

# **2021 Illinois Statewide Technical Reference Manual for Energy Efficiency Version 9.0**

## **Volume 1: Overview and User Guide**

**FINAL  
September 25, 2020**

**Effective:  
January 1, 2021**

## Table of Contents

### VOLUME 1: OVERVIEW AND USER GUIDE

<b>1 Purpose of the TRM .....</b>	<b>4</b>
1.1 Acknowledgments .....	4
1.2 Summary of Measure Revisions .....	6
1.3 Enabling ICC Policy.....	22
1.4 Development Process .....	22
1.4.1 Reliability Review.....	24
<b>2 Organizational Structure.....</b>	<b>26</b>
2.1 Measure Code Specification.....	26
2.2 Components of TRM Measure Characterizations.....	27
2.3 Variable Input Tables .....	28
2.3.1 C&I Custom Value Use in Measure Implementation .....	29
2.4 Program Delivery & Baseline Definitions .....	29
2.4.1 Default Measure Type for Program Delivery Methods.....	31
<b>3 Assumptions .....</b>	<b>33</b>
3.1 Footnotes & Documentation of Sources.....	33
3.2 General Savings Assumptions.....	33
3.3 Shifting Baseline Assumptions.....	33
3.3.1 LED Lamp and Linear Fixture Baseline Assumptions.....	34
3.3.2 Early Replacement Baseline Assumptions.....	35
3.3.3 Furnace Baseline .....	35
3.4 Provisional Measures Savings Assumptions .....	36
3.5 Glossary.....	36
3.6 Electrical Loadshapes (kWh).....	42
3.7 Summer Peak Period Definition (kW) .....	54
3.8 Heating and Cooling Degree-Day Data.....	54
3.9 Measure Incremental Cost Definition.....	58
3.10 Discount Rates, Inflation Rates, and O&M Costs .....	59
3.11 Interactive Effects .....	60

### VOLUME 2: COMMERCIAL AND INDUSTRIAL MEASURES

### VOLUME 3: RESIDENTIAL MEASURES

### VOLUME 4: CROSS-CUTTING MEASURES AND ATTACHMENTS

**ATTACHMENT A: ILLINOIS STATEWIDE NET-TO-GROSS METHODOLOGIES**

**ATTACHMENT B: EFFECTIVE USEFUL LIFE FOR CUSTOM MEASURE GUIDELINES**

**ATTACHMENT C: FRAMEWORK FOR COUNTING MARKET TRANSFORMATION SAVINGS IN ILLINOIS**

**Tables and Figures**

Table 1.1: Document Revision History..... 5

Table 1.2: Summary of Measure Level Changes..... 6

Table 1.3: Summary of Measure Revisions ..... 7

Table 1.4: Summary of Attachment A: IL-NTG Methods Revisions ..... 21

Table 1.5: Summary of Attachment C: Market Transformation Framework Revisions ..... 21

Table 2.1: End-Use Categories in the TRM..... 26

Table 2.2: Measure Code Specification Key ..... 27

Table 3.2: On- and Off-Peak Energy Definitions..... 42

Table 3.3: Loadshapes by Season ..... 43

Table 3.4: Loadshapes by Month and Day of Week ..... 46

Table 3.5: Degree-Day Zones and Values by Market Sector ..... 54

Figure 3.1: Cooling Degree-Day Zones by County ..... 55

Figure 3.2: Heating Degree-Day Zones by County..... 56

Table 3.6: Heating Degree-Day Zones by County..... 56

Table 3.7: Cooling Degree-day Zones by County..... 57

# 1 Purpose of the TRM

The purpose of the Illinois Statewide Technical Reference Manual (TRM or IL-TRM) is to provide a transparent and consistent basis for calculating energy (electric kilowatt-hours (kWh) and natural gas therms) and capacity (electric kilowatts (kW)) savings generated by the State of Illinois’ energy efficiency programs,<sup>1</sup> which are administered by the state’s largest electric and gas Utilities (collectively, Program Administrators or the Utilities).<sup>2</sup>

The TRM is a technical document that is filed with the Illinois Commerce Commission (Commission or ICC) and is intended to fulfill a series of objectives, including:

- “Serve as a common reference document for all... stakeholders, [Program Administrators], and the Commission, so as to provide transparency to all parties regarding savings assumptions and calculations and the underlying sources of those assumptions and calculations.
- Support the calculation of the Illinois Total Resource Cost test (“TRC”),<sup>3</sup> as well as other cost-benefit tests in support of program design, evaluation and regulatory compliance. Actual cost-benefit calculations and the calculation of avoided costs will not be part of this TRM.
- Identify gaps in robust, primary data for Illinois, that can be addressed via evaluation efforts and/or other targeted end-use studies.
- [Provide] a process for periodically updating and maintaining records, and preserve a clear record of what deemed parameters are/were in effect at what times to facilitate evaluation and data accuracy reviews.
- ...[S]upport coincident peak capacity (for electric) savings estimates and calculations for electric utilities in a manner consistent with the methodologies employed by the utility’s Regional Transmission Organization (“RTO”), as well as those necessary for statewide Illinois tracking of coincident peak capacity impacts.”<sup>4</sup>

## 1.1 Acknowledgments

This document was created through collaboration amongst the members of the Illinois Energy Efficiency Stakeholder Advisory Group (SAG). The SAG is an open forum where interested parties may participate in the evolution of Illinois’ energy efficiency programs. Parties wishing to participate in the SAG process may do so by visiting <http://www.ilsag.info/questions.html> and contacting the Independent Facilitator Celia Johnson at [celia@celiajohnsonconsulting.com](mailto:celia@celiajohnsonconsulting.com). Parties wishing to participate in the Technical Advisory Committee (TAC), a subcommittee of the SAG, may do so by contacting the TRM Administrator at [iltrmadministrator@veic.org](mailto:iltrmadministrator@veic.org).

SAG/TAC Stakeholders <sup>5</sup>
ADM Associates
Ameren Illinois Company (Ameren)
Apex Analytics
Applied Energy Group
Cadmus
Citizen's Utility Board (CUB)
City of Chicago
CLEARResult
Commonwealth Edison Company (ComEd)
CNT Energy
DNV GL

<sup>1</sup> 220 ILCS 5/8-103B and 220 ILCS 5/8-104.

<sup>2</sup> The Program Administrators include: Ameren Illinois, ComEd, Peoples Gas, North Shore Gas, and Nicor Gas (collectively, the Utilities).

<sup>3</sup> The Illinois TRC test is defined in 220 ILCS 5/8-104(b) and 20 ILCS 3855/1-10.

<sup>4</sup> Illinois Statewide Technical Reference Manual Request for Proposals, August 22, 2011, pages 3-4, [http://ilsag.org/yahoo\\_site\\_admin/assets/docs/TRM\\_RFP\\_Final\\_part\\_1.230214520.pdf](http://ilsag.org/yahoo_site_admin/assets/docs/TRM_RFP_Final_part_1.230214520.pdf)

<sup>5</sup> Being an open forum, this list of SAG stakeholders and participants may change at any time.

SAG/TAC Stakeholders <sup>5</sup>
Elevate Energy
Energy Futures Group
Energy Resources Center at the University of Illinois, Chicago (ERC)
Environment IL
Environmental Law and Policy Center (ELPC)
First Tracks Consulting Service, Inc.
Franklin Energy
Frontier Energy
Future Energy Enterprises LLC
GDS Associates
GTI Energy
Guidehouse
Illinois Attorney General's Office (AG)
Illinois Commerce Commission Staff (ICC Staff)
International Energy Conservation Consultants (IECC)
Itron
Leidos
Metropolitan Mayor's Caucus (MMC)
Michaels Energy
Midwest Energy Efficiency Association (MEEA)
Natural Resources Defense Council (NRDC)
Nexant
Nicor Gas
Opinion Dynamics
Optimal Energy
Peoples Gas and North Shore Gas
Resource Innovations
Slipstream
360 Energy Group

**Table 1.1: Document Revision History**

Document Title	Applicable to PY Beginning
Illinois_Statewide_TRM_Effective_060112_Version_1.0_091412_Clean.doc	6/1/12
Illinois_Statewide_TRM_Effective_060113_Version_2.0_060713_Clean.docx	6/1/13
Illinois_Statewide_TRM_Effective_060114_Version_3.0_022414_Clean.docx	6/1/14
Illinois_Statewide_TRM_Effective_060115_Final_022415_Clean.docx	6/1/15
IL-TRM_Effective_060116_v5.0_Vol_1_Overview_021116_Final IL-TRM_Effective_060116_v5.0_Vol_2_C_and_I_021116_Final IL-TRM_Effective_060116_v5.0_Vol_3_Res_021116_Final IL-TRM_Effective_060116_v5.0_Vol_4_X-Cutting_Measures_and_Attach_021116_Final	6/1/16
IL-TRM_Effective_010118_v6.0_Vol_1_Overview_020817_Final IL-TRM_Effective_010118_v6.0_Vol_2_C_and_I_020817_Final IL-TRM_Effective_010118_v6.0_Vol_3_Res_020817_Final IL-TRM_Effective_010118_v6.0_Vol_4_X-Cutting_Measures_and_Attach_020817_Final	1/1/18
IL-TRM_Effective_010119_v7.0_Vol_1_Overview_092818_Final IL-TRM_Effective_010119_v7.0_Vol_2_C_and_I_092818_Final IL-TRM_Effective_010119_v7.0_Vol_3_Res_092818_Final IL-TRM_Effective_010119_v7.0_Vol_4_X-Cutting_Measures_and_Attach_092818_Final	1/1/19

Document Title	Applicable to PY Beginning
IL-TRM_Effective_010120_v8.0_Vol_1_Overview_101719_Final IL-TRM_Effective_010120_v8.0_Vol_2_C_and_I_101719_Final IL-TRM_Effective_010120_v8.0_Vol_3_Res_101719_Final IL-TRM_Effective_010120_v8.0_Vol_4_X-Cutting_Measures_and_Attach_101719_Final	1/1/20
IL-TRM_Effective_010121_v9.0_Vol_1_Overview_092520_Final IL-TRM_Effective_010121_v9.0_Vol_2_C_and_I_092520_Final IL-TRM_Effective_010121_v9.0_Vol_3_Res_092520_Final IL-TRM_Effective_010121_v9.0_Vol_4_X-Cutting_Measures_and_Attach_092520_Final	1/1/21

## 1.2 Summary of Measure Revisions

The following tables summarize the evolution of measures that are new, revised or errata. This version of the TRM contains 116 measure-level changes as described in the following table.

**Table 1.2: Summary of Measure Level Changes**

Change Type	# Changes
Errata	6
Revision	85
New Measure	24
Retired	1
Total Changes	116

The ‘Change Type’ column indicates what kind of change each measure has gone through. Specifically, when a measure error was identified and the TAC process resulted in a consensus, the measure is identified here as an ‘Errata’. In these instances, the measure code indicates that a new version of the measure has been published, and that the effective date of the measure dates back to January 1, 2020. Measures that are identified as ‘Revised’ were included in the eighth edition of the TRM and have been updated for this edition of the TRM. Both ‘Revised’ and ‘New Measure(s)’ have an effective date of January 1, 2021.

The following table provides an overview of the 116 measure-level changes that are included in this version of the TRM.

**Table 1.3: Summary of Measure Revisions**

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
Volume 1: Overview	N/A	1.1 Acknowledgments	N/A	Revision	Updates to table of SAG/TAC Stakeholders	N/A
		2.2 Components of TRM Measure Characterizations		Revision	Edits to 'Deemed Lifetime of Efficient Equipment' to be consistent with new language in the Glossary.	
		3.3.1 LED Lamp and Linear Fixture Baseline Assumptions		Revision	Updates to text to reflect new approach to LED Lamps.	
		3.5 Glossary		Revision	Addition of Drug Store and Auto Dealership building definitions. Public Sector terminology changed to Emergency Services, and definition provided. Term updated in all building type tables in volume 2. Clarification of Technical v Measure Lifetime definitions.	
		3.5 Electrical Loadshapes (kWh)		Revision	Addition of 6 new agricultural, 2 new Voltage Optimization and a Residential Electric Vehicle Charger Loadshapes.	
		3.1 Discount Rates, Inflation Rates and O&M Costs		Revision	Update to nominal and real discount rates and inflation rate.	
Volume 2: Commercial and Industrial Measures	4.1 Agricultural	4.1.11 Commercial LED Grow Lights	CI-AGE-GROW-V02-210101	Revision	Updates to eligibility, efficient and baseline assumptions. Updates to measure life and coincidence factors. Calculation methods provided for grow space square footage or per fixture. Additional hour assumptions for different crop types. Updates to HVAC interactive effects assumptions.	Dependent on inputs
		4.1.12 Swine Heat Pads	CI-AGE-HPAD-V01-210101	New	New measure	N/A
	4.2 Food Service Equipment	4.2.10 Ice Maker	CI-FSE-ESIM-V04-210101	Revision	Correct typo of federal standard date.	N/A
		4.2.16 Kitchen Demand Ventilation Controls	CI-FSE-VENT-V04-210101	Revision	Addition of IECC 2018 code considerations. Update to measure life and cost assumptions.	Increase in lifetime savings.

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
	4.3 Hot Water	4.3.1 Storage Water Heater	CI-HWE-STWH-V06-210101	Revision	Addition of all draw pattern baseline calculation algorithms plus note that same draw pattern should be used for efficient and baseline units.	Dependent on inputs
		4.3.6 Ozone Laundry	CI-HWE-OZLD-V05-210101	Revision	Update to measure cost assumption.	N/A
		4.3.12 Tank Insulation	CI-HWE-TKIN-V01-210101	New	New measure	N/A
	4.4 HVAC	4.4.1 Air Conditioner Tune-up	CI-HVC-ACTU-V06-210101	Revision	Changed measure cost to be based on actual invoiced cost.	N/A
		4.4.2 Space Heating Boiler Tune-Up	CI-HVC-BLRT-V07-210101	Revision	Provided defaults for pre and post efficiency based on Guidehouse evaluation results. Language added allowing in-house staff to perform select tune-up activities.	N/A
		4.4.3 Process Boiler Tune-Up	CI-HVC-PBTU-V06-210101	Revision	Provided defaults for pre and post efficiency based on Guidehouse evaluation results.	N/A
		4.4.4 Boiler Lockout/Reset Controls	CI-HVC-BLRC-V04-210101	Revision	Update to measure life assumption.	Decrease in lifetime savings.
		4.4.10 High Efficiency Boiler	CI-HVC-BOIL-V08-210101	Revision	TAC decision to delay impact of Federal Standard until 1/1/2022 due to sell through of existing product. Added language of pending Standard.	N/A
		4.4.11 High Efficiency Furnace	CI-HVC-FRNC-V10-210101	Revision	Clarification of Federal Standard. Addition of HOURSyear assumptions for additional building types.	N/A
		4.4.12 Infrared Heaters	CI-HVC-IRHT-V02-210101	Revision	Modifications to measure to allow savings to be claimed by size. Updates to measure life and cost.	Dependent on inputs
		4.4.14 Pipe Insulation	CI-HVC-PINS-V06-210101	Revision	Addition of reference to external tool allowing more flexibility and comprehensive analysis of pipe insulation projects. Update to wind speed assumption for outdoor pipe insulation from 9.4 mph to 5mph to account for greater shielding. GTI are looking in to adjusting their calculator tool and updating the defaults based on this new assumption.	Decrease for outdoor application



Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		4.4.16 Steam Trap Replacement or Repair	CI-HVC-STRE-V07-210101	Revision	New additional algorithm provided for calculation of steam trap loss for low pressure systems. For MF space heating LPS systems, savings capped at 20% of building load. Addition of lifetime assumptions for Venturi Steam Traps	Decrease for MF LPS
		4.4.17 Variable Speed Drives for HVAC Pumps and Cooling Tower Fans	CI-HVC-VSDHP-V08-210101	Revision	Clarification that hours should be provided via Energy Management Software or metered. Addition of Hours assumptions for additional building types.	N/A
		4.4.26 Variable Speed Drives for HVAC Supply and Return Fans	CI-HVC-VSDF-V06-210101	Revision	Removal of language that implies all other VSD applications should be custom. Clarification that hours should be provided via Energy Management Software or metered.	N/A
		4.4.28 Stack Economizer for Boilers Serving HVAC Loads	CI-HVC-BECO-V02-210101	Revision	Fixed footnote issue. Added custom input for O&M impacts rather than N/A.	N/A
		4.4.32 Combined Heat and Power	CI-HVC-CHAP-V05-210101	Revision	Update to Heat Rate assumption based on eGrid 2018.	Dependent on inputs
		4.4.34 Destratification Fan	CI-HVC-DSFN-V05-210101	Revision	Recommendation for actual costs if known and other clarifications. Addition of commercial sized HP effective COP estimates.	N/A
		4.4.38 Covers and Gap Sealers for Room Air Conditioners	CI-HVC-CRAC-V02-200101	Errata	Fixing typos in algorithm that would result in incorrect savings.	N/A
		4.4.44 Commercial Ground Source and Ground Water Source Heat Pump	CI-HVC-GSHP-V04-210101	Revision	Update to Heat Rate assumption based on eGrid 2018. Updates and clarifications on applicable codes. The gas heat consumption is now calculated consistently using 'FLH * Capacity' as opposed to using default assumptions. Adjustments to format of fuel switching calculations. The electric only scenario for fuel switches now appropriately incorporates the fuel switch part of the scenario, and not just the efficiency improvement.	Dependent on inputs

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
					Assumptions for the remaining useful life of different types of existing equipment provided.  Additional calculations provided to determine the total source energy savings to determine eligibility, and provided in example calculations.	
		4.4.45 Adsorbent Air Cleaning	CI-HVC-ADAC-V03-210101	Revision	Removal of Provisional Measure status. Edit to electric savings based on updated pilot study results and including energy penalty of AAC modules. Addition of natural gas savings. Addition of NC and DI program types. Updates to measure cost.	Dependent on inputs
		4.4.48 Small Commercial Thermostats – Provisional Measure	CI-HVC-THST-V02-210101	Revision	Update to cooling assumption from 8% to 17.7% based on Guidehouse evaluation. Heating %Savings updated to 8.8% to reflect the manual only baseline from the residential measure. Footnotes relating to appropriate NTG application added. Propose remain Provisional Measure as additional evaluation on heating savings and on Advanced Thermostats would benefit this characterization.	Increase in cooling and heating savings
		4.4.49 Boiler Chemical Descaling	CI-HVC-BCHD-V01-210101	New	New measure	N/A
		4.4.50 Electric Chillers with Integrated Variable Speed Drives	CI-HVC-CFVD-V01-210101	New	New measure	N/A
		4.4.51 Advanced Rooftop Controls with High Rotor Pole Switch Reluctance Motors	CI-HVC-HSRM-V01-210101	New	New measure	N/A
		4.4.52 Hydronic Heating Radiator Replacement	CI-HVC-HHRR-V01-210101	New	New measure	N/A

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
	4.5 Lighting	4.5 Lighting End Use Factors	N/A	Revision	Addition of hours and waste heat factors for 8 agriculture operations. Update to fixture annual operating hours and IF waste heat factors for Grocery. Addition of accounting for lighting controls in lighting hours assumptions.	N/A
		4.5.2 Fluorescent Delamping	CI-LTG-DLMP-V03-210101	Revision	Updates to T12:T8 weighting based on latest ComEd Baseline Study.	Decrease
		4.5.4 LED Bulbs and Fixtures	CI-LTG-LEDB-V11-200101	Errata	Lamp measures updated to reflect Lighting Working Group developed forecasts of natural LED growth. Impacts measure lifetime, mid-life baseline adjustment and O&M impacts.	Increase in lifetime savings
			CI-LTG-LEDB-V12-210101	Revision	Update to v9 based on forecasts of natural LED growth. Update to T12 early replacement midlife adjustment based on 2019 ComEd baseline survey results. Update to LED Display Case Watts assumptions. Additional high lumen fixture assumptions added.	Dependent on inputs
		4.5.8 Miscellaneous Commercial/Industrial Lighting	CI-LTG-MSCI-V04-210101	Revision	Update to measure life assumption and ISR to make consistent with other measures.	Increase in lifetime savings
		4.5.9 Multi-Level Lighting Switch	CI-LTG-MLLC-V05-210101	Revision	Update to measure life assumption	Increase in lifetime savings
		4.5.10 Lighting Controls	CI-LTG-OSLC-V06-210101	Revision	Addition of new set of assumptions for Luminaire Level Lighting Controls (LLLCs) with high end trim and networking capabilities. Addition of (ESFEE – ESFBase) term in algorithm to allow comparison of any existing condition. Addition of prior assumptions for “Vacancy Sensors”. Addition of refrigerated case occupancy sensor assumptions. Update to measure lifetime. New lifetime specific to NLC/LLLCs, tied to fixture lifetime of 15 years added. Addition of language that where possible installation should be verified where savings beyond occupancy sensing are claimed.	Dependent on inputs

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		4.5.13 Occupancy Controlled Bi-Level Lighting Fixtures	CI-LTG-OCBL-V04-210101	Revision	Update to measure life assumption	Increase in lifetime savings
		4.5.16 LED Streetlighting	CI-LTG-STRT-V02-210101	Revision	Update to measure lifetime. Addition of TOS considerations with note that it is recommended to consider likely high freeridership for this measure as TOS. Update to early replacement remaining useful life.	Increase in lifetime savings
		4.5.17 Exterior Photocell Repair	CI-LTG-PHRP-V01-210101	New	New measure	N/A
	4.6 Refrigeration	4.6.4 Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers	CI-RFG-ECMF-V03-210101	Revision	Addition of default motor size for when it is unknown.	N/A
		4.6.5 ENERGY STAR Refrigerated Beverage Vending Machine	CI-RFG-ESVE- V04-210101	Revision	Update to ENERGY STAR specification v4.0, effective April 2020.	Dependent on inputs
		4.6.13 Add Doors to Open Refrigerated Display Cases	CI-RFG-DOOR-V01-210101	New	New measure	N/A
	4.7 Compressed Air	4.7.7 Efficient Desiccant Compressed Air Dryer	CI-CPA-DDRY-V02-210101	Revision	Addition of Purge Reduction Factor.	Decrease
		4.7.8 Desiccant Dryer Dew Point Demand Controls	CI-CPA-DPDC-V01-210101	New	New measure	N/A
		4.7.9 Compressed Air Heat Recovery	CI-CPA-CHR-V01-210101	New	New measure	N/A
		4.7.10 Compressed Air Storage Receiver Tank	CI-CPA-CASRT-V01-210101	New	New measure	N/A
		4.7.11 Reduce Compressed Air Setpoint	CI-CPA-RCAS-V01-210101	New	New measure	N/A
	4.8 Miscellaneous	4.8.1 Pump Optimization	CI-MSC-PMPO-V03-210101	Revision	Added loadshapes	N/A
		4.8.2 Roof Insulation for C&I Facilities	CI-MSC-RINS-V05-210101	Revision	Reworded to use actual inputs if available for costs and existing conditions.	N/A

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		4.8.3 Computer Power Management Software	CI-MSC-CPMS-V03-210101	Revision	Addition of assumptions for adjusting power settings on individual units. Savings the same, difference in cost and lifetime.	N/A
		4.8.5 High Speed Clothes Washer	CI-MSC-HSCW-V02-210101	Revision	Clarification that this measure applies to facilities with gas dryers only. Update to Retained Moisture Content assumption.	Decrease
		4.8.6 ENERGY STAR Computers	CI-MSC-COMP-V03-210101	Revision	Update to ENERGY STAR v8, effective October 15th, 2020.	Decrease
		4.8.8 High Efficiency Transformer	CI-MSC-TRNS-V02-210101	Revision	Updated loadshape to new Ameren and ComEd utility system loads rather than Flat. Review deadline set to 1/1/2022 as there is a potential update to the Federal Standard.	N/A
		4.8.14 Low Flow Toilets and Urinals	CI-MSC-LFTU-V02-210101	Revision	Updated number of flushes per day assumptions based on more appropriate reference.	Decrease
		4.8.17 Switch Peripheral Equipment Consolidation	CI-MSC-SPEC-V01-210101	New	New measure	N/A
		4.8.18 ENERGY STAR Uninterruptible Power Supply	CI-MSC-UPSE-V01-210101	New	New measure	N/A
		4.8.19 Energy Efficient Rectifier	CI-MSC-RECT-V01-210101	New	New measure	N/A
		4.8.20 Energy Efficient Hydraulic Oils - Provisional Measure	CI-MSC-EEHO-V01-210101	New	New measure	N/A
		4.8.21 Energy Efficient Gear Lubricants - Provisional Measure	CI-MSC-EEGL-V01-210101	New	New measure	N/A
		4.8.22 Smart Sockets	CI-MSC-SSOC-V01-210101	New	New measure	N/A
Volume 3 – Residential Measures	5.1 Appliances	5.1.1 ENERGY STAR Air Purifier	RS-APL-ESAP-V04-210101	Revision	Update due to ENERGY STAR Version 2.0, effective October 17, 2020.	Decrease
		5.1.3 ENERGY STAR Dehumidifier	RS-APL-ESDH-V08-210101	Revision	Update to ENERGY STAR Most Efficient specification and recalculation	Decrease
		5.1.4 ENERGY STAR Dishwasher	RS-APL-ESDI-V06-210101	Revision	Fixing typo of ENERGY STAR version number	N/A

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		5.1.6 ENERGY STAR and CEE Tier 2 Refrigerator	RS-APL-ESRE-V08-200101	Errata	Fixing error in CEE Tier 2 specification which was assuming 25% better than Federal Standard rather than 15%	Decrease for CEE T2
		5.1.10 ENERGY STAR Clothes Dryer	RS-APL-ESDR-V04-210101	Revision	Addition of Most Efficient criteria and assumptions.	N/A
		5.1.12 Ozone Laundry	RS-APL-OZNE-V03-210101	Revision	Fixing typo of CEE tier used in calculation.	N/A
		5.1.13 Income Qualified: ENERGY STAR Room AC	RS-APL-IQRA-V01-210101	New	New Measure	N/A
	5.2 Consumer Electronics	5.2.1 Advanced Power Strip – Tier 1	RS-CEL-SSTR-V06-210101	Revision	Updates to ISR assumptions based on Guidehouse evaluation.	Dependent on inputs
		5.2.2 Tier 2 Advanced Power Strip – Residential Audio Visual	RS-CEL-APS2-V05-210101	Revision	Removal of requirement for independent field testing. Replacement of manufacture specific performance bands with assumptions related to IR-only v IR-OS product types.	N/A
	5.3 HVAC	5.3.1 Air Source Heat Pump	RS-HVC-ASHP-V10-210101	Revision	Addition of assumptions relating to fuel switch scenarios. Assumptions for the remaining useful life of different types of existing equipment provided. Clarification that install costs should include any necessary electrical and distribution costs, and that defaults should not be used for fuel switch scenarios. The gas heat consumption is now calculated consistently using 'FLH * Capacity' as opposed to using default assumptions. The electric only scenario for fuel switches now appropriately incorporates the fuel switch part of the scenario, and not just the efficiency improvement. Added defaults for HSPFadj assumption. Additional calculations provided to determine the total source energy savings to determine eligibility and provided in example calculations.	N/A
		5.3.2 Boiler Pipe Insulation	RS-HVC-PINS-V04-210101	Revision	Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	N/A

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		5.3.3 Central Air Conditioning	RS-HVC-CAC1-V09-210101	Revision	Added requested clarification on measure eligibility that while ENERGY STAR SEER is a requirement, the EER is not an absolute requirement.	N/A
		5.3.4 Duct Insulation and Sealing	RS-HVC-DINS-V09-210101	Revision	Energy Conservatory Blower Door method document and BPI Distribution Efficiency table saved to SharePoint and weblink removed from document. Mid-life adjustment calculation fixed for gas fueled systems to appropriate incorporate the change in equipment efficiency.	N/A
		5.3.5 Furnace Blower Motor	RS-HVC-FBMT-V06-210101	Revision	Removal of language relating to new high efficiency equipment, since this is now a retrofit only measure. Removal of TOS assumptions from savings tables.	N/A
		5.3.6 Gas High Efficiency Boiler	RS-HVC-GHEB-V08-210101	Revision	TAC decision to delay impact of Federal Standard until 1/1/2022 due to sell through of existing product. Added language of pending Standard.	N/A
		5.3.7 Gas High Efficiency Furnace	RS-HVC-GHEF-V10-210101	Revision	Addition to cost assumption for 97% AFUE unit. Addition of Input Capacity and AFUE(eff) default assumptions.	N/A
		5.3.8 Ground Source Heat Pump	RS-HVC-GSHP-V10-210101	Revision	Update to Heat Rate assumption based on eGrid 2018. Assumptions for the remaining useful life of different types of existing equipment provided. Clarification that install costs should include any necessary electrical and distribution costs, and that defaults should not be used for fuel switch scenarios. The gas heat consumption is now calculated consistently using 'FLH * Capacity' as opposed to using default assumptions. Adjustments to format of fuel switching calculations. The electric only scenario for fuel switches now appropriately incorporates the fuel switch part of the scenario, and not just the efficiency improvement. Added defaults for HSPFadj assumption. Updated assumption for existing efficiency of GSHP being early replaced to 14SEER and 12 EER.	Dependent on inputs

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
					Additional calculations provided to determine the total source energy savings to determine eligibility and provided in example calculations.	
		5.3.10 HVAC Tune Up (Central Air Conditioning or Air Source Heat Pump)	RS-HVC-TUNE-V06-210101	Revision	Updated cost assumption	N/A
		5.3.11 Programmable Thermostats	RS-HVC-PROG-V07-210101	Revision	Update to measure life to make consistent with Weighted Average Measure Life definitions.	N/A
		5.3.12 Ductless Heat Pump	RS-HVC-DHP-V08-210101	Revision	Update to Heat Rate assumption based on eGrid 2018. Assumptions for the remaining useful life of different types of existing equipment provided. Clarification that install costs should include any necessary electrical and distribution costs, and that defaults should not be used for fuel switch scenarios. The gas heat consumption is now calculated consistently using 'FLH * Capacity' as opposed to using default assumptions. Adjustments to format of fuel switching calculations. The electric only scenario for fuel switches now appropriately incorporates the fuel switch part of the scenario, and not just the efficiency improvement. Update to EER assumptions to make consistent with Opinion Dynamics source. Additional calculations provided to determine the total source energy savings to determine eligibility and provided in example calculations.	Dependent on inputs
		5.3.13 Residential Furnace Tune-Up	RS-HVC-FTUN-V06-210101	Revision	Removal of HVAC SAVE methodology and assumptions.	N/A
		5.3.14 Boiler Reset Controls	RS-HVC-BREC-V03-210101	Revision	Updated measure life. Removal of mid-life adjustment for this measure, assuming that the BRC will last the remaining useful life of the existing boiler.	Decrease lifetime savings
		5.3.15 ENERGY STAR Ceiling Fan	RS-HVC-CFAN-V03-210101	Revision	Fix reference to LED Fixture measure for lighting considerations. No further changes recommended.	N/A



Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		5.3.16 Advanced Thermostats	RS-HVC-ADTH-V05-210101	Revision	Update to Cooling_Reduction and Cooling_DemandReduction value, to incorporate 90%/10% weighting of Guidehouse econometric evaluation results and the adjusted ENERGY STAR method for estimating runtime savings. It also now accounts for Thermostat Optimization savings. Update to Heating_Reduction to include accounting for Thermostat Optimization savings. Updates to Eff_ISR, unknown SEER and EER variables. Footnotes relating to appropriate NTG application added.	Increase in cooling energy savings, demand and heating savings
		5.3.17 Gas High Efficiency Combination Boiler	RS-HVC-COMB-V02-210101	Revision	Added reference to Federal Standard applying from 1/1/2022 due to sell through of existing product.	N/A
		5.3.18 Furnace Filter Alarm – Provisional Measure	N/A	Retired	Measure removed due to evaluation showing ineffectual results and safety concerns over reliance on measure that may not work.	N/A
		5.3.19 Thermostatic Radiator Valves – Provisional Measure	RS-HVC-TRVS-V01-210101	New	New measure	N/A
	5.4 Hot Water	5.4.1 Domestic Hot Water Pipe Insulation	RS-HWE-PINS-V04-210101	Revision	Addition of KITS and corresponding ISR assumption.	Dependent on inputs
		5.4.2 Gas Water Heater	RS-HWE-GWHT-V09-210101	Revision	Addition of additional draw pattern Federal Standard algorithms, with default provided for <55 gallons (Medium draw) and >55 gallons (High draw). Efficient equipment rating at different draw patterns added. Removal of adjustment for tankless water heaters since UEF better reflect typical draw over 24 hour period.	Dependent on inputs
		5.4.3 Heat Pump Water Heaters	RS-HWE-HPWH-V10-210101	Revision	Addition of additional draw pattern Federal Standard algorithms, with default provided for <55 gallons (Medium draw) and >55 gallons (High draw). Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	Dependent on inputs

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		5.4.4 Low Flow Faucet Aerators	RS-HWE-LFFA-V10-210101	Revision	Clarification added that secondary kWh savings from water supply/treatment should not be included in peak kW savings calculation.	N/A
		5.4.6 Water Heater Temperature Setback	RS-HWE-TMPS-V08-210101	Revision	Added language to include costs of information insert for when part of a kit program. Added ISR for instructions provided in kit.	N/A
		5.4.11 Drain Water Heat Recovery	RS-DHW-DWHR-V01-210101	New	New measure	N/A
	5.5 Lighting	5.5.6 LED Specialty Lamps	RS-LTG-LEDD-V11-200101	Errata	Lamp measures updated to reflect Lighting Working Group developed forecasts of natural LED growth. Impacts measure lifetime, mid-life baseline adjustment and O&M impacts. Additional forecasts developed and utilized for Income Eligible populations. Accounting for IECC 2015/2018 in New Construction baseline. Baseline assumptions and incremental costs provided for NC program.	Increase in lifetime savings. Decrease for New Construction
			RS-LTG-LEDD-V12-210101	Revision	Update to v9 based on forecasts of natural LED growth.	N/A
		5.5.8 LED Screw Based Omnidirectional Bulbs	RS-LTG-LEDA-V9-200101	Errata	Lamp measures updated to reflect Lighting Working Group developed forecasts of natural LED growth. Impacts measure lifetime, mid-life baseline adjustment and O&M impacts. Additional forecasts developed and utilized for Income Eligible populations. Accounting for IECC 2015/2018 in New Construction baseline. Baseline assumptions and incremental costs provided for NC program.	Increase in lifetime savings. Decrease for New Construction
			RS-LTG-LEDA-V10-210101	Revision	Update to v9 based on forecasts of natural LED growth.	N/A

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
		5.5.9 LED Fixtures	RS-LTG-LDFX-V03-200101	Errata	Lamp measures updated to reflect Lighting Working Group developed forecasts of natural LED growth. Impacts measure lifetime, mid-life baseline adjustment and O&M impacts. Additional forecasts developed and utilized for Income Eligible populations. Accounting for IECC 2015/2018 in New Construction baseline. Baseline assumptions and incremental costs provided for NC program.	Increase in lifetime savings. Decrease for New Construction
			RS-LTG-LDFX-V04-210101	Revision	Update to v9 based on forecasts of natural LED growth.	N/A
	5.6 Shell	5.6.1 Airsealing	RS-SHL-AIRS-V09-210101	Revision	Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied. Footnotes relating to appropriate NTG application added.	N/A
		5.6.2 Basement Sidewall Insulation	RS-SHL-BINS-V11-210101	Revision	Extra parenthesis in algorithm. Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	N/A
		5.6.3 Floor Insulation Above Crawlspace	RS-SHL-FINS-V12-210101	Revision	Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	N/A
		5.6.4 Wall Insulation	RS-SHL-WINS-V10-210101	Revision	Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	N/A
		5.6.5 Ceiling/Attic Insulation	RS-SHL-AINS-V03-210101	Revision	Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	N/A
		5.6.6 Rim/Band Joist Insulation	RS-SHL-RINS-V03-210101	Revision	Addition of language that if existing equipment efficiency is greater than new baseline efficiency, mid-life adjustment should not be applied.	N/A
		5.6.7 Low-E Storm Window	RS-SHL-LESW-V01-210101	New	New measure	N/A

Volume	End Use	Measure Name	Measure Code	Change Type	Explanation	Impact on Savings
	5.7 Miscellaneous	5.7.3 Level 2 Electric Vehicle Charger	RS-MSC-L2CH-V01-210101	New	New measure	N/A
Volume 4 – Cross-Cutting Measures and Attachments	6.1 Behavior	6.1.1 Adjustments to Behavior Savings to Account for Persistence	CC-BEH-BEHP-V04-210101	Revision	Updated guidance for application for the 2022-2025 cycle. Additional adjustment to update of length of savings persistence for both electric and gas savings. Update to decay rate for both electric and gas savings. Added flexibility for measure life for non-RES HERs type programs to be > 1 yr with defensible evaluation results. Added flexible language to provide opportunity to make the case for persistent savings from customer move-outs with defensible evaluation results.	Increase in lifetime savings
	6.2 System Wide	6.2.1 Voltage Optimization	CC-SYS-VOPT-V01-210101	New	New measure	N/A
	Attachment B	Effective Useful Life for Custom Measure Guidelines	N/A	Revision	Update to custom lighting control measure life	N/A

**Table 1.4: Summary of Attachment A: IL-NTG Methods Revisions**

IL-TRM Volume	Sectors	Protocol Name	Change Type	Explanation
Vol. 4	All Sectors	Free-Ridership Specific Issues	Revision	Added section 2.2 with survey design language guidelines and details on supplementing self-report with historical tracing.
Vol. 4	All Sectors	Free-Ridership Specific Issues	Revision	Added source footnote to section 2.2.2.
Vol. 4	All Sectors	Appendix B	Revision	Revised Rathbun and Violette source year and updated source link throughout.
Vol. 4	Commercial, Industrial and Public Sector Programs	Core Participant Spillover Protocol	Revision	Updated language clarifying spillover questions are about participant’s experience with the program rather than a specific project or measure.
				Updated recommended spillover approach; Influence question wording must match impacts in participant spillover rate denominator.

**Table 1.5: Summary of Attachment C: Market Transformation Framework Revisions**

IL-TRM Volume	Section	Protocol Name	Change Type	Explanation
Vol. 4	Market Transformation Context	Overview	Addition	Added information on the development and documentation process for the Market Transformation Framework.

### 1.3 Enabling ICC Policy

This Illinois Statewide Technical Reference Manual (TRM) was developed to comply with the Illinois Commerce Commission (ICC or Commission) Final Orders from the electric and gas Utilities’ Energy Efficiency Plan dockets.<sup>6</sup> In the Final Orders, the ICC required the utilities to work with the Illinois Department of Commerce and Economic Opportunity (DCEO) and the Illinois Energy Efficiency Stakeholder Advisory Group (SAG) to develop a statewide TRM. See, e.g., ComEd’s Final Order (*Docket No. 10-0570, Final Order<sup>7</sup> at 59-60, December 21, 2010*); Ameren’s Final Order (*Docket No. 10-0568, Order on Rehearing<sup>8</sup> at 19, May 24, 2011*); Peoples Gas/North Shore Gas’ Final Order (*Docket No. 10-0564, Final Order<sup>9</sup> at 76, May 24, 2011*), and Nicor’s Final Order (*Docket No. 10-0562, Final Order<sup>10</sup> at 30, May 24, 2011*).

As directed in the Utilities’ Efficiency Plan Orders, the SAG had the opportunity to, and also participated in, every aspect of the development of the TRM. Interested members of the SAG participated in weekly teleconferences to review, comment, and participate in the development of the TRM. The active participants in the TRM were designated as the “Technical Advisory Committee” (TAC). The TAC participants include representatives from the following organizations:

- the Utilities (ComEd, Ameren IL, Nicor Gas, Peoples Gas/North Shore Gas),
- Implementation contractors (CLEAResult, Conservation Services Group, Elevate Energy, Franklin Energy, GDS Associates, PECL, 360 Energy Group),
- Illinois Department of Commerce and Economic Opportunity (DCEO),
- the independent evaluators (ADM Associates, The Cadmus Group, Itron, Guidehouse Consulting, Michael’s Engineering, Opinion Dynamics Corporation),
- ICC Staff,
- the Illinois Attorney General’s Office (AG),
- Natural Resources Defense Council (NRDC),
- the Environmental Law and Policy Center (ELPC),
- the Citizen’s Utility Board (CUB),
- The University of Illinois at Chicago,
- Future Energy Enterprises,
- Issue-specific invited participants, including; Geothermal Alliance of Illinois, the Geothermal Exchange Organization, Embertec, TrickleStar, Oracle, Google Nest, Ecobee, and US EPA ENERGY STAR.

### 1.4 Development Process

Each version of the IL-TRM is approved by the Commission in the ICC Dockets listed below, and can all be found on the ICC webpage; <https://www.icc.illinois.gov/programs/illinois-statewide-technical-reference-manual-for-energy-efficiency>. Errata to the IL-TRM versions may also be found on that ICC IL-TRM webpage.

TRM Version	ICC Docket Number
Version 1.0	12-0528
Version 2.0	13-0437
Version 3.0	14-0189

<sup>6</sup> The Illinois Utilities subject to this TRM include: Ameren Illinois Company d/b/a Ameren Illinois (Ameren), Commonwealth Edison Company (ComEd), The Peoples Gas Light and Coke Company and North Shore Gas Company, and Northern Illinois Gas Company d/b/a Nicor Gas.

<sup>7</sup> <http://www.icc.illinois.gov/docket/files.aspx?no=10-0570&docId=159809>

<sup>8</sup> <http://www.icc.illinois.gov/docket/files.aspx?no=10-0568&docId=167031>

<sup>9</sup> <http://www.icc.illinois.gov/docket/files.aspx?no=10-0564&docId=167023>

<sup>10</sup> <http://www.icc.illinois.gov/docket/files.aspx?no=10-0562&docId=167027>

TRM Version	ICC Docket Number
Version 4.0	15-0187
Version 5.0	16-0171
Version 6.0	17-0106
Version 7.0	18-1605
Version 8.0	19-0954

The policies surrounding the applicability and use of the IL-TRM in planning, implementation, and evaluation were originally established by the Commission in ICC Docket No. 13-0077,<sup>11</sup> and most recently in ICC Docket Nos. 17-0270<sup>12</sup> and 19-0983.<sup>13</sup>

This document represents the ninth version of the IL-TRM and it applies to Section 8-103B and Section 8-104 energy efficiency programs. It contains a series of new measures, as well as a series of errata items<sup>14</sup> and updates to existing measures that were already present in the first eight versions. Like the previous versions, it is a result of an ongoing review process involving the Illinois Commerce Commission (ICC) Staff (Staff or ICC Staff), the Utilities, the Evaluators, the SAG TAC, and the SAG. VEIC meets with the SAG and/or the TRM TAC at least once each month to create a high level of transparency and vetting in the development of this TRM.

Measure requests that are submitted by interested parties are ranked based on the following criteria to determine the approximate priority level for order of inclusion in the TRM:

1. High Priority
  - a. For those existing measures that make up a significant portion of a utilities’ portfolio and/or where the impact of the requested change is high
  - b. For new measures where plans are in place to implement in the next program year
2. Medium Priority
  - a. For existing measures that are a less significant percent of a utilities’ portfolio and value change will not have a significant impact
  - b. For new measures where a savings value is estimated but implementation plans not yet developed
3. Low Priority
  - a. For existing measures that represent a very small percent of a utilities’ portfolio
  - b. For new measures that are just beginning to be explored and will not be implemented in the next program year

These rankings are used to align budget and schedule constraints with desired updates from the TRM.

As measure requests are finalized leading up to the next update of the TRM, weekly TAC meetings are often scheduled to maximize the level of collaboration and visibility into the measure characterization process. Where consensus does not emerge on specific measures or issues, those items are identified in a memo. As a result, this TRM represents a broad consensus amongst the SAG and TAC participants. In keeping with the goal of transparency, all of the comments and their status to date are available through the TAC SharePoint web site, <https://portal.veic.org>.

---

<sup>11</sup><http://www.icc.illinois.gov/docket/files.aspx?no=13-0077&docId=203903>;  
<http://www.icc.illinois.gov/docket/files.aspx?no=13-0077&docId=195913>;  
<http://www.icc.illinois.gov/downloads/public/edocket/339744.pdf>

<sup>12</sup> <https://www.icc.illinois.gov/docket/files.aspx?no=17-0270&docId=257523>

<sup>13</sup> <https://icc.illinois.gov/docket/P2019-0983/documents/292186> Please see IL-TRM Policy Document Version 3.0 available at <https://icc.illinois.gov/docket/P2019-0983/documents/292186/files/509718.pdf>

<sup>14</sup> Errata as well as links to the official IL-TRM documents, dockets, and policy documents are available on the following ICC webpage: <http://www.icc.illinois.gov/Electricity/programs/TRM.aspx>

For each measure characterization, this TRM includes engineering algorithm(s) and a value(s) for each parameter in the equation(s). These parameters have values that fall into one of three categories: a single deemed value, a lookup table of deemed values or an actual value such as the capacity of the equipment. The TRM makes extensive use of lookup tables because they allow for an appropriate level of measure streamlining and customization within the context of an otherwise prescriptive measure.

Accuracy is the overarching principle that governs what value to use for each parameter. When it is explicitly allowed within the text of the measure characterization, the preferred value is the actual or on-site value for the individual measure being implemented. The *deemed values*<sup>15</sup> in the lookup tables are the next most accurate choice, and in the absence of either an actual value or an appropriate value in a lookup table, the single, *deemed value* should be used. As a result, this single, *deemed value* can be thought of as a default value for that particular input to the algorithm.

A single *deemed savings estimate* is produced by any given combination of an algorithm and the allowable input values for each of its parameters. In cases where lookup tables are provided, there is a range of deemed savings estimates that are possible, depending on site-specific factors such as equipment capacity, location and building type.

Algorithms and their parameter values are included for calculating estimated:

- Gross annual electric energy savings (kWh)
- Gross annual natural gas energy savings (therms)
- Gross electric summer coincident peak demand savings (kW)

To support cost-effectiveness calculations, parameter values are also included for:

- Incremental costs (\$)
- Measure life (years)
- Operation and maintenance costs (\$)
- Water (gal) and other resource savings where appropriate.

### 1.4.1 Reliability Review

The process of incorporating new and better information into the TRM occurs annually as new measures and errors are identified, program designs change, old measures are dropped from programs, or other external events (such as code and standard changes or new evaluations and other data) warrant a review of assumptions. However, not all measures have updates triggered by such events, and some measures continue to appear in the TRM without ongoing review. Short of proactively identified issues that would trigger an update to a TRM characterization, a regular reliability review should be undertaken to assess that the information in older measures is still relevant and reliable. This review will include a general appraisal of reasonableness and continued program relevancy and an update of any assumptions to reflect new information.

To ensure that measures initially developed in the past and not recently revisited are updated and retired as needed, each measure is given a Review Deadline – a date that triggers a reliability review. This Review Deadline is established for each measure based on factors such as expected revisions to energy codes or federal standards; knowledge of upcoming evaluation or research efforts; knowledge of rapidly changing technology, cost, baselines, or other factors; or expected shifts in current customer practices. No Review Deadline is longer than six years from the date of the initial characterization or last update of a measure. The TRM Administrator will propose Review Deadlines for each measure, and they are reviewed and approved by the TAC. The Review Deadline for each measure is indicated in the measure characterization within the TRM. For example, a Review Deadline specified as 1/1/2023 means that the measure will be reviewed no later than the annual IL-TRM update process that occurs in 2022, in advance of the

---

<sup>15</sup> Emphasis has been added to denote the difference between a “deemed value” and a “deemed savings estimate”. A deemed value refers to a single input value to an algorithm, while a deemed savings estimate is the result of calculating the end result of all of the values in the savings algorithm.



1/1/2023 Review Deadline. Following a review and/or update, a new Review Deadline will be assigned to that measure.

## 2 Organizational Structure

The organization of this document follows a three-level format. These levels are designed to define and clarify what the measure is and where it is applied.

### 1. Market Sectors Volumes<sup>16</sup>

- This level of organization specifies the type of customer the measures apply to, either Commercial and Industrial (provided in Volume 2), Residential (provided in Volume 3), or cross-cutting measures, such as Behavior Persistence (provided in Volume 4, together with Attachments including the documentation of Illinois Statewide Net-to-Gross Methodologies, Guidelines for EULs for Custom Measures, and Framework for Counting Market Transformation Savings in Illinois).
- Answers the question, “What category best describes the customer?”

### 2. End-use Category

- This level of organization represents most of the major end-use categories for which an efficient alternative exists. The following table lists all of the end-use categories in this version of the TRM.
- Answers the question, “To what end-use category does the measure apply?”

**Table 2.1: End-Use Categories in the TRM<sup>17</sup>**

Volume 2: Commercial and Industrial Market Sector	Volume 3: Residential Market Sector	Volume 4: Cross-Cutting Measures and Attachments
Agricultural Equipment	Appliances	Behavior
Food Service Equipment	Consumer Electronics	System Wide
Hot Water	Hot Water	
HVAC	HVAC	
Lighting	Lighting	
Refrigeration	Shell	
Compressed Air	Miscellaneous	
Miscellaneous		

### 3. Measure & Technology

- This level of organization represents individual efficient measures such as CFL lighting and LED lighting, both of which are individual technologies within the Lighting end-use category.
- Answers the question, “What technology defines the measure?”

This organizational structure is silent on which fuel the measure is designed to save; electricity or natural gas. By organizing the TRM this way, measures that save on both fuels do not need to be repeated. As a result, the TRM will be easier to use and to maintain.

## 2.1 Measure Code Specification

In order to uniquely identify each measure in the TRM, abbreviations for the major organizational elements of the TRM have been established. When these abbreviations are combined and delimited by a dash ('-') a unique, 18-character alphanumeric code is formed that can be used for tracking the measures and their associated savings estimates. Measure codes appear at the end of each measure and are structured using five parts.

**Code Structure = Market + End-use Category + Measure + Measure Version # + Effective Date**

<sup>16</sup> Note that the Public sector buildings and low income measures are not listed as a separate Market Sector. The Public building type is one of a series of building types that are included in the appropriate measures in the Commercial and Industrial Sector.

<sup>17</sup> Please note that this is not an exhaustive list of end-uses and that others may be included in future versions of the TRM.

For example, the commercial boiler measure is coded: “CI-HVC-BLR\_-V01-120601”

**Table 2.2: Measure Code Specification Key**

Market (@@)	End-use (@@@)	Measure (@@@@)	Version (V##)	Effective Date
CI (C&I)	AGE (Agricultural Equipment)	BLR_	V01	YYMMDD
RS (Residential)	APL (Appliances)	T5FX	V02	YYMMDD
CC (Cross-Cutting)	BEH (Behavior)	T8FX	V03	YYMMDD
	CEL (Consumer Electronics)	...	...	...
	CPA (Compressed Air)			
	FSE (Food Service Equipment)			
	HVC (HVAC)			
	HWE (Hot Water)			
	LTG (Lighting)			
	MSC (Miscellaneous)			
	RFG (Refrigeration)			
	SHL (Shell)			
	SYS (System-wide)			

## 2.2 Components of TRM Measure Characterizations

Each measure characterization uses a standardized format that includes at least the following components. Measures that have a higher level of complexity may have additional components, but also follow the same format, flow and function.

### DESCRIPTION

Brief description of measure stating how it saves energy, the markets it serves and any limitations to its applicability.

### DEFINITION OF EFFICIENT EQUIPMENT

Clear definition of the criteria for the efficient equipment used to determine delta savings. Including any standards or ratings if appropriate.

### DEFINITION OF BASELINE EQUIPMENT

Clear definition of the efficiency level of the baseline equipment used to determine delta savings including any standards or ratings if appropriate. If a Time of Sale measure the baseline will be new base level equipment (to replace existing equipment at the end of its useful life or for a new building). For Early Replacement or Early Retirement measures the baseline is the existing working piece of equipment that is being removed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected duration in years (or hours) that the measure is expected to provide savings. Please see “Measure Life” in Section 3.5 Glossary. This is often based on the rated technical life of the equipment but may also be adjusted in consideration of the potential for users to remove or remodel and to allow for breakages or imperfect operation. If the savings of a population is expected to *decline* due to outcomes such as the overriding of settings or poorly maintaining equipment, a midlife adjustment should be used to reduce the lifetime savings<sup>18</sup>; however, the measure lifetime should still reflect the technical lifetime (i.e. total years any savings are expected to occur).

If an early replacement measure, the assumed Remaining Useful Life (RUL) of the existing unit is also provided.

<sup>18</sup> In rare cases, for example residential Home Energy Report (HER) type programs, it may be appropriate to have savings decay each year throughout the measure life rather than in a midlife adjustment.

### **DEEMED MEASURE COST**

For time of sale measures, incremental cost from baseline to efficient is provided. Installation costs should only be included if there is a difference between each efficiency level. For Early Replacement the full equipment and install cost of the efficient installation is provided in addition to the full deferred hypothetical baseline replacement cost. See '3.9 Measure Incremental Cost Definition' for more detailed information concerning incremental cost calculations.

### **LOADSHAPE**

The appropriate loadshape to apply to electric savings is provided.

### **COINCIDENCE FACTOR**

The summer coincidence factor is provided to estimate the impact of the measure on the utility's system peak – defined as 1PM to hour ending 5PM on non-holiday weekdays, June through August.

---

---

## **Algorithm**

---

---

### **CALCULATION OF ENERGY SAVINGS**

Algorithms are provided followed by list of assumptions with their definition.

If there are no Input Variables, there will be a finite number of Output values. These will be identified and listed in a table. Where there are custom inputs, an example calculation is often provided to illustrate the algorithm and provide context.

### **ELECTRIC ENERGY SAVINGS**

### **SUMMER COINCIDENT PEAK DEMAND SAVINGS**

### **NATURAL GAS SAVINGS**

### **WATER IMPACT DESCRIPTIONS AND CALCULATION**

### **DEEMED O&M COST ADJUSTMENT CALCULATION**

Only required if the operation and maintenance cost for the efficient case is different to the baseline. See '3.9 Measure Incremental Cost Definition' for information on the appropriate treatment of O&M costs.

### **MEASURE CODE**

### **REVIEW DEADLINE**

If not otherwise updated as part of an identified new TRM issue request before this Review Deadline, the measure will undergo a reliability review for reasonableness, continued program relevancy, and update of material assumptions during the update cycle prior to this deadline.

## **2.3 Variable Input Tables**

Many of the measures in this TRM require the user to select the appropriate input value from a list of inputs for a given parameter in the savings algorithm. Where the TRM asks the user to select the input, look-up tables of allowable values are provided. For example, a set of input parameters may depend on building type; while a range of values may be given for each parameter, only one value is appropriate for any specific building type. If no table of alternative inputs is provided for a particular parameter, then the single deemed value will be used, unless the measure has a custom allowable input.

### 2.3.1 C&I Custom Value Use in Measure Implementation

This section defines the requirements for capturing Custom variables that can be used in place of defaults for select assumptions within the prescriptive measures defined in this statewide TRM. This approach is to be used when a variable in a measure formula can be replaced by a verifiable and documented value that is not presented in the TRM. This approach assumes that the algorithms presented in the measure are used as stated and only allows changes to certain variable values and is not a replacement algorithm for the measure. A custom variable is when customer input is provided to define the number, or the value is measured at the site. Custom values can also be supplied from product data of the measure installed. In certain cases, the custom data can be provided from a documented study or report that is applicable to the measure. Custom variables and potential sources are clearly defined in the specific measures where “Actual” or “Custom” is noted.

In exceptional cases where the participant, program administrator, and independent evaluator all agree that the TRM algorithm for a particular energy efficiency measure does not accurately characterize the energy efficiency measure within a project due to the complexity in the design and configuration of the particular energy efficiency project, a more comprehensive custom engineering and financial analysis may be used that more accurately incorporates the attributes of the measure in the complex energy efficiency project. In such cases and consistent with Commission policy adopted in ICC Docket No. 17-0270, Program Administrators are subject to retrospective evaluation risk (retroactive adjustments to savings based on ex post evaluation findings) for such projects using customized savings calculations.

## 2.4 Program Delivery & Baseline Definitions

The measure characterizations in this TRM are not grouped by program delivery type. As a result, the measure characterizations provided include information and assumptions to support savings calculations for the range of program delivery options commonly used for the measure. The organizational significance of this approach is that multiple baselines, incremental costs, O&M costs, measure lives and in-service rates are included in the measure characterization(s) that are delivered under two or more different program designs. Values appropriate for each given program delivery type are clearly specified in the algorithms or in look-up tables within the characterization.

Care has been taken to clearly define in the measure’s description the types of program delivery that the measure characterization is designed to support. However, there are no universally accepted definitions for a particular program type, and the description of the program type(s) may differ by measure. Nevertheless, program delivery types can be generally defined according to the following baseline definitions. These are the definitions used in the measure descriptions, and, when necessary, individual measure descriptions may further refine and clarify these definitions of program delivery type.

### Baseline Definitions

The energy savings for an efficiency measure is derived, in significant part, by estimating the difference between baseline efficiency and the efficiency of the measure in question. Baselines are the standard practices regarding investment in efficiency (whether measures or operations) that efficiency programs are designed to change. They address the first (gross savings) component of the question “what would have occurred absent the efficiency program?” The answer to that question is completed when making net-to-gross adjustments.

Specific measure baselines are to be covered in the TRM; however, general descriptions and guidance regarding baselines are included here.

Baselines for calculating gross savings can differ depending on the type of efficiency initiative:<sup>19</sup>

- **Time of Sale (TOS)**

This type of initiative is designed to influence the decision of a customer who is going to purchase a new product independent of an efficiency program, with the program only influencing the *efficiency level* of the

---

<sup>19</sup> Note that best efforts should be made to ensure that net-to-gross adjustments shall be estimated relative to the specific gross savings baselines for a given product or program.

product purchased (not whether a product would be purchased). In most cases, the baseline for time of sale initiatives is the least efficient product the customer is permitted to purchase by law (i.e. complies with state and federal product efficiency standards). However, when there is no equipment available at those legal minimums the baseline shall be adjusted to the TAC agreed efficiency that represents the least efficient products that would be commonly purchased in the Illinois market absent efficiency programs. For products for which there are no legal minimum efficiency requirements, the baseline should be the TAC agreed efficiency that represents the least efficient products that would be commonly purchased in the Illinois market absent efficiency programs.

- **New Construction (NC)**

This type of initiative is designed to influence the design and construction of new buildings and major renovations to existing buildings, including decisions regarding which products will be installed in such buildings. Note that it only covers cases in which the independent evaluator concludes that the customer was planning the new construction or major renovation project independent of an efficiency program; cases in which an efficiency program was what triggered a customer to renovate an existing building are treated under the Retrofit or Early Replacement program discussions below. The default baseline for new construction initiatives shall be the applicable efficiency codes (including state or local building codes) and/or product efficiency standards in effect at the time a permit was issued. However, if and when the TAC accepts an assessment of baseline construction practices documenting typical construction practice different than code, whether lower or higher, the results of such study will become the baseline for estimating new construction project savings.<sup>20</sup> A baseline that is lower than code can be estimated and used only when the TAC accepts study results demonstrating that the typical industry practice in some geographic regions or market segments is for construction or renovation at a level of efficiency below code.<sup>21</sup>

- **Early Replacement (EREP)**

This type of initiative is designed to convince customers to replace functional equipment earlier than they otherwise would. In such cases there shall be a dual baseline, with the existing equipment efficiency (i.e., the efficiency of the equipment being replaced) being the baseline for the remaining useful life of the equipment and a potentially different (typically higher) efficiency for standard *new* products (consistent with the time of sale baselines, as adjusted for any known changes to future codes or standards) being used as baseline for the remaining life of the efficiency measure. Note that for a measure to be treated as “early replacement” each of the following conditions must be met:

- 1) the existing equipment being replaced early must be in good functioning condition or require minimal repair (i.e., it is reasonable to conclude that it would have continued to be used in the absence of the program)
- 2) the independent evaluator must conclude that the program caused the customer to replace their existing equipment before the end of its useful life.

Additional requirements may be developed by the TAC and applied to certain measures to ensure appropriate use of early replacement assumptions, such as a maximum existing unit age, and/or to help ensure a positive cost effectiveness result is achieved, such as requiring maximum existing unit efficiency eligible for early replacement.

---

<sup>20</sup> Baseline efficiency levels set above (i.e., more efficient) than a code/standard baseline are only possible for measures or measure bundles with efficiency alternatives that fall between the relevant code/standard and the efficiency requirement of the program (i.e., an “intermediate efficiency” level), and are only possible in cases where the independent evaluator determines that NTG is not capturing the impact of these intermediate efficiency levels.

<sup>21</sup> This would include cases in which utility programs endeavor to improve code compliance and can measure such improvement. It would also include situations in which a compelling case could be made that a utility initiative was necessary to enable a more efficient state or local code to be adopted (at least sooner than it otherwise would have been).

- **Early Retirement (ERET)**

This type of initiative is designed to convince customers to remove (and not replace) equipment that would otherwise continue to remain functional (and consume energy). In such cases, the baseline is the existing efficiency of the equipment being removed. Note that for a measure to be treated as “early retirement”, the existing equipment being removed must be in good functioning condition.

- **Retrofit (RF)**

This type of initiative is designed to convince customers to add efficiency features and/or practices to energy consuming products, systems or buildings. For such measures, the baseline is the existing level of efficiency of the products, systems or buildings to which efficiency features are being added. This is the case even if the act of adding efficiency features and/or practices triggers application of a state or local code because such a trigger would not have occurred absent the efficiency program.

**Other Program Delivery Types**

Additional program delivery types may have their own distinct assumptions (e.g., In Service Rates) provided within a measure characterization, for example:

- **Direct Install (DI)** - A program where measures are installed by a program representative during a site visit.
- **Efficiency Kits (KITS)** - A program where measures are provided to customers and in an Efficiency Kit and may be distributed through a number of channels (e.g. online ordering, schools, community events, trade shows, etc.).

**2.4.1 Default Measure Type for Program Delivery Methods**

The decision as to whether a measure is a Time of Sale or Early Replacement measure is critical to ensure the appropriate baseline is used to calculate the measure savings and the appropriate costs are applied. This decision could include consideration of:

- The functionality of or required repair cost of the existing equipment
- The age of the existing equipment and it’s estimated remaining useful life
- The role of the Program Administrator or a representative / contractor (referred herein as PA) in the decision to replace the equipment
- The importance of the incentive and/or contact with the PA in the decision to replace the equipment
- The timing of replacement in relation to regular maintenance or recapitalization upgrade schedules

The default position for measures in some common program designs are provided below, however diverging from this default is possible.

Program Type	Default Measure Type
Direct Install	Early Replacement
Audits	Early Replacement if results in replacing functioning equipment
Standard Rx Lighting Program (one to one fixture replacement)	Time of Sale
Standard Rx Lighting Program (lighting system redesign or delamping)	Early Replacement or Early Retirement
Other Standard Rx Programs	Time of Sale or Retrofit
Downstream	Time of Sale
Midstream	Time of Sale
Upstream	Time of Sale

Diverging from the default could be based upon either:

- A unit by unit site specific basis as governed by guidance established by the TAC and clearly documented in the TRM, for example Residential HVAC early replacement measures require verifying the unit is functional or that required repairs cost less than 20% of the cost of a new baseline unit.
- A TAC agreed divergence could be established on a program/measure level supported by an independent evaluation to demonstrate that the presence of the incentive and/or contact with the Program (for example via targeted marketing material), was significant enough to result in the participants replacing functioning equipment that they would not otherwise have done.

It may be appropriate to apply a deemed percent split of Time of Sale and Early Replacement assumptions based on these evaluation results, noting that it may be observed that different markets or participant groups have very different deemed percentages of early replacements (e.g., low income populations are less likely to replace functioning units early without program involvement).

It is also possible that a project within a property may include both Early Replacement *and* Time of Sale measures. Classification of part of a project as Early Replacement, as defined above, does not preclude classification of another portion of the project as Time of Sale and vice versa.



## 3 Assumptions

The information contained in this TRM contains VEIC's recommendations for the content of the Illinois TRM. Sources that are cited within the TRM have been chosen based on two priorities, geography and age. Whenever possible and appropriate, VEIC has incorporated Illinois-specific information into each measure characterization. The Business TRM documents from Ameren and ComEd were reviewed, as well as program and measure specific data from evaluations, efficiency plans, and working documents.

The assumptions for these characterizations rest on our understanding of the information available. In each case, the available Illinois and Midwest-specific information was reviewed, including evaluations and support material provided by the Illinois Utilities.

When Illinois or region-specific evaluations or data were not available, best practice research and data from other jurisdictions were used, often from west- and east-coast states that have allocated large amounts of funding to evaluation work and to refining their measure characterization parameters. As a result, much of the most-defensible information originates from these regions. In every case, VEIC used the most-recent, well-designed, and best-supported studies and only if it was appropriate to generalize their conclusions to the Illinois programs.

### 3.1 Footnotes & Documentation of Sources

Each new and updated measure characterization is supported by a work paper, which is posted to the SharePoint web site (<https://portal.veic.org>).<sup>22</sup> Both the work paper and the measure characterizations themselves use footnotes to document the references that have been used to characterize the technology. The reference documents are too numerous to include in an Appendix and have instead been posted to the TRM's SharePoint website. These files can be found in the 'Sources and Reference Documents' folder in the main directory, and are also posted to the SAG's public web site (<http://www.ilsag.info/technical-reference-manual.html>).

### 3.2 General Savings Assumptions

The TRM savings estimates are expected to serve as average, representative values, or ways to calculate savings based on program-specific information. All information is presented on a per-measure basis. In using the measure-specific information in the TRM, it is helpful to keep the following notes in mind.

- All estimates of energy (kWh or therms) and peak (kW) savings are for first-year savings, not lifetime savings.
- Unless otherwise noted, measure life is defined to be the life of an energy consuming measure, including its equipment life and measure persistence.
- Where deemed values for savings are provided, they represent the average energy (kWh or therms) or peak (kW) savings that could be expected from the average of all measures that might be installed in Illinois in the program year.
- In general, the baselines included in the TRM are intended to represent average conditions in Illinois. Some are based on data from the state, such as household consumption characteristics provided by the Energy Information Administration. Some are extrapolated from other areas, when Illinois data are not available.

### 3.3 Shifting Baseline Assumptions

The TRM anticipates the effects of changes in efficiency codes and standards on affected measures. When these changes take effect, a shift in the baseline is usually required. This complicates the measure savings estimation somewhat and will be handled in future versions of the TRM by describing the choice of and reasoning behind a shifting baseline assumption. In this version of the TRM, this applies to CFLs and T5/T8 Linear Fluorescents, Furnaces and Early Replacement Measures.

---

<sup>22</sup> To gain access to the SharePoint web site, please contact the TRM Administrator at [iltrmadministrator@veic.org](mailto:iltrmadministrator@veic.org).

### 3.3.1 LED Lamp and Linear Fixture Baseline Assumptions

#### LED Lamps

Specific reductions in savings have been incorporated for LED measures that relate to the shift in appropriate baseline due to changes in Federal Standards for lighting products. Federal legislation (stemming from the Energy Independence and Security Act of 2007) mandated a phase-in process that began in 2012 for all general-purpose light bulbs (defined as omnidirectional or A-lamps) between 40W and 100W to be approximately 30% more energy efficient than current incandescent bulbs, in essence beginning the phase-out of the current style, or “standard”, incandescent bulbs. From 2012, standard 100W incandescent bulbs could no longer be manufactured, followed by restrictions on standard 75W bulbs in 2013 and 60W and 40W bulbs in 2014. The baseline for the CFL and LED Omnidirectional Lamp measure in the corresponding program years therefore became bulbs (improved or “efficient” incandescent, or halogen) that met the new standard and have the same lumen equivalency.

In addition, a backstop provision was included that would require replacement baseline lamps to meet an efficacy requirement of 45 lumens/watt or higher beginning on 1/1/2020. However, in December 2019, DOE issued a final determination for General Service Incandescent Lamps (GSILs), finding that this more stringent standard was not economically justified.

The natural growth of LED market share however, has and will continue to grow over the lifetime of the LED measures installed. The TAC convened a Lamp Forecast Working Group to develop a forecast of the baseline growth of LED, based upon historical growth rates provided via CREED LightTracker data, comparisons of with and no-program states and review of projections provided by the Department of Energy.<sup>23</sup>

This baseline forecast was then used to estimate how replacement lamps would change over the lifetime of an LED. A single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings.

Specialty and Directional lamps were not included in the original definition of General Service Lamps in the Energy Independence and Security Act of 2007 (EISA). Therefore, the initial baseline is an incandescent / halogen lamp described in that measure.

A DOE Final Rule released on 1/19/2017 updated the EISA regulations to remove the exemption for these lamp types such that they become subject to the backstop provision defined within the original legislation. However, in September 2019 this decision was revoked in a DOE Final Rule. The Lamp Forecast Working Group also developed forecasts for specialty and directional lamps and apply adjustments to account for the natural growth of LED market share.

#### Income Eligible Program Adjustments

The Lamp Forecast Working Group also developed forecasts for estimated Income Eligible market growth in LEDs. These forecasts are used to provide a separate mid-life adjustment for programs supporting income eligible populations.

#### New Construction Programs

IECC 2015 has the following mandatory requirements for residential lighting in New Construction: *“Not less than 75 percent of the lamps in permanently installed lighting fixtures shall be high-efficacy lamps or not less than 75 percent of the permanently installed lighting fixtures shall contain only high-efficacy lamps”*. To meet the ‘high efficacy’ requirements, lamps need to be CFL or LED, however since CFLs are no longer commonly purchased (only 1% baseline forecast) it is assumed that 75% of the New Construction baseline is an LED and therefore savings are reduced by 75% for bulbs provided in New Construction projects.

---

<sup>23</sup> US Department of Energy, “Energy Savings Forecast of Solid State Lighting in General Illumination Applications”, December 2019. The resultant forecast is provided on the SharePoint site “Lamp Forecast Workbook.xls”.

Linear LED Fixtures

In July 14, 2012, Federal Standards were enacted that were expected to eliminate T-12s as an option for linear fluorescent fixtures. Through v3.0 of the TRM, it was assumed that the T-12 would no longer be baseline for retrofits from 1/1/2016. However, due to significant loopholes in the legislation, T-12 compliant product is still freely available, and in Illinois T-12s continue to hold a significant share of the existing market. Therefore, measures allow T12 as an existing fixture for early replacements, with a midlife adjustment to an assumed new baseline fixture after the assumed burn out of the existing fixture.

**3.3.2 Early Replacement Baseline Assumptions**

A series of measures have an option to choose an Early Replacement Baseline if the following conditions are met:

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or
- The existing unit requires minor repairs (see table below).<sup>24</sup>

Existing System	Maximum repair cost
Air Source Heat Pump	\$918
Central Air Conditioner	\$734
Boiler	\$709
Furnace	\$528
Ground Source Heat Pump	<\$249 per ton

- All other conditions will be considered Time of Sale.

The Baseline efficiency of the existing unit replaced:

- If the efficiency of the existing unit is less than the maximum shown below, the Baseline efficiency is the actual efficiency value of the unit replaced. If the efficiency is greater than the maximum, the Baseline efficiency is shown in the “New Baseline” column below:

Existing System	Maximum efficiency for Actual	New Baseline
Air Source Heat Pump	10 SEER	14 SEER
Central Air Conditioner	10 SEER	13 SEER
Boiler	75% AFUE	82% AFUE
Furnace	75% AFUE	80% AFUE
Ground Source Heat Pump	10 SEER	13 SEER

- If the operational status, repair cost or efficiency of the existing unit is unknown, the Baseline efficiency is the “New Baseline” column above.

**3.3.3 Furnace Baseline**

The prior national standard for residential oil and gas furnaces was 78% AFUE. DOE raised the standard in 2007 to 80% AFUE, effective 2015. However, virtually all furnaces on the market have an AFUE of 80% or better, which prompted states and environmental and consumer groups to sue DOE over its 2007 decision. In April 2009, DOE accepted a “voluntary remand” in that litigation. In October 2009, manufacturers and efficiency advocates negotiated an agreement that, for the first time, included different standard levels in three climate regions: the North, South, and Southwest. DOE issued a direct final rule (DFR) in June 2011 reflecting the standard levels in the

<sup>24</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement.

consensus agreement. The DFR became effective on October 25, 2011 establishing new standards: In the North, most furnaces will be required to have an AFUE of 90%. The 80% AFUE standard for the South and Southwest will remain unchanged at 80%. Oil furnaces will be required to have an AFUE of 83% in all three regions. The amended standards will become effective in May 2013 for non-weatherized furnaces and in January 2015 for weatherized furnaces. DOE estimates that the standards will save about 3.3 quads (quadrillion Btu) of energy over 30 years and yield a net present value of about \$14 billion at a 3 percent discount rate.

Update: On January 14<sup>th</sup>, 2013, the U.S. Department of Energy (DOE) proposed to settle a lawsuit brought by the American Public Gas Association (APGA) that seeks to roll back gas furnace efficiency standards. As a result, the new standards, completed in 2011 and slated to take effect in May 2013, would be eliminated in favor of yet another round of DOE hearings and studies. Even if DOE completes a new rulemaking in two years, it is unlikely to take effect before 2020.<sup>25</sup>

As a result, each of the furnace measures contains the following language describing the baseline assumption:

“Although the current Federal Standard for gas furnaces is an AFUE rating of 78%, based upon review of available product in the AHRI database, the baseline efficiency for this characterization is assumed to be 80%. The baseline will be adjusted when the Federal Standard is updated.”

### 3.4 Provisional Measures Savings Assumptions

As defined in the Glossary below, the term Provisional Measures refers to energy-efficient technologies, measures, projects, programs, and/or services that are generally nascent in Illinois or nationally, for which energy savings have not been validated through robust evaluation, measurement and verification (EM&V) efforts, and/or for which there is substantial uncertainty about their cost-effectiveness, performance, and/or customer acceptance. Because, by definition, information on savings for such measures or services is lacking, is based on limited information, or is currently subject to uncertainties, the development of robust assumptions for the TRM challenging. In order to provide calculations for use as the final applicability of these measures is being determined, the TRM can include such measures on a provisional basis, with savings estimates based on the best currently available data or approach, as determined by the IL-TRM Administrator in consultation with the TAC. In such a case, the identifying tag “Provisional Measure” will be added to the TRM measure name. Provisional Measures will be given a one-year Review Deadline, meaning that the measure will undergo a review for reasonableness, continued program relevancy, and update of material assumptions during the following TRM update cycle. The tagging of a measure in the TRM as “Provisional Measure” will ultimately be a TAC decision, and any TRM measure which the TAC determines falls into this category may be assigned.

Expectations are that the Program Administrator will work with evaluators and the TRM Administrator to design and undertake pilot studies, evaluations, or other relevant activities on an appropriate number of installations of the Provisional Measure within that year, with the goal of informing the development of more-robust and Illinois-specific savings assumptions. Including savings estimates in the TRM for such Provisional Measures provides a benchmark to assess effectiveness and allows for tracking and reporting on their value to the programs and customers, even as they are being studied. Savings from any Provisional Measure will be verified by the evaluators as per the characterization included in the TRM for up to 1% of a Program Administrator’s portfolio of savings. If savings for any single Provisional Measure rises above 1% of portfolio savings, the additional savings above 1% would be subject to retroactive evaluation risk.

### 3.5 Glossary

**Baseline Efficiency:** The assumed standard efficiency of equipment, absent an efficiency program.

**Building Types:**<sup>26</sup>

Note where a measure installation is within a building or application that does not fit with any of the defined building

---

<sup>25</sup> Appliance Standards Awareness Project, <http://www.appliance-standards.org/product/furnaces>

<sup>26</sup> Source: US EPA, [www.energystar.gov](http://www.energystar.gov), Space Type Definitions, or definitions as developed through the Technical Advisory Committee.

types below, the user should apply custom assumptions where it is reasonable to estimate them, else the building of best fit should be used.

Building Type	Definition
Assisted Living MultiFamily	Applies to residential buildings of three or more units with staff to assist the occupants. Gross Floor Area should include all fully-enclosed space within the exterior walls of the building(s) including individual rooms or units, wellness centers, exam rooms, community rooms, small shops or service areas for residents and visitors (e.g. hair salons, convenience stores), staff offices, lobbies, atriums, cafeterias, kitchens, storage areas, hallways, basements, stairways, corridors between buildings, and elevator shafts.
Auditorium/Assembly	Applies to any performance space such as a theater, arena, or hall. Gross Floor Area should include all space within the building(s), including seating, stage and backstage areas, food service areas, retail areas, rehearsal studios, administrative/office space, mechanical rooms, storage areas, elevator shafts, and stairwells.
Auto Dealership	Applies to facility space used for the retail sale of new or used cars or other vehicles. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas (refrigerated and non-refrigerated), and administrative areas.
Childcare/Pre-school	Applies to any building providing childcare to pre-kindergarten age children.
College/University	Applies to facility space used for higher education. Relevant buildings include administrative headquarters, residence halls, athletic and recreation facilities, laboratories, etc. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.
Convenience Store	Applies to facility space used for the retail sale of a limited selection of food and beverage products. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas (refrigerated and non-refrigerated), and administrative areas.
Drug Store	Applies to facility space used for the retail sale of pharmaceutical products, toiletries, and a limited selection of food and beverage products. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas (refrigerated and non-refrigerated), and administrative areas.
Elementary School	Applies to a school serving children in any grades from Kindergarten through sixth grade. The total gross floor area should include all supporting functions such as administrative space, conference rooms, kitchens used by staff, lobbies, cafeterias, gymnasiums, auditoria, laboratory classrooms, portable classrooms, greenhouses, stairways, atria, elevator shafts, small landscaping sheds, storage areas, etc.
Emergency Services	Applies to a building representing office, administrative, and functional space for Police/Fire/EMT style buildings. The building borrows many elements from the Low Rise Office definitions for size, envelope, occupant density, etc., but includes expanded occupancy schedules and increased equipment loads.
Exterior	Applies to unconditioned spaces that are outside of the building envelope.
Garage	Applies to unconditioned spaces either attached or detached from the primary building envelope that are not used for living space.
Grocery	Applies to facility space used for the retail sale of food and beverage products. It should not be used by restaurants. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas (refrigerated and non-refrigerated), administrative areas, stairwells, atria, lobbies, etc.
Healthcare Clinic	Applies to a facility space used to provide diagnosis and treatment for medical, dental, or psychiatric outpatient care. Gross Floor Area should include all space within the building(s) including offices, exam rooms, laboratories, lobbies, atriums, conference rooms and auditoriums, employee break rooms and kitchens, rest rooms, elevator shafts,

Building Type	Definition
	stairways, mechanical rooms, and storage areas.
High School/Middle School	Applies to facility space used as a school building for 7th through 12th grade students. This does not include college or university classroom facilities and laboratories, vocational, technical, or trade schools. The total gross floor area should include all supporting functions such as administrative space, conference rooms, kitchens used by staff, lobbies, cafeterias, gymnasiums, auditoria, laboratory classrooms, portable classrooms, greenhouses, stairways, atria, elevator shafts, small landscaping sheds, storage areas, etc.
Hospital	Applies to a general medical and surgical hospital (including critical access hospitals and children’s hospitals) that is either a stand-alone building or a campus of buildings. Spaces more accurately characterized as a Healthcare Clinic should use that definition. The definition of Hospital accounts for all space types that are located within the Hospital building/campus, such as medical offices, administrative offices, and skilled nursing. The total floor area should include the aggregate floor area of all buildings on the campus as well as all supporting functions such as: stairways, connecting corridors between buildings, medical offices, exam rooms, laboratories, lobbies, atria, cafeterias, storage areas, elevator shafts, and any space affiliated with emergency medical care, or diagnostic care.
Hotel/Motel Combined (All Spaces)	Applies to buildings that rent overnight accommodations on a room/suite basis, typically including a bath/shower and other facilities in guest rooms. The total gross floor area should include all interior space, including guestrooms, halls, lobbies, atria, food preparation and restaurant space, conference and banquet space, health clubs/spas, indoor pool areas, and laundry facilities, as well as all space used for supporting functions such as elevator shafts, stairways, mechanical rooms, storage areas, employee break rooms, back-of-house offices, etc. Hotel does not apply to fractional ownership properties such as condominiums or vacation timeshares. Hotel properties should be owned by a single entity and have rooms available on a nightly basis. Where distinction between Hotel and Motel is necessary: Hotel: Room entrances and Corridors are located in the <i>interior</i> of the building. Corridors are conditioned spaces. Building can be significantly larger in size/height. Motel: Room entrances and Corridors are located on the <i>exterior</i> of the building. Corridors are not conditioned spaces. Buildings tend to be two to three stories in height.
Hotel/Motel Common Areas	All the common areas open to guests of the hotel such as the lobby, corridors and stairways, and other spaces that may have continuous or large lighting and HVAC hours.
Hotel/Motel Guest Room	Applies to the guest rooms of the hotel or motel. These spaces are occupied intermittently.
Low-use Small Business	Any business type with low (<3000) operating hours (provided as option in lighting measures).
Manufacturing	Applies to buildings that are dedicated to manufacturing activities. Includes light industry buildings characterized by consumer product and component manufacturing and heavy industry buildings typically characterized by a plant that includes a main production area that has high-ceilings and contains heavy equipment used for assembly line production. These building types may be distinguished by categorizing NAICS (SIC) codes according to the needs of the Program Administrator.
Miscellaneous	Applies to spaces that do not fit clearly within any available categories should be designated as “miscellaneous”.
Mobile Home	A mobile home is a prefabricated structure, built in a factory on a permanently attached chassis before being transported to site. Use single family assumptions throughout the TRM unless otherwise specified.
Movie Theater	Applies to buildings used for public or private film screenings. Gross Floor Area should

Building Type	Definition
	include all space within the building(s), including seating areas, lobbies, concession stands, bathrooms, administrative/office space, mechanical rooms, storage areas, elevator shafts, and stairwells.
Multifamily-Mid Rise	Applies to residential buildings with up to four floors, including all public and multiuse spaces within the building envelope. Small Multifamily buildings best described as a house should use the residential measure characterizations.
Multifamily-High Rise Combined (All Spaces)	Applies to residential buildings with five or more floors, including all public and multiuse spaces within the building envelope. Gross Floor Area should include all fully-enclosed space within the exterior walls of the building(s) including living space in each unit (including occupied and unoccupied units), interior common areas (e.g. lobbies, offices, community rooms, common kitchens, fitness rooms, indoor pools), hallways, stairwells, elevator shafts, connecting corridors between buildings, storage areas, and mechanical space such as a boiler room. Open air stairwells, breezeways, and other similar areas that are not fully-enclosed should not be included in the Gross Floor Area.
Multifamily-High Rise Common Areas	All the common areas open to occupants of the building such as the lobby, corridors and stairways, and other spaces that may have continuous or high lighting and HVAC hours.
Multifamily-High Rise Residential Units	Applies to the residential units in the building only.
Office-Low Rise	Applies to facility spaces in buildings with four floors or fewer used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.
Office-Mid Rise	Applies to facility spaces in buildings with five to nine floors used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.
Office-High Rise	Applies to facility spaces in buildings with ten floors or more used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.
Religious Worship/Church	Applies to buildings that are used as places of worship. This includes churches, temples, mosques, synagogues, meetinghouses, or any other buildings that primarily function as a place of religious worship. Gross Floor Area should include all areas inside the building that includes the primary worship area, including food preparation, community rooms, classrooms, and supporting areas such as restrooms, storage areas, hallways, and elevator shafts.
Restaurant	Applies to a subcategory of Retail/Service space that is used to provide commercial food services to individual customers, and includes kitchen, dining, and common areas.
Retail/Service- Department store	Applies to facility space used to conduct the retail sale of consumer product goods. Stores must be at least 30,000 square feet and have an exterior entrance to the public. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, etc. Retail segments typically included under this definition are: Department Stores, Discount Stores, Supercenters, Warehouse Clubs, Dollar Stores, Home Center/Hardware Stores, and Apparel/Hard Line Specialty Stores (e.g., books, clothing, office products, toys, home goods, electronics). Retail segments excluded under this definition are: Grocery, Drug Stores, Convenience Stores, Automobile Dealerships, and Restaurants.
Retail/Service- Strip Mall	Applies to facility space used to conduct the retail sale of consumer product goods. Stores must less than 30,000 square feet and have an exterior entrance to the public. The total gross floor area should include all supporting functions such as kitchens

Building Type	Definition
	and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, etc. Retail segments excluded under this definition are: Grocery, Drug Stores, Convenience Stores, Automobile Dealerships, and Restaurants.
Warehouse	Applies to unrefrigerated or refrigerated buildings that are used to store goods, manufactured products, merchandise or raw materials. The total gross floor area of Refrigerated Warehouses should include all temperature-controlled area designed to store perishable goods or merchandise under refrigeration at temperatures below 50 degrees Fahrenheit. The total gross floor area of Unrefrigerated Warehouses should include space designed to store non-perishable goods and merchandise. Unrefrigerated warehouses also include distribution centers. The total gross floor area of refrigerated and unrefrigerated warehouses should include all supporting functions such as offices, lobbies, stairways, rest rooms, equipment storage areas, elevator shafts, etc. Existing atriums or areas with high ceilings should only include the base floor area that they occupy. The total gross floor area of refrigerated or unrefrigerated warehouse should not include outside loading bays or docks. Self-storage facilities, or facilities that rent individual storage units, are not eligible for a rating using the warehouse model.

**Coincidence Factor (CF):** Coincidence factors represent the fraction of connected load expected to be coincident with a particular system peak period, on a diversified basis. Coincidence factors are provided for summer peak periods.

**Commercial & Industrial:** The market sector that includes measures that apply to any of the building types defined in this TRM, which includes multifamily common areas and public housing.<sup>27</sup>

**Connected Load:** The maximum wattage of the equipment, under normal operating conditions.

**Deemed Value:** A value that has been assumed to be representative of the average condition of an input parameter.

**Default Value:** When a measure indicates that an input to a prescriptive saving algorithm may take on a range of values, an average value is also provided in many cases. This value is considered the default input to the algorithm and should be used when the other alternatives listed in the measure are not applicable.

**End-use Category:** A general term used to describe the categories of equipment that provide a service to an individual or building. See Table 2.1 for a list of the end-use categories that are incorporated in this TRM.

**Energy Efficiency:** "Energy efficiency" means measures that reduce the amount of electricity or natural gas consumed in order to achieve a given end use. "Energy efficiency" includes voltage optimization measures that optimize the voltage at points on the electric distribution voltage system and thereby reduce electricity consumption by electric customers' end use devices. "Energy efficiency" also includes measures that reduce the total Btus of electricity, natural gas and other fuels needed to meet the end use or uses (20 ILCS 3855/1-10). For purposes of this Section, "energy efficiency" means measures that reduce the amount of energy required to achieve a given end use. "Energy efficiency" also includes measures that reduce the total Btus of electricity and natural gas needed to meet the end use or uses (220 ILCS 5/8-104(b)).

**Equivalent Full Load Hours (EFLH):** The equivalent hours that equipment would need to operate at its peak capacity in order to consume its estimated annual kWh consumption (annual kWh/connected kW) or therms.

**High Efficiency:** General term for technologies and processes that require less energy, water, or other inputs to operate.

**Lifetime:** Two important distinctions fall under this definition:

**Technical Lifetime:** The number of years (or hours) that the new high efficiency equipment is expected to

<sup>27</sup> Measures that apply to the multifamily and public housing building types describe how to handle tenant versus master metered buildings.



function.

**Measure Lifetime:** The number of years (or hours) that the new high efficiency equipment is expected to provide the savings characterized in the measure. This is the value provided in the “Deemed Lifetime of Efficient Equipment” section of each characterization. The measure lifetime is generally based on the technical lifetime but should represent an estimate of the median number of years that the measures installed under a program are still in place and operable. This may include consideration of the potential for users to remove or remodel and to allow for breakages or imperfect operation, resulting in a shorter measure life. If the savings of a population is expected to *decline* due to issues such as the overriding of settings or poorly maintaining equipment, a midlife adjustment should be used to reduce the lifetime savings;<sup>28</sup> however, the measure lifetime should still reflect the technical lifetime (i.e., the total years any savings are expected to occur). The Measure Lifetime should be used in lifetime savings and cost benefit calculations as well as in Weighted Average Measure Life (WAML) calculations.

Two additional terms used when describing a Measure Lifetime are:

**Effective Useful Life (EUL)** – EUL is consistent with the Measure Lifetime described above.

**Remaining Useful Life (RUL)** – Applies to retrofit or replacement measures. For example, if an existing working refrigerator is replaced with a high efficiency unit, the RUL is an assumption of how many more years the existing unit would have lasted. As a general rule, the RUL is usually assumed to be 1/3 of the EUL.

**Load Factor (LF):** The fraction of full load (wattage) for which the equipment is typically run.

**Measure Cost:** The incremental (for time of sale measures) or full cost (both capital and labor for retrofit measures) of implementing the High Efficiency equipment. See Section 3.8 Measure Incremental Cost Definition for full definition.

**Measure Description:** A detailed description of the technology and the criteria it must meet to be eligible as an energy efficient measure.

**Measure:** An efficient technology or procedure that results in energy savings as compared to the baseline efficiency.

**Residential:** The market sector that includes measures that apply only to detached, residential buildings or duplexes.

**Operation and Maintenance (O&M) Cost Adjustments:** The dollar impact resulting from differences between baseline and efficient case Operation and Maintenance costs.

**Operating Hours (HOURS):** The annual hours that equipment is expected to operate.

**Provisional Measures:** Energy-efficient technologies, measures, projects, programs, and/or services that are generally nascent in Illinois or nationally, for which energy savings have not been validated through robust evaluation, measurement, and verification (EM&V) efforts, and/or for which there is substantial uncertainty about their cost-effectiveness, performance, and/or customer acceptance.

**Program:** The mode of delivering a particular measure or set of measures to customers. See Section 2.4 for a list of program descriptions that are presently operating in Illinois.

**Rating Period Factor (RPF):** Percentages for defined times of the year that describe when energy savings will be realized for a specific measure.

**Stakeholder Advisory Group (SAG):** The Illinois Energy Efficiency Stakeholder Advisory Group (SAG) was first defined in the electric utilities’ first energy efficiency Plan Orders to include “... the Utility, DCEO, Staff, the Attorney General, BOMA and CUB and representation from a variety of interests, including residential consumers, business consumers, environmental and energy advocacy organizations, trades and local government... [and] a representative from the

---

<sup>28</sup> In rare cases, for example residential Home Energy Report (HER) type programs, it may be appropriate to have savings decay each year throughout the measure life rather than in a midlife adjustment.

ARES (alternative retail electric supplier) community should be included.”<sup>29</sup> A group of stakeholders who have an interest in Illinois’ energy efficiency programs and who meet regularly to share information and work toward consensus on various energy efficiency issues. The Utilities in Illinois have been directed by the ICC to work with the SAG on the development of a statewide TRM.

### 3.6 Electrical Loadshapes (kWh)

Loadshapes are an integral part of the measure characterization and are used to divide energy savings into appropriate periods using Rating Period Factors (RPFs) such that each have variable avoided cost values allocated to them for the purpose of estimating cost effectiveness.

For the purposes of assigning energy savings (kWh) periods, the TRM TAC has agreed to use the industry standards for wholesale power market transactions as shown in the following table.

**Table 3.2: On- and Off-Peak Energy Definitions**

Period Category	Period Definition (Central Prevailing Time)
Winter On-Peak Energy	8AM - 11PM, weekdays, Oct – Apr, No NERC holidays
Winter Off-Peak Energy	All other hours
Summer On-Peak Energy	8AM - 11PM, weekdays, May – Sept, No NERC holidays
Summer Off-Peak Energy	All other hours

Loadshapes have been developed for each end-use by assigning Rating Period Factor percentages to each of the four periods above. Three methodologies were used:

1. Itron eShapes data for Missouri, provided by Ameren and reconciled to Illinois loads, were used to calculate the percentage of load in to the four categories above.
2. Where the Itron eShapes data did not provide a particular end-use or specific measure load profile, loadshapes that have been developed over many years by Efficiency Vermont and that have been reviewed by the Vermont Department of Public Service were adjusted to match Illinois period definitions. Note – no weather sensitive loadshapes were based on this method. Any of these load profiles that relate to High Impact Measures should be an area of future evaluation.
3. Loadshapes have also been developed from primary research studies conducted in Illinois or other jurisdictions if robust datasets were available to support hourly analysis of end use consumption.

The following pages provide the loadshape values for most measures provided in the TRM.<sup>30</sup> The source of the loadshape is also provided.

ComEd uses the DSMore™ (Integral Analytics DSMore™ Demand Side Management Option/Risk Evaluator) software to screen the efficiency measures for cost effectiveness. Since this tool requires a loadshape value for weekdays and weekends in each month (i.e., 24 inputs), the percentages for the four period categories above were calculated by weighting the proportion of weekdays/weekends in each month to the total within each period. The results of these calculations are also provided below.

<sup>29</sup> ICC Docket No. 07-0540, Final Order at 32-33, February 6, 2008.

<http://www.icc.illinois.gov/downloads/public/edocket/215193.pdf>

<sup>30</sup> All loadshape information has been posted to the VEIC SharePoint site and is publicly accessible through the Stakeholder

Advisory Group’s web site. <http://www.ilsag.info/technical-reference-manual.html>

[http://ilsagfiles.org/SAG\\_files/Technical\\_Reference\\_Manual/Residential\\_Loadshapes\\_References.zip](http://ilsagfiles.org/SAG_files/Technical_Reference_Manual/Residential_Loadshapes_References.zip)

[http://ilsagfiles.org/SAG\\_files/Technical\\_Reference\\_Manual/Commercial\\_Loadshapes\\_References.zip](http://ilsagfiles.org/SAG_files/Technical_Reference_Manual/Commercial_Loadshapes_References.zip)

[http://ilsagfiles.org/SAG\\_files/Technical\\_Reference\\_Manual/Final\\_Draft/Sources%20and%20References%20-%20Loadshapes/TRM\\_Version\\_3\\_Loadshapes\\_2.24.zip](http://ilsagfiles.org/SAG_files/Technical_Reference_Manual/Final_Draft/Sources%20and%20References%20-%20Loadshapes/TRM_Version_3_Loadshapes_2.24.zip)

[http://ilsagfiles.org/SAG\\_files/Technical\\_Reference\\_Manual/2018\\_Loadshape\\_Files.zip](http://ilsagfiles.org/SAG_files/Technical_Reference_Manual/2018_Loadshape_Files.zip)

**Table 3.3: Loadshapes by Season**

		Winter Peak	Winter Off-peak	Summer Peak	Summer Off-peak	
	Loadshape Reference Number	Oct-Apr, M-F, non-holiday, 8AM - 11PM	Oct-Apr, All other time	May-Sept, M-F, non-holiday, 8AM - 11PM	May- Sept, All other time	Loadshape Source
Residential Clothes Washer	R01	30.1%	27.1%	23.1%	19.7%	Guidehouse MA Baseline Study <sup>31</sup>
Residential Dish Washer	R02	32.2%	28.5%	20.6%	18.7%	Guidehouse MA Baseline Study
Residential Electric DHW	R03	33.8%	31.0%	18.2%	17.1%	Guidehouse MA Baseline Study
Residential Freezer	R04	23.3%	30.2%	20.4%	26.0%	Guidehouse MA Baseline Study
Residential Refrigerator	R05	23.7%	28.7%	21.7%	25.9%	Guidehouse MA Baseline Study
Residential Indoor Lighting	R06	35.1%	26.1%	22.0%	16.8%	Opinion Dynamics IL Metering Study <sup>32</sup>
Residential Outdoor Lighting	R07	18.0%	44.1%	9.4%	28.4%	Efficiency Vermont
Residential Cooling	R08	4.1%	0.7%	71.3%	23.9%	Itron eShapes
Residential Electric Space Heat	R09	57.8%	38.8%	1.7%	1.7%	Itron eShapes
Residential Electric Heating and Cooling	R10	35.2%	22.8%	31.0%	11.0%	Itron eShapes
Residential Ventilation	R11	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Residential - Dehumidifier	R12	12.9%	16.2%	31.7%	39.2%	Efficiency Vermont
Residential Standby Losses - Entertainment Center	R13	28.3%	30.3%	19.7%	21.7%	Guidehouse MA Baseline Study
Residential Standby Losses - Home Office	R14	28.8%	28.3%	21.4%	21.4%	Guidehouse MA Baseline Study
Residential Pool Pumps	R15	0%	0%	58.9%	41.1%	Efficiency Vermont
Residential Holiday String Lighting	R16	43.1%	56.9%	0%	0%	Estimate <sup>33</sup>
Residential Electric Dryer	R17	34.0%	26.0%	22.3%	17.7%	Guidehouse MA Baseline Study
Residential Heat Pump DHW	R18	32.8%	31.1%	18.2%	17.9%	Guidehouse MA Baseline Study
Residential Electric Vehicle Charger	R19	25.6%	34.7%	16.7%	23.1%	Guidehouse Vehicle Analytics and Simulation Tool (TM), 2020

<sup>31</sup> See “RES 1 Baseline Loadshape Study” Prepared for the Electric and Gas Program Administrators of Massachusetts, Guidehouse, July 27, 2018, and corresponding Excel Appendix files.

<sup>32</sup> See ‘IL Res Indoor LED Lighting Load Shape\_2018-06-06’ and ‘IL Res Indoor LED Lighting Load Shape Development Methodology\_2018-05-18’ for details.

<sup>33</sup> Based on average of Residential Indoor and Outdoor lighting winter usage only.

		Winter Peak	Winter Off-peak	Summer Peak	Summer Off-peak	
	Loadshape Reference Number	Oct-Apr, M-F, non-holiday, 8AM - 11PM	Oct-Apr, All other time	May-Sept, M-F, non-holiday, 8AM - 11PM	May- Sept, All other time	Loadshape Source
Commercial Electric Cooking	C01	40.6%	18.2%	28.7%	12.6%	Itron eShapes
Commercial Electric DHW	C02	40.5%	18.2%	28.5%	12.8%	Itron eShapes
Commercial Cooling	C03	4.9%	0.8%	66.4%	27.9%	Itron eShapes
Commercial Electric Heating	C04	53.5%	43.2%	1.9%	1.4%	Itron eShapes
Commercial Electric Heating and Cooling	C05	19.4%	13.5%	47.1%	19.9%	Itron eShapes
Commercial Indoor Lighting	C06	30.1%	27.5%	22.8%	19.7%	Guidehouse EmPOWER study <sup>34</sup>
Grocery/Conv. Store Indoor Lighting	C07	28.0%	30.2%	20.3%	21.5%	Guidehouse EmPOWER study
Health Indoor Lighting	C08	29.1%	28.9%	21.6%	20.3%	Guidehouse EmPOWER study
Office Indoor Lighting	C09	29.9%	28.2%	22.3%	19.6%	Guidehouse EmPOWER study
Restaurant Indoor Lighting	C10	32.1%	25.7%	23.4%	18.8%	Efficiency Vermont
Retail Indoor Lighting	C11	32.6%	25.4%	24.2%	17.9%	Guidehouse EmPOWER study
Warehouse Indoor Lighting	C12	26.0%	29.0%	22.4%	22.6%	Guidehouse EmPOWER study
Education Indoor Lighting	C13	34.7%	26.2%	23.6%	15.5%	Guidehouse EmPOWER study
Indust. 1-shift (8/5) (e.g., comp. air, lights)	C14	50.5%	7.2%	37.0%	5.3%	Efficiency Vermont
Indust. 2-shift (16/5) (e.g., comp. air, lights)	C15	47.5%	10.2%	34.8%	7.4%	Efficiency Vermont
Indust. 3-shift (24/5) (e.g., comp. air, lights)	C16	34.8%	23.2%	25.5%	16.6%	Efficiency Vermont
Indust. 4-shift (24/7) (e.g., comp. air, lights)	C17	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Industrial Indoor Lighting	C18	44.3%	13.6%	32.4%	9.8%	Efficiency Vermont
Industrial Outdoor Lighting	C19	18.0%	44.1%	9.4%	28.4%	Efficiency Vermont
Commercial Outdoor Lighting	C20	16.8%	44.6%	9.3%	29.3%	Guidehouse EmPOWER study
Commercial Office Equipment	C21	37.7%	20.9%	26.7%	14.7%	Itron eShapes
Commercial Refrigeration	C22	38.5%	20.6%	26.7%	14.2%	Itron eShapes
Commercial Ventilation	C23	38.1%	20.6%	29.7%	11.6%	Itron eShapes
Traffic Signal - Red Balls, always changing or flashing	C24	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - Red Balls, changing day, off night	C25	37.0%	20.9%	27.1%	14.9%	Efficiency Vermont
Traffic Signal - Green Balls, always changing	C26	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - Green Balls, changing day, off night	C27	37.0%	20.9%	27.1%	14.9%	Efficiency Vermont

<sup>34</sup> See '3.5 Electrical Load Shapes\_IL TRM Workpape\_CI\_Ltg\_2018-06-28' and 'IL Commercial Lighting Load Shape Development Methodology\_2018-06-28' for details.

		Winter Peak	Winter Off-peak	Summer Peak	Summer Off-peak	
	Loadshape Reference Number	Oct-Apr, M-F, non-holiday, 8AM - 11PM	Oct-Apr, All other time	May-Sept, M-F, non-holiday, 8AM - 11PM	May- Sept, All other time	Loadshape Source
Traffic Signal - Red Arrows	C28	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - Green Arrows	C29	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - Flashing Yellows	C30	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - "Hand" Don't Walk Signal	C31	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - "Man" Walk Signal	C32	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Traffic Signal - Bi-Modal Walk/Don't Walk	C33	25.8%	32.3%	18.9%	23.0%	Efficiency Vermont
Industrial Motor	C34	47.5%	10.2%	34.8%	7.4%	Efficiency Vermont
Industrial Process	C35	47.5%	10.2%	34.8%	7.4%	Efficiency Vermont
HVAC Pump Motor (heating)	C36	38.7%	48.6%	5.9%	6.8%	Efficiency Vermont
HVAC Pump Motor (cooling)	C37	7.8%	9.8%	36.8%	45.6%	Efficiency Vermont
HVAC Pump Motor (unknown use)	C38	23.2%	29.2%	21.4%	26.2%	Efficiency Vermont
VFD - Supply fans <10 HP	C39	38.8%	16.1%	28.4%	16.7%	Efficiency Vermont
VFD - Return fans <10 HP	C40	38.8%	16.1%	28.4%	16.7%	Efficiency Vermont
VFD - Exhaust fans <10 HP	C41	34.8%	23.2%	20.3%	21.7%	Efficiency Vermont
VFD - Boiler feedwater pumps <10 HP	C42	42.9%	44.2%	6.6%	6.3%	Efficiency Vermont
VFD - Chilled water pumps <10 HP	C43	11.2%	5.5%	40.7%	42.6%	Efficiency Vermont
VFD Boiler circulation pumps <10 HP	C44	42.9%	44.2%	6.6%	6.3%	Efficiency Vermont
Refrigeration Economizer	C45	36.3%	50.8%	5.6%	7.3%	Efficiency Vermont
Evaporator Fan Control	C46	24.0%	35.9%	16.7%	23.4%	Efficiency Vermont
Standby Losses - Commercial Office	C47	8.2%	50.5%	5.6%	35.7%	Efficiency Vermont
VFD Boiler draft fans <10 HP	C48	37.3%	48.9%	6.4%	7.3%	Efficiency Vermont
VFD Cooling Tower Fans <10 HP	C49	7.9%	5.2%	54.0%	32.9%	Efficiency Vermont
Engine Block Heater Timer	C50	26.5%	61.0%	4.1%	8.5%	Efficiency Vermont
Door Heater Control	C51	30.4%	69.6%	0.0%	0.0%	Efficiency Vermont
Beverage and Snack Machine Controls	C52	10.0%	48.3%	7.4%	34.3%	Efficiency Vermont
Flat	C53	36.3%	21.8%	26.2%	15.7%	Itron eShapes
Religious Indoor Lighting	C54	26.8%	31.4%	18.9%	22.8%	Efficiency Vermont
Commercial Clothes Washer	C55	47.0%	11.1%	34.0%	8.0%	Itron eShapes <sup>35</sup>
Dairy Farm Combined End Uses	C56	34.2%	23.9%	24.9%	17.0%	Efficiency Vermont

<sup>35</sup> Assumed equal to R01 Residential Clothes Washer loadshape.

	Loadshape Reference Number	Winter Peak	Winter Off-peak	Summer Peak	Summer Off-peak	Loadshape Source
		Oct-Apr, M-F, non-holiday, 8AM - 11PM	Oct-Apr, All other time	May-Sept, M-F, non-holiday, 8AM - 11PM	May- Sept, All other time	
Milk Pump	C57	29.5%	28.9%	21.3%	20.3%	Efficiency Vermont
Farm Plate Cooler / Heat Recovery Unit	C58	22.8%	16.7%	32.4%	28.1%	Efficiency Vermont
Agriculture and Water Pumping	C59	23.7%	36.0%	18.3%	22.0%	DEER 2008
Non-Residential Agriculture Lighting – 6 Hours	C60	42%	16%	30%	12%	Franklin Energy
Non-Residential Agriculture Lighting – 8 Hours	C61	36%	22%	26%	16%	Franklin Energy
Non-Residential Agriculture Lighting – 12 Hours	C62	38%	20%	27%	15%	Franklin Energy
Non-Residential Dairy Long Day Lighting – 17 Hours	C63	34%	24%	25%	17%	Franklin Energy
Non-Residential Agriculture Lighting – 24 Hours	C64	26%	33%	19%	22%	Franklin Energy
Non-Residential Indoor Agriculture Vegetative Room	C65	32%	26%	23%	19%	Franklin Energy
Non-Residential Indoor Agriculture Flowering Room	C66	31%	27%	23%	19%	Franklin Energy
Voltage Optimization – Ameren	C67	26%	30%	22%	22%	2017-2019 average utility system load for MISO Central region
Voltage Optimization – ComEd	C68	27%	29%	22%	22%	2017-2019 average utility system load for PJM ComEd region

**Table 3.4: Loadshapes by Month and Day of Week**

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
Residential Clothes Washer	R01	5.1%	3.0%	4.9%	2.5%	5.7%	2.5%	6.0%	3.7%	6.2%	3.1%	5.7%	2.6%	5.3%	3.6%	5.8%	2.5%	4.9%	3.1%	5.2%	2.7%	5.0%	2.7%	4.8%	3.4%
Residential Dish Washer	R02	6.1%	3.3%	5.1%	2.4%	6.1%	2.4%	5.5%	3.1%	5.6%	2.6%	5.3%	2.2%	4.8%	3.1%	5.5%	2.2%	5.0%	2.9%	5.7%	2.7%	5.9%	2.9%	5.8%	3.6%
Residential Electric DHW	R03	7.1%	3.4%	6.7%	2.7%	7.4%	2.6%	5.9%	3.0%	5.8%	2.4%	5.1%	1.9%	4.3%	2.4%	4.8%	1.7%	4.5%	2.3%	5.5%	2.3%	5.8%	2.6%	6.1%	3.4%
Residential Freezer	R04	4.8%	2.3%	4.7%	1.9%	5.8%	2.0%	5.7%	2.8%	6.2%	2.5%	6.4%	2.4%	6.4%	3.5%	7.5%	2.6%	6.0%	3.0%	6.1%	2.5%	5.4%	2.3%	4.7%	2.6%

Illinois Statewide Technical Reference Manual – 3 Assumptions

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
Residential Refrigerator	R05	5.0%	2.4%	4.6%	1.9%	5.5%	1.9%	5.1%	2.5%	6.1%	2.4%	6.6%	2.5%	6.9%	3.7%	7.7%	2.7%	5.9%	3.1%	5.9%	2.4%	5.3%	2.3%	4.8%	2.7%
Residential Indoor Lighting	R06	5.9%	2.7%	5.7%	2.2%	6.5%	2.2%	5.5%	2.7%	5.8%	2.5%	5.1%	1.9%	4.8%	2.4%	5.6%	2.0%	5.9%	3.0%	6.6%	2.7%	6.4%	2.8%	5.9%	3.3%
Residential Outdoor Lighting	R07	2.7%	6.2%	2.4%	5.9%	2.6%	7.0%	2.6%	6.0%	1.9%	5.7%	1.8%	5.8%	2.0%	5.3%	1.9%	6.0%	1.8%	5.7%	2.7%	6.0%	2.5%	6.6%	2.6%	6.4%
Residential Cooling	R08	0.6%	0.1%	0.5%	0.1%	0.6%	0.1%	0.6%	0.1%	14.6%	4.8%	13.7%	4.9%	14.9%	4.5%	14.2%	5.0%	13.9%	4.8%	0.6%	0.1%	0.6%	0.1%	0.6%	0.1%
Residential Electric Space Heat	R09	8.6%	5.5%	7.7%	5.1%	8.2%	6.1%	8.3%	5.3%	0.3%	0.3%	0.3%	0.3%	0.4%	0.3%	0.3%	0.4%	0.3%	0.3%	8.7%	5.3%	8.0%	5.8%	8.5%	5.6%
Residential Electric Heating and Cooling	R10	5.2%	3.2%	4.7%	3.0%	5.0%	3.6%	5.0%	3.1%	6.3%	2.2%	6.0%	2.3%	6.5%	2.1%	6.2%	2.3%	6.0%	2.2%	5.3%	3.1%	4.9%	3.4%	5.2%	3.3%
Residential Ventilation	R11	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Residential - Dehumidifier	R12	1.9%	2.3%	1.7%	2.2%	1.8%	2.6%	1.8%	2.2%	6.5%	7.8%	6.1%	8.0%	6.6%	7.3%	6.3%	8.2%	6.2%	7.8%	1.9%	2.2%	1.8%	2.4%	1.9%	2.4%
Residential Standby Losses - Entertainment Center	R13	5.7%	2.9%	5.5%	2.4%	6.2%	2.3%	5.3%	2.9%	5.9%	2.6%	5.9%	2.3%	5.2%	3.1%	6.0%	2.3%	5.4%	2.9%	5.9%	2.6%	5.5%	2.6%	5.5%	3.3%
Residential Standby Losses - Home Office	R14	5.9%	2.8%	5.6%	2.2%	6.0%	2.0%	5.2%	2.6%	5.7%	2.3%	6.6%	2.4%	6.2%	3.4%	6.7%	2.3%	4.7%	2.3%	5.7%	2.3%	6.0%	2.5%	5.5%	3.0%
Residential Holiday String Lighting	R16	9%	11%	2%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	3%	9%	11%	22%	28%
Residential Electric Dryer	R17	5.7%	3.6%	5.2%	2.7%	5.9%	2.7%	5.0%	3.3%	5.8%	3.1%	5.4%	2.6%	4.5%	3.4%	5.1%	2.4%	4.5%	3.1%	5.1%	2.9%	5.6%	3.1%	5.3%	3.8%
Residential Heat Pump DHW	R18	6.9%	3.3%	6.6%	2.6%	7.3%	2.5%	5.9%	3.0%	5.8%	2.4%	5.2%	1.9%	4.4%	2.5%	5.0%	1.8%	4.6%	2.3%	5.6%	2.3%	5.9%	2.6%	6.1%	3.3%
Residential	R19	3.8%	4.9%	3.4%	4.6%	3.6%	5.5%	3.7%	4.7%	3.4%	4.6%	3.2%	4.7%	3.5%	4.3%	3.3%	4.8%	3.3%	4.6%	3.8%	4.7%	3.5%	5.2%	3.7%	5.0%

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
Electric Vehicle Charger																									
Commercial Electric Cooking	C01	6.0%	2.6%	5.4%	2.4%	5.7%	2.9%	5.8%	2.5%	5.9%	2.5%	5.5%	2.6%	6.0%	2.4%	5.7%	2.6%	5.6%	2.5%	6.1%	2.5%	5.6%	2.7%	5.9%	2.6%
Commercial Electric DHW	C02	6.0%	2.6%	5.4%	2.4%	5.7%	2.9%	5.8%	2.5%	5.8%	2.5%	5.5%	2.6%	6.0%	2.4%	5.7%	2.7%	5.6%	2.5%	6.1%	2.5%	5.6%	2.7%	5.9%	2.6%
Commercial Electric Cooling	C03	0.7%	0.1%	0.6%	0.1%	0.7%	0.1%	0.7%	0.1%	13.6%	5.5%	12.8%	5.7%	13.9%	5.2%	13.3%	5.9%	13.0%	5.5%	0.7%	0.1%	0.7%	0.1%	0.7%	0.1%
Commercial Electric Heating	C04	7.9%	6.1%	7.1%	5.7%	7.6%	6.8%	7.7%	5.9%	0.4%	0.3%	0.4%	0.3%	0.4%	0.3%	0.4%	0.3%	0.4%	0.3%	8.0%	5.9%	7.4%	6.5%	7.8%	6.3%
Commercial Electric Heating and Cooling	C05	2.9%	1.9%	2.6%	1.8%	2.8%	2.1%	2.8%	1.9%	9.6%	4.0%	9.1%	4.1%	9.8%	3.7%	9.4%	4.2%	9.2%	4.0%	2.9%	1.9%	2.7%	2.0%	2.8%	2.0%
Commercial Indoor Lighting	C06	5.5%	2.8%	5.2%	2.3%	6.2%	2.2%	5.4%	2.7%	6.1%	2.4%	6.2%	2.3%	5.5%	3.0%	6.5%	2.2%	5.5%	2.7%	5.9%	2.5%	5.7%	2.5%	5.4%	3.1%
Grocery/Conv. Store Indoor Lighting	C07	5.7%	2.8%	5.5%	2.2%	6.3%	2.2%	5.5%	2.8%	6.0%	2.5%	6.0%	2.2%	5.4%	3.0%	6.3%	2.2%	5.5%	2.8%	6.0%	2.5%	5.7%	2.5%	5.5%	3.0%
Health Indoor Lighting	C08	5.4%	2.9%	5.3%	2.4%	6.4%	2.2%	5.5%	2.7%	6.0%	2.4%	6.0%	2.1%	5.5%	3.0%	6.4%	2.3%	5.5%	2.7%	6.0%	2.4%	5.8%	2.4%	5.2%	3.3%
Office Indoor Lighting	C09	5.2%	3.0%	5.1%	2.6%	6.3%	2.4%	5.3%	3.0%	5.7%	2.6%	6.0%	2.4%	5.3%	3.2%	6.3%	2.3%	5.2%	2.9%	5.5%	2.7%	5.5%	2.8%	5.2%	3.3%
Restaurant Indoor Lighting	C10	4.8%	3.6%	4.3%	3.4%	4.5%	4.1%	4.6%	3.5%	4.8%	3.7%	4.5%	3.8%	4.9%	3.5%	4.7%	4.0%	4.6%	3.7%	4.8%	3.5%	4.4%	3.8%	4.7%	3.7%
Retail Indoor Lighting	C11	5.6%	2.8%	5.4%	2.3%	6.3%	2.3%	5.5%	2.8%	6.0%	2.5%	6.0%	2.2%	5.4%	3.0%	6.4%	2.3%	5.5%	2.7%	5.9%	2.5%	5.7%	2.5%	5.5%	3.1%
Warehouse Indoor Lighting	C12	5.4%	2.8%	4.7%	2.1%	5.8%	1.9%	5.0%	2.3%	6.5%	2.3%	7.1%	2.2%	6.2%	2.8%	7.3%	2.2%	5.8%	2.6%	6.0%	2.3%	5.9%	2.4%	5.3%	3.2%
Education Indoor Lighting	C13	5.1%	2.8%	5.7%	3.3%	7.8%	1.9%	6.9%	2.5%	7.2%	2.1%	5.5%	1.6%	4.2%	1.7%	6.4%	1.6%	6.3%	2.4%	6.6%	2.1%	6.2%	2.1%	4.9%	3.0%



		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
Indust. 1-shift (8/5) (e.g., comp. air, lights)	C14	7.5%	1.0%	6.7%	1.0%	7.1%	1.1%	7.2%	1.0%	7.5%	1.1%	7.1%	1.1%	7.7%	1.0%	7.4%	1.1%	7.2%	1.1%	7.6%	1.0%	7.0%	1.1%	7.4%	1.0%
Indust. 2-shift (16/5) (e.g., comp. air, lights)	C15	7.0%	1.4%	6.3%	1.4%	6.7%	1.6%	6.8%	1.4%	7.1%	1.5%	6.7%	1.5%	7.3%	1.4%	6.9%	1.6%	6.8%	1.5%	7.1%	1.4%	6.6%	1.5%	7.0%	1.5%
Indust. 3-shift (24/5) (e.g., comp. air, lights)	C16	5.1%	3.3%	4.6%	3.1%	4.9%	3.7%	5.0%	3.2%	5.2%	3.3%	4.9%	3.4%	5.3%	3.1%	5.1%	3.5%	5.0%	3.3%	5.2%	3.2%	4.8%	3.5%	5.1%	3.4%
Indust. 4-shift (24/7) (e.g., comp. air, lights)	C17	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Industrial Indoor Lighting	C18	6.6%	1.9%	5.9%	1.8%	6.3%	2.1%	6.3%	1.9%	6.6%	1.9%	6.2%	2.0%	6.8%	1.8%	6.5%	2.0%	6.3%	1.9%	6.6%	1.9%	6.1%	2.0%	6.5%	2.0%
Industrial Outdoor Lighting	C19	2.7%	6.2%	2.4%	5.9%	2.6%	7.0%	2.6%	6.0%	1.9%	5.7%	1.8%	5.8%	2.0%	5.3%	1.9%	6.0%	1.8%	5.7%	2.7%	6.0%	2.5%	6.6%	2.6%	6.4%
Commercial Outdoor Lighting	C20	6.1%	3.2%	6.3%	2.5%	6.8%	2.4%	5.3%	2.7%	5.8%	2.4%	5.2%	1.9%	4.8%	2.6%	5.8%	2.0%	5.5%	2.7%	6.0%	2.5%	5.8%	2.5%	6.0%	3.4%
Commercial Office Equipment	C21	5.6%	3.0%	5.0%	2.8%	5.3%	3.3%	5.4%	2.9%	5.4%	2.9%	5.1%	3.0%	5.6%	2.7%	5.3%	3.1%	5.2%	2.9%	5.6%	2.9%	5.2%	3.1%	5.5%	3.0%
Commercial Refrigeration	C22	5.7%	2.9%	5.1%	2.7%	5.4%	3.2%	5.5%	2.8%	5.5%	2.8%	5.1%	2.9%	5.6%	2.7%	5.3%	3.0%	5.2%	2.8%	5.8%	2.8%	5.3%	3.1%	5.6%	3.0%
Commercial Ventilation	C23	5.6%	2.9%	5.1%	2.7%	5.4%	3.3%	5.4%	2.8%	6.1%	2.3%	5.7%	2.4%	6.2%	2.2%	5.9%	2.4%	5.8%	2.3%	5.7%	2.8%	5.3%	3.1%	5.6%	3.0%
Traffic Signal - Red Balls, always changing or flashing	C24	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - Red Balls,	C25	5.5%	2.9%	4.9%	2.8%	5.2%	3.3%	5.3%	2.9%	5.5%	3.0%	5.2%	3.1%	5.7%	2.8%	5.4%	3.1%	5.3%	3.0%	5.5%	2.9%	5.1%	3.1%	5.4%	3.0%

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
changing day, off night																									
Traffic Signal - Green Balls, always changing	C26	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - Green Balls, changing day, off night	C27	5.5%	2.9%	4.9%	2.8%	5.2%	3.3%	5.3%	2.9%	5.5%	3.0%	5.2%	3.1%	5.7%	2.8%	5.4%	3.1%	5.3%	3.0%	5.5%	2.9%	5.1%	3.1%	5.4%	3.0%
Traffic Signal - Red Arrows	C28	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - Green Arrows	C29	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - Flashing Yellows	C30	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - "Hand" Don't Walk Signal	C31	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - "Man" Walk Signal	C32	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Traffic Signal - Bi-Modal Walk/Don't Walk	C33	3.8%	4.6%	3.4%	4.3%	3.6%	5.1%	3.7%	4.4%	3.8%	4.6%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.6%	3.9%	4.4%	3.6%	4.8%	3.8%	4.7%
Industrial Motor	C34	7.0%	1.4%	6.3%	1.4%	6.7%	1.6%	6.8%	1.4%	7.1%	1.5%	6.7%	1.5%	7.3%	1.4%	6.9%	1.6%	6.8%	1.5%	7.1%	1.4%	6.6%	1.5%	7.0%	1.5%
Industrial Process	C35	7.0%	1.4%	6.3%	1.4%	6.7%	1.6%	6.8%	1.4%	7.1%	1.5%	6.7%	1.5%	7.3%	1.4%	6.9%	1.6%	6.8%	1.5%	7.1%	1.4%	6.6%	1.5%	7.0%	1.5%
HVAC Pump Motor (heating)	C36	5.7%	6.9%	5.2%	6.4%	5.5%	7.7%	5.5%	6.6%	1.2%	1.4%	1.1%	1.4%	1.2%	1.3%	1.2%	1.4%	1.2%	1.4%	5.8%	6.6%	5.3%	7.3%	5.7%	7.1%
HVAC Pump Motor (cooling)	C37	1.2%	1.4%	1.0%	1.3%	1.1%	1.5%	1.1%	1.3%	7.5%	9.1%	7.1%	9.3%	7.7%	8.5%	7.3%	9.6%	7.2%	9.1%	1.2%	1.3%	1.1%	1.5%	1.1%	1.4%
HVAC Pump Motor	C38	3.4%	4.1%	3.1%	3.9%	3.3%	4.6%	3.3%	4.0%	4.4%	5.2%	4.1%	5.4%	4.5%	4.9%	4.3%	5.5%	4.2%	5.2%	3.5%	4.0%	3.2%	4.4%	3.4%	4.2%

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
(unknown use)																									
VFD - Supply fans <10 HP	C39	5.7%	2.3%	5.2%	2.1%	5.5%	2.5%	5.6%	2.2%	5.8%	3.3%	5.5%	3.4%	5.9%	3.1%	5.7%	3.5%	5.5%	3.3%	5.8%	2.2%	5.4%	2.4%	5.7%	2.3%
VFD - Return fans <10 HP	C40	5.7%	2.3%	5.2%	2.1%	5.5%	2.5%	5.6%	2.2%	5.8%	3.3%	5.5%	3.4%	5.9%	3.1%	5.7%	3.5%	5.5%	3.3%	5.8%	2.2%	5.4%	2.4%	5.7%	2.3%
VFD - Exhaust fans <10 HP	C41	5.1%	3.3%	4.6%	3.1%	4.9%	3.7%	5.0%	3.2%	4.1%	4.3%	3.9%	4.4%	4.2%	4.1%	4.1%	4.6%	4.0%	4.3%	5.2%	3.2%	4.8%	3.5%	5.1%	3.4%
VFD - Boiler feedwater pumps <10 HP	C42	6.4%	6.2%	5.7%	5.9%	6.1%	7.0%	6.1%	6.0%	1.3%	1.3%	1.3%	1.3%	1.4%	1.2%	1.3%	1.3%	1.3%	1.3%	6.4%	6.0%	5.9%	6.6%	6.3%	6.4%
VFD - Chilled water pumps <10 HP	C43	1.7%	0.8%	1.5%	0.7%	1.6%	0.9%	1.6%	0.8%	8.3%	8.5%	7.8%	8.7%	8.5%	8.0%	8.1%	8.9%	7.9%	8.5%	1.7%	0.8%	1.6%	0.8%	1.6%	0.8%
VFD Boiler circulation pumps <10 HP	C44	6.4%	6.2%	5.7%	5.9%	6.1%	7.0%	6.1%	6.0%	1.3%	1.3%	1.3%	1.3%	1.4%	1.2%	1.3%	1.3%	1.3%	1.3%	6.4%	6.0%	5.9%	6.6%	6.3%	6.4%
Refrigeration Economizer	C45	5.4%	7.2%	4.8%	6.7%	5.1%	8.0%	5.2%	7.0%	1.1%	1.5%	1.1%	1.5%	1.2%	1.4%	1.1%	1.5%	1.1%	1.5%	5.4%	7.0%	5.0%	7.6%	5.3%	7.4%
Evaporator Fan Control	C46	3.6%	5.1%	3.2%	4.8%	3.4%	5.7%	3.4%	4.9%	3.4%	4.7%	3.2%	4.8%	3.5%	4.4%	3.3%	4.9%	3.3%	4.7%	3.6%	4.9%	3.3%	5.4%	3.5%	5.2%
Standby Losses - Commercial Office	C47	1.2%	7.1%	1.1%	6.7%	1.2%	8.0%	1.2%	6.9%	1.1%	7.1%	1.1%	7.3%	1.2%	6.7%	1.1%	7.5%	1.1%	7.1%	1.2%	6.9%	1.1%	7.5%	1.2%	7.3%
VFD Boiler draft fans <10 HP	C48	5.5%	6.9%	5.0%	6.5%	5.3%	7.7%	5.3%	6.7%	1.3%	1.5%	1.2%	1.5%	1.3%	1.4%	1.3%	1.5%	1.2%	1.5%	5.6%	6.7%	5.2%	7.3%	5.5%	7.1%
VFD Cooling Tower Fans <10 HP	C49	1.2%	0.7%	1.1%	0.7%	1.1%	0.8%	1.1%	0.7%	11.0%	6.5%	10.4%	6.7%	11.3%	6.2%	10.8%	6.9%	10.5%	6.5%	1.2%	0.7%	1.1%	0.8%	1.2%	0.8%
Engine Block Heater Timer	C50	3.9%	8.6%	3.5%	8.1%	3.7%	9.6%	3.8%	8.3%	0.8%	1.7%	0.8%	1.7%	0.8%	1.6%	0.8%	1.8%	0.8%	1.7%	4.0%	8.3%	3.7%	9.1%	3.9%	8.9%
Door Heater Control	C51	4.5%	9.8%	4.0%	9.2%	4.3%	11.0%	4.3%	9.5%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	4.5%	9.5%	4.2%	10.4%	4.4%	10.1%
Beverage and Snack	C52	1.5%	6.8%	1.3%	6.4%	1.4%	7.6%	1.4%	6.6%	1.5%	6.8%	1.4%	7.0%	1.5%	6.4%	1.5%	7.2%	1.4%	6.8%	1.5%	6.6%	1.4%	7.2%	1.5%	7.0%

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
Machine Controls																									
Flat	C53	5.4%	3.1%	4.8%	2.9%	5.1%	3.4%	5.2%	3.0%	5.3%	3.1%	5.0%	3.2%	5.5%	2.9%	5.2%	3.3%	5.1%	3.1%	5.4%	3.0%	5.0%	3.3%	5.3%	3.2%
Religious Indoor Lighting	C54	4.0%	4.4%	3.6%	4.2%	3.8%	5.0%	3.8%	4.3%	3.9%	4.5%	3.6%	4.7%	3.9%	4.3%	3.8%	4.8%	3.7%	4.5%	4.0%	4.3%	3.7%	4.7%	3.9%	4.6%
Commercial Clothes Washer	C55	7.0%	1.6%	6.3%	1.5%	6.6%	1.7%	6.7%	1.5%	6.9%	1.6%	6.5%	1.6%	7.1%	1.5%	6.8%	1.7%	6.6%	1.6%	7.0%	1.5%	6.5%	1.7%	6.9%	1.6%
Dairy Farm Combined End Uses	C56	5.1%	3.4%	4.6%	3.2%	4.8%	3.8%	4.9%	3.3%	5.1%	3.4%	4.8%	3.5%	5.2%	3.2%	5.0%	3.6%	4.9%	3.4%	5.1%	3.3%	4.7%	3.6%	5.0%	3.5%
Milk Pump	C57	4.4%	4.1%	3.9%	3.8%	4.2%	4.6%	4.2%	4.0%	4.3%	4.0%	4.1%	4.2%	4.4%	3.8%	4.3%	4.3%	4.2%	4.0%	4.4%	4.0%	4.1%	4.3%	4.3%	4.2%
Farm Plate Cooler / Heat Recovery Unit	C58	3.4%	2.4%	3.0%	2.2%	3.2%	2.6%	3.3%	2.3%	6.6%	5.6%	6.2%	5.7%	6.8%	5.3%	6.5%	5.9%	6.3%	5.6%	3.4%	2.3%	3.2%	2.5%	3.3%	2.4%
Agriculture and Water Pumping	C59	3.5%	5.1%	3.2%	4.8%	3.4%	5.7%	3.4%	4.9%	3.7%	4.4%	3.5%	4.5%	3.8%	4.1%	3.7%	4.6%	3.6%	4.4%	3.5%	4.9%	3.3%	5.4%	3.5%	5.2%
Non-Residential Agriculture Lighting – 6 Hours	C60	6.2%	2.3%	5.6%	2.1%	5.9%	2.5%	6.0%	2.2%	6.1%	2.4%	5.8%	2.5%	6.3%	2.3%	6.0%	2.5%	5.8%	2.4%	6.3%	2.2%	5.8%	2.4%	6.1%	2.3%
Non-Residential Agriculture Lighting – 8 Hours	C61	5.3%	3.1%	4.8%	2.9%	5.1%	3.5%	5.2%	3.0%	5.3%	3.2%	5.0%	3.3%	5.4%	3.0%	5.2%	3.4%	5.1%	3.2%	5.4%	3.0%	5.0%	3.3%	5.3%	3.2%
Non-Residential Agriculture Lighting – 12 Hours	C62	5.6%	2.8%	5.1%	2.7%	5.4%	3.2%	5.4%	2.7%	5.5%	3.0%	5.2%	3.1%	5.6%	2.8%	5.4%	3.2%	5.3%	3.0%	5.7%	2.7%	5.3%	3.0%	5.6%	2.9%
Non-Residential Dairy Long Day Lighting – 17 Hours	C63	5.0%	3.4%	4.5%	3.2%	4.8%	3.8%	4.9%	3.3%	5.1%	3.4%	4.8%	3.5%	5.2%	3.2%	5.0%	3.6%	4.9%	3.4%	5.1%	3.3%	4.7%	3.6%	5.0%	3.5%

		Jan		Feb		Mar		Apr		May		Jun		Jul		Aug		Sep		Oct		Nov		Dec	
		M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S	M-F	S-S
Non-Residential Agriculture Lighting – 24 Hours	C64	3.8%	4.7%	3.5%	4.4%	3.7%	5.2%	3.7%	4.5%	3.9%	4.4%	3.7%	4.5%	4.0%	4.1%	3.8%	4.6%	3.7%	4.4%	3.9%	4.5%	3.6%	4.9%	3.8%	4.8%
Non-Residential Indoor Agriculture Vegetative Room	C65	4.7%	3.7%	4.3%	3.5%	4.5%	4.1%	4.6%	3.6%	4.7%	3.8%	4.4%	3.9%	4.8%	3.6%	4.6%	4.0%	4.5%	3.8%	4.8%	3.6%	4.4%	3.9%	4.7%	3.8%
Non-Residential Indoor Agriculture Flowering Room	C66	4.6%	3.8%	4.1%	3.6%	4.4%	4.3%	4.4%	3.7%	4.7%	3.8%	4.4%	3.9%	4.8%	3.6%	4.6%	4.0%	4.5%	3.8%	4.6%	3.7%	4.3%	4.0%	4.5%	3.9%
Voltage Optimization – Ameren	C67	3.8%	4.2%	3.5%	4.0%	3.7%	4.7%	3.7%	4.1%	4.5%	4.4%	4.2%	4.5%	4.6%	4.1%	4.4%	4.6%	4.3%	4.4%	3.9%	4.1%	3.6%	4.5%	3.8%	4.4%
Voltage Optimization – ComEd	C68	4.0%	4.1%	3.6%	3.9%	3.8%	4.6%	3.9%	4.0%	4.5%	4.4%	4.2%	4.5%	4.6%	4.1%	4.4%	4.6%	4.3%	4.4%	4.0%	4.0%	3.7%	4.3%	4.0%	4.2%

### 3.7 Summer Peak Period Definition (kW)

To estimate the impact that an efficiency measure has on a utility’s system peak, the peak itself needs to be defined. Illinois spans two different electrical control areas, the Pennsylvania – Jersey – Maryland (PJM) and the Midwest Independent System Operators (MISO). As a result, there is some disparity in the peak definition across the state. However, only PJM has a forward capacity market where an efficiency program can potentially participate. Because ComEd is part of the PJM control area, their definition of summer peak is being applied statewide in this TRM.

Because Illinois is a summer peaking state, only the summer peak period is defined for the purpose of this TRM. The coincident summer peak period is defined as 1:00-5:00 PM Central Prevailing Time on non-holiday weekdays, June through August.

Summer peak coincidence factors can be found within each measure characterization. The source is provided and is based upon evaluation results, analysis of load shape data (e.g., the Itron eShapes data provided by Ameren), or through a calculation using stated assumptions.

For measures that are not weather-sensitive, the summer peak coincidence factor is estimated whenever possible as the average of savings within the peak period defined above. For weather sensitive measures such as cooling, the summer peak coincidence factor is provided in two different ways. The first method is to estimate demand savings during the utility’s peak hour (as provided by Ameren). This is likely to be the most indicative of actual peak benefits. The second way represents the average savings over the summer peak period, consistent with the non-weather sensitive end uses, and is presented so that savings can be bid into PJM’s Forward Capacity Market.

### 3.8 Heating and Cooling Degree-Day Data

Many measures are weather sensitive. Because there is a range of climactic conditions across the state, VEIC engaged the Utilities to provide their preferences for what airports and cities are the best proxies for the weather in their service territories. The result of this engagement is in the table below. All of the data represents 30-year normals from the National Climactic Data Center (NCDC).<sup>36</sup> Note that the base temperature for the calculation of heating degree-days in this document does not follow the historical 65F degree base temperature convention. Instead VEIC used several different temperatures in this TRM to more accurately reflect the outdoor temperature when a heating or cooling system turns on.

Residential heating is based on 60F, in accordance with regression analysis of heating fuel use and weather by state by the Pacific Northwest National Laboratory.<sup>37</sup> Residential cooling is based on 65F in agreement with a field study in Wisconsin.<sup>38</sup> These are lower than typical thermostat set points because internal gains, such as appliances, lighting, and people, provide some heating. In C&I settings, internal gains are often much higher; the base temperatures for both heating and cooling is 55F.<sup>39</sup> Custom degree-days with building-specific base temperatures are recommended for large C&I projects.

**Table 3.5: Degree-Day Zones and Values by Market Sector**

Zone	Residential		C&I		Weather Station / City
	HDD	CDD	HDD	CDD	
1	5,352	820	4,272	2,173	Rockford AP / Rockford
2	5,113	842	4,029	3,357	Chicago O'Hare AP / Chicago
3	4,379	1,108	3,406	2,666	Springfield #2 / Springfield

<sup>36</sup> 30-year normals have been used instead of Typical Meteorological Year (TMY) data due to the fact that few of the measures in the TRM are significantly affected by solar insolation, which is one of the primary benefits of using the TMY approach.

<sup>37</sup> Belzer and Cort, Pacific Northwest National Laboratory in “Statistical Analysis of Historical State-Level Residential Energy Consumption Trends,” 2004.


<sup>38</sup> Energy Center of Wisconsin, May 2008 metering study; “Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research”, p. 32 (amended in 2010).

<sup>39</sup> This value is based upon experience, and it is preferable to use building-specific base temperatures when available.


Zone	Residential		C&I		Weather Station / City
	HDD	CDD	HDD	CDD	
4	3,378	1,570	2,515	3,090	Belleville SIU RSCH / Belleville
5	3,438	1,370	2,546	2,182	Carbondale Southern IL AP / Marion
Average	4,860	947	3,812	3,051	Weighted by occupied housing units
Base Temp	60F	65F	55F	55F	30 year climate normals, 1981-2010

This table assigns each of the proxy cities to one of five climate zones. The following graphics from the Illinois State Water Survey show isobars (lines of equal degree-days), and we have color-coded the counties in each of these graphics using those isobars as a dividing line. Using this approach, the state divides into five cooling degree-day zones and five heating degree-day zones. Note that although the heating and cooling degree-day maps are similar, they are not the same, and the result is that there is a total of 10 climate zones in the state. The counties are listed in the tables following the figures for ease of reference. In addition, an Excel file containing all Illinois Zip Codes with the corresponding Heating and Cooling Degree-day zones is provided on the SharePoint site within the 'TRM Reference Documents' section.

**Figure 3.1: Cooling Degree-Day Zones by County**

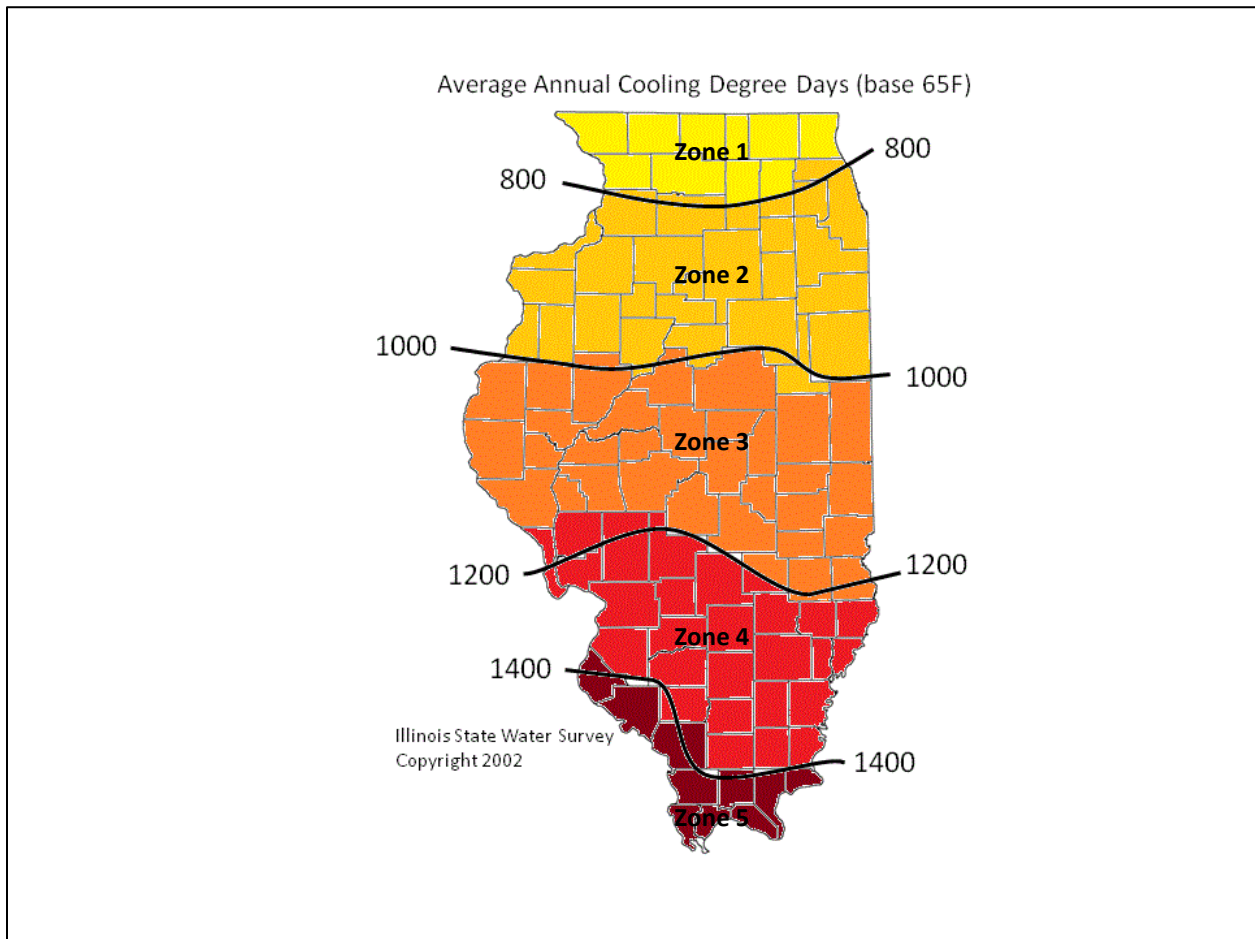

**Figure 3.2: Heating Degree-Day Zones by County**

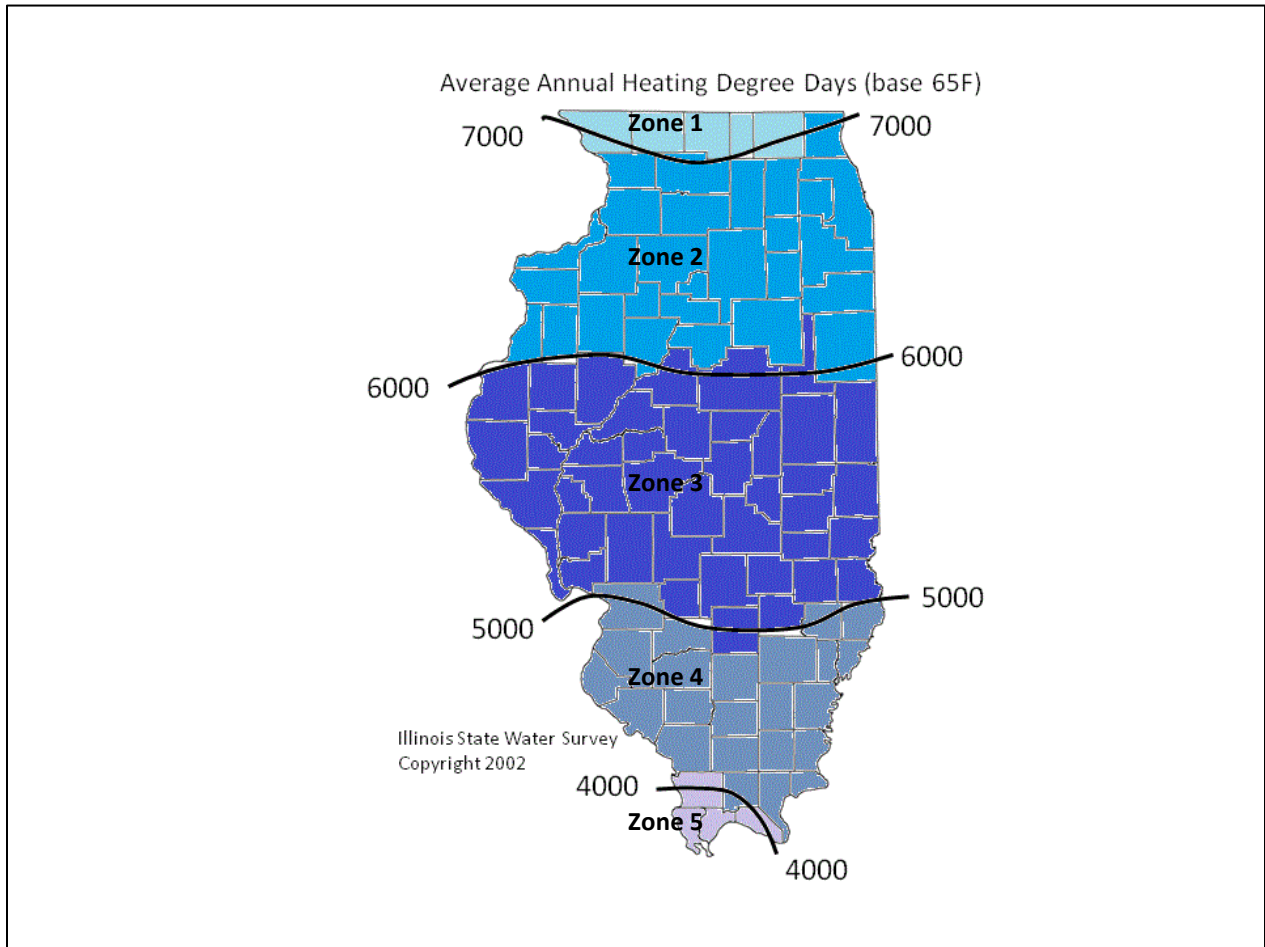

**Table 3.6: Heating Degree-Day Zones by County**

Zone 1	Zone 2	Zone 3	Zone 4	Zone 5
Boone County	Bureau County	Adams County	Clinton County	Alexander County
Jo Daviess County	Carroll County	Bond County	Edwards County	Massac County
Stephenson County	Cook County	Brown County	Franklin County	Pulaski County
Winnebago County	DeKalb County	Calhoun County	Gallatin County	Union County
	DuPage County	Cass County	Hamilton County	
	Grundy County	Champaign County	Hardin County	
	Henderson County	Christian County	Jackson County	
	Henry County	Clark County	Jefferson County	
	Iroquois County	Clay County	Johnson County	
	Kane County	Coles County	Lawrence County	
	Kankakee County	Crawford County	Madison County	
	Kendall County	Cumberland County	Marion County	
	Knox County	De Witt County	Monroe County	
	Lake County	Douglas County	Perry County	
	LaSalle County	Edgar County	Pope County	
	Lee County	Effingham County	Randolph County	
	Livingston County	Fayette County	Richland County	
	Marshall County	Ford County	Saline County	



Zone 1	Zone 2	Zone 3	Zone 4	Zone 5
	McHenry County	Fulton County	St. Clair County	
	Mercer County	Greene County	Wabash County	
	Ogle County	Hancock County	Washington County	
	Peoria County	Jasper County	Wayne County	
	Putnam County	Jersey County	White County	
	Rock Island County	Logan County	Williamson County	
	Stark County	Macon County		
	Warren County	Macoupin County		
	Whiteside County	Mason County		
	Will County	McDonough County		
	Woodford County	McLean County		
		Menard County		
		Montgomery		
		Morgan County		
		Moultrie County		
		Piatt County		
		Pike County		
		Sangamon County		
		Schuylar County		
		Scott County		
		Shelby County		
		Tazewell County		
		Vermilion County		

**Table 3.7: Cooling Degree-day Zones by County**

Zone 1	Zone 2	Zone 3	Zone 4	Zone 5
Boone County	Bureau County	Adams County	Bond County	Alexander County
Carroll County	Cook County	Brown County	Clay County	Hardin County
DeKalb County	DuPage County	Calhoun County	Clinton County	Johnson County
Jo Daviess County	Grundy County	Cass County	Edwards County	Massac County
Kane County	Henderson County	Champaign County	Fayette County	Pope County
Lake County	Henry County	Christian County	Franklin County	Pulaski County
McHenry County	Iroquois County	Clark County	Gallatin County	Randolph County
Ogle County	Kankakee County	Coles County	Hamilton County	Union County
Stephenson County	Kendall County	Crawford County	Jackson County	
Winnebago County	Knox County	Cumberland County	Jefferson County	
	LaSalle County	De Witt County	Jersey County	
	Lee County	Douglas County	Lawrence County	
	Livingston County	Edgar County	Macoupin County	
	Marshall County	Effingham County	Madison County	
	Mercer County	Ford County	Marion County	
	Peoria County	Fulton County	Monroe County	
	Putnam County	Greene County	Montgomery	
	Rock Island County	Hancock County	Perry County	
	Stark County	Jasper County	Richland County	
	Warren County	Logan County	Saline County	
	Whiteside County	Macon County	St. Clair County	
	Will County	Mason County	Wabash County	

Zone 1	Zone 2	Zone 3	Zone 4	Zone 5
	Woodford County	McDonough County	Washington County	
		McLean County	Wayne County	
		Menard County	White County	
		Morgan County	Williamson County	
		Moultrie County		
		Piatt County		
		Pike County		
		Sangamon County		
		Schuyler County		
		Scott County		
		Shelby County		
		Tazewell County		
		Vermilion County		

### 3.9 Measure Incremental Cost Definition

**Operations and Maintenance (O&M) and/or Deferred Baseline Replacement Cost Changes:** Any avoided costs are treated as benefits, and any increased costs are treated as Incremental Costs. In cases where the efficient Measure has a significantly shorter or longer life than the relevant baseline measure (e.g., LEDs versus halogens), the avoided baseline replacement measure costs should be accounted for as a benefit in the TRC test analysis.

**Incremental Costs** means the difference between the cost of the efficient Measure and the cost of the most relevant baseline measure that would have been installed (if any) in the absence of the efficiency Program. Installation costs (material and labor) shall be included if there is a difference between the efficient Measure and the baseline measure. The Customer’s value of service lost, the Customer’s value of their lost amenity, and the Customer’s transaction costs shall be included in the TRC test analysis where a reasonable estimate or proxy of such costs can be easily obtained (e.g., Program Administrator payment to a Customer to reduce load during a demand response event, Program Administrator payment to a Customer as an inducement to give up functioning equipment). This Incremental Cost input in the TRC analysis is not reduced by the amount of any Incentives (any Financial Incentives Paid to Customers or Incentives Paid to Third Parties by a Program Administrator that is intended to reduce the price of the efficient Measure to the Customer). Incremental Cost calculations will vary depending on the type of efficient Measure being implemented, as outlined in the examples provided below and as set forth in the IL-TRM. Note that the TRM includes at least one deemed incremental cost(s) as a default value(s) for most measures. However, consistent with the TRM Policy Document policy, in instances where Program Administrators have better information on the true incremental cost of the measures (e.g., direct install programs), the Program Administrator-specific incremental cost value should be used for the purposes of cost-effectiveness analysis.

Examples of Incremental Cost calculations include:

- a. The Incremental Cost for an efficient Measure that is installed in new construction or is being purchased at the time of natural installation, investment, or replacement is the additional cost incurred to purchase an efficient Measure over and above the cost of the baseline/standard (i.e., less efficient) measure (including any incremental installation, replacement, or O&M costs if those differ between the efficient Measure and baseline measure).
- b. For a retrofit Measure where the efficiency Program caused the Customer to update their existing equipment, facility, or processes (e.g., air sealing, insulation, tank wrap, controls), where the Customer would not have otherwise made a purchase, the appropriate baseline is zero expenditure, and the Incremental Cost is the full cost of the new retrofit Measure (including installation costs).
- c. For the early replacement of functioning equipment with a new efficient Measure, where the Customer would not have otherwise made a purchase for a number of years, the appropriate baseline is a dual baseline that begins as the existing equipment and shifts to the new standard equipment after the expected remaining useful life of the existing equipment ends. Thus, the Incremental Cost is the full cost of the new

efficient Measure (including installation costs) being purchased to replace a still-functioning equipment less the present value of the assumed deferred replacement cost (including installation costs) of replacing the existing equipment with a new baseline measure at the end of the existing equipment’s life. This deferred credit may not be necessary when the lifetime of the measure is short, the costs are very low, the measure is highly cost-effective even without the deferred credit, or for other reasons (e.g., certain Direct Install Measures, Measures provided in Kits to Customers).<sup>40</sup>

- d. For study-based services (e.g., facility energy audits, energy surveys, energy assessments, retro-commissioning, new construction design services), the Incremental Cost is the full cost of the study-based service. Even if the study-based service is performed entirely by a Program Administrator’s program implementation contractor, the full cost of the study-based service charged by the program implementation contractor is the Incremental Cost, because this is assumed to be the cost of the study-based service that would have been incurred by the Customer if the Customer were to have the study-based service performed in the absence of the efficiency Program. If the Customer implements efficient Measures as a result of the study-based service provided by the efficiency Program, the Incremental Cost for those efficient Measures should also be classified as Incremental Costs in the TRC analysis. Note that the Incremental Costs associated with study-based services should be included in Cost-Effectiveness calculations “only at the level at which they become variable.”<sup>41</sup> In some cases, this will be at the Measure level; in others, it will be at the Program level. Such costs should be included in Measure-level Cost-Effectiveness calculations only when they are inseparable from the efficiency improvements – i.e., when the provision of the study-based service is what produces energy savings (e.g., retro-commissioning). Conversely, when study-based service costs are separable from the costs of the efficient Measures themselves and Customer, Program Administrator and/or other parties have discretion over which of the identified efficient Measures to subsequently install (e.g., for facility energy audits, surveys or assessments that are used to identify potential efficient Measures for installation), the Incremental Cost associated with such study-based services should be included only in Program-level Cost-Effectiveness analyses (rather than allocated to individual efficient Measures).
- e. For the early retirement of functioning equipment before its expected life is over (e.g., appliance recycling Programs), the Incremental Costs are composed of the Customer’s value placed on their lost amenity, any Customer transaction costs, and the pickup and recycling cost. The Incremental Costs include the actual cost of the pickup and recycling of the equipment (often paid for by a Program Administrator to a program implementation contractor) because this is assumed to be the cost of recycling the equipment that would have been incurred by the Customer if the Customer were to recycle the equipment on their own in the absence of the efficiency Program. The payment a Program Administrator makes to the Customer serves as a proxy for the value the Customer places on their lost amenity and any Customer transaction costs.

### 3.10 Discount Rates, Inflation Rates, and O&M Costs

The Illinois Utilities use screening tools that apply an appropriate discount rate to any future costs or benefits. The societal discount rate, required for use by all electric utilities, is defined as a nominal discount rate of 2.40%, or a real (inflation-adjusted) discount rate of 0.42%.<sup>42</sup>

Where a future cost is provided within the TRM (e.g., in early replacement measures where a deferred baseline replacement cost is provided) and the future cost has been adjusted using an inflation rate (based upon the 20-year

---

<sup>40</sup> In such instances, the Incremental Cost is the full cost of direct installation Measures (materials and labor) and the full cost of Measures provided in Kits to Customers.

<sup>41</sup> See The National Efficiency Screening Project, National Standard Practice Manual for Assessing Cost-Effectiveness of Energy Efficiency Resources, Edition 1, Spring 2017. Retrieved from <https://nationalefficiencyscreening.org/national-standard-practice-manual/>.

<sup>42</sup> Based on the ten year average (1/1/2010 – 12/31/2019) of the 10 year Treasury bond yield rates. The 10 year rates are used to be consistent with the average measure life of the measures specified within this TRM. See “IL Discount Rate Calculation\_V9-V11.xls”.

Treasury yield of 1.98%)<sup>43</sup>, the nominal discount rate should be used to discount to the present value. Where future costs have not been adjusted for inflation, the real discount rate should be used to discount to present value.

The following table provides the historical discount rate that have been applied:

Program Year Applied To (TRM based upon)	Nominal Discount Rate	Real Discount Rate	Inflation Rate
2022-2025 (v9.0) <sup>44</sup>	2.40%	0.42% (10yr Treasury bond rates)	1.98%
2028 – 2021 (v6.0 – v8.0) <sup>45</sup>	2.38%	0.46% (10yr Treasury bond rates)	1.91%
EPY9 and GPY6 (v5.0)	Not specified	5.34% (WACC)	1.91%
EPY5-8 and GPY1-5 (v1.0 - v4.0)	Not specified	5.23% (WACC)	Not specified

Some measures specify an operations and maintenance (O&M) parameter that describes the incremental O&M cost savings that can be expected over the measure’s lifetime. For most measures the TRM does not specify the NPV of the O&M costs. Instead, the necessary information required to calculate the NPV is included. An example is provided below:

Baseline Case: O&M costs equal \$150 every two years.
Efficient Case: O&M costs equal \$50 every five years.

Given this information, the incremental O&M costs can be determined by discounting the cash flows in the Baseline Case and the Efficient Case separately using the real discount rate.

For a select few measures that include baseline shifts that result in multiple component costs and lifetimes over the lifetime of the measure, this standard method cannot be used. In only these cases, the O&M costs are presented both as Annual Levelized equivalent cost (i.e., the annual payment that results in an equivalent NPV to the actual stream of O&M costs) and as NPVs using a real societal discount rate of 0.42%.

When discounting nominal data that was adjusted to nominal from original real data using an inflation rate that is different than the IL-TRM inflation rate value, the analyst should first adjust for inflation using the original (non-IL-TRM) value to convert the data back to the appropriate year’s real dollars and then use the real discount rate as specified in the IL-TRM.

### 3.11 Interactive Effects

The TRM presents engineering equations for most measures. This approach is desirable because it conveys information clearly and transparently and is widely accepted in the industry. Unlike simulation model results, engineering equations also provide flexibility and the opportunity for users to substitute local, specific information for specific input values. Furthermore, the parameters can be changed in TRM updates to be applied in future years

<sup>43</sup> Calculated as  $((1 + \text{Nominal Discount Rate}) / (1 + \text{Real Discount Rate}) - 1)$ .

<sup>44</sup> Consistent with the IL EE Policy Manual Version 2.0, the societal discount rate used for analyses pertaining to the 2022-2025 Plan cycle will be this discount rate first presented in the 2021 IL-TRMv9.0. “The societal discount rate will be fixed for the entirety of each Plan period, and used for all analyses pertaining to that Plan period. That is, the real and/or nominal societal discount rates used in the development of the Program Administrators’ multi-year Plans shall also be used for retrospective Cost-Effectiveness analyses of the evaluated results of each of the years in those Plans as well as in the IL-TRM applicable to the years in those Plans.”

<sup>45</sup> Consistent with the IL EE Policy Manual Version 2.0, “The societal discount rate used for analyses pertaining to the 2018-2021 Plan cycle will be the discount rate in the 2019 IL-TRM.”

as better information becomes available.

One limitation is that some interactive effects between measures are not automatically captured. Because we cannot know what measures will be implemented at the same time with the same customer, we cannot always capture the interactions between multiple measures within individual measure characterizations. However, interactive effects with different end-uses are included in individual measure characterizations whenever possible.<sup>46</sup> For instance, waste heat factors are included in the lighting characterizations to capture the interaction between more-efficient lighting measures and the amount of heating and/or cooling that is subsequently needed in the building.

By contrast, no effort is made to account for interactive effects between an efficient air conditioning measure and an efficient lighting measure, because it is impossible to know the specifics of the other measure in advance of its installation. For custom measures and projects where a bundle of measures is being implemented at the same time, these kinds of interactive effects should be estimated.

---

<sup>46</sup> For more information, please refer to the document, “Dealing with interactive Effects During Measure Characterization” Memo to the Stakeholder Advisory Group dated 12/13/11.  
[http://portal.veic.org/projects/illinoistrm/Shared%20Documents/Memos/Interactive\\_Effects\\_Memo\\_121311.docx](http://portal.veic.org/projects/illinoistrm/Shared%20Documents/Memos/Interactive_Effects_Memo_121311.docx)

# **2021 Illinois Statewide Technical Reference Manual for Energy Efficiency**

## **Version 9.0**

### **Volume 2: Commercial and Industrial Measures**

**FINAL**

**September 25, 2020**

**Effective:**

**January 1, 2021**

[INTENTIONALLY LEFT BLANK]

**VOLUME 1: OVERVIEW AND USER GUIDE**

**VOLUME 2: COMMERCIAL AND INDUSTRIAL MEASURES..... 9**

**4.1 Agricultural End Use ..... 9**

- 4.1.1 Engine Block Timer for Agricultural Equipment ..... 9
- 4.1.2 High Volume Low Speed Fans ..... 12
- 4.1.3 High Speed Fans ..... 14
- 4.1.4 Livestock Waterer ..... 16
- 4.1.5 Fan Thermostat Controller ..... 18
- 4.1.6 Low Pressure Sprinkler Nozzles..... 21
- 4.1.7 Milk Pre-Cooler ..... 23
- 4.1.8 VSD Milk Pump with Plate Cooler Heat Exchanger ..... 26
- 4.1.9 Scroll Compressor for Dairy Refrigeration ..... 29
- 4.1.10 Dairy Refrigeration Heat Recovery..... 32
- 4.1.11 Commercial LED Grow Lights..... 36
- 4.1.12 Swine Heat Pads..... 41

**4.2 Food Service Equipment End Use..... 45**

- 4.2.1 Combination Oven ..... 45
- 4.2.2 Commercial Solid and Glass Door Refrigerators & Freezers ..... 52
- 4.2.3 Commercial Steam Cooker ..... 55
- 4.2.4 Conveyor Oven..... 62
- 4.2.5 ENERGY STAR Convection Oven..... 64
- 4.2.6 ENERGY STAR Dishwasher ..... 67
- 4.2.7 ENERGY STAR Fryer ..... 77
- 4.2.8 ENERGY STAR Griddle..... 81
- 4.2.9 ENERGY STAR Hot Food Holding Cabinets..... 86
- 4.2.10 Ice Maker..... 89
- 4.2.11 High Efficiency Pre-Rinse Spray Valve ..... 93
- 4.2.12 Infrared Charbroiler ..... 98
- 4.2.13 Infrared Rotisserie Oven..... 100
- 4.2.14 Infrared Salamander Broiler ..... 102
- 4.2.15 Infrared Upright Broiler ..... 104
- 4.2.16 Kitchen Demand Ventilation Controls ..... 106
- 4.2.17 Pasta Cooker..... 109
- 4.2.18 Rack Oven - Double Oven ..... 111



4.2.19	ENERGY STAR Electric Convection Oven.....	113
4.2.20	Efficient Dipper Wells.....	117
<b>4.3</b>	<b>Hot Water.....</b>	<b>121</b>
4.3.1	Water Heater.....	121
4.3.2	Low Flow Faucet Aerators.....	131
4.3.3	Low Flow Showerheads.....	139
4.3.4	Commercial Pool Covers.....	145
4.3.5	Tankless Water Heater – Measure combined with 4.3.1 Water Heater in Version 8.....	148
4.3.6	Ozone Laundry.....	149
4.3.7	Multifamily Central Domestic Hot Water Plants.....	158
4.3.8	Controls for Central Domestic Hot Water.....	162
4.3.9	Heat Recovery Grease Trap Filter.....	165
4.3.10	DHW Boiler Tune-up.....	169
4.3.11	Tunnel Washers.....	173
4.3.12	Tank Insulation.....	178
<b>4.4</b>	<b>HVAC End Use.....</b>	<b>182</b>
4.4.1	Air Conditioner Tune-up.....	186
4.4.2	Space Heating Boiler Tune-up.....	189
4.4.3	Process Boiler Tune-up.....	192
4.4.4	Boiler Lockout/Reset Controls.....	195
4.4.5	Condensing Unit Heaters.....	197
4.4.6	Electric Chiller.....	199
4.4.7	ENERGY STAR and CEE Super Efficient Room Air Conditioner.....	206
4.4.8	Guest Room Energy Management (PTAC & PTHP).....	210
4.4.9	Air and Water Source Heat Pump Systems.....	216
4.4.10	High Efficiency Boiler.....	226
4.4.11	High Efficiency Furnace.....	229
4.4.12	Infrared Heaters.....	235
4.4.13	Package Terminal Air Conditioner (PTAC) and Package Terminal Heat Pump (PTHP).....	238
4.4.14	Pipe Insulation.....	244
4.4.15	Single-Package and Split System Unitary Air Conditioners.....	262
4.4.16	Steam Trap Replacement or Repair.....	273
4.4.17	Variable Speed Drives for HVAC Pumps and Cooling Tower Fans.....	280

4.4.18	Small Commercial Programmable Thermostats – Retired 12/31/2019. Replaced with 4.4.48 Small Commercial Thermostats .....	284
4.4.19	Demand Controlled Ventilation .....	285
4.4.20	High Turndown Burner for Space Heating Boilers.....	290
4.4.21	Linkageless Boiler Controls for Space Heating .....	293
4.4.22	Oxygen Trim Controls for Space Heating Boilers .....	295
4.4.23	Shut Off Damper for Space Heating Boilers or Furnaces .....	297
4.4.24	Small Pipe Insulation .....	299
4.4.25	Small Commercial Programmable Thermostat Adjustments – Retired 12/31/2019.....	305
4.4.26	Variable Speed Drives for HVAC Supply and Return Fans.....	306
4.4.27	Energy Recovery Ventilator .....	312
4.4.28	Stack Economizer for Boilers Serving HVAC Loads .....	317
4.4.29	Stack Economizer for Boilers Serving Process Loads .....	320
4.4.30	Notched V Belts for HVAC Systems .....	323
4.4.31	Small Business Furnace Tune-Up .....	330
4.4.32	Combined Heat and Power .....	333
4.4.33	Industrial Air Curtain .....	341
4.4.34	Destratification Fan.....	351
4.4.35	Economizer Repair and Optimization.....	358
4.4.36	Multi-Family Space Heating Steam Boiler Averaging Controls.....	367
4.4.37	Unitary HVAC Condensing Furnace .....	369
4.4.38	Covers and Gap Sealers for Room Air Conditioners .....	377
4.4.39	High Temperature Heating and Ventilation (HTHV) Direct Fired Heater.....	383
4.4.40	Gas High Efficiency Single Package Vertical Air Conditioner.....	389
4.4.41	Advanced Rooftop Controls (ARC) .....	393
4.4.42	Advanced Thermostats for Small Commercial – Retired 12/31/2019. Replaced with 4.4.48 Small Commercial Thermostats.....	401
4.4.43	Packaged RTU Sealing.....	402
4.4.44	Commercial Ground Source and Ground Water Source Heat Pump.....	407
4.4.45	Adsorbent Air Cleaning.....	431
4.4.46	Server Room Temperature Set back .....	436
4.4.47	Air Deflectors for Unit Ventilators – PROVISIONAL MEASURE.....	439
4.4.48	Small Commercial Thermostats – PROVISIONAL MEASURE .....	441
4.4.49	Boiler Chemical Descaling.....	445

4.4.50	Electric Chillers with Integrated Variable Speed Drives.....	448
4.4.51	Advanced Rooftop Controls with High Rotor Pole Switch Reluctance Motors .....	457
4.4.52	Hydronic Heating Radiator Replacement .....	464
<b>4.5</b>	<b>Lighting End Use .....</b>	<b>469</b>
4.5.1	Commercial ENERGY STAR Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8..	474
4.5.2	Fluorescent Delamping.....	475
4.5.3	High Performance and Reduced Wattage T8 Fixtures and Lamps .....	479
4.5.4	LED Bulbs and Fixtures .....	492
4.5.5	Commercial LED Exit Signs.....	508
4.5.6	LED Traffic and Pedestrian Signals .....	512
4.5.7	Lighting Power Density.....	515
4.5.8	Miscellaneous Commercial/Industrial Lighting.....	533
4.5.9	Multi-Level Lighting Switch.....	537
4.5.10	Lighting Controls .....	540
4.5.11	Solar Light Tubes .....	545
4.5.12	T5 Fixtures and Lamps.....	548
4.5.13	Occupancy Controlled Bi-Level Lighting Fixtures .....	557
4.5.14	Commercial ENERGY STAR Specialty Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8	561
4.5.15	LED Open Sign.....	562
4.5.16	LED Streetlighting.....	566
4.5.17	Exterior Photocell Repair.....	569
<b>4.6</b>	<b>Refrigeration End Use .....</b>	<b>571</b>
4.6.1	Automatic Door Closer for Walk-In Coolers and Freezers .....	571
4.6.2	Beverage and Snack Machine Controls .....	573
4.6.3	Door Heater Controls for Cooler or Freezer .....	576
4.6.4	Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers.....	579
4.6.5	ENERGY STAR Refrigerated Beverage Vending Machine .....	582
4.6.6	Evaporator Fan Control for Electrically Commutated Motors .....	585
4.6.7	Strip Curtain for Walk-in Coolers and Freezers.....	587
4.6.8	Refrigeration Economizers.....	590
4.6.9	Night Covers for Open Refrigerated Display Cases .....	593
4.6.10	High Speed Rollup Doors .....	596
4.6.11	Q-Sync Motors for Walk-in and Reach-in Coolers/Freezers .....	601

4.6.12	Variable Speed Drive for Condenser Fans .....	608
4.6.13	Add Doors to Open Refrigerated Display Cases .....	610
<b>4.7</b>	<b>Compressed Air .....</b>	<b>615</b>
4.7.1	VSD Air Compressor .....	615
4.7.2	Compressed Air Low Pressure Drop Filters.....	619
4.7.3	Compressed Air No-Loss Condensate Drains.....	622
4.7.4	Efficient Compressed Air Nozzles.....	625
4.7.5	Efficient Refrigerated Compressed Air Dryer.....	628
4.7.6	Vortex Tube Thermostat - PROVISIONAL MEASURE .....	631
4.7.7	Efficient Desiccant Compressed Air Dryer .....	634
4.7.8	Desiccant Dryer Dew Point Demand Controls .....	638
4.7.9	Compressed Air Heat Recovery.....	642
4.7.10	Compressed Air Storage Receiver Tank.....	645
4.7.11	Reduce Compressed Air Setpoint.....	649
<b>4.8</b>	<b>Miscellaneous End Use .....</b>	<b>652</b>
4.8.1	Pump Optimization .....	652
4.8.2	Roof Insulation for C&I Facilities.....	654
4.8.3	Computer Power Management Software.....	660
4.8.4	Modulating Commercial Gas Clothes Dryer.....	664
4.8.5	High Speed Clothes Washer.....	666
4.8.6	ENERGY STAR Computers .....	670
4.8.7	Advanced Power Strip – Tier 1 Commercial.....	674
4.8.8	High Efficiency Transformer.....	677
4.8.9	High Frequency Battery Chargers .....	681
4.8.10	Commercial Clothes Dryer Moisture Sensor.....	684
4.8.11	Efficient Thermal Oxidizers .....	688
4.8.12	Spring-Loaded Garage Door Hinge.....	693
4.8.13	Variable Speed Drives for Process Fans.....	698
4.8.14	Low Flow Toilets and Urinals .....	703
4.8.15	Smart Irrigation Controls.....	706
4.8.16	Commercial Weather Stripping.....	710
4.8.17	Switch Peripheral Equipment Consolidation .....	713
4.8.18	ENERGY STAR Uninterruptible Power Supply .....	718
4.8.19	Energy Efficient Rectifier .....	721

4.8.20 Energy Efficient Hydraulic Oils - Provisional Measure ..... 724  
4.8.21 Energy Efficient Gear Lubricants - Provisional Measure..... 727  
4.8.22 Smart Sockets – Provisional Measure ..... 730

VOLUME 3: RESIDENTIAL MEASURES

VOLUME 4: CROSS CUTTING MEASURES AND ATTACHMENTS

## Volume 2: Commercial and Industrial Measures

### 4.1 Agricultural End Use

#### 4.1.1 Engine Block Timer for Agricultural Equipment

##### DESCRIPTION

The measure is a plug-in timer that is activated below a specific outdoor temperature to control an engine block heater in agricultural equipment. Engine block heaters are typically used during cold weather to pre-warm an engine prior to start, for convenience, heaters are typically plugged in considerably longer than necessary to improve startup performance. A timer allows a user to preset the heater to come on for only the amount of time necessary to pre-warm the engine block, reducing unnecessary run time even if the baseline equipment has an engine block temperature sensor.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

##### DEFINITION OF EFFICIENT EQUIPMENT

The efficient measure is an engine block heater operated by an outdoor plug-in timer (15 amp or greater) that turns on the heater only when the outdoor temperature is below 25 °F.

##### DEFINITION OF BASELINE EQUIPMENT

The baseline scenario is an engine block heater that is manually plugged in by the farmer to facilitate equipment startup at a later time.

##### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 3 years.<sup>1</sup>

##### DEEMED MEASURE COST

The incremental cost per installed plug-in timer is \$10.19.<sup>2</sup>

##### COINCIDENCE FACTOR

Engine block timers only operate in the winter, so the summer peak demand savings is zero.

---

#### Algorithm

---

##### CALCULATION OF SAVINGS

##### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ISR * Use\ Season * \%Days * HrSave/Day * kW_{heater} - ParaLd$$

Where:

$$ISR = \text{In Service Rate}$$

---

<sup>1</sup> Equipment life is expected to be longer, but measure life is more conservative to account for possible attrition in use over time.

<sup>2</sup> Based on bulk pricing reported by EnSave, which administers the rebate in Vermont

	= 78.39% <sup>3</sup>
Use Season	= The number of days in the use season in which the temperature drops below 25°F in the state of Illinois = 75 days <sup>4</sup>
%Days	= Propoortion of days timer is used with the Use Season = 84.23% <sup>5</sup>
HrSave/Day	= Hours of savings per day when timer is used = 7.765 hours per day <sup>6</sup>
kW <sub>heater</sub>	= Connected load of the engine block heater = 1.5 kW <sup>7</sup>
ParaLd	= Parasitic load = 5.46 kWh <sup>8</sup>

**For example**, using the default assumptions on the installation of a timer on an engine block with a 1.5 kW heater:

$$\Delta\text{kWh} = 78.39\% * 75 \text{ days} * 84.23\% * 7.765 \text{ Hr/Day} * 1.5 \text{ kW} - 5.46 \text{ kWh}$$

$$= 571 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>3</sup> Efficiency Vermont (EVT) Technical Reference Manual (TRM), Measure Savings Algorithms and Cost Assumptions, March 16, 2015. Based on field study conducted by Efficiency Vermont on 352 sites in Vermont and Minnesota.

<sup>4</sup> The number of days in the use season in which the temperature drops below 25°F in the state of Illinois. The data is sourced as an average from TMY3 weather data for five different weather zones within the state.

<sup>5</sup> EVT TRM, March 16, 2015. Based on field study conducted by EVT on 352 sites in Vermont and Minnesota.

<sup>6</sup> Ibid. The hours per day saved is sourced as the difference between the baseline run hours per day without the timer, 10.66 hours, and the efficient run hours per day with the timer, 2.90 hours.

<sup>7</sup> Ibid. Based on an average sized engine block heater, which typically ranges in connected load from 0.20 kW and 2 kW, as sourced from Efficiency Vermont program data.

<sup>8</sup> Ibid.

**MEASURE CODE: CI-AGE-EBLT-V02-190101**

**REVIEW DEADLINE: 1/1/2024**



### 4.1.2 High Volume Low Speed Fans

**DESCRIPTION**

The measure applies to 20-24 foot diameter horizontally mounted ceiling high volume low speed (HVLS) fans that are replacing multiple non HVLS fans that have reached the end of useful life in agricultural applications.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

In order for this characterization to apply, the efficient equipment is assumed to be classified as HVLS and have a VFD.<sup>9</sup>

**DEFINITION OF BASELINE EQUIPMENT**

In order for this characterization to apply, the baseline condition is assumed to be multiple non HVLS existing fans that have reached the end of useful life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 10 years.<sup>10</sup>

**DEEMED MEASURE COST**

The incremental capital cost for the fans are as follows:<sup>11</sup>

Fan Diameter Size (feet)	Incremental Cost
20	\$4150
22	\$4180
24	\$4225

**LOADSHAPE**

Loadshape C34 - Industrial Motor

**COINCIDENCE FACTOR**

The measure has deemed kW savings therefore, a coincidence factor is not applied.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS <sup>12</sup>**

The annual electric savings from this measure are deemed values depending on fan size and apply to all building types:

Fan Diameter Size (feet)	kWh Savings
20	6,577
22	8,543

---

<sup>9</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4

<sup>10</sup> Ibid.

<sup>11</sup> Ibid.

<sup>12</sup> Ibid.

Fan Diameter Size (feet)	kWh Savings
24	10,018

**SUMMER COINCIDENT PEAK DEMAND SAVINGS<sup>13</sup>**

The annual kW savings from this measure are deemed values depending on fan size and apply to all building types:

Fan Diameter Size (feet)	kW Savings
20	2.4
22	3.1
24	3.7

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-HVSF-V02-190101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>13</sup> Ibid.

### 4.1.3 High Speed Fans

**DESCRIPTION**

The measure applies to high speed exhaust, ventilation and circulation fans that are replacing an existing unit that reached the end of its useful life in agricultural applications.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

In order for this characterization to apply, the efficient equipment is assumed to be diffuser equipped and meet the following minimum efficiency criteria.<sup>14</sup>

Diameter of Fan (inches)	Minimum Efficiency for Exhaust & Ventilation Fans	Minimum Efficiency for Circulation Fans
24 through 35	14.0 cfm/W at 0.10 static pressure	12.5 lbf/kW
36 through 47	17.1 cfm/W at 0.10 static pressure	18.2 lbf/kW
48 through 71	20.3 cfm/W at 0.10 static pressure	23.0 lbf/kW

**DEFINITION OF BASELINE EQUIPMENT**

In order for this characterization to apply, the baseline condition is assumed to be an existing fan that reached the end of its useful life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 7 years.<sup>15</sup>

**DEEMED MEASURE COST**

The incremental capital cost for all fan sizes is \$150.<sup>16</sup>

**LOADSHAPE**

Loadshape C34 - Industrial Motor

**COINCIDENCE FACTOR**

The measure has deemed kW savings therefore, a coincidence factor is not applied.

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS <sup>17</sup>**

The annual electric savings from this measure are deemed values depending on fan size and apply to all building types:

Diameter of Fan (inches)	kWh
24 through 35	372

<sup>14</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4

<sup>15</sup> Ibid.

<sup>16</sup> Ibid.

<sup>17</sup> Ibid.

Diameter of Fan (inches)	kWh
36 through 47	625
48 through 71	1,122

**SUMMER COINCIDENT PEAK DEMAND SAVINGS<sup>18</sup>**

The annual kW savings from this measure are deemed values depending on fan size and apply to all building types:

Diameter of Fan (inches)	kW
24 through 35	0.118
36 through 47	0.198
48 through 71	0.356

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-HSF-V02-190101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>18</sup> Ibid.

#### 4.1.4 Livestock Waterer

##### **DESCRIPTION**

This measure applies to the replacement of electric open waterers with sinking or floating water heaters with equivalent herd size watering capacity of the old unit. Livestock waterers utilize electric heating elements and are used in cold climate locations in order to prevent water from freezing. Energy efficient livestock waterers, also called no or low energy livestock waterers, are closed and insulated watering containers that use lower wattage heating elements, thermostatically controlled, and water agitation (either in the form of air bubbles or floating balls), to prevent water from freezing, using less energy.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

##### **DEFINITION OF EFFICIENT EQUIPMENT**

In order for this characterization to apply, the efficient equipment is assumed to an electrically heated thermally insulated waterer with minimum 2 inches of insulation. A thermostat is required on unit with heating element greater than or equal to 250 watts.<sup>19</sup>

##### **DEFINITION OF BASELINE EQUIPMENT**

In order for this characterization to apply, the baseline equipment is assumed to be an electric open waterer with sinking or floating water heaters that have reached the end of useful life.

##### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 10 years.<sup>20</sup>

##### **DEEMED MEASURE COST**

The incremental capital cost for the waterers are \$787.50.<sup>21</sup>

##### **LOADSHAPE**

Loadshape C04 - Non-Residential Electric Heating

##### **COINCIDENCE FACTOR**

Heated livestock waterers only operate in the winter in order to keep water from freezing so the summer peak coincident demand savings is zero.

---

---

#### **Algorithm**

---

---

##### **CALCULATION OF SAVINGS**

##### **ELECTRIC ENERGY SAVINGS <sup>22</sup>**

The annual electric savings from this measure is a deemed value and assumed to be 1,592.85 kWh.

##### **SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

---

<sup>19</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4

<sup>20</sup> Ibid.

<sup>21</sup> Ibid.

<sup>22</sup> Ibid.

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-LSW1-V03-190101**

**REVIEW DEADLINE: 1/1/2024**

## 4.1.5 Fan Thermostat Controller

### DESCRIPTION

Incorporating a ventilation fan thermostat controller can reduce energy consumed where livestock is housed. Livestock ventilation fans reduce heat stress during the warmer months of the year.

For the purposes of this measure characterization, the installed ventilation fan thermostat controllers are temperature based on/off controls. While the complexity and intelligence of available controls can vary widely, where integrated controls can automate multiple modes and stages of ventilation, this measure assumes the control functionality is turning off the fan once the temperature falls to a certain point. It is recommended that other intelligent control technologies and strategies be handled through a custom approach, as these control installations require commissioning to optimize the functionality based on unique site and design considerations.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to the incorporation of thermostatic controller for ventilation fans used in the livestock industry. To qualify, the ventilation fan must be used to modulate the temperature to reduce heat stress in a livestock facility.

### DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is a non-thermostatically controlled livestock ventilation fan that operates constantly in their maximum capacity.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 15 years.<sup>23</sup>

### DEEMED MEASURE COST

The incremental cost is estimated at \$50 per fan.<sup>24</sup>

### LOADSHAPE

Loadshape C34 – Industrial Motor

### COINCIDENCE FACTOR

The savings come from a reduction in nighttime operation, so a coincidence factor is not applicable for this measure.

---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

The annual energy savings are generated by the fan being disabled at temperatures below 70°F. Typically the evening hours are cooler, and the ventilation fans are not required at these lower temperatures. It is assumed, prior to retrofit, that baseline ventilation fans are operating continuously from May 1st through October 31st, encapsulating the entire portion of the year in which hot temperatures exist and the need for livestock housing ventilation is prevalent. The efficient fan operation is derived from regional TMY3 data for the state of Illinois and represent, over

---

<sup>23</sup> Focus on Energy Evaluation Business Programs Measure Life Study: Final Report August 25, 2009, Public Service Commission of Wisconsin.

<sup>24</sup> The measure incremental cost is sourced from the 2019 Michigan Energy Measures Database (MEMD).

the same timeline that was used for the baseline, the number of hours in which the temperature is above 70°F. Electric Energy Savings

$$\Delta kWh/HP = HP_{Fan} \times LF \times C_{ME} \times \Delta Hours \div Eff_{motor}$$

Where:

- HP<sub>Fan</sub> = Motor horsepower of the controlled fan  
= Actual; if unknown, default to 1 horsepower<sup>25</sup>
- LF = Fan load factor  
= 0.75
- CME = 0.746 kW to HP conversion factor
- ΔHours = Reduction in fan run hours as a result of the thermostat controller, dependent on location<sup>26</sup>

Zone	Hours <sub>Base</sub>	Hours <sub>Eff</sub>	ΔHours
Rockford	4,416	1,559	2,857
Chicago	4,416	1,596	2,820
Springfield	4,416	2,054	2,362
Belleville	4,416	2,148	2,268
Marion	4,416	2,224	2,192

Eff<sub>motor</sub> = 82.5%<sup>27</sup>, motor efficiency

**For example**, using the default assumptions on a 1 horsepower fan thermostat controller for a single fan on a farm in Marion:

$$\begin{aligned} \Delta kWh &= 1 \text{ HP} \times 0.75 \times 0.746 \times 2,192 \text{ hours} / 82.5\% \text{ efficiency} \\ &= 1,487 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A – Assume fans will be in operation at maximum capacity during the coincident peak demand periods, resulting in zero potential demand savings during the hottest periods of the summer.

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>25</sup> The default fan horsepower is based on a review of single- and three-phase fans listed on BESS Labs performance tested exhaust fans between 36” and 47”. The Bioenvironmental and Structural Systems (BESS) Laboratory is a research and agriculture fan product-testing lab at the University of Illinois. For more detail on the derivation of fan horsepower from BESS Lab’s fan performance archive, please see “BESS Bin Data.xlsx”.

<sup>26</sup> The baseline run time assumes equipment continuous operation from May 1<sup>st</sup> through October 31<sup>st</sup>. Efficient run time is based on regional TMY3 weather data and is the count of hours in which outdoor air temperature exceeds 70°F.

<sup>27</sup> Table 1 with efficiency classes 60034-30 (2008), 4 Pole High Efficiency Motor, Technical note, IEC 600034-30 standard on efficiency classes for low voltage AC motors, TM)25 EN RevC 01-2-12, ABB.



**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-FNTC-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.1.6 Low Pressure Sprinkler Nozzles

### DESCRIPTION

Incorporating low pressure sprinkler nozzles can decrease the energy and water consumed by reducing required water supply pressure to irrigate crop fields. Low pressure sprinkler nozzles can provide uniform water application by using various orifice applications and configurations while operating at a lower pressure compared to standard, impact driven sprinkler heads. Energy savings are achieved by the irrigation system operating at a lower water pressure while maintaining the same water distribution.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Low Pressure Irrigation Nozzles operate at 35 psi or lower at rated/required flow. Annual Electric Savings obtained will be based on the number of nozzles replaced. To qualify the nozzles must operate for more than 500 hours per year and provide the equivalent flow at the reduced pressure. The maximum pump pressure must also be reduced accordingly.

### DEFINITION OF BASELINE EQUIPMENT

This measure applies to the replacement of high pressure irrigation nozzles that operate at 50 psi or greater at rated/required flow.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 5 years.<sup>28</sup>

### DEEMED MEASURE COST

The incremental cost, including labor, is \$1.74 per nozzle.<sup>29</sup>

### LOADSHAPE

Loadshape C59 – Agriculture and Well Pumping

### COINCIDENCE FACTOR

Coincidence Factor = 0.793<sup>30</sup>

---

---

### Algorithm

---

---

### CALCULATION OF ENERGY SAVINGS

The annual energy savings and coincidental electric demand savings is based on PG&E research on irrigation well pumping systems and corrected based upon the type of crop, irrigated acres, and average acre-feet of water applied per acre.<sup>31</sup>

---

<sup>28</sup> Measure life is sourced from DEER 2008 for permanent, solid-set low pressure sprinkler nozzles.

<sup>29</sup> The incremental cost is sourced from SCE Workpaper, SCE13WP007, Low pressure Sprinkler Nozzles, January 2013.

<sup>30</sup> Iowa Energy Efficiency Statewide TRM, Version 3.0, effective January 1, 2019

<sup>31</sup> For additional detail on the derivation of Illinois-specific savings values and how the original source material was modified and normalized into single deemed values, please see the Illinois Workpaper for this measure, "Illinois\_Statewide\_TRM\_Workpaper\_Low Pressure Sprinkler Nozzles\_2019 4.1.7.docx".

**ELECTRIC ENERGY SAVINGS**

Annual kWh Savings = 4.06 kWh/yr/nozzle

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Annual kW Savings = 0.0017 kW/yr/nozzle

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-LPSN-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.1.7 Milk Pre-Cooler

### DESCRIPTION

There is energy savings for adding a plate heat exchanger (pre-cooler) ahead of the milk storage tank. This addresses the electrical energy savings associated with the decreased milk cooling load. Installing a pre-cooler reduces milk temperature from 100°F to 55-70°F before it enters the bulk tank.

It is important to determine if the site has an adequate supply of water, as milk plate coolers require 1 to 2 times the amount of water as compared to processed milk, to be effective. However, sites leveraging plate coolers will repurpose the warm, discharged water, either for watering cows, wash-down, or other purposes on the farm. As there are indirect benefits associated with the warmer water,<sup>32</sup> and because it is typically repurposed, it is assumed that there are no negative water impacts for this measure. There are also no interactive domestic hot water savings attributable to the installation of a pre-cooler as the discharged water is typically not re-directed to the existing hot water heater.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The installation of the heat exchanger to decrease the cooling requirement of the primary milk bulk tank refrigeration system. The heat exchanger fluid medium used for heat rejection is well or ground water as this produces the largest temperature differential for energy savings. For water requirements, the water supply system must have capacity to keep up with the existing farm water demands and additional demands of the pre-cooler. To minimize the volume of water used for pre-cooling, a solenoid valve should be installed on the water supply line to the pre-cooler and be actuated only when the milk pump is in operation. A bypass line around the solenoid valve or a time delay relay can also be used to provide additional cooling of the residual milk in the pre-cooler between pumping cycles. A storage tank will be necessary for used cooling water storage until it is re-used for watering cows, cleanup or another purpose on the farm.

### DEFINITION OF BASELINE EQUIPMENT

The baseline conditions assume that no previous pre-cooler heat exchanger was installed and the entire milk cooling load is on the milk bulk tank.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 15 years.<sup>33</sup>

### DEEMED MEASURE COST

The average equipment cost of a plate cooler is \$2,950 with an installation cost of \$494, for a total incremental measure of \$3,444.<sup>34</sup>

---

<sup>32</sup> It is less stressful (metabolically) for cows to drink warmed water, and research has shown that cows will drink more water if it is warmer, leading to increased milk production. "Massachusetts Farm Energy Best Management Practices for Dairy Farms", United States Department of Agriculture (USDA), Natural Resource Conservation Service (NRCS), 2012.

<sup>33</sup> PA Consulting Group for the State of Wisconsin Public Service Commission, Focus on Energy Evaluation. Business Programs: Measure Life Study. Page 45 of pdf file. August 25, 2009.

<sup>34</sup> The equipment and labor costs are sourced from the PG&E Workpaper – Milk Pre Cooler (PGE3PAGR114), February 2013.

**LOADSHAPE**

Loadshape C58 – Farm Plate Cooler / Heat Recovery Unit

**COINCIDENCE FACTOR**

Coincidence factor of 0.16<sup>35</sup>

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Milk Pre-Cooler Heat Exchanger – Chiller Savings

$$\Delta kWh = \frac{\Delta T \times Lbs\ of\ Milk \times Cows \times C_{p,m} \times Days}{EER \times 1,000}$$

Where:

- $\Delta T$  = Change in milk temperature attributable to the pre-cooler  
= 30°F<sup>36</sup>
- Lbs of Milk = The pounds of milk produced per day that needs to be cooled  
= 68 lbs of milk per cow<sup>37</sup>
- Cows = Number of milking cows per farm  
= Actual; if unknown use 101<sup>38</sup>
- $C_{p,m}$  = Specific heat of milk  
= 0.93 Btu/lb °F<sup>39</sup>
- Days = 365 days/yr
- EER = Efficiency of the existing compressor  
= 8.0 Btuh/watt<sup>40</sup>
- 1,000 = 1,000 Watts to kW conversion factor

---

<sup>35</sup> Efficiency Vermont (EVT) Technical Reference Manual (TRM), Measure Savings Algorithms and Cost Assumptions, March 16, 2015

<sup>36</sup> The efficacy of a milk plate cooler is sourced from Sanford, Scott (University of Wisconsin–Madison). “Energy Efficiency for Dairy Enterprises.” Presentation to Agricultural and Life Sciences Program staff. December 2014. It was assumed that there is a 25°F of milk temperature difference for a single pass plate cooler and a 35°F of temperature difference for a double/multi-pass plate cooler. For the purposes of this measure, a straight average of 30°F between the two types was used. A plate cooler reduces the overall load on the refrigeration compressors and the revised  $\Delta T$  when accounting for a milk pre-cooler is 30°F less <sup>37</sup> “Ag Heat Recovery Tank Supplemental Data.” WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. “Milk Production per Cow, Wisconsin.”

<sup>38</sup> The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

<sup>39</sup> Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

<sup>40</sup> Average efficiency of an existing compressor on a dairy farm, as sourced from, Massachusetts Farm Energy: Best Management Practices for Dairy Farms, USDA NRCS, 2012 (page 19).

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \frac{\Delta kWh}{Hours} \times CF$$

Where:

Hours = 2920 hours<sup>41</sup>

CF = 0.16

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-MLKP-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>41</sup> Raw milk for pasturing must be cooled with 4 hours. Assuming 2 milking per day. Dairy Farm Energy Management Guide: California, Ludington, Johnson, Kowalski, & Mage, Southern California Edison, 2004.

## 4.1.8 VSD Milk Pump with Plate Cooler Heat Exchanger

### DESCRIPTION

This technology incorporates adding a variable speed drive to a milk transfer pump. The VSD drive reduces the heat transferred to milk during pumping operation as well increases the amount of time the milk is in the free cooling heat exchanger. The VFD regulates the milk pump in order to increase the efficacy of the plate cooler heat exchanger by slowing the flow of milk. This results in a maximum heat transfer between the warm milk and the cold water used in the plate cooler.

Energy savings are realized by the reduced load on the primary milk cooling system. A milk transfer pump VSD is only effective if paired with a plate cooler.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Installation of a new variable speed drive (VSD) on a new or existing milk transfer process pump.

### DEFINITION OF BASELINE EQUIPMENT

Must have a constant speed milk transfer process pump with no existing VSD controls. A plate cooling heat exchanger can already be a part of the system, or one installed in concert with the VSD.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 15 years.<sup>42</sup>

### DEEMED MEASURE COST

The average equipment cost of a milk vacuum pump variable speed drive is \$3,871 with an installation cost of \$1,177, for a total incremental measure of \$5,048.<sup>43</sup>

### LOADSHAPE

Loadshape C57 – Milk Pump

### COINCIDENCE FACTOR

There are no summer coincident peak savings for VFD dairy milk pumps. Through research of refrigeration compressor power demands, no substantial evidence has arisen that any notable kW demand reduction is possible in relation to using a VFD with a milk pre-cooler to pre-cool milk that would otherwise need to be chilled through mechanical refrigeration means.

---

<sup>42</sup> Focus on Energy Evaluation Business Programs Measure Life Study: Final Report August 25, 2009, Public Service Commission of Wisconsin.

<sup>43</sup> The equipment and labor costs are sourced from the PG&E Workpaper – Milk Vacuum Pump VSD, Dairy Farm Equipment (PGE3PAGR116), February 2013.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \frac{1}{EER} \times C_{p,m} \times \Delta T \times \text{Lbs of Milk} \times \text{Cows} \times \text{Days} / 1,000$$

Where:

- EER = Efficiency of the existing compressor  
= 8.0 Btu/watt<sup>44</sup>
- C<sub>p,m</sub> = Specific heat of milk  
= 0.93 Btu/lb °F<sup>45</sup>
- ΔT = Change in milk temperature as a result of the milk transfer pump VSD. This value is the additional benefits of a VSD on the milk pump over a standard plate cooler  
= 11.7 °F<sup>46</sup>
- Lbs of Milk = The pounds of milk produced per day that needs to be cooled  
= 68 lbs of milk per cow<sup>47</sup>
- Cows = Number of milking cows per farm  
= Actual, if unknown use 101<sup>48</sup>
- Days = 365 days of milking per year
- 1,000 = Watts to kW conversion factor

**For example**, using the default assumptions, the average kWh savings resulting from the installation of a milk transfer pump VSD is:

$$\Delta kWh = \frac{1}{8.0 \text{ Btu/Watt}} \times 0.93 \times 11.7^\circ F \times 68 \frac{\text{lbs}}{\text{milk/cow}} \times 101 \text{ cows} \times 365 \frac{\text{days}}{\text{yr}} / 1,000$$

$$= 3,410 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

<sup>44</sup> Average efficiency of an existing compressor on a dairy farm, as sourced from, Massachusetts Farm Energy: Best Management Practices for Dairy Farms, USDA NRCS, 2012 (page 19)

<sup>45</sup> Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

<sup>46</sup> Sanford, Scott (University of Wisconsin–Madison). “Well Water Precoolers.” Publication A37843. October 2003. It was determined that a plate cooler alone can reduce milk temperature to 68 °F and a plate cooler paired with a milk transfer pump VSD can reduce milk temperature to 56.3 °F. The additional benefits of the milk transfer pump VSD over the plate cooler is 11.7 °F.

<sup>47</sup> “Ag Heat Recovery Tank Supplemental Data.” WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. “Milk Production per Cow, Wisconsin.”

<sup>48</sup> The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.



**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-VSDM-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.1.9 Scroll Compressor for Dairy Refrigeration

### DESCRIPTION

Incorporating a more efficient compressor for process milk refrigeration can decrease the energy consumed at dairy farms. This measure is for the installation of a scroll compressor to replace an existing reciprocating compressor on a milk refrigeration bulk tank. The milk refrigeration system is used to cool milk for preservation and packaging. Milk is extracted from the cow at 98°F and cooled to 38°F, resulting in a substantial load on the milk cooling equipment, which is typically the largest energy use on a dairy farm. Scroll compressors can provide increased refrigeration efficiencies with improved EERs over baseline reciprocating compressors.

The energy savings for this measure is dependent on if the site is utilizing pre-cooling equipment such as a milk plate cooler. Plate coolers can reduce the incoming temperature of the milk into the refrigeration bulk tank, reducing the overall load on the compressor and the potential savings benefits.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

For an efficient scroll compressor with or without a plate cooler heat exchanger, the proposed compressor must be rated at 10.6 EER or greater on a process milk refrigeration system. The calculation assumes the cooling capacity of the compressor remains the same.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a reciprocating compressor.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected life of this measure is 15 years.<sup>49</sup>

### DEEMED MEASURE COST

The incremental cost is \$447 per compressor.<sup>50</sup>

### LOADSHAPE

Loadshape C56 – Dairy Farm Combined End Use

### COINCIDENCE FACTOR

Coincidence factor of 0.34<sup>51</sup>

---

<sup>49</sup> Focus on Energy Evaluation Business Programs Measure Life Study: Final Report August 25, 2009, Public Service Commission of Wisconsin.

<sup>50</sup> The incremental cost is sourced from the PG&E Workpaper – Scroll Compressor (PGE3PAGR113), February 2013. The incremental cost is based on the difference in material and labor cost between a reciprocating compressor, \$2,538, and a scroll compressor, \$2,985.

<sup>51</sup> Efficiency Vermont (EVT) Technical Reference Manual (TRM), Measure Savings Algorithms and Cost Assumptions, March 16, 2015

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \frac{\left( \frac{1}{EER_{base}} - \frac{1}{EER_{eff}} \right) \times Process\ Load}{1,000}$$

Where:

- EER<sub>base</sub> = Efficiency of the existing compressor  
= 8.4 Btu/watt<sup>52</sup>
- EER<sub>eff</sub> = Efficiency of the installed, scroll compressor  
= 10.6 Btu/watt<sup>53</sup>
- Process Load =  $C_{P,Milk} \times \Delta T \times Lbs\ of\ Milk \times Cows \times Days$

Where:

- C<sub>P,Milk</sub> = Specific heat of milk  
= 0.93 Btu/lb °F<sup>54</sup>
- ΔT = Change in milk temperature as result of the primary cooling system  
= 60°F without a milk plate cooler<sup>55</sup>  
= 30°F with a milk plate cooler<sup>56</sup>
- Lbs of Milk = The pounds of milk produced per day that needs to be cooled  
= 68 lbs of milk per cow<sup>57</sup>
- Cows = Number of milking cows per farm  
= Actual; if unknown use 101<sup>58</sup>

<sup>52</sup> Average efficiency of a reciprocating compressor, as sourced from Wisconsin Focus on Energy TRM – Plate Heat Exchanger and Well Water Pre-Cooler, 2017

<sup>53</sup> Average efficiency of a scroll compressor, as sourced from Massachusetts Farm Energy: Best Management Practices for Dairy Farms, USDA NRCS, 2012 (page 33)

<sup>54</sup> Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

<sup>55</sup> Safe Handling of Milk & Dairy Products. March 8th, 2017 and Sanford, Scott (University of Wisconsin–Madison). “Well Water Precoolers.” Publication A37843. October 2003. The temperature of the milk exiting the cow is considered to be 98°F and the final, cooled temperature of the milk is assumed to be 38°F.

<sup>56</sup> The efficacy of a milk plate cooler is sourced from Sanford, Scott (University of Wisconsin–Madison). “Energy Efficiency for Dairy Enterprises.” Presentation to Agricultural and Life Sciences Program staff. December 2014. It was assumed that there is a 25°F of milk temperature difference for a single pass plate cooler and a 35°F of temperature difference for a double/multi-pass plate cooler. For the purposes of this measure, a straight average of 30°F between the two types was used. A plate cooler reduces the overall load on the refrigeration compressors and the revised ΔT when accounting for a milk pre-cooler is 30°F less.

<sup>57</sup> “Ag Heat Recovery Tank Supplemental Data.” WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. “Milk Production per Cow, Wisconsin.”

<sup>58</sup> The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

Days = 365 days per year  
 1,000 = 1000 watts to kW conversion factor

**For example**, using the default assumptions, average kWh savings of an installed scroll compressor on the milk refrigeration bulk tank with a dairy using an existing plate cooler is:

$$\Delta kWh = \frac{\left(\frac{1}{8.4 EER} - \frac{1}{10.6 EER}\right) \times \frac{0.93 Btu}{lb\ of\ Milk} \times (98^{\circ}F - 30^{\circ}F - 38^{\circ}F) \times 68 \frac{lbs\ milk}{cow} \times 101\ cows \times 365\ Days}{1000\ Watts/kW}$$

$\Delta kWh = 1,728\ kWh$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \frac{\Delta kWh}{Hours} \times CF$$

Where:

Hours = 2,920 hours<sup>59</sup>  
 CF = 0.34

**For example**, using the default assumptions, average coincident peak demand savings of an installed scroll compressor on the milk refrigeration bulk tank with a dairy using an existing plate cooler is:

$$\Delta kW = \frac{1,728\ kWh}{2,920\ Hours} \times 0.34$$

$\Delta kW = 0.201\ kW$

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

**MEASURE CODE: CI-AGE-SCRC-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

<sup>59</sup> Raw milk for pasturing must be cooled with 4 hours. Assuming 2 milking per day. Dairy Farm Energy Management Guide: California, Ludington, Johnson, Kowalski, & Mage, Southern California Edison, 2004.

## 4.1.10 Dairy Refrigeration Heat Recovery

### DESCRIPTION

A refrigeration heat recovery (RHR) unit captures waste heat from the refrigeration system and uses a heat exchange to transfer some of that heat into incoming well water. That captured waste heat is used to pre-heat ground water before it enters the primary water heater and brought to the desired final temperature needed for cleaning farm equipment. The hot compressed refrigerant is diverted and flows through the heat exchanger, attached to a secondary water tank, on its way to the condenser unit. The heat from the refrigerant is transferred through the tank into the water. Thermal buoyancy causes the warmest water to rise to the top of the tank. When hot water is used, water flows from the RHR tank into the water heater, and well water flows into the heat recovery tank. These units can assist in reducing water heating energy use by approximately 50%.<sup>60</sup>

It is important to note that if a dairy farm installs an RHR unit and a milk plate cooler, (with or without the use of milk pump VFD control), the plate cooler will impact the savings potential of the RHR unit. The use of a plate cooler will reduce the total milk mechanical refrigeration load. Due to this refrigeration load reduction, the amount of heat rejection possible to the RHR system is diminished.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is farm refrigeration equipment where an RHR tank is installed and captures waste refrigerant heat from the refrigeration system compressor and transfers that waste into an RHR tank, supplied with cool ground water, through a heat exchanger before continuing through the refrigeration system condensing unit. The newly preheated water in the RHR tank is supplied into the farm's main water heater unit, which will have a smaller temperature differential to overcome, compared to a direct ground water heater feed.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing dairy farm with refrigeration equipment and a water heater unit without the use of an RHR unit to feed preheated water to the water heater. Water heater is fed directly with ground water.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected useful life is 15 years.<sup>61</sup>

### DEEMED MEASURE COST

The incremental cost is \$4,353.<sup>62</sup>

### LOADSHAPE

Loadshape C58 – Farm Plate Cooler / Heat Recovery Unit

### COINCIDENCE FACTOR

There are no summer coincident peak savings for RHR units. It is assumed that electric water heaters have a single element and will still be used to heat water up to full temperature, and that the kW rating is unchanged when an RHR unit is added in the water heating loop (resulting in no demand reduction).

---

<sup>60</sup> U.S. Department of Agriculture, Natural Resources Conservation Service. "Energy Self-Assessment: Refrigeration Heat Recovery." Accessed December 8, 2015.

<sup>61</sup> PA Consulting Group Inc. "State of Wisconsin Public Service Commission of Wisconsin Focus on Energy Evaluation Business Programs: Measure Life Study Final Report." August 25, 2009.

<sup>62</sup> The incremental cost is sourced from Efficiency Vermont custom project data based on actual equipment installs between 2010 and 2017.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = Btu_{Recovered} \times Days \times \left( \frac{1}{EF_{elec}} \right) / 3,412$$

Where:

$$Btu_{Recovered} = Btu_{Milk\ Potential} \text{ or } Btu_{RHR\ Storage} \text{ (lesser of the two)}$$

Where:

$$Btu_{Milk\ Potential} = Lbs\ of\ Milk \times Cows \times C_{p,Milk} \times \Delta T_{Milk} \times SF$$

and

$$Btu_{Storage} = Hot\ Water \times C_{p,Water} \times P_{Water} \times \Delta T_{Water}$$

- Days = Number of milking days per year  
= 365 days<sup>63</sup>
- 3,412 = Btu to kWh electric conversion factor
- EF<sub>elec</sub> = Energy factor for a standard electric water heater  
= 90%<sup>64</sup>
- Lbs of Milk = The pounds of milk produced per day per cow that needs to be cooled  
= 68 lbs of milk per cow<sup>65</sup>
- Cows = Number of milking cows per farm  
= Actual, if unknown use 101<sup>66</sup>
- C<sub>p,Milk</sub> = Specific heat of milk  
= 0.93 Btu/(lb-°F)<sup>67</sup>
- ΔT<sub>Milk</sub> = Change in milk temperature  
= °F<sub>IN</sub> - °F<sub>FINAL</sub>  
°F<sub>IN</sub> = Temperature of milk being supplied that needs to be cooled

<sup>63</sup> Wisconsin Milk Marketing Board. "Did You Know? Website: Milking Every Day." Accessed December 21, 2015

<sup>64</sup> Talbot, Jacob (American Council for an Energy-Efficient Economy). ACEEE Report A121: Market Transformation Efforts for Water Heating Efficiency. January 2012.

<sup>65</sup> "Ag Heat Recovery Tank Supplemental Data." WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. "Milk Production per Cow, Wisconsin."

<sup>66</sup> The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

<sup>67</sup> Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

= 98°F if no pre-cooler is used in operation; 68°F if a milk pre-cooler is used;<sup>68</sup>  
 56.3°F if a milk pre-cooler and VFD milk transfer pump are used.<sup>69</sup>

$^{\circ}\text{F}_{\text{FINAL}}$  = Final stored temperature of cooled milk  
 = 38°F

SF = Savings factor for the percentage of energy able to be captured from the milk cooling process  
 = 55%<sup>70</sup>

Hot Water = Amount of hot water per day in gallons that the site uses for washing and cleaning purposes  
 = 131.7 gallons<sup>71</sup>

$C_{p,\text{Water}}$  = Specific heat of water  
 = 1 Btu/lb-°F

$P_{\text{Water}}$  = Density of water  
 = 8.34 lbs/gallon

$\Delta T_{\text{Water}}$  = Temperature difference =  $\text{Temp}_{\text{warm water}} - \text{Temp}_{\text{cold water}}$

$\text{Temp}_{\text{warm water}}$  = 120°F, expected temperature a refrigeration heat recovery unit can pre-heat well water up to.

$\text{Temp}_{\text{cold water}}$  = 52.3°F, average well water temperature

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

**NATURAL GAS SAVINGS**

$$\Delta Therms = Btu_{\text{Recovered}} \times Days \times \left( \frac{1}{EF_{\text{gas}}} \right) / 100,000$$

100,000 =Btu to therms natural gas conversion factor

$EF_{\text{gas}}$  = Energy factor for a standard natural gas water heater

<sup>68</sup> The efficacy of a milk plate cooler is sourced from Sanford, Scott (University of Wisconsin–Madison). “Energy Efficiency for Dairy Enterprises.” Presentation to Agricultural and Life Sciences Program staff. December 2014. It was assumed that there is a 25°F of milk temperature difference for a single pass plate cooler and a 35°F of temperature difference for a double/multi-pass plate cooler. For the purposes of this measure, a straight average of 30°F between the two types was used. A plate cooler reduces the overall load on the refrigeration compressors and the revised  $\Delta T$  when accounting for a milk pre-cooler is 30°F less.

<sup>69</sup> Sanford, Scott (University of Wisconsin–Madison). “Well Water Precoolers.” Publication A37843. October 2003

<sup>70</sup> DeLaval. “Dairy Farm Energy Efficiency.” April 20, 2011. DeLaval estimates the heat recovery potential to be between 20 and 60%. Based on engineering judgement and further corroboration from the Wisconsin Focus on Energy TRM, opted to default to a 55% savings factor.

<sup>71</sup> The hot water use per day is based on the average hot water requirements per wash cycle multiplied by the number of wash cycles per day. The average amount of hot water used per wash cycle, 47.9 gallons, is sourced from the National Resource Conservation Service for Wash Water Requirements for Milking Systems, a calculator developed by University of Wisconsin, August 2005, Milking Center Waste Volume, v12,05, The number of wash cycles per day account for the hot water rinse cycles that are used to flush and clean the milk lines before and after milking. As sourced from the Regional Technical Forum (RTF) as part of the Northwest Power & Conservation Council, Deemed Measures List; Agricultural: Variable Frequency Drives-Dairy, FY2012, v1.2. Pre- and post-power meter data for five sites were used to establish RTF energy savings and the raw data used to generate load profiles showed, on average, two milkings per day. As there will be one more wash cycle than milking, the default average wash cycles per day is three.

= 59%

Other variables remain consistent with 'Electric Energy Savings' calculation method.

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-AGE-DRHR-V01-200101**

**REVIEW DEADLINE: 1/1/2024**



### 4.1.11 Commercial LED Grow Lights

#### DESCRIPTION

LED lamp technology offers reduced energy and maintenance costs when compared with conventional light sources. LED technology has a significantly longer useful life lasting 30,000 hours or more and significantly reduces maintenance costs. The savings and costs for this measure are evaluated with the replacement of HID grow lights with LED fixtures. LED lamps offer a more robust lighting source, longer lifetime, and greater electrical efficiency than conventional supplemental grow lights.

This measure is designed for other interior horticultural applications that use artificial light stimulation in an indoor conditioned space.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

LED fixtures must have a reduced wattage, be listed on the Design Lights Consortium (DLC) qualified products list,<sup>72</sup> be UL Listed, have a power factor (PF)  $\geq 0.90$ , a photosynthetic photon efficacy (PPE) of no less than 1.9 micromoles per joule, a minimum rated lifetime of 50,000 hours, and a minimum warranty of 5 years. If DLC PPE requirements for LED grow lighting exceeds the current requirements, the new PPE will become the efficient equipment standard.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is the industry established grow light based on the horticultural application, as detailed in the table below. HID fixtures are assumed for flowering and vegetative crops. T5 high-output fixtures are assumed for seedling and microgreen crops.

Crop Type	Baseline Technology Type	Baseline PPE ( $\mu\text{mol/J}$ ) <sup>73</sup>	Baseline Watts per Square Foot <sup>74</sup>	Baseline Fixture Wattage <sup>75</sup>
Flowering Crops (Tomatoes and Peppers)	High Pressure Sodium	1.7	68.8	1,100 W
Vegetative Growth	Metal Halide	1.25 <sup>76</sup>	40	640 W
Microgreens <sup>77</sup>	T5 HO Fixture	0.84 <sup>78</sup>	22.4	358 W

<sup>72</sup> Design Light Consortium – Horticultural Lighting, Testing and Reporting Requirements for LED-Based Horticultural Lighting, version 1.1, effective March 6, 2019. To date, all horticultural lamps certified by the DLC specification are LEDs.

<sup>73</sup> Erik Runkle and Bruce Bugbee “Plant Lighting Efficiency and Efficacy:  $\mu\text{mols per joule}$ ”. Accessed 4/21/2020.

<sup>74</sup> Jesse Remillard and Nick Collins, “Trends and Observations of Energy Use in the Cannabis Industry,” ACEEE, accessed April 17, 2020. Baseline watts per square foot were taken by using typical fixture technology by crop type and dividing by 16 sqft per fixture (a 4’x4’ area is a typical coverage amount for one grow light fixture).

<sup>75</sup> Jesse Remillard and Nick Collins, “Trends and Observations of Energy Use in the Cannabis Industry,” ACEEE, accessed April 17, 2020. Baseline watts per square foot were taken by using typical fixture technology by crop type and dividing by 16 sqft per fixture (a 4’x4’ area is a typical coverage amount for one grow light fixture).

<sup>76</sup> Jacob A. Nelson, Bruce Bugbee, “Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures.” Utah State University. Accessed 5/6/2020.

<sup>77</sup> Microgreens T5 fixture is based on a 6-lamp high output fixture, based on program experience.

<sup>78</sup> Jacob A. Nelson, Bruce Bugbee, “Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures.” Utah State University. Accessed 5/6/2020.

Crop Type	Baseline Technology Type	Baseline PPE ( $\mu\text{mol}/\text{J}$ ) <sup>73</sup>	Baseline Watts per Square Foot <sup>74</sup>	Baseline Fixture Wattage <sup>75</sup>
Propagation <sup>79</sup>	T5 HO Fixture	0.84 <sup>80</sup>	14.6	234 W
Medical Cannabis – Flowering Stage	High Pressure Sodium	1.7	68.8	1,100 W
Recreational Cannabis – Flowering Stage	HID/LED/Other	2.2 <sup>81</sup>	36	576 W <sup>82</sup>

Cannabis cultivation facilities have a separate equipment definition due to Illinois legislation.<sup>83</sup> See cannabis cultivation code from “Cannabis Regulation and Tax Act, Illinois HB 1438:

*“The Lighting Power Densities (LPD) for cultivation space commits to not exceed an average of 36 watts per gross square foot of active and growing space canopy, or all installed lighting technology shall meet a photosynthetic photon efficacy (PPE) of no less than 2.2 micromoles per joule fixture and shall be featured on the Design Lights Consortium (DLC) Horticultural Specification Qualified Products List (QPL).”*

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is 9.5 years (average rated life of 50,000 hours).<sup>84</sup>

**DEEMED MEASURE COST**

LED Fixture Costs:<sup>85</sup>

- ≤ 250 Watts = \$ 325.87 per fixture
- > 250 Watts = \$ 535.04 per fixture

**LOADSHAPE**

- Loadshape C65 – Non-Residential Indoor Agriculture Vegetative Room
- Loadshape C66 – Non-Residential Indoor Agriculture Flowering Room

**COINCIDENCE FACTOR**

- Summer coincidence factor for vegetative rooms = 0.95
- Summer coincidence factor for flowering rooms = 0.76

---

**Algorithm**

---

<sup>79</sup> Propagation T5 fixture is based on a 4-lamp high output fixture, based on program experience.  
<sup>80</sup> Jacob A. Nelson, Bruce Bugbee, “Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures.” Utah State University. Accessed 5/6/2020.  
<sup>81</sup> Recreational cannabis baseline PPE requirement is either 36 W/sqft or 2.2  $\mu\text{mol}/\text{J}$  and DLC listed. Per HB 1438.  
<sup>82</sup> Recreational cannabis baseline wattage was back calculated using 36 W/sqft and 16 sqft coverage area to get 576 W per fixture.  
<sup>83</sup> Illinois legislation Public Act 101-0027 the Cannabis Regulation and Tax Act, Article 20: Adult Use Cultivation Centers, (Section 20-15 (a) (23) a commitment to a technology standard for resource efficiency of the cultivation center facility (B) Lighting)  
<sup>84</sup> Based on 50,000 hours lifetime and 5,250 hours per year of use (average hours of use per year using flowering and vegetative rooms).  
<sup>85</sup> Focus on Energy Evaluation Business Programs: Measure Life Study Final Report: August 25, 2009

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Grow Space Square Footage Method:

$$\Delta kWh = ((W/sqft_{BASE} - W/sqft_{EE})/1000) \times Area \times Hours \times WHF_e$$

Per Fixture Method:

$$\Delta kWh = ((Watts_{BASE} - Watts_{EE})/1000) \times Hours \times WHF_e$$

Where:

$W/sqft_{BASE}$  = Baseline wattage per square foot. If unknown, typical baseline watts per square feet by crop type can be found in the baseline equipment definition.

$$W/sqft_{BASE} = Watts_{BASE}/Fixture\ Area$$

$Watts_{BASE}$  = Baseline fixture wattage, see typical baseline wattages by crop type in baseline equipment definition.

$W/sqft_{EE}$  = Efficient wattage per square foot  
= Actual

$$W/sqft_{EE} = Watts_{EE}/Area$$

$Watts_{EE}$  = Efficient fixture wattage.

Fixture Area = Square footage of grow canopy covered by one fixture.  
= 16 sqft.<sup>86</sup>

Area = Illuminated area in square feet of active and growing space canopy  
= Actual.

Hours = Annual operating hours. See table below for typical hours of operation breakdown by crop type.

Crop Types	Hours of Operation per Day <sup>87</sup>	Annual Hours of Operation <sup>88</sup>
Flowering Crops (Tomatoes/Peppers)	12	4,200
Vegetative/Propagation Growth	18	6,300
Microgreens	18	6,300
Medical Cannabis – Flower Stage	12	4,200
Recreational Cannabis – Flowering Stage	12	4,200

<sup>86</sup> Assumes a 4' x 4' canopy

<sup>87</sup> Sole-Source Lighting of Plants. Technically Speaking by Erik Runkle. Michigan State University Extension. September 2017. Accessed: 7/29/2019.

<sup>88</sup> Annual hours of operation were found by multiplying hours per day by 350 operating days per year. Assuming 5 crop cycles with 3 days of downtime between each cycle

WHFe = 1.21<sup>89</sup>  
 1000 = Watts to kW conversion factor

**Heating Penalty**

If electrically heated building:

Grow Space Square Footage Method

$$\Delta kWh_{heat\ penalty}^{90} = ((W/sqft_{BASE} - W/sqft_{EE})/1000) \times Area \times Hours \times -IFkWh$$

Per Fixture Method:

$$\Delta kWh_{heat\ penalty} = ((Watts_{BASE} - Watts_{EE})/1000) \times Hours \times -IFkWh$$

Where:

IFkWh = 0 if gas heating, 0.284 if electric resistance heating, 0.124 if electric heat pump heating; lighting-HVAC Interactive Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Grow Space Square Footage Method:

$$\Delta kW = ((W/sqft_{BASE} - W/sqft_{EE})/1000) \times Area \times CF \times WHF_d$$

Per Fixture Method:

$$\Delta kW = ((Watts_{BASE} - Watts_{EE})/1000) \times CF \times WHF_d$$

Where:

WHF<sub>d</sub> = 1.22 if cooling or 1.00 if none; waste heat factor for demand to account for cooling savings from efficient lighting in cooled buildings.  
 CF = 0.95 for vegetative crops or 0.76 for flowering crops

**NATURAL GAS SAVINGS**

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

Grow Space Square Footage Method:

$$\Delta Therms = ((W/sqft_{BASE} - W/sqft_{EE})/1000) \times Area \times Hours \times -IFTtherms$$

Per Fixture Method:

$$\Delta Therms = ((Watt_{BASE} - Watt_{EE})/1000) \times Hours \times -IFTtherms$$

Where:

---

<sup>89</sup> Waste heat factor for cooling savings calculation can be found in the Indoor Agriculture Loadshapes excel file.

<sup>90</sup> Negative value because this is an increase in heating consumption due to the efficient lighting

IFTherms = 0.043 if gas heating, 0 if other heating; lighting-HVAC Interactive Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient.

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Any costs associated with moving the LED lighting fixture to different heights throughout the different growing phases should also be included as an O&M consideration.

**MEASURE CODE: CI-AGE-GROW-V02-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.1.12 Swine Heat Pads

### DESCRIPTION

This measure applies to the large Commercial and Industrial sector, specifically for the agriculture industry. Swine farmers will typically keep their newborn piglets alongside their mothers (sows) for up to three to four weeks until they gain sufficient weight and can be moved to a nursery barn. During this farrowing stage, the piglets must be kept at temperatures ranging from 32 to 35°C (90 to 95°F). A sow and her piglets are kept in private farrowing crates, where the sow is kept in a separate and railed cage. This allows the piglets to still suckle from their mother and keeps the sow from crushing her piglets. These farrowing crates can be arranged in single or double systems. Typically, farmers will utilize a heat lamp as the primary heating source for these piglets, which can range from 125 W to 250 W and have an average measure life of 5,000 hours. More energy efficient technology has emerged in the form of heated mats. These mats require significantly less energy than a traditional heat lamp and have no known negative impacts on piglet health. Heating mats come in two options, single (typically rated at ≤100W) or double (typically rated at ≤200W) mats. Single mats serve one litter, and double mats serve two litters.

### DEFINITION OF EFFICIENT EQUIPMENT

The use of heat mats in swine farrowing will result in electrical savings for the customer. Research has also shown that newborn piglets do not prefer mat heating over lamp heating, but as they grow, they tend to prefer mat heating. Applied research in large industrial settings found no significant differences between lamp and mat heating on the behavior and well-being of piglets. Therefore, the only difference to note between the two methods is the energy saved in using heating mats.

### DEFINITION OF BASELINE EQUIPMENT

The baseline measure for swine farrowing heating is heat lamps, typically ranging from 125 to 250 Watts. Most studies conducted on swine farrowing heat lamps have used 125 watt or 175 watt lamps per litter.<sup>91,92</sup>

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life of a farrowing heat mat is 5 years.<sup>93</sup>

### DEEMED MEASURE COST

Heat mat prices will vary somewhat with size but a typical single mat costs \$125 and double mat costs \$250.<sup>94</sup> Additional costs can be incurred if a thermostat controller is included, these vary widely depending on controller complexity.

### LOADSHAPE

Loadshape C04 - Non-Residential Electric Heating

### COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.018.<sup>95</sup>

---

### Algorithm

---

<sup>91</sup>Zhang, Q. and H. Xin, "Responses of Piglets to Creep heat Type and Location in Farrowing Crate," Applied Engineering in Agriculture (2001): Vol. 17(4) 515-519

<sup>92</sup> "Research at Puratone Confirms Effectiveness and Extensive Energy Savings of Heat Pads," Manitoba Hydro Power Smart

<sup>93</sup> Professional judgement based on Iowa Energy Efficiency Statewide Technical Reference Manual 2018 Volume 3: Nonresidential Measures, Agriculture Equipment: 3.1.9 Heat Mat, Posted July 12<sup>th</sup>, 2017

<sup>94</sup> Hog Slat. (2019). Heat Pad. Online pricing catalogue for agriculture and livestock equipment.

<sup>95</sup> Coincidence factor is taken from the IL TRM loadshape C04 – Non-residential Electric Loadshape.

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$kWh_{saved} = kWh_{base} - kWh_{EE}$$

$$kWh_{base} = \frac{Crates_{total} \times Hours \times Fixture_{crate} \times Lamp_{fixture} \times Wattage_{lamp}}{1000 \frac{Watts}{kW}}$$

$$kWh_{EE} = \frac{Hours \times (Mats_{single} \times Wattage_{single} + Mats_{double} \times Wattage_{double})}{1000 \frac{Watts}{kW}}$$

Where:

$$Crates_{total} = (Crates_{single-row} + Crates_{double-row}) \times Rows \times Rooms$$

$$Mats_{Single} = Crates_{single-row} \times Rows \times Rooms$$

$$Mats_{Double} = Crates_{double-row} \times Rows \times Rooms$$

- Crates<sub>total</sub> = Number of Farrowing Crates
- Crates<sub>single-row</sub> = Number of single crates in a row
- Crates<sub>double-row</sub> = Number of double crates in a row
- Rows = Number of rows in a room
- Rooms = Number of rooms in a farrowing barn
- Mats<sub>single</sub> = Number of single mats
- Mats<sub>double</sub> = Number of double mats
- Wattage<sub>single</sub> = Default 100W; Wattage of a single heat mat
- Wattage<sub>double</sub> = Default 200W; Wattage of a double heat mat
- Hours = Default 5,105 hours;<sup>96</sup> Annual hours of operation
- Fixture<sub>crate</sub> = Number of heat lamp fixtures per farrowing crate
- Lamp<sub>fixture</sub> = Number of heat lamps per fixture
- Wattage<sub>lamp</sub> = Default 125W or 175W; Heat lamp wattage

**DEFAULT SAVINGS FOR SINGLE UNIT REPLACEMENT**

<sup>96</sup> While heat mat hours do vary from heat lamps slightly, the savings assumptions match heat lamp hours for consistency. Calculation method from Iowa State University farm manager (Ben Drescher): "At minimum I'd say they are on 24-7 from Oct-March and March-May, and 12 hours a day June-September 8 hours a day. You'd also take off for power washing etc. so if you had a 24 day turn in a farrowing room you'd run them for 21 days and turn the room subtract 3 days from x 15 turns a year - resulting in 5120 hours." Cadmus did not round data and estimated 5,105 hours. Email sent 10/23/15. "FW: Heat lamp bulbs". Itron benchmarked the HOU with their own analysis which resulted in 5,109 hours: 30.42 days/month; 3 months (summer) run 33% of time; 6 months run 50% of time; 3 months (winter) run full time.

Replacement Type	Baseline Heat Lamp	Annual kWh Savings
Single Mat replacing one Heat Lamp	125W	127.6
Double Mat replacing two Heat Lamps		255.3
Single Mat replacing one Heat Lamp	175W	382.9
Double Mat replacing two Heat Lamps		765.8

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$kW_{Saved} = (kWh_{Saved}/Hours) \times CF$$

Where:

kWh<sub>Saved</sub> = kWh savings, see above equation and table.

Hours = Operating hours, 5,105.

CF = Coincidence Factor, 0.018.<sup>97</sup>

**DEFAULT SAVINGS FOR SINGLE UNIT REPLACEMENT**

Replacement Type	Baseline Heat Lamp	Peak kW Savings
Single Mat replacing one Heat Lamp	125W	0.0005
Double Mat replacing two Heat Lamps		0.0009
Single Mat replacing one Heat Lamp	175W	0.0014
Double Mat replacing two Heat Lamps		0.0027

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Approximately 1% of mats are likely to be damaged by swine each year and require full replacement.

Additionally, depending on the flooring, some mats may become loose on steel slated floors. This can be prevented by buying mats that have a channel or groove where it sits in the partition. Another option is to buy tie down clips that cost approximately \$24 per double mat.<sup>98</sup>

<sup>97</sup> Coincidence factor is taken from the IL TRM loadshape C04 – Non-residential Electric Loadshape.

<sup>98</sup> Franklin Energy field experience



The NPV for replacement heat lamps and annual levelized replacement costs using the societal real discount rate of 0.42% are presented below. The O&M cost adjustments are based on a 1-year measure life for heat lamps and a 5-year analysis period for heat pads. The measure life assumptions indicate an annual lamp replacement cost for the baseline equipment. The heat lamp replacement cost is assumed to be \$5.50.<sup>99</sup>

Replacement Type	NPV of replacement costs for period	Levelized annual replacement cost savings
Single Mat replacing one Heat Lamp	\$21.78	\$4.41
Double Mat replacing two Heat Lamps	\$43.56	\$8.82

**MEASURE CODE: CI-AGE-HPAD-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>99</sup> The cost of a replacement heat lamp bulb is sourced from an average of available products via online pricing for agriculture equipment and heat lamps. For more information on the cost of a heat lamp and the derivation of O&M cost savings, please see: "Swine Heat Pads\_OM.xlsx".

## 4.2 Food Service Equipment End Use

### 4.2.1 Combination Oven

#### DESCRIPTION

This measure applies to both natural gas fired and electric high efficiency combination convection and steam ovens installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the installed equipment must be a new natural gas or electric combination oven meeting the ENERGY STAR idle rate and cooking efficiency requirements as specified below.<sup>100</sup>

**ENERGY STAR Requirements (Version 2.1, Effective January 1, 2014)**

Fuel Type	Operation	Idle Rate (Btu/h for Gas, kW for Electric)	Cooking-Energy Efficiency, (%)
Natural Gas	Steam Mode	$\leq 200P+6,511$	$\geq 41$
	Convection Mode	$\leq 150P+5,425$	$\geq 56$
Electric	Steam Mode	$\leq 0.133P+0.6400$	$\geq 55$
	Convection Mode	$\leq 0.080P+0.4989$	$\geq 76$

Note: P = Pan capacity as defined in Section 1.S, of the Commercial Ovens Program Requirements Version 2.1<sup>101</sup>

#### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a natural gas or electric combination oven that is not ENERGY STAR certified.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>102</sup>

#### DEEMED MEASURE COST

The costs vary based on the efficiency and make of the equipment. Actual costs should be used.

#### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

#### COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>103</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46

<sup>100</sup> ENERGY STAR Commercial Ovens Key Product Criteria, version 2.2, effective October 7, 2015

<sup>101</sup> Ibid. Pan capacity is defined as the number of steam table pans the combination oven is able to accommodate as per the ASTM F-1495-05 standard specification.

<sup>102</sup> The measure life is sourced from the Food Service Technology Center’s energy savings calculator for combination ovens.

<sup>103</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985

Location	CF
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

The algorithm below applies to electric combination ovens only.<sup>104</sup>

$$\Delta kWh = (\Delta CookingEnergy_{ConvElec} + \Delta CookingEnergy_{SteamElec} + \Delta IdleEnergy_{ConvElec} + \Delta IdleEnergy_{SteamElec}) * Days / 1,000$$

Where:

$\Delta CookingEnergy_{ConvElec}$  = Change in total daily cooking energy consumed by electric oven in convection mode

$$= LB_{Elec} * (EFOOD_{ConvElec} / ElecEFF_{ConvBase} - EFOOD_{ConvElec} / ElecEFF_{ConvEE}) * \%_{Conv}$$

$\Delta CookingEnergy_{SteamElec}$  = Change in total daily cooking energy consumed by electric oven in steam mode

$$= LB_{Elec} * (EFOOD_{SteamElec} / ElecEFF_{SteamBase} - EFOOD_{SteamElec} / ElecEFF_{SteamEE}) * \%_{Steam}$$

$\Delta IdleEnergy_{ConvElec}$  = Change in total daily idle energy consumed by electric oven in convection mode

$$= [(ElecIDLE_{ConvBase} * ((HOURS - LB_{Elec}/ElecPC_{ConvBase}) * \%_{Conv})) - (ElecIDLE_{ConvEE} * ((HOURS - LB_{Elec}/ElecPC_{ConvEE}) * \%_{Conv}))]$$

$\Delta IdleEnergy_{SteamElec}$  = Change in total daily idle energy consumed by electric oven in convection mode

$$= [(ElecIDLE_{SteamBase} * ((HOURS - LB_{Elec}/ElecPC_{SteamBase}) * \%_{Steam})) - (ElecIDLE_{SteamEE} * ((HOURS - LB_{Elec}/ElecPC_{SteamEE}) * \%_{Steam}))]$$

Where:

$LB_{Elec}$  = Estimated mass of food cooked per day for electric oven (lbs/day)  
 = Custom, or if unknown, use 200 lbs (If P <15) or 250 lbs (If P >= 15)

$EFOOD_{ConvElec}$  = Energy absorbed by food product for electric oven in convection mode  
 = Custom or if unknown, use 73.2 Wh/lb

$ElecEFF$  = Cooking energy efficiency of electric oven  
 = Custom or if unknown, use values from table below

	Base	EE
$ElecEFF_{Conv}$	72%	76%

<sup>104</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator

	Base	EE
ElecEFF <sub>Steam</sub>	49%	55%

%<sub>Conv</sub> = Percentage of time in convection mode  
 = Custom or if unknown, use 50%

EFOOD<sub>SteamElec</sub> = Energy absorbed by food product for electric oven in steam mode  
 = Custom or if unknown, use 30.8 Wh/lb

%<sub>steam</sub> = Percentage of time in steam mode  
 = 1 - %<sub>conv</sub>

ElecIDLE<sub>Base</sub> = Idle energy rate (W) of baseline electric oven  
 = Custom or if unknown, use values from table below

Pan Capacity	Convection Mode (ElecIDLE <sub>ConvBase</sub> )	Steam Mode (ElecIDLE <sub>SteamBase</sub> )
< 15	1,320	5,260
> = 15	2,280	8,710

HOURS = Average daily hours of operation  
 = Custom or if unknown, use 12 hours

ElecPC<sub>Base</sub> = Production capacity (lbs/hr) of baseline electric oven  
 = Custom of if unknown, use values from table below

Pan Capacity	Convection Mode (ElecPC <sub>ConvBase</sub> )	Steam Mode (ElecPC <sub>SteamBase</sub> )
< 15	79	126
> = 15	166	295

ElecIDLE<sub>ConvEE</sub> = Idle energy rate of ENERGY STAR electric oven in convection mode  
 = (0.08\*P +0.4989)\*1000

ElecPC<sub>EE</sub> = Production capacity (lbs/hr) of ENERGY STAR electric oven  
 = Custom of if unknown, use values from table below

Pan Capacity	Convection Mode (ElecPC <sub>ConvEE</sub> )	Steam Mode (ElecPC <sub>SteamEE</sub> )
< 15	119	177
> = 15	201	349

ElecIDLE<sub>SteamEE</sub> = Idle energy rate of ENERGY STAR electric oven in steam mode  
 = (0.133\* P+0.64)\*1000

Days = Days of operation per year  
 = Custom or if unknown, use 365 days per year

1,000 = Wh to kWh conversion factor

**For example**, a 10-pan capacity electric combination oven would save:

$$\begin{aligned} \Delta kWh &= (\Delta CookingEnergy_{ConvElec} + \Delta CookingEnergy_{SteamElec} + \Delta IdleEnergy_{ConvElec} + \Delta IdleEnergy_{SteamElec}) * \\ &\quad \text{Days} / 1,000 \\ \Delta CookingEnergy_{ConvElec} &= 200 * (73.2 / 0.72 - 73.2 / 0.76) * 0.50 \\ &= 535 \text{ Wh} \\ \Delta CookingEnergy_{SteamElec} &= 200 * (30.8 / 0.49 - 30.8 / 0.55) * (1 - 0.50) \\ &= 686 \text{ Wh} \\ \Delta IdleEnergy_{ConvElec} &= [(1,320 * ((12 - 200/79) * 0.50)) - (1,299 * ((12 - 200/119) * 0.50))] \\ &= -453 \text{ Wh} \\ \Delta IdleEnergy_{SteamElec} &= [(5,260 * ((12 - 200/126) * (1 - 0.50))) - (1,970 * ((12 - 200/177) * (1 - \\ &\quad 0.50)))] \\ &= 16,678 \text{ Wh} \\ \Delta kWh &= (535 + 686 + -453 + 16,678) * 365 / 1,000 \\ &= 6,368 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / (\text{HOURS} * \text{DAYS}) * CF$$

Where:

CF = Summer peak coincidence factor is dependent on building type:<sup>105</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

All other variables as defined above.

**For example**, a 10-pan capacity electric combination oven in a Full Service Limited Menu restaurant would save:

$$\begin{aligned} \Delta kW &= \Delta kWh / (\text{HOURS} * \text{DAYS}) * CF \\ &= 6,368 / (12 * 365) * 0.51 \\ &= 0.74 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

The algorithm below applies to natural gas combination ovens only.<sup>106</sup>

<sup>105</sup>Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985

<sup>106</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator

$$\Delta\text{Therms} = (\Delta\text{CookingEnergy}_{\text{ConvGas}} + \Delta\text{CookingEnergy}_{\text{SteamGas}} + \Delta\text{IdleEnergy}_{\text{ConvGas}} + \Delta\text{IdleEnergy}_{\text{SteamGas}}) * \text{Days} / 100,000$$

Where:

$\Delta\text{CookingEnergy}_{\text{ConvGas}}$  = Change in total daily cooking energy consumed by gas oven in convection mode

$$= \text{LB}_{\text{Gas}} * (\text{EFOOD}_{\text{ConvGas}} / \text{GasEFF}_{\text{ConvBase}} - \text{EFOOD}_{\text{ConvGas}} / \text{GasEFF}_{\text{ConvEE}}) * \%_{\text{Conv}}$$

$\Delta\text{CookingEnergy}_{\text{SteamGas}}$  = Change in total daily cooking energy consumed by gas oven in steam mode

$$= \text{LB}_{\text{Gas}} * (\text{EFOOD}_{\text{SteamGas}} / \text{GasEFF}_{\text{SteamBase}} - \text{EFOOD}_{\text{SteamGas}} / \text{GasEFF}_{\text{SteamEE}}) * \%_{\text{Steam}}$$

$\Delta\text{IdleEnergy}_{\text{ConvGas}}$  = Change in total daily idle energy consumed by gas oven in convection mode

$$= [(\text{GasIDLE}_{\text{ConvBase}} * ((\text{HOURS} - \text{LB}_{\text{Gas}} / \text{GasPC}_{\text{ConvBase}}) * \%_{\text{Conv}})) - (\text{GasIDLE}_{\text{ConvEE}} * ((\text{HOURS} - \text{LB}_{\text{Gas}} / \text{GasPC}_{\text{ConvEE}}) * \%_{\text{Conv}}))]$$

$\Delta\text{IdleEnergy}_{\text{SteamGas}}$  = Change in total daily idle energy consumed by gas oven in convection mode

$$= [(\text{GasIDLE}_{\text{SteamBase}} * ((\text{HOURS} - \text{LB}_{\text{Gas}} / \text{GasPC}_{\text{SteamBase}}) * \%_{\text{Steam}})) - (\text{GasIDLE}_{\text{SteamEE}} * ((\text{HOURS} - \text{LB}_{\text{Gas}} / \text{GasPC}_{\text{SteamEE}}) * \%_{\text{Steam}}))]$$

Where:

$\text{LB}_{\text{Gas}}$  = Estimated mass of food cooked per day for gas oven (lbs/day)

= Custom, or if unknown, use 200 lbs (If  $P < 15$ ), 250 lbs (If  $15 \leq P < 30$ ), or 400 lbs (If  $P \geq 30$ )

$\text{EFOOD}_{\text{ConvGas}}$  = Energy absorbed by food product for gas oven in convection mode

= Custom or if unknown, use 250 Btu/lb

$\text{GasEFF}$  = Cooking energy efficiency of gas oven

= Custom or if unknown, use values from table below

	Base	EE
$\text{GasEFF}_{\text{Conv}}$	52%	56%
$\text{GasEFF}_{\text{Steam}}$	39%	41%

$\text{EFOOD}_{\text{SteamGas}}$  = Energy absorbed by food product for gas oven in steam mode

= Custom or if unknown, use 105 Btu/lb

$\text{GasIDLE}_{\text{Base}}$  = Idle energy rate (Btu/hr) of baseline gas oven

= Custom or if unknown, use values from table below

Pan Capacity	Convection Mode ( $\text{GasIDLE}_{\text{ConvBase}}$ )	Steam Mode ( $\text{GasIDLE}_{\text{SteamBase}}$ )
< 15	8,747	18,656
15-30	10,788	24,562
>30	13,000	43,300

$\text{GasPC}_{\text{Base}}$  = Production capacity (lbs/hr) of baseline gas oven

= Custom of if unknown, use values from table below

Pan Capacity	Convection Mode (GasPC <sub>ConvBase</sub> )	Steam Mode (GasPC <sub>SteamBase</sub> )
< 15	125	195
15-30	176	211
>30	392	579

GasIDLE<sub>ConvEE</sub> = Idle energy rate of ENERGY STAR gas oven in convection mode  
 = 150 \* P + 5,425

GasPC<sub>EE</sub> = Production capacity (lbs/hr) of ENERGY STAR gas oven  
 = Custom of if unknown, use values from table below

Pan Capacity	Convection Mode (GasPC <sub>ConvEE</sub> )	Steam Mode (GasPC <sub>SteamEE</sub> )
< 15	124	172
15-30	210	277
>30	394	640

GasIDLE<sub>SteamEE</sub> = Idle energy rate of ENERGY STAR gas oven in steam mode  
 = 200 \* P + 6511

100,000 = Conversion factor from Btu to therms

All other variables as defined above.

**For example**, a 10-pan capacity gas combination oven would save:

$$\Delta \text{Therms} = (\Delta \text{CookingEnergy}_{\text{ConvGas}} + \Delta \text{CookingEnergy}_{\text{SteamGas}} + \Delta \text{IdleEnergy}_{\text{ConvGas}} + \Delta \text{IdleEnergy}_{\text{SteamGas}}) * \text{Days} / 100,000$$

$$\Delta \text{CookingEnergy}_{\text{ConvGas}} = 200 * (250 / 0.52 - 250 / 0.56) * 0.50 = 3,434 \text{ therms}$$

$$\Delta \text{CookingEnergy}_{\text{SteamGas}} = 200 * (105 / 0.39 - 105 / 0.41) * (1 - 0.50) = 1,313 \text{ therms}$$

$$\Delta \text{IdleEnergy}_{\text{ConvGas}} = [(8,747 * ((12 - 200/125) * 0.50)) - (6,925 * ((12 - 200/124) * 0.50))] = 9,519 \text{ therms}$$

$$\Delta \text{IdleEnergy}_{\text{SteamGas}} = [(18,658 * ((12 - 200/195) * (1 - 0.50))) - (8,511 * ((12 - 200/172) * (1 - 0.50)))] = 56,251 \text{ therms}$$

$$\Delta \text{Therms} = (3,434 + 1,313 + 9,519 + 56,251) * 365 / 100,000 = 257 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-CBOV-V02-160601**

**REVIEW DEADLINE: 1/1/2023**



## 4.2.2 Commercial Solid and Glass Door Refrigerators & Freezers

### DESCRIPTION

This measure relates to the installation of a new reach-in commercial refrigerator or freezer meeting ENERGY STAR efficiency standards. ENERGY STAR labeled commercial refrigerators and freezers are more energy efficient because they are designed with components such as ECM evaporator and condenser fan motors, hot gas anti-sweat heaters, or high-efficiency compressors, which will significantly reduce energy consumption.

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a new ENERGY STAR certified vertical closed solid or glass door refrigerator or freezer meeting energy consumptions requirements as determined by door type (solid or glass) and refrigerated volume (V).

#### ENERGY STAR Requirements (Version 4.0, Effective March 27, 2017)

Volume (ft <sup>3</sup> )	Maximum Daily Energy Consumption (kWh/day)	
	Refrigerator	Freezer
<b>Vertical Closed</b>		
<b>Solid Door</b>		
0 < V < 15	≤ 0.022V + 0.97	≤ 0.21V + 0.9
15 ≤ V < 30	≤ 0.066V + 0.31	≤ 0.12V + 2.248
30 ≤ V < 50	≤ 0.04V + 1.09	≤ 0.285V - 2.703
V ≥ 50	≤ 0.024V + 1.89	≤ 0.142V + 4.445
<b>Glass Door</b>		
0 < V < 15	≤ 0.095V + 0.445	≤ 0.232V + 2.36
15 ≤ V < 30	≤ 0.05V + 1.12	
30 ≤ V < 50	≤ 0.076V + 0.34	
V ≥ 50	≤ 0.105V - 1.111	

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a new vertical closed solid or glass door refrigerator or freezer that is not ENERGY STAR certified.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>107</sup>

### DEEMED MEASURE COST

The incremental capital cost per cubic foot of chilled or frozen compartment volume for this measure is provided below.<sup>108</sup>

Equipment Type	Incremental Cost per Cubic Foot (ft <sup>3</sup> )
Solid Door	

<sup>107</sup>2008 Database for Energy-Efficiency Resources (DEER), Version 2008.2.05, "Effective/Remaining Useful Life Values", California Public Utilities Commission, December 16, 2008.

<sup>108</sup> Incremental costs are based on the Northwest Regional Technical Forum, ENERGY STAR Version 4.0 Analysis. For cost calculation details, see the CostData&Analysis tab within the file Commercial Refrigerators & Freezers\_Costs\_Nov 2017.xlsm.

Equipment Type	Incremental Cost per Cubic Foot (ft <sup>3</sup> )
Refrigerator	\$24.21
Freezer	\$30.41
<b>Glass Door</b>	
Refrigerator	\$24.77
Freezer	\$33.01

**LOADSHAPE**

Loadshape C23 - Commercial Refrigeration

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is assumed to be 0.937.<sup>109</sup>

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (kWh_{base} - kWh_{e}) * 365.25$$

Where:

kWh<sub>base</sub> = baseline maximum daily energy consumption in kWh

= calculated using actual chilled or frozen compartment volume (V) of the efficient unit as shown in the table below.

Type	kWh <sub>base</sub> <sup>110</sup>
Solid Door Refrigerator	0.05 * V + 1.36
Glass Door Refrigerator	0.1 * V + 0.86
Solid Door Freezer	0.22 * V + 1.38
Glass Door Freezer	0.29 * V + 2.95

kWh<sub>e</sub><sup>111</sup> = efficient maximum daily energy consumption in kWh

= calculated using actual chilled or frozen compartment volume (V) of the efficient unit as shown in the table below.

Volume (ft <sup>3</sup> )	kWh <sub>e</sub>	
	Refrigerator	Freezer
<b>Vertical Closed</b>		
<b>Solid Door</b>		
0 < V < 15	≤ 0.022V + 0.97	≤ 0.21V + 0.9
15 ≤ V < 30	≤ 0.066V + 0.31	≤ 0.12V + 2.248
30 ≤ V < 50	≤ 0.04V + 1.09	≤ 0.285V - 2.703
V ≥ 50	≤ 0.024V + 1.89	≤ 0.142V + 4.445

<sup>109</sup> The CF for Commercial Refrigeration was calculated based upon the Ameren provided eShapes

<sup>110</sup> [Federal](#) standards for equipment manufactured on or after March 27, 2017: 10 CFR §431.66 - Energy Conservation Standards for Commercial Refrigerators, Freezers and Refrigerator-Freezers.

<sup>111</sup> ENERGY STAR Program Requirements for Commercial Refrigerators and Freezers Partner Commitments Version 4.0, effective March 27, 2017

Volume (ft <sup>3</sup> )	kW <sub>hee</sub>	
	Refrigerator	Freezer
<b>Glass Door</b>		
0 < V < 15	≤ 0.095V + 0.445	≤ 0.232V + 2.36
15 ≤ V < 30	≤ 0.05V + 1.12	
30 ≤ V < 50	≤ 0.076V + 0.34	
V ≥ 50	≤ 0.105V – 1.111	

V = the chilled or frozen compartment volume (ft<sup>3</sup>) (as defined in the Association of Home Appliance Manufacturers Standard HRF1–1979)

= Actual installed

365.25 = days per year

For example, a solid door refrigerator with a volume of 15 would save

$$\Delta kWh = (2.11 - 1.30) * 365.25$$

$$= 296 kWh$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / HOURS * CF$$

Where:

HOURS = equipment is assumed to operate continuously, 24 hours per day, 365.25 days per year.  
= 8766

CF = Summer Peak Coincidence Factor for measure  
= 0.937

**For example**, a solid door refrigerator with a volume of 15 would save

$$\Delta kW = 296 / 8766 * .937$$

$$= 0.0316 kW$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-CSDO-V02-190101**

**REVIEW DEADLINE: 1/1/2024**

### 4.2.3 Commercial Steam Cooker

#### DESCRIPTION

To qualify for this measure the installed equipment must be an ENERGY STAR® steamer in place of a standard steamer in a commercial kitchen. Savings are presented dependent on the pan capacity and corresponding idle rate at heavy load cooking capacity and if the steamer is gas or electric.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be as follows:

Gas	Electric
ENERGY STAR® qualified with 38% minimum cooking energy efficiency at heavy load (potato) cooking capacity for gas steam cookers.	ENERGY STAR® qualified with 50% minimum cooking energy efficiency at heavy load (potato) cooking capacity for electric steam cookers.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a non-ENERGY STAR® commercial steamer at end of life. It is assumed that the efficient equipment and baseline equipment have the same number of pans.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>112</sup>

#### DEEMED MEASURE COST

The incremental capital cost for this measure is \$998 for a natural gas steam cooker<sup>113</sup> or \$2490 for an electric steam cooker.<sup>114</sup>

#### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

#### COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>115</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36

<sup>112</sup>California DEER 2008 which is also used by both the Food Service Technology Center and ENERGY STAR®.

<sup>113</sup>Source for incremental cost for efficient natural gas steamer is RSG Commercial Gas Steamer Workpaper, January 2012.

<sup>114</sup>Source for efficient electric steamer incremental cost is \$2,490 per 2009 PG&E Workpaper - PGECOFST104.1 - Commercial Steam Cooker - Electric and Gas as reference by KEMA in the ComEd C & I TRM.

<sup>115</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985. Unknown is an average of other location types

Location	CF
Cafeteria	0.39
Unknown	0.41

**Algorithm**

**CALCULATION OF SAVINGS**

Formulas below are applicable to both gas and electric steam cookers. Please use appropriate lookup values and identified flags.

**ENERGY SAVINGS**

$$\Delta\text{Savings} = (\Delta\text{Idle Energy} + \Delta\text{Preheat Energy} + \Delta\text{Cooking Energy}) * Z$$

For a gas cooker:  $\Delta\text{Savings} = \Delta\text{Btu} * 1/100,000 * Z$

For an electric steam cooker:  $\Delta\text{Savings} = \Delta\text{kWh} * Z$

Where:

Z = days/yr steamer operating (use 365.25 days/yr if heavy use restaurant and exact number unknown)

$$\Delta\text{Idle Energy} = (((1 - \text{CSM}_{\%Baseline}) * \text{IDLE}_{BASE} + \text{CSM}_{\%Baseline} * \text{PC}_{BASE} * E_{FOOD} / \text{EFF}_{BASE}) * (\text{HOURS}_{day} - (F / \text{PC}_{BASE}) - (\text{PRE}_{number} * 0.25))) - (((1 - \text{CSM}_{\%ENERGYSTAR}) * \text{IDLE}_{ENERGYSTAR} + \text{CSM}_{\%ENERGYSTAR} * \text{PC}_{ENERGY} * E_{FOOD} / \text{EFF}_{ENERGYSTAR}) * (\text{HOURS}_{Day} - (F / \text{PC}_{ENERGY}) - (\text{PRE}_{number} * 0.25))))$$

Where:

$\text{CSM}_{\%Baseline}$  = Baseline Steamer Time in Manual Steam Mode (% of time)  
= 90%<sup>116</sup>

$\text{IDLE}_{Base}$  = Idle Energy Rate of Base Steamer<sup>117</sup>

Number of Pans	IDLE <sub>BASE</sub> - Gas, Btu/hr	IDLE <sub>BASE</sub> - Electric, kw
3	11,000	1.0
4	14,667	1.33
5	18,333	1.67
6	22,000	2.0

$\text{PC}_{Base}$  = Production Capacity of Base Steamer<sup>118</sup>

Number of Pans	PC <sub>BASE, gas</sub> (lbs/hr)	PC <sub>BASE, electric</sub> (lbs/hr)
3	65	70
4	87	93
5	108	117

<sup>116</sup>Food Service Technology Center 2011 Savings Calculator

<sup>117</sup>Food Service Technology Center 2011 Savings Calculator

<sup>118</sup>Production capacity per Food Service Technology Center 2011 Savings Calculator of 23.3333 lb/hr per pan for electric baseline steam cookers and 21.6667 lb/hr per pan for natural gas baseline steam cookers. ENERGY STAR® savings calculator uses 23.3 lb/hr per pan for both electric and natural gas baseline steamers.

Number of Pans	PC <sub>BASE, gas</sub> (lbs/hr)	PC <sub>BASE, electric</sub> (lbs/hr)
6	130	140

E<sub>FOOD</sub>= Amount of Energy Absorbed by the food during cooking known as ASTM Energy to Food (Btu/lb or kW/lb)

=105 Btu/lb (gas steamers) or 0.0308 (electric steamers)<sup>119</sup>

EFF<sub>BASE</sub> =Heavy Load Cooking Efficiency for Base Steamer

=15% (gas steamers) or 26% (electric steamers)<sup>120</sup>

HOURS<sub>day</sub> = Average Daily Operation (hours)

Type of Food Service	Hours <sub>day</sub> <sup>121</sup>
Fast Food, limited menu	4
Fast Food, expanded menu	5
Pizza	8
Full Service, limited menu	8
Full Service, expanded menu	7
Cafeteria	6
Unknown	6 <sup>122</sup>
Custom	Varies

F = Food cooked per day (lbs/day)

= custom or if unknown, use 100 lbs/day<sup>123</sup>

CSM<sub>%ENERGYSTAR</sub> = ENERGY STAR Steamer's Time in Manual Steam Mode (% of time)<sup>124</sup>

= 0%

IDLE<sub>ENERGYSTAR</sub> = Idle Energy Rate of ENERGY STAR<sup>®125</sup>

Number of Pans	IDLE <sub>ENERGY STAR – gas</sub> (Btu/hr)	IDLE <sub>ENERGY STAR – electric</sub> (kW)
3	6,250	0.40
4	8,333	0.53
5	10,417	0.67
6	12,500	0.80

<sup>119</sup>ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculations

<sup>120</sup>Reference Food Service Technology Center 2011 Savings Calculator values as used by Consortium for Energy Efficiency, Inc. for baseline electric and natural gas steamer heavy cooking load energy efficiencies.

<sup>121</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985.

<sup>122</sup>Unknown is average of other locations

<sup>123</sup>Reference amount used by both Food Service Technology Center and ENERGY STAR<sup>®</sup> savings calculator

<sup>124</sup>Reference information from the Food Service Technology Center siting that ENERGY STAR<sup>®</sup> steamers are not typically operated in constant steam mode, but rather are used in timed mode. Reference ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculation. Both baseline & efficient steamer mode values should be considered for users in Illinois market.

<sup>125</sup>Food Service Technology Center 2011 Savings Calculator.

$PC_{ENERGY}$  = Production Capacity of ENERGY STAR® Steamer<sup>126</sup>

Number of Pans	$PC_{ENERGY}$ - gas(lbs/hr)	$PC_{ENERGY}$ – electric (lbs/hr)
3	55	50
4	73	67
5	92	83
6	110	100

$EFF_{ENERGYSTAR}$  = Heavy Load Cooking Efficiency for ENERGY STAR® Steamer(%)  
 =38% (gas steamer) or 50% (electric steamer)<sup>127</sup>

$PRE_{number}$  = Number of preheats per day  
 =1<sup>128</sup> (if unknown, use 1)

$$\Delta Preheat Energy = ( PRE_{number} * \Delta Pre_{heat} )$$

Where:

$PRE_{number}$  = Number of Preheats per Day  
 =1<sup>129</sup> (if unknown, use 1)

$PRE_{heat}$  = Preheat energy savings per preheat  
 = 11,000 Btu/preheat (gas steamer)<sup>130</sup> or 0.5 kWh/preheat (electric steamer)<sup>131</sup>

$$\Delta Cooking Energy = ((1/ EFF_{BASE}) - (1/ EFF_{ENERGY STAR})) * F * E_{FOOD}$$

Where:

$EFF_{BASE}$  =Heavy Load Cooking Efficiency for Base Steamer  
 =15% (gas steamer) or 26% (electric steamer)<sup>132</sup>

$EFF_{ENERGYSTAR}$  =Heavy Load Cooking Efficiency for ENERGY STAR® Steamer  
 =38% (gas steamer) or 50% (electric steamer)<sup>133</sup>

F = Food cooked per day (lbs/day)

<sup>126</sup>Production capacity per Food Service Technology Center 2011 Savings Calculator of 18.3333 lb/hr per pan for gas ENERGY STAR® steam cookers and 16.6667 lb/hr per pan for electric ENERGY STAR® steam cookers. ENERGY STAR® savings calculator uses 16.7 lb/hr per pan for electric and 20 lb/hr for natural gas ENERGY STAR® steamers.

<sup>127</sup>Reference Food Service Technology Center 2011 Savings Calculator values as used by Consortium for Energy Efficiency, Inc. for Tier 1A and Tier 1B qualified electric and natural gas steamer heavy cooking load energy efficiencies, as sourced from ENERGY STAR Program Requirements Product Specification for Commercial Steam Cookers, version 1.2, effective August 1, 2013.

<sup>128</sup>Reference ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculations

<sup>129</sup>Ibid.

<sup>130</sup>Ohio TRM which references 2002 Food Service Technology Center "Commercial Cooking Appliance Technology Assessment" Chapter 8: Steamers. This is also used by the ENERGY STAR Commercial Kitchen Equipment Savings Calculator. 11,000 Btu/preheat is from 72,000 Btu/hr \* 15 min/hr /60 min/hr for gas steamers and 0.5 kWh/preheat is from 6 kW/preheat \* 15 min/hr / 60 min/hr

<sup>131</sup>Reference Food Service Technology Center 2011 Savings Calculator values for Baseline Preheat Energy.

<sup>132</sup>Reference Food Service Technology Center 2011 Savings Calculator values as used by Consortium for Energy Efficiency, Inc. for baseline electric and natural gas steamer heavy cooking load energy efficiencies.

<sup>133</sup> Ibid.

= custom or if unknown, use 100 lbs/day<sup>134</sup>

$E_{FOOD}$  = Amount of Energy Absorbed by the food during cooking known as ASTM Energy to Food<sup>135</sup>

$E_{FOOD} - \text{gas(Btu/lb)}$	$E_{FOOD} \text{ (kWh/lb)}$
105 <sup>136</sup>	0.0308 <sup>137</sup>

**For example**, for a gas steam cooker: A 3 pan steamer in a full service restaurant

$$\begin{aligned} \Delta \text{Savings} &= (\Delta \text{Idle Energy} + \Delta \text{Preheat Energy} + \Delta \text{Cooking Energy}) * Z * 1/100.000 \\ \Delta \text{Idle Energy} &= (((1 - 0.9) * 11000 + 0.9 * 65 * 105 / 0.15) * (7 - (100 / 65) - (1 * 0.25))) - (((1 - 0) * 6250 + 0 * 55 * 105 / 0.38) * (7 - (100 / 55) - (1 * 0.25))) \\ &= 188,321 \\ \Delta \text{Preheat Energy} &= (1 * 11,000) \\ &= 11,000 \\ \Delta \text{Cooking Energy} &= (((1 / 0.15) - (1 / 0.38)) * (100 \text{ lb/day} * 105 \text{ btu/lb})) \\ &= 42368 \\ \Delta \text{Therms} &= (188321 + 11000 + 42368) * 365.25 * 1/100,000 \\ &= 883 \text{ therms} \end{aligned}$$

For an electric steam cooker: A 3 pan steamer in a cafeteria:

$$\begin{aligned} \Delta \text{Savings} &= (\Delta \text{Idle Energy} + \Delta \text{Preheat Energy} + \Delta \text{Cooking Energy}) * Z \\ \Delta \text{Idle Energy} &= (((1 - .9) * 1.0 + .9 * 70 * 0.0308 / 0.26) * (6 - (100 / 70) - (1 * .25))) - (((1 - 0) * 0.4 + 0 * 50 * 0.0308 / 0.50) * (6 - (100 / 50) - (1 * 0.25))) \\ &= 31.18 \\ \Delta \text{Preheat Energy} &= (1 * 0.5) \\ &= 0.5 \\ \Delta \text{Cooking Energy} &= (((1 / 0.26) - (1 / 0.5)) * (100 * 0.0308)) \\ &= 5.69 \\ \Delta \text{kWh} &= (31.18 + 0.5 + 5.69) * 365.25 \text{ days} \\ &= 13,649 \text{ kWh} \end{aligned}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta \text{kWh}_{\text{water}} = \Delta \text{Water (gallons)} / 1,000,000 * E_{\text{water supply}}$$

Where

$$E_{\text{water supply}} = \text{IL Supply Energy Factor (kWh/Million Gallons)}$$

<sup>134</sup>Amount used by both Food Service Technology Center and ENERGY STAR® savings calculator

<sup>135</sup>Reference ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculations.

<sup>136</sup>Ibid.

<sup>137</sup>Ibid.



$$=2,571^{138}$$

**For example**, an electric 3 pan steamer with average efficiency in a full service restaurant

$\Delta\text{Water}$  (gallons) =  $(40 - 10) * 7 * 365.25$   
 = 76,703 gallons

$\Delta\text{kWh}_{\text{water}}$  =  $76,703/1,000,000*2,571$   
 = 197 kWh

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

This is only applicable to the electric steam cooker.

$$\Delta\text{kW} = (\Delta\text{kWh}/(\text{HOURS}_{\text{Day}} * \text{Days}_{\text{Year}})) * \text{CF}$$

Where:

$\Delta\text{kWh}$  = Annual kWh savings from measure as calculated above. Note do not include the secondary savings in this calculation.

CF =Summer Peak Coincidence Factor for measure is provided below for different locations:<sup>139</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

$\text{Days}_{\text{Year}}$  =Annual Days of Operation  
 =custom or 365.25 days a year  
 Other values as defined above

**For example**, for 3 pan electric steam cooker located in a cafeteria:

$\Delta\text{kW}$  =  $(\Delta\text{kWh}/(\text{HOURS}_{\text{Day}} * \text{Days}_{\text{Year}})) * \text{CF}$   
 =  $(13,649/ (6 * 365.25)) * 0.39$   
 = 2.43 kW

<sup>138</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’. Note that the Commercial Steam Cooker does not discharge its water into the wastewater system so only the water supply factor is used here.

<sup>139</sup>Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

This is applicable to both gas and electric steam cookers.

$$\Delta\text{Water (gallons)} = (W_{\text{BASE}} - W_{\text{ENERGYSTAR}}) * \text{HOURS}_{\text{Day}} * \text{Days}_{\text{Year}}$$

Where

$W_{\text{BASE}}$  = Water Consumption Rate of Base Steamer (gal/hr)  
 = 40<sup>140</sup>

$W_{\text{ENERGYSTAR}}$  = Water Consumption Rate of ENERGY STAR® Steamer look up<sup>141</sup>

CEE Tier	gal/hr
Tier 1A	15
Tier 1B	4
Avg Efficient	10
Avg Most Efficient	3

$\text{Days}_{\text{Year}}$  =Annual Days of Operation  
 =custom or 365.25 days a year<sup>142</sup>

**For example**, an electric 3 pan steamer with average efficiency in a full service restaurant  
 $\Delta\text{Water (gallons)} = (40 - 10) * 7 * 365.25$   
 = 76,703 gallons

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-STMC-V05-190101**

**REVIEW DEADLINE: 1/1/2023**

<sup>140</sup> FSTC (2002). Commercial Cooking Appliance Technology Assessment. Chapter 8: Steamers.

<sup>141</sup>Source Consortium for Energy Efficiency, Inc. September 2010 "Program Design Guidance for Steamers" for Tier 1A and Tier 1B water requirements. Ohio Technical Reference Manual 2010 for 10 gal/hr water consumption which can be used when Tier level is not known.

<sup>142</sup>Source for 365.25 days/yr is ENERGY STAR® savings calculator which references Food Service Technology research on average use, 2009.

## 4.2.4 Conveyor Oven

### DESCRIPTION

This measure applies to natural gas fired high efficiency conveyor ovens installed in commercial kitchens replacing existing natural gas units with conveyor width greater than 25 inches.

Conveyor ovens are available using four different heating processes: infrared, natural convection with a ceramic baking hearth, forced convection or air impingement, or a combination of infrared and forced convection. Conveyor ovens are typically used for producing a limited number of products with similar cooking requirements at high production rates. They are highly flexible and can be used to bake or roast a wide variety of products including pizza, casseroles, meats, breads, and pastries.

Some manufacturers offer an air-curtain feature at either end of the cooking chamber that helps to keep the heated air inside the conveyor oven. The air curtain operates as a virtual oven wall and helps reduce both the idle energy of the oven and the resultant heat gain to the kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a natural gas conveyor oven with a tested baking energy efficiency > 42% and an idle energy consumption rate < 57,000 Btu/hr utilizing ASTM standard F1817.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing pizza deck oven at end of life.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 17 years.<sup>143</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$1800.<sup>144</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

---

<sup>143</sup>See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

<sup>144</sup>Ibid.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

The annual natural gas energy savings from this measure is a deemed value equaling 884 Therms.<sup>145</sup>

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-CVOV-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>145</sup> The Resource Solutions Group Commercial Conveyor Oven – Gas workpaper from January 2012; Commercial Gas Conveyor Oven – Large Gas Savings (therms/unit).

#### 4.2.5 ENERGY STAR Convection Oven

**DESCRIPTION**

This measure applies to natural gas fired ENERGY STAR convection ovens installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

To qualify for this measure the installed equipment must be a natural gas convection oven with a cooking efficiency  $\geq 46\%$  utilizing ASTM standard 1496 and an idle energy consumption rate  $< 12,000$  Btu/hr.<sup>146</sup>

**DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment is a natural gas convection oven that is not ENERGY STAR certified and is at end of life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 12 years.<sup>147</sup>

**DEEMED MEASURE COST**

The incremental capital cost for this measure is \$50.<sup>148</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

Custom calculation below; otherwise, use deemed value of 306 therms.<sup>149</sup>

$$\Delta\text{Therms} = (\Delta\text{DailyIdle Energy} + \Delta\text{DailyPreheat Energy} + \Delta\text{DailyCooking Energy}) * \text{Days} / 100000$$

---

<sup>146</sup> Version 2.2. of the ENERGY STAR specification.

<sup>147</sup> Lifetime from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Oven Calculations, which cites reference as “FSTC research on available models, 2009”.

<sup>148</sup> Measure cost from ENERGY STAR Commercial Kitchen Equipment Savings Calculator which cites reference as “EPA research on available models using AutoQuotes, 2010”.

<sup>149</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Oven Calculations.

Where:

$$\Delta\text{DailyIdleEnergy} = (\text{IdleBase} * \text{IdleBaseTime}) - (\text{IdleENERGYSTAR} * \text{IdleENERGYSTARTime})$$

$$\Delta\text{DailyPreheatEnergy} = (\text{PreHeatNumberBase} * \text{PreheatTimeBase} / 60 * \text{PreheatRateBase}) - (\text{PreheatNumberENERGYSTAR} * \text{PreheatTimeENERGYSTAR} / 60 * \text{PreheatRateENERGYSTAR})$$

$$\Delta\text{DailyCookingEnergy} = (\text{LB} * \text{EFOOD} / \text{EffBase}) - (\text{LB} * \text{EFOOD} / \text{EffENERGYSTAR})$$

Where:

- HOURSday = Average Daily Operation  
= custom or if unknown, use 12 hours
- Days = Annual days of operation  
= custom or if unknown, use 365.25 days a year
- LB = Food cooked per day  
= custom or if unknown, use 100 pounds
- EffENERGYSTAR = Cooking Efficiency ENERGY STAR  
= custom or if unknown, use 46%
- EffBase = Cooking Efficiency Baseline  
= custom or if unknown, use 30%
- PCENERGYSTAR = Production Capacity ENERGY STAR  
= custom or if unknown, use 80 pounds/hr
- PCBase = Production Capacity base  
= custom or if unknown, use 70 pounds/hr
- PreheatNumberENERGYSTAR = Number of preheats per day  
= custom or if unknown, use 1
- PreheatNumberBase = Number of preheats per day  
= custom or if unknown, use 1
- PreheatTimeENERGYSTAR = preheat length  
= custom or if unknown, use 15 minutes
- PreheatTimeBase = preheat length  
= custom or if unknown, use 15 minutes
- PreheatRateENERGYSTAR = preheat energy rate high efficiency  
= custom or if unknown, use 44000 btu/h
- PreheatRateBase = preheat energy rate baseline  
= custom or if unknown, use 76000 btu/h
- IdleENERGYSTAR = Idle energy rate  
= custom or if unknown, use 12000 btu/h
- IdleBase = Idle energy rate

	= custom or if unknown, use 18000 btu/h
IdleENERGYSTARTTime	= ENERGY STAR Idle Time
	=HOURSday-LB/PCENERGYSTAR –PreHeatTimeENERGYSTAR/60
	=12 – 100/80 – 15/60
	=10.5 hours
IdleBaseTime	= BASE Idle Time
	= HOURSday-LB/PCbase –PreHeatTimeBase/60
	=Custom or if unknown, use
	=12 – 100/70-15/60
	=10.3 hours
EFOOD	= ASTM energy to food
	= 250 btu/pound

**For example**, an ENERGY STAR Oven with a cooking energy efficiency of 46% and default values from above would save.

$$\Delta\text{Therms} = (\Delta\text{Idle Energy} + \Delta\text{Preheat Energy} + \Delta\text{Cooking Energy}) * \text{Days} / 100000$$

Where:

$\Delta\text{DailyIdleEnergy}$	$= (18000 * 10.3) - (12000 * 10.5)$
	$= 59,400 \text{ btu}$
$\Delta\text{DailyPreheatEnergy}$	$= (1 * 15 / 60 * 76000) - (1 * 15 / 60 * 44000)$
	$= 8,000 \text{ btu}$
$\Delta\text{DailyCookingEnergy}$	$= (100 * 250 / .30) - (100 * 250 / .46)$
	$= 28,986 \text{ btu}$
$\Delta\text{Therms}$	$= (59,400 + 8,000 + 28,986) * 365.25 / 100000$
	$= 352 \text{ therms}$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-ESCV-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

## 4.2.6 ENERGY STAR Dishwasher

### DESCRIPTION

This measure applies to ENERGY STAR high and low temp under counter, stationary single tank door type, single tank conveyor, and multiple tank conveyor dishwashers, as well as high temp pot, pan, and utensil dishwashers installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR certified dishwasher meeting idle energy rate (kW) and water consumption (gallons/rack) limits, as determined by both machine type and sanitation approach (chemical/low temp versus high temp).

### ENERGY STAR Requirements (Effective February 1, 2013)

Dishwasher Type	High Temp Efficiency Requirements		Low Temp Efficiency Requirements	
	Idle Energy Rate	Water Consumption	Idle Energy Rate	Water Consumption
Under Counter	≤ 0.50 kW	≤ 0.86 GPR	≤ 0.50 kW	≤ 1.19 GPR
Stationary Single Tank Door	≤ 0.70 kW	≤ 0.89 GPR	≤ 0.60 kW	≤ 1.18 GPR
Pot, Pan, and Utensil	≤ 1.20 kW	≤ 0.58 GPSF	≤ 1.00 kW	≤ 0.58 GPSF
Single Tank Conveyor	≤ 1.50 kW	≤ 0.70 GPR	≤ 1.50 kW	≤ 0.79 GPR
Multiple Tank Conveyor	≤ 2.25 kW	≤ 0.54 GPR	≤ 2.00 kW	≤ 0.54 GPR

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a new dishwasher that is not ENERGY STAR certified.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be:<sup>150</sup>

Dishwasher Type		Equipment Life
Low Temp	Under Counter	10
	Stationary Single Tank Door	15
	Single Tank Conveyor	20
	Multi Tank Conveyor	20
High Temp	Under Counter	10
	Stationary Single Tank Door	15
	Single Tank Conveyor	20
	Multi Tank Conveyor	20
	Pot, Pan, and Utensil	10

### DEEMED MEASURE COST

The incremental capital cost for this measure is provided below:<sup>151</sup>

Dishwasher Type		Incremental Cost
Low	Under Counter	\$50

<sup>150</sup> Lifetime from ENERGY STAR Commercial Kitchen Equipment Savings Calculator which cites reference as “EPA/FSTC research on available models, 2013”

<sup>151</sup> Measure cost from ENERGY STAR Commercial Kitchen Equipment Savings Calculator which cites reference as “EPA research on available models using AutoQuotes, 2012”



Dishwasher Type		Incremental Cost
Temp	Stationary Single Tank Door	\$0
	Single Tank Conveyor	\$0
	Multi Tank Conveyor	\$970
High Temp	Under Counter	\$120
	Stationary Single Tank Door	\$770
	Single Tank Conveyor	\$2,050
	Multi Tank Conveyor	\$970
	Pot, Pan, and Utensil	\$1,710

**LOADSHAPE**

Loadshape C01 - Commercial Electric Cooking

**COINCIDENCE FACTOR**

Summer Peak Coincidence Factor for measure is provided below for different restaurant types:<sup>152</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

ENERGY STAR dishwashers save energy in three categories: building water heating, booster water heating and idle energy. Building water heating and booster water heating could be either electric or natural gas.

**ELECTRIC ENERGY SAVINGS**

Custom calculation below<sup>153</sup>, otherwise use deemed values found within the tables that follow.

$$\Delta kWh = \Delta \text{BuildingEnergy} + \Delta \text{BoosterEnergy} + \Delta \text{IdleEnergy}$$

Where:

$$\begin{aligned} \Delta \text{BuildingEnergy} &= \text{Change in annual electric energy consumption of building water heater} \\ &= [(WaterUse_{Base} * RacksWashed * Days) * (\Delta T_{in} * 1.0 * 8.2 \div Eff_{Heater} \div 3,412)] - \\ &\quad [(WaterUse_{ESTAR} * RacksWashed * Days) * (\Delta T_{in} * 1.0 * 8.2 \div Eff_{Heater} \div 3,412)] \end{aligned}$$

$$\begin{aligned} \Delta \text{BoosterEnergy} &= \text{Annual electric energy consumption of booster water heater}^{154} \\ &= [(WaterUse_{Base} * RacksWashed * Days) * (\Delta T_{in} * 1.0 * 8.2 \div Eff_{Heater} \div 3,412)] - \\ &\quad [(WaterUse_{ESTAR} * RacksWashed * Days) * (\Delta T_{in} * 1.0 * 8.2 \div Eff_{Heater} \div 3,412)] \end{aligned}$$

<sup>152</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985

<sup>153</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator.

<sup>154</sup> Booster water heater energy only applies to high-temperature dishwashers.

$$\Delta \text{IdleEnergy} = \text{Annual idle electric energy consumption of dishwasher}$$

$$= [\text{IdleDraw}_{\text{Base}} * (\text{Hours} * \text{Days} - \text{Days} * \text{RacksWashed} * \text{WashTime} \div 60)] -$$

$$[\text{IdleDraw}_{\text{ESTAR}} * (\text{Hours} * \text{Days} - \text{Days} * \text{RacksWashed} * \text{WashTime} \div 60)]$$

Where:

- $\text{WaterUse}_{\text{Base}}$  = Water use per rack (gal) of baseline dishwasher  
 = Custom or if unknown, use value from table below as determined by machine type and sanitation method
- $\text{WaterUse}_{\text{ESTAR}}$  = Water use per rack (gal) of ENERGY STAR dishwasher  
 = Custom or if unknown, use value from table below as determined by machine type and sanitation method
- $\text{RacksWashed}$  = Number of racks washed per day  
 = Custom or if unknown, use value from table below as determined by machine type and sanitation method
- $\text{Days}$  = Annual days of dishwasher operation  
 = Custom or if unknown, use 365.25 days per year
- $\Delta T_{\text{in}}$  = Inlet water temperature increase (°F)  
 = Custom or if unknown, use 70 °F for building water heaters and 40 °F for booster water heaters
- 1.0 = Specific heat of water (Btu/lb/°F)
- 8.2 = Density of water (lb/gal)
- $\text{Eff}_{\text{Heater}}$  = Efficiency of water heater  
 = Custom or if unknown, use 98% for electric building and booster water heaters
- 3,412 = kWh to Btu conversion factor
- $\text{IdleDraw}_{\text{Base}}$  = Idle power draw (kW) of baseline dishwasher  
 = Custom or if unknown, use value from table below as determined by machine type and sanitation method
- $\text{IdleDraw}_{\text{ESTAR}}$  = Idle power draw (kW) of ENERGY STAR dishwasher  
 = Custom or if unknown, use value from table below as determined by machine type and sanitation method
- $\text{Hours}$  = Average daily hours of dishwasher operation  
 = Custom or if unknown, use 18 hours per day
- $\text{WashTime}$  = Typical wash time (min)  
 = Custom or if unknown, use value from table below as determined by machine type and sanitation method
- 60 = Minutes to hours conversion factor

**For example**, an ENERGY STAR high-temperature, under counter dishwasher with electric building and electric booster water heating with defaults from the calculation above and the table below would save:

$$\Delta kWh = \Delta \text{BuildingEnergy} + \Delta \text{BoosterEnergy} + \Delta \text{IdleEnergy}$$

Where:

$$\begin{aligned} \Delta \text{BuildingEnergy} &= [(1.09 * 75 * 365.25) * (70 * 1.0 * 8.2 \div 0.98 \div 3,412)] - [(0.86 * 75 * 365.25) * (70 * 1.0 * 8.2 \div 0.98 \div 3,412)] \\ &= 1,082 \text{ kWh} \\ \Delta \text{BoosterEnergy} &= [(1.09 * 75 * 365.25) * (40 * 1.0 * 8.2 \div 0.98 \div 3,412)] - [(0.86 * 75 * 365.25) * (40 * 1.0 * 8.2 \div 0.98 \div 3,412)] \\ &= 618 \text{ kWh} \\ \Delta \text{IdleEnergy} &= [0.76 * (18 * 365.25 - 365.25 * 75 * 2.0 \div 60)] - [0.50 * (18 * 365.25 - 365.25 * 75 * 2.0 \div 60)] \\ &= 1,472 \text{ Wh} \\ \Delta kWh &= 1,082 + 618 + 1,472 \\ &= 3,172 \text{ kWh} \end{aligned}$$

Default values for WaterUse, RacksWashed, kW<sub>Idle</sub>, and WashTime are presented in the table below.

Low Temperature	RacksWashed	WashTime	WaterUse		IdleDraw	
	All Dishwashers	All Dishwashers	Conventional	ENERGY STAR	Conventional	ENERGY STAR
Under Counter	75	2.0	1.73	1.19	0.50	0.50
Stationary Single Tank Door	280	1.5	2.10	1.18	0.60	0.60
Single Tank Conveyor	400	0.3	1.31	0.79	1.60	1.50
Multi Tank Conveyor	600	0.3	1.04	0.54	2.00	2.00
High Temperature	All Dishwashers	All Dishwashers	Conventional	ENERGY STAR	Conventional	ENERGY STAR
Under Counter	75	2.0	1.09	0.86	0.76	0.50
Stationary Single Tank Door	280	1.0	1.29	0.89	0.87	0.70
Single Tank Conveyor	400	0.3	0.87	0.70	1.93	1.50
Multi Tank Conveyor	600	0.2	0.97	0.54	2.59	2.25
Pot, Pan, and Utensil	280	3.0 3.0	0.70	0.58	1.20	1.20

Savings for all water heating combinations are presented in the tables below (calculated without rounding variables as provided above).

Electric building and electric booster water heating

Dishwasher type		kWh <sub>Base</sub>	kWh <sub>ESTAR</sub>	ΔkWh
Low Temp	Under Counter	10,972	8,431	2,541
	Stationary Single Tank Door	39,306	23,142	16,164
	Single Tank Conveyor	42,230	28,594	13,636
	Multi Tank Conveyor	50,112	31,288	18,824
High Temp	Under Counter	12,363	9,191	3,173
	Stationary Single Tank Door	39,852	27,981	11,871
	Single Tank Conveyor	45,593	36,375	9,218
	Multi Tank Conveyor	72,523	45,096	27,426
	Pot, Pan, and Utensil	21,079	17,766	3,313

Electric building and natural gas booster water heating

Dishwasher type		kWh <sub>Base</sub>	kWh <sub>ESTAR</sub>	ΔkWh
Low Temp	Under Counter	10,972	8,431	2,541
	Stationary Single Tank Door	39,306	23,142	16,164
	Single Tank Conveyor	42,230	28,594	13,636
	Multi Tank Conveyor	50,112	31,288	18,824
High Temp	Under Counter	9,432	6,878	2,554
	Stationary Single Tank Door	26,901	19,046	7,856
	Single Tank Conveyor	33,115	26,335	6,780
	Multi Tank Conveyor	51,655	33,479	18,176
	Pot, Pan, and Utensil	14,052	11,943	2,108

Natural gas building and electric booster water heating

Dishwasher type		kWh <sub>Base</sub>	kWh <sub>ESTAR</sub>	ΔkWh
Low Temp	Under Counter	2,831	2,831	0
	Stationary Single Tank Door	2,411	2,411	0
	Single Tank Conveyor	9,350	8,766	584
	Multi Tank Conveyor	10,958	10,958	0
High Temp	Under Counter	7,234	5,143	2,090
	Stationary Single Tank Door	17,188	12,344	4,844
	Single Tank Conveyor	23,757	18,806	4,951
	Multi Tank Conveyor	36,004	24,766	11,238
	Pot, Pan, and Utensil	8,781	7,576	1,205

Natural gas building and natural gas booster water heating

Dishwasher type		kWh <sub>Base</sub>	kWh <sub>ESTAR</sub>	ΔkWh
Low Temp	Under Counter	2,831	2,831	0
	Stationary Single Tank Door	2,411	2,411	0
	Single Tank Conveyor	9,350	8,766	584
	Multi Tank Conveyor	10,958	10,958	0
High Temp	Under Counter	4,303	2,831	1,472
	Stationary Single Tank Door	4,237	3,409	828
	Single Tank Conveyor	11,279	8,766	2,513
	Multi Tank Conveyor	15,136	13,149	1,987
	Pot, Pan, and Utensil	1,753	1,753	0

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta\text{kWh}_{\text{water}} = \Delta\text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

$$E_{\text{water total}} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

= 5,010 for measures installed in all areas except Cook County<sup>155</sup>  
 = 2,937 for measures installed in Cook County<sup>156,157</sup>

**For example**, an ENERGY STAR low-temperature, under-counter dishwasher with defaults from the calculation above and the table within the electric energy savings characterization would save:

$$\Delta\text{Water} = (\text{WaterUse}_{\text{Base}} * \text{RacksWashed} * \text{Days}) - (\text{WaterUse}_{\text{ESTAR}} * \text{RacksWashed} * \text{Days})$$

$\Delta\text{Water}$ (gallons)	= (1.73 * 75 * 365.25) - (1.19 * 75 * 365.25)
	= 14,793 gallons
$\Delta\text{kWh}_{\text{water}}$	= 14,793/1,000,000*5,010
	= 74 kWh

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh} / \text{AnnualHours} * \text{CF}$$

Where:

- $\Delta\text{kWh}$  = Annual kWh savings from measure as calculated above. Note: do not include the secondary savings in this calculation.
- AnnualHours = Hours \* Days  
 = Custom, or if unknown assume (18 \* 365.25 =) 6575 annual hours
- CF = Summer Peak Coincidence Factor  
 = dependent on restaurant type:<sup>158</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36

<sup>155</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>156</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>157</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

<sup>158</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985.

Location	CF
Cafeteria	0.39

**For example**, a low temperature undercounter dishwasher in a Full Service Limited Menu restaurant with electric building and booster water heaters would save:

$$\begin{aligned} \Delta kW &= \Delta kWh / \text{AnnualHours} * CF \\ &= 2541 / 6575 * 0.51 \\ &= 0.197 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{Therms} = \Delta \text{BuildingEnergy} + \Delta \text{BoosterEnergy}$$

Where:

$$\begin{aligned} \Delta \text{BuildingEnergy} &= \text{Change in annual natural gas consumption of building water heater} \\ &= [(\text{WaterUse}_{\text{Base}} * \text{RacksWashed} * \text{Days}) * (\Delta T_{\text{in}} * 1.0 * 8.2 \div \text{Eff}_{\text{Heater}} \div 100,000)] - \\ &\quad [(\text{WaterUse}_{\text{ESTAR}} * \text{RacksWashed} * \text{Days}) * (\Delta T_{\text{in}} * 1.0 * 8.2 \div \text{Eff}_{\text{Heater}} \div 100,000)] \\ \Delta \text{BoosterEnergy} &= \text{Change in annual natural gas consumption of booster water heater} \\ &= [(\text{WaterUse}_{\text{Base}} * \text{RacksWashed} * \text{Days}) * (\Delta T_{\text{in}} * 1.0 * 8.2 \div \text{Eff}_{\text{Heater}} \div 100,000)] - \\ &\quad [(\text{WaterUse}_{\text{ESTAR}} * \text{RacksWashed} * \text{Days}) * (\Delta T_{\text{in}} * 1.0 * 8.2 \div \text{Eff}_{\text{Heater}} \div 100,000)] \end{aligned}$$

Where:

- WaterUse<sub>Base</sub> = Water use per rack (gal) of baseline dishwasher  
= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method
- WaterUse<sub>ESTAR</sub> = Water use per rack (gal) of ENERGY STAR dishwasher  
= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method
- RacksWashed = Number of racks washed per day  
= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method
- Days = Annual days of dishwasher operation  
= Custom or if unknown, use 365 days per year
- ΔT<sub>in</sub> = Inlet water temperature increase (°F)  
= Custom or if unknown, use 70 °F for building water heaters and 40 °F for booster water heaters
- 1.0 = Specific heat of water (Btu/lb/°F)
- 8.2 = Density of water (lb/gal)
- Eff<sub>Heater</sub> = Efficiency of water heater  
= Custom or 80% for gas building and booster water heaters
- 100,000 = Therms to Btu conversion factor

**For example**, an ENERGY STAR high-temperature, under counter dishwasher with gas building and gas booster water heating with defaults from the calculation above and the table within the electric energy savings characterization would save:

$$\Delta\text{Therms} = \Delta\text{BuildingEnergy} + \Delta\text{BoosterEnergy}$$

Where:

$$\begin{aligned} \Delta\text{BuildingEnergy} &= [(1.09 * 75 * 365.25) * (70 * 1.0 * 8.2 \div 0.80 \div 100,000)] - [(0.86 * 75 * 365.25) * (70 * 1.0 * 8.2 \div 0.80 \div 100,000)] \\ &= 45 \text{ therms} \\ \Delta\text{BoosterEnergy} &= [(1.09 * 75 * 365.25) * (40 * 1.0 * 8.2 \div 0.80 \div 100,000)] - [(0.86 * 75 * 365.25) * (40 * 1.0 * 8.2 \div 0.80 \div 100,000)] \\ &= 26 \text{ therms} \\ \Delta\text{Therms} &= 45 + 26 \\ &= 71 \text{ therms} \end{aligned}$$

Savings for all water heating combinations are presented in the tables below.

Electric building and natural gas booster water heating

Dishwasher type		Therms <sub>Base</sub>	Therms <sub>ESTAR</sub>	ΔTherms
Low Temp	Under Counter	NA	NA	NA
	Stationary Single Tank Door	NA	NA	NA
	Single Tank Conveyor	NA	NA	NA
	Multi Tank Conveyor	NA	NA	NA
High Temp	Under Counter	123	97	26
	Stationary Single Tank Door	541	374	168
	Single Tank Conveyor	522	420	102
	Stationary Single Tank Door	872	486	387
	Pot, Pan, and Utensil	294	243	50

Natural gas building and natural gas booster water heating

Dishwasher type		Therms <sub>Base</sub>	Therms <sub>ESTAR</sub>	ΔTherms
Low Temp	Under Counter	340	234	106
	Stationary Single Tank Door	1,543	867	676
	Single Tank Conveyor	1,375	829	546
	Multi Tank Conveyor	1,637	850	787
High Temp	Under Counter	337	266	71
	Stationary Single Tank Door	1,489	1,027	462
	Single Tank Conveyor	1,435	1,154	280
	Multi Tank Conveyor	2,399	1,336	1,064
	Pot, Pan, and Utensil	808	669	139

Natural gas building and electric booster water heating

Dishwasher type		Therms <sub>Base</sub>	Therms <sub>ESTAR</sub>	ΔTherms
Low Temp	Under Counter	340	234	106
	Stationary Single Tank Door	1,543	867	676
	Single Tank Conveyor	1,375	829	546
	Multi Tank Conveyor	1,637	850	787
High Temp	Under Counter	214	169	45

Dishwasher type		Therms <sub>Base</sub>	Therms <sub>ESTAR</sub>	ΔTherms
High Temp	Stationary Single Tank Door	948	654	294
	Single Tank Conveyor	913	735	178
	Multi Tank Conveyor	1,527	850	677
	Pot, Pan, and Utensil	514	426	88

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water} = (\text{WaterUse}_{\text{Base}} * \text{RacksWashed} * \text{Days}) - (\text{WaterUse}_{\text{ESTAR}} * \text{RacksWashed} * \text{Days})$$

Where:

- WaterUse<sub>Base</sub> = Water use per rack (gal) of baseline dishwasher  
= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method
- WaterUse<sub>ESTAR</sub> = Water use per rack (gal) of ENERGY STAR dishwasher  
= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method
- RacksWashed = Number of racks washed per day  
= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method
- Days = Annual days of dishwasher operation  
= Custom or if unknown, use 365 days per year

**For example**, an ENERGY STAR low-temperature, under counter dishwasher with defaults from the calculation above and the table within the electric energy savings characterization would save:

$$\Delta\text{Water} = (\text{WaterUse}_{\text{Base}} * \text{RacksWashed} * \text{Days}) - (\text{WaterUse}_{\text{ESTAR}} * \text{RacksWashed} * \text{Days})$$

$$\Delta\text{Water (gallons)} = (1.73 * 75 * 365.25) - (1.19 * 75 * 365.25)$$

$$= 14,793 \text{ gallons}$$

Savings for all dishwasher types are presented in the table below.

	Annual Water Consumption (gallons)		
	Baseline	ENERGY STAR	Savings
<b>Low Temperature</b>			
Under Counter	47,391	32,599	14,793
Stationary Single Tank Door	214,767	120,679	94,088
Single Tank Conveyor	191,391	115,419	75,972
Multi Tank Conveyor	227,916	118,341	109,575
<b>High Temperature</b>			
Under Counter	29,859	23,559	6,301
Stationary Single Tank Door	131,928	91,020	40,908
Single Tank Conveyor	127,107	102,270	24,837
Multi Tank Conveyor	212,576	118,341	94,235
Pot, Pan, and Utensil	71,589	59,317	12,272



**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-ESDW-V05-190101**

**REVIEW DEADLINE: 1/1/2023**

## 4.2.7 ENERGY STAR Fryer

### DESCRIPTION

This measure applies to electric or natural gas fired ENERGY STAR certified fryers installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the installed equipment must be an ENERGY STAR certified fryer meeting idle energy rate (W or Btu/hr) and cooking efficiency (%) limits, as determined by both fuel type and fryer capacity (standard versus large vat).

### ENERGY STAR Requirements (Version 3.0, Effective October 1, 2016)

Fryer Capacity	Electric Efficiency Requirements		Natural Gas Efficiency Requirements	
	Idle Energy Rate	Cooking Efficiency Consumption	Idle Energy Rate	Cooking Efficiency Consumption
Standard Open Deep-Fat Fryer	≤ 800 W	≥ 83%	≤ 9,000 Btu/hr	≥ 50%
Large Vat Open Deep-Fat Fryer	≤ 1,100 W	≥ 80%	≤ 12,000 Btu/hr	

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a new electric or natural gas fryer that is not ENERGY STAR certified.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>159</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$1200.<sup>160</sup>

### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

### COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>161</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36

<sup>159</sup>Lifetime from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, which cites reference as “FSTC research on available models, 2009.

<sup>160</sup>Measure cost from ENERGY STAR Commercial Kitchen Equipment Savings Calculator which cites reference as “EPA research on available models using AutoQuotes, 2010”.

<sup>161</sup>Values taken from Minnesota Technical Reference Manual, (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985.

Location	CF
Cafeteria	0.39

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Custom calculation for an electric fryer below; otherwise use deemed value of 2,378.0 kWh for standard fryers and 2,537.9 kWh for large vat fryers.<sup>162</sup>

$$\Delta \text{kWh} = (\Delta \text{DailyIdleEnergy} + \Delta \text{DailyCookingEnergy}) * \text{Days} / 1,000$$

Where:

$$\Delta \text{DailyIdleEnergy} = (\text{ElecIdle}_{\text{Base}} * (\text{HOURS} - \text{LB}/\text{ElecPC}_{\text{Base}})) - (\text{ElecIdle}_{\text{ESTAR}} * (\text{HOURS} - \text{LB}/\text{ElecPC}_{\text{ESTAR}}))$$

$$\Delta \text{DailyCookingEnergy} = (\text{LB} * \text{EFOOD}_{\text{Elec}} / \text{ElecEff}_{\text{Base}}) - (\text{LB} * \text{EFOOD}_{\text{Elec}} / \text{ElecEff}_{\text{ESTAR}})$$

Where:

$\Delta \text{DailyIdleEnergy}$  = Difference in idle energy between baseline and efficient fryer

$\Delta \text{DailyCookingEnergy}$  = Difference in cooking energy between baseline and efficient fryer

Days = Annual days of operation  
= Custom, or if unknown, use 365.25 days per year

1,000 = Wh to kWh conversion factor

$\text{ElecIdle}_{\text{Base}}$  = Idle energy rate of baseline electric fryer  
= 1,050 W for standard fryers and 1,350 W for large vat fryers

$\text{ElecIdle}_{\text{ESTAR}}$  = Idle energy rate of ENERGY STAR electric fryer  
= Custom or if unknown, use 800 W for standard fryers and 1,100 for large vat fryers

HOURS = Average daily hours of operation  
= Custom or if unknown, use 16 hours per day for a standard fryer and 12 hours per day for a large vat fryer

LB = Food cooked per day  
= Custom or if unknown, use 150 pounds

$\text{ElecPC}_{\text{Base}}$  = Production capacity of baseline electric fryer  
= 65 lb/hr for standard fryers and 100 lb/hr for large vat fryers

$\text{ElecPC}_{\text{ESTAR}}$  = Production capacity of ENERGY STAR electric fryer  
= Custom or if unknown, use 70 lb/hr for standard fryers and 110 lb/hr for large vat fryers

$\text{EFOOD}_{\text{Elec}}$  = ASTM energy to food for electric fryers

---

<sup>162</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator.

- = 167 Wh/lb
- ElecEff<sub>Base</sub> = Cooking efficiency of baseline electric fryer  
= 75% for standard fryers and 70% for large vat fryers
- ElecEff<sub>ESTAR</sub> = Cooking efficiency of ENERGY STAR electric fryer  
= Custom or if unknown, use 83% for standard fryers and 80% for large vat fryers

**For example**, an ENERGY STAR standard-sized electric fryer, using default values from the calculation above, would save:

$$\Delta kWh = (\Delta DailyIdleEnergy + \Delta DailyCookingEnergy) * Days / 1,000$$

Where:

$$\begin{aligned} \Delta DailyIdleEnergy &= (1,050 * (16 - 150 / 65)) - (800 * (16 - 150 / 70)) \\ &= 3,291 \text{ Wh} \\ \Delta DailyCookingEnergy &= (150 * 167 / 0.75) - (150 * 167 / 0.83) \\ &= 3,219 \text{ Wh} \\ \Delta kWh &= (3,291 + 3,219) * 365.25 / 1,000 \\ &= 2,378.0 \text{ kWh} \end{aligned}$$

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / (\text{HOURS} * \text{Days}) * CF$$

Where:

$$\Delta kWh = \text{Electric energy savings, calculated above}$$

Other variables as defined above.

**For example**, an ENERGY STAR standard-sized electric fryer in a cafeteria, using default values from the calculation above, would save:

$$\begin{aligned} \Delta kW &= \Delta kWh / (\text{HOURS} * \text{Days}) * CF \\ &= 2,378.0 / (16 * 365.25) * 0.36 \\ &= 0.1465 \text{ kW} \end{aligned}$$

#### NATURAL GAS ENERGY SAVINGS

Custom calculation for a gas fryer below, otherwise use deemed value of 507.9 therms for standard fryers and 415.1 therms for large vat fryers.<sup>163</sup>

$$\Delta \text{Therms} = (\Delta DailyIdle \text{ Energy} + \Delta DailyCooking \text{ Energy}) * \text{Days} / 100,000$$

Where:

$$\begin{aligned} \Delta DailyIdleEnergy &= (\text{GasIdle}_{\text{Base}} * (\text{HOURS} - \text{LB}/\text{GasPC}_{\text{Base}})) - (\text{GasIdle}_{\text{ESTAR}} * (\text{HOURS} - \text{LB}/\text{GasPC}_{\text{ESTAR}})) \\ \Delta DailyCookingEnergy &= (\text{LB} * \text{EFOOD}_{\text{Gas}} / \text{GasEff}_{\text{Base}}) - (\text{LB} * \text{EFOOD}_{\text{Gas}} / \text{GasEff}_{\text{ESTAR}}) \end{aligned}$$

Where:

<sup>163</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator.

100,000	= Btu to therms conversion factor
GasIdle <sub>Base</sub>	= Idle energy rate of baseline gas fryer = 14,000 Btu/hr for standard fryers and 16,000 Btu/hr for large vat fryers
GasIdle <sub>ESTAR</sub>	= Idle energy rate of ENERGY STAR gas fryer = Custom or if unknown, use 9,000 Btu/hr for standard fryers and 12,000 Btu/hr for large vat fryers
GasPC <sub>Base</sub>	= Production capacity of baseline gas fryer = 60 lb/hr for standard fryers and 100 lb/hr for large vat fryers
GasPC <sub>ESTAR</sub>	= Production capacity of ENERGY STAR gas fryer = Custom or if unknown, use 65 lb/hr for standard fryers and 110 lb/hr for large vat fryers
EFOOD <sub>Gas</sub>	= ASTM energy to food = 570 Btu/lb
GasEff <sub>Base</sub>	= Cooking efficiency of baseline gas fryer = 35% for both standard and large vat fryers
GasEff <sub>ESTAR</sub>	= Cooking efficiency of ENERGY STAR gas fryer = Custom or if unknown, use 50% for both standard and large vat fryers

Other variables as defined above.

**For example**, an ENERGY STAR standard-sized electric fryer, using default values from the calculation above, would save:

$$\Delta\text{Therms} = (\Delta\text{DailyIdleEnergy} + \Delta\text{DailyCookingEnergy}) * \text{Days} / 100,000$$

Where:

$$\begin{aligned} \Delta\text{DailyIdleEnergy} &= (14,000 * (16 - 150 / 60)) - (9,000 * (16 - 150 / 65)) \\ &= 65,769 \text{ Btu/day} \end{aligned}$$

$$\begin{aligned} \Delta\text{DailyCookingEnergy} &= (150 * 570 / 0.35) - (150 * 570 / 0.50) \\ &= 73,286 \text{ Btu/day} \end{aligned}$$

$$\begin{aligned} \Delta\text{Therms} &= (65,769 + 73,286) * 365.25 / 100,000 \\ &= 507.9 \text{ therms} \end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-ESFR-V02-190101**

**REVIEW DEADLINE: 1/1/2022**

## 4.2.8 ENERGY STAR Griddle

### DESCRIPTION

This measure applies to single or double-sided electric, natural gas fired, or dual fuel ENERGY STAR griddles installed in a commercial kitchen. For dual fuel griddles, savings should be divided between electric and gas as described in the Natural Gas Energy Savings section of this measure.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a single or double-sided natural gas, electric, or dual fuel ENERGY STAR griddle with a tested heavy load cooking energy efficiency of 70 percent (electric) 38 percent (gas) or greater and an idle energy rate of 2,650 Btu/hr per square foot of cooking surface or less, utilizing ASTM F1275. The griddle must have an Idle Energy Consumption Rate < 2,600 Btu/hr per square foot of cooking surface.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas or electric griddle that's not ENERGY STAR certified and is at end of use.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>164</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$0 for an electric griddle and \$60 for a gas griddle.<sup>165</sup>

### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

### COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>166</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

<sup>164</sup> Lifetime from ENERGY STAR Commercial Kitchen Equipment Calculator, Commercial Griddle Calculations, which cites reference as "FSTC research on available models, 2009".

<sup>165</sup> Measure cost from ENERGY STAR Commercial Kitchen Equipment Calculator, which cites reference as "EPA research on available models using AutoQuotes, 2010".

<sup>166</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985.

**Algorithm**

**CALCULATION OF SAVINGS<sup>167</sup>**

**ELECTRIC ENERGY SAVINGS**

Custom calculation for single or double-sided electric griddles below, otherwise use deemed value of 2,597 kWh.

$$\Delta kWh = (\Delta \text{Idle Energy} + \Delta \text{Preheat Energy} + \Delta \text{Cooking Energy}) * \text{Days} / 1000$$

Where:

$$\begin{aligned} \Delta \text{DailyIdleEnergy} &= [(\text{IdleBase} * \text{Width} * \text{Depth} * (\text{HOURSday} - (\text{LB}/(\text{PCBase} * \text{Width} * \text{Depth}))) - \\ & \quad (\text{PreheatNumberBase} * \text{PreheatTimeBase}/60)] - [(\text{IdleENERGYSTAR} * \text{Width} * \\ & \quad \text{Depth} * (\text{HOURSday} - (\text{LB}/(\text{PCENERGYSTAR} * \text{Width} * \text{Depth}))) - \\ & \quad (\text{PreheatNumberENERGYSTAR} * \text{PreheatTimeENERGYSTAR}/60)] \\ \Delta \text{DailyPreheatEnergy} &= (\text{PreHeatNumberBase} * \text{PreheatTimeBase} / 60 * \text{PreheatRateBase} * \text{Width} * \\ & \quad \text{Depth}) - (\text{PreheatNumberENERGYSTAR} * \text{PreheatTimeENERGYSTAR}/60 * \\ & \quad \text{PreheatRateENERGYSTAR} * \text{Width} * \text{Depth}) \\ \Delta \text{DailyCookingEnergy} &= (\text{LB} * \text{EFOOD}/ \text{EffBase}) - (\text{LB} * \text{EFOOD}/ \text{EffENERGYSTAR}) \end{aligned}$$

Where:

- HOURSday = Average Daily Operation  
= custom or if unknown, use 12 hours
- Days = Annual days of operation  
= custom or if unknown, use 365.25 days a year
- LB = Food cooked per day  
= custom or if unknown, use 100 pounds
- Width = Griddle Width  
= custom or if unknown, use 3 feet
- Depth = Griddle Depth  
= custom or if unknown, use 2 feet
- EffENERGYSTAR = Cooking Efficiency ENERGY STAR  
= custom or if unknown, use 70%
- EffBase = Cooking Efficiency Baseline  
= custom or if unknown, use 65%
- PCENERGYSTAR = Production Capacity ENERGY STAR  
= custom or if unknown, use 40/6 = 6.67 pounds/hr/sq ft
- PCBase = Production Capacity base  
= custom or if unknown, use 35/6 = 5.83 pounds/hr/sq ft
- PreheatNumberENERGYSTAR = Number of preheats per day  
= custom or if unknown, use 1

<sup>167</sup> Algorithms and assumptions derived from ENERGY STAR Griddle Commercial Kitchen Equipment Savings Calculator.

PreheatNumberBase	= Number of preheats per day = custom or if unknown, use 1
PreheatTimeENERGYSTAR	= preheat length = custom or if unknown, use 15 minutes
PreheatTimeBase	= preheat length = custom or if unknown, use 15 minutes
PreheatRateENERGYSTAR	= preheat energy rate high efficiency = custom or if unknown, use $8000/6 = 1333$ W/sq ft
PreheatRateBase	= preheat energy rate baseline = custom or if unknown, use $16000/6 = 2667$ W/sq ft
IdleENERGYSTAR	= Idle energy rate = custom or if unknown, use 320 W/sq ft
IdleBase	= Idle energy rate = custom or if unknown, use 400 W/sq ft
EFOOD	= ASTM energy to food = 139 w/pound

**For example**, an ENERGY STAR griddle with a tested heavy load cooking energy efficiency of 70 percent or greater and an idle energy rate of 320 W per square foot of cooking surface or less would save.

$$\begin{aligned} \Delta \text{DailyIdleEnergy} &= [400 * 3 * 2 * (12 - (100/(35/6 * 3 * 2))) - (1 * 15/60)] - [320 * 3 * 2 * (12 - (100/(40/6 * 3 * 2))) - (1 * 15/60)] \\ &= 3583 \text{ W} \\ \Delta \text{DailyPreheatEnergy} &= (1 * 15 / 60 * 16000/6 * 3 * 2) - (1 * 15/60 * 8000/6 * 3 * 2) \\ &= 2000 \text{ W} \\ \Delta \text{DailyCookingEnergy} &= (100 * 139 / 0.65) - (100 * 139 / 0.70) \\ &= 1527 \text{ W} \\ \Delta \text{kWh} &= (2000+1527+3583) * 365.25 / 1000 \\ &= 2597 \text{ kWh} \end{aligned}$$

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\text{kW} = \Delta \text{kWh/Hours} * \text{CF}$$

**For example**, an ENERGY STAR griddle in a cafeteria with a tested heavy load cooking energy efficiency of 70 percent or greater and an idle energy rate of 320 W per square foot of cooking surface or less would save

$$\begin{aligned} &= 2597 \text{ kWh}/4308 * 0.39 \\ &= 0.24 \text{ kW} \end{aligned}$$

#### NATURAL GAS ENERGY SAVINGS

Custom calculation for single or double-sided gas griddles or dual fuel griddles below, otherwise use deemed value of 149 therms.

$$\Delta \text{Therms} = (\Delta \text{Idle Energy} + \Delta \text{Preheat Energy} + \Delta \text{Cooking Energy}) * \text{Days} / 100000$$



Where:

$$\Delta\text{DailyIdleEnergy} = [(\text{IdleBase} * \text{Width} * \text{Depth} * (\text{HOURSday} - \text{LB}/(\text{PCBase} * \text{Width} * \text{Depth})) - (\text{PreheatNumberBase} * \text{PreheatTimeBase}/60)] - [(\text{IdleENERGYSTAR} * \text{Width} * \text{Depth} * (\text{HOURSday} - (\text{LB}/(\text{PCENERGYSTAR} * \text{Width} * \text{Depth})) - (\text{PreheatNumberENERGYSTAR} * \text{PreheatTimeENERGYSTAR}/60)]$$

$$\Delta\text{DailyPreheatEnergy} = (\text{PreHeatNumberBase} * \text{PreheatTimeBase} / 60 * \text{PreheatRateBase} * \text{Width} * \text{Depth}) - (\text{PreheatNumberENERGYSTAR} * \text{PreheatTimeENERGYSTAR}/60 * \text{PreheatRateENERGYSTAR} * \text{Width} * \text{Depth})$$

$$\Delta\text{DailyCookingEnergy} = (\text{LB} * \text{EFOOD}/\text{EffBase}) - (\text{LB} * \text{EFOOD}/\text{EffENERGYSTAR})$$

Where (new variables only):

EffENERGYSTAR = Cooking Efficiency ENERGY STAR  
= custom or if unknown, use 38%

EffBase = Cooking Efficiency Baseline  
= custom or if unknown, use 32%

PCENERGYSTAR = Production Capacity ENERGY STAR  
= custom or if unknown, use 45/6 = 7.5 pounds/hr/sq ft

PCBase = Production Capacity base  
= custom or if unknown, use 25/6 = 4.17 pounds/hr/sq ft

PreheatRateENERGYSTAR = preheat energy rate high efficiency  
= custom or if unknown, use 60000/6 = 10000 btu/h/sq ft

PreheatRateBase = preheat energy rate baseline  
= custom or if unknown, use 84000/6 = 14000 btu/h/sq ft

IdleENERGYSTAR = Idle energy rate  
= custom or if unknown, use 15900/6 = 2650 btu/h/sq ft

IdleBase = Idle energy rate  
= custom or if unknown, use 21000/6 = 3500 btu/h/sq ft

EFOOD = ASTM energy to food  
= 475 btu/pound

For dual fuel griddles, assume that half of the therms savings calculated according to the algorithm above are gas savings and half are electric savings.<sup>168</sup> Electric savings for dual griddles should be calculated as  $\Delta\text{kWh} = (\Delta\text{Therms} * 0.50) * 29.3$ .

---

<sup>168</sup> Dual fuel griddles are usually electric top plates and gas bottom plates, often used by fast food restaurants. As per DOE workpaper "Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances (2015 Update)" these models have a "second heating plate that is lowered on top of the food and used to simultaneously cook both sides." It therefore is reasonable to assume half savings are attributed to gas v electric.

**For example**, an ENERGY STAR griddle with a tested heavy load cooking energy efficiency of 38 percent or greater and an idle energy rate of 2,650 Btu/h per square foot of cooking surface or less and an Idle Energy Consumption Rate < 2,600 Btu/h per square foot of cooking surface would save.

$$\begin{aligned} \Delta \text{DailyIdleEnergy} &= [3500 * 3 * 2 * (12 - 100 / (25 / 6 * 3 * 2)) - (1 * 15 / 60)] - [(2650 * 3 * 2 * (12 - \\ & \quad (100 / (45 / 6 * 3 * 2)) - (1 * 15 / 60))] \\ &= 11258 \text{ Btu} \\ \Delta \text{DailyPreheatEnergy} &= (1 * 15 / 60 * 14,000 * 3 * 2) - (1 * 15 / 60 * 10000 * 3 * 2) \\ &= 6000 \text{ btu} \\ \Delta \text{DailyCookingEnergy} &= (100 * 475 / 0.32) - (100 * 475 / 0.38) \\ &= 23438 \text{ btu} \\ \Delta \text{Therms} &= (11258 + 6000 + 23438) * 365.25 / 100000 \\ &= 149 \text{ therms} \end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-ESGR-V04-200101**

**REVIEW DEADLINE: 1/1/2023**

## 4.2.9 ENERGY STAR Hot Food Holding Cabinets

### DESCRIPTION

This measure applies to electric ENERGY STAR hot food holding cabinets (HFHC) installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR certified HFHC.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an electric HFHC that’s not ENERGY STAR certified and at end of life.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>169</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is:<sup>170</sup>

HFHC Size	Incremental Cost
Full Size (20 cubic feet)	\$1200
¾ Size (12 cubic feet)	\$1800
½ Size (8 cubic feet)	\$1500

### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

### COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>171</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

<sup>169</sup> Lifetime from ENERGY STAR Commercial Kitchen Equipment Calculator, Hot Food Holding Cabinet Calculations, which cites reference as “FSTC research on available models, 2009”.

<sup>170</sup> Measure cost from ENERGY STAR Commercial Kitchen Equipment Calculator, which cites reference as “EPA research on available models using AutoQuotes, 2010”.

<sup>171</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), ‘Electric Oven and Range’ measure and are based upon “Project on Restaurant Energy Performance-End-Use Monitoring and Analysis”, Appendixes I and II, Claar, et. al., May 1985.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Custom calculation below, otherwise use deemed values depending on HFHC size:<sup>172</sup>

Cabinet Size	Savings (kWh)
Full Size HFHC	9308
¾ Size HFHC	3942
½ Size HFHC	2628

$$\Delta kWh = HFHC_{Baseline} kWh - HFHC_{ENERGYSTAR} kWh$$

Where:

$$HFHC_{Baseline} kWh = Power_{Baseline} * HOURS_{day} * Days / 1000$$

Power<sub>Baseline</sub> = Custom, otherwise

Cabinet Size	Power (W)
Full Size HFHC	2500
¾ Size HFHC	1200
½ Size HFHC	800

HOURS<sub>day</sub> = Average Daily Operation  
 = custom or if unknown, use 15 hours

Days = Annual days of operation  
 = custom or if unknown, use 365.25 days a year

$$HFHC_{ENERGYSTAR} kWh = Power_{ENERGYSTAR} * HOURS_{day} * Days / 1000$$

Power<sub>ENERGYSTAR</sub> = Custom, otherwise

Cabinet Size	Power (W)
Full Size HFHC	800
¾ Size HFHC	480
½ Size HFHC	320

HOURS<sub>day</sub> = Average Daily Operation  
 = custom or if unknown, use 15 hours

Days = Annual days of operation  
 = custom or if unknown, use 365.25 days a year

<sup>172</sup> Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator.

**For example**, if a full size HFHC is installed the measure would save:

$$\begin{aligned}\Delta\text{kWh} &= (\text{PowerBaseline} * \text{HOURSday} * \text{Days}) / 1000 - (\text{PowerENERGYSTAR} * \text{HOURSday} * \text{Days}) / 1000 \\ &= (2500 * 15 * 365.25) / 1000 - (800 * 15 * 365.25) / 1000 \\ &= 9,314 \text{ kWh}\end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh} / \text{Hours} * \text{CF}$$

Where: Hours = Hoursday \* Days

**For example**, if a full size HFHC is installed in a cafeteria the measure would save:

$$\begin{aligned}&= 9,314 \text{ kWh} / (15 * 365.25) * .39 \\ &= 0.66 \text{ kW}\end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-ESHH-V03-190101**

**REVIEW DEADLINE: 1/1/2023**

## 4.2.10 Ice Maker

### DESCRIPTION

This measure relates to the installation of a new ENERGY STAR qualified or CEE Tier 2 Advanced commercial ice machine. The ENERGY STAR label applied to air-cooled, cube-type machines including ice-making head, self-contained, and remote-condensing units. This measure could relate to the replacing of an existing unit at the end of its useful life, or the installation of a new system in a new or existing building.

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a new commercial ice machine meeting the minimum ENERGY STAR or CEE Tier 2 Advanced<sup>173</sup> efficiency level standards.

#### ENERGY STAR Requirements (Version 3.0, Effective January 28, 2018)

ENERGY STAR Requirements for Air-Cooled Batch-Type Ice Makers			
Equipment Type	Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)	ENERGY STAR Energy Consumption Rate (kWh/100 lbs ice)	Potable Water Use (gal/100 lbs ice)
IMH	H < 300	≤ 9.20 - 0.01134H	≤ 20.0
	300 ≤ H < 800	≤ 6.49 - 0.0023H	
	800 ≤ H < 1500	≤ 5.11 - 0.00058H	
	1500 ≤ H ≤ 4000	≤ 4.24	
RCU	H < 988	≤ 7.17 – 0.00308H	≤ 20.0
	988 ≤ H ≤ 4000	≤ 4.13	
SCU	H < 110	≤ 12.57 - 0.0399H	≤ 25.0
	110 ≤ H < 200	≤ 10.56 - 0.0215H	
	200 ≤ H ≤ 4000	≤ 6.25	
ENERGY STAR Requirements for Air-Cooled Continuous-Type Ice Makers			
Equipment Type	Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)	ENERGY STAR Energy Consumption Rate (kWh/100 lbs ice)	Potable Water Use (gal/100 lbs ice)
IMH	H < 310	≤ 7.90 – 0.005409H	≤ 15.0
	310 ≤ H < 820	≤ 7.08 – 0.002752H	
	820 ≤ H ≤ 4000	≤ 4.82	
RCU	H < 800	≤ 7.76 – 0.00464H	≤ 15.0
	800 ≤ H ≤ 4000	≤ 4.05	
SCU	H < 200	≤ 12.37 – 0.0261H	≤ 15.0
	200 ≤ H < 700	≤ 8.24 – 0.005429H	
	700 ≤ H ≤ 4000	≤ 4.44	

<sup>173</sup> Consortium of Energy Efficiency (CEE) High Efficiency Specifications for Commercial Ice Makers, Effective Date 7/1/2011, updated 7/7/2015.

CEE Tier 2 Advanced Requirements for Air Cooled Ice Makers			
Equipment Type	Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)	ENERGY STAR Energy Consumption Rate (kWh/100 lbs ice)	Potable Water Use (gal/100 lbs ice)
All	<175	14 – 0.0347H	≤30
	≥175 and <450	9.6 – 0.0098H	≤20
	≥450 and <1000	5.9 – 0.0016H	≤20
	≥1000	4.5 – 0.0002H	≤20

**DEFINITION OF BASELINE EQUIPMENT**

In order for this characterization to apply, the baseline equipment is assumed to be a commercial ice machine meeting federal equipment standards established January 28, 2018.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 9 years.<sup>174</sup>

**DEEMED MEASURE COST**

When available, the actual cost of the measure installation and equipment shall be used. The incremental capital cost for this measure is \$0 for Batch-Type, Continuous-Type, and CEE Tier 2 ice makers<sup>175</sup>.

**LOADSHAPE**

Loadshape C23 - Commercial Refrigeration

**COINCIDENCE FACTOR**

The Summer Peak Coincidence Factor is assumed to equal 0.937.

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = [(kWh_{base} - kWh_{ee}) / 100] * (DC * H) * 365.25$$

Where:

$kWh_{base}$  = maximum kWh consumption per 100 pounds of ice for the baseline equipment  
 = calculated as shown in the table below using the actual Harvest Rate (H) of the efficient equipment<sup>176</sup>.

$kWh_{ee}$  = maximum kWh consumption per 100 pounds of ice for the efficient equipment  
 = calculated as shown in the table below using the actual Harvest Rate (H) of the efficient equipment.

---

<sup>174</sup> Based on DOE Technical Support Document, 2014 as recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

<sup>175</sup> Incremental costs from ENERGY STAR Commercial Kitchen Equipment Savings Calculator. Calculator cites EPA research using AutoQuotes, 2016.

<sup>176</sup> Use the appropriate equipment type baseline and ice harvest rate range when calculating the savings for a CEE Tier Advanced ice maker.

Energy Consumption of Air-Cooled Batch-Type Ice Makers			
Ice Maker Type	Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)	kWh <sub>Base</sub>	kWh <sub>ESTAR</sub>
IMH	H < 300	10-0.01233H	≤ 9.20 - 0.01134H
	300 ≤ H < 800	7.05-0.0025H	≤ 6.49 - 0.0023H
	800 ≤ H < 1500	5.55-0.00063H	≤ 5.11 - 0.00058H
	1500 ≤ H ≤ 4000	4.61	≤ 4.24
RCU	H < 988	7.97-0.00342H	≤ 7.17 – 0.00308H
	988 ≤ H ≤ 4000	4.59	≤ 4.13
SCU	H < 110	14.79-0.0469H	≤ 12.57 - 0.0399H
	110 ≤ H < 200	12.42-0.02533H	≤ 10.56 - 0.0215H
	200 ≤ H ≤ 4000	7.35	≤ 6.25
Energy Consumption of Air-Cooled Continuous-Type Ice Makers			
Equipment Type	Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)	kWh <sub>Base</sub>	kWh <sub>ESTAR</sub>
IMH	H < 310	9.19-0.00629H	≤ 7.90 – 0.005409H
	310 ≤ H < 820	8.23-0.0032H	≤ 7.08 – 0.002752H
	820 ≤ H ≤ 4000	5.61	≤ 4.82
RCU	H < 800	9.7-0.0058H	≤ 7.76 – 0.00464H
	800 ≤ H ≤ 4000	5.06	≤ 4.05
SCU	H < 200	14.22-0.03H	≤ 12.37 – 0.0261H
	200 ≤ H < 700	9.47-0.00624H	≤ 8.24 – 0.005429H
	700 ≤ H ≤ 4000	5.1	≤ 4.44
CEE Tier 2 Advanced Requirements for Air Cooled Ice Makers			
Equipment Type	Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)	ENERGY STAR Energy Consumption Rate (kWh/100 lbs ice)	
All	<175	14 – 0.0347H	
	≥175 and <450	9.6 – 0.0098H	
	≥450 and <1000	5.9 – 0.0016H	
	≥1000	4.5 – 0.0002H	

- 100 = conversion factor to convert kWh<sub>base</sub> and kWh<sub>est</sub> into maximum kWh consumption per pound of ice.
- DC = Duty Cycle of the ice machine  
= 0.57<sup>177</sup>
- H = Harvest Rate (pounds of ice made per day)  
= Actual installed

<sup>177</sup>Duty cycle varies considerably from one installation to the next. TRM assumptions from Vermont, Wisconsin, and New York vary from 40 to 57%, whereas the ENERGY STAR Commercial Ice Machine Savings Calculator assumes a value of 75%. A field study of eight ice machines in California indicated an average duty cycle of 57% (“A Field Study to Characterize Water and Energy Use of Commercial Ice-Cube Machines and Quantify Saving Potential”, Food Service Technology Center, December 2007). Furthermore, a report prepared by ACEEE assumed a value of 40% (Nadel, S., Packaged Commercial Refrigeration Equipment: A Briefing Report for Program Planners and Implementers, ACEEE, December 2002). The value of 57% was utilized since it appears to represent a high quality data source.



365.35 = days per year

**For example**, a batch ice machine with an ice making head producing 450 pounds of ice would save

$$\begin{aligned} \Delta \text{kWh} &= [(5.9 - 5.5) / 100] * (0.57 * 450) * 365.25 \\ &= 440 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta \text{kW} = \Delta \text{kWh} / (\text{HOURS} * \text{DC}) * \text{CF}$$

Where:

$$\begin{aligned} \text{HOURS} &= \text{annual operating hours} \\ &= 8766^{178} \end{aligned}$$

$$\text{CF} = 0.937$$

**For example**, an ice machine with an ice making head producing 450 pounds of ice would save

$$\begin{aligned} \Delta \text{kW} &= 440 / (8766 * 0.57) * .937 \\ &= 0.083 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

While the ENERGY STAR labeling criteria require that certified commercial ice machines meet certain “maximum potable water use per 100 pounds of ice made” requirements, such requirements are intended to prevent equipment manufacturers from gaining energy efficiency at the cost of water consumptions. A review of the AHRI Certification Directory<sup>179</sup> indicates that approximately 81% of air-cooled, cube-type machines meet the ENERGY STAR potable water use requirement. Therefore, there are no assumed water impacts for this measure.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-ESIM-V04-210101**

**REVIEW DEADLINE: 1/1/2024**

<sup>178</sup>Unit is assumed to be connected to power 24 hours per day, 365.25 days per year.

<sup>179</sup>AHRI Certification Directory, Automatic Commercial Ice Makers, Accessed on 7/7/10.

## 4.2.11 High Efficiency Pre-Rinse Spray Valve

### DESCRIPTION

Pre-rinse spray valves use a spray of water to remove food waste from dishes prior to cleaning in a dishwasher. More efficient spray valves use less water thereby reducing water consumption, water heating cost, and waste water (sewer) charges. Pre-rinse spray valves include a nozzle, squeeze lever, and dish guard bumper. Pre-rinse spray valves are manually operated, and the frequency of use depends on the volume of dirty dishes washed at a facility. The primary impacts of this measure are water savings. Reduced hot water consumption saves either natural gas or electricity, depending on the type of energy the hot water heater uses.

This measure was developed to be applicable to the following program types: TOS, EREP, KITS and DI. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the new or replacement pre-rinse spray nozzle must have a maximum flow rate that meets program requirements.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment flow rate depends on program type. For TOS, the baseline equipment is a new pre-rinse spray valve with a maximum flow rate of 1.23 gpm or less.<sup>180</sup> For EREP and DI, the baseline equipment is an existing pre-rinse spray valve with an assumed flow rate of 2.14 gpm or less.<sup>181</sup>

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 5 years.<sup>182</sup>

### DEEMED MEASURE COST

When available, the actual cost of the measure (including labor where applicable) should be used. If unknown, the incremental cost of this measure for TOS programs is assumed to be \$0.<sup>183</sup> For EREP, KITS and DI programs, the total installed cost is assumed to be \$54.<sup>184</sup>

### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

### COINCIDENCE FACTOR

N/A

---

<sup>180</sup> Baseline for TOS programs is calculated using the maximum flow rate for each product class in 10 CFR 431.266, Energy Efficiency Program for Certain Commercial and Industrial Equipment weighted by estimated 2018 shipments for each product class from Table 3.6.1: U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015.

<sup>181</sup> Average flow rate of spray valve replaced through direct install programs from DNV-GL, "Impact Evaluation of National Grid Rhode Island C&I Prescriptive Gas Pre-Rinse Spray Valve Measure – Final Report," September 30, 2014, page 6-6.

<sup>182</sup> Measure life from U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015, page 8-13."

<sup>183</sup> Incremental measure cost based on U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015, page 8-1.

<sup>184</sup> Total installed cost is the manufacturer selling price (\$35.40) from Table 8.2.1 multiplied by the retailer markup (1.52) from Table 8.2.2: U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015. It is assumed that programs typically install spray valves only when other kitchen equipment is also being installed, and therefore, there are no additional labor costs associated with spray valve installations.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS (NOTE WATER SAVINGS MUST FIRST BE CALCULATED)**

$$\Delta kWh = \Delta Water \text{ (gallons)} * 8.33 * 1 * (Tout - Tin) * (1/EFF\_Elec) / 3,412 * FLAG$$

Where:

- $\Delta Water$  (gallons) = amount of water saved as calculated below
- 8.33 = specific mass in pounds of one gallon of water (lbm/gal)
- 1 = Specific heat of water: 1 Btu/lbm/°F
- Tout = Water Heater Outlet Water Temperature  
= custom, otherwise assume Tin + 70°F temperature rise from Tin<sup>185</sup>
- Tin = Inlet Water Temperature  
= custom, otherwise assume 54.1 °F<sup>186</sup>
- EFF\_Elec = Efficiency of electric water heater supplying hot water to pre-rinse spray valve  
= custom, otherwise assume 98%<sup>187</sup>
- Flag = 1 if electric or 0 if gas

**Time of Sale: For example**, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishments with a cafeteria with 70 degree temperature rise of water used by the pre-rinse spray valve that is heated by electric hot water saves annually :

$$\begin{aligned} \Delta kWh &= 14,040 \times 8.33 \times 1 \times ((70+54.1) - 54.1) \times (1/.98) / 3,412 \times 1 \\ &= 2,448 kWh \end{aligned}$$

**Retrofit: For example**, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 2.14 gal/min flow at a large institutional establishments with a cafeteria with 70 degree temperature rise of water used by the pre-rinse spray valve that is heated by electric hot water equals:

$$\begin{aligned} \Delta kWh &= 65,146 \times 8.33 \times 1 \times ((70+ 54.1) - 54.1) \times (1/.98) / 3,412 \times 1 \\ &= 11,360 kWh \end{aligned}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water \text{ total}}$$

Where:

<sup>185</sup>If unknown, assume a 70 degree temperature rise from Tin per Food Service Technology Center calculator assumptions to account for variations in mixing and water heater efficiencies.

<sup>186</sup>August 31, 2011 Memo of Savings for Hot Water Savings Measures to Nicor Gas from Navigant states that 54.1°F was calculated from the weighted average of monthly water mains temperatures reported in the 2010 Building America Benchmark Study for Chicago-Waukegan, Illinois.

<sup>187</sup> Electric water heaters have recovery efficiency of 98%, as sourced from available products on the AHRI Certification Directory.

$$\begin{aligned}
 E_{\text{water total}} &= \text{IL Total Water Energy Factor (kWh/Million Gallons)} \\
 &= 5,010 \text{ for measures installed in all areas except Cook County }^{188} \\
 &= 2,937 \text{ for measures installed in Cook County }^{189,190}
 \end{aligned}$$

**Time of Sale:** For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishment with a cafeteria equals

$$\begin{aligned}
 \Delta \text{Water (gallons)} &= (1.23 - 0.98) * 60 * 3 * 312 \\
 &= 14,040 \text{ gal/yr} \\
 \Delta \text{kWh}_{\text{water}} &= 14,040 / 1,000,000 * 5,010 \\
 &= 70 \text{ kWh}
 \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{Therms} = \Delta \text{Water (gallons)} * 8.33 * 1 * (T_{\text{out}} - T_{\text{in}}) * (1/\text{EFF}_{\text{Gas}}) / 100,000 * (1 - \text{FLAG})$$

Where (new variables only):

$$\begin{aligned}
 \text{EFF}_{\text{Gas}} &= \text{Efficiency of gas water heater supplying hot water to pre-rinse spray valve} \\
 &= \text{custom, otherwise assume } 80\%^{191}
 \end{aligned}$$

<sup>188</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>189</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>190</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

<sup>191</sup> IECC 2012/2015, Table C404.2, Minimum Performance of Water-Heating Equipment

**Time of Sale:** For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishments with a cafeteria with 70 degree temperature of water used by the pre-rinse spray valve that is heated by fossil fuel hot water saves annually:

$$\begin{aligned} \Delta\text{Therms} &= 14,040 \times 8.33 \times 1 \times ((70+54.1) - 54.1) \times (1/.80)/100,000 \times (1-0) \\ &= 102 \text{ Therms} \end{aligned}$$

**Retrofit:** For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 2.14 gal/min flow at a busy large institutional establishments with a cafeteria with 70 degree temperature rise of water used by the pre-rinse spray valve that is heated by fossil fuel hot water saves annually:

$$\begin{aligned} \Delta\text{Therms} &= 65,146 \times 8.33 \times 1 \times ((70+54.1) - 54.1) \times (1/.80)/100,000 \times (1-0) \\ &= 475 \text{ Therms} \end{aligned}$$

**WATER IMPACT CALCULATION<sup>192</sup>**

$$\Delta\text{Water (gallons)} = (\text{FLObase} - \text{FLOeff}) * 60 * \text{HOURSday} * \text{DAYYear}$$

Where:

FLObase = Base case flow in gallons per minute, or custom (Gal/min)

Time of Sale	Direct Install
1.23 gal/min <sup>193</sup>	2.14 gal/min <sup>194</sup>

FLOeff = Efficient case flow in gallons per minute or custom (Gal/min)  
= 0.98 gal/min<sup>195</sup>

60 = Minutes per hour

HOURSday = Hours per day that the pre-rinse spray valve is used at the site, custom, otherwise:<sup>196</sup>

Application	Hours/day
Small, quick- service restaurants	1
Medium-sized casual dining restaurants	1.5
Large institutional establishments with cafeteria	3

DAYYear = Days per year pre-rinse spray valve is used at the site, custom, otherwise 312 days/yr based on assumed 6 days/wk x 52 wk/yr = 312 day/yr.

<sup>192</sup>In order to calculate energy savings, water savings must first be calculated

<sup>193</sup>Baseline for TOS programs is calculated using the maximum flow rate for each product class in 10 CFR 431.266, Energy Efficiency Program for Certain Commercial and Industrial Equipment weighted by estimated 2018 shipments for each product class from Table 3.6.1: U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015.

<sup>194</sup> Average flow rate of spray valve replaced through direct install programs from DNV-GL, "Impact Evaluation of National Grid Rhode Island C&I Prescriptive Gas Pre-Rinse Spray Valve Measure – Final Report," September 30, 2014, page 6-6.

<sup>195</sup> A new pre-rinse spray valve is assumed to be 20% more efficient than the federal standard.

<sup>196</sup> Hours primarily based on PG& E savings estimates, algorithms, sources (2005), Food Service Pre-Rinse Spray Valves with review of 2010 Ohio Technical Reference Manual and Act on Energy Business Program Technical Resource Manual Rev05.

**Time of Sale:** For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishment with a cafeteria equals

$$= (1.23 - 0.98) * 60 * 3 * 312$$

$$= 14,040 \text{ gal/yr}$$

**Retrofit:** For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 2.14 gal/min flow at a large institutional establishments with a cafeteria equals

$$= (2.14 - 0.98) * 60 * 3 * 312$$

$$= 65,146 \text{ gal/yr}$$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-SPRY-V07-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.2.12 Infrared Charbroiler

### DESCRIPTION

This measure applies to natural gas fired charbroilers that utilize infrared burners installed in a commercial kitchen. This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas charbroiler with infrared burners.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas charbroiler without infrared burners.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>197</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$2173.<sup>198</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---



---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS ENERGY SAVINGS

Custom calculation below, otherwise use deemed value of 707 therms based on default values.<sup>199</sup>

$$\Delta Therms = \frac{(\Delta PreheatEnergy + \Delta CookingEnergy) * Days}{100,000}$$

---

<sup>197</sup> Lifecycle determined from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment.

<sup>198</sup> See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

<sup>199</sup> Assumptions derived from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment, Section 4: Broilers.

$$\Delta\text{PreheatEnergy} = (\text{PreheatRate}_{\text{Base}} - \text{PreheatRate}_{\text{EE}}) * \text{Preheats} * \frac{\text{PreheatTime}}{60}$$

$$\Delta\text{CookingEnergy} = (\text{InputRate}_{\text{Base}} - \text{InputRate}_{\text{EE}}) * (\text{Duty} * \text{Hours})$$

Where:

- Days = Annual days of operation  
= Custom or if unknown, use 312 days per year<sup>200</sup>
- 100,000 = Btu to therms conversion factor
- PreheatRate<sub>Base</sub> = Preheat energy rate of baseline charbroiler  
= 64,000 Btu/hr
- PreheatRate<sub>EE</sub> = Preheat energy rate of infrared charbroiler  
= Custom or if unknown, use 54,000 Btu/hr
- Preheats = Number of preheats per day  
= Custom or if unknown, use 1 preheat per day
- PreheatTime = Length of one preheat  
= Custom or if unknown, use 15 minutes per preheat<sup>201</sup>
- 60 = Minutes to hours conversion factor
- InputRate<sub>Base</sub> = Input energy rate of baseline charbroiler  
= 140,000 Btu/hr
- InputRate<sub>EE</sub> = Input energy rate of infrared charbroiler  
= Custom or if unknown, use 105,000 Btu/hr
- Duty = Duty cycle of charbroiler (%)  
= Custom or if unknown, use 80%<sup>202</sup>
- Hours = Average daily hours of operation  
= Custom or if unknown, use 8 hours per day

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-IRCB-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>200</sup>Typical annual operating time from FSTC Broiler Technology Assessment, Table 4.3.

<sup>201</sup>Typical preheat time from FSTC Broiler Technology Assessment.

<sup>202</sup> Duty cycle from FSTC Broiler Technology Assessment, Table 4.3.



### 4.2.13 Infrared Rotisserie Oven

**DESCRIPTION**

This measure applies to natural gas fired high efficiency rotisserie ovens utilizing infrared burners and installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

To qualify for this measure the installed equipment must be a new natural gas rotisserie oven with infrared burners.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment is an existing natural gas rotisserie oven without infrared burners.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 12 years.<sup>203</sup>

**DEEMED MEASURE COST**

The incremental capital cost for this measure is \$2665.<sup>204</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

Custom calculation below based on Food Service Technology Center calculator, otherwise use deemed value of 599 therms, based on default values.

$$\Delta Therms = \frac{(InputRate_{Base} - InputRate_{EE}) * (Duty * Hours)}{100,000}$$

Where:

---

<sup>203</sup>Lifecycle determined from Food Service Technology Center Gas Oven Life-Cycle Cost Calculator.

<sup>204</sup>See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

InputRate<sub>Base</sub> = Energy input rate of baseline rotisserie oven (Btu/hr)  
= Custom of if unknown, use 90,000 Btu/hr<sup>205</sup>

InputRate<sub>EE</sub> = Energy input rate of infrared rotisserie oven (Btu/hr)  
= Custom of if unknown, use 50,000 Btu/hr<sup>206</sup>

Duty = Duty cycle of rotisserie oven (%)  
= Custom or if unknown, use 60%<sup>207</sup>

Hours = Typical operating hours of rotisserie oven  
= Custom or if unknown, use 2,496 hours<sup>208</sup>

100,000 = Btu to therms conversion factor

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-IROV-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>205</sup> Median rated energy input for rotisserie ovens from FSTC Oven Technology Assessment, Section 7: Ovens, Table 7.2.

<sup>206</sup> Infrared energy input rate calculated based on efficient energy input rate of 50,000 Btu/hr, baseline cooking efficiency of 25%, and infrared cooking efficiency of 45%. Efficiencies and rates derived from FSTC Gas Rotisserie Oven Test Reports and FSTC Oven Technology Assessment.

<sup>207</sup> Duty cycle from Food Service Technology Center Oven Technical Assessment, Table 7.2.

<sup>208</sup> Typical operating hours based on oven operating schedule of 8 hours per day, 6 days per week, 52 weeks per year, provided in Food Service Technology Center Oven Technical Assessment, Table 7.2.

## 4.2.14 Infrared Salamander Broiler

### DESCRIPTION

This measure applies to natural gas fired high efficiency salamander broilers utilizing infrared burners installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas salamander broiler with infrared burners

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas salamander broiler without infrared burners

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>209</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$1,000.<sup>210</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS ENERGY SAVINGS

Custom calculation below based on Food Service Technology Center calculator, otherwise use deemed value of 240 therms, based on defaults.

$$\Delta Therms = \frac{(InputRate_{Base} - InputRate_{EE}) * (Duty * Hours)}{100,000}$$

---

<sup>209</sup> Lifecycle determined from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment.

<sup>210</sup>See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

Where:

InputRate <sub>Base</sub>	= Rated energy input rate of baseline salamander broiler (Btu/hr) = 38,500 Btu/hr <sup>211</sup>
InputRate <sub>EE</sub>	= Rated energy input rate of infrared salamander broiler (Btu/hr) = Custom; or if unknown, use 24,750 Btu/hr <sup>212</sup>
Duty	= Duty cycle of salamander broiler (%) = Custom; or if unknown, use 70% <sup>213</sup>
Hours	= Typical operating hours of salamander broiler = Custom; or if unknown, use 2,496 hours <sup>214</sup>
100,000	= Btu to therms conversion factor

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-IRBL-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>211</sup> Median rated energy input for salamander broilers from FSTC Broiler Technology Assessment, Section 4: Broilers, Table 4.3.

<sup>212</sup> Calculated energy input rate based on baseline energy input rate of 38,500 Btu/hr, baseline cooking efficiency of 22.5%, and infrared cooking efficiency of 35%.

<sup>213</sup> Duty cycle from Food Service Technology Center Broiler Technical Assessment, Table 4.3.

<sup>214</sup> Typical operating hours based on broiler operating schedule of 8 hours per day, 6 days per week, 52 weeks per year, provided in Food Service Technology Center Broiler Technical Assessment, Table 4.3.

## 4.2.15 Infrared Upright Broiler

### DESCRIPTION

This measure applies to natural gas fired high efficiency upright broilers utilizing infrared burners and installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas upright broiler with infrared burners.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas upright broiler without infrared burners.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>215</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$4,400.<sup>216</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---



---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS ENERGY SAVINGS

Custom calculation below based on Food Service Technology Center calculator, otherwise use deemed value of 943 therms based on default values.

$$\Delta Therms = \frac{(InputRate_{Base} - InputRate_{EE}) * (Duty * Hours)}{100,000}$$

Where:

---

<sup>215</sup> Lifecycle determined from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment.

<sup>216</sup>See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

InputRate <sub>Base</sub>	= Rated energy input rate of baseline upright broiler (Btu/hr) = 144,000 Btu/hr <sup>217</sup>
InputRate <sub>EE</sub>	= Rated energy input rate of infrared upright broiler (Btu/hr) = Custom; or if unknown, use 90,000 Btu/hr <sup>218</sup>
Duty	= Duty cycle of upright broiler (%) = Custom; or if unknown, use 70% <sup>219</sup>
Hours	= Typical operating hours of upright broiler = Custom; or if unknown, use 2,496 hours <sup>220</sup>
100,000	= Btu to therms conversion factor

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-IRUB-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>217</sup> Baseline energy input rate calculated based on efficient energy input rate of 90,000 Btu/hr, baseline cooking efficiency of 25%, and infrared cooking efficiency of 40%.

<sup>218</sup> Median rated energy input for upright broilers from FSTC Broiler Technology Assessment, Section 4.0: Broiler, Table 4.3.

<sup>219</sup> Duty cycle from Food Service Technology Center Broiler Technical Assessment, Table 4.3.

<sup>220</sup> Typical operating hours based on broiler operating schedule of 8 hours per day, 6 days per week, 52 weeks per year, provided in Food Service Technology Center Broiler Technical Assessment, Table 4.3.

## 4.2.16 Kitchen Demand Ventilation Controls

### DESCRIPTION

Installation of commercial kitchen demand ventilation controls that vary the ventilation based on cooking load and/or time of day.

IECC 2018 specifies that Kitchen Demand Control Ventilation is a mandatory compliance pathway for systems over 5,000 CFM of exhaust airflow. As stated, each kitchen exhaust hood shall comply with one of the following:

- Not < 50% of all replacement air shall be transfer air that would otherwise be exhausted.
- Demand ventilation systems on not < 75% of the exhaust air that are configured to provide not less than 50% reduction in exhaust and replacement air system airflow rates including controls necessary to modulate airflow in response to appliance operation and maintain full capture and containment of smoke, effluent, and combustion products during cooking and idle.
- Listed energy recovery devices with a sensible heat recovery effectiveness not < 40% on not < 50% of the total exhaust airflow.

If one of these alternate compliance options is met, kitchen demand ventilation controls would not be required by code; however, in these situations the demand ventilation controls would be considered redundant and the energy savings would likely be reduced. As a result, this measure is only applicable to new kitchens/systems under 5,000 CFM of exhaust airflow.

This measure was developed to be applicable to the following program types: NC, RF, TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a control system that varies the exhaust rate of kitchen ventilation (exhaust and/or makeup air fans) based on the energy and effluent output from the cooking appliances (i.e., the more heat and smoke/vapors generated, the more ventilation needed). There are three main demand control ventilation systems available that can achieve this type of modulation:

- Temperature sensors only. These systems ramp ventilation up and down based solely on the temperature from the cooking activity as measured in the ductwork or capture tank of the hood.
- Temperature and optical sensors. These systems offer the same functionality as systems with only temperature sensors plus the ability to change the ventilation rate based on the presence of smoke or steam.
- Temperature and infrared cooking sensors. These systems offer the same functionality as systems with only temperature sensors plus the ability to measure ventilation up and down based on when cooking starts.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is kitchen ventilation that has constant speed ventilation motor.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>221</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is:<sup>222</sup>

---

<sup>221</sup> “Commercial Kitchen Ventilation: An Energy Efficiency Program Administrator’s Guide to Demand Control Ventilation”, CEE, October 2010 (pg. 9). The 20-year measure life estimate is based on interviews with manufacturer and industry experts.

<sup>222</sup> The incremental costs were derived from Southern California Edison (SCE) program data on 72 demand control kitchen ventilation project installations between 2013 and 2017 (see;

Measure Category	Incremental Cost \$/HP of fan
DVC Control Retrofit	\$1,992
DVC Control New	\$1,180

**LOADSHAPE**

Loadshape C23 - Commercial Ventilation

**COINCIDENCE FACTOR**

The measure has deemed peak kW savings therefore a coincidence factor does not apply.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

Annual energy use was based on monitoring results from five different types of sites, as summarized in PG&E Food Service Equipment work paper.

**ELECTRIC ENERGY SAVINGS**

kWh savings are assumed to be 4966 kWh per horsepower of the fan.<sup>223</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

kW savings are assumed to be 0.68 kW per horsepower of the fan.<sup>224</sup>

**NATURAL GAS ENERGY SAVINGS**

$$\Delta\text{Therms} = \text{CFM} * \text{HP} * \text{Annual Heating Load} / (\text{Eff}(\text{heat}) * 100,000)$$

Where:

CFM = the average airflow reduction with ventilation controls per hood  
 = 430 cfm/HP<sup>225</sup>

HP = actual if known, otherwise assume 7.75 HP<sup>226</sup>

Annual Heating Load = Annual heating energy required to heat fan exhaust make-up air, Btu/cfm dependent on location:<sup>227</sup>

---

“SCE13CC008\_ Exhaust\_Hood\_DCKV\_Exhaust\_CFM\_and\_Cost\_Field\_Data.xlsx”). For reference, the baseline measure costs were factored out accordingly, being obtained from costs for five kitchen exhaust fans from RSMeans online in 2017. For more detail on the source of these cost estimates, please see the California eTRM – Exhaust Hood Demand Controlled Ventilation, Commercial measure (SWFS012-01), March 4, 2020.

<sup>223</sup> Based on data provided in PGE Workpaper, Commercial Kitchen Demand Ventilation Controls, PGECOFST116, June 1, 2009. See ‘Kitchen DCV.xls’ for details.

<sup>224</sup> Based on data provided in PGE Workpaper, Commercial Kitchen Demand Ventilation Controls, PGECOFST116, June 1, 2009. See ‘Kitchen DCV.xls’ for details.

<sup>225</sup> Based on data provided in PGE Workpaper, Commercial Kitchen Demand Ventilation Controls, PGECOFST116, June 1, 2009. See ‘Kitchen DCV.xls’ for details.

<sup>226</sup> Average of units in PGE Workpaper, Commercial Kitchen Demand Ventilation Controls, PGECOFST116, June 1, 2009.

<sup>227</sup> Food Service Technology Center Outside Air Load Calculator, with inputs of one cfm, and hours from Commercial Kitchen Demand Ventilation Controls (Average 17.8 hours a day 4.45 am to 10.30 pm). Savings for Rockford, Chicago, and Springfield were obtained from the calculator; values for Belleview and Marion were obtained by using the average savings per HDD from the other values.



Zone	Annual Heating Load, Btu/cfm
1 (Rockford)	154,000
2-(Chicago)	144,000
3 (Springfield)	132,000
4-(Belleville)	102,000
5-(Marion)	104,000

Eff(heat) = Heating Efficiency  
 = actual if known, otherwise assume 80%<sup>228</sup>  
 100,000 = conversion from Btu to Therm

**For example**, a kitchen hood in Rockford, IL with a 7.75 HP ventilation motor  
 $\Delta$ Therms =  $430 * 7.75 * 154,000 / (0.80 * 100,000)$   
 = 6,415 Therms

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-VENT-V04-210101**

**REVIEW DEADLINE: 1/1/2025**

<sup>228</sup>Work Paper WPRRSGNGRO301 CLEAResult "Boiler Tune-Up" which cites Focus on Energy Evaluation Business Programs: Deemed Savings Manual V1.0, PA Consulting, KEMA, March 22, 2010.

## 4.2.17 Pasta Cooker

### DESCRIPTION

This measure applies to natural gas fired dedicated pasta cookers as determined by the manufacturer and installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas fired pasta cooker.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas fired stove where pasta is cooked in a pan.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12.<sup>229</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$2,400.<sup>230</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS ENERGY SAVINGS

The annual natural gas energy savings from this measure is a deemed value equaling 1380 Therms.<sup>231</sup>

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

---

<sup>229</sup>See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

<sup>230</sup>Ibid.

<sup>231</sup> See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-FSE-PCOK-V02-180101**

**REVIEW DEADLINE: 1/1/2024**

## 4.2.18 Rack Oven - Double Oven

### DESCRIPTION

This measure applies to natural gas fired high efficiency rack oven - double oven installed in a commercial kitchen. This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas rack oven - double oven with a baking efficiency  $\geq 50\%$  utilizing ASTM standard 2093.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas rack oven – double oven with a baking efficiency  $< 50\%$ .

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>232</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$3,000.<sup>233</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---



---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS ENERGY SAVINGS

Custom calculation below, otherwise use deemed value of 1930 therms based on default values.<sup>234</sup>

$$\Delta Therms = InputRate * (BakingEfficiency_{EE} - BakingEfficiency_{Base}) * Duty * Hours * \frac{1}{100,000}$$

---

<sup>232</sup> Lifecycle determined from Food Service Technology Center Gas Rack Oven Life-Cycle Cost Calculator and from FSTC Oven Technology Assessment.

<sup>233</sup> See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

<sup>234</sup> Assumptions derived from Food Service Technology Center Gas Rack Oven Life-Cycle Cost Calculator, FSTC Oven Technology Assessment, Section 7: Ovens, and from FSTC Gas Double Rack Oven Test Reports.

Where:

InputRate	= Input energy rate of rack oven – double oven = Custom; or if unknown, 275,000 Btu/hr <sup>235</sup>
BakingEfficiency <sub>EE</sub>	= Baking efficiency of energy efficiency rack oven – double oven = Custom; or if unknown, use 55% <sup>236</sup>
BakingEfficiency <sub>Base</sub>	= Baking efficiency of baseline rack oven – double oven = Custom; or if unknown, 30%
Duty	= Duty cycle of double rack oven (%) = Custom; or if unknown, use 75% <sup>237</sup>
Hours	= Average daily hours of operation = Custom; or if unknown, use 3,744 hours <sup>238</sup>
100,000	= Btu to therms conversion factor

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-FSE-RKOV-VO2-180101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>235</sup> Median rated energy input for rack ovens from FSTC Oven Technology Assessment, Section 7: Ovens.

<sup>236</sup> Average baking efficiency of double rack oven from FSTC Gas Double Rack Oven Test Reports.

<sup>237</sup> Duty cycle from FSTC Gas Double Rack Oven Test Reports on various double rack ovens.

<sup>238</sup> Typical operating hours based on oven operating schedule of 12 hours per day, 6 days per week, 52 weeks per year, provided in FSTC Gas Double Rack Oven Test Reports on various double rack ovens.

## 4.2.19 ENERGY STAR Electric Convection Oven

### DESCRIPTION

Commercial convection ovens that are ENERGY STAR certified have higher heavy load cooking efficiencies, and lower idle energy rates, making them on average about 20 percent more efficient than standard models. Energy savings estimates are for ovens using full size (18" x 36") sheet pans.

This measure was developed to be applicable to the following program types; TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be an ENERGY STAR qualified electric convection oven.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a standard convection oven with a heavy load efficiency of 65%.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>239</sup>

### DEEMED MEASURE COST

The incremental cost for this measure is assumed to be \$800 for half size units and \$1,000 for full size.<sup>240</sup>

### LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

### COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>241</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39
Unknown	0.41

<sup>239</sup> Food Service Technology Center (FSTC). Default value from life cycle cost calculator for electric ovens.

<sup>240</sup> Based on data from the Regional Technical Forum for the Northwest Council (Commercial Cooking Convection Oven Calculator, UES Measure Workbook) using actual list prices for 23 units from 2012, see "ComCookingConvectionOven\_v2\_0.xlsm".

<sup>241</sup> Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985. Unknown is an average of other location types.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = kWh_{base} - kWh_{eff}$$

$$kWh = [(LB * E_{FOOD}/EFF) + (IDLE * (HOURS_{DAY} - LB/PC - PRE_{TIME}/60)) + PRE_{ENERGY}] * DAYS$$

Where:

$kWh_{base}$  = the annual energy usage of the baseline equipment calculated using baseline values

$kWh_{eff}$  = the annual energy usage of the efficient equipment calculated using efficient values

$HOURS_{DAY}$  = daily operating hours

= Actual, defaults:

Type of Food Service	$HOURS_{DAY}$ <sup>242</sup>
Fast Food, limited menu	4
Fast Food, expanded menu	5
Pizza	8
Full Service, limited menu	8
Full Service, expanded menu	7
Cafeteria	6
Unknown	6
Custom	Varies

$DAYS$  = Days per year of operation

= Actual, default = 365<sup>243</sup>

$PRE_{TIME}$  = Preheat time (min/day), the amount of time it takes a steamer to reach operating temperature when turned on

= 15 min/day<sup>244</sup>

$E_{FOOD}$  = ASTM Energy to Food (kWh/lb); the amount of energy absorbed by the food during cooking, per pound of food

= 0.0732<sup>245</sup>

$LB$  = pounds of food cooked per day (lb/day)

= Actual, default = 100<sup>246</sup>

$EFF$  = Heavy load cooking energy efficiency (%). See table below.

$IDLE$  = Idle energy rate. See table below.

$PC$  = Production capacity (lbs/hr). See table below.

<sup>242</sup>Ibid.

<sup>243</sup> Food Service Technology Center (FSTC). Default value from life cycle cost calculator for electric ovens.

<sup>244</sup> Food Service Technology Center (2002). *Commercial Cooking Appliance Technology Assessment*. Prepared by Don Fisher. Chapter 7: Ovens.

<sup>245</sup> American Society for Testing and Materials. Industry standard for Commercial Ovens.

<sup>246</sup> Food Service Technology Center (FSTC). Default value from life cycle cost calculator for electric ovens.

PRE<sub>ENERGY</sub> = Preheat energy (kWh/day). See table below.

Performance Metrics: Baseline and Efficient Values

Metric	Baseline Model <sup>247</sup>	Energy Efficient Model <sup>248</sup>
PRE <sub>ENERGY</sub> (kWh)	1.5	1
IDLE (kW)	2	Actual, default = 1.0
EFF	65%	Actual, default = 74%
PC (lb/hr)	70	Actual, default = 79

**For example**, using defaults provided above, the savings for a ENERGY STAR Electric Convection Oven in unknown location are:

$$\begin{aligned} \text{kWh}_{\text{base}} &= [(100 * 0.0732/0.65) + (2 * (6 - 100/70 - 15/60)) + 1.5] * 365 \\ &= 7,813 \text{ kWh} \\ \text{kWh}_{\text{eff}} &= [(100 * 0.0732/0.74) + (1 * (6 - 100/79 - 15/60)) + 1.0] * 365 \\ &= 5,612 \text{ kWh} \\ \Delta\text{kWh} &= \text{kWh}_{\text{base}} - \text{kWh}_{\text{eff}} \\ &= 7,813 - 5,612 \\ &= 2200 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = (\Delta\text{kWh} / (\text{HOURS}_{\text{DAY}} * \text{DAYS})) * \text{CF}$$

Where:

ΔkWh = Annual energy savings (kWh)

CF = Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>249</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39
Unknown	0.41

<sup>247</sup> Ibid.

<sup>248</sup> Average ratings of units on ENERGY STAR qualified list as of 10/2014. Preheat energy is not provided so default is provided based on FSTC life cycle cost calculator.

<sup>249</sup> Minnesota 2012 Technical Reference Manual, version 1.3, Commercial Food Service - Electric Oven and Range, page 138. Unknown is an average of other location types.



**For example**, using defaults provided above, the savings for a ENERGY STAR Electric Convection Oven in unknown location are:

$$\begin{aligned}\Delta kW &= (2200 / (6 * 365)) * 0.41 \\ &= 0.41\end{aligned}$$

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-FSE-ECON-V02-190101**

**REVIEW DEADLINE: 1/1/2022**

## 4.2.20 Efficient Dipper Wells

### DESCRIPTION

Various commercial food establishments utilize dipper wells that continuously run fresh water over utensils. One example is an ice cream shop that places the ice cream scooper in the dipper well, in order to keep them clean and avoid cross-mixing of flavors. Some restaurants may utilize a dipper well to store potato slicers and butter-ball scoopers. Coffee shops often utilize a dipper well for storage of drink thermometers and mixing spoons. Bars may utilize a dipper well for storage of mixing spoons, strainers, ice tongs, and other utensils. Dipper wells may also be found in grocery stores, school cafeterias, and other institutional kitchens.

Commercial kitchen equipment vendors have developed water-efficient dipper well designs which eliminate the continuous water flow. The efficient design recirculates the water in the well rather than continuously adding fresh water. For bacteriological control some designs utilize a chemical disinfectant (i.e., bleach) and some utilize ozone.

The calculated water savings (in gallons/year) will, in turn, be used to calculate electricity savings (in kWh/year) after applying the appropriate energy factor.

Heated dipper wells are not included in this characterization as the electric penalty associated with the electric resistance heating removes all potential electric savings due to water characterization.

This measure was developed to be applicable to the following program types; EREP and TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a dipper well that does not continuously run. One type of water-efficient dipper well design recirculates the water in the basin, rather than continuously adding fresh water. The efficient design will employ chemical or ozone sanitation.

Other types of water-efficient dipper well utilize a spatula or shower, where water is only applied to the surface of the utensil when a pressure switch is activated. The dimensions of water-efficient dipper wells will vary, depending on the number of utensils that need to be handled. The flow rate of the spigot is similar between the baseline equipment and the efficient equipment. However, that flow rate only occurs when the well initially fills up or the pressure switch is activated.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a dipper well providing continuously running fresh water to the utensils in the basin. As a result, there is a concurrent stream of wastewater that is continuously sent to the sewer. The dipper well typically will run during the hours of operation for the restaurant or bar. Some dipper wells will also be left on during the night when the establishment is closed.

Many dipper wells consist of two concentric tanks. Water flows into the inner tank and overflows through the perforations at the top to the outer tank, which is connected to the sewer drain. Other designs utilize just one tank, with some other means of overflow drainage to the sewer.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>250</sup>

---

<sup>250</sup> Alignment with existing dipper well program measure lives in California. Dipper Well Replacement Field Evaluation Report, Frontier Energy, November 2017.

[https://fishnick.com/publications/fieldstudies/Dipper\\_Well\\_Replacement\\_Field\\_Evaluation\\_ICP.pdf](https://fishnick.com/publications/fieldstudies/Dipper_Well_Replacement_Field_Evaluation_ICP.pdf)

**DEEMED MEASURE COST**

The cost for this measure is assumed to be \$450 for Early Replacement or \$300 for Time of Sale. The typical material cost for an efficient dipper well system is approximately \$150 to \$350.<sup>251</sup> The typical material cost for a baseline dipper well system is approximately \$100 to \$200.<sup>252</sup> Full installation costs, including plumbing materials, labor, and any associated controls, should be used for screening purposes.

**LOADSHAPE**

**LOADSHAPE C01 - COMMERCIAL ELECTRIC COOKING**

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

Energy savings from the efficient dipper well systems are the result of reduced water consumption. There are indirect electric energy savings from reduced potable water treatment and wastewater treatment energy inputs.

**ELECTRIC ENERGY SAVINGS**

The electric energy savings are based indirectly on the reduced electricity usage used to provide the potable water and treat the wastewater. By applying an “Energy Factor”, the water savings (in gallons/year) can be converted to electricity savings (in kWh/year). This “Energy Factor” considers the electric energy requirements of potable water treatment plants, potable water distribution, wastewater treatment plants, and wastewater distribution.

$$\Delta\text{kWhwater} = \Delta\text{Water (gallons)} / 1,000,000 * \text{Ewater total}$$

Where:

$$\begin{aligned} \text{Ewater total} &= \text{IL Total Water Energy Factor (kWh/Million Gallons)} \\ &= 5,010 \text{ for measures installed in all areas except Cook County}^{253} \\ &= 2,937 \text{ for measures installed in Cook County}^{254,255} \end{aligned}$$

---

<sup>251</sup> Google Shopping search for the term “water efficient dipper well”. Results include the “ConserveWell” from KaTom Restaurant Supply for \$300.

<sup>252</sup> Google Shopping search for the term “dipper well system”. Results show various baseline models that range from \$100 to \$200.

<sup>253</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>254</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>255</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

**For example,**

$$\begin{aligned}
 \text{BAWU} &= (\text{DWOH} * \text{AO}) / (\text{TFOG} * 1 \text{ hour}/60 \text{ min}) \\
 &= [16 \text{ hours}/\text{day}] * [365 \text{ day}/\text{year}] \\
 &\quad [0.5 \text{ gal}/\text{min}] * [1 \text{ hour}/60 \text{ min}] \\
 &= 175,200 \text{ gal}/\text{year} \\
 \text{ECAWU} &= 3,650 \text{ gal}/\text{year} \\
 \Delta\text{Water} &= \text{BAWU} - \text{ECAWU} \\
 &= 175,200 \text{ gal}/\text{year} - 3,650 \text{ gal}/\text{year} \\
 &= 171,550 \text{ gal}/\text{year} \\
 \Delta\text{kWhwater} &= \Delta\text{Water} / 1,000,000 * E_{\text{water total}} \\
 &= (171,500 \text{ gal. of water}/\text{year}) / 1,000,000 * 5,010 \text{ kWh}/\text{million gallons} \\
 &= 859 \text{ kWh}/\text{year}
 \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

The methodology for quantifying the water savings involves a direct comparison of the baseline equipment to the efficient equipment. The baseline flow rate will typically be between 0.2 gpm to 1.0 gpm.<sup>256</sup> The actual flow rate of the baseline equipment should be directly measured. This can be accomplished by recording the time required to fill a 1-gallon container (minutes per gallon); taking the inverse of that value will give the water flow rate (gallons per minute). The number of hours per day that the spigot remains flowing should be determined. This is typically coincident with the operating hours of the establishment, but the spigot could remain flowing during off hours too.

The equation for calculating the baseline annual water usage is as follows:

$$\text{BAWU} = [\text{DWOH} * \text{AO}] / [\text{TFOG} * (1 \text{ hour}/60 \text{ min})]$$

Where:

- BAWU = Baseline Annual Water Usage (gal/year)
- DWOH = Dipper Well Operating Hours (hours/day)
- AO = Annual Operations (days/year)
- TFOG = Time to Fill One Gallon (min/gal)

Estimating the efficient-case water consumption will require an understanding of how the dipper well will be used. If the efficient-case equipment utilizes a constantly circulating pool of chemically treated water, then the only water consumption is that required to fill the basin. Depending on the number of times that the basin is filled and emptied in a day, the annual water consumption for the efficient case can be calculated as follows:

<sup>256</sup> Michael Slater and Amin Delagah, “Dipper Well Replacement Field Evaluation Report”, Frontier Energy Report #50115-R0, November 2017. Prepared for the Metropolitan Water District of Southern California. <http://www.bewaterwise.com/pdfs/ICP/2015ICP-DipperWellFrontierEnergy.pdf>

$$\text{ECAWU} = \text{BV} * \text{BFPD} * \text{AO}$$

Where:

- ECAWU = Efficient Case Annual Water Usage (gal/year)
- BV = Basin Volume (gal)
- BFPD = Basin Fills Per Day (days-1)
- AO = Annual Operations (days/year)

If the efficient-case equipment utilizes a ‘shower’ that only dispenses water when the pressure switch is activated, the amount of water consumption is dependent on the number of times the ‘shower’ is actuated and the length of each ‘shower’. The Spigot Flow Rate should be similar to that of the baseline equipment (0.2 gal/min to 1.0 gal/min). However, that flow rate is only in effect for the duration that the pressure switch is pressed. This is referred to as the Time of Actuation, and it can generally be estimated as a few seconds per push. Furthermore, the number of times the shower is actuated in a day can be estimated by considering the customer sales volume of the establishment.

The annual water consumption for the efficient case can also be calculated as follows:

$$\text{ECAWU} = (\text{SFR} * \text{TA} * \text{NAPD}) / (60 \text{ sec/min} * \text{AO})$$

Where:

- ECAWU = Efficient Case Annual Water Usage (gal/year)
- SFR = Spigot Flow Rate (gal/min)
- TA = Time of Actuation (sec/push)
- NAPD = Number of Actuators per Day (push/day)
- AO = Annual Operations (days/year)

For the purposes of this measure, the Efficient Case daily water usage of 10 gal/day will be used<sup>257</sup>. At 365 days/year of usage, the ECAWU will be 3,650 gal/year.

Finally, the annual water savings per year can be calculated as follows:

$$\Delta\text{Water} = \text{BAWU} - \text{ECAWU}$$

Where:

- $\Delta\text{Water}$  = Total Water Savings (gal/year)
- BAWU = Baseline Annual Water Usage (gal/year)
- ECAWU = Efficient Case Annual Water Usage (gal/year)

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-FSE-EDIP-V01-200101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>257</sup> Michael Slater and Amin Delagah, “Dipper Well Replacement Field Evaluation Report”, Frontier Energy Report #50115-R0, November 2017. Prepared for the Metropolitan Water District of Southern California. <http://www.bewaterwise.com/pdfs/ICP/2015ICP-DipperWellFrontierEnergy.pdf>

## 4.3 Hot Water

### 4.3.1 Water Heater

#### DESCRIPTION

This measure is for upgrading from minimum code to a high efficiency water heater. Storage water heaters are used to supply hot water for a variety of commercial building types. Storage capacities vary greatly depending on the application. Large consumers of hot water include (but not limited to) industries, hotels/motels and restaurants.

Tankless water heaters function similar to standard hot water heaters except they do not have a storage tank. When there is a call for hot water, the water is heated instantaneously as it passes through the heating element and then proceeds to the user or appliance calling for hot water. Tankless water heaters achieve savings by eliminating the standby losses that occur in stand-alone or tank-type water heaters and by being more efficient than the baseline storage hot water heater.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The minimum specifications of the high efficiency equipment should be defined by the programs.

#### DEFINITION OF BASELINE EQUIPMENT

Time of Sale: The baseline condition is assumed to be a new standard water heater of same type as the existing unit being replaced, meeting the Federal Standard for  $\leq 75,000$  Btuh units and IECC 2018 for all others. If existing type is unknown, assume same water heater type as the efficient unit.

New Construction: The baseline condition is a new standard water heater of the same type as the efficient, meeting the IECC code level in place at the time the building permit was issued. Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

Note the same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units. Definitions of draw pattern are provided below.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor <sup>258</sup>
Residential Gas Storage Water Heaters $\leq 75,000$ Btu/h	$\leq 55$ gallon tanks	Very small	UEF = $0.3456 - (0.0020 * \text{Rated Storage Volume in Gallons})$
		Low	UEF = $0.5982 - (0.0019 * \text{Rated Storage Volume in Gallons})$
		Medium	UEF = $0.6483 - (0.0017 * \text{Rated Storage Volume in Gallons})$
		High	UEF = $0.6920 - (0.0013 * \text{Rated Storage Volume in Gallons})$
	$> 55$ gallon and $\leq 100$ gallon tanks	Very small	UEF = $0.6470 - (0.0006 * \text{Rated Storage Volume in Gallons})$
		Low	UEF = $0.7689 - (0.0005 * \text{Rated Storage Volume in Gallons})$
		Medium	UEF = $0.7897 - (0.0004 * \text{Rated Storage Volume in Gallons})$
		High	UEF = $0.8072 - (0.0003 * \text{Rated Storage Volume in Gallons})$
Residential-duty Commercial High Capacity Storage Gas-Fired Storage Water Heaters $> 75,000$ Btu/h	$\leq 120$ gallon tanks	Very small	UEF = $0.2674 - (0.0009 * \text{Rated Storage Volume in Gallons})$
		Low	UEF = $0.5362 - (0.0012 * \text{Rated Storage Volume in Gallons})$
		Medium	UEF = $0.6002 - (0.0011 * \text{Rated Storage Volume in Gallons})$
		High	UEF = $0.6597 - (0.0009 * \text{Rated Storage Volume in Gallons})$
Commercial Gas Storage Water Heaters	$> 120$ gallon tanks	All	

<sup>258</sup> All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor <sup>258</sup>
>75,000 Btu/h and ≤155,000 Btu/h			80% E <sub>thermal</sub> , Standby Losses = (Q /800 + 110VRated Storage Volume in Gallons)
<u>Commercial</u> Gas Storage Water Heaters >155,000 Btu/h			
Residential Gas Instantaneous Water Heaters ≤ 200,000 Btu/h	≤2 gal	Very low	UEF = 0.80
		All other	UEF = 0.81
<u>Commercial Gas</u> Instantaneous Water Heaters > 200,000 Btu/h	<10 gal	All	80% E <sub>thermal</sub>
	≥10 gal	All	80% E <sub>thermal</sub>
Residential Electric Storage Water Heaters ≤ 75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.8808 – (0.0008 * Rated Storage Volume in Gallons)
		Low	UEF = 0.9254 – (0.0003 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.9307 – (0.0002 * Rated Storage Volume in Gallons)
		High	UEF = 0.9349 – (0.0001 * Rated Storage Volume in Gallons)
	>55 gallon and ≤120 gallon tanks <sup>259</sup>	Very small	UEF = 1.9236 – (0.0011 * Rated Storage Volume in Gallons)
		Low	UEF = 2.0440 – (0.0011 * Rated Storage Volume in Gallons)
		Medium	UEF = 2.1171 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 2.2418 – (0.0011 * Rated Storage Volume in Gallons)
Residential Electric Instantaneous Water Heaters	≤12kW and ≤2 gal	All other	UEF = 0.91
		High	UEF = 0.92
<u>Residential-duty Commercial</u> Electric Instantaneous Water Heaters	> 12kW and ≤58.6 kW and ≤2 gal	All	UEF = 0.80

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below.<sup>260</sup>

Storage Water Heater Draw Pattern	
Draw Pattern	First Hour Rating (gallons)
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	Max GPM
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4
High	≥ 4

<sup>259</sup> It is assumed that tanks <75,000Btu/h and >55 gallons will not be eligible measures due to the high baseline.

<sup>260</sup> Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 15 years for storage units<sup>261</sup>, 5 years for electric tankless,<sup>262</sup> and 20 years for gas tankless.<sup>263</sup>

**DEEMED MEASURE COST**

The full install cost and incremental cost assumptions are provided below. Actual costs should be used where available:

Gas storage water heaters:<sup>264</sup>

Equipment Type	Category	Install Cost	Incremental Cost
Gas Storage Water Heaters ≤ 75,000 Btu/h, ≤55 Gallons	Baseline	\$616	N/A
	Efficient	\$1,055	\$440
Gas Storage Water Heaters > 75,000 Btu/h	0.80 Et	\$4,886	N/A
	0.83 Et	\$5,106	\$220
	0.84 Et	\$5,299	\$413
	0.85 Et	\$5,415	\$529
	0.86 Et	\$5,532	\$646
	0.87 Et	\$5,648	\$762
	0.88 Et	\$5,765	\$879
	0.89 Et	\$5,882	\$996
	0.90 Et	\$6,021	\$1,135

For electric water heaters, the incremental capital cost for this measure is assumed to be:<sup>265</sup>

Tank Size	Incremental Cost
50 gallons	\$1050
80 gallons	\$1050
100 gallons	\$1950

The incremental capital cost for an electric tankless heater this measure is assumed to be:<sup>266</sup>

Output (gpm) at delta T 70	Incremental Cost
5	\$1050
10	\$1050
15	\$1950

<sup>261</sup> DEER 08, EUL\_Summary\_10-1-08.xls.

<sup>262</sup> Ohio Technical Reference Manual 8/2/2010 referencing CenterPoint Energy-Triennial CIP/DSM Plan 2010-2012 Report; Additional reference stating >20 years is sourced from the US DOE Energy Savers for Tankless or Demand-Type Water Heaters.

<sup>263</sup> Ibid.

<sup>264</sup> Cost information is based upon data from “2010-2012 WA017 Ex Ante Measure Cost Study Draft Report”, Itron, February 28, 2014. See “NR HW Heater\_WA017\_MCS Results Matrix - Volume I.xls” for more information.

<sup>265</sup> Act on Energy Commercial Technical Reference Manual, Table 9.6.1-4

<sup>266</sup> Act on Energy Technical Reference Manual, Table 9.6.2-3



The incremental capital cost for a gas fired tankless heater is assumed to be \$2,526.<sup>267</sup>

**LOADSHAPE**

For electric hot water heaters, use Loadshape C02 - Commercial Electric DHW.

**COINCIDENCE FACTOR**

The coincidence factor is assumed to be 0.925.<sup>268</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Electric energy savings are calculated for electric water heaters per the equations given below.

Electric units ≤12 kW:

$$\Delta kWh = \frac{(T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma_{Water} * 1 * \left( \frac{1}{UEF_{elecbase}} - \frac{1}{UEF_{Eff}} \right)}{3412}$$

Where:

T<sub>OUT</sub> = Tank temperature  
 = 125°F

T<sub>IN</sub> = Incoming water temperature from well or municiple system  
 = 54°F<sup>269</sup>

HotWaterUse<sub>Gallon</sub> = Estimated annual hot water consumption (gallons)  
 = Actual if possible to provide reasonable custom estimate. If not, two methodologies are provided to develop an estimate:

1. Consumption per usable storage tank capacity  
 = Capacity \* Consumption/cap

Where:

Capacity = Usable capacity of hot water storage tank in gallons  
 = Actual

Consumption/cap = Estimate of consumption per gallon of usable tank capacity, based on building type.<sup>270</sup>

---

<sup>267</sup>Minnesota Center for Energy and Environment, Low contractor estimate used to reflect less labor required in new construction of venting.

<sup>268</sup> Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.

<sup>269</sup> US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy.

<sup>270</sup> Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL

Building Type <sup>271</sup>	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894

2. Consumption per unit area by building type  
 = (Area/1000) \* Consumption/1,000 sq.ft.

Where:

Area = Area in sq.ft that is served by DHW boiler  
 = Actual

Consumption/1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:<sup>272</sup>

Building Type <sup>273</sup>	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

<sup>271</sup> According to CBECS 2012 “Lodging” buildings include Dormitories, Hotels, Motel or Inns and other Lodging and “Nursing” buildings include Assisted Living and Nursing Homes.

<sup>272</sup> Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtu/h or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

<sup>273</sup> According to CBECS 2012 “Lodging” buildings include Dormitories, Hotels, Motel or Inns and other Lodging and “Nursing” buildings include Assisted Living and Nursing Homes.

$\gamma_{\text{Water}}$  = Specific weight capacity of water (lb/gal)  
 = 8.33 lbs/gal

1 = Specific heat of water (Btu/lb. °F)

$UEF_{\text{elecbase}}$  = Rated efficiency of baseline water heater expressed as Uniform Energy Factor (UEF);

Note the same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor <sup>274</sup>
Residential Electric Storage Water Heaters ≤ 75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.8808 – (0.0008 * Rated Storage Volume in Gallons)
		Low	UEF = 0.9254 – (0.0003 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.9307 – (0.0002 * Rated Storage Volume in Gallons)
		High	UEF = 0.9349 – (0.0001 * Rated Storage Volume in Gallons)
	>55 gallon and ≤120 gallon tanks <sup>275</sup>	Very small	UEF = 1.9236 – (0.0011 * Rated Storage Volume in Gallons)
		Low	UEF = 2.0440 – (0.0011 * Rated Storage Volume in Gallons)
		Medium	UEF = 2.1171 – (0.0011 * Rated Storage Volume in Gallons)
Residential Electric Instantaneous Water Heaters	≤12kW and ≤2 gal	All other	UEF = 0.91
		High	UEF = 0.92
<u>Residential-duty Commercial</u> Electric Instantaneous Water Heaters	> 12kW and ≤58.6 kW and ≤2 gal	All	UEF = 0.80

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below:<sup>276</sup>

Storage Water Heater Draw Pattern	
Draw Pattern	First Hour Rating (gallons)
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	Max GPM
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4
High	≥ 4

$UEF_{\text{eff}}$  = Rated efficiency of efficient water heater expressed as Uniform Energy Factor (UEF)

<sup>274</sup> All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

<sup>275</sup> It is assumed that tanks <75,000Btu/h and >55 gallons will not be eligible measures due to the high baseline.

<sup>276</sup> Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.

3412 = Actual  
 = Converts Btu to kWh

**For example**, for a 200,000 Btu/h, 150 gallon, 90% UEF storage unit with rated standby loss of 1029 BTU/h installed in a 1500 ft<sup>2</sup> restaurant:

$$\Delta kWh = \frac{((125 - 54) * ((1,500/1,000) * 44,439) * 8.33 * 1 * (1/0.8 - 1/0.9))}{3412}$$

$$= 1,605 \text{ kWh}$$

Electric units > 12kW:

$$\Delta kWh = \frac{((T_{out} - T_{air}) * V * \gamma_{Water} * 1 * (SL_{elecbase} - SL_{eff})) * 8766}{3412}$$

T<sub>air</sub> = Ambient Air Temperature  
 = 70°F

V = Rated tank volume in gallons  
 = Actual

SL<sub>elecbase</sub> = Standby loss of electric baseline unit (%/hr)  
 = 0.30 + 27/V

SL<sub>eff</sub> = Nameplate standby loss of new water heater, in BTU/h

8766 = Hours per year

**For example**, >12kW, 100 gallon storage unit with rated standby loss of 0.5 %/hr:

$$SL_{base} = 0.3 + (27 / 100)$$

$$= 0.57\%/hr$$

$$\Delta kWh = \frac{(((125 - 70) * 100 * 8.33 * 1 * (0.57 - 0.5)) * 8766)}{3412}$$

$$= 8,239 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \frac{\Delta kWh}{Hours} * CF$$

Where:

Hours = Full load hours of water heater  
 = 6461<sup>277</sup>

CF = Summer Peak Coincidence Factor for measure  
 = 0.925<sup>278</sup>

<sup>277</sup> Full load hours assumption based on Wh/Max W Ratio from Itron eShape data for Missouri, calibrated to Illinois loads.

<sup>278</sup> Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.

**For example**, >12kW, 100 gallon storage unit with rated standby loss of 0.5 %/hr:

$$\begin{aligned} \Delta kW &= 8,239 / 6,461 * 0.925 \\ &= 1.18 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

Natural gas energy savings are calculated for natural gas storage water heaters per the equations given below.

$$\Delta Therms = \frac{(T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma_{Water} * 1 * \left( \frac{1}{UEF_{gasbase}} - \frac{1}{UEF_{Eff}} \right)}{100,000}$$

Where:

100,000 = Converts Btu to Therms

EF<sub>gasbase</sub> = Rated efficiency of baseline water heater (expressed as Uniform Energy Factor (UEF) or Thermal Efficiency as provided below).

Note the same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor <sup>279</sup>
Residential Gas Storage Water Heaters ≤75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.3456 – (0.0020 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5982 – (0.0019 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6483 – (0.0017 * Rated Storage Volume in Gallons)
		High	UEF = 0.6920 – (0.0013 * Rated Storage Volume in Gallons)
	>55 gallon and ≤100 gallon tanks	Very small	UEF = 0.6470 – (0.0006 * Rated Storage Volume in Gallons)
		Low	UEF = 0.7689 – (0.0005 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.7897 – (0.0004 * Rated Storage Volume in Gallons)
		High	UEF = 0.8072 – (0.0003 * Rated Storage Volume in Gallons)
Residential-duty Commercial High Capacity Storage Gas-Fired Storage Water Heaters > 75,000 Btu/h	≤120 gallon tanks	Very small	UEF = 0.2674 – (0.0009 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5362 – (0.0012 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6002 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 0.6597 – (0.0009 * Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >75,000 Btu/h and ≤155,000 Btu/h	>120 gallon tanks	All	80% E <sub>thermal</sub> , Standby Losses = (Q /800 + 110v/Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >155,000 Btu/h			
Residential Gas Instantaneous Water Heaters ≤ 200,000 Btu/h	≤2 gal	Very low	UEF = 0.80
		All other	UEF = 0.81
Commercial Gas Instantaneous Water Heaters > 200,000 Btu/h	<10 gal	All	80% E <sub>thermal</sub>
	≥10 gal	All	78% E <sub>thermal</sub>

<sup>279</sup> All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below:<sup>280</sup>

Storage Water Heater Draw Pattern	
Draw Pattern	First Hour Rating (gallons)
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	Max GPM
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4

**Additional Standby Loss Savings**

Gas Storage Water Heaters >75,000 Btu/h can claim additional savings due to lower standby losses.

$$\Delta Therms_{Standby} = \frac{(SL_{gasbase} - SL_{eff}) * 8766}{100,000}$$

Where:

- SL<sub>gasbase</sub> = Standby loss of gas baseline unit (Btu/h)  
 =  $Q/800 + 110\sqrt{V}$   
 Q = Nameplate input rating in Btu/h  
 V = Rated volume in gallons
- SL<sub>eff</sub> = Nameplate standby loss of new water heater, in Btu/h
- 8766 = Hours per year

**For example**, for a 200,000 Btu/h, 150 gallon, 90% UEF storage unit with rated standby loss of 1029 BTU/h installed in a 1500 ft<sup>2</sup> restaurant:

$\Delta Therms = ((125 - 54) * ((1,500/1,000) * 44,439) * 8.33 * 1 * (1/0.44 - 1/0.9))/100,000$   
 = 467.8 Therms  
 $\Delta Therms_{Standby} = (((200000/800 + 110 * \sqrt{150}) - 1029) * 8766)/100,000$   
 = 49.8 Therms  
 $\Delta Therms_{Total} = 467.8 + 49.8$   
 = 517.6 Therms

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>280</sup> Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

The deemed O&M cost adjustment for a tankless heaters is \$100.<sup>281</sup>

**MEASURE CODE: CI-HWE-STWH-V06-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>281</sup> Water heaters (WH) require annual maintenance. There are different levels of effort for annual maintenance depending if the unit is gas or electric, tanked or tankless. Electric and gas tank water heater manufacturers recommend an annual tank drain to clear sediments. Also recommended are “periodic” inspections by qualified service professionals of operating controls, heating element and wiring for electric WHs and thermostat, burner, relief valve internal flue-way and venting systems for gas WHs. Tankless WH require annual maintenance by licensed professionals to clean control compartments, burners, venting system and heat exchangers. This information is from WH manufacturer product brochures including GE, Rinnai, Rheem, Takagi and Kenmore. References for incremental O&M costs were not found. Therefore the incremental cost of the additional annual maintenance for tankless WH is estimated at \$100.

## 4.3.2 Low Flow Faucet Aerators

### DESCRIPTION

This measure relates to the direct installation of a low flow faucet aerator in a commercial building. Expected applications include small business, office, restaurant, or motel. Health care-specific inputs are defined for Laminar Flow Restrictor (LFR) devices. For multifamily or senior housing, the residential low flow faucet aerator should be used.

This measure was developed to be applicable to the following program types, DI, KITS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an energy efficient faucet aerator, for bathrooms rated at 1.5 gallons per minute (GPM) or less, or for kitchens rated at 2.2 GPM or less. For LFR devices, the installed equipment must be a device rated at 2.2 GPM or less. Savings are calculated on an average savings per faucet fixture basis.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a standard bathroom faucet aerator rated at 2.25 GPM or more, or a standard kitchen faucet aerator rated at 2.75 GPM or more. For LFR devices, the baseline condition is assumed to be no aerator at all, due to the contamination risk caused by faucet aerators in health care facilities and the baseline flow rate is assumed to be 3.74 GPM<sup>282</sup>. Note if flow rates are measured, for example through a Direct Install program, then actual baseline flow rates should be used as opposed to the deemed values.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>283</sup>

### DEEMED MEASURE COST

The actual full install cost (including labor) for this measure should be used. If unknown assume \$8 for faucet aerators<sup>284</sup> and \$14.27 for LFR devices.<sup>285</sup>

### LOADSHAPE

Loadshape CO2 - Commercial Electric DHW

### COINCIDENCE FACTOR

The coincidence factor for this measure is dependent on building type as presented below.

---

<sup>282</sup> Workpaper WPCSGNRWH150827A, Laminar Flow Restrictors For Hospitals and Health Care Facilities.

<sup>283</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>284</sup> Direct-install price per faucet assumes cost of aerator and install time. (2011, Market research average of \$3 and assess and install time of \$5 (20min @ \$15/hr).

<sup>285</sup> Direct install price per faucet assumes cost of LFR (\$7.27) and install time (\$7) (Southern California Gas Company, Workpaper WPCSGNRWH150827A Revision #0, September, 2015).



**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Note these savings are *per faucet retrofitted*.<sup>286</sup>

$$\Delta kWh = \%ElectricDHW * ((GPM\_base - GPM\_low)/GPM\_base) * Usage * EPG\_electric * ISR$$

Where:

**%ElectricDHW** = proportion of water heating supplied by electric resistance heating

DHW fuel	%Electric_DHW
Electric	100%
Fossil Fuel	0%

**GPM\_base** = Average flow rate, in gallons per minute, of the baseline faucet “as-used”  
 = 1.39,<sup>287</sup> or custom based on metering studies,<sup>288</sup> or, if measured during DI:  
 = Measured full throttle flow \* 0.83 throttling factor<sup>289</sup>  
 Baseline for LFRs<sup>290</sup> = 3.74 \* 0.83 = 3.10

**GPM\_low** = Average flow rate, in gallons per minute, of the low-flow faucet aerator “as-used”  
 = 0.94,<sup>291</sup> or custom based on metering studies,<sup>292</sup> or, if measured during DI:  
 = Rated full throttle flow \* 0.95 throttling factor<sup>293</sup>  
 For LFRs<sup>294</sup> = 2.2 \* 0.95 = 2.09

<sup>286</sup> This algorithm calculates the amount of energy saved per aerator by determining the fraction of water consumption savings for the upgraded fixture. Due to the distribution of water consumption by fixture type, as well as the different number of fixtures in a building, several variables must be incorporated.

<sup>287</sup> DeOreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

<sup>288</sup> Measurement should be based on actual average flow consumed over a period of time rather than a onetime spot measurement for maximum flow. Studies have shown maximum flow rates do not correspond well to average flow rate due to occupant behavior which does not always use maximum flow.

<sup>289</sup> 2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings. Page 1-265.

<sup>290</sup> Using measured flow rate assumption from Workpaper WPSCGNRWH150827A, Laminar Flow Restrictors For Hospitals and Health Care Facilities.

<sup>291</sup> Average retrofit flow rate for kitchen and bathroom faucet aerators from sources 2, 4, 5, and 7. This accounts for all throttling and differences from rated flow rates. Assumes all kitchen aerators at 2.2 gpm or less and all bathroom aerators at 1.5 gpm or less. The most comprehensive available studies did not disaggregate kitchen use from bathroom use, but instead looked at total flow and length of use for all faucets. This makes it difficult to reliably separate kitchen water use from bathroom water use. It is possible that programs installing low flow aerators lower than the 2.2 gpm for kitchens and 1.5 gpm for bathrooms will see a lower overall average retrofit flow rate.

<sup>292</sup> Measurement should be based on actual average flow consumed over a period of time rather than a onetime spot measurement for maximum flow. Studies have shown maximum flow rates do not correspond well to average flow rate due to occupant behavior which does not always use maximum flow.

<sup>293</sup> 2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings. Page 1-265.

<sup>294</sup> Using measured flow rate assumption from Workpaper WPSCGNRWH150827A, Laminar Flow Restrictors For Hospitals and Health Care Facilities.

Usage = Estimated usage of mixed water (mixture of hot water from water heater line and cold water line) per faucet (gallons per year)

= If data is available to provide a reasonable custom estimate it should be used; if not, use the following defaults (or substitute custom information in to the calculation):

Building Type	Gallons hot water per unit per day <sup>295</sup> (A)	Unit	Estimated % hot water from Faucets <sup>296</sup> (B)	Multiplier <sup>297</sup> (C)	Unit	Days per year (D)	Annual gallons mixed water per faucet (A*B*C*D)
Small Office	1	person	100%	10	employees per faucet	250	2,500
Large Office	1	person	100%	45	employees per faucet	250	11,250
Fast Food Rest	0.7	meal/day	50%	75	meals per faucet	365	9,581
Sit-Down Rest	2.4	meal/day	50%	36	meals per faucet	365	15,768
Retail	2	employee	100%	5	employees per faucet	365	3,650
Grocery	2	employee	100%	5	employees per faucet	365	3,650
Warehouse	2	employee	100%	5	employees per faucet	250	2,500
Elementary School	0.6	person	50%	50	students per faucet	200	3,000
Jr High/High School	1.8	person	50%	50	students per faucet	200	9,000
Health	90	patient	25%	2	Patients per faucet	365	16,425
Motel	20	room	25%	1	faucet per room	365	1,825
Hotel	14	room	25%	1	faucet per room	365	1,278
Other	1	employee	100%	20	employees per faucet	250	5,000

- EPG\_electric = Energy per gallon of mixed water used by faucet (electric water heater)  
 =  $(8.33 * 1.0 * (\text{WaterTemp} - \text{SupplyTemp})) / (\text{RE\_electric} * 3412)$   
 = 0.0795 kWh/gal for Bath, 0.0969 kWh/gal for Kitchen, 0.139 kWh/gal for LFRs, 0.0919 kWh/gal for unknown
- 8.33 = Specific weight of water (lbs/gallon)
- 1.0 = Heat Capacity of water (btu/lb-°F)
- WaterTemp = Assumed temperature of mixed water  
 = 86F for Bath, 93F for Kitchen, 91F for Unknown,<sup>298</sup> 110F for health care facilities<sup>299</sup>
- SupplyTemp = Assumed temperature of water entering building

<sup>295</sup> Table 2-45 Chapter 49, Service Water Heating, 2007 ASHRAE Handbook, HVAC Applications.

<sup>296</sup> Estimated based on data provided in Appendix E; “Waste Not, Want Not: The Potential for Urban Water Conservation in California”, Pacific Institute, November 2003.

<sup>297</sup> Based on review of the Illinois plumbing code (Employees and students per faucet). Retail, grocery, warehouse and health are estimates. Meals per faucet estimated as 4 bathroom and 3 kitchen faucets and average meals per day of 250 (based on California study above) – 250/7 = 36. Fast food assumption estimated.

<sup>298</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. If the aerator location is unknown an average of 91% should be used which is based on the assumption that 70% of household water runs through the kitchen faucet and 30% through the bathroom  $(0.7*93)+(0.3*86)=0.91$ .

<sup>299</sup> Southern California Gas Company, Workpaper WPCSGNRWH150827A Revision #0, September, 2015.

- = 54.1°F<sup>300</sup>
- RE<sub>electric</sub> = Recovery efficiency of electric water heater  
= 98%<sup>301</sup>
- 3412 = Converts Btu to kWh (Btu/kWh)
- ISR = In service rate of faucet aerators dependant on install method as listed in table below:<sup>302</sup>

Selection	ISR
Direct Install - Deemed	0.95

**For example**, a direct installed kitchen faucet in a large office with electric DHW:

$$\begin{aligned} \Delta \text{kWh} &= 1 * ((1.39 - 0.94)/1.39) * 11,250 * 0.0969 * 0.95 \\ &= 335.3 \text{ kWh} \end{aligned}$$

**For example**, a direct installed bathroom faucet in an Elementary School with electric DHW:

$$\begin{aligned} \Delta \text{kWh} &= 1 * ((1.39 - 0.94)/1.39) * 3,000 * 0.0795 * 0.95 \\ &= 73.4 \text{ kWh} \end{aligned}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta \text{kWh}_{\text{water}} = \Delta \text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

- E<sub>water total</sub> = IL Total Water Energy Factor (kWh/Million Gallons)  
=5,010 for measures installed in all areas except Cook County<sup>303</sup>  
= 2,937 for measures installed in Cook County<sup>304,305</sup>

<sup>300</sup> US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy.

<sup>301</sup> Electric water heaters have recovery efficiency of 98%, as sourced from available products on the AHRI Certification Directory.

<sup>302</sup> ComEd Energy Efficiency/Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program, December 21, 2010, Table 3-8.

<sup>303</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>304</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>305</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

**For example**, a direct installed faucet in a large office:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((1.39 - 0.94)/1.39) * 11,250 * 0.95 \\ &= 3,640 \text{ gallons} \\ \Delta\text{kWh}_{\text{water}} &= 3,640/1,000,000 * 5,010 \\ &= 18 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = (\Delta\text{kWh} / \text{Hours}) * \text{CF}$$

Where:

$\Delta\text{kWh}$  = calculated value above on a per faucet basis. Note do not include the secondary savings in this calculation.

Hours = Annual electric DHW recovery hours for faucet use

$$= (\text{Usage} * 0.545^{306}) / \text{GPH}$$

= Calculate if usage is custom, if using default usage use:

Building Type	Annual Recovery Hours
Small Office	24
Large Office	109
Fast Food Rest	93
Sit-Down Rest	153
Retail	36
Grocery	36
Warehouse	24
Elementary School	29
Jr High/High School	88
Health	160
Motel	18
Hotel	12
Other	49

Where:

GPH = Gallons per hour recovery of electric water heater calculated for 85.9F temp rise (140-54.1), 98% recovery efficiency, and typical 12kW electric resistance storage tank.

$$= 56$$

CF = Coincidence Factor for electric load reduction

$$= \text{Dependent on building type}^{307}$$

<sup>306</sup> 54.5% is the proportion of hot 120F water mixed with 54.1F supply water to give 90°F mixed faucet water.

<sup>307</sup> Calculated as follows: Assumptions for percentage of usage during peak period (1-5pm) were made and then multiplied by 65/365 (65 being the number of days in peak period) and by the number of total annual recovery hours to give an estimate of the number of hours of recovery during peak periods. There are 260 hours in the peak period so the probability you will see

Building Type	Coincidence Factor
Small Office	0.0064
Large Office	0.0288
Fast Food Rest	0.0084
Sit-Down Rest	0.0184
Retail	0.0043
Grocery	0.0043
Warehouse	0.0064
Elementary School	0.0096
Jr High/High School	0.0288
Health	0.0144
Motel	0.0006
Hotel	0.0004
Other	0.0128

**For example**, a direct installed kitchen faucet in a large office with electric DHW:  
 $\Delta kW = 335.3/109 * 0.0288$   
 $= 0.0886 \text{ kW}$

**For example**, a direct installed bathroom faucet in an Elementary School with electric DHW:  
 $\Delta kW = 73.4/29 * 0.0096$   
 $= 0.0243 \text{ kW}$

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta \text{Therms} = \% \text{FossilDHW} * ((\text{GPM}_{\text{base}} - \text{GPM}_{\text{low}}) / \text{GPM}_{\text{base}}) * \text{Usage} * \text{EPG}_{\text{gas}} * \text{ISR}$$

Where:

$\% \text{FossilDHW}$  = proportion of water heating supplied by fossil fuel heating

DHW fuel	$\% \text{Fossil\_DHW}$
Electric	0%
Fossil Fuel	100%

$\text{EPG}_{\text{gas}}$  = Energy per gallon of mixed water used by faucet (gas water heater)  
 $= (8.33 * 1.0 * (\text{WaterTemp} - \text{SupplyTemp})) / (\text{RE}_{\text{gas}} * 100,000)$   
 = 0.00397 Therm/gal for Bath, 0.00484 Therm/gal for Kitchen, 0.00695 Therm/gal for LFRs, 0.00459 Therm/gal for unknown

Where:

$\text{RE}_{\text{gas}}$  = Recovery efficiency of gas water heater  
 $= 67\%^{308}$

savings during the peak period is calculated as the number of hours of recovery during peak divided by 260. See 'C&I Faucet Aerator.xls' for details.

<sup>308</sup> Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 75%. Commercial properties are more similar to MF homes than SF homes. MF hot water is often

100,000 = Converts Btus to Therms (Btu/Therm)

Other variables as defined above.

**For example**, a direct installed kitchen faucet in a large office with gas DHW:

$$\begin{aligned} \Delta\text{Therms} &= 1 * ((1.39 - 0.94)/1.39) * 11,250 * 0.00484 * 0.95 \\ &= 16.7 \text{ Therms} \end{aligned}$$

**For example**, a direct installed bathroom faucet in an Elementary School with gas DHW:

$$\begin{aligned} \Delta\text{Therms} &= 1 * ((1.39 - 0.94)/1.39) * 3,000 * 0.00397 * 0.95 \\ &= 3.66 \text{ Therms} \end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water (gallons)} = ((\text{GPM}_{\text{base}} - \text{GPM}_{\text{low}})/\text{GPM}_{\text{base}}) * \text{Usage} * \text{ISR}$$

Variables as defined above.

**For example**, a direct installed faucet in a large office:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((1.39 - 0.94)/1.39) * 11,250 * 0.95 \\ &= 3,640 \text{ gallons} \end{aligned}$$

**For example**, a direct installed faucet in an Elementary School:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((1.39 - 0.94)/1.39) * 3,000 * 0.95 \\ &= 971 \text{ gallons} \end{aligned}$$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**SOURCES USED FOR GPM ASSUMPTIONS**

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.

provided by a larger commercial boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of .59 and the .75 for single family home. An average is used for this analysis by default.

**MEASURE CODE: CI-HWE-LFFA-V09-190101**

**REVIEW DEADLINE: 1/1/2023**

### 4.3.3 Low Flow Showerheads

#### DESCRIPTION

This measure relates to the direct installation of a low flow showerhead in a commercial building. Expected applications include small business, office, restaurant, or small motel. For multifamily or senior housing, the residential low flow showerhead should be used.

This measure was developed to be applicable to the following program types: DI. If applied to other program types, the measure savings should be verified

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an energy efficient showerhead rated at 2.0 gallons per minute (GPM) or less. Savings are calculated on a per showerhead fixture basis.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a standard showerhead rated at 2.5 GPM.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>309</sup>

#### DEEMED MEASURE COST

The actual full install cost (including labor) should be used. If unknown, assume \$12 per showerhead.<sup>310</sup>

#### LOADSHAPE

Loadshape C02 - Commercial Electric DHW

#### COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 2.78%.<sup>311</sup>

---



---

#### Algorithm

---

#### CALCULATION OF SAVINGS<sup>312</sup>

##### ELECTRIC ENERGY SAVINGS

Note these savings are per showerhead fixture

$$\Delta kWh =$$

$$\%ElectricDHW * ((GPM\_base * L\_base - GPM\_low * L\_low) * NSPD * 365.25) * EPG\_electric * ISR$$

---

<sup>309</sup> Table C-6, Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007. Evaluations indicate that consumer dissatisfaction may lead to reductions in persistence, particularly in Multi-Family.

<sup>310</sup> Direct-install price per showerhead assumes cost of showerhead (Market research average of \$7 and assess and install time of \$5 (20min @ \$15/hr).

<sup>311</sup> Calculated as follows: Assume 11% showers take place during peak hours (as sourced from “Analysis of Water Use in New Single Family Homes, Aquacraft Water Engineering and Management, January 2011). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is  $0.11 * 65 / 365 = 1.96\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $1.96\% * 369 = 7.23$  hours of recovery during peak period. There are 260 hours in the peak period, so the probability you will see savings during the peak period is  $7,23 / 260 = 0.0278$ .

<sup>312</sup>Based on excel spreadsheet 120911.xls ...on IL-TRM SharePoint.



Where:

%ElectricDHW = proportion of water heating supplied by electric resistance heating  
 = 1 if electric DHW; 0 if fuel DHW; if unknown, assume 16%<sup>313</sup>

GPM\_base = Flow rate of the baseline showerhead  
 = 2.67 for Direct-install programs<sup>314</sup>

GPM\_low = As-used flow rate of the low-flow showerhead, which may, as a result of measurements of program evaluations deviate from rated flows, see table below:

Rated Flow
2.0 GPM
1.75 GPM
1.5 GPM
Custom or Actual <sup>315</sup>

L\_base = Shower length in minutes with baseline showerhead  
 = 8.20 min<sup>316</sup>

L\_low = Shower length in minutes with low-flow showerhead  
 = 8.20 min<sup>317</sup>

365.25 = Days per year, on average.

NSPD = Estimated number of showers taken per day for one showerhead

EPG\_electric = Energy per gallon of hot water supplied by electric  
 =  $(8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE\_electric} * 3412)$   
 =  $(8.33 * 1.0 * (101 - 54.1)) / (0.98 * 3412)$   
 = 0.117 kWh/gal

8.33 = Specific weight of water (lbs/gallon)

1.0 = Heat Capacity of water (btu/lb-°F)

ShowerTemp = Assumed temperature of water  
 = 101°F<sup>318</sup>

SupplyTemp = Assumed temperature of water entering house

<sup>313</sup> Table HC8.9. Water Heating in U.S. Homes in Midwest Region, Divisions, and States, 2009 (RECS).

<sup>314</sup> Based on measured data from Ameren IL EM&V of Direct-Install program. Program targets showers that are rated 2.5 GPM or above.

<sup>315</sup> Note that actual values may be either a) program-specific minimum flow rate, or b) program-specific evaluation-based value of actual effective flow-rate due to increased duration or temperatures. The latter increases in likelihood as the rated flow drops and may become significant at or below rated flows of 1.5 GPM. The impact can be viewed as the inverse of the throttling described in the footnote for baseline flowrate.

<sup>316</sup> Representative value from sources 1, 2, 3, 4, 5, and 6 (See Source Table at end of measure section).

<sup>317</sup> Set equal to L\_base.

<sup>318</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

- = 54.1°F <sup>319</sup>
- RE\_electric = Recovery efficiency of electric water heater  
= 98% <sup>320</sup>
- 3412 = Converts Btu to kWh (btu/kWh)
- ISR = In service rate of showerhead  
= Dependant on program delivery method as listed in table below

Selection	ISR <sup>321</sup>
Direct Install - Deemed	0.98

**For example**, a direct-installed 1.5 GPM showerhead in an office with electric DHW where the number of showers is estimated at 3 per day:

$$\begin{aligned} \Delta kWh &= 1 * ((2.67*8.20) - (1.5*8.20)) * 3 * 365.25 * 0.117 * 0.98 \\ &= 1205.4 \text{ kWh} \end{aligned}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{\text{water}} = \Delta \text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

- E<sub>water total</sub> = IL Total Water Energy Factor (kWh/Million Gallons)  
= 5,010 for measures installed in all areas except Cook County <sup>322</sup>  
= 2,937 for measures installed in Cook County <sup>323,324</sup>

<sup>319</sup> US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy.

<sup>320</sup> Electric water heaters have recovery efficiency of 98%, as sourced from available products on the AHRI Certification Directory.

<sup>321</sup> Deemed values are from ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program Table 3-8. Alternative ISRs may be developed for program delivery methods based on evaluation results.

<sup>322</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>323</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>324</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

**For example**, a direct-installed 1.5 GPM showerhead in an office with where the number of showers is estimated at 3 per day:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((2.67 * 8.20) - (1.5 * 8.20)) * 3 * 365.25 * 0.98 \\ &= 10,302 \text{ gallons} \\ \Delta\text{kWh}_{\text{water}} &= 10,302 / 1,000,000 * 5,010 \\ &= 52 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh/Hours} * \text{CF}$$

Where:

- $\Delta\text{kWh}$  = calculated value above. Note do not include the secondary savings in this calculation.
- Hours = Annual electric DHW recovery hours for showerhead use  
 $= ((\text{GPM}_{\text{base}} * \text{L}_{\text{base}}) * \text{NSPD} * 365.25) * 0.773^{325} / \text{GPH}$

Where:

- GPH = Gallons per hour recovery of electric water heater calculated for 65.9F temp rise (120-54.1), 98% recovery efficiency, and typical 4.5kW electric resistance storage tank.  
 $= 27.51$
- CF = Coincidence Factor for electric load reduction  
 $= 0.0278^{326}$

**For example**, a direct-installed 1.5 GPM showerhead in an office with electric DHW where the number of showers is estimated at 3 per day:

$$\begin{aligned} \Delta\text{kW} &= (1205.4 / 674.1) * 0.0278 \\ &= 0.050 \text{ kW} \end{aligned}$$

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Therms} = \% \text{FossilDHW} * ((\text{GPM}_{\text{base}} * \text{L}_{\text{base}} - \text{GPM}_{\text{low}} * \text{L}_{\text{low}}) * \text{NSPD} * 365.25) * \text{EPG}_{\text{gas}} * \text{ISR}$$

Where:

- $\% \text{FossilDHW}$  = proportion of water heating supplied by fossil fuel heating

<sup>325</sup> 77.3% is the proportion of hot 120F water mixed with 54.1°F supply water to give 105°F shower water.

<sup>326</sup> Calculated as follows: Assume 11% showers take place during peak hours (as sourced from “Analysis of Water Use in New Single Family Homes, Aquacraft Water Engineering and Management, January 2011). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is  $0.11 * 65 / 365.25 = 1.96\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $1.96\% * 369 = 7.23$  hours of recovery during peak period where 369 equals the average annual electric DHW recovery hours for showerhead use including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $7.23 / 260 = 0.0278$ .

DHW fuel	%Fossil_DHW
Electric	0%
Fossil Fuel	100%
Unknown	84% <sup>327</sup>

$$\begin{aligned} \text{EPG}_{\text{gas}} &= \text{Energy per gallon of Hot water supplied by gas} \\ &= (8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE}_{\text{gas}} * 100,000) \\ &= 0.0058 \text{ Therm/gal} \end{aligned}$$

Where:

$$\begin{aligned} \text{RE}_{\text{gas}} &= \text{Recovery efficiency of gas water heater} \\ &= 67\%^{328} \\ 100,000 &= \text{Converts Btus to Therms (btu/Therm)} \end{aligned}$$

Other variables as defined above.

**For example**, a direct-installed 1.5 GPM showerhead in an office with gas DHW where the number of showers is estimated at 3 per day:

$$\begin{aligned} \Delta\text{Therms} &= 1.0 * ((2.67 * 8.2) - (1.5 * 8.2)) * 3 * 365.25 * 0.0058 * 0.98 \\ &= 59.8 \text{ therms} \end{aligned}$$

#### WATER IMPACT DESCRIPTIONS AND CALCULATION

$$\Delta\text{Water (gallons)} = ((\text{GPM}_{\text{base}} * \text{L}_{\text{base}} - \text{GPM}_{\text{low}} * \text{L}_{\text{low}}) * \text{NSPD} * 365.25 * \text{ISR})$$

Variables as defined above

**For example**, a direct-installed 1.5 GPM showerhead in an office with where the number of showers is estimated at 3 per day:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((2.67 * 8.20) - (1.5 * 8.20)) * 3 * 365.25 * 0.98 \\ &= 10,302 \text{ gallons} \end{aligned}$$

#### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

<sup>327</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>328</sup> Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 75%. Commercial properties are more similar to MF homes than SF homes. MF hot water is often provided by a larger commercial boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of .59 and the .75 for single family home. An average is used for this analysis by default.

**SOURCES**

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.

**MEASURE CODE: CI-HWE-LFSH-V07-200101**

**REVIEW DEADLINE: 1/1/2022**

### 4.3.4 Commercial Pool Covers

#### DESCRIPTION

This measure refers to the installation of covers on commercial use pools that are heated with gas-fired equipment located either indoors or outdoors. By installing pool covers, the heating load on the pool boiler will be reduced by reducing the heat loss from the water to the environment and the amount of actual water lost due to evaporation (which then requires additional heated water to make up for it). An additional benefit to pool covers are the electricity savings from the reduced fresh water required to replace the evaporated water.

The main source of energy loss in pools is through evaporation. This is particularly true of outdoor pools where wind plays a larger role. The point of installing pool covers is threefold. First, it will reduce convective losses due to the wind by shielding the water surface. Second, it will insulate the water from the colder surrounding air. And third, it will reduce radiative losses to the night sky. In doing so, evaporative losses will also be minimized, and the boiler will not need to work as hard in replenishing the pool with hot water to keep the desired temperature.

This measure can be used for pools that (1) currently do not have pool covers, (2) have pool covers that are past the useful life of the existing cover, or (3) have pool covers that are past their warranty period and have failed.

#### DEFINITION OF EFFICIENT EQUIPMENT

For indoor pools, the efficient case is the installation of an indoor pool cover with a 5 year warranty on an indoor pool that operates all year.

For outdoor pools, the efficient case is the installation of an outdoor pool cover with a 5 year warranty on an outdoor pool that is open through the summer season.

#### DEFINITION OF BASELINE EQUIPMENT

For indoor pools, the base case is an uncovered indoor pool that operates all year.

For outdoor pools, the base case is an outdoor pool that is uncovered and is open through the summer season.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The useful life of this measure is assumed to be 6 years.<sup>329</sup>

#### DEEMED MEASURE COST

The table below shows the costs for the various options and cover sizes. Since this measure covers a mix of various sizes, the average cost of these options is taken to be the incremental measure cost.<sup>330</sup> Costs are per square foot.

Cover Size	Edge Style	
	Hemmed (indoor)	Weighted (outdoor)
1000-1,999 sq. ft.	\$2.19	\$2.24
2,000-2,999 sq. ft.	\$2.01	\$2.06
3,000+ sq. ft.	\$1.80	\$1.83
Average	\$2.00	\$2.04

#### LOADSHAPE

Loadshape R15 – Residential Pool Pumps

<sup>329</sup> The effective useful life of a pool cover is typically one year longer than its warranty period. SolaPool Covers. Pool Covers Website, FAQ- "How long will my SolaPool cover blanket last?". Pool covers are typically offered with 3 and 5 year warranties with at least one company offering a 6 year warranty. Conversation with Trade Ally. Knorr Systems.

<sup>330</sup> Pool Cover Costs: Lincoln Commercial Pool Equipment online catalog. Accessed 8/26/11.

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water \text{ supply}}$$

Where

$$E_{water \text{ supply}} = \text{Water Supply Energy Factor (kWh/Million Gallons)}$$

$$= 2,571^{331}$$

**For example,**

2400ft<sup>2</sup> Indoor Swimming Pool:

$$\begin{aligned} \Delta Water &= \text{WaterSavingFactor} \times \text{Size of Pool} \\ &= 15.28 \text{ gal./ft}^2/\text{year} \times 2400 \text{ ft}^2 \\ &= 36,672 \text{ gal./year} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{water} &= \Delta Water / 1,000,000 * E_{water \text{ supply}} \\ &= 36,672 \text{ gal./year} / 1,000,000 * 2,571 \text{ kWh/million gallons} \\ &= 96.3 \text{ kWh/year} \end{aligned}$$

2400ft<sup>2</sup> Outdoor Swimming Pool:

$$\begin{aligned} \Delta Water &= \text{WaterSavingFactor} \times \text{Size of Pool} \\ &= 8.94 \text{ gal./ft}^2/\text{year} \times 2400 \text{ ft}^2 \\ &= 21,456 \text{ gal./year} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{water} &= \Delta Water / 1,000,000 * E_{water \text{ supply}} \\ &= 21,456 \text{ gal./year} / 1,000,000 * 2,571 \text{ kWh/million gallons} \\ &= 55.2 \text{ kWh/year} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

---

<sup>331</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’. Note since the water loss associated with this measure is due to evaporation and does not discharge into the wastewater system, only the water supply factor is used here.

**NATURAL GAS SAVINGS**

The calculations are based on modeling runs using RSPEC! Energy Smart Pools Software that was created by the U.S. Department of Energy.<sup>332</sup>

$$\Delta\text{Therms} = \text{SavingFactor} \times \text{Size of Pool}$$

Where

Savings factor = dependant on pool location and listed in table below:<sup>333</sup>

Location	Therm / sq-ft
Indoor	2.61
Outdoor	1.01

Size of Pool = custom input

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water (gallons)} = \text{WaterSavingFactor} \times \text{Size of Pool}$$

Where

WaterSavingFactor = Water savings for this measure dependant on pool location and listed in table below:<sup>334</sup>

Location	Annual Savings Gal / sq-ft
Indoor	15.28
Outdoor	8.94

Size of Pool = Custom input

**DEEMED O&M COST ADJUSTMENT CALCULATION**

There are no O&M cost adjustments for this measure.

**MEASURE CODE: CI-HWE-PLCV-V03-200101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>332</sup> Full method and supporting information found in reference document: IL TRM - Business Pool Covers WorkPaper.docx. Note that the savings estimates are based upon Chicago weather data.

<sup>333</sup> Business Pool Covers.xlsx

<sup>334</sup> Ibid.



#### 4.3.5 Tankless Water Heater – Measure combined with 4.3.1 Water Heater in Version 8

## 4.3.6 Ozone Laundry

### DESCRIPTION

A new ozone laundry system(s) is added-on to new or existing commercial washing machine(s) using hot water heated with natural gas. The system generates ozone (O<sub>3</sub>), a naturally occurring molecule, which helps clean fabrics by chemically reacting with soils in cold water. Adding an ozone laundry system(s) will reduce the amount of chemicals, detergents, and hot water needed to wash linens. Using ozone also reduces the total amount of water consumed, saving even more in energy.

Natural gas energy savings will be achieved at the hot water heater/boiler as they will be required to produce less hot water to wash each load of laundry. The decrease in hot water usage will increase cold water usage, but overall water usage at the facility will decrease.

Electric savings can be realized through reduced washer cycle length and reduced pumping load at the boiler feeding the commercial washers. The increased usage associated with operating the ozone system should also be accounted for when determining total kWh impact. Data reviewed for this measure characterization indicated that pumping savings should be accounted for, but washer savings and ozone generator consumption are comparatively so small that they can be ignored.

The reduced washer cycle length may decrease the dampness of the clothes when they move to the dryer. This can result in shorter runtimes which result in gas and electrical savings. However, at this time, there is inconclusive evidence that energy savings are achieved from reduced dryer runtimes so the resulting dryer effects are not included in this analysis. Additionally, there would be challenges verifying that dryer savings will be achieved throughout the life of the equipment.

This incentive only applies to the following facilities with on-premise laundry operations:

- Hotels/motels
- Fitness and recreational sports centers.
- Healthcare (excluding hospitals)
- Assisted living facilities
- Laundromats

Ozone laundry system(s) could create significant energy savings opportunities at other larger facility types with on-premise laundry operations (such as correctional facilities, universities, and staff laundries), however, the results included in this analysis are based heavily on past project data for the applicable facility types listed above and may not apply to facilities outside of this list due to variances in number of loads and average pound (lbs.)-capacity per project site. Projects at these facilities should continue to be evaluated through custom programs and the applicable facility types and the resulting analysis should be updated based on new information.

Laundromats are the only application where number of washing units needs to be used to calculate total site energy savings. All other applications use site assumptions to calculate total site savings.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

A new ozone laundry system(s) is added-on to new or existing commercial washing machine(s) using hot water heated with natural gas. The ozone laundry system(s) must transfer ozone into the water through:

- Venturi Injection
- Bubble Diffusion
- Additional applications may be considered upon program review and approval on a case by case basis

- For laundromats, the ozone laundry system(s) must be connected to both the hot and cold water inlets of the clothes washing machine(s) so that hot water is no longer provided to the clothes washer.

**DEFINITION OF BASELINE EQUIPMENT**

The base case equipment is a conventional washing machine system with no ozone generator installed. The washing machines are provided hot water from a gas-fired boiler.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure equipment effective useful life (EUL) is estimated at 10 years based on typical lifetime of the ozone generator’s corona discharge unit.<sup>335</sup>

**DEEMED MEASURE COST**

The actual measure costs should be used if available. If not, the following deemed values should be used:

Application	Deemed Measure Cost
Laundromat	\$25.53 / lbs capacity <sup>336</sup>
Hotel/Motel	\$79.84 / lbs capacity <sup>337</sup>
Fitness and Recreation	
Healthcare	
Assisted Living	

**LOADSHAPE**

Loadshape C53 – Flat

**COINCIDENCE FACTOR**

Past project documentation and data collection is not sufficient to determine a coincidence factor for this measure. Value should continue to be studied and monitored through additional studies due to limited data points used for this determination.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Electric savings can be realized through reduced washer cycle length and reduced pumping load at the boiler feeding the commercial washers. There is also an increased usage associated with operating the ozone system. Data reviewed for this measure characterization indicated that while pumping savings is significant and should be accounted for, washer savings and ozone generator consumption are negligible, counter each other out and are well within the margin of error so these are not included to simplify the characterization.<sup>338</sup>

---

<sup>335</sup> Aligned with other national energy efficiency programs and confirmed with national vendors

<sup>336</sup> Average cost per unit of capacity for laundromats was generated using data collected from previous Peoples Gas and North Shore Gas custom projects

<sup>337</sup> Average costs per unit of capacity were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR), as well as from the Nicor Custom Incentive Program, and the Nicor Emerging Technology Program (ETP). See referenced document Table 2 and RSMMeans Mechanical Cost Data, 31st Annual Edition (2008)

<sup>338</sup> Washer savings were reviewed but were considered negligible and not included in the algorithm (0.00082 kWh / lbs-capacity, determined through site analysis through Nicor Emerging Technology Program (ETP) and confirmed with national

$$\Delta kWh_{PUMP} = HP * HP_{CONVERSION} * Hours * \%water\_savings$$

Where:

- $\Delta kWh_{PUMP}$  = Electric savings from reduced pumping load
- HP = Brake horsepower of boiler feed water pump;  
= Actual, or use 5 HP if unknown<sup>339</sup>
- $HP_{CONVERSION}$  = Conversion from Horsepower to Kilowatt  
= 0.746
- Hours = Actual associated boiler feed water pump hours  
= Must be a custom calculation for laundromats, but 800 hours can be used for other applications if unknown<sup>340</sup>
- $\%water\_savings$  = water reduction factor: how much more efficient an ozone injection washing machine is compared to a typical conventional washing machine as a rate of hot and cold water reduction.

Application	$\%water\_savings$
Laundromat	10% <sup>341</sup>
Hotel/Motel	25% <sup>342</sup>
Fitness and Recreation	
Healthcare	
Assisted Living	

Using defaults above:

$$\begin{aligned} \Delta kWh_{PUMP\_LAUNDROMAT} &= 5 * 0.746 * Hours * 0.10 \\ &= 0.373 kWh * Hours \\ \Delta kWh_{PUMP\_ALL\ OTHER} &= 5 * 0.746 * 800 * 0.25 \\ &= 746 kWh \end{aligned}$$

Default per pound:  $= \Delta kWh_{PUMP} / \text{Lbs-Capacity}$

Where:

Lbs-Capacity = Total washer capacity measured in pounds of laundry

vendors). Note that washer savings from Nicor’s site analysis are smaller than those reported in a WI Focus on Energy case study (0.23kWh/100lbs, Hampton Inn Brookfield, November 2010). Electric impact of operating ozone generator (0.0021 kWh / lbs-capacity same source as washer savings) was also considered negligible and not included in calculations. Values should continue to be studied and monitored through additional studies due to limited data points used for this determination.

<sup>339</sup> Assumed average horsepower for boilers connected to applicable washer.

<sup>340</sup> Engineered estimate provided by CLEAResult review of Nicor custom projects. Machines spent approximately 7 minutes per hour filling with water and were in operation approximately 20 hours per day. Total pump time therefore estimated as 7/60 \* 20 \* 365 = 852 hours, and rounded down conservatively to 800 hours.

<sup>341</sup> Page 7, Laundries and Dry-Cleaning Operations, Watersmart Guidebook EBMUD\_WaterSmart\_Guide\_Laundries\_Dry-Cleaning\_Operations.pdf.

<sup>342</sup> Average water reduction factors were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR). Table 6 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects. Nicor Savings Numbers are associated with ACEE\_AWE\_Ozone Laundry / From Gas Savings Calculations.

Application	Lbs-Capacity
Laundromat	Actual combined capacity of ozone connected washers  254.38 lbs per site <sup>343</sup>
Hotel/Motel	
Fitness and Recreation	
Healthcare	
Assisted Living	

$$\Delta kWh_{PUMP\ ALL\ OTHERS} \text{ per pound} = 746/254.38$$

$$= 2.93 \text{ kWh/lb}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water\ total}$$

Where:

$$\Delta Water \text{ (gallons)}_{LAUNDROMAT} = 239 * Lbs\_Capacity^{344}$$

$$\Delta Water \text{ (gallons)}_{ALL\ OTHERS} = 464,946^{345}$$

$$E_{water\ total} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

$$= 5,010 \text{ for measures installed in all areas except Cook County }^{346}$$

$$= 2,937 \text{ for measures installed in Cook County }^{347,348}$$

Deemed savings using defaults:

$$\Delta kWh_{water\_LAUNDROMAT} = (239 * Lbs-Capacity)/1,000,000 * 5,010 \text{ (2,937 in Cook County)}$$

$$\Delta kWh_{water\_ALL\ OTHERS} = 464,946/1,000,000 * 5,010 \text{ (2,937 in Cook County)}$$

$$= 2,329 \text{ kWh (1366kWh in Cook County)}$$

<sup>343</sup> Average lbs-capacity per project site was generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR), as well as from the Nicor Custom Incentive Program, and the Nicor Emerging Technology Program (ETP). See referenced document Table 2.

<sup>344</sup> See the “Water Impact Descriptions and Calculation” section of this measure for more information.

<sup>345</sup> See the “Water Impact Descriptions and Calculation” section of this measure for more information.

<sup>346</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>347</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>348</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Past project documentation and data collection is not sufficient to determine summer coincident peak demand savings for this measure. Value should continue to be studied and monitored through additional studies due to limited data points used for this determination. In absence of site-specific data, the summer coincident peak demand savings should be assumed to be zero.

$$\Delta kW = 0$$

**NATURAL GAS SAVINGS**

$$\Delta Therm = Therm_{Baseline} * \%hot\_water\_savings$$

Where:

$\Delta Therm$  = Gas savings resulting from a reduction in hot water use, in therm.

$Therm_{Baseline}$  = Annual Baseline Gas Consumption  
 = WHE \* WUtiliz \* WUsage\_hot

Where:

WHE = water heating energy: energy required to heat the hot water used  
 = 0.00885 therm/gallon<sup>349</sup>

WUtiliz = washer utilization factor: the annual pounds of clothes washed per year  
 = actual, if unknown the values below:

Application	WUtiliz
Laundromat	2,190 <sup>350</sup> cycles per year * Lbs-Capacity
Hotel/Motel	916,150 lbs <sup>351</sup> (Approx. 4,745 cycles per year) per site
Fitness and Recreation	
Healthcare	
Assisted Living	

WUsage\_hot = hot water usage factor: how much hot water a typical conventional washing machine utilizes, normalized per pounds of clothes washed

Application	WUsage_hot
Laundromat	0.64 gallons/lb <sup>352</sup>
Hotel/Motel	1.19 gallons/lb <sup>353</sup>
Fitness and Recreation	
Healthcare	
Assisted Living	

<sup>349</sup> Assuming boiler efficiency is the regulated minimum efficiency (80%), per Title 20 Appliance Standard of the California Energy Regulations (October 2007). The incoming municipal water temperature is assumed to be 55 °F with an average hot water supply temperature of 140°F, based on default test procedures on clothes washers set by the Department of Energy’s Office of Energy Efficiency and Renewable Energy (Federal Register, Vol. 52, No. 166). Enthalpies for these temperatures (107 btu/lbs at 140F, 23.07 btu/lbs at 55F) were obtained from ASHRAE Fundamentals.

<sup>350</sup> DOE Technical Support Document Chapter 6, 2010 <https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf>

<sup>351</sup> Average utilization factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. Table 3 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects.

<sup>352</sup> Calculated as WUsage \* Average % Hot water (estimated at 59% from Custom laundromat data); 1.09\*0.59 = 0.64 gal / lbs laundry.

<sup>353</sup> Average hot water usage factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. Summarizes data gathered from several NRR-DR projects.

Using defaults above:

$$\begin{aligned} \text{Therm}_{\text{Baseline\_LAUNDROMAT}} &= 0.00885 * (2,190 \text{ cycles per year} * \text{Lbs-Capacity}) * 0.64 \\ &= 12.4 \text{ therms} * \text{Lbs-Capacity} \end{aligned}$$

$$\begin{aligned} \text{Therm}_{\text{Baseline\_ALL OTHERS}} &= 0.00885 * 916,150 * 1.19 \\ &= 9648 \text{ therms} \end{aligned}$$

$\% \text{hot\_water\_savings}$  = hot water reduction factor: how much more efficient an ozone injection washing machine is, compared to a typical conventional washing machine, as a rate of hot water reduction

Application	$\% \text{hot\_water\_savings}$
Laundromat	100%
Hotel/Motel	81% <sup>354</sup>
Fitness and Recreation	
Healthcare	
Assisted Living	

Savings using defaults above:

$$\Delta \text{Therm} = \text{Therm}_{\text{Baseline}} * \% \text{hot\_water\_savings}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{LAUNDROMAT}} &= 12.4 * \text{Lbs-Capacity} * 100\% \\ &= 12.4 \text{ therms} * \text{Lbs-Capacity} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{ALL OTHER}} &= 9648 * 81\% \\ &= 7815 \text{ therms per site} \end{aligned}$$

Default per lb capacity:

$$\begin{aligned} \Delta \text{Therm}_{\text{LAUNDROMAT}} / \text{lb} &= 12.4 * \text{Lbs-Capacity} / \text{lb capacity} \\ &= 12.4 \text{ therms} / \text{lb} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{ALL OTHER}} / \text{lb} &= 7815 / 254.38 \\ &= 30.7 \text{ therms} / \text{lb} \end{aligned}$$

### WATER IMPACT DESCRIPTIONS AND CALCULATION

The water savings calculations listed here account for the combination of hot and cold water used. Savings calculations for this measure were based on the reduction in total water use from implementing an ozone washing system to the base case. There are three main components in obtaining this value:

$$\Delta \text{Water (gallons)} = W \text{Usage} * W \text{Utiliz} * \% \text{water\_savings}$$

Where:

$$\Delta \text{Water (gallons)} = \text{reduction in total water use from implementing an ozone washing system to the base case}$$

<sup>354</sup> Average hot water reduction factors were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR). Table 5 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects. Nicor Savings Numbers are associated with ACEE\_AWE\_Ozone Laundry / From Gas Savings Calculations.

WUsage = water usage factor: amount of total water used by a conventional washing machine normalized per unit of clothes washed

$$WUsage_{LAUNDROMATS} = 1.09 \text{ gallons / lbs laundry}^{355}$$

$$WUsage_{ALL OTHERS} = 2.03 \text{ gallons/lbs laundry}^{356}$$

WUtiliz = washer utilization factor: the annual pounds of clothes washed per year

= actual, if unknown use the values below:

Application	WUtiliz
Laundromat	2,190 <sup>357</sup> cycles per year * Lbs-Capacity
Hotel/Motel	916,150 lbs <sup>358</sup> (Approx. 4,745 cycles per year) per site
Fitness and Recreation	
Healthcare	
Assisted Living	

%water\_savings = water reduction factor: how much more efficient an ozone injection washing machine is compared to a typical conventional washing machine as a rate of hot and cold water reduction.

Application	%water_savings
Laundromat	10% <sup>359</sup>
Hotel/Motel	25% <sup>360</sup>
Fitness and Recreation	
Healthcare	
Assisted Living	

Savings using defaults above:

$$\Delta Water = WUsage * WUtiliz * \%water\_savings$$

$$\begin{aligned} \Delta Water_{LAUNDROMATS} &= 1.09 * WUtiliz * 0.1 \\ &= 1.09 * (2,190 * Lbs-Capacity) * 0.1 \\ &= 239 * Lbs-Capacity \end{aligned}$$

$$\begin{aligned} \Delta Water_{ALL OTHERS} &= 2.03 * 916,150 * 0.25 \\ &= 464,946 \text{ gallons per site} \end{aligned}$$

<sup>355</sup> Based on Peoples Gas custom project data.

<sup>356</sup> Average water usage factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. summarizes data gathered from several NRR-DR projects.

<sup>357</sup> DOE Technical Support Document Chapter 6, 2010 <https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf>

<sup>358</sup> Average utilization factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. Table 3 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects.

<sup>359</sup> Page 7, Laundries and Dry-Cleaning Operations, Watersmart Guidebook EBMUD\_WaterSmart\_Guide\_Laundries\_Dry-Cleaning\_Operations.pdf.

<sup>360</sup> Average water reduction factors were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR). Table 6 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects. Nicor Savings Numbers are associated with ACEE\_AWE\_Ozone Laundry / From Gas Savings Calculations.



Default per pound:

$$\Delta \text{Water}_{\text{LAUNDROMATS}} / \text{lb capacity} = (239 * \text{Lbs-Capacity}) / \text{lb-capacity}$$

$$= 239 \text{ gallons/lb}$$

$$\Delta \text{Water}_{\text{ALL OTHERS}} / \text{lb-capacity} = 464,946 / 254.38$$

$$= 1,828 \text{ gallons / lb}$$

### DEEMED O&M COST ADJUSTMENT CALCULATION

Maintenance is required for the following components annually:<sup>361</sup>

- Ozone Generator: filter replacement, check valve replacement, fuse replacement, reaction chamber inspection/cleaning, reaction chamber o-ring replacement
- Air Preparation – Heat Regenerative: replacement of two medias
- Air Preparation – Oxygen Concentrators: filter replacement, pressure relief valve replacement, compressor rebuild
- Venturi Injector: check valve replacement

Maintenance is expected to cost \$0.79 / lbs capacity.

### SOURCES

- 1 "Lodging Report", December 2008, California Travel & Tourism Commission, [http://tourism.visitcalifornia.com/media/uploads/files/editor/Research/CaliforniaTourism\\_200812.pdf](http://tourism.visitcalifornia.com/media/uploads/files/editor/Research/CaliforniaTourism_200812.pdf)
- 2 "Health, United States, 2008" Table 120, U.S. Department of Health & Human Services, Centers for Disease Control & Prevention, National Center for Health Statistics, <http://www.cdc.gov/nchs/data/hus/hus08.pdf#120>
- 3 Fourth Quarter 2008 Facts and Figures, California Department of Corrections & Rehabilitation (CDCR), [http://www.cdcr.ca.gov/Divisions\\_Boards/Adult\\_Operations/docs/Fourth\\_Quarter\\_2008\\_Facts\\_and\\_Figures.pdf](http://www.cdcr.ca.gov/Divisions_Boards/Adult_Operations/docs/Fourth_Quarter_2008_Facts_and_Figures.pdf)
- 4 Jail Profile Survey (2008), California Department of Corrections & Rehabilitation (CDCR), [http://www.cdcr.ca.gov/Divisions\\_Boards/CSA/FSO/Docs/2008\\_4th\\_Qtr\\_JPS\\_full\\_report.pdf](http://www.cdcr.ca.gov/Divisions_Boards/CSA/FSO/Docs/2008_4th_Qtr_JPS_full_report.pdf)
- 5 DEER2011\_NTGR\_2012-05-16.xls from DEER Database for Energy-Efficient Resources; Version 2011 4.01  
Under: DEER2011 Update Documentation linked at: DEER2011 Update Net-To-Gross table Cells: T56 and U56
- 6 The Benefits of Ozone in Hospitality On-Premise Laundry Operations, PG&E Emerging Technologies Program, Application Assessment Report #0802, April 2009.
- 7 Federal Register, Vol. 52, No. 166
- 8 2009 ASHRAE Handbook – Fundamentals, Thermodynamic Properties of Water at Saturation, Section 1.1 (Table 3), 2009
- 9 Table 2 through 6: Excel file summarizing data collected from existing ozone laundry projects that received incentives under the NRR-DR program
- 10 DOE Technical Support Document Chapter 6, 2010  
<https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf>
- 11 GTI Residential Ozone Laundry Field Demonstration (May 2018)

---

<sup>361</sup> Confirmed through communications with national vendors and available references, via an online forum (The Ozone Laundry Blog – The Importance of Maintenance).

**MEASURE CODE CI-HWE-OZLD-V05-210101**

**REVIEW DEADLINE: 1/1/2023**

### 4.3.7 Multifamily Central Domestic Hot Water Plants

**DESCRIPTION**

This measure covers multifamily central domestic hot water (DHW) plants with thermal efficiencies greater than or equal to 88%. This measure is applicable to any combination of boilers and storage tanks provided the thermal efficiency of the boilers is greater than 88%. Plants providing other than solely DHW are not applicable to this measure.

This measure was developed to be applicable to the following program types: TOS, NC, ER.

If applied to other program types, the measure savings should be verified.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

**DEFINITION OF EFFICIENT EQUIPMENT**

To qualify the boiler(s) must have a Thermal Efficiency of 88% or greater and supply domestic hot water to multi-family buildings.

**DEFINITION OF BASELINE EQUIPMENT**

For TOS the baseline boiler is assumed to have a Thermal Efficiency of 80%.<sup>362</sup>

For Early Replacement the savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit as above and efficient unit consumption for the remainder of the measure life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life for the domestic hot water boilers is 15 years.<sup>363</sup>

**DEEMED MEASURE COST**

TOS: The actual install cost should be used for the efficient case, minus the baseline cost assumption provided below:

Capacity Range	Baseline Installed Cost per kBtu <sup>364</sup>
<300kBtuh	\$65 per kBtUh
300 – 2500 kBtuh	\$38 per kBtUh
>2500 kBtuh	\$32 per kBtUh

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

<sup>362</sup> International Energy Conservation Code (IECC) 2012/2015/2018, Table C404.2, Minimum Performance of Water-Heating Equipment.

<sup>363</sup> Nicor Gas Energy Efficiency Plan 2011-2014. Revised Plan Filed Pursuant to Order Docket 10-0562, May 27, 2011.

<sup>364</sup> Baseline install costs are based on data from the “2010-2012 WO017 Ex Ante Measure Cost Study”, Itron, California Public Utilities Commission. The data is provided in a file named “MCS Results Matrix – Volume I”.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

There are no anticipated electrical savings from this measure.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

Time of Sale:

$$\begin{aligned} \Delta\text{Therms} &= \text{Hot Water Savings} + \text{Standby Loss Savings} \\ &= \left[ \frac{(\text{MFHH} * \#\text{Units} * \text{GPD} * \text{Days/yr} * \nu\text{Water} * (\text{Tout} - \text{Tin}) * (1/\text{Eff\_base} - 1/\text{Eff\_ee}))}{100,000} \right] + \left[ \frac{(\text{SL} * \text{Hours/yr} * (1/\text{Eff\_base} - 1/\text{Eff\_ee}))}{100,000} \right] \end{aligned}$$

Early Replacment:<sup>365</sup>

$$\begin{aligned} \Delta\text{Therms for remaining life of existing unit (1st 5 years):} \\ &= \left[ \frac{(\text{MFHH} * \#\text{Units} * \text{GPD} * \text{Days/yr} * \nu\text{Water} * (\text{Tout} - \text{Tin}) * (1/\text{Eff\_exist} - 1/\text{Eff\_ee}))}{100,000} \right] + \left[ \frac{(\text{SL} * \text{Hours/yr} * (1/\text{Eff\_exist} - 1/\text{Eff\_ee}))}{100,000} \right] \end{aligned}$$

$$\begin{aligned} \Delta\text{Therms for remaining measure life (next 10 years):} \\ &= \left[ \frac{(\text{MFHH} * \#\text{Units} * \text{GPD} * \text{Days/yr} * \nu\text{Water} * (\text{Tout} - \text{Tin}) * (1/\text{Eff\_base} - 1/\text{Eff\_ee}))}{100,000} \right] + \left[ \frac{(\text{SL} * \text{Hours/yr} * (1/\text{Eff\_base} - 1/\text{Eff\_ee}))}{100,000} \right] \end{aligned}$$

Where:

- MFHH = number of people in Multi-Family household  
= Actual. If unknown assume 2.1 persons/unit<sup>366</sup>
- #Units = Number of units served by hot water boiler  
= Actual
- GPD = Gallons of hot water used per person per day  
= Actual. If unknown assume 17.6 gallons per person per day<sup>367</sup>
- Days/yr = 365.25
- $\nu$ Water = Specific Weight of Water  
= 8.33 gal/lb
- Tout = tank temperature of hot water

<sup>365</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

<sup>366</sup> Navigant, ComEd PY3 Multi-Family Home Energy Savings Program Evaluation Report Final, May 16, 2012.

<sup>367</sup> Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

	= 125°F or custom				
Tin	= Incoming water temperature from well or municiple system = 54°F <sup>368</sup>				
Eff_base	= thermal efficiency of base unit = 80% <sup>369</sup>				
Eff_ee	= thermal efficiency of efficient unit complying with this measure = Actual. If unknown assume 88%				
Eff_exist	= thermal efficiency of existing unit = Actual. If unknown assume 73% <sup>370</sup>				
SL	= Standby Loss <sup>371</sup> = (Input rating / 800) + (110 * vTank Volume). <table style="margin-left: 40px;"> <tr> <td>Input rating</td> <td>= Name plate input capacity in Btuh</td> </tr> <tr> <td>Tank Volume</td> <td>= Rated volume of the tank in gallons</td> </tr> </table>	Input rating	= Name plate input capacity in Btuh	Tank Volume	= Rated volume of the tank in gallons
Input rating	= Name plate input capacity in Btuh				
Tank Volume	= Rated volume of the tank in gallons				
Hours / yr	= 8766 hours				
100,000	= btu/therm				

---

<sup>368</sup> US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy.

<sup>369</sup> IECC 2012/2015, Table C404.2, Minimum Performance of Water-Heating Equipment

<sup>370</sup> Based upon DCEO data provided 10/2014; average age adjusted efficiency of existing units replaced through the program. Efficiency age adjustment of 0.5% per year based upon NREL “Building America Performance Analysis Procedures for Existing Homes”.

<sup>371</sup> Stand-by loss is provided in IECC 2012/2015/2018, Table C404.2, Minimum Performance of Water-Heating Equipment.

**Time of Sale:**

**For example**, an 88% 1000 gallon boiler with 150,000 Btuh input rating installed serving 50 units.

$$\begin{aligned} \Delta\text{Therms} &= \text{Hot Water Savings} + \text{Standby Loss Savings} \\ &= \left[ \frac{(\text{MFHH} * \#\text{Units} * \text{GPD} * \text{Days/yr} * \nu\text{Water} * (\text{Tout} - \text{Tin}) * (1/\text{Eff\_base} - 1/\text{Eff\_ee}))}{100,000} \right] + \left[ \frac{(\text{SL} * \text{Hours/yr} * (1/\text{Eff\_base} - 1/\text{Eff\_ee}))}{100,000} \right] \\ &= \left[ \frac{(2.1 * 50 * 17.6 * 8.33 * 365.25 * 1.0 * (125-54) * (1/0.8 - 1/0.88))}{100000} \right] + \left[ \frac{((150000/800 + (110 * \nu 1000)) * 8766 * (1/0.8 - 1/0.88))}{100000} \right] \\ &= 454 + 37 \\ &= 490 \text{ therms} \end{aligned}$$

**Early Replacement:**

**For example**, an 88% 1000 gallon boiler with 150,000 Btuh input rating installed serving 50 units replaces a working unit with unknown efficiency.

$$\begin{aligned} \Delta\text{Therms for remaining life of existing unit (1st 5 years):} &= \left[ \frac{(2.1 * 50 * 17.6 * 8.33 * 365.25 * 1.0 * (125-54) * (1/0.73 - 1/0.88))}{100000} \right] + \left[ \frac{((150000/800 + (110 * \nu 1000)) * 8766 * (1/0.73 - 1/0.88))}{100000} \right] \\ &= 932 + 75 \\ &= 1007 \text{ therms} \end{aligned}$$

$$\begin{aligned} \Delta\text{Therms for remaining measure life (next 10 years):} &= 454 + 37 \text{ (as above)} \\ &= 490 \text{ therms} \end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HWE-MDHW-V04-200101**

**REVIEW DEADLINE: 1/1/2023**

## 4.3.8 Controls for Central Domestic Hot Water

### DESCRIPTION

Demand control recirculation pumps seek to reduce inefficiency by combining control via temperature and demand inputs, whereby the controller will not activate the recirculation pump unless both (a) the recirculation loop return water has dropped below a prescribed temperature (e.g. 100°F) and (b) a CDHW demand is sensed as water flow through the CDHW system.

This measure was developed to be applicable to the following program types: TOS, RF, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Re-circulating pump shall cycle on based on (a) the recirculation loop return water dropping below a prescribed temperature (e.g. 100°F) and (b) a CDHW demand is sensed as water flow through the CDHW system.

### DEFINITION OF BASELINE EQUIPMENT

The base case for this measure category are existing, un-controlled Recirculation Pumps on gas-fired Central Domestic Hot Water Systems.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The effective useful life is 15 years.<sup>372</sup>

### DEEMED MEASURE COST

The average cost of the demand controller circulation kit is \$1,608 with an installation cost of \$400 for a total measure cost of \$2,008.<sup>373</sup>

### LOADSHAPE

Loadshape C02 - Non-Residential Electric DHW

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

Deemed at 656 kWh.<sup>374</sup>

---

<sup>372</sup> Benningfield Group. (2009). *PY 2009 Monitoring Report: Demand Control for Multifamily Central Domestic Hot Water*. Folsom, CA: Prepared for Southern California Gas Company, October 30, 2009.

<sup>373</sup> The incremental costs were averaged based on the following multi-family and dormitory building studies-

- Gas Technology Institute. (2014). *1003: Demand-based domestic hot water recirculation Public project report*. Des Plaines, IL: Prepared for Nicor Gas, January 7, 2014.
- Studies performed in multiple dormitory buildings in the California region for Southern California Gas' PREPS Program, 2012.

<sup>374</sup> This value is the average kWh saved per pump based on results from Multi-Family buildings studied in Nicor Gas Emerging Technology Program study and Southern California Gas' study in multiple dormitory buildings. Note this value does not reflect

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

Gas savings for this measure can be calculated by using site specific boiler size and boiler usage information or deemed values are provided based on number of rooms for Dormitories and number of apartments for Multi-Family buildings.<sup>375</sup>

$$\Delta \text{Therms} = \text{Boiler Input Capacity} * (t_{\text{normal occ}} * R_{\text{normal occ}} + t_{\text{low occ}} * R_{\text{low occ}}) / 100,000$$

Where:

- Boiler Input Capacity = Input capacity of the Domestic Hot Water boiler in BTU/hr.
  - = If the facility uses the same boiler for space heat and domestic hot water, estimate the boiler input capacity for only domestic hot water loads. If this cannot be estimated, use 22.75% of total boiler input capacity for Multi-Family Buildings<sup>376</sup> and 16.48% of total boiler input capacity for Dormitories<sup>377</sup>, as domestic hot water load.
  - = If unknown capacity use 4,938 BTU/hr per room for Dormitories<sup>378</sup> and 12,493 BTU/hr per apartment for Multi-Family Buildings.<sup>379</sup>
- $t_{\text{normal occ}}$  = Total operating hours of domestic hot water burner, when the facility has normal occupancy. If unknown, assume 1,688 hours for Dormitories<sup>380</sup> and 2,089 hours for Multi-Family buildings.<sup>381</sup>
- $t_{\text{low occ}}$  = Total operating hours of domestic hot water burner, when the facility has low occupancy.<sup>382</sup> If unknown, assume 520 hours for Dormitories and 0 hours for Multi-Family buildings.

savings from electric units but electrical savings from gas-fired units. See 'CDHW Controls Summary Calculations.xlsx' for more information.

<sup>375</sup> See 'CDHW Controls Summary Calculations.xlsx' for more information.

<sup>376</sup> This is an average number based on Residential Energy Consumption Survey (2009) data and Commercial Building Energy Consumption Survey (2012) data compiled by U.S. Energy Information Administration, for buildings with more than 5 apartments in Illinois and Nursing Home and Assisted Living facilities in Midwest.

<sup>377</sup> This is based on Commercial Building Energy Consumption Survey (2012) data compiled by U.S. Energy Information Administration, for Education facilities in East North Central.

<sup>378</sup> This is based on studies done in multiple university dormitory buildings in the California region, for Southern California Gas' PREPS Program, 2012. It closely matches the design guidelines outlined in 2007 ASHRAE Handbook, Chapter 49: Service Water Heating, Table 7, and assumes 1 to 2 students per dorm room based on typical dorm room layouts. This source provides the source for dormitory assumptions of Boiler Input Capacity,  $t_{\text{low occ}}$ ,  $R_{\text{normal occ}}$  and  $R_{\text{low occ}}$ .

<sup>379</sup> This is based on studies done at Multi-Family Buildings for the Nicor Gas Emerging Technology Program by Gas Technology Institute. It closely matches the design guidelines outlined in 2007 ASHRAE Handbook, Chapter 49: Service Water Heating, Table 9, and assumes 2.1 persons per apartment as per ComEd PY3 Multi-Family Home Energy Savings Program Evaluation Report Final, May 16, 2012 by Navigant. This source provides the source for dormitory assumptions of Boiler Input Capacity,  $t_{\text{low occ}}$ ,  $R_{\text{normal occ}}$  and  $R_{\text{low occ}}$ .

<sup>380</sup> Based on results of studies performed in multiple university dormitory buildings in the California region, for Southern California Gas' PREPS Program, 2012.

<sup>381</sup> Based on results of the studies done at Multi-Family Buildings for the Nicor Gas Emerging Technology Program:  
 - Gas Technology Institute. (2014). *1003: Demand-based domestic hot water recirculation Public project report*. Des Plaines, IL: Prepared for Nicor Gas, January 7, 2014.

<sup>382</sup> Low occupancy periods for dormitory buildings can be assumed as vacation day or holiday occupancy.



$R_{\text{normal occ}}$	<p>= Reduction(%) in total operating hours of domestic hot water burner, due to installed central domestic hot water controls, during normal occupancy period.</p> <p>= 22.44% for Dormitories</p> <p>= 24.02% for Multi-Family Buildings</p>
$R_{\text{low occ}}$	<p>= Reduction(%) in total operating hours of domestic hot water burner, due to installed central domestic hot water controls, during low occupancy period.</p> <p>= 44.57% for Dormitories</p> <p>= 0% for Multi-Family Buildings</p>

Based on defaults above:

$$\Delta\text{Therms} = 30.1 * \text{number of rooms (for Dormitories)}$$

$$= 62.7 * \text{number of apartments (for Multi-Family buildings)}$$

**For example**, a dormitory building has a 400,000 BTU/hr boiler whose burner operates for an estimated 580 hours during vacation months and 1,300 hours during regular occupancy months. Savings from installing central domestic hot water controls in this building are -

$$\Delta\text{Therms} = 400,000 \text{ BTU/hr} * (1,300 * 0.2244 + 580 * 0.4457) / 100,000$$

$$= 2,200.9 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HWE-CDHW-V02-180101**

**REVIEW DEADLINE: 1/1/2022**

### 4.3.9 Heat Recovery Grease Trap Filter

**DESCRIPTION**

A heat recovery grease trap filter combines grease filters and a heat exchanger to recover heat leaving kitchen hoods. As a direct replacement for conventional hood mounted filters in commercial kitchens, they are plumbed to the domestic hot water system to provide preheating energy to incoming water.

This measure was developed to be applicable to the following program types: NC and RF. If applied to other program types, the measure savings should be verified. For NC projects, this measure may be applicable if code requirements are otherwise satisfied.

**DEFINITION OF EFFICIENT EQUIPMENT**

Grease filters with heat exchangers carrying domestic hot water in kitchen exhaust air ducts.

**DEFINITION OF BASELINE EQUIPMENT**

Kitchen exhaust air duct with constant air flow and no heat recovery.<sup>383</sup>

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 15 years.<sup>384</sup>

**DEEMED MEASURE COST**

Full installation costs, including plumbing materials, labor and any associated controls, should be used for screening purposes.

**LOADSHAPE**

Loadshape C01 - Commercial Electric Cooking

**COINCIDENCE FACTOR**

Summer Peak Coincidence Factor for measure is provided below for different building type:<sup>385</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.36
Unknown	0.40

<sup>383</sup> Savings methodology factors are for a constant speed fan.

<sup>384</sup> Professional judgement, consistent with expected lifetime of kitchen demand ventilation controls and other kitchen equipment.

<sup>385</sup>Minnesota 2012 Technical Reference Manual, Electric Food Service\_v03.2.xls

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

For electric hot water heaters:

$$\Delta kWh = \frac{[(Meal/Day * HW/Meal * Days/Year) * lbs/gal * BTU/lb.^{\circ}F * (\Delta T/filter * Qty\_Filter) * 0.00293]}{(\eta_{HeaterElec})}$$

Where:

- Meal/Day = Average number of meals served per day. If not directly available, see Table 1.
- HW/Meal = Hot water required per meal  
= 3 gal/meal<sup>386</sup>
- Days/Year = Number of days kitchen operates per year. If not directly available, see Table 1.
- Lbs/gal = weight of water  
= 8.3 lbs/gal
- BTU/lb.°F = Specific heat of water  
= 1.0
- ΔT/filter = Temperature difference of domestic water across each filter  
= 5.8°F/filter<sup>387</sup>
- Qty\_Filter = Number of heat recovery grease trap filters installed. If not directly available, see Table 1.

**Commercial Kitchen Load based on Building Type**

Building Type	Meals/Day <sup>388</sup>	Assumed days/Year	Number of Filters <sup>389</sup>
Primary School	400	312	2
Secondary School	600	312	3
Quick Service Restaurant	800	312	5
Full Service Restaurant	780	312	4
Large Hotel	780	356	4
Hospital	800	356	4

$\eta_{HeaterElec}$  = Efficiency of the Electric water heater.

<sup>386</sup> Average dishwashing and faucet water usage taken from Chapter 8, Table 8.3.3 Normalized Annual End Uses of Water in Select Restaurants in Western United States.

<sup>387</sup> Average value based on case studies. Northwinds Sailing, Inc. and North Shore Sustainable Energy, LLC. *Angry Trout Café Kitchen Exhaust Heat Recovery*. Minnesota Department of Commerce, Division of Energy Resources, 2012.

<sup>388</sup> Commercial Kitchen Loads for listed buildings in U.S. Department of Energy Commercial Reference Building Models of the National Building Stock, NREL

<sup>389</sup> Each filter is 20 X 20 inches.

= Actual. If unknown, for retrofit use the table C404.2 in IECC 2012. For new construction use the active code at time the permit was issued.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh/Hours * CF$$

Where:

Hours = Hours of operation of kitchen exhaust air fan. If not directly available use:

Building Type	Kitchen Exhaust Fan Annual Operating Hours <sup>390</sup>
Primary School	4,056
Secondary School	4,056
Quick Service Restaurant	5,616
Full Service Restaurant	5,616
Large Hotel	5,340
Hospital	3,916

CF = Summer Peak Coincidence Factor for measure:<sup>391</sup>

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.36
Unknown	0.40

**NATURAL GAS SAVINGS**

For natural gas hot water heaters:

$$\Delta Therm = [(Meal/Day * HW/Meal * Days/Year) * lbs/gal * BTU/lb .°F * (\Delta T/filter * Qty_Filter)] / (\eta_{HeaterGas} * 100,000)$$

Where:

$\eta_{HeaterGas}$  = Efficiency of the Gas water heater. If not directly available, use:  
 = Actual. If unknown, for retrofit use the table C404.2 in IECC 2012. For new construction use the active code at time the permit was issued.

Other variables as above.

<sup>390</sup> Exhaust Fan Schedules for listed buildings in U.S. Department of Energy Commercial Reference Building Models of the National Building Stock, NREL.

<sup>391</sup>Minnesota 2012 Technical Reference Manual, Electric Food Service\_v03.2.xls.

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

O&M savings may result from reduced filter and hood cleaning frequencies. More research should be done to understand any potential savings and the associated value.

**MEASURE CODE: CI-HWE-GRTF-V02-200601**

**REVIEW DEADLINE: 1/1/2024**

### 4.3.10 DHW Boiler Tune-up

#### DESCRIPTION

Domestic hot water (DHW) boilers provide hot water for bathrooms, kitchens, tubs and other appliances. Several commercial and industrial facilities such as multi-family buildings, lodging and restaurants have a separate hot water boiler serving DHW loads. Unlike space heating boilers, DHW boilers operate year round, which means they have a greater need to be properly maintained and tuned up.

This measure calculates savings for tuning up a DHW boiler to improve its efficiency and reduce its consumption. A boiler tune-up involves cleaning/inspecting burners, burner nozzles and combustion chambers, adjusting air flow and burner gas input to reduce stack temperatures, and checking venting and safety controls. A pre- and post-tune up combustion efficiency ticket (from combustion analyzer) can be used to confirm the improvement in boiler efficiency.

Boilers that serve only a DHW load are eligible for this measure.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements<sup>392</sup> listed below, by approved technician:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces.
- Inspect all refractory. Patch and wash coat as required.
- Inspect gaskets on front and rear doors and replace as necessary.
- Seal and close front and rear doors properly.
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.
- Clean plugs in control piping.
- Remove all hand hole and man hole plates. Flush boiler with water to remove loose scale and sediment.
- Replace all hand hole and man hole plates with new gaskets.
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.
- Make necessary adjustments to burner for proper combustion.
- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and man hole plates for leaks at normal operating temperatures and pressures.

---

<sup>392</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up.

- Troubleshoot any boiler system problems as requested by on-site personnel

**DEFINITION OF BASELINE EQUIPMENT**

The baseline condition of this measure is a boiler that has not had a tune-up within the past 36 months.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The life of this measure is 3 years.<sup>393</sup>

**DEEMED MEASURE COST**

The cost of this measure is \$0.83/MBtu/hr per tune-up.<sup>394</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = ((T_{\text{out}} - T_{\text{in}}) * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{water}} * 1 * (1/\text{Eff}_{\text{before}} - 1/\text{Eff}_{\text{after}}))/100,000$$

Where:

- $T_{\text{OUT}}$  = Hot water storage tank temperature  
= 125°F
- $T_{\text{IN}}$  = Incoming water temperature from well or municipal system  
= 54°F<sup>395</sup>
- $\text{HotWaterUse}_{\text{Gallon}}$  = Estimated annual hot water consumption (gallons)  
= Actual if possible to provide reasonable custom estimate. If not, the following methods are provided to develop an estimate.<sup>396</sup>

---

<sup>393</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up.

<sup>394</sup> Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

<sup>395</sup> US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy.

<sup>396</sup> Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtu/h or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50

1. Consumption per usable storage tank capacity

$$= \text{Capacity} * \text{Consumption/cap}$$

Where:

Capacity = Usable capacity of hot water storage tank in gallons  
= Actual

Consumption/cap = Estimate of consumption per gallon of usable tank capacity, based on building type:

Building Type <sup>397</sup>	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894

2. Consumption per unit area by building type

$$= (\text{Area}/1000) * \text{Consumption}/1,000 \text{ sq.ft.}$$

Where:

Area = Area in sq.ft that is served by DHW boiler  
= Actual

Consumption/1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:

Building Type	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941

Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

<sup>397</sup> According to CBECS 2012 “Lodging” buildings include Dormitories, Hotels, Motel or Inns and other Lodging and “Nursing” buildings include Assisted Living and Nursing Homes.



Building Type	Consumption/1,000 sq.ft.
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

$\gamma_{\text{water}}$  = Specific weight capacity of water (lb/gal)

= 8.33 lbs/gal

1 = Specific heat of water (Btu/lb.°F)

$\text{Eff}_{\text{before}}$  = Efficiency of the boiler before tune-up

$\text{Eff}_{\text{after}}$  = Efficiency of the boiler after tune-up

100,000 = Converts Btu to therms

*Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the year and take readings at a consistent firing rate for pre and post tune-up.*

**For example**, tune up of a DHW Boiler heating a 100 gallon storage tank in a nursing home, measuring 80% AFUE prior to tune up and 82.2% AFUE after.

$$\begin{aligned} \Delta\text{Therms} &= ((T_{\text{out}} - T_{\text{in}}) * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{water}} * 1 * (1/\text{Eff}_{\text{before}} - 1/\text{Eff}_{\text{after}}))/100,000 \\ &= ((125 - 54) * (100 * 672) * 8.33 * 1 * (1/0.8 - 1/0.822))/100,000 \\ &= 13.3 \text{ therms} \end{aligned}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HWE-DBTU-V01-180101**

**REVIEW DEADLINE: 1/1/2024**

### 4.3.11 Tunnel Washers

#### **DESCRIPTION**

Laundry equipment can be found at a variety of facilities, including hospitals, hotels, health clubs, penitentiaries, and others. Typically, these facilities use conventional batch washing machines for laundering their linens, towels, napkins and tablecloths, and uniforms. The uniformity of the feedstocks makes them good candidates for conversion to a continuous-batch tunnel washing machine system, which ultimately utilizes less water and detergent than conventional systems. The water savings are ultimately based on a comparison of the water efficiencies between the baseline and efficient equipment (measured in gallons of water per pound of laundry).

#### **DEFINITION OF EFFICIENT EQUIPMENT**

A tunnel washing machine utilizes a porous Archimedes screw to move laundry and wash water in opposite (or counterflow) directions. The laundry travels in the upslope direction, while the wash water travels downslope through the holes in the Archimedes screw. The laundry gets progressively cleaner as it travels up the screw, while the wash water gets progressively dirtier as it travels down the screw. The screw can be programmed to intermittently change direction, to provide additional agitation. The mechanical action of the screw and travel path of the wash water through holes helps significantly with the cleaning action of the tunnel washer, allowing a reduction in the amount of detergent and rinse water required.

In contrast to the baseline equipment, the tunnel washer reuses the “rinse” water from the top section of the tunnel into the lower “wash” water sections, along with the gradual introduction of detergent. The continuous counterflow of laundry and wash water ultimately results in a more water-efficient system.

Tunnel washers also utilize automated PLC computer controls to constantly monitor water temperatures in each section of the tunnel and to automate the introduction of fresh water and detergent. The speed of the Archimedes screw can adjust for the varying dirt load of the laundry input. The computer system can typically collect performance data (gallons of water, pounds of detergent, pounds of laundry) over time to continuously evaluate system efficiency.

Tunnel washers can utilize either a hydraulic press extractor to “squeeze” water out of the linen or a more conventional centrifugal extractor that spins the linen to remove the water.

Tunnel washers can also reduce manhours required to process the laundry, as a staff is not required to manually load and unload each batch. The continuous feed of laundry in a tunnel washing machine system requires less labor and reduces the potential for injury from sticking hand and arms into a conventional washing machine drum.

Tunnel washers are quite large compared to conventional washers and require a significant footprint in the facility. In addition, they require approximately 12 feet of ceiling clearance above the top of the tunnel washer for proper installation.

#### **DEFINITION OF BASELINE EQUIPMENT**

A traditional batch washing machine has discrete washing and rinsing cycles, wherein the water gets completely drained at the end of each cycle.

Typical top-loading washing machines used in homes and laundromats use approximately 40 gallons of water per load. This equates to 20 gallons for the wash cycle and 20 gallons for the rinse cycle. Some facilities will even utilize a second rinse cycle. The vertical axis design requires enough water in the drum to suspend the fabric in the soapy water.

The next step up in efficiency is a front-loading (or horizontal axis) washing machines. They typically use 20 to 30 gallons of water per load. This equates to 10-15 gallons for the wash cycle and 10-15 gallons for the rinse cycle.

Larger horizontal-axis washing machines can consume up to 45 gallons of water per load, equating to 22 gallons for the wash cycle and 22 gallons for the rinse cycle.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The life of this measure is assumed to be 15 years for a new tunnel washing machine.<sup>398</sup>

**DEEMED MEASURE COST**

The actual cost of the measure should be used.<sup>399</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

Energy savings from conversion from conventional washing machines to tunnel washing machines are the result of reduced water consumption and reduced natural gas consumption from heating water. There are indirect electric energy savings from reduced potable water treatment and wastewater treatment.

**ELECTRIC ENERGY SAVINGS**

The electric energy savings are based indirectly on the reduced electricity usage attributed to the water savings from the tunnel washing machine. By applying an “Energy Factor”, the water savings (in gallons/year) can be converted to electricity savings (in kWh/year). This “Energy Factor” considers the electric energy requirements of water treatment plants and water distribution infrastructure, and wastewater treatment and distribution infrastructure.

The methodology for estimating water savings is as follows:

$$\Delta\text{Water} = [\text{BWME} - \text{TWME}] \times \text{PLD} \times \text{ADPY}$$

- $\Delta\text{Water}$  = Total Water Savings (gallons/year)
- $\text{BWME}$  = Baseline Washing Machine Efficiency (gal of water / lb. of laundry)
- $\text{TWME}$  = Tunnel Washing Machine Efficiency (gal of water / lb. of laundry)
- $\text{PLD}$  = Pounds of Laundry Per Day (lb. laundry/day)
- $\text{ADPY}$  = Annual Days Per Year (days/year)

The values for BWME and TWME should be taken from actual equipment specifications or actual measurements (water flow meters and mechanical scales).

Typical values for TWME can be range from 0.75-1.0 gal. of water/lb. of laundry.<sup>400</sup> Some equipment vendors have claimed TWME approaching 0.3-0.4 gal. of water/lb. of laundry.<sup>401</sup> For the purposes of this measure, a TWME value of 0.87 gal. of water/lb. of laundry will be used.

---

<sup>398</sup> Table 8-18: Average Useful Lifetime of Commercial Washing Equipment, Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances, Navigant Consulting, December 21, 2009.

<sup>399</sup> One study found the average cost of tunnel washers to be \$1,100,000. Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances, Navigant Consulting, December 21, 2009.  
[https://www1.eere.energy.gov/buildings/publications/pdfs/corporate/commercial\\_appliances\\_report\\_12-09.pdf](https://www1.eere.energy.gov/buildings/publications/pdfs/corporate/commercial_appliances_report_12-09.pdf)

<sup>400</sup> Matt Poe. “Efficient, Flexible Tunnel Washers: Tunnel washers have made leaps forward in technology, productivity in the past 10 years”, *American Laundry News*, 12/11/18. <<https://americanlaundrynews.com/articles/efficient-flexible-tunnel-washers>>

<sup>401</sup> Ibid.

Typical values for BWME can range from 1.8-3.0 gal. of water/lb. of laundry.<sup>402</sup> For the purposes of this measure, a BWME value of 2.03 gal. of water/lb. of laundry will be used.<sup>403</sup>

The PLD is specific to each individual facility. An occupied hotel room typically produces 11 pounds of laundry per day.<sup>404</sup> An occupied hospital bed likely produces a similar amount of laundry load. The laundry loads of restaurants, health clubs, prisons, and other facilities need to be quantified using actual facility data.

The PLD can also be estimated from the Ozone Laundry Measure in the IL TRM, section 4.3.6. This measure gives a Washer Utilization Factor (Wutil) of 916,150 pounds/year of laundry for a typical facility.<sup>405</sup> Assuming 365 days/year of laundry activity, this would give a PLD of 2,508 pounds of laundry per day.

The ADPY is often 365 days per year for facilities that never shut down, including hospitals, hotels, and prisons. Other facilities may have regular shutdown periods, so the ADPY value should be adjusted as necessary.

The electricity savings for this measure can be calculated by applying the energy factor to the ΔWater. This EF considers savings from both potable water treatment and wastewater treatment.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water \text{ total}}$$

Where

$$E_{water \text{ total}} = \text{IL Total Water Energy Factor (kWh/Million Gallons)} \\ = 5,010^{406}$$

**For example**, switching from conventional washing machine technology to tunnel washing machine technology, at a facility that processes the defined 916,150 pounds/year (Wutil) and is open every day of the year.

$$\Delta Water = [BWME - TWME] \times PLD \times ADPY \\ = [(2.03 - 0.87) \text{ gal. of water/lb. of laundry}] \times (916,150 \text{ lb. of laundry/year}) \\ = 1,062,734 \text{ gal. of water/year}$$

$$\Delta kWh_{water} = \Delta Water / 1,000,000 * E_{water \text{ total}} \\ = (1,062,734 \text{ gal. of water/year}) / 1,000,000 * 5,010 \text{ kWh/million gallons} \\ = 5,324 \text{ kWh/year}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

Since the times of day from the water savings measure do not necessarily coincide with the times of day that the water treatment and distribution equipment is in use, the coincident peak demand savings cannot be determined.

<sup>402</sup> Theresa Boehl. "Tunnel Washers: The Answer to Rising Labor, Utility Costs?", *American Laundry News*, 5/27/14.

<<https://americanlaundrynews.com/articles/tunnel-washers>>

<sup>403</sup> IL TRM Section 4.3.6 "Ozone Laundry"

<sup>404</sup> Joseph Ricci. "Outsourced Hotel Laundries: The Value of Certification", *Lodging*, 3/28/17.

<<https://lodgingmagazine.com/outsourced-hotel-laundries-the-value-of-certification/>>

<sup>405</sup> IL TRM Section 4.3.6 footnote for  $W_{util}$ , which states "Average utilization factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program."

<sup>406</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

**NATURAL GAS SAVINGS**

With reduced water use by the installation of a tunnel washer, the DHW boiler used to heat the incoming water will use significantly less gas. The below algorithm can be used to calculate natural gas savings for hot water heating.

$$\Delta\text{Therms} = ((T_{\text{out}} - T_{\text{in}}) * \text{HotWaterReduction}_{\text{Gallon}} * \gamma_{\text{water}} * 1 * (1/\text{Eff}))/100,000$$

Where:

- $T_{\text{OUT}}$  = Hot water storage tank temperature  
= 125°F
- $T_{\text{IN}}$  = Incoming water temperature from well or municipal system  
= 54°F<sup>407</sup>
- $\text{HotWaterReduction}_{\text{Gallon}}$  = Estimated annual hot water reduction (gallons)  
= Actual custom estimate
- $\gamma_{\text{water}}$  = Specific weight capacity of water (lb/gal)  
= 8.33 lbs/gal
- 1 = Specific heat of water (Btu/lb.°F)
- Eff = Efficiency of the boiler  
= Use actual efficiency, otherwise use 80% AFUE
- 100,000 = Converts Btu to therms

**For example**, a DHW Boiler with an efficiency of 80% AFUE heats a 100 gallon storage tank in a laundry facility using a tunnel washer. Use of the tunnel washer will save the original laundry site an estimated 1,062,734 gallons of water the below example savings:

$$\begin{aligned} \Delta\text{Therms} &= ((T_{\text{out}} - T_{\text{in}}) * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{water}} * 1 * (1/\text{Eff}))/100,000 \\ &= ((125 - 54) * 1,062,734 * 8.33 * 1 * (1/0.8))/100,000 \\ &= 7856 \text{ therms} \end{aligned}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

The water savings from the tunnel washing machines will help preserve water supplies, extend the life of water treatment and wastewater treatment plants. The reduction in detergent requirements will also have cost and environmental benefits.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Actual O&M cost adjustments should be used for this measure.<sup>408</sup>

<sup>407</sup>US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy

<sup>408</sup> Annual repair & maintenance costs have been estimated at \$19,000 per unit. Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances, Navigant Consulting, December 21, 2009.

[https://www1.eere.energy.gov/buildings/publications/pdfs/corporate/commercial\\_appliances\\_report\\_12-09.pdf](https://www1.eere.energy.gov/buildings/publications/pdfs/corporate/commercial_appliances_report_12-09.pdf)

**MEASURE CODE: CI-HWE-TUWA-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.3.12 Tank Insulation

### DESCRIPTION

This measure provides rebates for installation of 1” or 2” fiberglass, mineral fiber, or other types of insulation with similar properties to existing bare heated tanks for industrial and some commercial installations. Storage tanks can hold any heated material including, but not limited to, hot water, thermal oil, chemicals, and asphalt.

Default per square foot savings estimates are provided for both exposed indoor and outdoor storage tanks that are heated by heat transfer fluids including steam and thermal oil. Only systems heated with natural gas are eligible for this measure.

Indoor tanks require at least 1” of insulation and outdoor tanks must have at least 2 inches of insulation and include an all-weather protective jacket. New advanced insulating materials may be thinner and savings can be calculated with 3E Plus v4.1.<sup>409</sup>

This measure was developed to be applicable to the following program types: RF (Retrofit), DI (Direct Install). If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is installing tank insulation to an uninsulated, heated material storage tank. Indoor tanks must have at least 1 inch of insulation (R-value of 2.1) and outdoor tanks must have at least 2” of insulation (R--value of 4.2) and include an all-weather protective jacket.

### DEFINITION OF BASELINE EQUIPMENT

The base case for savings estimates is a bare, steel tank. Other tank materials can be used to calculate savings with 3E Plus v4.1. Tanks are not required by mechanical codes to be insulated and are commonly found without any insulation.<sup>410</sup>

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.<sup>411</sup>

### INCREMENTAL MEASURE COST

The incremental cost for this measure is \$12/ft<sup>2</sup>.<sup>412</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

<sup>409</sup> 3E Plus v4.1 is a heat loss calculation software provided by the NAIMA (North American Insulation Manufacturer Association).

<sup>410</sup> ASHRAE Handbook – Fundamentals 2017 lists requirements for pipe and duct insulation but does not mention tank insulation.

<sup>411</sup> Based on the California Municipal Utilities Association Technical Reference Manual Third Edition measure 14.1.

<sup>412</sup> Based on RS Means Data Line Number 220719101162.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = [\text{ESF}_b * A_b + \text{ESF}_e * A_e] * \text{Hours} * \text{LF} * \text{TRF} / (100,000 * \eta)$$

Where:

$\text{ESF}_b$  = Energy savings factor from tank body defined as the difference in heat loss between an insulated condition and a bare condition as found in table below [Btu/hr/ft<sup>2</sup>]

$A_b$  = Area of tank body [ft<sup>2</sup>]  
= Actual

$\text{ESF}_e$  = Energy savings factor from tank endcap(s) defined as the difference in heat loss between an insulated condition and a bare condition as found in table below [Btu/hr/ft<sup>2</sup>]

$A_e$  = Area of endcap(s) [ft<sup>2</sup>]  
= Combined area of endcaps if tank is oriented horizontally, separate areas if tank is oriented vertically or only one endcap is insulated  
= Actual

Hours = Operating hours of heating system  
= Actual

LF = Load factor of heating system  
= Annual gas consumption / (Hours \* Nameplate Heating Capacity)

TRF = Thermal Regain Factor for space type, applied only to space heating energy, as found in Table 3

100,000 = Conversion factor from BTUs to Therms

$\eta$  = Efficiency of heating equipment used to heat tanks  
= Actual, or if unknown assume 79%<sup>413</sup>

The following table shows conductivities and maximum temperature ratings of similar insulation materials. The average value was used with 3EPlus software to generate the Energy Savings Factors used in the savings algorithm.

**Table 1 – Insulation types**

Insulation Type	Conductivity (Btu.in/ hr.ft <sup>2</sup> .°F @ 300°F)	Max Temp (°F)
Mineral Fiber Pipe and Tank Wrap	0.48	650

<sup>413</sup> Minimum efficiency for steam boilers as set in IECC 2018 code C403.3.2.



Insulation Type	Conductivity (Btu.in/ hr.ft <sup>2</sup> .°F @ 300°F)	Max Temp (°F)
Mineral Fiber Board	0.44	850
Polyurethane	0.5	400
Average	0.47	

The tank surface temperature assumption depends on the system type. The following table should be used to select the appropriate Energy Savings Factor based on the fluid temperature:

**Table 2 – Heating fluid temperatures**

System Type	Fluid Temperature Assumption (°F)
Low Pressure Steam (< 15 psi)	225
High Pressure Steam (> 60 psi)	315
Thermal Oil	425

Thermal regain factors are assumed as follows:

**Table 3 – Thermal Regain Factors<sup>414</sup>**

Tank Location	Assumed Regain	TRF, Thermal Regain Factor
Outdoor	0%	1.0
Indoor, heated space	85%	0.15
Indoor, semi-heated (unconditioned space, with heat transfer to conditioned space. E.g., boiler room)	40%	0.60

The energy savings factors (ESF) were developed using the 3E Plus v4.1 software program, and are derived as the difference in heat loss per square foot of a bare tank and an insulated tank.<sup>415</sup> The energy savings analysis is based on adding 1" (indoor) or 2" (outdoor) thick insulation around bare tanks. Outdoor conditions are assumed to be 48.6°F with a wind speed of 5.0 mph.<sup>416</sup> The thermal conductivity of tank insulation varies by material and temperature rating; to obtain a typical value, a range of materials allowed for this measure was averaged. For insulation materials not in the table above, use 3E Plus v4.1 software to calculate ESF<sub>b</sub> and ESF<sub>e</sub>.

**Energy Savings Factors [Btu/hr/ft<sup>2</sup>]**

		Low Pressure Steam	High Pressure Steam	Thermal Oil
Vertical Tank - Body	Indoor	290.2	559.0	991.8
	Outdoor	373.4	666.0	1132.0
Horizontal Tank - Body	Indoor	290.2	559.0	991.8
	Outdoor	373.4	666.0	1132.0

<sup>414</sup> Thermal regain for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012. Regain factors are assumed to behave similarly for tanks as for piping installations.

<sup>415</sup> Tank insulation calc\_8-4-20.xlsx including tables obtained from 3E Plus v4.1 software.

<sup>416</sup> DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL for the average ambient temperature and wind speed for Aurora, IL. Adjusted to align with ASHRAE 24.4 Terrain Category 1 for Large city centers with densely populated, tall buildings (2017).

		Low Pressure Steam	High Pressure Steam	Thermal Oil
Vertical Tank End - Top	Indoor	336.8	642.8	783.9
	Outdoor	426.3	756.2	1269.6
Vertical Tank End - Bottom	Indoor	189.8	380.0	712.1
	Outdoor	288.1	515.7	897.3
Horizontal Tank End	Indoor	290.2	559.0	991.8
	Outdoor	373.4	666.0	1132.0

**For example**, an outdoor, vertical, cylindrical tank with a radius of 5 ft and height of 15 ft heated by a thermal oil heating system that is insulated around the body and top of the tank would save (assuming 4380 hours of operation, 70% load factor, and 78% efficient thermal oil heater):

$$\begin{aligned} \Delta\text{Therms} &= [\text{ESF}_b * A_b + \text{ESF}_e * A_e] * \text{Hours} * \text{LF} * \text{TRF} / (100,000 * \eta) \\ \text{ESF}_b &= 1132.0 \text{ Btu/hr/ft}^2 \\ A_b &= 2 * \pi * r * h \\ &= 471.2 \text{ ft}^2 \\ \text{ESF}_e &= 1269.6 \text{ Btu/hr/ft}^2 \\ A_e &= \pi * r^2 \\ &= 78.5 \text{ ft}^2 \\ \text{Hours} &= 4380 \\ \text{LF} &= 0.7 \\ \text{TRF} &= 1.0 \\ \eta &= 0.78 \\ \Delta\text{Therms} &= [1132.0 * 471.2 + 1269.6 * 78.5] * 4380 * 0.7 * 1 / (100,000 * 0.78) \\ &= 24,884 \text{ therms} \end{aligned}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HWE-TKIN-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4 HVAC End Use

Many of the commercial HVAC measures use equivalent full load hours (EFLH) to calculate heating and cooling savings. The tables with these values are included in this section and referenced in each measure.

To calculate the updated EFLHs by building type and climate zone provided below, most of the eQuest models that were previously developed by a TAC Subcommittee utilizing building energy models originally developed for ComEd<sup>417</sup>, were migrated to OpenStudio by a parametric calibration process. The parametric runs were controlled with a genetic learning algorithm to characteristically adjust the seed models to achieve an acceptable target error against the existing eQuest model population. The breadth of the characteristic variations were informed through a sensitivity analysis, the IL joint assessment survey, and the existing eQuest models. The DOE prototypical models served as the initial seed model for most instances of calibration except where a direct map to available prototypes was unavailable.

The building characteristics of the eQuest models can be found in the reference table named “EFLH Building Descriptions Updated 2014-11-21.xlsx”. The OpenStudio models are based upon the DOE Prototypes described in NREL’s “U.S. Department of Energy Commercial Reference Building Models of the National Building Stock” and a calibration log file that documents all of the variations made to each model to get them calibrated is provided in “IL-Calibration-Log\_2019-08-27.xlsx”. These documents and all the models are all available on the SharePoint site.

Note where a measure installation is within a building or application that does not fit with any of the defined building types below, the user should apply custom assumptions where it is reasonable to estimate them, else the building of best fit should be utilized.

Equivalent Full Load Hours for Heating (EFLH<sub>Heating</sub>) for Existing Buildings:

Building Type	Heating EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Assembly	1,787	1,831	1,635	1,089	1,669	eQuest
Assisted Living	1,683	1,646	1,446	1,063	1,277	eQuest
Auto Dealership	2,981	2,950	2,694	2,368	2,437	OpenStudio
College	1,256	1,293	1,138	1,116	1,131	OpenStudio
Convenience Store	1,481	1,368	1,214	871	973	eQuest
Drug Store	2,848	2,947	2,568	2,362	2,516	OpenStudio
Elementary School	1,614	1,603	1,409	1,209	1,269	OpenStudio
Emergency Services	2,757	2,670	2,383	2,149	2,186	OpenStudio
Garage	985	969	852	680	752	eQuest
Grocery	1,467	1,551	1,364	1,367	1,375	OpenStudio
Healthcare Clinic	1,446	1,526	1,452	1,553	1,574	OpenStudio
High School	1,807	1,855	1,649	1,591	1,622	OpenStudio
Hospital - CAV no econ <sup>418</sup>	1,216	1,220	1,072	1,001	1,028	OpenStudio
Hospital - CAV econ <sup>419</sup>	1,387	1,398	1,252	1,222	1,269	OpenStudio
Hospital - VAV econ <sup>420</sup>	665	697	628	646	615	OpenStudio
Hospital - FCU	1,622	1,571	1,374	1,220	1,281	OpenStudio

<sup>417</sup> A full description of the ComEd model development is found in “ComEd Portfolio Modeling Report. Energy Center of Wisconsin July 30, 2010” .

<sup>418</sup> Based on model with single duct reheat system with a fixed outdoor air volume.

<sup>419</sup> Based on model with single duct reheat system with airside economizer controls, with constant volume zone reheat boxes and single speed fan motors.

<sup>420</sup> Based on model with single duct reheat system with airside economizer controls, zone VAV reheat boxes and VFD fan motors.

Building Type	Heating EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Hotel/Motel	1,597	1,634	1,468	1,376	1,451	OpenStudio
Hotel/Motel - Common	1,670	1,733	1,549	1,496	1,557	OpenStudio
Hotel/Motel - Guest	1,555	1,597	1,433	1,316	1,400	OpenStudio
Manufacturing Facility	1,048	1,013	939	567	634	eQuest
MF - High Rise	1,565	1,540	1,448	1,089	1,125	OpenStudio
MF - High Rise - Common	537	558	501	480	499	OpenStudio
MF - High Rise - Residential	1,665	1,666	1,512	1,145	1,207	OpenStudio
MF - Mid Rise	1,730	1,782	1,589	1,538	1,560	OpenStudio
Movie Theater	1,916	1,905	1,718	1,288	1,538	eQuest
Office - High Rise - CAV no econ	995	1,036	933	786	832	OpenStudio
Office - High Rise - CAV econ	2,244	2,237	2,024	1,553	1,608	OpenStudio
Office - High Rise - VAV econ	1,552	1,432	1,239	1,077	1,098	OpenStudio
Office - High Rise - FCU	1,015	993	899	773	809	OpenStudio
Office - Low Rise	2,825	2,625	2,365	2,007	2,040	OpenStudio
Office - Mid Rise	1,672	1,629	1,454	1,356	1,399	OpenStudio
Religious Building	1,603	1,504	1,440	1,054	1,205	eQuest
Restaurant	1,326	1,328	1,179	1,091	1,122	OpenStudio
Retail - Department Store	1,365	1,322	1,193	1,034	1,088	OpenStudio
Retail - Strip Mall	1,347	1,325	1,183	1,064	1,096	OpenStudio
Warehouse	1,285	1,286	1,180	1,147	1,224	OpenStudio
Unknown	1,709	1,678	1,508	1,287	1,411	n/a

Equivalent Full Load Hours for Heating (EFLH<sub>Heating</sub>) for New Construction:

Building Type	Heating EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Auto Dealership	1,286	1,185	1,279	1,138	1,078	OpenStudio
College	942	834	906	831	818	OpenStudio
Drug Store	1,023	930	1,017	889	822	OpenStudio
Elementary School	949	878	943	861	859	OpenStudio
Emergency Services	480	352	501	407	347	OpenStudio
Grocery	2,795	2,788	2,549	2,380	2,597	OpenStudio
Healthcare Clinic	1,534	1,417	1,555	1,395	1,371	OpenStudio
High School	1,502	1,549	1,368	1,283	1,299	OpenStudio
Hospital - CAV no econ	2,345	2,207	2,318	2,110	2,195	OpenStudio
Hospital - CAV econ	2,345	2,207	2,318	2,110	2,195	OpenStudio
Hospital - VAV econ	2,345	2,207	2,318	2,110	2,195	OpenStudio
Hospital - FCU	2,345	2,207	2,318	2,110	2,195	OpenStudio
Hotel/Motel - Residential	1,412	1,243	1,439	1,405	1,146	OpenStudio
Hotel_Motel_Common	1,554	1,415	1,519	1,410	1,361	OpenStudio
Hotel_Motel_Guest	1,538	1,083	1,554	1,381	987	OpenStudio
MF - High Rise	1,308	884	1,361	1,125	865	OpenStudio
MF - High Rise - Common	1,581	1,280	1,590	1,349	1,220	OpenStudio
MF - High Rise - Residential	1,352	946	1,413	1,174	917	OpenStudio
MF - Mid Rise	1,637	1,385	1,637	1,434	1,322	OpenStudio

Building Type	Heating EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Office - High Rise - FCU	987	870	1,001	893	837	OpenStudio
Office - High Rise - VAV econ	987	870	1,001	893	837	OpenStudio
Office - Mid Rise	867	759	892	792	701	OpenStudio
Office - High Rise - CAV no econ	967	854	971	876	804	OpenStudio
Office Low Rise	954	916	826	667	664	OpenStudio
Restaurant	787	797	671	811	820	OpenStudio
Retail - Department Store	1,286	1,185	1,279	1,138	1,078	OpenStudio
Retail - Strip Mall	973	867	972	857	777	OpenStudio
Warehouse	1,413	1,390	1,398	1,298	1,290	OpenStudio
Unknown	1,133	1,064	1,091	982	960	n/a

Equivalent Full Load Hours for Cooling (EFLH<sub>cooling</sub>) for Existing Buildings:

Building Type	Cooling EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Assembly	725	796	937	1,183	932	eQuest
Assisted Living	1,475	1,457	1,773	2,110	1,811	eQuest
Auto Dealership	996	1,051	1,343	1,582	1,414	OpenStudio
College	572	564	676	776	613	OpenStudio
Convenience Store	1,088	1,067	1,368	1,541	1,371	eQuest
Drug Store	858	943	1,133	1,279	1,092	OpenStudio
Elementary School	834	837	999	1264	967	OpenStudio
Emergency Services	2,983	3,009	3,762	4,030	3,740	OpenStudio
Garage	934	974	1,226	1,582	1,383	eQuest
Grocery	826	914	1,151	1,329	1,240	OpenStudio
Healthcare Clinic	1,220	1,294	1,505	1,658	1,534	OpenStudio
High School	892	883	1,066	1,397	1,018	OpenStudio
Hospital - CAV no econ	1,719	1,799	2,068	2,238	2,066	OpenStudio
Hospital - CAV econ	1,267	1,302	1,604	1,798	1,592	OpenStudio
Hospital - VAV econ	3,313	3,332	3,458	3,546	3,311	OpenStudio
Hospital - FCU	1,575	1,562	1,921	1,979	1,812	OpenStudio
Hotel/Motel	1,106	1,148	1,453	1,605	1,435	OpenStudio
Hotel/Motel - Common	1,108	1,168	1,430	1,574	1,406	OpenStudio
Hotel/Motel - Guest	1,061	1,106	1,391	1,509	1,401	OpenStudio
Manufacturing Facility	1,010	1,055	1,209	1,453	1,273	eQuest
MF - High Rise	928	920	1,059	1,360	1,205	OpenStudio
MF - High Rise - Common	1,405	1,383	1,479	1,527	1,466	OpenStudio
MF - High Rise - Residential	764	807	976	1,216	1,147	OpenStudio
MF - Mid Rise	787	855	1,099	1,198	1,082	OpenStudio
Movie Theater	876	745	1,036	1,178	1,010	eQuest
Office - High Rise - CAV no econ	1,357	1,404	1,587	1,753	1,468	OpenStudio
Office - High Rise - CAV econ	3,489	3,453	3,663	4,403	4,208	OpenStudio
Office - High Rise - VAV econ	847	887	991	1,092	893	OpenStudio

Building Type	Cooling EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Office - High Rise - FCU	1,083	1,116	1,269	1,348	1,266	OpenStudio
Office - Low Rise	1,796	1,790	2,233	2,342	2,219	OpenStudio
Office - Mid Rise	1,128	1,153	1,360	1,461	1,356	OpenStudio
Religious Building	861	817	967	1,159	1,067	eQuest
Restaurant	990	1,021	1,273	1,411	1,290	OpenStudio
Retail - Department Store	639	640	775	936	812	OpenStudio
Retail - Strip Mall	697	720	915	998	930	OpenStudio
Warehouse	252	265	363	377	379	OpenStudio
Unknown	1,003	1,019	1,230	1,403	1,236	n/a

Equivalent Full Load Hours for Cooling (EFLH<sub>cooling</sub>) for New Construction:

Building Type	Cooling EFLH					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Auto Dealership	806	923	792	938	1,028	OpenStudio
College	925	990	994	1,156	1,217	OpenStudio
Drug Store	813	931	744	836	1,083	OpenStudio
Elementary School	724	821	732	753	999	OpenStudio
Emergency Services	379	429	371	423	576	OpenStudio
Grocery	643	568	569	562	511	OpenStudio
Healthcare Clinic	1,964	2,093	1,932	2,055	2,221	OpenStudio
High School	1,807	1,642	2,093	2,292	1,830	OpenStudio
Hospital - CAV no econ	2,627	2,751	2,662	2,782	2,962	OpenStudio
Hospital - CAV econ	2,627	2,751	2,662	2,782	2,962	OpenStudio
Hospital - VAV econ	2,627	2,751	2,662	2,782	2,962	OpenStudio
Hospital - FCU	2,627	2,751	2,662	2,782	2,962	OpenStudio
Hotel/Motel - Residential	1,639	1,836	1,712	1,851	1,983	OpenStudio
Hotel_Motel_Common	2,343	2,472	2,286	2,400	2,590	OpenStudio
Hotel_Motel_Guest	788	1,024	846	1,073	1,164	OpenStudio
MF - High Rise	1,338	1,705	1,287	1,500	1,932	OpenStudio
MF - High Rise - Common	773	912	751	878	972	OpenStudio
MF - High Rise - Residential	1,299	1,663	1,245	1,451	1,882	OpenStudio
MF - Mid Rise	1,341	1,633	1,245	1,492	1,818	OpenStudio
Office - High Rise - FCU	1,296	1,465	1,281	1,477	1,574	OpenStudio
Office - High Rise - VAV econ	1,296	1,465	1,281	1,477	1,574	OpenStudio
Office - High Rise - CAV no econ	1,433	1,644	1,411	1,632	1,793	OpenStudio
Office - High Rise - CAV econ	1,361	1,375	1,604	1,715	1,617	OpenStudio
Office - Mid Rise	957	1,149	958	1,122	1,270	OpenStudio
Office Low Rise	947	989	1,090	1,302	1,076	OpenStudio
Restaurant	768	761	1,034	1,110	994	OpenStudio
Retail - Department Store	806	924	796	939	1,027	OpenStudio
Retail - Strip Mall	722	789	667	834	911	OpenStudio
Warehouse	389	522	408	527	567	OpenStudio
Unknown	984	1,045	1,047	1,177	1,176	n/a

## 4.4.1 Air Conditioner Tune-up

### DESCRIPTION

An air conditioning system that is operating as designed saves energy and provides adequate cooling and comfort to the conditioned space

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a unitary or split system air conditioner at least 3 tons and preapproved by program. The measure requires that a certified technician performs the following items:

- Check refrigerant charge
- Identify and repair leaks if refrigerant charge is low
- Measure and record refrigerant pressures
- Measure and record temperature drop at indoor coil
- Clean condensate drain line
- Clean outdoor coil and straighten fins
- Clean indoor and outdoor fan blades
- Clean indoor coil with spray-on cleaner and straighten fins
- Repair damaged insulation – suction line
- Change air filter
- Measure and record blower amp draw

A copy of contractor invoices that detail the work performed to identify tune-up items, as well as additional labor and parts to improve/repair air conditioner performance must be submitted to the program.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be an AC system that that does not have a standing maintenance contract or a tune up within in the past 36 months.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 3 years.<sup>421</sup>

### DEEMED MEASURE COST

Tune-up costs can vary considerably, particularly if refrigerant leak detection, remediation and recharge is necessary. Actual invoiced tune-up costs should be used.

### LOADSHAPE

Loadshape C03 - Commercial Cooling

### COINCIDENCE FACTOR

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

---

<sup>421</sup>3 years is given for “Clean Condenser Coils – Commercial” and “Clean Evaporator Coils”. DEER2014 EUL Table.

$$= 91.3\%^{422}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 47.8\%^{423}$$

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (\text{kBtu/hr}) * [(1/\text{EERbefore}) - (1/\text{EERafter})] * \text{EFLH}$$

Where:

kBtu/hr	= capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr). =Actual
EERbefore	= Energy Efficiency Ratio of the baseline equipment prior to tune-up <sup>424</sup> =Actual
EERafter	= Energy Efficiency Ratio of the baseline equipment after to tune-up =Actual
EFLH	= Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

Where it is not possible or appropriate to perform Test in and Test out of the equipment, the following deemed methodology can be used:

$$\Delta kWh = (\text{kBtu/hr}) / \text{EERbefore} * \text{EFLH} * \% \text{Savings}$$

Where:

%Savings	= Deemed percent savings per Tune-Up component. These are additive if condenser cleaning, evaporator cleaning and refrigerant charge correction are performed (totals provided below) <sup>425</sup>
----------	--

---

<sup>422</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>423</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>424</sup> In the context of this measure Energy Efficiency Ratio (EER) refers to field-measured steady-state rate of heat energy removal (e.g., cooling capacity) by the equipment in Btu/h divided by the steady-state rate of energy input to the equipment in watts. This ratio is expressed in Btu/h per watt (Btu/h/watt). The cooling capacity may be derived using either refrigerant or air-side measurements. The measurement is performed at the outdoor and indoor environmental conditions that are present at the time the tune-up is being performed, and should be normalized using a correction function to the AHRI 210/240 Standard test conditions. The correction function should be developed based on manufacturer's performance data. Care must be taken to ensure the unit is fully loaded and operating at or near steady-state. Generally, this requires that the outside air temperature is at least 60°F, and that the unit runs with all stages of cooling enabled for 10 to 15 minutes prior to making measurements. For more information, please see "IL TRM\_Normalizing to AHRI Conditions Method".

<sup>425</sup> Savings estimates are determined by applying the findings from DNV-GL "Impact Evaluation of 2013-2014 HVAC3 Commercial Quality Maintenance Programs", April 2016, to simulate the inefficient condition within select eQuest models and across climate zones. The percent savings were consistent enough across building types and climate zones that it was determined appropriate to apply a single set of assumptions for all. See 'eQuest C&I Tune up Analysis.xlsx' for more information.



Tune-Up Component	% savings
Condenser Cleaning	6.10%
Evaporator Cleaning	0.22%
Refrig. Charge Off. <=20%	0.68%
Refrig. Charge Off. >20%	8.44%
Combined (Refrig. Charge Off. <=20%)	7.00%
Combined (Refrig. Charge Off. >20%)	14.76%

**For example**, a 12 EER 5-ton rooftop air conditioner on a department store in Rockford receives a tune-up that includes both condenser and evaporator cleaning:

$$\begin{aligned} \Delta kWh &= (5 \cdot 12) / 12 * 1,392 * 6.32\% \\ &= 440 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW_{SSP} = (\text{kBtu/hr} * (1/\text{EER}_{\text{before}} - 1/\text{EER}_{\text{after}})) * CF_{SSP}$$

$$\Delta kW_{PJM} = (\text{kBtu/hr} * (1/\text{EER}_{\text{before}} - 1/\text{EER}_{\text{after}})) * CF_{PJM}$$

Where:

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)} \\ &= 91.3\%^{426} \end{aligned}$$

$$\begin{aligned} CF_{PJM} &= \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)} \\ &= 47.8\%^{427} \end{aligned}$$

Where it is not possible or appropriate to perform Test in and Test out of the equipment, the following deemed methodology can be used:

$$\Delta kW = (\text{kBtu/hr}) / \text{EER}_{\text{before}} * \% \text{Savings} * CF$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-ACTU-V06-210101**

**REVIEW DEADLINE: 1/1/2025**

<sup>426</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>427</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

## 4.4.2 Space Heating Boiler Tune-up

### DESCRIPTION

This measure is for a non-residential boiler that provides space heating. The tune-up will improve boiler efficiency by cleaning and/or inspecting burners, combustion chamber, and burner nozzles. Adjust air flow and reduce excessive stack temperatures, adjust burner and gas input. Check venting, safety controls, and adequacy of combustion air intake. Combustion efficiency should be measured before and after tune-up using an electronic flue gas analyzer.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements listed below<sup>428</sup> by approved technician:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces.
- Inspect all refractory. Patch and wash coat as required.\*
- Inspect gaskets on front and rear doors and replace as necessary.\*
- Seal and close front and rear doors properly.\*
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.\*
- Clean plugs in control piping.\*
- Remove all hand hole and manhole plates. Flush boiler with water to remove loose scale and sediment.\*
- Replace all hand hole and manhole plates with new gaskets.\*
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.\*
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.\*
- Make necessary adjustments to burner for proper combustion.
- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and manhole plates for leaks at normal operating temperatures and pressures.
- Troubleshoot any boiler system problems as requested by on-site personnel

Note: Tune-up activities marked with an asterisk (\*) are eligible to be performed by internal maintenance staff at periods of boiler shutdown.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a boiler that has not had a tune-up within the past 36 months.

---

<sup>428</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The life of this measure is 3 years.<sup>429</sup>

**DEEMED MEASURE COST**

The cost of this measure is \$0.83/MBtu/hr per tune-up<sup>430</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

---

**Algorithm**

---

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

$$\Delta\text{Therms} = (\text{Capacity} * \text{EFLH} * (((\text{Eff}_{\text{before}} + E_i) / \text{Eff}_{\text{before}}) - 1)) / 100,000$$

Where:

Capacity = Boiler gas input size (Btu/hr)  
= Custom

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

Eff<sub>before</sub> = Efficiency of the boiler before the tune-up  
= Actual. Default value is 81.5%<sup>431</sup>

*Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the heating season and take readings at a consistent firing rate for pre and post tune-up.*

E<sub>i</sub> = Efficiency improvement of the boiler tune-up measure

---

<sup>429</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

<sup>430</sup>Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

<sup>431</sup> Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year’s 2018 and 2019.

= Actual. Default value is 2.3%<sup>432</sup>

100,000 = Converts Btu to therms

**For example**, a 1050 kBtu boiler in a Chicago high rise office records an efficiency prior to tune up of 81.5% AFUE and a 2.3% improvement in efficiency after tune up:

$$\Delta \text{therms} = (1,050,000 * 2050 * ((0.815 + 0.023) / 0.815 - 1)) / 100,000$$
$$= 607 \text{ Therms}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-BLRT-V07-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>432</sup> Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

### 4.4.3 Process Boiler Tune-up

#### DESCRIPTION

This measure is for a non-residential boiler for process loads. For space heating, see measure 4.4.2. The tune-up will improve boiler efficiency by cleaning and/or inspecting burners, combustion chamber, and burner nozzles. Adjust air flow and reduce excessive stack temperatures, adjust burner and gas input. Check venting, safety controls, and adequacy of combustion air intake. Combustion efficiency should be measured before and after tune-up using an electronic flue gas analyzer.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements by approved technician<sup>433</sup> as specified below:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces
- Inspect all refractory. Patch and wash coat as required.\*
- Inspect gaskets on front and rear doors and replace as necessary.\*
- Seal and close front and rear doors properly.\*
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.\*
- Clean plugs in control piping.\*
- Remove all hand hole and man hole plates. Flush boiler with water to remove loose scale and sediment.\*
- Replace all hand hole and man hole plates with new gaskets.\*
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.\*
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.\*
- Make necessary adjustments to burner for proper combustion.
- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and man hole plates for leaks at normal operating temperatures and pressures.
- Troubleshoot any boiler system problems as reRequested by on-site personnel

Note: Tune-up activities marked with an asterisk (\*) are eligible to be performed by internal maintenance staff at periods of boiler shutdown.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a boiler that has not had a tune-up within the past 36 months.

---

<sup>433</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The life of this measure is 3 years.<sup>434</sup>

**DEEMED MEASURE COST**

The cost of this measure is \$0.83/MBtu/hr per tune-up<sup>435</sup>

**DEEMED O&M COST ADJUSTMENTS**

N/A

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

$$\Delta\text{Therms} = ((\text{Capacity} * 8766 * \text{UF}) / 100) * (1 - (\text{Eff}_{\text{pre}} / \text{Eff}_{\text{measured}}))$$

Where:

Capacity = Boiler gas input size (kBtu/hr)

= Custom

UF = Utilization Factor

= 41.9%,<sup>436</sup> or custom

Eff<sub>pre</sub> = Boiler Combustion Efficiency Before Tune-Up

= Actual. Default value is 80.3%<sup>437</sup>

*Note: Contractors should select a firing rate that appropriately represents the average operating condition and take readings at a consistent firing rate for pre and post tune-up.*

---

<sup>434</sup> Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

<sup>435</sup> Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

<sup>436</sup> Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

<sup>437</sup> Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year’s 2018 and 2019.

$Eff_{\text{measured}}$  = Boiler Combustion Efficiency After Tune-Up  
= Actual. Default value is 82.6%<sup>438</sup>

100 = conversion from kBtu to therms

8766 = hours a year

**For example**, a 80.3% 1050 kBtu boiler is tuned-up resulting in final efficiency of 82.6%:

$$\Delta \text{therms} = ((1050 * 8766 * 0.419) / 100) * (1 - (0.80.3 / 0.826))$$
$$= 1074 \text{ therms}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-PBTU-V06-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>438</sup> Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

#### 4.4.4 Boiler Lockout/Reset Controls

**DESCRIPTION**

This measure relates to improving combustion efficiency by adding controls to non-residential space heating boilers to vary the boiler entering water temperature relative to heating load as a function of the outdoor air temperature to save energy. Energy is saved by increasing the temperature difference between the water temperature entering the boiler in the boiler's heat exchanger and the boiler's burner flame temperature. The flame temperature remains the same while the water temperature leaving the boiler decreases with the decrease in heating load due to an increase in outside air temperature. A lockout temperature is also set to prevent the boiler from turning on when it is above a certain temperature outdoors.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

Natural gas customer adding boiler reset controls capable of resetting the boiler supply water temperature in an inverse linear fashion with outdoor air temperature. Boiler lockout temperatures should be set to 55 °F at this time as well, to turn the boiler off when the temperature goes above a certain setpoint.

**DEFINITION OF BASELINE EQUIPMENT**

Existing boiler without boiler reset controls, any size with constant hot water flow.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The life of this measure is 16 years.<sup>439</sup>

**DEEMED MEASURE COST**

The cost of this measure is \$612.<sup>440</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

---

<sup>439</sup> This is intentionally longer than the assumptions found in the early replacement commercial HVAC measures as the application of boiler reset controls will occur in a variety of sites that may not be targeted for early replacement HVAC systems.

<sup>440</sup> Nexant. Questar DSM Market Characterization Report. August 9, 2006.



### NATURAL GAS ENERGY SAVINGS

$$\Delta\text{Therms} = \text{Capacity}_{\text{input}} * \text{SF} * \text{EFLH} / 100$$

Where:

$\text{Capacity}_{\text{input}}$  = Boiler Input Capacity (kBtu/hr)

= custom

SF = Savings factor

= 8%,<sup>441</sup> or custom

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

100 = conversion from kBtu to therms

**For example**, reset controls were installed on an 800 kBtu/hr boiler at a restaurant in Rockford, IL

$$\begin{aligned}\Delta\text{Therms} &= 800 * 0.08 * 1,350 / 100 \\ &= 864 \text{ Therms}\end{aligned}$$

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

**MEASURE CODE: CI-HVC-BLRC-V04-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>441</sup> Savings factor is the estimate of annual gas consumption that is saved due to adding boiler reset controls. A comparable savings factor, based on boiler tuneup savings is derived from Xcel Energy "DSM Biennial Plan-Technical Assumptions," Colorado. For further substantiation, Wisconsin Focus on Energy 2020 TRM uses 8%, citing multiple sources. And other prescriptive programs across the country consistently use between 5 and 10% savings factor (Efficiency Vermont - 2020, New York TRM, version 7.0 – 2020 (Cadmus Group, Inc. Home Energy Services Impact Evaluation, August 2012, pg. 20)).

## 4.4.5 Condensing Unit Heaters

### DESCRIPTION

This measure applies to a gas fired condensing unit heater installed in a commercial application.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a condensing unit heater up to 300 MBH with a Thermal Efficiency > 90% and the heater must be vented, and condensate drained per manufacturer specifications. The unit must be replacing existing natural gas equipment.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be a non-condensing natural gas unit heater at end of life.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.<sup>442</sup>

### DEEMED MEASURE COST

The incremental capital cost for a unit heater is \$676.<sup>443</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS ENERGY SAVINGS

The annual natural gas energy savings from this measure is a deemed value equaling 266 Therms.

---

<sup>442</sup>DEER 2008

<sup>443</sup>ENERGY STAR and CEE do not currently provide calculators for this type of equipment therefore deemed values from Nicor Gas were used. Nicor Gas Energy Efficiency Plan 2011-2014. Revised Plan Filed Pursuant to Order Docket 10-0562, May 27, 2011.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-CUHT-V01-190101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.6 Electric Chiller

### DESCRIPTION

This measure relates to the installation of a new electric chiller meeting the efficiency standards presented below. This measure could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new system in an existing building (i.e. time of sale). Only single-chiller applications should be assessed with this methodology. The characterization is not suited for multiple chillers projects or chillers equipped with variable speed drives (VSDs).

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to exceed the efficiency requirements defined by the program.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit (if unknown assume IECC 2015).

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 23 years.<sup>444</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is provided below:<sup>445</sup>

Air-Cooled Chiller Incremental Costs (\$/Ton)				
Capacity (Tons)	Efficient EER			
	9.9	10.2	10.52	10.7
50	\$226	\$453	\$694	\$830
100	\$113	\$226	\$347	\$415
150	\$75	\$151	\$231	\$277
200	\$46	\$92	\$141	\$169
400	\$23	\$46	\$71	\$85

Water-Cooled Scroll/Screw Chiller Incremental Costs (\$/Ton)				
Capacity (Tons)	Efficient kW/ton			
	0.72	0.68	0.64	0.6
50	\$114	\$164	N/a	N/a
100	\$52	\$77	N/a	N/a
150	N/a	N/a	N/a	N/a
200	N/a	N/a	\$61	\$122
400	N/a	N/a	N/a	\$16

<sup>444</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018. ([http://deeresources.com/deer0911planning/downloads/EUL\\_Summary\\_10-1-08.xls](http://deeresources.com/deer0911planning/downloads/EUL_Summary_10-1-08.xls)).

<sup>445</sup> Based on Navigant Consulting, NEEP "Incremental Cost Study Phase Two Final Report", January 2013.

Water-Cooled Centrifugal Chiller Incremental Costs (\$/Ton)			
Capacity (Tons)	Efficient kW/ton		
	0.6	0.58	0.54
100	\$62	\$99	\$172
150	\$42	\$66	\$115
200	\$31	\$49	\$86
300	N/a	N/a	\$55
600	N/a	N/a	\$22

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM’s capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)}$$

$$= 91.3\%^{446}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 47.8\%^{447}$$

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{TONS} * ((IPLV_{base}) - (IPLV_{ee})) * EFLH$$

Where:

$$\text{TONS} = \text{chiller nominal cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)}$$

$$= \text{Actual installed}$$

IPLV<sub>base</sub> = efficiency of baseline equipment expressed as Integrated Part Load Value(kW/ton). Chiller units are dependent on chiller type. See Chiller Units, Conversion Values and Baseline Efficiency Values by Chiller Type and Capacity in the Reference Tables section.

$$IPLV_{ee}^{448} = \text{efficiency of high efficiency equipment expressed as Integrated Part Load Value (kW/ton)}^{449}$$

<sup>446</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>447</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>448</sup> Integrated Part Load Value is a seasonal average efficiency rating calculated in accordance with ARI Standard 550/590. It may be calculated using any measure of efficiency (EER, kW/ton, COP), but for consistency with IECC code requirements, it is expressed in terms of IPLV here.

<sup>449</sup> Can determine IPLV from standard testing or looking at engineering specs for design conditions. Standard data is available from AHRI online Certification Directory.

= Actual installed

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

**For example**, a 100 ton air-cooled electrically operated chiller with IPLV of 14 EER (0.86 kW/ton) and baseline EER of 12.5 (0.96 kW/ton) ,in a low-rise office building in Rockford with a building permit dated on 1/1/2015 would save:

$$\begin{aligned} \Delta \text{kWh} &= 100 * ((0.96) - (0.86)) * 949 \\ &= 9,490 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\begin{aligned} \Delta \text{kW}_{\text{SSP}} &= \text{TONS} * ((\text{PE}_{\text{base}}) - (\text{PE}_{\text{ee}})) * \text{CF}_{\text{SSP}} \\ \Delta \text{kW}_{\text{PJM}} &= \text{TONS} * ((\text{PE}_{\text{base}}) - (\text{PE}_{\text{ee}})) * \text{CF}_{\text{PJM}} \end{aligned}$$

Where:

- PE<sub>base</sub> = Peak efficiency of baseline equipment expressed as Full Load (kW/ton)
- PE<sub>ee</sub> = Peak efficiency of high efficiency equipment expressed as Full Load (kW/ton)  
= Actual installed
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 91.3%
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 47.8%

**For example**, a 100 ton air-cooled electrically operated chiller with a peak efficiency of 1.05 kW/ton and a baseline peak efficiency of 1.2 kW/ton would save:

$$\begin{aligned} \Delta \text{kW}_{\text{SSP}} &= 100 * (1.2 - 1.05) * 0.913 \\ &= 13.7 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**REFERENCE TABLES**

Chillers Ratings- Chillers are rated with different units depending on equipment type as shown below

Equipment Type	Unit
Air cooled, electrically operated	EER
Water cooled, electrically operated, positive displacement (reciprocating)	kW/ton

Equipment Type	Unit
Water cooled, electrically operated, positive displacement (rotary screw and scroll)	kW/ton

In order to convert chiller equipment ratings to IPLV, the following relationships are provided:

$$\text{kW/ton} = 12 / \text{EER}$$

$$\text{kW/ton} = 12 / (\text{COP} \times 3.412)$$

$$\text{COP} = \text{EER} / 3.412$$

$$\text{COP} = 12 / (\text{kW/ton}) / 3.412$$

$$\text{EER} = 12 / \text{kW/ton}$$

$$\text{EER} = \text{COP} \times 3.412$$

2012 IECC Baseline Efficiency Values by Chiller Type and Capacity (effective 1/1/2013 to 12/31/2015)

**TABLE C403.2.3(7)  
MINIMUM EFFICIENCY REQUIREMENTS:  
WATER CHILLING PACKAGES\***

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2010		AS OF 1/1/2010 <sup>b</sup>				TEST PROCEDURE <sup>c</sup>
			FULL LOAD	IPLV	PATH A		PATH B		
					FULL LOAD	IPLV	FULL LOAD	IPLV	
Air-cooled chillers	< 150 tons	EER		≥ 10.4					AHRI 550/590
	≥ 150 tons	EER	≥ 9.562	16	≥ 9.562	≥ 12.750	NA	NA	
Air cooled without condenser, electrical operated	All capacities	EER	≥ 10.586	≥ 11.782	Air-cooled chillers without condensers shall be rated with matching condensers and comply with the air-cooled chiller efficiency requirements				
Water cooled, electrically operated, reciprocating	All capacities	kW/ton	≤ 0.837	≤ 0.696	Reciprocating units shall comply with water cooled positive displacement efficiency requirements				
Water cooled, electrically operated, positive displacement	< 75 tons	kW/ton			≤ 0.780	≤ 0.630	≤ 0.800	≤ 0.600	
	≥ 75 tons and < 150 tons	kW/ton	≤ 0.790	≤ 0.676	≤ 0.775	≤ 0.615	≤ 0.790	≤ 0.586	
	≥ 150 tons and < 300 tons	kW/ton	≤ 0.717	≤ 0.627	≤ 0.680	≤ 0.580	≤ 0.718	≤ 0.540	
	≥ 300 tons	kW/ton	≤ 0.639	≤ 0.571	≤ 0.620	≤ 0.540	≤ 0.639	≤ 0.490	
Water cooled, electrically operated, centrifugal	< 150 tons	kW/ton	≤ 0.703	≤ 0.669					
	≥ 150 tons and < 300 tons	kW/ton	≤ 0.634	≤ 0.596	≤ 0.634	≤ 0.596	≤ 0.639	≤ 0.450	
	≥ 300 tons and < 600 tons	kW/ton	≤ 0.576	≤ 0.549	≤ 0.576	≤ 0.549	≤ 0.600	≤ 0.400	
	≥ 600 tons	kW/ton	≤ 0.576	≤ 0.549	≤ 0.570	≤ 0.539	≤ 0.590	≤ 0.400	
Air cooled, absorption single effect	All capacities	COP	≥ 0.600	NR	≥ 0.600	NR	NA	NA	AHRI 560
Water cooled, absorption single effect	All capacities	COP	≥ 0.700	NR	≥ 0.700	NR	NA	NA	
Absorption double effect, indirect fired	All capacities	COP	≥ 1.000	≥ 1.050	≥ 1.000	≥ 1.050	NA	NA	
Absorption double effect, direct fired	All capacities	COP	≥ 1.000	≥ 1.000	≥ 1.000	≥ 1.000	NA	NA	

For SI: 1 ton = 3517 W, 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

NA = Not applicable, not to be used for compliance; NR = No requirement.

- a. The centrifugal chiller equipment requirements, after adjustment in accordance with Section C403.2.3.1 or Section C403.2.3.2, do not apply to chillers used in low-temperature applications where the design leaving fluid temperature is less than 36°F. The requirements do not apply to positive displacement chillers with leaving fluid temperatures less than or equal to 32°F. The requirements do not apply to absorption chillers with design leaving fluid temperatures less than 40°F.
- b. Compliance with this standard can be obtained by meeting the minimum requirements of Path A or B. However, both the full load and IPLV shall be met to fulfill the requirements of Path A or B.
- c. Chapter 6 of the referenced standard contains a complete specification of the referenced test procedure, including the referenced year version of the test procedure.



2015 IECC Baseline Efficiency Values by Chiller Type and Capacity (effective 1/1/2016 to 3/30/2019)

**TABLE C403.2.3(7)  
WATER CHILLING PACKAGES – EFFICIENCY REQUIREMENTS<sup>a, b, d</sup>**

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE <sup>c</sup>	
			Path A	Path B	Path A	Path B		
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/ 590	
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15.800 IPLV		
	≥ 150 Tons		≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL		
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV		
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.					
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL		AHRI 550/ 590
			≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV		
	≥ 75 tons and < 150 tons		≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL		
			≤ 0.615 IPLV	≤ 0.586 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV		
	≥ 150 tons and < 300 tons		≤ 0.680 FL	≤ 0.718 FL	≤ 0.660 FL	≤ 0.680 FL		
			≤ 0.580 IPLV	≤ 0.540 IPLV	≤ 0.540 IPLV	≤ 0.440 IPLV		
	≥ 300 tons and < 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL		
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV		
	≥ 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL		
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV		
Water cooled, electrically operated centrifugal	< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	AHRI 560	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV		
	≥ 150 tons and < 300 tons		≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.635 FL		
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.400 IPLV		
	≥ 300 tons and < 400 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.595 FL		
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.520 IPLV	≤ 0.390 IPLV		
	≥ 400 tons and < 600 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.585 FL		
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV		
	≥ 600 Tons		≤ 0.570 FL	≤ 0.590 FL	≤ 0.560 FL	≤ 0.585 FL		
			≤ 0.539 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV		
Air cooled, absorption, single effect	All capacities	COP	≥ 0.600 FL	NA <sup>c</sup>	≥ 0.600 FL	NA <sup>c</sup>	AHRI 560	
Water cooled absorption, single effect	All capacities	COP	≥ 0.700 FL	NA <sup>c</sup>	≥ 0.700 FL	NA <sup>c</sup>		
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>		
			≥ 1.050 IPLV		≥ 1.050 IPLV			
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>		
			≥ 1.000 IPLV		≥ 1.050 IPLV			

- a. The requirements for centrifugal chiller shall be adjusted for nonstandard rating conditions in accordance with Section C403.2.3.1 and are only applicable for the range of conditions listed in Section C403.2.3.1. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.
- b. Both the full-load and IPLV requirements shall be met or exceeded to comply with this standard. Where there is a Path B, compliance can be with either Path A or Path B for any application.
- c. NA means the requirements are not applicable for Path B and only Path A can be used for compliance.
- d. FL represents the full-load performance requirements and IPLV the part-load performance requirements.

2018 IECC Baseline Efficiency Values by Chiller Type and Capacity (effective 7/1/2019)

TABLE C403.3.2(7)  
WATER CHILLING PACKAGES — EFFICIENCY REQUIREMENTS<sup>a, b, c, d</sup>

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE <sup>e</sup>	
			Path A	Path B	Path A	Path B		
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590	
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15.800 IPLV		
	≥ 150 Tons		≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL		
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV		
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.					
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL		AHRI 550/590
	≥ 75 tons and < 150 tons		≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV		
			≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL		
	≥ 150 tons and < 300 tons		≤ 0.615 IPLV	≤ 0.588 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV		
			≥ 0.680 FL	≥ 0.718 FL	≥ 0.660 FL	≥ 0.680 FL		
	≥ 300 tons and < 600 tons		≤ 0.580 IPLV	≥ 0.540 IPLV	≥ 0.540 IPLV	≥ 0.440 IPLV		
			≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL		
	≥ 600 tons		≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV		
≤ 0.620 FL		≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL				
Water cooled, electrically operated centrifugal	< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	AHRI 560	
	≥ 150 tons and < 300 tons		≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV		
			≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.635 FL		
	≥ 300 tons and < 400 tons		≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.400 IPLV		
			≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.595 FL		
	≥ 400 tons and < 600 tons		≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.520 IPLV	≤ 0.390 IPLV		
			≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.585 FL		
	≥ 600 Tons		≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV		
≤ 0.570 FL		≤ 0.590 FL	≤ 0.560 FL	≤ 0.585 FL				
Air cooled, absorption, single effect	All capacities	COP	≥ 0.600 FL	NA <sup>c</sup>	≥ 0.600 FL	NA <sup>c</sup>	AHRI 560	
Water cooled absorption, single effect	All capacities	COP	≥ 0.700 FL	NA <sup>c</sup>	≥ 0.700 FL	NA <sup>c</sup>		
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>		
			≥ 1.050 IPLV		≥ 1.050 IPLV			
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>		
			≥ 1.000 IPLV		≥ 1.050 IPLV			

a. The requirements for centrifugal chiller shall be adjusted for nonstandard rating conditions in accordance with Section C403.3.2.1 and are only applicable for the range of conditions listed in Section C403.3.2.1. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.  
 b. Both the full-load and IPLV requirements shall be met or exceeded to comply with this standard. Where there is a Path B, compliance can be with either Path A or Path B for any application.  
 c. NA means the requirements are not applicable for Path B and only Path A can be used for compliance.  
 d. FL represents the full-load performance requirements and IPLV the part-load performance requirements.

**MEASURE CODE: CI-HVC-CHIL-V07-200101**

**REVIEW DEADLINE: 1/1/2022**

### 4.4.7 ENERGY STAR and CEE Super Efficient Room Air Conditioner

#### DESCRIPTION

This measure relates to the purchase and installation of a room air conditioning unit that meets either the ENERGY STAR or CEE Super Efficient minimum qualifying efficiency specifications, in place of a baseline unit meeting minimum Federal Standard efficiency ratings presented below:<sup>450</sup>

Product Class (Btu/H)	Federal Standard CEER, with louvered sides	Federal Standard CEER, without louvered sides	ENERGY STAR CEER, with louvered sides	ENERGY STAR CEER, without louvered sides	CEE Super Efficient CEER
< 8,000	11.0	10.0	12.1	11.0	12.7
8,000 to 10,999	10.9	9.6	12.0	10.6	12.5
11,000 to 13,999		9.5		10.5	
14,000 to 19,999	10.7	9.3	11.8	10.2	12.3
20,000 to 27,999	9.4	9.4	10.3	10.3	10.8
>= 28,000	9.0		9.9		10.4

Casement	Federal Standard (CEER)	ENERGY STAR (CEER)
Casement-only	9.5	10.5
Casement-slider	10.4	11.4

Reverse Cycle - Product Class (Btu/H)	Federal Standard CEER, with louvered sides	Federal Standard CEER, without louvered sides	ENERGY STAR CEER, with louvered sides	ENERGY STAR CEER, without louvered sides
< 14,000	N/A	9.3	N/A	10.2
>= 14,000	N/A	8.7	N/A	9.6
< 20,000	9.8	N/A	10.8	N/A
>= 20,000	9.3	N/A	10.2	N/A

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the new room air conditioning unit must meet the ENERGY STAR efficiency standards presented above.

<sup>450</sup> Federal Baselines defined by Code of Federal Regulations §430.32(d). ENERGY STAR specification defined by Version 4.0 Room Air Conditioners. CEE specification defined by Room Air Conditioner Specification effective January 31, 2017. Side louvers that extend from a room air conditioner model in order to position the unit in a window. A model without louvered sides is placed in a built-in wall sleeve and are commonly referred to as "through-the-wall" or "built-in" models. Casement-only refers to a room air conditioner designed for mounting in a casement window of a specific size. Casement-slider refers to a room air conditioner with an encased assembly designed for mounting in a sliding or casement window of a specific size. Reverse cycle refers to the heating function found in certain room air conditioner models.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline assumption is a new room air conditioning unit that meets the current minimum federal efficiency standards presented above.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 9 years.<sup>451</sup>

**DEEMED MEASURE COST**

The incremental cost for this measure is assumed to be \$40 for an ENERGY STAR unit and \$80 for a CEE Super Efficient unit.<sup>452</sup>

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM’s capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)} \\ = 91.3\% \text{ }^{453}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)} \\ = 47.8\% \text{ }^{454}$$

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ENERGY SAVINGS**

$$\Delta kWh = (FLH_{RoomAC} * Btu/H * (1/CEERbase - 1/CEERee))/1000$$

Where:

$$FLH_{RoomAC} = \text{Full Load Hours of room air conditioning unit} \\ = \text{dependent on location:}^{455}$$

---

<sup>451</sup> Energy Star Room Air Conditioner Savings Calculator, Life Cycle Cost Estimate for ENERGY STAR Qualified Room Air Conditioners

<sup>452</sup> Based on field study conducted by Efficiency Vermont

<sup>453</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>454</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

<sup>455</sup> Full load hours for room AC is significantly lower than for central AC. The average ratio of FLH for Room AC (provided in RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008)) to FLH for Central Cooling for the same location (detailed in the Energy Star Room Air Conditioner Savings Calculator) is 31%. This ratio has been applied to the FLH from the unitary and split system air conditioning measure.

Zone	FLHRoomAC
1 (Rockford)	253
2-(Chicago)	254
3 (Springfield)	310
4-(Belleville)	391
5-(Marion)	254

- Btu/H = Size of unit  
 = Actual. If unknown assume 8500 Btu/hr <sup>456</sup>
- CEERbase = Combined Energy Efficiency Ratio of baseline unit  
 = As provided in tables above
- CEERee = Combined Energy Efficiency Ratio of ENERGY STAR or CEE Super Efficient unit  
 = Actual. If unknown assume minimum qualifying standard as provided in tables above

**For example**, for an 8,500 Btu/H capacity ENERGY STAR unit, with louvered sides, in Rockford:

$$\Delta kWh_{\text{ENERGY STAR}} = (253 * 8500 * (1/10.9 - 1/12.0)) / 1000$$

$$= 18.1 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Btu/H} * ((1/\text{CEERbase} - 1/\text{CEERee})/1000) * \text{CF}$$

Where:

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
 = 91.3% <sup>457</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
 = 47.8% <sup>458</sup>

Other variable as defined above

For example for an 8,500 Btu/H capacity ENERGY STAR unit, with louvered sides, in Rockford during system peak

$$\Delta kW_{\text{ENERGY STAR}} = (8500 * (1/10.9 - 1/12.0)) / 1000 * 0.913$$

$$= 0.065 \text{ kW}$$

**FOSSIL FUEL SAVINGS**

N/A

<sup>456</sup> Based on maximum capacity average from the RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

<sup>457</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>458</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-ESRA-V02-190101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.8 Guest Room Energy Management (PTAC & PTHP)

### DESCRIPTION

This measure applied to the installation of a temperature setback and lighting control system for individual guest rooms. The savings are achieved based on Guest Room Energy Management's (GREM's) ability to automatically adjust the guest room's set temperatures and control the HVAC unit for various occupancy modes.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Guest room temperature set point must be controlled by automatic occupancy detectors or keycard that indicates the occupancy status of the room. During unoccupied periods the default setting for controlled units differs by at least 5 degrees from the operating set point. Theoretically, the control system may also be tied into other electric loads, such as lighting and plug loads to shut them off when occupancy is not sensed. This measure bases savings on improved HVAC controls. If system is connected to lighting and plug loads, additional savings would be realized. The incentive is per guestroom controlled, rather than per sensor, for multi-room suites. Replacement or upgrades of existing occupancy-based controls are not eligible for an incentive.

### DEFINITION OF BASELINE EQUIPMENT

Guest room energy management thermostats replace manual heating/cooling temperature set-point and fan On/Off/Auto thermostat controls. Two possible baselines exist based on whether housekeeping staff are directed to set-back (or turn off) thermostats when rooms are not rented.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for GREM is 15 years.<sup>459</sup>

### DEEMED MEASURE COST

\$260/unit.

The IMC documented for this measure is \$260 per room HVAC controller, which is the cost difference between a non-programmable thermostat and a GREM.<sup>460</sup>

### DEEMED O&M COST ADJUSTMENTS

N/A

### LOADSHAPE

Loadshape C03 - Commercial Cooling

### COINCIDENCE FACTOR

A coincidence factor is not used in the determination of coincident peak kW savings.

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

Below are the annual kWh savings per installed EMS for different sizes and types of HVAC units. The savings are achieved based on GREM's ability to automatically adjust the guest room's set temperatures and control the HVAC

---

<sup>459</sup> DEER 2008 value for energy management systems.

<sup>460</sup> This value was extracted from Smart Ideas projects in PY1 and PY2.

unit to maintain set temperatures for various occupancy modes. Note that care should be taken in selecting a value consistent with actual baseline conditions (e.g., whether housekeeping staff are directed to set-back/turn-off the thermostats when rooms are unrented). Different values are provided for Motels and Hotels since significant differences in shell performance, number of external walls per room and typical heating and cooling efficiencies result in significantly different savings estimates. Energy savings estimates are derived using a prototypical EnergyPlus simulation of a motel and a hotel.<sup>461</sup> Model outputs are normalized to the installed capacity and reported here as kWh/Ton, coincident peak kW/Ton and Therms/Ton.

### ELECTRIC ENERGY SAVINGS

Climate Zone (City based upon)	Heating Source	Baseline	Electric Savings (kWh/Ton)
<b>Motel Electric Energy Savings</b>			
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	744
		No Housekeeping Setback	1,786
	PTAC w/ Gas Heating	Housekeeping Setback	63
		No Housekeeping Setback	155
	PTHP	Housekeeping Setback	385
		No Housekeeping Setback	986
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	506
		No Housekeeping Setback	1,582
	PTAC w/ Gas Heating	Housekeeping Setback	51
		No Housekeeping Setback	163
	PTHP	Housekeeping Setback	211
		No Housekeeping Setback	798
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	462
		No Housekeeping Setback	1,382
	PTAC w/ Gas Heating	Housekeeping Setback	65
		No Housekeeping Setback	198
	PTHP	Housekeeping Setback	202
		No Housekeeping Setback	736
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	559
		No Housekeeping Setback	1,877
	PTAC w/ Gas Heating	Housekeeping Setback	85
		No Housekeeping Setback	287
	PTHP	Housekeeping Setback	260
		No Housekeeping Setback	1,023
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	388
		No Housekeeping Setback	1,339
	PTAC w/ Gas Heating	Housekeeping Setback	81
		No Housekeeping Setback	274
	PTHP	Housekeeping Setback	174
		No Housekeeping Setback	682
<b>Hotel Electric Energy Savings</b>			
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	204
		No Housekeeping Setback	345

<sup>461</sup> For motels, see S. Keates, ADM Associates Workpaper: “Suggested Revisions to Guest Room Energy Management (PTAC & PTHP)”, 11/14/2013 and spreadsheet summarizing the results: ‘GREM Savings Summary\_IL TRM\_1\_22\_14.xlsx’. In 2014 the hotel models were also run to compile results, rather than by applying adjustment factors to the motel results as had been done in V3.0 of the TRM. The updated values can be found in ‘GREM Savings Summary (Hotel)\_IL TRM\_10\_16\_14.xls’.



Climate Zone (City based upon)	Heating Source	Baseline	Electric Savings (kWh/Ton)
	PTAC w/ Gas Heating	Housekeeping Setback	121
		No Housekeeping Setback	197
	PTHP	Housekeeping Setback	152
		No Housekeeping Setback	253
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	177
		No Housekeeping Setback	296
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	94	
	No Housekeeping Setback	148	
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	188
		No Housekeeping Setback	342
	PTAC w/ Gas Heating	Housekeeping Setback	119
		No Housekeeping Setback	195
	PTHP	Housekeeping Setback	145
		No Housekeeping Setback	250
Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	161	
	No Housekeeping Setback	294	
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	92	
	No Housekeeping Setback	147	
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	182
		No Housekeeping Setback	291
	PTAC w/ Gas Heating	Housekeeping Setback	123
		No Housekeeping Setback	197
	PTHP	Housekeeping Setback	145
		No Housekeeping Setback	233
Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	153	
	No Housekeeping Setback	240	
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	94	
	No Housekeeping Setback	146	
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	182
		No Housekeeping Setback	308
	PTAC w/ Gas Heating	Housekeeping Setback	125
		No Housekeeping Setback	199
	PTHP	Housekeeping Setback	146
		No Housekeeping Setback	240
Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	152	
	No Housekeeping Setback	255	
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	95	
	No Housekeeping Setback	147	
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	171
		No Housekeeping Setback	295
	PTAC w/ Gas Heating	Housekeeping Setback	122
		No Housekeeping Setback	199
	PTHP	Housekeeping Setback	140
		No Housekeeping Setback	235
Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	141	
	No Housekeeping Setback	243	
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	92	
	No Housekeeping Setback	146	

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Motel Coincident Peak Demand Savings			
Climate Zone (City based upon)	Heating Source	Baseline	Coincident Peak Demand Savings (kW/Ton)
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.17
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.17
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.17
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.06
		No Housekeeping Setback	0.17
	PTAC w/ Gas Heating	Housekeeping Setback	0.06
		No Housekeeping Setback	0.17
	PTHP	Housekeeping Setback	0.06
		No Housekeeping Setback	0.17
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.17
	PTAC w/ Gas Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.17
	PTHP	Housekeeping Setback	0.07
		No Housekeeping Setback	0.17
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.10
		No Housekeeping Setback	0.28
	PTAC w/ Gas Heating	Housekeeping Setback	0.10
		No Housekeeping Setback	0.28
	PTHP	Housekeeping Setback	0.10
		No Housekeeping Setback	0.28
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.21
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.21
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.21

Hotel Coincident Peak Demand Savings			
Climate Zone (City based upon)	Heating Source	Baseline	Coincident Peak Demand Savings (kW/Ton)
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08

Hotel Coincident Peak Demand Savings			
Climate Zone (City based upon)	Heating Source	Baseline	Coincident Peak Demand Savings (kW/Ton)
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.07
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.07
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05	
	No Housekeeping Setback	0.07	
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.07
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05	
	No Housekeeping Setback	0.07	
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05	
	No Housekeeping Setback	0.08	
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05	
	No Housekeeping Setback	0.08	

**NATURAL GAS ENERGY SAVINGS**

For PTACs with gas heating:

Motel Natural Gas Energy Savings			
Climate Zone (City based upon)	Baseline	Gas Savings (Therms/Ton)	
1 (Rockford)	Housekeeping Setback	30	
	No Housekeeping Setback	71	
2 (Chicago)	Housekeeping Setback	20	
	No Housekeeping Setback	62	
3 (Springfield)	Housekeeping Setback	17	
	No Housekeeping Setback	52	
4 (Belleville)	Housekeeping Setback	21	
	No Housekeeping Setback	70	
5 (Marion-Williamson)	Housekeeping Setback	13	
	No Housekeeping Setback	47	

Hotel Natural Gas Energy Savings			
Climate Zone (City based upon)	Heating Source	Baseline	Gas Savings (Therms/Ton)
1 (Rockford)	PTAC w/ Gas Heating	Housekeeping Setback	3.6
		No Housekeeping Setback	6.4
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	3.6
		No Housekeeping Setback	6.4
2 (Chicago)	PTAC w/ Gas Heating	Housekeeping Setback	3.0
		No Housekeeping Setback	6.5
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	3.0
		No Housekeeping Setback	6.5
3 (Springfield)	PTAC w/ Gas Heating	Housekeeping Setback	2.6
		No Housekeeping Setback	4.1
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	2.6
		No Housekeeping Setback	4.1
4 (Belleville)	PTAC w/ Gas Heating	Housekeeping Setback	2.5
		No Housekeeping Setback	4.8
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	2.5
		No Housekeeping Setback	4.8
5 (Marion-Williamson)	PTAC w/ Gas Heating	Housekeeping Setback	2.1
		No Housekeeping Setback	4.2
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	2.1
		No Housekeeping Setback	4.2

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-GREM-V05-150601**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.9 Air and Water Source Heat Pump Systems

### DESCRIPTION

This measure applies to the installation of high-efficiency air cooled and water source heat pump systems. This measure could apply to replacing an existing unit at the end of its useful life, or installation of a new unit in a new or existing building.

This measure was developed to be applicable to the following program types: TOS NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a high-efficiency air cooled or water source, heat pump system that exceeds the baseline and meets program requirements.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a standard-efficiency air cooled or water source heat pump system that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date unknown assume current Code minimum). The rating conditions for the baseline and efficient equipment efficiencies must be equivalent.

Note: IECC 2018 is scheduled to become effective July 1, 2019 will become baseline for all New Construction permits from that date.

Note: new Federal Standards affecting heat pumps become effective January 1, 2023.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.<sup>462</sup>

### DEEMED MEASURE COST

For analysis purposes, the incremental capital cost for this measure is assumed as \$100 per ton for air-cooled units.<sup>463</sup> The incremental cost for all other equipment types should be determined on a site-specific basis.

### LOADSHAPE

Loadshape C05 - Commercial Electric Heating and Cooling

### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)} \\ &= 91.3\% \text{ }^{464} \end{aligned}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

---

<sup>462</sup>Measure Life Report: Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, Inc., June 2007.

<sup>463</sup> Based on a review of TRM incremental cost assumptions from Vermont, Wisconsin, and California.

<sup>464</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

$$= 47.8\%^{465}$$

---



---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

For units with cooling capacities less than 65 kBtu/hr:

$$\Delta kWh = \text{Annual kWh Savings}_{\text{cool}} + \text{Annual kWh Savings}_{\text{heat}}$$

$$\text{Annual kWh Savings}_{\text{cool}} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{SEER}_{\text{base}}) - (1/\text{SEER}_{\text{ee}})] * \text{EFLH}_{\text{cool}}$$

$$\text{Annual kWh Savings}_{\text{heat}} = (\text{kBtu/hr}_{\text{heat}}) * [(1/\text{HSPF}_{\text{base}}) - (1/\text{HSPF}_{\text{ee}})] * \text{EFLH}_{\text{heat}}$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

$$\Delta kWh = \text{Annual kWh Savings}_{\text{cool}} + \text{Annual kWh Savings}_{\text{heat}}$$

$$\text{Annual kWh Savings}_{\text{cool}} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{base}}) - (1/\text{EER}_{\text{ee}})] * \text{EFLH}_{\text{cool}}$$

$$\text{Annual kWh Savings}_{\text{heat}} = (\text{kBtu/hr}_{\text{heat}})/3.412 * [(1/\text{COP}_{\text{base}}) - (1/\text{COP}_{\text{ee}})] * \text{EFLH}_{\text{heat}}$$

Where:

- kBtu/hr<sub>cool</sub> = capacity of the cooling equipment in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).  
= Actual installed
- SEER<sub>base</sub> = Seasonal Energy Efficiency Ratio of the baseline equipment  
= SEER from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).
- SEER<sub>ee</sub> = Seasonal Energy Efficiency Ratio of the energy efficient equipment.  
= Actual installed
- EFLH<sub>cool</sub> = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.
- HSPF<sub>base</sub> = Heating Seasonal Performance Factor of the baseline equipment  
= HSPF from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).
- HSPF<sub>ee</sub> = Heating Seasonal Performance Factor of the energy efficient equipment.  
= Actual installed. If rating is COP, HSPF = COP \* 3.413
- EFLH<sub>heat</sub> = heating mode equivalent full load hours in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.
- EER<sub>base</sub> = Energy Efficiency Ratio of the baseline equipment

---

<sup>465</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

= EER from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code). For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER to EER for calculation of peak savings:<sup>466</sup>

$$EER = (-0.02 * SEER^2) + (1.12 * SEER)$$

EERee = Energy Efficiency Ratio of the energy efficient equipment. For air-cooled units < 65 kBtu/hr, if the actual EERee is unknown, assume the conversion from SEER to EER as provided above.

= Actual installed

kBtu/hr<sub>heat</sub> = capacity of the heating equipment in kBtu per hour.

= Actual installed

3.412 = Btu per Wh.

COPbase = coefficient of performance of the baseline equipment

= COP from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code). If rating is HSPF, COP = HSPF / 3.413

COPee = coefficient of performance of the energy efficient equipment.

= Actual installed. If rating is HSPF, COP = HSPF / 3.413

**Code of Federal Redulations (baseline effective 1/1/2019):**

Equipment type	Cooling capacity	Heating type	Cooling Efficiency level	Heating Efficiency level	Compliance date
Small Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥65,000 Btu/h and <135,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 12.2	N/A	1/1/2018
		All Other Types of Heating	IEER = 12.0	COP = 3.3	1/1/2018
Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥135,000 Btu/h and <240,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 11.6	N/A	1/1/2018
		All Other Types of Heating	IEER = 11.4	COP = 3.2	1/1/2018
Very Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥240,000 Btu/h and <760,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 10.6	N/A	1/1/2018
		All Other Types of Heating	IEER = 10.4	COP = 3.2	1/1/2018
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Split-System)	<65,000 Btu/h	All	SEER = 14.0	HSPF = 8.2	1/1/2017
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Single-Package)	<65,000Btu/h	All	SEER = 14.0	HSPF = 8.0	1/1/2017
Small Commercial Packaged Air-Conditioning and Heating Equipment (Water Source: Water-to-Air, Water-Loop)	<17,000 Btu/h	All	EER = 12.2	COP = 4.3	10/9/2015
	≥17,000 Btu/h and <65,000 Btu/h	All	EER = 13.0	COP = 4.3	10/9/2015
	≥65,000 Btu/h and <135,000Btu/h	All	EER = 13.0	COP = 4.3	10/9/2015

<sup>466</sup> Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

Minimum Efficiency Requirements: 2012 IECC (baseline effective 1/1/2013 to 12/31/2015)

**TABLE C403.2.3(2)**  
**MINIMUM EFFICIENCY REQUIREMENTS:**  
**ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE*
Air cooled (cooling mode)	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER	AHRI 210/240
			Single Packaged	13.0 SEER	
Through-the-wall, air cooled	≤ 30,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER	
			Single Packaged	13.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	10.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	
		All other	Split System and Single Package	10.8 EER 11.0 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 10.7 IEER	
		All other	Split System and Single Package	10.4 EER 10.5 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 9.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	
Water source (cooling mode)	< 17,000 Btu/h	All	86°F entering water	11.2 EER	ISO 13256-1
	≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	12.0 EER	
	≥ 65,000 Btu/h and < 135,000 Btu/h	All	86°F entering water	12.0 EER	
Ground water source (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.2 EER	
		All	77°F entering water	13.4 EER	
Water-source water to water (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	
			59°F entering water	16.3 EER	
Ground water source Brine to water (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER	
Air cooled (heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	7.7 HSPF	AHRI 210/240
		—	Single Package	7.7 HSPF	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h <sup>b</sup> (cooling capacity)	—	Split System	7.4 HSPF	
		—	Single Package	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	6.8 HSPF	

(continued)



**TABLE C403.2.3(2)—continued  
MINIMUM EFFICIENCY REQUIREMENTS:  
ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUB-CATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE*
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb Outdoor Air	3.3 COP	AHRI 340/360
			17°F db/15°F wb Outdoor Air	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb Outdoor Air	3.2 COP	
			17°F db/15°F wb Outdoor Air	2.05 COP	
Water source (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.2 COP	ISO 13256-1
Ground water source (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.6 COP	
Ground source (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.1 COP	
Water-source water to water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	ISO 13256-2
		—	50°F entering water	3.1 COP	
Ground source brine to water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

- a. Chapter 6 of the referenced standard contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

Minimum Efficiency Requirements: 2015 IECC (baseline effective 1/1/2016 to 3/30/2019)

TABLE C403.2.3(2)  
**MINIMUM EFFICIENCY REQUIREMENTS:  
 ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE <sup>a</sup>
				Before 1/1/2016	As of 1/1/2016	
Air cooled (cooling mode)	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER <sup>c</sup>	14.0 SEER <sup>c</sup>	AHRI 210/240
			Single Package	13.0 SEER <sup>c</sup>	14.0 SEER <sup>c</sup>	
Through-the-wall, air cooled	≤ 30,000 Btu/h <sup>b</sup>	All	Split System	12.0 SEER	12.0 SEER	AHRI 210/240
			Single Package	12.0 SEER	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.0 IEER	AHRI 340/360
		All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 11.8 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 10.7 IEER	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 10.5 IEER	10.4 EER 11.4 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	9.3 EER 9.4 IEER	
Water to Air: Water Loop (cooling mode)	< 17,000 Btu/h	All	86°F entering water	12.2 EER	12.2 EER	ISO 13256-1
	≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	13.0 EER	13.0 EER	
	≥ 65,000 Btu/h and < 135,000 Btu/h	All	86°F entering water	13.0 EER	13.0 EER	
Water to Air: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	18.0 EER	18.0 EER	ISO 13256-1
Brine to Air: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering water	14.1 EER	14.1 EER	ISO 13256-1
Water to Water: WaterLoop (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	10.6 EER	ISO 13256-2
Water to Water: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.3 EER	16.3 EER	
Brine to Water: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER	12.1 EER	

(continued)

TABLE C403.2.3(2)—continued  
 MINIMUM EFFICIENCY REQUIREMENTS:  
 ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE <sup>a</sup>
				Before 1/1/2016	As of 1/1/2016	
Air cooled (heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	7.7 HSPF <sup>c</sup>	8.2 HSPF <sup>c</sup>	AHRI 210/240
		—	Single Package	7.7 HSPF <sup>c</sup>	8.0 HSPF <sup>c</sup>	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h <sup>b</sup> (cooling capacity)	—	Split System	7.4 HSPF	7.4 HSPF	
		—	Single Package	7.4 HSPF	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	6.8 HSPF	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	3.3 COP	
			17°F db/15°F wb outdoor air	2.25 COP	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	3.2 COP	
			17°F db/15°F wb outdoor air	2.05 COP	2.05 COP	
Water to Air: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	4.3 COP	ISO 13256-1
Water to Air: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	3.7 COP	
Brine to Air: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	3.2 COP	
Water to Water: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	3.7 COP	ISO 13256-2
Water to Water: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.1 COP	3.1 COP	
Brine to Water: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

- a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.
- c. Minimum efficiency as of January 1, 2015.

Minimum Efficiency Requirements: 2018 IECC (baseline effective 7/1/2019 for New Construction measures)

TABLE C403.3.2(2)  
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE <sup>a</sup>
Air cooled (cooling mode)	< 65,000 Btu/h <sup>b</sup>	All	Split System	14.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall, air cooled	≤ 30,000 Btu/h <sup>b</sup>	All	Split System	12.0 SEER	
			Single Package	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.0 IEER	
		All other	Split System and Single Package	10.8 EER 11.8 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 11.4 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	
Water to Air: Water Loop (cooling mode)	< 17,000 Btu/h	All	86°F entering water	12.2 EER	ISO 13256-1
	≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	13.0 EER	
	≥ 65,000 Btu/h and < 135,000 Btu/h	All	86°F entering water	13.0 EER	
Water to Air: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	18.0 EER	ISO 13256-1
Brine to Air: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering water	14.1 EER	ISO 13256-1
Water to Water: Water Loop (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	ISO 13256-2
Water to Water: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.3 EER	
Brine to Water: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER	

**IECC2018 Table C403.3.2(2) continued from previous page:**

Air cooled (heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	8.2 HSPF	AHRI 210/240
		—	Single Package	8.0 HSPF	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h <sup>b</sup> (cooling capacity)	—	Split System	7.4 HSPF	
		—	Single Package	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	
			17°Fdb/15°F wb outdoor air	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	
			17°Fdb/15°F wb outdoor air	2.05 COP	
Water to Air: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	ISO 13256-1
Water to Air: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	
Brine to Air: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	
Water to Water: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	ISO 13256-2
Water to Water: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.1 COP	
Brine to Water: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

- a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- b. Single-phase, air-cooled heat pumps less than 65,000 Btu/h are regulated by NAECA. SEER and HSPF values are those set by NAECA.

**For example,** a 5-ton cooling unit with 60 kbtu heating, an efficient SEER of 16, and an efficient HSPF of 9.5, at a restaurant in Chicago with a building permit dated after 1/1/2016 saves:

$$\begin{aligned} \Delta kWh &= [(60) * [(1/14) - (1/16)] * 1134] + [(60) * [(1/8.2) - (1/9.5)] * 1354] \\ &= 1963.2 kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((kBtu/hr_{cool}) * (1/EER_{base} - 1/EER_{ee})) * CF$$

Where CF value is chosen between:

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)} \\ &= 91.3\%^{467} \end{aligned}$$

$$\begin{aligned} CF_{PJM} &= \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)} \\ &= 47.8\%^{468} \end{aligned}$$

<sup>467</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>468</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**For example**, a 5 ton cooling unit with 60 kbtu heating, an efficient EER of 12.5 with a building permit dated after 1/1/2016 saves:

$$\begin{aligned}\Delta kW &= (60 * (1/11 - 1/12.5)) * 0.913 \\ &= 0.598 \text{ kW}\end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-HPSY-V07-200101**

**REVIEW DEADLINE: 1/1/2022**

### 4.4.10 High Efficiency Boiler

#### DESCRIPTION

To qualify for this measure the installed equipment must be replacement of an existing boiler at the end of its service life, in a commercial or multifamily space with a high efficiency, gas-fired steam or hot water boiler. High efficiency boilers achieve gas savings through the utilization of a sealed combustion chamber and multiple heat exchangers that remove a significant portion of the waste heat from flue gasses. Because multiple heat exchangers are used to remove waste heat from the escaping flue gasses, some of the flue gasses condense and must be drained.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a boiler used 80% or more for space heating, not process, and boiler AFUE,  $E_T$  (thermal efficiency), or  $E_C$  (combustion efficiency) rating must be rated greater than or equal to 85% for hot water boilers and 81% for steam boilers.

#### DEFINITION OF BASELINE EQUIPMENT

Dependent on when the unit is installed and whether the unit is hot water or steam. The baseline efficiency source is the Energy Independence and Security Act of 2007 with technical amendments from Federal Register, volume 81, Number 10, January 15, 2016 for boilers <300,000 Btu/hr and Federal Register, volume 74, Number 139, July 22, 2009 for boiler  $\geq$ 300,000 Btu/hr.

For boilers <300,000 Btu/hr the technical amendments include the recent compliance dates for gas-fired hot water and steam boilers manufactured on or after January 15, 2021.<sup>469</sup> However, this measure characterization is not adopting those appliance standards until January 1, 2022. The baseline for boilers <300,000 Btu/hr is considered to be any boiler manufactured on or after September 1, 2012 and before January 15, 2021.<sup>470</sup>

Note: A new Federal Standard, applicable to only natural-draft, gas-fired steam packaged boilers, becomes effective March 2, 2022. Additionally, new Federal Standards, applicable to all hot water and steam commercial packaged boilers < 10,000,000 Btu/hr input capacity, becomes effective January 10, 2023.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 25 years.<sup>471</sup>

#### DEEMED MEASURE COST

The incremental capital cost for boilers < 300,000 Btu/hr input capacity is provided in the table below and is dependent on the AFUE efficiency.<sup>472</sup> Any boiler > 300,000 Btu/hr input capacity is recommended to use a custom cost input.

Measure Tier	Incremental Cost, per unit by program year	
	2021	2022
AFUE 85%	\$633	\$415

<sup>469</sup> Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).

<sup>470</sup> Code of Federal Regulations, effective September 1, 2012 (10 CFR 432(e)(2)).

<sup>471</sup> Consistent with DOE assumption determined through a literature review in Appendix 8-F of the Department of Energy Commercial Technical Support Document.

<sup>472</sup> Based on data provided in Federal Appliance Standards, Chapter 8.3, of DOE Technical Support Documents; Table 8.5.6 LCC and PBP Results for Hot-Water Gas Boilers (High Cost). Where efficiency ratings were not provided (AFUE 90% and 95%), the values are interpolated from those given.

Measure Tier	Incremental Cost, per unit by program year	
	2021	2022
ENERGY STAR® Minimum (AFUE 90%) <sup>473</sup>	\$1,803	\$1,585
AFUE 95%	\$2,353	\$2,135
AFUE ≥ 96%	\$2,957	\$2,739
Boilers > 300,000 Btu/hr with E <sub>t</sub> (thermal efficiency) rating	Custom	

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

$$\Delta\text{Therms} = \text{EFLH} * \text{Capacity} * ((\text{Efficiency}_{\text{EE}} - \text{Efficiency}_{\text{Base}}) / \text{Efficiency}_{\text{Base}}) / 100,000$$

Where:

- EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use
- Capacity = Nominal Heating Input Capacity Boiler Size (Btu/hr) for efficient unit not existing unit  
= custom Boiler input capacity in Btu/hr
- Efficiency<sub>Base</sub> = Baseline Boiler Efficiency Rating, dependant on year and boiler type

Hot water boiler baseline:

Year	Efficiency
Hot Water <300,000 Btu/hr < January 1, 2022 <sup>474</sup>	82% AFUE
Hot Water <300,000 Btu/hr ≥ January 1, 2022 <sup>475</sup>	84% AFUE
Hot Water ≥300,000 & ≤2,500,000 Btu/hr <sup>476</sup>	80% E <sub>T</sub>

<sup>473</sup> ENERGY STAR Program Requirements, Product Specifications for Boilers, version 3.0, effective October 1, 2014 (≥ 90% AFUE for gas-fired and ≥ 87% AFUE for oil-fired).

<sup>474</sup> The Federal baseline for gas-fired hot water boilers <300,000 btu/hr changes from 82% to 84% in January 2021. To prevent a change in baseline mid-program, and to account for inventory meeting the old standard still in distribution, the increase in efficiency is delayed until January 2022 when a new program year starts.

<sup>475</sup> Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).

<sup>476</sup> Thermal Efficiency. Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87).



Year	Efficiency
Hot Water >2,500,000 Btu/hr <sup>477</sup>	82% E <sub>c</sub>

Steam boiler baseline:

Year	Efficiency
Steam <300,000 Btu/hr < January 1, 2022 <sup>478</sup>	80% AFUE
Steam <300,000 Btu/hr ≥ January 1, 2022 <sup>479</sup>	82% AFUE
Steam - all except natural draft ≥300,000 & ≤2,500,000 Btu/hr <sup>480</sup>	79% TE
Steam - natural draft ≥300,000 & ≤2,500,000 Btu/hr	77% TE
Steam - all except natural draft >2,500,000 Btu/hr	79% TE
Steam - natural draft >2,500,000 Btu/hr	77% TE

Efficiency<sub>EE</sub> = Efficient Boiler Efficiency Rating  
 =actual value, specified to one significant digit (i.e., 95.7%)

**For example**, a 150,000 btu/hr water boiler meeting AFUE 90% is installed in Rockford at a high rise office building, in the year 2022

$$\Delta\text{Therms} = 2,089 * 150,000 * (0.90 - 0.840) / 0.840 / 100,000 \text{ Btu/Therm}$$

$$= 224 \text{ Therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-BOIL-V08-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>477</sup> Combustion Efficiency. Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87).

<sup>478</sup> The Federal baseline for gas-fired steam water boilers <300,000 btu/hr changes from 80% to 82% in January 2021. To prevent a change in baseline mid-program, and to account for inventory meeting the old standard still in distribution, the increase in efficiency is delayed until January 2022 when a new program year starts.

<sup>479</sup> Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).

<sup>480</sup> Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87). Includes efficiency requirements for all steam boilers ≥ 300,000 Btu/hr.

## 4.4.11 High Efficiency Furnace

### DESCRIPTION

This measure covers the installation of a high efficiency gas furnace in lieu of a standard efficiency gas furnace in a commercial or industrial space. High efficiency gas furnaces achieve savings through the utilization of a sealed, super insulated combustion chamber, more efficient burners, and multiple heat exchangers that remove a significant portion of the waste heat from the flue gasses. Because multiple heat exchangers are used to remove waste heat from the escaping flue gasses, most of the flue gasses condense and must be drained. Furnaces equipped with ECM fan motors can save additional electric energy

This measure was developed to be applicable to the following program types: TOS, NC and EREP. If applied to other program types, the measure savings should be verified.

Time of sale:

- a. The installation of a new high efficiency, gas-fired condensing furnace in a commercial location. This could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new system.

Early replacement:

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or
- The existing unit requires minor repairs (<\$528).<sup>481</sup>
- All other conditions will be considered Time of Sale.

The Baseline AFUE of the existing unit replaced:

- If the AFUE of the existing unit is known and  $\leq 75\%$ , the Baseline AFUE is the actual AFUE value of the unit replaced. If the AFUE is  $>75\%$ , the Baseline AFUE = 80%.
- If the AFUE of the existing unit is unknown, use assumptions in variable list below (AFUE(exist)).
- If the operational status or repair cost of the existing unit is unknown, use time of sale assumptions.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a furnace with input energy less than 225,000 Btu/hr rated natural gas fired furnace with an Annual Fuel Utilization Efficiency (AFUE) rating and fan electrical efficiency exceeding the program requirements:

### DEFINITION OF BASELINE EQUIPMENT

Time of Sale: The current Federal Standard for gas furnaces less than 225,000 Btu/hr is an AFUE rating of 80%.

Early replacement: The baseline for this measure is the efficiency of the existing equipment for the assumed remaining useful life of the unit and a new baseline unit for the remainder of the measure life. As discussed above we estimate that the new baseline unit that could be purchased in the year the existing unit would have needed replacing is 90%.

Note: a new Federal Standard will become effective January 1, 2023 and be applicable to all gas furnaces.

---

<sup>481</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement. Note the non-inflated cost is used as this would be a cost consideration in the program year.

**DEFINITION OF MEASURE LIFE**

The expected measure life is assumed to be 16.5 years.<sup>482</sup>

Remaining life of existing equipment is assumed to be 5.5 years.<sup>483</sup>

**DEEMED MEASURE COST**

Time of Sale: The incremental capital cost for this measure depends on efficiency as listed below:<sup>484</sup>

AFUE	Installation Cost	Incremental Install Cost
80%	\$2011	n/a
90%	\$2641	\$630
91%	\$2727	\$716
92%	\$2813	\$802
93%	\$3049	\$1,038
94%	\$3286	\$1,275
95%	\$3522	\$1,511
96%	\$3758	\$1,747

Early Replacement: The full installation cost is provided in the table above. The assumed deferred cost (after 5.5 years) of replacing existing equipment with a new baseline unit is assumed to be \$2,876.<sup>485</sup> This cost should be discounted to present value using the nominal discount rate.

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{Heating Savings} + \text{Cooling Savings} + \text{Shoulder Season Savings}$$

Where:

$$\begin{aligned} \text{Heating Savings} &= \text{Brushless DC motor or Electronically commutated motor (ECM)} \\ &= 418 \text{ kWh}^{486} \end{aligned}$$

---

<sup>482</sup> Average of 15-18 year lifetime estimate made by the Consortium for Energy Efficiency in 2010.

<sup>483</sup> Assumed to be one third of effective useful life.

<sup>484</sup> Based on data from Appendix E of the US DOE Appliance Standards Technical Support Documents including equipment cost and installation labor. Where efficiency ratings are not provided, the values are interpolated from those that are.

<sup>485</sup> \$2641 inflated using 1.91% rate.

<sup>486</sup> To estimate heating, cooling and shoulder season savings for Illinois, VEIC adapted results from a 2009 Focus on Energy study of BPM blower motor savings in Wisconsin. This study included effects of behavior change based on the efficiency of new motor greatly increasing the amount of people that run the fan continuously. The savings from the Wisconsin study were adjusted to account for different run hour assumptions (average values used) for Illinois. See: FOE to IL Blower Savings.xlsx.

Cooling Savings = Brushless DC motor or electronically commutated motor (ECM) savings during cooling season  
 If air conditioning = 263 kWh  
 If no air conditioning = 175 kWh  
 If unknown (weighted average)= 241 kWh<sup>487</sup>

Shoulder Season Savings = Brushless DC motor or electronically commutated motor (ECM) savings during shoulder seasons  
 = 51 kWh

**For example**, a blower motor in a low rise office building where air conditioning presence is unknown:

$$\begin{aligned} \Delta\text{kWh} &= \text{Heating Savings} + \text{Cooling Savings} + \text{Shoulder Season Savings} \\ &= 418 + 241 + 51 \\ &= 710 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

For units that have evaporator coils and condensing units and are cooling in the summer in addition to heating in the winter the summer coincident peak demand savings should be calculated. If the unit is not equipment with coils or condensing units, the summer peak demand savings will not apply.

$$\Delta\text{kW} = (\text{CoolingSavings}/\text{HOURSyear}) * \text{CF}$$

Where:

HOURSyear = Actual hours per year if known, otherwise use hours from Table below for building type:<sup>488</sup>

Building Type	HOURSyear	Model source
Assembly	2150	eQuest
Assisted Living	4373	eQuest
Auto Dealership	1605	OpenStudio
College	4065	OpenStudio
Convenience Store	2084	eQuest
Drug Store	1708	OpenStudio
Elementary School	2649	OpenStudio
Emergency Services	3277	OpenStudio
Garage	2102	eQuest
Grocery	5470	OpenStudio
Healthcare Clinic	6364	OpenStudio
High School	3141	eQuest
Hospital - VAV econ	8707	OpenStudio
Hospital - CAV econ	2336	OpenStudio
Hospital - CAV no econ	4948	OpenStudio
Hospital - FCU	8760	OpenStudio
Manufacturing Facility	2805	eQuest

<sup>487</sup> The weighted average value is based on assumption that 75% of buildings installing BPM furnace blower motors have Central AC.

<sup>488</sup> Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the cooling system is operating for each building type.

Building Type	HOURSyear	Model source
MF - High Rise	6823	OpenStudio
MF - Mid Rise	4996	OpenStudio
Hotel/Motel – Guest	4155	OpenStudio
Hotel/Motel - Common	6227	OpenStudio
Movie Theater	2120	eQuest
Office - High Rise - VAV econ	3414	OpenStudio
Office - High Rise - CAV econ	4849	eQuest
Office - High Rise - CAV no econ	6049	OpenStudio
Office - High Rise - FCU	5341	OpenStudio
Office - Low Rise	3835	OpenStudio
Office - Mid Rise	3040	OpenStudio
Religious Building	2830	eQuest
Restaurant	2305	OpenStudio
Retail - Department Store	2528	eQuest
Retail - Strip Mall	2266	eQuest
Warehouse	770	eQuest
Unknown	2987	n/a

CF =Summer Peak Coincidence Factor for measure is provided below for different building types:<sup>489</sup>

HVAC Pumps	CF
Assembly	48.3%
Assisted Living	52.9%
College	14.2%
Convenience Store	57.1%
Elementary School	33.3%
Emergency Services	19.6%
Garage	61.9%
Grocery	47.5%
Healthcare Clinic	61.9%
High School	28.8%
Hospital - VAV econ	57.6%
Hospital - CAV econ	61.5%
Hospital - CAV no econ	64.8%
Hospital - FCU	60.9%
Manufacturing Facility	43.3%
MF - High Rise - Common	43.7%
MF - Mid Rise	24.3%
Hotel/Motel - Guest	62.9%
Hotel/Motel - Common	64.6%
Movie Theater	41.9%
Office - High Rise - VAV econ	43.2%
Office - High Rise - CAV econ	48.3%
Office - High Rise - CAV no econ	50.3%
Office - High Rise - FCU	46.2%
Office - Low Rise	47.4%
Office - Mid Rise	42.8%

<sup>489</sup> Coincidence Factors are estimated using the eQuest models.

HVAC Pumps	CF
Religious Building	43.3%
Restaurant	48.8%
Retail - Department Store	50.5%
Retail - Strip Mall	52.8%
Warehouse	22.5%
Unknown	42.4%

**For example**, a blower motor in a low rise office building where air conditioning presence is unknown:

$$\begin{aligned} \Delta kW &= (241 / 2481) * 0.474 \\ &= 0.05 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

Time of Sale:

$$\Delta \text{Therms} = \text{EFLH} * \text{Capacity} * ((\text{AFUE}(\text{eff}) - \text{AFUE}(\text{base})) / \text{AFUE}(\text{base})) / 100,000 \text{ Btu/Therm}$$

Early replacement<sup>490</sup>:

$\Delta$ Therms for remaining life of existing unit (1st 5.5 years):

$$\Delta \text{Therms} = \text{EFLH} * \text{Capacity} * ((\text{AFUE}(\text{eff}) - \text{AFUE}(\text{exist})) / \text{AFUE}(\text{exist})) / 100,000 \text{ Btu/Therm}$$

$\Delta$ Therms for remaining measure life (next 11 years):

$$\Delta \text{Therms} = \text{EFLH} * \text{Capacity} * ((\text{AFUE}(\text{eff}) - \text{AFUE}(\text{base})) / \text{AFUE}(\text{base})) / 100,000 \text{ Btu/Therm}$$

Where:

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

Capacity = Nominal Heating Input Capacity Furnace Size (Btu/hr) for efficient unit not existing unit  
 = custom Furnace input capacity in Btu/hr

AFUE(exist) = Existing Furnace Annual Fuel Utilization Efficiency Rating  
 = Use actual AFUE rating where it is possible to measure or reasonably estimate.  
 If unknown, assume 64.4 AFUE%. <sup>491</sup>

AFUE(base) = Baseline Furnace Annual Fuel Utilization Efficiency Rating  
 Dependent on program type as listed below:

Program Year	AFUE(base)
Time of Sale	80%
Early Replacement	90%

<sup>490</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

<sup>491</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

AFUE(eff) = Efficient Furnace Annual Fuel Utilization Efficiency Rating.  
= Actual. If Unknown, assume 95%.<sup>492</sup>

**For example,**

$$\begin{aligned}\Delta\text{Therms} &= 1428 * 150,000 * ((0.92-0.80)/0.80) / 100,000 \\ &= 321 \text{ Therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-FRNC-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>492</sup>Minimum ENERGY STAR efficiency after 2.1.2012.

## 4.4.12 Infrared Heaters

### DESCRIPTION

A natural gas-fired radiant infrared heater uses the combustion of natural gas to heat a metal tube or ceramic panel to a very high temperature (typically between 1200 and 5000 degrees Fahrenheit). The high surface temperature causes radiative heat transfer between the heater surface and its surroundings. The surroundings will re-radiate the heat to occupants and release heat through convection to the air, providing a comfortable environment without directly heating air.

Infrared heaters are ideal for space heating applications where there are elevated ceilings with high thermal stratification, spaces with high ventilation or air infiltration rates, or a need for spot heating within an unconditioned or industrial space. Aircraft hangars, warehouses, greenhouses, manufacturing production areas, pools, and loading docks are space types that can be efficiently served by a radiant infrared heater.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a natural gas heater with an electric ignition that uses non-conditioned air for combustion. Gross Radiant Coefficient (GRC) is provided by the manufacturer and defined as the ratio of radiant heat output delivered in Btu to the natural gas input energy.<sup>493</sup>

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a standard natural gas fired warm air heater.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.<sup>494</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$2.70 per kBtu/hr input capacity.<sup>495</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

---

<sup>493</sup> "AHRI Standard 1330 - 2014 Standard for Performance Rating for Radiant Output of Gas Fired Infrared Heaters". 2014. Air Conditioning, Heating, and Refrigeration Institute. Arlington, VA.

<sup>494</sup> 2020 Michigan Energy Measures Database (MEMD). Please see file "mi\_master\_measure\_database\_2020-011020\_681298\_7.xlsx"

<sup>495</sup> 2020 Michigan Energy Measures Database (MEMD). Please see file "mi\_master\_measure\_database\_2020-011020\_681298\_7.xlsx"



**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

Natural gas savings for this measure are based on the standard practice of HVAC designers to size a gas-fired radiant infrared heater at a lower input capacity than an equivalent warm air unit heater for an identical application.

$$\Delta\text{Therms} = \text{Therms}(\text{base}) - \text{Therms}(\text{IR})$$

$$\text{Therms}(\text{base}) = \text{Capacity}/\text{RSF} * \text{EFLH}/100,000$$

$$\text{Therms}(\text{IR}) = \text{Capacity} * \text{EFLH}/100,000$$

Where:

- Capacity = Input capacity of radiant infrared heater in btu/hr  
= Actual
- RSF = Radiation Sizing Factor, dependent on Gross Radiant Coefficient as listed below.<sup>496,497</sup>  
If Gross Radiant Coefficient is unavailable, assume RSF = 0.85.

Gross Radiant Coefficient (GRC)	RSF (Radiation Sizing Factor)
GRC < 0.67	0.85
0.67 ≤ GRC	0.70

- EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use
- 100,000 = Btu to therm conversion factor

**For example:** a radiant heater with a natural gas input capacity of 125,000 Btu/hr and a Gross Radiant Coefficient of 0.45 installed in a warehouse in Chicago will save:

$$\Delta\text{Therms} = \text{Therms}(\text{base}) - \text{Therms}(\text{IR})$$

$$\text{Therms}(\text{base}) = 125,000/0.85 * 1286/100,000 = 1891.176 \text{ Therms}$$

$$\text{Therms}(\text{IR}) = 125,000 * 1286/100,000 = 1607.500 \text{ Therms}$$

$$\Delta\text{Therms} = 1891.176 - 1607.500 = 283.676 \text{ Therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>496</sup> 2016 ASHRAE® HANDBOOK: Heating, Ventilating, and Air-Conditioning SYSTEMS AND EQUIPMENT, Inch-Pound Edition, Chapter 16, pg. 16.1, "Energy Conservation," 2016, American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc. Atlanta, GA.

<sup>497</sup> "Put Your Infra-Red Knowledge to the Test". Contracting Canada, July - August 2002.

**MEASURE CODE: CI-HVC-IRHT-V02-210101**

**REVIEW DEADLINE: 1/1/2023**

## 4.4.13 Package Terminal Air Conditioner (PTAC) and Package Terminal Heat Pump (PTHP)

### DESCRIPTION

A PTAC is a packaged terminal air conditioner that cools and sometimes provides heat through an electric resistance heater (heat strip). A PTHP is a packaged terminal heat pump. A PTHP uses its compressor year round to heat or cool. In warm weather, it efficiently captures heat from inside your building and pumps it outside for cooling. In cool weather, it captures heat from outdoor air and pumps it into your home, adding heat from electric heat strips as necessary to provide heat.

This measure characterizes:

- a) Time of Sale: the purchase and installation of a new efficient PTAC or PTHP.
- b) Early Replacement: the early removal of an existing PTAC or PTHP from service, prior to its natural end of life, and replacement with a new efficient PTAC or PTHP unit. Savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit and efficient unit consumption for the remainder of the measure life. The measure is only valid for non-fuel switching installations – for example replacing a cooling only PTAC with a PTHP can currently not use the TRM.

This measure was developed to be applicable to the following program types: TOS NC, EREP. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be PTACs or PTHPs that exceed baseline efficiencies.

### DEFINITION OF BASELINE EQUIPMENT

Time of Sale: the baseline condition is equipment that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date is unknown, assume current Code minimum).

Early Replacement: the baseline is the existing PTAC or PTHP for the assumed remaining useful life of the unit and the new baseline as defined above for the remainder of the measure life.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 8 years.<sup>498</sup>

Remaining life of existing equipment is assumed to be 3 years.<sup>499</sup>

### DEEMED MEASURE COST

Time of Sale: The incremental capital cost for this equipment is estimated to be \$84/ton.<sup>500</sup>

Early Replacement: The measure cost is the full cost of removing the existing unit and installing a new one. The actual program cost should be used. If unknown assume \$1,047 per ton.<sup>501</sup>

---

<sup>498</sup> Based on 2015 DOE Technical Support Document, as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>499</sup> Standard assumption of one third of effective useful life.

<sup>500</sup> DEER 2008. This assumes that baseline shift from IECC 2012 to IECC 2015 carries the same incremental costs. Values should be verified during evaluation.

<sup>501</sup> Based on DCEO – IL PHA Efficient Living Program data.

The assumed deferred cost (after 5 years) of replacing existing equipment with new baseline unit is assumed to be \$1,039 per ton.<sup>502</sup> This cost should be discounted to present value using the nominal discount rate.

### LOADSHAPE

Loadshape C03 - Commercial Cooling

### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)}$$

$$= 91.3\% \text{ }^{503}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 47.8\% \text{ }^{504}$$

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

Electric savings for PTACs and PTHPs should be calculated using the following algorithms

#### ENERGY SAVINGS

Time of Sale:

$$\text{PTAC } \Delta \text{kWh}^{505} = \text{Annual kWh Savings}_{\text{cool}}$$

$$\text{PTHP } \Delta \text{kWh} = \text{Annual kWh Savings}_{\text{cool}} + \text{Annual kWh Savings}_{\text{heat}}$$

$$\text{Annual kWh Savings}_{\text{cool}} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{base}}) - (1/\text{EER}_{\text{ee}})] * \text{EFLH}_{\text{cool}}$$

$$\text{Annual kWh Savings}_{\text{heat}} = (\text{kBtu/hr}_{\text{heat}})/3.412 * [(1/\text{COP}_{\text{base}}) - (1/\text{COP}_{\text{ee}})] * \text{EFLH}_{\text{heat}}$$

Early Replacement:

$$\Delta \text{kWh for remaining life of existing unit (1}^{\text{st}} \text{ 5 years)} = \text{Annual kWh Savings}_{\text{cool}} + \text{Annual kWh Savings}_{\text{heat}}$$

$$\text{Annual kWh Savings}_{\text{cool}} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{exist}}) - (1/\text{EER}_{\text{ee}})] * \text{EFLH}_{\text{cool}}$$

$$\text{Annual kWh Savings}_{\text{heat}} = (\text{kBtu/hr}_{\text{heat}})/3.412 * [(1/\text{COP}_{\text{exist}}) - (1/\text{COP}_{\text{ee}})] * \text{EFLH}_{\text{heat}}$$

$$\Delta \text{kWh for remaining measure life (next 10 years)} = \text{Annual kWh Savings}_{\text{cool}} + \text{Annual kWh Savings}_{\text{heat}}$$

$$\text{Annual kWh Savings}_{\text{cool}} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{base}}) - (1/\text{EER}_{\text{ee}})] * \text{EFLH}_{\text{cool}}$$

---

<sup>502</sup> Based on subtracting TOS incremental cost from the DCEO data and incorporating inflation rate of 1.91%.

<sup>503</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>504</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>505</sup> There are no heating efficiency improvements for PTACs since although some do provide heating, it is always through electric resistance and therefore the COP<sub>base</sub> and COP<sub>ee</sub> would be 1.0.

$$\text{Annual kWh Savings}_{\text{heat}} = (\text{kBtu/hr}_{\text{heat}})/3.412 * [(1/\text{COP}_{\text{base}}) - (1/\text{COP}_{\text{ee}})] * \text{EFLH}_{\text{heat}}$$

Where:

- $\text{kBtu/hr}_{\text{cool}}$  = capacity of the cooling equipment in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).  
= Actual installed
- $\text{EFLH}_{\text{cool}}$  = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use:
- $\text{EFLH}_{\text{heat}}$  = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use
- $\text{EER}_{\text{exist}}$  = Energy Efficiency Ratio of the existing equipment  
= Actual. If unknown assume 8.3 EER.<sup>506</sup>
- $\text{EER}_{\text{base}}$  = Energy Efficiency Ratio of the baseline equipment; see the table below for values.  
= Based on applicable Code on date of equipment purchase (if unknown assume current Code

---

<sup>506</sup> Efficiency of existing unit is estimated based on the 2012 IECC building energy code, and assuming a 1 ton unit;  $\text{EER} = 10.9 - (0.213 * 12,000/1,000) = 8.3$ .

**Copy of Table C403.2.3(3): Minimum Efficiency Requirements: Electrically operated packaged terminal air conditioners, packaged terminal heat pumps**

Equipment Type	IECC 2012 Minimum Efficiency (baseline effective 1/1/2013)	IECC 2015/2018 Minimum Efficiency (baseline effective 1/1/2016)	Federal Regulations Minimum Efficiency (baseline effective 1/1/2019)
PTAC (Cooling mode) New Construction	13.8 – (0.300 x Cap/1000) EER	14.0 – (0.300 x Cap/1000) EER	14.0 – (0.300 x Cap/1000) EER Compliance date: 1/1/2017
PTAC (Cooling mode) Replacements	10.9 – (0.213 x Cap/1000) EER	10.9 – (0.213 x Cap/1000) EER	10.9 – (0.213 x Cap/1000) EER Compliance date: 10/7/2010
PTHP (Cooling mode) New Construction	14.0 – (0.300 x Cap/1000) EER	14.0 – (0.300 x Cap/1000) EER	14.0 – (0.300 x Cap/1000) EER Compliance date: 10/8/2012
PTHP (Cooling mode) Replacements	10.8 – (0.213 x Cap/1000) EER	10.8 – (0.213 x Cap/1000) EER	10.8 – (0.213 x Cap/1000) EER Compliance date: 10/7/2010
PTHP (Heating mode) New Construction	3.2 – (0.026 x Cap/1000) COP	3.2 – (0.026 x Cap/1000) COP	3.7 – (0.052 x Cap/1000) COP Compliance date: 10/8/2012
PTHP (Heating mode) Replacements	2.9 – (0.026 x Cap/1000) COP	2.9 – (0.026 x Cap/1000) COP	2.9 – (0.026 x Cap/1000) COP Compliance date: 10/7/2010

Table notes: “Cap” = The rated cooling capacity of the project in Btu/hr. If the units capacity is less than 7000 Btu/hr, use 7,000 Btu/hr in the calculation. If the unit’s capacity is greater than 15,000 Btu/hr, use 15,000 Btu/hr in the calculations.

Replacement unit shall be factory labeled as follows “MANUFACTURED FOR REPLACEMENT APPLICATIONS ONLY; NOT TO BE INSTALLED IN NEW CONSTRUCTION PROJECTS”, Replacement efficiencies apply only to units with existing sleeves less than 16 inches (406mm) in height and less than 42 inches (1067 mm) in width.

- EER<sub>ee</sub> = Energy Efficiency Ratio of the energy efficient equipment. For air-cooled units < 65 kBtu/hr, if the actual EER<sub>ee</sub> is unknown, assume the following conversion from SEER to EER for calculation of peak savings<sup>507</sup>:  $EER = (-0.02 * SEER^2) + (1.12 * SEER)$
- = Actual installed
- kBtu/hr<sub>heat</sub> = capacity of the heating equipment in kBtu per hour.
- = Actual installed
- 3.412 = Btu per Wh.
- COP<sub>exist</sub> = coefficient of performance of the existing equipment

<sup>507</sup> Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

- = Actual. If unknown assume 1.0 COP for PTAC units and 2.6 COP for PTHPs<sup>508</sup>
- COP<sub>base</sub> = coefficient of performance of the baseline equipment; see table above for values.
- COP<sub>ee</sub> = coefficient of performance of the energy efficient equipment.
- = Actual installed.

**Time of Sale (assuming new construction baseline):**

**For example**, a 1 ton PTAC with an efficient EER of 12 in a guest room of a hotel in Rockford with a building permit dated after 1/1/2016 saves:

$$= [(12) * [(1/10.4) - (1/12)] * 1,042$$

$$= 160 \text{ kWh}$$

**Early Replacement (assuming replacement baseline for deferred replacement in 5 years):**

**For example**, a 1 ton PTHP with an efficient EER of 12, COP of 3.0 in a guest room of a hotel in Rockford replaces a PTAC unit (with electric resistance heat) with unknown efficiency.

ΔkWh for remaining life of existing unit (1<sup>st</sup> 5 years)

$$= (12 * (1/8.3 - 1/12) * 1,042) + (12/3.412 * (1/1.0 - 1/3.0) * 1,758)$$

$$= 465 + 4,122$$

$$= 4,587 \text{ kWh}$$

ΔkWh for remaining measure life (next 10 years)

$$= (12 * (1/8.3 - 1/12) * 1,042) + (12/3.412 * (1/1.0 - 1/3.0) * 1,758)$$

$$= 465 + 4,122$$

$$= 4,587 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Time of Sale:

$$\Delta kW = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{base}}) - (1/\text{EER}_{\text{ee}})] * \text{CF}$$

Early Replacement:

$$\Delta kW \text{ for remaining life of existing unit (1}^{\text{st}} \text{ 5 years)} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{exist}}) - (1/\text{EER}_{\text{ee}})] * \text{CF}$$

$$\Delta kW \text{ for remaining measure life (next 10 years)} = (\text{kBtu/hr}_{\text{cool}}) * [(1/\text{EER}_{\text{base}}) - (1/\text{EER}_{\text{ee}})] * \text{CF}$$

Where:

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

$$= 91.3\% \text{ }^{509}$$

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

$$= 47.8\% \text{ }^{510}$$

<sup>508</sup> Efficiency of existing unit is estimated based on the 2012 IECC building energy code, and assuming a 1 ton unit; COP = 2.9 – (0.026 \* 12,000/1,000) = 2.6.

<sup>509</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>510</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**Time of Sale:**

**For example**, a 1 ton replacement cooling unit with no heating with an efficient EER of 12 with a building permit dated after 1/1/2016 saves:

$$\begin{aligned}\Delta kW_{SSP} &= (12 * (1/10.4 - 1/12)) * 0.913 \\ &= 0.14 \text{ kW}\end{aligned}$$

**For example**, a 1 ton PTHP with an efficient EER of 12, COP of 3.0 replacing a PTAC unit with unknown efficiency saves:

$\Delta kW$  for remaining life of existing unit (1<sup>st</sup> 5 years):

$$\begin{aligned}\Delta kW_{SSP} &= 12 * (1/8.3 - 1/12) * 0.913 \\ &= 0.41 \text{ kW}\end{aligned}$$

$\Delta kW$  for remaining measure life (next 10 years):

$$\begin{aligned}\Delta kW_{SSP} &= 12 * (1/8.3 - 1/12) * 0.913 \\ &= 0.41 \text{ kW}\end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-PTAC-V10-200101**

**REVIEW DEADLINE: 1/1/2022**



## 4.4.14 Pipe Insulation

### DESCRIPTION

This measure provides rebates for installation of 1” – 4” fiberglass, foam, calcium silicate or other types of insulation with similar insulating properties to existing bare pipe on straight piping as well as other pipe components such as elbows, tees, valves, and flanges for all non-residential installations.

Savings are provided in two forms; default savings estimates on a per linear foot basis and savings calculated with a multitude of varying parameters with the use of an external calculator<sup>511</sup>. The default savings estimates are provided in the ‘Calculation of Savings’ section below. They provide estimated savings for measure applications with select and default parameters. The external tool, however, allows more flexibility and provides comprehensive analysis to pipe insulation projects, taking into account all on-site variables.

Default per linear foot savings estimates are provided for the both exposed indoor or above ground outdoor piping distributing fluid in the following system types (natural gas fired systems only):

- Hydronic heating systems (with or without outdoor reset controls), including:
  - boiler systems that do not circulate water around a central loop and operate upon demand from a thermostat (“non-recirculation”)
  - systems that recirculate during heating season only (“Recirculation – heating season only”)
  - systems recirculating year round (“Recirculation – year round”)
- Domestic hot water
- Low and high-pressure steam systems
  - non-recirculation
  - recirculation - heating season only
  - recirculation - year round

With the use of the external tool to account for varying parameter inputs, savings are calculated using the “Pipe Insulation” calculator available on the Nicor Gas website at: <https://www.nicorgas.com/emerging>. Savings are approached through the following inputs:

- Pipe Material: Copper, Steel, Stainless Steel
- Pipe Location: Indoor (Heated, Semi-Heated,<sup>512</sup> Unheated, Unspecified) or Outdoor
- Application: Hot Water Space Heating, Steam (5, 15, 40, 65, 100, 150 psi) for various system types detailed in the subsequent system type list below
- Thermal Regain Factor (based on pipe location)
- Building Type<sup>513</sup>
- Nominal Pipe Size (inches)
- Insulation Thickness (inches): 1”-4”, specified in ½” increments<sup>514</sup>
- Hot Water/Steam Boiler Efficiency (%): 75%-90%, specified in 2.5% increments
- Climate Zone: Rockford, Chicago, Springfield, Belleville, Marion
- Length of Installed Pipe (feet)
- Number of Elbows, Tees, Flanges, and/or Valves<sup>515</sup>

---

<sup>511</sup> Please see; ‘C&I Pipe Insulation Calculator Access.docx’ for directions on accessing the external calculator. The use of other comparable external calculators are allowed if the functionality mirrors the savings approach detailed in this characterization.

<sup>512</sup> Unconditioned space with heat transfer to conditioned space (e.g. boiler room, ceiling plenum, basement, crawlspace, wall, etc.).

<sup>513</sup> Comprehensive list of building types available in Section 4.4, HVAC End Use of IL TRM.

<sup>514</sup> For insulation thicknesses greater than 4”, savings can be claimed based on 4” insulation thickness.

<sup>515</sup> Equivalent length of elbows and tees is based on methodology described in ANSI/ASME B36.19. Equivalent length of flanges and valves is based on methodology described in ATSM Standard C1129-12.

Process piping can also use the algorithms provided but requires custom entry of hours.

For new construction applications, minimum qualifying nominal pipe diameter is 1". Piping must have at least 1" of insulation and outdoor piping must include an all-weather protective jacket. New advanced insulating materials may be thinner and savings can be calculated with 3E Plus v4.1.

The relevant code of compliance should be followed for direction on minimum permitted insulation thickness for a nominal pipe diameter. As per the International Energy Conservation Code (IECC) 2018, the minimum permitted insulation thickness is 1" for installations pertaining to new construction or major renovation heating HVAC applications<sup>516</sup>. However, there are exceptions based on Fluid Operating Temperature Range, Insulation thermal conductivity range, install locations and pipe sizes –indicating the minimum insulation thickness required for parameters described in the column headers presented in the table below.

Fluid Operating Temperature Range and Usage (°F)	Insulation Conductivity		Nominal Pipe or Tube Size (inches)				
	Conductivity Btu.in/(h.ft <sup>2</sup> .°F)	Mean Rating Temperature, °F	<1	1 to <1.5	1.5 to <4	4 to <8	≥8
>350	0.32 - 0.34	250	4.5	5.0	5.0	5.0	5.0
251 - 350	0.29 - 0.32	200	3.0	4.0	4.5	4.5	4.5
201 - 250	0.27 - 0.30	150	2.5	2.5	2.5	3.0	3.0
141 - 200	0.25 - 0.29	125	1.5	1.5	2.0	2.0	2.0
105 - 140	0.21 - 0.28	100	1.0	1.0	1.5	1.5	1.5
40 -60	0.21 - 0.27	75	0.5	0.5	1.0	1.0	1.0
<40	0.20 - 0.26	50	0.5	1.0	1.0	1.0	1.5

Note – The above table is not representative of the applicability of the workpaper measure and does not reflect any limitations in the web-based calculator. This is merely the requirements cited by the IECC 2018 code for pipe insulation.

This measure was developed to be applicable to the following program types: RF, DI

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient case is installing pipe wrap insulation to a length of pipe. Indoor piping must have at least 1" of insulation (or equivalent R-value) and outdoor piping must have at least 2" of insulation (or equivalent R-value) and include an all-weather protective jacket. Minimum qualifying pipe diameter is 1." Insulation must be continuous and contiguous over fittings that directly connect to straight pipe, including elbows and tees.<sup>517</sup>

**DEFINITION OF BASELINE EQUIPMENT**

The base case for savings estimates is a bare pipe. Pipes are required by new construction code to be insulated but are still commonly found uninsulated in older commercial buildings.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 15 years.<sup>518</sup>

<sup>516</sup> International Energy Conservation Code, 2018; Section C403.11.3 Piping Insulation (Mandatory), Table C403.11.3, Page C-69.

<sup>517</sup> ASHRAE Handbook—Fundamentals, 23.14; Hart, G., "Saving energy by insulating pipe components on steam and hot water distribution systems", ASHRAE Journal, October 2011.

<sup>518</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

**DEEMED MEASURE COST**

Actual costs should be used if known. Otherwise, the deemed measure costs below based on RS Means<sup>519</sup> pricing reference materials may be used.<sup>520</sup> The following table summarizes the estimated costs for this measure per foot of insulation added and include installation costs:

Insulation Thickness				
	1 Inch	1.5 Inches	2 Inches	2.5 Inches
Pipe- RS Means #	220719.10.5140	220719.10.4900	220719.10.4900	Extrapolated
Jacket- RS Means #	220719.30.0152 & 220719.40.0240	220719.30.0140 & 220719.40.0140	220719.30.0140 & 220719.40.0140	220719.30.0140 & 220719.40.0140
Pipe Insulation Type	Calcium Silicate	Calcium Silicate	Calcium Silicate	Calcium Silicate
Jacket Type (Indoor)	PVC	PVC	PVC	PVC
Jacket Type (Outdoor)	Aluminum	Aluminum	Aluminum	Aluminum
Insulation Cost per foot [1]	\$11.45	\$15.73	\$20.23	\$24.58
Jacket Cost per foot (Indoor) [2]	\$4.90	\$6.70	\$6.70	\$6.70
Jacket Cost per foot (Outdoor) [3]	\$6.75	\$9.27	\$9.27	\$9.27
<b>Total Cost per foot (Indoor) = [1+2]</b>	<b>\$16.35</b>	<b>\$22.43</b>	<b>\$26.93</b>	<b>\$31.28</b>
<b>Total Cost per foot (Outdoor) = [1+3]</b>	<b>\$18.20</b>	<b>\$25.00</b>	<b>\$29.50</b>	<b>\$33.85</b>

Insulation Thickness (continued)			
	3 Inches	3.5 Inches	4 Inches
Pipe- RS Means #	220719.10.4900	Extrapolated	Extrapolated
Jacket- RS Means #	220719.30.0140 & 220719.40.0140	220719.30.0140 & 220719.40.0140	220719.30.0140 & 220719.40.0140
Pipe Insulation Type	Calcium Silicate	Calcium Silicate	Calcium Silicate
Jacket Type (Indoor)	PVC	PVC	PVC
Jacket Type (Outdoor)	Aluminum	Aluminum	Aluminum
Insulation Cost per foot [1]	\$28.92	\$33.32	\$37.70
Jacket Cost per foot (Indoor) [2]	\$6.70	\$6.70	\$6.70
Jacket Cost per foot (Outdoor) [3]	\$9.27	\$9.27	\$9.27
<b>Total Cost per foot (Indoor) = [1+2]</b>	<b>\$35.62</b>	<b>\$40.02</b>	<b>\$44.40</b>
<b>Total Cost per foot (Outdoor) = [1+3]</b>	<b>\$38.19</b>	<b>\$42.59</b>	<b>\$46.97</b>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

<sup>519</sup> RS Means 2008. Mechanical Cost Data, pages 106 to 119

<sup>520</sup> RS Means 2010: “for fittings, add 3 linear feet for each fitting plus 4 linear feet for each flange of the fitting”

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\begin{aligned} \Delta \text{therms per foot}^{521} &= [((Q_{\text{base}} - Q_{\text{eff}}) * \text{EFLH}) / (100,000 * \eta_{\text{Boiler}})] * \text{TRF} \\ &= [\text{Modeled or provided by tables below}] * \text{TRF} \\ \Delta \text{therms} &= (L_{\text{sp}} + L_{\text{oc,i}}) * \Delta \text{therms per foot} \end{aligned}$$

Where:

EFLH = Equivalent Full Load Hours for Heating in Existing Buildings or New Construction  
 = Actual or defaults by building type provided in Section 4.4, HVAC end use  
 For year round recirculation or domestic hot water:  
 = 8,766

For heating season recirculation, hours with the outside air temperature below 55°F:

Zone	Hours
Zone 1 (Rockford)	5,039
Zone 2 (Chicago)	4,963
Zone 3 (Springfield)	4,495
Zone 4 (Belleville/	4,021
Zone 5 (Marion)	4,150

$Q_{\text{base}}$  = Heat Loss from Bare Pipe (Btu/hr/ft)  
 = Calculated where possible using 3E Plusv4.1 software. For defaults see table below  
 $Q_{\text{eff}}$  = Heat Loss from Insulated Pipe (Btu/hr/ft)  
 = Calculated where possible using 3E Plusv4.1 software. For defaults see table below  
 100,000 = conversion factor (1 therm = 100,000 Btu)  
 $\eta_{\text{Boiler}}$  = Efficiency of the boiler being used to generate the hot water or steam in the pipe  
 = Actual or if unknown use default values given below:  
 = 81.9% for water boilers<sup>522</sup>

<sup>521</sup>This value comes from the reference table “Savings Summary by Building Type and System Type.” The formula and the input tables in this section document assumptions used in calculation spreadsheet “Pipe Insulation Savings 2013-11-12.xlsx”.

<sup>522</sup> Average efficiencies of units from the California Energy Commission (CEC).

= 80.7% for steam boilers, except multifamily low-pressure <sup>523</sup>

= 64.8% for multifamily low-pressure steam boilers <sup>524</sup>

TRF = Thermal Regain Factor for space type, applied only to space heating energy and is applied to values resulting from  $\Delta$ therms/ft tables below <sup>525</sup>

= See table below for base TRF values by pipe location

May vary seasonally such as: TRF[summer] \* summer hours + TRF[winter] \* winter hours where TRF values reflecting summer and winter conditions are apportioned by the hours for those conditions. TRF may also be adjusted by building specific balance temperature and operating hours above and below that balance temperature.<sup>526</sup>

Pipe Location	Assumed Regain	TRF, Thermal Regain Factor
Outdoor	0%	1.0
Indoor, heated space	85%	0.15
Indoor, semi- heated, (unconditioned space, with heat transfer to conditioned space. E.g., boiler room, ceiling plenum, basement, crawlspace, wall)	30%	0.70
Indoor, unheated, (no heat transfer to conditioned space)	0%	1.0
Location not specified	85%	0.15
Custom	Custom	1 – assumed regain

$L_{sp}$  = Length of straight pipe to be insulated (linear foot)  
 = actual installed ((linear foot)

$L_{oc,l}$  = Total equivalent length of the other components (valves and tees) of pipe to be insulated  
 = Actual installed (linear foot). See table “Equivalent Length of Other Components – Elbows and Tees” for equivalent lengths.

The heat loss estimates ( $Q_{base}$  and  $Q_{eff}$ ) were developed using the 3E Plus v4.1 software program.<sup>527</sup> The energy savings analysis is based on adding 1-inch (indoor) or 2-inch (outdoor) thick insulation around bare pipe. The thermal conductivity of pipe insulation varies by material and temperature rating; to obtain a typical value, a range of materials allowed for this measure were averaged. For insulation materials not in the table below, use 3E Plusv4.0 software to calculate  $Q_{base}$  and  $Q_{eff}$ .

<sup>523</sup> Ibid.

<sup>524</sup> Katrakis, J. and T.S. Zawacki. “Field-Measured Seasonal Efficiency of Intermediate-sized Low-Pressure Steam Boilers”. ASHRAE V99, pt. 2, 1993.

<sup>525</sup> Thermal regain for *residential* pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012 and Andrews, John, Better Duct Systems for Home Heating and Cooling, U.S. Department of Energy, 2001. Recognizing the differences between residential and commercial heating systems, the factors have been adjusted based on professional judgment. This factor would benefit from additional study and evaluation.

<sup>526</sup> Thermal Regain Factor\_4-30-14.docx

<sup>527</sup> 3E Plus is a heat loss calculation software provided by the NAIMA (North American Insulation Manufacturer Association).

Insulation Type	Conductivity (Btu.in / hr.ft <sup>2</sup> .°F @ 75F)	Max temp (°F)
Polyethylene foam	0.25	200
Flexible polyurethane-based foam	0.27	200
Fiberglass	0.31	250
Melamine foam	0.26	350
Flexible silicon foam	0.40	392
Calcium silicate	0.40	1200
Cellular glass	0.31	400
Average conductivity of all these materials (Btu.in / hr.ft <sup>2</sup> .°F @ 75°F)	0.31	

The pipe fluid temperature assumption used depends upon both the system type and whether there is outdoor reset controls:

System Type	Fluid temperature assumption (°F)
Hot Water space heating with outdoor reset - Non recirculation	145
Hot Water space heating without outdoor reset - Non recirculation	170
Hot Water space heating with outdoor reset – Recirculation heating season only	145
Hot Water space heating without outdoor reset – Recirculation heating season only	170
Hot Water space heating with outdoor reset – Recirculation year round	130
Hot Water space heating without outdoor reset – Recirculation year round	170
Domestic Hot Water	125
5 psi Steam (low pressure)	225
15 psi Steam (low pressure)	250
40 psi Steam (low pressure)	287
65 psi Steam (high pressure)	312
100 psi Steam (high pressure)	338
150 psi Steam (high pressure)	365

Example System Types	Indoor Insulation, Hot Water	Indoor Insulation, 5 psi Steam	Indoor Insulation, 65 psi Steam	Domestic Hot Water	Outdoor Insulation, Hot Water	Outdoor Insulation, 5 psi Steam	Outdoor Insulation, 65 psi Steam
Insulation thickness (inch)	1	2	2.5	1	3	3.5	4
Temperature, Fluid in Pipe (°F)	170 (w/o reset) 145 (w/ reset heat) 130 (w/reset year)	225	312	125	170 (w/o reset) 145 (w/ reset heat) 130 (w/reset year)	225	312
Climate Zone	Climate Zone 2: Chicago						
Building Type	Office – Mid Rise						
Operating Time (hrs/yr)	1,629 (non-recirc) 4,963 (recirc heating season) 8,766 (recirc year-round)						
Ambient Temperature (°F) <sup>528</sup>	75	75	75	75	48.6	48.6	48.6
Wind speed (mph) <sup>529</sup>	0	0	0	0	5.0	5.0	5.0
Boiler / Water Heater efficiency	75%	80%	85%	67%	80%	85%	90%
<b>Pipe parameters</b>							
Pipe Location	Indoor Heated	Indoor Semi-heated	Indoor Unheated	n/a	Outdoor		
Pipe material	Copper	Steel	Stainless Steel	Copper	Copper	Steel	Stainless Steel
Length of Pipe (ft)	100						
Pipe size for Heat Loss Calc	2"	2"	2"	2"	2"	2"	2"
Outer Diameter, Pipe, actual	2.38"	2.38"	2.38"	2.38"	2.38"	2.38"	2.38"
Heat Loss, Bare Pipe (from 3EPlus) (Btu/hr.ft)	113.5 (w/o reset) 77.8 (w/ reset heat) 58 (w/reset year)	232.2	286.3	52	460.2 (w/o reset) 363.4 (w/ reset heat) 306 (w/reset year)	709.5	942.2
<b>Insulation parameters</b>							
Average Heat Loss, Insulation (from 3EPlus) (Btu/hr.ft)	21.6 (w/o reset) 15.8 (w/ reset heat) 12.4 (w/reset year)	22.6	31.8	13.25	15.2 (w/o reset) 12.1 (w/ reset heat) 10.2 (w/reset year)	20.4	28.2

<sup>528</sup> DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL for the average ambient temperature for Aurora, IL.

<sup>529</sup> DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL for the average ambient temperature for Aurora, IL.

Example System Types	Indoor Insulation, Hot Water	Indoor Insulation, 5 psi Steam	Indoor Insulation, 65 psi Steam	Domestic Hot Water	Outdoor Insulation, Hot Water	Outdoor Insulation, 5 psi Steam	Outdoor Insulation, 65 psi Steam
<b>Annual Energy Savings/ft</b>							
Annual Gas Use, Base Case (therms/yr/ft)	2.46 (w/o reset) 5.15 (w/ reset heat) 6.78 (w/reset year)	4.73 (non recirc) 14.4 (recirc heat) 25.4 (recirc year)	5.5 (non recirc) 16.7 (recirc heat) 29.5 (recirc year)	6.76	9.37 (w/o reset) 22.5 (w/ reset heat) 33.5 (w/reset year)	13.6 (non recirc) 41.4 (recirc heat) 73.2 (recirc year)	17.1 (non recirc) 52.0 (recirc heat) 91.8 (recirc year)
Annual Gas Use, Measure case (therms/yr/ft)	0.46 (w/o reset) 1.05 (w/ reset heat) 1.48 (w/reset year)	0.43 (non recirc) 1.4 (recirc heat) 2.4 (recirc year)	0.6 (non recirc) 1.8 (recirc heat) 3.2 (recirc year)	1.73	0.3 (w/o reset) 0.7 (w/ reset heat) 1.1 (w/reset year)	0.4 (non recirc) 1.2 (recirc heat) 2.1 (recirc year)	0.6 (non recirc) 1.6 (recirc heat) 2.8 (recirc year)
Annual Gas Savings (therms/yr/ft)	2.0 (w/o reset) 4.1 (w/ reset heat) 5.3 (w/reset year)	4.3 (non recirc) 13.0 (recirc heat) 23.0 (recirc year)	4.9(non recirc) 14.9 (recirc heat) 26.3 (recirc year)	5.02	9.1 (w/o reset) 21.8 (w/ reset heat) 32.4 (w/reset year)	13.2 (non recirc) 40.2 (recirc heat) 71.1 (recirc year)	16.5 (non recirc) 50.4 (recirc heat) 89 (recirc year)
<b>Elbows, Tees, Flanges, &amp; Valves</b>							
Number of Elbows	5	10	20	n/a	5	10	20
Number of Tees	5	10	20	n/a	5	10	20
Number of Flanges	5	10	20	n/a	5	10	20
Number of Valves	5	10	20	n/a	5	10	20
<b>Annual Energy Savings</b>							
Total Gas Savings (therms/yr)	39 (w/o reset) 80 (w/ reset heat) 104 (w/reset year)	478 (non recirc) 1,456 (recirc heat) 2,571 (recirc year)	1,072 (non recirc) 3,267 (recirc heat) 5,770 (recirc year)	502	930 (w/o reset) 2,832 (w/ reset heat) 4,211 (w/reset year)	2,112 (non recirc) 6,434 (recirc heat) 11,364 (recirc year)	3,635 (non recirc) 11,074 (recirc heat) 19,560 (recirc year)

Heat = heating season only, year = year round



Values below must be multiplied by the appropriate Thermal Regain Factor (TRF). All variables were the same except for hours of operation in the calculation of the default savings per foot for the various building types and applications as presented in the table below:

**Savings Summary for Indoor pipe insulation by System Type and Building Type (Δtherms per foot)  
(continues for 3.5 pages)**

Location	System Type	Building Type	Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
			Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Indoor	Hot Water Space Heating with outdoor reset – non-recirculation	Assembly	1.32	1.36	1.21	0.81	1.24
		Assisted Living	1.25	1.22	1.07	0.79	0.95
		College	1.13	1.06	0.95	0.53	0.63
		Convenience Store	1.10	1.01	0.90	0.65	0.72
		Elementary School	1.32	1.29	1.13	0.78	0.95
		Garage	0.73	0.72	0.63	0.50	0.56
		Grocery	1.19	1.19	1.04	0.65	0.78
		Healthcare Clinic	1.17	1.20	1.05	0.71	0.75
		High School	1.37	1.38	1.23	0.88	1.03
		Hospital - CAV no econ	1.31	1.35	1.15	0.99	1.12
		Hospital - CAV econ	1.33	1.37	1.17	1.01	1.15
		Hospital - VAV econ	0.54	0.51	0.39	0.23	0.25
		Hospital - FCU	0.98	1.12	0.91	1.07	1.44
		Hotel/Motel	1.31	1.27	1.14	0.78	0.96
		Hotel/Motel - Common	1.19	1.21	1.15	0.93	0.98
		Hotel/Motel - Guest	1.30	1.26	1.13	0.75	0.93
		Manufacturing Facility	0.78	0.75	0.70	0.42	0.47
		MF - High Rise	1.13	1.12	1.02	0.87	0.87
		MF - High Rise - Common	1.35	1.31	1.17	0.81	1.04
		MF - High Rise - Residential	1.09	1.08	0.99	0.85	0.83
		MF - Mid Rise	1.23	1.25	1.07	0.79	0.90
		Movie Theater	1.35	1.33	1.24	0.94	1.12
		Office - High Rise - CAV no econ	1.50	1.52	1.38	0.93	1.01
		Office - High Rise - CAV econ	1.55	1.58	1.45	1.00	1.10
		Office - High Rise - VAV econ	1.13	1.15	0.95	0.56	0.63
		Office - High Rise - FCU	0.83	0.82	0.71	0.37	0.39
		Office - Low Rise	1.06	1.06	0.84	0.51	0.59
		Office - Mid Rise	1.17	1.18	0.99	0.63	0.70
		Religious Building	1.19	1.11	1.07	0.78	0.89
		Restaurant	1.00	1.00	0.90	0.68	0.81
Retail - Department Store	1.03	0.95	0.89	0.58	0.66		
Retail - Strip Mall	0.99	0.91	0.81	0.56	0.60		
Warehouse	1.08	1.01	1.04	0.65	0.80		
Unknown	1.15	1.14	1.01	0.73	0.84		

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Indoor	Hot Water Space Heating without outdoor reset – non-recirculation	Assembly	1.96	2.00	1.79	1.19	1.83
		Assisted Living	1.84	1.80	1.58	1.16	1.40
		College	1.67	1.56	1.40	0.78	0.93
		Convenience Store	1.62	1.50	1.33	0.95	1.06
		Elementary School	1.95	1.90	1.68	1.16	1.40
		Garage	1.08	1.06	0.93	0.74	0.82
		Grocery	1.76	1.75	1.54	0.96	1.15
		Healthcare Clinic	1.73	1.77	1.55	1.05	1.11
		High School	2.02	2.03	1.82	1.30	1.52
		Hospital - CAV no econ	1.93	1.99	1.69	1.46	1.65
		Hospital - CAV econ	1.96	2.03	1.73	1.50	1.70
		Hospital - VAV econ	0.80	0.76	0.57	0.34	0.37
		Hospital - FCU	1.45	1.65	1.35	1.58	2.13
		Hotel/Motel	1.93	1.87	1.69	1.16	1.41
		Hotel/Motel - Common	1.75	1.78	1.69	1.38	1.45
		Hotel/Motel - Guest	1.92	1.86	1.66	1.11	1.37
		Manufacturing Facility	1.15	1.11	1.03	0.62	0.69
		MF - High Rise	1.67	1.65	1.50	1.28	1.28
		MF - High Rise - Common	1.99	1.93	1.73	1.19	1.54
		MF - High Rise - Residential	1.61	1.60	1.46	1.26	1.23
		MF - Mid Rise	1.82	1.84	1.59	1.17	1.33
		Movie Theater	1.99	1.96	1.83	1.39	1.66
		Office - High Rise - CAV no econ	2.21	2.24	2.04	1.37	1.49
		Office - High Rise - CAV econ	2.29	2.33	2.14	1.48	1.63
		Office - High Rise - VAV econ	1.67	1.70	1.40	0.83	0.93
		Office - High Rise - FCU	1.22	1.21	1.04	0.55	0.58
		Office - Low Rise	1.56	1.56	1.24	0.76	0.87
		Office - Mid Rise	1.73	1.74	1.47	0.94	1.04
		Religious Building	1.75	1.65	1.58	1.15	1.32
	Restaurant	1.48	1.48	1.33	1.01	1.19	
	Retail - Department Store	1.52	1.40	1.31	0.85	0.97	
	Retail - Strip Mall	1.46	1.35	1.19	0.82	0.89	
	Warehouse	1.59	1.49	1.53	0.96	1.18	
Unknown	1.70	1.68	1.50	1.07	1.25		
Hot Water with outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	3.73	3.68	3.33	2.98	3.08	
Hot Water w/o outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	5.51	5.43	4.92	4.40	4.54	
Hot Water with outdoor reset	All buildings, Recirculation year round (All hours)	4.79	4.79	4.79	4.79	4.79	
Hot Water w/o outdoor reset	All buildings, Recirculation year round (All hours)	9.58	9.58	9.58	9.58	9.58	
Domestic Hot Water	DHW circulation loop	5.02	5.02	5.02	5.02	5.02	

Location	System Type	Building Type	Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
			Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
	LP Steam – non-recirculation	Assembly	4.25	4.36	3.89	2.59	3.97
		Assisted Living	4.01	3.92	3.44	2.53	3.04
		College	3.64	3.40	3.04	1.69	2.02
		Convenience Store	3.52	3.26	2.89	2.07	2.32
		Elementary School	4.24	4.13	3.64	2.52	3.05
		Garage	2.34	2.31	2.03	1.62	1.79
		Grocery	3.83	3.81	3.34	2.08	2.49
		Healthcare Clinic	3.76	3.85	3.36	2.29	2.42
		High School	4.39	4.42	3.96	2.82	3.30
		Hospital - CAV no econ	4.20	4.33	3.69	3.17	3.60
		Hospital - CAV econ	4.25	4.41	3.76	3.26	3.70
		Hospital - VAV econ	1.74	1.65	1.24	0.75	0.81
		Hospital - FCU	3.15	3.60	2.93	3.44	4.63
		Hotel/Motel	4.19	4.07	3.67	2.51	3.07
		Hotel/Motel - Common	3.81	3.87	3.68	3.00	3.15
		Hotel/Motel - Guest	4.18	4.05	3.62	2.42	2.98
		Manufacturing Facility	2.49	2.41	2.23	1.35	1.51
		MF - High Rise	4.52	4.46	4.07	3.46	3.47
		MF - High Rise - Common	5.38	5.22	4.68	3.23	4.17
		MF - High Rise - Residential	4.37	4.34	3.94	3.41	3.33
		MF - Mid Rise	4.94	4.99	4.30	3.16	3.60
		Movie Theater	4.33	4.26	3.98	3.03	3.61
		Office - High Rise - CAV no econ	4.81	4.88	4.45	2.98	3.24
		Office - High Rise - CAV econ	4.97	5.07	4.66	3.21	3.54
		Office - High Rise - VAV econ	3.64	3.71	3.06	1.81	2.01
		Office - High Rise - FCU	2.66	2.62	2.27	1.20	1.26
		Office - Low Rise	3.40	3.39	2.69	1.65	1.89
		Office - Mid Rise	3.77	3.78	3.19	2.03	2.26
		Religious Building	3.82	3.58	3.43	2.51	2.87
		Restaurant	3.21	3.22	2.89	2.19	2.60
	Retail - Department Store	3.31	3.04	2.86	1.86	2.12	
	Retail - Strip Mall	3.17	2.94	2.59	1.79	1.93	
	Warehouse	3.46	3.23	3.33	2.08	2.56	
	Unknown	3.70	3.66	3.26	2.34	2.71	
	LP Steam	All buildings, Recirculation heating season only (Hours below 55F)	11.99	11.81	10.70	9.57	9.88
	LP Steam	All buildings, Recirculation year round (All hours)	20.84	20.84	20.84	20.84	20.84

Location	System Type	Building Type	Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
			Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
	HP Steam – non-recirculation	Assembly	8.02	8.22	7.34	4.89	7.49
		Assisted Living	7.56	7.39	6.49	4.77	5.73
		College	6.87	6.42	5.73	3.18	3.81
		Convenience Store	6.65	6.14	5.45	3.91	4.37
		Elementary School	8.00	7.79	6.87	4.75	5.76
		Garage	4.42	4.35	3.82	3.05	3.38
		Grocery	7.22	7.19	6.30	3.93	4.70
		Healthcare Clinic	7.09	7.27	6.35	4.32	4.57
		High School	8.28	8.34	7.48	5.33	6.23
		Hospital - CAV no econ	7.92	8.16	6.95	5.98	6.79
		Hospital - CAV econ	8.03	8.32	7.09	6.14	6.98
		Hospital - VAV econ	3.28	3.12	2.35	1.41	1.53
		Hospital - FCU	5.95	6.79	5.53	6.50	8.73
		Hotel/Motel	7.91	7.69	6.93	4.74	5.79
		Hotel/Motel - Common	7.18	7.30	6.95	5.65	5.94
		Hotel/Motel - Guest	7.89	7.64	6.83	4.57	5.62
		Manufacturing Facility	4.70	4.55	4.22	2.55	2.84
		MF - High Rise	6.85	6.76	6.16	5.25	5.26
		MF - High Rise - Common	8.15	7.91	7.09	4.89	6.31
		MF - High Rise - Residential	6.62	6.57	5.97	5.17	5.04
		MF - Mid Rise	7.48	7.57	6.51	4.79	5.46
		Movie Theater	8.16	8.04	7.52	5.71	6.80
		Office - High Rise - CAV no econ	9.07	9.20	8.39	5.62	6.12
		Office - High Rise - CAV econ	9.38	9.57	8.80	6.06	6.67
		Office - High Rise - VAV econ	6.86	6.99	5.76	3.41	3.80
		Office - High Rise - FCU	5.02	4.95	4.27	2.27	2.38
		Office - Low Rise	6.41	6.40	5.08	3.11	3.56
		Office - Mid Rise	7.12	7.12	6.03	3.84	4.27
		Religious Building	7.20	6.75	6.46	4.73	5.41
		Restaurant	6.06	6.08	5.46	4.13	4.90
		Retail - Department Store	6.25	5.74	5.39	3.51	4.00
	Retail - Strip Mall	5.98	5.54	4.89	3.37	3.63	
	Warehouse	6.53	6.09	6.29	3.93	4.84	
	Unknown	6.97	6.91	6.14	4.41	5.11	
	HP Steam	All buildings, Recirculation heating season only (Hours below 55F)	22.62	22.28	20.18	18.05	18.63
	HP Steam	All buildings, Recirculation year round (All hours)	39.32	39.32	39.32	39.32	39.32

**Savings Summary for Outdoor pipe insulation by System Type and Building Type (Δtherms per foot)  
(continues for 3.5 pages)**

Location	System Type	Building Type	Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
			Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Outdoor	Hot Water Space Heating with outdoor reset – non-recirculation	Assembly	5.61	5.75	5.14	3.42	5.24
		Assisted Living	5.28	5.17	4.54	3.34	4.01
		College	4.80	4.49	4.00	2.23	2.66
		Convenience Store	4.65	4.29	3.81	2.74	3.06
		Elementary School	5.59	5.45	4.81	3.32	4.03
		Garage	3.09	3.04	2.67	2.13	2.36
		Grocery	5.05	5.03	4.41	2.75	3.29
		Healthcare Clinic	4.96	5.08	4.44	3.03	3.20
		High School	5.79	5.83	5.23	3.72	4.36
		Hospital - CAV no econ	5.54	5.71	4.86	4.18	4.74
		Hospital - CAV econ	5.62	5.82	4.96	4.30	4.88
		Hospital - VAV econ	2.29	2.18	1.64	0.98	1.07
		Hospital - FCU	4.16	4.75	3.87	4.54	6.11
		Hotel/Motel	5.53	5.37	4.85	3.32	4.05
		Hotel/Motel - Common	5.02	5.11	4.86	3.95	4.15
		Hotel/Motel - Guest	5.52	5.34	4.77	3.20	3.93
		Manufacturing Facility	3.29	3.18	2.95	1.78	1.99
		MF - High Rise	4.80	4.73	4.31	3.67	3.68
		MF - High Rise - Common	5.70	5.54	4.96	3.42	4.41
		MF - High Rise - Residential	4.63	4.60	4.17	3.62	3.53
		MF - Mid Rise	5.23	5.29	4.55	3.35	3.82
		Movie Theater	5.71	5.62	5.25	4.00	4.76
		Office - High Rise - CAV no econ	6.34	6.44	5.87	3.93	4.28
		Office - High Rise - CAV econ	6.56	6.69	6.16	4.24	4.67
	Office - High Rise - VAV econ	4.80	4.89	4.03	2.38	2.66	
	Office - High Rise - FCU	3.52	3.46	2.99	1.58	1.67	
	Office - Low Rise	4.48	4.48	3.55	2.18	2.49	
	Office - Mid Rise	4.98	4.98	4.22	2.69	2.98	
	Religious Building	5.03	4.72	4.52	3.31	3.78	
	Restaurant	4.24	4.26	3.82	2.89	3.43	
	Retail - Department Store	4.37	4.01	3.77	2.45	2.80	
	Retail - Strip Mall	4.18	3.87	3.42	2.36	2.55	
	Warehouse	4.57	4.26	4.40	2.75	3.38	
	Unknown	4.88	4.83	4.30	3.09	3.57	
Hot Water Space Heating without outdoor reset – non-recirculation	Assembly	7.10	7.27	6.49	4.33	6.63	
	Assisted Living	6.69	6.53	5.74	4.22	5.08	
	College	6.08	5.68	5.07	2.81	3.37	
	Convenience Store	5.88	5.43	4.82	3.46	3.86	
	Elementary School	7.07	6.90	6.08	4.20	5.10	
	Garage	3.91	3.85	3.38	2.70	2.99	
	Grocery	6.39	6.36	5.58	3.48	4.16	
	Healthcare Clinic	6.27	6.44	5.62	3.83	4.05	
	High School	7.33	7.38	6.62	4.71	5.51	
	Hospital - CAV no econ	7.01	7.22	6.15	5.29	6.00	

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
		Hospital - CAV econ	7.10	7.36	6.28	5.44	6.17
		Hospital - VAV econ	2.91	2.76	2.07	1.24	1.35
		Hospital - FCU	5.26	6.01	4.89	5.75	7.73
		Hotel/Motel	6.99	6.80	6.13	4.20	5.12
		Hotel/Motel - Common	6.36	6.46	6.15	5.00	5.25
		Hotel/Motel - Guest	6.99	6.76	6.04	4.05	4.97
		Manufacturing Facility	4.17	4.03	3.73	2.26	2.52
		MF - High Rise	6.06	5.98	5.45	4.64	4.65
		MF - High Rise - Common	7.21	7.00	6.28	4.33	5.58
		MF - High Rise - Residential	5.86	5.82	5.28	4.57	4.46
		MF - Mid Rise	6.62	6.70	5.76	4.24	4.83
		Movie Theater	7.22	7.11	6.65	5.05	6.02
		Office - High Rise - CAV no econ	8.02	8.15	7.42	4.97	5.42
		Office - High Rise - CAV econ	8.30	8.47	7.78	5.37	5.91
		Office - High Rise - VAV econ	6.07	6.19	5.10	3.01	3.36
		Office - High Rise - FCU	4.44	4.37	3.78	2.01	2.10
		Office - Low Rise	5.68	5.66	4.50	2.75	3.15
		Office - Mid Rise	6.30	6.30	5.34	3.40	3.77
		Religious Building	6.37	5.97	5.72	4.19	4.79
		Restaurant	5.37	5.38	4.83	3.66	4.33
		Retail - Department Store	5.53	5.08	4.77	3.10	3.54
		Retail - Strip Mall	5.29	4.90	4.33	2.98	3.22
		Warehouse	5.78	5.39	5.56	3.47	4.28
		Unknown	6.17	6.11	5.44	3.90	4.52
	Hot Water with outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	15.82	15.58	14.11	12.62	13.03
	Hot Water without outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	20.02	19.71	17.86	15.97	16.49
	Hot Water with outdoor reset	All buildings, Recirculation year round (All hours)	23.16	23.16	23.16	23.16	23.16
	Hot Water without outdoor reset	All buildings, Recirculation year round (All hours)	34.79	34.79	34.79	34.79	34.79
	LP Steam – non-recirculation	Assembly	11.11	11.38	10.16	6.77	10.37
		Assisted Living	10.46	10.23	8.99	6.61	7.94
		College	9.51	8.89	7.93	4.40	5.28
		Convenience Store	9.21	8.50	7.55	5.42	6.05
		Elementary School	11.07	10.79	9.52	6.57	7.98
		Garage	6.12	6.02	5.29	4.23	4.68
		Grocery	10.00	9.96	8.73	5.45	6.50
		Healthcare Clinic	9.81	10.07	8.79	5.99	6.33
		High School	11.47	11.54	10.35	7.38	8.63
		Hospital - CAV no econ	10.97	11.30	9.63	8.28	9.40
		Hospital - CAV econ	11.11	11.52	9.82	8.51	9.66
		Hospital - VAV econ	4.54	4.32	3.25	1.95	2.11
		Hospital - FCU	8.24	9.41	7.66	9.00	12.10
		Hotel/Motel	10.95	10.64	9.60	6.56	8.02
		Hotel/Motel - Common	9.95	10.11	9.62	7.83	8.23

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
		Hotel/Motel - Guest	10.93	10.57	9.46	6.33	7.78
		Manufacturing Facility	6.51	6.30	5.84	3.53	3.94
		MF - High Rise	11.82	11.66	10.63	9.05	9.07
		MF - High Rise - Common	14.05	13.65	12.23	8.43	10.89
		MF - High Rise - Residential	11.42	11.33	10.30	8.92	8.70
		MF - Mid Rise	12.90	13.05	11.23	8.26	9.41
		Movie Theater	11.30	11.14	10.41	7.91	9.42
		Office - High Rise - CAV no econ	12.56	12.74	11.62	7.78	8.47
		Office - High Rise - CAV econ	12.99	13.25	12.19	8.40	9.24
		Office - High Rise - VAV econ	9.49	9.69	7.98	4.71	5.26
		Office - High Rise - FCU	6.96	6.85	5.92	3.15	3.29
		Office - Low Rise	8.88	8.86	7.04	4.31	4.93
		Office - Mid Rise	9.86	9.86	8.35	5.31	5.91
		Religious Building	9.97	9.35	8.95	6.56	7.50
		Restaurant	8.39	8.42	7.56	5.72	6.78
		Retail - Department Store	8.65	7.95	7.46	4.85	5.54
		Retail - Strip Mall	8.28	7.67	6.77	4.67	5.03
		Warehouse	9.05	8.44	8.71	5.44	6.70
		Unknown	9.66	9.57	8.51	6.11	7.08
	LP Steam	All buildings, Recirculation heating season only (Hours below 55F)	31.32	30.85	27.94	25.00	25.80
	LP Steam	All buildings, Recirculation year round (All hours)	54.46	54.46	54.46	54.46	54.46
	HP Steam – non-recirculation	Assembly	17.20	17.62	15.73	10.48	16.06
		Assisted Living	16.20	15.84	13.91	10.23	12.29
		College	14.73	13.76	12.28	6.82	8.17
		Convenience Store	14.25	13.16	11.68	8.38	9.36
		Elementary School	17.14	16.70	14.73	10.18	12.35
		Garage	9.47	9.32	8.20	6.54	7.24
		Grocery	15.47	15.41	13.51	8.43	10.07
		Healthcare Clinic	15.19	15.59	13.61	9.27	9.81
		High School	17.75	17.87	16.03	11.42	13.36
		Hospital - CAV no econ	16.98	17.49	14.90	12.82	14.55
		Hospital - CAV econ	17.21	17.83	15.20	13.17	14.96
		Hospital - VAV econ	7.04	6.68	5.02	3.02	3.27
		Hospital - FCU	12.76	14.56	11.85	13.93	18.73
		Hotel/Motel	16.95	16.48	14.86	10.17	12.41
		Hotel/Motel - Common	15.40	15.65	14.90	12.12	12.74
		Hotel/Motel - Guest	16.92	16.38	14.64	9.80	12.05
		Manufacturing Facility	10.09	9.75	9.04	5.46	6.10
		MF - High Rise	14.69	14.50	13.22	11.25	11.28
		MF - High Rise - Common	17.46	16.96	15.21	10.48	13.53
		MF - High Rise - Residential	14.19	14.08	12.80	11.09	10.81
		MF - Mid Rise	16.04	16.22	13.96	10.26	11.70
		Movie Theater	17.49	17.23	16.12	12.25	14.59
		Office - High Rise - CAV no econ	19.44	19.73	17.98	12.05	13.12
	Office - High Rise - CAV econ	20.10	20.51	18.86	13.00	14.30	

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
		Office - High Rise - VAV econ	14.70	14.99	12.36	7.30	8.14
		Office - High Rise - FCU	10.76	10.60	9.16	4.86	5.10
		Office - Low Rise	13.75	13.71	10.89	6.66	7.63
		Office - Mid Rise	15.25	15.27	12.92	8.23	9.15
		Religious Building	15.43	14.47	13.85	10.15	11.60
		Restaurant	12.99	13.03	11.70	8.85	10.49
		Retail - Department Store	13.39	12.31	11.55	7.52	8.57
		Retail - Strip Mall	12.82	11.87	10.49	7.23	7.79
		Warehouse	14.01	13.06	13.48	8.41	10.37
		Unknown	14.95	14.81	13.17	9.45	10.96
		HP Steam	All buildings, Recirculation heating season only (Hours below 55F)	48.49	47.76	43.25	38.69
HP Steam	All buildings, Recirculation year round (All hours)	84.30	84.30	84.30	84.30	84.30	

For insulation covering elbows and tees that connect straight pipe, a calculated surface area will be assumed based on the dimensions for fittings given by ANSI/ASME B36.19. The surface area is then converted to an equivalent length of pipe that must be added to the total length of straight pipe in order to calculate total savings. Equivalent pipe lengths are given in 1" increments in pipe diameter for simplicity. In the case of pipe diameters in between full inch diameters, the closest equivalent length should be used. The larger pipe sizes mostly apply to steam header piping, which has the most heat loss per foot.

**Calculated Surface Areas of Elbows and Tees**

Nominal Pipe Diameter	Calculated Surface Area (ft)	
	90 Degree Elbow <sup>530</sup>	Straight Tee <sup>531</sup>
1"	0.10	0.13
2"	0.41	0.39
3"	0.93	0.77
4"	1.64	1.21
5"	2.57	1.77
6"	3.70	2.44
8"	6.58	3.95
10"	10.28	5.98
12"	14.80	8.34

**Equivalent Length of Other Components – Elbows and Tees (L<sub>oc</sub>)**

Nominal Pipe Diameter	Equivalent Length of Other Components (ft)	
	90 Degree Elbow	Straight Tee
1"	0.30	0.38
2"	0.66	0.63
3"	1.01	0.84
4"	1.40	1.03

<sup>530</sup> Based on the dimensions for diameter, long radius, and short radius given by ANSI/ASME 36.19.

<sup>531</sup> Based on the center to face and diameter dimensions given by ANSI/ASME B36.19.



Nominal Pipe Diameter	Equivalent Length of Other Components (ft)	
	90 Degree Elbow	Straight Tee
5"	1.76	1.22
6"	2.13	1.41
8"	2.91	1.75
10"	3.65	2.13
12"	4.44	2.50

For insulation around valves or flanges, a surface area from ASTM standard C1129-12 will be assumed for 2" pipes. For 1" pipes, which weren't included in the standard, a linear-trended value will be used. The surface area is then converted to an equivalent length of either 1" or 2" straight pipe that must be added to the total length of straight pipe in order to calculate total savings.

**Calculated Surface Areas of Flanges and Valves**

Valves				
Class (psi)	150	300	600	900
NPS (in)	ft <sup>2</sup>	ft <sup>2</sup>	ft <sup>2</sup>	ft <sup>2</sup>
1	0.69	1.8	1.8	2.4
2	2.21	2.94	2.94	5.2
2.5	2.97	3.51	3.91	6.6
3	3.37	4.39	4.69	6.5
4	4.68	6.06	7.64	9.37
6	7.03	9.71	13.03	15.8
8	10.3	13.5	18.4	23.8
10	13.8	18	26.5	32.1
12	16.1	24.1	31.9	41.9

Flanges				
Class (psi)	150	300	600	900
NPS (in)	ft <sup>2</sup>	ft <sup>2</sup>	ft <sup>2</sup>	ft <sup>2</sup>
1	0.36	0.36	0.4	1.23
2	0.71	0.84	0.88	1.54
3	1.06	1.32	1.36	1.85
4	1.44	1.83	2.23	2.64
6	2.04	2.72	3.6	4.37
8	2.92	3.74	4.89	6.4
10	3.68	4.8	6.93	8.47
12	5.01	6.34	7.97	10.43

**Equivalent Length of Other Components - Flanges and Valves (L<sub>oc</sub>)**

ANSI Class (psi)	Equivalent Length of Other Components (ft)			
	1" Valve	1" Flange	2" Valve	2" Flange
150	2.00	1.04	3.56	1.14
300	5.22	1.04	4.73	1.35
600	5.22	1.16	4.73	1.42
900	6.96	3.57	8.37	2.48
ANSI Class (psi)	3" Valve	3" Flange	4" Valve	4" Flange
150	3.67	1.16	3.98	1.22
300	4.79	1.44	5.15	1.56
600	5.11	1.48	6.49	1.90
900	7.09	2.02	7.96	2.24

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-PINS-V06-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4.15 Single-Package and Split System Unitary Air Conditioners

### DESCRIPTION

This measure promotes the installation of high-efficiency unitary air-, water-, and evaporatively-cooled air conditioning equipment, both single-package and split systems. Air conditioning (AC) systems are a major consumer of electricity and systems that exceed baseline efficiency requirements can significantly reduce energy consumption. This measure could apply to the replacing of an existing unit at the end of its useful life or the installation of a new unit in a new or existing building.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a high-efficiency air-, water-, or evaporatively-cooled air conditioner that exceeds the energy efficiency requirements as prescribed by the program.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a standard-efficiency air-, water-, or evaporatively-cooled air conditioner that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date is unknown, assume current Code minimum).

For Early Replacement programs, use the actual efficiency of the existing unit or assume IECC code base in place at the original time of existing unit installation. To qualify under the early replacement characterization, baseline equipment must meet these additional qualifications:

- The existing unit is operational when replaced or the existing unit would be operational with minor repairs.<sup>532</sup>

Note: IECC 2018 is scheduled to become effective July 1, 2019 and will become baseline for all New Construction permits from that date.

Note: new Federal Standards become effective January 1, 2023.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.<sup>533</sup>

For early replacement, the remaining life of existing equipment is assumed to be 5 years.<sup>534</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is based upon capacity and efficiency level (defined by CEE specifications),<sup>535</sup> as outlined in the following table:<sup>536</sup>

---

<sup>532</sup> Based on ComEd Small Business Trade Ally feedback. For units rated at less than 20 ton units, the cost of common repairs is under \$2,000, significantly less than the cost of purchasing new equipment. Therefore, if the cost of repair is less than \$2,000, it can be considered early replacement because customers would repair instead of replace a failed unit. Repair cost data was not available for units larger than 20 tons.

<sup>533</sup> Measure Life Report: Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, Inc., June 2007.

<sup>534</sup> Assumed to be one third of effective useful life.

<sup>535</sup> CEE Commercial Unitary Air-conditioning and Heat Pumps Specification, which provides high efficiency performance specifications for single-package and split system unitary air conditioners.

<sup>536</sup> NEEP Incremental Cost Study (ICS) Final Report – Phase 3, May 2014.

Capacity	Incremental cost (\$/ton)	
	Up to and including CEE Tier 1 units	CEE Tier 2 and above
< 135,000 Btu/hr	\$63	\$127
135,000 Btu/hr to > 250,000 Btu/hr	\$63	\$127
250,000 Btu/hr and greater	\$19	\$38

For early replacement the full cost of the installed unit should be used. If unknown use defaults below. The assumed deferred cost (after 5 years) of replacing existing equipment with a new baseline unit is also provided. This future cost should be discounted to present value using the real discount rate:

Capacity	Full Install Cost (\$/ton)		
	Base Units	Up to and including CEE Tier 1 units	CEE Tier 2 and above
< 135,000 Btu/hr	\$895	\$958	\$1,021
135,000 Btu/hr to > 250,000 Btu/hr	\$762	\$825	\$889
250,000 Btu/hr and greater	\$673	\$691	\$710

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM’s capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)} \\ = 91.3\%^{537}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)} \\ = 47.8\%^{538}$$

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Time of Sale:

For units with cooling capacities less than 65 kBtu/hr:

$$\Delta kWh = (kBtu/hr) * [(1/SEER_{base}) - (1/SEER_{ee})] * EFLH$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

---

<sup>537</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>538</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

$$\Delta kWH = (kBtu/hr) * [(1/IEERbase) - (1/IEERee)] * EFLH$$

Early replacement:<sup>539</sup>

For units with cooling capacities less than 65 kBtu/hr:

For remaining life of existing unit (1st 5 years):

$$\Delta kWH = (kBtu/hr) * [(1/SEERexist) - (1/SEERee)] * EFLH$$

For remaining measure life (next 10 years):

$$\Delta kWH = (kBtu/hr) * [(1/SEERbase) - (1/SEERee)] * EFLH$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

For remaining life of existing unit (1st 5 years):

$$\Delta kWH = (kBtu/hr) * [(1/IEERexist) - (1/IEERee)] * EFLH$$

NOTE: If the existing equipment age is such that IEER ratings are not available, EER may be substituted when necessary. In such instances both existing and efficient unit efficiencies should be specified in EER.

For remaining measure life (next 10 years):

$$\Delta kWH = (kBtu/hr) * [(1/IEERbase) - (1/IEERee)] * EFLH$$

Where:

kBtu/hr	= capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)
SEERbase	= Seasonal Energy Efficiency Ratio of the baseline equipment = SEER values from tables below, based on applicable Code on date of equipment purchase (if unknown assume current Code).
SEERee	= Seasonal Energy Efficiency Ratio of the energy efficient equipment (actually installed)
SEERexist	= Seasonal Energy Efficiency Ratio of the existing equipment = Actual, or assume Code base in place at the original time of existing unit installation
IEERbase	= Integrated Energy Efficiency Ratio of the baseline equipment. See table below based on applicable Code on date of equipment purchase (if unknown assume current Code).
IEERee	= Integrated Energy Efficiency Ratio of the energy efficient equipment (actually installed)
IEERexist	= Integrated Energy Efficiency Ratio of the existing equipment = Actual, or assume Code base in place at the original time of existing unit installation
EFLH	= Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

The rating conditions for the baseline and efficient equipment efficiencies must be equivalent.

<sup>539</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

**Code of Federal Redulations (baseline effective 1/1/2019):**

Equipment type	Cooling capacity	Heating type	Efficiency level	Compliance date
Small Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥65,000 Btu/h and <135,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 12.9	1/1/2018
		All Other Types of Heating	IEER = 12.7	1/1/2018
Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥135,000 Btu/h and <240,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 12.4	1/1/2018
		All Other Types of Heating	IEER = 12.2	1/1/2018
Very Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥240,000 Btu/h and <760,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 11.6	1/1/2018
		All Other Types of Heating	IEER = 11.4	1/1/2018
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Split-System)	<65,000 Btu/h	All	SEER = 13.0	6/16/2008
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Single-Package)	<65,000Btu/h	All	SEER = 14.0	1/1/2017

2012 IECC Minimum Efficiency Requirements (baseline effective 1/1/2013 to 12/31/2015)

**TABLE C403.2.3(1)**  
**MINIMUM EFFICIENCY REQUIREMENTS:**  
**ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE <sup>a</sup>		
				Before 6/1/2011	As of 6/1/2011			
Air conditioners, air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER	13.0 SEER	AHRI 210/240		
			Single Package	13.0 SEER	13.0 SEER			
Through-the-wall (air cooled)	≤ 30,000 Btu/h <sup>b</sup>	All	Split system	12.0 SEER	12.0 SEER			
			Single Package	12.0 SEER	12.0 SEER			
Small-duct high-velocity (air cooled)	< 65,000 Btu/h <sup>b</sup>	All	Split System	10.0 SEER	10.0 SEER			
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 11.4 IEER	11.2 EER 11.4 IEER		AHRI 340/360	
		All other	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 11.2 IEER			
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 11.2 IEER			
		All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 11.0 IEER			
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 10.1 IEER	10.0 EER 10.1 IEER			
		All other	Split System and Single Package	9.8 EER 9.9 IEER	9.8 EER 9.9 IEER			
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 9.8 IEER	9.7 EER 9.8 IEER			
		All other	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 9.6 IEER			
	Air conditioners, water cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package	12.1 EER 12.3 IEER	12.1 EER 12.3 IEER		AHRI 210/240
		≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.5 EER 11.7 IEER	12.1 EER 12.3 IEER		AHRI 340/360
All other			Split System and Single Package	11.3 EER 11.5 IEER	11.9 EER 12.1 IEER			
≥ 135,000 Btu/h and < 240,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	12.5 EER 12.7 IEER			
		All other	Split System and Single Package	10.8 EER 11.0 IEER	12.3 EER 12.5 IEER			
≥ 240,000 Btu/h and < 760,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.1 IEER	12.4 EER 12.6 IEER			
		All other	Split System and Single Package	10.8 EER 10.9 IEER	12.2 EER 12.4 IEER			
≥ 760,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.1 IEER	12.0 EER 12.4 IEER			
		All other	Split System and Single Package	10.8 EER 10.9 IEER	12.0 EER 12.2 IEER			

(continued)

**TABLE C403.2.3(1)—continued**  
**MINIMUM EFFICIENCY REQUIREMENTS:**  
**ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUB-CATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE <sup>a</sup>		
				Before 6/1/2011	As of 6/1/2011			
Air conditioners, evaporatively cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package	12.1 EER 12.3 IEER	12.1 EER 12.3 IEER	AHRI 210/240		
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.5 EER 11.7 IEER	12.1 EER 12.3 IEER	AHRI 340/360		
		All other	Split System and Single Package	11.3 EER 11.5 IEER	11.9 EER 12.1 IEER			
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	12.0 EER 12.2 IEER			
		All other	Split System and Single Package	10.8 EER 11.0 IEER	11.8 EER 12.0 IEER			
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.1 IEER	11.9 EER 12.1 IEER			
		All other	Split System and Single Package	10.8 EER 10.9 IEER	12.2 EER 11.9 IEER			
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 11.1 IEER	11.7 EER 11.9 IEER			
		All other	Split System and Single Package	10.8 EER 10.9 IEER	11.5 EER 11.7 IEER			
	Condensing units, air cooled	≥ 135,000 Btu/h			10.1 EER 11.4 IEER		10.5 EER 14.0 IEER	AHRI 365
	Condensing units, water cooled	≥ 135,000 Btu/h			13.1 EER 13.6 IEER		13.5 EER 14.0 IEER	
	Condensing units, evaporatively cooled	≥ 135,000 Btu/h			13.1 EER 13.6 IEER		13.5 EER 14.0 IEER	

For SI: 1 British thermal unit per hour = 0.2931 W.

- a. Chapter 6 of the referenced standard contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.



2015 IECC Minimum Efficiency Requirements (baseline effective 1/1/2016 to 3/30/2019)

TABLE C403.2.3(1)  
MINIMUM EFFICIENCY REQUIREMENTS:  
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE <sup>a</sup>		
				Before 1/1/2016	As of 1/1/2016			
Air conditioners, air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER	13.0 SEER	AHRI 210/240		
			Single Package	13.0 SEER	14.0 SEER <sup>c</sup>			
Through-the-wall (air cooled)	≤ 30,000 Btu/h <sup>b</sup>	All	Split system	12.0 SEER	12.0 SEER			
			Single Package	12.0 SEER	12.0 SEER			
Small-duct high-velocity (air cooled)	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER	11.0 SEER			
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 11.4 IEER	11.2 EER 12.8 IEER		AHRI 340/360	
		All other	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.6 IEER			
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.4 IEER			
		All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 12.2 IEER			
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 10.1 IEER	10.0 EER 11.6 IEER			
		All other	Split System and Single Package	9.8 EER 9.9 IEER	9.8 EER 11.4 IEER			
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 9.8 IEER	9.7 EER 11.2 IEER			
		All other	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 11.0 IEER			
	Air conditioners, water cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package	12.1 EER 12.3 IEER	12.1 EER 12.3 IEER		AHRI 210/240
				≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package		12.1 EER 12.3 IEER
		All other	Split System and Single Package		11.9 EER 12.1 IEER	11.9 EER 13.7 IEER		
		≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.5 EER 12.5 IEER	12.5 EER 13.9 IEER		
All other			Split System and Single Package	12.3 EER 12.5 IEER	12.3 EER 13.7 IEER			
≥ 240,000 Btu/h and < 760,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	12.4 EER 12.6 IEER	12.4 EER 13.6 IEER			
		All other	Split System and Single Package	12.2 EER 12.4 IEER	12.2 EER 13.4 IEER			
≥ 760,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	12.2 EER 12.4 IEER	12.2 EER 13.5 IEER			
		All other	Split System and Single Package	12.0 EER 12.2 IEER	12.0 EER 13.3 IEER			

(continued)

2018 IECC Minimum Efficiency Requirements (baseline effective 7/1/2019 for New Construction measures)

TABLE C403.3.2(1)  
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE <sup>a</sup>		
Air conditioners, air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER	AHRI 210/240		
			Single Package	14.0 SEER			
Through-the-wall (air cooled)	≤ 30,000 Btu/h <sup>b</sup>	All	Split system	12.0 SEER			
			Single Package	12.0 SEER			
Small-duct high-velocity (air cooled)	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER			
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 12.8 IEER	AHRI 340/360		
		All other	Split System and Single Package	11.0 EER 12.6 IEER			
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.4 IEER			
		All other	Split System and Single Package	10.8 EER 12.2 IEER			
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 11.6 IEER			
		All other	Split System and Single Package	9.8 EER 11.4 IEER			
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 11.2 IEER			
		All other	Split System and Single Package	9.5 EER 11.0 IEER			
	Air conditioners, water cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package		12.1 EER 12.3 IEER	AHRI 210/240
≥ 65,000 Btu/h and < 135,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	12.1 EER 13.9 IEER	AHRI 340/360		
		All other	Split System and Single Package	11.9 EER 13.7 IEER			
≥ 135,000 Btu/h and < 240,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	12.5 EER 13.9 IEER			
		All other	Split System and Single Package	12.3 EER 13.7 IEER			
≥ 240,000 Btu/h and < 760,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	12.4 EER 13.6 IEER			
		All other	Split System and Single Package	12.2 EER 13.4 IEER			
≥ 760,000 Btu/h		Electric Resistance (or None)	Split System and Single Package	12.2 EER 13.5 IEER			
		All other	Split System and Single Package	12.0 EER 13.3 IEER			

Air conditioners, evaporatively cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.0 EER 12.2 IEER	
		All other	Split System and Single Package	11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.9 EER 12.1 IEER	
		All other	Split System and Single Package	11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.7 EER 11.9 IEER	
All other		Split System and Single Package	11.5 EER 11.7 IEER		
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	

For SI: 1 British thermal unit per hour = 0.2931 W.

- a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

**For example**, a 5 ton air cooled split system with a SEER of 15 at a retail strip mall in Rockford would save:

$$\begin{aligned} \Delta \text{kWh} &= (60) * [(1/13) - (1/15)] * 950 \\ &= 585 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Time of Sale:

$$\Delta \text{kW} = (\text{kBtu/hr} * (1/\text{EERbase} - 1/\text{EERee})) * \text{CF}$$

Early Replacement:

For remaining life of existing unit (1st 5 years):

$$\Delta \text{kW} = (\text{kBtu/hr}) * [(1/\text{EERexist}) - (1/\text{EERee})] * \text{CF}$$

For remaining measure life (next 10 years):

$$\Delta \text{kW} = (\text{kBtu/hr}) * [(1/\text{EERbase}) - (1/\text{EERee})] * \text{CF}$$

Where:

- EERbase = Energy Efficiency Ratio of the baseline equipment  
= EER values from tables above, based on applicable Code on date of equipment purchase (if unknown assume current Code). (For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER to EER for calculation of peak savings:<sup>540</sup> EER = (-0.02 \* SEER<sup>2</sup>) + (1.12 \* SEER))
- EERee = Energy Efficiency Ratio of the energy efficient equipment. If the actual EERee is unknown, assume the conversion from SEER to EER for calculation of peak savings as above).  
= Actual installed
- EERexist = Energy Efficiency Ratio of the existing equipment  
= Actual, or assume Code base in place at the original time of existing unit installation
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 91.3%<sup>541</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 47.8%<sup>542</sup>

**For example**, a 5 ton air cooled split system with a SEER of 15 in Rockford would save:

$$\begin{aligned} \Delta \text{kW}_{\text{SSP}} &= (60) * [(1/11.2) - (1/12.3)] * .913 \\ &= 0.437 \text{ kW} \end{aligned}$$

<sup>540</sup> Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

<sup>541</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>542</sup>Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**MEASURE CODE: CI-HVC-SPUA-V07-200101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.16 Steam Trap Replacement or Repair

### DESCRIPTION

The measure applies to the repair or replacement of steam traps in the failed open state that allow steam to escape the steam distribution system or return to the condensate receiver leading to increased steam generation. The measure is applicable to commercial applications, commercial HVAC (low pressure steam) including multifamily buildings, low pressure industrial applications, medium pressure industrial applications, applications and high-pressure industrial applications.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Customers must have steam traps in the failed open or leaking state to qualify for rebates. However, if a commercial customer opts to replace all traps without inspection, rebates and the savings are discounted to take into consideration the fact that some traps are being replaced that have not yet failed.

### DEFINITION OF BASELINE EQUIPMENT

The baseline criterion is a faulty steam trap in the failed open or leaking state. No minimum leak rate is required. Any leaking or blow through trap can be repaired or replaced. If a commercial customer chooses to repair or replace all the steam traps at the facility without verification, the savings are adjusted. Savings for commercial full replacement projects are reduced by the percentage of traps found to be leaking on average from the studies listed. If an audit is performed on a commercial site, then the leaking and blowdown can be adjusted.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

For standard steam traps the life of this measure is 6 years.<sup>543</sup>

For Venturi steam traps the measure life is 20 years if replacing a faulty mechanical steam trap.<sup>544</sup> If replacing an operational mechanical steam trap, the measure life is 14 years, having been reduced by the six-year measure life established for the Steam Trap Replacement or Repair measure from the IL TRM. By applying this conservative approach of reducing the measure life by the full estimated useful life of the existing steam trap, there is no need to survey or produce an inventory of the age of existing steam traps.

Venturi steam traps do not contain any moving parts, and their manufacturers cite this feature for the reduced failure rate leading to longer operational life than mechanical steam traps. Venturi steam traps have been observed to operate in excess of 20 years.<sup>545</sup> Venturi steam traps also typically come with a 10-year warranty that can be extended up to 20 years. Therefore, savings may be claimed on a year-to-year basis for venturi steam traps undergoing annual maintenance that have exhausted their deemed 20-year measure life.

---

<sup>543</sup>Source paper is the CLEARResult "Steam Traps Revision #1" dated August 2011. Primary studies used to prepare the source paper include Enbridge Steam Trap Survey, KW Engineering Steam Trap Survey, Enbridge Steam Saver Program 2005, Armstrong Steam Trap Survey, DOE Federal Energy Management Program Steam Trap Performance Assessment, Oak Ridge National Laboratory Steam System Survey Guide, KEMA Evaluation of PG&E's Steam Trap Program, Sept. 2007. Communication with vendors suggested an inverted bucket steam trap life typically in the range of 5 - 7 years, float and thermostatic traps 4- 6 years, float and thermodynamic disc traps of 1 - 3 years. Cost does not include installation.

<sup>544</sup>"Venturi Steam Trap – Functional Laboratory Study, GTI on behalf of Illinois utilities, Nicor Gas, Peoples Gas, and North Shore Gas, and on behalf of contributing utilities from other states, March 26, 2019. This report reflects phase 1 of an ongoing field study that will continue data collection to validate useful life and provide information on proper sizing in various end use applications. Additional data expected in 2021.

<sup>545</sup>Ibid. Based on reported age for venturi steam traps currently operating in the field.

**DEEMED MEASURE COST**

Steam System	Cost per trap <sup>546</sup> (\$)
Commercial Dry Cleaners	77
Commercial Heating (including Multifamily), low pressure steam	77
Industrial Medium Pressure >15 psig, < 30 psig	180
Steam Trap, Industrial Medium Pressure ≥30 <75 psig	223
Steam Trap, Industrial High Pressure ≥75 <125 psig	276
Steam Trap, Industrial High Pressure ≥125 <175 psig	322
Steam Trap, Industrial High Pressure ≥175 <250 psig	370
Steam Trap, Industrial High Pressure ≥250 psig	418

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings. These savings only apply to situations in which steam is lost from the steam system.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water \text{ supply}}$$

Where

$$E_{water \text{ supply}} = \text{Water Supply Energy Factor (kWh/Million Gallons)}$$

$$= 2,571^{547}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta Therm = Sa * (Hv + Hs * (T_1 - T_{source})) * \text{Hours} * L / (100,000 * \eta_B)$$

Where:

---

<sup>546</sup> Ibid.

<sup>547</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'. Note since the water loss associated with this measure is due to evaporation and does not discharge into the wastewater system, only the water supply factor is used here.

Sa = Steam loss per leaking trap (lbs/hr)

For systems used in space heating applications that operate at 5 psig or lower, use the following equation to calculate Sa<sup>548</sup>. The condensate return system pressure, P<sub>2</sub>, will typically be atmospheric pressure, 14.696 psia.

$$Sa = 1519.3 * P_1 * D * [(1/T_1) * (\gamma/(\gamma-1)) * ((P_2/P_1)^{(2/\gamma)} - (P_2/P_1)^{((\gamma+1)/\gamma)})]^{0.5} * A * FF$$

For all other steam systems and applications, use the following equation.

$$Sa = 24.24 * P_1 * D^2 * A * FF$$

Defaults are provided in table below if custom calculation is not performed.

Where:

1519.3 = Constant, (s<sup>2</sup> \* °R<sup>0.5</sup>)/(ft \* hr)

P<sub>1</sub> = Average steam trap inlet pressure (absolute, psia). If not available, use defaults provided in table below (note that defaults are provided in psig, not psia).

D = Diameter of orifice, inches. Actual value should be used wherever possible as this value has a significant impact on steam flowrate value.

T<sub>1</sub> = Temperature of Saturated Steam (°R)

$$= 507.89 * P_1^{0.0962}$$

Where:

$$507.89 = \text{Constant, } ^\circ\text{R} * (\text{in}^2/\text{lb}_f)^{0.0962}$$

γ = Heat Capacity Ratio (unitless)

$$= 5.071 * 10^{-4} * P_1 + 1.332$$

P<sub>2</sub> = Average steam trap outlet pressure (absolute psia). If unknown, assume atmospheric pressure, 14.696 psia.

A = Adjustment factor

= 50%,<sup>549</sup> all steam systems. This factor accounts for reduction in the maximum theoretical steam flow to the average steam flow (the Enbridge factor).

FF = Flow Factor. In addition to the Adjustment factor (A), an additional 50 percent flow factor adjustment is recommended for medium and high-pressure steam systems to address industrial float and thermostatic style traps where additional blockage is possible.

24.24 = Constant lbm/(hr-psia-in<sup>2</sup>)

<sup>548</sup> See "Derivation of Equation for Subsonic Compressible Flow through an Orifice and Supporting Calculations for Illinois TRM Steam Trap Measure" paper for more information.

<sup>549</sup>Enbridge adjustment factor used as referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012 and DOE Federal Energy Management Program Steam Trap Performance Assessment.



Default Steam Loss per Trap (Sa) are provided below for different system types:

Steam System	Average Steam Trap Inlet Pressure psig <sup>550</sup>	Diameter of Orifice in	Adjustment Factor	Flow Factor	Average Actual Steam Loss per Leaking Trap (lbm/hr/trap) <sup>551</sup>
Commercial Dry Cleaners	82.8	0.125	50%	100%	18.5
Multifamily LPS Space Heating - calculate Sa as provided above. If using default value, cap total savings at 20% of building consumption	-	-	50%	100%	6.9
Commercial LPS Space Heating	-	-	50%	100%	6.9
Industrial or Process Low Pressure, <15 psig	-	-	50%	100%	6.9
Medium Pressure >15 psig < 30 psig	16	0.1875	50%	50%	6.5
Medium Pressure ≥30 <75 psig	47	0.2500	50%	50%	23.4
High Pressure ≥75 <125 psig	101	0.2500	50%	50%	43.8
High Pressure ≥125 <175 psig	146	0.2500	50%	50%	60.9
High Pressure ≥175 <250 psig	202	0.2500	50%	50%	82.1
High Pressure ≥250 ≤300 psig	263	0.2500	50%	50%	105.2
High Pressure > 300 psig	Custom	Custom	50%	50%	Calculated

Hv = Heat of vaporization of steam, (Btu/lbm)

Steam System	Average Inlet Pressure psig	Heat of Vaporization <sup>552</sup> (Btu/lbm)
Commercial Dry Cleaners	--	890
Commercial Space Heating (including Multifamily) LPS	--	951
Industrial and Process Low Pressure ≤15 psig	--	951
Medium Pressure >15 psig < 30 psig	16	944
Medium Pressure ≥30 <75 psig	47	915
High Pressure ≥75 <125 psig	101	880
High Pressure ≥125 <175 psig	146	859
High Pressure ≥175 <250 psig	202	837
High Pressure ≥250 ≤300 psig	263	816
High Pressure > 300 psig	--	Custom

Hs = Specific heat of water, (Btu/(lbm \* °R))

<sup>550</sup> Medium and high pressure steam trap inlet pressure based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours. Dry cleaning steam trap inlet pressure based on C5 Steam Traps – Nicor FINAL 10.27.11.

<sup>551</sup> For applications where inlet pressures and orifice diameters are provided in the table, default values are directly calculated using the equation above. For applications where inlet pressures and orifice diameters are not provided in the table, default values are assumptions based on engineering judgement and will be revisited in future years.

<sup>552</sup> Heat of vaporization of steam at the inlet pressure to the steam trap. Implicit assumption that the average boiler nominal pressure where the vaporization occurs, is essentially that same pressure. Referenced in CLEARResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012.

= 1.001

$T_{source}$  = Incoming water temperature  
 = 513.67°R<sup>553</sup>

$\eta_B$  = Boiler efficiency

= custom, if unknown:

= 80.7% for steam boilers, except multifamily low-pressure <sup>554</sup>

= 64.8% for multifamily low-pressure steam boilers <sup>555</sup>

Hours = Annual hours when steam system is pressurized

= custom, if unknown:

Steam System	Zone (where applicable)	Hours/Yr <sup>556</sup>
Commercial Dry Cleaners	All Climate Zones	2,425
Industrial and Process Low Pressure ≤15 psig		8,282
Medium Pressure >15 psig < 30 psig		8,282
Medium Pressure ≥30 <75 psig		8,282
High Pressure ≥75 <125 psig		8,282
High Pressure ≥125 <175 psig		8,282
High Pressure ≥175 <250 psig		8,282
High Pressure ≥250 psig		8,282
Commercial Space Heating LPS	Rockford	4,272
	Chicago	4,029
	Springfield	3,406
	Belleville	2,515
	Marion	2,546
Multifamily Space Heating LPS	For steam traps that are part of steam systems where the boiler cycles on/off to maintain space setpoint temperature or for steam traps located downstream of a steam control valve that opens/closes to maintain setpoint temperature, use Heating EFLH values in Section 4.4 for High Rise or Mid-Rise MF buildings.  For steam traps that are exposed to steam continuously throughout the heating season, use the values listed above for Commercial Space Heating LPS for your appropriate climate zone.	

L = Leaking & blow-thru

L is 1.0 when applied to the replacment of an individual leaking trap. If a number of steam traps are replaced and the system has not been audited, the leaking and blow-thru is applied to reflect the assumed

<sup>553</sup> US DOE Building America Program. Building America Analysis Spreadsheet. For Chicago, IL.

<sup>554</sup> Ibid.

<sup>555</sup> Katrakis, J. and T.S. Zawacki. "Field-Measured Seasonal Efficiency of Intermediate-sized Low-Pressure Steam Boilers". ASHRAE V99, pt. 2, 1993.

<sup>556</sup> Medium and high-pressure steam trap annual operating hours based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours.

percentage of steam traps that were actually leaking and need to be replaced. A custom value can be utilized if supported by an evaluation.

Steam System	L (%) <sup>557</sup>
Custom	Custom
Commercial Dry Cleaners	27%
Commercial Heating (including Multifamily) LPS	27%
Industrial and Process Low Pressure ≤15 psig	16%
Medium Pressure >15 psig < 30 psig	16%
Medium Pressure ≥30 <75 psig	16%
High Pressure ≥75 <125 psig	16%
High Pressure ≥125 <175 psig	16%
High Pressure ≥175 <250 psig	16%
High Pressure > 300 psig	16%

**For example**, a commercial dry cleaning facility with the default hours of operation and boiler efficiency;

$$\Delta\text{Therms} = Sa * (Hv + Hs * (T_1 - T_{\text{source}})) * \text{Hours} * L / (100,000 * \eta_b)$$

$$\begin{aligned} T_1 &= 507.89 * p_1^{0.0962} \\ &= 507.89 * (82.8 + 14.696)^{0.0962} \\ &= 789.1^\circ\text{R} \end{aligned}$$

$$\begin{aligned} \Delta\text{Therms} &= 18.5 \text{ lbs/hr/trap} * (890 \text{ Btu/lb} + 1.001 * (789.1^\circ\text{R} - 513.7^\circ\text{R})) * 2,425\text{hrs} * \\ &27\% / (100,000 * 80.7\%) \\ &= 175.0 \text{ therms per trap} \end{aligned}$$

### WATER IMPACT DESCRIPTIONS AND CALCULATION

The hourly water volume saved per each repaired or replaced leaking trap is calculated by dividing the “Average Actual Steam Loss per Leaking Trap (lbm/hr/trap)” by the density of water saved, 8.33 lbm/gal, that replaces the lost steam. The average actual steam loss is provided in the table for parameter *Sa*, the “Average actual steam loss per leaking trap” in the Natural Gas savings section above. Annual water savings are calculated using *Hours* and *L*, the leaking and blow through factor, as defined above.

Water savings only apply to situations where condensate is lost from the steam system. If a condensate recovery system is in place, assume zero water savings or provide a custom calculation based on site-specific operation.

The annual water savings for a replaced or repaired trap is given by:

$$\Delta\text{Water} = \text{GAL} * \text{Hours} * L$$

Where:

**GAL** = average actual water volume saved per leaking trap, as listed in the following table and based on steam system type.

*Other variables as defined above.*

<sup>557</sup>Dry cleaners survey data as referenced in CLEAResult “Work Paper Steam Traps Revision #2” Revision 3 dated March 2, 2012.

Steam System*	Average Actual Steam Loss per Leaking Trap (lbm/hr/trap)	GAL: Average Actual Water Volume Saved per Leaking Trap Atmospheric Venting (gal/hr/trap)
Commercial Dry Cleaners	19.1	2.29
Commercial Heating (including Multifamily) LPS	6.9	0.83
Industrial or Process Low Pressure, <15 psig	6.9	0.83
Medium Pressure >15 psig < 30 psig	6.5	0.78
Medium Pressure ≥30 <75 psig	23.4	2.81
High Pressure ≥75 <125 psig	43.8	5.26
High Pressure ≥125 <175 psig	60.9	7.31
High Pressure ≥175 <250 psig	82.1	9.86
High Pressure ≥250 ≤300 psig	105.2	12.63
High Pressure > 300 psig	Calculated	Calculated Steam Loss / 8.33

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-STRE-V07-210101**

**REVIEW DEADLINE: 1/1/2023**

## 4.4.17 Variable Speed Drives for HVAC Pumps and Cooling Tower Fans

### DESCRIPTION

This measure is applied to variable speed drives (VSD) which are installed on the following HVAC system applications: chilled water pump, hot water pumps and cooling tower fans. There is a separate measure for HVAC supply and return fans. All other VSD applications require custom analysis by the program administrator. The VSD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

This measure is not applicable for:

- Cooling towers, chilled or hot water pumps with any process load.
- VSD installation in existing cooling towers with 2-speed motors. (current code requires 2-speed motors for cooling towers with motors greater than 7.5 HP)
- VSD installation in new cooling towers with motors greater than 7.5 HP

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The VSD is applied to a motor which does not have a VSD. This measure is not applicable for replacing failed VSDs. The application must have a variable load and installation is to include the necessary controls. Savings are based on application of VSDs to a range of baseline load conditions including no control, inlet guide vanes, outlet guide vanes and throttling valves.

### DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VSD or other methods of control. Retrofit baseline is an existing motor operating as is. Retrofit baselines may or may not include guide vanes, throttling valves or other methods of control. This information shall be collected from the customer.

Installations of new equipment with VSDs which are required by IECC 2012 or 2015 as adopted by the State of Illinois are not eligible for incentives.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date..

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for HVAC application is 15 years;<sup>558</sup> measure life for process is 15 years.<sup>559</sup>

### DEEMED MEASURE COST

Customer provided costs will be used when available. Default measure costs<sup>560</sup> are noted below for up to 20 hp motors. Custom costs must be gathered from the customer for motor sizes not listed below.

HP	Cost
1 -5 HP	\$ 1,330
7.5 HP	\$ 1,622
10 HP	\$ 1,898
15 HP	\$ 2,518
20 HP	\$ 3,059

---

<sup>558</sup> Efficiency Vermont TRM 10/26/11 for HVAC VSD motors.

<sup>559</sup> DEER 2008.

<sup>560</sup> Ohio TRM 8/6/2010 varies by motor/fan size based on equipment costs from Granger 2008 Catalog pp 286-289, average across available voltages and models. Labor costs from RS Means Data 2008. Ohio average cost adjustment applied.

**LOADSHAPE**

- Loadshape C42 - VFD - Boiler feedwater pumps <10 HP
- Loadshape C43 - VFD - Chilled water pumps <10 HP
- Loadshape C44 - VFD Boiler circulation pumps <10 HP
- Loadshape C48 - VFD Boiler draft fans <10 HP
- Loadshape C49 - VFD Cooling Tower Fans <10 HP

**COINCIDENCE FACTOR**

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = BHP / EFFi * Hours * ESF$$

Where:

BHP = System Brake Horsepower

(Nominal motor HP \* Motor load factor)

Motors are assumed to have a load factor of 65% for calculating kW if actual values cannot be determined<sup>561</sup>. Custom load factor may be applied if known.

EFFi = Motor efficiency, installed. Actual motor efficiency shall be used to calculate kW. If not known a default value of 93% shall be used.<sup>562</sup>

Hours = Default hours are provided for HVAC applications which vary by HVAC application and building type<sup>563</sup>. When available (provided via Energy Management Software or metered), actual hours should be used.

Building Type	Heating Run Hours	Cooling Run Hours	Model Source
Assembly	4888	2150	eQuest
Assisted Living	4711	4373	eQuest
Auto Dealership	5270	1605	OpenStudio
College	7005	4065	OpenStudio
Convenience Store	4136	2084	eQuest
Drug Store	4940	1708	OpenStudio
Elementary School	6028	2649	OpenStudio
Emergency Services	3936	3277	OpenStudio
Garage	4849	2102	eQuest

<sup>561</sup> Del Balso, Ryan J. "Investigation into the Reliability of Energy Efficiency/Demand Side Management Savings Estimates for Variable Frequency Drives in Commercial Applications", University of Colorado, Department of Civil, Environmental and Architectural Engineering, 2013.

<sup>562</sup> Ohio TRM 8/6/2010 pp207-209, Com Ed TRM June 1, 2010.

<sup>563</sup> Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the heating or cooling system is operating for each building type. "Heating and Cooling Run Hours" are estimated as the total number of hours fans are operating for heating, cooling and ventilation for each building type. This may overclaim certain applications (e.g. pumps) and so where possible actual hours should be used for these applications.

Building Type	Heating Run Hours	Cooling Run Hours	Model Source
Grocery	7452	5470	OpenStudio
Healthcare Clinic	8760	6364	OpenStudio
High School	5480	3141	eQuest
Hospital - VAV econ	8107	8707	OpenStudio
Hospital - CAV econ	3045	2336	OpenStudio
Hospital - CAV no econ	2927	4948	OpenStudio
Hospital - FCU	4371	8760	OpenStudio
Manufacturing Facility	3821	2805	eQuest
MF - High Rise	5168	6823	OpenStudio
MF - Mid Rise	6011	4996	OpenStudio
Hotel/Motel - Guest	5632	4155	OpenStudio
Hotel/Motel - Common	6340	6227	OpenStudio
Movie Theater	5063	2120	eQuest
Office - High Rise - VAV econ	5646	3414	OpenStudio
Office - High Rise - CAV econ	5361	4849	eQuest
Office - High Rise - CAV no econ	4202	6049	OpenStudio
Office - High Rise - FCU	4600	5341	OpenStudio
Office - Low Rise	3834	3835	OpenStudio
Office - Mid Rise	6119	3040	OpenStudio
Religious Building	5199	2830	eQuest
Restaurant	3476	2305	OpenStudio
Retail - Department Store	4249	2528	eQuest
Retail - Strip Mall	4475	2266	eQuest
Warehouse	4606	770	eQuest
Unknown	5038	2987	n/a

The type of hours to apply depends on the VFD application, according to the table below.

Application	Hours Type
Hot Water Pump	Heating
Chilled Water Pump	Cooling
Cooling Tower Fan	Cooling

ESF = Energy savings factor varies by VFD application. Units are kW/HP.

Application	ESF <sup>564</sup>
Hot Water Pump	0.249
Chilled Water Pump	0.081
Cooling Tower Fan	0.502

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = BHP/EFF_i * DSF$$

Where:

<sup>564</sup> Based on OpenStudio Large Office model, finding difference in energy use for each VSD application. See 'VSD ESF Calculation.xls'.

DSF = Demand Savings Factor varies by VFD application.<sup>565</sup> Units are kW/HP. Values listed below are based on typical peak load for the listed application.

Application	DSF
Hot Water Pump	0
Chilled Water Pump	0
Cooling Tower Fan	0.407

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

There are no expected fossil fuel impacts for this measure.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-VSDHP-V08-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>565</sup> Based on OpenStudio Large Office model, finding difference in maximum demand for each VSD application. See 'VSD ESF Calculation.xls'.



4.4.18 Small Commercial Programmable Thermostats – Retired 12/31/2019. Replaced with  
4.4.48 Small Commercial Thermostats

## 4.4.19 Demand Controlled Ventilation

### DESCRIPTION

Demand control ventilation (DCV) adjusts outside ventilation air based on the number of occupants and the ventilation demands that those occupants create. DCV is part of a building's ventilation system control strategy. It may include hardware, software, and controls as an integral part of a building's ventilation design. Active control of the ventilation system provides the opportunity to reduce heating and cooling energy use.

The primary component is a control sensor to communicate either directly with the economizer or with a central computer. The component is most typically a carbon dioxide (CO<sub>2</sub>) sensor, occupancy sensor, or turnstile counter. This measure is applicable to multiple building types, and savings are classified by the specific building types defined in the Illinois TRM. This measure is modeled to assume night time set backs are in operation and minimum outside air is being used when the building is unoccupied. Systems that have static louvers or that are open at night will likely have greater savings by using the custom program.

Demand controlled ventilation controls can also be added to the exhaust fans to enclosed parking garages. The fans modulate the ventilation airflow based on pollutant concentrations (primarily carbon monoxide) in the space.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment condition is defined by new CO<sub>2</sub> sensors installed on return air systems where no other sensors were previously installed. For heating savings, this measure does not apply to any system with terminal reheat (constant volume or variable air volume). For terminal reheat system a custom savings calculation should be used.

### DEFINITION OF BASELINE EQUIPMENT

The base case for this measure is a space with no demand control capability. The current code minimum for outside air (OA) is 17 CFM per occupant (ASHRAE 62.1 - 2016) which is the value for office space assumed in this measure.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 10 years and based on CO<sub>2</sub> sensor estimated life.<sup>566</sup>

### DEEMED MEASURE COST

The deemed measure cost is assumed to be the full cost of installation of a DCV retrofit including sensor cost (\$500) and installation (\$1000 labor) for a total of \$1,500.<sup>567</sup>

Adding demand controlled ventilation to parking garages is assumed to cost \$500 per sensor including the cost of the controller. The installation cost is estimated at \$1,000 for labor.<sup>568</sup>

### LOADSHAPE

Commercial ventilation C23

---

<sup>566</sup> During the course of conversations with vendors and Building Automation System (BAS) contractors, it was determined that sensors have to be functional for up to 10 years. It is recommended that they are part of a normal preventive maintenance program in which calibration is an important part of extending useful life. Although they are not subject to mechanical failure, they do fall out of tolerance over time.

<sup>567</sup> Discussion with vendors.

<sup>568</sup> California Utilities Statewide Codes and Standards Team. 2011. "2013 California Building Energy Efficiency Standards", Garage Exhaust, Section 4.2 Page 14.

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

For facilities heated by natural gas,

$$\Delta kWh = \text{Condition Space}/1000 * SF_{cooling}$$

For facilities heated by heat pumps,

$$\Delta kWh = \text{Condition Space}/1000 * SF_{cooling} + \text{Condition Space}/1000 * SF_{Heat HP}$$

For facilities heated by electric resistance,

$$\Delta kWh = \text{Condition Space}/1000 * SF_{cooling} + \text{Condition Space}/1000 * SF_{Heat ER}$$

Where:

- Conditioned Space = actual square footage of conditioned space controlled by sensor
- SF<sub>cooling</sub> = Cooling Savings Factor  
= value in table below based on building type and weather zone
- SF<sub>Heat HP</sub> = Heating Savings factor for facilities heated by Heat Pump (HP)  
= value in table below based on building type and weather zone
- SF<sub>Heat ER</sub> = Heating Savings factor for facilities heated by Electric Resistance (ER)  
= value in table below based on building type and weather zone

Saving Factor Tables<sup>569</sup>

Building Type	SF <sub>cooling</sub> (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	285	289	299	298	305
Office - Mid-rise	225	228	234	233	237
Office - High-rise	267	271	279	279	284
Religious Building	763	780	886	889	910
Restaurant	498	510	573	593	615
Retail - Department Store	388	393	410	415	423
Retail - Strip Mall	269	272	285	285	290
Convenience Store	355	357	368	370	374
Elementary School	358	367	410	405	415
High School	350	359	401	396	406
College/University	400	426	472	488	519

<sup>569</sup> The electric energy savings was calculated using TMY3 weather data and methodology consistent with ASHRAE standards. Savings are calculated on an annual basis for each given temperature zone in Illinois. Energy savings for DCV were developed utilizing standards, inputs and approaches as set forth by ASHRAE 90.1 -2010 (code level up until Dec 31, 2015). Building input parameters like square footage, equipment efficiencies and occupancy match those used in the EFLH calculations. Reference calculation found in Demand Control Ventilation 12-30-13.xls.

Building Type	SF <sub>cooling</sub> (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Healthcare Clinic	349	354	389	392	398
Lodging	407	409	423	424	428
Manufacturing	175	177	183	248	185
Special Assembly Auditorium	563	581	668	677	711
Default (non-garage)	377	385	419	426	433
Enclosed Parking Garage <sup>570</sup>	925	925	925	925	925

Building Type	SF <sub>Heat HP</sub> (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	234	205	181	171	147
Office - Mid-rise	157	138	121	115	99
Office - High-rise	211	185	163	154	133
Religious Building	1,508	1,333	1,180	1,125	1,008
Restaurant	1,067	962	837	816	720
Retail - Department Store	368	329	291	285	249
Retail - Strip Mall	246	215	195	186	165
Convenience Store	180	163	141	138	121
Elementary School	657	572	508	473	418
High School	641	558	495	461	406
College/University	1,267	1,114	980	945	798
Healthcare Clinic	447	396	348	334	299
Lodging	205	184	159	154	135
Manufacturing	130	114	101	172	83
Special Assembly Auditorium	1,773	1,564	1,414	1,378	1,212
Default (non-garage)	606	535	474	460	400

Building Type	SF <sub>Heat ER</sub> (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	703	615	542	512	441
Office - Mid-rise	471	413	364	345	298
Office - High-rise	633	554	489	462	398
Religious Building	4,523	3,999	3,541	3,376	3,024
Restaurant	3,201	2,886	2,511	2,449	2,159
Retail - Department Store	1,103	987	874	855	748
Retail - Strip Mall	738	646	584	559	495
Convenience Store	541	488	423	413	364
Elementary School	1,972	1,715	1,523	1,420	1,254
High School	1,924	1,673	1,484	1,383	1,219
College/University	3,801	3,341	2,940	2,834	2,394
Healthcare Clinic	1,341	1,188	1,044	1,001	896
Lodging	616	551	477	462	406

<sup>570</sup> Savings are estimated based on a study done by California Utilities Statewide Codes and Standards Team, “2013 California Building Energy Efficiency Standards”, 2013, Section 2.4, Table 1. The savings are primarily fan savings, and are not dependent on climate zone.

Building Type	SF <sub>Heat ER</sub> (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Manufacturing	390	343	303	516	250
Special Assembly Auditorium	5,320	4,691	4,243	4,133	3,636
Default (non-garage)	1,819	1,606	1,423	1,381	1,199

**For example**, for a 7,500 SqFt of low-rise office space in Chicago with gas heat.

$$\begin{aligned} \Delta kWh &= 7,500 / 1000 * 289 \\ &= 2,168 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

NA

**NATURAL GAS SAVINGS**

$$\Delta \text{therms} = \text{Condition Space} / 1000 * SF_{\text{Heat Gas}}$$

Where:

SF<sub>Heat Gas</sub> = value in table below based on building type and weather zone.<sup>571</sup>

Building Type	SF <sub>Heat Gas</sub> (Therm/1000 sq ft)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	30	26	23	22	19
Office - Mid-rise	20	18	16	15	13
Office- High-rise	27	24	21	20	17
Religious Building	193	171	151	144	129
Restaurant	137	123	107	104	92
Retail - Department Store	47	42	37	36	32
Retail - Strip Mall	31	28	25	24	21
Convenience Store	23	21	18	18	16
Elementary School	84	73	65	61	53
High School	82	71	63	59	52
College/ University	162	143	125	121	102
Healthcare Clinic	57	51	45	43	38
Lodging	26	23	20	20	17
Manufacturing	17	15	13	22	11
Special Assembly Auditorium	227	200	181	176	155
De-fault	78	68	61	59	51

<sup>571</sup> The natural gas energy savings was calculated using TMY3 weather data and methodology consistent with ASHRAE standards. Savings are calculated on an annual basis for each given temperature zone in Illinois. Energy savings for DCV were developed utilizing standards, inputs and approaches as set forth by ASHRAE 62.1 and 90.1, respectively. Building input parameters like square footage, equipment efficiencies and occupancy match those used in the EFLH calculations. Reference calculation found in Demand Control Ventilation 12-30-13.xls.

**For example**, for a 7500 SqFt of low-rise office space in Chicago.

$$\Delta\text{Therms} = 7,500/1,000 * 26$$

$$= 195 \text{ Therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-DCV-V05-190101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4.20 High Turndown Burner for Space Heating Boilers

### DESCRIPTION

This measure is for a non-residential boilers equipped with linkageless controls providing space heating with burners having a turndown less than 6:1.<sup>572</sup> Turndown is the ratio of the high firing rate to the low firing rate. When boilers are subjected to loads below the low firing rate, the boiler must cycle on/off to meet the load requirements. A higher turndown ratio reduces burner startups, provides better load control, saves wear-and-tear on the burner, and reduces purge-air requirements, all of these benefits result in better overall efficiency.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler linkageless burner must operate with a turndown greater than or equal to 10:1 and be subjected to loads less than or equal to 30% of the full fire input MBH<sup>573</sup> for greater than 60% of the operating hours.<sup>574</sup>

### DEFINITION OF BASELINE EQUIPMENT

The baseline boiler utilizes a linkageless burner with a turndown ration of 6:1 or less and is used primarily for space heating. Redundant boilers do not qualify. Code requirements must be considered.

Note: beginning with the 2015 edition, IECC makes the following requirements for boiler turndown:

*Boiler Systems* with design input of greater than 1,000,000 Btu/h shall comply with the turndown ratio specified in the following table.

The system turndown requirement shall be met through the use of multiple single-input boilers, one or more *modulating boilers* or a combination of single-input and *modulating boilers*.

BOILER SYSTEM DESIGN INPUT	MINIMUM TURNDOWN RATIO
≥ 1,000,000 and less than or equal to 5,000,000	3 to 1
> 5,000,000 and less than or equal to 10,000,000	4 to 1
> 10,000,000	5 to 1

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be the lower of remaining useful life of the boiler, or 21 years.<sup>575</sup>

### DEEMED MEASURE COST

Actual costs shall be used as available. When unknown, the deemed installed measure cost including labor is approximately \$2.53/MBtu/hr.<sup>576</sup>

<sup>572</sup> The standard turndown ratio for boilers is 6:1. Understanding Fuel Savings in the Boiler Room, ASHRAE Journal, David Eoff, December, 2008 p 38.

<sup>573</sup> Focus on Energy Evaluation, Business Programs: Deemed Savings Manual V1.0, March 22, 2010. This factor implies that boilers are 30% oversized on average.

<sup>574</sup> FES Analysis of bin hours based upon a 30% oversizing factor.

<sup>575</sup> "Burner," Obtained from a nation-wide survey conducted by ASHRAE TC 1.8 (Akalin 1978). Data changed by TC 1.8 in 1986.

<sup>576</sup> FES review of PY2/PY3 costs for custom People's and North Shore high turndown burner projects. See High Turndown Costs.xlsx for details.

**DEEMED O&M COST ADJUSTMENTS**

N/A

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta \text{therms} = N_{gi} * SF * EFLH / 100$$

Where:

$N_{gi}$  = Boiler gas input size (kBtu/hr) = custom

$SF$  = Savings Factor = Percentage of energy loss per hour  
 $= (\sum ((EL_{base} - EL_{eff}) * H_{cycling})) / H * 100$

Where:

$EL_{base}$  = Base Boiler Percentage of energy loss due to cycling at % of Base Boiler Load where  
 $BL_{base} \leq TDR_{base}$

$$= 0.003 * (Cycles_{base})^2 - 0.001 * Cycles_{base}^{577}$$

Where:

$Cycles_{base}$  = Number of Cycles/hour of base boiler

$$= TDR_{base} / BL$$

Where:

$BL$  = % of full boiler load at bin hours being evaluated. This is assumed to be a straight line based on 0% load at the building balance point (assumed to be 55F), and full load corrected for the oversizing (OSF) at the lowest temperature bin of -10 to -5F.

---

<sup>577</sup> Release 3.0 Operations & Maintenance Best Practices A Guide to Achieving Operational Efficiency, August 2010, Federal Energy Management Program, US Department of Energy. The equation was determined by plotting the values in Table 9.2.1 – Boiler Cycling Energy Loss.



OSF = Oversizing Factor = 1.3,<sup>578</sup> or custom

TDR\_base = Turndown ratio = 0.33,<sup>579</sup> or custom

EL\_eff = Efficient Boiler Percentage of energy loss due to cycling at % of Efficient Boiler Load

$$= 0.003 * (\text{Cycles\_eff})^2 - 0.001 * \text{Cycles\_eff}$$

Where:

Cycles\_eff = Number of Cycles/hour

$$= \text{TDR\_eff} / \text{BL}$$

Where:

TDR\_eff = Turndown ratio = 0.10,<sup>580</sup> or custom

H\_cycling = Hours base boiler is cycling at % of base boiler load

= see table below or custom

H = Total Number of Hours in Heating Season

= 4,946 or custom

100 = convert to a percentage

SF =  $69.1 / 4946 * 100 = 1.4\%$  or custom (see table below for summary of values)

Temperature	H_cycling	BL	EL_base	EL_eff	(EL_base-EL_eff)* Hours
50 to 55	601	6.0%	8.5%	0.7%	47.2
45 to 50	603	12.0%	2.0%	0.0%	12.0
40 to 45	455	18.0%	0.8%	0.0%	3.8
35 to 40	925	24.0%	0.4%	0.0%	4.0
30 to 35	814	30.0%	0.3%	0.0%	2.1
Total					69.1

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

100 = convert kBtu to therms

**Water IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVAC-HTBC-V05-200601**

**REVIEW DEADLINE: 1/1/2024**

<sup>578</sup> PA Consulting, KEMA, Focus on Energy Evaluation, Business Programs: Deemed Savings Manual V1.0, March 22, 2010, Page 4-12.

<sup>579</sup> Ibid.

<sup>580</sup> 10:1 ratio used to qualify for efficient equipment.

## 4.4.21 Linkageless Boiler Controls for Space Heating

### DESCRIPTION

This measure is for a non-residential boiler providing space heating and currently having single point positioning combustion control. In single-point positioning control, the fuel valve is linked to the combustion air damper via a jackshaft mechanism to maintain correspondence between fuel and combustion air input. Most boilers with single point positioning control do not maintain low excess air levels over their entire firing range. Generally these boilers are calibrated at high fire, but due to the non-linearity required for efficient combustion, excess air levels tend to dramatically increase as the firing rate decreases. Boiler efficiency drops as the excess air levels are increased.

This measure was developed to be applicable to the following program types: TOS, NC, RF.  
If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler burner must have a linkageless control system allowing the combustion air damper position to be adjusted and set for optimal efficiency at several firing rates throughout the burner's firing range. This requires the fuel valve and combustion air damper to each be powered by a separate actuator. An alternative to the combustion air damper is a Variable Speed Drive on the combustion air fan.

### DEFINITION OF BASELINE EQUIPMENT

The baseline boiler utilizes single point positioning for the burner combustion control.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years.<sup>581</sup>

### DEEMED MEASURE COST

The deemed measure cost is estimated at \$2.50/MBtu/hr burner input.<sup>582</sup>

### DEEMED O&M COST ADJUSTMENTS

N/A

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

<sup>581</sup> Total number of hours for heating with a base temperature of 55°F for Chicago, IL as noted by National Climate Data Center.

<sup>582</sup> Available and Emerging Technologies for Reducing Greenhouse Gas Emissions from Industrial, Commercial, and Institutional Boilers, Prepared by the Sector Policies and Programs Division Office of Air Quality Planning and Standards U.S. Environmental Protection Agency Research Triangle Park, North Carolina 27711, October 2010, Table 1. ICI Boilers – Summary of Greenhouse Gas Emission Reduction Measures, pg. 8

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

When a Variable Speed Drive is incorporated, electrical savings are calculated according to the “4.4.17 Variable Speed Drive for HVAC Pumps and Cooling Tower Fans” measure.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = \text{Ngi} * \text{SF} * \text{EFLH} / 100$$

Where:

Ngi = Boiler gas input size (kBtu/hr) = custom

SF = Savings factor

Note: Savings factor is the percentage increase in efficiency as a result of the addition of linkageless burner controls. At an average boiler load of 35%, single point controls are assumed to have excess air of 91%, while linkageless controls are assumed to have 34% excess air.<sup>583</sup> The difference between controls types is 57% at this average operating condition. A 15% reduction in excess air is approximately a 1% increase in efficiency.<sup>584</sup> Therefore the nominal combustion efficiency increase is  $57 / 15 * 1\% = 3.8\%$ .

$$= 3.8\%$$

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

100 = convert kBtu to therms

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-LBC-V05-160601**

**REVIEW DEADLINE: 1/1/2022**

<sup>583</sup> Available and Emerging Technologies for Reducing Greenhouse Gas Emissions from Industrial, Commercial, and Institutional Boilers, Prepared by the Sector Policies and Programs Division Office of Air Quality Planning and Standards U.S. Environmental Protection Agency Research Triangle Park, North Carolina 27711, October 2010, Table 1. ICI Boilers – Summary of Greenhouse Gas Emission Reduction Measures, pg. 8.

<sup>584</sup> Department of Energy (DOE). January 2012, Steam Tip Sheet #4, Improve Your Boiler’s Combustion Efficiency. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. This value was determined as an appropriate average over the stack temperatures and excess air levels indicated.

## 4.4.22 Oxygen Trim Controls for Space Heating Boilers

### DESCRIPTION

This measure is for a non-residential boiler providing space heating without oxygen trim combustion controls. Oxygen trim controls limit the amount of excess oxygen provided to the burner for combustion. This oxygen level is dependent upon the amount of air provided. Oxygen trim control converts parallel positioning, linkageless controls, into a closed-loop control configuration with the addition of an exhaust gas analyzer and PID controller. Boilers with oxygen trim controls can maintain a predetermined excess air rate (generally 15% to 30% excess air) over the entire burner firing rate. Boilers without these controls typically have excess air rates around 30% over the entire firing rate. Boiler efficiency drops as the excess air levels are increased.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler burner must have an oxygen control system allowing the combustion air to be adjusted to maintain a predetermined excess oxygen level in the flue exhaust at all firing rates throughout the burner's firing range. This requires an oxygen sensor in the flue exhaust and linkageless fuel valve and combustion air controls.

### DEFINITION OF BASELINE EQUIPMENT

The baseline boiler utilizes single point positioning for the burner combustion control.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the O2 Trim controls is 18 years.<sup>585</sup>

### DEEMED MEASURE COST

The deemed measure cost is approximately \$23,250.<sup>586</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

---

<sup>585</sup> State of Wisconsin Public Service Commission of Wisconsin Focus on Energy Evaluation Business Programs: Measure Life Study Final Report: August 25, 2009, Table 1-2. Recommended Measure Life by WISEerts Group Description, pg. 1-4.

<sup>586</sup> CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

### NATURAL GAS ENERGY SAVINGS

$$\Delta\text{Therms} = \text{Ngi} * \text{SF} * \text{EFLH} / 100$$

Where:

Ngi = Boiler gas input size (kBtu/hr)

= Custom

SF = Savings factor

Note: Savings factor is the percentage reduction in gas consumption as a result of the addition of O2 trim controls. Linkageless controls have an excess air rate of 28% over the entire firing range.<sup>587</sup> O2 trim controls have an excess air rate of 15%.<sup>588</sup> The average difference is 13%. A 15% reduction in excess air is approximately a 1% increase in efficiency.<sup>589,590</sup> Therefore, the nominal combustion efficiency increase is  $13 / 15 * 1\% = 0.87\%$ .

= 0.87%

EFLH = Default Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use. When available, actual hours should be used.

100 = convert kBtu to therms

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

### DEEMED O&M COST ADJUSTMENT CALCULATION

The deemed annual Operations and Maintenance cost is \$800.<sup>591</sup>

**MEASURE CODE: CI-HVC-O2TC-V01-140601**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>587</sup> Department of Energy (DOE). 2009. Energy Matters newsletter. Fall 2009- Vol. 1, Iss. 1. Washington, DC: U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy, Industrial Technologies Program.

<sup>588</sup> Ibid.

<sup>589</sup> Department of Energy (DOE), January 2012, Steam Tip Sheet #4, Improving Your Boiler's Combustion Efficiency. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. This value was determined as an appropriate average over the stack temperatures and excess air levels indicated.

<sup>591</sup> CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

## 4.4.23 Shut Off Damper for Space Heating Boilers or Furnaces

### DESCRIPTION

This measure is for non-residential atmospheric boilers or furnaces providing space heating without a shut off damper. When appliances are on standby mode warm room air is drawn through the stack via the draft hood or dilution air inlet at a rate proportional to the stack height, diameter and outdoor temperature. More air is drawn through the vent immediately after the appliance shuts off and the flue is still hot. Installation of a new shut off damper can prevent heat from being drawn up the warm vent and reducing the amount of air that passes through the furnace or boiler heat exchanger. This reduction in air can slightly increase overall operating efficiency by reducing the time needed to achieve steady-state operating conditions.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the space heating boiler or furnace must have a new electrically or thermally activated shut off damper installed on either the exhaust flue or combustion air intake. Barometric dampers do not qualify. The damper actuation shall be interlocked with the firing controls.

### DEFINITION OF BASELINE EQUIPMENT

The baseline boiler or furnace incorporates no shut off damper on the combustion air intake or flue exhaust.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the shut off damper is 15 years,<sup>592</sup> or for the remaining lifetime of the heating equipment, whichever is less.

### DEEMED MEASURE COST

Given the variability in cost associated with differences in system specifications and design, as well as choice of measure technology, actual installed costs should be used as available or based on program-specific qualification requirements. When unavailable, a deemed measure cost of \$1,500 shall be assumed.<sup>593</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

---

<sup>592</sup> State of Wisconsin Public Service Commission of Wisconsin Focus on Energy Evaluation Business Programs: Measure Life Study Final Report: August 25, 2009, Table 1-2. Recommended Measure Life by WISEerts Group Description, pg. 1-4.

<sup>593</sup> CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

$$\Delta\text{Therms} = \text{Ngi} * \text{SF} * \text{EFLH} / 100$$

Where:

Ngi = Boiler gas input size (kBtu/hr)

= Custom

SF = Savings factor

= 1%<sup>594</sup>

Note: The savings factor assumes the boiler or furnace is located in an unconditioned space. The savings factor can be higher for those units located within conditioned space.

EFLH = Default Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use. When available, actual hours should be used.

100 = convert kBtu to therms

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

A deemed, one-time Operations and Maintenance cost of \$150<sup>595</sup> shall be included in cost-effectiveness calculations and occur in year 10 of the measure life to account for controller replacement.

**MEASURE CODE: CI-HVC-SODP-V02-200601**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>594</sup> Based on internet review of savings potential;

“Up to 4%”: Use of Automatic Vent Dampers for New and Existing Boilers and Furnaces, Energy Innovators Initiative Technical Fact Sheet, Office of Energy Efficiency, Canada, 2002

“Up to 1%”: Page 9, The Carbon Trust, “Steam and high temperature hot water boilers”, March 2012,

“1 - 2%”: Page 2, Sustainable Energy Authority of Ireland “Steam Systems Technical Guide”.

<sup>595</sup> CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

## 4.4.24 Small Pipe Insulation

### DESCRIPTION

This measure provides rebates for adding insulation to bare pipes with inner diameters of ½” and ¾”. Insulation must be at least one inch thick. Since new construction projects are required by code to have pipe insulation, this measure is only for retrofits of existing facilities. This covers bare straight pipe as well as all fittings.

Default savings are provided on a per linear foot basis. It is assumed that the majority of pipes less than one inch in commercial facilities are used for domestic hot water. However, this measure can cover hydronic heating systems as well as low and high pressure steam systems.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is a ½” or ¾” diameter pipe with at least one inch of insulation. Insulation must be protected from damage which includes moisture, sunlight, equipment maintenance and wind. Outdoor pipes should have a weather protective jacket. Insulation must be continuous over straight pipe, elbows and tees.

### DEFINITION OF BASELINE EQUIPMENT

The base case for savings estimates is a bare hot water or steam pipe with a fluid temperature of 105 degrees Fahrenheit or greater. Current new construction code requires insulation amounts similar to this measure though this base case is commonly found in older existing buildings.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.<sup>596</sup>

### DEEMED MEASURE COST

The incremental measure cost for insulation is the full cost of adding insulation to the pipe. Actual installation costs should be used for the measure cost. For planning purposes, the following costs can be used to estimate the full cost of materials and labor.<sup>597</sup>

Insulation Thickness	¾” pipe	½” pipe
1”	\$4.45	\$4.15

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

<sup>596</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

<sup>597</sup> A market survey was performed to determine these costs.



**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms per foot}^{598} = [((Q_{\text{base}} - Q_{\text{eff}}) * \text{EFLH}) / (100,000 * \eta_{\text{Boiler}})] * \text{TRF}$$

$$= [\text{Modeled or provided by tables below}] * \text{TRF}$$

$$\Delta\text{Therms} = (L_{\text{sp}} + L_{\text{oc,i}}) * \Delta\text{therms per foot}$$

Where:

**EFLH** = Equivalent Full Load Hours for Heating  
 = Actual or defaults by building type in Existing Buildings provided in Section 4.4, HVAC end use

For year round recirculation or domestic hot water:

$$= 8,766$$

For heating season recirculation, hours with the outside air temperature below 55°F:

Zone	Hours
Zone 1 (Rockford)	5,039
Zone 2 (Chicago)	4,963
Zone 3 (Springfield)	4,495
Zone 4 (Belleville/	4,021
Zone 5 (Marion)	4,150

**Q<sub>base</sub>** = Heat Loss from Bare Pipe (Btu/hr/ft)  
 = Calculated where possible using 3E Plusv4.0 software. For defaults see table below

**Q<sub>eff</sub>** = Heat Loss from Insulated Pipe (Btu/hr/ft)  
 = Calculated where possible using 3E Plusv4.0 software. For defaults see table below

**100,000** = conversion factor (1 therm = 100,000 Btu)

**η<sub>Boiler</sub>** = Efficiency of the boiler being used to generate the hot water or steam in the pipe  
 = 81.9% for water boilers<sup>599</sup>  
 = 80.7% for steam boilers, except multifamily low-pressure<sup>600</sup>

<sup>598</sup>This value comes from the reference table “Savings Summary by Building Type and System Type.” The formula and the input tables in this section document assumptions used in calculation spreadsheet “Pipe Insulation Savings 2013-11-12.xlsx”.

<sup>599</sup> Average efficiencies of units from the California Energy Commission (CEC).

<sup>600</sup> Ibid.

= 64.8% for multifamily low-pressure steam boilers.<sup>601</sup>

TRF = Thermal Regain Factor for space type, applied only to space heating energy and is applied to values resulting from  $\Delta$ therms/ft tables below.<sup>602</sup>

= See table below for base TRF values by pipe location.

May vary seasonally such as: TRF[summer] \* summer hours + TRF[winter] \* winter hours where TRF values reflecting summer and winter conditions are apportioned by the hours for those conditions. TRF may also be adjusted by building specific balance temperature and operating hours above and below that balance temperature.<sup>603</sup>

Pipe Location	Assumed Regain	TRF, Thermal Regain Factor
Outdoor	0%	1.0
Indoor, heated space	85%	0.15
Indoor, semi- heated, (unconditioned space, with heat transfer to conditioned space. E.g.: boiler room, ceiling plenum, basement, crawlspace, wall)	30%	0.70
Indoor, unheated, (no heat transfer to conditioned space)	0%	1.0
Location not specified	85%	0.15
Custom	Custom	1 – assumed regain

$L_{sp}$  = Length of straight pipe to be insulated (linear foot)

$L_{oc,i}$  = Total equivalent length of (elbows and tees) of pipe to be insulated. Use table below to determine equivalent lengths.

Nominal Pipe Diameter	Equivalent Length (ft)	
	90 Degree Elbow	Straight Tee
1/2"	0.04	0.03
3/4"	0.06	0.05

The table below shows the deemed therm savings by building type and region on a per linear foot basis for both 1/2" and 3/4" copper pipe.

The following table provides deemed values for 1/2" copper pipe, temperatures are assumed by category below, and insulation is assumed to be one inch fiberglass.

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Space Heating	Assembly	0.117	0.120	0.107	0.071	0.109
	Assisted Living	0.110	0.107	0.094	0.069	0.083
	College	0.100	0.093	0.083	0.046	0.055

<sup>601</sup> Katrakis, J. and T.S. Zawacki. "Field-Measured Seasonal Efficiency of Intermediate-sized Low-Pressure Steam Boilers". ASHRAE V99, pt. 2, 1993.

<sup>602</sup> Thermal regain for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012 and Andrews, John, Better Duct Systems for Home Heating and Cooling, U.S. Department of Energy, 2001. Recognizing the differences between residential and commercial heating systems, the factors have been adjusted based on professional judgment. This factor would benefit from additional study and evaluation.

<sup>603</sup> Thermal Regain Factor\_4-30-14.docx

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Non-recirculating	Convenience Store	0.097	0.089	0.079	0.057	0.064
	Elementary School	0.116	0.113	0.100	0.069	0.084
	Garage	0.064	0.063	0.056	0.044	0.049
	Grocery	0.105	0.105	0.092	0.057	0.068
	Healthcare Clinic	0.103	0.106	0.092	0.063	0.066
	High School	0.120	0.121	0.109	0.077	0.091
	Hospital - CAV no econ	0.115	0.119	0.101	0.087	0.099
	Hospital - CAV econ	0.117	0.121	0.103	0.089	0.101
	Hospital - VAV econ	0.048	0.045	0.034	0.020	0.022
	Hospital - FCU	0.087	0.099	0.080	0.094	0.127
	Hotel/Motel	0.115	0.112	0.101	0.069	0.084
	Hotel/Motel - Common	0.104	0.106	0.101	0.082	0.086
	Hotel/Motel - Guest	0.115	0.111	0.099	0.066	0.082
	Manufacturing Facility	0.068	0.066	0.061	0.037	0.041
	MF - High Rise	0.100	0.098	0.090	0.076	0.076
	MF - High Rise - Common	0.118	0.115	0.103	0.071	0.092
	MF - High Rise - Residential	0.096	0.096	0.087	0.075	0.073
	MF - Mid Rise	0.109	0.110	0.095	0.070	0.079
	Movie Theater	0.119	0.117	0.109	0.083	0.099
	Office - High Rise - CAV no econ	0.132	0.134	0.122	0.082	0.089
	Office - High Rise - CAV econ	0.136	0.139	0.128	0.088	0.097
	Office - High Rise - VAV econ	0.100	0.102	0.084	0.050	0.055
	Office - High Rise - FCU	0.073	0.072	0.062	0.033	0.035
	Office - Low Rise	0.093	0.093	0.074	0.045	0.052
	Office - Mid Rise	0.103	0.104	0.088	0.056	0.062
	Religious Building	0.105	0.098	0.094	0.069	0.079
	Restaurant	0.088	0.088	0.079	0.060	0.071
	Retail - Department Store	0.091	0.083	0.078	0.051	0.058
Retail - Strip Mall	0.087	0.081	0.071	0.049	0.053	
Warehouse	0.095	0.089	0.091	0.057	0.070	
Unknown	0.101	0.100	0.089	0.064	0.074	
Space Heating - recirculation heating season only	All buildings (Hours below 55°F)	0.329	0.324	0.293	0.262	0.271
Space Heating - recirculation year round	All buildings (All hours)	0.572	0.572	0.572	0.572	0.572
DHW	Recirculation loop	0.572	0.572	0.572	0.572	0.572
Process	Custom	Custom				

The following table provides deemed savings values for 3/4" copper pipe with temperatures assumed by category below, insulation is assumed to be one inch fiberglass.

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Space Heating Non-recirculating	Assembly	0.142	0.145	0.129	0.086	0.132
	Assisted Living	0.133	0.130	0.115	0.084	0.101
	College	0.121	0.113	0.101	0.056	0.067
	Convenience Store	0.117	0.108	0.096	0.069	0.077
	Elementary School	0.141	0.137	0.121	0.084	0.102
	Garage	0.078	0.077	0.067	0.054	0.060
	Grocery	0.127	0.127	0.111	0.069	0.083
	Healthcare Clinic	0.125	0.128	0.112	0.076	0.081
	High School	0.146	0.147	0.132	0.094	0.110
	Hospital - CAV no econ	0.140	0.144	0.123	0.105	0.120
	Hospital - CAV econ	0.142	0.147	0.125	0.108	0.123
	Hospital - VAV econ	0.058	0.055	0.041	0.025	0.027
	Hospital - FCU	0.105	0.120	0.098	0.115	0.154
	Hotel/Motel	0.140	0.136	0.122	0.084	0.102
	Hotel/Motel - Common	0.127	0.129	0.123	0.100	0.105
	Hotel/Motel - Guest	0.139	0.135	0.120	0.081	0.099
	Manufacturing Facility	0.083	0.080	0.074	0.045	0.050
	MF - High Rise	0.121	0.119	0.109	0.093	0.093
	MF - High Rise - Common	0.144	0.140	0.125	0.086	0.111
	MF - High Rise - Residential	0.117	0.116	0.105	0.091	0.089
	MF - Mid Rise	0.132	0.134	0.115	0.085	0.096
	Movie Theater	0.144	0.142	0.133	0.101	0.120
	Office - High Rise - CAV no econ	0.160	0.162	0.148	0.099	0.108
	Office - High Rise - CAV econ	0.165	0.169	0.155	0.107	0.118
	Office - High Rise - VAV econ	0.121	0.123	0.102	0.060	0.067
	Office - High Rise - FCU	0.089	0.087	0.075	0.040	0.042
	Office - Low Rise	0.113	0.113	0.090	0.055	0.063
	Office - Mid Rise	0.126	0.126	0.106	0.068	0.075
	Religious Building	0.127	0.119	0.114	0.084	0.095
	Restaurant	0.107	0.107	0.096	0.073	0.086
Retail - Department Store	0.110	0.101	0.095	0.062	0.071	
Retail - Strip Mall	0.106	0.098	0.086	0.059	0.064	
Warehouse	0.115	0.108	0.111	0.069	0.085	
Unknown	0.123	0.122	0.108	0.078	0.090	
Space Heating - recirculation heating season only	All buildings (Hours below 55°F)	0.399	0.393	0.356	0.319	0.329
Space Heating - recirculation year round	All buildings (All hours)	0.694	0.694	0.694	0.694	0.694
DHW	Recirculation loop	0.694	0.694	0.694	0.694	0.694
Process	Custom	Custom				

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-SPIN-V02-160601**

**REVIEW DEADLINE: 1/1/2023**

#### 4.4.25 Small Commercial Programmable Thermostat Adjustments – Retired 12/31/2019.

## 4.4.26 Variable Speed Drives for HVAC Supply and Return Fans

### DESCRIPTION

This measure is applied to variable speed drives (VSD) which are installed on HVAC supply fans and return fans. The VSD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The VSD is applied to a motor which does not have a VSD. The application must have a variable load and installation is to include the necessary controls. Savings are based on application of VSDs to a range of baseline load conditions including no control, inlet guide vanes, outlet guide vanes and throttling valves.

### DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VSD or other methods of control. Retrofit baseline is an existing motor operating as is. Retrofit baselines may or may not include guide vanes, throttling valves or other methods of control. This information shall be collected from the customer.

Installations of new equipment with VSDs which are required by IECC 2012 or 2015 as adopted by the State of Illinois are not eligible for incentives.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for all VSDs is 15 years.<sup>604</sup>

### DEEMED MEASURE COST

Customer provided costs will be used when available. Default measure costs are noted below for up to 75 hp motors.<sup>605</sup> Custom costs must be gathered from the customer for motor sizes not listed below.

HP	Cost
5 HP	\$ 2,250
15 HP	\$ 3,318
25 HP	\$ 4,386
50 HP	\$ 6,573
75 HP	\$ 8,532

### LOADSHAPE

Loadshape C39 - VFD - Supply fans <10 HP

Loadshape C40 - VFD - Return fans <10 HP

Loadshape C41 - VFD - Exhaust fans <10 HP

### COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

<sup>604</sup> Efficiency Vermont TRM 10/26/11 for HVAC VSD motors.

<sup>605</sup> NEEP Incremental Cost Study Phase Two Final Report.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS<sup>606</sup>**

$$\begin{aligned}
 kWh_{Base} &= \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times RHRS_{Base} \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Base}) \\
 kWh_{Retrofit} &= \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times RHRS_{base} \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Retrofit}) \\
 \Delta kWh_{fan} &= kWh_{Base} - kWh_{Retrofit} \\
 \Delta kWh_{total} &= \Delta kWh_{fan} \times (1 + IE_{energy})
 \end{aligned}$$

Where:

- $kWh_{Base}$  = Baseline annual energy consumption (kWh/yr)
- $kWh_{Retrofit}$  = Retrofit annual energy consumption (kWh/yr)
- $\Delta kWh_{fan}$  = Fan-only annual energy savings
- $\Delta kWh_{total}$  = Total project annual energy savings
- 0.746 = Conversion factor for HP to kWh
- HP = Nominal horsepower of controlled motor
- LF = Load Factor; Motor Load at Fan Design CFM (Default = 65%)<sup>607</sup>
- $\eta_{motor}$  = Installed nominal/nameplate motor efficiency  
 Default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor

**NEMA Premium Efficiency Motors Default Efficiencies<sup>608</sup>**

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902

<sup>606</sup> Methodology developed and tested in Del Balso, Ryan Joseph. "Investigation into the Reliability of Energy Efficiency/Demand Side Management Savings Estimates for Variable Frequency Drives in Commercial Applications". A project report submitted to the Faculty of the Graduate School of the University of Colorado, 2013.

<sup>607</sup> Lawrence Berkeley National Laboratory, and Resource Dynamics Corporation. (2008). "Improving Motor and Drive System Performance; A Sourcebook for Industry". U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy. Golden, CO: National Renewable Energy Laboratory.

<sup>608</sup> Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.



Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

$RHRS_{Base}$  = Annual operating hours for fan motor based on building type

Default hours are provided for HVAC applications which vary by HVAC application and building type.<sup>609</sup> When available (provided via Energy Management Software or metered), actual hours should be used.

Building Type	Total Fan Run Hours	Model Source
Assembly	7235	eQuest
Assisted Living	8760	eQuest
Auto Dealership	7451	OpenStudio
College	4836	OpenStudio
Convenience Store	7004	eQuest
Drug Store	7156	OpenStudio
Elementary School	3765	OpenStudio
Emergency Services	8760	OpenStudio
Garage	7357	eQuest
Grocery	8543	OpenStudio
Healthcare Clinic	4314	OpenStudio
High School	3460	OpenStudio
Hospital - VAV econ	4666	OpenStudio
Hospital - CAV econ	8021	OpenStudio
Hospital - CAV no econ	7924	OpenStudio
Hospital - FCU	4055	OpenStudio

<sup>609</sup> Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

Building Type	Total Fan Run Hours	Model Source
Manufacturing Facility	8706	eQuest
MF - High Rise	8760	OpenStudio
MF - Mid Rise	8760	OpenStudio
Hotel/Motel - Guest	2409	OpenStudio
Hotel/Motel - Common	8683	OpenStudio
Movie Theater	7505	eQuest
Office - High Rise - VAV econ	2369	OpenStudio
Office - High Rise - CAV econ	2279	OpenStudio
Office - High Rise - CAV no econ	5303	OpenStudio
Office - High Rise - FCU	1648	OpenStudio
Office - Low Rise	6345	OpenStudio
Office - Mid Rise	3440	OpenStudio
Religious Building	7380	eQuest
Restaurant	7302	OpenStudio
Retail - Department Store	7155	OpenStudio
Retail - Strip Mall	6921	OpenStudio
Warehouse	6832	OpenStudio
Unknown	6241	n/a

$\%FF$  = Percentage of run-time spent within a given flow fraction range

Default Fan Duty Cycle Based on 2012 ASHRAE Handbook; HVAC Systems and Equipment, page 45.11, Figure 12.

Flow Fraction (% of design cfm)	Percent of Time at Flow Fraction
0% to 10%	0.0%
10% to 20%	1.0%
20% to 30%	5.5%
30% to 40%	15.5%
40% to 50%	22.0%
50% to 60%	25.0%
60% to 70%	19.0%
70% to 80%	8.5%
80% to 90%	3.0%
90% to 100%	0.5%

$PLR_{Base}$  = Part load ratio for a given flow fraction range based on the baseline flow control type

$PLR_{Retrofit}$  = Part load ratio for a given flow fraction range based on the retrofit flow control type

Control Type	Flow Fraction									
	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%
No Control or Bypass Damper	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Discharge Dampers	0.46	0.55	0.63	0.70	0.77	0.83	0.88	0.93	0.97	1.00
Outlet Damper, BI & Airfoil Fans	0.53	0.53	0.57	0.64	0.72	0.80	0.89	0.96	1.02	1.05
Inlet Damper Box	0.56	0.60	0.62	0.64	0.66	0.69	0.74	0.81	0.92	1.07

Control Type	Flow Fraction									
	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%
Inlet Guide Vane, BI & Airfoil Fans	0.53	0.56	0.57	0.59	0.60	0.62	0.67	0.74	0.85	1.00
Inlet Vane Dampers	0.38	0.40	0.42	0.44	0.48	0.53	0.60	0.70	0.83	0.99
Outlet Damper, FC Fans	0.22	0.26	0.30	0.37	0.45	0.54	0.65	0.77	0.91	1.06
Eddy Current Drives	0.17	0.20	0.25	0.32	0.41	0.51	0.63	0.76	0.90	1.04
Inlet Guide Vane, FC Fans	0.21	0.22	0.23	0.26	0.31	0.39	0.49	0.63	0.81	1.04
VFD with duct static pressure controls	0.09	0.10	0.11	0.15	0.20	0.29	0.41	0.57	0.76	1.01
VFD with low/no duct static pressure	0.05	0.06	0.09	0.12	0.18	0.27	0.39	0.55	0.75	1.00

Provided below is the resultant values based upon the defaults provided above:

Control Type	$\sum_{0\%}^{100\%} (\%FF \times PLR_{Base})$
No Control or Bypass Damper	1.00
Discharge Dampers	0.80
Outlet Damper, BI & Airfoil Fans	0.78
Inlet Damper Box	0.69
Inlet Guide Vane, BI & Airfoil Fans	0.63
Inlet Vane Dampers	0.53
Outlet Damper, FC Fans	0.53
Eddy Current Drives	0.49
Inlet Guide Vane, FC Fans	0.39
VFD with duct static pressure controls	0.30
VFD with low/no duct static pressure	0.27

$IE_{energy}$  = HVAC interactive effects factor for energy (default = 15.7%)

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$kW_{Base} = \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times PLR_{Base,FFpeak}$$

$$kW_{Retrofit} = \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times PLR_{Retrofit,FFpeak}$$

$$\Delta kW_{fan} = kW_{Base} - kW_{Retrofit}$$

$$\Delta kW_{total} = \Delta kW_{fan} \times (1 + IE_{demand})$$

Where:

- $kW_{Base}$  = Baseline summer coincident peak demand (kW)
- $kW_{Retrofit}$  = Retrofit summer coincident peak demand (kW)
- $\Delta kW_{fan}$  = Fan-only summer coincident peak demand impact
- $\Delta kW_{total}$  = Total project summer coincident peak demand impact
- $PLR_{Base,FFpeak}$  = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the baseline flow control type (default average flow fraction during peak period = 90%)
- $PLR_{Retrofit,FFpeak}$  = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the retrofit flow control type (default average flow fraction during peak period = 90%)

$IE_{demand}$  = HVAC interactive effects factor for summer coincident peak demand  
(default = 15.7%)

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

There are no expected fossil fuel impacts for this measure.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-VSDF-V06-210101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.27 Energy Recovery Ventilator

### DESCRIPTION

This measure includes the addition of energy recovery equipment on existing or new unitary equipment, where energy recovery is not required by the IECC 2012/2015/2018. This measure analyzes the heating and cooling savings potential from recovering energy from exhaust or relief building air. This measure assumes that during unoccupied hours of the building no exhaust or relief air is available for energy recovery.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Efficient equipment is unitary equipment that incorporates energy recovery not required by the IECC 2012/2015/2018.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is unitary equipment not required by IECC 2012/2015/2018 to incorporate energy recovery.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the domestic energy recovery equipment is 15 years.<sup>610</sup>

### DEEMED MEASURE COST

The incremental cost for this measure assumes cost of cabinet and controls incorporated into packaged and built up air handler units. Additionally, it assumes a 1 to 1 ratio of fresh and exhausted air.

Energy Recovery Equipment Type	Incremental Cost \$/CFM <sup>611</sup>
Plate Heat Exchanger	\$3.75
Rotary Wheel	\$3.75
Heat Pipe	\$3.75

### DEEMED O&M COST ADJUSTMENTS

There are no expected O&M savings associated with this measure.

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

<sup>610</sup> Assumed service life limited by controls -" Demand Control Ventilation Using CO2 Sensors", pg. 19, by US Department of Energy Efficiency and Renewable Energy.

<sup>611</sup> "National Cost-Effectiveness of ASHRAE Standard 90.1-2010 Compared to ASHRAE Standard 90.1-2007", PNNL, November 2007 (page 4-16).

**Algorithm**

**CALCULATION OF ENERGY SAVINGS ELECTRIC ENERGY SAVINGS**

The electric energy savings calculation here represents the net electric energy savings from reduced cooling requirements after accounting for increased fan power caused by additional pressure drop from the ERV device. These savings do not account for heating energy savings in HVAC systems using heat pumps or electric resistance heat. This calculation does not apply to wheel-type devices with purge sections, or to sensible-only devices such as heat pipes.

- $\Delta kWh$  = (cfm) \* Normalized Electric Energy Savings
- cfm = design supply air flow of energy recovery ventilator in cubic feet per minute  
= rated energy recovery ventilator supply air flow \* (1 – Exhaust Air Transfer Ratio)
- Exhaust Air Transfer Ratio = percentage of supply air made up of cross-leakage from exhaust air; value provided by vendor  
= 0.05 (default)

Normalized Electric Energy Savings

= kWh/cfm savings value for the expected energy savings (net of fan energy penalty) as detailed in Table 1 – Electric Energy Savings Summary (kWh/cfm)

**Table 1 – Electric Energy Savings Summary (kWh/cfm)<sup>612</sup>**

Building Type	Normalized Electricity Savings (kWh/OA cfm)				
	Zone 1 - Rockford	Zone 2 - Chicago	Zone 3 - Springfield	Zone 4 - Mt. Vernon/Belleville	Zone 5 - Marion
<b>Enthalpy Wheel - 75% sensible and latent effectiveness</b>					
Assembly	NA	NA	NA	0.107	0.229
Education	NA	NA	0.371	0.245	0.369
Grocery	NA	NA	0.239	0.523	0.630
Healthcare	1.551	1.594	2.508	2.999	3.077
Multifamily	2.178	2.566	3.781	4.746	5.029
Office	0.974	1.169	2.379	2.998	3.194
Retail	0.048	0.124	0.389	1.027	1.063
<b>Enthalpy Plate - 50% sensible and latent effectiveness</b>					
Assembly	NA	NA	NA	NA	NA
Education	NA	NA	NA	NA	0.035
Grocery	NA	NA	NA	0.002	0.102
Healthcare	0.923	0.963	1.548	1.841	1.908
Multifamily	0.627	0.908	1.450	2.341	2.509
Office	0.309	0.487	1.321	1.705	1.918
Retail	NA	NA	NA	0.398	0.435

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

- $\Delta kW$  = (cfm) \* Normalized Electric Peak Demand Savings \* CF
- = design supply air flow of energy recovery ventilator in cubic feet per minute

<sup>612</sup> Energy savings modeled using IL TRM energy models with added energy recovery wheels or enthalpy plates. Energy recovery device specifications based on product data from the AHRI Certification Directory (<https://www.ahridirectory.org/Search/SearchHome?ReturnUrl=%2f>). See reference “ERV Effectiveness AHRI Directory Survey.”

= rated energy recovery ventilator supply air flow \* (1 – Exhaust Air Transfer Ratio)

Exhaust Air Transfer Ratio = percentage of supply air made up of cross-leakage from exhaust air; value provided by vendor

= 0.05 (default)

CF = 1.0

Normalized Electric Peak Demand Savings

= kW/cfm savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 2 – Electric Peak Demand Savings Summary (kW/cfm)

**Table 2 – Electric Peak Demand Savings Summary (kW/cfm)<sup>613</sup>**

Building Type	Normalized Electric Demand Savings (kW/OA cfm)				
	Zone 1 - Rockford	Zone 2 - Chicago	Zone 3 - Springfield	Zone 4 - Mt. Vernon/Belleville	Zone 5 - Marion
<b>Enthalpy Wheel - 75% sensible and latent efficiency</b>					
Assembly	0.00127	0.00092	0.00111	0.00213	0.00209
Education	0.00159	0.00164	0.00282	0.00202	0.00308
Grocery	0.00115	0.00159	0.00152	0.00153	0.00187
Healthcare	0.00465	0.00433	0.00480	0.00443	0.00443
Multifamily	0.00210	0.00325	0.00298	0.00370	0.00381
Office	0.00538	0.00518	0.00527	0.00529	0.00589
Retail	0.00156	0.00195	0.00020	0.00217	0.00223
<b>Enthalpy Plate - 50% sensible and latent efficiency</b>					
Assembly	NA	NA	0.00024	0.00115	0.00113
Education	0.00114	0.00118	0.00201	0.00142	0.00218
Grocery	0.00059	0.00089	0.00083	0.00079	0.00102
Healthcare	0.00287	0.00284	0.00306	0.00292	0.00275
Multifamily	NA	0.00128	0.00111	0.00172	0.00167
Office	0.00351	0.00344	0.00344	0.00345	0.00384
Retail	0.00087	0.00123	0.00001	0.00119	0.00124

**NATURAL GAS SAVINGS**

Gas savings algorithm is derived from the following:

$$\Delta\text{Therms} = (\text{Design Heating Load} * \text{TE\_ERV} * \text{EFLH} * \text{OccHours}/24) / (100,000 * \mu\text{Heat})$$

Where:

$$\text{Design Heating Load} = (1.08 * \text{CFM} * \Delta\text{T})$$

1.08 = A constant for sensible heat equations (BTU/h/CFM.°F)

CFM = Cubic Feet per Minute of Energy Recovery Ventilator

$$\Delta\text{T} = \text{T\_RA} - \text{T\_DD}$$

<sup>613</sup> Demand savings modeled using IL TRM energy models with added energy recovery wheels or enthalpy plates. Energy recovery device specifications based on product data from the AHRI Certification Directory (<https://www.ahridirectory.org/Search/SearchHome?ReturnUrl=%2f>). Coincident demand measured according to TRM guidelines, though in 1-hour increments as established by the eQUEST simulation.

T\_RA = Temperature of the Return Air = 70°F or custom  
 T\_DD = Temperature on design day of outside air<sup>614</sup>  
 = (see Table below) or custom

Zone	Weather Station	T_DD, Temperature, °F
1	Greater Rockford	-5.8
2	Chicago/O’Hare ARPT.	-1.5
3	Springfield/Capital	0.4
4	Scott AFB MidAmerica	9.0
5	Cape Girardeau Regional	9.7
Average	-	2.4

TE\_ERV = Thermal Effectiveness of Energy Recovery Equipment<sup>615</sup>  
 = (see Table below) or custom

Heat Recovery Equipment Type	TE_ERV (%)
Fixed Plate	0.65
Rotary Equipment	0.68
Heat Pipe	0.55

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

OccHours = Average Hours per day facility is occupied  
 = custom or use Modeling Inputs in eQuest models:

	Weekday	Saturday	Sunday	Holiday	Annual Operating Hours	OccHours
Assembly/Convention Center	10am-9pm	10am-9pm	10am-9pm	closed	3905	10.7
Assisted Living	24/7	24/7	24/7	24/7	8760	24.0
College	8am-9pm	closed	closed	closed	3263	8.9
Convenience Store	7am-10pm	9am-9pm	10am-5pm	10am-5pm	4823	13.2
Elementary School	8am-4pm (20% in summer)	closed	closed	closed	1606	4.4
Garage	7am-5pm	8am-12pm	closed	closed	3342	9.1
Grocery	7am-9pm	7am-9pm	9am-8pm	closed	4814	13.2
Healthcare Clinic	7am-7pm	9am-5pm	closed	closed	3428	9.4
High School	8am-4pm (20% in summer)	closed	closed	closed	1606	4.4
Hospital	24/7	24/7	24/7	24/7	8760	24.0
Motel	24/7	24/7	24/7	24/7	8760	24.0
Manufacturing Facility (Light Industry)	Mfg: 6am-10pm, Office: 8am-5pm	Mfg: 6am-10pm, Office: closed	closed	closed	4848	13.3
Multi-Family Mid-Rise	24/7; Reduced occupancy 7am - 5pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	7038	19.3

<sup>614</sup>Weather Station Data, 99.6% Heating DB - 2013 Fundamentals, ASHRAE Handbook

<sup>615</sup>Energy Recovery Fact Sheet - Center Point Energy, MN



	Weekday	Saturday	Sunday	Holiday	Annual Operating Hours	OccHours
Multi-Family High-Rise	24/7; Reduced occupancy 7am - 5pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	7038	19.3
Movie Theater	10am-Midnight	10am-Midnight	10am-Midnight	10am-Midnight	5110	14.0
Office - Low-rise	8am-5pm	closed	closed	closed	2259	6.2
Office - Mid-rise	8am-5pm	20% 8am-noon	closed	closed	2301	6.3
Office - High-rise	8am-5pm	20% 8am-noon	closed	closed	2301	6.3
Religious Building	Office: 8am-5pm, other: closed	closed	8am-1pm	closed	260	0.7
Restaurant	7am-8pm	7am-8pm	7am-8pm	closed	4615	12.6
Retail - Department Store	9am-9pm	9am-9pm	10am-5pm	10am-5pm	4070	11.1
Retail - Strip Mall	9am-9pm	9am-9pm	10am-5pm	10am-5pm	4070	11.1
Warehouse (Conditioned Storage)	7am-7pm	7am-7pm (reduced occupancy)	closed	closed	3324	9.1

$\mu$ Heat = Efficiency of heating system  
 = Actual

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-ERVE-V04-200101**

**REVIEW DEADLINE: 1/1/2023**

## 4.4.28 Stack Economizer for Boilers Serving HVAC Loads

### MEASURE DESCRIPTION

Stack economizers are designed to recover heat from hot boiler flue gasses. Recovered heat is used to preheat boiler feed water. This measure describes the retrofit of HVAC boilers with stack economizers. HVAC boilers are defined as those used for space heating applications. There is another, similar measure for boilers that serve process loads.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the economizer must be installed on a boiler exhaust stack. Heat captured by the economizer is to be used to pre-heat boiler feed water.

### DEFINITION OF BASELINE EQUIPMENT

The baseline boiler does not have an economizer installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the boiler stack economizer is 15 years.<sup>616</sup>

### DEEMED MEASURE COST

The incremental and full measure cost for this measure is custom.

### DEEMED O&M COST ADJUSTMENTS

The O&M cost for this measure is custom.

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---



---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS SAVINGS

$$\Delta\text{therms} = \text{SF} * \text{MBH}_{\text{In}} * \text{EFLH} / 100$$

Where:

---

<sup>616</sup> PA Consulting, Focus on Energy Evaluation, Business Programs: Measure Life Study, August 25, 2009.

SF = Savings factor  
 = calculated custom as  $(T_{\text{existing}} - T_{\text{eff}}) / 40^{\circ}\text{F} * \text{TRE}$  or when not possible a default value based on the table below

Where:

$T_{\text{existing}}$  = Existing Full Fire Boiler Flue Gas Temperature as it exits the Stack<sup>617</sup>  
 = 425F (water, 81.9% eff) or custom  
 = 480F (steam, 80.7% eff) or custom

$T_{\text{eff}}$  = Efficient Full Fire Boiler Flue Gas Temperature as it exits the Stack  
 = 338°F (conventional economizer – Water Boiler)<sup>618</sup> or custom  
 = 365°F (conventional economizer – Steam Boiler)<sup>619</sup> or custom  
 = 280°F (condensing economizer – Water Boiler)<sup>620</sup> or custom  
 = 308°F (condensing economizer – Steam Boiler)<sup>621</sup> or custom

TRE = % efficiency increase for 40°F of stack temperature reduction  
 = 1%,<sup>622</sup> or custom

Based on defaults provided above:

Boiler Type	SF <sup>623</sup>	
	Conventional Economizer	Condensing Economizer
Hot Water Boiler	2.19% average SF or custom	3.63% average SF or custom
Steam Boiler	2.88% average SF or custom	4.31% average SF or custom

MBH<sub>In</sub> = Rated boiler input capacity, in MBH

= Actual

EFLH = Equivalent Full Load Hours for heating are provided in Section 4.4 HVAC End Use

<sup>617</sup> Cleaver Brooks. March 2012, Boiler Efficiency Guide, Pg. 7, Figure 1.

<sup>618</sup> The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(425^{\circ}\text{F} + 250^{\circ}\text{F}) / 2 = 338^{\circ}\text{F}$ .

<sup>619</sup> The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(480^{\circ}\text{F} + 250^{\circ}\text{F}) / 2 = 365^{\circ}\text{F}$ .

<sup>620</sup> The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(425^{\circ}\text{F} + 135^{\circ}\text{F}) / 2 = 280^{\circ}\text{F}$ .

<sup>621</sup> The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(480^{\circ}\text{F} + 135^{\circ}\text{F}) / 2 = 308^{\circ}\text{F}$ .

<sup>622</sup> United States EPA, Climate Wise: Wise Rules for Industrial Efficiency, July 1998. The Wise Rules indicate savings range of 1-2% per 40°F reduction, so utilizing 1% is a conservative approach.

<sup>623</sup> These average values should be utilized in absence of actual temperature data. An economizer with a zero temperature change between the existing and the efficient temperatures would not be installed, so these average values are conservative.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Depending on design, stack economizers may require routine maintenance for optimal performance. A custom calculation should be used as necessary.

**MEASURE CODE: CI-HVC-BECO-V02-210101**

**REVIEW DEADLINE: 1/1/2025**

## 4.4.29 Stack Economizer for Boilers Serving Process Loads

### MEASURE DESCRIPTION

Stack economizers are designed to recover heat from hot boiler flue gasses. Recovered heat is used to preheat boiler feed water. This measure describes the retrofit of process boilers with stack economizers. Process boilers are defined as those used for industrial, manufacturing, or other non-HVAC applications. There is another, similar measure for boilers that serve HVAC loads.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the economizer must be installed on a boiler exhaust stack. Heat captured by the economizer is to be used to pre-heat boiler feed water.

### DEFINITION OF BASELINE EQUIPMENT

The baseline boiler does not have an economizer installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the boiler stack economizer is 15 years.<sup>624</sup>

### DEEMED MEASURE COST

The incremental and full measure cost for this measure is custom.

### DEEMED O&M COST ADJUSTMENTS

The O&M cost for this measure is custom.

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

#### NATURAL GAS SAVINGS

$$\Delta \text{therms} = \text{SF} * \text{MBH\_In} * 8766 * \text{UF} / 100$$

---

<sup>624</sup> PA Consulting, Focus on Energy Evaluation, Business Programs: Measure Life Study, August 25, 2009.

Where:

SF =  $(T_{\text{existing}} - T_{\text{eff}}) / 40^{\circ}\text{F} * \text{TRE}$

= see default Savings Factor table below

T<sub>existing</sub> = Existing Full Fire Boiler Flue Gas Temperature as it exits the Stack<sup>625</sup>

= 425°F (water, 81.9% eff per IL TRM) or custom

= 480°F (steam, 80.7% eff per IL TRM) or custom

T<sub>eff</sub> = Efficient Full Fire Boiler Flue Gas Temperature as it exits the Stack

= 338°F (conventional economizer – Water Boiler)<sup>626</sup> or custom

= 365°F (conventional economizer – Steam Boiler)<sup>627</sup> or custom

= 280°F (condensing economizer – Water Boiler)<sup>628</sup> or custom

= 308°F (condensing economizer – Water Boiler)<sup>629</sup> or custom

TRE = % efficiency increase for 40°F of stack temperature reduction

= 1%,<sup>630</sup> or custom

Based on defaults provided above:

Boiler Type	SF <sup>631</sup>	
	Conventional Economizer	Condensing Economizer
Hot Water Boiler	2.19% average SF or custom	3.63% average SF or custom
Steam Boiler	2.88% average SF or custom	4.31% average SF or custom

MBH<sub>In</sub> = Rated boiler input capacity, in MBH

= Actual

8766 = Hours a year

<sup>625</sup> Cleaver Brooks. March 2012, Boiler Efficiency Guide, Pg. 7, Figure 1.

<sup>626</sup> The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(425^{\circ}\text{F} + 250^{\circ}\text{F}) / 2 = 338^{\circ}\text{F}$ .

<sup>627</sup> The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(480^{\circ}\text{F} + 250^{\circ}\text{F}) / 2 = 365^{\circ}\text{F}$ .

<sup>628</sup> The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(425^{\circ}\text{F} + 135^{\circ}\text{F}) / 2 = 280^{\circ}\text{F}$ .

<sup>629</sup> The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum,  $(480^{\circ}\text{F} + 135^{\circ}\text{F}) / 2 = 308^{\circ}\text{F}$ .

<sup>630</sup> United States EPA, Climate Wise: Wise Rules for Industrial Efficiency, July 1998. The Wise Rules indicate savings range of 1-2% per 40°F reduction, so utilizing 1% is a conservative approach.

<sup>631</sup> These average values should be utilized in absence of actual temperature data. An economizer with a zero temperature change between the existing and the efficient temperatures would not be installed, so these average values are conservative.

UF = Utilization Factor  
= 41.9%,<sup>632</sup> or custom

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-PECO-V01-150601**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>632</sup> Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

### 4.4.30 Notched V Belts for HVAC Systems

#### MEASURE DESCRIPTION

This measure is for replacement of smooth v-belts in non-residential package and split HVAC systems with notched v-belts or for installing new equipment with synchronous belts instead of smooth v-belts. Typically there is a v-belt between the motor and the supply air fan and/or return air fan in larger package and split HVAC systems (RTU).

In general there are two styles of grooved v-belts, notched and synchronous. The DOE defines each as follows;

**Notched V-Belts** - A notched belt has grooves or notches that run perpendicular to the belt's length, which reduces the bending resistance of the belt. Notched belts can use the same pulleys as cross-section standard V-belts. They run cooler, last longer, and are about 2% more efficient than standard V-belts.

**Synchronous Belts** - Synchronous belts (also called cogged, timing, positive-drive, or high-torque drive belts) are toothed and require the installation of mating grooved sprockets. These belts operate with a consistent efficiency of 98% and maintain their efficiency over a wide load range.

Smooth v-belts are usually referred to in five basic groups:

- "L" belts are low end belts that are for small, fractional horsepower motors and these are not used in RTUs.
- "A" and "B" belts are the two types typically used in RTUs. The "A" belt is a ½ inch width by 5/16 inch thickness and the "B" belt is larger, 21/32 inch wide and 12/32 inch thick so it can carry more power. V-belts come in a wide variety of lengths where 20 to 100 inches is typical.
- "C" and "D" belts are primarily for industrial applications with high power transmission requirements.
- V-belts are provided by various vendors. The notched version of these belts typically have an "X" added to the designation. For this HVAC fans notched v-belt Replacement measure, only the "A" and "B" v-belts are considered. A typical "A" v-belt is replaced by a notched "AX" v-belt and a "B" is replaced by a "BX." In general, smooth v-belts have an efficiency of 90% to 98% while notched v-belts have an efficiency of 95% to 98%. Because notched v-belts are more flexible they work with smaller diameter pulleys and they have less resistance to bending. Lower bending resistance increases the power transmission efficiency, lowers the waste heat, and allows the belt to last longer than a smooth belt.

Three research papers<sup>633 634 635</sup> show that the notched v-belt efficiency is 2% to 5% better than a typical smooth v-belt. A fourth paper by USDOE's Energy Efficiency and Renewable Energy<sup>636</sup> group reviewed most of the earlier literature and recommended using a conservative 2% efficiency improvement for energy savings for calculations.

For this measure it is assumed that upgrading a standard smooth v-belt with a new notched v-belt will result in a fan energy reduction of 2%.

#### DEFINITION OF EFFICIENT EQUIPMENT

For the Notched V-Belt characterization to apply, the Efficient Equipment is HVAC RTUs that have notched v-belts installed on the supply and/or return air fans. This can be done as a retrofit, TOS, or NC project.

For the Synchronous Belt characterization to apply, the Efficient Equipment is HVAC RTUs that have synchronous belts installed on the supply and/or return air fans. This can be done as a TOS or NC project. Retrofit projects can also claim savings, but costs should be verified independently (typically the cost of installing synchronous belts as a retrofit is not economically viable).

<sup>633</sup> "Gates Corporation Announces New EPDM Molded Notch V-Belts," The Gates Rubber Co., June 2010 (Assumed 3% efficiency improvement).

<sup>634</sup> "Synchronous Belt Drives Offer Low Cost Energy Savings," Baldor. February 2009. (attached in Reference Documents).

<sup>635</sup> "Energy Savings from Synchronous Belts," The Gates Rubber Co., February 2014. (Assumed 5% efficiency improvement).

<sup>636</sup> "Motor System Tip Sheet #5, Replace V-Belts with Cogged or Synchronous Belt Drives," USDOE-EERE, September 2005. (Assumed 2% efficiency improvement).



### DEFINITION OF BASELINE EQUIPMENT

The Baseline Equipment is HVAC RTUs that have smooth v-belts installed on the supply and/or return air fans (i.e., RTU does not already have a notched v-belt installed).

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

A v-belt has a life based on fan run hours which varies by building type based primarily on occupancy schedule because the fans are required by code to operate continuously during occupied hours. The supply and return fans will also run a few hours during unoccupied hours for heating and cooling as needed. For the notched v-belt EUL calculation, the default hours in the following table are used for a variety of building types and HVAC applications.<sup>637</sup>

$$\text{EUL} = \text{Belt Life} / \text{Occupancy Hours per year}$$

Where:

$$\text{Belt Life} = 24,000 \text{ hours}^{638}$$

$$\text{Occupancy Hours per year} = \text{values from Table below}$$

The notched v-belt measure EUL is summarized by building type in the following table.

### Notched v-belt Effective Useful Life (EUL)

Building Type	Total Fan Run Hours	EUL (Years)	Model Source
Assembly	7235	3.3	eQuest
Assisted Living	8760	2.7	eQuest
Auto Dealership	7451	3.2	OpenStudio
College	4836	5.0	OpenStudio
Convenience Store	7004	3.4	eQuest
Drug Store	7156	3.4	OpenStudio
Elementary School	3765	6.4	OpenStudio
Emergency Services	8760	2.7	OpenStudio
Garage	7357	3.3	eQuest
Grocery	8543	2.8	OpenStudio
Healthcare Clinic	4314	5.6	OpenStudio
High School	3460	6.9	OpenStudio
Hospital - VAV econ	4666	5.1	OpenStudio
Hospital - CAV econ	8021	3.0	OpenStudio
Hospital - CAV no econ	7924	3.0	OpenStudio
Hospital - FCU	4055	5.9	OpenStudio
Manufacturing Facility	8706	2.8	eQuest
MF - High Rise	8760	2.7	OpenStudio
MF - Mid Rise	8760	2.7	OpenStudio
Hotel/Motel - Guest	2409	10.0	OpenStudio
Hotel/Motel - Common	8683	2.8	OpenStudio
Movie Theater	7505	3.2	eQuest
Office - High Rise - VAV econ	2369	10.1	OpenStudio
Office - High Rise - CAV econ	2279	10.5	OpenStudio
Office - High Rise - CAV no econ	5303	4.5	OpenStudio

<sup>637</sup> ComEd Trm June 1, 2010 page 139. The Office hours is based upon occupancy from the eQuest model developed for EFLH, since it was agreed the ComEd value was too low.

<sup>638</sup> "DEER2014-EUL-table-update\_2014-02-05.xlsx," Database for Energy Efficiency Resources (DEER), DEER2014 EUL Table. (attached in Reference Documents).

Building Type	Total Fan Run Hours	EUL (Years)	Model Source
Office - High Rise - FCU	1648	14.6	OpenStudio
Office - Low Rise	6345	3.8	OpenStudio
Office - Mid Rise	3440	7.0	OpenStudio
Religious Building	7380	3.3	eQuest
Restaurant	7302	3.3	OpenStudio
Retail - Department Store	7155	3.4	OpenStudio
Retail - Strip Mall	6921	3.5	OpenStudio
Warehouse	6832	3.5	OpenStudio
Unknown	6241	3.8	n/a

The lifetime of a synchronous belt system is the same as the lifetime of the equipment it is installed on because it is a permanent upgrade, involving the installation of toothed pulleys. Typical HVAC RTU lifetime is 15 years, which applies to synchronous belts as well. This is not to suggest that the actual belt component has an equivalent lifetime because they do require replacement. However, their O&M cost savings (derived from not having to tension, etc.) are assumed to offset the replacement cost of the belt, resulting in a net cost of zero. As a result, neither a separate lifetime nor O&M savings are quantified for synchronous belts and lifetime can therefore be considered as the lifetime of the equipment they're installed on because it would not be possible to install a traditional or notched belt on the synchronous pulleys.

**DEEMED MEASURE COST**

A review of the Grainger online pricing for “A,” “B,” “AX,” and “BX” v-belts<sup>639</sup> showed the incremental cost to upgrade to notched v-belts would result in a 28% price increase. The notched v-belt incremental cost is summarized in the table below:

**Notched V-belt Incremental Cost Summary**

Smooth V-Belt Industry Number	Outside Length (Inches)	Dayton Smooth V-Belt*	Notched V-belt Industry Number	Dayton Notched v-belt*	Price Increase	% Increase
A30 (Item # 1A095)	32	\$12.70	AX29 (Item # 3GWU4)	\$17.65	\$4.95	28%
B29 (Item # 6L208)	32	\$16.75	BX29 (Item # 5TXL4)	\$23.23	\$6.48	28%
* Pricing based on Dayton Belts as found on Grainger Website 10/30/14						

Note that the incremental cost for notched V-Belts assumes that the notched belt is purchased and installed instead of a smooth v-belt. There is no difference in the cost of installation, only the material.

**Synchronous Belt Incremental Cost Summary**

Smooth V-Belt Industry Number	Smooth belt system Price*	Synchronous Belt Industry Number	Synchronous System Price*	Price Difference
Belt A30 (Item # 1A095)	\$12.70	Belt 1DHL5 (Item # 322L050)	\$20.51	\$7.81
Gearbelt pulley BK47 (Item #5UHD5)	\$45.90	Gearbelt sprocket GTR-36G-8M-12 (Item # 2UWH6)	\$113.00	\$67.10
* Costs based on Grainger pricing.				

<sup>639</sup> Grainger catalog on-line web-site for Dayton v-belt pricing.

Incremental cost for a NC or TOS project is \$142. This is the price of synchronous equipment (belt, two sprockets) subtract v-belt equipment (belt, two pulleys). Labor cost is assumed to be equal in the baseline and efficient cases.

Incremental cost for a RF project is \$383.81. This is the price of synchronous equipment and labor to install it<sup>640</sup> (not including a trip charge), less the cost of the v-belt (but not the pulleys).

**DEEMED O&M COST ADJUSTMENTS**

N/A

**LOADSHAPE**

Loadshape C05 - Commercial Electric Heating and Cooling

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = kW_{connected} * Hours * ESF$$

Where:

$kW_{Connected}$  =kW of equipment is calculated using motor efficiency<sup>641</sup>  
 = (HP \* 0.746 kW/HP\* Load Factor)/Motor Efficiency

Load Factor =Motors are assumed to have a load factor of 80% for calculating KW if actual values cannot be determined.<sup>642</sup> Custom load factor may be applied if known.

Motor Efficiency = Actual motor efficiency shall be used to calculate KW. If not known a value from the motor efficiency reference tables below should be used.<sup>643</sup> Default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor

---

<sup>640</sup> Assumed to be \$150 based on mechanical contractor estimate.

<sup>641</sup> Note that kW<sub>Connected</sub> may be determined using various methodologies. The examples provided use rated HP and assumed load factor. Other methodologies include rated voltage and full load current with assumed load factor, or actual measured voltage and current.

<sup>642</sup> Com Ed TRM June 1, 2010.

<sup>643</sup> Efficiency values for motors less than one HP taken from Baldor Electric Catalog 501, standard motor product catalog.

Baseline Motor Efficiencies (EPACT)						
Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles					
	6	4	2	6	4	2
	Speed (RPM)					
	1200	1800	3600	1200	1800	3600
1/8	-	44.00%	-	-	-	-
1/6	57.50%	62.00%	-	-	-	-
1/4	68.00%	68.00%	-	68.00%	64.00%	-
1/3	70.00%	70.00%	72.00%	70.00%	68.00%	72.00%
1/2	78.50%	80.00%	68.00%	72.00%	74.00%	68.00%
3/4	77.00%	78.50%	74.00%	77.00%	75.50%	74.00%
1	80.00%	82.50%	75.50%	80.00%	82.50%	75.50%
1.5	84.00%	84.00%	82.50%	85.50%	84.00%	82.50%
2	85.50%	84.00%	84.00%	86.50%	84.00%	84.00%
3	86.50%	86.50%	84.00%	87.50%	87.50%	85.50%
5	87.50%	87.50%	85.50%	87.50%	87.50%	87.50%
7.5	88.50%	88.50%	87.50%	89.50%	89.50%	88.50%
10	90.20%	89.50%	88.50%	89.50%	89.50%	89.50%
15	90.20%	91.00%	89.50%	90.20%	91.00%	90.20%
20	91.00%	91.00%	90.20%	90.20%	91.00%	90.20%
25	91.70%	91.70%	91.00%	91.70%	92.40%	91.00%

Efficient Motor Efficiencies (NEMA Premium)						
Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles					
	2	4	6	2	4	6
	Speed (RPM)					
	1200	1800 (Default)	3600	1200	1800	3600
0.125 *	-	44.00%	-	-	-	-
1/6	57.50%	62.00%	-	-	-	-
1/4	68.00%	68.00%	-	68.00%	64.00%	-
1/3	70.00%	70.00%	72.00%	70.00%	68.00%	72.00%
1/2	78.50%	80.00%	68.00%	72.00%	74.00%	68.00%
3/4	77.00%	78.50%	74.00%	77.00%	75.50%	74.00%
1	82.50%	85.50%	77.00%	82.50%	85.50%	77.00%
1.5	86.50%	86.50%	84.00%	87.50%	86.50%	84.00%
2	87.50%	86.50%	85.50%	88.50%	86.50%	85.50%
3	88.50%	89.50%	85.50%	89.50%	89.50%	86.50%
5	89.50%	89.50%	86.50%	89.50%	89.50%	88.50%
7.5	90.20%	91.00%	88.50%	91.00%	91.70%	89.50%
10	91.70%	91.70%	89.50%	91.00%	91.70%	90.20%
15	91.70%	93.00%	90.20%	91.70%	92.40%	91.00%
20	92.40%	93.00%	91.00%	91.70%	93.00%	91.00%
25	93.00%	93.60%	91.70%	93.00%	93.60%	91.70%

Hours = When available, actual hours should be used. If actual hours are not available, default hours are provided in table below for HVAC fan operation<sup>644</sup>, which varies by building type:

Building Type	Total Fan Run Hours	Model Source
Assembly	7235	eQuest
Assisted Living	8760	eQuest
Auto Dealership	7451	OpenStudio
College	4836	OpenStudio
Convenience Store	7004	eQuest
Drug Store	7156	OpenStudio
Elementary School	3765	OpenStudio
Emergency Services	8760	OpenStudio
Garage	7357	eQuest
Grocery	8543	OpenStudio
Healthcare Clinic	4314	OpenStudio
High School	7879	eQuest
Hospital - VAV econ	4666	OpenStudio
Hospital - CAV econ	8021	OpenStudio
Hospital - CAV no econ	7924	OpenStudio
Hospital - FCU	4055	OpenStudio
Manufacturing Facility	8706	eQuest
MF - High Rise	8760	OpenStudio
MF - Mid Rise	8760	OpenStudio
Hotel/Motel - Guest	2409	OpenStudio
Hotel/Motel - Common	8683	OpenStudio
Movie Theater	7505	eQuest
Office - High Rise - VAV econ	2369	OpenStudio
Office - High Rise - CAV econ	2279	OpenStudio
Office - High Rise - CAV no econ	5303	OpenStudio
Office - High Rise - FCU	1648	OpenStudio
Office - Low Rise	6345	OpenStudio
Office - Mid Rise	3440	OpenStudio
Religious Building	7380	eQuest
Restaurant	7302	OpenStudio
Retail - Department Store	7155	OpenStudio
Retail - Strip Mall	6921	OpenStudio
Warehouse	6832	OpenStudio
Unknown	6241	n/a

ESF = Energy Savings Factor, the ESF for notched v-belt installation is assumed to be 2%  
 = the ESF for notched Synchronous Belt Installation is assumed to be 3.1%<sup>645</sup>

<sup>644</sup> Hours per year are estimated using the eQuest models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

<sup>645</sup> Based on information found in Advanced Manufacturing Office, US DOE, "Replace V-Belts with Notched or Synchronous Drives", (US Department of Energy Motor Systems Tip Sheet #5, DOE/GO-102012-3740, November 2012). V-belt drives can have a peak efficiency of 95% and synchronous belts operate at 98%, therefore ESF is  $(1-95\%/98\%) = 3.1\%$ .

**For example**, a notched v-belt installation in an low rise office building RTU with a 5 HP NEMA premium efficiency motor using the default hours of operation, motor load and 89.5% motor efficiency;

$$\begin{aligned} \Delta kWh &= kW_{\text{connected}} * \text{Hours} * \text{ESF} \\ &= ((\text{HP} * 0.746 \text{ kW/HP} * \text{Load Factor}) / \text{Motor Efficiency}) * \text{Hours} * \text{ESF} \\ &= ((5 \text{ HP} * 0.746 \text{ kW/HP} * 80\%) / 89.5\%) * 6288 * 2\% \\ &= 419 \text{ kWh Savings} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = kW_{\text{connected}} * \text{ESF}$$

Where:

$$\begin{aligned} kW_{\text{Connected}} &= \text{kW of equipment is calculated using motor efficiency.} \\ &= (\text{HP} * 0.746 \text{ kW/HP} * \text{Load Factor}) / \text{Motor Efficiency} \\ &\text{Variables as provided above} \end{aligned}$$

**For example**, an office building RTU with a 5 HP NEMA premium efficiency motor using the default motor load and 89.5% motor efficiency;

$$\begin{aligned} \Delta kW &= kW_{\text{connected}} * \text{ESF} \\ &= ((\text{HP} * 0.746 \text{ kW/HP} * \text{Load Factor}) / \text{Motor Efficiency}) * \text{ESF} \\ &= ((5 \text{ HP} * 0.746 \text{ kW/HP} * 80\%) / 89.5\%) * 2\% \\ &= 0.0667 \text{ kW Savings} \end{aligned}$$

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-NVBE-V05-200101**

**REVIEW DEADLINE: 1/1/2022**

### 4.4.31 Small Business Furnace Tune-Up

#### **DESCRIPTION**

This measure is for a natural gas Small Business furnace that provides space heating. The tune-up will improve furnace performance by inspecting, cleaning and adjusting the furnace and appurtenances for correct and efficient operation. Additional savings maybe realized through a complete system tune-up.

This measure was developed to be applicable to the following program types: Small business.

If applied to other program types, the measure savings should be verified.

#### **DEFINITION OF EFFICIENT EQUIPMENT**

To qualify for this measure an approved technician must complete the tune-up requirements listed below:<sup>646</sup>

- Measure combustion efficiency using an electronic flue gas analyzer
- Check and clean blower assembly and components per manufacturer's recommendations
- Where applicable Lubricate motor and inspect and replace fan belt if required
- Inspect for gas leaks
- Clean burner per manufacturer's recommendations and adjust as needed
- Check ignition system and safety systems and clean and adjust as needed
- Check and clean heat exchanger per manufacturer's recommendations
- Inspect exhaust/flue for proper attachment and operation
- Inspect control box, wiring and controls for proper connections and performance
- Check air filter and clean or replace per manufacturer's
- Inspect duct work connected to furnace for leaks or blockages
- Measure temperature rise and adjust flow as needed
- Check for correct line and load volts/amps
- Check thermostat operation is per manufacturer's recommendations (if adjustments made, refer to 'Small Commercial Programmable Thermostat Adjustment' measure for savings estimate)
- Perform Carbon Monoxide test and adjust heating system until results are within standard industry acceptable limits

#### **DEFINITION OF BASELINE EQUIPMENT**

The baseline is furnace assumed not to have had a tune-up in the past 3 years.

#### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life for the tune up is 3 years.<sup>647</sup>

#### **DEEMED MEASURE COST**

The incremental cost for this measure should be the actual cost of tune up.

#### **DEEMED O&M COST ADJUSTMENTS**

There are no expected O&M savings associated with this measure.

---

<sup>646</sup> American Standard Heating & Air Conditioning, Maintenance for Indoor Units

<sup>647</sup> Assumed consistent with other tune-up measures.

**LOADSHAPE**

Loadshape C04 - Commercial Electric Heating

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithms**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta\text{kWh} = \Delta\text{Therms} * F_e * 29.3$$

Where:

$$\Delta\text{Therms} = \text{as calculated below}$$

$$F_e = \text{Furnace Fan energy consumption as a percentage of annual fuel consumption} \\ = 3.14\%^{648}$$

$$29.3 = \text{kWh per therm}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = (\text{Capacity} * \text{EFLH} * (((\text{Effbefore} + E_i) / \text{Effbefore}) - 1)) / 100,000$$

Where:

$$\text{Capacity} = \text{Furnace gas input size (Btu/hr)} \\ = \text{Actual}$$

$$\text{EFLH} = \text{Equivalent Full Load Hours for heating in Existing Buildings are provided} \\ \text{in section 4.4 HVAC End Use}$$

$$\text{Effbefore} = \text{Efficiency of the furnace before the tune-up} \\ = \text{Actual}$$

*Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the heating season and take readings at a consistent firing rate for pre and post tune-up.*

$$E_i = \text{Efficiency Improvement of the furnace tune-up measure} \\ = \text{Actual}$$

$$100,000 = \text{Converts Btu to therms}$$

---

<sup>648</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the Energy Star version 3 criteria for 2%  $F_e$ . See "Programmable Thermostats Furnace Fan Analysis.xlsx" for reference.



**For example**, a 200 kBtu furnace in a Rockford low rise office records an efficiency prior to tune up of 82% AFUE and a 1.8% improvement in efficiency are tune up:

$$\begin{aligned}\Delta\text{therms} &= (200,000 * 1428 * (((0.82 + 0.018)/ 0.82) - 1)) / 100,000 \\ &= 62.3 \text{ therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-FTUN-V03-200101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.32 Combined Heat and Power

### DESCRIPTION

The Combined Heat and Power (CHP) measure can provide energy savings within the State of Illinois through the development and operation of CHP projects. This measure is applicable for Conventional or Topping Cycle CHP systems, as well as Waste Heat-to-Power (WHP) or Bottoming Cycle CHP systems. The measure will reduce the total Btu’s of energy required to meet the end use needs of the facility.

It is recognized that CHP system design and configuration may be complex, and as such the calculation of energy savings may not be reducible to the equations within this measure. In such cases a more comprehensive engineering and financial analysis may be developed that more accurately incorporates the attributes of complex CHP configurations such as variable-capacity systems, and partial combined-cycle CHP systems. Where noted, the use of values that are determined through an external engineering analysis may be substituted by agreement between the participant, the program administrator and independent evaluator. This substitution of values does not eliminate ex post evaluation risk (retroactive adjustments to savings claims) that exists when using custom inputs.

This measure was developed to be applicable to the following program types: Retrofit (RF), New Construction (NC). If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Conventional or Topping Cycle CHP is defined as an integrated system that is located at or near the building or facility (on-site, on the customer side of the meter) that utilizes a prime mover (reciprocating engine, gas turbine, micro-turbine, fuel cell, boiler/steam turbine combination) for the purpose of generating electricity and useful thermal energy (such as steam, hot water, or chilled water) where the primary function of the facility where the CHP is located is not to generate electricity for use on the grid. An eligible system must demonstrate a minimum total system efficiency of 60% (HHV),<sup>649</sup> with at least 20% of the system’s total useful energy output in the form of useful thermal energy on an annual basis.

*Measuring and Calculating Conventional CHP Total System Efficiency:*

CHP efficiency is calculated using the following equation:

$$CHP_{Efficiency(HHV)} = \frac{\left[ CHP_{thermal} \left( \frac{kBtu}{yr} \right) + E_{CHP} \left( \frac{kWh}{yr} \right) * 3.412 \left( \frac{kBtu}{kWh} \right) \right]}{F_{totalCHP} \left( \frac{kBtu}{yr} \right)}$$

Where:

- CHP<sub>thermal</sub> = Useful annual thermal energy output from the CHP system, defined as the annual thermal energy output of the CHP system that is actually recovered and utilized in the facility/process.
- E<sub>CHP</sub> = Useful annual electricity output produced by the CHP system, defined as the annual electric energy output of the CHP system that is actually utilized to replace purchased electricity required to meet the requirements of the facility/process.
- F<sub>totalCHP</sub> = Total annual fuel consumed by the CHP system

For further definition of the terms, please see “Calculation of Energy Savings” Section below.

<sup>649</sup> Higher Heating Value (HHV): refers to the heating value of the fuel and is defined as the total thermal energy available, including the heat of condensation of water vapors, resulting from complete combustion of the fuel versus the Lower Heating Value (LHV), which assumes the heat of condensation is not available.

Waste Heat-to-Power or Bottoming Cycle CHP is defined as an integrated system that is located at or near the building or facility (on-site, on the customer side of the meter) that does one of the following:

- Utilizes exhaust heat from an industrial/commercial process to generate electricity (except for exhaust heat from a facility whose primary purpose is the generation of electricity for use on the grid); or
- Utilizes the pressure drop in an industrial/commercial facility to generate electricity through a backpressure steam turbine where the facility normally uses a pressure reducing valve (PRV) to reduce the pressure in their facility; or
- Utilizes the pressure reduction in natural gas pipelines (located at natural gas compressor stations) before the gas is distributed through the pipeline to generate electricity, provided that the conversion of energy to electricity is achieved without using additional fossil fuels.

Since these types of systems utilize waste heat as their fuel, they do not have to meet any specific total system efficiency level (assuming they use no additional fossil fuel in their operation) If additional fuel is used onsite, it should be accounted for using the following methodology:

- Treat the portion of Waste-Heat-to-Power that does not require any additional fuel using the Waste-Heat-to-Power methodology outlined in this document.
- Treat the portion of Waste-Heat-to-Power that requires additional fuel (if natural gas) using the Conventional CHP methodology outlined in this document. If the additional fuel is not natural gas, custom carbon equivalency calculations would be needed – refer to section “Calculation of Energy Savings” for more details.
- Add the energy savings together.

These systems may export power to the grid.

#### **DEFINITION OF BASELINE EQUIPMENT**

Electric Baseline: The baseline facility would be a facility that purchases its electric power from the grid.

Heating Baseline (for CHP applications that displace onsite heat): The baseline equipment would be the boiler/furnace operating onsite, or a boiler/furnace meeting the baseline equipment defined in the High Efficiency Boiler (Section 4.4.10)/Furnace (Section 4.4.11) measures of this TRM.

Cooling Baseline (for CHP applications that displace onsite cooling demands): The baseline equipment would be the chiller (or chillers) operating onsite, or a chiller (or chillers) meeting the definition of baseline equipment defined in the Electric Chiller (Section 4.4.6) measure of this TRM.

Facilities that use biogas or waste gas: Facilities that use (but are not purchasing) biogas or waste gas that is not otherwise used, whether they are using biogas or waste gas only or a combination of biogas or waste gas and natural gas to meet their energy demands are also eligible for this measure. If additional fuel is purchased to power the CHP system, then the additional natural gas should be taken into account using the following methodology:

- Treat the portion of CHP system that does not require any additional fuel, or that requires additional fuel that would otherwise be wasted (e.g., flared), using the Waste-Heat-to-Power methodology outlined in this document.
- Treat the portion of CHP that requires additional fuel (if natural gas) using the Conventional CHP methodology outlined in this document. If the additional fuel is not natural gas, custom carbon equivalency calculations would be needed – refer to section “Calculation of Energy Savings” for more details.
- Add the energy savings together.

Consumption of any biogas or waste gas that would not otherwise being wasted (e.g., flared) will be accounted for in the overall net BTU savings calculations the same as for purchased natural gas.

#### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

Measure life is a custom assumption, dependent on the technology selected and the system installation.

**DEEMED MEASURE COST**

Custom installation and equipment cost will be used. These costs should include the cost of the equipment and the cost of installing the equipment. Equipment costs include, but are not limited to: prime mover, heat recovery system(s), exhaust gas treatment system(s), controls, and any interconnection/electrical connection costs.

The installations costs include labor and material costs such as, but not limited to: labor costs, materials such as ductwork, piping, and wiring, project and construction management, engineering costs, commissioning costs, and other fees.

Measure costs will also include the present value of expected maintenance costs over the life of the CHP system.

**LOADSHAPE**

Use Custom Loadshape. The loadshape should be obtained from the actual CHP operation strategy, based on the On-Peak and Off-Peak Energy definitions specified in Table 3.3 of “Section 3.5 Electrical Loadshapes” of the TRM.

**COINCIDENCE FACTOR**

Custom coincidence factor will be used. Actual value based on the CHP operation strategy will be used.

---



---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**i) Conventional or Topping Cycle CHP Systems:**

**Step 1: (Calculating Total Annual Source Fuel Savings in Btus)**

The first step is to calculate the total annual source fuel savings associated with the CHP installation, in order to ensure the CHP project produces positive total annual source fuel savings (i.e., reduction in source Btus):

$$S_{\text{FuelCHP}} = \text{Annual fuel savings (Btu) associated with the use of a Conventional CHP system to generate the useful electricity output (kWh, converted to Btu) and useful thermal energy output (Btu) versus the use of the equivalent electricity generated and delivered by the local grid and the equivalent thermal energy provided by the onsite boiler/furnace.}$$

$$= (F_{\text{grid}} + F_{\text{thermalCHP}}) - F_{\text{total CHP}}$$

Where:

$$F_{\text{grid}} = \text{Annual fuel in Btu that would have been used to generate the useful electricity output of the CHP system if that useful electricity output was provided by the local utility grid.}$$

$$= E_{\text{CHP}} * H_{\text{grid}}$$

Where:

$$E_{\text{CHP}} = \text{Useful annual electricity output produced by the CHP system, defined as the annual electric energy output of the CHP system that is actually utilized to replace purchased electricity required to meet the requirements of the facility/process.}^{650}$$

$$= ( \text{CHP}_{\text{capacity}} * \text{Hours} ) - E_{\text{Parasitic}}$$

$$\text{CHP}_{\text{capacity}} = \text{CHP nameplate capacity}$$

$$= \text{Custom input}$$

---

<sup>650</sup> For complex systems this value may be obtained from a CHP System design/financial analysis study.

Hours = Annual operating hours of the system  
 = Custom input

$E_{\text{parasitic}}$  = The electricity required to operate the CHP system that would otherwise not be required by the facility/process  
 = Custom input

$H_{\text{grid}}$  = Heat rate of the grid in Btu/kWh, based on the average fossil heat rate for the EPA eGRID subregion, adjusted to take into account T&D losses.

For systems operating less than 6,500 hrs per year:

Use the Non-baseload heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest).<sup>651</sup> Also include any line losses.

For systems operating more than 6,500 hrs per year:

Use the All Fossil Average heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest). Also include any line losses.

$F_{\text{thermalCHP}}$  = Annual fuel in Btu that would have been used on-site by a boiler/furnace to provide the useful thermal energy output of the CHP system.<sup>652</sup>

=  $\text{CHP}_{\text{thermal}} / \text{Boiler}_{\text{eff}}$  (or  $\text{CHP}_{\text{thermal}} / \text{Furnace}_{\text{eff}}$ )

$\text{CHP}_{\text{thermal}}$  = Useful annual thermal energy output from the CHP system, defined as the annual thermal energy output of the CHP system that is actually recovered and utilized in the facility/process.

= Custom input

$\text{Boiler}_{\text{eff}} / \text{Furnace}_{\text{eff}}$  = Efficiency of the on-site Boiler/Furnace that is displaced by the CHP system or if unknown, the baseline equipment value stated in the High Efficiency Boiler (Section 4.4.10) measure or High Efficiency Furnace (Section 4.4.11) measure in this TRM.

= Custom input

$F_{\text{total CHP}}$  = Total fuel in Btus consumed by the CHP system

= Custom input

**Step 2: (Savings Allocation to Program Administrators for Purposes of Assessing Compliance with Energy Savings Goals (Not for Use in Load Reduction Forecasting))**

<sup>651</sup> These values are subject to regular updates so should be reviewed regularly to ensure the current assumptions are correct. Refer to the latest EPA eGRID data. Current values, based on eGrid 2018 are:

- Non-Baseload RFC West: 10,024 Btu/kWh \* (1 + Line Losses)
- Non-Baseload SERC Midwest: 9,871 Btu/kWh \* (1 + Line Losses)
- All Fossil Average RFC West: 9,575 Btu/kWh \* (1 + Line Losses)
- All Fossil Average SERC Midwest: 10,369 Btu/kWh \* (1 + Line Losses)

<sup>652</sup> For complex systems this value may be obtained from a CHP System design/financial analysis study.

Savings claims are a function of the electric output of the CHP system ( $E_{CHP}$ ), the used thermal output of the CHP system ( $F_{thermalCHP}$ ), and the CHP system efficiency ( $CHP_{Eff(HHV)}$ ). The percentages of electric output and used thermal output that can be claimed also differ slightly depending on whether the project was included in both electric<sup>653</sup> and gas<sup>654</sup> Energy Efficiency Portfolio Standard (EEPS)<sup>655</sup> efficiency programs, only an electric EEPS program or only a gas EEPS program. The tables below provide the specific percentages of electric and/or thermal output that can be claimed under each of those three scenarios. These percentages apply only to cases in which natural gas is the fuel used by the CHP system. Saving estimates for systems using other fuels should be calculated on a custom basis. If the waste heat recovered from the CHP system is offsetting electric equipment, such as an absorption chiller offsetting an electric chiller, then the net change in electricity consumption associated with the electric equipment should be added to the allocated electric savings.

1) For systems participating in both electric EEPS and gas EEPS programs:

CHP Annual System Efficiency (HHV)	Allocated Electric Savings	Allocated Gas Savings
<b>60%</b>	65% of $E_{CHP}$ (kWh)	No gas savings
<b>&gt;60% to 65%</b>	65% of $E_{CHP}$ (kWh) + one percentage point increase for every one percentage point increase in CHP system efficiency (max 70% of $E_{CHP}$ in kWh)	No gas Savings
<b>&gt;65%</b>	70% of $E_{chp}$ (kWh)	2.5% of $F_{thermal}$ (Boiler Natural Gas offset by CHP thermal) for every one percentage point increase in CHP system efficiency above 65%.

Example: System with measured annual system efficiency (HHV) of 70%: Electric savings (kWh) = 70% of  $E_{CHP}$  measured over 12 months, and Gas savings (therms) = 12.5% of  $F_{thermal}$  measured over 12 months (70% - 65% = 5 X 2.5% = 12.5%).

2) For systems participating in only an electric EEPS program:

CHP Annual System Efficiency (HHV)	Allocated Electric Savings	Allocated Gas Savings
<b>60%</b>	65% of $E_{CHP}$ (useful electric output of CHP system in kWh)	No gas Savings
<b>Greater than 60%</b>	65% + one percentage point increase for every one percentage point increase in CHP system efficiency (no max)	No gas Savings

Example: System with measured annual fuel use efficiency of 75%: Electric savings (kWh) = 65% + 15% = 80% of  $E_{CHP}$  measured over 12 months (15% = 1% for every 1% increase in system efficiency). No gas savings (therms).

<sup>653</sup> 220 ILCS 5/8-103; 220 ILCS 5/16-111.5B

<sup>654</sup> 220 ILCS 5/8-104

<sup>655</sup> As used in this measure characterization, EEPS programs are defined as those energy efficiency programs implemented pursuant to Sections 8-103, 8-104, and 16-111.5B of the Illinois Public Utilities Act. Technically, EEPS programs pertain to energy efficiency programs implemented pursuant to 220 ILCS 5/8-103 and 220 ILCS 5/8-104. However, for simplicity in presentation, this measure defines EEPS programs as also including those programs implemented pursuant to 220 ILCS 5/16-111.5B (these programs are funded through the same energy efficiency riders established pursuant to Section 8-103).

3) For systems participating in only a gas EEPS program:

CHP Annual System Efficiency (HHV)	Allocated Electric Savings	Allocated Gas Savings
<b>60% or greater</b>	No electric savings	2.5% of F <sub>thermal</sub> (Boiler Natural Gas offset by CHP thermal) for every one percentage point increase in CHP system efficiency above 60%.

Example: System with measured annual system efficiency (HHV) of 70%: No Electric savings (kWh). Gas savings (therms) = 25% of F<sub>thermal</sub> measured over 12 months (70% - 60% = 10 X 2.5% = 25%).

Conventional or topping cycle CHP systems virtually always require an increase in the use of fuel on-site in order to produce electricity. Different jurisdictions and experts across the country have employed and/or put forward a variety of approaches to address how increased on-site fuel consumption should be reflected in the attribution of electric savings to CHP systems.<sup>656</sup> The approach reflected in the tables above is generally consistent – for CHP systems consuming natural gas – with approaches recently put forward by the Southwest Energy Efficiency Project (SWEEP) and Institute for Industrial Productivity (IIP) that determine reduced electric savings based on the equivalent amount of carbon dioxide generated from the increased fuel used.<sup>657</sup>

There are a variety of ways one could treat the potential for gas utilities to claim savings from CHP projects in their EEPS portfolios. For projects in which a natural gas EEPS program is involved, the tables above treat savings from CHP installations in two steps: (1) a fuel-switch from electricity to natural gas (i.e., using more natural gas to eliminate the need to generate as much electricity on the grid); and (2) possible increases in CHP efficiency above a “benchmark” level. When both electric EEPS and natural gas EEPS programs are involved in a project, the program administrator claims all the electricity savings associated with a fuel-switch up to a “benchmark” 65% efficient CHP system. All the savings associated with increasing CHP efficiencies above that benchmark level are allocated to natural gas (e.g., if the CHP efficiency is 75%, the natural gas savings associated with an increase in CHP efficiency from 65% to 75% are allocated to natural gas). That is consistent with the notion that CHP efficiency typically increases primarily by increasing the use of the thermal output of the system (increasing the displacement of baseline gas use). For projects that involve only a natural gas EEPS program, the “benchmark” above which the gas utility can claim savings is lowered to 60%.

ii) **Waste-Heat-to-Power CHP Systems :**

**ELECTRIC ENERGY SAVINGS:**

$$\Delta kWh = E_{CHP}$$

<sup>656</sup> Approaches range from ignoring the increased gas use entirely (i.e., no “penalty”) to applying approximately 40-60% “penalties”, depending on the CHP efficiency and based on the equivalent grid kWh that the increased gas use represents.

<sup>657</sup> Consider, for example, a hypothetical CHP system that produces 5 million kWh annually, consumes 50 million kBtu of gas annual to generate that electricity (i.e. electric efficiency of approximately 34.8% HHV), reduces on-site gas use for space heating by 26 million kBtu of gas (i.e. equivalent to approximately 81.5% CHP thermal output utilization displacing gas used in a 70% efficient space heating boiler) and has a total annual CHP efficiency of 70.6% HHV. In this example, the net increase in on-site gas use is 24 million kBtu. At a carbon dioxide emission rate of 53.06 kg/MMBtu for burning natural gas, that translates to an increase in on-site carbon dioxide emissions of 1404 tons per year. At an estimated marginal emission rate of 1.098 tons of carbon dioxide per MWh in Illinois, that is equivalent to electric grid production of approximately 1.28 million kWh, or penalty of about 25.6% of the CHP system’s electrical output if a precise calculation of carbon equivalency was utilized to assign savings. In comparison, the simplified table above would entitle an electric utility to claim savings equal to 75.6% of the electric output (i.e., a penalty of 24.4% of electrical output) if it was the only utility promoting the system. In a gas and electric example, the electric savings claimed would be 70% of the production (a penalty of 30% of the CHP system’s electrical output) and 12.5% of the recovered thermal output, equivalent to 2.23 million kBtu. The difference between the electric only scenario and the electric and gas, on the electric side, is 5% of the electric output or 250,000 kWh, which would require 2.45 million kBtu input at an efficiency of 34.8% HHV.

Where:

$E_{\text{CHP}}$  = Useful annual electricity output produced by the CHP system, defined as the annual electric energy output of the CHP system that is actually utilized to replace purchased electricity required to meet the requirements of the facility/process.  
 = Custom input

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = CF * \text{CHP}_{\text{capacity}}$$

Where:

CF = Summer Coincidence factor. This factor should also consider any displaced chiller capacity.<sup>658</sup>  
 = Custom input  
 $\text{CHP}_{\text{Capacity}}$  = CHP nameplate capacity  
 = Custom input

**NATURAL GAS ENERGY SAVINGS:**

$$\Delta \text{Therms} = F_{\text{thermalCHP}} \div 100,000$$

Where:

$F_{\text{thermalCHP}}$  = Net savings in annual purchased fuel in Btu, if any, that would have been used on-site by a boiler/furnace to provide some or all of the useful thermal energy output of the CHP system.<sup>659</sup>  
 100,000 = Conversion factor for Btu to therms

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Custom estimates of maintenance costs that will be incurred for the life of the measure will be used. Maintenance costs vary with type and size of the prime mover. These costs include, but are not limited to:

- Maintenance labor
- Engine parts and materials such as oil filters, air filters, spark plugs, gaskets, valves, piston rings, electronic components, etc. and consumables such as oil
- Minor and major overhauls

For screening purposes, the US EPA has published resource guides that provide average maintenance costs based on CHP technology and system size.<sup>660</sup>

---

<sup>658</sup> If some or all of the existing electric chiller peak demand is no longer needed due to new waste heat powered chillers (e.g., absorption), the coincidence factor should be adjusted appropriately.

<sup>659</sup> In most cases, it is expected that waste-heat-to-power systems will not provide any new net useful thermal energy output, since the CHP system will be driven by thermal energy that was otherwise being wasted. If additional natural gas or other purchased energy is used onsite, it should be properly accounted for.

<sup>660</sup> “EPA Combined Heat and Power Partnership Resources” Oct 07, 2014, in the document “Catalog of CHP Technologies”, US EPA, September 2017, pages 2-16,, 3-14, 4-14, 5-14, and 6-16.



**COST-EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING**

For the purposes of forecasting load reductions due to CHP projects, changes in site energy use at the customer’s meter – reduced consumption of utility provided electricity – adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

For the purposes of screening a CHP measure application for cost-effectiveness, changes in site energy use – reduced consumption of utility provided electricity and the net change in consumption of fuel – should be used. In general, the benefit and cost components used in evaluating the cost-effectiveness of a CHP project would include at least the following terms:

Benefits:  $E_{CHP} + \Delta kW + F_{thermal\_CHP}$

Costs:  $F_{total\_CHP} + CHP_{COSTS} + O\&M_{COSTS}$

Where:

$CHP_{Costs}$  = CHP equipment and installation costs as defined in the “Deemed Measure Costs” section

$O\&M_{Costs}$  = CHP operations and maintenance costs as defined in the “Deemed O&M Cost Adjustment Calculation” section

**MEASURE CODE: CI-HVC-CHAP-V05-210101**

**REVIEW DEADLINE: 1/1/2022**

### 4.4.33 Industrial Air Curtain

#### DESCRIPTION

This measure applies to buildings with exterior entryways that utilize overhead doors. All other air curtain applications, such as through sliding door entryways or conventional foot-traffic entryways, require custom analysis as air curtain designs must often accommodate other factors that may change their effectiveness.

The use of overhead doors within exterior entryways during the heating season leads to the exfiltration of warm air from the upper portion of the door opening and the infiltration of colder air from the lower portion of the door opening. This results in increase heating energy use to compensate for heat losses every time a door is opened. By reducing heat losses, air curtains can also enhance the physical comfort of employees or customers near the entryway as there will be reduced temperature fluctuations when the door is opened and closed. In addition, in some cases excess heating capacity may be installed in buildings to meet this larger heating load. The addition of air curtains to exterior entryways that currently utilize overhead doors will result in energy savings and enhanced personal comfort, and also possibly in reduced equipment sizing and corresponding costs.

The primary markets for this measure are commercial and industrial facilities with overhead doors in exterior entryways, including but not limited to the following building types: retail, manufacturing, and warehouse (non-refrigerated).

#### *Limitations*

- For use in conditioned spaces with an overhead door in an exterior entryway. This measure does include other door types such doorways to commercial spaces such as retail.
- This measure should only be applied to spaces in which the overhead door separates a conditioned space and an unconditioned space.
- Installation must follow manufacturer recommendations to attain proper air velocity, discharge angle down to the floor level, and unit position.
- Certain heating systems may not be a good fit for air curtains, such as locations with undersized heating capacity. In these cases, the installation of an air curtain may not effectively reduce heating system cycling given the inappropriately sized heating capacity.
- Buildings with slightly positive to slightly negative (~5 Pa to -10 Pa). For all other scenarios, custom analysis is recommended.
- Measure assumes that wind speeds at near ground level are less than or equal to 12 mph for 90% of the heating or cooling season. For areas with more extreme weather, custom analysis is necessary.
- Note: for cost effectiveness, it is recommended that minimum door open times should be approximately 15 hours per week.<sup>661</sup>

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

The following methodology is highly complex and requires significant data collection. It is hoped that simplifying steps can be made in future iterations based on continued metering and evaluation of installations. Also the data collected through implementing the measure in the way currently drafted will aid in simplifying efforts at a future date.

---

<sup>661</sup> Spentzas, Steve, et. al, "1009: Commercial and Industrial Air Curtains – Public Project Report," Nicor Gas Emerging Technology Program (Oct 2014): 9.

**DEFINITION OF EFFICIENT EQUIPMENT**

Overhead air curtains designed for commercial and industrial applications that have been tested and certified in accordance with ANSI/AMCA 220 and installed following manufacturer guidelines. Measure is for standard models without added heating.

**DEFINITION OF BASELINE EQUIPMENT**

No air curtain or other currently installed means to effectively reduce heat loss and air mixing during door openings, such as a vestibule or strip curtain.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 15 years.<sup>662</sup>

**DEEMED MEASURE COST**

The incremental capital cost for overhead air curtains for exterior entryways are as follows, with an added average installation cost approximately equal to the capital cost.<sup>663</sup>

Door Size	Capital Cost
8'w x 8'h	\$3,600
10'w x 10'h	\$4,500
10'w x 12'h	\$5,400
12'w x 14'h	\$8,000
16'w x 16'h	\$13,300

**LOADSHAPE**

Heating Season: If electric heating, use Commercial Electric Heating Loadshape: C04. Otherwise, N/A

Cooling Season: Commercial Cooling Loadshape C03. Or, if applicable, use Commercial Electric Heating and Cooling Loadshape C05.

**COINCIDENCE FACTOR**

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)}$$

$$= 91.3\%^{664}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 47.8\%^{665}$$

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

The following formulas provide a methodology for estimating cooling load (kWh) and heating load (therm) savings associated with the installation of air curtains on exterior entryways such as a single door or loading bay. This

<sup>662</sup> Navigant Consulting Inc, Measures and Assumptions for Demand Side Management (DSM) Planning: Appendix C: Substantiation Sheets, "Air Curtains – Single Door," Ontario Energy Board, (April 2009): C-137.

2014 Database for Energy-Efficient Resources, EUL/RUL (Effective/Remaining Useful Life) Values, February 4, 2014.

<sup>663</sup> Based on manufacturer interviews and air curtain specification sheets.

<sup>664</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>665</sup>Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

algorithm is based on the assumption that therm savings are directly related to the difference in cooling or heating losses due to infiltration or exfiltration through an entryway before and after the installation of an AMCA certified air curtain. Energy savings are assumed to be the result of a reduction of natural infiltration effects due to wind and thermal forces and follow the calculation methodology outlined by the ASHRAE Handbook.<sup>666</sup> The calculation assumes that the air curtain is appropriately sized and commissioned to be effective in mitigating infiltration of winds of up to 12 mph for at least 90% of the year (based on manufacturer literature and TMY3 wind speed ranges at near ground level for Illinois).<sup>667</sup> Additionally, this measure assumes the HVAC systems are appropriately balanced such that the maximum pressure differential between indoor air and outdoor air is within the range of  $5 \text{ Pa} < \Delta P < 10 \text{ Pa}$ .<sup>668</sup> Custom analysis is necessary if building pressurization exceeds this range. However, while effectiveness decreases, some studies suggest that air curtains outperform vestibules and single door construction for negatively pressurized buildings with a  $\Delta P$  of above  $-30 \text{ Pa}$ .<sup>669</sup>

This algorithm allows either actual inputs or provides estimates if actual data is not available. All weather dependent values are derived from TMY3 data for the closest weather station to those locations defined elsewhere in the Illinois TRM (which are based on 30 year climate normals). If TMY3 weather station data was not available for the data used in the Illinois TRM, the next closest weather station was used. It is assumed that weather variations are negligible between the weather stations located within the same region. This approach was followed as the air curtain algorithm has a number of weather dependent variables, which are all calculated in relation to the heating season or cooling season as defined by the balance point temperature deemed appropriate for the facility. All weather dependent data is based on TMY3 data and is listed in tables by both climate zone and balance point temperature, which is then normalized to the Illinois TRM climate zoned HDD/CDD definitions unless otherwise noted.

#### ELECTRIC ENERGY SAVINGS

$$\Delta \text{kWh}_{\text{cooling}} = [(Q_{\text{tbc}} - Q_{\text{tac}}) / \text{EER} - (\text{HP} * 0.7457)] * t_{\text{open}} * \text{CD}$$

$$\Delta \text{kWh}_{\text{HPheating}} = [(Q_{\text{tbc}} - Q_{\text{tac}}) / \text{HSPF} - (\text{HP} * 0.7457)] * t_{\text{open}} * \text{HD}$$

$$\Delta \text{kWh}_{\text{Gasheating}} = - (\text{HP} * 0.7457) * t_{\text{open}} * \text{HD}$$

Where:

$Q_{\text{tbc}}$  = rate of total heat transfer through the open entryway, before air curtain (kBtu/hr)

$Q_{\text{tac}}$  = rate of total heat transfer through the open entryway, after air curtain (kBtu/hr)

(see calculation in ‘Heat Transfer Through Open Entryway with/without Air Curtain’ sections below)

EER = energy efficiency ratio of the cooling equipment (kBtu/kWh)

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2018 if through new construction) to assume values based on code estimates.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

HP = Input power for air curtain (hp)

<sup>666</sup> ASHRAE, “Ventilation and Infiltration,” in 2013 ASHRAE Handbook – Fundamentals (2013): Ch 16.1 - 16.37.

<sup>667</sup> National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL.

<sup>668</sup> Spentzas, Steve, et. al, “1009: Commercial and Industrial Air Curtains – Public Project Report,” Nicor Gas Emerging Technology Program (Oct 2014): 10.

Wang, Liangzhu, “Investigation of the Impact of Building Entrance Air Curtain on Whole Building Energy Use,” Air Movement and Control International, Inc. (2013). 4.

<sup>669</sup> Wang, Liangzhu, “Investigation of the Impact of Building Entrance Air Curtain on Whole Building Energy Use,” Air Movement and Control International, Inc. (2013). 4.

= Actual value. If actual value not available, use the following estimates based on manufacturer specs

Door Size	Fan HP
8'w x 8'h	1
10'w x 10'h	1.5
10'w x 12'h	4
12'w x 14'h	6
16'w x 16'h	12

0.7457 = unit conversion factor, brake horsepower to electric power (kW/HP)

t<sub>open</sub> = average hours per day the door is open (hr/day)

= Actual or user defined estimated value.

CD = cooling days per year, total days in year above balance point temperature (day)

= use table below to select the best value for location:<sup>670</sup>

Climate Zone -Weather Station/City	CD (Balance Point Temperature)				
	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	194	168	148	124	97
2 - Chicago O'Hare AP / Chicago	194	173	153	127	95
3 - Springfield #2 / Springfield	214	194	174	148	114
4 - Belleville SIU RSCH / Belleville	258	229	208	174	138
5 - Carbondale Southern IL AP / Marion	222	201	181	158	130

HSPF = Heating System Performance Factor of heat pump equipment

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2018 if through new construction) to assume values based on code estimates.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

HD = heating days per year, total days in year above balance point temperature (day)

= use table below to select an appropriate value:<sup>671</sup>

Climate Zone Weather Station/City	HD				
	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180

<sup>670</sup> National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL.

Note that cooling days (CD) are calculated by first determining its value from the TMY3 data associated with the appropriate weather station as defined by and used elsewhere in the Illinois TRM. Using the TMY3 outdoor air dry bulb hourly data, the annual hours are totaled for every hour that the outdoor air dry bulb temperature is above a designated zero heat loss balance point temperature or base temperature for cooling. For commercial and industrial (C&I) buildings, a base temperature for heating of 55 °F is designated in the Illinois TRM, but building specific base temperatures are recommended for large C&I projects. Additionally, the TRM uses a 30-year normal data for degree-days while the CD calculation was based on TMY3 data; in order to account for this, calculations of CD were also normalized by the ratio of CDD to align the calculated values more closely with the TRM.

<sup>671</sup> Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

Climate Zone Weather Station/City	HD				
	45 °F	50 °F	55 °F	60 °F	65 °F
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

**Heat Transfer Through Open Entryway without Air Curtain (Cooling Season)**

$$Q_{tbc} = 4.5 * CFM_{tot} * (h_{oc} - h_{ic}) / (1,000 \text{ Btu/kBtu})$$

Where:

4.5 = unit conversion factor with density of air: 60 min/hr \* 0.075 lbm/ft<sup>3</sup> (lb\*min/(ft\*hr))

CFM<sub>tot</sub> = Total air flow through entryway (cfm), see calculation below

h<sub>oc</sub> = average enthalpy of outside air during the cooling season (Btu/lb)

= use the below table to determine the approximate outdoor air enthalpy associated with an indoor temperature setpoint and climate zone.<sup>672</sup>

Climate Zone -Weather Station/City	h <sub>oc</sub>		
	67 °F	72 °F	77 °F
1 - Rockford AP / Rockford	31.6	33.0	35.3
2 - Chicago O'Hare AP / Chicago	32.0	33.6	35.4
3 - Springfield #2 / Springfield	32.9	34.6	36.6
4 - Belleville SIU RSCH / Belleville	33.5	35.0	36.4
5 - Carbondale Southern IL AP / Marion	34.6	36.2	37.7

h<sub>ic</sub> = average enthalpy of indoor air, cooling season (Btu/lb)

= use the below table to determine the approximate indoor air enthalpy associated with an indoor temperature setpoint in indoor relative humidity.

Relative Humidity (%)	h <sub>ic</sub>		
	67 °F	72 °F	77 °F
60	25.5	28.5	31.8
50	23.9	26.6	29.5
40	22.3	24.7	27.3

= an estimate 26.6 Btu/lb associated with the 72 °F and 50% indoor relative humidity case can be used as an approximation if no other data is available. For other indoor temperature setpoints and RH, enthalpies may be interpolated.

The total airflow through the entryway, CFM<sub>tot</sub>, includes both infiltration due to wind as well as thermal forces, as follows:

$$CFM_{tot} = \text{sqrt}[(CFM_w)^2 + (CFM_t^2)]$$

Where:

CFM<sub>w</sub> = Infiltration due to the wind (cfm)

<sup>672</sup> Average enthalpies were estimated following ASHRAE guidelines for perfect gas relationships for dry air associated with hourly TMY3 data. Enthalpies were then averaged for all values associated with a dry-bulb outdoor air temperature that exceeded the indoor air temperature setpoint. Other enthalpy values may be interpolated for indoor air temperature setpoints not represented in the table. Note that while outdoor air enthalpies increase with higher temperature setpoints, the change in enthalpy from indoor to outdoor will decrease.

$CFM_t$  = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

$$CFM_w = (v_{wc} * C_{wc}) * C_v * A_d * (88 \text{ fpm/mph})$$

Where:

$v_{wc}$  = average wind speed during the cooling season based on entryway orientation (mph)

= use the below table to for the wind speed effects based on climate zone and entryway orientation:<sup>673</sup>

Climate Zone -Weather Station /City	Entryway Orientation			
	N	E	S	W
1 - Rockford AP / Rockford	4.2	4.1	4.7	4.8
2 - Chicago O'Hare AP / Chicago	4.7	4.5	5.4	4.6
3 - Springfield #2 / Springfield	4.1	3.7	6.0	5.0
4 - Belleville SIU RSCH / Belleville	3.3	2.7	3.8	4.2
5 - Carbondale Southern IL AP / Marion	3.1	2.9	4.4	3.8

$C_{wc}$  = wind speed correction factor due to wind direction in cooling season (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the cooling season prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for cooling applications.

Climate Zone -Weather Station/City	Entryway Orientation			
	N	E	S	W
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31
2 - Chicago O'Hare AP / Chicago	0.18	0.17	0.36	0.26
3 - Springfield #2 / Springfield	0.17	0.12	0.46	0.21
4 - Belleville SIU RSCH / Belleville	0.21	0.15	0.35	0.16
5 - Carbondale Southern IL AP / Marion	0.18	0.15	0.37	0.11

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

$C_v$  = effectiveness of openings,  
= 0.3, assumes diagonal wind<sup>674</sup>

$A_d$  = area of the doorway (ft<sup>2</sup>)  
= user defined

The infiltration due to thermal forces is calculated as follows:

$$CFM_t = A_d * C_{dc} * (60 \text{ sec/min}) * \text{sqrt}[2 * g * H/2 * (T_{oc} - T_{ic}) / (459.7 + T_{oc})]$$

Where:

$C_{dc}$  = the discharge coefficient during the cooling season<sup>675</sup>

<sup>673</sup> Average wind speeds are calculated based on the TMY3 wind speed data. Because this data is collected at an altitude of 33 ft, wind speed is approximated for a 5 ft level based on ASHRAE Handbook guidelines using the urban/suburban parameters for adjusting wind speed based on altitude (Layer thickness (ft)  $\delta = 1200$ , Exponent  $a = 0.22$ ).

ASHRAE, "Airflow Around Buildings," in 2013 ASHRAE Handbook – Fundamentals (2013): p 24.3.

<sup>674</sup> ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

<sup>675</sup> ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13.

$$= 0.4 + 0.0025 * |T_{ic} - T_{oc}|$$

$$= 0.42, \text{ Illinois average at indoor air temp of } 72^{\circ}\text{F}$$

Note, values for  $C_{dc}$  show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value may be used as a simplification.

$g$  = acceleration due to gravity  
 = 32.2 ft/sec<sup>2</sup>

$H$  = the height of the entryway (ft)  
 = user input

$T_{ic}$  = Average indoor air temperature during cooling season  
 = User input, can assume indoor cooling temperature set-point

$T_{oc}$  = Average outdoor temp during cooling season (°F)  
 = the average outdoor temperature is dependent on the CD period and zone. As such, the following table may be used for average outdoor temperature during the cooling period.<sup>676</sup>

Climate Zone Weather Station/City	$T_{oc}$				
	62 °F	67 °F	72 °F	77 °F	82 °F
1 - Rockford AP / Rockford	72.9	76.0	79.2	82.5	85.5
2 - Chicago O'Hare AP / Chicago	72.9	76.0	79.4	82.8	85.5
3 - Springfield #2 / Springfield	73.7	76.7	79.9	83.4	86.4
4 - Belleville SIU RSCH / Belleville	74.9	77.7	81.0	84.3	86.9
5 - Carbondale Southern IL AP / Marion	75.1	77.7	80.9	84.7	87.4

459.7 = conversion factor from °F to °R  
 = calculation requires absolute temperature for values not calculated as a difference of temperatures.

**Heat Transfer Through Open Entryway with Air Curtain (Cooling Season)**

$$Q_{tac} = Q_{tbc} * (1 - E)$$

Where:

$E$  = the effectiveness of the air curtain (%)  
 = 0.60<sup>677</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\Delta kWh_{cooling} / (CD * 24)) * CF$$

Where:

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

<sup>676</sup> Based on binned data from TMY3 & adjusted bracketed thermostat setpoint temperatures. Interpolate other values as needed.

<sup>677</sup> Assumed conservative estimate based on referenced study results and ASHRAE 2004 effectiveness range of 60-80% for air curtains. Jaramillo, Julian, et. Al. "Application of Air Curtains in Refrigerated Chambers," International Refrigeration and Air-Conditioning Conference, Purdue University e-Pubs (July 14-17, 2008). ASHRAE, "Room Air Distribution Equipment," in 2004 ASHRAE Handbook – HVAC Systems and Equipment (2004): p 17.8.



$$= 91.3\%^{678}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 47.8\%^{679}$$

**NATURAL GAS SAVINGS**

Natural gas savings, Δtherms, associated with reduced infiltration through an entryway during the heating season are calculated by determining the difference between heat loss through the entryway before and after the installation of the air curtain.

$$\Delta\text{therms} = (Q_{bc} - Q_{ac}) * t_{open} * HD / \eta$$

Where:

$Q_{bc}$  = rate of sensible heat transfer through the open entryway, before air curtain (therm/hr)

$Q_{ac}$  = rate of sensible heat transfer through the open entryway, after air curtain (therm/hr)

$t_{open}$  = average hours per day the door is open (hr/day)

= Actual or estimated user input value

HD = heating days per year, total days in year above balance point temperature (day)

= use table below to select an appropriate value:<sup>680</sup>

Climate Zone - Weather Station/City	HD				
	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

$\eta$  = efficiency of heating equipment

= Actual. If unknown, assume 0.8

**Heat Transfer Through Open Entryway without Air Curtain (Heating Season)**

$$Q_{bc} = (1.08 \text{ Btu}/(\text{hr} * \text{°F} * \text{cfm})) * CFM_{tot} * (T_{ih} - T_{oh}) / (100,000 \text{ Btu}/\text{therm})$$

Where:

1.08 = sensible heat transfer coefficient (specific heat of air and unit conversions)

$CFM_{tot}$  = Total air flow through entryway (cfm)

$T_{ih}$  = Average indoor air temperature during heating season

= User input, can assume indoor heating temperature set-point

$T_{oh}$  = Average outdoor temp during heating season (°F)

<sup>678</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>679</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

<sup>680</sup> Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

= use table below, based on binned data from TMY3 & balance point temperature:

Climate Zone -Weather Station/City	Avg Outdoor Air Temp - Heating Season				
	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	26.3	28.8	31.6	34.2	37.3
2 - Chicago O'Hare AP / Chicago	29.4	31.2	34.0	36.8	40.3
3 - Springfield #2 / Springfield	29.4	31.5	34.6	37.7	41.6
4 - Belleville SIU RSCH / Belleville	31.7	33.6	36.2	39.2	42.3
5 - Carbondale Southern IL AP / Marion	32.5	34.9	37.8	40.7	44.0

The total airflow through the entryway,  $CFM_{tot}$ , includes both infiltration due to wind as well as thermal forces, as follows:

$$CFM_{tot} = \text{sqrt}[(CFM_w)^2 + (CFM_t)^2]$$

Where:

$CFM_w$  = Infiltration due to the wind (cfm)

$CFM_t$  = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

$$CFM_w = (v_{wh} * C_{wh}) * C_v * A_d * (88 \text{ fpm/mph})$$

Where:

$v_{wh}$  = average wind speed during the heating season (mph)

= similar to cooling season wind speed assumptions, use the following table to determined average wind speed based on entryway orientation:

Climate Zone -Weather Station/ City	Entryway Orientation			
	N	E	S	W
1 - Rockford AP / Rockford	5.0	4.6	4.9	5.6
2 - Chicago O'Hare AP / Chicago	5.5	5.2	4.9	5.1
3 - Springfield #2 / Springfield	5.0	4.9	5.3	5.1
4 - Belleville SIU RSCH / Belleville	4.3	3.4	3.5	5.3
5 - Carbondale Southern IL AP / Marion	4.6	3.2	4.2	4.4

$C_{wh}$  = wind speed correction factor due to wind direction in heating season, (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the heating season prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for the heating applications.

Climate Zone -Weather Station/ City	Entryway Orientation			
	N	E	S	W
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31
2 - Chicago O'Hare AP / Chicago	0.21	0.10	0.26	0.39
3 - Springfield #2 / Springfield	0.21	0.14	0.27	0.34
4 - Belleville SIU RSCH / Belleville	0.31	0.15	0.22	0.29
5 - Carbondale Southern IL AP / Marion	0.31	0.11	0.27	0.18

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

$C_v$  = effectiveness of openings,

$C_{dh}$  = 0.3, assumes diagonal wind<sup>681</sup>  
 $A_d$  = area of the doorway (ft<sup>2</sup>)  
 = user input

The infiltration due to thermal forces is calculated as follows:

$$CFM_t = A_d * C_{dh} * (60 \text{ sec/min}) * \text{sqrt}[2 * g * H/2 * (T_{ih} - T_{oh}) / (459.7 + T_{ih})]$$

Where:

$C_{dh}$  = the discharge coefficient during the heating season  
 =  $0.4 + 0.0025 * |T_{ih} - T_{oh}|$   
 = 0.49, Illinois average at indoor air temp of 72°F

Note, values for  $C_{dh}$  show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value may be used as a simplification.

$g$  = acceleration due to gravity  
 = 32.2 ft/sec<sup>2</sup>  
 $H$  = the height of the entryway (ft)  
 = user defined

**Heat Transfer Through Open Entryway without Air Curtain (Heating Season)**

$$Q_{ac} = Q_{bc} * (1 - E)$$

Where:

$E$  = the effectiveness of the air curtain (%)  
 = 0.60<sup>682</sup>

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

The air curtain would need to be regularly serviced and commissioned to ensure that it is appropriately operating. This is estimated at a cost of \$150.<sup>683</sup>

**MEASURE CODE: CI-HVC-AIRC-V03-200101**

**REVIEW DEADLINE: 1/1/2022**

<sup>681</sup> ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

<sup>682</sup> Assumed conservative estimate based on referenced study results and ASHRAE 2004 effectiveness range of 60-80% for air curtains. Jaramillo, Julian, et. Al. "Application of Air Curtains in Refrigerated Chambers," International Refrigeration and Air-Conditioning Conference, Purdue University e-Pubs (July 14-17, 2008).

ASHRAE, "Room Air Distribution Equipment," in 2004 ASHRAE Handbook – HVAC Systems and Equipment (2004): p 17.8.

<sup>683</sup> Assumes approximately 1 hour of maintenance (include cleaning out filters, greasing, and checking that the designed angle of attack on the blower nozzle is at the designed position) based on manufacturer input and product spec sheets.

## 4.4.34 Destratification Fan

### DESCRIPTION

This measure applies to buildings with high bay ceiling construction without fans currently installed for the purpose of destratifying air. There is also a separate measure for destratification fans as applied to agricultural settings (“High Volume Low Speed Fans”). All other destratification fan applications require custom analysis.

Air stratification leads to higher temperatures at the ceiling and lower temperatures at the ground. During the heating season, destratification fans improve air temperature distribution in a space by circulating warmer air from the ceiling back down to the floor level, thereby enhancing comfort and saving energy. Energy savings are realized by a reduction of heat loss through the roof-deck and walls as a result of a smaller temperature differential between indoor temperature and outdoor air.

Note that further, but limited, empirical evidence suggests that improved air mixing due to destratification would also result in shorter heating system runtimes due to warmer air reaching the thermostat level sooner, and possibly even allow a facility to lower the thermostat set point while maintaining a similar level of occupant comfort. This is supported by measured data in which an increase in temperatures was observed at the thermostat (5 foot level) level when air is destratified, resulting in an approximate temperature increase at the 5 foot level in the range of 1 - 3°F.<sup>684</sup> This measure does not currently attempt to quantify the potential impacts of air mixing from destratification; however, it should be noted that additional therms savings may be possible.

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

### Limitations

- For use in conditioned, high bay structures. Recommended minimum ceiling height of 20 ft.
- This measure should only be applied to spaces in which the ceiling is subject to heat loss to outdoor air (i.e., single story or top floor spaces) and where there is sufficient space to allow for appropriate spacing of the fans. Other applications require custom analysis.
- Installation must follow manufacturer recommendations sufficient to effectively destratify the entire space. Please see calculation of effective area,  $A_{eff}$ , in the therms savings algorithm as a check if this criteria is met. Otherwise, custom calculation is necessary.
- Measure does not currently support facilities with night setbacks on heating equipment. Custom analysis is needed in this case.
- Certain heating systems may not be a good fit for destratification fans, such as locations with: high velocity vertical throw unit heaters, radiant heaters, and centralized forced air systems. In these cases, measured evidence of stratification should be confirmed, and custom analysis may be necessary.

### DEFINITION OF EFFICIENT EQUIPMENT

High Volume, Low Speed (HVLS) fans with a minimum diameter of 14 ft with Variable Speed Drive (VSD) installed.<sup>685</sup>

Note that bell-shaped fans are currently excluded from this measure due to limited validation of the technology available. Further verification of effectiveness compared to HVLS is needed. A manufacturer of bell-shaped fans indicates that four bell-shaped fans provide an equivalent effective area as a typical HVLS fan. However, there is a need for further review of bell-shaped fan field test data supporting manufacturer claims regarding comparable effectiveness to HVLS technologies.

---

<sup>684</sup> Kosar, Doug, “1026: Destratification Fans – Public Project Report,” Nicor Gas, Emerging Technology Program (Oct 2014): 16.

<sup>685</sup> Kosar, Doug, “1026: Destratification Fans – Public Project Report,” Nicor Gas, Emerging Technology Program (Oct 2014): 16.

**DEFINITION OF BASELINE EQUIPMENT**

No destratification fans or other means to effectively mix indoor air.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 10 years.<sup>686</sup>

**DEEMED MEASURE COST**

The incremental measure cost = [equipment cost of HVLS fans] + [installation costs (including materials and labor)]

Since installation cost is dependent on a variety of factors, actual costs should be used if known. The default incremental measure cost for HVLS fans are as follows:<sup>687</sup>

Fan Diameter (ft)	Incremental Cost
14	\$6,600
16	\$6,650
18	\$6,700
20	\$6,750
22	\$6,800
24	\$6,850

**LOADSHAPE**

Loadshape C04: Commercial Electric Heating.

**COINCIDENCE FACTOR**

There are no summer coincident peak demand savings for this measure due to no savings attributable to cooling during the summer peak period.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

The following formulas provide a methodology for estimating heating load savings associated with destratification fan use. This algorithm is based on the assumption that savings are directly related to the difference in heat loss through the envelope before and after destratification.

**ELECTRIC ENERGY SAVINGS**

The algorithm for this measure was developed for natural gas heating applications, however, for electric heating applications, the same methodology presented in the Natural Gas Savings Section may be used with the standard conversion factor from therms to kWh of 29.31 kWh/therm and an equipment efficiency as follows:

---

<sup>686</sup> Consistent with both 2008 Database for Energy-Efficient Resources, EUL/RUL (Effective/Remaining Useful Life) Values, October 10, 2008 and GDS Associates, Inc, "Measure Life Report: Residential and Commercial/Industrial Lighting and HVAC Measures," New England Stat Program Working Group (June 2007), p30.

<sup>687</sup> Costs were obtained from manufacturer interviews and are based off of average or typical prices for base model HVLS fans. Costs include materials and labor to install the fans and tie fans into an existing electrical supply located near the fan.

System Type	Cooling Capacity of Equipment	Age of Equipment	HSPF Estimate	$\eta$ (Effective COP Estimate) (HSPF/3.413)
<b>Heat Pump</b> <sup>688</sup>	All	Before 2009	6.8	2.0
	< 65,000 Btu/h	2009 - 2017	7.7	2.3
		2017 on	8.2	2.40
	$\geq 65,000$ Btu/h and < 135,000 Btu/h	2010 on	11.3	3.3
	$\geq 135,000$ Btu/h and < 240,000 Btu/h	2010 on	10.9	3.2
	$\geq 240,000$ Btu/h and < 760,000 Btu/h	2010 on	10.9	3.2
<b>Resistance</b>	N/A	N/A	N/A	1

Regardless of how the building is heated, the energy consumption of the fans must be accounted for. If the building is electrically heated, fan energy shall be subtracted from the savings as calculated above. If the building is heated with natural gas, this shall represent an electric penalty, i.e., an increase in consumption. This is calculated as follows:

$$\Delta \text{kWh} = - (W_{\text{fan}} * N_{\text{fan}}) * t_{\text{eff}}$$

$W_{\text{fan}}$  = fan input power (kW)

$N_{\text{fan}}$  = number of fans

$t_{\text{eff}}$  = effective annual operation time, based on balance point temperature (hr)

= see table below in Natural Gas Savings section for further detail

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{Therms} = [(\Delta Q_r + \Delta Q_w) * t_{\text{eff}}] / (100,000 * \eta)$$

Where:

$\Delta Q_r$  = the heat loss reduction through the roof due to the destratification fan (Btu/hr)

= See calculation section below

$\Delta Q_w$  = the heat loss reduction through the exterior walls due to destratification fan (Btu/hr)

<sup>688</sup> Minimum heating efficiency standards for heat pumps are sourced from the Code of Federal Standards for Small and Large Commercial Package Air Conditioning and Heating Equipment (Air Cooled), 10 CFR 431.97 with compliance dates of June 16, 2008; January 1, 2010; January 1, 2017; and January 1, 2018. As the first federal appliance standards for heating efficiency for commercial heat pumps went into effect in June 2008, assuming efficiency standards equivalent to residential heat pumps prior to that date.

= See calculation section below

$t_{eff}$  = effective annual operation time, based on balance point temperature (hr)  
 = use table below to select an appropriate value:<sup>689</sup>

Climate Zone -Weather Station/City	$t_{eff}$				
	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	3810	4226	4880	5571	6436
2 - Chicago O'Hare AP / Chicago	3593	3986	4603	5254	6070
3 - Springfield #2 / Springfield	3038	3370	3891	4442	5131
4 - Belleville SIU RSCH / Belleville	2243	2488	2873	3280	3789
5 - Carbondale Southern IL AP / Marion	2271	2519	2909	3320	3836

100,000 = conversion factor (1 therm = 100,000 Btu)

$\eta$  = thermal efficiency of heating equipment  
 = Actual. If unknown, assume 0.8.

**For example**, for a warehouse facility located in Rockford, IL, installing destratification fans could reduce heat loss through the roof of 95,000 Btu/hr and a reduced heat loss through the wall of 51,228 Btu/hr. Assuming a balance point of 55°F the therms savings for the facility would be estimated as:

$$\begin{aligned} \Delta \text{Therms} &= [(\Delta Q_r + \Delta Q_w) * t_{eff}] / (100,000 * \eta) \\ &= [(95,000 \text{ Btu/hr} + 51,228 \text{ Btu/hr}) * 4880 \text{ hr}] / [(100,000 \text{ Btu/therm}) * 0.8] \\ &= 8,923 \text{ therms} \end{aligned}$$

**Heat loss reduction through the roof**

$$\begin{aligned} \Delta Q_r &= Q_{r,s} - Q_{r,d} \\ &= (1/R_r) * A_r * [(T_{r,s} - T_{oa}) - (T_{r,d} - T_{oa})] \\ &= (1/R_r) * A_r * (T_{r,s} - T_{r,d}) \end{aligned}$$

Where:

- $Q_{r,s}$  = roof heat loss for stratified space
- $Q_{r,d}$  = roof heat loss for destratified space
- $R_r$  = overall thermal resistance through the roof (hr \* ft<sup>2</sup> \* °F / Btu)  
 = Actual or estimated based on construction type. If unknown, assume the following:

Thermal Resistance Factor (R-Factor) for Roof	Retrofit <sup>690</sup>	New Construction <sup>691</sup>
$R_r$	15.0 (hr * ft <sup>2</sup> * °F / Btu)	30.0 (hr * ft <sup>2</sup> * °F / Btu)

$A_r$  = roof area (ft<sup>2</sup>)

<sup>689</sup> These were calculated at various base temperatures using TMY3 data and adjusted to make consistent with the 30 year normal data used elsewhere. For more information see 'Destratification Fan Workpaper'; Robert Irmiger, Gas Technology Institute, 9/6/2015.

<sup>690</sup> Professional judgement was used to address older vintage structures and an estimate of 50% of current code standard was used.

<sup>691</sup> Consistent with IECC 2015/2018 code requirements.

- = user input
- = can be approximated with floor area
- $T_{oa}$  = outside air temperature, note: therm savings calculations are actually independent of outside air because this term drops out of the heat loss reduction equation
- $T_{r,s}$  = indoor temperature at roof deck, stratified case (°F)  
= Actual. If unknown, use the following equation  
=  $m_s * h_r + T_{f,s}$
- $h_r$  = ceiling height/roof deck (ft)
- $m_s$  = estimated heat gain per foot elevation, stratified case (°F/ft)  
= 0.8 °F/ft  
= Professional judgement used to define value based on result from a Nicor Gas ETP Pilot field testing results and the Ansley article below.<sup>692,693</sup> Estimates from these sources fall on the conservative side of the industry rule of thumb range of 1-2 °F/ft heat gain.
- $T_{f,s}$  = estimated floor temperature, stratified case (°F)  
=  $T_{tstat} - m_s * h_{tstat}$   
=  $T_{tstat} - 4$  °F
- $T_{tstat}$  = temperature set point at the thermostat
- $h_{tstat}$  = vertical distance between the floor and the thermostat, assumed 5ft
- $T_{r,d}$  = indoor temp at roof, destratified case  
= actual value, or may be estimated using the following:<sup>694,695</sup>  
=  $T_{tstat} + 1$  °F

**For example**, for a 50,000 ft<sup>2</sup> warehouse built in 1997 with 30 ft ceilings and a thermostat set point of 65 °F. No further measured values available.

$$\begin{aligned} \Delta Q_r &= (1/R_r) * A_r * (T_{r,s} - T_{r,d}) = (1/R_r) * A_r * [(m_s * h_r + T_{tstat} - 4 \text{ °F}) - (T_{tstat} + 1 \text{ °F})] \\ &= (1/R_r) * A_r * [(0.8\text{°F/ft} * h_r) - 5 \text{ °F}] \\ &= 1/(10 \text{ hr} * \text{ft}^2 * \text{°F} / \text{Btu}) * (50,000 \text{ ft}^2) * [(0.8\text{°F/ft} * 30 \text{ ft}) - 5 \text{ °F}] \\ &= 95,000 \text{ Btu/hr} \end{aligned}$$

**Heat loss reduction through exterior walls**

Note: a conservative estimate for therms savings would neglect the impact of heat loss through the walls. However, Ansley suggests that estimates based on the roof deck losses alone underestimate actual savings by up to 46%.<sup>696</sup>

$$\Delta Q_w = Q_{w,s} - Q_{w,d}$$

<sup>692</sup> Kosar, Doug, “1026: Destratification Fans – Public Project Report,” Nicor Gas, Emerging Technology Program (Oct 2014): 10-11. Field testing results indicated approximately 0.6 oF/ft for a garden center.

<sup>693</sup> Aynsley, Richard, “Saving Heating Costs in Warehouses,” ASHRAE Journal (Dec 2005): 48. Identifies a 0.8 oF/ft gain.

<sup>694</sup> Kosar, Doug, “1026: Destratification Fans – Public Project Report,” Nicor Gas, Emerging Technology Program (Oct 2014): 10-11. Field testing results indicated approximately 0.6 oF/ft for a garden center.

<sup>695</sup> Aynsley, Richard, “Saving Heating Costs in Warehouses,” ASHRAE Journal (Dec 2005): 48.

<sup>696</sup> Aynsley, Richard, “Saving Heating Costs in Warehouses,” ASHRAE Journal (Dec 2005): 51.



$$= (1/R_w) * A_w * (T_{w,s} - T_{w,d})$$

Where:

$R_w$  = overall thermal resistance through the exterior walls (hr \* ft<sup>2</sup>\* °F / Btu)  
 = Actual or estimated based on construction type.<sup>697</sup> If unknown, assume the following:

Thermal Resistance Factor (R-Factor) for Wall	Retrofit <sup>698</sup>	New Construction <sup>699</sup> (2010 or newer)
$R_w$	6.5 (hr * ft <sup>2</sup> * °F / Btu)	13.0 (hr * ft <sup>2</sup> * °F / Btu)

$A_w$  = area of exterior walls (ft<sup>2</sup>)  
 = user input

$T_{w,s}$  = average indoor air temperature for wall heat loss, stratified case  
 = If actual  $T_{r,s}$  measurement is available<sup>700</sup>  

$$= [(T_{r,s} * h_a) + (T_{tstat} * h_b)] / h_r$$

$$h_a = \text{vertical distance between the heat source and the ceiling}$$

$$h_b = \text{vertical distance between the floor and the heat source}$$
 = Otherwise, use the linear stratification equation at average space height, see definition above.  

$$= m_s * (h_r / 2) + T_{f,s}$$

$$= m_s * (h_r / 2) + (T_{tstat} - 4)$$

$T_{w,d}$  = average indoor air temperature for wall heat loss, destratified case  
 =  $T_{tstat} + 0.5$

<sup>697</sup> Because heat loss through the walls is estimated using the average space temperature pre- and post- destratification. There are a number of factors that can impact the average space temperature causing deviations from estimates of many degrees in some cases. As such, it is recommended that a conservative value for the thermal resistance through the walls,  $R_w$ , be used. A recommended method for determining  $R_w$  would be to use the highest R-value for the wall space, neglecting lower R-values associated with windows, thermal bridges, etc.

<sup>698</sup>ANSI/ASHRAE/IESNA 100-1995, "Energy Conservation in Existing Buildings," ASHRAE Standard (1995). Additionally, professional judgement was used to address older vintage structure prior to adoption of the 1995 standard and an estimate of 50% of current code standard was used.

<sup>699</sup>ANSI/ASHRAE/IESNA Standard 90.1-2007, "Energy Standard for Buildings Except Low-Rise Residential Buildings," ASHRAE Standard (2007): Table 5.5-4 and Table 5.5-5.

<sup>700</sup> Aynsley, Richard, "Saving Heating Costs in Warehouses," ASHRAE Journal (Dec 2005): 48.

= conservative estimate using engineering judgment based on the same assumption used for  $T_{r,f}$  estimate.

**For example**, for a 50,000 ft<sup>2</sup> warehouse built in 1997 with 1200 ft length of perimeter wall and 30 ft ceilings and a thermostat set point of 65 °F and a measured temperature at the ceiling of 85 °F and unit heaters located 10 feet from the roof:

$$\begin{aligned} \Delta Q_w &= (1/R_w) * A_w * (T_{w,s} - T_{w,d}) \\ &= (1/R_w) * A_w * [((T_{r,s} * h_a) + (T_{tstat} * h_b)) / h_r] - (T_{tstat} + 0.5 \text{ °F}) \\ &= 1/(6.5 \text{ hr*ft}^2*\text{°F/Btu}) * (1200 * 30) * [((85\text{°F} * 10\text{ft}) + (65 \text{ °F} * 20\text{ft})) / 30\text{ft}] - (65 + 0.5 \text{ °F}) \\ &= 1/(6.5 \text{ hr*ft}^2*\text{°F/Btu}) * (36,000\text{ft}^2) * (71.7 \text{ °F} - 65.5 \text{ °F}) \\ &= 34,338 \text{ Btu/hr} \end{aligned}$$

**Measure eligibility check**

Use the following algorithm to verify a fan system is sufficiently sized to destratify air across the entire area.

Effective area,  $A_{eff}$ , is the area over which a fan or a group of fans can be expected to effectively destratify a space. If  $A_{eff}$  is less than the roof area,  $A_r$ , a custom analysis approach should be followed to account for the change in the effectiveness of the system. In lieu of more detailed studies, effective area is defined based on the measured results from an Enbridge Gas field study in which the area a fan was expected to effectively destratify was equal to 5 times the fan diameter.<sup>701</sup> Effective area, is calculated as follows:

$$\begin{aligned} A_{eff} &= [\pi * (5 * D_{fan})^2] / 4 * N_{fan} \\ &= 6.25 * \pi * D_{fan}^2 * N_{fan} \end{aligned}$$

Where:

- $A_{eff}$  = the effective area fan area on the floor (ft<sup>2</sup>)
- $D_{fan}$  = fan diameter
- $N_{fan}$  = the number of fans

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-DSFN-V05-210101**

**REVIEW DEADLINE: 1/1/2024**

<sup>701</sup> Enbridge Gas Distribution, Inc., “Big Fans Deliver Big Bonus,” (Aug 2007). Additionally, multiple utilities have adopted this definition in their programs in including Enbridge Gas and Consumers Energy.

## 4.4.35 Economizer Repair and Optimization

### DESCRIPTION

Economizers are designed to use unconditioned outside air (OSA) instead of mechanical cooling to provide cooling when exterior conditions permit. When the OSA temperature is less than the changeover temperature (determined by a static setpoint or a reference return air sensor) up to 100% OSA is supplied to help meet the facility's cooling needs, thus reducing mechanical cooling energy and saving energy. An economizer that is not working or is not properly adjusted can waste energy and cause comfort issues. This HVAC Economizer Optimization measure involves the repair and optimization of common economizer problems such as adjusting changeover setpoint, repairing damper motors & linkages and replacing non-working sensors and/or controllers. These repairs and adjustments result in proper operation which maximizes both occupant comfort and energy savings.

This measure is only appropriate for single zone packaged rooftop units. Custom calculations are required for savings for multi-zone systems.

In general the HVAC Economizer Optimization measure may involve both repair and/or optimization, as below.

**Economizer Repair** – The Economizer repair work is performed to ensure that the existing economizer is working properly. This allows the system to take advantage of free cooling and ensure that the system is not supplying an excess amount of outside air (OSA) during non-economizing periods.

- **Replace Damper Motor** – If the existing damper motor is not operational, the unit will be replaced with a functioning motor to allow proper damper modulation.
- **Repair Damper linkage** – If the existing linkage is broken or not adjusted properly, the unit will be replaced or adjusted to allow proper damper modulation.
- **Repair Economizer Wiring** – If the existing economizer is not operational due to a wiring issue, the issue will be repaired to allow proper economizer operation.
- **Reduce Over Ventilation** – If the unit is supplying excess OSA, the OSA damper position will be adjusted to meet minimum ventilation requirements.
- **Economizer Sensor Replacement** – If the unit is equipped with a nonadjustable dry bulb (i.e. snapdisk) or malfunctioning analog sensor, the sensor is replaced with a new selectable sensor.
- **Economizer Control Replacement** – If the existing economizer controller is not operational, the unit will be replaced or upgraded to allow for proper economizer operation.

**Economizer Optimization**- The economizer optimization work is performed to ensure that the existing economizer system is set up properly to maximize use of free cooling for units located in a particular climate zone.

- **Economizer Changeover Setpoint Adjustment** – If the unit is equipped with a fully operational economizer, the controller is adjusted to the appropriate changeover setpoint based on ASHRAE 90.1 (Figure 1 - *Table 6.5.1.1.3 High-Limit Shutoff Control Settings for Air Economizers*) for the corresponding climate zone.
- **Enable Integrated Operation** – If the unit is equipped with a fully operational economizer and is not set up to allow a minimum of two stages of cooling (1<sup>st</sup> stage – Economizer Only & 2<sup>nd</sup> Stage – Economizer & Mechanical cooling), the unit will be wired to allow two stage cooling

This measure was developed to be applicable to the following program types: RF, DI.

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient equipment condition is defined by fully functional economizer that is programmed to meet ASHRAE 90.1 economizer changeover setpoint requirements for the facility’s climate zone and changeover control type (Figure 1 - Table 6.5.1.1.3 High-Limit Shutoff Control Settings for Air Economizers).<sup>702</sup>

**Figure 1 – Baseline ASHRAE High-Limit Shutoff Control Settings**

**TABLE 6.5.1.1.3 High-Limit Shutoff Control Settings for Air Economizers<sup>b</sup>**

Control Type	Allowed Only in Climate Zone at Listed Setpoint	Required High-Limit Setpoints (Economizer Off When):	
		Equation	Description
Fixed dry-bulb temperature	1b, 2b, 3b, 3c, 4b, 4c, 5b, 5c, 6b, 7, 8	$T_{OA} > 75^{\circ}\text{F}$	Outdoor air temperature exceeds 75°F
	5a, 6a	$T_{OA} > 70^{\circ}\text{F}$	Outdoor air temperature exceeds 70°F
	1a, 2a, 3a, 4a,	$T_{OA} > 65^{\circ}\text{F}$	Outdoor air temperature exceeds 65°F
Differential dry-bulb temperature	1b, 2b, 3b, 3c, 4b, 4c, 5a, 5b, 5c, 6a, 6b, 7, 8	$T_{OA} > T_{RA}$	Outdoor air temperature exceeds return air temperature
Fixed enthalpy with fixed dry-bulb temperature	All	$h_{OA} > 28 \text{ Btu/lb}^a$ or $T_{OA} > 75^{\circ}\text{F}$	Outdoor air enthalpy exceeds 28 Btu/lb <sup>a</sup> of dry air <sup>a</sup> or outdoor air temperature exceeds 75°F
Differential enthalpy with fixed dry-bulb temperature	All	$h_{OA} > h_{RA}$ or $T_{OA} > 75^{\circ}\text{F}$	Outdoor air enthalpy exceeds return air enthalpy or outdoor air temperature exceeds 75°F

a. At altitudes substantially different than sea level, the fixed enthalpy limit shall be set to the enthalpy value at 75°F and 50% RH. As an example, at approximately 6000 ft elevation, the fixed enthalpy limit is approximately 30.7 Btu/lb.  
 b. Devices with selectable rather than adjustable setpoints shall be capable of being set to within 2°F and 2 Btu/lb of the setpoint listed.

**Figure 2 – ASHRAE Climate Zone Map**

**NORMATIVE APPENDIX B  
CLIMATE ZONES FOR U.S. STATES AND COUNTIES**

This normative appendix provides the climate zones for U.S. states and counties. Figure B-1 contains the county-level climate zone map for the United States. Table B-1 lists each state and major counties within the state and shows the climate number and letter for each county listed.

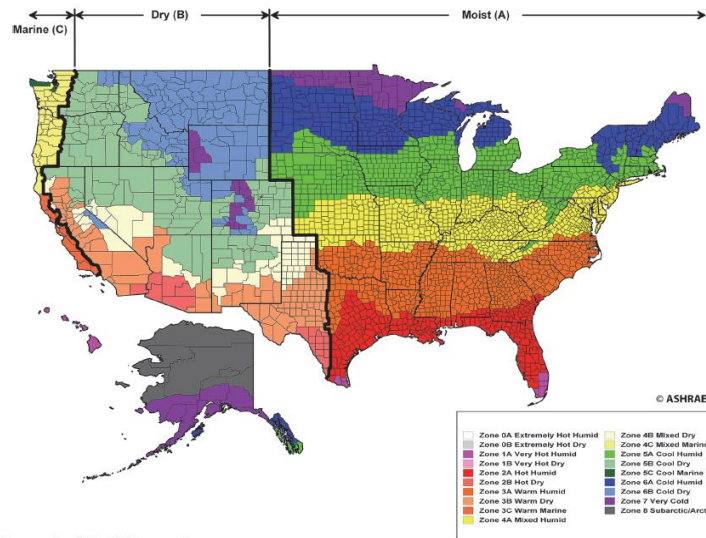


FIGURE B-1 Climate zones for United States counties.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline for this measure is an existing economizer installed on a packaged single zone rooftop HVAC unit. The existing economizer system is currently not operating as designed due to mechanical and/or control problems, and/or is not optimally adjusted.

<sup>702</sup> ASHRAE, Standard 90.1-2013

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 5 years.<sup>703</sup>

**DEEMED MEASURE COST**

The cost for this measure can vary considerably depending upon the existing condition of the economizer and the work required to achieve the required efficiency levels. Measure cost should be determined on a site-specific basis.

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

The savings calculation methodology uses a regression equation to calculate the energy savings for a variety of common situations.<sup>704</sup> The equation variables are limited to the ranges listed; if the actual conditions fall outside of these ranges custom calculations are required.

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = [\text{Baseline Energy Use (kWh/Ton)} - \text{Proposed Energy Use (kWh/Ton)}] * \text{Cooling Capacity (Tons)}$$

The following equations are used to calculate baseline and proposed electric energy use.<sup>705</sup>

**Electric Energy Use Equations (kWh / ton)**

Building Type	Changeover Type	Equation
Assembly	Fixed Dry-Bulb (DB)	$cz + CSP * -2.021 + EL * -16.362 + OAn * 1.665 + OAx * -3.13$
	Dual Temperature Dry-Bulb (DTDB)	$cz + EL * -11.5 + OAn * 1.635 + OAx * -2.817$
	Dual Temperature Enthalpy (DTEnth)	$cz + EL * -17.772 + OAn * 1.853 + OAx * -3.044$
	Fixed Enthalpy (Enth)	$cz + CSP * -5.228 + EL * -17.475 + OAn * 1.765 + OAx * -3.003$
	Analog ABCD Economizers (ABCD)	$cz + CSP * -2.234 + EL * -16.394 + OAn * 1.744 + OAx * -3.01$
Convenience Store	DB	$cz + CSP * -3.982 + EL * -27.508 + OAn * 2.486 + OAx * -4.684$
	DTDB	$cz + EL * -20.798 + OAn * 2.365 + OAx * -3.773$
	DTEnth	$cz + EL * -30.655 + OAn * 2.938 + OAx * -4.461$
	Enth	$cz + CSP * -8.648 + EL * -25.678 + OAn * 2.092 + OAx * -3.754$
	ABCD	$cz + CSP * -3.64 + EL * -24.927 + OAn * 2.09 + OAx * -3.788$
	DB	$cz + CSP * -0.967 + EL * -6.327 + OAn * 2.87 + OAx * -1.047$

<sup>703</sup> DEER 2014 (DEER2014 EUT Table D08 v2.05).

<sup>704</sup> For more information on methodology, please refer to workpaper submitted by CLEAResult titled "CLEAResult\_Economizer Repair\_151020\_Finalv2.doc". Note that the original ComEd eQuest models were used in the analysis, rather than the VEIC developed models used elsewhere. VEIC do not consider this a significant issue as adjustments from the ComEd models were focused on calibrating EFLH values, not to overall energy use metrics. We also believe using the ComEd models is likely more conservative. It may be appropriate to update the analysis with the updated models at a later time.

<sup>705</sup> This approach allows the savings estimate to account for the operational attributes of the baseline as well as the proposed case, yielding a better estimate than an approach that assumes a particular baseline or proposed energy use to determine savings.

Building Type	Changeover Type	Equation
Office - Low Rise	DTDB	$cz+OAn*2.968+OAx*-0.943$
	DTEnth	$cz+EL*-9.799+OAn*3.106+OAx*-1.085$
	Enth	$cz+CSP*-2.773+EL*-7.392+OAn*2.941+OAx*-0.974$
	ABCD	$cz+CSP*-1.234+EL*-7.229+OAn*2.936+OAx*-0.995$
Religious Facility	DB	$cz+CSP*-1.131+OAn*3.542+OAx*-1.01$
	DTDB	$cz+EL*-10.198+OAn*4.056+OAx*-1.279$
	DTEnth	$cz+OAn*3.775+OAx*-1.031$
	Enth	$cz+CSP*-2.13+OAn*3.317+OAx*-0.629$
Restaurant	ABCD	$cz+CSP*-0.95+OAn*3.313+OAx*-0.647$
	DB	$cz+CSP*-2.243+EL*-21.523+OAx*-1.909$
	DTDB	$cz+EL*-14.427+OAn*0.295+OAx*-1.451$
	DTEnth	$cz+EL*-25.99+OAn*0.852+OAx*-1.951$
Retail - Department Store	Enth	$cz+CSP*-4.962+EL*-16.868+OAn*-0.12+OAx*-1.418$
	ABCD	$cz+CSP*-2.115+EL*-16.15+OAn*-0.125+OAx*-1.432$
	DB	$cz+CSP*-1.003+OAn*3.765+OAx*-0.938$
	DTDB	$cz+OAn*3.688+OAx*-0.676$
Retail - Strip Mall	DTEnth	$cz+OAn*4.081+OAx*-1.072$
	Enth	$cz+CSP*-2.545+OAn*3.725+OAx*-0.788$
	ABCD	$cz+CSP*-1.175+OAn*3.708+OAx*-0.809$
	DB	$cz+CSP*-1.192+EL*-5.62+OAn*3.353+OAx*-1.142$
Retail - Strip Mall	DTDB	$cz+OAn*3.355+OAx*-0.915$
	DTEnth	$cz+EL*-9.202+OAn*3.642+OAx*-1.215$
	Enth	$cz+CSP*-2.997+EL*-5.938+OAn*3.312+OAx*-0.964$
	ABCD	$cz+CSP*-1.36+EL*-5.884+OAn*3.3+OAx*-0.987$

Where:

CZ = Climate Zone Coefficient

= Depends on Building Type and Changeover Type (see table below)

Building Type	Changeover Type	Electric Climate Zone Coefficients				
		CZ1 (Rockford)	CZ2 (Chicago)	CZ3 (Springfield)	CZ4 (Belleville)	CZ5 (Marion)
Assembly	DB	874.07	886.73	1043.38	1071.48	1072.20
	DTDB	698.45	711.89	870.13	899.51	903.10
	DTEnth	702.06	715.42	873.43	902.76	906.50
	Enth	851.95	865.43	1020.65	1047.10	1053.32
	ABCD	884.19	897.63	1053.12	1080.58	1086.35
Convenience Store	DB	1739.12	1787.09	2128.78	2206.65	2245.93
	DTDB	1389.28	1436.30	1780.99	1863.45	1904.89
	DTEnth	1398.42	1446.82	1789.71	1869.89	1912.59
	Enth	1643.51	1691.34	2032.83	2112.21	2157.63
	ABCD	1692.80	1740.62	2082.35	2162.73	2207.68
Office - Low Rise	DB	674.06	687.17	899.17	993.84	989.16
	DTDB	583.62	597.02	811.39	907.61	903.58

Building Type	Changeover Type	Electric Climate Zone Coefficients				
		CZ1 (Rockford)	CZ2 (Chicago)	CZ3 (Springfield)	CZ4 (Belleville)	CZ5 (Marion)
	DTEnth	588.94	602.11	816.02	912.49	908.26
	Enth	668.83	682.23	893.61	987.52	986.59
	ABCD	690.27	703.52	915.27	1009.94	1008.59
Religious Facility	DB	613.26	630.50	853.53	923.99	931.74
	DTDB	518.40	535.45	760.76	832.57	840.72
	DTEnth	513.59	531.20	756.26	829.13	837.26
	Enth	576.94	594.17	817.64	888.37	897.18
	ABCD	593.78	611.04	834.69	905.83	914.27
Restaurant	DB	1397.27	1430.45	1763.21	1837.63	1872.18
	DTDB	1191.82	1225.12	1558.32	1633.95	1669.13
	DTEnth	1192.84	1226.77	1559.41	1635.13	1671.11
	Enth	1343.56	1377.52	1710.11	1783.66	1821.67
	ABCD	1373.72	1407.70	1740.43	1814.74	1852.55
Retail - Department Store	DB	717.89	730.07	968.85	1034.78	1035.06
	DTDB	628.83	641.70	883.37	951.09	951.33
	DTEnth	629.35	641.90	882.84	951.33	951.44
	Enth	705.06	717.99	956.42	1020.57	1024.45
	ABCD	728.60	741.47	980.19	1045.30	1048.57
Retail - Strip Mall	DB	800.69	818.68	1070.39	1129.87	1133.84
	DTDB	692.97	711.31	965.63	1026.68	1030.41
	DTEnth	698.12	716.34	970.06	1031.78	1035.72
	Enth	784.54	803.35	1054.37	1112.72	1120.74
	ABCD	810.10	828.86	1080.11	1139.39	1146.95

CSP = Economizer Changeover Setpoint (°F or Btu/lb) (actual in ranges below)

Economizer Control Type		Economizer Changeover Setpoint
Dry-Bulb		60°F - 80°F
Dual Temperature Dry-Bulb		0°F -5°F delta
Dual Temperature Enthalpy		0 Btu/lb -5 Btu/lb delta
Enthalpy		18 Btu/lb – 28 Btu/lb
Analog ABCD Economizers	A	73°F
	B	70°F
	C	67°F
	D	63°F
	E	55°F

EL = Integrated Economizer Operation (Economizer Lockout)  
 = 1 for Economizer w/ Integrated Operation (Two Stage Cooling)  
 = 0 for Economizer w/ out Integrated Operation (One Stage Cooling)

- Oan = Minimum Outside Air (% OSA)<sup>706</sup>  
 = Actual. Must be between 15% -70%. If unknown, assume:  
     Functional Economizer – 30%  
     Non functional Economizer (Damper failed closed) – 15%  
     Non functional Economizer (Damper failed open) – 30% (Assume Minimum Ventilation (Three Fingers))<sup>707</sup>
- Oax = Maximum Outside Air (%)  
 = Actual. Must be between 15% -70%. If unknown, assume:  
     Functional Economizer – 70%  
     Non functional Economizer (Damper failed closed) – 15%  
     Non functional Economizer (Damper failed open) – 30% (Assume Minimum Ventilation (Three Fingers))

**For example**, a low rise office building in Rockford (Climate Zone 1) is heated and cooled with a packaged Gas (92 kBtu output) / DX (5 Ton) RTU. The RTU is equipped with a fixed dry-bulb outside air economizer and is programmed for integrated operation. When the technician inspects the RTU they find that the changeover setpoint is programmed to 62°F, which does not meet ASHRAE economizer high limit shut off air economizer recommendations. After further investigation it is found that the OSA damper motor is not operational and is providing 30% outside air.

The technician replaces the damper motor and allow for proper OSA damper modulation (30% Min OSA & 70% Max OSA). They also adjust the fixed dry-bulb changeover setpoint to meet the ASHRAE economizer high limit shut off air economizer recommendation of 70°F.

$$\Delta kWh = [\text{Baseline Energy Use (kWh/Ton)} - \text{Proposed Energy Use (kWh/Ton)}] * \text{Cooling Capacity (Tons)}$$

$$\text{Baseline Energy Use (kWh/Ton)} = \text{Equation for Office Low Rise}$$

$$= cz + CSP * -0.967 + EL * -6.327 + OAn * 2.87 + OAx * -1.047$$

$$= 674.06 + 62 * -0.967 + 0 * -6.327 + 30 * 2.87 + 30 * -1.047$$

$$= 668.8 \text{ kWh/Ton}$$

$$\text{Proposed Energy Use (kWh/Ton)} = \text{Equation for Office Low Rise}$$

$$= cz + CSP * -0.967 + EL * -6.327 + OAn * 2.87 + OAx * -1.047$$

$$= 674.06 + 70 * -0.967 + 0 * -6.327 + 30 * 2.87 + 70 * -1.047$$

$$= 619.2 \text{ kWh/Ton}$$

$$\Delta kWh = [668.8 \text{ (kWh/Ton)} - 619.2 \text{ (kWh/Ton)}] * 5 \text{ Tons}$$

$$= 49.6 \text{ kWh/Ton} * 5 \text{ Tons}$$

$$= 248.08 \text{ kWh}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A - It is assumed that repair or optimization of the economizer will not typically have a significant impact summer peak demand.

<sup>706</sup> DNV GL, "HVAC Impact Evaluation Final Report WO32 HVAC – Volume 1: Report," California Public Utilities Commission, Energy Division, HVAC Commercial Quality Maintenance (CQM) (1/28/14).

<sup>707</sup> Technician rule of thumb taken from CPUC 'HVAC Impact Evaluation Final Report', WO32, 28Jan 2015, p18.



**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = [\text{Baseline Energy Use (Therms/kBtuh)} - \text{Proposed Energy Use (Therms/kBtuh)}] * \text{Output Heating Capacity (kBtuh)}$$

The following equations are used to calculate baseline and proposed electric energy use.

**Natural Gas Energy Use Equations (therms / kbtu output)**

Building Type	Changeover Type	Equation
Assembly	Fixed Dry-Bulb (DB)	$cz+OAn*0.0853$
	Dual Temperature Dry-Bulb (DTDB)	$cz+OAn*0.0866$
	Dual Temperature Enthalpy (DTEnth)	$cz+OAn*0.0866$
	Fixed Enthalpy (Enth)	$cz+OAn*0.0855$
	Analog ABCD Economizers (ABCD)	$cz+OAn*0.0855$
Convenience Store	DB	$cz+OAn*0.26$
	DTDB	$cz+OAn*0.263$
	DTEnth	$cz+OAn*0.263$
	Enth	$cz+OAn*0.261$
	ABCD	$cz+OAn*0.261$
Office - Low Rise	DB	$cz+OAn*0.3$
	DTDB	$cz+OAn*0.301$
	DTEnth	$cz+OAn*0.301$
	Enth	$cz+OAn*0.3$
	ABCD	$cz+OAn*0.3$
Religious Facility	DB	$cz+OAn*0.35$
	DTDB	$cz+OAn*0.348$
	DTEnth	$cz+OAn*0.348$
	Enth	$cz+OAn*0.349$
	ABCD	$cz+OAn*0.349$
Restaurant	DB	$cz+OAn*0.0867$
	DTDB	$cz+OAx*-0.038+OAn*OAx*0.00149$
	DTEnth	$cz+OAx*-0.038+OAn*OAx*0.00149$
	Enth	$cz+OAn*0.0878$
	ABCD	$cz+OAn*0.0878$
Retail - Department Store	DB	$cz+OAn*0.319$
	DTDB	$cz+OAn*0.318$
	DTEnth	$cz+OAn*0.318$
	Enth	$cz+OAn*0.318$
	ABCD	$cz+OAn*0.318$
Retail - Strip Mall	DB	$cz+OAn*0.215$
	DTDB	$cz+OAn*0.216$
	DTEnth	$cz+OAn*0.216$
	Enth	$cz+OAn*0.215$
	ABCD	$cz+OAn*0.215$

Where:

CZ = Climate Zone Coefficient

= Depends on Building Type and Changover Type (see table below)

Building Type	Changeover Type	Natural Gas Climate Zone Coefficients				
		CZ1 (Rockford)	CZ2 (Chicago)	CZ3 (Springfield)	CZ4 (Belleville)	CZ5 (Marion)
Assembly	DB	-0.03	-0.55	-1.06	-1.28	-1.71
	DTDB	-0.02	-0.57	-1.11	-1.34	-1.79
	DTEnth	-0.02	-0.57	-1.11	-1.34	-1.79
	Enth	-0.03	-0.55	-1.06	-1.29	-1.72
	ABCD	-0.03	-0.55	-1.06	-1.29	-1.72
Convenience Store	DB	2.95	0.50	-1.48	-2.96	-5.56
	DTDB	3.06	0.52	-1.56	-3.11	-5.81
	DTEnth	3.06	0.52	-1.56	-3.11	-5.81
	Enth	2.96	0.50	-1.49	-2.98	-5.59
	ABCD	2.96	0.50	-1.49	-2.98	-5.59
Office - Low Rise	DB	5.83	3.02	0.46	-0.92	-4.13
	DTDB	5.98	3.08	0.41	-1.03	-4.36
	DTEnth	5.98	3.08	0.41	-1.03	-4.36
	Enth	5.85	3.03	0.46	-0.93	-4.16
	ABCD	5.85	3.03	0.46	-0.93	-4.16
Religious Facility	DB	9.23	6.71	3.75	2.40	-0.80
	DTDB	9.41	6.83	3.77	2.39	-0.86
	DTEnth	9.41	6.83	3.77	2.39	-0.86
	Enth	9.25	6.73	3.75	2.40	-0.80
	ABCD	9.25	6.73	3.75	2.40	-0.80
Restaurant	DB	8.30	6.54	4.94	4.00	1.95
	DTDB	10.51	8.71	7.07	6.10	4.00
	DTEnth	10.51	8.71	7.07	6.10	4.00
	Enth	8.28	6.51	4.91	3.96	1.90
	ABCD	8.28	6.51	4.91	3.96	1.90
Retail - Department Store	DB	8.20	5.86	3.19	1.25	-2.59
	DTDB	8.35	5.94	3.18	1.18	-2.75
	DTEnth	8.35	5.94	3.18	1.18	-2.75
	Enth	8.21	5.87	3.18	1.24	-2.61
	ABCD	8.21	5.87	3.18	1.24	-2.61
Retail - Strip Mall	DB	6.40	4.35	2.07	0.49	-2.18
	DTDB	6.51	4.38	2.03	0.39	-2.34
	DTEnth	6.51	4.38	2.03	0.39	-2.34
	Enth	6.41	4.35	2.06	0.48	-2.20
	ABCD	6.41	4.35	2.06	0.48	-2.20

**For example**, a low rise office building in Rockford (Climate Zone 1) is heated and cooled with a packaged Gas (92 kBtu output) / DX (5 Ton) RTU. The RTU is equipped with a fixed dry-bulb outside air economizer and is programmed for integrated operation. When the technician inspects the RTU they find that the changeover setpoint is programmed to 62°F, which does not meet ASHRAE economizer high limit shut off air economizer recommendations. After further investigation it is found the OSA damper motor is not operational and is providing 30% outside air.

The technician replaces the damper motor and allow for proper OSA damper modulation (30% Min OSA & 70% Max OSA). They also adjust the fixed dry-bulb changeover setpoint to meet the ASHRAE economizer high limit shut off air economizer recommendation of 70°F.

$$\Delta\text{Therms} = [\text{Baseline Energy Use (Therms/kBtuh)} - \text{Proposed Energy Use(Therms/kBtuh)}] * \text{Output Heating Capacity (kBtuh)}$$

$$\text{Baseline Energy Use (Therms/kBtuh)} = \text{Equation for Office Low Rise}$$

$$= cz+OAn*0.3$$

$$= 5.83+30*.3$$

$$=14.8 \text{ Therms/kBtuh output}$$

$$\text{Proposed Energy Use (Therms/kBtuh)} = \text{Equation for Office Low Rise}$$

$$= cz+OAn*0.3$$

$$= 5.83+30*.3$$

$$=14.8 \text{ Therms/kBtuh output}$$

$$\Delta\text{Therms} = [14.8(\text{Therms/kBtuh output}) - 14.8 (\text{Therms/kBtuh output})] * 92\text{kBtuh output}$$

$$= 0.0 (\text{Therms/kBtuh output}) * 92\text{kBtuh output}$$

$$= 0 \text{ Therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-ECRP-V03-180101**

**REVIEW DEADLINE: 1/1/2023**

## 4.4.36 Multi-Family Space Heating Steam Boiler Averaging Controls

### DESCRIPTION

This measure covers multi-family space heating boiler averaging controls. Temperature sensors are placed in interior spaces to monitor the average temperature of the building. At minimum a sensor must be placed at each corner and at one central location. Additionally, a temperature sensor must monitor the outside air temperature. These sensors shall provide data to the averaging controls. The averaging controls will adjust the boiler operation based upon an average of the indoor sensors and the outside air temperature. These controls shall also incorporate a night-time setback capability. Buildings utilizing thermostatic radiator valves, or other modulating control valves or sequences to control the temperature in individual spaces are not eligible.

This measure was developed to be applicable to the following program types: RF.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler(s) must incorporate an averaging control system utilizing at least 4 indoor sensors and 1 outdoor sensor. The controls shall have the capability to incorporate a nighttime setback throughout the building.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is a boiler system without averaging controls or other steam supply modulating controls. Current boiler control system can utilize a single thermostat or aquastat and timer.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the domestic hot water boilers is 20 years.<sup>708</sup>

### DEEMED MEASURE COST

As a retrofit measure, the actual installed cost should be used for screening purposes. A deemed retrofit measure cost of \$5,060 can be used if the actual installed cost is unknown.<sup>709</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

---

<sup>708</sup> The Brooklyn Union Gas Company, High Efficiency Heating and Water and Controls, Gas Energy Efficiency Program Implementation Plan.

<sup>709</sup> NREL, "Steam Balancing and Tuning for Multifamily Residential Buildings in Chicagoland-Second Year of Data Collection", August 2013.

### NATURAL GAS ENERGY SAVINGS

$$\Delta\text{Therms} = \text{Capacity} \times \text{EFLH} \times \text{SF} / 100,000$$

Where:

Capacity	= Boiler gas input size (Btu/h)
	= Actual
EFLH	= Effective Full Load Hours for heating in Existing Buildings are provided in section 4.4. HVAC End Use
SF	= Savings Factor
	= 10.2%, <sup>710</sup> or custom if savings can be substantiated
100,000	= converts Btu/h to therm

**For example**, a 1,000,000 btu/h steam boiler in a Mid-Rise Multi-Family building in Chicago has averaging controls installed.

$$\begin{aligned}\Delta\text{Therms} &= 1,000,000 \times 1,685 \times 0.102 / 100,000 \\ &= 1,719 \text{ therms}\end{aligned}$$

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

**MEASURE CODE: CI-HVC-SBAC-V02-190101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>710</sup> "Steam Balancing and Tuning for Multifamily Residential Buildings in Chicagoland-Second Year of Data Collection", NREL, August 2013, states that test buildings with steam balancing measures saved an average of 10.2%. The energy savings estimate assumes additional system balancing through the installation of large capacity air vents on steam main lines and the replacement of radiator vents. This work is assumed to be done in concert with any system being retrofitted with averaging controls.

## 4.4.37 Unitary HVAC Condensing Furnace

### DESCRIPTION

Condensing furnaces recover energy in combustion exhaust flue gasses that would otherwise simply be vented to the atmosphere, making them more efficient than non-condensing furnaces. This measure applies to a constant volume (CV), dedicated outside air system (DOAS), make-up air system (MUAS), or any unitary HVAC system that is utilizing an indirect gas fired process to heat 100% OA to provide ventilation or make-up air to commercial and industrial (C&I) building spaces. The unitary package must contain an indirect gas-fired, warm air furnace section, but the unitary package can be with or without an electric air conditioning section. The unitary package can be either a single package or split system that is applied indoors (non-weatherized) or outdoors (weatherized).

This measure excludes demand control ventilation, condensing unit heaters, and high efficiency (condensing) furnaces with annual fuel utilization efficiency (AFUE) ratings (for furnaces with less than 225,000 Btu/hr input capacity), which are covered by other measures for the C&I sector in the Technical Reference Manual (TRM).<sup>711</sup>

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the efficient unitary equipment must contain a condensing, warm air furnace with a natural gas thermal efficiency (TE) rating of 90% or higher, or alternatively, the unitary package must have equipment nameplate information for natural gas that identifies a heating output and heating input rating that has an output over input ratio of 0.90 or higher. These ratings must be certified by a recognized testing laboratory in accordance with American National Standards Institute (ANSI) Standard Z21.47 for Gas-Fired Central Furnaces.<sup>712</sup> The furnace must be vented and condensate disposed of in accordance with the equipment manufacturer installation instructions and applicable codes.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is expected to be unitary equipment that contains a non-condensing, warm air furnace with a natural gas thermal efficiency (TE) rating of 80%, or alternatively, the unitary package will have equipment nameplate information for natural gas that identifies a heating output and heating input rating that has an output over input ratio of 0.80. These ratings must be certified by a recognized testing laboratory in accordance with American National Standards Institute (ANSI) Standard Z21.47 for Gas-Fired Central Furnaces.

Note the current Department of Energy (DOE) federal minimum efficiency standard is 80% for 225,000 Btu/hr and higher input capacity furnaces per the Energy Conservation Standard for Commercial Warm Air Furnaces.<sup>713</sup> In the American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE) Standard 90.1 Energy Standard for Buildings Except Low-Rise Residential Buildings<sup>714</sup> that minimum TE requirement is extended below 225,000 Btu/hr input capacity to require all commercial warm air furnaces and combination warm air furnace/air conditioning units to meet the minimum 80% TE.

Note: new Federal Standards applicable to all gas furnaces become effective January 1, 2023.

---

<sup>711</sup> Illinois Statewide Technical Reference Manual (TRM), Version 4.0 (effective June 1, 2015), 2015.

<sup>712</sup> American National Standards Institute (ANSI), ANSI Z21.47 Standard for Central Gas-Fired Central Furnaces, 2012.

<sup>713</sup> Department of Energy (DOE), Commercial Warm Air Furnace Standard DOE 10 CFR, Part 431, Subpart D – Commercial Warm Air Furnaces, 2004.

<sup>714</sup> American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE), ASHRAE Standard 90.1 Energy Standard for Buildings Except Low-Rise Residential Buildings, 2013.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 15 years, which is consistent with the established TRM measure life for single-package and split system unitary air conditioners, since in colder climates these unitary packages typically contain a gas-fired, warm air furnace section, with an electric air conditioning section.

**DEEMED MEASURE COST**

The actual incremental equipment and installation costs should be used, if available. If not, the incremental cost of \$5.42 per 1000 Btu/hr of output capacity should be used for the condensing furnace equipment (as part of a unitary package) and its installation (including the combustion condensate drainage and disposal system). This incremental cost is from the DOE Technical Support Document for the Notice of Proposed Rulemaking (NOPR) for the Commercial Warm Air Furnace Standard.<sup>715</sup> Per the DOE documentation, it is based on their representative 250,000 Btu/hr input capacity furnace at a 92% TE.

**LOADSHAPE**

Loadshape C23 - Commercial Ventilation

**COINCIDENCE FACTOR**

The coincidence factor is assumed to be 1.0 – that is, building ventilation will always be provided during peak periods.

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

The following methodology provides formulas for estimating gas heating savings associated with condensing furnaces in unitary HVAC packages when applied as a CV, DOAS, MUAS, or any RTU that is indirectly heating 100% outside air (OA). These types of HVAC systems typically run continuously during the HVAC operating schedule to provide building ventilation and maintain indoor air quality or to compensate for exhaust and maintain neutral or slightly positive building pressurization. The algorithm estimates the gas use reduction resulting from utilizing condensing heating of 90% or higher thermal efficiency (TE) in place of the federal minimum TE of 80% (or other user defined baseline TE) for commercial warm air furnaces.

The methodology provides a representative group of operating schedules for the market sector applications highlighted earlier based on DOE commercial reference building models.<sup>716</sup> Heating loads during the operating schedule are determined based on hourly differences between a range of supply air (SA) heated to temperatures and the OA temperature using Typical Meteorological Year (TMY3) weather data.<sup>717</sup> These hourly heating loads are generated for all hours when the OA temperature is below the base temperature of 55 °F for heating in C&I settings per the TRM. To accommodate the variability in heating base temperatures in C&I settings, these hourly heating loads are also generated for base temperatures of 45 °F and 65 °F for heating. The hourly heating loads are then summed for the entire year. The annual heating loads are calculated in this manner for the climate zone 2 weather station (Chicago O’Hare Airport), which is then normalized to its National Climatic Data Center (NCDC)<sup>718</sup> 30-year (1981-2010) weather average by multiplying by the heating degree day (HDD) ratio of the NCDC/TRM HDD55 over the TMY3 HDD55 (HDD at base temperature of 55 °F), and likewise for the annual heating loads for HDD45 (HDD at base temperature of 45 °F) and HDD65 (HDD at base temperature of 65 °F), using the values in Table 1 and Table 2. Since detailed hourly weather data is not available for all 5 of the TRM climate zone weather stations, the annual heating loads for the other climate zones are determined by multiplying the climate zone 2 annual heating loads by the ratio of the other climate zone NCDC HDD over the climate zone 2 NCDC HDD, using the values in Table 1.

---

<sup>715</sup> Department of Energy (DOE), Rulemaking for Commercial Warm Air Furnace Standard, Technical Support Document 2015.

<sup>716</sup> Department of Energy (DOE) National Renewable Energy Laboratory, Commercial Reference Building Models of the National Building Stock, 2011.

<sup>717</sup> Department of Energy (DOE) National Renewable Energy Laboratory, User’s Manual for TMY3 Data Sets, 2008.

<sup>718</sup> National Climatic Data Center, 1981-2010 Climate Normals, 2015.

These annual heating loads on a per unit airflow basis are then used in conjunction with the actual airflow of the 100% OA system and its condensing efficiency to calculate the gas heating savings versus the baseline (non-condensing) heating efficiency. This measure results in additional electric use by the unitary HVAC package due to the additional pressure drop of the condensing heat exchanger of the warm air furnace section.

**Table 1. NCDC/TRM HDD Values for All Climate Zones**

Climate Zone - Weather Station/City	NCDC 30 Year Average HDD45 <sup>8</sup>	NCDC 30 Year Average HDD55 <sup>1,8</sup>	NCDC 30 Year Average HDD65 <sup>8</sup>
1 - Rockford AP / Rockford	2495	4272	6569
2 - Chicago O'Hare AP / Chicago	2263	4029	6340
3 - Springfield #2 / Springfield	1812	3406	5495
4 - Belleville SIU RSCH / Belleville	1197	2515	4379
5 - Carbondale Southern IL AP / Marion	1183	2546	4477

**Table 2. TMY3 HDD Values for Climate Zone 2**

Climate Zone - Weather Station/City	TMY3 HDD45 <sup>7</sup>	TMY3 HDD55 <sup>7</sup>	TMY3 HDD65 <sup>7</sup>
2 - Chicago O'Hare AP / Chicago	2422	4188	6497

**ELECTRIC ENERGY SAVINGS**

As noted previously, this measure results in additional SA fan electric use by the unitary HVAC system due to the additional pressure drop of the condensing heat exchanger of the warm air furnace section.

$$\Delta kWh = - (t_{FAN} * cfm * \Delta P) / (\eta_{FAN/MOTOR} * 8520)$$

Where:

t<sub>FAN</sub> = annual fan runtime (hr), refer to Tables 1 through 4

cfm = airflow (cfm), use actual or rated system airflow

ΔP = incremental pressure drop (inch W.G.), assume 0.15 if actual value not known

η<sub>FAN/MOTOR</sub> = combined fan and motor efficiency, assume 0.60 if actual value not known

8520 = conversion factor (fan horsepower – HP – calculation constant of 6356 for standard air conditions adjusted by 1 HP = 0.746 kW, or 6356/ 0.746 = 8520 for this kW calculation)

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

The additional SA fan electric use by the unitary HVAC system will typically result in a modest electric demand increase.

**For example**, for a “big box” retail store operating 24 hours a day and 7 days a week (8760 hours per year) with a 5000 cfm DOAS that has an incremental pressure drop of 0.15 inch W.G. and a combined fan and motor efficiency of 0.6 has annual kWh savings of:

$$\begin{aligned} \Delta kWh &= - (t_{FAN} * cfm * \Delta P) / (\eta_{FAN/MOTOR} * 8520) \\ &= - (8760 * 5000 * 0.15) / (0.6 * 8520) \\ &= - 1285 kWh \end{aligned}$$



$$\Delta kW = (\Delta kWh / t_{FAN}) * CF$$

Where:

$$CF = 1.0$$

**Continuing the previous example:**

$$\begin{aligned} \Delta kW &= (\Delta kWh / t_{FAN}) * CF \\ &= (- 1285 / 8760) * 1.0 \\ &= - 0.15 kW \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

$$\Delta Therms = [Q_{OA} * cfm * (1/TE_{NC} - 1/TE_C)] / 100,000$$

Where:

$$Q_{OA} = \text{annual outside air (OA) heating load per cfm of OA (Btu/cfm)}$$

First, select the most representative operating schedule for the application from among the four (4) scenarios listed below and its set of three (3) applicable tables. Second, select the table in that set with the most representative HDD base temperature – the base temperature for OA below which heating is required. If that base temperature is not readily determined, select the TRM default base temperature of 55 °F (HDD55) for heating in C&I settings. Third, select the climate zone within that table. Fourth, select an appropriate heated to supply air (SA) temperature within that table. Use the resulting  $Q_{OA}$  value, with linear interpolation allowed between SA temperatures.

The four (4) scenarios available are indicative of the following building applications and operating schedules:

1. 24 hour a day and 7 day a week (24/7) operation, with HVAC operating schedule of 8760 hours per year, typical of large retail stores with DOAS, hotel/multifamily buildings with corridor MUAS, and healthcare facilities with DOAS. Use Table 3 through Table 5.
2. 6:00 AM to 1:00 AM every day operation, with HVAC operating schedule of 7300 hours per year, typical of full service and quick service restaurants with kitchen MUAS. Use Table 6 through Table 8.
3. 7:00 AM to 9:00 PM Monday-Friday, 7:00 AM to 10:00 PM Saturday, and 9:00 AM to 7:00 PM Sunday operations, with HVAC operating schedule of 5266 hours per year, typical of non-24/7 retail stores with DOAS. Use Table 9 through Table 11.
4. 7:00 AM to 9:00 PM Monday-Friday operation, with HVAC operating schedule of 3911 hours per year, typical of school buildings with DOAS. Use Table 12 through Table 14.

$$TE_{NC} = \text{non-condensing thermal efficiency (TE), use federal minimum TE of 80\% (0.80) or actual TE if known}$$

$$TE_C = \text{condensing thermal efficiency (TE), use actual TE or if unknown assume 90\% (0.90)}$$

100,000 = conversion factor (1 therm = 100,000 Btu)

**Continuing the previous example:** for a climate zone 2 (Chicago O'Hare AP / Chicago) application using a 90% TE condensing DOAS with a supply air temperature from the DOAS of 95 °F:

$$\begin{aligned} \Delta\text{Therms} &= [Q_{\text{OA}} * \text{cfm} * (1/\text{TE}_{\text{NC}} - 1/\text{TE}_{\text{C}})] / 100,000 \\ &= 303,268 * 5,000 * (1/0.80 - 1/0.90) / 100,000 \\ &= 2,106 \text{ therms} \end{aligned}$$

8760 Hour Annual Operation Scenario

**Table 3. 8760 Hour Annual Operation Scenario for HDD45**

Supply Air Fan Runtime = 8760 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone - Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	189,343	230,897	272,451	314,004
2 - Chicago O'Hare AP / Chicago	171,737	209,427	247,116	284,806
3 - Springfield #2 / Springfield	137,511	167,689	197,868	228,046
4 - Belleville SIU RSCH / Belleville	90,839	110,775	130,711	150,647
5 - Carbondale Southern IL AP / Marion	89,777	109,479	129,182	148,885

**Table 4. 8760 Hour Annual Operation Scenario for HDD55**

Supply Air Fan Runtime = 8760 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone - Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	216,145	268,852	321,559	374,266
2 - Chicago O'Hare AP / Chicago	203,850	253,559	303,268	352,977
3 - Springfield #2 / Springfield	172,329	214,351	256,374	298,397
4 - Belleville SIU RSCH / Belleville	127,248	158,278	189,307	220,337
5 - Carbondale Southern IL AP / Marion	128,817	160,229	191,641	223,053

**Table 5. 8760 Hour Annual Operation Scenario for HDD65**

Supply Air Fan Runtime = 8760 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone - Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	239,158	308,050	376,942	445,834
2 - Chicago O'Hare AP / Chicago	230,820	297,311	363,802	430,292
3 - Springfield #2 / Springfield	200,056	257,685	315,314	372,943
4 - Belleville SIU RSCH / Belleville	159,426	205,351	251,276	297,200
5 - Carbondale Southern IL AP / Marion	162,994	209,947	256,899	303,852

7300 Hour Annual Operation Scenario

**Table 6. 7300 Hour Annual Operation Scenario for HDD45**

Supply Air Fan Runtime = 7300 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	151,914	185,369	218,823	252,278
2 - Chicago O'Hare AP / Chicago	137,788	168,132	198,476	228,819
3 - Springfield #2 / Springfield	110,328	134,624	158,921	183,217
4 - Belleville SIU RSCH / Belleville	72,882	88,932	104,982	121,033
5 - Carbondale Southern IL AP / Marion	72,030	87,892	103,755	119,617

**Table 7. 7300 Hour Annual Operation Scenario for HDD55**

Supply Air Fan Runtime = 7300 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	173,511	215,950	258,389	300,828
2 - Chicago O'Hare AP / Chicago	163,641	203,666	243,691	283,716
3 - Springfield #2 / Springfield	138,338	172,174	206,010	239,846
4 - Belleville SIU RSCH / Belleville	102,149	127,133	152,118	177,103
5 - Carbondale Southern IL AP / Marion	103,408	128,701	153,993	179,286

**Table 8. 7300 Hour Annual Operation Scenario for HDD65**

Supply Air Fan Runtime = 7300 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	191,803	247,046	302,288	357,531
2 - Chicago O'Hare AP / Chicago	185,117	238,434	291,750	345,067
3 - Springfield #2 / Springfield	160,444	206,655	252,866	299,076
4 - Belleville SIU RSCH / Belleville	127,859	164,685	201,510	238,336
5 - Carbondale Southern IL AP / Marion	130,720	168,370	206,020	243,670

5266 Hour Annual Operation Scenario

**Table 9. 5266 Hour Annual Operation Scenario for HDD45**

Supply Air Fan Runtime = 5266 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	104,175	127,350	150,524	173,699
2 - Chicago O'Hare AP / Chicago	94,488	115,508	136,527	157,547
3 - Springfield #2 / Springfield	75,657	92,488	109,319	126,149
4 - Belleville SIU RSCH / Belleville	49,979	61,097	72,215	83,334
5 - Carbondale Southern IL AP / Marion	49,394	60,383	71,371	82,359

**Table 10. 5266 Hour Annual Operation Scenario for HDD55**

Supply Air Fan Runtime = 5266 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	118,320	147,406	176,492	205,578
2 - Chicago O'Hare AP / Chicago	111,590	139,021	166,452	193,884
3 - Springfield #2 / Springfield	94,335	117,524	140,714	163,904
4 - Belleville SIU RSCH / Belleville	69,657	86,780	103,904	121,027
5 - Carbondale Southern IL AP / Marion	70,516	87,850	105,184	122,519

**Table 11. 5266 Hour Annual Operation Scenario for HDD65**

Supply Air Fan Runtime = 5266 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	130,903	168,718	206,532	244,347
2 - Chicago O'Hare AP / Chicago	126,339	162,836	199,333	235,829
3 - Springfield #2 / Springfield	109,501	141,133	172,765	204,398
4 - Belleville SIU RSCH / Belleville	87,262	112,470	137,678	162,886
5 - Carbondale Southern IL AP / Marion	89,215	114,987	140,759	166,531

3911 Hour Annual Operation Scenario

**Table 12. 3911 Hour Annual Operation Scenario for HDD45**

Supply Air Fan Runtime = 3911 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	75,029	91,729	108,428	125,128
2 - Chicago O'Hare AP / Chicago	68,053	83,199	98,346	113,492
3 - Springfield #2 / Springfield	54,490	66,618	78,746	90,874
4 - Belleville SIU RSCH / Belleville	35,996	44,008	52,019	60,031
5 - Carbondale Southern IL AP / Marion	35,575	43,493	51,411	59,329

**Table 13. 3911 Hour Annual Operation Scenario for HDD55**

Supply Air Fan Runtime = 3911 Hours	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	Climate Zone -Weather Station/City	75°F	85°F	95°F
1 - Rockford AP / Rockford	85,672	106,825	127,979	149,132
2 - Chicago O'Hare AP / Chicago	80,799	100,749	120,699	140,649
3 - Springfield #2 / Springfield	68,305	85,170	102,035	118,901
4 - Belleville SIU RSCH / Belleville	50,436	62,890	75,343	87,797
5 - Carbondale Southern IL AP / Marion	51,058	63,665	76,272	88,879

**Table 14. 3911 Hour Annual Operation Scenario for HDD65**

Supply Air Fan Runtime = 3911 Hours Climate Zone -Weather Station/City	Q <sub>oa</sub> (Annual Btu/cfm) At Supply Air Temperature Of			
	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	95,460	123,294	151,128	178,963
2 - Chicago O'Hare AP / Chicago	92,132	118,996	145,860	172,724
3 - Springfield #2 / Springfield	79,853	103,136	126,420	149,703
4 - Belleville SIU RSCH / Belleville	63,635	82,190	100,745	119,299
5 - Carbondale Southern IL AP / Marion	65,059	84,029	102,999	121,969

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

The actual incremental annual maintenance costs should be used, if available. If not, the incremental cost of \$0.05 per 1000 Btu/hr of output capacity should be used for maintaining the combustion condensate disposal system yearly. This incremental cost is from the DOE Technical Support Document for the Notice of Proposed Rulemaking (NOPR) for the Commercial Warm Air Furnace Standard. Per the DOE documentation, it is based on their representative 250,000 Btu/hr input capacity furnace at a 92% TE.

**MEASURE CODE: CI-HVC-DSFN-V02-190101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.38 Covers and Gap Sealers for Room Air Conditioners

### DESCRIPTION

Room air conditioners (window ACs, through-the-wall or sleeve ACs, PTACs or PTHPs) constitute a permanent or semi-permanent penetration through the building's envelope. These units are often poorly installed, resulting in gaps that act like air leakage pathways through the building's envelope. The uncontrolled movement of air across the gaps in the envelope (infiltration) increases the building's winter heating requirements and reduces its overall energy performance.

The heat loss and infiltration can be reduced by installing a rigid or flexible insulated cover on the inside of a room AC. These covers should be maintained by building staff and should remain installed through the heating season. Simple uninsulated cloth covers with no sealing at edges do not qualify for this measure.

There are several types of AC covers available that may be eligible for this measure:

1. If the room AC is left in the window or sleeve, a rigid cover that covers the indoor side of the AC unit with foam gaskets to seal the edges may be installed.
2. If the room AC is absent or is removed during the heating months, a rigid cover that fits inside the sleeve with foam gaskets along the edges for proper air sealing may be installed.
3. Flexible covers that are well insulated and perfectly cover the indoor side of the AC unit may also be eligible for this measure.

This measure was developed to be applicable to the following program types: RF, DI. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The installed equipment is a rigid cover that fits inside the empty sleeve or completely covers the indoor side of a window AC unit, with foam gaskets sealing the edges. A flexible insulated cover that perfectly covers the indoor side of the unit and seals gaps may also be installed. Covers should remain installed throughout the winter heating season.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a room AC (window AC, through-the-wall or sleeve AC, PTAC or PTHP) that is poorly installed with gaps around the edges and does not use AC covers or gap sealers during the winter heating months.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life of typical AC covers is 5 years.<sup>719</sup>

### DEEMED MEASURE COST

The measure cost is the full cost of installing AC covers. Actual installation costs (material and labor) should be used if available. In actual costs are unknown, assume material cost of \$24 (flexible covers) up to \$119, depending on size of the AC unit.<sup>720</sup> The install time per unit is 15 to 30 minutes at assumed labor rate of \$20/hour.

### LOADSHAPE

Loadshape C04 – Commercial Electric Heating

### COINCIDENCE FACTOR

N/A

---

<sup>719</sup> New York Standard Approach for Estimating Energy Savings from Energy Efficiency Programs V4, April 2016 (New York TRM).

<sup>720</sup> Cost estimates from customer invoices and vendors. Material costs can be lower for bulk orders.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

If the building is electrically heated, electric energy savings are calculated as follows:

$$\Delta kWh = (Q_{infiltration} * 1.08 * (T_{SA} - T_{OA}) * EFLH_{heat}) / (3,412 * COP)$$

Where:

$$Q_{infiltration} = \text{Air infiltration (CFM) due to poor installation of window or through-the-wall AC}^{721}$$

$$= ELA * 0.000645 * (f_s^2 * (T_{SA} - T_{OA}) + f_w^2 * U^2)^{1/2} * 2118.88$$

Where:

ELA = Effective Leakage Area (sq. in.)  
 = Can be collected on site; if unknown, assume 6 sq. in.<sup>722</sup>

0.000645= Converts square inches to square meters

f<sub>s</sub> = Stack Coefficient  
 = 1/3 \* (9.81 \* Height \* 0.3048 / T<sub>OA</sub>)<sup>0.5</sup>

f<sub>w</sub> = Wind Coefficient  
 = A \* B \* (Height \* 0.3048 / 10)<sup>C</sup>

Where:

9.81 = Acceleration due to gravity (m/s<sup>2</sup>)

Height = Height of the location of the leakage area in feet  
 = Assume 8 ft per floor

0.3048 = Converts feet to meters

T<sub>OA</sub> = Average Outside Air Temperature during heating period.<sup>723</sup>  
 Use values from table below, based on facility location.<sup>724</sup> This figure must be in Kelvin to determine Stack Coefficient (f<sub>s</sub>) and infiltration (Q<sub>infiltration</sub>), but in Fahrenheit to determine energy savings (ΔkWh, ΔTherms).

Zone	T <sub>OA</sub> (°F)	T <sub>OA</sub> (K)
Zone 1 (Rockford)	31.63	272.94
Zone 2 (Chicago)	33.99	274.26
Zone 3 (Springfield)	34.58	274.58
Zone 4 (Belleville)	36.24	275.51
Zone 5 (Marion)	39.07	277.08

<sup>721</sup> Infiltration equation and values for stack and wind coefficient equations from “The Use of Blower Door Data.” Max Sherman, 1998. The equation is adjusted for wall leakage area (i.e. no ceiling or floor leakage).

<sup>722</sup> Average effective leakage area for multi-family building AC units from “There are Holes in Our Walls.” Prepared for Urban Green Council by Steven Winter Associates, April 2011.

<sup>723</sup> “Heating Period” is defined as hours when the TMY3 dry bulb temperature is less than 55°F (balance point).

<sup>724</sup> Based on NREL’s Typical Meteorological Year 3 (TMY3) data for different weather stations.

A, B and C = Constants based on the facility site’s shielding and terrain parameters. Use values from the tables below.<sup>725</sup>

Shielding Class	Shielding Type	Shielding Description	A
1	None	No obstructions or local shielding whatsoever (i.e. isolated building)	0.324
2	Light	Light local shielding with few obstructions (e.g. A few trees or a shed in the vicinity)	0.285
3	Moderate	Moderate local shielding; some obstructions within two house heights (e.g. Thick hedge fence on fence and nearby building)	0.24
4	Heavy	Heavy shielding; obstructions around most of perimeter buildings or trees within five building heights in most directions (e.g. Well developed/dense tract house)	0.185
5	Very Heavy	Very heavy shielding, large obstruction surrounding perimeter within two house heights (e.g. Typical downtown area)	0.102

Terrain Class	Terrain Type	Terrain Description	B	C
1	None	Ocean or other body of water with at least 5 km of unrestricted space	1.3	0.1
2	Light	Flat terrain with some isolated obstacles (e.g. Buildings or trees well separated from each other)	1	0.15
3	Moderate	Rural areas with low buildings, trees etc.	0.85	0.2
4	Heavy	Urban, industrial or forest areas	0.67	0.25
5	Very Heavy	Center of large city (e.g. Manhattan)	0.47	0.35

0.3048 = Converts feet to meters

T<sub>SA</sub> = Average Indoor Air Temperature during heating period. This figure will need to be in Kelvin to calculate infiltration (Q<sub>infiltration</sub>) and Fahrenheit to calculate energy savings (ΔkWh, ΔTherms).

= Collected on site. If unknown, assume 72°F (295 K). If known, convert °F to K by using the following equation: K = (°F + 459.67) \* (5/9).

U = Average Wind Speed (m/s) during heating period. Use table below, based on facility location.<sup>726</sup>

Zone	U (m/s)
Zone 1 (Rockford)	4.50
Zone 2 (Chicago)	4.67
Zone 3 (Springfield)	4.60
Zone 4 (Belleville)	3.92
Zone 5 (Marion)	3.07

<sup>725</sup> Shielding and terrain class descriptions and constants from “The Use of Blower Door Data.” Max Sherman, 1998” and “Wind and Infiltration Interaction for Small Buildings.” MH Sherman and DT Grimsrud, Lawrence Berkley Laboratory, 1982.

<sup>726</sup> Based on TMY3 data, see “Covers for Room AC\_11092016.xls” for more information.



- 2118.88 = Converts m<sup>3</sup>/s to CFM
- 1.08 = Sensible heat transfer constant (Btu/hr.CFM.°F)
- EFLH<sub>heat</sub> = Equivalent Full Load Hours for heating in Existing Buildings from section 4.4 HVAC End Use<sup>727</sup>
- 3,412 = Converts Btus to kWh
- COP = Coefficient of Performance of the heating unit  
= Collected on site. If unknown assume 2.6 for PTHP<sup>728</sup>

Deemed per-unit savings for the Multi-Family Building type for Shielding Class 3 and Terrain Class 3 are as follows:

Multi-Family - Electric Savings per Unit (kWh/unit)						
Floor	Height	Rockford	Chicago	Springfield	Belleville	Marion
1	8	55.18	53.16	45.70	31.09	25.67
2	16	68.19	65.31	56.17	38.72	32.66
3	24	77.92	74.34	63.96	44.45	37.97
4	32	86.04	81.85	70.44	49.25	42.44
5	40	93.15	88.42	76.11	53.46	46.37
6	48	99.56	94.34	81.22	57.26	49.93
7	56	105.44	99.76	85.90	60.75	53.20
8	64	110.91	104.80	90.25	63.99	56.24
9	72	116.04	109.53	94.33	67.04	59.11
10	80	120.89	114.00	98.19	69.92	61.81
12	96	129.92	122.31	105.36	75.29	66.85
14	112	138.21	129.94	111.95	80.22	71.49
16	128	145.93	137.04	118.08	84.81	75.82
18	144	153.19	143.72	123.84	89.13	79.88
20	160	160.05	150.03	129.29	93.21	83.72
22	176	166.59	156.03	134.47	97.10	87.38
24	192	172.83	161.77	139.42	100.82	90.88
26	208	178.82	167.28	144.18	104.38	94.23
28	224	184.58	172.57	148.75	107.81	97.46
30	240	190.15	177.69	153.17	111.12	100.58

<sup>727</sup> Although in theory the hours should be all hours that infiltration is expected (i.e. all hours <55F), the IL TAC has agreed to use the Equivalent Full Load Hours to keep the savings at a more conservative level.

<sup>728</sup> From IECC 2012 Minimum Efficiency Requirements. For a 1 ton PTHP, COP = 2.9 – (0.026 \* 12,000/1,000).

**For example**, a mid-rise multi-family building located in the moderate terrain class and shielding class of Chicago, has 16 rooms on the 10<sup>th</sup> floor (80 feet high) with PTHPs that get covered with a cover and foam gasket during the heating months. The indoor temperature during the heating months is maintained at 74°F. The air infiltration and the related energy savings from the AC covers and seals are calculated as follows -

For Shielding Class 3 and Terrain Class 3,

A = 0.24, B = 0.85 and C = 0.2

Therefore,

$$f_s = 1/3 * (9.81 \text{ m/s}^2 * 80 \text{ ft} * 0.3048 \text{ m/ft} / 274.26 \text{ K})^{0.5} = 0.3 \text{ m/K}^{1/2} \cdot \text{s}$$

$$f_w = 0.24 * 0.85 * (80 \text{ ft} * 0.3048 \text{ m/ft} / 10 \text{ m})^{0.2} = 0.24$$

Total effective leakage area (ELA) = 16 units \* 6 sq. in. = 96 sq. in.

$$Q_{\text{infiltration}} = \text{ELA} * 0.000645 * (f_s^2 * (T_{\text{SA}} - T_{\text{OA}}) + f_w^2 * U^2)^{1/2} * 2118.88$$

$$= 96 * 0.000645 * (0.3^2 * (296.48 \text{ K} - 274.26 \text{ K}) + 0.24^2 * 4.67^2)^{1/2} * 2118.88$$

$$= 237 \text{ CFM}$$

$$\Delta \text{kWh} = (237 * 1.08 \text{ Btu/hr.CFM.}^\circ\text{F} * (74^\circ\text{F} - 33.99^\circ\text{F}) * 1,685) / (3,412 \text{ Btu/kWh} * 2.6)$$

$$= 1,945 \text{ kWh}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

As the savings occur during the winter season (non-peak), there are no demand savings associated with this measure.

### NATURAL GAS SAVINGS

If the building is heated with gas, the natural gas savings are calculated as follows:

$$\Delta \text{Therms} = (Q_{\text{infiltration}} * 1.08 \text{ Btu/hr.CFM.}^\circ\text{F} * (T_{\text{SA}} - T_{\text{OA}}) * \text{EFLH}_{\text{heat}}) / (100,000 \text{ Btu/therm} * \eta)$$

Where,

$\eta$  = Efficiency of heating equipment.

= Collected on site. If unknown, assume 80%<sup>729</sup>.

100,000 = Converts Btus to therms

Other factors as defined above

Deemed per-unit savings per unit for the Multi-Family Building type for Shielding Class 3 and Terrain Class 3 are as follows:

Multi-Family - Gas Savings per Unit (Therms/Unit)						
Floor	Height	Rockford	Chicago	Springfield	Belleville	Marion
1	8	6.12	5.90	5.07	3.45	2.85
2	16	7.56	7.24	6.23	4.29	3.62
3	24	8.64	8.24	7.09	4.93	4.21
4	32	9.54	9.08	7.81	5.46	4.71
5	40	10.33	9.81	8.44	5.93	5.14
6	48	11.04	10.46	9.01	6.35	5.54
7	56	11.69	11.06	9.53	6.74	5.90
8	64	12.30	11.62	10.01	7.10	6.24
9	72	12.87	12.15	10.46	7.43	6.55
10	80	13.41	12.64	10.89	7.75	6.85
12	96	14.41	13.56	11.68	8.35	7.41

<sup>729</sup> Energy Independence and Security Act of 2007 – averaged for hot water and steam boilers.

Multi-Family - Gas Savings per Unit (Therms/Unit)						
Floor	Height	Rockford	Chicago	Springfield	Belleville	Marion
14	112	15.33	14.41	12.41	8.90	7.93
16	128	16.18	15.20	13.09	9.40	8.41
18	144	16.99	15.94	13.73	9.88	8.86
20	160	17.75	16.64	14.34	10.34	9.28
22	176	18.47	17.30	14.91	10.77	9.69
24	192	19.16	17.94	15.46	11.18	10.08
26	208	19.83	18.55	15.99	11.57	10.45
28	224	20.47	19.14	16.50	11.96	10.81
30	240	21.09	19.70	16.98	12.32	11.15

**For example**, a gas-heated mid-rise multi-family building located in the moderate terrain class and shielding class of Chicago, has 16 rooms on the 10<sup>th</sup> floor (80 feet high) with room air conditioners that get covered with an AC cover and foam gasket during the heating months. The indoor temperature during the heating months is maintained at 74°F. The air infiltration and the related therm savings from the AC covers and seals are calculated as follows:

For Shielding Class 3 and Terrain Class 3,

A = 0.24, B = 0.85 and C = 0.2

Therefore,

$$f_s = 1/3 * (9.81 \text{ m/s}^2 * 80 \text{ ft} * 0.3048 \text{ m/ft} / 274.26 \text{ K})^{0.5} = 0.3 \text{ m/K}^{1/2} \cdot \text{s}$$

$$f_w = 0.24 * 0.85 * (80 \text{ ft} * 0.3048 \text{ m/ft} / 10 \text{ m})^{0.2} = 0.24$$

Total effective leakage area (ELA) = 16 units \* 6 sq.in = 96 sq. in

$$Q_{\text{infiltration}} = \text{ELA} * 0.000645 * (f_s^2 * (T_{\text{SA}} - T_{\text{OA}}) + f_w^2 * U^2)^{1/2} * 2118.88$$

$$= 96 * 0.000645 * (0.3^2 * (296.48 \text{ K} - 274.26 \text{ K}) + 0.24^2 * 4.67^2)^{1/2} * 2118.88$$

$$= 237 \text{ CFM}$$

$$\Delta \text{Therms} = (237 * 1.08 \text{ Btu/hr.CFM.}^\circ\text{F} * (74^\circ\text{F} - 33.99^\circ\text{F}) * 1,685) / (100,000 \text{ Btu/therm} * 80\%)$$

$$= 216 \text{ therms}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-CRAC-V02-200101**

**REVIEW DEADLINE: 1/1/2023**

#### 4.4.39 High Temperature Heating and Ventilation (HTHV) Direct Fired Heater

##### DESCRIPTION

This measure applies to 100% outside air, high temperature heating and ventilation (HTHV) direct fired gas heaters. These units replace unit heaters (indirect gas fired or steam coil) or rooftop units in warehouses which suffer from extreme temperature stratification, minimal controls and reduced heating efficiencies.

Warehouses have high ceilings (~30 ft high), and suffer from stratification of air. The warm air rises and remains near the roof, which keeps the thermostat from reaching its desired setpoint. This increases the run hours of the heating unit and causes discomfort among the occupants. The HTHV units have high pressure fans that direct high temperature and high velocity air towards the floor and thus help minimize temperature stratification. On average, a 30 ft high warehouse could reduce its linear stratification from 0.53°F/ft to 0.13°F/ft, thus maintaining a more uniform temperature in the room and reducing the operating hours of the heating unit.

Since the HTHV units are direct fired, they also have improved efficiencies of 92% compared to 80% for a typical indirect fired unit heater or rooftop unit. They transfer the latent heat of the flue gases into the space instead of venting it out.

This measure only applies to high ceiling warehouses that do not have any other destratification technologies installed (i.e., destratification fans, air rotation units, etc.). New HTHV units must be the warehouse's primary heat source.

This measure was developed to be applicable to the following program types: RF, TOS, NC. If applied to other program types, the measure savings should be verified.

##### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment must be a 100% outside air, HTHV direct fired gas heater, with a discharge temperature greater than or equal to 150°F, a temperature rise greater than or equal to 140°F, and an efficiency exceeding 92%.

##### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment must be an indirect fired gas or steam unit heater or a rooftop unit used as the primary space heating source. Warehouses with existing destratification technologies (high volume, low speed fans or air turnover units) do not qualify for this measure.

##### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.<sup>730</sup>

##### DEEMED MEASURE COST

The measure cost should be based on a contractor's evaluation of the project scope and may vary significantly on a project to project basis. If unknown, for early replacement or retrofit projects, assume \$14.50/MBtu/hr (material cost for an HTHV unit) or \$26/MBTUhr (sum of material and installation cost).<sup>731</sup>

The incremental measure cost, assuming a baseline of standard efficiency unit heaters, is \$7.43/MBtu/hr (material cost).<sup>732</sup>

---

<sup>730</sup> Based on "Field Demonstration of High Efficiency Gas Heaters", prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014.

<sup>731</sup> Average costs from CLEAResult's evaluation of 9 different projects in the Chicagoland area.

<sup>732</sup> Based on data collected in "Field Demonstration of High Efficiency Gas Heaters", prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014.

**LOADSHAPE**

Loadshape C04: Commercial Electric Heating

**COINCIDENCE FACTOR**

Assumed to be 0.

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

HTHV units may increase the facility’s electric energy consumption due to high pressure motors that supply air at higher velocity.

$$\Delta kWh = - kWh/HDD * HDD$$

Where:

- kWh/HDD = increase in electric energy consumption due to HTHV fan motor  
= 1.04<sup>733</sup>
- HDD = heating degree days

Zone	City	HDD55 <sup>734</sup>	ΔkWh
1	Rockford	4,272	(4,443)
2	Chicago	4,029	(4,190)
3	Springfield	3,406	(3,542)
4	Belleville	2,515	(2,616)
5	Marion	2,546	(2,648)

Although HTHV fan motors have a higher power draw, they also result in decreased heating equipment operating time, potentially offsetting some of the increase in electrical energy consumption. Therefore, if replacing heating equipment other than unit heaters, a custom evaluation may be necessary to determine if there is an increase in electrical energy consumption.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Since HTHV units operate during the winter (non-peak) season, there are no demand savings associated with this measure.

**NATURAL GAS SAVINGS**

Custom calculation below, otherwise use a deemed savings factor from the table that follows.

$$\Delta Therms = (FLH_{base} * Cap_{base} / (\eta_{base} * 100)) - (FLH_{eff} * Cap_{eff} / (\eta_{eff} * 100))$$

Where:

- FLH<sub>base</sub> = LF<sub>base</sub> \* Hours
- FLH<sub>eff</sub> = LF<sub>eff</sub> \* Hours

---

<sup>733</sup> Based on data collected in “Field Demonstration of High Efficiency Gas Heaters”, prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014. This study replaced four standard unit heaters with HTHV units, and the electrical energy increased from 0.4 kWh/HDD to 1.44 kWh/HDD. Therefore savings are assumed to be 1.04 kWh /HDD.

<sup>734</sup> 30-year normals from the National Climactic Data Center (NCDC), assuming base temperature 55.

- Hours = Annual operating hours of the unit, calculated as total number of hours when outside air temperature is less than 55°F. This can be adjusted based on the facility's occupancy schedule.
- LF<sub>base</sub> = load factor of baseline unit heater  
=  $(Q_{inf,base} + Q_{w,base} + Q_{r,base}) / (Cap_{base} * 100)$
- LF<sub>eff</sub> = load factor of HTHVheater  
=  $(Q_{inf,eff} + Q_{w,eff} + Q_{r,eff}) / (Cap_{eff} * 100)$
- Cap<sub>base</sub> = existing heating unit input capacity (MBtu/hr)  
= can be collected on site, or assumed to be the same as HTHV unit capacity, Cap<sub>eff</sub>
- Cap<sub>eff</sub> = HTHV unit input capacity (MBtu/hr)  
= can be collected on site or from specification sheets
- η<sub>base</sub> = efficiency of existing heating unit  
= collected from equipment nameplate or assumed as 70% for steam unit heaters, 80% for gas fired unit heaters, and 84% for rooftop units<sup>735</sup>
- η<sub>eff</sub> = efficiency of HTHV unit  
= collected from equipment nameplate or assumed as 92%
- 100 = converts MBtu to therms

See table below for savings inputs.

---

<sup>735</sup> Efficiency of existing systems assumed from ASHRAE 90.1 – 2010 and manufacturer's specification sheets for various equipment. Steam unit heaters have a lower efficiency due to steam distribution losses.

Parameter	Existing Unit	Proposed (Efficient) Unit
<b>Temperatures</b>		
Setpoint Temperature (°F)	$T_{\text{setpoint}}$ = collected on site, or assumed as 65°F	
Ceiling Temperature <sup>736</sup> (°F)	Either collected on site when the existing unit is in operation with an infrared gun, or assumed as: $T_{\text{c,base}} = T_{\text{setpoint}} + 0.53^{\circ}\text{F}/\text{ft} * \text{Height}$	Either collected on site when the proposed unit is in operation with an infrared gun, or assumed as: $T_{\text{c,eff}} = T_{\text{setpoint}} + 2 \text{ to } 4^{\circ}\text{F}$
Average Room Temperature (°F)	$T_{\text{r,base}} = (T_{\text{setpoint}} + T_{\text{c,base}})/2$	$T_{\text{r,eff}} = (T_{\text{setpoint}} + T_{\text{c,eff}})/2$
Outside Air Temperature (°F)	$T_{\text{OA}}$ , from local weather data <sup>737</sup>	
<b>Heat Loads</b>		
Infiltration Load <sup>738</sup> :	$Q_{\text{inf,base}} = 0.04\text{CFM}/\text{ft}^2 * (\text{Wall Surface Area} + \text{Roof Surface Area}) * 1.08 * (T_{\text{r,base}} - T_{\text{OA}})$	$Q_{\text{inf,eff}} = 0.04\text{CFM}/\text{ft}^2 * (\text{Wall Surface Area} + \text{Roof Surface Area}) * 1.08 * (T_{\text{r,eff}} - T_{\text{OA}})$
Wall Conduction Load <sup>739</sup> :	$Q_{\text{w,base}} = 1/\text{R-value}_{\text{wall}} * (\text{Wall Surface Area} * 1.08 * (T_{\text{r,base}} - T_{\text{OA}}))$ Where R-value <sub>wall</sub> = the insulation value of the wall. It can be collected on site, or assumed as R-15.	$Q_{\text{w,eff}} = 1/\text{R-value}_{\text{wall}} * (\text{Wall Surface Area} * 1.08 * (T_{\text{r,eff}} - T_{\text{OA}}))$ Where R-value <sub>wall</sub> = the insulation value of the wall. It can be collected on site, or assumed as R-15.
Roof Conduction Load:	$Q_{\text{r,base}} = 1/\text{R-value}_{\text{roof}} * (\text{Roof Surface Area} * 1.08 * (T_{\text{r,base}} - T_{\text{OA}}))$ Where R-value <sub>roof</sub> = the insulation value of the roof. It can be collected on site, or assumed as R-20.	$Q_{\text{r,eff}} = 1/\text{R-value}_{\text{roof}} * (\text{Roof Surface Area} * 1.08 * (T_{\text{r,eff}} - T_{\text{OA}}))$ Where R-value <sub>roof</sub> = the insulation value of the roof. It can be collected on site, or assumed as R-20.
<b>Surface Areas</b>		
Roof Surface Area:	Collected on site or assumed as: = facility area in sq.ft. If facility area is unknown, assume facility area <sup>740</sup> = 41.4 sq. ft./MBtu/hr * Cap <sub>eff</sub>	
Wall Surface Area:	Collected on site or assumed as: = (Height * Length + Height * Width) * 2 Where: Length, Height and Width (feet) of the facility can be collected on site. If unknown, assume: Length = Width = (Facility Area) <sup>1/2</sup> and Height = 25 ft If facility area is unknown, assume facility area = 41.4 sq. ft./MBtu/hr * Cap <sub>eff</sub>	

The default values from the table above were used to calculate the deemed savings values in the table below. Savings are provided for various rated input capacity ranges and weather stations.

Cap <sub>eff</sub> (MBtu/hr)	Average Cap <sub>eff</sub> (MBtu/hr)	Nearest Weather Station	ΔTherms (Baseline Equipment: Steam Fired Unit Heaters )	ΔTherms (Baseline Equipment: Gas Fired Unit Heaters)	ΔTherms (Baseline Equipment: Rooftop Units)
300 > Cap <sub>eff</sub> ≥ 500	400	Rockford	3,120	1,996	1,620
500 > Cap <sub>eff</sub> ≥ 900	757	Rockford	5,208	3,346	2,725
900 > Cap <sub>eff</sub> ≥ 1,000	950	Rockford	6,280	4,047	3,297

<sup>736</sup> Baseline stratification rate is based on data collected in “Field Demonstration of High Efficiency Gas Heaters”, prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014. The study also verifies that the proposed ceiling temperature can be maintained within 2-4°F of the setpoint.

<sup>737</sup> Use Typical Meteorological Year (TMY3) data from NREL.

<sup>738</sup> Typical infiltration rate assumed from Infiltration Modeling Guidelines for Commercial Building Energy Analysis, prepared for US. DOE by Pacific Northwestern National Laboratory, 2009.

<sup>739</sup> Roof and Wall Insulation R-values are based on ASHRAE 90.1- 2010. (Jim Young 2014) (K. Gowri 2009).

<sup>740</sup> Based on DOE’s Commercial Prototype Modeled Warehouse building (in Chicago), via the Building Energy Codes Program.

Cap <sub>eff</sub> (MBtu/hr)	Average Cap <sub>eff</sub> (MBtu/hr)	Nearest Weather Station	ΔTherms (Baseline Equipment: Steam Fired Unit Heaters )	ΔTherms (Baseline Equipment: Gas Fired Unit Heaters)	ΔTherms (Baseline Equipment: Rooftop Units)
1,000 > Cap <sub>eff</sub> ≥ 1,400	1,200	Rockford	7,656	4,932	4,020
1,400 > Cap <sub>eff</sub> ≥ 1,600	1,499	Rockford	9,249	5,966	4,872
1,600 > Cap <sub>eff</sub> ≥ 2,100	1,850	Rockford	11,100	7,160	5,865
2,100 > Cap <sub>eff</sub> ≥ 2,400	2,200	Rockford	12,914	8,338	6,820
Cap <sub>eff</sub> ≥ 2,400	2,718	Rockford	15,547	10,084	8,236
300 > Cap <sub>eff</sub> ≥ 500	400	Chicago	2,820	1,824	1,488
500 > Cap <sub>eff</sub> ≥ 900	757	Chicago	4,709	3,058	2,506
900 > Cap <sub>eff</sub> ≥ 1,000	950	Chicago	5,681	3,696	3,031
1,000 > Cap <sub>eff</sub> ≥ 1,400	1,200	Chicago	6,924	4,512	3,696
1,400 > Cap <sub>eff</sub> ≥ 1,600	1,499	Chicago	8,364	5,456	4,482
1,600 > Cap <sub>eff</sub> ≥ 2,100	1,850	Chicago	10,046	6,549	5,384
2,100 > Cap <sub>eff</sub> ≥ 2,400	2,200	Chicago	11,682	7,634	6,292
Cap <sub>eff</sub> ≥ 2,400	2,718	Chicago	14,079	9,214	7,583
300 > Cap <sub>eff</sub> ≥ 500	400	Springfield	2,452	1,588	1,300
500 > Cap <sub>eff</sub> ≥ 900	757	Springfield	4,095	2,665	2,188
900 > Cap <sub>eff</sub> ≥ 1,000	950	Springfield	4,950	3,221	2,651
1,000 > Cap <sub>eff</sub> ≥ 1,400	1,200	Springfield	6,024	3,936	3,240
1,400 > Cap <sub>eff</sub> ≥ 1,600	1,499	Springfield	7,285	4,767	3,912
1,600 > Cap <sub>eff</sub> ≥ 2,100	1,850	Springfield	8,732	5,717	4,718
2,100 > Cap <sub>eff</sub> ≥ 2,400	2,200	Springfield	10,164	6,666	5,500
Cap <sub>eff</sub> ≥ 2,400	2,718	Springfield	12,258	8,045	6,632
300 > Cap <sub>eff</sub> ≥ 500	400	Belleville	2,456	1,604	1,320
500 > Cap <sub>eff</sub> ≥ 900	757	Belleville	4,103	2,687	2,218
900 > Cap <sub>eff</sub> ≥ 1,000	950	Belleville	4,950	3,249	2,689
1,000 > Cap <sub>eff</sub> ≥ 1,400	1,200	Belleville	6,036	3,972	3,276
1,400 > Cap <sub>eff</sub> ≥ 1,600	1,499	Belleville	7,300	4,812	3,972
1,600 > Cap <sub>eff</sub> ≥ 2,100	1,850	Belleville	8,751	5,772	4,773
2,100 > Cap <sub>eff</sub> ≥ 2,400	2,200	Belleville	10,186	6,732	5,566
Cap <sub>eff</sub> ≥ 2,400	2,718	Belleville	12,285	8,127	6,713
300 > Cap <sub>eff</sub> ≥ 500	400	Marion	2,180	1,444	1,200
500 > Cap <sub>eff</sub> ≥ 900	757	Marion	3,649	2,430	2,021
900 > Cap <sub>eff</sub> ≥ 1,000	950	Marion	4,408	2,936	2,442
1,000 > Cap <sub>eff</sub> ≥ 1,400	1,200	Marion	5,364	3,576	2,988
1,400 > Cap <sub>eff</sub> ≥ 1,600	1,499	Marion	6,491	4,332	3,613
1,600 > Cap <sub>eff</sub> ≥ 2,100	1,850	Marion	7,789	5,217	4,348
2,100 > Cap <sub>eff</sub> ≥ 2,400	2,200	Marion	9,064	6,072	5,082
Cap <sub>eff</sub> ≥ 2,400	2,718	Marion	10,926	7,339	6,116

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A



**MEASURE CODE: CI-HVC-HTHV-V01-180101**

**REVIEW DEADLINE: 1/1/2023**

## 4.4.40 Gas High Efficiency Single Package Vertical Air Conditioner

### DESCRIPTION

This measure covers the installation of a single package vertical air conditioner with a high efficiency gas furnace, referred to here as a through the wall (TTW) condensing gas furnace, instead of a standard efficiency gas furnace. The primary market served by TTWs are multifamily housing and hospitality in a new construction application. High efficiency gas furnaces achieve savings through the utilization of a sealed, super insulated combustion chamber, more efficient burners, and multiple heat exchangers that remove a significant portion of the waste heat from the flue gases. Because multiple heat exchangers are used to remove waste heat from the escaping flue gases, most of the flue gases condense and must be drained. Management of the acidic condensate is currently a major limiting factor for retrofit application, making the new construction the best initial market point until the industry develops better strategies for condensate management for retrofit applications. Also, TTWs are normally installed at the exterior wall to access outside air to reject heat in the cooling cycle. Placement of TTWs near the exterior might be prohibitive in retrofit applications. Furnaces equipped with ECM fan motors and with above code EER ratings provide an opportunity for additional electric energy savings.

This measure assumes unit size less than or equal to 65,000 Btu/hr.

This measure was developed to be applicable to the following program types: NC, TOS. If applied to other program types such as RF, the measure savings should be verified via a custom measure.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an TTW condensing system with code minimum 9.0 EER cooling system (minimum code scheduled to increase to 11.0 EER on September 23, 2019) and a high-efficiency gas furnace with an annual fuel utilization efficiency (AFUE) of 90% or greater.<sup>741</sup> Fan electrical efficiency must exceed the program requirements.

### DEFINITION OF BASELINE EQUIPMENT

Baseline equipment for this measure are units with a cooling system that meets the current code minimum 9.0 EER efficiency rating and a heating unit with an AFUE rating of 80% or less.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16.5 years.<sup>742</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure depends on efficiency as listed below:<sup>743</sup>

AFUE	Incremental Cost Premium
80%	\$400
90%	\$400
95%	\$500

### LOADSHAPE

Loadshape R08 – Residential Cooling

<sup>741</sup> Electronic Code of Federal Regulations: 10 CFR 431.97, last modified September 27, 2016. Minimum EER standards are scheduled to increase to 11.0 EER on September 23, 2019.

<sup>742</sup> Average of 15-18 year lifetime estimate made by the Consortium for Energy Efficiency in 2010.

<sup>743</sup> Based on discussion with TTW Manufacturers at AHR 2018 Show in Chicago, IL.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the average savings over the defined summer peak period, and is presented so that savings can be bid into PJM’s capacity market.

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
= 68%<sup>744</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 46.6%<sup>745</sup>

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Electric savings come from a high efficiency cooling unit.<sup>746</sup> In some instances, the TTW unit provided by the manufacturer may not have higher efficiency cooling and fan blower motor systems integrated in to the TTW design; in these cases, electric energy savings will be zero for those components.

$$\Delta kWh_{EER} = FLH_{cool} * Capacity * (1/EER_{base} - 1/EER_{eff}) / 1000$$

Where:

FLH<sub>cool</sub> = Full load hours for cooling.<sup>747</sup>

Climate Zone (City based upon)	FLH <sub>cool</sub> (multifamily)
1 (Rockford)	467
2 (Chicago)	506
3 (Springfield)	663
4 (Belleville)	940
5 (Marion)	820
Weighted Average	564

Capacity = Cooling capacity of the efficient unit in Btu/hr  
= Actual installed

EER<sub>eff</sub> = Energy efficiency ratio of the efficient equipment  
= Actual installed rating

<sup>744</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>745</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>746</sup> If an ECM motor in the packaged system is present, savings should be claimed for this measure by referring to the Residential Furnace Blower Motor measure in the IL TRM.

<sup>747</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCDC) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

$EER_{base}$  = Energy efficiency ratio of the baseline equipment – Presently, the federal minimum efficiency level is 9.0 EER, increasing to 11.0 EER on September 23, 2019.<sup>748</sup>  
 = 9.0

**For example**, for a Rockford non-weatherized multifamily unit conditioned by a SPVAC with a 2-ton (24,000 Btu/hr) cooling capacity, a rated EER of 11.0, and an ECM fan blower motor installed.

$$\Delta kWh = [467 * 24,000 * (1/9.0 - 1/11.0) / 1000] = 958 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = CF * Capacity * (1/EER_{base} - 1/EER_{eff}) / 1000$$

Where:

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
 = 68%<sup>749</sup>

$CF_{PJM}$  = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>750</sup>

**NATURAL GAS SAVINGS**

$$\Delta Therms = EFLH_{heat} * Capacity * (AFUE_{eff} - AFUE_{base}) / AFUE_{base} / (100,000 \text{ Btu/Therm})$$

Where

$EFLH_{heat}$  = Equivalent Full Load Hours for heating:<sup>751</sup>

Climate Zone (City based upon)	$EFLH_{heat}$ (general multifamily)
1 (Rockford)	1,742
2 (Chicago)	1,704
3 (Springfield)	1,498
4 (Belleville)	1,208
5 (Marion)	1,429

Capacity = Nominal heating input capacity furnace size (Btu/hr) for efficient unit  
 = Actual

$AFUE_{eff}$  = Efficient furnace annual fuel utilization efficiency rating  
 = Actual installed rating

$AFUE_{base}$  = Baseline furnace annual fuel utilization efficiency rating  
 = 80%

<sup>748</sup> Electronic Code of Federal Regulations: 10 CFR 431.97, last modified September 27, 2016. Minimum EER standards are scheduled to increase to 11.0 EER on September 23, 2019.

<sup>749</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>750</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>751</sup> See section 4.4 for details.

**For example**, for a Chicago non-weatherized multifamily unit heated by an SPVAC with a 40 kBtu/hr capacity and a rated AFUE of 93%.

$$\Delta\text{Therms} = 1,704 * 40,000 * [(0.93 - 0.8)/0.8] / (100,000 \text{ Btu/Therm}) = 111 \text{ therms}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC -SPVA-V01-190101**

**REVIEW DEADLINE: 1/1/2023**

#### 4.4.41 Advanced Rooftop Controls (ARC)

##### DESCRIPTION

The Advanced Rooftop Controls (ARC) measure installs demand-controlled ventilation with optional supply-fan speed control via a variable-frequency drive to a single-zone, packaged HVAC unit with a functioning integrated economizer already installed. The demand-controlled ventilation modulates the outside air damper based on CO<sub>2</sub> concentration in the conditioned space. The supply-fan speed control options consist of setting the fan speed to 40% in ventilation mode and to 90% in heating and cooling modes, or of setting the fan speed to 40% in ventilation mode, to 75% in 1st stage heating and 1st stage cooling modes, and to 90% in 2nd stage heating and 2nd stage cooling modes. The measure results in fan, cooling, and heating savings compared to a baseline scenario of constant-volume, constant-ventilation operation typical of single-zone, packaged HVAC units. There are a number of off-the-shelf products available for the packaged HVAC unit market that support these control sequences, and the energy savings potential of these strategies has been studied and reported on.<sup>752</sup>

Demand-controlled ventilation modulates the percentage of outside air that is delivered to a space and its occupants by controlling the position of the outside air damper. The outside air damper is set to the minimum position required for the space, and is opened further when CO<sub>2</sub> concentration in the conditioned space increases, which indicates an increase in occupancy. The damper also opens to provide 100% outside air cooling (i.e., the unit economizes) when conditions permit. This portion of the measure saves energy by minimizing the energy required to unnecessarily heat and cool outside air. Demand-controlled ventilation can also be combined with the installation of a variable-frequency drive on the supply fan. This drive is used to reduce the speed of the supply fan when the full design airflow is not required. When the unit is only providing ventilation air (i.e., not heating or cooling), the airflow is reduced substantially, but not below the required minimum ventilation rate. The flow for heating and cooling can also be reduced a small amount in most cases. Per the fan affinity laws, the reduction in flow correlates to a near cubic reduction in fan power. In these ways, this measure is able to achieve cooling, heating, and fan energy reduction.

This measure is intended for commercial buildings served by single-zone, packaged HVAC units. This measure was developed to be applicable to the following program types: RF, DI

If applied to other program types, the measure savings should be verified.

##### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a single-zone, packaged HVAC unit (with an existing functional integrated economizer) that has been retrofitted with demand-controlled ventilation controls with optional supply-fan speed control via a variable-frequency drive.

##### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a single-zone, packaged HVAC unit (with an existing functional integrated economizer) that lacks demand-controlled ventilation controls and lacks supply-fan speed control via a variable-frequency drive.

##### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 10 years and based on CO<sub>2</sub> sensor estimated life.<sup>753</sup>

##### DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost below can be used.

---

<sup>752</sup> Katipamula, S., et al, "Advanced Rooftop Control (ARC) Retrofit: Field-Test Results", Pacific Northwest National Laboratory, July 2013.

<sup>753</sup> Based on [IL TRM v6.0 Vol. 2 – 4.4.19 Demand Controlled Ventilation](#).

**Table 1 – Deemed Measure Cost Details**

Measure	Material Unit (Each)	Material Cost / Unit	Labor Unit (Hours)	Labor Rate/ Unit	Total Cost
DCV	1	\$1,663.90	3	\$96.67	\$1,953.91
DCV and VFD with two speed modes (40% ventilating & 90% heating/cooling)	1	\$3,025.38	4	\$96.67	\$3,412.06
DCV and VFD with three speed modes (40% ventilating, 75% 1 <sup>st</sup> stage heating/cooling & 90% 2 <sup>nd</sup> stage heating/cooling)	1	\$3,487.00	4	\$96.67	\$3,873.68

**LOADSHAPE**

Commercial ventilation C23

**COINCIDENCE FACTOR**

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 91.3%<sup>754</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 47.8%<sup>755</sup>

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

To determine the savings associated with the Advanced Rooftop Controls (ARC) measure we utilized the available IL TRM prototype eQuest models which were initially created by the Energy Center of Wisconsin<sup>756</sup> but modified by VEIC in 2014 as part of the IL TRM v4.0 Equivalent Full Load Hours (EFLH) update. For each building type we used the most recent versions of the models for our baseline models (Assembly was not part of EFLH update). These models which were used are the most up-to-date versions and are readily available on the [VEIC SharePoint site](#), under the [TRM Reference Documents Section](#).

Upon examination of the ComEd building prototype models we found several of the baseline models did not have packaged single zone (PSZ) units. This measure is targeting packaged single zone HVAC systems. Therefore, as a basis for savings calculations, we chose only models that: 1) utilized PSZ HVAC systems, and 2) aligned with the small commercial building type applicable to this measure. Once the ComEd baseline models were selected, we determined several modifications were necessary to the prototype models in order to represent the baseline scenario for this measure:

1. Multistage PSZ HVAC System with Constant Volume Supply Fan
2. Optimized Economizer Controls by Climate Zone
  - a. Economizer Changeover Type – Set to fixed Dry Bulb
  - b. Economizer High-Limit Control Setpoints – Setpoints based on ASHRAE Climate Zones Fixed Dry Bulb Temperature recommendations.

<sup>754</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>755</sup>Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>756</sup> Energy Center of Wisconsin, ComEd Portfolio Modeling Report, July 30, 2010.

- c. Enable Integrated Operation – Allows economizer to operate simultaneously with mechanical cooling

Additionally, a number of the building prototype models were found to have supply fan total static pressure modeled inputs that seem excessive and atypical for packaged single zone rooftop units – these included Convenience Store (5 in. wc), Manufacturing Facility (5 in. wc), Office Low Rise (5 in. wc), Religious Building (5 in. wc), and Restaurant (5 in. wc). The remaining models had supply fan total static pressure inputs more in line with what we would expect to find for packaged single zone rooftop units, ranging from 1.3 to 2 in. wc. For each model having a supply fan total static pressure above 2 in. wc, model inputs were adjusted to set these to 2 in. wc. To implement the modifications shown above, changes were made to eQUEST keywords in the ComEd prototype models as shown in the following table. Hard-coded system capacities and supply airflows can be found in the attached “Advanced Rooftop Controls\_End Use Analysis\_IL TRM.xlsx” spreadsheet.

**Table 2 – Prototype Modifications to eQuest Keywords**

Component Adjusted	eQuest Keyword	IL TR Value	Modified Prototype Value
System - System Type	SYSTEM:TYPE	PSZ	PVVT
System - Airflow and Temperature Control	SYSTEM:AIR/TEMP-CONTROL	N/A	STAGED-VOLUME
System – Supply Fan Total Static Pressure	SYSTEM:SUPPLY-STATIC	Varies	If >2: 2 Else: IL TR Value
System - Cooling and Heating Capacities	SYSTEM:COOLING-CAPACITY SYSTEM:HEATING-CAPACITY	Auto-sized	Hard-coded (after retrieving auto-sized outputs)
System - Supply Fan Control	SYSTEM:FAN-CONTROL	Varies	CONSTANT-VOLUME
System - Supply Fan Ratios	SYSTEM:MIN-FLOW-RATIO SYSTEM:CMIN-FLOW-RATIO SYSTEM:HMIN-FLOW-RATIO SYSTEM:-MAX-FAN-RATIO	N/A	1
System - Supply Airflow	SYSTEM:SUPPLY-FLOW	Auto-sized	Hard-coded (after retrieving auto-sized outputs)
Economizer - Changeover Type	SYSTEM:OA-CONTROL	Fixed	Single Dry-Bulb
Economizer - Changeover Setpoint	SYSTEM-ECONO-LIMIT-T	Varies	ASHRAE 90.1-2013 – High-Limit Shutoff Control Settings: ASHRAE CLIMATE ZONE – 4A = 65°F ASHRAE CLIMATE ZONE – 5A = 70°F
Economizer - Integrated Operation	SYSTEM:ECONO-LOCKOUT	Yes	No

Further modifications were then made to these baseline models in order to simulate the following measure scenarios:

1. Demand-controlled ventilation (DCV) controls
2. DCV and supply fan variable frequency drive (VFD) with two fan speed modes
  - a. 40% fan speed for ventilating
  - b. 90% fan speed for heating and cooling
3. DCV and supply fan VFD with three fan speed modes
  - a. 40% fan speed for ventilating



- b. 75% fan speed for 1<sup>st</sup> stage heating and cooling
- c. 90% fan speed for 2<sup>nd</sup> and higher stage heating and cooling

The eQuest modifications from the baseline models to represent these measure scenarios are shown in the following table. Full modeled energy end use and savings summaries can be found in the attached “Advanced Rooftop Controls\_End Use Analysis\_IL TRM.xlsx” spreadsheet.

**Table 3 – Baseline and Measure Scenario eQuest Keywords**

Component Adjusted	eQuest Keyword	Baseline Value	Measure Scenario Values		
			1	2	3
System - Minimum Outside Air Control	SYSTEM:MIN-OA-METHOD	Fraction of Design Flow	DCV Return Sensor	DCV Return Sensor	DCV Return Sensor
System - Supply Airflow	SYSTEM:SUPPLY-FLOW	Hard-coded	1.0 × Hard-coded value	0.9 × Hard-coded value	0.9 × Hard-coded value
System - Supply Fan Control	SYSTEM:FAN-CONTROL	CONSTANT-VOLUME	CONSTANT-VOLUME	FAN-EIR-FPLR	FAN-EIR-FPLR
System - Supply Fan Ratios	SYSTEM:MIN-FLOW-RATIO	1	1	0.44*	0.44*
	SYSTEM:CMIN-FLOW-RATIO	1	1	1	0.83**
	SYSTEM:HMIN-FLOW-RATIO	1	1	1	0.83**
	SYSTEM:-MAX-FAN-RATIO	1	1	1	1

\*Since the total supply flow is limited by 0.9 of the baseline, a value of 0.44 for the minimum flow ratio results in a 40% fan speed: 0.4/0.9=0.44

\*\* Since the total supply flow is limited by 0.9 of the baseline, a value of 0.83 for the minimum heating/cooling flow ratios results in a 75% fan speed: 0.75/0.9=0.83

With these modifications in place each scenario was simulated in eQuest for each chosen IL TRM prototype building type across the five TRM climate zones. Whole building electric and gas savings were determined from the simulation output and are presented in the following sections. Electric savings have been normalized by cooling tons and heating savings by furnace kBtuh output.

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (\text{Capacity}_{\text{Cool}} * \text{Normalized Electric Cooling Energy Savings}) + (\text{Capacity}_{\text{Heat}} * \text{Normalized Electric Heating Energy Savings})$$

Where:

Capacity<sub>Cool</sub> = capacity of the cooling equipment in tons (nominal tonnage may be used).

=Actual

Normalized Electric Cooling Energy Savings

= kWh/ton savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 4 – Electric Cooling Energy Savings Summary (kWh/ton)

**Table 4 – Electric Cooling Energy Savings Summary (kWh/ton)**

Building Type - IL TRM Prototype Model Name	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario:														
	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	52.0	145.8	168.7	51.4	154.6	175.5	85.2	189.0	205.8	95.7	199.7	213.7	89.7	200.8	210.4
Assisted Living	8.0	574.4	604.7	8.8	580.5	605.5	14.7	578.2	598.7	15.6	589.1	609.4	16.5	600.9	615.5
College	49.7	410.8	448.4	54.1	410.4	442.0	106.5	464.1	490.9	139.1	514.3	537.0	158.7	511.9	526.3
Conditioned Storage	1.9	339.8	393.6	3.5	355.1	404.5	5.9	346.3	388.6	9.5	349.5	384.5	10.3	349.5	371.7
Convenience Store	46.4	918.9	984.1	49.9	921.0	977.0	82.3	955.1	1,000.2	86.9	996.3	1,035.0	103.7	998.3	1,022.7
Garage	14.8	479.7	578.9	19.2	482.9	573.6	25.9	510.4	586.3	48.4	570.1	640.3	53.0	589.0	648.7
Grocery	41.8	480.1	505.1	43.9	486.5	507.6	68.1	502.8	520.4	83.2	536.1	550.6	89.7	539.8	547.9
Manufacturing Facility	7.7	773.4	824.8	9.0	761.4	807.1	19.6	771.8	809.3	30.8	801.2	832.8	34.2	784.9	802.5
Office Low Rise	15.2	1,071.2	1,147.3	17.2	1,065.8	1,131.8	23.1	1,062.2	1,115.7	30.5	1,091.4	1,137.7	31.2	1,042.2	1,071.7
Religious Building	6.5	869.4	1,016.9	6.3	894.6	1,029.6	11.1	931.0	1,047.1	15.5	1,005.4	1,108.3	15.0	1,051.1	1,134.0
Restaurant	13.8	554.0	598.2	14.9	574.2	610.8	26.4	564.5	596.6	27.7	606.3	637.2	25.8	603.5	628.3
Retail Department Store	34.0	692.6	751.0	34.4	697.7	749.0	55.4	715.0	757.7	60.8	725.4	761.1	64.3	723.2	743.8
Retail Strip Mall	30.9	739.7	782.5	32.9	734.1	770.5	50.8	748.5	776.8	55.3	761.3	784.8	60.1	755.2	768.4

Capacity<sub>Heat</sub> = capacity of the heating equipment in tons (nominal tonnage may be used).  
 =Actual

Normalized Electric Heating Energy Savings

= kWh/ton savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 5 – Electric Energy Heating Savings Summary (kWh/ton)<sup>757</sup>

<sup>757</sup> Values for electric heat are based on converting the gas therm/kBtuh factors to electric kWh/ton factors factoring in the gas heating efficiencies used in the models and assuming a 2.3 COP heat pump. See 'ARC\_ElectricHeatCalculation.xls' for calculation.

**Table 5 – Electric Heating Energy Savings Summary (kWh/ton)**

	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario: 1 - DCV 2 - DCV and VFD w/2-speed fan control 3- DCV and VFD w/3-speed fan control														
Building Type	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	868.6	893.1	893.1	868.6	893.1	893.1	746.3	795.2	783.0	734.0	783.0	770.7	734.0	807.4	795.2
Assisted Living	119.3	59.6	23.9	95.4	47.7	11.9	83.5	35.8	11.9	83.5	59.6	23.9	71.6	59.6	23.9
College	880.8	831.9	807.4	770.7	734.0	709.6	648.4	611.7	599.5	526.1	513.8	489.3	342.5	330.3	318.1
Conditioned Storage	305.8	171.3	146.8	269.1	134.6	110.1	244.7	110.1	85.6	232.4	97.9	73.4	183.5	48.9	36.7
Convenience Store	587.2	464.9	440.4	526.1	403.7	379.2	452.6	342.5	330.3	428.2	330.3	305.8	354.8	269.1	244.7
Garage	59.6	47.7	35.8	47.7	35.8	35.8	47.7	35.8	23.9	47.7	35.8	23.9	47.7	35.8	35.8
Grocery	894.6	835.0	811.1	799.2	739.5	727.6	703.7	656.0	632.2	632.2	596.4	584.5	489.0	453.3	441.3
Manufacturing Facility	59.6	47.7	35.8	47.7	35.8	35.8	47.7	35.8	23.9	35.8	23.9	23.9	23.9	23.9	23.9
Office - Low Rise	334.0	143.1	119.3	298.2	107.4	83.5	238.6	95.4	71.6	214.7	71.6	59.6	155.1	23.9	23.9
Religious Building	107.4	131.2	155.1	95.4	107.4	131.2	83.5	95.4	107.4	71.6	95.4	107.4	71.6	71.6	83.5
Restaurant	345.9	262.4	226.6	298.2	214.7	190.8	262.4	190.8	167.0	238.6	190.8	155.1	202.8	155.1	131.2
Retail - Department Store	298.2	178.9	167.0	274.3	155.1	131.2	238.6	131.2	119.3	214.7	131.2	107.4	178.9	107.4	95.4
Retail - Strip Mall	286.3	226.6	202.8	250.5	190.8	178.9	214.7	167.0	155.1	202.8	167.0	155.1	178.9	143.1	131.2

For example, a 10-ton rooftop heat pump on an office low rise building in Chicago installs DCV with 2-speed supply fan control (operating at 40% in ventilating mode and 90% in heating and cooling modes):

$$\begin{aligned}
 \Delta kWh &= (\text{Capacity}_{\text{Cool}} * \text{Normalized Electric Cooling Energy Savings}) + (\text{Capacity}_{\text{Heat}} * \text{Normalized Electric Heating Energy Savings}) \\
 &= (10 \text{ tons} \times 1,065.8 \text{ kWh/ton}) + (10 \text{ tons} * 107.4) \\
 &= 11,732 \text{ kWh}
 \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW_{ssp} = (\text{tons}) \times \text{Normalized Electric Cooling Peak Demand Savings} \times CF_{ssp}$$

$$\Delta kW_{pjm} = (\text{tons}) \times \text{Normalized Electric Cooling Peak Demand Savings} \times CF_{pjm}$$

Where:

tons = capacity of the cooling equipment in tons (nominal tonnage may be used).  
 =Actual

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
 = 91.3%<sup>758</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
 = 47.8%<sup>759</sup>

Normalized Electric Peak Demand Savings

= kW/ton savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 6 – Electric Peak Demand Savings Summary (kW/ton)

**Table 6 – Electric Peak Demand Savings Summary (kW/ton)**

Building Type - IL TRM Prototype Model Name	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario:														
	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	0.024	0.107	0.107	0.086	0.126	0.126	0.015	0.042	0.042	0.069	0.095	0.095	0.048	0.064	0.064
Assisted Living	0.021	0.116	0.116	0.021	0.075	0.075	0.018	0.086	0.086	0.021	0.092	0.092	0.024	0.081	0.081
College	0.007	0.207	0.207	0.007	0.090	0.090	0.006	0.179	0.179	0.005	0.132	0.132	0.009	0.074	0.074
Conditioned Storage	0.007	0.065	0.065	0.006	0.083	0.083	0.010	0.096	0.096	0.005	0.060	0.060	0.007	0.071	0.071
Convenience Store	0.047	0.369	0.369	0.053	0.394	0.394	0.042	0.395	0.395	0.017	0.356	0.356	0.067	0.390	0.390
Garage	0.012	0.054	0.054	0.011	0.053	0.053	0.011	0.053	0.053	0.011	0.068	0.068	0.007	0.061	0.061
Grocery	0.065	0.122	0.122	0.034	0.080	0.080	0.033	0.088	0.088	0.072	0.119	0.119	0.033	0.082	0.082
Manufacturing Facility	0.008	0.335	0.335	0.006	0.296	0.296	-0.003	0.283	0.283	0.000	0.333	0.333	0.049	0.376	0.376
Office Low Rise	0.011	0.395	0.395	0.009	0.346	0.346	0.007	0.366	0.366	0.011	0.384	0.384	0.029	0.385	0.385
Religious Building	0.000	0.462	0.465	0.000	0.406	0.409	0.000	0.461	0.461	0.000	0.456	0.457	0.000	0.464	0.467
Restaurant	0.030	0.231	0.231	0.034	0.162	0.162	0.023	0.113	0.113	0.033	0.134	0.134	0.006	0.069	0.069
Retail Department Store	0.057	0.152	0.152	0.042	0.120	0.120	0.029	0.099	0.099	0.029	0.113	0.113	0.066	0.149	0.149
Retail Strip Mall	0.046	0.171	0.171	0.046	0.191	0.191	0.042	0.189	0.189	0.020	0.158	0.158	0.066	0.178	0.178

For example, a 10-ton rooftop air conditioner on an office low rise building in Chicago installs DCV with 2-speed supply fan control (operating at 40% in ventilating mode and 90% in heating and cooling modes) using the Summer System Peak Coincidence Factor:

$$\Delta kW = (10 \text{ tons}) \times (0.346 \text{ kW/ton}) \times 91.3\%$$

<sup>758</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>759</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

= 3.159 kW

**NATURAL GAS SAVINGS**

$\Delta\text{Therms} = (\text{kBtuh output}) \times \text{Normalized Gas Energy Savings}$

Where:

kBtuh = heating output of the gas furnace in kBtuh  
 =Actual

Normalized Gas Energy Savings

= Therms/kBtuh output savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 7 – Gas Energy Savings Summary (Therms/kBtuh output)

**Table 7 – Gas Energy Savings Summary (Therms/kBtuh output)**

Building Type - IL TRM Prototype Model Name	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario:														
	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	7.1	7.3	7.3	7.1	7.3	7.3	6.1	6.5	6.4	6.0	6.4	6.3	6.0	6.6	6.5
Assisted Living	1.0	0.5	0.2	0.8	0.4	0.1	0.7	0.3	0.1	0.7	0.5	0.2	0.6	0.5	0.2
College	7.2	6.8	6.6	6.3	6.0	5.8	5.3	5.0	4.9	4.3	4.2	4.0	2.8	2.7	2.6
Conditioned Storage	2.5	1.4	1.2	2.2	1.1	0.9	2.0	0.9	0.7	1.9	0.8	0.6	1.5	0.4	0.3
Convenience Store	4.8	3.8	3.6	4.3	3.3	3.1	3.7	2.8	2.7	3.5	2.7	2.5	2.9	2.2	2.0
Garage	0.5	0.4	0.3	0.4	0.3	0.3	0.4	0.3	0.2	0.4	0.3	0.2	0.4	0.3	0.3
Grocery	7.5	7.0	6.8	6.7	6.2	6.1	5.9	5.5	5.3	5.3	5.0	4.9	4.1	3.8	3.7
Manufacturing Facility	0.5	0.4	0.3	0.4	0.3	0.3	0.4	0.3	0.2	0.3	0.2	0.2	0.2	0.2	0.2
Office Low Rise	2.8	1.2	1.0	2.5	0.9	0.7	2.0	0.8	0.6	1.8	0.6	0.5	1.3	0.2	0.2
Religious Building	0.9	1.1	1.3	0.8	0.9	1.1	0.7	0.8	0.9	0.6	0.8	0.9	0.6	0.6	0.7
Restaurant	2.9	2.2	1.9	2.5	1.8	1.6	2.2	1.6	1.4	2.0	1.6	1.3	1.7	1.3	1.1
Retail Department Store	2.5	1.5	1.4	2.3	1.3	1.1	2.0	1.1	1.0	1.8	1.1	0.9	1.5	0.9	0.8
Retail Strip Mall	2.4	1.9	1.7	2.1	1.6	1.5	1.8	1.4	1.3	1.7	1.4	1.3	1.5	1.2	1.1

For example, a rooftop unit with a 148 kBtuh output gas furnace on an office low rise building in Chicago installs DCV with 2-speed supply fan control (operating at 40% in ventilating mode and 90% in heating and cooling modes):

$\Delta\text{Therms} = (148 \text{ kBtuh}) \times (0.9 \text{ Therms/kBtuh output})$   
 = 133.2 Therms

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-ARTC-V02-200101**

**REVIEW DEADLINE: 1/1/2023**

4.4.42 Advanced Thermostats for Small Commercial – Retired 12/31/2019. Replaced with  
4.4.48 Small Commercial Thermostats

#### 4.4.43 Packaged RTU Sealing

##### **DESCRIPTION**

The HVAC Packaged RTU Sealing Measure targets areas of the RTU that are readily accessible and can be easily sealed. By sealing the following areas, the amount of uncontrolled infiltration will be reduced leading to increased occupant comfort and an overall reduction in energy use.

The measure seeks to target the following three areas for sealing.

1. Economizer Hood – Seal the interior and exterior seams that connect the economizer to the RTU using UL listed metal tape and/or silicone caulking.
2. RTU Curb – Seal supply and return duct seams inside of RTU with mastic along with any leaks that are found around the perimeter of the roof to RTU connection using UL listed metal tape and/or silicone caulking.
3. Non-Removable Cabinet Panels – Seal all cabinet seams that are not typically removed during basic service (i.e. control panel) using UL listed metal tape and/or silicone caulking.

Uncontrolled infiltration of non-conditioned outside air (OSA) is a known issue for packaged rooftop units (RTU). This leakage can occur thru the curb, economizer assembly connection and cabinet panels. This leakage not only influences occupant comfort but also increases energy usage by increasing the heating and cooling loads while also reducing the unit's operating energy efficiency.

Prior to a recently released laboratory and field study developed by Robert Mowris & Associates, Inc.,<sup>760</sup> the energy effects of uncontrolled infiltration through cabinet leakage were difficult to quantify. However, this study determined that uncontrolled OSA infiltration not only increases the amount of energy to condition the excess air but also reduces the unit's operating efficiency (sensible EER) by 5.4%. By reducing the amount of uncontrolled OSA infiltration through RTU sealing the unit's operating efficiency (EER) can be increased reducing the amount of cooling energy. (Note: The referenced study quantifies improvements only from sealing the economizer hood – sealing the curb and non-access panels are recommended practice here but savings have not been quantified for these actions and may be in a future revision.)

This measure is only appropriate for packaged single zone rooftop units. Custom calculations are required for savings for built up air handling units or packaged multizone systems.

##### **DEFINITION OF EFFICIENT EQUIPMENT**

The efficient equipment condition is assumed to be a packaged HVAC system that has had the economizer hood, curb and non-access cabinet panels sealed.

##### **DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment condition is assumed to be an operational packaged HVAC system that has not been previously sealed. The packaged HVAC systems must be single zone and must have a functioning economizer.

##### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

Because the measure targets existing packaged RTU units, the deemed lifetime of the measure is assumed to be 5 years.<sup>761</sup>

##### **DEEMED MEASURE COST**

Actual measure costs should be used if available. If costs are not available the deemed measure cost below listed below can be used. The deemed measure costs are detailed for each individual RTU.

---

<sup>760</sup>Robert Mowris & Associates, Inc., "Laboratory Test Results of Commercial Packaged HVAC Maintenance Faults," California Public Utilities Commission, Feb 15, 2016 page 203.

<sup>761</sup> Assumed to be one third of effective useful life of an RTU (15 years).

Measure	Material Unit	Material Cost / Unit	Labor Unit (Hours)	Labor Rate / Unit	Total Cost
HVAC Packaged RTU Sealing	1	\$48.99	1.5	\$97	\$194.49

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

**COINCIDENCE FACTOR**

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
 = 91.3%<sup>762</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
 = 47.8%<sup>763</sup>

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

To determine the savings associated with the Packaged RTU Sealing measure available IL TRM prototype eQuest models, which were initially created by the Energy Center of Wisconsin<sup>764</sup> but modified by VEIC in 2014 as part of the IL TRM v4.0 Equivalent Full Load Hours (EFLH) update, were utilized. For each building type we used the most recent versions of the models for our baseline models (Assembly was not part of EFLH update).

This measure is targeting packaged single zone HVAC systems. Therefore, as a basis for savings calculations, only models that had the following characteristics were chosen: 1) Packaged-Single Zone (PSZ) HVAC systems; and 2) aligned with the small commercial building type applicable to this measure. Several modifications to the models were necessary in order to simulate a functioning airside economizer, which is assumed to be present in the baseline scenario for this measure:

3. Optimized Economizer Controls by Climate Zone
  - a. Economizer Changeover Type – Set to fixed Dry Bulb
  - b. Economizer High-Limit Control Setpoints – Setpoints based on ASHRAE Climate Zones Fixed Dry Bulb Temperature recommendations.
  - c. Enable Integrated Operation – Allows economizer to operate simultaneously with mechanical cooling

To determine the energy use associated with an unsealed RTU, the prototype models were modified using the associated reduction in efficiency reported in a Robert Mowris and Associates, Inc. study that was performed for the California Public Utilities Commission in 2016.<sup>765</sup> For further detail on the full modeled energy end use and savings summaries, see: “Packaged RTU Sealing\_End Use Analysis\_IL TRM 09042018.xlsx” spreadsheet.

After analyzing the modeled cooling annual energy usage for both the baseline (unsealed) and measure (sealed) model scenarios it was determined that the building type and climate zone variables had a minimal impact on the overall energy savings associated with the measure. As a result, the overall average savings factor of 4.67% was deemed applicable for any small commercial building type across all climate zones. This single savings value used in conjunction with the energy and demand savings calculations listed in the following sections will allow the savings

---

<sup>762</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>763</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>764</sup> Energy Center of Wisconsin, ComEd Portfolio Modeling Report, July 30, 2010.

<sup>765</sup> Robert Mowris & Associates, Inc., “Laboratory Test Results of Commercial Packaged HVAC Maintenance Faults,” California Public Utilities Commission, Feb 15, 2016 Section 5.4.



to be calculated based on the unit size and equivalent full load hours listed in the Illinois Technical Resource Manual (TRM).

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (kBtu/hr) / EER_{before} * EFLH * \%Savings$$

Where:

kBtu/hr = rated capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).

=Actual

EER<sub>before</sub> = Energy Efficiency Ratio (EER) of the baseline equipment

=Actual

%Savings = Deemed savings percentage

= 4.67%<sup>766</sup>

EFLH<sub>cooling</sub> = IL TRM v6 Equivalent Full Load Hours (EFLH) for cooling are provided in the following table

Building Type	Cooling EFLH				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Assembly	725	796	937	1,183	932
Assisted Living	1,475	1,457	1,773	2,110	1,811
College	475	481	662	746	806
Conditioned Storage (Warehouse)	357	338	422	647	533
Convenience Store	1,088	1,067	1,368	1,541	1,371
Garage	934	974	1,226	1,582	1,383
Grocery	1,033	1,000	1,236	1,499	1,286
Manufacturing Facility	1,010	1,055	1,209	1,453	1,273
Office - Low Rise	949	1,010	1,182	1,452	1,281
Religious Building	861	817	967	1,159	1,067
Restaurant	1,074	1,134	1,279	1,627	1,325
Retail - Department Store	949	889	1,124	1,367	1,157
Retail - Strip Mall	950	919	1,149	1,351	1,215

**For example**, a 12 EER 5-ton rooftop air conditioner on a department store in Rockford receives packaged RTU sealing:

$$\begin{aligned} \Delta kWh &= (5*12) / 12 * 949 * 4.67\% \\ &= 221.6 kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW_{ssp} = (kBtu/hr) / EER_{before} * \%Savings * CF_{ssp}$$

$$\Delta kW_{pjm} = (kBtu/hr) / EER_{before} * \%Savings * CF_{pjm}$$

<sup>766</sup> The average cooling energy savings for all building types and climate zones, as determined by modeling 13 small commercial building types across 5 weather zones utilizing the prototype TRM eQuest models. For additional reference on the methodology and approach to the calculation of the deemed savings factor, see "Packaged RTU Sealing\_End Use Analysis\_IL TRM 09042018.xlsx".

Where:

- kBtu/hr = Capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).  
=Actual
- EER<sub>before</sub> = Energy Efficiency Ratio (EER) of the baseline equipment  
=Actual
- %Savings = Deemed savings percentage  
= 4.67%
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 91.3%<sup>767</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 47.8%<sup>768</sup>

**For example**, a 12 EER 5-ton rooftop air conditioner using the Summer System Peak Coincidence Factor receives RTU sealing:

$$\begin{aligned} \Delta kW &= (5 \cdot 12) / 12 \cdot 4.67\% \cdot 91.3\% \\ &= 0.213 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

$$\Delta \text{Therm} = (\text{kBtu/hr}) / 100 / \text{Efficiency}_{\text{before}} \cdot \text{EFLH} \cdot \% \text{Savings}$$

Where:

- kBtu/hr = rated capacity of the heating equipment actually installed in kBtu per hour  
=Actual
- 100 = Converts kBtu/hr to Therms/hr
- Efficiency<sub>before</sub> = Efficiency of the baseline equipment (rated)  
=Actual
- %Savings = Deemed savings percentages by building type and climate zone are provided in the following table

Building Type	Savings Percentage				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Assembly	2.84%	2.86%	2.86%	2.98%	2.94%
Assisted Living	4.01%	4.15%	4.35%	4.64%	5.44%
College	3.86%	3.88%	3.97%	4.09%	5.10%
Conditioned Storage (Warehouse)	0.92%	0.90%	0.87%	1.00%	1.23%
Convenience Store	3.07%	3.20%	3.43%	3.70%	4.63%

<sup>767</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>768</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Building Type	Savings Percentage				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Garage	0.20%	0.21%	0.22%	0.23%	0.29%
Grocery	3.38%	3.49%	3.60%	3.79%	4.57%
Manufacturing Facility	0.18%	0.16%	0.16%	0.16%	0.16%
Office - Low Rise	2.19%	2.23%	2.37%	2.46%	2.96%
Religious Building	0.28%	0.28%	0.30%	0.31%	0.37%
Restaurant	2.76%	2.83%	2.96%	3.11%	3.58%
Retail - Department Store	1.87%	1.91%	2.00%	2.14%	2.88%
Retail - Strip Mall	2.06%	2.12%	2.29%	2.46%	3.17%

EFLH<sub>heating</sub> = IL TRM v6 Equivalent Full Load Hours (EFLH) for heating are provided in the following table

Building Type	Heating EFLH				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Assembly	1,787	1,831	1,635	1,089	1,669
Assisted Living	1,683	1,646	1,446	1,063	1,277
College	1,530	1,430	1,276	709	849
Conditioned Storage (Warehouse)	1,338	1,098	976	771	810
Convenience Store	1,481	1,368	1,214	871	973
Garage	985	969	852	680	752
Grocery	1,608	1,602	1,404	876	1,047
Manufacturing Facility	1,048	1,013	939	567	634
Office - Low Rise	1,428	1,425	1,132	692	793
Religious Building	1,603	1,504	1,440	1,054	1,205
Restaurant	1,350	1,354	1,216	920	1,091
Retail - Department Store	1,123	979	852	697	689
Retail - Strip Mall	1,332	1,233	1,090	751	810

**For example**, a packaged RTU with an 80% efficient 150-kBtu/hr gas furnace on a department store in Rockford receives packaged RTU sealing:

$$\Delta\text{Therm} = (150 / 100) / 80\% * 1,123 * 1.87\%$$

$$= 39.4 \text{ Therms}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-PRTU-V01-190101**

**REVIEW DEADLINE: 1/1/2023**

## 4.4.44 Commercial Ground Source and Ground Water Source Heat Pump

### DESCRIPTION

This measure characterizes the installation of a Ground Source Heat Pump under the following scenarios:

- A. New Construction:
  - i. The installation of a new Ground Source Heat Pump system meeting ENERGY STAR efficiency standards presented below in a new C&I building.
  - ii. Note the baseline in this case should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition.
- B. Time of Sale:
  - i. The planned installation of a new Ground Source Heat Pump system meeting ENERGY STAR efficiency standards presented below to replace an existing system(s) that does not meet the criteria for early replacement described in section C below.
  - ii. Note the baseline in this case is an equivalent replacement system to that which exists currently in the building. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, only an electric utility or only a gas utility.
  - iii. DHW savings are calculated based upon the fuel type and efficiency of the existing unit.
- C. Early Replacement/Retrofit:
  - i. The early removal of functioning electric or gas space heating and/or cooling systems from service, prior to the natural end of life, and replacement with a new high efficiency Ground Source Heat Pump system.
  - ii. Note the baseline in this case is the existing equipment being replaced. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, only an electric utility or only a gas utility. DHW savings are calculated based upon the fuel and efficiency of the existing unit.
  - iii. Early Replacement determination will be based on meeting the following conditions:
    - The existing unit is operational when replaced, or
    - The existing unit requires minor repairs to be operational, defined as costing less than:<sup>769</sup>

Existing System	Maximum repair cost
Air Source Heat Pump	\$263/ton
Chiller	\$308/ton
Boiler (Steam)	\$3.87/ kBtu
Boiler (Hot Water)	\$4.25/ kBtu
Furnace	\$2.49/ kBtu
Ground Source Heat Pump	\$2,185/ton

- All other conditions will be considered Time of Sale.

The Baseline efficiency of the existing unit replaced:

- Use actual existing efficiency whenever possible.
- If the efficiency of the existing unit is unknown, use assumptions based on the federal minimum standards provided in tables below.
- If the operational status or repair cost of the existing unit is unknown use time of sale assumptions.

<sup>769</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost (defined in the Measure Costs section), it can be considered early replacement.

The installation of the GSHP should meet the following design parameters to ensure a properly sized circulation pump. If the GSHP design does not meet the following parameters, a custom calculation should be performed to account for the motor energy consumed by the circulation pump. Optimal design parameters are:

- Circulation pump is included in the manufacturer assembly of the GSHP system  
Or;
- Circulation pump flow rate less than or equal to 3.0 GPM per system ton
- Variable flow controls on pumps serving systems greater than 10 tons. Variable flow controls include one of the following:
  - A variable speed system pump controlled from differential pressure and 2-way water flow control valves on each heat pump.
  - Individual on/off pumps on each heat pump controlled by heat pump demand. The heat pumps may be decoupled from the ground heat exchanger using a separate variable speed pump controlled by differential temperature across the ground loop.
- On/off or variable flow controls on pumps for systems less than 10 tons. On/off pump controls shall operate only when heat pump(s) are running.
- System pumping head less than 80 feet. For systems 10 tons or smaller system pumping head should not exceed 40 feet.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

#### **DEFINITION OF EFFICIENT EQUIPMENT**

For these products, the baseline equipment includes Air Conditioning, Space Heating and Domestic Hot Water Heating.

New Construction:

To calculate savings with an electric baseline, the baseline equipment is assumed to be an Air Source Heat Pump meeting the Federal Standard efficiency level as outlined in Table 2 (effective 1/1/2016 to 6/30/2019) or Table 7 (effective 7/1/2019); and a Federal Standard electric hot water heater efficiency level as outlined in Table 6 (effective 1/1/2016 to 6/30/2019) or Table 11 (effective 7/1/2019).

To calculate savings with a chiller/unitary cooling systems and boiler/furnace baseline, the baseline equipment is assumed to meet the minimum standard efficiencies as outlined in the Table 3 (effective 1/1/2016 to 6/30/2019) or Table 8 (effective 7/1/2019)

**Table** for chillers/unitary cooling systems, and Table 4 (effective 1/1/2016 to 6/30/2019) or Table 9 (effective 7/1/2019) for boilers or Table 5 (effective 1/1/2016 to 6/30/2019) or Table 10 (effective 7/1/2019) for furnaces. If a desuperheater is installed, the domestic hot water heater minimum standard efficiency is calculated as per Table 6 (effective 1/1/2016 to 6/30/2019) or Table 11 (effective 7/1/2019) below.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

**Table2: IECC 2015 ASHP Minimum Efficiency Requirements (effective 1/1/2016 to 6/30/2019):**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE <sup>a</sup>
				Before 1/1/2016	As of 1/1/2016	
Air cooled (cooling mode)	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER <sup>c</sup>	14.0 SEER <sup>c</sup>	AHRI 210/240
			Single Package	13.0 SEER <sup>c</sup>	14.0 SEER <sup>c</sup>	
Through-the-wall, air cooled	≤ 30,000 Btu/h <sup>b</sup>	All	Split System	12.0 SEER	12.0 SEER	
			Single Package	12.0 SEER	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.0 IEER	
			All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 11.8 IEER
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 10.7 IEER	10.6 EER 11.6 IEER	
			All other	Split System and Single Package	10.4 EER 10.5 IEER	10.4 EER 11.4 IEER
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 10.6 IEER	
			All other	Split System and Single Package	9.3 EER 9.4 IEER	9.3 EER 9.4 IEER
Air cooled (heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	7.7 HSPF <sup>c</sup>	8.2 HSPF <sup>c</sup>	AHRI 210/240
			Single Package	7.7 HSPF <sup>c</sup>	8.0 HSPF <sup>c</sup>	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h <sup>b</sup> (cooling capacity)	—	Split System	7.4 HSPF	7.4 HSPF	
			Single Package	7.4 HSPF	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	6.8 HSPF	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	3.3 COP	
			17°Fdb/15°F wb outdoor air	2.25 COP	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	3.2 COP	
			17°Fdb/15°F wb outdoor air	2.05 COP	2.05 COP	

**Table 3: IECC 2015 Electric Chillers, Air-Cooled and Water-Cooled minimum efficiencies (effective 1/1/2016 to 6/30/2019)**

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE <sup>c</sup>
			Path A	Path B	Path A	Path B	
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15.800 IPLV	
	≥ 150 Tons		≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL	
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.				
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL	
			≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV	
	≥ 75 tons and < 150 tons		≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.615 IPLV	≤ 0.586 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV	
	≥ 150 tons and < 300 tons		≥ 0.680 FL	≥ 0.718 FL	≥ 0.660 FL	≥ 0.680 FL	
			≥ 0.580 IPLV	≥ 0.540 IPLV	≥ 0.540 IPLV	≥ 0.440 IPLV	
	≥ 300 tons and < 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV	
≥ 600 tons	≤ 0.620 FL	≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL			
		≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV		
Water cooled, electrically operated centrifugal	< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV	
	≥ 150 tons and < 300 tons		≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.400 IPLV	
	≥ 300 tons and < 400 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.520 IPLV	≤ 0.390 IPLV	
	≥ 400 tons and < 600 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
≥ 600 Tons	≤ 0.570 FL	≤ 0.590 FL	≤ 0.560 FL	≤ 0.585 FL			
		≤ 0.539 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV		
Air cooled, absorption, single effect	All capacities	COP	≥ 0.600 FL	NA <sup>c</sup>	≥ 0.600 FL	NA <sup>c</sup>	AHRI 560
Water cooled absorption, single effect	All capacities	COP	≥ 0.700 FL	NA <sup>c</sup>	≥ 0.700 FL	NA <sup>c</sup>	
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>	
			≥ 1.050 IPLV		≥ 1.050 IPLV		
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>	
			≥ 1.000 IPLV		≥ 1.050 IPLV		



**Table 4: IECC 2015 Boiler minimum efficiency requirements (effective 1/1/2016 to 6/30/2019)**

EQUIPMENT TYPE <sup>a</sup>	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY <sup>d, e</sup>	TEST PROCEDURE
Boilers, hot water	Gas-fired	< 300,000 Btu/h	80% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	80% $E_t$	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	82% $E_c$	
	Oil-fired <sup>c</sup>	< 300,000 Btu/h	80% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	82% $E_t$	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	84% $E_c$	
Boilers, steam	Gas-fired	< 300,000 Btu/h	75% AFUE	10 CFR Part 430
	Gas-fired- all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	79% $E_t$	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	79% $E_t$	
	Gas-fired-natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	77% $E_t$	
		> 2,500,000 Btu/h <sup>a</sup>	77% $E_t$	
	Oil-fired <sup>c</sup>	< 300,000 Btu/h	80% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	81% $E_t$	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	81% $E_t$	

**Table 5: IECC 2015 Warm-air Furnace minimum efficiency standards (effective 1/1/2016 to 6/30/2019)**

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY <sup>d, e</sup>	TEST PROCEDURE <sup>a</sup>
Warm-air furnaces, gas fired	< 225,000 Btu/h	—	78% AFUE or 80% $E_t^c$	DOE 10 CFR Part 430 or ANSI Z21.47
	≥ 225,000 Btu/h	Maximum capacity <sup>c</sup>	80% $E_t^f$	ANSI Z21.47
Warm-air furnaces, oil fired	< 225,000 Btu/h	—	78% AFUE or 80% $E_t^c$	DOE 10 CFR Part 430 or UL 727
	≥ 225,000 Btu/h	Maximum capacity <sup>b</sup>	81% $E_t^g$	UL 727
Warm-air duct furnaces, gas fired	All capacities	Maximum capacity <sup>b</sup>	80% $E_c$	ANSI Z83.8
Warm-air unit heaters, gas fired	All capacities	Maximum capacity <sup>b</sup>	80% $E_c$	ANSI Z83.8
Warm-air unit heaters, oil fired	All capacities	Maximum capacity <sup>b</sup>	80% $E_c$	UL 731

**Table 6: IECC 2015 Water Heaters minimum performance (effective 1/1/2016 to 6/30/2019)**

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED <sup>a, b</sup>	TEST PROCEDURE
Water heaters, electric	≤ 12 kW <sup>d</sup>	Resistance	0.97 - 0.00 132V, EF	DOE 10 CFR Part 430
	> 12 kW	Resistance	$(0.3 + 27/V_m)$ , %/h	ANSI Z21.10.3
	≤ 24 amps and ≤ 250 volts	Heat pump	0.93 - 0.00 132V, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gal	0.67 - 0.0019V, EF	DOE 10 CFR Part 430
	> 75,000 Btu/h and ≤ 155,000 Btu/h	< 4,000 Btu/h/gal	$80\% E_t$ $(Q/800 + 110.\sqrt{V})SL$ , Btu/h	ANSI Z21.10.3
	> 155,000 Btu/h	< 4,000 Btu/h/gal	$80\% E_t$ $(Q/800 + 110.\sqrt{V})SL$ , Btu/h	
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h <sup>c</sup>	≥ 4,000 (Btu/h)/gal and < 2 gal	0.62 - 0.00 19V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	$80\% E_t$	ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	$80\% E_t$ $(Q/800 + 110.\sqrt{V})SL$ , Btu/h	

**Table7: IECC 2018 ASHP Minimum Efficiency Requirements (effective 7/1/2019)**

TABLE C403.3.2(2)  
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE <sup>a</sup>		
Air cooled (cooling mode)	< 65,000 Btu/h <sup>b</sup>	All	Split System	14.0 SEER	AHRI 210/240		
			Single Package	14.0 SEER			
Through-the-wall, air cooled	≤ 30,000 Btu/h <sup>b</sup>	All	Split System	12.0 SEER			
			Single Package	12.0 SEER			
Single-duct high-velocity air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER			
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.0 IEER		AHRI 340/360	
		All other	Split System and Single Package	10.8 EER 11.8 IEER			
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 11.6 IEER			
		All other	Split System and Single Package	10.4 EER 11.4 IEER			
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 10.6 IEER			
		All other	Split System and Single Package	9.3 EER 9.4 IEER			
	Water to Air: Water Loop (cooling mode)	< 17,000 Btu/h	All	86°F entering water	12.2 EER		ISO 13256-1
		≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	13.0 EER		
≥ 65,000 Btu/h and < 135,000 Btu/h		All	86°F entering water	13.0 EER			
Water to Air: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	18.0 EER	ISO 13256-1		
Brine to Air: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering water	14.1 EER	ISO 13256-1		
Water to Water: Water Loop (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	ISO 13256-2		
Water to Water: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.3 EER			
Brine to Water: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER			

**Table 7 continued:**

Air cooled (heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	8.2 HSPF	AHRI 210/240
		—	Single Package	8.0 HSPF	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h <sup>b</sup> (cooling capacity)	—	Split System	7.4 HSPF	
		—	Single Package	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h <sup>b</sup>	—	Split System	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	AHRI 340/360
			17°Fdb/15°F wb outdoor air	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	
			17°Fdb/15°F wb outdoor air	2.05 COP	
Water to Air: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	ISO 13256-1
Water to Air: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	
Brine to Air: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	
Water to Water: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	ISO 13256-2
Water to Water: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.1 COP	
Brine to Water: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W. °C = [(°F) - 32]/1.8.

- a. Chapter 8 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
- b. Single-phase, air-cooled heat pumps less than 65,000 Btu/h are regulated by NAECA. SEER and HSPF values are those set by NAECA.

**Table 8: IECC 2018 Electric Chillers, Air-Cooled and Water-Cooled minimum efficiencies (effective 7/1/2019)**

TABLE C403.3.2(7)  
WATER CHILLING PACKAGES — EFFICIENCY REQUIREMENTS<sup>a, b, d</sup>

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE <sup>c</sup>		
			Path A	Path B	Path A	Path B			
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590		
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15.800 IPLV			
	≥ 150 Tons		≥ 9.562 FL	NA <sup>c</sup>	≥ 10.100 FL	≥ 9.700 FL			
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV			
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.						
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL			
			≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV			
	≥ 75 tons and < 150 tons		≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL			
			≤ 0.615 IPLV	≤ 0.586 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV			
	≥ 150 tons and < 300 tons		≥ 0.680 FL	≥ 0.718 FL	≥ 0.660 FL	≥ 0.680 FL			
			≥ 0.580 IPLV	≥ 0.540 IPLV	≥ 0.540 IPLV	≥ 0.440 IPLV			
	≥ 300 tons and < 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL			
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV			
	≥ 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL			
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV			
	Water cooled, electrically operated centrifugal		< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	
					≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV	
≥ 150 tons and < 300 tons		≤ 0.634 FL	≤ 0.639 FL		≤ 0.610 FL	≤ 0.635 FL			
		≤ 0.596 IPLV	≤ 0.450 IPLV		≤ 0.550 IPLV	≤ 0.400 IPLV			
≥ 300 tons and < 400 tons		≤ 0.576 FL	≤ 0.600 FL		≤ 0.560 FL	≤ 0.595 FL			
		≤ 0.549 IPLV	≤ 0.400 IPLV		≤ 0.520 IPLV	≤ 0.390 IPLV			
≥ 400 tons and < 600 tons		≤ 0.576 FL	≤ 0.600 FL		≤ 0.560 FL	≤ 0.585 FL			
		≤ 0.549 IPLV	≤ 0.400 IPLV		≤ 0.500 IPLV	≤ 0.380 IPLV			
≥ 600 Tons		≤ 0.570 FL	≤ 0.590 FL		≤ 0.560 FL	≤ 0.585 FL			
		≤ 0.539 IPLV	≤ 0.400 IPLV		≤ 0.500 IPLV	≤ 0.380 IPLV			
Air cooled, absorption, single effect		All capacities	COP		≥ 0.600 FL	NA <sup>c</sup>	≥ 0.600 FL	NA <sup>c</sup>	AHRI 560
Water cooled absorption, single effect		All capacities	COP		≥ 0.700 FL	NA <sup>c</sup>	≥ 0.700 FL	NA <sup>c</sup>	
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>			
			≥ 1.050 IPLV		≥ 1.050 IPLV				
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA <sup>c</sup>	≥ 1.000 FL	NA <sup>c</sup>			
			≥ 1.000 IPLV		≥ 1.050 IPLV				

**Table 9: IECC 2018 Boiler minimum efficiency requirements (effective 7/1/2019)**

Note Code of Federal Regulations for gas -fired hot water boilers manufactured after January 15, 2021 require <300,000Btuh hot water boilers to be 84% AFUE and <300,000 Btuh steam boilers to be 82% AFUE (10 CFR 432(e)(3)). This should be assumed baseline from 1/1/2022.

TABLE C403.3.2(5)  
MINIMUM EFFICIENCY REQUIREMENTS: GAS- AND OIL-FIRED BOILERS

EQUIPMENT TYPE <sup>a</sup>	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY <sup>d, e</sup>	TEST PROCEDURE
Boilers, hot water	Gas-fired	< 300,000 Btu/h <sup>f, g</sup>	82% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	80% E <sub>t</sub>	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	82% E <sub>c</sub>	
	Oil-fired <sup>c</sup>	< 300,000 Btu/h <sup>a</sup>	84% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	82% E <sub>t</sub>	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	84% E <sub>c</sub>	
Boilers, steam	Gas-fired	< 300,000 Btu/h <sup>f</sup>	80% AFUE	10 CFR Part 430
	Gas-fired- all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	79% E <sub>t</sub>	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	79% E <sub>t</sub>	
	Gas-fired-natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	77% E <sub>t</sub>	
		> 2,500,000 Btu/h <sup>a</sup>	77% E <sub>t</sub>	
	Oil-fired <sup>c</sup>	< 300,000 Btu/h	82% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h <sup>b</sup>	81% E <sub>t</sub>	10 CFR Part 431
		> 2,500,000 Btu/h <sup>a</sup>	81% E <sub>t</sub>	

**Table 10: IECC 2018 Warm-air Furnace minimum efficiency standards (effective 7/1/2019)**

TABLE C403.3.2(4)  
WARM-AIR FURNACES AND COMBINATION WARM-AIR FURNACES/AIR-CONDITIONING UNITS, WARM-AIR DUCT FURNACES AND UNIT HEATERS, MINIMUM EFFICIENCY REQUIREMENTS

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY <sup>d, e</sup>	TEST PROCEDURE <sup>a</sup>
Warm-air furnaces, gas fired	< 225,000 Btu/h	—	80% AFUE or 80%E <sub>t</sub>	DOE 10 CFR Part 430 or ANSI Z21.47
	≥ 225,000 Btu/h	Maximum capacity <sup>c</sup>	80%E <sub>t</sub> <sup>f</sup>	ANSI Z21.47
Warm-air furnaces, oil fired	< 225,000 Btu/h	—	83% AFUE or 80%E <sub>t</sub>	DOE 10 CFR Part 430 or UL 727
	≥ 225,000 Btu/h	Maximum capacity <sup>b</sup>	81%E <sub>t</sub> <sup>g</sup>	UL 727
Warm-air duct furnaces, gas fired	All capacities	Maximum capacity <sup>b</sup>	80%E <sub>c</sub>	ANSI Z83.8
Warm-air unit heaters, gas fired	All capacities	Maximum capacity <sup>b</sup>	80%E <sub>c</sub>	ANSI Z83.8
Warm-air unit heaters, oil fired	All capacities	Maximum capacity <sup>b</sup>	80%E <sub>c</sub>	UL 731

**Table 11: IECC 2018 Water Heaters minimum performance (effective 7/1/2019)**

TABLE C404.2  
MINIMUM PERFORMANCE OF WATER-HEATING EQUIPMENT

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED <sup>a, b</sup>	TEST PROCEDURE
Water heaters, electric	≤ 12 kW <sup>d</sup>	Tabletop <sup>e</sup> , ≥ 20 gallons and ≤ 120 gallons	0.93 - 0.00132V, EF	DOE 10 CFR Part 430
		Resistance ≥ 20 gallons and ≤ 55 gallons	0.960 - 0.0003V, EF	
		Grid-enabled <sup>f</sup> > 75 gallons and ≤ 120 gallons	1.061 - 0.00168V, EF	
	> 12 kW	Resistance	(0.3 + 27/V <sub>m</sub> ), %/h	ANSI Z21.10.3
	≤ 24 amps and ≤ 250 volts	Heat pump > 55 gallons and ≤ 120 gallons	2.057 - 0.00113V, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gallons and > 55 gallons	0.675 - 0.0015V, EF	DOE 10 CFR Part 430
		> 55 gallons and ≤ 100 gallons	0.8012 - 0.00078V, EF	
	> 75,000 Btu/h and ≤ 155,000 Btu/h	< 4,000 Btu/h/gal	80% E <sub>t</sub>	ANSI Z21.10.3
	> 155,000 Btu/h	< 4,000 Btu/h/gal	80% E <sub>t</sub>	
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h <sup>c</sup>	≥ 4,000 (Btu/h)/gal and < 2 gal	0.82 - 0.00 19V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E <sub>t</sub>	ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E <sub>t</sub>	

Time of Sale: The baseline for this measure is a new replacement unit of the same system type as the existing unit, meeting the minimum standard efficiencies provided above.

Early replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating, cooling and hot water equipment for the assumed remaining useful life of the existing unit, and a new baseline heating and cooling system for the remainder of the measure life (as provided in table above).

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of the ground source heat pump is assumed to be 25 years.<sup>770</sup>

The expected measure life of the ground loop field is assumed to be 50 years.<sup>771</sup>

For early replacement, the remaining life of existing equipment is assumed to be 6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers and GSHP,<sup>772</sup> and 25 years for electric resistance.<sup>773</sup>

#### DEEMED MEASURE COST

New Construction and Time of Sale: Incremental costs of the Ground Source Heat Pump should be used. This would be the actual installed cost of the Ground Source Heat Pump, well drilling, building retrofit, and system commissioning costs (default of \$10,923 per ton),<sup>774</sup> minus the assumed installation cost of the baseline equipment (\$1,316 per ton for ASHP,<sup>775</sup> or \$12.43 per kBtu capacity for a new baseline efficient furnace or \$19.33 per kBtu capacity for a new efficient steam boiler or \$21.27 per kBtu capacity for a new efficient hot water boiler,<sup>776</sup> and \$1,539 per ton for new baseline chiller replacement<sup>777</sup>).

Early Replacement: The actual installed cost of the Ground Source Heat Pump should be used (default cost for total system retrofit provided above). The assumed deferred cost (after 8 years) of replacing existing equipment with a new baseline unit is assumed to be \$1,316 per ton for a new baseline Air Source Heat Pump, or \$12.43 per kBtu capacity for a new baseline efficient furnace or \$19.33 per kBtu capacity for a new efficient steam boiler or \$21.27 per kBtu capacity for a new efficient hot water boiler and \$1,539 per ton for new baseline chiller replacement. This future cost should be discounted to present value using the nominal societal discount rate.

#### LOADSHAPE

Loadshape C04 – Commercial Electric Heating (if replacing building with no existing cooling)

Loadshape C05 - Commercial Electric Heating and Cooling

Note for the purpose of cost effectiveness screening for a fuel switch scenario, the heating kWh increase and cooling kWh decrease should be calculated separately such that the appropriate loadshape (i.e., Loadshape C04 - Commercial Electric Heating and Loadshape C03 – Commercial Cooling respectively) can be applied.

#### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's

---

<sup>770</sup> System life of indoor components as per US DOE estimates from the Office of Energy Efficiency & Renewable Energy. The ground loop has a much longer life, but the compressor and other mechanical components are the same as an ASHP.

<sup>771</sup> U.S. DOE Office of Energy Efficiency & Renewable Energy, Energy Saver details and descriptions for Geothermal Heat Pumps

<sup>772</sup> Assumed to be one third of effective useful life of replaced equipment.

<sup>773</sup> Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.

<sup>774</sup> Average calculated based on reviewing cost information received from Chicagoland GSHP installers.

<sup>775</sup> Average calculated from Energy Star and RSMeans Mechanical Cost Data 2015.

<sup>776</sup> Average calculated based on RSMeans Mechanical Cost Data 2015.

<sup>777</sup> Average calculated based on RSMeans Mechanical Cost Data 2015 for Scroll, air cooled condenser chillers.



capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)} \\ &= 91.3\%^{778} \end{aligned}$$

$$\begin{aligned} CF_{PJM} &= \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)} \\ &= 47.8\%^{779} \end{aligned}$$

---



---

### Algorithm

---



---

#### CALCULATION OF ENERGY SAVINGS

##### ELECTRIC ENERGY SAVINGS AND NATURAL GAS SAVINGS

Non-fuel switch measures:

$$\Delta kWh = [\text{Cooling savings}] + [\text{Heating savings}] + [\text{DHW savings}]$$

$$\text{Cooling Savings} = (\text{Capacity}_{\text{cool}} * EFLH_{\text{cool}} * (1/EER_{\text{base}} - 1/EER_{\text{GSHP}}))/1000$$

$$\text{Heating Savings} = (\text{Capacity}_{\text{Heat}} * EFLH_{\text{Heat}} * (1/HSPF_{\text{base}} - 1/(COP_{\text{GSHP}} * 3.412)))/1000$$

$$\text{DHW Savings} = \text{Elec}_{\text{DHW}} * (\% \text{DHW} * ((1/EF_{\text{elecbase}}) * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{Water}} * (T_{\text{out}} - T_{\text{in}}) * 1/3412))$$

Fuel switch measures:

Fuel switch measures must produce positive total annual source fuel savings (i.e., reduction in source Btus) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

$$\text{SourceEnergySavings (MMBTUs)} = \text{GasHeatReplaced} - \text{GSHPSourceHeatConsumed} + \text{GSHPSourceCoolingImpact} + \text{GSHPSourceWaterImpact}$$

$$\text{GasHeatReplaced}^{780} = [(EFLH_{\text{Heat}} * \text{Capacity}_{\text{Heat}} * 1/AFUE_{\text{base}}) / 1,000,000]$$

$$\text{GSHPSourceHeatConsumed} = [EFLH_{\text{Heat}} * \text{Capacity}_{\text{Heat}} * (1/(COP_{\text{GSHP}} * 3.412))/1000] * H_{\text{grid}} / 1,000,000$$

$$\text{GSHPSourceCoolingImpact} = [EFLH_{\text{cool}} * \text{Capacity}_{\text{Cool}} * (1/EER_{\text{base}} - 1/EER_{\text{GSHP}})/1000] * H_{\text{grid}} / 1,000,000$$

$$\text{GSHPSourceWaterImpact}_{\text{Gas}} = (\% \text{DHWD} * ((1/EF_{\text{Gas}} * \text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 1,000,000$$

$$\text{GSHPSourceWaterImpact}_{\text{Electric}} = (\% \text{DHWD} * ((1/EF_{\text{Elec}} * \text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) * H_{\text{grid}} / 1,000,000$$

If SourceEnergySavings calculated above is positive, the measure is eligible.

---

<sup>778</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>779</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>780</sup> Note the Gas Source to Site ratio is assumed to be 1.0.

Two electric algorithms and one gas algorithm are provided below. The appropriate claim is dependent on which utilities are supporting the measure as provided in a table below.

$$\Delta kWh_{FuelSwitch} = [\text{Heat consumption of baseline ASHP}]$$

$$= [(EFLH_{Heat} * Capacity_{Heat} * 1/HSPF_{baseASHP})/1000]$$

$$\Delta kWh_{EfficiencyImprovement} = [\text{Cooling Savings}] + [\text{Heat Savings from Baseline ASHP to GSHP}] + [\text{DHW savings if displacing electric DHW}]$$

$$= [EFLH_{cool} * Capacity_{cool} * (1/EER_{base} - 1/EER_{GSHP})/1000] + [EFLH_{Heat} * Capacity_{Heat} * (1/HSPF_{baseASHP} - 1/(COP_{GSHP} * 3.412))/1000] + [ElecDHW * \%DHW * ((1/EF_{elecbase} * HotWaterUse_{Gallon} * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 3412)]$$

$$\Delta Therm_{FuelSwitch} = [\text{Heat consumption of baseline gas system}] + [\text{DHW savings if displacing gas DHW}]$$

$$= [(EFLH_{Heat} * Capacity_{Heat} * 1/AFUE_{base}) / 100,000] + [(1 - ElecDHW) * \%DHW * (1/EF_{GASBASE} * HotWaterUse_{Gallon} * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 100,000]$$

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$\Delta kWh_{EfficiencyImprovement} - \Delta kWh_{FuelSwitch} + (\Delta Therm_{FuelSwitch} / kWh_{toTherm})$	N/A
Electric and gas utility	$\Delta kWh_{EfficiencyImprovement}$	$\Delta Therm_{FuelSwitch} - (\Delta kWh_{FuelSwitch} * kWh_{toTherm})$
Gas utility only	N/A	$\Delta Therm_{FuelSwitch} - (\Delta kWh_{FuelSwitch} * kWh_{toTherm}) + (\Delta kWh_{EfficiencyImprovement} * kWh_{toTherm})$

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

- Capacity<sub>cool</sub> = Cooling Capacity of Ground Source Heat Pump (Btu/hr)  
= Actual installed
- EFLH<sub>cool</sub> = Cooling Equivalent Full Load Hours  
Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use
- EER<sub>Base</sub> = Energy Efficiency Ratio (EER) of existing cooling unit (kBtu/hr / kW).  
For early replacement, use actual EER rating for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 8 years for GSHP). If EER unknown but SEER available, convert using the equation:<sup>781</sup> EER<sub>exist</sub> = (-0.02 \* SEER<sub>exist</sub><sup>2</sup>) + (1.12 \* SEER<sub>exist</sub>).  
For TOS, NC, and the remaining measure life of early replacement, use minimum standard efficiencies as specified in tables in 'Definition of Baseline Equipment' section.

<sup>781</sup> From Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder.

$EER_{GSHP}$	= Part Load Energy Efficiency Ratio efficiency of efficient GSHP unit <sup>782</sup> = Actual installed
$Capacity_{Heat}$	= Heating Capacity of Ground Source Heat Pump (Btu/hr) = Actual installed
$EFLH_{Heat}$	= Heating Equivalent Full Load Hours Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use
$HSPF_{Base}$	= Heating System Performance Factor of baseline electric heating system (kBtu/kWh) For early replacement, use actual EER rating for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 8 years for GSHP or 15 years for electric resistance). For electric resistance, assume 3.41. <sup>783</sup>  For TOS, NC, and the remaining measure life of early replacement, use minimum standard efficiencies as specified in tables in 'Definition of Baseline Equipment' section.
$COP_{GSHP}$	= Part Load Coefficient of Performance of efficient GSHP <sup>784</sup> = Actual installed
3.412	= Constant to convert the COP of the unit to the Heating Season Performance Factor (HSPF)
$Elec_{DHW}$	= 1 if building has electric DHW = 0 if building has non electric DHW = 0 if one to one replacement of existing Ground Source Heat Pump
%DHW	= Percentage of total DHW load that the GSHP will provide = Actual if known = If unknown and if desuperheater installed, assume 44% <sup>785</sup> = 0% if no desuperheater installed
$EF_{elecbase}$	= Energy Factor of baseline electric DHW = Actual. If unknown or for new construction, assume federal standard as defined in applicable table in 'Definition of Baseline Equipment' section.
$HotWaterUse_{Gallon}$	= Estimated annual hot water consumption (gallons)  = Actual if possible to provide reasonable custom estimate. If not, two methodologies are provided to develop an estimate:  1. Consumption per usable storage tank capacity = Capacity * Consumption/cap

Where:

Capacity = Usable capacity of hot water storage tank in gallons  
= Actual

---

<sup>782</sup> From Res GSHP measure of the IL-TRM: As per conversations with David Buss territory manager for Connor Co, the EER rating of an ASHP equate most appropriately with the full load EER of a GSHP.

<sup>783</sup> Electric resistance has a COP of 1.0 which equals  $1/0.293 = 3.41$  HSPF.

<sup>784</sup> As per Res GSHP measure.

<sup>785</sup> Assumes that the desuperheater can provide two thirds of hot water needs for eight months of the year ( $2/3 * 2/3 = 44\%$ ). Based on input from Doug Dougherty, Geothermal Exchange Organization.

Consumption/cap = Estimate of consumption per gallon of usable tank capacity, based on building type:<sup>786</sup>

Building Type <sup>787</sup>	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894

2. Consumption per unit area by building type  
 = (Area/1000) \* Consumption/1,000 sq.ft.

Where:

Area = Area in sq.ft that is served by DHW boiler  
 = Actual

Consumption/1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:<sup>788</sup>

Building Type <sup>789</sup>	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941

<sup>786</sup> Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtu/h or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

<sup>787</sup> According to CBECS 2012 “Lodging” buildings include Dormitories, Hotels, Motel or Inns and other Lodging and “Nursing” buildings include Assisted Living and Nursing Homes.

<sup>788</sup> Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtu/h or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

<sup>789</sup> According to CBECS 2012 “Lodging” buildings include Dormitories, Hotels, Motel or Inns and other Lodging and “Nursing” buildings include Assisted Living and Nursing Homes.

Building Type <sup>789</sup>	Consumption/1,000 sq.ft.
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

- $\gamma_{\text{Water}}$  = Density of water  
= 8.33 pounds per gallon
- $T_{\text{out}}$  = Tank temperature  
= 125°F
- $T_{\text{in}}$  = Incoming water temperature from well or municipal system  
= 54°F<sup>790</sup>
- 1 = Heat Capacity of water (1 Btu/lb\*°F)
- 3.412 = Conversion from Btu to kWh
- $\text{AFUE}_{\text{base}}$  = Baseline Annual Fuel Utilization Efficiency Rating.  
For early replacement measures, use actual AFUE rating for the remaining useful life of the existing equipment (7 years for furnace, 8 years for boilers).  
  
For TOS, NC, and the remaining measure life of early replacement, use minimum standard efficiencies as specified in tables in 'Definition of Baseline Equipment' section.
- $\text{EF}_{\text{GasBase}}$  = Energy factor of Baseline natural gas DHW heater  
= Actual. If unknown or New Construction, assume federal standard as defined in applicable table in 'Definition of Baseline Equipment' section.
- $\text{kWh}_{\text{toTherm}}$  = Conversion between kWh at source/generation and Therms  
=  $H_{\text{grid}} / 100000$   
  
 $H_{\text{grid}}$  = Heat rate of the grid in btu/kWh based on the average fossil heat rate for the EPA eGRID subregion and includes a factor that considers T&D losses.  
  
For systems operating less than 6,500 hrs per year:  
  
Use the Non-baseload heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest).<sup>791</sup> Also include any line losses.  
  
For systems operating more than 6,500 hrs per year:

<sup>790</sup> US DOE Building America Program. Building America Analysis Spreadsheet. For Chicago, IL.

<sup>791</sup> These values are subject to regular updates so should be reviewed regularly to ensure the current assumptions are correct. Refer to the latest EPA eGRID data. Current values, based on eGrid 2018 are:

- Non-Baseload RFC West: 10,024 Btu/kWh \* (1 + Line Losses)
- Non-Baseload SERC Midwest: 9,871 Btu/kWh \* (1 + Line Losses)
- All Fossil Average RFC West: 9,575 Btu/kWh \* (1 + Line Losses)
- All Fossil Average SERC Midwest: 10,369 Btu/kWh \* (1 + Line Losses)

Use the All Fossil Average heat rate provided by EPA eGRID for RFC West region for ComEd territory, and SERC Midwest region for Ameren territory. Also include any line losses.

### Non Fuel Switch Illustrative Examples

#### New Construction using ASHP baseline:

**For example**, a 10 ton closed loop unit with Part Load EER rating of 20 and Part Load COP of 4.4, with desuperheater installed, and with a 100 gallon electric water heater in an Assisted living building in Chicago:

$$\begin{aligned} \Delta kWh &= [120,000 * 1,457 * (1/11 - 1/20) / 1000] + [1,646 * 120,000 * (1/11 - 1/(4.4 * 3.412)) / 1000] + [1 * 0.44 * \\ &((1/0.9568 * (100 * 672) * 8.33 * (125 - 54) * 1) / 3412)] \\ &= 7,153 + 4,800 + 5,357 = 17,309 \text{ kWh} \end{aligned}$$

#### Early Replacement:

**For example**, a 10 ton closed loop unit with Part Load EER rating of 20 and Part Load COP of 4.4 and with a desuperheater installed in an Assisted living building in Chicago with a 100 gallon electric water heater, replacing an existing working Air Source Heat Pump with efficiency ratings of 8.2 EER and 7.7 HSPF:

$$\begin{aligned} \Delta kWh \text{ for remaining life of existing unit (1st 8 years):} \\ &= [120,000 * 1,457 * (1/8.2 - 1/20) / 1000] + [1,646 * 120,000 * (1/7.7 - 1/(4.4 * 3.412)) / 1000] + [1 * 0.44 * \\ &((1/0.9568 * (100 * 672) * 8.33 * (125 - 54) * 1) / 3412)] \\ &= 12,580 + 12,495 + 5,357 = 30,432 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh \text{ for remaining measure life (next 17 years):} \\ &= [120,000 * 1,457 * (1/11 - 1/20) / 1000] + [1,646 * 120,000 * (1/11 - 1/(4.4 * 3.412)) / 1000] + [1 * 0.44 * \\ &((1/0.9568 * (100 * 672) * 8.33 * (125 - 54) * 1) / 3412)] \\ &= 7,153 + 4,800 + 5,357 = 17,310 \text{ kWh} \end{aligned}$$

#### Fuel Switch Illustrative Example

*[for illustrative purposes a Heat Rate of 10,000 Btu/kWh is used, kWh to Therm = 10,000/100,000 = 0.1]*

#### Early Replacement fuel switch:

A 10 ton closed loop unit with Part Load EER rating of 20 and Part Load COP of 4.4 in an Assisted Living building in Chicago with a 100 gallon gas water heater replaces an existing working natural gas boiler with 75% efficiency and central AC of 9.5 EER, and desuperheater installed with natural gas existing DHW heater:

LifetimeSourceEnergySavings (MMBTUs) = LifetimeGasHeatReplaced – LifetimeGSHPSourceHeatConsumed + LifetimeGSHPSourceCoolingImpact + LifetimeGSHPSourceWaterImpact

$$\begin{aligned} \text{LifetimeGasHeatReplaced} &= [(EFLH_{\text{Heat}} * Capacity_{\text{Heat}} * 1/AFUE_{\text{exist}}) / 1,000,000] * 8 \text{ years} + [(EFLH_{\text{Heat}} * \\ &Capacity_{\text{Heat}} * 1/AFUE_{\text{base}}) / 1,000,000] * 17 \text{ years} \\ &= ((120,000 * 1,646 * 1/0.75) / 1,000,000) * 8 + ((120,000 * 1,646 * 1/0.8) / 1,000,000) * 17 \\ &= 6304.2 \text{ MMBtu} \end{aligned}$$

$$\begin{aligned} \text{LifetimeGSHPSourceHeatConsumed} &= [EFLH_{\text{Heat}} * Capacity_{\text{Heat}} * (1/(COP_{\text{GSHP}} * 3.412)) / 1000] * H_{\text{grid}} / 1,000,000 \\ &* 25 \text{ years} \\ &= (120,000 * 1,646 * (1/(4.4 * 3.412))) / 1000 * 10,000 / 1,000,000 * 25 \\ &= 3289.2 \text{ MMBtu} \end{aligned}$$

$$\begin{aligned} \text{LifetimeGSHPSourceCoolingImpact} &= [(EFLH_{\text{cool}} * Capacity_{\text{cool}} * (1/EER_{\text{exist}} - 1/EER_{\text{GSHP}}) / 1000] * 6 \text{ years} + \\ &(EFLH_{\text{cool}} * Capacity_{\text{cool}} * (1/EER_{\text{base}} - 1/EER_{\text{GSHP}}) / 1000 * 19 \text{ years}) * H_{\text{grid}} / 1,000,000 \\ &= (((120,000 * 1,457 * (1/9.5 - 1/20)) / 1000) * 6) + (((120,000 * 1,457 * (1/11 - 1/20)) / 1000) * 19) * \\ &10,000 / 1,000,000 \\ &= 1938.7 \text{ MMBtu} \end{aligned}$$

**Fuel Switch Illustrative Example continued**

$$\begin{aligned} \text{LifetimeGSHPSourceWaterImpact}_{\text{Gas}} &= (\% \text{DHWDisplaced} * ((1/\text{EF}_{\text{Gas}} * \text{GPD} * \text{Household} * 365.25 * \\ &\quad \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 1,000,000 \\ &= (0.44 * (1/0.8 * (100*672) * 8.33 * (125-54) * 1) / 1,000,000) * 25 \\ &= 546.5 \text{ MMBtu} \end{aligned}$$

$$\text{LifetimeSourceEnergySavings (MMBTUs)} = 6304.2 - 3289.2 + 1938.7 + 546.5 = 5,500 \text{ MMBtu}$$

$$\begin{aligned} \Delta \text{kWh}_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline ASHP}] \\ &= [(120,000 * 1,646 * 1/11)/1000] \\ &= 17,956 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{kWh}_{\text{EfficiencyImprovement (Remaining Useful Life)}} &= [\text{Cooling Savings from existing to GSHP}] + [\text{Heat Savings} \\ &\quad \text{from Baseline ASHP to GSHP}] + [\text{DHW savings if displacing electric DHW}] \\ &= [120000 * 1,457 * (1/9.5 - 1/20) / 1000] + [120,000 * 1,646 * (1/11 - 1/(4.4 * \\ &\quad 3.412))/1000] + [0] \\ &= 9662 + 4800 + 0 \\ &= 14,462 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{kWh}_{\text{EfficiencyImprovement (Remaining measure)}} &= [\text{Cooling Savings from new baseline ASHP to GSHP}] + \\ &\quad [\text{Heat Savings from Baseline ASHP to GSHP}] + [\text{DHW savings if displacing} \\ &\quad \text{electric DHW}] \\ &= [120000 * 1,457 * (1/11 - 1/20) / 1000] + [120,000 * 1,646 * (1/11 - 1/(4.4 * \\ &\quad 3.412))/1000] + [0] \\ &= 7152 + 4800 + 0 \\ &= 11,952 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch (Remaining Useful Life)}} &= [\text{Heat consumption of existing gas system}] + [\text{DHW savings} \\ &\quad \text{if displacing gas DHW}] \\ &= [(120,000 * 1,646 * 1/0.75) / 100,000] + [(1 - 0) * (0.44 * (1/0.8 * (100*672) * 8.33 \\ &\quad * (125-54) * 1) / 100,000)] \\ &= 2634 + 219 \\ &= 2852 \text{ Therms} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch (Remaining measure)}} &= [\text{Heat consumption of baseline gas system}] + [\text{DHW savings if} \\ &\quad \text{displacing gas DHW}] \\ &= [(120,000 * 1,646 * 1/0.8) / 100,000] + [(1 - 0) * (0.44 * (1/0.8 * (100*672) * 8.33 \\ &\quad * (125-54) * 1) / 100,000)] \\ &= 2469 + 219 \\ &= 2688 \text{ Therms} \end{aligned}$$



**Fuel Switch Illustrative Example continued**

Savings would be claimed as follows: Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$14,462 - 17,956 + (2852/0.1)$ = 25,026 kWh for 1 <sup>st</sup> 8 years  $11,952 - 17,956 + (2688/0.1)$ = 20,876 kWh for remaining life	N/A
Electric and gas utility	14,462 kWh for 1 <sup>st</sup> 8 years  11,952 kWh for remaining life	$2,852 - (17,956 * 0.1)$ = 1056 therms for 1 <sup>st</sup> 8 years  $2,688 - (17,956 * 0.1)$ = 892 therms for remaining measure life
Gas utility only	N/A	$2,852 - (17,956 * 0.1) + (14,462 * 0.1)$ = 2503 therms for 1 <sup>st</sup> 8 years  $2,688 - (17,956 * 0.1) + (11,952 * 0.1)$ = 2088 therms for remaining measure life

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\text{Capacity}_{\text{Cool}} * (1/\text{EER}_{\text{base}} - 1/\text{EER}_{\text{GSHP}}))/1000 * \text{CF}$$

Where:

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
 = 91.3%<sup>792</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
 = 47.8%<sup>793</sup>

<sup>792</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>793</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**New Construction or Time of Sale:**

**For example**, a 10 ton closed loop unit with Full Load EER rating of 20:

$$\begin{aligned}\Delta kW_{SSP} &= (120,000 * (1/11 - 1/20))/1000 * 0.913 \\ &= 4.482kW\end{aligned}$$

$$\begin{aligned}\Delta kW_{PJM} &= (36,000 * (1/11 - 1/20))/1000 * 0.478 \\ &= 2.347kW\end{aligned}$$

**Early Replacement:**

**For example**, a 10 ton closed loop unit with Full Load 20 EER replaces an existing working Air Source Heat Pump with 8.2 EER:

$$\begin{aligned}\Delta kW_{SSP} \text{ for remaining life of existing unit (1st 8 years):} \\ &= (120,000 * (1/8.2 - 1/20))/1000 * 0.913 \\ &= 7.883 \text{ kW}\end{aligned}$$

$$\begin{aligned}\Delta kW_{SSP} \text{ for remaining measure life (next 17 years):} \\ &= (120,000 * (1/11 - 1/20))/1000 * 0.913 \\ &= 4.482kW\end{aligned}$$

$$\begin{aligned}\Delta kW_{PJM} \text{ for remaining life of existing unit (1st 8 years):} \\ &= (120,000 * (1/8.2 - 1/20))/1000 * 0.478 \\ &= 4.127 \text{ kW}\end{aligned}$$

$$\begin{aligned}\Delta kW_{PJM} \text{ for remaining measure life (next 17 years):} \\ &= (120,000 * (1/11 - 1/20))/1000 * 0.478 \\ &= 2.347kW\end{aligned}$$

**NATURAL GAS SAVINGS**

Calculation provided together with Electric Energy Savings above.

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING**

This measure can involve fuel switching from gas to electric.

For the purposes of forecasting load reductions due to fuel switch GSHP projects; changes in site energy use at the customer’s meter (using  $\Delta kWh$  algorithm below) adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, this will not match the output of the calculation/allocation methodology presented in the “Electric Energy Savings” and “Natural Gas Savings” sections above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the

remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure.

$$\begin{aligned} \Delta\text{Therms} &= [\text{Heating Consumption Replaced}] + [\text{DHW Savings if existing natural gas DHW}] \\ &= [(EFLH_{\text{heat}} * \text{Capacity}_{\text{Heat}} * 1 \text{ AFUE}_{\text{base}}) / 100,000] + [(1 - \text{ElecDHW}) * \% \text{DHW} * (1 / EF_{\text{GasBase}} * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 100,000] \\ \Delta\text{kWh} &= - [\text{GSHP heating consumption}] + [\text{Cooling savings}] + [\text{DHW savings if existing electric DHW}] \\ &= - [(EFLH_{\text{heat}} * \text{Capacity}_{\text{Heat}} * (1 / COP_{\text{GSHP}} * 3.412)) / 1000] + [(EFLH_{\text{cool}} * \text{Capacity}_{\text{Cool}} * (1 / EER_{\text{base}} - 1 / EER_{\text{GSHP}})) / 1000] + [\text{ElecDHW} * \% \text{DHW} * ((1 / EF_{\text{ELEC}} * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 3412)] \end{aligned}$$

**Illustrative Example of Cost Effectiveness Inputs for Fuel Switching:**

**For example**, a 10 ton unit with Part Load EER rating of 20 and Part Load COP of 4.4 in an Assisted living building in Chicago with a 100 gallon gas water heater replaces an existing working natural gas boiler with 75% efficiency and air-cooled chiller of 9.5 EER. [Note the calculation provides the annual savings for the first 8 years of the measure life, an additional calculation (not shown) would be required to calculate the annual savings for the remaining life (years 9-25)]:

$$\begin{aligned} \Delta\text{Therms} &= [(EFLH_{\text{heat}} * \text{Capacity}_{\text{Heat}} * 1 \text{ AFUE}_{\text{base}}) / 100,000] + [(1 - \text{ElecDHW}) * \% \text{DHW} * (1 / EF_{\text{GasBase}} * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 100,000] \\ &= [(120,000 * 1,646 * 1 / 0.75) / 100,000] + [(1 - 0) * 0.44 * (1 / 0.8 * (100 * 672) * 8.33 * (125 - 54) * 1) / 100,000] \\ &= 2,634 + 219 \\ &= 2,853 \text{ therms} \\ \Delta\text{kWh} &= - [(EFLH_{\text{heat}} * \text{Capacity}_{\text{Heat}} * (1 / COP_{\text{GSHP}} * 3.412)) / 1000] + [(EFLH_{\text{cool}} * \text{Capacity}_{\text{Cool}} * (1 / EER_{\text{base}} - 1 / EER_{\text{GSHP}})) / 1000] + [\text{ElecDHW} * \% \text{DHW} * ((1 / EF_{\text{ELEC}} * \text{HotWaterUse}_{\text{Gallon}} * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 3412)] \\ &= - [(1646 * 120000 * (1 / 4.4 * 3.412)) / 1000] + [(1457 * 120000 * (1 / 11 - 1 / 20)) / 1000] + [0 * (0.44 * ((1 / 0.9568) * (100 * 672) * 8.33 * (125 - 54) * 1 / 3412))] \\ &= -153,168 + 7153 + 0 \\ &= -146,015 \text{ kWh} \end{aligned}$$

**MEASURE CODE: CI-HVC-GSHP-V04-210101**

**REVIEW DEADLINE: 1/1/2022**

## 4.4.45 Adsorbent Air Cleaning

### DESCRIPTION

The Adsorbent Air Cleaning (AAC) measure installs modular adsorbent air cleaning devices ("AAC modules") into commercial forced air HVAC systems. These devices pass return air through adsorbent media which remove the gas-phase contaminants carbon dioxide and species of volatile organic compounds (VOCs) from the return air, allowing it to be recirculated rather than removed from the building as exhaust and replaced with ventilation air. This allows HVAC system operators to substantially reduce the amount of outside air brought in for ventilation while still maintaining acceptable indoor air quality, resulting in heating and cooling energy savings. An energy penalty is incurred due to the operation of fans integrated within the AAC modules, as well as from integrated electric heaters used in a regeneration cycle which purges the adsorbent media of contaminants to allow them to be used again. Net energy savings are calculated and are equal to the cooling and heating energy savings due to reduced outdoor air minus the energy required to operate the AAC modules.

This measure serves the market for medium to large commercial and institutional buildings.

This measure is currently applicable to the following program types: NC, RF, DI. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Efficient equipment is defined as a commercial HVAC system which has AAC modules installed in the return airstream, with the number of modules determined by appropriate sizing calculations. The modules allow for a substantial reduction in the volume of outside air introduced to the building compared to systems without AAC modules.

### DEFINITION OF BASELINE EQUIPMENT

Baseline equipment is a variable air volume HVAC system equipped with an integrated economizer and which does not have AAC modules installed. Heating is provided by either electricity, natural gas, or heat pump.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for HVAC applications is 20 years.<sup>794</sup>

### DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost below can be used, which is based on a cost per cfm of supply air flow rate.<sup>795</sup>

Unit	Material Cost / Unit (\$/cfm)	Labor Cost / Unit (\$/cfm)	Total Cost / Unit (\$/cfm)
Supply Air CFM	\$0.90	\$0.48	\$1.38

For example, the default deemed measure cost of installing the AAC measure in an HVAC system with a design supply air flow rate of 75,000 cfm is:

$$\text{Deemed Measure Cost (\$)} = 75,000 \text{ cfm} * \$1.38/\text{cfm} = \$103,500$$

### LOADSHAPE

For buildings with gas heat:

<sup>794</sup> Expected lifetime based on median years of axial fans and dampers from the ASHRAE Equipment Life Expectancy Chart.

<sup>795</sup> Default measure cost is based on sales information and labor cost estimates provided by a major Original Equipment Manufacturer (OEM) of AAC units. The OEM's estimates are based on prior installation experiences and case studies.

Loadshape C03 – Commercial Cooling

For buildings with electric heat:

Loadshape C05 – Commercial Electric Heating and Cooling

**COINCIDENCE FACTOR**

The coincidence factor is assumed to be the PJM Summer Peak Coincidence Factor for Commercial Cooling:

$$CF_{PJM} = 47.8\%^{796}$$

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

Savings associated with the Adsorbent Air Cleaning measure were derived from the results of a pilot study conducted in a commercial office building in Chicago during the 2019-2020 cooling and heating seasons. The building had a VAV system with economizer and electric heat. During the study, outdoor air rates were reduced according to the AAC module manufacturer's recommendations. Building cooling and heating loads associated with preconditioning outdoor air were continuously measured both with baseline and reduced outdoor air flow rates over a range of outdoor air temperatures and humidities. Statistical models were developed to predict energy and peak electric load savings as a function of outdoor air flow rate and outdoor air conditions. The models were then used to simulate energy use and peak load savings in other Illinois climate zones using TMY data.

In addition to monitoring cooling and heating energy, the pilot study also measured the electricity used to operate the AAC modules for the duration of the cooling and heating seasons. This energy penalty was subtracted from the cooling and heating load savings to calculate net savings.

**ELECTRIC ENERGY SAVINGS**

Identify the building's heating fuel. Electric energy savings will differ for buildings with natural gas, electric resistance, or electric heat pumps as a heating fuel.

For buildings with **natural gas** as a heating fuel, electric energy savings are:

$$\Delta kWh = \Delta V_{OA} * (NCLS / Cooling_{COP} - Annual Electric_{AAC})$$

For buildings with **electric resistance** as a heating fuel, electric energy savings are:

$$\Delta kWh = \Delta V_{OA} * (NCLS / Cooling_{COP} + NHLS - Annual Electric_{AAC})$$

For buildings with **electric heat pumps** as a heating fuel, electric energy savings are:

$$\Delta kWh = \Delta V_{OA} * (NCLS / Cooling_{COP} + NHLS / Heating_{COP} - Annual Electric_{AAC})$$

Where:

$\Delta V_{OA}$  = reduction in minimum outside air flow in scfm due to incorporating an AAC module

= if the rate is unknown, calculate using the following equation:

$$\Delta V_{OA} = V_{supply} * F_{OA} * F_R, \text{ where:}$$

<sup>796</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

- $V_{supply}$  = design or operational peak supply air flow rate of air handler in scfm
- $F_{OA}$  = operational minimum fraction of outside air in supply airflow before installing AAC modules
- $F_R$  = percentage reduction of outside air due to AAC modules  
= custom; if unknown, use 0.7 as a default<sup>797</sup>

NCLS (Normalized Cooling Load Savings)

=  $\Delta kWh/\Delta scfm$  savings value for the appropriate climate zone in the table below:

Normalized Cooling Load Savings (kWh/cfm)				
Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
17.9	18.6	24.2	26.5	23.6

NHLS (Normalized Heating Load Savings)

=  $\Delta kWh/\Delta scfm$  savings value for the appropriate climate zone and  $F_{OA}$  in the table below:

$F_{OA}$	Normalized Heating Load Savings (kWh/cfm)				
	Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
0.10	2.24	1.13	1.09	0.76	0.95
0.15	3.32	1.94	2.14	1.72	1.81
0.20	3.90	2.44	2.76	2.28	2.37
0.25	4.31	2.80	3.09	2.53	2.68
0.30	4.54	3.05	3.25	2.68	2.85

$Cooling_{COP}$  = seasonal average COP of building cooling plant. If unknown, use 4.0 as a default<sup>798</sup>

$Heating_{COP}$  = seasonal average COP of heat pump. If unknown, use 2.5 as a default<sup>799</sup>

Annual  $Electric_{AAC}$  = annual electricity consumed by AAC modules for the appropriate climate zone

AAC Electricity Consumption (kWh/cfm)				
Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
1.07	0.91	1.06	0.98	0.89

<sup>797</sup> The default value of 0.7 for  $F_R$  is based on a survey of previous case studies which documented the field installation of AAC modules in existing HVAC systems.

<sup>798</sup> The default cooling COP value of 4.0 is an approximation consistent with cooling analysis in the LEED rating system, and approximates a modern, moderate efficiency water-cooled chiller (COP = 6.0) with cooling tower and pump energy usage.

<sup>799</sup> The default heating COP value of 2.5 is an approximation representing an air-source heat pump of moderate efficiency.

**For example**, office building in Climate Zone 3 is equipped with a VAV system with electric heat and has a cooling plant COP of 4.0, a design supply air flow rate of 50,000 scfm and an outdoor air ventilation rate of 10,000 scfm. Installing AAC modules will allow reduction of the outdoor air ventilation rate by 70%. In this case:

$$V_{\text{supply}} = 50,000 \text{ scfm}$$

$$F_{\text{OA}} = 10,000 \text{ scfm} / 50,000 \text{ scfm} = 0.2$$

$$F_{\text{R}} = 0.7$$

$$\Delta V_{\text{OA}} = V_{\text{supply}} * F_{\text{OA}} * F_{\text{R}} = 50,000 \text{ scfm} * 0.2 * 0.7 = 7,000 \text{ scfm}$$

$$\text{Normalized Cooling Load Savings} = 24.2 \text{ kWh/scfm (Climate zone 3, } F_{\text{OA}} = 0.2)$$

$$\text{Cooling}_{\text{COP}} = 4.0$$

$$\text{Normalized Heating Load Savings} = 2.76 \text{ kWh/scfm (Climate zone 3, } F_{\text{OA}} = 0.2)$$

$$\text{Annual Electric}_{\text{AAC}} = 1.06 \text{ kWh/scfm (Climate zone 3)}$$

$$\begin{aligned} \Delta \text{kWh} &= \Delta V_{\text{OA}} * (\text{NCLS} / \text{Cooling}_{\text{COP}} + \text{NHLS} - \text{Annual Electric}_{\text{AAC}}) \\ &= 7,000 \text{ scfm} * (24.2 \text{ kWh/scfm} / 4.0 + 2.76 \text{ kWh/scfm} - 1.06 \text{ kWh/scfm}) \\ &= 54,250 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta \text{kW} = \Delta V_{\text{OA}} * (\text{Normalized Peak Cooling Load Savings} / \text{Cooling}_{\text{COP}}) * \text{CF}_{\text{PJM}}$$

Where:

$$\text{CF}_{\text{PJM}} = 0.478$$

Normalized Peak Cooling Load Savings

=  $\Delta \text{kW} / \Delta \text{scfm}$  savings value for the appropriate combination of building type, climate zone, and measure scenario, as detailed in the table below

Normalized Peak Cooling Load Savings (kW/cfm)				
Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
0.0259	0.0256	0.0296	0.0293	0.0283

### NATURAL GAS SAVINGS

Natural gas savings do not apply to buildings where electricity is the heating fuel. For buildings where natural gas is the heating fuel:

$$\Delta \text{therms} = \Delta V_{\text{OA}} * (\text{NHLS} / \eta) * 0.03412$$

Where:

$$\eta = \text{efficiency of gas heating equipment. If unknown, use 0.78 as default.}$$

$$0.03412 = \text{therms per kWh. Conversion factor to convert kWh to therms}$$

**MEASURE CODE: CI-HVC-ADAC-V03-210101**

**REVIEW DEADLINE: 1/1/2023**



## 4.4.46 Server Room Temperature Set back

### DESCRIPTION

This measure involves adjusting existing thermostats or building automation systems for reduced cooling energy consumption and fan energy consumption in server room and/or data center spaces. Existing set points should be documented through an audit or retro-commissioning study. A maximum temperature adjustment of 95°F will limit significant increase in server fan power consumption.

This measure was developed to be applicable to the following program types: RF, DI

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The criteria for this measure is established by optimizing the cooling temperature setpoint with a commercial thermostat or building automation system, up to a maximum of 95°F, which is adjusted to meet or approach ASHRAE recommended standards for data center cooling.

### DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is a commercial thermostat or building automation system that is currently controlling to cooling temperature setpoints that do not align with ASHRAE TC 9.9.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of a programmable thermostat is assumed to be 8 years.<sup>800</sup> For the purposes of claiming savings for an adjustment of an existing thermostat, this is reduced to a 50% persistence factor to give a final measure life of 4 years. It is recommended that this assumption be evaluated by future energy measurement and verification activities.

### DEEMED MEASURE COST

Actual labor costs should be used if the implementation method allows. If unknown the labor cost for this measure is assumed to be \$35.24 per thermostat,<sup>801</sup> as summarized in the following table.

Measure	Units	Materials	Labor	Total Cost (including O&P)	City Cost Index (Install Only)*	Total	Source
Adjust Temperature Set Points	4	\$0.00	\$5.95	\$6.55	134.5%	\$35.24	RS Means 2010 (pg 255, Section 23-09-8100)

\* Chicago, IL - Division 23

### LOADSHAPE

Loadshape C03 – Commercial Cooling

### COINCIDENCE FACTOR

Since the server room is cooled 8760 hours, the summer peak coincidence factor is assumed to be 100%.

<sup>800</sup> 8 years is based upon ASHRAE Applications (2003), Section 36, Table 3 estimate of 16 years for the equipment life, reduced by 50% to account for persistence issues.

<sup>801</sup> RSMears, "Instrumentation and Control for HVAC", Mechanical Cost Data, Kingston, MA: Reed Construction Data, 2010, pg. 255 & 632.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{Capacity} * (1/\text{EER}) * \text{EFLH} * \text{LF} * \% \text{Savings} * (T_{\text{after}} - T_{\text{before}})$$

Where:

- Capacity = Capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)  
= Actual
- EER = Energy efficiency ratio of the equipment  
= Actual
- EFLH = Equivalent full load hours for cooling  
= 8,760
- LF = Load Factor,  
= 65%<sup>802</sup>
- %Savings = Deemed percent savings  
= 4% per degree increase<sup>803</sup>
- T<sub>after</sub> = Space temperature setpoint after adjustment, maximum of 95°F  
= Actual
- T<sub>before</sub> = Space temperature setpoint before adjustment  
= Actual

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Capacity} * (1/\text{EER}) * \text{LF} * \% \text{Savings} * (T_{\text{after}} - T_{\text{before}}) * \text{CF}$$

Where:

- CF = Summer Peak Coincidence Factor for measure  
= 1.0

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

---

<sup>802</sup>ASHRAE Technical Support Document, 4.2.3.2 “Estimate the Average Computer Server Heat Load”, page 4-15.

<sup>803</sup>J. Brandon. “Going Green In The Data Center: Practical Steps For Your SME To Become More Environmentally Friendly. Processor”, 29, Sept. 2007.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-SRSB-V01-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4.47 Air Deflectors for Unit Ventilators – PROVISIONAL MEASURE

### DESCRIPTION

Unit ventilators (UVs) are the primary means of space conditioning found in schools, meeting rooms, offices, and other areas where local codes require controlled ventilation based on occupancy density. UVs are capable of heating, cooling, and ventilating a space using steam, hot water, electric heating, chilled water, or remote direct expansion cooling.

UVs have historically been placed next to perimeter exterior windows to serve as a draft stop while also conditioning and ventilating the space. As building envelopes become tighter and windows become better insulated, the draft stop function of UVs has diminished while their positioning under large windows exacerbates unwelcome space heating effects. Air delivered upward from UVs does not mix well with air in the room and creates air stratification. Warmer air stays near ceilings and cooler air stagnates near floors. Longer equipment runtimes are now required to satisfy thermostat setpoints resulting in wasted energy.

Installing supply air deflectors for unit ventilators (ADUVs) improve air mixing and reduce stratification issues for UVs resulting in improved comfort and lower energy consumption. This product is applicable for ChildCare/Pre-school, College/University, Elementary School, High School/Middle School, and Office – Low/Mid Rise with existing UVs.

In addition, deflectors should not be installed on unit on South facing walls as South-facing windows are known to have a higher solar gain, which naturally drives air convection in a room.

This measure was developed to be applicable to the following program types: RF, DI. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment consists of UVs on North, East or West facing walls with supply air deflectors mounted over existing unit ventilators utilizing an angled grille to direct airflow from the unit ventilator into the center of a room.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a UV located adjacent to exterior north, east, and west-facing perimeter windows with no existing technology to address air stratification installed. UVs located adjacent to south-facing perimeter windows are not eligible for this measure.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

While simple metal deflectors will last indefinitely, it is unknown whether they will remain effectively installed and/or transferred to new unit ventilators when they are replaced. The expected measure life is estimated at 20 years.

### DEEMED MEASURE COST

The measure cost for retrofit or direct installation on an existing unit ventilator is assumed to be the full cost for materials and labor and is estimated at \$250 per unit.<sup>804</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

<sup>804</sup> The estimated per unit costs based on anecdotal discussion with multiple potential manufacturers.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS<sup>805</sup>**

Annual natural gas savings for this measure are deemed at 55 therms/yr per UV unit.

The measured savings are extrapolated to other climate zones of Illinois. The savings are extrapolated based on HDD stipulated in Illinois TRM v7.0.

Climate Zone	HDD	Formula: Deemed Natural Gas Savings * (HDD/HDD <sub>Chicago</sub> )	Natural Gas Savings (therms/yr)
1 (Rockford)	4,272	55 * (4,272/4,029)	58
2 (Chicago)	4,029	55 * (4,029/4,029)	55
3 (Springfield)	3,406	55 * (3,406/4,029)	46
4 (Belleville)	2,515	55 * (2,515/4,029)	34
5 (Marion)	2,546	55 * (2,546/4,029)	35

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-ADUV-V01-200101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>805</sup> Hardik Shah and Feibi Yuan, "Project #1113: Air Deflector for Unit Ventilator (ADUV) Interim Pilot Assessment Public Report," Gas Technology Institute for Nicor Gas Company, Emerging Technology Program. October 29, 2018. The % savings was adjusted from 16.9% to 12% based on averaging the North orientation result, with two times the East (assuming East and West is comparable).

## 4.4.48 Small Commercial Thermostats – PROVISIONAL MEASURE

### DESCRIPTION

This measure characterizes the energy savings from the installation of either a Programmable or an advanced Thermostat to reduce heating and cooling consumption in a small commercial building.

The thermostat must be installed to control a single-zone HVAC system. This measure is limited to packaged HVAC units 5 tons or less. Systems larger will likely require more sophisticated controls to meet code requirements.

The savings associated with small commercial installations of thermostats had not been well evaluated at the time this measure was created for TRM Version 8.0. In the absence of assumptions specific to small commercial customers, the percent savings derived from Illinois Residential evaluations were used. This updated version (v9.0) adjusts the cooling savings percentage based on research conducted on small commercial programmable thermostat applications.<sup>806</sup> It is highly recommended that heating savings be revisited in a similar fashion as soon as is practicable, and that the application of Advanced Thermostats in small commercial settings be evaluated for future revisions.

Note that while these devices and service could potentially be used as part of a demand response program, the costs, delivery, impacts, and other aspects of DR-specific program delivery are not included in this characterization at this time, though they could be added in the future.

This measure was developed to be applicable to the following program types: TOS, RF, DI.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The criteria for this measure are established by replacement of a manual-only thermostat, with one that has the capability to establish a schedule of time and/or temperature setpoints.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is assumed to be a manual only thermostat.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 11 years.<sup>807</sup>

### DEEMED MEASURE COST

For DI and other programs for which installation services are provided, the actual material, labor, and other costs should be used. If unknown then the average incremental cost for the new installation measure is assumed to be \$175.

### LOADSHAPE

Loadshape C05 - Commercial Electric Heating and Cooling, or

Loadshape C03 - Commercial Cooling

---

<sup>806</sup> See "Small Commercial Thermostats Research," memorandum from Guidehouse to ComEd dated May 15, 2020.

<sup>807</sup> Based on 2017 Residential Smart Thermostat Workpaper, prepared by SCE and Nest for SCE (Work Paper SCE17HC054, Revision #0). Estimate ability of smart systems to continue providing savings after disconnection and conduct statistical survival analysis which yields 9.2-13.8 year range.

**COINCIDENCE FACTOR**

In the absence of conclusive results from empirical studies on peak savings, the TAC agreed to a temporary assumption of 50% of the cooling coincidence factor, acknowledging that while the savings from the Thermostat will track with the cooling load, the impact during peak periods may be lower. This is an assumption that could use future evaluation to improve these estimates.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)}$$

$$= 45.7^{808}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 23.9\%^{809}$$

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Heating savings are provided based upon the percentage savings from the Residential version of this measure. Cooling savings are based on research on small commercial programmable thermostat installations. Future research on heating savings percentages for small commercial applications, and heating and cooling savings percentages for Advanced Thermostat applications, should be used to improve this assumption.

$$\Delta kWh^{810} = \Delta kWh_{\text{heating}} + \Delta kWh_{\text{cooling}}$$

$$\Delta kWh_{\text{heating}} = (\text{kBtu/hr}_{\text{heat}} * 1/\text{HSPF} * \text{EFLH}_{\text{heat}} * \text{Heating\_Reduction}) + (\Delta \text{Therms} * F_e * 29.3)$$

$$\Delta kWh_{\text{cool}} = \text{kBtu/hr}_{\text{cool}} * 1/\text{SEER} * \text{EFLH}_{\text{cool}} * \text{Cooling\_Reduction}$$

Where:

- $\text{kBtu/hr}_{\text{heat}}$  = capacity of the heating equipment in kBtu per hour.  
= Actual
- $\text{HSPF}_{\text{base}}$  = Heating Seasonal Performance Factor of the baseline equipment  
= Actual, is unknown assume Code base
- $\text{EFLH}_{\text{heat}}$  = Heating mode equivalent full load hours in Existing Buildings are provided in section 4.4 HVAC End Use.
- $\text{Heating\_Reduction}$  = Assumed percentage reduction in total building heating energy consumption due to thermostat  
= 8.8%<sup>811</sup>

<sup>808</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year. Multiplied by 50%.

<sup>809</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year. Multiplied by 50%.

<sup>810</sup> Electrical savings are a function of both heating and cooling energy usage reductions. For heating this is a function of the percent of electric heat (heat pumps) and fan savings in the case of a natural gas furnace.

<sup>811</sup> Assumed equal to assumption for Residential Advanced Thermostats with manual thermostat baseline, before adding savings from Thermostat Optimization (which is not applicable to small commercial customers).

$\Delta$ Therms	= Therm savings if Natural Gas heating system = See calculation in Natural Gas section below
$F_e$	= Furnace Fan energy consumption as a percentage of annual fuel consumption = 3.14% <sup>812</sup>
29.3	= kWh per therm
kBtu/hr <sub>cool</sub>	= capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr) = Actual
SEER	= Seasonal Energy Efficiency Ratio of the cooling equipment = Actual, is unknown assume Code base
EFLH <sub>cool</sub>	= Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use.
Cooling_Reduction	= Average percentage reduction in total building cooling energy consumption due to installation of thermostat: = 17.7% <sup>813</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{kBtu/hr}_{\text{cool}} * 1/\text{EER} * \text{Cooling\_Reduction} * \text{CF}$$

Where:

EER = Energy Efficiency Ratio of the equipment  
= Actual, if unknown assume current Code. For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER to EER for calculation of peak savings:<sup>814</sup>

$$\text{EER} = (-0.02 * \text{SEER}^2) + (1.12 * \text{SEER})$$

Estimates of heating and cooling reduction factors are based on consumption data analyses with matching to non-participants and are therefore net with respect to participant spillover and between net and gross with respect to free ridership. Like all consumption data analyses, they are gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to these factors will be determined as part of the annual SAG net-to-gross process.

<sup>812</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBTU/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

<sup>813</sup> Based on research conducted by Guidehouse on a sample of IL Small Commercial programmable thermostat installations, which found a range of savings values depending on the modeling assumptions used. Guidehouse recommended selecting the midpoint of this range, which it deemed preferable to continuing to rely on Residential assumptions, while also accounting for the relative uncertainties involved. See “Small Commercial Thermostats Research” memo completed in 2020.

Estimates of heating and cooling reduction factors are based on consumption data analyses with matching to non-participants and are therefore net with respect to participant spillover and between net and gross with respect to free ridership. Like all consumption data analyses, they are gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to these factors will be determined as part of the annual SAG net-to-gross process.

<sup>814</sup> Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.



CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 45.7<sup>815</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 23.9%<sup>816</sup>

Other variables as provided above.

#### **NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = (\text{EFLH}_{\text{heat}} * \text{Capacity} * 1/\text{AFUE} * \text{Heating\_Reduction}) / 100,000\text{Btu/Therm}$$

Where:

Capacity = Nominal Heating Input Capacity (Btu/hr) of heating system  
= Actual

AFUE = Annual Fuel Utilization Efficiency Rating  
= Actual, if unknown assume code baseline.

Other variables as provided above.

#### **WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

#### **DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-THST-V02-210101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>815</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year. Multiplied by 50%.

<sup>816</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year. Multiplied by 50%.

### 4.4.49 Boiler Chemical Descaling

**DESCRIPTION**

The measure is for a non-residential hot water or steam boiler serving process loads or one that provides space heating. Even with careful and precise water treatment in a boiler system, mineral scales are formed over time due to the high pressure and heat. Boiler scale is typically calcium, carbon, iron and silica particle deposits that form on the boiler tubes. Scale creates a problem because it typically possesses a thermal conductivity, an order of magnitude less than the corresponding value for bare steel. Even thin layers of scale serve as an effective insulator and inhibit heat transfer. The result is overheating of boiler tube metal, tube failures, and loss of energy efficiency.

De-scaling a boiler system will improve boiler efficiency by removing mineral scale build up on boiler tubes. De-scaling is done either through mechanical or chemical cleaning techniques. There are several limitations to mechanical cleaning, namely firetube boilers cannot be mechanically cleaned. Depending on the size of the boiler, it can take up to a week to mechanically clean the tubes. This measure applies to chemical de-scaling, which is an efficient alternative, since it is not plagued by these limitations. The procedure typically involves the boiler being emptied and taken off-line, following which, the correct chemical solution ratio is pumped through the boiler system for four to eight hours.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

To qualify for this measure, the facility must, as applicable, complete the chemical de-scaling by an approved technician and be NSF/ANSI/CAN 60 compliant.<sup>817</sup>

The efficient equipment is a boiler system which has been de-scaled using a chemical solution. After the cleaning is complete, the personnel have to ensure that all safety checks are completed including checks for leaks. Lastly, any remains of the descaling chemical solution have to be eliminated from the tubes by flushing the system with water and a blowdown.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline condition is a boiler system that is compromised by scale build up.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The lifetime of this measure varies based on the location of the site in Illinois. It has been established that the rate of scale buildup in hydronic systems is directly dependent on the hardness of the supply water (the amount of dissolved Calcium, Magnesium and Iron).<sup>818</sup> Based on an analysis of water supply composition in Illinois,<sup>819</sup> the estimated life of measure(in years) before requiring de-scaling is listed below:

Climate Zone	Measure Life of De-scaling
Rockford	2

<sup>817</sup> NSF/ANSI/CAN 60 Standard: “If you manufacture, sell or distribute water treatment chemicals in North America, your products are required to comply with NSF/ANSI/CAN 60: Drinking Water Treatment Chemicals – Health Effects by most governmental agencies that regulate drinking water supplies.”

<sup>818</sup> ‘Study on Benefits of Removal of Water Hardness (Calcium and Magnesium Ions) from a Water Supply’, Battelle Memorial Institute, accessed April 2020.

<sup>819</sup> The Water Quality Reports from ‘Illinois American Water’ were analyzed for all five TRM zones in Illinois. Based on the water hardness level and Iron content, a correlation was made to the estimated usage of hydronic equipment before de-scaling is required. See page v of ‘Study on Benefits of Removal of Water Hardness (Calcium and Magnesium Ions) from a Water Supply’, Battelle Memorial Institute and “Water Quality Summary.xlsx” for reference.

Climate Zone	Measure Life of De-scaling
Chicago	6
Springfield	2
Belleville	3
Marion	3

**DEEMED MEASURE COST**

The cost of this measure is estimated to be \$378/MMBtu/hr per boiler.<sup>820</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = (\text{Capacity} * \text{EFLH} * \%Ei) / 100,000$$

Where:

Capacity = Nominal Heating Input Capacity Boiler Size (Btu/hr) for boiler unit  
 = Actual

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use. For process loads, use custom hours.

%Ei = Percent efficiency improvement from chemical descaling  
 = Dependent on system pressure and estimate of scale thickness. If unknown assume normal.<sup>821</sup>

---

<sup>820</sup> Averaged from quotes from two chemical de-scaling solution manufacturers. Quote based on one day service with two personnel, including circulating pumps, tank assembly and other necessary fittings. Quotes based on pilot project study done by Nicor Gas Emerging Technology Program and Gas Technology Institute (GTI), “Descaling of Steam Boiler Systems”, 2019-2020. A 20% RYDLYME solution is assumed for cost, based on the pilot.

<sup>821</sup> Estimates based on pilot project study done by Nicor Gas Emerging Technology Program and Gas Technology Institute (GTI), “Descaling of Steam Boiler Systems”, 2019-2020, and review of the following studies: ‘Clean Firetube Boiler Waterside Heat Transfer Surfaces’, U.S. Department of Energy, April 2012. ‘Energy Conservation Program Guide for Industry and Commerce’, NBS Handbook 115 Supplement 1, U.S. Department of Energy, December 1975, accessed April 2020.

Scale Thickness (inches)	Efficiency Improvement (%Ei)	
	Low Pressure (15psig and below) Applications	High Pressure (above 15psig) Applications
Low ( $\leq 1/64$ )	1%	1.6%
Normal ( $\geq 1/32$ & $\leq 3/64$ )	2.5%	3.9%
High ( $\geq 1/16$ )	3.9%	6.2%

100,000 = Converts Btu to Therms

**For example**, a 10,000 MBH firetube steam boiler in a Manufacturing facility in Rockford. The scaling on the tubes was estimated to be of 'normal' thickness and the steam supply was 'low pressure' at 15 psig.

$$\begin{aligned} \Delta\text{Therms} &= (\text{Capacity} * \text{EFLH} * \%Ei) / 100,000 \\ &= (10,000,000 * 1,048 * 0.025) / 100,000 \\ &= 2,620 \text{ Therms} \end{aligned}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-HVC-BCHD-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4.50 Electric Chillers with Integrated Variable Speed Drives

### DESCRIPTION

This measure relates to the installation of a new electric chiller(s) meeting the efficiency standards presented below. This measure could relate to new construction, or the installation of a new system in an existing building (i.e. time of sale). Multiple-chiller applications as specified by building type can be assessed with this methodology. The characterization is specifically designed for chillers equipped with magnetic bearings and with variable speed drives (VSDs).

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to exceed the efficiency requirements defined in the table below:

Type	Tons	Full Load kW/ton		Source
		Path A	Path B	
Screw	<75 tons	0.750	0.780	IECC 2018
Screw	75-150 tons	0.720	0.750	IECC 2018
Screw	150-300 tons	0.660	0.680	IECC 2018
Screw	300-600 tons	0.610	0.625	IECC 2018
Screw	>600 tons	0.560	0.585	IECC 2018
Scroll	<75 tons	0.750	0.780	IECC 2018
Scroll	75-150 tons	0.720	0.750	IECC 2018
Scroll	150-300 tons	0.660	0.680	IECC 2018
Scroll	300-600 tons	0.610	0.625	IECC 2018
Scroll	>600 tons	0.560	0.585	IECC 2018
Centrifugal	0-150 tons	0.610	0.695	IECC 2018
Centrifugal	150-300 tons	0.610	0.635	IECC 2018
Centrifugal	300-400 tons	0.560	0.595	IECC 2018
Centrifugal	400-600 tons	0.560	0.585	IECC 2018
Centrifugal	>600 tons	0.560	0.585	IECC 2018

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit (if unknown assume IECC 2018 provided above).

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>822</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is provided below.<sup>823</sup>

<sup>822</sup> As recommended in Navigant “ComEd Effective Useful Life Research Report”, May 2018. (EUL\_Summary\_10-1-08.xls)

<sup>823</sup> Based on chiller manufacturer provided data

Water-Cooled Centrifugal Chiller Incremental Costs (\$/Ton)			
Capacity (Tons)	Efficiency kW/ton		
	0.6	0.58	0.54
100	\$62	\$99	\$172
150	\$42	\$66	\$115
200	\$31	\$49	\$86
300	N/a	N/a	\$55
600	N/a	N/a	\$22

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

**COINCIDENCE FACTOR**

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
 = 91.3%<sup>824</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
 = 47.8%<sup>825</sup>

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

The measure uses run hours, chiller(s) size, baseline and proposed system efficiencies to calculate annual cooling savings in kWh and demand in kW. The tables with these values are included in the reference section of this measure. Run hours by building type and climate zone were calculated using EnergyPlus/OpenStudio models and the corresponding cooling loads were extracted. The cooling loads were extracted from the EnergyPlus/OpenStudio models based upon the DOE Prototype Buildings described in NREL’s “U.S. Department of Energy Commercial Reference Building Models of the National Building Stock” and a calibration log file that documents all of the variations made to each model to get them calibrated is provided in “ILCalibration-Log\_2019-08-27.xlsx”. These documents and all the models are available on the SharePoint site.

Run hours were calculated based on the sum of the cooling coil loads from the EnergyPlus/OpenStudio models and were reduced based on airside-economizer setpoints for the commercial buildings. These setpoints are referenced in Table 1. Run hours by climate zone and building type are found in Table 2.

System efficiencies were developed for each applicable building type. First, the baseline chiller efficiency was developed. Baseline chiller selection was based on chiller size for the associated DOE prototype building and was defined by the peak load and modeling guidelines. Table 3 summarizes these modeling guidelines. The chillers were designed with 1.15 capacity factor.<sup>826</sup> Baseline chiller types are identified for all five climate zones according to building type and can be found in Table 4.

Chilled water control strategies were also established for the energy models including condenser water reset and chilled water reset. The parameters for the reset strategies are found in Table 5 and Table 6. Chillers were staged on with the above referenced air-side economizer settings or were staged off if found to meet minimum thresholds for

---

<sup>824</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

<sup>825</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>826</sup> S. Goel, M. Rosenberg, C. Eley, "ANSI/ASHRAE/IES Standard 90.1-2016 Performance Rating Method Reference Manual," September 2017, page 3.222.

the baseline chiller technology. These minimum thresholds are found in Table 7. Condenser water temperature was determined using a 10°F cooling tower approach,<sup>827</sup> with a maximum temperature of 85°F.

For modeling purposes, the chillers were modeled meeting energy efficiency requirements of the IECC 2018. The magnetic bearing and VSD chiller efficiencies and part load data were provided by a chiller manufacturer. This data was used to develop the part load curves for the high efficiency magnetic bearing and VSD chillers.<sup>828</sup> DOE2.2 performance curves were used to model the baseline chiller part load performance.<sup>829</sup>

Chiller performance was calculated for all hours of cooling for each applicable building type.<sup>830</sup> An average performance for the entire year was calculated for the baseline systems as well as high efficiency chiller systems. High efficiency chillers were replaced individually to develop savings performance characteristics for buildings with mixed chillers of varying efficiency. The intent for the chiller performance curves is to indicate system performance for each modeled scenario. The maximum number of chillers represented in each model is the maximum number of chillers to be considered for the measure. Any system with more chillers than the reference building is not applicable to this characterization and measure savings would need to be verified. In addition, chillers over 1,000 tons would not be applicable to this characterization and measure savings would need to be verified. Chiller savings factors are listed in Table 8 and Table 9 for magnetic bearing and VSD chillers respectively.

It is important to note that this characterization includes multiple chiller system efficiencies. If only one chiller is replaced, the performance for the “Replace #1 Chiller” shall be considered. If two chillers are replaced “Replace Chiller #2” system efficiency shall be considered against the baseline, and so on. It is important to note that if the site has had chillers replaced with a magnetic bearing or VSD chillers in the past, the baseline chiller efficiency would be that of the number (#) of high efficiency chillers that were already replaced previous to the new installation. For instance, if the site had one VSD chiller in place, the baseline performance would be that of the “Replace Chiller #1” and not the “Baseline” performance. The characterization assumes that all high efficiency chillers are of the same, either magnetic bearing or VSD chillers. The characterization does have a maximum number of chillers that can be replaced, which varies per building type and climate zone. The maximum number of chillers modeled for each type are specified in Table 8 and Table 9. Any chiller plant(s) that contain additional chillers (not including backup chillers), would not be a part of this characterization. In addition, backup chillers are not considered a part of this characterization.

Chiller models for this characterization assumes equally sized chillers. For the purposes of this measure, equally sized chillers would be ideally characterized. If the chillers are of unequal size, the characterization would only apply if the larger of the chillers were replaced. For instance, if a plant had a 300 ton and 500 ton chiller and was only replacing one chiller, the characterization would only apply to the 500 ton chiller being replaced with a VSD or magnetic bearing chiller. If both chillers were replaced at the same time, the characterization would still apply. This characterization also assumes that the new efficient chiller(s) will be run as the base chiller(s) throughout the year.

## ELECTRIC ENERGY SAVINGS

Energy efficiency savings:

$$\Delta\text{kWH} = \text{Tons} * ((\text{Baseline System Efficiency}) - (\text{Proposed System Efficiency})) * \text{Run Hours}$$

Where:

<sup>827</sup> S. Goel, M. Rosenberg, C. Eley, "ANSI/ASHRAE/IES Standard 90.1-2016 Performance Rating Method Reference Manual," September 2017, page 3.231.

<sup>828</sup> Part load performance curves were designed using manufacturer provided data and techniques defined in K Gillespie and M Hydeman, “Tools and Techniques to Calibrate Electric Chiller Component Models.”

<sup>829</sup> Based on DOE2.2 Curves as provided by 2016 Nonresidential Alternative Calculation Method (ACM) Reference Manual, Appendix 5.7 Performance Curves. DOE2.2 path B screw chiller modeling curves were pulled directly from eQuest, as the chiller curves in the ACM were found to go negative at low loads for this specific chiller type. All curves specified are found in the resource document “VSD Chiller Modeling - IL TRM BLDG Types.xlsx.”

<sup>830</sup> All models are provided in the resource document “VSD Chiller Modeling - IL TRM BLDG Types.xlsx.”

- Tons = total system chiller nominal cooling capacity being replaced in tons (note: 1 ton is 12,000 Btu/hr)  
= Actual installed
- Baseline System Efficiency = efficiency of baseline system as found in Table 8 or Table 9 in Reference Tables section for the number of chillers being replaced
- Proposed System Efficiency = efficiency of proposed system as found in Table 8 or Table 9 in Reference Tables section for the number of chillers being replaced
- Run Hours = run hours for cooling as defined in Table 2 in Reference Tables section  
= Actual, if known

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Tons} * ((PE_{\text{base}}) - (PE_{\text{ee}})) * CF_{\text{SSP}}$$

$$\Delta kW = \text{Tons} * ((PE_{\text{base}}) - (PE_{\text{ee}})) * CF_{\text{PJM}}$$

Where:

- PE<sub>base</sub> = Peak efficiency of baseline equipment expressed as Full Load (kW/ton) from **Error! Reference source not found.**
- PE<sub>ee</sub> = Peak efficiency of high efficiency equipment expressed as Full Load (kW/ton)  
= Actual installed
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 91.3%
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 47.8%

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**REFERENCE TABLES**

**Table 1 – Air-Side Economizer Setpoints by Building Type<sup>831</sup>**

Building Type	Air-Side Economizer Temperature (F)*
College	55
Elementary School	55
Healthcare Clinic	55
High School	55

<sup>831</sup> Estimated values based on previous models



Building Type	Air-Side Economizer Temperature (F)*
Hospital CV	-
Hospital CV econ	55
Hospital FCU	-
Hospital VAV	55
Hotel	55
Office High Rise CAV	-
Office High Rise CAV econ	55
Office High Rise FCU	-
Office High Rise VAV	55
Office Mid Rise	55

**Table 2 – Run Hours by Building Type<sup>832</sup>**

Run Hours by Building Type	Z-1 (Rockford)	Z-2 (Chicago)	Z-3 (Springfield)	Z-4 (Belleville)	Z-5 (Marion)
College	2,581	2,749	3,135	3,106	3,263
Elementary School	2,354	2,465	2,822	2,811	2,918
Healthcare Clinic	3,650	3,932	4,506	4,390	4,667
High School	2,614	2,800	3,164	3,208	3,345
Hospital CV	8,710	8,760	8,760	8,760	8,760
Hospital CV econ	3,514	3,748	4,425	4,211	4,412
Hospital FCU	8,760	8,760	8,760	8,760	8,760
Hospital VAV	3,650	3,932	4,506	4,390	4,667
Hotel	3,652	3,935	4,502	4,389	4,663
Office High Rise CAV	7,773	7,847	7,855	7,861	7,761
Office High Rise CAV econ	3,640	3,914	4,473	4,354	4,667
Office High Rise FCU	5,283	5,342	5,652	5,671	5,737
Office High Rise VAV	2,391	2,543	2,840	2,840	2,967
Office Mid Rise	2,568	2,722	3,061	3,057	3,224

**Table 3 – Chiller Sizing Guidelines<sup>833</sup>**

Building Peak Cooling Load	Number and Type of Baseline Chillers for Mag Bearing Models*	Number and Type of Baseline Chillers for VSD Models**
<=300 tons	1 water-cooled screw chiller	1 water-cooled screw chiller
>300 tons, <500 tons	2 water-cooled screw chillers sized equally	2 water-cooled screw chillers sized equally
>500 tons, <600 tons	2 water-cooled centrifugal chillers minimum with chillers added so that no chiller is larger than 500 tons, all sized equally	2 water-cooled screw chillers sized equally
>600 tons	2 water-cooled centrifugal chillers minimum with chillers added so that no chiller is larger than 500 tons, all sized equally	2 water-cooled centrifugal chillers minimum with chillers added so that no chiller is larger than 800 tons, all sized equally

<sup>832</sup> Values from “VSD Chiller Modeling - IL TRM BLDG Types.xlsx”.

<sup>833</sup> \*Based on max chiller capacity as stated by vendor for magnetic bearing chillers, vendor stated that these chillers are not typically sized above ~450-500 tons; \*\* Values taken from ASHRAE 90.1-2016, page 286.

**Table 4 – Baseline Chiller Selection by Building Type and Climate Zone**

Baseline Chiller	Z-1 (Rockford)	Z-2 (Chicago)	Z-3 (Springfield)	Z-4 (Belleville)	Z-5 (Marion)
College	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Elementary School	Screw	Screw	Screw	Screw	Screw
Healthcare Clinic	Screw	Screw	Screw	Screw	Screw
High School	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Hospital CV	Screw	Screw	Screw	Screw	Screw
Hospital CV econ	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Hospital FCU	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Hospital VAV	Screw	Centrifugal	Screw	Screw	Centrifugal
Hotel	Screw	Screw	Screw	Screw	Screw
Office High Rise CAV	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Office High Rise CAV econ	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Office High Rise FCU	Screw	Screw	Screw	Screw	Screw
Office High Rise VAV	Screw	Screw	Screw	Screw	Screw
Office Mid Rise	Screw	Screw	Screw	Screw	Screw

**Table 5 – Entering Condenser Water Minimum Temperatures<sup>834</sup>**

Zone	City	Entering Condenser Water Minimum Temp (°F)*
Z1	Rockford	70
Z2	Chicago	70
Z3	Springfield	70
Z4	Belleville	75
Z5	Marion	75

**Table 6 – Chilled Water Reset Schedule<sup>835</sup>**

Chilled Water Reset Schedule (F)*	
Outside Air Temp (F)	Leaving Chilled Water Temp (F)
>=80	44 minimum
<=60	54 maximum

**Table 7 – Chiller Minimum Thresholds<sup>836</sup>**

Chiller Type	Minimum Compressor Load*
Reciprocating	25%
Screw	15%
Centrifugal <300	10%
Centrifugal 300-600	10%
Centrifugal >600	10%
Scroll	25%

<sup>834</sup> Value taken from ASHRAE 90.1-2016, page 286.

<sup>835</sup> Value taken from ASHRAE 90.1-2016, page 281.

<sup>836</sup> S. Goel, M. Rosenberg, C. Eley, "ANSI/ASHRAE/IES Standard 90.1-2016 Performance Rating Method Reference Manual," September 2017, page 3.224.

**Table 8 – Chiller System Performance Factors (Magnetic Bearing Chillers)<sup>837</sup>**

Zone	Building Type	System Performance Magnetic Bearing Chiller (kW/ton)				
		Baseline	Replace #1 Chiller	Replace #2 Chillers	Replace #3 Chillers	Replace #4 Chillers
Z1-Rockford	College	0.4668	0.3073	0.2795	0.2764	NA
Z1-Rockford	Elementary School	0.5898	0.3680	NA	NA	NA
Z1-Rockford	Healthcare Clinic	0.6727	0.4200	NA	NA	NA
Z1-Rockford	High School	0.4925	0.3414	0.3075	0.3005	0.2999
Z1-Rockford	Hospital CV	0.5064	0.2795	0.2539	NA	NA
Z1-Rockford	Hospital CV econ	0.4381	0.2598	0.2288	NA	NA
Z1-Rockford	Hospital FCU	0.3655	0.1997	0.1828	NA	NA
Z1-Rockford	Hospital VAV	0.5582	0.2766	0.2470	NA	NA
Z1-Rockford	Hotel	0.6929	0.3924	NA	NA	NA
Z1-Rockford	Office High Rise CAV	0.4373	0.3138	0.2680	0.2625	NA
Z1-Rockford	Office High Rise CAV econ	0.4754	0.3339	0.2958	NA	NA
Z1-Rockford	Office High Rise FCU	0.5912	0.3400	NA	NA	NA
Z1-Rockford	Office High Rise VAV	0.6188	0.3312	NA	NA	NA
Z1-Rockford	Office Mid Rise	0.6516	0.3382	NA	NA	NA
Z2-Chicago	College	0.4642	0.3372	0.3100	0.3069	NA
Z2-Chicago	Elementary School	0.5801	0.3647	NA	NA	NA
Z2-Chicago	Healthcare Clinic	0.6707	0.4233	NA	NA	NA
Z2-Chicago	High School	0.4850	0.3505	0.3182	0.3109	0.3101
Z2-Chicago	Hospital CV	0.5053	0.2815	0.2550	NA	NA
Z2-Chicago	Hospital CV econ	0.4381	0.2641	0.2326	NA	NA
Z2-Chicago	Hospital FCU	0.3682	0.2006	0.1832	NA	NA
Z2-Chicago	Hospital VAV	0.4315	0.2524	0.2358	NA	NA
Z2-Chicago	Hotel	0.6942	0.3908	NA	NA	NA
Z2-Chicago	Office High Rise CAV	0.4352	0.3122	0.2673	0.2611	NA
Z2-Chicago	Office High Rise CAV econ	0.4754	0.3289	0.2915	NA	NA
Z2-Chicago	Office High Rise FCU	0.5802	0.3360	NA	NA	NA
Z2-Chicago	Office High Rise VAV	0.6150	0.3282	NA	NA	NA
Z2-Chicago	Office Mid Rise	0.6427	0.3445	NA	NA	NA
Z3-Springfield	College	0.4778	0.3168	0.2750	0.2634	0.2629
Z3-Springfield	Elementary School	0.6099	0.3777	NA	NA	NA
Z3-Springfield	Healthcare Clinic	0.6920	0.4307	NA	NA	NA
Z3-Springfield	High School	0.5079	0.3678	0.3319	0.3209	0.3204
Z3-Springfield	Hospital CV	0.5246	0.2882	0.2546	NA	NA
Z3-Springfield	Hospital CV econ	0.4517	0.2707	0.2327	NA	NA
Z3-Springfield	Hospital FCU	0.3819	0.2092	0.1876	NA	NA
Z3-Springfield	Hospital VAV	0.5682	0.2865	0.2507	NA	NA
Z3-Springfield	Hotel	0.7148	0.3886	NA	NA	NA
Z3-Springfield	Office High Rise CAV	0.4565	0.3271	0.2782	0.2702	NA
Z3-Springfield	Office High Rise CAV econ	0.4952	0.3436	0.3056	NA	NA
Z3-Springfield	Office High Rise FCU	0.6011	0.3430	NA	NA	NA
Z3-Springfield	Office High Rise VAV	0.6304	0.3241	NA	NA	NA
Z3-Springfield	Office Mid Rise	0.6666	0.3494	NA	NA	NA
Z4-Belleville	College	0.5110	0.3859	0.3509	0.3460	NA
Z4-Belleville	Elementary School	0.6426	0.4149	NA	NA	NA
Z4-Belleville	Healthcare Clinic	0.7138	0.4427	NA	NA	NA
Z4-Belleville	High School	0.5331	0.4019	0.3620	0.3491	0.3468
Z4-Belleville	Hospital CV	0.5592	0.3323	0.2973	NA	NA
Z4-Belleville	Hospital CV econ	0.4632	0.2829	0.2410	NA	NA
Z4-Belleville	Hospital FCU	0.4105	0.2343	0.2121	NA	NA

<sup>837</sup> Values from “VSD Chiller Modeling - IL TRM BLDG Types.xlsb”.

Zone	Building Type	System Performance Magnetic Bearing Chiller (kW/ton)				
		Baseline	Replace #1 Chiller	Replace #2 Chillers	Replace #3 Chillers	Replace #4 Chillers
Z4-Belleville	Hospital VAV	0.5934	0.3110	0.2729	NA	NA
Z4-Belleville	Hotel	0.7332	0.4019	NA	NA	NA
Z4-Belleville	Office High Rise CAV	0.4836	0.3538	0.3069	0.2983	NA
Z4-Belleville	Office High Rise CAV econ	0.5045	0.3506	0.3111	NA	NA
Z4-Belleville	Office High Rise FCU	0.6353	0.3778	NA	NA	NA
Z4-Belleville	Office High Rise VAV	0.6496	0.3451	NA	NA	NA
Z4-Belleville	Office Mid Rise	0.6933	0.3933	NA	NA	NA
Z5-Marion	College	0.4960	0.3501	0.3087	0.2984	0.2973
Z5-Marion	Elementary School	0.6419	0.4262	NA	NA	NA
Z5-Marion	Healthcare Clinic	0.7134	0.4487	NA	NA	NA
Z5-Marion	High School	0.5369	0.4079	0.3707	0.3602	0.3585
Z5-Marion	Hospital CV	0.5585	0.3317	0.3006	NA	NA
Z5-Marion	Hospital CV econ	0.4646	0.2839	0.2457	NA	NA
Z5-Marion	Hospital FCU	0.4119	0.2339	0.2139	NA	NA
Z5-Marion	Hospital VAV	0.4689	0.2871	0.2648	NA	NA
Z5-Marion	Hotel	0.7396	0.3993	NA	NA	NA
Z5-Marion	Office High Rise CAV	0.4798	0.3461	0.3013	0.2931	NA
Z5-Marion	Office High Rise CAV econ	0.5096	0.3498	0.3074	NA	NA
Z5-Marion	Office High Rise FCU	0.6261	0.3764	NA	NA	NA
Z5-Marion	Office High Rise VAV	0.6481	0.3439	NA	NA	NA

**Table 9 – Chiller System Performance Factors (VSD chillers) <sup>838</sup>**

Zone	Building Type	System Performance VSD Chiller (kW/ton)			
		Baseline	Replace #1 Chiller	Replace #2 Chillers	Replace #3 Chillers
Z1-Rockford	College	0.5651	0.2714	0.2593	NA
Z1-Rockford	Elementary School	0.5898	0.2561	NA	NA
Z1-Rockford	Healthcare Clinic	0.6727	0.2733	NA	NA
Z1-Rockford	High School	0.6713	0.321	0.3091	NA
Z1-Rockford	Hospital CV	0.5064	0.1991	0.1709	NA
Z1-Rockford	Hospital CV econ	0.4381	0.2268	0.1937	NA
Z1-Rockford	Hospital FCU	0.3655	0.1619	0.1435	NA
Z1-Rockford	Hospital VAV	0.5582	0.2137	0.1812	NA
Z1-Rockford	Hotel	0.6929	0.2632	NA	NA
Z1-Rockford	Office High Rise CAV	0.4331	0.2399	0.2079	NA
Z1-Rockford	Office High Rise CAV econ	0.4754	0.269	0.2281	NA
Z1-Rockford	Office High Rise FCU	0.5912	0.241	NA	NA
Z1-Rockford	Office High Rise VAV	0.6188	0.243	NA	NA
Z1-Rockford	Office Mid Rise	0.6516	0.2274	NA	NA
Z2-Chicago	College	0.5702	0.2754	0.2618	NA
Z2-Chicago	Elementary School	0.5801	0.2514	NA	NA
Z2-Chicago	Healthcare Clinic	0.6707	0.2746	NA	NA
Z2-Chicago	High School	0.5109	0.2962	0.2689	0.2664
Z2-Chicago	Hospital CV	0.5053	0.2002	0.1711	NA
Z2-Chicago	Hospital CV econ	0.4381	0.2287	0.1954	NA
Z2-Chicago	Hospital FCU	0.3682	0.1633	0.1446	NA
Z2-Chicago	Hospital VAV	0.4315	0.2024	0.1851	NA
Z2-Chicago	Hotel	0.6942	0.2631	NA	NA
Z2-Chicago	Office High Rise CAV	0.4316	0.238	0.2072	NA
Z2-Chicago	Office High Rise CAV econ	0.4754	0.2678	0.2278	NA

<sup>838</sup> Values from “VSD Chiller Modeling - IL TRM BLDG Types.xlsx”.

Zone	Building Type	System Performance VSD Chiller (kW/ton)			
		Baseline	Replace #1 Chiller	Replace #2 Chillers	Replace #3 Chillers
Z2-Chicago	Office High Rise FCU	0.5802	0.2357	NA	NA
Z2-Chicago	Office High Rise VAV	0.615	0.2402	NA	NA
Z2-Chicago	Office Mid Rise	0.6427	0.2283	NA	NA
Z3-Springfield	College	0.5977	0.2882	0.2701	NA
Z3-Springfield	Elementary School	0.6099	0.2683	NA	NA
Z3-Springfield	Healthcare Clinic	0.692	0.2849	NA	NA
Z3-Springfield	High School	0.5316	0.3139	0.2836	0.2803
Z3-Springfield	Hospital CV	0.5246	0.2128	0.1763	NA
Z3-Springfield	Hospital CV econ	0.4517	0.2399	0.2004	NA
Z3-Springfield	Hospital FCU	0.3819	0.1742	0.1512	NA
Z3-Springfield	Hospital VAV	0.5682	0.2249	0.1861	NA
Z3-Springfield	Hotel	0.7148	0.2676	NA	NA
Z3-Springfield	Office High Rise CAV	0.4574	0.2583	0.2246	NA
Z3-Springfield	Office High Rise CAV econ	0.4952	0.2824	0.2423	NA
Z3-Springfield	Office High Rise FCU	0.6011	0.2466	NA	NA
Z3-Springfield	Office High Rise VAV	0.6304	0.2433	NA	NA
Z3-Springfield	Office Mid Rise	0.6666	0.2379	NA	NA
Z4-Belleville	College	0.6254	0.3142	0.2922	NA
Z4-Belleville	Elementary School	0.6426	0.2944	NA	NA
Z4-Belleville	Healthcare Clinic	0.7138	0.2956	NA	NA
Z4-Belleville	High School	0.5526	0.3382	0.3011	0.2951
Z4-Belleville	Hospital CV	0.5592	0.2386	0.2006	NA
Z4-Belleville	Hospital CV econ	0.4632	0.2509	0.2075	NA
Z4-Belleville	Hospital FCU	0.4105	0.1914	0.1679	NA
Z4-Belleville	Hospital VAV	0.5934	0.2422	0.2008	NA
Z4-Belleville	Hotel	0.7332	0.2787	NA	NA
Z4-Belleville	Office High Rise CAV	0.489	0.28	0.2477	NA
Z4-Belleville	Office High Rise CAV econ	0.5045	0.2899	0.248	NA
Z4-Belleville	Office High Rise FCU	0.6353	0.2711	NA	NA
Z4-Belleville	Office High Rise VAV	0.6496	0.2581	NA	NA
Z4-Belleville	Office Mid Rise	0.6933	0.2632	NA	NA
Z5-Marion	College	0.5129	0.292	0.2584	0.2547
Z5-Marion	Elementary School	0.6419	0.3003	NA	NA
Z5-Marion	Healthcare Clinic	0.7134	0.2987	NA	NA
Z5-Marion	High School	0.5581	0.3424	0.3098	0.3046
Z5-Marion	Hospital CV	0.5585	0.2355	0.2019	NA
Z5-Marion	Hospital CV econ	0.4646	0.2496	0.2102	NA
Z5-Marion	Hospital FCU	0.4119	0.1906	0.1696	NA
Z5-Marion	Hospital VAV	0.4689	0.2308	0.2078	NA
Z5-Marion	Hotel	0.7396	0.2793	NA	NA
Z5-Marion	Office High Rise CAV	0.485	0.2766	0.2457	NA
Z5-Marion	Office High Rise CAV econ	0.5096	0.2905	0.2457	NA
Z5-Marion	Office High Rise FCU	0.6261	0.2669	NA	NA
Z5-Marion	Office High Rise VAV	0.6481	0.2568	NA	NA

**MEASURE CODE: CI-HVC-CFVD-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4.51 Advanced Rooftop Controls with High Rotor Pole Switch Reluctance Motors

### DESCRIPTION

A High Rotor Pole Switch Reluctance Motor (HRSRM) is a type of brushless DC electric motor that runs by reluctance torque. Unlike other DC motor types, power is delivered to windings in the stator rather than the rotor. This simplifies the mechanical design; power does not need to be delivered to a moving part, but a switching system needs through software control and delivering power to the different windings. Electronic devices can precisely time switch, facilitating HRSRM configurations.

Combined in application with RTUs, the HRSRM motor is comparable or more efficient than an RTU equipped with a variable speed drive supply fan. It results in fan and cooling savings compared to a baseline scenario of constant-volume, constant-ventilation operation that is typical of single-zone, packaged HVAC units.

Fan energy savings come from the new integrated motor controls that allow for higher efficiency at varying loads. Cooling savings come from the effective use of variable speed or multi-stage cooling.

The markets that can be served by HRSRM motors are those which utilize RTUs, including but not limited to:

1. Fast-Service Restaurant
2. Full-Service Restaurant
3. Small Office
4. Stand-Alone Retail
5. Strip Mall
6. Warehouse

This measure was developed to be applicable to the following program types: NC, RF, EREP. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a single-zone, packaged HVAC unit with an existing functional integrated economizer that has been fitted with a HRSRM supply-fan and integrated speed control. This applies to both retrofit and new construction, and early replacement applications.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a single-zone, packaged HVAC unit (with an existing functional integrated economizer) that lacks demand-controlled ventilation controls and lacks supply-fan speed control via a variable-frequency drive.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years based on the HRSRM life.<sup>839</sup>

### DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost below can be used. Material cost is based on the horsepower (hp) of the supply fan used in the RTU. Retrofit represents the full cost of the installation. New construction and early replacement represent the incremental cost of the motor itself on a new unit.<sup>840</sup>

---

<sup>839</sup> Based on life cycle of a switch reluctance motor from P. Andrada, B. Blanque, E. Martinez, J.I. Perat, J.A. Sanchez, and M. Torrent, "Environmental and life cycle cost analysis of one switched reluctance motor drive and two inverter-fed induction motor drives," IET Electric Power Applications (2010): page 8.

<sup>840</sup> Based on cost data form Software Motor Company (SMC) on HRSRM motors, <https://softwaremotor.com/>.

**Deemed Measure Cost Details**

Type	HP	Material Cost	Labor Hours	Labor Rate	Deemed Cost
Retrofit	1	\$1,554.75	3	\$96.67	\$1,844.76
Retrofit	1.5	\$1,580.75	3	\$96.67	\$1,870.76
Retrofit	2	\$1,644.75	3	\$96.67	\$1,934.76
Retrofit	5	\$1,758.75	3	\$96.67	\$2,048.76
Retrofit	7.5	\$2,417.75	3	\$96.67	\$2,707.76
Retrofit	10	\$2,587.75	3	\$96.67	\$2,877.76
New Construction/Early Replacement	1	\$932.85	-	-	\$932.85
New Construction/Early Replacement	1.5	\$948.45	-	-	\$948.45
New Construction/Early Replacement	2	\$986.85	-	-	\$986.85
New Construction/Early Replacement	5	\$1,055.25	-	-	\$1,055.25
New Construction/Early Replacement	7.5	\$1,450.65	-	-	\$1,450.65
New Construction/Early Replacement	10	\$1,552.65	-	-	\$1,552.65

**LOADSHAPE**

Commercial ventilation C23

**COINCIDENCE FACTOR**

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)}$$

$$= 91.3\%^{841}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)}$$

$$= 47.8\%^{842}$$

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

Six different building types were selected for study. OpenStudio measures were used to generate ASHRAE 90.1-2013 code-compliant DOE prototype baseline models for each building type. The total conditioned area, the number of conditioned zones, and the peak cooling demand for each building are summarized in the following table.<sup>843</sup>

<sup>841</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>842</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

<sup>843</sup> Korbaga Woldekidan, Daniel Studer, and Ramin Faramarzi, "Performance Evaluation of Three RTU Energy Efficiency Technologies," 2019.

**Selected DOE Prototype Buildings**

Building Type	Small Office	Stand-Alone Retail	Warehouse	Strip Mall	Fast-Service Restaurant	Full-Service Restaurant
Conditioned Area (ft <sup>2</sup> )	5,502	24,692	52,045	22,500	2,501	5,502
Number of Conditioned Zones	5	4	3	10	2	2
Total Fan Break Horsepower (BHP)	3.5	25	5	23	7	11
Design Cooling Load (Ton)	8.5	65	13	69	20	33

In order to achieve savings, the RTU control options consist of following modes:

1. Ventilation Mode:
  - a. Outdoor air is at a minimum for building type
  - b. Fan speed set to 40%
  - c. Heating and cooling coils are off
2. Economizer Mode
  - a. Outdoor air rate was set from 40% and increased as needed to satisfy indoor air temperature
  - b. When outdoor air could no longer satisfy cooling, cooling mode was staged on
3. Mechanical Cooling Mode
  - a. Outdoor air is at a minimum for building type
  - b. Compressors (if multiple or variable) were staged/modulated to meet setpoint temperature of the space
  - c. Supply fan set to 100%
4. Heating mode
  - a. Outdoor air is at a minimum for building type
  - b. Heating coil staged as necessary
  - c. Supply fan set to 100%

The models produced a percentage energy savings based on using a HRSRM fan and varying compressor types. Retrofit savings include fan only. For new construction and early replacement, savings are based on compressor type and energy efficiency of the unit.

**ELECTRIC ENERGY SAVINGS**

For units with cooling capacities less than 65 kBtu/hr:

$$\Delta kWH = (kBtu/hr) * (1/ SEER_{exist}) * EFLH * ESF_{Cooling} + 0.746 * FanHP * RunHours * ESF_{Fan}$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

$$\Delta kWH = (kBtu/hr) * (1/IEER_{exist}) * EFLH * ESF_{Cooling} + 0.746 * FanHP * RunHours * ESF_{Fan}$$

Where:

kBtu/hr = capacity of the cooling equipment in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)

SEER<sub>exist</sub> = Seasonal Energy Efficiency Ratio of the existing equipment  
 = Actual, or assume Code base in place at the original time of existing unit installation. IECC 2018 provided below for referenced.

IEER<sub>exist</sub> = Integrated Energy Efficiency Ratio of the existing equipment



= Actual, or assume Code base in place at the original time of existing unit installation. IECC 2018 provided below for reference.

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in Illinois TRM version 8.0 section 4.4 HVAC End Use

ESF\_Cooling = Energy savings factor for cooling as found in **Error! Reference source not found.**<sup>844</sup>

ESF\_Fan = Energy savings factor for cooling as found in table below<sup>845</sup>

#### Energy Savings Factors

Energy Savings Type	Retrofit Type	HRSM on Single Stage Compressor	HRSM on Single Two Stage Compressor	HRSM on Variable Speed Compressor
ESF_Cooling	New Construction/Early Replacement	9.6%	8.1%	9.1%
ESF_Cooling	Supply Fan Retrofit Only	0.0%	0.0%	0.0%
ESF_Fan	New Construction/Early Replacement	38.1%	49.9%	53.0%
ESF_Fan	Supply Fan Retrofit Only	38.1%	49.9%	53.0%

FanHP = Horsepower of fan in RTU

= Actual

RunHours = Annual operating hours for fan motor based on building type

= Default hours are provided for HVAC applications which vary by HVAC application and building type.<sup>846</sup> When available, actual hours should be used.

Building Type	Total Fan Run Hours	Model Source
Assembly	7,235	eQuest
Assisted Living	8,760	eQuest
Auto Dealership	7,451	OpenStudio
College	4,836	OpenStudio
Convenience Store	7,004	eQuest
Drug Store	7,156	OpenStudio
Elementary School	3,765	OpenStudio
Emergency Services	8,760	OpenStudio
Garage	7,357	eQuest
Grocery	8,543	OpenStudio
Healthcare Clinic	4,314	OpenStudio
High School	3,460	OpenStudio
Manufacturing Facility	8,706	eQuest
MF - High Rise	8,760	OpenStudio
MF - Mid Rise	8,760	OpenStudio
Hotel/Motel - Guest	2,409	OpenStudio
Hotel/Motel - Common	8,683	OpenStudio
Movie Theater	7,505	eQuest

<sup>844</sup> Average cooling savings for all building types from paper entitled “Performance Evaluation of Three RTU Energy Efficiency Technologies.” Savings averaged by RTU compressor type.

<sup>845</sup> Average fan savings for all building types from paper entitled “Performance Evaluation of Three RTU Energy Efficiency Technologies.” Savings averaged by RTU compressor type.

<sup>846</sup> Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

Building Type	Total Fan Run Hours	Model Source
Office - Low Rise	6,345	OpenStudio
Office - Mid Rise	3,440	OpenStudio
Religious Building	7,380	eQuest
Restaurant	7,302	OpenStudio
Retail - Department Store	7,155	OpenStudio
Retail - Strip Mall	6,921	OpenStudio
Warehouse	6,832	OpenStudio
Unknown	6,241	n/a

**2018 IECC Minimum Efficiency Requirements**

TABLE C403.3.2(1)  
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE <sup>a</sup>
Air conditioners, air cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System	13.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall (air cooled)	≤ 30,000 Btu/h <sup>b</sup>	All	Split system	12.0 SEER	
			Single Package	12.0 SEER	
Small-duct high-velocity (air cooled)	< 65,000 Btu/h <sup>b</sup>	All	Split System	11.0 SEER	
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 12.8 IEER	AHRI 340/380
		All other	Split System and Single Package	11.0 EER 12.6 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.4 IEER	
		All other	Split System and Single Package	10.8 EER 12.2 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 11.6 IEER	
		All other	Split System and Single Package	9.8 EER 11.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 11.2 IEER	
		All other	Split System and Single Package	9.5 EER 11.0 IEER	
Air conditioners, water cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 13.9 IEER	AHRI 340/380
		All other	Split System and Single Package	11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.5 EER 13.9 IEER	
		All other	Split System and Single Package	12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.4 EER 13.6 IEER	
		All other	Split System and Single Package	12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.2 EER 13.5 IEER	
		All other	Split System and Single Package	12.0 EER 13.3 IEER	

Air conditioners, evaporatively cooled	< 65,000 Btu/h <sup>b</sup>	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 12.3 IEER	
		All other	Split System and Single Package	11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.0 EER 12.2 IEER	AHRI 340/360
		All other	Split System and Single Package	11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.9 EER 12.1 IEER	
		All other	Split System and Single Package	11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.7 EER 11.9 IEER	
All other		Split System and Single Package	11.5 EER 11.7 IEER		
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	

For SI: 1 British thermal unit per hour = 0.2931 W.

- a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.  
 b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = [(kBtu/hr) * (1/EER_{exist}) * ESF_{Cooling} + 0.746 * FanHP * ESF_{Fan}] * CF$$

Where:

- EER<sub>exist</sub> = Energy Efficiency Ratio of the existing equipment (assume the following conversion from SEER to EER for calculation of peak savings:  $EER = (-0.02 * SEER^2) + (1.12 * SEER)$ )  
 = Actual, or assume Code base in place at the original time of existing unit installation
- CFSSP = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
 = 91.3%
- CFPJM = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
 = 47.8%

### NATURAL GAS SAVINGS

N/A

### WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

**MEASURE CODE: CI-HVC-HSRM-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.4.52 Hydronic Heating Radiator Replacement

### DESCRIPTION

A hydronic heating radiator's capacity to evenly and consistently distribute heat throughout a space, utilizing piped hot-water or steam is often stymied by the buildup of mineral deposits and contaminants. Past research has shown that eliminating these deposits regularizes flow rate and boiler behavior, in effect restoring a radiator to a like-new condition.<sup>847</sup> A space is heated more effectively in this improved state and this condition furthermore reduces the need for continual (additionally wasteful) thermostat readjustment. A straightforward process to achieve this is to simply replace the fouled hydronic radiator pipe system with a new system equivalent to the replaced system's pre-fouled performance levels. This avoids any possible inconsistencies associated with a radiator-flushing procedure (e.g., less-than-expected savings, failure to return the pipe system to like-new condition, inability to treat a system due to its interlinking with separate domestic hot water systems, etc.) and furthermore ensures that expected savings are realized. This measure offers benefits during heating seasons for natural gas, is applicable to both residential and commercial applications, and considers hot water or steam as the source of thermal energy (seeing as both heat transfer mediums can theoretically act as the intermediary from which contaminants precipitate).

The calculations of savings presented in this section are furthermore normalized to apply to both commercial and multi-family residential applications and additionally consider the differences between the physical characteristics of hot water or steam (e.g., thermal resistance, temperature, convective heat transfer) when computing the savings tabulated in the 'Annual Normalized Gas Savings per Surface Area' table shown below.

This measure was developed to be applicable to the following program types: RF

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a new replacement hydronic radiator free of mineral deposit scaling and/or sludge which must reflect the capacity of the replaced system's pre-fouled performance levels (i.e., a "like-for-like" replacement).

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is the hydronic radiator being replaced, which has shown decreased performance due to a high degree of mineral deposit scaling and sludge buildup. The built-up scale inside the radiators is predominantly assumed to be Iron Oxide ( $\text{Fe}_3\text{O}_4$ ) and to have a thermal conductivity of 3.01 Btu/hr.ft.°F.<sup>848</sup>

A "standard scaled" radiator is assumed to be 10% clogged and a "heavily scaled" radiator is assumed to be 30% clogged. An implementation contractor will need to verify the baseline condition of the radiator, to classify it as either standard or heavily scaled. Measuring the surface temperature spread using an infrared temperature thermometer can be used to determine this; surface temperature spot readings below 180°F for a steam system and below 100°F for a hot water system can be labeled as 'standard scaling'. A "heavily scaled" radiator is assumed to one with surface temperature spots below 150°F for a steam system and below 90°F for a hot water system.<sup>849</sup> This should be verified by the implementation contractor by measuring the radiator surface temperature at multiple points when operating the boiler system at full load and when outdoor air temperatures are below 20°F. Implementer should strive to perform spot readings on at least 10% of total radiators. Based on the collected spot temperature readings, qualify the facility as either standard scaled or heavily scaled.

---

<sup>847</sup> Day, Paul and Balmer, Paul. "Independent Study Shows Sludge Build-up Significantly Affects Hydronic Heating System Performance," May, 2011. Accessed 03/25/20.

<sup>848</sup> The thermal properties of Iron Oxide are referenced from the following: Takeda, Mikako and Onishi, Takashi and Nakakubo, Shouhei and Fujimoto, Shinji. "Physical Properties of Iron-Oxide Scales on Si-Containing Steels at High Temperature," Materials Transactions Vol 50, No. 9 (2009): pp. 2242-2246. doi:10.2320/matertrans.M2009097.

<sup>849</sup> Assumptions based on typical operating hot water/steam supply temperatures for cast-iron radiators of 170°F and 220°F. 'Clogged' surface temperature assumptions based on temperatures below which performance of radiators starts dropping considerably.

The baseline for this measure are aging scaled radiators. Most facilities tend not to replace their old radiators and often tend to add a means of secondary heating. This measure is aimed at these facilities to incentivize the replacement of these old radiators.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

Hydronic radiator systems are extremely diverse, in size, scope or application, and in the materials utilized for the heat transfer surface. Cast iron, steel, and copper piping are common in radiators, as are polymer materials such as polyethylene (often seen in newer radiator systems). As such, an estimated useful life will naturally vary based on these circumstances and the quality of previous radiator maintenance. The estimated useful life of a typical hydronic radiator has been approximated to be 25 years.<sup>850</sup>

**DEEMED MEASURE COST**

The measure cost is the full cost of removing the existing unit and installing a new one. The actual program cost should be used. If unknown, assume \$61.35 per vertical column.<sup>851</sup> For more details on the definition of section of a radiator, the cited reference can be used.<sup>852</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

The annual natural gas savings per area for radiator replacement is calculated by determining the difference between the heat transfer from the replacement radiator and the radiator being replaced.

---

<sup>850</sup> Examples from the following source use “system design lives” of 20 and 25 years, and cite the service lifetimes of a cast iron hydronic radiator’s boiler to often be “30 years or more”.

Siegenthaler, John, Modern Hydronic Heating: For Residential and Light Commercial Buildings 3rd Edition, Delmar Cengage Learning, Clifton Park, New York, 2012.

There is limited information available on system lifetimes of hydronic radiators, as well-built and well-maintained systems tend to last for decades. We assume that a midpoint of the “design-lives” cited above (25) can correspond to the time a hydronic radiator system begins to underperform, with one known reason for underperformance (which also happens to be the focus of this measure) being the corrosion of piping materials and/or the presence of precipitated mineral contaminates restricting flow rate and thus hindering heat transfer.

<sup>851</sup> Average calculated from RSMMeans Cost Data 2020 for Hydronic Heating Radiators, Cast Iron.

<sup>852</sup> Express Radiant, “Calculating Radiator Output”, 2014. This reference shows a representation of how a section of a typical radiator is defined.

$$\Delta Therms = \frac{[Q_{New} - Q_{Base}] * EFLH}{(100,000 * \eta)}$$

$$Q_{Base} = \frac{(A * \Delta T)}{R_{Base}}$$

$$R_{Base} = R_{conv1} + R_{cond} + \left( \frac{R_{rad} * R_{conv2}}{R_{rad} + R_{conv2}} \right)$$

$$Q_{New} = \frac{(A * \Delta T)}{R_{New}}$$

The thermal resistance components remain the same as the above ( $R_{Base}$ ), with the exception of the contaminate oxide layer which is no longer present in the post-case:

$$R_{New} = R_{conv1} + \left( \frac{R_{rad} * R_{conv2}}{R_{rad} + R_{conv2}} \right)$$

Where:

- $Q_{New}$  (Btu/hr) = The heat emission from the replacement hydronic heating system
- $Q_{Base}$  (Btu/hr) = The heat emission from the hydronic heating system being replaced
- $EFLH$  = Effective full load hours based on the climate zone (see **Error! Reference s**  
**ource not found.**)

**Heating Season Recirculation Hours**

Climate Zone	Hours
1 - Rockford	5,039
2 - Chicago	4,963
3 - Springfield	4,495
4 - Belleville	4,021
5 - Marion	4,150

- $\eta$  = Actual Thermal Efficiency of the Heating Equipment (if unknown, use 81.9% for water boilers<sup>853</sup> and 80.7% for steam boilers<sup>854</sup>)
- 100,000 = conversion factor (1 Therm = 100,000 Btu)
- $A$  (ft<sup>2</sup>) = the effective area of heat transfer of the radiator<sup>855</sup>
- $\Delta T$  (°F) = the temperature difference between the supply fluid temperature and the conditioned room design temperature
- $R_{Base}$  (ft<sup>2</sup> °F hr/ BTU) = the overall thermal resistance of the system before replacement
- $R_{New}$  (ft<sup>2</sup> °F hr/ BTU) = the overall thermal resistance of the system after replacement

<sup>853</sup> Assumptions as per IL TRM which references CEC for these values.

<sup>854</sup> Assumptions as per IL TRM which references CEC for these values.

<sup>855</sup> The pipe diameter is assumed to be 2 inches and the thickness of mineral deposits in a fouled radiator (which, recall, are assumed to be composed of iron oxide), is a function of the percent of the pipe diameter which is clogged and the assumed pipe diameter.

$R_{conv1}$  (ft<sup>2</sup> °F hr/ BTU) = the thermal resistance of convection between the hot water/steam and the radiator<sup>856</sup>

$R_{cond}$  (ft<sup>2</sup> °F hr/ BTU) = the thermal resistance of conduction in the oxide layer buildup<sup>857</sup>

$R_{rad}$  (ft<sup>2</sup> °F hr/ BTU) = the thermal resistance of radiation between the radiator and the conditioned space<sup>858</sup>

$R_{conv2}$  (ft<sup>2</sup> °F hr/ BTU) = the thermal resistance of convection between radiator and the conditioned space<sup>859</sup>

**Annual Normalized Gas Savings per Surface Area (therms/ft<sup>2</sup>)**

HVAC System Type		1 - Rockford	2 - Chicago	3 - Springfield	4 - Belleville	5 - Marion
Hot Water Radiator	Standard Scaling	0.115	0.113	0.102	0.091	0.094
	Heavy Scaling	0.337	0.332	0.301	0.269	0.278
Steam Radiator	Standard Scaling	0.170	0.168	0.152	0.136	0.140
	Heavy Scaling	0.501	0.493	0.447	0.400	0.413

$$\Delta Therms = HS_{cz} * Area_{radiator}$$

Where:

$HS_{cz}$  = Annual heating savings per area of radiator by climate zone, values from 'Annual Normalized Gas Savings per Surface Area' table above.

$Area_{radiator}$  = Total surface area of radiator (ft<sup>2</sup>)

Example:

**For example**, a building in Climate Zone 1 is equipped with a heavily scaled steam radiator system. The surface area of the replacement and radiator being replaced was calculated to be 85 ft<sup>2</sup>.

$\Delta Therms$  = Annual Normalized Gas Savings (therms/sq.ft.) \* Surface Area (sq.ft.)

= 0.501 \* 85

= 42.59 therms annually

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>856</sup> For a steam system, the supply temperature is assumed to be 220°F. For a hot water system, the supply temperature is assumed to be 170°F. This implies convective heat transfer coefficients of 1,100 Btu/hr.ft<sup>2</sup>.°F and 700 Btu/hr.ft<sup>2</sup>.°F for steam and hot water, respectively, the inverses of which equate to steam's or hot water's thermal resistances.

<sup>857</sup> Recall that iron oxide has a thermal conductivity of 3.01 Btu/hr.ft<sup>2</sup>.°F.

<sup>858</sup> Stefan-Boltzmann constant is assumed to be 1.714×10<sup>-9</sup> BTU·hr<sup>-1</sup>.ft<sup>-2</sup>.°R<sup>-4</sup>.

<sup>859</sup> The convective heat transfer coefficient of Air is assumed to be 1.844 Btu/hr.ft<sup>2</sup>.°F. Emissivity of radiator surface is assumed to be 0.6.



**MEASURE CODE: CI-HVC-HHRR-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

## 4.5 Lighting End Use

The commercial lighting measures use a standard set of variables for hours of use, waste heat factors, coincident factors and HVAC interaction effects. This table has been developed based on information provided by the various stakeholders. For ease of review, the table is included here and referenced in each measure.

The building characteristics of the eQuest models can be found in the reference table named “EFLH Building Descriptions Updated 2014-11-21.xlsx”. The OpenStudio models are based upon the DOE Prototypes described in NREL’s “U.S. Department of Energy Commercial Reference Building Models of the National Building Stock” and a calibration log file that documents all of the variations made to each model to get them calibrated is provided in “IL-Calibration-Log\_2019-08-27.xlsx”. Documents and all models are all available on the SharePoint site.

Note where a measure installation is within a building or application that does not fit with any of the defined building types below, the user should apply custom assumptions where it is reasonable to estimate them, else the building of best fit should be utilized.

Building/Space Type	Fixture Annual Operating Hours <sup>860</sup>	Screw based bulb Annual Operating hours <sup>861</sup>	Waste Heat Cooling Energy WHFe <sup>862</sup>	Waste Heat Cooling Demand WHFd	Coincidence Factor CF <sup>863</sup>	Waste Heat Gas Heating IFTherms <sup>864</sup>	Waste Heat Electric Resistance Heating IFkWh <sup>865</sup>	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Agriculture – Chicken Broilers <sup>866</sup>	3,251	3,251	1.00	1.00	0.76	0.000	0.000	0.000	n/a
Agriculture – Chicken Breeders	4,606	4,606	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Chicken Layers	4,914	4,914	1.00	1.00	0.95	0.000	0.000	0.000	n/a

<sup>860</sup>Fixtures hours of use are based upon schedule assumptions used in the eQuest models, except for those building types where Illinois based metering results provide a statistically valid estimate (currently: College, Elementary School, High School, Manufacturing, Low and Mid rise Office, Retail Department Store and Warehouse) or Grocery which is based on logging survey at 28 grocery stores in a Massachusetts DNV-GL “Lighting Hours of Use Study” report, April 12,2019. Miscellaneous is a weighted average of indoor spaces using the relative area of each building type in the region (CBECS).

<sup>861</sup> Hours of use for screw based bulbs are derived from DEER 2008 by building type for cfls. Garage, exterior and multi-family common area values are from the Hours of Use Table in this document. Miscellaneous is an average of interior space values. Some building types are averaged when DEER has two values: these include office, restaurant and retail. Healthcare clinic uses the hospital value.

<sup>862</sup> The Waste Heat Factor for Energy and is developed using eQuest models for various building types base on Chicago Illinois (closest to statewide average HDD and CDD). Exterior and garage values are 1, unknown is a weighted average of the other building types.

<sup>863</sup>Coincident diversity factors are based on either combined IL evaluation results (College, Elementary School, High School, Manufacturing, Low and Mid rise Office, Retail Department Store and Warehouse), case lighting projects performed over several years by Michaels Energy in Illinois and other jurisdictions (Refrigerated and Freezer Cases), or based upon schedules defined in the eQuest models described (all others).

<sup>864</sup> IFkWh Resistance value is developed using eQuest or OpenStudio models consistent with methodology for Waste Heat Factor for Energy.

<sup>865</sup> Heat penalty assumptions are based on converting the IFkWh Resistance multiplier value in to IFtherms or IF kWhHeat Pump by applying relative heating system efficiencies. The gas efficiency was assumed to be 80% AFUE and the electric resistance is assumed to be 100%, for Heat Pump is assumed to be 2.3COP.

<sup>866</sup> Agriculture lighting loadshapes, operational hours, and HVAC interactive factors were developed based on field experience and research material for the general agriculture, indoor agriculture, poultry and dairy commodities. Please see the excel files, ‘General Agriculture Loadshape’ and ‘Indoor Agriculture Lighting Loadshape’ on the 8760-calculation approach and for more detail. Due to livestock housing having little to no mechanical cooling systems, waste heat cooling and associated demand factors were assumed to be 1.00.

Building/Space Type	Fixture Annual Operating Hours <sup>860</sup>	Screw based bulb Annual Operating hours <sup>861</sup>	Waste Heat Cooling Energy WHFe <sup>862</sup>	Waste Heat Cooling Demand WHFd	Coincidence Factor CF <sup>863</sup>	Waste Heat Gas Heating IFTherms <sup>864</sup>	Waste Heat Electric Resistance Heating IFkWh <sup>865</sup>	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Agriculture – Turkey Hens	2,231	2,231	1.00	1.00	0.76	0.000	0.000	0.000	n/a
Agriculture – Turkey Toms	5,351	5,351	1.00	1.00	0.95	0.000	0.000	0.000	na
Agriculture – Turkey Breeder Hens	4,396	4,396	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Turkey Breeder Toms	5,446	5,446	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Dairy Long Day Lighting	6,205	6,205	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Assisted Living	7,862	5,950	1.14	1.30	0.66	0.035	0.823	0.358	eQuest
Auto Dealership	4,099	2,935	1.16	1.24	0.97	0.013	0.315	0.137	OpenStudio
Childcare/Pre-School	2,860	2,860	1.17	1.29	0.72	0.018	0.420	0.183	eQuest
College	3,395	2,588	1.02	1.54	0.63	0.023	0.548	0.238	OpenStudio
Convenience Store	4,672	3,650	1.09	1.26	0.76	0.035	0.828	0.360	eQuest
Drug Store	4,093	2,935	1.05	1.34	1.00	0.017	0.394	0.171	OpenStudio
Elementary School	3,038	2,118	1.04	1.51	0.65	0.019	0.455	0.198	OpenStudio
Emergency Services	2,698	3,088	1.06	1.09	0.65	0.001	0.014	0.006	OpenStudio
Garage	3,401	3,540	1.00	1.00	0.92	0.000	0.000	0.000	eQuest
Garage, 24/7 lighting	8,766	8,766	1.00	1.00	1.00	0.000	0.000	0.000	eQuest
Grocery	5,468	3,650	1.05	1.22	0.82	0.010	0.230	0.100	OpenStudio
Healthcare Clinic	3,890	4,207	1.14	1.04	0.67	0.020	0.463	0.201	OpenStudio
High School	3,038	2,327	1.15	1.40	0.65	0.011	0.249	0.108	OpenStudio
Hospital - CAV no econ	7,616	4,207	1.17	1.32	0.56	0.009	0.211	0.092	OpenStudio
Hospital - CAV econ	7,616	4,207	1.14	1.27	0.56	0.009	0.205	0.089	OpenStudio
Hospital - VAV econ	7,616	4,207	1.13	1.35	0.56	0.006	0.148	0.064	OpenStudio
Hospital - FCU	7,616	4,207	1.16	1.42	0.56	0.000	0.000	0.000	OpenStudio
Manufacturing Facility	4,618	2,629	1.02	1.04	0.81	0.012	0.270	0.117	eQuest
MF - High Rise - Common	6,138	5,950	1.20	1.24	0.90	0.005	0.109	0.047	OpenStudio
MF - Mid Rise - Common	5,216	5,950	1.11	1.16	0.62	0.021	0.484	0.211	OpenStudio
Hotel/Motel - Guest	2,390	777	1.17	1.21	0.46	0.020	0.468	0.204	OpenStudio
Hotel/Motel - Common	6,138	4,542	1.09	1.26	0.85	0.017	0.406	0.176	OpenStudio
Movie Theater	3,506	5,475	1.11	1.38	0.53	0.029	0.673	0.293	eQuest
Office - High Rise - CAV no econ	2,886	3,088	1.22	1.30	0.60	0.006	0.149	0.065	OpenStudio
Office - High Rise - CAV econ	2,886	3,088	1.00	1.07	0.57	0.039	0.905	0.394	eQuest
Office - High Rise - VAV econ	2,886	3,088	1.06	1.65	0.60	0.015	0.345	0.150	OpenStudio

Building/Space Type	Fixture Annual Operating Hours <sup>860</sup>	Screw based bulb Annual Operating hours <sup>861</sup>	Waste Heat Cooling Energy WHFe <sup>862</sup>	Waste Heat Cooling Demand WHFd	Coincidence Factor CF <sup>863</sup>	Waste Heat Gas Heating IFTherms <sup>864</sup>	Waste Heat Electric Resistance Heating IFkWh <sup>865</sup>	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Office - High Rise - FCU	2,886	3,088	1.21	1.17	0.60	0.007	0.153	0.067	OpenStudio
Office - Low Rise	2,698	3,088	1.10	1.26	0.52	0.010	0.231	0.100	OpenStudio
Office - Mid Rise	3,266	3,088	1.10	1.36	0.60	0.016	0.378	0.164	OpenStudio
Religious Building	2,085	1,664	1.12	1.37	0.48	0.015	0.356	0.155	eQuest
Restaurant	5,571	4,784	1.08	1.10	1.00	0.009	0.208	0.090	OpenStudio
Retail - Department Store	4,099	2,935	1.06	1.06	0.94	0.015	0.346	0.150	OpenStudio
Retail - Strip Mall	4,093	2,935	1.12	1.29	0.71	0.019	0.450	0.196	eQuest
Warehouse	3,135	4,293	1.02	1.17	0.85	0.016	0.378	0.164	OpenStudio
Unknown	3,379	3,612	1.08	1.30	0.67	0.015	0.354	0.154	n/a
Exterior – dusk to dawn <sup>867</sup>	4,303	4,303	1.00	1.00	0.00	0.000	0.000	0.000	n/a
Exterior – dusk to business close	See calculation below		1.00	1.00	0.00	0.000	0.000	0.000	n/a
Low-Use Small Business	2,954	2,954	1.31	1.53	0.66	0.023	0.524	0.262	n/a
Uncooled Building	Varies	varies	1.00	1.00	0.66	0.014	0.320	0.160	n/a
Refrigerated Cases	5,802	n/a	1.29 <sup>868</sup>	1.29	1.00	0.000	0.000	0.000	n/a
Freezer Cases	5,802	n/a	1.50 <sup>869</sup>	1.5	1.00	0.000	0.000	0.000	n/a

**Annual Operating Hours – Spaces with Lighting Controls**

For spaces where occupancy or daylight sensors are known to be already installed, the user should adjust the Annual Operating Hours using the formula below. For v9.0, the TAC agreed that if current state is unknown by the implementer, then subsequent evaluation should assume the space does not have lighting controls. Over 2021 program year, this should be evaluated and the TAC will determine if a different unknown assumption should be used from V10 on.

<sup>867</sup> Based on Navigant verified value using 2014 Astronomical Applications Department, U.S. Naval Observatory data for ComEd’s service territory. See Navigant Memorandum ‘RE: LED Street Lighting Program Hours of Use for the ComEd and DCEO Programs. June 21, 2017’.

<sup>868</sup> For closed refrigerated case lighting (open cases should use building type WHF), the value is 1.29 (calculated as  $(1 + (1.0 / 3.5))$ ). Based on the assumption that all lighting in refrigerated cases is mechanically cooled, with a typical 3.5 COP refrigeration system efficiency, and assuming 100% of lighting heat needs to be mechanically cooled at time of summer peak. Assumes 3.5 COP for medium temp cases based on the average of standard reciprocating and discus compressor efficiencies with Saturated Suction Temperatures of 20°F and a condensing temperature of 90°F.

<sup>869</sup> For closed freezer case lighting (open cases should use building type WHF), the value is 1.50 (calculated as  $(1 + (1.0 / 2.0))$ ). Based on the assumption that all lighting in freezer cases is mechanically cooled, with a typical 2.0 COP freezer system efficiency, and assuming 100% of lighting needs to be mechanically cooled at time of summer peak. Assumes 2.0 COP for low temp cases based on the average of standard reciprocating and discus compressor efficiencies with Saturated Suction Temperatures of -20°F and a condensing temperature of 90°F.

$$\text{Sensor Controlled Hours} = \text{Annual Operating Hours} * (1 - \text{ESF})$$

Where:

Annual Operating Hours = Average hours of use per year for specific space type, provided in the Reference Table above.

ESF = Energy Savings factor (represents the percentage reduction to the operating Hours from the non-controlled baseline lighting system),

Table from Measure 4.5.10 Lighting Controls:

Lighting Control Type	Energy Savings Factor <sup>870</sup>
Fixture Measurement of Control savings through Networked Trending	Custom
Interior Occupancy Sensor (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	24% 34% with High End Trim
Interior Occupancy Sensor configured as "Vacancy Sensor" (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	31% 41% with High End Trim
Interior Daylight Sensor (Wall, Fixture or Remote Mounted)	28% 38% with High End Trim
Interior Dual Occupancy & Daylight Sensor (Integrated of Fixture Mounted)	38% 48% with High End Trim
Interior Luminaire-Level Lighting Controls	50%
Refrigerated Case Occupancy Sensor – Freezer and Cooler	27%
Exterior Occupancy Sensor	41%
No Lighting Control	0%

Note, if a program is installing lighting fixtures *and* controls, the interactive effect should be accounted for by either assuming:

- Fixture watt savings for full annual operating hours, control savings on efficient fixture
- Or
- Control savings on baseline fixture, fixture watt savings for "sensor controlled hours".

**Exterior Lighting Hours – dusk to business close**

<sup>870</sup> Interior controls % savings based except where noted on LBNL, Williams et al, "Lighting Controls in Commercial Buildings", 2012, p172. ESF for Vacancy Sensors is based on Papamichael, Konstantions, Bi-Level Switching in Office Spaces, California Lighting Technology Center, February 1,2010. See Figure 8 on page 10 for relevant study results. The study shows a 30% extra savings above a typical occupancy sensor; 24% \* 1.3 = 31%.

ESF for Luminaire Level Lighting Controls, and 10% High End Trim adder are based upon review of:

- Pacific Northwest National Laboratory, "Evaluation of Advanced Lighting Control Systems in a Working Office Environment", November 2018.
- Schuetter et al., "Cree SmartCast Lighting Retrofit Demonstration: LED Fixtures and Controls for Advanced Holistic Lighting Solutions", September 2020 (expected).
- DesignLights Consortium and NEEA, "Energy Savings from Networked Lighting Control and Luminaire-level Lighting Control Systems: 2020 Update", 2020 (expected).

Refrigerated Case occupancy sensors ESF is based on percentage of operating hours spent in low-power operation during vacant periods, found in SDG&E workpaper: WPSDGENRLG0027.

Exterior sensors are based upon data from "Application Assessment of Bi-Level LED Parking Lot Lighting" p6.

$$\text{Hours} = (6.19 * \text{Days}) + (\%Adj * \text{Days})$$

Where:

6.19 = Average hours per day between dusk and midnight<sup>871</sup>

Days = Days of business operation

= Actual

%Adj = Percent adjustment dependent on hour closing<sup>872</sup>

Business closes at	4pm	5pm	6pm	7pm	8pm	9pm	10pm	11pm	12pm	1am	2am	3am
%Adj	-619%	-604%	-564%	-500%	-400%	-300%	-200%	-100%	0%	100%	200%	300%

For example a business open until 8pm, 260 days per year, would assume:

$$\text{Hours} = (6.19 * 260) + (-400% * 260) = 569.4 \text{ hours}$$

---

<sup>871</sup> Calculated using the eQuest model by finding the total number of hours of exterior lighting consumption between dusk and midnight and dividing by 365 (2261 / 365 = 6.19 hours per day).

<sup>872</sup> See "IL TRM Ext Lighting.xlsx" for calculation.

4.5.1 Commercial ENERGY STAR Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8

## 4.5.2 Fluorescent Delamping

### DESCRIPTION

This measure addresses the permanent removal of existing 8', 4', 3', and 2' fluorescent lamps. Unused lamps, lamp holders, and ballasts must be permanently removed from the fixture. This measure is applicable when retrofitting from T12 lamps to T8 lamps or simply removing lamps from a T8 fixture. Removing lamps from a T12 fixture that is not being retrofitted with T8 lamps are not eligible for this incentive.

Customers are responsible for determining whether or not to use reflectors in combination with lamp removal in order to maintain adequate lighting levels. Lighting levels are expected to meet the Illuminating Engineering Society of North America (IESNA) recommended light levels. Unused lamps, lamp holders, and ballasts must be permanently removed from the fixture and disposed of in accordance with local regulations. A pre-approval application is required for lamp removal projects.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Savings are defined on a per removed lamp basis. The retrofit wattage (efficient conditioned) is therefore assumed to be zero. The savings numbers provided below are for the straight lamp removal measures, as well as the lamp removal and install reflector measures. The lamp installed/retrofit is captured in another measure.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is either a T12 or a T8 lamp with default wattages provided below. Note, if the program does not allow for the lamp type to be known, then a T12:T8 weighting of 40%:60% can be applied.<sup>873</sup>

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 11 years per DEER 2005.

### DEEMED MEASURE COST

The incremental capital cost is provided in the table below:

Measure Category	Value	Source
8-Foot Lamp Removal	\$16.00	ComEd/KEMA regression <sup>874</sup>
4-Foot Lamp Removal	\$12.00	ICF Portfolio Plan
8-Foot Lamp Removal with reflector	\$30.00	KEMA Assumption
4-Foot Lamp Removal with reflector	\$25.00	KEMA Assumption
2-Foot or 3-Foot Removal	\$12.35	KEMA Assumption
2-Foot or 3-Foot Removal with reflector	\$25.70	KEMA Assumption

### LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting

Loadshape C07 - Grocery/Conv. Store Indoor Lighting

Loadshape C08 - Hospital Indoor Lighting

<sup>873</sup> Based on ComEd's 2019 Baseline Survey results indicating approximately 40% of linear fixtures are T12s.

<sup>874</sup> Based on the assessment of active projects in the 2008-09 ComEd Smart Ideas Program. See files "ltg costs 12-10-10.xl." and "Lighting Unit Costs 102605.doc".



- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((WattsBase - WattsEE) / 1000) * ISR * Hours * WHFe$$

Where:

WattsBase = Assume wattage reduction of lamp removed

	Wattage of lamp removed <sup>875</sup>		Weighted average 40% T12, 60% T8
	T8	T12	
8-ft T8	38.6	60.3	47.3
4-ft T8	19.4	33.7	25.1
3-ft T8	14.6	40.0	24.8
2-ft T8	9.8	28.0	17.1

WattsEE = 0

ISR = In Service Rate or the percentage of units rebated that get installed.  
 =100% if application form completed with sign off that equipment permanently removed and disposed of.

Hours = Average hours of use per year are provided in Reference Table in Section 4.5. If unknown use the Miscellaneous value.

---

<sup>875</sup> Default wattage reduction is based on averaging the savings from moving from a 2 to 1, 3 to 2 and 4 to 3 lamp fixture, as provided in the Standard Performance Contract Procedures Manual: Appendix B: Table of Standard Fixture Wattages, Version 3.0, SCE, March 2004. An adjustment is made to the T8 delamped fixture to account for the significant increase in ballast factor. See 'Delamping calculation.xls' for details.

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, delamping a 4 ft T8 fixture in an office building:

$$\begin{aligned} \Delta kWh &= ((19.4 - 0)/1000) * 1.0 * 4439 * 1.25 \\ &= 107.6 \text{ kWh} \end{aligned}$$

### HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{\text{heatpenalty}}^{876} = (((\text{WattsBase} - \text{WattsEE})/1000) * \text{ISR} * \text{Hours} * -\text{IFkWh})$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, delamping a 4 ft T8 fixture in a heat pump heated office building:

$$\begin{aligned} \Delta kWh_{\text{heatpenalty}} &= ((19.4 - 0)/1000) * 1.0 * 4439 * -0.151 \\ &= -13.0 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = ((\text{WattsBase} - \text{WattsEE})/1000) * \text{ISR} * \text{WHFd} * \text{CF}$$

Where:

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value..

CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value..

Other factors as defined above

**For example**, delamping a 4 ft T8 fixture in an office building:

$$\begin{aligned} \Delta kW &= ((19.4 - 0)/1000) * 1.0 * 1.3 * 0.66 \\ &= 0.017 \text{ kW} \end{aligned}$$

### NATURAL GAS ENERGY SAVINGS

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta \text{Therms}^{877} = (((\text{WattsBase} - \text{WattsEE})/1000) * \text{ISR} * \text{Hours} * -\text{IFTherms})$$

Where:

IFTherms = Lighting-HVAC Interaction Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by

<sup>876</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>877</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

Other factors as defined above

**For example**, delamping a 4 ft T8 fixture in an office building:

$$\begin{aligned}\Delta\text{Therms} &= ((19.4 - 0)/1000) * 1.0 * 4439 * -0.016 \\ &= -1.4 \text{ therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-LTG-DLMP-V03-210101**

**REVIEW DEADLINE: 1/1/2026**

### 4.5.3 High Performance and Reduced Wattage T8 Fixtures and Lamps

**DESCRIPTION**

This measure applies to “High Performance T8” (HPT8) lamp/ballast systems that have higher lumens per watt than standard T8 systems. This measure applies to the installation of new equipment with efficiencies that exceed that of the equipment that would have been installed following standard market practices and is applicable to time of sale as well as retrofit measures. Retrofit measures may include new fixtures or relamp/reballast measures. In addition, options have been provided to allow for the “Reduced Wattage T8 lamps” or RWT8 lamps that result in re-lamping opportunities that produce equal or greater light levels than standard T8 lamps while using fewer watts.

If the implementation strategy does not allow for the installation location to be known, a deemed split of 100% Commercial and 0% Residential should be used.<sup>878</sup>

This measure was developed to be applicable to the following program types: TOS, EREP, DI.

If applied to other program types, the measure savings should be verified.

The measure applies to all commercial HPT8 installations excluding new construction and major renovation or change of use measures (see lighting power density measure). Lookup tables have been provided to account for the different types of installations. Whenever possible, actual costs and hours of use should be utilized for savings calculations. Default new and baseline assumptions have been provided in the reference tables. Default component costs and lifetimes have been provided for Operating and Maintenance Calculations. Please see the Definition Table to determine applicability for each program. HPT8 configurations not included in the TRM may be included in custom program design using the provided algorithms as long as energy savings is achieved. The following table defines the applicability for different programs:

Time of Sale (TOS)	Early Replacement (EREP) and Direct Install (DI)
<p>This measure relates to the installation of new equipment with efficiency that exceeds that of equipment that would have been installed following standard market practices. In general, the measure will include qualifying high efficiency low ballast factor ballasts paired with high efficiency long life lamps as detailed in the attached tables. High-bay applications use this system paired with qualifying high ballast factor ballasts and high performance 32 w lamps. Custom lighting designs can use qualifying low, normal or high ballast factor ballasts and qualifying lamps in lumen equivalent applications where total system wattage is reduced when calculated using the Calculation of Savings Algorithms.</p>	<p>This measure relates to the replacement of existing equipment with new equipment with efficiency that exceeds that of the existing equipment. In general, the retrofit will include qualifying high efficiency low ballast factor ballasts paired with high efficiency long life lamps as detailed in the attached tables. Custom lighting designs can use qualifying low, normal or high ballast factor ballasts and qualifying lamps in lumen equivalent applications where total system wattage is reduced when calculated using the Calculation of Savings Algorithms.</p> <p>High efficiency troffers (new/or retrofit) utilizing HPT8 technology can provide even greater savings. When used in a high-bay application, high-performance T8 fixtures can provide equal light to HID high-bay fixtures, while using fewer watts; these systems typically utilize high ballast factor ballasts, but qualifying low and normal ballast factor ballasts may be used when appropriate light levels are provided and overall wattage is reduced.</p>

<sup>878</sup> Based on weighted average of Final ComEd’s Instant Discounts program data from PY7 and PY9. For Residential installations, hours of use assumptions from ‘5.5 Interior Hardwired Compact Fluorescent Lamp (CFL) Fixture’ measure should be used.

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient conditions for all applications are a qualifying HP or RWT8 fixture and lamp/ballast combinations listed on the CEE website under qualifying HP T8 products<sup>879</sup> and qualifying RWT8 products.<sup>880</sup>

The definition of efficient equipment varies based on the program and is defined below:

Time of Sale (TOS)	Early Replacement (EREP) and Direct Install (DI)
<p>High efficiency troffers combined with high efficiency lamps and ballasts allow for fewer lamps to be used to provide a given lumen output. High efficiency troffers must have a fixture efficiency of 80% or greater to qualify. Default values are given for a 2 lamp HPT8 fixture replacing a 3 lamp standard efficiency T8 fixture, but other configurations may qualify and the Calculation of savings algorithm used to account for base watts being replaced with EE watts.</p> <p>High bay fixtures must have fixture efficiencies of 85% or greater.</p> <p>RWT8 lamps: 2', 3' and 8' lamps must meet the wattage requirements specified in the RWT8 new and baseline assumptions table. This measure assumes a lamp only purchase.</p>	<p>High efficiency troffers (new or retrofit kits) combined with high efficiency lamps and ballasts allow for fewer lamps to be used to provide a given lumen output. High efficiency troffers must have a fixture efficiency of 80% or greater to qualify. Default values are given for a 2 lamp HPT8 fixture replacing a 3 lamp standard efficiency T8 fixture, but other configurations may qualify and the Calculation of savings algorithm used to account for base watts being replaced with EE watts.</p> <p>High bay fixtures will have fixture efficiencies of 85% or greater.</p> <p>RWT8: 2', 3' and 8' lamps must meet the wattage requirements specified in the RWT8 new and baseline assumptions table.</p>

**DEFINITION OF BASELINE EQUIPMENT**

The definition of baseline equipment varies based on the program and is defined below:

Time of Sale (TOS)	Early Replacement (EREP) and Direct Install (DI)
<p>The baseline is standard efficiency T8 systems that would have been installed. The baseline for high-bay fixtures is pulse start metal halide fixtures, the baseline for a 2 lamp high efficiency troffer is a 3 lamp standard efficiency troffer.</p>	<p>The baseline is the existing system.</p> <p>In July 14, 2012, Federal Standards were enacted that were expected to eliminate T-12s as an option for linear fluorescent fixtures. Through v3.0 of the TRM, it was assumed that the T-12 would no longer be baseline for retrofits from 1/1/2016. However, due to significant loopholes in the legislation, T-12 compliant product is still freely available and in Illinois T-12s continue to hold a significant share of the existing and replacement lamp market. Therefore the timing of the sunset of T-12s as a viable baseline has been pushed back and will be revisited in future update sessions.</p> <p>There will be a baseline shift applied to all early replacement measures with a T12 baseline. See table C-1.</p>

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The deemed lifetime of efficient equipment varies based on the program and is defined below:

<sup>879</sup> Consortium for Energy Efficiency (CEE) Energy Efficiency Program Library, High-Performance T8 Specification, June 30, 2009.  
<sup>880</sup> Consortium for Energy Efficiency (CEE) Energy Efficiency Program Library, Reduced Wattage T8 Specification, July 29, 2013.

Time of Sale (TOS)	Early Replacement (EREP) and Direct Install (DI)
<p>Fixture lifetime is rated lifetime of fixture/hours of use. If unknown default is 12 years.<sup>881</sup></p> <p>Fixture retrofits which utilize RWT8 lamps have a lifetime equivalent to the life of the lamp, capped at 15 years. There is no guarantee that a reduced wattage lamp will be installed at time of burnout, but if one is, savings will be captured in the RWT8 measure below.</p> <p>RWT8 lifetime is the life of the product, at the reported operating hours (lamp life in hours divided by operating hours per year – see reference table "RWT8 Component Costs and Lifetime"), capped at 12 years.<sup>882</sup></p>	<p>Fixture lifetime is rated lifetime of fixture/hours of use. If unknown default is 15 years.</p> <p>As per explanation above, for existing T12 fixtures, a mid life baseline shift should be applied as described in table C-1. Note, since the fixture lifetime is deemed at 12 years, the replacement cost of both the lamp and ballast should be incorporated in to the O&amp;M calculation.</p>

**DEEMED MEASURE COST**

The deemed measure cost is found in the reference table at the end of this characterization.

**LOADSHAPE**

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

<sup>881</sup> 12 years is based on average of mostly CEE lamp products (9 years), T5 lamps (10.7 years) and GDS Measure Life Report, June 2007, (15 years), as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>882</sup> ibid

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * Hours * WHF_e * ISR$$

Where:

**Watts<sub>base</sub>** = Input wattage of the existing system which depends on the baseline fixture configuration (number and type of lamp) and number of fixtures. Value can be selected from the appropriate reference table as shown below, or a custom value can be entered if the configurations in the tables is not representative of the existing system.

Program	Reference Table
Time of Sale	A-1: HPT8 New and Baseline Assumptions
Early Replacement	A-2: HPT8 New and Baseline Assumptions
Reduced Wattage T8, time of sale or Early Replacement	A-3: RWT8 New and Baseline Assumptions

**Watts<sub>EE</sub>** = New Input wattage of EE fixture which depends on new fixture configuration (number of lamps) and ballast factor and number of fixtures. Value can be selected from the appropriate reference table as shown below, or a custom value can be entered if the configurations in the tables is not representative of the existing system.

Program	Reference Table
Time of Sale	A-1: HPT8 New and Baseline Assumptions
Early Replacement	A-2: HPT8 New and Baseline Assumptions
Reduced Wattage T8, time of sale or Early Replacement	A-3: RWT8 New and Baseline Assumptions

**Hours** = Average hours of use per year as provided by the customer or selected from the Reference Table in Section 4.5, Fixture annual operating hours. If hours or building type are unknown, use the Miscellaneous value.

**WHF<sub>e</sub>** = Waste heat factor for energy to account for cooling energy savings from efficient lighting is selected from the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**ISR** = In Service Rate or the percentage of units rebated that get installed.  
 =100% if application form completed with sign off that equipment is not placed into storage<sup>883</sup>

If sign off form not completed assume the following 3 year ISR assumptions:

<sup>883</sup> Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an "In-Service Rate" when commercial customers complete an application form.

Weighted Average 1st year In Service Rate (ISR)	2nd year Installations	3rd year Installations	Final Lifetime In Service Rate
93.4% <sup>884</sup>	2.5%	2.1%	98.0% <sup>885</sup>

### HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{\text{heatingpenalty}}^{886} = (((\text{WattsBase}-\text{WattsEE})/1000) * \text{ISR} * \text{Hours} * -\text{IFkWh}$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

### SUMMER COINCIDENT DEMAND SAVINGS

$$\Delta kW = ((\text{Watts}_{\text{base}}-\text{Watts}_{\text{EE}})/1000) * \text{WHF}_d * \text{CF} * \text{ISR}$$

Where:

WHF<sub>d</sub> = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is selected from the Reference Table in Section 4.5 for each building type. If the building is not cooled WHF<sub>d</sub> is 1.

CF = Summer Peak Coincidence Factor for measure is selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66.

Other factors as defined above

### NATURAL GAS SAVINGS

$$\Delta \text{Therms}^{887} = (((\text{WattsBase}-\text{WattsEE})/1000) * \text{ISR} * \text{Hours} * - \text{IFTherms}$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Please select from the Reference Table in Section 4.5 for each building type.

<sup>884</sup> Based on ComEd’s Instant Incentives program data from PY7 and PY9, see “IL Commercial Lighting ISR\_2018.xlsx”.

<sup>885</sup> The 98% Lifetime ISR assumption is based upon review of two evaluations:

‘Nexus Market Research, RLW Analytics and GDS Associates study; ‘New England Residential Lighting Markdown Impact Evaluation, January 20, 2009’ and ‘KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.’ This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings. Note that this Final Install Rate does NOT account for leakage of purchased bulbs being installed outside of the utility territory. EM&V should assess how and if data from evaluation should adjust this final installation rate to account for this impact

<sup>886</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>887</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.



**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Actual operation and maintenance costs will vary by specific equipment installed/replaced. See Reference tables for Operating and Maintenance Values;

Program	Reference Table
Time of Sale	B-1: HPT8 Component Costs and Lifetime
Early Replacement	B-2: HPT8 Component Costs and Lifetime
Reduced Wattage T8, time of sale or Early Replacement	B-3: HPT8 Component Costs and Lifetime

**REFERENCE TABLES**

See following page

A-1: Time of Sale: HPT8 New and Baseline Assumptions<sup>888</sup>

EE Measure Description	Nominal Watts	Watts <sub>EE</sub>	Baseline Description	Nominal Watt	Watts <sub>BASE</sub>	Incremental Cost	Watts <sub>SAVE</sub>
4-Lamp HPT8 w/ High-BF Ballast High-Bay	128	147.2	200 Watt Pulse Start Metal-Halide	200	232	\$75	84.80
4-Lamp HPT8 w/ High-BF Ballast High-Bay	128	147.2	250 Watt Metal Halide	250	295	\$75	147.80
6-Lamp HPT8 w/ High-BF Ballast High-Bay	192	220.8	320 Watt Pulse Start Metal-Halide	320	348.8	\$75	128.00
6-Lamp HPT8 w/ High-BF Ballast High-Bay	192	220.8	400 Watt Pulse Start Metal Halide	400	455	\$75	234.20
8-Lamp HPT8 w/ High-BF Ballast High-Bay	256	294.4	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 320 PSMH	320	476	\$75	181.60
8-Lamp HPT8 w/ High-BF Ballast High-Bay	256	292.4	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 400 W Metal Halide	400	618	75	323.60
1-Lamp HPT8-high performance 32 w lamp	32	24.64	1-Lamp Standard F32T8 w/ Elec. Ballast	32	28.16	\$15	3.52
1-Lamp HPT8-high performance 28 w lamp	28	21.56	1-Lamp Standard F32T8 w/ Elec. Ballast	32	28.16	\$15	6.60
1-Lamp HPT8-high performance 25 w lamp	25	19.25	1-Lamp Standard F32T8 w/ Elec. Ballast	32	28.16	\$15	8.91
2-Lamp HPT8 -high performance 32 w lamp	64	49.28	2-Lamp Standard F32T8 w/ Elec. Ballast	64	56.32	\$18	7.04
2-Lamp HPT8-high performance 28 w lamp	56	43.12	2-Lamp Standard F32T8 w/ Elec. Ballast	64	56.32	\$18	13.20
2-Lamp HPT8-high performance 25 w lamp	50	38.5	2-Lamp Standard F32T8 w/ Elec. Ballast	64	56.32	\$18	17.82
3-Lamp HPT8-high performance 32 w lamp	96	73.92	3-Lamp Standard F32T8 w/ Elec. Ballast	96	84.48	\$20	10.56
3-Lamp HPT8-high performance 28 w lamp	84	64.68	3-Lamp Standard F32T8 w/ Elec. Ballast	96	84.48	\$20	19.80
3-Lamp HPT8-high performance 25 w lamp	75	57.75	3-Lamp Standard F32T8 w/ Elec. Ballast	96	84.48	\$20	26.73
4-Lamp HPT8 -high performance 32 w lamp	128	98.56	4-Lamp Standard F32T8 w/ Elec. Ballast	128	112.64	\$23	14.08
4-Lamp HPT8-high performance 28 w lamp	112	86.24	4-Lamp Standard F32T8 w/ Elec. Ballast	128	112.64	\$23	26.40
4-Lamp HPT8-high performance 25 w lamp	100	77	4-Lamp Standard F32T8 w/ Elec. Ballast	128	112.64	\$23	35.64
2-lamp High-Performance HPT8 Troffer	64	49.28	3-Lamp F32T8 w/ Elec. Ballast	96	84.48	\$100	35.20

Table developed using a constant ballast factor of .77 for troffers/linear HPT8 and 1.15 for HPT8 highbay, 1.0 for all MH/MHPS, and 0.95 for T12 and 0.88 for standard T8. Input wattages are an average of manufacturer inputs that account for ballast efficacy

<sup>888</sup> Watt, lumen, lamp life, and ballast factor assumptions for efficient measures are based upon Consortium for Energy Efficiency (CEE) Commercial Lighting Qualifying Product Lists. Watt, lumen, lamp life, and ballast factor assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline and efficient measure cost data comes from lighting suppliers, past Efficiency Vermont projects, and professional judgment.

A-2: Early Replacement HPT8 New and Baseline Assumptions<sup>889</sup>

EE Measure Description	Nominal Watts	Ballast Factor	Watt <sub>EE</sub>	Baseline Description	Nominal Watts	Watt <sub>BASE</sub>	Watt <sub>SAVE</sub>	Full Measure Cost
4-Lamp HPT8 w/ High-BF Ballast High-Bay	128	1.15	147.2	200 Watt Pulse Start Metal-Halide	200	232	84.80	\$200
4-Lamp HPT8 w/ High-BF Ballast High-Bay	128	1.15	147.2	250 Watt Metal Halide	250	295	147.80	\$200
6-Lamp HPT8 w/ High-BF Ballast High-Bay	192	1.15	220.8	320 Watt Pulse Start Metal-Halide	320	348.8	128.00	\$225
6-Lamp HPT8 w/ High-BF Ballast High-Bay	192	1.15	220.8	400 Watt Pulse Start Metal Halide	400	455	234.20	\$225
8-Lamp HPT8 w/ High-BF Ballast High-Bay	256	1.15	294.4	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 320 PSMH	320	476	181.60	\$250
8-Lamp HPT8 w/ High-BF Ballast High-Bay	256	1.15	294.4	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 400 W Metal Halide	400	618	323.60	\$250
1-Lamp Relamp/Reballast T12 to HPT8	32	0.77	24.64	1-Lamp F34T12 w/ EEMag Ballast	34	42	17.36	\$50
2-Lamp Relamp/Reballast T12 to HPT8	64	0.77	49.28	2-Lamp F34T12 w/ EEMag Ballast	68	67	17.72	\$55
3-Lamp Relamp/Reballast T12 to HPT8	96	0.77	73.92	3-Lamp F34T12 w/ EEMag Ballast	102	104	30.08	\$60
4-Lamp Relamp/Reballast T12 to HPT8	128	0.77	98.56	4-Lamp F34T12 w/ EEMag Ballast	136	144	45.44	\$65
1-Lamp Relamp/Reballast T12 to HPT8	32	0.77	24.64	1-Lamp F40T12 w/ EEMag Ballast	40	41	16.36	\$50
2-Lamp Relamp/Reballast T12 to HPT8	64	0.77	49.28	2-Lamp F40T12 w/ EEMag Ballast	80	87	37.72	\$55
3-Lamp Relamp/Reballast T12 to HPT8	96	0.77	73.92	3-Lamp F40T12 w/ EEMag Ballast	120	141	67.08	\$60
4-Lamp Relamp/Reballast T12 to HPT8	128	0.77	98.56	4-Lamp F40T12 w/ EEMag Ballast	160	172	73.44	\$65
1-Lamp Relamp/Reballast T12 to HPT8	32	0.77	24.64	1-Lamp F40T12 w/ Mag Ballast	40	51	26.36	\$50
2-Lamp Relamp/Reballast T12 to HPT8	64	0.77	49.28	2-Lamp F40T12 w/ Mag Ballast	80	97	47.72	\$55
3-Lamp Relamp/Reballast T12 to HPT8	96	0.77	73.92	3-Lamp F40T12 w/ Mag Ballast	120	135	61.08	\$60
4-Lamp Relamp/Reballast T12 to HPT8	128	0.77	98.56	4-Lamp F40T12 w/ Mag Ballast	160	175	76.44	\$65
1-Lamp Relamp/Reballast T8 to HPT8	32	0.77	24.64	1-Lamp F32T8 w/ Elec. Ballast	32	28.16	3.52	\$50
2-Lamp Relamp/Reballast T8 to HPT8	64	0.77	49.28	2-Lamp F32T8 w/ Elec. Ballast	64	56.32	7.04	\$55
3-Lamp Relamp/Reballast T8 to HPT8	96	0.77	73.92	3-Lamp F32T8 w/ Elec. Ballast	96	84.48	10.56	\$60
4-Lamp Relamp/Reballast T8 to HPT8	128	0.77	98.56	4-Lamp F32T8 w/ Elec. Ballast	128	112.64	14.08	\$65

<sup>889</sup> Watt, lumen, lamp life, and ballast factor assumptions for efficient measures are based upon Consortium for Energy Efficiency (CEE) Commercial Lighting Qualifying Product Lists. Watt, lumen, lamp life, and ballast factor assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline and efficient measure cost data comes from lighting suppliers, past Efficiency Vermont projects, Xcel Energy Lighting Efficiency Input Wattage Guide and professional judgment.

EE Measure Description	Nominal Watts	Ballast Factor	Watt <sub>EE</sub>	Baseline Description	Nominal Watts	Watt <sub>BASE</sub>	Watt <sub>SAVE</sub>	Full Measure Cost
2-lamp High-Performance HPT8 Troffer or high efficiency retrofit troffer	64	0.77	49.28	3-Lamp F32T8 w/ Elec. Ballast	96	84.48	35.20	\$100

Table developed using a constant ballast factor of 0.77 for troffers/linear HPT8 and 1.15 for HPT8 highbay, 1.0 for all MH/MHPS, and 0.95 for T12 and 0.88 for standard T8. Input wattages are an average of manufacturer inputs that account for ballast efficacy.

EE Measure Description	Nominal Watts	Watt <sub>EE</sub>	EE Lamp Cost	Baseline Description	Base Lamp Cost	Nominal Watts	Watt <sub>BASE</sub>	Watt <sub>SAVE</sub>	Measure Cost
RW T8 - F28T8 Lamp	28	24.64	\$4.50	F32 T8 Standard Lamp	\$2.50	32	28.16	3.52	\$2.00
RWT8 F2T8 Extra Life Lamp	28	24.64	\$4.50	F32 T8 Standard Lamp	\$2.50	32	28.16	3.52	\$2.00
RWT8 - F32/25W T8 Lamp	25	22.00	\$4.50	F32 T8 Standard Lamp	\$2.50	32	28.16	6.16	\$2.00
RWT8 - F32/25W T8 Lamp Extra Life	25	22.00	\$4.50	F32 T8 Standard Lamp	\$2.50	32	28.16	6.16	\$2.00
RWT8 F17T8 Lamp - 2 ft	16	14.08	\$4.80	F17 T8 Standard Lamp - 2ft	\$2.80	17	14.96	0.88	\$2.00
RWT8 F25T8 Lamp - 3 ft	23	20.24	\$5.10	F25 T8 Standard Lamp - 3ft	\$3.10	25	22.00	1.76	\$2.00
RWT8 F30T8 Lamp - 6' Utube	30	26.40	\$11.31	F32 T8 Standard Utube	\$9.31	32	28.16	1.76	\$2.00
RWT8 F29T8 Lamp - Utube	29	25.52	\$11.31	F32 T8 Standard Utube	\$9.31	32	28.16	2.64	\$2.00
RWT8 F96T8 Lamp - 8 ft	65	57.20	\$9.00	F96 T8 Standard Lamp - 8 ft	\$7.00	70	61.60	4.40	\$2.00

A- 3: RWT8 New and Baseline Assumptions

Table developed using a constant ballast factor of 0.88 for RWT8 and Standard T8.

B-1: Time of Sale T8 Component Costs and Lifetime<sup>890</sup>

<sup>890</sup> Watt, lumen, lamp life, and ballast factor assumptions for efficient measures are based upon Consortium for Energy Efficiency (CEE) Commercial Lighting Qualifying Product Lists. Watt, lumen, lamp life, and ballast factor assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline and efficient measure cost data comes from lighting suppliers, past Efficiency Vermont projects, and professional judgment.

EE Measure Description	EE Lamp Cost	EE Lamp Life (hrs)	EE Lamp Rep. Labor Cost per lamp	EE Ballast Cost	EE Ballast Life (hrs)	EE Ballast Rep. Labor Cost	Baseline Description	Base Lamp Cost	Base Lamp Life (hrs)	Base Lamp Rep. Labor Cost	Base Ballast Cost	Base Ballast Life (hrs)	Base Ballast Rep. Labor Cost
4-Lamp HPT8 w/ High-BF Ballast High-Bay	\$5.00	24000	\$6.67	\$32.50	70000	\$15.00	200 Watt Pulse Start Metal-Halide	\$21.00	10000	\$6.67	\$87.75	40000	\$22.50
6-Lamp HPT8 w/ High-BF Ballast High-Bay	\$5.00	24000	\$6.67	\$32.50	70000	\$15.00	320 Watt Pulse Start Metal-Halide	\$21.00	20000	\$6.67	\$109.35	40000	\$22.50
8-Lamp HPT8 w/ High-BF Ballast High-Bay	\$5.00	24000	\$6.67	\$32.50	70000	\$15.00	Lamp HPT8 Equivalent to 320 PSMH	\$21.00	20000	\$6.67	\$109.35	40000	\$22.50
1-Lamp HPT8 – all qualifying lamps	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	1-Lamp Standard F32T12 w/ Elec Ballast	\$2.50	20000	\$2.67	\$15.00	70000	\$15.00
2-Lamp HPT8 – all qualifying lamps	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	2-Lamp Standard F32T12 w/ Elec Ballast	\$2.50	20000	\$2.67	\$15.00	70000	\$15.00
3-Lamp HPT8 – all qualifying lamps	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	3-Lamp Standard F32T8 w/ Elec. Ballast	\$2.50	20000	\$2.67	\$15.00	70000	\$15.00
4-Lamp HPT8 – all qualifying lamps	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	4-Lamp Standard F32T8 w/ Elec. Ballast	\$2.50	20000	\$2.67	\$15.00	70000	\$15.00
				\$32.50									
2-lamp High-Performance HPT8 Troffer	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	3-Lamp F32T8 w/ Elec. Ballast	\$2.50	20000	\$2.67	\$15.00	70000	\$15.00

B-2: T8 Early Replacement Component Costs and Lifetime<sup>891</sup>

<sup>891</sup> Cost assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline and efficient measure cost data comes from lighting suppliers, past Efficiency Vermont projects, and professional judgment.

EE Measure Description	EE Lamp Cost	EE Lamp Life (hrs)	EE Lamp Rep. Labor Cost per lamp	EE Ballast Cost	EE Ballast Life (hrs)	EE Ballast Rep. Labor Cost	Baseline Description	Base Lamp Cost	Base Lamp Life (hrs)	Base Lamp Rep. Labor Cost	Base Ballast Cost	Base Ballast Life (hrs)	Base Ballast Rep. Labor Cost
4-Lamp HPT8 w/ High-BF Ballast High-Bay	\$5.00	24000	\$6.67	\$32.50	70000	\$15.00	200 Watt Pulse Start Metal-Halide	\$29.00	12000	\$6.67	\$87.75	40000	\$22.50
6-Lamp HPT8 w/ High-BF Ballast High-Bay	\$5.00	24000	\$6.67	\$32.50	70000	\$15.00	320 Watt Pulse Start Metal-Halide	\$72.00	20000	\$6.67	\$109.35	40000	\$22.50
8-Lamp HPT8 w/ High-BF Ballast High-Bay	\$5.00	24000	\$6.67	\$32.50	70000	\$15.00	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 320 PSMH	\$17.00	20000	\$6.67	\$109.35	40000	\$22.50
1-Lamp Relamp/Reballast T12 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	1-Lamp F34T12 w/ EEMag Ballast	\$2.70	20000	\$2.67	\$20.00	40000	\$15.00
2-Lamp Relamp/Reballast T12 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	2-Lamp F34T12 w/ EEMag Ballast	\$2.70	20000	\$2.67	\$20.00	40000	\$15.00
3-Lamp Relamp/Reballast T12 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	3-Lamp F34T12 w/ EEMag Ballast	\$2.70	20000	\$2.67	\$20.00	40000	\$15.00
4-Lamp Relamp/Reballast T12 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	4-Lamp F34T12 w/ EEMag Ballast	\$2.70	20000	\$2.67	\$20.00	40000	\$15.00
1-Lamp Relamp/Reballast T8 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	1-Lamp F32T8 w/ Elec. Ballast	\$2.70	20000	\$2.67	\$20.00	70000	\$15.00
2-Lamp Relamp/Reballast T8 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	2-Lamp F32T8 w/ Elec. Ballast	\$2.70	20000	\$2.67	\$20.00	70000	\$15.00
3-Lamp Relamp/Reballast T8 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	3-Lamp F32T8 w/ Elec. Ballast	\$2.70	20000	\$2.67	\$20.00	70000	\$15.00
4-Lamp Relamp/Reballast T8 to HPT8	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	4-Lamp F32T8 w/ Elec. Ballast	\$2.70	20000	\$2.67	\$20.00	70000	\$15.00
2-lamp High-Performance HPT8 Troffer	\$5.00	24000	\$2.67	\$32.50	70000	\$15.00	3-Lamp F32T8 w/ Elec. Ballast	\$2.50	20000	\$2.67	\$15.00	70000	\$15.00

B-3: Reduced Wattage T8 Component Costs and Lifetime<sup>892</sup>

EE measure description	EE Lamp Cost	EE Lamp Life (hrs)	Baseline Description	Base Lamp Cost	Base Lamp Life (hrs)	Base Lamp Rep. Labor Cost
RW T8 - F28T8 Lamp	\$4.50	30000	F32 T8 Standard Lamp	\$2.50	15000	\$2.67
RWT8 F2T8 Extra Life Lamp	\$4.50	36000	F32 T8 Standard Lamp	\$2.50	15000	\$2.67
RWT8 - F32/25W T8 Lamp	\$4.50	30000	F32 T8 Standard Lamp	\$2.50	15000	\$2.67
RWT8 - F32/25W T8 Lamp Extra Life	\$4.50	36000	F32 T8 Standard Lamp	\$2.50	15000	\$2.67
RWT8 F17T8 Lamp - 2 ft	\$4.80	18000	F17 T8 Standard Lamp - 2ft	\$2.80	15000	\$2.67
RWT8 F25T8 Lamp - 3 ft	\$5.10	18000	F25 T8 Standard Lamp - 3ft	\$3.10	15000	\$2.67
RWT8 F30T8 Lamp - 6' Utube	\$11.31	24000	F32 T8 Standard Utube	\$9.31	15000	\$2.67
RWT8 F29T8 Lamp - Utube	\$11.31	24000	F32 T8 Standard Utube	\$9.31	15000	\$2.67
RWT8 F96T8 Lamp - 8 ft	\$9.00	24000	F96 T8 Standard Lamp - 8 ft	\$7.00	15000	\$2.67

<sup>892</sup> Cost assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline and efficient measure cost data comes from lighting suppliers, past Efficiency Vermont projects, and professional judgment.

C-1: T12 Baseline Adjustment:

For early replacement measures replacing existing T12 fixtures the full savings (as calculated above in the Algorithm section) will be claimed for the remaining useful life of the T12 fixture. This should be calculated as follows:

$$\text{RUL of existing T12 fixture} = (1/3 * 40,000)/\text{Hours}$$

A savings adjustment should then be applied to the annual savings for the remainder of the measure life. The adjustment to be applied for each measure should be calculated as:

$$\% \text{ Adjustment} = (\text{TOS Base Watts} - \text{Efficient Watts}) / (\text{Existing T12 Watts} - \text{Efficient Watts})$$

For example, an existing 2 lamp T12 fixture (87W) in a college is replaced by a 2 lamp HPT8 (49.3W).

$$\text{Mid life adjustment of } (56.4 - 49.3) / (87 - 49.3) = 19\%$$

$$\text{Applied after } (1/3 * 40000) / 3395 = 3.9 \text{ years}$$

The adjustment to be applied for each default measure described above is listed in the reference table below:

Savings Adjustment Factors

EE Measure Description	Savings Adjustment T12 EEmag ballast and 34 w lamps to HPT8	Savings Adjustment T12 EEmag ballast and 40 w lamps to HPT8	Savings Adjustment T12 mag ballast and 40 w lamps to HPT8
1-Lamp Relamp/Reballast T12 to HPT8	20%	22%	13%
2-Lamp Relamp/Reballast T12 to HPT8	40%	19%	15%
3-Lamp Relamp/Reballast T12 to HPT8	35%	16%	17%
4-Lamp Relamp/Reballast T12 to HPT8	31%	19%	18%

**MEASURE CODE: CI-LTG-T8FX-V09-200101**

**REVIEW DEADLINE: 1/1/2025**



## 4.5.4 LED Bulbs and Fixtures

### DESCRIPTION

This characterization provides savings assumptions for a variety of LED lamps including Omnidirectional (e.g., A-Type lamps), Decorative (e.g., Globes and Torpedoes) and Directional (PAR Lamps, Reflectors, MR16), and fixtures including refrigerated case, recessed and outdoor/garage fixtures.

If the implementation strategy does not allow for the installation location to be known, for Residential targeted programs (e.g., an upstream retail program), a deemed split of 97% Residential and 3% Commercial assumptions should be used,<sup>893</sup> and for Commercial targeted programs a deemed split of 98% Commercial and 2% Residential should be used.<sup>894</sup>

This measure was developed to be applicable to the following program types: TOS, NC, EREP, DI, KITS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, new lamps must be ENERGY STAR in accordance with ENERGY STAR specification v2.1 (effective 1/2/2017) or be listed on the Design Lights Consortium Qualifying Product List.<sup>895</sup>

### DEFINITION OF BASELINE EQUIPMENT

The Standard Rx Program will assume a Time of Sale baseline for all one to one replacements, and early replacement for lighting redesign and early retirement for delamping.

For early replacement, the baseline is the existing fixture being replaced.

If the existing fixture is a T12: In July 14, 2012, Federal Standards were enacted that were expected to eliminate T-12s as an option for linear fluorescent fixtures. Through v3.0 of the TRM, it was assumed that the T-12 would no longer be baseline for retrofits from 1/1/2016. However, due to significant loopholes in the legislation, T-12 compliant product is still freely available and in Illinois T-12s continue to hold a significant share of the existing and replacement lamp market. From v8.0 on, a midlife adjustment is applied after the remaining useful life of the T12 fixture (calculated as 1/3 of the 40,000 hour ballast life/ hours). This assumes that T12 replacement lamps will continue to be available until then. See 'Early Replacement Measures with T12 baseline' section.

For Time of Sale, refer to the baseline tables at the end of this measure.

In 2012, Federal legislation stemming from the Energy Independence and Security Act of 2007 (EIAS) required all general-purpose light bulbs (defined as omni-directional or standard A-lamps) between 40 watts and 100 watts to have ~30% increased efficiency, essentially phasing out standard incandescent technology. In 2012, the 100 w lamp standards went in to effect followed by the 75 w lamp standards in 2013 and 60 w and 40 w lamps in 2014.

Additionally, an EISA backstop provision was included that would require replacement baseline lamps to meet an efficacy requirement of 45 lumens/watt or higher beginning on 1/1/2020.

However, in December 2019, DOE issued a final determination for General Service Incandescent Lamps (GSILs), finding that this more stringent standard was not economically justified.

The natural growth of LED market share however, has and will continue to grow over the lifetime of the LED measures installed. The TAC convened a Lamp Forecast Working Group to develop a forecast of the baseline growth

---

<sup>893</sup> RES v C&I split is based on a weighted (by sales volume) average of ComEd PY8, PY9 and CY2018 and Ameren PY8 in store intercept survey results. See 'RESvCI Split\_2019.xlsx.

<sup>894</sup> Based on final ComEd's Instant Incentives program data from PY7 and PY9. For Residential installations, hours of use assumptions from '5.5.6 LED Downlights' should be used for LED fixtures and '5.5.8 LED Screw Based Omnidirectional Bulbs' should be used for LED bulbs.

<sup>895</sup> ENERGY STAR Program Requirements Product Specifications for Lamps (Light Bulbs), version 2.1, effective January 2, 2017.

of LED, based upon historical growth rates provided via CREED LightTracker data, comparisons with no-program states and review of projections provided by the Department of Energy.<sup>896</sup> The TAC determined that using the Residential-derived forecast is appropriate for the small commercial participants likely to be purchasing lamps through the efficiency programs.

This baseline forecast was then used to estimate how replacement lamps would change over the lifetime of an LED. A single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings.

Specialty and Directional lamps were not included in the original definition of General Service Lamps in the Energy Independence and Security Act of 2007 (EISA). Therefore, the initial baseline is an incandescent / halogen lamp described in the tables below.

A DOE Final Rule released on 1/19/2017 updated the EISA regulations to remove the exemption for these lamp types such that they become subject to the backstop provision defined within the original legislation. However, in September 2019 this decision was revoked in a new DOE Final Rule. The natural growth of LED market share of specialty and directional lamps was also estimated by the Working Group and applied to those lamp types.

#### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

For fixtures, the lifetime is the life of the product, at the reported operating hours (lamp life in hours divided by operating hours per year – see reference table "LED component Costs and Lifetime." The analysis period is the same as the lifetime, capped at 15 years. (15 years from GDS Measure Life Report, June 2007).

For lamps lifetime is calculated as the rated lifetime of the product (actual if available, otherwise assume 20,000 hours for Omnidirectional, 17,000 hours for decorative and 25,000 for directional lamps based on average rated life of lamps on the ENERGY STAR Qualified Products list (accessed 6/16/2020)) divided by the reported operating hours, capped at 10 years.<sup>897</sup>

#### **DEEMED MEASURE COST**

Wherever possible, actual incremental costs should be used. Refer to reference table "LED component Cost & Lifetime" for defaults.

#### **LOADSHAPE**

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)

---

<sup>896</sup> US Department of Energy, "Energy Savings Forecast of Solid State Lighting in General Illumination Applications", December 2019. The resultant forecast is provided on the SharePoint site "Lamp Forecast Workbook.xls".

<sup>897</sup> Based on recommendation in the Dunsky Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-18.

- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting
- Loadshape C60 – Non-Residential Agriculture Lighting – 6 Hours
- Loadshape C61 – Non-Residential Agriculture Lighting – 8 Hours
- Loadshape C62 – Non-Residential Agriculture Lighting – 12 Hours
- Loadshape C63 – Non-Residential Dairy Long Day Lighting – 17 Hours
- Loadshape C64 – Non-Residential Agriculture Lighting – 24 Hours

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * Hours * WHF_e * ISR$$

Where:

Watts<sub>base</sub> = Input wattage of the existing (for early replacement) or baseline system. Reference the “LED New and Baseline Assumptions” table for default values.

Watts<sub>EE</sub> = Actual wattage of LED purchased / installed. If unknown, use default provided below:  
 For ENERGY STAR rated lamps the following lumen equivalence tables should be used:<sup>898</sup>

**Omnidirectional Lamps - ENERGY STAR Minimum Luminous Efficacy = 80Lm/W for <90 CRI lamps and 70Lm/W for >=90 CRI lamps.**

Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage <sup>899</sup> (WattsEE)	Baseline (WattsBase)	Delta Watts (WattsEE)
5280	6209	5745	72.9	300.0	227.1
3301	5279	4290	54.5	200.0	145.5
2601	3300	2951	37.5	150.0	112.5
1490	2600	2045	26.0	72.0	46.0
1050	1489	1270	16.1	53.0	36.9
750	1049	900	11.4	43.0	31.6
310	749	530	6.7	29.0	22.3
250	309	280	3.5	25.0	21.5

<sup>898</sup> See file “LED baseline and EE wattage table\_2018.xlsx” for details on lamp wattage calculations.

<sup>899</sup> Based on ENERGY STAR V2.0 specs – for omnidirectional <90CRI: 80 lm/W and for omnidirectional >=90 CRI: 70 lm/W. To weight these two criteria, the ENERGY STAR qualified list was reviewed and found to contain 87.8% lamps <90CRI and 12.2% >=90CRI.

**Decorative Lamps - ENERGY STAR Minimum Luminous Efficacy = 65Lm/W for all lamps**

Bulb Type	Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage (Watts <sub>EE</sub> )	Baseline (Watts <sub>Base</sub> )	Delta Watts (Watts <sub>EE</sub> )
<b>3-Way<sup>900</sup></b>	250	449	350	4.4	25	20.6
	450	799	625	7.9	40	32.1
	800	1,099	950	12.1	60	47.9
	1,100	1,599	1350	17.1	75	57.9
	1,600	1,999	1800	22.8	100	77.2
	2,000	2,549	2275	28.9	125	96.1
	2,550	2,999	2775	35.2	150	114.8
<b>Globe (medium and intermediate bases less than 750 lumens)</b>	90	179	135	2.1	10	7.9
	180	249	215	3.3	15	11.7
	250	349	300	4.6	25	20.4
	350	749	550	8.5	40	31.5
<b>Decorative (Shapes B, BA, C, CA, DC, F, G, medium and intermediate bases less than 750 lumens)</b>	70	89	80	1.2	10	8.8
	90	149	120	1.8	15	13.2
	150	299	225	3.5	25	21.5
	300	749	525	8.1	40	31.9
<b>Globe (candelabra bases less than 1050 lumens)</b>	90	179	135	2.1	10	7.9
	180	249	215	3.3	15	11.7
	250	349	300	4.6	25	20.4
	350	499	425	6.5	40	33.5
	500	1,049	775	11.9	60	48.1
<b>Decorative (Shapes B, BA, C, CA, DC, F, G, candelabra bases less than 1050 lumens)</b>	70	89	80	1.2	10	8.8
	90	149	120	1.8	15	13.2
	150	299	225	3.5	25	21.5
	300	499	400	6.1	40	33.9
	500	1,049	775	11.9	60	48.1

**Directional Lamps** - ENERGY STAR Minimum Luminous Efficacy = 70Lm/W for <90 CRI lamps and 61 Lm/W for >=90CRI lamps.

For Directional R, BR, and ER lamp types:

<sup>900</sup> For 3-way bulbs or fixtures, the product’s median lumens value will be used to determine both LED and baseline wattages.

Bulb Type	Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage (Watts <sub>EE</sub> )	Baseline (Watts <sub>Base</sub> )	Delta Watts (Watts <sub>EE</sub> )
<b>R, ER, BR with medium screw bases w/ diameter &gt;2.25" (*see exceptions below)</b>	420	472	446	6.6	40	33.4
	473	524	499	7.3	45	37.7
	525	714	620	9.1	50	40.9
	715	937	826	12.1	65	52.9
	938	1259	1099	16.2	75	58.8
	1260	1399	1330	19.6	90	70.4
	1400	1739	1570	23.1	100	76.9
	1740	2174	1957	28.8	120	91.2
	2175	2624	2400	35.3	150	114.7
	2625	2999	2812	41.3	175	133.7
<b>*R, BR, and ER with medium screw bases w/ diameter &lt;=2.25"</b>	3000	4500	3750	55.1	200	144.9
	400	449	425	6.2	40	33.8
	450	499	475	7.0	45	38.0
	500	649	575	8.5	50	41.5
<b>*ER30, BR30, BR40, or ER40</b>	650	1199	925	13.6	65	51.4
	400	449	425	6.2	40	33.8
	450	499	475	7.0	45	38.0
<b>*BR30, BR40, or ER40</b>	500	649	575	8.5	50	41.5
	650	1419	1035	15.2	65	49.8
<b>*R20</b>	400	449	425	6.2	40	33.8
	450	719	585	8.6	45	36.4
<b>*All reflector lamps below lumen ranges specified above</b>	200	299	250	3.7	20	16.3
	300	399	350	5.1	30	24.9

For PAR, MR, and MRX Lamp Types:

For these highly focused directional lamp types, it is necessary to have Center Beam Candle Power (CBCP) and beam angle measurements to accurately estimate the equivalent baseline wattage. The formula below

is based on the Energy Star Center Beam Candle Power tool.<sup>901</sup> If CBCP and beam angle information are not available or if the equation below returns a negative value (or undefined), use the manufacturer’s recommended baseline wattage equivalent.<sup>902</sup>

Wattsbase =

$$375.1 - 4.355(D) - \sqrt{227,800 - 937.9(D) - 0.9903(D^2) - 1479(BA) - 12.02(D * BA) + 14.69(BA^2) - 16,720 * \ln(CBCP)}$$

Where:

- D = Bulb diameter (e.g. for PAR20 D = 20)
- BA = Beam angle
- CBCP = Center beam candle power

The result of the equation above should be rounded DOWN to the nearest wattage established by Energy Star:

Diameter	Permitted Wattages
16	20, 35, 40, 45, 50, 60, 75
20	50
30S	40, 45, 50, 60, 75
30L	50, 75
38	40, 45, 50, 55, 60, 65, 75, 85, 90, 100, 120, 150, 250

Additional EISA non-exempt bulb types:

Bulb Type	Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage (Watts <sub>EE</sub> )	Baseline (Watts <sub>Base</sub> )	Delta Watts (Watts <sub>EE</sub> )
<b>Dimmable Twist, Globe (less than 5" in diameter and &gt; 749 lumens), candle (shapes B, BA, CA &gt; 749 lumens), Candelabra Base Lamps (&gt;1049 lumens), Intermediate Base Lamps (&gt;749 lumens)</b>	310	749	530	6.7	29	22.3
	750	1049	900	11.4	43	31.6
	1050	1489	1270	16.1	53	36.9
	1490	2600	2045	26.0	72	46.0

Hours = Average hours of use per year are provided in the Reference Table in Section 4.5 for each building type. If unknown, use the Miscellaneous value.

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

ISR = In Service Rate -the percentage of units rebated that actually get installed.

<sup>901</sup> ENERGY STAR Lamps Center Beam Intensity Benchmark Tool and Calculator

<sup>902</sup> The Energy Star Center Beam Candle Power tool does not accurately model baseline wattages for lamps with certain bulb characteristic combinations – specifically for lamps with very high CBCP.

=100% if application form completed with sign off that equipment is not placed into storage.<sup>903</sup> If sign off form not completed, assume the following 3 year ISR assumptions:

Weighted Average 1st year In Service Rate (ISR)	2nd year Installations	3rd year Installations	Final Lifetime In Service Rate
82.5% <sup>904</sup>	8.4%	7.1%	98.0% <sup>905</sup>

For Kits, use survey response data to determine appropriate ISR.

**Mid Life Baseline Adjustment**

Omnidirectional, Decorative and Directional Lamps

During the lifetime of an LED, the baseline incandescent/halogen bulb would need to be replaced multiple times. Natural growth of LED market share has, and will continue to grow over the lifetime of the measure, and so a single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings. See ‘Lamp Forecast Workbook\_2020.xls’ for details.

The calculated mid-life adjustments for 2021 are provided below for each population:

Lamp Type	Year from which adjustment is applied	Adjustment Factor applied to Annual kWh Savings
Omnidirectional	2025	38%
Decorative	2025	61%
Directional	2025	60%

**For example**, a 1000 lumen omnidirectional lamp installed in a high school in 2021.

$$\begin{aligned} \Delta\text{kWh (2021 – 2024)} &= ((43-11.4)/1000) * 2327 * 1.15 * 1 \\ &= 84.6 \text{ kWh} \\ \Delta\text{kWh (2025 on)} &= 84.6 * 0.38 \\ &= 32.1 \text{ kWh} \end{aligned}$$

<sup>903</sup> Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an “In-Service Rate” when commercial customers complete an application form.

<sup>904</sup> Based on ComEd’s Instant Incentives program data from PY7 and PY9 and Ameren’s Instant Incentives program for PY9, see “IL Commercial Lighting ISR\_2018.xlsx”.

<sup>905</sup> In the absence of any data for LEDs specifically it is assumed that the same proportion of bulbs eventually get installed as for CFLs. The 98% CFL assumption is based upon review of two evaluations:

‘Nexus Market Research, RLW Analytics and GDS Associates study; ‘New England Residential Lighting Markdown Impact Evaluation, January 20, 2009’ and ‘KEMA Inc, Feb 2010, Final Evaluation Report: Upstream Lighting Program, Volume 1.’ This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings. Note that this Final Install Rate does NOT account for leakage of purchased bulbs being installed outside of the utility territory. EM&V should assess how and if data from evaluation should adjust this final installation rate to account for this impact.

**Early Replacement Measures with T12 Baseline**

For early replacement measures replacing existing T12 fixtures the full savings (as calculated above in the Algorithm section) will be claimed for the remaining useful life of the T12 fixture. This should be calculated as follows:

$$RUL \text{ of existing T12 fixture} = (1/3 * 40,000)/\text{Hours}$$

A savings adjustment should then be applied to the annual savings for the remainder of the measure life. The adjustment factor to be applied for each T12 installation is 57%.<sup>906</sup>

For example, for an existing 68W T12 fixture in a college is replaced by a 3000 lumen LED 2x2 Recessed Light Fixture (25.4W), a mid life adjustment of 57% should be applied after  $(1/3 * 40000)/3395 = 3.9$  years.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{\text{heatpenalty}}^{907} = (((\text{WattsBase}-\text{WattsEE})/1000) * \text{ISR} * \text{Hours} * -\text{IFkWh}$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, a 9W LED lamp, 450 lumens, is installed in a heat pump heated office in 2014 and sign off form provided:

$$\begin{aligned} \Delta kWh_{\text{heatpenalty}} &= ((29-6.7)/1000)*1.0*3088* -0.151 \\ &= - 10.4 \text{ kWh} \end{aligned}$$

**DEFERRED INSTALLS**

As presented above, if a sign off form is not completed the characterization assumes that a percentage of bulbs purchased are not installed until Year 2 and Year 3 (see ISR assumption above). The Illinois Technical Advisory Committee has determined the following methodology for calculating the savings of these future installs.

Year 1 (Purchase Year) installs: Characterized using assumptions provided above or evaluated assumptions if available.

Year 2 and 3 installs: Characterized using delta watts assumption and hours of use from the Install Year, i.e., the actual deemed (or evaluated if available) assumptions active in Year 2 and 3 should be applied.

The NTG factor for the Purchase Year should be applied.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((\text{Watts}_{\text{base}}-\text{Watts}_{\text{EE}})/1000) * \text{ISR} * \text{WHF}_d * \text{CF}$$

Where:

<sup>906</sup> The appropriate T12 midlife adjustment factor was developed by the TAC Lighting Working Group. The results of a 2019 ComEd study provided survey response data on the planned replacement upon the burnout of a T12 ballast. This was adjusted by first year NTG to remove first year freeriders and therefore estimate what the non-freerider population would do at the end of T12 life. See "Linear Forecast Workbook\_2020.xls" for information on calculation.

<sup>907</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.



- WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in Reference Table in Section 4.5. If unknown, use the Miscellaneous value.
- CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, a 9W LED lamp, 450 lumens, is installed in an office in 2014 and sign off form provided:

$$\Delta kW = ((29-6.7)/1000) * 1.0 * 1.3 * 0.66$$

$$= 0.019 \text{ kW}$$

**NATURAL GAS ENERGY SAVINGS**

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta \text{Therms} = ((\text{WattsBase}-\text{WattsEE})/1000) * \text{ISR} * \text{Hours} * - \text{IFTherms}$$

Where:

- IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, a 9W LED lamp, 450 lumens, is installed in an office in 2014 and sign off form provided:

$$\Delta \text{Therms} = ((29-6.7)/1000) * 1.0 * 3088 * -0.016$$

$$= - 1.10 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

For fixture measures, the individual component lifetimes and costs are provided in the reference table section below.<sup>908</sup>

For lamps in order to account for the natural growth of LED over the lifetime of the measure, an equivalent annual levelized baseline replacement cost is calculated and applied over the life of the measure as described above.

The NPV for replacement lamps and annual levelized replacement costs using the societal real discount rate of 0.42% are presented below. It is important to note that for cost-effectiveness screening purposes, the O&M cost adjustments should only be applied in cases where the light bulbs are actually in service and so should be multiplied by the appropriate ISR:

Lamp Type	Location	NPV of replacement costs for period	Levelized annual replacement cost savings
		2021	2021
Omnidirectional	Commercial	\$12.05	\$2.21
	Multifamily common areas	\$19.65	\$5.90

<sup>908</sup> See IL LED Lighting Systems TRM Reference Tables\_2018.xlsx for breakdown of component cost assumptions.

Lamp Type	Location	NPV of replacement costs for period	Levelized annual replacement cost savings
		2021	2021
Decorative	Commercial	\$15.38	\$3.31
	Multifamily common areas	\$22.19	\$7.84
Directional	Commercial	\$41.54	\$6.11
	Multifamily common areas	\$73.77	\$17.77

For halogen bulbs, we assume the same replacement cycle as incandescent bulbs.<sup>909</sup> The replacement cycle is based on the miscellaneous hours of use. Both incandescent and halogen lamps are assumed to last for 1,000 hours before needing replacement and CFLs after 10,000 hours.

**REFERENCE TABLES**

**LED Bulb Assumptions**

Wherever possible, actual incremental costs should be used. If unavailable assume the following incremental costs:<sup>910</sup>

Bulb Type	Year	LED	Incandescent	Incremental Cost
Omnidirectional	2017	\$3.21	\$1.25	\$1.96
	2018	\$3.21		\$1.96
	2019	\$3.11		\$1.86
	2020	\$2.70		\$1.45
Directional	2017	\$6.24	\$3.53	\$2.71
	2018+	\$5.18		\$1.65
Decorative and Globe	2017	\$3.50	\$1.60	\$1.90
	2018+	\$3.40	\$1.74	\$1.66

**LED Fixture Wattage, TOS Baseline and Incremental Cost Assumptions<sup>911</sup>**

LED Category	EE Measure Description	Watts <sub>EE</sub>	Baseline Description	Watts <sub>BASE</sub>	Incremental Cost
LED Downlight Fixtures	LED Recessed, Surface, Pendant Downlights	17.6	Baseline Recessed, Surface, Pendant Downlights	54.3	\$27
	LED Track Lighting	12.2	Baseline Track Lighting	60.4	\$59

<sup>909</sup> The manufacturers of the new minimally compliant EISA Halogens are using regular incandescent lamps with halogen fill gas rather than halogen infrared to meet the standard and so the component rated life is equal to the standard incandescent.

<sup>910</sup> Baseline and LED lamp costs are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis. Given LED prices are expected to continue declining assumed costs should be reassessed on an annual basis and replaced with IL specific LED program information when available.

<sup>911</sup> Watt, lumen, lamp life, and ballast factor assumptions for efficient measures are based upon Consortium for Energy Efficiency (CEE) Commercial Lighting Qualifying Product Lists alongside past Efficiency Vermont projects and PGE refrigerated case study. Watt, lumen, lamp life, and ballast factor assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline cost data comes from lighting suppliers, past Efficiency Vermont projects, and professional judgment. Efficient cost data comes from 2012 DOE "Energy Savings Potential of Solid-State Lighting in General Illumination Applications", Table A.1. See "LED Lighting Systems TRM Reference Tables\_2018.xlsx" for more information and specific product links.

LED Category	EE Measure Description	Watts <sub>EE</sub>	Baseline Description	Watts <sub>BASE</sub>	Incremental Cost
LED Interior Directional	LED Wall-Wash Fixtures	8.3	Baseline Wall-Wash Fixtures	17.7	\$59
LED Display Case <sup>912</sup>	LED Display Case Light Fixture	4 per ft	Baseline Display Case Light Fixture	36.2 per ft	\$11/ft
	LED Undercabinet Shelf-Mounted Task Light Fixtures	4 per ft	Baseline Undercabinet Shelf-Mounted Task Light Fixtures	36.2 per ft	\$11/ft
	LED Refrigerated Case Light, Horizontal or Vertical	4 per ft	Baseline Refrigerated Case Light, Horizontal or Vertical (per foot)	15.2 per ft	\$11/ft
	LED Freezer Case Light, Horizontal or Vertical	4 per ft	Baseline Freezer Case Light, Horizontal or Vertical (per foot)	18.7 per ft	\$11/ft
LED Linear Replacement Lamps	T8 LED Replacement Lamp (TLED), < 1200 lumens	8.9	F17T8 Standard Lamp - 2 foot	15.0	\$13
	T8 LED Replacement Lamp (TLED), 1200-2400 lumens	15.8	F32T8 Standard Lamp - 4 foot	28.2	\$15
	T8 LED Replacement Lamp (TLED), > 2400 lumens	22.9	F32T8/HO Standard Lamp - 4 foot	41.8	\$13
LED Troffers	LED 2x2 Recessed Light Fixture, 2000-3500 lumens	25.4	2-Lamp 32w T8 (BF < 0.89)	57.0	\$53
	LED 2x2 Recessed Light Fixture, 3501-5000 lumens	36.7	3-Lamp 32w T8 (BF < 0.88)	84.5	\$69
	LED 2x4 Recessed Light Fixture, 3000-4500 lumens	33.3	2-Lamp 32w T8 (BF < 0.89)	57.0	\$55
	LED 2x4 Recessed Light Fixture, 4501-6000 lumens	44.8	3-Lamp 32w T8 (BF < 0.88)	84.5	\$76
	LED 2x4 Recessed Light Fixture, 6001-7500 lumens	57.2	4-Lamp 32w T8 (BF < 0.88)	112.6	\$104
	LED 1x4 Recessed Light Fixture, 1500-3000 lumens	21.8	1-Lamp 32w T8 (BF < 0.91)	29.1	\$22
	LED 1x4 Recessed Light Fixture, 3001-4500 lumens	33.7	2-Lamp 32w T8 (BF < 0.89)	57.0	\$75
	LED 1x4 Recessed Light Fixture, 4501-6000 lumens	43.3	3-Lamp 32w T8 (BF < 0.88)	84.5	\$83

<sup>912</sup> LED Case Lighting is based on an average of DLC Horizontal and Vertical Lighting less than 80 W. This filter was intended to exclude vaportight fixtures from the average. The horizontal and vertical averages, provided by Guidehouse in 5/2020, were 4.1 W/ft and 3.7 W/ft, respectively.

LED Category	EE Measure Description	Watts <sub>EE</sub>	Baseline Description	Watts <sub>BASE</sub>	Incremental Cost
LED Linear Ambient Fixtures	LED Surface & Suspended Linear Fixture, <= 3000 lumens	19.5	1-Lamp 32w T8 (BF <0.91)	29.1	\$10
	LED Surface & Suspended Linear Fixture, 3001-4500 lumens	32.1	2-Lamp 32w T8 (BF < 0.89)	57.0	\$52
	LED Surface & Suspended Linear Fixture, 4501-6000 lumens	43.5	3-Lamp 32w T8 (BF < 0.88)	84.5	\$78
	LED Surface & Suspended Linear Fixture, 6001-7500 lumens	56.3	T5HO 2L-F54T5HO - 4'	120.0	\$131
	LED Surface & Suspended Linear Fixture, > 7500 lumens	82.8	T5HO 3L-F54T5HO - 4'	180.0	\$173
LED High & Low Bay Fixtures	LED Low-Bay Fixtures, <= 10,000 lumens	61.6	3-Lamp T8HO Low-Bay	157.0	\$44
	LED High-Bay Fixtures, 10,001-15,000 lumens	99.5	4-Lamp T8HO High-Bay	196.0	\$137
	LED High-Bay Fixtures, 15,001-20,000 lumens	140.2	6-Lamp T8HO High-Bay	294.0	\$202
	LED High-Bay Fixtures, 20,001-30,000 lumens	193.8	8-Lamp T8HO High-Bay	392.0	\$264
	LED High-Bay Fixtures, 30,001-40,000 lumens	250	750 Watts Metal Halide	850	\$400
	LED High-Bay Fixtures 40,001-50,000 lumens	295	1000 Watts Metal Halide	1080	\$425
	LED High-Bay Fixtures >50,000 lumens	435	1500 Watts Metal Halide	1610	\$550
LED Agricultural Interior Fixtures	LED Ag Interior Fixtures, <= 2,000 lumens	12.9	25% 73 Watt EISA Inc, 75% 1L T8	42.0	\$18
	LED Ag Interior Fixtures, 2,001-4,000 lumens	29.7	25% 146 Watt EISA Inc, 75% 2L T8	81.0	\$48
	LED Ag Interior Fixtures, 4,001-6,000 lumens	45.1	25% 217 Watt EISA Inc, 75% 3L T8	121.0	\$57
	LED Ag Interior Fixtures, 6,001-8,000 lumens	59.7	25% 292 Watt EISA Inc, 75% 4L T8	159.0	\$88
	LED Ag Interior Fixtures, 8,001-12,000 lumens	84.9	200W Pulse Start Metal Halide	227.3	\$168

LED Category	EE Measure Description	Watts <sub>EE</sub>	Baseline Description	Watts <sub>BASE</sub>	Incremental Cost
	LED Ag Interior Fixtures, 12,001-16,000 lumens	113.9	320W Pulse Start Metal Halide	363.6	\$151
	LED Ag Interior Fixtures, 16,001-20,000 lumens	143.7	350W Pulse Start Metal Halide	397.7	\$205
	LED Ag Interior Fixtures, > 20,000 lumens	193.8	(2) 320W Pulse Start Metal Halide	727.3	\$356
LED Exterior Fixtures	LED Exterior Fixtures, <= 5,000 lumens	34.1	100W Metal Halide	113.6	\$80
	LED Exterior Fixtures, 5,001-10,000 lumens	67.2	175W Pulse Start Metal Halide	198.9	\$248
	LED Exterior Fixtures, 10,001-15,000 lumens	108.8	250W Pulse Start Metal Halide	284.1	\$566
	LED Exterior Fixtures, 15,001-30,000 lumens	183.9	400W Pulse Start Metal Halide	454.5	\$946
	LED Exterior Fixtures, 30,001-40,000 lumens	250	750 W Metal Halide	850	\$700
	LED Exterior Fixtures, 40,001-50,000 lumens	295	1000 W Metal Halide	1080	\$850
	LED Exterior Fixtures, > 50,000 lumens	435	1500 W Metal Halide	1610	\$1100

**LED Fixture Component Costs & Lifetime<sup>913</sup>**

LED Category	EE Measure Description	EE Measure				Baseline			
		Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
LED Downlight Fixtures	LED Recessed, Surface, Pendant Downlights	50,000	\$30.75	70,000	\$47.50	2,500	\$8.86	40,000	\$14.40
LED Interior Directional	LED Track Lighting	50,000	\$39.00	70,000	\$47.50	2,500	\$12.71	40,000	\$11.00
	LED Wall-Wash Fixtures	50,000	\$39.00	70,000	\$47.50	2,500	\$9.17	40,000	\$27.00
LED Display Case	LED Display Case Light Fixture	50,000	\$9.75/ft	70,000	\$11.88/ft	2,500	\$6.70	40,000	\$5.63
	LED Undercabinet Shelf-Mounted Task Light Fixtures	50,000	\$9.75/ft	70,000	\$11.88/ft	2,500	\$6.70	40,000	\$5.63
	LED Refrigerated Case Light, Horizontal or Vertical	50,000	\$8.63/ft	70,000	\$9.50/ft	15,000	\$1.13	40,000	\$8.00

<sup>913</sup> Note that some measures have blended baselines (T12:T8 18:82). All values are provided to enable calculation of appropriate O&M impacts. Total costs include lamp, labor and disposal cost assumptions where applicable, see IL LED Lighting Systems TRM Reference Tables\_2018.xlsx for more information.

LED Category	EE Measure Description	EE Measure				Baseline			
		Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
	LED Freezer Case Light, Horizontal or Vertical	50,000	\$7.88/ft	70,000	\$7.92/ft	12,000	\$0.94	40,000	\$6.67
LED Linear Replacement Lamps	T8 LED Replacement Lamp (TLED), < 1200 lumens	50,000	\$5.76	70,000	\$13.67	30,000	\$6.17	40,000	\$11.96
	T8 LED Replacement Lamp (TLED), 1200-2400 lumens	50,000	\$8.57	70,000	\$13.67	24,000	\$6.17	40,000	\$11.96
	T8 LED Replacement Lamp (TLED), > 2400 lumens	50,000	\$8.57	70,000	\$13.67	18,000	\$6.17	40,000	\$11.96
LED Troffers	LED 2x2 Recessed Light Fixture, 2000-3500 lumens	50,000	\$78.07	70,000	\$40.00	24,000	\$26.33	40,000	\$35.00
	LED 2x2 Recessed Light Fixture, 3501-5000 lumens	50,000	\$89.23	70,000	\$40.00	24,000	\$39.50	40,000	\$35.00
	LED 2x4 Recessed Light Fixture, 3000-4500 lumens	50,000	\$96.10	70,000	\$40.00	24,000	\$12.33	40,000	\$35.00
	LED 2x4 Recessed Light Fixture, 4501-6000 lumens	50,000	\$114.37	70,000	\$40.00	24,000	\$18.50	40,000	\$35.00
	LED 2x4 Recessed Light Fixture, 6001-7500 lumens	50,000	\$137.43	70,000	\$40.00	24,000	\$24.67	40,000	\$35.00
	LED 1x4 Recessed Light Fixture, 1500-3000 lumens	50,000	\$65.43	70,000	\$40.00	24,000	\$6.17	40,000	\$35.00
	LED 1x4 Recessed Light Fixture, 3001-4500 lumens	50,000	\$100.44	70,000	\$40.00	24,000	\$12.33	40,000	\$35.00
	LED 1x4 Recessed Light Fixture,	50,000	\$108.28	70,000	\$40.00	24,000	\$18.50	40,000	\$35.00

LED Category	EE Measure Description	EE Measure				Baseline			
		Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
	4501-6000 lumens								
LED Linear Ambient Fixtures	LED Surface & Suspended Linear Fixture, <= 3000 lumens	50,000	\$62.21	70,000	\$40.00	24,000	\$6.17	40,000	\$35.00
	LED Surface & Suspended Linear Fixture, 3001-4500 lumens	50,000	\$93.22	70,000	\$40.00	24,000	\$12.33	40,000	\$35.00
	LED Surface & Suspended Linear Fixture, 4501-6000 lumens	50,000	\$114.06	70,000	\$40.00	24,000	\$18.50	40,000	\$35.00
	LED Surface & Suspended Linear Fixture, 6001-7500 lumens	50,000	\$152.32	70,000	\$40.00	30,000	\$26.33	40,000	\$60.00
	LED Surface & Suspended Linear Fixture, > 7500 lumens	50,000	\$183.78	70,000	\$40.00	30,000	\$39.50	40,000	\$60.00
LED High & Low Bay Fixtures	LED Low-Bay Fixtures, <= 10,000 lumens	50,000	\$90.03	70,000	\$62.50	18,000	\$64.50	40,000	\$92.50
	LED High-Bay Fixtures, 10,001-15,000 lumens	50,000	\$122.59	70,000	\$62.50	18,000	\$86.00	40,000	\$92.50
	LED High-Bay Fixtures, 15,001-20,000 lumens	50,000	\$157.22	70,000	\$62.50	18,000	\$129.00	40,000	\$117.50
	LED High-Bay Fixtures, 20,001 – 30,000 lumens	50,000	\$228.52	70,000	\$62.50	18,000	\$172.00	40,000	\$142.50
	LED High-Bay Fixtures, 30,001-40,000 lumens	50,000	\$294.00	70,000	\$62.50	15,000	\$82.00	40,000	\$143.00
	LED High-Bay Fixtures, 40,001-50,000 lumens	50,000	\$324.00	70,000	\$62.50	15,000	\$88.00	40,000	\$149.00
	LED High-Bay Fixtures, > 50,000 lumens	50,000	\$382.00	70,000	\$62.50	15,000	\$96.00	40,000	\$200.00
LED Agricultura	LED Ag Interior Fixtures, <= 2,000 lumens	50,000	\$41.20	70,000	\$40.00	1,000	\$1.23	40,000	\$26.25

LED Category	EE Measure Description	EE Measure				Baseline			
		Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
Interior Fixtures	LED Ag Interior Fixtures, 2,001-4,000 lumens	50,000	\$65.97	70,000	\$40.00	1,000	\$1.43	40,000	\$26.25
	LED Ag Interior Fixtures, 4,001-6,000 lumens	50,000	\$80.08	70,000	\$40.00	1,000	\$1.62	40,000	\$26.25
	LED Ag Interior Fixtures, 6,001-8,000 lumens	50,000	\$105.54	70,000	\$40.00	1,000	\$1.81	40,000	\$26.25
	LED Ag Interior Fixtures, 8,001-12,000 lumens	50,000	\$179.81	70,000	\$62.50	15,000	\$63.00	40,000	\$112.50
	LED Ag Interior Fixtures, 12,001-16,000 lumens	50,000	\$190.86	70,000	\$62.50	15,000	\$68.00	40,000	\$122.50
	LED Ag Interior Fixtures, 16,001-20,000 lumens	50,000	\$237.71	70,000	\$62.50	15,000	\$73.00	40,000	\$132.50
	LED Ag Interior Fixtures, > 20,000 lumens	50,000	\$331.73	70,000	\$62.50	15,000	\$136.00	40,000	\$202.50
LED Exterior Fixtures	LED Exterior Fixtures, <= 5,000 lumens	50,000	\$73.80	70,000	\$62.50	15,000	\$58.00	40,000	\$102.50
	LED Exterior Fixtures, 5,001-10,000 lumens	50,000	\$124.89	70,000	\$62.50	15,000	\$63.00	40,000	\$112.50
	LED Exterior Fixtures, 10,001-15,000 lumens	50,000	\$214.95	70,000	\$62.50	15,000	\$68.00	40,000	\$122.50
	LED Exterior Fixtures, 15,000-30,000 lumens	50,000	\$321.06	70,000	\$62.50	15,000	\$73.00	40,000	\$132.50
	LED Exterior Fixtures, 30,001-40,000 lumens	50,000	\$546.00	70,000	\$62.50	15,000	\$82.00	40,000	\$143.00
	LED Exterior Fixtures, 40,001-50,000 lumens	50,000	\$722.00	70,000	\$62.50	15,000	\$88.00	40,000	\$149.00
	LED Exterior Fixtures, > 50,000 lumens	50,000	\$870.00	70,000	\$62.50	15,000	\$96.00	40,000	\$200.00

**MEASURE CODE: CI-LTG-LEDB-V12-210101**

**REVIEW DEADLINE: 1/1/2022**



### 4.5.5 Commercial LED Exit Signs

**DESCRIPTION**

This measure characterizes the savings associated with installing a Light Emitting Diode (LED) exit sign in place of a fluorescent or incandescent exit sign in a Commercial building. Light Emitting Diode exit signs have a string of very small, typically red or green, glowing LEDs arranged in a circle or oval. The LEDs may also be arranged in a line on the side, top or bottom of the exit sign. LED exit signs provide the best balance of safety, low maintenance, and very low energy usage compared to other exit sign technologies.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient equipment is assumed to be an exit sign illuminated by LEDs.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment is assumed to be an existing fluorescent or incandescent model.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 5 years.<sup>914</sup>

**DEEMED MEASURE COST**

The actual material and labor costs should be used if available. If actual costs are unavailable, assume a total installed cost of at \$32.50.<sup>915</sup>

**LOADSHAPE**

Loadshape C53 - Flat

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is assumed to be 100%.<sup>916</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((WattsBase - WattsEE) / 1000) * HOURS * WHF_e$$

Where:

WattsBase = Actual wattage if known, if unknown assume the following:

Baseline Type	Watts <sub>Base</sub>
Incandescent	35W <sup>917</sup>

<sup>914</sup> Estimate of remaining life of existing unit being replaced.

<sup>915</sup> Price includes new exit sign/fixture and installation. LED exit cost cost/unit is \$22.50 from the NYSERDA Deemed Savings Database and assuming IL labor cost of 15 minutes @ \$40/hr.

<sup>916</sup> Assuming continuous operation of an LED exit sign, the Summer Peak Coincidence Factor is assumed to equal 1.0.

<sup>917</sup> Based on review of available product.

Baseline Type	Watts <sub>Base</sub>
CFL (dual sided)	14W <sup>918</sup>
CFL (single sided)	7W
Unknown	7W

Watts<sub>EE</sub> = Actual wattage if known, if unknown assume 2W for single sided or unknown type and 4W for dual sided<sup>919</sup>

HOURS = Annual operating hours  
= 8766

WHF<sub>e</sub> = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided for each building type in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, replacing incandescent fixture in an office:

$$\Delta kWh = ((35 - 2)/1000) * 8766 * 1.25$$

$$= 362 \text{ kWh}$$

Replacing single sided fluorescent fixture in a hospital:

$$\Delta kWh = ((7 - 2)/1000) * 8766 * 1.35$$

$$= 59.2 \text{ kWh}$$

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{\text{heatpenalty}}^{920} = (((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{Hours} * -\text{IFkWh})$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, replacing incandescent fixture in a heat pump heated office:

$$\Delta kWh_{\text{heatpenalty}} = ((35 - 2)/1000) * 8766 * -0.151$$

$$= -43.7 \text{ kWh}$$

Replacing single sided fluorescent fixture in a heat pump heated hospital:

$$\Delta kWh_{\text{heatpenalty}} = ((7 - 2)/1000) * 8766 * -0.104$$

$$= -4.6 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{WHF}_d * \text{CF}$$

<sup>918</sup> Average CFL single sided (5W, 7W, 9W) from Appendix B 2013-14 Table of Standard Fixture Wattages.

<sup>919</sup> Average LED single sided (2W) from Appendix B 2013-14 Table of Standard Fixture Wattages.

<sup>920</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

Where:

- WHF<sub>d</sub> = Waste heat factor for demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.
- CF = Summer Peak Coincidence Factor for measure  
= 1.0

**For example**, replacing incandescent fixture in an office:

$$\Delta kW = ((35 - 2)/1000) * 1.3 * 1.0$$

$$= 0.043 \text{ kW}$$

Replacing single sided fluorescent fixture in a hospital:

$$\Delta kW = ((7 - 2)/1000) * 1.69 * 1.0$$

$$= 0.0085 \text{ kW}$$

**NATURAL GAS SAVINGS**

Heating Penalty if natural gas heated building (or if heating fuel is unknown):

$$\Delta \text{therms} = ((\text{WattsBase} - \text{WattsEE})/1000) * \text{Hours} * \text{IFTherms}$$

Where:

- IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**For example**, replacing incandescent fixture in an office:

$$\Delta \text{Therms} = ((35 - 2)/1000) * 8766 * -0.016$$

$$= -4.63 \text{ Therms}$$

Replacing single sided fluorescent fixture in a hospital:

$$\Delta \text{Therms} = ((7 - 2)/1000) * 8766 * -0.011$$

$$= -0.48 \text{ Therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

The annual O&M Cost Adjustment savings should be calculated using the following component costs and lifetimes.

Component	Baseline Measures	
	Cost	Life (yrs)
Lamp	\$12.45 <sup>921</sup>	1.37 years <sup>922</sup>

<sup>921</sup> Consistent with assumption for a Standard CFL bulb (\$2.45) with an estimated labor cost of \$10 (assuming \$40/hour and a task time of 15 minutes).

<sup>922</sup> Assumes a lamp life of 12,000 hours and 8766 run hours 12000/8766 = 1.37 years.

**MEASURE CODE: CI-LTG-LEDE-V03-190101**

**REVIEW DEADLINE: 1/1/2024**

## 4.5.6 LED Traffic and Pedestrian Signals

### DESCRIPTION

Traffic and pedestrian signals are retrofitted to be illuminated with light emitting diodes (LED) instead of incandescent lamps. Incentive applies for the replacement or retrofit of existing incandescent traffic signals with new LED traffic and pedestrian signal lamps. Each lamp can have no more than a maximum LED module wattage of 25. Incentives are not available for spare lights. Lights must be hardwired and single lamp replacements are not eligible, with the exception of pedestrian hand signals. Eligible lamps must meet the Energy Star Traffic Signal Specification and the Institute for Transportation Engineers specification for traffic signals.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Refer to the Table titled ‘Traffic Signals Technology Equivalencies’ for efficient technology wattage and savings assumptions.

### DEFINITION OF BASELINE EQUIPMENT

Refer to the Table titled ‘Traffic Signals Technology Equivalencies’ for baseline efficiencies and savings assumptions.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of an LED traffic signal is 10 years. The life in years is calculated by dividing 100,000 hrs (manufacturer’s estimate) by the annual operating hours for the particular signal type and is capped at 10 years.<sup>923</sup>

### DEEMED MEASURE COST

The actual measure installation cost should be used (including material and labor).

### LOADSHAPE

- Loadshape C24 - Traffic Signal - Red Balls, always changing or flashing
- Loadshape C25 - Traffic Signal - Red Balls, changing day, off night
- Loadshape C26 - Traffic Signal - Green Balls, always changing
- Loadshape C27 - Traffic Signal - Green Balls, changing day, off night
- Loadshape C28 - Traffic Signal - Red Arrows
- Loadshape C29 - Traffic Signal - Green Arrows
- Loadshape C30 - Traffic Signal - Flashing Yellows
- Loadshape C31 - Traffic Signal - “Hand” Don’t Walk Signal
- Loadshape C32 - Traffic Signal - “Man” Walk Signal
- Loadshape C33 - Traffic Signal - Bi-Modal Walk/Don’t Walk

### COINCIDENCE FACTOR<sup>924</sup>

The summer peak coincidence factor (CF) for this measure is dependent on lamp type as below:

Lamp Type	CF
Red Round, always changing or flashing	0.55
Red Arrows	0.90

<sup>923</sup> ACEEE, (1998) A Market Transformation Opportunity Assessment for LED Traffic Signals

<sup>924</sup> Ibid.

Lamp Type	CF
Green Arrows	0.10
Yellow Arrows	0.03
Green Round, always changing or flashing	0.43
Flashing Yellow	0.50
Yellow Round, always changing	0.02
“Hand” Don’t Walk Signal	0.75
“Man” Walk Signal	0.21

---



---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (W_{base} - W_{eff}) \times \text{HOURS} / 1000$$

Where:

- Wbase = The connected load of the baseline equipment  
= see Table ‘Traffic Signals Technology Equivalencies’
- Weff = The connected load of the baseline equipment  
= see Table ‘Traffic Signals Technology Equivalencies’
- HOURS = annual operating hours of the lamp  
= see Table ‘Traffic Signals Technology Equivalencies’
- 1000 = conversion factor (W/kW)

**For example**, an 8 inch red, round signal:

$$\begin{aligned} \Delta kWh &= ((69 - 7) \times 4818) / 1000 \\ &= 299 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (W_{base} - W_{eff}) \times CF / 1000$$

Where:

- Wbase = The connected load of the baseline equipment  
= see Table ‘Traffic Signals Technology Equivalencies’
- Weff = The connected load of the efficient equipment  
= see Table ‘Traffic Signals Technology Equivalencies’
- CF = Summer Peak Coincidence Factor for measure

**For example**, an 8 inch red, round signal:

$$\begin{aligned} \Delta kW &= ((69 - 7) \times 0.55) / 1000 \\ &= 0.0341 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**REFERENCE TABLES**

Traffic Signals Technology Equivalencies<sup>925</sup>

Traffic Fixture Type	Fixture Size and Color	Efficient Lamps	Baseline Lamps	HOURS	Efficient Fixture Wattage	Baseline Fixture Wattage	Energy Savings (in kWh)
Round Signals	8" Red	LED	Incandescent	4818	7	69	299
Round Signals	12" Red	LED	Incandescent	4818	6	150	694
Flashing Signal <sup>926</sup>	8" Red	LED	Incandescent	4380	7	69	272
Flashing Signal	12" Red	LED	Incandescent	4380	6	150	631
Flashing Signal	8" Yellow	LED	Incandescent	4380	10	69	258
Flashing Signal	12" Yellow	LED	Incandescent	4380	13	150	600
Round Signals	8" Yellow	LED	Incandescent	175	10	69	10
Round Signals	12" Yellow	LED	Incandescent	175	13	150	24
Round Signals	8" Green	LED	Incandescent	3767	9	69	266
Round Signals	12" Green	LED	Incandescent	3767	12	150	520
Turn Arrows	8" Yellow	LED	Incandescent	701	7	116	76
Turn Arrows	12" Yellow	LED	Incandescent	701	9	116	75
Turn Arrows	8" Green	LED	Incandescent	701	7	116	76
Turn Arrows	12" Green	LED	Incandescent	701	7	116	76
Pedestrian Sign	12" Hand/Man	LED	Incandescent	8766	8	116	946

Reference specifications for above traffic signal wattages are from the following manufacturers:

1. 8" Incandescent traffic signal bulb: General Electric Traffic Signal Model 17325-69A21/TS
2. 12" Incandescent traffic signal bulb: General Electric Signal Model 35327-150PAR46/TS
3. Incandescent Arrows & Hand/Man Pedestrian Signs: General Electric Traffic Signal Model 19010-116A21/TS
4. 8" and 12" LED traffic signals: Leotek Models TSL-ES08 and TSL-ES12
5. 8" LED Yellow Arrow: General Electric Model DR4-YTA2-01A
6. 8" LED Green Arrow: General Electric Model DR4-GCA2-01A
7. 12" LED Yellow Arrow: Dialight Model 431-3334-001X
8. 12: LED Green Arrow: Dialight Model 432-2324-001X
9. LED Hand/Man Pedestrian Sign: Dialight 430-6450-001X

**MEASURE CODE: CI-LTG-LEDT-V02-200601**

**REVIEW DEADLINE: 1/1/2024**

<sup>925</sup> Technical Reference Manual for Pennsylvania Act 129 Energy Efficiency and Conservation Program and Act 213 Alternative Energy Portfolio Standards. Pennsylvania Public Utility Commission. May 2009.

<sup>926</sup> Technical Reference Manual for Ohio, August 6, 2010.

## 4.5.7 Lighting Power Density

### DESCRIPTION

This measure relates to installation of efficient lighting systems in new construction or substantial renovation of commercial buildings excluding low rise (three stories or less) residential buildings. Substantial renovation is when two or more building systems are renovated, such as shell and heating, heating and lighting, etc. State Energy Code specifies a lighting power density level by building type for both the interior and the exterior. Either the Building Area Method or Space by Space method as defined in IECC 2012, 2015 or 2018, depending on the IECC in effect on the date of the building permit (if unknown assume IECC 2015), can be used for calculating the Interior Lighting Power Density.<sup>927</sup> The measure consists of a design that is more efficient (has a lower lighting power density in watts/square foot) than code requires. The IECC applies to both new construction and renovation.

This measure was developed to be applicable to the following program types: NC.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the lighting system must be more efficient than the baseline Energy Code lighting power density in watts/square foot for either the interior space or exterior space.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is assumed to be a lighting power density that meets the IECC in effect on the date of the building permit (if unknown assume IECC 2015).

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

### DEEMED CALCULATION FOR THIS MEASURE

Annual kWh Savings

$$\Delta \text{kWh} = (\text{WSF}_{\text{base}} - \text{WSF}_{\text{effic}}) / 1000 * \text{SF} * \text{Hours} * \text{WHF}_e$$

Summer Coincident Peak kW Savings

$$\Delta \text{kW} = (\text{WSF}_{\text{base}} - \text{WSF}_{\text{effic}}) / 1000 * \text{SF} * \text{CF} * \text{WHF}_d$$

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.<sup>928</sup>

### DEEMED MEASURE COST

The actual incremental cost over a baseline system will be collected from the customer if possible or developed on a fixture by fixture basis.

### LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting

Loadshape C07 - Grocery/Conv. Store Indoor Lighting

Loadshape C08 - Hospital Indoor Lighting

Loadshape C09 - Office Indoor Lighting

---

<sup>927</sup> Refer to the referenced code documents for specifics on calculating lighting power density using either the whole building method or the Space by Space method.

<sup>928</sup> Measure Life Report, Residential and Commercial/Industrial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.



- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the building type.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ENERGY SAVINGS**

$$\Delta kWh = (WSF_{base} - WSF_{effic}) / 1000 * SF * Hours * WHF_e$$

Where:

- WSF<sub>base</sub> = Baseline lighting watts per square foot or linear foot as determined by building or space type. Whole building analysis values are presented in the Reference Tables below.<sup>929</sup>
- WSF<sub>effic</sub> = The actual installed lighting watts per square foot or linear foot.
- SF = Provided by customer based on square footage of the building area applicable to the lighting design for new building.
- Hours = Annual site-specific hours of operation of the lighting equipment collected from the customer. If not available, use building area type as provided in the Reference Table in Section 4.5, Fixture annual operating hours.
- WHF<sub>e</sub> = Waste Heat Factor for Energy to account for cooling savings from efficient lighting is as provided in the Reference Table in Section 4.5 by building type. If building is not cooled WHF<sub>e</sub> is 1.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{heatpenalty}^{930} = (WSF_{base} - WSF_{effic}) / 1000 * SF * Hours * -IFkWh$$

Where:

- IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected

---

<sup>929</sup>See Reference Code documentation for additional information.

<sup>930</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (WSF_{base} - WSF_{effic}) / 1000 * SF * CF * WHF_d$$

Where:

WHF<sub>d</sub> = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is as provided in the Reference Table in Section 4.5 by building type. If building is not cooled WHF<sub>d</sub> is 1.

CF = Summer Peak Coincidence Factor for measure is as provided in the Reference Table in Section 4.5 by building type. If the building type is unknown, use the Miscellaneous value of 0.66.

Other factors as defined above

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{Therms} = (WSF_{base} - WSF_{effic}) / 1000 * SF * \text{Hours} * - \text{IFTtherms}$$

Where:

IFTtherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. This value is provided in the Reference Table in Section 4.5 by building type.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**REFERENCE TABLES**

Lighting Power Density Values from IECC 2012, 2015 and 2018 for Interior Commercial New Construction and Substantial Renovation Building Area Method:

Building Area Type <sup>931</sup>	IECC 2012 Lighting Power Density (w/ft <sup>2</sup> )	IECC 2015 Lighting Power Density (w/ft <sup>2</sup> )	IECC 2018 Lighting Power Density (w/ft <sup>2</sup> )
Automotive Facility	0.9	0.80	0.71
Convention Center	1.2	1.01	0.76
Court House	1.2	1.01	0.9
Dining: Bar Lounge/Leisure	1.3	1.01	0.9
Dining: Cafeteria/Fast Food	1.4	0.9	0.79
Dining: Family	1.6	0.95	0.78
Dormitory	1.0	0.57	0.61
Exercise Center	1.0	0.84	0.65
Fire station	0.8	0.67	0.53
Gymnasium	1.1	0.94	0.68

<sup>931</sup> In cases where both a general building area type and a more specific building area type are listed, the more specific building area type shall apply.

Building Area Type <sup>931</sup>	IECC 2012 Lighting Power Density (w/ft <sup>2</sup> )	IECC 2015 Lighting Power Density (w/ft <sup>2</sup> )	IECC 2018 Lighting Power Density (w/ft <sup>2</sup> )
Healthcare – clinic	1.0	0.90	0.82
Hospital	1.2	1.05	1.05
Hotel	1.0	0.87	0.75
Library	1.3	1.19	0.78
Manufacturing Facility	1.3	1.17	0.90
Motel	1.0	0.87	0.75
Motion Picture Theater	1.2	0.76	0.83
Multifamily	0.7	0.51	0.68
Museum	1.1	1.02	1.06
Office	0.9	0.82	0.79
Parking Garage	0.3	0.21	0.15
Penitentiary	1.0	0.81	0.75
Performing Arts Theater	1.6	1.39	1.18
Police Station	1.0	0.87	0.80
Post Office	1.1	0.87	0.67
Religious Building	1.3	1.0	0.94
Retail <sup>932</sup>	1.4	1.26	1.06
School/University	1.2	0.87	0.81
Sports Arena	1.1	0.91	0.87
Town Hall	1.1	0.89	0.80
Transportation	1.0	0.70	0.61
Warehouse	0.6	0.66	0.48
Workshop	1.4	1.19	0.90

<sup>932</sup> Where lighting equipment is specified to be installed to highlight specific merchandise in addition to lighting equipment specified for general lighting and is switched or dimmed on circuits different from the circuits for general lighting, the small of the actual wattage of the lighting equipment installed specifically for merchandise, or additional lighting power as determined below shall be added to the interior lighting power determined in accordance with this line item.

Lighting Power Density Values from IECC 2018 for Interior Commercial New Construction and Substantial Renovation Building Area Method:

TABLE C405.3.2(1)  
INTERIOR LIGHTING POWER ALLOWANCES: BUILDING AREA METHOD

BUILDING AREA TYPE	LPD (w/ft <sup>2</sup> )
Automotive facility	0.71
Convention center	0.76
Courthouse	0.90
Dining: bar lounge/leisure	0.90
Dining: cafeteria/fast food	0.79
Dining: family	0.78
Dormitory <sup>a, b</sup>	0.61
Exercise center	0.65
Fire station <sup>a</sup>	0.53
Gymnasium	0.68
Health care clinic	0.82
Hospital <sup>a</sup>	1.05
Hotel/Motel <sup>a, b</sup>	0.75
Library	0.78
Manufacturing facility	0.90
Motion picture theater	0.83
Multifamily <sup>c</sup>	0.68
Museum	1.06
Office	0.79
Parking garage	0.15
Penitentiary	0.75
Performing arts theater	1.18
Police station	0.80
Post office	0.67
Religious building	0.94
Retail	1.06
School/university	0.81
Sports arena	0.87
Town hall	0.80
Transportation	0.61
Warehouse	0.48
Workshop	0.90

a. Where sleeping units are excluded from lighting power calculations by application of Section R405.1, neither the area of the sleeping units nor the wattage of lighting in the sleeping units is counted.

b. Where dwelling units are excluded from lighting power calculations by application of Section R405.1, neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.

c. Dwelling units are excluded. Neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.

Lighting Power Density Values from IECC 2012 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

COMMERCIAL ENERGY EFFICIENCY

**TABLE C405.5.2(2)  
INTERIOR LIGHTING POWER ALLOWANCES:  
SPACE-BY-SPACE METHOD**

COMMON SPACE-BY-SPACE TYPES	LPD (w/ft <sup>2</sup> )
Atrium – First 40 feet in height	0.03 per ft. ht.
Atrium – Above 40 feet in height	0.02 per ft. ht.
Audience/seating area – permanent	
For auditorium	0.9
For performing arts theater	2.6
For motion picture theater	1.2
Classroom/lecture/training	1.30
Conference/meeting/multipurpose	1.2
Corridor/transition	0.7
Dining area	
Bar/lounge/leisure dining	1.40
Family dining area	1.40
Dressing/fitting room performing arts theater	1.1
Electrical/mechanical	1.10
Food preparation	1.20
Laboratory for classrooms	1.3
Laboratory for medical/industrial/research	1.8
Lobby	1.10
Lobby for performing arts theater	3.3
Lobby for motion picture theater	1.0
Locker room	0.80
Lounge recreation	0.8
Office – enclosed	1.1
Office – open plan	1.0
Restroom	1.0
Sales area	1.6 <sup>a</sup>
Stairway	0.70
Storage	0.8
Workshop	1.60
Courthouse/police station/penitentiary	
Courtroom	1.90
Confinement cells	1.1
Judge chambers	1.30
Penitentiary audience seating	0.5
Penitentiary classroom	1.3
Penitentiary dining	1.1
<b>BUILDING SPECIFIC SPACE-BY-SPACE TYPES</b>	
Automotive – service/repair	0.70
Bank/office – banking activity area	1.5
Dormitory living quarters	1.10
Gymnasium/fitness center	
Fitness area	0.9
Gymnasium audience/seating	0.40
Playing area	1.40

(continued)

**TABLE C405.5.2(2)—continued  
INTERIOR LIGHTING POWER ALLOWANCES:  
SPACE-BY-SPACE METHOD**

COMMON SPACE-BY-SPACE TYPES	LPD (w/ft <sup>2</sup> )
Healthcare clinic/hospital	
Corridors/transition	1.00
Exam/treatment	1.70
Emergency	2.70
Public and staff lounge	0.80
Medical supplies	1.40
Nursery	0.9
Nurse station	1.00
Physical therapy	0.90
Patient room	0.70
Pharmacy	1.20
Radiology/imaging	1.3
Operating room	2.20
Recovery	1.2
Lounge/recreation	0.8
Laundry – washing	0.60
Hotel	
Dining area	1.30
Guest rooms	1.10
Hotel lobby	2.10
Highway lodging dining	1.20
Highway lodging guest rooms	1.10
Library	
Stacks	1.70
Card file and cataloguing	1.10
Reading area	1.20
Manufacturing	
Corridors/transition	0.40
Detailed manufacturing	1.3
Equipment room	1.0
Extra high bay (> 50-foot floor-ceiling height)	1.1
High bay (25- – 50-foot floor-ceiling height)	1.20
Low bay (< 25-foot floor-ceiling height)	1.2
Museum	
General exhibition	1.00
Restoration	1.70
Parking garage – garage areas	0.2
Convention center	
Exhibit space	1.50
Audience/seating area	0.90
Fire stations	
Engine room	0.80
Sleeping quarters	0.30
Post office	
Sorting area	0.9
Religious building	
Fellowship hall	0.60
Audience seating	2.40
Worship pulpit/choir	2.40
Retail	
Dressing/fitting area	0.9
Mall concourse	1.6
Sales area	1.6 <sup>a</sup>

(continued)

**TABLE C405.5.2(2)—continued  
 INTERIOR LIGHTING POWER ALLOWANCES:  
 SPACE-BY-SPACE METHOD**

BUILDING SPECIFIC SPACE-BY-SPACE TYPES	LPD (w/ft <sup>2</sup> )
Sports arena	
Audience seating	0.4
Court sports area – Class 4	0.7
Court sports area – Class 3	1.2
Court sports area – Class 2	1.9
Court sports area – Class 1	3.0
Ring sports area	2.7
Transportation	
Air/train/bus baggage area	1.00
Airport concourse	0.60
Terminal – ticket counter	1.50
Warehouse	
Fine material storage	1.40
Medium/bulky material	0.60

Lighting Power Density Values from IECC 2015 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

**TABLE C405.4.2(2)  
INTERIOR LIGHTING POWER ALLOWANCES:  
SPACE-BY-SPACE METHOD**

COMMON SPACE TYPES <sup>a</sup>	LPD (watts/sq.ft)
<b>Atrium</b>	
Less than 40 feet in height	0.03 per foot in total height
Greater than 40 feet in height	0.40 + 0.02 per foot in total height
<b>Audience seating area</b>	
In an auditorium	0.63
In a convention center	0.82
In a gymnasium	0.65
In a motion picture theater	1.14
In a penitentiary	0.28
In a performing arts theater	2.43
In a religious building	1.53
In a sports arena	0.43
Otherwise	0.43
Banking activity area	1.01
<b>Breakroom (See Lounge/Breakroom)</b>	
<b>Classroom/lecture hall/training room</b>	
In a penitentiary	1.34
Otherwise	1.24
Conference/meeting/multipurpose room	1.23
Copy/print room	0.72
<b>Corridor</b>	
In a facility for the visually impaired (and not used primarily by the staff) <sup>b</sup>	0.92
In a hospital	0.79
In a manufacturing facility	0.41
Otherwise	0.66
Courtroom	1.72
Computer room	1.71
<b>Dining area</b>	
In a penitentiary	0.96
In a facility for the visually impaired (and not used primarily by the staff) <sup>b</sup>	1.9
In bar/lounge or leisure dining	1.07
In cafeteria or fast food dining	0.65
In family dining	0.89
Otherwise	0.65
Electrical/mechanical room	0.95
Emergency vehicle garage	0.56

(continued)

**TABLE C405.4.2(2)—continued  
INTERIOR LIGHTING POWER ALLOWANCES:  
SPACE-BY-SPACE METHOD**

COMMON SPACE TYPES <sup>a</sup>	LPD (watts/sq.ft)
Food preparation area	1.21
Guest room	0.47
<b>Laboratory</b>	
In or as a classroom	1.43
Otherwise	1.81
Laundry/washing area	0.6
Loading dock, interior	0.47
<b>Lobby</b>	
In a facility for the visually impaired (and not used primarily by the staff) <sup>b</sup>	1.8
For an elevator	0.64
In a hotel	1.06
In a motion picture theater	0.59
In a performing arts theater	2.0
Otherwise	0.9
Locker room	0.75
<b>Lounge/breakroom</b>	
In a healthcare facility	0.92
Otherwise	0.73
<b>Office</b>	
Enclosed	1.11
Open plan	0.98
Parking area, interior	0.19
Pharmacy area	1.68
<b>Restroom</b>	
In a facility for the visually impaired (and not used primarily by the staff) <sup>b</sup>	1.21
Otherwise	0.98
Sales area	1.59
Seating area, general	0.54
<b>Stairway (See space containing stairway)</b>	
Stairwell	0.69
Storage room	0.63
Vehicular maintenance area	0.67
Workshop	1.59
BUILDING TYPE SPECIFIC SPACE TYPES <sup>a</sup>	LPD (watts/sq.ft)
<b>Facility for the visually impaired<sup>b</sup></b>	
In a chapel (and not used primarily by the staff)	2.21
In a recreation room (and not used primarily by the staff)	2.41
<b>Automotive (See Vehicular Maintenance Area above)</b>	
Convention Center—exhibit space	1.45
Dormitory—living quarters	0.38
Fire Station—sleeping quarters	0.22
<b>Gymnasium/fitness center</b>	
In an exercise area	0.72
In a playing area	1.2

(continued)

**TABLE C405.4.2(2)—continued  
INTERIOR LIGHTING POWER ALLOWANCES:  
SPACE-BY-SPACE METHOD**

BUILDING TYPE SPECIFIC SPACE TYPES <sup>a</sup>	LPD (watts/sq.ft)
<b>healthcare facility</b>	
In an exam/treatment room	1.66
In an imaging room	1.51
In a medical supply room	0.74
In a nursery	0.88
In a nurse's station	0.71
In an operating room	2.48
In a patient room	0.62
In a physical therapy room	0.91
In a recovery room	1.15
<b>Library</b>	
In a reading area	1.06
In the stacks	1.71
<b>Manufacturing facility</b>	
In a detailed manufacturing area	1.29
In an equipment room	0.74
In an extra high bay area (greater than 50' floor-to-ceiling height)	1.05
In a high bay area (25-50' floor-to-ceiling height)	1.23
In a low bay area (less than 25' floor-to-ceiling height)	1.19
<b>Museum</b>	
In a general exhibition area	1.05
In a restoration room	1.02
Performing arts theater—dressing room	0.61
Post Office—Sorting Area	0.94
<b>Religious buildings</b>	
In a fellowship hall	0.64
In a worship/pulpit/choir area	1.53
<b>Retail facilities</b>	
In a dressing/fitting room	0.71
In a mall concourse	1.1
<b>Sports arena—playing area</b>	
For a Class I facility	3.68
For a Class II facility	2.4
For a Class III facility	1.8
For a Class IV facility	1.2
<b>Transportation facility</b>	
In a baggage/carousel area	0.53
In an airport concourse	0.36
At a terminal ticket counter	0.8
<b>Warehouse—storage area</b>	
For medium to bulky, palletized items	0.58
For smaller, hand-carried items	0.95

- a. In cases where both a common space type and a building area specific space type are listed, the building area specific space type shall apply
- b. A 'Facility for the Visually Impaired' is a facility that is licensed or will be licensed by local or state authorities for senior long-term care, adult daycare, senior support or people with special visual needs.



Lighting Power Density Values from IECC 2018 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

TABLE C405.3.2(2)  
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES <sup>a</sup>	LPD (watts/sq.ft)
Atrium	
Less than 40 feet in height	0.03 per foot in total height
Greater than 40 feet in height	0.40 + 0.02 per foot in total height
Audience seating area	
In an auditorium	0.63
In a convention center	0.82
In a gymnasium	0.65
In a motion picture theater	1.14
In a penitentiary	0.28
In a performing arts theater	2.03
In a religious building	1.53
In a sports arena	0.43
Otherwise	0.43
Banking activity area	0.86
Breakroom (See Lounge/breakroom)	
Classroom/lecture hall/training room	
In a penitentiary	1.34
Otherwise	0.96
Computer room	1.33
Conference/meeting/multipurpose room	1.07
Copy/print room	0.56
Corridor	
In a facility for the visually impaired (and not used primarily by the staff) <sup>b</sup>	0.92
In a hospital	0.92
In a manufacturing facility	0.29
Otherwise	0.66
Courtroom	1.39
Dining area	
In bar/lounge or leisure dining	0.93
In cafeteria or fast food dining	0.63
In a facility for the visually impaired (and not used primarily by the staff) <sup>b</sup>	2.00
In family dining	0.71
In a penitentiary	0.96
Otherwise	0.63
Electrical/mechanical room	0.43
Emergency vehicle garage	0.41
Food preparation area	1.08
Guestroom <sup>c, d</sup>	0.77
Laboratory	
In or as a classroom	1.20
Otherwise	1.45

Laundry/washing area	0.43
Loading dock, interior	0.58
Lobby	
For an elevator	0.68
In a facility for the visually impaired (and not used primarily by the staff) <sup>D</sup>	2.03
In a hotel	1.06
In a motion picture theater	0.45
In a performing arts theater	1.70
Otherwise	1.0
Locker room	0.48
Lounge/breakroom	
In a healthcare facility	0.78
Otherwise	0.62
Office	
Enclosed	0.93
Open plan	0.81
Parking area, interior	0.14
Pharmacy area	1.34
Restroom	
In a facility for the visually impaired (and not used primarily by the staff) <sup>D</sup>	0.96
Otherwise	0.85
Sales area	1.22
Seating area, general	0.42
Stairway (see Space containing stairway)	
Stairwell	0.58
Storage room	0.46
Vehicular maintenance area	0.58
Workshop	1.14

BUILDING TYPE SPECIFIC SPACE TYPES <sup>a</sup>	LPD (watts/sq.ft)
Automotive (see Vehicular maintenance area)	
Convention Center—exhibit space	0.88
Dormitory—living quarters <sup>c, d</sup>	0.54
Facility for the visually impaired <sup>b</sup>	
In a chapel (and not used primarily by the staff)	1.08
In a recreation room (and not used primarily by the staff)	1.80
Fire Station—sleeping quarters <sup>c</sup>	0.20
Gymnasium/fitness center	
In an exercise area	0.50
In a playing area	0.82
Healthcare facility	
In an exam/treatment room	1.88
In an imaging room	1.08
In a medical supply room	0.54
In a nursery	1.00
In a nurse's station	0.81
In an operating room	2.17
In a patient room <sup>c</sup>	0.62
In a physical therapy room	0.84
In a recovery room	1.03
Library	
In a reading area	0.82
In the stacks	1.20
Manufacturing facility	
In a detailed manufacturing area	0.93
In an equipment room	0.65
In an extra-high-bay area (greater than 50' floor-to-ceiling height)	1.05
In a high-bay area (25-50' floor-to-ceiling height)	0.75
In a low-bay area (less than 25' floor-to-ceiling height)	0.96
Museum	
In a general exhibition area	1.05
In a restoration room	0.85
Performing arts theater—dressing room	0.38
Post office—sorting area	0.68
Religious buildings	
In a fellowship hall	0.55
In a worship/pulpit/choir area	1.53

Retail facilities	
In a dressing/fitting room	0.50
In a mall concourse	0.90
Sports arena—playing area	
For a Class I facility <sup>a</sup>	2.47
For a Class II facility <sup>f</sup>	1.98
For a Class III facility <sup>g</sup>	1.70
For a Class IV facility <sup>h</sup>	1.13
Transportation facility	
In a baggage/carousel area	0.45
In an airport concourse	0.31
At a terminal ticket counter	0.82
Warehouse—storage area	
For medium to bulky, palletized items	0.35
For smaller, hand-carried items	0.89

- a. In cases where both a common space type and a building area specific space type are listed, the building area specific space type shall apply.
- b. A 'Facility for the Visually Impaired' is a facility that is licensed or will be licensed by local or state authorities for senior long-term care, adult daycare, senior support or people with special visual needs.
- c. Where sleeping units are excluded from lighting power calculations by application of Section R405.1, neither the area of the sleeping units nor the wattage of lighting in the sleeping units is counted.
- d. Where dwelling units are excluded from lighting power calculations by application of Section R405.1, neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.
- e. Class I facilities consist of professional facilities; and semiprofessional, collegiate, or club facilities with seating for 5,000 or more spectators.
- f. Class II facilities consist of collegiate and semiprofessional facilities with seating for fewer than 5,000 spectators; club facilities with seating for between 2,000 and 5,000 spectators; and amateur league and high-school facilities with seating for more than 2,000 spectators.
- g. Class III facilities consist of club, amateur league and high-school facilities with seating for 2,000 or fewer spectators.
- h. Class IV facilities consist of elementary school and recreational facilities; and amateur league and high-school facilities without provision for spectators.

The exterior lighting design will be based on the building location and the applicable “Lighting Zone” as defined in IECC 2015 Table C405.5.2(1) which follows. This table is identical to IECC 2012 Table C405.62(1) and IECC 2018 Table C405.4.2(1).

**TABLE C405.5.2(1)  
EXTERIOR LIGHTING ZONES**

LIGHTING ZONE	DESCRIPTION
1	Developed areas of national parks, state parks, forest land, and rural areas
2	Areas predominantly consisting of residential zoning, neighborhood business districts, light industrial with limited nighttime use and residential mixed-use areas
3	All other areas not classified as lighting zone 1, 2 or 4
4	High-activity commercial districts in major metropolitan areas as designated by the local land use planning authority

The lighting power density savings will be based on reductions below the allowable design levels as specified in IECC 2012 Table C405.6.2(2) or IECC 2015 Table C405.5.2(2).

Allowable Design Levels from IECC 2012

**TABLE C405.6.2(2)  
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS**

		LIGHTING ZONES			
		Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance (Base allowance is usable in tradable or nontradable surfaces.)		500 W	600 W	750 W	1300 W
<b>Uncovered Parking Areas</b>					
	Parking areas and drives	0.04 W/ft <sup>2</sup>	0.06 W/ft <sup>2</sup>	0.10 W/ft <sup>2</sup>	0.13 W/ft <sup>2</sup>
<b>Building Grounds</b>					
	Walkways less than 10 feet wide	0.7 W/linear foot	0.7 W/linear foot	0.8 W/linear foot	1.0 W/linear foot
	Walkways 10 feet wide or greater, plaza areas special feature areas	0.14 W/ft <sup>2</sup>	0.14 W/ft <sup>2</sup>	0.16 W/ft <sup>2</sup>	0.2 W/ft <sup>2</sup>
	Stairways	0.75 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>
	Pedestrian tunnels	0.15 W/ft <sup>2</sup>	0.15 W/ft <sup>2</sup>	0.2 W/ft <sup>2</sup>	0.3 W/ft <sup>2</sup>
<b>Building Entrances and Exits</b>					
	Main entries	20 W/linear foot of door width	20 W/linear foot of door width	30 W/linear foot of door width	30 W/linear foot of door width
	Other doors	20 W/linear foot of door width	20 W/linear foot of door width	20 W/linear foot of door width	20 W/linear foot of door width
	Entry canopies	0.25 W/ft <sup>2</sup>	0.25 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>
<b>Sales Canopies</b>					
	Free-standing and attached	0.6 W/ft <sup>2</sup>	0.6 W/ft <sup>2</sup>	0.8 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>
<b>Outdoor Sales</b>					
	Open areas (including vehicle sales lots)	0.25 W/ft <sup>2</sup>	0.25 W/ft <sup>2</sup>	0.5 W/ft <sup>2</sup>	0.7 W/ft <sup>2</sup>
	Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	10 W/linear foot	10 W/linear foot	30 W/linear foot
Nontradable Surfaces (Lighting power density calculations for the following applications can be used only for the specific application and cannot be traded between surfaces or with other exterior lighting. The following allowances are in addition to any allowance otherwise permitted in the "Tradable Surfaces" section of this table.)	Building facades	No allowance	0.1 W/ft <sup>2</sup> for each illuminated wall or surface or 2.5 W/linear foot for each illuminated wall or surface length	0.15 W/ft <sup>2</sup> for each illuminated wall or surface or 3.75 W/linear foot for each illuminated wall or surface length	0.2 W/ft <sup>2</sup> for each illuminated wall or surface or 5.0 W/linear foot for each illuminated wall or surface length
	Automated teller machines and night depositories	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location
	Entrances and gatehouse inspection stations at guarded facilities	0.75 W/ft <sup>2</sup> of covered and uncovered area	0.75 W/ft <sup>2</sup> of covered and uncovered area	0.75 W/ft <sup>2</sup> of covered and uncovered area	0.75 W/ft <sup>2</sup> of covered and uncovered area
	Loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.5 W/ft <sup>2</sup> of covered and uncovered area	0.5 W/ft <sup>2</sup> of covered and uncovered area	0.5 W/ft <sup>2</sup> of covered and uncovered area	0.5 W/ft <sup>2</sup> of covered and uncovered area
	Drive-up windows/doors	400 W per drive-through	400 W per drive-through	400 W per drive-through	400 W per drive-through
	Parking near 24-hour retail entrances	800 W per main entry	800 W per main entry	800 W per main entry	800 W per main entry

For SI: 1 foot = 304.8 mm, 1 watt per square foot = W/0.0929 m<sup>2</sup>.

Allowable Design Levels from IECC 2015

TABLE C405.5.2(2)  
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

		LIGHTING ZONES			
		Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance (Base allowance is usable in tradable or nontradable surfaces.)		500 W	600 W	750 W	1300 W
Tradable Surfaces (Lighting power densities for uncovered parking areas, building grounds, building entrances and exits, canopies and overhangs and outdoor sales areas are tradable.)	<b>Uncovered Parking Areas</b>				
	Parking areas and drives	0.04 W/ft <sup>2</sup>	0.06 W/ft <sup>2</sup>	0.10 W/ft <sup>2</sup>	0.13 W/ft <sup>2</sup>
	<b>Building Grounds</b>				
	Walkways less than 10 feet wide	0.7 W/linear foot	0.7 W/linear foot	0.8 W/linear foot	1.0 W/linear foot
	Walkways 10 feet wide or greater, plaza areas special feature areas	0.14 W/ft <sup>2</sup>	0.14 W/ft <sup>2</sup>	0.16 W/ft <sup>2</sup>	0.2 W/ft <sup>2</sup>
	Stairways	0.75 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>
	Pedestrian tunnels	0.15 W/ft <sup>2</sup>	0.15 W/ft <sup>2</sup>	0.2 W/ft <sup>2</sup>	0.3 W/ft <sup>2</sup>
	<b>Building Entrances and Exits</b>				
	Main entries	20 W/linear foot of door width	20 W/linear foot of door width	30 W/linear foot of door width	30 W/linear foot of door width
	Other doors	20 W/linear foot of door width	20 W/linear foot of door width	20 W/linear foot of door width	20 W/linear foot of door width
	Entry canopies	0.25 W/ft <sup>2</sup>	0.25 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>
	<b>Sales Canopies</b>				
	Free-standing and attached	0.6 W/ft <sup>2</sup>	0.6 W/ft <sup>2</sup>	0.8 W/ft <sup>2</sup>	1.0 W/ft <sup>2</sup>
	<b>Outdoor Sales</b>				
	Open areas (including vehicle sales lots)	0.25 W/ft <sup>2</sup>	0.25 W/ft <sup>2</sup>	0.5 W/ft <sup>2</sup>	0.7 W/ft <sup>2</sup>
Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	10 W/linear foot	10 W/linear foot	30 W/linear foot	
Nontradable Surfaces (Lighting power density calculations for the following applications can be used only for the specific application and cannot be traded between surfaces or with other exterior lighting. The following allowances are in addition to any allowance otherwise permitted in the "Tradable Surfaces" section of this table.)	Building facades	No allowance	0.075 W/ft <sup>2</sup> of gross above-grade wall area	0.113 W/ft <sup>2</sup> of gross above-grade wall area	0.15 W/ft <sup>2</sup> of gross above-grade wall area
	Automated teller machines (ATM) and night depositories	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location
	Entrances and gatehouse inspection stations at guarded facilities	0.75 W/ft <sup>2</sup> of covered and uncovered area	0.75 W/ft <sup>2</sup> of covered and uncovered area	0.75 W/ft <sup>2</sup> of covered and uncovered area	0.75 W/ft <sup>2</sup> of covered and uncovered area
	Loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.5 W/ft <sup>2</sup> of covered and uncovered area	0.5 W/ft <sup>2</sup> of covered and uncovered area	0.5 W/ft <sup>2</sup> of covered and uncovered area	0.5 W/ft <sup>2</sup> of covered and uncovered area
	Drive-up windows/doors	400 W per drive-through	400 W per drive-through	400 W per drive-through	400 W per drive-through
	Parking near 24-hour retail entrances	800 W per main entry	800 W per main entry	800 W per main entry	800 W per main entry

For SI: 1 foot = 304.8 mm, 1 watt per square foot = W/0.0929 m<sup>2</sup>.  
W = watts.

Allowable Design Levels from IECC 2018

Table C405.2.2(2)  
Lighting Power Allowances for Building Exteriors

	Zone 0	Zone 1	Zone 2	Zone 3	Zone 4
<b>Base Site Allowance</b> (Base allowance may be used in tradable or nontradable surfaces.)					
	No allowance	350 W	400 W	500 W	900 W
<b>Tradable Surfaces</b> (LPD allowances for uncovered parking areas, building grounds, building entrances, exits and loading docks, canopies and overhangs, and outdoor sales areas may be traded.)					
<b>Uncovered Parking Areas</b>					
Parking areas and drives	No allowance	0.03 W/ft <sup>2</sup>	0.04 W/ft <sup>2</sup>	0.06 W/ft <sup>2</sup>	0.08 W/ft <sup>2</sup>
<b>Building Grounds</b>					
Walkways/ramps less than 10 ft wide	No allowance	0.5 W/linear foot	0.5 W/linear foot	0.6 W/linear foot	0.7 W/linear foot
Walkways/ramps 10 ft wide or greater Plaza areas Special feature areas	No allowance	0.10 W/ft <sup>2</sup>	0.10 W/ft <sup>2</sup>	0.11 W/ft <sup>2</sup>	0.14 W/ft <sup>2</sup>
Dining areas	No allowance	0.65 W/ft <sup>2</sup>	0.65 W/ft <sup>2</sup>	0.75 W/ft <sup>2</sup>	0.95 W/ft <sup>2</sup>
Stairways	No allowance	0.6 W/ft <sup>2</sup>	0.7 W/ft <sup>2</sup>	0.7 W/ft <sup>2</sup>	0.7 W/ft <sup>2</sup>
Pedestrian tunnels	No allowance	0.12 W/ft <sup>2</sup>	0.12 W/ft <sup>2</sup>	0.14 W/ft <sup>2</sup>	0.21 W/ft <sup>2</sup>
Landscaping	No allowance	0.03 W/ft <sup>2</sup>	0.04 W/ft <sup>2</sup>	0.04 W/ft <sup>2</sup>	0.04 W/ft <sup>2</sup>
<b>Building Entrances, Exits, and Loading Docks</b>					
Pedestrian and vehicular entrances and exits	No allowance	14 W/lin ft of opening	14 W/lin ft of opening	21 W/lin ft of opening	21 W/lin ft of opening
Entry canopies	No allowance	0.20 W/ft <sup>2</sup>	0.25 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>
Loading docks	No allowance	0.35 W/ft <sup>2</sup>	0.35 W/ft <sup>2</sup>	0.35 W/ft <sup>2</sup>	0.35 W/ft <sup>2</sup>
<b>Sales Canopies</b>					
Free standing and attached	No allowance	0.4 W/ft <sup>2</sup>	0.4 W/ft <sup>2</sup>	0.6 W/ft <sup>2</sup>	0.7 W/ft <sup>2</sup>
<b>Outdoor Sales</b>					
Open areas (including vehicle sales lots)	No allowance	0.2 W/ft <sup>2</sup>	0.2 W/ft <sup>2</sup>	0.35 W/ft <sup>2</sup>	0.5 W/ft <sup>2</sup>
Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	No allowance	7 W/linear foot	7 W/linear foot	21 W/linear foot



TABLE C405.4.2(3)  
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

LIGHTING ZONES				
	Zone 1	Zone 2	Zone 3	Zone 4
Building facades	No allowance	0.075 W/ft <sup>2</sup> of gross above-grade wall area	0.113 W/ft <sup>2</sup> of gross above-grade wall area	0.15 W/ft <sup>2</sup> of gross above-grade wall area
Automated teller machines (ATM) and night depositories	135 W per location plus 45 W per additional ATM per location			
Uncovered entrances and gatehouse inspection stations at guarded facilities	0.5 W/ft <sup>2</sup> of area			
Uncovered loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.35 W/ft <sup>2</sup> of area			
Drive-up windows and doors	200 W per drive through			
Parking near 24-hour retail entrances.	400 W per main entry			

For SI: For SI: 1 watt per square foot = W/0.0929 m<sup>2</sup>.

W = watts.

**MEASURE CODE: CI-LTG-LPDE-V06-200101**

**REVIEW DEADLINE: 1/1/2024**

## 4.5.8 Miscellaneous Commercial/Industrial Lighting

### DESCRIPTION

This measure is designed to calculate savings from energy efficient lighting upgrades that are not captured in other measures within the TRM. If a lighting project fits the measure description in other lighting measures, then those criteria, definitions, and calculations should be used.

Unlike other lighting measures this one applies only to RF applications (because there is no defined baseline for TOS or NC applications).

### DEFINITION OF EFFICIENT EQUIPMENT

A lighting fixture that replaces an existing fixture to provide the same or greater lumen output at a lower kW consumption.

### DEFINITION OF BASELINE EQUIPMENT

The definition of baseline equipment is the existing lighting fixture.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The lifetime of the efficient equipment fixture is the rated fixture life divided by hours of use. If unknown the default lifetime, regardless of program type is 15 years.<sup>933</sup>

### DEEMED MEASURE COST

The actual cost of the efficient light fixture should be used.

### LOADSHAPE

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in section 4.5.

---

<sup>933</sup> 15 years is used based on assumption that most product using this measure will be LED.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * Hours * WHF_e * ISR$$

Where:

**Watts<sub>base</sub>** = Input wattage of the existing system which depends on the baseline fixture configuration (number and type of lamp) and ballast factor (if applicable) and number of fixtures.

= Actual

**Watt<sub>EE</sub>** = New Input wattage of EE fixture which depends on new fixture configuration (number of lamps) and ballast factor (if applicable) (if applicable) and number of fixtures.

= Actual

**Hours** = Average hours of use per year as provided by the customer or selected from the Reference Table in Section 4.5, Fixture annual operating hours, by building type. If hours or building type are unknown, use the Miscellaneous value.

**WHF<sub>e</sub>** = Waste heat factor for energy to account for cooling energy savings from efficient lighting is selected from the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**ISR** = In Service Rate or the percentage of units rebated that get installed.

=100% if application form completed with sign off that equipment is not placed into storage.<sup>934</sup> If sign off form not completed assume the following 3 year ISR assumptions:

Weighted Average 1st year In Service Rate (ISR)	2nd year Installations	3rd year Installations	Final Lifetime In Service Rate
93.4% <sup>935</sup>	2.5%	2.1%	98.0% <sup>936</sup>

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{heatpenalty}^{937} = (((Watts_{Base} - Watts_{EE}) / 1000) * ISR * Hours * -IFkWh$$

Where:

**IFkWh** = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected

<sup>934</sup>Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an "In-Service Rate" when commercial customers complete an application form.

<sup>935</sup> Based on assumptions from 4.5.3 High Performance and Reduced Wattage T8 fixtures.

<sup>936</sup> The 98% Lifetime ISR assumption is based upon review of two evaluations:

'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings.

<sup>937</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**DEFERRED INSTALLS**

As presented above, if a sign off form is not completed the characterization assumes that a percentage of bulbs purchased are not installed until Year 2 and Year 3 (see ISR assumption above). The Illinois Technical Advisory Committee has determined the following methodology for calculating the savings of these future installs.

Year 1 (Purchase Year) installs: Characterized using assumptions provided above or evaluated assumptions if available.

Year 2 and 3 installs: Characterized using delta watts assumption and hours of use from the Install Year, i.e., the actual deemed (or evaluated if available) assumptions active in Year 2 and 3 should be applied.

The NTG factor for the Purchase Year should be applied.

**SUMMER COINCIDENT DEMAND SAVINGS**

$$\Delta kW = ((Watts_{base} - Watts_{EE}) / 1000) * WHF_d * CF * ISR$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is selected from the Reference Table in Section 4.5 for each building type. If the building is not cooled WHFd is 1.

CF = Summer Peak Coincidence Factor for measure is selected from the Reference table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66.

Other factors as defined above.

**NATURAL GAS ENERGY SAVINGS**

$$\Delta Therms^{938} = (((Watts_{Base} - Watts_{EE}) / 1000) * ISR * Hours * - IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. This value is selected from the Reference Table in Section 6.5 for each building type.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

If there are differences between the maintenance of the efficient and baseline lighting system then they should be evaluated on a project-by-project basis.

---

<sup>938</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

**MEASURE CODE: CI-LTG-MSCI-V04-210101**

**REVIEW DEADLINE: 1/1/2026**

## 4.5.9 Multi-Level Lighting Switch

### DESCRIPTION

This measure relates to the installation new multi-level lighting switches on an existing lighting system.

This measure can only relate to the adding of a new control in an existing building, since multi-level switching is required in the Commercial new construction building energy code (IECC 2012/2015/2018).

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient system is assumed to be a lighting system controlled by multi-level lighting controls.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an uncontrolled lighting system where all lights in a given area are on the same circuit or all circuits come on at the same time.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for all lighting controls is assumed to be 10 years.<sup>939</sup>

### DEEMED MEASURE COST

When available, the actual cost of the measure shall be used. When not available, the incremental capital cost for this measure is assumed to be \$274.<sup>940</sup>

### LOADSHAPE

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

---

<sup>939</sup> Consistent with Lighting control measure.

<sup>940</sup> Goldberg et al, State of Wisconsin Public Service Commission of Wisconsin, Focus on Energy Evaluation, Business Programs: Incremental Cost Study, KEMA, October 28, 2009.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = KW_{Controlled} * Hours * ESF * WHF_e$$

Where:

$KW_{Controlled}$  = Total lighting load connected to the control in kilowatts.  
 = Actual

Hours = total operating hours of the controlled lighting circuit before the lighting controls are installed. This number should be collected from the customer. Average hours of use per year are provided in the Reference Table in Section 4.5, Fixture annual operating hours, for each building type if customer specific information is not collected. If unknown building type, use the Miscellaneous value.

ESF = Energy Savings factor (represents the percentage reduction to the  $KW_{controlled}$  due to the use of multi-level switching).  
 = Dependent on building type:<sup>941</sup>

Building Type	Energy Savings Factor (ESF)
Private Office	21.6%
Open Office	16.0%
Retail	14.8%
Classrooms	8.3%
Unknown, average	15%

$WHF_e$  = Waste heat factor for energy to account for cooling energy savings from efficient lighting is provided in the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{heatpenalty}^{942} = KW_{Controlled} * Hours * ESF * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

<sup>941</sup> Based on results from “Lighting Controls Effectiveness Assessment: Final Report on Bi-Level Lighting Study” published by the California Public Utilities Commission (CPUC), prepared by ADM Associates.

<sup>942</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = KW_{\text{controlled}} * ESF * WHF_d * CF$$

Where:

WHF<sub>d</sub> = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If the building is un-cooled WHF<sub>d</sub> is 1.

CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value of 0.66.<sup>943</sup>

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{therms} = KW_{\text{Controlled}} * \text{Hours} * ESF * - \text{IFTherms}$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting and provided in the Reference Table in Section 4.5 by building type.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-LTG-MLLC-V05-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>943</sup> By applying the ESF and the same coincidence factor for general lighting savings we are in essence assuming that the savings from multi-level switching are as likely during peak periods as any other time. In the absence of better information this seems like a reasonable assumption and if anything may be on the conservative side since you might expect the peak periods to be generally sunnier and therefore more likely to have lower light levels. It is also consistent with the control type reducing the wattage lighting load, the same as the general lighting measures.



## 4.5.10 Lighting Controls

### DESCRIPTION

This measure relates to the installation of new occupancy or daylighting sensors and controls on a new or existing lighting system. Lighting control types covered by this measure include wall, ceiling, fixture mounted or integrated controls in addition to Luminaire Level Lighting Controls (LLLCs) or Networked Lighting Controls (NLC) which have additional high end trim and networking capabilities. Passive infrared, ultrasonic detectors and fixture-mounted sensors or sensors with a combination thereof are eligible. Lighting controls required by state energy codes are not eligible. This must be a new installation and may not replace an existing lighting occupancy sensor control.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Lighting that is controlled by any of the control strategies characterized in this measure; occupancy, daylighting or dual (occupancy and daylighting) controls with or without high end trim, and Luminaire-level lighting controls (LLLCs) / Networked Lighting Controls (NLC).

LLLCs or NLCs are defined according to DesignLights Consortium (DLC) Networked Lighting Controls definition, which requires systems to have fixture networking capabilities, individual addressability, occupancy sensing, daylight harvesting, high-end trim, flexible zoning, continuous dimming, scheduling and cybersecurity. The network ability allows building managers to group lights with specific zonal control and scheduling strategies, energy monitoring and high end trim resulting in a higher savings capability. While DLC listing is not a requirement for any control type characterized in this measure, programs should consider eligibility requirements that ensure quality product is installed.

A subset of occupancy sensors are those that are programmed as “vacancy” sensors. To qualify as a vacancy sensor, the control must be configured such that manual input is required to turn on the controlled lighting and the control automatically turns the lighting off. Additional savings are achieved compared to standard occupancy sensors because lighting does not automatically turn on and occupants may decide to not turn it on. Note that vacancy sensors are not a viable option for many applications where standard occupancy sensors should be used instead.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is assumed to be the existing lighting system and can include manual or no controls or an existing control strategy that is being improved. Note where an existing inefficient fixture is replaced with an efficient fixture with control, use the fixture measure to calculate savings from the wattage reduction first, then assume the efficient fixture without control as the baseline for the control measure.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for Luminaire-level lighting controls (LLLCs) / Networked Lighting Controls (NLC) is assumed to be 15 years, consistent with the average expected lifetime of the fixture. For all other lighting controls, measure life is assumed to be 10 years.<sup>944</sup>

### DEEMED MEASURE COST

When available, the actual cost of the measure shall be used. When not available, the following default values are provided:

---

<sup>944</sup> Based on research conducted by Guidehouse, interviewing 46 contractors, reported in ‘ComEd Retrofit Add-On EUL Results Memo. January 27, 2020.

Lighting Control Type	Incremental Cost <sup>945</sup>
Interior Wall Switch Occupancy Sensor	\$55.00
Interior Fixture-Mounted Occupancy Sensor	\$67.00
Interior Remote or Wall-Mounted Occupancy Sensor	\$125.00
Interior Fixture-Mounted Daylight Sensor	\$50.00
Interior Remote or Wall-Mounted Daylight Sensor	\$65.00
Interior Integrated Occupancy for LED Interior Fixtures < 10,000 Lumens	\$40.00
Interior Integrated Occupancy for LED Interior Fixtures >= 10,000 Lumens	\$40.00
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	\$50.00
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	\$50.00
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	\$ 100.00
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	\$ 100.00
Luminaire-Level Lighting Controls	\$61.00
High End Trim or Institutional Tuning	\$0.06 per ft <sup>2</sup>
Exterior Occupancy Sensor	\$82.00

**LOADSHAPE**

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on location.

<sup>945</sup> Based on indicative product cost review as performed for Efficiency Vermont TRM. Cost assumption for Luminaire Level Lighting Controls is based on the average of ‘clever’ and ‘hybrid’ LLLC incremental costs, including a per fixture contribution to the necessary gateway, servers and installation labor from Kisch et al, “Incremental Cost of Luminaire Level Lighting Controls”, Energy Solutions on behalf of NEEA, December 2019. Cost for High End Trim / Institutional Tuning is based on estimate provided by SlipStream based on field implementation.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = KW_{Controlled} * Hours * (ESF_{EE} - ESF_{Base}) * WHF_e$$

Where:

$KW_{Controlled}$  = Total lighting load connected to the control in kilowatts. Savings is per control. The total connected load per control should be collected from the customer or the default values presented below used. Note where an existing inefficient fixture is replaced with an efficient fixture with control, use the fixture measure to calculate savings from the wattage reduction first, then assume the efficient fixture without control as the baseline for the control measure.

Lighting Control Type <sup>946</sup>	Wattage Unit	Default kW Controlled
Interior Wall Switch Occupancy Sensor	per control	0.084
Interior Fixture-Mounted Occupancy Sensor	per fixture	0.081
Interior Remote or Wall-Mounted Occupancy Sensor	per control	0.338
Interior Fixture-Mounted Daylight Sensor	per fixture	0.095
Interior Wall-Mounted Daylight Sensor	per control	0.239
Interior Integrated Occupancy for LED Interior Fixtures < 10,000 Lumens	per fixture	0.031
Interior Integrated Occupancy for LED Interior Fixtures >= 10,000 Lumens	per fixture	0.118
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	per control	0.031
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	per control	0.118
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	per control	0.031
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	per control	0.118
Interior Luminaire-Level Lighting Controls < 10,000 Lumens	per control	0.031
Interior Luminaire-Level Lighting Controls >= 10,000 Lumens	per control	0.118
Refrigerated Case Occupancy Sensor – Freezer and Cooler	per control	0.090
Exterior Occupancy Sensor	per fixture	0.086

**Hours** = total operating hours of the controlled lighting circuit before the lighting controls are installed. This number should be collected from the customer. Average hours of use per year are provided in the Reference Table in Section 4.5, Fixture annual operating hours, for each building type if customer specific information is not collected. If unknown building type, use the Miscellaneous value.

<sup>946</sup> Estimates of watts controlled are based on Efficiency Vermont data as provided in the 2018 TRM. Future evaluation should determine appropriate assumptions based on Illinois program data.

ESF = Energy Savings factor (represents the percentage reduction to the operating Hours from the non-controlled lighting system). Where available and with building owner consent, custom savings from controls may be used via networked trending software. If unavailable or consent not provided, defaults are provided below which assume installation is appropriate to provide the savings described. For dual controls and fixtures with high end trim this should be reviewed and verified via representative spot checks to ensure daylighting capabilities will provide savings and fixture tuning is being performed.<sup>947</sup>

Lighting Control Type	Energy Savings Factor <sup>948</sup>
Fixture Measurement of Control savings through Networked Trending	Custom
Interior Occupancy Sensor (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	24% 34% with High End Trim
Interior Occupancy Sensor configured as "Vacancy Sensor" (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	31% 41% with High End Trim
Interior Daylight Sensor (Wall, Fixture or Remote Mounted)	28% 38% with High End Trim
Interior Dual Occupancy & Daylight Sensor (Integrated or Fixture Mounted)	38% 48% with High End Trim
Interior Luminaire-Level Lighting Controls	50%
Refrigerated Case Occupancy Sensor – Freezer and Cooler	27%
Exterior Occupancy Sensor	41%
No Lighting Control	0%

WHF<sub>e</sub> = Waste heat factor for energy to account for cooling energy savings from efficient lighting is provided in the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{\text{heatpenalty}}^{949} = KW_{\text{Controlled}} * \text{Hours} * \text{ESF} * -\text{IFkWh}$$

<sup>947</sup> It is recommended that evaluation is performed to assess the extent to which daylighting and high end trim benefits are appropriately utilized in the field.

<sup>948</sup> Interior controls % savings based except where noted on LBNL, Williams et al, "Lighting Controls in Commercial Buildings", 2012, p172. ESF for Vacancy Sensors is based on Papamichael, Konstantions, Bi-Level Switching in Office Spaces, California Lighting Technology Center, February 1,2010. See Figure 8 on page 10 for relevant study results. The study shows a 30% extra savings above a typical occupancy sensor; 24% \* 1.3 = 31%.

ESF for Luminaire Level Lighting Controls, and 10% High End Trim adder are based upon review of:

- Pacific Northwest National Laboratory, "Evaluation of Advanced Lighting Control Systems in a Working Office Environment", November 2018.
- Schuetter et al., "Cree SmartCast Lighting Retrofit Demonstration: LED Fixtures and Controls for Advanced Holistic Lighting Solutions", September 2020 (expected).
- DesignLights Consortium and NEEA, "Energy Savings from Networked Lighting Control and Luminaire-level Lighting Control Systems: 2020 Update", 2020 (expected).

Refrigerated Case occupancy sensors ESF is based on percentage of operating hours spent in low-power operation during vacant periods, found in SDG&E workpaper: WPSDGENRLG0027.

Exterior sensors are based upon data from "Application Assessment of Bi-Level LED Parking Lot Lighting" p6.

<sup>949</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = KW_{\text{controlled}} * WHF_d * (CF_{\text{baseline}} - CF_{\text{os}})$$

Where:

WHF<sub>d</sub> = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If the building is un-cooled WHF<sub>d</sub> is 1.

CF<sub>baseline</sub> = Baseline Summer Peak Coincidence Factor for the lighting system without Occupancy Sensors installed selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66

CF<sub>os</sub> = Retrofit Summer Peak Coincidence Factor the lighting system with Occupancy Sensors installed is 0.15 regardless of building type.<sup>950</sup>

#### NATURAL GAS ENERGY SAVINGS

$$\Delta \text{therms} = KW_{\text{controlled}} * \text{Hours} * \text{ESF} * - \text{IFTherms}$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting and provided in the Reference Table in Section 4.5 by building type.

#### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

#### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

**MEASURE CODE: CI-LTG-OSLC-V06-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>950</sup> Coincidence Factor Study Residential and Commercial Industrial Lighting Measures, RLW Analytics, Spring 2007. Note, the connected load used in the calculation of the CF for occupancy sensor lights includes the average ESF.

## 4.5.11 Solar Light Tubes

### DESCRIPTION

A tubular skylight which is 10” to 21” in diameter with a prismatic or translucent lens is installed on the roof of a commercial facility. The lens reflects light captured from the roof opening through a highly specular reflective tube down to the mounted fixture height. When in use, a light tube fixture resembles a metal halide fixture. Uses include grocery, school, retail and other single story commercial buildings.

In order that the savings characterized below apply, the electric illumination in the space must be automatically controlled to turn off or down when the tube is providing enough light.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a tubular skylight that concentrates and directs light from the roof to an area inside the facility.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment for this measure is a fixture with comparable luminosity. The specifications for the baseline lamp depend on the size of the Light Tube being installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life for a light tube commercial skylight is 10 years.<sup>951</sup>

### DEEMED MEASURE COST

If available, the actual incremental cost should be used. For analysis purposes, assume an incremental cost for a light tube commercial skylight is \$750.<sup>952</sup>

### LOADSHAPE

Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)<sup>953</sup>

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on location.

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = kW_f * HOURS * WHFe$$

Where:

---

<sup>951</sup> Equal to the manufacturers standard warranty.

<sup>952</sup> Based on review of solar lighting installers websites (e.g., elitesolarsystems.com).

<sup>953</sup> The savings from solar light tubes are only realized during the sunlight hours. It is therefore appropriate to apply the single shift (8/5) loadshape to this measure.

$kW_f$  = Connected load of the fixture the solar tube replaces

Size of Tube	Average Lumen output for Chicago Illinois (minimum) <sup>954</sup>	Equivalent fixture	kW
21"	9,775 (4,179)	50% 3 x 2 32W lamp CFL (207W, 9915 lumens) 50% 4 lamp F32 w/Elec 4' T8 (114W, 8895 lumens)	0.161
14"	4,392 (1,887)	50% 2 42W lamp CFL (94W, 4406 lumens) 50% 2 lamp F32 w/Elec 4' T8 (59W, 4448 lumens)	0.077
10"	2,157 (911)	50% 1 42W lamp CFL (46W, 2203 lumens) 50% 1 lamp F32 w/Elec 4' T8 (32W, 2224 lumens)	0.039
		<b>AVERAGE</b>	<b>0.092</b>

HOURS = Equivalent full load hours  
= 2400<sup>955</sup>

WHF<sub>e</sub> = Waste heat factor for energy to account for cooling energy savings from efficient lighting is selected from the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{\text{heatpenalty}}^{956} = kW_f * \text{HOURS} * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kW_f * WHFd * CF$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is selected from the Reference Table in Section 4.5 for each building type. If the building is not cooled WHFd is 1.

CF = Summer Peak Coincidence Factor for measure is selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66.

**NATURAL GAS SAVINGS**

$$\Delta \text{Therms}^{957} = \Delta kW_f * \text{HOURS} * -IF\text{Therms}$$

Where:

<sup>954</sup> Solatube Test Report (2005). [http://www.maine绿色建筑.com/files/file/solatube/stb\\_lumens\\_datasheet.pdf](http://www.maine绿色建筑.com/files/file/solatube/stb_lumens_datasheet.pdf).

<sup>955</sup> Ibid. The lumen values presented in the kW table represent the average of the lightest 2400 hours.

<sup>956</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>957</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Please select from the Reference Table in Section 4.5 for each building type.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-LTG-STUB-V03-200101**

**REVIEW DEADLINE: 1/1/2025**



### 4.5.12 T5 Fixtures and Lamps

**DESCRIPTION**

T5 Lamp/ballast systems have higher lumens per watt than a standard T8 or an existing T8 or T12 system. The smaller lamp diameter allows for better optical systems, and more precise control of lighting. These characteristics result in light fixtures that produce equal or greater light than standard T8 or T12 fixtures, while using fewer watts.

This measure applies to the installation of new equipment with efficiencies that exceed that of the equipment that would have been installed following standard market practices and is applicable to time of sale as well as retrofit measures.

If the implementation strategy does not allow for the installation location to be known, a deemed split of 99% Commercial and 1% Residential should be used.<sup>958</sup>

This measure was developed to be applicable to the following program types: TOS, EREP, DI.

If applied to other program types, the measure savings should be verified.

The measure applies to all commercial T5 installations excluding new construction and substantial renovation or change of use measures (see lighting power density measure). Lookup tables have been provided to account for various installations. Actual existing equipment wattages should be compared to new fixture wattages whenever possible while maintaining lumen equivalent designs. Default new and baseline assumptions are provided if existing equipment cannot be determined. Actual costs and hours of use should be utilized when available. Default component costs and lifetimes have been provided for Operating and Maintenance Calculations. Please see the Definition Table to determine applicability for each program. Configurations not included in the TRM may be included in custom program design using the provided algorithms as long as energy savings is achieved. The following table defines the applicability for different programs:

Time of Sale (TOS)	Early Replacement (EREP) and DI
<p>This program applies to installations where customer and location of equipment is not known, or at time of burnout of existing equipment. T5 Lamp/ballast systems have higher lumens per watt than a standard T8 system. The smaller lamp diameter allows for better optical systems, and more precise control of lighting. These characteristics result in light fixtures that produce equal or greater light than standard T8 fixtures, while using fewer watts.</p>	<p>For installations that upgrade installations before the end of their useful life. T5 Lamp/ballast systems have higher lumens per watt than a standard T8 or T12 system. The smaller lamp diameter allows for better optical systems, and more precise control of lighting. These characteristics result in light fixtures that produce equal or greater light than standard T8 or T12 fixtures, while using fewer watts and having longer life.</p>

**DEFINITION OF EFFICIENT EQUIPMENT**

The definition of efficient equipment varies based on the program and is defined below:

Time of Sale (TOS)	Early Replacement (EREP) and DI
<p>4' fixtures must use a T5 lamp and ballast configuration. 1' and 3' lamps are not eligible. High Performance Troffers must be 85% efficient or greater. T5 HO high bay fixtures must be 3, 4 or 6 lamps and 90% efficient or better.</p>	<p>4' fixtures must use a T5 lamp and ballast configuration. 1' and 3' lamps are not eligible. High Performance Troffers must be 85% efficient or greater. T5 HO high bay fixtures must be 3, 4 or 6 lamps and 90% efficient or better.</p>

<sup>958</sup> Based on weighted average of Final ComEd’s BILD program data from PY5 and PY6. For Residential installations, hours of use assumptions from ‘5.5 Interior Hardwired Compact Fluorescent Lamp (CFL) Fixture’ measure should be used.

**DEFINITION OF BASELINE EQUIPMENT**

The definition of baseline equipment varies based on the program and is defined below:

Time of Sale (TOS)	Early Replacement (EREP) and DI
<p>The baseline is T8 with equivalent lumen output. In high-bay applications, the baseline is pulse start metal halide systems.</p>	<p>The baseline is the existing system.                      In July 14, 2012, Federal Standards were enacted that were expected to eliminate T-12s as an option for linear fluorescent fixtures. Through v3.0 of the TRM, it was assumed that the T-12 would no longer be baseline for retrofits from 1/1/2016. However, due to significant loopholes in the legislation, T-12 compliant product is still freely available and in Illinois T-12s continue to hold a significant share of the existing and replacement lamp market. Therefore the timing of the sunseting of T-12s as a viable baseline has been pushed back in v7.0 until 1/1/2020 and will be revisited in future update sessions.                      There will be a baseline shift applied to all measures installed before 2020 in years remaining in the measure life. See table C-1.</p>

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The lifetime of the efficient equipment fixture should be the rated life of the fixture divided by hours of use. If unknown default is, regardless of program type is 12 years.<sup>959</sup>

**LOADSHAPE**

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

<sup>959</sup> 12 years is based on average of mostly CEE lamp products (9 years), T5 lamps (10.7 years) and GDS Measure Life Report, June 2007, (15 years), as recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * Hours * WHF_e * ISR$$

Where:

**Watts<sub>base</sub>** = Input wattage of the existing system which depends on the baseline fixture configuration (number and type of lamp) and number of fixtures. Value can be selected from the appropriate reference table as shown below, of a custom value can be entered if the configurations in the tables is not representative of the existing system.

**Watts<sub>EE</sub>** = New Input wattage of EE fixture which depends on new fixture configuration (number of lamps) and ballast factor and number of fixtures. Value can be selected from the appropriate reference table as shown below, of a custom value can be entered if the configurations in the tables is not representative of the existing system.

Program	Reference Table
Time of Sale	A-1: T5 New and Baseline Assumptions
Early Replacement, DI	A-2: T5 New and Baseline Assumptions

**Hours** = Average hours of use per year as provided by the customer or selected from the Reference Table in Section 4.5, Fixture annual operating hours, by building type. If hours or building type are unknown, use the Miscellaneous value.

**WHF<sub>e</sub>** = Waste heat factor for energy to account for cooling energy savings from efficient lighting is selected from the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**ISR** = In Service Rate or the percentage of units rebated that get installed.  
 =100%<sup>960</sup> if application form completed with sign off that equipment is not placed into storage. If sign off form not completed assume the following 3 year ISR assumptions:

Weighted Average 1 <sup>st</sup> year In Service Rate (ISR)	2 <sup>nd</sup> year Installations	3 <sup>rd</sup> year Installations	Final Lifetime In Service Rate
98% <sup>961</sup>	0%	0%	98.0% <sup>962</sup>

**HEATING PENALTY**

If electrically heated building:

<sup>960</sup>Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an "In-Service Rate" when commercial customers complete an application form.

<sup>961</sup> 1<sup>st</sup> year in service rate is based upon review of PY5-6 evaluations from ComEd's commercial lighting program (BILD) (see 'IL Commercial Lighting ISR\_2014.xls' for more information.

<sup>962</sup> The 98% Lifetime ISR assumption is based upon review of two evaluations:

'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report: Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings.

$$\Delta kWh_{\text{heatpenalty}}^{963} = (((\text{WattsBase}-\text{WattsEE})/1000) * \text{ISR} * \text{Hours} * -\text{IFkWh}$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**SUMMER COINCIDENT DEMAND SAVINGS**

$$\Delta kW = ((\text{Watts}_{\text{base}}-\text{Watts}_{\text{EE}})/1000) * \text{WHF}_d * \text{CF} * \text{ISR}$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is selected from the Reference Table in Section 4.5 for each building type. If the building is not cooled WHFd is 1.

CF = Summer Peak Coincidence Factor for measure is selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value.

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{Therms}^{964} = (((\text{WattsBase}-\text{WattsEE})/1000) * \text{ISR} * \text{Hours} * - \text{IFTherms}$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. This value is selected from the Reference Table in Section 4.5 for each building type.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

See Reference tables for Operating and Maintenance Values

Program	Reference Table
Time of Sale	B-1: T5 Component Costs and Lifetime
Early Replacement, DI	B-2: T5 Component Costs and Lifetime

**REFERENCE TABLES**

See following page.

<sup>963</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>964</sup>Negative value because this is an increase in heating consumption due to the efficient lighting.

A-1: Time of Sale: T5 New and Baseline Assumptions<sup>965</sup>

EE Measure Description	EE Cost	Watts <sub>EE</sub>	Baseline Description	Base Cost	Watts <sub>BASE</sub>	Measure Cost	Watts <sub>SAVE</sub>
2-Lamp T5 High-Bay	\$200.00	180	200 Watt Pulse Start Metal-Halide	\$100.00	232	\$100.00	52
3-Lamp T5 High-Bay	\$200.00	180	200 Watt Pulse Start Metal-Halide	\$100.00	232	\$100.00	52
4-Lamp T5 High-Bay	\$225.00	240	320 Watt Pulse Start Metal-Halide	\$125.00	350	\$100.00	110
6-Lamp T5 High-Bay	\$250.00	360	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 320 PSMH	\$150.00	476	\$100.00	116
1-Lamp T5 Troffer/Wrap	\$100.00	32	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	\$60.00	44	\$40.00	12
2-Lamp T5 Troffer/Wrap	\$100.00	64	3-Lamp F32T8 Equivalent w/ Elec. Ballast	\$60.00	88	\$40.00	24
1-Lamp T5 Industrial/Strip	\$70.00	32	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	\$40.00	44	\$30.00	12
2-Lamp T5 Industrial/Strip	\$70.00	64	3-Lamp F32T8 Equivalent w/ Elec. Ballast	\$40.00	88	\$30.00	24
3-Lamp T5 Industrial/Strip	\$70.00	96	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	\$40.00	132	\$30.00	36
4-Lamp T5 Industrial/Strip	\$70.00	128	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	\$40.00	178	\$30.00	50
1-Lamp T5 Indirect	\$175.00	32	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	\$145.00	44	\$30.00	12
2-Lamp T5 Indirect	\$175.00	64	3-Lamp F32T8 Equivalent w/ Elec. Ballast	\$145.00	88	\$30.00	24

<sup>965</sup> Adapted from Efficiency Vermont Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions, October 26, 2011.

A-2: T5 New and Baseline Assumptions<sup>966</sup>

EE Measure Description	EE Cost	Watts <sub>EE</sub>
3-Lamp T5 High-Bay	\$200.00	180
4-Lamp T5 High-Bay	\$225.00	234
6-Lamp T5 High-Bay	\$250.00	358
1-Lamp T5 Troffer/Wrap	\$100.00	32
2-Lamp T5 Troffer/Wrap	\$100.00	64
1-Lamp T5 Industrial/Strip	\$70.00	32
2-Lamp T5 Industrial/Strip	\$70.00	64
3-Lamp T5 Industrial/Strip	\$70.00	96
4-Lamp T5 Industrial/Strip	\$70.00	128
1-Lamp T5 Indirect	\$175.00	32
2-Lamp T5 Indirect	\$175.00	64

Baseline Description	Watts <sub>BASE</sub>
200 Watt Pulse Start Metal-Halide	232
250 Watt Metal-Halide	295
320 Watt Pulse Start Metal-Halide	350
400 Watt Metal-Halide	455
400 Watt Pulse Start Metal-Halide	476
1-Lamp F34T12 w/ EEMag Ballast	40
2-Lamp F34T12 w/ EEMag Ballast	68
3-Lamp F34T12 w/ EEMag Ballast	110
4-Lamp F34T12 w/ EEMag Ballast	139
1-Lamp F40T12 w/ EEMag Ballast	48
2-Lamp F40T12 w/ EEMag Ballast	82
3-Lamp F40T12 w/ EEMag Ballast	122
4-Lamp F40T12 w/ EEMag Ballast	164
1-Lamp F40T12 w/ Mag Ballast	57
2-Lamp F40T12 w/ Mag Ballast	94
3-Lamp F40T12 w/ Mag Ballast	147
4-Lamp F40T12 w/ Mag Ballast	182
1-Lamp F32T8	32
2-Lamp F32T8	59
3-Lamp F32T8	88
4-Lamp F32T8	114

<sup>966</sup>Ibid.

B-1: Time of Sale T5 Component Costs and Lifetime<sup>967</sup>

EE Measure Description	EE Lamp Cost	EE Lamp Life (hrs)	EE Lamp Rep. Labor Cost per lamp	EE Ballast Cost	EE Ballast Life (hrs)	EE Ballast Rep. Labor Cost	Baseline Description	# Base Lamps	Base Lamp Cost	Base Lamp Life (hrs)	Base Lamp Rep. Labor Cost	# Base Ballasts	Base Ballast Cost	Base Ballast Life (hrs)	Base Ballast Rep. Labor Cost
3-Lamp T5 High-Bay	\$12.00	20000	\$6.67	\$52.00	70000	\$22.50	200 Watt Pulse Start Metal-Halide	1.00	\$21.00	10000	\$6.67	1.00	\$87.75	40000	\$22.50
4-Lamp T5 High-Bay	\$12.00	20000	\$6.67	\$52.00	70000	\$22.50	320 Watt Pulse Start Metal-Halide	1.00	\$21.00	20000	\$6.67	1.00	\$109.35	40000	\$22.50
6-Lamp T5 High-Bay	\$12.00	20000	\$6.67	\$52.00	70000	\$22.50	Adjusted according to 6-Lamp HPT8 Equivalent to 320	1.36	\$21.00	20000	\$6.67	1.50	\$109.35	40000	\$22.50
1-Lamp T5 Troffer/Wrap	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	1.50	\$2.50	20000	\$2.67	0.50	\$15.00	70000	\$15.00
2-Lamp T5 Troffer/Wrap	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	3-Lamp F32T8 Equivalent w/ Elec. Ballast	3.00	\$2.50	20000	\$2.67	1.00	\$15.00	70000	\$15.00
1-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	1.50	\$2.50	20000	\$2.67	0.50	\$15.00	70000	\$15.00
2-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	3-Lamp F32T8 Equivalent w/ Elec. Ballast	3.00	\$2.50	20000	\$2.67	1.00	\$15.00	70000	\$15.00
3-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent	4.50	\$2.50	20000	\$2.67	1.50	\$15.00	70000	\$15.00
4-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	6.00	\$2.50	20000	\$2.67	2.00	\$15.00	70000	\$15.00
1-Lamp T5 Indirect	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	1.50	\$2.50	20000	\$2.67	0.50	\$15.00	70000	\$15.00
2-Lamp T5 Indirect	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	3-Lamp F32T8 Equivalent w/ Elec. Ballast	3.00	\$2.50	20000	\$2.67	1.00	\$15.00	70000	\$15.00

<sup>967</sup> Adapted from Efficiency Vermont Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions, October 26, 2011.

B-2: T5 Component Costs and Lifetime<sup>968</sup>

EE Measure Description	EE Lamp Cost	EE Lamp Life (hrs)	EE Lamp Rep. Labor Cost per lamp	EE Ballast Cost	EE Ballast Life (hrs)	EE Ballast Rep. Labor Cost	Baseline Description	# Base Lamps	Base Lamp Cost	Base Lamp Life (hrs)	Base Lamp Rep. Labor Cost	# Base Ballasts	Base Ballast Cost	Base Ballast Life (hrs)	Base Ballast Rep. Labor Cost
3-Lamp T5 High-Bay	\$12.00	20000	\$6.67	\$52.00	70000	\$22.50	200 Watt Pulse Start Metal-Halide	1.00	\$21.00	10000	\$6.67	1.00	\$ 88	40000	\$22.50
							250 Watt Metal Halide	1.00	\$21.00	10000	\$6.67	1.00	\$ 92	40000	\$22.50
4-Lamp T5 High-Bay	\$12.00	20000	\$6.67	\$52.00	70000	\$22.50	320 Watt Pulse Start Metal-Halide	1.00	\$72.00	20000	\$6.67	1.00	\$ 109	40000	\$22.50
							400 Watt Metal Halide	1.00	\$17.00	20000	\$6.67	1.00	\$ 114	40000	\$22.50
6-Lamp T5 High-Bay	\$12.00	20000	\$6.67	\$52.00	70000	\$22.50	Proportionally Adjusted according to 6-Lamp HPT8 Equivalent to 320 PSMH	1.36	\$72.00	20000	\$6.67	1.50	\$ 109	40000	\$22.50
1-Lamp T5 Troffer/Wrap	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	1.50	\$2.50	20000	\$2.67	0.50	\$ 15	70000	\$15.00
2-Lamp T5 Troffer/Wrap	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	3-Lamp F32T8 Equivalent w/ Elec. Ballast	3.00	\$2.50	20000	\$2.67	1.00	\$ 15	70000	\$15.00
1-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	1.50	\$2.50	20000	\$2.67	0.50	\$ 15	70000	\$15.00
2-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	3-Lamp F32T8 Equivalent w/ Elec. Ballast	3.00	\$2.50	20000	\$2.67	1.00	\$ 15	70000	\$15.00
3-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	4.50	\$2.50	20000	\$2.67	1.50	\$ 15	70000	\$15.00
4-Lamp T5 Industrial/Strip	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	6.00	\$2.50	20000	\$2.67	2.00	\$ 15	70000	\$15.00
1-Lamp T5 Indirect	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	Proportionally adjusted according to 2-Lamp T5 Equivalent to 3-Lamp T8	1.50	\$2.50	20000	\$2.67	0.50	\$ 15	70000	\$15.00
2-Lamp T5 Indirect	\$12.00	20000	\$2.67	\$52.00	70000	\$15.00	3-Lamp F32T8 Equivalent w/ Elec. Ballast	3.00	\$2.50	20000	\$2.67	1.00	\$ 15	70000	\$15.00

<sup>968</sup> Efficiency Vermont Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions, October 26, 2011  
 EPE Program Downloads. (Copy of LSF\_2012\_v4.04\_250rows.xls). Kuiken et al, Focus on Energy Evaluation. Business Programs: Deemed Savings Manual v1.0, Kema, March 22, 2010.



C-1: T12 Baseline Adjustment:

For early replacement measures replacing existing T12 fixtures the full savings (as calculated above in the Algorithm section) will be claimed for the remaining useful life of the T12 fixture. This should be calculated as follows:

$$\text{RUL of existing T12 fixture} = (1/3 * 40,000)/\text{Hours.}$$

A savings adjustment should then be applied to the annual savings for the remainder of the measure life. The adjustment to be applied for each measure should be calculated as:

$$\% \text{ Adjustment} = (\text{TOS Base Watts} - \text{Efficient Watts}) / (\text{Existing T12 Watts} - \text{Efficient Watts})$$

The adjustment to be applied for each default measure described above is listed in the reference table below:

Savings Adjustment Factors

	watts	Equivalent T12 watts adjusted for lumen equivalency-34 w and 40 w with EEMag ballast	Equivalent T12 watts adjusted for lumen equivalency-40 w with EEMag ballast	Equivalent T12 watts adjusted for lumen equivalency-40 w with Mag ballast	Prportionally Adjusted for Lumens wattage for T8 equivalent
1-Lamp T5 Industrial/Strip	32	61	73	82	44
2-Lamp T5 Industrial/Strip	64	103	125	135	88
3-Lamp T5 Industrial/Strip	96	167	185	211	132
4-Lamp T5 Industrial/Strip	128	211	249	226	178
		Savings Factor Adjustment to the T8 baseline	Savings Factor Adjustment to the T8 baseline	Savings Factor Adjustment to the T8 baseline	
1-Lamp T5 Industrial/Strip		42%	29%	24%	
2-Lamp T5 Industrial/Strip		61%	40%	34%	
3-Lamp T5 Industrial/Strip		51%	40%	31%	
4-Lamp T5 Industrial/Strip		60%	41%	51%	

**MEASURE CODE: CI-LTG-T5FX-V08-200101**

**REVIEW DEADLINE: 1/1/2025**

## 4.5.13 Occupancy Controlled Bi-Level Lighting Fixtures

### DESCRIPTION

This measure relates to replacing existing uncontrolled continuous lighting fixtures with new bi-level lighting fixtures. This measure can only relate to replacement in an existing building, since multi-level switching is required in the Commercial new construction building energy code (IECC 2012/2015/2018).

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient system is assumed to be an occupancy controlled lighting fixture that reduces light level during unoccupied periods.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an uncontrolled lighting system on continuously, e.g. in stairwells and corridors for health and safety reasons.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for all lighting controls is assumed to be 10 years.<sup>969</sup>

### DEEMED MEASURE COST

When available, the actual cost of the measure shall be used. When not available, the assumed measure cost is \$274.<sup>970</sup>

### LOADSHAPE

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

---

<sup>969</sup> Consistent with Lighting Controls measure.

<sup>970</sup> Consistent with the Multi-level Fixture measure with reference to Goldberg et al, State of Wisconsin Public Service Commission of Wisconsin, Focus on Energy Evaluation, Business Programs: Incremental Cost Study, KEMA, October 28, 2009. Also consistent with field experience of about \$250 per fixture and \$25 install labor.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (KW_{Baseline} - (KW_{Controlled} * (1 - ESF))) * Hours * WHF_e$$

Where:

$KW_{Baseline}$  = Total baseline lighting load of the existing/baseline fixture  
 = Actual

Note that if the existing fixture is only being retrofit with bi-level occupancy controls and not being replaced  $KW_{Baseline}$  will equal  $KW_{Controlled}$ .

$KW_{Controlled}$  = Total controlled lighting load at full light output of the new bi-level fixture  
 = Actual

Hours = Number of hours lighting is on. This measure is limited to 24/7 operation.  
 = 8,766

ESF = Energy Savings factor (represents the percentage reduction to the  $KW_{Controlled}$  due to the occupancy control).  
 = % Standby Mode \* (1 - % Full Light at Standby Mode)

% Standby Mode = Represents the percentage of the time the fixture is operating in standby (i.e. low-wattage) mode.

% Full Light at Standby Mode = Represents the assumed wattage consumption during standby mode relative to the full wattage consumption. Can be achieved either through dimming or a stepped control strategy.

= Dependent on application. If participant provided or metered data is available for both or either of these inputs a custom savings factor should be calculated. If not defaults are provided below:

Application	% Standby Mode	% Full Light at Standby Mode	Energy Savings Factor (ESF)
Stairwells	78.5% <sup>971</sup>	50%	39.3%
		33%	52.6%
		10%	70.7%
		5%	74.6%
Corridors	50.0% <sup>972</sup>	50%	25.0%

<sup>971</sup> Average found from the four buildings in the State of California Energy Commission Lighting Research Program Bi-Level Stairwell Fixture Performance Final Report, October 2005.

<sup>972</sup> Value determined from the Pacific Gas and Electric Company: Bi-Level Lighting Control Credits study for Interior Corridors of Hotels, Motels and High Rise Residential, June 2002.

Application	% Standby Mode	% Full Light at Standby Mode	Energy Savings Factor (ESF)
		33%	33.5%
		10%	45.0%
		5%	47.5%
Other 24/7 Space Type	50.0% <sup>973</sup>	50%	25.0%
		33%	33.5%
		10%	45.0%
		5%	47.5%

WHF<sub>e</sub> = Waste heat factor for energy to account for cooling energy savings from efficient lighting is provided in the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{\text{heatingpenalty}}^{974} = (KW_{\text{Baseline}} - (KW_{\text{Controlled}} * (1 - ESF))) * \text{Hours} * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (KW_{\text{Baseline}} - (KW_{\text{Controlled}} * (1 - ESF))) * WHF_d * (CF_{\text{baseline}} - CF_{\text{os}})$$

Where:

WHF<sub>d</sub> = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If the building is un-cooled WHFd is 1.

CF<sub>baseline</sub> = Baseline Summer Peak Coincidence Factor for the lighting system without Occupancy Sensors installed selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66

CF<sub>os</sub> = Retrofit Summer Peak Coincidence Factor the lighting system with Occupancy Sensors installed is 0.15 regardless of building type.<sup>975</sup>

**NATURAL GAS HEATING PENALTY**

If natural gas heating:

$$\Delta \text{therms} = (KW_{\text{Baseline}} - (KW_{\text{Controlled}} * (1 - ESF))) * \text{Hours} * -IF\text{Therms}$$

Where:

<sup>973</sup> Conservative estimate.

<sup>974</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>975</sup> Coincidence Factor Study Residential and Commercial Industrial Lighting Measures, RLW Analytics, Spring 2007. Note, the connected load used in the calculation of the CF for occupancy sensor lights includes the average ESF.

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting and provided in the Reference Table in Section 4.5 by building type.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-LTG-OCBL-V04-210101**

**REVIEW DEADLINE: 1/1/2025**

4.5.14 Commercial ENERGY STAR Specialty Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8

## 4.5.15 LED Open Sign

### **DESCRIPTION**

LED open signs must replace an existing neon open sign. LED drivers can be either electronic switching or linear magnetic, with the electronic switching supplies being the most efficient. The on/off power switch may be found on either the power line or load side of the driver, with the line side location providing significantly lower standby losses when the sign is turned off and is not operating. All new open signs must meet UL-84 (UL-844) requirements.

Replacement signs cannot use more than 20% of the input power of the sign that is being replaced.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### **DEFINITION OF EFFICIENT EQUIPMENT**

The efficient product is an LED type illuminated open sign.

### **DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment is a neon type illuminated open sign.

### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The estimated useful life is 15 years.<sup>976</sup>

### **DEEMED MEASURE COST**

The actual measure installation cost should be used (including material and labor).

### **LOADSHAPE**

- Loadshape C06 - Commercial Indoor Lighting
- Loadshape C07 - Grocery/Conv. Store Indoor Lighting
- Loadshape C08 - Hospital Indoor Lighting
- Loadshape C09 - Office Indoor Lighting
- Loadshape C10 - Restaurant Indoor Lighting
- Loadshape C11 - Retail Indoor Lighting
- Loadshape C12 - Warehouse Indoor Lighting
- Loadshape C13 - K-12 School Indoor Lighting
- Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
- Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
- Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
- Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
- Loadshape C18 - Industrial Indoor Lighting
- Loadshape C19 - Industrial Outdoor Lighting
- Loadshape C20 - Commercial Outdoor Lighting

---

<sup>976</sup> 15 years from GDS Measure Life Report, June 2007.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section in Section 4.5.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

The following equation was used to determine the energy savings from installing LED open signs:

$$\Delta kWh = (Watts_{base} - Watts_{ee}) / 1,000 * Hours * WHFe$$

Where:

- Watts<sub>base</sub> = Wattage of neon sign with magnetic high voltage transformer  
= Actual; if unknown use 46.0W<sup>977</sup>
- Watts<sub>ee</sub> = Wattage of LED sign with low voltage transformer  
= Actual; if unknown use 14.9W<sup>978</sup>
- Hours = Annual hours of operation, assumed to be consistent with operating hours. Values are provided in the Reference Table in Section 4.5.
- WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**HEATING PENALTY**

If electrically heated building:

$$\Delta kWh_{heatpenalty}^{979} = ((Watts_{base} - Watts_{EE}) / 1000) * Hours * -IFkWh$$

Where:

- IFkWh = Lighting-HVAC Interaction Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

**DEMAND SAVINGS**

$$\Delta kW = ((Watts_{base} - Watts_{see}) / 1000) * CF * WHF_d$$

Where:

- WHF<sub>d</sub> = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in Reference Table in Section 4.5. If unknown, use the Miscellaneous value.
- CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

---

<sup>977</sup> Measured average demand data. Southern California Edison, "Replace Neon Open Sign with LED Open Sign", Workpaper SCE13LG070, Revision 2, October 2015. Pg. 10.

<sup>978</sup> Ibid.

<sup>979</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.



Other variables as provided above.

Based on defaults provided above, the deemed energy savings are provided below:

**Electric Energy and Coincident Peak Demand Savings**

Building Types <sup>980</sup>	Energy Savings (kWh)	$\Delta kWh_{\text{heatpenalty}}$ (if electric heat)	Coincident Demand Savings (kW)
Convenience Store	158	-120	0.0298
Grocery	152	-74	0.0277
Healthcare Clinic	169	-17	0.0374
Hotel/Motel - Common	229	-143	0.0282
Movie Theater	121	-73	0.0227
Restaurant	203	-85	0.0277
Retail - Department Store	191	-88	0.0387
Miscellaneous	115	-55	0.0245

**NATURAL GAS SAVINGS**

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta \text{Therms}^{981} = ((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{Hours} * \text{IFTherms}$$

Where:

IFTherms = Lighting-HVAC Interaction Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

Other factors as defined above

Based on defaults provided above, the deemed penalty is provided below:

Building Type	$\Delta \text{Therms}_{\text{heatpenalty}}$ (if gas heat)
Convenience Store	-5.1
Grocery	-3.2
Healthcare Clinic	-0.7
Hotel/Motel - Common	-6.1
Movie Theater	-3.2
Restaurant	-3.6
Retail - Department Store	-3.7
Miscellaneous	-2.3

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>980</sup> Savings can be calculated for additional building types using the default values provided in the Reference Table in Section 4.5.

<sup>981</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

**MEASURE CODE: CI-LTG-OPEN-V01-180101**

**REVIEW DEADLINE: 1/1/2022**

## 4.5.16 LED Streetlighting

### DESCRIPTION

Existing streetlights are retrofitted to be illuminated with light emitting diodes (LED) instead of less efficient lamps. Incentive applies for the replacement or retrofit of existing streetlights with new LED lamps.

This measure was developed to be applicable to the following program types: EREP, TOS\*. If applied to other program types, the measure savings should be verified.

\* It is recommended to consider likely high freeridership for time of sale applications of this measure.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is the installed LED streetlight.

### DEFINITION OF BASELINE EQUIPMENT

For early replacement, the baseline equipment is the existing streetlight for its' remaining useful life, and a new baseline High Pressure Sodium lamp for the remainder of the measure life. For TOS, baseline is assumed to be High Pressure Sodium lamp.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed effective useful life (EUL) of a new LED streetlight is 20 years for standard operation or 10 years for 8766 hour lighting.<sup>982</sup>

For early replacement, it is assumed the existing unit has a remaining useful life (RUL) of 3 years for standard operation and 1.5 year for 8760 operation.<sup>983</sup>

### DEEMED MEASURE COST

The actual measure installation cost should be used (including material and labor). The assumed deferred cost (after 3 years for standard operation and 1.5 year for 8760 operation) of replacing the existing lamp with a new High Pressure Sodium lamp is assumed to be \$44.<sup>984</sup> This cost should be discounted to present value using the nominal discount rate.

### LOADSHAPE

Loadshape C20 - Commercial Outdoor Lighting

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0 for standard usage or 1.0 for 8766 hour lighting.<sup>985</sup>

---

<sup>982</sup> Based on research conducted by Guidehouse and reported in "ComEd LED St Lighting EUL Results Memo," January 27, 2020, Guidehouse reviewed a cross-section of products covered in 2019 energy conservation programs; these fixtures include the most commonly selected manufacturers and output spanning from 4,000 to 25,000 lumens. This review found that manufactures for the majority of LED streetlights installed through programs in IL have recently doubled the expected rated life to 100,000 hours.

<sup>983</sup> Assuming an existing mercury vapor ballast with a typical rated life of 40,000. Assuming 1/3 remaining useful life and standard operation this equates to  $40,000/3/4303 = 3$  year remaining life, and  $40,000/3/8760 = 1.5$  year remaining life for 8760 operation.

<sup>984</sup> High Pressure Sodium replacement cost (lamp and labor) was provided by ComEd based on their composite maintenance rate.

<sup>985</sup> Assuming standard operation of streetlight occurs outside the summer peak period of 1-5 PM. Coincidence Factor is assumed to equal 0.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

For remaining useful life (1<sup>st</sup> 3 years for standard operation and 1.5 year for 8760 operation) of existing equipment:

$$\Delta kWh = (W_{\text{exist}} - W_{\text{eff}}) * \text{HOURS} / 1000$$

For remaining life of measure (next 17 years for standard operation and 8.5 years for 8760 operation) or time of sale:

$$\Delta kWh = (W_{\text{base}} - W_{\text{eff}}) * \text{HOURS} / 1000$$

Where:

- $W_{\text{exist}}$  =the connected load of the existing equipment  
= actual existing equipment wattage
- $W_{\text{base}}$  =the connected load of the baseline equipment  
= assume appropriate High Pressure Sodium lamp wattage for application.
- $W_{\text{eff}}$  =the connected load of the efficient equipment  
= actual efficient equipment wattage
- EFLH = annual operating hours of the lamp  
= 4,303 hours for standard operation<sup>986</sup>  
= 8,766 hours for always on lighting
- 1000 = conversion factor (W/kW)

**For example**, an existing 469 watts mercury vapor streetlight is replaced by an LED light of 161 watts with standard operation. High Pressure Sodium equivalent is 295 watts:

$$\begin{aligned} \Delta kWh \text{ (first three years)} &= ((469 - 161) * 4,303) / 1000 \\ &= 1,325.3 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh \text{ (remaining seventeen years)} &= ((295 - 161) * 4,303) / 1000 \\ &= 576.6 \text{ kWh} \end{aligned}$$

Therefore, a midlife adjustment of 43.5% (576.6/1325.3) would be applied after 3 years.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (W_{\text{base}} - W_{\text{eff}}) / 1000 * CF$$

Where:

- CF = Summer Peak Coincidence Factor for measure

<sup>986</sup> Based on Navigant verified value using 2014 Astronomical Applications Department, U.S. Naval Observatory data for ComEd’s service territory. See Navigant Memorandum ‘RE: LED Street Lighting Program Hours of Use for the ComEd and DCEO Programs. June 21, 2017’.

= 0 for Standard operation

= 1 for 8766 lighting

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

For EREP: to calculate an O&M adjustment, in addition to the deferred HPS replacement after 3 years, assume one additional HPS replacement lamp costing \$44 in year nine and year fifteen for standard operation or every 2.7 years for 8,766 hour lighting.<sup>987</sup>

For TOS: Assume one additional HPS replacement costing \$44 every 6 years for standard operation or every 2.7 years for 8,766 hour lighting.

**MEASURE CODE: CI-LTG-STRT-V02-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>987</sup> Assumes a rated life of the High Pressure Sodium lamp of 24,000 hours. High Pressure Sodium replacement cost (lamp and labor) was provided by ComEd based on their composite maintenance rate.

## 4.5.17 Exterior Photocell Repair

### DESCRIPTION

This measure characterizes the repair of a photocell on an existing exterior light. A photocell is designed to switch exterior lights off during daylight hours, but if broken the fixtures may remain on 8760 hours.

This measure was developed to be applicable to the following program types: RF.  
If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is an exterior light with a repaired or replaced photocell. The specifications and location of exterior lighting fixtures must be verified.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an exterior light with a broken photocell.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed measure life is 2 years.<sup>988</sup>

### DEEMED MEASURE COST

The deemed measure cost is \$65.52 per lighting sensor.<sup>989</sup>

### LOADSHAPE

Loadshape C19 - Industrial Outdoor Lighting  
Loadshape C20 - Commercial Outdoor Lighting

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 1.0. The savings for this measure will be throughout the daytime hours.

---

### Algorithm

---

#### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (\text{Watts}_{\text{fixture}}/1000) * (\text{HOU}_{\text{PRE}} - \text{HOU}_{\text{POST}})$$

Where:

Watt<sub>s</sub><sub>fixture</sub> = Input wattage of exterior lighting fixture(s) controlled by photocell

HOU<sub>PRE</sub> = Fixture Annual Operating Hours before Photocell repair/replacement

---

<sup>988</sup> Estimated remaining life of an exterior lamp running 8760 hours.

<sup>989</sup> Wisconsin Focus on Energy TRM 2017 based on historical project data cost of 643 units over 31 projects from 2014 to 2018.

= 8,766 hours<sup>990</sup>

HOU<sub>POST</sub> = Fixture Annual Operating Hours with Photocell repaired / replaced

= 4,303 hours<sup>991</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / (HOU_{PRE} - HOU_{POST}) * CF$$

Where:

CF = Summer Peak Coincidence Factor for measure

= 1<sup>992</sup>

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-LTG-PHRP-V01-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>990</sup> Exterior lighting with broken photocells are typically identified by visual inspection during the daytime and it is assumed that exterior lighting that is found to be on during daylight hours is on during *all* day and night hours.

<sup>991</sup> Assumption for Dusk to Dawn as provided in Section 4.5.

<sup>992</sup> The savings for this measure will be throughout the daytime hours when the repaired photocell turns lighting off.

## 4.6 Refrigeration End Use

### 4.6.1 Automatic Door Closer for Walk-In Coolers and Freezers

#### DESCRIPTION

This measure is for installing an auto-closer to the main insulated opaque door(s) of a walk-in cooler or freezer. The auto-closer must firmly close the door when it is within 1 inch of full closure.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

This measure consists of the installation of an automatic, hydraulic-type door closer on main walk-in cooler or freezer doors. These closers save energy by reducing the infiltration of warm outside air into the refrigeration itself.

#### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be a walk in cooler or freezer without an automatic closure.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 8 years.<sup>993</sup>

#### DEEMED MEASURE COST

The deemed measure cost is \$156.82 for a walk-in cooler or freezer.<sup>994</sup>

#### LOADSHAPE

Loadshape C22 - Commercial Refrigeration

#### COINCIDENCE FACTOR

The measure has deemed kW savings therefore a coincidence factor does not apply.

---

#### Algorithm

---

#### CALCULATION OF SAVINGS

##### ELECTRIC ENERGY SAVINGS

Savings calculations are based on values from through PG&E's Workpaper PGECOREF110.1 – Auto-Closers for Main Cooler or Freezer Doors. Savings are averaged across all California climate zones and vintages.<sup>995</sup>

Annual Savings	kWh
Walk in Cooler	943
Walk in Freezer	2307

##### SUMMER COINCIDENT PEAK DEMAND SAVINGS

Annual Savings	kW
Walk in Cooler	0.137

<sup>993</sup> Source: DEER 2014.

<sup>994</sup> Ibid.

<sup>995</sup> Measure savings from ComEd TRM developed by KEMA. June 1, 2010.



Annual Savings	kW
Walk in Freezer	0.309

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-ATDC-V02-190101**

**REVIEW DEADLINE: 1/1/2023**

## 4.6.2 Beverage and Snack Machine Controls

### DESCRIPTION

This measure relates to the installation of new controls on refrigerated beverage vending machines, non-refrigerated snack vending machines, and glass front refrigerated coolers. Controls can significantly reduce the energy consumption of vending machine and refrigeration systems. Qualifying controls must power down these systems during periods of inactivity but, in the case of refrigerated machines, must always maintain a cool product that meets customer expectations. This measure relates to the installation of a new control on a new or existing unit. This measure should **not** be applied to ENERGY STAR qualified vending machines, as they already have built-in controls.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a standard efficiency refrigerated beverage vending machine, non-refrigerated snack vending machine, or glass front refrigerated cooler with a control system capable of powering down lighting and refrigeration systems during periods of inactivity.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a standard efficiency refrigerated beverage vending machine, non-refrigerated snack vending machine, or glass front refrigerated cooler without a control system capable of powering down lighting and refrigeration systems during periods of inactivity.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 5 years.<sup>996</sup>

### DEEMED MEASURE COST

The actual measure installation cost should be used (including material and labor), but the following can be assumed for analysis purposes:<sup>997</sup>

Refrigerated Vending Machine and Glass Front Cooler: \$180.00

Non-Refrigerated Vending Machine: \$80.00

### LOADSHAPE

Loadshape C52 - Beverage and Snack Machine Controls

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0.<sup>998</sup>

---

<sup>996</sup> Measure Life Study, prepared for the Massachusetts Joint Utilities, Energy & Resource Solutions, November 2005.

<sup>997</sup> ComEd workpapers, 8—15-11.pdf.

<sup>998</sup> Assumed that the peak period is coincident with periods of high traffic diminishing the demand reduction potential of occupancy based controls.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{WATTSbase} / 1000 * \text{HOURS} * \text{ESF}$$

Where:

WATTSbase = connected W of the controlled equipment; see table below for default values by connected equipment type:

Equipment Type	WATTSbase <sup>999</sup>
Refrigerated Beverage Vending Machines	400
Non-Refrigerated Snack Vending Machines	85
Glass Front Refrigerated Coolers	460

1000 = conversion factor (W/kW)

HOURS = operating hours of the connected equipment; assumed that the equipment operates 24 hours per day, 365.25 days per year  
= 8766

ESF = Energy Savings Factor; represents the percent reduction in annual kWh consumption of the equipment controlled; see table below for default values:

Equipment Type	Energy Savings Factor (ESF) <sup>1000</sup>
Refrigerated Beverage Vending Machines	46%
Non-Refrigerated Snack Vending Machines	46%
Glass Front Refrigerated Coolers	30%

**For example**, adding controls to a refrigerated beverage vending machine:

$$\begin{aligned} \Delta kWh &= \text{WATTSbase} / 1000 * \text{HOURS} * \text{ESF} \\ &= 400/1000 * 8766 * 0.46 \\ &= 1613 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>999</sup> USA Technologies Energy Management Product Sheets, July 2006; cited September 2009.

<sup>1000</sup> Ibid.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-BEVM-V03-190101**

**REVIEW DEADLINE: 1/1/2022**

### 4.6.3 Door Heater Controls for Cooler or Freezer

#### DESCRIPTION

By installing a control device to turn off door heaters when there is little or no risk of condensation, one can realize significant energy savings. There are two commercially available control strategies that achieve “on-off” control of door heaters based on either (1) the relative humidity of the air in the store, or (2) the “conductivity” of the door (which drops when condensation appears). In the first strategy, the system activates your door heaters when the relative humidity in your store rises above a specific setpoint, and turns them off when the relative humidity falls below that setpoint. In the second strategy, the sensor activates the door heaters when the door conductivity falls below a certain setpoint, and turns them off when the conductivity rises above that setpoint.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a door heater control on a commercial glass door cooler or refrigerator utilizing humidity or conductivity control.

#### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be a commercial glass door cooler or refrigerator with a standard heated door with no controls installed.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>1001</sup>

#### DEEMED MEASURE COST

The incremental capital cost for a humidity-based control is \$300 per circuit regardless of the number of doors controlled. The incremental cost for conductivity-based controls is \$200.<sup>1002</sup>

#### LOADSHAPE

Loadshape C51 - Door Heater Control

#### COINCIDENCE FACTOR<sup>1003</sup>

The summer peak coincidence factor for this measure is assumed to be 0%.<sup>1004</sup>

---

---

#### Algorithm

---

#### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWH} = \text{kWbase} * \text{NUMdoors} * \text{ESF} * \text{BF} * 8766$$

---

<sup>1001</sup> As recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

<sup>1002</sup> Efficiency Vermont Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions, February, 19, 2010.

<sup>1003</sup> Source partial list from DEER 2008.

<sup>1004</sup> Based on the assumption that humidity levels will most likely be relatively high during the peak period, reducing the likelihood of demand savings from door heater controls.

Where:

- kWbase<sup>1005</sup> = connected load kW for typical reach-in refrigerator or freezer door and frame with a heater.  
= If actual kWbase is unknown, assume 0.195 kW for freezers and 0.092 kW for coolers.
- NUMdoors = number of reach-in refrigerator or freezer doors controlled by sensor  
= Actual installed
- ESF<sup>1006</sup> = Energy Savings Factor; represents the percentage of hours annually that the door heater is powered off due to the controls.  
= assume 55% for humidity-based controls, 70% for conductivity-based controls
- BF<sup>1007</sup> = Bonus Factor; represents the increased savings due to reduction in cooling load inside the cases, and the increase in cooling load in the building space to cool the additional heat generated by the door heaters.

Definition	Representative Evaporator Temperature Range, °F <sup>1008</sup>	Typical Uses	BF
Low	-35 to 0	Freezers for times such as frozen pizza, ice cream, etc.	1.36
Medium	0 – 20	Coolers for items such as meat, milk, dairy, etc	1.22
High	20 – 45	Coolers for items such as floral, produce and meat preparation rooms	1.15

8766 = annual hours of operation

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1005</sup> A review of TRM methodologies from Vermont, New York, Wisconsin, and Connecticut reveals several different sources for this factor. Connecticut requires site-specific information, whereas New York’s characterization does not explicitly identify the kWbase. Connecticut and Vermont provide values that are very consistent, and the simple average of these two values has been used for the purposes of this characterization.

<sup>1006</sup> A review of TRM methodologies from Vermont, New York, Wisconsin, and Connecticut reveals several different estimates of ESF. Vermont is the only TRM that provides savings estimates dependent on the control type. Additionally, these estimates are the most conservative of all TRMs reviewed. These values have been adopted for the purposes of this characterization.

<sup>1007</sup> Efficiency Vermont Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions, February, 19, 2010. Note, these numbers differ from those factors listed in the Lighting End Use tables because interactive effects within this measure occur with both the refrigeration and HVAC systems.

<sup>1008</sup> Energy Efficiency Supermarket Refrigeration, Wisconsin Electric Power Company, July 23, 1993.

**MEASURE CODE: CI-RFG-DHCT-V03-200101**

**REVIEW DEADLINE: 1/1/2022**

#### 4.6.4 Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers

##### DESCRIPTION

This measure is applicable to the replacement of an existing, uncontrolled, and continuously operating standard-efficiency shaded-pole evaporator fan motor in refrigerated display cases or fan coil in walk-ins.

This measure achieves savings by installing a more efficient motor, the result of which produces less waste heat that the cooling system must reject.

If applicable, savings from this measure may be claimed in combination with measure 4.6.6 Evaporator Fan Control for Electrically Commutated Motors.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

##### DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to the replacement of an existing standard-efficiency shaded-pole evaporator fan motor in refrigerated display cases or fan coil in walk-ins. The replacement unit must be an electronically commutated motor (ECM) with a minimum efficiency of 66%. If controls are added as part of the motor upgrade to reduce annual run time, additional savings may potentially be claimed using measure 4.6.6 Evaporator Fan Control.

##### DEFINITION OF BASELINE EQUIPMENT

The baseline is the existing shaded-pole motor(s) with no fan control operating 8760 hours continuously in a refrigerated display case or fan coil unit of a walk-in cooling unit.

##### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.<sup>1009</sup>

##### DEEMED MEASURE COST

The measure cost is assumed to be \$177 per motor for a walk in cooler and walk in freezer.<sup>1010</sup>

##### LOADSHAPE

Loadshape C53 - Flat

##### COINCIDENCE FACTOR

The peak kW coincidence factor is 100%.

---

---

#### Algorithm

---

##### CALCULATION OF SAVINGS

##### ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \text{Savings per motor} * \text{motors}$$

Where:

Savings per motor = based on the motor rating of the ECM motor:

---

<sup>1009</sup> DEER

<sup>1010</sup> Difference in the fully installed cost (\$468) for ECM motor and controller, listed in Work Paper PGE3PREF126, "ECM for Walk-In Evaporator with Fan Controller," June 20,2012, and the measure cost specified in 4.6.6 (\$291).



Evaporator Fan Motor Rating (of ECM)	Annual kWh Savings/motor
16W	408
1/15 - 1/20HP	1,064
1/5HP	1,409
1/3HP	1,994
1/2HP	2,558
3/4HP	2,782

= If unknown, assume 1/15 HP, therefore 1,064 kWh saved / motor<sup>1011</sup>

motors

= number of fan motors replaced

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / \text{Hours} * CF * \text{motors}$$

Where:

$\Delta kWh$  = Gross customer annual kWh savings for the measure, as listed above

= If unknown, assume 1,064 kWh<sup>1012</sup>

Hours = Full Load hours per year

= 8760

CF = Summer Peak Coincident Factor

= 1.0

Other variables as defined above.

The following table provides the resulting kW savings (per motor), if unknown assume 0.121 kW saved / motor:<sup>1013</sup>

Evaporator Fan Motor Rating (of ECM)	Peak kW Savings/motor
16W	0.047
1/15 - 1/20HP	0.121
1/5HP	0.161
1/3HP	0.228
1/2HP	0.292
3/4HP	0.318

### NATURAL GAS ENERGY SAVINGS

N/A

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

<sup>1011</sup> Default motor size for EC Evaporator was found to be  $\leq$  1/15 HP per the ComEd Standard Program data. See ECM Motor Size Supplement.xlsx.

<sup>1012</sup> Ibid.

<sup>1013</sup> Ibid.

**MEASURE CODE: CI-RFG-ECMF-V03-210101**

**REVIEW DEADLINE: 1/1/2022**

## 4.6.5 ENERGY STAR Refrigerated Beverage Vending Machine

### DESCRIPTION

ENERGY STAR qualified new and rebuilt vending machines incorporate more efficient compressors, fan motors, and lighting systems as well as low power mode option that allows the machine to be placed in low-energy lighting and/or low-energy refrigeration states during times of inactivity.

This measure was developed to be applicable to the following program types: TOS, NC .

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The refrigerated vending machine can be new or rebuilt but must meet the ENERGY STAR specifications, as outlined below.<sup>1014</sup>

A. Refrigerated Beverage Vending Machine: A commercial refrigerator that cools bottled and/or canned beverages and dispenses the bottled and/or canned beverages on payment. Bottled or canned beverages means a beverage in a sealed container.

a. Class A Machine: A refrigerated bottled and/or canned beverage vending machine that is not a combination vending machine and in which 25 percent or more of the surface area on the front side of the beverage vending machine is transparent.

b. Class B Machine: Any refrigerated bottled and/or canned beverage vending machine not considered to be Class A, and is not a combination vending machine

B. Combination Vending Machine: A bottled and/or canned beverage vending machine containing two or more compartments separated by a solid partition, that may or may not share a product delivery chute, in which at least one compartment is designed to be refrigerated, as demonstrated by the presence of temperature controls, and at least one compartment is not.

a. Combination A Machine: A combination vending machine where 25 percent or more of the surface area on the front side of the beverage vending machine is transparent.

b. Combination B Machine: A combination vending machine that is not considered to be Combination A.

### DEFINITION OF BASELINE EQUIPMENT

The baseline vending machine is a standard unit.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed lifetime of this measure is 14 years.<sup>1015</sup>

### DEEMED MEASURE COST

The incremental cost of this measure is \$500.<sup>1016</sup>

### LOADSHAPE

Loadshape C22 - Commercial Refrigeration

---

<sup>1014</sup> ENERGY STAR Program Requirements Specification for Refrigerated Beverage Vending Machines, Version 4.0

<sup>1015</sup> ENERGY STAR

<sup>1016</sup> ENERGY STAR

**COINCIDENCE FACTOR**

It is assumed that controls are only effective during off-peak hours and so have no peak-kW savings.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Using the ENERGY STAR MDEC Equations, as specified in the above paragraph and the Baseline Equipment DOE Standards,<sup>1017</sup> the theoretical energy savings are calculated as:

$$\Delta kWh = (MDEC_{Baseline} - MDEC_{Efficient}) * Days$$

Where:

- MDEC<sub>Baseline</sub> = Maximum Daily Energy Consumption calculated using the equation from the table below, specific for the baseline equipment class and the volume range
- MDEC<sub>Efficient</sub> = Maximum Daily Energy Consumption calculated using the equation from the table below, specific for the ENERGY STAR Specification 4.0 equipment class and the volume range
- Days = Days per year  
= Actual. If unknown, assume 365.

Maximum Daily Energy Consumption (MDEC) equations for Baseline Equipment and ENERGY STAR equipment compliant with ENERGY STAR Specification V4.0 are outline in the table below:

Product Class	Refrigerated Volume Range (ft <sup>3</sup> )	MDEC Equation (kWh/day) Federal Standard: Baseline Equipment	MDEC Equation (kWh/day) ENERGY STAR Specification V 4.0
Class A	11.5 - 38.5	0.052 * V + 2.43	0.04836 * V + 2.2599
Class B	21.8 - 30.5	0.052 * V + 2.20	0.04576 * V + 1.936
Combination A	9.7 - 16	0.086 * V + 2.66	0.07998 * V + 2.4738
Combination B	N/A	0.111 * V + 2.04	0.09768 * V + 1.7952

Where:

V = the refrigerated volume (ft<sup>3</sup>) of the refrigerated bottled or canned beverage vending machine, as specified in Appendix C.<sup>1018</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

N/A

---

<sup>1017</sup> CFR Title 10: Energy. PART 431—ENERGY EFFICIENCY PROGRAM FOR CERTAIN COMMERCIAL AND INDUSTRIAL EQUIPMENT

<sup>1018</sup> Appendix C of the American National Standards Institute (ANSI)/ American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE) Standard 32.1 - 2010, "Methods of Testing for Rating Vending Machines for Bottled, Canned or Other Sealed Beverages." For combination vending machines, the refrigerated volume does not include any non-refrigerated compartments.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-ESVE- V04-210101**

**REVIEW DEADLINE: 1/1/2025**

## 4.6.6 Evaporator Fan Control for Electrically Commutated Motors

### DESCRIPTION

This measure is for the installation of controls for Electronically Commutated Motors in existing medium temperature walk-in coolers. The controller reduces airflow of the evaporator fans when there is no refrigerant flow.

This measure achieves savings by controlling the motor(s) to run at lower speeds (or shut off entirely) when there is no refrigerant flow, the result of which produces less waste heat that the cooling system must reject.

If eligible, this measure may be claimed in combination with 4.6.4 Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The measure must control a minimum of 1/20 HP where fans operate continuously at full speed. The measure also must reduce fan motor power by at least 75% during the off cycle. This measure is not applicable if any of the following conditions apply:

- The compressor runs more than 4380 hours annually
- The evaporator fan does not run at full speed all the time
- The evaporator fan motor runs on poly-phase power
- Evaporator does not use off-cycle or time-off defrost.

### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the existing condition must be a reach-in or walk-in freezer or cooler with continuously running evaporator fans driven by Electrically Commutated Motors

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 13 years.<sup>1019</sup>

### DEEMED MEASURE COST

The measure cost is assumed to be \$291.<sup>1020</sup>

### LOADSHAPE

Loadshape C46 - Evaporator Fan Control

### COINCIDENCE FACTOR

The measure has deemed kW savings therefore a coincidence factor does not apply.

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

Savings are based on a measure created by Energy & Resource Solutions for the California Municipal Utilities Association<sup>1021</sup> and supported by a PGE workpaper. Note that climate differences across all California climate zones

---

<sup>1019</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1020</sup> Source: DEER

<sup>1021</sup> See 'EC\_motor\_with\_controller\_182014.xlsx'.

result in negligible savings differences, which indicates that the average savings for the California study should apply equally as well to Illinois. Savings found in the aforementioned source are presented in combination with savings from an ECM upgrade, however for the purposes of this measure only those associated with the controller are considered.

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{Savings per motor} * \text{motors}$$

Where:

Savings per motor = based on the motor rating of the ECM motor:

Evaporator Fan Motor Rating (of ECM)	Annual kWh Savings/motor
16W	212
1/15 - 1/20HP	315
1/5HP	920
1/3HP	1,524
1/2HP	2,283
3/4HP	3,444

motors = number of fan motors controlled

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Peak kW savings per motor (as listed in the table below)} * \text{motors (as defined above)}$$

Evaporator Fan Motor Rating (of ECM)	Peak kW Savings/motor
16W	0.024
1/15 - 1/20HP	0.036
1/5HP	0.105
1/3HP	0.174
1/2HP	0.261
3/4HP	0.393

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-EVPP-V04-190101**

**REVIEW DEADLINE: 1/1/2024**

## 4.6.7 Strip Curtain for Walk-in Coolers and Freezers

### DESCRIPTION

This commercial measure pertains to the installation of infiltration barriers (strip curtains) on walk-in coolers or freezers. Strip curtains impede heat transfer from adjacent warm and humid spaces into walk-ins when the main door is opened, thereby reducing the cooling load. As a result, compressor run time and energy consumption are reduced. The engineering assumption is that the walk-in door is open for varying durations per day based on facility type, and the strip curtain covers the entire door frame. All assumptions are based on values that were determined by direct measurement and monitoring of over 100 walk-in units in the 2006-2008 evaluation for the CA Public Utility Commission.<sup>1022</sup>

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a strip curtain at least 0.06 inches thick added to a walk-in cooler or freezer.<sup>1023</sup> The new strip curtain must cover the entire area of the doorway when the door is opened.

### DEFINITION OF BASELINE EQUIPMENT

The baseline assumption is a walk-in cooler or freezer that previously had either no strip curtain installed or an old, ineffective strip curtain installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 4 years.<sup>1024</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$10.22/sq ft of door opening.<sup>1025</sup>

### LOADSHAPE

Loadshape C22 - Commercial Refrigeration

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is 100%.<sup>1026</sup>

---

<sup>1022</sup> The scale factors have been determined with tracer gas measurements on over 100 walk-in refrigeration units during the California Public Utility Commission's (CPUC) evaluation of the 2006-2008 CA investor owned utility energy efficiency programs. The door-open and close times, and temperatures of the infiltrating and refrigerated airs are taken from short-term monitoring of over 100 walk-in units. "Commercial Facilities Contract Group 2006-2008 Direct Impact Evaluation", CPUC, February 2010.

<sup>1023</sup> Pennsylvania Public Utility Commission TRM, chapter 3.5.9 Strip Curtains for Walk-in Freezers and Coolers.

<sup>1024</sup> DEER 2014 Effective Useful Life.

<sup>1025</sup> The reference for incremental cost is \$10.22 per square foot of door opening (includes material and labor). 2008 Database for Energy-Efficiency Resources (DEER), Version 2008.2.05, "Cost Values and Summary Documentation", California Public Utilities Commission, December 16, 2008.

<sup>1026</sup> The summer coincident peak demand reduction is assumed as the total annual savings divided by the total number of hours per year, effectively assuming the average demand reduction is realized during the peak period. This is a reasonable assumption for refrigeration savings.



**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS<sup>1027</sup>**

$$\Delta kWh = \Delta kWh/sq\ ft * A$$

Where:

$\Delta kWh/sq\ ft$  = Average annual kWh savings per square foot of infiltration barrier. Values can be found in Table 4.6.7 - 1.

A = Doorway area. If the actual doorway area in square feet is unknown, then use the values found in Table 4.6.7 - 2.

Table 4.6.7 - 1: Default Energy Savings and for Strip Curtains<sup>1028</sup>

Type	Pre-Existing Curtains	Energy Savings $\Delta kWh/sq\ ft$
Supermarket - Cooler	Yes	37
Supermarket - Cooler	No	108
Supermarket - Freezer	Yes	119
Supermarket - Freezer	No	349
Convenience Store - Cooler	Yes	5
Convenience Store - Cooler	No	20
Convenience Store - Freezer	Yes	8
Convenience Store - Freezer	No	27
Restaurant - Cooler	Yes	8
Restaurant - Cooler	No	30
Restaurant - Freezer	Yes	34
Restaurant - Freezer	No	119
Refrigerated Warehouse	Yes	254
Refrigerated Warehouse	No	729

Table 4.6.7 - 2: Default Doorway Area by Facility Type<sup>1029</sup>

Facility Type	Doorway Area (sq ft)
Supermarket - Cooler	35
Supermarket - Freezer	35
Convenience Store - Cooler	21
Convenience Store - Freezer	21
Restaurant - Cooler	21
Restaurant - Freezer	21

<sup>1027</sup> The source algorithm from which the savings per square foot values are determined is based on Tamm’s equation (an application of Bernoulli’s equation) [Kaltverluste durch kuhlraumoffnungen. Tamm W., Kaltetechnik-Klimatisierung 1966;18;142-144;] and the ASHRAE handbook [American Society of Heating, Refrigeration, and Air-Conditioning Engineers (ASHRAE). 2010. ASHRAE Handbook, Refrigeration: 13.4, 13.6].

<sup>1028</sup>Table 3-114 Default Energy Savings and Demand Reductions for Strip Curtains in Pennsylvania Public Utility Commission TRM, chapter 3.5.9 Strip Curtains for Walk-in Freezers and Coolers.

<sup>1029</sup> Assumed Doorway area for four different facility types including supermarket, convenience store, restaurant and refrigerated warehouse. Pennsylvania Public Utility Commission 2016 TRM, chapter 3.5.9 Strip Curtains for Walk-in Freezers and Coolers.

Facility Type	Doorway Area (sq ft)
Refrigerated Warehouse	80

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / 8766 * CF$$

Where:

$$8766 = \text{hours per year}$$

$$CF = \text{Summer Peak Coincidence Factor for the measure}$$
$$= 1.0$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-CRTN-V04-180101**

**REVIEW DEADLINE: 1/1/2022**

## 4.6.8 Refrigeration Economizers

### DESCRIPTION

This measure applies to commercial walk in refrigeration systems and includes two components, outside air economizers and evaporator fan controllers. Economizers save energy by bringing in outside air when weather conditions allow, rather than operating the compressor. Walk-in refrigeration systems evaporator fans run almost all the time; 24 hrs/day, 365 days/yr. This is because they must run constantly to provide cooling when the compressor is running, and to provide air circulation when the compressor is not running. However, evaporator fans are a very inefficient method of providing air circulation. Installing an evaporator fan control system will turn off evaporator fans while the compressor is not running, and instead turn on an energy-efficient 35 watt fan to provide air circulation, resulting in significant energy savings. This measure allows for economizer systems with evaporator fan controls plus a circulation fan and without a circulation fan.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified. IECC code requires economizers in certain instances and therefore projects relying on code baseline definitions must verify eligibility.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure an economizer is installed on a walk in refrigeration system.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a walk-in refrigeration system without an economizer

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated life of this measure is 15 years.<sup>1030</sup>

### DEEMED MEASURE COST

Installation costs can vary considerably depending on system size (larger systems may require multiple economizer units), physical site layouts (locating economizer intakes and ductwork), and controls elected. Therefore, actual site-specific costs should be used.

### LOADSHAPE

Loadshape C22 - Commercial Refrigeration

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0%.<sup>1031</sup>

---

---

### Algorithm

---

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

Electric energy savings is calculated based on whether evaporator fans run all.

#### With Fan Control Installed

---

<sup>1030</sup> Estimated life from Efficiency Vermont TRM.

<sup>1031</sup> Based on the assumption that humidity levels will most likely be relatively high during the peak period, reducing the likelihood of demand savings.

$$\Delta kWh = [HP * kWhCond] + [(kWEvap * nFans) - kW\Circ) * Hours * DCComp * BF] - [kWEcon * DCEcon * Hours]$$

Without Fan Control Installed

$$\Delta kWh = [HP * kWhCond] - [kWEcon * DCEcon * Hours]$$

Where:

HP = Horsepower of Compressor  
= actual installed

kWhCond = Condensing unit savings, per hp. (value from savings table)<sup>1032</sup>

	Hermetic / Semi-Hermetic	Scroll	Discus
kWh/HP	1,256	1,108	1,051

Hours = Number of annual hours that economizer operates<sup>1033</sup>

Region (city)	Hours
1 (Rockford)	2,376
2 (Chicago/O'Hare)	1,968
3 (Springfield)	1,728
4 (Bellevue)	1,488
5 (Marion)	1,224

DCComp = Duty cycle of the compressor  
= 50%<sup>1034</sup>

kWEvap = Connected load kW of each evaporator fan  
= If known, actual installed. Otherwise assume 0.123 kW<sup>1035</sup>

kWCirc = Connected load kW of the circulating fan  
= If known, actual installed. Otherwise assume 0.035 kW<sup>1036</sup>

nFans = Number of evaporator fans  
= actual number of evaporator fans

DCEcon = Duty cycle of the economizer fan on days that are cool enough for the economizer to be working

<sup>1032</sup> Savings table uses Economizer Calc.xls. Assume 5HP compressor size used to develop kWh/HP value. No floating head pressure controls and compressor is located outdoors.

<sup>1033</sup> In the source TRM (VT) this value was 2,996 hrs based on 38° F cooler setpoint, Burlington VT weather data, and 5 degree economizer deadband. The IL numbers were calculated by using weather bin data for each location (number of hours < 38F at each location is the Hours value).

<sup>1034</sup> A 50% duty cycle is assumed based on examination of duty cycle assumptions from Richard Travers (35%-65%), Cooltrol (35%-65%), Natural Cool (70%), Pacific Gas & Electric (58%). Also, manufacturers typically size equipment with a built-in 67% duty factor and contractors typically add another 25% safety factor, which results in a 50% overall duty factor. (as referenced by the Efficiency Vermont, Technical Reference User Manual).

<sup>1035</sup> Based on a weighted average of 80% shaded pole motors at 132 watts and 20% PSC motors at 88 watts.

<sup>1036</sup> Wattage of fan used by Freeaire and Cooltrol. This fan is used to circulate air in the cooler when the evaporator fan is turned off. As such, it is not used when fan control is not present.

- = If known, actual installed. Otherwise assume 63%<sup>1037</sup>
- BF = Bonus factor for reduced cooling load from running the evaporator fan less or (1.3)<sup>1038</sup>
- kWEcon = Connected load kW of the economizer fan
- = If known, actual installed. Otherwise assume 0.227 kW.<sup>1039</sup>

**For example**, adding an outdoor air economizer and fan controls in Rockford to a 5 hp walk in refrigeration unit with 3 evaporator fans would save:

$$\begin{aligned} \Delta\text{kWh} &= [\text{HP} * \text{kWhCond}] + [((\text{kWEvap} * \text{nFans}) - \text{kWCirc}) * \text{Hours} * \text{DCComp} * \text{BF}] - [\text{kWEcon} * \text{DCEcon} * \text{Hours}] \\ &= [5 * 1256] + [((0.123 * 3) - 0.035) * 2376 * 0.5 * 1.3] - [0.227 * 0.63 * 2376] \\ &= 6456 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh} / \text{Hours}$$

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-ECON-V06-200101**

**REVIEW DEADLINE: 1/1/2024**

<sup>1037</sup> Average of two manufacturer estimates of 50% and 75%.

<sup>1038</sup> Bonus factor (1+ 1/3.5) assumes COP of 3.5, based on the average of standard reciprocating and discus compressor efficiencies with a Saturated Suction Temperature of 20°F and a condensing temperature of 90°F.

<sup>1039</sup> The 227 watts for an economizer is calculated from the average of three manufacturers: Freeaire (186 Watts), Cooltrol (285 Watts), and Natural Cool (218 Watts).

## 4.6.9 Night Covers for Open Refrigerated Display Cases

### DESCRIPTION

This measure is the installation of fitted covers on existing open-type refrigerated and freezer display cases that are deployed during the facility unoccupied hours. Night covers are designed to reduce refrigeration energy consumption by reducing the work done by the compressor. Night covers reduce the heat and moisture entry into the refrigerated space through various heat transfer mechanisms. By fully or partially covering the case opening, night covers reduce the convective heat transfer into the case through reduced air infiltration. Additionally, they provide a measure of insulation, reducing conduction into the case, and also decrease radiation into the case by blocking radiated heat from entering the refrigerated space.

### DEFINITION OF EFFICIENT EQUIPMENT

Curtains or covers on top of open refrigerated or freezer display cases that are applied at least six hours (during off-hours) in a 24-hour period.

### DEFINITION OF BASELINE EQUIPMENT

Refrigerated and freezer, open-type display case in vertical, semi-vertical, and horizontal displays, with no night cover.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 5 years, based on DEER 2014.<sup>1040</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$42 per linear foot of cover installed including material and labor.<sup>1041</sup>

### LOADSHAPE

Loadshape 22: Commercial Refrigeration

### COINCIDENCE FACTOR

N/A – savings occur at night only.

---



---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \text{ES} * \text{L}$$

Where:

ES = the energy savings ( $\Delta\text{kWh}/\text{ft}$ ) found in table below:

---

<sup>1040</sup> 2014 Database for Energy-Efficiency Resources (DEER), Version 2014, "Cost Values and Summary Documentation", California Public Utilities Commission, January, 2014.

<sup>1041</sup> 2014 Database for Energy-Efficiency Resources (DEER), Version 2014, "Cost Values and Summary Documentation", California Public Utilities Commission, January, 2014.

Display Case Description	Case Temperature Range (°F)	Annual Electricity Use kWh/ft <sup>1042</sup>	ES ΔkWh/ft reduction (= 9% reduction of electricity use <sup>1043,1044</sup> )
Vertical Open, Remote Condensing, Medium Temperature	35°F to 55°F	1453	131
Vertical Open, Remote Condensing, Low Temperature	0°F to 30°F	3292	296
Vertical Open, Self-Contained Medium Temperature	35°F to 55°F	2800	252
Horizontal Open, Remote Condensing, Medium Temperature	35°F to 55°F	439	40
Horizontal Open, Remote Condensing, Low Temperature	0°F to 30°F	1007	91
Horizontal Open, Self-Contained, Medium Temperature	35°F to 55°F	1350	121
Horizontal Open, Self-Contained, Low Temperature	0°F to 30°F	2749	247

L = the length of the refrigerated case in linear feet  
 = Actual

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Peak savings are null because savings occur at night only.

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1042</sup> Energy Conservation Standards for Commercial Refrigeration Equipment: Technical Support Document, U.S. Department of Energy, September 2013. The information required to estimate annual energy savings for refrigerated display cases is taken from the 2013-2014 U.S. Department of Energy (DOE) energy conservation standard rulemaking for Commercial Refrigerated Equipment. During the rulemaking process, DOE estimates the energy savings specific to night covers through extensive simulation and energy models that are validated by both manufacturers of night covers and refrigerated cases. The information is also referenced from a study done by Southern California Edison and testing by Technischer Überwachungs-Verein Rheinland, which are used by DOE for the rulemaking process.

<sup>1043</sup> Southern California Edison Refrigeration Technology and Test Center. Effects of the Low Emissivity Shields on Performance and Power Use of a Refrigerated Display Case. 1997. Southern California Edison, Rancho Cucamonga, CA.

<sup>1044</sup> Technischer Überwachungs-Verein Rheinland E.V. Laboratory test results for energy savings on refrigerated dairy case, conducted for Econofrost.

**MEASURE CODE: CI-RFG-NCOV-V01-150601**

**REVIEW DEADLINE: 1/1/2024**



## 4.6.10 High Speed Rollup Doors

### DESCRIPTION

This measure entails the installation of High Speed Doors in refrigerated warehouses. High speed doors can save energy by lowering infiltration through a reduction in time that cooled spaces are exposed to ambient outdoor conditions. This in turn can lower the demand on refrigeration systems.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a High Speed Door installed on the loading dock doorway of a refrigerated space. The high speed door is assumed to act as a primary door. It should be noted that for high-traffic applications (about 45 door passages per hour, using the defaults for this measure) a custom analysis is necessary to ensure that high-speed rollup doors will provide savings, because strip curtains may outperform the high speed door, if no other open-door protection device is installed.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is existing strip curtains on doorways to a loading dock. During times of traffic, primary doors are left open, leaving just the strip curtains as open-doorway protection.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years.<sup>1045</sup>

### DEEMED MEASURE COST

The incremental measure cost is \$150/sqft.<sup>1046</sup>

### LOADSHAPE

Loadshape C22 - Commercial Refrigeration

### COINCIDENCE FACTOR

The coincidence factor is assumed to be 1.00.

---



---

### Algorithm

---



---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

Electric savings consider the change in loading on the refrigeration system as well as the consumption of the drive on the high speed door. The following algorithms are based heavily on those derived and described in chapter 24 Refrigerated-Facility Loads of the ASHRAE Refrigeration Handbook.

$$\Delta kWh = (0.00008333 * q * D_f * \eta * [D_{tB}(1 - E_B) - D_{tE}(1 - E_E)] - D_{tM}M) * t$$

Where:

0.00008333 = conversion from Btu/h to tons

---

<sup>1045</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1046</sup> Rite Hite – Industrial High Speed Doors


$q$  = sensible and latent refrigeration load for fully established flow, Btu/h

$$= 3790 * W * H^{1.5} * \left(\frac{Q_s}{A}\right) * \left(\frac{1}{R_s}\right)$$

$W$  = width of doorway, in feet. Custom input.

$H$  = height of doorway, in feet. Custom input.

$\frac{Q_s}{A}$  = Sensible heat load of infiltration air per square foot of door way opening, as read from the following figure and dependent on infiltration air temperature and cooled space temperature. If unknown, infiltration temperature can be assumed to be 50° F,<sup>1047</sup> cooler temperature 35° F, and freezer temperature -10° F,<sup>1048</sup> resulting in values of 0.06 for a cooler and 0.5 for a freezer.

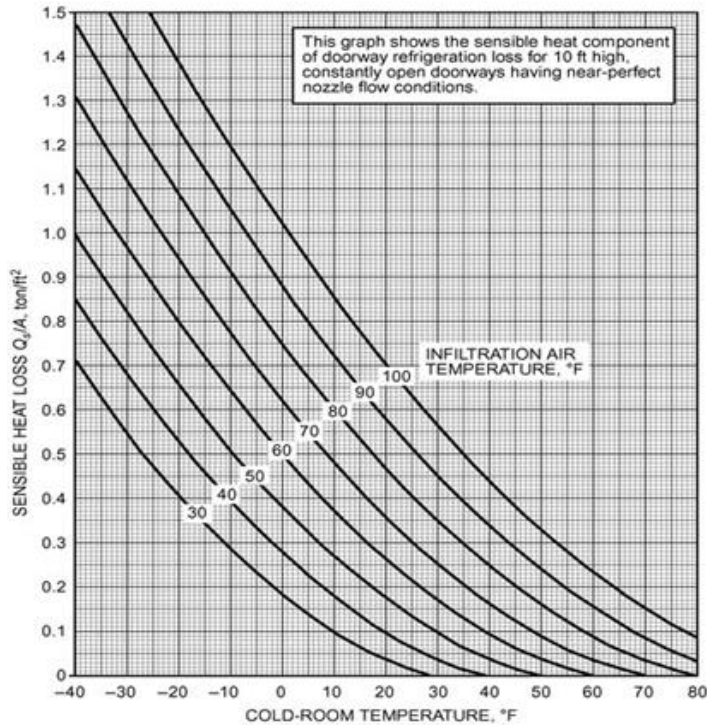

$R_s$  = Sensible heat ratio of the infiltration air heat gain, as read or interpolated from the chart below or from a psychrometric chart, dependent on temperature and relative humidity of infiltration air and cooled space temperature. If unknown, use the same assumptions as previously, with a warm space relative humidity value of 70%,<sup>1049</sup> resulting in values of 0.685 (interpolated) for coolers and 0.73 (interpolated) for freezers.

<sup>1047</sup> Taken to represent the overall annual average temperature in Illinois. TMY3 data for the five weather regions defined by the TRM indicate averages that fall within the range of 47.6 (Rockford) to 55.9 (Marion).

<sup>1048</sup> Refrigerated Warehouse, 2013 California Building Energy Standards, CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE), March 2011,

<sup>1049</sup> Taken to represent the overall annual average in Illinois. TMY3 data for the five weather regions defined by the TRM indicate averages that fall within the range of 69.1 (Springfield) to 72.1 (Rockford).

Warm Space		Cold Space at 90% rh									
Temp.	rh	Dry-Bulb Temperature, °F									
°F	%	-40	-30	-20	-10	0	10	20	30	40	50
70	100	0.60	0.58	0.56	0.53	0.50	0.47	0.44	0.41	0.37	0.34
	80	0.66	0.64	0.61	0.59	0.56	0.53	0.50	0.48	0.46	0.44
	60	0.72	0.70	0.68	0.66	0.63	0.61	0.59	0.58	0.59	0.64
	40	0.79	0.78	0.76	0.75	0.73	0.72	0.71	0.73	0.80	—
60	100	0.66	0.64	0.62	0.59	0.56	0.52	0.49	0.45	0.41	0.35
	80	0.71	0.69	0.67	0.64	0.62	0.59	0.56	0.53	0.52	0.53
	60	0.77	0.75	0.73	0.71	0.69	0.67	0.65	0.65	0.70	—
	40	0.83	0.82	0.81	0.79	0.78	0.77	0.78	0.83	—	—
50	100	0.72	0.70	0.67	0.64	0.61	0.57	0.53	0.49	0.43	—
	80	0.76	0.74	0.72	0.70	0.67	0.64	0.61	0.59	0.62	—
	60	0.81	0.80	0.78	0.76	0.74	0.72	0.71	0.75	—	—
	40	0.87	0.86	0.84	0.83	0.82	0.82	0.85	—	—	—
40	100	0.77	0.75	0.72	0.69	0.66	0.62	0.57	0.51	—	—
	80	0.81	0.79	0.77	0.74	0.72	0.69	0.66	0.67	—	—
	60	0.85	0.84	0.82	0.80	0.78	0.77	0.79	0.99	—	—
	40	0.90	0.89	0.88	0.87	0.86	0.88	0.97	—	—	—
30	100	0.82	0.80	0.77	0.74	0.70	0.66	0.59	—	—	—
	80	0.85	0.83	0.81	0.79	0.76	0.73	0.73	—	—	—
	60	0.88	0.87	0.86	0.84	0.83	0.83	0.94	—	—	—
	40	0.92	0.91	0.90	0.90	0.91	0.96	—	—	—	—
20	100	0.86	0.84	0.82	0.79	0.75	0.69	—	—	—	—
	80	0.89	0.87	0.85	0.83	0.81	0.80	—	—	—	—
	60	0.91	0.90	0.89	0.88	0.88	0.95	—	—	—	—
	40	0.94	0.94	0.93	0.94	0.97	—	—	—	—	—
10	100	0.90	0.88	0.86	0.83	0.78	—	—	—	—	—
	80	0.92	0.90	0.89	0.87	0.86	—	—	—	—	—
	60	0.94	0.93	0.92	0.92	0.96	—	—	—	—	—
	40	0.96	0.96	0.96	0.98	—	—	—	—	—	—
0	100	0.92	0.91	0.89	0.85	—	—	—	—	—	—
	80	0.94	0.93	0.92	0.91	—	—	—	—	—	—
	60	0.96	0.95	0.95	0.97	—	—	—	—	—	—
	40	0.97	0.97	0.98	—	—	—	—	—	—	—

D<sub>f</sub> = doorway flow factor. Equal to 0.8 for a doorway between a freezer and a dock and 1.1 for a doorway between a cooler and a dock.<sup>1050</sup>

η = Efficiency of refrigeration system (kW/ton). Custom input, if unknown assume 1.6 kW/ton for coolers and 2.4 kW/ton for freezers.<sup>1051</sup>

D<sub>tB</sub> = decimal portion of time doorway is open in the baseline condition. If during facility operating hours, the primary doors are left open, leaving only open-doorway protective devices (e.g., strip curtains) as a barrier, this is considered 1.0. If primary doors are actively operated and do not remain open for the entire time the facility is in operation, refer to the following calculation.

$$D_{tB} = \frac{(P \theta_{pB} + 60 \theta_{oB})}{3600 \theta_d}$$

P = Number of passages through doorway per hour.

θ<sub>pB</sub> = Door open to close time in seconds.

θ<sub>oB</sub> = Time door remains open in minutes.

θ<sub>d</sub> = Period of time considered in hours, 1 hr.

D<sub>tE</sub> = decimal portion of time doorway is open in the efficient condition.

<sup>1050</sup> ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.7.

<sup>1051</sup> Professional judgement, in alignment with typical freezer and cooler performance found in the Michigan Energy Measures Database (MEMD).

$$D_{tE} = \frac{(P \theta_{pE} + 60 \theta_{oE})}{3600 \theta_d}$$

P = Number of passages through doorway per hour. Custom input; assume 5.9 if unknown.<sup>1052</sup>

$\theta_{pE}$  = Door open to close time in seconds. Custom input; assume 7.5 seconds if unknown.<sup>1053</sup>

$\theta_{oE}$  = Time door remains open in minutes. Custom input; assume 3 minutes if unknown.<sup>1054</sup>

$\theta_d$  = Period of time considered in hours, 1 hr.

$D_{tM}$  = decimal portion of time high speed door motor is operational.

$$D_{tM} = \frac{P \theta_{pE}}{3600 \theta_d}$$

Variables defined above.

$E_B$  = effectiveness of baseline open-doorway protective device (strip curtains). Equal to 0.85.<sup>1055</sup>

$E_E$  = effectiveness of efficient open-doorway protective device. Equal to 0, unless an additional protective device exists to limit infiltration during times when the high-speed door is open.

M = operating input power of the high speed door motor, in kW.

= Custom input; assume 1.49kW if unknown.<sup>1056</sup>

t = hours per year when primary doors to the cooled space are open.

= Custom input; assume 2,959 hrs/yr if unknown.<sup>1057</sup>

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh / t) * CF$$

Where

CF = Summer peak coincidence factor for this measure

= 1.0

All other variables as defined above.

#### NATURAL GAS ENERGY SAVINGS

N/A

#### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

<sup>1052</sup> ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.11

<sup>1053</sup> ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.6

<sup>1054</sup> Professional judgement.

<sup>1055</sup> ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.7

<sup>1056</sup> Rite Hite – Industrial High Speed Doors, product line commonly uses 2HP drives.

<sup>1057</sup> Based on a ComEd survey that obtained the number of hours per week certain building types operate. Warehouses had an average response of 55.6 and industrials had 58.2. Calculated by taking the simple average of the two and multiplying by 52 weeks/yr.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Manufacturers suggest annual inspection and maintenance (such as patching tears) of high speed doors. At a minimum, greasing of fittings and oil top-off should be carried out annually. This is estimated at a cost of \$150 per year.<sup>1058</sup>

**MEASURE CODE: CI-RFG-HSRD-V02-190101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>1058</sup> Assumes approximately 1 hour of maintenance, based on manufacturer product spec sheets.

## 4.6.11 Q-Sync Motors for Walk-in and Reach-in Coolers/Freezers

### DESCRIPTION

This measure is applicable to replacement of an existing, uncontrolled, and continuously operating standard-efficiency shaded-pole, permanent split capacitor (PSC), and electronically commutated (EC) evaporator fan motors in reach-in refrigerated display cases as well as walk-in coolers and freezers.

This measure achieves energy savings by installing a more efficient Q-Sync motor in these scenarios (accompanied with replacement fan assembly as necessary). In addition to motor energy savings, the measure also results in less waste heat for the refrigeration equipment to reject and improves the power factor of the equipment.

This measure is limited to a typical reach-in refrigerated display case with the evaporator fan power of 9-12 Watts and walk-in coolers and freezers with the evaporator fan power of 38-50 Watts. In addition to the motor, replacement of the evaporator fan is necessary to ensure matching airflow is provided (because the fan's speed has been modified). Care must be taken by the installer to ensure airflows remain within the specified range, otherwise fan performance could suffer, causing reliability issues. Q-Sync motors are commonly purchased as a kit, which includes replacement fan blades and shrouds when replacement is necessary.

This measure was developed to be applicable to the following program types: RF, NC.<sup>1059</sup>

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The replacement unit must be a 9-12 Watt Q-Sync motor with a minimum of 73% motor efficiency or a 38-50 Watt Q-Sync motor with a minimum of 81% motor efficiency (as listed by manufacturer).

### DEFINITION OF BASELINE EQUIPMENT

Depending on existing conditions, one of three baselines is chosen:

Baseline 1 is the existing shaded-pole motor(s) with no fan control operating 8760 hours continuously in a refrigerated reach-in display case, walk-in cooler, or walk-in freezer.

Baseline 2 is an EC motor with no fan control operating 8760 hours continuously in a refrigerated reach-in display case.

Baseline 3 is the existing PSC motor(s) with no fan control operating 8760 hours continuously in a walk-in cooler or freezer.

Baseline 4 is a blended baseline, consisting of a mix of shaded-pole motors and EC motors that are assumed to be present in retrofit project where accurate counts are unknown or difficult to determine. It is assumed that existing motors have no fan control and operate 8760 hours continuously in refrigerated reach-in display cases.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is ten years.<sup>1060</sup>

### DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the following deemed measure cost can be used.<sup>1061</sup>

---

<sup>1059</sup> Customers should be encouraged to check with the manufacturer to determine any impact on warranty of new equipment due to installing Q-sync fan/motor assemblies.

<sup>1060</sup> Based on communication with QM Power representative, April 16, 2018. See reference document "4.16.2018 Email.msg".

<sup>1061</sup> Based on communication with QM Power representative, April 24, 2018. See reference document "4.24.2018 Email.msg".

Measure	Material Unit (Each)	Material Cost / Unit	Labor Unit (Hours)	Labor Rate / Unit	Total Cost / Unit
9-12-watt Q-Sync motor (including replacement fan kit)	1	\$52	0.25	\$120	\$82
38-50-watt Q-Sync motor (including replacement fan kit)	1	\$50	0.50	\$120	\$110

Note: the material unit cost is based on a large-scale retrofit project.

**LOADSHAPE**

Loadshape C53 - Flat

**COINCIDENCE FACTOR**

The peak kW coincidence factor is 100%

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

To determine the savings associated with the Q-Sync motor measure we utilized the field study results provided by Oak Ridge National Laboratory (ORNL)<sup>1062</sup> and Alternative Energy Systems Consulting (AESC)<sup>1063</sup> for refrigerated display cases, and the field study results provided by Slipstream<sup>1064</sup> and ORNL<sup>1065</sup> for walk-in coolers and freezers.

For refrigerated display cases, in 2015, ORNL conducted a side-by-side comparison of Q-Sync motors with EC motors in a 16 ft medium-temperature vertical multi-deck refrigerated display case at an Hy-Vee Supermarket in the Kansas City metropolitan area. A retrofit was done on the display case that contained four 12 W EC evaporator fan motors, two in each 8 ft section. Two existing EC motors in one of the 8 ft sections were replaced with two 12 W Q-Sync motors. The initial results show that Q-Sync motors consumed approximately 16.4 watts per motor, and EC motors consumed approximately 22.6 watts per motor.<sup>1066</sup>

---


<sup>1062</sup> Brian A. Fricke and Bryan R. Becker, “Q-Sync Motors in Commercial Refrigeration: Preliminary Test Results and Projected Benefits,” Oak Ridge National Laboratory, September 2015.

<sup>1063</sup> M. Valmiki and Antonio Corradini, “Energy Savings of Permanent Magnet Synchronous Fan Motor Assembly Refrigerated Case Evaporators,” Alternative Energy Systems Consulting, August 2016.

<sup>1064</sup> Xiaohui Zhou, et al, “Q-Sync Motor Performance in Walk-in Coolers and Freezers: Field Test for ComEd Emerging Technologies,” Slipstream, March 2019.

<sup>1065</sup> Brian A. Fricke and Bryan R. Becker, “Permanent Magnet Synchronous Motors for Commercial Refrigeration: Final Report,” Oak Ridge National Laboratory, July 2018.

<sup>1066</sup> Brian A. Fricke and Bryan R. Becker, “Q-Sync Motors in Commercial Refrigeration: Preliminary Test Results and Projected Benefits,” Oak Ridge National Laboratory, September 2015.

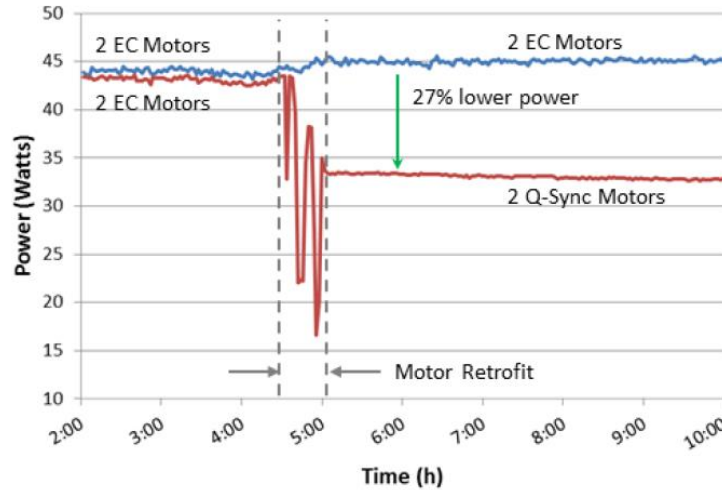

In comparison, the 2011 study by Navigant and PNNL determined that a 12 w shade-pole motor ‘s actual power is 60.0 watts for use in commercial refrigeration equipment at design condition,<sup>1067</sup> even though some manufacturers also pointed out that “there could be significant variations in efficiency between motors of the same type but different models.” In the AESC study, the field test showed that the average input power for each of the 13 shaded pole motors retrofitted is 41.6 watts. As a compromise between the two studies, we use 50.0 watts as a representative number for shaded pole motors in our calculation. The average evaporator fan motor powers in refrigerated cases are summarized in the following table.

	Shaded-pole motor	PSC motor	Q-Sync motor
Average evaporator fan motor power in refrigerated display cases (watt)	50.0	22.6	16.4

For walk-in coolers and freezers, in 2019, Slipstream conducted a field study in three small businesses in Illinois retrofitting a total of 18 evaporator fan motors in 7 walk-in coolers or freezers. The average input power for each of the existing 16 shaded-pole motors was 131.6 watts, and 58.4 watts for each of the existing two PSC motors. The average input power for each of the 18 Q-Sync motors post-retrofit was 40.1 watts. In the ORNL 2018 field study on walk-in cooler/freezers in two supermarkets, the average input power for each of the existing 20 shaded-pole fan motors was 111.5 watts, and 61.4 watts for each of the existing 73 PSC motors. The average input power for each of the 93 Q-Sync motors post-retrofit was 36.6 watts. Combining both studies’ results, the average powers for evaporator fan motors pre- and post-retrofit are listed in the following table:

	Shaded-pole motor	PSC motor	Q-Sync motor
Average evaporator fan motor power in walk-in coolers/freezers (watt)	120.4	61.3	37.2

<sup>1067</sup> NCI (Navigant Consulting Inc.) and PNNL (Pacific Northwest National Laboratory), “Preliminary Technical Support Document (TSD): Energy Conservation Program for Certain Commercial and Industrial Equipment: Commercial Refrigeration Equipment,” Appliances and Commercial Equipment Standards, Building Technologies Program, Office of Energy Efficiency and Renewable Energy, US Department of Energy, Washington, D.C., 2011.



For refrigerated display cases:

The electrical energy savings for replacing a shaded-pole motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours. For med-temperature cases, T is 8,760 hours. For low-temp freezer cases, T is 8,578 hours considering daily 30-minute defrost cycles during which fans are not powered.<sup>1068</sup>

Motor energy savings (Baseline 1, med-temp, per motor) = (50 w – 16.4 w) x 8760 hours / 1000 = 294.336 kWh

Motor energy savings (Baseline 1, low-temp, per motor) = (50 w – 16.4 w) x 8578 hours /1000 = 288.221 kWh

The electrical energy savings for replacing an EC motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours (8760 hours):

Motor energy savings (Baseline 2, med-temp, per motor) = (22.6 w – 16.4 w) x 8760 hours / 1000 = 54.312 kWh

Motor energy savings (Baseline 2, low-temp, per motor) = (22.6 w – 16.4 w) x 8578 hours / 1000 = 53.184 kWh

The reduced motor power will also reduce refrigeration load. Assuming the power to drive the evaporator fan is converted to heat inside the display cases at 100% rate, the reduction in refrigeration system compressor power can be calculated using the following equation:

$$\Delta kWh_{refrigeration} = \frac{\Delta kWh_{motor}}{COP},$$

where COP is the Coefficient of Performance of refrigeration systems in the supermarket display cases. For med-temperature cases, the average COP is 2.5<sup>1069</sup>. For low-temp freezer cases, the average COP is 1.3.<sup>1070</sup>

The refrigeration energy savings can be calculated based on above numbers:

Refrigeration energy savings (Baseline 1, med-temp, per motor) = 117.734 kWh

Refrigeration energy savings (Baseline 1, low-temp, per motor) = 221.708 kWh

Refrigeration energy savings (Baseline 2, med-temp, per motor) = 21.724 kWh

Refrigeration energy savings (Baseline 2, low-temp, per motor) = 40.910 kWh

The overall energy savings are the sums of the motor energy savings and the refrigeration energy savings:

Overall energy savings (Baseline 1, med-temp, per motor) = 412.070 kWh

Overall energy savings (Baseline 1, low-temp, per motor) = 509.929 kWh

Overall energy savings (Baseline 2, med-temp, per motor) = 76.036 kWh

Overall energy savings (Baseline 2, low-temp, per motor) = 94.094 kWh

For walk-in coolers and freezers:

The electrical energy savings for replacing a shaded-pole motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours. For coolers, T is 8,760 hours. For freezers, T is 8,578 hours considering daily 30-minute defrost cycles during which fans are not powered.

Motor energy savings (Baseline 1, med-temp, per motor) = (120.4 w – 37.2 w) x 8760 hours / 1000 = 728.832 kWh

Motor energy savings (Baseline 1, low-temp, per motor) = (120.4 w – 37.2 w) x 8578 hours /1000 = 713.690 kWh

<sup>1068</sup> M M. Valmiki and Antonio Corradini, "Energy Savings of Permanent Magnet Synchronous Fan Motor Assembly Refrigerated Case Evaporators," Alternative Energy Systems Consulting, August 2016.

<sup>1069</sup> Michael Deru, et al, "U.S. Department of Energy Commercial Reference Building Models of National Building Stock," NREL Report TP-5500-46861, February 2011.

<sup>1070</sup> Michael Deru, et al, "U.S. Department of Energy Commercial Reference Building Models of National Building Stock," NREL Report TP-5500-46861, February 2011.

The electrical energy savings for replacing a PSC motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours (8760 hours):

Motor energy savings (Baseline 3, med-temp, per motor) = (61.3 w – 37.2 w) x 8760 hours / 1000 = 211.116 kWh

Motor energy savings (Baseline 3, low-temp, per motor) = (61.3 w – 37.2 w) x 8578 hours / 1000 = 206.730 kWh

The reduced motor power will also reduce refrigeration load. Assuming the power to drive the evaporator fan is converted to heat inside the display cases at 100% rate, the reduction in refrigeration system compressor power can be calculated using the following equation:

$$\Delta kWh_{refrigeration} = \frac{\Delta kWh_{motor}}{COP},$$

where COP is the Coefficient of Performance of refrigeration systems in the supermarket display cases. For med-temperature cases, the average COP is 2.5. For low-temp freezer cases, the average COP is 1.3.

The refrigeration energy savings can be calculated based on above numbers:

Refrigeration energy savings (Baseline 1, med-temp, per motor) = 291.532 kWh

Refrigeration energy savings (Baseline 1, low-temp, per motor) = 548.992 kWh

Refrigeration energy savings (Baseline 3, med-temp, per motor) = 84.446 kWh

Refrigeration energy savings (Baseline 3, low-temp, per motor) = 159.023 kWh

The overall energy savings are the sums of the motor energy savings and the refrigeration energy savings:

Overall energy savings (Baseline 1, med-temp, per motor) = 1020.364 kWh

Overall energy savings (Baseline 1, low-temp, per motor) = 1262.682 kWh

Overall energy savings (Baseline 3, med-temp, per motor) = 295.562 kWh

Overall energy savings (Baseline 3, low-temp, per motor) = 365.753 kWh

**ELECTRIC ENERGY SAVINGS**

If the numbers of existing shaded-pole motors, EC motors to be retrofitted are known (Baseline 1,2, & 3):

$$\Delta kWh = \text{Overall annual savings per motor} * \text{Motors}$$

Where overall energy savings per motor can be as specified in the following table:

Evaporator Fan Motor Rating (of Q-Sync motor)	Baseline	Annual kWh Savings/motor
9-12W	shaded-pole motor, med-temp	412.1
9-12W	shaded-pole motor, low-temp	509.9
9-12W	EC motor, med-temp	76.0
9-12W	EC motor, low-temp	94.1
38-50W	shaded-pole motor, med-temp	1020.364
38-50W	shaded-pole motor, low-temp	1262.682
38-50W	PSC motor, med-temp	295.562
38-50W	PSC motor, low-temp	365.753

Motors = number of fan motors replaced

For refrigerated display cases, if the numbers of existing shaded-pole motors and EC motors are unknown in a retrofit project (Baseline 3):

$$\Delta kWh = [W_{med-temp} (W_{SPM} \times S_{SPM-med} + W_{ECM} \times S_{ECM-med}) + W_{low-temp} (W_{SPM} \times S_{SPM-low} + W_{ECM} \times S_{ECM-low})] * Motors$$

Motors = number of fan motors replaced

S = annual energy savings per motor, by type. Savings for each different type ( $S_{SPM-med}$ ,  $S_{SPM-low}$ ,  $S_{ECM-med}$ ,  $S_{ECM-low}$ ) can be looked up from the table above.

W = weighting factors. The weights for the medium-temperature and low-temperature applications ( $W_{med-temp}$  and  $W_{low-temp}$ ) should be calculated based on the actual numbers of motors in a retrofit project, and the sum of the two weights should equal to 1. If these weights cannot be accurately obtained, the estimated weights ( $W_{med-temp}^*$  and  $W_{low-temp}^*$ )<sup>1071</sup> from the table below can be used (the  $W_{SPM}$  and  $W_{ECM}$  numbers are slightly adjusted by +/-5% based on national averages in the 2015 ORNL study, reflecting some shaded pole motors may have been replaced with EC motors in the past few years).<sup>1072</sup>

Application	WSPM	WECM	Wmed-temp*	Wlow-temp*
Supermarkets	0.6	0.4	0.68	0.32
Other Food Retail Formats	0.8	0.2	0.68	0.32
Other Retail Categories	0.7	0.3	0.68	0.32
Restaurants and Bars	0.85	0.15	0.68	0.32
Beverage Vending Machines	0.85	0.15	0.68	0.32

For walk-in coolers and freezers, if the existing motor types are unknown in a retrofit project, it can be assumed they are PSC motors, as from industry survey in the 2018 ORNL study,<sup>1073</sup> 95% of the 38-50 watt evaporator fan motors are PSC motors.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / Hours * CF$$

Where:

$\Delta kWh$  = Gross customer annual kWh savings for the measure, as listed above

Hours = Full Load hours per year  
 = 8,766 (med-temp); 8,578 (low-temp)

CF = Summer Peak Coincident Factor  
 = 1.0

Other variables as defined above.

The following table provides the resulting kW savings (per motor):

Evaporator Fan Motor Rating (of Q-Sync motor)	Baseline	kW Savings/motor
9-12W	shaded-pole motor, med-temp	0.047
9-12W	shaded-pole motor, low-temp	0.059
9-12W	EC motor, med-temp	0.009
9-12W	EC motor, low-temp	0.011

<sup>1071</sup> ASHRAE, “ASHRAE Handbook – Refrigeration,” ASHRAE, 2018.

<sup>1072</sup> NCI (Navigant Consulting Inc.) and PNNL (Pacific Northwest National Laboratory), “Preliminary Technical Support Document (TSD): Energy Conservation Program for Certain Commercial and Industrial Equipment: Commercial Refrigeration Equipment,” Appliances and Commercial Equipment Standards, Building Technologies Program, Office of Energy Efficiency and Renewable Energy, US Department of Energy, Washington, D.C., 2011.

<sup>1073</sup> Brian A. Fricke and Bryan R. Becker, “Permanent Magnet Synchronous Motors for Commercial Refrigeration: Final Report,” Oak Ridge National Laboratory, July 2018.

Evaporator Fan Motor Rating (of Q-Sync motor)	Baseline	kW Savings/motor
38-50W	shaded-pole motor, med-temp	0.116
38-50W	shaded-pole motor, low-temp	0.147
38-50W	PSC motor, med-temp	0.034
38-50W	PSC motor, low-temp	0.043

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

There is no O&M cost adjustment for replacing shaded pole or EC motors with Q-Sync motors in reach-in refrigerated display case applications. From the 2015 ORNL study,<sup>1074</sup> the 2016 AESC study,<sup>1075</sup> and the manufacturer,<sup>1076</sup> there is no expected degradation in equipment performance after the retrofits, and therefore no O&M cost differences are expected between baseline and efficient measures.

**MEASURE CODE: CI-RFG-QMF-V02-200101**

**REVIEW DEADLINE: 1/1/2022**

<sup>1074</sup> Brian A. Fricke and Bryan R. Becker, “Q-Sync Motors in Commercial Refrigeration: Preliminary Test Results and Projected Benefits,” Oak Ridge National Laboratory, September 2015.

<sup>1075</sup> M M. Valmiki and Antonio Corradini, “Energy Savings of Permanent Magnet Synchronous Fan Motor Assembly Refrigerated Case Evaporators,” Alternative Energy Systems Consulting, August 2016.

<sup>1076</sup> Based on communication with QM Power representative, August 22, 2018. See reference document “8.22.2018 Email.msg”.

## 4.6.12 Variable Speed Drive for Condenser Fans

### DESCRIPTION

This measure is applicable to VFDs installed on condenser fan motors operating in supermarket refrigeration systems.

Where a baseline condenser motor load operates at a fixed-speed, VFDs generate energy and cost savings by modulating frequency and voltage to match the load on the condensers.<sup>1077</sup> Savings result from the resulting fan speed variation.

This measure is applicable to motors between 0.5 horsepower and 1.5 horsepower.

This measure was developed to be applicable to the following program types: RF, TOS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to retrofitted installation of condenser fan motors in supermarkets where no ability to modulate frequency and voltage for fan-speed variation exists. Savings are based on the application of VFDs to baseline load conditions defined as pre-installation load compared to post-installation load.

### DEFINITION OF BASELINE EQUIPMENT

The time-of-sale baseline is a new motor installed without a VFD or other methods of control. Retrofit baseline is an existing motor operating as is.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for VFD condenser fan applications is 15 years.<sup>1078</sup>

### DEEMED MEASURE COST

Customer costs will be used when available. For motor sizes 0.5 to 1.5 HP the default measure cost is \$1,170/HP. Custom costs must be gathered for other motor sizes.

### LOADSHAPE

C22-commercial refrigeration.

### COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

---

---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

Energy savings is based on a pre- and post-treatment test. The pre-treatment period being nearly three months in duration with post-treatment of a similar period. Both periods include significant average outdoor temperature (OAT) changes. Measurement of energy savings relies on regression of condenser fan energy use against ambient temperature. These estimates were made on each condenser using both pre- and post-VFD installation; comparison

---

<sup>1077</sup> Romberger, Jeff. Wed. "Chapter 18: Variable Frequency Drive Evaluation Protocol. The Uniform Methods Project: Methods for Determining Energy Efficiency Savings for Specific Measures". United States. doi:10.2172/1365710.

<sup>1078</sup> Efficiency Vermont TRM 3/16/2015 pp 19 for motor end use-variable frequency drives.

of the two yields savings.<sup>1079</sup>

**ELECTRIC ENERGY SAVINGS**

$$\text{Annual } \Delta\text{kWh}_{\text{condenser}} = \text{No. fans} * \text{HP/fan} * \text{kWh savings/HP/Zone}$$

Zone	kWh savings/HP
1 (Rockford)	1,480
2 (Chicago)	1,500
3 (Springfield)	1,430
4 (Belleville)	1,430
5 (Marion)	1,480

**For example**, for a condenser with 5 fans, each rated at 1.5 HP in Chicago (Zone 2):

$$\begin{aligned} \text{Annual } \Delta\text{kWh}_{\text{condenser}} &= 5 * 1.5 * 1,500 \\ &= 11,250 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Variable frequency drives, anecdotally, increase motor life because they allow for soft-start and soft shutdown. This would lead to O&M savings from replacing motors. Unfortunately, there is currently insufficient evidence to quantify this savings, so no deemed O&M savings can be claimed at this time.

**MEASURE CODE: CI-RFG-VSC-V02-200101**

**REVIEW DEADLINE: 1/1/2025**

<sup>1079</sup> Pre- and post-VFD retrofit kWh consumption were derived from measurement of 14 condensers at 4 supermarkets in Rockford, IL. Annual savings in each Zone is the product of the number of hours in each 5-degree F Typical Meteorological Year temperature bin multiplied by the mean savings across the 14 condensers measured in the study. These estimates represent means from 10,000 simulations that include confidence intervals at the 90 percent level of +/-330, +/-330, +/-300, +/-320, and +/-310 for zones 1, 2, 3, 4, and 5, respectively. Detailed methods, assumptions, and calculations are found in “Variable Frequency Drive Energy Savings in Supermarkets Report. Slipstream, September, 30 2018” [pending report publication by ComEd.] Once published, the report will be made available to Illinois TRM Stakeholders for reference.

### 4.6.13 Add Doors to Open Refrigerated Display Cases

#### DESCRIPTION

Open display cases are typically found in grocery and convenience stores and have been a preference of store owners because they allow customers a clear view and easy access to refrigerated products. This measure is retrofitting existing, open, refrigerated display cases by adding and installing doors. The baseline equipment is an open vertical display case with no doors or covering. The efficient equipment is the installation of solid doors on the existing display case. Replacement of open display cases with new display cases with doors is not covered under this measure characterization.

Energy savings are based on air infiltration reduction from the addition of doors to the open display cases. The air infiltration reductions assume a reduced heat gain and subsequent reduced load on the refrigeration compressors. Both radiant and conduction heat losses were factored into the analysis as well. Energy savings are based on a per linear foot of display case.

Interactive HVAC energy savings were also included in the measure savings analysis. The HVAC interactive effects calculation assesses the measure's impact on the heating and cooling equipment. With adding a door to an open refrigerated display case, excess cold air leaking into the conditioned space no longer has to be treated by the heating system, resulting in additive savings. Similarly, the reduction in cold air from the open refrigerated display case no longer supplements the efforts of the space cooling equipment, which results in an overall increase in its consumption.

High, medium, and low temperature cases are eligible for this measure; however, the measure assumptions detailed in this characterization are based on medium temperature vertical display cases, with the installation of zero energy doors, as it was deemed the most likely candidate for participation in this measure. Open low temperature or freezer display cases are not common. If the retrofitted door has LED fixtures, it is recommended to leverage '4.5.4 LED Bulbs and Fixtures' for quantifying savings and measure benefits.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is retrofitting an existing open, refrigerated, vertical display case by adding doors.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an open, refrigerated, vertical display case without any covering.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 15 years.<sup>1080</sup>

#### DEEMED MEASURE COST

The incremental cost, which includes both material and labor, differs depending on whether or not the installed door is equipped with LED lighting. The estimated incremental cost for doors without LED lighting is \$390 per linear foot. The incremental cost for doors with LED lighting is \$419 per linear foot.<sup>1081</sup>

---

<sup>1080</sup> The measure life is sourced from the PG&E Workpaper, "Add Doors to Open Medium Temperature Cases – PGE3PREF116 R3", June 2019.

<sup>1081</sup> The incremental cost is sourced from the PG&E Workpaper, "Add Doors to Open Medium Temperature Cases – PGE3PREF116 R3", June 2019. The incremental cost for retrofitting new doors on existing refrigerated display cases is the

**LOADSHAPE**

Loadshape C03 - Commercial Cooling

Loadshape 22: Commercial Refrigeration

**COINCIDENCE FACTOR**

There are two components to the demand savings of this measure, one that impacts the refrigeration equipment itself, and another that has an interactive impact on the space cooling equipment. As a result, the measure details two summer coincidence peak demand factors.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((\Delta HG * CL) / (EER * 1000) * 8760) + (MMBtu_{HVAC\ Cool} * CL * (1 / SEER) * 1000) - kWh_{Night\ Covers} - kWh_{Added\ Lights}$$

Where:

- $\Delta kWh$  = gross customer annual kWh savings
- $\Delta HG$  = Heat Gain, the decreased load or the reduced heat gain on the open refrigerated display case with the installation of a door (Btu/hr-linear foot)  
= 1,172 Btu/h-ft<sup>1082</sup>
- CL = Case Length, refrigerated case length in feet  
= Actual
- EER = Energy Efficiency Ratio; display case compressor efficiency (Btu/hr-watt)  
= 11.36<sup>1083</sup>
- 1000 = Conversion from watts to kilowatts (W / kW)
- 8760 = Annual operating hours of the refrigerated display case<sup>1084</sup>

---

material cost of the door and the labor cost required for installation. The material cost of the doors is \$331 per linear foot with LED lighting and \$301 per linear foot without LED lighting. And the installation cost is \$88 per linear foot.

<sup>1082</sup> The change in heat gain is sourced as the typical value for a medium temperature vertical display case adding doors from the PG&E Workpaper, "Add Doors to Open Medium Temperature Cases - PGE3PREF116 R3", June 2019. The workpaper assumes a net reduction in heat gain with the installation of doors on open refrigerated display cases. The primary benefits account for the decrease in excess heat entering the display case from air infiltration. Radiation and conduction heat gains were also included in the derivation of this value. Additionally, the net heat gain has built in assumptions on how often the refrigerated case doors will be used and the display case accessed by customers and site associates, reducing some of the air infiltration benefits of the new door.

<sup>1083</sup> Average EER values were calculated as the average of standard reciprocating and discus compressor efficiencies, using a typical condensing temperature of 90°F and saturated suction temperatures (SST) of 20°F for medium temperature applications. The efficiency analysis and product review is sourced from the Efficiency Vermont TRM, which utilizes data from Emerson Climate Technology software. Medium temperature cases have an EER value of 11.36.

<sup>1084</sup> The measure assumes the baseline equipment is not employing night covers or any other covering but is in fact left open for the duration of its operation.



$MMBtu_{HVAC\ Cool}$  = Total cooling load increase on the HVAC equipment per linear foot of display case. Varies by location:<sup>1085</sup>

Zone	$MMBtu_{HVAC\ Cool}$
1 (Rockford)	-2.632
2 (Chicago)	-2.763
3 (Springfield)	-3.284
4 (Belleville)	-3.254
5 (Marion)	-3.335

SEER = Seasonal Energy Efficiency Ratio; HVAC equipment operating efficiency (Btu/hr-watt)  
 = 13.00<sup>1086</sup>

$kWh_{Night\ Covers}$  = Reduction in energy savings if existing display case utilizes night covers (kWh/linear-ft)  
 = 0 if no night covers are deployed. See table below if display case uses night covers.

Display Case Description	Case Temperature Range (°F)	$\Delta kWh/ft$ reduction (= 9% reduction of electricity use <sup>1087,1088</sup> )
Vertical Open, Remote Condensing, Medium Temperature	35°F to 55°F	131
Vertical Open, Remote Condensing, Low Temperature	0°F to 30°F	296
Vertical Open, Self-Contained Medium Temperature	35°F to 55°F	252

$kWh_{Added\ Lights}$  = Reduction in energy savings if new lighting is added to the case (kWh/linear-ft)  
 = 0 if no lighting is added, or if lighting is added but existing lighting is removed. If lighting is retrofit, determine case lighting savings using '4.5.4 LED Bulbs and Fixtures'.  
 = Actual installed equipment specifications or use case lighting values from '4.5.4 LED Bulbs and Fixtures'.

<sup>1085</sup> The  $MMBtu$  increase on the HVAC cooling equipment is based on an outdoor air temperature bin analysis, the total hours of operation of the cooling system, and the building's overall loss of additional cooling as a result of the installation of the doors on the open refrigerated display case. The analysis assumes a certain amount of conditioned air has to be treated to replace the air previously cooled by the display case. Furthermore, the analysis assumes an increased load on the cooling system, at outdoor temperatures above 60°F. A 25% disabling factor was also applied to account for some of the cold air pouring out of the display case and subcooling the site's conditioned space, which will not trigger a thermostatic response from the HVAC equipment. For more information on the analysis used to derive the load increase on the HVAC cooling equipment per linear foot of display case, please see the 'HVAC IE' tab in the "IL TRM\_Add Doors\_Analysis\_June 2020.xlsx".

<sup>1086</sup> In light of limited existing market data for the efficiency of commercial air condition equipment in Iowa grocery and convenience stores, SEER assumptions are conservatively sourced from IECC 2012.

<sup>1087</sup> Southern California Edison Refrigeration Technology and Test Center. Effects of the Low Emissivity Shields on Performance and Power Use of a Refrigerated Display Case. 1997. Southern California Edison, Rancho Cucamonga, CA. See '4.6.9 Night Covers' for more detail.

<sup>1088</sup> Technischer Überwachungs-Verein Rheinland E.V. Laboratory test results for energy savings on refrigerated dairy case, conducted for Econofrost. See '4.6.9 Night Covers' for more detail.

**For example**, a grocery store in Chicago installed zero energy doors on four open refrigerated cases that do not use night covers, which amounted to 12 linear feet of retrofitted display cases, savings the site:

$$\begin{aligned} \Delta\text{kWh} &= ((1172 * 12) / (11.36 * 1000) * 8760) + (-2.763 * 12 * (1 / 13) * 1000) \\ &= 8,295 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\begin{aligned} \Delta\text{kW} &= (((\Delta\text{HG} * \text{CL}) / (\text{EER} * 1000)) - \text{kW}_{\text{Added Lights}}) * \text{CF}_{\text{Refrigeration}} \\ &+ ((\text{MMBtu}_{\text{HVAC Cool}} / \text{Hours}_{\text{Cool}} * \text{CL} * (1 / \text{SEER}) * 1000) * \text{CF}_{\text{Cool}}) \end{aligned}$$

Where:

Hours<sub>Cool</sub> = Total combined hours the site is providing cooling. Varies by location:<sup>1089</sup>

Zone	Hours <sub>Cool</sub>
1 (Rockford)	2,994
2 (Chicago)	3,143
3 (Springfield)	3,736
4 (Belleville)	3,702
5 (Marion)	3,794

kW<sub>Added Lights</sub> = Reduction in demand savings if new lighting is added to the case (kW/linear-ft)  
 = 0 if no lighting is added, or if lighting is added but existing lighting is removed. If lighting is retrofit, determine case lighting savings using ‘4.5.4 LED Bulbs and Fixtures’.  
 = Actual installed equipment specifications or use case lighting values from ‘4.5.4 LED Bulbs and Fixtures’.

CF<sub>Refrigeration</sub> = Summer peak coincidence factor for the refrigerated display case  
 = 0.964

CF<sub>Cool</sub> = Summer peak coincidence factor for the HVAC cooling system. This is the summer system peak coincidence factor for commercial cooling (during system peak hours)  
 = 0.913<sup>1090</sup>

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = (\text{MMBtu}_{\text{HVAC Heat}} * \text{CL} * (1 / \text{AFUE}) * 10$$

Where:

ΔTherms = gross customer annual therms savings

<sup>1089</sup> The total combined hours in which the site is providing cooling is based on an outdoor air temperature bin analysis, where the site is conditioning cold air at outdoor temperatures of 60°F and above. Weather data was sourced from TMY3 data for the specific locations. For more information on the derivation of these hours, please see 'HVAC IE' tab in the "IL TRM\_Add Doors\_Analysis\_June 2020.xlsx" Night covers are not included in the peak demand savings algorithm because night covers are deployed at night, outside of the peak demand period.

<sup>1090</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

MMBtu<sub>HVAC Heat</sub> = Total heating load decrease on the HVAC equipment per linear foot of display case.  
 Varies by locations: <sup>1091</sup>

Zone	MMBtu <sub>HVAC Heat</sub>
1 (Rockford)	5.068
2 (Chicago)	4.937
3 (Springfield)	4.416
4 (Belleville)	4.446
5 (Marion)	4.365

- CL = Case Length, refrigerated case length in feet
- = Actual
- AFUE = 80%<sup>1092</sup>
- 10 = Conversion from MMBtu to therms

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-RFG-DOOR-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

<sup>1091</sup> The MMBtu decrease on the HVAC heating equipment is based on an outdoor air temperature bin analysis, the total hours of operation in which the site is providing heat, and the building's overall reduced heating load as a result of the installation of the doors on the open refrigerated display case. The analysis assumes a certain reduction of conditioned air that had to be treated to make up for the air previously cooled by the display case. The reduced heat gain on the refrigerated display case equals the reduced heat loss by the site and a heating load that no longer has to be provided by the HVAC system. Furthermore, the analysis assumes a decrease load on the heating system, at outdoor temperatures below 60°F. A 25% disabling factor was also applied to account for some of the cold air pouring out of the display case and subcooling the site's conditioned space, which will not trigger a thermostatic response from the HVAC equipment. For more information on the analysis used to derive the load decrease on the HVAC heating equipment per linear foot of display case, please see the 'HVAC IE' tab in the "IL TRM\_Add Doors\_Analysis\_June 2020.xlsx".

<sup>1092</sup> Typical heating system efficiency of 80%, consistent with current heating efficiency assumptions for lighting HVAC interactive effects for commercial fossil fuel-fired systems.

## 4.7 Compressed Air

### 4.7.1 VSD Air Compressor

#### DESCRIPTION

This measure relates to the installation of an air compressor with a variable frequency drive, load/no load controls or variable displacement control. Baseline compressors choke off the inlet air to modulate the compressor output, which is not efficient. Efficient compressors use a variable speed drive on the motor to match output to the load. Savings are calculated using representative baseline and efficient demand numbers for compressor capacities according to the facility's load shape, and the number of hours the compressor runs at that capacity. Demand curves are as per DOE data for a Variable Speed compressor versus a Modulating compressor. This measure applies only to an individual compressor  $\leq 200$  hp. Only one compressor per compressed air distribution system is eligible.

This measure was developed to be applicable to the following program types: TOS.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is a compressor  $\leq 200$  hp with variable speed control.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is either an oil-flooded compressor  $\leq 200$  hp with inlet modulating with blowdown or load/no-load controls.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

13 years<sup>1093</sup>

#### DEEMED MEASURE COST

$$\text{IncrementalCost (\$)} = (127 \times \text{hp}_{\text{compressor}}) + 1,446$$

Where:

127 and 1,446<sup>1094</sup> = compressor motor nominal hp to incremental cost conversion factor and offset

$\text{hp}_{\text{compressor}}$  = compressor motor nominal

#### DEEMED O&M COST ADJUSTMENTS

N/A

#### LOADSHAPE

Loadshape C35 - Industrial Process

#### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---

<sup>1093</sup> Department of Energy Technical Support Document.

<sup>1094</sup> Conversion factor and offset based on a linear regression analysis of the relationship between air compressor motor nominal horsepower and incremental cost, as sourced from the Efficiency Vermont Technical Reference Manual (TRM). Several Vermont vendors were surveyed to determine the cost of equipment.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = 0.9 \times hp_{\text{compressor}} \times \text{HOURS} \times (CF_b - CF_e)$$

Where:

- $\Delta kWh$  = gross customer annual kWh savings for the measure
- $hp_{\text{compressor}}$  = compressor motor nominal hp
- $0.9^{1095}$  = compressor motor nominal hp to full load kW conversion factor
- HOURS = compressor total hours of operation below depending on shift

Shift	Hours
Single shift (8/5)	1,976 hours 7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952 hours 7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928 hours 24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8,320 hours 24 hours per day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average <sup>1096</sup>	5,702 hours

$CF_b$  = baseline compressor factor<sup>1097</sup>

<sup>1095</sup> Conversion factor based on Survey of CAGI data sheets from 200 compressors. See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1096</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1097</sup> Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM.(The “variable speed drive” compressor factor has been adjusted up from the 0.675 presented in the analysis to 0.705 to account for the additional power draw of the VSD).

Baseline Compressor	Compressor Factor (≤ 40 hp) <sup>1098</sup>	Compressor Factor (50 – 200 hp) <sup>1099</sup>
Modulating w/ Blowdown	0.890	0.863
Load/No Load w/ 1 Gallon/CFM	0.909	0.887
Load/No Load w/ 3 Gallon/CFM	0.831	0.811
Load/No Load w/ 5 Gallon/CFM	0.806	0.786

CF<sub>e</sub> = efficient compressor  
 = 0.705 for units ≤ 40 hp<sup>1100</sup>  
 = 0.658 for units 50 – 200 hp

**For example**, a VSD compressor with 10 HP operating in a 1-shift facility would save  
 ΔkWh = 0.9 x 10 x 1,976 x (0.890 – 0.705)  
 = 3,290 kWh

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

ΔkW = ΔkWh / HOURS \* CF

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average <sup>1102</sup>	0.89

<sup>1098</sup> Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM. (The “variable speed drive” compressor factor has been adjusted up from the 0.675 presented in the analysis to 0.705 to account for the additional power draw of the VSD). See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1099</sup> Compressor factors for this size range were developed using DOE part-load data for different compressor control types as well as load profiles from 45 compressors and 20 facilities. This data comes from ComEd Custom and Industrial Systems programs. The compressors were filtered to reflect only rotary screw compressors, between 50 and 200 hp, and operating a minimum of 4 hour per day. Additionally, compressors with clear and consistent baseload profiles were excluded from this analysis. See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1100</sup> Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM. (The “variable speed drive” compressor factor has been adjusted up from the 0.675 presented in the analysis to 0.705 to account for the additional power draw of the VSD). See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1101</sup> Compressor factors for this size range were developed using DOE part-load data for different compressor control types as well as load profiles from 45 compressors and 20 facilities. This data comes from ComEd Custom and Industrial Systems programs. The compressors were filtered to reflect only rotary screw compressors, between 50 and 200 hp, and operating a minimum of 4 hour per day. Additionally, compressors with clear and consistent baseload profiles were excluded from this analysis. See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1102</sup> Ibid.

**For example**, a VSD compressor with 10 HP operating in a 1 shift facility would save

$$\begin{aligned}\Delta kW &= 3,290/1,976*0.59 \\ &= 0.98 \text{ kW}\end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-CPA-VSDA-V03-200101**

**REVIEW DEADLINE: 1/1/2022**

## 4.7.2 Compressed Air Low Pressure Drop Filters

### DESCRIPTION

Low pressure drop filters remove solids and aerosols from compressed air systems with a longer life and lower pressure drop than standard coalescing filters, resulting in the ability to lower a compressed air systems pressure setpoints. This reduces the compressor work required resulting in energy savings.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a low pressure drop filter with pressure drop not exceeding 1 psid when new and 3 psid at element change.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a standard coalescing filter with a pressure drop of 3 psid when new and 5 psid or more at element change

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years<sup>1103</sup>

### DEEMED MEASURE COST

The incremental cost for this measure is estimated to be \$1,000 Incremental cost per filter.<sup>1104</sup>

### LOADSHAPE

Loadshape C35 - Industrial Process

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (kW_{\text{typical}} \times \Delta P \times SF \times \text{Hours} / HP_{\text{typical}}) \times HP_{\text{real}}$$

Where:

$kW_{\text{typical}}$  = Adjusted compressor power (kW) based on typical compressor loading and operating profile. Use actual compressor control type if known:

---

<sup>1103</sup> Based on survey of manufacturer claims (Zeks, Van Air, Quincy), as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1104</sup> Incremental cost research found in LPDF Costs. xlsx.



Compressor kW<sub>typical</sub>

Control Type	kW <sub>typical</sub> <sup>1105</sup>
Reciprocating - On/off Control	70.2
Reciprocating - Load/Unload	74.8
Screw - Load/Unload	82.3
Screw - Inlet Modulation	82.5
Screw - Inlet Modulation w/ Unloading	82.5
Screw - Variable Displacement	73.2
Screw - VFD	70.8

= If the actual compressor control type is not known, use a weighted average based on the following market assumptions:

Control Type	Share %	kW <sub>typical</sub> <sup>1106</sup>
Market share estimation for load/unload control compressors	40%	74.8
Market share estimation for modulation w/unloading control compressors	40%	82.5
Market share estimation for variable displacement control compressors	20%	73.2
Weighted Average		77.6

$\Delta P$  = Reduction in pressure differential across the filter (psi)

=2 psi<sup>1107</sup>

SF =1% reduction in power per 2 psi reduction in system pressure is equal to 0.5% reduction per 1 psi, or a Savings Factor of 0.005<sup>1108</sup>

Hours = Compressor hours of operation below depending on shift

Shift	Hours
Single shift (8/5)	1976 hours 7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3952 hours 7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5928 hours 24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8320 hours 24 hours per day, 7 days a week minus some holidays and scheduled down time

HP<sub>typical</sub> = Nominal HP for typical compressor = 100 hp<sup>1109</sup>

HP<sub>real</sub> = Total HP of real compressors distributing air through filter. This should include the total horsepower of the compressors that normally run through the filter, but not backup compressors.

<sup>1105</sup> See "Industrial System Standard Deemed Saving Analysis.xls".

<sup>1106</sup> See "Industrial System Standard Deemed Saving Analysis.xls".

<sup>1107</sup> Assumed pressure will be reduced from a roughly 3 psi pressure drop through a filter to less than 1 psi, for a 2 psi savings

<sup>1108</sup> "Optimizing Pneumatic Systems for Extra Savings," Compressed Air Best Practices, DOE Compressed Air Challenge, 2010.

<sup>1109</sup> Industrial System Standard Deemed Saving Analysis.xls

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-CPA-LPDF-V03-200101**

**REVIEW DEADLINE: 1/1/2022**

### 4.7.3 Compressed Air No-Loss Condensate Drains

**DESCRIPTION**

No-loss condensate drains remove condensate as needed without venting compressed air, resulting in less air demand and consequently better efficiency. Replacement or upgrades of existing no-loss drains are not eligible for the incentive.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient condition is installation of no-loss condensate drains.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline condition is installation of standard condensate drains (open valve, timer, or both)

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

10 years

**DEEMED MEASURE COST**

The average equipment cost per drain is \$194 with an installation labor cost of \$50 for a total incremental cost \$244 per drain.<sup>1110</sup>

**LOADSHAPE**

Loadshape C35 - Industrial Process

**COINCIDENCE FACTOR**

The coincidence factor equals 0.95.<sup>1111</sup>

---



---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = CFM_{\text{reduced}} \times kW_{\text{CFM}} \times \text{Hours}$$

Where:

$$CFM_{\text{reduced}} = \text{Reduced air consumption (CFM) per drain}$$

$$= 3 \text{ CFM}^{1112}$$

$$kW_{\text{CFM}} = \text{System power reduction per reduced air demand (kW/CFM) depending on the type of compressor control:}$$

---

<sup>1110</sup> Based on empirical project data from ComEd Comprehensive Compressed Air Study program and VEIC review of pricing data found in CAS Cost Data.xlsx.

<sup>1111</sup> Efficiency Vermont Technical Reference Manual (TRM) Measure Savings Algorithms and Cost Assumptions, August 10, 2016.

<sup>1112</sup> Reduced CFM consumption is based on a timer drain opening for 10 seconds every 300 seconds as the baseline. See "Industrial System Standard Deemed Saving Analysis.xls".

System Power Reduction per Reduced Air Demand<sup>1113</sup>

Control Type	kW / CFM
Reciprocating - On/off Control	0.184
Reciprocating - Load/Unload	0.136
Screw - Load/Unload	0.152
Screw - Inlet Modulation	0.055
Screw - Inlet Modulation w/ Unloading	0.055
Screw - Variable Displacement	0.153
Screw - VFD	0.178

Or if compressor control type is unknown, then a weighted average based on market share can be used:<sup>1114</sup>

Control Type	Share %	kW / CFM
Market share estimation for load/unload control compressors	40%	0.136
Market share estimation for modulation w/unloading control compressors	40%	0.055
Market share estimation for variable displacement control compressors	20%	0.153
Weighted Average		0.107

Hours = Compressed air system pressurized hours  
 =6136 hours<sup>1115</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$\Delta kW = \Delta kWh / HOURS * CF$

Where:

CF = Summer peak coincidence factor for this measure  
 = 0.95

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1113</sup> Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See "Industrial System Standard Deemed Saving Analysis.xls".

<sup>1114</sup> Table 8.2.3, Technical Support Document. US Department of Energy

<sup>1115</sup> US DOE, Evaluation of the Compressed Air Challenge® Training Program, Page 19.

**MEASURE CODE: CI-CPA-NCLD-V03-200101**

**REVIEW DEADLINE: 1/1/2025**

## 4.7.4 Efficient Compressed Air Nozzles

### DESCRIPTION

This measure is for the replacement of standard air nozzle with high-efficiency air nozzle used in a compressed air system. High-efficiency air nozzles reduce the amount of air required to blow off parts or for drying. These nozzles utilize the Coandă effect to pull in free air to accomplish tasks with significantly less compressed air. High-efficiency nozzles often replace simple copper tubes. These nozzles have the added benefits of noise reduction and improved safety in systems with greater than 30 psig.

### DEFINITION OF EFFICIENT EQUIPMENT

The high-efficiency air nozzle must meet the following specifications:

1. High-efficiency air nozzle must replace continuous open blow-offs
2. High-efficiency air nozzle must meet SCFM rating at 80psig less than or equal to: 1/8" 11 SCFM, 1/4" 29 SCFM, 5/16" 56 SCFM, 1/2" 140 SCFM.
3. Manufacturer's specification sheet of the high-efficiency air nozzle must be provided along with the make and model

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a standard air nozzle.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 15 years.<sup>1116</sup>

### DEEMED MEASURE COST

The estimated incremental measure costs are presented in the following table:<sup>1117</sup>

Nozzle Diameter	1/8"	1/4"	5/16"	1/2"
Average IMC	\$42	\$57	\$87	\$121

### LOADSHAPE

Loadshape C35 - Industrial Process

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---

<sup>1116</sup> PA Consulting Group (2009). Business Programs: Measure Life Study. Prepared for State of Wisconsin Public Service Commission.

<sup>1117</sup> Costs are from EXAIR's website and are an average of nozzles that meet the flow requirements. Models include Atto Super, Pico Super, Nano Super, Micro Super, Mini Super, Super and Large Super nozzles. Accessed March 20, 2014.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (SCFM * SCFM\%Reduced) * kW/CFM * \%USE * Hours$$

Where:

SCFM = Air flow through standard nozzle. Use actual rated flow at 80 psi if known. If unknown, the table below includes the CFM by orifice diameter.<sup>1118, 1119</sup>

Orifice Diameter	SCFM
1/8"	21
1/4"	58
5/16"	113
1/2"	280

SCFM%Reduced = Percent in reduction of air loss per nozzle. Estimated at 50%.<sup>1120</sup>

kW/CFM = System power reduction per air demand (kW/CFM) depending on the type of air compressor found in table below:<sup>1121</sup>

Air Compressor Type	kW/CFM
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Inlet Modulation	0.06
Screw – Inlet Modulation w/ Unloading	0.06
Screw – Variable Displacement	0.15
Screw - VFD	0.18

%USE = Percent of the compressor total operating hours that the nozzle is in use  
 = Custom; if unknown assume 5%<sup>1122</sup>

Hours = Compressed air system pressurized hours.  
 = Use actual hours if known, otherwise assume values in table below:

Shift	Hours
Single Shift	1,976
Two Shifts	3,952

<sup>1118</sup> Review of manufacturer’s information.

<sup>1119</sup> Technical Reference Manual (TRM) for Ohio Senate Bill 221 “Energy Efficiency and Conservation Program” and 09-512-GE-UNC, October 15, 2009. Pages 170-171.

<sup>1120</sup> Conservative estimate based on average values provided by the Compressed Air Challenge Training Program, Machinery’s Handbook 25<sup>th</sup> Edition, and manufacturers’ catalog.

<sup>1121</sup> Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See “Industrial System Standard Deemed Saving Analysis.xls”.

<sup>1122</sup> Assumes 50% handheld air guns and 50% stationary air nozzles. Manual air guns tend to be used less than stationary air nozzles, and a conservative estimate of 1 second of blow-off per minute of compressor run time is assumed. Stationary air nozzles are commonly more wasteful as they are often mounted on machine tools and can be manually operated resulting in the possibility of a long term open blow situation. An assumption of 5 seconds of blow-off per minute of compressor run time is used.

Shift	Hours
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average <sup>1123</sup>	5,702

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$\Delta kWh$  = As calculated above

CF = Summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average <sup>1124</sup>	0.89

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-CPA-CNOZ-V02-190101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>1123</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1124</sup> Ibid.



## 4.7.5 Efficient Refrigerated Compressed Air Dryer

### DESCRIPTION

An air dryer is an essential component in a compressed air system that prevents condensate from being deposited in the compressed air supply lines of a facility. If warm saturated compressed air is supplied directly to the plant, excess condensate will form in the compressed air supply lines. Uncontrolled condensate can damage demand-side tools and process equipment. Secondly, in an oil-flooded rotary screw compressor, the residual oil from compression can be carried along the supply lines potentially damaging process equipment. Industries that use compressed air for processes make use of various types of dryers including refrigerated dryers (both cycling and non-cycling). For this measure, three types of refrigerated air dryers will be considered: thermal mass, variable speed and digital scroll. All these technologies offer better part load performance compared to non-cycling refrigerated dryers, thereby offering energy savings during periods when the dryer is not operating at peak capacity.

This measure was developed to be applicable to the following program types: TOS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

A new, high efficiency thermal mass dryer, variable speed dryer, or digital scroll dryer.

### DEFINITION OF BASELINE EQUIPMENT

A standard non-cycling refrigerated compressed air dryer of comparable capacity.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 13 years.<sup>1125</sup>

### DEEMED MEASURE COST

The incremental capital cost for this measure is \$6 per CFM.<sup>1126</sup>

### LOADSHAPE

Loadshape C35 – Industrial Process

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---



---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = P_s \times (EC50_{\text{baseline}} - EC50_{\text{efficient}}) \times \text{HOURS} \times \text{CFM}$$

Where:

$$P_s = \text{Full flow specific power of the dryer}$$

---

<sup>1125</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1126</sup> Analysis of material cost between cycling and non-cycling dryers according to online prices from Grainger. Cost provided is the average incremental cost when comparing non-cycling and cycling dryers of the same CFM capacity.

= 0.007 kW/CFM<sup>1127</sup> (for both baseline and efficient equipment)

EC50<sub>baseline</sub> = Energy consumption ratio of baseline dryer at 50%<sup>1128</sup> inlet load capacity as compared to fully loaded operating conditions.<sup>1129</sup>

= 0.843

ECF50<sub>efficient</sub> = Energy consumption ratio of efficient dryer at 50% inlet load capacity as compared to fully loaded operating conditions.

= Dependent on efficient dryer type, refer to the following table:<sup>1130</sup>

Dryer Type	EC50 <sub>efficient</sub>
Thermal-Mass	0.729
VSD	0.501
Digital Scroll	0.551

HOURS = Compressed air system pressurized hours, depending on shift. If unknown, use weighted average. This value is the weighted average of facility owner responses from the DOE evaluation of the Compressed Air Challenge. Facility owners with compressed air systems were surveyed detailing the number of shifts their facilities operated.

Shift	Hours	Distribution of Facilities by Hours of Operation <sup>1131</sup>	Weighted Hours
Single Shift 7 AM – 3 PM, weekdays, minus some holidays and scheduled down time	1,976	16%	316
Two Shifts 7AM – 11 PM, weekdays, minus some holidays and scheduled down time	3,952	23%	909
Three Shifts 24 hours per day, weekdays, minus some holidays and scheduled down time	5,928	25%	1,482
Four Shifts or Continual Operation 24 hours per day, 7 days a week minus some holidays and scheduled down time	8,320	36%	2,995
Total weighted average			5,702

CFM = Cubic feet per minute, rated capacity of refrigerated dryer

= Assume 100% of actual rated capacity.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / HOURS * CF$$

Where:

<sup>1127</sup> Compressed Air Challenge: Compressed Air Best Practice; “Cycling Air Dryers – Are Savings Significant?” Fox, Timothy J. and Marshall, Ron.

<sup>1128</sup> Engineering judgement, based on the assumption that on average, compressed air systems will operate at 50% capacity.

<sup>1129</sup> Compressed Air Challenge: Compressed Air Best Practice; “Cycling Air Dryers – Are Savings Significant?” Fox, Timothy J. and Marshall, Ron.

<sup>1130</sup> Ibid.

<sup>1131</sup> DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

CF = Summer peak coincidence factor, depending on shift. If unknown, use weighted average.

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average <sup>1132</sup>	0.89

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-CPA-CADR-V02-190101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>1132</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

## 4.7.6 Vortex Tube Thermostat - PROVISIONAL MEASURE

### DESCRIPTION

Cabinets that house programmable controllers, relays, motor controls, or other electrical components can generate significant amounts of heat. Removing heat from these cabinets is necessary to ensure the operation and longevity of the electrical components inside. There are several common methods of cooling electrical cabinets: fans, open blowing of compressed air, direct-expansion cooling units, heat pipes, thermoelectric coolers, and compressed air vortex coolers.<sup>1133</sup> Compressed air vortex tubes (“Ranque-Hilsch vortex tubes”) are used because they are cost-effective, simple (no moving parts), and appropriate for dirty or dusty environments where filter fouling is a concern. Vortex tubes separate the compressed air stream into hot air and cold air streams that reach to 100°F below inlet air temperature, making them much more effective than open blowing.<sup>1134</sup>

If compressed air cooling is used and uncontrolled, it typically blows continuously at an unregulated pressure. In these cases, a thermostatic control is recommended to reduced unnecessary compressed air consumption.<sup>1135</sup> These controls are available as retrofit kits or integrated with new vortex coolers.

This measure was developed to be applicable to the following program types: TOS, RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is a vortex tube cabinet cooler with valve and thermostatic control. Inlet modulating compressor systems are not eligible for this measure.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a continuously operated vortex tube cabinet cooler without thermostatic control.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

5 years<sup>1136</sup>

### DEEMED MEASURE COST

\$340 per thermostat kit, \$280 incremental cost of new cooler with thermostat, and \$1,390 total cost of new cooler with thermostat.<sup>1137</sup>

### LOADSHAPE

Loadshape C35 - Industrial Process

---

<sup>1133</sup> *Enclosure Cooling Solutions*, Hoffman. 2018.

[https://hoffman.nvent.com/wcsstore/AuroraStorefrontAssetStore/User%20Downloads/Literature%20Requests/content\\_Bro-00127.pdf](https://hoffman.nvent.com/wcsstore/AuroraStorefrontAssetStore/User%20Downloads/Literature%20Requests/content_Bro-00127.pdf)

<sup>1134</sup> *Vortex Tube Short Course*, Vortec. February 2017. <https://www.vortec.com/vortex-tube-short-course>

<sup>1135</sup> *Eliminate Inappropriate Uses of Compressed Air*, US Department of Energy. August 2004.

[https://www.energy.gov/sites/prod/files/2014/05/f16/compressed\\_air2.pdf](https://www.energy.gov/sites/prod/files/2014/05/f16/compressed_air2.pdf)

<sup>1136</sup> The thermostatic control lifetime is conservatively estimated at 5 years due to installation in a dirty, hazardous, or corrosive environment. Engineering judgement.

<sup>1137</sup> Based on a survey of Vortec and Exair product offerings. See “IL TRM Vortex Cooler Thermostat - Supporting Information.xls” for more detail.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = CFM_{Cooler} * kW_{Comp} * Hours * SF$$

Where:

$CFM_{Cooler}$  = Rated flow of the vortex cooler (CFM)

$kW_{Comp}$  = System power reduction per air demand (kW/CFM) depending on the type of air compressor found in table below.<sup>1138</sup> If unknown, assume Screw – Load/Unload.

Air Compressor Type	$kW_{Comp}$ (kW/CFM)
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Variable Displacement	0.15
Screw - VFD	0.18

Hours = Compressed air system pressurized hours

= Use actual hours if known, otherwise assume values in table below:

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average <sup>1139</sup>	5,702

SF = Savings Factor, representing the percentage of time the cooler is shut off by the thermostatic control.

= 25%<sup>1140</sup>

<sup>1138</sup> Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See “Industrial System Standard Deemed Saving Analysis.xls”.

<sup>1139</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1140</sup> This is a conservative assumption based on available case studies and conversations with distributors. Broadly, the minimum savings factor is equal to the safety factor used when sizing. This assumes that the heat generation inside the cabinet is constant. Since this not likely, the savings factor should be greater than the safety factor. 25% was selected as it was the most conservative of the case studies and a reasonable safety factor. See “IL TRM Vortex Cooler Thermostat - Supporting Information.xls” for more detail.

**For example**, a 20-CFM vortex cooler outfitted with a thermostat control would save

$$\begin{aligned} \Delta\text{kWh} &= 20 * 0.152 * 5,702 * 25\% \\ &= 4,334 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh/Hours} * \text{CF}$$

Where:

$\Delta\text{kW}$  = As calculated above

CF = Summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average <sup>1141</sup>	0.89

**For example**, a 20-CFM vortex cooler outfitted with a thermostat control would save

$$\begin{aligned} \Delta\text{kW} &= 4,334 / 5,702 * 0.89 \\ &= 0.68 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-CPA-VTEX-V01-200101**

**REVIEW DEADLINE: 1/1/2022**

<sup>1141</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

## 4.7.7 Efficient Desiccant Compressed Air Dryer

### DESCRIPTION

Compressed air is dried to reduce or eliminate condensation that can harm the compressed air system or end use equipment. For applications that require air to be dried below a dew point of 35°F,<sup>1142</sup> regenerative desiccant air dryers are typically used. Typically, regenerative desiccant dryers achieve pressure dew points as low as -40°F.

Regenerative desiccant dryers generally consist of two towers (or vertical tanks) filled with porous desiccant media. “Wet” compressed air flows through one tower, exiting as dried compressed air, while the other tower is dried out (or regenerated). This dryer alternates this process between towers to prevent compressed air flowing through saturated towers and damaging downstream equipment. The means of regeneration distinguishes the different types of regenerative dryer.

Heatless Desiccant Dryer: Uses compressed air (“purge air”) to dry out the regenerating tower. The amount of purge air is typically between 15-20% of the dryer’s rate flow (CFM), regardless of the flow rate that the compressor is supplying.<sup>1143</sup> This type of dryer alternates tower regeneration approximately every 5 minutes.<sup>1144</sup>

Heated Desiccant Dryer: Uses a combination of compressed purge air and heat for regeneration. The amount of purge air is typically 5-10% of the dryer’s rate flow (CFM), regardless of the flow rate that the compressor is supplying.<sup>1145</sup> This type of dryer alternates tower regeneration approximately every 8 hours.<sup>1146</sup>

Externally Heated Blower Purge Dryer: Uses an external blower and heat source for regeneration. This type of dryer requires a small amount (2%) of purge air or ambient air to cool the tower after heating. This type of dryer alternates tower regeneration approximately every 8 hours.<sup>1147</sup> There is also a type of blower purge dryer called a zero purge dryer that eliminates all compressed purge air.

The energy use of these dryers is primarily due to regeneration of the desiccant. Standard dryers come equipped with a fixed, timer regeneration control. However, the actual load on the dryer is variable. Optional dew point demand controls (DPDC) adjust the amount of regeneration to the moisture load on the dryer, reducing unnecessary purge energy.

This measure was developed to be applicable to the following program types: TOS, NC, ER.

---

<sup>1142</sup> The dew point limitation of the most common refrigerant-type air dryer. Improving Compressed Air System Performance: A Sourcebook for Industry, US Department of Energy. Page 48.

<https://www.energy.gov/sites/prod/files/2016/03/f30/Improving%20Compressed%20Air%20Sourcebook%20version%203.pdf>

<sup>1143</sup> Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.

<https://airbestpractices.com/system-assessments/air-treatment2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0>

<sup>1144</sup> Regenerative Desiccant Compressed Air Dryers. White, Donald. <https://airbestpractices.com/technology/air-treatment2/regenerative-desiccant-compressed-air-dryers>

<sup>1145</sup> Types of Compressed Air Dryers 2: Refrigerant and Regenerative Desiccant, Compressed Air and Gas Institute (CAGI). <https://airbestpractices.com/technology/air-treatment/n2/types-compressed-air-dryers-refrigerant-and-regenerative-desiccant>

<sup>1146</sup> Regenerative Desiccant Compressed Air Dryers. White, Donald. <https://airbestpractices.com/technology/air-treatment2/regenerative-desiccant-compressed-air-dryers>

<sup>1147</sup> Regenerative Desiccant Compressed Air Dryers. White, Donald. <https://airbestpractices.com/technology/air-treatment2/regenerative-desiccant-compressed-air-dryers>

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient equipment is heated or externally-heated by a blower purge desiccant dryer without dew point demand controls. Dryers installed on inlet modulation compressors do not qualify for this measure.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment is a heatless regenerative desiccant dryer without dew point demand controls.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The lifetime of this measure is 15 years.<sup>1148</sup>

**DEEMED MEASURE COST**

The incremental equipment cost for heated and blower purge regenerative desiccant dryers is \$3/CFM and \$12/CFM, respectively.<sup>1149</sup>

**LOADSHAPE**

Loadshape C35 – Industrial Process

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---



---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = CFM_{Dryer} * (P_{Base} - P_{EE} * PRF) * HOU$$

Where:

- CFM<sub>Dryer</sub> = rated capacity of the dryer in cubic feet per minute (CFM)
- P<sub>Base</sub> = power requirement of the baseline heatless regenerative dryer (kW/CFM)  
= PF<sub>Heatless</sub> \* kW<sub>comp</sub>
- PF<sub>Heatless</sub> = purge flow of heatless model (%)  
= 15%<sup>1150</sup>
- kW<sub>comp</sub> = system power reduction per reduced air demand (kW/CFM) depending on the type of compressor control.<sup>1151</sup> If unknown, assume Screw – Load/Unload.

---

<sup>1148</sup> Focus on Energy Evaluation Business Programs: Measure Life Study, p. 91-92. PA Consulting Group. August 25, 2009. [https://focusonenergy.com/sites/default/files/bpmeasurelifestudyfinal\\_evaluationreport.pdf](https://focusonenergy.com/sites/default/files/bpmeasurelifestudyfinal_evaluationreport.pdf)

<sup>1149</sup> Analysis of equipment cost between heatless, heated, blower purge dryers according to available online pricing. The capacity range considered was 250 – 1,500 CFM. Cost provided is the average incremental cost when comparing heated and blower purge dryers to baseline heatless dryers of the same CFM capacity. See “IL TRM Deissciant Dryers – Supporting Information.xls” file for more detail.

<sup>1150</sup> Typical estimates of purge flow for heatless dryers range from 15-20% of dryer rated capacity. 15% was selected as a conservative value.

<sup>1151</sup> Consistent with Air Nozzle measure, this assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See “Industrial System Standard Deemed Saving Analysis.xls”.



Air Compressor Type	$\Delta kW/CFM$
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Variable Displacement	0.15
Screw - VFD	0.18

Note: Dryers installed on inlet modulation compressors do not qualify for this measure.

- $P_{EE}$  = power requirement of the energy efficient (heated or blower purge) regenerative dryer (kW/CFM)  
 =  $(PF_{EE} * kW_{comp} + kW_{Heater} + kW_{Blower})$
- $PF_{EE}$  = purge flow of energy efficient model (%)<sup>1152</sup>  
 = 7.5% for heated models  
 = 2% for blower purge models (with compressed air cooling)  
 = 0% for “zero purge” blower purge models
- $kW_{Heater}$  = average power of heater per CFM of dryer (kW/CFM)<sup>1153,1154</sup>  
 = 0.007 kW/CFM for heated models  
 = 0.013 kW/CFM for blower purge models
- $kW_{Blower}$  = average power of blower per CFM of dryer (kW/CFM)<sup>1155</sup>  
 = 0 kW/CFM for heated models  
 = 0.003 kW/CFM for blower purge models
- PRF = purge reduction factor  
 = Assume 50% for heatless desiccant dryers<sup>1156</sup>  
 = Assume 60% for externally-heated or heated blower purge desiccant dryers<sup>1157</sup>

<sup>1152</sup> Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron. <https://airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0>

<sup>1153</sup> Based on a review of data sheets from six manufacturers. These values reflect average heater kW and not nominal heater kW. The heater operation will vary based on moisture load to the dryer. See “IL TRM Desiccant Dryers – Supporting Information.xls” file for more detail.

<sup>1154</sup> The heater operation will be controlled by temperature to avoid overheating the desiccant media. Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron. <https://airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0>

<sup>1155</sup> Based on a review of data sheets from six manufacturers. These values reflect average blower kW and not nominal blower kW. The blower operation will in many cases vary based on moisture load to the dryer. See “IL TRM Desiccant Dryers – Supporting Information.xls” file for more detail.

<sup>1156</sup> “For heatless desiccant dryers, the reduction in purge tends to be proportional only to the reduction of flow, not the reduction in moisture load due to the lower inlet temperatures.” The 50% value is based on the TRM’s assumption of a 50% dryer load factor used Illinois TRM Measure 4.7.5. Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers. <https://www.airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0>

<sup>1157</sup> “But for heated style units, the dryer reacts to both reductions. This means some energy is saved due to flow reduction, and additional energy is saved due to the lower moisture load in the cooler inlet air, resulting in more energy savings when compared with heatless styles.” Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers.

HOU = compressor total hours of operation below depending on shift

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average <sup>1158</sup>	5,702

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW_{\text{peak}} = \Delta kWh / \text{HOU} * \text{CF}$$

Where:

CF = summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average <sup>1159</sup>	0.89

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-CPA-DDRY-V02-210101**

**REVIEW DEADLINE: 1/1/2024**

<https://www.airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0>

<sup>1158</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1159</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

## 4.7.8 Desiccant Dryer Dew Point Demand Controls

### DESCRIPTION

Compressed air is dried to reduce or eliminate condensation that can harm the compressed air system or end use equipment. For applications that require air to be dried below a dew point of 35°F,<sup>1160</sup> regenerative desiccant air dryers are typically used. Typically, regenerative desiccant dryers achieve pressure dew points as low as -40°F.

Regenerative desiccant dryers generally consist of two towers (or vertical tanks) filled with porous desiccant media. “Wet” compressed air flows through one tower, exiting as dried compressed air, while the other tower is dried out (or regenerated). This dryer alternates this process between towers to prevent compressed air flowing through saturated towers and damaging downstream equipment. The means of regeneration distinguishes the different types of regenerative dryer.

The energy use of these dryers is primarily due to regeneration of the desiccant. Standard dryers come equipped with a fixed, timer regeneration control. However, the actual load on the dryer is variable. Dew point demand controls (DPDC) adjust the amount of regeneration to the load on the dryer, reducing unnecessary purge energy. DPDC can be retrofit on existing desiccant dryers or integrated in new desiccant dryers.

Heatless Desiccant Dryer: Uses compressed air (“purge air”) to dry out the regenerating tower. The amount of purge air is typically between 15-20% of the dryer’s rate flow (CFM), regardless of the flow rate that the compressor is supplying.<sup>1161</sup> This type of dryer alternates tower regeneration approximately every 5 minutes.<sup>1162</sup>

Heated Desiccant Dryer: Uses a combination of compressed purge air and heat for regeneration. The amount of purge air is typically 5-10% of the dryer’s rate flow (CFM), regardless of the flow rate that the compressor is supplying.<sup>1163</sup> This type of dryer alternates tower regeneration approximately every 8 hours.<sup>1164</sup>

Externally Heated Blower Purge Dryer: Uses an external blower and heat source for regeneration. This type of dryer requires a small amount (2%) of purge air or ambient air to cool the tower after heating. This type of dryer alternates tower regeneration approximately every 8 hours.<sup>1165</sup> There is also a type of blower purge dryer called a zero purge dryer that eliminates all compressed purge air.

This measure was developed to be applicable to the following program types: RF

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a heatless, externally-heated, or blower purge regenerative desiccant dryer without dew point demand controls. The controls should be able to respond to changes in flow and moisture loading. Dryers installed on inlet modulation compressors do not qualify for this measure.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a heatless, externally-heated, or blower purge regenerative desiccant dryer with dew point demand controls.

---

<sup>1160</sup> The dew point limitation of the most common refrigerant-type air dryer. Improving Compressed Air System Performance: A Sourcebook for Industry, US Department of Energy. Page 48.

<sup>1161</sup> Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.

<sup>1162</sup> Regenerative Desiccant Compressed Air Dryers. White, Donald.

<sup>1163</sup> Types of Compressed Air Dryers 2: Refrigerant and Regenerative Desiccant, Compressed Air and Gas Institute (CAGI).

<sup>1164</sup> Regenerative Desiccant Compressed Air Dryers. White, Donald.

<sup>1165</sup> Regenerative Desiccant Compressed Air Dryers. White, Donald.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The lifetime of this measure is 5 years.<sup>1166</sup>

**DEEMED MEASURE COST**

The estimated cost of the controls retrofit is \$4,000.<sup>1167</sup>

**LOADSHAPE**

Loadshape C35 – Industrial Process

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = CFM_{Dryer} * (PF * kW_{Comp} + kW_{Heater} + kW_{Blower}) * HOU * PRF$$

Where:

CFM<sub>Dryer</sub> = rated capacity of the dryer in cubic feet per minute (CFM)

PF = purge flow of desiccant dryer (%)<sup>1168</sup>

Air Compressor Type	Purge Flow
Heatless	15%
Externally-Heated	7.5%
Blower Purge	2%

kW<sub>comp</sub> = system power reduction per reduced air demand (kW/CFM) depending on the type of compressor control.<sup>1169</sup> If unknown, assume Screw – Load/Unload.

Air Compressor Type	ΔkW/CFM
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Variable Displacement	0.15
Screw - VFD	0.18

Note: Dryers installed on inlet modulation compressors do not qualify for this measure.

---

<sup>1166</sup> Since this is a retrofit, the EUL is one-third of the dryer life which is 15 years (TRM 4.7.7). Focus on Energy Evaluation Business Programs: Measure Life Study, p. 91-92. PA Consulting Group. August 25, 2009.

<sup>1167</sup> Desiccant Air Dryer Control: Seeing Isn't Always Believing. Marshall, Ron.

<sup>1168</sup> Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.

<sup>1169</sup> Consistent with Air Nozzle measure, this assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See "Industrial System Standard Deemed Saving Analysis.xls".

$kW_{Heater}$  = average power of heater per CFM of dryer (kW/CFM)<sup>1170,1171</sup>  
 = 0.007 kW/CFM for heated models  
 = 0.013 kW/CFM for blower purge models

$kW_{Blower}$  = average power of blower per CFM of dryer (kW/CFM)<sup>1172</sup>  
 = 0 kW/CFM for heated models  
 = 0.003 kW/CFM for blower purge models

HOU = compressor total hours of operation below depending on shift

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average <sup>1173</sup>	5,702

PRF = purge reduction factor  
 = Assume 50% for heatless desiccant dryers<sup>1174</sup>  
 = Assume 60% for externally-heated or heated blower purge desiccant dryers<sup>1175</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW_{peak} = \Delta kWh / HOU * CF$$

Where:

CF = summer peak coincidence factor

<sup>1170</sup> Based on a review of data sheets from six manufacturers. These values reflect average heater kW and not nominal heater kW. The heater operation will vary based on moisture load to the dryer. See “IL TRM Desiccant Dryers – Supporting Information.xls” file for more detail.

<sup>1171</sup> The heater operation will be controlled by temperature to avoid overheating the desiccant media. Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.

<sup>1172</sup> Based on a review of data sheets from six manufacturers. These values reflect average blower kW and not nominal blower kW. The blower operation will in many cases vary based on moisture load to the dryer. See “IL TRM Desiccant Dryers – Supporting Information.xls” file for more detail.

<sup>1173</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1174</sup> “For heatless desiccant dryers, the reduction in purge tends to be proportional only to the reduction of flow, not the reduction in moisture load due to the lower inlet temperatures.” The 50% value is based on the TRM’s assumption of a 50% dryer load factor used Illinois TRM Measure 4.7.5. Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers.

<sup>1175</sup> “But for heated style units, the dryer reacts to both reductions. This means some energy is saved due to flow reduction, and additional energy is saved due to the lower moisture load in the cooler inlet air, resulting in more energy savings when compared with heatless styles.” Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers.

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average <sup>1176</sup>	0.89

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-CPA-DPDC-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>1176</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

## 4.7.9 Compressed Air Heat Recovery

### DESCRIPTION

Air compressors are inherently inefficient, converting 80 to 93% of the electrical input energy into heat.<sup>1177</sup> Recovering this wasted heat for useful purposes is one method for reducing facility-level energy use. Typical air compressor heat recovery involves ducting air-cooled air compressor exhaust for space heat. Recovered heat can also be used for process heating, water heating, and boiler makeup water heating, but this workpaper only addresses the most common scenario.

This measure was developed to be applicable to the following program types: RF, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is an air-cooled air compressor that is ducted for heat recovery during the heating season. The ducting must include a thermostat that controls the heat recovery based on whether heating is needed.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an air-cooled air compressor whose exhaust is ducted to the outdoors or to a space where heat is not needed (e.g., compressor room, unoccupied space).

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

15 years<sup>1178</sup>

### DEEMED MEASURE COST

\$80/hp<sup>1179</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

---

<sup>1177</sup> Ron Marshall, William Scales, Gary Shafer, Paul Shaw, Paul Sheaffer, Rick Stasyshan, H.P. Improving Compressed Air System Performance: A Sourcebook for Industry v3. United States: N. p., 2016.

<sup>1178</sup> The 15-year measure life is based on the value for HVAC controls within the ComEd EUL research. The ductwork has an estimated 20-year measure life but is limited by the mechanical and thermostatic controls.

<sup>1179</sup> This estimate is based on three representative projects received through the Nicor Custom Program. The costs in these three projects were \$73/hp, \$76/hp, and \$84/hp.

**NATURAL GAS SAVINGS**

$$\Delta\text{therms} = \eta_{\text{HR}} * 2,545 * \text{HP} * \text{PP} * \text{Hours} * \text{CHF} / 100,000 / \eta_{\text{heat}}$$

Where:

$\eta_{\text{HR}}$  = Efficiency of heat recovery

= 80%<sup>1180</sup>

2,545 = Conversion factor, Btu/hp-hr

HP = Nominal horsepower of the compressor

PP = Percent power at average load (% flow or capacity) conditions. See table below  
If average flow is unknown, assume 65%.<sup>1181</sup>

If compressor type is unknown, assume Load/No-load (1 gal/CFM)

= 93.5%

% Capacity	On/Off Control	Load/No-Load (1 gal/cfm)	Load/No-Load (10 gal/cfm)	Inlet Valve Modulation (w/o Blowdown)	Inlet Valve Modulation (w/ Blowdown)	Variable Displacement	VSD w/ Unloading	VSD w/ Stopping
0%	0%	27%	27%	71%	26%	25%	12%	0%
10%	10%	32%	35%	74%	40%	34%	20%	12%
20%	20%	63%	42%	76%	54%	44%	28%	24%
30%	30%	74%	52%	79%	62%	52%	36%	33%
40%	40%	81%	60%	82%	82%	61%	45%	41%
50%	50%	87%	68%	86%	86%	63%	53%	53%
60%	60%	92%	76%	88%	88%	69%	60%	60%
<b>65%</b>	<b>65%</b>	<b>94%</b>	<b>80%</b>	<b>90%</b>	<b>90%</b>	<b>73%</b>	<b>66%</b>	<b>66%</b>
70%	70%	95%	83%	92%	92%	77%	71%	71%
80%	80%	98%	89%	94%	94%	85%	80%	80%
90%	90%	100%	96%	97%	97%	91%	89%	89%
100%	100%	100%	100%	100%	100%	100%	100%	100%

Hours = Compressor hours of operation below depending on shift

= Use actual hours if known, otherwise assume values in table below:

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928

<sup>1180</sup> Ron Marshall, William Scales, Gary Shafer, Paul Shaw, Paul Sheaffer, Rick Stasyshan, H.P. Improving Compressed Air System Performance: A Sourcebook for Industry v3. United States: N. p., 2016 (page 14).

<sup>1181</sup> The analysis of compressor load factors for the Illinois TRM’s 4.7.1 VSD Air Compressor measure show an average load factor range of 63 – 65%. For more information, please see: “IL TRM VSD Air Compressor – Supporting Information.xls”.



Shift	Hours
Four Shifts or Continual Operation	8,320
Unknown / Weighted average <sup>1182</sup>	5,702

CHF = Climate heating factor. This value represents the amount of time that the facility has a use for space heating. See table below for values.<sup>1183</sup>

Zone	Climate Heating Factor
1 - Rockford	58%
2 - Chicago	55%
3 - Springfield	48%
4 - Belleville	49%
5 - Marion	46%

100,000 = Conversion factor, Btu/therm

$\eta_{\text{heat}}$  = Heating system efficiency

= If actual heating system efficiency is unknown, assume 80%<sup>1184</sup>

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE CI-CPA-CHR-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

<sup>1182</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1183</sup> These values reflect a ratio of the hours below a heating balance point over 8,760. The heating balance point is assumed to be 55°F. The data source is TMY3 data. See “Compressed Air Heat Recovery – Supporting Info” file for derivation.

<sup>1184</sup> 80% is the federal minimum efficiency of gas-fired unit heaters. Unit heaters are a common heat source in industrial and manufacturing settings, where compressed air is likely to be in place.

## 4.7.10 Compressed Air Storage Receiver Tank

### DESCRIPTION

Using an air receiver or storage tank will buffer the air demands of the system on the compressor, thus eliminating short cycling. Although a load/no load compressor unloads in response to lowered demand, it does so over a period of time to prevent lubrication oil from foaming. Therefore, reducing the number of cycles reduces the number of transition times from load to no load and saves energy.

To qualify for this measure an existing load/no load compressor with a 1 gal/cfm storage ratio or a modulating w/ blowdown compressor must be replaced with a load/no load compressor with an improved storage capacity and ratio.

This measure was developed to be applicable to the following program types: RF, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is an oil-flooded load/no load compressor with an improved storage capacity and ratio compared to the existing system. The cfm should reflect the rated capacity (in cfm) of all active compressors. If that value cannot be determined, compressor power can be converted to capacity using the rule-of-thumb 4.5 cfm/hp.<sup>1185</sup>

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an oil-flooded load/no load compressor with a 1 gal/cfm storage ratio or a modulating w/ blowdown compressor.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years

### DEEMED MEASURE COST

Incremental cost (\$) =  $4.67 * (TANK_E - TANK_B)^{1186}$

Where:

4.67 = air receiver tank size, in gallons, to equipment cost conversion factor

TANK<sub>E</sub> = efficient tank size (gallons)

TANK<sub>B</sub> = baseline tank size (gallons)

### LOADSHAPE

Loadshape C35 – Industrial Process

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---

### Algorithm

---

<sup>1185</sup> The 4.5 cfm/hp rule of thumb is based on a rotary screw compressor delivering 4 to 5 cfm per 1 hp, "Relationship Between Pressure and Flow", Compressed Air System Best Practices, Industrial Utility Efficiency.

<sup>1186</sup> 2018 Vermont PUC: Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = 0.9 \times hp_{\text{compressor}} \times \text{HOURS} \times (CF_b - CF_e)$$

Where:

- $\Delta kWh$  = gross customer annual kWh savings for the measure
- $hp_{\text{compressor}}$  = compressor motor nominal hp
- $0.9^{1187}$  = compressor motor nominal hp to full load kW conversion factor
- HOURS = compressor total hours of operation below depending on shift

Shift	Hours
Single shift (8/5)	1,976 hours 7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952 hours 7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928 hours 24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8,320 hours 24 hours per day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average <sup>1188</sup>	5,702 hours

- $CF_b$  = baseline compressor factor<sup>1189</sup>  
= See table below for baseline compressor factor. If compressor type is unknown, default to a load/no load compressor with 1 gallon/cfm for the appropriate-sized compressor.

<sup>1187</sup> Conversion factor based on Survey of CAGI data sheets from 200 compressors. See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1188</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

<sup>1189</sup> Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM.

Baseline Compressor	Compressor Factor (≤ 40 hp) <sup>1190</sup>	Compressor Factor (50 – 200 hp) <sup>1191</sup>
Modulating w/ Blowdown	0.890	0.863
Load/No Load w/ 1 Gallon/CFM	0.909	0.887
Load/No Load w/ 3 Gallon/CFM	0.831	0.811
Load/No Load w/ 4 Gallon/CFM	0.812	0.792
Load/No Load w/ 5 Gallon/CFM	0.806	0.786

CF<sub>e</sub> = efficient compressor factor

= See table above for load/no load compressors with the adequate storage capacity installed. If unknown, default to load/no load compressors w/ 4 gallons/cfm.

**For example**, a 1-shift facility with a 100-hp modulating (with blowdown) adds a 2,000-gallon receiver to their compressed air system. This improvement brings the system storage over 4 gallons per cfm.

$$\begin{aligned} \text{Capacity Check:} &= 2,000 \text{ gallons} / (100 \text{ hp} * 4.5 \text{ cfm/hp}) \\ &= 4.4 \text{ gallons per cfm} \end{aligned}$$

$$\begin{aligned} \Delta \text{kWh} &= 0.9 * 100 * 1,976 * (0.863 - 0.792) \\ &= 12,627 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta \text{kW} = \Delta \text{kWh} / \text{HOURS} * \text{CF}$$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average <sup>1192</sup>	0.89

<sup>1190</sup> Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM. See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1191</sup> Compressor factors for this size range were developed using DOE part-load data for different compressor control types as well as load profiles from 45 compressors and 20 facilities. This data comes from ComEd Custom and Industrial Systems programs. The compressors were filtered to reflect only rotary screw compressors, between 50 and 200 hp, and operating a minimum of 4 hour per day. Additionally, compressors with clear and consistent baseload profiles were excluded from this analysis. See “IL TRM VSD Air Compressor – Supporting Information.xls” for more information.

<sup>1192</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

**For example**, a 1-shift facility with a 100-hp VSD modulating (with blowdown) compressor adds a 2,000-gallon receiver to their compressed air system. This improvement vringes the system storage over 4 gallons per cfm.

$$\begin{aligned} \text{Capacity Checek:} &= 2,000 \text{ gallons} / (100 \text{ hp} * 4.5 \text{ cfm/hp}) \\ &= 4.4 \text{ gallons per cfm} \end{aligned}$$

$$\begin{aligned} \Delta \text{kW} &= 12,627 / 1,976 * 0.59 \\ &= 3.77 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-CPA-CASRT-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

## 4.7.11 Reduce Compressed Air Setpoint

### DESCRIPTION

This measure characterizes the energy savings associated with reducing the compressed air pressure setpoint. A lower setpoint pressure results in the reduction of work requirements on the compressor resulting in energy savings. The energy savings assumptions are based on compressors operating at 100 psi.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment must meet the following requirements:

- Compressor setpoint must be decreased
- Specification and location of compressor must be known and verifiable

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an air compressor with a pressure setpoint higher than necessary (line pressure more than 115% of the highest end use requirement).

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 5 years.<sup>1193</sup>

### DEEMED MEASURE COST

The incremental cost is assumed to be \$0.

### LOADSHAPE

Loadshape C35 – Industrial Process

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

---



---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (kW_{\text{typical}} * \Delta P * SF * \text{Hours} / HP_{\text{typical}}) * HP_{\text{real}}$$

Where:

$\Delta kWh$  = gross customer annual kWh savings for the measure

$kW_{\text{typical}}$  = adjusted compressor power (kW) based on typical compressor loading and operating profile. Use actual compressor control type if known:

---

<sup>1193</sup> Based on value from ComEd Operational Efficiency CY2018 Impact Evaluation.

Control Type	kW <sub>typical</sub> <sup>1194</sup>
Reciprocating - On/off Control	70.2
Reciprocating - Load/Unload	74.8
Screw - Load/Unload	82.3
Screw - Inlet Modulation	82.5
Screw - Inlet Modulation w/ Unloading	82.5
Screw - Variable Displacement	73.2
Screw - VFD	70.8

= if the actual compressor control type is not known, use a weighted average based on the following market assumptions:

Control Type	Share %	kW <sub>typical</sub> <sup>1195</sup>
Market share estimation for load/unload control compressors	56%	74.8
Market share estimation for modulation w/unloading control compressors	27%	82.5
Market share estimation for variable displacement control compressors	17%	73.2
Weighted Average		76.6

$\Delta P$  = reduction in pressure differential between efficient and base case (psi)

= actual

SF =1% reduction in power per 2 psi reduction in system pressure is equal to 0.5% reduction per 1 psi, or a Savings Factor of 0.005<sup>1196</sup>

HOURS = compressor total hours of operation below depending on shift

Shift	Hours
Single shift (8/5)	1,976 hours 7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952 hours 7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928 hours 24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8,320 hours 24 hours per day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average <sup>1197</sup>	5,702 hours

<sup>1194</sup> Consistent with 4.7.2 Compressed Air Low Pressure Drop Filters. See “Industrial System Standard Deemed Saving Analysis.xls”.

<sup>1195</sup> Based on Tables 8.2.2 and 8.2.3 from Technical Support Document: Air Compressors. US Department of Energy. May, 2016.

<sup>1196</sup> “Optimizing Pneumatic Systems for Extra Savings,” Compressed Air Best Practices, DOE Compressed Air Challenge, 2010.

<sup>1197</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

HP<sub>typical</sub> = nominal HP for typical compressor  
 = 100 hp<sup>1198</sup>

HP<sub>real</sub> = total HP of real compressors distributing air through filter. This should include the total horsepower of the compressors that normally run through the filter, but not backup compressors.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$\Delta kW$  =  $\Delta kWh / HOURS * CF$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average <sup>1199</sup>	0.89

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-CPA-RCAS-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>1198</sup> Consistent with 4.7.2 Compressed Air Low Pressure Drop Filters. See “Industrial System Standard Deemed Saving Analysis.xls”.

<sup>1199</sup> Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.



## 4.8 Miscellaneous End Use

### 4.8.1 Pump Optimization

#### DESCRIPTION

Pump improvements can be done to optimize the design and control of centrifugal water pumping systems, including water solutions with freeze protection up to 15% concentration by volume. Other fluid and gas pumps cannot use this measure calculation. The measurement of energy and demand savings for commercial and industrial applications will vary with the type of pumping technology, operating hours, efficiency, and existing and proposed controls. Depending on the specific application slowing the pump, trimming or replacing the impeller may be suitable options for improving pumping efficiency. Pumps up to 40 HP are allowed to use this energy savings calculation. Larger motors should use a custom calculation (which may result in larger savings than this measure would claim).

#### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is proven to be an optimized centrifugal pumping system meeting the applicable program efficiency requirements:

- Pump balancing valves no more than 15% throttled
- Balancing valves on at least one load 100% open.

#### DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be the existing pumping system including existing controls and sequence of operations.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 8 years.<sup>1200</sup>

#### DEEMED MEASURE COST

The incremental capital cost for this measure can vary considerably depending upon the strategy employed to achieve the required efficiency levels and should be determined on a site-specific basis.

#### LOADSHAPE

Loadshape C14: Indust. 1-shift (8/5) (e.g., comp. air, lights)  
Loadshape C15: Indust. 2-shift (16/5) (e.g., comp. air, lights)  
Loadshape C16: Indust. 3-shift (24/5) (e.g., comp. air, lights)  
Loadshape C17: Indust. 4-shift (24/7) (e.g., comp. air, lights)

#### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 38%.<sup>1201</sup>

---

<sup>1200</sup> SCE Pump Test Final Report (2009), Summit Blue Consulting, LLC. This value is a weighted average of estimates provided by program participants.

<sup>1201</sup> Summer Peak Coincidence Factor has been preserved from the "Technical Reference Manual" (TRM) for Ohio Senate Bill 221 Energy Efficiency and Conservation Program and 09-512-GE-UNC," October 15, 2009. This is likely a conservative estimate, but is recommended for further study (as stated in the OH State TRM, page 269).

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (HP_{motor} * 0.746 * LF / \eta_{motor}) * HOURS * ESF$$

Where:

HP<sub>motor</sub> = Installed nameplate motor horsepower  
 = Actual

0.746 = Conversion factor from horse-power to kW (kW/hp)

LF / η<sub>motor</sub> = Combined as a single factor since efficiency is a function of load  
 = 0.65<sup>1202</sup>

Where:

LF = Load Factor; Ratio of the peak running load to the nameplate rating of the motor

η<sub>motor</sub> = Motor efficiency at pump operating conditions

HOURS = Annual operating hours of the pump  
 = Actual

ESF = Energy Savings Factor; assume a value of 15%.<sup>1203</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (HP_{motor} * 0.746 * (LF / \eta_{motor})) * (ESF) * CF$$

Where:

CF = Summer Coincident Peak Factor for measure

**NATURAL GAS ENERGY SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-PMPO-V03-210101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>1202</sup> "Measured Loading of Energy Efficient Motors - the Missing Link in Engineering Estimates of Savings," ACEEE 1994 Summer Study Conference, Asilomar, CA.

<sup>1203</sup> Published estimates of typical pumping efficiency improvements range from 5 to 40%. For analysis purposes, assume 15%. United States Industrial Electric Motor Systems Market Opportunities Assessment December 2002, Table E-7, Page 18.

## 4.8.2 Roof Insulation for C&I Facilities

### DESCRIPTION

Energy and demand saving are realized through reductions in the building cooling and heating loads by way of improvements in roof assembly thermal resistance properties. This measure was developed to be applicable to the following program types: RF and NC.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a roof assembly with thermal resistance that exceeds code requirements and should be determined by the program.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition in retrofit scenarios is the thermal resistance of the existing roof assembly.

The baseline for new construction scenarios is the thermal resistance of the roof assembly as mandated by applicable building code. Assembly R-values shall be referenced from IECC 2012 or ASHRAE – 90.1 – 2010, or IECC 2015 or ASHRAE – 90.1 – 2013, depending on the IECC in effect on the date of the building permit (if unknown assume IECC 2015).

Note IECC 2018 (based on ASHRAE 90.1-2016) became effective July 1, 2019 and is baseline for all New Construction permits from that date.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure expected useful life (EUL) is assumed to be 20 years per DEER 2008. This is consistent with SDG&E's 9th Year Measure Retrofit Study (1996 & 1997 Residential Weatherization Programs), CPUC's Energy Efficiency Policy Manual v.2, and GDS's Measure Life Report Residential and Commercial/Industrial Lighting and HVAC Measures (June 2007).

### DEEMED MEASURE COST

Costs can be highly variable due to differences in building type and structural assemblies and for that reason actual costs should be used when possible. Absent of actual cost information, estimated costs can be used. Per the W017 Itron California Measure Cost Study,<sup>1204</sup> the material cost for R-30 insulation is \$0.59 per square foot. The installation cost is \$0.81 per square foot. The total measure cost, therefore, is \$1.40 per square foot of insulation installed.

### LOADSHAPE

Loadshape C03: Commercial Cooling

### COINCIDENCE FACTOR

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
 = 91.3%<sup>1205</sup>

$CF_{PJM}$  = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

---

<sup>1204</sup> Measure costs are from the "2010-2012 W0017 Ex Ante Measure Cost Study", Itron, California Public Utilities Commission, May 2014. The data is provided in a file named "MCS Results Matrix – Volume I".

<sup>1205</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

$$= 47.8\%^{1206}$$

---



---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Electric energy savings is calculated as the sum of energy saved when cooling the building and energy saved when heating the building

$$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{heating}$$

If central cooling, the electric energy saved in annual cooling due to the added insulation is

$$\Delta kWh_{cooling} = ((1/R_{existing}) - (1/R_{new})) * Area * EFLH_{cooling} * \Delta T_{AVG,cooling} / 1,000 / \eta_{cooling}$$

Where:

R<sub>existing</sub> = Roof assembly heat loss coefficient with existing (or code required) insulation [(hr-°F-ft<sup>2</sup>)/Btu]

= In retrofit scenarios, actual existing conditions prior to retrofit should be used. If unavailable, default values by building type can be used, as outlined in the following table and adopted from Ohio Energy Technical Reference Manual and expanded to cover all type of commercial buildings in the state of Illinois. In new construction scenarios, the applicable code requirements, per the following tables, should be used.

For retrofits, the R-value for the entire assembly:

Building Type	Retrofit Assembly R-Value
Assembly	13.5
Assisted Living	13.5
College	13.5
Convenience Store	13.5
Elementary School	13.5
Garage	13.5
Grocery	13.5
Healthcare Clinic	13.5
High School	13.5
Hospital	13.5
Hotel/Motel	13.5
Manufacturing Facility	12
MF - High Rise	13.5
MF - Mid Rise	13.5
Movie Theater	13.5
Office - High Rise	13.5
Office - Low Rise	13.5
Office - Mid Rise	13.5
Religious Building	13.5
Restaurant	13.5

---

<sup>1206</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Building Type	Retrofit Assembly R-Value
Retail - Department Store	13.5
Retail - Strip Mall	13.5
Warehouse	12
Unknown	13.5

R-Values: ASHRAE – 90.1 – 2010

	IL TRM Zones 1, 2, & 3 [ASHRAE/IECC Climate Zone 5 (A, B, C)]			
	Nonresidential		Semiheated	
	Assembly Maximum	Insulation Min. R-Value	Assembly Maximum	Insulation Min. R-Value
Insulation Entirely Above Deck	0.048	R-20 c.i.	U-0.119	R-7.6 c.i.
Metal Building (Roof)	0.055	R-13.0 + R-13.0	U-0.083	R-13.0
Attic and Other	0.027	R-38.0	U-0.053	R-19.0

	IL TRM Zones 4 & 5 [ASHRAE/IECC Climate Zone 4 (A, B, C)]			
	Nonresidential		Semiheated	
	Assembly Maximum	Insulation Min. R-Value	Assembly Maximum	Insulation Min. R-Value
Insulation Entirely Above Deck	0.048	R-20.0 c.i.	0.173	R-5.0 c.i.
Metal Building (Roof)	0.055	R-13.0 + R-13.0	0.097	R-10.0
Attic and Other	0.027	R-38.0	0.053	R-19.0

**Table Notes**  
c.i. = continuous insulation

R-Values: ASHRAE – 90.1 – 2013 and 2016

	IL TRM Zones 1, 2, & 3 [ASHRAE/IECC Climate Zone 5 (A, B, C)]			
	Nonresidential		Semiheated	
	Assembly Maximum	Insulation Min. R-Value	Assembly Maximum	Insulation Min. R-Value
Insulation Entirely Above Deck	0.032	R-30.0 c.i.	0.063	R-15 c.i.
Metal Building (Roof)	0.037	R-19 + R-11 Ls or R-25 + R-8 Ls	0.082	R-19
Attic and Other	0.021	R-49	0.034	R-30

	IL TRM Zones 4 & 5 [ASHRAE/IECC Climate Zone 4 (A, B, C)]			
	Nonresidential		Semiheated	
	Assembly Maximum	Insulation Min. R-Value	Assembly Maximum	Insulation Min. R-Value
Insulation Entirely Above Deck	0.032	R-30.0 c.i.	0.093	R-10 c.i.
Metal Building (Roof)	0.037	R-19 + R-11 Ls or R-25 + R-8 Ls	0.082	R-19
Attic and Other	0.021	R-49	0.034	R-30

**Table Notes**  
 c.i. = continuous insulation  
 Ls = linear system, a continuous vapor barrier liner installed below the purlins and uninterrupted by framing members

- R<sub>new</sub> = Roof assembly heat loss coefficient with new insulation [(hr-°F-ft<sup>2</sup>)/Btu]
- Area = Area of the roof surface in square feet.
- EFLH<sub>cooling</sub> = Equivalent Full Load Hours for Cooling [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use
- ΔT<sub>AVG,cooling</sub> = Average temperature difference [°F] during cooling season between outdoor air temperature and assumed 75°F indoor air temperature

Climate Zone (City based upon)	OA <sub>AVG,cooling</sub> [°F] <sup>1207</sup>	ΔT <sub>AVG,cooling</sub> [°F]
1 (Rockford)	81	6
2 (Chicago)	81	6
3 (Springfield)	81	6
4 (Belleville)	82	7
5 (Marion)	82	7

- 1,000 = Conversion from Btu to kBtu
- η<sub>cooling</sub> = Seasonal energy efficiency ratio (SEER) of cooling system (kBtu/kWh). Use actual if possible, if unknown and for planning purposes assume the following:

Year Equipment was Installed	SEER estimate
Before 2006	10
After 2006	13

If the building is heated with electric heat (resistance or heat pump), the electric energy saved in annual heating due to the added insulation is

$$\Delta kWh_{heating} = [(1/R_{existing}) - (1/R_{new})] * Area * EFLH_{heating} * \Delta T_{AVG,heating} / 3,412 / \eta_{heating}$$

Where:

- EFLH<sub>heating</sub> = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use
- ΔT<sub>AVG,heating</sub> = Average temperature difference [°F] during heating season between outdoor air temperature and assumed 55°F heating base temperature

<sup>1207</sup> National Solar Radiation Data Base -- 1991- 2005 Update: Typical Meteorological Year 3

Climate Zone (City based upon)	OA <sub>AVG,heating</sub> [°F] <sup>1208</sup>	ΔT <sub>AVG,heating</sub> [°F]
1 (Rockford)	32	23
2 (Chicago)	34	21
3 (Springfield)	35	20
4 (Belleville)	36	19
5 (Marion)	39	16

3,142 = Conversion from Btu to kWh.

η<sub>heating</sub> = Efficiency of heating system. Use actual efficiency. If not available refer to default table below.

System Type	Age of Equipment	HSPF Estimate	η <sub>Heat</sub> (Effective COP Estimate) (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006	7.7	1.92
Resistance	N/A	N/A	1

If the building is heated with a gas furnace, there will be some electric savings in heating the building attributed to extra insulation since the furnace fans will run less.

$$\Delta kWh_{heating} = \Delta Therms * Fe * 29.3$$

Where:

ΔTherms = Gas savings calculated with equation below.

Fe = Percentage of heating energy consumed by fans, assume 3.14%

29.3 = Conversion from therms to kWh

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\Delta kWh_{cooling} / EFLH_{cooling}) * CF$$

Where:

EFLH<sub>cooling</sub> = Equivalent full load hours of air conditioning in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)  
= 91.3%<sup>1209</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)  
= 47.8%<sup>1210</sup>

<sup>1208</sup> National Solar Radiation Data Base -- 1991- 2005 Update: Typical Meteorological Year 3

<sup>1209</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

<sup>1210</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**NATURAL GAS SAVINGS**

If building uses a gas furnace, the savings resulting from the insulation is calculated with the following formula.

$$\Delta\text{Therms} = ((1/R_{\text{existing}}) - (1/R_{\text{new}})) * \text{Area} * \text{EFLH}_{\text{heating}} * \Delta T_{\text{AVG,heating}} / 100,000 / \eta_{\text{heat}}$$

Where:

- R\_existing = Roof assembly heat loss coefficient with existing (or code required) insulation [(hr-°F-ft<sup>2</sup>)/Btu], per guidance outlined in Electric Energy Savings section.
- R\_new = Roof assembly heat loss coefficient with new insulation [(hr-°F-ft<sup>2</sup>)/Btu]
- Area = Area of the roof surface in square feet. Assume 1000 sq ft for planning.
- EFLH<sub>heating</sub> = Equivalent Full Load Hours for Heating in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use
- ΔT<sub>AVG,heating</sub> = Average temperature difference [°F] during heating season (see above)
- 100,000 = Conversion from BTUs to Therms
- η<sub>heat</sub> = Efficiency of existing furnace. Assume 0.78 for planning purposes.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MS-C-RINS-V05-210101**

**REVIEW DEADLINE: 1/1/2025**



### 4.8.3 Computer Power Management Software

#### DESCRIPTION

This measure characterizes the savings achieved through controlling the power management settings of a desktop computer, monitor or laptop. This can be achieved one of two ways; either a centralized computer power management software is installed on a network of computers to monitor and record usage and manage the power management settings of all units (referred to as Centralized Software) , or the settings are adjusted on each individual unit (referred to as Individual Settings).

#### DEFINITION OF EFFICIENT EQUIPMENT

For Centralized Software, the efficient equipment is defined by the requirements listed below:

- Allow centralized control and override of computer power management settings of workstations which include both a computer monitor and CPU (i.e. a desktop or laptop computer on a distributed network)
- Be able to control on/off/sleep states on both the CPU and monitor according to the Network Administrator-defined schedules and apply power management policies to network groups
- Have capability to allow networked workstations to be remotely wakened from power-saving mode (e.g. for system maintenance or power/setting adjustments)
- Have capability to detect and monitor power management performance and generate energy savings reports
- Have capability to produce system reports to confirm the inventory and performance of equipment on which the software is installed.

For Individual Settings, each desktop, monitor or laptop requires power settings to be adjusted to appropriately place devices in a low-power standby, sleep or off mode after a predetermined period of inactivity (for example display sleep mode after 10 minutes of inactivity and computer sleep mode after 30 minutes).

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF BASELINE EQUIPMENT

Baseline is defined as a desktop computer, monitor or laptop without the power management settings enabled.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

For Centralized Software, the expected measure life is five years.<sup>1211</sup>

For Individual Settings, the expected measure life is two years.<sup>1212</sup>

#### DEEMED MEASURE COST

For Centralized Software, the deemed measure cost is \$29 per networked computer, including labor.<sup>1213</sup>

For Individual Settings, the deemed measure cost is \$10 per unit.<sup>1214</sup>

---

<sup>1211</sup> Computers and peripheral equipment are considered 5-year property. 2016 IRS Publication 946.

<https://www.irs.gov/pub/irs-prior/p946--2016.pdf>

<sup>1212</sup> Reduced estimate accounting for settings only lasting as long as units are in operation and the ease at which they can be turned off or adjusted in any one individual machine, due to personal preference.

<sup>1213</sup> Work Paper WPSCNROE0003 Revision 1, Power Management Software for Networked Computers. Southern California Edison.

<sup>1214</sup> Estimate assuming 15 minutes of labor at \$40/hour rate.

**LOADSHAPE**

Loadshape C21: Commercial Office Equipment.

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((UECCompBase - UECCompEff) + (UECMonBase - UECMonEff))$$

Where:

UECComBase = Energy consumption of computer before adjusting power settings  
 $(\sum State PowerState \times HoursBase,State) / 1,000$

UECComEff = Energy consumption of computer after adjusting power settings  
 $(\sum State PowerState \times HoursEff,State) / 1,000$

UECMonBase = Energy consumption of monitor before adjusting power settings  
 $(\sum State MpW \times PowerState \times HoursBase,State) / 1,000$

UECMonEff = Energy consumption of monitor after adjusting power settings  
 $(\sum State MpW \times PowerState \times HoursEff,State) / 1,000$

HoursBase,State = Annual hours in each power state<sup>1215</sup>  
 $8,760 \times BaseDutyCycle(\%)$

Computer Power State	Base Duty Cycle	
	Computer	Monitor
Unplugged	5%	22%
Off	55%	50%
Sleep	2%	2%
Idle	35%	N/A
Active	3%	26%

Hours Eff,State = Annual hours in each power state<sup>1216</sup>  
 $8,760 \times EfficientDutyCycle(\%)$

<sup>1215</sup> Northwest Regional Technical Forum Non-Res Network Computer Power Management , January 29, 2015. Analysis can be found in NonResNetCompPwrMgt\_v4\_1.xlsm. <https://rtf.nwcouncil.org/measure/non-res-network-computer-power-management>

<sup>1216</sup> Northwest Regional Technical Forum Non-Res Network Computer Power Management , January 29, 2015. Analysis can be found in NonResNetCompPwrMgt\_v4\_1.xlsm. <https://rtf.nwcouncil.org/measure/non-res-network-computer-power-management>

Computer Power State	Efficient Duty Cycle	
	Computer	Monitor
Unplugged	5%	22%
Off	77%	57%
Sleep	2%	2%
Idle	13%	N/A
Active	3%	19%

PowerState = Power (W) consumption in each power state<sup>1217</sup>

Computer Power State	Power Draw (Watts)		
	Desktop Computer	Laptop Computer	Monitor
Unplugged	0.0	0.0	0.0
Off	0.9	0.5	0.23
Sleep	2.1	0.9	0.32
Idle	39.9	8.9	N/A
Active	72.2	60.0	14.43

**For example:** Computer Savings:

$$\text{kWh savings} = (\text{UECCompBase} - \text{UECCompEff})$$

$$\text{UECCompBase} = 0 \times 5\% \times 8,760 + 0.9 \times 55\% \times 8,760 + 2.1 \times 2\% \times 8,760 + 39.9 \times 35\% \times 8,760 + 72.2 \times 3\% \times 8,760 = 146.2 \text{ kWh}$$

$$\text{UECCompEff} = 0 \times 5\% \times 8760 + 0.9 \times 77\% \times 8760 + 2.1 \times 2\% \times 8760 + 39.9 \times 13\% \times 8760 + 72.2 \times 3\% \times 8760 = 70.5 \text{ kWh}$$

$$\text{Computer kWh savings} = (146.2 - 70.5) = 75.7 \text{ kWh}$$

**For example:** Laptop Savings:

$$\text{UECCompBase} = 0 \times 5\% \times 8,760 + 0.5 \times 55\% \times 8,760 + 0.9 \times 2\% \times 8,760 + 8.9 \times 35\% \times 8,760 + 60.0 \times 3\% \times 8,760 = 45.6 \text{ kWh}$$

$$\text{UECCompEff} = 0 \times 5\% \times 8760 + 0.5 \times 77\% \times 8760 + 0.9 \times 2\% \times 8760 + 8.9 \times 13\% \times 8760 + 60.0 \times 3\% \times 8760 = 29.4 \text{ kWh}$$

$$\text{Laptop kWh savings} = (45.6 - 29.4) = 16.2 \text{ kWh}$$

**For example:** Monitor Savings:

$$\text{Monitor kWh savings} = (\text{UECMonBase} - \text{UECMonEff})$$

$$\text{UECMonBase} = (2 \times 0 \times 22\% \times 8,760 + 2 \times 0.23 \times 50\% \times 8,760 + 2 \times 0.32 \times 2\% \times 8,760 + 2 \times 14.43 \times 26\% \times 8,760) / 1,000 = 67.9 \text{ kWh}$$

$$\text{UECMonEff} = (2 \times 0 \times 22\% \times 8760 + 2 \times 0.23 \times 57\% \times 8,760 + 2 \times 0.32 \times 2\% \times 8,760 + 2 \times 14.43 \times 19\% \times 8,760) / 1,000 = 50.5 \text{ kWh}$$

$$\text{Monitor kWh savings} = (67.9 - 50.5) = 17.4 \text{ kWh}$$

<sup>1217</sup> Northwest Regional Technical Forum Non-Res Network Computer Power Management , January 29, 2015. Analysis can be found in NonResNetCompPwrMgt\_v4\_1.xlsm. <https://rtf.nwccouncil.org/measure/non-res-network-computer-power-management>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / 8760$$

Computer peak kW savings	= 75.7/8760	= 0.009 kW
Laptop peak kW savings	= 16.2/8760	= 0.002 kW
Monitor peak kW savings	=17.4/8760	= 0.002 kW

**NATURAL GAS SAVING**

NA

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

NA

**DEEMED O&M COST ADJUSTMENT CALCULATION**

For Centralized Software, assume \$2/unit <sup>1218</sup>

For Individual Settings, no O&M impacts.

**MEASURE CODE: CI-MSC-CPMS-V03-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>1218</sup> Based on Dimetrosky, S., Luedtke, J. S., & Seiden, K. (2005). Surveyor Network Energy Manager: Market Progress Evaluation Report, No. 2 (Northwest Energy Efficiency Alliance report #E05-136). Portland, OR: Quantec LLC and review of CLEARResult document providing Qualifying Software Providers for ComEd program and their licensing fees; "Qualifying Vendor Software Comparison.pdf".

## 4.8.4 Modulating Commercial Gas Clothes Dryer

### DESCRIPTION

This measure relates to the installation of a two-stage modulating gas valve retrofit kit on a standard commercial non-modulating gas dryer. Commercial gas clothes dryers found in coin-operated laundromats or on-premise laundromats (hospitals, hotels, health clubs, etc.) traditionally have a single firing rate which is sized properly for highest heat required in initial drying stages but is oversized for later drying stages requiring lesser heat. This causes the burner to cycle on/off frequently, resulting in less efficient drying and wasted gas. Replacing the single stage gas valve with a two-stage gas valve allows the firing rate to adjust to the changing heat demand, thereby reducing overall gas consumption.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

A 30 to 250 pound capacity commercial gas dryer retrofitted with a two-stage modulating gas valve kit.

### DEFINITION OF BASELINE EQUIPMENT

A 30 to 250 pound capacity commercial gas dryer with no modulating capabilities.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life for the retrofit kit is 14 years, assumed to be equal to that of a commercial gas dryer.<sup>1219</sup>

### DEEMED MEASURE COST

The full retrofit cost is assumed to be \$700, including the material cost for the basic modulating gas valve retrofit kit (\$600) and the associated of labor for installation (\$100).<sup>1220</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

---

<sup>1219</sup> Zhang, Yanda, and Julianna Wei. *Commerical Clothes Dryers, CASE Initiative for PY2013: Title 20 Standards Development*. California Public Utilities Commission, 2013.

<sup>1220</sup> Engineering judgement, based on observed costs during Nicor Gas pilot study. "Nicor Gas Emerging Technology Program, 1036: Commercial Dryer Modulation Retrofit Public Project Report." 2014.

**NATURAL GAS ENERGY SAVINGS**

*Note: Accurately estimating dryer energy consumption is complicated and challenging due to a variety of factors that influence cycle times and characteristics and ultimately drying energy requirements. Clothing loads can vary by weight, volume, fiber composition, physical structure, and initial water content, meaning that for any given cycle drying energy requirements can differ. Additionally, dryer settings selected by the user as well as interactions with the site’s HVAC systems are known to influence dryer performance. As better information becomes available, this characterization can be modified to allow for a more site-specific estimation of savings.*

$$\Delta\text{Therms} = N_{\text{Cycles}} * SF$$

Where:

$N_{\text{Cycles}}$  = Number of dryer cycles per year. Refer to the table below if this value is not directly available.

Application	Cycles per Year
Coin- Operated Laundromats <sup>1221</sup>	1,483
Multi-family Dryers <sup>1222</sup>	1,074
On-Premise Laundromats <sup>1223</sup>	3,607

SF = Savings factor  
 = 0.18 therms/cycle<sup>1224</sup>

If using default cycles the savings are as follows:

Application	$\Delta\text{Therms}$
Coin- Operated Laundromats <sup>1225</sup>	267
Multi-family Dryers <sup>1226</sup>	193
On-Premise Laundromats <sup>1227</sup>	649

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-MODD-V01-160601**

**REVIEW DEADLINE: 1/1/2023**

<sup>1221</sup> From DOE’s Federal Register Notices, Energy Conservation Program: Energy Conservation Standards for Commercial Clothes Dryers, Office of Energy Efficiency & Renewable Energy.

<sup>1222</sup> Ibid.

<sup>1223</sup> Average value for dryer cycles in healthcare facility, hotels, drycleaners and laundromats from tests conducted in Nicor Gas Emerging Technology Program’s Commercial Dryer Modulation Retrofit Public Project Report.

<sup>1224</sup> Based on Illinois weather data, and average dryer performance for laundromat (30 to 45lb) and hotel (75 to 170 lb) dryers. See GTI Analysis.xlsx for complete derivation.

<sup>1225</sup> From DOE’s Federal Register Notices, Energy Conservation Program: Energy Conservation Standards for Commercial Clothes Dryers, Office of Energy Efficiency & Renewable Energy.

<sup>1226</sup> Ibid.

<sup>1227</sup> Average value for dryer cycles in healthcare facility, hotels, drycleaners and laundromats from tests conducted in Nicor Gas Emerging Technology Program’s Commercial Dryer Modulation Retrofit Public Project Report.

## 4.8.5 High Speed Clothes Washer

### DESCRIPTION

This measure applies to the installation of clothes washers with extraction speeds of 200G or greater, which is significantly higher than traditional hard-mount washers. Standard washer extractors in laundromats operate at speeds of 70-80G<sup>1228</sup>. The high-speed extraction process in the wash cycle removes more water from each compared to standard washers, reducing operating time and gas consumption of clothes dryers. Heat exposure and mechanical action are also reduced, resulting in less linen wear.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a clothes washer with an extraction speed of 200G or greater, installed in a commercial laundromat. This measure is only applicable for sites utilizing gas dryers. Sites using electric dryers are not eligible for participation.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a clothes washer with an extraction speed of 100G or less, installed in a commercial laundromat.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure lifetime is assumed to be the typical lifetime of a commercial clothes washer: 7 years.<sup>1229</sup>

For early replacement measures it is assumed the existing unit would last another 2.3 years.<sup>1230</sup>

### DEEMED MEASURE COST<sup>1231</sup>

The incremental cost for time of sale is \$9.70/lb capacity.

The full cost of the high speed washer for early replacement applications is \$164.89/lb capacity. The deferred replacement cost of the baseline unit is \$155.19/lb capacity. This future cost should be discounted to present value using the real discount rate.

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

---

### Algorithm

---

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

N/A

---

<sup>1228</sup> "The Real Size of a Front Load Washer", Laundromat123

<sup>1229</sup> "Assessment of Water Savings for Commercial Washers: Report on the Monitoring and Assessment of Water Savings from the Coin-Operated Multi-Load Clothes Washers Voucher Initiative Program." San Diego County Water Authority October 2016.

<sup>1230</sup> One-third of expected measure life.

<sup>1231</sup> Measure costs are based on data from a quote provided by a commercial washer distributor to Franklin Energy Services.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = (\text{Ncycles} * \text{Days} * \text{Capacity} * \text{RMC} * h_e / \eta_{\text{dryer}} / 100,000) * \text{DryerUse} * \text{LF}$$

Where:

Ncycles = Average number of washer cycles per day

= Use values from table below, depending on application

Application	Ncycles
Coin-operated Laundromats	4.3 <sup>1232</sup>
Multi-family	3.4 <sup>1233</sup>
Hotel/Motel/Hospital	10.4 <sup>1234</sup>

Days = Days per year of commercial laundromat operation

= Actual, or if unknown, assume 360 days<sup>1235</sup>

Capacity = Clothes washer rated capacity (lb/cycle)<sup>1236</sup>

= Actual

RMC = Retained Moisture Content (%)<sup>1237</sup> reduction from replacing a low extraction speed washer

= Assume 15%<sup>1238</sup>

<sup>1232</sup>“2014-2015 State of the Self-Service Laundry Industry Report.” Carlo Calma, April 13, 2015.

<sup>1233</sup> “Assessment of Water Savings for Commercial Washers: Report on the Monitoring and Assessment of Water Savings from the Coin-Operated Multi-Load Clothes Washers Voucher Initiative Program.” San Diego County Water Authority October 2016.

<sup>1234</sup> “Laundry Planning Guide.” EDRO, January 2015.

<sup>1235</sup> Based on professional judgement, assuming closed on holidays.

<sup>1236</sup> Clothes washer capacity is based on weight of dry clothing.

<sup>1237</sup> The EDRO “Laundry Planning Guide” describes moisture retention as “the ratio of retained moisture weight to clean dry textile weight.” The pounds of water retained by clothing at the end of a wash cycle is calculated by multiplying Capacity (lbs of dry clothing per cycle) by RMC.

<sup>1238</sup> Using chart provided (Figure 1) and assuming a 50/50 cloth blend load of cotton and polyester, the retained moisture drops from approximately 65% to 50% when a 100 g washer is replaced with a 200 g washer. Chart from “Laundry Planning Guide.” EDRO, January 2015. The Department of Energy test procedures for commercial clothes washers specifies, “...the use of energy test cloth consisting of a pure finished bleach cloth, made with a momie or granite weave, which is a blended fabric of 50-percent cotton and 50-percent polyester.” – Energy Conservation Program: Energy Conservation Standards for Commercial Clothes Washers; Final Rule, Notice of Proposed Rulemaking, DOE, March 2014 (10 CFR Part 431).



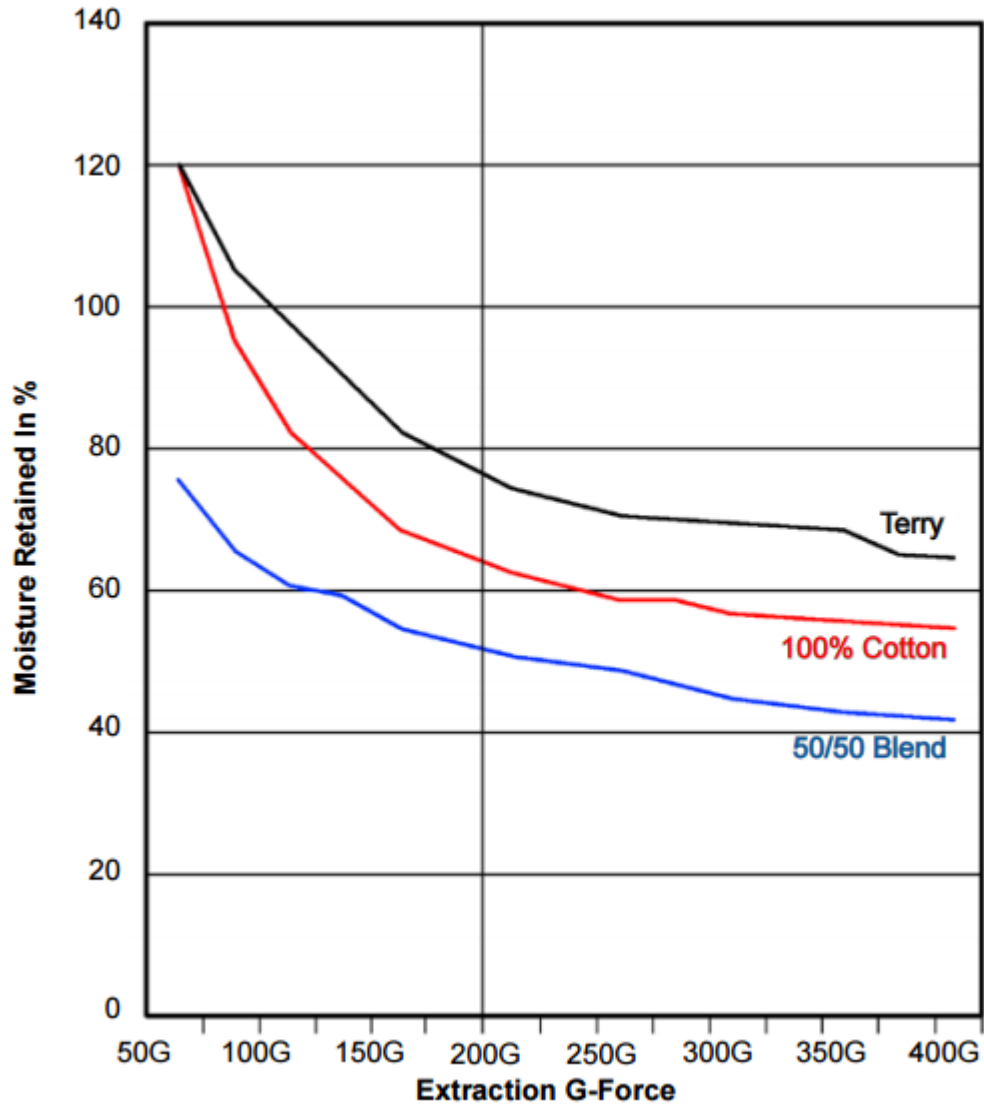


Figure 1

$h_e$  = Heat required by a dryer to evaporate 1 lb of water

= Assume 1,200 Btu/lb<sup>1239</sup>

$\eta_{dryer}$  = Efficiency of the clothes dryer

= Actual, or if unknown, assume 60%<sup>1240</sup>

100,000 = Converts Btus to therms

DryerUse = % of washer loads dried in the field

= Assume 91%<sup>1241</sup>

<sup>1239</sup> "Laundry Planning Guide." EDRO, January 2015.

<sup>1240</sup> ACEEE (2010), "Are We Missing Energy Savings in Clothes Dryers?" Paul Bendt (Ecos), 2010

<sup>1241</sup> "Dryer Field Study." Northwest Energy Efficiency Alliance, November 20, 2014.

LF = Load Factor (%) to account for the pounds per washer load, as a percentage of rated capacity  
= Assume 66%<sup>1242</sup>

**For example**, a clothes washer with a 14 lb/cycle capacity and installed at a coin-operated laundromat, using default assumptions, would save:

$$\begin{aligned}\Delta\text{Therms} &= (\text{Ncycles} * \text{Days} * \text{Capacity} * \text{RMC} * h_e / \eta_{\text{dryer}} / 100,000) * \text{DryerUse} * \text{LF} \\ &= (4.3 * 360 * 14 * 0.25 * 1,200 / 0.60 / 100,000) * 0.91 * 0.66 \\ &= 65 \text{ therms}\end{aligned}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-HSCW-V02-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>1242</sup>“Assessment of Water Savings for Commercial Washers: Report on the Monitoring and Assessment of Water Savings from the Coin-Operated Multi-Load Clothes Washers Voucher Initiative Program.” San Diego County Water Authority October 2016.

## 4.8.6 ENERGY STAR Computers

### DESCRIPTION

This measure estimates savings for a desktop computer with ENERGY STAR (ES) Version 8.0 rating, ES 8.0 +20%, ES 8.0 with 80 PLUS Platinum PSUs, and ES 8.0 with 80 PLUS Titanium PSUs.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient product is a desktop with a rating of ENERGY STAR Version 8.0 rating, ES 8.0 +20%, ES 8.0 with 80 PLUS Platinum PSUs, or ES 8.0 with 80 PLUS Titanium PSUs.

### DEFINITION OF BASELINE EQUIPMENT

Non ENERGY STAR qualified equipment with standard efficiency power supply.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 4 years.<sup>1243</sup>

### DEEMED MEASURE COST<sup>1244</sup>

The incremental cost for an 80 Plus Desktop PSU is \$5.

The incremental cost for an ENERGY STAR desktop PSU is \$20.

### LOADSHAPE

C21 Commercial Office Equipment

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS<sup>1245</sup>

$$\Delta \text{kWh} = 8760/1000 * (((\text{Watts}_{\text{Base,Off}} * \% \text{Time}_{\text{Off}}) + (\text{Watts}_{\text{Base,Sleep}} * \% \text{Time}_{\text{Sleep}}) + (\text{Watts}_{\text{Base,Long}} * \% \text{Time}_{\text{Long}}) + (\text{Watts}_{\text{Base,Short}} * \% \text{Time}_{\text{Short}})) - ((\text{Watts}_{\text{Eff,Off}} * \% \text{Time}_{\text{Off}}) + (\text{Watts}_{\text{Eff,Sleep}} * \% \text{Time}_{\text{Sleep}}) + (\text{Watts}_{\text{Eff,Long}} * \% \text{Time}_{\text{Long}}) + (\text{Watts}_{\text{Eff,Short}} * \% \text{Time}_{\text{Short}})))$$

Where (see assumptions in table below):

8760/1000 = Converts W to kWh

Watts<sub>Base,Off</sub> = baseline equipment power in off mode

%Time<sub>Off</sub> = typical percent of time a desktop, integrated desktop or notebook is in off mode during the year

<sup>1243</sup> Codes and Standards Enhancement (CASE) Initiative For PY 2013: Title 20 Standards Development. Analysis of Standards Proposal for Computers, August 6, 2013. Section 2.3 Design Life, Page 15.

<sup>1244</sup> NEEA Research Into Action, 80 PLUS Market Progress Evaluation Report #5, November 26, 2013. Page 24.

<sup>1245</sup> ENERGY STAR Program Requirements for Computers - Eligibility Criteria v8.0, Section 3.5.2.v., Equation 1: TEC Calculation (ETEC) for Desktop, Integrated Desktop, and Notebook Computers, pg 12.

- Watts<sub>Base,Sleep</sub> = baseline equipment power in sleep mode
- %Time<sub>Sleep</sub> = typical percent time in sleep mode
- Watts<sub>Base,Long</sub> = baseline equipment power in long idle mode
- %Time<sub>Long</sub> = typical percent time in long idle mode
- Watts<sub>Base,Short</sub> = baseline equipment power in short idle mode
- %Time<sub>Short</sub> = typical percent time in short idle mode
- Watts<sub>Eff,Off</sub> = efficient equipment power in off mode
- Watts<sub>Eff,Sleep</sub> = efficient equipment power in sleep mode
- Watts<sub>Eff,Long</sub> = efficient equipment power in long idle mode
- Watts<sub>Eff,Short</sub> = efficient equipment power in short idle mode

Measure Annual Mode Time (%)	Off	Sleep	Long Idle	Short Idle
Duty cycle – Commercial Desktop <sup>1246</sup>	15%	45%	10%	30%

Measure Watt Draw in Mode (Watts)	Off	Sleep	Long Idle	Short Idle
Baseline <sup>1247</sup>	0.88	2.1	26.5	27.9
ES 8.0 Desktops <sup>1248</sup>	0.64	1.54	14.97	19.62
ES 8.0 +20% Desktops <sup>1249</sup>	0.64	1.53	14.47	19.22
ES 8.0 Desktops w/ 80 PLUS Platinum PSUs <sup>1250</sup>	0.50	1.50	13.97	18.30
ES 8.0 Desktops w/ 80 PLUS Titanium PSUs <sup>1251</sup>	0.50	1.50	13.67	17.91

Calculated energy consumption in each mode, and savings provided below:

Measure TEC by Mode - Commercial	Off	Sleep	Long Idle	Short Idle	TEC (kWh/yr)	Savings (kWh/yr)
Baseline	1.2	8.3	23.2	73.3	106.0	N/A
ES 8.0 Desktops	0.8	6.1	13.1	51.6	71.6	34.4
ES 8.0 +20% Desktops	0.8	6.0	12.7	50.5	70.1	35.9

<sup>1246</sup> ENERGY STAR Program Requirements for Computers - Eligibility Criteria v8.0, Section 3.5.2.v., Table 4: Mode Weightings for Desktops and Integrated Desktop Computers, pg 13.

<sup>1247</sup> Codes and Standards Enhancement (CASE) Initiative For PY 2013: Title 20 Standards Development. Computers: Technical Report - Supplemental Analysis and Test Results, January 21, 2014.

<sup>1248</sup> Analysis of current DT I2 Category Desktops in the ENERGY STAR version 8.0 Qualified Products List (QPL) as accessed on 5/6/2020 (see File "ENERGY STAR\_Computers\_Analysis\_2020.xlsx", Sheet "DT I2 Stats").

<sup>1249</sup> Analysis of current DT I2 Category Desktops in the ENERGY STAR version 8.0 Qualified Products List (QPL), passing with > 20% margin, as accessed on 5/6/2020 (see File "ENERGY STAR\_Computers\_Analysis\_2020.xlsx", Sheet "DT I2 Stats").

<sup>1250</sup> 80 PLUS program savings calculator, additional 7% reduction in idle power levels over ENERGY STAR version 7.0 computers with 80 PLUS Silver PSU levels. The program calculator was used to establish relative and comparable savings, and as a result, absolute idle power values do not match. For more details on the derivation of the 6.7% savings factor, please see, "80 PLUS Desktop Savings\_25Aug2014\_Revised ESv8.xlsx", 'Analysis Summary' tab.

<sup>1251</sup> 80 PLUS program savings calculator, additional 9.1% reduction in idle power levels over ENERGY STAR version 7.0 computers with 80 PLUS Silver PSU levels. The program calculator was used to establish relative and comparable savings, and as a result, absolute idle power values do not match. For more details on the derivation of the 8.7% savings factor, please see, "80 PLUS Desktop Savings\_25Aug2014\_Revised ESv8.xlsx", 'Analysis Summary' tab.

Measure TEC by Mode - Commercial	Off	Sleep	Long Idle	Short Idle	TEC (kWh/yr)	Savings (kWh/yr)
ES 8.0 Desktops w/ 80 PLUS Platinum PSUs	0.7	5.9	12.2	48.1	66.9	39.1
ES 8.0 Desktops w/ 80 PLUS Titanium PSUs	0.7	5.9	12.0	47.1	65.6	40.3

Savings calculations can be referenced in "ENERGY STAR Computers Analysis\_2020\_Revised.xlsx"

**SUMMER COINCIDENT PEAK DEMAND SAVINGS<sup>1252</sup>**

$$\Delta kW = (Watts_{Base} - Watts_{Eff}) / 1000 * CF$$

Where:

Watts<sub>Base</sub> = Assumed average baseline wattage during peak period (see table below)

Watts<sub>Eff</sub> = Assumed average efficient wattage during peak period (see table below)

CF = Summer Peak Coincidence Factor

= 1.0

Calculated average demand during peak period, and savings provided below:

Measure Demand Reduction by Mode	TEC (Watts)	Long Idle Demand Savings (kW)	Short Idle Demand Savings (kW)	Weighted Average Demand Savings (kW)
Baseline	14.1	N/A	N/A	N/A
ES 8.0 Desktops	9.5	0.0115	0.0083	<b>0.0091</b>
ES 8.0 +20% Desktops	9.3	0.0120	0.0087	<b>0.0095</b>
ES 8.0 Desktops w/ 80 PLUS Platinum PSUs	8.9	0.0125	0.0096	<b>0.0103</b>
ES 8.0 Desktops w/ 80 PLUS Titanium PSUs	8.7	0.0128	0.0100	<b>0.0107</b>

Please note, the last column is a weighted average of the Long & Short Idle Modes and should be the value used in calculations. All Savings calculations can be referenced in "ENERGY STAR Computers Analysis\_2020\_Revised.xlsx"

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1252</sup> It assumed that computers will not be off during peak period, and that the weighting of sleep, long idle and short idle during peak hours is consistent with the whole year. Wattage assumptions are weighted accordingly and coincidence factor is thus assumed to be 1.0 – see "ENERGY STAR Computers Analysis\_2020\_Revised.xlsx" for calculation.

**MEASURE CODE: CI-MSC-COMP-V03-210101**

**REVIEW DEADLINE: 1/1/2025**

## 4.8.7 Advanced Power Strip – Tier 1 Commercial

### DESCRIPTION

This measure relates to Advanced Power Strips – Tier 1 which are multi-plug power strips with the ability to automatically disconnect specific connected loads depending upon the power draw of a control load, also plugged into the strip. Power is disconnected from the switched (controlled) outlets when the control load power draw is reduced below a certain adjustable threshold, thus turning off the appliances plugged into the switched outlets. By disconnecting, the standby load of the controlled devices, the overall load of a centralized group of equipment (e.g. a desk workstation) can be reduced. In a commercial office space, savings generally occur during off-hours, when connected equipment continues to consume electricity while in standby mode or when off. Uncontrolled outlets are also provided that are not affected by the control device and so are always providing power to any device plugged into it.

This measure was developed to be applicable to the following program types: DI.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is an advanced power strip with a load-sensing master plug and at least two controlled plugs.

### DEFINITION OF BASELINE EQUIPMENT

The assumed baseline is a standard power strip with surge protection that does not control connected loads.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the advanced power strip is 7 years.<sup>1253</sup>

### DEEMED MEASURE COST

For direct install the actual full equipment and installation cost (including labor) and for kits the actual full equipment cost should be used.

### LOADSHAPE

Loadshape C47 – Standby Losses – Commercial Office<sup>1254</sup>

### COINCIDENCE FACTOR

N/A due to no savings attributable to standby losses between 1 and 5 PM.

---

<sup>1253</sup> This is a consistent assumption with 5.2.2 Advanced Power Strip – Tier 2.

<sup>1254</sup> Loadshapes were calculated from empirical studies and compared to the existing loadshape in Volume 1, Table 3.5. The studies were:

Acker, Brad *et al*, "Office Space Plug Load Profiles and Energy Saving Interventions," 2012 ACEEE Summer Study on Energy Efficiency in Buildings.

Sheppy, M. *et al*, "Reducing Plug Loads in Office Spaces" Hawaii and Guam Energy Improvement Technology Demonstration Project, NREL/NAVFAC (January 2014).

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh^{1255} = \frac{((kW_{wkday} * (hrs_{wkday} - hrs_{wkday-open})) + (kW_{wkend} * (hrs_{wkend} - hrs_{wkend-open}))) * weeks/year * ISR}{ISR}$$

Where:

- $kW_{wkday}$  = Standby power consumption of connected electronics on weekday off-hours. If unknown, assume 0.0315 kW.
- $kW_{wkend}$  = Standby power consumption of connected electronics on weekend off-hours. If unknown, assume 0.00617 kW.
- $hrs_{wkday}$  = total hours during the work week (Monday 7:30 AM to Friday 5:30 PM)  
= 106
- $hrs_{wkend}$  = total hours during the weekend (Friday 5:30 PM to Monday 7:30 AM)  
= 62
- $hrs_{wkday-open}$  = hours the office is open during the work week. If unknown, assume 50 hours.
- $hrs_{wkend-open}$  = hours the office is open during the weekend. If unknown, assume 0 hours.
- $weeks/year$  = number of weeks per year  
= 52.2
- $ISR$  = In Service Rate  
= Assume 0.969 for commercial Direct Install application<sup>1256</sup>

**For example**, an office open 9 hours per day (45 hours per week) on weekdays and 4 hours on Saturday:

$$\begin{aligned} \Delta kWh &= ((0.0315 * (106 - 45)) + (0.00617 * (62 - 4))) * 52.2 * 0.969 \\ &= 115 kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A due to no savings attributable to standby losses between 1 and 5 PM.

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>1255</sup> Savings algorithm reconstructed from weekday and weekend savings information in Acker, Brad *et. al*, "Office Space Plug Load Profiles and Energy Saving Interventions," 2012 ACEEE Summer Study on Energy Efficiency in Buildings, and verified against savings in Acker *et. al* and savings in: BPA, "Smart Power Strip Energy Savings Evaluation: Ross Complex," (2011). Office stations are assumed to have zero or minimal standby losses during normal operating hours. Method shown in "Commercial Tier 1 APS Calculations – IL TRM.xlsx".

<sup>1256</sup> Based upon review of the PY2 and PY3 ComEd Direct Install Residential program surveys. This value could be modified based upon commercial application evaluation.



**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-APSC-V03-200101**

**REVIEW DEADLINE: 1/1/2024**

### 4.8.8 High Efficiency Transformer

**DESCRIPTION**

Distribution transformers are used in commercial and industrial applications to step down power from distribution voltage to be used in HVAC or process loads (220V or 480V) or to serve plug loads (120V).

Distribution transformers that are more efficient than the required minimum federal standard efficiency qualify for this measure. If there is no specific standard efficiency requirement, the transformer does not qualify (because we cannot define a reasonable baseline). For example, although the federal standards increased the minimum required efficiency in 2016, most transformers with a NEMA premium or CEE Tier 2 rating will still achieve energy conservation. Standards are defined for low-voltage dry-type distribution transformers (up to 333kVA single-phase and 1000kVA 3-phase), liquid-immersed distribution transformers (up to 833kVA single-phase and 2500kVA 3-phase), and medium-voltage dry-type distribution transformers (up to 833kVA single-phase and 2500kVA 3-phase).

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

Any transformer that is more efficient than the federal minimum standard. This includes CEE Tier II (single or three phase) and most NEMA premium efficiency rated products.

**DEFINITION OF BASELINE EQUIPMENT**

A transformer that meets the minimum federal efficiency requirement should be used as the baseline to calculate savings. Standards are developed by the Department of Energy and published in the Federal Register 10CFR 431.<sup>1257</sup>

**(a) Low-Voltage Dry-Type Distribution Transformers.**

(2) The efficiency of a low-voltage dry-type distribution transformer manufactured on or after January 1, 2016, shall be no less than that required for their kVA rating in the table below. Low-voltage dry-type distribution transformers with kVA ratings not appearing in the table shall have their minimum efficiency level determined by linear interpolation of the kVA and efficiency values immediately above and below that kVA rating.

Single-phase		Three-phase	
kVA	Efficiency (%)	kVA	Efficiency (%)
15	97.70	15	97.89
25	98.00	30	98.23
37.5	98.20	45	98.40
50	98.30	75	98.60
75	98.50	112.5	98.74
100	98.60	150	98.83
167	98.70	225	98.94
250	98.80	300	99.02
333	98.90	500	99.14
		750	99.23
		1000	99.28

**(b) Liquid-Immersed Distribution Transformers.**

<sup>1257</sup> US Department of Energy, “Energy Conservation Program: Energy Conservation Standards for Distribution Transformers; Final Rule”, 10 CFR Part 431, Published April 18, 2013, Compliance effective as of January 1, 2016.

(2) The efficiency of a liquid-immersed distribution transformer manufactured on or after January 1, 2016, shall be no less than that required for their kVA rating in the table below. Liquid-immersed distribution transformers with kVA ratings not appearing in the table shall have their minimum efficiency level determined by linear interpolation of the kVA and efficiency values immediately above and below that kVA rating.

Single-phase		Three-phase	
kVA	Efficiency (%)	kVA	Efficiency (%)
10	98.70	15	98.65
15	98.82	30	98.83
25	98.95	45	98.92
37.5	99.05	75	99.03
50	99.11	112.5	99.11
75	99.19	150	99.16
100	99.25	225	99.23
167	99.33	300	99.27
250	99.39	500	99.35
333	99.43	750	99.40
500	99.49	1000	99.43
667	99.52	1500	99.48
833	99.55	2000	99.51
		2500	99.53

**(c) Medium-Voltage Dry-Type Distribution Transformers.**

(2) The efficiency of a medium- voltage dry-type distribution transformer manufactured on or after January 1, 2016, shall be no less than that required for their kVA and BIL rating in the table below. Medium-voltage dry-type distribution transformers with kVA ratings not appearing in the table shall have their minimum efficiency level determined by linear interpolation of the kVA and efficiency values immediately above and below that kVA rating.

1				Three-phase			
kVA	BIL*			kVA	BIL		
	20-45 kV	46-95 kV	≥96 kV		20-45 kV	46-95 kV	≥96 kV
	Efficiency (%)	Efficiency (%)	Efficiency (%)		Efficiency (%)	Efficiency (%)	Efficiency (%)
15	98.10	97.86		15	97.50	97.18	
25	98.33	98.12		30	97.90	97.63	
37.5	98.49	98.30		45	98.10	97.86	
50	98.60	98.42		75	98.33	98.13	
75	98.73	98.57	98.53	112.5	98.52	98.36	
100	98.82	98.67	98.63	150	98.65	98.51	
167	98.96	98.83	98.80	225	98.82	98.69	98.57
250	99.07	98.95	98.91	300	98.93	98.81	98.69
333	99.14	99.03	98.99	500	99.09	98.99	98.89
500	99.22	99.12	99.09	750	99.21	99.12	99.02
667	99.27	99.18	99.15	1000	99.28	99.20	99.11
833	99.31	99.23	99.20	1500	99.37	99.30	99.21
				2000	99.43	99.36	99.28
				2500	99.47	99.41	99.33

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

30 years<sup>1258</sup>

**DEEMED MEASURE COST**

Actual incremental costs should be used.

**LOADSHAPE**

Use custom loadshape based on application; default loadshape is Loadshape C67 (Ameren) or C68 (ComEd), which represent overall utility system loads.

**COINCIDENCE FACTOR**

Coincidence Factor for distribution transformers is 1.0 by definition. By including the load factor in the demand savings calculation, the load profile is accounted for.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

Savings are determined by metering equipment

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = Losses_{base} - Losses_{EE}$$

Where:

$$Losses_{base} = PowerRating * LF * PF * \left( \frac{1}{EFF_{base}} - 1 \right) * 8766$$

$$Losses_{EE} = PowerRating * LF * PF * \left( \frac{1}{EFF_{EE}} - 1 \right) * 8766$$

PowerRating = kVA rating of the transformer (in units of kVA)

EFF<sub>base</sub> = baseline total efficiency rating of federal minimum standard transformer (refer to baseline tables above based on kVA, voltage, and type of transformer)

EFF<sub>EE</sub> = actual total efficiency rating of the transformer as calculated by the appropriate DOE test method.<sup>1259</sup>

LF = Load Factor for the transformer. Ratio of average transformer load to peak load rating over a period of one year. Use actual load factor for the network segment served based on historical data. If unknown, use 22% for commercial load and 45% for industrial load.<sup>1260</sup>

PF = Power Factor for the load being served by the transformer. Ratio of real power to apparent power supplied to the transformer. Use actual power factor for the network segment served. If unknown, use 1.0 (unity) by default.<sup>1261</sup>

---

<sup>1258</sup> US DOE lists lifetime at 32 years. For consistency with efficiency measure evaluated lifetimes, 30 years is the recommended maximum deemed lifetime. US Department of Energy, “Energy Conservation Program: Energy Conservation Standards for Distribution Transformers; Final Rule”, 10 CFR Part 431, Published April 18, 2013, Effective as of January 1, 2016.

<sup>1259</sup> Energy Conservation Program: Test Procedures for Distribution Transformers; Final Rule. Effective May 30, 2006.

<sup>1260</sup> Guidelines on The Calculation and Use of Loss Factors, Electric Authority, Te Mana Hiko, February 14, 2013.

<sup>1261</sup> Unity power factor for used as default value, as used in the test procedures provided by US DOE. Energy Conservation Program: Test Procedures for Distribution Transformers; Final Rule. Effective May 30, 2006.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{PowerRating} * \text{LF} * \text{PF} * \left( \frac{1}{\text{Eff}_{base}} - \frac{1}{\text{Eff}_{EE}} \right)$$

Variables as provided above.

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-TRNS-V02-210101**

**REVIEW DEADLINE: 1/1/2022**

## 4.8.9 High Frequency Battery Chargers

### DESCRIPTION

This measure applies to industrial high frequency battery chargers, used for industrial equipment such as fork lifts, replacing existing SCR (silicon controlled rectifier) or ferroresonant charging technology. High frequency battery chargers have a greater system efficiency.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

High frequency battery charger systems with minimum Power Conversion Efficiency of 90% and a minimum 8-hour shift operation five days per week.

### DEFINITION OF BASELINE EQUIPMENT

SCR or ferroresonant battery charger systems with minimum 8-hour shift operation five days per week.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

15 years<sup>1262</sup>

### DEEMED MEASURE COST

The deemed incremental measure cost is \$400.<sup>1263</sup>

### LOADSHAPE

Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)

Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)

Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)

Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)

### COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.0 for 1 and 2-shift operation and 1.0 for 3 and 4-shift operation.<sup>1264</sup>

---

### Algorithm

---

### ELECTRIC ENERGY SAVINGS

$$\Delta \text{kWh} = (\text{CAP} * \text{DOD}) * \text{CHG} * (\text{CR}_B / \text{PC}_B - \text{CR}_{EE} / \text{PC}_{EE})$$

Where:

CAP = Capacity of Battery

= Use actual battery capacity, otherwise use a default value of 35 kWh<sup>1265</sup>

DOD = Depth of Discharge

---

<sup>1262</sup> Suzanne Foster Porter et al., "Analysis of Standards Options for Battery Charger Systems", (PG&E, 2010), 45.

<sup>1263</sup> Suzanne Foster Porter et al., "Analysis of Standards Options for Battery Charger Systems", (PG&E, 2010), 42.

<sup>1264</sup> Emerging Technologies Program Application Assessment Report #0808, Industrial Battery Charger Energy Savings Opportunities, Pacific Gas & Electric. May 29, 2009.

<sup>1265</sup> Jacob V. Renquist, Brian Dickman, and Thomas H. Bradley, "Economic Comparison of fuel cell powered forklifts to battery powered forklifts", International Journal of Hydrogen Energy Volume 37, Issue 17, (2012): 2.

= Use actual depth of discharge, otherwise use a default value of 80%.<sup>1266</sup>

CHG = Number of Charges per year

= Use actual number of annual charges, if unknown use values below based on the type of operations<sup>1267</sup>

Standard Operations	Number of Charges per year
1-shift (8 hrs/day – 5 days/week)	520
2-shift (16 hrs/day – 5 days/week)	1040
3-shift (24 hrs/day – 5 days/week)	1560
4-shift (24 hrs/day – 7 days/week)	2184

CR<sub>B</sub> = Baseline Charge Return Factor

= 1.2485<sup>1268</sup>

PC<sub>B</sub> = Baseline Power Conversion Efficiency

= 0.84<sup>1269</sup>

CR<sub>EE</sub> = Efficient Charge Return Factor

= 1.107<sup>1270</sup>

PC<sub>EE</sub> = Efficient Power Conversion Efficiency

= 0.89<sup>1271</sup>

Default savings using defaults provided above are provided below:

Standard Operations	ΔkWh
1-shift (8 hrs/day – 5 days/week)	3,531
2-shift (16 hrs/day – 5 days/week)	7,061
3-shift (24 hrs/day – 5 days/week)	10,592
4-shift (24 hrs/day – 7 days/week)	14,829

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (PF_B/PC_B - PF_{EE}/PC_{EE}) * Volts_{DC} * Amps_{DC} / 1000 * CF$$

Where:

PF<sub>B</sub> = Power factor of baseline charger

= 0.9095<sup>1272</sup>

<sup>1266</sup> Ryan Matley, “Measuring Energy Efficiency Improvements in Industrial Battery Chargers”, (ESL-IE-09-05-32, Energy Technology Conference, New Orleans, LA, May 12-15, 2009), 4.

<sup>1267</sup> Number of charges is derived from the following reference and adjusted to the hours and days of the different types of shift operations. These values are based on an estimated 2-charge per 8-hour workday. See reference file Ryan Matley, “Measuring Energy Efficiency Improvements in Industrial Battery Chargers”, (ESL-IE-09-05-32, Energy Technology Conference, New Orleans, LA, May 12-15, 2009), 4.

<sup>1268</sup> Ryan Matley, “Measuring Energy Efficiency Improvements in Industrial Battery Chargers”, (ESL-IE-09-05-32, Energy Technology Conference, New Orleans, LA, May 12-15, 2009), 4 (average of SCR and Ferroresonant).

<sup>1269</sup> Ibid.

<sup>1270</sup> Ibid.

<sup>1271</sup> Ibid.

<sup>1272</sup> Ibid.

PF<sub>EE</sub> = Power factor of high frequency charger  
 = 0.9370<sup>1273</sup>

Volts<sub>DC</sub> = Actual DC rated voltage of charger (assumed baseline charger is replaced with same rated high frequency unit)  
 = Use actual battery DC voltage rating, otherwise use a default value of 48 volts.<sup>1274</sup>

Amps<sub>DC</sub> = Actual DC rated amperage of charger (assumed baseline charger is replaced with same rated high frequency unit)  
 = Use actual battery DC ampere rating, otherwise use a default value of 81 amps.<sup>1275</sup>

1,000 = watt to kilowatt conversion factor

CF = Summer Coincident Peak Factor for this measure  
 = 0.0 (for 1 and 2-shift operation)<sup>1276</sup>  
 = 1.0 (for 3 and 4-shift operation)<sup>1277</sup>

Other variables as provided above.

Default savings using defaults provided above are provided below:

Standard Operations	ΔkW
1-shift (8 hrs/day – 5 days/week)	0
2-shift (16 hrs/day – 5 days/week)	0
3-shift (24 hrs/day – 5 days/week)	0.1165
4-shift (24 hrs/day – 7 days/week)	0.1165

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-BACH-V02-210101**

**REVIEW DEADLINE: 1/1/2025**

<sup>1273</sup> Ibid.

<sup>1274</sup> Voltage rating based on the assumption of 35kWh battery with a normalized average amp-hour capacity of 760 Ah charged over a 7.5 hour charge cycle. Pacific Gas & Electric, “Emerging Technologies Program Application Assessment Report #0808”, Industrial Battery Charger Energy Savings Opportunities. May 29, 2009. Page 8, Table 3.

<sup>1275</sup> Ampere rating based on the assumption of 35kWh battery with a normalized average amp-hour capacity of 760 Ah charged over a 7.5 hour charge cycle. Pacific Gas & Electric, “Emerging Technologies Program Application Assessment Report #0808”, Industrial Battery Charger Energy Savings Opportunities. May 29, 2009. Page 8, Table 3.

<sup>1276</sup> Emerging Technologies Program Application Assessment Report #0808, Industrial Battery Charger Energy Savings Opportunities, Pacific Gas & Electric. May 29, 2009.

<sup>1277</sup> Ibid.



## 4.8.10 Commercial Clothes Dryer Moisture Sensor

### DESCRIPTION

This measure applies to moisture sensing controllers installed on new or existing commercial natural gas clothes dryers controlled electronically. Moisture controllers detect when the load is dry, which will stop the cycle from consuming additional energy. Some new commercial dryers utilize moisture sensors, but the majority of older dryers, as well as many new models, still do not utilize moisture sensors. In a commercial dryer, when a load is drying, the heat will run completely on in the early stages. Then, it begins to cycle on and off more frequently as the load becomes drier. Traditional moisture sensors use a conductivity strip in the dryer drum. The wet load will contact the strip that completes the circuit. When the load is dry, the circuit is shorted that completes the drying cycle. Instead, this technology is a “plug and play” retrofit controller that uses patent-pending software to determine when the load is dry. When the load is dry, it overrides the existing controls to end the cycle, which shuts the drying cycle. This measure does not apply to mechanical timer dryers or to dryers with modulating valves installed.

Natural gas energy savings will be achieved by reduced drying times and correspondingly reduced natural gas consumption. Electric savings will also be achieved by reduced operating times.

This measure was developed to be applicable to following facility types:

- Hotel/Motel
- Miscellaneous - Fitness and Recreational Sports Centers
- Hospital
- Assisted Living Facilities
- Miscellaneous - Dry cleaning
- Multifamily

Moisture sensing controller retrofits could create significant energy savings opportunities at other larger facility types with on-premise laundry operations (such as correctional facilities, universities, and staff laundries); however, the results included in this analysis are based heavily on past project data for the applicable facility types listed above and may not apply to facilities outside of this list due to variances in number of loads and average pound (lbs.) capacity per project site. Projects at these facilities should continue to be evaluated through custom programs and the applicable facility types and the resulting analysis should be updated based on new information.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

A retrofit moisture controlling technology is added to new or existing commercial natural gas clothes dryers. Existing facilities must be able to confirm that they do not have moisture sensors (conductive strip type) or modulating gas valves installed on clothes dryers already before proceeding with the installation of this technology.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a conventional natural gas clothes dryer without a moisture sensor or a modulating gas valve installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The equipment effective useful life (EUL) is 14 years based on manufacturer claims, assumed to be equal to that of a commercial dryer.<sup>1278</sup>

---

<sup>1278</sup> Zhang, Yanda, and Julianna Wei. *Commercial Clothes Dryers, CASE Initiative for PY2013: Title 20 Standards Development*. California Public Utilities Commission, 2013.

**DEEMED MEASURE COST**

The full retrofit cost is assumed to be \$600, including the material cost for the basic moisture control retrofit (\$500) and the associated labor for installation (\$100).<sup>1279</sup>

**LOADSHAPE**

Loadshape C55; Commercial Clothes Washer

**COINCIDENCE FACTOR**

The coincidence factor for this measure is dependent on the application:

Application	Coincidence Factor <sup>1280</sup>
Multi-family Dryers	0.15
On-Premise Laundromats	0.52

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Electric energy savings are per retrofitted dryer.

$$\Delta kWh = N_{Cycles} * SF$$

Where:

$N_{Cycles}$  = Number of dryer cycles per year. Refer to the table below if this value is not directly available from the facility.

Application	Cycles per Dryer Per Year
Multi-family Dryers <sup>1281</sup>	1,074
On-Premise Laundromats <sup>1282</sup>	3,607

SF = Savings factor  
 = 0.16 kWh/cycle<sup>1283</sup>

If using default cycles the savings are as follows:

Application	$\Delta kWh$ per Dryer
Multi-family Dryers	171.8
On-Premise Laundromats	577.1

<sup>1279</sup> Based on Gas Technology Institute’s analysis of cost data from “Nicor Gas Emerging Technology Program, 1069: Moisture Sensor Retrofit, Comprehensive Pilot Assessment Report,” May 1, 2017.

<sup>1280</sup> In the absence of loadshape information for commercial applications, this is estimated by adjusting the residential coincidence factor proportionately by the relative number of loads (264 for residential and as described in this measure for commercial applications).

<sup>1281</sup> From DOE’s Federal Register Notices - found here: <http://energy.gov/eere/buildings/recent-federal-register-notice>

<sup>1282</sup> Average value for dryer cycles in healthcare facility, hotels, drycleaners and laundromats from tests conducted in Nicor Gas Emerging Technology Program’s Commercial Dryer Modulation Retrofit Public Project Report.

<sup>1283</sup> Savings factor based on engineering analysis of savings data from “Nicor Gas Emerging Technology Program, 1069: Moisture Sensor Retrofit, Comprehensive Pilot Assessment Report,” May 1, 2017 and “Advanced Commercial Clothes Dryer Technologies Field Test,” prepared by Gas Technology Institute for the Minnesota Department of Commerce, January 15, 2018.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

Hours = Assumed Run hours of Clothes Dryer<sup>1284</sup>

Application	Hours
Multi-family Dryers	806
On-Premise Laundromats	2,705

CF = Summer Peak Coincidence Factor for measure.

Application	Coincidence Factor <sup>1285</sup>
Multi-family Dryers	0.15
On-Premise Laundromats	0.52

If using default cycles the savings are as follows:

Application	ΔkW per Dryer
Multi-family Dryers	0.0320
On-Premise Laundromats	0.1109

**NATURAL GAS SAVINGS**

Natural gas savings are per retrofitted dryer.

$$\Delta \text{Therms} = N_{\text{Cycles}} * SF$$

Where:

SF = Savings factor  
 = 0.15 therms/cycle<sup>1286</sup>

If using default cycles the savings are as follows:

Application	ΔTherms per Dryer
Multi-family Dryers	161
On-Premise Laundromats	541

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1284</sup> Estimate based on 45 minutes per cycle.

<sup>1285</sup> In the absence of loadshape information for commercial applications, this is estimated by adjusting the residential coincidence factor proportionately by the relative number of loads (264 for residential and as described in this measure for commercial applications).

<sup>1286</sup> Savings factor based on engineering analysis of savings data from “Nicor Gas Emerging Technology Program, 1069: Moisture Sensor Retrofit, Comprehensive Pilot Assessment Report,” May 1, 2017 and “Advanced Commercial Clothes Dryer Technologies Field Test,” prepared by Gas Technology Institute for the Minnesota Department of Commerce, January 15, 2018.

**MEASURE CODE: CI-MSC-CDMS-V01-190101**

**REVIEW DEADLINE: 1/1/2023**

## 4.8.11 Efficient Thermal Oxidizers

### DESCRIPTION

Thermal Oxidizers are used to destroy volatile organic compounds (VOCs) from process exhausts, before emitting the treated air to the environment. VOC emissions are precursors to the formation of ground-level ozone pollution, and its control is mandated by the U.S. EPA. Some VOC constituents are individually toxic and require efficient destruction. Some waste streams have high enough concentrations to present an explosion hazard. Other waste streams merely present nuisance odors that need to be mitigated.

A facility may be required to utilize a Thermal Oxidizer by a state regulatory agency air quality permit. Some permits may require a VOC destruction efficiency that must be demonstrated with periodic emissions testing. Other permits merely require maintaining an oxidizer chamber temperature. A facility may also choose to utilize a Thermal Oxidizer for other purposes (nuisance odors), without a regulatory requirement.

The Efficient Thermal Oxidizer measure seeks to evaluate natural gas savings from utilizing more efficient means for VOC destruction with the use of a recuperative or regenerative thermal oxidizer. The heat recovery (either Recuperative or Regenerative) is used to pre-heat the inlet process air stream. This primary heat recovery is used within the thermal oxidizer process and the only heat recovery that is covered in this measure protocol. Natural gas savings will result from reduced burner firing. There is a “secondary” form of heat recovery that recovers heat from the combustion exhaust stack for other purposes like space heating, DHW heating, etc.

### DEFINITION OF EFFICIENT EQUIPMENT

Two Thermal Oxidizer technologies can be considered as efficient equipment: Recuperative and Regenerative.

#### Recuperative Thermal Oxidizer

In a Recuperative Thermal Oxidizer, the exhaust air stream is sent through a heat exchanger to indirectly pre-heat the inlet air stream coming from the process. The heat exchanger efficiency for a recuperator is typically 50-70%.<sup>1287</sup> The chamber temperature is typically 1400 °F to 1500 °F.

#### Regenerative Thermal Oxidizer

A Regenerative Thermal Oxidizer utilizes a two-chamber ceramic bed as its heat exchanger system. The exhaust air passes through one bed, imparting its heat onto the ceramic media, while the intake air passes through the other bed, capturing the waste heat from the previous cycle. The flow reverses every few minutes so that the intake bed becomes the exhausted bed and vice versa. The heat exchanger efficiency of a regenerative system is much higher than a recuperative system. These efficiencies can reach 85% to 97%.<sup>1288</sup> However, the ceramic media needs to be periodically cleaned or replaced. The chamber temperatures in Regenerative Thermal Oxidizers are typically 1,500 °F to 1,600 °F (depending on VOC requirements).

### DEFINITION OF BASELINE EQUIPMENT

Depending on the facility process, there may be two baseline selection options: incinerator or recuperator.

The baseline Thermal Oxidizer with no heat recovery is referred to as an Incinerator. This baseline is recommended for selection if it currently exists on site or in new construction when there is a specific process that cannot practically utilize a recuperator due to VOCs coating or clogging the heat exchanger. This system employs a burner to provide direct fire to a process exhaust air stream. Typical operative temperatures are 1400 °F to 2200 °F. The advantage of an afterburner is a quick startup and shutdown time that is ready on demand. The equipment cost is lower than the efficient equipment, but the fuel consumption is much higher.

---

<sup>1287</sup> Presentation on the “Operating Cost Reduction Strategies for Oxidizers”, presented by Rich Grzanka, during the Chem Show Technology Exposition on October 31, 2007.

<sup>1288</sup> Ibid.

In all other cases, (existing equipment is recuperative or new construction/ expansion of manufacturing process), a recuperative thermal oxidizer is recommended as the appropriate baseline.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected useful life of any thermal oxidizer system is assumed to 20 years.<sup>1289</sup>

**DEEMED MEASURE COST**

The cost of any thermal oxidizer is dependent on various variables such as air flow capacity, destruction efficiency, heat exchanger efficiency, etc.<sup>1290</sup> Shown below is an example of a system for 20,000 CFM.

Recuperative Thermal Oxidizer costs, based on their heat recovery efficiency, is detailed in the table below.

Heat Recovery Efficiency	Equipment Cost
0%	\$106,042
35%	\$174,193
50%	\$203,801
70%	\$253,801
Average	\$184,317

Regenerative Thermal Oxidizer, at 95% heat recovery, have a deemed cost of \$546,000.

Incinerator cost is treated as 0% heat recovery in the Recuperative Cost summary table above, and has a deemed cost of \$106,042.

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

Energy savings from thermally efficient equipment are entirely natural gas related. There are no electricity savings nor peak demand savings, as the blower fans and valve actuators are assumed to operate the same in all conditions.

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = ((\text{Baseline QT Air Pollution Control Device} - \text{Proposed QT Air Pollution Control Device}) \times \text{Hours}) / \text{LHV}$$

Where:

---

<sup>1289</sup> EPA Air Pollution Control Cost Manual, Chapter 2, November 2017. The system capital recovery cost is based on an estimated 20-year equipment life. This estimate of oxidizer equipment life is consistent with information available to EPA and is consistent with statements from large vendors for incinerators and oxidizers.

<sup>1290</sup> U.S. Environmental Protection Agency, Incinerators and Oxidizers, Chapter 2, November 2017.

- LHV = Latent Heat of Vaporization
- = If the post is regenerative thermal oxidizer, LHV = 0.953.
- = If the post is recuperative thermal oxidizer, LHV = 1.

Regenerative or Recuperative: A baseline or proposed Regenerative or Recuperative Air Pollution Control Device can each be modeled in the following heat balance equation:<sup>1291</sup>

$$QT \text{ (BTU/hr)} = QI + QCC + QRL - QVOC$$

Incinerator: A baseline incinerator Air Pollution Control Device can be modeled as the following heat balance equation:

$$QT \text{ (BTU/hr)} = QI + QCC + QRL$$

Where:

- QT = Total Energy Input
- QI = Energy used to raise the temperature of process air (FI) in BTU/hr
- QCC = Heat used to raise the temperature of combustion air (FCC)
- QRL = Radiation heat loss from RTO (BTU/hr)
- QVOC = Heat release provided by VOC combustion
- Hours = Annual hours per year that Oxidizer is used

Where:

- $QI = FI \times 1.08 \times (TO - TI)$
- TO = Average stack outlet temperature (°F) (actual trended average or use efficiency equation below to solve for TO under assumed conditions)
- $TO = TC - (N \times (TC - TI) \times FI / (FI + FCC))$
- TC = Combustion chamber temperature (°F), trended or design value provided by the manufacturer
- N = Thermal Efficiency of Heat Exchanger

Thermal Oxidizer	Efficiency
Regenerative	97%
Recuperative	70%
Incinerator	0%

- TI = Inlet air temperature (°F), this is the temperature of the air coming from the process
- FI = Process air (CFM), actual loading or use maximum design value
- 1.08 = Conversion Factor
  - =  $60 \text{ (min/hr)} \times 0.07489 \text{ (lb/ft}^3\text{, density air at standard conditions)} \times 0.2404 \text{ Btu/}^\circ\text{F-lb}$ , (specific heat of air), where 0.2404 is average heat capacity of intake air

Where:

- $QCC = FCC \times 1.08 \times (TO - TA)$
- FCC = Additional combustion air CFM at provided FI value

<sup>1291</sup> ICAC Guidance Method for Estimation of Gas Consumption in a Regenerative Thermal Oxidizer (RTO), July 2002.

= If unknown, assume 3% of design value<sup>1292</sup>

TO = Average outlet temperature (°F) (same as above)

TA = Combustion intake air temperature (°F)

= Indoor: Actual, or assume 70 °F year-round

= Outdoor: Actual annual average found near the facility, or assume TMY3 annual averages:

Region / Area	Average Outdoor Air Temperature
Chicago O'Hare	50.0 °F
Chicago Midway	52.5 °F
Rockford Airport	47.6 °F

Where:

QRL = SA x BTU/hr radiant loss

SA = Surface Area (provided by the manufacturer or rough measurements taken)

BTU/hr radiant loss = Assume 240 BTU/hr if installed outdoors, otherwise, 0 BTU/hr for indoor installation since the waste heat provides space heating and offset gas-fired space heating equipment

Where:

QVOC = VOC X HC X (% Dest / 100)

VOC = Average lbs/hr from process to oxidizer

HC = Btu/lb, weighted average for the heat of combustion of VOCS

= Site-specific, lookup table

% Destruction = Destruction efficiency of VOCs provided by the manufacturer, or use:

Hours = Annual hours of operation of the air pollution control device, assume customer production schedule or hours of occupancy

LHV = Lower heating value of natural gas

= 983 BTU/CF<sup>1293</sup>

HHV = High heating value of natural gas

= 1,031 BTU/CF<sup>1294</sup>

0.953 = LHV / HHV conversion factor

To calculate the natural gas savings by upgrading from an incinerator to an Efficient Thermal Oxidizer system, the new temperatures must be considered. The addition of heat recovery (either Recuperative or Regenerative) will increase the inlet temperature, TI, above that found in the facility.

The calculation should consider changes in the inlet temperature. First, the key temperature required for 99.99% destruction efficiency of various VOC compounds must be determined. The U.S. EPA's Innovative Strategies and Economics Group produced some guidance on the key temperatures<sup>1295</sup> for the following compounds:

<sup>1292</sup> Ibid.

<sup>1293</sup> Biomass Energy Data Book, 2011, Appendix A: Lower and Higher Heating Values of Gas, Liquid, and Solid Fuels.

<sup>1294</sup> Heat content of natural gas delivered to consumers per the Energy Information Administration, Independent Statistics & Analysis, 2018.

<sup>1295</sup> U.S. Environmental Protection Agency, Incinerators and Oxidizers, Chapter 2, November 2017.



VOC Compound	Key Destruction Temperature (°F)
Acrylonitrile	1,344
Allyl chloride	1,276
Benzene	1,350
Chlorobenzene	1,407
1,2 – dichloromethane	1,368
Methyl chloride	1,596
Toluene	1,341
Vinyl chloride	1,369

For VOC compounds not listed above, the Key Destruction Temperature should be determined through product literature, equipment vendors, Material Data Safety Sheets (MSDS), or some other source.

When employing heat recovery, either Recuperative or Regenerative, the increased outlet temperature is limited to the heat exchanger efficiency. This efficiency, or in other words how much heat can be recovered, is limited to the auto-ignition temperatures of the VOCs in the air stream. Regenerative Thermal Oxidizers offer the advantage of recovering more heat as the combustion can occur within the heat exchanger, whereas with Recuperative Thermal Oxidizers, the heat exchanger efficiency is much lower to prevent premature combustion in the stack of the recuperator.

While the VOCs in the waste air stream have some heating value that contributes to reaching the required chamber temperature, such contributions do not have as high of an impact in the overall energy consumption calculation when compared to the heat exchanger efficiency.

#### **WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

Thermal oxidizer operations will have no impact on water or other resources. There may be some safety issues with potential burning hazards from deploying this equipment at high temperatures. There may also be some potential issues with installing outdoor natural gas piping to the location of the Thermal Oxidizers. In terms of physical sizing, regenerative thermal oxidizers are much larger, thus requiring larger physical space at the site of installation.

#### **DEEMED O&M COST ADJUSTMENT CALCULATION**

The ceramic media in the regenerative thermal oxidizer requires regular servicing and may need to be considered as a regular part of facility O&M.

**MEASURE CODE: CI-MS-ETOX-V01-190101**

**REVIEW DEADLINE: 1/1/2023**

## 4.8.12 Spring-Loaded Garage Door Hinge

### DESCRIPTION

Existing overhead doors often close loosely at the perimeter weather strips and between panels. Conditioned air escapes through these gaps, leading to energy loss. Spring-loaded hinges create tension and reduce gaps at the perimeter and between panels. The product is applicable for small-commercial and residential sectors, but the savings estimated by this measure apply only to small-commercial applications. This measure applies to sites where the inside area of the garage is conditioned during the heating season by natural gas.

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified as a custom measure.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment consists of a heavy-duty spring-loaded hinge installed in place of a standard hinge on a garage overhead door. The number of hinges per project may vary depending on the door type, size, and number of panels. The efficient condition is an air sealed garage door with no gaps around the perimeter or between panels.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a garage door with a 1/8-inch gap between the door and the weather-stripping around the perimeter of the door. The bottom of the door is assumed sealed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>1296</sup>

### DEEMED MEASURE COST

Incremental costs equal installed cost and will vary based on the number of hinges required per door. Based on information provided by the manufacturer to Nicor Gas, average material cost is \$126 per garage door and installation cost is \$63 per garage door for a total installed cost of \$189 per garage door. The typical garage door is assumed to have 4 panels and 9 total hinges.

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---



---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

Savings are calculated based on a reduction in airflow rate associated with decreased infiltration across the leakage area. The algorithm below for change in cubic feet per minute,  $\Delta CFM$ , is modeled after equation 48 in Chapter 16: Ventilation and infiltration of the 2017 ASHRAE Handbook—Fundamentals.

### ELECTRIC ENERGY SAVINGS

N/A

---

<sup>1296</sup> Public Service Commission of Wisconsin, "Evaluation – Business Program: Measure Life Study," Focus on Energy (2009): page 1-4, Table 1-2 Recommended Measure Life by WISEerts Group Description for Building Shell Equip or Tech measure type, accessed March 26, 2019, [https://focusonenergy.com/sites/default/files/bpmeasurelifestudyfinal\\_evaluationreport.pdf](https://focusonenergy.com/sites/default/files/bpmeasurelifestudyfinal_evaluationreport.pdf).

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta CFM = A_l * [(C_s * \Delta T) + (C_w * W_s^2)]^{0.5}$$

$$\Delta HeatLoad = \Delta CFM * Conv_{min} * Density_{air} * SpecificHeat_{air} * \Delta T$$

$$\Delta therms_{Hr} = \Delta HeatLoad / Eff_{heat} / Conv_{BTU}$$

$$\Delta therms_{Ann} = \Delta therms_{Hr} * Hours$$

Where:

- $A_l$  = Leakage area, estimated at 51 (in<sup>2</sup>), of air gap before retrofit.<sup>1297</sup>
- $C_s$  = Stack coefficient, 0.0299 (cfm<sup>2</sup>/in<sup>4</sup> \* °F), adjustment based on airflow at average building height.<sup>1298</sup>
- $C_w$  = Wind coefficient, 0.0086 (cfm<sup>2</sup>/in<sup>4</sup> \* mph<sup>2</sup>), adjustment based on airflow at average building height and wind shelter classification.<sup>1299</sup>
- $\Delta T$  = Average temperature difference between outside air temperature (OAT) during the heating season<sup>1300</sup> and assumed indoor heating temperature setpoint 70°F;<sup>1301</sup> see table below.
- $W_s$  = Average wind speed (mph) during heating season, see table below.

Climate Zone	Average OAT, Heating (°F)	Average Delta T, Heating (°F)	Average heating Season Wind Speed (mph) <sup>1302</sup>
1 (Rockford)	32	38	10
2 (Chicago)	34	36	10
3 (Springfield)	35	35	10
4 (Belleville)	36	34	9
5 (Marion)	39	31	7

- $Conv_{min}$  = Conversion from minutes to hours, 60 minutes/hour.
- $Density_{air}$  = The density of air, 0.08 (lb/ft<sup>3</sup>) at 1 atmosphere pressure and approximately 30-40°F.<sup>1303</sup>

<sup>1297</sup> Leakage area is estimated based on average door size of installations previously completed in Wisconsin and reported in the Wisconsin Focus on Energy Technical Reference Manual. Average door size is 10 ft x 12 ft, with a side and top perimeter equal to 1 top \* (10 ft \* 12 in/1 ft) + 2 sides\* (12 ft \* 12 in/1ft) = 408 in. At 1/8 in perimeter gap, the leakage area is 408 in \* 1/8 in = 51 in<sup>2</sup>.

<sup>1298</sup> 2017 ASHRAE Handbook—Fundamentals, 16.24, Table 4 “Basic Model Stack Coefficient  $C_s$ ”, assumed average building height of 16 feet, two-story.

<sup>1299</sup> 2017 ASHRAE Handbook—Fundamentals, 16.24, Table 6 “Basic Model Wind Coefficient  $C_w$ ”, assumed average building height of 16 feet and shelter class 3: “Typical shelter caused by other buildings across street from building under study.”

<sup>1300</sup> DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL, for the average outdoor temperature when the heating system is expected to be operating.

<sup>1301</sup> Energy Center of Wisconsin, “Baseline Building Energy Models – Nonresidential Heating Thermostat Setpoint,” ComEd Portfolio Modeling Report (July 2010): page 6.

<sup>1302</sup> DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL, for the average wind speed when the heating system is expected to be operating, defined as hours where the average temperature is lower than 55°F.

<sup>1303</sup> Engineering ToolBox, (2003). Air - Density, Specific Weight and Thermal Expansion Coefficient at Varying Temperature and Constant Pressures. [online] Available at: [https://www.engineeringtoolbox.com/air-density-specific-weight-d\\_600.html](https://www.engineeringtoolbox.com/air-density-specific-weight-d_600.html) [Accessed March 2019].

$SpecificHeat_{air}$  = Specific heat of air, 0.24 (BTU/lb) at 1 atmosphere pressure and 32°F.<sup>1304</sup>

$Eff_{heat}$  = Efficiency of the heating system, assume 0.78 for planning purposes.<sup>1305</sup>

$Conv_{BTU}$  = Conversion from BTUs to therms, 100,000 BTU/therm.

$EFLH_H$  =Equivalent Full Load Heating Hours in Existing Buildings or New Construction are listed in section 4.4 HVAC End Use, but a subset of the building types most likely to use this measure are repeated here for easy reference.

EFLH Existing Buildings					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	1,481	1,368	1,214	871	973
Garage	958	969	852	680	1,047
High School	1,845	1,857	1,666	1,187	1,388
Manufacturing	1,048	1,013	939	567	634
Office - Low Rise	1,428	1,425	1,132	692	793
Retail - Strip Mall	1,347	1,325	1,183	1,064	1,096
Warehouse	1,285	1,286	1,180	1,147	1,224

EFLH New Construction					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	1,481	1,368	1,214	871	973
Garage	958	969	852	680	1,047
High School	1,807	1,642	2,093	2,292	1,830
Manufacturing	1,048	1,013	939	567	634
Office - Low Rise	947	989	1,090	1,302	1,076
Retail - Strip Mall	722	789	667	834	911
Warehouse	389	522	408	527	567

Savings for all climate zones and selected building types are presented in the following table.

Annual Therm Savings Existing Buildings					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	59.89	51.62	44.19	29.20	26.38
Garage	38.74	36.56	31.01	22.79	28.39
High School	74.61	70.07	60.64	39.79	37.63
Manufacturing	42.38	38.22	34.18	19.01	17.19
Office - Low Rise	57.75	53.77	41.21	23.20	21.50
Retail - Strip Mall	54.47	50.00	43.06	35.67	29.72

<sup>1304</sup> Engineering ToolBox, (2004). Air - Specific Heat at Constant Pressure and Varying Temperature. [online] Available at: [https://www.engineeringtoolbox.com/air-specific-heat-capacity-d\\_705.html](https://www.engineeringtoolbox.com/air-specific-heat-capacity-d_705.html) [Accessed March 2019].

<sup>1305</sup> To maintain consistency across assumptions within the IL TRM, this value is equal to the furnace efficiency value listed in the Roof Insulation for C&I Facilities measure in the 2019 IL TRM v.7.0 Vol. 2, Page 562.

Warehouse	51.97	48.53	42.95	38.45	33.19
-----------	-------	-------	-------	-------	-------

Annual Therm Savings New Construction					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	59.89	51.62	44.19	29.20	26.38
Garage	38.74	36.56	31.01	22.79	28.39
High School	73.08	61.96	76.19	76.83	49.62
Manufacturing	42.38	38.22	34.18	19.01	17.19
Office - Low Rise	38.30	37.32	39.68	43.64	29.17
Retail - Strip Mall	29.20	29.77	24.28	27.96	24.70
Warehouse	15.73	19.70	14.85	17.67	15.37

Savings for all climate zones and selected building types per linear foot are presented in the following table.

Annual Therm Savings per Linear Foot Existing Buildings					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	1.76	1.52	1.30	0.86	0.78
Garage	1.14	1.08	0.91	0.67	0.83
High School	2.19	2.06	1.78	1.17	1.11
Manufacturing	1.25	1.12	1.01	0.56	0.51
Office - Low Rise	1.70	1.58	1.21	0.68	0.63
Retail - Strip Mall	1.60	1.47	1.27	1.05	0.87
Warehouse	1.53	1.43	1.26	1.13	0.98

Annual Therm Savings per Linear Foot New Construction					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	1.76	1.52	1.30	0.86	0.78
Garage	1.14	1.08	0.91	0.67	0.83
High School	2.15	1.82	2.24	2.26	1.46
Manufacturing	1.25	1.12	1.01	0.56	0.51
Office - Low Rise	1.13	1.10	1.17	1.28	0.86
Retail - Strip Mall	0.86	0.88	0.71	0.82	0.73
Warehouse	0.46	0.58	0.44	0.52	0.45

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-SLDH-V01-200101**

**REVIEW DEADLINE: 1/1/2023**

## 4.8.13 Variable Speed Drives for Process Fans

### DESCRIPTION

This measure is applied to variable speed drives (VSD) which are installed on non-HVAC fans for process loads. There are separate measures for HVAC pumps and cooling tower fans (4.4.17) and HVAC supply and return fans (4.4.26). VSD process pump applications require custom analysis by the program administrator. The VSD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The VSD is applied to a motor which does not have a VSD. The application must have a variable load and installation is to include the necessary controls. Savings are based on application of VSDs to a range of baseline load conditions including no control, inlet guide vanes, outlet guide vanes and throttling valves.

### DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VSD or other methods of control. Retrofit baseline is an existing motor operating without a method of variable control. This information shall be collected from the customer.

Installations of new equipment with VSDs which are required by IECC 2012 or 2015 as adopted by the State of Illinois are not eligible for incentives.

Note IECC 2018 became effective July 1, 2019 and is the baseline for all New Construction permits from that date.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 15 years.<sup>1306</sup>

### DEEMED MEASURE COST

The costs vary based on the motor horsepower and application. Actual costs should be used.

### LOADSHAPE

Time-based schedule considerations are required to perform energy savings calculations and should be concurrently used to establish the savings loadshape that is in alignment with relevant loadshape components and definitions.

### COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

---

### Algorithm

---

---

<sup>1306</sup> ComEd Effective Useful Life Research Report (2018)

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$kWh_{Base} = \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times RHRS \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Base})$$

$$kWh_{Retrofit} = \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times RHRS \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Retrofit})$$

$$ESF = \frac{(kWh_{Base} - kWh_{Retrofit})}{kWh_{Base}}$$

$$\Delta kWh_{total} = kWh_{Base} \times ESF$$

Where:

- $kWh_{Base}$  = Baseline annual energy consumption (kWh/yr)
  - $kWh_{Retrofit}$  = Retrofit annual energy consumption (kWh/yr)
  - $ESF$  = Energy savings factor; If ESF is greater than 67%, cap the ESF at 67% for process fan VSD improvements.<sup>1307</sup>
  - $\Delta kWh_{total}$  = Total project annual energy savings
  - 0.746 = Conversion factor for HP to kWh
  - $HP$  = Nominal horsepower of controlled motor
  - $LF$  = Load Factor; Motor Load at Fan Design CFM (Default = 65%)<sup>1308</sup>
  - $\eta_{motor}$  = Installed nominal/nameplate motor efficiency
- Default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor

**NEMA Premium Efficiency Motors Default Efficiencies<sup>1309</sup>**

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917

<sup>1307</sup> Recommendations for Verifying Savings for non-HVAC VFDs memorandum calculated an energy savings limit of 67% for process fans using the Toshiba Energy Savings Software for Motors and Drives (2009 version).

<sup>1308</sup> Lawrence Berkeley National Laboratory, and Resource Dynamics Corporation. (2008). "Improving Motor and Drive System Performance; A Sourcebook for Industry". U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy. Golden, CO: National Renewable Energy Laboratory.

<sup>1309</sup> Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.



Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

*RHRS* = Annual operating hours of process fan. Actual hours should be used.

*%FF* = Percentage of run-time spent within a given flow fraction range.

Fans used in process applications operate under site-specific conditions. The percentage of run-time spent within each of the given ranges in the table below should be field collected.

Flow Fraction (% of design cfm)	Percent of Time at Flow Fraction
0% to 10%	
>10% to 20%	
>20% to 30%	
>30% to 40%	
>40% to 50%	
>50% to 60%	
>60% to 70%	
>70% to 80%	
>80% to 90%	
>90% to 100%	

Field Collected for each bin.

$PLR_{Base}$  = Part load ratio for a given flow fraction range based on the baseline flow control type

$PLR_{Retrofit}$  = Part load ratio for a given flow fraction range based on the retrofit flow control type

Control Type	Flow Fraction									
	0-10%	>10% to 20%	>20% to 30%	>30% to 40%	>40% to 50%	>50% to 60%	>60% to 70%	>70% to 80%	>80% to 90%	>90% to 100%
No Control or Bypass Damper	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Discharge Dampers	0.46	0.55	0.63	0.70	0.77	0.83	0.88	0.93	0.97	1.00
Outlet Damper, BI & Airfoil Fans	0.53	0.53	0.57	0.64	0.72	0.80	0.89	0.96	1.02	1.05
Inlet Damper Box	0.56	0.60	0.62	0.64	0.66	0.69	0.74	0.81	0.92	1.07
Inlet Guide Vane, BI & Airfoil Fans	0.53	0.56	0.57	0.59	0.60	0.62	0.67	0.74	0.85	1.00
Inlet Vane Dampers	0.38	0.40	0.42	0.44	0.48	0.53	0.60	0.70	0.83	0.99
Outlet Damper, FC Fans	0.22	0.26	0.30	0.37	0.45	0.54	0.65	0.77	0.91	1.06
Eddy Current Drives	0.17	0.20	0.25	0.32	0.41	0.51	0.63	0.76	0.90	1.04
Inlet Guide Vane, FC Fans	0.21	0.22	0.23	0.26	0.31	0.39	0.49	0.63	0.81	1.04
VFD with duct static pressure controls	0.09	0.10	0.11	0.15	0.20	0.29	0.41	0.57	0.76	1.01
VFD with low/no duct static pressure	0.05	0.06	0.09	0.12	0.18	0.27	0.39	0.55	0.75	1.00

$\sum_{0\%}^{100\%} (\%FF \times PLR)$  = The sum of the product of the percentage of run-time spent within a given flow fraction range (%FF) and the part load ratio for a given flow fraction range based on the retrofit flow control type.

Example: A process fan with discharge damper controls operates 85% of the time at 75% flow fraction, 5% of the time at 80% flow fraction, and 10% of the time at 95% flow fraction:

$$\sum_{0\%}^{100\%} (\%FF \times PLR) = (0.85 \times 0.93) + (0.05 \times 0.97) + (0.10 \times 1.00) = 0.939\%$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$kW_{Base} = \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times PLR_{Base,FFpeak}$$

$$kW_{Retrofit} = \left( 0.746 \times HP \times \frac{LF}{\eta_{motor}} \right) \times PLR_{Retrofit,FFpeak}$$

$$\Delta kW_{fan} = kW_{Base} - kW_{Retrofit}$$

Where:

- $kW_{Base}$  = Baseline summer coincident peak demand (kW)
- $kW_{Retrofit}$  = Retrofit summer coincident peak demand (kW)
- $\Delta kW_{fan}$  = Fan-only summer coincident peak demand impact
- $\Delta kW_{total}$  = Total project summer coincident peak demand impact
- $PLR_{Base,FFpeak}$  = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the baseline flow control type (default average flow fraction during peak period = 90%)

$PLR_{Retrofit,FFpeak}$  = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the retrofit flow control type (default average flow fraction during peak period = 90%)

**FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION**

There are no expected fossil fuel impacts for this measure.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-VSDP-V01-200101**

**REVIEW DEADLINE: 1/1/2023**

## 4.8.14 Low Flow Toilets and Urinals

### DESCRIPTION

Toilets and urinals are found in bathrooms located in commercial, and industrial facilities. The first federal standards dealing with water consumption for toilets and urinals was the Energy Policy Act of 1992. It specified a gallon per flush (gpf) standard for both fixtures. These standards are used to define the baseline equipment for this measure. The Subsequent U.S. EPA WaterSense program in 2009 set even tighter standards for plumbing fixtures, including toilets and urinals. These standards are used to define the efficient equipment for this measure.

### DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is either a U.S. EPA WaterSense certified commercial toilet fixture or commercial urinal.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a toilet or urinal that has a maximum gallons per flush outlined by the Energy Policy Act of 1992.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life for this measure is assumed to be 25 years for both toilets and urinals.<sup>1310</sup>

### DEEMED MEASURE COST

The incremental costs for both toilets and urinals are \$0.<sup>1311</sup>

### LOADSHAPE

Loadshape C02 - Commercial Electric DHW

### COINCIDENCE FACTOR

N/A

---



---

## Algorithm

---



---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta \text{kWh} = \Delta \text{Water} / 1,000,000 * E_{\text{water total}}$$

$$E_{\text{water}} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

---

<sup>1310</sup> ATD Home Inspection: <http://www.atdhomeinspection.com/advice/average-product-life/> is 50 years. 25 years is used to be conservative.

<sup>1311</sup> Measure cost assumption from City of Fort Collins, "Green Building Practice Summary," March 21, 2011, page 2. The document states "Information from the EPA WaterSense web site: WaterSense® labeled toilets are not more expensive than regular toilets. MaP testing results have shown no correlation between price and performance. Prices for toilets can range from less than \$100 to more than \$1,000. Much of the variability in price is due to style, not functional design."

$$= 5,010^{1312}$$

**Toilet Calculation:**

**For example**, a low flow toilet is installed in a commercial location.

$$\begin{aligned} \Delta \text{kWh} &= 491 \text{ gal/year} / 1,000,000 * 5,010 \text{ kWh/million gallons} \\ &= 2.5 \text{ kWh/year} \end{aligned}$$

**Urinal Calculation:**

**For example**, a low flow urinal is installed in a commercial location.

$$\begin{aligned} \Delta \text{kWh} &= 2,340 \text{ gal/year} / 1,000,000 * 5,010 \text{ kWh/million gallons} \\ &= 11.7 \text{ kWh/year} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta \text{Water} = (\text{GPF}_{\text{Base}} - \text{GPF}_{\text{Eff}}) * \text{NFPD} * \text{ADPY}$$

Where:

- GPF<sub>Base</sub> = Baseline equipment gallons per flush  
 = 1.6 for toilets<sup>1313</sup>  
 = 1.0 for urinals<sup>1314</sup>
- GPF<sub>Eff</sub> = Efficient equipment gallons per flush  
 = Actual, if unknown assume 1.28 for toilets<sup>1315</sup>  
 = Actual, if unknown assume 0.5 for urinals<sup>1316</sup>
- NFPD = Number of flushes per day  
 = 5.9 for toilets<sup>1317</sup>  
 = 18 for urinals<sup>1318,1319</sup>
- ADPY = Annual days per year

<sup>1312</sup> This factor includes 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s Review ‘IL TRM: Energy per Gallon Factor, May 2018’.

<sup>1313</sup> U. S. EPA WaterSense. “Water Efficiency Management Guide – Bathroom Suite” (EPA 832-F-17-016d), Nov 2017.

<sup>1314</sup> U.S. EPA WaterSense. “WaterSenses Specification for Flushing Urinals Supporting Statement”, Oct 2009.

<sup>1315</sup> U. S. EPA WaterSense. “Water Efficiency Management Guide – Bathroom Suite” (EPA 832-F-17-016d), Nov 2017.

<sup>1316</sup> U.S. EPA WaterSense. “WaterSenses Specification for Flushing Urinals Supporting Statement”, Oct 2009.

<sup>1317</sup> CASE Initiative for PY 2013: Analysis of Standards Proposal for Toilets and Urinals Water Efficiency. July 29, 2013. Pg 18.

<sup>1318</sup> Ibid.

<sup>1319</sup> U.S. EPA WaterSense. “WaterSenses Specification for Flushing Urinals Supporting Statement”, Oct 2009. Pg 1.

= 260 for commercial and industrial<sup>1320</sup>

**Toilet Calculation:**

**For example**, a low flow toilet is installed in a commercial location.

$$\begin{aligned}\Delta\text{Water} &= [(1.6 - 1.28) \text{ gal/flush} \times 5.9 \text{ flush/day} \times 260 \text{ days/year}] \\ &= 491 \text{ gal/year}\end{aligned}$$

**Urinal Calculation:**

**For example**, a low flow urinal is installed in a commercial location.

$$\begin{aligned}\Delta\text{Water} &= (1.0 - 0.5) \text{ gal/flush} \times 18 \text{ flush/day} \times 260 \text{ days/year} \\ &= 2,340 \text{ gal/year}\end{aligned}$$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-LFTU-V02-210101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>1320</sup> Assuming the work week is Monday through Friday.

## 4.8.15 Smart Irrigation Controls

### DESCRIPTION

Irrigation systems are commonly found on commercial properties, educational institutions, public parks, golf courses, and other facilities with landscaped grounds. They are typically operated on timers, applying the irrigation water in the early morning or after dusk. The timing and duration of irrigation application are determined by the user, along with the location and density of sprinklers. The irrigation water gets applied according to the control schedule, regardless of whether the landscape actually needs the irrigation water at that time.

The new measure involves the installation of a control system technology that reduces or eliminates irrigation during times of precipitation or when there is already sufficient soil moisture. This measure applies to landscape irrigation systems for commercial, institutional, and public properties only. It does not apply to agricultural irrigation systems for crops or residential landscape irrigation systems.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Smart Irrigation Controls utilize sensors, gauges, or local weather forecasts to regulate the application of irrigation water to lawn or landscape vegetation. There are two main technologies used for this purpose: 1) Precipitation based smart irrigation controllers, and 2) Soil-moisture based smart irrigation controllers.

#### Precipitation Based Smart Irrigation Controllers

This type of system utilizes either an on-site rain gauge or a local weather service to determine if there is sufficient precipitation to allow shut-off of the irrigation water.

#### Soil Moisture Based Smart Irrigation Controllers

This type of system utilizes soil moisture sensors, buried in the root zone, to determine if irrigation water is needed. A “suspended cycle irrigation system” uses the soil moisture sensors to determine whether a regularly scheduled irrigation application is necessary. If there is sufficient soil moisture, then the next scheduled irrigation cycle gets interrupted. A “water-on-demand irrigation system” applies irrigation water when the moisture sensor reaches its lower limit and shuts off when the moisture sensor reaches its upper limit. There is no regularly scheduled irrigation with the water on demand system.

For the purposes of this measure characterization, the assumed rolling 24-hour threshold for shutting off the irrigation is 6 mm (0.24”). The Savings Factor is based on the percentage of time that the rolling 24-hour average of precipitation meets or exceed the 6 mm threshold.

### DEFINITION OF BASELINE EQUIPMENT

The baseline irrigation system applies irrigation water to the lawn or landscape on a regularly scheduled timer. The timing and duration of irrigation application are determined by the user, along with the location and density of sprinklers. The irrigation water gets applied according to the control schedule, regardless of whether the landscape actually needs the irrigation water at that time.

Sprinkler head nozzles have a variety of configurations that affect the distribution of the irrigation water. The water can come in the form of a spray, a rotating plume, a bubbler, or a drip.

Typical baseline irrigation systems provide 1 inch of irrigation to the entire lawn. This is equivalent to 0.623 gallons per square foot of lawn per week.<sup>1321</sup>

---

<sup>1321</sup> Today’s Homeowner with Danny Lipford. “How to Calculate Lawn Irrigation Water Usage and Costs.”

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected useful life for Irrigation Control Measures is assumed to be 15 years.

**DEEMED MEASURE COST**

The measure cost for a multi-zone smart irrigation control system is \$500.<sup>1322</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

Energy savings from Irrigation Control Measures are the result of reduced water consumption. There are indirect electric energy savings from reduced potable water treatment.

**ELECTRIC ENERGY SAVINGS**

The electric energy savings are based indirectly on the reduced electricity usage used to provide the potable water and treat the wastewater. By applying an “Energy Factor”, the water savings (in gallons/year) can be converted to electricity savings (in kWh/year). This “Energy Factor” considers the electric energy requirements of potable water treatment plants and potable water distribution. Since the “wasted” irrigation water in the baseline case will likely be absorbed into the soil or will runoff into surface water bodies, electricity savings from a reduction in wastewater treatment load would not apply.

The methodology for quantifying the water savings involves a direct comparison of the baseline equipment to the efficient equipment. In order to calculate the baseline water usage of an irrigation system, the number of sprinklers and their sizing need to be determined. The static pressure and sizing of the water service, along with the sprinkler head orifice sizing will ultimately determine the flow rate of water.

The electricity savings for this measure can be calculated by applying an energy factor to the calculated water savings.

$$\Delta kWh_{water} = \Delta Water / 1,000,000 * E_{water}$$

Where:

$$E_{water} = \text{Illinois Total Water Energy Factor (kWh/Million Gallons)} \\ = 2,571^{1323}$$

The total water savings for this measure can be calculated as follows:

$$\Delta Water = BSFL - ESFL$$

Where:

<sup>1322</sup> Material pricing taken from Google shopping search on “smart irrigation control system”. The Rain Bird Smart LNK WiFi Irrigation System Indoor Controller (4 Pack) sells for \$316 from online retailer Wish.com.. Installation labor pricing taken from online retailer Home Advisor – Lawn and Garden, Repair a Sprinkler System which stated \$45 to \$200 per hour for a plumber.

<sup>1323</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.



$$\Delta\text{Water} = \text{Total Water Savings (gallon/season)}$$

The baseline volumetric flow rate for the entire system can be calculated as follows:

$$\text{BSFL} = \text{NOS} \times \text{SFL} \times \text{DOI} \times \text{NAY}$$

Where:

BSFL	= Baseline System Flow Rate (gallon/year)
NOS	= Number of Sprinklers, the total number of sprinklers at the property = Actual
SFL	= Sprinkler Flow Rate (gallon/minute) = Actual, site-specific irrigation system specifications should be consulted to determine the property's sprinkler flow rate
DOI	= Duration of Irrigation (minutes/application) = Actual, the baseline scheduling controls should be used to determine the irrigation season
NAY	= Number of Applications per Year (application/year) = Actual

The efficient volumetric flow rate can be calculated as follows:

$$\text{ESFL} = \text{BSFL} \times (1 - \text{SF})$$

Where:

ESFL	= Efficient System Flow Rate (gallon/season)
BSFL	= Baseline System Flow Rate (gallon/season)
SF	= Savings Factor

The volumetric flow rate for the entire efficient system is based on applying a Savings Factor (SF) to the BSFL. The SF is determined by calculating the number of weeks in the irrigation season (April 25 through October 13) when there is sufficient precipitation to allow the shutoff of the irrigation system. Typical Meteorological Year (TMY-3) data gives precipitation depth in millimeters for each hour of the typical year. By consulting the TMY-3 data for the closest applicable weather station, the SF can be determined.

One source recommends a rain sensor shut-off threshold of 6 mm of precipitation for twice or thrice weekly irrigation schedule or 13 mm of precipitation for once weekly irrigation schedule.<sup>1324</sup> For the purposes of this workpaper, we will use a rolling 24-hour threshold of 6 mm.

The State Climatologist Office for Illinois produced a map of the Illinois Growing Season days per year for different parts of the state.<sup>1325</sup> Using a growing season average of 170 days, the "irrigation season" begins on April 25 and end on October 13.

By analyzing the TMY-3 precipitation data, the number of weeks during the "irrigation season" that the rolling 24-hour precipitation levels greater than 6 mm can be determined, along with the Savings Factors:

Chicago:	SF = 0.265
Midway:	SF = 0.241
Rockford:	SF = 0.268
Peoria:	SF = 0.227
Springfield:	SF = 0.186

---

<sup>1324</sup> Michael D. Dukes. "Smart Irrigation Controllers: What Makes an Irrigation Controller Smart". University of Florida, Institute for Food & Agricultural Sciences.

<sup>1325</sup> State Climatologist Office for Illinois, Illinois State Water Survey, 2003. Based on 1971 – 2000 data, assessing the number of days between the last spring drop below 32 degrees and the first fall drop below 32 degrees.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

The water savings inherent in the efficient irrigation control technology will help preserve water supplies and extend the life of water treatment and wastewater treatment equipment. By reducing irrigation during periods of precipitation, unnecessary storm runoff and puddling can be avoided. For more details on calculating water savings, please see the 'Algorithm' section of this characterization.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Maintaining an Efficient Irrigation Control system will require periodic cleaning and calibration of the sensors. Any wiring or wireless communication devices will also need to be maintained. Costs for these activities is \$196.<sup>1326</sup>

**MEASURE CODE: CI-MSC-SIRC-V01-200101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>1326</sup> Based on data provided on Home Advisor website, Lawn and Garden, Repair a Sprinkler System.

## 4.8.16 Commercial Weather Stripping

### DESCRIPTION

Entrance/exit doors installed for a commercial or industrial buildings often leave clearance gaps to allow for proper operation. The gaps around the doors allow unconditioned air to infiltrate the building due to wind force, internal building stack affect, and other temperature differentials, thus adding to the cooling and heating loads of an HVAC system. Sweeps and other weather stripping applications are designed to close these gaps, while still allowing proper operation. They are installed along the bottom, head, and jambs of exterior doors to prevent air infiltration from adding to the HVAC load.

This measure was developed to be applicable to the following program types: RF, DI. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

There are a variety of types of materials used as door sweeps and weather stripping, including nylon bristles, felt, vinyl, open or closed-cell foam, and EPDM rubber. Their effectiveness is assumed to be the same when properly installed.

### DEFINITION OF BASELINE EQUIPMENT

This measure shall apply to the exterior doors on commercial buildings that are not sealed from the outside environment (i.e., interior vestibule doors would be ineligible) with visible gaps of at least 1/8 inches and up to 3/4 inches along any outside edge of the door. The space on the interior of the door must be conditioned and/or heated, and the calculation methodology will use standard efficiencies of 1.0 kW/ton for cooling and 80% for heating. Electric resistance heating and electric heat pump systems will use coefficients of performance (COPs) of 1.0 and 3.3, respectively.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life (EUL) is 10 years.<sup>1327</sup>

### DEEMED MEASURE COST

Costs for this measure should be determined by actual quotes obtained from manufacturers and estimated labor. If not available, it is estimated based on brush weather strips cost of \$5.50/LF with labor and other direct costs of installation costing \$2.50/LF with the total coming to \$8.00/LF.<sup>1328</sup>

### LOADSHAPE

Loadshape C03 - Commercial Cooling

Loadshape C04 - Commercial Electric Heating

Loadshape C05 - Commercial Electric Heating and Cooling

### COINCIDENCE FACTOR

N/A

---

<sup>1327</sup> Assumed lower than residential due to likely significantly higher door usage.

<sup>1328</sup> Deemed costs referenced from the Arkansas TRM.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \Delta kWh_{\text{weatherstrip}} * \text{Length}$$

Where:

$$\Delta kWh_{\text{weatherstrip}} = \text{Annual kWh savings from installation of door sweep per linear foot}^{1329}$$

Climate Zone (City based upon)	$\Delta kWh_{\text{weatherstrip}}$ per linear ft	
	Electric Resistance	Heat Pump
1 (Rockford)	89.4	44.7
2 (Chicago)	78.6	39.3
3 (Springfield)	69.2	34.6
4 (Belleville)	59.9	29.9
5 (Marion)	48.0	24.0

$$\text{Length} = \text{Linear feet of door weatherstripping installed}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Cooling savings have not been quantified for this measure.

**NATURAL GAS SAVINGS**

$$\Delta \text{Therms} = \Delta \text{Therms}_{\text{weatherstrip}} * \text{Length}$$

Where:

$$\Delta \text{Therms}_{\text{weatherstrip}} = \text{Annual therm savings from installation of door sweep per linear foot}^{1330}$$

Climate Zone (City based upon)	$\Delta \text{Therms}_{\text{weatherstrip}}$ per linear ft
1 (Rockford)	3.91
2 (Chicago)	3.44
3 (Springfield)	3.03
4 (Belleville)	2.62
5 (Marion)	2.1

$$\text{Length} = \text{Linear feet of door weatherstripping installed}$$

<sup>1329</sup> Converts the Therm value to kWh and incorporates the relative COP efficiencies (assumed 0.78 for gas heat, 1 for electric resistance and 2.0 for heat pumps).

<sup>1330</sup> Savings are based on lab test results performed by CLEARresult, assuming a 1/8" gap. See 'Commercial Weather Stripping IL\_TRM\_Workpaper v1.2'. The results for 1/8" gap are similar to the prescriptive Residential door sweep measure in 5.6.1 Air Sealing (assuming 3 ft doorsweep) and so deemed appropriate by the TAC.

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

NA

**DEEMED O&M COST ADJUSTMENT CALCULATION**

NA

**MEASURE CODE: CI-MSC-WTST-V01-200101**

**REVIEW DEADLINE: 1/1/2022**

## 4.8.17 Switch Peripheral Equipment Consolidation

### **DESCRIPTION**

This measure will allow for projects with small scopes of equipment replacement to be cost effectively brought into the telecommunication optimization incentive program. Consolidating telecommunication line and trunk equipment eliminate underutilized equipment which reduces power draw from the rectifier. This avoided heat load also results in cooling savings.

This measure was developed to be applicable to the following program types: Telecommunication Optimization. If applied to other program types, the measure savings should be verified.

### **DEFINITION OF EFFICIENT EQUIPMENT**

The measure requires no new equipment and only consolidates partially loaded equipment. There are a myriad of different types of line and trunk equipment, but consolidation eliminates underutilized equipment which will result in energy savings.

### **DEFINITION OF BASELINE EQUIPMENT**

Baseline telecommunications equipment is partially loaded line and trunk equipment that is no longer needed due to line loss on the telecommunications network. Lines are consolidated to like equipment and the underutilized equipment is removed. This applies to all line and trunk equipment and does not exclude participation from any particular type of line and trunk equipment. All line and trunk equipment are considered eligible but only up to and including 40 pieces of equipment. Above that amount, projects will require on-site amp reduction verification.

Baseline cooling equipment is assumed to be an Air-Cooled Chiller without an economizer with a capacity >240 MBtu. If cooling equipment can be verified, the chiller efficiency can be replaced with the appropriate value using Table 3.

**ASHRAE 90.1 2016: Table 6.8.1-11**

Equipment Type	Net Sensible Cooling Capacity	Downflow units	Upflow - Ducted	Upflow - Unducted	Horizontal Flow
		COP	COP	COP	COP
Air Cooled	< 65 MBtuh	2.30	2.10	2.09	2.45
	> 65 MBtuh and < 240 MBtuh	2.20	2.05	1.99	2.35
	> 240 MBtuh	2.00	1.85	1.79	2.15
Water Cooled	< 65 MBtuh	2.50	2.30	2.25	2.70
	> 65 MBtuh and < 240 MBtuh	2.40	2.20	2.15	2.60
	> 240 MBtuh	2.25	2.10	2.05	2.45
Water Cooled with Fluid Economizer	< 65 MBtuh	2.45	2.25	2.20	2.60
	> 65 MBtuh and < 240 MBtuh	2.35	2.15	2.10	2.55
	> 240 MBtuh	2.20	2.05	2.00	2.40
Glycol Cooled	< 65 MBtuh	2.30	2.10	2.00	2.40
	> 65 MBtuh and < 240 MBtuh	2.05	1.85	1.85	2.15
	> 240 MBtuh	1.95	1.80	1.75	2.10
Glycol Cooled with Fluid Economizer	< 65 MBtuh	2.25	2.10	2.00	2.35
	> 65 MBtuh and < 240 MBtuh	1.95	1.80	1.75	2.10
	> 240 MBtuh	1.90	1.80	1.70	2.10

**Converted ASHRAE 90.1 2016: Table 6.8.1-11 Cooling Efficiency Table**

Equipment Type	Net Sensible Cooling Capacity	Downflow units	Upflow - Ducted	Upflow - Unducted	Horizontal Flow
		kW/Ton	kW/Ton	kW/Ton	kW/Ton
Air Cooled	< 65 MBtuh	1.53	1.67	1.68	1.44
	> 65 MBtuh and < 240 MBtuh	1.60	1.72	1.77	1.50
	> 240 MBtuh	1.76	1.90*	1.96	1.64
Water Cooled	< 65 MBtuh	1.41	1.53	1.56	1.30
	> 65 MBtuh and < 240 MBtuh	1.47	1.60	1.64	1.35
	> 240 MBtuh	1.56	1.67	1.72	1.44
Water Cooled with Fluid Economizer	< 65 MBtuh	1.44	1.56	1.60	1.35
	> 65 MBtuh and < 240 MBtuh	1.50	1.64	1.67	1.38
	> 240 MBtuh	1.60	1.72	1.76	1.47
Glycol Cooled	< 65 MBtuh	1.53	1.67	1.76	1.47
	> 65 MBtuh and < 240 MBtuh	1.72	1.90	1.90	1.64
	> 240 MBtuh	1.80	1.95	2.01	1.67
Glycol Cooled with Fluid Economizer	< 65 MBtuh	1.56	1.67	1.76	1.50
	> 65 MBtuh and < 240 MBtuh	1.80	1.95	2.01	1.67
	> 240 MBtuh	1.85	1.95	2.07	1.67

\*Default value based on previous program data; in all but one project, this was the cooling efficiency value used

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

10 years.<sup>1331</sup>

**DEEMED MEASURE COST**

There is no equipment cost to implement this measure. The only associated cost is the required internal labor to move lines from the to-be-removed piece of equipment to the chosen like piece of equipment. The default labor cost is \$742/piece of equipment removed.<sup>1332</sup>

**LOADSHAPE**

Loadshape is determined by the constant power draw by the line and trunk equipment; default loadshape is: Loadshape C53 – Flat.

**COINCIDENCE FACTOR**

Coincidence Factor is determined by the constant power draw by the line and trunk equipment; the summer peak coincidence factor for the line and trunk equipment is assumed to be 100%. The cooling coincident factor is assumed to be slightly less due to compressor cycling; the summer peak coincidence factor for the cooling system is assumed to be 82%.

<sup>1331</sup> Assumption is based on communication from AT&T program manager indicating an expectation that consolidated equipment should be expected to remain for a minimum of 10 years.

<sup>1332</sup> Value based on the average of program data provided by Franklin Energy. See “Network Combing Workpaper Research\_v2.xls” for details. Note projects were capped at 40 pieces of equipment in the development of this average.



**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\text{kWh Savings} = p * kW_{\text{Trunk}}(1 + \text{LCF} * \text{CE}) * t$$

Where:

- p = Number of pieces of redundant equipment removed
- $kW_{\text{Trunk}}$  = Average line and trunk equipment power draw, 0.233 kW<sup>1333</sup>
- LCF = Load Conversion Factor kW to Ton, 0.284
- CE = Cooling Efficiency, default value = 1.90 kW/ton<sup>1334</sup>
- t = time, 8,760 hours

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\text{kW Savings} = p * kW_{\text{Trunk}}(\text{CF}_{\text{Trunk}} + \text{LCF} * \text{CE} * \text{CF}_{\text{Cooling}})$$

Where:

- p = Number of pieces of redundant equipment removed
- $kW_{\text{Trunk}}$  = Average line and trunk equipment power draw, 0.233 kW
- LCF = Load Conversion Factor kW to Ton, 0.284
- CE = Cooling Efficiency, default value = 1.90 kW/ton based on previous program data
- $\text{CF}_{\text{Trunk}}$  = Line and Trunk Equipment Coincidence Factor, 1.0
- $\text{CF}_{\text{Cool}}$  = Cooling System Coincidence Factor, 0.82

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1333</sup> Value based on the average of program data provided by Franklin Energy. See “Network Combing Workpaper Research\_v2.xls” for details. Note projects were capped at 40 pieces of equipment in the development of this average.  
<sup>1334</sup> Cooling efficiency kW/ton default is based on air cooled units >240 Mbtuh, upflow ducted value as per the ASHRAE 90.1 2016 tables provided in the baseline section. This was the appropriate cooling efficiency value for all but one of Franklin Energy's projects.

**MEASURE CODE: CI-MSC-SPEC-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

## 4.8.18 ENERGY STAR Uninterruptible Power Supply

### DESCRIPTION

This measure is for replacing an inefficient uninterruptible power supply (UPS) with an efficient ENERGY STAR rated UPS in a data center, telecommunications, or similar facility that operates continuously. UPS units provide backup power in data centers and draw power constantly to keep their batteries charged. Uninterruptible power supplies (UPS) are utilized in many organizations to protect themselves from downtime with power distribution and avoid data processing errors due to downtimes. UPS systems are connected between the public power distribution system and mission critical loads.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a new ENERGY STAR UPS. For single-normal mode UPSs, the installed system must meet or exceed the average loading-adjusted efficiency values required by the ENERGY STAR program.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing non-ENERGY STAR UPS.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.<sup>1335</sup>

### DEEMED MEASURE COST

The incremental cost is estimated at \$59per UPS unit.<sup>1336</sup>

### LOADSHAPE

Loadshape is determined by the constant power draw by the UPS; default loadshape is Loadshape C53 – Flat.

### COINCIDENCE FACTOR

The coincidence factor for the UPS or rectifier is assumed to be 1.0 due to equipment operating during peak period.

---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \text{Size} * (1/\text{Eff}_{\text{AVGbase}} - 1/\text{Eff}_{\text{AVGee}}) * \text{EFLH}$$

---

<sup>1335</sup> California Municipal Utilities Association. Savings Estimation Technical Reference Manual 2017, Third Edition. Section 8.12, p. 8–15.

<sup>1336</sup> As estimated in the California Municipal Utilities Association. Savings Estimation Technical Reference Manual 2017, incremental measure cost based on average UPS costs for a range of sizes, assuming a 30% premium for an ENERGY STAR UPS.

Where:

- Size = Size of UPS in rated output power, kW
- Eff<sub>AVGbase</sub> = Efficiency of existing UPS
- = Actual or use table below<sup>1337</sup>

UPS Product Class	Rated Output Power	Minimum Efficiency
Voltage and Frequency Dependent (VFD)	P ≤ 300 W	$-1.09 \times 10^{-6} \times P^2 + 6.50 \times 10^{-4} \times P + 0.876$
	300 W < P ≤ 700 W	$-5.63 \times 10^{-8} \times P^2 + 7.61 \times 10^{-5} \times P + 0.955$
	P > 700 W	$-6.22 \times 10^{-9} \times P^2 + 3.91 \times 10^{-6} \times P + 0.981$
Voltage Independent (VI)	P ≤ 300 W	$-6.45 \times 10^{-7} \times P^2 + 3.80 \times 10^{-4} \times P + 0.929$
	300 W < P ≤ 700 W	$-3.94 \times 10^{-8} \times P^2 + 4.87 \times 10^{-5} \times P + 0.974$
	P > 700 W	$-2.28 \times 10^{-9} \times P^2 + 7.40 \times 10^{-7} \times P + 0.990$
Voltage and Frequency Independent (VFI)	P ≤ 300 W	$-3.13 \times 10^{-6} \times P^2 + 1.960 \times 10^{-3} \times P + 0.544$
	300 W < P ≤ 700 W	$-2.60 \times 10^{-7} \times P^2 + 3.65 \times 10^{-4} \times P + 0.765$
	P > 700 W	$-1.70 \times 10^{-8} \times P^2 + 3.85 \times 10^{-5} \times P + 0.877$

- Eff<sub>AVGee</sub> = Efficiency of new ENERGY STAR UPS
- = Actual or ENERGY STAR minimum value from table below<sup>1338</sup>

Rated Output Power	UPS Product Class		
	VFD	VI	VFI
P ≤ 350 W	$5.71 \times 10^{-5} \times P + 0.962$	$5.71 \times 10^{-5} \times P + 0.962$	$0.011 \times \ln(P) + 0.824$
350 W < P ≤ 1.5 kW	0.982	0.984	$0.011 \times \ln(P) + 0.824$
1.5 kW < P ≤ 10 kW	0.981 - E <sub>MOD</sub>	0.981 - E <sub>MOD</sub>	$0.0145 \times \ln(P) + 0.8 - E_{MOD}$
P > 10 kW	0.97	0.94	$0.0058 \times \ln(P) + 0.886$

E<sub>MOD</sub> = an allowance of 0.004 for Modular UPSs applicable in the commercial 1500 – 10,000 W range

- EFLH = Equivalent Full Load Hours, per equation below and values provided in table<sup>1339</sup>
- =  $(t_{0.25} \times 0.25 + t_{0.5} \times 0.5 + t_{0.75} \times 0.75 + t_{1.0} \times 1.0) \times 8760$  hours

Rated Output Power (P) in watts	UPS Product Class	Time spent at specified proportion of reference test load (t)				EFLH
		25%	50%	75%	100%	
P ≤ 1.5 kW	VFD	0.2	0.2	0.3	0.3	5913
	VI or VFI	0	0.3	0.4	0.3	6570
1.5 kW < P ≤ 10 kW	VFD, VI, or VFI	0	0.3	0.4	0.3	6570
P > 10 kW	VFD, VI, or VFI	0.25	0.5	0.25	0	4380

<sup>1337</sup> 10 CFR 430 Energy Conservation Standards for Uninterruptible Power Supplies <https://beta.regulations.gov/document/EERE-2016-BT-STD-0022-0007>

<sup>1338</sup> ENERGY STAR Uninterruptible Power Supplies Final Version 2.0 Specification.

<sup>1339</sup> Calculation and inputs provided in ENERGY STAR Uninterruptible Power Supplies Final Version 2.0 Specification.

Default Energy Savings are provided below:<sup>1340</sup>

Output Power Range	Single-Normal Mode UPS Systems			Multiple-Normal Mode UPS Systems	
	VFD	VI	VFI	VFD <sub>25%</sub> /VI <sub>75%</sub>	VFD <sub>25%</sub> /VFI <sub>75%</sub>
P ≤ 350 W	416.7	133.3	996.6	212.4	777.2
350 W < P ≤ 1.5 kW	162.5	246.2	-407.4*	229.7	-219.0*
1.5 kW < P ≤ 10 kW	131.7	105.8	-609.2*	115.9	-383.8*
10 kW < P < 16 kW	65.2	-63.4*	255.1	-21.9*	210.9
16 kW ≤ P ≤ 80 kW	65.2	31.4	62.6	48.6	72.3
P > 80 kW	65.2	31.4	102.7	48.6	72.3

\*' negative savings, i.e. an increase in consumption and so these are not recommended

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Size} * (1/\text{Eff}_{\text{AVGbase}} - 1/\text{Eff}_{\text{AVGee}}) * \text{CF}$$

Where:

CF<sub>IT</sub> = Coincidence factor of UPS  
 = 1.0

Default Summer Peak Demand Savings are provided below based on defaults above:

Output Power Range	Single-Normal Mode UPS Systems			Multiple-Normal Mode UPS Systems	
	VFD	VI	VFI	VFD <sub>25%</sub> /VI <sub>75%</sub>	VFD <sub>25%</sub> /VFI <sub>75%</sub>
P ≤ 350 W	0.0705	0.0203	0.1517	0.0323	0.1183
350 W < P ≤ 1.5 kW	0.0275	0.0375	-0.0620*	0.0350	-0.0333*
1.5 kW < P ≤ 10 kW	0.0223	0.0161	-0.0927*	0.01764	-0.05842*
10 kW < P < 16 kW	0.0149	-0.0096*	0.0388	-0.00333*	0.03210
16 kW ≤ P ≤ 80 kW	0.0149	0.0048	0.0095	0.00740	0.01101
P > 80 kW	0.0149	0.0048	0.0156	0.00740	0.01101

**NATURAL GAS SAVINGS**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-UPSE-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

<sup>1340</sup> Default savings are provided in a calculation file provided by Franklin Energy that averages a number of power ratings within each range. See “ENERGY STAR UPS Calculations.xls” for more information.

## 4.8.19 Energy Efficient Rectifier

### DESCRIPTION

This measure is for replacing an inefficient rectifier with an efficient unit in a data center, telecommunications, or similar facility that operates continuously. A rectifier converts alternating current (AC) to direct current (DC).

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a new rectifier whose efficiency in normal mode (not in energy saver mode) is at least 94%.<sup>1341</sup>

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing rectifier whose efficiency in normal mode (not in energy saver mode) is less than 90%.<sup>1342</sup>

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.<sup>1343</sup>

### DEEMED MEASURE COST

The incremental cost is estimated at \$0.57 per rectifier Amp.<sup>1344</sup>

### LOADSHAPE

Loadshape is determined by the constant power draw by the Rectifier; default loadshape is Loadshape C53 – Flat.

### COINCIDENCE FACTOR

The coincidence factor for the rectifier is assumed to be 1.0 due to equipment operating during peak period.

---

<sup>1341</sup> Switching mode rectifier (SMR) technologies allows for efficiencies as high as 96% according to the Office of Energy Efficiency & Renewable Energy. Accessed: 12/05/19 <https://www.energy.gov/eere/amo/high-efficiency-wide-band-three-phase-rectifiers-and-adaptive-rectifier-management>

<sup>1342</sup> Mid-range efficiency for most low peak rectifiers (88%-92%) based on information from the Office of Energy Efficiency & Renewable Energy. Accessed: 12/05/19 <https://www.energy.gov/eere/amo/high-efficiency-wide-band-three-phase-rectifiers-and-adaptive-rectifier-management>

<sup>1343</sup> California Municipal Utilities Association. Savings Estimation Technical Reference Manual 2017, Third Edition. Section 8.12, p. 8–15.

<sup>1344</sup> Based on market study of twenty 1600 Volt Bridge Rectifiers. Accessed: 12/05/19. [https://www.mouser.com/Semiconductors/Discrete-Semiconductors/Diodes-Rectifiers/Bridge-Rectifiers/\\_/N-ax1mf?P=1yzzhysZ1yzzpaz](https://www.mouser.com/Semiconductors/Discrete-Semiconductors/Diodes-Rectifiers/Bridge-Rectifiers/_/N-ax1mf?P=1yzzhysZ1yzzpaz)

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = kWh_{base} - kWh_{EE}$$

$$kWh_{base} = ((Load * H_{IT})/Eff_{base}) + ((Load * (1/ Eff_{base} - 1) * H_{Cool} * kW/Ton_{Cool} * 3412/12000)$$

$$kWh_{EE} = ((Load * H_{IT})/Eff_{EE}) + ((Load * (1/ Eff_{EE} - 1) * H_{Cool} * kW/Ton_{Cool} * 3412/12000)$$

Where:

- Load = Average IT load (output kW)  
= Actual, typically at 20% of equipment rated load<sup>1345</sup>
- H<sub>IT</sub> = Annual hours of operation of rectifier  
= 8760
- H<sub>cool</sub> = Annual cooling system hours of operation  
= Actual or defaults below:

System Size	Cooling Hours (H <sub>cool</sub> )
Small IT (≤ 50 kW) without air-side economizer	8760 hours <sup>1346</sup>
Small IT (> 50 kW) with air-side economizer	4380 hours <sup>1347</sup>

- Eff<sub>base</sub> = Efficiency of existing rectifier  
= Actual. If unknown assume 90%<sup>1348</sup>
- Eff<sub>EE</sub> = Efficiency of new rectifier  
= Actual. If unknown assume 94%
- kW/Ton<sub>cool</sub> = Cooling system efficiency (kW/Ton)

Cooling Equipment Type	Efficiency Calculation (kW/Ton <sub>cool</sub> )
Air-Cooled Chiller	kW/Ton <sub>Chiller</sub> + kW <sub>chilled water pump</sub> /Tons
Water-Cooled Chiller	kW/Ton <sub>Compressor</sub> + (kW <sub>chilled water pump</sub> + kW <sub>condensator water pump</sub> + kW <sub>cooling tower fans</sub> )/Tons
Direct Expansion System	12/EER

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = kW_{base} - kW_{EE}$$

$$kW_{base} = ((Load * CF_{IT})/Eff_{base}) + ((Load * CF_{cool} * (1/ Eff_{base} - 1) * kW/Ton_{Cool} * 3412/12000)$$

$$kW_{EE} = ((Load * CF_{IT})/Eff_{EE}) + ((Load * CF_{cool} * (1/ Eff_{EE} - 1) * kW/Ton_{Cool} * 3412/12000)$$

<sup>1345</sup> Based on industry knowledge of large telecom company set up.

<sup>1346</sup> Small IT systems are assumed to have no air-side economizer and to operate continuously throughout the year.

<sup>1347</sup> Larger IT systems are assumed to have an air-side economizer that allows the cooling system to be turned off for half the year. This corresponds to approximately a 45°F changeover temperature, which is a conservative assumption.

<sup>1348</sup> Mid-range efficiency for most low peak rectifiers (88%-92%) based on information from the Office of Energy Efficiency & Renewable Energy.

Where:

$CF_{IT}$  = Coincidence factor of rectifier  
= 1.0

$CF_{cool}$  = Coincidence factor of cooling system  
= 0.82

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-RECT-V01-210101**

**REVIEW DEADLINE: 1/1/2023**



## 4.8.20 Energy Efficient Hydraulic Oils - Provisional Measure

### DESCRIPTION

Industrial hydraulic systems use hydraulic oil to transfer input energy to output power. Hydraulic oils also protect critical components from premature wear. Energy efficient hydraulic oil lubricants meet these requirements and provide reduced energy consumption. Energy efficient hydraulic oils have a lower coefficient of friction which reduces the friction between two moving parts (rotating pump equipment and hydraulic oil). This lower coefficient of friction reduces the energy required to yield output power. Second, these oils have a high viscosity index which reduces the effect temperature has on the viscosity of the hydraulic oil. The high viscosity index allows constant viscosity over a range of operating temperatures which optimizes volumetric and mechanical efficiency at the pumps rated output. Additionally, energy efficient hydraulic oils reduce the operating temperature of the hydraulic system.

Manufacturers who use electric-motor-driven hydraulic systems have been found to reduce energy consumption by between 3 and 7%.

This measure was developed to be applicable to the following program types: NC, TOS and RF. If applied to other program types, the measure should be verified as a custom measure.

### DEFINITION OF EFFICIENT EQUIPMENT

This is applicable for small, medium, and large manufacturers in all climate zones using electric motors to power their hydraulic system both inside and/or outside conditioned areas; or for all hydraulic systems on mobile equipment in all climate zones on Illinois.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is defined as hydraulic systems using non-energy efficient industrial hydraulic oils which provides no energy efficiency benefits. In the formula below, the baseline equipment is where,  $E_i = \text{zero}$ .

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.

The ability to reduce energy consumption (energy efficiency) is an inherent characteristic in the oil which does not deplete over time. As long as the energy efficient oil is in use, it will provide energy efficiency.

### DEEMED MEASURE COST

The actual incremental costs between an energy-efficient hydraulic oil and a standard hydraulic oil should be used.

### LOADSHAPE

Loadshape C14: Indust. 1-shift (8/5) (e.g., comp. air, lights)

Loadshape C15: Indust. 2-shift (16/5) (e.g., comp. air, lights)

Loadshape C16: Indust. 3-shift (24/5) (e.g., comp. air, lights)

Loadshape C17: Indust. 4-shift (24/7) (e.g., comp. air, lights)

### COINCIDENCE FACTOR

No coincidence factor though it is noted that reduced consumption for equipment will reduce the overall baseload power demand, especially if a construction operation or manufacturing operation demand more utility power in summer weather (e.g., construction ground work, rubber manufacturing, etc).

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

Savings are calculated based on a reduced coefficient of friction and the shear-stable high viscosity index value associated with energy-efficient hydraulic oils in hydraulic systems. The algorithm below for Energy Savings, is modeled after the Focus on Energy Emerging Technology Program M&V study.

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{MotorHP} * (0.746 \text{ kW/HP}) * (\% \text{MotorLoading} / \mu \text{Motor}) * \text{HOURS} * E_i$$

Where:

MotorHP = Rated horsepower of electric motor, summed when pumps are in series.  
 = Actual

%MotorLoading = Is dependent upon many factors including the part being manufactured, the polymer, the machine’s specifications, and cycle time.  
 = Actual, calculated as (Average load / Full rated load)  
 = Estimated as 75%.<sup>1349</sup>

$\mu$ Motor = Motor efficiency  
 = Actual. If unknown, estimated as 92% for motors in size range typically used.<sup>1350</sup>

HOURS = Hours of operation per year  
 = Actual

E<sub>i</sub> = Efficiency improvement due to use of energy efficient hydraulic oils  
 = Actual. If not measured, assume 3.3%.<sup>1351</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

O&M savings from the necessary standard oil replacement over the lifetime of the energy efficient hydraulic oil (including oil cost, disposal costs, labor and avoided downtime) should be calculated. If additional savings for improved pump and valve lifetime can be demonstrated, these can also be included.

<sup>1349</sup> Most electric motors are designed to run at 50% to 100% of rated load, from Department of Energy “Determining Electric Motor Load & Efficiency”, June 23, 2020.

<sup>1350</sup> Based on common size and type of motor - chart on pages 13-14, “Attachment C” of reference 9, the efficiency of a 50HP motor (TEFC type) at 1200 RPM is 92%. Or 75HP at 900 RPM at 75% TEFC type is 91.8%. These are common sizes and type for manufacturers.

<sup>1351</sup> Estimate based on review of a number of studies provided by ExxonMobil and saved in reference folders.

An example O&M cost calculation is provided below, relating to the standard hydraulic oil requiring 1 change out per year:

O&M Component	Cost
Oil cost	\$800
Oil disposal cost	\$80
Labor (4 hours per change at \$40/hr)	\$160
Downtime Production cost (2 hours at \$500 lost production cost per year)	\$1000
Total annual O&M benefit (1 change per year)	\$2040

**MEASURE CODE: CI-MSC-EEHO-V01-210101**

**REVIEW DEADLINE: 1/1/2022**

## 4.8.21 Energy Efficient Gear Lubricants - Provisional Measure

### DESCRIPTION

Industrial gear reduction systems use gear oil to transfer input energy to output power. Gear oils also protect critical components from premature wear. Energy efficient gear oil lubricants meet these requirements and provide reduced energy consumption. Energy efficient gear oils have a lower coefficient of friction which reduces the friction between two moving parts (rotating pump equipment and hydraulic oil). This lower coefficient of friction reduces the energy required to yield output power. Second, these oils have a high viscosity index which reduces the effect temperature has on the viscosity of the hydraulic oil. The high viscosity index allows constant viscosity over a range of operating temperatures which optimizes volumetric and mechanical efficiency at the pumps rated output. Additionally, energy efficient gear oils reduce the operating temperature of the gear-reduction gearbox.

Manufacturers who use electric-motor-driven gear-reduction gearboxes can reduce energy consumption by up to 1% per gear-mesh (e.g., 3% efficiency for a 3-reduction gearbox).

This measure was developed to be applicable to the following program types: NC, TOS and RF. If applied to other program types, the measure should be verified as a custom measure.

### DEFINITION OF EFFICIENT EQUIPMENT

This is applicable for small, medium, and large manufacturers in all climate zones using electric motors to power their gear reduction system both inside and/or outside conditioned areas; or for all gear reduction systems on mobile equipment in all climate zones on Illinois.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is defined as a gearbox using non-energy efficient industrial gear lubricants which provides no energy efficiency benefits. In the formula below, the baseline equipment is where,  $E_i = \text{zero}$ .

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.

The ability to reduce energy consumption (energy efficiency) is an inherent characteristic in the oil which does not deplete over time. As long as the energy efficient oil is in use, it will provide energy efficiency.

### DEEMED MEASURE COST

The actual incremental costs between an energy-efficient and a standard gear lubricant should be used.

### LOADSHAPE

Loadshape C14: Indust. 1-shift (8/5) (e.g., comp. air, lights)  
Loadshape C15: Indust. 2-shift (16/5) (e.g., comp. air, lights)  
Loadshape C16: Indust. 3-shift (24/5) (e.g., comp. air, lights)  
Loadshape C17: Indust. 4-shift (24/7) (e.g., comp. air, lights)

### COINCIDENCE FACTOR

No coincidence factor though it is noted that reduced consumption for equipment will reduce the overall baseload power demand, especially if a construction operation or manufacturing operation demand more utility power in summer weather (e.g., construction ground work, rubber manufacturing, etc).

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

Savings are calculated based on a reduced coefficient of friction and the shear-stable high viscosity index value associated with energy-efficient gear oils in gear-reduction systems. The algorithm below for Energy Savings is modeled after the Focus on Energy Emerging Technology Program M&V study.

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \text{MotorHP} * (0.746 \text{ kW/HP}) * (\% \text{MotorLoading} / \mu \text{Motor}) * \text{HOURS} * E_i$$

Where:

MotorHP = Rated horsepower of electric motor, summed when pumps are in series.  
 = Actual

%MotorLoading = Is dependent upon many factors including the part being manufactured, the polymer, the machine's specifications, and cycle time.  
 = Actual, calculated as (Average load / Full rated load)  
 = Estimated as 75%.<sup>1352</sup>

$\mu$ Motor = Motor efficiency  
 = Actual. If unknown, estimated as 92% for motors in size range typically used.<sup>1353</sup>

HOURS = Hours of operation per year  
 = Actual

E<sub>i</sub> = Efficiency improvement due to use of energy efficient hydraulic oils  
 = Actual. If not measured, assume 1% per gear mesh.<sup>1354</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

O&M savings from the necessary standard oil replacement over the lifetime of the energy efficient gear oil (including oil cost, disposal costs, labor and avoided downtime) should be calculated. If additional savings for improved gear box lifetime can be demonstrated, these can also be included.

<sup>1352</sup> Most electric motors are designed to run at 50% to 100% of rated load, from Department of Energy "Determining Electric Motor Load & Efficiency", June 23, 2020.

<sup>1353</sup> Based on common size and type of motor - chart on pages 13-14, "Attachment C" of reference 9, the efficiency of a 50HP motor (TEFC type) at 1200 RPM is 92%. Or 75HP at 900 RPM at 75% TEFC type is 91.8%. These are common sizes and type for manufacturers.

<sup>1354</sup> Estimate based on review of a number of studies provided by ExxonMobil and saved in reference folders.

**MEASURE CODE: CI-MSC-EEGL-V01-210101**

**REVIEW DEADLINE: 1/1/2022**

## 4.8.22 Smart Sockets – Provisional Measure

### DESCRIPTION

Smart sockets achieve savings through the reduction of the standby load of the controlled appliance, as well as eliminating the operation of an appliance during unoccupied hours. The standby power consumption of home appliances and office equipment can be significantly reduced.

In a commercial office space, significant opportunity exists for savings from the reduction of plug loads, with power strips and timers being a key energy saving measure.<sup>1355</sup> Savings from smart sockets generally occurs during off-hours, when connected equipment continues to consume electricity while in standby mode or when off. Savings may also be achieved through the more precise scheduling of the appliance, so that it is not operating during unoccupied hours, though those savings have not been attempted to be quantified within this summary.

Smart sockets are ideal for all types of plugged-in devices such as small appliances (coffee maker, office heater, etc.), in-wall AC units, large office equipment, outlet lights, digital signs, decorative lighting, televisions, etc, though they provide the greatest energy savings when installed on equipment with higher wattage and standby power consumption. In a commercial office space, the shared photocopier is often the largest stand-alone user of electricity, with the highest standby power draw, so an ideal candidate for use with a smart socket. Note that a dedicated power supply is critical for your office photocopier.<sup>1356</sup> Also, note that the electrical amperage rating of the smart socket should be verified to suit the connected equipment. Desktop computers with peripheral equipment may be better served by an advanced power strip.

This measure was developed to be applicable to the following program types: DI, KITS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is the use of a smart plug with a standby power wattage of 2W or less. Should be UL listed. (Simply Conserve Smart Socket SS-15A1-WiFi has a standby power of less than or equal to 0.7).

### DEFINITION OF BASELINE EQUIPMENT

The assumed baseline is an appliance or piece of office equipment plugged into an outlet (without a power strip) or into a standard power strip with surge protection that does not control connected loads.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the smart socket is 7 years.<sup>1357</sup>

### DEEMED MEASURE COST

For direct install, the actual full equipment and installation cost (including labor) and for kits the actual full equipment cost should be used. If unknown for kits, use \$9.00/each.<sup>1358</sup>

---

<sup>1355</sup> See Page 6 of New Buildings Institute, “Plug Load Savings Assessment: Part of the Evidence-based Design and Operations PIER Program,” California Energy Commission, Evidence-based Design and Operations PIER Program, March 2013.

<sup>1356</sup> From Ross Wiffler, “A Dedicated Power Supply is Critical for Your Office Copier”, Copiers & More, Small Business, Aug. 18<sup>th</sup>, 2015. <https://commonsensebusinesssolutions.com/a-dedicated-power-supply-is-critical-for-your-office-copier/>

<sup>1357</sup> This is an assumption consistent with 4.8.7 Advanced Power Strip – Tier 1 Commercial.

<sup>1358</sup> Based on cost from vendor of typical smart socket on the market, Simply Conserve Smart Socket by AM Conservation Group. 10 amp smart socket: \$8.92/each; 15 amp smart socket: \$9.00/each.

**LOADSHAPE**

Loadshape C47 – Standby Losses – Commercial Office<sup>1359</sup>

**COINCIDENCE FACTOR**

N/A due to no savings attributable to standby losses between 1 and 5 PM.

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh^{1360} = (((W_{Base} - W_{Eff}) * (hrs_{wkday} - hrs_{wkday-open})) + ((W_{Base} - W_{Eff}) * (hrs_{wkend} - hrs_{wkend-open}))) / 1000 * weeks/year * ISR$$

Where:

$W_{Base}$  = Standby power consumption of connected appliance.

Use actual if known, or refer to table below.

Controlled Equipment <sup>1361</sup>	Standby Power (W)
Television, CRT	3.06
Television, Rear Projection	6.97
Television, LCD <sup>1362</sup>	8.00
Set-top Box, DVR	36.68
Set-top Box, Digital Cable	17.83
Set-top Box, Satellite	15.66
Television/VCR	5.99
VCR	4.68
Computer, Desktop	2.84
Computer Notebook	8.90
Multifunction Device, Inkjet	5.26
Multifunction Device, Laser	3.12
Scanner, Flatbed	2.48

<sup>1359</sup> As referenced in 4.8.7 Advanced Power Strip – Tier 1 Commercial, Loadshapes were calculated from empirical studies and compared to the existing loadshape in Volume 1, Table 3.5. The studies were:

Acker, Brad *et al.*, “Office Space Plug Load Profiles and Energy Saving Interventions,” 2012 ACEEE Summer Study on Energy Efficiency in Buildings.

Sheppy, M. *et al.*, “Reducing Plug Loads in Office Spaces” Hawaii and Guam Energy Improvement Technology Demonstration Project, NREL/NAVFAC (January 2014).

<sup>1360</sup> Savings algorithm reconstructed from weekday and weekend savings information in Acker, Brad *et al.*, “Office Space Plug Load Profiles and Energy Saving Interventions,” 2012 ACEEE Summer Study on Energy Efficiency in Buildings, and verified against savings in Acker *et al.* and savings in: BPA, “Smart Power Strip Energy Savings Evaluation: Ross Complex,” (2011). Office stations are assumed to have zero or minimal standby losses during normal operating hours. Method shown in “Commercial Tier 1 APS Calculations – IL TRM.xlsx”.

<sup>1361</sup> See Standby Power Summary Table contained in “Standby Power”, Lawrence Berkeley National Laboratory, Building Technology and Urban Systems Division, <https://standby.lbl.gov/data/summary-table/>

<sup>1362</sup> From “iTECH evaluation on the SmartSocket,” ITECH Electronic Co., LTD, 1/28/19. IoT – Related Technical Articles. <https://www.itechate.com/uploadfiles/2019/01/201901281143214321.pdf>.



$W_{Eff}$	= Standby power consumption of smart socket. If unknown, assume 2W.
$hr_{S_{wkday}}$	= total hours during the work week (Monday 7:30 AM to Friday 5:30 PM) = 106
$hr_{S_{wkend}}$	= total hours during the weekend (Friday 5:30 PM to Monday 7:30 AM) = 62
$hr_{S_{wkday-open}}$	= hours the office is open during the work week. If unknown, assume 50 hours.
$hr_{S_{wkend-open}}$	= hours the office is open during the weekend. If unknown, assume 0 hours.
weeks/year	= number of weeks per year = 52.2
ISR	= In Service Rate = Assume 0.969 for commercial Direct Install application <sup>1363</sup> = Assume 0.28 for kits <sup>1364</sup>

**For example**, an office open 10 hours per day (50 hours per week) on weekdays and closed on weekends:

$$\begin{aligned} \Delta kWh &= (((8 - 2) * (106 - 50)) + ((8 - 2) * (62 - 0))) / 1000 * 52.2 * 0.969 \\ &= 35.81 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A due to no savings attributable to standby losses between 1 and 5 PM.

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: CI-MSC-SSOC-V01-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>1363</sup> Based upon review of the PY2 and PY3 ComEd Direct Install Residential program surveys. This value could be modified based upon commercial application evaluation.

<sup>1364</sup> This is a conservative estimate as a placeholder until more information becomes available. This ISR is based on taking half of the value of ISR value for kits for Advanced Power Strips – Tier 1, which has ISR=56%. More specific data will become available during 2020, as this measure is included within ComEd SB EE Kits program, and survey data will be obtained.

**2021 Illinois Statewide Technical  
Reference Manual for Energy Efficiency  
Version 9.0**

**Volume 3: Residential Measures**

**FINAL**

**September 25, 2020**

**Effective:  
January 1, 2021**

[INTENTIONALLY LEFT BLANK]

**VOLUME 1: OVERVIEW AND USER GUIDE**

**VOLUME 2: COMMERCIAL AND INDUSTRIAL MEASURES**

**VOLUME 3: RESIDENTIAL MEASURES..... 6**

**5.1 Appliances End Use..... 6**

- 5.1.1 ENERGY STAR Air Purifier/Cleaner ..... 6
- 5.1.2 ENERGY STAR Clothes Washers ..... 9
- 5.1.3 ENERGY STAR Dehumidifier ..... 16
- 5.1.4 ENERGY STAR Dishwasher ..... 20
- 5.1.5 ENERGY STAR Freezer..... 25
- 5.1.6 ENERGY STAR and CEE Tier 2 Refrigerator..... 29
- 5.1.7 ENERGY STAR Room Air Conditioner ..... 34
- 5.1.8 Refrigerator and Freezer Recycling ..... 39
- 5.1.9 Room Air Conditioner Recycling..... 44
- 5.1.10 ENERGY STAR Clothes Dryer..... 47
- 5.1.11 ENERGY STAR Water Coolers ..... 51
- 5.1.12 Ozone Laundry ..... 54
- 5.1.13 Income Qualified: ENERGY STAR Room Air Conditioner ..... 59

**5.2 Consumer Electronics End Use..... 63**

- 5.2.1 Advanced Power Strip – Tier 1..... 63
- 5.2.2 Tier 2 Advanced Power Strips (APS) – Residential Audio Visual..... 67

**5.3 HVAC End Use..... 71**

- 5.3.1 Air Source Heat Pump ..... 71
- 5.3.2 Boiler Pipe Insulation ..... 86
- 5.3.3 Central Air Conditioning ..... 90
- 5.3.4 Duct Insulation and Sealing ..... 97
- 5.3.5 Furnace Blower Motor ..... 111
- 5.3.6 Gas High Efficiency Boiler ..... 116
- 5.3.7 Gas High Efficiency Furnace..... 120
- 5.3.8 Ground Source Heat Pump ..... 125
- 5.3.9 High Efficiency Bathroom Exhaust Fan..... 139
- 5.3.10 HVAC Tune Up (Central Air Conditioning or Air Source Heat Pump) ..... 142
- 5.3.11 Programmable Thermostats..... 146
- 5.3.12 Ductless Heat Pumps ..... 151
- 5.3.13 Residential Furnace Tune-Up ..... 163

5.3.14	Boiler Reset Controls .....	166
5.3.15	ENERGY STAR Ceiling Fan .....	169
5.3.16	Advanced Thermostats .....	174
5.3.17	Gas High Efficiency Combination Boiler .....	183
5.3.18	Furnace Filter Alarm – Provisional Measure .....	187
5.3.19	Thermostatic Radiator Valves – Provisional Measure .....	188
<b>5.4</b>	<b>Hot Water End Use .....</b>	<b>191</b>
5.4.1	Domestic Hot Water Pipe Insulation .....	191
5.4.2	Gas Water Heater.....	195
5.4.3	Heat Pump Water Heaters.....	200
5.4.4	Low Flow Faucet Aerators .....	207
5.4.5	Low Flow Showerheads.....	217
5.4.6	Water Heater Temperature Setback .....	224
5.4.7	Water Heater Wrap.....	228
5.4.8	Thermostatic Restrictor Shower Valve .....	231
5.4.9	Shower Timer.....	238
5.4.10	Pool Covers .....	243
5.4.11	Drain Water Heat Recovery.....	247
<b>5.5</b>	<b>Lighting End Use .....</b>	<b>252</b>
5.5.1	Compact Fluorescent Lamp (CFL)—Retired 12/31/2018, Removed in v8 .....	252
5.5.2	ENERGY STAR Specialty Compact Fluorescent Lamp (CFL)—Retired 12/31/2018, Removed in v8.....	252
5.5.3	ENERGY STAR Torchiere—Retired 12/31/2018, Removed in v8 .....	252
5.5.4	Exterior Hardwired Compact Fluorescent Lamp (CFL) Fixture—Retired 12/31/2018, Removed in v8..	252
5.5.5	Interior Hardwired Compact Fluorescent Lamp (CFL) Fixture—Retired 12/31/2018, Removed in v8..	252
5.5.6	LED Specialty Lamps .....	253
5.5.7	LED Exit Signs .....	266
5.5.8	LED Screw Based Omnidirectional Bulbs .....	271
5.5.9	LED Fixtures .....	281
5.5.10	Holiday String Lighting .....	289
5.5.11	LED Nightlights .....	294
5.5.12	Connected LED Lamps.....	299
<b>5.6</b>	<b>Shell End Use .....</b>	<b>304</b>
5.6.1	Air Sealing.....	304
5.6.2.	Basement Sidewall Insulation.....	318

5.6.3.	Floor Insulation Above Crawlspace .....	326
5.6.4.	Wall Insulation .....	334
5.6.5.	Ceiling/Attic Insulation .....	342
5.6.6.	Rim/Band Joist Insulation .....	351
5.6.7.	Low-E Storm Window .....	359
<b>5.7</b>	<b>Miscellaneous.....</b>	<b>364</b>
5.5.1	High Efficiency Pool Pumps.....	364
5.5.2	Low Flow Toilets.....	369
5.5.3	Level 2 Electric Vehicle Charger .....	372

**VOLUME 4: CROSS-CUTTING MEASURES AND ATTACHMENTS**

## Volume 3: Residential Measures

### 5.1 Appliances End Use

#### 5.1.1 ENERGY STAR Air Purifier/Cleaner

##### DESCRIPTION

An air purifier (cleaner) meeting the efficiency specifications of ENERGY STAR is purchased and installed in place of a model meeting the current federal standard.

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

##### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as an air purifier meeting the efficiency specifications of ENERGY STAR as provided below.

- Must produce a minimum 30 Clean Air Delivery Rate (CADR) for Smoke<sup>1</sup> to be considered under this specification. Minimum Performance Requirement is expressed in Smoke CADR/Watt and it shall be greater than or equal to the Minimum Smoke CADR/Watt Requirement shown in the table below:

CADR Range	CADR/W
$30 \leq \text{Smoke CADR} < 100$	1.9
$100 \leq \text{Smoke CADR} < 150$	2.4
$150 \leq \text{Smoke CADR} < 200$	2.9
$200 \leq \text{Smoke CADR}$	2.9

- “Partial On Mode” Requirements are to be calculated as per Section 3.4.1 of the Energy Star Eligibility Criteria<sup>2</sup>
- UL Safety Requirement: Models that emit ozone as a byproduct of air cleaning must meet UL Standard 867 (ozone production must not exceed 50ppb)

##### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a conventional unit<sup>3</sup> that does not meet ENERGY STAR Efficiency Requirements.<sup>4</sup>

##### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 9 years.<sup>5</sup>

<sup>1</sup> Measured according to the latest ANSI/AHAM AC-1 (AC-1) Standard

<sup>2</sup> ENERGY STAR® Product Specification for Room Air Cleaners - Eligibility Criteria Version 2.0, effective October 17, 2020.

<sup>3</sup> As defined as the average of non-ENERGY STAR products found in EPA research, 2011, ENERGY STAR Qualified Room Air Cleaner Calculator. See file "ENERGY STAR appliance\_calculator.xlsx".

<sup>4</sup> ENERGY STAR® Product Specification for Room Air Cleaners - Eligibility Criteria Version 2.0.

<sup>5</sup> ENERGY STAR Qualified Room Air Cleaner Calculator citing Appliance Magazine, Portrait of the U.S. Appliance Industry 1998.

**DEEMED MEASURE COST**

The incremental cost for this measure is dependent on the Air Purifier size in CADR of Smoke.<sup>6</sup>

Product Size	Smoke CADR/W	Average Purchase Cost (\$)	Average Incremental Cost (\$)
30 ≤ Smoke CADR < 100	1.90	\$82.49	\$8.44
100 ≤ Smoke CADR < 150	2.40	\$140.43	\$22.33
150 ≤ Smoke CADR < 200	2.90	\$349.00	\$92.34
200 ≤ Smoke CADR	2.90	\$264.49	\$44.50

**LOADSHAPE**

Loadshape C53 – Flat

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta\text{kWh} = \text{Annual Electrical Savings}$$

Where

Annual Electrical Savings = Electrical Savings in kWh, for the specific CADR range

Annual Unit Energy Savings are outlined in the table below:<sup>7</sup>

CADR Range	Electrical Savings (kWh)
30 ≤ Smoke CADR < 100	39
100 ≤ Smoke CADR < 150	95
150 ≤ Smoke CADR < 200	173
200 ≤ Smoke CADR	328

Assumptions considered for the table above are:

The baseline used to calculate savings was a Smoke CADR/W equivalent just under the ENERGY STAR V1.2 at a Dust CADR/W of 1.9. Calculations assume (1) Smoke CADR/W is equal to the Dust CADR/W divided by Dust CADR and multiplied by Smoke CADR. The measure lifetime Energy Cost Savings are calculated based on a lifetime of 9 years, per Appliance Magazine, Portrait of the U.S. Appliance Industry 1998.

---

<sup>6</sup> ENERGY STAR V2 Room Air Cleaners Data Package (October 11, 2019). See file “ENERGY STAR V2 Room Air Cleaners Data Package\_GH 05122020\_VEIC.xlsx”

<sup>7</sup> ENERGY STAR V2 Room Air Cleaners Data Package (October 11, 2019). See file “ENERGY STAR V2 Room Air Cleaners Data Package\_GH 05122020\_VEIC.xlsx”



**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$\Delta kWh$  = Gross customer annual kWh savings for the measure

Hours = Average hours of use per year  
 = 5844 hours<sup>8</sup>

CF = Summer Peak Coincidence Factor for measure  
 = 66.7%<sup>9</sup>

CADR Range	$\Delta kW$
$30 \leq \text{Smoke CADR} < 100$	0.005
$100 \leq \text{Smoke CADR} < 150$	0.011
$150 \leq \text{Smoke CADR} < 200$	0.020
$200 \leq \text{Smoke CADR}$	0.037

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

There are no operation and maintenance cost adjustments for this measure.<sup>10</sup>

**MEASURE CODE: RS-APL-ESAP-V04-210101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>8</sup> Consistent with ENERGY STAR Qualified Room Air Cleaner Calculator assumption of 16 hours per day (16 \* 365.25 = 5844).

<sup>9</sup> Assumes that the purifier usage is evenly spread throughout the year, therefore coincident peak is calculated as 5844/8766 = 66.7%.

<sup>10</sup> Some types of room air cleaners require filter replacement or periodic cleaning, but this is likely to be true for both efficient and baseline units and so no difference in cost is assumed.

## 5.1.2 ENERGY STAR Clothes Washers

### DESCRIPTION

This measure relates to the installation of a clothes washer meeting the ENERGY STAR or CEE Tier 2 minimum qualifications. Note if the DHW and dryer fuels of the installations are unknown (for example through a retail program) savings should be based on a weighted blend using RECS data (the resultant values (kWh, therms and gallons of water) are provided). The algorithms can also be used to calculate site specific savings where DHW and dryer fuels are known.

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Clothes washer must meet the ENERGY STAR or CEE Tier 2 minimum qualifications, as required by the program.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a standard sized clothes washer meeting the minimum federal baseline as of January 2018.<sup>11</sup>

Efficiency Level	Top Loading >2.5 Cu ft	Front Loading >2.5 Cu ft
Federal Standard	≥1.57 IMEF, ≤6.5 IWF	≥1.84 IMEF, ≤4.7 IWF
ENERGY STAR	≥2.06 IMEF, ≤4.3 IWF	≥2.76 IMEF, ≤3.2 IWF
CEE Tier 2	≥2.92 IMEF, ≤3.2 IWF	

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 14 years<sup>12</sup>

### DEEMED MEASURE COST

The incremental cost for an ENERGY STAR unit is assumed to be \$84 and for a CEE Tier 2 unit it is \$141.<sup>13</sup>

### DEEMED O&M COST ADJUSTMENTS

N/A

### LOADSHAPE

Loadshape R01 - Residential Clothes Washer

### COINCIDENCE FACTOR

The coincidence factor for this measure is 3.8%.<sup>14</sup>

<sup>11</sup> DOE Energy Conservation Standards for Clothes Washers, Appliance and Equipment Standard, 10 CFR Part 430.32(g)

<sup>12</sup> Based on DOE Life-Cycle Cost and Payback Period Excel-based analytical tool.

<sup>13</sup> Cost estimates are based on Navigant analysis for the Department of Energy (see IL\_TRM\_CW Analysis\_06202019.xlsx). This analysis looked at incremental cost and shipment data from manufacturers and the Association of Home Appliance Manufacturers and attempts to find the costs associated only with the efficiency improvements. The ENERGY STAR level in this analysis was made the baseline (as it is now equivalent), the CEE Tier 2 level was extrapolated based on equal rates. Note these assumptions should be reviewed as qualifying product becomes available.

<sup>14</sup> Calculated from Itron eShapes, 8760 hourly data by end use for Missouri, as provided by Ameren.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

1. Calculate clothes washer savings based on the Integrated Modified Energy Factor (IMEF).

The Integrated Modified Energy Factor (IMEF) includes unit operation, standby, water heating, and drying energy use: "IMEF is the quotient of the capacity of the clothes container, C, divided by the total clothes washer energy consumption per cycle, with such energy consumption expressed as the sum of the machine electrical energy consumption, M, the hot water energy consumption, E, the energy required for removal of the remaining moisture in the wash load, D, and the combined low-power mode energy consumption".<sup>15</sup>

The hot water and dryer savings calculated here assumes electric DHW and Dryer (this will be separated in Step 2).

$$\text{IMEFsavings}^{16} = \text{Capacity} * (1/\text{IMEFbase} - 1/\text{IMEFeff}) * \text{Ncycles}$$

Where

- Capacity = Clothes Washer capacity (cubic feet)  
= Actual. If capacity is unknown assume 3.50 cubic feet<sup>17</sup>
- IMEFbase = Integrated Modified Energy Factor of baseline unit  
= 1.75<sup>18</sup>
- IMEFeff = Integrated Modified Energy Factor of efficient unit  
= Actual. If unknown assume average values provided below.
- Ncycles = Number of Cycles per year  
= 295<sup>19</sup>

IMEFsavings is provided below based on deemed values:<sup>20</sup>

Efficiency Level	IMEF	IMEF Savings (kWh)
Federal Standard	1.75	0.0
ENERGY STAR	2.23	126.0

<sup>15</sup> Definition provided on the ENERGY STAR website.

<sup>16</sup> IMEFsavings represents total kWh only when water heating and drying are 100% electric.

<sup>17</sup> Based on the average clothes washer volume of all units that pass the new Federal Standard on the California Energy Commission (CEC) database of Clothes Washer products accessed on 05/03/2018. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>18</sup> Weighted average IMEF of Federal Standard rating for Front Loading and Top Loading units. Weighting is based upon the relative top v front loading percentage of available non-ENERGY STAR product in the CEC database (products accessed on 05/03/2018).

<sup>19</sup> Weighted average of clothes washer cycles per year (based on 2009 Residential Energy Consumption Survey (RECS) national sample survey of housing appliances section, state of Illinois. If utilities have specific evaluation results providing a more appropriate assumption for single-family or Multifamily homes, in a particular market, or geographical area then that should be used.

<sup>20</sup> IMEF values are the weighted average of the new ENERGY STAR specifications. Weighting is based upon the relative top v front loading percentage of available ENERGY STAR and CEE Tier 2 products in the CEC database. See "IL TRM\_CW Analysis\_06202019.xlsx" for the calculation.

Efficiency Level	IMEF	IMEF Savings (kWh)
CEE Tier 2	2.92	235.8

2. Break out savings calculated in Step 1 for electric DHW and electric dryer

$$\Delta kWh = [Capacity * 1/IMEF_{base} * Ncycles * (\%CW_{base} + (\%DHW_{base} * \%Electric\_DHW) + (\%Dryer_{base} * \%Electric\_Dryer))] - [Capacity * 1/IMEF_{eff} * Ncycles * (\%CW_{eff} + (\%DHW_{eff} * \%Electric\_DHW) + (\%Dryer_{eff} * \%Electric\_Dryer))]$$

Where:

**%CW** = Percentage of total energy consumption for Clothes Washer operation (different for baseline and efficient unit – see table below)

**%DHW** = Percentage of total energy consumption used for water heating (different for baseline and efficient unit – see table below)

**%Dryer** = Percentage of total energy consumption for dryer operation (different for baseline and efficient unit – see table below)

	Percentage of Total Energy Consumption <sup>21</sup>		
	%CW	%DHW	%Dryer
Baseline	8.1%	26.5%	65.4%
ENERGY STAR	5.8%	31.2%	63.0%
CEE Tier 2	13.9%	9.6%	76.5%

**%Electric\_DHW** = Percentage of DHW savings assumed to be electric

DHW fuel	%Electric_DHW
Electric	100%
Natural Gas	0%
Unknown	16% <sup>22</sup>

**%Electric\_Dryer** = Percentage of dryer savings assumed to be electric

Dryer fuel	%Electric_Dryer
Electric	100%
Natural Gas	0%
Unknown	38% <sup>23</sup>

Using the default assumptions provided above, the prescriptive savings for each configuration are presented below:

<sup>21</sup> The percentage of total energy consumption that is used for the machine, heating the hot water or by the dryer is different depending on the efficiency of the unit. Values are based on a weighted average of top loading and front loading units based on data from DOE Life-Cycle Cost and Payback Period Excel-based analytical tool. See “IL TRM\_CW Analysis\_06202019.xlsx” for the calculation.

<sup>22</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of Illinois. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>23</sup> Default assumption for unknown is based on percentage of homes with electric dryer from EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of Illinois. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

	ΔkWh								
	Electric DHW Electric Dryer	Gas DHW Electric Dryer	Electric DHW Gas Dryer	Gas DHW Gas Dryer	Electric DHW Unknown Dryer	Gas DHW Unknown Dryer	Unknown DHW Electric Dryer	Unknown DHW Gas Dryer	Unknown DHW Unknown Dryer
ENERGY STAR	126.0	114.6	32.5	21.0	68.3	56.8	116.3	22.8	58.6
CEE Tier 2	235.8	113.9	120.9	-1.0	164.9	43.0	132.9	18.0	61.9

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water \text{ total}}$$

Where

$$E_{water \text{ total}} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

$$= 5,010 \text{ for measures installed in all areas except Cook County}^{24}$$

$$= 2,937 \text{ for measures installed in Cook County}^{25,26}$$

Using defaults provided:

ENERGY STAR  $\Delta kWh_{water} = 1,259/1,000,000 * 5,010$  (2937 in Cook County)  
 = 6.3 kWh (3.7 in Cook County)

ENERGY STAR Most Efficient  $\Delta kWh_{water} = 2,157/1,000,000 * 5,010$  (2937 in Cook County)  
 = 10.8 kWh (6.3 in Cook County)

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$$\Delta kWh = \text{Energy Savings as calculated above. Note do not include the secondary savings in this}$$

<sup>24</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>25</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>26</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

calculation.

Hours = Assumed Run hours of Clothes Washer  
 = 295 hours<sup>27</sup>

CF = Summer Peak Coincidence Factor for measure.  
 = 0.038<sup>28</sup>

Using the default assumptions provided above, the prescriptive savings for each configuration are presented below:

	ΔkW								
	Electric DHW Electric Dryer	Gas DHW Electric Dryer	Electric DHW Gas Dryer	Gas DHW Gas Dryer	Electric DHW Unknown Dryer	Gas DHW Unknown Dryer	Unknown DHW Electric Dryer	Unknown DHW Gas Dryer	Unknown DHW Unknown Dryer
ENERGY STAR	0.0162	0.0148	0.0042	0.0027	0.0088	0.0073	0.0150	0.0029	0.0075
CEE Tier 3	0.0304	0.0147	0.0156	-0.0001	0.0212	0.0055	0.0171	0.0023	0.0080

**NATURAL GAS SAVINGS**

Break out savings calculated in Step 1 of electric energy savings (MEF savings) and extract Natural Gas DHW and Natural Gas dryer savings from total savings:

$$\Delta\text{Therm} = [(\text{Capacity} * 1/\text{IMEFbase} * \text{Ncycles} * ((\% \text{DHWbase} * \% \text{Natural Gas\_DHW} * \text{R\_eff}) + (\% \text{Dryerbase} * \% \text{Gas\_Dryer}))) - (\text{Capacity} * 1/\text{IMEFeff} * \text{Ncycles} * ((\% \text{DHWeff} * \% \text{Natural Gas\_DHW} * \text{R\_eff}) + (\% \text{Dryereff} * \% \text{Gas\_Dryer})))] * \text{Therm\_convert}$$

Where:

Therm\_convert = Conversion factor from kWh to Therm  
 = 0.03412

R\_eff = Recovery efficiency factor  
 = 1.26<sup>29</sup>

%Natural Gas\_DHW = Percentage of DHW savings assumed to be Natural Gas

DHW fuel	%Natural Gas_DHW
Electric	0%
Natural Gas	100%
Unknown	84% <sup>30</sup>

%Gas\_Dryer = Percentage of dryer savings assumed to be Natural Gas

<sup>27</sup> Based on a weighted average of 295 clothes washer cycles per year assuming an average load runs for one hour (2009 Residential Energy Consumption Survey (RECS) national sample survey of housing appliances section, Midwest Census Region, data for the state of Illinois)

<sup>28</sup> Calculated from Itron eShapes, 8760 hourly data by end use for Missouri, as provided by Ameren.

<sup>29</sup> To account for the different efficiency of electric and Natural Gas hot water heaters (gas water heater: recovery efficiencies ranging from 0.74 to 0.85 (0.78 used), and electric water heater with 0.98 recovery efficiency (see ENERGY STAR Waste Water Recovery Guidelines). Therefore a factor of 0.98/0.78 (1.26) is applied.

<sup>30</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of Illinois. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

Dryer fuel	%Gas_Dryer
Electric	0%
Natural Gas	100%
Unknown	62% <sup>31</sup>

Other factors as defined above.

Using the default assumptions provided above, the prescriptive savings for each configuration are presented below:

	ΔTherms								
	Electric DHW Electric Dryer	Gas DHW Electric Dryer	Electric DHW Gas Dryer	Gas DHW Gas Dryer	Electric DHW Unknown Dryer	Gas DHW Unknown Dryer	Unknown DHW Electric Dryer	Unknown DHW Gas Dryer	Unknown DHW Unknown Dryer
ENERGY STAR	0.0	0.5	3.2	3.7	2.0	2.5	0.4	3.6	2.4
CEE Tier 3	0.0	5.2	3.9	9.2	7.7	7.7	4.4	8.3	6.8

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water (gallons)} = \text{Capacity} * (\text{IWFbase} - \text{IWFeff}) * \text{Ncycles}$$

Where

ΔWater (gallons) = Water saved, in gallons

IWFbase = Integrated Water Factor of baseline clothes washer  
= 5.29<sup>32</sup>

IWFeff = Water Factor of efficient clothes washer  
= Actual. If unknown assume average values provided below.

Using the default assumptions provided above, the prescriptive water savings for each efficiency level are presented below:

Efficiency Level	IWF <sup>33</sup>	ΔWater (gallons per year)
Federal Standard	5.29	0.0
ENERGY STAR	4.04	1,295
ENERGY STAR Most Efficient	3.20	2,157

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>31</sup> Default assumption for unknown fuel is based on percentage of homes with gas dryer from EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of Illinois. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>32</sup> Weighted average IWF of Federal Standard rating for Front Loading and Top Loading units. Weighting is based upon the relative top v front loading percentage of available non-ENERGY STAR product in the CEC database (products accessed on 05/03/2018).

<sup>33</sup> IWF values are the weighted average of the new ENERGY STAR specifications. Weighting is based upon the relative top v front loading percentage of available ENERGY STAR and CEE Tier 2 products in the CEC database (products accessed on 05/03/2018). See "IL TRM\_CW Analysis\_06202019.xlsx" for the calculation.

**MEASURE CODE: RS-APL-ESCL-V08-200101**

**REVIEW DEADLINE: 1/1/2023**



### 5.1.3 ENERGY STAR Dehumidifier

#### DESCRIPTION

A dehumidifier meeting the minimum qualifying efficiency standard established by the current ENERGY STAR Version 5.0 (effective 10/31/2019) and ENERGY STAR Most Efficient 2020 Criteria (effective 01/01/2020) is purchased and installed in a residential setting in place of a unit that meets the minimum federal standard efficiency.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the new dehumidifier must meet the ENERGY STAR standards as defined below:

Equipment Specification	Product Capacity	ENERGY STAR Criteria	ENERGY STAR Most Efficient Criteria
	(Pints/Day)	(L/kWh)	(L/kWh)
Portable Dehumidifier	≤ 25	≥1.57	≥1.70
	>25 and ≤ 50	≥1.80	≥1.90
	>50 and < 155	≥3.30	≥3.40

Qualifying units shall be equipped with an adjustable humidistat control or shall require a remote humidistat control to operate. The Whole – Home option for Dehumidifiers was not included, due to the extremely limited availability of Qualified products on the market. As of May 5, 2020, there are zero models.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is defined as a new dehumidifier that meets the Code of Federal Regulations appliance federal efficiency standards. As of June 13, 2019, those are as defined below for Dehumidifiers:

Equipment Specification	Capacity (pints/day)	Federal Standard Criteria (L/kWh)
Portable Dehumidifier	≤25	≥1.30
	>25 and ≤ 50	≥1.60
	>50 and <155	≥2.80

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the measure is 12 years.<sup>34</sup> Analysis period is the same as the lifetime.

#### DEEMED MEASURE COST

The incremental cost is the difference in cost between a baseline and an ENERGY STAR qualified unit. Please see the table below for cost assumptions used:

<sup>34</sup> EPA Research, 2012; ENERGY STAR Appliance Calculator, Dehumidifier Section

Equipment Specification	ENERGY STAR	ENERGY STAR Most Efficient
Portable Dehumidifier	\$10 <sup>35</sup>	\$75 <sup>36</sup>

**LOADSHAPE**

Loadshape R12 - Residential - Dehumidifier

**COINCIDENCE FACTOR**

The coincidence factor is assumed to be 37% .<sup>37</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (((Avg Capacity * 0.473) / 24) * Hours) * (1 / (L/kWh\_Base) - 1 / (L/kWh\_Eff))$$

Where:

- Avg Capacity = Average capacity of the unit (pints/day)  
= Actual, if unknown assume capacity in each capacity range as provided in table below, or if capacity range unknown assume average.
- 0.473 = Constant to convert Pints to Liters
- 24 = Constant to convert Liters/day to Liters/hour
- Hours = Run hours per year  
= 1632<sup>38</sup>
- L/kWh = Liters of water per kWh consumed, as provided in tables above

Annual kWh usage and savings, for each capacity class and product type, are presented in the four tables below:

Portable Dehumidifiers					Annual kWh		
Capacity Range	Capacity Used <sup>39</sup>	Federal Standard Criteria	ENERGY STAR Criteria	ENERGY STAR Most Efficient	Federal Standard	ENERGY STAR	ENERGY STAR Most Efficient
(pints/day)	(pints/day)	(≥ L/kWh)	(≥ L/kWh)	(≥ L/kWh)			
≤25	20	1.30	1.57	1.70	495	410	378
>25 and ≤50	37.5	1.60	1.80	1.90	754	670	635
>50 and <155	102.5	2.80	3.30	3.40	1177	999	970
<b>Average<sup>40</sup></b>	38.9	1.54	1.75	1.86	813	714	673

<sup>35</sup> Based on incremental costs sourced from the 2016 ENERGY STAR Appliance Calculator and weighted by capacity based on ENERGY STAR qualified products, accessed on May 2019.

<sup>39</sup> Capacity Used in calculations for each bin is an average. See next footnote regarding overall average for Portable Dehumidifiers

Portable Dehumidifier		Energy Savings ( $\Delta$ kWh)	
Capacity Range (pints/day)	Capacity Used (pints/day)	ENERGY STAR	ENERGY STAR Most Efficient
$\leq 25$	20	85	116
$>25$ and $\leq 50$	37.5	84	119
$>50$ and $<155$	102.5	178	208
<b>Average</b>	38.9	99	140

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh/Hours * CF$$

Where:

Hours = Annual operating hours  
 = 1632 hours<sup>41</sup>

CF = Summer Peak Coincidence Factor for measure  
 = 0.37<sup>42</sup>

Summer coincident peak demand results for each capacity class are presented below:

Portable Dehumidifier Capacity Range (pints/day)	Annual Summer Peak Savings ( $\Delta$ kW)	
	ENERGY STAR	ENERGY STAR Most Efficient
$\leq 25$	0.019	0.027
$>25$ and $\leq 50$	0.019	0.027
$>50$ and $<155$	0.041	0.047
<b>Average</b>	0.023	0.032

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>37</sup> Assume usage is evenly distributed day vs. night, weekend vs. weekday and is used between April through the end of September (4392 possible hours). 1632 operating hours from ENERGY STAR Dehumidifier Calculator. Coincidence peak during summer peak is therefore 1632/4392 = 37.2%

<sup>38</sup> ENERGY STAR Dehumidifier Calculator; 24-hour operation over 68 days of the year.

<sup>39</sup> Capacity Used in calculations for each bin is an average. See next footnote regarding overall average for Portable Dehumidifiers

<sup>40</sup> Weighted Overall average based on ENERGY STAR Products List 2020 for Dehumidifiers, accessed May 2020. See sheet *ESTAR-2020-5* in file "ENERGY STAR Dehumidifier TRM Analysis\_2020.xlsx"

<sup>41</sup> Based on 68 days of 24 hour operation; ENERGY STAR Dehumidifier Calculator

<sup>42</sup> Assume usage is evenly distributed day vs. night, weekend vs. weekday and is used between April through the end of September (4392 possible hours). 1632 operating hours from ENERGY STAR Dehumidifier Calculator. Coincidence peak during summer peak is therefore 1632/4392 = 37.2%

**MEASURE CODE: RS-APL-ESDH-V08-210101**

**REVIEW DEADLINE: 1/1/2025**

## 5.1.4 ENERGY STAR Dishwasher

### DESCRIPTION

A standard or compact residential dishwasher meeting ENERGY STAR standards is installed in place of a model meeting the federal standard.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as a standard or compact dishwasher meeting the ENERGY STAR standards presented in the table below.

#### ENERGY STAR Requirements (Version 6.0, Effective January 29, 2016)

Dishwasher Type	Maximum kWh/year	Maximum gallons/cycle
Standard (≥ 8 place settings + six serving pieces)	270	3.5
Standard with Connected Functionality <sup>43</sup>	283	
Compact (< 8 place settings + six serving pieces)	203	3.1

### DEFINITION OF BASELINE EQUIPMENT

The baseline reflects the minimum federal efficiency standards for dishwashers effective May 30, 2013, as presented in the table below.

Dishwasher Type	Maximum kWh/year	Maximum gallons/cycle
Standard	307	5.0
Compact	222	3.5

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the measure is 11 years.<sup>44</sup>

### DEEMED MEASURE COST

The incremental cost for standard and compact dishwashers is provided in the table below:<sup>45</sup>

Dishwasher Type	Baseline Cost	ENERGY STAR Cost	Incremental Cost
Standard	\$255.63	\$331.30	\$75.67

<sup>43</sup> The new ENERGY STAR specification “establishes optional connected criteria for dishwashers. ENERGY STAR certified dishwashers with connected functionality offer favorable attributes for demand response programs to consider, since their peak energy consumption is relatively high, driven by water heating. ENERGY STAR certified dishwashers with connected functionality will offer consumers new convenience and energy-saving features, such as alerts for cycle completion and/or recommended maintenance, as well as feedback on the energy use of the product”. See ‘ENERGY STAR Residential Dishwasher Final Version 6.0 Cover Memo.pdf’. Calculated as per Version 6.0 specification; “ENERGY STAR Residential Dishwasher Version 6.0 Final Program Requirements.pdf”. Note that the potential for demand response and additional peak savings from units with Connected Functionality have not been explored. This could be a potential addition in a future version.

<sup>44</sup> Measure lifetime from California DEER. See file California DEER 2014-EUL Table - 2014 Update.xlsx.

<sup>45</sup> Costs are based on data from U.S. DOE, Final Rule Life-Cycle Cost (LCC) Spreadsheet. See file Residential Dishwasher Analysis\_Nov2017.xlsx for cost calculation details.

Dishwasher Type	Baseline Cost	ENERGY STAR Cost	Incremental Cost
Compact	\$290.13	\$308.62	\$18.49

**LOADSHAPE**

Loadshape R02 - Residential Dish Washer

**COINCIDENCE FACTOR**

The coincidence factor is assumed to be 2.6%.<sup>46</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh^{47} = ((kWh_{BASE} - kWh_{ESTAR}) * (\%kWh_{op} + (\%kWh_{heat} * \%Electric\_DHW)))$$

Where:

$kWh_{BASE}$  = Baseline kWh consumption per year

Dishwasher Type	Maximum kWh/year
Standard	307
Compact	222

$kWh_{ESTAR}$  = ENERGY STAR kWh annual consumption

Dishwasher Type	Maximum kWh/year
Standard	270
Standard with Connected Functionality	283
Compact	203

$\%kWh_{op}$  = Percentage of dishwasher energy consumption used for unit operation  
 =  $1 - 56\%$ <sup>48</sup>  
 = 44%

$\%kWh_{heat}$  = Percentage of dishwasher energy consumption used for water heating  
 =  $56\%$ <sup>49</sup>

$\%Electric\_DHW$  = Percentage of DHW savings assumed to be electric

---

<sup>46</sup> Calculated from Itron eShapes, 8760 hourly data by end use for Missouri, as provided by Ameren.

<sup>47</sup> The Federal Standard and ENERGY STAR annual consumption values include electric consumption for both the operation of the machine and for heating the water that is used by the machine.

<sup>48</sup> ENERGY STAR Appliance Calculator.

<sup>49</sup> Ibid.

DHW fuel	%Electric_DHW
Electric	100%
Natural Gas	0%
Unknown	16% <sup>50</sup>

Dishwasher Type	ΔkWh		
	With Electric DHW	With Gas DHW	With Unknown DHW
ENERGY STAR Standard	37.0	16.3	19.6
ENERGY STAR Standard with Connected Functionality	24.0	10.6	12.7
ENERGY STAR Compact	19.0	8.4	10.1

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water total}$$

Where

$$E_{water total} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

$$= 5,010 \text{ for measures installed in all areas except Cook County}^{51}$$

$$= 2,937 \text{ for measures installed in Cook County}^{52,53}$$

Using defaults provided:

Standard	$\Delta kWh_{water}$	= 252/1,000,000*5,010 (2,937 for Cook County)
		= 1.3 kWh (0.7 for Cook County)
Compact	$\Delta kWh_{water}$	= 67/1,000,000*5,010 (2,937 for Cook County)
		= 0.3 kWh (0.2 for Cook County)

<sup>50</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>51</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>52</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>53</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS<sup>54</sup>**

$$\Delta kW = \Delta kWh/Hours * CF$$

Where:

$\Delta kWh$  = Annual kWh savings from measure as calculated above. Note do not include the secondary savings in this calculation.

Hours = Annual operating hours<sup>55</sup>  
 = 353 hours

CF = Summer Peak Coincidence Factor  
 = 2.6%<sup>56</sup>

Dishwasher Type	$\Delta kW$		
	With Electric DHW	With Gas DHW	With Unknown DHW
ENERGY STAR Standard	0.0027	0.0012	0.0014
ENERGY STAR Standard with Connected Functionality	0.0018	0.0008	0.0009
ENERGY STAR Compact	0.0014	0.0006	0.0007

**NATURAL GAS SAVINGS**

$$\Delta Therm = (kWh_{Base} - kWh_{ESTAR}) * \%kWh_{heat} * \%Natural\ Gas\_DHW * R_{eff} * 0.03412$$

Where

$\%kWh_{heat}$  = % of dishwasher energy used for water heating  
 = 56%

$\%Natural\ Gas\_DHW$  = Percentage of DHW savings assumed to be Natural Gas

DHW fuel	$\%Natural\ Gas\_DHW$
Electric	0%
Natural Gas	100%
Unknown	84% <sup>57</sup>

$R_{eff}$  = Recovery efficiency factor  
 = 1.26<sup>58</sup>

0.03412 = factor to convert from kWh to Therm

<sup>54</sup> Note that the potential for demand response and additional peak savings from units with Connected Functionality have not been explored. This could be a potential addition in a future version.

<sup>55</sup> Assuming 2.1 hours per cycle and 168 cycles per year therefore 353 operating hours per year. 168 cycles per year is based on a weighted average of dishwasher usage in Illinois derived from the 2009 RECs data.

<sup>56</sup> End use data from Ameren representing the average DW load during peak hours/peak load.

<sup>57</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>58</sup> To account for the different efficiency of electric and natural gas hot water heaters (gas water heater: recovery efficiencies ranging from 0.74 to 0.85 (0.78 used), and electric water heater with 0.98 recovery efficiency (see ENERGY STAR Waste Water Heat Recovery Guidelines). Therefore a factor of 0.98/0.78 (1.26) is applied.



Dishwasher Type	ΔTherms		
	With Electric DHW	With Gas DHW	With Unknown DHW
ENERGY STAR Standard	0.00	0.89	0.75
ENERGY STAR Standard with Connected Functionality	0.00	0.58	0.49
ENERGY STAR Compact	0.00	0.46	0.38

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water (gallons)} = \text{Water}_{\text{Base}} - \text{Water}_{\text{EFF}}$$

Where

$\text{Water}_{\text{Base}}$  = water consumption of conventional unit

Dishwasher Type	$\text{Water}_{\text{Base}}$ (gallons) <sup>59</sup>
Standard	840
Compact	588

$\text{Water}_{\text{EFF}}$  = annual water consumption of efficient unit:

Dishwasher Type	$\text{Water}_{\text{EFF}}$ (gallons) <sup>60</sup>
Standard	588
Compact	521

Dishwasher Type	ΔWater (gallons)
ENERGY STAR Standard	252
ENERGY STAR Compact	67

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-ESDI-V06-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>59</sup> Assuming maximum allowed from specifications and 168 cycles per year based on a weighted average of dishwasher usage in Illinois derived from the 2009 RECs data.

<sup>60</sup> Assuming maximum allowed from specifications and 168 cycles per year based on a weighted average of dishwasher usage in Illinois derived from the 2009 RECs data.

### 5.1.5 ENERGY STAR Freezer

#### DESCRIPTION

A freezer meeting the efficiency specifications of ENERGY STAR is installed in place of a model meeting the federal standard (NAECA). Energy usage specifications are defined in the table below (note, AV is the freezer Adjusted Volume and is calculated as 1.73\*Total Volume):

Product Category	Volume (cubic feet)	Assumptions after September 2014	
		Federal Baseline Maximum Energy Usage in kWh/year <sup>61</sup>	ENERGY STAR Maximum Energy Usage in kWh/year <sup>62</sup>
Upright Freezers with Manual Defrost	7.75 or greater	5.57*AV + 193.7	5.01*AV + 174.3
Upright Freezers with Automatic Defrost	7.75 or greater	8.62*AV + 228.3	7.76*AV + 205.5
Chest Freezers and all other Freezers except Compact Freezers	7.75 or greater	7.29*AV + 107.8	6.56*AV + 97.0
Compact Upright Freezers with Manual Defrost	< 7.75 and 36 inches or less in height	8.65*AV + 225.7	7.79*AV + 203.1
Compact Upright Freezers with Automatic Defrost	< 7.75 and 36 inches or less in height	10.17*AV + 351.9	9.15*AV + 316.7
Compact Chest Freezers	<7.75 and 36 inches or less in height	9.25*AV + 136.8	8.33*AV + 123.1

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as a freezer meeting the efficiency specifications of ENERGY STAR, as defined below and calculated above:

Equipment	Volume	Criteria
Full Size Freezer	7.75 cubic feet or greater	At least 10% more energy efficient than the minimum federal government standard (NAECA).
Compact Freezer	Less than 7.75 cubic feet and 36 inches or less in height	At least 20% more energy efficient than the minimum federal government standard (NAECA).

#### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a model that meets the federal minimum standard for energy efficiency. The standard varies depending on the size and configuration of the freezer (chest freezer or upright freezer, automatic or manual defrost) and is defined in the table above.

<sup>61</sup> See Department of Energy Federal Standards.

<sup>62</sup> See Version 5.0 ENERGY STAR specification.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 22 years.<sup>63</sup>

**DEEMED MEASURE COST**

The incremental cost for this measure is \$35.<sup>64</sup>

**LOADSHAPE**

Loadshape R04 - Residential Freezer

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is assumed to be 95%.<sup>65</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS:**

$$\Delta kWh = kWh_{BASE} - kWh_{ESTAR}$$

Where:

$kWh_{BASE}$  = Baseline kWh consumption per year as calculated in algorithm provided in table above.

$kWh_{ESTAR}$  = ENERGY STAR kWh consumption per year as calculated in algorithm provided in table above.

**For example** for a 7.75 cubic foot Upright Freezers with Manual Defrost purchased after September 2014:

$$\begin{aligned} \Delta kWh &= (5.57 * (7.75 * 1.73) + 193.7) - (5.01 * (7.75 * 1.73) + 174.3) \\ &= 268.4 - 241.5 \\ &= 26.9 \text{ kWh} \end{aligned}$$

If volume is unknown, use the following default values:

Product Category	Volume Used <sup>66</sup>	Assumptions after September 2014		
		$kWh_{BASE}$	$kWh_{ESTAR}$	kWh Savings
Upright Freezers with Manual Defrost	27.9	349.2	314.2	35.0
Upright Freezers with Automatic Defrost	27.9	469.0	422.2	46.8
Chest Freezers and all other Freezers except Compact Freezers	27.9	311.4	280.2	31.2
Compact Upright Freezers with Manual Defrost	10.4	467.2	420.6	46.6

<sup>63</sup> Based on [2011 DOE Rulemaking Technical Support Document](#), as recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

<sup>64</sup> Based on review of data from the Northeast Regional ENERGY STAR Consumer Products Initiative; ‘2009 ENERGY STAR Appliances Practices Report’, submitted by Lockheed Martin, December 2009.

<sup>65</sup> Based on eShapes Residential Freezer load data as provided by Ameren.

<sup>66</sup> Volume is based on ENERGY STAR Calculator assumption of 16.14 ft<sup>3</sup> average volume, converted to Adjusted volume by multiplying by 1.73.

Product Category	Volume Used <sup>66</sup>	Assumptions after September 2014		
		kWh <sub>BASE</sub>	kWh <sub>ESTAR</sub>	kWh Savings
Compact Upright Freezers with Automatic Defrost	10.4	635.9	572.2	63.7
Compact Chest Freezers	10.4	395.1	355.7	39.4

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$\Delta kWh$  = Gross customer annual kWh savings for the measure

Hours = Full Load hours per year  
 = 5890<sup>67</sup>

CF = Summer Peak Coincident Factor  
 = 0.95<sup>68</sup>

**For example**, for a 7.75 cubic foot Upright Freezers with Manual Defrost:

$$\Delta kW = 26.9 / 5890 * 0.95$$

$$= 0.0043 \text{ kW}$$

If volume is unknown, use the following default values:

Product Category	Assumptions after September 2014
	kW Savings
Upright Freezers with Manual Defrost	0.0057
Upright Freezers with Automatic Defrost	0.0076
Chest Freezers and all other Freezers except Compact Freezers	0.0050
Compact Upright Freezers with Manual Defrost	0.0075
Compact Upright Freezers with Automatic Defrost	0.0103
Compact Chest Freezers	0.0064

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>67</sup> Calculated from eShapes Residential Freezer load data as provided by Ameren by dividing total annual load by the maximum kW in any one hour.

<sup>68</sup> Based on eShapes Residential Freezer load data as provided by Ameren.

**MEASURE CODE: RS-APL-ESFR-V03-190101**

**REVIEW DEADLINE: 1/1/2023**

### 5.1.6 ENERGY STAR and CEE Tier 2 Refrigerator

#### DESCRIPTION

This measure relates to:

- a) Time of Sale: the purchase and installation of a new refrigerator meeting either ENERGY STAR or CEE TIER 2 specifications.
- b) Early Replacement: the early removal of an existing residential inefficient Refrigerator from service, prior to its natural end of life, and replacement with a new ENERGY STAR or CEE Tier 2 qualifying unit. Savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit and efficient unit consumption for the remainder of the measure life.

Energy usage specifications are defined in the table below (note, Adjusted Volume is calculated as the fresh volume + (1.63 \* Freezer Volume):

Product Category	Existing Unit	Assumptions after September 2014	
	Based on Refrigerator Recycling algorithm	Federal Baseline Maximum Energy Usage in kWh/year <sup>69</sup>	ENERGY STAR Maximum Energy Usage in kWh/year <sup>70</sup>
1. Refrigerators and Refrigerator-freezers with manual defrost	Use Algorithm in 5.1.8 Refrigerator and Freezer Recycling measure to estimate existing unit consumption	6.79AV + 193.6	6.11 * AV + 174.2
2. Refrigerator-Freezer--partial automatic defrost		7.99AV + 225.0	7.19 * AV + 202.5
3. Refrigerator-Freezers--automatic defrost with top-mounted freezer without through-the-door ice service and all-refrigerators--automatic defrost		8.07AV + 233.7	7.26 * AV + 210.3
4. Refrigerator-Freezers--automatic defrost with side-mounted freezer without through-the-door ice service		8.51AV + 297.8	7.66 * AV + 268.0
5. Refrigerator-Freezers--automatic defrost with bottom-mounted freezer without through-the-door ice service		8.85AV + 317.0	7.97 * AV + 285.3
5A Refrigerator-freezer—automatic defrost with bottom-mounted freezer with through-the-door ice service		9.25AV + 475.4	8.33 * AV + 436.3
6. Refrigerator-Freezers--automatic defrost with top-mounted freezer with through-the-door ice service		8.40AV + 385.4	7.56 * AV + 355.3
7. Refrigerator-Freezers--automatic defrost with side-mounted freezer with through-the-door ice service	8.54AV + 432.8	7.69 * AV + 397.9	

This measure was developed to be applicable to the following program types: TOS, NC, EREP.

If applied to other program types, the measure savings should be verified.

<sup>69</sup> See Department of Energy Federal Standards.

<sup>70</sup> See Version 5.0 ENERGY STAR specification.

### **DEFINITION OF EFFICIENT EQUIPMENT**

The efficient equipment is defined as a refrigerator meeting the efficiency specifications of ENERGY STAR or CEE Tier 2 (defined as requiring  $\geq 10\%$  or  $\geq 15\%$  less energy consumption than an equivalent unit meeting federal standard requirements respectively). The ENERGY STAR standard varies according to the size and configuration of the unit, as shown in table above.

### **DEFINITION OF BASELINE EQUIPMENT**

Time of Sale: baseline is a new refrigerator meeting the minimum federal efficiency standard for refrigerator efficiency. The current federal minimum standard varies according to the size and configuration of the unit, as shown in table above. Note also that this federal standard will be increased for units manufactured after September 1, 2014.

Early Replacement: the baseline is the existing refrigerator for the assumed remaining useful life of the unit and the new baseline as defined above for the remainder of the measure life.

### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 17 years.<sup>71</sup>

Remaining life of existing equipment is assumed to be 6 years.<sup>72</sup>

### **DEEMED MEASURE COST**

Time of Sale: The incremental cost for this measure is assumed to be \$40 for an ENERGY STAR unit<sup>73</sup> and \$140 for a CEE Tier 2 unit.<sup>74</sup>

Early Replacement: The measure cost is the full cost of removing the existing unit and installing a new one. The actual program cost should be used. If unavailable, assume \$451 for ENERGY STAR unit and \$551 for CEE Tier 2 unit.<sup>75</sup>

The avoided replacement cost (after 4 years) of a baseline replacement refrigerator is \$413.<sup>76</sup> This cost should be discounted to present value using the nominal societal discount rate.

### **LOADSHAPE**

Loadshape R05 - Residential Refrigerator

### **COINCIDENCE FACTOR**

A coincidence factor is not used to calculate peak demand savings for this measure, see below.

---

<sup>71</sup> [Based on 2011 DOE Rulemaking Technical Support Document](#), as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>72</sup> Standard assumption of one third of effective useful life.

<sup>73</sup> From ENERGY STAR calculator linked above.

<sup>74</sup> Based on weighted average of units participating in Efficiency Vermont program and retail cost data provided in Department of Energy, "TECHNICAL REPORT: Analysis of Amended Energy Conservation Standards for Residential Refrigerator-Freezers", October 2005.

<sup>75</sup> ENERGY STAR full cost is based upon IL PHA Efficient Living Program data on sample size of 910 replaced units finding average cost of \$430 plus an average recycling/removal cost of \$21. The CEE Tier 2 estimate uses the delta from the Time of Sale estimate.

<sup>76</sup> Calculated using incremental cost from Time of Sale measure and applying inflation rate of 1.91%.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS:**

Time of Sale:  $\Delta kWh = UEC_{BASE} - UEC_{EE}$

Early Replacement:

$\Delta kWh$  for remaining life of existing unit (1<sup>st</sup> 6 years) =  $UEC_{EXIST} - UEC_{EE}$

$\Delta kWh$  for remaining measure life (next 11 years) =  $UEC_{BASE} - UEC_{EE}$

Where:

$UEC_{EXIST}$  = Annual Unit Energy Consumption of existing unit as calculated in algorithm from 5.1.8 Refrigerator and Freezer Recycling measure.

$UEC_{BASE}$  = Annual Unit Energy Consumption of baseline unit as calculated in algorithm provided in table above.

$UEC_{EE}$  = Annual Unit Energy Consumption of ENERGY STAR unit as calculated in algorithm provided in table above.

For CEE Tier 2, unit consumption is calculated as 15% lower than baseline.

If volume is unknown, use the following defaults, based on an assumed Adjusted Volume of 25.8:<sup>77</sup>

Assumptions after standard changes on September 1<sup>st</sup>, 2014:

Product Category	Existing Unit $UEC_{EXIST}$ 78	New Baseline $UEC_{BASE}$	New Efficient $UEC_{EE}$		Early Replacement (1 <sup>st</sup> 6 years) $\Delta kWh$		Time of Sale and Early Replacement (last 11 years) $\Delta kWh$	
			ENERGY STAR	CEE T2	ENERGY STAR	CEE T2	ENERGY STAR	CEE T2
1. Refrigerators and Refrigerator-freezers with manual defrost	1027.7	368.6	331.6	313.3	696.1	714.5	36.9	55.3
2. Refrigerator-Freezer--partial automatic defrost	1027.7	430.9	387.8	366.3	640.0	661.5	43.1	64.6
3. Refrigerator-Freezers--automatic defrost with top-mounted freezer without through-the-door ice service and all-refrigerators--automatic defrost	814.5	441.7	397.4	375.4	417.2	439.1	44.3	66.2
4. Refrigerator-Freezers--automatic defrost with side-mounted freezer without through-the-door ice service	1241.0	517.1	465.4	439.5	775.6	801.4	51.7	77.6

<sup>77</sup> Volume is based on the ENERGY STAR calculator average assumption of 14.75 ft<sup>3</sup> fresh volume and 6.76 ft<sup>3</sup> freezer volume.

<sup>78</sup> Estimates of existing unit consumption are based on using the 5.1.8 Refrigerator and Freezer Recycling algorithm and the inputs described here: Age = 10 years, Pre-1990 = 0, Size = 21.5 ft<sup>3</sup> (from ENERGY STAR calc and consistent with AV of 25.8), Single Door = 0, Side by side = 1 for classifications stating side by side, 0 for classifications stating top/bottom, and 0.5 for classifications that do not distinguish, Primary appliances = 1, unconditioned = 0, Part use factor = 0.



Product Category	Existing Unit UEC <sub>EXIST</sub> <sup>78</sup>	New Baseline UEC <sub>BASE</sub>	New Efficient UEC <sub>EE</sub>		Early Replacement (1 <sup>st</sup> 6 years) ΔkWh		Time of Sale and Early Replacement (last 11 years) ΔkWh	
			ENERGY STAR	CEE T2	ENERGY STAR	CEE T2	ENERGY STAR	CEE T2
5. Refrigerator-Freezers-- automatic defrost with bottom-mounted freezer without through-the-door ice service	814.5	545.1	490.7	463.3	323.9	351.2	54.4	81.8
5A Refrigerator-freezer— automatic defrost with bottom-mounted freezer with through-the-door ice service	814.5	713.8	651.0	606.7	163.6	207.8	62.8	107.1
6. Refrigerator-Freezers-- automatic defrost with top- mounted freezer with through-the-door ice service	814.5	601.9	550.1	511.6	264.4	303.0	51.7	90.3
7. Refrigerator-Freezers-- automatic defrost with side- mounted freezer with through-the-door ice service	1241.0	652.9	596.1	554.9	644.9	686.0	56.8	97.9

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\Delta kWh/8766) * TAF * LSAF$$

Where:

TAF = Temperature Adjustment Factor  
= 1.25<sup>79</sup>

LSAF = Load Shape Adjustment Factor  
= 1.057<sup>80</sup>

If volume is unknown, use the following defaults:

<sup>79</sup> Average temperature adjustment factor (to account for temperature conditions during peak period as compared to year as a whole) based on Blasnik, Michael, "Measurement and Verification of Residential Refrigerator Energy Use, Final Report, 2003-2004 Metering Study", July 29, 2004 (p. 47). It assumes 90 °F average outside temperature during peak period, 71°F average temperature in kitchens and 65°F average temperature in basement, and uses assumption that 66% of homes in Illinois have central cooling (CAC saturation: "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey).

<sup>80</sup> Daily load shape adjustment factor (average load in peak period /average daily load) also based on Blasnik, Michael, "Measurement and Verification of Residential Refrigerator Energy Use, Final Report, 2003-2004 Metering Study", July 29, 2004 (p. 48, using the average Existing Units Summer Profile for hours 13 through 17)

Product Category	Assumptions after September 2014 standard change $\Delta kW$			
	Early Replacement (1 <sup>st</sup> 6 years)		Time of Sale and Early Replacement (last 11 years)	
	ENERGY STAR	CEE T2	ENERGY STAR	CEE T2
1. Refrigerators and Refrigerator-freezers with manual defrost	0.105	0.108	0.006	0.008
2. Refrigerator-Freezer--partial automatic defrost	0.096	0.100	0.006	0.010
3. Refrigerator-Freezers--automatic defrost with top-mounted freezer without through-the-door ice service and all-refrigerators--automatic defrost	0.063	0.066	0.007	0.010
4. Refrigerator-Freezers--automatic defrost with side-mounted freezer without through-the-door ice service	0.117	0.121	0.008	0.012
5. Refrigerator-Freezers--automatic defrost with bottom-mounted freezer without through-the-door ice service	0.049	0.053	0.008	0.012
5A Refrigerator-freezer—automatic defrost with bottom-mounted freezer with through-the-door ice service	0.025	0.031	0.009	0.016
6. Refrigerator-Freezers--automatic defrost with top-mounted freezer with through-the-door ice service	0.040	0.046	0.008	0.014
7. Refrigerator-Freezers--automatic defrost with side-mounted freezer with through-the-door ice service	0.097	0.103	0.009	0.015

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-ESRE-V08-200101**

**REVIEW DEADLINE: 1/1/2023**

### 5.1.7 ENERGY STAR Room Air Conditioner

#### DESCRIPTION

This measure relates to:

- a) Time of Sale the purchase and installation of a room air conditioning unit that meets ENERGY STAR version 4.0, which is effective October 26<sup>th</sup> 2015,<sup>81</sup> in place of a baseline unit. The baseline is based on the Federal Standard effective June 1<sup>st</sup>, 2014.

Product Type and Class (Btu/hr)		Federal Standard with louvered sides (CEER) <sup>82</sup>	Federal Standard without louvered sides (CEER)	ENERGY STAR v4.0 with louvered sides (CEER) <sup>83</sup>	ENERGY STAR v4.0 without louvered sides (CEER)
Without Reverse Cycle	< 8,000	11.0	10.0	12.1	11.0
	8,000 to 10,999	10.9	9.6	12.0	10.6
	11,000 to 13,999	10.9	9.5	12.0	10.5
	14,000 to 19,999	10.7	9.3	11.8	10.2
	20,000 to 27,999	9.4	9.4	10.3	10.3
	>=28,000	9.0	9.4	9.9	10.3
With Reverse Cycle	<14,000	9.8	9.3	10.8	10.2
	14,000 to 19,999	9.8	8.7	10.8	9.6
	>=20,000	9.3	8.7	10.2	9.6
Casement only		9.5		10.5	
Casement-Slider		10.4		11.4	

Side louvers extend from a room air conditioner model in order to position the unit in a window. A model without louvered sides is placed in a built-in wall sleeve and are commonly referred to as "through-the-wall" or "built-in" models.

Casement-only refers to a room air conditioner designed for mounting in a casement window of a specific size.

Casement-slider refers to a room air conditioner with an encased assembly designed for mounting in a sliding or casement window of a specific size.

Reverse cycle refers to the heating function found in certain room air conditioner models.

- b) Early Replacement: the early removal of an existing residential inefficient Room AC unit from service, prior to its natural end of life, and replacement with a new ENERGY STAR qualifying unit. Savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit and efficient unit consumption for the remainder of the measure life.

This measure was developed to be applicable to the following program types: TOS, NC, EREP.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the new room air conditioning unit must meet the ENERGY STAR version 4.0 (effective

<sup>81</sup> ENERGY STAR Version 4.0 Room Air Conditioners Program Requirements

<sup>82</sup> See DOE’s Appliance and Equipment Standards for Room AC;

<sup>83</sup> ENERGY STAR Version 4.0 Room Air Conditioners Program Requirements

October 26<sup>th</sup> 2015<sup>84</sup>) efficiency standards presented above.

**DEFINITION OF BASELINE EQUIPMENT**

Time of Sale: the baseline assumption is a new room air conditioning unit that meets the Federal Standard (effective June 1<sup>st</sup>, 2014)<sup>85</sup> efficiency standards as presented above.

Early Replacement: the baseline is the existing Room AC for the assumed remaining useful life of the unit and the new baseline as defined above for the remainder of the measure life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 12 years.<sup>86</sup>

Remaining life of existing equipment is assumed to be 4 years.<sup>87</sup>

**DEEMED MEASURE COST**

Time of Sale: The incremental cost for this measure is assumed to be \$40 for a ENERGY STAR unit.<sup>88</sup>

Early Replacement: The measure cost is the full cost of removing the existing unit and installing a new one. The actual program cost should be used. If unavailable assume \$448 for ENERGY STAR unit.<sup>89</sup>

The avoided replacement cost (after 4 years) of a baseline replacement unit is \$432.<sup>90</sup> This cost should be discounted to present value using the nominal societal discount rate.

**LOADSHAPE**

Loadshape R08 - Residential Cooling

**COINCIDENCE FACTOR**

The coincidence factor for this measure is assumed to be 0.3.<sup>91</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Time of Sale:  $\Delta kWh = (FLH_{RoomAC} * Btu/H * (1/CEERbase - 1/CEERee))/1000$

Early Replacment:

$\Delta kWh \text{ for remaining life of existing unit (1<sup>st</sup> 4 years)} = (FLH_{RoomAC} * Btu/H * (1/(EERexist/1.01) - 1/CEERee))/1000$

---

<sup>84</sup> ENERGY STAR Version 4.0 Room Air Conditioners Program Requirements

<sup>85</sup> See DOE’s Appliance and Equipment Standards for Room AC.

<sup>86</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

<sup>87</sup> Standard assumption of one third of effective useful life.

<sup>88</sup> Incremental cost based on field study conducted by Efficiency Vermont.

<sup>89</sup> Based on IL PHA Efficient Living Program Data for 810 replaced units showing \$416 per unit plus \$32 average recycling/removal cost.

<sup>90</sup> Estimate based upon Time of Sale incremental costs and applying inflation rate of 1.91%.

<sup>91</sup> Consistent with coincidence factors found in: RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

$$\Delta kWh \text{ for remaining measure life (next 8 years)} = (FLH_{RoomAC} * Btu/H * (1/CEER_{base} - 1/CEER_{ee}))/1000$$

Where:

$FLH_{RoomAC}$  = Full Load Hours of room air conditioning unit  
 = dependent on location:<sup>92</sup>

Climate Zone (City based upon)	$FLH_{RoomAC}$
1 (Rockford)	220
2 (Chicago)	210
3 (Springfield)	319
4 (Belleville)	428
5 (Marion)	374
Weighted Average <sup>93</sup>	248

Btu/H = Size of rebated unit  
 = Actual. If unknown assume 8500 Btu/hr<sup>94</sup>

EER<sub>exist</sub> = Efficiency of existing unit  
 = Actual. If unknown assume 7.7<sup>95</sup>

1.01 = Factor to convert EER to CEER (CEER includes standby and off power consumption)<sup>96</sup>

CEER<sub>base</sub> = Combined Energy Efficiency Ratio of baseline unit  
 = As provided in tables above

CEER<sub>ee</sub> = Combined Energy Efficiency Ratio of ENERGY STAR unit  
 = Actual. If unknown, assume minimum qualifying standard as provided in tables above

<sup>92</sup> Full load hours for room AC is significantly lower than for central AC. The average ratio of FLH for Room AC (provided in RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008) to FLH for Central Cooling for the same location is 31%. This ratio is applied to those IL cities that have FLH for Central Cooling provided in the ENERGY STAR calculator. For other cities this is extrapolated using the FLH assumptions VEIC have developed for Central AC. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>93</sup> Weighted based on number of residential occupied housing units in each zone.

<sup>94</sup> Based on maximum capacity average from the RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008

<sup>95</sup> Based on Nexus Market Research Inc, RLW Analytics, December 2005; "Impact, Process, and Market Study of the Connecticut Appliance Retirement Program: Overall Report."

<sup>96</sup> Since the existing unit will be rated in EER, this factor is used to appropriately compare with the new CEER rating. Version 3.0 of the ENERGY STAR specification provided equivalent EER and CEER ratings and for the most popular size band the EER rating is approximately 1% higher than the CEER. See 'ENERGY STAR Version 3.0 Room Air Conditioners Program Requirements'.

**Time of Sale:**

**For example**, for an 8,500 Btu/H capacity unit, with louvered sides, in an unknown location:

$$\begin{aligned} \Delta\text{kWh}_{\text{ENERGY STAR}} &= (248 * 8500 * (1/10.9 - 1/12.0)) / 1000 \\ &= 17.7 \text{ kWh} \end{aligned}$$

**Early Replacement:**

**For example**, a 7.7EER, 9000Btu/h unit is removed from a home in Springfield and replaced with an ENERGY STAR unit with louvered sides:

$$\begin{aligned} \Delta\text{kWh for remaining life of existing unit (1}^{\text{st}} \text{ 4 years)} &= (319 * 9000 * (1/(7.7/1.01) - 1/12.0))/1000 \\ &= 137.3 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta\text{kWh for remaining measure life (next 8 years)} &= (319 * 9000 * (1/10.9 - 1/12.0))/1000 \\ &= 24.1 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Time of Sale:  $\Delta\text{kW} = \text{Btu/H} * ((1/(\text{CEER}_{\text{base}} * 1.01) - 1/(\text{CEER}_{\text{ee}} * 1.01)))/1000) * \text{CF}$

Early Replacement:  $\Delta\text{kW} = \text{Btu/H} * ((1/\text{EER}_{\text{exist}} - 1/(\text{CEER}_{\text{ee}} * 1.01)))/1000) * \text{CF}$

Where:

CF = Summer Peak Coincidence Factor for measure  
= 0.3<sup>97</sup>

1.01 = Factor to convert CEER to EER (CEER includes standby and off power consumption)<sup>98</sup>  
Other variable as defined above

**Time of Sale:**

**For example**, for an 8,500 Btu/H capacity unit, with louvered sides, for an unknown location:

$$\begin{aligned} \Delta\text{kW}_{\text{CEE TIER 1}} &= (8500 * (1/(10.9 * 1.01) - 1/(12.0 * 1.01))) / 1000 * 0.3 \\ &= 0.021 \text{ kW} \end{aligned}$$

**Early Replacement:**

**For example**, a 7.7 EER, 9000Btu/h unit is removed from a home in Springfield and replaced with an ENERGY STAR unit with louvered sides:

$$\begin{aligned} \Delta\text{kW for remaining life of existing unit (1}^{\text{st}} \text{ 4 years)} &= (9000 * (1/7.7 - 1/(12.0 * 1.01)))/1000 * 0.3 \\ &= 0.128 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta\text{kW for remaining measure life (next 8 years)} &= (9000 * (1/(10.9 * 1.01) - 1/(12.0 * 1.01)))/1000 \\ &\quad * 0.3 \\ &= 0.022 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

N/A

<sup>97</sup> Consistent with coincidence factors found in: RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008

<sup>98</sup> Since the new CEER rating includes standby and off power consumption, for peak calculations it is more appropriate to apply the EER rating, but it appears as though new units will only be rated with a CEER rating. Version 3.0 of the ENERGY STAR specification provided equivalent EER and CEER ratings and for the most popular size band the EER rating is approximately 1% higher than the CEER. See 'ENERGY STAR Version 3.0 Room Air Conditioners Program Requirements'.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-ESRA-V07-190101**

**REVIEW DEADLINE: 1/1/2022**

## 5.1.8 Refrigerator and Freezer Recycling

### DESCRIPTION

This measure describes savings from the retirement and recycling of inefficient but operational refrigerators and freezers. Savings are provided based on a 2013 workpaper provided by Cadmus that used data from a 2012 ComEd metering study and metering data from a Michigan study, to develop a regression equation that uses key inputs describing the retired unit. The savings are equivalent to the Unit Energy Consumption of the retired unit and should be claimed for the assumed remaining useful life of that unit. A part use factor is applied to account for those secondary units that are not in use throughout the entire year. The reader should note that the regression algorithm is designed to provide an accurate portrayal of savings for the population as a whole and includes those parameters that have a significant effect on the consumption. The precision of savings for individual units will vary.

For Net to Gross factor considerations, please refer to section 4.2 Appliance Recycling Protocol of Appendix A: Illinois Statewide Net-to-Gross Methodologies of Volume 4.0 Cross Cutting Measures and Attachments.

This measure was developed to be applicable to the following program types: ERET.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

N/A

### DEFINITION OF BASELINE EQUIPMENT

The existing inefficient unit must be operational and have a capacity of between 10 and 30 cubic feet.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated remaining useful life of the recycling units is 6.5 years.<sup>99</sup>

### DEEMED MEASURE COST

Measure cost includes the customer's value placed on their lost amenity, any customer transaction costs, and the cost of pickup and recycling of the refrigerator/freezer and should be based on actual costs of running the program. The payment (bounty) a Program Administrator makes to the customer serves as a proxy for the value the customer places on their lost amenity and any customer transaction costs. If unknown assume \$170 per unit.<sup>100</sup>

### LOADSHAPE

Loadshape R05 - Residential Refrigerator

### COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.00012.

---

<sup>99</sup> DOE refrigerator and freezer survival curves are used to calculate RUL for each equipment age and develop a RUL schedule. The RUL of each unit in the ARCA database is calculated and the average RUL of the dataset serves as the final measure RUL. Refrigerator recycling data from ComEd (PY7-PY9) and Ameren (PY6-PY8) were used to determine EUL with the DOE survival curves from the 2009 TSD. A weighted average of the retailer ComEd data and the Ameren data results in an average of 6.5 years. See Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>100</sup> The \$170 default assumption is based on \$120 cost of pickup and recycling per unit and \$50 proxy for customer transaction costs and value customer places on their lost amenity. \$120 is cost of pickup and recycling based on similar Efficiency Vermont program. \$50 is bounty, based on Ameren and ComEd program offerings as of 7/27/15.



**Algorithm**

**CALCULATION OF SAVINGS**

**ENERGY SAVINGS<sup>101</sup>**

Refrigerators:

Energy savings for refrigerators are based upon a linear regression model using the following coefficients:<sup>102</sup>

Independent Variable Description	Estimate Coefficient
Intercept	83.324
Age (years)	3.678
Pre-1990 (=1 if manufactured pre-1990)	485.037
Size (cubic feet)	27.149
Dummy: Side-by-Side (= 1 if side-by-side)	406.779
Dummy: Primary Usage Type (in absence of the program) (= 1 if primary unit)	161.857
Interaction: Located in Unconditioned Space x CDD/365.25	15.366
Interaction: Located in Unconditioned Space x HDD/365.25	-11.067

$$\Delta kWh = [83.32 + (Age * 3.68) + (Pre-1990 * 485.04) + (Size * 27.15) + (Side-by-side * 406.78) + (Proportion of Primary Appliances * 161.86) + (CDD/365.25 * unconditioned * 15.37) + (HDD/365.25 * unconditioned * -11.07)] * Part Use Factor$$

Where:

- Age = Age of retired unit
- Pre-1990 = Pre-1990 dummy (=1 if manufactured pre-1990, else 0)
- Size = Capacity (cubic feet) of retired unit
- Side-by-side = Side-by-side dummy (= 1 if side-by-side, else 0)
- Primary Usage = Primary Usage Type (in absence of the program) dummy  
(= 1 if Primary, else 0)

<sup>101</sup> Based on the specified regression, a small number of units may have negative energy and demand consumption. These are a function of the unit size and age, and should comprise a very small fraction of the population. While on an individual basis this result is counterintuitive it is important that these negative results remain such that as a population the average savings is appropriate.

<sup>102</sup> Energy savings are based on an average 30-year TMY temperature of 51.1 degrees. Coefficients provided in July 30, 2014 memo from Cadmus: "Appliance Recycling Update no single door July 30, 2014".

Interaction: Located in Unconditioned Space x CDD/365.25

(=1 \* CDD/365.25 if in unconditioned space)

CDD = Cooling Degree Days

= Dependent on location:<sup>103</sup>

Climate Zone (City based upon)	CDD 65	CDD/365.25
1 (Rockford)	820	2.25
2 (Chicago)	842	2.31
3 (Springfield)	1,108	3.03
4 (Belleville)	1,570	4.30
5 (Marion)	1,370	3.75

Interaction: Located in Unconditioned Space x HDD/365.25

(=1 \* HDD/365.25 if in unconditioned space)

HDD = Heating Degree Days

= Dependent on location:<sup>104</sup>

Climate Zone (City based upon)	HDD 65	HDD/365.25
1 (Rockford)	6,569	17.98
2 (Chicago)	6,339	17.36
3 (Springfield)	5,497	15.05
4 (Belleville)	4,379	11.99
5 (Marion)	4,476	12.25

Part Use Factor = To account for those units that are not running throughout the entire year. The most recent part-use factor participant survey results available at the start of the current program year shall be used.<sup>105</sup> For illustration purposes, this example uses 0.93.<sup>106</sup>

**For example**, the program averages for AIC’s ARP in PY4 produce the following equation:

$$\begin{aligned} \Delta\text{kWh} &= [83.32 + (22.81 * 3.68) + (0.45 * 485.04) + (18.82 * 27.15) + (0.17 * 406.78) \\ &+ (0.34 * 161.86) + (1.29 * 15.37) + (6.49 * -11.07)] * 0.93 \\ &= 969 * 0.93 \\ &= 900.9 \text{ kWh} \end{aligned}$$

Freezers:

Energy savings for freezers are based upon a linear regression model using the following

<sup>103</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 65°F.

<sup>104</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 65°F.

<sup>105</sup> For example, the part-use factor that shall be applied to the current program year t (PYt) for savings verification purposes should be determined through the PYt-2 participant surveys conducted in the respective utility’s service territory, if available. If an evaluation was not performed in PYt-2 the latest available evaluation should be used.

<sup>106</sup> Most recent refrigerator part-use factor from Ameren Illinois PY5 evaluation.

coefficients:<sup>107</sup>

Independent Variable Description	Estimate Coefficient
Intercept	132.122
Age (years)	12.130
Pre-1990 (=1 if manufactured pre-1990)	156.181
Size (cubic feet)	31.839
Chest Freezer Configuration (=1 if chest freezer)	-19.709
Interaction: Located in Unconditioned Space x CDD/365.25	9.778
Interaction: Located in Unconditioned Space x HDD/365.25	-12.755

$$\Delta kWh = [132.12 + (\text{Age} * 12.13) + (\text{Pre-1990} * 156.18) + (\text{Size} * 31.84) + (\text{Chest Freezer} * -19.71) + (\text{CDDs} * \text{unconditioned} * 9.78) + (\text{HDDs} * \text{unconditioned} * -12.75)] * \text{Part Use Factor}$$

Where:

Age = Age of retired unit

Pre-1990 = Pre-1990 dummy (=1 if manufactured pre-1990, else 0)

Size = Capacity (cubic feet) of retired unit

Chest Freezer = Chest Freezer dummy (= 1 if chest freezer, else 0)

Interaction: Located in Unconditioned Space x CDD/365.25

(=1 \* CDD/365.25 if in unconditioned space)

CDD = Cooling Degree Days (see table above)

Interaction: Located in Unconditioned Space x HDD/365.25

(=1 \* HDD/365.25 if in unconditioned space)

HDD = Heating Degree Days (see table above)

Part Use Factor = To account for those units that are not running throughout the entire year. The most recent part-use factor participant survey results available at the start of the current program year shall be used.<sup>108</sup> For illustration purposes, the example uses 0.85.<sup>109</sup>

**For example**, the program averages for AIC’s ARP in PY4 produce the following equation:

$$\begin{aligned} \Delta kWh &= [132.12 + (26.92 * 12.13) + (0.6 * 156.18) + (15.9 * 31.84) + (0.48 * -19.71) \\ &+ (6.61 * 9.78) + (1.3 * -12.75)] * 0.825 \\ &= 977 * 0.825 \\ &= 905 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = kWh/8766 * CF$$

<sup>107</sup> Energy savings are based on an average 30-year TMY temperature of 51.1 degrees. Coefficients provided in January 31, 2013 memo from Cadmus: “Appliance Recycling Update”.

<sup>108</sup> For example, the part-use factor that shall be applied to the current program year t (PYt) for savings verification purposes should be determined through the PYt-2 participant surveys conducted in the respective utility’s service territory, if available. If an evaluation was not performed in PYt-2 the latest available evaluation should be used.

<sup>109</sup> Most recent freezer part-use factor from Ameren Illinois Company PY5 evaluation.

Where:

kWh = Savings provided in algorithm above  
CF = Coincident factor defined as summer kW/average kW  
= 1.081 for Refrigerators  
= 1.028 for Freezers<sup>110</sup>

**For example**, the program averages for AIC’s ARP in PY4 produce the following equation:

$$\begin{aligned}\Delta kW &= 806/8766 * 1.081 \\ &= 0.099 \text{ kW}\end{aligned}$$

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-RFRC-V07-190101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>110</sup> Cadmus memo, February 12, 2013; “Appliance Recycling Update”

## 5.1.9 Room Air Conditioner Recycling

### DESCRIPTION

This measure describes the savings resulting from running a drop off service taking existing residential, inefficient Room Air Conditioner units from service, prior to their natural end of life. This measure assumes that though a percentage of these units will be replaced this is not captured in the savings algorithm since it is unlikely that the incentive made someone retire a unit that they weren't already planning to retire. The savings therefore relate to the unit being taken off the grid as opposed to entering the secondary market. The Net to Gross factor applied to these units should incorporate adjustments that account for those participants who would have removed the unit from the grid anyway.

This measure was developed to be applicable to the following program types: ERET. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

N/A. This measure relates to the retiring of an existing inefficient unit.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is the existing inefficient room air conditioning unit.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed remaining useful life of the existing room air conditioning unit being retired is 4 years.<sup>111</sup>

### DEEMED MEASURE COST

The actual implementation cost for recycling the existing unit should be used.

### LOADSHAPE

Loadshape R08 - Residential Cooling

### COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 30%.<sup>112</sup>

---



---

### Algorithm

---



---

#### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ((FLH_{RoomAC} * Btu/hr * (1/EER_{exist}))/1000)$$

---

<sup>111</sup> A third of assumed measure life for Room AC.

<sup>112</sup> Consistent with coincidence factors found in: RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

Where:

$FLH_{RoomAC}$  = Full Load Hours of room air conditioning unit  
 = dependent on location:<sup>113</sup>

Climate Zone (City based upon)	$FLH_{RoomAC}$
1 (Rockford)	220
2 (Chicago)	210
3 (Springfield)	319
4 (Belleville)	428
5 (Marion)	374
Weighted Average <sup>114</sup>	248

Btu/H = Size of retired unit  
 = Actual. If unknown assume 8500 Btu/hr <sup>115</sup>

EER<sub>exist</sub> = Efficiency of existing unit  
 = 9.8<sup>116</sup>

**For example**, for an 8500 Btu/h unit in Springfield:

$$\begin{aligned} \Delta kWh &= ((319 * 8500 * (1/9.8)) / 1000) \\ &= 276 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (Btu/hr * (1/EER_{exist}))/1000 * CF$$

Where:

CF = Summer Peak Coincidence Factor for measure  
 = 0.3<sup>117</sup>

**For example**, an 8500 Btu/h unit:

$$\begin{aligned} \Delta kW &= (8500 * (1/9.8)) / 1000 * 0.3 \\ &= 0.26 \text{ kW} \end{aligned}$$

<sup>113</sup> The average ratio of FLH for Room AC (provided in RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008) to FLH for Central Cooling for the same location is 31%. This ratio is applied to those IL cities that have FLH for Central Cooling provided in the ENERGY STAR calculator. For other cities this is extrapolated using the FLH assumptions VEIC have developed for Central AC. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>114</sup> Weighted based on number of residential occupied housing units in each zone.

<sup>115</sup> Based on maximum capacity average from the RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008

<sup>116</sup> Minimum Federal Standard for most common room AC type (8000-14,999 capacity range with louvered sides) per federal standards from 10/1/2000 to 5/31/2014. Note that this value is the EER value, as CEER were introduced later.

<sup>117</sup> Consistent with coincidence factors found in:

RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-RARC-V02-190101**

**REVIEW DEADLINE: 1/1/2023**

## 5.1.10 ENERGY STAR Clothes Dryer

### DESCRIPTION

This measure relates to the installation of a residential clothes dryer meeting the ENERGY STAR criteria. ENERGY STAR qualified clothes dryers save energy through a combination of more efficient drying and reduced runtime of the drying cycle. More efficient drying is achieved through heat pump technology, increased insulation, modifying operating conditions such as air flow and/or heat input rate, improving air circulation through better drum design or booster fans, and improving efficiency of motors. Reducing the runtime of dryers through automatic termination by temperature and moisture sensors is believed to have the greatest potential for reducing energy use in clothes dryers<sup>118</sup>. ENERGY STAR provides criteria for both gas and electric clothes dryers.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Clothes dryer must meet the ENERGY STAR or ENERGY STAR Most Efficient criteria, as required by the program.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a clothes dryer meeting the minimum federal requirements for units manufactured on or after January 1, 2015.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years.<sup>119</sup>

### DEEMED MEASURE COST

The incremental cost for an ENERGY STAR clothes dryer is assumed to be \$152 and \$405 for an ENERGY STAR Most Efficient dryer.<sup>120</sup>

### LOADSHAPE

Loadshape R17 - Residential Electric Dryer

### COINCIDENCE FACTOR

The coincidence factor for this measure is 3.8%.<sup>121</sup>

---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta \text{kWh} = (\text{Load}/\text{CEF}_{\text{base}} - \text{Load}/\text{CEF}_{\text{eff}}) * \text{Ncycles} * \% \text{Electric}$$

---

<sup>118</sup> ENERGY STAR Market & Industry Scoping Report. Residential Clothes Dryers. Table 8. November 2011.

<sup>119</sup> [Based on DOE Rulemaking Technical Support Document, LCC Chapter, 2011](#), as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>120</sup> Based on the difference in installed cost for an efficient dryer (\$716) and standard dryer (\$564) (see "ACEEE Clothes Dryers.pdf").

<sup>121</sup> Based on coincidence factor of 3.8% for clothes washers



Where:

**Load** = The average total weight (lbs) of clothes per drying cycle. If dryer size is unknown, assume standard.

Dryer Size	Load (lbs) <sup>122</sup>
Standard	8.45
Compact	3

**CEFFbase** = Combined energy factor (CEF) (lbs/kWh) of the baseline unit is based on existing federal standards energy factor and adjusted to CEF as performed in the ENERGY STAR analysis.<sup>123</sup> If product class unknown, assume electric, standard.

Product Class	CEF (lbs/kWh)
Vented Electric, Standard ( $\geq 4.4 \text{ ft}^3$ )	3.11
Vented Electric, Compact (120V) ( $< 4.4 \text{ ft}^3$ )	3.01
Vented Electric, Compact (240V) ( $< 4.4 \text{ ft}^3$ )	2.73
Ventless Electric, Compact (240V) ( $< 4.4 \text{ ft}^3$ )	2.13
Vented Gas	2.84 <sup>124</sup>

**CEFFeff** = CEF (lbs/kWh) of the ENERGY STAR unit based on ENERGY STAR or ENERGY STAR Most Efficient requirements.<sup>125</sup> If product class unknown, assume electric, standard.

Product Class	ENERGY STAR	ENERGY STAR Most Efficient
	CEF (lbs/kWh)	CEF (lbs/kWh)
Vented or Ventless Electric, Standard ( $\geq 4.4 \text{ ft}^3$ )	3.93	4.3
Vented or Ventless Electric, Compact (120V) ( $< 4.4 \text{ ft}^3$ )	3.80	4.3
Vented Electric, Compact (240V) ( $< 4.4 \text{ ft}^3$ )	3.45	4.3
Ventless Electric, Compact (240V) ( $< 4.4 \text{ ft}^3$ )	2.68	3.7
Vented Gas	3.48 <sup>126</sup>	3.8

**Ncycles** = Number of dryer cycles per year. Use actual data if available. If unknown, use 283 cycles per year.<sup>127</sup>

**%Electric** = The percent of overall savings coming from electricity  
 = 100% for electric dryers, 16% for gas dryers<sup>128</sup>

<sup>122</sup> Based on ENERGY STAR test procedures.

<sup>123</sup> ENERGY STAR Draft 2 Version 1.0 Clothes Dryers Data and Analysis

<sup>124</sup> Federal standards report CEF for gas clothes dryers in terms of lbs/kWh. To determine gas savings, this number is later converted to therms.

<sup>125</sup> ENERGY STAR Clothes Dryers Key Product Criteria.

<sup>126</sup> Federal standards report CEF for gas clothes dryers in terms of lbs/kWh. To determine gas savings, this number is later converted to therms.

<sup>127</sup> Appendix D to Subpart B of Part 430 – Uniform Test Method for Measuring the Energy Consumption of Dryers.

<sup>128</sup> %Electric accounts for the fact that some of the savings on gas dryers comes from electricity (motors, controls, etc). 16% was determined using a ratio of the electric to total savings from gas dryers given by ENERGY STAR Draft 2 Version 1.0 Clothes Dryers Data and Analysis.

**For example**, for a Time of Sale, a standard, vented, electric ENERGY STAR clothes dryer:

$$\begin{aligned} \Delta\text{kWh} &= ((8.45/3.11 - 8.45/3.93) * 283 * 100\%) \\ &= 160 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \Delta\text{kWh}/\text{Hours} * \text{CF}$$

Where:

$\Delta\text{kWh}$  = Energy Savings as calculated above

Hours = Annual run hours of clothes dryer. Use actual data if available. If unknown, use 283 hours per year.<sup>129</sup>

CF = Summer Peak Coincidence Factor for measure  
= 3.8%<sup>130</sup>

**For example**, for a Time of Sale, a standard, vented, electric ENERGY STAR clothes dryer:

$$\begin{aligned} \Delta\text{kW} &= 160/283 * 3.8\% \\ &= 0.0215 \text{ kW} \end{aligned}$$

### NATURAL GAS SAVINGS

Natural gas savings only apply to ENERGY STAR vented gas clothes dryers.

$$\Delta\text{Therm} = (\text{Load}/\text{EF}_{\text{base}} - \text{Load}/\text{CE}_{\text{eff}}) * \text{Ncycles} * \text{Therm}_{\text{convert}} * \% \text{Gas}$$

Where:

Therm\_convert = Conversion factor from kWh to Therm  
= 0.03412

%Gas = Percent of overall savings coming from gas  
= 0% for electric units and 84% for gas units<sup>131</sup>

**For example**, for a Time of Sale, a standard, vented, gas ENERGY STAR clothes dryer:

$$\begin{aligned} \Delta\text{Therm} &= (8.45/2.84 - 8.45/3.48) * 283 * 0.03412 * 0.84 \\ &= 4.44 \text{ therms} \end{aligned}$$

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

<sup>129</sup> ENERGY STAR qualified dryers have a maximum test cycle time of 80 minutes. Assume one hour per dryer cycle.

<sup>130</sup> Based on coincidence factor of 3.8% for clothes washers.

<sup>131</sup> %Gas accounts for the fact that some of the savings on gas dryers comes from electricity (motors, controls, etc). 84% was determined using a ratio of the gas to total savings from gas dryers given by ENERGY STAR Draft 2 Version 1.0 Clothes Dryers Data and Analysis.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-ESDR-V04-210101**

**REVIEW DEADLINE: 1/1/2023**

### 5.1.11 ENERGY STAR Water Coolers

**DESCRIPTION**

Water coolers are a home appliance that offer consumers the ability to enjoy hot and/or cold water on demand. This measure is the characterization of the purchasing and use of an ENERGY STAR certified water cooler in place of a conventional water cooler.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

The high efficiency equipment is an ENERGY STAR certified water cooler meeting the ENERGY STAR 2.0 efficiency criteria.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline equipment is a standard or conventional, non-ENERGY STAR certified water cooler.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The estimated useful life for a water cooler is 10 years.<sup>132</sup>

**DEEMED MEASURE COST**

The incremental cost for this measure is estimated at \$17.<sup>133</sup>

**LOADSHAPE**

Loadshape C53: Flat

**COINCIDENCE FACTOR**

The summer peak coincidence factor is assumed to be 1.0.

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (kWh_{base} - kWh_{ee}) * Days$$

Where:

$kWh_{base}$  = Daily energy use (kWh/day) for baseline water cooler<sup>134</sup>

Type of Water Cooler	kWhbase
Hot and Cold Water – Storage	1.090
Hot and Cold Water – On Demand	0.330
Cold Water Only	0.290

<sup>132</sup> Savings Calculator for ENERGY STAR Certified Water Coolers, last updated 2009.

<sup>133</sup> Ameren Missouri PY3 Evaluation Report.

<sup>134</sup> Savings Calculator for ENERGY STAR Certified Water Coolers, last updated 2009.

$kWh_{ee}$  = Daily energy use (kWh/day) for ENERGY STAR water cooler<sup>135</sup>

Type of Water Cooler	$kWh_{ee}$
Hot and Cold Water – Storage	0.747
Hot and Cold Water – On Demand	0.170
Cold Water Only	0.157

Days = Number of days per year that the water cooler is in use  
 = 365.25 days<sup>136</sup>

Energy Savings:

Type of Water Cooler	$\Delta kWh$
Hot and Cold Water – Storage	125.4
Hot and Cold Water – On Demand	58.4
Cold Water Only	48.7

**DEMAND SAVINGS**

$\Delta kW = \Delta kWh / \text{Hours} * CF$

Where:

Hours = Number of hours per year water cooler is in use  
 = 8766 hours<sup>137</sup>

CF = Summer Peak Coincidence Factor for measure  
 = 1.0

Demand Savings:

Type of Water Cooler	$\Delta kW$
Hot and Cold Water - Storage	0.0143
Hot and Cold Water – On Demand	0.0067
Cold Water Only	0.0056

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>135</sup> Average kWh/day for from the ENERGY STAR efficient product database.

<sup>136</sup> Savings Calculator for ENERGY STAR Certified Water Coolers, last updated 2009.

<sup>137</sup> Assumed 365 days per year and 24 hours per day as utilized in daily energy consumption from ENERGY STAR Program Requirements Product Specification for Water Coolers Test Method.

**MEASURE CODE: RS-APL-WTCL-V01-180101**

**REVIEW DEADLINE: 1/1/2024**

## 5.1.12 Ozone Laundry

### DESCRIPTION

A new ozone laundry system is added-on to new or existing residential clothes washing machine(s) or washing machines located in multifamily building common areas. The system generates ozone (O<sub>3</sub>), a naturally occurring molecule, which helps clean fabrics by chemically reacting with soils in cold water. Adding an ozone laundry system(s) eliminate the use of chemicals, detergents, and hot water by residential washing machine(s).

Energy savings will be achieved at the domestic hot water heater as it will no longer supply hot water to the washing machine. Cold water usage by the clothes washer will increase, but overall water usage will stay constant.

This measure was developed to be applicable to the following program types: TOS, RNC, RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

A new, single-unit ozone laundry system(s) rated for residential clothes washing machines is added-on to new or existing residential clothes washing machines. The ozone laundry system must be connected to both the hot and cold water inlets of the clothes washing machine so that hot water from the domestic hot water heater is no longer provided to the clothes washer.

The ozone laundry system(s) must transfer ozone into the water through:

- Venturi injection
- Bubble diffusion
- Additional applications may be considered upon program review and approval on a case by case basis

### DEFINITION OF BASELINE EQUIPMENT

The base case equipment is a conventional residential washing machine with no ozone generator installed. The washing machine is provided hot water from a domestic hot water heater.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure equipment effective useful life (EUL) is estimated at 8 years based on the typical lifetime of products currently available in the market.<sup>138</sup>

### DEEMED MEASURE COST

The deemed measure cost is \$300 for a new single-unit ozone laundry system.<sup>139</sup>

### LOADSHAPE

Loadshape R01 – Residential Clothes Washer

### COINCIDENCE FACTOR

The coincidence factor for this measure is 3.8%.<sup>140</sup>

---

<sup>138</sup> Average based on conversations with manufacturers and distributors of the four residential ozone laundry systems tested in the 2018 GTI Residential Ozone Laundry Field Demonstration (O3 Pure, Pure Wash, Eco Washer, Scent Crusher).

<sup>139</sup> 2018 GTI Residential Ozone Laundry Field Demonstration (May 2018).

<sup>140</sup> Calculated from Itron eShapes, 8760 hourly data by end use for Missouri, as provided by Ameren.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = kWh_{HotWash} * (\%HotWash_{base} - \%HotWash_{Ozone})$$

Where:

$$kWh_{HotWash} = (\%ElectricDHW * Capacity * IWF * \%HotWater * (T_{OUT} - T_{IN}) * 8.33 * 1.0 * Ncycles) / (RE_{electric} * 3.412)$$

**%ElectricDHW** = Proportion of water heating supplied by electric heating

DHW fuel	%FossilDHW
Electric	100%
Natural gas	0%
Unknown	16% <sup>141</sup>

**Capacity** = Clothes washer capacity (cubic feet).  
 = Actual. If unknown, assume 5.0 cubic feet.<sup>142</sup>

**IWF** = Integrated water factor (gallons/cycle/ft<sup>3</sup>).  
 = Actual. If unknown, use the following values

Efficiency Level	IWF (gallons/cycle/ft <sup>3</sup> )	
	Top loading > 2.5 Cu ft	Front Loading > 2.5 Cu ft
Federal Standard (as of March 2015)	8.4	4.7
ENERGY STAR (as of February 2018)	4.3	3.2
CEE Tier 2	3.2	3.2

**%HotWater** = Percentage of water usage that is supplied by the domestic hot water heater when the hot or warm wash cycles are selected.<sup>143</sup>

Single-Family Home	Multifamily
0.1759	0.2960

**T<sub>OUT</sub>** = Tank temperature  
 = 125°F

<sup>141</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>142</sup> Average data from GTI Residential Ozone Laundry Field Demonstration (May 2018). As an add on to existing equipment it is assumed this is a larger capacity than the assumption for new Clothes Washers as old machines tended to have larger capacities. See 'Residential Ozone Summary Calcs\_2019.xlsx' and 'Multifamily Ozone Summary Calcs\_2019.xlsx' for more information. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>143</sup> Averaged data from GTI Residential Ozone Laundry Field Demonstration (May 2018). Hot and warm wash cycles were combined because data from the EIA Residential Energy Consumption Survey (RECS) 2015 East North Central Region show that, of the total hot and warm washes that occur, over 96% are warm washes. See 'Residential Ozone Summary Calcs\_2019.xlsx' and 'Multifamily Ozone Summary Calcs\_2019.xlsx' for more information.



$T_{IN}$  = Incoming water temperature from well or municipal system  
 = 54.1°F<sup>144</sup>

8.33 = Specific weight of water (lbs/gallon)

1.0 = Heat capacity of water (Btu/lb °F)

Ncycles = Number of Cycles per year

Single-Family Home	Multifamily
295 <sup>145</sup>	1,243 <sup>146</sup>

RE\_electric = Recovery efficiency of electric water heater  
 = 98%<sup>147</sup>

3412 = Btus to kWh conversion (Btu/kWh)

%HotWash<sub>base</sub> = Average percentage of loads that use hot or warm water with baseline equipment.<sup>148</sup>

Single-Family Home	Multifamily
0.7743	0.7438

%HotWash<sub>Ozone</sub> = Percentage of loads that use hot or warm water with efficient equipment.  
 = 0.0

**For example**, a residential ozone laundry system is installed in a single-family home with an electric domestic hot water heater. The capacity and IWF of the baseline equipment is unknown.

$$\Delta kWh = (1 * 5.0 * 8.4 * 0.1759 * (125 - 54.1) * 8.33 * 1.0 * 295) / (0.98 * 3412) * (0.7743 - 0)$$

$$= 298 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh/Hours * CF$$

Where:

$\Delta kWh$  = Energy Savings as calculated above

Hours = Assumed Run hours of Clothes Washer

= 264 hours<sup>149</sup>

<sup>144</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

<sup>145</sup> Weighted average of clothes washer cycles per year (based on 2009 Residential Energy Consumption Survey (RECS) national sample survey of housing appliances section, [state of Illinois](#)).

If utilities have specific evaluation results providing a more appropriate assumption for single-family or Multifamily homes, in a particular market, or geographical area then that should be used.

<sup>146</sup> DOE Technical Support Document Chapter 6, 2010 <https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf>

<sup>147</sup> Electric water heaters have recovery efficiency of 98%.

<sup>148</sup> GTI Residential Ozone Laundry Field Demonstration (May 2018). See 'Residential Ozone Summary Calcs\_2019.xlsx' and 'Multifamily Ozone Summary Calcs\_2019.xlsx' for more information.

<sup>149</sup> Based on a weighted average of 264 clothes washer cycles per year assuming an average load runs for one hour.

CF = Summer Peak Coincidence Factor for measure.  
 = 0.038<sup>150</sup>

**For example**, a residential ozone laundry system is installed in a single-family home with an electric domestic hot water heater. The capacity and IWF of the baseline equipment is unknown.

$$\begin{aligned} \Delta kW &= 298/295 * 0.038 \\ &= 0.038kW \end{aligned}$$

**NATURAL GAS SAVINGS**

$$\Delta Therm = ThermHotWash * (\%HotWash_{base} - \%HotWash_{Ozone})$$

Where:

$$ThermHotWash = (\%FossilDHW * Capacity * IWF * \%HotWater * (T_{OUT} - T_{IN}) * 8.33 * 1.0 * Ncycles) / (RE_{gas} * 100,000)$$

%FossilDHW = proportion of water heating supplied by natural gas heating

DHW fuel	%FossilDHW
Electric	0%
Natural gas	100%
Unknown	84% <sup>151</sup>

RE\_gas = Recovery efficiency of gas water heater

Single-Family Homes	Multifamily
78% <sup>152</sup>	67% <sup>153</sup>

100,000 = Btus to Therms conversion (Btu/Therm).

**For example**, a residential ozone laundry system is installed in a single-family home with a gas domestic hot water heater. The capacity and IWF of the baseline equipment is unknown.

$$\begin{aligned} \Delta Therms &= (1 * 5.0 * 8.4 * 0.1759 * (125 - 54.1) * 8.33 * 1.0 * 295) / (0.78 * 100,000) * (0.7743 - 0) \\ &= 12.78 Therms \end{aligned}$$

<sup>150</sup> Calculated from Itron eShapes, 8760 hourly data by end use for Missouri, as provided by Ameren.

<sup>151</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>152</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.

<sup>153</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

**LAUNDRY DETERGENT SAVINGS**

Annual savings from not purchasing laundry detergent that are realized by efficient equipment end-user(s) (\$/year).

$$\text{Detergent savings per year} = \text{Detergent\_cost} * \text{Ncycles}$$

Where:

$$\begin{aligned} \text{Detergent\_cost} &= \text{Average laundry detergent cost per load (\$/load).} \\ &= 0.16^{154} \end{aligned}$$

**For example**, a residential ozone laundry system is installed in a single-family home.

$$\begin{aligned} \text{Detergent savings per year} &= 0.16 * 295 \\ &= \$47.20 \end{aligned}$$

**MEASURE CODE: RS-APL-OZNE-V03-210101**

**REVIEW DEADLINE: 1/1/2023**

---

<sup>154</sup> Based on cost analysis of products available on [www.Jet.com](http://www.Jet.com) and [www.Amazon.com](http://www.Amazon.com).

### 5.1.13 Income Qualified: ENERGY STAR Room Air Conditioner

#### DESCRIPTION

This measure relates to the purchase and installation of a room air conditioning unit that meets ENERGY STAR version 4.0 which is effective October 26<sup>th</sup> 2015, in place of an existing inefficient unit or a newly acquired inefficient unit through the secondary market. This measure is to be used by programs supporting the installation of efficient Room AC in income qualified households. The COVID pandemic of 2020 has meant that opportunities for income qualified populations to keep themselves and their families cool and comfortable during the summer heat have been restricted as access to cooling centers and air conditioned public areas have become limited. This can result in hospitalization or even death from heat exhaustion.

It is assumed that the Room AC's characterized in this measure are being used less as a luxury and more as a necessity and that access to a single AC unit per household will result in run hours more consistent with central AC usage.

This measure was developed to be applicable to the following program types: TOS, EREP.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the new room air conditioning unit must meet the ENERGY STAR version 4.0 (effective October 26<sup>th</sup> 2015)<sup>155</sup> efficiency standards presented above.

Product Type and Class (Btu/hr)		ENERGY STAR v4.0 with louvered sides (CEER)	ENERGY STAR v4.0 without louvered sides (CEER)
Without Reverse Cycle	< 8,000	12.1	11.0
	8,000 to 10,999	12.0	10.6
	11,000 to 13,999	12.0	10.5
	14,000 to 19,999	11.8	10.2
	20,000 to 27,999	10.3	10.3
	>=28,000	9.9	10.3
With Reverse Cycle	<14,000	10.8	10.2
	14,000 to 19,999	10.8	9.6
	>=20,000	10.2	9.6
Casement only		10.5	
Casement-Slider		11.4	

#### DEFINITION OF BASELINE EQUIPMENT

For both Time of Sale and Early Replacement the baseline assumption is an inefficient unit either existing in the home or being purchased or acquired via the secondary market.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 12 years.<sup>156</sup>

It is assumed that the baseline unit would need to be replaced with an additional secondary unit after 6 years.

<sup>155</sup> ENERGY STAR Version 4.0 Room Air Conditioners Program Requirements

<sup>156</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

**DEEMED MEASURE COST**

The actual full cost of the ENERGY STAR unit should be used. If unavailable assume \$300.<sup>157</sup>

The cost of the inefficient secondary market unit is assumed to be \$50.

Therefore, where the new unit replaces an existing unit the measure cost is \$300, and where there is no existing unit the measure cost is assumed to be \$250.

The avoided replacement cost (after 6 years) of the replacement secondary market unit is \$50. This cost should be discounted to present value using the nominal societal discount rate.

**LOADSHAPE**

Loadshape R08 - Residential Cooling

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM’s capacity market.

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 68%<sup>158</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 46.6%<sup>159</sup>

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (FLH_{RoomAC} * Btu/H * (1/(EERbase/1.01) - 1/CEERee))/1000$$

Where:

FLH<sub>RoomAC</sub> = Full Load Hours of room air conditioning unit  
= dependent on location:

Climate Zone (City based upon)	FLHcool (single family)	FLHcool (multifamily)	FLH_cooling (weatherized multifamily) <small>160</small>
1 (Rockford)	512	467	299

<sup>157</sup> To promote improved cost effectiveness, it is assumed that the lower cost ENERGY STAR Room AC units would be used. Units between \$200-\$400 are available dependent on capacity.

<sup>158</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>159</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>160</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015. The multifamily units within this

Climate Zone (City based upon)	FLHcool (single family)	FLHcool (multifamily)	FLH_cooling (weatherized multifamily) <sup>160</sup>
2 (Chicago)	570	506	324
3 (Springfield)	730	663	425
4 (Belleville)	1035	940	603
5 (Marion)	903	820	526
Weighted Average <sup>161</sup>	629	564	362

- Btu/H = Size of installed unit  
= Actual. If unknown assume 8500 Btu/hr<sup>162</sup>
- EERbase = Efficiency of existing / baseline unit  
= Actual. If unknown assume 7.7<sup>163</sup>
- 1.01 = Factor to convert EER to CEER (CEER includes standby and off power consumption)<sup>164</sup>
- CEERee = Combined Energy Efficiency Ratio of ENERGY STAR unit  
= Actual. If unknown assume minimum qualifying standard as provided in tables above

**For example**, for an 8,500 Btu/H capacity unit, with louvered sides, in an unknown multifamily location:

$$\Delta\text{kWh}_{\text{ENERGY STAR}} = (564 * 8500 * (1/(7.7/1.01) - 1/12.0)) / 1000$$

$$= 229 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \text{Btu/H} * ((1/\text{EER}_{\text{exist}} - 1/(\text{CEER}_{\text{ee}} * 1.01)))/1000) * \text{CF}$$

Where:

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 68%<sup>165</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 46.6%<sup>166</sup>

study had undergone significant shell improvements (air sealing and insulation) and therefore this set of assumptions is only appropriate for units that have recently participated in a weatherization or other shell program. Note that the FLHcool where recalculated based on existing efficiencies consistent with the TRM rather than from the metering study.

<sup>161</sup> Weighted based on number of residential occupied housing units in each zone.

<sup>162</sup> Based on maximum capacity average from the RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008

<sup>163</sup> Based on Nexus Market Research Inc, RLW Analytics, December 2005; "Impact, Process, and Market Study of the Connecticut Appliance Retirement Program: Overall Report."

<sup>164</sup> Since the existing unit will be rated in EER, this factor is used to appropriately compare with the new CEER rating. Version 3.0 of the ENERGY STAR specification provided equivalent EER and CEER ratings and for the most popular size band the EER rating is approximately 1% higher than the CEER. See 'ENERGY STAR Version 3.0 Room Air Conditioners Program Requirements'.

<sup>165</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>166</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

1.02 = Factor to convert CEER to EER (CEER includes standby and off power consumption)<sup>167</sup>  
 Other variable as defined above

**For example**, for an 8,500 Btu/H capacity unit, with louvered sides, for an unknown multifamily location:

$$\begin{aligned} \Delta kW_{SSP} &= (8500 * (1/7.7 - 1/(12.0*1.01))) / 1000 * 0.68 \\ &= 0.2738 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} &= (8500 * (1/7.7 - 1/(12.0*1.01))) / 1000 * 0.466 \\ &= 0.1876 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-APL-IQRA-V01-210101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>167</sup> Since the new CEER rating includes standby and off power consumption, for peak calculations it is more appropriate to apply the EER rating, but it appears as though new units will only be rated with a CEER rating. Version 3.0 of the ENERGY STAR specification provided equivalent EER and CEER ratings and for the most popular size band the EER rating is approximately 1% higher than the CEER. See 'ENERGY STAR Version 3.0 Room Air Conditioners Program Requirements'.

## 5.2 Consumer Electronics End Use

### 5.2.1 Advanced Power Strip – Tier 1

#### **DESCRIPTION**

This measure relates to Advanced Power Strips – Tier 1 which are multi-plug surge protector power strips with the ability to automatically disconnect specific connected loads depending upon the power draw of a control load, also plugged into the strip. Power is disconnected from the switched (controlled) outlets when the control load power draw is reduced below a certain adjustable threshold, thus turning off the appliances plugged into the switched outlets. By disconnecting the standby load of the controlled devices, the overall load of a centralized group of equipment (i.e. entertainment centers and home office) can be reduced. Uncontrolled outlets are also provided that are not affected by the control device and so are always providing power to any device plugged into it. This measure characterization provides savings for a 5-plug strip and a 7-plug strip.

This measure was developed to be applicable to the following program types: TOS, NC, DI, KITS.

If applied to other program types, the measure savings should be verified.

#### **DEFINITION OF EFFICIENT EQUIPMENT**

The efficient case is the use of a 5 or 7-plug advanced power strip.

#### **DEFINITION OF BASELINE EQUIPMENT**

For time of sale or new construction applications, the assumed baseline is a standard power strip that does not control connected loads.

For direct install and kits, the baseline is the existing equipment utilized in the home.

#### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The assumed lifetime of the advanced power strip is 7 years.<sup>168</sup>

#### **DEEMED MEASURE COST**

For time of sale or new construction the incremental cost of an advanced Tier 1 power strip over a standard power strip with surge protection is assumed to be \$10.<sup>169</sup>

For direct install the actual full equipment and installation cost (including labor) and for kits the actual full equipment cost should be used.

#### **LOADSHAPE**

Loadshape R13 - Residential Standby Losses – Entertainment

Loadshape R14 - Residential Standby Losses - Home Office

---

<sup>168</sup> This is a consistent assumption with 5.2.2 Advanced Power Strip – Tier 2.

<sup>169</sup> Price survey performed by Illume Advising LLC for IL TRM workpaper, see “Current Surge Protector Costs and Comparison 7-2016” spreadsheet.



**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is assumed to be 80%.<sup>170</sup>

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta\text{kWh} = \text{kWh} * \text{ISR}$$

Where:

kWh = Assumed annual kWh savings per unit  
 = 56.5 kWh for 5-plug units or 103 kWh for 7-plug units<sup>171</sup>

ISR = In Service Rate, dependent on delivery mechanism

Delivery Mechanism	ISR
Multifamily Energy Efficiency Kit, Leave behind	40% <sup>172</sup>
Single Family Energy Efficiency Kit, Leave behind	55% <sup>173</sup>
Community Distributed Kit	91% <sup>174</sup>
Direct Install	100%
Time of Sale	71% <sup>175</sup>

Using assumptions above:

# Plugs	Delivery Mechanism	ΔkWh
5- plug	Multifamily Energy Efficiency Kit, Leave behind	22.6
	Single family Energy Efficiency Kit,	31.1

<sup>170</sup> Efficiency Vermont 2016 TRM coincidence factor for advanced power strip measure –in the absence of empirical evaluation data, this was based on assumptions of the typical run pattern for televisions and computers in homes.

<sup>171</sup> NYSERDA Measure Characterization for Advanced Power Strips. Study based on review of: Smart Strip Electrical Savings and Usability, Power Smart Engineering, October 27, 2008.

Final Field Research Report, Ecos Consulting, October 31, 2006. Prepared for California Energy Commission’s PIER Program. Developing and Testing Low Power Mode Measurement Methods, Lawrence Berkeley National Laboratory (LBNL), September 2004. Prepared for California Energy Commission’s Public Interest Energy Research (PIER) Program.

2005 Intrusive Residential Standby Survey Report, Energy Efficient Strategies, March 2006.

Smart Strip Portfolio of the Future, Navigant Consulting for San Diego G&E, March 31, 2009.

“Smart strip” in this context refers to the category of Advanced Power Strips, does not specifically signify Smart Strip® from BITS Limited, and was used without permission. Smart Strip® is a registered trademark of BITS Smart Strip, LLC.

<sup>172</sup> Opinion Dynamics and Navigant. Impact Evaluation for ComEd 2018 site visit efforts for leave-behind measures in public housing multi-family units. The Evaluation Team completed site visits for 72 apartment units across seven of the ten participating properties in which advanced power strips were installed. The Evaluation Team attempted a census using all data provided at the time of site visit planning (Fall 2018). The program distributed a total of 476 advanced power strips, with 471 distributed amongst the seven properties with completed site visits. The Team performed intrasite sampling within each property and verified a total of 37 advanced power strips of the 92 within the sample.

<sup>173</sup> Research from 2018 ComEd Home Energy Assessment participant survey.

<sup>174</sup> Research from 2018 Ameren Illinois Income Qualified participant survey.

<sup>175</sup> Research from 2019 ComEd Appliance Rebate Program- Online Marketplace participant survey

# Plugs	Delivery Mechanism	ΔkWh
	Leave behind	
	Community Distributed Kit	51.4
	Direct Install	56.5
	Time of Sale	40.1
7-plug	Multifamily Energy Efficiency Kit, Leave behind	41.2
	Single family Energy Efficiency Kit, Leave behind	56.7
	Community Distributed Kit	93.8
	Direct Install	103.0
	Time of Sale	73.1
Unknown <sup>176</sup>	Multifamily Energy Efficiency Kit, Leave behind	31.9
	Single family Energy Efficiency Kit, Leave behind	43.9
	Community Distributed Kit	72.6
	Direct Install	80.0
	Time of Sale	56.6

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

Hours = Annual number of hours during which the controlled standby loads are turned off by the Tier 1 Advanced power Strip.

$$= 7,129^{177}$$

CF = Summer Peak Coincidence Factor for measure

$$= 0.8^{178}$$

# Plugs	Delivery Mechanism	ΔkW
5- plug	Multifamily Energy Efficiency Kit, Leave behind	0.0025
	Single family Energy Efficiency Kit, Leave behind	0.0035
	Community Distributed Kit	0.0058
	Direct Install	0.0063
	Time of Sale	0.045
7-plug	Multifamily Energy Efficiency Kit, Leave behind	0.0046
	Single family Energy Efficiency Kit, Leave behind	0.0064
	Community Distributed Kit	0.0105

<sup>176</sup> Calculated as average of 5 and 7 plug savings assumptions.

<sup>177</sup> Average of hours for controlled TV and computer from; NYSERDA Measure Characterization for Advanced Power Strips

<sup>178</sup> Efficiency Vermont 2016 TRM coincidence factor for advanced power strip measure –in the absence of empirical evaluation data, this was based on assumptions of the typical run pattern for televisions and computers in homes.

# Plugs	Delivery Mechanism	ΔkW
	Direct Install	0.0116
	Time of Sale	0.0082
Unknown <sup>179</sup>	Multifamily Energy Efficiency Kit, Leave behind	0.0036
	Single family Energy Efficiency Kit, Leave behind	0.0049
	Community Distributed Kit	0.0081
	Direct Install	0.0090
	Time of Sale	0.0064

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-CEL-SSTR-V06-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>179</sup> Calculated as average of 5 and 7 plug savings assumptions.

## 5.2.2 Tier 2 Advanced Power Strips (APS) – Residential Audio Visual

### DESCRIPTION

This measure relates to the installation of a Tier 2 Advanced Power Strip / surge protector for household audio visual environments (Tier 2 AV APS). Tier 2 AV APS are multi-plug power strips that remove power from audio visual equipment through intelligent control and monitoring strategies.

By utilizing advanced control strategies such as a countdown timer, external sensors (e.g. of infra-red remote usage and/or occupancy sensors, true RMS (Root Mean Square) power sensing; both active power loads and standby power loads of controlled devices are managed by Tier 2 AV APS devices.<sup>180</sup> Monitoring and controlling both active and standby power loads of controlled devices will reduce the overall load of a centralized group of electrical equipment (i.e. the home entertainment center). This more intelligent sensing and control process has been demonstrated to deliver increased energy savings and demand reduction compared with 'Tier 1 Advanced Power Strips'.

This measure was developed to be applicable to the following program types: DI. If applied to other program delivery types, the installation characteristics including the number of AV devices under control and an appropriate in service rate should be verified through evaluation.

Current evaluation is limited to Direct Install applications. Through a Direct Install program it can be assured that the APS is appropriately set up and the customer is knowledgeable about its function and benefit. It is encouraged that additional implementation strategies are evaluated to provide an indication of whether the units are appropriately set up, used with AV equipment and that the customer is knowledgeable about its function and benefit. This will then facilitate a basis for broadening out the deployment methods of the APS technology category beyond Direct Install.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is the use of a Tier 2 AV APS in a residential AV (home entertainment) environment that includes control of at least 2 AV devices with one being the television.<sup>181</sup>

The minimum product specifications for Tier 2 AV APS are:

#### Safety & longevity

- Product and installation instructions shall comply with 2012 International Fire Code and 2000 NFPA 101 Life Safety Code (IL Fire Code).
- Third party tested to all applicable UL Standards.
- Contains a resettable circuit breaker
- Incorporates power switching electromechanical relays rated for 100,000 switching cycles at full 15 amp load (equivalent to more than 10 years of use).

#### Energy efficiency functionality

- Calculates real power as the time average of the instantaneous power, where instantaneous power is the product of instantaneous voltage and current.
- Delivers a warning when the countdown timer begins before an active power down event and maintains the warning until countdown is concluded or reset by use of the remote or other specified signal
- Uses an automatically adjustable power switching threshold.

---

<sup>180</sup> Tier 2 AV APS identify when people are not engaged with their AV equipment and then remove power, for example a TV and its peripheral devices that are unintentionally left on when a person leaves the house or for instance where someone falls asleep while watching television.

<sup>181</sup> Given this requirement, an AV environment consisting of a television and DVD player or a TV and home theater would be eligible for a Tier 2 AV APS installation.

**DEFINITION OF BASELINE EQUIPMENT**

The assumed baseline equipment is the existing equipment being used in the home (e.g. a standard power strip or wall socket) that does not control loads of connected AV equipment.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The default deemed lifetime value for Tier 2 AV APS is assumed to be 7 years.<sup>182</sup>

**DEEMED MEASURE COST**

Direct Installation: The actual installed cost (including labor) of the new Tier 2 AV APS equipment should be used.

**LOADSHAPE**

Loadshape R13 - Residential Standby Losses – Entertainment

**COINCIDENCE FACTOR**

The summer peak coincidence factor for this measure is assumed to be 80%.<sup>183</sup>

---

<sup>182</sup> There is little evaluation to base a lifetime estimate upon. Based on review of assumptions from other jurisdictions and the relative treatment of In Service Rates and persistence, an estimate of 7 years was agreed by the Technical Advisory Committee, but further evaluation is recommended.

<sup>183</sup> In the absence of empirical evaluation data, this was based on assumptions of the typical run pattern for televisions and computers in homes.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta \text{kWh} = \text{ERP} * \text{BaselineEnergy}_{\text{AV}} * \text{ISR}$$

Where:

ERP = Energy Reduction Percentage of qualifying Tier2 AV APS product range as provided below. Savings are based upon independent field trials of two product manufacturers and the savings differences are assumed to relate to the product classifications provided below. Additional evaluation will be reviewed in future cycles to confirm if additional classification categories are appropriate.

Product Type	ERP used
Infrared Only	40% <sup>184</sup>
Infrared and Occupancy Sensor	25% <sup>185</sup>

$$\text{BaselineEnergy}_{\text{AV}} = 466 \text{ kWh}^{186}$$

ISR = In Service Rate.

Product Type	ISR <sup>187</sup>
Infrared Only	73%
Infrared and Occupancy Sensor	83%

<sup>184</sup> Representative savings assumption based on the following independent field tests on Embertec’s IR-only product. This includes both simulated saving results (based on recording what action the APS would have taken, but where equipment is not actually switched off allowing evaluation of the expected length of savings), and pre/post metering studies.

- AESC (page 30) - Valmiki, MM., Corradini, Antonio PE. 2015. *Tier 2 Advanced Power Strips in Residential and Commercial Applications*. Prepared for San Diego Gas & Electric by Alternative Energy Systems Consulting, Inc. (Simulated 50%, pre/post 32%).
- AESC- Valmiki, MM., Corradini, Antonio PE., Feb 2016. *Energy Savings of Tier 2 Advanced Power Strips in Residential AV Systems*. (Simulated 50%, pre/post 29%)
- CalPlug research (Page 12) - Wang, M. e. 2014. “Tier 2 Advanced Power Strip Evaluation for Energy Saving Incentive”. California Plug Load Research Center (CalPlug), UC Irvine. (Simulated 51%)
- NMR Group Inc., RLPNC 17-3: *Advanced Power Strip Metering Study*, Revised March 18, 2019, submitted to Massachusetts Program Administrators and EEAC. (Pre/post with regression 50%, Pre/post only 20%).

<sup>185</sup> Representative savings assumption based on the following independent field tests on TrickeStar IR-OS product and reflect both simulated and pre/post meter study results.

- AESC- Valmiki, MM., Corradini, Antonio PE., Feb 2016. *Energy Savings of Tier 2 Advanced Power Strips in Residential AV Systems*. (Simulated 27%, pre/post 25%)
- NMR Group Inc., RLPNC 17-3: *Advanced Power Strip Metering Study*, Revised March 18, 2019, submitted to Massachusetts Program Administrators and EEAC. (Pre/post with regression 37%, Pre/post only 11%)

<sup>186</sup> Average of baseline energy in Regional Technical Form survey of Tier 2 APS pre-post methodology studies, see ‘RTF\_T2\_APS.ppt’.

<sup>187</sup> Weighted average of evaluation results from AESC, Inc, “Energy Savings of Tier 2 Advanced Power Strips in Residential AC Systems”, p35. These assumptions include “adjustments in weighting based on the persistence sensitivity to demographics” and NMR Group Inc., RLPNC 17-3: *Advanced Power Strip Metering Study*, Revised March 18, 2019.

Deemed savings for each product type are provided below:

Product Type	ΔkWh
Infrared Only	136.1
Infrared and Occupancy Sensor	96.7

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

ΔkWh = Energy savings as calculated above

Hours = Annual number of hours during which the APS provides savings.  
 = 4,380<sup>188</sup>

CF = Summer Peak Coincidence Factor for measure  
 = 0.8<sup>189</sup>

Deemed savings for each product type are provided below:

Product Type	ΔkW
Infrared Only	0.0249
Infrared and Occupancy Sensor	0.0177

**NATURAL GAS SAVINGS**

N/A<sup>190</sup>

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-CEL-APS2-V05-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>188</sup> This is estimate based on assumption that approximately half of savings are during active hours (supported by AESC study) (assumed to be 5.3 hrs/day, 1936 per year (NYSERDA 2011. “Advanced Power Strip Research Report”)) and half during standby hours (8760-1936 = 6824 hours). The weighted average is 4380.

<sup>189</sup> In the absence of empirical evaluation data, this was based on assumptions of the typical run pattern for televisions and computers in homes. This appears to be supported by the Average Weekday AV Demand Profile and Reduction charts in the AESC study (p33-34). These show that the average demand reduction is relatively flat.

<sup>190</sup> Interactive effects of Tier 2 APS on space conditioning loads has not yet been adequately studied.

## 5.3 HVAC End Use

### 5.3.1 Air Source Heat Pump

#### DESCRIPTION

A heat pump provides heating or cooling by moving heat between indoor and outdoor air.

This measure characterizes:

a) New Construction:

- The installation of a new residential sized ( $\leq 65,000$  Btu/hr) Air Source Heat Pump system meeting ENERGY STAR efficiency standards presented below in a new home.
- Note the baseline in this case should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition.

b) Time of Sale:

- The installation of a new residential sized ( $\leq 65,000$  Btu/hr) Air Source Heat Pump that is more efficient than required by federal standards. This relates to the replacement of an existing unit at the end of its useful life.
- Note the baseline in this case is an equivalent replacement system to that which exists currently in the home. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, just an electric utility or just a gas utility.

c) Early Replacement:

The early removal of functioning electric or gas heating and/or cooling (SEER 10 or under if present) systems from service, prior to its natural end of life, and replacement with a new high efficiency air source heat pump unit.

Note the baseline in this case is the existing equipment being replaced. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, just an electric utility or just a gas utility.

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or
- The existing unit requires minor repairs ( $< \$276$  per ton).<sup>191</sup>
- All other conditions will be considered Time of Sale.

The Baseline SEER of the existing unit replaced:

- If the SEER of the existing unit is known and  $\leq 10$ , the Baseline SEER is the actual SEER value of the unit replaced. If the SEER is  $> 10$ , the Baseline SEER = 14.
- If the SEER of the existing unit is unknown use assumptions in variable list below (SEER\_exist and HSPF\_exist).
- If the operational status or repair cost of the existing unit is unknown, use time of sale assumptions.

A weighted average early replacement rate is provided for use when the actual baseline early replacement rates are unknown.<sup>192</sup>

---

<sup>191</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement. Note the non-inflated cost is used as this would be a cost consideration in the program year.

<sup>192</sup> Based upon research from “Home Energy Efficiency Rebate Program GPY2 Evaluation Report” which outlines early replacement rates for both primary and secondary central air cooling (CAC) and residential furnaces. This is used as a



**Deemed Early Replacement Rates For ASHP**

	Deemed Early Replacement Rate
Early Replacement Rate for ASHP participants	7%

Note it is not appropriate to claim additional ECM fan savings (from 5.3.5 Furnace Blower Motor) due to installing new ASHP units with an ECM, since the SEER/EER/HSPF ratings already account for this electrical load.

Quality Installation:

Additional savings are attributed to the Quality Installation (QI) of the system. QI programs should follow industry standards such as those described in ENERGY STAR Verified HVAC Installation Program (ESVI), ANSI ACCA QI5 and QI9vp. This must include considerations of system design (including sizing, matching, ventilation calculations) and equipment installation (including static pressure, airflow, refrigerant charge) and may also consider distribution.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

A new residential sized (<= 65,000 Btu/hr) air source heat pump with specifications to be determined by program.

**DEFINITION OF BASELINE EQUIPMENT**

New Construction:

To calculate savings with an electric baseline, the baseline equipment is assumed to be an Air Source Heat Pump meeting the Federal Standard efficiency level; 14 SEER, 8.2 HSPF and 11 EER.<sup>193</sup>

To calculate savings with a furnace/central AC baseline, the baseline equipment is assumed to be an 80% AFUE Furnace and central AC meeting the Federal Standard efficiency level; 13 SEER, 10.5 EER.<sup>194</sup>

Time of Sale: The baseline for this measure is a new replacement unit of the same system type as the existing unit, meeting the baselines provided below.

Unit Type	Efficiency Standard
ASHP	14 SEER, 11 EER, 8.2 HSPF
Gas Furnace	80% AFUE
Gas Boiler	84% AFUE
Central AC	13 SEER, 10.5 EER

Early replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating and cooling equipment for the assumed remaining useful life of the existing unit and a new baseline heating and cooling system for the remainder of the measure life (as provided in table above except for Gas Furnace where new baseline assumption is 90% due to pending standard change).

---

reasonable proxy for ASHP installations since ASHP specific data is not available. Report presented to Nicor Gas Company February 27, 2014.

<sup>193</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>194</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 16 years.<sup>195</sup>

Remaining life of existing equipment is assumed to be 6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers<sup>196</sup> and 16 years for electric resistance.<sup>197</sup>

**DEEMED MEASURE COST**

New Construction and Time of Sale: The actual installed cost of the Air Source Heat Pump (including any necessary electrical or distribution upgrades required) should be used minus the assumed installation cost of the baseline equipment (\$1,381 per ton for a new baseline ASHP, \$2,011 for a new baseline 80% AFUE furnace or \$4,053 for a new 84% AFUE boiler<sup>198</sup> and \$952 per ton for new baseline Central AC replacement<sup>199</sup>).

Early Replacement: The actual full installation cost of the Air Source Heat Pump (including any necessary electrical or distribution upgrades required) should be used. The assumed deferred cost (after 8 years) of replacing existing equipment with a new baseline unit is assumed to be \$1,584 per ton for a new baseline Air Source Heat Pump, or \$3,030 for a new baseline 90% AFUE furnace or \$4,649 for a new 84% AFUE boiler and \$1,092 per ton for new baseline Central AC replacement.<sup>200</sup> This future cost should be discounted to present value using the nominal societal discount rate.

If the install cost of the efficient Air Source Heat Pump is unknown, assume the following (note these costs are per ton of unit capacity);<sup>201</sup> however, because these assumptions do not include any additional costs that may be required for fuel switch scenarios, these defaults should not be used and actual costs should always be used for fuel switch measures:

Efficiency (SEER)	Full Efficient ASHP Cost (including labor)
14.5	\$1,381 / ton + \$123
15	\$1,381 / ton + \$303
16	\$1,381 / ton + \$438
17	\$1,381 / ton + \$724
18	\$1,381 / ton + \$724

Quality Installation: The additional design and installation work associated with quality installation has been estimated to cost an additional \$150.<sup>202</sup>

**LOADSHAPE**

Loadshape R10 - Residential Electric Heating and Cooling

<sup>195</sup> Based on 2016 DOE Rulemaking Technical Support document, as recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

<sup>196</sup> Assumed to be one third of effective useful life of replaced equipment.

<sup>197</sup> Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.

<sup>198</sup> Furnace and boiler costs are based on data provided in Appendix E of the Appliance Standards Technical Support Documents including equipment cost and installation labor.

<sup>199</sup> Based on 3 ton initial cost estimate for a conventional unit from ENERGY STAR Central AC calculator.

<sup>200</sup> All baseline replacement costs are consistent with their respective measures and include inflation rate of 1.98%.

<sup>201</sup> Baseline cost per ton derived from DEER 2008 Database Technology and Measure Cost Data. See ‘ASHP\_Revised DEER Measure Cost Summary.xls’ for calculation. Efficiency cost increment consistent with Cadmus ‘HVAC Program: Incremental Cost Analysis Update’, December 19, 2016 study results.

<sup>202</sup> Based on data provided by MidAmerican in April 2018 summarizing survey results from 11 HVAC suppliers in Iowa.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM’s Forward Capacity Market.

CF <sub>SSP, SF</sub>	= Summer System Peak Coincidence Factor for Heat Pumps in single-family homes (during utility peak hour)  = 72% <sup>203</sup>
CF <sub>PJM, SF</sub>	= PJM Summer Peak Coincidence Factor for Heat Pumps in single-family homes (average during PJM peak period)  = 46.6% <sup>204</sup>
CF <sub>SSP, MF</sub>	= Summer System Peak Coincidence Factor for Heat Pumps in multi-family homes (during system peak hour)  = 67% <sup>205</sup>
CF <sub>PJM, MF</sub>	= PJM Summer Peak Coincidence Factor for Heat Pumps in multi-family homes (average during peak period)  = 28.5%

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS AND NATURAL GAS SAVINGS**

Non fuel switch measures:

$$\Delta kWh = ((FLH_{cooling} * Capacity_{cooling} * (1/(SEER_{base} * (1 - DeratingCool_{base})) - 1/(SEER_{ee} * SEER_{adj} * (1 - DeratingCool_{eff})))) / 1000) + ((FLH_{heat} * Capacity_{heating} * (1/(HSPF_{base} * (1 - DeratingHeat_{base})) - 1/(HSPF_{ee} * HSPF_{adj} * (1 - DeratingHeat_{eff})))) / 1000)$$

Fuel switch measures:

Fuel switch measures must produce positive total annual source fuel savings (i.e., reduction in source Btus) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

---

<sup>203</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>204</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>205</sup> Multifamily coincidence factors both from; *All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems*, Cadmus, October 2015

$$\begin{aligned} \text{SourceEnergySavings (MMBTUs)} &= \text{GasHeatReplaced} - \text{ASHPSourceHeatConsumed} + \text{ASHPSourceCoolingImpact} \\ \text{GasHeatReplaced}^{206} &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{\text{base}}) / 1,000,000] \\ \text{ASHPSourceHeatConsumed} &= [(\text{FLHheat} * \text{Capacity\_heating} * (1/(\text{HSPF}_{\text{ee}} * \text{HSPF}_{\text{adj}} * (1 - \text{DeratingHeat}_{\text{Eff}})))) / 1000] * H_{\text{grid}} / 1,000,000 \\ \text{ASHPSourceCoolingImpact} &= [(\text{FLHcool} * \text{Capacity\_cooling} * (1/(\text{SEER}_{\text{base}} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{SEER}_{\text{ee}} * \text{SEER}_{\text{adj}} * (1 - \text{DeratingCool}_{\text{Eff}})))) / 1000] * H_{\text{grid}} / 1,000,000 \end{aligned}$$

If SourceEnergySavings calculated above is positive, the measure is eligible.

Two electric algorithms and one gas algorithm are provided below. The appropriate claim is dependent on which utilities are supporting the measure as provided in a table below.

$$\begin{aligned} \Delta\text{kWh}_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline ASHP}] \\ &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/(\text{HSPF}_{\text{baseASHP}} * (1 - \text{DeratingHeat}_{\text{Base}})))/1000] \\ \Delta\text{kWh}_{\text{EfficiencyImprovement}} &= [\text{Cooling Savings}] + [\text{Heat Savings from Baseline ASHP to Efficient ASHP}] \\ &= ((\text{FLH\_cooling} * \text{Capacity\_cooling} * (1/(\text{SEER}_{\text{base}} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{SEER}_{\text{ee}} * \text{SEER}_{\text{adj}} * (1 - \text{DeratingCool}_{\text{Eff}})))) / 1000) + ((\text{FLH\_heat} * \text{Capacity\_heating} * (1/(\text{HSPF}_{\text{baseASHP}} * (1 - \text{DeratingHeat}_{\text{Base}})) - 1/(\text{HSPF}_{\text{ee}} * \text{HSPF}_{\text{adj}} * (1 - \text{DeratingHeat}_{\text{Eff}})))) / 1000) \\ \Delta\text{Therm}_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline gas system}] \\ &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{\text{base}}) / 100,000] \end{aligned}$$

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$\Delta\text{kWh}_{\text{EfficiencyImprovement}} - \Delta\text{kWh}_{\text{FuelSwitch}} + (\Delta\text{Therm}_{\text{FuelSwitch}}/\text{kWh to Therm})$	N/A
Electric and gas utility	$\Delta\text{kWh}_{\text{EfficiencyImprovement}}$	$\Delta\text{Therm}_{\text{FuelSwitch}} - (\Delta\text{kWh}_{\text{FuelSwitch}} * \text{kWh to Therm})$
Gas utility only	N/A	$\Delta\text{Therm}_{\text{FuelSwitch}} - (\Delta\text{kWh}_{\text{FuelSwitch}} * \text{kWh to Therm}) + (\Delta\text{kWh}_{\text{EfficiencyImprovement}} * \text{kWh to Therm})$

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

$$\begin{aligned} \text{FLH\_cooling} &= \text{Full load hours of air conditioning} \\ &= \text{dependent on location:} \end{aligned}$$

<sup>206</sup> Note the Gas Source to Site ratio is assumed to be 1.0.

Climate Zone (City based upon)	FLH_cooling (single family) <sup>207</sup>	FLH_cooling (general multifamily) <sup>208</sup>	FLH_cooling (weatherized multifamily) <sup>209</sup>
1 (Rockford)	512	467	299
2 (Chicago)	570	506	324
3 (Springfield)	730	663	425
4 (Belleville)	1,035	940	603
5 (Marion)	903	820	526
Weighted Average <sup>210</sup>	629	564	362

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

Capacity\_cooling = Cooling Capacity of Air Source Heat Pump (Btu/hr)

= Actual (1 ton = 12,000Btu/hr)SEER\_base = Seasonal Energy Efficiency Ratio of baseline unit (kBtu/kWh). For early replacment measures, the actual SEER rating where it is possible to measure or reasonably estimate should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC), if unknown assume default provided below:

Baseline/Existing Cooling System	SEER_base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	9.3 <sup>211</sup>		14 <sup>212</sup>
Central AC	9.3 <sup>213</sup>		13 <sup>214</sup>
No central cooling	Make ‘1/SEER_exist’ = 0 <sup>215</sup>		13 <sup>216</sup>

SEER\_ee = Rated Seasonal Energy Efficiency Ratio of ENERGY STAR unit (kBtu/kWh)  
= Actual, or 15 if unknown.<sup>217</sup>

<sup>207</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCDC) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>208</sup> Ibid.

<sup>209</sup> *All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems*, Cadmus, October 2015. The multifamily units within this study had undergone significant shell improvements (air sealing and insulation) and therefore this set of assumptions is only appropriate for units that have recently participated in a weatherization or other shell program. Note that the FLHcool where recalculated based on existing efficiencies consistent with the TRM rather than from the metering study.

<sup>210</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>211</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>212</sup> Minimum Federal Standard as of 1/1/2015

<sup>213</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>214</sup> Minimum Federal Standard; Federal Register, Vol. 66, No. 14, Monday, January 22, 2001/Rules and Regulations, p. 7170-7200.

<sup>215</sup> If there is no central cooling in place but the incentive encourages installation of a new ASHP with cooling, the added cooling load should be subtracted from any heating benefit.

<sup>216</sup> Assumes that the decision to replace existing systems includes desire to add cooling.

<sup>217</sup> ENERGY STAR minimum.

SEER<sub>adj</sub> = Adjustment percentage to account for in-situ performance of the unit<sup>218</sup>  
 =  $[(0.805 \times (\frac{EER_{ee}}{SEER_{ee}})) + 0.367]$

DeratingCool<sub>Eff</sub> = Efficient ASHP Cooling derating  
 = 0% if Quality Installation is performed  
 = 10% if Quality Installation is not performed or unknown<sup>219</sup>

DeratingCool<sub>Base</sub> = Baseline Cooling derating  
 = 10%

FLH<sub>heat</sub> = Full load hours of heating  
 = Dependent on location and home type:

Climate Zone (City based upon)	FLH <sub>heat</sub> (single family and general multifamily) <sup>220</sup>	FLH <sub>heat</sub> (weatherized multifamily) <sup>221</sup>
1 (Rockford)	1,969	748
2 (Chicago)	1,840	699
3 (Springfield)	1,754	667
4 (Belleville)	1,266	481
5 (Marion)	1,288	489
Weighted Average <sup>222</sup>	1,821	692

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

Capacity<sub>heating</sub> = Heating Capacity of Air Source Heat Pump (Btu/hr)  
 = Actual (1 ton = 12,000Btu/hr)

HSPF<sub>base</sub> = Heating System Performance Factor of baseline heating system (kBtu/kWh). For early replacement measures, use actual HSPF rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment (6 years for ASHP, 16 years for electric resistance). If unknown assume default:

<sup>218</sup> In situ performance based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

<sup>219</sup> Based on Cadmus assumption provided in preparation of the 2014 Interstate Power and Light TRM based upon proper refrigerant charge, evaporator airflow, and unit sizing, Appears conservative in comparison to ENERGY STAR statements ([see](#) ‘Sponsoring an ENERGY STAR Verified HVAC Installation (ESVI) Program’). Note pending ComEd evaluation will provide an update to these assumptions.

<sup>220</sup> Full load heating hours for heat pumps are provided for Rockford, Chicago and Springfield in the ENERGY STAR Calculator. Estimates for the other locations were calculated based on the FLH to Heating Degree Day (from NCDC) ratio. VEIC consider ENERGY STAR estimates to be high due to oversizing not being adequately addressed. Using average Illinois billing data (from ICC [commerce Commission](#)) VEIC estimated the average gas heating load and used this to estimate the average home heating output (using 83% average gas heat efficiency). Dividing this by a typical 36,000 Btu/hr ASHP gives an estimate of average ASHP FLH<sub>heat</sub> of 1821 hours. We used the ratio of this value to the average of the locations using the ENERGY STAR data (1994 hours) to scale down the ENERGY STAR estimates. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>221</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015.

<sup>222</sup> Weighted based on number of occupied residential housing units in each zone.

Baseline/ Existing Heating System	HSPF_base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	5.54 <sup>223</sup>	8.2 <sup>224</sup>	
Electric Resistance	3.41 <sup>225</sup>		

HSPF\_ee = Heating System Performance Factor of efficient Air Source Heat Pump (kBtu/kWh)

= Actual or 8.5 if unknown<sup>226</sup>

HSPFadj = Adjustment percentage to account for the heating capacity ratio of the efficient unit<sup>227</sup>

$$= \left[ \left( \frac{17^\circ\text{F Capacity}}{47^\circ\text{F Capacity}} \right) \times 0.158 + 0.899 \right]$$

= Actual using AHRI lookup values for efficient unit heating capacities rated at 17°F and 47°F. If not available assume 1.<sup>228</sup>

DeratingHeat<sub>Eff</sub> = Efficient ASHP Heating derating

= 0% if Quality Installation is performed

= 10% if Quality Installation is not performed<sup>229</sup>

DeratingHeat<sub>Base</sub> = Baseline Heating derating

= 10%

AFUEbase = Baseline Annual Fuel Utilization Efficiency Rating. For early replacement measures, use actual AFUE rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment (7 years for furnace, 8 years for boilers). If unknown assume default:

Baseline/ Existing Heating System	AFUEbase		
	Early Replacement (Remaining useful life of existing equipment) <sup>230</sup>	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Furnace	64.4%	90% <sup>231</sup>	80%

<sup>223</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>224</sup> Based on Minimum Federal Standard effective 1/1/2015.

<sup>225</sup> Electric resistance has a COP of 1.0 which equals 1/0.293 = 3.41 HSPF.

<sup>226</sup> ENERGY STAR minimum.

<sup>227</sup> In situ performance based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>228</sup> In situ performance based on Guidehouse review of 201 ASHP installs. While the data indicated an average of 1.006, the range was 0.9 to 1.06 so calculation of this value should be done where possible.

<sup>229</sup> Based on Cadmus assumption provided in preparation of the 2014 Interstate Power and Light TRM based upon proper refrigerant charge, evaporator airflow, and unit sizing, Assumed consistent for heating and cooling. Appears conservative in comparison to ENERGY STAR statements (see 'Sponsoring an ENERGY STAR Verified HVAC Installation (ESVI) Program'). Note pending ComEd evaluation will provide an update to these assumptions.

<sup>230</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

<sup>231</sup> Assumes that Federal Standard will have been increased to 90% by the time the existing unit would have to have been

Baseline/ Existing Heating System	AFUEbase		
	Early Replacement (Remaining useful life of existing equipment) <sup>230</sup>	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Boiler	61.6%	84% <sup>232</sup>	82%

kWhtoTherm = Conversion between kWh at source/generation and Therms  
 =  $H_{grid} / 100000$

$H_{grid}$  = Heat rate of the grid in btu/kWh based on the average fossil heat rate for the EPA eGRID subregion and includes a factor that considers T&D losses.

For systems operating less than 6,500 hrs per year:

Use the Non-baseload heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest).<sup>233</sup> Also include any line losses.

For systems operating more than 6,500 hrs per year:

Use the All Fossil Average heat rate provided by EPA eGRID for RFC West region for ComEd territory, and SERC Midwest region for Ameren territory. Also include any line losses.

replaced.

<sup>232</sup> Federal standards for boilers manufactured on or after January 15, 2021.

<sup>233</sup> These values are subject to regular updates so should be reviewed regularly to ensure the current assumptions are correct. Refer to the latest EPA eGRID data. Current values, based on eGrid 2018 are:

- Non-Baseload RFC West: 10,024 Btu/kWh \* (1 + Line Losses)
- Non-Baseload SERC Midwest: 9,871 Btu/kWh \* (1 + Line Losses)
- All Fossil Average RFC West: 9,575 Btu/kWh \* (1 + Line Losses)
- All Fossil Average SERC Midwest: 10,369 Btu/kWh \* (1 + Line Losses)



**Non Fuel Switch Illustrative Examples**

Time of Sale using ASHP baseline:

For example, an ASHP is installed in a single-family home in Marion with the following nameplate information: 15 SEER, 12EER, 9 HSPF; Cooling capacity: 34,800 Btuh; Heating capacity at 47°F: 33,000 Btuh; Heating capacity at 17°F: 21,200 Btuh with Quality Installation;

$$\% SEER_{adj} = 0.805 \times \left( \frac{EER_{ee}}{SEER_{ee}} \right) + 0.367 = 1.011$$

$$\% HSPF_{adj} = \left( \frac{17^\circ F \text{ Capacity}}{47^\circ F \text{ Capacity}} \right) \times 0.158 + 0.899 = 1.001$$

$$\begin{aligned} \Delta kWh &= ((903 * 34,800 * (1/(14 * (1 - 0.1)) - 1/(15 * 1.011 * (1 - 0)))) / 1000) + ((1,288 * 33,000 * \\ &(1/(8.2 * (1 - 0.1)) - 1/(9 * 1.001 * (1-0)))) / 1000) \\ &= 1463 \text{ kWh} \end{aligned}$$

Early Replacement:

For example, a 15 SEER, 12EER, 9 HSPF Air Source Heat Pump with nameplate information as above replaces an existing working Air Source Heat Pump with unknown efficiency ratings in a single family home in Marion:

ΔkWh for remaining life of existing unit (1st 6 years):

$$\begin{aligned} &= ((903 * 34,800 * (1/(9.3 * (1-0.1)) - 1/(15 * 1.011 * (1-0)))) / 1000) + ((1,288 * 33,000 * (1/(5.54 * \\ &(1-0.1)) - 1/(9 * 1.001 * (1-0)))) / 1000) \\ &= 5489 \text{ kWh} \end{aligned}$$

ΔkWh for remaining measure life (next 12 years):

$$\begin{aligned} &= ((903 * 34,800 * (1/(14 * (1 - 0.1)) - 1/(15 * 1.011 * (1 - 0)))) / 1000) + ((1,288 * 33,000 * (1/(8.2 * \\ &(1 - 0.1)) - 1/(9 * 1.001 * (1-0)))) / 1000) \\ &= 1463 \text{ kWh} \end{aligned}$$

**Fuel Switch Illustrative Examples**

*[for illustrative purposes a Heat Rate of 10,000 Btu/kWh is used, kWh to Therm = 10,000/100,000 = 0.1]*

New construction using gas furnace and central AC baseline:

For example a three ton (Cooling capacity of 34,800Btuh and Heating capacity of 33,000 Btuh), 15 SEER, 12EER, 9 HSPF Air Source Heat Pump installed in single-family home in Marion with Quality Installation, in place of a natural gas furnace and 3 ton Central AC unit:

$$\text{SourceEnergySavings (MMBTUs)} = \text{GasHeatReplaced} - \text{ASHPSourceHeatConsumed} + \text{ASHPSourceCoolingImpact}$$

$$\begin{aligned} \text{GasHeatReplaced} &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{\text{base}}) / 1,000,000] \\ &= [(1288 * 33,000 * 1/0.8) / 1000000] \\ &= 53.1 \text{ MMBtu} \end{aligned}$$

$$\begin{aligned} \text{ASHPSourceHeatConsumed} &= [(\text{FLHheat} * \text{Capacity\_heating} * (1/(\text{HSPF}_{\text{ee}} * \text{HSPF}_{\text{adj}} * (1 - \\ &\text{DeratingHeat}_{\text{Eff}})))) / 1000] * H_{\text{grid}} / 1,000,000 \\ &= [(1,288 * 33,000 * (1/(9 * 1.001 * (1-0)))) / 1000] * 10,000/1,000,000 \\ &= 47.2 \text{ MMBtu} \end{aligned}$$

$$\begin{aligned} \text{ASHPSourceCoolingImpact} &= [(\text{FLHcool} * \text{Capacity\_cooling} * (1/(\text{SEER}_{\text{base}} * (1 - \text{DeratingCool}_{\text{Base}})) \\ &- 1/(\text{SEER}_{\text{ee}} * \text{SEER}_{\text{adj}} * (1 - \text{DeratingCool}_{\text{Eff}})))) / 1000] * H_{\text{grid}} / 1,000,000 \\ &= ((903 * 34,800 * (1/(13 * (1-0.1)) - 1/(15 * 1.011 * (1-0)))) / 1000) * \\ &10,000/1,000,000 \\ &= 6.1 \text{ MMBtu} \end{aligned}$$

$$\text{SourceEnergySavings (MMBTUs)} = 53.1 - 47.2 + 6.1 = 12 \text{ MMBtu}$$

**Fuel Switch Illustrative Example continued**

$$\begin{aligned} \Delta kWh_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline ASHP}] \\ &= [(1288 * 33,000 * 1/(8.2 * (1-0.1)))/1000] \\ &= 5,759 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{\text{EfficiencyImprovement}} &= [\text{Cooling Savings}] + [\text{Heat Savings from Baseline ASHP to GSHP}] \\ &= ((903 * 34,800 * (1/(13 * (1-0.1)) - 1/(15 * 1.011 * (1-0)))) / 1000) + ((1,288 * 33,000 * (1/(8.2 * (1-0.1)) - 1/(9 * 1.001 * (1-0)))) / 1000) \\ &= 614 + 1,041 \\ &= 1,655 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline gas system}] \\ &= [(1288 * 33,000 * 1/0.8) / 100,000] \\ &= 531 \text{ Therms} \end{aligned}$$

Savings would be claimed as follows:

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	1655 - 5759 + (531/0.1) = 1206 kWh	N/A
Electric and gas utility	1655 kWh	531 - (5,759 * 0.1) = -45 therms
Gas utility only	N/A	531 - (5,759 * 0.1) + (1655 * 0.1) = 120.6 therms

Early Replacement fuel switch:

For example a three ton (Cooling capacity of 34,800Btuh and Heating capacity of 33,000 Btuh), 15 SEER, 12EER, 9 HSPF Air Source Heat Pump installed in single-family home in Marion with Quality Installation, replaces an existing working natural gas furnace and 3 ton Central AC unit with unknown efficiency ratings:

$$\text{SourceEnergySavings (MMBTUs)} = \text{LifetimeGasHeatReplaced} - \text{LifetimeASHPSourceHeatConsumed} + \text{LifetimeASHPSourceCoolingImpact}$$

$$\begin{aligned} \text{LifetimeGasHeatReplaced} &= [(FLH_{\text{heat}} * \text{Capacity}_{\text{heating}} * 1/AFUE_{\text{exist}}) / 1,000,000] * 7 \text{ years} + [(FLH_{\text{heat}} * \text{Capacity}_{\text{heating}} * 1/AFUE_{\text{base}}) / 1,000,000] * 9 \text{ years} \\ &= (((1288 * 33,000 * 1/0.644) / 1000000) * 7) + (((1288 * 33,000 * 1/0.8) / 1000000) * 9) \\ &= 940.2 \text{ MMBtu} \end{aligned}$$

$$\begin{aligned} \text{LifetimeASHPSourceHeatConsumed} &= [(FLH_{\text{heat}} * \text{Capacity}_{\text{heating}} * (1/(HSPF_{\text{ee}} * HSPF_{\text{adj}} * (1 - \text{DeratingHeat}_{\text{Eff}})))) / 1000] * H_{\text{grid}} / 1,000,000 * 16 \text{ years} \\ &= [(1,288 * 33,000 * (1/(9 * 1.001 * (1-0)))) / 1000] * 10,000/1,000,000 * 16 \\ &= 754.9 \text{ MMBtu} \end{aligned}$$

$$\begin{aligned} \text{LifetimeASHPSourceCoolingImpact} &= ((FLH_{\text{cool}} * \text{Capacity}_{\text{cooling}} * (1/(SEER_{\text{exist}} * (1 - \text{DeratingCool}_{\text{base}})) - 1/(SEER_{\text{ee}} * SEER_{\text{adj}} * (1 - \text{DeratingCool}_{\text{Eff}}))))/1000) * 6 \text{ years} + ((FLH_{\text{cool}} * \text{Capacity}_{\text{cooling}} * (1/(SEER_{\text{base}} * (1 - \text{DeratingCool}_{\text{base}})) - 1/(SEER_{\text{ee}} * SEER_{\text{adj}} * (1 - \text{DeratingCool}_{\text{Eff}}))))/1000) * 10 \text{ years}) * H_{\text{grid}} / 1,000,000 \\ &= ((903 * 34,800 * (1/(9.3 * (1-0.1)) - 1/(15 * 1.011 * (1-0)))) / 1000) * 10,000/1,000,000 * 6 + ((903 * 34,800 * (1/(13 * (1-0.1)) - 1/(15 * 1.011 * (1-0)))) / 1000) * 10,000/1,000,000 * 10) \\ &= 162.3 \text{ MMBtu} \end{aligned}$$

$$\text{SourceEnergySavings (MMBTUs)} = 940.2 - 754.9 + 162.3 = 347.6 \text{ MMBtu}$$

**Fuel Switch Illustrative Example continued**

$$\begin{aligned} \Delta kWh_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline ASHP}] \\ &= [(1288 * 33,000 * 1 / (8.2 * (1-0.1))) / 1000] \\ &= 5,759 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{\text{EfficiencyImprovement}} \text{ (Remaining Useful Life)} &= [\text{Cooling Savings from existing to ASHP}] + [\text{Heat Savings from Baseline ASHP to GSHP}] \\ &= ((903 * 34,800 * (1 / (9.3 * (1-0.1)) - 1 / (15 * 1.011 * (1-0)))) / 1000) + ((1,288 * 33,000 * (1 / (8.2 * (1-0.1)) - 1 / (9 * 1.001 * (1-0)))) / 1000) \\ &= 1,682.2 + 1,041.4 \\ &= 2,724 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{\text{EfficiencyImprovement}} \text{ (Remaining measure)} &= [\text{Cooling Savings from new baseline to ASHP}] + [\text{Heat Savings from Baseline ASHP to GSHP}] \\ &= ((903 * 34,800 * (1 / (13 * (1-0.1)) - 1 / (15 * 1.011 * (1-0)))) / 1000) + ((1,288 * 33,000 * (1 / (8.2 * (1-0.1)) - 1 / (9 * 1.001 * (1-0)))) / 1000) \\ &= 614 + 1,041 \\ &= 1,655 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch}} \text{ (Remaining Useful Life)} &= [\text{Heat consumption of existing gas system}] \\ &= [(1288 * 33,000 * 1 / 0.644) / 100,000] \\ &= 660 \text{ Therms} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch}} \text{ (Remaining Measure)} &= [\text{Heat consumption of new baseline gas system}] \\ &= [(1288 * 33,000 * 1 / 0.9) / 100,000] \\ &= 472 \text{ Therms} \end{aligned}$$

Savings would be claimed as follows:

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$2724 - 5759 + (660/0.1)$ = 3565 kWh for 1 <sup>st</sup> 7 years  $1655 - 5759 + (472/0.1)$ = 616 kWh for remaining 9 years	N/A
Electric and gas utility	2724 kWh for 1 <sup>st</sup> 7 years 1655 kWh for remaining 9 years	$660 - (5,759 * 0.1)$ = 84 therms for 1 <sup>st</sup> 7 years  $472 - (5,759 * 0.1)$ = -104 therms for remaining 9 years
Gas utility only	N/A	$660 - (5,759 * 0.1) + (2724 * 0.1)$ = 356 therms for 1st 7 years  $472 - (5,759 * 0.1) + (1655 * 0.1)$ = 62 therms for remaining 9 years

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\text{Capacity}_{\text{cooling}} * (1/(\text{EER}_{\text{base}} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{EER}_{\text{ee}} * (1 - \text{DeratingCool}_{\text{Eff}})))) / 1000 * CF$$

Where:

**EER<sub>base</sub>** = Energy Efficiency Ratio of baseline unit (kBtu/kWh). For early replacement measures, the actual EER rating where it is possible to measure or reasonably estimate should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC). If using rated efficiencies, derate efficiency value by 1% per year to account for degradation over time.<sup>234</sup> If unknown, assume default provided below:

Baseline/Existing Cooling System	EER <sub>base</sub>		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	7.5 <sup>235</sup>	11 <sup>236</sup>	
Central AC	7.5 <sup>237</sup>		10.5 <sup>238</sup>
No central cooling	Make '1/EER <sub>exist</sub> ' = 0 <sup>239</sup>		10.5

**EER<sub>ee</sub>** = Energy Efficiency Ratio of efficient Air Source Heat Pump (kBtu/hr / kW)  
 = Actual. If unknown, assume 12.5 EER.<sup>240</sup>

**CF<sub>SSP, SF</sub>** = Summer System Peak Coincidence Factor for Heat Pumps in single-family homes (during system peak hour)  
 = 72%<sup>241</sup>

**CF<sub>PJM, SF</sub>** = PJM Summer Peak Coincidence Factor for Heat Pumps in single-family homes (average during peak period)  
 = 46.6%<sup>242</sup>

**CF<sub>SSP, MF</sub>** = Summer System Peak Coincidence Factor for Heat Pumps in multi-family homes (during system peak hour)  
 = 67%<sup>243</sup>

<sup>234</sup> Justification for degradation factors can be found on page 21 of 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>235</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>236</sup> The Federal Standard does not include an EER requirement. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>237</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>238</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>239</sup> If there is no central cooling in place but the incentive encourages installation of a new ASHP with cooling, the added cooling load should be subtracted from any heating benefit.

<sup>240</sup> ENERGY STAR minimum.

<sup>241</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>242</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>243</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015

$CF_{PJM, MF}$  = PJM Summer Peak Coincidence Factor for Heat Pumps in multi-family homes (average during peak period)  
 = 28.5%

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

Time of Sale:

**For example**, a three ton, 15 SEER, 12EER, 9 HSPF Air Source Heat Pump installed in single-family home in Marion with Quality Installation:

$$\Delta kW_{SSP} = (36,000 * (1/(11 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.72$$

$$= 0.458 \text{ kW}$$

$$\Delta kW_{PJM} = (36,000 * (1/(11 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.466$$

$$= 0.297 \text{ kW}$$

Early Replacement:

**For example**, a three ton, 15 SEER, 12EER, 9 HSPF Air Source Heat Pump replaces an existing working Air Source Heat Pump with unknown efficiency ratings in single-family home in Marion with Quality Installation:

$\Delta kW_{SSP}$  for remaining life of existing unit (1st 6 years):

$$= (36,000 * (1/(7.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.72$$

$$= 1.68 \text{ kW}$$

$\Delta kW_{SSP}$  for remaining measure life (next 12 years):

$$= (36,000 * (1/(11 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.72$$

$$= 0.458 \text{ kW}$$

$\Delta kW_{PJM}$  for remaining life of existing unit (1st 6 years):

$$= (36,000 * (1/(7.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.466$$

$$= 1.087 \text{ kW}$$

$\Delta kW_{PJM}$  for remaining measure life (next 12 years):

$$= (36,000 * (1/(11 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.466$$

$$= 0.297 \text{ kW}$$

**NATURAL GAS SAVINGS**

Calculation provided together with Electric Energy Savings above.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING**

This measure can involve fuel switching from gas to electric.

For the purposes of forecasting load reductions due to fuel switch GSHP projects per Section 16-111.5B, changes in site energy use at the customer’s meter (using  $\Delta kWh$  algorithm below) adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, this will not match the output of the calculation/allocation methodology presented in the “Electric Energy Savings” and “Natural Gas Savings” sections above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure.

$$\begin{aligned} \Delta\text{Therms} &= [\text{Heating Consumption Replaced}] \\ &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{\text{base}}) / 100,000] \\ \Delta\text{kWh} &= - [\text{ASHP heating consumption}] + [\text{Cooling savings}] \\ &= - [(\text{FLHheat} * \text{Capacity\_heating} * (1/(\text{HSPF\_ee} * \text{HSPFadj} * (1 - \text{DeratingHeat}_{\text{Eff}}))))/1000] \\ &\quad + [(\text{FLHcool} * \text{Capacity\_cooling} * (1/(\text{SEER\_base} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{SEER\_ee} * \text{SEERadj} * (1 - \text{DeratingCool}_{\text{Eff}}))))/1000] \end{aligned}$$

**MEASURE CODE: RS-HVC-ASHP-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

### 5.3.2 Boiler Pipe Insulation

**DESCRIPTION**

This measure describes adding insulation to un-insulated boiler pipes in un-conditioned basements or crawlspaces. This measure was developed to be applicable to the following program types: TOS, RNC, RF, DI. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

The efficient case is installing pipe wrap insulation to a length of boiler pipe.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline is an un-insulated boiler pipe.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 15 years.<sup>244</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 13 years.<sup>245</sup> See section below for detail.

**DEEMED MEASURE COST**

The measure cost including material and installation is assumed to be \$3 per linear foot.<sup>246</sup>

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta_{\text{Therm}} = (((1/R_{\text{exist}} * C_{\text{exist}}) - (1/R_{\text{new}} * C_{\text{new}})) * \text{FLH\_heat} * L * \Delta T) / \eta_{\text{Boiler}} / 100,000$$

---

<sup>244</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

<sup>245</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

<sup>246</sup> Consistent with DEER 2008 Database Technology and Measure Cost Data.

Where:

$R_{exist}$  = Pipe heat loss coefficient of uninsulated pipe (existing) [(hr-°F-ft<sup>2</sup>)/Btu]  
 = 0.5<sup>247</sup>

$R_{new}$  = Pipe heat loss coefficient of insulated pipe (new) [(hr-°F-ft<sup>2</sup>)/Btu]  
 = Actual (0.5 + R value of insulation)

FLH\_heat = Full load hours of heating  
 = Dependent on location:<sup>248</sup>

Climate Zone (City based upon)	FLH_heat
1 (Rockford)	1,969
2 (Chicago)	1,840
3 (Springfield)	1,754
4 (Belleville)	1,266
5 (Marion)	1,288
Weighted Average <sup>249</sup>	1,821

L = Length of boiler pipe in unconditioned space covered by pipe wrap (ft)  
 = Actual

$C_{exist}$  = Circumference of bare pipe (ft) (Diameter (in) \*  $\pi/12$ )  
 = Actual (0.5" pipe = 0.131ft, 0.75" pipe = 0.196ft)

$C_{new}$  = Circumference of pipe with insulation (ft) ((Diameter of pipe (in)) + ([Thickness of Insulation (in)]\*2)) \*  $\pi/12$ )  
 = Actual

$\Delta T$  = Average temperature difference between circulated heated water and unconditioned space air temperature (°F)<sup>250</sup>

Pipes in unconditioned basement:

Outdoor reset controls	$\Delta T$ (°F)
Boiler without reset control	110

<sup>247</sup> Assumption based on data obtained from the 3E Plus heat loss calculation software provided by the NAIMA (North American Insulation Manufacturer Association) and derived from Table 15 and Table 16 of 2009 ASHRAE Fundamentals Handbook, Chapter 23 Insulation for Mechanical Systems, page 23.17.

<sup>248</sup> Full load heating hours for heat pumps are provided for Rockford, Chicago and Springfield in the ENERGY STAR Calculator. Estimates for the other locations were calculated based on the FLH to Heating Degree Day (from NCDC) ratio. VEIC consider ENERGY STAR estimates to be high due to oversizing not being adequately addressed. Using average Illinois billing data (from Illinois Commerce Commission) VEIC estimated the average gas heating load and used this to estimate the average home heating output (using 83% average gas heat efficiency). Dividing this by a typical 36,000 Btu/hr ASHP gives an estimate of average ASHP FLH\_heat of 1821 hours. We used the ratio of this value to the average of the locations using the ENERGY STAR data (1994 hours) to scale down the ENERGY STAR estimates. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>249</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>250</sup> Assumes 160°F water temp for a boiler without reset control, 120°F for a boiler with reset control, and 50°F air temperature for pipes in unconditioned basements and the following average heating season outdoor temperatures as the air temperature in crawl spaces: Zone 1 – 33.1, Zone 2 – 34.4, Zone 3 – 37.7, Zone 4 – 40.0, Zone 5 – 39.8, Weighted Average – 35.3 (NCDC 1881-2010 Normals, average of monthly averages Nov – Apr for zones 1-3 and Nov-March for zones 4 and 5).



Outdoor reset controls	ΔT (°F)
Boiler with reset control	70

Pipes in crawl space:

Climate Zone (City based upon)	ΔT (°F)	
	Boiler without reset control	Boiler with reset control
1 (Rockford)	127	87
2 (Chicago)	126	86
3 (Springfield)	122	82
4 (Belleville)	120	80
5 (Marion)	120	80
Weighted Average <sup>251</sup>	125	85

ηBoiler = Efficiency of boiler  
= 0.819<sup>252</sup>

**For example**, insulating 10 feet of 0.75” pipe with R-3 wrap (0.75” thickness) in a crawl space of a Marion home with a boiler without reset control:

$$\Delta_{Therm} = (((1/0.5 * 0.196) - (1/3.5 * 0.589)) * 10 * 120 * 1288) / 0.819 / 100,067$$

$$= 4.2 \text{ therms}$$

### Mid-Life adjustment

In order to account for the likely replacement of existing heating equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηHeat	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 13 years.<sup>253</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

<sup>251</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>252</sup> Average efficiency of boiler units found in Ameren PY3-PY4 data.

<sup>253</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

**MEASURE CODE: RS-HVC-PINS-V04-210101**

**REVIEW DEADLINE: 1/1/2022**

### 5.3.3 Central Air Conditioning

#### DESCRIPTION

This measure characterizes:

- a) Time of Sale:
  - a. The installation of a new residential sized ( $\leq 65,000$  Btu/hr) Central Air Conditioning ducted split system meeting ENERGY STAR SEER efficiency standards presented below. This could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new system in a new home.

- b) Early Replacement:

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or
- The existing unit requires minor repairs ( $< \$190$  per ton).<sup>254</sup>
- All other conditions will be considered Time of Sale.

The Baseline SEER of the existing Central Air Conditioning unit replaced:

- If the SEER of the existing unit is known and  $\leq 10$ , the Baseline SEER is the actual SEER value of the unit replaced. If the SEER is  $> 10$ , the Baseline SEER = 13.
- If the SEER of the existing unit is unknown, use assumptions in variable list below (SEER\_exist).
- If the operational status or repair cost of the existing unit is unknown, use time of sale assumptions.

A weighted average early replacement rate is provided for use when the actual baseline early replacement rate is unknown.<sup>255</sup>

#### Deemed Early Replacement Rates for CAC Units in Combined System Replacement (CSR) Projects

Replacement Scenario for the CAC Unit	Deemed Early Replacement Rate
Early Replacement Rate for a CAC unit when the CAC unit is the Primary unit in a CSR project	14%
Early Replacement Rate for a CAC unit when the CAC unit is the Secondary unit in a CSR project	40%

Note: it is not appropriate to claim additional ECM fan savings (from 5.3.5 Furnace Blower Motor) due to installing new CAC units with an ECM, since the SEER/EER ratings already account for this electrical load.

Quality Installation:

Additional savings are attributed to the Quality Installation (QI) of the system. QI programs should follow industry standards such as those described in ENERGY STAR Verified HVAC Installation Program (ESVI), ANSI ACCA Q15 and Q19vp. This must include considerations of system design (including sizing, matching, ventilation calculations) and equipment installation (including static pressure, airflow, refrigerant charge) and may also consider distribution.

<sup>254</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement. Note the non-inflated cost is used as this would be a cost consideration in the program year.

<sup>255</sup> Based upon research from “Home Energy Efficiency Rebate Program GPY2 Evaluation Report” which outlines early replacement rates for both primary and secondary central air cooling (CAC) and residential furnaces. The unit (furnace or CAC unit) that initially caused the customer to contact a trade ally is defined as the “primary unit”. The furnace or CAC unit that was also replaced but did not initially prompt the customer to contact a trade ally is defined as the “secondary unit”. This evaluation used different criteria for early replacement due to the availability of data after the fact; cost of any repairs  $< \$550$  and age of unit  $< 20$  years. Report presented to Nicor Gas Company February 27, 2014.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

In order for this characterization to apply, the efficient equipment is assumed to be a ducted split central air conditioning unit meeting at least the minimum ENERGY STAR efficiency level standards; 15 SEER and 12.5 EER.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline for the Time of Sale measure is based on the current Federal Standard efficiency level; 13 SEER and an estimate of expected peak rated efficiency of 10.5 EER. It is assumed that ‘Quality Installation’ did not occur.

The baseline for the early replacement measure is the efficiency of the existing equipment for the assumed remaining useful life of the unit and the new baseline as defined above for the remainder of the measure life.<sup>256</sup>

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 18 years.<sup>257</sup>

Remaining life of existing equipment is assumed to be 6 years.<sup>258</sup>

**DEEMED MEASURE COST**

Time of sale: The incremental capital cost for this measure is dependent on efficiency. Assumed incremental costs are provided below.<sup>259</sup>

Efficiency Level (SEER)	Incremental Cost
14	\$104
15	\$108
16	\$221
17	\$620
18	\$620

Early replacement: The full install cost for this measure is the actual cost of removing the existing unit and installing the new one. If this is unknown, assume defaults below.<sup>260</sup>

Efficiency Level (SEER)	Full Retrofit Cost (including labor)
14	\$952 / ton + \$104
15	\$952 / ton + \$108
16	\$952 / ton + \$221
17	\$952 / ton + \$620
18	\$952 / ton + \$620

Assumed deferred cost (after 6 years) of replacing existing equipment with new baseline unit is assumed to be \$3,140.<sup>261</sup> This cost should be discounted to present value using the nominal societal discount rate.

<sup>256</sup> Baseline SEER and EER should be updated when new minimum federal standards become effective.

<sup>257</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

<sup>258</sup> Assumed to be one third of effective useful life

<sup>259</sup> Based on incremental cost results from Cadmus “HVAC Program: Incremental Cost Analysis Update”, December 19, 2016.

<sup>260</sup> Based on 3 ton initial cost estimate for a conventional unit from ENERGY STAR Central AC calculator, \$2,857. Efficiency cost increment consistent with Cadmus study results.

<sup>261</sup> Based on 3 ton initial cost estimate for a conventional unit from ENERGY STAR Central AC calculator, \$2,857, and applying

Quality Installation: The additional design and installation work associated with quality installation has been estimated to cost an additional \$150.<sup>262</sup>

**LOADSHAPE**

Loadshape R08 - Residential Cooling

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM’s capacity market.

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
 = 68%<sup>263</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>264</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Time of sale:

$$\Delta \text{kWh} = (\text{FLHcool} * \text{Capacity} * (1/(\text{SEERbase} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{SEERee} * \text{SEERadj} * (1 - \text{DeratingCool}_{\text{Eff}}))))/1000$$

Early replacement:<sup>265</sup>

ΔkWh for remaining life of existing unit (1st 6 years):

$$=(\text{FLHcool} * \text{Capacity} * (1/(\text{SEERexist} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{SEERee} * \text{SEERadj} * (1 - \text{DeratingCool}_{\text{Eff}}))))/1000$$

ΔkWh for remaining measure life (next 12 years):

$$= (\text{FLHcool} * \text{Capacity} * (1/(\text{SEERbase} * (1 - \text{DeratingCool}_{\text{Base}})) - 1/(\text{SEERee} * \text{SEERadj} * (1 - \text{DeratingCool}_{\text{Eff}}))))/1000$$

Where:

FLHcool = Full load cooling hours

---

inflation rate of 1.91%. While baselines are likely to shift in the future, there is currently no good indication of what the cost of a new baseline unit will be in 6 years. In the absence of this information, assuming a constant federal baseline cost is within the range of error for this prescriptive measure.

<sup>262</sup> Based on data provided by MidAmerican in April 2018 summarizing survey results from 11 HVAC suppliers in Iowa.

<sup>263</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>264</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>265</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

= dependent on location and building type.<sup>266</sup>

Climate Zone (City based upon)	FLHcool (single family)	FLHcool (multifamily)	FLH_cooling (weatherized multifamily) <sup>267</sup>
1 (Rockford)	512	467	299
2 (Chicago)	570	506	324
3 (Springfield)	730	663	425
4 (Belleville)	1035	940	603
5 (Marion)	903	820	526
Weighted Average <sup>268</sup>	629	564	362

Use Multifamily if the Building has shared HVAC or meets the utility’s definition for multifamily

- Capacity = Size of new equipment in Btu/hr (note 1 ton = 12,000Btu/hr)  
 = Use actual when program delivery allows size of AC unit to be known. If unknown, assume 33,600 Btu/hr for single family homes, 28,000 Btu/hr for multifamily, or 24,000 Btu/hr for mobile homes.<sup>269</sup> If building type is unknown, assume 31,864Btu/hr.<sup>270</sup>
- SEERbase = Seasonal Energy Efficiency Ratio of baseline unit (kBtu/kWh)  
 = 13<sup>271</sup>
- SEERexist = Seasonal Energy Efficiency Ratio of existing unit (kBtu/kWh)  
 = Use actual SEER rating where it is possible to measure or reasonably estimate. If using rated efficiencies, derate efficiency value by 1% per year to account for degradation over time,<sup>272</sup> or, if unknown, assume 9.3.<sup>273</sup>
- SEERee = Rated Seasonal Energy Efficiency Ratio of ENERGY STAR unit (kBtu/kWh)  
 = Actual, or 15 if unknown.

<sup>266</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCDC) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>267</sup> *All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems*, Cadmus, October 2015. The multifamily units within this study had undergone significant shell improvements (air sealing and insulation) and therefore this set of assumptions is only appropriate for units that have recently participated in a weatherization or other shell program. Note that the FLHcool where recalculated based on existing efficiencies consistent with the TRM rather than from the metering study.

<sup>268</sup> Weighted based on number of residential occupied housing units in each zone.

<sup>269</sup> Single family cooling capacity based on Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), October 19, 2010, ComEd, Navigant Consulting. Multifamily capacity based on weighted average of PY9 Ameren and ComEd MF cooling capacities. Mobile home capacity based on ENERGY STAR’s Manufactured Home Cooling Equipment Sizing Guidelines which vary by climate zone and home size. The average size of a mobile home in the East North Central region (1,120 square feet) from the 2015 RECS data is used to calculate appropriate size.

<sup>270</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>271</sup> Based on Minimum Federal Standard.

<sup>272</sup> Justification for degradation factors can be found on page 21 of ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>273</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

- SEERadj = Adjustment percentage to account for in-situ performance of the unit<sup>274</sup>  
 =  $[(0.805 \times (\frac{EER_{ee}}{SEER_{ee}})) + 0.367]$
- DeratingCool<sub>Eff</sub> = Efficient Central Air Conditioner Cooling derating  
 = 0% if Quality Installation is performed  
 = 10% if Quality Installation is not performed or unknown<sup>275</sup>
- DeratingCool<sub>Base</sub> = Baseline Central Air Conditioner Cooling derating  
 = 10%

**Time of sale example:** a 3 ton unit with SEER rating of 17, EER rating of 12.5 in unknown location without Quality Install:

SEERadj =  $(0.805 * (12.5/17) + 0.367)$   
 = 0.959

$\Delta$ kWh =  $(629 * 36,000 * (1/(13 * (1-0.1)) - 1 / (17 * 0.959 * (1-0.1)))) / 1000$   
 = 392 kWh

**Time of sale example:** a 3 ton unit with SEER rating of 17, EER rating of 12.5 in unknown location with Quality Install:

$\Delta$ kWh =  $(629 * 36,000 * (1/(13 * (1-0.1)) - 1 / (17 * 0.959 * (1-0)))) / 1000$   
 = 546 kWh

**Early replacement example:** a 3 ton unit, with SEER rating of 17, EER rating of 12.5 replaces an existing unit in unknown location with quality installation:

$\Delta$ kWh(for first 6 years) =  $(629 * 36,000 * (1/(9.3 * (1-0.1)) - 1/(17* 0.959 * (1-0))))/1000$   
 = 1,316 kWh

$\Delta$ kWh(for next 12 years) =  $(629 * 36,000 * (1/(13 * (1-0.1)) - 1/(17* 0.959 * (1-0))))/1000$   
 = 546 kWh

Therefore savings adjustment of 41% (546/1316) after 6 years.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Time of sale:

$\Delta$ kW =  $(Capacity * (1/(EER_{base} * (1 - DeratingCool_{Base})) - 1/(EER_{ee} * (1 - DeratingCool_{Eff}))))/1000 * CF$

Early replacement:<sup>276</sup>

<sup>274</sup> In situ performance based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

<sup>275</sup> Based on Cadmus assumption provided in preparation of the 2014 Interstate Power and Light TRM based upon proper refrigerant charge, evaporator airflow, and unit sizing, Appears conservative in comparison to ENERGY STAR statements ([see](#) ‘Sponsoring an ENERGY STAR Verified HVAC Installation (ESVI) Program’). Note pending ComEd evaluation will provide an update to these assumptions.

<sup>276</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

$\Delta kW$  for remaining life of existing unit (1st 6 years):

$$= (\text{Capacity} * (1/(\text{EER}_{\text{exist}} * (1 - \text{DeratingCool}_{\text{base}})) - 1/(\text{EER}_{\text{ee}} * (1 - \text{DeratingCool}_{\text{eff}})))) / 1000 * \text{CF}$$

$\Delta kW$  for remaining measure life (next 12 years):

$$= (\text{Capacity} * (1/(\text{EER}_{\text{base}} * (1 - \text{DeratingCool}_{\text{base}})) - 1/(\text{EER}_{\text{ee}} * (1 - \text{DeratingCool}_{\text{eff}})))) / 1000 * \text{CF}$$

Where:

EERbase	= EER Efficiency of baseline unit = 10.5 <sup>277</sup>
EERexist	= EER Efficiency of existing unit = Use actual EER rating where it is possible to measure or reasonably estimate. If using rated efficiencies, derate efficiency value by 1% per year to account for degradation over time. <sup>278</sup> If unknown, assume 7.5. <sup>279</sup>
EERee	= EER Efficiency of ENERGY STAR unit = Actual installed or 12 if unknown
CF <sub>SSP</sub>	= Summer System Peak Coincidence Factor for Central A/C (during system peak hour) = 68% <sup>280</sup>
CF <sub>PJM</sub>	= PJM Summer Peak Coincidence Factor for Central A/C (average during peak period) = 46.6% <sup>281</sup>

**Time of sale example:** a 3 ton unit with EER rating of 12 with Quality Install:

$$\begin{aligned} \Delta kW_{\text{SSP}} &= (36,000 * (1/(10.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.68 \\ &= 0.550 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{\text{PJM}} &= (36,000 * (1/(10.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.466 \\ &= 0.377 \text{ kW} \end{aligned}$$

**Early replacement example:** a 3 ton unit with EER rating of 12 replaces an existing unit with Quality Install:

$$\begin{aligned} \Delta kW_{\text{SSP}} \text{ (for first 6 years)} &= (36,000 * (1/(7.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.68 \\ &= 1.587 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{\text{SSP}} \text{ (for next 12 years)} &= (36,000 * (1/(10.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.68 \\ &= 0.550 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{\text{PJM}} \text{ (for first 6 years)} &= (36,000 * (1/(7.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.466 \\ &= 1.087 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{\text{PJM}} \text{ (for next 12 years)} &= (36,000 * (1/(10.5 * (1-0.1)) - 1/(12 * (1-0)))) / 1000 * 0.466 \\ &= 0.377 \text{ kW} \end{aligned}$$

<sup>277</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>278</sup> Justification for degradation factors can be found on page 21 of 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>279</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>280</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>281</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.



**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-CAC1-V09-210101**

**REVIEW DEADLINE: 1/1/2023**

## 5.3.4 Duct Insulation and Sealing

### DESCRIPTION

This measure describes evaluating the savings associated with performing duct sealing using mastic sealant or metal tape to the distribution system of homes with either central air conditioning or a ducted heating system.

Two methodologies for estimating the savings associate from sealing the ducts are provided. The first preferred method requires the use of a blower door and the second requires careful inspection of the duct work.

1. **Modified Blower Door Subtraction** – this technique is described in detail on the Energy Conservatory website. See ‘The Energy Conservatory\_Blower-Door-Subtraction-Method.pdf’.
2. **Evaluation of Distribution Efficiency** – this methodology requires the evaluation of three duct characteristics below, and use of the Building Performance Institutes ‘Distribution Efficiency Look-Up Table’; See ‘DistributionEfficiencyTable-BlueSheet.pdf’.
  - a. Percentage of duct work found within the conditioned space
  - b. Duct leakage evaluation
  - c. Duct insulation evaluation

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is sealed duct work throughout the unconditioned or semi-conditioned space in the home. A non-conditioned space is defined as a space outside of the thermal envelope of the building that is not intentionally heated for occupancy (crawl space, roof attic, etc.). A semi-conditioned space is defined as a space within the thermal envelop that is not intentionally heated for occupancy (unfinished basement).<sup>282</sup>

### DEFINITION OF BASELINE EQUIPMENT

The existing baseline condition is leaky duct work within the unconditioned or semi-conditioned space in the home.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of this measure is 20 years.<sup>283</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years.<sup>284</sup> See section below for detail.

### DEEMED MEASURE COST

The actual duct sealing measure cost should be used.

### LOADSHAPE

Loadshape R08 - Residential Cooling

Loadshape R09 - Residential Electric Space Heat

Loadshape R10 - Residential Electric Heating and Cooling (Shell Measures)

---

<sup>282</sup> Definition matches Regain factor discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012

<sup>283</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

<sup>284</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM’s capacity market.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)}$$

$$= 68\%^{285}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)}$$

$$= 46.6\%^{286}$$

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

**Methodology 1: Modified Blower Door Subtraction**

- a) Determine Duct Leakage rate before and after performing duct sealing:  
 $\text{Duct Leakage (CFM50}_{DL}) = (\text{CFM50}_{\text{Whole House}} - \text{CFM50}_{\text{Envelope Only}}) * \text{SCF}$

Where:

- CFM50<sub>Whole House</sub> = Standard Blower Door test result finding Cubic Feet per Minute at 50 Pascal pressure differential
- CFM50<sub>Envelope Only</sub> = Blower Door test result finding Cubic Feet per Minute at 50 Pascal pressure differential with all supply and return registers sealed.
- SCF = Subtraction Correction Factor to account for underestimation of duct leakage due to connections between the duct system and the home. Determined by measuring pressure in duct system with registers sealed and using look up table provided by Energy Conservatory.

- b) Calculate duct leakage reduction, convert to CFM25<sub>DL</sub> and factor in Supply and Return Loss Factors  
 $\text{Duct Leakage Reduction } (\Delta\text{CFM25}_{DL}) = (\text{Pre CFM50}_{DL} - \text{Post CFM50}_{DL}) * 0.64 * (\text{SLF} + \text{RLF})$

Where:

- 0.64 = Converts CFM50 to CFM25<sup>287</sup>
- SLF = Supply Loss Factor  
 = % leaks sealed located in Supply ducts \* 1<sup>288</sup>

<sup>285</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>286</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>287</sup> 25 Pascals is the standard assumption for typical pressures experienced in the duct system under normal operating conditions. To convert CFM50 to CFM25 you multiply by 0.64 (inverse of the “Can’t Reach Fifty” factor for CFM25; see Energy Conservatory Blower Door Manual).

<sup>288</sup> Assumes that for each percent of supply air loss there is one percent annual energy penalty. This assumes supply side leaks are direct losses to the outside and are not recaptured back to the house. This could be adjusted downward to reflect regain of usable energy to the house from duct leaks. For example, during the winter some of the energy lost from supply leaks in a

Default = 0.5<sup>289</sup>  
 RLF = Return Loss Factor  
 = % leaks sealed located in Return ducts \* 0.5<sup>290</sup>  
 Default = 0.25<sup>291</sup>

c) Calculate Electric Energy Savings:

$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{Fan}$   
 $\Delta kWh_{cooling} = ((\Delta CFM_{25DL} / ((CapacityCool / 12,000) * 400)) * FLHcool * CapacityCool * TRFCool * \%Cool) / 1000 / \eta_{Cool}$   
 $\Delta kWh_{Fan} = (\Delta Therms * F_e * 29.3)$

Where:

$\Delta CFM_{25DL}$  = Duct leakage reduction in CFM25  
 = calculated above  
 CapacityCool = Capacity of Air Cooling system (Btu/hr)  
 =Actual  
 12,000 = Converts Btu/H capacity to tons  
 400 = Converts capacity in tons to CFM (400CFM / ton)<sup>292</sup>  
 FLHcool = Full load cooling hours  
 = Dependent on location as below.<sup>293</sup>

Climate Zone (City based upon)	FLHcool Single Family	FLHcool Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>294</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

crawlspace will probably be regained back to the house (sometimes 1/2 or more may be regained). More information provided in “Appendix E Estimating HVAC System Loss From Duct Airtightness Measurements” from Energy Conservatory ‘Minneapolis Duct Blaster Operation Manual’.

<sup>289</sup> Assumes 50% of leaks are in supply ducts.

<sup>290</sup> Assumes that for each percent of return air loss there is a half percent annual energy penalty. Note that this assumes that return leaks contribute less to energy losses than do supply leaks. This value could be adjusted upward if there was reason to suspect that the return leaks contribute significantly more energy loss than “average” (e.g. pulling return air from a super heated attic), or can be adjusted downward to represent significantly less energy loss (e.g. pulling return air from a moderate temperature crawl space) . More information provided in “Appendix E Estimating HVAC System Loss From Duct Airtightness Measurements” from Energy Conservatory ‘Minneapolis Duct Blaster Operation Manual’.

<sup>291</sup> Assumes 50% of leaks are in return ducts.

<sup>292</sup> This conversion is an industry rule of thumb; e.g. see ‘Why 400 CFM per ton.pdf’.

<sup>293</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>294</sup> Weighted based on number of occupied residential housing units in each zone.

TRFcool = Thermal Regain Factor for cooling by space type  
 = 1.0 for Unconditioned Spaces  
 = 0.4 for Semi-Conditioned Spaces<sup>295</sup>

%Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>296</sup>	66%

1000 = Converts Btu to kBtu

$\eta$ Cool = Efficiency (SEER) of Air Conditioning equipment (kBtu/kWh)  
 = Actual. If unknown assume the following:<sup>297</sup>

Age of Equipment	SEER Estimate
Before 2006	10
After 2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

$\Delta$ Therms = Therm savings as calculated in Natural Gas Savings

$F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption  
 = 3.14%<sup>298</sup>

29.3 = kWh per therm

<sup>295</sup> Thermal regain (i.e. the potential for conditioned air escaping from ducts not being lost to the atmosphere) for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012.

<sup>296</sup> Percentage of homes in Illinois that have central cooling from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>297</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>298</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See "Programmable Thermostats Furnace Fan Analysis.xlsx" for reference.

**For example**, duct sealing in unconditioned space a single family house in Springfield with a 36,000 Btu/H, SEER 11 central air conditioning, an 80% AFUE, 105,000 Btu/H natural gas furnace and the following blower door test results:

Before:  $CFM50_{Whole\ House} = 4800\ CFM50$   
 $CFM50_{Envelope\ Only} = 4500\ CFM50$   
 House to duct pressure of 45 Pascals. = 1.29 SCF (Energy Conservatory look up table)

After:  $CFM50_{Whole\ House} = 4600\ CFM50$   
 $CFM50_{Envelope\ Only} = 4500\ CFM50$   
 House to duct pressure of 43 Pascals = 1.39 SCF (Energy Conservatory look up table)

Duct Leakage:

$$CFM50_{DL\ before} = (4800 - 4500) * 1.29 = 387\ CFM$$

$$CFM50_{DL\ after} = (4600 - 4500) * 1.39 = 139\ CFM$$

Duct Leakage reduction at CFM25:

$$\Delta CFM25_{DL} = (387 - 139) * 0.64 * (0.5 + 0.25) = 119\ CFM25$$

Energy Savings:

$$\Delta kWh_{cooling} = [((119 / ((36,000/12,000) * 400)) * 730 * 36,000 * 1) / 1000 / 11] + (212 * 0.0314 * 29.3) = 237 + 195 = 432\ kWh$$

Heating savings for homes with electric heat:

$$\Delta kWh_{heatingElectric} = ((\Delta CFM25_{DL} / ((OutputCapacityHeat / 12,000) * 400)) * FLH_{heat} * OutputCapacityHeat * TRF_{heat} * \%ElectricHeat) / \eta_{Heat} / 3412$$

Where:

OutputCapacityHeat = Heating output capacity (Btu/hr) of electric heat  
 =Actual

FLH<sub>heat</sub> = Full load heating hours  
 = Dependent on location as below:<sup>299</sup>

Climate Zone (City based upon)	FLH <sub>heat</sub>
1 (Rockford)	1,969
2 (Chicago)	1,840
3 (Springfield)	1,754
4 (Belleville)	1,266
5 (Marion)	1,288
Weighted Average <sup>300</sup>	1,821

<sup>299</sup> Heating EFLH based on ENERGY STAR EFLH for Rockford, Chicago, and Springfield and on NCDC/NOAA HDD for the other two cities. In all cases, the hours were adjusted based on average natural gas heating consumption in IL.

<sup>300</sup> Weighted based on number of occupied residential housing units in each zone.

TRFheat = Thermal Regain Factor for heating by space type  
 = 0.40 for Semi-Conditioned Spaces  
 = 1.0 for Unconditioned Spaces<sup>301</sup>

%ElectricHeat = Percent of homes that have electric space heating

Heating System	%ElectricHeat
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>302</sup>	13%

ηHeat = Efficiency in COP of Heating equipment  
 = Actual. If not available use:<sup>303</sup>

System Type	Age of Equipment	HSPF Estimate	COP Estimate
Heat Pump	Before 2006	6.8	2.00
	After 2006 - 2014	7.7	2.26
	2015 on	8.2	2.40
Resistance	N/A	N/A	1.00
Unknown (for use in program evaluation only) <sup>304</sup>	N/A	N/A	1.28

3412 = Converts Btu to kWh

**For example**, duct sealing in unconditioned space in a 36,000 Btu/H 2.5 COP heat pump heated single family house in Springfield with the blower door results described above:

$$\Delta kWh_{\text{heating}} = ((119 / ((36,000/12,000) * 400)) * 1,754 * 36,000 * 1 * 1) / 2.5 / 3412$$

$$= 734 \text{ kWh}$$

**Methodology 2: Evaluation of Distribution Efficiency**

Determine Distribution Efficiency by evaluating duct system before and after duct sealing using Building

<sup>301</sup> Thermal regain (i.e. the potential for conditioned air escaping from ducts not being lost to the atmosphere) for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012.

<sup>302</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>303</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>304</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

Performance Institute “Distribution Efficiency Look-Up Table”

$$\Delta kWh = (((DE_{after} - DE_{before}) / DE_{after}) * FLH_{cool} * Capacity_{cool} * TRF_{cool} * \%Cool) / 1000 / \eta_{cool} + (\Delta Therms * F_e * 29.3)$$

Where:

- DE<sub>after</sub> = Distribution Efficiency after duct sealing
- DE<sub>before</sub> = Distribution Efficiency before duct sealing
- FLH<sub>cool</sub> = Full load cooling hours  
= Dependent on location as below:<sup>305</sup>

Climate Zone (City based upon)	FLH <sub>cool</sub> Single Family	FLH <sub>cool</sub> Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>306</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

- Capacity<sub>cool</sub> = Capacity of Air Cooling system (Btu/hr)  
=Actual
- TRF<sub>cool</sub> = Thermal Regain Factor for cooling by space type  
= 1.0 for Unconditioned Spaces  
= 0.4 for Semi-Conditioned Spaces<sup>307</sup>
- %Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>308</sup>	66%

- 1000 = Converts Btu to kBtu
- η<sub>cool</sub> = Efficiency (SEER) of Air Conditioning equipment (kBtu/kWh)  
= Actual. If unknown assume:<sup>309</sup>

<sup>305</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>306</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>307</sup> Thermal regain for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012.

<sup>308</sup> Percentage of homes in Illinois that have central cooling from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>309</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.



Age of Equipment	SEER Estimate
Before 2006	10
After 2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

**For example**, duct sealing in unconditioned space in a single family house in Springfield, with 36,000 Btu/H SEER 11 central air conditioning, an 80% AFUE, 105,000 Btu/H natural gas furnace and the following duct evaluation results:

$$DE_{\text{before}} = 0.85$$

$$DE_{\text{after}} = 0.92$$

Energy Savings:

$$\begin{aligned} \Delta kWh_{\text{cooling}} &= (((0.92 - 0.85)/0.92) * 730 * 36,000 * 1 * 1) / 1000 / 11 + (212 * 0.0314 * 29.3) \\ &= 182 + 195 \\ &= 377 \text{ kWh} \end{aligned}$$

Heating savings for homes with electric heat:

$$\Delta kWh_{\text{heatingElectric}} = ((DE_{\text{after}} - DE_{\text{before}}) / DE_{\text{after}}) * FLH_{\text{heat}} * OutputCapacityHeat * TRF_{\text{heat}} * \%ElectricHeat / \eta_{\text{Heat}} / 3412$$

Where:

OutputCapacityHeat = Heating output capacity (Btu/hr) of the electric heat  
= Actual

FLH<sub>heat</sub> = Full load heating hours  
= Dependent on location as below:<sup>310</sup>

Climate Zone (City based upon)	FLH <sub>heat</sub>
1 (Rockford)	1,969
2 (Chicago)	1,840
3 (Springfield)	1,754
4 (Belleville)	1,266
5 (Marion)	1,288
Weighted Average <sup>311</sup>	1,821

TRF<sub>heat</sub> = Thermal Regain Factor for heating by space type  
= 0.40 for Semi-Conditioned Spaces

<sup>310</sup> Heating EFLH based on ENERGY Star EFLH for Rockford, Chicago, and Springfield and on NCDC/NOAA HDD for the other two cities. In all cases, the hours were adjusted based on average natural gas heating consumption in IL.

<sup>311</sup> Weighted based on number of occupied residential housing units in each zone.

= 1.0 for Unconditioned Spaces<sup>312</sup>

%ElectricHeat = Percent of homes that have electric space heating

Heating System	%ElectricHeat
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>313</sup>	13%

COP = Coefficient of Performance of electric heating system<sup>314</sup>

= Actual. If not available use:<sup>315</sup>

System Type	Age of Equipment	HSPF Estimate	COP Estimate
Heat Pump	Before 2006	6.8	2.00
	After 2006 - 2014	7.7	2.26
	2015 on	8.2	2.40
Resistance	N/A	N/A	1.00
Unknown (for use in program evaluation only) <sup>316</sup>	N/A	N/A	1.28

**For example**, duct sealing in unconditioned space in a 36,000 Btu/H, 2.5 COP heat pump heated single family house in Springfield with the following duct evaluation results:

$$DE_{\text{after}} = 0.92$$

$$DE_{\text{before}} = 0.85$$

Energy Savings:

$$\begin{aligned} \Delta kWh_{\text{heating}} &= ((0.92 - 0.85)/0.92) * 1,754 * 36,000 * 1 * 1) / 2.5) / 3412 \\ &= 563 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh_{\text{cooling}} / FLH_{\text{cool}} * CF$$

Where:

<sup>312</sup> Thermal regain for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012.

<sup>313</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>314</sup> Note that the HSPF of a heat pump is equal to the COP \* 3.413.

<sup>315</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>316</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

FLHcool = Full load cooling hours:  
 = Dependent on location as below:<sup>317</sup>

Climate Zone (City based upon)	FLHcool Single Family	FLHcool Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>318</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility's definition for multifamily

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
 = 68%<sup>319</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
 = 46.6%<sup>320</sup>

**NATURAL GAS SAVINGS**

For homes with Natural Gas Heating:

**Methodology 1: Modified Blower Door Subtraction**

$$\Delta\text{Therm} = (((\Delta\text{CFM}_{25\text{DL}} / (\text{InputCapacityHeat} * 0.0123)) * \text{FLHheat} * \text{InputCapacityHeat} * \text{TRFheat} * \% \text{GasHeat} * (\eta_{\text{Equipment}} / \eta_{\text{System}})) / 100,000$$

Where:

$\Delta\text{CFM}_{25\text{DL}}$  = Duct leakage reduction in CFM25

InputCapacityHeat = Heating input capacity (Btu/hr)  
 =Actual

0.0123 = Conversion of Capacity to CFM (0.0123CFM / Btu/hr)<sup>321</sup>

FLHheat = Full load heating hours  
 =Dependent on location as below:<sup>322</sup>

<sup>317</sup> Based on Full Load Hours from ENERGY Star with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>318</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>319</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>320</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>321</sup> Based on Natural Draft Furnaces requiring 100 CFM per 10,000 Btu, Induced Draft Furnaces requiring 130CFM per 10,000Btu and Condensing Furnaces requiring 150 CFM per 10,000 Btu (rule of thumb from ['Practical Standards to Measure HVAC System Performance'](#)). Data provided by GAMA during the federal rule-making process for furnace efficiency standards, suggested that in 2000, 24% of furnaces purchased in Illinois were condensing units. Therefore a weighted average required airflow rate is calculated assuming a 50:50 split of natural v induced draft non-condensing furnaces, as 123 per 10,000Btu or 0.0123/Btu.

<sup>322</sup> Heating EFLH based on ENERGY Star EFLH for Rockford, Chicago, and Springfield and on NCDC/NOAA HDD for the other two cities. In all cases, the hours were adjusted based on average natural gas heating consumption in IL.

Climate Zone (City based upon)	FLH_heat
1 (Rockford)	1,969
2 (Chicago)	1,840
3 (Springfield)	1,754
4 (Belleville)	1,266
5 (Marion)	1,288
Weighted Average <sup>323</sup>	1,821

TRFheat = Thermal Regain Factor for heating by space type  
 = 0.40 for Semi-Conditioned Spaces  
 = 1.0 for Unconditioned Spaces<sup>324</sup>

%GasHeat = Percent of homes that have gas space heating

Heating System	%GasHeat
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>325</sup>	87%

100,000 = Converts Btu to therms

ηEquipment = Heating Equipment Efficiency  
 = Actual.<sup>326</sup> If not available, use 83%.<sup>327</sup>

ηSystem = Pre duct sealing Heating System Efficiency (Equipment Efficiency \* Pre Distribution Efficiency)<sup>328</sup>  
 = Actual. If not available, use 70%<sup>329</sup>

<sup>323</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>324</sup> Thermal regain for residential pipe insulation measures is discussed in Home Energy Services Impact Evaluation, prepared for the Massachusetts Residential Retrofit and Low Income Program Area Evaluation, Cadmus Group, Inc., August 2012.

<sup>325</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>326</sup> The Equipment Efficiency can be obtained either by recording the AFUE of the unit, or performing a steady state efficiency test.

If there are more than one heating systems, the weighted (by consumption) average efficiency should be used.

If the heating system or distribution is being upgraded within a package of measures together with the insulation upgrade, the new average heating system efficiency should be used.

<sup>327</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey). In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:  
 $(0.24 * 0.92) + (0.76 * 0.8) = 0.829$

<sup>328</sup> The Distribution Efficiency can be estimated via a visual inspection and by referring to a look up table such as that provided by the Building Performance Institute: (see ‘DistributionEfficiencyTable-Blue Sheet’) or by performing duct blaster testing.

<sup>329</sup> Estimated as follows:  $0.829 * (1 - 0.15) = 0.70$

**For example**, duct sealing in unconditioned space in a house in Springfield with an 80% AFUE, 105,000 Btu/H (input capacity) natural gas furnace and the following blower door test results:

Before:  $CFM50_{Whole\ House} = 4800\ CFM50$   
 $CFM50_{Envelope\ Only} = 4500\ CFM50$   
 House to duct pressure of 45 Pascals = 1.29 SCF (Energy Conservatory look up table)

After:  $CFM50_{Whole\ House} = 4600\ CFM50$   
 $CFM50_{Envelope\ Only} = 4500\ CFM50$   
 House to duct pressure of 43 Pascals = 1.39 SCF (Energy Conservatory look up table)

Duct Leakage:

$$CFM50_{DL\ before} = (4800 - 4500) * 1.29$$

$$= 387\ CFM$$

$$CFM50_{DL\ after} = (4600 - 4500) * 1.39$$

$$= 119\ CFM$$

Duct Leakage reduction at CFM25:

$$\Delta CFM25_{DL} = (387 - 119) * 0.64 * (0.5 + 0.25)$$

$$= 119\ CFM25$$

Energy Savings:

$$Pre\ Distribution\ Efficiency = 1 - (387/4800) = 92\%$$

$$\eta_{System} = 80\% * 92\% = 74\%$$

$$\Delta Therm = ((119 / (105,000 * 0.0123)) * 1,754 * 105,000 * 1 * (0.8/0.74)) / 100,000$$

$$= 183\ therms$$

**Methodology 2: Evaluation of Distribution Efficiency**

$$\Delta Therm = ((DE_{after} - DE_{before}) / DE_{after}) * FLHeat * InputCapacityHeat * TRFheat * \%GasHeat * (\eta_{Equipment} / \eta_{System}) / 100,000$$

Where:

- $DE_{after}$  = Distribution Efficiency after duct sealing
- $DE_{before}$  = Distribution Efficiency before duct sealing
- $\%GasHeat$  = Percent of homes that have gas space heating

Heating System	$\%GasHeat$
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>330</sup>	87%

Other variables as defined above

<sup>330</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey.

**For example**, duct sealing in unconditioned space in a house in Springfield an 80% AFUE, 105,000 Btu/H (input capacity) natural gas furnace and the following duct evaluation results:

$$\begin{aligned}
 DE_{\text{after}} &= 0.92 \\
 DE_{\text{before}} &= 0.85 \\
 \text{Energy Savings:} \\
 \eta_{\text{System}} &= 80\% * 85\% = 68\% \\
 \Delta\text{Therm} &= (((0.92 - 0.85)/0.92) * 1,754 * 105,000 * 1 * 1 * (0.8/0.68)) / 100,067 \\
 &= 165 \text{ therm}
 \end{aligned}$$

**Mid-Life Adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied.

For electric HVAC, to calculate the adjustment, re-calculate the savings using the algorithms in the ‘Electric Energy Savings’ section using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Heat Pump (8.2HSPF/3.413)	2.40 COP

For gas fueled systems, because the algorithm uses input capacity (which already accounts for the equipment efficiency), the *change* in equipment efficiency needs to be accounted for. Therefore re-calculate the savings using the following algorithm:

$$\Delta\text{Therms} = ((DE_{\text{after}} - DE_{\text{before}}) / DE_{\text{after}}) * FLH_{\text{heat}} * \text{InputCapacityHeat} * TRF_{\text{heat}} * \%Gas_{\text{heat}} * (\eta_{\text{Equipment}} / (\eta_{\text{Equipment}_{\text{New}}} * DE_{\text{after}})) / 100,000$$

Where:

$$\eta_{\text{Equipment}_{\text{New}}} = 90\% \text{ AFUE}^{331}$$

The re-calculated reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimated to be 10 years.<sup>332</sup> Note: if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>331</sup> Estimate that the new baseline unit that could be purchased in the year the existing unit would have needed replacing is 90%.  
<sup>332</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-DINS-V09-210101**

**REVIEW DEADLINE: 1/1/2024**

### 5.3.5 Furnace Blower Motor

#### DESCRIPTION

This measure describes savings from a brushless permanent magnet (BPM) motor (known and referred in this measure as an electronically commutated motor (ECM)) compared to a lower efficiency motor. Time of Sale and New Construction replacement scenarios no longer apply to this measure, as federal standards make ECM blower fan motors a requirement for residential furnaces.<sup>333</sup> Savings however are available from retrofitting an ECM motor into an existing furnace, or replacing an operational inefficient furnace with a new furnace with an ECM prior to the end of its life.

This measure characterizes the electric savings associated with the fan and the interactive negative therm savings due to a reduction in waste heat of the fan when operating in heating mode.

Savings decrease sharply with static pressure so duct improvements, and clean, low pressure drop filters can maximize savings. Savings occur when the blower is used for heating, cooling as well as when it is used for continuous ventilation, but only if the non-ECM motor would have been used for continuous ventilation too. If the resident runs the ECM blower continuously because it is a more efficient motor and would not run a non-ECM motor that way, savings are near zero and possibly negative. This characterization uses a 2016 Ameren Illinois study of ECM blower motors in Illinois, which accounted for the effects of this behavioral impact through surveyed results of impacted homeowners.

Retrofitting an existing blower motor with a new ECM reduces the potential impact of the high efficiency motor over a new system designed for an ECM blower motor because existing systems were not designed to capitalize and take advantage of the ECM's multi-staging features. Energy and demand savings are limited to the efficiency gains from the motor itself.

This measure was developed to be applicable to the following program types: RF, EREP

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

A brushless permanent magnet (ECM) blower motor, also known by the trademark ECM, BLDC, and other names.

#### DEFINITION OF BASELINE EQUIPMENT

A non-ECM blower motor.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 6 years, which is the remaining life of existing furnaces.<sup>334</sup>

#### DEEMED MEASURE COST

The capital cost for this measure as a retrofit should be actual if known; if unknown, assume \$322.<sup>335</sup> For the early

---

<sup>333</sup> As part of the code of federal regulations, energy conservation standards for covered residential furnace fans become effective on July 3, 2019 (10 CFR 430.32(y)). The expectation is the baseline will essentially become an ECM motor.

<sup>334</sup> While ECM blower motors have an effective useful life of 15 year (consistent with assumed life of a BPM/ECM motor, Appendix 8-E of the DOE Technical support documents for federal residential appliance standards) as this is a retrofit measure on an existing furnace blower motor, the remaining useful life of that equipment is used. For more detail, please see 5.3.7 Gas High Efficiency Furnace

<sup>335</sup> An incremental material cost of \$97 was used and adapted from Tables 8.2.3 and 8.2.13 in the DOE Technical support documents for federal residential appliance standards. Furthermore, an incremental labor time of 2.5 hours at a per hour cost of \$90 was included, bringing the total incremental cost to \$322. For more detail on the source of the labor cost estimates, please see, "Evaluation of Retrofit Variable-Speed Furnace Fan Motors", NREL, January 2014 (page 27).



replacement of existing furnaces, the full replacement cost is defined in 5.3.7 Gas High Efficiency Furnace.

**LOADSHAPE**

- Loadshape R08 - Residential Cooling
- Loadshape R09 - Residential Electric Space Heat
- Loadshape R10 - Residential Electric Heating and Cooling

**COINCIDENCE FACTOR**

ECMs installed in high efficiency CACs and ASHPs do not generate peak demand cooling savings if demand savings are claimed for these systems. However, some savings are realized for fans operating in circulation mode, even during peak demand cooling periods. Circulation mode operation during peak cooling periods would only occur when a system is not operating in cooling mode, with the percent time in circulation mode calculated using the summer system peak and PJM peak coincidence factors. A metering study found 23% of fans operated continuously during the summer peak periods,<sup>336</sup> therefore, ECMs do generate some demand savings during peak periods (when the system is not cooling). ECMs installed with CACs or ASHPs not receiving a rebate improve the cooling efficiency and therefore generate additional peak demand savings (when the system is cooling). Demand savings vary with system size and can be calculated using factors listed in the demand savings calculation table in the next section which incorporate coincidence with peak in their calculation.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = Capacity\_cooling * kWhSavingsPerTon$$

Where:

- Capacity\_cooling = Capacity of cooling system in tons  
= Actual (1 ton = 12,000Btu/hr)
- kWhSavingsPerTon = Blower fan kWh savings per ton of cooling<sup>337</sup>

The per-ton energy savings values vary by system installation scenario and location as provided below. Assumptions are also provided for installation with no or unknown cooling system.

---

<sup>336</sup> See Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

<sup>337</sup> Tons of cooling was determined to be the most straightforward multiplier to apply to systems in which the BPM is installed. The basis of the values and for more information see Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

Region	Existing ASHP	Existing CAC	Furnace, No Cooling System*	Furnace, Cooling System unknown* <sup>338</sup>
Rockford	247	229	210	223
Chicago	245	230	208	222
Springfield	249	231	203	221
Belleville	247	235	196	222
Marion	242	231	196	219
Average	247	230	206	222
*Multiply kWh saved value by 2 tons for furnaces <70 kBTU, by 3 tons for furnaces 70 kBTU – 90 kBTU and by 4 tons for furnaces 90+ kBTU.				

**For example**, an BPM installed in an existing three ton, 16 SEER CAC in a home in Marion:  
 $\Delta kWh = 3 * 231$   
 $= 693 kWh$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Capacity\_cooling} * kW\text{SavingsPerTon}$$

Where:

$$kW\text{SavingsPerTon} = \text{Blower fan kW savings per ton of cooling}^{339}$$

The per-ton energy savings values vary by system installation scenario and location as provided below. Assumptions are also provided for installation with no or unknown cooling system.

Demand Savings Type	Existing ASHP	Existing CAC	Furnace, No Cooling System*	Furnace, Cooling System unknown* <sup>340</sup>
SSP	0.085	0.085	0.013	0.065
PJM	0.064	0.064	0.009	0.048
*Multiply kWh saved value by 2 tons for furnaces <70 kBTU, by 3 tons for furnaces 70 kBTU – 90 kBTU and by 4 tons for furnaces 90+ kBTU.				

<sup>338</sup> Unknown cooling system values are based on a weight of 66% existing CAC and 34% no cooling factors. Based on 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

<sup>339</sup> Tons of cooling was determined to be the most straightforward multiplier to apply to systems in which the BPM is installed. The basis of the values and for more information see Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>340</sup> Unknown cooling system values are based on a weight of 66% existing CAC and 34% no cooling factors. Based on 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

**For example**, a BPM installed in an existing three ton, 16 SEER CAC receiving a rebate in a home in Marion:

$$\begin{aligned} \Delta kW_{ssp} &= 3 * 0.0085 \\ &= 0.0255 \text{ kW} \\ \Delta kW_{pjm} &= 3 * 0.064 \\ &= 0.192 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

$$\Delta \text{therms}^{341} = - \text{HeatingkWhSavings} * 0.03412 / \text{AFUE}$$

Where:

$$\text{HeatingkWhSavings} = \text{Heating kWh savings per ton of cooling}^{342}$$

Use the location-specific values in the following table to determine heating savings based on the size of the cooling system. If cooling size is unknown, assume 2 tons for furnaces <70 kBTU, 3 tons for furnaces 70 kBTU – 90 kBTU, and 4 tons for furnaces 90+ kBTU. If heating size is unknown or if the system does not include cooling, assume a 3-ton system.

Region	Heating Savings (kWh per ton of cooling)
Rockford	61
Chicago	59
Springfield	50
Belleville	39
Marion	39
Average	56

0.03412 = Converts kWh to therms

AFUE = Efficiency of the Furnace

= Actual. If unknown, assume 64.4 AFUE% for the existing furnace.<sup>343</sup>

**For example**, an ECM installed in an existing three ton CAC and 95% AFUE furnace in a home in Marion:

$$\begin{aligned} \Delta \text{therms} &= (-39 \text{ kWh} * 3 \text{ tons} * 0.03412) / 0.95 \\ \Delta \text{therms} &= - 4.2 \text{ therms} \end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>341</sup> The blower fan is in the heating duct so all, or very nearly all, of its waste heat is delivered to the conditioned space. Negative value since this measure will increase the heating load due to reduced waste heat.

<sup>342</sup> Tons of cooling was determined to be the most straightforward multiplier to apply to systems in which the BPM is installed. The basis of the values and for more information see Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

<sup>343</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

**MEASURE CODE: RS-HVC-FBMT-V06-210101**

**REVIEW DEADLINE: 1/1/2024**

### 5.3.6 Gas High Efficiency Boiler

#### DESCRIPTION

High efficiency boilers achieve most gas savings through the utilization of a sealed combustion chamber and multiple heat exchangers that remove a significant portion of the waste heat from flue gasses. Because multiple heat exchangers are used to remove waste heat from the escaping flue gasses, some of the flue gasses condense and must be drained.

This measure characterizes:

- a) Time of Sale:
  - a. The installation of a new high efficiency, gas-fired hot water boiler in a residential location. This could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new system in a new home.

- b) Early Replacement:

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or
- The existing unit requires minor repairs (<\$709).<sup>344</sup>
- All other conditions will be considered Time of Sale.

The Baseline AFUE of the existing unit replaced:

- If the AFUE of the existing unit is known and  $\leq 75\%$ , the Baseline AFUE is the actual AFUE value of the unit replaced. If the AFUE is  $>75\%$ , the Baseline AFUE = 82%.
- If the AFUE of the existing unit is unknown, use assumptions in variable list below (AFUE<sub>Exist</sub>).
- If the operational status or repair cost of the existing unit is unknown, use time of sale assumptions.

A weighted average early replacement rate is provided for use when the actual baseline early replacement rates are unknown.<sup>345</sup>

#### Deemed Early Replacement Rates for Boilers

	Deemed Early Replacement Rate
Early Replacement Rate for Boiler participants	7%

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed Boiler must be ENERGY STAR qualified (AFUE rated at or greater than 90%

<sup>344</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement. Note the non-inflated cost is used as this would be a cost consideration in the program year.

<sup>345</sup> Based upon research from “Home Energy Efficiency Rebate Program GPY2 Evaluation Report” which outlines early replacement rates for both primary and secondary central air cooling (CAC) and residential furnaces. This is used as a reasonable proxy for boiler installations since boiler specific data is not available. Report presented to Nicor Gas Company February 27, 2014.

and input capacity less than 300,000 Btu/hr).<sup>346</sup>

**DEFINITION OF BASELINE EQUIPMENT**

Time of sale: The baseline equipment for this measure is a new, gas-fired, standard-efficiency water boiler. The baseline AFUE is assumed to be 82% and is based on minimum federal appliance standards for boilers manufactured on or after September 1, 2012 and before January 15, 2021.<sup>347</sup>

Note: New federal appliance standards, raising the minimum AFUE from 82% to 84%, go into effect for boilers manufactured on or after January 15, 2021, but this baseline efficiency standards won't be adopted until 2022.

Early replacement: The baseline for this measure is the efficiency of the existing equipment for the assumed remaining useful life of the unit and the new baseline as defined above for the remainder of the measure life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 25 years.<sup>348</sup>

Early replacement: Remaining life of existing equipment is assumed to be 8 years.<sup>349</sup>

**DEEMED MEASURE COST**

Time of sale: The incremental install cost for this measure is dependent on tier:<sup>350</sup>

Measure Type	Year 2021		Year 2022	
	Installation Cost	Incremental Install Cost	Installation Cost	Incremental Install Cost
Baseline	\$3543	n/a	\$4,053	n/a
AFUE 90% (ENERGY STAR Minimum)	\$4268	\$725	\$5,519	\$1,466
AFUE 95%	\$5328	\$1,785	\$6,188	\$2,135

Early Replacement: The full installation cost is provided in the table above. The assumed deferred cost (after 8 years) of replacing existing equipment with a new baseline unit is assumed to be \$4,045 in 2021<sup>351</sup> and \$4,627 in 2022 and beyond.<sup>352</sup> This cost should be discounted to present value using the nominal discount rate.

**LOADSHAPE**

N/A

<sup>346</sup> ENERGY STAR Program Requirements, Product Specifications for Boilers, version 3.0, effective October 1, 2014 (≥ 90% AFUE for gas-fired and ≥ 87% AFUE for oil-fired)

<sup>347</sup> Code of Federal Regulations, effective September 1, 2012 (10 CFR 432(e)(2)). The federal baseline for boilers changes from 82% to 84% on January 15, 2021 (Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3))). To prevent a change in baseline mid-program, and to account for inventory meeting the old standard still in distribution, the increase in efficiency is delayed until January 2022 when a new program year starts.

<sup>348</sup> Appendix 8-F of the Department of Energy Commercial Technical Support Document, Table 8.3.3, federal residential appliance standards.

<sup>349</sup> Assumed to be one third of effective useful life

<sup>350</sup> Based on data provided in Federal Appliance Standards, Chapter 8.3, of DOE Technical Support Documents; Table 8.5.6 LCC and PBP Results for Hot-Water Gas Boilers (High Cost). Where efficiency ratings were not provided (AFUE 90% and 95%), the values are interpolated from those given.

<sup>351</sup> \$3,543 inflated using 1.91% rate.

<sup>352</sup> \$4,053 inflated using 1.91% rate.

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

Time of Sale:

$$\Delta\text{Therms} = (\text{EFLH} * \text{CAP}_{\text{Input}} * (\text{AFUE}_{\text{Eff}} / \text{AFUE}_{\text{Base}} - 1)) / 100,000$$

Early replacement:<sup>353</sup>

$\Delta\text{Therms}$  for remaining life of existing unit (1st 8 years):

$$= (\text{EFLH} * \text{CAP}_{\text{Input}} * (\text{AFUE}_{\text{Eff}} / \text{AFUE}_{\text{Exist}} - 1)) / 100,000$$

$\Delta\text{Therms}$  for remaining measure life (next 17 years):

$$= (\text{EFLH} * \text{CAP}_{\text{Input}} * (\text{AFUE}_{\text{Eff}} / \text{AFUE}_{\text{Base}} - 1)) / 100,000$$

Where:

$\text{CAP}_{\text{Input}}$  = Gas Boiler input capacity (Btuh)

= Actual

EFLH = Equivalent Full Load Hours for gas heating

Climate Zone (City based upon)	EFLH <sup>354</sup>
1 (Rockford)	1022
2 (Chicago)	976
3 (Springfield)	836
4 (Belleville)	645
5 (Marion)	656
Weighted Average <sup>355</sup>	928

<sup>353</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

<sup>354</sup> Full load hours for Chicago, are based on findings in ‘Energy Efficiency / Demand Response Nicor Gas Plan Year 1 (6/1/2011-5/31/2012) Research Report: Furnace Metering Study (August 1, 2013), prepared by Navigant Consulting, Inc. Values for other cities are then calculated by comparing relative HDD at base 60F.

<sup>355</sup> Weighted based on number of occupied residential housing units in each zone.

AFUE<sub>Exist</sub> = Existing Boiler Annual Fuel Utilization Efficiency Rating  
 = Use actual AFUE rating where it is possible to measure or reasonably estimate.  
 If unknown, assume 61.6 AFUE%.<sup>356</sup>

AFUE<sub>Base</sub> = Baseline Boiler Annual Fuel Utilization Efficiency Rating  
 = 82% if implemented prior to 2022  
 = 84% if implemented in 2022 and beyond

AFUE<sub>Eff</sub> = Efficient Boiler Annual Fuel Utilization Efficiency Rating  
 = Actual. If unknown, use defaults dependent on tier as listed below:<sup>357</sup>

Measure Type	AFUE(eff)
ENERGY STAR®	90%
AFUE 90%	92.5%
AFUE 95%	95%

**Time of Sale:**  
**For example**, a 100,000 Btu/h, 90% AFUE ENERGY STAR boiler purchased and installed near Springfield in 2022:  

$$\Delta\text{Therms} = (836 * 100,000 * (0.90/0.84 - 1)) / 100,000$$

$$= 59.7 \text{ Therms}$$

**Early Replacement:**  
**For example**, an existing function boiler with unknown efficiency is replaced with a 100,000 Btu/h, 90% AFUE ENERGY STAR boiler purchased and installed in Springfield in 2022:  

$$\Delta\text{Therms for remaining life of existing unit (1st 8 years):}$$

$$= (836 * 100,000 * (0.90/0.616 - 1)) / 100,000$$

$$= 385.4 \text{ Therms}$$

$$\Delta\text{Therms for remaining measure life (next 17 years):}$$

$$= (836 * 100,000 * (0.90/0.84 - 1)) / 100,000$$

$$= 59.7 \text{ Therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-GHEB-V08-210101**

**REVIEW DEADLINE: 1/1/2023**

<sup>356</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

<sup>357</sup> Default values per tier selected based upon the average AFUE value for the tier range except for the top tier where the minimum is used due to proximity to the maximum possible.



### 5.3.7 Gas High Efficiency Furnace

#### DESCRIPTION

High efficiency furnace features may include improved heat exchangers and modulating multi-stage burners.

This measure characterizes:

- a) Time of sale:
  - a. The installation of a new high efficiency, gas-fired condensing furnace in a residential location. This could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new system in a new home.
- b) Early Replacement:

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or
- The existing unit requires minor repairs (<\$528).<sup>358</sup>
- All other conditions will be considered Time of Sale.

The Baseline AFUE of the existing unit replaced:

- If the AFUE of the existing unit is known and <=75%, the Baseline AFUE is the actual AFUE value of the unit replaced. If the AFUE is >75%, the Baseline AFUE = 80%.
- If the AFUE of the existing unit is unknown, use assumptions in variable list below (AFUE(exist)).
- If the operational status or repair cost of the existing unit is unknown, use time of sale assumptions.

A weighted average early replacement rate is provided for use when the actual baseline early replacement rate is unknown.<sup>359</sup>

#### Deemed Early Replacement Rates For Furnaces

Replacement Scenario for the Furnace	Deemed Early Replacement Rate
Early Replacement Rate for Furnace-only participants	7%
Early Replacement Rate for a furnace when the furnace is the Primary unit in a Combined System Replacement (CSR) project	14%
Early Replacement Rate for a furnace when the furnace is the Secondary unit in a CSR project	46%

#### Verified Quality Installation

This approach uses in-field measurement and interpretation of static pressures, identification and plotting of airflow, airflow measurement, temperature measurement and diagnostics, pressure measurements and duct design, and BTU measurement to ensure that newly installed equipment is operating according to manufacturers’ published potential performance. Installed equipment operating efficiency is largely dependent on the efficiency rating of the

<sup>358</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement. Note the non-inflated cost is used as this would be a cost consideration in the program year.

<sup>359</sup> Based upon research from “Home Energy Efficiency Rebate Program GPY2 Evaluation Report” which outlines early replacement rates for both primary and secondary central air cooling (CAC) and residential furnaces. The unit (furnace or CAC unit) that initially caused the customer to contact a trade ally is defined as the “primary unit”. The furnace or CAC unit that was also replaced but did not initially prompt the customer to contact a trade ally is defined as the “secondary unit”. This evaluation used different criteria for early replacement due to the availability of data after the fact; cost of any repairs < \$550 and age of unit < 20 years. Report presented to Nicor Gas Company February 27, 2014.

equipment, the skill of the installation contractor, the degree to which the equipment has aged or drifted from initial settings, and the system level constraints. When one or more of these key dependencies are operating sub-optimally, the overall efficiency of the equipment is degraded. A Verified Quality Install identifies sub-optimal performance and prescribes a solution during furnace installation.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

To qualify for this measure the installed equipment must be a residential sized (input energy less than 225,000 Btu/hr) natural gas fired furnace with an Annual Fuel Utilization Efficiency (AFUE) rating exceeding the program requirements.

**DEFINITION OF BASELINE EQUIPMENT**

Time of Sale: The current Federal Standard for gas furnaces is an AFUE rating of 80%. The baseline will be adjusted when the Federal Standard is updated.

Early replacement: The baseline for this measure is the efficiency of the existing equipment for the assumed remaining useful life of the unit and a new baseline unit for the remainder of the measure life. We estimate that the new baseline unit that could be purchased in the year the existing unit would have needed replacing is 90%.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 20 years.<sup>360</sup>

For early replacement: Remaining life of existing equipment is assumed to be 6 years.<sup>361</sup>

**DEEMED MEASURE COST**

Time of sale: The incremental installed cost (retail equipment cost plus installation cost) for this measure depends on efficiency as listed below.<sup>362</sup>

AFUE	Installed Cost	Incremental Installed Cost
80%	\$2011	n/a
90%	\$2641	\$630
91%	\$2727	\$716
92%	\$2813	\$802
93%	\$3025	\$1014
94%	\$3237	\$1226
95%	\$3449	\$1438
96%	\$3661	\$1650
97%	\$3873	\$1862

Early Replacement: The full installed cost is provided in the table above. The assumed deferred cost (after 6 years) of replacing existing equipment with a new 90% baseline unit is assumed to be \$2903.<sup>363</sup> This cost should be discounted to present value using the nominal discount rate.

<sup>360</sup> Table 8.3.3 The Technical support documents for federal residential appliance standards.

<sup>361</sup> Assumed to be one third of effective useful life

<sup>362</sup> Based on data from Table E.1.1 of Appendix E of the Appliance Standards Technical Support Documents including equipment cost and installation labor. Where efficiency ratings are not provided, the values are interpolated from those that are. Note that ECM furnace fan cost (refer to other measure in TRM) has been deducted from the 93%-96% AFUE values to avoid double counting.

<sup>363</sup> \$2641 inflated using 1.91% rate.

Verified Quality Installation: The additional design and installation work associated with verified quality installation has been estimated to take 1-2 hours (Tim Hanes, ESI). At \$40/hr, VQI adds \$60 to the installed cost.

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Electrical energy savings from the more fan-efficient (typically using brushless permanent magnet (BPM) blower motor) should also be claimed, please refer to “Furnace Blower Motor” characterization for details.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

If the blower motor is also used for cooling, coincident peak demand savings should also be claimed, please refer to “Furnace Blower Motor” characterization for savings details.

**NATURAL GAS SAVINGS**

Time of Sale:

$$\Delta Therms = \frac{EFLH * CAPInput}{(1 - Derating_{eff})} * \left( \frac{AFUE(eff) * (1 - Derating(eff))}{AFUE(base) * (1 - Derating(base))} - 1 \right) / 100,000$$

Early replacement:<sup>364</sup>

ΔTherms for remaining life of existing unit (1st 6 years):

$$= \frac{EFLH * CAPInput}{(1 - Derating_{eff})} * \left( \frac{AFUE(eff) * (1 - Derating(eff))}{AFUE(exist) * (1 - Derating(base))} - 1 \right) / 100,000$$

ΔTherms for remaining measure life (next 14 years):

$$= \frac{EFLH * CAPInput}{(1 - Derating_{eff})} * \left( \frac{AFUE(eff) * (1 - Derating(eff))}{AFUE(base) * (1 - Derating(base))} - 1 \right) / 100,000$$

Where:

- CAPInput = Gas Furnace input capacity (Btuh)
- = Actual. If unknown, use the table below:

---

<sup>364</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

Eligibility Tier	Input Capacity <sup>365</sup>
AFUE ≥ 95 (all furnaces, no tiers)	84,305
AFUE ≥ 95 and < 97 tier	84,000
AFUE ≥ 97 tier	87,796

EFLH = Equivalent Full Load Hours for gas heating

Climate Zone (City based upon)	EFLH <sup>366</sup>
1 (Rockford)	1022
2 (Chicago)	976
3 (Springfield)	836
4 (Belleville)	645
5 (Marion)	656
Weighted Average <sup>367</sup>	928

AFUE(exist) = Existing Furnace Annual Fuel Utilization Efficiency Rating  
 = Use actual AFUE rating where it is possible to measure or reasonably estimate.  
 If unknown, assume 64.4 AFUE%.<sup>368</sup>

AFUE(base) = Baseline Furnace Annual Fuel Utilization Efficiency Rating  
 = Dependent on program type as listed below.<sup>369</sup>

Program Year	AFUE(base)
Time of Sale	80%
Early Replacement <sup>370</sup>	90%

AFUE(eff) = Efficient Furnace Annual Fuel Utilization Efficiency Rating  
 = Actual. If unknown, use the table below:

Eligibility Tier	AFUE (eff) <sup>371</sup>
AFUE ≥ 95 (all furnaces, no tiers)	96.0
AFUE ≥ 95 and < 97 tier	95.9
AFUE ≥ 97 tier	97.5

<sup>365</sup> Average Input Capacity for Northern Illinois, based on analysis of Nicor Gas 2019 Home Energy Efficiency Rebate Program participant tracking data, prepared by Guidehouse, Inc., based on 12,549 furnaces rebated at the 95 AFUE Tier, and 1,103 furnaces rebated at the 97 AFUE Tier. Approximately 10% of tracked input capacities were adjusted by Guidehouse based on verification of manufacturer model numbers. Values for Southern Illinois not available.

<sup>366</sup> Full load hours for Chicago, are based on findings in 'Energy Efficiency / Demand Response Nicor Gas Plan Year 1 (6/1/2011-5/31/2012) Research Report: Furnace Metering Study (August 1, 2013), prepared by Navigant Consulting, Inc. Values for other cities are then calculated by comparing relative HDD at base 60F.

<sup>367</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>368</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

<sup>369</sup> Though the Federal Minimum AFUE is 78%, there were only 50 models listed in the AHRI database at that level. At AFUE 79% the total rises to 308. There are 3,548 active furnace models listed with AFUE ratings between 78 and 80.

<sup>370</sup> We estimate that the new baseline unit that could be purchased in the year the existing unit would have needed replacing is 90%.

<sup>371</sup> Average AFUE based on analysis of Nicor Gas 2019 Home Energy Efficiency Rebate Program participant tracking data, prepared by Guidehouse, Inc., based on 12,549 furnaces rebated at the 95 AFUE Tier, and 1,103 furnaces rebated at the 97 AFUE Tier.

- Derating(base) =Baseline furnace AFUE derating  
 = 6.4%<sup>372</sup>
- Derating(eff) =Efficient furnace AFUE derating  
 =0% if verified quality installation is performed  
 =6.4% if verified quality installation is not performed or unknown<sup>373</sup>

**Time of Sale:**

**For example**, a 95% AFUE, 80,000Btuh furnace purchased and installed with verified quality installation for an existing home near Rockford:

$$\Delta\text{Therms} = ((1022 * 80,000)/(1-0) * (((0.95 * (1-0)) / (0.8 * (1-0.064))) - 1)) / 100000$$

$$= 220 \text{ therms}$$

For example, a 95% AFUE, 80,000Btuh furnace purchased and installed without verified quality installation for an existing home near Rockford:

$$\Delta\text{Therms} = ((1022 * 80,000)/(1-0.064) * (((0.95 * (1-0.064)) / (0.8 * (1-0.064))) - 1)) / 100000$$

$$= 164 \text{ therms}$$

**Early Replacement:**

**For example**, an existing functioning furnace with unknown efficiency is replaced with an 95% AFUE, 80,000Btuh furnace using quality installation in Rockford:

$\Delta\text{Therms}$  for remaining life of existing unit (1st 6 years):

$$= ((1022 * 80,000)/(1-0) * (((0.95 * (1-0)) / (0.644 * (1-0.064))) - 1)) / 100000$$

$$= 471 \text{ therms}$$

$\Delta\text{Therms}$  for remaining measure life (next 14 years):

$$= ((1022 * 80,000)/(1-0) * (((0.95 * (1-0)) / (0.9 * (1-0.064))) - 1)) / 100000$$

$$= 104 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-GHEF-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>372</sup> Brand, L., Yee, S., and Baker, J. "Improving Gas Furnace Performance: A Field and Laboratory Study at End of Life." Building Technologies Office. National Renewable Energy Laboratory. 2015 accessed September 6<sup>th</sup>, 2016.

<sup>373</sup> Ibid

### 5.3.8 Ground Source Heat Pump

#### DESCRIPTION

This measure characterizes the installation of a Ground Source Heat Pump under the following scenarios:

- a) New Construction:
  - i. The installation of a new residential sized Ground Source Heat Pump system meeting ENERGY STAR efficiency standards presented below in a new home.
  - ii. Note the baseline in this case should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition.
- b) Time of Sale:
  - i. The planned installation of a new residential sized Ground Source Heat Pump system meeting ENERGY STAR efficiency standards presented below to replace an existing system(s) that does not meet the criteria for early replacement described in section c below.
  - ii. Note the baseline in this case is an equivalent replacement system to that which exists currently in the home. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, just an electric utility or just a gas utility.
  - iii. Additional DHW savings are calculated based upon the fuel and efficiency of the existing unit.
- c) Early Replacement/Retrofit:
  - i. The early removal of functioning either electric or gas space heating and/or cooling systems from service, prior to the natural end of life, and replacement with a new high efficiency Ground Source Heat Pump system.
  - ii. Note the baseline in this case is the existing equipment being replaced. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, just an electric utility or just a gas utility.
  - iii. Additional DHW savings are calculated based upon the fuel and efficiency of the existing unit.
  - iv. Early Replacement determination will be based on meeting the following conditions:
    - The existing unit is operational when replaced, or
    - The existing unit requires minor repairs, defined as costing less than:<sup>374</sup>

Existing System	Maximum repair cost
Air Source Heat Pump	\$276 per ton
Central Air Conditioner	\$190 per ton
Boiler	\$709
Furnace	\$528
Ground Source Heat Pump	<\$249 per ton

- All other conditions will be considered Time of Sale.
- v. The Baseline efficiency of the existing unit replaced:
  - If the efficiency of the existing unit is less than the maximum shown below, the Baseline efficiency is the actual efficiency value of the unit replaced. If the efficiency is greater than the maximum, the Baseline efficiency is shown in the “New Baseline” column below:

Existing System	Maximum efficiency for Actual	New Baseline
Air Source Heat Pump	10 SEER	14 SEER

<sup>374</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement.

Existing System	Maximum efficiency for Actual	New Baseline
Central Air Conditioner	10 SEER	13 SEER
Boiler	75% AFUE	82% AFUE
Furnace	75% AFUE	80% AFUE
Ground Source Heat Pump	10 SEER	14 SEER

- If the efficiency of the existing unit is unknown, use assumptions in variable list below (SEER, HSPF or AFUE exist).
- If the operational status or repair cost of the existing unit is unknown use time of sale assumptions.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

In order for this characterization to apply, the efficient equipment must be a Ground Source Heat Pump unit meeting the minimum ENERGY STAR efficiency level standards effective at the time of installation as detailed below:

ENERGY STAR Requirements (Effective January 1, 2012)

Product Type	Cooling EER	Heating COP
<b>Water-to-air</b>		
Closed Loop	17.1	3.6
Open Loop	21.1	4.1
<b>Water-to-Water</b>		
Closed Loop	16.1	3.1
Open Loop	20.1	3.5
DGX	16	3.6

**DEFINITION OF BASELINE EQUIPMENT**

For these products, baseline equipment includes Air Conditioning, Space Heating and Water Heating.

New Construction:

To calculate savings with an electric baseline, the baseline equipment is assumed to be an Air Source Heat Pump meeting the Federal Standard efficiency level; 14 SEER, 8.2 HSPF and 11.8 EER<sup>375</sup> and a Federal Standard electric hot water heater.

To calculate savings with a furnace/central AC baseline, the baseline equipment is assumed to be an 80% AFUE Furnace and central AC meeting the Federal Standard efficiency level; 13 SEER, 11 EER. If a gas water heater, the Federal Standard baseline is calculated as follows; 0.6483 – (0.0017 \* storage capacity in gallons) for tanks<=55 gallons and 0.7897 – (0.0004 × storage capacity in gallons) for greater than 55 gallon storage water heaters.<sup>376</sup> For a 40-gallon storage water heater this would be 0.58 EF.

Time of Sale: The baseline for this measure is a new replacement unit of the same system type as the existing unit,

<sup>375</sup> The Federal Standard does not include an EER requirement, so it is approximated with this formula: (-0.02 \* SEER2) + (1.12 \* SEER) Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder.

<sup>376</sup> Minimum Federal standard as of 4/16/2015.

meeting the baselines provided below.

Unit Type	Efficiency Standard
ASHP	14 SEER, 11.8 EER, 8.2 HSPF
Gas Furnace	80% AFUE
Gas Boiler	82% AFUE
Central AC	13 SEER, 11 EER

Early replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating, cooling and hot water equipment for the assumed remaining useful life of the existing unit and a new baseline heating and cooling system for the remainder of the measure life (as provided in table above except for Gas Furnace where new baseline assumption is 90% due to pending standard change).

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 25 years.<sup>377</sup>

For early replacement, the remaining life of existing equipment is assumed to be 6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers and GSHP<sup>378</sup> and 25 years for electric resistance.<sup>379</sup>

**DEEMED MEASURE COST**

New Construction and Time of Sale: The actual installed cost of the Ground Source Heat Pump (including any necessary electrical or distribution upgrades required) should be used (default of \$3957 per ton),<sup>380</sup> minus the assumed installation cost of the baseline equipment (\$1381 per ton for ASHP<sup>381</sup> or \$2011 for a new baseline 80% AFUE furnace, or \$3543 for a new 82% AFUE boiler,<sup>382</sup> and \$952 per ton for new baseline Central AC replacement<sup>383</sup>).

Early Replacement: The actual full installation cost of the Ground Source Heat Pump should be used (including any necessary electrical or distribution upgrades required). If the install cost is unknown a default is provided above, however because these assumptions do not include any additional costs that may be required for fuel switch scenarios, these defaults should not be used and actual costs should always be used for fuel switch measures.

The assumed deferred cost (after 8 years) of replacing existing equipment with a new baseline unit is assumed to be \$1,518 per ton for a new baseline Air Source Heat Pump, or \$2,903 for a new baseline 90% AFUE furnace, or \$4,045 for a new 82% AFUE boiler, and 1,047 per ton for new baseline Central AC replacement.<sup>384</sup> This future cost should be discounted to present value using the nominal societal discount rate.

**LOADSHAPE**

Loadshape R10 - Residential Electric Heating and Cooling (if replacing gas heat and central AC)<sup>385</sup>

<sup>377</sup> System life of indoor components as per DOE estimate (see ‘Geothermal Heat Pumps Department of Energy’). The ground loop has a much longer life, but the compressor and other mechanical components are the same as an ASHP.

<sup>378</sup> Assumed to be one third of effective useful life of replaced equipment.

<sup>379</sup> Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.

<sup>380</sup> Based on data provided in ‘Results of Home geothermal and air source heat pump rebate incentives documented by IL electric cooperatives’.

<sup>381</sup> Baseline cost per ton derived from DEER 2008 Database Technology and Measure Cost Data. See ‘ASHP\_Revised DEER Measure Cost Summary.xls’ for calculation.

<sup>382</sup> Furnace and boiler costs are based on data provided in Appendix E of the Appliance Standards Technical Support Documents including equipment cost and installation labor.

<sup>383</sup> Based on 3 ton initial cost estimate for a conventional unit from ENERGY STAR Central AC calculator.

<sup>384</sup> All baseline replacement costs are consistent with their respective measures and include inflation rate of 1.91%.

<sup>385</sup> The baseline for calculating electric savings is an Air Source Heat Pump.



Loadshape R09 - Residential Electric Space Heat (if replacing electric heat with no cooling)

Loadshape R10 - Residential Electric Heating and Cooling (if replacing ASHP)

Note for purpose of cost effectiveness screening a fuel switch scenario, the heating kWh increase and cooling kWh decrease should be calculated separately such that the appropriate loadshape (i.e., Loadshape R09 - Residential Electric Space Heat and Loadshape R08 – Residential Cooling respectively) can be applied.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM’s capacity market.

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Heat Pumps (during utility peak hour)}$$

$$= 72\%^{386}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Heat Pumps (average during PJM peak period)}$$

$$= 46.6\%^{387}$$

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS AND NATURAL GAS SAVINGS**

Non-fuel switch measures:

$$\Delta kWh = [\text{Cooling savings}] + [\text{Heating savings}] + [\text{DHW savings}]$$

$$= [\text{FLHcool} * \text{Capacity\_cooling} * (1/\text{SEER}_{base} - 1/\text{EER}_{PL})/1000] + [\text{FLHheat} * \text{Capacity\_heating} * (1/\text{HSPF}_{base} - 1/(\text{COP}_{PL} * 3.412))/1000] + [\text{ElecDHW} * \% \text{DHWD} \text{Displaced} * ((1/\text{EF}_{ELEC} * \text{GPD} * \text{Household} * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 3412)]$$

Fuel switch measures:

Fuel switch measures must produce positive total annual source fuel savings (i.e., reduction in source Btus) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

$$\text{SourceEnergySavings (MMBTUs)} = \text{GasHeatReplaced} - \text{GSHPSourceHeatConsumed} + \text{GSHPSourceCoolingImpact} + \text{GSHPSourceWaterImpact}$$

$$\text{GasHeatReplaced}^{388} = [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{base}) / 1,000,000]$$

$$\text{GSHPSourceHeatConsumed} = [\text{FLHheat} * \text{Capacity\_heating} * (1/(\text{COP}_{PL} * 3.412))/1000] * H_{grid} / 1,000,000$$

$$\text{GSHPSourceCoolingImpact} = [\text{FLHcool} * \text{Capacity\_cooling} * (1/\text{SEER}_{base} - 1/\text{EER}_{PL})/1000] * H_{grid} /$$

<sup>386</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>387</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>388</sup> Note the Gas Source to Site ratio is assumed to be 1.0.

1,000,000

$$GSHPSourceWaterImpact_{Gas} = (\%DHWD\text{Displaced} * ((1/EF_{Gas} * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 1,000,000$$

$$GSHPSourceWaterImpact_{Electric} = (\%DHWD\text{Displaced} * ((1/EF_{Elec} * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) * H_{grid} / 1,000,000$$

If SourceEnergySavings calculated above is positive, the measure is eligible.

Two electric algorithms and one gas algorithm are provided below. The appropriate claim is dependent on which utilities are supporting the measure as provided in a table below.

$$\Delta kWh_{FuelSwitch} = [\text{Heat consumption of baseline ASHP}]$$

$$= [(FLH_{heat} * Capacity_{heating} * 1/HSPF_{baseASHP})/1000]$$

$$\Delta kWh_{EfficiencyImprovement} = [\text{Cooling Savings}] + [\text{Heat Savings from Baseline ASHP to GSHP}] + [\text{DHW savings if displacing electric DHW}]$$

$$= [FLH_{cool} * Capacity_{cooling} * (1/SEER_{base} - 1/EER_{PL})/1000] + [FLH_{heat} * Capacity_{heating} * (1/HSPF_{baseASHP} - 1/(COP_{PL} * 3.412))]/1000] + [ElecDHW * \%DHWD\text{Displaced} * ((1/EF_{ELEC} * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 3412)]$$

$$\Delta Therm_{FuelSwitch} = [\text{Heat consumption of baseline gas system}] + [\text{DHW savings if displacing gas DHW}]$$

$$= [(FLH_{heat} * Capacity_{heating} * 1/AFUE_{base}) / 100,000] + [(1 - ElecDHW) * \%DHWD\text{Displaced} * (1/EF_{GAS\ EXIST} * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 100,000]$$

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$\Delta kWh_{EfficiencyImprovement} - \Delta kWh_{FuelSwitch} + (\Delta Therm_{FuelSwitch} / kWh\text{toTherm})$	N/A
Electric and gas utility	$\Delta kWh_{EfficiencyImprovement}$	$\Delta Therm_{FuelSwitch} - (\Delta kWh_{FuelSwitch} * kWh\text{toTherm})$
Gas utility only	N/A	$\Delta Therm_{FuelSwitch} - (\Delta kWh_{FuelSwitch} * kWh\text{toTherm}) + (\Delta kWh_{EfficiencyImprovement} * kWh\text{toTherm})$

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

FLHcool = Full load cooling hours  
 Dependent on location as below:<sup>389</sup>

<sup>389</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

Climate Zone (City based upon)	FLHcool Single Family	FLHcool Multifamily	FLH_cooling (weatherized multifamily) <sup>390</sup>
1 (Rockford)	512	467	299
2 (Chicago)	570	506	324
3 (Springfield)	730	663	425
4 (Belleville)	1,035	940	603
5 (Marion)	903	820	526
Weighted Average <sup>391</sup>	629	564	362

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

Capacity\_cooling = Cooling Capacity of Ground Source Heat Pump (Btu/hr)

= Actual (1 ton = 12,000Btu/hr)

SEERbase = SEER Efficiency of baseline unit. For early replacment measures, the actual SEER rating where it is possible to measure or reasonably estimate should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 8 years for GSHP). If unknown assume default provided below:

Baseline/Existing Cooling System	SEERbase		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	9.3 <sup>392</sup>	14 <sup>393</sup>	
Ground Source Heat Pump	14 <sup>394</sup>	14	
Central AC	9.3 <sup>395</sup>	13 <sup>396</sup>	
No central cooling	13 <sup>397</sup>	13 <sup>398</sup>	

EER<sub>PL</sub> = Part Load EER Efficiency of efficient GSHP unit<sup>399</sup>

= Actual installed

FLHheat = Full load heating hours

<sup>390</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015. The multifamily units within this study had undergone significant shell improvements (air sealing and insulation) and therefore this set of assumptions is only appropriate for units that have recently participated in a weatherization or other shell program. Note that the FLHcool where recalculated based on existing efficiencies consistent with the TRM rather than from the metering study.

<sup>391</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>392</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>393</sup> Minimum Federal Standard as of 1/1/2015

<sup>394</sup> Estimate of existing GSHP efficiency is based converting 12 EER (estimate based upon Navigant, 2018 “EIA – Technology Forecast Updates – Residential and Commercial Building Technologies – Reference Case”) to SEER.

<sup>395</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>396</sup> Minimum Federal Standard; Federal Register, Vol. 66, No. 14, Monday, January 22, 2001/Rules and Regulations, p. 7170-7200.

<sup>397</sup> Assumes that the decision to replace existing systems includes desire to add cooling.

<sup>398</sup> Assumes that the decision to replace existing systems includes desire to add cooling.

<sup>399</sup> As per conversations with David Buss territory manager for Connor Co, the SEER and COP ratings of an ASHP equate most appropriately with the part load EER and COP of a GSHP.

Dependent on location as below:<sup>400</sup>

Climate Zone (City based upon)	FLH <sub>heat</sub>
1 (Rockford)	1,969
2 (Chicago)	1,840
3 (Springfield)	1,754
4 (Belleville)	1,266
5 (Marion)	1,288
Weighted Average <sup>401</sup>	1,821

Capacity<sub>heating</sub> = Heating Capacity of Ground Source Heat Pump (Btu/hr)

= Actual (1 ton = 12,000Btu/hr)

HSPF<sub>base</sub> = Heating System Performance Factor of baseline heating system (kBtu/kWh). For early replacement measures, use actual HSPF rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment (6 years for ASHP, 8 years for GSHP or 15 years for electric resistance). If unknown assume default:

Baseline/ Existing Heating System	HSPF <sub>base</sub>		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	5.54 <sup>402</sup>		8.2
Ground Source Heat Pump	8.2 <sup>403</sup>		8.2
Electric Resistance		3.41 <sup>404</sup>	

COP<sub>PL</sub> = Part Load Coefficient of Performance of efficient unit<sup>405</sup>

= Actual Installed

3.412 = Constant to convert the COP of the unit to the Heating Season Performance Factor (HSPF)

ElecDHW = 1 if existing DHW is electrically heated

= 0 if existing DHW is not electrically heated

%DHWDisplaced = Percentage of total DHW load that the GSHP will provide

= Actual if known

<sup>400</sup> Heating EFLH based on ENERGY STAR EFLH for Rockford, Chicago, and Springfield and on NCDC/NOAA HDD for the other two cities. In all cases, the hours were adjusted based on average natural gas heating consumption in IL. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>401</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>402</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>403</sup> Estimate of existing GSHP efficiency is assumed equivalent to a new baseline ASHP. It is recommended that this value be evaluated and adjusted for a future version.

<sup>404</sup> Electric resistance has a COP of 1.0 which equals 1/0.293 = 3.41 HSPF.

<sup>405</sup> As per conversations with David Buss territory manager for Connor Co, the SEER and COP ratings of an ASHP equate most appropriately with the part load EER and COP of a GSHP.

- = If unknown and if desuperheater installed,, assume 44%<sup>406</sup>
- = 0% if no desuperheater installed
- EF<sub>ELEC</sub> = Energy Factor (efficiency) of electric water heater
- = Actual. If unknown or for new construction, assume federal standard:<sup>407</sup>
- For <=55 gallons: 0.96 – (0.0003 \* rated volume in gallons)
- For >55 gallons: 2.057 – (0.00113 \* rated volume in gallons)
- GPD = Gallons Per Day of hot water use per person
- = 45.5 gallons hot water per day per household/2.59 people per household<sup>408</sup>
- = 17.6
- Household = Average number of people per household

Household Unit Type	Household
Single-Family - Deemed	2.56 <sup>409</sup>
Multifamily - Deemed	2.1 <sup>410</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>411</sup>

Use Multifamily if: Building meets utility's definition for multifamily

- 365.25 = Days per year
- γ<sub>Water</sub> = Specific weight of water
- = 8.33 pounds per gallon
- T<sub>OUT</sub> = Tank temperature
- = 125°F
- T<sub>IN</sub> = Incoming water temperature from well or municipal system
- = 54°F <sup>412</sup>
- 1.0 = Heat Capacity of water (1 Btu/lb\*°F)
- 3412 = Conversion from Btu to kWh
- AFUE<sub>base</sub> = Baseline Annual Fuel Utilization Efficiency Rating. For early replacement measures, use actual AFUE rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment (7 years for furnace, 8 years for boilers). If unknown assume default:

<sup>406</sup> Assumes that the desuperheater can provide two thirds of hot water needs for eight months of the year (2/3 \* 2/3 = 44%). Based on input from Doug Dougherty, Geothermal Exchange Organization.

<sup>407</sup> Minimum Federal Standard as of 4/1/2015;.

<sup>408</sup> Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

<sup>409</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>410</sup> ComEd PY3 Multifamily Evaluation Report REVISED DRAFT v5 2011-12-08.docx

<sup>411</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>412</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

Baseline/ Existing Heating System	AFUEbase		
	Early Replacement (Remaining useful life of existing equipment) <sup>413</sup>	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Furnace	64.4%	90% <sup>414</sup>	80%
Boiler	61.6%	84% <sup>415</sup>	82%

EF<sub>GAS EXIST</sub> = Energy Factor (efficiency) of existing gas water heater

= Actual. If unknown, assume federal standard:<sup>416</sup>

For <=55 gallons: 0.6483 – (0.0017 \* storage capacity in gallons)

For > 55 gallons 0.7897 – (0.0004 \* storage capacity in gallons)

= If tank size unknown, assume 40 gallons and EF\_Baseline of 0.58

kWhtoTherm = Conversion between kWh at source/generation and Therms

= H<sub>grid</sub> / 100000

H<sub>grid</sub> = Heat rate of the grid in btu/kWh based on the average fossil heat rate for the EPA eGRID subregion and includes a factor that considers T&D losses.

For systems operating less than 6,500 hrs per year:

Use the Non-baseload heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest).<sup>417</sup> Also include any line losses.

For systems operating more than 6,500 hrs per year:

Use the All Fossil Average heat rate provided by EPA eGRID for RFC West region for ComEd territory, and SERC Midwest region for Ameren territory. Also include any line losses.

<sup>413</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

<sup>414</sup> Assumes that Federal Standard will have been increased to 90% by the time the existing unit would have to have been replaced.

<sup>415</sup> Federal standards for boilers manufactured on or after January 15, 2021.

<sup>416</sup> Minimum Federal Standard as of 4/1/2015.

<sup>417</sup> These values are subject to regular updates so should be reviewed regularly to ensure the current assumptions are correct. Refer to the latest EPA eGRID data. Current values, based on eGrid 2018 are:

- Non-Baseload RFC West: 10,024 Btu/kWh \* (1 + Line Losses)
- Non-Baseload SERC Midwest: 9,871 Btu/kWh \* (1 + Line Losses)
- All Fossil Average RFC West: 9,575 Btu/kWh \* (1 + Line Losses)
- All Fossil Average SERC Midwest: 10,369 Btu/kWh \* (1 + Line Losses)

**Non Fuel Switch Illustrative Examples**

**New Construction** using ASHP baseline:

For example, a 3 ton unit with Part Load EER rating of 19 and Part Load COP of 4.4 with desuperheater is installed with a 50 gallon electric water heater in single family house in Springfield:

$$\begin{aligned} \Delta kWh &= [FLH_{cool} * Capacity_{cooling} * (1/SEER_{base} - 1/EER_{PL})/1000] + [FLH_{heat} * Capacity_{heating} * (1/HSPF_{base} - 1/(COP_{PL} * 3.412))/1000] + [ElecDHW * \%DHWDisplaced * ((1/EF_{ELEC\ EXIST} * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 3412)] \\ \Delta kWh &= [730 * 36,000 * (1/14 - 1/19) / 1000] + [1754 * 36,000 * (1/8.2 - 1/(4.4 * 3.412)) / 1000] + [1 * 0.44 * ((1/0.945 * 17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1)/3412)] \\ &= 494 + 3494 + 1328 \\ &= 5316 kWh \end{aligned}$$

**Early Replacement**

For example, a 3 ton unit with Part Load EER rating of 19 and Part Load COP of 4.4 with desuperheater is installed in single family house in Springfield with a 50 gallon electric water heater replacing an existing working Air Source Heat Pump with unknown efficiency ratings:

$$\begin{aligned} \Delta kWh \text{ for remaining life of existing unit (1st 8 years):} &= [730 * 36,000 * (1/9.3 - 1/19) / 1000] + [1754 * 36,000 * (1/5.54 - 1/(4.4 * 3.412)) / 1000] + [0.44 * 1 * ((1/0.945 * 17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1)/3412)] \\ &= 1443 + 7191 + 1328 \\ &= 9,963 kWh \\ \Delta kWh \text{ for remaining measure life (next 17 years):} &= (730 * 36,000 * (1/14 - 1/19) / 1000) + [1967 * 36,000 * (1/8.2 - 1/(4.4 * 3.412)) / 1000] + [0.44 * 1 * ((1/0.945 * 17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1)/3412)] \\ &= 494 + 3494 + 1328 \\ &= 5316 kWh \end{aligned}$$

**Fuel Switch Illustrative Example** [for illustrative purposes a Heat Rate of 10,000 Btu/kWh is used]

**New construction** using gas furnace and central AC baseline:

For example, a 3 ton unit with Part Load EER rating of 19 and Part Load COP of 4.4 in single family house in Springfield with a 40 gallon gas water heater is installed in place of a natural gas furnace and 3 ton Central AC unit:

$$\begin{aligned} \text{SourceEnergySavings (MMBTUs)} &= \text{GasHeatReplaced} - \text{GSHPSourceHeatConsumed} + \text{GSHPSourceCoolingImpact} + \text{GSHPSourceWaterImpact} \\ \text{GasHeatReplaced} &= [(FLH_{heat} * Capacity_{heating} * 1/AFUE_{base}) / 1,000,000] \\ &= [(1754 * 36,000 * 1/0.8) / 1,000,000] = 78.9 \text{ MMBtu} \\ \text{GSHPSourceHeatConsumed} &= [FLH_{heat} * Capacity_{heating} * (1/(COP_{PL} * 3.412))/1000] * H_{grid} / 1,000,000 \\ &= [1754 * 36,000 * (1/(4.4 * 3.412))/1000] * 10,000/1,000,000 = 42.1 \text{ MMBtu} \\ \text{GSHPSourceCoolingImpact} &= [FLH_{cool} * Capacity_{cooling} * (1/SEER_{base} - 1/EER_{PL})/1000] * H_{grid} / 1,000,000 \\ &= [730 * 36,000 * (1/13 - 1/19) / 1000] * 10,000/1,000,000 = 6.4 \text{ MMBtu} \\ \text{GSHPSourceWaterImpact}_{Gas} &= (\%DHWDisplaced * ((1/EF_{Gas} * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 1,000,000) \\ &= (0.44 * (1/0.58 * 17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1) / 1,000,000) = 7.4 \text{ MMBtu} \\ \text{SourceEnergySavings (MMBTUs)} &= 78.9 - 42.1 + 6.4 + 7.4 = 50.6 \text{ MMBtu} \end{aligned}$$

*Continued on next page*

**Fuel Switch Illustrative Example continued**

$$\begin{aligned} \Delta kWh_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline ASHP}] \\ &= [(1754 * 36,000 * 1/8.2)/1000] \\ &= 7,700 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{\text{EfficiencyImprovement}} &= [\text{Cooling Savings}] + [\text{Heat Savings from Baseline ASHP to GSHP}] + [\text{DHW savings if displacing electric DHW}] \\ &= [730 * 36,000 * (1/13 - 1/19) / 1000] + [1754 * 36,000 * (1/8.2 - 1/(4.4 * 3.412))/1000] + [0] \\ &= 638 + 3494 + 0 \\ &= 4132 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline gas system}] + [\text{DHW savings if displacing gas DHW}] \\ &= [(1754 * 36,000 * 1/0.8) / 100,000] + [(1 - 0) * (0.44 * (1/0.58 * 17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1) / 100,000)] \\ &= 789 + 74 \\ &= 863 \text{ Therms} \end{aligned}$$

Savings would be claimed as follows:

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	4132 – 7,700 + (863/0.1) = 5,062 kWh	N/A
Electric and gas utility	4,132 kWh	863 – (7,700 * 0.1) = 93 therms
Gas utility only	N/A	863 – (7,700 * 0.1) + (4132 * 0.1) = 506 therms

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\text{Capacity}_{\text{cooling}} * (1/\text{EER}_{\text{base}} - 1/\text{EER}_{\text{FL}}))/1000 * \text{CF}$$

Where:

**EERbase** = Energy Efficiency Ratio of baseline unit (kBtu/kWh). For early replacement measures, the actual EER rating where it is possible to measure or reasonably estimate should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC). If using rated efficiencies, derate efficiency value by 1% per year to account for degradation over time.<sup>418</sup> If unknown, assume default provided below:

<sup>418</sup> Justification for degradation factors can be found on page 21 of 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'



Baseline/Existing Cooling System	EER_base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	7.5 <sup>419</sup>	11 <sup>420</sup>	
Ground Source Heat Pump	12	12	
Central AC	7.5 <sup>421</sup>	10.5 <sup>422</sup>	
No central cooling	10.5 <sup>423</sup>	10.5	

EER<sub>FL</sub> = Full Load EER Efficiency of ENERGY STAR GSHP unit <sup>424</sup>

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 72%<sup>425</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
= 46.6%<sup>426</sup>

<sup>419</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>420</sup> The Federal Standard does not include an EER requirement, so it is approximated with the conversion formula from Wassmer, M. 2003 thesis referenced below.

<sup>421</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’

<sup>422</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

<sup>423</sup> Assumes that the decision to replace existing systems includes desire to add cooling.

<sup>424</sup> As per conversations with David Buss territory manager for Connor Co, the EER rating of an ASHP equate most appropriately with the full load EER of a GSHP.

<sup>425</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>426</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**New Construction or Time of Sale:**

**For example**, a 3 ton unit with Full Load EER rating of 19:

$$\begin{aligned} \Delta kW_{SSP} &= (36,000 * (1/11.8 - 1/19))/1000 * 0.72 \\ &= 0.83 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} &= (36,000 * (1/11 - 1/19))/1000 * 0.466 \\ &= 0.54 \text{ kW} \end{aligned}$$

**Early Replacement:**

**For example**, a 3 ton Full Load 19 EER replaces an existing working Air Source Heat Pump with unknown efficiency ratings in Marion:

$$\begin{aligned} \Delta kW_{SSP} \text{ for remaining life of existing unit (1st 8 years):} \\ &= (36,000 * (1/7.5 - 1/19))/1000 * 0.72 \\ &= 2.09 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{SSP} \text{ for remaining measure life (next 17 years):} \\ &= (36,000 * (1/11.8 - 1/19))/1000 * 0.72 \\ &= 0.83 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} \text{ for remaining life of existing unit (1st 8 years):} \\ &= (36,000 * (1/7.5 - 1/19))/1000 * 0.466 \\ &= 1.35 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} \text{ for remaining measure life (next 17 years):} \\ &= (36,000 * (1/11.8 - 1/19))/1000 * 0.466 \\ &= 0.54 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

Calculation provided together with Electric Energy Savings above

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING**

This measure can involve fuel switching from gas to electric.

For the purposes of forecasting load reductions due to fuel switch GSHP projects per Section 16-111.5B, changes in site energy use at the customer’s meter (using ΔkWh algorithm below) adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, this will not match the output of the calculation/allocation methodology presented in the “Electric Energy Savings” and “Natural Gas Savings” sections above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for

the remaining years of the measure.

$$\begin{aligned} \Delta\text{Therms} &= [\text{Heating Consumption Replaced}] + [\text{DHW Savings if gas}] \\ &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{\text{base}}) / 100,000] + [(1 - \text{ElecDHW}) * \\ &\quad \% \text{DHWD} \text{Displaced} * (1/ \text{EF}_{\text{GAS EXIST}} * \text{GPD} * \text{Household} * 365.25 * \gamma \text{Water} * (\text{T}_{\text{OUT}} - \text{T}_{\text{IN}}) * 1.0) \\ &\quad / 100,000]] \\ \Delta\text{kWh} &= - [\text{GSHP heating consumption}] + [\text{Cooling savings}] + [\text{DHW savings if electric}] \\ &= - [(\text{FLHheat} * \text{Capacity\_heating} * (1/\text{COP}_{\text{PL}} * 3.412))/1000] + [(\text{FLHcool} * \\ &\quad \text{Capacity\_cooling} * (1/\text{SEER}_{\text{base}} - 1/\text{EER}_{\text{PL}}))/1000] + [\text{ElecDHW} * \% \text{DHWD} \text{Displaced} * \\ &\quad ((1/\text{EF}_{\text{ELEC}} * \text{GPD} * \text{Household} * 365.25 * \gamma \text{Water} * (\text{T}_{\text{OUT}} - \text{T}_{\text{IN}}) * 1.0) / 3412)] \end{aligned}$$

**Illustrative Example of Cost Effectiveness Inputs for Fuel Switching**

**For example**, a 3 ton unit with Part Load EER rating of 19 and Part Load COP of 4.4 in single family house in Springfield with a 40 gallon gas water heater replaces an existing working natural gas furnace and 3 ton Central AC unit with unknown efficiency ratings. [Note the calculation provides the annual savings for the first 8 years of the measure life, an additional calculation (not shown) would be required to calculate the annual savings for the remaining life (years 9-25)]:

$$\begin{aligned} \Delta\text{Therms} &= [(\text{FLHheat} * \text{Capacity\_heating} * 1/\text{AFUE}_{\text{base}}) / 100,000] + [(1 - \text{ElecDHW}) * \\ &\quad \% \text{DHWD} \text{Displaced} * (1/ \text{EF}_{\text{GAS EXIST}} * \text{GPD} * \text{Household} * 365.25 * \gamma \text{Water} * (\text{T}_{\text{OUT}} - \text{T}_{\text{IN}}) * \\ &\quad 1.0) / 100,067]] \\ &= [1754 * 36,000 * 1/0.8] / 100,000 + [((1 - 0) * 0.44 * (1/ 0.58 * 17.6 * 2.56 * 365.25 * 8.33 * \\ &\quad (125-54) * 1) / 100,0067)] \\ &= 789 + 74 \\ &= 863 \text{ therms} \\ \Delta\text{kWh} &= - [(\text{FLHheat} * \text{Capacity\_heating} * (1/\text{COP}_{\text{PL}} * 3.412))/1000] + [(\text{FLHcool} * \\ &\quad \text{Capacity\_cooling} * (1/\text{SEER}_{\text{exist}} - 1/\text{EER}_{\text{PL}}))/1000] + [\text{ElecDHW} * \% \text{DHWD} \text{Displaced} * \\ &\quad (((1/\text{EF}_{\text{ELEC}}) * \text{GPD} * \text{Household} * 365.25 * \gamma \text{Water} * (\text{T}_{\text{OUT}} - \text{T}_{\text{IN}}) * 1.0) / 3412)] \\ &= - [(1754 * 36,000 * (1/(4.4 * 3.412)))/ 1000] + [(730 * 36,000 * (1/9.3 - 1/19))/ 1000] + [0 * \\ &\quad 0.44 * (((1/0.904) * 17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1)/3412)] \\ &= -4206 + 1443 + 0 \\ &= -2763 \text{ kWh} \end{aligned}$$

**MEASURE CODE: RS-HVC-GSHP-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

### 5.3.9 High Efficiency Bathroom Exhaust Fan

**DESCRIPTION**

This market opportunity measure is split into the purchase of a new bathroom fan for typical usage, and to meet the need for continuous mechanical ventilation due to reduced air-infiltration from a tighter building shell. In retrofit projects, existing fans may be too loud, or insufficient in other ways, to be operated as required for proper ventilation. This measure assumes fan capacities between 10 and 200 CFM rated at a sound level of less than 2.0 sones at 0.1 inches of water column static pressure, or 50 CFM if used for continuous ventilation. All eligible installations shall be sized to provide the mechanical ventilation rate indicated by ASHRAE 62.2.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

New efficient ENERGY STAR or ENERGY STAR Most Efficient exhaust-only ventilation fan, quiet (< 2.0 sones) operating in accordance with recommended ventilation rate indicated by ASHRAE 62.2 – 2016.<sup>427</sup> ENERGY STAR specifications (effective October 1, 2015) and 2018 Most Efficient specifications are provided below:

Efficiency Level	Fan Capacity	Minimum Efficacy Level (CFM/Watts)	Maximum Allowable Sound Level (sones)
ENERGY STAR	10 – 89 CFM	2.8	2.0
	90 – 200 CFM	3.5	
ENERGY STAR Most Efficient	All	10	

**DEFINITION OF BASELINE EQUIPMENT**

New standard efficiency exhaust-only ventilation fan.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 19 years.<sup>428</sup>

**DEEMED MEASURE COST**

Incremental cost per installed fan is \$43.50 for quiet, efficient fans.<sup>429</sup>

**LOADSHAPE**

Loadshape R11 - Residential Ventilation

**COINCIDENCE FACTOR**

The summer Peak Coincidence Factor is assumed to be 100% because the fan runs continuously.

<sup>427</sup> Bi-level controls may be used by efficient fans larger than 50 CFM

<sup>428</sup> Conservative estimate based upon GDS Associates Measure Life Report “Residential and C&I Lighting and HVAC measures” 25 years for whole-house fans, and 19 for thermostatically-controlled attic fans.

<sup>429</sup> VEIC analysis using cost data collected from wholesale vendor.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (CFM * (1/\eta_{BASELINE} - 1/\eta_{EFFICIENT})/1000) * Hours$$

Where:

- CFM = Nominal Capacity of the exhaust fan  
 = Actual or use defaults provided below  
 = Assume 50CFM for continuous ventilation<sup>430</sup>
- $\eta_{BASELINE}$  = Average efficacy for baseline fan (CFM/watts)  
 = See table below
- $\eta_{EFFICIENT}$  = Average efficacy for efficient fan (CFM/watts)  
 = Actual or use defaults provided below
- Hours = assumed annual run hours,  
 = 1089 for standard usage<sup>431</sup>  
 = 8766 for continuous ventilation.

Defaults provided below:<sup>432</sup>

Application	Min CFM	Max CFM	Average CFM	Base CFM/Watts	ENERGY STAR		ENERGY STAR Most Efficient	
					CFM/Watts	$\Delta kWh$ Savings	CFM/Watts	$\Delta kWh$ Savings
Standard usage	10	89	70.6	1.7	4.9	28.9	12.0	38.2
	90	200	116.1	2.6	5.6	25.3	13.9	38.7
	Unknown		92.4	2.2	5.3	27.4	12.9	38.6
Continuous usage	N/A		50	1.7	5.1	170.7	11.2	216.9

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (CFM * (1/\eta_{BASELINE} - 1/\eta_{EFFICIENT})/1000) * CF$$

Where:

- CF = Summer Peak Coincidence Factor  
 = 0.135 for standard usage  
 = 1.0 for continuous operation  
 Other variables as defined above

<sup>430</sup> 50CFM is the closest available fan size to ASHRAE 62.2 Section 4.1 Whole House Ventilation rates based upon typical square footage and bedrooms.

<sup>431</sup> Assumed to be consistent with Residential Indoor Lighting hours of use.

<sup>432</sup> Based on review of Bathroom Exhaust Fan product available on CEC Appliance Database, accessed 6/18/2018. See 'CEC Bath Fan.xls' for more information.

Application	Min CFM	Max CFM	Average CFM	ENERGY STAR $\Delta$ kW Savings	ENERGY STAR Most Efficient $\Delta$ kW Savings
Standard usage	10	89	70.6	0.0036	0.0047
	90	200	116.1	0.0031	0.0048
	Unknown		92.4	0.0034	0.0048
Continuous usage	N/A		50	0.0195	0.0247

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-BAFA-V02-190101**

**REVIEW DEADLINE: 1/1/2024**

### 5.3.10 HVAC Tune Up (Central Air Conditioning or Air Source Heat Pump)

#### DESCRIPTION

This measure involves the measurement of refrigerant charge levels and airflow over the central air conditioning or heat pump unit coil, correction of any problems found and post-treatment re-measurement. Measurements must be performed with standard industry tools and the results tracked by the efficiency program.

Savings from this measure are developed using a reputable Wisconsin study. It is recommended that future evaluation be conducted in Illinois to generate a more locally appropriate characterization.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

N/A

#### DEFINITION OF BASELINE EQUIPMENT

This measure assumes that the existing unit being maintained is either a residential central air conditioning unit or an air source heat pump that has not been serviced for at least 3 years.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 3 years.<sup>433</sup>

#### DEEMED MEASURE COST

If the implementation mechanism involves delivering and paying for the tune up service, the actual cost should be used. If however the customer is provided a rebate and the program relies on private contractors performing the work, the measure cost should be assumed to be \$225.<sup>434</sup>

#### LOADSHAPE

Loadshape R08 - Residential Cooling

#### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market.

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
= 68%<sup>435</sup>

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)

---

<sup>433</sup> Based on DEER 2014 EUL Table for "Clean Condenser Coils – Residential" and "Refrigerant Charge – Residential".

<sup>434</sup> Based on personal communication with HVAC efficiency program consultant Buck Taylor or Roltay Inc., 6/21/10, who estimated the cost of tune up at \$125 to \$225, depending on the market and the implementation details. The average value of \$175 has been increased by inflation to give an estimate of \$225 in 2021.

<sup>435</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

$$= 72\%^{436}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)}$$

$$= 46.6\%^{437}$$

---



---

### Algorithm

---



---

#### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh_{\text{Central AC}} = (\text{FLHcool} * \text{Capacity\_cooling} * (1/\text{SEER}_{\text{CAC}}))/1000 * \text{MFe}$$

$$\Delta kWh_{\text{Air Source Heat Pump}} = ((\text{FLHcool} * \text{Capacity\_cooling} * (1/\text{SEER}_{\text{ASHP}}))/1000 * \text{MFe}) + (\text{FLHheat} * \text{Capacity\_heating} * (1/\text{HSPF}_{\text{ASHP}}))/1000 * \text{MFe}$$

Where:

FLHcool = Full load cooling hours

Dependent on location as below:<sup>438</sup>

Climate Zone (City based upon)	FLHcool Single Family	FLHcool Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>439</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility's definition for multifamily

Capacity\_cooling = Cooling capacity of equipment in Btu/hr (note 1 ton = 12,000 Btu/hr)

= Actual

SEER<sub>CAC</sub> = SEER Efficiency of existing central air conditioning unit receiving maintenance

= Actual. If unknown assume 10 SEER<sup>440</sup>

MFe = Maintenance energy savings factor

= 0.05<sup>441</sup>

SEER<sub>ASHP</sub> = SEER Efficiency of existing air source heat pump unit receiving maintenance

<sup>436</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>437</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>438</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>439</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>440</sup> Use actual SEER rating where it is possible to measure or reasonably estimate. Unknown default of 10 SEER is a VEIC estimate of existing unit efficiency, based on minimum federal standard between the years of 1992 and 2006.

<sup>441</sup> Energy Center of Wisconsin, May 2008; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research."



FLHheat = Actual. If unknown assume 10 SEER <sup>442</sup>  
 = Full load heating hours  
 Dependent on location:<sup>443</sup>

Climate Zone (City based upon)	FLHheat
1 (Rockford)	2208
2 (Chicago)	2064
3 (Springfield)	1967
4 (Belleville)	1420
5 (Marion)	1445
Weighted Average <sup>444</sup>	1821

Capacity\_heating = Heating capacity of equipment in Btu/hr (note 1 ton = 12,000 Btu/hr)

HSPF<sub>ASHP</sub> = Actual  
 = Heating Season Performance Factor of existing air source heat pump unit receiving maintenance  
 = Actual. If unknown assume 6.8 HSPF <sup>445</sup>

**For example**, maintenance of a 3-ton, SEER 10 air conditioning unit in a single family house in Springfield:

$$\Delta kWh_{CAC} = (730 * 36,000 * (1/10))/1000 * 0.05$$

$$= 131 \text{ kWh}$$

**For example**, maintenance of a 3-ton, SEER 10, HSPF 6.8 air source heat pump unit in a single family house in Springfield:

$$\Delta kWh_{ASHP} = ((730 * 36,000 * (1/10))/1000 * 0.05) + (1967 * 36,000 * (1/6.8))/1000 * 0.05$$

$$= 652 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \text{Capacity}_{cooling} * (1/EER)/1000 * MFd * CF$$

Where:

EER = EER Efficiency of existing unit receiving maintenance in Btu/H/Watts

<sup>442</sup> Use actual SEER rating where it is possible to measure or reasonably estimate. Unknown default of 10 SEER is a VEIC estimate of existing unit efficiency, based on minimum federal standard between the years of 1992 and 2006.

<sup>443</sup> Full load heating hours for heat pumps are provided for Rockford, Chicago and Springfield in the ENERGY STAR Calculator. Estimates for the other locations were calculated based on the FLH to Heating Degree Day (from NCDC) ratio. VEIC consider ENERGY STAR estimates to be high due to oversizing not being adequately addressed. Using average Illinois billing data (from [Illinois Commerce Commission](#)) VEIC estimated the average gas heating load and used this to estimate the average home heating output (using 83% average gas heat efficiency). Dividing this by a typical 36,000 Btu/hr ASHP gives an estimate of average ASHP FLH\_heat of 1821 hours. We used the ratio of this value to the average of the locations using the ENERGY STAR data (1994 hours) to scale down the ENERGY STAR estimates. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>444</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>445</sup> Use actual HSPF rating where it is possible to measure or reasonably estimate. Unknown default of 6.8 HSPF is a VEIC estimate based on minimum Federal Standard between 1992 and 2006.

	= Calculate using Actual SEER
	= $- 0.02 * SEER^2 + 1.12 * SEER$ <sup>446</sup>
MFd	= Maintenance demand savings factor
	= $0.02$ <sup>447</sup>
CF <sub>SSP</sub>	= Summer System Peak Coincidence Factor for Central A/C (during system peak hour)
	= $68\%$ <sup>448</sup>
CF <sub>SSP</sub>	= Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)
	= $72\%$ <sup>449</sup>
CF <sub>PJM</sub>	= PJM Summer Peak Coincidence Factor for Central A/C and Heat Pumps (average during peak period)
	= $46.6\%$ <sup>450</sup>

**For example**, maintenance of 3-ton, SEER 10 (equals EER 9.2) CAC unit:

$$\begin{aligned} \Delta kW_{SSP} &= 36,000 * 1/(9.2)/1000 * 0.02 * 0.68 \\ &= 0.0532 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} &= 36,000 * 1/(9.2)/1000 * 0.02 * 0.466 \\ &= 0.0365 \text{ kW} \end{aligned}$$

#### NATURAL GAS SAVINGS

N/A

#### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

#### DEEMED O&M COST ADJUSTMENT CALCULATION

Conservatively not included.

**MEASURE CODE: RS-HVC-TUNE-V06-210101**

**REVIEW DEADLINE: 1/1/2025**

<sup>446</sup> Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

<sup>447</sup> Based on June 2010 personal conversation with Scott Pigg, author of Energy Center of Wisconsin, May 2008; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research" suggesting the average WI unit system draw of 2.8kW under peak conditions, and average peak savings of 50W.

<sup>448</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>449</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>450</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

## 5.3.11 Programmable Thermostats

### DESCRIPTION

This measure characterizes the household energy savings from the installation of a new or reprogramming of an existing Programmable Thermostat for reduced heating energy consumption through temperature set-back during unoccupied or reduced demand times. Because a literature review was not conclusive in providing a defensible source of prescriptive cooling savings from programmable thermostats, cooling savings from programmable thermostats are assumed to be zero for this version of the measure. It is not appropriate to assume a similar pattern of savings from setting a thermostat down during the heating season and up during the cooling season. Note that the EPA's EnergyStar program is developing a new specification for this project category, and if/when evaluation results demonstrate consistent cooling savings, subsequent versions of this measure will revisit this assumption.<sup>451</sup> Since energy savings are applicable at the household level, savings should only be claimed for one thermostat of any type (i.e., one programmable thermostat or one advanced thermostat), installation of multiple thermostats per home does not accrue additional savings.

This measure was developed to be applicable to the following program types: TOS, NC, RF, DI.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The criteria for this measure are established by replacement of a manual-only temperature control, with one that has the capability to adjust temperature setpoints according to a schedule without manual intervention. This category of equipment is broad and rapidly advancing in regards to the capability, and usability of the controls and their sophistication in setpoint adjustment and information display, but for the purposes of this characterization, eligibility is perhaps most simply defined by what it is not: a manual only temperature control.

For the thermostat reprogramming measure, the auditor consults with the homeowner to determine an appropriate set back schedule, reprograms the thermostat and educates the homeowner on its appropriate use.

### DEFINITION OF BASELINE EQUIPMENT

For new thermostats the baseline is a non-programmable thermostat requiring manual intervention to change temperature setpoint.

For the purpose of thermostat reprogramming, an existing programmable thermostat that an auditor determines is being used in override mode or otherwise effectively being operated like a manual thermostat.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of a programmable thermostat is assumed to be 16 years, however concerns over persistence over a population result in the application of a mid-life adjustment to reduce annual savings during the measure lifetime.<sup>452</sup> For reprogramming, the measure life of 2 years is assumed.

### DEEMED MEASURE COST

Actual material and labor costs should be used if the implementation method allows. If unknown (e.g., through a retail program) the capital cost for the new installation measure is assumed to be \$30.<sup>453</sup> The cost for reprogramming

---

<sup>451</sup> The ENERGY STAR program discontinued its support for this measure category effective 12/31/09, and is presently developing a new specification for 'Residential Climate Controls'.

<sup>452</sup> 8 years is based upon ASHRAE Applications (2003), Section 36, Table 3 estimate of 16 years for the equipment life, reduced by 50% to account for persistence issues.

<sup>453</sup> Market prices vary significantly in this category, generally increasing with thermostat capability and sophistication. The basic functions required by this measure's eligibility criteria are available on units readily available in the market for the listed price.

is assumed to be \$10 to account for the auditor’s time to reprogram and educate the homeowner.

**LOADSHAPE**

Loadshape R09 - Residential Electric Space Heat

**COINCIDENCE FACTOR**

N/A due to no savings attributable to cooling during the summer peak period.

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh^{454} = \%ElectricHeat * Elec\_Heating\_Consumption * Heating\_Reduction * HF * Eff\_ISR + (\Delta Therms * F_e * 29.3)$$

Where:

**%ElectricHeat** = Percentage of heating savings assumed to be electric

Heating fuel	%ElectricHeat
Electric	100%
Natural Gas	0%
Unknown	6.5% <sup>455</sup>

**Elec\_Heating\_Consumption**

= Estimate of annual household heating consumption for electrically heated homes.<sup>456</sup> If location and heating type is unknown, assume 15,683 kWh.<sup>457</sup>

Climate Zone (City based upon)	Electric Resistance Elec_Heating_ Consumption (kWh)	Electric Heat Pump Elec_Heating_ Consumption (kWh)
1 (Rockford)	21,748	12,793
2 (Chicago)	20,777	12,222
3 (Springfield)	17,794	10,467

<sup>454</sup> Note the second part of the algorithm relates to furnace fan savings if the heating system is Natural Gas.

<sup>455</sup> Assumes that half of the electric heat in the state is a heat pump able to be controlled by an advanced thermostat (consistent with Potential Study results from the state). Average value of 13% electric space heating from 2010 Residential Energy Consumption Survey for Illinois. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>456</sup> Values in table are based on converting an average household heating load (834 therms) for Chicago based on ‘Table E-1, Energy Efficiency/Demand Response Nicor Gas Plan Year 1: Research Report: Furnace Metering Study, Draft, Navigant, August 1 2013 to an electric heat load (divide by 0.03412) to electric resistance and ASHP heat load (resistance load reduced by 15% to account for distribution losses that occur in furnace heating but not in electric resistance while ASHP heat is assumed to suffer from similar distribution losses) and then to electric consumption assuming efficiencies of 100% for resistance and 200% for HP (see ‘Household Heating Load Summary Calculations\_08222018.xls’). Finally these values were adjusted to a statewide average using relative HDD assumptions to adjust for the evaluation results focus on northern region. Values for individual cities are then calculated by comparing average HDD to the individual city’s HDD.

<sup>457</sup> Assumption that 1/2 of electrically heated homes have electric resistance and 1/2 have Heat Pump, based on 2010 Residential Energy Consumption Survey for Illinois.

Climate Zone (City based upon)	Electric Resistance Elec_Heating_ Consumption (kWh)	Electric Heat Pump Elec_Heating_ Consumption (kWh)
4 (Belleville)	13,726	8,074
5 (Marion)	13,970	8,218
Average	19,749	11,617

Heating\_Reduction = Assumed percentage reduction in total household heating energy consumption due to programmable thermostat  
= 6.2%<sup>458</sup>

HF = Household factor, to adjust heating consumption for non-single-family households.

Household Type	HF
Single-Family	100%
Mobile home	83% <sup>459</sup>
Multifamily	65% <sup>460</sup>
Unknown	96.5% <sup>461</sup>
Actual	Custom <sup>462</sup>

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

Eff\_ISR = Effective In-Service Rate, the percentage of thermostats installed and programmed effectively

Program Delivery	Eff_ISR
Direct Install	100%
Other, or unknown	56% <sup>463</sup>

ΔTherms = Therm savings if Natural Gas heating system  
= See calculation in Natural Gas section below

F<sub>e</sub> = Furnace Fan energy consumption as a percentage of annual fuel consumption

<sup>458</sup> The savings from programmable thermostats are highly susceptible to many factors best addressed, so far for this category, by a study that controlled for the most significant issues with a very large sample size. To the extent that the treatment group is representative of the program participants for IL, this value is suitable. Higher and lower values would be justified based upon clear dissimilarities due to program and product attributes. Future evaluation work should assess program specific impacts associated with penetration rates, baseline levels, persistence, and other factors which this value represents.

<sup>459</sup> Since mobile homes are similar to Multifamily homes with respect to conditioned floor area but to single-family homes with respect to exposure (i.e., all four wall orientations are adjacent to the outside), this factor is estimated as an average of the single family and multifamily household factors.

<sup>460</sup> Multifamily household heating consumption relative to single-family households is affected by overall household square footage and exposure to the exterior. This 65% factor is applied to MF homes based on professional judgment that average household size, and heat loads of MF households are smaller than single-family homes

<sup>461</sup> When Household type is unknown, a value of 96.5% may be used as a weighted average of 90% SF and 10% MF (96.5% = 100%\*90% + 65%\*10%) based on a Navigant evaluation of PY8 participants in ComEd’s advanced thermostat program.

<sup>462</sup> Program-specific household factors may be utilized on the basis of sufficiently validated program evaluations.

<sup>463</sup>“Programmable Thermostats. Report to KeySpan Energy Delivery on Energy Savings and Cost Effectiveness,” GDS Associates, Marietta, GA. 2002GDS

$$= 3.14\%^{464}$$

29.3

= kWh per therm

**For example**, a programmable thermostat directly installed in an electric resistance heated, single-family home in Springfield:

$$\begin{aligned} \Delta\text{kWh} &= 1 * 17,794 * 0.062 * 100\% * 100\% + (0 * 0.0314 * 29.3) \\ &= 1,103 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A due to no savings from cooling during the summer peak period.

### NATURAL GAS ENERGY SAVINGS

$$\Delta\text{Therms} = \%FossilHeat * Gas\_Heating\_Consumption * Heating\_Reduction * HF * Eff\_ISR$$

Where:

$\%FossilHeat$  = Percentage of heating savings assumed to be Natural Gas

Heating fuel	$\%FossilHeat$
Electric	0%
Natural Gas	100%
Unknown	93.5% <sup>465</sup>

$Gas\_Heating\_Consumption$

= Estimate of annual household heating consumption for gas heated single-family homes. If location is unknown, assume the average below.<sup>466</sup>

Climate Zone (City based upon)	$Gas\_Heating\_Consumption$ (therms)
1 (Rockford)	1,052
2 (Chicago)	1,005
3 (Springfield)	861
4 (Belleville)	664
5 (Marion)	676

<sup>464</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See "Programmable Thermostats Furnace Fan Analysis.xlsx" for reference.

<sup>465</sup> Assumes that half of the electric heat in the state is a heat pump able to be controlled by an advanced thermostat. Data from 2010 Residential Energy Consumption Survey for Illinois. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used.

<sup>466</sup> Values are based on adjusting the average household heating load (834 therms) for Chicago based on 'Table E-1, Energy Efficiency / Demand Response Nicor Gas Plan Year 1, Research Report: Furnace Metering Study', divided by standard assumption of existing unit efficiency of 83% (estimate based on 24% of furnaces purchased in Illinois were condensing in 2000 (based on data from GAMA, provided to Department of Energy), assuming typical efficiencies:  $(0.24 * 0.92) + (0.76 * 0.8) = 0.83$ ) to give 1005 therms. This Chicago value was then adjusted to a statewide average using relative HDD assumptions to adjust for the evaluation results focus on northern region. Values for individual cities are then calculated by comparing average HDD to the individual city's HDD.

Climate Zone (City based upon)	Gas_Heating_ Consumption (therms)
Average	955

**For example**, a programmable thermostat directly-installed in a gas heated single-family home in Chicago:

$$\Delta\text{Therms} = 1.0 * 1005 * 0.062 * 100\% * 100\%$$

$$= 62.3 \text{ therms}$$

**Mid-Life Baseline Adjustment**

Due to concerns that across a population the savings for programmable thermostats are likely to decline through the technical lifetime of the thermostat,<sup>467</sup> a mid-life adjustment should be applied. The mid-life adjustment should be applied in year 6 (i.e., after five years of full savings) and is calculated as 28%. This results in a consistent lifetime savings as applying a 50% reduction to the technical lifetime. This adjustment should be applied to both electric or therm heating savings.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-PROG-V07-210101**

**REVIEW DEADLINE: 1/1/2025**

---

<sup>467</sup> This concern is based on consideration of the findings from a number of evaluations, including Sachs et al, *“Field Evaluation of Programmable Thermostats”*, US DOW Building Technologies Program, December 2012, p35; “low proportion of households that ended up using thermostat-enabled energy saving settings”, and Meier et al., *“Usability of residential thermostats: Preliminary investigations”*, Lawrence Berkeley National Laboratory, March 2011, p1; “The majority of occupants operated thermostats manually, rather than relying on their programmable features and almost 90% of respondents reported that they rarely or never adjusted the thermostat to set a weekend or weekday program. Photographs of thermostats were collected in one on-line survey, which revealed that about 20% of the thermostats displayed the wrong time and that about 50% of the respondents set their programmable thermostats on “long term hold” (or its equivalent).”

### 5.3.12 Ductless Heat Pumps

#### DESCRIPTION

This measure is designed to calculate electric savings for the installation of a ductless mini-split heat pump (DMSHP). DMSHPs save energy in heating mode because they provide heat more efficiently than electric resistance heat and central ASHP systems. Additionally, DMSHPs use less fan energy to move heat and don't incur heat loss through a duct distribution system.

For cooling, the proposed savings calculations are aligned with those of typical replacement systems. DMSHPs save energy in cooling mode because they provide cooling capacity more efficiently than other types of unitary cooling equipment. A DMSHP installed in a home with a central ASHP system will save energy by offsetting some of the cooling energy of the ASHP. In order for this measure to apply, the control strategy for the heat pump is assumed to be chosen to maximize savings per installer recommendation.<sup>468</sup>

This measure characterizes the following scenarios:

- a) New Construction:
  - a. The installation of a new DMSHP meeting efficiency standards required by the program in a new home.
  - b. Note the baseline in this case should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition.
- b) Time of Sale:
  - a. The planned installation of a new DMSHP meeting efficiency standards required by the program to replace an existing system(s) that does not meet the criteria for early replacement described in section c below.
  - b. Note the baseline in this case is an equivalent replacement system to that which exists currently in the home. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, just an electric utility or just a gas utility.
- c) Early Replacement/Retrofit:
  - a. The early removal or displacement of functioning either electric or gas space heating and/or cooling systems from service, prior to the natural end of life, and replacement with a new DMSHP.
  - b. Note the baseline in this case is the existing equipment being replaced/displaced. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, just an electric utility or just a gas utility.
  - c. Early Replacement determination will be based on meeting the following conditions:
    - The existing unit is operational when replaced/displaced, or
    - The existing unit requires minor repairs, defined as costing less than:<sup>469</sup>

Existing System	Maximum repair cost
Air Source Heat Pump	\$276 per ton
Central Air Conditioner	\$190 per ton

<sup>468</sup> The whole purpose of installing ductless heat pumps is to conserve energy, so the installer can be assumed to be capable of recommending an appropriate controls strategy. For most applications, the heating setpoint for the ductless heat pump should be at least 2F higher than any remaining existing system and the cooling setpoint for the ductless heat pump should be at least 2F cooler than the existing system (this should apply to all periods of a programmable schedule, if applicable). This helps ensure that the ductless heat pump will be used to meet as much of the load as possible before the existing system operates to meet the remaining load. Ideally, the new ductless heat pump controls should be set to the current comfort settings, while the existing system setpoints should be adjusted down (heating) and up (cooling) to capture savings.

<sup>469</sup> The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement.



Existing System	Maximum repair cost
Boiler	\$709
Furnace	\$528
Ground Source Heat Pump	<\$249 per ton

- All other conditions will be considered Time of Sale.
- d. The Baseline efficiency of the existing unit replaced:
- If the efficiency of the existing unit is less than the maximum shown below, the Baseline efficiency is the actual efficiency value of the unit replaced. If the efficiency is greater than the maximum, the Baseline efficiency is shown in the “New Baseline” column below:

Existing System	Maximum efficiency for Actual	New Baseline <sup>470</sup>
Air Source Heat Pump	10 SEER	14 SEER
Central Air Conditioner	10 SEER	13 SEER
Boiler	75% AFUE	82% AFUE
Furnace	75% AFUE	80% AFUE
Ground Source Heat Pump	10 SEER	13 SEER

- If the efficiency of the existing unit is unknown, use assumptions in variable list below (SEER, HSPF or AFUE exist).
- If the operational status or repair cost of the existing unit is unknown use time of sale assumptions.

This measure was developed to be applicable to the following program types: RF, TOS, NC, EREP.

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

In order for this characterization to apply, the new equipment must be a high-efficiency, variable-capacity (typically “inverter-driven” DC motor) ductless heat pump system that exceeds the program minimum efficiency requirements.

**DEFINITION OF BASELINE EQUIPMENT**

For these products, baseline equipment includes Air Conditioning and Space Heating:

New Construction:

To calculate savings with an electric baseline, the baseline equipment is assumed to be an Air Source Heat Pump meeting the Federal Standard efficiency level; 14 SEER, 8.2 HSPF and 11 EER.<sup>471</sup>

To calculate savings with a furnace/central AC baseline, the baseline equipment is assumed to be an 80% AFUE Furnace and central AC meeting the Federal Standard efficiency level; 13 SEER, 10.5 EER.<sup>472</sup>

Time of Sale: The baseline for this measure is a new replacement unit of the same system type as the existing unit, meeting the baselines provided below.

Unit Type	Efficiency Standard
ASHP	14 SEER, 11 EER, 8.2 HSPF
Gas Furnace	80% AFUE

<sup>470</sup> Based on relevant Federal Standards.

<sup>471</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

<sup>472</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See ‘AIC HVAC Metering Study Memo FINAL 2\_28\_2018’.

Unit Type	Efficiency Standard
Gas Boiler	82% AFUE
Central AC	13 SEER, 10.5 EER

Early replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating and cooling equipment for the assumed remaining useful life of the existing unit and a new baseline heating and cooling system for the remainder of the measure life (as provided in table above except for Gas Furnace where new baseline assumption is 90% due to pending standard change). Note that in order to claim cooling savings, there must be an existing air conditioning system.

For multifamily buildings, each residence must have existing individual heating equipment. Multifamily residences with central heating do not qualify for this characterization.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 15 years.<sup>473</sup>

For early replacement, the remaining life of existing equipment is assumed to be 6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers<sup>474</sup> and 15 years for electric resistance.<sup>475</sup>

**DEEMED MEASURE COST**

New Construction and Time of Sale: The actual installed cost of the DMSHP (including any necessary electrical or distribution upgrades required) should be used (defaults are provided below), minus the assumed installation cost of the baseline equipment (\$1,381 per ton for ASHP,<sup>476</sup> or \$2,011 for a new baseline 80% AFUE furnace, or \$3,543 for a new 82% AFUE boiler,<sup>477</sup> and \$952 per ton for new baseline Central AC replacement<sup>478</sup>).

Default full cost of the DMSHP is provided below. Note, for smaller units a minimum cost of \$2,000 should be applied.<sup>479</sup>

Unit Size	Full Install Cost (\$/ton) <sup>480</sup>
9-9.9	\$1,443
10-10.9	\$1,605
11-12.9	\$1,715
13+	\$2,041

The incremental cost of the DSMHP compared to a baseline minimum efficiency DSMHP is provided in the table

<sup>473</sup> [Based on 2016 DOE Rulemaking Technical Support Document](#), as recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

<sup>474</sup> Assumed to be one third of effective useful life of replaced equipment.

<sup>475</sup> Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.

<sup>476</sup> Baseline cost per ton derived from DEER 2008 Database Technology and Measure Cost Data. See ‘ASHP\_Revised DEER Measure Cost Summary.xls’ for calculation.

<sup>477</sup> Furnace and boiler costs are based on data provided in Appendix E of the Appliance Standards Technical Support Documents including equipment cost and installation labor. Where efficiency ratings are not provided, the values are interpolated from those that are.

<sup>478</sup> Based on 3 ton initial cost estimate for a conventional unit from ENERGY STAR Central AC calculator

<sup>479</sup> The cost per ton table provides reasonable estimates for installation costs of DMSHP, which can vary significantly due to requirements of the home. It is estimated that all units, even those 1 ton or less will be at least \$2000 to install.

<sup>480</sup> Full costs based upon full install cost of an ASHP plus incremental costs provided in Memo from Opinion Dynamics Evaluation Team, Ductless Mini-Split Heat Pumps: Incremental Cost Analysis, April 27, 2017.

below:<sup>481</sup>

Efficiency (HSPF)	Incremental Cost (\$/ton) over an HSPF 8.0 DHP
9-9.9	\$62
10-10.9	\$224
11-12.9	\$334
13+	\$660

Early Replacement/retrofit (replacing existing equipment): The actual full installation cost of the DMSHP (including any necessary electrical or distribution upgrades required) should be used. The assumed deferred cost (after 8 years) of replacing existing equipment with a new baseline unit is assumed to be \$1,518 per ton for a new baseline Air Source Heat Pump, or \$2,903 for a new baseline 90% AFUE furnace or \$4,045 for a new 82% AFUE boiler and \$1,047 per ton for new baseline Central AC replacement.<sup>482</sup> If replacing electric resistance heat, there is no deferred replacement cost. This future cost should be discounted to present value using the nominal societal discount rate.

Where the DMSHP is a supplemental HVAC system, the full installation cost of the DMSHP (including any necessary electrical or distribution upgrades required) should be used without a deferred replacement cost.

If the install cost is unknown a default is provided above, however because these assumptions do not include any additional costs that may be required for fuel switch scenarios, these defaults should not be used and actual costs should always be used for fuel switch measures.

**LOADSHAPE**

- Loadshape R10 - Residential Electric Heating and Cooling (if replacing gas heat and central AC)<sup>483</sup>
- Loadshape R09 - Residential Electric Space Heat (if replacing electric heat with no cooling)
- Loadshape R10 - Residential Electric Heating and Cooling (if replacing ASHP)

Note for purpose of cost effectiveness screening a fuel switch scenario, the heating kWh increase and cooling kWh decrease should be calculated separately such that the appropriate loadshape (i.e., Loadshape R09 - Residential Electric Space Heat and Loadshape R08 – Residential Cooling respectively) can be applied.

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in four different ways below. The first two relate to the use of DMSHP to supplement existing cooling or provide limited zonal cooling, the second two relate to use of the DMSHP to provide whole house cooling. In each pair, the first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM’s capacity market. Both values provided are based on metering data for 40 DMSHPs in Ameren Illinois service territory.<sup>484</sup>

For supplemental or limited zonal cooling:

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for DMSHP (during utility peak hour)  
 = 43.1%<sup>485</sup>

<sup>481</sup> Memo from Opinion Dynamics Evaluation Team, Ductless Mini-Split Heat Pumps: Incremental Cost Analysis, April 27, 2017

<sup>482</sup> All baseline replacement costs are consistent with their respective measures and include inflation rate of 1.91%.

<sup>483</sup> The baseline for calculating electric savings is an Air Source Heat Pump.

<sup>484</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015

<sup>485</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for DMSHP (average during PJM peak period)}$$

$$= 28.0\%^{486}$$

For whole house cooling:

$$CF_{SSP} = \text{Summer System Peak Coincidence Factor for Heat Pumps (during utility peak hour)}$$

$$= 72\%^{487}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Heat Pumps (average during PJM peak period)}$$

$$= 46.6\%^{488}$$

---

## Algorithms

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS AND NATURAL GAS SAVINGS

Non fuel switch measures:

$$\Delta kWh = [\text{Cooling Savings}] + [\text{Heating Savings}]$$

$$= [(Capacity_{cool} * EFLH_{cool} * (1/SEER_{Base} - 1/SEER_{ee}))/1000] + [(Capacity_{heat} * EFLH_{heat} * (1/HSPF_{Base} - 1/HSPF_{ee})) / 1000]$$

Fuel switch measures:

Fuel switch measures must produce positive total annual source fuel savings (i.e., reduction in source Btus) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

$$\text{SourceEnergySavings (MMBTUs)} = \text{GasHeatReplaced} - \text{DMSHPSourceHeatConsumed} + \text{DMSHPSourceCoolingImpact}$$

$$\text{GasHeatReplaced}^{489} = [(FLH_{heat} * Capacity_{heating} * 1/AFUE_{base}) / 1,000,000]$$

$$\text{DMSHPSourceHeatConsumed} = [(Capacity_{heat} * EFLH_{heat} * (1/HSPF_{ee}))/1000] * H_{grid} / 1,000,000$$

$$\text{DMSHPSourceCoolingImpact} = ((Capacity_{cool} * EFLH_{cool} * (1/SEER_{Base} - 1/SEER_{ee}))/1000) * H_{grid} / 1,000,000$$

If SourceEnergySavings calculated above is positive, the measure is eligible.

---

<sup>486</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>487</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>488</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>489</sup> Note the Gas Source to Site ratio is assumed to be 1.0.

Two electric algorithms and one gas algorithm are provided below. The appropriate claim is dependent on which utilities are supporting the measure as provided in a table below.

$$\Delta kWh_{FuelSwitch} = [\text{Heat consumption of baseline ASHP}]$$

$$= [(Capacity_{heat} * EFLH_{heat} * 1/HSPF_{baseASHP})/1000]$$

$$\Delta kWh_{EfficiencyImprovement} = [\text{Cooling Savings}] + [\text{Heat Savings from Baseline ASHP to Efficient DMSHP}]$$

$$= ((Capacity_{cool} * EFLH_{cool} * (1/SEER_{Base} - 1/SEER_{ee})) / 1000) + ((Capacity_{heat} * EFLH_{heat} * (1/HSPF_{Base} - 1/HSPF_{ee})) / 1000)$$

$$\Delta Therm_{FuelSwitch} = [\text{Replaced Heat consumption of baseline gas system}]$$

$$= [(Capacity_{heat} * EFLH_{heat} * 1/AFUE_{base}) / 100,000]$$

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$\Delta kWh_{EfficiencyImprovement} - \Delta kWh_{FuelSwitch} + (\Delta Therm_{FuelSwitch} / kWh_{toTherm})$	N/A
Electric and gas utility	$\Delta kWh_{EfficiencyImprovement}$	$\Delta Therm_{FuelSwitch} - (\Delta kWh_{FuelSwitch} * kWh_{toTherm})$
Gas utility only	N/A	$\Delta Therm_{FuelSwitch} - (\Delta kWh_{FuelSwitch} * kWh_{toTherm}) + (\Delta kWh_{EfficiencyImprovement} * kWh_{toTherm})$

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

Capacity<sub>cool</sub> = the cooling capacity of the ductless heat pump unit in Btu/hr<sup>490</sup>  
 = Actual installed

EFLH<sub>cool</sub> = Equivalent Full Load Hours for cooling. Depends on location. See table below.<sup>491</sup>

Climate Zone (City based upon)	EFLH <sub>cool</sub>
1 (Rockford)	323
2 (Chicago)	308
3 (Springfield)	468
4 (Belleville)	629
5 (Marion)	549
Weighted Average <sup>492</sup>	364

SEER<sub>base</sub> = Seasonal Energy Efficiency Ratio of baseline unit (kBtu/kWh). For early replacment measures, the actual SEER rating where it is possible to measure or reasonably estimate

<sup>490</sup> 1 Ton = 12 kBtu/hr

<sup>491</sup> *All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems*, Cadmus, October 2015. FLH values are based on metering of Multifamily units, and in buildings that had received weatherization improvements. Additional evaluation is recommended to refine the EFLH assumptions for the general population.

<sup>492</sup> Weighted based on number of residential occupied housing units in each zone.

should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC), if unknown assume default provided below:

Baseline/Existing Cooling System	SEERbase		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	9.3 <sup>493</sup>	14 <sup>494</sup>	
Central AC	9.3 <sup>495</sup>	13 <sup>496</sup>	
Room AC	8.0 <sup>497</sup>	13	
No central cooling	Make '1/SEER_exist' = 0 <sup>498</sup>	13 <sup>499</sup>	

SEER<sub>ee</sub> = SEER rating of new equipment (kbtu/kwh)  
 = Actual installed<sup>500</sup>

Capacity<sub>heat</sub> = Heating capacity of the ductless heat pump unit in Btu/hr  
 = Actual

EFLH<sub>heat</sub> = Equivalent Full Load Hours for heating. Depends on location. See table below:

Climate Zone (City based upon)	EFLH <sub>heat</sub> <sup>501</sup>
1 (Rockford)	1,520
2 (Chicago)	1,421
3 (Springfield)	1,347
4 (Belleville)	977
5 (Marion)	994
Weighted Average	1,406

HSPF<sub>base</sub> = Heating System Performance Factor of baseline heating system (kBtu/kWh) For early replacement measures, use actual HSPF rating where it is possible to measure or

<sup>493</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>494</sup> Minimum Federal Standard as of 1/1/2015

<sup>495</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>496</sup> Minimum Federal Standard; Federal Register, Vol. 66, No. 14, Monday, January 22, 2001/Rules and Regulations, p. 7170-7200.

<sup>497</sup> Estimated by converting the EER assumption for Room AC using the conversion equation;  $EER_{base} = (-0.02 * SEER_{base}^2) + (1.12 * SEER)$ . From Wassmer, M. (2003). 'A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations', Masters Thesis, University of Colorado at Boulder.

<sup>498</sup> If there is no central cooling in place but the incentive encourages installation of a new ASHP with cooling, the added cooling load should be subtracted from any heating benefit.

<sup>499</sup> Assumes that the decision to replace existing systems includes desire to add cooling.

<sup>500</sup> Note that if only an EER rating is available, use the following conversion equation;  $EER_{base} = (-0.02 * SEER_{base}^2) + (1.12 * SEER)$ . From Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder.

<sup>501</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015. FLH values are based on metering of Multifamily units that were used as the primary heating source to the whole home, and in buildings that had received weatherization improvements. A DMSHP installed in a single-family home may be used more sporadically, especially if the DMSHP serves only a room, and buildings that have not been weatherized may require longer hours. Additional evaluation is recommended to refine the EFLH assumptions for the general population.

reasonably estimate for the remaining useful life of the existing equipment (6 years for ASHP, 15 years for electric resistance). If unknown assume default:

Baseline/ Existing Heating System	HSPF <sub>Base</sub>		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	5.54 <sup>502</sup>	8.2 <sup>503</sup>	
Electric Resistance	3.41 <sup>504</sup>		

HSPF<sub>ee</sub> = HSPF rating of new equipment (kbtu/kwh)

= Actual installed

<sup>502</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>503</sup> Based on Minimum Federal Standard effective 1/1/2015.

<sup>504</sup> Electric resistance has a COP of 1.0 which equals 1/0.293 = 3.41 HSPF.

### Non Fuel Switch Illustrative Examples

Installing a 1.5-ton (heating and cooling capacity) ductless heat pump unit rated at 8 HSPF and 14 SEER in a single-family home in Chicago to displace electric baseboard heat and replace a window air conditioner of unknown efficiency, savings are:

$$\begin{aligned}\Delta\text{kWh}_{\text{heat}} &= (18000 * 1421 * (1/3.412 - 1/8))/1000 &= 4,299 \text{ kWh} \\ \Delta\text{kWh}_{\text{cool}} &= (18000 * 308 * (1/8.0 - 1/14))/1000 &= 297 \text{ kWh} \\ \Delta\text{kWh} &= 4,299 + 297 &= 4,596 \text{ kWh}\end{aligned}$$

### Fuel Switch Illustrative Examples

*[for illustrative purposes a Heat Rate of 10,000 Btu/kWh is used, kWh to Therm = 10,000/100,000 = 0.1]*

Installing a 1.5-ton (heating and cooling capacity) ductless heat pump unit rated at 9 HSPF and 16 SEER in a single-family home in Chicago to displace gas furnace heat and replace a central air conditioner of unknown efficiency, savings are:

$$\begin{aligned}\text{LifetimeSourceEnergySavings (MMBTUs)} &= \text{LifetimeGasHeatReplaced} - \\ &\quad \text{LifetimeDMSHPSourceHeatConsumed} + \text{LifetimeDMSHPSourceCoolingImpact} \\ \text{LifetimeGasHeatReplaced} &= (([\text{FLH}_{\text{heat}} * \text{Capacity}_{\text{heating}} * 1/\text{AFUE}_{\text{exist}}] / 1,000,000] * 7 \text{ years}) \\ &\quad + ([\text{FLH}_{\text{heat}} * \text{Capacity}_{\text{heating}} * 1/\text{AFUE}_{\text{base}}] / 1,000,000] * 8 \text{ years}) \\ &= (((1421 * 18,000 * 1/0.644) / 1,000,000) * 7) + (((1421 * 18,000 * 1/0.9) / \\ &\quad 1,000,000) * 8) \\ &= 505.8 \text{ MMBtu} \\ \text{LifetimeDMSHPSourceHeatConsumed} &= [(\text{Capacity}_{\text{heat}} * \text{EFLH}_{\text{heat}} * (1/\text{HSPF}_{\text{ee}}))/1000] * H_{\text{grid}} / \\ &\quad 1,000,000 * 15 \text{ years} \\ &= ((1421 * 18,000 * (1/9)) / 1000) * 10,000/1,000,000 * 15 \text{ years} \\ &= 426.3 \text{ MMBtu} \\ \text{LifetimeDMSHPSourceCoolingImpact} &= ((\text{Capacity}_{\text{cool}} * \text{EFLH}_{\text{cool}} * (1/\text{SEER}_{\text{Base}} - 1/\text{SEER}_{\text{ee}}))/1000) * \\ &\quad H_{\text{grid}} / 1,000,000 \\ &= (((308 * 18,000 * (1/9.3 - 1/16))/1000) * 6 \text{ years}) + (((308 * 18,000 * (1/13 \\ &\quad - 1/16))/1000) * 9 \text{ years}) * 10,000/1,000,000 \\ &= 22.2 \text{ MMBtu} \\ \text{LifetimeSourceEnergySavings (MMBTUs)} &= 505.8 - 426.3 + 22.2 \\ &= 101.7 \text{ MMBtu}\end{aligned}$$



**Fuel Switch Illustrative Examples continued**

$$\begin{aligned} \Delta kWh_{\text{FuelSwitch}} &= [\text{Heat consumption of baseline ASHP}] \\ &= [(1421 * 18,000 * 1/8.2)/1000] \\ &= 3,119 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{\text{EfficiencyImprovement}} (\text{Remaining Useful Life}) &= [\text{Cooling Savings from existing to DMSHP}] + [\text{Heat Savings from Baseline ASHP to DMSHP}] \\ &= (308 * 18,000 * (1/9.3 - 1/16))/1000 + (1421 * 18,000 * (1/8.2 - 1/9)) / 1000 \\ &= 250 + 277 \\ &= 527 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{\text{EfficiencyImprovement}} (\text{Remaining measure}) &= [\text{Cooling Savings from new baseline to DMSHP}] + [\text{Heat Savings from Baseline ASHP to DMSHP}] \\ &= (308 * 18,000 * (1/13 - 1/16))/1000 + (1421 * 18,000 * (1/8.2 - 1/9)) / 1000 \\ &= 80 + 277 \\ &= 357 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch}} (\text{Remaining Useful Life}) &= [\text{Replaced Heat consumption of existing gas system}] \\ &= [(1421 * 18,000 * 1/0.644) / 100,000] \\ &= 397 \text{ Therms} \end{aligned}$$

$$\begin{aligned} \Delta \text{Therm}_{\text{FuelSwitch}} (\text{Measure Life}) &= [\text{Replaced Heat consumption of new baseline gas system}] \\ &= [(1421 * 18,000 * 1/0.9) / 100,000] \\ &= 284 \text{ Therms} \end{aligned}$$

Savings would be claimed as follows:

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	$527 - 3119 + (397/0.1)$ = 1378 kWh for 1 <sup>st</sup> 7 years  $357 - 3119 + (284/0.1)$ = 78 kWh for remaining life	N/A
Electric and gas utility	527 kWh for 1 <sup>st</sup> 7 years  357 kWh for remaining life	$397 - (3119 * 0.1)$ = 85.1 therms for 1 <sup>st</sup> 7 years  $284 - (3119 * 0.1)$ = -27.9 therms for remaining life
Gas utility only	N/A	$397 - (3119 * 0.1) + (527 * 0.1)$ = 137.8 therms for 1 <sup>st</sup> 7 years  $284 - (3119 * 0.1) + (357 * 0.1)$ = 7.8 therms

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((\text{Capacity}_{\text{cool}} * (1/\text{EER}_{\text{base}} - 1/\text{EER}_{\text{ee}})) / 1000) * \text{CF}$$

Where:

EER\_base = Energy Efficiency Ratio of baseline unit (kBtu/kWh). For early replacement measures, the actual EER rating where it is possible to measure or reasonably estimate should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC). If using rated efficiencies, derate efficiency value by 1% per year to account for degradation over time.<sup>505</sup> If unknown assume default provided below:

Baseline/Existing Cooling System	EER_base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	7.5 <sup>506</sup>	11 <sup>507</sup>	
Central AC	7.5 <sup>508</sup>	10.5 <sup>509</sup>	
Room AC	7.7 <sup>510</sup>	10.5	
No central cooling	Make '1/EER_exist' = 0 <sup>511</sup>		10.5

EER\_ee = Energy Efficiency Ratio of new ductless Air Source Heat Pump (kBtu/hr / kW)  
 = Actual, If not provided convert SEER to EER using this formula: <sup>512</sup>  

$$= (-0.02 * SEER^2) + (1.12 * SEER)$$

For supplemental or limited zonal cooling:

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for DMSHP (during utility peak hour)  
 = 43.1%<sup>513</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for DMSHP (average during PJM peak period)  
 = 28.0%<sup>514</sup>

For whole house cooling:

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during utility peak hour)

<sup>505</sup> Justification for degradation factors can be found on page 21 of 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>506</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>507</sup> The Federal Standard does not include an EER requirement. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>508</sup> Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'

<sup>509</sup> The federal Standard does not currently include an EER component. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2\_28\_2018'.

<sup>510</sup> Same EER as Window AC recycling. Based on Nexus Market Research Inc, RLW Analytics, December 2005; "Impact, Process, and Market Study of the Connecticut Appliance Retirement Program: Overall Report."

<sup>511</sup> If there is no central cooling in place but the incentive encourages installation of a new ASHP with cooling, the added cooling load should be subtracted from any heating benefit.

<sup>512</sup> Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

<sup>513</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>514</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

$$CF_{PJM} = 72\%^{515}$$

$CF_{PJM}$  = PJM Summer Peak Coincidence Factor for Heat Pumps (average during PJM peak period)

$$= 46.6\%^{516}$$

**NATURAL GAS SAVINGS**

Calculation provided together with Electric Energy Savings above.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING**

This measure can involve fuel switching from gas to electric.

For the purposes of forecasting load reductions due to fuel switch DMSHP projects per Section 16-111.5B, changes in site energy use at the customer’s meter (using ΔkWh algorithm below) adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, this will not match the output of the calculation/allocation methodology presented in the “Electric Energy Savings” and “Natural Gas Savings” sections above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure.

$$\Delta\text{Therms} = [\text{Heating Consumption Replaced}]$$

$$= [(\text{Capacity}_{\text{heat}} * \text{EFLH}_{\text{heat}} * 1/\text{AFUE}_{\text{base}}) / 100,000]$$

$$\Delta\text{kWh} = - [\text{DMSHP heating consumption}] + [\text{Cooling savings}]$$

$$= - [(\text{Capacity}_{\text{heat}} * \text{EFLH}_{\text{heat}} * 1/\text{HSPFee})/1000] + [(\text{Capacity}_{\text{cool}} * \text{EFLH}_{\text{cool}} * (1/\text{SEER}_{\text{Base}} - 1/\text{SEER}_{\text{ee}})) / 1000]$$

**MEASURE CODE: RS-HVC-DHP-V08-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>515</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>516</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

### 5.3.13 Residential Furnace Tune-Up

#### DESCRIPTION

This measure is for a natural gas Residential furnace that provides space heating. The tune-up will improve furnace performance by inspecting, cleaning and adjusting the furnace and appurtenances for correct and efficient operation. Additional savings maybe realized through a complete system tune-up.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure an approved technician must complete the tune-up requirements listed below:<sup>517</sup>

- Measure combustion efficiency using an electronic flue gas analyzer
- Check and clean blower assembly and components per manufacturer's recommendations
- Where applicable Lubricate motor and inspect and replace fan belt if required
- Inspect for gas leaks
- Clean burner per manufacturer's recommendations and adjust as needed
- Check ignition system and safety systems and clean and adjust as needed
- Check and clean heat exchanger per manufacturer's recommendations
- Inspect exhaust/flue for proper attachment and operation
- Inspect control box, wiring and controls for proper connections and performance
- Check air filter and clean or replace per manufacturer's
- Inspect duct work connected to furnace for leaks or blockages
- Measure temperature rise and adjust flow as needed
- Check for correct line and load volts/amps
- Check thermostat operation is per manufacturer's recommendations(if adjustments made, refer to 'Residential Programmable Thermostat' measure for savings estimate)
- Perform Carbon Monoxide test and adjust heating system until results are within standard industry acceptable limits

#### DEFINITION OF BASELINE EQUIPMENT

The baseline is furnace assumed not to have had a tune-up in the past 3 years.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the clean and check tune up is 3 years.<sup>518</sup>

#### DEEMED MEASURE COST

The incremental cost for this measure should be the actual cost of tune up.

#### DEEMED O&M COST ADJUSTMENTS

There are no expected O&M savings associated with this measure.

---

<sup>517</sup> American Standard Maintenance for Indoor Units (see 'HVAC Maintenance American Standard')

<sup>518</sup> Assumed consistent with other tune-up measures.

**LOADSHAPE**

Loadshape R09 - Residential Electric Space Heat

**COINCIDENCE FACTOR**

N/A

**Algorithms**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \Delta Therms * F_e * 29.3$$

Where:

$\Delta Therms$  = as calculated below

$F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption  
 = 3.14%<sup>519</sup>

29.3 = kWh per therm

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta Therms = \frac{(CAP_{InputPre} * EFLH * (1/Eff_{before} - 1/(Eff_{before} + E_i)))}{100,00}$$

Where:

$CAP_{InputPre}$  = Gas Furnace input capacity pre tune-up (Btuh)  
 = Measured input capacity from HVAC SAVE

EFLH = Equivalent Full Load Hours for heating

Climate Zone (City based upon)	EFLH <sup>520</sup>
1 (Rockford)	1022
2 (Chicago)	976
3 (Springfield)	836
4 (Belleville)	645
5 (Marion)	656
Weighted Average <sup>521</sup>	928

<sup>519</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy (Ef in MMBtu/yr) and Eae (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See "Programmable Thermostats Furnace Fan Analysis.xlsx" for reference.

<sup>520</sup> Full load hours for Chicago, are based on findings in "Energy Efficiency / Demand Response Nicor Gas Plan Year 1 (6/1/2011-5/31/2012) Research Report: Furnace Metering Study (August 1, 2013), prepared by Navigant Consulting, Inc. Values for other cities are then calculated by comparing relative HDD at base 60F.

<sup>521</sup> Weighted based on number of occupied residential housing units in each zone.

Effbefore = Efficiency of the furnace before the tune-up  
= Actual

*Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the heating season and take readings at a consistent firing rate for pre and post tune-up.*

EI = Efficiency Improvement of the furnace tune-up measure  
= Actual

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-FTUN-V06-210101**

**REVIEW DEADLINE: 1/1/2025**

### 5.3.14 Boiler Reset Controls

#### DESCRIPTION

This measure relates to improving system efficiency by adding controls to residential heating boilers to vary the boiler entering water temperature relative to heating load as a function of the outdoor air temperature to save energy. The water can be run a little cooler during fall and spring, and a little hotter during the coldest parts of the winter. A boiler reset control has two temperature sensors - one outside the house and one in the boiler water. As the outdoor temperature goes up and down, the control adjusts the water temperature setting to the lowest setting that is meeting the house heating demand. There are also limits in the controls to keep a boiler from operating outside of its safe performance range.<sup>522</sup>

This measure was developed to be applicable to the following program types: RF.

#### DEFINITION OF EFFICIENT EQUIPMENT

Natural gas single family residential customer adding boiler reset controls capable of resetting the boiler supply water temperature in an inverse fashion with outdoor air temperature. The system must be set so that the minimum temperature is not more than 10 degrees above manufacturer's recommended minimum return temperature. This boiler reset measure is limited to existing condensing boilers serving a single family residence. Boiler reset controls for non-condensing boilers in single family residences should be implemented as a custom measure, and the cost-effectiveness should be confirmed.

#### DEFINITION OF BASELINE EQUIPMENT

Existing condensing boiler in a single family residential setting without boiler reset controls.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 16 years, which is assumed to be the remaining life of the existing boiler.<sup>523</sup>

#### DEEMED MEASURE COST

The cost of this measure is \$612.<sup>524</sup>

#### LOADSHAPE

NA

#### COINCIDENCE FACTOR

N/A

---

---

#### Algorithm

---

---

---

<sup>522</sup> Energy Solutions Center, a consortium of natural gas utilities, equipment manufacturers and vendors, See 'Boiler Reset Control – NaturalGasEfficiency.org'.

<sup>523</sup> This is intentionally longer than the assumptions found in the early replacement residential HVAC measures as the application of boiler reset controls will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

<sup>524</sup> Nexant. Questar DSM Market Characterization Report. August 9, 2006.

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

NA

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = \text{Gas\_Boiler\_Load} * (1/\text{AFUE}) * \text{Savings Factor}$$

Where:

Gas\_Boiler\_Load<sup>525</sup>

= Estimate of annual household Load for gas boiler heated single-family homes. If location is unknown, assume the average below.<sup>526</sup>

= or Actual if informed by site-specific load calculations, ACCA Manual J, or equivalent.<sup>527</sup>

Climate Zone (City based upon)	Gas_Boiler Load (therms)
1 (Rockford)	1275
2 (Chicago)	1218
3 (Springfield)	1043
4 (Belleville)	805
5 (Marion)	819
Average	1158

AFUE = Existing Condensing Boiler Annual Fuel Utilization Efficiency Rating

= Actual.

SF = Savings Factor, 5%<sup>528</sup>

<sup>525</sup> Boiler consumption values are informed by an evaluation which did not identify any fraction of heating load due to domestic hot water (DHW) provided by the boiler. Thus these values are an average of both homes with boilers only providing heat, and homes with boilers that also provide DHW. Heating load is used to describe the household heating need, which is equal to (gas heating consumption \* AFUE )

<sup>526</sup> Values are based on household heating consumption values and inferred average AFUE results from Table 3-4, Program Sample Analysis, *Nicor R29 Res Rebate Evaluation Report 092611\_REV FINAL to Nicor*. Adjusting to a statewide average using relative HDD values to adjust for the evaluation results focus on northern region. Values for individual cities are then calculated by comparing average HDD to the individual city’s HDD.

<sup>527</sup> The Air Conditioning Contractors of America Manual J, Residential Load Calculation 8<sup>th</sup> Edition produces equipment sizing loads for Single Family, Multi-single, and Condominiums using input characteristics of the home. A best practice for equipment selection and installation of Heating and Air Conditioning, load calculations should be completed by contractors during the selection process and may be readily available for program data purposes.

<sup>528</sup> Energy Solutions Center, a consortium of natural gas utilities, equipment manufacturers and vendors. See ‘Boiler Reset Control – NaturalGasEfficiency.org’.



**For example**, boiler reset controls on a 92.5 AFUE boiler at a household in Rockford, IL

$$\begin{aligned}\Delta\text{Therms} &= 1275 * (1/0.925) * 0.05 \\ &= 69 \text{ Therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-BREC-V03-210101**

**REVIEW DEADLINE: 1/1/2024**

### 5.3.15 ENERGY STAR Ceiling Fan

#### DESCRIPTION

A ceiling fan/light unit meeting the efficiency specifications of ENERGY STAR version 4.0 is installed in place of a model meeting the federal standard. ENERGY STAR qualified ceiling fan/light combination units are over 60% more efficient than conventional fan/light units and use improved motors and blade designs.

Due to the savings from this measure being derived from more efficient ventilation and more efficient lighting, and the loadshape and measure life for each component being very different, the savings are split into the component parts and should be claimed together. Lighting savings should be estimated utilizing the 5.5.9 LED Fixtures measure.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as an ENERGY STAR certified ceiling fan with integral CFL or LED bulbs. Upon review of the ENERGY STAR Qualified Products List, it was determined that 88% of ceiling fans with integrated light kits leverage LED lamps; with the remaining 12% using CFLs.<sup>529</sup> Concurrently, ENERGY STAR criteria require ceiling fans with light kits to provide the consumer with either CFLs or LEDs. In the cases where light kits require screw-base sockets, the efficient lamps have to be included in the packaging of the ceiling fan.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a standard fan with efficient incandescent or halogen light bulbs. Production of 100W, standard efficacy incandescent lamps ended in 2012 followed by restrictions on 75W in 2013 and 60W and 40W in 2014, due to the Energy Independence and Security Act of 2007 (EISA). Finally, a provision in the EISA regulations requires that by January 1, 2020, all lamps meet efficiency criteria of at least 45 lumens per watt, in essence making the baseline equivalent to a current day CFL. Therefore the measure life (number of years that savings should be claimed) for the lighting portion of the savings should be reduced once the assumed lifetime of the bulb exceeds 2020. Due to expected delay in clearing retail inventory and to account for the operating life of a halogen incandescent potentially spanning over 2020, this shift is assumed not to occur until 2021.

Effective January 21, 2020, all ceiling fan light kits manufactured after this date must be packaged with lamps to fill all screw-base sockets, further limiting the potential for inefficient light bulbs to be utilized. Additionally, ceiling fan light kits with pin-based sockets for fluorescent lamps must use electronic ballasts. Integrated ceiling fan light kits must adhere to the same lighting efficiency requirements.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The fan savings measure life is assumed to be 10 years.<sup>530</sup>

The lighting savings measure life is assumed to be 1 year for lighting savings for units installed in 2020 (see 5.5.9 LED Fixtures measure).<sup>531</sup>

---

<sup>529</sup> ENERGY STAR version 4.0, Product Specification for Residential Ceiling Fans and Ceiling Fan Light Kits, effective June 15, 2018. Qualified Products List data pulled on 10/11/2018.

<sup>530</sup> Lifetime estimate is sourced from the ENERGY STAR Ceiling Fan Savings Calculator.

<sup>531</sup> Since the replacement baseline bulb from 2020 on will be equivalent to a CFL, no additional savings should be claimed from that point. Due to expected delay in clearing stock from retail outlets and to account for the operating life of a halogen incandescent potentially spanning over 2020, this shift is assumed not to occur until 2021.

**DEEMED MEASURE COST**

Incremental cost of a ceiling fan with light kit is \$46.

Incremental cost of only a ceiling fan is \$30.71.<sup>532</sup>

**LOADSHAPE**

R06 - Residential Indoor Lighting

R11 - Residential Ventilation

**COINCIDENCE FACTOR**

The summer peak coincidence factor for the ventilation savings is assumed to be 30%.<sup>533</sup>

For lighting savings, see 5.5.9 LED Fixtures measure.

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \Delta kWh_{fan} + \Delta kWh_{light}$$

$$\Delta kWh_{fan} = [Days * FanHours * ((\%Low_{base} * WattsLow_{base}) + (\%Med_{base} * WattsMed_{base}) + (\%High_{base} * WattsHigh_{base}))/1000] - [Days * FanHours * ((\%Low_{ES} * WattsLow_{ES}) + (\%Med_{ES} * WattsMed_{ES}) + (\%High_{ES} * WattsHigh_{ES}))/1000]$$

$$\Delta kWh_{light} = \text{see 5.5.9 LED Fixtures measure.}$$

Where:<sup>534</sup>

- Days = Days used per year  
= Actual. If unknown use 365.25 days/year
- FanHours = Daily Fan “On Hours”  
= Actual. If unknown use 3 hours
- %Low<sub>base</sub> = Percent of time spent at Low speed of baseline  
= 40%
- WattsLow<sub>base</sub> = Fan wattage at Low speed of baseline  
= Actual. If unknown use 15 watts

---

<sup>532</sup> The incremental cost of \$46 is sourced from the ENERGY STAR Ceiling Fan Savings Calculator, which is based on a ceiling fan and a light kit. In order to determine the incremental cost of only a ceiling fan, the incremental cost of the lights were factored in and removed accordingly. Through review of the ENERGY STAR Qualified Products List, accessed on October 11, 2018, the average ceiling fan LED light kit had 1.2 lamps, with an average wattage of 11.8W. The comparable baseline wattage, baseline cost, and efficient lamp cost is based on a scaled equivalence from the 5.5.9 LED Fixtures measure.

<sup>533</sup> Assuming that the CF same as a Room AC. Consistent with coincidence factors found in: RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

<sup>534</sup> All fan operating conditions and baseline default assumptions are based upon assumptions provided in the ENERGY STAR Ceiling Fan Savings Calculator. The efficient wattages at the low and high speed settings are sourced from the average of available products on the ENERGY STAR Qualified Products List (QPL), as pulled on 10/11/2018. The efficient wattage at the medium speed is interpolated based on the varying speed wattages from the ENERGY STAR version 4.0 specifications. For more information on the QPL data set, please see “Illinois Residential Ceiling Fan Analysis.xlsx”.

- $\%Med_{base}$  = Percent of time spent at Medium speed of baseline  
= 40%
- $WattsMed_{base}$  = Fan wattage at Medium speed of baseline  
= Actual. If unknown use 34 watts
- $\%High_{base}$  = Percent of time spent at High speed of baseline  
= 20%
- $WattsHigh_{base}$  = Fan wattage at High speed of baseline  
= Actual. If unknown use 67 watts
- $\%LowES$  = Percent of time spent at Low speed of ENERGY STAR  
= 40%
- $WattsLowES$  = Fan wattage at Low speed of ENERGY STAR  
= Actual. If unknown use 3 watts
- $\%MedES$  = Percent of time spent at Medium speed of ENERGY STAR  
= 40%
- $WattsMedES$  = Fan wattage at Medium speed of ENERGY STAR  
= Actual. If unknown use 13 watts
- $\%HighES$  = Percent of time spent at High speed of ENERGY STAR  
= 20%
- $WattsHighES$  = Fan wattage at High speed of ENERGY STAR  
= Actual. If unknown use 31 watts

For ease of reference, the fan assumptions are provided below in table form:

	Low Speed	Medium Speed	High Speed
Percent of Time at Given Speed	40%	40%	20%
Conventional Unit Wattage	15	34	67
ENERGY STAR Unit Wattage	3	13	31
$\Delta W$	12	21	36

If the lighting  $WattsBase$  and  $WattsEE$  is unknown, assume the following.<sup>535</sup>

$$WattsBase = 1.2 \times 46.5 = 55.8 \text{ W}$$

$$WattsEE = 1.2 \times 11.8 = 14.2 \text{ W}$$

<sup>535</sup> Through review of the ENERGY STAR Qualified Products List, accessed on October 11, 2018, the average ceiling fan LED light kit had 1.2 lamps, with an average wattage of 11.8W. The comparable baseline is based on a scaled equivalent wattage from the 5.5.9 LED Fixtures measure.

**For example**, an ENERGY STAR ceiling fan with one, 22.4W LED lamp as part of its light kit were purchased and installed to replace an existing ceiling fan that was no longer operational, the savings are:

$$\begin{aligned} \Delta kWh_{fan} &= [365.25 * 3 * ((0.4 * 15) + (0.4 * 34) + (0.2 * 67)) / 1000] - \\ & \quad [365.25 * 3 * ((0.4 * 3) + (0.4 * 13) + (0.2 * 3)) / 1000] \\ &= 36.2 - 13.8 = 22.4 \text{ kWh} \\ \Delta kWh_{light} &= ((88.5 - 22.4) / 1000) * 759 * 1.06 \\ &= 53.2 \text{ kWh} \\ \Delta kWh &= 22.4 + 53.2 = 75.6 \text{ kWh} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\begin{aligned} \Delta kW &= \Delta kW_{Fan} + \Delta kW_{light} \\ \Delta kW_{Fan} &= ((WattsHigh_{base} - WattsHigh_{ES}) / 1000) * CF_{fan} \\ \Delta kW_{Light} &= \text{see 5.5.9 LED Fixtures measure.} \end{aligned}$$

Where:

$$\begin{aligned} CF_{fan} &= \text{Summer Peak coincidence factor for ventilation savings} \\ &= 30\%^{536} \\ CF_{light} &= \text{Summer Peak coincidence factor for lighting savings} \\ &= 7.1\%^{537} \end{aligned}$$

**For example**, an ENERGY STAR ceiling fan with one 22.4W LED lamp as part of its light kit were purchased and installed to replace an existing ceiling fan that was no longer operational, the savings are:

$$\begin{aligned} \Delta kW_{fan} &= ((67 - 31) / 1000) * 0.3 \\ &= 0.0108 \text{ kW} \\ \Delta kW_{light} &= ((88.5 - 22.4) / 1000) * 1.11 * 0.071 \\ &= 0.0052 \text{ kW} \\ \Delta kW &= 0.0108 + 0.0052 \\ &= 0.016 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

See 5.5.9 LED Fixtures measure for bulb replacement costs.

<sup>536</sup> Assuming that the CF same as a Room AC. Consistent with coincidence factors found in: RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

<sup>537</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation.

**MEASURE CODE: RS-HVC-CFAN-V03-210101**

**REVIEW DEADLINE: 1/1/2023**

## 5.3.16 Advanced Thermostats

### DESCRIPTION

This measure characterizes the household energy savings from the installation of a new thermostat(s) for reduced heating and cooling consumption through a configurable schedule of temperature setpoints (like a programmable thermostat) *and* automatic variations to that schedule to better match HVAC system runtimes to meet occupant comfort needs. These schedules may be defaults, established through user interaction, and be changed manually at the device or remotely through a web or mobile app. Automatic variations to that schedule could be driven by local sensors and software algorithms, and/or through connectivity to an internet software service. Data triggers to automatic schedule changes might include, for example: occupancy/activity detection, arrival & departure of conditioned spaces, optimization based on historical or population-specific trends, weather data and forecasts.<sup>538</sup> This class of products and services are relatively new, diverse, and rapidly changing. Generally, the savings expected for this measure aren't yet established at the level of individual features, but rather at the system level and how it performs overall. Like programmable thermostats, it is not suitable to assume that heating and cooling savings follow a similar pattern of usage and savings opportunity, and so here too this measure treats these savings independently. Note that this is an active area of ongoing work to better map features to savings value, and establish standards of performance measurement based on field data so that a standard of efficiency can be developed.<sup>539</sup> Since energy savings are applicable at the household level, savings should only be claimed for one thermostat of any type (i.e., one programmable thermostat or one advanced thermostat), and installation of multiple thermostats per home does not accrue additional savings.

Note that though these devices and service could potentially be used as part of a demand response program, the costs, delivery, impacts, and other aspects of DR-specific program delivery are not included in this characterization at this time, though they could be added in the future.

This measure was developed to be applicable to the following program types: TOS, NC, RF, DI.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The criteria for this measure are established by replacement of a manual-only or programmable thermostat, with one that has the default enabled capability—or the capability to automatically—establish a schedule of temperature setpoints according to driving device inputs above and beyond basic time and temperature data of conventional programmable thermostats. As summarized in the description, this category of products and services is broad and rapidly advancing in regard to their capability, usability, and sophistication, but at a minimum must be capable of two-way communication<sup>540</sup> and exceed the typical performance of manual and conventional programmable thermostats through the automatic or default capabilities described above.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is either the actual type (manual or programmable) if it is known,<sup>541</sup> or an assumed mix of these two

---

<sup>538</sup> For example, the capabilities of products and added services that use ultrasound, infrared, or geofencing sensor systems, automatically develop individual models of home's thermal properties through user interaction, and optimize system operation based on equipment type and performance traits based on weather forecasts demonstrate the type of automatic schedule change functionality that apply to this measure characterization.

<sup>539</sup> The ENERGY STAR program released version 1.0 of its Connected Thermostats Specification in 2017. Details and active discussion can be found on ENERGY STAR website; 'Connected Thermostats Specifications v1.0'.

<sup>540</sup> This measure recognizes that field data may be available, through this 2-way communication capability, to better inform characterization of efficiency criteria and savings calculations. It is recommended that program implementations incorporate this data into their planning and operation activities to improve understanding of the measure to manage risks and enhance savings results.

<sup>541</sup> If the actual thermostat is programmable and it is found to be used in override mode or otherwise effectively being operated

types based upon information available from evaluations or surveys that represent the population of program participants. This mix may vary by program, but as a default, 51% programmed programmable and 49% manual or non-programmed programmable thermostats may be assumed.<sup>542</sup>

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life for advanced thermostats is assumed to be 11 years.<sup>543</sup>

**DEEMED MEASURE COST**

For DI and other programs for which installation services are provided, the actual material, labor, and other costs should be used. For retail, Bring Your Own Thermostat (BYOT) programs,<sup>544</sup> or other program types, actual costs are still preferable,<sup>545</sup> but if unknown, then the average incremental cost for the new installation measure is assumed to be \$125.<sup>546</sup>

**LOADSHAPE**

- $\Delta kWh$  → Loadshape R10 - Residential Electric Heating and Cooling
- $\Delta kWh_{heating}$  → Loadshape R09 - Residential Electric Space Heat
- $\Delta kWh_{cooling}$  → Loadshape R08 - Residential Cooling

**COINCIDENCE FACTOR**

In the absence of conclusive results from empirical studies on peak savings, the TAC agreed to a temporary assumption of 50% of the cooling coincidence factor, acknowledging that while the savings from the advanced Thermostat will track with the cooling load, the impact during peak periods may be lower. This is an assumption that could use future evaluation to improve these estimates.

- $CF_{SSP}$  = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 34%<sup>547</sup>
- $CF_{PJM}$  = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 23.3%<sup>548</sup>

---

like a manual thermostat, then the baseline may be considered to be a manual thermostat

<sup>542</sup> Based on Opinion Dynamics Corporation, “ComEd Residential Saturation/End Use, Market Penetration & Behavioral Study”, Appendix 3: Detailed Mail Survey Results, p34, April 2013.

<sup>543</sup> Based on 2017 Residential Smart Thermostat Workpaper, prepared by SCE and Nest for SCE (Work Paper SCE17HC054, Revision #0). Estimate ability of smart systems to continue providing savings after disconnection and conduct statistical survival analysis which yields 9.2-13.8 year range.

<sup>544</sup> In contrast to program designs that utilize program affiliated contractors or other trade ally partners that support customer participation through thermostat distribution, installation and other services , BYOT programs enroll customers *after* the time of purchase through online rebate and program integration sign-ups.

<sup>545</sup> Including any one-time software integration or annual software maintenance, and or individual device energy feature fees.

<sup>546</sup> Market prices vary considerably in this category, generally increasing with thermostat capability and sophistication. The core suite of functions required by this measure's eligibility criteria are available on units readily available in the market roughly in the range of \$150 and \$250, excluding the availability of time or market-limited wholesale or volume pricing. The assumed incremental cost is based on the middle of this range (\$175) minus a cost of \$50 for the baseline equipment blend of manual and programmable thermostats. Note that any add-on energy service costs, which may include one-time setup and/or annual per device costs are not included in this assumption.

<sup>547</sup> Assumes 50% of the cooling coincidence factor (based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory).

<sup>548</sup> Assumes 50% of the cooling coincidence factor (based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.)



**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh^{549} = \Delta kWh_{heating} + \Delta kWh_{cooling}$$

$$\Delta kWh_{heating} = \%ElectricHeat * Elec\_Heating\_Consumption * Heating\_Reduction * HF * Eff\_ISR + (\Delta Therms * F_e * 29.3)$$

$$\Delta kWh_{cool} = \%AC * ((FLH * Capacity * 1/SEER)/1000) * Cooling\_Reduction * Eff\_ISR$$

Where:

**%ElectricHeat** = Percentage of heating savings assumed to be electric

Heating fuel	%ElectricHeat
Electric	100%
Natural Gas	0%
Unknown	3% <sup>550</sup>

**Elec\_Heating\_Consumption**

= Estimate of annual household heating consumption for electrically heated homes.<sup>551</sup> If location and heating type is unknown, assume 15,683 kWh.<sup>552</sup>

Climate Zone (City based upon)	Electric Resistance Elec_Heating_ Consumption (kWh)	Electric Heat Pump Elec_Heating_ Consumption (kWh)
1 (Rockford)	21,748	12,793
2 (Chicago)	20,778	12,222
3 (Springfield)	17,794	10,467
4 (Belleville)	13,726	8,074
5 (Marion)	13,970	8,218
Average	19,749	11,617

**Heating\_Reduction** = Assumed percentage reduction in total household heating energy consumption due to advanced thermostat including accounting for Thermostat

<sup>549</sup> Electrical savings are a function of both heating and cooling energy usage reductions. For heating this is a function of the percent of electric heat (heat pumps) and fan savings in the case of a natural gas furnace.

<sup>550</sup> Value used is based on known PY8 percent of electric heat provided by Navigant as part of the ongoing evaluation work source: "Slide 21: May 22, 2018, Second Addendum IL TRM Advanced Thermostat Cooling Savings Evaluation"

<sup>551</sup> Values in table are based on converting an average household heating load (834 therms) for Chicago based on 'Table E-1, Energy Efficiency/Demand Response Nicor Gas Plan Year 1: Research Report: Furnace Metering Study, Draft, Navigant, August 1 2013 to an electric heat load (divide by 0.03412) to electric resistance and ASHP heat load (resistance load reduced by 15% to account for distribution losses that occur in furnace heating but not in electric resistance while ASHP heat is assumed to suffer from similar distribution losses) and then to electric consumption assuming efficiencies of 100% for resistance and 200% for HP (see 'Household Heating Load Summary Calculations\_08222018.xls'). Finally these values were adjusted to a statewide average using relative HDD assumptions to adjust for the evaluation results focus on northern region. Values for individual cities are then calculated by comparing average HDD to the individual city's HDD.

<sup>552</sup> Assumption that 1/2 of electrically heated homes have electric resistance and 1/2 have Heat Pump, based on 2010 Residential Energy Consumption Survey for Illinois.

Optimization services<sup>553</sup>

Existing Thermostat Type	Heating Reduction <sup>554</sup>
Manual	10.4%
Programmable	7.3%
Unknown (Blended)	8.6%

HF = Household factor, to adjust heating consumption for non-single-family households.

Household Type	HF
Single-Family	100%
Mobile home	83% <sup>555</sup>
Multifamily	65% <sup>556</sup>
Actual	Custom <sup>557</sup>
Unknown	96.5% <sup>558</sup>

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

Eff\_ISR = Effective In-Service Rate, the percentage of thermostats installed and configured effectively for 2-way communication. Note that retrospective adjustments should be made during evaluation verification activities through the use of a realization rate if the program design does not ensure that each advanced thermostat is actually installed and/or if the evaluation determines that the advanced thermostat is not actually installed in the Program Administrator’s service territory.

Program Delivery	Eff_ISR
Direct Install	100%
Other programs where not evaluated	90% <sup>559</sup>

<sup>553</sup> This estimate is based on a consumption data analysis with matching to non-participants and is therefore net with respect to participant spillover and between net and gross with respect to free ridership. Like all consumption data analyses, it is gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to these factors will be determined as part of the annual SAG net-to-gross process.

<sup>554</sup> These values represent adjusted baseline savings values (8.8% for manual, and 5.6% for programmable thermostats) as presented in Navigant’s PowerPoint on Impact Analysis from Preliminary Gas savings findings (slide 28 of ‘IL SAG Smart Thermostat Preliminary Gas Impact Findings 2015-12-08 to IL SAG.ppt’). These values are adjusted upwards in v9 to account for inclusion of Thermostat Optimization savings in an estimated 45% of future participants (based on reported share of Nest and ecobee participants and 2020 rates of Thermostat Optimization). The basis for the Thermostat Optimization savings is Navigant “ComEd CY2018 Seasonal Savings Heating Season Impact Evaluation Report”, March 2019.

These values are used as the basis for the weighted average savings value when the type of existing thermostat is not known. Using weightings updated from PY8 data, based upon baseline type, and allocating programmability into manual and programmable based upon programmed status yields a weighted new blend of 43% manual (or non-programmed programmable) and 57% programmed. Further evaluation and regular review of this key assumption is encouraged.

<sup>555</sup> Since mobile homes are similar to Multifamily homes with respect to conditioned floor area but to single-family homes with respect to exposure (i.e., all four wall orientations are adjacent to the outside), this factor is estimated as an average of the single family and multifamily household factors.

<sup>556</sup> Multifamily household heating consumption relative to single-family households is affected by overall household square footage and exposure to the exterior. This 65% reduction factor is applied to MF homes, based on professional judgment that average household size, and heat loads of MF households are smaller than single-family homes

<sup>557</sup> Program-specific household factors may be utilized on the basis of sufficiently validated program evaluations.

<sup>558</sup> When Household type is unknown, a value of 96.5% may be used as a weighted average of 90% SF and 10% MF (96.5% = 100%\*90% + 65%\*10%) based on a Navigant evaluation of PY8 participants in ComEd’s advanced thermostat program.

<sup>559</sup> The 2020 Guidehouse evaluation indicated that 6.75% of participants installed the advanced thermostat out of state. An additional reduction is applied to account for purchases that are never installed. Based on the available data this is estimated as an additional 3.75%.

- $\Delta$ Therms = Therm savings if Natural Gas heating system  
= See calculation in Natural Gas section below
- $F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption  
= 3.14%<sup>560</sup>
- 29.3 = kWh per therm
- %AC = Fraction of customers with thermostat-controlled air-conditioning

Thermostat control of air conditioning?	%AC <sup>561</sup>
Yes	100%
No	0%
Unknown (AC-targeted program)	99%
Unknown (general program)	82.5%

- FLH = Estimate of annual household full load cooling hours for air conditioning equipment based on location and home type. If climate zone is unknown, assume the weighted average for the relevant home type. If both climate zone and home type are unknown, assume 623 hours.<sup>562</sup>

Climate zone (city based upon)	FLH (single family) <sup>563</sup>	FLH (general multifamily) <sup>564</sup>	FLH_cooling (weatherized multifamily) <sup>565</sup>
1 (Rockford)	512	467	243
2 (Chicago)	570	506	263
3 (Springfield)	730	663	345
4 (Belleville)	1035	940	489
5 (Marion)	903	820	426
Weighted average <sup>566</sup>	629	564	293

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

<sup>560</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBTU/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

<sup>561</sup> 99% of ComEd PY8 program participants (AC targeted programs) have Central AC per communication with Navigant’s ongoing 2017/2018 cooling savings evaluation. Non-targeted programs are still expected to have participation with %AC above general population rates. 82.5% is an average of the 99% program participation rate, and the 66% of homes in Illinois having central cooling (“Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration”, 2009 Residential Energy Consumption Survey ;

<sup>562</sup> When both climate zone and home type are unknown, a value of 623 hours may be used as a weighted average of 90% SF and 10% MF (623 = 629\*90% + 564\*10%) based on a Navigant evaluation of PY8 participants in ComEd’s advanced thermostat program.

<sup>563</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCDC) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>564</sup> Ibid.

<sup>565</sup> All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015

<sup>566</sup> Weighted based on number of residential occupied housing units in each zone.

- Capacity = Size of AC unit.<sup>567</sup> (Note: One refrigeration ton is equal to 12,000 Btu/hr)  
 = Use actual when program delivery allows size of AC unit to be known. If unknown assume 33,600 Btu/hr for single family homes, 28,000 Btu/hr for multifamily or 24,000 Btu/hr for mobile homes.<sup>568</sup> If building type is unknown, assume 33,040 Btu/hr.<sup>569</sup>
- SEER = the cooling equipment’s Seasonal Energy Efficiency Ratio rating (kBtu/kWh)  
 = Use actual SEER rating where it is possible to measure or reasonably estimate.

Cooling System	SEER <sup>570</sup>
Air Source Heat Pump	12
Central AC	

- 1/1000 = kBtu per Btu
- Cooling\_Reduction = Assumed average percentage reduction in total household cooling energy consumption due to installation of advanced thermostat including accounting for Thermostat Optimization:<sup>571</sup>  
 = 8.4%<sup>572</sup>

<sup>567</sup> Actual unit size required for Multifamily building, no size assumption provided because the unit size and resulting savings can vary greatly depending on the number of units.

<sup>568</sup> Single family cooling capacity based on Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), October 19, 2010, ComEd, Navigant Consulting. Multifamily capacity based on weighted average of PY9 Ameren and ComEd MF cooling capacities. Mobile home capacity based on ENERGY STAR’s Manufactured Home Cooling Equipment Sizing Guidelines which vary by climate zone and home size. The average size of a mobile home in the East North Central region (1,120 square feet) from the 2015 RECS data is used to calculate appropriate size.

<sup>569</sup> Unknown is based on statewide weighted average of 90% single family and 10% multifamily, based on a Navigant evaluation of PY8 participants in ComEd’s advanced thermostat program.

<sup>570</sup> Estimate based upon Navigant, 2018 “EIA – Technology Forecast Updates – Residential and Commercial Building Technologies – Reference Case”

<sup>571</sup> Note that “Cooling\_Reduction” percentage is the savings expected from reduced cooling use, and is not the same as % cooling savings that are based on total kWh saved (including fan and heating kWh savings) as a percent of total kWh used for cooling.

<sup>572</sup> The Cooling\_Reduction assumption is based on a TAC agreement to weight the consumption data analysis result (econometric) and the adjusted ENERGY STAR method for estimating runtime savings for advanced thermostats with stakeholder assumptions about baseline behavior (ENERGY STAR), provided by Guidehouse in 2020. The econometric result (7.8%) is weighted at 90%, and the ENERGY STAR result (10-14% range taken as reasonable by stakeholders, however 14% is used to account for increased Thermostat Optimization) weighted at 10%.

This econometric value is based upon the non-weather normalized savings percentage, adjusted for selection bias, %AC and ISR, with additional adjustment to account for the anticipated growth in Thermostat Optimization savings, from 12% of participants in the study to 45% of future participants (based on reported share of Nest and ecobee participants and 2020 rates of Thermostat Optimization). The basis for the Thermostat Optimization savings is Navigant’s “ComEd CY2018 Seasonal Savings Cooling Season Impact Evaluation Report”, March 2019. The estimate of cooling reduction factor includes an adjustment for apparent selection bias, per stakeholder request as part of a 2020 study by Guidehouse involving a consumption analysis of ComEd advanced thermostat rebate recipients. Guidehouse acknowledges that this adjustment is a coarse method of addressing potential bias, but believes that this adjustment may not be accurate or applicable for future studies of this type.

The adjusted ENERGY STAR analysis is gross with respect to all components of net-to-gross (free ridership, and participant and non-participant spillover). The econometric analysis uses matching to future participants and is therefore gross with respect to free ridership. Like all consumption data analyses, it is net with respect to participant spillover and gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to these factors will be determined as part of the annual SAG net-to-gross process.

**For example**, an advanced thermostat replacing a programmable thermostat directly installed in an electric heat pump heated, single-family home in Springfield with advanced thermostat-controlled air conditioning of a system of unknown size and seasonal efficiency rating:

$$\begin{aligned} \Delta kWh &= \Delta kWh_{\text{heating}} + \Delta kWh_{\text{cooling}} \\ &= 1 * 10,464 * 7.3\% * 100\% * 100\% + (0 * 0.0314 * 29.3) + 100\% * ((730 * 33,600 * (1/12))/1000) \\ &\quad * 8.4\% * 100\% \\ &= 764kWh + 172 kWh \\ &= 936 kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \%AC * (\text{Cooling\_DemandReduction} * \text{Btu/hr} * (1/\text{EER})/1000) * \text{EFF\_ISR} * \text{CF}$$

Where:

Cooling\_DemandReduction = Assumed average percentage reduction in total household cooling demand due to installation of advanced thermostat including accounting for Thermostat Optimization services  
 = 16.4%<sup>573</sup>

EER = Energy Efficiency Ratio of existing cooling system (kBtu/hr / kW)  
 = Use actual EER rating where it is possible to measure or reasonably estimate. If EER unknown but SEER available convert using the equation:

$$\text{EER} = (-0.02 * \text{SEER\_exist}^2) + (1.12 * \text{SEER\_exist})^{574}$$

If SEER or EER rating unavailable, use:

Cooling System	EER <sup>575</sup>
Air Source Heat Pump	10.5
Central AC	

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
 = 34%<sup>576</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 23.3%<sup>577</sup>

<sup>573</sup> The current Cooling\_DemandReduction assumption is based on results presented on August 4th, 2020 from a Guidehouse econometric analysis and further refinements discussed throughout August.

The final value is based upon the non-weather normalized savings percentage, adjusted for selection bias, %AC and ISR, provided by the Guidehouse econometric results, and includes an additional adjustment to account for the anticipated growth in Thermostat Optimization savings. The estimate of cooling reduction factor includes an adjustment for apparent selection bias, per stakeholder request as part of a 2020 study by Guidehouse involving a consumption analysis of ComEd advanced thermostat rebate recipients. Guidehouse acknowledges that this adjustment is a coarse method of addressing potential bias, but believes that this adjustment may not be accurate or applicable for future studies of this type.

<sup>574</sup> From Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder.

<sup>575</sup> Based on converting SEER assumption to EER.

<sup>576</sup> Assumes 50% of the cooling coincidence factor (based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.)

<sup>577</sup> Assumes 50% of the cooling coincidence factor (based on analysis of Itron eShape data for Missouri, calibrated to Illinois)

**For example**, an advanced thermostat replacing a programmable thermostat directly installed in an electric resistance heated, single-family home in Springfield with advanced thermostat-controlled air conditioning of a system of unknown size and seasonal efficiency rating:

$$\begin{aligned} \Delta kW_{SSP} &= 100\% * (16.4\% * 33,600 * (1/10.5)/1000) * 100\% * 34\% \\ &= 0.1784 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} &= 100\% * (16.4\% * 33,600 * (1/10.5)/1000) * 100\% * 23.3\% \\ &= 0.1223 \text{ kW} \end{aligned}$$

**NATURAL GAS ENERGY SAVINGS**

$$\Delta \text{Therms} = \% \text{FossilHeat} * \text{Gas\_Heating\_Consumption} * \text{Heating\_Reduction} * \text{HF} * \text{Eff\_ISR}$$

Where:

$\% \text{FossilHeat}$  = Percentage of heating savings assumed to be Natural Gas

Heating fuel	$\% \text{FossilHeat}$
Electric	0%
Natural Gas	100%
Unknown	97% <sup>578</sup>

$\text{Gas\_Heating\_Consumption}$

= Estimate of annual household heating consumption for gas heated single-family homes. If location is unknown, assume the average below.<sup>579</sup>

Climate Zone (City based upon)	Gas_Heating_Consumption (therms)
1 (Rockford)	1,052
2 (Chicago)	1,005
3 (Springfield)	861
4 (Belleville)	664
5 (Marion)	676
Average	955

Other variables as provided above.

loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.)

<sup>578</sup> Value used is based on known PY8 percent of electric heat provided by Navigant as part of the ongoing evaluation work source: "Slide 21: May 22, 2018, Second Addendum IL TRM Advanced Thermostat Cooling Savings Evaluation"

<sup>579</sup> Values are based on adjusting the average household heating consumption (849 therms) for Chicago based on 'Table 3-4, Program Sample Analysis, Nicor R29 Res Rebate Evaluation Report 092611\_REV FINAL to Nicor', calculating inferred heating load by dividing by average efficiency of new in program units in the study (94.4%) and then applying standard assumption of existing unit efficiency of 83% (estimate based on 24% of furnaces purchased in Illinois were condensing in 2000 (based on data from GAMA, provided to Department of Energy), assuming typical efficiencies:  $(0.24 * 0.92) + (0.76 * 0.8) = 0.83$ ). This Chicago value was then adjusted to a statewide average using relative HDD assumptions to adjust for the evaluation results focus on northern region. Values for individual cities are then calculated by comparing average HDD to the individual city's HDD.

**For example**, an advanced thermostat replacing a programmable thermostat directly-installed in a gas heated single-family home in Chicago:

$$\begin{aligned}\Delta\text{Therms} &= 1.0 * 1005 * 7.3\% * 100\% * 100\% \\ &= 73.4 \text{ therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-ADTH-V05-210101**

**REVIEW DEADLINE: 1/1/2022**

## 5.3.17 Gas High Efficiency Combination Boiler

### DESCRIPTION

Space heating boilers are pressure vessels that transfer heat to water for use in space heating. Boilers either heat water using a heat exchanger that works like an instantaneous water heater or by adding/connecting a separate tank with an internal heat exchanger to the boiler. A combination boiler contains a separate heat exchanger that heats water for domestic hot water use. Qualifying combination boilers must be whole-house units used for both space heating and domestic water heating with one appliance and energy source. Only participants who have a natural gas account with a participating natural gas utility are eligible for this rebate.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a condensing combination boiler unit with boiler AFUE of 90% or greater. The combination boiler must have a sealed combustion unit and be capable of modulating the firing rate and must be accompanied by a programmed outdoor reset control.<sup>580</sup> Measures that do not qualify for this incentive include boilers with a storage tank and redundant or backup boilers.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a boiler with the federal minimum of 82% AFUE and a residential, natural gas-fueled, 0.5803 UEF storage water heater.

On January 15, 2021, the federal minimum residential boiler efficiency is scheduled to increase to 84% AFUE. However, these new appliance standards will not be adopted by this measure characterization until January 1, 2022.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 21.5 years.<sup>581</sup>

### DEEMED MEASURE COST

The incremental measure cost is assumed to be \$3,522.<sup>582</sup>

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

<sup>580</sup> In a 2015 study, the Cadmus Group team conducted an analysis of optimal outdoor reset curves and discovered that “a boiler in Massachusetts with well-programmed outdoor reset controls could see an operating efficiency improvement of up to 3 to 4 percentage points from the average efficiency of 88.4% observed”.

<sup>581</sup> US Department of Energy, Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Residential Furnaces.” February 10, 2015. Table 8.2.1, p. 8-23. The document’s definition of furnaces includes hot water boilers with firing rates of less than 300,000 Btu/h.

<sup>582</sup> Northeast Energy Efficiency Partnerships. Incremental Cost Study Report. September 23, 2011. Incremental measure cost of \$2,791.00 for a combination boiler and \$2,461.00 for a high efficiency boiler sized at 110 Mbt. The percentage increase is applied to the current boiler incremental cost to provide a combination boiler cost of \$3,521.72.



**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = \Delta\text{Therm}_{\text{Boiler}} + \Delta\text{Therm}_{\text{WH}}$$

$$\Delta\text{Therms}_{\text{Boiler}} = (\text{EFLH} * \text{CAP}_{\text{Input}} * (\text{AFUE}_{\text{Eff}} / \text{AFUE}_{\text{Base}} - 1)) / 100,000$$

$$\Delta\text{Therms}_{\text{WH}} = (1/\text{UEF}_{\text{Base}} - 1/\text{UEF}_{\text{Eff}}) * (\text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 100,000$$

Where:

$\text{CAP}_{\text{Input}}$  = Gas Furnace input capacity (Btuh)

= Actual

EFLH = Equivalent Full Load Hours for gas heating

Climate Zone (City based upon)	EFLH <sup>583</sup>
1 (Rockford)	1022
2 (Chicago)	976
3 (Springfield)	836
4 (Belleville)	645
5 (Marion)	656
Weighted Average <sup>584</sup>	928

$\text{AFUE}_{\text{Exist}}$  = Existing boiler annual fuel utilization efficiency rating

= Use actual AFUE rating where it is possible to measure or reasonably estimate.

If unknown, assume 61.6 AFUE%.<sup>585</sup>

$\text{AFUE}_{\text{Base}}$  = Baseline boiler annual fuel utilization efficiency rating

= 82%

$\text{AFUE}_{\text{Eff}}$  = Efficient boiler annual fuel utilization efficiency rating

= Actual. If unknown, use defaults dependent on tier as listed below.<sup>586</sup>

<sup>583</sup> Full load hours for Chicago, are based on findings in ‘Energy Efficiency / Demand Response Nicor Gas Plan Year 1 (6/1/2011-5/31/2012) Research Report: Furnace Metering Study (August 1, 2013), prepared by Navigant Consulting, Inc. Values for other cities are then calculated by comparing relative HDD at base 60F.

<sup>584</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>585</sup> Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

<sup>586</sup> Default values per tier selected based upon the average AFUE value for the tier range except for the top tier where the minimum is used due to proximity to the maximum possible.

Measure Type	AFUE <sub>Eff</sub>
AFUE ≥ 90%	92.5%
AFUE ≥ 95%	95%

**UEF<sub>Base</sub>** = Uniform Energy Factor rating for baseline equipment  
 = For ≤55 gallons:  $0.6483 - (0.0017 * \text{storage capacity in gallons})$   
 = For >55 gallons:  $0.7897 - (0.0004 \times \text{storage capacity in gallons})$   
 = If tank size unknown for SF assume 40 gallons and UEF<sub>Base</sub> of 0.58  
 = If tank size unknown for MF assume 30 gallons and UEF<sub>Base</sub> of 0.54  
 Use Multifamily if: Building meets utility’s definition for multifamily

**UEF<sub>Eff</sub>** = Uniform Energy Factor rating for efficient combination boiler. This is assumed consistent with a condensing instantaneous gas-fired water heater.  
 = 0.933<sup>587</sup>

**GPD** = Gallons per day of hot water use per person  
 = 45.5 gallons hot water per day per household/2.59 people per household<sup>588</sup>  
 = 17.6

**Household** = Average number of people per household

Household Unit Type	Household
Single-Family - Deemed	2.56 <sup>589</sup>
Multifamily - Deemed	2.1 <sup>590</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>591</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

365.25 = Days per year, on average

**V<sub>Water</sub>** = Specific weight of water  
 = 8.33 pounds per gallon

**T<sub>OUT</sub>** = Tank temperature  
 = 125°F

**T<sub>IN</sub>** = Incoming water temperature from well or municipal system  
 = 54°F<sup>592</sup>

<sup>587</sup> Average Uniform Energy Factor from DOE CCMS of condensing instantaneous gas-fired water heaters. The water heater portion of a gas high efficiency combination boiler is essentially a tankless water heater.

<sup>588</sup> Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

<sup>589</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report.  $2.75 * 93\%$  evaluation adjustment

<sup>590</sup> Navigant, ComEd PY3 Multifamily Home Energy Savings Program Evaluation Report Final, May 16, 2012.

<sup>591</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>592</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

1.0 = Heat capacity of water (1 Btu/lb\*°F)

**For example**, a Rockford single-family home installing an 80,000 Btuh condensing combination boiler unit with boiler AFUE of 95%:

$$\begin{aligned} \Delta\text{Therms}_{\text{Boiler}} &= (1022 * 80,000 * (0.95/0.82 - 1))/100,000 \\ \Delta\text{Therms}_{\text{SWH}} &= (1/0.5803 - 1/0.933) * (17.6 * 2.56 * 365.25 * 8.33 * (125-54) * 1.0 )/100,000 \\ \Delta\text{Therms} &= 129.6 + 63.4 \\ &= 193.0 \text{ Therms} \end{aligned}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-COMB-V02-210101**

**REVIEW DEADLINE: 1/1/2023**

### 5.3.18 Furnace Filter Alarm – Provisional Measure

Measure has been removed in v9.0 due to evaluation results showing filter alarms being ineffectual at indicating a dirty filter.

## 5.3.19 Thermostatic Radiator Valves – Provisional Measure

### DESCRIPTION

Thermostatic Radiator Valves (TRVs) are installed on hydronic or steam radiators to provide temperature control within a room or space. The TRV is a self-regulating valve requiring no auxiliary power, allowing the user to set the temperature to their preferred set point. On hydronic and two-pipe steam systems, as the room temperature rises the valve head expands, blocking the flow of hot water or steam into the radiator. On a one-pipe steam system the TRVs are installed on the air vent and limit the amount of air escaping the radiator, which in turn limits the amount of steam filling the radiator.

The current measure is limited to retrofit application in Multifamily buildings. TRVs are particularly effective in large multifamily buildings where some rooms tend to be overheated resulting in tenants leaving windows open even in winter.

From limited evaluation results, savings appear to be dependent on being part of a whole system commissioning and balancing project.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the TRV is installed on an existing hydronic or steam heated radiator in a multifamily building.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is an existing hydronic or steam heated radiator without a TRV installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of a TRV is estimated as 15 years.<sup>593</sup>

### DEEMED MEASURE COST

The actual cost per TRV should be used. If unknown assume a measure cost of \$200 for steam systems and \$250 for hot water per TRV.<sup>594</sup> If the heating system is required to be drained, the full cost should be used and split between all TRVs installed.

### LOADSHAPE

N/A

### COINCIDENCE FACTOR

N/A

---

<sup>593</sup> Estimate based on assumption used in Department of Energy, Dentz et al, “Thermostatic Radiator Valve Evaluation”, January 2015.

<sup>594</sup> Department of Energy, Dentz et al, “Thermostatic Radiator Valve Evaluation”, January 2015, Table 2, Page 7.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

$$\Delta\text{Therms} = \text{Gas\_Heating\_Load} / (\mu\text{Boiler} * \#\text{Radiators}) * \%TRV\text{Savings}$$

Where:

$\Delta\text{Therms}$  = Therm savings per TRV installed

$\text{Gas\_Heating\_Load}$  = Estimated Gas heating Load per multi family unit.<sup>595</sup>

Climate Zone (City based upon)	Gas_Heating_Load per Multi family unit (therms)
1 (Rockford)	567
2 (Chicago)	542
3 (Springfield)	464
4 (Belleville)	358
5 (Marion)	365
Average	<b>515</b>

$\mu\text{Boiler}$  = AFUE Efficiency of the boiler system

= Actual. If unknown assume 75%

$\#\text{Radiators}$  = Number of radiators in the multifamily unit.

= Actual. If unknown estimated as five.

$\%TRV\text{Savings}$  = Estimate of heating consumption savings from installing a TRV<sup>596</sup>

= 15% when part of a system balancing project to address overheated spaces

= 5% if installed without system balancing

<sup>595</sup> This assumption is based on the Single Family Gas Heating Consumption for boiler values provided in 5.3.14 Boiler Reset Controls (based on Table 3-4, Program Sample Analysis, *Nicor R29 Res Rebate Evaluation Report 092611\_REV FINAL to Nicor*) multiplied by a 65% adjustment factor, which is used to account for the expected lower multifamily heating consumption relative to single-family households due to overall household square footage and exposure to the exterior.

<sup>596</sup> Based on literature review of a limited number of studies available including:

Department of Energy, Dentz et al, "Thermostatic Radiator Valve Evaluation", January 2015.

NYSERDA "Thermostatic Radiator Valve Demonstration Project", 1995.

Lublin University of Technology Cholewa et al "Actual energy savings from the use of thermostatic radiator valves in residential buildings – Long term field evaluation", July 2017.

**For example**, a TRV is installed on three of five radiators in a multifamily unit with a central 75% AFUE hydronic boiler, as part of a system balancing project in Chicago.

$$\begin{aligned}\Delta\text{Therms per TRV} &= \text{Gas\_Heating\_Load} / (\mu\text{Boiler} * \#\text{Radiators}) * \%TRV\text{Savings} \\ &= 542 / (0.75 * 5) * 0.15 \\ &= 21.7 \text{ Therms}\end{aligned}$$

Total of  $21.7 * 3 = 65.1$  Therms for the multi family unit

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HVC-TRVS-V01-210101**

**REVIEW DEADLINE: 1/1/2022**

## 5.4 Hot Water End Use

### 5.4.1 Domestic Hot Water Pipe Insulation

#### DESCRIPTION

This measure describes adding insulation to un-insulated domestic hot water pipes. The measure assumes the pipe wrap is installed to the first length of both the hot and cold pipe up to the first elbow. This is the most cost effective section to insulate since the water pipes act as an extension of the hot water tank up to the first elbow which acts as a heat trap. Insulating this length therefore helps reduce standby losses. Default savings are provided per 3ft length and are appropriate up to 6ft of the hot water pipe and 3ft of the cold.

This measure was developed to be applicable to the following program types: TOS, NC, RF, KITS.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is installing pipe wrap insulation to a length of hot water pipe.

#### DEFINITION OF BASELINE EQUIPMENT

The baseline is an un-insulated hot water pipe.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.<sup>597</sup>

#### DEEMED MEASURE COST

The measure cost including material and installation is assumed to be \$3 per linear foot.<sup>598</sup>

#### LOADSHAPE

Loadshape C53 - Flat

#### COINCIDENCE FACTOR

This measure assumes a flat loadshape since savings relate to reducing standby losses and as such the coincidence factor is 1.

---

### Algorithm

---

#### CALCULATION OF SAVINGS

##### ELECTRIC ENERGY SAVINGS

For electric DHW systems:

$$\Delta kWh = ((C_{exist} / R_{exist} - C_{new} / R_{new}) * L * \Delta T * 8,766 * ISR) / \eta_{DHW} / 3412$$

Where:

$$R_{exist} = \text{Pipe heat loss coefficient of uninsulated pipe (existing) [(hr-°F-ft)/Btu]}$$

---

<sup>597</sup> Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

<sup>598</sup> Consistent with DEER 2008 Database Technology and Measure Cost Data ([www.deeresources.com](http://www.deeresources.com)).



	= 1.0 <sup>599</sup>
R <sub>new</sub>	= Pipe heat loss coefficient of insulated pipe (new) [(hr-°F-ft)/Btu] = Actual (1.0 + R value of insulation)
L	= Length of pipe from water heating source covered by pipe wrap (ft) = Actual
C <sub>exist</sub>	= Circumference of pipe (ft) (Diameter (in) * π/12) = Actual (0.5" pipe = 0.131ft, 0.75" pipe = 0.196ft)
C <sub>new</sub>	= Circumference of pipe (ft) (Diameter (in) * π/12) = Actual (0.5" pipe and 3/8" foam ((0.5 + 3/8 + 3/8) * π/12) = .327 ft)
ΔT	= Average temperature difference between supplied water and outside air temperature (°F) = 60°F <sup>600</sup>
8,766	= Hours per year
ISR	= In Service Rate = 0.56 for Kits distribution, <sup>601</sup> and 1.0 for all other program types
η <sub>DHW</sub>	= Recovery efficiency of electric hot water heater = 0.98 <sup>602</sup>
3412	= Conversion from Btu to kWh

**For example**, insulating 5 feet of 0.75" pipe with R-5 wrap through a Direct Install program:

$$\begin{aligned} \Delta \text{kWh} &= ((C_{\text{exist}} / R_{\text{exist}} - C_{\text{new}} / R_{\text{new}}) * L * \Delta T * 8,766 * 1.0) / \eta_{\text{DHW}} / 3412 \\ &= ((0.196/1 - 0.327/5) * 5 * 60 * 8766 * 1.0) / 0.98 / 3412 \\ &= 106 \text{ kWh} \end{aligned}$$

If inputs above are not available, the following default per 3ft R-5 length can be used for up to 6 ft length on the hot pipe and 3 ft on the cold pipe.

$$\begin{aligned} \Delta \text{kWh for KIT programs} &= ((C_{\text{exist}} / R_{\text{exist}} - C_{\text{new}} / R_{\text{new}}) * L * \Delta T * 8,766 * 0.56) / \eta_{\text{DHW}} / 3412 \\ &= ((0.196/1 - 0.327/5) * 3 * 60 * 8766 * 0.56) / 0.98 / 3412 \\ &= 34.5 \text{ kWh per 3ft length} \end{aligned}$$

$$\begin{aligned} \Delta \text{kWh for all other programs} &= ((C_{\text{exist}} / R_{\text{exist}} - C_{\text{new}} / R_{\text{new}}) * L * \Delta T * 8,766 * 1.0) / \eta_{\text{DHW}} / 3412 \\ &= ((0.196/1 - 0.327/5) * 3 * 60 * 8766 * 1.0) / 0.98 / 3412 \\ &= 61.6 \text{ kWh per 3ft length} \end{aligned}$$

<sup>599</sup> Navigant Consulting Inc., April 2009; "Measures and Assumptions for Demand Side Management (DSM) Planning; Appendix C Substantiation Sheets", p77.

<sup>600</sup> Assumes 125°F water leaving the hot water tank and average temperature of basement of 65°F.

<sup>601</sup> Kits installation rate for DHW pipe insulation is from 2020 survey research by Guidehouse, conducted with Peoples Gas income qualified recipients of self install efficiency kits distributed by mail in late 2019. There were 117 survey respondents.

<sup>602</sup> Electric water heaters have recovery efficiency of 98%.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / 8766$$

Where:

$$\Delta kWh = \text{kWh savings from pipe wrap installation}$$

$$8766 = \text{Number of hours in a year (since savings are assumed to be constant over year).}$$

**For example**, insulating 5 feet of 0.75" pipe with R-5 wrap through a Direct Install program:

$$\begin{aligned} \Delta kW &= 106/8766 \\ &= 0.0121kW \end{aligned}$$

If inputs above are not available, the following default per 3ft R-4 length can be used for up to 6 ft length on the hot pipe and 3 ft on the cold pipe.

$$\begin{aligned} \Delta kW \text{ for KIT programs} &= 34.5/8766 \\ &= 0.0039 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW \text{ for all other programs} &= 61.6/8766 \\ &= 0.0070 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

For Natural Gas DHW systems:

$$\Delta Therm = ((C_{exist} / R_{exist} - C_{new} / R_{new}) * L * \Delta T * 8,766 * ISR) / \eta_{DHW} / 100,000$$

Where:

$$\begin{aligned} \eta_{DHW} &= \text{Recovery efficiency of gas hot water heater} \\ &= 0.78^{603} \end{aligned}$$

Other variables as defined above

**For example**, insulating 5 feet of 0.75" pipe with R-5 wrap through a Direct Install program:

$$\begin{aligned} \Delta Therm &= ((0.196/1 - 0.327/5) * 5 * 60 * 8766 * 1.0) / 0.78 / 100,000 \\ &= 4.40 \text{ therms} \end{aligned}$$

If inputs above are not available, the following default per 3ft R-4 length can be used for up to 6ft length on the hot pipe and 3ft on the cold pipe.

$$\begin{aligned} \Delta Therm \text{ for KIT programs} &= ((C_{exist} / R_{exist} - C_{new} / R_{new}) * L * \Delta T * 8,766 * ISR) / \eta_{DHW} / 100,000 \\ &= ((0.196/1 - 0.327/5) * 3 * 60 * 8766 * 0.56) / 0.78 / 100,000 \\ &= 1.48 \text{ therms per 3ft length} \end{aligned}$$

$$\begin{aligned} \Delta Therm \text{ for all other programs} &= ((C_{exist} / R_{exist} - C_{new} / R_{new}) * L * \Delta T * 8,766 * ISR) / \eta_{DHW} / 100,000 \\ &= ((0.196/1 - 0.327/5) * 3 * 60 * 8766 * 1.0) / 0.78 / 100,000 \\ &= 2.64 \text{ therms per 3ft length} \end{aligned}$$

<sup>603</sup> Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HWE-PINS-V04-210101**

**REVIEW DEADLINE: 1/1/2025**

## 5.4.2 Gas Water Heater

### DESCRIPTION

This measure characterizes:

- a) Time of sale or new construction:

The purchase and installation of a new efficient gas-fired water heater, in place of a Federal Standard unit in a residential setting. Savings are provided for power-vented, condensing storage, and whole-house tankless units meeting specific Uniform Energy Factor (UEF) criteria.

- b) Early replacement:

The early removal of an existing functioning natural gas water heater from service, prior to its natural end of life, and replacement with a new high efficiency unit. Savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit and efficient unit consumption for the remainder of the measure life.

This measure was developed to be applicable to the following program types: TOS, NC, EREP.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the installed equipment must be a residential gas-fired storage water heater or tankless water heater meeting ENERGY STAR criteria.<sup>604</sup>

Water Heater Type	Water Heater Volume (gallons)	Draw Pattern	Minimum Uniform Energy Factor
Gas Storage	≤ 55	Medium	≥ 0.64
		High	≥ 0.68
	> 55	Medium	≥ 0.78
		High	≥ 0.80
Gas Instantaneous	All	All	≥ 0.87

### DEFINITION OF BASELINE EQUIPMENT

Time of Sale or New Construction: The baseline equipment is assumed to be a new, gas-fired storage residential water heater meeting minimum Federal efficiency standards as provided below:

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor <sup>605</sup>
Residential Gas Storage Water Heaters ≤75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.3456 – (0.0020 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5982 – (0.0019 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6483 – (0.0017 * Rated Storage Volume in Gallons)
		High	UEF = 0.6920 – (0.0013 * Rated Storage Volume in Gallons)
	>55 gallon and ≤100 gallon tanks	Very small	UEF = 0.6470 – (0.0006 * Rated Storage Volume in Gallons)
		Low	UEF = 0.7689 – (0.0005 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.7897 – (0.0004 * Rated Storage Volume in Gallons)
		High	UEF = 0.8072 – (0.0003 * Rated Storage Volume in Gallons)

<sup>604</sup> ENERGY STAR Product Specification for Residential Water Heaters, Version 3.2, effective April 16, 2015

<sup>605</sup> DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

Draw patterns are based on first hour rating (gallons) for storage tanks as shown below:<sup>606</sup>

Storage Water Heater Draw Pattern	
Draw Pattern	First Hour Rating (gallons)
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

The same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units. If using a deemed approach, for storage water heaters with a storage capacity equal to or less than 55 gallons, the Federal energy factor requirement is calculated as  $0.6483 - (0.0017 * \text{storage capacity in gallons})$  assuming a Medium draw and  $0.8072 - (0.0003 * \text{storage capacity in gallons})$  assuming a High draw for greater than 55 gallon storage water heaters.

Early Replacement: The baseline is the efficiency of the existing gas water heater for the remaining useful life of the unit and the efficiency of a new gas water heater of the same type meeting minimum Federal efficiency standards for the remainder of the measure life.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 13 years.<sup>607</sup>

For early replacement: Remaining life of existing equipment is assumed to be 4 years.<sup>608</sup>

**DEEMED MEASURE COST**

Time of Sale or New Construction:

The incremental capital cost for this measure is dependent on the type of water heater as listed below.<sup>609</sup>

Early Replacement: The full installed cost is provided in the table below. The assumed deferred cost (after 4 years) of replacing existing equipment with a new baseline unit is assumed to be \$650.<sup>610</sup> This cost should be discounted to present value using the nominal discount rate.

Water heater Type	Incremental Cost	Full Install Cost
Gas Storage	\$400	\$1014
Condensing gas storage	\$685	\$1299
Tankless whole-house unit	\$605	\$1219

<sup>606</sup> Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1

<sup>607</sup> DOE, 2010 Residential Heating Products Final Rule Technical Support Document, Table 8.2.14. Note: This source is used to support this category in aggregate. For all water heaters, life expectancy will depend on local variables such as water chemistry and homeowner maintenance. Some categories, including condensing storage and tankless water heaters do not yet have sufficient field data to support separate values. Preliminary data show lifetimes may exceed 20 years, though this has yet to be sufficiently demonstrated.

<sup>608</sup> Assumed to be one third of effective useful life

<sup>609</sup> Source for cost info; DOE, 2010 Residential Heating Products Final Rule Technical Support Document, Table 8.2.14.

<sup>610</sup> The deemed install cost of a Gas Storage heater is based upon DCEO Efficient Living Program Data for a sample size of 157 gas water heaters, and applying inflation rate of 1.91%.

**LOADSHAPE**

N/A

**COINCIDENCE FACTOR**

N/A

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS ENERGY SAVINGS**

Time of Sale or New Construction:

$$\Delta\text{Therms} = (1/ \text{UEF}_{\text{BASE}} - 1/\text{UEF}_{\text{EFFICIENT}}) * (\text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0)/100,000$$

Early replacement:<sup>611</sup>

$\Delta\text{Therms}$  for remaining life of existing unit (1st 3.7 years for gas storage unit and 1<sup>st</sup> 6.7 years for gas tankless unit):

$$= (1/ \text{UEF}_{\text{EXISTING}} - 1/\text{UEF}_{\text{EFFICIENT}}) * (\text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0)/100,000$$

$\Delta\text{Therms}$  for remaining measure life (next 7.3 years for gas storage unit and next 13.3 years for gas tankless unit):

$$= (1/ \text{UEF}_{\text{BASE}} - 1/\text{UEF}_{\text{EFFICIENT}}) * (\text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0)/100,000$$

Where:

**UEF\_Baseline** = Uniform Energy Factor rating of standard storage water heater according to federal standards provided in table in baseline section and using the same draw pattern as the efficient equipment. For a deemed approach:

= For gas storage water heaters ≤55 gallons: 0.6483 – (0.0017 \* storage capacity in gallons)

= For gas storage water heaters >55 gallons: 0.8072 – (0.0003 × storage capacity in gallons)

= If tank size is unknown, assume 0.563 for a gas storage water heater with a 50-gallon storage capacity

**UEF\_Efficient** = Uniform Energy Factor Rating for efficient equipment

= Actual. If unknown assume 0.64 for gas storage water heaters ≤55 gallons, 0.78 for gas

<sup>611</sup> The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a “number of years to adjustment” and “savings adjustment” input which would be the (new base to efficient savings)/(existing to efficient savings).

storage water heaters >55 gallons, and 0.87 for gas tankless water heaters.<sup>612</sup>

UEF\_Existing = Uniform Energy Factor rating for existing equipment  
 = Use actual UEF rating where it is possible to measure or reasonably estimate.  
 = if unknown assume 0.52<sup>613</sup>

GPD = Gallons Per Day of hot water use per person  
 = 45.5 gallons hot water per day per household/2.59 people per household.<sup>614</sup>  
 = 17.6

Household = Average number of people per household

Household Unit Type	Household
Single-Family - Deemed	2.56 <sup>615</sup>
Multifamily - Deemed	2.1 <sup>616</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>617</sup>

Use Multifamily if: Building meets utility's definition for multifamily

365.25 = Days per year, on average

$\gamma_{\text{Water}}$  = Specific Weight of water  
 = 8.33 pounds per gallon

T<sub>OUT</sub> = Tank temperature  
 = 125°F

T<sub>IN</sub> = Incoming water temperature from well or municipal system  
 = 54°F<sup>618</sup>

1.0 = Heat Capacity of water (1 Btu/lb\*°F)

**For example**, a 40 gallon condensing gas storage water heater, with a uniform energy factor of 0.80 in a single family house:

$$\Delta \text{Therms} = (1/0.58 - 1/0.80) * (17.6 * 2.56 * 365.25 * 8.33 * (125 - 54) * 1) / 100,000$$

$$= 46.15 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>612</sup> ENERGY STAR Product Specification for Residential Water Heaters, Version 3.2, effective April 16, 2015.

<sup>613</sup> Based on DCEO Efficient Living Program Data for a sample size of 157 gas water heaters.

<sup>614</sup> Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

<sup>615</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>616</sup> Navigant, ComEd PY3 Multifamily Home Energy Savings Program Evaluation Report Final, May 16, 2012.

<sup>617</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>618</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HWE-GWHT-V09-210101**

**REVIEW DEADLINE: 1/1/2024**



### 5.4.3 Heat Pump Water Heaters

#### DESCRIPTION

The installation of a heat pump domestic hot water heater in place of a standard electric water heater in a home. Savings are presented dependent on the heating system installed in the home due to the impact of the heat pump water heater on the heating loads.

This measure was developed to be applicable to the following program types: TOS, NC, RF. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR Heat Pump domestic water heater.<sup>619</sup>

#### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a new electric water heater meeting federal minimum efficiency standards,<sup>620</sup> dependent on the storage volume (in gallons) of the water heater.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor <sup>621</sup>
Residential Electric Storage Water Heaters ≤ 75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.8808 – (0.0008 * Rated Storage Volume in Gallons)
		Low	UEF = 0.9254 – (0.0003 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.9307 – (0.0002 * Rated Storage Volume in Gallons)
		High	UEF = 0.9349 – (0.0001 * Rated Storage Volume in Gallons)
	>55 gallon and ≤120 gallon tanks <sup>622</sup>	Very small	UEF = 1.9236 – (0.0011 * Rated Storage Volume in Gallons)
		Low	UEF = 2.0440 – (0.0011 * Rated Storage Volume in Gallons)
		Medium	UEF = 2.1171 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 2.2418 – (0.0011 * Rated Storage Volume in Gallons)
Residential Electric Instantaneous Water Heaters	≤12kW and ≤2 gal	All other	UEF = 0.91
		High	UEF = 0.92

The same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units. If using a deemed approach, for units ≤55 gallons – baseline is assumed to be a resistance storage unit with efficiency: 0.9307 – (0.0002 \* rated volume in gallons) assuming medium draw.

For units >55 gallons – assume a 50 gallon resistance tank baseline,<sup>623</sup> i.e., 0.9299 UEF assuming high draw .

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.<sup>624</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied

<sup>619</sup> If the water heater does not have a UEF rating, but a EF rating, revert to using the previous version of this measure.

<sup>620</sup> Minimum Federal Standard as of 4/1/2015, and updated in a Supplemental Notice of Proposed Rulemaking in 2016 assuming medium draw pattern.

<sup>621</sup> All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

<sup>622</sup> It is assumed that tanks <75,000Btu/h and >55 gallons will not be eligible measures due to the high baseline.

<sup>623</sup> A 50 gallon volume tank for the baseline is assumed to capture market practice of using larger heat pump water heaters to achieve greater efficiency of the heat pump cycle and preventing the unit from going in electric resistance mode.

<sup>624</sup> As recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

after 10 years or 13 years for boilers.<sup>625</sup> See section below for detail.

**DEEMED MEASURE COST**

For Time of Sale or New Construction the incremental installation cost (including labor) should be used. Defaults are provided below.<sup>626</sup> Actual efficient costs can also be used although care should be taken as installation costs can vary significantly due to complexities of a particular site.

For retrofit costs, the actual full installation cost should be used (default provided below if unknown).

Capacity	Efficiency Range	Baseline Installed Cost	Efficient Installed Cost	Incremental Installed Cost
≤55 gallons	<2.6 UEF	\$1,032	\$2,062	\$1,030
	≥2.6 UEF	\$1,032	\$2,231	\$1,199
>55 gallons	<2.6 UEF	\$1,319	\$2,432	\$1,113
	≥2.6 UEF	\$1,319	\$3,116	\$1,797

**LOADSHAPE**

Loadshape R18 - Residential Heat Pump Water Heater

**COINCIDENCE FACTOR**

The summer Peak Coincidence Factor is assumed to be 12%.<sup>627</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (((1/UEF_{BASE} - 1/UEF_{EFFICIENT}) * GPD * Household * 365.25 * \gamma_{Water} * (T_{OUT} - T_{IN}) * 1.0) / 3412) + kWh_{cooling} - kWh_{heating}$$

Where:

UEF<sub>BASE</sub> = Uniform Energy Factor (efficiency) of standard electric water heater according to federal standards provided in table in baseline section and using the same draw pattern as the efficient equipment. For a deemed approach:

For ≤55 gallons: 0.9307 – (0.0002 \* rated volume in gallons)

For >55 gallons: 0.9299

= If unknown volume, use 0.9207 for a 50 gallon tank, the most common size for HPWH assuming medium draw

UEF<sub>EFFICIENT</sub> = Uniform Energy Factor (efficiency) of Heat Pump water heater

---

<sup>625</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

<sup>626</sup> Costs for <2.6 UEF are based upon averages from the NEEP Phase 3 Incremental Cost Study. The assumption for higher efficiency tanks is based upon averaged from NEEP Phase 4 Incremental Cost Study. See 'HPWH Cost Estimation.xls' for more information.

<sup>627</sup> Calculated from Figure 8 "Combined six-unit summer weekday average electrical demand" in FEMP study; 'Field Testing of Pre-Production Prototype Residential Heat Pump Water Heaters' as (average kW usage during peak period \* hours in peak period) / [(annual kWh savings / FLH) \* hours in peak period] = (0.1 kW \* 5 hours) / [(2100 kWh (default assumptions) / 2533 hours) \* 5 hours] = 0.12

= Actual  
 GPD = Gallons Per Day of hot water use per person  
 = 45.5 gallons hot water per day per household/2.59 people per household <sup>628</sup>  
 = 17.6

Household = Average number of people per household

Household Unit Type	Household
Single-Family - Deemed	2.56 <sup>629</sup>
Multifamily - Deemed	2.1 <sup>630</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>631</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

365.25 = Days per year  
 γ<sub>Water</sub> = Specific weight of water  
 = 8.33 pounds per gallon

T<sub>OUT</sub> = Tank temperature  
 = 125°F

T<sub>IN</sub> = Incoming water temperature from well or municle system  
 = 54°F <sup>632</sup>

1.0 = Heat Capacity of water (1 Btu/lb\*°F)

3412 = Conversion from Btu to kWh

$$\begin{aligned} \text{kWh}_{\text{cooling}}^{633} &= \text{Cooling savings from conversion of heat in home to water heat} \\ &= \left( \left( \left( \left( \text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0 \right) / 3412 \right) - \right. \right. \\ &\quad \left. \left. \left( \left( 1 / \text{UEF}_{\text{NEW}} * \text{GPD} * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0 \right) / 3412 \right) * \right. \right. \\ &\quad \left. \left. \text{LF} * 27\% \right) / \text{COP}_{\text{COOL}} \right) * \text{LM} \end{aligned}$$

Where:

LF = Location Factor  
 = 1.0 for HPWH installation in a conditioned space  
 = 0.5 for HPWH installation in an unknown location

<sup>628</sup> Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

<sup>629</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>630</sup> Navigant, ComEd PY3 Multifamily Home Energy Savings Program Evaluation Report Final, May 16, 2012.

<sup>631</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>632</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

<sup>633</sup> This algorithm calculates the heat removed from the air by subtracting the HPWH electric consumption from the total water heating energy delivered. This is then adjusted to account for location of the HP unit and the coincidence of the waste heat with cooling requirements, the efficiency of the central cooling and latent cooling demands.

- = 0.0 for installation in an unconditioned space
- 27% = Portion of reduced waste heat that results in cooling savings<sup>634</sup>
- COP<sub>COOL</sub> = COP of central air conditioning  
= Actual, if unknown, assume 2.8<sup>635</sup>
- LM = Latent multiplier to account for latent cooling demand  
= 1.33<sup>636</sup>
- kWh\_heating = Heating cost from conversion of heat in home to water heat (dependent on heating fuel)  
= (((((GPD \* Household \* 365.25 \* γ<sub>Water</sub> \* (T<sub>OUT</sub> - T<sub>IN</sub>) \* 1.0) / 3412) - ((1/ UEF<sub>NEW</sub> \* GPD \* Household \* 365.25 \* γ<sub>Water</sub> \* (T<sub>OUT</sub> - T<sub>IN</sub>) \* 1.0) / 3412)) \* LF \* 49%) / COP<sub>HEAT</sub>) \* (1 - %NaturalGas)

Where:

- 49% = Portion of reduced waste heat that results in increased heating load<sup>637</sup>
- COP<sub>HEAT</sub> = COP of electric heating system  
= actual. If not available use.<sup>638</sup>

System Type	Age of Equipment	HSPF Estimate	COP <sub>HEAT</sub> (COP Estimate) = (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1.00
Unknown <sup>639</sup>	N/A	N/A	1.28

<sup>634</sup> REMRate determined percentage (27%) of lighting savings that result in reduced cooling loads (lighting is used as a proxy for hot water heating since load shapes suggest their seasonal usage patterns are similar).

<sup>635</sup> Starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm  $(-0.02 * SEER^2) + (1.12 * SEER)$  (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to COP = EER/3.412 = 2.8COP.

<sup>636</sup> A sensible heat ratio (SHR) of 0.75 corresponds to a latent multiplier of 4/3 or 1.33. SHR of 0.75 for typical split system from page 10 of “Controlling Indoor Humidity Using Variable-Speed Compressors and Blowers” by M. A. Andrade and C. W. Bullard, 1999.

<sup>637</sup> REMRate determined percentage (49%) of lighting savings that result in increased heating loads (lighting is used as a proxy for hot water heating since load shapes suggest their seasonal usage patterns are similar).

<sup>638</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

<sup>639</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

**For example**, a 2.0 UEF heat pump water heater, in a conditioned space in a single family home with gas space heat and central air conditioning (SEER 10.5) in Belleville:

$$\begin{aligned} \Delta kWh &= [(1 / 0.9207 - 1 / 2.0) * 17.6 * 2.56 * 365.25 * 8.33 * (125 - 54)] / 3412 + 188.9 - 0 \\ &= 1861 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$$\begin{aligned} \text{Hours} &= \text{Full load hours of water heater} \\ &= 2533^{640} \end{aligned}$$

$$\begin{aligned} CF &= \text{Summer Peak Coincidence Factor for measure} \\ &= 0.12^{641} \end{aligned}$$

**For example**, a 2.0 UEF heat pump water heater, in a conditioned space in a single family home with gas space heat and central air conditioning in Belleville:

$$\begin{aligned} kW &= 1861 / 2533 * 0.12 \\ &= 0.088kW \end{aligned}$$

### NATURAL GAS SAVINGS

$$\begin{aligned} \Delta \text{Therms} &= - (((((GPD * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 3412) - (GPD * \text{Household} * 365.25 * \gamma_{\text{Water}} * (T_{\text{OUT}} - T_{\text{IN}}) * 1.0) / 3412) / \text{UEF}_{\text{EFFICIENT}})) * LF * 49\% * 0.03412) / \eta_{\text{Heat}} \\ &\quad * \% \text{NaturalGas} \end{aligned}$$

Where:

$$\Delta \text{Therms} = \text{Heating cost from conversion of heat in home to water heat for homes with Natural Gas heat}^{642}$$

$$0.03412 = \text{conversion factor (therms per kWh)}$$

$$\begin{aligned} \eta_{\text{Heat}} &= \text{Efficiency of heating system} \\ &= \text{Actual.}^{643} \text{ If not available use } 70\%.^{644} \end{aligned}$$

<sup>640</sup> Full load hours assumption based on Efficiency Vermont analysis of Itron eShapes.

<sup>641</sup> Calculated from Figure 8 "Combined six-unit summer weekday average electrical demand" in FEMP study; 'Field Testing of Pre-Production Prototype Residential Heat Pump Water Heaters' as (average kW usage during peak period \* hours in peak period) / [(annual kWh savings / FLH) \* hours in peak period] = (0.1 kW \* 5 hours) / [(2100 kWh / 2533 hours) \* 5 hours] = 0.12

<sup>642</sup> This is the additional energy consumption required to replace the heat removed from the home during the heating season by the heat pump water heater. kWh\_heating (electric resistance) is that additional heating energy for a home with electric resistance heat (COP 1.0). This formula converts the additional heating kWh for an electric resistance home to the MMBtu required in a Natural Gas heated home, applying the relative efficiencies.

<sup>643</sup> Ideally, the System Efficiency should be obtained either by recording the AFUE of the unit, or performing a steady state efficiency test. The Distribution Efficiency can be estimated via a visual inspection and by referring to a look up table such as that provided by the Building Performance Institute: ([see 'DistributionEfficiencyTable-BlueSheet.pdf'](#)) or by performing duct blaster testing.

<sup>644</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey). In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of

%NaturalGas = Factor dependent on heating fuel:

Heating System	%NaturalGas
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel <sup>645</sup>	87%

Other factors as defined above

**For example**, a 2.0 COP heat pump water heater in conditioned space, in a single family home with gas space heat (70% system efficiency):

$$\Delta\text{Therms} = -((((17.6 * 2.56 * 365.25 * 8.33 * (125 - 54) * 1.0) / 3412) - (17.6 * 2.56 * 365.25 * 8.33 * (125 - 54) * 1.0 / 3412 / 2.0)) * 1 * 0.49 * 0.03412) / 0.7) * 1$$

$$= - 34.1 \text{ therms}$$

**Mid-Life adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Electric Resistance	1.0 COP
	Heat Pump (8.2HSPF/3.413)*0.85	2.04 COP
	Furnace 90% AFUE * 0.85	76.5% AFUE
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>646</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:  
 $(0.24 * 0.92) + (0.76 * 0.8) * (1 - 0.15) = 0.70$

<sup>645</sup> 2010 American Community Survey.

<sup>646</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

**MEASURE CODE: RS-HWE-HPWH-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

## 5.4.4 Low Flow Faucet Aerators

### DESCRIPTION

This measure relates to the installation of a low flow faucet aerator in a household kitchen or bath faucet fixture.

This measure may be used for units provided through Efficiency Kits however the in service rate for such measures should be derived through evaluation results specifically for this implementation methodology.

This measure was developed to be applicable to the following program types: TOS, NC, RF, DI, KITS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a low flow faucet aerator, for bathrooms rated at 1.5 gallons per minute (GPM) or less, or for kitchens rated at 2.2 GPM or less. Savings are calculated on an average savings per faucet fixture basis.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a standard bathroom faucet aerator rated at 2.2 GPM or greater, or a standard kitchen faucet aerator rated at 2.2 GPM or greater.

Average measured flow rates are used in the algorithm and are lower, reflecting the penetration of previously installed low flow fixtures (and therefore the freerider rate for this measure should be 0), use of the faucet at less than full flow, debris buildup, and lower water system pressure than fixtures are rated at.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>647</sup>

### DEEMED MEASURE COST

For time of sale or new construction the incremental cost for this measure is \$3,<sup>648</sup> or program actual.

For faucet aerators provided through Direct Install or within Efficiency Kits, the actual program delivery costs (including labor if applicable) should be utilized. If unknown, assume \$8 for Direct Install<sup>649</sup> and \$3 for Efficiency Kits.

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 2.2%.<sup>650</sup>

---

<sup>647</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>648</sup> 2011, Market research average of \$3.

<sup>649</sup> Includes assess and install labor time of \$5 (20min @ \$15/hr)

<sup>650</sup> Calculated as follows: Assume 18% aerator use takes place during peak hours (based on: Oreo et al, "The end uses of hot water in single family homes from flow trace analysis", 2001.) There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is  $0.18 * 65 / 365 = 3.21\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $3.21\% * 180 = 5.8$  hours of recovery during peak period where 180 equals the average annual electric DHW recovery hours for faucet use including SF and MF homes. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $5.8 / 260 = 0.022$



**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Note these savings are *per faucet retrofitted*<sup>651</sup> (unless faucet type is unknown, then it is per household).

$$\Delta kWh = \%ElectricDHW * ((GPM\_base * L\_base - GPM\_low * L\_low) * Household * 365.25 * DF / FPH) * EPG\_electric * ISR$$

Where:

**%ElectricDHW** = proportion of water heating supplied by electric resistance heating

DHW fuel	%ElectricDHW
Electric	100%
Natural Gas	0%
Unknown	16% <sup>652</sup>

**GPM\_base** = Average flow rate, in gallons per minute, of the baseline faucet “as-used.” This includes the effect of existing low flow fixtures and therefore the freerider rate for this measure should be 0.

= If unknown assume values in table below, or custom based on metering studies,<sup>653</sup> or if measured during DI:

= Measured full throttle flow \* 0.83 throttling factor<sup>654</sup>

Faucet Type	GPM <sup>655</sup>
Kitchen	1.63
Bathroom	1.53
If faucet location unknown	1.58

**GPM\_low** = Average flow rate, in gallons per minute, of the low-flow faucet aerator “as-used”

<sup>651</sup> This algorithm calculates the amount of energy saved per aerator by determining the fraction of water consumption savings for the upgraded fixture.

<sup>652</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>653</sup> Measurement should be based on actual average flow consumed over a period of time rather than a onetime spot measurement for maximum flow. Studies have shown maximum flow rates do not correspond well to average flow rate due to occupant behavior which does not always use maximum flow.

<sup>654</sup> 2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings. Page 1-265. [www.seattle.gov/light/Conserve/Reports/paper\\_10.pdf](http://www.seattle.gov/light/Conserve/Reports/paper_10.pdf)

<sup>655</sup> Based on flow meter bag testing conducted from June 2013 to January 2014 by Franklin Energy. Over 300 residential sites in the Chicago area were tested.

= 0.94,<sup>656</sup> or custom based on metering studies,<sup>657</sup> or if measured during DI:

= Rated full throttle flow \* 0.95 throttling factor<sup>658</sup>

L\_base = Average baseline daily length faucet use per capita for faucet of interest in minutes

= if available custom based on metering studies, if not use:

Faucet Type	L_base (min/person/day)
Kitchen	4.5 <sup>659</sup>
Bathroom	1.6 <sup>660</sup>
If faucet location unknown (total for household): Single-Family except mobile homes	9.0 <sup>661</sup>
If location unknown (total for household): Multifamily and mobile homes	6.9 <sup>662</sup>
If faucet location and building type unknown (total for household)	8.3 <sup>663</sup>

L\_low = Average retrofit daily length faucet use per capita for faucet of interest in minutes

= if available custom based on metering studies, if not use:

Faucet Type	L_low (min/person/day)
Kitchen	4.5 <sup>664</sup>
Bathroom	1.6 <sup>665</sup>
If faucet location unknown (total for household): Single-Family except mobile homes	9.0 <sup>666</sup>
If faucet location unknown (total for household):	6.9 <sup>667</sup>

<sup>656</sup> Average retrofit flow rate for kitchen and bathroom faucet aerators from sources 2, 4, 5, and 7(see source table at end of characterization). This accounts for all throttling and differences from rated flow rates. Assumes all kitchen aerators at 2.2 gpm or less and all bathroom aerators at 1.5 gpm or less. The most comprehensive available studies did not disaggregate kitchen use from bathroom use, but instead looked at total flow and length of use for all faucets. This makes it difficult to reliably separate kitchen water use from bathroom water use. It is possible that programs installing low flow aerators lower than the 2.2 gpm for kitchens and 1.5 gpm for bathrooms will see a lower overall average retrofit flow rate.

<sup>657</sup> Measurement should be based on actual average flow consumed over a period of time rather than a onetime spot measurement for maximum flow. Studies have shown maximum flow rates do not correspond well to average flow rate due to occupant behavior which does not always use maximum flow.

<sup>658</sup> 2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings. Page 1-265.

<sup>659</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. This study of 135 single and Multifamily homes in Michigan metered energy parameters for efficient showerhead and faucet aerators.

<sup>660</sup> Ibid.

<sup>661</sup> One kitchen faucet plus 2.83 bathroom faucets. Based on findings from a 2009 ComEd residential survey of 140 sites, provided by Cadmus.

<sup>662</sup> One kitchen faucet plus 1.5 bathroom faucets. Based on findings from a 2009 ComEd residential survey of 140 sites, provided by Cadmus.

<sup>663</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>664</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>665</sup> Ibid.

<sup>666</sup> One kitchen faucet plus 2.83 bathroom faucets. Based on findings from a 2009 ComEd residential survey of 140 sites, provided by Cadmus.

<sup>667</sup> One kitchen faucet plus 1.5 bathroom faucets. Based on findings from a 2009 ComEd residential survey of 140 sites,

Faucet Type	L_low (min/person/day)
Multifamily	
If faucet location and building type unknown (total for household)	8.3 <sup>668</sup>

Household = Average number of people per household

Household Unit Type	Household
Single-Family - Deemed	2.56 <sup>669</sup>
Multi-Family - Deemed	2.1 <sup>670</sup>
Household type unknown	2.42 <sup>671</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>672</sup>

Use Multifamily if: Building meets utility's definition for multifamily

365.25 = Days in a year, on average.

DF = Drain Factor

Faucet Type	Drain Factor <sup>673</sup>
Kitchen	75%
Bath	90%
Unknown	79.5%

FPH = Faucets Per Household

Faucet Type	FPH
Kitchen Faucets Per Home (KFPH)	1
Bathroom Faucets Per Home (BFPH): Single-Family except mobile homes	2.83 <sup>674</sup>
Bathroom Faucets Per Home (BFPH): Multifamily and mobile homes	1.5 <sup>675</sup>
If faucet location unknown (total for household): Single-Family except mobile homes	3.83
If faucet location unknown (total for household):	2.5

provided by Cadmus.

<sup>668</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>669</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>670</sup> Navigant, ComEd PY3 Multifamily Home Energy Savings Program Evaluation Report Final, May 16, 2012.

<sup>671</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>672</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>673</sup> Because faucet usages are at times dictated by volume, only usage of the sort that would go straight down the drain will provide savings. VEIC is unaware of any metering study that has determined this specific factor and so through consensus with the Illinois Technical Advisory Group have deemed these values to be 75% for the kitchen and 90% for the bathroom. If the aerator location is unknown an average of 79.5% should be used which is based on the assumption that 70% of household water runs through the kitchen faucet and 30% through the bathroom  $(0.7*0.75)+(0.3*0.9)=0.795$ .

<sup>674</sup>Based on findings from a 2009 ComEd residential survey of 140 sites, provided by Cadmus.

<sup>675</sup> Ibid.

Faucet Type	FPH
Multifamily and mobile homes	
If faucet location and building type unknown (total for household)	3.42 <sup>676</sup>

- EPG<sub>electric</sub> = Energy per gallon of water used by faucet supplied by electric water heater  
 =  $(8.33 * 1.0 * (\text{WaterTemp} - \text{SupplyTemp})) / (\text{RE}_{\text{electric}} * 3412)$   
 =  $(8.33 * 1.0 * (86 - 54.1)) / (0.98 * 3412)$   
 = 0.0795 kWh/gal (Bath), 0.0969 kWh/gal (Kitchen), 0.0919 kWh/gal (Unknown)
- 8.33 = Specific weight of water (lbs/gallon)
- 1.0 = Heat Capacity of water (btu/lb-°F)
- WaterTemp = Assumed temperature of mixed water  
 = 86F for Bath, 93F for Kitchen 91F for Unknown<sup>677</sup>
- SupplyTemp = Assumed temperature of water entering house  
 = 54.1F<sup>678</sup>
- RE<sub>electric</sub> = Recovery efficiency of electric water heater  
 = 98%<sup>679</sup>
- 3412 = Converts Btu to kWh (btu/kWh)
- ISR = In service rate of faucet aerators dependant on install method as listed in table below

<sup>676</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>677</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. If the aerator location is unknown an average of 91% should be used which is based on the assumption that 70% of household water runs through the kitchen faucet and 30% through the bathroom  $(0.7*93)+(0.3*86)=0.91$ .

<sup>678</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

<sup>679</sup> Electric water heaters have recovery efficiency of 98%. <http://www.ahridirectory.org/ahridirectory/pages/home.aspx>

Selection	ISR
Direct Install - Single Family	0.95 <sup>680</sup>
Direct Install –Multifamily Kitchen	0.91 <sup>681</sup>
Direct Install –Multifamily Bathroom	0.95 <sup>682</sup>
Efficiency Kit Bathroom Aerator	0.61 <sup>683</sup>
Efficiency Kit Kitchen Aerator	0.58 <sup>684</sup>
Community Distributed Kit Aerators	0.45 <sup>685</sup>
Distributed School Efficiency Kit Bathroom Aerator	0.27 <sup>686</sup>
Distributed School Efficiency Kit Kitchen Aerator	0.27 <sup>687</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

**For example**, a direct installed kitchen low flow faucet aerator in an individual electric DHW home:

$$\Delta\text{kWh} = 1.0 * (((1.63 * 4.5 - 0.94 * 4.5) * 2.56 * 365.25 * 0.75) / 1) * 0.0969 * 0.95$$

$$= 200 \text{ kWh}$$

**For example**, a direct installed bath low flow faucet aerator in a shared electric DHW home:

$$\Delta\text{kWh} = 1.0 * (((1.53 * 1.6 - 0.94 * 1.6) * 2.1 * 365.25 * 0.90) / 1.5) * 0.0795 * 0.95$$

$$= 33.0 \text{ kWh}$$

**For example**, a direct installed low flow faucet aerator in unknown faucet in an individual electric DHW home:

$$\Delta\text{kWh} = 1.0 * (((1.58 * 9.0 - 0.94 * 9.0) * 2.56 * 365.25 * 0.795) / 3.83) * 0.0919 * 0.95$$

$$= 97.6 \text{ kWh}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta\text{kWh}_{\text{water}} = \Delta\text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

$$E_{\text{water total}} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

$$= 5010 \text{ for measures installed in all areas except Cook County}^{688}$$

<sup>680</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program Table 3-8

<sup>681</sup> Navigant, ComEd-Nicor Gas EPY4/GPY1 Multifamily Home Energy Savings Program Evaluation Report DRAFT 2013-01-28

<sup>682</sup> Ibid.

<sup>683</sup> A weighted ISR was found by weighting Nicor and Ameren efficiency kit program uptake and their previously found ISRs. This analysis can be found in Faucet Aerators and Showerheads Weighted Average ISR IL TRM.xlsx.

<sup>684</sup> A weighted ISR was found by weighting Nicor and Ameren efficiency kit program uptake and their previously found ISRs. This analysis can be found in Faucet Aerators and Showerheads Weighted Average ISR IL TRM.xlsx.

<sup>685</sup> Research from 2018 Ameren Illinois Income Qualified participant survey.

<sup>686</sup> Opinion Dynamics and Cadmus. 2018 AIC Residential Program Annual Impact Evaluation Report. April 30, 2019. Results from implementer-administered participant survey.

<sup>687</sup> Ibid

<sup>688</sup> This factor includes 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

= 2,937 for measures installed in Cook County<sup>689,690</sup>

**For example**, a direct installed kitchen low flow aerator in an single family home

$$\Delta\text{Water (gallons)} = (((1.63 * 4.5 - 0.94 * 4.5) * 2.56 * 365.25 * 0.75) / 1) * 0.95$$

$$= 2068 \text{ gallons}$$

$$\Delta\text{kWh}_{\text{water}} = 2068 / 1000000 * 5010$$

$$= 10.4 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh} / \text{Hours} * \text{CF}$$

Where:

$\Delta\text{kWh}$  = calculated value above. Note do not include the secondary savings in this calculation.

Hours = Annual electric DHW recovery hours for faucet use per faucet

$$= ((\text{GPM}_{\text{base}} * \text{L}_{\text{base}}) * \text{Household}/\text{FPH} * 365.25 * \text{DF}) * 0.545^{691} / \text{GPH}$$

Building Type	Faucet location	Calculation	Hours per faucet
Single Family	Kitchen	$((1.63 * 4.5) * 2.56 / 1 * 365.25 * 0.75) * 0.545 / 27.4$	102
	Bathroom	$((1.53 * 1.6) * 2.56 / 2.83 * 365.25 * 0.9) * 0.545 / 27.4$	14
	Unknown	$((1.58 * 9.0) * 2.56 / 3.83 * 365.25 * 0.795) * 0.545 / 27.4$	55
Multifamily	Kitchen	$((1.63 * 4.5) * 2.1 / 1 * 365.25 * 0.75) * 0.545 / 27.4$	84
	Bathroom	$((1.53 * 1.6) * 2.1 / 1.5 * 365.25 * 0.9) * 0.545 / 27.4$	22
	Unknown	$((1.58 * 6.9) * 2.1 / 2.5 * 365.25 * 0.795) * 0.545 / 27.4$	53

GPH = Gallons per hour recovery of electric water heater calculated for 70.9F temp rise (125-54.1), 98% recovery efficiency, and typical 4.5kW electric resistance storage tank.

$$= 27.4$$

CF = Coincidence Factor for electric load reduction

$$= 0.022^{692}$$

<sup>689</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>690</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility's achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute's applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

<sup>691</sup> 54.5% is the proportion of hot 120F water mixed with 54.1F supply water to give 90F mixed faucet water.

<sup>692</sup> Calculated as follows: Assume 18% aerator use takes place during peak hours (based on: Oreo et al, "The end uses of hot water in single family homes from flow trace analysis", 2001.) There are 65 days in the summer peak period, so the percentage

**For example**, a direct installed kitchen low flow faucet aerator in a single family electric DHW home:

$$\begin{aligned} \Delta kW &= 200/110 * 0.022 \\ &= 0.04 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

$$\Delta \text{Therms} = \% \text{FossilDHW} * ((\text{GPM\_base} * \text{L\_base} - \text{GPM\_low} * \text{L\_low}) * \text{Household} * 365.25 * \text{DF} / \text{FPH}) * \text{EPG\_gas} * \text{ISR}$$

Where:

$\% \text{FossilDHW}$  = proportion of water heating supplied by Natural Gas heating

DHW fuel	$\% \text{Fossil\_DHW}$
Electric	0%
Natural Gas	100%
Unknown	84% <sup>693</sup>

$\text{EPG\_gas}$  = Energy per gallon of Hot water supplied by gas  
 =  $(8.33 * 1.0 * (\text{WaterTemp} - \text{SupplyTemp})) / (\text{RE\_gas} * 100,000)$   
 = 0.00341 Therm/gal for SF homes (Bath), 0.00415 Therm/gal for SF homes (Kitchen), 0.00394 Therm/gal for SF homes (Unknown)  
 = 0.00397 Therm/gal for MF homes (Bath), 0.00484 Therm/gal for MF homes (Kitchen), 0.00459 Therm/gal for MF homes (Unknown)

$\text{RE\_gas}$  = Recovery efficiency of gas water heater  
 = 78% For individual water heater<sup>694</sup>  
 = 67% For shared water heater<sup>695</sup>  
 If unknown, use individual water heater value for single family, use shared water heater value for multifamily. Use multifamily if building meets utility’s definition for multifamily.

100,000 = Converts Btus to Therms (btu/Therm)

Other variables as defined above.

of total annual aerator use in peak period is  $0.18 * 65 / 365 = 3.21\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $3.21\% * 180 = 5.8$  hours of recovery during peak period where 180 equals the average annual electric DHW recovery hours for faucet use including SF and MF homes. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $5.8 / 260 = 0.022$

<sup>693</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>694</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.

<sup>695</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

**For example**, a direct-installed kitchen low flow faucet aerator in a fuel DHW single-family home:

$$\begin{aligned} \Delta\text{Therms} &= 1.0 * (((1.63 * 4.5 - 0.94 * 4.5) * 2.56 * 365.25 * 0.75) / 1) * 0.00415 * 0.95 \\ &= 8.58 \text{ Therms} \end{aligned}$$

**For example**, a direct installed bath low flow faucet aerator in a fuel DHW multi-family home:

$$\begin{aligned} \Delta\text{Therms} &= 1.0 * (((1.53 * 1.6 - 0.94 * 1.6) * 2.1 * 365.25 * 0.90) / 1.5) * 0.003974 * 0.95 \\ &= 1.64 \text{ Therms} \end{aligned}$$

**For example**, a direct installed low flow faucet aerator in unknown faucet in a fuel DHW single-family home:

$$\begin{aligned} \Delta\text{Therms} &= 1.0 * (((1.58 * 9.0 - 0.94 * 9.0) * 2.56 * 365.25 * 0.795) / 3.83) * 0.00394 * 0.95 \\ &= 4.18 \text{ Therms} \end{aligned}$$

#### WATER IMPACT DESCRIPTIONS AND CALCULATION

$$\Delta\text{Water (gallons)} = ((\text{GPM}_{\text{base}} * L_{\text{base}} - \text{GPM}_{\text{low}} * L_{\text{low}}) * \text{Household} * 365.25 * \text{DF} / \text{FPH}) * \text{ISR}$$

Variables as defined above

**For example**, a direct-installed kitchen low flow aerator in a single family home

$$\begin{aligned} \Delta\text{Water (gallons)} &= (((1.63 * 4.5 - 0.94 * 4.5) * 2.56 * 365.25 * 0.75) / 1) * 0.95 \\ &= 2068 \text{ gallons} \end{aligned}$$

**For example**, a direct installed bath low flow faucet aerator in a multi-family home:

$$\begin{aligned} \Delta\text{Water (gallons)} &= (((1.53 * 1.6 - 0.94 * 1.6) * 2.1 * 365.25 * 0.90) / 1.5) * 0.95 \\ &= 413 \text{ gallons} \end{aligned}$$

**For example**, a direct installed low flow faucet aerator in unknown faucet in a single family home:

$$\begin{aligned} \Delta\text{Water (gallons)} &= (((1.58 * 9.0 - 0.94 * 9.0) * 2.56 * 365.25 * 0.795) / 3.83) * 0.95 \\ &= 1062 \text{ gallons} \end{aligned}$$

#### DEEMED O&M COST ADJUSTMENT CALCULATION

N/A



**SOURCES**

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.

**MEASURE CODE: RS-HWE-LFFA-V10-210101**

**REVIEW DEADLINE: 1/1/2024**

## 5.4.5 Low Flow Showerheads

### DESCRIPTION

This measure relates to the installation of a low flow showerhead in a single or multi-family household.

This measure may be used for units provided through Efficiency Kits; however the in service rate for such measures should be derived through evaluation results specifically for this implementation methodology.

This measure was developed to be applicable to the following program types: TOS, RF, NC, DI, KITS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a low flow showerhead rated at least 0.5 gallons per minute (GPM) less than the existing showerhead. Savings are calculated on a per showerhead fixture basis.

### DEFINITION OF BASELINE EQUIPMENT

For Direct install programs, the baseline condition is assumed to be a standard showerhead rated at 2.0 GPM or greater.

For retrofit and time-of-sale programs, the baseline condition is assumed to be a representative average of existing showerhead flow rates of participating customers including a range of low flow showerheads, standard-flow showerheads, and high-flow showerheads.

Average measured flow rates are used in the algorithm and are lower, reflecting the penetration of previously installed low flow fixtures (and therefore the freerider rate for this measure should be 0), use of the shower at less than full flow, debris buildup, and lower water system pressure than fixtures are rated at.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>696</sup>

### DEEMED MEASURE COST

For time of sale or new construction the incremental cost for this measure is \$7 or program actual.<sup>697</sup>

For low flow showerheads provided through Direct Install or within Efficiency Kits, the actual program delivery costs (including labor if applicable) should be utilized. If unknown assume \$12 for Direct Install<sup>698</sup> and \$7 for Efficiency Kits.

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 2.78%.<sup>699</sup>

---

<sup>696</sup> Table C-6, Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007. Evaluations indicate that consumer dissatisfaction may lead to reductions in persistence, particularly in Multifamily.

<sup>697</sup> Market research average of \$7.

<sup>698</sup> Includes assess and install labor time of \$5 (20min @ \$15/hr)

<sup>699</sup> Calculated as follows: Assume 11% showers take place during peak hours (based on: Oreo et al, "The end uses of hot water in single family homes from flow trace analysis", 2001.). There are 65 days in the summer peak period, so the percentage of

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Note these savings are per showerhead fixture

$$\Delta kWh = \%ElectricDHW * ((GPM\_base * L\_base - GPM\_low * L\_low) * Household * SPCD * 365.25 / SPH) * EPG\_electric * ISR$$

Where:

**%ElectricDHW** = proportion of water heating supplied by electric resistance heating

DHW fuel	%ElectricDHW
Electric	100%
Natural Gas	0%
Unknown	16% <sup>700</sup>

**GPM\_base** = Average flow rate, in gallons per minute, of the baseline faucet “as-used.” This includes the effect of existing low flow fixtures and therefore the freerider rate for this measure should be 0.

Program	GPM_base
Direct-install	2.24 <sup>701</sup>
Retrofit, Efficiency Kits, NC or TOS	2.35 <sup>702</sup>

**GPM\_low** = As-used flow rate of the low-flow showerhead, which may, as a result of measurements of program evaluations deviate from rated flows, see table below:

Rated Flow
2.0 GPM
1.75 GPM
1.5 GPM
Custom or Actual <sup>703</sup>

total annual aerator use in peak period is  $0.11 * 65 / 365 = 1.96\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $1.96\% * 369 = 7.23$  hours of recovery during peak period, where 369 equals the average annual electric DHW recovery hours for showerhead use including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $7.23 / 260 = 0.0278$

<sup>700</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>701</sup> Based on measurements conducted from June 2013 to January 2014 by Franklin Energy. Over 300 residential sites in the Chicago area were tested.

<sup>702</sup> Representative value from sources 1, 2, 4, 5, 6 and 7 (See Source Table at end of measure section) adjusted slightly upward to account for program participation which is expected to target customers with existing higher flow devices rather than those with existing low flow devices.

<sup>703</sup> Note that actual values may be either a) program-specific minimum flow rate, or b) program-specific evaluation-based value of actual effective flow-rate due to increased duration or temperatures. The latter increases in likelihood as the rated flow drops and may become significant at or below rated flows of 1.5 GPM. The impact can be viewed as the inverse of the throttling described in the footnote for baseline flowrate.

L\_base = Shower length in minutes with baseline showerhead  
 = 7.8 min<sup>704</sup>

L\_low = Shower length in minutes with low-flow showerhead  
 = 7.8 min<sup>705</sup>

Household = Average number of people per household

Household Unit Type <sup>706</sup>	Household
Single-Family - Deemed	2.56 <sup>707</sup>
Multi-Family - Deemed	2.1 <sup>708</sup>
Household type unknown	2.42 <sup>709</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>710</sup>

Use Multifamily if: Building meets utility's definition for multifamily

SPCD = Showers Per Capita Per Day  
 = 0.6<sup>711</sup>

365.25 = Days per year, on average.

SPH = Showerheads Per Household so that per-showerhead savings fractions can be determined

Household Type	SPH
Single-Family except mobile homes	1.79 <sup>712</sup>
Multifamily and mobile homes	1.3 <sup>713</sup>
Household type unknown	1.64 <sup>714</sup>
Custom	Actual

Use Multifamily if: Building meets utility's definition for multifamily

EPG\_electric = Energy per gallon of hot water supplied by electric

<sup>704</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. This study of 135 single and Multifamily homes in Michigan metered energy parameters for efficient showerhead and faucet aerators.

<sup>705</sup> Ibid.

<sup>706</sup> If household type is unknown, as may be the case for time of sale measures, then single family deemed value shall be used.

<sup>707</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>708</sup> ComEd PY3 Multifamily Evaluation Report REVISED DRAFT v5 2011-12-08.docx

<sup>709</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>710</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>711</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>712</sup> Based on findings from a 2009 ComEd residential survey of 140 sites, provided by Cadmus.

<sup>713</sup> Ibid.

<sup>714</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

$$= (8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE\_electric} * 3412)$$

$$= (8.33 * 1.0 * (101 - 54.1)) / (0.98 * 3412)$$

$$= 0.117 \text{ kWh/gal}$$

- 8.33 = Specific weight of water (lbs/gallon)
- 1.0 = Heat Capacity of water (btu/lb-°)
- ShowerTemp = Assumed temperature of water  
= 101F<sup>715</sup>
- SupplyTemp = Assumed temperature of water entering house  
= 54.1F<sup>716</sup>
- RE\_electric = Recovery efficiency of electric water heater  
= 98%<sup>717</sup>
- 3412 = Converts Btu to kWh (btu/kWh)
- ISR = In service rate of showerhead  
= Dependant on program delivery method as listed in table below

Selection	ISR
Direct Install - Single Family	0.97 <sup>718</sup>
Direct Install –Multifamily	0.95 <sup>719</sup>
Efficiency Kits--One showerhead kit	0.62 <sup>720</sup>
Efficiency Kits—Two showerhead kit	0.67 <sup>721</sup>
Distributed School Efficiency Kit showerhead	0.25 <sup>722</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

**For example**, a direct-installed 1.5 GPM low flow showerhead in a single family home with electric DHW where the number of showers is not known:

$$\Delta \text{kWh} = 1.0 * ((2.24 * 7.8 - 1.5 * 7.8) * 2.56 * 0.6 * 365.25 / 1.79) * 0.117 * 0.97$$

$$= 205 \text{ kWh}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

<sup>715</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>716</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

<sup>717</sup> Electric water heaters have recovery efficiency of 98%.

<sup>718</sup> Weighted average of 98% found in ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program Table 3-8 (quantity surveyed = 163), and 87% from ComEd Single Family Retrofits CY2018 Field Work Memo 2019-07-19, Table 1 (quantity surveyed = 15).

Alternative ISRs may be developed for program delivery methods based on evaluation results.

<sup>719</sup> Navigant, ComEd-Nicor Gas EPY4/GPY1 Multifamily Home Energy Savings Program Evaluation Report FINAL 2013-06-05

<sup>720</sup> A weighted ISR was found by weighting Nicor and Ameren efficiency kit program uptake and their previously found ISRs. This analysis can be found in Faucet Aerators and Showerheads Weighted Average ISR IL TRM.xlsx.

<sup>721</sup> A weighted ISR was found by weighting Nicor and Ameren efficiency kit program uptake and their previously found ISRs. This analysis can be found in Faucet Aerators and Showerheads Weighted Average ISR IL TRM.xlsx.

<sup>722</sup> Opinion Dynamics and Cadmus. 2018 AIC Residential Program Annual Impact Evaluation Report. April 30, 2019. Results from implementer-administered participant survey.

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{\text{water}} = \Delta \text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

$$E_{\text{water total}} = \text{IL Total Water Energy Factor (kWh/Million Gallons)}$$

$$= 5010 \text{ for measures installed in all areas except Cook County}^{723}$$

$$= 2,937 \text{ for measures installed in Cook County}^{724,725}$$

**For example**, a direct installed 1.5 GPM low flow showerhead in a single family where the number of showers is not known:

$$\Delta \text{Water (gallons)} = ((2.24 * 7.8 - 1.5 * 7.8) * 2.56 * 0.6 * 365.25 / 1.79) * 0.97$$

$$= 1756 \text{ gallons}$$

$$\Delta kWh_{\text{water}} = 1773 / 1,000,000 * 5010$$

$$= 8.9 \text{ kWh}$$

#### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$\Delta kWh$  = calculated value above. Note do not include the secondary savings in this calculation.

Hours = Annual electric DHW recovery hours for showerhead use

$$= ((\text{GPM}_{\text{base}} * L_{\text{base}}) * \text{Household} * \text{SPCD} * 365.25) * 0.712^{726} / \text{GPH}$$

= 255 for SF Direct Install; 208 for MF Direct Install

= 267 for SF Retrofit, Efficiency Kits, NC and TOS; 219 for MF Retrofit, Efficiency Kits, NC and TOS

Use Multifamily if: Building meets utility’s definition for multifamily

GPH = Gallons per hour recovery of electric water heater calculated for 65.9F temp rise (120-54.1), 98% recovery efficiency, and typical 4.5kW electric resistance storage tank.

<sup>723</sup> This factor includes 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>724</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>725</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

<sup>726</sup> 71.2% is the proportion of hot 120F water mixed with 54.1F supply water to give 101F shower water.

$$= 27.4$$

CF = Coincidence Factor for electric load reduction

$$= 0.0278^{727}$$

**For example**, a direct installed 1.5 GPM low flow showerhead in a single family home with electric DHW where the number of showers is not known:

$$\begin{aligned} \Delta kW &= 205/255 * 0.0278 \\ &= 0.022 \text{ kW} \end{aligned}$$

### NATURAL GAS SAVINGS

$$\Delta \text{Therms} = \% \text{FossilDHW} * ((\text{GPM}_{\text{base}} * L_{\text{base}} - \text{GPM}_{\text{low}} * L_{\text{low}}) * \text{Household} * \text{SPCD} * 365.25 / \text{SPH}) * \text{EPG}_{\text{gas}} * \text{ISR}$$

Where:

$\% \text{FossilDHW}$  = proportion of water heating supplied by Natural Gas heating

DHW fuel	$\% \text{Fossil}_{\text{DHW}}$
Electric	0%
Natural Gas	100%
Unknown	84% <sup>728</sup>

$$\begin{aligned} \text{EPG}_{\text{gas}} &= \text{Energy per gallon of Hot water supplied by gas} \\ &= (8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE}_{\text{gas}} * 100,000) \\ &= 0.00501 \text{ Therm/gal for SF homes} \\ &= 0.00583 \text{ Therm/gal for MF homes} \end{aligned}$$

$$\begin{aligned} \text{RE}_{\text{gas}} &= \text{Recovery efficiency of gas water heater} \\ &= 78\% \text{ For individual water heater}^{729} \\ &= 67\% \text{ For shared water heater}^{730} \end{aligned}$$

If unknown, use individual water heater value for single family, use shared water heater value for multifamily. Use multifamily if building meets utility's definition for multifamily.

<sup>727</sup> Calculated as follows: Assume 11% showers take place during peak hours (based on: Oreo et al, "The end uses of hot water in single family homes from flow trace analysis", 2001.). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is  $0.11 * 65 / 365 = 1.96\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $1.96\% * 369 = 7.23$  hours of recovery during peak period where 369 equals the average annual electric DHW recovery hours for showerhead use including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $7.23 / 260 = 0.0278$

<sup>728</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>729</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.

<sup>730</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

100,000 = Converts Btus to Therms (btu/Therm)

Other variables as defined above.

**For example**, a direct installed 1.5 GPM low flow showerhead in a gas fired DHW single family home where the number of showers is not known:

$$\begin{aligned} \Delta\text{Therms} &= 1.0 * ((2.24 * 7.8 - 1.5 * 7.8) * 2.56 * 0.6 * 365.25 / 1.79) * 0.00501 * 0.97 \\ &= 8.8 \text{ therms} \end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water (gallons)} = ((\text{GPM\_base} * \text{L\_base} - \text{GPM\_low} * \text{L\_low}) * \text{Household} * \text{SPCD} * 365.25 / \text{SPH}) * \text{ISR}$$

Variables as defined above

**For example**, a direct installed 1.5 GPM low flow showerhead in a single family home where the number of showers is not known:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((2.24 * 7.8 - 1.5 * 7.8) * 2.56 * 0.6 * 365.25 / 1.79) * 0.97 \\ &= 1754 \text{ gallons} \end{aligned}$$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**SOURCES**

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.

**MEASURE CODE: RS-HWE-LFSH-V09-210101**

**REVIEW DEADLINE: 1/1/2023**



## 5.4.6 Water Heater Temperature Setback

### DESCRIPTION

This measure was developed to be applicable to the following program types: NC, RF, DI, KITS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

High efficiency is a hot water tank with the thermostat reduced to no lower than 120 degrees.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a hot water tank with a thermostat setting that is higher than 120 degrees, typically systems with settings of 130 degrees or higher. Note if there are more than one DHW tanks in the home at or higher than 130 degrees and they are all turned down, then the savings per tank can be multiplied by the number of tanks.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the measure is 2 years.

### DEEMED MEASURE COST

The incremental cost of a setback is assumed to be \$5 for contractor time, or where the measure is installed as part of a kit program, the cost of the informational insert or other product should be used.

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 1.

---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

For homes with electric DHW tanks:

$$\Delta kWh^{731} = (U * A * (T_{pre} - T_{post}) * Hours * ISR) / (3412 * RE_{electric})$$

Where:

U = Overall heat transfer coefficient of tank (Btu/Hr-°F-ft<sup>2</sup>).  
 = Actual if known. If unknown assume R-12, U = 0.083

---

<sup>731</sup> Note this algorithm provides savings only from reduction in standby losses. The TAC considered avoided energy from not heating the water to the higher temperature but determined that dishwashers are likely to boost the temperature within the unit (roughly canceling out any savings), faucet and shower use is likely to be at the same temperature so there would need to be more lower temperature hot water being used (cancelling any savings) and clothes washers will only see savings if the water from the tank is taken without any temperature control. It was felt the potential impact was too small to be characterized.

A = Surface area of storage tank (square feet)  
 = Actual if known. If unknown use table below based on capacity of tank. If capacity unknown assume 50 gal tank; A = 24.99ft<sup>2</sup>

Capacity (gal)	A (ft <sup>2</sup> ) <sup>732</sup>
30	19.16
40	23.18
50	24.99
80	31.84

Tpre = Actual hot water setpoint prior to adjustment

Tpost = Actual new hot water setpoint, which may not be lower than 120 degrees

Default Hot Water Temperature Inputs	
Tpre	135
Tpost	120

Hours = Number of hours in a year (since savings are assumed to be constant over year).  
 = 8766

ISR = In service rate of measure  
 = Dependent on program delivery method as listed in table below

Delivery method	ISR
Distributed school efficient kit instructions	13% <sup>733</sup>
Instructions provided in all other Kit programs	10% <sup>734</sup>
All other	100%

3412 = Conversion from Btu to kWh

RE\_electric = Recovery efficiency of electric hot water heater  
 = 0.98<sup>735</sup>

A deemed savings assumption for non-kit programs, where site specific assumptions are not available would be as follows:

<sup>732</sup> Assumptions from PA TRM. Area values were calculated from average dimensions of several commercially available units, with radius values measured to the center of the insulation.

<sup>733</sup> Opinion Dynamics and Cadmus. 2018 AIC Residential Program Annual Impact Evaluation Report. April 30, 2019. Results from implementer-administered participant survey.

<sup>734</sup> Opinion Dynamics. Impact and Process Evaluation of 2014 (PY7) Illinois Power Agency Rural Kits Program. April 19, 2016.

<sup>735</sup> Electric water heaters have recovery efficiency of 98%.

$$\begin{aligned} \Delta kWh &= (U * A * (T_{pre} - T_{post}) * \text{Hours} * \text{ISR}) / (3412 * \text{RE}_{\text{electric}}) \\ &= (((0.083 * 24.99) * (135 - 120) * 8766 * 1.0) / (3412 * 0.98)) \\ &= 81.6 \text{ kWh} \end{aligned}$$

For school kit programs, the default savings is 10.6 kWh and for all other kit programs the default savings is 8.2 kWh.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

$$\begin{aligned} \text{Hours} &= 8766 \\ CF &= \text{Summer Peak Coincidence Factor for measure} \\ &= 1 \end{aligned}$$

A deemed savings assumption for non-kit programs, where site specific assumptions are not available would be as follows:

$$\begin{aligned} \Delta kW &= (81.6 / 8766) * 1 \\ \Delta kW \text{ default} &= 0.0093 \text{ kW} \end{aligned}$$

For school kit programs, the default savings is 0.0012kW and for all other kit programs the default savings is 0.00094kW.

**NATURAL GAS SAVINGS**

For homes with gas water heaters:

$$\Delta \text{Therms} = (U * A * (T_{pre} - T_{post}) * \text{Hours} * \text{ISR}) / (100,000 * \text{RE}_{\text{gas}})$$

Where

$$\begin{aligned} 100,000 &= \text{Converts Btus to Therms (btu/Therm)} \\ \text{RE}_{\text{gas}} &= \text{Recovery efficiency of gas water heater} \\ &= 78\% \text{ For SF homes}^{736} \\ &= 67\% \text{ For MF homes}^{737} \\ &\text{Use Multifamily if: Building has shared DHW} \end{aligned}$$

A deemed savings assumption for non-kit programs, where site specific assumptions are not available would be as follows:

For Single Family homes:

<sup>736</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.

<sup>737</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

$$\begin{aligned}\Delta\text{Therms} &= (U * A * (T_{\text{pre}} - T_{\text{post}}) * \text{Hours} * \text{ISR}) / (\text{RE}_{\text{gas}}) \\ &= ((0.083 * 24.99) * (135 - 120) * 8766 * 1.0) / (100,000 * 0.78) \\ &= 3.5 \text{ Therms}\end{aligned}$$

For school kit programs, the default savings is 0.45 Therms and for all other kit programs the default savings is 0.35 Therms.

For Multi Family homes:

$$\begin{aligned}\Delta\text{Therms} &= (U * A * (T_{\text{pre}} - T_{\text{post}}) * \text{Hours} * \text{ISR}) / (\text{RE}_{\text{gas}}) \\ &= ((0.083 * 24.99) * (135 - 120) * 8766 * 1.0) / (100,000 * 0.67) \\ &= 4.1 \text{ Therms}\end{aligned}$$

For school kit programs, the default savings is 0.53 Therms and for all other kit programs the default savings is 0.41 Therms.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HWE-TMPS-V08-210101**

**REVIEW DEADLINE: 1/1/2025**

## 5.4.7 Water Heater Wrap

### DESCRIPTION

This measure relates to a Tank Wrap or insulation “blanket” that is wrapped around the outside of a hot water tank to reduce stand-by losses. This measure applies only for homes that have an electric water heater that is not already well insulated. Generally this can be determined based upon the appearance of the tank.<sup>738</sup>

This measure was developed to be applicable to the following program types: RF, DI.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The measure is a properly installed, R-8 or greater insulating tank wrap to reduce standby energy losses from the tank to the surrounding ambient area.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is a standard electric domestic hot water tank without an additional tank wrap. Gas storage water heaters are excluded due to the limitations of retrofit wrapping and the associated impacts on reduced savings and safety.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 5 years.<sup>739</sup>

### DEEMED MEASURE COST

The incremental cost for this measure will be the actual material cost of procuring and labor cost of installing the tank wrap.

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

This measure assumes a flat loadshape and as such the coincidence factor is 1.

---



---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

For electric DHW systems:

$$\Delta \text{kWh} = ((A_{\text{base}} / R_{\text{base}} - A_{\text{insul}} / R_{\text{insul}}) * \Delta T * \text{Hours}) / (3412 * \eta_{\text{DHW}})$$

Where:

$$R_{\text{base}} = \text{Overall thermal resistance coefficient prior to adding tank wrap (Hr-}^\circ\text{F-ft}^2\text{/BTU).}$$

---

<sup>738</sup> Visually determine whether it is insulated by foam (newer, rigid, and more effective) or fiberglass (older, gives to gently pressure, and not as effective)

<sup>739</sup> This estimate assumes the tank wrap is installed on an existing unit with 5 years remaining life.

- $R_{insul}$  = Overall thermal resistance coefficient after addition of tank wrap (Hr-°F-ft<sup>2</sup>/BTU).
- $A_{base}$  = Surface area of storage tank prior to adding tank wrap (square feet)<sup>740</sup>
- $A_{insul}$  = Surface area of storage tank after addition of tank wrap (square feet)<sup>741</sup>
- $\Delta T$  = Average temperature difference between tank water and outside air temperature (°F)  
= 60°F <sup>742</sup>
- Hours = Number of hours in a year (since savings are assumed to be constant over year).  
= 8766
- 3412 = Conversion from Btu to kWh
- $\eta_{DHW}$  = Recovery efficiency of electric hot water heater  
= 0.98 <sup>743</sup>

The following table has default savings for various tank capacity and pre and post R-VALUES.

Capacity (gal)	Rbase	Rinsul	Abase (ft <sup>2</sup> ) <sup>744</sup>	Ainsul (ft <sup>2</sup> ) <sup>745</sup>	$\Delta kWh$	$\Delta kW$
30	8	16	19.16	20.94	171	0.0195
30	10	18	19.16	20.94	118	0.0135
30	12	20	19.16	20.94	86	0.0099
30	8	18	19.16	20.94	194	0.0221
30	10	20	19.16	20.94	137	0.0156
30	12	22	19.16	20.94	101	0.0116
40	8	16	23.18	25.31	207	0.0236
40	10	18	23.18	25.31	143	0.0164
40	12	20	23.18	25.31	105	0.0120
40	8	18	23.18	25.31	234	0.0268
40	10	20	23.18	25.31	165	0.0189
40	12	22	23.18	25.31	123	0.0140
50	8	16	24.99	27.06	225	0.0257
50	10	18	24.99	27.06	157	0.0179
50	12	20	24.99	27.06	115	0.0131
50	8	18	24.99	27.06	255	0.0291
50	10	20	24.99	27.06	180	0.0206
50	12	22	24.99	27.06	134	0.0153
80	8	16	31.84	34.14	290	0.0331
80	10	18	31.84	34.14	202	0.0231
80	12	20	31.84	34.14	149	0.0170
80	8	18	31.84	34.14	328	0.0374
80	10	20	31.84	34.14	232	0.0265
80	12	22	31.84	34.14	173	0.0198

<sup>740</sup> Area includes tank sides and top to account for typical wrap coverage.

<sup>741</sup> Ibid.

<sup>742</sup> Assumes 125°F water leaving the hot water tank and average temperature of basement of 65°F.

<sup>743</sup> Electric water heaters have recovery efficiency of 98%.

<sup>744</sup> Assumptions from PA TRM. Area values were calculated from average dimensions of several commercially available units, with radius values measured to the center of the insulation. Area includes tank sides and top to account for typical wrap coverage.

<sup>745</sup> Assumptions from PA TRM.  $A_{insul}$  was calculated by assuming that the water heater wrap is a 2" thick fiberglass material.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh / 8766 * CF$$

Where:

$\Delta kWh$  = kWh savings from tank wrap installation

8766 = Number of hours in a year (since savings are assumed to be constant over year).

CF = Summer Coincidence Factor for this measure

= 1.0

The table above has default kW savings for various tank capacity and pre and post R-values.

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-HWE-WRAP-V02-150601**

**REVIEW DEADLINE: 1/1/2022**

## 5.4.8 Thermostatic Restrictor Shower Valve

### DESCRIPTION

The measure is the installation of a thermostatic restrictor shower valve in a single or multi-family household. This is a valve attached to a residential showerhead which restricts hot water flow through the showerhead once the water reaches a set point (generally 95F or lower).

This measure was developed to be applicable to the following program types: RF, NC, DI. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a thermostatic restrictor shower valve installed on a residential showerhead.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is the residential showerhead without the restrictor valve installed.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.<sup>746</sup>

### DEEMED MEASURE COST

The incremental cost of the measure should be the actual program cost (including labor if applicable), or \$30<sup>747</sup> plus \$20 labor<sup>748</sup> if not available.

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 0.22%.<sup>749</sup>

---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \%ElectricDHW * ((GPM\_base\_S * L\_showerdevice) * Household * SPCD * 365.25 / SPH) *$$

<sup>746</sup> Assumptions based on NY TRM, Pacific Gas and Electric Company Work Paper PGECODHW113, and measure life of low-flow showerhead.

<sup>747</sup> Based on actual cost of the SS-1002CP-SB Ladybug Water-Saving Shower-Head adapter from Evolve showerheads.

<sup>748</sup> Estimate for contractor installation time.

<sup>749</sup> Calculated as follows: Assume 11% showers take place during peak hours (based on: Oreo et al, "The end uses of hot water in single family homes from flow trace analysis", 2001.). There are 65 days in the summer peak period, so the percentage of total annual use in peak period is 0.11\*65/365 = 1.96%. The number of hours of recovery during peak periods is therefore assumed to be 1.96% \* 29.5 = 0.577 hours of recovery during peak period, where 29.5 equals the average annual electric DHW recovery hours for showerhead use prevented by the device including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is 0.577/260 = 0.0022



EPG\_electric \* ISR

Where:

%ElectricDHW = proportion of water heating supplied by electric resistance heating

DHW fuel	%ElectricDHW
Electric	100%
Natural Gas	0%
Unknown	16% <sup>750</sup>

GPM\_base\_S = Flow rate of the basecase showerhead, or actual if available

Program	GPM
Direct-install, device only	2.24 <sup>751</sup>
New Construction or direct install of device and low flow showerhead	Rated or actual flow of program-installed showerhead
Retrofit or TOS	2.35 <sup>752</sup>

L\_showerdevice = Hot water waste time avoided due to thermostatic restrictor valve  
 = 0.89 minutes<sup>753</sup>

Household = Average number of people per household

Household Unit Type <sup>754</sup>	Household
Single-Family - Deemed	2.56 <sup>755</sup>
Multi-Family - Deemed	2.1 <sup>756</sup>
Household type unknown	2.42 <sup>757</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>758</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

<sup>750</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>751</sup> Based on measurements conducted from June 2013 to January 2014 by Franklin Energy. Over 300 residential sites in the Chicago area were tested.

<sup>752</sup> Representative value from sources 1, 2, 4, 5, 6 and 7 (See Source Table at end of measure section) adjusted slightly upward to account for program participation which is expected to target customers with existing higher flow devices rather than those with existing low flow devices.

<sup>753</sup> Average of the following sources: ShowerStart LLC survey; “Identifying, Quantifying and Reducing Behavioral Waste in the Shower: Exploring the Savings Potential of ShowerStart”, City of San Diego Water Department survey; “Water Conservation Program: ShowerStart Pilot Project White Paper”, and PG&E Work Paper PGECODHW113.

<sup>754</sup> If household type is unknown, as may be the case for time of sale measures, then single family deemed value shall be used.

<sup>755</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>756</sup> ComEd PY3 Multifamily Evaluation Report REVISED DRAFT v5 2011-12-08.docx

<sup>757</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>758</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

- SPCD = Showers Per Capita Per Day  
= 0.6<sup>759</sup>
- 365.25 = Days per year, on average.
- SPH = Showerheads Per Household so that per-showerhead savings fractions can be determined

Household Type	SPH
Single-Family	1.79 <sup>760</sup>
Multifamily	1.3 <sup>761</sup>
Household type unknown	1.64 <sup>762</sup>
Custom	Actual

Use Multifamily if: Building meets utility’s definition for multifamily

- EPG\_electric = Energy per gallon of hot water supplied by electric  
=  $(8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE\_electric} * 3412)$   
=  $(8.33 * 1.0 * (101 - 54.1)) / (0.98 * 3412)$   
= 0.117 kWh/gal
- 8.33 = Specific weight of water (lbs/gallon)
- 1.0 = Heat Capacity of water (btu/lb-°)
- ShowerTemp = Assumed temperature of water  
= 101F<sup>763</sup>
- SupplyTemp = Assumed temperature of water entering house  
= 54.1F<sup>764</sup>
- RE\_electric = Recovery efficiency of electric water heater  
= 98%<sup>765</sup>
- 3412 = Converts Btu to kWh (btu/kWh)
- ISR = In service rate of showerhead  
= Dependent on program delivery method as listed in table below

Selection	ISR
Direct Install - Single Family	0.98 <sup>766</sup>

<sup>759</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>760</sup> Based on findings from a 2009 ComEd residential survey of 140 sites, provided by Cadmus.

<sup>761</sup> Ibid.

<sup>762</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>763</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>764</sup> US DOE Building America Program. Building America Analysis Spreadsheet.

<sup>765</sup> Electric water heaters have recovery efficiency of 98%.

<sup>766</sup> Deemed values are from ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program Table 3-8. Alternative ISRs may be developed for

Selection	ISR
Direct Install – Multi Family	0.95 <sup>767</sup>
Efficiency Kits	To be determined through evaluation

Use Multifamily if: Building meets utility’s definition for multifamily

**For example**, a direct installed valve in a single-family home with electric DHW:

$$\begin{aligned} \Delta\text{kWh} &= 1.0 * (2.24 * 0.89 * 2.56 * 0.6 * 365.25 / 1.79) * 0.117 * 0.98 \\ &= 72 \text{ kWh} \end{aligned}$$

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta\text{kWh}_{\text{water}} = \Delta\text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

$$\begin{aligned} E_{\text{water total}} &= \text{IL Total Water Energy Factor (kWh/Million Gallons)} \\ &= 5,010 \text{ for measures installed in all areas except Cook County}^{768} \\ &= 2,937 \text{ for measures installed in Cook County}^{769,770} \end{aligned}$$

**For example**, a direct installed thermostatic restrictor device in a single family home where the number of showers is not known:

$$\begin{aligned} \Delta\text{Water (gallons)} &= ((2.24 * 0.89) * 2.56 * 0.6 * 365.25 / 1.79) * 0.98 \\ &= 612 \text{ gallons} \\ \Delta\text{kWh}_{\text{water}} &= 612 / 1,000,000 * 5010 \\ &= 3.1 \text{ kWh} \end{aligned}$$

program delivery methods based on evaluation results.

<sup>767</sup> Navigant, ComEd-Nicor Gas EPY4/GPY1 Multifamily Home Energy Savings Program Evaluation Report FINAL 2013-06-05

<sup>768</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>769</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>770</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \Delta kWh/Hours * CF$$

Where:

$\Delta kWh$  = calculated value above. Note do not include the secondary savings in this calculation.

Hours = Annual electric DHW recovery hours for wasted showerhead use prevented by device  
 =  $((GPM\_base\_S * L\_showerdevice) * Household * SPCD * 365.25) * 0.712^{771} / GPH$

GPH = Gallons per hour recovery of electric water heater calculated for 65.9F temp rise (120-54.1), 98% recovery efficiency, and typical 4.5kW electric resistance storage tank.  
 = 27.51

= 34.4 for SF Direct Install; 28.3 for MF Direct Install

= 30.3 for SF Retrofit and TOS; 24.8 for MF Retrofit and TOS

Use Multifamily if: Building meets utility’s definition for multifamily

CF = Coincidence Factor for electric load reduction

= 0.0022<sup>772</sup>

**For example**, a direct installed thermostatic restrictor device in a home with electric DHW where the number of showers is not known.

$$\begin{aligned} \Delta kW &= 72/34.4 * 0.0022 \\ &= 0.0046 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

$$\Delta Therms = \%FossilDHW * ((GPM\_base\_S * L\_showerdevice) * Household * SPCD * 365.25 / SPH) * EPG\_gas * ISR$$

Where:

$\%FossilDHW$  = proportion of water heating supplied by Natural Gas heating

DHW fuel	$\%Fossil\_DHW$
Electric	0%
Natural Gas	100%
Unknown	84% <sup>773</sup>

<sup>771</sup> 71.2% is the proportion of hot 120F water mixed with 54.1F supply water to give 101F shower water.

<sup>772</sup> Calculated as follows: Assume 11% showers take place during peak hours (based on: Oreo et al, “The end uses of hot water in single family homes from flow trace analysis”, 2001.). There are 65 days in the summer peak period, so the percentage of total annual use in peak period is  $0.11 * 65/365 = 1.96\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $1.96\% * 29.5 = 0.577$  hours of recovery during peak period, where 29.5 equals the average annual electric DHW recovery hours for showerhead use prevented by the device including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $0.577/260 = 0.0022$

<sup>773</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

EPG\_gas = Energy per gallon of Hot water supplied by gas  
 =  $(8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE\_gas} * 100,000)$   
 = 0.00501 Therm/gal for SF homes  
 = 0.00583 Therm/gal for MF homes

RE\_gas = Recovery efficiency of gas water heater  
 = 78% For SF homes<sup>774</sup>  
 = 67% For MF homes<sup>775</sup>  
 Use Multifamily if: Building has shared DHW.

100,000 = Converts Btus to Therms (btu/Therm)  
 Other variables as defined above.

**For example**, a direct installed thermostatic restrictor device in a gas fired DHW single family home where the number of showers is not known:

$$\Delta\text{Therms} = 1.0 * ((2.24 * 0.89) * 2.56 * 0.6 * 365.25 / 1.79) * 0.00501 * 0.98$$

$$= 3.1 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$\Delta\text{Water (gallons)} = ((\text{GPM\_base\_S} * \text{L\_showerdevice}) * \text{Household} * \text{SPCD} * 365.25 / \text{SPH}) * \text{ISR}$   
 Variables as defined above

**For example**, a direct installed thermostatic restrictor device in a single family home where the number of showers is not known:

$$\Delta\text{Water (gallons)} = ((2.24 * 0.89) * 2.56 * 0.6 * 365.25 / 1.79) * 0.98$$

$$= 612 \text{ gallons}$$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**SOURCES**

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.

<sup>774</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.

<sup>775</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

Source ID	Reference
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.
8	2011, Lutz, Jim. "Water and Energy Wasted During Residential Shower Events: Findings from a Pilot Field Study of Hot Water Distribution Systems", Energy Analysis Department Lawrence Berkeley National Laboratory, September 2011.
9	2008, Water Conservation Program: ShowerStart Pilot Project White Paper, City of San Diego, CA.
10	2012, Pacific Gas and Electric Company, Work Paper PGECODHW113, Low Flow Showerhead and Thermostatic Shower Restriction Valve, Revision # 4, August 2012.
11	2008, "Simply & Cost Effectively Reducing Shower Based Warm-Up Waste: Increasing Convenience & Conservation by Attaching ShowerStart to Existing Showerheads", ShowerStart LLC.
12	2014, New York State Record of Revision to the TRM, Case 07-M-0548, June 19, 2014.

**MEASURE CODE: RS-HWE-TRVA-V05-200101**

**REVIEW DEADLINE: 1/1/2023**

## 5.4.9 Shower Timer

### DESCRIPTION

Shower Timers are designed to make it easy for people to consistently take short showers, resulting in water and energy savings.

The shower timer provides a reminder to participants on length of their shower visually or auditorily.

This measure was developed to be applicable to the following program type: KITS, DI.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The shower timer should provide a reminder to participants to keep showers to a length of 5 minutes or less.

### DEFINITION OF BASELINE EQUIPMENT

The baseline is no shower timer.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed lifetime is 2 years.<sup>776</sup>

### DEEMED MEASURE COST

For shower timers provided in Efficiency Kits, the actual program delivery costs should be utilized.

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 2.78%.<sup>777</sup>

---



---

### Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \%Electric\ DHW * GPM * (L\_base - L\_timer) * Household * Days/yr * SPCD * UsageFactor * EPG\_Electric$$

Where:

$\%Electric\ DHW$  = Proportion of water heating supplied by electric resistance heating

---

<sup>776</sup> Estimate of persistence of behavior change instigated by the shower timer.

<sup>777</sup> Calculated as follows: Assume 11% showers take place during peak hours (based on: Oreo et al, "The end uses of hot water in single family homes from flow trace analysis", 2001.). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is  $0.11 * 65 / 365 = 1.96\%$ . The number of hours of recovery during peak periods is therefore assumed to be  $1.96\% * 369 = 7.23$  hours of recovery during peak period, where 369 equals the average annual electric DHW recovery hours for showerhead use including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is  $7.23 / 260 = 0.0278$

DHW fuel	%ElectricDHW
Electric	100%
Natural Gas	0%
Unknown	16% <sup>778</sup>

- GPM = Flow rate of showerhead as used  
 = Custom, to be determined through evaluation. If data is not available use 1.93<sup>779</sup>
- L\_base = Number of minutes in shower without a shower timer  
 =7.8 minutes<sup>780</sup>
- L\_timer = Number of minutes in shower after shower timer  
 = Custom, to be determined through evaluation. If data is not available use 5.79.<sup>781</sup>
- Household = Number in household using timer

Household Unit Type <sup>782</sup>	Household
Single-Family - Deemed	2.56 <sup>783</sup>
Multi-Family - Deemed	2.1 <sup>784</sup>
Household type unknown	2.42 <sup>785</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>786</sup>

- Days/yr = 365.25
- SPCD = Showers Per Capita Per Day  
 = 0.6<sup>787</sup>
- UsageFactor = How often each participant is using shower timer  
 =Custom, to be determined through evaluation. If data is not available use 0.34<sup>788</sup>
- EPG\_Electric = Energy per gallon of hot water supplied by electric

<sup>778</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>779</sup> Navigant Elementary Education GPY4 Evaluation Report, dated May 12, 2016. Average of all utilities.

<sup>780</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. This study of 135 single and Multifamily homes in Michigan metered energy parameters for efficient showerhead and faucet aerators.

<sup>781</sup> Navigant Elementary Education GPY4 Evaluation Report, dated May 12, 2016. Average of all utilities.

<sup>782</sup> If household type is unknown, as may be the case for time of sale measures, then single family deemed value shall be used.

<sup>783</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>784</sup> ComEd PY3 Multifamily Evaluation Report REVISED DRAFT v5 2011-12-08.docx

<sup>785</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>786</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

<sup>787</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>788</sup> Navigant Elementary Education GPY4 Evaluation Report, dated May 12, 2016. Average of all utilities.



$$\begin{aligned}
 &= (8.33 * 1.0 * (\text{ShowerTemp} - \text{SupplyTemp})) / (\text{RE\_electric} * 3412) \\
 &= (8.33 * 1.0 * (101 - 54.1)) / (0.98 * 3412) \\
 &= 0.117 \text{ kWh/gal}
 \end{aligned}$$

Based on default assumptions provided above, the savings for a single family home would be:

$$\begin{aligned}
 \Delta\text{kWh} &= \% \text{Electric DHW} * \text{GPM} * (\text{L\_base} - \text{L\_timer}) * \text{Household} * \text{Days/yr} * \text{SPCD} * \text{UsageFactor} \\
 &\quad * \text{EPG\_Electric} \\
 &= 0.16 * 1.93 * (7.8 - 5.79) * 2.56 * 365.25 * 0.6 * 0.34 * 0.117 \\
 &= 13.9 \text{ kWh}
 \end{aligned}$$

#### Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta\text{kWh}_{\text{water}} = \Delta\text{Water (gallons)} / 1,000,000 * E_{\text{water total}}$$

Where

$$\begin{aligned}
 E_{\text{water total}} &= \text{IL Total Water Energy Factor (kWh/Million Gallons)} \\
 &= 5,010 \text{ for measures installed in all areas except Cook County}^{789} \\
 &= 2,937 \text{ for measures installed in Cook County}^{790,791}
 \end{aligned}$$

Based on default assumptions provided above, the savings for a single family home would be:

$$\begin{aligned}
 \Delta\text{Water (gallons)} &= \text{GPM} * (\text{L\_base} - \text{L\_timer}) * \text{Household} * \text{Days/yr} * \text{SPCD} * \text{UsageFactor} \\
 &= 1.93 * (7.8 - 5.79) * 2.56 * 365.25 * 0.6 * 0.34 \\
 &= 740.0 \text{ gallons} \\
 \Delta\text{kWh}_{\text{water}} &= 740 / 1,000,000 * 5010 \\
 &= 3.7 \text{ kWh}
 \end{aligned}$$

#### **SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = \Delta\text{kWh/Hours} * \text{CF}$$

<sup>789</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’.

<sup>790</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>791</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility’s achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute’s applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

Where:

- $\Delta kWh$  = calculated value above. Note do not include the secondary savings in this calculation.
- Hours = Annual electric DHW recovery hours for showerhead use  
 $= ((GPM\_base * L\_base) * Household\ Users * SPCD * 365.25) * 0.712 / GPH$
- GPH = Gallons per hour recovery of electric water heater calculated for 65.9F temp rise (120-54.1), 98% recovery efficiency, and typical 4.5kW electric resistance storage tank.  
 $= 27.51$
- CF = Coincidence Factor for electric load reduction  
 $= 0.0278^{792}$

Based on default assumptions provided above, the savings for a single family home would be:

$$\Delta kW = \Delta kWh / Hours * CF$$

$$= 0.0013\ kW$$

**NATURAL GAS SAVINGS**

- $\Delta Therms$  = %FossilDHW \* GPM \* (L\_base – L\_timer) \* Household \* Days/yr \* SPCD \* UsageFactor \* EPG\_Gas
- %FossilDHW = Proportion of water heating supplied by electric resistance heating

DHW fuel	%FossilDHW
Electric	0%
Natural Gas	100%
Unknown	84% <sup>793</sup>

- EPG\_gas = Energy per gallon of Hot water supplied by gas  
 $= (8.33 * 1.0 * (ShowerTemp - SupplyTemp)) / (RE\_gas * 100,000)$   
 $= 0.00501\ Therm/gal\ for\ SF\ homes$   
 $= 0.00583\ Therm/gal\ for\ MF\ homes$
- RE\_gas = Recovery efficiency of gas water heater  
 $= 78\% \text{ For SF homes }^{794}$

<sup>792</sup> Calculated as follows: Assume 11% showers take place during peak hours (based on: Oreo et al, “The end uses of hot water in single family homes from flow trace analysis”, 2001.). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is 0.11\*65/365 = 1.96%. The number of hours of recovery during peak periods is therefore assumed to be 1.96% \* 369 = 7.23 hours of recovery during peak period where 369 equals the average annual electric DHW recovery hours for showerhead use including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is 7.23/260 = 0.0278

<sup>793</sup> Default assumption for unknown fuel is based on EIA Residential Energy Consumption Survey (RECS) 2009 for Midwest Region, data for the state of IL. If utilities have specific evaluation results providing a more appropriate assumption for homes in a particular market or geographical area then that should be used

<sup>794</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.

= 67% For MF homes<sup>795</sup>

Use Multifamily if: Building has shared DHW.

100,000 = Converts Btus to Therms (btu/Therm)

Other variables as defined above.

Based on default assumptions provided above, the savings for a single family home would be:

$$\begin{aligned} \Delta \text{ Therms} &= \%FossilDHW * GPM * (L\_base - L\_timer) * Household * Days/yr * SPCD * UsageFactor \\ &\quad * EPG\_Gas \\ &= 0.84 * 1.93 * (7.8 - 5.79) * 2.56 * 365.25 * 0.6 * 0.34 * 0.00501 \\ &= 3.1 \text{ Therms} \end{aligned}$$

#### **WATER DESCRIPTIONS AND CALCULATION**

$$\Delta \text{Water (gallons)} = GPM * (L\_base - L\_timer) * Household * Days/yr * SPCD * UsageFactor$$

Variables as defined above

Based on default assumptions provided above, the savings for a single family home would be:

$$\begin{aligned} \Delta \text{Water (gallons)} &= GPM * (L\_base - L\_timer) * Household * Days/yr * SPCD * UsageFactor \\ &= 1.93 * (7.8 - 5.79) * 2.56 * 365.25 * 0.6 * 0.34 \\ &= 740.0 \text{ gallons} \end{aligned}$$

#### **DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-DHW-SHTM-V03-190101**

**REVIEW DEADLINE: 1/1/2026**

---

<sup>795</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

## 5.4.10 Pool Covers

### DESCRIPTION

This measure refers to the installation of covers on residential use pools that are heated with gas-fired equipment located either indoors or outdoors. By installing pool covers, the heating load on the pool boiler will be reduced by reducing the heat loss from the water to the environment and the amount of actual water lost due to evaporation (which then requires additional heated water to make up for it). An additional benefit to pool covers are the electricity savings from the reduced fresh water required to replace the evaporated water.

The main source of energy loss in pools is through evaporation. This is particularly true of outdoor pools where wind plays a larger role. The point of installing pool covers is threefold. First, it will reduce convective losses due to the wind by shielding the water surface. Second, it will insulate the water from the colder surrounding air. And third, it will reduce radiative losses to the night sky. In doing so, evaporative losses will also be minimized, and the boiler will not need to work as hard in replenishing the pool with hot water to keep the desired temperature.

This measure can be used for pools that (1) currently do not have pool covers, (2) have pool covers that are past the useful life of the existing cover, or (3) have pool covers that are past their warranty period and have failed.

This measure was developed to be applicable to the following program type: RF. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

For indoor pools, the efficient case is the installation of an indoor pool cover with a 5 year warranty on an indoor pool that is used all year.

For outdoor pools, the efficient case is the installation of an outdoor pool cover with a 5 year warranty on an outdoor pool that is used through the summer season.

### DEFINITION OF BASELINE EQUIPMENT

For indoor pools, the base case is an uncovered indoor pool that operates all year.

For outdoor pools, the base case is an outdoor pool that is uncovered and is open through the summer season.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The useful life of this measure is assumed to be 6 years.<sup>796</sup>

### DEEMED MEASURE COST

The table below shows the costs for the various options and cover sizes. Since this measure covers a mix of various sizes, the average cost of these options is taken to be the incremental measure cost.<sup>797</sup> Costs are per square foot.

---

<sup>796</sup> The effective useful life of a pool cover is typically one year longer than its warranty period. SolaPool Covers. Pool Covers Website, FAQ- "How long will my SolaPool cover blanket last?". Pool covers are typically offered with 3 and 5 year warranties with at least one company offering a 6 year warranty. Conversation with Trade Ally. Knorr Systems

<sup>797</sup> Pool Cover Costs: Lincoln Pool Equipment online catalog. Accessed 7/18/2019.

Cover Size	Edge Style	
	Hemmed (indoor)	Weighted (outdoor)
1-299 sq. ft.	\$3.91	\$4.08
300-999 sq. ft.	\$2.61	\$2.78
Average	\$3.26	\$3.43

**LOADSHAPE**

Loadshape R15 – Residential Pool Pumps

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water \text{ (gallons)} / 1,000,000 * E_{water \text{ supply}}$$

Where

$$E_{water \text{ supply}} = \text{Water Supply Energy Factor (kWh/Million Gallons)}$$

$$= 2,571^{798}$$

---

<sup>798</sup> This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy’s ‘IL TRM: Energy per Gallon Factor, May 2018 paper’. Note since the water loss associated with this measure is due to evaporation and does not discharge into the wastewater system, only the water supply factor is used here.

**For example:**

For a 392 ft<sup>2</sup> Indoor Swimming Pool:

$$\begin{aligned} \Delta\text{Water} &= \text{WaterSavingFactor} \times \text{Size of Pool} \\ &= 15.28 \text{ gal./ft}^2/\text{year} \times 392 \text{ ft}^2 \\ &= 5,990 \text{ gal./year} \end{aligned}$$

$$\begin{aligned} \Delta\text{kWhwater} &= \Delta\text{Water} / 1,000,000 * E_{\text{water total}} \\ &= 5,990 \text{ gal./year} / 1,000,000 * 2,571 \text{ kWh/million gallons} \\ &= 15.4 \text{ kWh/year} \end{aligned}$$

For a 392 ft<sup>2</sup> Outdoor Swimming Pool:

$$\begin{aligned} \Delta\text{Water} &= \text{WaterSavingFactor} \times \text{Size of Pool} \\ &= 8.94 \text{ gal./ft}^2/\text{year} \times 392 \text{ ft}^2 \\ &= 3,504 \text{ gal./year} \end{aligned}$$

$$\begin{aligned} \Delta\text{kWhwater} &= \Delta\text{Water} / 1,000,000 * E_{\text{water supply}} \\ &= 3,504 \text{ gal./year} / 1,000,000 * 2,571 \text{ kWh/million gallons} \\ &= 9.0 \text{ kWh/year} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

The calculations are based on modeling runs using RSPEC! Energy Smart Pools Software that was created by the U.S. Department of Energy.<sup>799</sup>

$$\Delta\text{Therms} = \text{SavingFactor} \times \text{Size of Pool}$$

Where

Savings factor = dependant on pool location and listed in table below.<sup>800</sup>

Location	Therm / sq-ft
Indoor	2.61
Outdoor	1.01

Size of Pool = Actual. If unknown assume 392 ft<sup>2</sup>.<sup>801</sup>

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta\text{Water (gallons)} = \text{WaterSavingFactor} \times \text{Size of Pool}$$

Where

WaterSavingFactor = Water savings for this measure dependant on pool location and listed in table below.<sup>802</sup>

<sup>799</sup> Full method and supporting information found in reference document: IL TRM – Residential Pool Covers WorkPaper.docx. Note that the savings estimates are based upon Chicago weather data.

<sup>800</sup> Calculations can be found in Residential Pool Covers.xlsx

<sup>801</sup> The average size of an installed in-ground swimming poll is 14 ft x 28 ft, giving a surface area of 392 ft<sup>2</sup>. <<https://www.homeadvisor.com/cost/swimming-pools-hot-tubs-and-saunas/inground-pool/>>

<sup>802</sup> Ibid.

Location	Annual Savings Gal / sq-ft
Indoor	15.28
Outdoor	8.94

Size of Pool = 392 ft<sup>2</sup>

**DEEMED O&M COST ADJUSTMENT CALCULATION**

There are no O&M cost adjustments for this measure.

**MEASURE CODE: RS-HWE-PLCV-V01-200101**

**REVIEW DEADLINE: 1/1/2022**

## 5.4.11 Drain Water Heat Recovery

### DESCRIPTION

Drain Water Heat Recovery (DWHR) is a technology that captures waste heat in the drain line during a shower event, using the reclaimed heat to preheat cold water that is then delivered either to the shower or the water heater. The device can be installed in either an equal flow configuration (with preheated water being routed to both the water heater and the shower) or an unequal flow configuration (preheated water directed to either the water heater or shower). The energy harvested from a DWHR device is maximized in an equal flow configuration. It uses a non-regenerative heat exchanger to pre-heat the incoming cold fresh water with the outgoing warm drain water. It has been proven that DWHR devices only recover energy during simultaneous draws,<sup>803</sup> i.e., showers, and that for energy savings purposes all other water draws can be ignored. Savings are calculated per drain water heat recovery unit. Other benefits include increased first-hour rating of water tank, improved comfort due to slower temperature degradation at run-out and reduction of coincident peak demand.<sup>804</sup>

This measure was developed to be applicable to the following program types: RF, NC. If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

Efficient equipment is a DWHR unit retrofitted to the main drain which includes outlets from showers, sinks and other fixtures too. Note, that the DWHR unit can either be installed in a vertical configuration or a horizontal configuration. Although, this measure covers both horizontal and vertical DWHR,<sup>805</sup> the energy savings calculations focuses on vertical. Due to the lack of any moving parts, no maintenance is required for either types of DWHR units. Vertical units are said to comprise 95% of the market currently.<sup>806</sup>

The device can be installed in either an equal flow configuration or an unequal flow configuration. A equal flow installation is ideal with all the incoming cold water passing through the DWHR heat exchanger apparatus, after which it splits into cold water and inlet to water heater. Units should be installed in single-family homes and multi-family homes.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a storage type water heater without DWHR devices in a residential application.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 30 years.<sup>807</sup>

### DEEMED MEASURE COST

The incremental cost for this measure is \$742 per unit.<sup>808</sup>

### LOADSHAPE

Load Shape R03 – Residential Electric DHW

---

<sup>803</sup> Charles Zaloum, John Gusdorf, and Anil Parekh; “Performance Evaluation of Drain Water Heat Recovery Technology at the Canadian Centre for Housing Technology”, January 2007, accessed April 2020.

<sup>804</sup> G.Proskiw, “Technology Profile: Residential Greywater Heat Recovery Systems”, June 1998, accessed April 2020.

<sup>805</sup> 2019 Title 24, Part 6 CASE Report. “Drain Water Heat Recovery – Final Report.”

<sup>806</sup> Ibid

<sup>807</sup> Ibid

<sup>808</sup> Ibid



**COINCIDENCE FACTOR**

The coincidence factor for this measure is assumed to be 2.78%.<sup>809</sup>

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

For electric water heating, annual energy savings per unit are calculated through the following formula:

$$\Delta kWh = \frac{(ShowerTemp - SupplyTemp) \times 8.33 \frac{BTU}{gal \cdot ^\circ F} \times GPM \times T_{shower-length} \times N_{persons} \times N_{units} \times SPCD \times 365.25 \frac{days}{yr} \times SF}{3412 \frac{BTU}{kWh} \times RE}$$

Where:

- ShowerTemp = assumed water temperature during shower  
= 101°F<sup>810</sup>
- SupplyTemp = assumed temperature of cold water entering house  
= 54.1°F<sup>811</sup>
- 8.33 = Energy required (BTU) to heat one gallon of water by one degree Fahrenheit
- GPM = gallon per minute, flow rate of showerhead  
= 2.24 Gallon/minute for direct installed showerheads<sup>812</sup>  
= 2.35 Gallon/minute for retrofit, efficiency kits, NC, or TOS<sup>813</sup>
- T<sub>shower-length</sub> = shower length in minutes  
= 7.8 minute<sup>814</sup>
- N<sub>persons</sub> = average number of people per household

---

<sup>809</sup> Assume coincidence factor for DWHR units is the same with that of low flow showerheads (see 2020 Illinois Statewide Technical Reference Manual for Energy Efficiency, section 5.4.5, low flow showerheads)

<sup>810</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>811</sup> US DOE Building America Program, Building America Analysis Spreadsheet (for Chicago, IL), Office of Energy Efficiency & Renewable Energy.

<sup>812</sup> Based on measurements conducted from June 2013 to January 2014 by Franklin Energy. Over 300 residential sites in the Chicago area were tested.

<sup>813</sup> 2020 Illinois Statewide Technical Reference Manual for Energy Efficiency, section 5.4.5, low flow showerheads

<sup>814</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. This study of 135 single and Multifamily homes in Michigan metered energy parameters for efficient showerhead and faucet aerators.

Household Unit Type	Household
Single-Family - Deemed	2.56 <sup>815</sup>
Multi-Family – Deemed	2.1 <sup>816</sup>
Household type unknown	2.42 <sup>817</sup>

$N_{units}$  = Number of units in a multifamily building with drains connected to the DWHR unit

Household Unit	$N_{units}$
Single-Family	1
Multi-Family	1 or Actual

SPCD = Showers Per Capita Per Day  
= 0.6<sup>818</sup>

365.25 = Days per year, on average.

SF = Water heating energy savings factor  
= 0.4<sup>819</sup>

3,412 = Conversion factor, 1 kWh equals 3,412 BTU

RE = Recovery efficiency of electric water heater  
= 0.98<sup>820</sup> or Actual

**For example,** for electric water heating, DHWR energy savings for a single family home can be calculated as follows:

$$\Delta kWh = \frac{(101 - 54.1) \times 8.33 \times 2.24 \times 7.8 \times 2.56 \times 1 \times 0.6 \times 365.25 \times 0.4}{3,412 \times 0.98}$$

= 458.1 kWh

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / \text{Hours} * CF$$

Where:

<sup>815</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>816</sup> ComEd PY3 Multifamily Evaluation Report REVISED DRAFT v5 2011-12-08.docx (see 2020 Illinois Statewide Technical Reference Manual for Energy Efficiency, section 5.4.5, low flow showerheads)

<sup>817</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>818</sup> Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

<sup>819</sup> Federal Energy Management Program, <Heat Recovery from Wastewater Using a Gravity-Film Exchanger>, “based on our measurements, a 30 to 50% savings in the energy needed to heat shower water seems reasonable.” Here, we adopt an average of 40% as water heating energy savings factor;

<sup>820</sup> Electric water heaters typically have recovery efficiency of 98%.

ΔkWh	= calculated value from above.
Hours	= Annual electric DHW recovery hours for showerhead use = ((GPM * T <sub>shower-length</sub> ) * N <sub>persons</sub> * SPCD * 365.25) * 0.712 <sup>821</sup> / GPH = 255 for SF Direct Installed showerheads; 208 for MF Direct Installed showerheads = 267 for SF Retrofit, Efficiency Kits, NC and TOS showerheads; = 219 for MF Retrofit, Efficiency Kits, NC and TOS showerheads Use Multifamily if: Building meets utility’s definition for multifamily
GPH	= Gallons per hour recovery of electric water heater calculated for 65.9°F temp rise (120-54.1), 98% recovery efficiency, and typical 4.5kW electric resistance storage tank. = 27.4
CF	= Coincidence Factor for electric load reduction = 0.0278

**For example**, DHWR summer coincident peak demand savings for single family home with direct installed showerheads can be calculated as follows:

$$\Delta kW = (458.1 / 255) * 0.0278$$

$$= 0.05 \text{ kW}$$

**NATURAL GAS SAVINGS**

For gas water heating, annual energy savings per unit are calculated through the following formula:

$$\Delta \text{therms} = \frac{(\text{ShowerTemp} - \text{SupplyTemp}) \times 8.33 \frac{\text{BTU}}{\text{gal} \cdot \text{F}} \times \text{GPM} \times T_{\text{shower-length}} \times N_{\text{persons}} \times N_{\text{units}} \times \text{SPCD} \times 365.25 \frac{\text{days}}{\text{yr}} \times \text{SF}}{100,000 \frac{\text{BTU}}{\text{therm}} \times \text{RE}}$$

Where:

- 100,000 = Conversion factor, 1 therm equals 100,000 BTU
- RE = efficiency of gas water heater: 78% for single family<sup>822</sup> and 67% for multi family<sup>823</sup>

**For example**, for gas water heating, DHWR energy savings for single family home can be calculated as follows:

$$\Delta \text{therms} = \frac{(101-54.1) \times 8.33 \times 2.24 \times 7.8 \times 2.56 \times 1 \times 0.6 \times 365.25 \times 0.4}{100,000 \times 0.78}$$

$$= 19.64 \text{ therms}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

---

<sup>821</sup> 71.2% is the proportion of hot 120°F water mixed with 54.1°F supply water to give 101°F shower water.  
<sup>822</sup> DOE Final Rule discusses Recovery Efficiency with an average around 0.76 for Gas Fired Storage Water heaters and 0.78 for standard efficiency gas fired tankless water heaters up to 0.95 for the highest efficiency gas fired condensing tankless water heaters. These numbers represent the range of new units however, not the range of existing units in stock. Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 78%.  
<sup>823</sup> Water heating in Multifamily buildings is often provided by a larger central boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of 0.59 and the 0.75 for single family homes. An average efficiency of 0.67 is used for this analysis as a default for Multifamily buildings.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-DHW-DWHR-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

## 5.5 Lighting End Use

- 5.5.1 Compact Fluorescent Lamp (CFL)—Retired 12/31/2018, Removed in v8
- 5.5.2 ENERGY STAR Specialty Compact Fluorescent Lamp (CFL)—Retired 12/31/2018, Removed in v8
- 5.5.3 ENERGY STAR Torchiere—Retired 12/31/2018, Removed in v8
- 5.5.4 Exterior Hardwired Compact Fluorescent Lamp (CFL) Fixture—Retired 12/31/2018, Removed in v8
- 5.5.5 Interior Hardwired Compact Fluorescent Lamp (CFL) Fixture—Retired 12/31/2018, Removed in v8

## 5.5.6 LED Specialty Lamps

### DESCRIPTION

This measure describes savings from a variety of specialty LED lamp types (including globe, decorative and downlights). This characterization assumes that the LED lamp is installed in a residential location. Where the implementation strategy does not allow for the installation location to be known (e.g., an upstream retail program) a deemed split of 96% Residential and 4% Commercial assumptions should be used.<sup>824</sup>

This measure was developed to be applicable to the following program types: TOS, NC, EREP, KITS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR LED lamp or fixture. Note a new ENERGY STAR specification v2.1 becomes effective on 1/2/2017.

### DEFINITION OF BASELINE EQUIPMENT

Specialty and Directional lamps were not included in the original definition of General Service Lamps in the Energy Independence and Security Act of 2007 (EISA). Therefore, the initial baseline is an incandescent / halogen lamp described in the table below.

A DOE Final Rule released on 1/19/2017 updated the EISA regulations to remove the exemption for these lamp types such that they become subject to the backstop provision defined within the original legislation. However, in September 2019 this decision was revoked in a new DOE Final Rule.

The natural growth of LED market share however, has and will continue to grow over the lifetime of the LED measures installed. The TAC convened a Lamp Forecast Working Group to develop a forecast of the baseline growth of LED, based upon historical growth rates provided via CREED LightTracker data, comparisons of with and no-program states and review of projections provided by the Department of Energy.<sup>825</sup>

This baseline forecast was then used to estimate how replacement lamps would change over the lifetime of an LED. A single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings.

### Income Eligible Program Adjustments

The Lamp Forecast Working Group also developed forecasts for estimated Income Eligible market growth in LEDs. These forecasts are used to provide a separate mid-life adjustment for programs supporting income eligible populations. Note that upstream lighting programs in DIY, Warehouse, and Big Box stores located in income eligible neighborhoods should not assume that all customers are from income eligible populations, as data has indicated that the product selection and low prices found in these stores attract customers from beyond.<sup>826</sup> A weighted blend of the two measure types (Income eligible and non-income eligible) can be used for DIY, Warehouse, and Big Box stores located in income eligible neighborhoods based upon primary evaluation research at these store types, or using a default of 30% income eligible customers.<sup>827</sup>

---

<sup>824</sup> RES v C&I split is based on a weighted (by sales volume) average of ComEd PY8, PY9 and CY2018 in store intercept survey results. See 'RESvCI Split\_2019.xlsx'.

<sup>825</sup> US Department of Energy, "Energy Savings Forecast of Solid State Lighting in General Illumination Applications", December 2019. The resultant forecast is provided on the SharePoint site "Lamp Forecast Workbook.xls".

<sup>826</sup> Navigant and Itron, "CY2018 ComEd Income Eligible Product Discounts – Lighting NTG Recommendations".

<sup>827</sup> 30% of the respondents at the three Income Eligible Program stores where in-store intercepts were conducted met ComEd's income eligible definition; Navigant and Itron, "CY2018 ComEd Income Eligible Product Discounts – Lighting NTG Recommendations".

**New Construction Programs**

Since IECC 2015 energy code, there has been mandatory requirements for lighting in New Construction: “Not less than 75 percent (90 percent in IECC 2018) of the lamps in permanently installed lighting fixtures shall be high-efficacy lamps or not less than 75 percent (90 percent in IECC 2018) of the permanently installed lighting fixtures shall contain only high-efficacy lamps”. To meet the ‘high efficacy’ requirements, lamps need to be CFL or LED, however since CFLs are no longer commonly purchased (only 1% baseline forecast) it is assumed that 75% (IECC 2015) or 90% (IECC 2018) of the New Construction baseline is an LED and therefore savings are reduced by that percentage for bulbs provided in New Construction projects.

**Early Replacement**

The baseline for the early replacement measure is the existing bulb being replaced.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The average rated life for Decorative lamps on the ENERGY STAR Qualified Products list (accessed 6/16/2020) is approximately 17,000 hours, and for Directional Lamps is approximately 25,000 hours.

The deemed measure life is 6.9 years for exterior application of decorative lamps, and lifetimes are capped at 10 years for all other applications.<sup>828</sup>

For early replacement measures, if replacing a halogen or incandescent bulb, the remaining life is assumed to be 333 hours. For CFLs, the remaining life is 3,333 hours.<sup>829</sup>

**DEEMED MEASURE COST**

The price of LED lamps is falling quickly. Where possible, the actual cost should be used and compared to the baseline cost provided below. If the incremental cost is unknown, assume the following:<sup>830</sup>

Bulb Type	Year	Incandescent	LED	Incremental Cost	Incremental Cost for New Construction	Incremental Cost for New Construction
					(IECC 2015)	(IECC 2015)
Directional	2019 and on	\$3.53	\$5.18	\$1.65	\$0.41	\$0.17
Decorative and Globe	2019 and on	\$1.74	\$3.40	\$1.66	\$0.42	\$0.17

**LOADSHAPE**

Loadshape R06 - Residential Indoor Lighting

Loadshape R07 - Residential Outdoor Lighting

**COINCIDENCE FACTOR**

The summer peak coincidence factor is assumed to be 0.109 for residential and in-unit multifamily bulbs,<sup>831</sup> 0.273

<sup>828</sup> Based on recommendation in the Dunsky Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-18.

<sup>829</sup> Representing a third of the expected lamp lifetime.

<sup>830</sup> Baseline and LED lamp costs for both directional and decorative and globe are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis. .

<sup>831</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

for exterior bulbs<sup>832</sup> and 0.117 for unknown<sup>833</sup>. Use Multifamily if the building meets the utility’s definition for multifamily.

---

### Algorithm

---

#### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ((WattsBase - WattsEE) / 1000) * ISR * (1 - Leakage) * Hours * WHFe$$

Where:

Watts<sub>base</sub> = Input wattage of the existing or baseline system. Reference the table below for default values.<sup>834</sup>

Watts<sub>EE</sub> = Actual wattage of LED purchased / installed. If unknown, use default provided below.

---

<sup>832</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for specialty LEDs in exterior applications.

<sup>833</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>834</sup> See file “LED baseline and EE wattage table\_2018.xlsx” for details on lamp wattage calculations.



**Decorative Lamps – ENERGY STAR Minimum Luminous Efficacy = 65Lm/W for all lamps**

Bulb Type	Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage (Watts <sub>EE</sub> )	Baseline (Watts <sub>Base</sub> )	Baseline for New Construction (Watts <sub>Base</sub> )		Delta Watts (Watts <sub>EE</sub> )	Delta Watts for New Construction (Watts <sub>EE</sub> )	
						IECC 2015	IECC 2018		IECC 2015	IECC 2018
<b>3-Way</b>	250	449	350	4.4	25	9.6	6.5	20.6	5.2	2.1
	450	799	625	7.9	40	15.9	11.1	32.1	8.0	3.2
	800	1,099	950	12.1	60	24.1	16.9	47.9	12.0	4.8
	1,100	1,599	1350	17.1	75	31.6	22.9	57.9	14.5	5.8
	1,600	1,999	1800	22.8	100	42.1	30.5	77.2	19.3	7.7
	2,000	2,549	2275	28.9	125	52.9	38.5	96.1	24.0	9.6
	2,550	2,999	2775	35.2	150	63.9	46.7	114.8	28.7	11.5
<b>Globe (medium and intermediate bases less than 750 lumens)</b>	90	179	135	2.1	10	4.1	2.9	7.9	2.0	0.8
	180	249	215	3.3	15	6.2	4.5	11.7	2.9	1.2
	250	349	300	4.6	25	9.7	6.6	20.4	5.1	2.0
	350	749	550	8.5	40	16.4	11.7	31.5	7.9	3.2
<b>Decorative (Shapes B, BA, C, CA, DC, F, G, medium and intermediate bases less than 750 lumens)</b>	70	89	80	1.2	10	3.4	2.1	8.8	2.2	0.9
	90	149	120	1.8	15	5.1	3.1	13.2	3.3	1.3
	150	299	225	3.5	25	8.9	5.7	21.5	5.4	2.2
	300	749	525	8.1	40	16.1	11.3	31.9	8.0	3.2
<b>Globe (candelabra bases less than 1050 lumens)</b>	90	179	135	2.1	10	4.1	2.9	7.9	2.0	0.8
	180	249	215	3.3	15	6.2	4.5	11.7	2.9	1.2
	250	349	300	4.6	25	9.7	6.6	20.4	5.1	2.0
	350	499	425	6.5	40	14.9	9.9	33.5	8.4	3.4
	500	1,049	775	11.9	60	23.9	16.7	48.1	12.0	4.8
<b>Decorative (Shapes B, BA, C, CA, DC, F, G, candelabra bases less than 1050 lumens)</b>	70	89	80	1.2	10	3.4	2.1	8.8	2.2	0.9
	90	149	120	1.8	15	5.1	3.1	13.2	3.3	1.3
	150	299	225	3.5	25	8.9	5.7	21.5	5.4	2.2
	300	499	400	6.1	40	14.6	9.5	33.9	8.5	3.4
	500	1,049	775	11.9	60	23.9	16.7	48.1	12.0	4.8

**Directional Lamps** - ENERGY STAR Minimum Luminous Efficacy = 70Lm/W for <90 CRI lamps and 61 Lm/W for >=90CRI lamps.

For Directional R, BR, and ER lamp types.<sup>835</sup>

<sup>835</sup> From pg. 13 of the ENERGY STAR Specification for lamps v2.1

Bulb Type	Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage (Watts <sub>EE</sub> )	Baseline (Watts <sub>Base</sub> )	Baseline for New Construction (Watts <sub>Base</sub> )		Delta Watts (Watts <sub>EE</sub> )	Delta Watts for New Construction (Watts <sub>EE</sub> )	
						IECC 2015	IECC 2018		IECC 2015	IECC 2018
<b>R, ER, BR with medium screw bases w/ diameter &gt;2.25" (*see exceptions below)</b>	420	472	446	6.6	40	15.0	9.9	33.4	8.4	3.3
	473	524	499	7.3	45	16.7	11.1	37.7	9.4	3.8
	525	714	620	9.1	50	19.3	13.2	40.9	10.2	4.1
	715	937	826	12.1	65	25.3	17.4	52.9	13.2	5.3
	938	1259	1099	16.2	75	30.9	22.1	58.8	14.7	5.9
	1260	1399	1330	19.6	90	37.2	26.6	70.4	17.6	7.0
	1400	1739	1570	23.1	100	42.3	30.8	76.9	19.2	7.7
	1740	2174	1957	28.8	120	51.6	37.9	91.2	22.8	9.1
	2175	2624	2400	35.3	150	64.0	46.8	114.7	28.7	11.5
	2625	2999	2812	41.3	175	74.7	54.7	133.7	33.4	13.4
3000	4500	3750	55.1	200	91.3	69.6	144.9	36.2	14.5	
<b>*R, BR, and ER with medium screw bases w/ diameter &lt;=2.25"</b>	400	449	425	6.2	40	14.7	9.6	33.8	8.5	3.4
	450	499	475	7.0	45	16.5	10.8	38.0	9.5	3.8
	500	649	575	8.5	50	18.9	12.7	41.5	10.4	4.2
	650	1199	925	13.6	65	26.5	18.7	51.4	12.9	5.1
<b>*ER30, BR30, BR40, or ER40</b>	400	449	425	6.2	40	14.7	9.6	33.8	8.5	3.4
	450	499	475	7.0	45	16.5	10.8	38.0	9.5	3.8
	500	649	575	8.5	50	18.9	12.7	41.5	10.4	4.2
<b>*BR30, BR40, or ER40</b>	650	1419	1035	15.2	65	27.7	20.2	49.8	12.5	5.0
<b>*R20</b>	400	449	425	6.2	40	14.7	9.6	33.8	8.5	3.4
	450	719	585	8.6	45	17.7	12.2	36.4	9.1	3.6
<b>*All reflector lamps below lumen ranges specified above</b>	200	299	250	3.7	20	7.8	5.3	16.3	4.1	1.6
	300	399	350	5.1	30	11.3	7.6	24.9	6.2	2.5

For PAR, MR, and MRX Lamps Types:

For these highly focused directional lamp types, it is necessary to have Center Beam Candle Power (CBCP) and beam angle measurements to accurately estimate the equivalent baseline wattage. The formula below is based on the ENERGY STAR Center Beam Candle Power tool.<sup>836</sup> If CBCP and beam angle information are not available or if the equation below returns a negative value (or undefined), use the manufacturer’s recommended baseline wattage equivalent.<sup>837</sup>

Wattsbase =

$$375.1 - 4.355(D) - \sqrt{227,800 - 937.9(D) - 0.9903(D^2) - 1479(BA) - 12.02(D * BA) + 14.69(BA^2) - 16,720 * \ln(CBCP)}$$

Where:

D = Bulb diameter (e.g. for PAR20 D = 20)

<sup>836</sup> See ‘ESLampCenterBeamTool.xls’.

<sup>837</sup> The ENERGY STAR Center Beam Candle Power tool does not accurately model baseline wattages for lamps with certain bulb characteristic combinations – specifically for lamps with very high CBCP.

BA = Beam angle  
 CBCP = Center beam candle power

The result of the equation above should be rounded DOWN to the nearest wattage established by ENERGY STAR:

Diameter	Permitted Wattages
16	20, 35, 40, 45, 50, 60, 75
20	50
30S	40, 45, 50, 60, 75
30L	50, 75
38	40, 45, 50, 55, 60, 65, 75, 85, 90, 100, 120, 150, 250

Additional EISA non-exempt bulb types:

Bulb Type	Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage (Watts <sub>EE</sub> )	Baseline (Watts <sub>Base</sub> )	Baseline for New Construction (Watts <sub>Base</sub> )		Delta Watts (Watts <sub>EE</sub> )	Delta Watts for New Construction (Watts <sub>EE</sub> )	
						IECC 2015	IECC 2018		IECC 2015	IECC 2018
Dimmable Twist, Globe (less than 5" in diameter and > 749 lumens), candle (shapes B, BA, CA > 749 lumens), Candelabra Base Lamps (>1049 lumens), Intermediate Base Lamps (>749 lumens)	310	749	530	6.7	29	12.3	8.9	22.3	5.6	2.2
	750	1049	900	11.4	43	19.3	14.6	31.6	7.9	3.2
	1050	1489	1270	16.1	53	25.3	19.8	36.9	9.2	3.7
	1490	2600	2045	26.0	72	37.5	30.6	46.0	11.5	4.6

ISR = In Service Rate or the percentage of lamps rebated that get installed

Program	Weighted Average 1 <sup>st</sup> year In Service Rate (ISR)	2 <sup>nd</sup> year Installations	3 <sup>rd</sup> year Installations	Final Lifetime In Service Rate
Retail (Time of Sale)	81.5% <sup>838</sup>	8.9%	7.6%	98.0% <sup>839</sup>

<sup>838</sup> 1<sup>st</sup> year in service rate is based upon analysis of ComEd PY8, PY9 and CY2018 intercept data (see 'Res Lighting ISR\_2019.xlsx' for more information).

<sup>839</sup> The 98% Lifetime ISR assumption is based upon the standard CFL measure in the absence of any better reference. This value is based upon review of two evaluations:

'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings.

Program		Weighted Average 1 <sup>st</sup> year In Service Rate (ISR)	2 <sup>nd</sup> year Installations	3 <sup>rd</sup> year Installations	Final Lifetime In Service Rate
Direct Install		94.5% <sup>840</sup>			
Efficiency Kits <sup>841</sup>	LED Distribution <sup>842</sup>	59%	13%	11%	83%
	School Kits <sup>843</sup>	60%	13%	11%	84%
	Direct Mail Kits <sup>844</sup>	66%	14%	12%	93%
	Direct Mail Kits, Income Qualified <sup>845</sup>	68%	15%	12%	95%
	Community Distributed Kits <sup>846</sup>	88%	4%	3%	95%

Leakage = Adjustment to account for the percentage of program bulbs that move out (and in if deemed appropriate)<sup>847</sup> of the Utility Jurisdiction.

KITS programs = Determined through evaluation

Upstream (TOS) Lighting programs = Use deemed assumptions below:<sup>848</sup>

ComEd: 1.1%

Ameren: 13.1%

All other programs = 0

Hours = Average hours of use per year

<sup>840</sup> Consistent with assumption for standard LEDs (in the absence of evidence that it should be different for this bulb type). Based upon average of Navigant low income single family direct install field work LED ISR and review of the PY2 and PY3 ComEd Direct Install program surveys. This value includes bulb failures in the 1st year to be consistent with the Commission approval of annualization of savings for first year savings claims. ComEd PY2 All Electric Single Family Home Energy Performance Tune-Up Program Evaluation, Navigant Consulting, December 21, 2010.

<sup>841</sup> In Service Rates provided are for the bulb within a kit only. Given the significant differences in program design and the level of education provided through Efficiency Kits programs, the evaluators should apply the ISR estimated through evaluations (either past evaluations or the current program year evaluation) of the specific Efficiency Kits program. In cases where program-specific evaluation results for an ISR are unavailable, the default ISR values for Efficiency Kits provide may be used.

<sup>842</sup> Free bulbs provided without request, with little or no education. Consistent with Standard CFL assumptions.

<sup>843</sup> 1<sup>st</sup> year ISR for school kits based on ComEd PY9 data for the Elementary Energy Education program. Final ISR assumptions are based upon comparing with CFL Distribution First year ISR and multiplying by the CFL Distribution Final ISR value, and second and third year estimates based on same proportion of future installs.

<sup>844</sup> Opt-in program to receive kits via mail, with little or no education. Consistent with Standard CFL assumptions.

<sup>845</sup> Research from 2018 Ameren Illinois Income Qualified participant survey.

<sup>846</sup> Kits distributed in a community setting, targeted to income qualified communities. Research from 2018 Ameren Illinois Income Qualified participant survey.

<sup>847</sup> Leakage in is only appropriate to credit to IL utility program savings if it is reasonably expected that the IL utility program marketing efforts played an important role in influencing customer to purchase the light bulbs. Furthermore, consideration that such customers might be free riders should be addressed. If leakage in is assessed, efforts should be made to ensure no double counting of savings occurs if the evaluation is estimating both leakage in and spillover savings of light bulbs.

<sup>848</sup> Leakage rate is based upon review of PY8-CY2018 evaluations from ComEd and PY5,6 and 8 for Ameren.

Installation Location	Annual hours of use (HOU)
Residential and In-Unit Multi Family	763 <sup>849</sup>
Exterior	2,475 <sup>850</sup>
Unknown	1,020 <sup>851</sup>

WHFe = Waste heat factor for energy to account for cooling savings from efficient lighting

Bulb Location	WHFe
Interior single family	1.06 <sup>852</sup>
Multifamily in unit	1.04 <sup>853</sup>
Exterior or uncooled location	1.0
Unknown location	1.046 <sup>854</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

For example, a 13W PAR20 LED is purchased through a ComEd upstream program and installed in place of a 750 lumen PAR20 incandescent screw-in lamp with medium screw base, diameter >2.5" in a single family interior location:

$$\begin{aligned} \Delta kWh &= ((45 - 13) / 1000) * 0.840 * (1 - 0.011) * 763 * 1.06 \\ &= 21.5 kWh \end{aligned}$$

**DEFERRED INSTALLS**

As presented above, the characterization assumes that a percentage of bulbs purchased are not installed until Year 2 and Year 3 (see ISR assumption above). The Illinois Technical Advisory Committee has determined the following methodology for calculating the savings of these future installs.

Year 2 and 3 installs: Characterized using delta watts assumption and hours of use from the Install Year; i.e., the actual deemed assumptions active in Year 2 and 3

<sup>849</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

<sup>850</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. The IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide hours of use for specialty LEDs in exterior applications.

<sup>851</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>852</sup> The value is estimated at 1.06 (calculated as 1 + (0.66\*(0.27 / 2.8)). Based on cooling loads decreasing by 27% of the lighting savings (average result from REMRate modeling of several different configurations and IL locations of homes), assuming typical cooling system operating efficiency of 2.8 COP (starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm (-0.02 \* SEER2) + (1.12 \* SEER) (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to COP = EER/3.412 = 2.8COP) and 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

<sup>853</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from "Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009" which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>854</sup> Unknown is weighted average of interior v exterior (assuming 15% exterior specialty lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

should be applied.

The NTG factor for the Purchase Year (Year 1) should be applied.

**HEATING PENALTY**

If electric heated home (if heating fuel is unknown assume gas, see Natural Gas section):

$$\Delta kWh^{855} = - (((WattsBase - WattsEE) / 1000) * ISR * (1 - Leakage) * Hours * HF) / \eta_{Heat}$$

Where:

- HF = Heating Factor or percentage of light savings that must be heated
  - = 49% for interior location <sup>856</sup>
  - = 0% for exterior location
  - = 42% for unknown location <sup>857</sup>
- $\eta_{Heat}$  = Efficiency in COP of Heating equipment
  - = Actual. If not available use: <sup>858</sup>

System Type	Age of Equipment	HSPF Estimate	COP <sub>HEAT</sub> (COP Estimate) = (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1.00
Unknown <sup>859</sup>	N/A	N/A	1.28

**For example**, a 13W PAR20 LED is purchased through a ComEd upstream program and installed in place of a 750 lumen PAR20 incandescent screw-in lamp with medium screw base, diameter >2.5" in a single family interior location with a 2016 heat pump:

$$\begin{aligned} \Delta kWh &= - (((45 - 13) / 1000) * 0.840 * (1 - 0.011) * 763 * 0.49) / 2.04 \\ &= - 4.87 \text{ kWh} \end{aligned}$$

**Mid-Life Baseline Adjustment**

<sup>855</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>856</sup> This means that heating loads increase by 49% of the lighting savings. This is based on the average result from REMRate modeling of several different configurations and IL locations of homes.

<sup>857</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>858</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

<sup>859</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see "HC6.9 Space Heating in Midwest Region.xls", using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

During the lifetime of an LED, the baseline incandescent/halogen bulb would need to be replaced multiple times. Natural growth of LED market share has, and will continue to grow over the lifetime of the measure, and so a single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings. See ‘Lamp Forecast Workbook\_2020.xls’ for details.

The calculated mid-life adjustments for 2021 are provided below for each population:

Population	Lamp Type	Year from which adjustment is applied	Adjustment Factor applied to Annual kWh Savings
Income Eligible	Decorative	2028	62%
	Directional	2028	70%
All others	Decorative	2025	61%
	Directional	2025	60%

**For example**, a 13W PAR20 LED is purchased through a ComEd upstream program and installed in place of a 750 lumen PAR20 incandescent screw-in lamp with medium screw base, diameter >2.5" in a single family interior location:

$\Delta\text{kWh (2021-2024)} = ((45 - 13) / 1000) * 0.840 * (1 - 0.011) * 763 * 1.06$   
 $= 21.5 \text{ kWh}$

$\Delta\text{kWh (2025 on)} = 21.5 * 0.60$   
 $= 12.9 \text{ kWh}$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = ((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{ISR} * (1 - \text{Leakage}) * \text{WHFd} * \text{CF}$$

Where:

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting.

Bulb Location	WHFd
Interior single family	1.11 <sup>860</sup>
Multifamily in unit	1.07 <sup>861</sup>
Exterior or uncooled location	1.0
Unknown location	1.083 <sup>862</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

CF = Summer Peak Coincidence Factor for measure

<sup>860</sup> The value is estimated at 1.11 (calculated as  $1 + (0.66 * 0.466 / 2.8)$ ). See footnote relating to WHFe for details. Note the 46.6% factor represents the average Residential cooling coincidence factor calculated by dividing average load during the peak hours divided by the maximum cooling load.

<sup>861</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from “Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009” which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>862</sup> Unknown is weighted average of interior v exterior (assuming 15% exterior specialty lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

= 0.109 for residential and in-unit multifamily bulbs<sup>863</sup>, 0.273 for exterior bulbs,<sup>864</sup> and 0.117 for unknown.<sup>865</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

Other factors as defined above

**For example**, a 13W PAR20 LED is purchased through a ComEd upstream program and installed in place of a 750 lumen PAR20 incandescent screw-in lamp with medium screw base, diameter >2.5" in a single family interior location:

$$\begin{aligned} \Delta kW &= (((45 - 13) / 1000) * 0.840 * (1 - 0.011) * 1.11 * 0.109 \\ &= 0.0032 \text{ kW} \end{aligned}$$

### NATURAL GAS SAVINGS

Heating penalty if Natural Gas heated home, or if heating fuel is unknown.

$$\Delta \text{therms} = - (((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{ISR} * (1 - \text{Leakage}) * \text{Hours} * \text{HF} * 0.03412) / \eta \text{Heat}$$

Where:

HF = Heating factor, or percentage of lighting savings that must be replaced by heating system.

= 49% for interior<sup>866</sup>

= 0% for exterior location

= 42% for unknown location<sup>867</sup>

0.03412 = Converts kWh to Therms

$\eta$ Heat = Average heating system efficiency.

= 0.70<sup>868</sup>

Other factors as defined above

<sup>863</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

<sup>864</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for specialty LEDs in exterior applications.

<sup>865</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>866</sup> Average result from REMRate modeling of several different configurations and IL locations of homes

<sup>867</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>868</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey) In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:

$$(0.24 * 0.92) + (0.76 * 0.8) * (1 - 0.15) = 0.70$$



**For example**, a 13W PAR20 LED is purchased through a ComEd upstream program and installed in place of a 750 lumen PAR20 incandescent screw-in lamp with medium screw base, diameter >2.5" in single family interior location with gas heating at 70% total efficiency:

$$\Delta \text{therms} = - ((45 - 13) / 1000) * 0.840 * (1 - 0.011) * 763 * 0.49 * 0.03412 / 0.70$$

$$= - 0.48 \text{ therms}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

Bulb replacement costs assumed in the O&M calculations are provided below:<sup>869</sup>

Lamp Type	Standard Incandescent	EISA Compliant Halogen	CFL	LED
Decorative	\$1.74	\$1.74	\$2.50	\$3.40
Directional	\$3.53	\$3.53	\$4.50	\$5.18

For non-exempt EISA bulb types defined above, in order to account for natural growth of LED over the lifetime of the measure, an equivalent annual levelized baseline replacement cost is calculated and applied over the life of the measure life.

The NPV for replacement lamps and annual levelized replacement costs using the societal real discount rate of 0.42% are presented below:<sup>870</sup>

Lamp Type	Population	Location	NPV of replacement costs for period	Levelized annual replacement cost savings
			2021	2021
Decorative	Income eligible	Residential and in-unit Multi Family, and Unknown	\$13.96	\$1.43
		Exterior	\$20.62	\$3.05
	All others	Residential and in-unit Multi Family, and Unknown	\$12.46	\$1.28
		Exterior	\$18.63	\$2.76
Directional	Income eligible	Residential and in-unit Multi Family, and Unknown	\$28.72	\$2.94
		Exterior	\$60.14	\$6.15
	All others	Residential and in-unit Multi Family, and Unknown	\$24.83	\$2.54
		Exterior	\$51.03	\$5.17

It is important to note that for cost-effectiveness screening purposes, the O&M cost adjustments should only be applied in cases where the light bulbs area actually in service and so should be multiplied by the appropriate ISR.

<sup>869</sup> Baseline costs are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis.

<sup>870</sup> See "Lamp Forecast Workbook\_2020.xlsx" for calculation.

**MEASURE CODE: RS-LTG-LEDD-V12-210101**

**REVIEW DEADLINE: 1/1/2022**

## 5.5.7 LED Exit Signs

### DESCRIPTION

This measure characterizes the savings associated with installing a Light Emitting Diode (LED) exit sign in place of a fluorescent or incandescent exit sign in a Multifamily building within unit (use 4.5.5 Commercial Exit Signs for multifamily common area exit signs). Light Emitting Diode exit signs have a string of very small, typically red or green, glowing LEDs arranged in a circle or oval. The LEDs may also be arranged in a line on the side, top or bottom of the exit sign. LED exit signs provide the best balance of safety, low maintenance, and very low energy usage compared to other exit sign technologies.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be an exit sign illuminated by LEDs.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an existing fluorescent or incandescent model.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 5 years.<sup>871</sup>

### DEEMED MEASURE COST

The actual material and labor costs should be used if available. If actual costs are unavailable, assume a total installed cost of at \$32.50.<sup>872</sup>

### LOADSHAPE

Loadshape C53 - Flat

### COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 100%.<sup>873</sup>

---



---

### Algorithm

---

### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ((WattsBase - WattsEE) / 1000) * HOURS * WHF_e$$

Where:

WattsBase = Actual wattage if known, if unknown assume the following:

---

<sup>871</sup> Estimate of remaining life of existing unit being replaced.

<sup>872</sup> Price includes new exit sign/fixture and installation. LED exit cost/unit is \$22.50 from the NYSERDA Deemed Savings Database and assuming 1 labor cost of 15 minutes @ \$40/hr.

<sup>873</sup> Assuming continuous operation of an LED exit sign, the Summer Peak Coincidence Factor is assumed to equal 1.0.

Baseline Type	Watts <sub>Base</sub>
Incandescent	35W <sup>874</sup>
CFL (dual sided)	14W <sup>875</sup>
CFL (single sided)	7W
Unknown	7W

Watts<sub>EE</sub> = Actual wattage if known, if singled sided or unknown assume 2W, if dual sided assume 4W.<sup>876</sup>

HOURS = Annual operating hours  
= 8766

WHF<sub>e</sub> = Waste heat factor for energy; accounts for cooling savings from efficient lighting.  
= 1.04<sup>877</sup>

Default if replacing incandescent fixture

$$\Delta\text{kWh} = (35 - 2)/1000 * 8766 * 1.04$$

$$= 301 \text{ kWh}$$

Default if replacing dual sided fluorescent fixture

$$\Delta\text{kWh} = (14 - 4)/1000 * 8766 * 1.04$$

$$= 91 \text{ kWh}$$

Default if replacing single sided fluorescent (or unknown) fixture

$$\Delta\text{kWh} = (7 - 2)/1000 * 8766 * 1.04$$

$$= 46 \text{ kWh}$$

### HEATING PENALTY

If electric heated home (if heating fuel is unknown assume gas, see Natural Gas section):

$$\Delta\text{kWh}^{878} = -(((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{Hours} * \text{HF}) / \eta_{\text{Heat}}$$

Where:

HF = Heating Factor or percentage of light savings that must be heated  
= 49%<sup>879</sup>

<sup>874</sup> Based on review of available product.

<sup>875</sup> Average CFL single sided (5W, 7W, 9W) from Appendix B 2013-14 Table of Standard Fixture Wattages.

<sup>876</sup> Average LED single sided (2W) from Appendix B 2013-14 Table of Standard Fixture Wattages.

<sup>877</sup> The value is estimated at 1.04 (calculated as  $1 + (0.45 * (0.27 / 2.8))$ ). Based on cooling loads decreasing by 27% of the lighting savings (average result from REMRate modeling of several different configurations and IL locations of homes), assuming typical cooling system operating efficiency of 3.1 COP (starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm  $(-0.02 * \text{SEER}2) + (1.12 * \text{SEER})$  (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to  $\text{COP} = \text{EER}/3.412 = 2.8\text{COP}$ ) and estimate of 45% of multi family buildings in Illinois having central cooling (based on data from "Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009" which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>878</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>879</sup> This means that heating loads increase by 49% of the lighting savings. This is based on the average result from REMRate modeling of several different configurations and IL locations of homes.

$\eta_{\text{Heat}}$  = Efficiency in COP of Heating equipment  
 = Actual. If not available use: <sup>880</sup>

System Type	Age of Equipment	HSPF Estimate	$\text{COP}_{\text{HEAT}}$ (COP Estimate) = (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1.00
Unknown <sup>881</sup>	N/A	N/A	1.28

**For example**, a 2.0 COP (including duct loss) Heat Pump heated building:

If incandescent fixture:  $\Delta\text{kWh} = -((35 - 2)/1000 * 8766 * 0.49) / 2$   
 $= -71 \text{ kWh}$

If unknown fixture  $\Delta\text{kWh} = -((7 - 2)/1000 * 8766 * 0.49) / 2$   
 $= -10.7 \text{ kWh}$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = ((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{WHF}_d * \text{CF}$$

Where:

$\text{WHF}_d$  = Waste heat factor for demand to account for cooling savings from efficient lighting. The cooling savings are only added to the summer peak savings.  
 $= 1.07^{882}$

CF = Summer Peak Coincidence Factor for measure  
 $= 1.0$

Default if incandescent fixture

$$\Delta\text{kW} = (35 - 2)/1000 * 1.07 * 1.0$$

$$= 0.035 \text{ kW}$$

Default if dual sided fluorescent fixture

$$\Delta\text{kW} = (14 - 4)/1000 * 1.07 * 1.0$$

$$= 0.0107 \text{ kW}$$

<sup>880</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

<sup>881</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see "HC6.9 Space Heating in Midwest Region.xls", using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

<sup>882</sup> The value is estimated at 1.11 (calculated as  $1 + (0.45 * 0.466 / 2.8)$ ). See footnote relating to WHFe for details. Note the 46.6% factor represents the average Residential cooling coincidence factor calculated by dividing average load during the peak hours divided by the maximum cooling load.

Default if single sided fluorescent fixture

$$\begin{aligned}\Delta kW &= (7 - 2) / 1000 * 1.07 * 1.0 \\ &= 0.0054 \text{ kW}\end{aligned}$$

### NATURAL GAS SAVINGS

Heating penalty if Natural Gas heated building, or if heating fuel is unknown.

$$\Delta \text{Therms} = - (((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{Hours} * \text{HF} * 0.03412) / \eta_{\text{Heat}}$$

Where:

- HF = Heating factor, or percentage of lighting savings that must be replaced by heating system.  
= 49%<sup>883</sup>
- 0.03412 = Converts kWh to Therms
- $\eta_{\text{Heat}}$  = Average heating system efficiency.  
= 0.70<sup>884</sup>

Other factors as defined above

Default if incandescent fixture

$$\begin{aligned}\Delta \text{Therms} &= - (((35 - 2) / 1000) * 8766 * 0.49 * 0.03412) / 0.70 \\ &= -6.9 \text{ therms}\end{aligned}$$

Default if dual sided fluorescent fixture

$$\begin{aligned}\Delta \text{Therms} &= - (((14 - 4) / 1000) * 8766 * 0.49 * 0.03412) / 0.70 \\ &= -2.1 \text{ therms}\end{aligned}$$

Default if single sided fluorescent fixture

$$\begin{aligned}\Delta \text{Therms} &= - (((7 - 2) / 1000) * 8766 * 0.49 * 0.03412) / 0.70 \\ &= -1.05 \text{ therms}\end{aligned}$$

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

---

<sup>883</sup> Average result from REMRate modeling of several different configurations and IL locations of homes

<sup>884</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey) In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:  
 $(0.24 * 0.92) + (0.76 * 0.8) * (1 - 0.15) = 0.70$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

The annual O&M Cost Adjustment savings should be calculated using the following component costs and lifetimes.

Component	Baseline Measures	
	Cost	Life (yrs)
Lamp	\$12.45 <sup>885</sup>	1.37 years <sup>886</sup>

**MEASURE CODE: RS-LTG-LEDE-V03-190101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>885</sup> Consistent with assumption for a Standard CFL bulb (\$2.45) with an estimated labor cost of \$10 (assuming \$40/hour and a task time of 15 minutes).

<sup>886</sup> Assumes a lamp life of 12,000 hours and 8766 run hours  $12000/8766 = 1.37$  years.

## 5.5.8 LED Screw Based Omnidirectional Bulbs

### DESCRIPTION

This characterization provides savings assumptions for LED Screw Based Omnidirectional (e.g., A-Type lamps) lamps within the residential and multifamily sectors. This characterization assumes that the LED lamp is installed in a residential location. Where the implementation strategy does not allow for the installation location to be known (e.g., an upstream retail program) a deemed split of 97% Residential and 3% Commercial assumptions should be used.<sup>887</sup>

This measure was developed to be applicable to the following program types: TOS, NC, EREP, DI, KITS.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, new lamps must be ENERGY STAR labeled. Note a new ENERGY STAR specification v2.1 became effective on 1/2/2017.

### DEFINITION OF BASELINE EQUIPMENT

In 2012, Federal legislation stemming from the Energy Independence and Security Act of 2007 (EISA) will require all general-purpose light bulbs between 40 watts and 100 watts to have ~30% increased efficiency, essentially phasing out standard incandescent technology. In 2012, the 100 w lamp standards apply; in 2013 the 75 w lamp standards will apply, followed by restrictions on the 60 w and 40 w lamps in 2014. Since measures installed under this TRM all occur after 2014, baseline equipment are the values after EISA. These are shown in the baseline table below.

Additionally, an EISA backstop provision was included that would require replacement baseline lamps to meet an efficacy requirement of 45 lumens/watt or higher beginning on 1/1/2020. However, in December 2019, DOE issued a final determination for General Service Incandescent Lamps (GSILs), finding that this more stringent standard was not economically justified.

The natural growth of LED market share however, has and will continue to grow over the lifetime of the LED measures installed. The TAC convened a Lamp Forecast Working Group to develop a forecast of the baseline growth of LED, based upon historical growth rates provided via CREED LightTracker data, comparisons of with and no-program states and review of projections provided by the Department of Energy.<sup>888</sup>

This baseline forecast was then used to estimate how replacement lamps would change over the lifetime of an LED. A single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings.

### Income Eligible Program Adjustments

The Lamp Forecast Working Group also developed forecasts for estimated Income Eligible market growth in LEDs. These forecasts are used to provide a separate mid-life adjustment for programs supporting income eligible populations. Note that upstream lighting programs in DIY, Warehouse, and Big Box stores located in income eligible neighborhoods should not assume that all customers are from income eligible populations, as data has indicated that the product selection and low prices found in these stores attract customers from beyond.<sup>889</sup> A weighted blend of the two measure types (Income eligible and non-income eligible) can be used for DIY, Warehouse, and Big Box stores located in income eligible neighborhoods based upon primary evaluation research at these store types, or

---

<sup>887</sup> RES v C&I split is based on a weighted (by sales volume) average of ComEd PY8, PY9 and CY2018 and Ameren PY8 in store intercept survey results. See 'RESvCI\_Split\_2019.xlsx'.

<sup>888</sup> US Department of Energy, "Energy Savings Forecast of Solid State Lighting in General Illumination Applications", December 2019. The resultant forecast is provided on the SharePoint site "Lamp Forecast Workbook.xls".

<sup>889</sup> Navigant and Itron, "CY2018 ComEd Income Eligible Product Discounts – Lighting NTG Recommendations".



using a default of 30% income eligible customers.<sup>890</sup>

**New Construction Programs**

Since IECC 2015 energy code, there has been mandatory requirements for lighting in New Construction: “Not less than 75 percent (90 percent in IECC 2018) of the lamps in permanently installed lighting fixtures shall be high-efficacy lamps or not less than 75 percent (90 percent in IECC 2018) of the permanently installed lighting fixtures shall contain only high-efficacy lamps”. To meet the ‘high efficacy’ requirements, lamps need to be CFL or LED, however since CFLs are no longer commonly purchased (only 1% baseline forecast) it is assumed that 75% (IECC 2015) or 90% (IECC 2018) of the New Construction baseline is an LED and therefore savings are reduced by that percentage for bulbs provided in New Construction projects.

**Early Replacement**

The baseline for the early replacement measure is the existing bulb being replaced.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The average rated life for Omnidirectional lamps on the ENERGY STAR Qualified Products list (accessed 6/16/2020) is approximately 20,000 hours.

The deemed measure life is 8 years for exterior application and lifetimes are capped at 10 years for other applications.<sup>891</sup>

For early replacement measures, if replacing a halogen or incandescent bulb, the remaining life is assumed to be 333 hours. For CFL’s, the remaining life is 3,333 hours.<sup>892</sup>

**DEEMED MEASURE COST**

The price of LED lamps is falling quickly. Where possible, the actual LED lamp cost should be used and compared to the baseline cost provided below. If the incremental cost is unknown, assume the following:<sup>893</sup>

Year	EISA Compliant Halogen	LED A-Lamp	Incremental Cost	Incremental Cost for New Construction	
				(IECC 2015)	(IECC 2018)
2020 and on	\$1.25	\$2.70	\$1.45	\$0.36	\$0.15

**LOADSHAPE**

Loadshape R06 – Residential Indoor Lighting

Loadshape R07 – Residential Outdoor Lighting

**COINCIDENCE FACTOR**

The summer peak coincidence factor is assumed to be 0.128 for Residential and in-unit Multi Family bulbs,<sup>894</sup> 0.273

<sup>890</sup> 30% of the respondents at the three Income Eligible Program stores where in-store intercepts were conducted met ComEd’s income eligible definition; Navigant and Itron, “CY2018 ComEd Income Eligible Product Discounts – Lighting NTG Recommendations”.

<sup>891</sup> Based on recommendation in the Dunsky Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-18.

<sup>892</sup> Representing a third of the expected lamp lifetime.

<sup>893</sup> Baseline and LED lamp costs are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis.

<sup>894</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

for exterior bulbs,<sup>895</sup> and 0.135 for unknown,<sup>896</sup>

Use Multifamily if: Building meets utility’s definition for multifamily.

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * ISR * (1 - Leakage) * Hours * WHF_e$$

Where:

Watts<sub>base</sub> = Input wattage of the existing or baseline system. Reference the “LED New and Baseline Assumptions” table for default values.

Watts<sub>EE</sub> = Actual wattage of LED purchased / installed. If unknown, use default provided below:<sup>897</sup>

**LED New and Baseline Assumptions Table**

Minimum Lumens	Maximum Lumens	Lumens used to calculate LED Wattage (midpoint)	LED Wattage <sup>898</sup> (WattsEE)	Baseline (WattsBase)	Baseline for New Construction (WattsBase)		Delta Watts (WattsEE)	Delta Watts for New Construction (WattsEE)	
					(IECC 2015)	(IECC 2018)		(IECC 2015)	(IECC 2018)
5280	6209	5745	72.9	300.0	129.7	95.6	227.1	56.8	22.7
3301	5279	4290	54.5	200.0	90.9	69.1	145.5	36.4	14.6
2601	3300	2951	37.5	150.0	65.6	48.8	112.5	28.1	11.3
1490	2600	2045	26.0	72.0	37.5	30.6	46.0	11.5	4.6
1050	1489	1270	16.1	53.0	25.3	19.8	36.9	9.2	3.7
750	1049	900	11.4	43.0	19.3	14.6	31.6	7.9	3.2
310	749	530	6.7	29.0	12.3	8.9	22.3	5.6	2.2
250	309	280	3.5	25.0	8.9	5.7	21.5	5.4	2.2

ISR = In Service Rate, the percentage of lamps rebated that are actually in service.

<sup>895</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for screw-based omnidirectional LEDs in exterior applications.

<sup>896</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>897</sup> See file “LED baseline and EE wattage table\_2018.xlsx” for details on lamp wattage calculations.

<sup>898</sup> Based on ENERGY STAR V2.1 specs – for omnidirectional <90CRI: 80 lm/W and for omnidirectional >=90 CRI: 70 lm/W. To weight these two criteria, the ENERGY STAR qualified list was reviewed and found to contain 87.8% lamps <90CRI and 12.2% >=90CRI.

Program		Weighted Average 1 <sup>st</sup> year In Service Rate (ISR)	2 <sup>nd</sup> year Installations	3 <sup>rd</sup> year Installations	Final Lifetime In Service Rate <sup>899</sup>
Retail (Time of Sale)		76.0% <sup>900</sup>	11.9%	10.1%	98.0% <sup>901</sup>
Direct Install		94.5% <sup>902</sup>			
Efficiency Kits <sup>903</sup>	LED Distribution <sup>904</sup>	59%	13%	11%	83%
	School Kits <sup>905</sup>	60%	13%	11%	84%
	Direct Mail Kits <sup>906</sup>	66%	14%	12%	93%
	Direct Mail Kits, Income Qualified <sup>907</sup>	68%	15%	12%	95%
	Community Distributed Kits <sup>908</sup>	88%	4%	3%	95%
Food Bank / Pantry Distribution <sup>909</sup>		80.3% <sup>910</sup>	9.6%	8.1%	98% <sup>911</sup>

Leakage = Adjustment to account for the percentage of program bulbs that move out (and in if deemed appropriate)<sup>912</sup> of the Utility Jurisdiction.

<sup>899</sup> Final ISR assumptions for efficiency kits are based upon comparing with CFL Distribution First year ISR and multiplying by the CFL Distribution Final ISR value, capped at 95%, and second and third year estimates based on same proportion of future installs. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings.

<sup>900</sup> 1<sup>st</sup> year in service rate is based upon analysis of ComEd PY8, PY9 and CY2018 and Ameren PY8 intercept data (see 'RES Lighting ISR\_2019.xlsx' for more information).

<sup>901</sup> The 98% Lifetime ISR assumption is based upon the standard CFL measure in the absence of any better reference. This value is based upon review of two evaluations:

'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report; Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed.

<sup>902</sup> Based upon average of Navigant low income single family direct install field work LED ISR and Standard CFL assumption in the absence of better data, and is based upon review of the PY2 and PY3 ComEd Direct Install program surveys. This value includes bulb failures in the 1st year to be consistent with the Commission approval of annualization of savings for first year savings claims. ComEd PY2 All Electric Single Family Home Energy Performance Tune-Up Program Evaluation, Navigant Consulting, December 21, 2010.

<sup>903</sup> In Service Rates provided are for the bulb within a kit only. Given the significant differences in program design and the level of education provided through Efficiency Kits programs, the evaluators should apply the ISR estimated through evaluations (either past evaluations or the current program year evaluation) of the specific Efficiency Kits program. In cases where program-specific evaluation results for an ISR are unavailable, the default ISR values for Efficiency Kits provide may be used.

<sup>904</sup> Free bulbs provided without request, with little or no education. Consistent with Standard CFL assumptions.

<sup>905</sup> 1<sup>st</sup> year ISR for school kits based on ComEd PY9 data for the Elementary Energy Education program. Final ISR assumptions are based upon comparing with CFL Distribution First year ISR and multiplying by the CFL Distribution Final ISR value, and second and third year estimates based on same proportion of future installs.

<sup>906</sup> Opt-in program to receive kits via mail, with little or no education. Consistent with Standard CFL assumptions.

<sup>907</sup> Research from 2018 Ameren Illinois Income Qualified participant survey.

<sup>908</sup> Kits distributed in a community setting, targeted to income qualified communities. Research from 2018 Ameren Illinois Income Qualified participant survey.

<sup>909</sup> Free bulbs provided through local food banks and food pantries.

<sup>910</sup> 1<sup>st</sup> year ISR is determined based on online surveys conducted for ComEd CY2018 Food Bank LED Distribution program. See 'CY2018 ComEd Foodbank LED Dist Survey Results\_Navigant'.

<sup>911</sup> In the absence of any program specific data, 98% lifetime ISR assumption is made based on similarity between 1<sup>st</sup> year ISR values with the Retail (Time of Sale) program and the 2<sup>nd</sup> and 3<sup>rd</sup> year installations are scaled accordingly.

<sup>912</sup> Leakage in is only appropriate to credit to IL utility program savings if it is reasonably expected that the IL utility program marketing efforts played an important role in influencing customer to purchase the light bulbs. Furthermore, consideration that such customers might be free riders should be addressed. If leakage in is assessed, efforts should be made to ensure no double

KITS programs = Determined through evaluation

Upstream (TOS) Lighting programs = Use deemed assumptions below:<sup>913</sup>

ComEd: 0.8%  
Ameren: 13.1%

All other programs = 0

Hours = Average hours of use per year

Installation Location	Hours
Residential and in-unit Multi Family	1,089 <sup>914</sup>
Exterior	2,475 <sup>915</sup>
Unknown	1,159 <sup>916</sup>

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting

Bulb Location	WHFe
Interior single family	1.06 <sup>917</sup>
Multifamily in unit	1.04 <sup>918</sup>
Exterior or uncooled location	1.0
Unknown location	1.051 <sup>919</sup>

counting of savings occurs if the evaluation is estimating both leakage in and spillover savings of light bulbs.

<sup>913</sup> Leakage rate is based upon review of PY8-CY2018 evaluations from ComEd and PY8 for Ameren.

<sup>914</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

<sup>915</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. The IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide hours of use for screw-based omnidirectional LEDs in exterior applications.

<sup>916</sup> Based on a weighted average of hours of use in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>917</sup> The value is estimated at 1.06 (calculated as  $1 + (0.66 * (0.27 / 2.8))$ ). Based on cooling loads decreasing by 27% of the lighting savings (average result from REMRate modeling of several different configurations and IL locations of homes), assuming typical cooling system operating efficiency of 2.8 COP (starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm  $(-0.02 * SEER2) + (1.12 * SEER)$  (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to  $COP = EER/3.412 = 2.8COP$ ) and 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

<sup>918</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from "Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009" which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>919</sup> Unknown is weighted average of interior v exterior (assuming 5% exterior lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

**For example**, an 8W LED lamp, 450 lumens, is installed in the interior of a home. The customer purchased the lamp through a ComEd upstream program:

$$\begin{aligned} \Delta\text{kWh} &= ((29.0 - 6.7) / 1000) * 0.784 * (1 - 0.008) * 1,089 * 1.06 \\ &= 20.0 \text{ kWh} \end{aligned}$$

### DEFERRED INSTALLS

As presented above, the characterization assumes that a percentage of bulbs purchased are not installed until Year 2 and Year 3 (see ISR assumption above). The Illinois Technical Advisory Committee has determined the following methodology for calculating the savings of these future installs.

Year 2 and 3 installs: Characterized using delta watts assumption and hours of use from the Install Year; i.e., the actual deemed assumptions active in Year 2 and 3 should be applied.

The NTG factor for the Purchase Year should be applied.

**For example:** using the assumptions from above, for an 8W LED, 450 Lumens purchased for the interior of a residential homes through a ComEd upstream program.

$$\begin{aligned} \Delta\text{kWh}_{2\text{nd year installs}} &= ((29 - 6.7)/1000) * 0.106 * (1 - 0.008) * 1,089 * 1.06 \\ &= 2.7 \text{ kWh} \\ \Delta\text{kWh}_{3\text{rd year installs}} &= ((29 - 6.7)/1000) * 0.09 * (1 - 0.008) * 1,089 * 1.06 \\ &= 2.3 \text{ kWh} \end{aligned}$$

Note: Here we assume no change in hours assumption. NTG value from Purchase year should be applied.

### HEATING PENALTY

If electric heated home (if heating fuel is unknown assume gas, see Natural Gas section):

$$\Delta\text{kWh}^{920} = -(((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{ISR} * (1 - \text{Leakage}) * \text{Hours} * \text{HF}) / \eta\text{Heat}$$

Where:

HF = Heating Factor or percentage of light savings that must be heated  
 = 49% for interior<sup>921</sup>  
 = 0% for exterior or unheated location  
 = 42% for unknown location<sup>922</sup>

$\eta\text{Heat}$  = Efficiency in COP of Heating equipment  
 = actual. If not available use:<sup>923</sup>

<sup>920</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>921</sup> This means that heating loads increase by 49% of the lighting savings. This is based on the average result from REMRate modeling of several different configurations and IL locations of homes.

<sup>922</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>923</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely

System Type	Age of Equipment	HSPF Estimate	COP <sub>HEAT</sub> (COP Estimate) = (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1.00
Unknown <sup>924</sup>	N/A	N/A	1.28

**For example:** using the same 8 W LED that is installed in home with 2.0 COP Heat Pump (including duct loss) through a ComEd upstream program:

$$\begin{aligned} \Delta\text{kWh}_{1\text{st year}} &= - ((29 - 6.7) / 1000) * 0.784 * (1 - 0.008) * 1,089 * 0.42) / 2.0 \\ &= - 4.0 \text{ kWh} \end{aligned}$$

Second and third year install savings should be calculated using the appropriate ISR and the delta watts and hours from the install year.

### Mid-Life Baseline Adjustment

During the lifetime of a standard Omnidirectional LED, the baseline incandescent/halogen bulb would need to be replaced multiple times. In December 2019, DOE issued a final determination for General Service Incandescent Lamps (GSILs), finding that the more stringent standards (45 lumen per watt) prescribed in the 2007 EISA regulation to become effective in 2020 (known as the ‘Backstop’ provision), was not economically justified. However, natural growth of LED market share has, and will continue to grow over the lifetime of the measure, and so a single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings. See ‘Lamp Forecast Workbook\_2020.xls’ for details.

The calculated mid-life adjustments for 2021 are provided below for each population:

Population	Year from which adjustment is applied	Adjustment Factor applied to Annual kWh Savings
Income Eligible	2028	57%
All others	2025	38%

**For example,** an 8W LED lamp, 450 lumens, is installed in the interior of a home. The customer purchased the lamp through a ComEd upstream program:

$$\begin{aligned} \Delta\text{kWh (2021-2024)} &= ((29.0 - 6.7) / 1000) * 0.784 * (1 - 0.008) * 1,089 * 1.06 \\ &= 20.0 \text{ kWh} \\ \Delta\text{kWh (2025 on)} &= 20.0 * 0.38 \\ &= 7.6 \text{ kWh} \end{aligned}$$

degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

<sup>924</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{ISR} * (1 - \text{Leakage}) * \text{WHFd} * \text{CF}$$

Where:

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting.

Bulb Location	WHFd
Interior single family	1.11 <sup>925</sup>
Multifamily in unit	1.07 <sup>926</sup>
Exterior or uncooled location	1.0
Unknown location	1.093 <sup>927</sup>

CF = Summer Peak Coincidence Factor for measure.

Bulb Location	CF
Interior	0.128 <sup>928</sup>
Exterior	0.273 <sup>929</sup>
Unknown	0.135 <sup>930</sup>

Other factors as defined above

**For example:** for the same 8 W LED that is installed in a single family interior location through a ComEd upstream program:

$$\begin{aligned} \Delta kW &= ((29 - 6.7) / 1000) * 0.784 * (1 - 0.008) * 1.11 * 0.128 \\ &= 0.0025 \text{ kW} \end{aligned}$$

Second and third year install savings should be calculated using the appropriate ISR and the delta watts and hours from the install year.

**NATURAL GAS SAVINGS**

Heating penalty if Natural Gas heated home, or if heating fuel is unknown.

$$\Delta \text{Therms} = - (((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{ISR} * (1 - \text{Leakage}) * \text{Hours} * \text{HF} * 0.03412) / \eta \text{Heat}$$

<sup>925</sup> The value is estimated at 1.11 (calculated as 1 + (0.66 \* 0.466 / 2.8)). See footnote relating to WHFe for details. Note the 46.6% factor represents the average Residential cooling coincidence factor calculated by dividing average load during the peak hours divided by the maximum cooling load.

<sup>926</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from “Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009” which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>927</sup> Unknown is weighted average of interior v exterior (assuming 5% exterior lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>928</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

<sup>929</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for screw-based omnidirectional LEDs in exterior applications.

<sup>930</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

Where:

HF	= Heating factor, or percentage of lighting savings that must be replaced by heating system.
	= 49% for interior <sup>931</sup>
	= 0% for exterior location
	= 42% for unknown location <sup>932</sup>
0.03412	= Converts kWh to Therms
$\eta_{\text{Heat}}$	= Average heating system efficiency.
	= 0.70 <sup>933</sup>

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

In order to account for the natural growth of LED over the lifetime of the measure, an equivalent annual levelized baseline replacement cost is calculated and applied over the life of the measure as described above.

The NPV for replacement lamps and annual levelized replacement costs using the societal real discount rate of 0.42% are presented below.<sup>934</sup> It is important to note that for cost-effectiveness screening purposes, the O&M cost adjustments should only be applied in cases where the light bulbs area actually in service and so should be multiplied by the appropriate ISR:

---

<sup>931</sup> Average result from REMRate modeling of several different configurations and IL locations of homes

<sup>932</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>933</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey) In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:

$(0.24 \times 0.92) + (0.76 \times 0.8) \times (1 - 0.15) = 0.70$

<sup>934</sup> See "Lamp Forecast Workbook\_2020.xlsx" for calculation.



Population	Location	NPV of replacement costs for period	Levelized annual replacement cost savings
		2021	2021
Income eligible	Residential and in-unit Multi Family, and Unknown	\$9.97	\$1.02
	Exterior	\$16.66	\$2.12
All others	Residential and in-unit Multi Family, and Unknown	\$7.83	\$0.80
	Exterior	\$9.97	\$1.02

**MEASURE CODE: RS-LTG-LEDA-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

## 5.5.9 LED Fixtures

### DESCRIPTION

This characterization provides savings assumptions for LED Fixtures and is broken into four ENERGY STAR fixture types: Indoor Fixtures (including track lighting, wall-wash, sconces, ceiling and fan lights), Task and Under Cabinet Fixtures, Outdoor Fixtures (including flood light, hanging lights, security/path lights, outdoor porch lights), and Downlight Fixtures.

For upstream programs, utilities should develop an assumption of the residential v commercial split and apply the relevant assumptions to each portion. A default deemed split of 97% Residential and 3% Commercial assumptions can be used based on Omnidirectional Bulbs.<sup>935</sup>

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, new fixtures must be ENERGY STAR labeled based upon the v2.1 ENERGY STAR specification for luminaires. Specifications are as follows:

Fixture Category	Lumens/Watt
Indoor	65
Task and Under Cabinet	50
Outdoor	60
Downlight	55

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition for this measure is assumed to be an average of EISA-equivalent wattages for ENERGY STAR-qualified products. Most of the lamp types in this measure are considered specialty so the baseline adjustments are consistent with the 5.5.6 LED Specialty Lamps.

Specialty and Directional lamps were not included in the original definition of General Service Lamps in the Energy Independence and Security Act of 2007 (EISA). Therefore, the initial baseline is an incandescent / halogen lamp described in the tables below.

A DOE Final Rule released on 1/19/2017 updated the EISA regulations to remove the exemption for these lamp types such that they become subject to the backstop provision defined within the original legislation. However, in September 2019 this decision was revoked in a DOE Final Rule.

The natural growth of LED market share however, has and will continue to grow over the lifetime of the LED measures installed. The TAC convened a Lamp Forecast Working Group to develop a forecast of the baseline growth of LED, based upon historical growth rates provided via CREED LightTracker data, comparisons of with and no-program states and review of projections provided by the Department of Energy.<sup>936</sup>

This baseline forecast was then used to estimate how replacement lamps would change over the lifetime of an LED. A single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast decline in annual savings.

<sup>935</sup> RES v C&I split is based on a weighted (by sales volume) average of ComEd PY7, PY8 and PY9 and Ameren PY8 in store intercept survey results. See 'RESvCI Split\_2018.xlsx'.

<sup>936</sup> US Department of Energy, "Energy Savings Forecast of Solid State Lighting in General Illumination Applications", December 2019. The resultant forecast is provided on the SharePoint site "Lamp Forecast Workbook.xls".

### Income Eligible Program Adjustments

The Lamp Forecast Working Group also developed forecasts for estimated Income Eligible market growth in LEDs. These forecasts are used to provide a separate mid-life adjustment for programs supporting income eligible populations. Note that upstream lighting programs in DIY, Warehouse, and Big Box stores located in income eligible neighborhoods should not assume that all customers are from income eligible populations, as data has indicated that the product selection and low prices found in these stores attract customers from beyond.<sup>937</sup> A weighted blend of the two measure types (Income eligible and non-income eligible) can be used for DIY, Warehouse, and Big Box stores located in income eligible neighborhoods based upon primary evaluation research at these store types, or using a default of 30% income eligible customers.<sup>938</sup>

### New Construction Programs

Since IECC 2015 energy code, there has been mandatory requirements for lighting in New Construction: *“Not less than 75 percent (90 percent in IECC 2018) of the lamps in permanently installed lighting fixtures shall be high-efficacy lamps or not less than 75 percent (90 percent in IECC 2018) of the permanently installed lighting fixtures shall contain only high-efficacy lamps”*. To meet the ‘high efficacy’ requirements, lamps need to be CFL or LED, however since CFLs are no longer commonly purchased (only 1% baseline forecast) it is assumed that 75% (IECC 2015) or 90% (IECC 2018) of the New Construction baseline is an LED and therefore savings are reduced by that percentage for bulbs provided in New Construction projects.

### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The lifetime of a fixture is a function of its rated life and average hours of use. The rated life is 47,000 hours for indoor and downlight, 45,000 for task and cabinet, and 49,000 for outdoor fixtures.<sup>939</sup> This would imply a lifetime of 51 years for indoor and downlight, 62 years for task and under cabinet, and 20 years for outdoor fixtures. However, all fixture lifetimes are capped at 15 years,<sup>940</sup> so a 15 year measure life should be assumed.

### **DEEMED MEASURE COST**

Wherever possible, actual incremental costs should be used. If unavailable, assume the following incremental costs:

Fixture Category	Incremental Cost	Incremental Cost for New Construction	
		(IECC 2015)	(IECC 2018)
Indoor	\$26 <sup>941</sup>	\$6.50	\$2.60
Task /Under Cabinet	\$18 <sup>942</sup>	\$4.50	\$1.80
Outdoor	\$26	\$6.50	\$2.60
Downlight	\$13	\$3.25	\$1.30

<sup>937</sup> Navigant and Itron, “CY2018 ComEd Income Eligible Product Discounts – Lighting NTG Recommendations”.

<sup>938</sup> 30% of the respondents at the three Income Eligible Program stores where in-store intercepts were conducted met ComEd’s income eligible definition; Navigant and Itron, “CY2018 ComEd Income Eligible Product Discounts – Lighting NTG Recommendations”.

<sup>939</sup> Average rated lives are based on the average rated lives of fixtures available on the ENERGY STAR qualifying list as of 2/26/2018.

<sup>940</sup> Based on recommendation in the Dunskey Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-18.

<sup>941</sup> Incremental costs for indoor and outdoor fixtures based on ENERGY STAR Light Fixtures and Ceiling Fans Calculator, which cites “EPA research on available products, 2012.” ENERGY STAR cost assumptions were reduced by 20% to account for falling LED prices.

<sup>942</sup> Incremental costs for task/under cabinet and downlight fixtures are from the 2018 Michigan Energy Measures Database.

**LOADSHAPE**

Loadshape R06 - Residential Indoor Lighting

Loadshape R07 - Residential Outdoor Lighting

**COINCIDENCE FACTOR**

The summer peak coincidence factor is assumed to be 0.119 for residential and in-unit multifamily fixtures,<sup>943</sup> 0.273 for exterior fixtures,<sup>944</sup> and 0.127 for unknown.<sup>945</sup>

**Algorithm**

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * ISR * (1 - Leakage) * Hours * WHF_e$$

Where:

**Watts<sub>Base</sub>** = Baseline is an average of lumen-equivalent EISA wattages for ENERGY STAR products within the fixture category;<sup>946</sup> see table below.

**Watts<sub>EE</sub>** = Actual wattage of LED fixture purchased / installed - If unknown, use default provided below.<sup>947</sup>

Fixture Category	Watts <sub>Base</sub>	Baseline for New Construction (WattsBase)		Watts <sub>EE</sub>	Delta Watts for New Construction (WattsEE)	
		(IECC 2015)	(IECC 2018)		(IECC 2015)	(IECC 2018)
Indoor	88.5	38.9	29.0	22.4	16.5	6.6
Task /Under Cabinet	45.2	20.0	15.0	11.6	8.4	3.4
Outdoor	79.6	33.6	24.4	18.3	15.3	6.1
Downlight	72.8	33.4	25.6	20.3	13.1	5.3

**ISR** = In Service Rate, the percentage of units rebated that are actually in service  
= 1.0<sup>948</sup>

**Leakage** = Adjustment to account for the percentage of program bulbs that move out (and in if deemed appropriate)<sup>949</sup> of the Utility Jurisdiction.

<sup>943</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs. Average of values for standard and specialty bulbs.

<sup>944</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for screw-based omnidirectional LEDs in exterior applications.

<sup>945</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>946</sup> See "Analysis" tab within file Residential LED Fixtures\_Analysis\_June 2018.xlsx for baseline calculations.

<sup>947</sup> Average of ENERGY STAR product category watts for products at or above the version 2.1 efficacy specification

<sup>948</sup> ISR recommendation for fixtures in the Dunskey Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-22.

<sup>949</sup> Leakage in is only appropriate to credit to IL utility program savings if it is reasonably expected that the IL utility program marketing efforts played an important role in influencing customer to purchase the light bulbs. Furthermore, consideration that

Upstream (TOS) Lighting programs = Use deemed assumptions below:<sup>950</sup>

ComEd: 0.7%  
Ameren: 6.6%

All other programs = 0

Hours = Average hours of use per year

Fixture Category	Hours
Indoor and Downlight	926 <sup>951</sup>
Task/Under Cabinet	730 <sup>952</sup>
Outdoor	2,475 <sup>953</sup>

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting

Bulb Location	WHFe
Interior single family	1.06 <sup>954</sup>
Multifamily in unit	1.04 <sup>955</sup>
Exterior or uncooled location	1.0
Unknown location	1.051 <sup>956</sup>

**For example**, an indoor LED fixture is purchased through a ComEd retail program in 2019:

$$\begin{aligned} \Delta\text{kWh} &= ((88.5 - 22.4) / 1000) * 1.0 * (1 - 0.007) * 926 * 1.06 \\ &= 64.4 \text{ kWh} \end{aligned}$$

such customers might be free riders should be addressed. If leakage in is assessed, efforts should be made to ensure no double counting of savings occurs if the evaluation is estimating both leakage in and spillover savings of light bulbs.

<sup>950</sup> Leakage rate is based upon review of PY7-9 evaluations from ComEd and PY8 for Ameren (see for more information) for LED omnidirectional and specialty lamps. Leakage rates for fixtures are an average of rates for standard and specialty lamps, reduced by half according to TAC agreement.

<sup>951</sup> Assuming 365.25 days/year and average of recommended values for standard LED lamps (2.98) and specialty LED lamps (2.09) in interior locations from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs

<sup>952</sup> Task/under cabinet hours of use are estimated at 2 hours per day.

<sup>953</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. The IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide hours of use for screw-based omnidirectional LEDs in exterior applications.

<sup>954</sup> The value is estimated at 1.06 (calculated as  $1 + (0.66 * (0.27 / 2.8))$ ). Based on cooling loads decreasing by 27% of the lighting savings (average result from REMRate modeling of several different configurations and IL locations of homes), assuming typical cooling system operating efficiency of 2.8 COP (starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm  $(-0.02 * \text{SEER}2) + (1.12 * \text{SEER})$  (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to  $\text{COP} = \text{EER} / 3.412 = 2.8\text{COP}$ ) and 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

<sup>955</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from "Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009" which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>956</sup> Unknown is weighted average of interior v exterior (assuming 5% exterior lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

**HEATING PENALTY**

If electric heated home (if heating fuel is unknown assume gas, see Natural Gas section):

$$\Delta kWh^{957} = - (((WattsBase - WattsEE) / 1000) * ISR * (1 - Leakage) * Hours * HF) / \eta_{Heat}$$

Where:

- HF = Heating Factor or percentage of light savings that must be heated
  - = 49%<sup>958</sup> for interior location
  - = 0% for exterior or unheated location
  - = 42%<sup>959</sup> for unknown location
- $\eta_{Heat}$  = Efficiency in COP of Heating equipment
  - = actual. If not available use:<sup>960</sup>

System Type	Age of Equipment	HSPF Estimate	COP <sub>HEAT</sub> (COP Estimate) = (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1.00
Unknown <sup>961</sup>	N/A	N/A	1.28

**For example**, using the same indoor LED fixture that is installed in home with 2.0 COP Heat Pump (including duct loss) through a ComEd retail program in 2019:

$$\begin{aligned} \Delta kWh_{1st\ year} &= - (((88.5 - 22.4) / 1000) * 1.0 * (1 - 0.007) * 926 * 0.49) / 2.0 \\ &= - 14.9\ kWh \end{aligned}$$

Second and third year install savings should be calculated using the appropriate ISR and the delta watts and hours from the install year. The appropriate baseline shift adjustment should then be applied to all installs.

**Mid-Life Baseline Adjustment**

During the lifetime of an LED, the baseline incandescent/halogen bulb would need to be replaced multiple times. Natural growth of LED market share has, and will continue to grow over the lifetime of the measure, and so a single mid-life adjustment is calculated that results in an equivalent net present value of lifetime savings as the forecast

<sup>957</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>958</sup> This means that heating loads increase by 49% of the lighting savings. This is based on the average result from REMRate modeling of several different configurations and IL locations of homes.

<sup>959</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>960</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

<sup>961</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see "HC6.9 Space Heating in Midwest Region.xls", using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

decline in annual savings. For fixtures the directional lamp adjustments from the ‘Lamp Forecast Workbook\_2020.xls’ are applied.

The calculated mid-life adjustments for 2021 are provided below for each population:

Population	Year from which adjustment is applied	Adjustment
Income Eligible	2028	70%
All others	2025	60%

**For example**, an indoor LED fixture is purchased through a ComEd retail program in 2021:

$\Delta kWh (2021-2024) = ((88.5 - 22.4) / 1000) * 1.0 * (1 - 0.007) * 926 * 1.06$   
 $= 64.4 kWh$

$\Delta kWh (2025 on) = 64.4 * 0.60$   
 $= 38.6 kWh$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((WattsBase - WattsEE) / 1\ 000) * ISR * (1 - Leakage) * WHFd * CF$$

Where:

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting.

Bulb Location	WHFd
Interior single family	1.11 <sup>962</sup>
Multifamily in unit	1.07 <sup>963</sup>
Exterior or uncooled location	1.0
Unknown location	1.093 <sup>964</sup>

CF = Summer Peak Coincidence Factor for measure.

Bulb Location	CF
Interior	0.119 <sup>965</sup>
Exterior	0.273 <sup>966</sup>

<sup>962</sup> The value is estimated at 1.11 (calculated as  $1 + (0.66 * 0.466 / 2.8)$ ). See footnote relating to WHFe for details. Note the 46.6% factor represents the average Residential cooling coincidence factor calculated by dividing average load during the peak hours divided by the maximum cooling load.

<sup>963</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from “Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009” which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>964</sup> Unknown is weighted average of interior v exterior (assuming 5% exterior lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>965</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs. Average of values for standard and specialty bulbs.

<sup>966</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for screw-based omnidirectional LEDs in exterior applications.

Bulb Location	CF
Unknown	0.127 <sup>967</sup>

Other factors as defined above

**For example**, for the same indoor LED fixture that is installed in a single family interior location through a ComEd retail program in 2019, the demand savings are:

$$\begin{aligned} \Delta kW &= ((88.5 - 22.4) / 1000) * 1.0 * (1-0.007) * 1.11 * 0.119 \\ &= 0.0087 \text{ kW} \end{aligned}$$

Second and third year install savings should be calculated using the appropriate ISR and the delta watts and hours from the install year. The appropriate baseline shift adjustment should then be applied to all installs.

### NATURAL GAS SAVINGS

Heating penalty if Natural Gas heated home, or if heating fuel is unknown.

$$\Delta \text{Therms} = -(((\text{WattsBase} - \text{WattsEE}) / 1000) * \text{ISR} * (1 - \text{Leakage}) * \text{Hours} * \text{HF} * 0.03412) / \eta \text{Heat}$$

Where:

- HF = Heating factor, or percentage of lighting savings that must be replaced by heating system.  
 = 49% for interior or unknown location<sup>968</sup>  
 = 0% for exterior location  
 = 42% for unknown location<sup>969</sup>
- 0.03412 = Converts kWh to Therms
- $\eta \text{Heat}$  = Average heating system efficiency.  
 = 0.70<sup>970</sup>

### WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

<sup>967</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>968</sup> Average result from REMRate modeling of several different configurations and IL locations of homes

<sup>969</sup> Based on a weighted average of interior and exterior hours of use from the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs, assuming 15% exterior specialty lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>970</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey) In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:

$$(0.24 * 0.92) + (0.76 * 0.8) * (1 - 0.15) = 0.70$$



**DEEMED O&M COST ADJUSTMENT CALCULATION**

Bulb replacement costs assumed in the O&M calculations are provided below:<sup>971</sup>

Year	Standard Incandescent	CFL	LED
2019	\$1.90	N/A	
2020	\$1.90	N/A	
2021 & after	\$1.90	\$3.15	\$4.35

In order to account for the natural growth of LED over the lifetime of the measure, an equivalent annual levelized baseline replacement cost is calculated and applied over the life of the measure life.

The NPV for replacement lamps and annual levelized replacement costs using the societal real discount rate of 0.42% are presented below.<sup>972</sup> It is important to note that for cost-effectiveness screening purposes, the O&M cost adjustments should only be applied in cases where the light bulbs area actually in service and so should be multiplied by the appropriate ISR:

Population	Location	NPV of replacement costs for period	Levelized annual replacement cost savings
		2021	2021
Income eligible	Indoor and Downlight, Task/Under Cabinet	\$10.57	\$0.73
	Exterior	\$22.84	\$1.57
All others	Indoor and Downlight, Task/Under Cabinet	\$7.57	\$0.52
	Exterior	\$15.97	\$1.10

**MEASURE CODE: RS-LTG-LDFX-V04-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>971</sup> Baseline and LED lamp costs are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis. Costs for standard, decorative, and directional bulbs were averaged.

<sup>972</sup> See "Residential LED Fixtures\_Analysis\_2019b.xlsx" for calculation.

## 5.5.10 Holiday String Lighting

### DESCRIPTION

This measure categorizes the savings from customers handing in incandescent string lighting typically used during the holidays and receiving equivalent LED string lighting. LED bulbs on string lights can consume up to 98% less power when compared to incandescent bulbs. Besides less energy to operate, LED string lighting offers many other advantages over incandescent: longer bulb life, a higher brightness, less heat buildup making them safer especially when used indoors on live trees, and better durability since they use a plastic covering over the diode instead of a glass bulb.<sup>973</sup>

This measure applies to mini, C7, and C9 bulb shape types used in residential locations. Description of the bulb types of string lighting are listed below:<sup>974, 975</sup>

- Mini: About 1/4" wide x 5/8" high with a shape described as a miniature candle with a pointed tip. The mini is the most common type of string light today and shares about 80% of the market. They have a female-to-male push type base.
- C7: Approximately 1" wide x 1-1/2" high with a shape described as a strawberry. The C7 (and C9) are thought of as more "old fashioned" or traditional since they were the first types of string lighting used for decorative purposes. The C7 shares about 7% of the market and has a screw-in E12 candelabra base.
- C9: Similar in shape to the C7, the C9 is slightly larger at 1-1/4" wide x 2-1/2" high. The C9 shares about 5% of the market and has a screw-in E17 intermediate base.

A third variant of the "C" bulb exists, which is called C6. However, due to lack of availability of the C6 incandescent from retailers, it is assumed the market has already adopted the LED as the baseline for this bulb shape type and should not be claimed for utility program savings.

The implementation strategy for this measure is only geared towards residential customers. Furthermore, the deemed hours of operation are sourced on residential only. As such, the proposed deemed split of 100% Residential and 0% Commercial assumptions should be used.

This measure was developed to be applicable to the following program types: EREP. To ensure that the baseline is appropriate, the measure is limited to an exchange event where the customer has to turn in a string of inefficient lighting.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, new string lights must be LED and one of the eligible bulb shape categories listed in this measure (mini, C7, C9).

Some manufacturers offer integrated "smart" control of new LED strings; however, these are not included in this measure.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is the existing incandescent mini, C7, or C9 string lighting turned in during an exchange event.

---

<sup>973</sup> See 'Christmas Lights Buying Guide – Hayneedle'.

<sup>974</sup> See 'Christmas Lights Buying Guide – Hayneedle'.

<sup>975</sup> See 'Christmas Lights Guide Visual'.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The rated lifespan of LED bulbs for string lighting is in the range of 20,000 to 100,000 hours of use. However, the measure lifetime is capped at 7 years due to wear on bulbs and string from weather, sunlight, and annual installation and storage.<sup>976</sup>

**DEEMED MEASURE COST**

Where possible, the actual, full cost of new LED string lighting should be used. If unavailable, assume the following costs.

Bulb Type	Measure Cost <sup>977</sup>
Mini	\$15.38
C7	\$21.42
C9	\$17.28

Loadshape

Loadshape R16; Residential Holiday String Lighting

**COINCIDENCE FACTOR**

Due to the seasonal nature and evening operation of holiday string lights, there is no expected reduction in a utility’s peak demand.

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((Watts_{base} - Watts_{EE}) / 1000) * ISR * (1 - Leakage) * Hours * WHF_e$$

Where:

Watts<sub>base</sub> = Total wattage of the existing incandescent string lights = Bulb Wattage \* # Bulbs; see table below for baseline bulb wattage assumptions

Watts<sub>EE</sub> = Actual total wattage of the new LED string lights = Bulb Wattage \* # Bulbs. If unknown, assume total wattage of new LED string lights = Bulb Wattage \* # Bulbs; see table below for LED bulb wattage assumptions

Where:

Bulb Wattage = Reference the “Bulb Wattage Assumptions” table below.

**Bulb Wattage Assumptions<sup>978</sup>**

Type	Incandescent Bulb (Watts)	LED Bulb (Watts)
Mini	0.49	0.11
C7	5.00	0.31
C9	7.00	0.13

<sup>976</sup> LED string lighting lifetime from <https://www.christmasdesigners.com/blog/how-long-do-led-christmas-lights-really-last/How Long Do LED Christmas Lights Really Last Christmas Designers>

<sup>977</sup> See file Holiday Lights Research and Calcs\_2018.xlsx for CLEAResult research on holiday string lighting costs.

<sup>978</sup> Average wattages provided from market research by CLEAResult. See file Holiday Lights Research and Calcs\_2018.xlsx.

# Bulbs	= Actual quantity of bulbs on the string. If baseline is unknown, assume same as the new string.
ISR	= In Service Rate, or percentage of string lights that get installed. Derive from program evaluation analysis, otherwise assume 100%.
Leakage	= Adjustment to account for the percentage of program string lights that move out (and in, if deemed appropriate) of the Utility Jurisdiction.  = For an exchange event, assume 0% if customer is required to be a utility customer. If not, determine leakage rate through evaluation. If customer is not required to be utility customer and if leakage is not determined through evaluation, use the deemed leakage rates LED omnidirectional bulbs sold through Upstream (TOS) programs: <sup>979</sup>
	ComEd: 1.6%
	Ameren: 13.1%
Hours	= Average hours of use per year = 210 hours <sup>980</sup>
WHFe	= Waste heat factor for energy to account for cooling energy savings from efficient lighting, assumed value of 1.0 since operation of string lights (if indoors) does not coincide with cooling season and there are no interactive effects for outdoor string lights.

**For example**, a customer replaces a 50-bulb mini incandescent string with a 50-bulb mini LED string through exchange event:

$$\Delta kWh = ((0.49 * 50) - (0.11 * 50)) / 1000 * 1.00 * (1 - 0) * 210 * 1.0$$

### HEATING PENALTY

If electric heated home (if heating fuel is unknown assume gas, see Natural Gas section):

$$\Delta kWh^{981} = - (((WattsBase - WattsEE) / 1000) * ISR * (1 - Leakage) * Hours * HF) / \eta_{Heat}$$

Where:

HF	= Heating Factor or percentage of light savings that must be heated = 49% for interior or unknown location <sup>982</sup> = 0% for exterior or unheated location
$\eta_{Heat}$	= Efficiency in COP of Heating equipment = actual. If not available, use: <sup>983</sup>

<sup>979</sup> Leakage rate is based upon review of PY8-CY2018 evaluations from ComEd and PY8 for Ameren.

<sup>980</sup> Based on typical holiday lighting hours of use (6 hours per day, 7 days per week for 5 weeks) from California Municipal Utilities Association "TRM 205 LED Holiday Lights."

<sup>981</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>982</sup> This means that heating loads increase by 49% of the lighting savings. This is based on the average result from REMRate modeling of several different configurations and IL locations of homes.

<sup>983</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

System Type	Age of Equipment	HSPF Estimate	COPheat (COP Estimate) = (HSPF/3.413) * 0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006-2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown <sup>984</sup>	N/A	N/A	1.28

**For example**, using the same 50-bulb mini LED string that is installed in home with 2.0 COP Heat Pump (including duct loss):

$$\Delta kWh = - (((0.49 * 50) - (0.11 * 50)) / 1000) * 1.00 * (1 - 0) * 210 * 0.49 / 2.0$$

$$= - 1.0 kWh$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

Heating penalty if installed in a natural gas heated home, or if heating fuel is unknown.

$$\Delta Therms = - (((WattsBase - WattsEE) / 1000) * ISR * (1 - Leakage) * Hours * HF * 0.03412) / \eta_{Heat}$$

Where:

- HF = Heating factor, or percentage of lighting savings that must be replaced by heating system.  
= 49% for interior or unknown location <sup>985</sup>  
= 0% for exterior location
- 0.03412 = Converts kWh to Therms
- $\eta_{Heat}$  = Actual heating system efficiency  
= 70% <sup>986</sup>

<sup>984</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

<sup>985</sup> Average result from REMRate modeling of several different configurations and IL locations of homes.

<sup>986</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey). In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in

**For example**, using the same 50-bulb mini LED string that is installed in a single family interior location with gas heating at 70% total efficiency:

$$\begin{aligned}\Delta\text{therms} &= - (((0.49 * 50) - (0.11 * 50)) / 1000) * 1.00 * (1 - 0) * 210 * 0.49 * 0.03412 / 0.70 \\ &= - 0.10 \text{ therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-LTG-LEDH-V02-200101**

**REVIEW DEADLINE: 1/1/2022**

---

the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:

$$(0.24 * 0.92) + (0.76 * 0.8) * (1 - 0.15) = 0.70$$

### 5.5.11 LED Nightlights

**DESCRIPTION**

This measure describes savings from LED nightlights. This characterization assumes that the LED nightlight is installed in a residential location.

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

**DEFINITION OF EFFICIENT EQUIPMENT**

For this characterization to apply, the high-efficiency equipment must be a qualified LED nightlight.

**DEFINITION OF BASELINE EQUIPMENT**

The baseline condition is assumed to be an incandescent/halogen nightlight.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The estimated useful life of the is estimated is 8 years.<sup>987</sup>

**DEEMED MEASURE COST**

Where possible, the actual cost should be used and compared to the baseline cost. If the incremental cost is unknown, assume the following:<sup>988</sup>

Bulb Type	Year	Incandescent	LED	Incremental Cost
Nightlights	All	\$2.84	\$6.19	\$3.35

**LOADSHAPE**

Loadshape R07 - Residential Outdoor Lighting

**COINCIDENCE FACTOR**

Demand savings is assumed to be zero for this measure.

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = ((WattsBase - WattsEE) / 1000) * ISR * (1 - Leakage) * Hours * WHFe$$

Where:

$$Watts_{base} = \text{Actual wattage if known, if unknown, assume } 7W.^{989}$$

---

<sup>987</sup> Southern California Edison Company, "LED, Electroluminescent & Fluorescent Night Lights", Work Paper WPSCRELG0029 Rev. 1, February 2009, p. 2. and p.3.

<sup>988</sup> Average cost data provided in Stanley Mertz, "LED Nightlights Energy Efficiency Retail products programs", March 2018.

<sup>989</sup> Based on Stanley Mertz, "LED Nightlights Energy Efficiency Retail products programs", March 2018.

Watts<sub>EE</sub> = Actual wattage of LED purchased / installed.

ISR = In Service Rate or the percentage of nightlights rebated that get installed

Program	Weighted Average 1 <sup>st</sup> year In Service Rate (ISR)	2 <sup>nd</sup> year Installations	3 <sup>rd</sup> year Installations	Final Lifetime In Service Rate
Retail (Time of Sale)	84.0% <sup>990</sup>	7.6%	6.4%	98.0% <sup>991</sup>
Direct Install	96.9% <sup>992</sup>			
School Kits	60% <sup>993</sup>	13%	11%	84%

Leakage = Adjustment to account for the percentage of program bulbs that move out (and in if deemed appropriate)<sup>994</sup> of the Utility Jurisdiction.

KITS programs = Determined through evaluation

Upstream (TOS) Lighting programs = Use deemed assumptions below:<sup>995</sup>

ComEd: 2.0%

Ameren: 13.1%

Hours = Average hours of use per year

= 4,380<sup>996</sup>

WHFe = Waste heat factor for energy to account for cooling savings from efficient lighting

Bulb Location	WHFe
Interior single family	1.06 <sup>997</sup>

<sup>990</sup> 1<sup>st</sup> year in service rate is based upon analysis of ComEd PY7, PY8, and PY9 intercept data (see 'Res Lighting ISR\_2018.xlsx' for more information).

<sup>991</sup> The 98% Lifetime ISR assumption is based upon the standard CFL measure in the absence of any better reference. This value is based upon review of two evaluations:

'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2<sup>nd</sup> and 3<sup>rd</sup> year installations should be counted as part of those future program year savings.

<sup>992</sup> Consistent with assumption for standard CFLs (in the absence of evidence that it should be different for this bulb type). Based upon review of the PY2 and PY3 ComEd Direct Install program surveys. This value includes bulb failures in the 1st year to be consistent with the Commission approval of annualization of savings for first year savings claims. ComEd PY2 All Electric Single Family Home Energy Performance Tune-Up Program Evaluation, Navigant Consulting, December 21, 2010.

<sup>993</sup> 1<sup>st</sup> year ISR for school kits based on ComEd PY9 data for the Elementary Energy Education program.

<sup>994</sup> Leakage in is only appropriate to credit to IL utility program savings if it is reasonably expected that the IL utility program marketing efforts played an important role in influencing customer to purchase the light bulbs. Furthermore, consideration that such customers might be free riders should be addressed. If leakage in is assessed, efforts should be made to ensure no double counting of savings occurs if the evaluation is estimating both leakage in and spillover savings of light bulbs.

<sup>995</sup> Leakage rate is based upon review of PY7-9 evaluations from ComEd and PY5,6 and 8 for Ameren (see for more information).

<sup>996</sup> Assumes nightlight is operating 12 hours per day, consistent with the 2016 Pennsylvania TRM.

<sup>997</sup> The value is estimated at 1.06 (calculated as 1 + (0.66\*(0.27 / 2.8)). Based on cooling loads decreasing by 27% of the lighting savings (average result from REMRate modeling of several different configurations and IL locations of homes), assuming typical cooling system operating efficiency of 2.8 COP (starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm (-0.02 \* SEER2) + (1.12 \* SEER) (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to COP =



Bulb Location	WHFe
Multifamily in unit	1.04 <sup>998</sup>
Unknown location	1.054 <sup>999</sup>

**For example,** a 0.3W LED nightlight is direct installed in single family interior location within ComEd territory:

$$\begin{aligned} \Delta kWh &= ((7 - 0.3) / 1000) * 0.969 * (1 - 0) * 4380 * 1.06 \\ &= 30.1 kWh \end{aligned}$$

**HEATING PENALTY**

If electric heated home (if heating fuel is unknown assume gas, see Natural Gas section):

$$\Delta kWh^{1000} = - (((WattsBase - WattsEE) / 1000) * ISR * Hours * HF) / \eta_{Heat}$$

Where:=(

- HF = Heating Factor or percentage of light savings that must be heated  
= 49% for interior<sup>1001</sup>
- $\eta_{Heat}$  = Efficiency in COP of Heating equipment  
= Actual. If not available use:<sup>1002</sup>

System Type	Age of Equipment	HSPF Estimate	COP <sub>HEAT</sub> (COP Estimate) = (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.69
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1.00
Unknown <sup>1003</sup>	N/A	N/A	1.28

EER/3.412 = 2.8COP) and 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

<sup>998</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from "Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009" which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>999</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>1000</sup> Negative value because this is an increase in heating consumption due to the efficient lighting.

<sup>1001</sup> This means that heating loads increase by 49% of the lighting savings. This is based on the average result from REMRate modeling of several different configurations and IL locations of homes.

<sup>1002</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate. Note efficiency should include duct losses. Defaults provided assume 15% duct loss for heat pumps.

<sup>1003</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see "HC6.9 Space Heating in Midwest Region.xls", using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

**For example**, a 0.3W LED nightlight is direct installed in single family interior location with a 2016 heat pump:

$$\begin{aligned} \Delta kWh &= - (((7 - 0.3) / 1000) * 0.969 * (1-0) * 4380 * 0.49) / 2.04 \\ &= - 6.83 kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = ((WattsBase - WattsEE) / 1000) * ISR * (1-Leakage) * WHFd * CF$$

Where:

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting.

Bulb Location	WHFd
Interior single family or unknown location	1.11 <sup>1004</sup>
Multifamily in unit	1.07 <sup>1005</sup>
Unknown location	1.098 <sup>1006</sup>

CF = Summer Peak Coincidence Factor for measure.  
= 0

**NATURAL GAS SAVINGS**

Heating penalty if Natural Gas heated home, or if heating fuel is unknown.

$$\Delta \text{therms} = - (((WattsBase - WattsEE) / 1000) * ISR * Hours * HF * 0.03412) / \eta \text{Heat}$$

Where:

HF = Heating factor, or percentage of lighting savings that must be replaced by heating system.  
= 49% for interior<sup>1007</sup>

0.03412 = Converts kWh to Therms

$\eta$ Heat = Average heating system efficiency  
= 0.70<sup>1008</sup>

Other factors as defined above

<sup>1004</sup> The value is estimated at 1.11 (calculated as 1 + (0.66 \* 0.466 / 2.8)). See footnote relating to WHFe for details. Note the 46.6% factor represents the average Residential cooling coincidence factor calculated by dividing average load during the peak hours divided by the maximum cooling load.

<sup>1005</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from “Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009” which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>1006</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>1007</sup> Average result from REMRate modeling of several different configurations and IL locations of homes

<sup>1008</sup> This has been estimated assuming that natural gas central furnace heating is typical for Illinois residences (66% of Illinois homes have a Natural Gas Furnace (based on Energy Information Administration, 2009 Residential Energy Consumption Survey) In 2000, 24% of furnaces purchased in Illinois were condensing (based on data from GAMA, provided to Department of Energy during the federal standard setting process for residential heating equipment - see Furnace Penetration.xls). Furnaces tend to last up to 20 years and so units purchased 10 years ago provide a reasonable proxy for the current mix of furnaces in the State. Assuming typical efficiencies for condensing and non-condensing furnaces and duct losses, the average heating system efficiency is estimated as follows:

$$(0.24*0.92) + (0.76*0.8) * (1-0.15) = 0.70$$

**For example**, a 0.3W LED nightlight is direct installed in single family interior location with gas heating at 70% total efficiency:

$$\begin{aligned}\Delta\text{therms} &= - ((7 - 0.3) / 1000) * 0.969 * (1-0) * 4380 * 0.49 * 0.03412 / 0.70 \\ &= - 0.68 \text{ therms}\end{aligned}$$

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**MEASURE CODE: RS-LTG-NITL-V01-190101**

**REVIEW DEADLINE: 1/1/2022**

## 5.5.12 Connected LED Lamps

### DESCRIPTION

Many home devices in the market have become integrated with smart technology in recent years. Home devices able to connect to Wifi or a mobile network allow the user to control the device over the internet. This measure defines the savings associated with connected lighting. Connected LEDs allow for remote user control through a smart device, such as smart phone, tablet, or smart speaker. The standard LED provides light in one shade at one lumen level and color temperature. Connected LEDs have options integrated that allow for customizable color, color temperature, and lumen output. The Connected LED can also be turned on and off with a set schedule or controlled remotely. Savings from this measure come from both reduced hours of operation and dimming.

This measure was developed to be applicable to the following program types: TOS, NC

### DEFINITION OF EFFICIENT EQUIPMENT

For this characterization to apply, the efficient condition must be LED lighting that is controlled by a smart device. The savings for this measure are the estimated incremental control savings compared to a non-connected efficient lamp. Some connected LEDs come with hubs for managing their operations. Connected LEDs with hubs do not qualify for this savings characterization, as the energy use by the hub cancels out the savings attributed to the connectivity of the lamp.

### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is the efficient LED without the connected capabilities.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 6.1 years for exterior application.<sup>1009</sup> For all other applications, lifetimes are capped at 10 years.<sup>1010</sup>

### DEEMED MEASURE COST

The incremental cost can be assumed to be \$20, the difference between the average cost of the baseline non-connected LED and the average cost of the connected LED.<sup>1011</sup>

### LOADSHAPE

Loadshape R06 – Residential Indoor Lighting

Loadshape R07 – Residential Outdoor Lighting

### COINCIDENCE FACTOR

The summer peak coincidence factor is assumed to be 0.128 for Residential and in-unit Multi Family bulbs,<sup>1012</sup> 0.273

---

<sup>1009</sup> ENERGY STAR v2.1 requires omnidirectional LED bulbs to be rated for at least 15,000 hours. 15000/2475 (exterior hours of use) = 6.1 years.

<sup>1010</sup> Based on recommendation in the Dunsky Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-18.

<sup>1011</sup> Estimate based on review of available product and estimates provided in King J., ACEEE, “Energy Impacts of Smart Home Technologies”, April 2018.

<sup>1012</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

for exterior bulbs,<sup>1013</sup> and 0.135 for unknown.<sup>1014</sup>

Use Multifamily if: Building meets utility’s definition for multifamily.

**Algorithm**

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = (((Watts_{EE}/1000) * HOURS * SVGe * WHFe) - Standby_{kWh}) * ISR * (1 - Leakage)$$

Where:

WattsEE = Actual wattage of LED. If unknown, then use the following default assumption:  
= 0.034<sup>1015</sup>

HOURS = Average hours of use per year

Installation Location	Hours
Residential and in-unit Multi Family	1,089 <sup>1016</sup>
Exterior	2,475 <sup>1017</sup>
Unknown	1,159 <sup>1018</sup>

SVGe = Percentage of annual lighting energy saved by lighting control; determined on a site-specific basis or using default below  
= 0.30<sup>1019</sup>

ISR = In Service Rate, the percentage of lamps rebated that are actually in service.

Program	Weighted Average 1 <sup>st</sup> year In Service Rate (ISR) <sup>1020</sup>
Retail (Time of Sale)	98.0%
Direct Install	96.9%

<sup>1013</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for screw-based omnidirectional LEDs in exterior applications.

<sup>1014</sup>Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>1015</sup> Connecticut LED Lighting Study Report (R154). Average connected wattage of lamps in dining room, living space, bedroom, bathroom, and kitchen spaces.

<sup>1016</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

<sup>1017</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. The IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide hours of use for screw-based omnidirectional LEDs in exterior applications.

<sup>1018</sup> Based on a weighted average of hours of use in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

<sup>1019</sup> Mid Atlantic Technical Reference Manual Version 8, May 2018. SVGe value adjusted downward (from original TRM value of 0.49 to 0.30) based on phone conversations with Navigant in support of the MEMD.

<sup>1020</sup> ISRs are consistent with the LED Screw Based Standard Lamp measure, however since 2<sup>nd</sup> and 3<sup>rd</sup> year savings for this measure are so minimal, for ease of implementation the 3 year installs are discounted using the real discount rate to a single assumption.

Program		Weighted Average 1 <sup>st</sup> year In Service Rate (ISR) <sup>1020</sup>
Efficiency Kits	LED Distribution	83%
	School Kits	84%
	Direct Mail Kits	92%
Food Bank / Pantry Distribution		98%

Leakage = Adjustment to account for the percentage of program bulbs that move out (and in if deemed appropriate)<sup>1021</sup> of the Utility Jurisdiction.

KITS programs = Determined through evaluation

Upstream (TOS) Lighting programs = Use deemed assumptions below:<sup>1022</sup>

ComEd: 0.8%

Ameren: 13.1%

All other programs = 0

WHFe = Waste heat factor for energy to account for cooling savings

Bulb Location	WHFe
Interior single family	1.06 <sup>1023</sup>
Multifamily in unit	1.04 <sup>1024</sup>
Exterior or uncooled location	1.0
Unknown location	1.051 <sup>1025</sup>

StandbykWh = Standby power draw of the controlled lamp. Use actual value from manufacturer specification. If not known then assume:

= 0.35 kWh<sup>1026</sup>

<sup>1021</sup> Leakage in is only appropriate to credit to IL utility program savings if it is reasonably expected that the IL utility program marketing efforts played an important role in influencing customer to purchase the light bulbs. Furthermore, consideration that such customers might be free riders should be addressed. If leakage in is assessed, efforts should be made to ensure no double counting of savings occurs if the evaluation is estimating both leakage in and spillover savings of light bulbs.

<sup>1022</sup> Leakage rate is based upon review of PY8-CY2018 evaluations from ComEd and PY8 for Ameren.

<sup>1023</sup> The value is estimated at 1.06 (calculated as  $1 + (0.66 * (0.27 / 2.8))$ ). Based on cooling loads decreasing by 27% of the lighting savings (average result from REMRate modeling of several different configurations and IL locations of homes), assuming typical cooling system operating efficiency of 2.8 COP (starting from standard assumption of SEER 10.5 central AC unit, converted to 9.5 EER using algorithm  $(-0.02 * SEER^2) + (1.12 * SEER)$  (from Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder), converted to  $COP = EER / 3.412 = 2.8COP$ ) and 66% of homes in Illinois having central cooling ("Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009 from Energy Information Administration", 2009 Residential Energy Consumption Survey)

<sup>1024</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from "Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009" which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>1025</sup> Unknown is weighted average of interior v exterior (assuming 5% exterior lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>1026</sup> Laccarino, et. Al. "Only as Smart as its owner: A connected device study". Cadmus study presented at ACEEE Summer Study on Energy Efficiency in Buildings, 2018.

**For example**, a 9W Connected LED is purchased through a ComEd upstream program.

$$\begin{aligned} \Delta kWh_{1st\ year\ installs} &= ((9/1000) * 1,089 * 0.3 * 1.051) - 0.35 * 0.9 * (1 - 0.008) \\ &= 2.45\ kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kWh = (Watts_{EE}/1000) * SVGd * WHFd * ISR * (1 - Leakage) * CF$$

Where:

SVGd = Percentage of annual lighting demand saved by lighting control; determined on a site-specific basis or using default below  
 = 0.30<sup>1027</sup>

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting.

Bulb Location	WHFd
Interior single family	1.11 <sup>1028</sup>
Multifamily in unit	1.07 <sup>1029</sup>
Exterior or uncooled location	1.0
Unknown location	1.093 <sup>1030</sup>

CF = Summer Peak Coincidence Factor for measure.

Bulb Location	CF
Interior	0.128 <sup>1031</sup>
Exterior	0.273 <sup>1032</sup>
Unknown	0.135 <sup>1033</sup>

<sup>1027</sup> Mid Atlantic Technical Reference Manual Version 8, May 2018. SVGe value adjusted downward (from original TRM value of 0.49 to 0.30) based on phone conversations with Navigant in support of the MEMD.

<sup>1028</sup> The value is estimated at 1.11 (calculated as 1 + (0.66 \* 0.466 / 2.8)). See footnote relating to WHFe for details. Note the 46.6% factor represents the average Residential cooling coincidence factor calculated by dividing average load during the peak hours divided by the maximum cooling load.

<sup>1029</sup> As above but using estimate of 45% of multifamily buildings in Illinois having central cooling (based on data from “Table HC7.1 Air Conditioning in U.S. Homes, By Housing Unit Type, 2009” which is for the whole of the US, scaled to IL air conditioning prevalence compared to US average)

<sup>1030</sup> Unknown is weighted average of interior v exterior (assuming 5% exterior lighting based on distribution of LEDs from on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study) and SF v MF interior based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>1031</sup> Based on the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs.

<sup>1032</sup> Based on lighting logger study conducted as part of the PY5/6 ComEd Residential Lighting Program evaluation. the IL Statewide LED Lighting Logger study conducted as part of the PY8/PY9 evaluations of the Ameren Illinois and ComEd Residential Lighting programs was unable to provide coincidence factors for screw-based omnidirectional LEDs in exterior applications.

<sup>1033</sup> Based on a weighted average of coincidence factors in interior and exterior applications, assuming 5% exterior lighting. The distribution of LEDs is based on the on-site lighting inventory conducted as part of the IL Statewide LED Lighting Logger study.

**For example**, a 9W Connected LED is purchased through a ComEd upstream program.

$$\begin{aligned}\Delta kW_{1st \text{ year installs}} &= ((9/1000) * 0.3 * 1.093) * 0.9 * (1 - 0.008) \\ &= 0.0026 \text{ kW}\end{aligned}$$

**NATURAL GAS SAVINGS**

NA

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

NA

**DEEMED O&M COST ADJUSTMENT CALCULATION**

NA

**MEASURE CODE: RS-LTG-LEDC-V01-200101**

**REVIEW DEADLINE: 1/1/2023**



## 5.6 Shell End Use

### 5.6.1 Air Sealing

#### **DESCRIPTION**

Thermal shell air leaks are sealed through strategic use and location of air-tight materials. Leaks are detected and leakage rates measured with the assistance of a blower-door. The algorithm for this measure can be used when the program implementation does not allow for more detailed forecasting through the use of residential modeling software.

Prescriptive savings are provided for use only where a blower door test is not possible (for example in large multifamily buildings).

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

#### **DEFINITION OF EFFICIENT EQUIPMENT**

Air sealing materials and diagnostic testing should meet all eligibility program qualification criteria. The initial and final tested leakage rates should be performed in such a manner that the identified reductions can be properly discerned, particularly in situations wherein multiple building envelope measures may be implemented simultaneously.

#### **DEFINITION OF BASELINE EQUIPMENT**

The existing air leakage should be determined through approved and appropriate test methods using a blower door. The baseline condition of a building upon first inspection significantly impacts the opportunity for cost-effective energy savings through air-sealing.

#### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 20 years.<sup>1034</sup>

The expected measure life of prescriptive shrink-fit window film is assumed to be 1 year.

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years or 13 years for boilers.<sup>1035</sup> See section below for detail.

#### **DEEMED MEASURE COST**

The actual capital cost for this measure should be used in screening.

#### **LOADSHAPE**

Loadshape R08 - Residential Cooling

Loadshape R09 - Residential Electric Space Heat

Loadshape R10 - Residential Electric Heating and Cooling

#### **COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate

---

<sup>1034</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1035</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM’s capacity market.

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
= 68%<sup>1036</sup>
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
= 72%<sup>1037</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 46.6%<sup>1038</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Preferred methodology unless blower door testing is not possible.

$$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas}$$

Where:

- $\Delta kWh_{cooling}$  = If central cooling, reduction in annual cooling requirement due to air sealing  
=  $\frac{(((CFM50_{existing} - CFM50_{new}) / N_{cool}) * 60 * 24 * CDD * DUA * 0.018)}{(1000 * \eta_{Cool}) * LM * ADJ_{AirSealingCool}} * IE_{NetCorrection} * \%Cool$
- CFM50<sub>existing</sub> = Infiltration at 50 Pascals as measured by blower door before air sealing.  
= Actual
- CFM50<sub>new</sub> = Infiltration at 50 Pascals as measured by blower door after air sealing.  
= Actual
- N<sub>cool</sub> = Conversion factor from leakage at 50 Pascal to leakage at natural conditions  
= Dependent on location and number of stories:<sup>1039</sup>

Climate Zone (City based upon)	N <sub>cool</sub> (by # of stories)			
	1	1.5	2	3
1 (Rockford)	39.5	35.0	32.1	28.4
2 (Chicago)	38.9	34.4	31.6	28.0
3 (Springfield)	41.2	36.5	33.4	29.6

<sup>1036</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1037</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1038</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1039</sup> N-factor is used to convert 50-pascal blower door air flows to natural air flows and is dependent on geographic location and # of stories. These were developed by applying the LBNL infiltration model (see LBNL paper 21040, *Exegisis of Proposed ASHRAE Standard 119: Air Leakage Performance for Detached Single-Family Residential Buildings*; Sherman, 1986; page v-vi, Appendix page 7-9) to the reported wind speeds and outdoor temperatures provided by the NRDC 30 year climate normals. For more information see Bruce Harley, CLEARResult “Infiltration Factor Calculations Methodology.doc”.

Climate Zone (City based upon)	N_cool (by # of stories)			
	1	1.5	2	3
4 (St Louis, MO)	40.4	35.8	32.9	29.1
5 (Paducah, KY)	43.6	38.6	35.4	31.3

60 \* 24 = Converts Cubic Feet per Minute to Cubic Feet per Day

CDD = Cooling Degree Days  
 = Dependent on location:<sup>1040</sup>

Climate Zone (City based upon)	CDD 65
1 (Rockford)	820
2 (Chicago)	842
3 (Springfield)	1,108
4 (Belleville)	1,570
5 (Marion)	1,370

DUA = Discretionary Use Adjustment (reflects the fact that people do not always operate their AC when conditions may call for it).  
 = 0.75<sup>1041</sup>

0.018 = Specific Heat Capacity of Air (Btu/ft<sup>3</sup>\*°F)

1000 = Converts Btu to kBtu

ηCool = Efficiency (SEER) of Air Conditioning equipment (kBtu/kWh)  
 = Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume the following:<sup>1042</sup>

Age of Equipment	SEER Estimate
Before 2006	10
2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

LM = Latent multiplier to account for latent cooling demand<sup>1043</sup>

<sup>1040</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 65°F.

<sup>1041</sup> This factor's source is: Energy Center of Wisconsin, May 2008 metering study; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research", p31.

<sup>1042</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>1043</sup> Derived by calculating the sensible and total loads in each hour. For more information see Bruce Harley, CLEARResult "Infiltration Factor Calculations Methodology.doc".

Climate Zone (City based upon)	LM
1 (Rockford)	3.3
2 (Chicago)	3.2
3 (Springfield)	3.7
4 (St Louis, MO)	3.6
5 (Paducah, KY)	3.7

$ADJ_{AirSealingCool}$  = Adjustment for cooling savings to account for inaccuracies in engineering algorithms<sup>1044</sup>

Measure	$ADJ_{AirSealingCool}$
Air sealing and attic insulation	121%
Air sealing without attic insulation	100%

$IE_{NetCorrection}$  = 100% if not income eligible or air sealing is installed without attic insulation.  
 = 110% if installing air sealing and attic insulation in income eligible projects with a deemed NTG value of 1.0 to offset net savings adjustment inherent when using  $ADJ_{AirSealingCool}$  of 121%<sup>1045</sup>

%Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>1046</sup>	66%

$\Delta kWh_{heatingElectric}$  = If electric heat (resistance or heat pump), reduction in annual electric heating due to air sealing

$$= [(((CFM50_{existing} - CFM50_{new})/N_{heat}) * 60 * 24 * HDD * 0.018) / (\eta_{Heat} * 3,412)] * \%ElectricHeat$$

$N_{heat}$  = Conversion factor from leakage at 50 Pascal to leakage at natural conditions

<sup>1044</sup> As demonstrated in air sealing and insulation research by Navigant, see Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company.

These adjustment factors are based on a consumption data analysis using matching to non-participants. The values are therefore between net and gross with respect to free ridership. Like all consumption data analyses, they are net with respect to participant spillover and gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to the savings will be determined as part of the annual SAG net-to-gross process.

<sup>1045</sup> The additional value of 10% was selected to acknowledge that some portion of the regression-derived adjustment factors accounts for gross impact effects, and that removing net effects embedded in the adjustment factors would increase savings to some degree. A review of historical NTG values for air sealing and insulation measures in non-income eligible populations did not provide definitive guidance for estimating the net component of the adjustment factors. Historically, free ridership has ranged from 9% to 26% for like measures, and spillover has ranged from 1% to 14%, while NTGs have ranged from 0.75 to 1.05. The midpoint of the NTG range would be 0.90, a 10% reduction from 1.0.

<sup>1046</sup> Percentage of homes in Illinois that have central cooling from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

= Based on climate zone, building height and exposure level:<sup>1047</sup>

Climate Zone (City based upon)	N_heat (by # of stories)			
	1	1.5	2	3
1 (Rockford)	23.8	21.1	19.3	17.1
2 (Chicago)	23.9	21.1	19.4	17.2
3 (Springfield)	24.2	21.5	19.7	17.4
4 (St Louis, MO)	25.4	22.5	20.7	18.3
5 (Paducah, KY)	27.8	24.6	22.6	20.0

HDD = Heating Degree Days

= Dependent on location:<sup>1048</sup>

Climate Zone (City based upon)	HDD 60
1 (Rockford)	5,352
2 (Chicago)	5,113
3 (Springfield)	4,379
4 (Belleville)	3,378
5 (Marion)	3,438

$\eta$ Heat = Efficiency of heating system

= Actual (where new or where it is possible to measure or reasonably estimate)..  
If not available refer to default table below:<sup>1049</sup>

System Type	Age of Equipment	HSPF Estimate	$\eta$ Heat (Effective COP Estimate)= (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown (for use in program evaluation only) <sup>1050</sup>	N/A	N/A	1.28

<sup>1047</sup> N-factor is used to convert 50-pascal blower door air flows to natural air flows and is dependent on geographic location and # of stories. These were developed by applying the LBNL infiltration model (see LBNL paper 21040, *Exegisis of Proposed ASHRAE Standard 119: Air Leakage Performance for Detached Single-Family Residential Buildings*; Sherman, 1986; page v-vi, Appendix page 7-9) to the reported wind speeds and outdoor temperatures provided by the NRDC 30 year climate normals. For more information see Bruce Harley, CLEAResult "Infiltration Factor Calculations Methodology.doc".

<sup>1048</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F.

<sup>1049</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time means that using the minimum standard is appropriate. An 85% distribution efficiency is then applied to account for duct losses for heat pumps.

<sup>1050</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see "HC6.9 Space Heating in Midwest Region.xls", using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

3412 = Converts Btu to kWh

%ElectricHeat = Percent of homes that have electric space heating

Heating System	%ElectricHeat
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>1051</sup>	13%

**For example:** energy savings from air sealing. Energy savings for attic insulation are included in a separate example in Section 5.6.5: Ceiling/Attic Insulation.

Assume a 2 story single family non-income eligible home in Chicago completes air sealing, installs attic insulation, has 10.5 SEER central cooling and a heat pump with COP of 2 (1.92 including distribution losses), and has pre and post blower door test results of 3,400 and 2,250:

$$\begin{aligned}
 \Delta kWh &= \Delta kWh_{cooling} + \Delta kWh_{heating} \\
 &= [(((3,400 - 2,250) / 31.6) * 60 * 24 * 842 * 0.75 * 0.018) / (1000 * 10.5) * 3.2 * 121\%] * 100\% \\
 &\quad * 100\% + [(((3,400 - 2,250) / 19.4) * 60 * 24 * 5113 * 0.018) / (1.92 * 3,412)] * 100\% \\
 &= 220 + 1,199 \\
 &= 1,419 kWh
 \end{aligned}$$

$\Delta kWh_{heatingGas}$  = If gas furnace heat, kWh savings for reduction in fan run time

$$= \Delta Therms * F_e * 29.3 * ADJ_{AirSealingHeatFan} * IE_{NetCorrection}$$

$F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption

$$= 3.14\%^{1052}$$

29.3 = kWh per therm

$ADJ_{AirSealingHeatFan}$  = Adjustment for fan savings during heating season to account for inaccuracies in engineering algorithms<sup>1053</sup>

Measure	$ADJ_{AirSealingHeatFan}$
Air sealing and attic insulation	107%
Air sealing without attic insulation	100%

<sup>1051</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1052</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

<sup>1053</sup> As demonstrated in air sealing and insulation research by Navigant, see Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company. These adjustment factors are based on a consumption data analysis using matching to non-participants. The values are therefore between net and gross with respect to free ridership. Like all consumption data analyses, they are net with respect to participant spillover and gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to the savings will be determined as part of the annual SAG net-to-gross process.

IE<sub>NetCorrection</sub> = 100% if not income eligible or air sealing is installed without attic insulation  
 = 110% if installing air sealing and attic insulation in income eligible projects with a deemed NTG value of 1.0 to offset net savings adjustment inherent when using ADJ<sub>AirSealingHeatFan</sub> of 107%<sup>1054</sup>

**For example:** energy savings from air sealing. Energy savings for attic insulation are included in a separate example in Section 5.6.5: Ceiling/Attic Insulation.

Assume a well shielded, 2 story non-income eligible single family home in Chicago completes air sealing, installs attic insulation, has a gas furnace with system efficiency of 70%, and has pre and post blower door test results of 3,400 and 2,250 (see therm calculation in Natural Gas Savings section):

$$\begin{aligned} \Delta\text{kWh}_{\text{heatingGas}} &= 76.3 * 0.0314 * 29.3 * 107\% * 100\% \\ &= 75.1 \text{ kWh} \end{aligned}$$

**Methodology 2: Prescriptive Infiltration Reduction Measures**<sup>1055</sup>

Savings shall only be calculated via Methodology 2 if a blower door test is not feasible. Cooling savings are not quantified using Methodology 2.

$$\begin{aligned} \Delta\text{kWh}_{\text{heating}} &= (\Delta\text{kWh}_{\text{gasket}} * n_{\text{gasket}} + \Delta\text{kWh}_{\text{windows}} * sf_{\text{windows}} + \Delta\text{kWh}_{\text{sweep}} * n_{\text{sweep}} + \Delta\text{kWh}_{\text{sealing}} * If_{\text{sealing}} + \\ &\Delta\text{kWh}_{\text{WX}} * If_{\text{WX}}) * \text{ADJ}_{\text{RxAirsealing}} * \text{ISR} \end{aligned}$$

Where:

$\Delta\text{kWh}_{\text{gasket}}$  = Annual kWh savings from installation of air sealing gasket on an electric outlet

Climate Zone (City based upon)	$\Delta\text{kWh}_{\text{gasket}} / \text{gasket}$	
	Electric Resistance	Heat Pump
1 (Rockford)	10.5	5.3
2 (Chicago)	10.2	5.1
3 (Springfield)	8.8	4.4
4 (Belleville)	7.0	3.5
5 (Marion)	7.2	3.6

$n_{\text{gasket}}$  = Number of gaskets installed

$\Delta\text{kWh}_{\text{windows}}$  = Annual kWh savings from installation of Shrink-Fit Window Kit<sup>1056</sup>

Climate Zone (City based upon)	$\Delta\text{kWh}_{\text{windows}} / \text{sf}$	$\Delta\text{kWh}_{\text{windows}} / \text{sf}$
	Electric Resistance	Heat Pump
1 (Rockford)	4.0	2.1

<sup>1054</sup> The additional value of 10% was selected to acknowledge that some portion of the regression-derived adjustment factors accounts for gross impact effects, and that removing net effects embedded in the adjustment factors would increase savings to some degree. A review of historical NTG values for air sealing and insulation measures in non-income eligible populations did not provide definitive guidance for estimating the net component of the adjustment factors. Historically, free ridership has ranged from 9% to 26% for like measures, and spillover has ranged from 1% to 14%, while NTGs have ranged from 0.75 to 1.05. The midpoint of the NTG range would be 0.90, a 10% reduction from 1.0.

<sup>1055</sup> Prescriptive savings are based upon “Evaluation of the Weatherization Residential Assistance Partnership and Helps Programs (WRAP/Helps).” Middletown, CT: KEMA, 2010. Accessed July 30, 2015, and adjusted for relative HDD of Bridgeport/Hartford CT with the IL climate zones. See ‘Rx Airsealing HDD adjustment.xls’ for more information.

<sup>1056</sup> Prescriptive savings are based upon “Cost Benefit Analysis for 2018, Annual Report submitted to Virginia Natural Gas, Inc., submitted by Nexant.” July 31, 2018. Adjusted for relative HDD of Virginia Beach VA with the IL climate zones. See “Window Film Savings Calculation.xlsx” for more information.

Climate Zone (City based upon)	$\Delta kWh_{\text{windows}} / sf$ Electric Resistance	$\Delta kWh_{\text{windows}} / sf$ Heat Pump
2 (Chicago)	3.9	2.0
3 (Springfield)	3.3	1.7
4 (Belleville)	2.5	1.3
5 (Marion)	2.6	1.3

$sf_{\text{windows}}$  = square footage of shrink-fit window film

$\Delta kWh_{\text{sweep}}$  = Annual kWh savings from installation of door sweep

Climate Zone (City based upon)	$\Delta kWh_{\text{sweep}} / \text{sweep}$	
	Electric Resistance	Heat Pump
1 (Rockford)	202.4	101.2
2 (Chicago)	195.3	97.6
3 (Springfield)	169.3	84.7
4 (Belleville)	134.9	67.5
5 (Marion)	137.9	68.9

$n_{\text{sweep}}$  = Number of sweeps installed

$\Delta kWh_{\text{sealing}}$  = Annual kWh savings from foot of caulking, sealing, or polyethylene tape

Climate Zone (City based upon)	$\Delta kWh_{\text{sealing}} / ft$	
	Electric Resistance	Heat Pump
1 (Rockford)	11.6	5.8
2 (Chicago)	11.2	5.6
3 (Springfield)	9.7	4.8
4 (Belleville)	7.7	3.9
5 (Marion)	7.9	3.9

$lf_{\text{sealing}}$  = linear feet of caulking, sealing, or polyethylene tape

$\Delta kWh_{\text{wx}}$  = Annual kWh savings from window weatherstripping or door weatherstripping

Climate Zone (City based upon)	$\Delta kWh_{\text{wx}} / ft$	
	Electric Resistance	Heat Pump
1 (Rockford)	13.5	6.7
2 (Chicago)	13.0	6.5
3 (Springfield)	11.3	5.6
4 (Belleville)	9.0	4.5
5 (Marion)	9.2	4.6

$lf_{\text{wx}}$  = Linear feet of window weatherstripping or door weatherstripping

$ADJ_{\text{RxAirsealing}}$  = Adjustment for air sealing savings to account for prescriptive estimates overclaiming savings<sup>1057</sup>  
= 80%

<sup>1057</sup> Though we do not have a specific evaluation to point to, modeled savings have often been found to overclaim. Further VEIC reviewed these deemed estimates and consider them to likely be a high estimate. As such an 80% adjustment is applied, and this could be further refined with future evaluations.



ISR = In service rate of weatherization kits dependant on install method as listed in table below.

Selection	ISR
Distributed School Weatherization Kits	0.58 <sup>1058</sup>
Other Weatherization Kits	0.87 <sup>1059</sup>
Direct Install, Retail	1.0

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\Delta kWh_{cooling} / FLH_{cooling}) * CF$$

Where:

FLH<sub>cooling</sub> = Full load hours of air conditioning  
 = Dependent on location:<sup>1060</sup>

Climate Zone (City based upon)	Single Family	Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
 = 68%<sup>1061</sup>

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 = 72%<sup>1062</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
 = 46.6%<sup>1063</sup>

Other factors as defined above.

<sup>1058</sup> ILLUME Advising LLC. School-Based Energy Education Programs: Goals, Challenges, and Opportunities. October 2015. See result for AEP Ohio Weather stripping/door sweep/gaskets kit in table on page 17.

<sup>1059</sup> For residential showerheads and aerators in the IL-TRM, the ratio of ISRs for opt-in kits to ISRs for distributed school kits vary from 1.9 to 2.4. For weatherization kits, opt-in ISRs are estimate at 1.5 times the distributed school ISR.

<sup>1060</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCDG) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH.

<sup>1061</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1062</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1063</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

**For example:** energy savings from air sealing. Energy savings for attic insulation are included in a separate example in Section 5.6.5: Ceiling/Attic Insulation.

Assume a well shielded, 2 story non-income eligible single family home in Chicago completes air sealing, installs attic insulation, has 10.5 SEER central cooling and a heat pump with COP of 2.0, and has pre and post blower door test results of 3,400 and 2,250:

$$\begin{aligned} \Delta kW_{SSP} &= 220 / 570 * 0.68 \\ &= 0.26 \text{ kW} \\ \Delta kW_{PJM} &= 220 / 570 * 0.466 \\ &= 0.18 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

**Methodology 1: Blower Door Test**

Preferred methodology unless blower door testing is not possible.

If Natural Gas heating:

$$\Delta \text{Therms} = (((\text{CFM50}_{\text{existing}} - \text{CFM50}_{\text{new}}) / \text{N}_{\text{heat}}) * 60 * 24 * \text{HDD} * 0.018) / (\eta_{\text{Heat}} * 100,000) * \text{ADJ}_{\text{AirSealingGasHeat}} * \text{IE}_{\text{NetCorrection}}$$

Where:

$\text{N}_{\text{heat}}$  = Conversion factor from leakage at 50 Pascal to leakage at natural conditions  
 = Based on climate zone and building height:<sup>1064</sup>

Climate Zone (City based upon)	N <sub>heat</sub> (by # of stories)			
	1	1.5	2	3
1 (Rockford)	23.8	21.1	19.3	17.1
2 (Chicago)	23.9	21.1	19.4	17.2
3 (Springfield)	24.2	21.5	19.7	17.4
4 (St Louis, MO)	25.4	22.5	20.7	18.3
5 (Paducah, KY)	27.8	24.6	22.6	20.0

HDD = Heating Degree Days  
 = dependent on location:<sup>1065</sup>

Climate Zone (City based upon)	HDD 60
1 (Rockford)	5,352
2 (Chicago)	5,113
3 (Springfield)	4,379
4 (Belleville)	3,378
5 (Marion)	3,438

<sup>1064</sup> N-factor is used to convert 50-pascal blower door air flows to natural air flows and is dependent on geographic location and # of stories. These were developed by applying the LBNL infiltration model (see LBNL paper 21040, *Exegisis of Proposed ASHRAE Standard 119: Air Leakage Performance for Detached Single-Family Residential Buildings*; Sherman, 1986; page v-vi, Appendix page 7-9) to the reported wind speeds and outdoor temperatures provided by the NRDC 30 year climate normals. For more information see Bruce Harley, CLEAResult "Infiltration Factor Calculations Methodology.doc".

<sup>1065</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F, consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in "Statistical Analysis of Historical State-Level Residential Energy Consumption Trends," 2004..

$\eta_{Heat}$  = Efficiency of heating system  
 = Equipment efficiency \* distribution efficiency  
 = Actual (where new or where it is possible to measure or reasonably estimate).<sup>1066</sup> If not available, use 72% for existing system efficiency.<sup>1067</sup>

$ADJ_{AirSealingGasHeat}$  = Adjustment for gas heating savings to account for inaccuracies in engineering algorithms:<sup>1068</sup>

Measure	$ADJ_{AirSealingGasHeat}$
Air sealing and attic insulation	72%
Air sealing without attic insulation	100%

$IE_{NetCorrection}$  = 100% if not income eligible or air sealing is installed without attic insulation  
 = 110% if installing air sealing and attic insulation in income eligible projects with a deemed NTG value of 1.0 to offset net savings adjustment inherent when using  $ADJ_{AirSealingGasHeat}$  of 72%<sup>1069</sup>

$\%GasHeat$  = Percent of homes that have gas space heating

Heating System	$\%GasHeat$
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>1070</sup>	87%

Other factors as defined above.

<sup>1066</sup> Ideally, the System Efficiency should be obtained either by recording the AFUE of the unit, or performing a steady state efficiency test. The Distribution Efficiency can be estimated via a visual inspection and by referring to a look up table such as that provided by the Building Performance Institute: (see ‘BPI Distribution Efficiency Table’) or by performing duct blaster testing.

<sup>1067</sup> Based on average Nicor PY4 nameplate efficiencies derated by 15% for distribution losses.

<sup>1068</sup> As demonstrated in air sealing and insulation research by Navigant, see Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company. These adjustment factors are based on a consumption data analysis using matching to non-participants. The values are therefore between net and gross with respect to free ridership. Like all consumption data analyses, they are net with respect to participant spillover and gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to the savings will be determined as part of the annual SAG net-to-gross process.

<sup>1069</sup> The additional value of 10% was selected to acknowledge that some portion of the regression-derived adjustment factors accounts for gross impact effects, and that removing net effects embedded in the adjustment factors would increase savings to some degree. A review of historical NTG values for air sealing and insulation measures in non-income eligible populations did not provide definitive guidance for estimating the net component of the adjustment factors. Historically, free ridership has ranged from 9% to 26% for like measures, and spillover has ranged from 1% to 14%, while NTGs have ranged from 0.75 to 1.05. The midpoint of the NTG range would be 0.90, a 10% reduction from 1.0.

<sup>1070</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

**For example:** energy savings from air sealing. Energy savings for attic insulation are included in a separate example in Section 5.6.5: Ceiling/Attic Insulation.

Assume a 2 story non-income eligible single family home in Chicago completes air sealing, installs attic insulation, has a gas furnace with system efficiency of 70%, and has pre and post blower door test results of 3,400 and 2,250:

$$\begin{aligned} \Delta\text{Therms} &= (((3,400 - 2,250)/19.4) * 60 * 24 * 5113 * 0.018) / (0.72 * 100,000) * 72\% * 100\% \\ &= 78.5 \text{ therms} \end{aligned}$$

**Methodology 2: Prescriptive Infiltration Reduction Measures<sup>1071</sup>**

Savings shall only be calculated via Methodology 2 if a blower door test is not feasible.

$$\begin{aligned} \Delta\text{therms} &= (\Delta\text{therms}_{\text{gasket}} * n_{\text{gasket}} + \Delta\text{therms}_{\text{windows}} * \text{sf}_{\text{windows}} + \Delta\text{therms}_{\text{Ssweep}} * n_{\text{sweep}} + \Delta\text{therms}_{\text{sealing}} \\ &\quad * \text{If}_{\text{sealing}} + \Delta\text{therms}_{\text{SWX}} * \text{If}_{\text{WX}}) * \text{ADJ}_{\text{RxAirsealing}} * \text{ISR} \end{aligned}$$

Where:

$\Delta\text{therms}_{\text{gasket}}$  = Annual therm savings from installation of air sealing gasket on an electric outlet

Climate Zone (City based upon)	$\Delta\text{therms}_{\text{gasket}} / \text{gasket}$ Gas Heat
1 (Rockford)	0.49
2 (Chicago)	0.47
3 (Springfield)	0.41
4 (Belleville)	0.33
5 (Marion)	0.33

$n_{\text{gasket}}$  = Number of gaskets installed

$\Delta\text{therms}_{\text{Swindows}}$  = Annual therm savings from installation of Shrink-Fit Window Kit:<sup>1072</sup>

Climate Zone (City based upon)	$\Delta\text{therms}_{\text{Swindows}} / \text{sf}$ Gas Heat
1 (Rockford)	0.191
2 (Chicago)	0.183
3 (Springfield)	0.156
4 (Belleville)	0.121
5 (Marion)	0.123

$\text{sf}_{\text{windows}}$  = square footage of shrink-fit window film

$\Delta\text{therms}_{\text{Ssweep}}$  = Annual therm savings from installation of door sweep

<sup>1071</sup> Prescriptive savings are based upon “Evaluation of the Weatherization Residential Assistance Partnership and Helps Programs (WRAP/Helps).” Middletown, CT: KEMA, 2010. Accessed July 30, 2015, and adjusted for relative HDD of Bridgeport/Hartford CT with the IL climate zones. See ‘Rx Airsealing HDD adjustment.xls’ for more information.

<sup>1072</sup> Prescriptive savings are based upon “Cost Benefit Analysis for 2018, Annual Report submitted to Virginia Natural Gas, Inc., submitted by Nexant.” July 31, 2018. Adjusted for relative HDD of Virginia Beach VA with the IL climate zones. See “Window Film Savings Calculation.xlsx” for more information.

Climate Zone (City based upon)	$\Delta\text{therms}_{\text{sweep}} / \text{sweep}$ Gas Heat
1 (Rockford)	9.46
2 (Chicago)	9.13
3 (Springfield)	7.92
4 (Belleville)	6.31
5 (Marion)	6.45

$n_{\text{sweep}}$  = Number of sweeps installed

$\Delta\text{therms}_{\text{sealing}}$  = Annual therm savings from foot of caulking, sealing, or polyethylene tape

Climate Zone (City based upon)	$\Delta\text{therms}_{\text{sealing}} / \text{ft}$ Gas Heat
1 (Rockford)	0.54
2 (Chicago)	0.52
3 (Springfield)	0.45
4 (Belleville)	0.36
5 (Marion)	0.37

$l_{\text{sealing}}$  = linear feet of caulking, sealing, or polyethylene tape

$\Delta\text{therms}_{\text{WX}}$  = Annual therm savings from window weatherstripping or door weatherstripping

Climate Zone (City based upon)	$\Delta\text{therms}_{\text{sx}} / \text{ft}$ Gas Heat
1 (Rockford)	0.63
2 (Chicago)	0.61
3 (Springfield)	0.53
4 (Belleville)	0.42
5 (Marion)	0.43

$l_{\text{WX}}$  = Linear feet of window weatherstripping or door weatherstripping

$ADJ_{\text{RxAirsealing}}$  = Adjustment for air sealing savings to account for prescriptive estimates overclaiming savings<sup>1073</sup>  
= 80%

ISR = In service rate of weatherization kits dependent on install method as listed in table below

Selection	ISR
Distributed School Weatherization Kits	0.58 <sup>1074</sup>
Other Weatherization Kits	0.87 <sup>1075</sup>
Direct Install, Retail	1.0

<sup>1073</sup> Though we do not have a specific evaluation to point to, modeled savings have often been found to overclaim. Further VEIC reviewed these deemed estimates and consider them to likely be a high estimate. As such an 80% adjustment is applied, and this could be further refined with future evaluations.

<sup>1074</sup> ILLUME Advising LLC. School-Based Energy Education Programs: Goals, Challenges, and Opportunities. October 2015. See result for AEP Ohio Weather stripping/door sweep/gaskets kit in table on page 17.

<sup>1075</sup> For residential showerheads and aerators in the IL-TRM, the ratio of ISRs for opt-in kits to ISRs for distributed school kits vary from 1.9 to 2.4. For weatherization kits, opt-in ISRs are estimate at 1.5 times the distributed school ISR.

**Mid-Life adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the life time of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Electric Resistance	1.0 COP
	Heat Pump (8.2HSPF/3.413)*0.85	2.04 COP
	Furnace 90% AFUE * 0.85	76.5% AFUE
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>1076</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-SHL-AIRS-V09-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>1076</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

## 5.6.2. Basement Sidewall Insulation

### DESCRIPTION

Insulation is added to a basement or crawl space. Insulation added above ground in conditioned space is modeled the same as wall insulation. Below ground insulation is adjusted with an approximation of the thermal resistance of the ground. Insulation in unconditioned spaces is modeled by reducing the degree days to reflect the smaller but non-zero contribution to heating and cooling load. Cooling savings only consider above grade insulation, as below grade has little temperature difference during the cooling season.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

This measure requires a member of the implementation staff or a participating contractor to evaluate the pre and post R-values and measure surface areas. The requirements for participation in the program will be defined by the utilities.

### DEFINITION OF BASELINE EQUIPMENT

The existing condition will be evaluated by implementation staff or a participating contractor and is likely to be no basement wall or ceiling insulation.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>1077</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years or 13 years for boilers.<sup>1078</sup> See section below for detail.

### DEEMED MEASURE COST

The actual installed cost for this measure should be used in screening.

### DEEMED O&M COST ADJUSTMENTS

N/A

### LOADSHAPE

Loadshape R08 - Residential Cooling

Loadshape R09 - Residential Electric Space Heat

Loadshape R10 - Residential Electric Heating and Cooling

### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's

---

<sup>1077</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1078</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

capacity market.

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
= 68%<sup>1079</sup>
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
= 72%<sup>1080</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 46.6%<sup>1081</sup>

---



---

### Algorithm

---



---

#### CALCULATION OF SAVINGS

#### ELECTRIC ENERGY SAVINGS

Where available savings from shell insulation measures should be determined through a custom analysis. When that is not feasible for the program the following engineering algorithms can be used with the inclusion of an adjustment factor to de-rate the heating savings.

$$\Delta kWh = (\Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas})$$

Where:

$$\begin{aligned} \Delta kWh_{cooling} &= \text{If central cooling, reduction in annual cooling requirement due to insulation} \\ &= \left( \left( \left( \frac{1}{R_{old\_AG}} - \frac{1}{R_{added} + R_{old\_AG}} \right) * L_{basement\_wall\_total} * \right. \right. \\ &\quad \left. \left. H_{basement\_wall\_AG} * (1 - Framing\_factor) * 24 * CDD * DUA \right) / (1000 * \eta_{Cool}) \right) * \\ &\quad ADJ_{BasementCool} * \%Cool \end{aligned}$$

R<sub>added</sub> = R-value of additional spray foam, rigid foam, or cavity insulation.

R<sub>old\_AG</sub> = R-value value of foundation wall above grade.  
= Actual, if unknown assume 1.0.<sup>1082</sup>

L<sub>basement\_wall\_total</sub> = Length of basement wall around the entire insulated perimeter (ft)

H<sub>basement\_wall\_AG</sub> = Height of insulated basement wall above grade (ft)

Framing\_factor = Adjustment to account for area of framing when cavity insulation is used  
= 0% if Spray Foam or External Rigid Foam  
= 25% if studs and cavity insulation<sup>1083</sup>

24 = Converts hours to days

CDD = Cooling Degree Days

<sup>1079</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1080</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>1081</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1082</sup> ORNL Builders Foundation Handbook, crawl space data from Table 5-5: Initial Effective R-values for Uninsulated Foundation System and Adjacent Soil, 1991.

<sup>1083</sup> ASHRAE, 2001, "Characterization of Framing Factors for New Low-Rise Residential Building Envelopes (904-RP)," Table 7.1



= Dependent on location and whether basement is conditioned:<sup>1084</sup>

Climate Zone (City based upon)	Conditioned CDD 65	Unconditioned CDD 65 <sup>1085</sup>
1 (Rockford)	820	263
2 (Chicago)	842	281
3 (Springfield)	1,108	436
4 (Belleville)	1,570	538
5 (Marion)	1,370	570
Weighted Average <sup>1086</sup>	947	325

DUA = Discretionary Use Adjustment (reflects the fact that people do not always operate their AC when conditions may call for it).

= 0.75<sup>1087</sup>

1000 = Converts Btu to kBtu

$\eta$ Cool = Seasonal Energy Efficiency Ratio of cooling system (kBtu/kWh)

= Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume the following:<sup>1088</sup>

Age of Equipment	$\eta$ Cool Estimate
Before 2006	10
2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

ADJ<sub>BasementCool</sub> = Adjustment for cooling savings from basement wall insulation to account for prescriptive engineering algorithms overclaiming savings<sup>1089</sup>

= 80%

%Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program)	66%

<sup>1084</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 65°F. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1085</sup> Five year average cooling degree days with 75F base temp from DegreeDays.net were used in this table because the 30 year climate normals from NCDC used elsewhere are not available at base temps above 72F.

<sup>1086</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1087</sup> This factor's source is: Energy Center of Wisconsin, May 2008 metering study; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research", p31.

<sup>1088</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>1089</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo "Results for AIC PY6 HPwES Billing Analysis", dated February 20, 2015. TAC negotiated adjustment factor is 80%.

Central Cooling? evaluation only) <sup>1090</sup>	%Cool

$\Delta kWh_{heatingElectric}$  = If electric heat (resistance or heat pump), reduction in annual electric heating due to insulation

$$= [(((1/R_{old\_AG} - 1/(R_{added}+R_{old\_AG})) * L_{basement\_wall\_total} * H_{basement\_wall\_AG} * (1-Framing\_factor)) + ((1/R_{old\_BG} - 1/(R_{added}+R_{old\_BG})) * L_{basement\_wall\_total} * (H_{basement\_wall\_total} - H_{basement\_wall\_AG}) * (1-Framing\_factor)))] * 24 * HDD) / (3,412 * \eta_{Heat}) * ADJ_{BasementHeat} * \%ElectricHeat$$

Where

$R_{old\_BG}$  = R-value value of foundation wall below grade (including thermal resistance of the earth)<sup>1091</sup>  
 = dependent on depth of foundation ( $H_{basement\_wall\_total} - H_{basement\_wall\_AG}$ ):  
 = Actual R-value of wall plus average earth R-value by depth in table below

Below Grade R-value									
Depth below grade (ft)	0	1	2	3	4	5	6	7	8
Earth R-value (°F-ft <sup>2</sup> -h/Btu)	2.44	4.50	6.30	8.40	10.44	12.66	14.49	17.00	20.00
Average Earth R-value (°F-ft <sup>2</sup> -h/Btu)	2.44	3.47	4.41	5.41	6.42	7.46	8.46	9.53	10.69
Total BG R-value (earth + R-1.0 foundation) default	3.44	4.47	5.41	6.41	7.42	8.46	9.46	10.53	11.69

$H_{basement\_wall\_total}$  = Total height of basement wall (ft)

HDD = Heating Degree Days  
 = dependent on location and whether basement is conditioned:<sup>1092</sup>

Climate Zone (City based upon)	Conditioned HDD 60	Unconditioned HDD 50
1 (Rockford)	5,352	3,322
2 (Chicago)	5,113	3,079
3 (Springfield)	4,379	2,550
4 (Belleville)	3,378	1,789
5 (Marion)	3,438	1,796
Weighted Average <sup>1093</sup>	4,860	2,895

<sup>1090</sup> Percentage of homes in Illinois that have central cooling from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1091</sup> Adapted from Table 1, page 24.4, of the 1977 ASHRAE Fundamentals Handbook

<sup>1092</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F for a conditioned basement and 50°F for an unconditioned basement), consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in “Statistical Analysis of Historical State-Level Residential Energy Consumption Trends,” 2004. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1093</sup> Weighted based on number of occupied residential housing units in each zone.

$\eta_{Heat}$  = Efficiency of heating system  
 = Actual (where new or where it is possible to measure or reasonably estimate).  
 If not available refer to default table below:<sup>1094</sup>

System Type	Age of Equipment	HSPF Estimate	$\eta_{Heat}$ (Effective COP Estimate) (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	After 2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown (for use in program evaluation only) <sup>1095</sup>	N/A	N/A	1.28

$ADJ_{BasementHeat}$  = Adjustment for basement wall insulation to account for prescriptive engineering algorithms overclaiming savings<sup>1096</sup>  
 = 60%

$\%ElectricHeat$  = Percent of homes that have electric space heating

Heating System	$\%ElectricHeat$
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>1097</sup>	13%

<sup>1094</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time means that using the minimum standard is appropriate. An 85% distribution efficiency is then applied to account for duct losses for heat pumps.

<sup>1095</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see "HC6.9 Space Heating in Midwest Region.xls", using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

<sup>1096</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo "Results for AIC PY6 HPwES Billing Analysis", dated February 20, 2015. TAC negotiated adjustment factor is 60%.

<sup>1097</sup> Based on Illinois data from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

**For example**, a single family home in Chicago with a 20 by 25 by 7 foot R-2.25 basement, with 3 feet above grade, insulated with R-13 of interior spray foam, 10.5 SEER Central AC and 2.26 COP Heat Pump:

$$\begin{aligned} \Delta kWh &= (\Delta kWh_{cooling} + \Delta kWh_{heating}) \\ &= [((((1/2.25 - 1/(13 + 2.25)) * (20+25+20+25) * 3 * (1 - 0)) * 24 * 281 * 0.75)/(1000 * 10.5)) * 0.8 * 100\%] + [((((1/2.25 - 1/(13 + 2.25)) * (20+25+20+25) * 3 * (1-0)) + ((1 / (2.25 + 6.42) - 1 / (13 + 2.25 + 6.42)) * (20+25+20+25) * 4 * (1-0))) * 24 * 3079) / (3412 * 1.92)) * 0.6 * 100\%] \\ &= (39.4 + 860.9) \\ &= 900.3 kWh \end{aligned}$$

$$\begin{aligned} \Delta kWh_{heatingGas} &= \text{If gas furnace heat, kWh savings for reduction in fan run time} \\ &= \Delta \text{Therms} * F_e * 29.3 \end{aligned}$$

$$\begin{aligned} F_e &= \text{Furnace Fan energy consumption as a percentage of annual fuel consumption} \\ &= 3.14\%^{1098} \end{aligned}$$

$$29.3 = \text{kWh per therm}$$

**For example**, a single family home in Chicago with a 20 by 25 by 7 foot unconditioned basement, with 3 feet above grade, insulated with R-13 of interior spray foam, and a 70% efficient furnace (for therm calculation see Natural Gas Savings section :

$$\begin{aligned} &= 78.3 * 0.0314 * 29.3 \\ &= 72.0 kWh \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND**

$$\Delta kW = (\Delta kWh_{cooling} / FLH_{cooling}) * CF$$

Where:

$$\begin{aligned} FLH_{cooling} &= \text{Full load hours of air conditioning} \\ &= \text{dependent on location:}^{1099} \end{aligned}$$

Climate Zone (City based upon)	Single Family	Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>1100</sup>	629	564

<sup>1098</sup> F<sub>e</sub> is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy (E<sub>f</sub> in MMBtu/yr) and E<sub>ae</sub> (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2% F<sub>e</sub>. See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

<sup>1099</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCD) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1100</sup> Weighted based on number of occupied residential housing units in each zone.

- Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily
- $CF_{SSP}$  = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 68%<sup>1101</sup>
- $CF_{SSP}$  = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
= 72%<sup>1102</sup>
- $CF_{PJM}$  = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
= 46.6%<sup>1103</sup>

**For example**, a single family home in Chicago with a 20 by 25 by 7 foot unconditioned basement, with 3 feet above grade, insulated with R-13 of interior spray foam, 10.5 SEER Central AC and 2.26 COP Heat Pump:

$$\Delta kW_{SSP} = 39.4 / 570 * 0.68$$

$$= 0.047 \text{ kW}$$

$$\Delta kW_{PJM} = 39.4 / 570 * 0.466$$

$$= 0.032 \text{ kW}$$

### NATURAL GAS SAVINGS

If Natural Gas heating:

$$\Delta \text{Therms} = (((1/R_{old\_AG} - 1/(R_{added}+R_{old\_AG})) * L_{basement\_wall\_total} * H_{basement\_wall\_AG} * (1-Framing\_factor)) + ((1/R_{old\_BG} - 1/(R_{added}+R_{old\_BG})) * L_{basement\_wall\_total} * (H_{basement\_wall\_total} - H_{basement\_wall\_AG}) * (1-Framing\_factor))) * 24 * HDD) / (\eta_{Heat} * 100,000) * ADJ_{BasementHeat} * \%GasHeat$$

- $\eta_{Heat}$  = Efficiency of heating system  
= Equipment efficiency \* distribution efficiency  
= Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume 72% for existing system efficiency<sup>1104</sup>
- $\%GasHeat$  = Percent of homes that have gas space heating

Heating System	$\%GasHeat$
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>1105</sup>	87%

Other factors as defined above

<sup>1101</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1102</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1103</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1104</sup> Based on average Nicor PY4 nameplate efficiencies derated by 15% for distribution losses.

<sup>1105</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

**For example**, a single family home in Chicago with a 20 by 25 by 7 foot R-2.25 basement, with 3 feet above grade, insulated with R-13 of interior spray foam, and a 72% efficient furnace:

$$= \left( \left( \left( \left( \frac{1}{2.25} - \frac{1}{13 + 2.25} \right) * (20+25+20+25) * 3 * (1-0) \right) + \left( \frac{1}{8.67} - \frac{1}{13 + 8.67} \right) * (20+25+20+25) * 4 * (1 - 0) \right) * 24 * 3079 \right) / (0.72 * 100,000) * 0.60$$

= 78.3 therms

**Mid-Life adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Electric Resistance	1.0 COP
	Heat Pump (8.2HSPF/3.413)*0.85	2.04 COP
	Furnace 90% AFUE * 0.85	76.5% AFUE
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>1106</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-SHL-BINS-V11-210101**

**REVIEW DEADLINE: 1/1/2025**

<sup>1106</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

### 5.6.3. Floor Insulation Above Crawlspace

#### **DESCRIPTION**

Insulation is added to the floor above a vented crawl space that does not contain pipes or HVAC equipment. If there are pipes, HVAC, or a basement, it is desirable to keep them within the conditioned space by insulating the crawl space walls and ground. Insulating the floor separates the conditioned space above from the space below the floor, and is only acceptable when there is nothing underneath that could freeze or would operate less efficiently in an environment resembling the outdoors. Even in the case of an empty, unvented crawl space, it is still considered best practice to seal and insulate the crawl space perimeter rather than the floor. Not only is there generally less area to insulate this way, but there are also moisture control benefits. There is a “Basement Insulation” measure for perimeter sealing and insulation. This measure assumes the insulation is installed above an unvented crawl space and should not be used in other situations.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

#### **DEFINITION OF EFFICIENT EQUIPMENT**

This measure requires a member of the implementation staff or a participating contractor to evaluate the pre and post R-values and measure surface areas. The requirements for participation in the program will be defined by the utilities.

#### **DEFINITION OF BASELINE EQUIPMENT**

The existing condition will be evaluated by implementation staff or a participating contractor and is likely to be no insulation on any surface surrounding a crawl space.

#### **DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The expected measure life is assumed to be 20 years.<sup>1107</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years or 13 years for boilers.<sup>1108</sup> See section below for detail.

#### **DEEMED MEASURE COST**

The actual installed cost for this measure should be used in screening.

#### **DEEMED O&M COST ADJUSTMENTS**

N/A

#### **LOADSHAPE**

- Loadshape R08 - Residential Cooling
- Loadshape R09 - Residential Electric Space Heat
- Loadshape R10 - Residential Electric Heating and Cooling

#### **COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate

---

<sup>1107</sup> As recommended in Navigant ‘ComEd Effective Useful Life Research Report’, May 2018.

<sup>1108</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM’s capacity market.

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
= 68%<sup>1109</sup>
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
= 72%<sup>1110</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
= 46.6%<sup>1111</sup>

---



---

**Algorithm**

---



---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Where available savings from shell insulation measures should be determined through a custom analysis. When that is not feasible for the program the following engineering algorithms can be used with the inclusion of an adjustment factor to de-rate the heating savings.

$$\Delta kWh = (\Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas})$$

Where:

- $\Delta kWh_{cooling}$  = If central cooling, reduction in annual cooling requirement due to insulation  
=  $\frac{(((1/R_{old} - 1/(R_{added} + R_{old})) * Area * (1 - Framing\_factor)) * 24 * CDD * DUA) / (1000 * \eta_{Cool})) * ADJ_{FloorCool} * \%Cool$
- R<sub>old</sub> = R-value value of floor before insulation, assuming 3/4” plywood subfloor and carpet with pad  
= Actual. If unknown assume 3.53<sup>1112</sup>
- R<sub>added</sub> = R-value of additional spray foam, rigid foam, or cavity insulation.
- Area = Total floor area to be insulated
- Framing\_factor = Adjustment to account for area of framing  
= 12%<sup>1113</sup>
- 24 = Converts hours to days
- CDD = Cooling Degree Days

<sup>1109</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1110</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1111</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1112</sup> Based on 2005 ASHRAE Handbook – Fundamentals: assuming ¾” subfloor, ½” carpet with rubber pad, and accounting for a still air film above and below: 0.68 + 0.94 + 1.23 + 0.68 = 3.53

<sup>1113</sup> ASHRAE, 2001, “Characterization of Framing Factors for New Low-Rise Residential Building Envelopes (904-RP),” Table 7.1



Climate Zone (City based upon)	Unconditioned CDD <sup>1114</sup>
1 (Rockford)	263
2 (Chicago)	281
3 (Springfield)	436
4 (Belleville)	538
5 (Marion)	570
Weighted Average <sup>1115</sup>	325

DUA = Discretionary Use Adjustment (reflects the fact that people do not always operate their AC when conditions may call for it).

= 0.75<sup>1116</sup>

1000 = Converts Btu to kBtu

$\eta_{Cool}$  = Seasonal Energy Efficiency Ratio of cooling system (kBtu/kWh)

= Actual (where it is possible to measure or reasonably estimate). If unknown assume the following:<sup>1117</sup>

Age of Equipment	$\eta_{Cool}$ Estimate
Before 2006	10
2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

$ADJ_{FloorCool}$  = Adjustment for cooling savings from floor to account for prescriptive engineering algorithms overclaiming savings<sup>1118</sup>

= 80%

%Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>1119</sup>	66%

<sup>1114</sup> Five year average cooling degree days with 75F base temp from DegreeDays.net were used in this table because the 30 year climate normals from NCDC used elsewhere are not available at base temps above 72F.

<sup>1115</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1116</sup> Energy Center of Wisconsin, May 2008 metering study; “Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research”, p31.

<sup>1117</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>1118</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo “Results for AIC PY6 HPwES Billing Analysis”, dated February 20, 2015. TAC negotiated adjustment factor is 80%.

<sup>1119</sup> Percentage of homes in Illinois that have central cooling from “Table HC7.9 Air Conditioning in Homes in Midwest Region,

$\Delta kWh_{heatingElectric}$  = If electric heat (resistance or heat pump), reduction in annual electric heating due to insulation

$$= ((1/R_{old} - 1/(R_{added} + R_{old})) * Area * (1-Framing\_factor) * 24 * HDD) / (3,412 * \eta_{Heat}) * ADJ_{FloorHeat} * \%ElectricHeat$$

HDD = Heating Degree Days:<sup>1120</sup>

Climate Zone (City based upon)	Unconditioned HDD
1 (Rockford)	3,322
2 (Chicago)	3,079
3 (Springfield)	2,550
4 (Belleville)	1,789
5 (Marion)	1,796
Weighted Average <sup>1121</sup>	2,895

$\eta_{Heat}$  = Efficiency of heating system

= Actual. If not available refer to default table below:<sup>1122</sup>

System Type	Age of Equipment	HSPF Estimate	$\eta_{Heat}$ (Effective COP Estimate) (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown (for use in program evaluation only) <sup>1123</sup>	N/A	N/A	1.28

$ADJ_{FloorHeat}$  = Adjustment for floor insulation to account for prescriptive engineering algorithms overclaiming savings<sup>1124</sup>

= 60%

Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1120</sup> National Climatic Data Center, Heating Degree Days with a base temp of 50°F to account for lower impact of unconditioned space on heating system. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1121</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1122</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time means that using the minimum standard is appropriate. An 85% distribution efficiency is then applied to account for duct losses for heat pumps.

<sup>1123</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

<sup>1124</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo “Results for AIC PY6 HPwES Billing Analysis”, dated February 20, 2015. TAC negotiated adjustment factor is 60%.

%ElectricHeat = Percent of homes that have electric space heating

Heating System	%ElectricHeat
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>1125</sup>	13%

Other factors as defined above.

**For example**, a single family home in Chicago with a 20 by 25 footprint, insulated with R-30 spray foam above the crawlspace, a 10.5 SEER Central AC and a newer heat pump:

$$\begin{aligned} \Delta kWh &= (\Delta kWh_{cooling} + \Delta kWh_{heating}) \\ &= (((1/3.53 - 1/(30+3.53)) * (20*25) * (1-0.12) * 24 * 281 * 0.75) / (1000 * 10.5)) * 0.8 * 1 + \\ &\quad (((1/3.53 - 1/(30+3.53)) * (20*25) * (1-0.15) * 24 * 3079) / (3412 * 1.92)) * 0.6 * 1) \\ &= (42.9 + 729.1) \\ &= 772 \text{ kWh} \end{aligned}$$

$$\begin{aligned} \Delta kWh_{heatingGas} &= \text{If gas furnace heat, kWh savings for reduction in fan run time} \\ &= \Delta Therms * F_e * 29.3 \end{aligned}$$

$$\begin{aligned} F_e &= \text{Furnace Fan energy consumption as a percentage of annual fuel consumption} \\ &= 3.14\%^{1126} \end{aligned}$$

$$29.3 = \text{kWh per therm}$$

**For example**, a single family home in Chicago with a 20 by 25 footprint, insulated with R-30 spray foam above the crawlspace, and a 70% efficient furnace (for therm calculation see Natural Gas Savings section):

$$\begin{aligned} \Delta kWh &= 68.7 * 0.0314 * 29.3 \\ &= 63.2 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh_{cooling} / FLH_{cooling}) * CF$$

Where:

$$\begin{aligned} FLH_{cooling} &= \text{Full load hours of air conditioning} \\ &= \text{Dependent on location:}^{1127} \end{aligned}$$

<sup>1125</sup> Based on Illinois data from “Table HC.7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1126</sup> F<sub>e</sub> is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy (E<sub>f</sub> in MMBtu/yr) and E<sub>ae</sub> (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2% F<sub>e</sub>. See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

<sup>1127</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCD) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH. There is a county mapping table Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

Climate Zone (City based upon)	Single Family	Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>1128</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 68%<sup>1129</sup>
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
= 72%<sup>1130</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
= 46.6%<sup>1131</sup>

**For example**, a single family home in Chicago with a 20 by 25 footprint, insulated with R-30 spray foam above the crawlspace, a 10.5 SEER Central AC and a newer heat pump:

$$\Delta kW_{SSP} = 42.9 / 570 * 0.68$$

$$= 0.051 \text{ kW}$$

$$\Delta kW_{SSP} = 42.9 / 570 * 0.466$$

$$= 0.035 \text{ kW}$$

**NATURAL GAS SAVINGS**

If Natural Gas heating:

$$\Delta \text{Therms} = ((1/R_{old} - 1/(R_{added}+R_{old})) * \text{Area} * (1-\text{Framing\_factor}) * 24 * \text{HDD}) / (100,000 * \eta_{Heat}) * \text{ADJ}_{\text{FloorHeat}} * \% \text{GasHeat}$$

Where

- $\eta_{Heat}$  = Efficiency of heating system
- = Equipment efficiency \* distribution efficiency
- = Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume 72% for existing system efficiency.<sup>1132</sup>

<sup>1128</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1129</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1130</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1131</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1132</sup> Based on average Nicor PY4 nameplate efficiencies derated by 15% for distribution losses.

%GasHeat = Percent of homes that have gas space heating

Heating System	%GasHeat
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>1133</sup>	87%

Other factors as defined above

**For example**, a single family home in Chicago with a 20 by 25 footprint, insulated with R-30 spray foam above the crawlspace, and a 72% efficient furnace:

$$\Delta\text{Therms} = ((1 / 3.53 - 1 / (30 + 3.53)) * (20 * 25) * (1 - 0.12) * 24 * 3079) / (100,000 * 0.72) * 0.60 * 1$$

$$= 68.7 \text{ therms}$$

**Mid-Life adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Electric Resistance	1.0 COP
	Heat Pump (8.2HSPF/3.413)*0.85	2.04 COP
	Furnace 90% AFUE * 0.85	76.5% AFUE
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>1134</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

<sup>1133</sup> Based on Illinois data from “Table HC.7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1134</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

**MEASURE CODE: RS-SHL-FINS-V12-210101**

**REVIEW DEADLINE: 1/1/2023**

## 5.6.4. Wall Insulation

### DESCRIPTION

Insulation is added to wall cavities. This measure requires a member of the implementation staff evaluating the pre and post R-values and measure surface areas. The efficiency of the heating and cooling equipment in the home should also be evaluated if possible.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

This measure requires a member of the implementation staff or a participating contractor to evaluate the pre and post R-values and measure surface areas. The requirements for participation in the program will be defined by the utilities.

### DEFINITION OF BASELINE EQUIPMENT

The existing condition will be evaluated by implementation staff or a participating contractor and is likely to be empty wall cavities.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>1135</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years or 13 years for boilers.<sup>1136</sup> See section below for detail.

### DEEMED MEASURE COST

The actual installed cost for this measure should be used in screening.

### LOADSHAPE

Loadshape R08 - Residential Cooling

Loadshape R09 - Residential Electric Space Heat

Loadshape R10 - Residential Electric Heating and Cooling

### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market.

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)} \\ &= 68\%^{1137} \end{aligned}$$

---

<sup>1135</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1136</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

<sup>1137</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 = 72%<sup>1138</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>1139</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Where available savings from shell insulation measures should be determined through a custom analysis. When that is not feasible for the program the following engineering algorithms can be used with the inclusion of an adjustment factor to de-rate the heating savings.

$$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas}$$

Where

$\Delta kWh_{cooling}$  = If central cooling, reduction in annual cooling requirement due to wall insulation  
 =  $\frac{(((1/R_{old} - 1/R_{wall}) * A_{wall} * (1 - Framing\_factor\_wall)) * 24 * CDD * DUA) / (1000 * \eta_{Cool}) * ADJ_{WallCool} * \%Cool}$

R<sub>wall</sub> = R-value of new wall assembly (including all layers between inside air and outside air).

R<sub>old</sub> = R-value value of existing assembly and any existing insulation.  
 (Minimum of R-5 for uninsulated assemblies)<sup>1140</sup>

A<sub>wall</sub> = Net area of insulated wall (ft<sup>2</sup>)

Framing\_factor\_wall = Adjustment to account for area of framing  
 = 25%<sup>1141</sup>

24 = Converts hours to days

CDD = Cooling Degree Days  
 = dependent on location:<sup>1142</sup>

Climate Zone (City based upon)	CDD 65
1 (Rockford)	820
2 (Chicago)	842
3 (Springfield)	1,108
4 (Belleville)	1,570

<sup>1138</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.  
<sup>1139</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1140</sup> An estimate based on review of Madison Gas and Electric, Exterior Wall Insulation, R-value for no insulation in walls, and NREL's Building Energy Simulation Test for Existing Homes (BESTEST-EX).  
<sup>1141</sup> ASHRAE, 2001, "Characterization of Framing Factors for New Low-Rise Residential Building Envelopes (904-RP)," Table 7.1  
<sup>1142</sup> National Climatic Data Center, Cooling Degree Days are based on a base temp of 65°F. There is a county mapping table Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.



Climate Zone (City based upon)	CDD 65
5 (Marion)	1,370
Weighted Average <sup>1143</sup>	947

DUA = Discretionary Use Adjustment (reflects the fact that people do not always operate their AC when conditions may call for it).  
= 0.75<sup>1144</sup>

1000 = Converts Btu to kBtu

$\eta_{Cool}$  = Seasonal Energy Efficiency Ratio of cooling system (kBtu/kWh)  
= Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume the following:<sup>1145</sup>

Age of Equipment	$\eta_{Cool}$ Estimate
Before 2006	10
2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

$ADJ_{WallCool}$  = Adjustment for cooling savings from wall insulation to account for inaccuracies in prescriptive engineering algorithms<sup>1146</sup>  
= 80%

%Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>1147</sup>	66%

kWh\_heatingElectric = If electric heat (resistance or heat pump), reduction in annual electric heating due to wall insulation  
=  $((1/R_{old} - 1/R_{wall}) * A_{wall} * (1 - Framing\_factor\_wall) * 24 * HDD) / (\eta_{Heat} * )$

<sup>1143</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1144</sup> This factor's source is: Energy Center of Wisconsin, May 2008 metering study; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research", p31.

<sup>1145</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>1146</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo "Results for AIC PY6 HPwES Billing Analysis", dated February 20, 2015. TAC negotiated adjustment factor is 80%.

<sup>1147</sup> Percentage of homes in Illinois that have central cooling from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

$$3412)) * ADJ_{WallHeat} * \%ElectricHeat$$

HDD

= Heating Degree Days

= Dependent on location:<sup>1148</sup>

Climate Zone (City based upon)	HDD 60
1 (Rockford)	5,352
2 (Chicago)	5,113
3 (Springfield)	4,379
4 (Belleville)	3,378
5 (Marion)	3,438
Weighted Average <sup>1149</sup>	4,860

$\eta_{Heat}$

= Efficiency of heating system

= Actual (where new or where it is possible to measure or reasonably estimate). If not available refer to default table below:<sup>1150</sup>

System Type	Age of Equipment	HSPF Estimate	$\eta_{Heat}$ (Effective COP Estimate) (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown (for use in program evaluation only) <sup>1151</sup>	N/A	N/A	1.28

3412

= Converts Btu to kWh

$ADJ_{WallHeat}$

= Adjustment for heating savings to account for inaccuracies in prescriptive engineering algorithms.<sup>1152</sup>

= 60%

<sup>1148</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F, consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in “Statistical Analysis of Historical State-Level Residential Energy Consumption Trends,” 2004. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1149</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1150</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time means that using the minimum standard is appropriate. An 85% distribution efficiency is then applied to account for duct losses for heat pumps.

<sup>1151</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

<sup>1152</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo “Results for AIC PY6 HPwES Billing Analysis”, dated February 20, 2015. TAC negotiated adjustment factor is 60%.

%ElectricHeat = Percent of homes that have electric space heating

Heating System	%ElectricHeat
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>1153</sup>	13%

**For example**, a single family home in Chicago with 990 ft<sup>2</sup> of R-5 walls insulated to R-11, 10.5 SEER Central AC and 2.26 (1.92 including distribution losses) COP Heat Pump:

$$\begin{aligned} \Delta kWh &= (\Delta kWh_{cooling} + \Delta kWh_{heating}) \\ &= (((((1/5 - 1/11) * 990 * (1-0.25)) * 842 * 0.75 * 24) / (1000 * 10.5)) * 80% * 100%) + \\ &\quad (((((1/5 - 1/11) * 990 * (1-0.25)) * 5113 * 24) / (1.92 * 3412)) * 60% * 100%) \\ &= 93.5 + 910 \\ &= 1,004 \text{ kWh} \end{aligned}$$

$\Delta kWh_{heatingGas}$  = If gas furnace heat, kWh savings for reduction in fan run time

$$= \Delta Therms * F_e * 29.3$$

$F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption

$$= 3.14\%^{1154}$$

29.3 = kWh per therm

**For example**, a single family home in Chicago with 990 ft<sup>2</sup> of R-5 walls insulated to R-11 with a gas furnace with system efficiency of 66% (for therm calculation see Natural Gas Savings section):

$$\begin{aligned} \Delta kWh_{heatingGas} &= 90.3 * 0.0314 * 29.3 \\ &= 83.1 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh_{cooling} / FLH_{cooling}) * CF$$

Where:

FLH<sub>cooling</sub> = Full load hours of air conditioning

= Dependent on location as below:<sup>1155</sup>

Climate Zone (City based upon)	Single Family	Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506

<sup>1153</sup> Based on Illinois data from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1154</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See "Programmable Thermostats Furnace Fan Analysis.xlsx" for reference.

<sup>1155</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

Climate Zone (City based upon)	Single Family	Multifamily
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>1156</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily.

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
= 68%<sup>1157</sup>

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
72%<sup>1158</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
= 46.6%<sup>1159</sup>

**For example**, a single family home in Chicago with 990 ft<sup>2</sup> of R-5 walls insulated to R-11, 10.5 SEER Central AC, and 2.26 COP Heat Pump:

$$\begin{aligned} \Delta kW_{SSP} &= 93.5 / 570 * 0.68 \\ &= 0.11 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} &= 93.5 / 570 * 0.466 \\ &= 0.08 \text{ kW} \end{aligned}$$

### NATURAL GAS SAVINGS

If Natural Gas heating:

$$\Delta \text{Therms} = (((1/R_{old} - 1/R_{wall}) * A_{wall} * (1 - \text{Framing\_factor\_wall}) * 24 * \text{HDD}) / (\eta_{\text{Heat}} * 100,000 \text{ Btu/therm})) * \text{ADJ}_{\text{WallHeat}} * \% \text{GasHeat}$$

Where:

HDD = Heating Degree Days  
= Dependent on location:<sup>1160</sup>

Climate Zone (City based upon)	HDD 60
1 (Rockford)	5,352

<sup>1156</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1157</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1158</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1159</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1160</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F, consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in “Statistical Analysis of Historical State-Level Residential Energy Consumption Trends,” 2004. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

Climate Zone (City based upon)	HDD 60
2 (Chicago)	5,113
3 (Springfield)	4,379
4 (Belleville)	3,378
5 (Marion)	3,438
Weighted Average <sup>1161</sup>	4,860

ηHeat = Efficiency of heating system  
 = Equipment efficiency \* distribution efficiency  
 = Actual (where new or where it is possible to measure or reasonably estimate).<sup>1162</sup> If unknown assume 72% for existing system efficiency.<sup>1163</sup>

%GasHeat = Percent of homes that have gas space heating

Heating System	%GasHeat
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>1164</sup>	87%

Other factors as defined above.

**For example**, a single family home in Chicago with 990 ft<sup>2</sup> of R-5 walls insulated to R-11, with a gas furnace with system efficiency of 66%:

$$\Delta\text{Therms} = (((1/5 - 1/11) * 990 * (1-0.25)) * 24 * 5113) / (0.66 * 100,000) * 60\% * 100\%$$

$$= 90.4 \text{ therms}$$

**Mid-Life adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Electric Resistance	1.0 COP
	Heat Pump (8.2HSPF/3.413)*0.85	2.04 COP
	Furnace	76.5% AFUE

<sup>1161</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1162</sup> Ideally, the System Efficiency should be obtained either by recording the AFUE of the unit, or performing a steady state efficiency test. The Distribution Efficiency can be estimated via a visual inspection and by referring to a look up table such as that provided by the Building Performance Institute: (see ‘BPI Distribution Efficiency Table’) or by performing duct blaster testing.

<sup>1163</sup> Based on average Nicor PY4 nameplate efficiencies derated by 15% for distribution losses.

<sup>1164</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

Efficiency Assumption	System Type	New Baseline Efficiency
	90% AFUE * 0.85	
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>1165</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-SHL-WINS-V10-210101**

**REVIEW DEADLINE: 1/1/2022**

---

<sup>1165</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

## 5.6.5. Ceiling/Attic Insulation

### DESCRIPTION

Insulation is added to attic. This measure requires a member of the implementation staff evaluating the pre and post R-values and measure surface areas. The efficiency of the heating and cooling equipment in the home should also be evaluated if possible.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

This measure requires a member of the implementation staff or a participating contractor to evaluate the pre and post R-values and measure surface areas. The requirements for participation in the program will be defined by the utilities.

### DEFINITION OF BASELINE EQUIPMENT

The existing condition will be evaluated by implementation staff or a participating contractor and is likely to be little or no attic insulation.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>1166</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years or 13 years for boilers.<sup>1167</sup> See section below for detail.

### DEEMED MEASURE COST

The actual installed cost for this measure should be used in screening.

### LOADSHAPE

Loadshape R08 - Residential Cooling

Loadshape R09 - Residential Electric Space Heat

Loadshape R10 - Residential Electric Heating and Cooling

### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market.

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)} \\ &= 68\%^{1168} \end{aligned}$$

---

<sup>1166</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1167</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

<sup>1168</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 = 72%<sup>1169</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>1170</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Where available savings from shell insulation measures should be determined through a custom analysis. When that is not feasible for the program the following engineering algorithms can be used with the inclusion of an adjustment factor to de-rate the heating savings.

$$\Delta kWh = (\Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas})$$

Where

$\Delta kWh_{cooling}$  = If central cooling, reduction in annual cooling requirement due to ceiling/attic insulation  
 =  $\frac{(((1/R_{old} - 1/R_{attic}) * A_{attic} * (1 - Framing\_factor_{attic})) * 24 * CDD * DUA) / (1000 * \eta_{Cool})}{ADJ_{AtticCool} * IE_{NetCorrection} * \%Cool}$

R<sub>attic</sub> = R-value of new attic assembly (including all layers between inside air and outside air).

R<sub>old</sub> = R-value value of existing assembly and any existing insulation.

(Minimum of R-3 for uninsulated assemblies)<sup>1171</sup>

A<sub>attic</sub> = Total area of insulated ceiling/attic (ft<sup>2</sup>)

Framing\_factor\_attic = Adjustment to account for area of framing  
 = 7%<sup>1172</sup>

24 = Converts hours to days

CDD = Cooling Degree Days  
 = dependent on location:<sup>1173</sup>

Climate Zone (City based upon)	CDD 65
1 (Rockford)	820
2 (Chicago)	842
3 (Springfield)	1,108
4 (Belleville)	1,570
5 (Marion)	1,370

<sup>1169</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.  
<sup>1170</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1171</sup> Component estimate of airfilm above and below, sheathing and sheet rock, (0.68+0.5+0.45+0.68 = 2.3) is rounded up to R-3.  
<sup>1172</sup> Ibid.

<sup>1173</sup> National Climatic Data Center, Cooling Degree Days are based on a base temp of 65°F. There is a county mapping table Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.



Climate Zone (City based upon)	CDD 65
Weighted Average <sup>1174</sup>	947

DUA = Discretionary Use Adjustment (reflects the fact that people do not always operate their AC when conditions may call for it).

= 0.75<sup>1175</sup>

1000 = Converts Btu to kBtu

$\eta_{Cool}$  = Seasonal Energy Efficiency Ratio of cooling system (kBtu/kWh)

= Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume the following:<sup>1176</sup>

Age of Equipment	SEER Estimate
Before 2006	10
2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

$ADJ_{AtticCool}$  = Adjustment for cooling savings to account for inaccuracies in engineering algorithms<sup>1177</sup>

= 121%

$IE_{NetCorrection}$  = 100% if not income eligible or attic insulation is installed without air sealing  
 = 110% if installing air sealing and attic insulation in income eligible projects with a deemed NTG value of 1.0 to offset net savings adjustment inherent when using  $ADJ_{AtticCool}$  of 121%<sup>1178</sup>

%Cool = Percent of homes that have cooling

<sup>1174</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1175</sup> This factor's source is: Energy Center of Wisconsin, May 2008 metering study; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research", p31.

<sup>1176</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>1177</sup> As demonstrated in air sealing and insulation research by Navigant, see Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company. Adjustment factor was derived from a consumption data regression analysis with an experimental design that does not require further net savings adjustment for non-income eligible populations.

<sup>1178</sup> The additional value of 10% was selected to acknowledge that some portion of the regression-derived adjustment factors accounts for gross impact effects, and that removing net effects embedded in the adjustment factors would increase savings to some degree. A review of historical NTG values for air sealing and insulation measures in non-income eligible populations did not provide definitive guidance for estimating the net component of the adjustment factors. Historically, free ridership has ranged from 9% to 26% for like measures, and spillover has ranged from 1% to 14%, while NTGs have ranged from 0.75 to 1.05. The midpoint of the NTG range would be 0.90, a 10% reduction from 1.0.

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>1179</sup>	66%

kWh\_heatingElectric = If electric heat (resistance or heat pump), reduction in annual electric heating due to attic insulation

$$= (((1/R_{old} - 1/R_{attic}) * A_{attic} * (1 - Framing\_factor\_attic)) * 24 * HDD) / (\eta_{Heat} * 3412) * ADJ_{AtticElectricHeat} * \%ElectricHeat$$

HDD = Heating Degree Days

= Dependent on location:<sup>1180</sup>

Climate Zone (City based upon)	HDD 60
1 (Rockford)	5,352
2 (Chicago)	5,113
3 (Springfield)	4,379
4 (Belleville)	3,378
5 (Marion)	3,438
Weighted Average <sup>1181</sup>	4,860

$\eta_{Heat}$  = Efficiency of heating system

= Actual (where new or where it is possible to measure or reasonably estimate). If not available refer to default table below:<sup>1182</sup>

System Type	Age of Equipment	HSPF Estimate	$\eta_{Heat}$ (Effective COP Estimate)= (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown (for use in program evaluation only) <sup>1183</sup>	N/A	N/A	1.28

<sup>1179</sup> Percentage of homes in Illinois that have central cooling from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1180</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F, consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in “Statistical Analysis of Historical State-Level Residential Energy Consumption Trends,” 2004. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1181</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1182</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time means that using the minimum standard is appropriate. An 85% distribution efficiency is then applied to account for duct losses for heat pumps.

<sup>1183</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration,

- 3412 = Converts Btu to kWh
- ADJ<sub>AtticElectricHeat</sub> = Adjustment for electric heating savings to account for inaccuracies in engineering algorithms<sup>1184</sup>  
= 60%
- %ElectricHeat = Percent of homes that have electric space heating

Heating System	%ElectricHeat
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>1185</sup>	13%

**For example:** energy savings from ceiling/attic insulation. Energy savings for air sealing are included in a separate example in Section 5.6.1: Air Sealing.

Assume a non-income eligible single family home in Chicago installs 700 ft<sup>2</sup> of attic insulation, completes air sealing, has 10.5 SEER Central AC and 2.26 (1.92 including distribution losses) COP Heat Pump, and has pre and post attic insulation R-values of R-5 and R-38, respectively:

$$\begin{aligned}
 \Delta kWh &= (\Delta kWh_{cooling} + \Delta kWh_{heating}) \\
 &= (((((1/5 - 1/38) * 700 * (1-0.07)) * 842 * 0.75 * 24) / (1000 * 10.5)) * 121\% * 100\% * 100\%) + \\
 &\quad (((((1/5 - 1/38) * 700 * (1-0.07)) * 5113 * 24) / (1.92 * 3412)) * 60\% * 100\%) \\
 &= 197 + 1,271 \\
 &= 1,468 \text{ kWh}
 \end{aligned}$$

- $\Delta kWh_{heatingGas}$  = If gas furnace heat, kWh savings for reduction in fan run time  
=  $\Delta Therms * F_e * 29.3 * ADJ_{AtticHeatFan} * IE_{NetCorrection}$
- $F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption  
= 3.14%<sup>1186</sup>
- 29.3 = kWh per therm
- ADJ<sub>AtticHeatFan</sub> = Adjustment for fan savings to account for inaccuracies in engineering algorithms<sup>1187</sup>

2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

<sup>1184</sup> As demonstrated in air sealing and insulation research by Navigant, Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company.

<sup>1185</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1186</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

<sup>1187</sup> As demonstrated in air sealing and insulation research by Navigant, see Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company. Adjustment factor was derived from a consumption data regression analysis with an experimental design that does not require further net savings adjustment for non-income eligible populations.

$$= 107\%$$

$$IE_{\text{NetCorrection}} = 100\% \text{ if not income eligible or attic insulation is installed without air sealing}$$

$$= 110\% \text{ if installing air sealing and attic insulation in income eligible projects with a deemed NTG value of 1.0 to offset net savings adjustment inherent when using } ADJ_{\text{AtticHeatFan}} \text{ of } 107\%^{1188}$$

**For example:** energy savings from ceiling/attic insulation. Energy savings for air sealing are included in a separate example in Section 5.6.1: Air Sealing.

Assume a non-income eligible single family home in Chicago installs 700 ft<sup>2</sup> of attic insulation, completes air sealing, has a gas furnace with system efficiency of 66% (for therm calculation see Natural Gas Savings section), and has pre and post attic insulation R-values of R-5 and R-38, respectively:

$$\Delta kWh = 147 * 0.0314 * 29.3 * 107\% * 100\%$$

$$= 145 \text{ kWh}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = (\Delta kWh_{\text{cooling}} / FLH_{\text{cooling}}) * CF$$

Where:

$$FLH_{\text{cooling}} = \text{Full load hours of air conditioning}$$

$$= \text{Dependent on location as below:}^{1189}$$

Climate Zone (City based upon)	Single Family	Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>1190</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

$$CF_{\text{SSP}} = \text{Summer System Peak Coincidence Factor for Central A/C (during system peak hour)}$$

$$= 68\%^{1191}$$

$$CF_{\text{SSP}} = \text{Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)}$$

<sup>1188</sup> The additional value of 10% was selected to acknowledge that some portion of the regression-derived adjustment factors accounts for gross impact effects, and that removing net effects embedded in the adjustment factors would increase savings to some degree. A review of historical NTG values for air sealing and insulation measures in non-income eligible populations did not provide definitive guidance for estimating the net component of the adjustment factors. Historically, free ridership has ranged from 9% to 26% for like measures, and spillover has ranged from 1% to 14%, while NTGs have ranged from 0.75 to 1.05. The midpoint of the NTG range would be 0.90, a 10% reduction from 1.0.

<sup>1189</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1190</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1191</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

$$CF_{PJM} = 72\%^{1192}$$

$$CF_{PJM} = \text{PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)}$$

$$CF_{PJM} = 46.6\%^{1193}$$

**For example:** energy savings from ceiling/attic insulation. Energy savings for air sealing are included in a separate example in Section 5.6.1: Air Sealing.

Assume a non-income eligible single family home in Chicago installs 700 ft<sup>2</sup> of attic insulation, has 10.5 SEER Central AC and 2.26 COP Heat Pump, and has pre and post attic insulation R-values of R-5 and R-38, respectively:

$$\Delta kW_{SSP} = 197 / 570 * 0.68$$

$$= 0.24 \text{ kW}$$

$$\Delta kW_{PJM} = 168 / 570 * 0.466$$

$$= 0.16 \text{ kW}$$

### NATURAL GAS SAVINGS

If Natural Gas heating:

$$\Delta \text{Therms} = (((1/R_{old} - 1/R_{attic}) * A_{attic} * (1 - \text{Framing\_factor\_attic})) * 24 * \text{HDD}) / (\eta_{\text{Heat}} * 100,000 \text{ Btu/therm}) * \text{ADJ}_{\text{AtticGasHeat}} * \text{IE}_{\text{NetCorrection}} * \% \text{GasHeat}$$

Where:

$$\text{HDD} = \text{Heating Degree Days}$$

$$= \text{Dependent on location:}^{1194}$$

Climate Zone (City based upon)	HDD 60
1 (Rockford)	5,352
2 (Chicago)	5,113
3 (Springfield)	4,379
4 (Belleville)	3,378
5 (Marion)	3,438
Weighted Average <sup>1195</sup>	4,860

$$\eta_{\text{Heat}} = \text{Efficiency of heating system}$$

$$= \text{Equipment efficiency} * \text{distribution efficiency}$$

$$= \text{Actual (where new or where it is possible to measure or reasonably estimate).}^{1196} \text{ If not}$$

<sup>1192</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>1193</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1194</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F, consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in "Statistical Analysis of Historical State-Level Residential Energy Consumption Trends," 2004. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1195</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1196</sup> Ideally, the System Efficiency should be obtained either by recording the AFUE of the unit, or performing a steady state efficiency test. The Distribution Efficiency can be estimated via a visual inspection and by referring to a look up table such as that provided by the Building Performance Institute: (see 'BPI Distribution Efficiency Table') or by performing duct blaster testing.

available, use 72% for existing system efficiency.<sup>1197</sup>

$ADJ_{AtticGasHeat}$  = Adjustment for gas heating savings to account for inaccuracies in engineering algorithms<sup>1198</sup>

= 72%

$IE_{NetCorrection}$  = 100% if not income eligible or attic insulation is installed without air sealing

= 110% if installing air sealing and attic insulation in income eligible projects with a deemed NTG value of 1.0 to offset net savings adjustment inherent when using  $ADJ_{AtticGasHeat}$  of 72%<sup>1199</sup>

$\%GasHeat$  = Percent of homes that have gas space heating

Heating System	$\%GasHeat$
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>1200</sup>	87%

Other factors as defined above.

**For example:** energy savings from ceiling/attic insulation. Energy savings for air sealing are included in a separate example in Section 5.6.1: Air Sealing.

Assume a non-income eligible single family home in Chicago installs 700 ft<sup>2</sup> of attic insulation, has a gas furnace with system efficiency of 66%, and has pre and post attic insulation R-values of R-5 and R-38, respectively:

$$\Delta Therms = (((1/5 - 1/38) * 700 * (1-0.07)) * 24 * 5113) / (0.66 * 100,000) * 72\% * 100\% * 100\%$$

$$= 151 \text{ therms}$$

### Mid-Life adjustment

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
$\eta_{Cool}$	Central AC	13 SEER
	Heat Pump	14 SEER
$\eta_{Heat}$	Electric Resistance	1.0 COP
	Heat Pump	2.04 COP

<sup>1197</sup> Based on average Nicor PY4 nameplate efficiencies derated by 15% for distribution losses.

<sup>1198</sup> As demonstrated in air sealing and insulation research by Navigant, Navigant (2018). *ComEd and Nicor Gas Air Sealing and Insulation Research Report*. Presented to Commonwealth Edison Company and Nicor Gas Company. Adjustment factor was derived from a consumption data regression analysis with an experimental design that does not require further net savings adjustment for non-income eligible populations.

<sup>1199</sup> The additional value of 10% was selected to acknowledge that some portion of the regression-derived adjustment factors accounts for gross impact effects, and that removing net effects embedded in the adjustment factors would increase savings to some degree. A review of historical NTG values for air sealing and insulation measures in non-income eligible populations did not provide definitive guidance for estimating the net component of the adjustment factors. Historically, free ridership has ranged from 9% to 26% for like measures, and spillover has ranged from 1% to 14%, while NTGs have ranged from 0.75 to 1.05. The midpoint of the NTG range would be 0.90, a 10% reduction from 1.0.

<sup>1200</sup> Based on Illinois data from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

Efficiency Assumption	System Type	New Baseline Efficiency
	(8.2HSPF/3.413)*0.85	
	Furnace 90% AFUE * 0.85	76.5% AFUE
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>1201</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-SHL-AINS-V03-210101**

**REVIEW DEADLINE: 1/1/2024**

---

<sup>1201</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

## 5.6.6. Rim/Band Joist Insulation

### DESCRIPTION

This measure describes savings from adding insulation (either rigid or spray foam) to rim/band joist cavities. This measure requires a member of the implementation staff evaluating the pre- and post-project R-values and to measure surface areas. The efficiency of the heating and cooling equipment in the home should also be evaluated if possible.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

### DEFINITION OF EFFICIENT EQUIPMENT

This measure requires a member of the implementation staff or a participating contractor to evaluate the pre and post R-values and measure surface areas. The requirements for participation in the program will be defined by the utilities.

### DEFINITION OF BASELINE EQUIPMENT

The existing condition will be evaluated by implementation staff or a participating contractor and is likely to be empty wall cavities and little or no attic insulation.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.<sup>1202</sup>

Note a mid-life adjustment to account for replacement of HVAC equipment during the measure life should be applied after 10 years or 13 years for boilers<sup>1203</sup>. See section below for detail.

### DEEMED MEASURE COST

The actual installed cost for this measure should be used in screening.

### LOADSHAPE

Loadshape R08 - Residential Cooling

Loadshape R09 - Residential Electric Space Heat

Loadshape R10 - Residential Electric Heating and Cooling

### COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market.

$$\begin{aligned} CF_{SSP} &= \text{Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)} \\ &= 68\%^{1204} \end{aligned}$$

---

<sup>1202</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

<sup>1203</sup> This is intentionally longer than the assumptions found in the early replacement measures as the application of this measure will occur in a variety of homes that will not be targeted for early replacement HVAC systems.

<sup>1204</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.



- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 = 72%<sup>1205</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>1206</sup>

---

**Algorithm**

---

**CALCULATION OF SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Where available savings from shell insulation measures should be determined through a custom analysis. When that is not feasible for the program the following engineering algorithms can be used with the inclusion of an adjustment factor to de-rate the heating savings.

$$\Delta kWh = (\Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas})$$

Where

$\Delta kWh_{cooling}$  = If central cooling, reduction in annual cooling requirement due to insulation

$$= \frac{\left(\frac{1}{R_{old}} - \frac{1}{R_{Rim}}\right) * A_{Rim} * (1 - FramingFactor_{Rim}) * CDD * 24 * DUA * ADJ_{BasementCool* \%Cool}}{(1000 * \eta_{Cool})}$$

R<sub>Rim</sub> = R-value of new rim/band joist assembly (including all layers between inside air and outside air).

R<sub>old</sub> = R-value value of existing assembly and any existing insulation.  
 (Minimum of R-5 for uninsulated assemblies)<sup>1207</sup>

A<sub>Rim</sub> = Net area of insulated rim/band joist (ft<sup>2</sup>)

FramingFactor<sub>Rim</sub> = Adjustment to account for area of framing  
 = 5%<sup>1208</sup>

24 = Converts hours to days

CDD = Cooling Degree Days  
 = dependent on location:<sup>1209</sup>

---

<sup>1205</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC's 2010 system peak; 'Impact and Process Evaluation of Ameren Illinois Company's Residential HVAC Program (PY5)'.

<sup>1206</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1207</sup> An estimate based on review of Madison Gas and Electric, Exterior Wall Insulation, R-value for no insulation in walls, and NREL's Building Energy Simulation Test for Existing Homes (BESTEST-EX).

<sup>1208</sup> Assumes the average framing factor for joists running from front-to-back (0.094) and from side-to-side (0). The front-to-back FF was calculated based on 1.5" joists for every 16" (1.5"/16" = 0.094). The side-to-side FF is 0 since joists are continuous and uninterrupted.

<sup>1209</sup> National Climatic Data Center, Cooling Degree Days are based on a base temp of 65°F. There is a county mapping table Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

Climate Zone (City based upon)	Conditioned CDD 65	Unconditioned CDD 75 <sup>1210</sup>
1 (Rockford)	820	263
2 (Chicago)	842	281
3 (Springfield)	1,108	436
4 (Belleville)	1,570	538
5 (Marion)	1,370	570
Weighted Average <sup>1211</sup>	947	325

DUA = Discretionary Use Adjustment (reflects the fact that people do not always operate their AC when conditions may call for it).

= 0.75<sup>1212</sup>

1000 = Converts Btu to kBtu

$\eta_{Cool}$  = Seasonal Energy Efficiency Ratio of cooling system (kBtu/kWh)

= Actual (where new or where it is possible to measure or reasonably estimate). If unknown assume the following:<sup>1213</sup>

Age of Equipment	SEER Estimate
Before 2006	10
2006 - 2014	13
Central AC After 1/1/2015	13
Heat Pump After 1/1/2015	14
Unknown (for use in program evaluation only)	10.5

$ADJ_{BasementCool}$  = Adjustment for cooling savings from basement wall and rim/band joist insulation to account for prescriptive engineering algorithms overclaiming savings<sup>1214</sup>

= 80%

%Cool = Percent of homes that have cooling

Central Cooling?	%Cool
Yes	100%
No	0%
Unknown (for use in program evaluation only) <sup>1215</sup>	66%

<sup>1210</sup> Five year average cooling degree days with 75F base temp from DegreeDays.net were used in this table because the 30 year climate normals from NCDC used elsewhere are not available at base temps above 72F.

<sup>1211</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1212</sup> This factor's source is: Energy Center of Wisconsin, May 2008 metering study; "Central Air Conditioning in Wisconsin, A Compilation of Recent Field Research", p31.

<sup>1213</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Central AC was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time mean that using the minimum standard is appropriate.

<sup>1214</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo "Results for AIC PY6 HPwES Billing Analysis", dated February 20, 2015. TAC negotiated adjustment factor is 80%.

<sup>1215</sup> Percentage of homes in Illinois that have central cooling from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

kWh\_heatingElectric = If electric heat (resistance or heat pump), reduction in annual electric heating due to insulation

$$= \frac{\left(\frac{1}{R_{old}} - \frac{1}{R_{Rim}}\right) * A_{Rim} * (1 - FramingFactor_{Rim}) * HDD * 24 * ADJ_{BasementHeat} * \%ElectricHeat}{(\eta_{Heat} * 3412)}$$

HDD = Heating Degree Days  
 = Dependent on location:<sup>1216</sup>

Climate Zone (City based upon)	Conditioned HDD 60	Unconditioned HDD 50
1 (Rockford)	5,352	3,322
2 (Chicago)	5,113	3,079
3 (Springfield)	4,379	2,550
4 (Belleville)	3,378	1,789
5 (Marion)	3,438	1,796
Weighted Average <sup>1217</sup>	4,860	2,895

ηHeat = Efficiency of heating system  
 = Actual (where new or where it is possible to measure or reasonably estimate).  
 If not available, refer to default table below:<sup>1218</sup>

System Type	Age of Equipment	HSPF Estimate	ηHeat (Effective COP Estimate)= (HSPF/3.413)*0.85
Heat Pump	Before 2006	6.8	1.7
	2006 - 2014	7.7	1.92
	2015 on	8.2	2.04
Resistance	N/A	N/A	1
Unknown (for use in program evaluation only) <sup>1219</sup>	N/A	N/A	1.28

3412 = Converts Btu to kWh

<sup>1216</sup> National Climatic Data Center, calculated from 1981-2010 climate normals with a base temp of 60°F for a conditioned basement and 50°F for an unconditioned basement, consistent with the findings of Belzer and Cort, Pacific Northwest National Laboratory in “Statistical Analysis of Historical State-Level Residential Energy Consumption Trends,” 2004. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1217</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1218</sup> These default system efficiencies are based on the applicable minimum Federal Standards. In 2006 the Federal Standard for Heat Pumps was adjusted. While one would expect the average system efficiency to be higher than this minimum, the likely degradation of efficiencies over time means that using the minimum standard is appropriate. An 85% distribution efficiency is then applied to account for duct losses for heat pumps.

<sup>1219</sup> Calculation assumes 35% Heat Pump and 65% Resistance, which is based upon data from Energy Information Administration, 2009 Residential Energy Consumption Survey, see “HC6.9 Space Heating in Midwest Region.xls”, using average for East North Central Region. Average efficiency of heat pump is based on assumption that 50% are units from before 2006 and 50% from 2006-2014. Program or evaluation data should be used to improve this assumption if available.

$ADJ_{\text{BasementHeat}}$  = Adjustment for basement wall and rim/band joist insulation to account for prescriptive engineering algorithms overclaiming savings<sup>1220</sup>

= 60%

$\%ElectricHeat$  = Percent of homes that have electric space heating

Heating System	$\%ElectricHeat$
Electric resistance or heat pump	100%
Natural Gas	0%
Unknown heating fuel (for use in program evaluation only) <sup>1221</sup>	13%

**For example**, a single family home in Chicago with 100 ft<sup>2</sup> of uninsulated rim joist cavities in an unconditioned basement that is insulated to R-13. The home has 10.5 SEER Central AC and 2.26 (1.92 including distribution losses) COP Heat Pump:

$$\begin{aligned} \Delta kWh &= (\Delta kWh_{\text{cooling}} + \Delta kWh_{\text{heating}}) \\ &= (((1/5 - 1/13) * 100 * (1-0.05) * 281 * 24 * 0.75 * 1) / (1000 * 10.5)) + (((1/5 - 1/13) * 100 * (1-0.05) * 3079 * 24 * 0.60 * 1) / (1.92 * 3412)) \\ &= 5.6 + 79.1 \\ &= 84.7 \text{ kWh} \end{aligned}$$

$\Delta kWh_{\text{heatingGas}}$  = If gas furnace heat, kWh savings for reduction in fan run time

$$= \Delta \text{Therms} * F_e * 29.3$$

$F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption

$$= 3.14\%^{1222}$$

29.3 = kWh per therm

**For example**, a single family home in Chicago with 100 ft<sup>2</sup> of uninsulated rim joist cavities in an unconditioned basement that is insulated to R-13. The home has a gas furnace with system efficiency of 66% (for therm calculation see Natural Gas Savings section):

$$\begin{aligned} \Delta kWh &= 7.85 * 0.0314 * 29.3 \\ &= 7.2 \text{ kWh} \end{aligned}$$

### SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh_{\text{cooling}} / FLH_{\text{cooling}}) * CF$$

Where:

<sup>1220</sup> As demonstrated in two years of metering evaluation by Opinion Dynamics, see Memo “Results for AIC PY6 HPwES Billing Analysis”, dated February 20, 2015. TAC negotiated adjustment factor is 60%.

<sup>1221</sup> Based on Illinois data from “Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009” from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1222</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

FLH\_cooling = Full load hours of air conditioning  
 = Dependent on location as below:<sup>1223</sup>

Climate Zone (City based upon)	Single Family	Multifamily
1 (Rockford)	512	467
2 (Chicago)	570	506
3 (Springfield)	730	663
4 (Belleville)	1,035	940
5 (Marion)	903	820
Weighted Average <sup>1224</sup>	629	564

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)  
 = 68%<sup>1225</sup>

CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 72%<sup>1226</sup>

CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)  
 = 46.6%<sup>1227</sup>

**For example**, a single family home in Chicago with 100 ft<sup>2</sup> of uninsulated rim joist cavities in an unconditioned basement that is insulated to R-13. The home has 10.5 SEER Central AC and 2.26 (1.92 including distribution losses) COP Heat Pump:

$$\begin{aligned} \Delta kW_{SSP} &= 5.6 / 570 * 0.68 \\ &= 0.0067 \text{ kW} \end{aligned}$$

$$\begin{aligned} \Delta kW_{PJM} &= 5.6 / 570 * 0.466 \\ &= 0.0046 \text{ kW} \end{aligned}$$

**NATURAL GAS SAVINGS**

If Natural Gas heating:

$$= \frac{\left(\frac{1}{R_{old}} - \frac{1}{R_{Rim}}\right) * A_{Rim} * (1 - FramingFactor_{Rim}) * HDD * 24 * ADJ_{BasementHeat} * \%GasHeat}{(\eta_{Heat} * 100,000)}$$

Where:

ηHeat = Efficiency of heating system

<sup>1223</sup> Based on Full Load Hours from ENERGY STAR with adjustments made in a Navigant Evaluation, other cities were scaled using those results and CDD. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

<sup>1224</sup> Weighted based on number of occupied residential housing units in each zone.

<sup>1225</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1226</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1227</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

= Equipment efficiency \* distribution efficiency

= Actual (where new or where it is possible to measure or reasonably estimate).<sup>1228</sup> If not available, use 72% for existing system efficiency.<sup>1229</sup>

%GasHeat = Percent of homes that have gas space heating

Heating System	%GasHeat
Electric resistance or heat pump	0%
Natural Gas	100%
Unknown heating fuel (for use in program evaluation only) <sup>1230</sup>	87%

Other factors as defined above.

**For example**, a single family home in Chicago with 100 ft<sup>2</sup> of uninsulated rim joist cavities in an unconditioned basement that is insulated to R-13. The home has a gas furnace with system efficiency of 66%:

$$\Delta\text{Therms} = ((1/5 - 1/13) * 100 * (1-0.05) * 3079 * 24 * 0.60 * 1) / (0.66 * 100,000)$$

$$= 7.85 \text{ therms}$$

**Mid-Life adjustment**

In order to account for the likely replacement of existing heating and cooling equipment during the lifetime of this measure, a mid-life adjustment should be applied. To calculate the adjustment, re-calculate the savings above using the following new baseline system efficiency assumptions:

Efficiency Assumption	System Type	New Baseline Efficiency
ηCool	Central AC	13 SEER
	Heat Pump	14 SEER
ηHeat	Electric Resistance	1.0 COP
	Heat Pump (8.2HSPF/3.413)*0.85	2.04 COP
	Furnace 90% AFUE * 0.85	76.5% AFUE
	Boiler	82% AFUE

This reduced annual savings should be applied following the assumed remaining useful life of the existing equipment, estimate to be 10 years or 13 years for boilers.<sup>1231</sup> Note if the existing equipment efficiency is greater than the new baseline efficiency listed above, do not apply a mid-life adjustment.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

<sup>1228</sup> Ideally, the System Efficiency should be obtained either by recording the AFUE of the unit, or performing a steady state efficiency test. The Distribution Efficiency can be estimated via a visual inspection and by referring to a look up table such as that provided by the Building Performance Institute: (see 'BPI Distribution Efficiency Table') or by performing duct blaster testing.

<sup>1229</sup> Based on average Nicor PY4 nameplate efficiencies derated by 15% for distribution losses.

<sup>1230</sup> Based on Illinois data from "Table HC7.9 Air Conditioning in Homes in Midwest Region, Divisions, and States, 2009" from Energy Information Administration, 2009 Residential Energy Consumption Survey

<sup>1231</sup> This is intentionally longer than the assumption found in the early replacement measures as the application of this measure will occur in a variety of homes and will not be targeting those homes appropriate for early replacement HVAC systems.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-SHL-RINS-V03-210101**

**REVIEW DEADLINE: 1/1/2024**

### 5.6.7. Low-E Storm Window

#### DESCRIPTION

Emissivity is a measure of thermal radiation emitted by an object’s surface. Emissivity values range from 0 to 1 with 1 being the emissivity of a black body. Low emissivity (low-e) storm window inserts reduce the rate of thermal radiation of the window assembly through the interaction of multiple properties. The low-e surface of the insert means that the window will transfer heat at a reduced rate. The newly created air gap between the window and the insert combined with the low emissivity of the insert improves thermal performance of the window assembly. The inserts include weather-stripping as a means of sealing the connection which reduces air infiltration. This measure offers benefits during both heating and cooling seasons, for both natural gas and electricity. In addition to energy benefits, this measure offers non-energy benefits including increased comfort and noise reduction.

The calculation of savings presented in this section apply to single and multifamily residential applications with no portable window air conditioners. Small commercial applications with operating characteristics similar to a residential profile are also eligible for the savings presented here.

This measure was developed to be applicable to the following program types: RF, DI. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a window insert installed over either the interior or exterior of the baseline window. The insert must be ENERGY STAR certified and meet the ENERGY STAR storm windows key product criteria.

**ENERGY STAR key product criteria for storm windows<sup>1232</sup>**

Climate Zone	Emissivity	Solar Transmission
1 - Rockford	≤ 0.22	> 0.55
2 - Chicago		
3 - Springfield		
4 - Belleville		Any
5 – Marion		

#### DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing single-pane or double-pane window with clear glass and any frame type: metal, vinyl, or wood.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 20 years.<sup>1233</sup>

#### DEEMED MEASURE COST

The incremental cost for this measure is \$7.85 per square foot material cost. Applications using professional window installers should include an additional \$30 per window installation cost.<sup>1234</sup>

#### LOADSHAPE

Loadshape R08 - Residential Cooling

<sup>1232</sup> ENERGY STAR Storm Windows Key Product Criteria, accessed February 2020.

<sup>1233</sup> Pacific Northwest National Laboratory for the U.S. Department of Energy, “Task ET-WIN-PNNL-FY13-01-5.3: Database of Low-e Storm Window Energy Performance across U.S. Climate Zones,” September 2013: page 5.

<sup>1234</sup> Ibid.



Loadshape R09 - Residential Electric Space Heat  
 Loadshape R10 - Residential Electric Heating and Cooling

**COINCIDENCE FACTOR**

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the average savings over the defined summer peak period and is presented so that savings can be bid into PJM’s capacity market.

- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
 = 68%<sup>1235</sup>
- CF<sub>SSP</sub> = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 = 72%<sup>1236</sup>
- CF<sub>PJM</sub> = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>1237</sup>

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

$$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{heatingElectric} + \Delta kWh_{heatingGas}$$

$$\Delta kWh_{cooling} = CS_{cz} * Area_{window}$$

$$\Delta kWh_{heatingElectric} = EHS_{cz} * Area_{window}$$

$$\Delta kWh_{heatingGas} = \Delta Therms * F_e * 29.3$$

Where:

CS<sub>cz</sub> = Annual cooling savings per area of window by climate zone, see table below.

**Cooling savings per window area by climate zone and baseline window condition<sup>1238</sup>**

<sup>1235</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1236</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1237</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1238</sup> Based on savings modeled by EPA, “ES Storm Windows RESFEN Data and Calculations.xlsx”, April 2017. Whole House Cooling energy values from the “Raw Data-Exterior Storm Windows” and “Raw Data-Interior Storm Windows,” Climate Zone 5, Location IL Chicago, wood frame, single pane, exterior low-E (0.148 panel) and interior low-E (0.148 panel) were used to calculate savings. EPA only reported single pane modeling results. In order to estimate impacts for double pane windows, ratios of double pane to single pane cooling energy was applied as reported by the Pacific Northwest National Laboratory for the U.S. Department of Energy, “Task ET-WIN-PNNL-FY13-01-5.3: Database of Low-e Storm Window Energy Performance across U.S. Climate Zones,” September 2013. Values from Appendix C, table C.8 for Chicago, Illinois were used to calculate the ratio of double pane to single pane cooling energy. See “Low E Window Workpaper Supporting Calculations.xlsx” for reference. The was data modified for different heating zones of Illinois.

Climate Zone	Single Pane Base Window (kWh/ft <sup>2</sup> )	Double Pane Base Window (kWh/ft <sup>2</sup> )
1 - Rockford	0.46	0.33
2 - Chicago	0.47	0.34
3 - Springfield	0.62	0.45
4 - Belleville	0.88	0.64
5 - Marion	0.77	0.56

$EHS_{cz}$  = Annual electric heating savings per area of window by climate zone, see table below. **Error! Reference source not found..**

**Heating savings per window area by climate zone, heating type, and baseline window condition<sup>1239</sup>**

Climate Zone	Electric Resistance Heat		Electric Heat Pump	
	Single Pane Base Window (kWh/ft <sup>2</sup> )	Double Pane Base Window (kWh/ft <sup>2</sup> )	Single Pane Base Window (kWh/ft <sup>2</sup> )	Double Pane Base Window (kWh/ft <sup>2</sup> )
1 - Rockford	16.84	1.90	9.31	1.05
2 - Chicago	16.09	1.81	8.89	1.00
3 - Springfield	13.78	1.55	7.61	0.86
4 - Belleville	10.63	1.20	5.87	0.66
5 - Marion	10.82	1.22	5.98	0.67

$Area_{window}$  = Total area of installed window inserts. Use site specific value.

$\Delta Therms$  = Therm savings from gas heating as calculated below

$F_e$  = Furnace Fan energy consumption as a percentage of annual fuel consumption, 3.14%<sup>1240</sup>

29.3 = Conversion factor, kWh per therm

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta kW = \left( \frac{\Delta kWh_{cooling}}{FLH_{cooling}} \right) * CF$$

<sup>1239</sup> Based on savings modeled by EPA, “ES Storm Windows RESFEN Data and Calculations.xlsx”, April 2017. Whole House Heating energy values from the “Raw Data-Exterior Storm Windows” and “Raw Data-Interior Storm Windows,” Climate Zone 5, Location IL Chicago, wood frame, single pane, exterior low-E (0.148 panel) and interior low-E (0.148 panel) were used to calculate savings. EPA only reported single pane modeling results. In order to estimate impacts for double pane windows, ratios of double pane to single pane cooling energy was applied as reported by the Pacific Northwest National Laboratory for the U.S. Department of Energy, “Task ET-WIN-PNNL-FY13-01-5.3: Database of Low-e Storm Window Energy Performance across U.S. Climate Zones,” September 2013. Values from Appendix C, table C.8 for Chicago, Illinois were used to calculate the ratio of double pane to single pane heating energy. See “Low E Window Workpaper Supporting Calculations.xlsx” for reference. To convert from “Furnace” savings to electric, it is assumed a furnace efficiency of 72%, electric resistance of 100% and heat pump of 1.81 (average of pre-2006 and 2006-2014 federal standard).

<sup>1240</sup>  $F_e$  is not one of the AHRI certified ratings provided for residential furnaces, but can be reasonably estimated from a calculation based on the certified values for fuel energy ( $E_f$  in MMBtu/yr) and  $E_{ae}$  (kWh/yr). An average of a 300 record sample (non-random) out of 1495 was 3.14%. This is, appropriately, ~50% greater than the ENERGY STAR version 3 criteria for 2%  $F_e$ . See “Programmable Thermostats Furnace Fan Analysis.xlsx” for reference.

Where:

$FLH_{cooling}$  = Full load hours of air conditioning based on climate zone.  
 = Dependent on location:<sup>1241</sup>

Climate Zone	Single Family	Multifamily
1 - Rockford	512	467
2 - Chicago	570	506
3 - Springfield	730	663
4 - Belleville	1,035	940
5 - Marion	903	820

Use Multifamily if: Building has shared HVAC or meets utility’s definition for multifamily

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)  
 = 68%<sup>1242</sup>

$CF_{SSP}$  = Summer System Peak Coincidence Factor for Heat Pumps (during system peak hour)  
 = 72%<sup>1243</sup>

$CF_{PJM}$  = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)  
 = 46.6%<sup>1244</sup>

**NATURAL GAS SAVINGS**

$$\Delta Therms = GHS_{cz} * Area_{window}$$

Where:

$GHS_{cz}$  = Annual gas heating savings per area of window by climate zone, see table below  
**Error! Reference source not found..**

**Heating savings per window area by climate zone and baseline window condition<sup>1245</sup>**

Climate Zone	Single Pane Base Window (therms/ft <sup>2</sup> )	Double Pane Base Window (therms/ft <sup>2</sup> )
1 - Rockford	0.80	0.09
2 - Chicago	0.76	0.09
3 - Springfield	0.65	0.07
4 - Belleville	0.50	0.06

<sup>1241</sup> Full load hours for Chicago, Moline and Rockford are provided in “Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting”, p.33. An average FLH/Cooling Degree Day (from NCDC) ratio was calculated for these locations and applied to the CDD of the other locations in order to estimate FLH.

<sup>1242</sup> Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

<sup>1243</sup> Based on analysis of metering results from 24 heat pumps in Ameren Illinois service territory in PY5 coincident with AIC’s 2010 system peak; ‘Impact and Process Evaluation of Ameren Illinois Company’s Residential HVAC Program (PY5)’.

<sup>1244</sup> Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

<sup>1245</sup> Based on savings modeled by EPA, “ES Storm Windows RESFEN Data and Calculations.xlsx”, April 2017. Whole House Heating energy values from the “Raw Data-Exterior Storm Windows” and “Raw Data-Interior Storm Windows,” Climate Zone 5, Location IL Chicago, wood frame, single pane, exterior low-E (0.148 panel) and interior low-E (0.148 panel) were used to calculate savings. EPA only reported single pane modeling results. In order to estimate impacts for double pane windows, ratios of double pane to single pane cooling energy was applied as reported by the Pacific Northwest National Laboratory for the U.S. Department of Energy, “Task ET-WIN-PNNL-FY13-01-5.3: Database of Low-e Storm Window Energy Performance across U.S. Climate Zones,” September 2013. Values from Appendix C, table C.8 for Chicago, Illinois were used to calculate the ratio of double pane to single pane heating energy. See “Low E Window Workpaper Supporting Calculations.xlsx” for reference.

Climate Zone	Single Pane Base Window (therms/ft <sup>2</sup> )	Double Pane Base Window (therms/ft <sup>2</sup> )
5 - Marion	0.51	0.06

$Area_{window}$  = Total area of installed window inserts. Use site specific value.

**For example**, a single family gas heated residence in Rockford installs 10 window inserts over single pane windows. Each window is 12 square feet for a total window area of 120 square feet.

$$\Delta Therms = 0.80 * 120 = 95.81 \text{ therms}$$

$$\Delta kWh = 0.46 * 120 + 95.81 * 0.0314 * 29.3 = 143.37 \text{ kWh}$$

$$\Delta kW_{PJM} = \left( \frac{143.37}{512} \right) * 0.466 = 0.13 \text{ kW}$$

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-SHL-LESW-V01-210101**

**REVIEW DEADLINE: 1/1/2024**

## 5.7 Miscellaneous

### 5.5.1 High Efficiency Pool Pumps

#### DESCRIPTION

Conventional residential outdoor pool pumps are single speed, often oversized, and run frequently at constant flow regardless of load. Single speed pool pumps require that the motor be sized for the task that requires the highest speed. As such, energy is wasted performing low speed tasks at high speed. Two speed and variable speed pool pumps reduce speed when less flow is required, such as when filtering is needed but not cleaning, and have timers that encourage programming for fewer on-hours. Variable speed pool pumps use advanced motor technologies to achieve efficiency ratings of 90% while the average single speed pump will have efficiency ratings between 30% and 70%.<sup>1246</sup> This measure is the characterization of the purchasing and installing of an efficient two speed or variable speed residential pool pump motor in place of a standard single speed motor of equivalent horsepower.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is a two speed or variable speed residential pool pump meeting the ENERGY STAR minimum qualifications for either in-ground or above ground pools. ENERGY STAR version 2.0 specification takes effect on January 1, 2019, and version 3.0 has an effective date of July 19, 2021.

Pump Sub-Type	Size Class	ENERGY STAR Version 2.0 Energy Efficiency Level (Effective 1/1/2019)	ENERGY STAR Version 3.0 Energy Efficiency Level (Effective 7/19/2021)
Self-Priming (Inground) Pool Pumps	Extra Small (hhp ≤ 0.13)	WEF ≥ 7.60	WEF ≥ 13.40
	Small (hhp > 0.13 and < 0.711)	WEF ≥ -1.30 x ln (hhp) + 4.95	WEF ≥ -2.45 x ln (hhp) + 8.40
	Standard Size (hhp ≥ 0.711)	WEF ≥ -2.30 x ln (hhp) + 6.59	WEF ≥ -2.45 x ln (hhp) + 8.40
Non-Self Priming (Aboveground) Pool Pumps	Extra Small (hhp ≤ 0.13)	WEF ≥ 4.92	WEF ≥ 4.92
	Standard Size (hhp > 0.13)	WEF ≥ -1.00 x ln (hhp) + 3.85	WEF ≥ -1.00 x ln (hhp) + 3.85

#### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a single speed residential pool pump.

Per the Code of Federal Regulation, new energy conservation standards for dedicated-purpose pool pumps manufactured on or after July 19, 2021 go into effect.<sup>1247</sup> These appliance efficiency standards cover both self-priming and non-self-priming pumps. In order to account for retailers and dealers clearing back-logged inventory, these new federal energy codes will not be adopted as baseline until January 1, 2022.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life for a two speed or variable speed pool pump is 7 years.<sup>1248</sup>

<sup>1246</sup> U.S. DOE, 2012. Measure Guideline: Replacing Single-Speed Pool Pumps with Variable Speed Pumps for Energy Savings. Report No. DOE/GO-102012-3534.

<sup>1247</sup> Energy Conservation Program: Energy Conservation Standards for Dedicated-Purpose Pool Pumps, Docket ID: EERE-2015-BT-STM-0008.

<sup>1248</sup> As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

**DEEMED MEASURE COST**

The incremental costs for in-ground pool pumps are estimated as \$235 for a two speed motor and \$549 for a variable speed motor.<sup>1249</sup>

The incremental costs for above ground pool pumps are estimated as \$200 for a two speed motor and \$1,130 for a variable speed motor.<sup>1250</sup>

**LOADSHAPE**

Loadshape R15 – Residential Pool Pumps

**COINCIDENCE FACTOR**

The coincidence factor for this measure is assumed to be 0.831.<sup>1251</sup>

---



---

**Algorithm**

---



---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS<sup>1252</sup>**

$$\Delta kWh \text{ two speed} = \left( \frac{((Hrs/Day_{base} * GPM_{base} * 60)/EF_{base}) - ((Hrs/Day_{2spH} * GPM_{2spH} * 60) + (Hrs/Day_{2spL} * GPM_{2spL} * 60))/WEF_{2sp}}{1000} \right) * Days$$

$$\Delta kWh \text{ variable speed} = \left( \frac{((Hrs/Day_{base} * GPM_{base} * 60)/EF_{base}) - (((Hrs/Day_{vsH} * GPM_{vsH} * 60)/ + (Hrs/Day_{vsL} * GPM_{vsL} * 60))/WEF_{vs}}{1000} \right) * Days$$

Where:

- Hrs/Day<sub>base</sub> = run hours of single speed pump  
= 11.4 hours for in-ground pools  
= 7.0 hours for above ground pools
- GPM<sub>base</sub> = flow of single speed pump (gal/min)  
= 64.4 gal/min for in-ground pools  
= 36 gal/min for above ground pools
- 60 = minutes per hour
- EF<sub>base</sub> = Energy Factor of baseline single speed pump (gal/Wh)  
= 2.1
- Hrs/Day<sub>2spH</sub> = run hours of two speed pump at high speed  
= 2 hours for in-ground pools

---

<sup>1249</sup> ENERGY STAR Pool Pump Calculator.

<sup>1250</sup> CEE Efficient Residential Swimming Pool Initiative, December 2012, page 18.

<sup>1251</sup> Based on assumptions of daily load pattern through pool season. Assumption was developed for Efficiency Vermont but is considered a reasonable estimate for Illinois.

<sup>1252</sup> The methodology and all assumptions are sourced from the ENERGY STAR Pool Pump Calculator and assume a nameplate horsepower of 1.5 and a pool size of 22,000 gallons, with 2.0 turnovers per day in the base case and 1.6 turnovers per day in the efficient case. For above ground pools, the turnover ratios were kept the same with the pool size being 7,540 gallons. The volume of the above ground pool is sourced from the California Urban Water Council Evaluation of Potential Best Management Practices for Pools, Spas, and Fountains for the average above ground residential pool.

- = 1.2 hours for above ground pools
- GPM<sub>2spH</sub> = flow of two speed pump at high speed (gal/min)
  - = 56 gal/min for in-ground pools
  - = 31 gal/min for above ground pools
- Hrs/Day<sub>2spl</sub> = run hours of two speed pump at low speed
  - = 15.7 hours for in-ground pools
  - = 9.6 hours for above ground pools
- GPM<sub>2spl</sub> = flow of two speed pump at low speed (gal/min)
  - = 31 gal/min for in-ground pools
  - = 17 gal/min for above ground pools
- WEF = Weighted Energy Factor of the efficient pump (gal/Wh), dependent on the pool application and motor designation, as detailed in the table below:<sup>1253</sup>

Pump Sub-Type	Motor Design	ENERGY STAR Version 2.0 WEF (gal/Wh)	ENERGY STAR Version 3.0 WEF (gal/Wh)
Self-Priming (Inground) Pool Pumps	Multi-speed (WEF <sub>2sp</sub> )	5.31	8.44
	Variable-speed (WEF <sub>vs</sub> )	6.6	11.05
Non-Self Priming (Aboveground) Pool Pumps	Multi-speed (WEF <sub>2sp</sub> )	3.55	3.55
	Variable-speed (WEF <sub>vs</sub> )	4.21	4.21

- Hrs/Day<sub>vsH</sub> = run hours of variable speed pump at high speed
  - = 2 hours for in-ground pools
  - = 1.2 hours for above ground pools
- GPM<sub>vsH</sub> = flow of variable speed pump at high speed (gal/min)
  - = 50 gal/min for in-ground pools
  - = 28 gal/min for above ground pools
- Hrs/Day<sub>vsL</sub> = run hours of variable speed pump at low speed
  - = 16 hours for in-ground pools
  - = 9.8 hours for above ground pools
- GPM<sub>vsL</sub> = flow of variable speed pump at low speed (gal/min)
  - = 30.6 gal/min for in-ground pools
  - = 17 gal/min for above ground pools
- Days = Number of days per year that the swimming pool is operational
  - = 125<sup>1254</sup>

<sup>1253</sup> The efficient Weighted Energy Factor is sourced from a weighted average of products meeting the ENERGY STAR minimum qualifications and listed on their Qualified Products List (QPL), as accessed on 04/26/2018. As pump applications were not designated in the ENERGY STAR QPL, equipment sizes and horsepower were assumed similar between aboveground and inground pools.

<sup>1254</sup> Assumes 50% of pools operated from Memorial Day through Labor Day (100 days) and 50% of pools operate for a longer span, typically the 5 month period between May and September (150 days), due to their ability to heat the pool.

Based on the pool/pump application and the motor designation, the annual energy savings (ΔkWh) are detailed in the table below:

Pump Sub-Type	Motor Design	Annual Energy Savings (ΔkWh) ENERGY STAR Version 2.0	Annual Energy Savings (ΔkWh) ENERGY STAR Version 3.0
Self-Priming (Inground) Pool Pumps	Multi-speed	1,776	2,090
	Variable-speed	1,952	2,222
Non-Self Priming (Aboveground) Pool Pumps	Multi-speed	465	465
	Variable-speed	539	539

**SUMMER COINCIDENT PEAK DEMAND SAVINGS<sup>1255</sup>**

$$\Delta kW \text{ two speed} = ((kWh/day_{base})/(Hrs/day_{base}) - (kWh/day_{2sp})/(Hr/day_{2sp})) * CF$$

$$\Delta kW \text{ variable speed} = ((kWh/day_{base})/(Hrs/day_{base}) - (kWh/day_{vr})/(Hr/day_{vr})) * CF$$

Where:

kWh/day<sub>base</sub> = daily energy consumption of baseline pump, as defined above  
 = 20.98 kWh/day for in-ground pools  
 = 7.19 kWh/day for above ground pools

Hrs/day<sub>base</sub> = daily run hours of single speed pump  
 = 11.4 hours for in-ground pools  
 = 7.0 hours for above ground pools

kWh/day = daily energy consumption of the efficient pump, dependent on the pool application and motor designation, as detailed in the table below:

Pump Sub-Type	Motor Design	Daily Energy Consumption (kWh/day) ENERGY STAR Version 2.0	Daily Energy Consumption (kWh/day) ENERGY STAR Version 3.0
Self-Priming (Inground) Pool Pumps	Multi-speed (kWh/day <sub>2sp</sub> )	6.76	4.26
	Variable-speed (kWh/day <sub>vs</sub> )	5.36	3.20
Non-Self Priming (Aboveground) Pool Pumps	Multi-speed (kWh/day <sub>2sp</sub> )	3.47	3.47
	Variable-speed (kWh/day <sub>vs</sub> )	2.88	2.88

Hr/day<sub>2sp</sub> = run hours of two speed pump  
 = 17.7 hours for in-ground pools  
 = 10.9 hours for above ground pools

Hr/day<sub>var</sub> = run hours of variable speed pump  
 = 18 hours for in-ground pools  
 = 11 hours for above ground pools

<sup>1255</sup> The methodology and all assumptions are sourced from the ENERGY STAR Pool Pump Calculator and assume a nameplate horsepower of 1.5 and a pool size of 22,000 gallons, with 2.0 turnovers per day in the base case and 1.5 turnovers per day in the efficient case.



CF = Summer Peak Coincidence Factor for measure  
 = 0.831<sup>1256</sup>

Based on the pool/pump application and the motor designation, the summer coincident peak demand savings ( $\Delta kW$ ) are detailed in the table below:

Pump Sub-Type	Motor Design	Summer Peak Coincident Demand Savings ( $\Delta kW$ ) ENERGY STAR Version 2.0	Summer Peak Coincident Demand Savings ( $\Delta kW$ ) ENERGY STAR Version 3.0
Self-Priming (Inground) Pool Pumps	Multi-speed	1.211	1.329
	Variable-speed	1.282	1.381
Non-Self Priming (Aboveground) Pool Pumps	Multi-speed	0.589	0.589
	Variable-speed	0.638	0.638

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-MSC-RPLP-V02-190101**

**REVIEW DEADLINE: 1/1/2022**

<sup>1256</sup> Based on assumptions of daily load pattern through pool season. Assumption was developed for Efficiency Vermont but is considered a reasonable estimate for Illinois.

## 5.5.2 Low Flow Toilets

### DESCRIPTION

The first federal standards dealing with water consumption for toilets was the Energy Policy Act of 1992. It specified a gallon per flush (gpf) standard for both fixtures. These standards are used to define the baseline equipment for this measure. The Subsequent U.S. EPA WaterSense program in 2009 set even tighter standards for plumbing fixtures, including toilets. These standards are used to define the efficient equipment for this measure.

### DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is a U.S. EPA WaterSense certified residential toilet fixture.

### DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a toilet that has a maximum gallons per flush outlined by the Energy Policy Act of 1992.

### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life for this measure is assumed to be 25 years.<sup>1257</sup>

### DEEMED MEASURE COST

The incremental costs for both are \$0.<sup>1258</sup>

### LOADSHAPE

Loadshape R03 - Residential Electric DHW

### COINCIDENCE FACTOR

N/A

---

## Algorithm

---

### CALCULATION OF ENERGY SAVINGS

#### ELECTRIC ENERGY SAVINGS

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\begin{aligned} \Delta\text{kWh} &= \Delta\text{Water} / 1,000,000 * E_{\text{water total}} \\ E_{\text{water}} &= \text{IL Total Water Energy Factor (kWh/Million Gallons)} \\ &= 5,010 \text{ for measures installed in all areas except Cook County}^{1259} \end{aligned}$$

---

<sup>1257</sup> [http://www.metrohome.us/information\\_kit\\_files/life.pdf](http://www.metrohome.us/information_kit_files/life.pdf) and ATD Home Inspection:

<http://www.atdhomeinspection.com/advice/average-product-life/> is 50 years. 25 years is used to be conservative.

<sup>1258</sup> Measure cost assumption from City of Fort Collins, "Green Building Practice Summary," March 21, 2011, page 2. The document states "Information from the EPA WaterSense web site: WaterSense® labeled toilets are not more expensive than regular toilets. MaP testing results have shown no correlation between price and performance. Prices for toilets can range from less than \$100 to more than \$1,000. Much of the variability in price is due to style, not functional design."

<sup>1259</sup> This factor includes 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

= 2,937 for measures installed in Cook County<sup>1260,1261</sup>

**Toilet Calculation**

**For example**, a low flow toilet is installed in a single family home with unknown occupancy.

$$\begin{aligned} \Delta kWh &= 1495 / 1,000,000 * 5,010 \\ &= 7.5 \text{ kWh/year} \end{aligned}$$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

N/A

**NATURAL GAS SAVINGS**

N/A

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

$$\Delta Water = (GPF_{Base} - GPF_{Eff}) * NFPD * Household * ADPY$$

Where:

GPF<sub>Base</sub> = Baseline equipment gallons per flush  
 = 1.6 for toilets<sup>1262</sup>

GPF<sub>Eff</sub> = Efficient equipment gallons per flush  
 = 1.28 for toilets<sup>1263</sup>

NFPD = Number of flushes per day per occupant  
 = 5<sup>1264</sup>

Household = Number of people in the household.  
 = Actual. If unknown assume average number of people per household:

<sup>1260</sup> Supply (2,571) + 15% of wastewater (2,439\*15% = 366) = 2,937 kWh/million gallons. Assumes that over 10MW wastewater treatment plant customers consume approximately 85% of the energy for treating wastewater in Cook County and as per Section 8-103B statute, savings are not allowed to be claimed from customers who are over 10MW customers.

<sup>1261</sup> The TRM Administrator is not an expert in determining the definitive applicability of IL Statute (220 ILCS 5/8-103B) to these secondary electric savings. The calculation reported above is based on what the TRM Administrator believes to be a reasonable interpretation of the Statute: that savings for exempt customers (retail customers of an electric utility that serves more than 3,000,000 retail customers in the State and whose total highest 30 minute demand was more than 10,000 kilowatts, or any retail customers of an electric utility that serves less than 3,000,000 retail customers but more than 500,000 retail customers in the State and whose total highest 15 minute demand was more than 10,000 kilowatts) will not be used in the establishment of annual energy sales or the utility's achievement of the cumulative persisting annual savings goals. In the case that a definitive interpretation of the Statute's applicability under these circumstances leads to a different conclusion, this treatment can be reconsidered.

<sup>1262</sup> U. S. EPA WaterSense. "Water Efficiency Management Guide – Bathroom Suite" (EPA 832-F-17-016d), Nov 2017.

<sup>1263</sup> U. S. EPA WaterSense. "Water Efficiency Management Guide – Bathroom Suite" (EPA 832-F-17-016d), Nov 2017.

<sup>1264</sup> U.S. EPA WaterSense, "Water Specification for Flushing Urinals Supporting Statement." Appendix B: References for Calculation Assumptions.

Household Unit Type <sup>1265</sup>	Household
Single-Family - Deemed	2.56 <sup>1266</sup>
Multi-Family - Deemed	2.1 <sup>1267</sup>
Household type unknown	2.42 <sup>1268</sup>
Custom	Actual Occupancy or Number of Bedrooms <sup>1269</sup>

Use Multifamily if: Building meets utility’s definition for multifamily

ADPY = Annual days per year  
 = 365 for residential

**Toilet Calculation**  
**For example**, a low flow toilet is installed in a single family home with unknown occupancy.

$$\Delta\text{Water} = [(1.6 - 1.28) \times 5 \times 2.56 \times 365]$$

$$= 1495 \text{ gal/year}$$

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-MSC-LFTU-V01-200101**

**REVIEW DEADLINE: 1/1/2022**

<sup>1265</sup> If household type is unknown, as may be the case for time of sale measures, then single family deemed value shall be used.

<sup>1266</sup> ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program citing 2006-2008 American Community Survey data from the US Census Bureau for Illinois cited on p. 17 of the PY2 Evaluation report. 2.75 \* 93% evaluation adjustment

<sup>1267</sup> ComEd PY3 Multifamily Evaluation Report REVISED DRAFT v5 2011-12-08.docx

<sup>1268</sup> Unknown is based on statewide weighted average of 69% single family and 31% multifamily, based on IL data from 2009 RECS Table HC2.9 Structural and Geographic Characteristics of Homes in Midwest Region, Divisions and States, 2009.

<sup>1269</sup> Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

### 5.5.3 Level 2 Electric Vehicle Charger

#### DESCRIPTION

The measure is for the purchase of a Level 2 electric vehicle charger consistent with the ENERGY STAR specification for Electric Vehicle Supply Equipment (EVSE) installed for residential household use. Networked chargers enable access to online energy management tools through an EVSE network. Non-networked chargers are standalone units that are not connected to other units through an EVSE network.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

#### DEFINITION OF EFFICIENT EQUIPMENT

An ENERGY STAR qualified networked or non-networked level 2 electric vehicle charger.

#### DEFINITION OF BASELINE EQUIPMENT

A non-ENERGY STAR networked or non-networked level 2 electric vehicle charger.

#### DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for the EV charger is assumed to be 10 years.<sup>1270</sup>

#### DEEMED MEASURE COST

The incremental cost for the EV charger is assumed to be \$57.<sup>1271</sup>

#### LOADSHAPE

Loadshape R19 - Residential Electric Vehicle Charger

#### COINCIDENCE FACTOR

Coincidence factor is embedded in deemed demand reduction savings estimate, so the coincidence factor is assumed to be 1.

---

### Algorithm

---

#### CALCULATION OF ENERGY SAVINGS

##### ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (((Hours\_PS + Hours\_US) * SP\_base) - (Hours\_PS * SP\_EEp + Hours\_US * SP\_EEu)) / 1000$$

Where:

$$Hours\_C = \text{Annual Active Charging Hours}$$

---

<sup>1270</sup> Based on Northwest Power and Conservation Council, Regional Technical Forum workbook for Level 2 Electric Vehicle Charger version 1.1. approved May 2019. <https://rtf.nwcouncil.org/measure/level-2-electric-vehicle-charger>

<sup>1271</sup> Weighted average incremental cost based on limited data provided in Northwest Power and Conservation Council, Regional Technical Forum workbook for Level 2 Electric Vehicle Charger version 1.1. approved May 2019. <https://rtf.nwcouncil.org/measure/level-2-electric-vehicle-charger>. Recommend this assumption be reviewed in future versions.

$$\begin{aligned}
 &= \text{EV\_kWh} / \text{Steady State Charger Output Capacity (kW)} \\
 &= \text{EV\_kWh} / 8.2^{1272} \\
 &= 336 \text{ hours} \\
 \text{EV\_kWh} &= \text{Annual Driving Energy Consumed at Home (kWh)} \\
 &= \text{VMT} * \text{EV\_ee} / 100 * \% \text{Home\_Charging} \\
 \text{VMT} &= \text{Annual vehicle miles traveled of the vehicle measure.} \\
 &= 10,690^{1273} \\
 \text{EV\_ee} &= \text{Actual nameplate operation efficiency for electric vehicle expressed} \\
 &\quad \text{in kWh per 100 miles.} \\
 &= 30 \text{ kWh per 100 miles}^{1274} \\
 \% \text{Home\_Charging} &= \text{Percent of charging that is done at home} \\
 &= 86\%^{1275} \\
 &= 2,758 \text{ kWh} \\
 \text{Hours\_P} &= \text{Total Annual Hours Plugged In} \\
 &= \text{Annual \# of Charging Sessions} * \text{Average EV Plug in Time per Charging Session (Hrs)} \\
 &= (\text{EV\_kWh} / 7.4^{1276}) * 14.7^{1277} \\
 &= 5,479 \text{ hours} \\
 \text{Hours\_PS} &= \text{Annual Standby Hours Plugged In} \\
 &= \text{Hours\_P} - \text{Hours\_C} \\
 &= 5,143 \text{ hours} \\
 \text{Hours\_US} &= \text{Annual Standby Hours Unplugged} \\
 &= 8760 - \text{Hours\_P} \\
 &= 3,281 \text{ hours} \\
 \text{SP\_base} &= \text{Baseline Average Standby Power (W)} \\
 &= 3.7 \text{ for non-networked, } 9.9 \text{ for networked}^{1278} \\
 \text{SP\_EEp} &= \text{Efficient Average Standby Power (W) with vehicle plugged in}
 \end{aligned}$$

<sup>1272</sup> Analysis of WA and OR Cumulative EV Registrations through 2018 paired with Vehicle Maximum Power Acceptance (kW) data from Chargehub <https://chargehub.com/en/find-the-right-charging-station-power.html>

<sup>1273</sup> Average annual vehicle miles traveled estimated based on Stateside average of data from the 2017 National Household Transportation survey, accessed 07/2020.

<sup>1274</sup> Average electric vehicle efficiency based on light-duty vehicle miles per gallon from Annual Energy Outlook 2019. U.S. Energy Information Administration.

<sup>1275</sup> Assumption consistent with RTF characterization based on 2014 Idaho National Laboratory study.

<sup>1276</sup> Avista Docket No. UE-160082 – Avista Utilities Semi-Annual Report on Electric Vehicle Supply Equipment Pilot Program (November 2018) Table 13 Avg. kWh Consumed per Session

<sup>1277</sup> Based on data provided by Avista. Total hours EV is plugged into charging station including both charge and standby time.

<sup>1278</sup> INL charger testing <https://avt.inl.gov/evse-type/ac-level-2> and ENERGY STAR Market and Industry Scoping Report Electric Vehicle Supply Equipment (EVSE) September 2013 (source data is from INL).

$\text{SP\_EEu} = 4.3$  for non-networked,  $6.4$  for networked<sup>1279</sup>  
 = Efficient Average Standby Power (W) in no vehicle mode  
 $\text{SP\_EEu} = 2.1$  for non-networked,  $3.2$  for networked<sup>1280</sup>

$\Delta\text{kWh per non-networked charger} = ((5,143 + 3,281) * 3.7) - (5,143 * 4.3 + 3,281 * 2.1) / 1000$   
 $= 2.2 \text{ kWh}$

$\Delta\text{kWh per networked charger} = ((5,143 + 3,281) * 9.9) - (5,143 * 6.4 + 3,281 * 3.2) / 1000$   
 $= 40.0 \text{ kWh}$

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

$$\Delta\text{kW} = - \text{kW\_vehicle} * \text{CF}$$

Where:

$\text{kW\_vehicle} =$  Summer peak electric demand of the electric vehicle.  
 $= 0.28 \text{ kW}$ <sup>1281</sup>

$\text{CF} =$  Summer peak coincidence factor  
 $= 1$ <sup>1282</sup>

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**MEASURE CODE: RS-MSC-L2CH-V01-210101**

**REVIEW DEADLINE: 1/1/2022**

<sup>1279</sup> 2019 ENERGY STAR QPL of Residential EVSE. No Residential units, used commercial as a proxy. Averaged Partial On Mode Input Power (W) and Idle Mode Input Power (W)

<sup>1280</sup> 2019 ENERGY STAR QPL of Residential EVSE. No Residential units, used commercial as a proxy. Averaged Partial On Mode Input Power (W) and Idle Mode Input Power (W).

<sup>1281</sup> Summer peak demand impacts are a deemed value based on EV Charging Station Pilot Evaluation Report. Xcel CO. May 2015. Page 5.

<sup>1282</sup> kW\_Vehicle accounts for the estimated average kW draw during the system peak.

**2021 Illinois Statewide Technical  
Reference Manual for Energy Efficiency  
Version 9.0**

**Volume 4: Cross-Cutting Measures and  
Attachments**

**FINAL  
September 25, 2020**

**Effective:  
January 1, 2021**



## Table of Contents

**VOLUME 1: OVERVIEW AND USER GUIDE**

**VOLUME 2: COMMERCIAL AND INDUSTRIAL MEASURES**

**VOLUME 3: RESIDENTIAL MEASURES**

**VOLUME 4: CROSS-CUTTING MEASURES AND ATTACHMENTS**

<b>6</b>	<b>CROSS-CUTTING MEASURES</b> .....	<b>8</b>
6.1	Behavior .....	8
6.1.1	Adjustments to Behavior Savings to Account for Persistence.....	8
6.2	System Wide.....	23
6.2.1	Voltage Optimization.....	23
<b>ATTACHMENT A: ILLINOIS STATEWIDE NET-TO-GROSS METHODOLOGIES.....</b>		<b>32</b>
<b>1</b>	<b>POLICY CONTEXT FOR THIS INFORMATION</b> .....	<b>32</b>
<b>2</b>	<b>ATTRIBUTION IN ENERGY EFFICIENCY PROGRAMS IN GENERAL</b> .....	<b>36</b>
2.1	Definitions .....	36
2.2	Free Ridership-Specific Issues.....	38
2.2.1	Survey Design.....	38
2.2.2	Supplementing Self-Report with Historical Tracing.....	39
2.3	Spillover-Specific Issues.....	39
2.3.1	Measure Costs.....	40
<b>3</b>	<b>COMMERCIAL, INDUSTRIAL, AND PUBLIC SECTOR PROTOCOLS</b> .....	<b>41</b>
3.1	Core Non-Residential Protocol.....	42
3.1.1	Core Non-Residential Free Ridership Protocol.....	42
3.2	Core Non-Residential Spillover Protocol .....	49
3.2.1	Core Participant Spillover Protocol .....	50
3.2.2	Core Nonparticipant Spillover Protocol .....	53
3.3	Small Business Protocol.....	57
3.3.1	Free Ridership .....	57
3.4	C&I New Construction Protocol .....	58
3.4.1	Free Ridership .....	58
3.5	Study-Based Protocol .....	58
3.5.1	Free Ridership .....	58
3.6	Technical Assistance Protocol.....	61
3.6.1	Free Ridership .....	61
<b>4</b>	<b>RESIDENTIAL AND LOW INCOME SECTOR PROTOCOLS</b> .....	<b>63</b>
4.1	Residential Cross-Cutting Approaches .....	64
4.1.1	Survey Design Issues.....	64
4.1.2	Participant Spillover .....	64

4.1.3	Nonparticipant Spillover Measured from Customers.....	66
4.2	Appliance Recycling Protocol.....	68
4.2.1	Basic Method.....	69
4.2.2	Enhanced Method.....	72
4.3	Residential Upstream Lighting Protocol.....	73
4.3.1	Basic Method.....	73
4.3.2	Participant Spillover.....	75
4.3.3	Nonparticipant Spillover.....	77
4.4	Prescriptive Rebate (With No Audit) Protocol.....	79
4.4.1	Basic Method.....	79
4.5	Single-Family Home Energy Audit Protocol.....	81
4.5.1	Basic Method.....	81
4.6	Multifamily Protocol.....	85
4.6.1	Basic Method.....	85
4.7	Energy Saving Kits and Elementary Education Protocol.....	87
4.7.1	Basic Method.....	88
4.8	Residential New Construction Protocol.....	88
4.8.1	Basic Method.....	88
4.8.2	Participant Spillover.....	91
4.8.3	Builder Nonparticipant Spillover.....	92
<b>5</b>	<b>CROSS-SECTOR PROTOCOLS.....</b>	<b>94</b>
5.1	Combining Participant and Trade Ally Free Ridership Scores.....	94
5.1.1	Trade Ally Free Ridership Calculation.....	94
5.1.2	Triangulation.....	94
5.2	Spillover Measured Through Trade Allies.....	95
5.2.1	Spillover from Active Trade Allies.....	96
5.2.2	Spillover from Inactive Trade Allies.....	98
5.3	Consumption Data Analysis Protocol.....	99
5.3.1	Consumption Data Analysis and NTG.....	100
5.3.2	Nonparticipant Spillover.....	101
5.3.3	Participant Spillover.....	101
5.3.4	Free Ridership.....	101
5.3.5	Consumption Data Analysis Designs with a Comparison Group.....	103
5.3.6	Consumption Data Analysis Designs without a Comparison Group.....	107
5.3.7	Program Implementation and Consumption Data Analysis.....	107
5.4	Midstream Free-Ridership Protocol.....	108
5.4.1	Using This Protocol.....	108

5.4.2	Free Ridership Estimation Methodology .....	110
<b>6</b>	<b>APPENDIX A: OVERVIEW OF NTG METHODS.....</b>	<b>113</b>
6.1	Survey-Based Approaches .....	113
6.1.1	Self-Report Approach .....	113
6.1.2	Econometric/Revealed Preference Approach.....	114
6.2	NTG with Consumption Data Analysis.....	114
6.3	Deemed or Stipulated NTG Ratios.....	114
6.4	Common Practice Baseline Approaches .....	114
6.5	Market Analyses.....	114
6.6	Structured Expert Judgment Approaches.....	115
6.7	Program Theory-Driven Approach .....	115
6.8	Case Studies Design.....	116
<b>7</b>	<b>APPENDIX B: REFERENCES.....</b>	<b>117</b>
	<b>ATTACHMENT B: EFFECTIVE USEFUL LIFE FOR CUSTOM MEASURE GUIDELINES.....</b>	<b>119</b>
	<b>ATTACHMENT C: FRAMEWORK FOR COUNTING MARKET TRANSFORMATION SAVINGS IN ILLINOIS .....</b>	<b>127</b>
<b>1</b>	<b>MARKET TRANSFORMATION CONTEXT .....</b>	<b>127</b>
1.1	Market Transformation Definition .....	127
1.2	Market Transformation and Resource Acquisition .....	127
1.3	Market Transformation and Attribution.....	129
1.4	What Makes an MT Initiative Recognizable?.....	130
1.5	Evaluation and Measurement of Savings in MT Initiatives.....	130
1.5.1	Evaluation Approach – Theory-based Evaluation.....	131
1.5.2	Evaluation Products.....	131
1.6	Uncertainty and Risk in MT Savings Estimates.....	132
<b>2</b>	<b>ESTIMATING SAVINGS FOR MT INITIATIVES .....</b>	<b>132</b>
2.1	Overall Approach .....	132
2.1.1	Unit Energy Savings .....	133
2.1.2	Estimating Total Market Units .....	133
2.2	Estimating Natural Market Baseline.....	134
2.2.1	The Role of Natural Market Baseline and Attribution .....	134
2.2.2	Natural Market Baseline Units .....	135
2.3	Accounting for RA Savings .....	137
2.4	Allocating Energy Savings to Individual Utility Sponsors .....	138
2.5	Estimating Savings Post Active-Market Engagement in Markets without Codes or Standards as an Endpoint 139	
2.5.1	Duration of Savings Post Active Market Engagement in Markets without Codes or Standards as an Endpoint 140	
2.6	Energy Codes and Appliance Standards .....	140

2.6.1	Additional Considerations for Savings from Codes and Standards .....	141
2.7	Energy Savings from Enhanced Energy Code Compliance Activities .....	142
2.7.1	Duration of Enhanced Energy Code Compliance Savings .....	143
<b>3</b>	<b>APPENDICES .....</b>	<b>145</b>
3.1	Appendix A: MT Initiative Business Plan Outline .....	145
3.2	Appendix B: Glossary of Terms .....	145
3.3	Appendix C: References.....	147

## Table of Figures

### Attachment A

Figure 2-1. Example - Types of Spillover and Methods for Assessment .....	40
Figure 3-1. Core Free Ridership Algorithm 1 .....	44
Figure 3-2. Core Free Ridership Algorithm 2 .....	44
Figure 3-3. Small Business Free Ridership.....	57
Figure 3-4. Study-Based Free Ridership—Overview .....	59
Figure 3-5. Study-Based Free Ridership—No-Program FR Score Option #1 .....	60
Figure 3-6. Study-Based Free Ridership—No-Program FR Score Option #2 .....	61
Figure 4-1. NPSO Question Logic.....	67
Figure 4-2. Appliance Retirement Scenarios .....	71
Figure 4-3. Residential Upstream Lighting Free Ridership via In-Store Intercept.....	74
Figure 4-4. Residential Upstream Lighting Participant Spillover Determination .....	76
Figure 4-5. Residential Upstream Lighting Nonparticipant Spillover Determination .....	78
Figure 4-6. Residential Prescriptive Rebate (With No Audit) Free Ridership .....	80
Figure 4-7. Single-Family Home Energy Audit Free Ridership—No Cost Measures.....	83
Figure 4-9. Multifamily Free Ridership—Non-CFL/Non-LED Measures .....	86
Figure 4-10. Multifamily Free Ridership for Property Managers—CFL/LED Measures.....	86
Figure 4-11. Energy Saving Kits and Elementary Education Free Ridership .....	87
Figure 4-12. Residential New Construction Free Ridership.....	89

### Attachment B

Figure 1-1. Proposed Approach for Determining EUL for Non-TRM Measures.....	120
---	-----

### Attachment C

Figure 1-1: Examples of Potential MT Activities Under a “Theory Umbrella” .....	128
Figure 2-1: Framework for MT Savings .....	133
Figure 2-2: Accounting for RA and MT Program Savings .....	138
Figure 2-3: The Effect of Energy Code Adoption .....	141
Figure 2-4: Savings from Enhancing Energy Code Compliance .....	143

## Table of Tables

### Attachment A

Table 1-1. ICC Energy Efficiency Dockets .....	32
Table 2-1. Definitions .....	36
Table 3-1. Commercial, Industrial, and Public Sector Programs .....	41
Table 4-1. Residential and Low Income Programs.....	63
Table 4-2. Estimation of Respondents’ NPSO Savings .....	68
Table 4-3. Calculation of Total NPSO Generated.....	68
Table 4-2. Net Savings Example for a Sample Population* .....	71
Table 4-8. IECC 2015 Building Energy Code .....	92
Table 5-1. Example Triangulation Weighting Approach .....	95
Table 5-3. NTG Summary for Consumption Data Analysis.....	100

### Attachment B

Table 1-1. Recommended Commercial Custom Measure End-Use Categories, Subcategories and Effective Useful Life Values.....	120
Table 1-2. Source Strength Type and Examples .....	124

**Attachment C**

Table 1-1: Comparing Resource Acquisition Programs and Market Transformation Initiatives ..... 129

## 6 Cross-Cutting Measures

### 6.1 Behavior

#### 6.1.1 Adjustments to Behavior Savings to Account for Persistence

##### DESCRIPTION

Energy efficiency program administrators are increasingly including behavior programs as part of their portfolios. These programs are characterized by various kinds of outreach, education, and customer engagement designed to motivate increases in conservation and energy management behaviors, and most commonly include participant-specific energy usage information. Savings impacts are evaluated by ex-post billing analysis comparing consumption before and after (or with and without) program intervention, and require M&V methods that include customer-specific energy usage regression analysis and randomized controlled trial (RCT) experimental designs, among others (see Behavioral protocol set forth in the IL-TRM Attachment A: Illinois Statewide Net-to-Gross Methodologies for more information). As such, initial calculation of savings is treated as a custom protocol.<sup>1</sup>

An important issue for many stakeholders is whether energy savings from behavior programs continue over time (i.e., whether they persist beyond the initial program year). Behavior programs have now been delivered for a number of years in many jurisdictions. The weight of evaluation evidence indicates that the energy-saving behaviors influenced through at least some types of these programs can persist beyond the initial period of program intervention, even without continued program participation.<sup>2</sup> This post-treatment savings persistence has implications for calculations of first-year savings, measure life, and cost-effectiveness testing. Accounting for persistence will yield savings and cost-effectiveness estimates that more accurately reflect the true benefits of these programs. Because annual goals are based on first-year savings, programs should count, and only count, savings attributable to first-year spending. The effect of persistence of savings from such spending beyond the first year should be included in any lifetime savings calculations (including cumulative persistent annual savings) and cost-effectiveness testing.

The protocol below was developed to outline the adjustments that should be made to account for the persistence of savings beyond the year of program delivery. This general protocol is applicable to behavior programs of any type, delivered to residential or C&I customers, that have evaluated evidence of program persistence. However, the deemed persistence values and measure life in this version of the protocol are specific to residential home energy reports (HERs)-type programs only.<sup>3</sup> Evaluations in Illinois and elsewhere have shown that at least some of the savings from residential HERs-type behavior programs can persist into the first several years following discontinuation of program delivery, though on-going savings levels decay over time.<sup>4</sup> For residential RCT programs evaluated to date, savings have been shown to persist for at least two years and as much as eight years following program delivery,<sup>5</sup> and industry expectations are that savings may persist beyond that. For any other program type,

<sup>1</sup> The protocol outlined here assumes that adjustments to remove the effects of savings from program lift (participation in other utility programs), including legacy uplift, to account for move-outs and opt-outs, to normalize for effects of weather, and any other appropriate adjustments, have been made as part of the custom calculation of savings – this final savings value is referred to as “Measured Savings” in the calculations below.

<sup>2</sup> Long-Run Savings and Cost-Effectiveness of Home Energy Reports Programs, Cadmus, October 2014. Also see additional sources in the REFERENCE TABLES section below.

<sup>3</sup> Residential HERs-type programs: programs that regularly deliver home energy reports to residential customers through direct mail or email channels using a random control trial (RCT) experimental design. At a minimum, the reports include customer-specific usage information used for a comparison to similar households and individualized energy savings tips.

<sup>4</sup> See REFERENCE TABLES below for sources.

<sup>5</sup> Long-Run Savings and Cost-Effectiveness of Home Energy Reports Programs, Cadmus, October 2014. Also see additional sources in the REFERENCE TABLE below. Given the variable characteristics of persistence studies available, we acknowledge that using an average of these studies by fuel type may be the best approximation of persistence rates. However, moving forward, the TAC will incorporate additional study values and develop the most appropriate persistence factors, taking into account when possible participant characteristics, such as the duration of exposure, the frequency of reports, baseline usage, as well as

persistence factors and years of persistence will only be deemed for application once supportable assumptions for persistence exist as measured by multi-year, rigorous evaluation studies.

Currently, evaluations of residential HERs-type programs calculate a custom value on an annual basis to estimate yearly savings, the initial input value for application of this persistence protocol. Evaluators typically use a regression analysis to estimate program effects. These regression analyses provide what is called an average treatment effect on the treated (ATT) estimate of program savings. The ATT approach takes advantage of the presence of a randomly assigned control group for each cohort that received reports in the service territory. These regressions use various methods to account for household-specific usage patterns.<sup>6</sup> Because of the experimental design, we can assume that the treatment and control groups experienced similar historical, political, economic, and other events that had comparable effects on their energy use. Moreover, because these groups experienced generally similar weather conditions, it is not necessary to measure or include weather in the RCT model specification to calculate initial annual savings related to the program.

However, in the case of comparing and summing savings year over year, exogenous factors, such as weather, are likely to make annual estimates non-equivalent. In particular, weather is likely to play an important role in driving behavioral effects, affecting savings magnitude (e.g., a constant percentage change in consumption will result in more cooling savings during a hotter-than-average summer), as well as savings rate (e.g., the percentage change in consumption is likely to be higher during hotter-than-average summers. As such, for this framework, evaluators will adjust for effects related to weather as part of the custom inputs to this protocol. Each evaluator will choose the most appropriate method for weather normalization. For example, one method would be to provide savings using a model specification that incorporates standard weather year inputs (e.g., HDD and CDD), to be used as the initial input into the calculation of annual savings, as well as inputs for cost effectiveness, as outlined below. This input will approximate average savings for a standard weather year based upon historical data.<sup>7</sup> Adjusting savings to a standard weather year is consistent with how other weather-sensitive TRM measures are specified, and will remove weather risk from performance goals and cost-effectiveness testing.<sup>8</sup>

The current update to this protocol will become effective for residential HERs-type programs as of January 1, 2022. The update is provided in IL-TRM v9.0 to be used for program planning purposes for the 2022-2025 cycle. Evaluations of CY2021 should use IL-TRM v8.0. Should any additional new programs (referred to as “waves” in the calculations below) be established in 2022 or in subsequent years, their first year will be assumed to be Year 1 for that wave – that is, each wave is tracked separately, and savings are calculated separately using the approach outlined here. The assumptions and protocols outlined below will not be applied retrospectively to any utility programs. Updates to persistence factors from future evaluations, once incorporated into the IL-TRM, will be used when available for calculation of annual savings values for applicable program years but will not be applied retrospectively to previous years’ first-year savings calculations.

As noted above, all other types of behavior programs other than residential HERs-type programs *may* use this adjustment protocol with appropriate persistence factors as follows. In the absence of supportable evidence for behavioral persistence for such other program types, persistence factors and measure life will not be deemed. Instead, program administrators may choose to propose and defend persistence factors and years of persistence to be used for such behavioral programs on a custom basis in concert with the independent evaluator and stakeholders,<sup>9</sup> on the understanding that the evaluator should then plan to retrospectively assess persistence for

---

the amount of time that has persisted since receiving their final report, and the shape of the persistence curve.

<sup>6</sup> For example, a linear fixed-effects regression (LFER) model includes a household-specific intercept to account for time-invariant, household-level factors affecting energy use, and a post program regression (PPR) model uses energy use lags to account for household-specific usage in the year prior to the program.

<sup>7</sup> In the future, this approach could be empirically tested by comparing actual savings calculated in future program years against standard weather year results, producing a ‘realization rate’ between planned and actual savings results. Standard weather years could potentially be enhanced to better reflect these differences.

<sup>8</sup> We acknowledge that this approach is a proxy for estimating actual savings to allow for prospective calculation of lifetime savings. However, a substantial limitation to this approach is the issue of unobserved behavioral ramp-up that is likely to occur for future waves of participants.

<sup>9</sup> Program Administrators may also choose to use a deemed one-year measure life in the absence of other evidence.



these programs when feasible. However, these persistence factors will be subject to evaluation risk similar to any other custom evaluation parameter.

#### **DETERMINATION OF EFFICIENT BEHAVIOR**

Behavior programs focus primarily on reducing electricity and natural gas consumption through behavioral changes; this reduction is generally measured through ex-post billing analysis after program intervention. Specific energy conservation and management behaviors are not usually directly observable. The specific definition of the efficient case is part of the design of behavioral programs and is included as part of the custom saving protocol, which will include any adjustment necessary to remove effects of program-related investments in efficient equipment.

#### **DETERMINATION OF BASELINE BEHAVIOR**

The ideal baseline for behavior programs is the energy usage without the program intervention. Various types of experimental, quasi-experimental, and/or regression-based EM&V approaches are used to present statistically valid approximations to this without-program baseline.<sup>10</sup> The specific definition of the baseline case is part of the design of behavioral programs and is included as part of the custom saving protocol.

#### **DEEMED LIFETIME/PERSISTENCE OF SAVINGS**

We assume here that savings for residential HERs-type behavior programs persist at some level for nine years beyond the initial treatment year for electric programs, giving a 10-year measure life, and for six years beyond the initial treatment year for gas programs, giving a seven-year measure life.<sup>11</sup> On-going persistent savings over those years are not equal, however; it is preferable that actual levels of ongoing savings should be calculated by future year as outlined below (see Application of Persistence for Prospective Calculations section below) to be used in cost-effectiveness and lifetime savings calculations.<sup>12</sup> For other behavior program types without deemed measure lives and persistence factors, program administrators may choose to propose and defend years of persistence to be used on a custom basis in concert with the independent evaluator and stakeholders, on the understanding that the evaluator should then plan to retrospectively assess persistence for these programs when feasible. Alternatively, a deemed one-year measure life may be used if nothing defensible on measure life/persistence exists.

#### **DEEMED MEASURE COST**

It is assumed that most behavior changes in residential settings can be accomplished with homeowner labor only and without investment in new equipment; therefore, without evidence to the contrary, measure costs in such residential programs focused on motivating changes in customer behavior may be defined as \$0.<sup>13</sup> Costs for C&I programs may include additional staffing, software purchases, etc. Cost for such programs is therefore program specific and is determined on a custom basis.

---

<sup>10</sup> See the Illinois Behavioral protocol set forth in the IL-TRM Attachment A: IL-NTG Methods for more information concerning randomized control trials and quasi-experimental evaluation methods for non-randomized designs for behavior programs.

<sup>11</sup> Determined as a reasonable assumption by Illinois TAC members. This assumption should continue to be updated as additional research is conducted on these types of programs, and additional evaluation should be undertaken to assess the reasonableness of this assumption for Illinois-specific programs.

<sup>12</sup> This method of applying calculated values for future year benefits is preferred. Alternatively, an effective measure life can be calculated as  $\text{Effective Measure Life} = \text{Total Discounted Lifetime Savings} / \text{First Year Savings}$ .

<sup>13</sup> Future evaluation of costs of behavior change is encouraged to help clarify this assumption. In addition, as noted earlier in this measure characterization, in order to ensure double counting of savings does not occur, the protocol outlined here assumes that adjustments to remove the effects of program lift have been made as part of the custom calculation of savings. In a similar manner, given the savings accounted for by other utility programs are removed from the savings claims and cost-effectiveness for the behavior program, the incremental costs associated with such utility program incentivized measures should also be excluded from the behavior program cost-effectiveness analysis, so as to help ensure double counting of costs does not occur in the utility portfolio cost-effectiveness analysis.

### LOADSHAPE AND COINCIDENCE FACTOR

While there is evidence from analysis of AMI data that the savings loadshape for residential HERs-type programs mirrors the whole-house electric energy load pattern, there are not yet enough data to develop a behavior-specific loadshape. Indications from several unpublished analyses<sup>14</sup> show that these behavior savings occur in a general pattern most closely approximated by the Residential Electric Heating and Cooling Loadshape (R10) than any other current residential measure loadshape; this is therefore recommended as the most reasonable approximation for use until more-specific data are available. Loadshapes and coincidence factors will need to be determined for other types of behavior programs once sufficient data are in hand.

---



---

### Algorithm

---



---

#### CALCULATION OF SAVINGS

Throughout these protocols, Year T refers to the current reporting year for which annual savings are being determined (treatment year).<sup>15</sup>

#### ELECTRIC ENERGY SAVINGS

The algorithm shown below for this measure was developed to calculate the annual persistence-adjusted electric savings in to be reported in year T after adjustment to account for the proportion of the measured savings for that program year that actually reflects any persistent savings from prior years' program activities (Years T-1, T-2, T-3, etc.).<sup>16</sup>

$$\Delta kWh_{T \text{ Adjusted}} = \Delta kWh_{T \text{ Measured}} - \sum_{i=1}^n (\Delta kWh_{T-i \text{ Adjusted}} * RR_{T-i,T} * PFE_i)$$

Where:

$\Delta kWh_{x \text{ Adjusted}}$  = total program annual savings for year X after adjustments to account for persistence (calculated value)

$\Delta kWh_{x \text{ Measured}}$  = measured kWh savings: total program savings as determined from custom calculation/billing analysis of participants in program during year X (input value)<sup>17</sup>

$RR_{y,x}$  = Program retention rate in year X from year Y participation<sup>18</sup>

---

<sup>14</sup> Based on communication from Mathias Bell based on (currently unpublished) studies done by Opower, Cadmus, and LBNL. Also see DTE Energy: Behavior Program Measures for Submission to 2015 MEMD - Year Three Energy Savings - Demand Savings. Energy Optimization, April 15, 2014. [http://www.michigan.gov/documents/mpsc/memd\\_2015\\_453673\\_7.pdf](http://www.michigan.gov/documents/mpsc/memd_2015_453673_7.pdf)

<sup>15</sup> Calculation algorithms account for attrition of customers out of the service territory, as well as persistence decay. It has been noted that there may also be a need to adjust for cross-year effects of large differences in weather conditions or economic impacts. Custom savings inputs therefore are adjusted for standard year weather.

<sup>16</sup> This calculation should be carried out separately for each "wave" of behavior programs, where a wave is defined as a newly launched program. For simplicity, any new wave is assumed to start at the beginning of a program year (Year 1) and may include multiple different treatment types such as usage groups, report frequency, etc. For example, any wave added after 2022 will be considered Year 1 in the year they are launched.

<sup>17</sup> All appropriate adjustments to remove effects of participation in other utility programs, move-outs, opt-outs, to normalize for effects related to weather, and other adjustments as determined by the program experimental design, are assumed to have been made to result in this value for "measured savings". This value has been adjusted for standard year weather terms.

<sup>18</sup> It is possible that some savings related to behavioral programs persist even after participants move and are therefore dropped from the program. Such persistent savings could potentially occur in two ways. First, some proportion of these potential savings likely comes from efficient measures installed on the premises and not otherwise identified through other direct program participation; this component of saving could persist even under new building ownership. Second, participants who move might continue behavior changes that save energy even in a new setting; this could continue to provide savings to

= % of program participants in year Y that are still in program in year X (input value: calculated as # participants still in program in year X / # participants in year Y))

PFE<sub>Z</sub> = Persistence factor, electric programs (deemed value)

= % savings that persist Z years after savings were initially measured

= use table below to select the appropriate value

*n* = number of additional years beyond first year of program delivery for which savings persist

= Illinois electric programs assumption = 9

**Electric Persistence Factors<sup>19</sup>**

Program Type = Electric Residential HERs-type (RCT)	
Application Year	Persistence Factor
<b>Program Year T (treatment year)</b> - record 100% of adjusted savings ( $\Delta kWh_{TAdjusted}$ above)	100%
Percent adjusted savings from Year T activities that persist <b>1 year after year T</b> = PFE <sub>1</sub>	78%
Percent adjusted savings from Year T activities that persist <b>2 years after year T</b> = PFE <sub>2</sub>	61%
Percent adjusted savings from Year T activities that persist <b>3 years after year T</b> = PFE <sub>3</sub>	47%
Percent adjusted savings from Year T activities that persist <b>4 years after year T</b> = PFE <sub>4</sub>	37%
Percent adjusted savings from Year T activities that persist <b>5 years after year T</b> = PFE <sub>5</sub>	29%
Percent adjusted savings from Year T activities that persist <b>6 years after year T</b> = PFE <sub>6</sub>	23%
Percent adjusted savings from Year T activities that persist <b>7 years after year T</b> = PFE <sub>7</sub>	18%
Percent adjusted savings from Year T activities that persist <b>8 years after year T</b> = PFE <sub>8</sub>	14%

the program administrator if the move was within the same utility territory. As of this time, no definitive information exists as to the level of program savings related to installed measures vs. behavioral changes, making determination of these effects highly uncertain, and sufficient data may not exist to track individual customer moves. As such, this protocol assumes no persistent savings related to customers who move. Program administrators may choose to propose and defend a methodology to calculate persisting savings net of the existing RCT for the residual effects of move-outs on a custom basis in concert with the independent evaluator and stakeholders. Such a custom treatment should be based on defensible evaluation of the proportion of persisting savings from move-outs related to installed efficient measures vs. ongoing changes in behavior, utility-specific data on total customer moves within the utility territory, and appropriate management of customers who move with regard to future behavior program participation. Management of customers who move out, and the associated persisting savings of the households and premises, should not impede the ability of the program administrator to operate the program as an RCT and maintain or expand the program size (households in treatment, etc.). Such an adjustment will be subject to evaluation risk similar to any other custom evaluation parameter.

<sup>19</sup> See REFERENCE TABLES below for sources.

Program Type = Electric Residential HERs-type (RCT)	
Application Year	Persistence Factor
Percent adjusted savings from Year T activities that persist <b>9 years after year T</b> = PFE <sub>9</sub>	11%

**Example of Adjusted Annual Savings Calculations:**

Assume the following information on participation and measured savings for an electric HERs-type program for the following program years (all adjustments have been made to remove effects of program lift, weather, etc. within the custom savings calculations). Assume 2021 is the first year of the program/wave.

	Reporting Year						
	2021	2022	2023	2024	2025	2026	2027
<b>Input data from program information and custom savings analysis</b>							
# Participants (households)	120,000	109,000	103,000	99,000	94,000	90,000	88,000
kWh per participant (household)	200	250	245	250	250	265	265
kWh Measured savings (custom)	24,000,000	27,250,000	25,235,000	24,750,000	23,500,000	23,850,000	23,320,000

**Calculation of Retention Rates:**

**For use in 2022:**

$$RR_{2021, 2022} = 109,000/120,000 = 0.908$$

**For use in 2023:**

$$RR_{2021, 2023} = 103,000/120,000 = 0.858$$

$$RR_{2022, 2023} = 103,000/109,000 = 0.945$$

**For use in 2024:**

$$RR_{2021, 2024} = 99,000/120,000 = 0.825$$

$$RR_{2022, 2024} = 99,000/109,000 = 0.908$$

$$RR_{2023, 2024} = 99,000/103,000 = 0.961$$

**For use in 2025:**

$$RR_{2021, 2025} = 94,000/120,000 = 0.783$$

$$RR_{2022, 2025} = 94,000/109,000 = 0.862$$

$$RR_{2023, 2025} = 94,000/103,000 = 0.913$$

$$RR_{2024, 2025} = 94,000/99,000 = 0.949$$

**For use in 2026:**

$$RR_{2021, 2026} = 90,000/120,000 = 0.750$$

$$RR_{2022, 2026} = 90,000/109,000 = 0.826$$

$$RR_{2023, 2026} = 90,000/103,000 = 0.874$$

$$RR_{2024, 2026} = 90,000/99,000 = 0.909$$

$$RR_{2025, 2026} = 90,000/94,000 = 0.957$$

**For use in 2027:**

$$RR_{2021, 2027} = 88,000/120,000 = 0.733$$

$$RR_{2022, 2027} = 88,000/109,000 = 0.807$$

$$RR_{2023, 2027} = 88,000/103,000 = 0.854$$

$$RR_{2024, 2027} = 88,000/99,000 = 0.889$$

$$RR_{2025, 2027} = 88,000/94,000 = 0.936$$

$$RR_{2026, 2027} = 88,000/90,000 = 0.978$$

**Continue this approach for future years as appropriate.**

**Calculation of Adjusted Annual Savings:**

$$\Delta kWh_{2021 \text{ Adjusted}} = 24,000,000 \text{ kWh}$$

$$\Delta kWh_{2022 \text{ Adjusted}} = 27,250,000 - (24,000,000 * 0.908 * 0.78) = 10,252,240 \text{ kWh}$$

$$\Delta kWh_{2023 \text{ Adjusted}} = 25,235,000 - (10,252,240 * 0.945 * 0.78) - (24,000,000 * 0.858 * 0.61) = 5,116,954 \text{ kWh}$$

$$\Delta kWh_{2024 \text{ Adjusted}} = 24,750,000 - (5,116,954 * 0.961 * 0.78) - (10,252,240 * 0.908 * 0.61) - (24,000,000 * 0.825 * 0.47) = 5,929,923 \text{ kWh}$$

$$\Delta kWh_{2025 \text{ Adjusted}} = 23,500,000 - (5,929,923 * 0.949 * 0.78) - (5,116,954 * 0.913 * 0.61) - (10,252,240 * 0.862 * 0.47) - (24,000,000 * 0.783 * 0.37) = 5,154,135 \text{ kWh}$$

$$\Delta kWh_{2026 \text{ Adjusted}} = 23,850,000 - (5,154,135 * 0.957 * 0.78) - (5,929,923 * 0.909 * 0.61) - (5,116,954 * 0.874 * 0.47) - (10,252,240 * 0.826 * 0.37) - (24,000,000 * 0.750 * 0.29) = 6,259,330 \text{ kWh}$$

$$\Delta kWh_{2027 \text{ Adjusted}} = 23,320,000 - (6,259,330 * 0.978 * 0.78) - (5,154,135 * 0.936 * 0.61) - (5,929,923 * 0.889 * 0.47) - (5,116,954 * 0.854 * 0.37) - (10,252,240 * 0.807 * 0.29) - (24,000,000 * 0.733 * 0.23) = 5,062,282 \text{ kWh}$$

**Continue for future years as appropriate.**

Apply the same approach to calculate adjusted annual kW and Therms, using appropriate factors and lifetimes.

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Coincident peak demand savings in year T should also be adjusted to account for persistence from previous years using a similar algorithm.<sup>20</sup>

If peak demand is measured directly by the custom savings analysis:

$$\Delta kW_{T \text{ Adjusted}} = \Delta kW_{T \text{ Measured}} - \sum_{i=1}^n (\Delta kW_{T-i \text{ Adjusted}} * RR_{T-i,T} * PFE_i)$$

Where:

$\Delta kW_{X \text{ Adjusted}}$  = total program demand savings for year X after adjustments to account for persistence (calculated value)

$\Delta kW_{X \text{ Measured}}$  = total program demand savings as determined from custom calculation /billing analysis of participants in program during year X (input value)<sup>21</sup>

Other variables as defined above

If peak demand is not measured directly by the custom savings analysis, peak demand should be calculated as follows:

$$\Delta kW_{T \text{ Adjusted}} = (\Delta kWh_{T \text{ Adjusted Summer}} / \# \text{summer hours}) * \text{peak adjustment factor}$$

Where:

$\Delta kWh_{T \text{ Adjusted Summer}}$  = average adjusted electric energy savings (calculated above) for peak summer months

$$= \Delta kWh_{T \text{ Adjusted}} * 0.42 * (3/5)$$

$$= \Delta kWh_{T \text{ Adjusted}} * 0.25$$

Where:

0.42 = Summer Loadshape % for May – Sept

3/5 = proportion of May-Sept hours that fall in June, July, and Aug

# summer hours = # hours in June, July, and Aug

$$= 8760 / 4$$

Where: 8760 = Hours per year

peak adjustment factor = adjustment for peak k/w over average kW for these hours

$$= 1.5^{22}$$

**NATURAL GAS ENERGY SAVINGS**

The algorithm shown below for this measure was developed to calculate the annual persistence-adjusted Therm savings in to be reported in year T after adjustment to account for the proportion of the measured savings for that

<sup>20</sup> While there are no current studies that evaluate the persistence of peak savings, without more-specific information on the actual behaviors undertaken by program participants and their corresponding peak savings, it seems reasonable to assume that peak savings will also persist in a similar pattern; both of the approaches given assume persistence in peak savings. Further evaluation should be undertaken to clarify this point and determine appropriate peak-specific persistence values.

<sup>21</sup> All appropriate adjustments to remove effects of participation in other utility programs, move-outs, opt-outs, to normalize for effects related to weather, and other adjustments as determined by the program experimental design, are assumed to have been made to result in this value for “measured savings”. This value has been adjusted for standard year weather terms.

<sup>22</sup> Based on an approach used in Michigan that gives resulting values supported by evaluation claims. Also see DTE Energy: Behavior Program Measures for Submission to 2015 MEMD - Year Three Energy Savings - Demand Savings. Energy Optimization, April 15, 2014. [http://www.michigan.gov/documents/mpsc/memd\\_2015\\_453673\\_7.pdf](http://www.michigan.gov/documents/mpsc/memd_2015_453673_7.pdf)

program year that actually reflects any persistent savings from prior years’ program activities (Years T-1, T-2, T-3, etc.).<sup>23</sup>

$$\Delta\text{Therms}_{T\text{ Adjusted}} = \Delta\text{Therms}_{T\text{ Measured}} - \sum_{i=1}^n (\Delta\text{Therms}_{T-i\text{ Adjusted}} * RR_{T-i,T} * PFG_i)$$

Where:

$\Delta\text{Therms}_{x\text{ Adjusted}}$  = total program annual savings for year X after adjustments to account for persistence (calculated value)

$\Delta\text{Therms}_{x\text{ Measured}}$  = total program savings as determined from custom calculation/billing analysis of participants in program during year X (input value)<sup>24</sup>

$PFG_z$  = Persistence factor, gas programs (deemed value)

= % savings that persist Z years after savings were initially measured

= use table below to select the appropriate value

$n$  = number of additional years beyond first year of program delivery for which savings persist

= Illinois gas programs assumption = 6

Other variables as defined above

**Gas Persistence Factors<sup>25</sup>**

Program Type = Gas Residential HERs-type (RCT)	
Application Year	Persistence Factor
<b>Program Year T (treatment year)</b> - record 100% of adjusted savings ( $\Delta\text{Therms}_{T\text{ Adjusted}}$ above)	100%
Percent adjusted savings from Year T activities that persist <b>1 year after year T</b> = $PGE_1$	70%
Percent adjusted savings from Year T activities that persist <b>2 years after year T</b> = $PGE_2$	49%
Percent adjusted savings from Year T activities that persist <b>3 years after year T</b> = $PGE_3$	34%
Percent adjusted savings from Year T activities that persist <b>4 years after year T</b> = $PGE_4$	24%
Percent adjusted savings from Year T activities that persist <b>5 years after year T</b> = $PGE_5$	17%
Percent adjusted savings from Year T activities that persist <b>6 years after year T</b> = $PGE_6$	12%

<sup>23</sup> This calculation should be carried out separately for each “wave” of behavior programs, where a wave is defined as a newly launched program. For simplicity, any new wave is assumed to start at the beginning of a program year (Year 1) and may include multiple different treatment types such as usage groups, report frequency, etc.

<sup>24</sup> All appropriate adjustments to remove effects of participation in other utility programs, move-outs, opt-outs, to normalize for effects related to weather, and other adjustments as determined by the program experimental design, are assumed to have been made to result in this value for “measured savings”. This value has been adjusted for standard year weather terms.

<sup>25</sup> See REFERENCE TABLES below for sources.

**APPLICATION OF PERSISTENCE FOR PROSPECTIVE CALCULATIONS**

For determination of prospective savings related to programs delivered in year T (including cost-effectiveness, lifetime savings, and cumulative prospective annual savings (CPAS)), future years’ savings related to the current year activities should be recorded for this measure as savings for each specific year calculated using the table below – the current year plus 9 years of future persisting savings for electric programs, and the current year plus 6 years of future persisting savings for gas programs. Because of the potentially confounding effects of differences in weather in future years, the savings inputs used ( $\Delta kWh_{TAdjusted}$ ,  $\Delta kW_{TAdjusted}$ ,  $\Delta Therms_{TAdjusted}$ ) for these future-year savings calculations have been determined using weather normalized inputs. This input (to be provided by program evaluators) will approximate average savings for a standard weather year based upon historical data.<sup>26</sup>

Calculation of Future Years’ Savings Related to Current Year Activities			
	Electric Programs		Gas Programs
	Electric Energy Savings	Peak Savings	Therm Savings
Program Year T: record 100% of adjusted annual savings as calculated above	$\Delta kWh_{TAdjusted}$	$\Delta kW_{TAdjusted}$	$\Delta Therms_{TAdjusted}$
Percent savings from Year T activities that persist 1 year after year T	$\Delta kWh_{TAdjusted} * PFE_1 * RR_{Utility}$	$\Delta kW_{TAdjusted} * PFE_1 * RR_{Utility}$	$\Delta Therms_{TAdjusted} * PFG_1 * RR_{Utility}$
Percent savings from Year T activities that persist 2 years after year T	$\Delta kWh_{TAdjusted} * PFE_2 * RR_{Utility}^2$	$\Delta kW_{TAdjusted} * PFE_2 * RR_{Utility}^2$	$\Delta Therms_{TAdjusted} * PFG_2 * RR_{Utility}^2$
Percent savings from Year T activities that persist 3 years after year T	$\Delta kWh_{TAdjusted} * PFE_3 * RR_{Utility}^3$	$\Delta kW_{TAdjusted} * PFE_3 * RR_{Utility}^3$	$\Delta Therms_{TAdjusted} * PFG_3 * RR_{Utility}^3$
Percent savings from Year T activities that persist 4 years after year T	$\Delta kWh_{TAdjusted} * PFE_4 * RR_{Utility}^4$	$\Delta kW_{TAdjusted} * PFE_4 * RR_{Utility}^4$	$\Delta Therms_{TAdjusted} * PFG_4 * RR_{Utility}^4$
Percent savings from Year T activities that persist 5 years after year T	$\Delta kWh_{TAdjusted} * PFE_5 * RR_{Utility}^5$	$\Delta kW_{TAdjusted} * PFE_5 * RR_{Utility}^5$	$\Delta Therms_{TAdjusted} * PFG_5 * RR_{Utility}^5$
Percent savings from Year T activities that persist 6 years after year T	$\Delta kWh_{TAdjusted} * PFE_6 * RR_{Utility}^6$	$\Delta kW_{TAdjusted} * PFE_6 * RR_{Utility}^6$	$\Delta Therms_{TAdjusted} * PFG_6 * RR_{Utility}^6$
Percent savings from Year T activities that persist 7 years after year T	$\Delta kWh_{TAdjusted} * PFE_7 * RR_{Utility}^7$	$\Delta kW_{TAdjusted} * PFE_7 * RR_{Utility}^7$	n/a
Percent savings from Year T activities that persist 8 years after year T	$\Delta kWh_{TAdjusted} * PFE_8 * RR_{Utility}^8$	$\Delta kW_{TAdjusted} * PFE_8 * RR_{Utility}^8$	n/a
Percent savings from Year T activities that persist 9 years after year T	$\Delta kWh_{TAdjusted} * PFE_9 * RR_{Utility}^9$	$\Delta kW_{TAdjusted} * PFE_9 * RR_{Utility}^9$	n/a

Where:

<sup>26</sup> In the future, this approach could be empirically tested by comparing actual savings calculated in future program years against standard weather year results, producing a ‘realization rate’ between planned and actual savings results. Standard weather years could potentially be enhanced to better reflect these differences.



$RR_{Utility}$  = a utility-specific estimated future retention rate for the program<sup>27,28</sup>

Other variables as defined above

---

<sup>27</sup> This retention rate should be an historical average, based on multiple years of data, that applies across all program waves for a given utility. The retention rate should be updated on a regular basis (for example, with the program planning cycles) to make sure it remains reflective of current program and economic conditions. Evaluators will decide for each utility what population the retention rate should be based on (for example: all residential customers; the entire population eligible for the program; the current program population). In making this decision, evaluators should consider data availability, expected changes in the program population in the planning cycle, and the eligible population for the program.

<sup>28</sup> It is possible that some savings related to behavioral programs persist even after participants move and are therefore dropped from the program. Such persistent savings could potentially occur in two ways. First, some proportion of these potential savings likely comes from efficient measures installed on the premises and not otherwise identified through other direct program participation; this component of saving could persist even under new building ownership. Second, participants who move might continue behavior changes that save energy even in a new setting; this could continue to provide savings to the program administrator if the move was within the same utility territory. As of this time, no definitive information exists as to the level of program savings related to installed measures vs. behavioral changes, making determination of these effects highly uncertain, and sufficient data may not exist to track individual customer moves. As such, this protocol assumes no persistent savings related to customers who move. Program administrators may choose to propose and defend a methodology to calculate persisting savings net of the existing RCT for the residual effects of move-outs on a custom basis in concert with the independent evaluator and stakeholders. Such a custom treatment should be based on defensible evaluation of the proportion of persisting savings from move-outs related to installed efficient measures vs. ongoing changes in behavior, utility-specific data on total customer moves within the utility territory, and appropriate management of customers who move with regard to future behavior program participation. Management of customers who move out, and the associated persisting savings of the households and premises, should not impede the ability of the program administrator to operate the program as an RCT and maintain or expand the program size (households in treatment, etc.). Such an adjustment will be subject to evaluation risk similar to any other custom evaluation parameter.

**Example of Calculation of Cost-effectiveness Inputs:**

Assume the same information for an electric program as was used in the Example of Adjusted Annual Savings Calculations, and the following estimated future program retention rate.

	Reporting Year T						
	2021	2022	2023	2024	2025	2026	2027
Annual Energy Savings = Adj. kWh savings (previously calculated) = $\Delta kWh_{TAdjusted}$	24,000,000	10,252,240	5,116,954	5,929,923	5,154,135	6,259,330	5,062,282
RR <sub>Utility</sub> = 0.88							

**Inputs for calculating cost effectiveness in 2021:**

Cost-effectiveness benefit of 2021 savings in 2022 =  $\Delta kWh_{2021 Adjusted} * PFE_1 * RR_{Utility} = 24,000,000 * 0.78 * 0.88 = 16,473,600$  kWh

Cost-effectiveness benefit of 2021 savings in 2023 =  $\Delta kWh_{2021 Adjusted} * PFE_2 * RR_{Utility}^2 = 24,000,000 * 0.61 * 0.88^2 = 11,337,216$  kWh

Cost-effectiveness benefit of 2021 savings in 2024 =  $\Delta kWh_{2021 Adjusted} * PFE_3 * RR_{Utility}^3 = 24,000,000 * 0.47 * 0.88^3 = 7,687,004$  kWh

Cost-effectiveness benefit of 2021 savings in 2025 =  $\Delta kWh_{2021 Adjusted} * PFE_4 * RR_{Utility}^4 = 24,000,000 * 0.37 * 0.88^4 = 5,325,295$  kWh

Cost-effectiveness benefit of 2021 savings in 2026 =  $\Delta kWh_{2021 Adjusted} * PFE_5 * RR_{Utility}^5 = 24,000,000 * 0.29 * 0.88^5 = 3,673,014$  kWh

Cost-effectiveness benefit of 2021 savings in 2027 =  $\Delta kWh_{2021 Adjusted} * PFE_6 * RR_{Utility}^6 = 24,000,000 * 0.23 * 0.88^6 = 2,563,511$  kWh

**Inputs for calculating cost effectiveness in 2022:**

Cost-effectiveness benefit of 2022 savings in 2023 =  $\Delta kWh_{2022 Adjusted} * PFE_1 * RR_{Utility} = 10,252,240 * 0.78 * 0.88 = 7,037,138$  kWh

Cost-effectiveness benefit of 2022 savings in 2024 =  $\Delta kWh_{2022 Adjusted} * PFE_2 * RR_{Utility}^2 = 10,252,240 * 0.61 * 0.88^2 = 4,842,994$  kWh

Cost-effectiveness benefit of 2022 savings in 2025 =  $\Delta kWh_{2022 Adjusted} * PFE_3 * RR_{Utility}^3 = 10,252,240 * 0.47 * 0.88^3 = 3,283,709$  kWh

Cost-effectiveness benefit of 2022 savings in 2026 =  $\Delta kWh_{2022 Adjusted} * PFE_4 * RR_{Utility}^4 = 10,252,240 * 0.37 * 0.88^4 = 2,274,842$  kWh

Cost-effectiveness benefit of 2022 savings in 2027 =  $\Delta kWh_{2022 Adjusted} * PFE_5 * RR_{Utility}^5 = 10,252,240 * 0.29 * 0.88^5 = 1,569,026$  kWh

Cost-effectiveness benefit of 2022 savings in 2028 =  $\Delta kWh_{2022 Adjusted} * PFE_6 * RR_{Utility}^6 = 10,252,240 * 0.23 * 0.88^6 = 1,095,072$  kWh

**Continue this approach for future years as appropriate.**

Apply the same approach to calculate cost-effectiveness inputs for kW and for Therms, using appropriate factors and lifetimes.

**WATER IMPACT DESCRIPTIONS AND CALCULATION**

N/A

**DEEMED O&M COST ADJUSTMENT CALCULATION**

N/A

**REFERENCE TABLES**

Persistence studies done to date for HERs-type programs capture effects through a specific time frame and only for the specific program characteristics of the programs studied. While any individual study may not accurately represent conditions in Illinois or those for all Illinois programs, the Illinois TAC has determined that an average of the implied annual decay rates across the electric- or gas-specific studies done to date (Tables 1 and 2 below) is the best currently available data to approximate persistence for the general class of residential HERs-type programs. This protocol assumes a standard decay function with a constant annual savings decay rate, where Persistence in year  $t = (1 - \text{Annual Decay Rate})^t$ .

It is recommended that the persistence values and the length of persistence application as used in this protocol continue to be reviewed for update once every plan cycle as further longer term and Illinois-specific evaluations are undertaken.

Table 1: Annual Decay Rate for Residential HERs-type (RCT) Programs: Reference Studies – Electric Programs												
Source	Utility/Location	Number of Months in Program Before Terminated	Number of Post-Treatment Savings Analysis Months	Persistence:								Implied Annual Decay Rate
				1 Year after Treatment	2 Years after Treatment	3 Years after Treatment	4 Years after Treatment	5 Years after Treatment	6 Years after Treatment	7 Years after Treatment	8 Years after Treatment	
1 & 2	Upper Midwest	24-45	26		62%							21%
1 & 2	West Coast	24	29		67%							18%
1 & 2	West Coast	25-28	34		72%							15%
1 & 3	SMUD	27	12	68%								32%
4	MASS	26	15	67%								33%
5	Duke Energy Progress	22	12	54%								46%
6 & 7	Southern California Edison	12	24	97%	75%							13%
7 & 8	Pennsylvania (PPL & Duquesne)	10-38	16-21		69%							17%
7 & 9	Connecticut	8-14	48	71%	61%	26%	27%					28%
10	Pacific Gas and Electric	30	36	100%	92%	72%						10%
11	Indiana Michigan Power Company	21	27		66%							19%

Table 1: Annual Decay Rate for Residential HERs-type (RCT) Programs: Reference Studies – Electric Programs												
Source	Utility/Location	Number of Months in Program Before Terminated	Number of Post-Treatment Savings Analysis Months	Persistence:								Implied Annual Decay Rate
				1 Year after Treatment	2 Years after Treatment	3 Years after Treatment	4 Years after Treatment	5 Years after Treatment	6 Years after Treatment	7 Years after Treatment	8 Years after Treatment	
12	Pennsylvania (Met-Ed & Penelec)	20-48	24		41%							36%
13-20	Puget Sound Energy	24	96	59%	61%	51%	38%	34%	23%	29%	18%	19%
21	ComEd	16-52	60	90%	69%	65%	70%	63%				9%
22	Ameren Illinois	4-90	24	93%	73%							14%
											<b>Average Annual Electric Savings Decay Rate:</b>	<b>22%</b>

Table 2: Annual Decay Rate for Residential HERs-type (RCT) Programs: Reference Studies – Gas Programs												
Source	Utility/Location	Number of Months in Program Before Terminated	Number of Post-Treatment Savings Analysis Months	Persistence:								Implied Annual Decay Rate
				1 Year after Treatment	2 Years after Treatment	3 Years after Treatment	4 Years after Treatment	5 Years after Treatment	6 Years after Treatment	7 Years after Treatment	8 Years after Treatment	
4	MASS	15	15	36%								64%
10	Pacific Gas and Electric	30	36	60%	44%	37%						28%
13-20	Puget Sound Energy	24	96	94%	69%	80%	83%	72%	63%	63%	62%	6%
22	Ameren Illinois	4-90	24	97%	86%							7%
23	Nicor	12	12	54%								46%
											<b>Average Annual Gas Savings Decay Rate:</b>	<b>30%</b>

Sources:

- [http://www.cadmusgroup.com/wp-content/uploads/2014/11/Cadmus\\_Home\\_Energy\\_Reports\\_Winter2014.pdf](http://www.cadmusgroup.com/wp-content/uploads/2014/11/Cadmus_Home_Energy_Reports_Winter2014.pdf)
- <https://www.povertyactionlab.org/sites/default/files/publications/899%20Allcott%20and%20Rogers%20AER2014%20The%20Short-Run%20and%20Long-Run%20Effects%20of%20Behavioral%20Interventions.pdf>
- <https://library.cee1.org/content/impact-persistence-evaluation-report-sacramento-municipal-utility-district-home-energy-repor>

- 4: <http://ma-eeac.org/wordpress/wp-content/uploads/Home-Energy-Report-Savings-Decay-Analysis-Final-Report1.pdf>
- 5: <https://dms.psc.sc.gov/attachments/matter/9F872380-155D-141F-231F53E80756D3C3>
- 6: [http://www.calmac.org/publications/DNVGL\\_SCE\\_HER\\_2015\\_final\\_to\\_calmac.pdf](http://www.calmac.org/publications/DNVGL_SCE_HER_2015_final_to_calmac.pdf)
- 7: <http://www.ripuc.org/eventsactions/docket/2.%20RI%20HER%20Savings%20Decay%20Lit%20Review%20FINAL.pdf>
- 8: [https://aceee.org/files/proceedings/2016/data/papers/2\\_935.pdf](https://aceee.org/files/proceedings/2016/data/papers/2_935.pdf)
- 9: [https://www.energizect.com/sites/default/files/R1606\\_Eversource%20Behavior%20Persistence%20Evaluation\\_Review%20Draft\\_4.10.17.pdf](https://www.energizect.com/sites/default/files/R1606_Eversource%20Behavior%20Persistence%20Evaluation_Review%20Draft_4.10.17.pdf)
- 10: [http://www.calmac.org/publications/PG&E\\_2016\\_HER\\_Energy\\_and\\_Demand\\_Savings\\_Early\\_EM&V.pdf](http://www.calmac.org/publications/PG&E_2016_HER_Energy_and_Demand_Savings_Early_EM&V.pdf)
- 11: <https://www.indianamichiganpower.com/global/utilities/lib/docs/info/projects/IMDemandSideManagement/44841%20Jon%20C.%20Walter%20Direct%20Testimony%20%20Attachments%20Vol%20II.pdf>
- 12: [http://www.puc.state.pa.us/Electric/pdf/Act129/SWE\\_Res\\_Behavioral\\_Program-Persistence\\_Study\\_Addendum2018.pdf](http://www.puc.state.pa.us/Electric/pdf/Act129/SWE_Res_Behavioral_Program-Persistence_Study_Addendum2018.pdf)
- 13: [https://conduitnw.org/\\_layouts/Conduit/FileHandler.ashx?RID=849](https://conduitnw.org/_layouts/Conduit/FileHandler.ashx?RID=849)
- 14: <http://www.oracle.com/us/industries/utilities/puget-sound-energy-home-3631948.pdf>
- 15: <http://www.oracle.com/us/industries/utilities/herp-puget-sound-energy-3628986.pdf>
- 16: [https://conduitnw.org/\\_layouts/Conduit/FileHandler.ashx?rid=2963](https://conduitnw.org/_layouts/Conduit/FileHandler.ashx?rid=2963)
- 17: <http://www.oracle.com/us/industries/utilities/home-energy-reports-err-2015-3697558.pdf>
- 18: <https://conduitnw.org/pages/file.aspx?rid=4252>
- 19: <https://conduitnw.org/Pages/File.aspx?rid=4415>
- 20: <https://conduitnw.org/pages/file.aspx?rid=4976>
- 21: DRAFT <https://s3.amazonaws.com/ilsag/ComEd-HER-Year-Five-Persistence-and-Decay-Study-2019-10-25.docx>
- 22: [https://s3.amazonaws.com/ilsag/AIC\\_2018\\_Behavioral\\_Modification\\_Persistence\\_Study\\_Memo\\_FINAL\\_2019-10-21.pdf](https://s3.amazonaws.com/ilsag/AIC_2018_Behavioral_Modification_Persistence_Study_Memo_FINAL_2019-10-21.pdf)
- 23: [http://ilsagfiles.org/SAG\\_files/Technical\\_Reference\\_Manual/Version\\_6/Evaluation\\_Documents/Nicor\\_Gas\\_HER\\_Persistence\\_Study\\_Part\\_2\\_Final\\_2016-09-21.pdf](http://ilsagfiles.org/SAG_files/Technical_Reference_Manual/Version_6/Evaluation_Documents/Nicor_Gas_HER_Persistence_Study_Part_2_Final_2016-09-21.pdf)

**MEASURE CODE: CC-BEH-BEHP-V04-220101**

**REVIEW DEADLINE: 1/1/2025**

## 6.2 System Wide

### 6.2.1 Voltage Optimization

#### **DESCRIPTION**

Voltage optimization (VO)<sup>29</sup> is a smart grid technology that flattens voltage profiles and lowers average voltage levels on an electric power distribution grid. Lowering voltage reduces the instantaneous power consumed by customers on VO-enabled feeders,<sup>30</sup> which in turn results in energy and demand savings. Voltage optimization is achieved through the operation of distributed sensors, two-way communications infrastructure, remote controls on substation transformer load-tap changers, voltage regulators and line capacitor banks, and integrating/optimizing software.

Unlike energy efficiency programs that achieve savings by providing financial incentives to encourage customers to adopt energy-efficient equipment or behavioral suggestions to encourage them to adopt no-cost energy-saving behaviors, VO involves no direct customer engagement. Instead, savings are achieved by operating the voltage and reactive power controls on VO-enabled feeders in a manner designed to maintain the voltages delivered to affected customers in the lower part of the allowable voltage range.<sup>31</sup>

In general, reducing the voltage on a feeder reduces power consumed by the connected loads, assuming all other factors of the feeder remain constant. This is a realistic assumption for many types of consumer devices. However, there are several scenarios in which decreasing voltage does not directly result in energy and demand savings. For example, some devices (e.g., electronics) have self-contained control systems that maintain constant power consumption despite the delivered voltage. Other devices increase their power draw when presented with reduced voltage due to nonlinear inefficiencies. Still other devices (e.g., resistive heating) might decrease instantaneous power draw but operate for longer periods; thus their total energy consumption remains approximately constant (similar to the time-shifting effects of demand response programs). This means VO is more effective in reducing load for some device types than others. This may lead it to be more or less effective for specific feeders depending on the exact mix of device types the feeder has.

This measure was developed to be applicable to the following program types: Voltage Optimization. This measure is unique and does not apply to other program types.

#### **DEFINITION OF EFFICIENT EQUIPMENT**

To qualify for this measure, feeders must be enabled with VO technology and have VO fully commissioned and operational.<sup>32</sup>

#### **DEFINITION OF BASELINE EQUIPMENT**

The baseline assumption is a feeder without any VO technology.

---

<sup>29</sup> Voltage optimization is also referred to a volt-var optimization (VVO) or conservation voltage reduction (CVR).

<sup>30</sup> For the purposes of this measure, the term feeder is synonymous with circuit.

<sup>31</sup> The bulk of the energy savings that occurs is thus expected to occur on the customer side of the meter, although additional savings is expected from reduced current flows along the full length of the affected feeders.

<sup>32</sup> Note that any VO On/Off testing for the purposes of evaluation or updating the TRM will not be counted against the utility in claiming savings. VO On/Off testing is an experimental design that involves enabling and disabling the VO system under a predefined schedule for the purposes of testing its functionality. By following a predefined schedule, the VO On/Off design enables modeling of the impact of VO while controlling for factors that may vary over time, such as weather or weekday vs. weekend loads.

**DEEMED LIFETIME OF EFFICIENT EQUIPMENT**

The measure life is assumed to be 15 years.<sup>33</sup>

**DEEMED MEASURE COST**

The costs vary by feeder. Actual costs should be used.

**LOADSHAPE**

Loadshape C67 Voltage Optimization – Ameren

Loadshape C68 Voltage Optimization - ComEd

**COINCIDENCE FACTOR**

N/A

---

**Algorithm**

---

**CALCULATION OF ENERGY SAVINGS**

**ELECTRIC ENERGY SAVINGS**

Annualized savings should be calculated separately for each VO-enabled feeder. The savings reductions during VO On/Off testing shall not be a basis to reduce the estimated savings.<sup>34</sup> The off periods from testing shall be treated as if they were on during the evaluation period.

$$\Delta kWh = kWh_{BASE} * \Delta V * CVR_f$$

Where:

$$kWh_{BASE} = \text{Baseline kWh consumption on the feeder per year}^{35}$$

For Ameren territory, use the average annual customer energy use for each feeder over the 2014-2016 timeframe, less energy use by exempt customers.

For ComEd territory, use annual energy consumption using the actual energy measurement during the time when VO was off (as appropriate; this may include the actual measurements prior to VO activation during the given program year and from prior program years and VO OFF periods from subsequent program years) and a calculated VO OFF value for the time when VO was on. The VO OFF baseline energy for the periods when VO is on shall be calculated using:

$$E_{VO\_OFF} = \frac{E_{VO\_ON}}{1 - (CVR_f * \Delta V)}$$

Where:

---

<sup>33</sup> This measure life is prescribed by Illinois statute 220 ILCS 5/8-103B(b-20):

(b-20) Each electric utility subject to this Section may include cost-effective voltage optimization measures in its plans submitted under subsections (f) and (g) of this Section, and the costs incurred by a utility to implement the measures under a Commission-approved plan shall be recovered under the provisions of Article IX or Section 16-108.5 of this Act. For purposes of this Section, the measure life of voltage optimization measures shall be 15 years. The measure life period is independent of the depreciation rate of the voltage optimization assets deployed.

<sup>34</sup> VO On/Off testing is an experimental design that involves enabling and disabling the VO system under a predefined schedule for the purposes of testing its functionality. By following a predefined schedule, the VO On/Off design enables modeling of the impact of VO while controlling for factors that may vary over time, such as weather or weekday vs. weekend loads.

<sup>35</sup> If the energy consumption baseline is measured at the feeder head, an adjustment will be made to recognize line losses and loss savings.

$E_{VO\_OFF}$  = the calculated VO OFF energy consumption when VO is on (activated)

$E_{VO\_ON}$  = the actual measured energy consumption during the period when VO is on

$\Delta V$  = the voltage reduction

$CVR_f$  = the CVR factor

- i Where power (MW) data has not been established yet, best available data from the feeder line measurement devices should be considered.
- ii Data are clustered into bins according to temperature range,<sup>36</sup> season,<sup>37</sup> day type (weekday/weekend),<sup>38</sup> and hour of the day based on the VO OFF and ON statuses to create a lookup table. If multiple data points are found (i.e., same temperature range, same season, same day type, same hour of the day, and same VO status), the average of multiple references are placed into the lookup table. Various combinations of these variables may be used in an order of decreasing priority when no data points are found that match all of them.
- iii The independent evaluator shall use best practices, including an appropriate technique that is transparent, replicable, and most accurate, to address any data quality issues, with input from interested stakeholders, including ComEd.

$\Delta V$  = Percentage voltage reduction on the feeder caused by VO

For Ameren territory, voltage reduction shall be calculated using a pre-post regression model (i.e., comparing pre-VO and post-VO installation). The model specification will be selected based on model fit and may vary year to year. The model will be run in accordance with the terms provided in subsections (i) through (iv) below:

- i The model utilizes pre-period (VO OFF) data from the feeders in question from the prior calendar year.
- ii Voltage (V) data is sourced from customer AMI meters. The feeder average voltage is calculated as the average of at least 70% of the AMI meters on the feeder, whenever possible.<sup>39</sup> AMI voltage readings are normalized by their nominal voltage before averaging voltage across the AMI meters on a given feeder.
- iii Ameren and stakeholders have agreed on a list of excludable events, during which Ameren may claim VO savings if the system is down for reasons deemed appropriate. Please see Table 1 below for further explanation and list of excludable and non-excludable events.

<sup>36</sup> Temperature bins are to the ceiling of the nearest 5°F interval.

<sup>37</sup> Seasons are defined as follows; Spring: March through May; Summer: June through August; Fall: September through November; and Winter: December through February.

<sup>38</sup> Weekdays are Monday to Friday and weekends are Saturday and Sunday.

<sup>39</sup> In cases when less than 70% of the AMI meters are programmed to record voltage data, all available meters will be used, with the goal of utilizing as close to 70% of the meters as possible.



- iv. The independent evaluator shall use best practices, including an appropriate technique that is transparent, replicable, and most accurate, to address any data quality issues, with the input from interested stakeholders, including Ameren.

For ComEd territory, voltage reduction shall be calculated from voltage measurements taken from the feeder’s head end primary voltage source using the following equation and in accordance with the terms provided in subsections (i) through (iv) below:

$$\Delta V = \left( \frac{V_{OFF} - V_{ON}}{V_{OFF}} \right)$$

- i. When VO is off, the voltage if VO was on needs to be estimated and vice versa. Actual measurements shall be used for the off voltage when VO is off and the on voltage when VO is on.
- ii. Data are clustered into bins in accordance to temperature range,<sup>40</sup> season,<sup>41</sup> day type (weekday/weekend),<sup>42</sup> and hour of the day based on the VO OFF and ON statuses to create a lookup table. If multiple data points are found (i.e., same temperature range, same season, same day type, same hour of the day, and same VO status), the average of multiple references are placed into the lookup table. Various combinations of these variables may be used in an order of decreasing priority when no data points are found that match all of them.
- iii. The independent evaluator shall use best practices, including an appropriate technique that is transparent, replicable, and most accurate, to address any data quality issues, with the input from interested stakeholders, including ComEd.
- iv. The counterfactual VO ON and VO OFF profiles shall be created for each feeder for the entire program year using the lookup table for temperature range,<sup>43</sup> season,<sup>44</sup> day type (weekday/weekend),<sup>45</sup> and hour of the day.
- v. If VO is ON in a continuous basis throughout the year, previous year’s voltage data along with temperature, day type, and time of the day can be correlated in accordance to present year’s temperature data, day type, and time of the day to create the VO OFF profile. This correlation shall use the data created from the most representative feeder or feeders that have undergone testing.

---

<sup>40</sup> Temperature bins are to the ceiling of the nearest 5°F interval.

<sup>41</sup> Seasons are defined as follows; Spring: March through May; Summer: June through August; Fall: September through November; and Winter: December through February.

<sup>42</sup> Weekdays are Monday to Friday and weekends are Saturday and Sunday.

<sup>43</sup> Temperature bins are to the ceiling of the nearest 5°F interval.

<sup>44</sup> Seasons are defined as follows; Spring: March through May; Summer: June through August; Fall: September through November; and Winter: December through February.

<sup>45</sup> Weekdays are Monday to Friday and weekends are Saturday and Sunday.

$CVR_f$  = conservation voltage reduction factor relating the change in voltage to a change in energy  
 = 0.80 (for both Ameren and ComEd territories)<sup>46</sup>

**SUMMER COINCIDENT PEAK DEMAND SAVINGS**

Peak demand savings should be calculated separately for each VO-enabled feeder. The savings reductions during VO On/Off testing shall not be a basis to reduce the estimated savings. The off periods from testing shall be treated as if they were on during the evaluation period.

$$\Delta kW = kW_{BASE} * \Delta V_{PEAK} * CVR_{f,PEAK}$$

Where:

$kW_{BASE}$  = Baseline kW usage on the feeder during the peak period, defined as 1:00-5:00 pm CDT on non-holiday weekdays from June 1 to August 31.

For Ameren territory, this will be calculated as the average demand in the peak hour for each feeder over the 2014-2016 timeframe, adjusted by a calibration factor that describes the relationship between demand in the peak hour and average demand over the peak period (defined as 1:00-5:00 pm CDT on non-holiday weekdays from June 1 to August 31). This calibration factor will be calculated based on a sample of feeders for which 2014-2016 data is available.

For ComEd territory, this will be calculated in the same manner as  $kWh_{BASE}$  for energy savings but with the intent of estimating the baseline just for the peak period as opposed to for the entire year.

$\Delta V_{Peak}$  = Percentage voltage reduction on the feeder caused by VO during the peak period, defined as 1:00 – 5:00 pm CDT on non-holiday weekdays from June 1 to August 31.

For Ameren territory, this will be calculated in the same manner as  $\Delta V$  for energy savings but with the intent of estimating  $\Delta V$  just for the peak period as opposed to for the entire year.

For ComEd territory, this will be calculated in the same manner as  $\Delta V$  for energy savings but with the intent of estimating  $\Delta V$  just for the peak period as opposed to for the entire year.

$CVR_{f,PEAK}$  = conservation voltage reduction factor relating the change in voltage to a change in energy specifically for the peak period, defined as 1:00 – 5:00 pm CDT on non-holiday weekdays from June 1 to August 31

For Ameren territory, 0.68.<sup>47</sup>

For ComEd territory, 1.02.<sup>48</sup>

**EXCLUDABLE AND NOT-EXCLUDABLE EVENTS IN CALCULATING ELECTRIC SAVINGS**

Both Ameren and ComEd have established a set of excludable (where VO is off, but savings can be claimed as if VO is on) and not-excludable (where VO is off, and savings cannot be claimed) events. These events can be accounted for either by: 1) determining the percentage of time non-excludable events occur and de-rating the savings by this percentage (ComEd’s approach), or 2) removing the excludable events from the dataset used to calculate savings (Ameren’s approach).

<sup>46</sup> Guidehouse. 2020. *Supporting Documentation for Voltage Optimization TRM Measure*. <Add hyperlink when available>

<sup>47</sup> Ibid.

<sup>48</sup> Ibid.

Below are tables of events each utility has established as excludable and non-excludable. Changes or additions can be made to these tables with the consensus of the utilities, the independent evaluator, and ICC staff (none of whose consensus shall not be unreasonably withheld).

**Table 1. Ameren Excludable and Non-Excludable VO Events**

Event	Description	Reason/Explanation	Category
Feeder Outage	Anytime the majority of a feeder is out due to any reason.	Feeder outages are typically not predictable or planned and are outside of Ameren’s control. They are an anomaly and are not certain to occur on the same feeder in subsequent years.	Excludable
Repair / Maintenance	Repair or maintenance work is performed on a VO feeder causing VO to be disabled.	Repair and maintenance of Ameren’s system is an operational necessity to provide customers with safe and reliable electric service. These events are not certain to occur on the same feeder in subsequent years.	Excludable
Switching	Dispatch disables VO on the feeder for any necessary switching event.	Ameren will perform switching for storms, outages, repair, maintenance, safety, and work to support new customer growth. These events are not certain to occur on the same feeder in subsequent years.	Excludable
Technology	A failure of the Information and/or Communication Technology which results in "all" VO feeders being disabled simultaneously due to events outside of Ameren’s control.	VO is dependent upon third party infrastructure that Ameren has no control over. Examples include the loss of the cellular communications network (AT&T and Verizon), the failure of the VO Software provided by the outside vendor, or a Cyber event. Events of this nature are an anomaly and are not certain to occur year after year. This event is not predictable or planned and is outside of Ameren’s control.	Excludable
Worldwide Pandemic / Orders by Civil Authorities	Repairs and maintenance may take longer due to limited crew availability or other restrictions/priorities. Example: COVID-19	Due to restrictions, repairs and maintenance may take longer. This reasonable delay is outside the control of Ameren.	Excludable
Disaster Recovery (DR) Testing	Ameren periodically performs Disaster Recovery testing on systems (AMI, ADMS, VO, etc.) which could result in VO disabling. Typically all VO feeders would be affected during DR testing.	Disaster Recovery is necessary and critical to ensure that Ameren can operate safely and effectively during an unforeseen event.	Not-Excludable
Server patching/issues	Anytime servers go down or patching takes place and the VO system does not come back online due to servers not rebooting correctly.	Events of this nature are unavoidable, but should be addressed by Ameren in a timely fashion. This should result in negligible impacts to energy savings.	Not-Excludable

Event	Description	Reason/Explanation	Category
Configuration Changes	Anytime VO is disabled for making updates to the Orion, go-live testing, or to make changes on the system resulting in shutting down services.	Events of this nature are unavoidable, but should be addressed by Ameren in a timely fashion. This should result in negligible impacts to energy savings.	Not-Excludable
VO field hardware failures	The loss or failure of a voltage regulator control, LTC control, or switched capacitor control on a feeder.	Events of this nature are unavoidable, but should be addressed by Ameren in a timely fashion. This should result in negligible impacts to energy savings.	Not-Excludable
Loss of communications	Anytime a device has a communications failure that would result in VO disabling. This event does not include 3 <sup>rd</sup> party cellular communications network (AT&T and Verizon) failures.	Events of this nature are unavoidable, but should be addressed by Ameren in a timely fashion. This should result in negligible impacts to energy savings.	Not-Excludable

**Table 2. ComEd Excludable and Non-Excludable VO Events**

Event	Description	Reason/Explanation	Category
System Operational Requirements	OCC takes control and disables VO due to station/feeder out of configuration, major alarm, repair/maintenance or switching events.	Feeder outages are typically not predictable or planned and are outside of ComEd control. ComEd will take necessary steps to ensure the reliability and safety of the system during storms and outages, maintenance, and work to support new customer growth. These events are not certain to occur on the same feeder in subsequent years.	Excludable
Loss of communication	Any unplanned interruption to the communication network.	Natural causes or unplanned repair due to equipment failure occasionally disrupting communication network.	Excludable
VO Control System	System component failure requires vendor upgrade or revision.	The failure of the VO Software provided by the outside vendor (OSI), or a Cyber event. Events of this nature are an anomaly and are not certain to occur year after year. This event is not predictable or planned and is outside of ComEd’s control.	Excludable
VO On/Off Cycling Schedule	Supervision over the transitional states from on to off, and vice versa.	When adding or commissioning substations or feeders to the VO Control system.	Excludable
Customer Maintenance	VO is disabled to investigate power quality issues.	Possible VO deactivation may be required to facilitate certain investigation requirements.	Not-Excludable
Worldwide Pandemic / Orders by Civil Authorities	Repairs and maintenance may take longer due to limited crew availability or other restrictions and priorities. Example: COVID-19	Due to restrictions, repairs and maintenance may take longer. This reasonable delay is outside the control of ComEd.	Excludable

Event	Description	Reason/Explanation	Category
VO Control System	Anytime VO system fails to operate due to model error in VO software, or inappropriate manual settings (human error).	Events of this nature should be addressed by ComEd in a timely manner, resulting in negligible impacts to energy savings.	Not-Excludable
Loss of communication	Any planned system upgrade that interrupts communication.	Planned system patching or upgrades interfere with the communication network and disable VO. This should be addressed by ComEd in a timely manner, resulting in negligible impacts to energy savings.	Not-Excludable
Equipment	Equipment failure that results in VO feeders being disabled (MJ5/DCIAB).	The equipment failure should be addressed by ComEd in a timely manner. This should result in negligible impacts to energy savings.	Not-Excludable
Server patching/ issues	Anytime servers would go down or if patching took place and VO system did not come back online due to servers not rebooting correctly.	Events of this nature are unavoidable but should be addressed by ComEd in a timely manner. This should result in negligible impacts to energy savings.	Not-Excludable

**NATURAL GAS SAVINGS**

N/A

**WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION**

VO may provide non-monetized energy benefits in the form of improved ability to manage the grid “downstream” of the substation. This could result in improved reliability, lower spending on other grid improvements, or both. Further research is needed to understand the scope and impact of these potential benefits. There are no water savings or non-energy impacts from VO.

**DEEMED O&M COST ADJUSTMENT CALCULATION**

There are annual O&M costs incurred by the utility as a result of implementation of VO. Cost-effectiveness analysis should include estimates of annual O&M costs over the 15-year life of the VO investment, discounted to present value for the year in which the VO investment is being analyzed. O&M cost estimates should include (a) labor and equipment costs to maintain the system and (b) third-party software costs.

**MEASURE CODE: CC-SYS-VOPT-V01-210101**

**REVIEW DEADLINE: 1/1/2023**

Consistent with the definition of Review Deadline in TRM Volume 1 (Overview), the Voltage Optimization working group collectively acknowledges that this date does not represent a commitment or obligation to revise TRM content by this date. Rather, it serves as a pledge to reconvene as a working group prior to the deadline date to discuss and review the TRM as part of ongoing efforts to ensure it performs as reliably as possible.

# **2021 Illinois Statewide Technical Reference Manual for Energy Efficiency Version 9.0**

## **Attachment A**

### **Illinois Statewide Net-to-Gross Methodologies**

#### **Effective for Evaluation**

All NTG data collection and analysis activities for the program types covered by this document shall conform to the NTG methods set forth herein.

## Attachment A: Illinois Statewide Net-to-Gross Methodologies

### 1 Policy Context for this Information

The Illinois Evaluation Teams (Cadmus Group, Itron, Navigant Consulting, Opinion Dynamics, Ridge & Associates) are working with the Illinois Stakeholder Advisory Group (SAG) to create an Illinois Statewide Net-to-Gross (NTG) Methodologies document (IL-NTG Methods). The IL-NTG Methods document is included as an attachment to the Illinois Statewide Technical Reference Manual for Energy Efficiency (IL-TRM). Through five different dockets, the Illinois Commerce Commission (ICC) has directed the Evaluation Teams to compile and formalize standard NTG methods for use in Illinois energy efficiency (EE) evaluation, measurement, and verification (EM&V) work. The ICC EE dockets are shown in the following table.

**Table 1-1. ICC Energy Efficiency Dockets**

ICC Order Docket No. and Date	Program Administrator	NTG Discussion – Order Pages	ICC Link
<b>13-0495 (1/28/14)</b>	Commonwealth Edison Company (ComEd)	129-130	<a href="http://www.icc.illinois.gov/downloads/public/edocket/367591.pdf">http://www.icc.illinois.gov/downloads/public/edocket/367591.pdf</a>
<b>13-0498 (1/28/14)</b>	Ameren Illinois Company (Ameren)	167, 171	<a href="http://www.icc.illinois.gov/downloads/public/edocket/367603.pdf">http://www.icc.illinois.gov/downloads/public/edocket/367603.pdf</a>
<b>13-0499 (1/28/14)</b>	Illinois Department of Commerce & Economic Opportunity (Department of Commerce)	20, 23, 49	<a href="http://www.icc.illinois.gov/downloads/public/edocket/367581.pdf">http://www.icc.illinois.gov/downloads/public/edocket/367581.pdf</a>
<b>13-0549 (5/20/14)</b>	Nicor Gas Company (Nicor)	41-42, 78	<a href="http://www.icc.illinois.gov/downloads/public/edocket/378494.pdf">http://www.icc.illinois.gov/downloads/public/edocket/378494.pdf</a>
<b>13-0550 (5/20/14)</b>	North Shore Gas Company (North Shore Gas) and The Peoples Gas Light and Coke Company (Peoples Gas) (collectively, PG&NSG)	54-55, 66	<a href="http://www.icc.illinois.gov/downloads/public/edocket/378495.pdf">http://www.icc.illinois.gov/downloads/public/edocket/378495.pdf</a>

To provide clarity to the ICC directives, the relevant section on IL-NTG Methods is shown in its entirety from the Nicor Gas Order (Docket No. 13-0549). The Nicor Gas Order provides the most detail on the ICC NTG directive in comparison to the other EE orders. The Nicor language is as follows:

The Commission believes that Staff’s recommendations concerning Commission adoption of consistent statewide net-to-gross methodologies (“IL-NTG Methods”) for use by the evaluators are reasonable and will aid in future evaluation of the energy efficiency programs. To help ensure the independence of the evaluators, to improve efficiency in the evaluation process, and to ensure programs across the state as delivered by the various Program Administrators can be meaningfully and consistently evaluated, the Commission hereby adopts Staff’s recommendation that consistent IL-NTG Methods be established for use in the evaluations of comparable energy efficiency programs offered by different Illinois Program Administrators. The Commission notes that Section 8-104(k) of the Act encourages statewide coordination and consistency between the gas and electric energy efficiency programs and Staff’s proposal would help ensure consistency in the evaluation of program performance. The Commission notes that this directive is not to create entirely “new” NTG methodologies for every energy efficiency program, but rather to assess NTG methodologies and survey instruments that have been used to evaluate energy efficiency programs offered in Illinois, and to compile the most justifiable and well-vetted methodologies (or potentially combine certain components from the existing approaches to better represent the most justifiable and well-vetted method consistent with best practices) in an attachment to the Updated IL-TRM that would get submitted to the Commission for approval. The Commission notes that the IL-NTG Methods will be

flexible and adaptable to multiple program designs and budgets and tailored to appropriately assess the specifics of each of the Program Administrators' energy efficiency programs, consistent with standard NTG methodologies adopted in other states that were filed in this proceeding. The Commission agrees with Staff that in the interest of efficiency, the current program evaluators should take the lead in compiling and formalizing standard methodologies for NTG in Illinois taking into consideration SAG input. Because the existing Plan 1 evaluators are under contract with the Company for the evaluation of the program year three energy efficiency programs, it is appropriate for these existing evaluators to work on and complete the compilation of the IL-NTG Methods over the next year. The Commission recognizes that each year considerable time may be spent vetting NTG methodologies for each program evaluation separately for each utility under the existing evaluation plan review practices; adoption of IL-NTG Methods would save on these limited evaluation resources by having a common reference document for the evaluators to use in estimating net savings for Illinois.

The Commission hereby directs the Company to require its evaluators to collaborate with the other Illinois evaluators and the SAG to use best efforts to reach consensus on the approaches used in assessing NTG in particular markets for both residential and non-residential energy efficiency programs in a manner consistent with the direction described herein. (Pages 41-42)

- (16) Northern Illinois Gas Company shall require its evaluators to collaborate with the other Illinois evaluators and the SAG to reach consensus on the most defensible and well-vetted methodologies for assessing net-to-gross ratios in particular markets for both residential and non-residential energy efficiency programs in a manner consistent with the direction provided herein.
- (17) ICC Staff shall file the agreed-upon consensus statewide NTG methodologies with the Commission as an attachment to the Updated IL-TRM, and if consensus is not reached on a certain component of the statewide NTG methodologies, that particular non-consensus component should be submitted in a manner consistent with the approach used for non-consensus IL-TRM Updates. (Page 78)

## 1.2 Programs Currently Covered in this Document

This document is intended to cover the majority of residential and non-residential programs offered in Illinois.<sup>49</sup> Programs covered as of the writing of this document are listed in tables at the beginning of Section 3: Commercial, Industrial, and Public Sector Protocols and Section 4: Residential and Low Income Sector Protocols. If the design of a given program changes significantly, then it may mean that the NTG protocol listed for that program in this document is no longer appropriate. If that happens, the evaluator should follow the procedures outlined below under Section 1.4: Diverging from the IL-NTG Methods.

This document will be updated over time to incorporate new programs and to reflect recommended changes to existing methodologies. All NTG data collection and analysis activities for the program types covered by this document shall conform to the NTG methods set forth herein.

## 1.3 Updating the IL-NTG Methods

This attachment is part of the IL-TRM and follows the timeline for updating of the IL-TRM, as specified in the Illinois Energy Efficiency Policy Manual. In general, the following will take place:

- Updates will generally occur annually.
- Any changes to the IL-NTG Methods document will be circulated to the full SAG, and SAG participants will have a ten business day review process.
- Updates may be discussed within the SAG throughout the year but will be completed annually.
- Annually, the ICC Staff will submit a Staff Report (with the consensus Updated IL-TRM attached) to the Commission with a request for expedited review and approval.

---

<sup>49</sup> Evaluation reports on those programs can be found at <http://www.ilsag.info/evaluation-documents.html>.



- Updated NTG methods go into effect upon SAG approval, which may be before the annual TRM update or before the effective date of the updated TRM.

#### 1.4 Diverging from the IL-NTG Methods

The NTG methods for the programs outlined in this document are partially binding. The criteria for deviating from the IL-NTG Methods document are set forth below. In all cases, the evaluators (or any interested stakeholder) submits the proposed deviation to the full SAG for a ten business day SAG review and comment period. In the event of an objection by a SAG participant, efforts may be made to see if consensus can be reached on the proposed deviation in a subsequent monthly SAG meeting. In this case, a final opportunity for SAG review and comment to the proposed deviation will be provided following the SAG meeting.

Evaluators may modify the approaches described in this document if the following three conditions have been satisfied:

1. Evaluators must explicate within the annual evaluation research plan (or another document) how specific items in the proposed modified NTG method will diverge from what is written in this document. Evaluators must justify why the divergence is appropriate.
2. Prior to the use of the modified NTG method for a particular program, evaluation teams must be in agreement on the use and execution of the modified NTG method.
3. Any objection from SAG participants regarding the proposed modified NTG method is resolved.

Evaluators may test alternative methods of estimating NTG for a particular program in addition to the NTG methods outlined in this document, if the following three conditions have been satisfied:

1. Evaluators must explicate within the annual evaluation research plan (or other document) the proposed alternative NTG method. Evaluators must explain why the proposed alternative NTG method might be superior to the NTG methods outlined in this document for the particular program. Evaluators must discuss the foundation for expecting that the proposed alternative NTG method is likely to produce meaningful results.
2. Prior to the use of the alternative NTG method for a particular program, evaluation teams must be in agreement on the key details of the approach for implementing the alternative NTG method.
3. Any objection from SAG participants regarding the proposed alternative NTG method gets resolved.

When performing alternative NTG methods for a particular program, the choice of methods may vary across the state. For example, if ComEd's evaluator chooses to test Methods 1 and 2 for a particular program, Ameren's and Department of Commerce's evaluators do not also have to perform Methods 1 and 2 for a similar program.

Several sections of this attachment provide example questions that can be used to collect the data required in the NTG algorithms. Adjustments to refine specific question wording, e.g., to better reflect the design of the evaluated program, do not constitute divergence from the IL-NTG Methods. Evaluators are not required to use the exact wording provided in the example questions.

#### 1.5 Procedure for Non-Consensus Items

Non-consensus items that arise during the development and updating of the IL-NTG Methods document will be handled in substantially the same way as non-consensus IL-TRM Updates are addressed. The approach to be used is as follows.

- Once the Illinois NTG Working Group<sup>50</sup> has progressed as far as they can on the methodology, and it has been found that there is non-consensus on a specific Net-to-Gross Methods topic or procedure, the

---

<sup>50</sup> The Illinois NTG Working Group consists primarily of the subset of Evaluators deliberating on NTG methodologies; however, any interested party may participate in the Illinois NTG Working Group.

Illinois NTG Working Group shall submit to the ICC Staff and the SAG’s Technical Advisory Committee (TAC) a “Comparison Exhibit of Non-Consensus Net-to-Gross Methods topics/procedures” within two weeks after the Illinois NTG Working Group has failed to reach consensus. The TAC will then deliberate on the issue with a goal of reaching consensus.

- If consensus does not emerge in the TAC regarding a particular Net-to-Gross Methods topic or procedure, the “Comparison Exhibit of Non-Consensus NTG Methods topics/procedures” is then sent to the full SAG for their deliberations and input. The SAG provides a forum where experts on all sides of the contested issue can present their expert opinions in an effort to inform parties of the contested issue and to also facilitate consensus.
- To the extent a consensus among Program Administrators and non-financially interested stakeholders cannot be reached regarding issues related to specific Net-to-Gross Methods topic or procedure updates, the IL-TRM Administrator shall have the authority to use its best judgment to propose a resolution of the issue and include such in the updated IL-TRM that gets submitted to the ICC for approval. For transparency and informational purposes, the ICC Staff will document such dispute and include a link to a “Comparison Exhibit of Non-Consensus Net-to-Gross Methods topics/procedures” developed by the Illinois NTG Working Group and the IL-TRM Administrator in the Staff Report submitted to the Commission. The “Comparison Exhibit of Non-Consensus Net-to-Gross Methods topics/procedures” will document, with input from the parties, the various parties’ positions concerning a non-consensus Net-to-Gross Methods topic or procedure update as well as the IL-TRM Administrator’s rationale for its decision to resolve the issue.
- Nothing in this language shall preclude Program Administrators and stakeholders from challenging the IL-TRM Administrator’s proposed resolution by petitioning the Commission. Until the Commission resolves the petition, the Commission-approved Net-to-Gross Methods topic or procedure shall be the default pending the issuance of a Commission Order. The applicable date for the Commission-resolved Net-to-Gross Methods topic or procedure will be the latter of January 1 of the year the IL-TRM was designed to go into effect, or the first day of the next month following the Commission order. In the petition, the filing party should note all Program Administrators affected by the IL-TRM dispute, and request that the Commission join each affected Program Administrator to the docket.

## 2 Attribution in Energy Efficiency Programs in General

One of the most difficult aspects of evaluation, and not just within evaluation of energy efficiency programs, is attributing results to a program. Attribution provides credible evidence that there is a causal link between the program activities and the outcomes achieved by the program. Attribution research estimates the difference between the outcomes and those that would have occurred absent the program (i.e., the counterfactual). Put in research terms, evaluators must reject the null hypothesis of no causality through probabilistic statements (e.g., “strong evidence”; “high probability”). As such, it is important to realize that the concept of the counterfactual cannot be proven with certainty. So even though the NTG ratio is a single value, conceptually it is a probabilistic statement.<sup>51</sup> One of the main academics within evaluation stated that there is a “...total and inevitable absence of certain knowledge [arising] from the methods social scientists use” when assessing the counterfactual. (Shadish, et al., 2002) This statement is not about poor methods, but about the counterfactual itself. Because programs work with people and are usually not a laboratory experiment that can be replicated over and over<sup>52</sup> to find out what actions people would have taken absent an intervention, one would need a time machine to take people back in time and not provide the program. Since time machines do not exist, evaluators have developed methods that approximate the counterfactual to the best of their ability.

### 2.1 Definitions

For energy efficiency programs, evaluators differentiate between savings at a “gross” and “net” level as described below in the short set of relevant definitions. These definitions are not all encompassing or meant to restrict evaluation in any way, but to provide context before additional detail is provided in later sections. Research to determine attribution occurs to allow for a better understanding of the net level of savings.

**Table 2-1. Definitions**

Concept	Term	Definition
<b>Consumers</b>	Nonparticipant	Any consumer who was eligible but did not participate in the subject efficiency program, in a given program year.
	Participant	A consumer who received a service offered through the subject efficiency program, in a given program year; also called program participant. The term “service” is used in this definition to suggest that the service can be a wide variety of inducements, including financial rebates, technical assistance, product installations, training, energy efficiency information, or other services, items, or conditions. Each evaluation plan should define “participant” as it applies to the specific evaluation.
<b>Gross Impacts</b>	Gross Impacts	The change in energy consumption and/or demand that results directly from program-related actions taken by participants in an energy efficiency program, regardless of why they participated.
<b>Attribution of Impacts</b>	Net Impacts	The change in energy consumption and/or demand that is attributable to a particular energy efficiency program. This change in energy use and/or demand may include, implicitly or explicitly, consideration of factors such as free ridership, participant and nonparticipant spillover, and induced market effects. These factors may be considered in how a baseline is defined (e.g., common practice) and/or in adjustments to gross savings values.
	Net-to-Gross Ratio	A factor representing net program savings divided by gross program savings that is applied to gross program impacts to convert them into net program impacts. The factor itself may be made up of a variety of

<sup>51</sup> A probabilistic statement is not the same as the confidence and precision information calculated based on sampling theory.

<sup>52</sup> However, a small number of program designs do lend themselves to experimental or quasi-experimental designs that allow for regression analysis of net impacts.

Concept	Term	Definition
		factors that create differences between gross and net savings, commonly including free riders and spillover. The factor can be estimated and applied separately to either energy or demand savings. Note that the net-to-gross ratio (NTGR) = ((1-Free Ridership) + Participant Spillover + Nonparticipant Spillover).
	Core NTGR	1-Free Ridership
	Free Rider	A program participant who would have implemented the program’s measures or practices in the absence of the program. Free riders can be: (1) total, in which the participant’s activity would have completely replicated the program measure; (2) partial, in which the participant’s activity would have partially replicated the program measure; or (3) deferred, in which the participant’s activity would have partially or completely replicated the program measure, but at a future time.
	Spillover	<p>Reductions in energy consumption and/or demand caused by the presence of an energy efficiency program. There can be participant and/or nonparticipant spillover.</p> <p><i>Participant spillover</i> (PSO) is the additional energy savings that occur as a result of the program’s influence when a program participant independently installs incremental energy efficiency measures or applies energy-saving practices after having participated in the energy efficiency program. Evaluated savings associated with Program Administrator Training programs will also be considered Participant spillover. There are several general categories of participant spillover:</p> <ul style="list-style-type: none"> <li>• <i>Inside spillover</i> (ISO): Occurs when program participants implement additional program-induced energy efficiency measures at the program project site.</li> <li>• <i>Outside spillover</i> (OSO): Occurs when program participants implement program-induced efficiency measures at other sites within the Program Administrator’s service territory at which program project measures were not implemented.</li> <li>• <i>Like spillover</i>: Occurs when program participants implement program-induced efficiency measures of the same type as those implemented through the program. Like spillover can occur at the program project sites (ISO) or at other sites within the Program Administrator’s service territory (OSO).</li> <li>• <i>Unlike spillover</i>: Occurs when program participants implement program-induced efficiency measures of a different type from those implemented through the program. Unlike spillover can occur at the program project sites (ISO) or at other sites within the Program Administrator’s service territory (OSO).</li> </ul> <p><i>Nonparticipant spillover</i> (NPSO) refers to energy savings that occur when a program nonparticipant installs energy efficiency measures or applies energy savings practices as a result of a program’s influence.</p>
Markets	Market	The commercial activity (e.g., manufacturing, distributing, buying, and selling) associated with products and services that affect energy use.
	Market Effects	A change in the structure of a market or the behavior of participants in a market that is reflective of an increase (or decrease) in the

Concept	Term	Definition
		adoption of energy efficient products, services, or practices and is causally related to market interventions (e.g., programs). Examples of market effects include increased levels of awareness of energy-efficient technologies among customers and suppliers, increased availability of energy-efficient technologies through retail channels, reduced prices for energy-efficient models, build-out of energy-efficient model lines, and—the end goal— increased market shares for energy-efficient goods, services, and design practices.
	Market Assessment	An analysis that provides an assessment of how and how well a specific market or market segment is functioning with respect to the definition of well-functioning markets or with respect to other specific policy objectives. A market assessment generally includes a characterization or description of the specific market or market segments, including a description of the types and number of buyers and sellers in the market, the key factors that influence the market, the type and number of transactions that occur on an annual basis, and the extent to which market participants consider energy efficiency an important part of these transactions. This analysis may also include an assessment of whether a market has been sufficiently transformed to justify a reduction or elimination of specific program interventions (or whether continued or even increased intervention is necessary). Market assessment can be blended with strategic planning analysis to produce recommended program designs or budgets. One particular kind of market assessment effort is a baseline study, or the characterization of a market before the commencement of a specific intervention in the market for the purpose of guiding the intervention and/or assessing its effectiveness later.

Sources: State and Local Energy Efficiency Action Network. 2012. Energy Efficiency Program Impact Evaluation Guide. Prepared by Steven R. Schiller, Schiller Consulting, Inc., [www.seeaction.energy.gov](http://www.seeaction.energy.gov); Violette and Rathbun 2014. The Uniform Methods Project: Methods for Determining Energy Efficiency Savings for Specific Measures, Chapter 23: Estimating Net Savings: Common Practices, <http://www.nrel.gov/docs/fy17osti/68578.pdf>.

## 2.2 Free Ridership-Specific Issues

### 2.2.1 Survey Design

Free ridership questions, especially questions about the counterfactual, can be challenging to answer and may confuse respondents. To address these challenges, evaluators may use the following survey design strategies:

- Warm up questions
- Clarification of key terms

#### Warm up Questions

Warm up questions preface the counterfactual questions to remind the respondent of their state of mind when they decided on the efficient option. Examples of warm up questions are as follows:

1. How did you first learn about the energy efficient option of this [MEASURE]?
2. How did you first learn about the following features of this energy efficient [MEASURE]:
  - A. The potential to save energy and lower your utility bill?
  - B. The environmental benefits?
  - C. The potential to reduce maintenance costs?
  - D. The home comfort benefits?
  - E. The price difference between this energy efficient [MEASURE] and one of standard efficiency?

Responses to warm up questions are not to be used to calculate free ridership. They are intended to improve the quality of responses to free ridership questions by reminding the respondent of their process to choose the energy efficient option.

#### Clarification of Efficiency Terms

To highlight that free ridership questions focus on the process of choosing an efficient option over one of standard efficiency, evaluators may clarify the terms used to describe the options before asking the questions. For example:

“Next we will ask you about your decision to purchase the energy efficient [measure] instead of one of standard efficiency. By “energy efficient” we mean the equipment performs just as well or better than equipment of standard efficiency, but the energy efficient equipment uses less energy to do so. Energy efficient equipment typically costs more than standard models, but they cost less to operate and often cost less to maintain than standard models do.”

Prefacing counterfactual questions with clarifications of efficiency terms may highlight for the respondent that the questions center on choosing the efficient option – not on the need to replace the existing equipment (with a model of any efficiency).

### 2.2.2 Supplementing Self-Report with Historical Tracing

For programs with projects that are large, complex, involve multiple decision-makers, and are the result of many decisions made over the course of the project (for example, custom and new construction programs), evaluators may review project documentation to supplement their analysis of self-report survey results. Historical tracing, which involves reconstructing the events that led to the outcome of interest, can support logic to enhance the validity of the free ridership estimation from self-report survey results<sup>53</sup>. By considering additional qualitative and quantitative information, such as project files, documented communication, as well as open-ended survey responses, evaluators may better understand the multiple sources of program attribution and the weight of various decision makers for complex projects. In these instances, evaluators may include a historical tracing approach to add consideration of the multiple decision maker perspectives. Because the process of gathering the appropriate documentation from program teams, implementers, and customers can be burdensome on all parties involved, evaluators should prioritize projects within a given program that would most affect the confidence of the savings-weighted NTG estimate

### 2.3 Spillover-Specific Issues

Some issues related to spillover are applicable for both residential and non-residential programs and are discussed in this section.

Spillover is generally categorized into two broad categories – participant spillover and nonparticipant spillover (see Table 2-1). These protocols include two general methods of assessing spillover, one through end-user (or participant/nonparticipant) research and the other through trade ally research. Estimates of participant and nonparticipant research are mutually exclusive, as long as only one of these two general methods is used for a given evaluation period. For example, there is no danger of double-counting spillover if an evaluation includes end-user research with both participants and nonparticipants. Similarly, there is no danger of double-counting spillover if an evaluation includes research with both active and inactive trade allies (see definitions in Section 5.2). However, once end-user research is combined with trade ally research, there is a potential for overlap in the resulting spillover estimates, and care must be taken to avoid double-counting.



Figure 2-1 provides a visual depiction of how the four methods (or “perspectives”) for estimating spillover included in these protocols (participant and nonparticipant self-report, Sections 3.2 and 4.1; and active and inactive trade ally spillover, Section 5.2) can be used to assess both participant (red) and nonparticipant spillover (green). This figure illustrates that (a) different spillover methods can overlap in the spillover they cover, leading to potential double-counting, and (b) some spillover may not be measured by these methods (as represented by the four

---

<sup>53</sup> Violette and Rathbun, *Estimating Net Savings*, 46-48.

corners in the diagram).

**Figure 2-1. Example - Types of Spillover and Methods for Assessment**

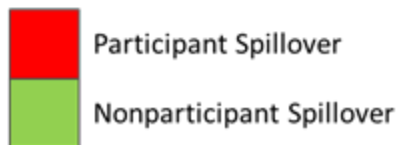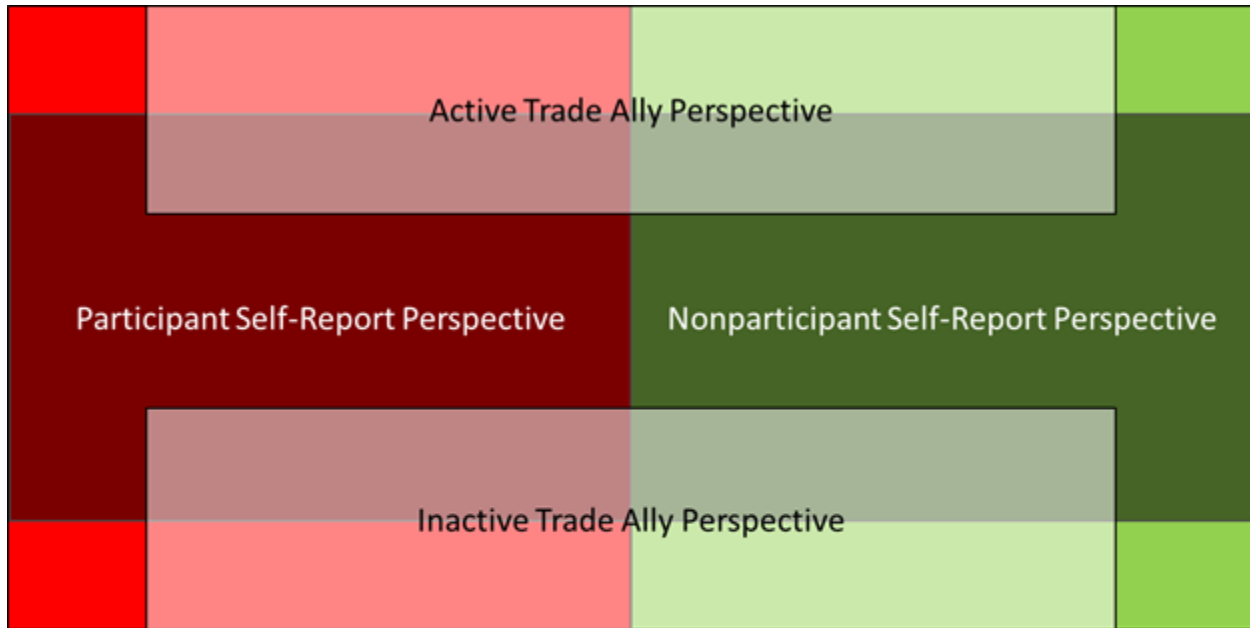

### 2.3.1 Measure Costs

In order to facilitate analysis of program Total Resource Cost (TRC), estimates of the total incremental measure cost (IMC) at the program level must be developed. IMC values are available for most IL-TRM measures and can be summed to the program level. However, the IMC values for spillover measures could also be estimated and added to this total. The problem is that IMC values for spillover measures can be difficult to estimate. When the magnitude of the savings justifies the effort to estimate the total IMC for spillover measures, the following approaches should be used.

- In cases where the evaluator believes the spillover measure incremental costs are not materially different from the rebated measure incremental costs, the evaluator may multiply the IMC for the rebated measure by the spillover rate to derive the IMC for the spillover measure.
- In cases where the evaluator believes the spillover measure incremental costs are materially different from the installed measure incremental costs (e.g., installation of measures that have no efficiency levels), the evaluator should use the estimated incremental project costs as the IMC for the spillover measure.

Normally, the sample-based estimates of IMCs for spillover measures should be extrapolated to the program level using sample weights. Then the total IMCs for rebated measures and the total IMCs for spillover measures should be summed and used in the TRC calculation.

For measures characterized by the IL-TRM, measure effective useful life (EUL) estimates should be based on the IL-TRM. For measures not characterized by the IL-TRM, evaluator can use either the EUL for similar measures or best professional judgment. In either case, the evaluator must provide the rationale for their choices.

### 3 Commercial, Industrial, and Public Sector Protocols

The table below lists Illinois non-residential programs and the free ridership protocol applicable to each program.<sup>54</sup> If the design of a given program changes significantly, then it may mean that the NTG protocol listed for that program in this document is no longer appropriate. If that happens, the evaluator should follow the procedures outlined in Section 1.4: Diverging from the IL-NTG Methods. Note that the Core Non-Residential Spillover protocol described in Section 3.2 is generally applicable to most of these programs.

**Table 3-1. Commercial, Industrial, and Public Sector Programs**

<b>Program Administrator</b>	<b>Free Ridership Protocol</b>	<b>Program Name</b>
Ameren Illinois	3.1 Core Non-Residential Protocol	Standard Initiative – Core Program Custom Initiative Streetlighting Initiative Standard Initiative – Instant Incentives
	3.3 Small Business Protocol	Standard Initiative – Small Business Standard Initiative – Online Store
	3.5 Study-Based Protocol	Retro-Commissioning Initiative
ComEd	3.1 Core Non-Residential Protocol	Incentives (Standard, Custom) Business Instant Discounts
	3.3 Small Business Protocol	Small Business Air Care Plus Rural Small Business Kits
	3.4 C&I New Construction Protocol	C&I New Construction
	3.5 Study-Based Protocol	Incentives (Data Centers) Enhanced Building Optimization Program Industrial Systems Retrocommissioning Strategic Energy Management Operational Savings
	3.5 Study-Based Protocol or 5.3 Consumption Data Analysis Protocol	Power TakeOff
	5.3 Consumption Data Analysis Protocol	Business Energy Analyzer
	4.6 Multifamily Protocol	Public Housing Retrofits
	3.1 Core Non-Residential Protocol	LED Streetlighting
Nicor Gas	3.5 Study-Based Protocol	Strategic Energy Management
	3.3 Small Business Protocol	Small Business Program
	3.1 Core Non-Residential Protocol	Business Energy Efficiency Rebates
	3.1 Core Non-Residential Protocol	Business Custom Rebates
	3.4 C&I New Construction Protocol	Commercial and Industrial New Construction
	3.1 Core Non-Residential Protocol	Combined Heat and Power
	3.5 Study-Based Protocol	Retro Commissioning
Peoples Gas/ North Shore Gas	3.1 Core Non-Residential Protocol	C&I and PS Custom
	3.6 Technical Assistance Protocol	C&I and PS Direct Install and Assessment
	3.1 Core Non-Residential Protocol	C&I and PS Prescriptive
	3.3 Small Business Protocol	SB Custom SB Direct Install & Assessment

<sup>54</sup> The “Free Ridership Protocol Name” in the second column of the table refers to the numbered sections in this document, e.g., “3.3 Small Business Protocol.”



Program Administrator	Free Ridership Protocol	Program Name
		SB Partner Trade Ally SB Prescriptive
	3.4 C&I New Construction Protocol	C&I and PS New Construction (Joint)
	3.5 Study-Based Protocol	C&I and PS Gas Optimization MF Gas Optimization C&I and PS Retro-Commissioning (Joint)

### 3.1 Core Non-Residential Protocol

#### 3.1.1 Core Non-Residential Free Ridership Protocol

Key considerations and guidelines for estimation of free ridership under this Core Non-Residential Free Ridership (FR) protocol are listed below:

- Multiple Questions:** Evaluators will use program participant responses to multiple survey questions as inputs to the free ridership calculation algorithm. Evaluators will not use the response to a single question to establish a survey respondent as either a complete free rider or a complete non-free rider.
- Program and Non-Program Factors:** Evaluators will administer survey questions to obtain respondent ratings on a numeric scale of the impact, influence, or importance on the decision to implement energy efficiency measures or take energy efficiency actions. A series of questions will focus on factors that the evaluator determines are a function of the program. Such program factors may, for instance, include the availability of the program incentive, technical assistance from program staff, program staff recommendations, Program Administrator marketing materials, and an endorsement or recommendation by a Program Administrator, account manager or program partner staff. Evaluators will also administer a series of questions to obtain respondent ratings, on a numeric scale of the impact, influence, or importance on the decision to implement energy efficiency measures, of different factors that the evaluator determines are not a function of the program. Such non-program factors may include, for example, previous experience with the measure, standard business or industry practice, and organizational policy or guidelines.
- Vendor Recommendations:** Vendor recommendations may also be a program factor to the extent that such recommendations are a function of the program. Vendors include trade allies, contractors, distributors, suppliers, and other market actors involved in the selection and installation of program-incented equipment on behalf of the participant. The evaluator may administer survey questions to vendors to verify their involvement with participant projects and to obtain their ratings—on a numeric scale—of the impact, influence, or importance of the program on the decision to recommend the energy efficiency measures to the program participant.
- Consistency Checks:** Evaluators should administer survey questions as checks on the consistency of responses associated with a core free ridership assessment methodology. Evaluators may also reference available quantitative and qualitative data, including consistency check data, to perform documented modifications to individual free ridership estimates resulting from the application of a core free ridership assessment methodology.
- Quality Control Review:** For programs involving large, complex projects and decision-making, after all the survey data collection has been completed and preliminary NTGRs have been computed using the standard calculation procedures, a quality control review is completed. All quantitative and qualitative data is systematically and independently analyzed by a researcher who is familiar with the program, the individual site and the social science theory that underlies the decision maker survey instrument. They make an independent determination of whether the additional information justifies modifying the previously calculated NTGR score and present any recommended modifications and their rationale in a well-organized manner, along with specific references to the supporting data. Circumstances that may justify a revision of the previously calculated NTGR score include: (1) significant inconsistencies exist

between one of the scores that may lead to elimination of the score that is an outlier; (2) the emerging “story” from the qualitative data is in conflict with the quantitative data, thereby requiring a callback to the customer to resolve the inconsistency and a revision to the original scoring based on the new information; or (3) the entire set of results for an interview are inconsistent, the data are too disparate and would not be helped with a callback. In such cases, a recommendation is made to remove that sample point and replace it with a back-up point.

#### 3.1.1.1 Core Free Ridership Scoring Algorithm

The Core Non-Residential FR protocol combines three scores that test different ways of approaching free ridership: the Program Components FR Score, the Program Influence FR Score, and the No-Program FR Score. The three scores are combined to calculate the final free ridership value.

Two options for combining the three scores are shown graphically in Figure 3-1 and Figure 3-2. These two options use different specifications to account for the impact of the program on project timing (referred to as “deferred free ridership”; see also discussion in Section 3.1.1.1.4). Evaluators will calculate free ridership using both options and will select one option for purposes of calculating the annual incremental energy savings for comparing to the legislated goal.<sup>55</sup> To select the appropriate option for use, we recommend that evaluators examine the various components of the free ridership scores to understand the differences between the options and justify their choice. Evaluators may also choose to use Cronbach’s alpha to examine the internal consistency of the various options (but evaluators are not *required* to select the option with the highest Cronbach’s alpha if they have justification for a different choice). In addition, evaluators are also encouraged to conduct cognitive interviews to better understand how C&I respondents are able to answer the free ridership questions. Evaluators should note where respondents seem confused or did not seem to understand the line of questioning. As a result of the cognitive interview findings, evaluators may suggest changes to the wording or free ridership components for future TRMs. The Program Influence score, in particular, should be assessed.

Evaluators will submit participant survey and net savings analysis data to the Illinois NTG Working Group. The group will analyze these data for the purpose of further refining the protocol and potentially reducing the number of alternative algorithm input specifications.

---

<sup>55</sup> As defined in 220 ILCS 5/8-103 and 220 ILCS 5/8-104.

Figure 3-1. Core Free Ridership Algorithm 1


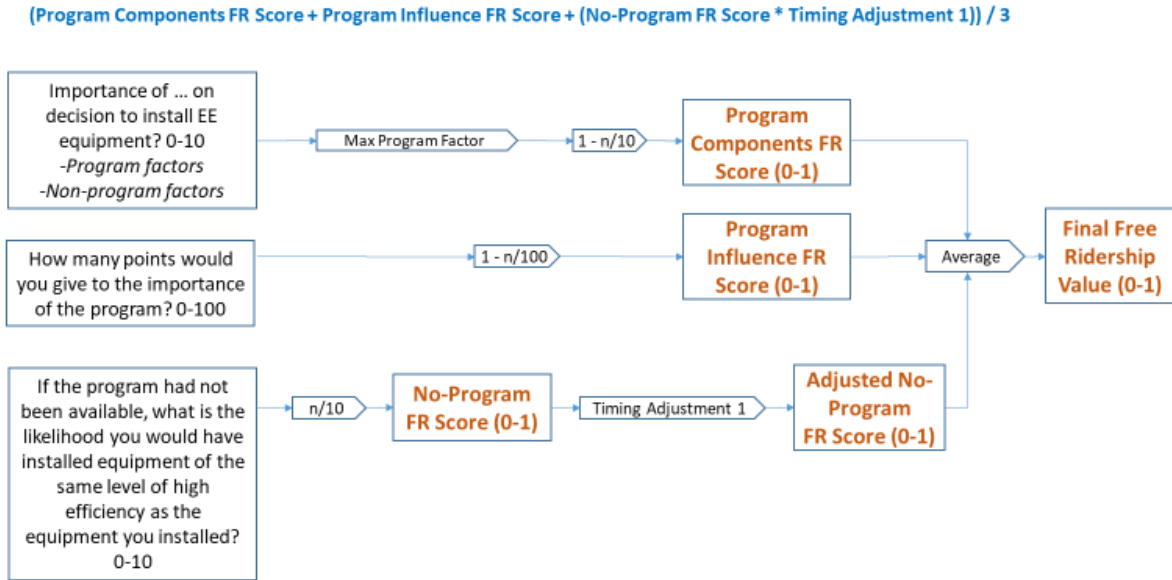


Figure 3-2. Core Free Ridership Algorithm 2

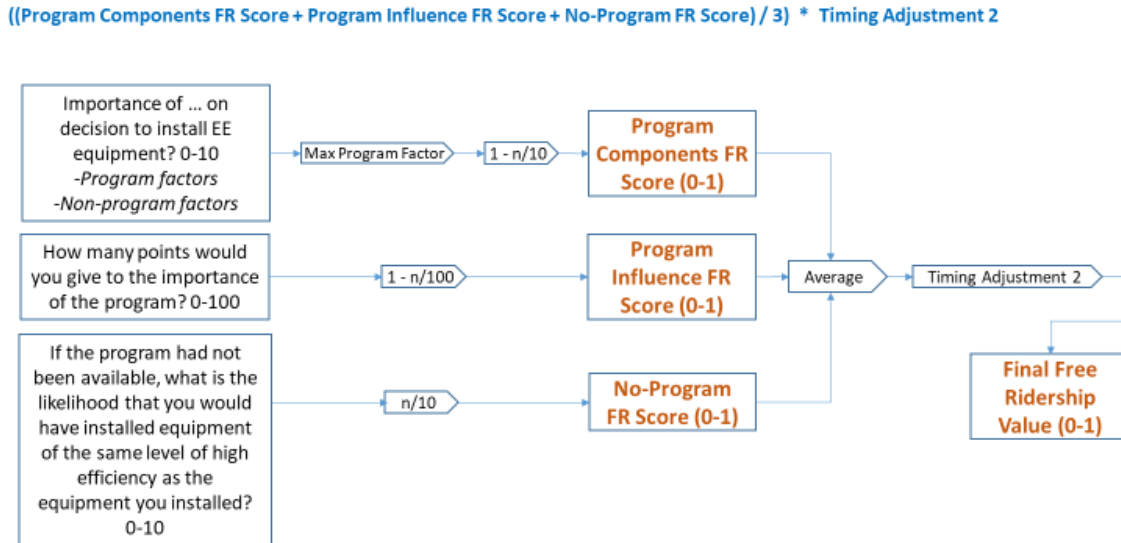

**3.1.1.1.1 Program Components FR Score**

Evaluators will administer survey questions to obtain participants’ rating of the importance of various factors on the decision to implement energy efficiency measures. The numeric scales shall range from 0 to 10, where 0 means “not at all important,” and 10 means “extremely important.” The various factors referenced in the survey will include

those that the evaluator determines are program factors and non-program factors that could potentially impact the participant decision making process. A participant rating shall be obtained for each relevant program and non-program factor.

Evaluators will calculate the “Program Components FR Score” for each survey respondent using the following equation:

$$\text{Program Components FR Score} = 1 - \left( \frac{[\text{Maximum Program Factor Rating}]}{10} \right).$$

These scores can range from 0 (no free ridership) to 1 (full free rider). Since the algorithm uses the numerical rating for the Program Component receiving the highest score, it is important that such scoring be accurate. To facilitate this, the scores feeding into the Program Components FR Score calculation can be enhanced by adjusting survey wording and adding consistency checks around specific program components to seek clarification on how they influenced decision making. For those program components receiving scores of 8, 9 or 10, additional questions can be included to determine why that specific score was given, and further, how that Program Component specifically influenced the participant’s decision to upgrade to energy efficient equipment.

Evaluation reports should list all factors considered program and non-program factors. Evaluators must document why factors were treated as program factors or non-program factors.

**3.1.1.1.2 Program Influence FR Score**

Evaluators will administer a survey question that asks respondents to quantify the importance (or impact) of the program on the decision to implement energy efficiency measures relative to the importance (or impact) of non-program factors. Respondents will be asked to allocate a total of 100 points to the program and to non-program factors. Unlike the factor ratings that go into the Program Components FR Score, this question asks respondents to explicitly make a trade-off between the program and non-program factors, i.e., it assesses the importance of the program *relative to* non-program factors.

The points allocated to the program by the participants are the “Program Points.” Evaluators will calculate the “Program Influence FR Score” as 1 - (Program Points/100). This score can range from 0 (no free ridership) to 1 (full free rider).

Before asking respondents to allocate the 100 points, it is important to remind them what is meant by “program” and “non-program factors.” Otherwise, they might inadvertently divide the points based on an incorrect understanding of the two concepts. The following wording is suggested for use prior to the 100 points question. While the evaluator can make changes to this wording, as needed, to reflect the details of the program, the evaluator must follow the TRM’s guidance around reading in program and non-program factors.

*Program factors include:*

[READ IN A MINIMUM OF TWO PROGRAM FACTORS, SELECTED BY CHOOSING THOSE THAT RECEIVED THE HIGHEST TWO SCORES AMONG ALL PROGRAM COMPONENTS IN THE PROGRAM COMPONENTS SECTION. THE EVALUATOR MAY CHOOSE TO READ IN ADDITIONAL FACTORS AT THEIR DISCRETION, ALSO CHOSEN BY SELECTING THOSE THAT RECEIVED THE NEXT HIGHEST SCORES IN THE PROGRAM COMPONENTS SECTION AMONG PROGRAM COMPONENTS. IF FACTORS ARE TIED IN SCORE, EVALUATORS MAY WISH TO READ IN ALL TIED FACTORS, OR RANDOMIZE SELECTION OF TWO OR MORE FACTORS.]

*Non-program factors include:*

[READ IN A MINIMUM OF TWO NON-PROGRAM FACTORS, SELECTED BY CHOOSING THOSE THAT RECEIVED THE HIGHEST TWO SCORES AMONG ALL NON-PROGRAM COMPONENTS IN THE PROGRAM COMPONENTS SECTION. THE EVALUATOR MAY CHOOSE TO READ IN ADDITIONAL FACTORS AT THEIR DISCRETION, ALSO CHOSEN BY SELECTING THOSE THAT RECEIVED THE NEXT HIGHEST SCORES IN THE PROGRAM COMPONENTS SECTION. IF FACTORS ARE TIED IN SCORE, EVALUATORS MAY WISH TO READ IN ALL TIED FACTORS, OR

RANDOMIZE SELECTION OF TWO OR MORE FACTORS.]

ONCE THESE PROGRAM AND NON-PROGRAM FACTORS ARE IDENTIFIED, THE EVALUATOR SHOULD READ BOTH LISTS TO THE RESPONDENT BEFORE ASKING THE 100-POINTS ALLOCATION QUESTION.

**3.1.1.1.3 No-Program FR Score**

Evaluators will administer a counterfactual likelihood survey question. This question will obtain respondent ratings on a 0 to 10-point numeric scale (where 0 means “not at all likely” and 10 means “extremely likely”) of the likelihood of the respondent, absent the program, to implement equipment of the same level of high efficiency as the unit they installed. Evaluators will calculate the “No-Program FR Score” as the numeric score of the likelihood of the respondent to implement specified energy efficiency measures in the absence of the program divided by 10. This score can range from 0 (no free ridership) to 1 (full free rider).

Note that under one of the two deferred free ridership specifications (see next subsection), a timing adjustment is applied to the “No-Program FR Score.” Under this specification, the resulting score is referred to as the “Adjusted No-Program FR Score.”

**3.1.1.1.4 Timing and Deferred Free Ridership**

Evaluators will ask about the likely timing of measure installation in the absence of the program in two different ways. This is referred to as the counterfactual timing question since the evaluators are asking the respondent to speculate on what might have happened within a particular timeframe.

The first question will present a series of date ranges (e.g., within one year, between 12 months and 2 years, etc.) and ask the respondent to pick one representing their best estimate of when the measure would have been implemented in the absence of the program. The free ridership algorithm uses the midpoint of each date range, referred to as “Number of Months Expedited” below. For respondents that report accelerated adoption due to the program, this variable can take on values from 6 to 48 months.

The second question will prompt the respondent to use a 0 to 10-point numeric scale to report the likelihood, in the absence of the program, of implementing the same measure within 12 months of when it was actually implemented. This is the “Likelihood of Implementing within One Year” in the formulas below.

Evaluators will use the Likelihood of Implementing within One Year and/or the Number of Months Expedited variables to calculate two alternative ways of accounting for deferred free ridership:

- 1) Calculate *Timing Adjustment 1* as equal to:

$$1 - (\text{Number of Months Expedited} - 6)/42$$

Timing Adjustment 1 is multiplied by the No-Program FR Score; it can range from 0 (full deferred free ridership) to 1 (no deferred free ridership). The application of Timing Adjustment 1 is shown in Figure 3-1.

- 2) Calculate *Timing Adjustment 2* as equal to:

$$1 - ((\text{Number of Months Expedited} - 6)/42) * ((10 - \text{Likelihood of Implementing within One Year})/10)$$

Timing Adjustment 2 is multiplied by the average of the Program Components FR Score, the Program Influence FR Score, and the No-Program FR Score; it can range from 0 (full deferred free ridership) to 1 (no deferred free ridership). The application of Timing Adjustment 2 is shown in Figure 3-2.

How these timing adjustments are accounted for in the calculation of the Final FR Value is described below in the subsection “3.1.1.2 Construction of Core Free Ridership Value.”

**3.1.1.1.5 Consistency Checks**

Respondents may be asked one or more questions to facilitate understanding and potentially reconcile apparently inconsistent responses. Some questions may be asked of all respondents; others may be asked when previous answers appear inconsistent. Evaluators should report on the amount of inconsistency encountered and, on the resolution, to inform future protocol revisions. Three consistency checks are outlined below.

### **Program Influence/Program Components Consistency Check**

A Program Influence/Program Components consistency check is triggered when the following conditions are met:

- 1) The number of Program Points (supporting calculation of the Program Influence FR Score) is greater than 70; and
- 2) No program factor is rated greater than 2.

A Program Influence/Program Components consistency check is also triggered by the following conditions being met:

- 1) The number of Program Points (supporting calculation of the Program Influence FR Score) is less than 30; and
- 2) At least one program factor is rated greater than 7. In this instance, the highest-rated program factor(s) with a rating of greater than 7 will be referenced in the consistency check question.

### **Program Components/No-Program Consistency Check**

A Program Components/No-Program consistency check is triggered when the following conditions are met:

- 1) The likelihood of installing , absent the program, equipment of the same level of high efficiency as the unit installed with the program (supporting calculation of the No-Program FR Score) is greater than 7; and
- 2) At least one program factor is rated greater than 7.

A Program Components/No-Program consistency check is also triggered when the following conditions are met:

- 1) The likelihood of installing equipment, absent the program, of the same level of high efficiency as the unit installed with the program (supporting calculation of the No-Program FR Score) is less than 3; and
- 2) No program factor is rated greater than 2.

### **Timing of Installation Decision/Level of Program Attribution Consistency Check**

The survey should contain a question to ask whether the respondent learned about the program after finalizing project specifications, including, where applicable, equipment efficiency level and number of units. The Timing of Installation Decision/Level of Program Attribution consistency check is triggered by the following conditions being met:

- 1) A respondent learned about the program after finalizing project specifications; and
- 2) Any of the following occur:
  - a) The number of Program Points (supporting calculation of the Program Influence FR Score) is greater than 70;
  - b) The likelihood of installing , absent the program, equipment of the same level of high efficiency as the unit installed with the program (supporting calculation of the No-Program FR Score) is less than 3; or
  - c) At least one program factor is rated greater than 7.

When the Timing of Installation Decision/Level of Program Attribution consistency check is administered, if the respondent rating of the importance of the vendor on the decision to implement the project is greater than 7, then an open-ended question will be triggered to obtain information regarding the role the vendor played in the participant decision to implement the project.

#### **3.1.1.2 Construction of Core Free Ridership Value**

This protocol designates two options of constructing the core free ridership value. Evaluators will calculate free ridership using both options and will select one option for purposes of calculating the annual incremental energy savings for comparing to the legislated goal. Evaluators will present the results of both estimates of free ridership in EM&V reporting.

Evaluators will calculate free ridership values in the following two ways:

- 1) Core FR Algorithm 1 = AVERAGE([Program Components FR Score], [Program Influence FR Score], [No-Program FR Score\*Timing Adjustment 1])
- 2) Core FR Algorithm 2 = AVERAGE([Program Components FR Score], [Program Influence FR Score], [No-Program FR Score]) \* Timing Adjustment 2

The two Core FR Algorithms listed above are graphically presented in Figure 3-1 and Figure 3-2, respectively.

### 3.1.1.3 Vendor Influence in the Free Ridership Calculation

#### **3.1.1.3.1 Treatment of Participant's Rating of Vendor in the Program Components FR Score of the Core FR Algorithm**

The Program Components FR Score of the participant Core FR algorithm is based on participant ratings of program and non-program factors. Vendors<sup>56</sup> often receive a high rating for their influence on the participant's decision to install the efficient measure. To implement the Core FR algorithm, the evaluator needs to decide whether the vendor rating should be considered a program factor or a non-program factor. This section outlines three scenarios for the treatment of the participant's rating of a vendor in the Program Components FR Score of the Core FR algorithm.

##### **Scenario #1: Vendors are automatically considered a program factor**

The vendor is considered a program factor in the calculation of the Program Components FR Score in the FR algorithm if the program meets specific criteria, which could include the following:

1. Trade allies are an integral component of program delivery, as supported by program logic
2. The trade ally network consists of a limited number of Program Administrator-selected, pre-approved trade allies
3. Only trade allies can implement projects and submit applications on behalf of the customer
4. Trade allies complete signed agreements with the Program Administrator
5. Trade allies complete program-sponsored training

In these cases, the vendor is automatically considered a program factor, and no additional input from the vendor is needed regarding the customer's decision-making process related to the project. The participant's influence rating for the vendor goes directly into the Program Components FR Score algorithm as a program factor (if it is the highest rating given to any program factor).

##### **Scenario #2: Vendors are considered a program factor if the program influenced their recommendation to implement the efficient project**

For programs that have a trade ally network, but do not meet the conditions under Scenario #1 above, follow-up interviews with vendors may be used to determine if the vendor should be considered a program factor. To qualify for Scenario #2, a program's trade ally network should meet the following conditions:

1. Trade allies are registered with the program
2. Trade allies typically complete signed agreements with the Program Administrator
3. Trade allies complete program-sponsored training
4. Trade allies drive program participation, as supported by program logic

In these cases, if the size of the project warrants a greater level of effort, a follow-up interview with the vendor may be used to determine if the participant's rating of the vendor's influence should be included as a program factor. A follow-up interview is triggered under the following conditions:

1. The participant rated the influence of the vendor as 8, 9, or 10 (on a scale from 0 to 10)
2. The rating the participant gave to vendor influence is higher than any of the program factor ratings

---

<sup>56</sup> Vendors include trade allies, contractors, distributors, suppliers, and other market actors involved in the selection and installation of program-incented equipment on behalf of the participant.

If completed, the interview should include the following questions:

- FR1a On a scale of 0 to 10 where 0 is NOT AT ALL IMPORTANT and 10 is EXTREMELY IMPORTANT, how important was the <PROGRAM>, including incentives as well as program services and information, in influencing your decision to recommend that <CUSTOMER> install the energy efficient <MEASURE> at this time?
- FR1b On the same scale, how important was your firm’s past participation in an incentive or study-based program sponsored by <PROGRAM ADMINISTRATOR>?
- FR2 And using a 0 to 10 likelihood scale where 0 is NOT AT ALL LIKELY and 10 is EXTREMELY LIKELY, if the <PROGRAM>, including incentives as well as program services and information, had not been available, what is the likelihood that you would have recommended this specific <MEASURE> to <CUSTOMER>?
- FR3a Approximately, in what percent of projects did you recommend <MEASURE> BEFORE you learned about the <PROGRAM>?
- FR3b And approximately, in what percent of projects do you recommend <MEASURE> now that you have worked with the <PROGRAM>?

The interview will also include consistency checks, if the vendor provides inconsistent responses to these questions.

The vendor is viewed as a program factor and the rating the participant provided for the vendor goes into the Program Components FR Score algorithm as a program factor if, after consideration of any consistency checks:

1. The response to Q. FR1a or FR1b is 8, 9, or 10

OR

2. The response to Q. FR2 is 0, 1, or 2

OR

3. The difference between the responses to FR3b and FR3a is 80% or greater

If none of these conditions are met, the rating the participant provided for the vendor does not go into the Program Components FR Score algorithm as a program factor.

In the event that an interview is not completed (e.g., the size of the project did not warrant a vendor interview or the vendor could not be reached), the evaluation reports should explain how the rating the participant provided for the vendor was treated. Guidelines for these situations may be added to this document in the future.

**Scenario #3: Vendors are considered a non-program factor**

For programs that do NOT have a trade ally network that meets the conditions under Scenario #2, vendors are considered a non-program factor. In these cases, the participant’s rating of the vendor does not go directly into the Program Components FR Score algorithm as a program factor.

**3.2 Core Non-Residential Spillover Protocol**

Spillover refers to energy savings associated with energy-efficient equipment installed by consumers who were influenced by an energy efficiency program, but without direct intervention (e.g., financial or technical assistance) from the program.

To place the spillover protocols in context, we begin by defining the NTGR as:

$$NTGR = (1 - \text{Free Ridership Value} + \text{PSO Rate} + \text{NPSO Rate})$$

Where:

- PSO Rate = Participant spillover rate
- NPSO Rate = Nonparticipant spillover rate

The term (1-Free Ridership) is referred to as the Core NTGR for an efficiency program.



### 3.2.1 Core Participant Spillover Protocol

The Core Participant Spillover protocol is generally applicable to most commercial, industrial, and public sector programs.

#### 3.2.1.1 Research Methods

**Data collection approach.** An initial determination of participant spillover may be made based on self-reported findings from surveys of program participants. At a minimum, surveys collecting data pertaining to participant spillover will obtain general information on the specific measures installed and information substantiating their attribution to an energy efficiency program. Research on the specific characteristics of the energy efficient equipment installed and the baseline and operating conditions needed to estimate savings may be done in one of two ways: 1) a detailed battery of measure specific questions may be administered as part of the initial survey; or 2) a separate in-depth follow-up interview may be conducted by the engineer or analyst responsible for the energy savings calculation. In either case, an engineer or analyst will use the collected data to develop an estimate of spillover savings for each project.

**Sample Frame.** One target for participant spillover research may be the most recent year's program participants who have been sampled for free ridership or process surveys. In the case where a stand-alone spillover study is being conducted, the sample frame may be broader and include those whose participation occurred during the time period of two prior program years.

Because evaluated spillover energy impacts associated with the sample are being extrapolated to the program population, it is important that the sample frame be limited to participating customers for which spillover may potentially be claimed.

Sample frames should be constructed in accordance with the following guidelines:

- Self-directing customers as defined by 220 ILCS 5/8-104(m) should be excluded from the sample frame for natural gas spillover.
- Customers of municipal electric utilities should be excluded from the sample frame for electric spillover.

**Timing of Data Collection.** Evaluators may either administer the participant spillover module as part of a comprehensive net-to-gross survey, or they may elect to implement it separately. A follow-up in-depth interview may also be conducted by an engineer or analyst to obtain additional details needed to quantify savings. Optimally, the spillover inquiry should be timed in order to allow sufficient time for spillover to occur; at a minimum, three months after the program-incented measure is installed. Projects installed up to two years after program participation occurred may be counted as spillover, provided it can be substantiated.

#### 3.2.1.2 Approach for Identifying and Quantifying Spillover

**Attribution Criteria.** Program attribution is determined by the responses to the following two survey questions:

1. How important was your experience in the <PROGRAM> in your decision to implement this measure, using a scale of 0 to 10, where 0 is not at all important and 10 is extremely important?
2. If you had not participated in the <PROGRAM>, how likely is it that your organization would still have implemented this measure, using a 0 to 10 scale, where 0 means you definitely WOULD NOT have implemented this measure and 10 means you definitely WOULD have implemented this measure?

The response to the first question cited above is "Measure Attribution Score 1," and the response to the second question cited above is "Measure Attribution Score 2."

There are two methods by which the attribution may be calculated:

1. Program attribution is established if the average of Measure Attribution Score 1 and (10 – Measure Attribution Score 2) exceeds 5.0<sup>57</sup>; either the Measure Attribution Score 1 or (10 – Measure Attribution

---

<sup>57</sup> Note that the threshold value for counting spillover has been lowered from 7.0 to 5.0. The rationale for this lower threshold

Score 2) could be below 5.0—as long as the average is greater than 5.0, the threshold is met. If the average is greater than 5.0, 100% of the measure energy savings referenced in the question are considered to be attributable to the program. If the average is not greater than 5.0, none of the measure energy savings are considered to be attributable to the program.

2. An attribution rate may be calculated as equal to the sum of Measure Attribution Score 1 and (10 – Measure Attribution Score 2), divided by 20. For instance, if the attribution rate is 0.3, then 30% of the measure energy savings referenced in the question are considered to be attributable to the program.

Program attribution option 2 must be used in cases in which evaluators have performed the data collection and analysis required to attribute energy savings using option 2 identified above.

**Calculation of Spillover Measure Energy Savings.** Energy savings of spillover measures shall be calculated in one of two ways.

1. Those addressed in the IL-TRM shall be calculated in accordance with the methods and algorithms specified in the IL-TRM, and shall reference the IL-TRM-defined time-of-sale or new construction baseline.
2. For measures not addressed in the IL-TRM, evaluators shall quantify savings using accepted industry-wide savings methods that conform to IPMVP or other industry protocols and documents.

Evaluators will make every effort to ensure that there is no double-counting of participant spillover energy savings across multiple sources of participant and nonparticipant spillover (such as participating customer and trade ally surveys) and will document that effort.

Measure implementation must have occurred within one year of the participant spillover study data collection effort in order to be countable as participant spillover.

For the purposes of accounting for spillover savings attributable to a program, spillover will only be quantified for measures implemented within the Program Administrator’s service territory.

### 3.2.1.3 Key Participant Spillover Survey Questions

The Participant Spillover question module is designed to be a general inquiry that seeks to: (1) assess whether additional energy efficiency improvements were implemented since the rebated project was completed; (2) confirm that these measures either had not received program incentives, or that there were no plans to submit them for program incentives in the future; (3) gather basic information about the additional energy efficiency measures (e.g., their type, size, quantities, and energy efficiency rating); and (4) establish program attribution.

The basic question structure is shown below. The measure-specific questions can be repeated in order to capture multiple measures. Note that there is considerable flexibility to tailor the questions to specific types of applications and programs.

1. Since your participation in the <PROGRAM>, did you implement any ADDITIONAL energy efficiency improvements at this facility or at your other facilities within <PROGRAM ADMINISTRATOR>’s service territory that did NOT receive incentives through <PROGRAM>?
2. What measures did you implement without an incentive?

MEASURE-SPECIFIC QUESTIONS [repeated for each spillover measure]<sup>58</sup>

1. How important was your experience in the <PROGRAM> in your decision to implement this <MEASUREX>? Please use a scale of 0 to 10, where 0 is not at all important and 10 is extremely important.

---

is: (1) the value of >5 is a strong indicator of program influence on the decision to install non-rebated equipment and is currently being used in other states (e.g., California); (2) the previous value of >7 set an unreasonably high standard for demonstrating program influence on the decision to install non-rebated equipment; and (3) past IL evaluation data show that a threshold of >5 will improve spillover estimates as it provides a better approximation of partial spillover (i.e., where a portion of the savings for each measure installed outside the program gets credited as spillover based upon the program influence rating).

<sup>58</sup> Example questions to gather engineering information to support the calculation of spillover savings may be accessed here: [http://www.ilsag.info/il\\_ntg\\_methods.html](http://www.ilsag.info/il_ntg_methods.html)

2. Can you explain how your experience with the <PROGRAM> influenced your decision to install this additional high-efficiency measure?
3. If you had not participated in the <PROGRAM>, how likely is it that your organization would still have implemented <MEASURE>? Please use a 0 to 10, scale where 0 means you definitely WOULD NOT have implemented this measure and 10 means you definitely WOULD have implemented this measure.
4. How many of <MEASURE> did you install?3
5. Questions to further define the measure (as applicable):
  - a. Type
  - b. Efficiency
  - c. Size
  - d. Other attributes
6. Can you briefly explain why you decided to install this energy efficiency measure on your own, rather than going through the <PROGRAM>?

Since spillover is best conceptualized as a program-level concept, the preferred approach is to ask the influence questions (Q.1-3 above) relative to the participant’s experience with the *program*, rather than relative to the participant’s experience with a specific *project* or *incented measure* (in cases where a unique participant implemented more than one project/measure through the program during the evaluation period).

#### 3.2.1.4 Reporting of Results

Evaluators will report the following information relating to participant spillover data collection and analysis in annual EM&V reporting: 1) the number of participants surveyed; 2) the number of survey respondents reporting additional energy efficiency improvements; 3) the number of survey respondents who meet the spillover attribution threshold; 4) the number of respondents for which spillover savings were actually quantified; 5) the spillover savings for each respondent and overall; and 6) the spillover rate. The term (1-Free Ridership) is referred to as the Core NTGR.

The report summarizing spillover should also describe the means by which the participant spillover rate is calculated.

The preferred approach is to estimate program spillover effects by summing spillover estimates for the sample and dividing this sum by the total ex ante or ex post (if available) gross savings for all projects completed by the respondents in the sample to produce the participant spillover rate. This participant spillover rate can be added to the Core NTGR for the sample to yield the NTGR. If the sample is stratified, sampling weights must be applied before applying the NTGR to the ex post gross savings of the participant population.

Using this approach, the participant spillover rate is calculated using the following formula:

$$Participant\ Spillover\ Rate = \frac{ISO + OSO\ in\ sample}{Ex\ Post\ Gross\ Impacts\ for\ all\ projects\ by\ respondents\ in\ sample}$$

Where:

ISO = Inside participant spillover

OSO = Outside participant spillover

An alternative method is to add the participant spillover rate to each project’s Core NTGR. The project-level NTGRs are then weighted by each project’s ex ante or ex post (if available) gross savings as a share of the total. This savings-weighted NTGR can then be applied to the ex post gross savings of the participant population. If the sample is stratified, sampling weights must be applied before applying the NTGR to the ex post gross savings of the participant population. If this method is chosen, the influence questions (Q.1-3 above) must be asked relative to the participant’s experience with a specific *project* and the following formula is used:

$$Participant\ Spillover\ Rate = \frac{ISO + OSO\ in\ sample}{Ex\ Post\ Gross\ Impacts\ for\ all\ sampled\ projects}$$

Irrespective of the approach used to calculate the participant spillover rate, it is essential that the wording of the influence questions (i.e., whether relative to the participant’s experience with the *program* or relative to the

participant’s experience with a specific *project or incented measure*) match the impacts included in the denominator of the participant spillover rate.

### 3.2.2 Core Nonparticipant Spillover Protocol

The evaluation may perform research to measure nonparticipant spillover (NPSO). Evaluators will make efforts to ensure that there is no double-counting of energy savings across multiple sources and will document those efforts.

#### 3.2.2.1 Core Nonparticipant Spillover Protocol – Measured from End Users

NPSO for end users is defined as the energy savings that are achieved when a nonparticipant end user—as a result of the influence of a Program Administrator’s programs—implements energy efficiency measures *outside* of the Program Administrator’s programs.

One option for the evaluator would be to survey nonparticipating customers and estimate spillover savings for any efficient measures installed that respondents are able to attribute to specific Program Administrator programs. However, in many cases, nonparticipants might find it difficult, if not impossible, to reliably attribute any of their installations to the influence of a specific Program Administrator program. If an evaluator suspects that nonresidential nonparticipants will not be able to reliably attribute spillover savings to any particular Program Administrator program, a second option would be to survey nonparticipants and estimate spillover savings from the installation of efficient measures that respondents are able to attribute to their general knowledge of the Program Administrator incentives and information, regardless of the particular program source. These protocols are written assuming that the NPSO for end users will be estimated using this second option.

Note that this protocol does not address estimating spillover for upstream and midstream programs where the end user is assumed to be completely ignorant of any Program Administrator influence. Of course, when considered feasible, evaluators are free to estimate spillover and spillover rates at the program-specific level with the suggested questions presented in Section 3.2.2.1.2 modified appropriately.

##### 3.2.2.1.1 Research Methods

**Data Collection Approach.** An initial determination of spillover may be made based on self-reported findings from surveys of nonparticipants. At a minimum, surveys collecting data pertaining to nonparticipant spillover will obtain general information on the specific measures installed and information substantiating the influence of the Program Administrator on the installation decision. Research on the specific characteristics of the energy efficient equipment installed and the baseline and operating conditions needed to estimate savings may be done in one of two ways: (1) a detailed battery of measure specific questions may be administered as part of the initial survey, or (2) a separate in-depth follow-up interview may be conducted by the engineer or analyst responsible for the energy savings calculation.<sup>59</sup> Projects installed within the last two years of the nonparticipant spillover study data collection effort may be counted as spillover, provided program attribution and energy savings can be substantiated. In either case, an engineer or analyst will use the collected data to develop an estimate of spillover savings for each project.

**Sample Frame.** The sample frame for nonparticipant end user spillover research is composed of customers who have not participated in any programs within the last three years. Because evaluated spillover savings associated with the sample are being extrapolated to the nonparticipant population, it is important that the sample frame be limited to nonparticipants for whom spillover may potentially be claimed.

Sample frames should be constructed in accordance with the following guidelines:

- Self-directing customers as defined by 220 ILCS 5/8-104(m) should be excluded from the sample frame for natural gas spillover.
- Customers of municipal electric utilities should be excluded from the sample frame for electric spillover.
- Entities eligible to participate in the Illinois Department of Commerce and Economic Opportunity programs will not be included in sample frames for the study of nonparticipant spillover attributable to utility-

<sup>59</sup> See [http://www.ilsag.info/il\\_ntg\\_methods.html](http://www.ilsag.info/il_ntg_methods.html) for detailed example questions designed to collect information required to estimate spillover savings for a variety of measures.

administered programs.

- Entities eligible to participate in the utilities' programs will not be included in sample frames for the study of nonparticipant spillover attributable to programs administered by the Department of Commerce and Economic Opportunity.

**Timing of Data Collection.** Evaluators might administer the nonparticipant end user spillover study in parallel with the program impact evaluation, potential study or saturation study research, or at a different time.

### 3.2.2.1.2 Approach for Identifying and Quantifying Spillover

**Key Nonparticipant Spillover Survey Questions.** The nonparticipant end user spillover question module is designed to be a general inquiry that seeks to: (1) assess whether additional energy efficiency improvements were implemented during the study period; (2) confirm that these measures had not received program incentives and that there were no plans to submit them for program incentives in the future; (3) gather basic information about the additional energy efficiency measure(s), e.g., the type, size, quantities, and energy efficiency rating; and (4) establish the Program Administrator importance ratings. Note that while the example questions can be customized to assess the influence of a specific program in the Program Administrator portfolio, they are currently worded to capture influence of the Program Administrator, regardless of program source.

Below are example questions that might be used in a nonparticipant spillover survey. They are grouped by the following topics:

- **Threshold conditions:** Is there some credible evidence that it was at least possible for the Program Administrator to have influenced the decision to install additional energy efficient measures?
- **Measure description:** Enough information needs to be collected for the measure and its operation to support a credible estimate of savings
- **Attribution:** Is there credible evidence that the Program Administrator had substantial influence on the end user's decision to install the efficient measure outside of any of the programs in the Program Administrator portfolio?

**Threshold Conditions.** Spillover cases are identified using a threshold approach in which certain minimal conditions must be met for a customer's installation to be considered for spillover. The following are example questions that evaluators may use (individually or in combination) to determine that program administrator influence on the installation is possible:

1. Before installing these measures, did you know that <PROGRAM ADMINISTRATOR> offers energy efficiency programs, incentives, and information to help their business customers make energy efficiency improvements at their facilities?
2. <PROGRAM ADMINISTRATOR> offers incentives for energy efficient equipment upgrades and improvements through its <PORTFOLIO NAME> programs. Before installing these measures, had you heard about the <PORTFOLIO NAME> programs?

If the answer to either question is "yes", then the threshold condition is met.

**Measure Description.** The interview (either the initial interview or a separate in-depth follow-up interview) can be used to determine the following basic attributes (as applicable) required to support a credible estimate of savings:

1. Type
2. Efficiency
3. Size
4. Other attributes

The named measure(s) must represent equipment that is more energy efficient than either: (1) equipment required by codes or standards; (2) industry-standard practice for certain types of equipment; or (3) for Custom measures, the minimum efficiency equipment available to meet the customer's requirements. For detailed example questions designed to collect engineering information required to estimate spillover savings for a variety of measures, see [http://www.ilsag.info/il\\_ntg\\_methods.html](http://www.ilsag.info/il_ntg_methods.html).

**Attribution.** The following questions are suggested to assess attribution. These questions should be asked separately for each potential spillover measure:

1. Earlier you mentioned that you knew that <PROGRAM ADMINISTRATOR> offers incentives to customers for installing energy efficient equipment, and also provides information to customers to help them reduce their energy usage. Thinking about all of the reasons you chose to install the energy efficient <MEASURE>, did your knowledge of these incentives and information available through <PROGRAM ADMINISTRATOR> have ANY INFLUENCE on your decision to install <MEASURE>?

ASK IF Q1=YES

2. Using a scale of 0 to 10, where 0 is not at all influential and 10 is extremely influential, how much influence did your knowledge of the incentives and information <PROGRAM ADMINISTRATOR> offers have on your decision to install your energy efficient <MEASURE>?
3. Just to make sure that we understand you correctly, please answer the following hypothetical question. If you had you NOT known about the incentives and information <PROGRAM ADMINISTRATOR> offers, would you still have installed your energy efficient <MEASURE>? Please use a scale of 0 to 10, where 0 means you definitely WOULD NOT have installed your energy efficient <MEASURE> and 10 means you definitely WOULD have done so.

### Consistency Checks

Respondents may be asked one or more questions to facilitate understanding and potentially reconcile apparently inconsistent responses. Evaluators should report on the amount of inconsistency encountered and, on the resolution, to inform future protocol revisions.

ASK IF Q2>7 AND Q3>7 OR Q2<3 AND Q3<3

4. In your own words, can you explain HOW your knowledge of the incentives and information <PROGRAM ADMINISTRATOR> offers influenced your decision to purchase or install your energy efficient <MEASURE>?

The evaluation analyst will assess the response to this open ended question and its consistency with the other questions, and, if warranted based on clear additional information, they will adjust the score based on expert judgment. If an inconsistency exists and the open-ended response does not resolve the inconsistency, the respondent will be removed from the calculation. All instances of this occurring should be documented in the final report. Additional consistency checks, triggered and resolved within the survey with additional questions to participants, remain optional.

**Nonparticipant End User Spillover Algorithm.** The response to question #2 cited above is “Measure Attribution Score 1,” and the response to question #3 cited above is “Measure Attribution Score 2.”

There are two methods by which the attribution may be calculated:

1. Provided that the open-ended responses do not contradict influence of the Program Administrator, spillover is considered to be attributable to the Program Administrator if the average of the Measure Attribution Score 1 and  $(10 - \text{Measure Attribution Score 2})$  exceeds 5.0<sup>60</sup>; either the Measure Attribution Score 1 or  $(10 - \text{Measure Attribution Score 2})$  could be below 5.0—as long as the average is greater than 5.0, the threshold is met. If the average is greater than 5.0, 100% of the measure energy savings referenced in the question are considered to be attributable to the Program Administrator. If the average is not greater than 5.0, none of the measure energy savings are considered to be attributable to the Program Administrator.
2. Provided that the open-ended responses do not contradict influence of the Program Administrator, the attribution rate is calculated as equal to the sum of Measure Attribution Score 1 and  $(10 - \text{Measure Attribution Score 2})$ , divided by 20. For instance, if the attribution rate is 0.3, then 30% of the measure energy savings referenced in the question are considered to be attributable to the Program Administrator.

**Calculation of Spillover Measure Energy Savings.** Energy savings of spillover measures shall be calculated in one of

---

<sup>60</sup> Note that the same 5.0 threshold value is being used for both Participant and Nonparticipant Spillover.

two ways.

1. Those addressed in the IL-TRM shall be calculated in accordance with the methods and algorithms specified in the IL-TRM, and shall reference the IL-TRM-defined time-of-sale or new construction baseline.
2. For measures not addressed in the IL-TRM, evaluators shall quantify savings using accepted industry-wide savings methods that conform to IPMVP and other industry protocols and documents.

Evaluators will make every effort to ensure that there is no double-counting of nonparticipant spillover energy savings across multiple sources of nonparticipant spillover reporting (such as nonparticipating customer and trade ally surveys) and will document that effort.

Measure implementation must have occurred within the last two years of the nonparticipant spillover study data collection effort in order to be countable as nonparticipant spillover.

For the purposes of accounting for spillover savings attributable to the Program Administrator, spillover will only be quantified for measures implemented within the Program Administrator’s service territory.

### 3.2.2.1.3 Reporting of Results

Evaluators will report the following information relating to nonparticipant spillover data collection and analysis in annual EM&V reporting: 1) how the sample frame was defined, 2) the number of customers surveyed; 3) the number of survey respondents reporting spillover; 4) the number of survey respondents who meet the spillover attribution threshold; 5) the number of respondents for which spillover savings were actually quantified; 6) the spillover savings for each project and overall; 7) the nonparticipant spillover rate, and 8) the calculation of the weights used to extrapolate the spillover to the population of nonparticipants from which the sample was drawn.

The EM&V report should also describe the means by which the nonparticipant spillover (NPSO) rate is calculated. For each sampled site, the verified spillover savings should be summed across measures to derive the total end user NPSO for the sampled sites.<sup>61</sup> The estimate of site-level end user NPSO for the entire sample is then extrapolated to the entire nonparticipant population using sampling weights.

There are two options for using the estimated NPSO.

1. Allocate the portfolio-level spillover savings to individual programs in the portfolio based on each program’s share of the ex post gross savings. For each program, the spillover rate could then be calculated for each program using the equation below in which the spillover allocated to each program would be the numerator and the ex post program-specific gross savings would be the denominator.

$$\text{Program – Specific NPSO Rate} = \frac{NPSO_{\text{Program-Specific}}}{\text{Ex Post Gross Impacts}_{\text{Program-Specific}}}$$

The spillover-adjusted NTGR for each program could then be used to adjust the Core NTGR for each program before calculating the TRC. In calculating the Program-Specific NPSO Rate, the numerator and denominator must be consistent in terms of the time period of measure implementation/potential implementation. While this time period must be within the last two years, it may be for a period of less than two years.

2. The NPSO Rate is calculated at the Sector level. The estimated energy savings associated with program-attributable spillover measures implemented during the study period by the entire nonparticipant population is divided by the ex post gross impacts for all the nonresidential programs in the portfolio occurring during the study period. The C&I Sector NPSO Rate is calculated using the following equation

$$\text{Portfolio NPSO Rate} = \frac{NPSO_{\text{Portfolio}}}{\text{Ex Post Gross Impacts}_{\text{Portfolio}}}$$

The NPSO rate could then be used to adjust the portfolio core NTGR before calculating the portfolio TRC. Again, in calculating the Portfolio NPSO Rate, the numerator and denominator must be consistent in terms of the time period of measure implementation/potential implementation. While this time period must be within the last two years, it may be for a period of less than two years.

<sup>61</sup> This includes all samples sites including those that reported no spillover savings.

### 3.3 Small Business Protocol

#### 3.3.1 Free Ridership


The FR algorithm for non-residential small business programs will follow the Core Non-Residential FR Protocol, with the following exceptions:

1. To reduce respondent burden, the Program Influence FR Score may be dropped from the Small Business FR algorithm. The influence of nonprogram factors will still be captured in the Program Components FR Score.
2. The counterfactual likelihood question (likelihood the participant would have installed, absent the program, equipment of the same level of high efficiency as the unit installed with the program) may be preceded with a 0-10 scale question about the likelihood the participant would have installed any new equipment—either standard efficiency or high efficiency—on their own.
  - a. If the participant provides a likelihood response of 0, then the No-Program FR Score for that participant is set to 0.
  - b. If the participant provides a likelihood response of 1-10, then the participant is asked the same counterfactual questions (including the first timing question) as in the Core Non-Residential FR protocol.
3. To reduce respondent burden, the second question about timing (likelihood the participant would have installed, absent the program, equipment of the same level of high efficiency as the unit installed with the program within 12 months) may be dropped. In this case, the only Deferred Free Ridership specification would be the one applying Timing Adjustment 1.

The diagram below, Figure 3-3, depicts the Small Business FR approach with the above exceptions implemented.

**Figure 3-3. Small Business Free Ridership**

$$\frac{\text{Program Components FR Score} + (\text{No-Program FR Score} * \text{Timing Adjustment 1})}{2}$$

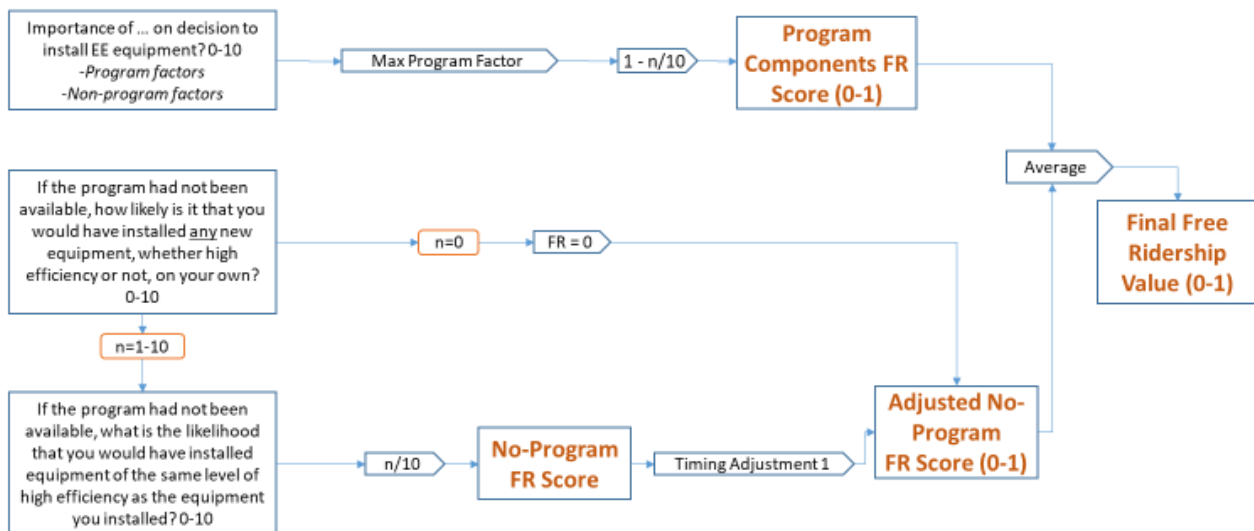

Evaluators will calculate free ridership values for small business projects as follows:

- (1) If Program Influence FR Score is dropped:



FR = AVERAGE ([Program Components FR Score], [No-Program FR Score \* Timing Adjustment 1])

(2) If Program Influence FR Score is included:

FR = AVERAGE ([Program Components FR Score], [Program Influence FR Score], [No-Program FR Score \* Timing Adjustment 1])

### 3.4 C&I New Construction Protocol

#### 3.4.1 Free Ridership

The FR algorithm for non-residential new construction programs will follow the Core Non-Residential FR protocol, with the following exception:

- The concept of project timing and deferred free ridership is not applicable to new construction projects.<sup>62</sup> As a result, the various deferred free ridership specifications outlined in Figure 3-1 and Figure 3-2 will not be included in the free ridership estimation for new construction projects.

Evaluators will calculate free ridership values for new construction projects as follows:

FR = AVERAGE ([Program Components FR Score], [Program Influence FR Score], [No-Program FR Score])

### 3.5 Study-Based Protocol

#### 3.5.1 Free Ridership

The FR algorithm for non-residential study-based programs (See Figure 3-4) will follow the Core Non-Residential FR protocol, with the following exceptions:

- The counterfactual likelihood question (Q.4 in Figure 3-5 and Figure 3-6, below) will be preceded by five questions.<sup>63</sup>
- Q.1 A 0-10 scale question about the likelihood that the participant would have conducted the study absent the program will be included.

**At the measure-group level, the following should be included:**

- Q.2a A yes/no question to determine if the participant performs regular maintenance on the equipment treated through the program
- Q.2b If the response to Q.2a is “yes,” a yes/no question to determine if the maintenance always includes the treatment provided through the program
- Q.3a A yes/no question to determine if the participant had prior awareness of the performance issues identified through the study
- Q.3b A 0-10 scale question about the participant’s level of familiarity with the recommended actions to rectify the performance issue.

The counterfactual likelihood question (Q.4 – likelihood the participant would have taken action absent the program) and the first counterfactual timing question (used to develop Timing Adjustment 1) will be asked at the measure-group level. Measure-group level responses will be aggregated to the project level, using savings-based weights.

There will be two options for developing the No-Program FR Score:

---


<sup>62</sup> New Construction programs intervene in the early phases of ongoing construction projects (i.e., after the decision to build has been made). As a result, participation in a New Construction program would not be expected to accelerate the construction of the new building.

<sup>63</sup> It should be noted that the question numbering in Figure 3-5 and Figure 3-6 is for reference purposes only; the additional questions do not have to immediately precede the counterfactual likelihood question.


1. The measure-group level Adjusted No-Program FR Score will be developed following Algorithm 1 of the Core Non-Residential FR approach, using responses to the counterfactual likelihood question (Q.4) and Timing Adjustment 1.
2. The measure-group level No-Program FR Scores will be assigned, based on responses to Q.1, Q.2b, Q.3a, and Q.3b, as follows:
  - a. If Q.2b = Yes, then No-Program FR Score = 1. This assumes that if the participant performs regular maintenance on the treated equipment and that maintenance always includes the issue addressed through the program, then the participant is a full free rider for that measure group for purposes of calculating the No-Program FR Score.
  - b. If Q.3a = No and Q1 = 0 and Q.2b ≠ Yes, then No-Program FR Score = 0. This assumes that if the participant was not aware of the performance issue and had a zero likelihood of performing the study absent the program and their maintenance practices do not always include the issue addressed through the program, then the participant is not a free rider for that measure group for purposes of calculating the No-Program FR Score since they would not have found out about the issue absent the program.
  - c. If Q.3b = 0 and Q1 = 0 and Q.2b ≠ Yes, then No-Program FR Score = 0. This assumes that if the participant had no familiarity with how to rectify the performance issue, had a zero likelihood of performing the study absent the program, and their maintenance practices do not always include the issue addressed through the program, then the participant is not a free rider for that measure group for purposes of calculating the No-Program FR Score since they would not have known how to address the issue absent the program.
  - d. For all other combinations of responses to Q.1, Q.2b, Q.3a, and Q.3b, the measure-group level Adjusted No-Program FR Scores will be developed following Algorithm 1 of the Core FR approach, using responses to the counterfactual likelihood question (Q.4) and Timing Adjustment 1.

**Figure 3-4. Study-Based Free Ridership—Overview**


$$\text{((Program Components FR Score + Program Influence FR Score + (No-Program FR Score * Timing Adjustment 1)) / 3)$$

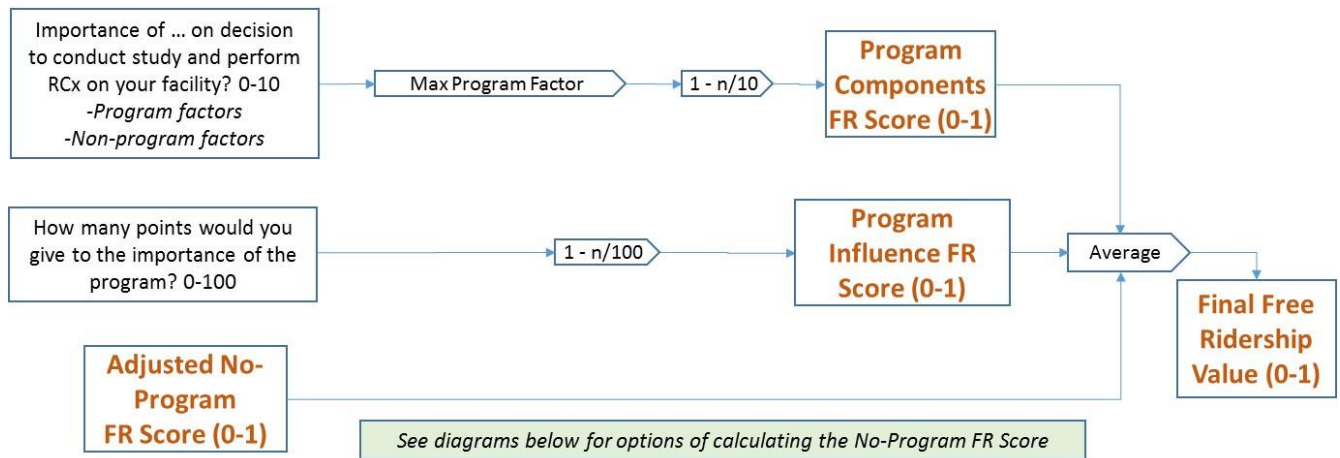

**Figure 3-5. Study-Based Free Ridership—No-Program FR Score Option #1**

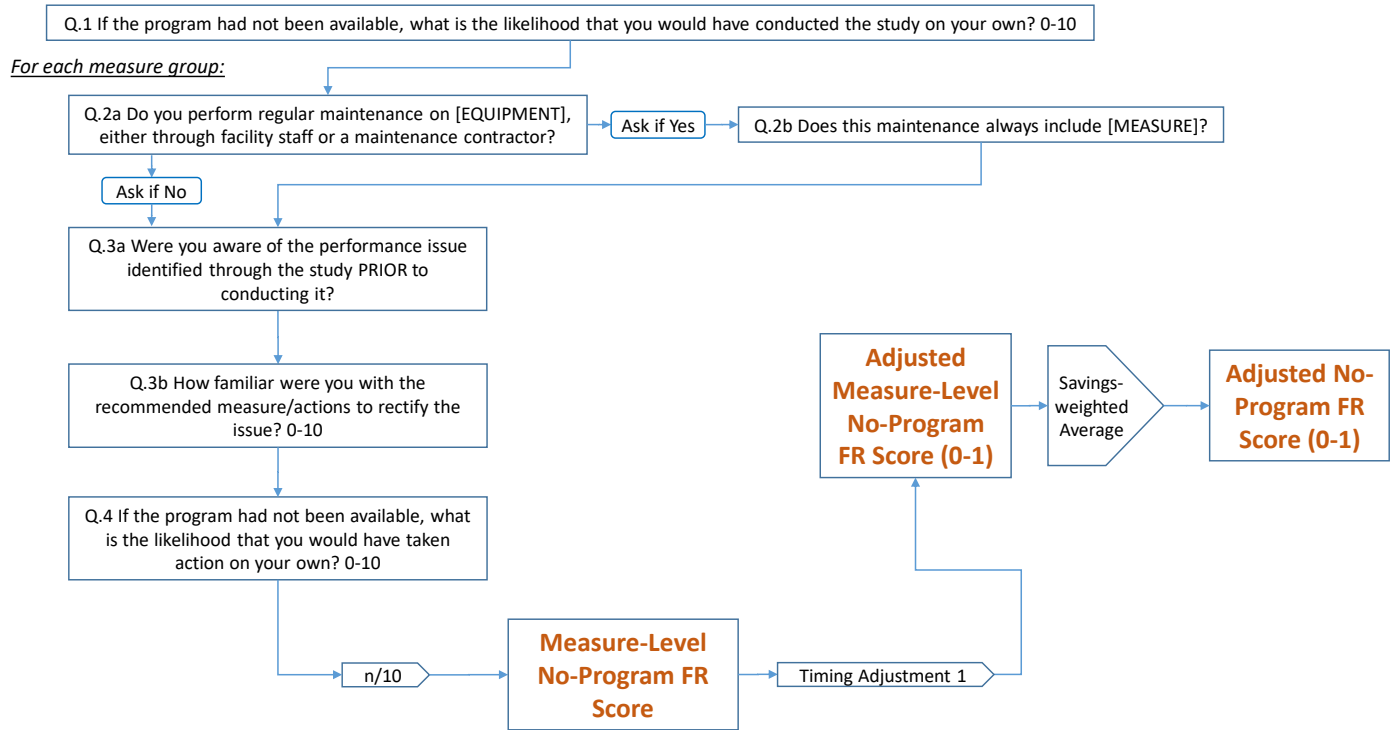

**Figure 3-6. Study-Based Free Ridership—No-Program FR Score Option #2**

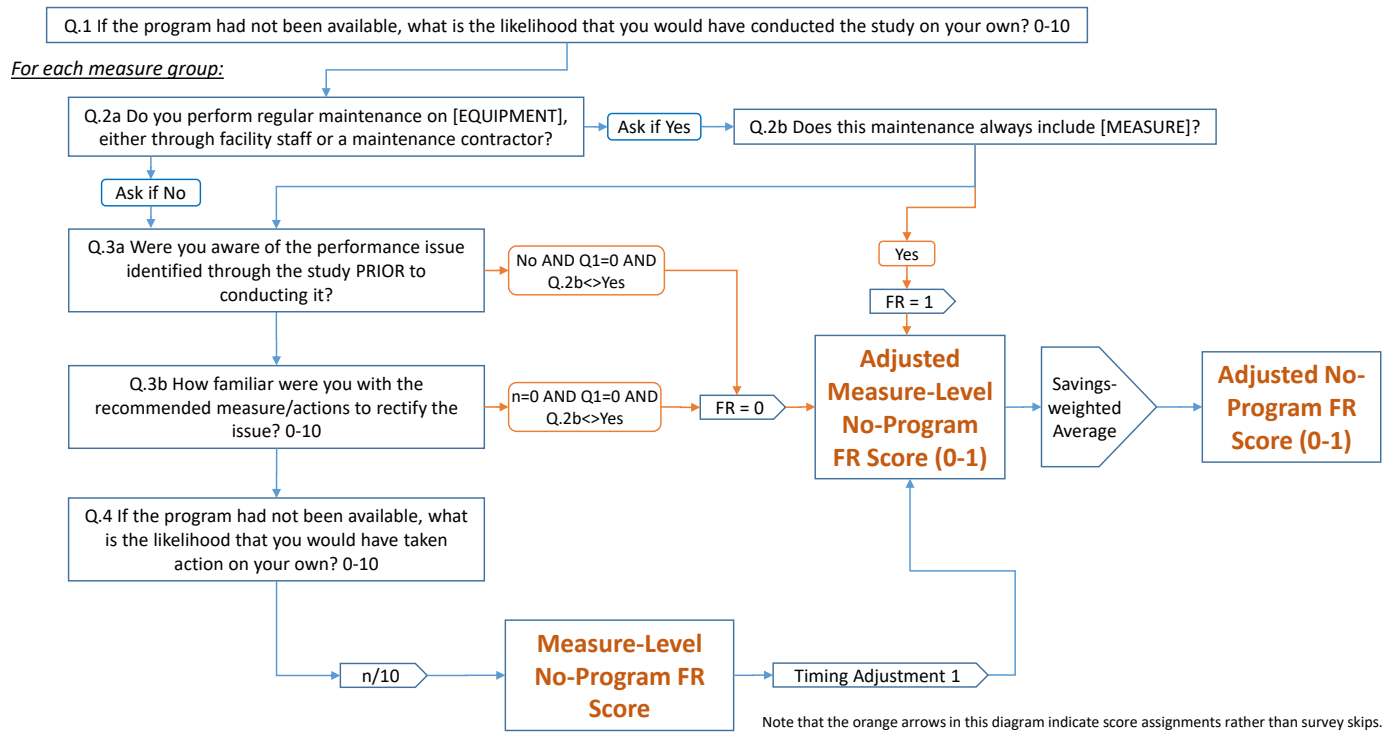

Evaluators will calculate free ridership values for study-based programs as follows:

$$FR = \text{AVERAGE} ([\text{Program Components FR Score}], [\text{Program Influence FR Score}], [\text{No-Program FR Score} * \text{Timing Adjustment 1}])$$

Evaluators will develop estimates of free ridership based on the two No-Program FR Score options outlined above. Evaluators will select one of these for purposes of calculating the annual incremental energy savings for comparing to the legislated goal. Evaluators will present the results of both estimates of free ridership in EM&V reporting.

### 3.6 Technical Assistance Protocol

This protocol is applicable to programs that provide technical assistance to encourage the adoption of energy efficiency measures in non-residential facilities, but do not provide financial incentives.

Program-attributable savings from Technical assistance programs are achieved when a program participant—as a result of the program’s influence via the training or technical assistance provided—undertakes energy efficiency improvements on their own, without any direct financial assistance from any other Illinois energy efficiency program.

An initial determination of program-attributable savings is made based on self-reported findings from surveys of program participants. At a minimum, surveys collecting data pertaining to participant measure implementation will obtain general information on the specific measures installed and information substantiating their attribution to the program. Research on the specific characteristics of the energy-efficient equipment installed and the baseline and operating conditions needed to estimate savings may be done in one of two ways: 1) a detailed battery of measure specific questions may be administered as part of the initial survey; or 2) a separate in-depth follow-up interview may be conducted by the engineer or analyst responsible for the energy savings calculation. These collected data may be augmented by detailed facility and measure characteristics if provided by program staff.

#### 3.6.1 Free Ridership

- The FR algorithm for Technical Assistance programs is identical to the Core Non-Residential FR protocol,

with the following exception:

- For the Program Components score, the list of program and non-program components differs extensively from conventional programs and therefore, is described in some detail here. As under the Core Protocol, evaluators administer survey questions to obtain participants' rating of the importance of a comprehensive list of program and non-program factors on the decision to implement energy efficiency measures. Examples of Technical Assistance program factors that may be included are: Documentation in a program-provided technical report of the energy saving opportunities from installing the measure.
- Verbal information or guidance provided by a program representative or energy auditor during a training course or an on-site visit.
- A follow-up communication from the utility regarding implementing the recommendations provided through the audit, training, or technical assistance.

Examples of Technical Assistance non-program factors that may be included are:

- Information from trade shows, conferences, or other professional gatherings
- Recommendation from an equipment vendor that sold you the measure and/or installed it
- Previous experience with the measure
- A recommendation from a design or consulting engineer
- Standard practice in your business/industry
- Corporate policy or guidelines
- Payback on the investment

## 4 Residential and Low Income Sector Protocols

The table below lists Illinois residential programs and the NTG protocol applicable to each program.<sup>64</sup> If the design of a given program changes significantly, then it may mean that the NTG protocol listed for that program in this document is no longer appropriate. If that happens, the evaluator should follow the procedures outlined in Section 1.4: Diverging from the IL-NTG Methods.

**Table 4-1. Residential and Low Income Programs**

Program Administrator	Free Ridership Protocol	Program Name
Ameren Illinois	4.2 Appliance Recycling Protocol	Appliance Recycling Initiative
	4.3 Residential Upstream Lighting Protocol	Retail Products Initiative – Lighting Products
	4.4 Prescriptive Rebate (With No Audit) Protocol	HVAC Initiative Retail Products Initiative – Non-Lighting Products
	4.6 Multifamily Protocol	Multifamily Initiative
	4.7 Energy Saving Kits and Elementary Education Protocol	Direct Distribution of Efficient Products Initiative
	5.3 Consumption Data Analysis Protocol	Behavior Modification
	†	Income Qualified Initiative Public Housing Initiative Affordable Housing New Construction (any remaining DCEO commitments)
ComEd	4.2 Appliance Recycling Protocol	Fridge and Freezer Recycling
	4.3 Residential Upstream Lighting Protocol	Lighting Discounts
	4.4 Prescriptive Rebate (With No Audit) Protocol	Appliance Rebates Heating and Cooling Rebates Weatherization Rebates
	4.5 Single-Family Home Energy Audit Protocol	Home Energy Assessments
	4.6 Multifamily Protocol	Multifamily Assessments
	4.7 Energy Saving Kits and Elementary Education Protocol	Elementary Energy Education Kits
	4.8 Residential New Construction Protocol	Residential New Construction
	5.3 Consumption Data Analysis Protocol	Residential Behavior
†	Income Eligible Single Family Retrofit Income Eligible Multi-Family Retrofit Affordable Housing New Construction Food Bank LED Distribution Program Income Eligible Kits Program New Manufactured Homes Existing Manufactured Homes Income Eligible Retail Discounts	
Nicor Gas	4.4 Prescriptive Rebate (With No Audit) Protocol	Home Energy Efficiency Rebates (Single Family)
	4.5 Single-Family Home Energy Audit Protocol	Home Energy Savings (Single Family Assessment/ Direct Install)
		Weatherization (Wx) Prescriptive (Air/Duct Sealing and Insulation)

<sup>64</sup> The “Free Ridership Protocol Name” in the second column of the table refers to the numbered sections in this document, e.g., “4.6 Multifamily Protocol.”

Program Administrator	Free Ridership Protocol	Program Name
	4.6 Multifamily Protocol	Multi-Family (Assessment/ Direct Install) Multi-Family Prescriptive Rebates
	4.7 Energy Saving Kits and Elementary Education Protocol	Elementary Education Kits Energy Saving Kits
	4.8 Residential New Construction Protocol	Residential New Construction
	5.3 Consumption Data Analysis Protocol	Behavioral Energy Savings
	5.2 Code Compliance Protocol	Code Compliance
Peoples Gas/ North Shore Gas	4.4 Prescriptive Rebate (With No Audit) Protocol	Home Energy Rebates
	4.5 Single-Family Home Energy Audit Protocol	Home Energy Jumpstart
	4.6 Multifamily Protocol	MF Custom MF Partner Trade Ally MF Prescriptive Multifamily (Direct Install)
	4.7 Energy Saving Kits and Elementary Education Protocol	Elementary Energy Education
	5.3 Consumption Data Analysis Protocol	Home Energy Reports
All	5.4 Midstream Protocol	(Midstream Programs)

† The evaluation teams should follow the Policy Manual regarding NTG for Income Eligible programs.

#### 4.1 Residential Cross-Cutting Approaches

The approaches in this section can apply to more than one program type but do not supersede program-specific approaches presented in later sections.

##### 4.1.1 Survey Design Issues

Free ridership questions should be asked near the beginning of a participant survey, before asking satisfaction questions. This should prevent participants from confusing free ridership questions with the satisfaction questions, which could influence free ridership scores. In particular, evaluators have observed that some respondents have interpreted the No Program – Efficiency question to be a satisfaction question, synonymous with, “Do you like this item? Would you purchase this?” Evaluators may add an explanation that this question is not about respondents’ satisfaction with the item.

##### 4.1.2 Participant Spillover

Effective program marketing and outreach generates program participation and increases general energy efficiency awareness among customers. Spillover can be calculated using participant survey questions, which ask participants about energy-savings actions they have taken on their own since participating in the program. Questions should be sufficiently specific to ensure energy savings associated with spillover can be reasonably well-quantified. These may include questions about measure types or measures installed, quantities, and efficiency levels. When program implementers provide recommendations to participants and can provide data on the types of recommendations made to specific participants, evaluations should attempt to determine whether participants took the recommended actions outside of the program at sites within the program administrator’s service territory; if so, savings from those recommended actions should be attributed to the program.

To reduce the respondent’s burden, the survey should first ask participants about the influence the program had on their taking additional energy-saving actions on their own. In particular, the evaluation team should ask two close-ended questions to determine program influence on spillover actions. The two required questions, preceded by an optional open-ended warm-up question, are:

- OPTIONAL: Did the program influence you in any way to make these additional improvements?

1. How important was your participation in the <PROGRAM ADMINISTRATOR’S> program on your making additional energy efficiency improvements on your own? [Scale from 0-10 where 0 is “not at all important” and 10 is “extremely important”]
2. If you had not participated in the <PROGRAM ADMINISTRATOR’S> program, how likely is it that you would still have implemented this measure, using a 0 to 10, scale where 0 means you definitely WOULD NOT have implemented this measure and 10 means you definitely WOULD have implemented this measure?

The response to the first required question cited above is “Measure Attribution Score 1,” and the response to the second required question cited above is “Measure Attribution Score 2.” The specific measures referenced in the question are considered to be attributable to the program if the “Spillover Score” is greater than 5.0:

$$\text{Spillover Score} = (\text{Measure Attribution Score 1} + (10 - \text{Measure Attribution Score 2}))/2 > 5.0$$

If these conditions are met, the evaluator determines that the specific measures referenced in the question are attributable to the program; otherwise, the evaluator determines that the specific measures referenced in the question are not attributable to the program. The attribution criterion represents a threshold approach, in which energy impacts associated with measures implemented by program participants outside the program are either 100% program-attributable or 0% program-attributable.

For each measure mentioned, customers will be asked how they know the measure is more efficient than other models. If the respondent can identify the measure as ENERGY STAR or name an efficiency level that the evaluator confirms as being above the minimum federal standard, or if they identify a technology that the evaluator can confirm is above the minimum federal standard, it will count towards Participant Spillover.

Finally, depending on the measure type cited by the customer, follow-up questions should ask customers to provide reasonable information to allow the evaluator to estimate the amount of savings using IL-TRM protocols, such as quantity of appliances or the location and amount of insulation.

To calculate the spillover energy and demand savings for these actions, the appropriate version of the IL-TRM should be used. To develop the spillover rate, the total energy and demand impacts from the sampled participants who installed additional measures due to participation in the program are summed, and then this sum is divided by the total ex post sample energy and demand impacts:

$$\text{Participant Spillover Rate (PSO)} = \frac{\text{Sum of Energy or Demand from Additional Measures Installed}}{\text{Sample Ex Post Gross Energy or Demand Impacts}}$$

The equation used to adjust the Core NTGR based on participant spillover is as follows:

$$\text{NTGR} = (1 - \text{FR} + \text{PSO})$$

#### 4.1.2.1 Data Collection

Respondents should be drawn from a random sample of current or up to one year of previous program participants. Regardless of the participation year, spillover should be measured within the last 12 months (from the survey date), but after previous participation; the tracking database should supply this information.

#### 4.1.2.2 Data Analysis

The following four steps calculate spillover:

1. Calculate total spillover savings for each participant installing an efficient measure not rebated through the program where the Spillover Score is greater than 5.0:

$$\text{Measure Spillover} = \text{Measure Savings} * \text{Number of Units}$$

2. Total savings associated with each program participant to calculate overall participant spillover savings.

3. Spillover Percentage Estimate = 
$$\frac{\sum \text{Sample Spillover kWh Savings}}{\text{Sample Evaluated Program kWh Savings}}$$



### 4.1.3 Nonparticipant Spillover Measured from Customers

The evaluation may perform research to measure nonparticipant spillover (NPSO). If so, care should be taken to ensure spillover is not double-counted with a trade-ally approach. The basic method uses a two-step process: (1) conduct a nonparticipant survey to identify potential spillover measures and (2) if needed, conduct a follow-up call or on-site visit by technical staff to confirm attribution and obtain information needed to estimate energy savings.

#### 4.1.3.1 Basic Method

##### 4.1.3.1.1 Sampling

As spillover may be rare in the nonparticipating population, determining spillover will likely require a large sample of customers who have not participated in any energy efficiency programs, including a behavioral program, within the past three years. Customers will be removed from the sample frame if their account numbers can be cross-referenced against a list of program participants from the previous three years. The survey should target household members responsible for paying utility bills. Survey respondents will be asked a screening question (whether they have participated in a program in the past three years) to confirm their household qualifies as a true nonparticipant.

##### 4.1.3.1.2 Measure-Specific Questions

Depending on the spillover measure type reported by the customer, follow-up questions should be included to gather sufficient information to reasonably assess the saving amount by applying the IL-TRM, understanding that assumptions must be made if IL-TRM inputs cannot be easily supplied by the participant. Such assumptions should be conservative, or, if not conservative, reasons for deviating from the conservative application should be documented. Measures that cannot be reasonably quantified within available evaluation budgets should be excluded from spillover calculations.

For measures included in the IL-TRM, savings will be assessed using the IL-TRM algorithms. Baselines for measures not in the IL-TRM will be assessed based on appliance standards and building codes, if applicable, and, if not, through engineering judgements of existing or market conditions. Engineering assumptions and analysis by the evaluator will be applied for measures not included in the IL-TRM. Key assumptions should be documented in the report.

#### 4.1.3.2 Attribution Approach

To receive credit for energy savings, the nonparticipant must fit the following criteria: (1) be familiar with the Program Administrator's energy efficiency campaign (e.g., ActOnEnergy for Ameren); and (2) indicate that some aspect of the Program Administrator's energy efficiency programs motivated their purchases. Influence will be measured on a scale of 0 to 10, where 10 is extremely influential and 0 is not at all influential. Savings attribution requires a Spillover Score of greater than 5.0.

Survey respondents will be asked a series of questions following the logic shown in Figure 4-1. First, the customer will indicate whether they know about their Program Administrator's energy efficiency programs and/or marketing messages. If customer is aware, the survey will ask if they or anyone in their household made an energy efficiency improvement within the last year, and if so, what improvements they made. Responses to these questions will generate a list of potential spillover measures (shown at point "[A]" in Figure 4-1). Customers will be asked how they know the measure is more efficient than other models. If the respondent can identify the measure as ENERGY STAR or name an efficiency level that the evaluator confirms as being above the minimum federal standard, or if they identify a technology that the evaluator can confirm is above the minimum federal standard, it will count towards NPSO. At this point in the NPSO process, the customer could be referred for a follow-up call with a technical interviewer.<sup>65</sup>

To assess attribution for each spillover measure mentioned, the customer will be asked questions to be scored in two areas. Spillover may be program-attributable for those measures for which self-report data meet the following threshold condition:

<sup>65</sup> Customers who installed efficient lighting (CFL/LED) will not be eligible for NPSO if those savings are already claimed by an upstream lighting program. A separate NPSO protocol is provided specifically for upstream lighting programs.

$$\text{Spillover Score} = (\text{Attribution Score 1} + (10 - \text{Attribution Score 2})) / 2 > 5.0$$

**4.1.3.2.1 Attribution Score 1**

The first score, “Attribution Score 1,” measures the influence level (on a scale of 0 to 10, where 10 is extremely influential and 0 is not at all influential) their Program Administrator had on the purchase of the measure.

Influence can derive from the following:

1. General information about energy efficiency provided by the Program Administrator (e.g. through a bill insert)
2. Information from a contractor or retailer related to the Program Administrator’s programs.
3. Word-of-mouth from people installing energy-efficient equipment and receiving a rebate from the Program Administrator.

Attribution Score 1 is the maximum score (or Yes response) assigned to any source of influence from the Program Administrator.


**4.1.3.2.2 Attribution Score 2**

The second score, “Attribution Score 2,” comes from the customer’s response to a single question to assess the counterfactual, asking about the likelihood (on a scale of 0 to 10, where 10 is extremely likely and 0 is not at all likely) that the customer would have installed the measure had they not been influenced by the program.

The Spillover Score is then the average of the Attribution Score 1 and (10 – Attribution Score 2). If that Spillover Score is greater than 5.0, 100% of the savings are attributed to the Program Administrator for that measure.

Finally, depending on the measure type cited by the customer, follow-up questions will gather information to enable an estimate of savings (shown in the figure as [B]), such as quantity of appliances or the location of insulation.

**Figure 4-1. NPSO Question Logic**

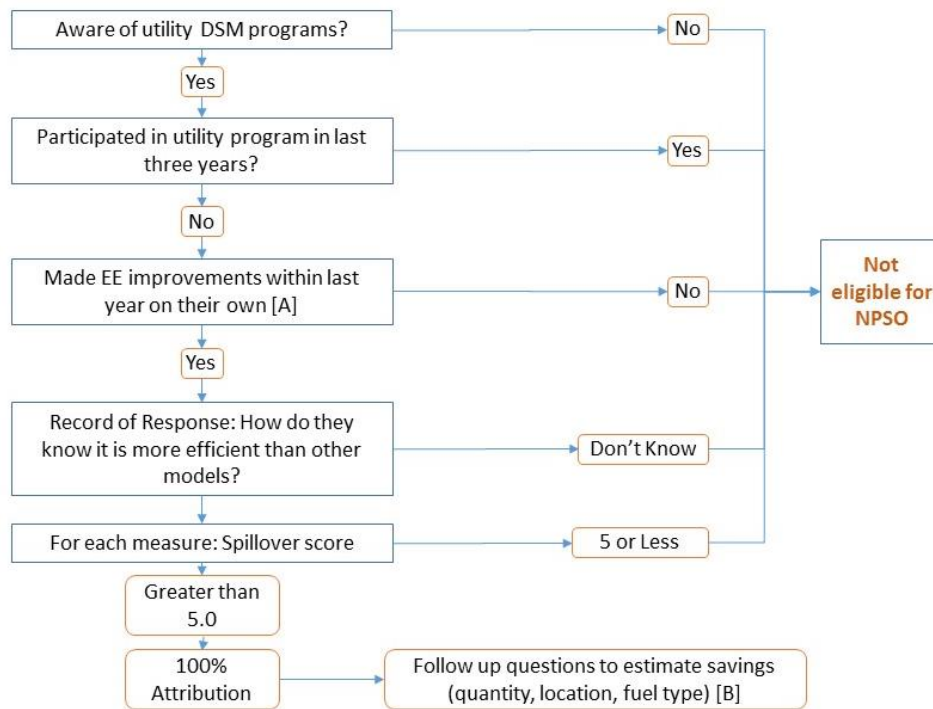

4.1.3.3 Scoring

Survey respondents’ answers to the NPSO questions will determine total energy and demand savings attributed to the program. Table 4-2 lists NPSO measures under column A, the Spillover Score under column B, the estimated measure savings under column C, the percentage of allocated savings under column D, and the total allocated savings under column E. Column F shows the calculated average energy savings per spillover measure, determined by dividing the total allocated savings (the sum of column E) by the number of surveyed nonparticipating customers. The table shows how kWh NPSO savings would be calculated; calculations of therm or demand savings would be accomplished in the same manner.

**Table 4-2. Estimation of Respondents’ NPSO Savings**

A	B	C	D	E	F
Spillover Measure	Spillover Score	Measure Savings (kWh)	Allocated Savings	Total kWh Savings	Average kWh Per Surveyed Customer
Measure1	Scale of 0 to 10	Savings1	100% if [B] > 5.0  0% if [B] ≤ 5.0	[C] x [D]	N/A
Measure2	Scale of 0 to 10	Savings2		[C] x [D]	
MeasureN	Scale of 0 to 10	SavingsN		[C] x [D]	
				Sum of column E = Total kWh Savings	Total kWh Savings ÷ Number of Completed Surveys

Table 4-3 shows the process for estimating total NPSO generated by the Program Administrator during the program year (for electric savings). The savings attributed from the survey population will be extrapolated to the nonparticipating residential customer population to determine the overall NPSO savings. Then NPSO energy savings will be converted into a percentage using the total evaluated electric savings for the program year. A similar process would apply for calculating therm or demand NPSO.

**Table 4-3. Calculation of Total NPSO Generated**

Variable	Description	Source/Calculation
F	Average kWh Energy Savings per Surveyed Customer	Survey data and Savings Calculation
J	Total Nonparticipating Residential Population	Customer database
K	NPSO MWh Energy Savings Extrapolated to Nonparticipating Population	$[F \times J] \div 1,000 \text{ kWh/MWh}$
S	Total Evaluated MWh Savings	Residential Portfolio Savings
G	NPSO Spillover Rate	$K \div S$

4.2 Appliance Recycling Protocol

Appliance recycling programs (ARPs) typically offer some mix of incentives and free pickups for the removal of old but operable refrigerators, freezers, or room air conditioners. These programs encourage consumers to undertake the following:

- Discontinue use of secondary or inefficient appliances;
- Relinquish appliances previously used as primary units upon their replacement (rather than keeping the old appliance as a secondary unit); and
- Prevent the continued use of old appliances in other households through direct transfers (i.e., giving it away or selling it) or indirect transfers (resale in the used appliance market).

As the program theory and logic for appliance recycling differ significantly from standard “downstream” incentive programs (which typically offer rebates for purchases of efficient products), the free ridership estimation approach also significantly differs.

The basic and enhanced methods are described next.

## 4.2.1 Basic Method

### 4.2.1.1 Free Ridership

Free ridership is based on participants' anticipated plans had the program not been available, thus classifying a free rider as a participant who would have removed the unit from service regardless of the program.

Estimating net savings for ARPs should adopt a multistep process to segment participants into different groups, each with specific attributable savings.

In general, independent of program intervention, participating appliances would have been subject to one of the following options:

1. The appliance would have been kept by the participating household.
2. The appliance would have been discarded in a way that transfers the unit to another customer for continued use.
3. The appliance would have been discarded in a way that would have permanently removed the unit from service.

Only Option 3 constitutes free ridership (the proportion of units that would have been taken off the grid absent the program). Options 1 and 2 both indicate non-free riders. However, these respondents need to be further classified to account for secondary market impacts, described below.

#### 4.2.1.1.1 Data Collection

A participant survey—drawn from a random sample of participants—will serve as the primary source of data collected for estimating NTG for the ARP. To determine the percentage of participants in each of the three options, evaluators will begin by asking surveyed participants about the likely fate of their recycled appliance had it not been decommissioned through the program. Responses provided by participants generally can be categorized as follows:

1. Kept the appliance.
2. Sold the appliance to a private party (either an acquaintance or through a posted advertisement).
3. Sold or gave the appliance to a used-appliance dealer.
4. Gave the appliance to a private party, such as a friend or neighbor.
5. Gave the appliance to a charity organization, such as Goodwill Industries or a church.
6. Had the appliance removed by the dealer from whom the new or replacement appliance was obtained.
7. Hauled the appliance to a landfill or recycling center.
8. Hired someone else to haul the appliance away for junking, dumping, or recycling.

Additional, follow-up questions will be included to validate the viability of all responses.

Next, evaluators will assess whether each participant's final response indicates free ridership:

- Some final responses clearly indicate free ridership, such as: "I would have taken it to the landfill or recycling center myself."
- Other responses clearly indicate no free ridership, as when the appliance would have remained active within the participating home ("I would have kept it and continued to use it") or used elsewhere within the Program Administrator's service territory ("I would have given it to a family member, neighbor, or friend to use").

If the respondent planned to have the unit picked up by the retailer and the retailer would likely resell the unit in the secondary market, they are not a free rider. Absent retailer survey primary research described in the Enhanced Options below, the evaluators will utilize data from the most recent research conducted of the ComEd program to

determine the proportion of free riders unless another metric is mutually agreed upon by the evaluators.<sup>66</sup>

#### Secondary Market Impacts

In the event that the unit would have been transferred to another household (Option 2 above), the question then becomes what purchasing decisions are made by the would-be acquirers of participating units now that these units are unavailable. Such would-be acquirers could:

1. Not purchase/acquire another unit.
2. Purchase/acquire another used unit.

Adjustments to savings based on these factors are referred to as the program's secondary market impacts.

If it is determined that the participant would have directly or indirectly (through a market actor) transferred the unit to another customer on the grid, the next question addresses what that potential acquirer did because that unit was unavailable. There are three possibilities:

- A. **None of the would-be acquirers would find another unit.** That is, program participation would result in a one-for-one reduction in the total number of appliances operating on the grid. In this case, the total energy consumption of avoided transfers (participating appliances that otherwise would have been used by another customer) should be credited as savings to the program. This position is consistent with the theory that participating appliances are essentially convenience goods for would-be acquirers. (That is, the potential acquirer would have accepted the appliance had it been readily available, but because the appliance was not a necessity, the potential acquirer would not seek out an alternate unit.)
- B. **All of the would-be acquirers would find another unit.** Thus, program participation has no effect on the total number of appliances operating on the grid. This position is consistent with the notion that participating appliances are necessities and that customers will always seek alternative units when participating appliances are unavailable.
- C. **Some of the would-be acquirers would find another unit, while others would not.** This possibility reflects the awareness that some acquirers were in the market for an appliance and would acquire another unit, while others were not (and would only have taken the unit opportunistically).

The evaluators will assume Possibility C unless primary research within a Program Administrator's service territory to assess the secondary appliance market is undertaken as described in the Enhanced Options below. Specifically, evaluators will assume that half (0.5, the midpoint of Possibilities A and B) of the would-be acquirers of avoided transfers found an alternate unit.

Once the proportion of would-be acquirers who are assumed to find alternate units is determined, the next question is whether the alternate unit was likely to be another used appliance (similar to those recycled through the program) or, with fewer used appliances presumably available in the market due to program activity, would the customer acquire a new standard-efficiency unit instead.


#### 4.2.1.2 Integrating Free Ridership and Secondary Market Impacts

The flow chart shown in Figure 4-2 illustrates how net savings will be derived for an ARP. As shown, below, expected savings fall into three different scenarios.

---

<sup>66</sup> Note that such retailer interviews are being conducted annually for the ComEd ARP evaluation, and answers are used directly in the calculation of the NTG ratio in cases where: (1) the respondent planned to have the unit picked up by the retailer; and (2) the retailer was interviewed.

Figure 4-2. Appliance Retirement Scenarios

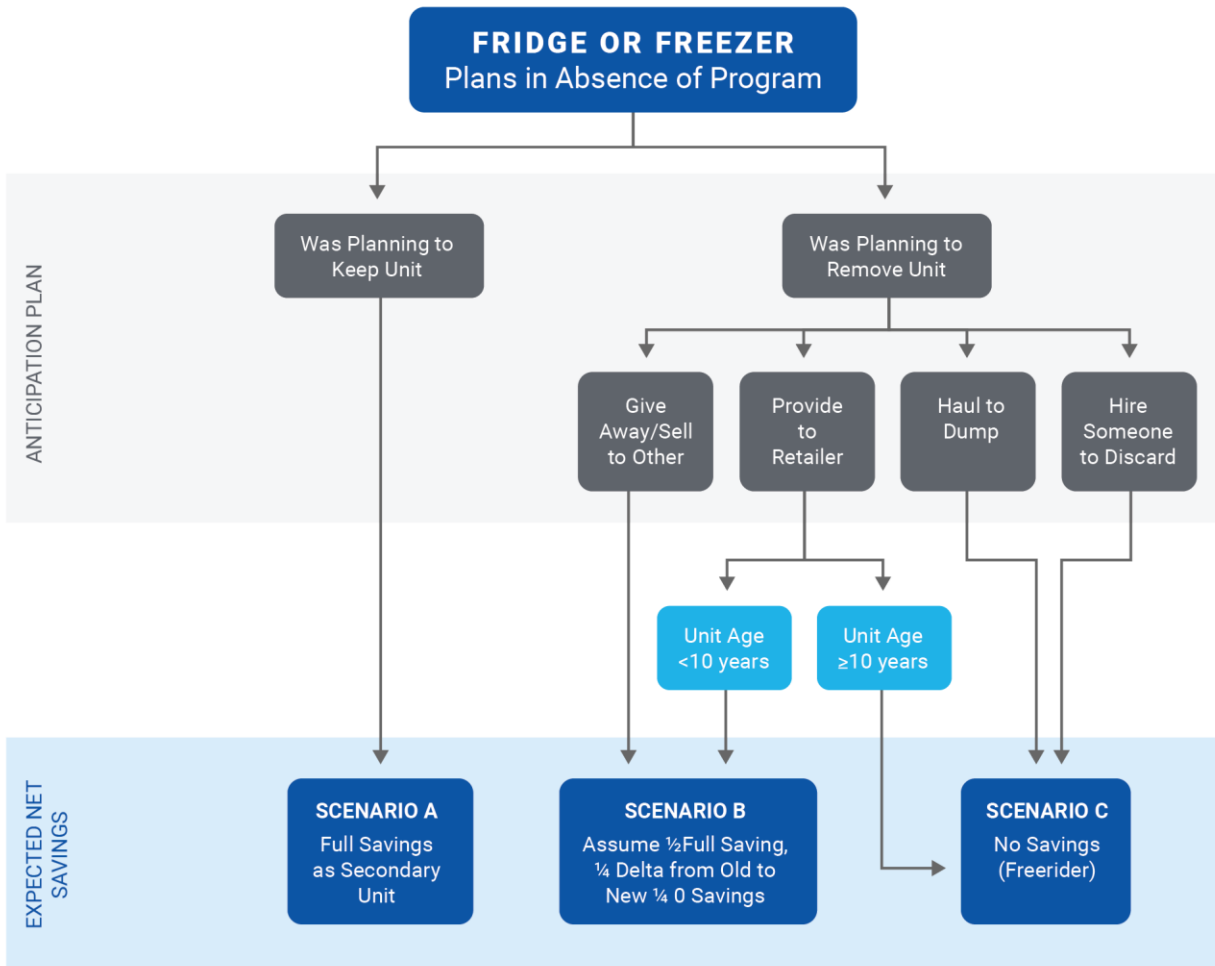

Source: Adapted from the Pennsylvania Statewide Evaluator Common Approach for Measuring Net Savings for Appliance Retirement Programs, Guidance Memo-026, March 14, 2014.

4.2.1.3 Scoring Algorithm

Net savings will be assigned individually to each respondent, based on responses provided to the questions discussed above. Net savings will be averaged across all respondents to calculate program-level net savings. The following equation will be used:

$$FR = (\text{free ridership and secondary market impacts \%} - \text{induced replacement \%})$$

Table 4-4 demonstrates the proportion of a sample population classified into each of the eight potential (Tertiary Classification) categories and the resulting weighted net savings.

Table 4-2. Net Savings Example for a Sample Population\*

Primary Classification	Secondary Classification	Tertiary Classification	Population (%)	UEC (kWh) w/out Program	UEC (kWh) w/ Program	kWh Savings
Would have kept unit	Scenario A: Kept No Induced Replacement	N/A	25%	1,026	0	1,026
Would have	Scenario B:	N/A	30%	1,026	520	506

Primary Classification	Secondary Classification	Tertiary Classification	Population (%)	UEC (kWh) w/out Program	UEC (kWh) w/ Program	kWh Savings
<b>removed unit</b>	Transferred No Induced Replacement					
	Scenario C: Removed from Service	Recycled/ Destroyed	20%	0	0	0
		Retailer would Recycle	13%	0	0	0
<b>Net Savings (kWh)</b>						475

\*The percent values presented in this table serve only as examples; actual research should be conducted to determine the percentage of units falling into each of these categories. Note that UEC (Unit Energy Consumption) values presented in the table represent example values, factoring in part-use.

#### 4.2.2 Enhanced Method

Results can be enhanced by including three additional research efforts. The basic method has defaults where primary research on enhanced approaches cannot be performed:

1. A retailer survey, to determine the quantity and/or proportion of units returned to a retailer and that the retailer would deconstruct or recycle. Through this survey, one would determine a retailer’s criteria for reselling used units vs. deconstructing them, based on unit age and condition. Results from the survey and analysis would be used to determine the proportion of those who would have returned an old appliance to the retailer that should be included in Scenario D (free riders). This research was conducted for ComEd in EPY6 evaluation and those results were applied to Ameren.
2. An appliance market assessment study to determine the size of the secondary appliance market and whether removal of participating units from the market would cause an otherwise would-be receiver to purchase an alternative used or new unit. Savings attributable to these participants are the most difficult to estimate, as the scenario attempts to estimate what the prospective buyer of a used appliance would do in the absence of finding a program-recycled unit in the marketplace (i.e., the program took the unit off the grid, so the prospective purchaser faced, in theory, a smaller supply of used appliances). It is difficult to answer this question with certainty, absent Program Administrator-specific information regarding the change in the total number of appliances (overall and used appliances specifically) that were active before and after program implementation. In some cases outside of Illinois, evaluators have conducted in-depth market research to estimate both the program’s impact on the secondary market and the appropriate attribution of savings for this scenario. Although these studies are imperfect, they can provide Program Administrator-specific information related to the program’s net energy impact. Where feasible, evaluators and utilities should design and implement such an approach. Unfortunately, this type of research tends to be cost-prohibitive, or the necessary data may simply be unavailable.
3. However, it is possible to estimate through nonparticipant surveys which of the disposal responses given by nonparticipants were most likely to have been to an opportunistic would-be-acquirer. Transfers that would most likely have been opportunistic are determined primarily based on the cost to the recipient. If the appliance was sold or transferred to a retailer, there would have been a cost to the recipient of that appliance. If the recipient was willing to pay for the appliance or was willing to exert the effort to visit a retail location, this suggests the recipient was actively seeking an appliance. However, if the unit were given away for free, there was little cost to the recipient and it is a reasonable proxy for the proportion of opportunistic acquirers. This proportion would replace the 50% default assumption (scenario C in Figure 4-2) of would-be-acquirers that would or would not find an alternate unit.
4. A nonparticipant survey can be used to assess how nonparticipants acquire and dispose of used units. As nonparticipants do not have the same perceived response bias as participants, they can help offset some of this potential bias in estimating the true proportion of the population that would have recycled their units in program’s absence. The evaluators will average the results of the nonparticipant survey with the participant survey if the nonparticipant survey is of sufficient sample size. Otherwise, results may be used

for a qualitative characterization of potential bias. Though recommended, use of a nonparticipant survey need not be required, given budget and time considerations. A nonparticipant survey was completed as part of ComEd’s EPY6 evaluation and used qualitatively to validate participant results.

### 4.3 Residential Upstream Lighting Protocol

The Illinois Residential Upstream Lighting programs to date have provided discounts on efficient lighting through retailers at the point of purchase. Such programs often remain transparent to customers purchasing incentivized lighting. Program administrators also do not know the identity of most customers purchasing the program-discounted lighting; so these customers cannot easily be contacted once they leave the store for a traditional self-report NTG evaluation survey (i.e., an after-the-fact, direct solicitation of customers regarding what they would have done in the program’s absence). Similar surveys can be conducted with customers within program retailers after they have made their lighting purchasing decision but before they leave the store. For programs such as this, in store customer surveys are preferable to the traditional self-report telephone surveys that ask customers to recall their past light bulb purchases. Light bulbs are a small and relatively insignificant purchase for most people, thus the recall bias could be substantial.

Further, as upstream programs work with multiple market actors and can include wide-reaching marketing campaigns promoting energy efficiency to the general public, they tend to stimulate spillover and “market effects.” As a result, estimating NTG for upstream residential lighting programs can be challenging. Multiple methods exist, each with their own strengths and weaknesses.

Ameren and ComEd implement their residential lighting programs comparably, and the evaluation teams have used a consistent primary NTG evaluation method. This section details the consensus NTG methodology, which has been used multiple times for both ComEd and Ameren and is considered the most well-vetted and defensible NTG method that has been successfully used in Illinois.

For EPY5 and EPY6, Ameren and ComEd used a customer self-report methodology to estimate NTG for their upstream residential lighting programs.<sup>67</sup> Customer self-report data in this method are collected during surveys conducted within program retailers with customers purchasing program bulbs (i.e., in-store intercept surveys). This method separately estimates free ridership, participant spillover, and nonparticipant spillover. Details follow on the primary data collection and scoring algorithms.

#### 4.3.1 Basic Method

##### 4.3.1.1 Free Ridership

Free ridership for this program is calculated as the proportion of program bulbs that would have been purchased if the program did not exist. Three alternative scenarios could occur:

1. Full Free Rider: The customer would have purchased the same quantity of efficient bulbs (CFLs or LEDs) in the program’s absence.
2. Partial Free Rider: The customer would have purchased fewer efficient bulbs (CFLs or LEDs) in the program’s absence.
3. Non-Free Rider: The customer would have not purchased any efficient bulbs (CFLs or LEDs) in the program’s absence.

Free ridership is calculated as the average of two distinct scores: a Program Influence Score and a No-Program score. These scores are defined as follows:

1. The Program Influence Score captures the maximum level of program influence, reported by a survey respondent, of the residential lighting program on their decisions to purchase program bulbs on the day of the survey. This program influence can take a number of forms, such as: the monetary incentive provided to decrease the cost of high-efficiency bulbs; program-sponsored educational materials that explain the

---

<sup>67</sup> ComEd has used this method since EPY2. Ameren began using it in EPY5.




benefits of efficient lighting; in-store product placement of efficient bulbs; and program bulb recommendations provided by retail store personnel.

2. The No-Program Score is used to estimate how many program bulbs a survey respondent would have purchased in the absence of the residential lighting program.

Figure 4-3 illustrates the scoring algorithm for Residential Upstream Lighting Free Ridership via In-Store Intercepts.

**Figure 4-3. Residential Upstream Lighting Free Ridership via In-Store Intercept**

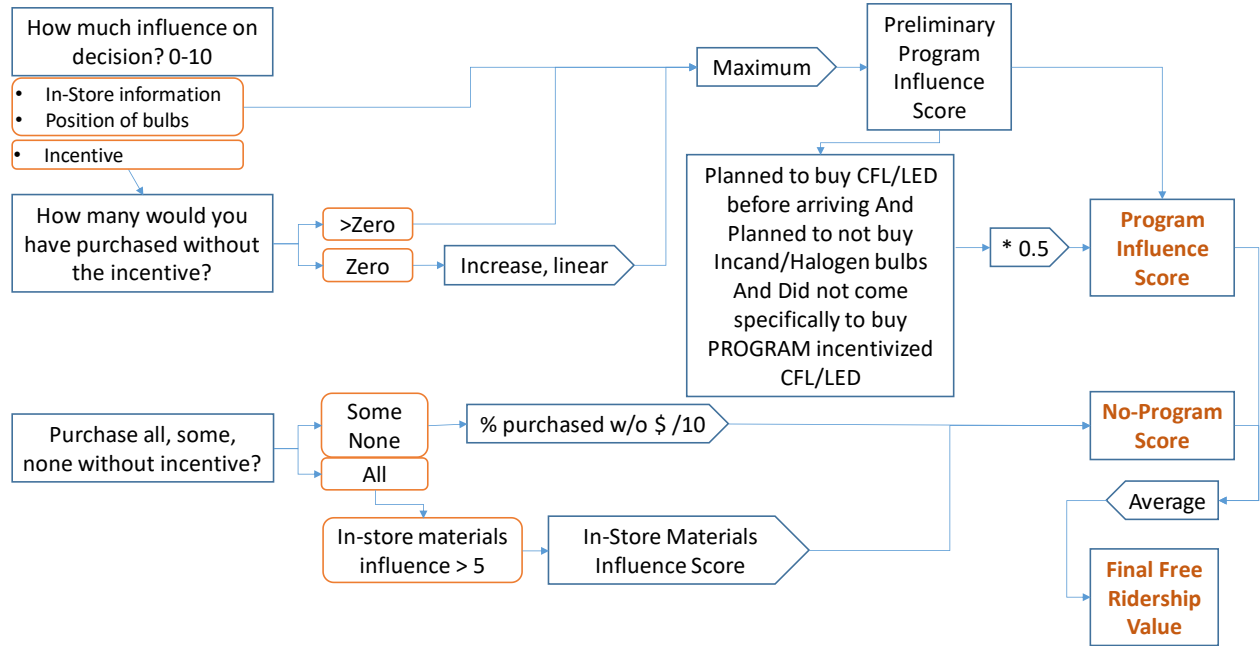

#### 4.3.1.2 Data Collection

To estimate free ridership, the evaluation teams will conduct in-store intercept surveys with customers purchasing program-discounted lighting at participating retailers. Customers are asked questions that are used to estimate a Program Influence Score and a No-Program Score for each customer and efficient bulb type purchased.

##### Primary Program Influence Score Questions

1. Light bulb purchasing plans for current shopping trip (Yes/No)
2. If planning to purchase bulbs:
  - a. Bulb type (CFL, LED, Incandescent, Halogen)
  - b. Program administrator-incentivized bulbs (Yes/No)
3. Influence of various program factors:
  - a. Program incentive
  - b. In-store information (printed materials or information from Program Administrator representatives or retail personnel)
  - c. Positioning of discounted bulbs within the store

##### Primary No-Program Score Questions

1. Stated preference of light bulb purchases had the Program Administrator incentive not been available (purchase all, some, or none of efficient bulbs)
2. Quantity of light bulbs purchased absent the incentive

#### 4.3.1.3 Scoring Algorithms

Using the data collected from program participants during the in-store intercept surveys, Program Influence and No-Program Scores are calculated for each survey respondent and then combined to estimate a respondent-specific Free Ridership Score.

##### 4.3.1.3.1 Calculation of the Program Influence Score

Survey respondents purchasing one or more program-discounted bulbs are assigned a Preliminary Program Influence Score based on the maximum program influence level (on a 0 to 10 scale) they assigned to one or more program factors (e.g., monetary incentive/informational materials [printed or from store personnel]/product positioning). The influence level assigned to the monetary incentive should be increased for survey respondents (using a linear decreasing function)<sup>68</sup> who indicated that, absent the incentive, they would not have purchased any of the program bulbs they were purchasing that day.

After the Preliminary Program Influence Score is assigned, a secondary algorithm is run that adjusts the preliminary program influence based on survey data regarding the customers purchasing plans when they entered the store. Survey respondents who indicated they planned to purchase high-efficiency bulbs prior to entering the store and who had not come to the store specifically to buy Program Administrator-incentivized program bulbs, should have their Program Influence Score cut in half. This adjustment makes the final Program Influence Score reflective of their stated planned intention to purchase efficient bulbs in the program’s absence.

##### 4.3.1.3.2 Calculation of the No-Program Score

The No-Program Score is based on whether a respondent states they would have purchased all, some, or none of the program-discounted bulbs in the absence of Program Administrator incentives. Respondents reporting they would have purchased all of the efficient bulbs without the incentive should be considered free riders and receive a No-Program Score of zero. Those reporting they would have purchased none of the efficient bulbs without the incentives should be classified as non-free riders and receive a No-Program Score of 10, the maximum. Respondents reporting they would have purchased some of the efficient bulbs without the incentive should be assigned a No-Program Score between 0 and 10, reflective of the percentage of efficient bulbs they would not have purchased absent the program.

Respondents reporting they would have purchased all of the program-discounted bulbs in the program’s absence, but in-store materials provided by the Program Administrator had a moderate to high influence on their decision, should have their No-Program Scores adjusted to equal the level of influence they attributed to these program-sponsored informational materials.

#### 4.3.1.4 Calculation of Free Ridership

The Free Ridership rate is calculated as follows:

$$\text{Free Ridership} = 1 - (\text{Program Influence Score} + \text{No-Program Score})/20$$

Using the calculated Program Influence and No-Program Scores, Free Ridership is calculated as one minus the sum of the two scores (Program Influence Score plus No-Program score), divided by 20. Dividing the sum of scores by 20 results in a ratio (between 0 and 1) that is representative of the average of the two zero to 10 scores. Subtracting this ratio from one reverses the score, thus representing the free ridership level. If either the No-Program or Program Influence Scores are missing, Free Ridership can be calculated using the single available score divided by 10. Evaluators may also reference available data to perform documented modifications to individual free ridership estimates resulting from the application of this free ridership assessment methodology.

### 4.3.2 Participant Spillover

For this program, participant spillover results from purchases of non-discounted efficient bulbs by program bulb

<sup>68</sup> The function, adjusted monetary score = (monetary score + 10)/2, increases the monetary score using a decreasing linear function. This function results in an increase in the monetary influence score of between 0 and 5 points depending on their original monetary score (i.e., an original score of 0 would become a 5, a 5 would become a 7.5, and a 10 would remain a 10). In past Illinois evaluations, this adjustment has typically changed less than 10% of all monetary scores.

purchasers who are influenced by their participation in the residential lighting program to purchase additional non-discounted efficient bulbs.

4.3.2.1 Data Collection

Data collected during in-store intercept surveys with customers purchasing program bulbs should be used to estimate participant spillover. During these surveys, customers purchasing program-discounted and non-discounted efficient bulbs (CFLs or LEDs) should be asked questions to determine whether the residential lighting program influenced their purchases of non-discounted efficient bulbs.

**Primary Program Influence Score Question**


1. Influence of the lighting program or in-store information on the customer’s decision to purchase non-discounted CFLs or LEDs. (0 to 10 scale where 0 is not at all influential and 10 is extremely influential)

4.3.2.2 Scoring Algorithm

To estimate participant spillover, the number of program-influenced, non-discounted efficient bulbs (CFLs or LEDs) purchased by program participants is divided by the total number of program bulbs purchased by these program participants. This results in the Participant Spillover Rate.

**Step 1:** Estimate the total number of non-discounted energy efficient bulbs purchased by respondents that had also purchased program-discounted bulbs and were influenced by the program. Respondents who gave a rating of greater than 5 on the program influence question are considered to be influenced by the program.

Figure 4-4 below provides a visual depiction of the process of qualifying non-discounted bulbs as participant spillover bulbs.

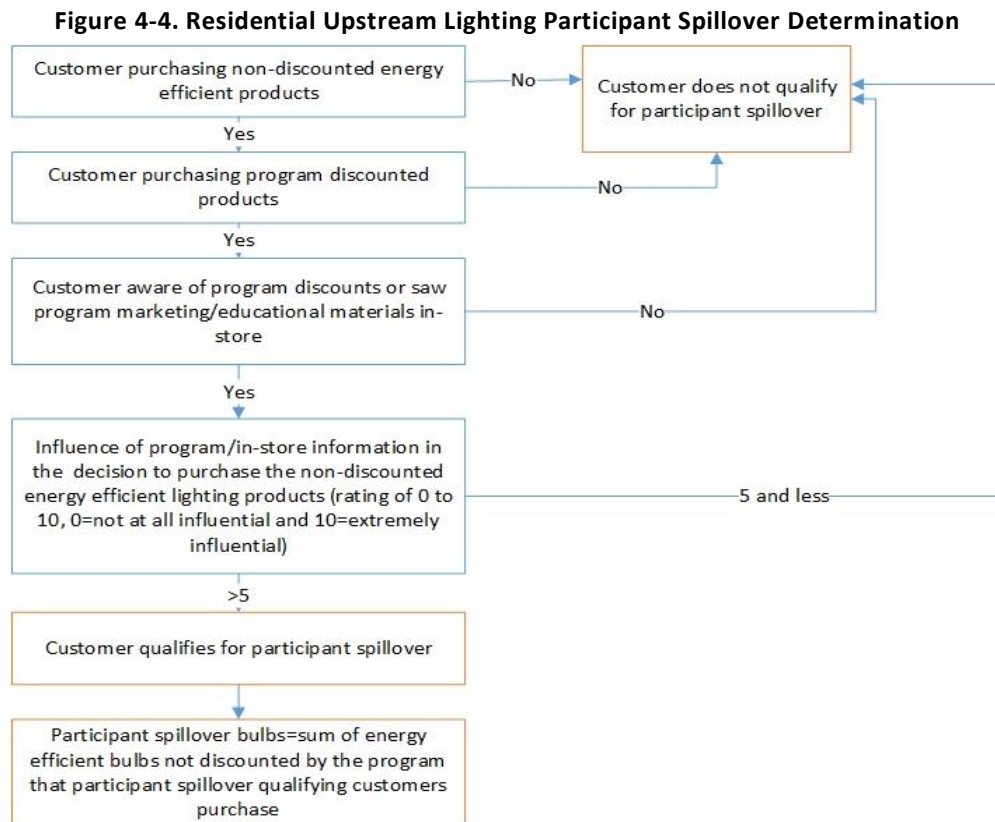

**Step 2:** Calculate the total number of program-discounted bulbs purchased by summing the number discounted bulbs purchased by all respondents.

**Program Bulb Purchases** = sum(Number of Discounted CFLs or LEDs purchased)

**Step 3:** Calculate the spillover rate by dividing the total number of spillover bulbs purchased by the total number of program-discounted bulbs purchased.

$$\text{Spillover Rate} = \text{Spillover Purchases} / \text{Program Purchases}$$

### 4.3.3 Nonparticipant Spillover

Nonparticipant spillover results from purchases of non-discounted efficient bulbs by customers who are not purchasing program-discounted bulbs, but report that the residential lighting program influenced their decision to purchase non-discounted efficient bulbs.

#### 4.3.3.1 Data Collection

Data collected during in-store intercept surveys with customers purchasing efficient bulbs not discounted by the program should be used to estimate nonparticipant spillover. During these surveys, customers purchasing non-discounted efficient bulbs (CFLs or LEDs) and not purchasing any program-discounted bulbs should be asked questions about awareness of the program discounts and point-of-purchase program marketing and educational materials. These questions are used to determine whether the residential lighting program influenced their purchases of non-discounted efficient bulbs.

#### Primary Program Influence Score Question

1. Influence of the lighting program or in-store information on the customer’s decision to purchase non-discounted CFLs or LEDs. (0 to 10 scale where 0 is not at all influential and 10 is extremely influential)

#### 4.3.3.2 Scoring Algorithm


The nonparticipant spillover scoring algorithm involves estimating the total number of nonparticipants, the incidence of nonparticipants in the sample, the total number of nonparticipant spillover bulbs, and the average number of nonparticipant spillover bulbs per customer in the sample, and then extrapolating the sample estimates to the population of the utility customers. Below are the steps used to calculate the nonparticipant spillover rate.

Step 1. Determine nonparticipant spillover in the sample by following the steps outlined below.

- A. Determine the total number of nonparticipating customers in the survey sample:  
*Nonparticipating customers (survey) = customers who did not purchase any program-discounted energy efficient lighting products. These customers may have purchased non-discounted energy efficient lighting products, less efficient lighting products or both.*
- B. Determine the incidence of nonparticipating customers in the survey sample by dividing nonparticipating customers by total customers in the sample:  
*Incidence of nonparticipating customers (survey) = Nonparticipating customers (survey) / total customers (survey)*
- C. Determine total number of nonparticipant spillover bulbs by summing CFLs and LEDs not discounted by the program that were purchased by nonparticipating customers who were aware of the program discounts or marketing promoting energy efficient lighting and were influenced by it. Spillover qualifying bulbs are those purchased by customers who rate the program’s influence as greater than 5. The graphic below provides a visual depiction of the process of qualifying non-discounted products as spillover products.

Figure 4-5 below provides a visual depiction of the process of qualifying non-discounted bulbs as nonparticipant spillover bulbs.

**Figure 4-5. Residential Upstream Lighting Nonparticipant Spillover Determination**

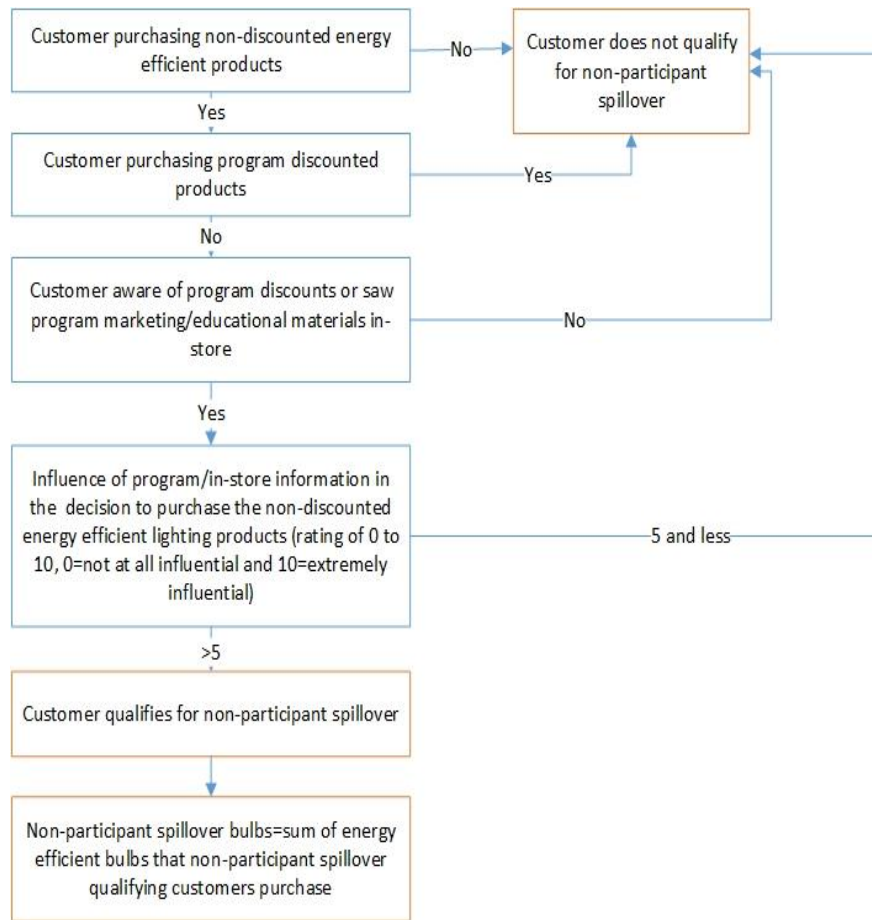

- D. Determine the average number of non-participating spillover bulbs per non-participating customer by dividing the total number of non-participating spillover bulbs in the survey by the total number of non-participating customers in the survey.

*Average number of nonparticipating spillover bulbs (survey)=total number of nonparticipating spillover bulbs (survey)/nonparticipating customers (survey)*

Step 2. Extrapolate nonparticipant spillover to the population

- A. Determine the total number of nonparticipating customers in the population by applying the nonparticipant incidence rate from the sample to the population

*Total number of nonparticipating customers (population)=Utility residential customer count\* incidence of nonparticipating customers (survey)*

- B. Determine the total number of spillover bulbs by multiplying the average number of spillover bulbs per nonparticipating customer in the survey by the total estimate of nonparticipating customers

*Total number of nonparticipating spillover bulbs=Average number of nonparticipating spillover bulbs (survey)\*total number of nonparticipating customers (population)*

Step 3. Calculate nonparticipant spillover rate by dividing the total number of nonparticipant spillover bulbs in the population by the total number of program-discounted bulbs:

*Nonparticipating spillover rate=total number of nonparticipating spillover bulbs/total number of program discounted bulbs*

#### 4.3.3.3 Method Advantages and Disadvantages

The in-store intercept method described above has certain advantages and disadvantages.

**Advantages:** This approach catches customers at their point of purchase, before they leave the store and can no longer be contacted directly. Given the interview’s timing, customers can more easily recall price factors leading to their purchase choices. Also, as customers are intercepted at the store rather than surveyed by telephone, a higher cooperation rate results.

**Disadvantages:** Customers may not fully connect the impact that in-store education, product placement, and advertising have on their decision making. While many consumers believe they are not influenced by advertising, retailers know advertising and product placement work. Further, store intercepts typically must be coordinated with education events, and many retailers do not allow interviews to take place in their stores. Consequently, results are not based on random samples of customers purchasing program-discounted lighting throughout the year and across all participating retailers, which could bias the results.

### 4.4 Prescriptive Rebate (With No Audit) Protocol

Prescriptive Rebate programs typically offer predetermined rebates to residential customers for purchasing measures such as high-efficiency furnaces, clothes washers, brushless/electronically commutated motors (ECMs), boilers, boiler reset controls, water heaters, air-source heat pumps (ASHPs), ground-source heat pumps (GSHPs), central air conditioners (CACs), programmable thermostats, smart thermostats, insulation, air sealing, duct sealing, and desktop power management software. The program may require installation by a registered program ally, but it does not require a home audit (although purchases may be made in response to an audit).

These programs encourage consumers to undertake the following:

- Purchase higher-efficiency equipment than they otherwise would have, had they shopped for such equipment at the same time (replace on burnout); and
- Replace operating but inefficient equipment with higher-efficiency equipment (early replacement).

The basic method for estimating free ridership and participant spillover (See Section 4.1.2) for these programs uses a participant self-report, based on a standard battery of questions. An enhanced method may utilize trade ally surveys to provide another quantitative assessment, which may be triangulated with the basic method approach. As discussed further in Section 5.2, trade ally surveys may also be used to assess nonparticipant spillover.

#### 4.4.1 Basic Method

##### 4.4.1.1 Free Ridership


The free ridership assessment battery is brief to avoid applying an undue survey burden, yet it seeks to reduce self-report biases by including two main free ridership components:

- A Program Influence component, based on the participant’s perception of the program’s influence on carrying out the energy-efficient project; and
- A No-Program component, based on the participant’s intention to carry out the energy-efficient project without program funds.

When scored, each component assesses the likelihood of free ridership on a scale of 0 to 10, with the two scores averaged and for a combined total free ridership score. As different and opposing biases potentially affect the two main components, the No-Program component typically indicates higher free ridership than the Program Influence component. Therefore, combining these decreases the biases.

Figure 4-6 illustrates the scoring algorithm.

**Figure 4-6. Residential Prescriptive Rebate (With No Audit) Free Ridership**

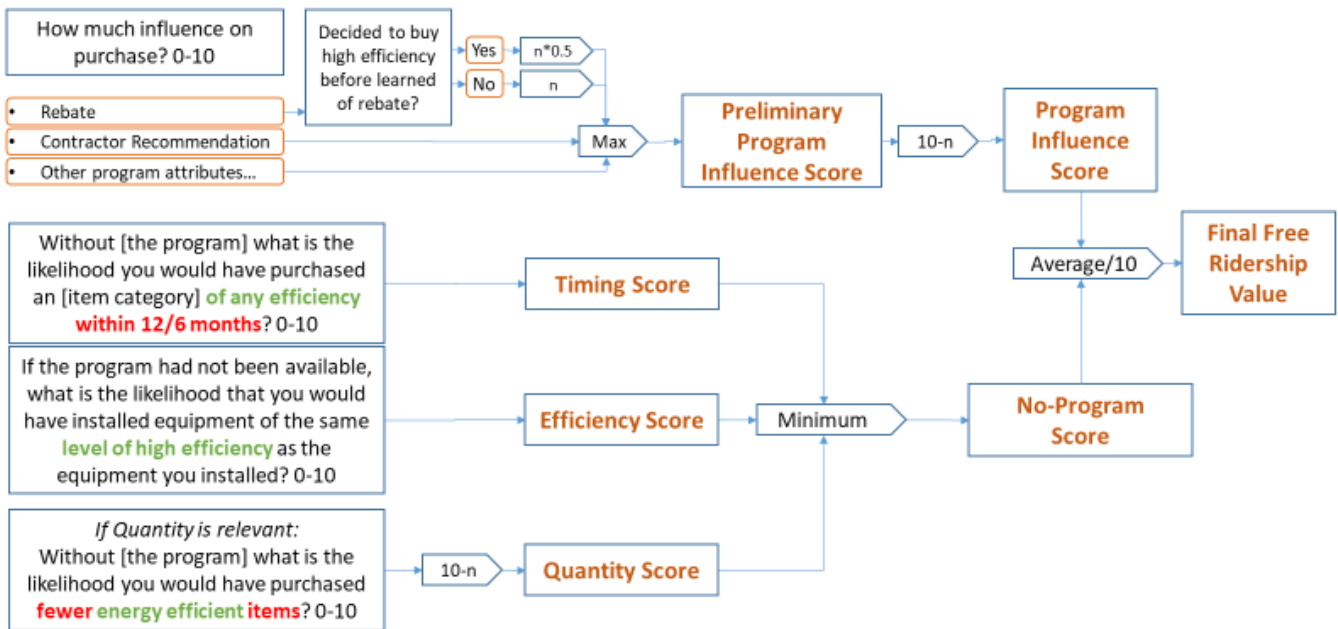

**4.4.1.1.1 Calculation of the Program Influence Score**

Program influence is assessed by asking respondents, on a scale from 0 (not at all important) to 10 (extremely important), how important they found various program elements were on their undertaking the project the way they did. The number of elements included will vary, depending on the program’s design. Logic models, program theory, and staff interviews typically inform the list of elements. Programs typically use the following elements to influence customer behavior: information; incentives or rebates; interaction with program staff (i.e., technical assistance); interaction with program proxies, such as members of a trade ally network; building audits or assessments; and financing.

In addition to asking about specific program influences, surveys ask respondents whether they planned to purchase a high-efficiency version of the product before learning of the rebate program. The respondent’s rating of the rebate’s influence is adjusted by 0.5 for those answering the question “yes.”<sup>69</sup> Evaluators should conduct a sensitivity analysis around the use of this adjustment and present it in the report.

The Preliminary Program Influence Score equals the maximum influence rating for any program element rather than, for example, the mean influence rating. This is based on the rationale that if any given program element had a great influence on the respondent’s action, then the program itself had a great influence, even if other elements had less influence.

An inverse relationship occurs between high program influence and free ridership: the greater the program influence, the lower the free ridership. The Program Influence (PI) Score = 10 - Preliminary Program Influence Score.

**4.4.1.1.2 Calculation of the No-Program Score**

The No-Program (NP) Score is based on three measures of the likelihood of a participant purchasing equipment of the same level of high efficiency as the unit installed with the program at the same time in the absence of the

<sup>69</sup> The Illinois NTG Working Group discussed using this question to check for consistencies rather than adjusting the score. The NTG working group agreed that it is preferable not to directly ask about conflicting language with residential customers and to utilize an open ended question instead to assess possible reasons for conflicting statements. It is the experience of the NTG working group members that residential customers tend to be more impatient with these types of questions and can typically respond easier to an open-ended question about their motivations.

program. Each of these likelihood measures are assessed on a 0-10 scale in which 0 means not at all likely and 10 means very likely.

First, the participant should be asked their likelihood of purchasing an item of *any efficiency* within 12 or 6 months (12 months for a single or big ticket item and 6 months for less expensive items) for the Timing (T) Score. Participants who were influenced by the program to replace still-functioning equipment will likely give a low score to this question, while participants who needed to replace burned out equipment will give a high score. This measure enables the analysis to use a single algorithm for both early replacement and replace-on-burnout scenarios.

Next, the participant should be asked a key question that asks the respondent to gauge their likelihood of purchasing, absent the program, equipment of the same level of high efficiency as the unit installed with the program. This measure forms the Efficiency Score. A respondent stating the likelihood of purchasing an item of the *same level of high efficiency* as a 5 on a scale of 0 to 10 is assigned an Efficiency Score of 5.

If multiple quantities of an item are purchased, the respondent should be asked about the likelihood of purchasing fewer energy-efficient items. The response to this question is subtracted from 10 to compute the Quantity (Q) Score.

The No-Program Score is the minimum of the Timing, Efficiency, and (if applicable) Quantity Scores. Finally, the No-Program Score is averaged with the Program Influence Score to calculate the Final Free Ridership Value.

$$\text{No Program Score (NP)} = \text{Min}(T, E, Q)$$

$$\text{Free Ridership (FR)} = \text{Mean}(PI, NP)$$

#### 4.4.1.1.3 Consistency Checks

To address the possibility of conflicting responses (i.e., low intention score and high influence score), the survey should include consistency checks that, at a minimum, ask participants an open-ended question to address the program’s influence. For example:

- In your own words, please tell me the influence the program had on your purchase of the <insert measure name>.

In this case, the evaluation analyst will assess the response to this open ended question and its consistency with the other questions, and, if warranted based on clear additional information, they will adjust the score based on expert judgement. If an inconsistency exists and the open-ended response does not resolve the inconsistency, the respondent will be removed from the calculation. All instances of this occurring should be documented in the final report. Additional consistency checks, triggered and resolved within the survey with additional questions to participants, remain optional.

Missing responses to specific questions should be treated as “missing” for that particular question, but the observation or case will be retained in the analysis. Evaluation reports should note if this affects more than 5% of the responses.

## 4.5 Single-Family Home Energy Audit Protocol

Single-Family Home Energy Audit programs (or energy assessment programs) seek to secure energy savings for residential customers by providing audits, direct-install measures, and incentives for additional energy efficiency opportunities. The participation process generally begins with an energy audit, performed by a program-affiliated companies or individuals; this involves an auditor assessing the customer’s home to identify energy-saving opportunities. At that time, the auditor may install free instant-savings measures, such as CFLs, low-flow showerheads, and faucet aerators. Auditors also may educate customers about incentives available through the audit program (e.g., air sealing, insulation) or other Program Administrator-sponsored energy efficiency programs.

For these programs, free ridership and participant spillover (See Section 4.1.2) estimates rely on participant self-reports, gathered through surveys.

### 4.5.1 Basic Method

Given the multiple components of some audit programs, net impacts should be estimated using survey batteries



tailored to a customer’s experience (e.g., receipt of free direct-install measures and discounted or rebated measures). The following sections outline the approach for two program components, one dealing with the direct installation of free low-cost measures and a second dealing with envelope measures, such as air sealing and insulation.

#### 4.5.1.1 No-Cost, Direct Install Measures

For free measures directly installed by program staff due to the audit, free ridership calculations should include the following components: Timing, Efficiency, and Quantity.

This approach provides several important benefits, such as deriving a partial free ridership score based on the likelihood that the participant would take similar actions in the absence of the audit. For example, partial scores can be assigned to customers who planned to install the measure, but the program influenced that installation, particularly in terms of timing (e.g., the program might have accelerated the installation) or quantity (e.g., the program might have led to installation of additional program-qualified measures).

Outlines of components and their associated survey questions follow:


- **Timing (T).** The first question to compute the Timing (T) Score accounts for earlier installation of measures due to the program by asking respondents about their likelihood (0-10 scale) to have installed an item *of any efficiency* within 6 or 12 months, had they not received it through the program (12 months for a single or big ticket item and 6 months for less expensive items).
- **Efficiency (E).** This score reflects the likelihood that customers would have installed equipment, absent the program, of the same level of high efficiency as the unit installed with the program. For free measures, this is based on a question asking respondents to rate the likelihood that they would have installed equipment of the same level of high efficiency as the unit installed had they not received them for free through the audit (on a 0 to 10 scale, where 0 is not at all likely and 10 is extremely likely). A higher likelihood value means a higher level of free ridership (i.e., a lower attribution level for the program).
- **Quantity (Q).** The question to compute the Quantity (Q) Score asks respondents about the likelihood that they would have installed fewer measures or performed less weatherization without the program. The response to this question is subtracted from 10 to compute the Quantity Score, as a lower score means a greater likelihood the respondent would have installed the same or a greater number of measures.

Given the low cost of the measures provided through the direct-install component of most audit programs and the number of measures received per participant, efforts have been made to streamline the free ridership battery to reduce the respondent’s burden. As such, the overall Final Free Ridership Value per measure can be calculated by taking the minimum of the Timing, Efficiency, and Quantity Scores, as shown in the following equation:

$$\text{Free Ridership (FR)} = \text{Min}(T, E, Q)$$

Figure 4-7 illustrates the algorithm for no-cost measures.

**Figure 4-7. Single-Family Home Energy Audit Free Ridership—No Cost Measures**

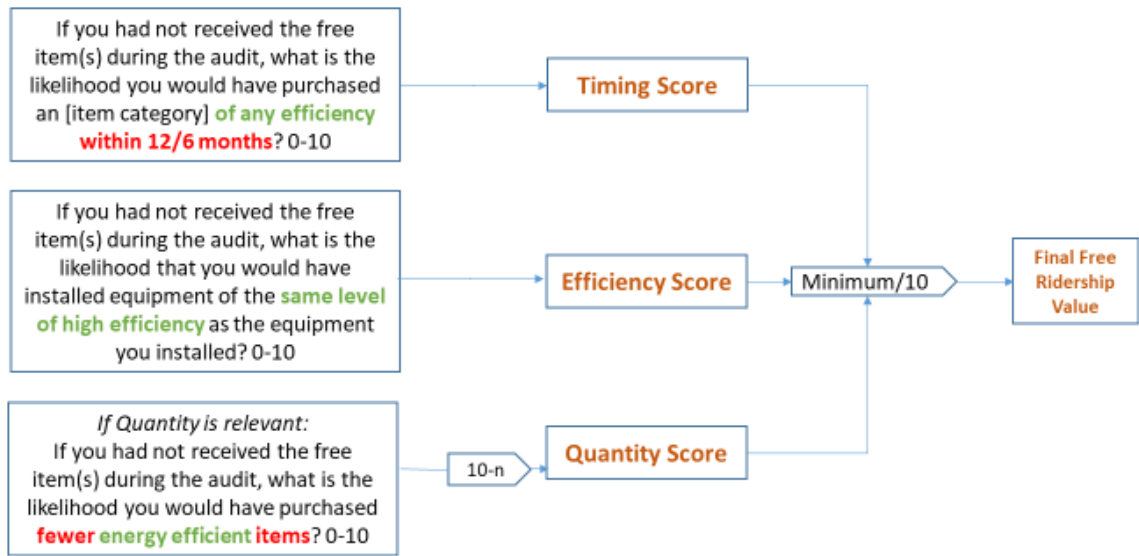


4.5.1.2 Rebated/Discounted Measures

Estimating NTG for rebated measures (typically for building shells) requires a more rigorous process than estimating NTG for free direct-install measures. In particular, the approach integrates an assessment of various program components that may have influenced the participant’s installation of the measures. For discounted envelope measures, the basic free ridership factor consists of the following two components:

- A Program Influence component, based on the participant’s perception of the influence of various program elements—including the discount and the audit itself—on carrying out the energy-efficient project; and
- A No-Program component, based on the participant’s likelihood of purchasing equipment, absent the program, of the same level of high efficiency as the unit installed at installed at the same time.

The free ridership method for discounted measures is identical to that used in the Prescriptive Rebate (With No Audit) protocol, with the one exception that the questions about program influence should be sure to include the audit itself as one of the program attributes. Evaluators should refer to Section 4.4.1.1 for details of the method. Figure 4-8 illustrates the algorithm for discounted measures.

Figure 4-8. Single-Family Home Energy Audit Free Ridership—Discounted Measures

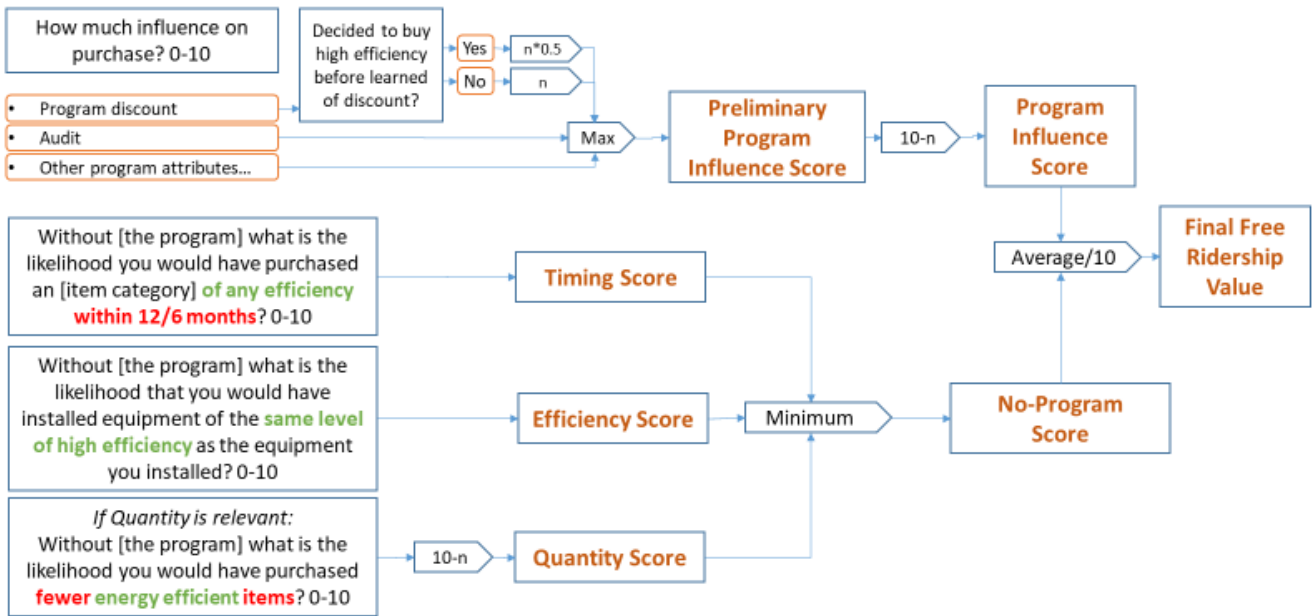

#### 4.5.1.3 Consistency Checks

To address the possibility of conflicting responses (e.g., the high likelihood to install the same measure in the program’s absence and the high importance of program factors), the survey should include consistency checks that, at a minimum, ask participants an open-ended question to address a program’s influence, such as the following:

- In your own words, please tell me the influence the program had on your purchase of the <insert measure name>.

For low or no-cost, direct-install measures, surveys should include two questions to assess a program’s influence on the respondent. The first should be asked at the beginning of the NTG battery, and the second should be asked at its conclusion. Questions include the following:

- Prior to the audit, had you purchased any <measures>? Y/N
- IF YES AND LIKELIHOOD TO INSTALL WITHOUT THE PROGRAM IS <7: Given that you had purchased <measures> before receiving the audit, why didn’t you purchase additional <measures> on your own without the program? [OPEN END]
- IF NO AND LIKELIHOOD TO INSTALL WITHOUT THE PROGRAM IS >6: Given that you have not purchased <measures> before, why were you likely to purchase <measures> on your own without the program? [OPEN END]

In both cases, the evaluation analyst will assess responses to open ended questions and their consistency with the other questions; if warranted, based on clear additional information, the evaluator will adjust the original question score if required. If inconsistency occurs and the open-ended response does not resolve it, the original question response will be removed from the calculation. Final reports should document all instances of such adjustments. Optionally, additional participant questions can be included to trigger and resolve additional consistency checks.

Missing responses to specific questions (e.g., don’t know or refused) should be treated as “missing” for those particular questions, but the analysis retains the observation or case. The evaluation reports should note if this affects more than 5% of responses.

## 4.6 Multifamily Protocol

Multifamily energy efficiency programs typically offer direct installation of low-cost, energy-efficient measures in multifamily dwelling units, in addition to rebates for common area lighting retrofits, air sealing, insulation, and improvements to HVAC systems and controls. These programs have various target audiences from owners, managers, or developers of market rate multifamily housing to those operating lower income or assisted living housing. Across these groups, properties must generally have a minimum of between three and five units to qualify for the programs.

Most multifamily program savings are typically achieved by encouraging customers to install higher-efficiency equipment than they would have installed on their own. However, programs may also encourage early replacement of still functioning equipment that is less efficient, thus impacting the timing of the installation, so that savings is realized earlier. The incentive may also make it more affordable for customers to install a greater number of high-efficiency measures.

The basic method for estimation of free ridership and participant spillover (See Section 4.1.2) for these types of programs is based on participant self-report gathered through surveys. For common area and building shell components of the program, participants are property managers and owners responsible for building maintenance and renovation. However, depending on the program design for the in-unit component of the program and specifically the installation of efficient lighting, participating in the program (i.e., install program measures) may be driven by either property managers/owners or tenants or, potentially, both. This distinction is due to the fact that in some market-rate apartments, the tenant is responsible for decisions related to the installation of program measures, including light bulbs, while this is not common practice in income-qualified or assisted-living settings. For other in-unit measures, such as faucet aerators and low-flow showerheads, evaluators interview property managers/owners regarding program influence, as these measures are typically direct installed by program staff, and there is a limited likelihood of tenants making changes to these features.

### 4.6.1 Basic Method

Estimating NTG for rebated measures requires a more rigorous process than estimating NTG for free direct-install measures. In particular, the approach integrates an assessment of various program components that may have influenced the participant's installation of the measures. For discounted measures, the basic free ridership factor consists of the following two components:

- A Program Influence component, based on the participant's perception of the influence of various program elements—including the discount and the audit itself—on carrying out the energy-efficient project; and
- A No-Program component, based on the participant's likelihood of purchasing equipment, absent the program, of the same level of high efficiency as the unit installed at the same time in the absence of the program.

The free ridership method for discounted measures is identical to that used in the Prescriptive Rebate (With No Audit) protocol, with the one exception that the questions about program influence should be sure to include the audit itself as one of the program attributes. Evaluators should refer to Section 4.4.1.1.1 and 4.4.1.1.2 for details of the method. Figure 4-9 and Figure 4-10 also illustrate the algorithms for CFL/LED and non-CFL/non-LED measures<sup>70</sup>.

---

<sup>70</sup> Evaluators should word the survey questions to reflect whether measures were free or purchased with an incentive.

Figure 4-9. Multifamily Free Ridership—Non-CFL/Non-LED Measures


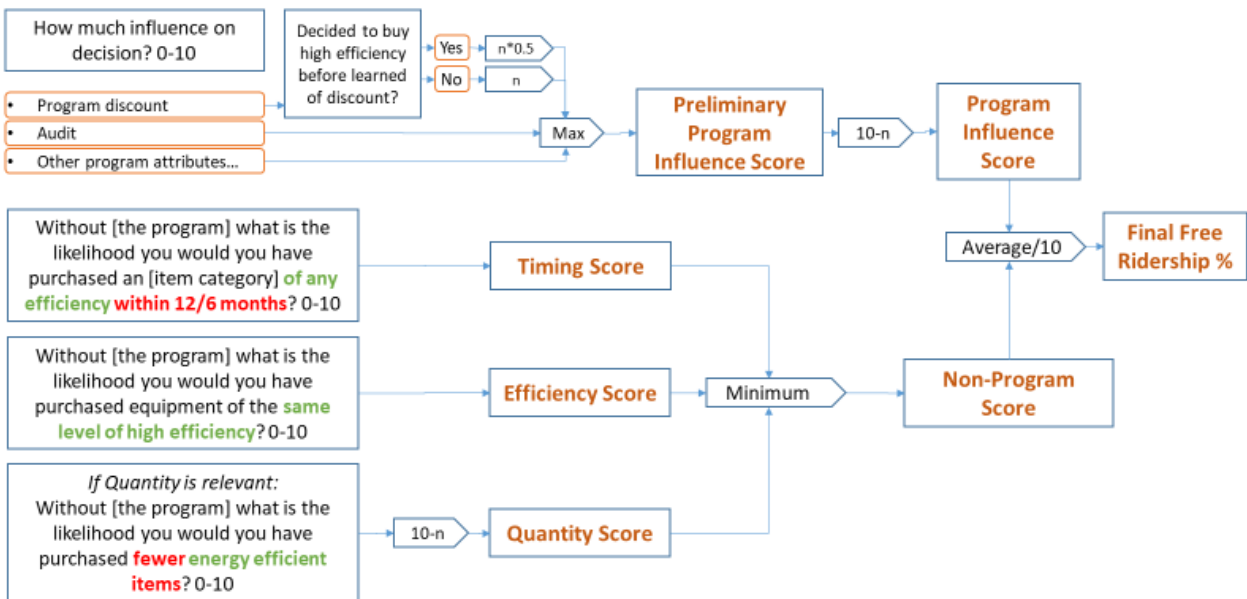


Figure 4-10. Multifamily Free Ridership for Property Managers—CFL/LED Measures

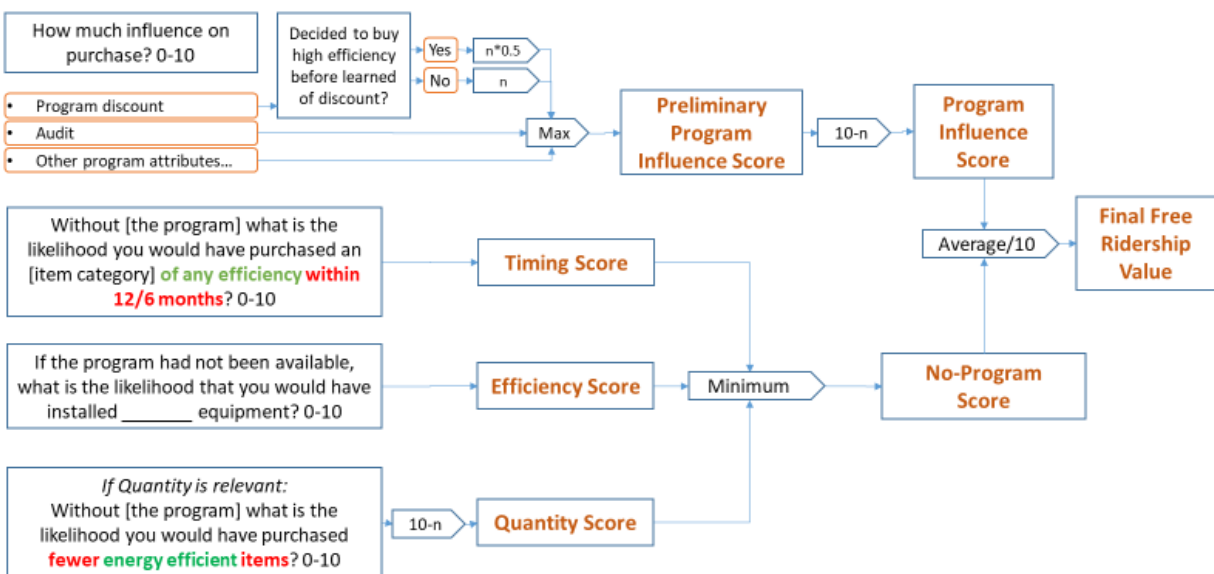

#### 4.6.1.1 Consistency Checks

To address the possibility of conflicting responses (e.g., high likelihood to install the same measure without the program, high importance to program factors), the survey should include consistency checks that, at a minimum, ask participants an open-ended question to address the program’s influence. For example<sup>71</sup>:

<sup>71</sup> Evaluators should word the consistency check questions to reflect whether measures were free or purchased with an incentive.

- In your own words, please tell me the influence the program had on your purchase of the <insert measure name>.

The evaluation analyst will assess the responses to the open ended questions and their consistency with the other survey questions, and, if warranted based on clear additional information, will adjust the original question score. If the open-ended response does not resolve the inconsistency, responses to the original question should be removed from the calculation. The survey may include additional consistency check triggers and resolutions through additional participant questions. The final report should document how often the consistency check rules were triggered, how often adjustments were made to scores, and how often inconsistencies could not be resolved.

Missing responses to specific questions (including don't know or refused) should be treated as missing for that particular question, but the analysis should retain that observation or case. Evaluation reports should note if this affects more than 5% of the responses.

#### 4.6.1.2 Data Collection

A participant survey should be used as the primary source of data collected for estimating free ridership in residential multifamily programs. As discussed, evaluators may field surveys with owners, property managers, or tenants, depending on a program's design and theory. Determining the appropriate audience from which to gather information for estimating free ridership depends on the program's design, and, ultimately, the party responsible for deciding to install specific program measures.


### 4.7 Energy Saving Kits and Elementary Education Protocol

Energy Saving Kits and Elementary Education Programs aim to secure energy savings through the distribution of kits containing various energy-saving measures, including (but not limited to): high-efficiency lighting (CFLs or LED lamps); bathroom and kitchen faucet aerators; and low-flow showerheads. Energy Saving Kits operate as an opt-in program; customers can request a kit by completing an Internet or phone application. Elementary Education Program participants do not request a kit as kits are distributed to all students in a classroom.

Free ridership and participant spillover (See Section 4.1.2) estimations for both programs rely upon participant self-report information gathered through surveys, despite the differences in distribution models. This methodology can be used for other energy-saving kit programs, including kits with alternative distribution methods (e.g., kits dropped off at a participant's home).

The following section contains a description of the basic NTG method used. Figure 4-11 illustrates the method.

**Figure 4-11. Energy Saving Kits and Elementary Education Free Ridership**

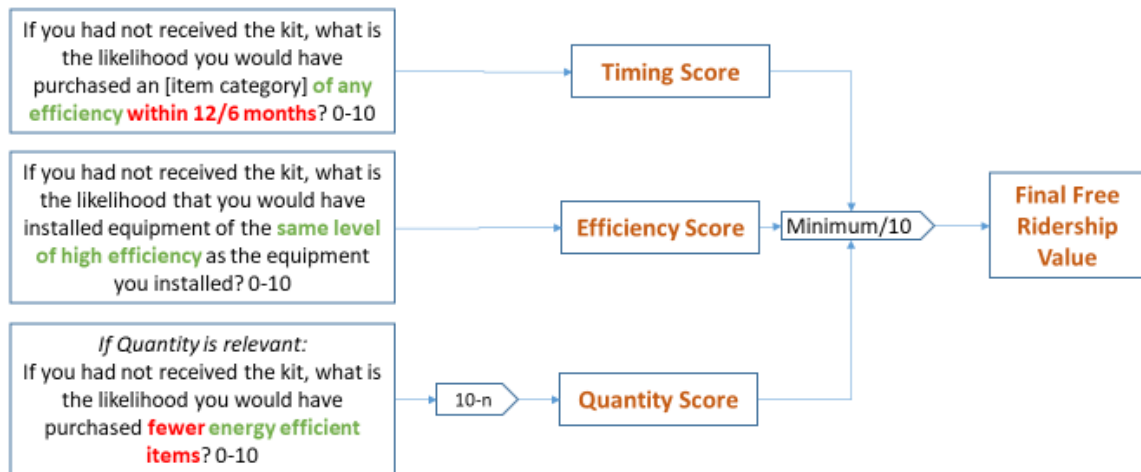

### 4.7.1 Basic Method

Free ridership calculations should include the following components: No-Program, Timing, and Quantity.

This approach provides several important benefits, such as the ability to derive a partial free ridership score based on the likelihood that similar actions would have taken place, even if the participant had not received a kit. For instance, partial scores can be assigned to customers with plans to install the measure, but the program at least influenced that installation, particularly in terms of timing (e.g., the program might have accelerated the installation) or quantity (e.g., the program might have led to the installation of additional measures).

Outlines of components and their associated survey questions follow:

- **Timing (T).** The first question is compute the Timing (T) Score accounts for earlier installation of measures due to the program by asking respondents about their likelihood (0-10 scale) to have installed an item of *any efficiency* within 6 or 12 months, had they not received it through the program (12 months for a single or big ticket item and 6 months for less expensive items).
- **Efficiency (E).** This score reflects the likelihood that customers would have installed equipment of the same level of high efficiency as the unit installed absent the program. This is based on a question asking respondents to rate the likelihood that they would have installed measures of the same level of high efficiency had they not received them for free through the kit (on a 0 to 10 scale, where 0 is not at all likely and 10 is extremely likely). A higher likelihood value means a higher level of free ridership (i.e., a lower attribution level for the program).
- **Quantity (Q).** The question to compute the Quantity (Q) Score asks respondents about the likelihood that they would have installed fewer measures without the program. The response to this question is subtracted from 10 to compute the Quantity Score, as a lower score means a greater likelihood the respondent would have installed the same or a greater number of measures.

Given the low cost of measures provided in the energy-saving kits as well as the number of measures included in each kit, efforts have been made to streamline the free ridership battery to reduce the respondent's burden. As such, the overall Final Free Ridership Value per measure can be calculated by taking the minimum of the Timing, Efficiency, and Quantity Scores, as shown in the following equation:

$$\text{Free Ridership (FR)} = \text{Min}(T, E, Q)$$

Missing responses to specific questions (e.g., don't know or refused) should be treated as "missing" for that particular question. Despite missing responses, the case will be retained in the analysis (pairwise deletion). The evaluation reports should present the percent missing for each of the three questions.

#### 4.7.1.1 Data Collection

Evaluators should use a participant survey as the primary data collection source for estimating free ridership in Energy Saving Kits and Elementary Education Programs. As a general rule, a free ridership rate should be calculated for each separate kit component, and then be weighted by savings to determine the program-level results.

## 4.8 Residential New Construction Protocol

Residential New Construction programs typically offer builder training, technical information, marketing materials, and incentives to builders for the construction of eligible homes. Eligible homes must meet specific standards, designed to achieve energy efficiency levels above local building codes. Programs may use different tiers of standards to meet correspondingly different incentives.

The basic method for estimating free ridership and participant spillover for these programs is based on builder participant self-reporting, gathered through surveys.

The following section describes the basic method used.

### 4.8.1 Basic Method


For this program, a free rider is a builder who would have constructed a home at the program's efficiency level in

the program’s absence. Given the multiple methods available to achieve desired home energy efficiency levels, survey questions consider the builder’s likelihood of meeting the same energy efficiency standard, rather than whether or not the builder would have installed certain energy efficiency measures. Figure 4-12 (below) illustrates the method in more detail.

Evaluators assess Program Influence by asking respondents, on a scale from 0 (not at all important) to 10 (extremely important), how important they found various program elements in deciding to build to specific energy efficiency standards. The number of elements included vary, depending on the program’s design. Logic models, program theory, and staff interviews typically inform the list of program elements included. Programs typically use the following elements to influence builder actions: marketing materials; incentives or rebates; contacts with HERS Raters; and technical assistance.

In addition to asking about specific program influences, surveys should ask builders whether they planned to build homes to the same standard before learning of the program.

**Figure 4-12. Residential New Construction Free Ridership**

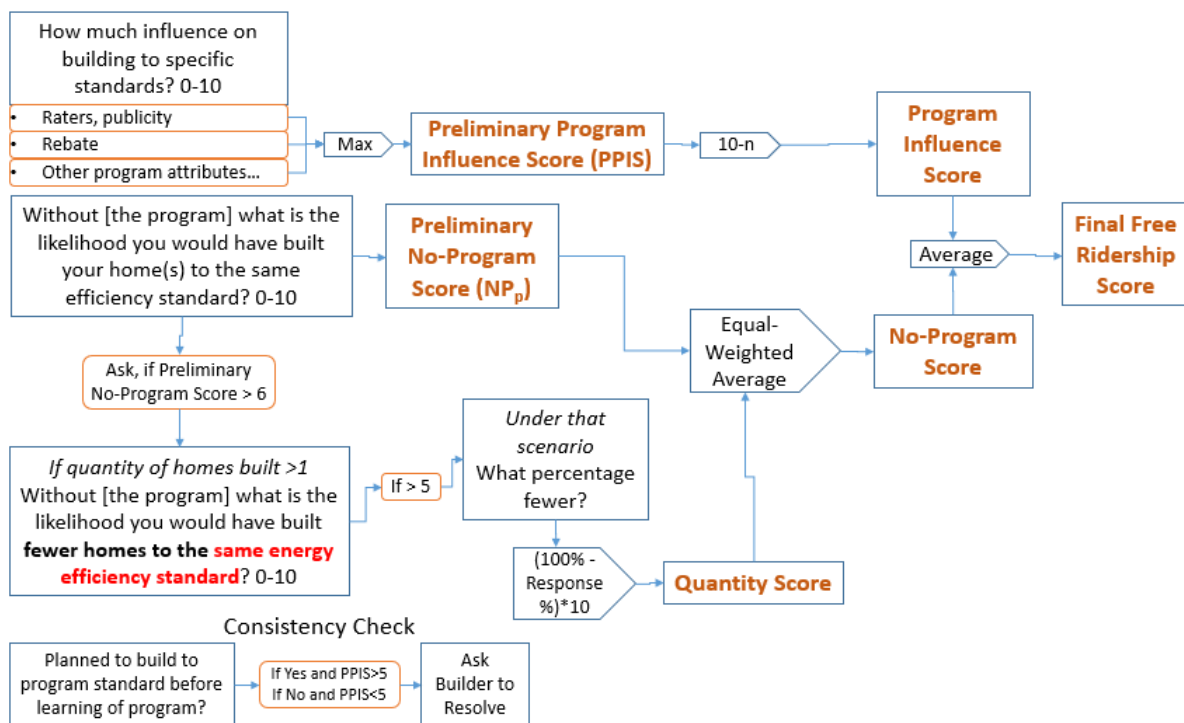

4.8.1.1 Calculation of the Program Influence Score

The Program Influence Score (PI) equals 10 minus the maximum influence rating for any program element rather than, for example, the mean influence rating. This is based on the rationale that if any given program element had a great influence on the respondent’s action, the program itself had a great influence, even if other elements had less influence.

4.8.1.2 Calculation of the No-Program Score

Evaluators calculate the No-Program score using a set of questions that ask respondents to gauge their likelihood of building homes to the same standards and in the same quantities had the program not existed. Three separate responses are considered in calculating the No-Program Score:

- The likelihood, on a scale of 0 to 10, that the builder would have built their homes to the same efficiency standard (Preliminary No-Program Score (NP<sub>p</sub>))
- If that likelihood is greater than 6, the likelihood of fewer homes being built to the same efficiency standard.



- If that likelihood is greater than 6, the response to the question “for that scenario, what percentage of fewer homes would be built to the standard?” (Quantity Score = (100% - % answer) \* 10, which will be a number between 0 and 10)

The resulting No-Program (NP) Score is calculated as follows:

$$NP = Mean(NP_p, Q)$$

The overall Free Ridership Value derives from the average of the PI and NP scores, as shown in the following formula:

$$FR = Mean(PI, NP)$$

#### 4.8.1.3 Consistency Checks

To address the possibility of conflicting responses (e.g., the high likelihood to build to the same efficiency standards without the program, the high importance of program factors), the survey should include, at a minimum, consistency checks that ask participants an open-ended question to address the program’s influence. For example:

- In your own words, please tell me the influence the program had on your building practices.

If a high (>6) Preliminary Program Influence Score (PPIS) results, yet the builder planned to meet the same efficiency standard prior to learning of the program; or if the Preliminary Program Influence Score is lower (<7), and the builder did not plan to build to the standards prior to learning of the program, the survey should include a question to determine why this occurred, using wording that gets at the following inconsistencies:

- IF Preliminary Program Influence Score is >6 and Builder planned to meet the same efficiency standard prior to learning OF THE PROGRAM: Given that you had plans to meet the standard prior to learning about the program, why do you think the <program elements> were influential in your meeting the standard? [OPEN END]
- IF Preliminary Program Influence Score is <7 and Builder had no plans to meet the same efficiency standard prior to learning of the program: Given that you had no plans to meet the standard prior to learning about the program, why do you think the <program elements> were not more influential in your meeting the standard? [OPEN END]

The evaluation analyst will assess the responses to the open ended questions and their consistency with the other survey questions, and, if warranted based on clear additional information, will adjust the original question score. If the open-ended response does not resolve the inconsistency, responses to the original question should be removed from the calculation. The survey may include additional consistency check triggers and resolutions through additional participant questions. The final report should document how often the consistency check rules were triggered, how often adjustments were made to scores, and how often inconsistencies could not be resolved.

Missing responses to specific questions (including don’t know or refused) should be treated as missing for that particular question, but the analysis should retain that observation or case. Evaluation reports should note if this affects more than 5% of the responses.

## 4.8.2 Participant Spillover

Participant spillover occurs when, due to program participation, a builder increases the energy efficiency of homes built outside the program (but inside a utility’s service territory) by adopting certain building practices used in participating homes. Participant spillover can be calculated based on participant builder survey questions that ask builders about homes built within the utility service territory but outside the program. Survey questions ask whether the builder increased the energy efficiency standards of non-program homes after participating in the program, and the number of homes they applied these increased standards to, within the utility’s service territory. Depending on the program characteristics, spillover should be measured as changes in specific building practices or as installation of specific measures. The text below assumes the program has been targeted at modifying building practices.

Spillover may be recorded depending on responses to the following questions:

1. How important was your experience in the <PROGRAM ADMINISTRATOR’S> program in your incorporating this building practice your other homes, using a scale of 0 to 10, where 0 is not at all important and 10 is extremely important?
2. If you had not participated in the <PROGRAM ADMINISTRATOR’S> program, how likely is it that you would still have incorporated this building practice using a 0 to 10, scale where 0 means you definitely WOULD NOT have implemented this practice and 10 means you definitely WOULD have implemented this practice?

Responses to the first question establish the Practice Attribution Score 1, and responses to the second question establish the Practice Attribution Score 2. Spillover may be program-attributable for building practices with self-report data meeting the following condition:

$$\text{Spillover Score} = (\text{Practice Attribution Score 1} + (10 - \text{Practice Attribution Score 2}))/2 > 5.0$$

For responses meeting these conditions, an evaluator determines that specific building practices referenced in the question are attributable to the program; otherwise, the evaluator determines that specific building practices referenced in the question are not attributable to the program. The attribution criteria represent a threshold approach, in which energy impacts associated with building practices program participants implement outside the program are either 100% program-attributable or 0% program-attributable.

For each building practice discussed, builders will be asked how they know the building practice is more efficient than other options. If the respondent can identify the building practice as ENERGY STAR or name an efficiency level that the evaluator confirms as above the minimum federal standard, or if they identify a technology that the evaluator can confirm is above the minimum federal standard, this counts towards participant spillover.

Finally, depending on the building practice cited by the builder, follow-up questions should ask customers to provide reasonable information to allow the evaluator to estimate the amount of savings using IL-TRM protocols, such as quantity of appliances or the location and amount of insulation.

To calculate the spillover energy and demand savings for these actions, further questions should be asked to assess the gross savings of the building practice, through the appropriate version of the IL-TRM, if available, and the number of homes to which it applied. To develop the Spillover Rate, the total energy and demand impacts from the sampled participants who implemented efficient building practices in other homes due to participation in the program is summed, and then this sum is divided by the total ex post sample energy and demand impacts:

$$\text{Participant Spillover Rate (PSO)} = \frac{\text{Sum of Energy or Demand from Additional EE Practices}}{\text{Sample Ex Post Gross Energy or Demand Impacts}}$$

The equation used to adjust the Core NTGR based on participant spillover is as follows:

$$\text{NTGR} = (1 - \text{FR} + \text{PSO})$$

### 4.8.2.1 Sample

The sample for a spillover survey should be a random sample of current and up to one year previous program participants. Regardless of the year of participation, spillover should be measured within the set of homes that were completed within 12 months of the survey date.

### 4.8.3 Builder Nonparticipant Spillover

In addition to participant free ridership and spillover, new construction programs may create NPSO through builders exposed to the program but not actually participating. Rather, they implement some or all of the efficiency measures incorporated through the program in order to compete with builders that are participating.<sup>72</sup> NPSO caused by builders can be determined by surveying two groups of builders:

- “Drop out” builders, who participated in the program previously but have not participated in the past 12 months.
- True nonparticipating builders that report they were aware of the program or that other builders were taking steps to improve new home efficiency, but had never participated.

Surveys ask nonparticipating builders if their knowledge of other builders’ increased focus on energy efficiency influenced their building practices and in what manner, to quantify the program’s impact on nonparticipating homes. The survey questions will first identify specific building practices that go beyond the implemented energy code for the specific jurisdiction in which the builder is active. Table 4-6 lists the latest building energy code in place for most areas of Illinois. Evaluators should make efforts to ensure the building code under enforcement for each jurisdiction is used as the baseline when evaluating spillover savings.

**Table 4-8. IECC 2015 Building Energy Code**

<b>Component</b>	<b>IECC 2015</b>
Thermostat	Heating 72F; Cooling 75F Programmable Thermostat
Ceiling	U-0.026
Walls	U-0.060
Floors	U-0.033
Slab	R-10, 2ft
Windows	U-0.32
Infiltration	5ACH50
Duct Leakage	4CFM/100CFA
Duct Insulation	R-8 Attic Supply, R-6 Otherwise
Heat Pump	8.2 HSPF
Furnace	80 AFUE
<b>Component</b>	<b>IECC 2015</b>
Boiler	82 AFUE
AC	13 SEER
Lighting	75% CFL
Appliances	RESNET Default
Gas Water Heat*	0.58 EF
Electric Water Heat*	0.92 EF

\*EF varies based on water heater storage volume and draw pattern; values in table for 40 gallon water heater with medium draw pattern.

For each component that is more efficient than code, the following additional questions are asked:

1. How many homes did you sell in <period> that incorporated this upgrade?
2. Of these homes, how many would have incorporated this upgrade, had the <program> not existed?

Evaluators should ensure that nonparticipant builders receive sufficient time to collect specific data and not rely on “guesses” to respond. Responses should also clarify whether sales counts are specific to the utility service territory in question.

The following steps calculate the program’s nonparticipant builder spillover percentage:

<sup>72</sup> NPSO also can arise from nonparticipating customers as a direct result of general energy efficiency education and promotion efforts. A separate protocol addresses such NPSO. Care should be taken to ensure the different approaches do not double-count NPSO.

1. Compute the difference between the total reported number of efficiency upgrades sold and the total that would have been sold in the program's absence to obtain the total number of upgrades by type of upgrade for that builder.
2. Multiply the total net number of upgrades of each type sold by each surveyed builder by the average gross unit savings for each upgrade type.
3. Sum the result for each builder from the previous step, and weight the results by the ratio of the population of non-active builders to the sample to compute the total spillover energy over the program period.
4. Divide the spillover energy savings by program gross savings.

Should a general population survey be implemented for nonparticipant spillover, care should be taken to ensure spillover is not double-counted.

## 5 Cross-Sector Protocols

The following sections include protocols that may be applicable to programs in the residential as well as in the commercial, industrial, and public sectors. Table 3-1 Commercial, Industrial, and Public Sector Programs and Table 4-1 Residential and Low Income Programs present information regarding the applicability of these protocols to specific programs.

### 5.1 Combining Participant and Trade Ally Free Ridership Scores

For a program where trade allies play a prominent role in delivering the energy efficiency measure and promoting the program, an estimate of free ridership from trade allies can be combined with one from participants to form a combined free ridership value. Elsewhere, the NTG Protocol (see Section 3.1.1.3) discusses using trade ally surveys to adjust **project-level** free ridership scores. This section discusses combining a **program-level** free ridership score from trade allies with a program-level free ridership score from participants.

If an evaluation uses this approach, the evaluator's NTG report should present the conditions that support the argument that the combined value is more likely to be reflective of reality. That argument should consider the following topics:

1. **Trade Ally Role.** What role do the trade allies play in the program? How were participating trade allies chosen? How might they differ from nonparticipating trade allies? Why does that support the proposition that their view on free ridership is accurate and reasonably unbiased?
2. **Participant Role.** What role do the participants play in deciding which measures are installed and why does that support the proposition that their view on free ridership is accurate and reasonably unbiased?
  - a. For example, the participant's role in the decision **may** be significantly less in some types of programs like new construction or multifamily direct install programs. (The participant free ridership data collection method may already account for this by, for example, treating the building owner as the participant rather than the tenants.)
3. **Market Conditions.** What conditions exist in the market that support the proposition that either the trade allies' view or the participants' view on market behavior may be more accurate?
  - a. For example, if the market was in its infancy before the program began and as a result participants' ability to take the energy efficiency action was limited, the trade allies may have a more accurate view on the counterfactual than the participants.
4. **Bias.** What are the hypothesized biases of the participants and trade allies? Where do they stem from? What evidence is there that they exist? How well has the data collection approach sought to mitigate that bias?
5. **Offsetting Bias.** Do the hypothesized biases of participants and trade allies offset each other, or do they move the free ridership value in the same direction?

#### 5.1.1 Trade Ally Free Ridership Calculation

The NTG protocols do not yet contain a standardized approach for measuring free ridership from trade allies. That approach should be developed for future versions of the TRM. In the meantime, if an evaluation team decides to estimate trade ally free ridership, they should collaborate with other Illinois evaluators on the survey design and calculation algorithm.

#### 5.1.2 Triangulation

Where appropriate, evaluators should combine participant and trade ally free ridership values by weighting each value in the final result. The weighting of each value should be based on considerations of the likely bias, accuracy, and representativeness of the results. The following presents one approach for determining weights. This is an example only. The evaluator should create an approach appropriate for the program.

**Example.** Combined participant and trade ally free ridership results by rating the analysis methodology and data collected using responses (rated on a scale of 0 to 10) to the following three questions:

1. All things being equal, on a scale of 0 to 10, with 0 being not at all likely and 10 being extremely likely, how likely is the approach to provide a more accurate estimate of free ridership?
2. Similarly, on a scale of 0 to 10, with 0 being not at all valid and 10 being extremely valid, how valid and reliable is the data collected and the analysis performed (i.e., consider non-response bias, missing data (e.g., whether data collected was based on recollection or record keeping?)
3. On a scale of 0 to 10, with 0 being not at all representative and 10 being extremely representative, how representative is the sample (accounting for sampling error {confidence and precision}, and non-response bias, and any sample frame bias)?

The weight for each free ridership estimate is the average score for that estimate divided by the sum of the average scores for both estimates.

Table 4-5 provides an example scoring illustrating the calculated weights.

**Table 5-1. Example Triangulation Weighting Approach**

<b>NTG Triangulation Data and Analysis</b>	<b>Participants</b>	<b>Trade Allies</b>
1. How likely is this approach to provide an accurate estimate of free ridership?	6	8
2. How valid is the data collected/analysis?	3	5
3. How representative is the sample?	8	10
Average Score	5.7	9
Sum of Averages	14.7	14.7
Weight	39%	61%

## 5.2 Spillover Measured Through Trade Allies

Many energy efficiency programs rely on trade allies to help spread program awareness and promote energy efficiency among their customers. Some programs establish lists of participating trade allies and provide trade allies with training, education, and/or marketing materials. Spillover might occur when a trade ally’s business practices are influenced by a program but at least some of their energy efficient installations do not receive a program incentive.

For the purposes of measuring trade ally spillover, we define trade allies as (1) retailers, contractors or other market actors who work with end-user customers on the selection and installation of energy-using equipment; and (2) distributors who supply equipment to stores and other market actors, rather than to end-user customers. For the purposes of this section, manufacturers are not included in the definition of trade allies.<sup>73</sup> In addition, we differentiate between the following types of trade allies:

1. Active Trade Allies
  - a. Trade allies who were active in the program during the evaluation period and appear in program tracking databases. The tracking data contains information on the quantity of incented measures associated with these trade allies and their savings;
2. Inactive Trade Allies
  - a. Trade allies who are on the utility’s trade ally list (and have received at least some utility training or education) but who were not active during the evaluation period and do not appear in program savings tracking databases for the evaluation period;
  - b. Trade allies who were previously active in the program (and may have been on the utility’s trade ally list) but have dropped out; and/or
  - c. Trade allies who have never been active in the program and were never on the utility’s trade ally list.

<sup>73</sup> The exclusion of manufacturers from the definition of trade ally does *not* suggest that manufacturers cannot create spillover. Rather, manufacturers are excluded because the methodologies outlined in this section do not apply to them.

When deciding whether to conduct trade ally spillover research, the evaluator should consider the following:

- **Likelihood of trade ally spillover:** When limited evaluation resources are available, the evaluator should weigh the likelihood of trade ally spillover against the cost of the analysis when prioritizing evaluation efforts. E.g., programs that provide incentives, but no training or education are less likely to generate spillover than programs that do provide training or education. Similarly, spillover from active trade allies is generally more likely than spillover from inactive trade allies, and spillover from inactive trade allies who have previously been active in the program is generally more likely than spillover from inactive trade allies who have never been active in the program.
- **Potential double-counting of spillover reported by end-use customers and trade allies:** Spillover from active trade allies and spillover from inactive trade allies are mutually exclusive, i.e., as long as the populations and samples are correctly defined, there is no danger of double-counting spillover from these two groups (see also discussion in Section 2.2). However, if the evaluator measures spillover through trade allies and end-use customers for the same evaluation period, care needs to be taken to avoid double-counting. Evaluators should clearly document potential double-counting of spillover and the steps taken to avoid it.

The following subsections provide suggested approaches for measuring spillover from active and inactive trade allies. Different approaches are outlined for these two groups because of the different types of data available for each of them. For active trade allies, program tracking data contains information on their program activity (the quantity of incented measures associated with each active trade ally and their savings). This data allows for a more rigorous spillover methodology than can be used for inactive trade allies, for whom this information does not exist.

### 5.2.1 Spillover from Active Trade Allies

Trade allies that are active in an energy efficiency program are more likely to create spillover than inactive trade allies, as their exposure to any program messaging and training/education is likely to be current and therefore more influential on their business practices. Active trade allies may create spillover if their program participation changes their business practices and leads to the completion of non-incented energy efficient projects that would otherwise not have happened. For example, as a result of program training, a trade ally might feel more comfortable talking about the benefits of energy efficiency and recommend energy efficient solutions more often. If these recommendations result in energy efficient projects, but no incentive is claimed, spillover from inactive trade allies may be present.

For active trade allies, the spillover methodology varies slightly for downstream programs and midstream programs. Approaches for both types of program are discussed below.

#### 5.2.1.1 Downstream Programs

Surveys can be used to ask active trade allies if the program influenced their sales of high-efficiency equipment to participating or nonparticipating customers and to quantify the program’s impact on their high-efficiency sales. To assess if a sampled trade ally created spillover, the following screening criteria are recommended (the order of these may be adjusted by the evaluator):

1. The percentage of the trade ally’s installations/sales that are high efficiency and/or the total volume of high efficiency installations/sales increased since the trade ally became exposed to the program.
2. The trade ally rated the program as important to at least one of these (as described above) high efficiency installation increases.
3. The trade ally installed/sold at least some high efficiency equipment or products during the evaluation period that did not receive an incentive.
4. The trade ally’s recommendation was influential in the customers’ choice of high efficiency equipment/product over standard efficiency equipment/product in instances where the equipment did not receive a program incentive.
5. The open-ended response about why customers with eligible projects do not receive an incentive supported that the non-incented high efficiency installations can be considered spillover.

Sampled trade allies who do not pass one of the above screening criteria do not qualify for spillover and may be skipped out of the rest of the spillover module.

To quantify spillover for each sampled trade ally, the survey collects information on the percentage of the trade ally’s total equipment installations/sales (in terms of projects or measures) that was (1) standard efficiency, (2) high efficiency that DID receive a program incentive, and (3) high efficiency that DID NOT receive a program incentive. Based on these responses, the share of a trade ally’s high efficiency installations/sales that received an incentive can be calculated as follows:

$$\frac{\% \text{ of TA's High Efficiency Equipment that Received Incentive}}{\% \text{ High efficiency that DID receive a program incentive (2)}} = \frac{\% \text{ High efficiency that DID receive a program incentive (2)}}{\% \text{ High efficiency that DID receive a program incentive (2)} + \% \text{ High efficiency that did NOT receive a program incentive (3)}}$$

With this data, and the trade ally’s savings from the program tracking database, the following equation is used to calculate the savings of high efficiency equipment that did not receive an incentive:

$$\text{Savings of Non-Incented High Efficiency Equipment} = \frac{\text{Savings from Program Database}}{\% \text{ of TA's High Efficiency Equipment that Received Incentive}} - \text{Savings from Program Database} * \text{Size Adjustment}$$

The last term in the above equation is a size adjustment that accounts for the possibility that savings from non-incented projects/measures might be different from incented ones. Information on the relative size of incented versus non-incented projects/measures is also collected in the survey.

Using this approach, spillover savings are considered to be equal to the savings of non-incented, high efficiency equipment/products, as calculated in the equation above. To compute the program spillover percentage for active trade allies, the following steps are used:

1. **Develop the spillover ratio for sampled trade allies** by summing their spillover savings and dividing this total by the program-tracked savings associated with the sampled trade allies.
2. **Develop spillover savings for the population of active trade allies** by applying the spillover ratio from Step 1 to all program savings associated with a trade ally (whether a survey respondent or not).
3. **Develop the overall spillover ratio for active trade allies** by dividing the trade ally spillover estimate from Step 2 by total program savings (whether associated with a trade ally or not).

#### 5.2.1.2 Midstream Programs

Similar to downstream programs, surveys can be used to ask active trade allies in midstream programs if the program influenced their sales of high-efficiency equipment to participating or nonparticipating customers and to quantify the program’s impact on their high-efficiency sales. To assess if a sampled midstream trade ally created spillover, the following screening criteria are recommended (the order of these may be adjusted by the evaluator):

1. The percentage of the trade ally’s sales that are high efficiency and/or the total volume of high efficiency sales increased since the trade ally became exposed to the program.
2. The trade ally sold at least some high efficiency equipment or products during the evaluation period that did not receive an incentive.
3. The trade ally’s recommendation, marketing, or equipment/product stocking or placement was influential in the customers’ choice of high efficiency equipment/product over standard efficiency equipment/product in instances where the equipment did not receive a program incentive.

Sampled trade allies who do not pass one of the above screening criteria do not qualify for spillover and may be skipped out of the rest of the spillover module.

To quantify spillover for each sampled midstream trade ally, the survey collects information on the percentage of the trade ally’s total equipment sales (in terms of projects or measures) that was (1) standard efficiency, (2) high efficiency that DID receive a program incentive, and (3) high efficiency that DID NOT receive a program incentive.



Based on these responses, the share of a trade ally’s high efficiency sales that received an incentive can be calculated as follows:

$$\frac{\% \text{ of TA's High Efficiency Sales that Received Incentive}}{\% \text{ High efficiency that DID receive a program incentive} + \% \text{ High efficiency that did NOT receive a program incentive}} = \frac{\% \text{ High efficiency that DID receive a program incentive}}{\% \text{ High efficiency that DID receive a program incentive} + \% \text{ High efficiency that did NOT receive a program incentive}}$$

Through additional survey questions,<sup>74</sup> the evaluator should develop an attribution percentage, i.e., the proportion of non-incented high efficiency projects or measures that are attributable to the program. With this data, and the trade ally’s savings from the program tracking database, the following equation is used to calculate the trade ally’s spillover savings:

$$\text{Spillover Savings} = \frac{\text{Savings from Program Database}}{\% \text{ of TA's High Efficiency Sales that Received Incentive}} - \frac{\text{Savings from Program Database}}{\% \text{ of TA's High Efficiency Sales that Received Incentive}} * \text{Size Adjustment (if applicable)}$$

The last term in the above equation is a size adjustment that accounts for the possibility that savings from non-incented projects/measures might be different from incented ones. Information on the relative size of average energy savings of incented versus non-incented projects/measures is also collected in the survey if the evaluator expects a potential difference in relative size.

To compute the program spillover percentage for active midstream trade allies, the following steps are used:

1. **Develop the spillover ratio for sampled trade allies** by summing their spillover savings and dividing this total by the program-tracked savings associated with the sampled trade allies.
2. **Develop spillover savings for the population of active trade allies** by applying the spillover ratio from Step 1 to all program savings associated with a trade ally (whether a survey respondent or not).
3. **Develop the overall spillover ratio for active trade allies** by dividing the trade ally spillover estimate from Step 2 by total program savings (whether associated with a trade ally or not).

### 5.2.2 Spillover from Inactive Trade Allies

Inactive trade allies may create spillover if they are exposed to the program but do not directly facilitate program participation, i.e., they did not complete any projects through the program during the evaluation period. Rather, they promote and stock higher-efficiency equipment due to the influence of the program on the market.

Surveys can be used to ask inactive trade allies if the program influenced their sales of high-efficiency equipment to participating or nonparticipating customers and to quantify the program’s impact on their high-efficiency sales. The general questions take the following form:

- Q.1: How many <measures> did you sell in <utility>’s service territory in <period>?
- Q.2: How many of them were <efficiency level> or higher?
- Q.3: Had the <program> not existed, how many <measures> of <efficiency level> or higher do you think you would have sold in <utility>’s service territory?

Evaluators should attempt to allow trade allies sufficient time to collect specific data (e.g., by sending information ahead of the interview or conducting additional follow-up; this might require providing incentives as inactive trade allies tend to be hard-to-reach) and not rely on “guesses” to respond. Additional questions should be included to document how the program influenced sales of additional energy efficient measures and why these measures did not receive an incentive.

<sup>74</sup> As some trade allies may find it difficult to directly quantify the program’s attribution effect on non-program sales, the evaluator may need to use a series of questions to guide the trade ally to provide an estimate of the overall attribution. Questions may include asking about what factors influence sales of non-program efficient equipment/products and how the program influences individual factors to provide context for an overall attribution estimate.

For programs that offer a number of different measures, the evaluator should select and ask about a small number of measures or measure groups that are most likely to generate spillover, e.g., the program’s highest impact measures. The selection of trade allies to include in this research will depend on the measures selected, e.g., if the highest impact measures are lighting measures, the population of trade allies from which to sample should be lighting contractors.

The following steps are used to calculate the spillover percentage for inactive trade allies:

1. **Develop the total number of spillover units for each trade ally** by computing the difference between the total reported number of high-efficiency units sold and the number that would have been sold in the program’s absence, for each measure type.
2. **Develop the total spillover savings for each trade ally** by multiplying the trade ally’s total number of spillover units (from Step 1) by the average gross unit savings, for each measure type.
3. **Compute the total spillover savings for the program period** by summing the spillover savings from all sampled trade allies (from Step 2) and multiplying this sum by the ratio of the population of inactive trade allies to the sample, for each end-use.
4. **Compute the program spillover percentage** by summing the spillover savings for all end-uses (from Step 3) and dividing this sum by program gross savings.

It should be noted that the methodology for inactive trade allies requires the evaluator to quantify the number of trade allies in the population. Depending on which types of inactive trade allies are targeted by the research, determining the size of the population may be challenging and may lead to uncertainty in the results. When targeting trade allies that are on the utility’s trade ally list (but are not active) or those who have been active in the past but have dropped out, program records allow for accurate estimation of the population size. However, when targeting trade allies that have never been active in the program and were never on the utility’s trade ally list, secondary market data is required to develop estimates of population size. The evaluator should carefully document the target population for any inactive trade ally research, data sources used to quantify the population size, and any uncertainty associated with their estimates.

### 5.3 Consumption Data Analysis Protocol

This protocol refers to impact analyses that use consumption data from customer’s monthly bills (commonly referred to as billing analysis) or AMI meter reads<sup>75</sup> to estimate program energy savings. This protocol discusses different consumption data methods and where they fall on the NTG spectrum with respect to participant spillover, nonparticipant spillover, and free ridership; this has implications for whether a NTGR needs to be applied after the consumption data analysis estimate is obtained in order to achieve an estimate of net savings. Decisions of whether to apply a NTGR after conducting a consumption data analysis should be made by the evaluator on a case-by-case basis taking into account the guidelines of this protocol for when these methods are net, gross, or somewhere in between.<sup>76</sup> The remainder of this section discusses NTG for various consumption data analysis methods and then goes through some details of the various analysis methods.

In general, consumption data analysis methods split into two approaches. One approach is to use a comparison group in a randomized control treatment (RCT) design, a random encouragement design (RED) or a quasi-experimental design. These comparison group approaches can, under the right circumstances, be used to directly estimate net savings eliminating the need for a NTGR adjustment. A second approach is to estimate savings without a comparison group (for example, using a pre/post regression model for program participants). Approaches without

<sup>75</sup> Benefits of using AMI data can include: having more observations per customer, which may improve model precision; obviating concerns over billing periods with differing numbers of days; and, for hourly models, providing the ability to observe intraday load shifting in addition to energy savings.

<sup>76</sup> For example, it is generally accepted that programs for income qualified customers have little to no free ridership as these customers are unlikely to install the measures without the incentive of the program. For specific guidance on income qualified programs see Section 4.

a comparison group produce gross savings and must be adjusted by a NTGR to achieve net savings.

In consumption data analysis, energy consumption of the treatment and control groups can be appropriately compared through a regression analysis, using time-series observations on the usage of individual customers in the treatment and comparison groups during the pre- and post-treatment periods. Due to the combined time-series/cross-section structure of such data sets, panel regression techniques can be used.<sup>77</sup>

In general, consumption data analysis methods are best suited to the following situations:

1. When the expected net savings per participant (i.e., the effect size) are large or when large participant/nonparticipant sample sizes are possible.
2. When the program can be designed using a randomized controlled trial (see Section 5.3.5).
3. Programs where nonparticipant spillover is expected to be trivial within the comparison group.
4. Cases where self-selection bias can be effectively controlled for.

### 5.3.1 Consumption Data Analysis and NTG

Different consumption data analysis methods produce different savings estimates in terms of the NTG spectrum, as summarized in Table 5 – 3. These methods will always yield gross savings with respect to nonparticipant spillover and net savings with respect to participant spillover. However, the savings estimates may be net, gross, or somewhere in between with respect to free ridership, depending on the evaluation technique.

**Table 5-3. NTG Summary for Consumption Data Analysis**

Consumption Data Analysis Method	Free Ridership	Participant Spillover*	Nonparticipant Spillover**
Randomized Controlled Trial (RCT)	✓	✓	§
Random Encouragement Design			
No Instrumental Variable (IV)	†	✓	§
IV	†	✓	§
IV w/ Inverse Mills Ratio (IMR)	†***	✓	§
Quasi-Experimental Design (QED) ****			
Matching			
To Nonparticipants	†*****	✓	§
To Prior or Future Participants	§	✓	§
Regression Discontinuity (RD)	✓	✓	§
Variation-in-Adoption (VIA)	§	✓	§
Without a Comparison Group	§	✓	§
§ Indicates not accounted for (gross) ✓ Indicates fully accounted for (net) † Indicates partially accounted for (between net and gross) * Participant spillover within the analysis timeframe in the same building and fuel type is captured. Other sources of participant spillover may not be captured. See the subsection on participant spillover below for details.			

<sup>77</sup> “Panel” refers to the data set consisting of time-series observations on energy consumption of a cross-section of treatment and control customers. Panel estimation techniques refer to the model’s inclusion of terms that control for individual customer heterogeneity (e.g., customer fixed effects or a lagged dependent variable), and cluster-robust standard errors, which can accommodate differing error variances across customers and an intracustomer correlation of errors.

\*\* Nonparticipant spillover is not captured as a positive in consumption data analysis and may actually reduce the estimate of savings if it occurs within the comparison group. See the subsection on nonparticipant spillover below for details.  
 \*\*\*This method has been tested in simulation but needs further use in practice.  
 \*\*\*\* Note that this is a non-exhaustive list of QED evaluation techniques.  
 \*\*\*\*\* As noted in first few paragraphs of Section 5.3, these comparison group approaches can, under the right circumstances, be used to produce an estimate of net savings, eliminating the need for a NTGR adjustment (see Goldberg et al., 2017).

When consumption data analysis methods are being used to update the TRM, the update should explicitly state how a NTGR should be applied to the given measure or program in the future. The language used should consider different program delivery mechanisms (which often have different NTG values) and how stable the NTG value is likely to be over time (thus allowing for consideration of how frequently it should be updated).

### 5.3.2 Nonparticipant Spillover

Nonparticipant spillover is never captured by consumption data analysis, making these savings estimates gross with respect to nonparticipant spillover (i.e., nonparticipant spillover is not accounted for by the estimate directly from the consumption data analysis without further adjustment). To the extent that nonparticipant spillover occurs in the comparison group being used for evaluation, the effect of the program may be underestimated as the difference between the participant group and the comparison group is decreased by the amount of nonparticipant spillover. If nonparticipant spillover is expected to be large (based on the best research available or given the program’s logic model) and occur within the evaluation comparison group, that may be a reason to use other methods for evaluating savings. If a billing analysis is done in these cases, a traditional nonparticipant spillover analysis (using techniques like nonparticipant surveys or interviews) should be used to help quantify this effect (these analyses are discussed in various subsections of Chapter 4 of this protocol). Within the comparison group, it can also be difficult to distinguish the effects of nonparticipant spillover, free ridership, and market transformation as all of these effects increase uptake of a measure without going through the program among the nonparticipant group.

In cases where nonparticipant spillover is not expected to occur in the comparison group but may occur in the broader population (for example, if we go from a pilot evaluation where measures were restricted among the comparison group to a full program deployment), adjustments for nonparticipant spillover (or justification for why there is no nonparticipant spillover) should be made as appropriate on a program-by-program basis.

### 5.3.3 Participant Spillover

Participant spillover is captured by consumption data analysis, making these savings estimates net with respect to participant spillover (i.e., participant spillover is accounted for by the estimate directly from the consumption data analysis without further adjustment). This occurs because consumption data analysis measures all changes in participant usage (captured by the utility billing system or AMI meter reads) regardless of whether the changes are related to the program. A few caveats apply:

1. Consumption data analysis does not capture participant spillover that occurs outside the home or business being analyzed. For example, spillover at a participant’s vacation home or spillover at other facilities owned by the same firm.
2. Consumption data analysis does not capture participant spillover that occurs in a different fuel type. For example, if the analysis is done on electric data but there is participant spillover into natural gas.
3. Consumption data analysis does not capture participant spillover that occurs outside the analysis period (typically a one-year period).

If these sources of participant spillover that are not captured are expected to be large (based on the best research available or given the program’s logic model), adjustments or additional analysis to capture these types of participant spillover may be required.

### 5.3.4 Free Ridership

With respect to free ridership, consumption data analysis can produce savings estimates that are net, gross, or somewhere in between (i.e., free ridership can be fully, not at all, or partially accounted for by the estimate directly from the consumption data analysis without further adjustment). Where they fall depends on whether the comparison group accounts for (or nets out) free ridership in the estimation. For a summary of where each method

falls see Table 5-3 above.

Methods that yield gross savings estimates with respect to free ridership have no comparison group or have a comparison group that is made up of other (prior or future) participants. In these cases, a free ridership adjustment (or justification of why there is no free ridership) is necessary. These methods include:

- Matching to older or newer participants<sup>78</sup>
- Variation-in-adoption (VIA)<sup>79</sup>
- Any method without a comparison group

Methods that yield net savings estimates with respect to free ridership have a nonparticipant comparison group that has the same level of free ridership as the participants. In these cases, the comparison group is engaging in energy efficiency activities at the same rate as the participant group would have without the program. This nets out the free ridership and means no free ridership adjustment is necessary. These methods include:

- Randomized controlled trial (RCT)
- Regression discontinuity (RD)
- Random encouragement design (RED) under at least one of the following conditions:
  - Analysis is done using instrumental variables with an inverse mills ratio<sup>80</sup>
  - Designs where only the encouraged group can join the program (and as such the participants who join the program include only compliers and not always takers<sup>81</sup>)
  - There is no relationship between how much energy a customer will save by participating and their inclination to participate

Methods where there is a nonparticipant comparison group that is expected to have a different level of naturally occurring adoption than the participant group can result in savings estimates that fall somewhere between net and gross with respect to free ridership. For example, a group of participants would be expected to be comprised of more natural adopters than a group of nonparticipants who never joined the program. These methods include:

- RED (in situations not covered by the previous list showing when RED is net)
- Matching to nonparticipants

In these cases, it is up to the evaluator to decide whether an estimate is most appropriately considered net or gross on an analysis-by-analysis basis. Some guidelines include:

- Measures where instant upstream rebates exist for a large portion of the market are likely gross as there should be very few customers who got the measure in the nonparticipant group
- Measures for income qualified customers are typically considered net as these customers are unlikely to install the measures without the incentive of the program

In some cases, evaluators may be able to implement techniques when using a nonparticipant comparison group such that the savings are sufficiently close to net and do not require further net to gross adjustment. One example of these techniques is the IV-IMR method proposed in Goldberg et. al. (2017). The UMP Chapter 21 (Violette and Rathbun, 2017) also has some discussion of getting net savings estimates using these approaches, although UMP

<sup>78</sup> Except in the case of income qualified programs where the use of future participants can produce an estimate of net savings. For specific guidance on income qualified programs see Section 4.

<sup>79</sup> See Harding and Hsiaw (2013). This is a distinct method from the UMP Chapter 8 (Agnew and Goldberg, 2017) pooled fixed effects approach which can be estimated with multiple years of participants. VIA hinges on rolling enrollment and in essence uses each participant as a control and a treatment customer through time. The Chapter 8 pooled fixed effects approach uses participants from an earlier time period as a comparison group for participants from a later time period.

<sup>80</sup> For details see: Goldberg, M.; Agnew, K.; Train, K.; Fowle, M. (2017). *Mitigating Self-Selection Bias in Billing Analysis for Impact Evaluation*. Pacific Gas and Electric Company. CALMAC Study ID PGE0401.01.

<[http://www.calmac.org/publications/Mitigating\\_Self\\_Selection\\_Bias\\_in\\_Bill\\_Analysis\\_8.4.17.pdf](http://www.calmac.org/publications/Mitigating_Self_Selection_Bias_in_Bill_Analysis_8.4.17.pdf)>

<sup>81</sup> See Section 5.

Chapter 8 (Agnew and Goldberg 2017) should be reviewed in conjunction as it is more specific to consumption data methods. However, these techniques often require customer characteristic data that is not readily available to evaluators and some of them needed to be further tested beyond theoretical simulations.

### 5.3.5 Consumption Data Analysis Designs with a Comparison Group

This section discusses descriptions of and considerations for estimating savings via consumption data analysis designs with a comparison group. Although the ideas of net and gross savings are touched upon, the full discussion on whether each of these methods produce net or gross savings and under what circumstances is in Section 5.3.1.

#### 5.3.5.1 Randomized Controlled Trials

In a randomized controlled trial (RCT) design, evaluators (and sometimes implementation contractors) randomly assign sampled members of a population of interest to a treatment group or a control group. Among the benefits offered by an RCT—when properly applied—is that it produces net savings estimates by netting out free ridership.<sup>82</sup> The evaluation of a program must be designed and implemented this way from the outset; it is not possible for an evaluation team to apply RCT evaluation techniques after the program has been implemented if random assignment to treatment and control groups was not done before program launch. While such designs are rarely possible outside of Home Energy Report programs, one should not overlook the possibility of such designs in evaluating new pilot programs.

For some programs, evaluators must take a second step to ensure savings are not being double-counted, either counting savings being claimed by other programs or savings already credited to earlier program efforts (often called “legacy uplift”). Only net increases in participation in other programs should be considered in this uplift adjustment; changes to total savings do not need to be made based on decreases in participation in other programs.

#### 5.3.5.2 Random Encouragement Designs

In a random encouragement design (RED), eligible customers are randomly assigned between an encouraged group (who receives incremental encouragement to join the program<sup>83</sup>) and a non-encouraged, or control, group (who does not receive the encouragement). Members of either group can join the program, but the encouraged group is expected to do so at a higher rate.<sup>84</sup> If the encouragement is not effective at driving the encouraged group into the program at a higher rate than the non-encouraged group then the evaluation design breaks down and other (likely quasi-experimental) methods will be needed to estimate program savings.

In an RED, both the encouraged and non-encouraged group are made up of the following:

1. Always takers – customers who will join the program with or without the encouragement
2. Compliers – customers who only join the program if they receive the encouragement
3. Never takers – customers who will never join the program, regardless of whether they receive the encouragement

In the non-encouraged group, the always takers can be distinguished from the compliers and never takers (they’re the portion of the non-encouraged group who joins the program), but the compliers and never takers cannot be distinguished from one another (they’re both observed not to join the program). In the encouraged group, the never takers can be distinguished from the always takers and compliers (they’re the portion of the encouraged group who does not join the program), but the always takers and compliers cannot be distinguished from one another (they’re

---

<sup>82</sup> RCTs eliminate free rider bias because the random assignment of customers to treatment and control groups equally distributes such participants between the two. Due to differential attrition and random chance, small differences may occur between the distributions of free riders in the two groups for any given sample. Their expected values, however, will be identical, and in any case the size of any such discrepancies shrinks as sample size increases. Thus, this is only a potential concern for programs with unusually small numbers of participants.) Upon comparing the two groups’ energy consumption, free riders’ energy savings in the control group cancel out those in the treatment group, eliminating free rider bias.

<sup>83</sup> The encouragement could take many forms including targeted marketing or direct monetary incentives.

<sup>84</sup> This design does not preclude mass marketing of the program to all customers but relies on the encouragement being effective at driving the encouraged customers into the program at a higher rate than the non-encouraged customers.

both observed to join the program).

Like RCTs, REDs are a form of experimental design. An RED is known to give an unbiased estimate of net savings (with respect to free ridership) for the compliers. Applying this savings to the always takers group requires some explanation of why it is likely to be accurate. Additionally, the RED design provides the average net savings per participant for those who participate because of the encouragement but otherwise would not (compliers). This is not necessarily the same as the net savings for the original program without extra encouragement. In particular, we would expect free-ridership to be lower among those who need extra encouragement. Thus, the RED might be expected to overstate net savings for the original program if free-ridership is present but would still provide useful information.

There are several methods for evaluating REDs using panel data including methods using instrumental variables (IVs) and the inverse mills ratio (IMR).<sup>85</sup>

### 5.3.5.3 Quasi-Experimental Designs

Where randomized assignments prove infeasible, quasi-experimental design (QED) evaluation methods can be substituted (although experimental designs are typically preferable when possible). Depending on the exact QED implemented, the savings may be net, gross, or somewhere in between with respect to the different pieces of a NTG adjustment (participant spillover, nonparticipant spillover, and free ridership). The specifics of net versus gross estimation are covered in Section 5.3.1, this subsection does not rehash this issue but rather describes estimation for a subset of QED methods.

Three quasi-experimental approaches are commonly used to evaluate behavior-based energy efficiency programs that cannot be constructed as experiments.<sup>86</sup>

- Regression discontinuity (RD)
- Variation-in-adoption (VIA)<sup>87</sup>
- Matched controls (MC)

All three rely on a nonrandom comparison group.

**Regression Discontinuity.** RD requires basing a program's eligibility on a continuous variable (e.g., customers' adjusted gross income falling below a cutoff value for them to qualify for the program). When this is true, the RD method assumes customers just beyond the cutoff likely will be very similar, on average, to those just inside of it. The method compares changes in energy usage for a group just outside of the eligible range to that of a group of participants just on the other side of the eligibility cutoff. The RD approach, however, is susceptible to an important weakness: misspecification of the regression functional form.<sup>88</sup>

<sup>85</sup> See, for example:

Goldberg, M.; Agnew, K.; Train, K.; Fowlie, M. (2017). *Mitigating Self-Selection Bias in Billing Analysis for Impact Evaluation*. Pacific Gas and Electric Company. CALMAC Study ID PGE0401.01.

<[http://www.calmac.org/publications/Mitigating\\_Self\\_Selection\\_Bias\\_in\\_Bill\\_Analysis\\_8.4.17.pdf](http://www.calmac.org/publications/Mitigating_Self_Selection_Bias_in_Bill_Analysis_8.4.17.pdf)>

Fowlie, M.; Greenstone, M.; Wolfram, C. (2015). *Are the Non-Monetary Costs of Energy Efficiency Investments Large? Understanding Low Take-up of a Free Energy Efficiency Program*. American Economic Review: Papers and Proceedings 105(5): 201-204. <

[https://www.povertyactionlab.org/sites/default/files/publications/389\\_500%20Weatherization%20AER.pdf](https://www.povertyactionlab.org/sites/default/files/publications/389_500%20Weatherization%20AER.pdf)>

<sup>86</sup> There are many other types of QEDs that may be appropriate for evaluation but these are some of the most commonly used for evaluation in IL.

<sup>87</sup> See Harding and Hsiaw (2013). This is a distinct method from the UMP Chapter 8 (Agnew and Goldberg, 2017) pooled fixed effects approach which can be estimated with multiple years of participants. VIA hinges on rolling enrollment and in essence uses each participant as a control and a treatment customer through time. The Chapter 8 pooled fixed effects approach using participants from an earlier time period as a comparison group for participants from a later time period. The Chapter 8 pooled fixed effects method is discussed in Section 5.3.6.

<sup>88</sup> The most common misspecifications are: mistaking a nonlinear relationship for a discontinuity; and failing to recognize potential interactions between assignments and the treatment studied. See W.R. Shadish, T.D. Cook and D.T. Campbell,

**Variation-in-Adoption.** The VIA model applies only to program participants.<sup>89</sup> For this method, customers must sign up for the program on a rolling basis. VIA takes advantage of its enrollees' differential timing to compare energy usage of customers opting in to that of customers not yet opting in (but doing so later). The method relies on an assumption that, in any given month, customers that soon opt in have similar characteristics to those who have enrolled, both in observable and unobservable characteristics. For this assumption to prove valid, customers must decide to opt into the program at different times for essentially random reasons (e.g., influenced only by marketing exposure and program awareness).<sup>90</sup> In particular, the decision to opt in should not relate to observable or unobservable household characteristics.<sup>91</sup>

**Matched Controls.** MC creates a control group by matching each treatment customer to the most similar nonparticipant customer available on the basis of exogenous covariates from the pre-enrollment period known to highly correlate with post-enrollment usage.<sup>92</sup> The covariate most likely to correlate with post-enrollment energy usage in a given time period is customer energy usage during the same period of the preceding year, but other observable factors may be used when available. Implementing MC requires customer usage data for the year preceding all opt-in customers' decisions to participate in the program, along with a large group of nonparticipants who can be assumed to be similar to opt-in customers, aside from their program participation status. Whenever possible, the pool of potential matches should be drawn from the same geography, customer class, and rate category as the participants.

Another option is to pull the nonparticipants from a group of prior or future participants in the program (sometimes referred to as the cohort design<sup>93</sup>). These groups are similar to current participants since we know that they also join the program at an earlier or future date, significantly mitigating the issue of self-selection bias (wherein, customers who join the program are different from those who do not in unobservable ways).<sup>94</sup> However, using this design can significantly decrease the number of participants for analysis and the size of the potential matching group. It can also require the evaluator to delay the analysis if more recent participants are being used as the comparison group.<sup>95</sup>

The MC method involves identifying a nonparticipant customer whose energy usage closely matches that of a program participant in the months preceding the participant's enrollment in the program. The logic inherent in this approach is: if the analyst finds a set of nonparticipants who, on average, are the same as participants regarding energy consumption before program enrollment, these matches will provide a good counterfactual estimate of how much energy participants would have used in the program's absence.

---

*Experimental and Quasi-Experimental Designs for Generalized Causal Inference*, Wadsworth 2002, pp. 229-238.

<sup>89</sup> Harding, M. and Hsiaw, A. 2013. *Goal Setting and Energy Conservation* Available at: [http://people.duke.edu/~mch55/resources/Harding\\_Goals.pdf](http://people.duke.edu/~mch55/resources/Harding_Goals.pdf).

<sup>90</sup> This differs from an RCT with a recruit-and-delay design, in which customers do not choose when to opt in, but instead are randomly assigned different times to opt in, and from an RCT with a recruit-and-deny design, where customers are randomly denied access to the program.

<sup>91</sup> As the validity of the VIA method depends on this assumption, it should be empirically tested to the extent possible. If program marketing is punctuated and dates of marketing exposure are known, it is possible to test whether household enrollment in any particular month is driven by marketing activity, as opposed to observed household characteristics or unobserved heterogeneity. A test of whether the energy usage of households before they opt in differs from households that opt in during any particular month as opposed to another month is built into the VIA regression model's functional form. See Harding and Hsiaw, op. cit., for details.

<sup>92</sup> See Daniel E. Ho, Kosuke Imai, Gary King, and Elizabeth Stuart, 2007, "Matching as Nonparametric Preprocessing for Reducing Model Dependence in Parametric Causal Inference." *Political Analysis* 15(3): 199-236.

<sup>93</sup> See W.R. Shadish, T.D. Cook and D.T. Campbell. (2002). *Experimental and Quasi-Experimental Designs for Generalized Causal Inference*. New York: Houghton Mifflin Company, pp. 148-153

<sup>94</sup> Though there could still be a selection issue based on when customers choose to join the program. As with VIA, the assumption is that the timing of participation is basically random.

<sup>95</sup> The cohort design has also been used, under certain conditions, to control for exogenous factors when estimating gross savings. See Agnew, K. and M. Goldberg. (2017). Whole Building Retrofit with Consumption Data Analysis Evaluation Protocol: Chapter 8 of the Uniform Methods Project, National Renewable Energy Laboratory.



The MC approach does present a main weakness: it can only identify matches based on observable customer characteristics, which leaves open the exclusion of the possible influence of relevant unobservable variables. While factors other than pre-enrollment energy usage plausibly could be used (e.g., household income, demographics, geographic location) in the matching process to address relevant unobservable characteristics (e.g., attitudes toward energy conservation and environmental concerns), this assumption cannot be directly tested.<sup>96</sup>

There is a special case of MC called propensity-score matching. This develops a binary choice (logistic regression) model to predict the probability that a customer will opt into the program, and then, for a comparison group. The logistic regression reduces each household's set of covariates to a single propensity score. Nonparticipants are then matched to participants based on their propensity scores. This functions well if observable variables used to calculate the propensity score sufficiently correlate with relevant unobservable variables to explain differences between treatment and control customers that cannot be explained by matching on observable variables. With most evaluations of energy efficiency programs, however, little (if any) data are available on nonparticipating customers other than their energy usage. In some cases, the demographic data necessary to estimate these models can be obtained from providers such as Experian and assigned to each participant and nonparticipant.

**Self-Selection Bias and QED.** Self-selection bias due to observable and unobservable variables is always a possibility with QEDs. One can collect as much information as possible on both participants and members of the comparison group and include them as covariates in the regression model, but there may still be self-selection bias related to unobservable variables. Several techniques have been developed to help mitigate it. Efforts to address the biasing effects of *unobserved* differences using Inverse Mills Ratios began at least as early as the late 1980s. Since then, Train (1993) and Goldberg and Train (1995), using simulated datasets, demonstrated that failing to correct for self-selection can overestimate net savings, but that there are effective strategies to reduce this bias substantially.

One approach is to calculate and enter the propensity score, based on observable variables, as an additional covariate into the regression model. Of course, the most difficult issue to address is the differences between participants and nonparticipants that are unobserved and unobservable. To mitigate both overt and hidden bias, a variety of approaches that attempt to take advantage of recent developments in statistics and econometrics are available:

- Sample selection models (e.g., Heckman's two-step estimator (1978, 1979); treatment effect model (Green, 2003); instrumental variables estimator (Wooldridge, 2002)
- The propensity score matching model (Rosenbaum and Rubin, 1983, 1985; Hansen and Klopfer, 2006; Guo and Fraser, 2014)<sup>97</sup>
- Matching estimators and synthetic controls (Abadie and Imbens, 2002, 2006)
- Instrumental variables approach with the predicted probability of participation serving as the instrumental variable and the inclusion of an Inverse Mills Ratio (IMR) (Goldberg et al., 2017)

Another issue that should be considered is that, when using a comparison group in a QED, the composition of the comparison group needs to be carefully considered.<sup>98,99</sup> For example, simply selecting a random sample of nonparticipants from the general nonparticipant population could result in an estimate of savings that is somewhere between net and gross, thus overestimating net savings. For a single-measure residential program like an air conditioner (AC) replacement program, the eligible population is the population of customers who have purchased a new air conditioner. That is, part of the eligible population appropriate to a net effects comparison group would be those who purchased and installed some air conditioner, whether efficient or not. Simply selecting from the

---

<sup>96</sup> Such secondary, observable characteristics are rarely available to evaluators of energy efficiency programs, except for geographic location (e.g., postal zone of customer premise).

<sup>97</sup> Note that propensity scores cannot remove hidden biases except to the extent that unmeasured variables are correlated with the measured covariates used to compute the propensity score

<sup>98</sup> See Agnew et al., Section 8.1.3 (The Importance of Measures Applicability)

<sup>99</sup> Katherine Randazzo, Richard Ridge and Seth Wayland. Evaluating Whole-Building Programs: It is harder and easier than you think! Presented at the International Energy Program Evaluation Conference in August 2017.

general residential population would include households with no air conditioner, those with older ACs of varying vintages, those with new standard efficient ACs and those with new program-qualified ACs. The results would be virtually uninterpretable. Of course, for more complex multi-measure programs, finding the appropriate comparison group is far more challenging.

### 5.3.6 Consumption Data Analysis Designs without a Comparison Group

Although less common, consumption data methods can also be used to estimate savings without the use of a comparison group. These methods typically estimate gross savings, and net savings are found by multiplying gross savings by a separately estimated NTGR. There are basically two types of pre/post models to estimate gross savings:

- the pooled participant-only linear fixed-effects approach
- site-specific regression models

In both modeling approaches, exogenous factors must be controlled for.<sup>100</sup>

**Pooled Approach.** The pooled approach addresses exogenous change without the inclusion of a separate comparison group. In this model, participants who received a measure installation during a certain time interval serve as a steady-state comparison for other participants in each other time interval. Almost all observation points include premises that are still in their pre-installation period and premises that are in their post-installation period, so the effect of post- versus pre- is estimated to control for exogenous trends. Note that if changes at the site that affect energy use are not or cannot be explicitly modelled the estimated gross savings will be biased. This method is typically used in analysis of residential and small (and occasionally for large) commercial programs.

**Site Specific Regression Models.** This approach involves the estimation of site-specific regression models to estimate savings. This method is often used for large commercial and industrial customers or in other situations where it is difficult to identify an adequate comparison group (for example, in evaluation of Strategic Energy Management programs). In these cases, single customer regressions are typically run as a time series without a cross-section of customers.

Note that both the pooled approach and the site-specific approach and the conditions that must be met before using them are discussed in Agnew and Goldberg (2017).

### 5.3.7 Program Implementation and Consumption Data Analysis

The approach the evaluation can use to estimate net savings is greatly dependent on the design of the program and the size of the expected savings (i.e., the signal-to-noise ratio).

**RCT and RED:** These designs must be integral to a program's implementation. Without the ability to randomly assign customers to the control and treatment groups (or at least randomly encourage customers to participate in a program), the ability of the design to yield unambiguous estimates of net impacts is compromised. Evaluators often help design how a program is implemented. However, if they not involved at the outset, they cannot carefully review choices made by the implementation team. RCT and RED designs are difficult to perform well within the commercial and industrial sectors due to a low signal-to-noise ratio. One solution for these two sectors is to increase the sample size but this is not always feasible.

**QED:** A QED may be designed after a program has been implemented. It relies on determination of an equivalent comparison group, which is often chosen based on energy use and other variables, if available. QED is also difficult to perform well within the commercial and industrial sectors due to a low signal-to-noise ratio. One solution for these two sectors is to increase the sample size but this is not always feasible.<sup>101</sup>

**Methods without a Comparison Group:** These methods can also be implemented by the evaluator after the program has been designed. They are most appropriate in situations where it is difficult to construct an appropriate

<sup>100</sup> Exogenous factors include non-program-related effects due to the economy and other factors affecting energy consumption.

<sup>101</sup> A power analysis can be undertaken before the actual analysis to determine whether the sample size available is likely to be large enough to produce statistically significant savings at the desired confidence level.

comparison group.

For any kind of evaluation design, evaluators may also analyze the data to help understand the savings within specific segments if sufficient information and data points are available.

## References

- Abadie, Imbens, 2002, 2006
- Agnew, Goldberg, 2017
- Donaldson, 2009
- Fowlie, Greenstone, Wolfram, 2015
- Goldberg, Agnew, Train, Fowlie, 2017
- Goldberg, Train, 1995
- Green, 2003
- Guo, Fraser, 2014
- Hansen, Klopfer, 2006
- Harding, Hsiaw, 2013
- Heckman, 1978, 1979
- Ho, Imai, King, Stuart, 2007
- Mohr, 1995
- Shadish, Cook, Campbell, 2002
- Scriven, 2008
- Randazzo, Ridge, Wayland, 2017
- Rosenbaum, Rubin, 1983, 1985
- Train, 1993
- Wooldridge, 2002

## 5.4 Midstream Free-Ridership Protocol<sup>102</sup>

Typical energy efficiency programs offer incentives to end-use customers to purchase more efficient equipment. These can be referred to as “downstream” incentives, or downstream programs. Moving up the supply chain, the next entities are distributors, contractors, and design professionals. Programs aimed at influencing these market actors are referred to as “midstream” programs. “Upstream” programs target manufacturers and potentially retailers.

### 5.4.1 Using This Protocol

The methods described in this section should be applied for estimating NTGRs for midstream programs in which the incentives are paid directly to distributors who have the option of sharing some or all of these incentives with the end-use customers in the form of price reductions. As discussed in further detail later in this section, programs of this type influence behavior of both distributors as well as end-users (to various degrees). As a result, in midstream programs where it is believed that end-use customers are aware of the utility intervention, it is desirable for evaluators to conduct research that produces both end-user- and distributor-based estimates of free ridership for these programs, and to combine these estimates using guidance provided in Section 5.1: Combining Participant and Trade Ally Free Ridership Scores to estimate a NTGR that is inclusive of both perspectives.<sup>103</sup>

---

<sup>102</sup> Note that the method for assessing trade ally spillover is included in Section 5.2.

<sup>103</sup> In cases where midstream programs require distributors to pass the entire incentive to a customer and collect customer information, it is still likely that the program is affecting distributor behavior, and distributor research is still valuable.

In cases where midstream programs do not collect customer information, end-user research will generally not be feasible, and free ridership estimates will be based solely on distributor research as outlined in this protocol.<sup>104</sup>

If evaluation constraints do not allow for high quality end-user and distributor research to be conducted, it is likely preferable to conduct high quality research from only one perspective rather than lower quality (e.g., minimal sample size) research from both perspectives, and the evaluator may choose to utilize only one approach without it being considered a divergence from the IL-NTG Methods. In this case, the evaluator should carefully consider the specific design and intent of a given program when choosing the appropriate protocol(s) for evaluation and must document the rationale for its decision in the evaluation plan.

Ultimately, the protocol(s) to be used for a given program is defined in Table 3-1 and Table 4-1. If the design of a given program changes significantly, then it may mean that the NTG protocol listed for that program in Table 3-1 or Table 4-1 is no longer appropriate. In addition, the evaluator may determine that the customer or distributor NTG algorithms need to be substantially modified to accommodate the specific design of a midstream program. If the evaluator chooses to use an alternative method or approach to estimate the NTG, the evaluator should follow the procedures outlined in Section 1.4: Diverging from the IL-NTG Methods. For new programs the choice of protocol(s) will be ultimately at the discretion of the evaluator.

Knowing that they will receive an incentive for selling high efficiency units, distributors may choose to increase their stock of high efficiency units, and/or to upsell high efficiency units to contractors. Distributors may also choose to offer training sessions or marketing campaigns aimed at engineers, architects, and contractors to increase awareness of these high efficiency units. As a result of the program's actions:

Contractors/customers may be more likely to purchase high efficiency units because they are in stock,

Contractors/customers may be more likely to purchase high efficiency equipment because the distributor upsold these units,

Contractors/customers may be more likely to purchase high efficiency units because the incremental cost is lower than it would have been without the incentive (assuming the distributor uses the incentive to reduce the price of the equipment), and

Design professionals and contractors may be more likely to specify or recommend high efficiency units because they are more aware or more familiar with these options.

The expected overall outcome is that a greater proportion of customer purchases will be high efficiency units. As distributors sell more high efficiency units, manufacturers will respond by producing more high efficiency equipment. Ultimately, the overall market in a utility's service territory will become more efficient than it otherwise would have been, or it will achieve this efficiency sooner than if no intervention had occurred.

To assess impacts from this type of program, the evaluator needs to determine if the distributor changed their practices in a way that ultimately influenced the customer's buying decision. Assessing the influence of the program involves conducting in-depth interviews with participating distributors and asking them how they would have behaved in the absence of the program. While interviews with others such as contractors and design professionals can also be conducted in order to develop a more complete understanding of the influence of the program, the focus of this protocol is on the distributor interviews.

This protocol is based on the key considerations and guidelines for estimation of free ridership for non-residential programs that is described in Section 3.1.1: Core Non-Residential Free Ridership Protocol. The process to be used for scoring free ridership is described in Section 3.1.1.1: Core Non-Residential Free Ridership Scoring Algorithm. This midstream protocol can be used for estimating NTGRs for both residential and non-residential midstream programs that focus on distributors.<sup>105</sup>

To ensure that the midstream NTGR approach covers all avenues of program influence, one should develop a logic model based on discussions with utility program staff, implementer staff, and a general review of midstream

---

<sup>104</sup> While contact information is available for the participating distributors, it is not always available for the end-use customer.

<sup>105</sup> See Section 4.3 for a description of an approach for calculating NTG specifically for Residential Upstream Lighting programs.

programs. The midstream NTGR approach recommended here is designed to be flexible as the midstream incentives may be impacting distributors’ businesses in one of many ways—including via changes in stocking, upselling, price reduction, etc. Ultimately, the midstream program should be given credit for influence via any of these causal pathways. Note that a midstream program might have longer-term impacts that are not immediately measurable. Such longer-term impacts manifest as “market effects,” which signify a transformation in the underlying structure and functioning of the market. This midstream protocol does not address the measurement of such market effects.

## 5.4.2 Free Ridership Estimation Methodology

This methodology uses three indicators of free ridership:

- Program Components FR Score,
- Program Influence FR Score, and
- No-Program FR Score

These scores are then averaged to arrive at a final free ridership value. The algorithm shown in Section 3, Figure 3-1: Core Free Ridership Algorithm 1, can be used to calculate the free-ridership. The resulting NTGR value should be weighted proportionate to the ex post gross kWh savings for each respondent.

The one exception to the free ridership algorithm described above concerns the timing question. Note that normally, in the case of downstream rebate programs, it is possible that the old equipment was still functioning, but the program induced the participant to swap out the equipment before the end of its useful life. Because of the conceptually challenging nature of a timing question for distributors, it has been removed.

This protocol starts with the Core Non-Residential Protocol methodology outlined in Section 3, Figure 3-1: Core Free Ridership Algorithm 1 and suggests modifications to the free ridership questions to recognize the unique nature of midstream programs. Below are some examples of the types of questions that could be asked of distributors for each of the three pathways to program influence.

### 5.4.2.1 Strategies Used

First, the evaluator must ask each distributor which of the available sales strategies they used to promote program-qualified equipment.

Now, I’m going to ask you about the various strategies you might have used to sell program-qualified equipment. Please indicate which ones you have used. [READ]

- Upsell contractors to purchase program-qualified units
- Conduct training workshops for contractors
- Increase marketing of program-qualified units
- Reduce the prices of program-qualified units
- Increase the stocking or assortment of program-qualified units
- Discuss the benefits of program-qualified units with design professionals
- Other (Please describe: \_\_\_\_\_)

#### 5.4.2.1.1 Program Components FR Score

Next, the evaluators will administer survey questions to obtain participants’ rating of the importance of various factors on the decision to implement energy efficiency measures. The numeric scales shall range from 0 to 10, where 0 means “not at all important” and 10 means “extremely important”. The various program and non-program factors referenced in the survey will include those that the evaluator determines are program factors and non-program factors that could potentially impact the participant decision making process. Program factors are those utility actions designed to convince the distributor to increase their stock of efficient equipment and to change their sales

strategies in order to sell more of these more energy efficient models. These might include such things as the incentive, information about the cost-effectiveness of the more efficient units, promotional materials, and the training of sales staff. Of course, it is possible that there might be other reasons other than the program actions that might also explain why they chose to promote the more energy efficient equipment. Non-program factors might include the distributor’s policies designed to support sustainability, their general concern about global warming, their interest in increasing their sales and profits, their desire to help their customers reduce their energy bills, and their interest in being perceived as environmentally responsible. A participant rating shall be obtained for each relevant program and non-program factor. Evaluators will calculate the “Program Components FR Score” for each survey respondent using the following equation:

$$\text{Program Components FR Score} = 1 - ([\text{Maximum Program Factor Rating}]/10).$$

**5.4.2.1.2 Program Influence FR Score**

Evaluators will administer a survey question that asks respondents to quantify the importance (or impact) of the program on the decision to implement energy efficiency measures relative to the importance (or impact) of non-program factors. Respondents will be asked to allocate a total of 100 points to the program and to non-program factors. Unlike the factor ratings that go into the Program Components FR Score, this question asks respondents to explicitly make a trade-off between the program and non-program factors, i.e., it assesses the importance of the program *relative to* non-program factors.

The points allocated to the program by the participants are the “Program Points.” Evaluators will calculate the “Program Influence FR Score” as  $1 - (\text{Program Points}/100)$ . This score can range from 0 (no free ridership) to 1 (full free rider).

Before asking respondents to allocate the 100 points, it is important to remind them what is meant by “program” and “non-program factors.” Otherwise, they might inadvertently divide the points based on an incorrect understanding of the two concepts. The following wording is suggested for use prior to the 100 points question. While the evaluator can make changes to this wording, as needed, to reflect the details of the program, the evaluator must follow the TRM’s guidance around reading in program and non-program factors.

*Program factors include:*

[READ IN A MINIMUM OF TWO PROGRAM FACTORS, SELECTED BY CHOOSING THOSE THAT RECEIVED THE HIGHEST TWO SCORES AMONG ALL PROGRAM COMPONENTS IN THE PROGRAM COMPONENTS SECTION. THE EVALUATOR MAY CHOOSE TO READ IN ADDITIONAL FACTORS AT THEIR DISCRETION, ALSO CHOSEN BY SELECTING THOSE THAT RECEIVED THE NEXT HIGHEST SCORES IN THE PROGRAM COMPONENTS SECTION AMONG PROGRAM COMPONENTS. IF FACTORS ARE TIED IN SCORE, EVALUATORS MAY WISH TO READ IN ALL TIED FACTORS, OR RANDOMIZE SELECTION OF TWO OR MORE FACTORS.]

*Non-program factors include:*

[READ IN A MINIMUM OF TWO NON-PROGRAM FACTORS, SELECTED BY CHOOSING THOSE THAT RECEIVED THE HIGHEST TWO SCORES AMONG ALL NON-PROGRAM COMPONENTS IN THE PROGRAM COMPONENTS SECTION. THE EVALUATOR MAY CHOOSE TO READ IN ADDITIONAL FACTORS AT THEIR DISCRETION, ALSO CHOSEN BY SELECTING THOSE THAT RECEIVED THE NEXT HIGHEST SCORES IN THE PROGRAM COMPONENTS SECTION. IF FACTORS ARE TIED IN SCORE, EVALUATORS MAY WISH TO READ IN ALL TIED FACTORS, OR RANDOMIZE SELECTION OF TWO OR MORE FACTORS.]

ONCE THESE PROGRAM AND NON-PROGRAM FACTORS ARE IDENTIFIED, THE EVALUATOR SHOULD READ BOTH LISTS TO THE RESPONDENT BEFORE ASKING THE 100-POINTS ALLOCATION QUESTION.

Next, I would like you to rate the importance of the PROGRAM FACTORS as a group in your decision to implement these sales strategies as opposed to other NON-PROGRAM FACTORS as a group that might have influenced your decision.

Now, if you were given 100 points to award in total, how many points would give to the importance of the

program factors as a group and how many points would you give to the non-program factors as a group?

Evaluators will calculate the “Program Influence FR Score” as  $1 - (\text{Program Points}/100)$ .

#### **5.4.2.1.3 No-Program FR Score**

Using a likelihood scale from 0 to 10, where 0 is “Not at all likely” and 10 is “Extremely likely”, if PROGRAM had not been available, what is the likelihood that you would have used the same strategies to sell program-qualified equipment?

Evaluators will calculate the “No-Program FR Score” as the numeric score of the likelihood that the respondent would have used the same strategies to sell program-qualified equipment in the absence of the program divided by 10. Evaluators should also follow the guidelines regarding program and non-program factors, consistency checks, and quality control review in Section 3.1.1: Core Non-Residential Free Ridership Protocol.

The approach for assessing program impacts described in this section should not be considered exclusive or exhaustive. However, use of a different method or of a modified algorithm will be considered a deviation as discussed in Section 1.4: Diverging from the IL-NTG Methods, and will require a proposal to the Illinois SAG and approval of the proposed method by the SAG. Some additional potential methods that would be considered a deviation from this protocol will now be discussed. Within the general framework of the non-residential algorithm, there are other possible ways to construct indicators of free ridership depending on the data available. For example, for the No-Program FR Score, if the evaluator can obtain historic and current category sales data from each participating distributor, these data can be combined with program sales data (that they are required to provide to the utility) to determine the shift in efficient market shares at the distributor and program levels. If current category sales data are not available, the evaluator could ask the distributors about changes in these shares from the pre- to the post-participation periods (see example from EMI, 2018), although this approach is likely less reliable than shares based on recorded sales data. Or, one could also conduct an interrupted time-series analysis of monthly sales of program-qualified units. There may also be qualitative methodologies which can be combined with quantitative methodologies to enhance the accuracy of program impact estimates. One could also employ a theory-driven evaluation framework (Coryn, 2011) within which an evaluator could assess the program’s effectiveness, guided by the program theory and logic model. For a complex midstream distributor program, an evaluator could develop performance metrics for each activity, output, and outcome and assess the extent to which major activities of the program have been and are being successfully implemented and whether these activities had led to or are likely to lead eventually to the expected short-, mid-, and long-term outcomes. Of course, as evaluators choose to use some of these other methods, they must propose and defend a modified algorithm that can include the results from using these other methods.

## 6 Appendix A: Overview of NTG Methods

The evaluation teams present information in this appendix to provide a relatively quick overview of NTG methods for readers unaccustomed to the possible methods that evaluators may deploy. It is not meant to be a complete or deep discussion about each of the methods presented. However, the evaluators in Illinois considered the inclusion of this appendix to be very important in acknowledging the current suite of methods deployed by evaluators throughout the U.S. and giving a framework for work within Illinois.

Much of the information shown below is taken directly from a single source—the national Uniform Methods Project, Chapter 23: Estimating Net Savings: Common Practices. (Violette and Rathbun, 2014) This document has done a nice job of summarizing the eight most common attribution methods currently in use across the U.S. The evaluation teams recommend that readers go first to this reference for further information. Additionally, while there are slightly over 100 references within the Violette and Rathbun document, other non-duplicative references are included where reasonable as additional resources for those interested in further research into any specific method.

### 6.1 Survey-Based Approaches

Virtually all Illinois based evaluations use a survey-based approach for programs where primary data is used to determine net savings. (The main exception is for behavioral programs which use statistical analysis based on a randomized control trial program design.) Survey-based approaches obtain data from program participants and nonparticipants using a structured data collection instrument implemented via phone, in person, or online.<sup>106</sup> At times, evaluators create and use an unstructured depth-interview guide to collect information about attribution, and this provides both contextual data and quantitative data about a given project.

#### 6.1.1 Self-Report Approach

The self-report approach relies on the abilities of customers to discuss the program influence as well as the somewhat abstract ideas of the counterfactual (i.e., what would have occurred absent the program) after making a choice to purchase an energy efficient item or take an energy efficient action unrelated to a purchase. For program participants, this could include doing nothing (i.e., leaving the existing equipment as-is), installing the same energy efficient equipment as they did through the program, or an intermediate step of installing equipment that is more efficient than what they had in place previously, but less efficient than what they installed through the program. Evaluators also use this approach when collecting information from trade allies or distributors. This self-report approach is not new, nor is it exclusively used by the energy efficiency industry. An important attribute of this approach is its reliance on well-designed and fielded survey questions; so that the data underlying subsequent analyses are accurate and complete.

The output of this approach is a NTG ratio which can be considered an index of the program's influence on the decision to install energy-efficient equipment. The NTG ratio is applied to gross savings in order to obtain an estimate of net savings. The NTG ratio may include free ridership, spillover, or market effects, depending on the survey and analytical design. NTG ratios may be calculated at the measure, suite of measures, or program level and are typically average values weighted by savings. If sufficient information is available, analysis of NTG ratios among certain customer segments may be done to further inform changes to program design.

#### References

- Sudman, 1996
- Stone, et al., 2000
- Bradburn, et al., 2004

---

<sup>106</sup> Historically, evaluators in Illinois have collected the majority of primary data via telephone surveys. As evaluations increasingly leverage online surveys to collect information relevant to attribution, careful attention should be paid to mode effects that are due to interviewer-administered versus self-administered surveys (e.g., scale direction effects). It is recommended that evaluators, where possible, assess the differences between telephone and online survey methods for the purposes of future updates to these protocols.



### 6.1.2 Econometric/Revealed Preference Approach

The econometric/revealed preference approach, while still considered a survey approach due to how data is collected, moves beyond asking people about the counterfactual and instead uses the observations of the evaluator to collect information for analysis of a NTG ratio. Within this approach, evaluators typically deploy similar sampling designs as for the self-report approach to collect data, but actively gather what a person is doing (i.e., what is being purchased in a store) to determine attribution.

## 6.2 NTG with Consumption Data Analysis

As mentioned in Section 5.3, evaluators use randomized control trials (RCTs), random encouragement designs (REDs), and quasi-experimental designs (QEDs) using consumption data (like monthly bills or AMI meter reads) to estimate savings for a variety of programs. RCTs estimate net savings by design but other consumption data analysis methods may be net, gross, or somewhere in between. In some cases, evaluators may be able to use methods that produce estimates that are acceptably close to net without further adjustment, while in other cases a NTGR may need to be developed outside the consumption data analysis and then multiplied by the estimate to produce net savings. Therefore, the NTG adjustment method will differ and needs to be justified by the evaluator on a case by case basis.

## 6.3 Deemed or Stipulated NTG Ratios

A deemed (or stipulated) NTG ratio is a value known prior to implementing a program and applied to estimate net savings for that program in a certain year.

Deemed or stipulated NTG ratios may be based on previous primary data collection, a review of secondary data, or agreed to among stakeholders. In Illinois, deemed or stipulated NTG ratios should reflect best estimates of likely future actual NTG ratios for the relevant program year, taking into consideration stakeholder input, the evaluator's expertise, and the best and most up-to-date information.

## 6.4 Common Practice Baseline Approaches

For this method, the evaluation team estimates what a typical consumer would have done at the time of the project implementation. Essentially, what is "commonly done" becomes the basis for baseline energy consumption and calculation of net savings. No gross impacts are calculated in this approach. This baseline is defined as the counterfactual "i.e., what would have occurred absent the program" and has been referred to as current practice, common practice, or industry standard practice. Evaluators determine these practices through multiple methods, but often can be from self-report or on-site audits. The difference between the energy use of measures installed in the program and the energy use associated with current practice is considered by some to be sufficiently close to the net savings.

This approach is not in use in Illinois, but it is used elsewhere in the country, such as the Pacific Northwest and Delaware.

## 6.5 Market Analyses

Market analyses can be done in several ways. Market analyses are often used in theory-driven evaluations of market transformation programs.

Other non-sales data market analyses can be postulated on changes specified in program logic such as: 1) changes in the number of energy-efficient units manufactured; 2) changes in market actor behavior around promotion or stocking of energy-efficient items; or 3) reductions in prices. The analyses involving non-sales data must make a clear link between the program intervention and the changes found in the market. Additionally, outside of Illinois, while evaluators have extrapolated the market changes to specific energy or demand reductions, this activity may be viewed as tenuous due to assumptions that evaluators must make within the analysis.

Illinois is in a position to begin to discuss market analyses and how specific research may be able to interpret changes that have occurred (or may occur in the future) because of the program interventions over the past eight years.

Market analyses can be backward looking through historical tracing, but it is best used when the logic of an intervention is described, and specific market metrics are tracked over time.

## 6.6 Structured Expert Judgment Approaches

Closely tied to market analysis, this approach is a way for evaluators to gather credible evidence of changes that arise due to the intervention of a program. When deployed, it is often used as a cost-effective approach to estimate market effects or reach agreement on a NTG value when several different types of evidence are available. The key premise of this approach is the use of a select group of known experts that all stakeholders agree can provide unbiased information as well as having sufficient knowledge to judge what may have occurred absent a program intervention.

A Delphi Panel is an example of this approach where data are collected from two or more rounds of data collection (which can occur via e-mail, Internet, or in person). A round is when experts make their thoughts known about a specific subject; the evaluation team synthesizes the data and provides this collated data back to the group to discuss again. Allowing the full experts to see how their peers think about a topic helps to move the group towards consensus.

### References

- Mosenthal, et al., 2000
- Powell, 2002

## 6.7 Program Theory-Driven Approach

This approach is not included in the Violette and Rathbun (2017) document as a high-level method, but it is discussed by the authors under the historical tracing method. The Illinois evaluators believe that it deserves at least a short discussion within this framework.

A program theory is the written narrative about why the activities of a program are expected to bring about change. Typically associated with this approach is the direct graphical explication of the linkages between activities, outputs, and outcomes through an impact logic model.<sup>107</sup>

A theory-driven evaluation denotes “[A]ny evaluation strategy or approach that explicitly integrates and uses stakeholder, social science, some combination of, or other types of theories in conceptualizing, designing, conducting, interpreting, and applying an evaluation.” (Coryn 2011) Within this approach, the ultimate conclusions regarding the efficacy of a program are based on the preponderance of the evidence and not on the results of any single analysis. Coryn and colleagues systematically examined 45 cases of theory-driven evaluations published over a 20-year period to ascertain how closely theory-driven evaluation practices comport with the key tenants of theory-driven evaluation as described and prescribed by prominent theoretical writers. One output from this analysis was the identification of the core principles and sub-principles of theory-driven evaluation. If interested, please review the reference under Coryn 2011.

As an approach, it is best used for complex programs and/or causal mechanisms that extend far into the future. Evaluators collect evidence that supports or rejects hypotheses that are explicit in the logic model. The case for program attribution is strengthened based on the extent to which an evaluation shows that the expected changes occur. Additionally, the evaluation team may be able to collect data that will answer questions about the longer-term outcomes of a program. This type of data collection may be very similar to market tracking activities described briefly above under Market Analyses.

This approach does not specifically estimate a NTG value, but Program Administrators can choose to keep, drop, or change a program based on intermediary data. Regulators must be convinced that the logic of a program is sound and that the intermediary outcomes are causally linked to expected savings.

---

<sup>107</sup> Evaluators may use logic models to show program processes as well, but this is a program flow chart, not an impact model.

## References

- Weiss, 1997
- Chen, 2000
- Coryn, 2011

## 6.8 Case Studies Design

Case studies are used extensively in social sciences as well as many other disciplines or practice-oriented areas, such as political science, economics, education, and public policy. Case studies help to understand the how and why of a situation and typically retain a holistic aspect of real-life events. As such, they may be a useful approach to determine attribution. As with program theory design, though, the data collected and analyzed within a case study approach will not typically yield a specific NTG value, but can provide credible evidence and insight that supports or refutes the changes brought about by program intervention.

To be used to assess attribution, evaluators must carefully design case studies to assure they account for the threats to causality (i.e., internal validity) that arise in any design. While not typically thought of in this manner, case study design can address multiple types of validity such as construct, internal, and external validity as well as assuring reliability. When establishing construct validity and reliability, evaluators must use multiple sources of evidence, create and maintain a study database, and maintain a “chain of evidence” within the analysis. Internal validity is shown through analytic tactics such as pattern matching, explanation building, addressing rival explanations, or using logic models. External validity centers on the ability to generalize the analytical findings to other similar situations. External validity may be shown through the replication of findings.

## References

- Yin, 2003
- Stake, 2006

## 7 Appendix B: References

- Abadie, A. and G. W. Imbens. (2002). Simple and bias-corrected matching estimators [Technical Report]. Department of Economics, University of California, Berkeley. Retrieved March 6, 2016, from <http://ideas.repec.org/p/nbr/nberte/0283.html>.
- Abadie, A. and G. W. Imbens. (2006). Large sample properties of matching estimators for average treatment effects. *Econometrica*, 74, pp. 235-267.
- Agnew, K. and M. Goldberg. (2017). Whole Building Retrofit with Consumption Data Analysis Evaluation Protocol: Chapter 8 of the Uniform Methods Project, National Renewable Energy Laboratory.
- Bradburn, Norman, Sudman, Seymore, and Wansink, Brian. 2004. Asking Questions. The Definitive Guide to Questionnaire Design – For Market Research, Political Polls, and Social and Health Questionnaires. San Francisco, CA: Jossey-Bass.
- Chen, Huey-Tsyh. 1990. Theory-Driven Evaluations. Sage Publications.
- Coryn, Chris L.S., Norakes, Linday A., Westine, Carl D., Schröter, Daniela C. 2011. “A Systematic Review of Theory-Driven Evaluation Practice from 1990 to 2009.” *American Journal of Evaluation*, 32(2): 199-226.
- Donaldson, Steward I., Christie, Christina A., Mark, Melvin M. 2009. What Counts as Credible Evidence in Applied Research and Evaluation Practice? Los Angeles, CA: Sage Publications, Inc.
- EMI Consulting. (2018). Xcel Energy: Colorado Cooling Efficiency Product: 2017 Evaluation. Prepared for Xcel Energy.
- Fowlie, M.; Greenstone, M.; Wolfram, C. (2015). Are the Non-Monetary Costs of Energy Efficiency Investments Large? Understanding Low Take-up of a Free Energy Efficiency Program. *American Economic Review: Papers and Proceedings* 105(5): 201-204. <  
[https://www.povertyactionlab.org/sites/default/files/publications/389\\_500%20Weatherization%20AER.pdf](https://www.povertyactionlab.org/sites/default/files/publications/389_500%20Weatherization%20AER.pdf)>
- Greene, W. H. (2003) *Econometric Analysis* (5th Ed.). Upper Saddle River, N.J.: Prentice Hall.
- Goldberg, M. L. And K. Train, (1995) Net Savings Estimation: An Analysis of Regression and Discrete Choice Approaches. Submitted by Xenergy Inc. To CADMAC Subcommittee on Base Efficiency.
- Goldberg, M.; Agnew, K.; Train, K.; Fowlie, M. (2017). Mitigating Self-Selection Bias in Billing Analysis for Impact Evaluation. Pacific Gas and Electric Company. CALMAC Study ID PGE0401.01. <  
[http://www.calmac.org/publications/Mitigating\\_Self\\_Selection\\_Bias\\_in\\_Bill\\_Analysis\\_8.4.17.pdf](http://www.calmac.org/publications/Mitigating_Self_Selection_Bias_in_Bill_Analysis_8.4.17.pdf)>
- Gou, Shenyang and Mark W. Fraser, (2015). Propensity Score Analysis: Statistical Methods and Applications. Los Angeles, CA: SAGE Publications.
- Hansen, B. B. and S. O. Klopfer. (2006). Optimal Full Matching and Related Designs via Network Flows. *Journal of Computational and Graphical Statistics*, 15, pp. 1-19.
- Harding, M. and Hsiaw, A. 2013. Goal Setting and Energy Conservation Available at: [http://people.duke.edu/~mch55/resources/Harding\\_Goals.pdf](http://people.duke.edu/~mch55/resources/Harding_Goals.pdf).
- Heckman, J. J. (1979). Sample Selection Bias as a Specification Error. *Econometrica*, 47(1), pp. 153-162.
- Heckman, J. J. (1978). Dummy Endogenous Variables in a Simultaneous equations system. *Econometrica*, 46(1), pp. 931-960.
- Ho, D.E., Imai, K., King, G. and Stuart, E., 2007. “Matching as Nonparametric Preprocessing for Reducing Model Dependence in Parametric Causal Inference.” *Political Analysis* 15(3): 199-236.
- Mohr, Lawrence B. 1995. *Impact Analysis for Program Evaluation*, Second Edition. Thousand Oaks, CA: Sage Publications, Inc.
- Mosenthal, Philip, Prah, Ralph, Neme, Chris, and Cuomo, Robert. 2000. A Modified Delphi Approach to Predict Market Transformation Program Effects. Proceedings from the 2000 ACEEE Conference.

Powell, Catherine. 2002. "The Delphi Technique: Myths and Realities." *Journal of Advanced Nursing*. 41(4), 376-382.

Randazzo, K., Ridge, R. and Wayland, S. Evaluating Whole-Building Programs: It is harder and easier than you think! Presented at the International Energy Program Evaluation Conference in August 2017.

Rosenbaum, P. R. and D. B. Rubin. (1983). The central role of the propensity score in observational studies for causal effects. *Biometrika*, 70, pp. 41-55. 21

Rosenbaum, P. R. and D. B. Rubin. (1985). Constructing a control group using multivariate matched sampling methods that incorporate the propensity score. *American Statistician*, 39, pp. 33-38.

Scriven, Michael. "A Summative Evaluation of RCT Methodology and an Alternative Approach to Causal Research." March 2008. *Journal of MultiDisciplinary Evaluation*, Volume 5, Number 9. ISSN 1556-8180.

Shadish, William R., Cook, Thomas D., and Campbell, Donald T. 2002. *Experimental and Quasi-Experimental Designs for Generalized Causal Inference*. Boston: Houghton Mifflin Company.

Stake, Robert E. 2006. *Multiple Case Study Analysis*. The Guilford Press.

Stone, Arthur A., Turkkan, Jaylan S., Bachrach, Christine A., Jobe, Jared B., Kurtzman, Howard S., Cain, Virginia S. editors. 2000. *The Science of Self-Report. Implications for Research and Practice*. Lawrence Erlbaum Associates, Inc.

Sudman, Seymour, Bradburn, Norman, Schwarz, Norbert. 1996. *Thinking about Answers. The Application of Cognitive Processes to Survey Methodology*. Jossey-Bass.

Train, Kenneth. (1993). Estimation of Net Impact from Energy Conservation Programs. Submitted to the Southern California Edison Company.

Violette, Daniel M.; Rathbun, Pamela. (2017). Chapter 21: Estimating Net Savings – Common Practices: Methods for Determining Energy-Efficiency Savings for Specific Measures. Golden, CO; National Renewable Energy Laboratory. NREL/SR-7A40-68578. <http://www.nrel.gov/docs/fy17osti/68578.pdf>

Weiss, Carol H. 1998. *Evaluation Methods for Studying Programs and Policies*, 2nd Edition. Upper Saddle River, New Jersey: Prentice Hall.

Wooldridge, J. M. (2002). *Econometric Analysis of Cross Section and Panel Data*. Cambridge: MIT Press.

Yin, Robert K. 2003. *Case Study Research. Design and Methods*. Thousand Oaks, CA: Sage Publications, Inc.

## Attachment B: Effective Useful Life for Custom Measure Guidelines

This section provides guidelines on the EUL values to use for the custom measures and programs. The approach for assigning EUL values to non-TRM measures is different from the approach used to assign EUL values to prescriptive measures because the non-TRM EUL (1) may be dependent on a mix of measures, or (2) may not be supported by previous primary and secondary research.

Similar to evaluating custom program savings on a retrospective basis, if there is a defined EUL for a measure or project<sup>108</sup> that does not use a TRM value or the correct TRM value, the evaluator will revise the value accordingly and apply the results in the verified lifetime savings and CPAS. As a result, the implementation team should be consistent and comprehensive in its documentation of the identified EUL.

The complexities of the various approaches for custom-like programs require a program-by-program perspective. The following process should be used to determine the EUL value for custom measures.


Figure 1-1 provides guidance as to what the evaluation team will review and address in providing evaluated CPAS savings. Similar to first year energy savings calculations, appropriate documentation should be provided to support the EUL value which may include references, approach, and reasons.

1. Identify the non-TRM measure and consider if there are similar measures with high quality EUL values already in the TRM. This initial step provides a benchmark for the EUL value.
2. Review the sources used to determine the EUL values for those similar measures. See Table 1-3.
3. If the sources do not have EUL documentation for the non-TRM measure, research additional sources. The level of research effort should be commensurate with the savings potential for the non-TRM measure.
4. If EUL documentation for the non-TRM measure is insufficient (such as a low-quality source from Table 1-3), assess if EUL values for similar measures are appropriate substitutes.
5. If none of the above meets the source reference quality criteria, use the recommended default EUL value provided in Table 1-3 and 1-2.

---

<sup>108</sup> A measure is considered one isolated technology that can be defined for energy savings and EUL. A project is made up of a system of technologies such as an HVAC system retrofit where specific measure savings cannot be individually analyzed.

**Figure 1-1. Proposed Approach for Determining EUL for Non-TRM Measures<sup>109</sup>**

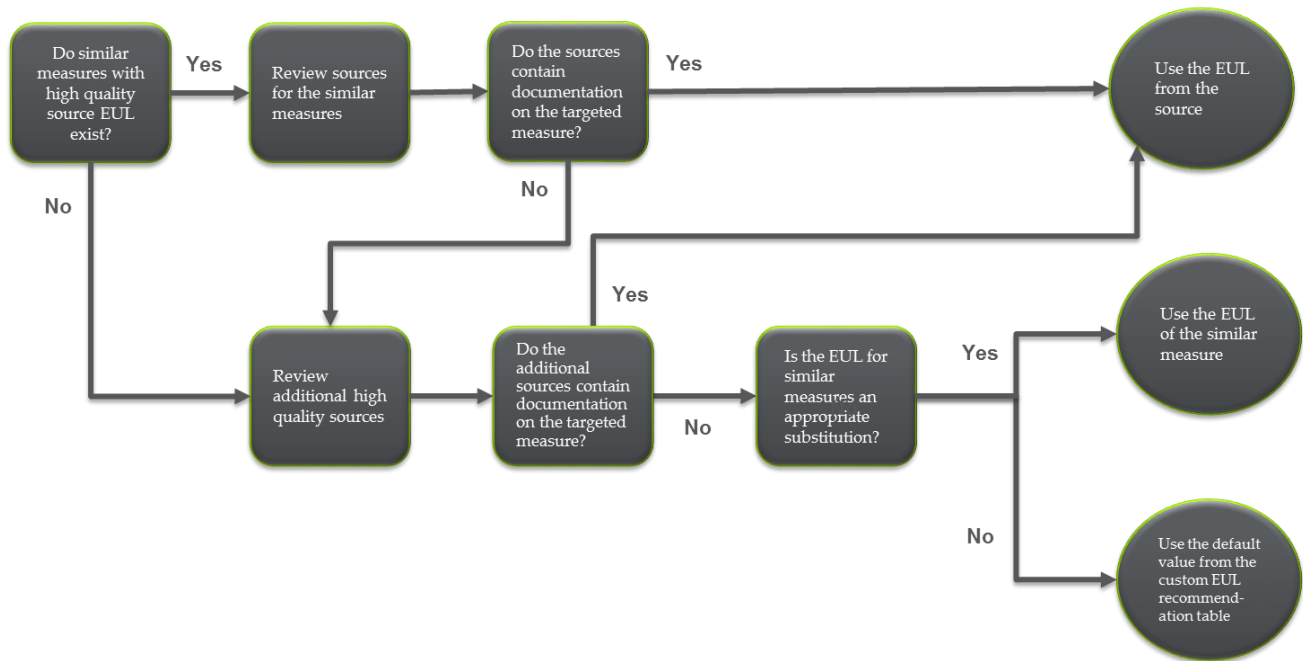

The recommended values in Table 1-3 are a result of initial research into EUL values for non-TRM measures and may be considered as deemed. The recommended values can be used by program implementers when the steps presented in Figure 1-1 do not result in sufficient information to determine the appropriate EUL value for a non-TRM measure.

**Table 1-3. Recommended Commercial Custom Measure End-Use Categories, Subcategories and Effective Useful Life Values**

Program/End-Use Category	End-Use Subcategory	Sample Mapped Measures	EUL (years)	Notes
Combined Heat and Power	Combined Heat and Power	CHP	Capped at 25	Project specific
Compressed Air	Custom Compressed Air – Equipment	Compressed Air Pressure Reduction Low-Pressure Blower System (replacing compressed air)	15	Default value Future research may show that EULs for compressed air measures vary significantly between equipment and controls.
	Custom Compressed Air – Controls	Compressed Air Flow Controller		

<sup>109</sup> Custom EUL recommendation table is Table 1-3.

Program/End-Use Category	End-Use Subcategory	Sample Mapped Measures	EUL (years)	Notes
	Compressed Air Leak Repair	Compressed Air Leak Repair	1 - 5	A range of possible lifetime values is provided. Therefore, the implementers of this measure must justify the reason for selecting an appropriate measure life for each project and the decision will be subject to evaluation with the risk of adjustments. <sup>110</sup>
Data Centers	Custom Data Centers - Equipment	Data Center	15	Default values
	Custom Data Centers – Controls		15	Future research may show that EULs for data center measures vary significantly between equipment and controls.
Energy Management System	Energy Management System	Energy Management System	15	Default values
	Custom Electric HVAC – Equipment	Custom Electric HVAC	13	
		VAV Fume Hood		
		Chilled Water Reset		
		Fume Hood Occupancy Controls		
HVAC		Electric HVAC Controls		Default values
	Custom Electric HVAC - Controls	Low-Flow High Performance Hood -	15	
		Reduce/Optimize Air Change per Hour (ACH) Rate - Chiller		
		Sash Stops		
Lighting	New Construction/ Custom Lighting	Ceramic MH Lamp	15	Section 4.5.8 of the TRM covers 'Miscellaneous Commercial/Industrial Lighting'. It applies to "energy efficient lighting upgrades that are not captured in other measures within the TRM". The measure applies to retrofits and appears to be applicable to any non-prescriptive lighting measures,
		New Construction Lighting		

<sup>110</sup> Note during IL TRM v7.0 updates, this assumption was discussed at length with the realization that there is a lack of a strong source for defaulting the lifetime and different applications may vary significantly. It is hoped that future research will help to inform an appropriate assumption(s) to update this assumption for v8.0.



Program/End-Use Category	End-Use Subcategory	Sample Mapped Measures	EUL (years)	Notes
	Custom Lighting - Controls	Advanced Lighting Control Systems	10	which would imply a 15-year measure life for custom lighting measures. It does not cover new construction or controls, thus the recommendation to include these subcategories.
Non-Res New Construction	Non-Res New Construction	New Construction – Electric Measures	17.4	Based on research of measure level breakdown of typical projects in a program year.
		New Construction – Gas Measures	20.6	
Refrigeration	Custom Refrigeration	Efficient Refrigeration Condenser		Default value
		Floating Head Pressure Controls		Research may show that EULs for refrigeration measures vary significantly between equipment and controls.
		Refrigerated Cases	15	If that is not the case, the recommended end-use subcategory will continue working well.
		Refrigeration Compressor		If that is the case, at that time the end-use subcategories should be updated to the following: Custom Refrigeration – Equipment Custom Refrigeration – Controls
		Refrigeration Controls		
Retro commissioning	Retro commissioning	Electric RCx Measures	8.8	Research may show that EULs for RCx measures vary significantly between RCx categories or RCx delivery methods. If that is not the case, the recommended program level value will continue working well.
Strategic Energy Management	Strategic Energy Management	SEM	5	Only applicable to behavior or operational measures.
Custom – Other	Custom Other	Barrel Wraps for Injection Molders and Extruders	Custom	This category is intended to capture unique, one-off projects/measures that do not fall under the other recommended end-use categories. Each project/measure should have a custom EUL. To achieve this, the implementer will provide an ex ante EUL for the project/measure and the evaluator will assess it for
		Blowers		
		Building Envelope		

Program/End-Use Category	End-Use Subcategory	Sample Mapped Measures	EUL (years)	Notes
		Controls		reasonableness and revise as necessary.
		Cooling Tower/Heat Exchanger		As a last resort where there is no basis for a custom EUL a default of 13 years is provided and is deemed appropriate for electric measures.
		Filter		
		Injection Molding Machine		
		Low Pressure Drop High Efficiency (Non-HEPA) Air Filters		
		Piping/Duct Modification		
		Pump/Fan Replacement		
		Vacuum System		

**Table 1-4. Recommended Residential Custom Measure End-Use Categories, Subcategories and Effective Useful Life Values**

Program/End-Use Category	End-Use Subcategory	Sample Mapped Measures	EUL (years)	Notes
HVAC	Thermostat Optimization	Thermostat Optimization	2	For up to two year’s application of the optimization to the same customers. A third or more year applications would have a one year measure life until evidence of persistence is available. <sup>111</sup>
Res New Construction	Res New Construction	New Construction Electric Measures	18	
	Affordable Housing New Construction	Affordable Housing New Construction	-	Varies by project based on implemented measures

<sup>111</sup> This limit to the two year measure life is due to the fact that the optimization builds upon itself; that is, if a thermostat is optimized during a cooling season the setpoints will remain at the optimized levels when that thermostat switches back into cooling mode in the following year, and further optimization applied in that year will change setpoints even further compared to the pre-optimization levels. As the setpoints get more and more extreme from repeated optimizations it is likely that the rate of manual adjustments to the setpoints goes up (thus overriding the optimized setpoints) which shortens the measure life.

Source quality will be determined using hierarchy to describe the strength of the identified source as shown in Table 1-3 below. In cases where a range of values are provided by a source versus an absolute EUL, the median value should be used. In other cases, if more than one high quality source is available with conflicting values, the one with primary research data with strong confidence in the findings should prevail, otherwise, the average EUL should be calculated.

**Table 1-3. Source Strength Type and Examples**

Source Name	Description
<b>TYPE 1: Sources identified as highest strength:</b>	
Primary research conducted or vetted by third-party entities such as trade organizations, national labs, or government organizations	
1.1 U.S. Department of Energy Federal Energy Conservation Standards	The U.S. Department of Energy (DOE) produces Technical Support Documents (TSD) detailing the analysis behind the federal conservation standards established for each product it regulates. Each TSD contains a chapter, often titled “Life Cycle Cost and Payback Period Analysis”, that offers DOE’s EUL estimate for the product and explains how this value was derived. Although the method depends on the data available for a given product, DOE’s analysis generally relies on some combination of primary research, secondary research, modeling, and/or input from industry experts. The TSDs are linked from DOE’s rulemaking page for each product, <a href="https://energy.gov/eere/buildings/standards-and-test-procedures">https://energy.gov/eere/buildings/standards-and-test-procedures</a> .  The TSD measure life values are based on shipment data, secondary literature research and primary research which include discussions with industry experts. Navigant considers as high quality because of the stakeholder review process and due diligence required to create these documents. Only the best available sources are used to support the EUL values used in life-cycle cost analysis for DOE federal equipment standards.
1.2 LED lighting reports prepared by Navigant	Navigant has performed extensive market research on the state of LED lighting for the US. DOE Solid State Lighting Program most recently published in 2016. It includes typical lifetime operating hours for each lamp type by sector.  <a href="https://energy.gov/sites/prod/files/2016/09/f33/energysavingsforecast16_2.pdf">https://energy.gov/sites/prod/files/2016/09/f33/energysavingsforecast16_2.pdf</a>
1.3 Appliance Magazine	Appliance Magazine publishes an annual report on the market value, life expectancy, and expected unit replacements for a range of consumer appliances. The appliances listed in this report change from year to year, so older versions of the report may be referenced for products no longer listed. As noted in the report, these EUL estimates represent the expert judgment of magazine staff based on input obtained from many sources. Portrait of the U.S. Appliance Industry (2001-2009). U.S. Appliance Industry: Market Share, Life Expectancy and Replacement Market, and Saturation Levels (2010). U.S. Appliance Industry: Market Value, Life Expectancy and Replacement Picture (2011-2014).
1.4 C&I Measure Life and Persistence Project	In 2011, Northeast Energy Efficiency Partnership sponsored this study of EUL of commercial and industrial lighting. The primary objective of this study was to conduct primary and secondary research and analysis for estimates of measure lifetimes that included on-site verification of CFL bulbs and fixtures, LED exit signs, HID fixtures, and T8 fixtures. Installations occurred from 1999-2009. <a href="http://www.neep.org/sites/default/files/resources/NEEP_CI_Persistence_Report-FINAL.pdf">http://www.neep.org/sites/default/files/resources/NEEP_CI_Persistence_Report-FINAL.pdf</a>
<b>TYPE 2: Sources identified as medium-high strength:</b>	
Meta-analyses conducted by third-party organizations, that show some level of evaluating the studies that comprise the dataset	

	Source Name	Description
2.1	California DEER	The most recent and comprehensive DEER documentation of EUL sources was from 2008 and 2014. The 2008 version identifies all the sources reviewed and justification for selected measure life. The 2014 measure list identifies the source used for the measure life. Many of the original references are from 2005, <a href="http://deeresources.com/files/deer2005/downloads/DEER2005UpdateFinalReport_ItronVersion.pdf">http://deeresources.com/files/deer2005/downloads/DEER2005UpdateFinalReport_ItronVersion.pdf</a> , p. 11-1.
2.2	Regional Technical Forum (RTF) reference workbook	Ongoing revisions as measures undergo review. Similar to the 2008 DEER, the RTF identifies all the sources reviewed and justification for selected measure life.
2.3	GDS Reports	GDS Measure Life Report Residential and Commercial/Industrial Lighting and HVAC Measures – 2007. This study used various data sources such as DEER, state TRMs, and evaluation studies with a working group to review and decide on each value.
2.4	Focus on Energy Report	Focus on Energy Evaluation Business Programs: Measure Life Study Final Report: August 25, 2009 – this is a critical review of studies, workpapers and technical guides including a review of the underlying sources or supporting research.
2.5	ASHRAE	Original source is from Akalin, M.T. 1978. Equipment life and maintenance cost survey (RP-186). ASHRAE Transactions 84(2):94-106; Recent work is ASHRAE system life database (research project 1237-TRP) - which is a crowd-sourced approach to collecting actual system data. <a href="https://xp20.ashrae.org/publicdatabase/system_service_life.asp?selected_system_type=7">https://xp20.ashrae.org/publicdatabase/system_service_life.asp?selected_system_type=7</a>

**TYPE 3: Sources identified as medium strength:**

Compilations conducted by third-party organizations. Original sources should be cited, and locatable where applicable

3.1	State TRMs	Many state TRMs reference each other and other sources of varying strength. Due diligence on reference documentation is not always present for the measure life. Many TRMs are reviewed via a stakeholder process.
3.2	ENERGY STAR calculators prepared by U.S. EPA and DOE (depending on the references used)	EPA’s Energy Star offers calculators to help consumers and businesses estimate the energy and cost savings that could be realized by choosing to buy Energy Star certified products. Within these calculators, Energy Star offers a typical EUL and cites the source. Energy Star generally cites a single high-quality source (e.g., DOE, Appliance Magazine) for each EUL value and offers no analysis or discussion of the selected value. Energy Star’s calculators can be accessed at <a href="http://www.energystar.gov">www.energystar.gov</a> . For example, their appliance calculator is available at <a href="http://www.energystar.gov/sites/default/files/asset/document/appliance_calculator.xlsx">www.energystar.gov/sites/default/files/asset/document/appliance_calculator.xlsx</a> .

**TYPE 4: Sources identified as medium-low strength:**

Primary research conducted by interested parties such as manufacturers, distributors, retailers or installers

4.1	Interview with interested parties (with no statistical rigor or analysis)	Manufacturer, distributor, installer, etc. have a vested interest and may overstate the benefit.
-----	---	--

**TYPE 5: Sources identified as low strength:**

Source where the basis of measure life is anecdotal, based on design specs, warranty period, etc.

	Source Name	Description
5.1	Industry blogs, Implementer or Navigant experience	Typically based on professional judgment and not rooted in any data.

---

# Attachment C: Framework for Counting Market Transformation Savings in Illinois

## 1 Market Transformation Context

This Attachment was developed in 2019 within the Illinois Energy Efficiency Stakeholder Advisory Group (SAG) Market Transformation Savings Working Group, to describe a high-level framework for estimating savings from Market Transformation (MT) initiatives. MT protocols will need to be developed for individual MT initiatives as they are launched, and may be documented in the IL-TRM or by posting agreed-upon protocols to the SAG website. The development and future inclusion of MT initiative-specific protocols in the IL-TRM will (1) help to ensure consistent evaluation approaches are used for similar MT initiatives that are offered throughout the state and (2) provide utilities with greater certainty as to how specific MT initiatives will be evaluated.

This Attachment is divided into two sections. The first gives the context of Market Transformation (MT) and describes some of its unique features that influence the estimation of savings. The second part describes high-level methodologies for determining savings from MT initiatives.

### 1.1 Market Transformation Definition

This protocol uses the following definition for Market Transformation (MT) which is also used by the Midwest Market Transformation Collaborative and is very similar to definitions used by other organizations:

*Market Transformation is the strategic process of intervening in a market to create lasting change that results in the accelerated adoption of energy efficient products, services and practices.*

### 1.2 Market Transformation and Resource Acquisition

An MT initiative can include intervention activities similar to those implemented in standard Resource Acquisition<sup>112</sup> (RA) programs, such as incentives that reduce first costs, training for trade allies, and marketing and case study materials<sup>113</sup>. However, MT initiatives additionally include activities that specifically seek to affect the long-term structure of a market in ways that are not easily undone. For example, working directly with manufacturers on product specifications and features or engaging with ENERGY STAR and DOE on test procedures and rulemakings.

Figure 1 depicts the types of activities that might be included in an MT initiative. There are a number of other process actions required to develop an initiative, such as discussions with stakeholders or setting up an evaluation plan, but this is not the subject of the figure. An example of an MT initiative with multiple interventions is the Heat Pump Water Heater (HPWH) Initiative<sup>114</sup> in the Northwest. Interventions include: Technical support for development of ENERGY STAR specifications; Laboratory testing of new HPWH to prove performance claims; Upstream manufacturer engagement including incentives to encourage aggressive market pricing; Customer facing retail rebates; Providing technical information to the US DOE standards process in support of HPWHs being cost-effective for large tank sizes; and Working with local jurisdictions to develop code provisions that provide “extra-credit” for HPWH in new construction.


---

<sup>112</sup> Resource acquisition (RA) is defined in the glossary but is used loosely in this Attachment to refer to more traditional utility driven energy efficiency programs that typically work at the individual consumer level, rather than the market level.

<sup>113</sup> For a review of best practices for designing and implementing market transformation initiatives, see Keating (2014).

<sup>114</sup> A description of this initiative can be found in recent reports from NEEA: <https://neea.org/resources/northwest-heat-pump-water-heater-initiative-market-progress-evaluation-report-3> or <https://neea.org/resources/northwest-heat-pump-water-heater-initiative-market-progress-evaluation-report-4>

Figure 1-1: Examples of Potential MT Activities Under a “Theory Umbrella”

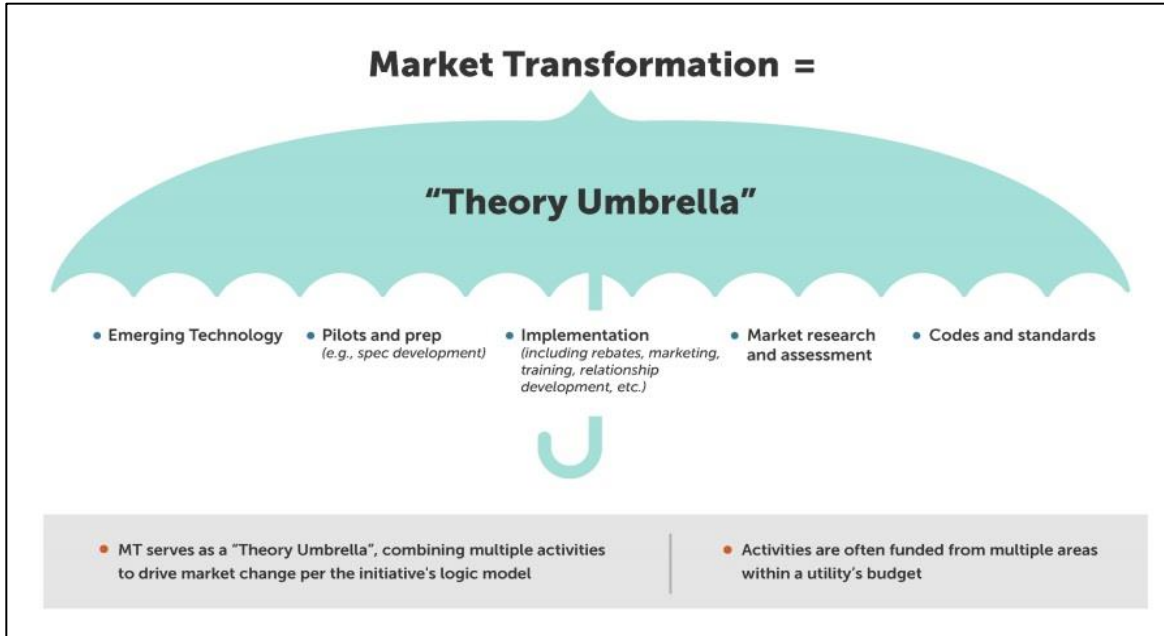

Each MT initiative must establish its own unique overarching MT theory with an “umbrella hypothesis” under which a variety of strategic activities, including those that may be occurring through other parts of the utility or even other organizations, can be combined to affect the desired market change. The goal of this set of activities is to reduce market barriers and leverage opportunities to create lasting market change. The entire set of activities are incorporated in the overall MT initiative hypothesis and logic model, even if some of those activities might be funded or implemented from different budgets or organizations.

RA activities can also result in market changes<sup>115</sup> and RA savings approaches may also include documenting market effects for those programs independently from an MT initiative. However, RA savings are normally measured through participation in a program rather than whole market effects. There are further differences between RA and MT that influence the methods for calculating savings and key difference are shown in table 1 below. While this protocol addresses savings from initiatives identified as MT, RA savings approaches may also include documenting market effects for those programs independently from an MT initiative. Accounting for overlap in MT and RA program savings is discussed in a later section of this paper.

Although an MT initiative might include activities similar to an RA program under the MT Theory Umbrella, the significant differences between MT and RA program types provide important context for planning, implementation and evaluation. As summarized in Table 1 below, these differences include: the scale of the intervention, the target market, the ultimate goal, the fundamental program approach, the time frame over which cost effectiveness must be evaluated, the amount of program administrator (PA) control, and the set of activities that are tracked, measured and evaluated.

<sup>115</sup> For example, NMR Group, Inc. (2014) reviews methods for the evaluation of market effects primarily (though not exclusively) for RA programs.

**Table 1-1: Comparing Resource Acquisition Programs and Market Transformation Initiatives<sup>116</sup>**

	Resource Acquisition	Market Transformation
<b>Scale</b>	Program Administrator’s service territory	Entire defined market
<b>Target</b>	Whoever can be induced to participate	All consumers of a particular product or service
<b>Goal</b>	Near-term savings	Structural changes in the market leading to long term savings
<b>Approach</b>	Save energy through customer participation	Save energy through mobilizing the market
<b>Scope of Effort</b>	Results from a single program	May result from effects of multiple programs or interventions
<b>Level of Program Administrator Control</b>	PAs can control the pace, scale, geographic location, and can usually identify participants	Markets are very dynamic, and the PAs are only one set of actors. If, how, where, and when the impacts occur are usually beyond the direct control of the program administrators
<b>Evaluation and Measurement</b>	Energy use and savings, participants, free-ridership, and sometimes spillover	Interim and long-term indicators of market progress and structural changes, attribution to the program, and cumulative energy impacts
<b>Timeframe for planning, savings measurement, and cost-effectiveness</b>	Typically based on annual or multi-year planning and reporting cycle savings	Typically planned and implemented over a 10-20 year timeframe

Historically, the differences between the two approaches have created challenges for MT initiatives to thrive in states where policy frameworks are strongly focused on resource acquisition<sup>117</sup>. The much longer time frame for MT initiatives and the lesser degree of program administrator control can be difficult to reconcile with policy rules that are focused largely on the precise quantification of annual savings.<sup>118</sup> Evaluation of net savings can be fraught in jurisdictions where financial incentives or penalties are determined based on evaluated results, and can be particularly challenging for MT initiatives, which require market analyses that introduce additional uncertainty. Operating MT initiatives in this scenario requires upfront negotiation on evaluation processes to set clear expectations on measurement approaches.

### 1.3 Market Transformation and Attribution

The concept of attribution - or the attempt to assess the extent to which observed outcomes are caused by the program(s) of interest as opposed to events that would have happened regardless of any intervention - is

<sup>116</sup> Source: adapted from Prah and Keating, 2014; derived in turn from Keating, et al. and Sebold et al., 2001.

<sup>117</sup> Note, for example that a regulatory framework supporting the MT initiative is cited as one of three “must-have components” for MT to thrive in a recent Illinois Summit on MT. ComEd Energy Efficiency Program “Energy Efficiency Market Transformation Summit Report”, Navigant Consulting, February 2019.

<sup>118</sup> For a comprehensive discussion of the challenges of reconciling MT and RA within an RA-dominant policy framework, see Prah and Keating (2014).



fundamental to the evaluation of energy efficiency programs<sup>119</sup>. Without attribution, it is difficult to understand the success or failure of a program – and to improve (or to justify continued public funding for) a program whose success or failure is not understood.

While attribution is relevant to both market transformation initiatives and resource acquisition programs, there are important differences to approaching attribution between the two types of programs. For resource acquisition programs, it has long been the norm in much of the US to treat attribution as a continuous variable that can be quantitatively scored (often in the form of a net-to-gross ratio that adjusts for free ridership and spillover) and applied to savings claims at frequent intervals with relative granularity. RA programs can ask questions directly of actual participants to ascertain attribution. However, MT initiatives typically do not lend themselves to this type of quantitative approach. More often than not, there is too much elapsed time over the lifecycle of a market transformation initiative and too many other market forces at work for a quantitative attribution score to be meaningful. So instead, market transformation paints a qualitative case as to whether the initiative was generally successful in causing the intended market changes.<sup>120</sup>

Successful incorporation of MT initiatives into a program portfolio that is dominated by resource acquisition programs generally requires that stakeholders accept these methodological differences between the two program approaches, and the fact that with MT initiatives, attribution can typically only be established qualitatively.

It is important to note this does not imply that quantitative estimates of net savings should not be made for MT initiatives. Fundamentally, all Illinois efficiency programs will need to quantitatively estimate savings so long as counting the savings toward goals and estimating cost-effectiveness is adopted policy. It simply means that net savings for MT initiatives will be significantly less certain by nature than those for pure RA programs. Defensible methods for dealing with the limits to quantifying attribution for MT initiatives are discussed at length in the second half of this paper.

#### 1.4 What Makes an MT Initiative Recognizable?

Because of the difference in evaluation approaches between an MT initiative and an RA program, it is important to first confirm whether an initiative falls into the MT category or the RA category before developing savings estimates.

To qualify as an MT initiative, there needs to be a clearly delineated target market<sup>121</sup>, as well as a documented theory of change in this market (or MT hypothesis) that is embedded in a defensible logic model,<sup>122</sup>. This logic model provides the linkages between program activities and the anticipated lasting market change that accelerates the adoption of energy efficiency. The logic model is documented in the MT Business Plan<sup>123</sup> or similar document and is developed in advance of executing activities. MT initiatives are not created by looking backwards and claiming credit for market changes from previous programs. Nor are all “upstream” programs MT by default. For example, the upstream program may not result in any lasting change to the market and once the incentive is removed the market reverts to its prior condition.

#### 1.5 Evaluation and Measurement of Savings in MT Initiatives

Energy savings from MT initiatives are the end result of increased and accelerated market adoption over and above the hypothesized future that would have happened without the MT initiative. Attributing savings to MT initiatives requires the assumption that some portion of the observed changes in market adoption are the direct result of a targeted, strategic market intervention that was designed and implemented to achieve that result. The MT

---

<sup>119</sup> See additional discussion on attribution in the Illinois Technical Reference Manual, Volume 4: Cross-Cutting Measures and Attachments, Section 2.

<sup>120</sup> In this regard, the evaluation of market transformation initiatives closely resembles most other fields of social program evaluation, and it is actually the evaluation of resource acquisition programs that is unusual. For example, evaluations of early intervention education programs such as Head Start routinely concern themselves with the issue of attribution, but they generally do not seek to construct a quantitative attribution score for a specific program, region, and year.

<sup>121</sup> As shown in the glossary, this paper uses the following common definition of a market: an actual or nominal place where forces of demand and supply operate, and where buyers and sellers interact (directly or through intermediaries) to trade goods, services, or contracts or instruments, for money or barter.

<sup>122</sup> In some regions of the country, this is called a “program theory.”

<sup>123</sup> The content of an MT Business Plan is listed in Appendix A.

framework requires both validation of the MT initiative logic and an evaluation of program implementation and progress towards specific market progress indicators before savings can be estimated.

The following section discusses several core concepts specific to the evaluation of MT initiatives.<sup>124</sup>

### 1.5.1 Evaluation Approach – Theory-based Evaluation

Methodologically, MT evaluation tends to rely heavily on Theory-Based Evaluation (TBE).<sup>125</sup> TBE starts with a theory of change that explains how an intervention is expected to produce results. This theory of change is embodied in the logic model that is the core of an MT initiative. Theory-based evaluation 1) attempts to understand if observed changes in the market are consistent with those that would be expected if the initiative were successful, and 2) seeks to understand an intervention's contribution to those market changes. Because the unit of analysis is an entire market not a single transaction, MT evaluations tend to require numerous pieces of evidence that 1) change is occurring; and 2) the program is influential in that change.<sup>126</sup> A preponderance of evidence approach, rather than proof is most often required. It is important to note that “preponderance of evidence” does not require that all indicators show overwhelming evidence of programmatic influence, but rather that multiple indicators show consistent direction. This information can be qualitative (based on in-depth interviews or observational data collection) or quantitative (based on market share or production data).

Under a TBE approach, it is important to assess the consistency of the changes observed in the market with those predicted by the program theory. It can also be important to have a mix of leading indicators (such as early shifts in market share), which provide timely feedback on the near-term progress of the program and the market, as well as lagging indicators, (such as new entrants in the supply chain for the energy efficient product) which can be used to help assess longer-term outcomes.

### 1.5.2 Evaluation Products

To evaluate a market transformation initiative effectively, it is essential to conduct regular research to understand market changes and implications for program adaptation. The Northwest Energy Efficiency Alliance (NEEA) refers to these regular evaluations as Market Progress Evaluation Reports (MPERs) and typically executes one per initiative yearly.<sup>127</sup> MPERs include components of impact and process evaluation, market research, and planning and market assessments and are designed to document progress and market change over the initiative's life cycle. It usually takes multiple MPERs over time to tell the complete story of an initiative.

The MPER scope is centered around 1) an assessment of the strength of remaining barriers and 2) measurement of Market Progress Indicators (MPIs).<sup>128</sup> MPIs are market-based milestones associated with progress hypothesized in the logic model and confirmed as appropriate real-world indicators of progress. Examples of MPIs include market share for the efficient option, changes in product availability, or evidence of promotional activity by affiliated or unaffiliated market actors. Regular assessment of MPI progress plays a central role in building a qualitative case for

---

<sup>124</sup> For a comprehensive review of best practices for the evaluation of market transformation initiatives, see NMR Group, Inc. (2013). For a more condensed discussion, see Prahl and Keating (2014). Metrics, Tracking, and Performance Assessment Working Group (2018) provides a regional perspective by discussing New York state's approach to the evaluation of its market transformation efforts. Also see Navigant (2018) for a discussion of best practices in MT design. Finally, it is important to keep in mind that both market transformation initiatives and resource acquisition programs can cause market effects; NMR Group, Inc. (2014) reviews methods for the evaluation of market effects primarily (though not exclusively) for RA programs.

<sup>125</sup> See Chen (1990) or Weiss (1998). TBE is also often useful for resource acquisition programs but tends to be particularly central for the evaluation of market transformation initiatives. For a discussion of the application of TBE to energy efficiency programs in general, see Section 6.9 in Attachment A of the cross-cutting protocols.

<sup>126</sup> Examples might include: changes in efficient market share or product positioning; changes in leading indicators such as distributor stocking practices, consumer awareness, or new vendors entering into the market; self-reports of program effects from market actors; evidence of change in the prevalence of training/credentials, sales or installation data,—basically, evidence that the efficient option is being “normalized”.

<sup>127</sup> In other regions, such recurring efforts may go by other names. However, the general concept of regular, recurring efforts to understand the progress of a market transformation initiative is widely accepted in the energy efficiency industry. This paper uses the term MPER for envisioned MT evaluations in Illinois. For examples of completed MPERs, see <https://neea.org/resources-reports>

<sup>128</sup> Market Progress Indicator is the term used in the Northwest. A closely related term that is often used in other regions of the country is “market indicator,” although there are shades of differences in the meanings of the terms.

attribution over time via theory-based evaluation.

## 1.6 Uncertainty and Risk in MT Savings Estimates

It is also important to understand that MT interventions operate with a different level of certainty than many resource acquisition programs. Experimental design and tight error bounds on realized energy savings are not realistic expectations for initiatives that seek to animate, but not control, market shifts. One key reason for this greater uncertainty, as discussed above, is the greater difficulty of establishing attribution. In addition, needed market data (particularly sales data) can be hard to obtain. Finally, uncertainty also stems from items such as a rapidly changing product category or a reliance on the indirect influence of retail sales people.

To help stakeholders and utilities assess the risks associated with this uncertainty, program designers should engage early with planning and evaluation professionals with experience in market transformation. Establishing energy savings methods associated with the proposed intervention and gaining acceptance for the proposed baseline often requires multiple rounds of review and refinement as data and assumptions are vetted. At the time of writing, it is anticipated that the Illinois Stakeholder Advisory Group Working Group on Market Transformation Savings will serve as a forum to effectively plan MT initiatives and navigate unexpected market events.

## 2 Estimating Savings for MT Initiatives

### 2.1 Overall Approach

There are three key factors to consider when estimating MT savings. The first is the Total Market Savings that result from the entire market adoption of energy efficiency products or services. The second is the Natural Market Baseline, which is an estimate of the market as if there were no utility funded energy efficiency activity. Figure 2 illustrates these two factors<sup>129</sup>. The third is the removal of savings specifically tied to RA programs operating in the same market to prevent double counting. After all three factors are considered, then MT savings are typically allocated to individual service territories.

The first step to estimate savings is to determine MT Units and Unit Energy Savings (UES). MT Units is the result of subtracting Natural Market Baseline Units from Total Market Units. MT UES is the result of subtracting the Unit Energy Consumption (UEC) of the efficient product/service from the UEC of the baseline product/service. These are described more fully in the text below.

$$\text{MT Energy Savings} = \text{Unit Energy Savings (UES)} \times \text{Number of MT Units (Units)}$$

Where:

- *Unit Energy Savings = Unit Energy Consumption (UEC) of baseline product/service – UEC of EE product*
- *Number of MT Units = Total Market Units minus Natural Market Baseline Units;*


Note: Units are adjusted in a subsequent step to account for any overlap between RA and MT.

Figure 2 illustrates the overall approach where Natural Market Baseline is subtracted from the Total Market to estimate MT savings.

---

<sup>129</sup> Not illustrated in the figure are further adjustments for savings from RA programs operating in the same market or allocations of the market savings to individual utility service territories. These are discussed in subsequent sections.

Figure 2-1: Framework for MT Savings

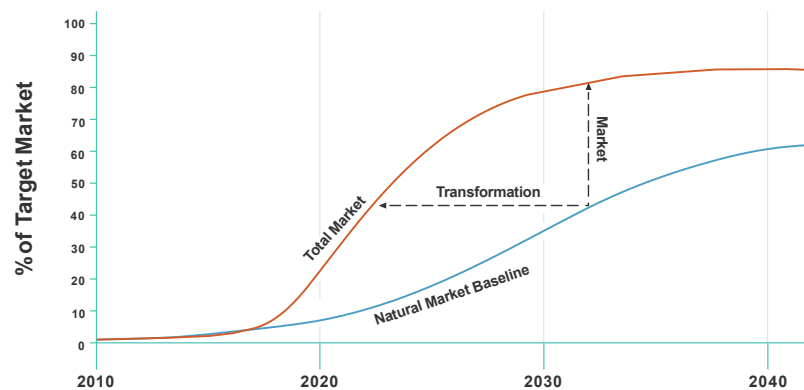

## 2.1.1 Unit Energy Savings

### 2.1.1.1 Theory

Estimating total market savings requires unit energy savings for each unit. The definition of “units” will depend on the energy-efficient product or service that is the focal point for the MT initiative. Units are defined upfront and typically are measured as: a device; square footage; number of housing units; number of operators; pound of product, etc. The appropriate unit definition will have been identified in the MT Business Plan. Savings are measured in kwh/unit, therms/unit, and kW/unit. Note that the average savings per unit for that market likely will be the weighted average savings per unit for different categories of product (such as top-load or front-load clothes washer categories). In this paper unit energy savings reflect the weighted average of all the categories included in the target market.

### 2.1.1.2 Practice

Savings per unit are derived from the delta between the unit energy consumption in the baseline product or service and that of the efficient one. This savings delta can be a deemed value already included in the TRM, it can be calculated as part of the planning and baseline work that informs typical MT programs, or it can be directly tracked or researched.

For MT programs that rely on shifts in practice or sales mix, an appropriate approach to calculating savings can be using the energy consumption embodied in the “standard practice” or “average sales mix” as opposed to a single widget-based calculation. When data is not available for the consumption of standard practice or average sales, modelling of an applicable energy code or standard can also be used.

Analysts can review existing sources of information for savings per unit (or base- and efficient- consumption) and use those estimates if they are applicable. These sources could include the Business Plan for the initiative; prior evaluations; TRMs; load forecasts; existing energy efficiency programs within the utility; emerging technology/R&D results; negotiated settlements on particular savings values, etc.

If existing sources aren’t available or don’t seem sufficiently reliable, the analyst should develop and implement a plan for securing more information on savings per unit. This may include product testing, piloting, or developing an agreed upon proxy for use in the near term with a plan for developing more robust savings estimates over the longer term.

## 2.1.2 Estimating Total Market Units

### 2.1.2.1 Theory

Each market will have unique characteristics and data sources for tracking units in that market. In many markets, extrapolations or approximations based on best available information will need to suffice. Ideally, the initiative should try to track both the total number of units in the market and the portion of units that meet the efficiency

specification in the MT initiative (efficient units). Over time, Market Progress Evaluation Reports will work to track shifts in the relationship between efficient units and total units – which represents the market share of efficient units.

In the case of gas-heated new home construction, for example, Market Progress Evaluation Reports would collect public information on new gas-heated housing starts as well as track the number of new homes meeting a particular efficiency specification. In mass markets, like appliances and commercial food service equipment, the best market data often resides with key market actors, like large distributors or manufacturers. In these cases, the design of the initiative should include a plan to secure sales data for the whole product category and the efficient units as an inherent part of the initiative’s implementation. If not secured at the beginning of an initiative, this data can be difficult or impossible to secure later. As a result, it is optimal to design this data collection into the initiative when starting strategic partnerships with the market actors.

In many cases an initiative is unlikely to have participation from distributors, manufacturers and/or retailers that cover sales in 100% of the market. In this case factors need to be developed to extrapolate the data that is available for a portion of the market to the rest of the market.

### 2.1.2.2 Practice

In practice, planning a market transformation initiative requires developing a plan for obtaining sufficient market data to enable the establishment of a reasonable baseline, as well as for on-going estimation of savings from the MT initiative. Below are a few of the approaches to meet this requirement:

1. **Full category sales<sup>130</sup> or market practice data<sup>131</sup>.** Market analyses are most comprehensive when they include full category data from key actors in the market chain, such as retailers or distributors. They can reveal unexpected trends in product categories that inform both trendlines and program interventions. These data make it possible to understand the market share of the efficient product relative to its competitive set.
2. **Primary data collection and extrapolation.** Because full category data is rarely available, primary research within the target market is frequently used to develop an understanding of the current level of market activity, including the portion consistent with the efficiency threshold sought by the program. Surveys with robust samples of trade allies, design professionals, and distributors can provide data on the square footage, sales in dollar value, project volume or denominator of interest. In cases where downstream rebate programs are operating in tandem with MT engagement, rebate processing data can provide a detailed look at a slice of the total market. Similarly, some upstream programs will be able to collect actual primary sales data on market share for some or all of the market.
3. **Secondary market data.** Regardless of the data available to the program, it is also best practice to include a scan for other sources of market data that might be available outside of the energy efficiency community. Investment briefs, product trend analyses, JD Power or Consumer Reports data, and industry data often gathered by trade associations or similar organizations such as the Association of Home Appliance Manufacturers, NPD Group, Heating Air-conditioning Refrigeration Distributors International, etc.

## 2.2 Estimating Natural Market Baseline

### 2.2.1 The Role of Natural Market Baseline and Attribution

The Natural Market Baseline is a forecast of the future in which no utility-funded energy efficiency programmatic intervention exists. Natural Market Baseline is removed from the Total Market Savings to ensure that the savings counted from ratepayer activities do not include savings that would have occurred without the utility funded programs. This is the MT version of “attribution” and no further adjustment for free riders is needed.

As discussed earlier in the paper, attribution can typically only be established qualitatively for MT initiatives, yet

---

<sup>130</sup> MT initiatives can also operate on buildings (like multi-family ordinances), engage corporations (like Strategic Energy Management), or even drive behavior change (like Building Operator Certification) – assuming they are structured as MT. The goal is still to gather total units as well as efficient units.

<sup>131</sup> Full category sales data includes all sales within a product category such as clothes washers -- both efficient and inefficient units.

under the policy framework in place in Illinois, a net savings figure must be determined. Subtracting the Natural Market Baseline from Total Market Units is the mechanism by which this is accomplished. Once an initial forecast has been made, the focus of evaluation efforts turns to building a case over time as to whether sufficient evidence exists to establish a link between program activities and market effects that are consistent with that forecast. As discussed below, depending on the body of evidence that emerges over time, the initial forecast for both Total Market Units and the Natural Market Baseline may be revised periodically. In addition, quantitative adjustments may be made to allocate total net savings between sponsors or between MT and RA programs as discussed later.

In principle, subtracting the Natural Market Baseline from total market units yields by definition an estimate of total net savings<sup>132</sup>. However, depending on the specifics of the regional policy framework and the individual initiative, further adjustments could be called for. One example would be a situation in which policymakers or stakeholders simply wish to build some conservatism into MT savings claims to reflect the greater uncertainty surrounding attribution compared to RA programs. Another example would be a situation in which it appears that some other public intervention not directly connected to the MT initiative or reflected in the Natural Market Baseline, is likely to have contributed to the progress of the market.<sup>133</sup> Such further adjustments for attribution could be either deemed up front, negotiated after the fact, or determined by an oversight agency such as a regulatory commission.

## 2.2.2 Natural Market Baseline Units<sup>134</sup>

### 2.2.2.1 Theory

The Natural Market Baseline should be modeled during the development of the MT initiative with the best available information, and then adjusted over time if significant new data becomes available during the implementation of the initiative, or because of unexpected market disruptions, such as those associated with substitute products.

Typically, the Natural Market Baseline will reflect at least some naturally occurring adoption of the targeted measure or practice because as Prahl and Keating (2014) note:

With market transformation, the gross market changes observed over the time horizon of a market transformation initiative are not all linked to the utility or other public policy intervention. Some of it is naturally occurring – even a slow growing product, if it is moving into the market will have an increasing penetration, even without a strategic market transformation intervention. This equates to the non-net portion of resource acquisition. (pp. 45-46)

Forecasting Natural Market Baseline units often assumes that, over time, adoption of energy efficient technology will follow a normal distribution consistent with Diffusion of Innovation theory. In this theory, market share is small due to a few innovators and early adopters participating in the market in early years, increasing to a majority of adopters during the peak years of market growth and then over time decreasing again to a small number of laggards adopting the product/service. Sometimes MT initiatives are primarily attempting to shift the adoption curve forward in time. Other times, they may be attempting to increase the slope and/or maximum values of the adoption curve

The Natural Market Baseline is probably the most challenging piece of estimating savings from MT because it is a prediction of the future that will never actually exist and therefore can't be measured. As a result, it is important to involve evaluators and stakeholders in advance to ensure transparency, alignment and understanding of the data and judgement that will ultimately be used to estimate savings.

### 2.2.2.2 Practice

The basic task is to develop a baseline of how the energy efficient product, service or behavior would have grown in the market independent from utility activity. There are several elements for effectively developing the Natural Market Baseline:

---

<sup>132</sup> This “net” savings includes savings from both MT and RA programs, so the “net” is further adjusted for RA savings, which is discussed in a section below.

<sup>133</sup> This is not to be confused with a situation in which the MT initiative has multiple administrators and some allocation of savings among them is needed – an issue that is discussed below.

<sup>134</sup> The term “Naturally Occurring Market Adoption” or NOMAD is synonymous with “Natural Market Baseline Units”.

1. **Identify existing data sources** that could inform the Natural Market Baseline and include these in the MT Business Plan. Market or sales data are the best sources, particularly if they are “full category” (or include the full efficiency mix, not just the qualified, efficient units). Other data sources can also be used, including industry forecasts, market intelligence and trend information, primary data collected as part of market research or market characterization to support the initiative development, hedonic price modeling, or other information about how efficiency is positioned relative to other market drivers. In addition, trade associations, advisors to the target market/industry, investment grade forecasts or organizations related to regulatory oversight (like Lawrence Berkeley National Laboratory) can be good sources of data. Manufacturers or distributors themselves are excellent sources, but they may be unwilling to share proprietary information.
2. **Use available data, quantitative modeling, best judgement, proxy data or other techniques** to develop a Natural Market Baseline. Some projects lend themselves to modeling or model averaging using statistical approaches to estimating baseline sales behavior. These can incorporate different assumptions about how a program affects product sales. In many cases, multiple approaches can be used. For example, a recent evaluation completed for Consolidated Edison included a sales model, market share model, probit model<sup>135</sup> and a model averaging model, which were used in a single project to test different ways of estimating baseline sales.<sup>136</sup> In some cases, a comparison group (such as different but similar region that is not intervening in this market) may be used as a proxy.
3. **Develop the initial baseline curve** and have the shape of baseline curve and underlying assumptions reviewed by stakeholders. Several key product characteristics should be considered when determining the shape of the Natural Market Baseline curve. These characteristics include the maximum potential market share, the pace of innovation within a given market, the lifecycle or time between purchase decisions, the presence of non-energy benefits, and the incremental cost associated with the efficient product without the MT intervention. It is also important to consider the strength of identified barriers to adoption for a given product. These barriers often emerge from market research or market characterization studies and can point to installation or supply barriers that might otherwise be missed.  
  
In some cases, the Natural Market Baseline can be zero for a number of years. This might be the case when an MT initiative catalyzes the entrance into the market of a technology that otherwise wouldn't have emerged for many more years.
4. **Incorporate anticipated changes to codes and standards** to the extent they are known in the baseline. The special case of savings from energy codes and standards is discussed further in the Energy Codes and Standards section of this protocol.
5. **Identify any known data gaps** that emerged in the planning process needed to improve the forecast over time and monitor these gaps as the initiative progresses.

### 2.2.2.3 Reviewing Natural Market Baseline Over Time

It is important to track the baseline forecast periodically as part of MPERs or other recurring efforts to assess the progress of the program and the target market. Changes should be made to the Natural Market Baseline if they significantly impact the results.

#### **Criteria for Updating the Natural Baseline Market Forecast**

The fundamental reason for periodically reviewing the initial baseline forecast is because better information is likely to become available over time that may allow improvements in the accuracy of the initial forecast. The Natural Market Baseline forecast is a major determinant of the estimated savings attributable to the program. Given the challenges inherent in forecasting a counterfactual scenario, Natural Market Baseline often constitutes the biggest individual source of uncertainty surrounding estimated savings. As such, incorporating enhanced information regarding the Natural Market Baseline forecast helps both in building an improved qualitative case for attribution for observed market changes, and in supporting adaptive management of the program.

At the same time, it can be counterproductive and costly to update the baseline forecast too easily or too often.

---

<sup>135</sup> In statistics, a probit model is a type of regression where the dependent variable can take only two values, for example married or not married.

<sup>136</sup> EMI Consulting. Con Edison 2017 Retail Products Platform (RPP) Evaluation. June 15, 2018.

What is typically most readily available to the evaluator is the actual trajectory of total number of efficient units appearing in the market, which may well reflect effects from the MT program itself. This raises the risk that evaluators may decide that an observed acceleration in efficient market share is due to an acceleration in the Natural Market Baseline when it is actually due to the effects of the MT program, thereby leading to underestimation of the program’s accomplishments – or, the reverse can happen. Deciding how often to update the baseline forecast requires the evaluator to balance the desirability of incorporating valuable new information with the importance of ensuring reasonable treatment.<sup>137</sup>

This tension can best be resolved by establishing guidelines for when new information is significant enough to update the initial forecast. The following are examples of some key circumstances where it may be appropriate to update the initial Natural Market Baseline forecast.

1. **Key assumptions underlying the initial forecast have proven to be incorrect.** For example, the initial forecast may have reflected an assumption that in the absence of intervention, manufacturers would have little naturally occurring incentive to incorporate a key energy-saving feature into their products, and it might become clear with the passage of time that this assumption was incorrect.
2. **The timing of key anticipated events has changed.** Examples might include a product launch being substantially delayed, a key partner ceasing operations, or an energy code or standard opportunity being delayed. All of these factors could affect the baseline forecast if it was built assuming certain events would impact the naturally occurring adoption.
3. **Changes in exogenous conditions affecting the target market have altered the initial trajectory of the Natural Market Baseline.** Examples might include a substantial change in public policy brought about by an electoral outcome, or economic conditions that create unexpected shifts in the level of economic activity (e.g. recession, housing booms, tariffs, unforeseen jump in the price of raw materials, etc.).
4. **Significant improvements in the availability of sales data demonstrate that the initial forecast can be improved without introducing a significant risk of over- or under-estimating program impacts.** For example, the initial forecast may have been based on limited information from key market informants, but over time full category sales data may become available and show that the initial estimate of efficient market share was off base.
5. **The criteria for what constitute an “efficient” product have changed in a manner that tends to superannuate the initial baseline forecast.** Examples might include changes in test procedures or qualifying standards.
6. **Substitute products or innovations have been introduced that change the energy consumption profile of an entire product category.** Examples might include LEDs displacing CFLs, laptop computers overtaking desktops, and the addition of 4k or 8k features to televisions.

### 2.3 Accounting for RA Savings

Ideally, customer-facing RA programs would be an integrated part of MT activities. This would allow for counting all savings in the target market regardless of assignment to either MT or RA. However, in the near-term, RA programs are likely to continue to be implemented and evaluated separately from MT programs. As a result, if RA and MT programs are operating simultaneously in the same market, there is a need to parse the savings between the MT and RA efforts.

While the goal of not double counting is clear, the actual practice is complicated by the fact that RA and MT use different methodologies to get to a “net” savings. For example, both methodologies adjust for a counterfactual baseline; designated as free-ridership for RA programs and Natural Market Baseline for MT initiatives. Both

---

<sup>137</sup> It is important to note that trying to strike this balance can and does lead to differences in baseline assumptions between MT initiatives and related RA programs. The mission of RA programs is generally to achieve measurable, reliable, near-term savings. From that perspective, it is important that the baseline assumptions reflect the realities at work in the marketplace at any one time. However, the mission of an MT initiative is to gradually achieve large-scale improvements in the way markets work, so it is important that the baseline forecast reflect the conditions facing the initiative at its onset. Resolving these potential differences in the handling of baseline assumptions between MT initiatives and related RA programs is an example of the broader issue of accounting, which is discussed elsewhere in this paper.




methodologies also attempt to estimate market effects that occur beyond the direct program participants; designated as spillover in RA and savings above baseline for MT. To successfully avoid double counting of savings, the MT framework must include consideration for all components of the RA framework.

Figure 3 is a depiction of the typical components of RA savings overlaid on the MT savings framework. Area A represents participants who wouldn't have taken the action without the program, area B is free riders and area C is spillover. As described above, MT savings are Total Market minus Natural Market Baseline.

To avoid double counting with RA programs, the default approach is to subtract all non-Market Transformation verified savings within the same market being targeted by the MT initiative from the MT savings calculated in previous sections<sup>138</sup>. If accuracy could be improved or greater cost-efficiency created in the evaluation process from using another method, that can be proposed by the evaluator. An example might be separating the units between the MT and RA activities but using the MT savings per unit (if it differs from the RA savings per unit) as the factor to multiply by the MT units.

**Figure 2-2: Accounting for RA and MT Program Savings**

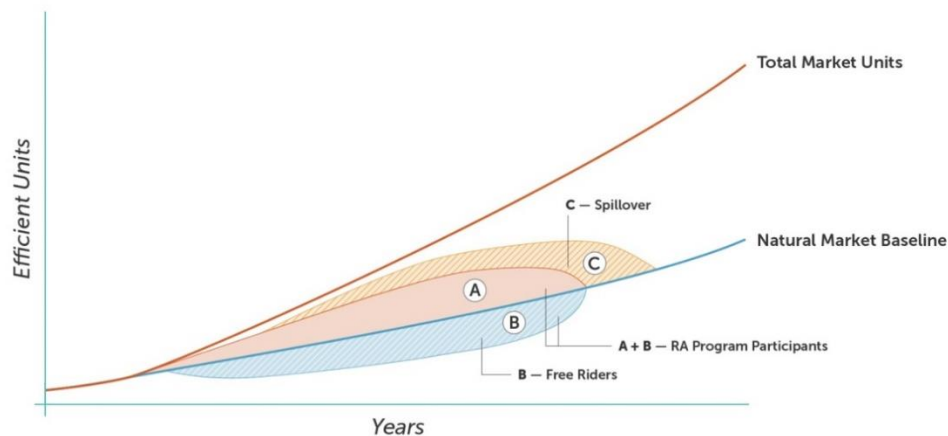

A key benefit of netting out all RA claimed savings is that it allows for a straightforward assertion that “all savings counted through the RA program have been removed from the MT initiative savings”. This simple statement may satisfy the needs of regulators and stakeholders without requiring further detail on the differences between the RA and MT frameworks.

On the other hand, this technique creates a bias against MT initiatives in favor of counting the savings in RA. This is because it has the unfortunate consequence of removing legitimate market effects (like spillover) from the MT initiative. This could discourage coordination and collaboration between MT initiatives and RA programs.

## 2.4 Allocating Energy Savings to Individual Utility Sponsors

Market boundaries rarely, if ever, align nicely with the geographic boundaries of utility service territories. While it is possible for an individual utility to operate a market transformation program that is limited in scope to the boundaries of their own service territory, it is more likely that utilities will be implementing MT initiatives in collaboration with other entities at a state, regional, or even nationwide level. In multi-sponsored MT initiatives, an

<sup>138</sup> Note that the traditional use of the terms “net” and “gross” savings can be confusing in the MT framework. The MT savings calculation described in the first equation in Section II results in savings that are attributed to utility programs (both MT and RA) – typically called “net” in RA evaluation. This section then further nets out RA savings so MT savings can be separately analyzed.

allocation scheme should be used to distribute savings to each sponsoring utility/efficiency organization. Historically, there have been several different approaches to utility allocation, although most of them attempt to base the proportion to each utility on estimated savings that land in that utility's service territory. The method used should be selected in advance.

1. **Allocation by Sponsor Funding Shares** In this approach, energy savings are allocated to each funder according to their share of the total MT initiative funding across all participating sponsors. In the Northwest, this approach is applied at a portfolio level to the total savings, partially because funding shares are based on the relative energy loads of the utilities.
2. **Allocation by Service Territory Delivery** This approach allocates energy savings based on an attempt to track market adoption of the energy efficient units (and therefore savings) to the geographic boundaries of the sponsoring utility. Unfortunately, most MT initiatives track efficient units at a scale different than utility service territory (such as to the point of distribution or retail sale), and methods must be used to scale these units to the service territory of the utilities operating the initiative. In these cases, a factor is developed in advance to share retail sales from the point of sale or distribution into an allocation to each of the utility service territories served by that channel. It is best to develop this factor ahead of time and use it consistently throughout the program, unless compelling data becomes available that would justify a change in the methodology. The adjustment can sometimes be made by working with the channel to get estimates of the zip codes of their clientele and then correlate that to the service territory zip codes. In the Northwest, for example, Bonneville Power Administration developed a retail sales allocation tool where retail locations are divided up by how they serve customers from different utilities.
3. **Allocation by Tracking Participants** There may be initiatives where it is possible to track all participants – for example, Building Operator Certification where every tracked operator comes through the initiative itself. This can then be a direct measurement.
4. **Allocation by Survey of Market** This approach samples the entire market and asks survey questions about in which service territory the efficiency is occurring.
5. **Allocation by Customer Proportions or Energy Consumption** This approach allocates energy savings based on the share of total customers or energy consumption within the sponsoring utilities service territories, or if known, shares within a particular market. Customers or consumption in this approach are a proxy for relative market share for the MT initiative. Examples include total residential single-family homes with a certain type of appliance, number of industrial customers of a certain size, or total energy consumption of commercial end use loads for the market end use in question.

## 2.5 Estimating Savings Post Active-Market Engagement in Markets without Codes or Standards as an Endpoint

Not all MT initiatives have the possibility of a code or standard to lock-in sustained market change or will be successful in the achieving the desired code or standard. For example, programs seeking to change standard practice in operations and maintenance, influence recommendations for building upgrades in existing buildings (not typically affected by new construction codes), or create change via training often cannot rely on a code or standard to ensure sustained adoption. Even without a code or standard, it is still possible for estimated MT savings to become significant as the market adoption rate can grow exponentially. Therefore, it is important to design market evaluation components that support ongoing measurement and estimation of total market adoption and efficient units, even after MT investments have subsided. There may also be exogenous market factors that could trigger a reforecast of the Natural Market Baseline during this post period. A periodic independent evaluation of these elements is recommended to support continued and accurate calculation of successful, long-term MT savings.

Key considerations for post-active market engagement energy savings estimation include:

- **Total Market Units** Data collection for total market units may be more challenging if the market actors who previously provided full market data are not willing to continue doing so without an active value transaction. In some situations, access to sales data could continue via contractual agreements with key market actors. In many scenarios, however, analysts will need to infer market changes through surveys, adjustments to purchased third-party data, or on-going market studies.

- **Unit energy savings** Given the wider market adoption at this point; it may be necessary to adjust the unit energy savings estimate. For example, with wider adoption there may be better data about the actual energy savings performance of the efficient measure. Key assumptions that affect UES during this period may also change as a wider group of users engage with the product or service.
- **Natural Market Baseline** As adoption grows, often other market forces become more apparent and may warrant review and possible adjustment of the Natural Market Baseline. Also, exogenous variables can come into play in the market that simply could not have been foreseen during the initial forecast of the Natural Market Baseline.

### 2.5.1 Duration of Savings Post Active Market Engagement in Markets without Codes or Standards as an Endpoint

It is important to establish the length of time that savings will be credited to the utility post-active-market engagement. This time period is separate from the lifetime of the measures embodied in savings measures. Instead it reflects the amount of time that a utility will receive credit for having changed the market even when it has no or minimal engagement. In some circumstances, the Natural Market Baseline will be expected to increase over time until some point where it essentially overtakes the Total Market. This provides a natural ending point for claiming savings from the MT initiative.

In some markets, the Natural Market Baseline will never approach the Total Market, or it will do so in an unreasonably long time-frame. In these cases, there is no quantitative analysis to determine duration directly; instead, it requires a policy call that balances an appropriate level of credit to make it worth the effort to support MT initiatives without counting savings into perpetuity. Factors to consider in crafting this determination include the likelihood of the baseline changing over time and the lifecycle of the product (which influences when things would have changed anyway). Given that this is a policy call, it is usually best to make this decision early in the MT initiative design process to provide certainty to program designers and implementers.

## 2.6 Energy Codes and Appliance Standards

Best practice in MT initiative design will identify applicable codes or standards early on and design interventions over the life of the initiative to accelerate early adoption of more efficient energy codes and standards when possible. If an MT initiative can successfully influence the code or standard to incorporate higher levels of efficiency, the initiative can effectively “lock-in” sustained efficiency changes for virtually the entire market. Logic models for MT initiatives will often include activities that are deliberately targeting and driving towards adoption of enhanced energy codes or standards (C&S). Energy savings that occur following successful adoption of efficient C&S<sup>139</sup> are often a significant portion of the energy savings claimed. In California<sup>140</sup> and the Northwest, savings from C&S currently represent significant portions of the energy savings in their energy efficiency program portfolios.

Illinois does not yet count savings from energy codes or increased compliance, but as of this writing is discussing possible activities to influence energy code compliance and potential adoption of higher efficiency levels in energy codes and standards. This Attachment describes savings estimates from energy codes adoption<sup>141</sup> because these are often part of MT efforts<sup>142</sup> and energy code compliance enhancement activities because they increase the effectiveness of the codes.

---

<sup>139</sup> Energy code compliance is a key factor in the actual savings resulting from a code, and this is discussed in a later section.


<sup>140</sup> See TRC (2019) Codes & Standards Program Advocacy & Attribution study for a review of California’s methods for codes and standards savings.

<sup>141</sup> Savings for “stretch” codes are covered by this discussion of codes and standards. If allowed by the state, a stretch code means local jurisdictions can adopt a code that is beyond the state code and is mandatory only for builders within that local jurisdiction. Savings would be calculated per this section, but only applied to buildings in the adopting jurisdiction.

<sup>142</sup> It should be noted that California has similar calculation methods for savings from codes and standards, although they weren’t developed specifically under an MT framework. Massachusetts has developed a method for savings for code compliance that is similar to RA program analysis other than how attribution is estimated.

Figure 4<sup>143</sup> depicts the course of an MT initiative with an emphasis on the portion that effects energy codes<sup>144</sup>. This figure depicts a market where the natural market baseline does not have a regular code adoption cycle, but if that is the practice for the market being analyzed, anticipated energy code adoptions and their efficiency level would be included in the baseline. Area A represents the savings that accrue to activities in an MT initiative that prepare the market before C&S adoption and can include the wide variety of activities that are shown in Figure 1. Area B represents the savings following adoption of a new C&S. There are many activities that could be sponsored by utilities at the point of adopting a code or standard (just before the “code effective” vertical line). Some examples include developing model C&S language, providing technical and economic analysis and support, or submittal of C&S proposals.

**Figure 2-3: The Effect of Energy Code Adoption**

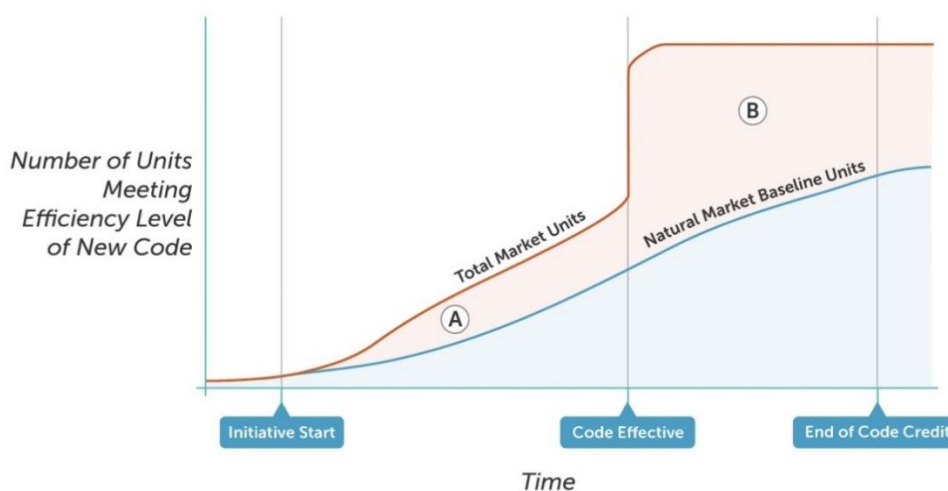

If an MT initiative includes C&S activities as part of its logic model, energy savings from the pre-adoption period A in Figure 4 are counted using the methods described earlier. In addition, it can be credited with energy savings post-adoption B, which are also derived using the methods described earlier, but with some additional considerations, described below.

### 2.6.1 Additional Considerations for Savings from Codes and Standards <sup>145</sup>

This section describes the additional items needed to calculate savings from Codes and Standards (C&S). Per unit savings and total market units are calculated as described above. Additional factors that need consideration for C&S include:

- **Compliance when a new energy code is adopted:** Total Market Savings should be adjusted for measured or estimated compliance rates. Measured compliance pre- and post-adoption of the new energy code is strongly preferred, but not always available. In this case, a baseline compliance rate pre-adoption either measured or estimated is usually assumed to be the same post-adoption for purposes of energy savings estimation.
- **Post-adoption Natural Market Baseline:** Special attention should be given to the segment of the Natural Market Baseline (from energy code adoption to the end of energy code credit). The best representation

<sup>143</sup> Note that compliance with the energy code is usually less than -- and can sometimes be greater than 100%. Compliance greater than 100% can occur, for example, if the typical measure most readily available is more efficient than the code requirement; builders will simply use the available measure.

<sup>144</sup> In calculating savings, the effective date of the energy code or standard adoption drives the uptick in the number of efficient units meeting the efficiency level. In this paper, the term “adoption” is short-hand for the energy code or standard adoption, which would have an effective date by which most units will comply.

<sup>145</sup> A paper by Cadmus *et. al.* in 2013 describes the estimation of energy code adoption and energy code compliance savings in depth starting on page 52.

of the counterfactual might be a fixed post-adoption baseline that changes to full adoption rates during the next scheduled change in the C&S processes (e.g. 3 years for the International Energy Conservation Code). Another option is some form of declining savings credit, such as a baseline that increases over time.

- Determining the timing of this counter-factual movement in some alternate future has been difficult in those regions already counting savings from energy code adoption. One approach involves expert subject matter panels (Delphi panels) to establish this alternative future. However, finding enough independent experts and achieving convergence of opinion can be challenging. Trending market data or comparison with other similar code provision adoptions may also be used as alternatives. Ultimately, as with all counterfactual baseline estimation, there will need to be an aspect of professional judgement to determine the appropriate treatment of post-adoption baseline.
- **Accounting:** Accounting of savings between RA and MT programs is not generally used for C&S. This is because utility RA programs typically have ended operations before or at the point that the energy code adoption process takes place.
- **Allocation:** In principle, allocation of energy savings that occur from an MT initiative supported by multiple sponsoring utilities and targeting statewide code changes should be no different than during the voluntary portion of the MT initiative (see above section on allocation). In addition, there may need to be a split between utilities and other parties working on code adoption. This is often a negotiated number, sometimes informed by a Delphi panel, evaluators, stakeholders, or other entities.
- **Duration of Energy Savings Claims<sup>146</sup>:** It is important to establish the length of time that savings will be credited to the utility for the new code or standard. This is shown in Figure 4 as the time between “Code Effective” and “End of Code Credit”. This time period is separate from the lifetime of the measures embodied in the energy code. Instead it reflects the amount of time that a utility will receive credit for having changed the energy code.
  - There is no quantitative analysis that can determine the duration of an energy code credit to the utilities; instead, it requires a policy that provides an appropriate level of credit to implementers that makes it worth the effort to support MT initiatives that target code changes, while not being so large as to be unfair to ratepayers. The policy call can be informed by when the code or standard would have been updated anyway to the level targeted in the MT initiative. Given that this is a policy call, it is usually best to make this decision early in the MT initiative design process to provide certainty to the program designers and implementers. For example, the Northwest negotiated a standard policy that allows for claiming code savings for ten years post the code effective date. For the residential code, NEEA does not report savings units six months after the code becomes effective, and then counts savings for a full ten years. This was a negotiated number among the parties involved at the time. If a new, more efficient code comes into play during that period, the incremental savings for that change are also counted for ten years.

## 2.7 Energy Savings from Enhanced Energy Code Compliance Activities

From work in other regions, a number of activities such as training and education, increased support for enforcement, and third-party plan-review, have been shown to result in increased compliance of energy codes, which in turn results in energy savings<sup>147</sup>. Efforts are underway in Illinois to analyze and discuss activities for improving compliance with existing energy codes.

Savings from enhancing code compliance activities are derived by documenting compliance rates before the

---

<sup>146</sup> Duration of savings claims can interact with the considerations in the Natural Market Baseline since this baseline can sometimes equate to Total Market Units over time, and therefore savings effectively become zero.


<sup>147</sup> For examples of recent evaluation reports analyzing the effects of compliance support programs on compliance rates in the residential and non-residential sectors, respectively, see NMR Group, Inc. (2018) and NMR Group, Inc. and Cadmus (2018).

NMR Group, Inc. 2018. Residential New Construction and CCSI Attribution Assessment (TXC48). [http://ma-eeac.org/wordpress/wp-content/uploads/TXC\\_48\\_RNCAttribution\\_24AUG2018\\_Final.pdf](http://ma-eeac.org/wordpress/wp-content/uploads/TXC_48_RNCAttribution_24AUG2018_Final.pdf)

NMR Group, Inc. and Cadmus. 2018. Massachusetts TXC47 Non-Residential Code Compliance Support Initiative Attribution and Net Savings Assessment. [http://ma-eeac.org/wordpress/wp-content/uploads/TXC\\_47\\_Nonres\\_CCSI\\_Attribution\\_Assessment\\_26July2018\\_Final-1.pdf](http://ma-eeac.org/wordpress/wp-content/uploads/TXC_47_Nonres_CCSI_Attribution_Assessment_26July2018_Final-1.pdf).

initiative starts<sup>148</sup>, and compliance after the initiative has operated for a period of time. See Figure 5.

**Figure 2-4: Savings from Enhancing Energy Code Compliance**

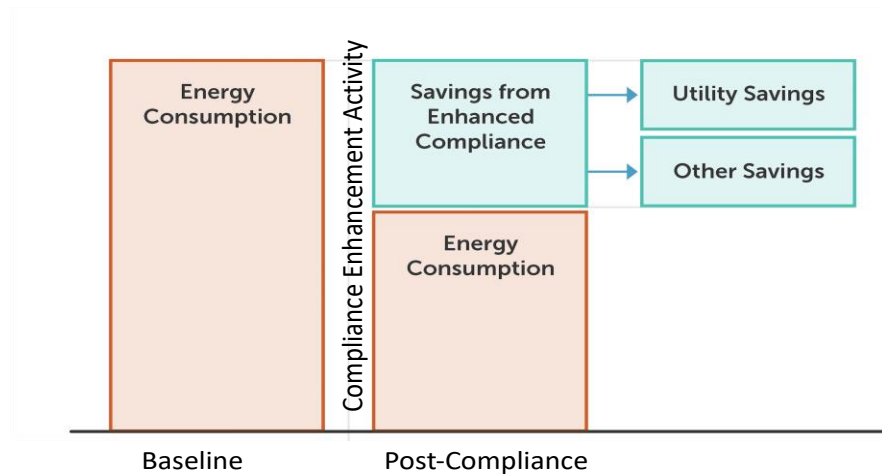

Unit energy savings<sup>149</sup> is the difference between the average unit energy consumption in the pre-enhanced-compliance case compared to the post-case<sup>150</sup> multiplied by the number of new units each year in the market that are affected. This is typically developed using building energy-use modeling of the baseline and post-compliance cases, and then subtracting the two. The building energy modeling should follow the practices for new construction modeling in the TRM for residential or commercial buildings as appropriate.

The per unit energy consumption for the baseline case is computed based on total building energy consumption with either measured or assumed compliance for all energy-impacting measures in the building. The per unit energy consumption for the post-compliance-enhancement activities is similarly calculated but using the energy-impacting measures of the post-compliance-enhancement building. For example, per building energy savings for wall insulation would be calculated by subtracting the building energy use assuming post-compliance-activity insulation amounts in the walls from an equivalent building energy use with the baseline wall insulation amounts. These building level savings are then divided by the square feet of the building to derive an average UES/square foot. This in turn is multiplied by the number of square feet in the market that are affected to derive the total compliance-enhancement related savings.

Total savings are then reviewed for the savings directly resulting from the efforts of the utility, versus other causes. Examples of other causes that can create enhanced code compliance include suppliers who might stock only “above code” materials or “spillover” from other larger jurisdictions that make it uneconomical for builders to change practices across jurisdictions. Most often, the split between utilities and other causes is a negotiated number among utilities and stakeholders which is sometimes informed by a Delphi panel that gives input to a third-party evaluator on their opinion of the utility’s contribution if there are enough independent experts to form a Delphi panel.

### 2.7.1 Duration of Enhanced Energy Code Compliance Savings

Similar to the duration of savings credit for other MT initiatives, the actual value is a policy call. However, in the case

<sup>148</sup> The Midwest Energy Efficiency Alliance is currently developing field data to determine compliance with current energy codes, and analyze which measures create the largest gap in savings.

<sup>149</sup> In some cases, enhancing the compliance or effectiveness of measures in the code can have an impact on savings already incorporated in a TRM. If Illinois moves forward with enhanced code compliance, this could be an adjustment in the future to other sections of the TRM.

<sup>150</sup> If both compliance and increased efficiency happen at the same time, the savings can be calculated separately for each and summed.

of enhanced code compliance activities, duration of the activities is usually deemed to be the period of time that the particular code is in place. Once the code changes, (for example, every three years for the International Energy Conservation Code (IECC)), then credit for compliance-enhancement savings from the prior code would be stopped. This is because compliance savings are tied to a specific set of measures, and those measures may change when the code changes.

## 3 Appendices

### 3.1 Appendix A: MT Initiative Business Plan Outline

The MT Initiative Business Plan is intended to document the strategy, data, and assumptions about the initiative at the time of launch. It is a document that can evolve as knowledge of the market and the initiative evolves but is essential to prepare and guide launch of the initiative into the market.

Key components of the Business Plan include:

1. Identification/description of the specific market to be targeted
2. Description of the “leverage” point(s) that catalyze transformation
3. Logic Model or hypothesis of how the planned intervention will result in the desired market change
  - a. Barriers that prevent market adoption
  - b. Activities/interventions that will catalyze the change
  - c. Outputs that result from the activities
  - d. Market Outcomes (short-, medium- and/or long-term) that are measurable responses to the activities
  - e. Ultimate desired impact – which is the final state of the market after it is transformed.
4. Market Progress Indicators
  - a. Data collection/management plan
  - b. Document any input from evaluators
5. Multi-year budget
6. Multi-year savings, including description of baseline over time
7. Estimate of cost-effectiveness
8. Names of utilities most likely to be involved with operating this initiative
9. Description of interaction with other programs (if any) by utility
10. Description of Jobs or Disadvantaged Community Impacts
11. Discussion of risks specific to this initiative
12. Date of adoption and Date of amendment(s), if any

### 3.2 Appendix B: Glossary of Terms

**Above Natural Market Baseline Savings Net of RA Savings** – The residual estimated energy savings computed by subtraction of energy savings claimed by an RA program.

**Accounting** – For purposes of this document, accounting refers to the practice of adjusting MT above market baseline savings to net out energy savings being claimed through any RA programs operation in the same market.

**Adoption Date (of Code or Standard)** – The date when the change in a building code or appliance/equipment standard was adopted by the rule-making authority.

**Allocation** – The process of allocating energy savings from MT programs to multiple sponsors of an MT initiative that operates across multiple sponsoring utilities; e.g. at a state or multiple state regional level.

**Attribution, general** – The concept of attributing causality for claimed energy savings to specific or general actions by the utility(s) as opposed to other agents acting in the same market. Attribution provides credible evidence that



there is a causal link between the program activities and the outcomes achieved by the program.

**Attribution, MT Programs** – Attribution of all energy savings not counted in the Natural Market Baseline to utility funded interventions, including RA, MT, and supporting infrastructure. Note that this is not actually a statement of causality but rather a measurement by subtraction of Natural Market Baseline.

**Attribution, RA Programs** – In traditional RA program attribution is generally approached through application of an adjustment factor that adjusts “gross energy savings” measured through the program participants to account for “free-ridership”; i.e., those participants that would have acted without the RA program. For RA programs, this adjustment is usually represented in a “net-to-gross” (NTG) factor that is multiplied by gross energy savings to get “net” energy savings that can be “attributable” to the RA program.

**Counterfactual** – A constructed alternative future that might have happened without the intervention of either the MT or RA programs.

**Estimated Market Transformation Savings** – The residual estimated energy savings computed by subtraction of the natural market baseline savings from total market savings. These estimated savings are assumed to be associated with all utility funded market interventions including MT and RA programs, supporting infrastructure, and codes and standards activities. Analogous to the space above the Natural Market Baseline in Figure 2.

**Estimated Market Transformation Savings Net of RA** – The residual estimated energy savings after subtracting energy savings claimed by a resource-acquisition (RA) program from Estimated Market Transformation energy savings operating in the same geographic service territory.

**Free Riders** – A program participant who would have implemented the program’s measures or practices in the absence of the program. Free riders can be: (1) total, in which the participant’s activity would have completely replicated the program measure; (2) partial, in which the participant’s activity would have partially replicated the program measure; or (3) deferred, in which the participant’s activity would have partially or completely replicated the program measure, but at a future time beyond the program’s time frame.

**Full Category Data** – Sales data (individual SKU, price and numbers sold) for all units of a specific product including both efficient and inefficient versions typically sold through a retail or distributor channel. May also refer to data available from manufacturers or trade associations that includes all units manufactured or sold.

**Hedonic Price Modelling** – a statistical approach that controls for a variety of variables and attempts to isolate the incremental cost associated with the feature of interest.

**Logic Model** – a graphic depiction of the shared relationships among the activities, outputs, and outcomes of a program. The theory of change should be visible in the logic model.

**Market** – an actual or nominal place where forces of demand and supply operate, and where buyers and sellers interact (directly or through intermediaries) to trade goods, services or contracts or instruments, for money or barter.

**Market Progress Evaluation Report (MPER)** – A report on MT program progress, usually conducted in parallel with program implementation over a relatively short (e.g. 12 months) timeline. Best practices would have these evaluation activities conducted by a third party. [Note that there are regionally distinct terms for similar evaluation products, including Market Evaluation. The specific term is less important for the purpose of this framework than the need to acknowledge that market transformation requires a somewhat different evaluation scope and product than might be required of other programs.]

**Market Progress Indicator (MPI)** – A measurement of market progress for a specific indicator of an element of MT theory described in the program logic that defines the associate barrier/opportunity/intervention strategy and anticipated outcomes from successful implementation. [Note that regional differences exist in how these indicators are labeled, including the term Market Indicator. The specific term is less important than the fact that the indicator refers to activities occurring within the market, rather than within the program, and that they will likely include long-term indicators that can take years to emerge.]

**Market Transformation (MT)** – The strategic process of intervening in a market to create lasting change that results

in the accelerated adoption of energy efficient products, services, and practices.

**MT Business Plan** - A document embodying the strategy, data, and assumptions about the MT initiative at the time of launch. It includes a description of the efficiency opportunity, targeted markets, assessment of barriers and opportunities, intervention strategies, near-, mid- and long-term market outcomes, market progress indicators and key energy savings estimation assumptions.

**Natural Market Baseline Savings** – The estimated energy savings computed based on a market adoption rate forecast of what would have happened without any utility funded interventions that may include both MT and RA programs as well as enabling infrastructure support. The forecast of Natural Market Baseline is generally established before the start of the MT initiative but may be revised periodically.

**Resource Acquisition (RA)** – An approach to capture energy efficiency grounded in a regulatory framework which views EE as a resource that can be “acquired” through direct utility action analogous to any other “resource” considered by a utility to meet its existing and future energy requirements. These can be thought of as traditional utility-driven energy efficiency programs that typically work at the individual consumer level, rather than the market level.

**Spillover** – Reductions in energy consumption and/or demand caused by the presence of an energy efficiency program. There can be participant and/or nonparticipant spillover:

- **Participant spillover** is the additional energy savings that occur as a result of the program’s influence when a program participant independently installs incremental energy efficiency measures or applies energy-saving practices after having participated in the energy efficiency program.
- **Nonparticipant spillover** is energy savings that occur when a program nonparticipant installs energy efficiency measures or applies energy savings practices as a result of a program’s influence.

**Summative Report** – An evaluation report that attempts to quantify and assess the outcome effects for a given program period. Distinguished from “process evaluation” and consistent with “impact evaluation” in energy efficiency.

**Total Market Savings** – The estimated energy savings computed based on all market adoption above and beyond the adoption rate at the start of the MT initiative.

### 3.3 Appendix C: References

Chen, Huey-Tsyh. 1990. *Theory-Driven Evaluations*. Sage Publications.

EMI Consulting, 2017. *Con Edison 2017 Retail Products Platform (RPP) Evaluation*. June 15, 2018. Accessed 6/5/2019 at <https://www.dps.ny.gov/>

EMI Consulting and Richard Ridge, 2015. *California 2016-2019 Retail Products Platform Program Pilot: Evaluation Plan*.

Evaluation, Measurement and Verification Working Group, 2018. *ENERGY STAR® Retail Products Platform (RPP): Conditions and Considerations in Evaluating Market Transformation Programs and Evaluation Guidance for RPP*.

Prahl, Ralph, and Ken Keating, 2014. *Building a Policy Framework to Support Energy Efficiency Market Transformation in California*. White paper written for the California Public Utilities Commission, San Francisco.

Navigant Consulting, February 2019. *ComEd Energy Efficiency Program Energy Efficiency Market Transformation Summit Report*. <https://www.navigant.com/experience/energy/2019/energy-efficiency-market-transformation-summit> [https://www.navigant.com/-/media/www/site/downloads/energy/2019/market-transformation-summit-report.pdf?la=en&utm\\_source=Direct&utm\\_medium=PDF\\_MTS](https://www.navigant.com/-/media/www/site/downloads/energy/2019/market-transformation-summit-report.pdf?la=en&utm_source=Direct&utm_medium=PDF_MTS)

NMR Group, Inc., 2013. *A Review of Effective Practices for the Planning, Design, Implementation and Evaluation of Market Transformation Initiatives*. CALMAC study ID PGE330.01.

NMR Group, Inc., 2014. *Methods for Measuring Market Effects of Massachusetts Energy Efficiency Programs*. <http://ma-eeac.org/wordpress/wp-content/uploads/Methods-for-Measuring-Market-Effects-of-Massachusetts->

[Energy-Efficiency-Programs.pdf](#)

Keating, Ken, 2014. *Guidance on Designing and Implementing Energy Efficiency Market Transformation Initiatives*. White paper written for the California Public Utilities Commission, San Francisco.

Lee, Allen, Dan Groshans, Peter Schaffer, Alexandra Rekkas, Richard Faesy, Lynn Hoefgen and Phil Mosenthal, 2013. *Attributing Building Energy Code Savings to Energy Efficiency Programs*. Report prepared for Northeast Energy Efficiency Partnerships, Innovation Electricity Efficiency, and the Institute for Market Transformation.

Metrics, Tracking and Performance Assessment Working Group, 2018. *Market Transformation Metrics and EM&V Coordination Report*. White paper submitted to the New York Department of Public Service by the Clean Energy Advisory Council.

Ridge, Richard, Brian Arthur Smith, Julie Colvin, and Luke Nickerman, 2015. *Modifying California's Traditional Resource Acquisition Benefit-Cost Analysis to Accommodate Market Transformation Programs*. In *Proceedings of the 2015 International Energy Program Evaluation Conference*. Long Beach.

TRC, 2019. *Codes & Standards Program Advocacy and Attribution Study*. CALMAC Study ID: SCE0435.01. Report prepared for the California Public Utilities Commission.

Weiss, Carol H. 1998. *Evaluation Methods for Studying Programs and Policies, 2nd Edition*. Upper Saddle River, New Jersey: Prentice Hall.