2027 Illinois Statewide Technical Reference Manual for Energy Efficiency

Version 15.0

Volume 2: Commercial and Industrial Measures

FINAL

September 18, 2026

Effective:

January 1, 2027

[INTENTIONALLY LEFT BLANK]

VOLUME 1: OVERVIEW AND USER GUIDE

4 VOLUME 2: COMMERCIAL AND INDUSTRIAL MEASURES 11

4.1. Agricultural End Use 11

4.1.1 ENGINE BLOCK TIMER FOR AGRICULTURAL EQUIPMENT - MEASURE MOVED TO MISCELLANEOUS END USE 11

4.1.2 HIGH VOLUME LOW SPEED FANS 12

4.1.3 HIGH SPEED FANS 16

4.1.4 LIVESTOCK WATERER 20

4.1.5 FAN THERMOSTAT CONTROLLER 22

4.1.6 LOW PRESSURE SPRINKLER NOZZLES 24

4.1.7 MILK PRE-COOLER 26

4.1.8 VSD MILK PUMP WITH PLATE COOLER HEAT EXCHANGER 29

4.1.9 SCROLL COMPRESSOR FOR DAIRY REFRIGERATION 32

4.1.10 DAIRY REFRIGERATION HEAT RECOVERY 35

4.1.11 COMMERCIAL LED GROW LIGHTS 39

4.1.12 SWINE HEAT PADS 45

4.1.13 IRRIGATION PUMP VFD 49

4.1.14 HIGH EFFICIENCY GRAIN DRYER 53

4.1.15 GRAIN DRYER TUNE-UP 60

4.1.16 GREENHOUSE BOILER TUNE-UP 64

4.1.17 GREENHOUSE THERMAL CURTAINS 67

4.1.18 INFRARED FILM FOR GREENHOUSE 71

4.1.19 ENERGY STAR DAIRY WATER HEATER 74

4.1.20 COMMERCIAL ELECTRIC LAWN MOWER 79

4.1.21 INDOOR AGRICULTURE DEHUMIDIFIER 83

4.2. Food Service End Use 86

4.2.1 COMBINATION OVEN 86

4.2.2 COMMERCIAL SOLID AND GLASS DOOR REFRIGERATORS & FREEZERS 97

4.2.3 COMMERCIAL STEAM COOKER 100

4.2.4 CONVEYOR OVEN 111

4.2.5 ENERGY STAR CONVECTION OVEN 114

4.2.6 ENERGY STAR DISHWASHER 123

4.2.7 ENERGY STAR FRYER 135

4.2.8 GRIDDLE 142

4.2.9 ENERGY STAR HOT FOOD HOLDING CABINETS 150

4.2.10 Ice Maker 152
4.2.11 High Efficiency Pre-Rinse Spray Valve 156
4.2.12 Infrared Charbroiler 161
4.2.13 Rotisserie Oven 164
4.2.14 Infrared Salamander Broiler 166
4.2.15 Infrared Upright Broiler 168
4.2.16 Kitchen Demand Ventilation Controls 170
4.2.17 Pasta Cooker 173
4.2.18 Rack Oven - Double Oven 174
4.2.19 ENERGY STAR Electric Convection Oven – Removed in v11, consolidated with 4.2.5 ENERGY STAR Convection Oven 177
4.2.20 Efficient Dipper Wells 178
4.2.21 On-Demand Package Sealers – Provisional Measure 182
4.2.22 Automatic Conveyor Broiler 185
4.2.23 Electric Deck Oven 189
4.2.24 Gas and Electric Pressure Fryers 193
4.2.25 Efficient Cooktops 199
4.2.26 Hot Food Holding Bins 205
4.3. Hot Water End Use 208
4.3.1 Water Heater 208
4.3.2 Low Flow Faucet Aerators 225
4.3.3 Low Flow Showerheads 232
4.3.4 Commercial Pool Covers 237
4.3.5 Tankless Water Heater – Measure combined with 4.3.1 Water Heater in Version 8 240
4.3.6 Ozone Laundry 241
4.3.7 Multifamily Central Domestic Hot Water Plants 249
4.3.8 Controls for Central Domestic Hot Water 253
4.3.9 Heat Recovery Grease Trap Filter 258
4.3.10 DHW Boiler and Water Heater Tune-up 262
4.3.11 Tunnel Washers 267
4.3.12 Tank Insulation 271
4.3.13 Tankless Water Heater Array 275
4.3.14 Solar Water Heater 282
4.3.15 ECM Circulation Pumps for Domestic Hot Water 287

$\mathbf{\Delta kW = * * LF * CF}$ ..... Error! Bookmark not defined.

4.4. HVAC End Use 290

4.4.1 AIR CONDITIONER TUNE-UP 297

4.4.2 SPACE HEATING BOILER TUNE-UP 300

4.4.3 PROCESS BOILER TUNE-UP 303

4.4.4 BOILER LOCKOUT/RESET CONTROLS 306

4.4.5 CONDENSING UNIT HEATERS 308

4.4.6 ELECTRIC CHILLER 310

4.4.7 ROOM AIR CONDITIONER 321

4.4.8 GUEST ROOM ENERGY MANAGEMENT (PTAC & PTHP) 324

4.4.9 AIR AND WATER SOURCE HEAT PUMP SYSTEMS (CENTRALLY DUCTED AND DUCTLESS) 330

4.4.10 HIGH EFFICIENCY BOILER 351

4.4.11 HIGH EFFICIENCY FURNACE 354

4.4.12 INFRARED HEATERS 360

4.4.13 PACKAGE TERMINAL AIR CONDITIONER (PTAC) AND PACKAGE TERMINAL HEAT PUMP (PTHP) 363

4.4.14 PIPE INSULATION 370

4.4.15 SINGLE-PACKAGE AND SPLIT SYSTEM UNITARY AIR CONDITIONERS 388

4.4.16 STEAM TRAP REPLACEMENT OR REPAIR 403

4.4.17 VARIABLE SPEED DRIVES FOR HVAC PUMPS AND COOLING TOWER FANS 411

4.4.18 SMALL COMMERCIAL PROGRAMMABLE THERMOSTATS – RETIRED 12/31/2019. REPLACED WITH 4.4.48 SMALL COMMERCIAL THERMOSTATS 416

4.4.19 DEMAND CONTROLLED VENTILATION 417

4.4.20 HIGH TURNDOWN BURNER FOR SPACE HEATING BOILERS 422

4.4.21 LINKAGE-LESS BOILER CONTROLS FOR SPACE HEATING 425

4.4.22 OXYGEN TRIM CONTROLS FOR SPACE HEATING BOILERS 427

4.4.23 SHUT OFF DAMPER FOR SPACE HEATING BOILERS OR FURNACES 429

4.4.24 SMALL PIPE INSULATION 431

4.4.25 SMALL COMMERCIAL PROGRAMMABLE THERMOSTAT ADJUSTMENTS – RETIRED 12/31/2019 438

4.4.26 VARIABLE SPEED DRIVES FOR HVAC SUPPLY AND RETURN FANS 439

4.4.27 ENERGY RECOVERY VENTILATOR 445

4.4.28 STACK ECONOMIZER FOR BOILERS SERVING HVAC LOADS 450

4.4.29 STACK ECONOMIZER FOR BOILERS SERVING PROCESS LOADS 453

4.4.30 NOTCHED V BELTS FOR HVAC SYSTEMS 456

4.4.31 SMALL BUSINESS FURNACE AND ROOFTOP UNIT TUNE-UP 464

4.4.32 Combined Heat and Power 467
4.4.33 Commercial & Industrial Air Curtain 474
4.4.34 Destratification Fan 485
4.4.35 Economizer Repair and Optimization 492
4.4.36 Multi-Family Space Heating Steam Boiler Averaging Controls 501
4.4.37 Unitary HVAC Condensing Furnace 504
4.4.38 Covers and Gap Sealers for Room Air Conditioners 512
4.4.39 High Temperature Heating and Ventilation (HTHV) Direct Fired Heater 520
4.4.40 Gas High Efficiency Single Package Vertical Air Conditioner 526
4.4.41 Advanced Rooftop Controls (ARC) 530
4.4.42 Advanced Thermostats for Small Commercial – Retired 12/31/2019. Replaced with 4.4.48 Small Commercial Thermostats 538
4.4.43 Packaged RTU Sealing 539
4.4.44 Commercial Ground Source and Ground Water Source Heat Pump 544
4.4.45 Adsorbent Air Cleaning 575
4.4.46 Server Room Temperature Set back 580
4.4.47 Air Deflectors for Unit Ventilators – Provisional Measure – Removed V12. 583
4.4.48 Small Commercial Thermostats 584
4.4.49 Boiler Chemical Descaling 589
4.4.50 Electric Chillers with Integrated Variable Speed Drives – Removed V12 592
4.4.51 Advanced Rooftop Controls with High Rotor Pole Switch Reluctance Motors 593
4.4.52 Hydronic Heating Radiator Replacement 608
4.4.53 HVAC Supply, Return and Exhaust Fans – Fan Energy Index 612
4.4.54 Process Heating Boiler 618
4.4.55 Commercial Gas Heat Pump 622
4.4.56 Commercial Duct Sealing 648
4.4.57 Condensate Recovery System 655
4.4.58 Steam Trap Monitoring System 662
4.4.59 Ductless Heat Pumps - Removed in v.13 670
4.4.60 Variable Refrigerant Flow HVAC System 671
4.4.61 Chiller Condenser Water Temperature Reset 682
4.4.62 Cooling Tower Water Side Economizer 685
4.4.63 Boiler Blowdown Heat Recovery 688
4.4.64 Steam Vent Condensers 693

4.4.65 Computer Room Air Conditioner (CRAC) 696
4.4.66 Steam Leak Repair 701
Review Deadline: 1/1/2028 704
4.4.67 CRAC/CRAH Electronically Commutated Plug Fans 705
4.4.68 Turbulators 708
4.4.69 Waterless HVAC Condensate Trap 711
4.4.70 Indoor Air Purification 718
4.4.71 Electric Chiller Tune-up 723
4.4.72 ENERGY STAR Ceiling Fan 727
4.4.73 Pressure Independent VAV Controller for Fume Hood Fan Systems 731
4.4.74 Building Automation System for Public Schools 737
4.4.75 Dedicated Outdoor Air System (DOAS) 741
4.4.76 Air to Water Heat Pump 744
4.5. Lighting End Use 753
4.5.1 Commercial ENERGY STAR Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8 759
4.5.2 Linear Delamping 760
4.5.3 High Performance and Reduced Wattage T8 Fixtures and Lamps – Retired 12/31/2025, Removed in v14 764
4.5.4 LED Bulbs and Fixtures 765
4.5.5 Commercial LED Exit Signs 783
4.5.6 LED Traffic and Pedestrian Signals – Retired 12/31/2026, Removed in v15 786
4.5.7 Lighting Power Density 787
4.5.8 Miscellaneous Commercial/Industrial Lighting 809
4.5.9 Multi-Level Lighting Switch 813
4.5.10 Lighting Controls 816
4.5.11 Solar Light Tubes 823
4.5.12 T5 Fixtures and Lamps – Retired 12/31/2025, Removed in v14 826
4.5.13 Occupancy Controlled Bi-Level Lighting Fixtures 827
4.5.14 Commercial ENERGY STAR Specialty Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8 831
4.5.15 LED Open Sign 832
4.5.16 LED Streetlighting 836
4.5.17 Exterior Photocell Repair 839
4.5.18 Ultra-Efficient LED Lighting 841
4.6. Refrigeration End Use 845

4.6.1 Automatic Door Closer for Walk-In Coolers and Freezers 845
4.6.2 Beverage and Snack Machine Controls 847
4.6.3 Door Heater Controls for Cooler or Freezer 850
4.6.4 Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers 853
4.6.5 ENERGY STAR Refrigerated Beverage Vending Machine 856
4.6.6 Evaporator Fan Control for Electrically Commutated Motors 859
4.6.7 Strip Curtain for Walk-in Coolers and Freezers 861
4.6.8 Refrigeration Economizers 864
4.6.9 Night Covers for Open Refrigerated Display Cases 867
4.6.10 High Speed Rollup Doors 870
4.6.11 Q-Sync Motors for Walk-in and Reach-in Coolers/Freezers 875
4.6.12 Variable Speed Drive for Condenser Fans 882
4.6.13 Add Doors to Open Refrigerated Display Cases 884
4.6.14 Floating Head Pressure Control 889
4.6.15 Zero Energy Doors for Refrigerated Cases 892
4.6.16 Door Gaskets for Walk-in and Reach-in Coolers and Freezers 895
4.6.17 Refrigeration Tune Up 898
4.7. Compressed Air End Use 901
4.7.1 VSD Air Compressor 901
4.7.2 Compressed Air Low Pressure Drop Filters 904
4.7.3 Compressed Air No-Loss Condensate Drains 907
4.7.4 Efficient Compressed Air Nozzles 909
4.7.5 Efficient Refrigerated Compressed Air Dryer 912
4.7.6 Vortex Tube Thermostat - Provisional Measure – Retired 12/31/2023, Removed in v12 915
4.7.7 Efficient Desiccant Compressed Air Dryer 916
4.7.8 Desiccant Dryer Dew Point Demand Controls 920
4.7.9 Compressed Air Heat Recovery 924
4.7.10 Compressed Air Storage Receiver Tank 927
4.7.11 Reduce Compressed Air Setpoint 931
4.7.12 AODD Pump Controls 934
4.7.13 Compressed Air Leak Repair 938
4.7.14 Compressed Air Tool Replacement 942
4.8. Shell End Use 945
4.8.1 Roof Insulation for C&I Facilities 945

4.8.2 Spring-Loaded Garage Door Hinge 951
4.8.3 Commercial Weather Stripping 959
4.8.4 C&I Air Sealing 962
4.8.5 High Speed Overhead Doors 969
4.8.6 Dock Door Seals and Shelter 979
4.8.7 Commercial Wall Insulation 987
4.8.8 Commercial Secondary Windows 994
4.8.9 Efficient Windows 999
4.9. Miscellaneous End Use 1006
4.9.1 Pump Optimization 1006
4.9.2 Computer Power Management Software – Retired 12/31/2026, Removed in v15 1008
4.9.3 Modulating Commercial Gas Clothes Dryer 1009
4.9.4 High Speed Clothes Washer 1011
4.9.5 ENERGY STAR Computers 1015
4.9.6 Advanced Power Strip – Tier 1 Commercial 1018
4.9.7 High Efficiency Transformer 1021
4.9.8 High Frequency Battery Chargers 1025
4.9.9 Commercial Clothes Dryer Moisture Sensor 1028
4.9.10 Efficient Thermal Oxidizers 1031
4.9.11 Variable Speed Drives for Process Fans 1036
4.9.12 Low Flow Toilets and Urinals 1041
4.9.13 Smart Irrigation Controls 1044
4.9.14 Switch Peripheral Equipment Consolidation 1048
4.9.15 ENERGY STAR Low Wattage Uninterruptible Power Supply 1052
4.9.16 Energy Efficient Rectifier and High Wattage UPS 1055
4.9.17 Energy Efficient Hydraulic Oils - Provisional Measure 1058
4.9.18 Energy Efficient Gear Lubricants - Provisional Measure 1061
4.9.19 Smart Sockets 1063
4.9.20 Lithium Ion Fork Truck Batteries 1067
4.9.21 Building Operator Certification 1071
4.9.22 Warm-Mix Asphalt Chemical Additives 1075
4.9.23 Energy Efficient Hand Dryers 1078
4.9.24 Elevator Modernization 1082
4.9.25 Virtual AMI Driven Commissioning 1087

4.9.26 ENGINE BLOCK HEATER CONTROLLER 1091

Appendix 1: Key Commercial OpenStudio Building Model Assumptions 1094

VOLUME 3: RESIDENTIAL MEASURES

VOLUME 4: CROSS CUTTING MEASURES AND ATTACHMENTS

4 Volume 2: Commercial and Industrial Measures

4.1. Agricultural End Use

4.1.1 Engine Block Timer for Agricultural Equipment - Measure moved to Miscellaneous End Use

4.1.2 High Volume Low Speed Fans

DESCRIPTION

The measure applies to horizontally mounted ceiling high volume low speed (HVLS) fans that are replacing multiple non HVLS fans that have reached the end of useful life in agricultural applications.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment must be a fan with a diameter above 16 feet that meets program minimum efficiency requirements.

DEFINITION OF BASELINE EQUIPMENT

As a retrofit measure, the actual existing conditions are taken as baseline. The number and wattage of the existing fans shall be used to define baseline energy consumption. As a time of sale measure, baseline is taken as the total operating wattage of conventional fans required to match the flow rate (CFM) rating of the efficient equipment.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[1]

DEEMED MEASURE COST

As a retrofit measure, the actual installation cost should be used for screening and reporting purposes.

For a time of sale measure, actual full installed costs may be used along with the following baseline cost assumptions:[2]

Diameter of Fan (feet)	Baseline Cost
16-17.9	$1210
18-19.9	$1460
20-23.9	$1840
24 +	$2090

If actual costs are unavailable for time of sale, the incremental measure costs are as follows:[3]

Diameter of Fan (feet)	Incremental Cost
16-17.9	$4100
18-19.9	$4130
20-23.9	$4190
24 +	$4230

LOADSHAPE

Loadshape C34 - Industrial Motor

[1] Average motor life is calculated by dividing the estimated motor life (35,000 hours) divided by the annual run hours, taken to be the unknown/other farm commodity type of 3,259 hours (see description of default run hours on following page); and rounded down to nearest whole year. Motor life source, U.S. Department of Energy Advanced Manufacturing Office, Motor Systems Tip Sheet #3.

[2] Baseline full installed costs linearly extrapolated using cost data from the Illinois ActOnEnergy TRM No. 2010-4. Midpoints were used to establish a single cost for each fan diameter category. Costs rounded up to the nearest $10.

[3] Incremental costs linearly extrapolated using cost data from the Illinois ActOnEnergy TRM No. 2010-4. Midpoints were used to establish a single cost for each fan diameter category. Costs rounded up to the nearest $10.

COINCIDENCE FACTOR

The measure has deemed kW savings therefore, a coincidence factor is not applied.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{\sum(N_{base} * Watts_{base}) - \sum(N_{ee} * Watts_{ee})}{1000} * Hours$$

Where:

N_{base} = Number of baseline (conventional) fans being replaced (of equivalent wattage)

= Actual (for Retrofit projects). For time of sale projects, the number of baseline fans should be set equivalent to the number of HVLS fans being installed.

$Watts_{base}$ = Operating demand (W) of baseline fan

=Actual (Retrofit). For time of sale projects refer to the time of sale HVLS connected load savings table below.

N_{ee} = Number of efficient fans installed (of equivalent wattage)

= Actual

$Watts_{ee}$ = Operating demand (W) of efficient fan

= Actual (Retrofit). For time of sale projects refer to the Time of Sale HVLS connected load savings table below.

Time of Sale HVLS Connected Load Savings[4]

Diameter of Fan (feet)	Watts_base	Watts_ee
16-17.9	4497	761
18-19.9	5026	850
20-23.9	5555	940
24 +	6613	1119

Hours = Actual hours of operation. If unknown use the assumptions from the table below[5]

Facility Type	Annual Hours of Operation
Hog	3,458
Poultry	2,790
Dairy	2,455
Unknown/Other	3,133

[4] KEMA 2009 Evaluation of IPL Energy Efficiency Programs, Appendix F, Group 1 Programs, Volume 2 (Table 17). Typically, the number of baseline conventional circulation fans the HVLS fan is off-setting is not a one for one replacement scenario. Due to their more efficient design, a single HVLS fan can move and displace as much air as multiple conventional circulation fans. The baseline wattage represents the equivalent quantity of baseline fans and their wattages to match that of a single HVLS fan.

[5] Based on NCEI/NCDC US Hourly Climate Normals data for Weather Stations in each Climate Zone, and weighted by 2010 US Census Data. The unknown/other commodity type is a weighted average of hog, poultry, and dairy facilities based on farm count as sourced from the U.S. 2017 Agriculture Census for Iowa. Dairy Farm Energy Management Guide, Southern California Edison February, 2004. The guide recommends controlling fans in order to provide maximum ventilation as necessary at 72°F and above due to heat stress concerns on cows at and above that temperature. The 67°F balance point was developed assuming a 5°F temperature band, assuming the interior temperature of the barn will be greater than that outside due to internal heat gains.

Based on default assumptions above, deemed savings for replacing one fan would be:

Facility Type	Diameter of Fan (feet)	ΔkWh
Hog	16-17.9	12,919.1
	18-19.9	14,440.6
	20-23.9	15,958.7
	24 +	18,998.3
Poultry	16-17.9	10,423.4
	18-19.9	11,651.0
	20-23.9	12,875.9
	24 +	15,328.3
Dairy	16-17.9	9,171.9
	18-19.9	10,252.1
	20-23.9	11,329.8
	24 +	13,487.8
Unknown/Other	16-17.9	11,704.9
	18-19.9	13,083.4
	20-23.9	14,458.8
	24 +	17,212.7

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\sum(\text{-}N_{base} * Watts_{base}) - \sum(N_{ee} * Watts_{ee})}{1000} * CF$$

Where:

CF = Summer Peak Coincidence Factor

= 100%[6]

Based on default assumptions above, deemed savings would be:

Facility Type	Diameter of Fan (feet)	ΔkW
Hog	16-17.9	3.74
	18-19.9	4.18
	20-23.9	4.62
	24 +	5.49
Poultry	16-17.9	3.74
	18-19.9	4.18
	20-23.9	4.62
	24 +	5.49
Dairy	16-17.9	3.74
	18-19.9	4.18
	20-23.9	4.62
	24 +	5.49
Unknown/Other	16-17.9	3.74
	18-19.9	4.18

[6] Industrial Ventilation CF from eQuest.

Facility Type	Diameter of Fan (feet)	ΔkW
	20-23.9	4.62
	24 +	5.49

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-HVSF-V03-240101

REVIEW DEADLINE: 1/1/2028

4.1.3 High Speed Fans

DESCRIPTION

The measure applies to high speed exhaust, ventilation and circulation fans that are replacing an existing unit that reached the end of its useful life in agricultural applications.

Agricultural circulation fans are fans located in barns to provide air movement that helps to keep animals cool. Circulation fan efficiency is expressed as CFM[7]/watt and is derived from the thrust efficiency ratio (TER) in pounds force per watt (lbf/W).

Agricultural ventilation fans provide ventilation air to keep animals cool. Fan efficiency is expressed as CFM/watt and is derived from the thrust efficiency ratio (TER) in pounds force per watt (lbf/kW).

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment must be certified by BESS Labs[8] with fan diameters above 12 inches that meet program minimum efficiency requirements.

Diameter of Fan (inches)	Circulation Fans IPL Minimum Efficiency (CFM/Watt)	Ventilation Fans IPL Minimum Efficiency (CFM/Watt) at (0.05 SP[9])
12-23	10.7	10.1
24-35	11.5	13.5
36-47	19.0	17.4
48+	21.5	20.3

Efficient fans are assumed to be governed by thermostatic on/off controls.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be an existing fan that reached the end of its useful life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years for Circulation Fans[10] and 7 years for Ventilation Fans[11] .

DEEMED MEASURE COST

Actual full installed costs may be used along with the following baseline cost assumptions:[12]

Diameter of Fan (inches)	Baseline Cost
12-23	$375

[7] Cubic Feet per Minute
[8] University of Illinois, Department of Agricultural and Biological Engineering. http://bess.illinois.edu/
[9] Static Pressure in units of inches of water
[10] Average motor life is calculated by dividing the estimated motor life (35,000 hours) divided by the annual run hours, taken to be the unknown/other farm commodity type of 3,259 hours (see description of default run hours on following page); and rounded down to nearest whole year. Motor life source, U.S. Department of Energy Advanced Manufacturing Office, Motor Systems Tip Sheet #3.
[11] Average motor life is calculated by dividing the estimated motor life (35,000 hours) divided by the annual run hours, taken to be the unknown/other farm commodity type of 4,800 hours (see description of default run hours on following page); and rounded down to nearest whole year. Motor life source, U.S. Department of Energy Advanced Manufacturing Office, Motor Systems Tip Sheet #3.
[12] Baseline full installed costs from Act on Energy Commercial Technical Reference Manual No. 2010-4. Cost for 12-23" diameter fans determined through extrapolation of costs for other fan sizes.

Diameter of Fan (inches)	Baseline Cost
24-35	$450
36-47	$525
48+	$600

If actual cost not available, assume an incremental total installed cost of $150.[13]

LOADSHAPE

Loadshape C34 - Industrial Motor

COINCIDENCE FACTOR

The measure has deemed kW savings therefore, a coincidence factor is not applied.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{Watts_base - Watts_ee}{1000} * Hours * Nfans$$

Where:

Watts_base[14] = Demand (W) of baseline fan

Diameter of Fan (inches)	Circulation Fan Watts_base	Ventilation Fan Watts_base
12-23	366	382
24-35	615	550
36-47	810	879
48+	1358	1353

Watts_ee[15] = Demand (W) of efficient fan

Diameter of Fan (inches)	Circulation Fan Watts_ee	Ventilation Fan Watts_ee (0.05 SP)
12-23	298	304
24-35	440	383
36-47	529	565
48+	993	1041

Hours[16] = Actual hours of operation. TBD with new climate data

Facility Type	Circulation Fan Annual Hours of Operation	Ventilation Fan Annual EFLH
Hog	3,458	4,773
Poultry	2,790	5,298
Dairy	2,455	4,033
Unknown/Other	3,133	4,854

[13] Act on Energy Commercial Technical Reference Manual No. 2010-4.
[14] BESS fan database downloaded on 7/1/2015. Average watts from models below standard. AgCirculation Fans.xls
[15] BESS fan database downloaded on 7/1/2015. Average watts from models above standard. AgCirculation Fans.xls
[16] See "Ag Op Hours_2023.xlsx" workbook for a complete description and derivation of default operating hours. EFLH based on US Hourly Climate Normals data for weighted statewide average. The unknown/other commodity type is a weighted average of hog, poultry, and dairy facilities based on farm count as sourced from the U.S. 2017 Agriculture Census for Iowa.

Nfans = Number of circulation fans

= Actual

Based on default assumptions above, deemed savings would be:

Facility Type	Diameter of Fan (feet)	Circulation Fan ΔkWh	Ventilation Fan ΔkWh
Hog	12-23	235.1	372.3
	24-35	605.2	797.1
	36-47	971.7	1,498.7
	48+	1,261.2	1,489.2
Poultry	12-23	189.7	413.2
	24-35	488.3	884.8
	36-47	784.0	1,663.6
	48+	1,018.4	1,653.0
Dairy	12-23	166.9	314.6
	24-35	429.6	673.5
	36-47	689.9	1,266.4
	48+	896.1	1,258.3
Unknown/Other	12-23	213.0	378.6
	24-35	548.3	810.6
	36-47	880.4	1,524.2
	48+	1143.6	1514.5

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{Watts_base - Watts_ee}{1000} * CF * Nfans$$

Where:

CF = Summer Peak Coincidence Factor

= 100%[17]

Based on default assumptions above, deemed savings would be:

Facility Type	Diameter of Fan (feet)	Circulation Fan ΔkW	Ventilation Fan ΔkW
Hog	12-23	0.068	0.078
	24-35	0.175	0.167
	36-47	0.281	0.314
	48+	0.365	0.312
Poultry	12-23	0.068	0.078
	24-35	0.175	0.167
	36-47	0.281	0.314
	48+	0.365	0.312
Dairy	12-23	0.068	0.078
	24-35	0.175	0.167
	36-47	0.281	0.314

[17] Industrial Ventilation CF from eQuest.

Facility Type	Diameter of Fan (feet)	Circulation Fan ΔkW	Ventilation Fan ΔkW
	48+	0.365	0.312
Unknown/Other	12-23	0.068	0.078
	24-35	0.175	0.167
	36-47	0.281	0.314
	48+	0.365	0.312

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-HSF-V03-240101

REVIEW DEADLINE: 1/1/2028

4.1.4 Livestock Waterer

DESCRIPTION

This measure applies to the replacement of electric open waterers with sinking or floating water heaters with equivalent herd size watering capacity of the old unit. Livestock waterers utilize electric heating elements and are used in cold climate locations in order to prevent water from freezing. Energy efficient livestock waterers, also called no or low energy livestock waterers, are closed and insulated watering containers that use lower wattage heating elements, thermostatically controlled, and water agitation (either in the form of air bubbles or floating balls), to prevent water from freezing, using less energy.

This measure was developed to be applicable to the following program types: RF, TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to an electrically heated thermally insulated waterer with minimum 2 inches of insulation. A thermostat is required on unit with heating element greater than or equal to 250 watts.[18]

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be an electric open waterer with sinking or floating water heaters that have reached the end of useful life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[19]

DEEMED MEASURE COST

For time of sale, the incremental cost is $575[20]. For retrofit, use actual costs.

LOADSHAPE

Loadshape C04 - Non-Residential Electric Heating

COINCIDENCE FACTOR

Heated livestock waterers only operate in the winter in order to keep water from freezing so the summer peak coincident demand savings is zero.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{(WattsBASE - WattsEE)}{1{,}000} * Hours$$

Where:

WattsBASE = Power consumption of baseline equipment. Actual, if known

= If unknown, use 1,100 for RF, 500 for TOS[21]

WattsEE = Power consumption of efficient equipment. Actual, if known

[18] Act on Energy Commercial Technical Reference Manual No. 2010-4

[19] PA Consulting Group Inc. "State of Wisconsin Public Service Commission of Wisconsin Focus on Energy Evaluation Business Programs: Measure Life Study Final Report." August 25, 2009

[20] Internet research of leading distributers

[21] EnSave, Energy Efficient Stock Waterers

= If unknown, use 250 for energy-efficient, 0 for energy free

1,000 = Kilowatt conversion factor

Hours = Average annual run hours of heater. Actual if known.

= If unknown, use the table below[22]

Climate Zone (City based upon)	Hours
1 (Rockford)	2,321
2 (Chicago)	2,103
3 (Springfield)	1,731
4 (Belleville)	1,362
5 (Marion/Murphysboro)	1,016
State-Wide Average	**1,707**

Based on default assumptions above, deemed savings would be:

Measure Type	Efficient Option	ΔkWh
Retrofit	Energy Efficient	1,451.0
	Energy Free	1,877.7
Time of Sale	Energy Efficient	426.8
	Energy Free	853.5

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-LSW1-V04-240101

REVIEW DEADLINE: 1/1/2029

[22] The number of days in the use season in which the temperature drops below 35°F in the state of Illinois. The data is sourced as an average from TMYx weather data for five different weather zones within the state, see 'Ag Op Hours_2023 – IL- Final.xlsx

4.1.5 Fan Thermostat Controller

DESCRIPTION

Incorporating a ventilation fan thermostat controller can reduce energy consumed where livestock is housed. Livestock ventilation fans reduce heat stress during the warmer months of the year.

For the purposes of this measure characterization, the installed ventilation fan thermostat controllers are temperature based on/off controls. While the complexity and intelligence of available controls can vary widely, where integrated controls can automate multiple modes and stages of ventilation, this measure assumes the control functionality is turning off the fan once the temperature falls to a certain point. It is recommended that other intelligent control technologies and strategies be handled through a custom approach, as these control installations require commissioning to optimize the functionality based on unique site and design considerations.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to the incorporation of thermostatic controller for ventilation fans used in the livestock industry. To qualify, the ventilation fan must be used to modulate the temperature to reduce heat stress in a livestock facility.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is a non-thermostatically controlled livestock ventilation fan that operates constantly in their maximum capacity.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 15 years.[23]

DEEMED MEASURE COST

The incremental cost is estimated at $50 per fan.[24]

LOADSHAPE

Loadshape C34 – Industrial Motor

COINCIDENCE FACTOR

The savings come from a reduction in nighttime operation, so a coincidence factor is not applicable for this measure.

Algorithm

CALCULATION OF ENERGY SAVINGS

The annual energy savings are generated by the fan being disabled at temperatures below 70°F. Typically the evening hours are cooler, and the ventilation fans are not required at these lower temperatures. It is assumed, prior to retrofit, that baseline ventilation fans are operating continuously from May 1st through October 31st, encapsulating the entire portion of the year in which hot temperatures exist and the need for livestock housing ventilation is prevalent. The efficient fan operation is derived from regional TMYx data for the state of Illinois and represent, over the same timeline that was used for the baseline, the number of hours in which the temperature is above 70°F. Electric Energy Savings

$$\Delta kWh = HP_{Fan} \times LF \times C_{ME} \times \Delta Hours \div Eff_{motor}$$

[23] Focus on Energy Evaluation Business Programs Measure Life Study: Final Report August 25, 2009, Public Service Commission of Wisconsin.

[24] The measure incremental cost is sourced from the 2023 Michigan Energy Measures Database (MEMD).

Where:

HP_{Fan} = Motor horsepower of the controlled fan

= Actual; if unknown, default to 1 horsepower[25]

LF = Fan load factor

= 0.75

CME = 0.746 kW to HP conversion factor

ΔHours = Reduction in fan run hours as a result of the thermostat controller, dependent on location[26]

Zone	$Hours_{Base}$	$Hours_{Eff}$	ΔHours
Hog	6,307	4,773	1,534
Poultry	5,670	5,298	372
Dairy	4,829	4,033	795
Unknown/Other	5,937	4,854	1,083

Eff_{motor} = 82.5%[27], motor efficiency

For example, using the default assumptions on a 1 horsepower fan thermostat controller for a single fan on a poultry farm:

$$\Delta kWh = 1\ HP \times 0.75 \times 0.746 \times 372\ hours\ /\ 82.5\%\ efficency$$

= 252.3 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A – Assume fans will be in operation at maximum capacity during the coincident peak demand periods, resulting in zero potential demand savings during the hottest periods of the summer.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-FNTC-V03-240101

REVIEW DEADLINE: 1/1/2029

[25] The default fan horsepower is based on a review of single- and three-phase fans listed on BESS Labs performance tested exhaust fans between 36" and 47". The Bioenvironmental and Structural Systems (BESS) Laboratory is a research and agriculture fan product-testing lab at the University of Illinois. For more detail on the derivation of fan horsepower from BESS Lab's fan performance archive, please see "BESS Bin Data.xlsx".

[26] National Centers for Environmental Information (NCEI) Annual Normals, from 2006 - 2020, calculated with a base temp of varying degrees for different livestock, see 'Ag Op Hours_2023 - IL.xlsx for further details on fan staging temperatures.

[27] Table 1 with efficiency classes 60034-30 (2008), 4 Pole High Efficiency Motor, Technical note, IEC 600034-30 standard on efficiency classes for low voltage AC motors, TM)25 EN RevC 01-2-12, ABB.

4.1.6 Low Pressure Sprinkler Nozzles

DESCRIPTION

Incorporating low pressure sprinkler nozzles can decrease the energy and water consumed by reducing required water supply pressure to irrigate crop fields. Low pressure sprinkler nozzles can provide uniform water application by using various orifice applications and configurations while operating at a lower pressure compared to standard, impact driven sprinkler heads. Energy savings are achieved by the irrigation system operating at a lower water pressure while maintaining the same water distribution.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Low Pressure Irrigation Nozzles operate at 35 psi or lower at rated/required flow. Annual Electric Savings obtained will be based on the number of nozzles replaced. To qualify the nozzles must operate for more than 500 hours per year and provide the equivalent flow at the reduced pressure. The maximum pump pressure must also be reduced accordingly.

DEFINITION OF BASELINE EQUIPMENT

This measure applies to the replacement of high pressure irrigation nozzles that operate at 50 psi or greater at rated/required flow.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 5 years.[28]

DEEMED MEASURE COST

The incremental cost, including labor, is $1.74 per nozzle.[29]

LOADSHAPE

Loadshape C59 – Agriculture and Well Pumping

COINCIDENCE FACTOR

Coincidence Factor = 0.793[30]

Algorithm

CALCULATION OF ENERGY SAVINGS

The annual energy savings and coincidental electric demand savings is based on PG&E research on irrigation well pumping systems and corrected based upon the type of crop, irrigated acres, and average acre-feet of water applied per acre.[31]

ELECTRIC ENERGY SAVINGS

Annual kWh Savings = 4.06 kWh/yr/nozzle

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Annual kW Savings = 0.0017 kW/yr/nozzle

[28] Measure life is sourced from DEER 2008 for permanent, solid-set low pressure sprinkler nozzles.
[29] The incremental cost is sourced from SCE Workpaper, SCE13WP007, Low pressure Sprinkler Nozzles, January 2013.
[30] Iowa Energy Efficiency Statewide TRM, Version 3.0, effective January 1, 2019
[31] For additional detail on the derivation of Illinois-specific savings values and how the original source material was modified and normalized into single deemed values, please see the Illinois Workpaper for this measure, "Illinois_Statewide_TRM_Workpaper_Low Pressure Sprinkler Nozzles_2019 4.1.7.docx".

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-LPSN-V02-240101

REVIEW DEADLINE: 1/1/2029

4.1.7 Milk Pre-Cooler

DESCRIPTION

There is energy savings for adding a plate heat exchanger (pre-cooler) ahead of the milk storage tank. This addresses the electrical energy savings associated with the decreased milk cooling load. Installing a pre-cooler reduces milk temperature from 100°F to 55-70°F before it enters the bulk tank.

It is important to determine if the site has an adequate supply of water, as milk plate coolers require 1 to 2 times the amount of water as compared to processed milk, to be effective. However, sites leveraging plate coolers will repurpose the warm, discharged water, either for watering cows, wash-down, or other purposes on the farm. As there are indirect benefits associated with the warmer water,[32] and because it is typically repurposed, it is assumed that there are no negative water impacts for this measure. There are also no interactive domestic hot water savings attributable to the installation of a pre-cooler as the discharged water is typically not re-directed to the existing hot water heater.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The installation of the heat exchanger to decrease the cooling requirement of the primary milk bulk tank refrigeration system. The heat exchanger fluid medium used for heat rejection is well or ground water as this produces the largest temperature differential for energy savings. For water requirements, the water supply system must have capacity to keep up with the existing farm water demands and additional demands of the pre-cooler. To minimize the volume of water used for pre-cooling, a solenoid valve should be installed on the water supply line to the pre-cooler and be actuated only when the milk pump is in operation. A bypass line around the solenoid valve or a time delay relay can also be used to provide additional cooling of the residual milk in the pre-cooler between pumping cycles. A storage tank will be necessary for used cooling water storage until it is re-used for watering cows, cleanup or another purpose on the farm.

DEFINITION OF BASELINE EQUIPMENT

The baseline conditions assume that no previous pre-cooler heat exchanger was installed and the entire milk cooling load is on the milk bulk tank.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 15 years.[33]

DEEMED MEASURE COST

The average equipment cost of a plate cooler is $2,950 with an installation cost of $494, for a total incremental measure of $3,444.[34]

LOADSHAPE

Loadshape C58 – Farm Plate Cooler / Heat Recovery Unit

COINCIDENCE FACTOR

Coincidence factor of 0.16[35]

[32] It is less stressful (metabolically) for cows to drink warmed water, and research has shown that cows will drink more water if it is warmer, leading to increased milk production. “Massachusetts Farm Energy Best Management Practices for Dairy Farms”, United States Department of Agriculture (USDA), Natural Resource Conservation Service (NRCS), 2012.

[33] PA Consulting Group for the State of Wisconsin Public Service Commission, Focus on Energy Evaluation. Business Programs: Measure Life Study. Page 45 of pdf file. August 25, 2009.

[34] The equipment and labor costs are sourced from the PG&E Workpaper – Milk Pre Cooler (PGE3PAGR114), February 2013.

[35] Efficiency Vermont (EVT) Technical Reference Manual (TRM), Measure Savings Algorithms and Cost Assumptions, March 16, 2015

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Milk Pre-Cooler Heat Exchanger – Chiller Savings

$$\Delta kWh = \frac{\Delta T \times Lbs\ of\ Milk \times Cows \times C_{p,m} \times Days}{EER \times 1{,}000}$$

Where:

ΔT	= Change in milk temperature attributable to the pre-cooler
	= 30˚F[36]
Lbs of Milk	= The pounds of milk produced per day that needs to be cooled
	= 68 lbs of milk per cow[37]
Cows	= Number of milking cows per farm
	= Actual; if unknown use 101[38]
$C_{p,m}$	= Specific heat of milk
	= 0.93 Btu/lb ˚F[39]
Days	= 365 days/yr
EER	= Efficiency of the existing compressor
	= 8.0 Btuh/watt[40]
1,000	= 1,000 Watts to kW conversion factor

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{Hours} \times CF$$

Where:

Hours	= 2920 hours[41]
CF	= 0.16

[36] The efficacy of a milk plate cooler is sourced from Sanford, Scott (University of Wisconsin–Madison). "Energy Efficiency for Dairy Enterprises." Presentation to Agricultural and Life Sciences Program staff. December 2014. It was assumed that there is a 25°F of milk temperature difference for a single pass plate cooler and a 35°F of temperature difference for a double/multi-pass plate cooler. For the purposes of this measure, a straight average of 30°F between the two types was used. A plate cooler reduces the overall load on the refrigeration compressors and the revised ΔT when accounting for a milk pre-cooler is 30°F less

[37] "Ag Heat Recovery Tank Supplemental Data." WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. "Milk Production per Cow, Wisconsin."

[38] The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

[39] Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

[40] Average efficiency of an existing compressor on a dairy farm, as sourced from, Massachusetts Farm Energy: Best Management Practices for Dairy Farms, USDA NRCS, 2012 (page 19).

[41] Raw milk for pasturing must be cooled with 4 hours. Assuming 2 milking per day. Dairy Farm Energy Management Guide: California, Ludington, Johnson, Kowalski, & Mage, Southern California Edison, 2004.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-MLKP-V02-240101

REVIEW DEADLINE: 1/1/2029

4.1.8 VSD Milk Pump with Plate Cooler Heat Exchanger

DESCRIPTION

This technology incorporates adding a variable speed drive to a milk transfer pump. The VSD drive reduces the heat transferred to milk during pumping operation as well increases the amount of time the milk is in the free cooling heat exchanger. The VFD regulates the milk pump in order to increase the efficacy of the plate cooler heat exchanger by slowing the flow of milk. This results in a maximum heat transfer between the warm milk and the cold water used in the plate cooler.

Energy savings are realized by the reduced load on the primary milk cooling system. A milk transfer pump VSD is only effective if paired with a plate cooler.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Installation of a new variable speed drive (VSD) on a new or existing milk transfer process pump.

DEFINITION OF BASELINE EQUIPMENT

Must have a constant speed milk transfer process pump with no existing VSD controls. A plate cooling heat exchanger can already be a part of the system, or one installed in concert with the VSD.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life expectancy of this measure is 15 years.[42]

DEEMED MEASURE COST

The average equipment cost of a milk vacuum pump variable speed drive is $3,871 with an installation cost of $1,177, for a total incremental measure of $5,048.[43]

LOADSHAPE

Loadshape C57 – Milk Pump

COINCIDENCE FACTOR

There are no summer coincident peak savings for VFD dairy milk pumps. Through research of refrigeration compressor power demands, no substantial evidence has arisen that any notable kW demand reduction is possible in relation to using a VFD with a milk pre-cooler to pre-cool milk that would otherwise need to be chilled through mechanical refrigeration means.

[42] Focus on Energy Evaluation Business Programs Measure Life Study: Final Report August 25, 2009, Public Service Commission of Wisconsin.

[43] The equipment and labor costs are sourced from the PG&E Workpaper – Milk Vacuum Pump VSD, Dairy Farm Equipment (PGE3PAGR116), February 2013.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{1}{EER} \times C_{p,m} \times \Delta T \times Lbs\ of\ Milk \times Cows \times Days\ /\ 1{,}000$$

Where:

EER	= Efficiency of the existing compressor
	= 8.0 Btu/watt[44]
$C_{p,m}$	= Specific heat of milk
	= 0.93 Btu/lb ˚F[45]
ΔT	= Change in milk temperature as a result of the milk transfer pump VSD. This value is the additional benefits of a VSD on the milk pump over a standard plate cooler
	= 11.7 ˚F[46]
Lbs of Milk	= The pounds of milk produced per day that needs to be cooled
	= 68 lbs of milk per cow[47]
Cows	= Number of milking cows per farm
	= Actual, if unknown use 101[48]
Days	= 365.25 days of milking per year
1,000	= Watts to kW conversion factor

For example, using the default assumptions, the average kWh savings resulting from the installation of a milk transfer pump VSD is:

$$\Delta kWh = \frac{1}{8.0\ Btu/Watt} \times 0.93 \times 11.7°F \times 68\frac{lbs}{milk/cow} \times 101\ cows \times 365\frac{days}{yr} / 1{,}000$$
$$= 3{,}410\ kWh$$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

[44] Average efficiency of an existing compressor on a dairy farm, as sourced from, Massachusetts Farm Energy: Best Management Practices for Dairy Farms, USDA NRCS, 2012 (page 19)

[45] Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

[46] Sanford, Scott (University of Wisconsin–Madison). "Well Water Precoolers." Publication A37843. October 2003. It was determined that a plate cooler alone can reduce milk temperature to 68 ˚F and a plate cooler paired with a milk transfer pump VSD can reduce milk temperature to 56.3˚F. The additional benefits of the milk transfer pump VSD over the plate cooler is 11.7˚F.

[47] "Ag Heat Recovery Tank Supplemental Data." WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. "Milk Production per Cow, Wisconsin."

[48] The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-VSDM-V02-240101

REVIEW DEADLINE: 1/1/2029

4.1.9 Scroll Compressor for Dairy Refrigeration

DESCRIPTION

Incorporating a more efficient compressor for process milk refrigeration can decrease the energy consumed at dairy farms. This measure is for the installation of a scroll compressor to replace an existing reciprocating compressor on a milk refrigeration bulk tank. The milk refrigeration system is used to cool milk for preservation and packaging. Milk is extracted from the cow at 98°F and cooled to 38°F, resulting in a substantial load on the milk cooling equipment, which is typically the largest energy use on a dairy farm. Scroll compressors can provide increased refrigeration efficiencies with improved EERs over baseline reciprocating compressors.

The energy savings for this measure is dependent on if the site is utilizing pre-cooling equipment such as a milk plate cooler. Plate coolers can reduce the incoming temperature of the milk into the refrigeration bulk tank, reducing the overall load on the compressor and the potential savings benefits.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

For an efficient scroll compressor with or without a plate cooler heat exchanger, the proposed compressor must be rated at 10.6 EER or greater on a process milk refrigeration system. The calculation assumes the cooling capacity of the compressor remains the same.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a reciprocating compressor.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected life of this measure is 15 years.[49]

DEEMED MEASURE COST

The incremental cost is $400 per compressor.[50]

LOADSHAPE

Loadshape C56 – Dairy Farm Combined End Use

COINCIDENCE FACTOR

Coincidence factor of 0.34[51]

[49] Focus on Energy Evaluation Business Programs Measure Life Study: Final Report August 25, 2009, Public Service Comission of Wisconsin.
[50] The incremental cost is sourced from Sanford, Scott (University of Wisconsin-Madison). “Energy Efficiency for Dairy Enterprises.” Presentation to Agricultural and Life Sciences Program Staff. December 2014.
[51] Efficiency Vermont (EVT) Technical Reference Manual (TRM), Measure Savings Algorithms and Cost Assumptions, March 16, 2015

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{\left(\frac{1}{EER_{base}} - \frac{1}{EER_{eff}}\right) \times Process\ Load}{1{,}000}$$

Where:

EER_{base} = Efficiency of the existing compressor

= 8.4 Btu/watt[52]

EER_{eff} = Efficiency of the installed, scroll compressor

= 10.6 Btu/watt[53]

Process Load = $C_{P,Milk} \times \Delta T \times Lbs\ of\ Milk \times Cows \times Days$

Where:

$C_{P,Milk}$ = Specific heat of milk

= 0.93 Btu/lb ˚F[54]

ΔT = Change in milk temperature as result of the primary cooling system

= 60˚F without a milk plate cooler[55]

= 30˚F with a milk plate cooler[56]

Lbs of Milk = The pounds of milk produced per day that needs to be cooled

= 68 lbs of milk per cow[57]

Cows = Number of milking cows per farm

= Actual; if unknown use 101[58]

Days = 365 days per year

[52] Average efficiency of a reciprocating compressor, as sourced from Wisconsin Focus on Energy TRM – Plate Heat Exchanger and Well Water Pre-Cooler, 2017

[53] Average efficiency of a scroll compressor, as sourced from Massachusetts Farm Energy: Best Management Practices for Dairy Farms, USDA NRCS, 2012 (page 33)

[54] Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

[55] Safe Handling of Milk & Dairy Products. March 8th, 2017 and Sanford, Scott (University of Wisconsin–Madison). "Well Water Precoolers." Publication A37843. October 2003. The temperature of the milk exiting the cow is considered to be 98°F and the final, cooled temperature of the milk is assumed to be 38°F.

[56] The efficacy of a milk plate cooler is sourced from Sanford, Scott (University of Wisconsin–Madison). "Energy Efficiency for Dairy Enterprises." Presentation to Agricultural and Life Sciences Program staff. December 2014. It was assumed that there is a 25°F of milk temperature difference for a single pass plate cooler and a 35°F of temperature difference for a double/multi-pass plate cooler. For the purposes of this measure, a straight average of 30°F between the two types was used. A plate cooler reduces the overall load on the refrigeration compressors and the revised ΔT when accounting for a milk pre-cooler is 30°F less.

[57] "Ag Heat Recovery Tank Supplemental Data." WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. "Milk Production per Cow, Wisconsin."

[58] The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

1,000 = 1,000 watts to kW conversion factor

For example, using the default assumptions, average kWh savings of an installed scroll compressor on the milk refrigeration bulk tank with a dairy using an existing plate cooler is:

$$\Delta kWh = \frac{\left(\frac{1}{8.4\ EER} - \frac{1}{10.6\ EER}\right) \times \frac{0.93\ Btu}{lb\ of\ Milk} \times (98°\text{F} - 30°\text{F} - 38°\text{F}) \times 68 \frac{lbs\ milk}{cow} \times 101\ cows \times 365\ Days}{1{,}000\ Watts/kW}$$

$$\Delta kWh = 1{,}728\ kWh$$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{Hours} \times CF$$

Where:

Hours = 2,920 hours[59]

CF = 0.34

For example, using the default assumptions, average coincident peak demand savings of an installed scroll compressor on the milk refrigeration bulk tank with a dairy using an existing plate cooler is:

$$\Delta kW = \frac{1{,}728\ kWh}{2{,}920\ Hours} \times 0.34$$

$$\Delta kW = 0.201\ kW$$

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

MEASURE CODE: CI-AGE-SCRC-V02-240101

REVIEW DEADLINE: 1/1/2029

[59] Raw milk for pasturing must be cooled with 4 hours. Assuming 2 milking per day. Dairy Farm Energy Management Guide: California, Ludington, Johnson, Kowalski, & Mage, Southern California Edison, 2004.

4.1.10 Dairy Refrigeration Heat Recovery

DESCRIPTION

A refrigeration heat recovery (RHR) unit captures waste heat from the refrigeration system and uses a heat exchange to transfer some of that heat into incoming well water. That captured waste heat is used to pre-heat ground water before it enters the primary water heater and brought to the desired final temperature needed for cleaning farm equipment. The hot compressed refrigerant is diverted and flows through the heat exchanger, attached to a secondary water tank, on its way to the condenser unit. The heat from the refrigerant is transferred through the tank into the water. Thermal buoyancy causes the warmest water to rise to the top of the tank. When hot water is used, water flows from the RHR tank into the water heater, and well water flows into the heat recovery tank. These units can assist in reducing water heating energy use by approximately 50%.[60]

It is important to note that if a dairy farm installs an RHR unit and a milk plate cooler, (with or without the use of milk pump VFD control), the plate cooler will impact the savings potential of the RHR unit. The use of a plate cooler will reduce the total milk mechanical refrigeration load. Due to this refrigeration load reduction, the amount of heat rejection possible to the RHR system is diminished.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is farm refrigeration equipment where an RHR tank is installed and captures waste refrigerant heat from the refrigeration system compressor and transfers that waste into an RHR tank, supplied with cool ground water, through a heat exchanger before continuing through the refrigeration system condensing unit. The newly preheated water in the RHR tank is supplied into the farm's main water heater unit, which will have a smaller temperature differential to overcome, compared to a direct ground water heater feed.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing dairy farm with refrigeration equipment and a water heater unit without the use of an RHR unit to feed preheated water to the water heater. Water heater is fed directly with ground water.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected useful life is 15 years.[61]

DEEMED MEASURE COST

The incremental cost is $4,353.[62]

LOADSHAPE

Loadshape C58 – Farm Plate Cooler / Heat Recovery Unit

COINCIDENCE FACTOR

There are no summer coincident peak savings for RHR units. It is assumed that electric water heaters have a single element and will still be used to heat water up to full temperature, and that the kW rating is unchanged when an RHR unit is added in the water heating loop (resulting in no demand reduction).

Algorithm

[60] U.S. Department of Agriculture, Natural Resources Conservation Service. "Energy Self-Assessment: Refrigeration Heat Recovery." Accessed April 27th, 2023.
[61] PA Consulting Group Inc. "State of Wisconsin Public Service Commission of Wisconsin Focus on Energy Evaluation Business Programs: Measure Life Study Final Report." August 25, 2009.
[62] The incremental cost is sourced from Efficiency Vermont custom project data based on actual equipment installs between 2010 and 2017.

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = Btu_{Recovered} * Days * \left(\frac{1}{EF_{elec}}\right) / 3{,}412$$

Where:

$$Btu_{Recovered} = Btu_{Milk\ Potential}\ or\ Btu_{RHR\ Storage}\ (lesser\ of\ the\ two)$$

Where:

$$Btu_{Milk\ Potential} = Lbs\ of\ Milk\ * Cows * C_{P,Milk} * \Delta T_{Milk} * SF$$

and

$$Btu_{Storage} = Hot\ Water * C_{P,Water} * P_{Water} * \Delta T_{Water}$$

Days = Number of milking days per year

= 365.25 days[63]

3,412 = Btu to kWh electric conversion factor

EF_{elec} = Energy factor for a standard electric water heater

= 90%[64]

Lbs of Milk = The pounds of milk produced per day per cow that needs to be cooled

=68 lbs of milk per cow[65]

Cows = Number of milking cows per farm

= Actual, if unknown use 101[66]

$C_{P,Milk}$ = Specific heat of milk

= 0.93 Btu/(lb-˚F) [67]

ΔT_{Milk} = Change in milk temperature

= $^{\circ}F_{IN}$ - $^{\circ}F_{FINAL}$

$^{\circ}F_{IN}$ = Temperature of milk being supplied that needs to be cooled

[63] Wisconsin Milk Marketing Board. "Did You Know? Website: Milking Every Day." Accessed December 21, 2015

[64] Talbot, Jacob (American Council for an Energy-Efficient Economy). ACEEE Report A121: Market Transformation Efforts for Water Heating Efficiency. January 2012.

[65] "Ag Heat Recovery Tank Supplemental Data." WI Dairy Statistics tab shows USDA reported annual data from: U.S. Department of Agriculture. "Milk Production per Cow, Wisconsin."

[66] The default value for the average number of milking cows per farm is sourced from the 2017 U.S. Census of Agriculture, Illinois State Summary Highlights, Full Report, Volume 1, Chapter 2, U.S. State Level. Average number of cows per farm = 93,341 cows / 924 farms.

[67] Specific heat of whole milk, Table 3: Unfrozen Composition Data, Initial Freezing Point, and Specific Heat of Foods, 2014 ASHRAE Handbook - Refrigeration. Page 19.5.

= 98˚F if no pre-cooler is used in operation; 68˚F if a milk pre-cooler is used;[68] 56.3˚F if a milk pre-cooler and VFD milk transfer pump are used.[69]

$^{\circ}F_{FINAL}$ = Final stored temperature of cooled milk

= 38˚F

SF = Savings factor for the percentage of energy able to be captured from the milk cooling process

= 55%[70]

Hot Water = Amount of hot water per day in gallons that the site uses for washing and cleaning purposes

= 131.7 gallons[71]

$C_{P,Water}$ = Specific heat of water

= 1 Btu/lb-˚F

P_{Water} = Density of water

= 8.34 lbs/gallon

ΔT_{Water} = Temperature difference = $Temp_{warm\ water} - Temp_{cold\ water}$

$Temp_{warm\ water}$ = 120˚F, expected temperature a refrigeration heat recovery unit can pre-heat well water up to.

$Temp_{cold\ water}$ = 52.3˚F, average well water temperature

SUMMER COINCIDENT PEAK DEMAND SAVINGS

None

FOSSIL FUEL SAVINGS

$$\Delta Therms = Btu_{Recovered} * Days * \left(\frac{1}{EF_{gas}}\right) / 100{,}000$$

Where:

100,000 =Btu to therms natural gas conversion factor

[68] The efficacy of a milk plate cooler is sourced from Sanford, Scott (University of Wisconsin–Madison). “Energy Efficiency for Dairy Enterprises.” Presentation to Agricultural and Life Sciences Program staff. December 2014. It was assumed that there is a 25°F of milk temperature difference for a single pass plate cooler and a 35°F of temperature difference for a double/multi-pass plate cooler. For the purposes of this measure, a straight average of 30°F between the two types was used. A plate cooler reduces the overall load on the refrigeration compressors and the revised ΔT when accounting for a milk pre-cooler is 30°F less.

[69] Sanford, Scott (University of Wisconsin–Madison). “Well Water Precoolers.” Publication A37843. October 2003

[70] DeLaval. “Dairy Farm Energy Efficiency.” April 20, 2011. DeLaval estimates the heat recovery potential to be between 20 and 60%. Based on engineering judgement and further corroboration from the Wisconsin Focus on Energy TRM, opted to default to a 55% savings factor.

[71] The hot water use per day is based on the average hot water requirements per wash cycle multiplied by the number of wash cycles per day. The average amount of hot water used per wash cycle, 47.9 gallons, is sourced from the National Resource Conservation Service for Wash Water Requirements for Milking Systems, a calculator developed by University of Wisconsin, August 2005, Milking Center Waste Volume, v12,05, The number of wash cycles per day account for the hot water rinse cycles that are used to flush and clean the milk lines before and after milking. As sourced from the Regional Technical Forum (RTF) as part of the Northwest Power & Conservation Council, Deemed Measures List; Agricultural: Variable Frequency Drives-Dairy, FY2012, v1.2. Pre- and post-power meter data for five sites were used to establish RTF energy savings and the raw data used to generate load profiles showed, on average, two milkings per day. As there will be one more wash cycle than milking, the default average wash cycles per day is three.

EF_{gas} = Energy factor for a standard natural gas water heater

= 59%

Other variables remain consistent with 'Electric Energy Savings' calculation method.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-DRHR-V02-240101

REVIEW DEADLINE: 1/1/2029

4.1.11 Commercial LED Grow Lights

DESCRIPTION

LED lamp technology offers reduced energy and maintenance costs when compared with conventional light sources. LED technology has a significantly longer useful life lasting 50,000 hours or more and significantly reduces maintenance costs. The savings and costs for this measure are evaluated with the replacement of HID and/or linear fluorescent grow lights with LED fixtures. LED lamps offer a more robust lighting source, longer lifetime, and greater electrical efficiency than conventional supplemental grow lights.

This measure is designed for other interior horticultural applications that use artificial light stimulation in an indoor conditioned space.

This measure was developed to be applicable to the following program types: ERET, TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

LED fixtures must have a reduced wattage, be listed on the Design Lights Consortium (DLC) qualified products list,[72] be UL Listed, have a power factor (PF) ≥0.90, a photosynthetic photon efficacy (PPE) of no less than 2.5 micromoles per joule, a minimum rated lifetime of 50,000 hours, and a minimum warranty of 5 years for the fixture. If DLC PPE requirements for LED grow lighting exceeds the current requirements, the new PPE will become the efficient equipment standard.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is the industry established grow light based on the horticultural application, as detailed in the table below. HID fixtures are assumed for flowering and vegetative crops. T5 high-output fixtures are assumed for seedling and leafy greens crops.

[72] Design Light Consortium – Horticultural Lighting, Testing and Reporting Requirements for LED-Based Horticultural Lighting, version 4.0, effective April 18, 2025. To date, all horticultural lamps certified by the DLC specification are LEDs.

Crop Type/Growth Stage	Baseline Technology Type	Baseline PPE (µmol/J)[73]	Baseline Fixture Wattage[74]
Flowering and Vine Crops (e.g. Tomatoes, Cucumbers, and Peppers and excludes floriculture applications)	High Pressure Sodium	1.7	1,100 W
Vegetative Growth	Metal Halide	1.25[75]	640 W
Leafy Greens (e.g. Microgreens, Lettuce, and Spinach)[76]	T5 HO Fixture	1.0[77]	358 W
Propagation[78]	T5 HO Fixture	1.0[79]	234 W
Medical Cannabis – Flowering Stage	High Pressure Sodium	1.7	1,100 W
Medical Cannabis – Vegetative Stage	Metal Halide	1.25[80]	640 W
Medical Cannabis – Cloning, Seedling, and Propagation	T5 HO Fixture	1.0[81]	234W
Recreational Cannabis – Flowering Stage	LED	2.2[82]	850 W[83]
Recreational Cannabis – Vegetative Stage	LED	2.2	640 W
Recreational Cannabis – Cloning, Seedling, and Propagation	LED	2.2	234 W

Recreational cannabis cultivation facilities have a separate equipment definition due to Illinois legislation.[84] See cannabis cultivation code from "Cannabis Regulation and Tax Act," Illinois HB 1438:

"The Lighting Power Densities (LPD) for cultivation space commits to not exceed an average of 36 watts per gross square foot of active and growing space canopy, or all installed lighting technology shall meet a photosynthetic photon efficacy (PPE) of no less than 2.2 micromoles per joule fixture and shall be featured on the Design Lights Consortium (DLC) Horticultural Specification Qualified Products List (QPL)."

[73] Jacob A. Nelson, Bruce Bugbee, "Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures." Utah State University. Accessed 5/6/2020.
[74] Jacob A. Nelson, Bruce Bugbee, "Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures." Utah State University. Accessed 5/6/2020.
[75] Jacob A. Nelson, Bruce Bugbee, "Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures." Utah State University. Accessed 5/6/2020.
[76] Microgreens T5 fixture is based on a 6-lamp high output fixture, based on program experience.
[77] D.S. de Villiers, L.D. Albright, and R. Tuck, "Next Generation, Energy Efficient, Uniform Supplemental Lighting for Closed-System Plant Production." International Society for Horticultural Science. Accessed 4/8/2022.
[78] Propagation T5 fixture is based on a 4-lamp high output fixture, based on program experience.
[79] D.S. de Villiers, L.D. Albright, and R. Tuck, "Next Generation, Energy Efficient, Uniform Supplemental Lighting for Closed-System Plant Production." International Society for Horticultural Science. Accessed 4/8/2022.
[80] Jacob A. Nelson, Bruce Bugbee, "Economic Analysis of Greenhouse Lighting: Light Emitting Diodes vs. High Intensity Discharge Fixtures." Utah State University. Accessed 5/6/2020.
[81] D.S. de Villiers, L.D. Albright, and R. Tuck, "Next Generation, Energy Efficient, Uniform Supplemental Lighting for Closed-System Plant Production." International Society for Horticultural Science. Accessed 4/8/2022.
[82] Recreational cannabis baseline PPE requirement is either 36 W/sqft or 2.2 µmol/J and DLC listed. Per HB 1438.
[83] Recreational cannabis baseline wattage was back calculated using the medical cannabis – flowering stage wattage of 1,100 W and adjusted by the IL HB 1438 minimum fixture efficiency of 2.2 µm/J compared to the typical baseline of 1.7 µm/J.
[84] Illinois legislation Public Act 101-0027 the Cannabis Regulation and Tax Act, Article 20: Adult Use Cultivation Centers, (Section 20-15 (a) (23) a commitment to a technology standard for resource efficiency of the cultivation center facility (B) Lighting)

For new construction applications, for non-recreational cannabis facilities, baseline reverts to IECC 2021 or IECC 2024, depending on applicable permitting dates. IECC 2021 stipulates the following for lighting for plant growth and maintenance:

"Not less than 95 percent of the permanently installed luminaires used for plant growth and maintenance shall have a photon efficiency of not less than 1.6 µmol/J as defined in accordance with ANSI/ASABE S640."

IECC 2024 stipulates the following for lighting for plant growth and maintenance:

"Permanently installed luminaires shall have a photocynthetic photo efficacy of not less than 1.7 µmol/J for horticultural lighting in greenhouses and not less than 1.9 µmol/J for all other horticultural lighting, Luminaires for horticultural lighting in greenhouses shall be controlled by a device that automatically turns off the luminaire when sufficient daylight is available. Luminaires for horticultural lighting shall be controlled by a device that automatically turns off the luminaire at specific programmed times. The following buildings are exempt:

1. *Indoor grow buildings with less than 40 kW of connected load for horticultural lighting shall have a PPE of at least 1.7 µmol/J for integrated, nonserviceable luminaires, or a PPE of at least 1.7 µmol/J for lamps in luminaires with removable or serviceable lamps.*
2. *Cannabis facilities subject to 410 ILCS 705/10-45, the Cannabis Regulation and Tax Act.*

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 9.5 years (average rated life of 50,000 hours).[85]

DEEMED MEASURE COST

The estimated incremental measure cost, excluding recreational cannabis facilities, is assumed to be $501.[86]

For recreational cannabis facilities, incremental costs are estimated to be $80[87], as the baseline for these facilities is assumed to be LED fixtures given the Illinois PPE legislative requirements.

LOADSHAPE

Loadshape C65 – Non-Residential Indoor Agriculture Vegetative Room

Loadshape C66 – Non-Residential Indoor Agriculture Flowering Room

COINCIDENCE FACTOR

Summer coincidence factor for vegetative and flowering rooms = 0.95

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

PPF Equivalence Method:

[85] Based on 50,000 hours lifetime and 5,250 hours per year of use (average hours of use per year using flowering and vegetative rooms).

[86] Incremental costs are sourced from the Wisconsin Focus on Energy 2025 Technical Reference Manual, January 29, 2025 – Grow Light System, Agriculture, and include an estimated blend of baseline HID fixtures that fit the measure replacement scenario.

[87] LED fixture costs are based on a 2023 review of online retailers, conducted for the California eTRM, LED Indoor Horticulture, published April 18, 2025.

$$\Delta kWh = \left[\left(\frac{PPF_{Total,i}}{PPE_{BL,i} \times 1000}\right) - kW_{ee,i}\right] \times Hours \times WHF_e$$

$$PPF_{Total,i} = PPF_{Fixture,i} \times Qty_i$$

Where:

$PPF_{Total,i}$ = Total Photosynthetically-active Photon Flux output of the installed efficient fixtures for a specific growth phase, i in units of µmol/s. Equal to the number of fixtures installed multiplied by the PPF output per fixture.

$PPE_{BL,i}$ = Photosynthetically-active Photon Flux Efficiency of the assumed baseline fixture for a specific growth phase, i in units of µmol/J. Can be found in the table above.

$PPF_{Fixture,i}$ = The Photosynthetically-active Photon Flux output of an individual fixture installed for a specific growth phase, i in units of µmol/s.[88]

Qty_i = The installed quantity of efficient fixtures.

i = An indicator used to separate growth phases of products or different plants. "i" can be used to separate "Flowering" and "Vegetative", or different crop types, such as "Flowering Crops (tomatoes and peppers)" and "Microgreens".

1000 = Watts to kilowatts conversion factor

$kW_{ee,i}$ = Total power of the installed fixtures for a specific growth phase, i.

Hours = Annual operating hours. See table below for typical hours of operation breakdown by crop type.

Crop Type/Growth Stage	Hours of Operation per Day[89]	Annual Hours of Operation[90]
Flowering and Vine Crops (e.g. Tomatoes, Cucumbers, and Peppers and excludes floriculture applications)	12	4,200
Vegetative/Propagation Growth Stage	18	6,300
Leafy Greens (e.g. Microgreens, Lettuce, and Spinach)	18	6,300
Medical Cannabis – Flowering Stage	12	4,200
Recreational Cannabis – Flowering Stage	12	4,200
Greenhouse[91]	N/A	2,120

[88] Individual fixture PPF can be sourced directly from the DLC horticulture qualified products list, Design Light Consortium – Horticultural Lighting, Testing and Reporting Requirements for LED-Based Horticultural Lighting, version 4.0, effective April 18, 2025.

[89] Sole-Source Lighting of Plants. Technically Speaking by Erik Runkle. Michigan State University Extension. September 2017. Accessed: 7/29/2019.

[90] Annual hours of operation were found by multiplying hours per day by 350 operating days per year. Assuming 5 crop cycles with 3 days of downtime between each cycle

[91] Supplemental lighting for greenhouses varies monthly and fluctuates depending on the available daylight hours. As a result, only annual hours of operation for greenhouses is available and sourced from, Energy Savings Potential of SSL in Horticultural Applications, U.S. DOE, December 2017

WHFe = 1.21[92] if cooling or unknown or 1.00 if none; waste heat factor for energy to account for cooling savings from efficient lighting in cooled buildings.

For example, a recreational cannabis growth facility is installing 100 efficient LED fixtures in their flowering spaces. Using the manufacturer and model number, the DLC Qualified Products List for horticulture lighting lists these fixtures as consuming 529W and having a Photosynthetic Photon Efficiency (PPE) of 3.3 µmol/J and producing 1,722 µmol/s. One hundred (100) fixtures at 529W each is a total lighting power of 52.9 kW. The baseline PPE is 2.2 µmol/J, as dictated by IL HB 1438. The total flux output and annual energy savings calculations are shown below.

$$PPF_{Total,i} = (1{,}722\ \mu mol/s) \times 100\ fixtures$$ = 172,200 µmol/s

$$\Delta kWh = \left[\left(\frac{172{,}200\ \frac{\mu mol}{s}}{2.2\ \frac{\mu mol}{J} \times 1000}\right) - (52.9\ kW)\right] \times 4{,}200\ hours \times 1.21$$

= 128,944 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \left[\left(\frac{PPF_{Total,i}}{PPE_{BL,i} \times 1000}\right) - kW_{ee,i}\right] \times CF\ \times WHF_d$$

Where:

WHF_d = 1.22 if cooling or 1.00 if none; waste heat factor for demand to account for cooling savings from efficient lighting in cooled buildings.

CF = 0.95 for vegetative crops and flowering crops

For example, a recreational cannabis growth facility is installing 100 efficient LED fixtures in their flowering spaces. Using the manufacturer and model number, the DLC Qualified Products List for horticulture lighting lists these fixtures as consuming 529W and having a Photosynthetic Photon Efficiency (PPE) of 3.3 µmol/J and producing 1,722 µmol/s. One hundred (100) fixtures at 529W each is a total lighting power of 52.9 kW. The baseline PPE is 2.2 µmol/J, as dictated by IL HB 1438. The total flux output and peak demand savings calculations are shown below.

$$PPF_{Total,i} = (1{,}722\ \mu mol/s) \times 100\ fixtures$$ = 172,200 µmol/s

$$\Delta kWh = \left[\left(\frac{172{,}200\ \frac{\mu mol}{s}}{2.2\ \frac{\mu mol}{J} \times 1000}\right) - (52.9\ kW)\right] \times 0.95 \times 1.22$$

= 29.41 kW

FOSSIL FUEL SAVINGS

N/A

[92] Waste heat factor for cooling savings calculation can be found in the Indoor Agriculture Loadshapes excel file.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Any costs associated with moving the LED lighting fixture to different heights throughout the different growing phases should also be included as an O&M consideration.

MEASURE CODE: CI-AGE-GROW-V09-270101

REVIEW DEADLINE: 1/1/2028

4.1.12 Swine Heat Pads

DESCRIPTION

This measure applies to the large Commercial and Industrial sector, specifically for the agriculture industry. Swine farmers will typically keep their newborn piglets alongside their mothers (sows) for up to three to four weeks until they gain sufficient weight and can be moved to a nursery barn. During this farrowing stage, the piglets must be kept at temperatures ranging from 32 to 35°C (90 to 95°F). A sow and her piglets are kept in private farrowing crates, where the sow is kept in a separate and railed cage. This allows the piglets to still suckle from their mother and keeps the sow from crushing her piglets. These farrowing crates can be arranged in single or double systems. Typically, farmers will utilize a heat lamp as the primary heating source for these piglets, which can range from 125 W to 250 W and have an average measure life of 5,000 hours. More energy efficient technology has emerged in the form of heated mats. These mats require significantly less energy than a traditional heat lamp and have no known negative impacts on piglet health. Heating mats come in two options, single (typically rated at ≤100W) or double (typically rated at ≤200W) mats. Single mats serve one litter, and double mats serve two litters.

DEFINITION OF EFFICIENT EQUIPMENT

The use of heat mats in swine farrowing will result in electrical savings for the customer. Research has also shown that newborn piglets do not prefer mat heating over lamp heating, but as they grow, they tend to prefer mat heating. Applied research in large industrial settings found no significant differences between lamp and mat heating on the behavior and well-being of piglets. Therefore, the only difference to note between the two methods is the energy saved in using heating mats.

DEFINITION OF BASELINE EQUIPMENT

The baseline measure for swine farrowing heating is heat lamps, typically ranging from 125 to 250 Watts. Most studies conducted on swine farrowing heat lamps have used 125 watt or 175 watt lamps per litter.[93,94]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life of a farrowing heat mat is 5 years.[95]

DEEMED MEASURE COST

Heat mat prices will vary somewhat with size but a typical single mat costs $155 and double mat costs $280.[96] Additional costs can be incurred if a thermostat controller is included, these start at $240 but vary widely depending on controller complexity.

LOADSHAPE

Loadshape C04 - Non-Residential Electric Heating

COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.018.[97]

[93]Zhang, Q. and H. Xin, "Responses of Piglets to Creep heat Type and Location in Farrowing Crate," Applied Engineering in Agriculture (2001): Vol. 17(4) 515-519

[94] "Research at Puratone Confirms Effectiveness and Extensive Energy Savings of Heat Pads," Manitoba Hydro Power Smart

[95] Professional judgement based on Iowa Energy Efficiency Statewide Technical Reference Manual 2018 Volume 3: Nonresidential Measures, Agriculture Equipment: 3.1.9 Heat Mat, Posted July 12th, 2017

[96] Hog Slat. (2023). Heat Pad. Online pricing catalogue for agriculture and livestock equipment.

[97] Coincidence factor is taken from the IL TRM loadshape C04 – Non-residential Electric Loadshape.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$kWh_{saved} = kWh_{base} - kWh_{EE} - kWh_{controller}$$

$$kWh_{base} = \frac{Crates_{total} \times Hours \times Fixture_{crate} \times Lamp_{fixture} \times Wattage_{lamp}}{1000 \frac{Watts}{kW}}$$

$$kWh_{EE} = \frac{Hours \times \left(Mats_{single} \times Wattage_{single} + Mats_{double} \times Wattage_{double}\right)}{1000 \frac{Watts}{kW}}$$

$$kWh_{controller} = \frac{Hours \times Rooms \times \left(MSU_{room} \times MSU_{wattage}\right)}{1000 \frac{Watts}{kW}}$$

Where:

$$Crates_{total} = \left(Crates_{single-row} + Crates_{double-row}\right) \times Rows \times Rooms$$

$$Mats_{Single} = Crates_{single-row} \times Rows \times Rooms$$

$$Mats_{Double} = Crates_{double-row} \times Rows \times Rooms$$

$Crates_{total}$ = Number of Farrowing Crates

$Crates_{single-row}$ = Number of single crates in a row

$Crates_{double-row}$ = Number of double crates in a row

Rows = Number of rows in a room

Rooms = Number of rooms in a farrowing barn

$Mats_{single}$ = Number of single mats

$Mats_{double}$ = Number of double mats

$Wattage_{single}$ = Default 90W with no MSU, 61W with MSU*; Wattage of a single heat mat

$Wattage_{double}$ = Default 180Wwith no MSU, 122W with MSU*; Wattage of a double heat mat

Hours = Default 5,105 hours;[98] Annual hours of operation

$Fixture_{crate}$ = Number of heat lamp fixtures per farrowing crate

$Lamp_{fixture}$ = Number of heat lamps per fixture

$Wattage_{lamp}$ = Default 125W or 175W; Heat lamp wattage

MSU_{room} = Default 1; Number of master sensor units (MSU) per room

[98] While heat mat hours do vary from heat lamps slightly, the savings assumptions match heat lamp hours for consistency. Calculation method from Iowa State University farm manager (Ben Drescher): "At minimum I'd say they are on 24-7 from Oct-March and March-May, and 12 hours a day June-September 8 hours a day. You'd also take off for power washing etc. so if you had a 24 day turn in a farrowing room you'd run them for 21 days and turn the room subtract 3 days from x 15 turns a year - resulting in 5120 hours." Cadmus did not round data and estimated 5,105 hours. Email sent 10/23/15. "FW: Heat lamp bulbs". Itron benchmarked the HOU with their own analysis which resulted in 5,109 hours: 30.42 days/month; 3 months (summer) run 33% of time; 6 months run 50% of time; 3 months (winter) run full time.

$MSU_{wattage}$ = Default 75W; Wattage of master sensor unit

DEFAULT SAVINGS FOR SINGLE UNIT REPLACEMENT

Replacement Type	Baseline Heat Lamp	Annual kWh Savings
Single Mat replacing one Heat Lamp w/o MSU	125W	178.7
Single Mat replacing one Heat Lamp w/ MSU		326.7
Double Mat replacing two Heat Lamps w/o MSU		357.4
Double Mat replacing two Heat Lamps w/ MSU		653.4
Single Mat replacing one Heat Lamp w/o MSU	175W	433.9
Single Mat replacing one Heat Lamp w/ MSU		582.0
Double Mat replacing two Heat Lamps w/o MSU		867.9
Double Mat replacing two Heat Lamps w/ MSU		1163.9

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$kW_{Saved} = (kWh_{Saved}/Hours) \times CF$$

Where:

kWh_{Saved} = kWh savings, see above equation and table.

Hours = Operating hours, 5,105.

CF = Coincidence Factor, 0.018.[99]

DEFAULT SAVINGS FOR SINGLE UNIT REPLACEMENT

Replacement Type	Baseline Heat Lamp	Peak kW Savings
Single Mat replacing one Heat Lamp w/o MSU	125W	0.0006
Single Mat replacing one Heat Lamp w/ MSU		0.0012
Double Mat replacing two Heat Lamps w/o MSU		0.0013
Double Mat replacing two Heat Lamps w/ MSU		0.0023
Single Mat replacing one Heat Lamp w/o MSU	175W	0.0015
Single Mat replacing one Heat Lamp w/ MSU		0.0021
Double Mat replacing two Heat Lamps w/o MSU		0.0027

[99] Coincidence factor is taken from the IL TRM loadshape C04 – Non-residential Electric Loadshape.

Replacement Type	Baseline Heat Lamp	Peak kW Savings
Double Mat replacing two Heat Lamps w/ MSU		0.0041

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Approximately 1% of mats are likely to be damaged by swine each year and require full replacement.

Additionally, depending on the flooring, some mats may become loose on steel slated floors. This can be prevented by buying mats that have a channel or groove where it sits in the partition. Another option is to buy tie down clips that cost approximately $24 per double mat.[100]

The NPV for replacement heat lamps and annual levelized replacement costs using the societal real discount rate of 0.42% are presented below. The O&M cost adjustments are based on a 1-year measure life for heat lamps and a 5-year analysis period for heat pads. The measure life assumptions indicate an annual lamp replacement cost for the baseline equipment. The heat lamp replacement cost is assumed to be $5.50.[101]

Replacement Type	NPV of Replacement Costs for Period	Levelized Annual Replacement Cost Savings
Single Mat replacing one Heat Lamp	$20.58	$4.94
Double Mat replacing two Heat Lamps	$41.16	$8.98

MEASURE CODE: CI-AGE-HPAD-V02-240101

REVIEW DEADLINE: 1/1/2029

[100] Franklin Energy field experience

[101] The cost of a replacement heat lamp bulb is sourced from an average of available products via online pricing for agriculture equipment and heat lamps. For more information on the cost of a heat lamp and the derivation of O&M cost savings, please see: "Swine Heat Pads_OM.xlsx".

4.1.13 Irrigation Pump VFD

DESCRIPTION

This measure applies to variable speed drives (VSD) installed on irrigation pump motors for the agriculture industry. This characterization does not apply to positive displacement pumps. The VFD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The VFD is applied to a motor that does not yet have one. The irrigation system must have a variable load, and installation is to include the necessary controls as determined by a qualified engineer. Savings are based on application of VFDs to a range of baseline load conditions.

DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VFD or other methods of control. The retrofit baseline is an existing motor operating as is. Retrofit baselines may or may not include guide vanes, throttling valves, or other methods of control. This information shall be collected from the customer.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 15 years.[102]

DEEMED MEASURE COST

Customer provided costs will be used when available. Default measure costs[103] are noted below for up to 75 hp motors. Custom costs must be gathered from the customer for motor sizes not listed below.

HP	Cost
1-9 HP	$2,790
10-19 HP	$4,830
20-29 HP	$7,050
30-39 HP	$8,850
40-49 HP	$10,875
50-59 HP	$14,018
60-69 HP	$16,385
70-75 HP	$17,435

LOADSHAPE

Loadshape C59 – Agriculture and Water Pumping

COINCIDENCE FACTOR

The installation of a VFD on an irrigation pump should not cause any energy reduction during peak runtimes.

[102] California Public Utilities Commission (CPUC), Energy Division. 2014. "DEER2014-EUL-table-update_2014-02-05.xlsx"
[103] Variable Frequency Drive on Irrigation Pump, SWWP005-04, July 23, 2024, California eTRM.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \text{kWh}_{\text{Base}} - \text{kWh}_{\text{VFD}}$$

$$kWh_{Base} = \sum_{1}^{\eta} HP_{\eta} * 0.746 \frac{kW}{HP} * Hours_{year} * \%Hours_{\eta}$$

$$kWh_{VFD} = \sum_{1}^{\eta} HP_{VFD,\eta} * 0.746 \frac{kW}{HP} * Hours_{year} * \%Hours_{\eta}$$

$$HP_{\eta} = \frac{Flow_{\eta} * Head_{\eta}}{3960 \times (Eff_{pump} * Eff_{motor})}$$

$$HP_{VFD,\eta} = \frac{Flow_{\eta} \times Head_{VFD,\eta}}{3960 \times (Eff_{pump} * Eff_{VFD} * Eff_{motor})}$$

$$Hours_{year} = \frac{Acres \times Irrigation}{12\frac{in}{ft} * 60\frac{min}{hr} * GPM_{System} \Big/ \left(7.481\frac{gal}{ft^3} * 43{,}560\frac{ft^2}{acre}\right)}$$

Where:

kWh_{Base}	= Annual energy required for the baseline pump condition
kWh_{VFD}	= Annual energy required with a VFD pump installed
HP_{η}	= Baseline horsepower required for a given flow rate
$\text{HP}_{\text{VFD},\eta}$	= Horsepower required for a given flow rate with the VFD installed
$\text{Hours}_{\text{year}}$	= Annual Hours of irrigation
$\%\text{Hours}_{\eta}$	= Percent of time irrigation pump will be operating at a given flow rate
η	= Number of data points needed or collected
Flow_{η}	= Flow rate at a given data point in gallons per minute, use actual values
Head_{η}	= Pressure head at a given data point in feet, use actual values
$\text{Head}_{\text{VFD},\eta}$	= Pressure head at a given data point in feet with a VFD
Eff_{pump}	= Percent efficiency of the pump, taken from manufacturers pump curve
$\text{Eff}_{\text{motor}}$	= Percent efficiency of the pump motor

NEMA Premium Efficiency Motors Default Efficiencies[104]

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

Eff_{VFD} = Percent efficiency of the VFD

= 97%[105]

Acres = Size of the field that is being irrigated in acres

Irrigation = Gross irrigation required in inches per year

GPM_{System} = Required system flow rate in gallons per minute

[104] Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.

[105] Estimated typical VFD efficiency, as sourced from; "Chapter 18: Variable Frequency Drive Evaluation Protocol", The Uniform Methods Project: Methods for Determining Energy Efficiency Savings for Specific Measures, NREL, December 2014 (pg. 2)

For example, using the default assumptions on the installation of a VFD controlled by a pressure sensor is installed on a 25 hp irrigation pump using a central pivot to water corn for grain.

$Hours_{year}$	= (80 * 14.5) / ((12 * 60 * 300) / (7.481 * 43,560))
	= 1,750 hours
HP_n	= (300 * 120) / (3,960 * (0.615 * 0.936))
	= 15.79
kWh_{Base}	= 15.79 * 0.746 * 1750 * 0.5
	= 10,306.9
HP_{VFDn}	= (300 * 90) / (3,960 * (0.615 * 0.97 * 0.936))
	= 12.21
kWh_{VFD}	= 12.21 * 0.746 * 1750 * 0.5
	= 7,970
ΔkWh	= 10,306.9 – 7,970
	= 2,337 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

There are no expected peak demand impacts for this measure.

FOSSIL FUEL SAVINGS

There are no expected fossil fuel impacts for this measure.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

While there may be water savings from the installation of a VFD on an irrigation pump, they are not being included at this time. Any water savings calculations should be handled in a custom manner.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-PUMP-V03-270101

REVIEW DEADLINE: 1/1/2030

4.1.14 High Efficiency Grain Dryer

DESCRIPTION

This measure characterizes the energy savings from the replacement of an existing inefficient grain dryer with a new efficient grain dryer (Early Replacement incentive program). Alternatively, this measure is for the purchase of a new high efficiency grain dryer instead of a new standard efficiency grain dryer for an existing facility (Time of Sale program) or a new facility (New Construction incentive program). Energy savings are achieved by drying grain more efficiently through: improved dryer air flow design, improved dryer controls, warm air heat recovery, and burner efficiency improvements. Efficient dryers also have the benefits of increased throughput capacity and reduced annual hours of operation.

This measure was developed to be applicable to the following program types: TOS, EREP, and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a new, high efficiency grain dryer. Bushels per hour must be provided by the manufacturer, as rated at 5% moisture removal rate per bushel processed.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is a standard efficiency grain dryer currently on the market. Bushels per hour must be provided by the manufacturer, as rated at 5% moisture removal rate per bushel processed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the energy-efficient grain dryer is deemed to be 20 years[106].

DEEMED MEASURE COST

If known, the actual material and labor cost of installation should be used. If unknown, the cost of the measure is assumed to be the values summarized in the table below:

Tier (bushels per hour)	Tier (annual bushels)	High-Efficiency Dryer Total Installation Cost (for Early Replacement only)	Average Incremental Cost of High-Efficiency Dryer vs Standard Dryer	Average Incremental Cost of Variable Speed Drive added to Cost of High-Efficiency Dryer
<500	< 170,000	$83,000 (Based on baseline price of $50,000 + ($50/Bu/hr * 250 Rated Bu/hr) + Incremental Cost of High Efficiency)	$20,000	$4,000 (Based on baseline price of $2,500 + 0.046kW/Bu/hr * 250 Rated Bu/hr) *$100/kW)
≥ 500 and < 1,000	≥ 170,000 and < 330,000	$118,000 (Based on 750 Rated Bu/hr)	$30,000	$6,000 (Based on 750 Rated Bu/hr)
≥ 1,000 and < 2,000	≥ 330,000 and < 670,000	$165,000 (Based on 1,500 Rated Bu/hr)	$40,000	$9,000 (Based on 1,500 Rated Bu/hr)

[106] Iowa State University Ag Extension, "Computing a Grain Storage Rental Rate", October 2013. The useful life of grain storage bins was estimated to be between 15 and 25 years and the drying equipment useful life was estimated to be between 10 and 12 years. Combined with engineering judgement, the estimated measure life for a high efficiency grain dryer is estimated to be 20 years, which is corroborated by the Wisconsin Focus on Energy 2025 Technical Reference Manual, Cadmus, Publish Service Commission of Wisconsin – Energy Efficient Grain Dryer, January 2025.

Tier (bushels per hour)	Tier (annual bushels)	High-Efficiency Dryer Total Installation Cost (for Early Replacement only)	Average Incremental Cost of High-Efficiency Dryer vs Standard Dryer	Average Incremental Cost of Variable Speed Drive added to Cost of High-Efficiency Dryer
≥ 2,000 and < 3,500	≥ 670,000 and < 1,200,000	$258,000 (Based on 2,750 Rated Bu/hr)	$70,000	$15,000 (Based on 2,750 Rated Bu/hr)
≥ 3,500 and ≤ 5,000	≥ 1,200,000 and ≤ 1,700,000	$363,000 (Based on 4,250 Rated Bu/hr)	$100,000	$22,000 (Based on 4,250 Rated Bu/hr)
> 5,000	> 1,700,000	$488,000 (Based on 6,250 Rated Bu/hr)	$125,000	$31,000 (Based on 6,250 Rated Bu/hr)

Early Replacement: The full installation cost is provided in the table above. The assumed deferred cost (after 6.5 years [one third of useful life]) of replacing existing equipment with a new baseline unit is assumed to be the installation cost discounted to present value using the nominal discount rate.

LOADSHAPE

Loadshape NRE11 – Non-Residential Agriculture

COINCIDENCE FACTOR

There are no summer peak savings associated with this measure as it is assumed grain dryers do no operate during peak summer months.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

If grain dryer is heated exclusively with electricity:

$$\Delta kWh = Capacity * Hours * \left(\frac{Moisture\%_{In} - Moisture\%_{Out}}{100\% - Moisture\%_{Out}}\right) * Grain_{Lb} * Btu_{Lb\ Evap} * (1 / Dryer\ Eff_{Std} - 1/ Dryer\ Eff_{Eff}) / 3{,}412 + (Dryer\ Fan\ Power_{Std} - Dryer\ Fan\ Power_{Eff}) * Capacity * Hours$$

Where:

Capacity = Capacity of Grain Dryer in Bushels per hour when reducing grain moisture content by 5%

= Actual

Hours = Average annual hours of use of typical grain dryer

= Deemed value of 336.3 hr/year[107]

[107] Alliant Energy Custom Rebate project data from 2012-2014; original Alliant table was modified, adding a new column of hours per year use and renaming labels. Annual tier production quantities (bushels/yr) were divided by the maximum nominal tier capacities (bushels/hr @ rated capacity) to obtain Hours per Year @ Rated Capacity. Arithmetic average hours of use was 336.3 per year.

Annual hours of use were calculated based on following table. Deemed value is arithmetic average of Average Use per Year

Savings Tier (Bushels/hr) from Manufacturer	Savings Tier (Bushels/yr)	Hours
>= 0 Bu/Hr	170,000	340
>= 500 Bu/Hr	330,000	330
>= 1,000 Bu/Hr	670,000	335
>= 2,000 Bu/Hr	1,200,000	343
>= 3,500 Bu/Hr	1,700,000	340
>= 5,000 Bu/Hr	2,475,000	330

$Moisture\%_{In}$ = 23%[108], a deemed value representing average % moisture in grain arriving at grain dryer facility[109]

$Moisture\%_{Out}$ = 15%[110], a deemed value representing average % moisture in grain after being dried at grain dryer facility

$Grain_{Lb}$ = Standard weight of a bushel of grain in lbs per bushel. Lookup value from following table. [111]

[108] Wisconsin Focus on Energy project data; 13 recent grain dryer projects in Wisconsin were used as the source of average pre- and post- moisture content (23% and 15%, respectively) and baseline and proposed dryer efficiency.
[109] The National Corn Handbook. "Energy Conservation and Alternative Sources for Corn Drying." NCH-14, page 3, Table 4.
[110] Based on customer project data as sourced from Wisconsin Focus on Energy implementation database and reproduced in the 2025 Wisconsin Focus on Energy TRM, Energy Efficient Grain Dryer, January 2025 (project data:13 recent grain dryer projects in Wisconsin were used as the source of average pre- and post- moisture content (23% and 15%, respectively) and baseline and proposed dryer efficiency.)
[111] "Tables for Weights and Measurement: Crops". Murphy, William J.

Grain Type	Weight of "Standard Bushel"
Alfalfa	60.0 Lb/Std Bu
Barley	48.0 Lb/Std Bu
Clover	60.0 Lb/Std Bu
Corn, Shelled (15.5%)	56.0 Lb/Std Bu
Corn, Ear (15.5%)	68.4 Lb/Std Bu
Cotton	32.0 Lb/Std Bu
Cowpeas	60.0 Lb/Std Bu
Flax	60.0 Lb/Std Bu
Grass, Exc Timothy	14.0 Lb/Std Bu
Grass, Timothy	45.0 Lb/Std Bu
Lespedeza	45.0 Lb/Std Bu
Millet	80.0 Lb/Std Bu
Oats	32.0 Lb/Std Bu
Rape	60.0 Lb/Std Bu
Tye	56.0 Lb/Std Bu
Sorghum, Forage	50.0 Lb/Std Bu
Sorghum, grain (13.0%)	56.0 Lb/Std Bu
Soybeans	60.0 Lb/Std Bu
Sudan grass	28.0 Lb/Std Bu
Sunflower, oil type	28.0 Lb/Std Bu
Trefoil, Birdsfoot	60.0 Lb/Std Bu
Vetch	60.0 Lb/Std Bu
Wheat (13.5%)	60.0 Lb/Std Bu

$Btu_{Lb\ Evap}$ = 990 Btu per Lb of Water Evaporated; an engineering constant

$Dryer\ Eff_{Std}$ = Electric grain dryer efficiency of a standard-efficiency electric bin dryer, expressed as a %, defined as Btu of moisture evaporated in the dryer divided by the heating Btu input into the dryer

=71%[112], a deemed value, based on the following table, which represents BTU/Lb evaporated and equivalent Overall Efficiency for the dryers and heating sources used in this TRM:

[112] "Reducing Grain Drying Costs". Sanford, Scott., University of Wisconsin Rural Energy Program, 2013. Notes 20-30% savings in bin dryers through the use of stirrers and ambient air low temperatiure drying. Based on this, 71% is used as a conservative value, but Actual values can be used if available. Accessed August 19, 2020.

Grain Dryer Description	Dryer Efficiency		Dryer Fan Power (Dryer Fan Power)
	Dryer Eff	Btu/lb Water Evaporated (Btu/lb Water)	kW / Bushel
Baseline Gas Grain Dryer w/ Constant Speed Fan Operation	44%	2,241	0.044
Efficient Gas Grain Dryer w/ Constant Speed Fan Operation	61%	1,625	0.044
Efficient Gas Grain Dryer w/ Damper Fan Operation	61%	1,625	0.035
Efficient Gas Grain Dryer w/ Fan VFD	61%	1,625	0.002
Baseline Electric Bin Grain Dryer w/ Constant Speed Fan Operation	71%	1,400	0.44
Efficient Electric Bin Grain Dryer w/ Constant Speed Fan Operation	88%	1,120	0.044
Efficient Electric Bin Grain Dryer w/ Damper Fan Operation	88%	1,120	0.035
Efficient Electric Bin Grain Dryer w/ Fan VFD	88%	1,120	0.002

$Dryer\ Eff_{Eff}$ = Actual or a deemed value based upon above table. If unknown assume 88%[113]. See prior footnote for derivation of this value.

3,412 = Conversion factor of kWh to Btu; engineering constant.

$Dryer\ Fan\ Power_{Std}$ = 0.044 kW/Bu[114], from above table, a deemed value, based on the following average standard bin dryer operational parameters, and the engineering equation:

kW/Bu_{Std} = CFM/Bu_{Std} * $in._wc_{Std}$ / 6,354 / $Fan_Efficiency_{Std}$ * 0.746 / $Motor\ Eff_{Std}$

In the above equation, the following deemed constants are typical for standard-efficiency Grain Dryers:

Where:

CFM/Bu_{Std} = 61 CFM/Bu

$in._wc_{Std}$ = 3.0” wc

6,354 =Units conversion from cfm * in. wc. / Fan_Efficiency to BHP

$Fan_Effieciency_{Std}$ = 60%

0.746 = Units conversion from BHP to kW

$Motor\ Effcy_{Std}$ = 80%.

kW/Bu = 61 * 3.0 / 6,354 / 60% * 0.746 / 80%
= 0.044 kW/Bu

[113] Alliant Energy Custom Rebate project data from 2012-2014; same comments apply as in prior footnote.
[114] The Standard Dryer Fan Power using the fan brakehorsepower equation.

Dryer Fan Power$_{Eff}$ = 0.035 kW/Bu[115], if fan volume is controlled using outlet damper, or

= 0.002 kW/Bu, if fan volume is controlled using VFD.

Above values are deemed constants, based on the following average high-efficiency bin dryer operational parameters, and the engineering equation:

kW/Bu$_{Eff}$ = CFM/Bu$_{Eff}$ * in._wc$_{Eff}$ / 6,354 / Fan_Effieciency$_{Eff}$ * 0.746 / Motor_Effcy$_{Eff}$ / Drive_Effcy$_{Eff}$

In the above equation, the following deemed constants are assumed to apply to high-efficiency Grain Dryers:

Where:

CFM/Bu$_{Eff}$	= 22
in._wc$_{Eff}$	= 4.4” if Outlet Damper control; 0.4” if VFD control
6,354	=Units conversion from cfm * in. wc. / Fan_Efficiency to BHP
Fan_Efficiency$_{Eff}$	= 60%
0.746	= Units conversion from BHP to kW
Motor Eff$_{Eff}$	= 80%
Drive Eff$_{Eff}$	= 100% if Outlet Damper control; 95% if VFD control.

For high-efficiency dryer with VFD control:

kW/Bu = 22 * 0.4 / 6,354 / 60% * 0.746 / 80% / 95%
= 0.002 kW/Bu

For example, using the default assumptions on the installation of a 3,000 bushels/hr electric grain dryer with Outlet Damper used for Alfalfa:

$$\Delta kWh = (3{,}000 * 336.3 * \frac{(0.23 - 0.15)}{1-0.15} * 60 * 990 * (1/0.71 - 1/0.88)/3{,}412) + ((0.044 - 0.035) * 3{,}000 * 336.3)$$

= 458,865 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

If grain dryer is heated exclusively with natural gas:

$$\Delta Therms = Capacity * Hours * (\frac{Moisture_\%_{In} - Moisture_\%_{Out}}{1 - Moisture_\%_{Out}}) * Grain_{Lb} * Btu_{Lb\ Evap} * (1 / Dryer\ Eff_{Std} - 1/ Dryer\ Eff_{Eff}) / 100{,}000$$

Where:

100,000 = Conversion factor of Therms to Btu; engineering constant.

All variables are as defined and derived in the preceding electric savings calculations, but using values in the dryer efficiency table above for Baseline or Efficient "Gas or Propane Grain Dryer".

[115] The same Dryer Fan Power formula as in the above footnote.

Note: When a variable frequency drive (VFD) is incorporated on the drying fan, electrical savings may be claimed by the fan power derivation in the electric savings algorithm for additive electrical savings for a gas heated grain dryer.

For example, using the default assumptions on the installation of a 3,000 bushels/hr gas grain dryer with Outlet Damper used for Alfalfa:

ΔTherms = 3,000 * 336.3 * ((0.23 - 0.15) / (1 – 0.15)) * 60 * 990 * (1/0.44 - 1/0.61)/100,000

= 35,725 Therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-GDRY-V03-260101

REVIEW DEADLINE: 1/1/2030

4.1.15 Grain Dryer Tune-Up

DESCRIPTION

This measure is for commercial grain dryers for agricultural operations. Tune-ups improve grain drying efficiency by maintaining dryer components that have become clogged, dirty, or uncalibrated. This measure involves cleaning and/or inspecting burners, fans, and screens and cleaning and recalibrating all temperature and moisture sensors, if applicable.

Crops such as grain, soybeans, and corn need to be dried after harvest to prevent rot, mold, and animals from destroying the crop. After harvest, these wet crops are loaded into a grain dryer where they are dried. Grain drying processes vary but consist of warm (or high temperature) air forced through the crop. The air may be heated electrically or by fossil fuels. Once the grain is dried, it is stored in grain bins or silos until transport. At the time of harvest, moisture content inside grain varies between 17% and 40%. After drying, moisture levels are kept between 13% and 14% to improve shelf life. Maintaining peak efficiency of grain dryers through tune-ups is important for equipment efficiency and grain drying performance. Tune-ups save energy by removing impediments to airflow and calibrating sensors so that equipment capacity is maximized and drying time is minimized.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the facility must, as applicable, complete the tune-up requirements by an approved technician as specified below:

- Inspect and clean screens
- Inspect and clean fans
- Clean and calibrate all temperature sensors
- Clean and calibrate all moisture sensors*
- Inspect and adjust grain dryer controls including temperature setpoint, as needed
- Lubricate bearings

Task marks with an asterisk (*) are only required if the existing grain dryer contains this equipment.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a commercial-grade grain dryer that has not been tuned-up within the past 12 months.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 1 year.[116]

DEEMED MEASURE COST

The cost of this measure is $276, which includes service and labor.[117]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

[116] University of Wisconsin-Madison Extension. “Low Cost Energy Conservation: Grain Drying (A3784-10).” Tune-Ups are recommended annually because of the dusty environment components are subject to during the grain drying process. Although farms often defer grain dryer maintenance, the energy savings will not persist over multiple seasons.
[117] Wisconsin Focus on Energy 2025 Technical Reference Manual, Grain Dryer Tune-Up (pg. 51), January 2025. Incremental costs are based on trade ally survey.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = Bushels_{ANNUAL} * kWh\ Saved\ per\ Bushel$$

Where:

$Bushels_{ANNUAL}$ = Number of bushels of grain to be dried per year (bushels/yr)

= Actual

Where:

$$kWh\ Saved\ per\ Bushel = \left(GD_{EFF} * Lbs_{H2O\ REMOVED} * \frac{kWh\%}{3{,}412}\right) * SF$$

Where:

$kWh\ Saved\ per\ Bushel$ = Amount of energy saved per bushel of grain dried.

GD_{EFF} = Existing grain dryer efficiency (Btu/Lbs_H20)

= Actual, or default value in table below based on type of grain dryer

Grain Dryer Type	GD_EFF (Btu/Lbs_H2O)[118]	kWh%[119]
Low Temperature Bin Dryer	1,600	100%
Continuous Mixed Flow Bin Dryer	2,000	2%
Mixed Flow Dryer	2,000	2%
High Temperature Batch Bin Dryer	2,400	2%
Continuous Cross-Flow (Tower) Dryer	2,400	2%
Cross-Flow Batch Dryer	2,500	2%

$$Lbs_{H2O\ REMOVED} = Grain_{LBS} * \frac{(\%\ Moisture_{IN} - \%\ Moisture_{OUT})}{(100\% - \%\ Moisture_{OUT})}$$

Where:

$Lbs_{H2O\ REMOVED}$ = Pounds of water removed per bushel

= Calculated value based on grain type and grain starting and ending moisture content. Default values provided for corn and soybean in the table below.

[118] U.S. Department of Agriculture. "Energy Self-Assessment, Step 2: Informational Section." Grain Drying Energy Efficiency and Energy Cost graph. Accessed May 2019. See Grain Dryer Tune Up Supporting Document for referenced graph. And University of Wisconsin–Madison, Extension. Wisconsin Energy Efficiency and Renewable Energy "Improving Energy Efficiency in Grain Drying: Fact Sheet." December 2012.

[119] The National Corn Handbook. "Energy Conservation and Alternative Sources for Corn Drying." NCH-14, page 3, Table 4.

Crop Type	Moisture Removal Assumption	LBS_H2O Removed per $Bushels_{annual}$
Corn (Shelled)	7% reduction (from 22% initial moisture content (MC) to 15% final MC)[120]	4.61
Soybean	7% reduction (from 20% initial MC to 13% final MC)[121]	4.83[122]

$Grain_{LBS}$ = Standard weight per bushel of grain in lbs per bushel . Value is specific to grain type and is based on the following table: [123]

Grain Type	Weight of "Standard Bushel"
Alfalfa	60.0 Lb/Std Bu
Barley	48.0 Lb/Std Bu
Clover	60.0 Lb/Std Bu
Corn, Shelled (15.5%)	56.0 Lb/Std Bu
Corn, Ear (15.5%)	68.4 Lb/Std Bu
Cotton	32.0 Lb/Std Bu
Cowpeas	60.0 Lb/Std Bu
Flax	60.0 Lb/Std Bu
Grass, Exc Timothy	14.0 Lb/Std Bu
Grass, Timothy	45.0 Lb/Std Bu
Lespedeza	45.0 Lb/Std Bu
Millet	80.0 Lb/Std Bu
Oats	32.0 Lb/Std Bu
Rape	60.0 Lb/Std Bu
Tye	56.0 Lb/Std Bu
Sorghum, Forage	50.0 Lb/Std Bu
Sorghum, grain (13.0%)	56.0 Lb/Std Bu
Soybeans	60.0 Lb/Std Bu
Sudan grass	28.0 Lb/Std Bu
Sunflower, oil type	28.0 Lb/Std Bu
Trefoil, Birdsfoot	60.0 Lb/Std Bu
Vetch	60.0 Lb/Std Bu
Wheat (13.5%)	60.0 Lb/Std Bu

$\%\ Moisture_{IN}$ = Average % moisture of grain as it arrives at the grain dryer

= Actual

$\%\ Moisture_{OUT}$ = Average % moisture of grain as it exits the grain dryer after being dried

[120] The National Corn Handbook. "Energy Conservation and Alternative Sources for Corn Drying." NCH-14, page 3, Table 4.
[121] University of Nebraska-Lincoln, Institute of Agriculture and Natural Resources. "Harvest Soybeans at 13% Moisture".
[122] University of Minnestota Extension. "Storing, drying, and handling wet soybeans".
[123] "Tables for Weights and Measurement: Crops". Murphy, William J.

= Actual

$kWh\%$ = Percentage of overall dryer energy consumption that is electricity

= Default value in table above based on type of grain dryer

$3{,}412$ = Conversion from Btu to kWh

SF = Savings factor

= 5%[124]

For example, for a Mixed Flow Dryer that produces 100,000 bushels of corn per year.

$$\Delta Therms = 100{,}000\frac{Bu}{yr} \times \left(2{,}000\frac{Btu}{lb\ H2O} \times\ 4.61\frac{lbsH20}{bu} \times \frac{98\ \%\ Therm}{100{,}000\frac{Btu}{Therm}}\right) \times\ 5\%$$

$$\Delta Therms = 452$$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta Therms = Bushels_{ANNUAL} * Therms\ Saved\ per\ Bushel$$

$$Therms\ Saved\ per\ Bushel = \left(GD_{EFF} *\ Lbs_{H2O\ REMOVED} *\ \frac{Therms\%}{100{,}000}\right) * SF$$

Where:

Therms Saved per Bushel = Amount of energy saved per bushel of grain dried.

Therms% = Percentage of overall dryer energy consumption that is natural gas

= (1 – kWh%)

100,000 = Conversion factor

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-DTUNE-V02-270101

REVIEW DEADLINE: 1/1/2030

[124] Conservative estimate provided by a grain dryer manufacturer (Sukup Manufacturing Co.) – assumptions outlined in the Wisconsin Focus on Energy 2025 Technical Reference Manual, Grain Dryer Tune-Up (pg. 51), January 29, 2025.

4.1.16 Greenhouse Boiler Tune-Up

DESCRIPTION

This measure is for a non-residential greenhouse boiler. For space heating other than greenhouses, see measure 4.4.2 Space Heating Boiler Tune-Up. For process heating other than greenhouses, see measure 4.4.3 Process Boiler Tune-Up. The tune-up will improve boiler efficiency by cleaning and/or inspecting burners, combustion chamber, and burner nozzles. Adjust air flow and reduce excessive stack temperatures, adjust burner and gas input. Check venting, safety controls, and adequacy of combustion air intake. Combustion efficiency should be measured before and after tune-up using an electronic flue gas analyzer.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements by approved technician[125] as specified below:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces
- Inspect all refractory. Patch and wash coat as required.*
- Inspect gaskets on front and rear doors and replace as necessary.*
- Seal and close front and rear doors properly.*
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.*
- Clean plugs in control piping.*
- Remove all hand hole and man hole plates. Flush boiler with water to remove loose scale and sediment.*
- Replace all hand hole and man hole plates with new gaskets.*
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.*
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.*
- Make necessary adjustments to burner for proper combustion.
- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and man hole plates for leaks at normal operating temperatures and pressures.
- Troubleshoot any boiler system problems as requested by on-site personnel

Note: Tune-up activities marked with an asterisk (*) are eligible to be performed by internal maintenance staff at periods of boiler shutdown.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a boiler that has not had a tune-up within the past 36 months.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 3 years.[126]

[125] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up
[126] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

DEEMED MEASURE COST

The cost of this measure is $0.83/MBtu/hr per tune-up.[127]

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta Therms = ((Capacity * 8{,}766 * UF) / 100) * (1 - (Eff_{pre} / Eff_{measured}))$$

Where:

Capacity = Boiler gas input size (kBtu/hr)

= Custom

UF = Utilization Factor

= Default Utilization Factor for heating in a greenhouse for agricultural end use are listed in the table below, or use a custom value based on modeling.[128,129]

Building Type	Heating UF Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Greenhouses with curtains	0.473	0.445	0.383	0.328	0.321	Virtual Grower 3.1, with ASHRAE HDD
Greenhouses without curtains	0.476	0.447	0.385	0.330	0.323	Virtual Grower 3.1, with ASHRAE HDD

Eff_{pre} = Boiler Combustion Efficiency Before Tune-Up

[127] Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

[128] Custom site-specific utilization factors for greenhouses can be modeled using the greenhouse configuration and boiler capacity with USDA Virtual Grower software. https://www.ars.usda.gov/midwest-area/wooster-oh/application-technology-research/docs/virtual-grower/

[129] ASHRAE Fundamentals 2017 Chapter 14 Appendix HDD at 65 °F was used to smooth the Virtual Grower software outputs.

= Actual. Default value is 80.3%[130]

Note: Contractors should select a firing rate that appropriately represents the average operating condition and take readings at a consistent firing rate for pre and post tune-up.

$Eff_{measured}$ = Boiler Combustion Efficiency after Tune-Up

= Actual. Default value is 82.6%[131]

100 = Converstion from kBtu to therms

8,766 = Hours per year

For example, a greenhouse 80.3% efficient, 1,050 kBtu boiler is tuned-up resulting in final efficiency of 82.6%:

Δtherms =((1,050 * 8,766 * 0.419) / 100) * (1 - (0.803 / 0.826))

= 1,074 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-GTUNE-V02-250101

REVIEW DEADLINE: 1/1/2028

[130] Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

[131] Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

4.1.17 Greenhouse Thermal Curtains

DESCRIPTION

Existing greenhouse construction with polyethlene (PE) roofs allows for significant heat loss overnight. The existing PE roofs cause radiant heat to enter the space during daytime, but also lead to heat loss to outside the structure during the night. This can be addressed using thermal curtains which decrease conduction, convection, and radiation heat losses in greenhouses. Thermal curtains are installed inside the greenhouse and are designed to be placed horizontally above the growing zone within a greenhouse. In addition to retaining heat, thermal curtains are commonly used for shading. Thermal insulating curtains are sheets of fabric that extend above the plant growing zone and span the length of the greenhouse. These curtain barriers can reduce nighttime heat loss by more than 20%.[132] Operation of thermal curtains can be manual or motorized, but must be installed to ensure a tight seal at all connection points.

This measure case is defined as the installation of a single-layer heat curtain with infrared film in a greenhouse area in which a heat curtain was not present. It is assumed that the thermal curtains are deployed during nighttime hours, and open during daytime hours. This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure case is defined as the installation of a single-layer heat curtain with infrared film in a greenhouse area in which a heat curtain was not present. It is assumed that the thermal curtains are deployed during nighttime hours, and open during daytime hours. They can either be manual or motorized thermal curtains installed in greenhouse constructed of PE glazing.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a greenhouse constructed of PE glazing and no thermal curtain.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure lifetime for greenhouse thermal curtains is 5 years.[133]

DEEMED MEASURE COST

Measure cost for greenhouse thermal curtains is $0.76 per square foot.[134]

LOADSHAPE

NA

COINCIDENCE FACTOR

NA

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings are estimated using EnergyPlus version 9.4 whole-building energy simulation. The greenhouse geometry used in the EnergyPlus model consists of 4 connected bays, each bay with a gable type roof construction, measuring 36 feet wide by 100 feet long. The total conditioned floor area of the modeled greenhouse is 14,210 square feet, and savings are normalized per square foot floor area. The greenhouse is conditioned by gas-fired unit heaters and no cooling system. Greenhouse thermal curtain U values vary depending on the material type like spunbonded polyester, double-knit cloth, aluminized vinyl, aluminum strips, etc. They can have U values as low as

[132] Sanford, Scott, College of Agricultural and Life Science, University of Wisconsin Cooperative Extension. *Using Greenhouse Curtains to Reduce Greenhouse Heating and Cooling Costs.*

[133] DEER 2014, https://cedars.sound-data.com/deer-resources/

[134] Itron, Inc. 2014. *2010-2012 WO017 Ex Ante Measure Cost Study Final Report*. Prepared for the California Public Utilities Commission.

0.26 up to as high as 0.77. However, an average case of 0.483 U value has been simulated here which is assumed to represent a majority of thermal curtains.[135] The area of the thermal curtain equals the conditioned floor area of the greenhouse.

Baseline and efficient models were developed for each Illinois climate zone using inputs for key greenhouse construction characteristics and sources as listed in the following table:

Retrofit:

Input Parameter	Baseline Value	Efficient Value
Roof Glazing	Double PE film, U-value 0.7 ($Btu/h \cdot ft^2 \cdot °F$)[136]	Same as baseline.
Thermal Curtain	None.	Sunset - Sunrise, U-value 0.483 ($Btu/h \cdot ft^2 \cdot °F$)[137]
Wall Glazing	Single PE film, U-value 1.1 ($Btu/h \cdot ft^2 \cdot °F$)[138]	Same as baseline.
Infiltration	1.5 Air Change per Hour (ACH)[139]	Same as baseline.
Ventilation	10 cubic feet per minute (CFM) per area (ft^2)[140]	Same as baseline.
Heating System	Gas-fired unit heater, 0.8 efficiency	Same as baseline.
Thermostat Setpoint	Heating setpoint 70°F	Same as baseline.
Cooling System	Natural Ventilation	Same as baseline.
Occupancy Schedule	8am – 4pm	Same as baseline.
Lighting Power Density	1.83 watts per square foot[141]	Same as baseline.
Lighting Schedule	Varies monthly based on available daylight hours, supplemental lighting operates between 5 – 11 hours per day to target 20 total light hours.[142]	Same as baseline.

New Construction:[143]

[135] Bartok, John, Department of Natural Resources Management and Engineering, University of Connecticut, Natural Resource, Agriculture, and Engineering Service (NRAES) Cooperative Extension, Energy Conservation for Commercial Greenhouses, 2001 Revision, Table 4-1 Heat loss through blanket and roof, average of all material types.
[136] Bartok, Table 1-2 Heat flow u-value for double layer polyethlene film.
[137] Bartok, Table 4-1 Heat loss through blanket and roof, average of all material types.
[138] Bartok, Table 1-2 Heat flow u-value for single layer polyethlene film.
[139] ASHRAE HVAC Applications, Design for Greenhouses, ch. 25.2.1 Table 4, Suggested Design Air Changes for old construction with good maintenance.
[140] Bartok, Chapter 6, page 42.
[141] ASHRAE ch. 25.2.2 Table 10, Suggested Radiant Energy, Duration, and Time of Day for Supplemental Lighting in Greenhouses, average of all W/ft^2.
[142] ASHRAE ch. 25.2.2 Table 10, Suggested Radiant Energy, Duration, and Time of Day for Supplemental Lighting in Greenhouses, average of all hours.
[143] New construction greenhouses are compliant with IECC 2021 thermal envelope requirements. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Input Parameter	Baseline Value	Efficient Value
Roof Glazing	Double PE film, U-value 0.5 (Btu/h · ft^2 · °F)	Same as baseline.
Thermal Curtain	None.	Sunset - Sunrise, U-value 0.483 (Btu/h · ft^2 · °F)
Wall Glazing	Double PE film, U-value 0.7(Btu/h · ft^2 · °F)	Same as baseline.
Infiltration	1.5 Air Changes per Hour (ACH)	Same as baseline.
Ventilation	10 cubic feet per minute (CFM) per area (ft^2)	Same as baseline.
Heating System	Gas-fired unit heater, 0.8 efficiency	Same as baseline.
Thermostat Setpoint	Heating setpoint 70°F	Same as baseline.
Cooling System	Natural Ventilation	Same as baseline.
Occupancy Schedule	8am – 4pm	Same as baseline.
Lighting Power Density	1.83 watts per square foot	Same as baseline.
Lighting Schedule	Varies monthly based on available daylight hours, supplemental lighting operates between 5 – 11 hours per day to target 20 total light hours.	Same as baseline.

ELECTRIC ENERGY SAVINGS

NA

SUMMER COINCIDENT PEAK DEMAND SAVINGS

NA

FOSSIL FUEL SAVINGS

Natural gas savings are presented for each climate zone per square foot of greenhouse floor area, which constitutes all floor space under the thermal curtains, including pathways and growing canopy.

Zone	Retrofit Therm Savings per Square Foot	NC Therm Savings per Square Foot
Rockford	0.394	0.275
Chicago	0.361	0.250
Springfield	0.325	0.226
Belleville	0.317	0.222
Marion	0.265	0.191

For example, an existing 15,000 sq.ft greenhouse located in Chicago is retrofitting a thermal curtain with an IR film above the growing zone. The annual savings for the installation will be computed as:

$\Delta Therms = 15{,}000 * 0.361$

$= 5{,}415$ therms.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

NA

DEEMED O&M COST ADJUSTMENT CALCULATION

NA

MEASURE CODE: CI-AGE-GHEAT-V03-250101

REVIEW DEADLINE: 1/1/2028

4.1.18 Infrared Film for Greenhouse

DESCRIPTION

Existing greenhouse construction with polyethlene (PE) roofs allows for heat transmission loss up to 50%[144]. The existing PE roofs cause radiant heat to enter the space during daytime, but also lead to heat loss to the outside during the night. This issue can be addressed using Infrared-treated (IR) films. They can be applied on the interior side of the PE roof, reducing heat loss through the roof overnight by absorbing and re-emitting infrared radiation and can reduce heat loss by up to 20%.[145] Reduction in heat loss through the roof overnight reduces the heating load on the greenhouse heating system. This measure applies to greenhouses with polyethlene roof construction.

This measure case is defined as a greenhouse roof with infrared (IR) inhibiting film additive on the inflated double polyethylene roof. This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is infrared film installed on the interior of a PE roof glazing in a gas-heated greenhouse. The recommendation is to use one layer of IR film placed as the inner layer of the roof glazing. Doing this allows the wetting agent that is also included in most films to conduct the condensed moisture away.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a gas-heated greenhouse with PE roof glazing construction and no infrared film.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure lifetime for infrared film is 5 years.[146]

DEEMED MEASURE COST

Incremental cost for IR films installed in new/retrofit applications is $0.02 per square foot of IR film.[147]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings are estimated using EnergyPlus version 9.4 whole-building energy simulation. The greenhouse geometry used in the EnergyPlus model consists of 4 connected bays, each bay with a gable type roof construction, measuring 36 feet wide by 100 feet long. The total conditioned floor area of the modeled greenhouse is 14,210 square feet, and savings are normalized per square foot of conditioned floor area. The greenhouse is conditioned by gas-fired unit heaters and has no dedicated cooling system. Cooling is typically achieved by natural ventilation and exhaust/ventilations fans in the greenhouse space.

[144] Bartok, John, Department of Natural Resources Management and Engineering, University of Connecticut, Natural Resource, Agriculture, and Engineering Service (NRAES) Cooperative Extension, *Energy Conservation for Commercial Greenhouses*, 2001 Revision, Chapter 1, page 4.
[145] DEER 2014. https://cedars.sound-data.com/deer-resources/
[146] Itron, Inc. 2005. *2004-2005 Database for Energy Efficiency Resources (DEER) Update Study – Final Report.* Prepared for Southern California Edison.
[147] Itron, Inc. 2014. *2010-2012 WO017 Ex Ante Measure Cost Study Final Report*. Prepared for the California Public Utilities Commission.

Baseline and efficient models were developed for each Illinois climate zone using inputs for key greenhouse construction characteristics and sources as listed in the following table:

Retrofit:

Input Parameter	Baseline Value	Efficient Value
Roof Glazing	Double PE film, U-value 0.7 ($Btu/h \cdot ft^2 \cdot °F$)[148]	IR-treated double PE film, U-value 0.5 ($Btu/h \cdot ft^2 \cdot °F$) [149]
Wall Glazing	Single PE film, U-value 1.1 ($Btu/h \cdot ft^2 \cdot °F$)[150]	Same as baseline.
Infiltration	1.5 Air Change per Hour (ACH)[151]	Same as baseline.
Ventilation	10 cubic feet per minute (CFM) per area (ft^2)[152]	Same as baseline.
Heating System	Gas-fired unit heater, 0.8 efficiency	Same as baseline.
Thermostat Setpoint	Heating setpoint 70°F	Same as baseline.
Cooling System	Natural Ventilation	Same as baseline.
Occupancy Schedule	8am – 4pm	Same as baseline.
Lighting Power Density	1.83 watts per square foot[153]	Same as baseline.
Lighting Schedule	Varies monthly based on available daylight hours, supplemental lighting operates between 5 – 11 hours per day to target 20 total light hours.[154]	Same as baseline.

New Construction:[155]

Input Parameter	Baseline Value	Efficient Value
Roof Glazing	Double PE film, U-value 0.5 ($Btu/h \cdot ft^2 \cdot °F$)	IR-treated double PE film, U-value 0.3 ($Btu/h \cdot ft^2 \cdot °F$)
Wall Glazing	Double PE film, U-value 0.7 ($Btu/h \cdot ft^2 \cdot °F$)	Same as baseline.
Infiltration	1.5 Air Change per Hour (ACH)	Same as baseline.
Ventilation	10 cubic feet per minute (CFM) per area (ft^2)	Same as baseline.
Heating System	Gas-fired unit heater, 0.8 efficiency	Same as baseline.

[148] Bartok, Table 1-2 Heat flow u-value for double layer polyethlene film.
[149] Bartok, Table 1-2 Heat flow u-value for IR-inhibited double layer polyethlene film.
[150] Bartok, Table 1-2 Heat flow u-value for single layer polyethlene film.
[151] ASHRAE HVAC Applications, Design for Greenhouses, ch. 25.2.1 Table 4, Suggested Design Air Changes for old construction with good maintenance.
[152] Bartok, Chapter 6, page 42.
[153] ASHRAE ch. 25.2.2 Table 10, Suggested Radiant Energy, Duration, and Time of Day for Supplemental Lighting in Greenhouses, average of all W/ft^2.
[154] ASHRAE ch. 25.2.2 Table 10, Suggested Radiant Energy, Duration, and Time of Day for Supplemental Lighting in Greenhouses, average of all hours.
[155] New construction greenhouses are compliant with IECC 2021 thermal envelope requirements. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Input Parameter	Baseline Value	Efficient Value
Thermostat Setpoint	Heating setpoint 70°F	Same as baseline.
Cooling System	Natural Ventilation	Same as baseline.
Occupancy Schedule	8am – 4pm	Same as baseline.
Lighting Power Density	1.83 watts per square foot	Same as baseline.
Lighting Schedule	Varies monthly based on available daylight hours, supplemental lighting operates between 5 – 11 hours per day to target 20 total light hours.	Same as baseline.

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Natural gas savings are presented for each climate zone per square foot of greenhouse floor area, which constitutes all floor space under the thermal curtains, including pathways and growing canopy.

Zone	Retrofit Therm Savings per Square Foot of Floor Area	NC Therms Savings per Square Foot of Floor Area
Rockford	0.256	0.314
Chicago	0.232	0.285
Springfield	0.206	0.253
Belleville	0.198	0.245
Marion	0.163	0.212

For example**,** a 15,000 sq.ft greenhouse located in Chicago is retrofitting its roof glazing material with an infrared film. The annual savings for the installation will be computed as:

$$\Delta\text{Therms} = 15{,}000 * 0.232$$

$$= 3{,}480 \text{ therms.}$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-GFILM-V02-250101

REVIEW DEADLINE: 1/1/2028

4.1.19 ENERGY STAR Dairy Water Heater

DESCRIPTION

This measure is for upgrading from federal minimum code efficiency to an ENERGY STAR[156] commercial or residential high efficiency water heater on a dairy farm. Water heaters may have a tank for water storage or may be instantaneous. For electric water heaters to be certified by ENERGY STAR, heat pump technology is required. Energy performance of residential water heaters is typically measured by Uniform Energy Factor (UEF) [large sizes are measured by Energy Factor (EF)], gas commercial water heaters are rated by Thermal Efficiency (E_t), and electric commercial water heaters are rated by Coefficient of Performance (COP).

DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment must meet ENERGY STAR specifications.[157]

DEFINITION OF BASELINE EQUIPMENT

Time of sale: The baseline condition is assumed to be a new standard water heater of the same type and service (residential, commercial) as the existing unit being replaced. The new equipment must exceed federal standard efficiency based on equipment type, size category, and subcategory/rating condition.

New Construction: The baseline condition is a new standard water heater of the same type as the efficient, meeting the IECC code level in place at the time the building permit was issued. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints. Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code

For dairies, efficiency requirements assume a high draw pattern.

Service Type	Equipment Type	Size Category	Federal Minimum Efficiency Requirements[158]
Residential	Gas-Fired Storage Water Heater ≤75,000 Btu/h	≥20 gal and ≤55 gal	UEF = 0.6920 – 0.0013 × V_r
		>55 gal and ≤100 gal	UEF = 0.8072 – 0.0003 × V_r
		> 100 gal	EF = 0.6200 – 0.0019 × V_r
	Gas Fired Instantaneous Water Heater	< 2 gal and > 50,000 Btu/h	UEF = 0.81
	Electric Storage Water Heater	≥20 gal and ≤55 gal	UEF = 0.9349 – 0.0001 × V_r
		>55 gal and ≤120 gal	UEF = 2.2418−0.0011 × Vr
		> 120 gal	EF = 0.9300−0.00132 × Vr
Residential-duty Commercial	High Capacity Storage Gas-Fired Storage Water Heaters > 75,000 Btu/h	≤120 gallon tanks	UEF = 0.6597 – (0.0009 * Vr
Commercial	Gas Storage	Any	80% E_t
	Gas Instantaneous	Any	80% E_t
	Electric Storage	Any	2.18 COP

[156] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.

[157] ENERGY STAR Program Requirements for Product Specification for Residential Water Heaters, v5.0, effective April 18, 2023. ENERGY STAR Program Requirements Product Specification for Commercial Water Heaters, v2.0, effective October 1, 2018.

[158] Minimum performance rating assumes a high usage draw pattern of 84 gallons per day. A typical dairy in Illinois is estimated to use 131.7 gallons of hot water per day. Please see '4.1.10 Dairy Refrigeration Heat Recovery' for the derivation of the hot water heated on an average dairy farm. Note that minimum performance requirements for residential water heaters toggle between EF and UEF depending on size category based on 'Code of Federal Regulations, federal standards for residential water

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years for storage units, 20 years for tankless water heaters.[159]

DEEMED MEASURE COST

The full install cost and incremental cost assumptions are provided below.[160] Actual costs should be used where available:

Equipment Type	Category	Installed Cost	Incremental Cost
Gas Storage Water Heaters ≥ 75,000 Btu/hr, ≤55 gallons	Baseline	$616	N/A
	Efficient	$1,055	$440
Gas Storage Water Heaters > 75,000 Btuh/h	80% E_t	$4,886	N/A
	83% E_t	$5,106	$220
	84% E_t	$5,299	$413
	85% E_t	$5,415	$529
	86% E_t	$5,532	$646
	87% E_t	$5,648	$762
	88% E_t	$5,765	$879
	89% E_t	$5,882	$996
	90% E_t	$6,021	$1,135
Electric Storage Water Heaters	50 gallons		$1,050
	80 gallons		$1,050
	100 gallons		$1,950

LOADSHAPE

For electric hot water heaters, use Loadshape C02 – Commercial Electric DHW.

COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.925.[161]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Electric energy savings are calculated for electric water heaters per the equations given below.

heaters, 10 CFR 432.32(d)'. Commercial water heaters must meet a minimum Thermal Efficiency (TE) and are subject to maximum standby loss requirements of Q/800 + 110 x $\sqrt{V_r}$ where Q is the input rating in Btu/hr per '2019 Building Energy Efficiency Standards; 5.3 Mandatory Requirements for Water Heating', California Energy Commission.

[159] Additional reference stating >20 years from the US DOE Energy Savers for Tankless or Demand-Type Water Heaters, and 15 years from the 'New York Standard Approach for Estimating Energy Savings from Energy Efficiency Programs', v8.0, effective January 1, 2021.

[160] From the 2010-2012 WO017 Ex Ante Measure Cost Study Final Report from the California Public Utilities Commission Table 3-12.

[161] Coincidence factor based on the average wattage in peak period divided by the maximum wattage from Itron eShape data for Missouri, calibrated to Illinois loads.

$$\Delta kWh = \frac{(T_{OUT} - T_{IN}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{elecbase}} - \frac{1}{UEF_{Eff}}\right)}{3412}$$

Where:

T_{OUT} = Tank Temperature

= 170°F [162]

T_{IN} = Incoming water temperature from well or municipal system or other[163]

= Take measurement if possible, otherwise use the following assumptions.

= 52.3°F, average well water temperature if no Dairy Refrigeration Heat Recovery system installed

= 120°F, if Dairy Refrigeration Heat Recovery system is operational

= 86°F, if unknown[164]

$HotWaterUse_{Gallon}$ = Estimated annual hot water consumption (gallons)

= Actual if possible to provide reasonable custom estimate. If not, use the following formula:

= GPD * 365

GPD = average gallons of hot water usage per day (=1.30 gallons per cow per day[165]) * Number of Milking Cows being served by the water heater

γWater = Density of Water (lb/gal)

= 8.33 lbs/gal

1 = Specific Heat of Water (Btu/lb°F)

$UEF_{elecbase}$ = Rated efficiency of baseline water heater expressed as Uniform Energy Factor (UEF)

UEF_{eff} = Rated efficiency of the efficient water heater expressed as Uniform Energy Factor (UEF)

= Actual per ENERGY STAR certified equipment product list

3412 = Converts Btu to kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{Hours} * CF$$

Where:

[162] Water heating temperature for dairy farms: The cycle for cleaning needs 170 °F to start and cannot drop below 120°F by the end of the wash cycle. 'Hot Water for Dairy Farms', PHCP Pros, Harvey Ramer, May 11, 2017

[163] Expected temperature a refrigeration heat recovery unit can pre-heat well water up to. For more detail, please see: '4.1.10 Dairy Refrigeration Heat Recovery.'

[164] Average value assuming 50% of farms have Dairy Refrigeration Heat Recovery system

[165] '4.1.10 Dairy Refrigeration Heat Recovery' details average default values for hot water use and number of milking cows if unknown. The 1.30 gallons of hot water per day is calculated from (131.7 GPD/101 cows). This value is corroborated by milking system washing hot water consumption of 5L per cow (1.32 gallons per cow) per Shortall J. et al. and supported by data from NYSERDA Dairy Farm Audit Summary, in which 10 dairy farms averaged of 1.40 gallons of hot water per cow per day based on measured electric water heater energy consumption and assumed 98% efficiency.

Hours = Full load hours of water heater[166]

= 6,461

CF = Summer Peak Coincidence Factor for measure

= 0.925[167]

For example, a residential ENERGY STAR water heater of 100 gallons rated capacity and UEF of 3.5 will be serving hot water to 101 cows milked daily. The farm does not currently have any dairy refrigeration heat recovery system so they are directly getting the water from a well and heating it to 170°F to clean the milking equipment.

$$\Delta kWh = \frac{(T_{OUT} - T_{IN}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{elecbase}} - \frac{1}{UEF_{Eff}}\right)}{3{,}412}$$

$$\Delta kWh = \frac{(170\,°\text{F} - 52.3\,°\text{F}) * 101\ cows * \frac{1.30\frac{gal}{cow}}{day} * 8.33\frac{lb}{gal} * 1\frac{Btu}{lb°F} * \left(\frac{1}{(2.2418 - 0.0011 \times 100)} - \frac{1}{3.5}\right)}{3{,}412\frac{Btu}{kWh}} * 365\frac{days}{yr}$$

$$= 2{,}527\ kWh$$

For Demand Saving:

$$\Delta kW = \frac{\Delta kWh}{Hours} * CF$$

$$\Delta kW = \frac{2{,}527}{6{,}461} * 0.925 = 0.36\ kW$$

FOSSIL FUEL SAVINGS

Natural gas energy savings are calculated for natural gas storage water heaters per the equations given below.

$$\Delta Therms = \frac{(T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{gasbase}} - \frac{1}{UEF_{Eff}}\right)}{100{,}000}$$

Where:

100,000 = Converts Btu to Therms

[166] Full load hours assumption based on Wh/Max W Ratio from Itron eShape data for Missouri, calibrated to Illinois loads.
[167] Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.

$UEF_{gasbase}$ = Rated efficiency of baseline water heater (Expressed as Uniform Energy Factor (UEF).

For example, a 150,000 Btu/h gas storage water heater of 100 gallons rated volume and UEF of 0.9 delivers hot water for 101 cows milked daily. The farm has a dairy refrigeration heat recovery system that supplies 120 °F water to the heater. The farm uses 170°F hot water for milking equipment cleaning.

$$\Delta Therms = \frac{(T_{OUT} - T_{IN}) \times HotWaterUse_{Gallon} \times \gamma Water \times 1 \times \left(\frac{1}{UEF_{gasbase}} - \frac{1}{UEF_{Eff}}\right)}{100{,}000 \frac{Btu}{therm}}$$

$$(170 - 120)°\text{F} \times 101\ cows \times \frac{1.30 \frac{gal}{cow}}{day} \times 365 \frac{days}{yr} \times 8.33 \frac{lb}{gal}$$

$$\Delta Therms = \frac{\times 1 \frac{Btu}{lb°\text{F}} \times \left(\frac{1}{0.8072 - 0.0003 \times 100} - \frac{1}{0.9}\right)}{100{,}000 \frac{Btu}{Therm}} \times 365 \frac{Days}{yr}$$

$$\Delta Therms = 35\ Therms$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-ESWH-V06-270101

REVIEW DEADLINE: 1/1/2028

4.1.20 Commercial Electric Lawn Mower

DESCRIPTION

This measure identifies the claimed savings associated with commercial lawn mower electrification. This measure was developed to be applicable to the following program types: TOS.

Time of Sale (TOS):

- The use of all-electric equipment in place of a device with a spark-ignition gasoline-powered engine.
- Note that the baseline in this case is an equivalent replacement system to that which exists currently in the business.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is an all-electric lawn mower sized to be equivalent to the baseline gasoline-powered mower.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a new gasoline-powered lawn mower.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life varies based on the equipment type (displayed in the table below).

Equipment Type	Measure Life (years)[168]
Riding Lawn Mower	10
Push Lawn Mower	10

DEEMED MEASURE COST

For Time of Sale (TOS) the incremental cost should be used. Actual costs can also be used although care should be taken as costs can vary significantly. Defaults are provided below.

Equipment Type	Incremental Cost[169]
Riding Lawn Mower	$21,373
Push Lawn Mower	$500

LOADSHAPE

Loadshape C03 – Commercial Cooling[170]

COINCIDENCE FACTOR

The summer Peak Coincidence Factor is assumed to be 91.3%.[171]

[168] Conservative estimate given lack of definitive source. Useful life for commercial gasoline-powered mowers is 5 years, per CARB (2022). CCI Emission Factor Database, "Fuel-Specific GHG" worksheet, available at cci_emissionfactordatabase_2022-11-30.xlsx (live.com). Electric mowers may last significantly longer. Manufacturers estimate 3,000-5,000 hours for electric mowers, according to The Electric Advantage - MEAN GREEN MOWERS (meangreenproducts.com), which equates to more than 10 years at 246 hours per year.

[169] Vermont Act 56 Tier III Technical Advisory Group 2021 ANNUAL REPORT

[170] Commercial cooling loadshape is used as an estimate of likely usage pattern for electric lawn equipment. This methodology is used in other jurisdictions offering electric lawn care equipment savings.

[171] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

Fuel switch measure (baseline is gas equipment):

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

$$\Delta\text{SiteEnergySavings (MMBtu)} = [GasConsumptionReplaced] - [ElectricConsumptionAdded]$$

$$= [Fuel_{baseline} * 120{,}238/1{,}000{,}000] - [Fuel_{baseline} * ED_{gasoline} / (ED_{electricity} * EER_{G\rightarrow E}) * 3{,}412/1{,}000{,}000]$$

$$\text{Fuel}_{\text{baseline}} = (BSFC_{baseline} * hp_{baseline} * LF_{baseline} * Hours) / (Fuel\ Density_{gasoline})$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:

$\text{BSFC}_{\text{baseline}}$ = Brake Specific Fuel (Gasoline) Consumption Factor (lbs/hp-hr)

= If unknown, use default values in the table below

$\text{hp}_{\text{baseline}}$ = Horsepower of the lawn mower

= If unknown, use default values in the table below

$\text{LF}_{\text{baseline}}$ = The load factor is the average operational level of an engine as a fraction or percentage of the engine manufacturer's maximum rated horsepower. Load factor is diffcicult to characterize since it is a strong function of the equipment use and operation. Load factors for various equipment types are presented in the table below.

Hours = Annual operating hours of the lawn mower.

= Values for various equipment types are presented in the table below.

$\text{Fuel Density}_{\text{gasoline}}$ = Gasoline fuel density (assume 6.15 lbs/gal)[172]

$\text{ED}_{\text{gasoline}}$ = Energy density of gasoline (assume 115.83 MJ/gal)[172]

$\text{ED}_{\text{electricity}}$ = Energy density of electricity = 3.6 MJ/kWh

$EER_{G \to E}$ = Energy Economy Ratio = 3.4 (for switching from gasoline to electricity)[173]

120,238 = Btu content in one gallon of finished gasoline[174]

1,000,000 = Btu to MMBtu conversion

Equipment Type	$\text{BSFC}_{\text{baseline}}$ (lbs/hp-hr)[186]	$\text{hp}_{\text{baseline}}$[186]	$\text{LF}_{\text{baseline}}$[175]	Hours (hrs/year)	ΔkWh	ΔMMBtu	Site Energy Savings (MMBtu)
Riding Lawn Mower	0.775	21.4	38%	246	-2386	30.3	22.2
Push Lawn Mower	0.789	3.9	33%	161.6	-253	3.2	2.3

For example, using the default assumptions on the application of a riding lawn mower:

$\text{Fuel}_{\text{baseline}}$ = (0.775 * 21.4 * 0.38 * 246) / 6.15

= 252.09

SiteEnergySavings (MMBtu) = (252.09 * 120,238/1,000,000) - (252.09 * 115.83/(3.6 * 3.4) * 3,412 /1,000,000)

= 22.2 MMBtu

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = -1 * \text{kW}_{\text{battery draw}} * \text{CF}$$

Where:

$\text{kW}_{\text{battery draw}}$ = The electric draw by the battery during charging. This varies based on the battery and charger specifications. If unknown use values in the table below.

Equipment Type	$\text{kW}_{\text{battery draw}}$
Riding Lawn Mower	1.12[176]

[172] CARB (2022). CCI Emission Factor Database, "Fuel-Specific GHG" worksheet, available at cci_emissionfactordatabase_2022-11-30.xlsx (live.com).

[173] Energy Economy Ratio (EER) dimensionless value that represents the efficiency of a fuel as used in a powertrain as compared to a reference fuel used in the same powertrain. Source: CARB (2018), Low Carbon Fuel Standard Regulations: Table 5. EER Values for Fuels Used in Light- and Medium- Duty, and Heavy-Duty Applications. RESO 18-34 LCFS Attachment A Final Reg Order (ca.gov)

[174] Energy conversion calculators - U.S. Energy Information Administration (EIA)

[175] Conservative estimate given lack of definitive source. Useful life for commercial gasoline-powered mowers is 5 years, per CARB (2022). CCI Emission Factor Database, "Fuel-Specific GHG" worksheet, available at cci_emissionfactordatabase_2022-11-30.xlsx (live.com). Electric mowers may last significantly longer. Manufacturers estimate 3,000-5,000 hours for electric mowers, according to The Electric Advantage - MEAN GREEN MOWERS (meangreenproducts.com), which equates to more than 10 years at 246 hours per year.

[176] Vermont Act 56 Tier III Technical Advisory Group 2021 ANNUAL REPORT

Equipment Type	$kW_{battery\ draw}$
Push Lawn Mower	0.42[177]

CF = Summer Peak Coincidence Factor

= 91.3%[178]

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Replacement battery costs should be accounted for if likely to be required within the 10 year measure life.

MEASURE CODE: CI-AGE-CELM-V02-250101

REVIEW DEADLINE: 1/1/2028

[177] Massachusetts Residential Baseline Study, Guidehouse, 2020

[178] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

4.1.21 Indoor Agriculture Dehumidifier

DESCRIPTION

Packaged stand-alone dehumidifiers have become common in indoor agriculture facilities and are used to maintain desirable growing conditions. Dehumidifiers help maintain optimal humidity levels while reducing energy costs.

This measure reduces the demand on air conditioning or other cooling systems, resulting in energy savings. This measure is designed for the installation of packaged stand-alone dehumidifiers for use in indoor agricultural facilities. The savings and costs for this measure are evaluated with the replacement of an existing packaged stand-alone dehumidifier or new construction. Residential and commercial buildings are not eligible.

This measure was developed to be applicable to the following program types: TOS, EREP, and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the installed dehumidification equipment must meet or exceed 3.0 L/kWh. The efficient equipment is to be rated at 80 degrees F dry bulb temperature and 60% relative humidity.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an installed, stand-alone, non-portable dehumidifier that meets an efficiency of 2.1 liters/kWh at a rated condition of 80 F and 60% relative humidity for projects replacing existing equipment or 2.9 liters/kWh at a rated condition of 80 F and 60% relative humidity for new construction projects. The deemed standard efficiency value is based on manufacturer performance information as found during a December 2021 survey of packaged commercial and industrial dehumidifiers. The deemed high efficiency value is based on manufacturer performance information as found during a December 2021 survey of packaged commercial and industrial dehumidifiers.[179]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[180]

DEEMED MEASURE COST

The average incremental cost per capacity (pints per day) is $7.35.[181]

LOADSHAPE

Loadshape C65 – Non-Residential Indoor Agriculture Vegetative Room

Loadshape C66 – Non-Residential Indoor Agriculture Flowering Room

COINCIDENCE FACTOR

The coincidence factor is assumed to be 1 since the dehumidification will always be running during peak periods.[182]

[179] Maine Technical Reference Manual, Commercial TRM v2024.3, section: Prescriptive Agricultural: Stand Alone Dehumidifiers for Indoor Cannabis Cultivation
[180] Pennsylvania Technical Reference Manual, Rev Date: June 2015, section: 2.4.8 ENERGY STAR DEHUMIDIFIERS
[181] Colorado Technical Reference Manual, 2024-2026 DEMAND-SIDE MANAGEMENT & BENEFICIAL ELECTRIFICATION PLAN, section 12.14 Indoor Agriculture Dehumidification
[182] Colorado Technical Reference Manual, 2024-2026 DEMAND-SIDE MANAGEMENT & BENEFICIAL ELECTRIFICATION PLAN, section 12.14 Indoor Agriculture Dehumidification

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \text{Capacity} * 0.473 * \text{Hours} * \text{DC} * \left(\frac{1}{\text{Eff}_{\text{Base}}} - \frac{1}{\text{Eff}_{\text{Proposed}}}\right) * \frac{1}{24}$$

Where:

Capacity	= Water removal capacity of the equipment in pints/day rated at 80F and 60% RH
	= Actual installed
0.473	= Constant to convert Pints to Liters
Hours	= Run hours per year
	= 8760 hours
DC	= Duty cycle of the dehumidifier, representing the percentage of time the dehumidifier is actively running
	= 77%[183]
Eff_{Base}	= Actual or 2.1 L/kWh for projects replacing existing equipment or 2.9 L/kWh for new construction. If unknown, assume 2.9 L/kWh.
$\text{Eff}_{\text{Proposed}}$	= Actual energy Factor (L/kWh) of the new high efficiency unit rated at 80F and 60% RH. If unknown, assume 3.0 L/kWh.
24	= Constant to convert Liters/day to Liters/hour.

Existing Equipment:
For example, for the installation of a dehumidifier with 746 Pints/Day water removal at 80F and 60% RH and an Energy Factor of 3.5 L/kWh at 80F and 60% RH that is replacing an existing dehumidifier:

$$\Delta\text{kWh} = 746 * 0.473 * 8760 * 0.77 * \left(\frac{1}{2.1} - \frac{1}{3.5}\right) * \frac{1}{24}$$

$$\Delta\text{kWh} = 18{,}890 \text{ kWh}$$

New Construction:
For example, for the installation of a dehumidifier with 746 Pints/Day water removal at 80F and 60% RH and an Energy Factor of 3.5 L/kWh at 80F and 60% RH that is not replacing an existing dehumidifier:

$$\Delta\text{kWh} = 746 * 0.473 * 8760 * 0.77 * \left(\frac{1}{2.9} - \frac{1}{3.5}\right) * \frac{1}{24}$$

$$\Delta\text{kWh} = 5{,}852 \text{ kWh}$$

[183] Energy Trust of Oregon, Measure Approval Document for Indoor Ag Dehumidifiers, November 9, 2023

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \frac{\text{kWh}}{\text{Hours}} * \text{CF}$$

Where:

CF = 1.0

For example, for the installation of a dehumidifier with 746 Pints/Day water removal at 80F and 60% RH and an Energy Factor of 3.5 L/kWh at 80F and 60% RH that is replacing an existing dehumidifier:

$$\Delta\text{kW} = \frac{18{,}969.6}{8760} * 1.0$$

$$\Delta\text{kW} = 2.165 \text{ kW}$$

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-AGE-DEHU-V01-260101

REVIEW DEADLINE: 1/1/2029

4.2. Food Service End Use

4.2.1 Combination Oven

DESCRIPTION

This measure applies to both natural gas fired and electric high efficiency combination convection and steam ovens installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the installed equipment must be a new natural gas or electric combination oven meeting the ENERGY STAR idle rate and cooking efficiency requirements as specified below.[184]

ENERGY STAR[185] Requirements (Version 3.0, Effective January 12, 2023)

Fuel Type	Operation	Idle Rate (Btu/h for Gas, kW for Electric)	Cooking-Energy Efficiency, (%)
Natural Gas (5-40 Pan Capacity)	Steam Mode Convection Mode	≤ 200P+6,511 ≤ 140P+3,800	≥ 41 ≥ 57
Electric (5-40 Pan Capacity)	Steam Mode Convection Mode	≤ 0.133P+0.6400 ≤ 0.083P+0.35	≥ 55 ≥ 78
Electric (3-4 Pan Capacity)	Steam Mode Convection Mode	≤ 0.60P ≤ 0.05P+0.55	≥ 51 ≥ 70

Note: P = Pan capacity as defined in Section 1.Y, of the Commercial Ovens Program Requirements Version 3.0[186]

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a natural gas or electric combination oven that is not ENERGY STAR certified.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[187]

DEEMED MEASURE COST

The costs vary based on the efficiency and make of the equipment. Actual costs should be used. Otherwise[188]:

Oven Type & Capacity	Baseline Cost	Efficient Cost	Incremental Measure Cost
Electric < 15 Pan Capacity	$13,919	$16,189	$2,269
Electric 15 – 30 Pan Capacity	$18,966	$21,247	$2,281
Electric > 30 Pan Capacity	$30,827	$34,625	$3,798
Gas < 15 Pan Capacity	$15,406	$19,338	$3,932
Gas 15 – 30 Pan Capacity	$20,292	$24,509	$4,217
Gas > 30 Pan Capacity	$32,508	$38,337	$5,829

[184] ENERGY STAR Commercial Ovens Key Product Criteria, version 3.0, effective January 12, 2023
[185] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[186] Ibid. Pan capacity is defined as the number of steam table pans the combination oven is able to accommodate as per the ASTM F-1495-05 standard specification.
[187] The measure life is sourced from the Food Service Technology Center's energy savings calculator for combination ovens.
[188] Costs are sourced from Food Service Technology Center 2016 'Combi_2016_Prices_Updated' which is also used in the ENERGY STAR Commercial Foodservice Savings Calculator, published March, 2021.

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is assumed to be 0.90.[189]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS[190]

Non-Fuel Switch Measures

The algorithm below applies to electric combination ovens only.

$$\Delta kWh = (\Delta CookingEnergy_{ConvElec} + \Delta CookingEnergy_{SteamElec} + \Delta IdleEnergy_{ConvElec} + \Delta IdleEnergy_{SteamElec} + \Delta PreHeatEnergy_{Elec}) * Days / 1{,}000$$

The algorithm below applies to natural gas combination ovens only.

$$\Delta Therms = (\Delta CookingEnergy_{ConvGas} + \Delta CookingEnergy_{SteamGas} + \Delta IdleEnergy_{ConvGas} + \Delta IdleEnergy_{SteamGas} + \Delta PreHeatEnergy_{Gas}) * Days / 100{,}000$$

Fuel Switch/Electrification Measures

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

$$SiteEnergySavings\ (MMBTUs) = [GasConsumptionReplaced] - [ElectricConsumptionAdded]$$

$$= [(CookingEnergy_{ConvGasBase} + CookingEnergy_{SteamGasBase} + IdleEnergy_{ConvGasBase} + IdleEnergy_{SteamGasBase} + PreHeatEnergy_{BaseGas}) * Days / 1{,}000{,}000] -$$

$$[(CookingEnergy_{ConvElecEE} + CookingEnergy_{SteamElecEE} + IdleEnergy_{ConvElecEE} + IdleEnergySteam_{ElecEE} + PreHeatEnergy_{EEElec}) * Days * 3.412 / 1{,}000{,}000]$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A

[189] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

[190] Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, updated March 2021.

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:

$\Delta CookingEnergy_{ConvElec}$ = Change in total daily cooking energy consumed by electric oven in convection mode

$=LB_{Elec} * (EFOOD_{ConvElec} / ElecEFF_{ConvBase} - EFOOD_{ConvElec} / ElecEFF_{ConvEE}) * \%_{Conv}$

$\Delta CookingEnergy_{SteamElec}$ = Change in total daily cooking energy consumed by electric oven in steam mode

$=LB_{Elec} * (EFOOD_{SteamElec} / ElecEFF_{SteamBase} - EFOOD_{SteamElec} / ElecEFF_{SteamEE}) * \%_{Steam}$

$\Delta IdleEnergy_{ConvElec}$ = Change in total daily idle energy consumed by electric oven in convection mode

$=[(ElecIDLE_{ConvBase} * ((HOURS - LB_{Elec}/ElecPC_{ConvBase}) * \%_{Conv})) - (ElecIDLE_{ConvEE} * ((HOURS - LB_{Elec}/ElecPC_{ConvEE}) * \%_{Conv}))]$

$\Delta IdleEnergy_{SteamElec}$ = Change in total daily idle energy consumed by electric oven in steam mode

$=[(ElecIDLE_{SteamBase} * ((HOURS - LB_{Elec}/ElecPC_{SteamBase}) * \%_{Steam})) - (ElecIDLE_{SteamEE} * ((HOURS - LB_{Elec}/ElecPC_{SteamEE}) * \%_{Steam}))]$

$\Delta PreHeatEnergy_{Elec}$ = Change in total daily energy consumed by electric oven to preheat

$= Preheat_{BaseElec} - Preheat_{EEElec}$

$\Delta CookingEnergy_{ConvGas}$ = Change in total daily cooking energy consumed by gas oven in convection mode

$=LB_{Gas} * (EFOOD_{ConvGas} / GasEFF_{ConvBase} - EFOOD_{ConvGas} / GasEFF_{ConvEE}) * \%_{Conv}$

$\Delta CookingEnergy_{SteamGas}$ = Change in total daily cooking energy consumed by gas oven in steam mode

$=LB_{Gas} * (EFOOD_{SteamGas} / GasEFF_{SteamBase} - EFOOD_{SteamGas} / GasEFF_{SteamEE}) * \%_{Steam}$

$\Delta IdleEnergy_{ConvGas}$ = Change in total daily idle energy consumed by gas oven in convection mode

$=[(GasIDLE_{ConvBase} * ((HOURS - LB_{Gas}/GasPC_{ConvBase}) * \%_{Conv})) - (GasIDLE_{ConvEE} * ((HOURS - LB_{Gas}/GasPC_{ConvEE}) * \%_{Conv}))]$

$\Delta IdleEnergy_{SteamGas}$ = Change in total daily idle energy consumed by gas oven in steam mode

$=[(GasIDLE_{SteamBase} * ((HOURS - LB_{Gas}/GasPC_{SteamBase}) * \%_{Steam})) - (GasIDLE_{SteamEE} * ((HOURS - LB_{Gas}/GasPC_{SteamEE}) * \%_{Steam}))]$

ΔPreHeatEnergy$_{Gas}$ = Change in total daily energy consumed by gas oven to preheat

$= Preheat_{BaseGas} - Preheat_{EEGas}$

CookingEnergy$_{ConvElecEE}$ = Total daily cooking energy consumed by new ENERGY STAR electric oven in convection mode (for fuel switch measure)

$=LB_{Elec} * (EFOOD_{ConvElec} / ElecEFF_{ConvEE}) * \%_{Conv}$

CookingEnergy$_{SteamElecEE}$ = Total daily cooking energy consumed by new ENERGY STAR electric oven in steam mode (for fuel switch measure)

$=LB_{Elec} * (EFOOD_{SteamElec} / ElecEFF_{SteamEE}) * \%_{Steam}$

IdleEnergy$_{ConvElecEE}$ = Total daily idle energy consumed by new ENERGY STAR electric oven in convection mode (for fuel switch measure)

$=(ElecIDLE_{ConvEE} * ((HOURS - LB_{Elec}/ElecPC_{ConvEE}) * \%_{Conv}))$

IdleEnergy$_{SteamElecEE}$ = Total daily idle energy consumed by new ENERGY STAR electric oven in convection mode (for fuel switch measure)

$=(ElecIDLE_{SteamEE} * ((HOURS - LB_{Elec}/ElecPC_{SteamEE}) * \%_{Steam}))$

CookingEnergy$_{ConvGasBase}$ = Total daily cooking energy consumed by baseline gas oven in convection mode (for fuel switch measure)

$=LB_{Gas} * (EFOOD_{ConvGas} / GasEFF_{ConvBase}) * \%_{Conv}$

CookingEnergy$_{SteamGasBase}$ = Total daily cooking energy consumed by baseline gas oven in steam mode (for fuel switch measure)

$=LB_{Gas} * (EFOOD_{SteamGas} / GasEFF_{SteamBase}) * \%_{Steam}$

IdleEnergy$_{ConvGasBase}$ = Total daily idle energy consumed by baseline gas oven in convection mode (for fuel switch measure)

$=(GasIDLE_{ConvBase} * ((HOURS - LB_{Gas}/GasPC_{ConvBase}) * \%_{Conv}))$

IdleEnergy$_{SteamGasBase}$ = Total daily idle energy consumed by baseline gas oven in convection mode(for fuel switch measure)

$=[(GasIDLE_{SteamBase} * ((HOURS - LB_{Gas}/GasPC_{SteamBase}) * \%_{Steam}))$

Where:

LB_{Elec} = Estimated mass of food cooked per day for electric oven (lbs/day)

= Custom, or if unknown, use 200 lbs (If P <15) or 250 lbs (If P >= 15)

$EFOOD_{ConvElec}$ = Energy absorbed by food product for electric oven in convection mode

= Custom or if unknown, use 73.2 Wh/lb

ElecEFF = Cooking energy efficiency of electric oven

= Custom or if unknown, use values from table below

	Base	EE
$ElecEFF_{Conv}$	72%	78%
$ElecEFF_{Steam}$	52%	55%

$\%_{Conv}$ = Percentage of time in convection mode

= Custom or if unknown, use 50%

$EFOOD_{SteamElec}$ = Energy absorbed by food product for electric oven in steam mode

= Custom or if unknown, use 30.8 Wh/lb

$\%_{steam}$ = Percentage of time in steam mode

= 1 - $\%_{conv}$

$ElecIDLE_{Base}$ = Idle energy rate (W) of baseline electric oven

= Custom or if unknown, use values from table below

Pan Capacity	Convection Mode ($ElecIDLE_{ConvBase}$)	Steam Mode ($ElecIDLE_{SteamBase}$)
< 15	1,754	5,260
> = 15 to <30	2,966	8,866
>= 30	4,418	11,875

HOURS = Average daily hours of operation

= Custom or if unknown, use 12 hours

$ElecPC_{Base}$ = Production capacity (lbs/hr) of baseline electric oven

= Custom of if unknown, use values from table below

Pan Capacity	Convection Mode ($ElecPC_{ConvBase}$)	Steam Mode ($ElecPC_{SteamBase}$)
< 15	79	126
> = 15	166	295

$ElecIDLE_{ConvEE}$ = Idle energy rate of ENERGY STAR electric oven in convection mode

= Custom or if unknown, use default below:

= (0.083*P +0.350) * 1000 for 5-40 Pan Capacity

= (0.05*P +0.55) * 1000 for 3-4 Pan Capacity

$ElecPC_{EE}$ = Production capacity (lbs/hr) of ENERGY STAR electric oven

= Custom of if unknown, use values from table below

Pan Capacity	Convection Mode ($ElecPC_{ConvEE}$)	Steam Mode ($ElecPC_{SteamEE}$)
< 15	119	177
> = 15	201	349

$ElecIDLE_{SteamEE}$ = Idle energy rate of ENERGY STAR electric oven in steam mode

= Custom or if unknown, use default below:

= (0.133 * P+0.64) * 1000 for 5-40 Pan Capacity

= (0.60 * P) * 1000 for 3-4 Pan Capacity

$Preheat_{BaseElec}$ = Total preheat energy consumption per day of baseline electric unit (Wh)

= Custom or if unknown, use default below:

Pan Capacity	$Preheat_{BaseElec}$
< 15	1,635
> = 15	3,146

$Preheat_{EEElec}$ = Total preheat energy consumption per day of ENERGY STAR electric unit (Wh)

Pan Capacity	$Preheat_{EEElec}$
< 15	997
> = 15	1,633

Days = Days of operation per year

= Custom or if unknown, use 365 days per year

1,000 = Wh to kWh conversion factor

LB_{Gas} = Estimated mass of food cooked per day for gas oven (lbs/day)

= Custom, or if unknown, use 200 lbs (If P <15), 250 lbs (If 15 <= P 30), or 400 lbs (If P = >30)

$EFOOD_{ConvGas}$ = Energy absorbed by food product for gas oven in convection mode

= Custom or if unknown, use 250 Btu/lb

GasEFF = Cooking energy efficiency of gas oven

= Custom or if unknown, use values from table below

	Base	EE
$GasEFF_{Conv}$	49%	57%
$GasEFF_{Steam}$	37%	41%

$EFOOD_{SteamGas}$ = Energy absorbed by food product for gas oven in steam mode

= Custom or if unknown, use 105 Btu/lb

$GasIDLE_{Base}$ = Idle energy rate (Btu/hr) of baseline gas oven

= Custom or if unknown, use values from table below

Pan Capacity	Convection Mode ($GasIDLE_{ConvBase}$)	Steam Mode ($GasIDLE_{SteamBase}$)
< 15	9,840	24,003
15-30	11,734	27,795
>30	15,376	27,957

$GasPC_{Base}$ = Production capacity (lbs/hr) of baseline gas oven

= Custom of if unknown, use values from table below

Pan Capacity	Convection Mode ($GasPC_{ConvBase}$)	Steam Mode ($GasPC_{SteamBase}$)
< 15	125	195
15-30	176	211
>30	392	579

$GasIDLE_{ConvEE}$ = Idle energy rate of ENERGY STAR gas oven in convection mode

= Custom or if unknown, use default below:

= 140*P + 3,800

$GasPC_{EE}$ = Production capacity (lbs/hr) of ENERGY STAR gas oven

= Custom of if unknown, use values from table below

Pan Capacity	Convection Mode ($GasPC_{ConvEE}$)	Steam Mode ($GasPC_{SteamEE}$)
< 15	124	172
15-30	210	277
>30	394	640

$GasIDLE_{SteamEE}$ = Idle energy rate of ENERGY STAR gas oven in steam mode

= Custom or if unknown, use default below:

= 200 * P +6511

$Preheat_{BaseGas}$ = Total preheat energy consumption per day of baseline gas unit (BTU)

= Custom or if unknown, use default below:

Pan Capacity	$Preheat_{BaseGas}$
< 15	10,964
> = 15	15,844

$Preheat_{EEGas}$ = Total preheat energy consumption per day of ENERGY STAR gas unit (BTU)

= Custom or if unknown, use default below:

Pan Capacity	$Preheat_{EEGas}$
< 15	4,467
> = 15	10,638

100,000 = Conversion factor from Btu to therms

3.412 = Conversion factor from Wh to Btu

1,000,000 = Conversion factor from Btu to MMBtu

For example, a 10-pan capacity ENERGY STAR electric combination oven in place of a baseline electric oven would save:

ΔkWh =($\Delta CookingEnergy_{ConvElec} + \Delta CookingEnergy_{SteamElec} + \Delta IdleEnergy_{ConvElec} + \Delta IdleEnergy_{SteamElec} + \Delta PreHeatEnergy_{Elec}) * Days / 1{,}000$

ΔCookingEnergy$_{ConvElec}$ = 200 * (73.2 / 0.72 – 73.2 / 0.78) * 0.50

= 782 Wh

ΔCookingEnergy$_{SteamElec}$ = 200 * (30.8 / 0.52 – 30.8 / 0.55) * (1 – 0.50)

= 323 Wh

ΔIdleEnergy$_{ConvElec}$ = [(1,754 * ((12 – 200/79) * 0.50)) - (1,180 *((12 - 200/119) * 0.50))]

= 2,215 Wh

ΔIdleEnergy$_{SteamElec}$ = [(5,260 * ((12 – 200/126) * (1 – 0.50))) - (1,970 * ((12 - 200/177) * (1 – 0.50)))]

= 16,678 Wh

ΔPreHeatEnergy$_{Elec}$ = 1,635 – 997

= 638 Wh

ΔkWh = (782 + 323 + 2215 + 16,678 + 638) * 365 /1,000

= 7,532 kWh

For example, an ENERGY STAR 10-pan capacity electric combination oven in place of a baseline gas combination oven would save:

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricConsumptionAdded]$

$$=[(CookingEnergy_{ConvGasBase} + CookingEnergy_{SteamGasBase} + IdleEnergy_{ConvGasBase} + IdleEnergy_{SteamGasBase} + PreHeatEnergy_{BaseGas}) * Days / 1{,}000{,}000] - [(CookingEnergy_{ConvElecEE} + CookingEnergy_{SteamElecEE} + IdleEnergy_{ConvElecEE} + IdleEnergy_{SteamElecEE} + PreHeatEnergy_{EEElec}) * Days * 3.412/ 1{,}000{,}000]$$

$CookingEnergy_{ConvGasBase}$ = 200 * (250 / 0.49) * 0.50
=51,020 Btu

$CookingEnergy_{SteamGasBase}$ = 200 * (105 / 0.37) * (1 – 0.50)
= 28,378 Btu

$IdleEnergy_{ConvGasBase}$ = 9,840 * ((12 – 200/125) * 0.50))
= 51,168 Btu

$IdleEnergy_{SteamGasBase}$ = 24,003 * ((12 – 200/195) * (1 – 0.50))
= 131,709 Btu

$PreHeatEnergy_{BaseGas}$ = 10,964 Btu

$CookingEnergy_{ConvElecEE}$ = 200 * (73.2 / 0.78) * 0.50
= 9,385 Wh

$CookingEnergy_{SteamElecEE}$ = 200 * (30.8 / 0.55) * (1 – 0.50)
= 5,600 Wh

$IdleEnergy_{ConvElecEE}$ = 1,180 * ((12 - 200/119) * 0.50)
= 6,088 Wh

$IdleEnergy_{SteamElecEE}$ = 1,970 * ((12 - 200/177) * (1 – 0.50)))
= 10,707 Wh

$PreHeatEnergy_{EEElec}$ = 997 Wh

SiteEnergySavings (MMBTUs) = [(51,020 + 28,378 + 51,168 + 131,709 + 10,964) * 365 /1,000,000]
– [(9,385 + 5,600 + 6,088 + 10,707 + 997) * 365 * 3.412/1,000,000]
= 58.9 MMBtu

If supported by an electric utility; ΔkWh = ΔSiteEnergySavings * 1,000,000 / 3,412
= 58.9 * 1,000,000/3,412
= 17,263 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

For non-fuel switch measures:

$$\Delta kW = ((\Delta CookingEnergy_{ConvElec} + \Delta CookingEnergy_{SteamElec} + \Delta IdleEnergy_{ConvElec} + \Delta IdleEnergy_{SteamElec} + \Delta PreHeatEnergy_{Elec}) / (1{,}000 * HOURS) * CF$$

For fuel switch measures:

$$\Delta kW = -((CookingEnergy_{ConvElecEE} + CookingEnergy_{SteamElecEE} + IdleEnergy_{ConvElecEE} + IdleEnergy_{SteamElecEE} + PreHeatEnergy_{EEElec})/(1{,}000 * HOURS) * CF$$

Where:

CF = Summer Peak Coincidence Factor for measure

= 0.90[191]

All other variables as defined above.

For example, a 10-pan capacity electric combination oven in a Full Service Limited Menu restaurant would save:

$\Delta kW = \Delta kWh / (1{,}000 * HOURS) * CF$

= (782 + 323 + 2,215 + 16,678 + 638) / (1,000 * 12) * 0.9

= 1.55 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

$\Delta Therms = [Gas\ Cooking\ Consumption\ Replaced]$

$= [(CookingEnergy_{ConvGasBase} + CookingEnergy_{SteamGasBase} + IdleEnergy_{ConvGasBase} + IdleEnergy_{SteamGasBase} + PreHeatEnergy_{BaseGas}) * Days / 100{,}000]$

$\Delta kWh = [Electric\ Cooking\ Consumption\ Added]$

$= -[(CookingEnergy_{ConvElecEE} + CookingEnergy_{SteamElecEE} + IdleEnergy_{ConvElecEE} + IdleEnergy_{SteamElecEE} + PreHeatEnergy_{EEElec}) * Days/1{,}000]$

[191] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

MEASURE CODE: CI-FSE-CBOV-V07-260101

REVIEW DEADLINE: 1/1/2028

4.2.2 Commercial Solid and Glass Door Refrigerators & Freezers

DESCRIPTION

This measure relates to the installation of a new reach-in commercial refrigerator or freezer meeting ENERGY STAR[192] efficiency standards. ENERGY STAR labeled commercial refrigerators and freezers are more energy efficient because they are designed with components such as ECM evaporator and condenser fan motors, hot gas anti-sweat heaters, or high-efficiency compressors, which will significantly reduce energy consumption.

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a new ENERGY STAR certified vertical closed solid or glass door refrigerator or freezer meeting energy consumptions requirements as determined by door type (solid or glass) and refrigerated volume (V).

ENERGY STAR Requirements (Version 5.0, Effective December 22, 2022)

Volume (ft^3)	Maximum Daily Energy Consumption (kWh/day)	
	Refrigerator	Freezer
Vertical Closed		
Solid Door		
0 < V < 15	≤ 0.0267V + 0.8	≤ 0.21V + 0.9
15 ≤ V < 30	≤ 0.05V + 0.45	≤ 0.12V + 2.248
30 ≤ V < 50	≤ 0.05V + 0.45	≤ 0.2578V -1.8864
V ≥ 50	≤ 0.025V + 1.6991	≤ 0.14V + 4.0
Glass Door		
0 < V < 15	≤ 0.095V + 0.445	≤ 0.232V + 2.36
15 ≤ V < 30	≤ 0.05V + 1.12	
30 ≤ V < 50	≤ 0.076V + 0.34	
V ≥ 50	≤ 0.105V – 1.111	

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a new vertical closed solid or glass door refrigerator or freezer that is not ENERGY STAR certified.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years. [193]

DEEMED MEASURE COST

The incremental capital cost for this measure is provided in the table below.[194]

Door Type	Volume	Refrigerator	Freezer
Solid Door	0 < V < 15	$53	$27

[192] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.

[193] 2008 Database for Energy-Efficiency Resources (DEER), Version 2008.2.05, "Effective/Remaining Useful Life Values", California Public Utilities Commission, December 16, 2008.

[194] Energy Star, 2021. ENERGY STAR Version 5.0 Commercial Refrigerators and Freezers Data Pack.xlsx. From Incremental Cost and Payback tab, an average $/sq ft value was calculated and applied to the average volumes for each refrigerator and freezer category – rounded to the nearest dollar (from product data tabs, and 2023 Energy Star QPL)

Door Type	Volume	Refrigerator	Freezer
	15 ≤ V < 30	$121	$57
	30 ≤ V < 50	$247	$119
	50 ≤ V	$401	$196
Glass Door	0 < V < 15	$51	$19
	15 ≤ V < 30	$125	$56
	30 ≤ V < 50	$252	$114
	50 ≤ V	$420	$201

LOADSHAPE

Loadshape C23 - Commercial Refrigeration

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0.937.[195]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (kWhbase - kWhee) * 365.25$$

Where:

kWhbase = baseline maximum daily energy consumption in kWh

= calculated using actual chilled or frozen compartment volume (V) of the efficient unit as shown in the table below.

Type	kWhbase[196]
Solid Door Refrigerator	0.05 * V + 1.36
Glass Door Refrigerator	0.1 * V + 0.86
Solid Door Freezer	0.22 * V + 1.38
Glass Door Freezer	0.29 * V + 2.95

kWhee[197] = efficient maximum daily energy consumption in kWh

= actual if known. If unknown can be calculated using actual chilled or frozen compartment volume (V) of the efficient unit as shown in the table below.

Volume (ft^3)	kWhee	
	Refrigerator	Freezer
Vertical Closed		
Solid Door		
0 < V < 15	≤ 0.0267V + 0.8	≤ 0.21V + 0.9
15 ≤ V < 30	≤ 0.05V + 0.45	≤ 0.12V + 2.248

[195] The CF for Commercial Refrigeration was calculated based upon the Ameren provided eShapes

[196]Federal standards for equipment manufactured on or after March 27, 2017: 10 CFR §431.66 - Energy Conservation Standards for Commercial Refrigerators, Freezers and Refrigerator-Freezers.

[197]ENERGY STAR Program Requirements for Commercial Refrigerators and Freezers Partner Commitments Version 5.0, effective December 22, 2022

Volume (ft^3)	kWhee	
	Refrigerator	Freezer
30 ≤ V < 50	≤ 0.05V + 0.45	≤ 0.2578V -1.8864
V ≥ 50	≤ 0.025V + 1.6991	≤ 0.14V + 4.0
Glass Door		
0 < V < 15	≤ 0.095V + 0.445	≤ 0.232V + 2.36
15 ≤ V < 30	≤ 0.05V + 1.12	
30 ≤ V < 50	≤ 0.076V + 0.34	
V ≥ 50	≤ 0.105V – 1.111	

V = the chilled or frozen compartment volume (ft^3) (as defined in the Association of Home Appliance Manufacturers Standard HRF1–1979)

= Actual installed

365.25 = days per year

For example, a solid door refrigerator with a volume of 15 would save

ΔkWh = (2.11 – 1.20) * 365.25

= 332 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh \; / \; HOURS \; * \; CF$

Where:

HOURS = equipment is assumed to operate continuously, 24 hours per day, 365.25 days per year.

= 8766

CF = Summer Peak Coincidence Factor for measure

= 0.937

For example, a solid door refrigerator with a volume of 15 would save

ΔkW = 332/ 8766 * .937

=0.0355 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-CSDO-V04-260101

REVIEW DEADLINE: 1/1/2028

4.2.3 Commercial Steam Cooker

DESCRIPTION

To qualify for this measure the installed equipment must be an ENERGY STAR®[198] steamer in place of a standard steamer in a commercial kitchen. Savings are presented dependent on the pan capacity and corresponding idle rate at heavy load cooking capacity and if the steamer is gas or electric.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be as follows:

Gas	Electric
ENERGY STAR® qualified with 38% minimum cooking energy efficiency at heavy load (potato) cooking capacity for gas steam cookers.	ENERGY STAR® qualified with 50% minimum cooking energy efficiency at heavy load (potato) cooking capacity for electric steam cookers.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a non-ENERGY STAR® commercial steamer at end of life. It is assumed that the efficient equipment and baseline equipment have the same number of pans.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[199]

DEEMED MEASURE COST

The incremental capital cost for this measure uses actual costs, otherwise use costs outlined below:[200]

Equipment Type	Baseline Equipment Cost	Efficient Equipment Cost	Incremental Cost
Electric	$5,444	$8,201	$2,758
Gas	$10,265	$12,324	$2,059

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building types:[201]

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36

[198] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[199]California DEER 2008 which is also used by both the Food Service Technology Center and ENERGY STAR®.
[200] Costs taken from California "SWFS005-03_Steamers_2022_Price_Updated"
[201] Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985.Unknown is an average of other location types

Location	CF
Cafeteria	0.39
Unknown	0.408

:

Algorithm

CALCULATION OF SAVINGS

Formulas below are applicable to both gas and electric steam cookers. Please use appropriate lookup values and identified flags.

ENERGY SAVINGS AND FOSSIL FUEL SAVINGS

Non-Fuel Switch Measures

The algorithm below applies to ENERGY STAR electric steam cooker compared to baseline electric steam cooker:

$$\Delta kWh = (\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy) * Days$$

The algorithm below applies to ENERGY STAR gas steam cooker compared to baseline gas steam cooker:

$$\Delta Therms = (\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy) * 1/100{,}000 * Days$$

Fuel Switch/Electrification Measures

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

$$SiteEnergySavings\ (MMBTUs) = [GasConsumptionReplaced] - [ElectricConsumptionAdded]$$

$$= [(Idle\ Energy_{GasBase} + Preheat\ Energy_{GasBase} + Cooking\ Energy_{GasBase}) * 1/1{,}000{,}000 * Days] - [(Idle\ Energy_{ElecEE} + Preheat\ Energy_{ElecEE} + Cooking\ Energy_{ElecEE}) * 3{,}412/1{,}000{,}000 * Days]$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:

ΔIdle Energy $=((((1 - CSM_{\%Baseline}) * IDLE_{BASE} + CSM_{\%Baseline} * PC_{BASE} * E_{FOOD} / EFF_{BASE}) * (HOURS_{day} - (F / PC_{Base}) - (PRE_{number} * PRE_{TimeBase} / 60))) - (((1 - CSM_{\%ENERGYSTAR}) * IDLE_{ENERGYSTAR} + CSM_{\%ENERGYSTAR} * PC_{ENERGYSTAR} * E_{FOOD} / EFF_{ENERGYSTAR}) * (HOURS_{Day} - (F\,l / PC_{ENERGYSTAR}) - (PRE_{number} * PRE_{TimeEE} / 60))))$

ΔPreheat Energy $=(PRE_{number} * (PRE_{heatEnergyBase} - PRE_{heatEnergyEE})$

ΔCooking Energy $=((1/ EFF_{BASE}) - (1/ EFF_{ENERGY\ STAR})) * F * E_{FOOD}$

Idle Energy$_{GasBase}$ $= ((((1 - CSM_{\%Baseline}) * IDLE_{BASE} + CSM_{\%Baseline} * PC_{BASE} * E_{FOOD} / EFF_{BASE}) * (HOURS_{day} - (F / PC_{Base}) - (PRE_{number} * PRE_{TimeGasBase}/60)))$

Preheat Energy$_{GasBase}$ $=(PRE_{number} * Pre_{heatEnergyGasBase})$

Cooking Energy$_{GasBase}$ $= (1/ EFFBASE) * F * E_{FOOD}$

Idle Energy$_{ElecEE}$ $=(((1 - CSM_{\%ENERGYSTAR}) * IDLE_{ENERGYSTAR} + CSM_{\%ENERGYSTAR} * PC_{ENERGY} * E_{FOOD} / EFF_{ENERGYSTAR}) * (HOURS_{Day} - (F / PC_{ENERGYSTAR}) - (PRE_{number} * PRE_{TimeElecEE}/60))))$

Preheat Energy$_{ElecEE}$ $= (PRE_{number} * Pre_{heatEnergyElecEE})$

Cooking Energy$_{ElecEE}$ $= (1/ EFF_{ENERGY\ STAR}) * F * E_{FOOD}$

Where:

CSM$_{\%Baseline}$ = Baseline Steamer Time in Manual Steam Mode (% of time)

= 90%[202]

IDLE$_{Base}$ = Idle Energy Rate of Base Steamer[203]

Number of Pans	IDLE$_{BASE}$ - Gas, Btu/hr	IDLE$_{BASE}$ - Electric, kw
3	11,000	1.0
4	14,667	1.33
5	18,333	1.67
6	22,000	2.0
10	18,000	1.2

PC$_{Base}$ = Production Capacity of Base Steamer[204]

Number of Pans	PC$_{BASE}$, gas (lbs/hr)	PC$_{BASE}$, electric (lbs/hr)
3	65	70
4	87	93
5	108	117
6	130	140
10	233	233

[202]Food Service Technology Center 2011 Savings Calculator

[203]Food Service Technology Center 2011 Savings Calculator. Estimates for units with 10 pans taken from ENERGY STAR Commercial Food Service Savings Calculator.

[204]Production capacity per Food Service Technology Center 2011 Savings Calculator of 23.3333 lb/hr per pan for electric baseline steam cookers and 21.6667 lb/hr per pan for natural gas baseline steam cookers. ENERGY STAR® savings calculator uses 23.3 lb/hr per pan for both electric and natural gas baseline steamers. Estimates for units with 10 pans taken from ENERGY STAR Commercial Food Service Savings Calculator.

E_{FOOD}= Amount of Energy Absorbed by the food during cooking known as ASTM Energy to Food (Btu/lb or kW/lb)

=105 Btu/lb (gas steamers) or 0.0308 (electric steamers) [205]

EFF_{BASE} =Heavy Load Cooking Efficiency for Base Steamer

=15% (gas steamers) or 26% (electric steamers) [206]

$HOURS_{day}$ = Average Daily Operation (hours)

Type of Food Service	$HOURS_{day}$[207]
Fast Food, limited menu	4
Fast Food, expanded menu	5
Pizza	8
Full Service, limited menu	8
Full Service, expanded menu	7
Cafeteria	6
Unknown	6[208]
Custom	Varies

F = Food cooked per day (lbs/day)

= custom or if unknown, use 100 lbs/day[209]

$CSM_{\%ENERGYSTAR}$ = ENERGY STAR Steamer's Time in Manual Steam Mode (% of time)[210]

= 0%

$IDLE_{ENERGYSTAR}$ = Idle Energy Rate of ENERGY STAR®[211]

=Actual, or

Number of Pans	$IDLE_{ENERGY\ STAR}$ – gas, (Btu/hr)	$IDLE_{ENERGY\ STAR}$ – electric, (kW)
3	6,250	0.40
4	8,333	0.53
5	10,417	0.67
6	12,500	0.80
10	12,500	0.80

[205]ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculations

[206]Reference Food Service Technology Center 2011 Savings Calculator values as used by Consortium for Energy Efficiency, Inc. for baseline electric and natural gas steamer heavy cooking load energy efficiencies.

[207] Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985.

[208]Unknown is average of other locations

[209]Reference amount used by both Food Service Technology Center and ENERGY STAR® savings calculator

[210]Reference information from the Food Service Technology Center siting that ENERGY STAR® steamers are not typically operated in constant steam mode, but rather are used in timed mode. Reference ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculation. Both baseline & efficient steamer mode values should be considered for users in Illinois market.

[211]Food Service Technology Center 2011 Savings Calculator. Estimates for units with 10 pans taken from ENERGY STAR Commercial Food Service Savings Calculator.

$PC_{ENERGYSTAR}$ = Production Capacity of ENERGY STAR® Steamer[212]

=Actual, or

Number of Pans	PC_{ENERGY} - gas(lbs/hr)	PC_{ENERGY} – electric (lbs/hr)
3	55	50
4	73	67
5	92	83
6	110	100
10	200	167

$EFF_{ENERGYSTAR}$ = Heavy Load Cooking Efficiency for ENERGY STAR® Steamer(%)

=Actual, or 38% (gas steamer) or 50% (electric steamer) [213]

PRE_{number} = Number of preheats per day

=1[214] (if unknown, use 1)

$PRE_{heatEnergyBase}$ = Energy per preheat of Base Steamer[215]

Equipment Type	Preheat Energy
Electric	1.78 kWh
Gas	18,832.7 Btu

$PRE_{heatEnergyEE}$ = Energy per preheat of ENERGY STAR Steamer[216]

Equipment Type	Preheat Energy
Electric	1.67 kWh
Gas	10,293.9 Btu

$PRE_{TimeBase}$ =Preheat duration of Base Steamer[217]

Equipment Type	Preheat Time (minutes)
Electric	11.9
Gas	10.9

PRE_{TimeEE} = Preheat duration of ENERGY STAR Steamer[218]

Equipment Type	Preheat Time (minutes)
Electric	13.2

[212]Production capacity per Food Service Technology Center 2011 Savings Calculator of 18.3333 lb/hr per pan for gas ENERGY STAR® steam cookers and 16.6667 lb/hr per pan for electric ENERGY STAR® steam cookers. ENERGY STAR® savings calculator uses 16.7 lb/hr per pan for electric and 20 lb/hr for natural gas ENERGY STAR® steamers. Estimates for units with 10 pans taken from ENERGY STAR Commercial Food Service Savings Calculator.

[213]Reference Food Service Technology Center 2011 Savings Calculator values as used by Consortium for Energy Efficiency, Inc. for Tier 1A and Tier 1B qualified electric and natural gas steamer heavy cooking load energy efficiencies, as sourced from ENERGY STAR Program Requirements Product Specification for Commercial Steam Cookers, version 1.2, effective August 1, 2013.

[214]Reference ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculations

[215] Reference ENERGY STAR Commercial Foodservice Savings Calculator, March 2021

[216] Ibid

[217] Ibid

[218] Ibid

Equipment Type	Preheat Time (minutes)
Gas	13.4

EFF_{BASE} =Heavy Load Cooking Efficiency for Base Steamer

=15% (gas steamer) or 26% (electric steamer) [219]

$EFF_{ENERGYSTAR}$ =Heavy Load Cooking Efficiency for ENERGY STAR® Steamer

=Actual, or 38% (gas steamer) or 50% (electric steamer) [220]

F = Food cooked per day (lbs/day)

= custom or if unknown, use 100 lbs/day[221]

E_{FOOD} = Amount of Energy Absorbed by the food during cooking known as ASTM Energy to Food[222]

E_{FOOD} - gas(Btu/lb)	E_{FOOD} (kWh/lb)
105[223]	0.0308[224]

Days = days/yr steamer operating (use 365.25 days/yr if heavy use restaurant and exact number unknown)

[219] Reference Food Service Technology Center 2011 Savings Calculator values as used by Consortium for Energy Efficiency, Inc. for baseline electric and natural gas steamer heavy cooking load energy efficiencies.
[220] Ibid.
[221]Amount used by both Food Service Technology Center and ENERGY STAR® savings calculator
[222]Reference ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Steam Cooker Calculations.
[223]Ibid.
[224]Ibid.

For example, for an ENERGY STAR gas steam cooker compared to baseline gas cooker: A 3 pan steamer in a full service restaurant

ΔSavings = $(\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy) * Days * 1/100{,}000$

ΔIdle Energy = $((((1 - 0.9) * 11{,}000 + 0.9 * 65 * 105\ /0.15\ ) * (7 - (100 / 65) - (1 * 10.9/60))) - (((1 - 0) * 6250 + 0 * 55 * 105\ / 0.38) * (7 - (100 / 55) - (1 * 13.4/60))))$

= 191,028 BTU/day

ΔPreheat Energy = $(1 * (18{,}832.7 - 10{,}293.9)$

= 8,539 BTU/day

ΔCooking Energy = $(((1/\ 0.15) - (1/\ 0.38)) * (100\ lb/day * 105\ btu/lb)))$

= 42,368 BTU/day

ΔTherms = $(191{,}028 + 8{,}539 + 42{,}368) * 365.25 * 1/100{,}000$

= 884 therms

For an ENERGY STAR electric steam cooker compared to baseline electric cooker: A 3 pan steamer in a cafeteria:

ΔSavings = $(\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy) * Days$

ΔIdle Energy = $((((1 - .9) * 1.0 + .9 * 70 * 0.0308\ /0.26\ ) * (6 - (100 / 70) - (1 * 11.9/60))) - (((1 - 0) * 0.4 + 0 * 50 * 0.0308\ / 0.50) * (6 - (100 / 50) - (1 * 13.2/60))))$

= 31.6 kWh/day

ΔPreheat Energy = $(1 * (1.78 - 1.67\ ))$

= 0.1 kWh/day

ΔCooking Energy = $(((1/\ 0.26) - (1/\ 0.5)) * (100 * 0.0308)))$

= 5.7 kWh/day

ΔkWh = $(31.6 + 0.1 + 5.7) * 365.25\ days$

= 13,660 kWh

For an ENERGY STAR electric steam cooker compared to baseline gas cooker: A 3 pan steamer in a cafeteria:

SiteEnergySavings (MMBTUs) $= [GasConsumptionReplaced] - [ElectricConsumptionAdded]$

$=[(Idle\ Energy_{GasBase} + Preheat\ Energy_{GasBase} + Cooking\ Energy_{GasBase}) * 1/1{,}000{,}000 * Days] - [(Idle\ Energy_{ElecEE} + Preheat\ Energy_{ElecEE} + Cooking\ Energy_{ElecEE}) * 3412/1{,}000{,}000 * Days]$

Idle Energy$_{GasBase}$ $=((((1 - 0.9) * 11000 + 0.9 * 65 * 105\ /0.15\ ) * (6 - (100\ /\ 65) - (1 * 10.9/60)))$

= 187,432 Btu

Preheat Energy$_{GasBase}$ $= (1 * 18{,}832)$

= 18,832 BTU/day

Cooking Energy$_{GasBase}$ $= (1/\ 0.15) * (100\ lb/day * 105\ btu/lb)$

= 70,000 BTU/day

Idle Energy$_{ElecEE}$ $= (((1 - 0) * 0.4 + 0 * 50 * 0.0308\ \ /\ 0.50) * (6 - (100\ /\ 50) - (1 * 13.2/60))))$

= 1.5 kWh/day

Preheat Energy$_{ElecEE}$ $= (1 * 1.67)$

= 1.67 kWh/day

Cooking Energy$_{ElecEE}$ $= (1/\ 0.5) * (100 * 0.0308)$

= 6.16 kWh/day

SiteEnergySavings (MMBTUs) $=[(187{,}432 + 18{,}832 + 70{,}000) * 1/1{,}000{,}000 * 365.25] - [(1.5 + 1.67 + 6.16) * 3{,}412/1{,}000{,}000 * 365.25]$

= 89.3 MMBtu

If supported by an electric utility: ΔkWh $= \Delta SiteEnergySavings * 1{,}000{,}000\ /\ 3{,}412$

$= 89.3 * 1{,}000{,}000/3{,}412$

= 26,172 kWh

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water\ (gallons)\ /\ 1{,}000{,}000\ *\ E_{water\ supply}$$

Where

$E_{water\ supply}$ = IL Supply Energy Factor (kWh/Million Gallons)

=2,571[225]

For example, an electric 3 pan steamer with average efficiency in a full service – expanded menu restaurant

ΔWater (gallons) = $(40 - 10) * 7 * 365.25$

= 76,703 gallons

ΔkWh_{water} = $76{,}703/1{,}000{,}000 * 2{,}571$

= 197 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

This is only applicable to the electric steam cooker.

Non-fuel switch measures:

ΔkW = $((\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy)/HOURSDay) * CF$

ΔkW = $-((Idle\ EnergyElecEE + Preheat\ EnergyElecEE + Cooking\ EnergyElecEE)/HOURSDay) * CF$

Where:

CF =Summer Peak Coincidence Factor for measure is provided below for different locations:[226]

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39
Unknown	0.408

Other values as defined above

For example, for 3 pan electric steam cooker located in a cafeteria:

ΔkW = $((\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy)/(HOURSDay * Days)) * CF$

= $((31.18 + 0.5 + 5.69)/6) * 0.39$

= $2.43\ kW$

[225] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'. Note that the Commercial Steam Cooker does not discharge its water into the wastewater system so only the water supply factor is used here.

[226] Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985.

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

This is applicable to both gas and electric steam cookers.

$$\Delta\text{Water (gallons)} = (W_{BASE} - W_{ENERGYSTAR®}) * HOURS_{Day} * Days$$

Where

W_{BASE} = Water Consumption Rate of Base Steamer (gal/hr)

= 40[227]

$W_{ENERGYSTAR}$ = Water Consumption Rate of ENERGY STAR® Steamer look up[228]

=Actual, or

Equipment Type	gal/hr
Boilerless	1.69
Steam Generation	6.6

For example, a boilerless electric 3 pan steamer with in a full service restaurant

$$\Delta\text{Water (gallons)} = (40 - 1.69) * 7 * 365.25$$
$$= 97{,}949\ gallons$$

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = $[Gas\ Cooking\ Consumption\ Replaced]$

=$[(Idle\ Energy_{GasBase} + Preheat\ Energy_{GasBase} + Cooking\ Energy_{GasBase}) * 1/100{,}000 * Days]$

ΔkWh = $[Electric\ Cooking\ Consumption\ Added]$

=$-[(Idle\ Energy_{ElecEE} + Preheat\ Energy_{ElecEE} + Cooking\ Energy_{ElecEE}) * Days]$

[227] FSTC (2002). Commercial Cooking Appliance Technology Assessment. Chapter 8: Steamers.

[228] Average water consumption by equipment type calculated from the ENERGY STAR Qualified Products List, Accessed 06/02/2023.

MEASURE CODE: CI-FSE-STMC-V10-260101

REVIEW DEADLINE: 1/1/2028

4.2.4 Conveyor Oven

DESCRIPTION

This measure applies to natural gas fired high efficiency conveyor ovens installed in commercial kitchens replacing existing natural gas units with conveyor width greater than 25 inches.

Conveyor ovens are available using four different heating processes: infrared, natural convection with a ceramic baking hearth, forced convection or air impingement, or a combination of infrared and forced convection. Conveyor ovens are typically used for producing a limited number of products with similar cooking requirements at high production rates. They are highly flexible and can be used to bake or roast a wide variety of products including pizza, casseroles, meats, breads, and pastries.

Some manufacturers offer an air-curtain feature at either end of the cooking chamber that helps to keep the heated air inside the conveyor oven. The air curtain operates as a virtual oven wall and helps reduce both the idle energy of the oven and the resultant heat gain to the kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a natural gas conveyor oven with a tested baking energy efficiency > 42% and an idle energy consumption rate < 57,000 Btu/hr utilizing ASTM standard F1817.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing pizza deck oven at end of life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[229]

DEEMED MEASURE COST

The incremental capital cost for this measure is $2230.[230]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS[231]

$$\Delta\text{Therms} = ((\Delta DailyPreheatEnergy + \Delta DailyIdleEnergy + \Delta DailyCookingEnergy) * Days) / 100{,}000$$

[229] See PG&E Workpaper PGECOFST117 Commercial Conveyor Oven – Gas Revision #6, published April 1, 2016.
[230] Ibid.
[231] All inputs are taken from PG&E Workpaper PGECOFST117 Commercial Conveyor Oven – Gas Revision #6, published April 1, 2016, unless otherwise referenced.

Where:

ΔTherms = Annual therms calculated as in the equation above

Days = Annual days of kitchen operation

=Actual, if unknown assume 365.25

$$\Delta\text{DailyPreheatEnergy} = (PreheatEnergy_{Base} * Preheats) - (PreheatEnergy_{EE} * Preheats)$$

Where:

ΔDailyPreheatEnergy = Energy savings per day when gas conveyor oven is preheating calculated as in the equation above

$PreheatEnergy_{Base}$ = Preheat energy of baseline gas conveyor oven

= Actual, if unknown use 35,000 Btu

$PreheatEnergy_{EE}$ = Preheat energy of efficient conveyor oven

= Actual, if unknown use 18,000 Btu

Preheats = Number of preheats per day

= Actual, if unknown use 1

$$\Delta\text{DailyIdleEnergy} = (IdleRateGas_{Base} * (Hours - FoodCooked / ProductionGas_{Base} - (Preheats * PreheatTime / 60)) - (IdleRateGas_{EE} * (Hours - FoodCooked / ProductionGas_{EE} - (Preheats * PreheatTime / 60))$$

Where:

ΔDailyIdleEnergy = Energy savings per day when gas conveyor oven is idle as calculated in the equation above

Hours = Average daily hours of operation

=Actual, if unknown assume 12 hours

$IdleRateGas_{Base}$ = Idle energy rate of baseline gas conveyor oven

=Actual, if unknown use 70,000 Btu/hr

$IdleRateGas_{EE}$ = Idle energy rate of efficient gas conveyor oven

=Actual, if unknown use 57,000 Btu/hr

FoodCooked = Food cooked per day

= Actual, if unknown use 250 pizzas

Preheats = Number of preheats per day

= Actual, if unknown use 1

PreheatTime = Length of one preheat

= Actual, if unknown use 15 minutes

$ProductionGas_{Base}$ = Production capacity of baseline gas conveyor oven

= 150 pizzas per hour

$ProductionGas_{EE}$ = Production capacity of efficient gas conveyor oven

= Actual, if unknown use 220 pizzas per hour

ΔDailyCookingEnergy $=(FoodCooked * EFOOD_{Gas}/EFF_{Base}) - (FoodCooked * EFOOD_{Gas}/EFF_{EE})$

Where:

ΔDailyCookingEnergy = Energy savings per day when gas conveyor oven is cooking

FoodCooked = Food cooked per day

= Actual, if unknown use 250 pizzas

$EFOOD_{Gas}$ = ASTM energy to food for gas conveyor oven

= 190 Btu/pizza

EFF_{Base} = Cooking efficiency of baseline conveyor oven

= Actual, if unknown use 20%

EFF_{EE} = Cooking efficiency of efficient conveyor oven

= Actual, if unknown use 42%

For example, an efficient conveyor oven compared to baseline conveyor oven using default values from above would save.

ΔTherms = $((\Delta DailyPreheatEnergy + \Delta DailyIdleEnergy + \Delta DailyCookingEnergy) * Days) / 100{,}000$

Where:

ΔDailyPreheatEnergy $=(35{,}000 * 1) - (18{,}000 * 1)$

= $17{,}000\ btu$

ΔDailyIdleEnergy $=(70{,}000 * (12 - 250 / 150 - (1 * 15/60)) - (57{,}000 * 12 - 250 / 220 - (1 * 15/60))$

= $21{,}835\ btu$

ΔDailyCookingEnergy $= (250 * 190/0.2) - (250 * 190/0.42)$

= 124,405 btuΔTherms $= (17{,}000 + 21{,}835 + 124{,}405) * 365.25/100000$

= $596\ therms$

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-CVOV-V03-240101

REVIEW DEADLINE: 1/1/2028

4.2.5 ENERGY STAR Convection Oven

DESCRIPTION

This measure applies to electric or natural gas fired ENERGY STAR[232] convection ovens installed in a commercial kitchen.

Commercial convection ovens that are ENERGY STAR certified have higher heavy load cooking efficiencies, and lower idle energy rates, making them up to 20 percent more efficient than standard models. Energy savings estimates are for ovens using full size (18" x 36") sheet pans.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must meet ENERGY STAR requirements listed in ENERGY STAR Commercial Ovens Specifications Version 3.0.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a convection oven that is not ENERGY STAR certified and is at end of life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[233]

DEEMED MEASURE COST

The incremental capital cost for this measure uses actual costs, otherwise use costs outlined below:[234]

Equipment Type	Baseline Equipment Cost	Efficient Equipment Cost	Incremental Cost
Electric	$7,652	$8,612	$960
Gas	$7,510	$9,884	$2,374

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is assumed to be 0.90.[235]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

Non-Fuel Switch Measures

[232] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[233] Lifetime from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, Oven Calculations, which cites reference as "FSTC research on available models, 2009".
[234] Costs sourced from California SWFS001_Convection_Oven_IMC_Analysis_-_2022-07-25
[235] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.Type equation here.

The algorithm below applies to ENERGY STAR compared to baseline electric convection ovens:

$$\Delta kWh = (\Delta DailyIdle\ Energy + \Delta DailyPreheat\ Energy + \Delta DailyCooking\ Energy) * Days$$

The algorithm below applies to ENERGY STAR compared to baseline gas convection ovens:

$$\Delta Therms = (\Delta DailyIdle\ Energy + \Delta DailyPreheat\ Energy + \Delta DailyCooking\ Energy) * Days / 100{,}000$$

Fuel Switch/Electrification Measures

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

$$SiteEnergySavings\ (MMBTUs) = [GasConsumptionReplaced] - [ElectricConsumptionAdded]$$

$$= [(DailyIdle\ Energy_{\ GasBase} + DailyPreheat\ Energy_{GasBase} + DailyCooking\ Energy_{GasBase}) * 1/1{,}000{,}000 * Days] -$$

$$[(DailyIdle\ Energy_{ElecEE} + DailyPreheat\ Energy_{ElecEE} + DailyCooking\ Energy)_{ElecEE} * 3412/1{,}000{,}000 * Days]$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

$$\Delta DailyIdleEnergy = (IdleBase * IdleBaseTime) - (IdleENERGYSTAR * IdleENERGYSTARTime)$$

$$\Delta DailyCookingEnergy = (LB * EFOOD / Eff_{Base}) - (LB * EFOOD / Eff_{ENERGYSTAR})$$

$$\Delta DailyPreheatEnergy = (PreheatNumber * PreheatTimeBase/60 * PreheatRateBase) - (PreheatNumber * PreheatTimeENERGYSTAR/60 * PreheatRateENERGYSTAR)$$

$$DailyIdle\ Energy_{GasBase} = (IdleBase_{Gas} * IdleBaseTime_{Gas})$$

$$DailyCooking\ Energy_{GasBase} = (LB * EFOOD / Eff_{BaseGas})$$

$$DailyIdle\ Energy_{ElecEE} = (IdleENERGYSTAR_{Elec} * IdleENERGYSTARTime)$$

$$DailyCooking\ Energy_{ElecEE} = (LB * EFOOD / Eff_{ENERGYSTARElec})$$

Where[236]:

IdleENERGYSTAR = Idle energy rate

= Actual, if unknown assume:

Oven Type	IdleENERGYSTAR
Electric Half Size	1.0 kW/h
Electric Full-Size ≥ 5 pans	1.4 kW/h
Electric Full-Size < 5 pans	1.0 kW/h
Natural Gas	9,500 Btu/h

IdleBase = Idle energy rate

Oven Type	IdleBASE
Electric Half Size	1.51 kW/h
Electric Full-Size ≥ 5 pans	1.63 kW/h
Electric Full-Size < 5 pans	1.563 kW/h
Natural Gas	12,245 Btu/h

IdleENERGYSTARTime = $ENERGY\ STAR\ Idle\ Time\ (hours)$

$=HOURsday - LB/PC_{ENERGYSTAR} - PreHeatTime_{ENERGYSTAR}/60$

Using defaults:

Oven Type	Calculation	IdleENERGYSTARTime
Electric Half Size	= 12 – 61/42 – 8/60	10.4
Electric Full-Size ≥ 5 pans	= 12 – 122/98 – 9/60	10.6
Electric Full-Size < 5 pans	= 12 – 122/60 – 9/60	9.8
Natural Gas	= 12 – 100/91 – 11/60	10.7

HOURSday = Average Daily Operation

= custom or if unknown, use 12 hours

LB = Food cooked per day

= custom or if unknown, use 100 pounds for gas oven, 61 lbs for half sized electric oven or 122 lbs for full-sized electric oven[237]. For fuel switching scenarios, use same LB assumption for both baseline and efficient.

$PC_{ENERGYSTAR}$ = Production Capacity ENERGY STAR (lb/hr)

= Actual, if unknown use:

Oven Type	$PC_{ENERGYSTAR}$
Electric Half Size	42
Electric Full-Size ≥ 5 pans	98
Electric Full-Size < 5 pans	60
Natural Gas	91

$PreheatTime_{ENERGYSTAR}$ = preheat length of ENERGY STAR oven

= custom or if unknown use[238]:

[236] All assumptions except where noted are based upon data package provided alongside ENERGY STAR Commercial Ovens Specifications Version 3.0. See ENERGY STAR v3 Commercial Ovens Data Package.xlsx.
[237] Gas default is based upon the ENERGY STAR Commercial Kitchen Calculator. Electric defaults based on data from the Regional Technical Forum for the Northwest Council (Commercial Cooking Convection Oven Calculator, UES Measure Workbook), see "ComCookingConvectionOven_v4_0.xlsm".
[238] ENERGY STAR Commercial Kitchen Calculator, updated March 2024.

Oven Type	PreheatTimeENERGYSTAR
Electric Half Size	8
Electric Full-Size	9
Natural Gas	11

IdleBaseTime = BASE Idle Time

= $HOURS_{day-LB}/PC_{base} – PreHeatTime_{Base}/60$

Using defaults:

Oven Type	Calculation	IdleBaseTime
Electric Half Size	= 12 – 61/45 – 9/60	10.5
Electric Full-Size ≥ 5 pans	= 12 – 122/102 – 9/60	10.7
Electric Full-Size < 5 pans	= 12 – 122/68 – 9/60	10.1
Natural Gas	= 12 – 100/95 – 12/60	10.7

PC_{Base} = Production Capacity base

= Actual, if unknown use:

Oven Type	PC_{Base}
Electric Half Size	45
Electric Full-Size ≥ 5 pans	102
Electric Full-Size < 5 pans	68
Natural Gas	95

PreheatTimeBase = preheat length of base oven

= custom or if unknown use[239]:

Oven Type	PreheatTimeBase
Electric Half Size	9
Electric Full-Size	9
Natural Gas	12

Days = Annual days of operation

= custom or if unknown, use 365.25 days a year

EFOOD = ASTM energy to food

= 0.0732 kWh/lb for electric ovens or 250 btu/pound for natural gas ovens[240]:

$Eff_{ENERGYSTAR}$ = Cooking Efficiency ENERGY STAR

= Actual, if unknown use:

Oven Type	$Eff_{ENERGYSTAR}$
Electric Half Size	71%
Electric Full-Size ≥ 5 pans	76%
Electric Full-Size < 5 pans	76%
Natural Gas	49%

[239] ENERGY STAR Commercial Kitchen Calculator, updated March 2024.
[240] ENERGY STAR Commercial Kitchen Calculator, updated March 2024.

Eff_{Base} = Cooking Efficiency Baseline

Oven Type	Eff_{Base}
Electric Half Size	64%
Electric Full-Size ≥ 5 pans	74%
Electric Full-Size < 5 pans	65%
Natural Gas	48%

$PreheatRate_{Base}$ =Preheat rate (kWh/day for electric units, btu/day for natural gas units) baseline.

=Actual, if unknown

Oven Type	$PreheatRate_{Base}$
Electric Half Size	0.77
Electric Full-Size ≥ 5 pans	1.55
Electric Full-Size < 5 pans	1.563
Natural Gas	11,320

$PreheatRate_{ENERGYSTAR}$ =Preheat rate (kWh/day for electric units, btu/day for natural gas units) ENERGY STAR.

=Actual; or if unknown

Oven Type	$PreheatRate_{ENERGYSTAR}$
Electric Half Size	0.89
Electric Full-Size ≥ 5 pans	1.36
Electric Full-Size < 5 pans	1.389
Natural Gas	10,130

PreheatNumber =Number of preheats per day

= Actual; or if unknown use 1

For example, an ENERGY STAR gas oven compared to baseline gas oven using default values from above would save.

ΔTherms = $(\Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy) * Days\ /100000$

Where:

ΔDailyIdleEnergy =$(12{,}245 * 10.7) - (9{,}500 * 10.7)$
= $29{,}372\ btu$

ΔDailyPreheatEnergy = $(1 * 12/60 * 11{,}320) - (1 * 11/60 * 10{,}130)$
= $407\ btu$

ΔDailyCookingEnergy = $(100 * 250/0.48) - (100 * 250/0.49)$
= $1{,}063\ btu$

ΔTherms = $(29{,}372 + 407 + 1{,}063) * 365.25\ /100000$
= $113\ therms$

An ENERGY STAR half sized electric oven compared to baseline electric oven using default values from above would save.

ΔkWh = $(\Delta Idle\ Energy + \Delta DailyPreheat\ Energy + \Delta Cooking\ Energy) * Days\ /100000$

Where:

ΔDailyIdleEnergy =$(1.51 * 10.5) - (1.0 * 10.4)$
= $5.5\ kWh$

ΔDailyPreheatEnergy = $(1 * 9/60 * 0.77) - (1 * 8/60 * 0.89)$
= $-0.003\ kWh$

ΔDailyCookingEnergy = $(61 * 0.0732/0.65) - (61 * 0.0732/0.71)$
= $0.58\ kWh$

ΔkWh = $(5.5 + -0.003 + 0.58) * 365.25$
= $2{,}220\ kWh$

An ENERGY STAR full sized electric oven ≥ 5 pans compared to baseline electric oven using default values from above would save.

ΔkWh=$(\Delta Idle\ Energy + \Delta DailyPreheat\ Energy + \Delta Cooking\ Energy) * Days\ /100000$

Where:

ΔDailyIdleEnergy =$(1.63 * 10.7) - (1.4 * 10.6)$
= $2.6\ kWh$

ΔDailyPreheatEnergy = $(1 * 9/60 * 1.55) - (1 * 9/60 * 1.36)$
= $0.03\ kWh$

ΔDailyCookingEnergy = $(122 * 0.0732/0.74) - (122 * 0.0732/0.76)$
= $0.3\ kWh$

ΔkWh = $(2.6 + 0.03 + 0.3) * 365.25$
= $1{,}070\ kWh$

An ENERGY STAR full sized electric oven < 5 pans compared to baseline electric oven using default values from above would save.

$$\Delta kWh = (\Delta Idle\ Energy\ +\ \Delta Cooking\ Energy) * Days\ /100000$$

Where:

ΔDailyIdleEnergy $=(1.563 * 10.1) - (1.0 * 9.8)$

$= 6.0\ kWh$

ΔDailyPreheatEnergy $= (1 * 9/60 * 1.563) - (1 * 9/60 * 1.389)$

$= 0.03\ kWh$

ΔDailyCookingEnergy $= (122 * 0.0732/0.65) - (122 * 0.0732/0.76)$

$= 2.0\ kWh$

ΔkWh $= (6.0 + 0.03 + 2.0) * 365.25$

$= 2{,}933\ kWh$

An ENERGY STAR full sized >5 pan electric oven compared to baseline gas oven assuming 100 lbs food cooked per day and using other default values from above would save.

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricConsumptionAdded]$

$=[(DailyIdle\ Energy_{GasBase} + DailyPreheat\ Energy_{GasBase} + DailyCooking\ Energy_{GasBase}) * 1/1{,}000{,}000 * Days] - [(DailyIdle\ Energy_{ElecEE} + DailyPreheat\ Energy_{ElecEE}\ DailyCooking\ Energy_{ElecEE}) * 3412/1{,}000{,}000 * Days]$

$DailyIdleEnergy_{GasBase}$ $=(12{,}245 * 10.7)$

$= 131{,}022\ btu$

$DailyPreheatEnergy_{GasBase}$ $= (1 * 12/60 * 11{,}320)$

$= 2{,}264\ btu$

$DailyCookingEnergy_{GasBase}$ $= (100 * 250/0.48)$

$= 52{,}083\ btu$

$DailyIdleEnergy_{ElecEE}$ $= (1.4 * 10.6)$

$= 14.8\ kWh$

$DailyPreheatEnergy_{ElecEE}$ $= (1 * 9/60 * 1.36)$

$= 0.20\ kWh$

$DailyCookingEnergy_{ElecEE}$ $= (100 * 0.0732/0.76)$

$= 9.6\ kWh$

SiteEnergySavings (MMBTUs) $=((131022 + 2264 + 52083) * 1/1{,}000{,}000 * 365.25) - ((14.8 + 0.20 + 9.6) * 3412/1{,}000{,}000 * 365.25)$

$= 37\ MMBtu$

If supported by an electric utility: ΔkWh = ΔSiteEnergySavings * 1,000,000 / 3,412

= 37 * 1,000,000/3,412

= 10,844 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Non-fuel switch measures:

$$\Delta kW = ((\Delta DailyIdle\ Energy + \Delta DailyPreheat\ Energy + \Delta DailyCooking\ Energy) / HOURSDay * CF$$

Fuel switch measures:

$$\Delta kW = - ((DailyIdle\ Energy_{ElecEE} + DailyPreheat\ Energy_{ElecEE} + DailyCooking\ Energy_{ElecEE}) / HOURSDay * CF$$

Where:

CF =Summer Peak Coincidence Factor

= 0.90[241]

Other values as defined above.

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

$$\Delta Therms = [Gas\ Cooking\ Consumption\ Replaced]$$

$$= [(DailyIdle\ Energy_{GasBase} + DailyPreheat\ Energy_{GasBase} + DailyCooking\ Energy_{GasBase}) * 1/100{,}000 * Days]$$

$$\Delta kWh = [Electric\ Cooking\ Consumption\ Added]$$

$$= - [(DailyIdle\ Energy_{ElecEE} + DailyPreheat\ Energy_{ElecEE} + DailyCooking\ Energy_{ElecEE}) * Days]$$

[241] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

MEASURE CODE: CI-FSE-ESCV-V08-270101

REVIEW DEADLINE: 1/1/2030

4.2.6 ENERGY STAR Dishwasher

DESCRIPTION

This measure applies to ENERGY STAR[242] high and low temp under counter, stationary single tank door type, single tank conveyor, and multiple tank conveyor dishwashers, as well as high temp pot, pan, and utensil dishwashers installed in a commercial kitchen.

This measure was developed to be applicable to the foll

owing program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR certified dishwasher meeting idle energy rate (kW), washing energy and water consumption (gallons/rack) limits, as determined by both machine type and sanitation approach (chemical/low temp versus high temp).

ENERGY STAR Requirements (Version 3.0, effective July 27, 2021)

Dishwasher Type	High Temp Efficiency Requirements			Low Temp Efficiency Requirements		
	Idle Energy Rate	Washing Energy	Water Consumption	Idle Energy Rate	Washing Energy	Water Consumption
Under Counter	≤ 0.30 kW	≤ 0.35 kWh/rack	≤ 0.86 GPR	≤ 0.25 kW	≤ 0.15 kWh/rack	≤ 1.19 GPR
Stationary Single Tank Door	≤ 0.55 kW	≤ 0.35 kWh/rack	≤ 0.89 GPR	≤ 0.30 kW	≤ 0.15 kWh/rack	≤ 1.18 GPR
Pot, Pan, and Utensil	≤ 0.90 kW	≤ 0.55 + 0.05 * SF_{rack}	≤ 0.58 GPSF	N/A		
Single Tank Conveyor	≤ 1.20 kW	≤ 0.36 kWh/rack	≤ 0.70 GPR	≤ 0.85 kW	≤ 0.16 kWh/rack	≤ 0.79 GPR
Multiple Tank Conveyor	≤ 1.85 kW	≤ 0.36 kWh/rack	≤ 0.54 GPR	≤ 1.00 kW	≤ 0.22 kWh/rack	≤ 0.54 GPR

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a new dishwasher that is not ENERGY STAR certified.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be:[243]

Dishwasher Type		Equipment Life
Low Temp	Under Counter	10
	Stationary Single Tank Door	10
	Single Tank Conveyor	10
	Multi Tank Conveyor	10
High Temp	Under Counter	10
	Stationary Single Tank Door	10
	Single Tank Conveyor	10
	Multi Tank Conveyor	10
	Pot, Pan, and Utensil	10

DEEMED MEASURE COST

The incremental capital cost for this measure is provided below:[244]

[242] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.

[243] Lifetime from ENERGY STAR Commerical Food Service Equipment Calculator, updated March 2024 which cites reference as "EPA/FSTC research on available models, 2013"

[244] Measure cost from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, updated March 2024 which cites reference as "Difference between a similar ENERGY STAR and non-qualifying model EPA research using AutoQuotes, 2016 (for high/low temp undercounter/single door) and 2012 (all other types)".

Dishwasher Type		Incremental Cost
Low Temp	Under Counter	$234
	Stationary Single Tank Door	$1,469
	Single Tank Conveyor	$0
	Multi Tank Conveyor	$970
High Temp	Under Counter	$156
	Stationary Single Tank Door	$3,309
	Single Tank Conveyor	$2,050
	Multi Tank Conveyor	$970
	Pot, Pan, and Utensil	$1,710

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different restaurant types:[245]

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

Algorithm

CALCULATION OF SAVINGS

ENERGY STAR dishwashers save energy in three categories: building water heating, booster water heating and idle energy. Building water heating and booster water heating could be either electric or natural gas.

ELECTRIC ENERGY SAVINGS

Non-Fuel Switch measures:

Custom calculation below[246], otherwise use deemed values found within the tables that follow.

$$\Delta\text{kWh} = \Delta\text{BuildingEnergy} + \Delta\text{BoosterEnergy} + \Delta\text{IdleEnergy}$$

Where:

ΔBuildingEnergy = Change in annual electric energy consumption of building water heater

$$= [(WaterUseBase * RacksWashed * Days) * (\Delta Tin * 1.0 * 8.2 \div EffHeater \div 3{,}412)] - [(WaterUseESTAR * RacksWashed * Days) * (\Delta Tin * 1.0 * 8.2 \div EffHeater \div 3{,}412)]$$

ΔBoosterEnergy = Annual electric energy consumption of booster water heater[247]

[245] Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985

[246] Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator.

[247] Booster water heater energy only applies to high-temperature dishwashers.

$$= [(WaterUseBase * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{3{,}412})]$$

$$- [(WaterUseESTAR * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{3{,}412}]$$

ΔIdleEnergy = Annual idle electric energy consumption of dishwasher

$$= [IdleDrawBase * \left((Hours * Days) - \left(Days * RacksWashed * \frac{WashTime}{60}\right)\right)] -$$

$$[IdleDrawESTAR * \left((Hours * Days) - \left(Days * RacksWashed * \frac{WashTime}{60}\right)\right)]$$

Fuel-Switch / Electrification Measures:

Fuel-switching / electrification is only applicable in the following scenario:

Base Case: High Temp Dishwasher with an Electric Booster Heater and a Gas Building Heater

Measure Case: High Temp Heat Recovery Dishwasher with an Electric Booster Heater and no associated Building Heater energy usage.

Fuel-switch / electrification measures must product positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. The following algorithm can be used to determine eligibility:

SiteEnergySavings (MMBTUs) $= [GasConsumptionReplaced + kWhCosumptionReplaced] - [ElectricalConsumptionAdded]$

$$= \left[\frac{AnnualBuildingEnergyGasBaseTHERMS}{10} + (\frac{AnnualBoosterEnergyElectricBase + AnnualIdleEnergyElectricBase + WaterEnergyGasBase) * 3{,}412}{1{,}000{,}000}\right] - \left[\frac{(AnnualBoosterEnergyElectricMeasure + AnnualIdelEnergyElectricMeasure + WaterEnergyElectricMeasure) * 3{,}412}{1{,}000{,}000}\right]$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claims are dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remain the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:

$WaterUse_{Base}$ = Water use per rack (gal) of baseline dishwasher

= Custom or if unknown, use value from table below as determined by machine type and sanitation method

$WaterUse_{ESTAR}$ = Water use per rack (gal) of ENERGY STAR dishwasher

= Custom or if unknown, use value from table below as determined by machine type and sanitation method

RacksWashed = Number of racks washed per day

= Custom or if unknown, use value from table below as determined by machine type and sanitation method

Days = Annual days of dishwasher operation

= Custom or if unknown, use 365.25 days per year

ΔT_{in} = Inlet water temperature increase (°F)

= Custom or if unknown, use 70 °F for building water heaters and 40 °F for booster water heaters

Note for Heat Recovery Dish Washers which accept cold water the temperature increase is 0 °F for building water heaters and 110 °F for booster water heaters.

1.0 = Specific heat of water (Btu/lb/°F)

8.2 = Density of water (lb/gal)

Eff_{Heater} = Efficiency of water heater

= Custom or if unknown, use 98% for electric building and booster water heaters

3,412 = kWh to Btu conversion factor

$IdleDraw_{Base}$ = Idle power draw (kW) of baseline dishwasher

= Custom or if unknown, use value from table below as determined by machine type and sanitation method

$IdleDraw_{ESTAR}$ = Idle power draw (kW) of ENERGY STAR dishwasher

= Custom or if unknown, use value from table below as determined by machine type and sanitation method

Hours = Average daily hours of dishwasher operation

= Custom or if unknown, use 18 hours per day

WashTime = Typical wash time (min)

= Custom or if unknown, use value from table below as determined by machine type and sanitation method

60 = Minutes to hours conversion factor

For example, an ENERGY STAR high-temperature, under counter dishwasher with electric building and electric booster water heating with defaults from the calculation above and the table below would save:

ΔkWh = ΔBuildingEnergy + ΔBoosterEnergy + ΔIdleEnergy

Where:

ΔBuildingEnergy = [(1.09 * 75 * 365.25) * (70 *1.0 * 8.2 ÷ 0.98 ÷ 3,412)] - [(0.86 * 75 * 365.25) * (70 *1.0 * 8.2 ÷ 0.98 ÷ 3,412)]

= 1,082 kWh

ΔBoosterEnergy = [(1.09 * 75 * 365.25) * (40 *1.0 * 8.2 ÷ 0.98 ÷ 3,412)] - [(0.86 * 75 * 365.25) * (40 *1.0 * 8.2 ÷ 0.98 ÷ 3,412)]

= 618 kWh

ΔIdleEnergy = [0.36 * (18 *365.25 – 365.25 * 75 * 2.5 ÷ 60)] –

[0.30 * (18 *365.25 – 365.25 * 75 * 2.5 ÷ 60)]

= 326 kWh

ΔkWh = 1,082 + 618 + 340

= 2,026 kWh

Default values for WaterUse, RacksWashed, kW_{Idle}, and WashTime are presented in the table below.

Low Temperature	RacksWashed	WashTime	WaterUse		IdleDraw	
	All Dishwashers	All Dishwashers	Conventional	ENERGY STAR	Conventional	ENERGY STAR
Under Counter	75	2.5	1.73	1.19	0.41	0.25
Stationary Single Tank Door	280	7.0	2.10	1.18	0.32	0.30
Single Tank Conveyor	400	2.0	1.31	0.79	0.75	0.85
Multi Tank Conveyor	600	3.0	1.04	0.54	1.74	1.00
High Temperature	**All Dishwashers**	**All Dishwashers**	**Conventional**	**ENERGY STAR**	**Conventional**	**ENERGY STAR**
Under Counter	75	2.5	1.09	0.86	0.36	0.30
Stationary Single Tank Door	280	7.0	1.29	0.89	0.51	0.55
Single Tank Conveyor	400	2.0	0.87	0.70	1.30	1.20
Multi Tank Conveyor	600	2.0	0.97	0.54	1.84	1.85
Pot, Pan, and Utensil	200	10.0	0.70	0.58	1.10	0.90

Savings for all water heating combinations are presented in the tables below (calculated without rounding variables as provided above).

Electric building and electric booster water heating

Dishwasher Type		kWh_{Base}	kWh_{ESTAR}	ΔkWh
Low Temp	Under Counter	17,299	11,117	6,182
	Stationary Single Tank Door	54,507	37,252	17,255
	Single Tank Conveyor	63,517	48,138	15,378
	Multi Tank Conveyor	96,834	73,971	22,863
High Temp	Under Counter	19,114	17,634	1,480
	Stationary Single Tank Door	74,430	62,533	11,897
	Single Tank Conveyor	97,362	87,158	10,204
	Multi Tank Conveyor	166,643	121,569	45,074
	Pot, Pan, and Utensil	86,494	75,516	10,979

Electric building and natural gas booster water heating

Dishwasher Type		kWh_{Base}	kWh_{ESTAR}	ΔkWh
Low Temp	Under Counter	17,299	11,117	6,182
	Stationary Single Tank Door	54,507	37,252	17,255
	Single Tank Conveyor	63,517	48,138	15,378
	Multi Tank Conveyor	96,834	73,971	22,863
High Temp	Under Counter	16,185	15,323	862
	Stationary Single Tank Door	61,488	53,604	7,884
	Single Tank Conveyor	84,893	77,125	7,768
	Multi Tank Conveyor	145,789	109,960	35,829
	Pot, Pan, and Utensil	81,478	71,359	10,119

Natural gas building and electric booster water heating

Dishwasher Type		kWh_{Base}	kWh_{ESTAR}	ΔkWh
Low Temp	Under Counter	2,320	1,414	905
	Stationary Single Tank Door	1,285	1,205	80
	Single Tank Conveyor	4,380	4,964	-584
	Multi Tank Conveyor	9,527	5,475	4,052
High Temp	Under Counter	4,955	4,008	946
	Stationary Single Tank Door	14,990	11,137	3,852
	Single Tank Conveyor	20,061	17,041	3,020
	Multi Tank Conveyor	31,599	22,413	9,186
	Pot, Pan, and Utensil	8,228	6,784	1,444

Natural gas building and natural gas booster water heating

Dishwasher Type		kWh_{Base}	kWh_{ESTAR}	ΔkWh
Low Temp	Under Counter	2,320	1,414	905
	Stationary Single Tank Door	1,285	1,205	80
	Single Tank Conveyor	4,380	4,964	-584
	Multi Tank Conveyor	9,527	5,475	4,052
High Temp	Under Counter	2,025	1,697	328
	Stationary Single Tank Door	2,048	2,208	-161
	Single Tank Conveyor	7,592	7,008	584
	Multi Tank Conveyor	10,746	10,804	-58
	Pot, Pan, and Utensil	3,212	2,628	584

For example, the fuel switch measure of a High Temp Heat Recovery Dishwasher with an Electric Booster Heater and no associated Building Heater energy usage, in place of a High Temp Dishwasher with an Electric Booster Heater and a Gas Building Heater.

SiteEnergySavings (MMBTUs)	= [GasConsumptionReplaced + kWhCosumptionReplaced] – [ElectricalConsumptionAdded] = [$AnnualBuildingEnergy_{GasBaseTHERMS}$ / 10 + ($AnnualBoosterEnergy_{ElectricBase}$ + $AnnualIdleEnergy_{ElectricBase}$ + $WaterEnergy_{GasBase}$) *3,412 / 1,000,000] – [($AnnualBoosterEnergy_{ElectricMeasure}$ + $AnnualIdleEnergy_{ElectricMeasure}$ + $WaterEnergy_{ElectricMeasure}$) * 3,412 / 1,000,000]
$AnnualBuildingEnergy_{GasBaseTHERMS}$	= ($WaterUse_{Base}$ * RacksWashed * Days)*(ΔT_{in} * 1.0 * 8.2 / Eff_{Heater} / 100,000) = (1.09 * 75 * 365.25) * (70 * 1 * 8.2 / 0.8 / 100,000) = 214 Therm
$AnnualBoosterEnergy_{ElectricBase}$	= ($WaterUse_{Base}$ * RacksWashed * Days) * (ΔT_{in} *1.0 * 8.2 / Eff_{Heater} / 3,412) = (1.09 * 75 * 365.25) * (40 * 1 * 8.2 / 0.98 / 3,412) = 2,929 kWh
$AnnualIdleEnergy_{ElectricBase}$	= $IdleDraw_{Base}$* (Hours * Days – Days * RacksWashed * WashTime / 60) = 0.36 * (18 * 365.25 – 365.25 * 75 * 2.5 / 60) = 1,956 kWh
$WaterEnergy_{ElectricBase}$	= ($WaterUse_{Base}$ * RacksWashed * Days) / 1,000,000 * 5,010 = (0.86 * 75 * 365.25) / 1,000,000 * 5,010 = 150 kWh
$AnnualBoosterEnergy_{ElectricMeasure}$	= ($WaterUse_{Measure}$ * RacksWashed * Days) * (ΔT_{in} *1.0 * 8.2 / Eff_{Heater} / 3,412) = (0.86 * 75 * 365.25) * (110 * 1 * 8.2 / 0.98 / 3,412) = 6,355 kWh
$AnnualIdleEnergy_{ElectricMeasure}$	= $IdleDraw_{Measure}$* (Hours * Days – Days * RacksWashed * WashTime / 60) = 0.3 * (18 * 365.25 – 365.25 * 75 * 2.5 / 60) = 1,630 kWh
$WaterEnergy_{ElectricMeasure}$	= ($WaterUse_{Measure}$ * RacksWashed * Days) / 1,000,000 * 5,010 = (0.86 * 75 * 365.25) / 1,000,000 * 5,010 = 118 kWh
SiteEnergySavings (MMBTUs)	= [214 / 10 + (2,929 + 1,956 + 150) * 3,412 / 1,000,000] – [(6,355 + 1,630 + 118) * 3,412 / 1,000,000] = 10.9 MMBTU
If supported by an electric utility	= SiteEnergySavings * 1,000,000 / 3,412 = 10.9 * 1,000,000 / 3,412 = 3,195 kWh

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \frac{\Delta Water\ (gallons)}{1{,}000{,}000} * Ewater\ total$$

Where

$E_{water\ total}$ = IL Total Water Energy Factor (kWh/Million Gallons)

= 5,010[248]

For example, an ENERGY STAR low-temperature, under-counter dishwasher with defaults from the calculation above and the table within the electric energy savings characterization would save:

ΔWater = ($WaterUse_{Base}$ * RacksWashed * Days) - ($WaterUse_{ESTAR}$ * RacksWashed * Days)

ΔWater (gallons) = (1.73 * 75 * 365.25) - (1.19 * 75 * 365.25)

= 14,793 gallons

ΔkWh_{water} = 14,793/1,000,000*5,010

= 74 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{AnnualHours} * CF$$

Where:

ΔkWh = Annual kWh savings from measure as calculated above. Note: do not include the secondary savings in this calculation.

AnnualHours $= Hours * Days$

= Custom, or if unknown assume (18 * 365.25 =) 6575 annual hours

CF = Summer Peak Coincidence Factor

= dependent on restaurant type:[249]

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.39

[248] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

[249] Values taken from Minnesota Technical Reference Manual (Version 2.2, effective May 2, 2018), 'Electric Oven and Range' measure and are based upon "Project on Restaurant Energy Performance-End-Use Monitoring and Analysis", Appendixes I and II, Claar, et. al., May 1985.

For example, a low temperature undercounter dishwasher in a Full Service Limited Menu restaurant with electric building and booster water heaters would save:

ΔkW = ΔkWh/ AnnualHours * CF
= 3645/6575*0.51
= 0.283 kW

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = \Delta\text{BuildingEnergy} + \Delta\text{BoosterEnergy}$$

Where:

ΔBuildingEnergy = Change in annual natural gas consumption of building water heater

$$= [(WaterUseBase * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{100{,}000})]$$

$$- [(WaterUseESTAR * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{100{,}000})]$$

ΔBoosterEnergy = Change in annual natural gas consumption of booster water heater

$$= [(WaterUseBase * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{100{,}000})]$$

$$- [(WaterUseESTAR * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{100{,}000})]$$

Where:

$WaterUse_{Base}$ = Water use per rack (gal) of baseline dishwasher

= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method

$WaterUse_{ESTAR}$ = Water use per rack (gal) of ENERGY STAR dishwasher

= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method

RacksWashed = Number of racks washed per day

= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method

Days = Annual days of dishwasher operation

= Custom or if unknown, use 365.25 days per year

ΔT_{in} = Inlet water temperature increase (°F)

= Custom or if unknown, use 70 °F for building water heaters and 40 °F for booster water heaters

1.0 = Specific heat of water (Btu/lb/°F)

8.2 = Density of water (lb/gal)

Eff_{Heater} = Efficiency of water heater

= Custom or 80% for gas building and booster water heaters

100,000 = Therms to Btu conversion factor

For example, an ENERGY STAR high-temperature, under counter dishwasher with gas building and gas booster water heating with defaults from the calculation above and the table within the electric energy savings characterization would save:

ΔTherms = ΔBuildingEnergy + ΔBoosterEnergy

Where:

ΔBuildingEnergy = [(1.09 * 75 * 365.25)*(70 * 1.0 * 8.2 / 0.80 / 100,000)] - [(0.86 * 75 * 365.25)*(70 * 1.0 * 8.2 / 0.80 / 100,000)]

= 45 therms

ΔBoosterEnergy = [(1.09 * 75 * 365.25)*(40 * 1.0 * 8.2 / 0.80 / 100,000)] - [(0.86 * 75 * 365.25) * (40 * 1.0 * 8.2 / 0.80 / 100,000)]

= 26 therms

ΔTherms = 45 + 26

= 71 therms

Savings for all water heating combinations are presented in the tables below.

Electric building and natural gas booster water heating

Dishwasher Type		$Therms_{Base}$	$Therms_{ESTAR}$	ΔTherms
Low Temp	Under Counter	NA	NA	NA
	Stationary Single Tank Door	NA	NA	NA
	Single Tank Conveyor	NA	NA	NA
	Multi Tank Conveyor	NA	NA	NA
High Temp	Under Counter	122	97	26
	Stationary Single Tank Door	541	373	168
	Single Tank Conveyor	521	419	102
	Stationary Single Tank Door	872	485	386
	Pot, Pan, and Utensil	210	174	36

Natural gas building and natural gas booster water heating

Dishwasher Type		$Therms_{Base}$	$Therms_{ESTAR}$	ΔTherms
Low Temp	Under Counter	340	234	106
	Stationary Single Tank Door	1,542	866	675
	Single Tank Conveyor	1,374	828	545
	Multi Tank Conveyor	1,636	849	786
High Temp	Under Counter	337	266	71
	Stationary Single Tank Door	1,488	1,027	461
	Single Tank Conveyor	1,434	1,154	280
	Multi Tank Conveyor	2,398	1,335	1,063
	Pot, Pan, and Utensil	577	478	99

Natural gas building and electric booster water heating

Dishwasher Type		$Therms_{Base}$	$Therms_{ESTAR}$	ΔTherms
Low Temp	Under Counter	340	234	106
	Stationary Single Tank Door	1,542	866	675
	Single Tank Conveyor	1,374	828	545

Dishwasher Type		$Therms_{Base}$	$Therms_{ESTAR}$	ΔTherms
	Multi Tank Conveyor	1,636	849	786
High Temp	Under Counter	214	169	45
	Stationary Single Tank Door	947	653	294
	Single Tank Conveyor	912	734	178
	Multi Tank Conveyor	1,526	849	676
	Pot, Pan, and Utensil	367	304	63

WATER IMPACT DESCRIPTIONS AND CALCULATION

$$\Delta\text{Water} = (\text{WaterUse}_{\text{Base}} * \text{RacksWashed} * \text{Days}) - (\text{WaterUse}_{\text{ESTAR}} * \text{RacksWashed} * \text{Days})$$

Where:

$WaterUse_{Base}$ = Water use per rack (gal) of baseline dishwasher

= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method

$WaterUse_{ESTAR}$ = Water use per rack (gal) of ENERGY STAR dishwasher

= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method

RacksWashed = Number of racks washed per day

= Custom or if unknown, use value from table within the electric energy savings characterization as determined by machine type and sanitation method

Days = Annual days of dishwasher operation

= Custom or if unknown, use 365.25 days per year

For example, an ENERGY STAR low-temperature, under counter dishwasher with defaults from the calculation above and the table within the electric energy savings characterization would save:

ΔWater = ($WaterUse_{Base}$ * RacksWashed * Days) - ($WaterUse_{ESTAR}$ * RacksWashed * Days)

ΔWater (gallons) = (1.73 * 75 * 365.25) - (1.19 * 75 * 365.25)

= 14,793 gallons

Savings for all dishwasher types are presented in the table below.

	Annual Water Consumption (gallons)		
	Baseline	ENERGY STAR	Savings
Low Temperature			
Under Counter	47,391	32,599	14,793
Stationary Single Tank Door	214,767	120,679	94,088
Single Tank Conveyor	191,391	115,419	75,972
Multi Tank Conveyor	227,916	118,341	109,575
High Temperature			
Under Counter	29,859	23,559	6,301
Stationary Single Tank Door	131,928	91,020	40,908
Single Tank Conveyor	127,107	102,270	24,837
Multi Tank Conveyor	212,576	118,341	94,235
Pot, Pan, and Utensil	51,135	42,369	8,766

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = [Gas Consumption Replaced]

$$= [((WaterUseBase * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{100{,}000}))$$

$$+ ((WaterUseBase * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{100{,}000}))]$$

ΔkWh = [Electric Consumption Added]

$$= -[\left((WaterUseESTAR * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{3{,}412})\right)$$

$$+ \left((WaterUseESTAR * RacksWashed * Days) * (\frac{\frac{\Delta Tin * 1.0 * 8.2}{EffHeater}}{3{,}412})\right)$$

$$+ \left(IdleDrawESTAR * \left((Hours * Days) - \left(Days * RacksWashed * \frac{WashTime}{60}\right)\right)\right)]$$

MEASURE CODE: CI-FSE-ESDW-V10-260101

REVIEW DEADLINE: 1/1/2029

4.2.7 ENERGY STAR Fryer

DESCRIPTION

This measure applies to electric or natural gas fired ENERGY STAR[250] certified fryers installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the installed equipment must be an ENERGY STAR certified fryer meeting idle energy rate (W or Btu/hr)) and cooking efficiency (%) limits, as determined by both fuel type and fryer capacity (standard versus large vat).

ENERGY STAR Requirements (Version 3.0, Effective October 1, 2016)

Fryer Capacity	Electric Efficiency Requirements		Natural Gas Efficiency Requirements	
	Idle Energy Rate	Cooking Efficiency Consumption	Idle Energy Rate	Cooking Efficiency Consumption
Standard Open Deep-Fat Fryer	≤ 800 W	≥ 83%	≤ 9,000 Btu/hr	≥ 50%
Large Vat Open Deep-Fat Fryer	≤ 1,100 W	≥ 80%	≤ 12,000 Btu/hr	

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a new electric or natural gas fryer that is not ENERGY STAR certified.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[251]

DEEMED MEASURE COST

For the incremental capital costs, please see the table below:[252]

Fuel Source	Size	Incremental Cost
Electric	Standard	$1,500
	Large Vat	$500
Natural Gas	Standard	$1,000
	Large Vat	$2,000

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is assumed to be 0.90.[253]

[250] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[251] Lifetime from ENERGY STAR Commercial Kitchen Equipment Savings Calculator 03-2021,which cites reference as "FSTC research on available models, 2009.
[252] Measure cost from ENERGY STAR Commercial Kitchen Equipment Savings Calculator (last updated March 2021) which cites reference as "Difference between a similar ENERGY STAR and non-qualifying model, EPA research using AutoQuotes, October 2020".
[253] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC AND FOSSIL FUEL ENERGY SAVINGS

Non-Fuel Switch Measures

The algorithm below applies to ENERGY STAR compared to baseline electric fryer:

$$\Delta kWh = (\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days / 1{,}000$$

The algorithm below applies to ENERGY STAR compared to baseline gas fryer:

$$\Delta Therms = (\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days / 100{,}000$$

Fuel Switch/Electrification Measures:

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

$$SiteEnergySavings\ (MMBTUs) = [GasConsumptionReplaced] - [ElectricConsumptionAdded]$$

$$= [(DailyIdleEnergy_{GasBase} + DailyPreheatEnergy_{GasBase} + DailyCookingEnergy_{GasBase}) * 1/1{,}000{,}000 * Days] -$$

$$[(DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE}) * 3.412/1{,}000{,}000 * Days]$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

$$\Delta DailyIdleEnergy = (Idle_{Base} * ((HOURS - (PreheatTime/60)) - LB/PC_{Base})) - (Idle_{ESTAR} * ((HOURS - (PreheatTime/60)) - LB/PCESTAR))$$

$$\Delta DailyPreheatEnergy = (PreheatEnergy_{Base} - PreheatEnergy_{ESTAR}) * 1{,}000$$

$$\Delta DailyCookingEnergy = (LB * EFOOD/Eff_{Base}) - (LB * EFOOD/Eff_{ESTAR})$$

$$DailyIdle\ Energy_{GasBase} = (Idle_{BaseGas} * ((HOURS - (PreheatTime/60)) - LB/PC_{BaseGas}))$$

DailyCooking Energy$_{GasBase}$= $(LB * EFOOD / Eff_{BaseGas})$

DailyIdle Energy$_{ElecEE}$ =$(Idle_{ESTARElec} * ((HOURS - (PreheatTime/60)) - LB/PC_{ESTARElec}))$

DailyCooking Energy$_{ElecEE}$ = $(LB * EFOOD / Eff_{ESTAR})$

Where[254]:

Idle$_{Base}$ = Idle energy rate of baseline fryer

Fryer Type	Idle$_{Base}$
Electric Standard	1,200 W/h
Electric Large Vat	1,350 W/h
Natural Gas Standard	14,000 Btu/h
Natural Gas Large Vat	16,000 Btu/h

Idle$_{ESTAR}$ = Idle energy rate of ENERGY STAR electric fryer

= Actual, if unknown use:

Fryer Type	Idle$_{ESTAR}$
Electric Standard	800 W/h
Electric Large Vat	1,100 W/h
Natural Gas Standard	9,000 Btu/h
Natural Gas Large Vat	12,000 Btu/h

HOURS = Average daily hours of operation

= Actual or if unknown, use 16 hours per day for a standard fryer and 12 hours per day for a large vat fryer

PreheatTime = Time required to preheat the fryer

= 15 minutes per day

60 = minutes to hours conversion factor

LB = Food cooked per day

= Actual or if unknown, use 150 pounds

PC$_{Base}$ = Production capacity of baseline fryer (lb/h)

Fryer Type	PC$_{Base}$ (lb/h)
Electric Standard	65
Electric Large Vat	100
Natural Gas Standard	60
Natural Gas Large Vat	100

PC$_{ESTAR}$ = Production capacity of ENERGY STAR fryer

= Actual or if unknown, use

[254] Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator (last updated March 2021).

Fryer Type	PC_{Base} (lb/h)
Electric Standard	70
Electric Large Vat	110
Natural Gas Standard	65
Natural Gas Large Vat	110

$PreheatEnergy_{Base}$ = Total energy used during preheat of baseline fryer

= 2.4 kWh for electric fryers and 18,500Btu for gas fryers

$PreheatEnergy_{ESTAR}$ = Total energy used during preheat of ENERGY STAR fryer

= Actual, or if unknown assume 1.9 kWh for electric fryers and 16,000Btu for gas fryers

EFOOD = ASTM energy to food

= 167 Wh/lb for electric fryers and 570 Btu/lb for gas fryers

Eff_{Base} = Cooking efficiency of baseline electric fryer

Fryer Type	Eff_{Base}
Electric Standard	75%
Electric Large Vat	70%
Natural Gas Standard	35%
Natural Gas Large Vat	35%

Eff_{ESTAR} = Cooking efficiency of ENERGY STAR electric fryer

= Actual or if unknown use:

Fryer Type	Eff_{ESTAR}
Electric Standard	83%
Electric Large Vat	80%
Natural Gas Standard	50%
Natural Gas Large Vat	50%

Days = Annual days of operation

= Custom, or if unknown, use 365.25 days per year

1,000 = Wh to kWh conversion factor

100,000 = Btu to therms conversion factor

For example, an ENERGY STAR standard-sized electric fryer, using default values from the calculation above, would save:

ΔkWh =$(\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days$ /1,000

Where:

ΔDailyIdleEnergy = (1,200 * ((16 – 15/60) – 150 / 65)) - (800 * ((16 – 15/60) – 150 / 70))
= 5,245 Wh

ΔDailyPreheatEnergy = (2.4 - 1.9) * 1,000
= 500 Wh

ΔDailyCookingEnergy = (150 * 167/ 0.75) - (150 * 167/ 0.83)
= 3,219 Wh

ΔkWh = (5,245 + 500 + 3,219) * 365.25 / 1,000
= 3,274.2 kWh

[Electric Large Vat using defaults = 2,697.6 kWh]

For example, an ENERGY STAR standard-sized gas fryer, using default values from the calculation above, would save:

ΔTherms = $(\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days$ /100,000

Where:

ΔDailyIdleEnergy = (14,000 * ((16 – 15/60) – 150 / 60)) - (9,000 * ((16 – 15/60) – 150 / 65))
= 64,519 Btu/day

ΔDailyPreheatEnergy = 18,500 – 16,000
= 2,500 Btu/day

ΔDailyCookingEnergy = (150 * 570/ 0.35) - (150 * 570/ 0.50)
=73,286 Btu/day

ΔTherms = (64,519 + 2,500 + 73,286) * 365.25 / 100,000
= 512.5 therms

[Gas Large Vat using defaults = 420.6 therms]

An ENERGY STAR standard-sized electric fryer compared to baseline gas fryer assuming default values from above would save.

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricConsumptionAdded]$

= $[(DailyIdleEnergy_{GasBase} + DailyPreheatEnergy_{GasBase} + DailyCookingEnergy_{GasBase}) * 1/1{,}000{,}000 * Days] -$

$[(DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE}) * 3.412/1{,}000{,}000 * Days]$

DailyIdleEnergy$_{GasBase}$ = (14,000 * ((16 – 15/60) – 150 / 60))

= 185,500 btu

DailyPreheatEnergy$_{GasBase}$ = 18,500 btu

DailyCookingEnergy$_{GasBase}$ = (150 * 570/ 0.35)

= 244,286 btu

DailyIdleEnergy$_{ElecEE}$ = (800 * ((16 – 15/60) – 150 / 70))

= 10,886 Wh

DailyPreheatEnergy$_{ElecEE}$ = 1.9 * 1,000

= 1,900 Wh

DailyCookingEnergy$_{ElecEE}$ = (150 * 167/ 0.83)

= 30,181 Wh

SiteEnergySavings (MMBTUs) = ((185,500 + 18,500 + 244,286) * 1/1,000,000 * 365.25) – ((10,886 + 1,900 + 30,181) * 3.412/1,000,000 * 365.25)

= 110 MMBtu

If supported by an electric utility: ΔkWh = ΔSiteEnergySavings * 1,000,000 / 3,412

= 110 * 1,000,000/3,412

= 32,239 kWh

[Using Large Vat defaults = 103 MMBtu or 30,188 kWh]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $((\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy)/(1{,}000 * HOURS) * CF$

ΔkW = $-((DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE})/(1{,}000 * HOURS) * CF$

Where:

CF =Summer Peak Coincidence Factor

= 0.90[255]

[255] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

Other variables as defined above.

For example, an ENERGY STAR standard-sized electric fryer in a cafeteria, using default values from the calculation above, would save:

$$\Delta kW = (5{,}245 + 500 + 3{,}219)/(1000 * HOURS) * CF$$
$$= 8964 / (1000 * 16) * 0.9$$
$$= 0.504\ kW$$

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

$$\Delta Therms = [Gas\ Cooking\ Consumption\ Replaced]$$
$$= [(DailyIdleEnergy_{GasBase} + DailyPreheatEnergy_{GasBase} + DailyCookingEnergy_{GasBase}) * 1/100{,}000 * Days]$$

$$\Delta kWh = [Electric\ Cooking\ Consumption\ Added]$$
$$= -[(DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE}) * Days/\ 1{,}000]$$

MEASURE CODE: CI-FSE-ESFR-V07-260101

REVIEW DEADLINE: 1/1/2028

4.2.8 Griddle

DESCRIPTION

This measure applies to single or double-sided electric, natural gas fired, or dual fuel griddles installed in a commercial kitchen. For dual fuel griddles, savings should be calculated for electric and gas separately, then combined as described in the Fossil Fuel Savings section of this measure.

This measure was developed to be applicable to the following program types: TOS, NC, ER. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure case is described as a new single or double-sided natural gas, electric, or dual fuel griddle with a tested heavy load cooking energy efficiency and idle energy rate per square foot of cooking surface as defined below, utilizing ASTM F1275 for single-sided griddles, or ASTM F1605 for double-sided griddles.

	Electric	Gas
Cooking Efficiency	≥70%	≥38%
Idle Energy Rate (per square foot)	320 W/sqft	2,650 Btu/hr/sqft

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is described as a new or existing single or double-sided natural gas, electric, or dual fuel griddle with a tested cooking efficiency less than and an idle energy rate greater than the values defined above, as determined by lab testing in accordance with ASTM F1275 for single-sided griddles, or ASTM F1605 for double-sided griddles.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[256]

DEEMED MEASURE COST

The cost for this measure is provided in the table below:[257]

Equipment Type	Baseline Cost	Efficient Cost	Incremental Cost
Gas	$3,253	$3,570	$317
Electric	$2,819	$3,531	$712

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is assumed to be 0.90.[258]

[256] Lifetime from ENERGY STAR Commercial Kitchen Equipment Calculator, Commercial Griddle Calculations, which cites reference as "FSTC research on available models, 2009".
[257] Measure cost from CAeTRM support document "SWFS004_Cost_Analysis_2024-04-10.xlsx."
[258] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

Algorithm

CALCULATION OF SAVINGS [259]

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

Non-Fuel Switch Measures

The algorithm below applies to ENERGY STAR compared to baseline electric griddles:

$$\Delta kWh = (\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days\ /1000$$

The algorithm below applies to ENERGY STAR compared to baseline gas griddles:

$$\Delta Therms = (\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days\ /100{,}000$$

Fuel Switch/Electrification Measures:

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

$$\text{SiteEnergySavings (MMBTUs)} = [GasConsumptionReplaced] - [ElectricConsumptionAdded]$$

$$= [(DailyIdleEnergy_{GasBase} + DailyPreheatEnergy_{GasBase} + DailyCookingEnergy_{GasBase}) * 1/1{,}000{,}000 * Days] -$$

$$[(DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE}) * 3.412/1{,}000{,}000 * Days]$$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported by:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

$$\Delta DailyIdleEnergy = [(Idle_{Base} * Width * Depth * (HOURSday - (LB/(PC_{Base} * Width * Depth) - (PreheatNumber_{Base} * PreheatTime_{Base}/60))] - [(Idle_{EE} * Width * Depth * (HOURSday - (LB/(PC_{EE} * Width * Depth) - (PreheatNumber_{EE} * PreheatTime_{EE}/60))]$$

[259] Algorithms and assumptions derived from ENERGY STAR Griddle Commercial Kitchen Equipment Savings Calculator.

ΔDailyPreheatEnergy = $(PreHeatNumber_{Base} * PreheatEnergy_{Base} * Width * Depth) - (PreheatNumber_{EE} * PreheatEnergy_{EE} * Width * Depth)$

ΔDailyCookingEnergy = $(LB * EFOOD / Eff_{Base}) - (LB * EFOOD / Eff_{EE})$

DailyIdle Energy$_{GasBase}$ =$[(Idle_{BaseGas} * Width * Depth * (HOURSday - (LB/(PC_{BaseGas} * Width * Depth)) - (PreheatNumber_{Base} * PreheatTime_{Base}/60)]$

DailyPreheatEnergy$_{GasBase}$=$(PreheatNumber_{Base} * PreheatEnergy_{BaseGas} * Width * Depth)$

DailyCooking Energy$_{GasBase}$= $(LB * EFOOD / Eff_{BaseGas})$

DailyIdle Energy$_{ElecEE}$ =$[(Idle_{EEElec} * Width * Depth * (HOURSday - (LB/(PC_{EEElec} * Width * Depth)) - (PreheatNumber_{EE} * PreheatTime_{EE}/60]$

DailyPreheat Energy$_{ElecEE}$ = $(PreheatNumber_{EE} * PreheatEnergy_{EE} * Width * Depth)$

DailyCooking Energy$_{ElecEE}$ = $(LB * EFOOD / Eff_{EEElec})$

For double-sided dual fuel griddles, calculate the reduced energy consumption for both gas and electric operations using the values provided in the tables below.

Where[260]:

$Idle_{Base}$ = Idle energy rate of baseline griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Electric (W/sqft)	Gas (Btu/hr/sqft)
Single-Sided	372	3,290
Double Sided Electric	469	N/A
Double Sided Dual Fuel	320	2,650

$Idle_{EE}$ = Idle energy rate of efficient griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Electric (W/sqft)	Gas (Btu/hr/sqft)
Single-Sided	261	2,263
Double Sided Electric	289	N/A
Double Sided Dual Fuel	171	1,108

[260] Assumptions are calculated based on Proprietary Data: Frontier Energy Food Service Tech Center – Frontier_Griddles_DataComparisonTables.xlsx in combination with "Griddles_QPL_Equipment_Data_2026.xlsx." Due to a lack of available data, baseline values for Double Sided Dual Fuel equipment assumptions have been set equal to the values for the single-sided equivalent griddle for each fuel type, or the summation of the two wherever appropriate. Where the single-sided equivalent exceeds the efficient equipment requirements, the baseline is assumed to be just below the minimum efficiency threshold. This assumption has been deemed conservative and may be adjusted in the future if additional data becomes available.

LB = Food cooked per day

= Actual or if unknown, use 100 pounds

Width = Griddle Width

= Actual or if unknown, use 3 feet

Depth = Griddle Depth

= Actual or if unknown, use 2 feet

PC_{Base} = Production Capacity of the baseline griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Production Capacity (lbs/hr/sqft)
Single-Sided Gas	6.3
Single-Sided Electric	4.8
Double Sided Electric	13.7
Double Sided Dual Fuel	11.1

PC_{EE} = Production Capacity of the efficient griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Production Capacity (lbs/hr/sqft)
Single-Sided Gas	7.7
Single-Sided Electric	6.6
Double Sided Electric	13.1
Double Sided Dual Fuel	12.7

$PreheatNumber_{Base}$ = Number of preheats per day of the baseline griddle

= Actual or if unknown, use 1$PreheatNumber_{EE}$ = Number of preheats per day of the efficient griddle

= Actual or if unknown, use 1$PreheatTime_{Base}$ = preheat length base (mins)

= Actual or if unknown, use 15 minutes

$PreheatTime_{EEE}$ = preheat length of the efficient griddle (mins)

= Actual or if unknown, use 15 minutes

$PreheatEnergy_{Base}$ = Preheat Energy of the baseline griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Electric (W/sqft)	Gas (Btu/sqft)
Single-Sided	463	3,569
Double Sided Electric	752	N/A
Double Sided Dual Fuel	433	2,622

$PreheatEnergy_{EE}$ = Preheat Energy of the efficient griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Electric (W/sqft)	Gas (Btu/sqft)
Single-Sided	433	2,622
Double Sided Electric	642	N/A
Double Sided Dual Fuel	382	2,418

EFOOD = ASTM energy to food

= 139 w/pound for electric and 475 btu/pound for gas

EffBase = Cooking Efficiency of the baseline griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Electric Efficiency (%)	Gas Efficiency (%)
Single-Sided	65	32
Double Sided Electric	68	N/A
Double Sided Dual Fuel	69	45

Eff_{EE} = Cooking Efficiency of the efficient griddle

= Actual or if unknown, use the values provided below for the associated fuel type. For double-sided dual fuel calculations, calculate both electric and gas savings.

Equipment Type	Electric Efficiency (%)	Gas Efficiency (%)
Single-Sided	77	45
Double Sided Electric	79	N/A
Double Sided Dual Fuel	79	54

HOURSday = Average Daily Operation

= Actual or if unknown, use 12 hours

Days = Annual days of operation

= Actual or if unknown, use 365.25 days a year

For dual fuel griddles, use the specified assumptions above to calculate savings for both electric and gas savings components for a sum of total savings.[261]

[261] Duel fuel griddles are usually electric top plates and gas bottom plates, often used by fast food restaurants. As per DOE workpaper "Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances (2015 Update)" these models have a “second heating plate that is lowered on top of the food and used to simultaneously cook both sides." It therefore is reasonable to calculate gas and electric savings separately then combine for total savings.

For example, an efficient single-sided electric griddle with a tested heavy load cooking energy efficiency of 77 percent and an idle energy rate of 261 W per square foot of cooking surface or less, compared to the baseline electric griddle would save:

ΔDailyIdleEnergy	=(372 * 3 * 2 * (12 - (100/(4.8 * 3 * 2))-(1 * 15/60))) - (261 * 3 * 2 * (12 - (100/(6.6 * 3 * 2))-(1 * 15/60)))
	= 4030 W
ΔDailyPreheatEnergy	= (1* 463 * 3 * 2) – (1* 433 * 3 * 2)
	= 180 W
ΔDailyCookingEnergy	= (100 * 139 / 0.65) - (100 * 139 / 0.77)
	= 3333 W
ΔkWh	= (180+3333+5310) * 365.25 /1000
	= 3223 kWh

For example, an efficient single-sided gas griddle with a tested heavy load cooking energy efficiency of 45 percent and an idle energy rate of 2,263 Btu/h per square foot of cooking surface, compared to the baseline gas griddle would save:

ΔDailyIdleEnergy	= (3290 * 3 * 2 * (12 - (100/(6.3 * 3 * 2)) - (1 * 15/60))) - (2263 * 3 * 2 * (12 - (100/(7.7 * 3 * 2))- (1 * 15/60)))
	= 49,571 Btu
ΔDailyPreheatEnergy	= (1 * 3569 * 3 * 2) – (1* 2622 * 3 * 2)
	= 5,682 Btu
ΔDailyCookingEnergy	= (100 * 475/ 0.32) - (100 * 475/ 0.45)
	= 42,882 Btu
ΔTherms	= (49571 + 5682 + 42882) * 365.25 /100000
	= 358 therms

For example, an efficient double-sided dual fuel griddle compared to the baseline double-sided dual fuel griddle would save:

$\Delta DailyIdleEnergy_{Elec}$	= (320 * 3 * 2 * (12 - (100/(11.1 * 3 * 2) – 1 * 15/60))) - (171 * 3 * 2 * (12 - (100/(12.7 * 3 * 2) – 1 * 15/60)))
	= 9,415 Wh
$\Delta DailyPreheatEnergy_{Elec}$	= (1 * 433 * 3 * 2) – (1* 382 * 3 * 2)
	= 306 Wh
$\Delta DailyCookingEnergy_{Elec}$	= (100 * 139/ 0.69) - (100 * 139/ 0.79)
	= 2,550 Wh
ΔkWh	= (9415 + 306 + 2550) * 365.25 /1000
	= 4,482 kWh
	AND
$\Delta DailyIdleEnergy_{Gas}$	= (2650 * 3 * 2 * (12 - 100/(11.1 * 3 * 2) - 1 * 15/60)) - (1108 * 3 * 2 * (12 - 100/(12.7 * 3 * 2) - 1* 15/60))
	= 93,562 Btu
$\Delta DailyPreheatEnergy_{Gas}$	= (1 * 2622 * 3 * 2) – (1* 2418 * 3 * 2)
	= 1,224 Btu
$\Delta DailyCookingEnergy_{Gas}$	= (100 * 475/ 0.45) - (100 * 475/ 0.54)
	= 17,593 Btu
ΔTherms	= (93562 + 1224 + 17593) * 365.25 /100000
	= 410 Therms

An efficient electric griddle compared to baseline gas griddle assuming default values from above would save.

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricConsumptionAdded]$

$$= [(DailyIdleEnergy_{GasBase} + DailyPreheatEnergy_{GasBase} + DailyCookingEnergy_{GasBase}) * 1/1{,}000{,}000 * Days] - [(DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE})) * 3.412/1{,}000{,}000 * Days]$$

DailyIdleEnergy$_{GasBase}$ = (3290 * 3 * 2 * (12 - (100/(6.3 * 3 * 2)) - (1 * 15/60)))

= 179,723 btu

DailyPreheatEnergy$_{GasBase}$ = (1 * 3,569 * 3 * 2)

= 21,414 btu

DailyCookingEnergy$_{GasBase}$ = (100 * 475/ 0.32)

= 148,438 btu

DailyIdleEnergy$_{ElecEE}$ = (261 * 3 * 2 * (12 - (100/(6.6 * 3 * 2)) - (1 * 15/60)))

= 14,446 Wh

DailyPreheatEnergy$_{ElecEE}$ = (1* 433 * 3 * 2)

= 2,598 Wh

DailyCookingEnergy$_{ElecEE}$ = (100 * 139 / 0.77)

= 18,052 Wh

SiteEnergySavings (MMBTUs) = ((179,723 + 21,414 + 148,438) * 1/1,000,000 * 365.25) – ((14,446 + 2,598 + 18,052) * 3.412/1,000,000 * 365.25)

= 83.9 MMBtu

If supported by an electric utility:

ΔkWh = ΔSiteEnergySavings * 1,000,000 / 3,412

= 83.9 * 1,000,000/3,412

= 24,590 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Non-fuel switch measures:

kW $= (\Delta IdleEnergy + \Delta PreheatEnergy + \Delta CookingEnergy) / (1{,}000 * HoursDay) * CF$

Fuel switch measures:

kW $= -((DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE}) / (1{,}000 * HoursDay) * CF$

For dual fuel griddles, use the specified assumptions to calculate savings for non-fuel switch and fuel switch measures for a sum of total savings.

Where:

CF =Summer Peak Coincidence Factor

= 0.90[262]

For example, an efficient griddle in a cafeteria with a tested heavy load cooking energy efficiency of 77 percent or greater and an idle energy rate of 261 W per square foot of cooking surface or less would save

= (180+3,333+5,310)/(1000 * 12) * 0.9

= 0.662 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = $[Gas\ Cooking\ Consumption\ Replaced]$

=$[(DailyIdleEnergy_{GasBase} + DailyPreheatEnergy_{GasBase} + DailyCookingEnergy_{GasBase}) * 1/100{,}000 * Days]$

ΔkWh = $[Electric\ Cooking\ Consumption\ Added]$

=$-[(DailyIdleEnergy_{ElecEE} + DailyPreheatEnergy_{ElecEE} + DailyCookingEnergy_{ElecEE}) * Days / 1{,}000]$

MEASURE CODE: CI-FSE-ESGR-V09-270101

REVIEW DEADLINE: 1/1/2029

[262] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

4.2.9 ENERGY STAR Hot Food Holding Cabinets

DESCRIPTION

This measure applies to electric ENERGY STAR[263] hot food holding cabinets (HFHC) installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR certified HFHC.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an electric HFHC that's not ENERGY STAR certified and at end of life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[264]

DEEMED MEASURE COST

The incremental capital cost for this measure is $1,000.[265]

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is assumed to be 0.90.[266]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Custom calculation below, otherwise use deemed values of 545 kWh.[267]

$$\Delta kWh = \frac{(IdleEnergyRateBase - IdleEnergyRateES) * HOURSday * Days}{1000}$$

Where:

IdleEnergyRateBase = Custom, otherwise
= 30 * V

V = Volume of HFHC (cubic feet)
= Custom, otherwise assume 15 cu ft

HOURSday = Average Daily Operation

[263] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[264] Lifetime from ENERGY STAR Commercial Kitchen Equipment Calculator, updated March 2024, Hot Food Holding Cabinet Calculations, which cites reference as "FSTC research on available models, 2009".
[265] Measure cost from ENERGY STAR Commercial Kitchen Equipment Calculator, updated March 2024, which cites reference as "EPA research using AutoQuotes, 2020".
[266] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.
[267] Algorithms and assumptions derived from ENERGY STAR Commercial Kitchen Equipment Savings Calculator, updated 2024.

= custom or if unknown, use 9 hours

Days = Annual days of operation

= custom or if unknown, use 365.25 days a year

IdleEnergyRateES = Custom, otherwise assume maximum ENERGY STAR Idle Energy Rate presented below. If volume is unknown assume 15 cu ft, resulting in 284W:

Cabinet Volume (cu ft)	Power (W)
V < 13	21.5 * V
13 ≤ V < 28	2*V+254
28 ≤ V	3.8*V+203.5

For example, if a full size HFHC, with a volume of 15 cubic ft, is installed the measure would save:

ΔkWh = ((15*30)-(2*V+254))*9*365.25/1,000

= (450 – 284)*9*365.25 /1,000

= 546 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{Hours} * CF$$

Where:

Hours = Hoursday *Days

= If unknown, use 9 * 365.25 = 3287 hours

CF =Summer Peak Coincidence Factor

= 0.90[268]

For example, if a full size HFHC, with a volume of 15 cubic feet, is installed in a cafeteria the measure would save:

= 545 kWh / (9*365.25)* 0.9

=0 .1492 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-ESHH-V06-260101

REVIEW DEADLINE: 1/1/2029

[268] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for Southern California Edison.

4.2.10 Ice Maker

DESCRIPTION

This measure relates to the installation of a new ENERGY STAR[269] qualified commercial ice machine. The ENERGY STAR label applied to air-cooled, cube-type machines including ice-making head, self-contained, and remote-condensing units. This measure could relate to the replacing of an existing unit at the end of its useful life, or the installation of a new system in a new or existing building.

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a new commercial ice machine meeting the minimum ENERGY STAR efficiency level standards.

ENERGY STAR Requirements (Version 3.0, Effective January 28, 2018)

ENERGY STAR Requirements for Air-Cooled Batch-Type Ice Makers			
Equipment Type	**Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)**	**ENERGY STAR Energy Consumption Rate (kWh/100 lbs ice)**	**Potable Water Use (gal/100 lbs ice)**
IMH	H < 300	≤ 9.20 - 0.01134H	≤ 20.0
	300 ≤ H < 800	≤ 6.49 - 0.0023H	
	800 ≤ H < 1500	≤ 5.11 - 0.00058H	
	1500 ≤ H ≤ 4000	≤ 4.24	
RCU	H < 988	≤ 7.17 – 0.00308H	≤ 20.0
	988 ≤ H ≤ 4000	≤ 4.13	
SCU	H < 110	≤ 12.57 - 0.0399H	≤ 25.0
	110 ≤ H < 200	≤ 10.56 - 0.0215H	
	200 ≤ H ≤ 4000	≤ 6.25	
ENERGY STAR Requirements for Air-Cooled Continuous-Type Ice Makers			
Equipment Type	**Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)**	**ENERGY STAR Energy Consumption Rate (kWh/100 lbs ice)**	**Potable Water Use (gal/100 lbs ice)**
IMH	H < 310	≤ 7.90 – 0.005409H	≤ 15.0
	310 ≤ H < 820	≤ 7.08 – 0.002752H	
	820 ≤ H ≤ 4000	≤ 4.82	
RCU	H < 800	≤ 7.76 – 0.00464H	≤ 15.0
	800 ≤ H ≤ 4000	≤ 4.05	
SCU	H < 200	≤ 12.37 – 0.0261H	≤ 15.0
	200 ≤ H < 700	≤ 8.24 – 0.005429H	
	700 ≤ H ≤ 4000	≤ 4.44	

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a commercial ice machine meeting federal equipment standards established January 28, 2018.

[269] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 9 years.[270]

DEEMED MEASURE COST

When available, the actual cost of the measure installation and equipment shall be used. The incremental capital cost for this measure is $250 for Batch-Type and Continuous-Type[271].

LOADSHAPE

Loadshape C23 - Commercial Refrigeration

COINCIDENCE FACTOR

The Summer Peak Coincidence Factor is assumed to equal 0.937.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWH = [(kWh_{base} - kWh_{ee}) / 100] * (DC * H) * 365.25$$

Where:

kWh_{base} = maximum kWh consumption per 100 pounds of ice for the baseline equipment

= calculated as shown in the table below using the actual Harvest Rate (H) of the efficient equipment[272].

kWh_{ee} = maximum kWh consumption per 100 pounds of ice for the efficient equipment

= actual if known. If unknown calculate as shown in the table below using the actual Harvest Rate (H) of the efficient equipment.

[270] Based on DOE Technical Support Document, 2014 as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

[271] Incremental costs from ENERGY STAR Commercial Kitchen Equipment Savings Calculator. Calculator cites EPA research using AutoQuotes, October 2020.

[272] Use the appropriate equipment type baseline and ice harvest rate range when calculating the savings for a CEE Tier Advanced ice maker.

Energy Consumption of Air-Cooled Batch-Type Ice Makers			
Ice Maker Type	**Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)**	**kWh_{Base}**	**kWh_{ESTAR}**
IMH	H < 300	10-0.01233H	≤ 9.20 - 0.01134H
	300 ≤ H < 800	7.05-0.0025H	≤ 6.49 - 0.0023H
	800 ≤ H < 1500	5.55-0.00063H	≤ 5.11 - 0.00058H
	1500 ≤ H ≤ 4000	4.61	≤ 4.24
RCU	H < 988	7.97-0.00342H	≤ 7.17 – 0.00308H
	988 ≤ H ≤ 4000	4.59	≤ 4.13
SCU	H < 110	14.79-0.0469H	≤ 12.57 - 0.0399H
	110 ≤ H < 200	12.42-0.02533H	≤ 10.56 - 0.0215H
	200 ≤ H ≤ 4000	7.35	≤ 6.25
Energy Consumption of Air-Cooled Continuous-Type Ice Makers			
Equipment Type	**Applicable Ice Harvest Rate Range (lbs of ice/24 hrs)**	**kWh_{Base}**	**kWh_{ESTAR}**
IMH	H < 310	9.19-0.00629H	≤ 7.90 – 0.005409H
	310 ≤ H < 820	8.23-0.0032H	≤ 7.08 – 0.002752H
	820 ≤ H ≤ 4000	5.61	≤ 4.82
RCU	H < 800	9.7-0.0058H	≤ 7.76 – 0.00464H
	800 ≤ H ≤ 4000	5.06	≤ 4.05
SCU	H < 200	14.22-0.03H	≤ 12.37 – 0.0261H
	200 ≤ H < 700	9.47-0.00624H	≤ 8.24 – 0.005429H
	700 ≤ H ≤ 4000	5.1	≤ 4.44

100 = conversion factor to convert kWhbase and kWhee into maximum kWh consumption per pound of ice.

DC = Duty Cycle of the ice machine

= 0.57[273]

H = Harvest Rate (pounds of ice made per day)

= Actual installed

365.25 = days per year

For example, a batch ice machine with an ice making head producing 450 pounds of ice would save

ΔkWH = [(5.9 – 5.5) / 100] * (0.57 * 450) * 365.25

= 440 kWh

[273]Duty cycle varies considerably from one installation to the next. TRM assumptions from Vermont, Wisconsin, and New York vary from 40 to 57%, whereas the ENERGY STAR Commercial Ice Machine Savings Calculator assumes a value of 75%. A field study of eight ice machines in California indicated an average duty cycle of 57% ("A Field Study to Characterize Water and Energy Use of Commercial Ice-Cube Machines and Quantify Saving Potential", Food Service Technology Center, December 2007). Furthermore, a report prepared by ACEEE assumed a value of 40% (Nadel, S., Packaged Commercial Refrigeration Equipment: A Briefing Report for Program Planners and Implementers, ACEEE, December 2002). The value of 57% was utilized since it appears to represent a high quality data source.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh \ / \ (HOURS \ * \ DC) \ * \ CF$

Where:

HOURS = annual operating hours

= 8766[274]

CF = 0.937

For example, an ice machine with an ice making head producing 450 pounds of ice would save

ΔkW = 440/(8766 * 0.57) * .937

= 0.083 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

While the ENERGY STAR labeling criteria require that certified commercial ice machines meet certain "maximum potable water use per 100 pounds of ice made" requirements, such requirements are intended to prevent equipment manufacturers from gaining energy efficiency at the cost of water consumptions. A review of the AHRI Certification Directory[275] indicates that approximately 81% of air-cooled, cube-type machines meet the ENERGY STAR potable water use requirement. Therefore, there are no assumed water impacts for this measure.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-ESIM-V09-270101

REVIEW DEADLINE: 1/1/2030

[274]Unit is assumed to be connected to power 24 hours per day, 365.25 days per year.
[275]AHRI Certification Directory, Automatic Commercial Ice Makers, Accessed on 7/7/10.

4.2.11 High Efficiency Pre-Rinse Spray Valve

DESCRIPTION

Pre-rinse spray valves use a spray of water to remove food waste from dishes prior to cleaning in a dishwasher. More efficient spray valves use less water thereby reducing water consumption, water heating cost, and waste water (sewer) charges. Pre-rinse spray valves include a nozzle, squeeze lever, and dish guard bumper. Pre-rinse spray valves are manually operated, and the frequency of use depends on the volume of dirty dishes washed at a facility. The primary impacts of this measure are water savings. Reduced hot water consumption saves either natural gas or electricity, depending on the type of energy the hot water heater uses.

This measure was developed to be applicable to the following program types: TOS, EREP, KITS and DI. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the new or replacement pre-rinse spray nozzle must have a maximum flow rate that meets program requirements.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment flow rate depends on program type. For TOS, the baseline equipment is a new pre-rinse spray valve with a maximum flow rate of 1.23 gpm or less.[276] For EREP and DI, the baseline equipment is an existing pre-rinse spray valve with an assumed flow rate of 2.14 gpm or less.[277]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 5 years.[278]

DEEMED MEASURE COST

When available, the actual cost of the measure (including labor where applicable) should be used. If unknown, the incremental cost of this measure for TOS programs is assumed to be $21.[279] For EREP, KITS and DI programs, the total installed cost is assumed to be $88.[280]

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

N/A

[276] Baseline for TOS programs is calculated using the maximum flow rate for each product class in 10 CFR 431.266, Energy Efficiency Program for Certain Commercial and Industrial Equipment weighted by estimated 2018 shipments for each product class from Table 3.6.1: U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015.
[277] Average flow rate of spray valve replaced through direct install programs from DNV-GL, "Impact Evaluation of National Grid Rhode Island C&I Prescriptive Gas Pre-Rinse Spray Valve Measure – Final Report," September 30, 2014, page 6-6.
[278]Measure life from U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015, page 8-13."
[279]Incremental measure cost based on CA eTRM Low-Flow Pre-Rinse Spray Valve Measure SWFS013-04, updated November 13, 2024.
[280] Total installed cost is the full equipment cost from CA eTRM Low-Flow Pre-Rinse Spray Valve Measure SWFS013-04, updated November 13, 2024.It is assumed that programs typically install spray valves only when other kitchen equipment is also being installed, and therefore, there are no additional labor costs associated with spray valve installations.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS (NOTE WATER SAVINGS MUST FIRST BE CALCULATED)

$$\Delta kWH = \frac{\Delta Water\ (gallons) * 8.33 * 1 * (Tout - Tin) * (\frac{1}{Eff_Elec} 1/EFF_Elec)}{3{,}412} * FLAG$$

Where:

ΔWater (gallons) = amount of water saved as calculated below

8.33 = specific mass in pounds of one gallon of water (lbm/gal)

1 = Specific heat of water: 1 Btu/lbm/°F

Tout = Water Heater Outlet Water Temperature

= custom, otherwise assume Tin + 70°F temperature rise from Tin[281]

Tin = Inlet Water Temperature

= custom, otherwise assume 50.7°F [282]

EFF_Elec = Efficiency of electric water heater supplying hot water to pre-rinse spray valve

=custom, otherwise assume 98%[283]

Flag = 1 if electric or 0 if gas

Time of Sale: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishments with a cafeteria with 70 degree temperature rise of water used by the pre-rinse spray valve that is heated by electric hot water saves annually :

ΔkWH = 14,040 * 8.33 * 1 * ((70+50.7) – 50.7) * (1/.98) /3,412 * 1

= 2,448kWh

Retrofit: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 2.14 gal/min flow at a large institutional establishments with a cafeteria with 70 degree temperature rise of water used by the pre-rinse spray valve that is heated by electric hot water equals:

ΔkWH = 65,146 * 8.33 * 1 * ((70+ 50.7) – 50.7) * (1/.98) /3,412 * 1

=11,360 kWh

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWhwater = \frac{\Delta Water\ (gallons)}{1{,}000{,}000} * Ewater\ total$$

Where:

[281] If unknown, assume a 70 degree temperature rise from Tin per Food Service Technology Center calculator assumptions to account for variations in mixing and water heater efficiencies.

[282] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[283] Electric water heaters have recovery efficiency of 98%, as sourced from available products on the AHRI Certification Directory.

$E_{water\ total}$ = IL Total Water Energy Factor (kWh/Million Gallons)

=5,010[284]

Time of Sale: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishment with a cafeteria equals

ΔWater (gallons) = (1.23 – 0.98) * 60 * 3 * 312

= 14,040 gal/yr

ΔkWh_{water} = 14,040/1,000,000*5,010

= 70 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta Therms = \frac{\Delta Water\ (gallons) * 8.33 * 1 * (Tout - Tin) * (\frac{1}{Eff_Gas} 1/EFF_Gas)}{100{,}000} * (1 - FLAG)$$

Where (new variables only):

EFF_Gas = Efficiency of gas water heater supplying hot water to pre-rinse spray valve

= custom, otherwise assume 80%[285]

Time of Sale: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishments with a cafeteria with 70 degree temperature of water used by the pre-rinse spray valve that is heated by fossil fuel hot water saves annually:

ΔTherms = 14,040 * 8.33 * 1 * ((70+50.7) - 50.7) * (1/0.80)/100,000 * (1-0)

= 102 Therms

Retrofit: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 2.14 gal/min flow at a busy large institutional establishments with a cafeteria with 70 degree temperature rise of water used by the pre-rinse spray valve that is heated by fossil fuel hot water saves annually:

ΔTherms = 65,146 * 8.33 * 1 * ((70+50.7) - 50.7) * (1/0.80)/100,000 * (1-0)

=475 Therms

WATER IMPACT CALCULATION[286]

$$\Delta Water\ (gallons) = (FLObase - FLOeff) * 60 * HOURSday * DAYSyear * ISR$$

Where:

FLObase = Base case flow in gallons per minute, or custom (Gal/min)

[284] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

[285] IECC 2015-2024, Table C404.2, Minimum Performance of Water-Heating Equipment

[286] In order to calculate energy savings, water savings must first be calculated

Time of Sale	Direct Install
1.23 gal/min[287]	2.14 gal/min[288]

FLOeff = Efficient case flow in gallons per minute or custom (Gal/min)

= 0.98 gal/min[289]

60 = Minutes per hour

HOURSday = Hours per day that the pre-rinse spray valve is used at the site, custom, otherwise:[290]

Application	Hours/day
Small, quick- service restaurants	1
Medium-sized casual dining restaurants	1.5
Large institutional establishments with cafeteria	3

DAYSyear = Days per year pre-rinse spray valve is used at the site, custom, otherwise 312 days/yr based on assumed 6 days/wk x 52 wk/yr = 312 day/yr.

ISR = in-service-rate, the percentage of units actually installed. For kits programs, if survey data is unavailable, use 0.466[291]. For all other programs use 1.0.

Time of Sale: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 1.23 gal/min flow at a large institutional establishment with a cafeteria equals

= (1.23 – 0.98) * 60 * 3 * 312

= 14,040 gal/yr

Retrofit: For example, a new spray nozzle with 0.98 gal/min flow replacing a nozzle with 2.14 gal/min flow at a large institutional establishments with a cafeteria equals

= (2.14 – 0.98) * 60 * 3 * 312

= 65,146 gal/yr

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[287]Baseline for TOS programs is calculated using the maximum flow rate for each product class in 10 CFR 431.266, Energy Efficiency Program for Certain Commercial and Industrial Equipment weighted by estimated 2018 shipments for each product class from Table 3.6.1: U.S. DOE, "Technical Support Document: Energy Efficiency Program for Consumer Products and Commercial and Industrial Equipment: Commercial Prerinse Spray Valves," December 2015.

[288] Average flow rate of spray valve replaced through direct install programs from DNV-GL, "Impact Evaluation of National Grid Rhode Island C&I Prescriptive Gas Pre-Rinse Spray Valve Measure – Final Report," September 30, 2014, page 6-6.

[289] A new pre-rinse spray valve is assumed to be 20% more efficient than the federal standard.

[290] Hours primarily based on PG& E savings estimates, algorithms, sources (2005), Food Service Pre-Rinse Spray Valves with review of 2010 Ohio Technical Reference Manual and Act on Energy Business Program Technical Resource Manual Rev05.

[291] Average ISR for pre-rinse spray valves distributed to ComEd Small Business Kit customers in CY2018, CY2019, and CY2020. ISR was calculated based on 262 telephone surveys from restaurant and fire station participants. Please see file "SB Kits Survey Analysis TRMv10 Support.xlsx"

MEASURE CODE: CI-FSE-SPRY-V10-270101

REVIEW DEADLINE: 1/1/2029

4.2.12 Infrared Charbroiler

DESCRIPTION

This measure applies to natural gas fired charbroilers that utilize infrared burners installed in a commercial kitchen

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas charbroiler with infrared burners.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas charbroiler without infrared burners.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[292]

DEEMED MEASURE COST

The incremental capital cost for this measure is $2173.[293]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Custom calculation below, otherwise use deemed value of 707 therms based on default values.[294]

$$\Delta Therms = \frac{(\Delta PreheatEnergy + \Delta CookingEnergy) * Days}{100{,}000}$$

$$\Delta\text{PreheatEnergy} = (PreheatRate_{Base} - PreheatRate_{EE}) * Preheats * \frac{PreheatTime}{60}$$

$$\Delta\text{CookingEnergy} = (InputRate_{Base} - InputRate_{EE}) * (Duty * Hours)$$

Where:

Days = Annual days of operation

[292] Lifecycle determined from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment.
[293] See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.
[294] Assumptions derived from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment, Section 4: Broilers.

= Custom or if unknown, use 312 days per year[295]

100,000 = Btu to therms conversion factor

$PreheatRate_{Base}$ = Preheat energy rate of baseline charbroiler

= 64,000 Btu/hr

$PreheatRate_{EE}$ = Preheat energy rate of infrared charbroiler

= Custom or if unknown, use 54,000 Btu/hr

Preheats = Number of preheats per day

= Custom or if unknown, use 1 preheat per day

PreheatTime = Length of one preheat

= Custom or if unknown, use 15 minutes per preheat[296]

60 = Minutes to hours conversion factor

$InputRate_{Base}$ = Input energy rate of baseline charbroiler

= 140,000 Btu/hr

$InputRate_{EE}$ = Input energy rate of infrared charbroiler

= Custom or if unknown, use 105,000 Btu/hr

Duty = Duty cycle of charbroiler (%)

= Custom or if unknown, use 80%[297]

Hours = Average daily hours of operation

= Custom or if unknown, use 8 hours per day

For example, using the default assumptions on the installation of an infrared charbroiler:

PreheatEnergy = (64,000 – 54,000) * 1 * (15 / 60)

= 2500 BTU/day

CookingEnergy = (140,000 – 105,000)*(.80*8)

= 224,000 BTU/day

ΔTherms = ((2,500 + 224,000) * 312) / 100,000

= 706.7 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[295]Typical annual operating time from FSTC Broiler Technology Assessment, Table 4.3.
[296]Typical preheat time from FSTC Broiler Technology Assessment.
[297] Duty cycle from FSTC Broiler Technology Assessment, Table 4.3.

MEASURE CODE: CI-FSE-IRCB-V04-250101

REVIEW DEADLINE: 1/1/2028

4.2.13 Rotisserie Oven

DESCRIPTION

This measure applies to efficient natural gas fired high efficiency rotisserie ovens utilizing infrared burners or design approaches that combine radiative heat exchangers and convection heating and installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new highly efficient natural gas rotisserie oven as defined by the program.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a new standard natural gas rotisserie oven.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[298]

DEEMED MEASURE COST

The incremental capital cost for this measure is $2,500.[299]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Custom calculation below based on Food Service Technology Center calculator, otherwise use deemed value of 599 therms, based on default values.

$$\Delta Therms = \frac{(InputRate_{Base} - InputRate_{EE}) * Duty * Days * HoursDay}{100{,}000}$$

Where:

$InputRate_{Base}$ = Energy input rate of baseline rotisserie oven (Btu/hr)

= Custom of if unknown, use 90,000 Btu/hr[300]

$InputRate_{EE}$ = Energy input rate of efficient rotisserie oven (Btu/hr)

[298] Lifecycle determined from Food Service Technology Center Gas Oven Life-Cycle Cost Calculator.
[299] Measure cost based on SWFS029-01_Rotisserie_Commercial_Supporting_Data_04212023.
[300] Median rated energy input for rotisserie ovens from FSTC Oven Technology Assessment, Section 7: Ovens, Table 7.2.

= Custom of if unknown, use 50,000 Btu/hr[301]

Duty = Duty cycle of rotisserie oven (%)

= Custom or if unknown, use 60%[302]

Days = Days per year rotisserie oven is operating

= Custom of if unknown assume 312 (6 days a week, 52 weeks per year) [303]

HoursDay = Typical daily operating hours of rotisserie oven

= Custom or if unknown, assume 8 hours[304]

100,000 = Btu to therms conversion factor

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-IROV-V05-270101

REVIEW DEADLINE: 1/1/2030

[301] Infrared energy input rate calculated based on efficient energy input rate of 50,000 Btu/hr, baseline cooking efficiency of 25%, and infrared cooking efficiency of 45%. Efficiencies and rates derived from FSTC Gas Rotisserie Oven Test Reports and FSTC Oven Technology Assessment.

[302] Duty cycle from Food Service Technology Center Oven Technical Assessment, Table 7.2.

[303] Typical operating hours based on oven operating schedule of 8 hours per day, 6 days per week, 52 weeks per year, provided in Food Service Technology Center Oven Technical Assessment, Table 7.2.

[304] Food Service Technology Center Oven Technical Assessment, Table 7.2.

4.2.14 Infrared Salamander Broiler

DESCRIPTION

This measure applies to natural gas fired high efficiency salamander broilers utilizing infrared burners installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas salamander broiler with infrared burners

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas salamander broiler without infrared burners

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[305]

DEEMED MEASURE COST

The incremental capital cost for this measure is $1,000.[306]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Custom calculation below based on Food Service Technology Center calculator, otherwise use deemed value of 240 therms, based on defaults.

$$\Delta Therms = \frac{(InputRate_{Base} - InputRate_{EE}) * Duty * Days * HoursDay)}{100{,}000}$$

Where:

$InputRate_{Base}$ = Rated energy input rate of baseline salamander broiler (Btu/hr)

= 38,500 Btu/hr[307]

[305] Lifecycle determined from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment.

[306] See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

[307] Median rated energy input for salamander broilers from FSTC Broiler Technology Assessment, Section 4: Broilers, Table 4.3.

$InputRate_{EE}$	= Rated energy input rate of infrared salamander broiler (Btu/hr)
	= Custom; or if unknown, use 24,750 Btu/hr[308]
Duty	= Duty cycle of salamander broiler (%)
	= Custom; or if unknown, use 70%[309]
Days	= Days per year salamander broiler is operating
	= Custom of if unknown assume 312 (6 days a week, 52 weeks per year) [310]
HoursDay	= Typical daily operating hours of salamander broiler
	= Custom; or if unknown, assume 8 hours[311]
100,000	= Btu to therms conversion factor

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-IRBL-V03-240101

REVIEW DEADLINE: 1/1/2028

[308] Calculated energy input rate based on baseline energy input rate of 38,500 Btu/hr, baseline cooking efficiency of 22.5%, and infrared cooking efficiency of 35%.
[309] Duty cycle from Food Service Technology Center Broiler Technical Assessment, Table 4.3.
[310] Typical operating hours based on oven operating schedule of 8 hours per day, 6 days per week, 52 weeks per year, provided in Food Service Technology Center Oven Technical Assessment, Table 7.2.
[311] Food Service Technology Center Broiler Technical Assessment, Table 4.3.

4.2.15 Infrared Upright Broiler

DESCRIPTION

This measure applies to natural gas fired high efficiency upright broilers utilizing infrared burners and installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas upright broiler with infrared burners.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas upright broiler without infrared burners.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[312]

DEEMED MEASURE COST

The incremental capital cost for this measure is $4,400.[313]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Custom calculation below based on Food Service Technology Center calculator, otherwise use deemed value of 943 therms based on default values.

$$\Delta Therms = \frac{(InputRate_{Base} - InputRate_{EE}) * Duty * Days * HoursDay}{100{,}000}$$

Where:

$InputRate_{Base}$ = Rated energy input rate of baseline upright broiler (Btu/hr)

= 144,000 Btu/hr[314]

[312] Lifecycle determined from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment.

[313] See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

[314] Baseline energy input rate calculated based on efficient energy input rate of 90,000 Btu/hr, baseline cooking efficiency of 25%, and infrared cooking efficiency of 40%.

$InputRate_{EE}$	= Rated energy input rate of infrared upright broiler (Btu/hr)
	= Custom; or if unknown, use 90,000 Btu/hr[315]
Duty	= Duty cycle of upright broiler (%)
	= Custom; or if unknown, use 70%[316]
Days	= Days per year upright broiler is operating
	= Custom of if unknown assume 312 (6 days a week, 52 weeks per year) [317]
HoursDay	= Typical daily operating hours of upright broiler
	= Custom; or if unknown, assume 8 hours[318]
100,000	= Btu to therms conversion factor

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-IRUB-V03-240101

REVIEW DEADLINE: 1/1/2028

[315] Median rated energy input for upright broilers from FSTC Broiler Technology Assessment, Section 4.0: Broiler, Table 4.3.
[316] Duty cycle from Food Service Technology Center Broiler Technical Assessment, Table 4.3.
[317] Typical operating hours based on oven operating schedule of 8 hours per day, 6 days per week, 52 weeks per year, provided in Food Service Technology Center Oven Technical Assessment, Table 7.2.
[318] Food Service Technology Center Broiler Technical Assessment, Table 4.3.

4.2.16 Kitchen Demand Ventilation Controls

DESCRIPTION

Installation of commercial kitchen demand ventilation controls that vary the ventilation based on cooking load and/or time of day.

IECC 2024 specifies that Kitchen Demand Control Ventilation is a mandatory compliance pathway for systems over 5,000 CFM of exhaust airflow and shall::

- Be configured to provide a minimum of 50% reduction in exhaust and replacement air system airflow rates
- Include controls necessary to modulate exhaust and replacement air system airflows in response to appliance operation and to maintain full capture an containment of smoke, effluent and combustion products during cooking and idle operation
- Be factory-built commercial exhaust hoods listed by a nationally recognized testing laboratory and shall have a maximum exhaust rate (CFM per foot of hood) as specified in the below table[319]:

TYPE OF HOOD	LIGHT-DUTY EQUIPMENT	MEDIUM-DUTY EQUIPMENT	HEAVY-DUTY EQUIPMENT	EXTRA-HEAVY-DUTY EQUIPMENT
Wall-mounted canopy	140	210	280	385
Single island	280	350	420	490
Double island (per side)	175	210	280	385
Eyebrow	175	175	NA	NA
Backshelf/Pass-over	210	210	280	NA

As a result, this measure is only applicable to new kitchens/systems under 5,000 CFM of exhaust airflow.

This measure was developed to be applicable to the following program types: NC, RF, TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a control system that varies the exhaust rate of kitchen ventilation (exhaust and/or makeup air fans) based on the energy and effluent output from the cooking appliances (i.e., the more heat and smoke/vapors generated, the more ventilation needed). There are three main demand control ventilation systems available that can achieve this type of modulation:

- Temperature sensors only. These systems ramp ventilation up and down based solely on the temperature from the cooking activity as measured in the ductwork or capture tank of the hood.
- Temperature and optical sensors. These systems offer the same functionality as systems with only temperature sensors plus the ability to change the ventilation rate based on the presence of smoke or steam.
- Temperature and infrared cooking sensors. These systems offer the same functionality as systems with only temperature sensors plus the ability to measure ventilation up and down based on when cooking starts.

[319] IECC 2024 – Table C03.7.5: Maximum Net Exhaust Flow Rate, CFM per Linear Foot of Hood Length

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is kitchen ventilation that has constant speed ventilation motor.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.[320]

DEEMED MEASURE COST

The incremental capital cost for this measure is:[321]

Measure Category	Incremental Cost $/HP of Fan
DVC Control Retrofit	$1,992
DVC Control New	$1,180

LOADSHAPE

Loadshape C23 - Commercial Ventilation

COINCIDENCE FACTOR

The measure has deemed peak kW savings therefore a coincidence factor does not apply.

Algorithm

CALCULATION OF SAVINGS

Annual energy use was based on monitoring results from five different types of sites, as summarized in PG&E Food Service Equipment work paper.

ELECTRIC ENERGY SAVINGS

kWh savings are assumed to be 4,423 kWh per horsepower of the fan.[322]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

kW savings are assumed to be 0.551 kW per horsepower of the fan.[323]

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = CFM * HP * Annual\ Heating\ Load\ /(Eff(heat) * 100{,}000)$$

Where:

CFM = the average airflow reduction with ventilation controls per hood

= 430 cfm/HP[324]

[320] "Commercial Kitchen Ventilation: An Energy Efficiency Program Administrator's Guide to Demand Control Ventilation", CEE, October 2010 (pg. 9). The 20-year measure life estimate is based on interviews with manufacturer and industry experts.
[321] The incremental costs were derived from Southern California Edison (SCE) program data on 72 demand control kitchen ventilation project installations between 2013 and 2017 (see; "SCE13CC008._Exhaust_Hood_DCKV_Exhaust_CFM_and_Cost_Field_Data.xlsx"). For reference, the baseline measure costs were factored out accordingly, being obtained from costs for five kitchen exhaust fans from RSMeans online in 2017. For more detail on the source of these cost estimates, please see the California eTRM – Exhaust Hood Demand Controlled Ventilation, Commercial measure (SWFS012-01), March 4, 2020.
[322] Based on data provided in Southern California Edison Workpaper "Commercial Kitchen Exhaust Hoods Demand Controlled Ventilation, June 11, 2014..
[323] Based on data provided in Southern California Edison Workpaper "Commercial Kitchen Exhaust Hoods Demand Controlled Ventilation, June 11, 2014. Normalized demand reduction over 11 sites was 0.612 kW/HP. Applying a 0.9 CF results in a coincident demand reduction of 0.551 kW/HP.
[324] Based on data provided in PGE Workpaper, Commercial Kitchen Demand Ventilation Controls, PGECOFST116, June 1, 2009. See 'Kitchen DCV.xls' for details.

HP = actual if known, otherwise assume 9.65 HP[325]

Annual Heating Load = Annual heating energy required to heat fan exhaust make-up air, Btu/cfm dependent on location:[326]

Zone	Annual Heating Load, Btu/cfm
1 (Rockford)	46,627
2-(Chicago)	39,688
3 (Springfield)	33,597
4-(Belleville)	20,991
5-(Marion)	22,128

Eff(heat) = Heating Efficiency

= actual if known, otherwise assume 80%[327]

100,000 = conversion from Btu to Therm

For example, a kitchen hood in Rockford, IL with a 9.65 HP ventilation motor

ΔTherms = 430 * 9.65*46,627 / (0.80 * 100,000)

= 2,418 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-VENT-V08-270101

REVIEW DEADLINE: 1/1/2028

[325] Average of 72 study sites in Southern California Edison Workpaper "Commercial Kitchen Exhaust Hoods Demand Controlled Ventilation, June 11, 2014.

[326] Hours are from Commercial Kitchen Demand Ventilation Controls (Average 17.8 hours a day 4.45 am to 10.30 pm). Savings for all locations were calculated using NCEI 15-yr HDD data, and properties of air at atmospheric conditions and room temperature. See reference file "Kitchen DCV rev2.0.xlsx"

[327] Work Paper WPRRSGNGRO301 CLEAResult"Boiler Tune-Up" which cites Focus on Energy Evaluation Business Programs: Deemed Savings Manual V1.0, PA Consulting, KEMA, March 22, 2010.

4.2.17 Pasta Cooker

DESCRIPTION

This measure applies to natural gas fired dedicated pasta cookers as determined by the manufacturer and installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas fired pasta cooker.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas fired stove where pasta is cooked in a pan.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12.[328]

DEEMED MEASURE COST

The incremental capital cost for this measure is $2,400.[329]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

The annual natural gas energy savings from this measure is a deemed value equaling 1380 Therms.[330]

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-PCOK-V03-240101

REVIEW DEADLINE: 1/1/2028

[328]See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.
[329]Ibid.
[330] See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.

4.2.18 Rack Oven - Double Oven

DESCRIPTION

This measure applies to natural gas fired high efficiency rack oven - double oven installed in a commercial kitchen.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a new natural gas rack oven - double oven with a baking efficiency ≥ 56%.[331]

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing natural gas rack oven – double oven with a baking efficiency <51%.[332]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years.[333]

DEEMED MEASURE COST

The incremental capital cost for this measure is $3,000.[334]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Custom calculation below, otherwise use deemed value of 585 therms based on default values.[335]

$$\Delta Therms = \Delta DailyPreheatEnergy + \Delta DailyIdleEnergy + \Delta DailyCookingEnergy) * Days/100{,}000$$

$$\Delta DailyPreheatEnergy = DailyPreheats * (PreheatEnergyBase - PreheatEnergyEE)$$

[331] Based on average test data per ASTM F2093 used in California Foodservice Rack Oven Memo 09202019 Attachment supporting the CAeTRM.
[332] Ibid.
[333] Lifecycle determined from Food Service Technology Center Gas Rack Oven Life-Cycle Cost Calculator and from FSTC Oven Technology Assessment.
[334]See 'Arkansas Deemed TRM Table for GasFoodService.xls' from v3.0 Arkansas Technical Reference Manual.
[335] Assumptions derived from Food Service Technology Center Gas Rack Oven Life-Cycle Cost Calculator, FSTC Oven Technology Assessment, Section 7: Ovens, and from FSTC Gas Double Rack Oven Test Reports.

$$\Delta DailyIdleEnergy = (IdleRateBase * (Hours - \frac{LB}{PCBase} - \frac{DailyPreheats*PreheatTime}{60})) - (IdleRateEE * (Hours - \frac{LB}{PCEE} - \frac{DailyPreheats*PreheatTime}{60}))$$

$$\Delta DailyCookingEnergy = \left(\frac{LB * EFOOD}{EffBase}\right) - \left(\frac{LB * EFOOD}{EffEE}\right)$$

Where[336]:

DailyPreheats	= Number of preheats per day
	= Custom; or if unknown, 1
$PreheatEnergy_{EE}$	= Preheat energy of energy efficient rack oven – double oven
	= Custom; or if unknown 65,758 Btu
$PreheatEnergy_{Base}$	= Preheat energy of baseline rack oven – double oven
	= Custom; or if unknown 90,009 Btu
$IdleRate_{EE}$	=Idle rate of energy efficient rack oven – double oven
	=Custom; or if unknown, 24,600 Btu/hr
$IdleRate_{Base}$	=Idle rate of baseline rack oven – double oven
	=Custom; or if unknown, 36,909 Btu/hr
LB	= Pounds of food cooked per day
	= Custom; or if unknown, 1,200 lb/day
PC_{EE}	= Production capacity of energy efficient rack oven – double oven
	= Custom; or if unknown, 279 lbs/hour
PC_{Base}	= Production capacity of baseline rack oven – double oven
	= Custom; or if unknown, 272 lbs/hour
PreheatTime	= Length of a single preheat
	= Custom; or if unknown, 20 minutes
60	= Conversion of minutes to hour
EFOOD	= ASTM energy to food ratio, the energy absorbed by food during cooking
	= 235 Btu/lb
Eff_{EE}	= Cooking efficiency of energy efficient rack oven – double oven
	= Custom; or if unknown, use 56%
Eff_{Base}	= Cooking efficiency of baseline rack oven – double oven
	= Custom; or if unknown, 51%
Days	= 365[337]
Hours	= Average daily hours of operation

[336] Unless noted otherwise, assumptions consistent with Southern California Gas Company (SCG). 2019. "Reformulated baseline efficiencies and eligibility requirements for Commercial Rack Oven workpaper SWFS014-01." Memorandum submitted to Peter Biermayer (Energy Division) and Sue Haselhorst (Ex Ante Review Team). September 18.

[337] Consistent with the ENERGY STAR Commercial Food Service Equipment Calculator, updated March 2024.

= Custom; or if unknown, use 12 hours[338]

100,000 = Btu to therms conversion factor

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE CI-FSE-RKOV-V04-240101

REVIEW DEADLINE: 1/1/2028

[338] Typical operating hours based on oven operating schedule of 12 hours per day provided in FSTC Gas Double Rack Oven Test Reports on various double rack ovens.

4.2.19 ENERGY STAR Electric Convection Oven – Removed in v11, consolidated with 4.2.5 ENERGY STAR Convection Oven

4.2.20 Efficient Dipper Wells

DESCRIPTION

Various commercial food establishments utilize dipper wells that continuously run fresh water over utensils. One example is an ice cream shop that places the ice cream scooper in the dipper well, in order to keep them clean and avoid cross-mixing of flavors. Some restaurants may utilize a dipper well to store potato slicers and butter-ball scoopers. Coffee shops often utilize a dipper well for storage of drink thermometers and mixing spoons. Bars may utilize a dipper well for storage of mixing spoons, strainers, ice tongs, and other utensils. Dipper wells may also be found in grocery stores, school cafeterias, and other institutional kitchens.

Commercial kitchen equipment vendors have developed water-efficient dipper well designs which eliminate the continuous water flow. The efficient design recirculates the water in the well rather than continuously adding fresh water. For bacteriological control some designs utilize a chemical disinfectant (i.e., bleach) and some utilize ozone.

The calculated water savings (in gallons/year) will, in turn, be used to calculate electricity savings (in kWh/year) after applying the appropriate energy factor.

Heated dipper wells are not included in this characterization as the electric penalty associated with the electric resistance heating removes all potential electric savings due to water characterization.

This measure was developed to be applicable to the following program types; EREP and TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a dipper well that does not continuously run. One type of water-efficient dipper well design recirculates the water in the basin, rather than continuously adding fresh water. The efficient design will employ chemical or ozone sanitation.

Other types of water-efficient dipper well utilize a spatula or shower, where water is only applied to the surface of the utensil when a pressure switch is activated. The dimensions of water-efficient dipper wells will vary, depending on the number of utensils that need to be handled. The flow rate of the spigot is similar between the baseline equipment and the efficient equipment. However, that flow rate only occurs when the well initially fills up or the pressure switch is activated.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a dipper well providing continuously running fresh water to the utensils in the basin. As a result, there is a concurrent stream of wastewater that is continuously sent to the sewer. The dipper well typically will run during the hours of operation for the restaurant or bar. Some dipper wells will also be left on during the night when the establishment is closed.

Many dipper wells consist of two concentric tanks. Water flows into the inner tank and overflows through the perforations at the top to the outer tank, which is connected to the sewer drain. Other designs utilize just one tank, with some other means of overflow drainage to the sewer.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[339]

[339] Alignment with existing dipper well program measure lives in California. Dipper Well Replacement Field Evaluation Report, Frontier Energy, November 2017.
https://fishnick.com/publications/fieldstudies/Dipper_Well_Replacement_Field_Evaluation_ICP.pdf

DEEMED MEASURE COST

The cost for this measure is assumed to be $450 for Early Replacement or $300 for Time of Sale. The typical material cost for an efficient dipper well system is approximately $150 to $350.[340] The typical material cost for a baseline dipper well system is approximately $100 to $200.[341] Full installation costs, including plumbing materials, labor, and any associated controls, should be used for screening purposes.

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

Energy savings from the efficient dipper well systems are the result of reduced water consumption. There are indirect electric energy savings from reduced potable water treatment and wastewater treatment energy inputs.

ELECTRIC ENERGY SAVINGS

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

The electric energy savings are based indirectly on the reduced electricity usage used to provide the potable water and treat the wastewater. By applying an "Energy Factor", the water savings (in gallons/year) can be converted to electricity savings (in kWh/year). This "Energy Factor" considers the electric energy requirements of potable water treatment plants, potable water distribution, wastewater treatment plants, and wastewater distribution.

$$\Delta kWh_{water} = \Delta Water\ (gallons) \ / \ 1{,}000{,}000 \ * \ Ewater\ total$$

Where:

Ewater total = IL Total Water Energy Factor (kWh/Million Gallons)

=5,010[342]

[340] Google Shopping search for the term "water efficient dipper well". Results include the "Conservewell" from KaTom Restaurant Supply for $300.

[341] Google Shopping search for the term "dipper well system". Results show various baseline models that range from $100 to $200.

[342] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

For example,

BAWU = $(DWOH * AO) / (TFOG\ x\ 1\ hour/60\ min)$

= $[16\ hours/day] * [365\ day/year]$

$[0.5\ gal/min] * [1\ hour/60\ min]$

= $175{,}200\ gal/year$

ECAWU = $3{,}650\ gal/year$

ΔWater = $BAWU - ECAWU$

= $175{,}200\ gal/year - 3{,}650\ gal/year$

= $171{,}550\ gal/year$

ΔkWhwater = $\Delta Water\ /\ 1{,}000{,}000 * Ewater\ total$

= $(171{,}500\ gal.of\ water/year)\ /\ 1{,}000{,}000 * 5{,}010\ kWh/million\ gallons$

= $859\ kWh/year$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

The methodology for quantifying the water savings involves a direct comparison of the baseline equipment to the efficient equipment. The baseline flow rate will typically be between 0.2 gpm to 1.0 gpm.[343] The actual flow rate of the baseline equipment should be directly measured. This can be accomplished by recording the time required to fill a 1-gallon container (minutes per gallon); taking the inverse of that value will give the water flow rate (gallons per minute). The number of hours per day that the spigot remains flowing should be determined. This is typically coincident with the operating hours of the establishment, but the spigot could remain flowing during off hours too.

The equation for calculating the baseline annual water usage is as follows:

BAWU = $[DWOH * AO) / [TFOG\ x\ (1\ hour/60\ min)]$

Where:

BAWU = $Baseline\ Annual\ Water\ Usage\ (gal/year)$

DWOH = $Dipper\ Well\ Operating\ Hours\ (hours/day)$

AO = $Annual\ Operations\ (days/year)$

TFOG = $Time\ to\ Fill\ One\ Gallon\ (min/gal)$

Estimating the efficient-case water consumption will require an understanding of how the dipper well will be used. If the efficient-case equipment utilizes a constantly circulating pool of chemically treated water, then the only water consumption is that required to fill the basin. Depending on the number of times that the basin is filled and emptied in a day, the annual water consumption for the efficient case can be calculated as follows:

ECAWU = $BV * BFPD * AO$

Where:

[343] Michael Slater and Amin Delagah, "Dipper Well Replacement Field Evaluation Report", Frontier Energy Report #50115-R0, November 2017. Prepared for the Metropolitan Water District of Southern California. http://www.bewaterwise.com/pdfs/ICP/2015ICP-DipperWellFrontierEnergy.pdf

ECAWU = Efficient Case Annual Water Usage (gal/year)

BV = Basin Volume (gal)

BFPD = Basin Fills Per Day (days-1)

AO = Annual Operations (days/year)

If the efficient-case equipment utilizes a 'shower' that only dispenses water when the pressure switch is activated, the amount of water consumption is dependent on the number of times the 'shower' is actuated and the length of each 'shower'. The Spigot Flow Rate should be similar to that of the baseline equipment (0.2 gal/min to 1.0 gal/min). However, that flow rate is only in effect for the duration that the pressure switch is pressed. This is referred to as the Time of Actuation, and it can generally be estimated as a few seconds per push. Furthermore, the number of times the shower is actuated in a day can be estimated by considering the customer sales volume of the establishment.

The annual water consumption for the efficient case can also be calculated as follows:

$$ECAWU = (SFR\ x\ TA\ x\ NAPD)\ /\ (60\ sec/min\ x\ AO)$$

Where:

ECAWU = Efficient Case Annual Water Usage (gal/year)

SFR = Spigot Flow Rate (gal/min)

TA = Time of Actuation (sec/push)

NAPD = Number of Actuations per Day (push/day)

AO = Annual Operations (days/year)

For the purposes of this measure, the Efficient Case daily water usage of 10 gal/day will be used [344]. At 365 days/year of usage, the ECAWU will be 3,650 gal/year.

Finally, the annual water savings per year can be calculated as follows:

$$\Delta Water = BAWU\ -\ ECAWU$$

Where:

ΔWater = Total Water Savings (gal/year)

BAWU = Baseline Annual Water Usage (gal/year)

ECAWU = Efficient Case Annual Water Usage (gal/year)

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE CI-FSE-EDIP-V02-220101

REVIEW DEADLINE: 1/1/2028

[344] Michael Slater and Amin Delagah, "Dipper Well Replacement Field Evaluation Report", Frontier Energy Report #50115-R0, November 2017. Prepared for the Metropolitan Water District of Southern California. http://www.bewaterwise.com/pdfs/ICP/2015ICP-DipperWellFrontierEnergy.pdf

4.2.21 On-Demand Package Sealers – Provisional Measure

DESCRIPTION

This measure consists of the replacement of standard electric package sealers with new on-demand package sealers in a retail grocery store. The sealers are used for heat-sealing plastic-wrapped packages for retail sale. The typical baseline unit uses a 550-Watt heating element and 50 Watt heat sealing bar at about 280°F or greater and maintains that temperature unless the unit is turned off when not in use.[345] In practice, the units are frequently left on to avoid waiting for the bar to reach operating temperature. Qualifying units use on-demand heat bars or automatic controls that turn off the unit between uses. Different configurations and brands were tested for the baseline at two grocery store chains that included a total of 199 stores. [346] This measure applies to grocery store, convenience store, deli, bakery, butcher, and other commercial with a demonstrated business need.

This measure was developed to be applicable to the following program types: TOS, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The on-demand package sealer uses controls to turn the equipment off when it is not in use. The functionality of the baseline and on-demand system is similar. The on-demand package sealer operates similarly to the baseline but has a larger heating element. The on-demand package sealer utilizes an automatic control or pressure momentary switch control to power off the heating elements when the equipment is not in use. Controls for the on-demand unit allow the heating element to turn on only when the heating element is pushed down, or the product crosses the automatic controls. By applying pressure to the heating element or activating the automatic controls the on-demand unit engages a switch, which activates the 2,000-Watt heating element until the switch is disengaged, or for a maximum of 3 seconds. The efficient sealers use less energy overall by reducing standby electrical energy use. These machines come in stand-alone or table-top styles.

DEFINITION OF BASELINE EQUIPMENT

The baseline package sealer consists of a heating bar and a larger heating element and is rated at approximately 550 Watts and 0.50 kW, respectively. The heating bar is used to cut the wrapping film as it contacts the heating bar. The larger heating element is used to heat up the wrapping film. When the wrapping film is heated, the film sticks to a package to seal the product. With the conventional package sealer, both heating elements are controlled to keep a constant temperature of 280°F. The units are manually turned on and off. The baseline package sealers come in two styles, a stand-alone unit and a table-top unit.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[347]

DEEMED MEASURE COST

The deemed measure cost for this measure varies based on unit size and type. Please see the table[348] below for typical costs:

[345] Design & Engineering Services Customer Service Organization Southern California Edison, October 2012, Vacuum-Sealing and Packaging Machines For Food Service Applications Field Test Et10sce1450, pg 1.
[346] The October 2012 SCE field test (mentioned above) was a study based datalogger information over six weeks of units in 199 stores.
[347] Based on similar equipment types, as there is not a standard for shrink wrappers listed. The Illinois TRM v9's kitchen equipment measure lives range from 5-20 years. 70% of the kitchen equipment measures have a 12 year measure life, but half of these are gas-only measures. We used Efficient Dipper Wells' measure life of 10 years as both measures save energy by replacing continuously running equipment with equipment that only runs when needed. Both On-Demand Package Sealers and Efficient Dipper Wells also may have higher regular maintenance needs than the other Kitchen equipment - to prevent clogging.
[348] Commercial Vacuum Sealer costs – Manual (Baseline) & Automatic. Please see pdf of https://www.webstaurantstore.com/ data sets.

Equipment Category	Tabletop Unit	Floor Unit
Baseline	$2,492	$2,242
Efficient	$3,281	$12,208

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \left(\frac{(\text{Watts}_{\text{base}} * \text{HOU})}{1{,}000}\right) - \left(\left(\frac{(\text{Watts}_{\text{efficient}} * \text{HOU})}{1{,}000}\right) * (1 - \text{ESF})\right)$$

Where:

$\text{Watts}_{\text{base}}$ = Wattage of Existing Equipment's heating element
= If not known, use 600 W[349]

$\text{Watts}_{\text{efficient}}$ = Wattage of Proposed Efficient Equipment sealing element
= If not known, use 2,000 W[350]

HOU = Use known Hours of Use
= If hours not known, hours are selected from the fixture hours column of the Reference Table in Section 4.5 for each building type.

ESF = Energy Savings Factor
= If ESF not known, use 90% [351]

For example, a new on-demand package sealer replacing a baseline package sealer with unknown hours at a grocery store saves:

ΔkWh = ((600 * 5,468) / 1,000) – (((2,000 * 5,468) / 1,000) * (1 - 0.9))
= 2,187.2 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \frac{\Delta kWh}{HOU} * CF$$

[349] Design & Engineering Services Customer Service Organization Southern California Edison, October 2012, Vacuum-Sealing And Packaging Machines For Food Service Applications Field Test Et10sce1450 – Note: this was a study based datalogger information over six weeks of units in 199 stores.
[350] Ibid
[351] ESF assumes On-Demand Package Sealer is actively heating 10% of the Hours of Use. The ESF source assumption is that the On-Demand sealers will be in use an average of six minutes of every hour. Currently there is no logged data that captures the total amount of time the efficient machines run, however once we get that data is available from the program, this value will be updated.

Where:

CF = Coincident Factor, use 1.0.

For example, a new on-demand package sealer replacing a baseline package sealer with unknown hours at a grocery store saves:

ΔkWh = 2,187.2 / 5,468 * 1.0

= 0.40 kW

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-ODPS-V02-260101

REVIEW DEADLINE: 1/1/2029

4.2.22 Automatic Conveyor Broiler

DESCRIPTION

This measure applies to natural gas fired energy efficient automatic conveyor broiler installed in a commercial kitchen. Conveyor broilers are one of the most energy intensive appliances in a commercial kitchen and energy efficient automatic conveyor broilers have potential to save energy while providing similar capacities and reducing the heat load in a kitchen[352].

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To be eligible for rebates, the energy efficient natural gas fired automatic conveyor broiler must have a catalyst and an input rate less than 80 kBtu/hr or a dual stage or modulating valve with a capability of throttling the input rate below 80 kBtu/hr[353].

Natural gas fired energy efficient automatic conveyor broilers equipped with electric bun grills and/or electric heating/warming elements are eligible for electric energy savings.

DEFINITION OF BASELINE EQUIPMENT

The base case is defined as natural gas fired automatic conveyor broiler capable of maintaining a temperature above 600^{o}F and an idle rate greater than the energy efficient replacement.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years[354].

DEEMED MEASURE COST

The incremental capital cost varies based on the conveyor width[355]:

Conveyor Width (in)	IMC
18in	$4,767
26in	$2,729
30in	$1,711

LOADSHAPE

N/A

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is 0.90[356].

[352] "California eTRM: Automatic Conveyor Broiler, Commercial", November 13, 2024 https://www.caetrm.com/measure/SWFS017/04/

[353] "California eTRM: Automatic Conveyor Broiler, Commercial", November 13,2024 as well as "New York Standard Approach for Estimating Energy Savings from Energy Efficiency Programs: Conveyor Broiler", August 30th , 2021, Page 410.

[354] "California eTRM: Automatic Conveyor Broiler, Commercial", November 13, 2024https://www.caetrm.com/measure/SWFS017/04/

[355] Ibid.

[356] "California eTRM: Automatic Conveyor Broiler, Commercial", November 13,2024 https://www.caetrm.com/measure/SWFS017/04/

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Natural gas fired energy efficient automatic conveyor broilers equipped with electric bun grills and/or electric heating/warming elements are eligible for electric energy savings.

$$\Delta kWh = kWHbase - kWheff$$

$$kWh = ElectricalIDLE(kW) * HoursDAY * Days$$

Where:

$Electrical_{IDLE}(kW)$ = Electrical Idle Energy Rate. See table below[357]. If known, use actual.

Conveyor Width (in)	Baseline Idle Energy Rate (kW)	EE Idle Energy Rate (kW)
<20in	1.84	0.20
20in -26in	1.35	0.37
>26in	4.80	1.15

$Hours_{DAY}$ = Daily Operating Hours. See table below. If known, use actual.

Location	$Hours_{DAY}$
Smaller restaurants; 2nd broiler in 24-hr restaurant	8 hours[358]
24 hour restaurant	23 hours[359]

Days = Days per year of operation

= Actual, default =

Location	Days
Smaller restaurants; 2nd broiler in 24-hr restaurant	312 days[360]
24 hour restaurant	363 days[361]

For example, using the default assumptions on the installation of an efficient automatic conveyor broiler with a width less than 20 inches in a small restaurant:

kWh_{base} = 1.84 kW * 8 hours* 312 days

= 4,592.64 kWh

kWh_{eff} = 0.20 kW * 8 hours * 312 days

= 499.2 kWh

ΔkWh = 4592.64 kWh - 499.20 kWh

= 4,093.4 kWh

[357] Ibid.

[358] Assumptions derived from Food Service Technology Center Gas Broiler Life-Cycle Cost Calculator and from FSTC Broiler Technology Assessment, Section 4: Broilers.

[359] "California eTRM: Automatic Conveyor Broiler, Commercial", July 29th ,2021 https://www.caetrm.com/measure/SWFS017/02/

[360] Typical annual operating time from FSTC Broiler Technology Assessment, Table 4.3.

[361] "California eTRM: Automatic Conveyor Broiler, Commercial", July 29th ,2021 https://www.caetrm.com/measure/SWFS017/02/

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{AnnualHours} * CF$$

Where:

ΔkWh = Annual kWh savings from measure as calculated above.

$$AnnualHours = HoursDAY * Days$$

= Actual. If unknown, use values listed above.

CF = Summer Peak Coincidence Factor

= 0.90

FOSSIL FUEL SAVINGS

$$\Delta Therms = \Delta Idle\ Energy + \Delta Preheat\ Energy + \Delta Cooking\ Energy$$

$$\Delta Idle\ Energy = \frac{(Idle\ EnergyBase - Idle\ EnergyEE)}{100{,}000}$$

$$Idle\ EnergyBase = (HoursDAY - (\frac{LB}{PCBase}) - (\frac{PRETimeBase}{60})) * IDLEBase$$

$$Idle\ EnergyEE = (HoursDAY - (\frac{LB}{PCEE}) - (\frac{PRETimeEE}{60})) * IDLEEE$$

Where:

LB = pounds of food cooked per day (lb/day)

PC = Production capacity (lbs/hr)

PRE_{TIME} = Preheat time (min/day)

IDLE = Idle energy rate (Btu/hr)

If known, use actual values, otherwise see table below:[362]

Conveyor Width (in)	LB (lb/day)		PC (Lbs/hr)		PreTIME (Min)		IDLE (Btu/hr)	
	Base	EE	Base	EE	Base	EE	Base	EE
<20in	75		29	21	10	29	54,500	28,000
20in - 26in	150		48	42	8	16	78,120	47,960
>26in	110		90	86	22	12	104,000	57,000

$$\Delta Preheat\ Energy = \frac{(PREENERGYBase - PREENERGYEff)}{100{,}000}$$

Where:

PRE_{ENERGY} = Preheat energy (Btu)

$$\Delta Cooking\ Energy = \frac{(Cooking\ Energybase - Cooking\ EnergyEff)}{100{,}000}$$

[362] "California eTRM: Automatic Conveyor Broiler, Commercial", November 13, 2024 https://www.caetrm.com/measure/SWFS017/04/

$$Cooking\ Energybase\ = (\frac{LB}{PCBase}) * CookingRateBase$$

$$Cooking\ EnergyEE\ = (\frac{LB}{PCEE}) * CookingRateEE$$

$Cooking_{RateBase}$ = Baseline Cooking energy rate (Btu/hr)

$Cooking_{RateEE}$ = Efficient Cooking energy rate (Btu/hr)

If known, use actual values, otherwise see table below:[363]

Conveyor Width (in)	Pre_{ENERGY} (Btu)		$Cooking_{Rate}$ (Btu/hr)	
	Base	EE	Base	EE
<20in	11,500	13,500	55,000	28,500
20in - 26in	14,130	14,214	78,240	50,938
>26in	42,500	13,500	111,210	67,117

For example, using the default assumptions on the installation of an efficient automatic conveyor broiler with a width less than 20 inches in a small restaurant:

Idle $Energy_{base}$	= (8 - (75 / 29) - (10 / 60)) * 54,500
	= 285,968.4 Btu
Idle $Energy_{EE}$	= (8 – (75 / 21) – (29 / 60)) * 28,000
	= 110,466.7 Btu
ΔIdle Enery	= (285,968.4 – 110,466.7) / 100,000
	= 1.75 Therms
ΔPreheat Energy	= (11,500 – 13,500) /100,000
	= -0.02 Therms
Cooking $Energy_{base}$	= (75 / 29) * 55,000
	=142,241.4 Btu
Cooking $Energy_{EE}$	= (75 / 21) * 28,500
	= 101,785.7 Btu
ΔCooking Energy	= (142,241.4-101,785.7)/100,000
	= 0.4 Therms
ΔTherms	= (1.75 + -0.02 + 0.40)
	= 2.1 Therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-ACBL-V04-260101

REVIEW DEADLINE: 1/1/2029

[363] "California eTRM: Automatic Conveyor Broiler, Commercial", November 13, 2024https://www.caetrm.com/measure/SWFS017/04/

4.2.23 Electric Deck Oven

DESCRIPTION

This measure applies to new electric deck ovens installed in a commercial kitchen which have minimum heavy load cooking efficiency and maximum idle rate standards based on lab testing following ASTM F1965-99 (2010).[364]

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure case is described as a new electric deck oven which has a tested minimum heavy load cooking efficiency of 60%, and has an idle energy rate of no greater than 1.3 kW.[2]

Deck Oven Measure Case:

	Minimum Cooking Efficiency	Maximum Idle Energy Rate
Electric Deck Oven	60%	1.3 kW

DEFINITION OF BASELINE EQUIPMENT

The base case electric deck oven is described as an electric deck oven with a tested average cooking efficiency which does not meet the measure case criteria.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected effective useful life of the measure electric deck oven is estimated to be 12 years.[365] [366]

DEEMED MEASURE COST

The incremental capital cost for this measure is $1022 normalized per deck after considering common discounts.[367]

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0.900[368]

[364] American Society for Testing and Materials (ASTM). 2010. *ASTM F1965-99, Standard Test Method for the Performance of Deck Ovens.* West Conshohocken (PA): ASTM International.
[365] Robert Mowris & Associates. 2005. *Ninth Year Retention Study of the 1995 Southern California Gas Company Commercial New Construction Program.* Prepared for Southern California Gas Company. Study ID Number 718A.
[366] California Public Utilities Commission (CPUC), Energy Division. 2003. *Energy Efficiency Policy Manual v 2.0.*
[367] Energy Solutions. 2017. "2016 IMC Analysis - For Cal TF (Energy Solutions).xls"
[368] Itron, Inc. 2005. *2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report*. Prepared for Southern California Edison.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS[369]

ΔAnnual_kWh = $(\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days$

ΔDailyIdleEnergy = $(IdleRate_{base} - IdleRate_{measure}) * (Hours - Food / PC - Preheats * PreheatTime / 60)$

ΔDailyPreheatEnergy = $Preheats * (PreheatEnergy_{base} - PreheatEnergy_{measure})$

ΔDailyCookingEnergy = $(Food * 0.0732 / CookingEff_{base}) - (Food * 0.0732 / CookingEff_{measure})$

Where:[370] [371]

Days = Annual days of operation

= Actual, or if unknown, use 365 days per year

Hours = Average daily hours of operation

= Actual, or if unknown, use 12 hours

$IdleRate_{base}$ = Idle energy rate of baseline electric deck oven

= 1.90 kW

$IdleRate_{measure}$ = Idle energy rate of measure electric deck oven

= Actual, or if unknown, use 1.30 kW

Food = Average pounds of food cooked per day

= Actual, or if unknown, use 200 lb/day

PC = Production Capacity of the electric deck oven

= 60 lb/h

Preheats = Average number of times the unit is preheated in any given day

= Actual, or if unknown, use 1

PreheatTime = Estimated time that the unit spends in the preheat mode

= 30 min

60 = Minutes to hours conversion factor

$PreheatEnergy_{base}$ = Energy use of the baseline electric deck oven during a preheat

= Actual, or if unknown, use 6.50 kWh

$PreheatEnergy_{measure}$ = Energy use of the measure electric deck oven during a preheat

= Actual, or if unknown, use 3.00 kWh

[369] American Society for Testing and Materials (ASTM). 2010. *ASTM F1965-99, Standard Test Method for the Performance of Deck Ovens.* West Conshohocken (PA): ASTM International.

[370] Food Service Technology Center (FSTC). (n.d.) Proprietary database

[371] Southern California Edison (SCE). 2018. "SCE17CC012.1 A2 - Cost & Savings Calculations.xlsm."

0.0732 = ASTM energy to food ratio; the energy absorbed by the food during cooking in kWh/lb

$CookingEff_{base}$ = Heavy load cooking energy efficiency of the baseline electric deck oven

= Actual, or if unknown, use 40%

$CookingEff_{measure}$ = Heavy load cooking energy efficiency of the measure electric deck oven

= Actual, or if unknown, use 60%

For example, for a measure case electric deck oven compared to the baseline electric deck oven using the default values from above would save:

ΔAnnual_kWh $= (\Delta DailyIdleEnergy + \Delta DailyPreheatEnergy + \Delta DailyCookingEnergy) * Days$

Where:

ΔDailyIdleEnergy = (1.9 – 1.3) * (12 – 200 / 60 – 1 * 30 / 60)

= 4.9 kWh

ΔDailyPreheatEnergy = 1 * (6.5 – 3.0)

= 3.5 kWh

ΔDailyCookingEnergy = (200 * 0.0732 / 0.40) – (200 * 0.0732 / 0.60)

= 12.2 kWh

ΔAnnual_kWh = (4.9 + 3.5 + 12.2) * 365

= 7,519.0 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / (Hours * Days) * CF$$

Where:[372]

ΔkWh = Annual kWh savings from measure as calculated above

Hours = Average daily hours of operation

= Actual, or if unknown, use 12 hours

Days = Annual days of operation

= Actual, or if unknown, use 365 days per year

CF = Summer Peak Coincidence Factor for measure

= 0.900

[372] Itron, Inc. 2005. *2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report*. Prepared for Southern California Edison.

For example, for a measure case electric deck oven compared to the baseline electric deck oven using the default values from above would save:

ΔkW = $\Delta kWh \ / \ (Hours \ * \ Days) \ * \ CF$

Where:

ΔkWh = Annual kWh savings from measure as calculated from the previous example using default values

= 7,519.0 kWh

ΔkW = 7,519.0 / (12 * 365) * 0.900

= 1.545 kW

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-EDOV-V01-240101

REVIEW DEADLINE: 1/1/2028

4.2.24 Gas and Electric Pressure Fryers

DESCRIPTION

This measure applies to electric or natural gas fired pressure fryers installed in a commercial kitchen which have a minimum cooking efficiency and maximum idle rate standards based on lab testing following ASTM F1964-21 Standard Test Method for Performance of Pressure Fryers.[373]

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure case is a new pressure fryer which meets the minimum cooking efficiency and maximum idle energy rate standards as tested following ASTM F1964-21.[3] These standards are comparable to the ENERGY STAR standards for large open deep fat fryers[374] and are based on the efficiency levels of the most efficient pressure fryers tested for each fuel type.

Pressure Fryer Measure Case

	Minimum Cooking Efficiency	Maximum Idle Rate
Electric Pressure Fryer	83%	0.7 kW
Gas Pressure Fryer	40%	9,000 Btu/h

DEFINITION OF BASELINE EQUIPMENT

The base case pressure fryer is described as a pressure fryer with a tested average cooking efficiency and idle energy rate which do not meet the measure case criteria.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected lifetime of the measure equipment is assumed to be 12 years for electric pressure fryers and 11 years for gas fired pressure fryers.[375] [376]

DEEMED MEASURE COST

The incremental capital cost for this measure is $6,394 for electric pressure fryers and $4054 for gas pressure fryers.[377]

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

N/A

Algorithm

[373] American Society for Testing and Materials (ASTM). 2021. *ASTM F1964-21, Standard Test Method for Performance of Pressure Fryers.* West Conshohocken (PA): ASTM International.
[374] ENERGY STAR Commercial Fryers Program Program Requirements, version 3.0, October 2016
[375] California Public Utilities Commission (CPUC), Energy Division. 2020. *Energy Efficiency Policy Manual Version 6.* April. Page 35
[376] Guidehouse, Inc. 2020. *EMV Group A, Deliverable 16 EUL Research - Gas Fryers: Final Report*. Prepared for the California Public Utilities Commission (CPUC). June 2.
[377] UNPUBLISHFrontier Energy, Inc. "Pressure_Fryer_Workpaper_Calculations_Draft_R2 2023-07-31.xlsx". May 2023.

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS & FOSSIL FUEL SAVINGS

Non-Fuel Switch Measures:

The algorithms below apply to electric fryers only.

ΔAnnual_kWh = $(\Delta DailyIdleEnergy + \Delta DailyActiveEnergy) * Days / 1{,}000$

ΔDailyIdleEnergy = $(IdleRate_{base} - IdleRate_{measure}) * TimeIdle$

ΔDailyActiveEnergy = $(TimeActive * InputRate_{base}) - [(TimeActive * InputRate_{measure}) * CookTimeSaved]$

The algorithms below apply to gas fryers only.

ΔAnnual_Therms = $(\Delta DailyIdleEnergy + \Delta DailyActiveEnergy) * Days / 100{,}000$

ΔDailyIdleEnergy = $(IdleRate_{base} - IdleRate_{measure}) * TimeIdle$

ΔDailyActiveEnergy =$(TimeActive * InputRate_{base}) - [(TimeActive * InputRate_{measure}) * CookTimeSaved]$

Fuel-Switch / Electrification Measures:

Fuel switch / electrification measures must product positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. The following algorithm can be used to determine eligibility:

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricalConsumptionAdded]$

=$[DailyIdleEnergy_{GasBase} + DailyActiveEnergy_{GasBase}] - [DailyIdleEnergy_{ElectricMeasure} + DailyActiveEnergy_{ElectricMeasure}]$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claims are dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remain the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:[378]

Days = Annual days of operation

= Actual, or if unknown, use 326[379] days per year

1,000 = Wh to kWh conversion factor

$IdleRate_{base}$ = Idle energy rate of baseline pressure fryer

[378] UNPUBLISHED Frontier Energy, Inc. "Pressure_Fryer_Workpaper_Calculations_Draft_R2 2023-07-31.xlsx". May 2023.
[379] Fisher-Nickel, Inc. *Characterizing the Energy Efficiency Potential of Gas-Fired Commercial Foodservice Equipment.* Prepared for the California Energy Commission (CEC). CEC-500-2014-095. October 2014.

= Actual, or if unknown, use:

Equipment Type	IdleRate
Electric	1.0 kW
Gas	10,500 Btu/h

$IdleRate_{measure}$ = Idle energy rate of measure pressure fryer

= Actual, or if unknown, use:

Equipment Type	IdleRate
Electric	0.7 kW
Gas	9,000 Btu/h

TimeIdle = Daily operating time that the electric pressure fryer is in idle state

= Actual, of if unknown, use 9.50 hours

TimeActive = Daily operating time the electric pressure fryer is in an active state (preheat or cook)

= Actual, or if unknown, use 2.64 hours

$InputRate_{base}$ = Preheat energy rate of the baseline pressure fryer

= Actual, or if unknown, use:

Equipment Type	Input Rate
Electric	16 kW
Gas	75,000 Btu/hr

$InputRate_{measure}$ = Preheat energy rate of the measure pressure fryer

= Actual, or if unknown, use:

Equipment Type	Input Rate
Electric	17 kW
Gas	60,000 Btu/hr

CookTimeSaved = Percentage of time saved cooking by the measure electric pressure fryer

= Can be calculated using actual values using the following algorithm:

$CookTime_{measure}$ / $CookTime_{baseline}$

or

if unknown, use 0.88 for an electric pressure fryer or 0.83 for a gas pressure fryer

For fuel-switch / electrification measure use 0.88

Where:

$CookTime_{measure}$ = The amount of time to cook one load of the food product (min)

= Actual, or if unknown, use:

Equipment Type	CookTime (minutes)
Electric	13.5
Gas	12.7

$CookTime_{baseline}$ = The amount of time to cook on load of the food product (min)

= Actual, or if unknown, use:

Equipment Type	CookTime (minutes)
Electric	15.2
Gas	15.3

100,000 = Btu to therms conversion factor

For example, for a measure case electric pressure fryer replacing a baseline natural gas pressure fryer using the default values from the measure case in Electric Energy Savings above and the base case in Natural Gas Savings below would save:

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricalConsumptionAdded]$
$= [(DailyIdleEnergy_{GasBase} + DailyActiveEnergy_{GasBase}) * Days / 1{,}000{,}000] - [(DailyIdleEnergy_{ElectricMeasure} + DailyActiveEnergy_{ElectricMeasure}) * Days * 3{,}412 / 1{,}000{,}000]$

$DailyIdleEnergy_{GasBase}$ = $IdleRate_{Gasbase} * TimeIdle$
= 10,500 * 9.50
= 99,750 btu

$DailyActiveEnergy_{GasBase}$ = $TimeActive * InputRate_{GasBase}$
= 2.64 * 75,000
= 198,000 btu

$DailyIdleEnergy_{ElectricMeasure}$ = $IdleRate_{ElectricMeasure} * TimeIdle$
= 0.700 * 9.50
= 6.65 kWh

$DailyActiveEnergy_{ElectricMeasure}$ = $TimeActive * InputRate_{ElectricMeasure} * CookTimeSaved$
= 2.64 * 17 * 0.88
= 39.49 kWh

SiteEnergySavings (MMBTUs) = [(99,750 + 198,000) * 326 / 1,000,000] – [(6.65 + 39.49) * 326 * 3,412 / 1,000,000]
= 45.9 MMBTU

If supported by an electric utility = $SiteEnergySavings * 1{,}000{,}000 / 3{,}412$
= 45.9 * 1,000,000 / 3,412
= 13,440 kWh

For example, for a measure case electric pressures compared to the baseline gas pressure fryer using the default values from above would save:

ΔAnnual_Therms = $(\Delta DailyIdleEnergy + \Delta DailyActiveEnergy) * Days / 100{,}000$

Where:

ΔDailyIdleEnergy = (10,500 – 9,000) * 9.50

= 14,250 Btu

ΔDailyActiveEnergy = (2.64 * 75,000) – ((2.64 * 60,000) * 0.83)

= 66,528 Btu

ΔAnnual_Therms = (14,250 + 66,528) * 326 / 100,000

= 263 Therms

For example, for a measure case electric pressure fryer compared to the baseline electric pressure fryer using the default values from above would save:

ΔAnnual_kWh = $(\Delta DailyIdleEnergy + \Delta DailyActiveEnergy) * Days$

Where:

ΔDailyIdleEnergy = (1.0 – 0.7) * 9.50

= 2.850 kWh

ΔDailyActiveEnergy = (2.64 * 16) – ((2.64 * 17) * 0.88)

= 2.746 kWh

ΔAnnual_kWh = (2.850 + 2.746) * 326

= 1,824 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = $[Gas\ Cooking\ Consumption\ Replaced]$

=$[((IdleRate_{base} * TimeIdle) + ((TimeActive * InputRate_{base}) * CookTimeSaved)) * Days / 100{,}000]$

ΔkWh = $[Electric\ Cooking\ Consumption\ Added]$

=$- [((IdleRate_{measure} * TimeIdle) + ((TimeActive * InputRate_{measure}) * CookTimeSaved)) * Days / 1{,}000]$

MEASURE CODE: CI-FSE-GEPF-V01-240101

REVIEW DEADLINE: 1/1/2028

4.2.25 Efficient Cooktops

DESCRIPTION

This measure applies to new induction or natural gas cooktops installed in a commercial kitchen which have minimum heavy load cooking efficiency and maximum idle rate standards as defined below, based on lab testing following ASTM F1521-22 Standard Test Methods for Performance of Range Tops.[380]

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure case is described as a new cooktop which has a tested minimum cooking efficiency defined below, as determined by lab testing following ASTM F1521. Where applicable, values align with ENERGY STAR[381] program criteria.[382]

Induction Cooktop Measure Case:

	Minimum Cooking Efficiency
Induction Cooktop	80%
Gas Cooktop	43%

DEFINITION OF BASELINE EQUIPMENT

The base case cooktop is described as a new natural gas or electric induction cooktop with a tested average cooking efficiency which does not meet the measure case criteria. This measure has not been designed to support electric resistance-based burner designs.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected effective useful life of the measure cooktop is estimated to be 12 years.[383] [384]

DEEMED MEASURE COST

The incremental capital cost for this measure is defined below, normalized per burner:[385]

Fuel Source	Incremental Measure Cost
Electric	$560
Gas	$127
Fuel-Switch	$950

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

[380] American Society for Testing and Materials (ASTM). 2018. *ASTM F1521-12, Standard Test Method for Performance of Range Tops.* West Conshohocken (PA): ASTM International.
[381] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[382] ENERGY STAR Commercial Electric Cooktops, version 1.0, drafted January 12, 2023
[383] Itron, Inc. 2005. *2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report*. Prepared for Southern California Edison.
[384] California Public Utilities Commission (CPUC), Energy Division. 2003. *Energy Efficiency Policy Manual v 2.0.*
[385] Frontier Energy, Inc. 2023. "Cooktop_Supporting_Data_R2 2023-07-30.xlsx".

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0.900[4]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS AND FOSSIL FUEL SAVINGS[386]

Non Fuel-Switch Measures:

The algorithms below apply to electric cooktops only.

ΔAnnual_kWh = $(\Delta DailyCookingEnergy) * Days$

ΔDailyCookingEnergy = $(Food * (130 / 3{,}412) / CookingEff_{base}) - (Food * (130 / 3{,}412) / CookingEff_{measure})$

The algorithms below apply to gas cooktops only.

ΔAnnual_Therms = $(\Delta DailyCookingEnergy + \Delta DailyPilotEnergy) * Days / 100{,}000$

ΔDailyCookingEnergy =$(Food * 130 / CookingEff_{base}) - (Food * 130 / CookingEff_{measure})$

ΔDailyPilotEnergy =$(PilotRate_{base} * (24 - Food / ProdCap_{base})) - (PilotRate_{measure} * (24 - Food / ProdCap_{measure}))$

Fuel-Switch / Electrification Measures:

Fuel switch / electrification measures must product positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. The following algorithm can be used to determine eligibility:

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricalConsumptionAdded]$

=$[DailyCookingEnergy_{GasBase} + DailyPilotEnergy_{GasBase}] - [DailyCookingEnergy_{ElectricMeasure}]$

It should be noted that the Food variable shall be similar from one unit to the other when fuel-switching.

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claims are dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remain the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:[7]

Days = Annual days of operation

[386] Frontier Energy, Inc. 2023. "Cooktop_Supporting_Data_R2 2023-07-30.xlsx"

= Actual, or if unknown, use 326 days per year

Food = Average pounds of food cooked per day

= Actual, or if unknown, use 108 lb/day for an electric cooktop or 143lb/day for a gas cooktop. For fuel switching scenarios, use same Food assumption for both baseline and efficient.

130 = ASTM energy to food ratio; the energy absorbed by the food during cooking in Btu/lb

3412 = Btu to kWh conversion factor

$CookingEff_{base}$ = Heavy load cooking energy efficiency of the baseline cooktop

= Actual, or if unknown, use:

Equipment Type	Cooking Efficiency
Electric	75%
Gas	34%

$CookingEff_{measure}$ = Heavy load cooking energy efficiency of the measure induction cooktop

= Actual, or if unknown, use:

Equipment Type	Cooking Efficiency
Electric	84%
Gas	47%

100,000 = Btu to therms conversion factor

$PilotRate_{base}$ = Input energy rate of pilot found on baseline gas cooktop

= Actual, or if unknown, use 500 Btu/h

$PilotRate_{measure}$ = Input energy rate of pilot found on measure gas cooktop

= Actual, or if unknown, use 460 Btu/h

24 = Hours in a day

$ProdCap_{base}$ = Production Capacity of baseline gas cooktop

= Actual, or if unknown, use 78 lb/h

$ProdCap_{measure}$ = Production Capacity of measure gas cooktop

= Actual, or if unknown, use 66 lb/h

For example, for a measure case induction cooktop compared to the baseline induction cooktop using the default values from above would save:

ΔAnnual_kWh = $\Delta DailyCookingEnergy * Days$

Where:

ΔDailyCookingEnergy = (108 * (130 / 3412) / 0.75) – (108 * (130 / 3412) / 0.84)

= 0.588 kWh

ΔAnnual_kWh = 0.588 * 326

= 191.628 kWh

For example, for a measure case gas cooktop compared to the baseline gas cooktop using the default values from above would save:

ΔAnnual_Therms = $(\Delta DailyCookingEnergy + \Delta DailyPilotEnergy) * Days / 100{,}000$

Where:

ΔDailyCookingEnergy = (143 * 130 / 0.34) – (143 * 130 / 0.47)

= 15,123 Btu

ΔDailyPilotEnergy = 500 * (24 – 143 / 78) – 460 * (24 – 143 / 66)

= 1040 Btu

ΔAnnual_Therms = (15,123 + 1040) * 326 / 100,000

= 52.69 Therms

For example, for a measure case electric induction cooktop replacing a baseline natural gas cooktop using the default values from the measure case in Electric Energy Savings above and the base case in Natural Gas Savings below would save:

SiteEnergySavings (MMBTUs) = $[GasConsumptionReplaced] - [ElectricalConsumptionAdded]$
$=[(DailyCookingEnergy_{GasBase} + DailyPilotEnergy_{GasBase}) * Days / 1{,}000{,}000 - [DailyCookingEnergy_{ElectricMeasure} * Days * 3{,}412 / 1{,}000{,}000]$

DailyCookingEnergy$_{GasBase}$ = $Food * 130 / CookingEff_{GasBase}$
= 143 * 130 / 0.34
= 54,677 btu

DailyPilotEnergy$_{GasBase}$ = $PilotRate_{GasBase} * (24 - Food / ProdCap_{GasBase})$
= 500 * (24 – 143 / 78)
= 11,083 btu

DailyCookingEnergy$_{ElectricMeasure}$ = $Food * 130 / 3{,}412 / CookingEff_{ElectricMeasure}$
= 143 * 130 / 3,412 / 0.84
= 6.49 kWh

SiteEnergySavings (MMBTUs) = $[(54{,}677 + 11{,}083) * 326 / 1{,}000{,}000] - [6.49 * 326 * 3{,}412 / 1{,}000{,}000]$
= 14.2 MMBTU

If supported by an electric utility = $SiteEnergySavings * 1{,}000{,}000 / 3{,}412$
= 14.2 * 1,000,000 / 3,412
= 4,169 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh / (Hours * Days) * CF$

Where:[387]

ΔkWh = Annual kWh savings from measure as calculated above

Hours = Average daily hours of operation
= Actual, or if unknown, use 6 hours

Days = Annual days of operation
= Actual, or if unknown, use 326 days per year

CF = Summer Peak Coincidence Factor for measure
= 0.900

[387] Itron, Inc. 2005. *2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report*. Prepared for Southern California Edison.

For example, for a measure case induction cooktop compared to the baseline induction cooktop using the default values from above would save:

ΔkW = $\Delta kWh \ / \ (Hours * Days) * CF$

Where:

ΔkWh = Annual kWh savings from measure as calculated from the previous example using default values

= 191.628 kWh

ΔkW = 191.682 / (6 * 326) * 0.900

= 0.088 kW

ΔDailyCookingEnergy = (93 * (130 / 3412.14) / 0.75) – (93 * (130 / 3412.14) / 0.84)

= 0.506176 kWh

ΔAnnual_kWh = 0.506176 * 326

= 119.458 kWh

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = $[Gas\ Cooking\ Consumption\ Replaced]$

= $[((PilotRate_{base} * (24 - Food \ / \ ProdCap_{base})) + (Food * 130 \ / \ CookingEffe_{Gasbas})) * Days \ / \ 100{,}000]$

ΔkWh = $[Electric\ Cooking\ Consumption\ Added]$

= $-[(Food * (130 \ / \ 3{,}412) \ / \ CookingEff_{Elecmeasure}) * Days]$

MEASURE CODE: CI-FSE-INDC-V02-260101

REVIEW DEADLINE: 1/1/2028

4.2.26 Hot Food Holding Bins

DESCRIPTION

This measure applies to new hot food holding bins installed in a commercial kitchen which have maximum holding energy rate as defined below, based on lab testing following the draft ASTM Standard Test Method for Performance of Hot Food Holding Bins.

This measure was developed to be applicable to the following program types: TOS, RF, and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure case is described as a new hot food holding bin which has a tested average holding energy rate no greater than the value defined below, as determined by lab testing in accordance with the draft ASTM Standard Test Method for Performance of Hot Food Holding Bins.[388]

Holding Energy Rate
≤ 40 Watts per bin

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is described as a new or existing hot food holding bin which has a tested average holding energy rate greater than the maximum holding energy rate value defined above, as determined by lab testing in accordance with the draft ASTM Standard Test Method for Performance of Hot Food Holding Bins.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected effective useful life of the measure is equal to 12 years.[389]

DEEMED MEASURE COST

The incremental capital cost for this measure is defined below:[390]

Baseline Equipment Cost per bin	Efficient Equipment Cost per bin	Incremental Cost per bin
$419.69	$571.75	$152.07

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0.90.[391]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$\Delta kWh = \Delta DailyIdleEnergy * Days * Bins / 1000$

$\Delta DailyIdleEnergy_Wh = Hours * (IdleRate_{baseline} - IdleRate_{EE})$

[388] Southern California Gas Company (SCG), 2023. "Holding_Bin_Data_Summary_Final_Analysis_02062023.xlsx."
[389] Itron, Inc. 2005. *2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report*. This assumption is also validated by Robert Mowris & Associates. 2005. *Ninth Year Retention Study of the 1995 Southern California Gas Company Commercial New Construction Program.* Prepared for Southern California Gas Company. Study ID Number 718A.
[390] Southern California Gas Company (SCG), 2023. "Holding_Bin_Data_Summary_Final_Analysis_02062023.xlsx."
[391] Southern California Edison (SCE), Emerging Products. 2022. *Commercial Foodservice Holding Bins*. Emerging Technologies Project ET21SCE0009. April.

Where:

Days	= Annual days of equipment operation
	= Actual, or if unknown, use 365.25 days per year[392]
Hours	= Operating hours per day
	= Actual, or if unknown, use 22 hours per day[393]
Bins	= Number of bins of the measure equipment
	= Actual, or if unknown, use 8 bins[394]
$IdleRate_{base}$	= Average holding energy rate of the baseline hot food holding bin, normalized per bin
	= Actual, or if unknown, use 58.43 Watts per bin[395]
$IdleRate_{EE}$	= Average holding energy rate of the baseline hot food holding bin, normalized per bin
	= Actual, or if unknown, use 30.41 Watts per bin[396]
1000	= Watts to kilowatts conversion factor constant

For example, an 8-bin measure case hot food holding bin compared to an 8-bin baseline hot food holding bin using the default values from above would save:

ΔkWh	= ΔDailyIdleEnergy_Wh * Days * Bins / 1000

Where:

ΔDailyIdleEnergy_Wh	= 22 * (58.43 – 30.41)
	= 616.44 Wh per bin
ΔkWh	= 616.44 * 365.25 * 8 / 1000
	= 1,801.2 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW	= ΔkWh / (Hours * Days) * CF

Where:[397]

ΔkWh	= Annual kWh savings from measure as calculated above
CF	= Summer Peak Coincidence Factor for measure

[392] Ibid.
[393] Ibid.
[394] Southern California Gas Company (SCG), 2023. "Holding_Bin_Data_Summary_Final_Analysis_02062023.xlsx."
[395] Ibid.
[396] Ibid.
[397] Southern California Gas Company (SCG), 2023. "Holding_Bin_Data_Summary_Final_Analysis_02062023.xlsx."

= 0.900

For example, an 8-bin measure case hot food holding bin compared to an 8-bin baseline hot food holding bin using the default values from above would save:

ΔkW	= ΔkWh / (Hours * Days) * CF

Where:

ΔkWh	= Annual kWh savings from measure as calculated from the previous example using default values for an 8 bin hot food holding bin.
	= 1,801.2 kWh
ΔkW	= 1,801.2 / (22 * 365.25) * 0.900
	= 0.202 kW
ΔDailyCookingEnergy	= (93 * (130 / 3412.14) / 0.75) – (93 * (130 / 3412.14) / 0.84)
	= 0.506176 kWh

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-FSE-HFHB-V01-270101

REVIEW DEADLINE: 1/1/2029

4.3. Hot Water End Use

4.3.1 Water Heater

DESCRIPTION

This measure is for upgrading from minimum code to a high efficiency water heater. Storage water heaters are used to supply hot water for a variety of commercial building types. Storage capacities vary greatly depending on the application. Large consumers of hot water include (but not limited to) industries, hotels/motels and restaurants.

Tankless water heaters function similar to standard hot water heaters except they do not have a storage tank. When there is a call for hot water, the water is heated instantaneously as it passes through the heating element and then proceeds to the user or appliance calling for hot water. Tankless water heaters achieve savings by eliminating the standby losses that occur in stand-alone or tank-type water heaters and by being more efficient than the baseline storage hot water heater.

Heat pump water heaters use electricity to move heat from one place to another instead of generating heat directly and can allow for additional energy savings. Savings are presented dependent on the heating system installed in the home due to the impact of the heat pump water heater on the heating loads.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The minimum specifications of the high efficiency equipment should be defined by the programs.

DEFINITION OF BASELINE EQUIPMENT

Time of Sale: The baseline condition is assumed to be a new standard water heater of same type as the existing unit being replaced, meeting the Federal Standard for ≤75,000 Btuh units and IECC 2021 for all others. If existing type is unknown, assume same water heater type as the efficient unit. Programs should continue to use the Federal Standards effective before October 6, 2026 through 2027.

For Residential-sized >55 gallon HPWH tanks, the baseline should assume the same capacity and use the appropriate standard listed below, unless it can be confirmed that the existing tank being replaced was <55 gallon (and the larger tank is only being used to achieve greater efficiency of the heat pump cycle and prevent the unit from going in to resistance mode), in which case the existing unit capacity and the <55 gallon algorithms should be used.

New Construction: The baseline condition is a new standard water heater of the same type as the efficient, meeting the IECC code level in place at the time the building permit was issued. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints. Note, IECC 2024 became effective 11/30/2025, IECC 2021 became effective statewide on 1/1/2024. IECC 2018 is the requisite code for any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code.

Note the same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units. Definitions of draw pattern are provided below.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[398]	
			Equipment manufactured before October 6, 2026	Equipment manufactured after October 6, 2026
Residential Gas Storage Water Heaters	≤55 gallon tanks	Very small	UEF = 0.3456 – (0.0020 * Rated Storage Volume in Gallons)	
		Low	UEF = 0.5982 – (0.0019 * Rated Storage Volume in Gallons)	

[398] All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[398]	
			Equipment manufactured before October 6, 2026	Equipment manufactured after October 6, 2026
≤75,000 Btu/h		Medium	UEF = 0.6483 – (0.0017 * Rated Storage Volume in Gallons)	
		High	UEF = 0.6920 – (0.0013 * Rated Storage Volume in Gallons)	
	>55 gallon and ≤100 gallon tanks	Very small	UEF = 0.6470 – (0.0006 * Rated Storage Volume in Gallons)	
		Low	UEF = 0.7689 – (0.0005 * Rated Storage Volume in Gallons)	
		Medium	UEF = 0.7897 – (0.0004 * Rated Storage Volume in Gallons)	
		High	UEF = 0.8072 – (0.0003 * Rated Storage Volume in Gallons)	
Residential-duty Commercial High Capacity Storage Gas-Fired Storage Water Heaters > 75,000 Btu/h	≤120 gallon tanks	Very small	UEF = 0.2674 – (0.0009 * Rated Storage Volume in Gallons)	UEF = 0.5374 – (0.0009 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5362 – (0.0012 * Rated Storage Volume in Gallons)	UEF = 0.8062 – (0.0012 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6002 – (0.0011 * Rated Storage Volume in Gallons)	UEF = 0.8702 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 0.6597 – (0.0009 * Rated Storage Volume in Gallons)	UEF = 0.9297 – (0.0009 * Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >75,000 Btu/h and ≤155,000 Btu/h	>120 gallon tanks	All	80% $E_{thermal}$, Unless total water heater capacity is ≥1,000,000 then is 92% for single water heaters or 90% average input-capacity-weighted when multiple water heaters[399] Standby Losses = (Q /800 + 110√Rated Storage Volume in Gallons)	95% $E_{thermal}$, Standby Losses = 0.86 * (Q /800 + 110√Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >155,000 Btu/h		All		
Residential Gas Instantaneous Water Heaters ≤ 200,000 Btu/h	≤2 gal	Very low	UEF = 0.80	
		All other	UEF = 0.81	
Commercial Gas Instantaneous Water Heaters > 200,000 Btu/h	<10 gal	All	80% $E_{thermal}$	96% $E_{thermal}$
	≥10 gal	All	80% $E_{thermal}$	96% $E_{thermal}$
Residential Electric Storage Water Heaters ≤ 75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.8808 – (0.0008 * Rated Storage Volume in Gallons)	
		Low	UEF = 0.9254 – (0.0003 * Rated Storage Volume in Gallons)	
		Medium	UEF = 0.9307 – (0.0002 * Rated Storage Volume in Gallons)	
		High	UEF = 0.9349 – (0.0001 * Rated Storage Volume in Gallons)	
	>55 gallon and ≤120 gallon tanks [400]	Very small	UEF = 1.9236 – (0.0011 * Rated Storage Volume in Gallons)	
		Low	UEF = 2.0440 – (0.0011 * Rated Storage Volume in Gallons)	
		Medium	UEF = 2.1171 – (0.0011 * Rated Storage Volume in Gallons)	
		High	UEF = 2.2418 – (0.0011 * Rated Storage Volume in Gallons)	
Residential Electric Instantaneous Water Heaters	≤12kW and ≤2 gal	All other	UEF = 0.91	
		High	UEF = 0.92	
Residential-duty Commercial	> 12kW and ≤58.6 kW and ≤2 gal	All	UEF = 0.80	

[399] International Energy Conservation Code (IECC) 2021/2024, Section C404.2.1, High-input Service Water-Heating systems.

[400] It is assumed that tanks <75,000Btu/h and >55 gallons will not be eligible measures due to the high baseline.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[398]	
			Equipment manufactured before October 6, 2026	Equipment manufactured after October 6, 2026
Electric Instantaneous Water Heaters				

Residential-duty Commercial Water Heaters meet the following criteria:

- Is not designed to provide outlet hot water at temperatures greater than 180 °F; and
- If electric, must use a single-phase external power supply; and
- Gas-fired Storage Water Heater with a rated input no greater than 105 kBtu/h and a DOE Rated Storage volume no greater than 120 gallons.
- Electric Instantaneous with a rated input no greater than 58.6 kW and a DOE Rated Storage volume no greater than 2 gallons.

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below:[401]

Storage Water Heater Draw Pattern	
Draw Pattern	First Hour Rating (gallons)
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	Max GPM
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4
High	≥ 4

Gas-fired water heater for new buildings, where the total input capacity from high-capacity gas-fired water heaters is 1,000,000 Btu/h or greater, shall meet the following criteria[402]:

- When a single water heater is installed, the minimum thermal efficiency of the water heater is 92%.
- When a multiple water heater are installed, the minimum input-capacity-weighted thermal efficiency of the water heaters is 90%.
- The input rating of water heaters installed in individual living units does not count towards the total input capacity of water heaters for the building.
- The input rating of water heaters with an input rating of not greater than 105,000 Btu/h does not count towards the total input capacity of water heaters for the building.

[401] Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.
[402] International Energy Conservation Code (IECC) 2021/2024, Section C404.2.1, High-input Service Water-Heating systems.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 13 years for storage[403] and heat pump units[404], 5 years for electric tankless,[405] and 20 years for gas tankless.[406]

DEEMED MEASURE COST

The full install cost and incremental cost assumptions are provided below. Actual costs should be used where available:

Gas storage water heaters:[407]

Equipment Type	Category	Install Cost	Incremental Cost
Gas Storage Water Heaters ≤ 75,000 Btu/h, ≤55 Gallons	Baseline	$616	N/A
	Efficient	$1,055	$440
Gas Storage Water Heaters > 75,000 Btu/h	0.95 Et	$7,569	N/A
	0.96 Et	$7,623	$54
	0.97 Et	$7,677	$108
	0.98 Et	$7,731	$162
	0.99 Et	$7,720	$151

For electric water heaters, the incremental capital cost for this measure is assumed to be:[408]

Tank Size	Incremental Cost
50 gallons	$1050
80 gallons	$1050
100 gallons	$1950

The incremental capital cost for an electric tankless heater this measure is assumed to be:[409]

Output (gpm) at delta T 70	Incremental Cost
5	$1050
10	$1050
15	$1950

The incremental capital cost for a gas fired tankless heater is assumed to be[410]:

[403] DNV Commercial HVAC and Water Heating Measure Effective Useful Life Study Final Report, California Public Utilities Commission, May 30, 2024.
[404] Ibid
[405] Ohio Technical Reference Manual 8/2/2010 referencing CenterPoint Energy-Triennial CIP/DSM Plan 2010-2012 Report; Additional reference stating >20 years is soured from the US DOE Energy Savers for Tankless or Demand-Type Water Heaters.
[406] DNV Commercial HVAC and Water Heating Measure Effective Useful Life Study Final Report, California Public Utilities Commission, May 30, 2024.
[407] Costs are forecast based on data from EIA - Technology Forecast Updates – Residential and Commercial Building Technologies, Prepared by Guidehouse and Leidos, March 2023.
[408] Act on Energy Commercial Technical Reference Manual, Table 9.6.1-4
[409] Act on Energy Technical Reference Manual, Table 9.6.2-3
[410] Costs are forecast based on data from EIA - Technology Forecast Updates – Residential and Commercial Building Technologies, Prepared by Guidehouse and Leidos, March 2023.

Category	Incremental Cost
0.96 Et	N/A
0.97 Et	$295
0.98 Et	$590
0.99 Et	$2,304

For a heat pump water heater, the incremental installation cost (including labor) should be used. Defaults are provided below.[411] Actual efficient costs can also be used although care should be taken as installation costs can vary For a heat pump water heater, the incremental installation cost (including labor) should be used. Defaults are provided below.[412] Actual efficient costs can also be used although care should be taken as installation costs can vary significantly due to complexities of a particular site.

Capacity	Efficiency Range	Baseline Installed Cost	Efficient Installed Cost	Incremental Installed Cost
≤55 gallons	<2.6 UEF	$1,032	$2,062	$1,030
	≥2.6 UEF	$1,032	$2,231	$1,199
>55 gallons	<2.6 UEF	$1,319	$2,432	$1,113
	≥2.6 UEF	$1,319	$3,116	$1,797

LOADSHAPE

For electric hot water heaters, use Loadshape C02 - Commercial Electric DHW.

COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.925.[413]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

Non-Fuel Switch Measures:

Electric energy savings are calculated for electric water heaters per the equations given below.

Electric units ≤12 kW:

$$\Delta kWh = \frac{(T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{elecbase}} - \frac{1}{UEF_{Eff}}\right)}{3412}$$

[411] Costs for <2.6 UEF are based upon averages from the NEEP Phase 3 Incremental Cost Study. The assumption for higher efficiency tanks is based upon averaged from NEEP Phase 4 Incremental Cost Study. See 'HPWH Cost Estimation.xls' for more information.

[412] Costs for <2.6 UEF are based upon averages from the NEEP Phase 3 Incremental Cost Study. The assumption for higher efficiency tanks is based upon averaged from NEEP Phase 4 Incremental Cost Study. See 'HPWH Cost Estimation.xls' for more information.

[413] Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.

$$+HPWHWasteHeat_{cool} - HPWHWasteHeat_{heat}$$

Electric units > 12kW:

$$\Delta kWh = \frac{\left((T_{out} - T_{air}) * V * \gamma Water * 1 * \left(\frac{SL_{elecbase} - SL_{eff}}{100}\right)\right) * 8766}{3412}$$

Natural gas energy savings are calculated for natural gas storage water heaters per the equations given below.

$$\Delta Therms = \frac{(T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{gasbase}} - \frac{1}{UEF_{Eff}}\right)}{100{,}000} - HPWHWasteHeat_{GasHeat}$$

Additional Standby Loss Savings:

Gas Storage Water Heaters >75,000 Btu/h can claim additional savings due to lower standby losses.

$$\Delta Therms_{Standby} = \frac{(SL_{gasbase} - SL_{eff}) * 8766}{100{,}000}$$

Fuel Switch/Electrification Measures:

Fuel switch / electrification measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

Electric units ≤12 kW:

SiteEnergySavings (MMBTUs) = [GasConsumptionReplaced] – [ElectricConsumptionAdded]

$$= \left[\frac{(T_{out}-T_{in}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{gasbase}}\right)}{1{,}000{,}000}\right] - \left[\frac{(T_{out}-T_{in}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{Eff}}\right)}{1{,}000{,}000} + HPWHWasteHeat_{cool} - HPWHWasteHeat_{heat}\right]$$

Electric units > 12kW and gas units >75,000 Btu/h:

SiteEnergySavings (MMBTUs) = [GasConsumptionReplaced] – [ElectricConsumptionAdded] + ($HPWHWasteHeat_{cool}$ * 0.003412) – ($HPWHWasteHeat_{heat}$ * ConversionToMMBtu)

$$[\text{GasConsumptionReplaced}] = \left[\frac{(T_{out}-T_{in}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{gasbase}}\right)}{1{,}000{,}000} + \frac{(SL_{gasbase} * 8766)}{1{,}000{,}000}\right]$$

$$[\text{ElectricConsumptionAdded}]=\left[\frac{(T_{out}-T_{in})*HotWaterUse_{Gallon}*\gamma Water*1*\left(\frac{1}{UEF_{Eff}}\right)}{1{,}000{,}000}+\frac{\left((T_{out}-T_{air})*V*\gamma Water*1*\left(\frac{SL_{eff}}{100}\right)\right)*8766}{1{,}000{,}000}\right]$$

$$\text{HPWHWasteHeat}_{\text{cool}}=\left[\frac{\left((T_{OUT}-T_{IN})*HotWaterUse_{Gallon}*\gamma Water*1*\left(1-\frac{1}{UEF_{Eff}}\right)\right)*LF*25\%*LM}{COP_{COOL}*3412}\right]*Cool$$

$\text{HPWHWasteHeat}_{\text{heat}}$ =

$$\text{If Electric Heat}=\left[\frac{\left((T_{OUT}-T_{IN})*HotWaterUse_{Gallon}*\gamma Water*1*\left(1-\frac{1}{UEF_{Eff}}\right)\right)*\text{LF}*35\%}{\text{COP}_{\text{HEAT}}*3412}\right]*\text{ElectricHeat}$$

$$\text{If Gas Heat}=\left[\frac{\left((T_{OUT}-T_{IN})*HotWaterUse_{Gallon}*\gamma Water*1*\left(1-\frac{1}{UEF_{Eff}}\right)\right)*\text{LF}*35\%}{100{,}000*\eta Heat}\right]*(1-\text{ElectricHeat})$$

ConversionToMMBtu =

If Electric Heat = 0.003412 kWh/MMBtu

If Gas Heat = 0.1 Therms/MMBtu

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure Supported By:	Electric Utility Claims (kWh):	Gas Utility Claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:

T_{OUT} = Tank temperature

= 125°F

T_{IN} = Incoming water temperature from well or municiple system

= 50.7°F [414]

$HotWaterUse_{Gallon}$ = Estimated annual hot water consumption (gallons)

= Actual if possible to provide reasonable custom estimate. If not, two methodologies are provided to develop an estimate:

1. Consumption per usable storage tank capacity

   = Capacity * Consumption/cap

   Where:

   Capacity = Usable capacity of hot water storage tank in gallons

   = Actual

   Consumption/cap = Estimate of consumption per gallon of usable tank capacity, based on building type:[415]

Building Type[416]	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894
Unknown	555[417]

2. Consumption per unit area by building type

   = (Area/1000) * Consumption/1,000 sq.ft.

   Where:

   Area = Area in sq.ft that is served by DHW boiler

   = Actual

[414] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[415] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

[416] According to CBECS 2012 "Lodging" buildings include Dormitories, Hotels, Motel or Inns and other Lodging and "Nursing" buildings include Assisted Living and Nursing Homes.

[417] From a historical average of all Ameren Illinois commercial & industrial water heater applications from 2013-2022

Consumption/1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:[418]

Building Type[419]	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

γWater = Specific weight capacity of water (lb/gal)

= 8.33 lbs/gal

1 = Specific heat of water (Btu/lb.°F)

$UEF_{elecbase}$ = Rated efficiency of baseline water heater expressed as Uniform Energy Factor (UEF);

Note the same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[420]
Residential Electric Storage Water Heaters ≤ 75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.8808 – (0.0008 * Rated Storage Volume in Gallons)
		Low	UEF = 0.9254 – (0.0003 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.9307 – (0.0002 * Rated Storage Volume in Gallons)
		High	UEF = 0.9349 – (0.0001 * Rated Storage Volume in Gallons)
	>55 gallon and ≤120 gallon tanks [421]	Very small	UEF = 1.9236 – (0.0011 * Rated Storage Volume in Gallons)
		Low	UEF = 2.0440 – (0.0011 * Rated Storage Volume in Gallons)
		Medium	UEF = 2.1171 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 2.2418 – (0.0011 * Rated Storage Volume in Gallons)
Residential Electric Instantaneous Water Heaters	≤12kW and ≤2 gal	All other	UEF = 0.91
		High	UEF = 0.92

[418] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

[419] According to CBECS 2012 "Lodging" buildings include Dormitories, Hotels, Motel or Inns and other Lodging and "Nursing" buildings include Assisted Living and Nursing Homes.

[420] All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

[421] It is assumed that tanks <75,000Btu/h and >55 gallons will not be eligible measures due to the high baseline.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[420]
Residential-duty Commercial Electric Instantaneous Water Heaters	> 12kW and ≤58.6 kW and ≤2 gal	All	UEF = 0.80

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below:[422]

Storage Water Heater Draw Pattern	
Draw Pattern	**First Hour Rating (gallons)**
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	**Max GPM**
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4
High	≥ 4

UEF_{eff} = Rated efficiency of efficient water heater expressed as Uniform Energy Factor (UEF)

= Actual

3412 = Converts Btu to kWh

$HPWHWasteheat_{cool}$ = Heat Pump Water Heater Only - Cooling savings from conversion of heat in building to water heat[423]

$$= \left[\frac{\left((T_{OUT} - T_{IN}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(1 - \frac{1}{UEF_{Eff}} \right) \right) * LF * 25\% * LM}{COP_{COOL} * 3412} \right] * Cool$$

Where:

LF = Location Factor

= 1.0 for HPWH installation in a conditioned space

= 0.5 for HPWH installation in an unknown location[424]

= 0.0 for installation in an unconditioned space

[422] Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.

[423] This algorithm calculates the heat removed from the air by subtracting the HPWH electric consumption from the total water heating energy delivered. This is then adjusted to account for location of the HP unit and the coincidence of the waste heat with cooling requirements, the efficiency of the central cooling, and latent cooling demands.

[424] Note unconditioned means a space that is not intentionally heated via furnace vents or boiler radiators. The presence of and/or leakage from a heating system in a space doesn't in itself imply the space is conditioned.

25% = Portion of reduced waste heat that results in cooling savings[425]

COP_{COOL} = COP of Central Air Conditioner

= Actual - If unknown, assume 3.25 (11.1 SEER2 / 3.412) [426]

LM = Latent multiplier to account for latent cooling demand

= 1.33 [427]

Cool = 1 if building has central cooling, 0 if not cooled

$HPWHWasteheat_{Heat}$ = Heat Pump Water Heater Only - Heating cost from conversion of heat in building to water heat (dependent on heating fuel)

$$= \left(\frac{\left((T_{OUT} - T_{IN}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(1 - \frac{1}{UEF_{Eff}}\right)\right) * \text{LF} * 35\%}{\text{COP}_{\text{HEAT}} * 3412} \right) * \text{ElectricHeat}$$

Where:

35% = Portion of reduced waste heat that results in increased heating load[428]

COP_{HEAT} = COP of electric heating system

= Actual system efficiency including duct loss - If not available, use:

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95 (Distribution Efficiency)
Heat Pump	7.37[429]	2.05
Resistance	N/A	1

ElectricHeat = 1 if building is electrically heated, 0 if not

For example, for a 50 gallon, 95% UEF storage unit installed in a 1500 ft^2 restaurant:

ΔkWh = ((125 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 1 * (1/0.88 - 1/0.95))/3412 + 0 + 0

= 1012 kWh

[425] This is estimated based on the percentage of lighting savings that result in reduced cooling loads (lighting is used as a proxy for hot water heating since load shapes suggest their seasonal usage patterns are similar). This is based on the WHFe for unknown non-residential buildings (1.08) and assuming an average cooling COP of 3.08 (1.08 = 1 + 0.246/3.08).

[426] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER value converted to SEER2 by multiplying by 0.95 and multiplied by 0.95 distribution efficiency.

[427] A sensible heat ratio (SHR) of 0.75 corresponds to a latent multiplier of 4/3 or 1.33. SHR of 0.75 for typical split system from page 10 of "Controlling Indoor Humidity Using Variable-Speed Compressors and Blowers" by M. A. Andrade and C. W. Bullard, 1999: www.ideals.illinois.edu/bitstream/handle/2142/11894/TR151.pdf

[428] This is estimated based on the percentage of lighting savings that result in increased heating loads (lighting is used as a proxy for hot water heating since load shapes suggest their seasonal usage patterns are similar). The WHFh for unknown non-residential buildings is 35%.

[429] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.

Electric units > 12kW:

T_{air} = Ambient Air Temperature

= 70°F

V = Rated tank volume in gallons

= Actual

$SL_{elecbase}$ = Standby loss of electric baseline unit (%/hr)

= 0.30 + 27/V

SL_{eff} = Nameplate standby loss of new water heater, in BTU/h

8766 = Hours per year

For example, >12kW, 100 gallon storage unit with rated standby loss of 0.5 %/hr:

SLbase = 0.3 + (27 / 100)

= 0.57%/hr

ΔkWh = (((125 – 70) * 100 * 8.33 * 1 * (0.57- 0.5)/100) * 8766)/3412

= 82.4 kWh

Gas units:

100,000 = Converts Btu to Therms

$EF_{gasbase}$ = Rated efficiency of baseline water heater (expressed as Uniform Energy Factor (UEF) or Thermal Efficiency as provided below).

Note the same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[430]	
			Equipment manufactured before October 6, 2026	Equipment manufactured after October 6, 2026
Residential Gas Storage Water Heaters ≤75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.3456 – (0.0020 * Rated Storage Volume in Gallons)	
		Low	UEF = 0.5982 – (0.0019 * Rated Storage Volume in Gallons)	
		Medium	UEF = 0.6483 – (0.0017 * Rated Storage Volume in Gallons)	
		High	UEF = 0.6920 – (0.0013 * Rated Storage Volume in Gallons)	
	>55 gallon and ≤100 gallon tanks	Very small	UEF = 0.6470 – (0.0006 * Rated Storage Volume in Gallons)	
		Low	UEF = 0.7689 – (0.0005 * Rated Storage Volume in Gallons)	
		Medium	UEF = 0.7897 – (0.0004 * Rated Storage Volume in Gallons)	
		High	UEF = 0.8072 – (0.0003 * Rated Storage Volume in Gallons)	
Residential-duty Commercial High Capacity Storage Gas-Fired Storage Water Heaters > 75,000 Btu/h	≤120 gallon tanks	Very small	UEF = 0.2674 – (0.0009 * Rated Storage Volume in Gallons)	UEF = 0.5374 – (0.0009 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5362 – (0.0012 * Rated Storage Volume in Gallons)	UEF = 0.8062 – (0.0012 * Rated Storage Volume in Gallons)

[430] All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[430]	
			Equipment manufactured before October 6, 2026	Equipment manufactured after October 6, 2026
		Medium	UEF = 0.6002 – (0.0011 * Rated Storage Volume in Gallons)	UEF = 0.8702 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 0.6597 – (0.0009 * Rated Storage Volume in Gallons)	UEF = 0.9297 – (0.0009 * Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >75,000 Btu/h and ≤155,000 Btu/h	>120 gallon tanks	All	80% $E_{thermal}$, Unless total water heater capacity is ≥1,000,000 then is 92% for single water heaters or 90% average input-capacity-weighted when multiple water heaters[431] Standby Losses = (Q /800 + 110√Rated Storage Volume in Gallons)	95% $E_{thermal}$, Standby Losses = 0.86 * (Q /800 + 110√Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >155,000 Btu/h				
Residential Gas Instantaneous Water Heaters ≤ 200,000 Btu/h	≤2 gal	Very low	UEF = 0.80	
		All other	UEF = 0.81	
Commercial Gas Instantaneous Water Heaters > 200,000 Btu/h	<10 gal	All	80% $E_{thermal}$	96% $E_{thermal}$
	≥10 gal	All	80% $E_{thermal}$	96% $E_{thermal}$

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below:[432]

Storage Water Heater Draw Pattern	
Draw Pattern	First Hour Rating (gallons)
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	Max GPM
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4

$HPWHWasteHeat_{GasHeat}$ = Heat Pump Water Heater Only - Heating cost from conversion of heat in building to water heat (dependent on heating fuel)

[431] International Energy Conservation Code (IECC) 2021/2024, Section C404.2.1, High-input Service Water-Heating systems.

[432] Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.

$$= \left(\frac{\left((T_{OUT} - T_{IN}) * HotWaterUse_{Gallon} * \gamma Water * 1 * \left(1 - \frac{1}{UEF_{Eff}} \right) \right) * \text{LF} * 35\%}{100{,}000 * \eta Heat} \right) * (1 - \text{ElectricHeat})$$

ηHeat = Heating system efficiency including duct loss

= Actual. If unknown assume 0.821.[433]

Where:

$SL_{gasbase}$ = Standby loss of gas baseline unit (Btu/h)

$= Q/800 + 110\sqrt{V}$

Q = Nameplate input rating in Btu/h

V = Rated volume in gallons

SL_{eff} = Nameplate standby loss of new water heater, in Btu/h

8766 = Hours per year

For example, for a 200,000 Btu/h, 150 gallon, 90% UEF storage unit with rated standby loss of 1,029 BTU/h installed in a 1,500 ft^2 restaurant:

ΔTherms = ((125 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 1 * (1/0.8 - 1/0.9))/100,000

= 57.3 Therms

$\Delta Therms_{Standby}$ = (((200,000/800 + 110 * √150) – 1,029) * 8,766)/100,000

= 49.8 Therms

ΔThermsTotal = 57.3 + 49.8

= 107.1 Therms

[433] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

Fuel switch: For example, a 160,000 Btu/h, 120 gallon, 80% UEF storage unit with rated standby loss of 1405 BTU/h installed in a 1500 ft^2 restaurant (with gas heat 85% AFUE and cooling) is replaced with a 120 gallon HPWH with medium draw (UEF = 2.1171 – (0.0011 * 100) = 2.0) and standby loss rate of 0.5%/hr installed in a unknown location.

GasConsumptionReplaced = (((125 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 1 * 1/0.8)/1,000,000) + ((1,405 * 8,766)/1,000,000)

= 63.8 MMBtu

ElectricConsumptionAdded = (((125 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 1 * 1/2.0)/1,000,000) + ((((125 – 50.7) * 120 * 8.33 * 1 * 0.5/100) * 8766)/1,000,000)

= 23.9 MMBtu

$HPWHWasteHeat_{cool}$ = ((125 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 1 * (1 - 1/2.0) * 0.5 * 0.25 * 1.33) / (3.08 * 3412 * 1)

= 326 kWh

HPWHWasteHeatGasHeat = ((125 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 1 * (1 - 1/2.0) * 0.5 * 0.35) / (100,000 * 0.85 * 1)

= 42 Therms

SiteEnergySavings (MMBTUs) = 63.8 – 23.9 + (326 * 0.003412) – (42 * 0.1)

= 36.8 MMBtu

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{Hours} * CF$$

Where:

Hours = Full load hours of water heater

= 6,461 [434]

CF = Summer Peak Coincidence Factor for measure

= 0.925 [435]

For example, >12kW, 100 gallon storage unit with rated standby loss of 0.5 %/hr:

ΔkW = 82.4 / 6,461 * 0.925

= 0.0118 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

DEEMED O&M COST ADJUSTMENT CALCULATION

The deemed O&M cost adjustment for a tankless heaters is $100.[436]

[434] Full load hours assumption based on Wh/Max W Ratio from Itron eShape data for Missouri, calibrated to Illinois loads.
[435] Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.
[436] Water heaters (WH) require annual maintenance. There are different levels of effort for annual maintenance depending if the unit is gas or electric, tanked or tankless. Electric and gas tank water heater manufacturers recommend an annual tank drain to clear sediments. Also recommended are "periodic" inspections by qualified service professionals of operating controls,

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

Electric units ≤12 kW:

ΔTherms = [GasConsumptionReplaced]

$$= \left[\frac{(T_{out} - T_{in}) \ * \ HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{gasbase}}\right)}{100{,}000}\right]$$

ΔkWh = [ElectricConsumptionAdded]

$$= -\left[\frac{(T_{out} - T_{in}) \ * \ HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{Eff}}\right)}{3{,}412} + HPWHWasteHeat_{cool} - \ HPWHWasteHeat_{heat}\right]$$

Electric units > 12kW and gas units >75,000 Btu/h:

ΔTherms = [GasConsumptionReplaced]

$$= \left[\frac{(T_{out} - T_{in}) \ * \ HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{gasbase}}\right)}{100{,}000} + \frac{(SL_{gasbase} * 8766)}{100{,}000}\right] - (\text{HPWHWasteHeat}_{heat(gas)})$$

ΔkWh = [ElectricConsumptionAdded]

$$= -\left[\frac{(T_{out} - T_{in}) \ * \ HotWaterUse_{Gallon} * \gamma Water * 1 * \left(\frac{1}{UEF_{Eff}}\right)}{1{,}000{,}000} + \frac{\left((T_{out} - T_{air}) * V * \gamma Water * 1 * \left(\frac{SL_{eff}}{100}\right)\right) * 8766}{1{,}000{,}000}\right] + (\text{HPWHWasteHeat}_{cool} * 0.003412) - (\text{HPWHWasteHeat}_{heat(electric)})$$

heating element and wiring for electric WHs and thermostat, burner, relief valve internal flue-way and venting systems for gas WHs. Tankless WH require annual maintenance by licensed professionals to clean control compartments, burners, venting system and heat exchangers. This information is from WH manufacturer product brochures including GE, Rennai, Rheem, Takagi and Kenmore. References for incremental O&M costs were not found. Therefore the incremental cost of the additional annual maintenance for tankless WH is estimated at $100.

MEASURE CODE: CI-HWE-STWH-V13-270101

REVIEW DEADLINE: 1/1/2030

4.3.2 Low Flow Faucet Aerators

DESCRIPTION

This measure relates to the direct installation of a low flow faucet aerator in a commercial building. Expected applications include small business, office, restaurant, or motel. Health care-specific inputs are defined for Laminar Flow Restrictor (LFR) devices. For multifamily or senior housing, the residential low flow faucet aerator should be used.

This measure was developed to be applicable to the following program types, DI, KITS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an energy efficient faucet aerator, for bathrooms rated at 1.5 gallons per minute (GPM) or less, or for kitchens rated at 2.2 GPM or less. For LFR devices, the installed equipment must be a device rated at 2.2 GPM or less. Savings are calculated on an average savings per faucet fixture basis.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a standard bathroom or kitchen faucet aerator. For LFR devices, the baseline condition is assumed to be no aerator at all, due to the contamination risk caused by faucet aerators in health care facilities and the baseline flow rate is assumed to be 3.74 GPM[437]. Note if flow rates are measured, for example through a Direct Install program, then actual baseline flow rates should be used as opposed to the deemed values.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[438]

DEEMED MEASURE COST

The actual full install cost (including labor) for this measure should be used. If unknown assume $8 for faucet aerators[439] and $14.27 for LFR devices.[440]

LOADSHAPE

Loadshape C02 - Commercial Electric DHW

COINCIDENCE FACTOR

The coincidence factor for this measure is dependent on building type as presented below.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Note these savings are *per faucet retrofitted.*[441]

$$\Delta\text{kWh} = \%ElectricDHW * ((GPM_base - GPM_low)/GPM_base) * Usage * EPG_electric * ISR$$

[437] Workpaper WPSCGNRWH150827A, Laminar Flow Restrictors For Hospitals and Health Care Facilities.
[438] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[439] Direct-install price per faucet assumes cost of aerator and install time. (2011, Market research average of $3 and assess and install time of $5 (20min @ $15/hr).
[440] Direct install price per faucet assumes cost of LFR ($7.27) and install time ($7) (Southern California Gas Company, Workpaper WPSCGNRWH150827A Revision #0, September, 2015).
[441] This algorithm calculates the amount of energy saved per aerator by determining the fraction of water consumption savings for the upgraded fixture. Due to the distribution of water consumption by fixture type, as well as the different number of fixtures in a building, several variables must be incorporated.

Where:

%ElectricDHW = proportion of water heating supplied by electric resistance heating

DHW Fuel	%Electric_DHW
Electric	100%
Fossil Fuel	0%
Unknown	32%[442]

GPM_base = Average flow rate, in gallons per minute, of the baseline faucet "as-used"

= 1.39,[443] or custom based on metering studies,[444] or, if measured during DI:

= Measured full throttle flow * 0.83 throttling factor[445]

Baseline for LFRs[446] = 3.74 * 0.83 = 3.10

GPM_low = Average flow rate, in gallons per minute, of the low-flow faucet aerator "as-used"

= 0.94,[447] or custom based on metering studies,[448] or, if measured during DI:

= Rated full throttle flow * 0.95 throttling factor[449]

For LFRs[450] = 2.2 * 0.95 = 2.09

Usage = Estimated usage of mixed water (mixture of hot water from water heater line and cold water line) per faucet (gallons per year)

= If data is available to provide a reasonable custom estimate it should be used; if not, use the following defaults (or substitute custom information in to the calculation):

[442] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.
[443] DeOreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.
[444] Measurement should be based on actual average flow consumed over a period of time rather than a onetime spot measurement for maximum flow. Studies have shown maximum flow rates do not correspond well to average flow rate due to occupant behavior which does not always use maximum flow.
[445] 2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings. Page 1-265.
[446] Using measured flow rate assumption from Workpaper WPSCGNRWH150827A, Laminar Flow Restrictors For Hospitals and Health Care Facilities.
[447] Average retrofit flow rate for kitchen and bathroom faucet aerators from sources 2, 4, 5, and 7. This accounts for all throttling and differences from rated flow rates. Assumes all kitchen aerators at 2.2 gpm or less and all bathroom aerators at 1.5 gpm or less. The most comprehensive available studies did not disaggregate kitchen use from bathroom use, but instead looked at total flow and length of use for all faucets. This makes it difficult to reliably separate kitchen water use from bathroom water use. It is possible that programs installing low flow aerators lower than the 2.2 gpm for kitchens and 1.5 gpm for bathrooms will see a lower overall average retrofit flow rate.
[448] Measurement should be based on actual average flow consumed over a period of time rather than a onetime spot measurement for maximum flow. Studies have shown maximum flow rates do not correspond well to average flow rate due to occupant behavior which does not always use maximum flow.
[449] 2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings. Page 1-265.
[450] Using measured flow rate assumption from Workpaper WPSCGNRWH150827A, Laminar Flow Restrictors For Hospitals and Health Care Facilities.

Building Type	Gallons Hot Water per Unit per Day[451] (A)	Unit	Estimated % Hot Water from Faucets [452] (B)	Multiplier [453] (C)	Unit	Days per Year (D)	Annual Gallons Mixed Water per Faucet (A*B*C*D)
Small Office	1	person	100%	10	employees per faucet	250	2,500
Large Office	1	person	100%	45	employees per faucet	250	11,250
Fast Food Rest	0.7	meal/day	50%	75	meals per faucet	365	9,581
Sit-Down Rest	2.4	meal/day	50%	36	meals per faucet	365	15,768
Retail	2	employee	100%	5	employees per faucet	365	3,650
Grocery	2	employee	100%	5	employees per faucet	365	3,650
Warehouse	2	employee	100%	5	employees per faucet	250	2,500
Elementary School	0.6	person	50%	50	students per faucet	200	3,000
Jr High/High School	1.8	person	50%	50	students per faucet	200	9,000
Health	90	patient	25%	2	Patients per faucet	365	16,425
Motel	20	room	25%	1	faucet per room	365	1,825
Hotel	14	room	25%	1	faucet per room	365	1,278
Other	1	employee	100%	20	employees per faucet	250	5,000

EPG_electric = Energy per gallon of mixed water used by faucet (electric water heater)

= (8.33 * 1.0 * (WaterTemp - SupplyTemp)) / (RE_electric * 3412)

= 0.0879 kWh/gal for Bath, 0.1054 kWh/gal for Kitchen, 0.1477 kWh/gal for LFRs, 0.1004 kWh/gal for unknown

8.33 = Specific weight of water (lbs/gallon)

1.0 = Heat Capacity of water (btu/lb-°F)

WaterTemp = Assumed temperature of mixed water

= 86°F for Bath, 93°F for Kitchen, 91°F for Unknown,[454] 110°F for health care facilities[455]

SupplyTemp = Assumed temperature of water entering building

= 50.7°F [456]

RE_electric = Recovery efficiency of electric water heater

= 98% [457]

[451] Table 2-45 Chapter 49, Service Water Heating, 2007 ASHRAE Handbook, HVAC Applications.

[452] Estimated based on data provided in Appendix E; "Waste Not, Want Not: The Potential for Urban Water Conservation in California", Pacific Institute, November 2003.

[453] Based on review of the Illinois plumbing code (Employees and students per faucet). Retail, grocery, warehouse and health are estimates. Meals per faucet estimated as 4 bathroom and 3 kitchen faucets and average meals per day of 250 (based on California study above) – 250/7 = 36. Fast food assumption estimated.

[454] Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group. If the aerator location is unknown an average of 91% should be used which is based on the assumption that 70% of household water runs through the kitchen faucet and 30% through the bathroom (0.7*93)+(0.3*86)=0.91.

[455] Southern California Gas Company, Workpaper WPSCGNRWH150827A Revision #0, September, 2015.

[456] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[457] Electric water heaters have recovery efficiency of 98%, as sourced from available products on the AHRI Certification Directory.

3412 = Converts Btu to kWh (Btu/kWh)

ISR = In service rate of faucet aerators dependant on install method as listed in table below:

Selection	ISR
Direct Install - Deemed[458]	0.95
Efficiency Kits - Default[459]	0.50
Leave-Behind Kit[460]	0.91

For example, a direct installed kitchen faucet in a large office with electric DHW:

ΔkWh = 1 * ((1.39 – 0.94)/1.39) * 11,250 * 0.1054 * 0.95

= 364.7 kWh

For example, a direct installed bathroom faucet in an Elementary School with electric DHW:

ΔkWh = 1 * ((1.39 – 0.94)/1.39) * 3,000 * 0.0879 * 0.95

= 81.1 kWh

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water\ (gallons) \ / \ 1{,}000{,}000 \ * \ E_{water\ total}$$

Where

$E_{water\ total}$ = IL Total Water Energy Factor (kWh/Million Gallons)

=5,010[461]

For example, a direct installed faucet in a large office:

ΔWater (gallons) = ((1.39 – 0.94)/1.39) * 11,250 * 0.95

= 3,640 gallons

ΔkWh_{water} = 3,640/1,000,000*5,010

= 18 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh \ / \ Hours) \ * \ CF$$

Where:

[458] ComEd Energy Efficiency/Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program, December 21, 2010, Table 3-8.

[459] Analysis of CY2018, CY2019, and CY2020 Small Business Kit participant survey installation data. Use if annual survey data is not available or applicable. Please see file "SB Kits Survey Analysis TRMv10 Support.xlsx"

[460] Based on DCEO STEP Program GPY5 evaluation report for showerheads and aerators. Guidehouse, *In-Service Rates for a CY2020 Business Remote Assessment Path for Customer Installed Measures*, August 21, 2020. Please see file "Business Program Remote Assessment and Install ISR Memo 2020-08-21.docx"

[461] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

ΔkWh = calculated value above on a per faucet basis. Note do not include the secondary savings in this calculation.

Hours = Annual electric DHW recovery hours for faucet use

= (Usage * 0.44 [462])/GPH

= Calculate if usage is custom, if using default usage use:

Building Type	Annual Recovery Hours
Small Office	20
Large Office	92
Fast Food Rest	78
Sit-Down Rest	129
Retail	30
Grocery	30
Warehouse	20
Elementary School	24
Jr High/High School	73
Health	134
Motel	15
Hotel	10
Other	41

Where:

GPH = Gallons per hour recovery of electric water heater calculated for 89.3F temp rise (140-50.7), 98% recovery efficiency, and typical 12kW electric resistance storage tank.

= 53.9

CF = Coincidence Factor for electric load reduction

= Dependent on building type[463]

Building Type	Coincidence Factor
Small Office	0.0064
Large Office	0.0288
Fast Food Rest	0.0084
Sit-Down Rest	0.0184
Retail	0.0043
Grocery	0.0043
Warehouse	0.0064
Elementary School	0.0096
Jr High/High School	0.0288
Health	0.0144
Motel	0.0006

[462] 44% is the proportion of hot 140°F water mixed with 50.7°F supply water to give 90°F mixed faucet water.

[463] Calculated as follows: Assumptions for percentage of usage during peak period (1-5pm) were made and then multiplied by 65/365 (65 being the number of days in peak period) and by the number of total annual recovery hours to give an estimate of the number of hours of recovery during peak periods. There are 260 hours in the peak period so the probability you will see savings during the peak period is calculated as the number of hours of recovery during peak divided by 260. See 'C&I Faucet Aerator.xls' for details.

Building Type	Coincidence Factor
Hotel	0.0004
Other	0.0128

For example, a direct installed kitchen faucet in a large office with electric DHW:

ΔkW = 364.7/92 * 0.0288

= 0.1142 kW

For example, a direct installed bathroom faucet in an Elementary School with electric DHW:

ΔkW = 81.1/24 * 0.0096

= 0.0324 kW

FOSSIL FUEL SAVINGS

$$\Delta Therms = \%FossilDHW * ((GPM_base - GPM_low)/GPM_base) * Usage * EPG_gas * ISR$$

Where:

%FossilDHW = proportion of water heating supplied by fossil fuel heating

DHW Fuel	%Fossil_DHW
Electric	0%
Fossil Fuel	100%
Unknown	68%[464]

EPG_gas = Energy per gallon of mixed water used by faucet (gas water heater)

= (8.33 * 1.0 * (WaterTemp - SupplyTemp)) / (RE_gas * 100,000)

= 0.0044 Therm/gal for Bath, 0.0053 Therm/gal for Kitchen, 0.0074 Therm/gal for LFRs, 0.0050 Therm/gal for unknown

Where:

RE_gas = Recovery efficiency of gas water heater

= 67% [465]

100,000 = Converts Btus to Therms (Btu/Therm)

Other variables as defined above.

[464] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

[465] Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 75%. Commercial properties are more similar to MF homes than SF homes. MF hot water is often provided by a larger commercial boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of .59 and the .75 for single family home. An average is used for this analysis by default.

For example, a direct installed kitchen faucet in a large office with gas DHW:

ΔTherms = 1 * ((1.39 – 0.94)/1.39) * 11,250 * 0.0053 * 0.95

= 18.3 Therms

For example, a direct installed bathroom faucet in an Elementary School with gas DHW:

ΔTherms = 1 * ((1.39 – 0.94)/1.39) * 3,000 * 0.0044 * 0.95

= 4.06 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

ΔWater (gallons) = $((GPM_base - GPM_low)/GPM_base) * Usage * ISR$

Variables as defined above.

For example, a direct installed faucet in a large office:

ΔWater (gallons) = ((1.39 – 0.94)/1.39) * 11,250 * 0.95

= 3,640 gallons

For example, a direct installed faucet in an Elementary School:

ΔWater (gallons) = ((1.39 – 0.94)/1.39) * 3,000 * 0.95

= 971 gallons

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

Sources Used for GPM Assumptions

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.

MEASURE CODE: CI-HWE-LFFA-V13-260101

REVIEW DEADLINE: 1/1/2030

4.3.3 Low Flow Showerheads

DESCRIPTION

This measure relates to the direct installation of a low flow showerhead in a commercial building. Expected applications include small business, office, restaurant, or small motel. For multifamily or senior housing, the residential low flow showerhead should be used.

This measure was developed to be applicable to the following program types: DI. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an energy efficient showerhead rated at 2.0 gallons per minute (GPM) or less. Savings are calculated on a per showerhead fixture basis.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is assumed to be a standard showerhead rated at 2.5 GPM.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[466]

DEEMED MEASURE COST

The actual full install cost (including labor) should be used. If unknown, assume $12 per showerhead.[467]

LOADSHAPE

Loadshape C02 - Commercial Electric DHW

COINCIDENCE FACTOR

The coincidence factor for this measure is assumed to be 2.78%.[468]

Algorithm

CALCULATION OF SAVINGS [469]

ELECTRIC ENERGY SAVINGS

Note these savings are per showerhead fixture.

$$\Delta kWh = \%ElectricDHW * ((GPM_base * L_base - GPM_low * L_low) * NSPD * 365.25) * EPG_electric * ISR$$

Where:

%ElectricDHW = proportion of water heating supplied by electric resistance heating

= 1 if electric DHW; 0 if fuel DHW; if unknown, assume 32%[470]

[466] Table C-6, Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007. Evaluations indicate that consumer dissatisfaction may lead to reductions in persistence, particularly in Multi-Family.
[467] Direct-install price per showerhead assumes cost of showerhead (Market research average of $7 and assess and install time of $5 (20min @ $15/hr).
[468] Calculated as follows: Assume 11% showers take place during peak hours (as sourced from "Analysis of Water Use in New Single Family Homes, Aquacraft Water Engineering and Management, January 2011). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is 0.11*65/365 = 1.96%. The number of hours of recovery during peak periods is therefore assumed to be 1.96% * 369 = 7.23 hours of recovery during peak period. There are 260 hours in the peak period, so the probability you will see savings during the peak period is 7,23/260 = 0.0278.
[469] Based on excel spreadsheet 120911.xls …on IL-TRM SharePoint.
[470] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

GPM_base = Flow rate of the baseline showerhead

= 2.67 for Direct-install programs[471]

GPM_low = As-used flow rate of the low flow showerhead, which may, as a result of measurements of program evaulations deviate from rated flows, see table below:

Rated Flow
2.0 GPM
1.75 GPM
1.5 GPM
Custom or Actual[472]

L_base = Shower length in minutes with baseline showerhead

= 8.20 min[473]

L_low = Shower length in minutes with low-flow showerhead

= 8.20 min[474]

365.25 = Days per year, on average.

NSPD = Estimated number of showers taken per day for one showerhead

EPG_electric = Energy per gallon of hot water supplied by electric

= (8.33 * 1.0 * (ShowerTemp - SupplyTemp)) / (RE_electric * 3412)

= (8.33 * 1.0 * (101 – 50.7)) / (0.98 * 3412)

= 0.125 kWh/gal

8.33 = Specific weight of water (lbs/gallon)

1.0 = Heat Capacity of water (btu/lb-°F)

ShowerTemp = Assumed temperature of water

= 101°F [475]

SupplyTemp = Assumed temperature of water entering house

= 50.7°F [476]

RE_electric = Recovery efficiency of electric water heater

[471] Based on measured data from Ameren IL EM&V of Direct-Install program. Program targets showers that are rated 2.5 GPM or above.

[472] Note that actual values may be either a) program-specific minimum flow rate, or b) program-specific evaluation-based value of actual effective flow-rate due to increased duration or temperatures. The latter increases in likelihood as the rated flow drops and may become significant at or below rated flows of 1.5 GPM. The impact can be viewed as the inverse of the throttling described in the footnote for baseline flowrate.

[473] Representative value from sources 1, 2, 3, 4, 5, and 6 (See Source Table at end of measure section).

[474] Set equal to L_base.

[475] Cadmus and Opinion Dynamics Showerhead and Faucet Aerator Meter Study Memorandum dated June 2013, directed to Michigan Evaluation Working Group.

[476] Table 4 in Chen, et. al., “Calculating Average Hot Water Mixes of Residential Plumbing Fixtures”, June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

= 98% [477]

3412 = Converts Btu to kWh (btu/kWh)

ISR = In service rate of showerhead

= Dependant on program delivery method as listed in table below

Selection	ISR
Direct Install or Guided Self-Install	0.98[478]
Leave-Behind Kit	0.94[479]

For example, a direct-installed 1.5 GPM showerhead in an office with electric DHW where the number of showers is estimated at 3 per day:

ΔkWh = 1 * ((2.67*8.20)- (1.5*8.20)) * 3*365.25) *0.125 * 0.98

= 1288 kWh

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water\ (gallons) \ / \ 1{,}000{,}000 \ * \ E_{water\ total}$$

Where

$E_{water\ total}$ = IL Total Water Energy Factor (kWh/Million Gallons)

=5,010[480]

For example, a direct-installed 1.5 GPM showerhead in an office with where the number of showers is estimated at 3 per day:

ΔWater (gallons) = ((2.67 * 8.20)-(1.5 * 8.20)) * 3 * 365.25 * 0.98

= 10,302 gallons

ΔkWh_{water} = 10,302/1,000,000*5,010

= 52 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh/Hours \ * \ CF$$

Where:

ΔkWh = calculated value above. Note do not include the secondary savings in this calculation.

[477] Electric water heaters have recovery efficiency of 98%, as sourced from available products on the AHRI Certification Directory.

[478] Deemed values are from ComEd Energy Efficiency/ Demand Response Plan: Plan Year 2 (6/1/2009-5/31/2010) Evaluation Report: All Electric Single Family Home Energy Performance Tune-Up Program Table 3-8. Alternative ISRs may be developed for program delivery methods based on evaluation results.

[479] Based on DCEO STEP Program GPY5 evaluation report for showerheads and aerators. Guidehouse, *In-Service Rates for a CY2020 Business Remote Assessment Path for Customer Installed Measures*, August 21, 2020.

[480] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

Hours = Annual electric DHW recovery hours for showerhead use

= $((GPM_base * L_base) * NSPD * 365.25) * 0.608$ [481] / GPH

Where:

GPH = Gallons per hour recovery of electric water heater calculated for 89.3F temp rise (140-50.7), 98% recovery efficiency, and typical 12kW electric resistance storage tank.

= 53.9

CF = Coincidence Factor for electric load reduction

= 0.0278 [482]

For example, a direct-installed 1.5 GPM showerhead in an office with electric DHW where the number of showers is estimated at 3 per day:

ΔkW = (1288 / 271)*0.0278

= 0.132 kW

FOSSIL FUEL SAVINGS

ΔTherms = $\%FossilDHW * ((GPM_base * L_base - GPM_low * L_low) * NSPD * 365.25) * EPG_gas * ISR$

Where:

%FossilDHW = proportion of water heating supplied by fossil fuel heating

DHW Fuel	%Fossil_DHW
Electric	0%
Fossil Fuel	100%
Unknown	68%[483]

EPG_gas = Energy per gallon of Hot water supplied by gas

= $(8.33 * 1.0 * (ShowerTemp - SupplyTemp)) / (RE_gas * 100{,}000)$

= 0.0063 Therm/gal

Where:

RE_gas = Recovery efficiency of gas water heater

= 67% [484]

[481] 60.8% is the proportion of hot 140°F water mixed with 50.7°F supply water to give 105°F shower water.

[482] Calculated as follows: Assume 11% showers take place during peak hours (as sourced from "Analysis of Water Use in New Single Family Homes, Aquacraft Water Engineering and Management, January 2011). There are 65 days in the summer peak period, so the percentage of total annual aerator use in peak period is 0.11*65/365.25 = 1.96%. The number of hours of recovery during peak periods is therefore assumed to be 1.96% * 369 = 7.23 hours of recovery during peak period where 369 equals the average annual electric DHW recovery hours for showerhead use including SF and MF homes with Direct Install and Retrofit/TOS measures. There are 260 hours in the peak period so the probability you will see savings during the peak period is 7.23/260 = 0.0278.

[483] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

[484] Review of AHRI Directory suggests range of recovery efficiency ratings for new Gas DHW units of 70-87%. Average of existing units is estimated at 75%. Commercial properties are more similar to MF homes than SF homes. MF hot water is often

100,000 = Converts Btus to Therms (btu/Therm)

Other variables as defined above.

For example, a direct-installed 1.5 GPM showerhead in an office with gas DHW where the number of showers is estimated at 3 per day:

ΔTherms = 1.0 * ((2.67 *8.2) – (1.5 * 8.2)) * 3 * 365.25 * 0.0063 * 0.98

= 64.9 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

ΔWater (gallons) = $((GPM_base * L_base - GPM_low * L_low) * NSPD * 365.25 * ISR$

Variables as defined above

For example, a direct-installed 1.5 GPM showerhead in an office with where the number of showers is estimated at 3 per day:

ΔWater (gallons) = ((2.67 * 8.20)-(1.5 * 8.20)) * 3 * 365.25 * 0.98

= 10,302 gallons

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

Sources

Source ID	Reference
1	2011, DeOreo, William. California Single Family Water Use Efficiency Study. April 20, 2011.
2	2000, Mayer, Peter, William DeOreo, and David Lewis. Seattle Home Water Conservation Study. December 2000.
3	1999, Mayer, Peter, William DeOreo. Residential End Uses of Water. Published by AWWA Research Foundation and American Water Works Association. 1999.
4	2003, Mayer, Peter, William DeOreo. Residential Indoor Water Conservation Study. Aquacraft, Inc. Water Engineering and Management. Prepared for East Bay Municipal Utility District and the US EPA. July 2003.
5	2011, DeOreo, William. Analysis of Water Use in New Single Family Homes. By Aquacraft. For Salt Lake City Corporation and US EPA. July 20, 2011.
6	2011, Aquacraft. Albuquerque Single Family Water Use Efficiency and Retrofit Study. For Albuquerque Bernalillo County Water Utility Authority. December 1, 2011.
7	2008, Schultdt, Marc, and Debra Tachibana. Energy related Water Fixture Measurements: Securing the Baseline for Northwest Single Family Homes. 2008 ACEEE Summer Study on Energy Efficiency in Buildings.

MEASURE CODE: CI-HWE-LFSH-V10-260101

REVIEW DEADLINE: 1/1/2029

provided by a larger commercial boiler. This suggests that the average recovery efficiency is somewhere between a typical central boiler efficiency of .59 and the .75 for single family home. An average is used for this analysis by default.

4.3.4 Commercial Pool Covers

DESCRIPTION

This measure refers to the installation of covers on commercial use pools that are heated with gas-fired equipment located either indoors or outdoors. By installing pool covers, the heating load on the pool boiler will be reduced by reducing the heat loss from the water to the environment and the amount of actual water lost due to evaporation (which then requires additional heated water to make up for it). An additional benefit to pool covers are the electricity savings from the reduced fresh water required to replace the evaporated water.

The main source of energy loss in pools is through evaporation. This is particularly true of outdoor pools where wind plays a larger role. The point of installing pool covers is threefold. First, it will reduce convective losses due to the wind by shielding the water surface. Second, it will insulate the water from the colder surrounding air. And third, it will reduce radiative losses to the night sky. In doing so, evaporative losses will also be minimized, and the boiler will not need to work as hard in replenishing the pool with hot water to keep the desired temperature.

This measure can be used for pools that (1) currently do not have pool covers, (2) have pool covers that are past the useful life of the existing cover, or (3) have pool covers that are past their warranty period and have failed. Please note, IECC 2021 and 2024 require pool covers in outdoor applications, making this measure ineligible for new construction projects with outdoor pools. IECC 2024 has become effective statewide as of November 30th, 2025, and is the baseline for all New Construction permits from that date onward. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

DEFINITION OF EFFICIENT EQUIPMENT

For indoor pools, the efficient case is the installation of an indoor pool cover with a 5 year warranty on an indoor pool that operates all year.

For outdoor pools, the efficient case is the installation of an outdoor pool cover with a 5 year warranty on an outdoor pool that is open through the summer season.

DEFINITION OF BASELINE EQUIPMENT

For indoor pools, the base case is an uncovered indoor pool that operates all year.

For outdoor pools, the base case is an outdoor pool that is uncovered and is open through the summer season.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The useful life of this measure is assumed to be 6 years.[485]

DEEMED MEASURE COST

The table below shows the costs for the various options and cover sizes. Since this measure covers a mix of various sizes, the average cost of these options is taken to be the incremental measure cost.[486] Costs are per square foot.

[485] The effective useful life of a pool cover is typically one year longer than its warranty period. SolaPool Covers. Pool Covers Website, FAQ- "How long will my SolaPool cover blanket last?". Pool covers are typically offered with 3 and 5 year warranties with at least one company offering a 6 year warranty. Conversation with Trade Ally. Knorr Systems.
[486] Pool Cover Costs: Lincoln Commercial Pool Equipment online catalog. Accessed 8/26/11.

Cover Size	Edge Style	
	Hemmed (indoor)	Weighted (outdoor)
1000-1,999 sq. ft.	$2.19	$2.24
2,000-2,999 sq. ft.	$2.01	$2.06
3,000+ sq. ft.	$1.80	$1.83
Average	$2.00	$2.04

LOADSHAPE

Loadshape R15 – Residential Pool Pumps

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water\ (gallons) \ / \ 1{,}000{,}000 \ * \ E_{water\ supply}$$

Where

$E_{water\ supply}$ = Water Supply Energy Factor (kWh/Million Gallons)

= 2,571[487]

For example,

2400ft^2 Indoor Swimming Pool:

ΔWater = $WaterSavingFactor\ x\ Size\ of\ Pool$

= 15.28 gal./ft^2/year x 2400 ft^2

= 36,672 gal./year

ΔkWhwater = $\Delta Water \ / \ 1{,}000{,}000 \ * \ Ewater\ supply$

= 36,672 gal./year / 1,000,000 * 2,571 kWh/million gallons

= 96.3 kWh/year

2400ft^2 Outdoor Swimming Pool:

ΔWater = $WaterSavingFactor\ x\ Size\ of\ Pool$

= 8.94 gal./ft^2/year x 2400 ft^2

= 21,456 gal./year

ΔkWhwater = $\Delta Water \ / \ 1{,}000{,}000 \ * \ E_{water\ supply}$

= 21,456 gal./year / 1,000,000 * 2,571 kWh/million gallons

= 55.2 kWh/year

[487] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'. Note since the water loss associated with this measure is due to evaporation and does not discharge into the wastewater system, only the water supply factor is used here.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

The calculations are based on modeling runs using RSPEC! Energy Smart Pools Software that was created by the U.S. Department of Energy. [488]

$$\Delta\text{Therms} = SavingFactor\ x\ Size\ of\ Pool$$

Where

Savings factor = dependant on pool location and listed in table below:[489]

Location	Therm / sq-ft
Indoor	2.61
Outdoor	1.01

Size of Pool = custom input

WATER IMPACT DESCRIPTIONS AND CALCULATION

$$\Delta\text{Water (gallons)} = WaterSavingFactor\ x\ Size\ of\ Pool$$

Where

WaterSavingFactor = Water savings for this measure dependant on pool location and listed in table below:[490]

Location	Annual Savings Gal / sq-ft
Indoor	15.28
Outdoor	8.94

Size of Pool = Custom input

DEEMED O&M COST ADJUSTMENT CALCULATION

There are no O&M cost adjustments for this measure.

MEASURE CODE: CI-HWE-PLCV-V07-270101

REVIEW DEADLINE: 1/1/2029

[488] Full method and supporting information found in reference document: IL TRM - Business Pool Covers WorkPaper.docx. Note that the savings estimates are based upon Chicago weather data.
[489] Business Pool Covers.xlsx
[490] Ibid.

4.3.5 Tankless Water Heater – Measure combined with 4.3.1 Water Heater in Version 8

4.3.6 Ozone Laundry

DESCRIPTION

A new ozone laundry system(s) is added-on to new or existing commercial washing machine(s) using hot water heated with natural gas. The system generates ozone (O_3), a naturally occurring molecule, which helps clean fabrics by chemically reacting with soils in cold water. Adding an ozone laundry system(s) will reduce the amount of chemicals, detergents, and hot water needed to wash linens. Using ozone also reduces the total amount of water consumed, saving even more in energy.

Natural gas energy savings will be achieved at the hot water heater/boiler as they will be required to produce less hot water to wash each load of laundry. The decrease in hot water usage will increase cold water usage, but overall water usage at the facility will decrease.

Electric savings can be realized through reduced washer cycle length and reduced pumping load at the boiler feeding the commercial washers. The increased usage associated with operating the ozone system should also be accounted for when determining total kWh impact. Data reviewed for this measure characterization indicated that pumping savings should be accounted for, but washer savings and ozone generator consumption are comparatively so small that they can be ignored.

The reduced washer cycle length may decrease the dampness of the clothes when they move to the dryer. This can result in shorter runtimes which result in gas and electrical savings. However, at this time, there is inconclusive evidence that energy savings are achieved from reduced dryer runtimes so the resulting dryer effects are not included in this analysis. Additionally, there would be challenges verifying that dryer savings will be achieved throughout the life of the equipment.

This incentive only applies to the following facilities with on-premise laundry operations:

- Hotels/motels
- Fitness and recreational sports centers.
- Healthcare (excluding hospitals)
- Assisted living facilities
- Laundromats

Ozone laundry system(s) could create significant energy savings opportunities at other larger facility types with on-premise laundry operations (such as correctional facilities, universities, and staff laundries), however, the results included in this analysis are based heavily on past project data for the applicable facility types listed above and may not apply to facilities outside of this list due to variances in number of loads and average pound (lbs.)-capacity per project site. Projects at these facilities should continue to be evaluated through custom programs and the applicable facility types and the resulting analysis should be updated based on new information.

Laundromats are the only application where number of washing units needs to be used to calculate total site energy savings. All other applications use site assumptions to calculate total site savings.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

A new ozone laundry system(s) is added-on to new or existing commercial washing machine(s) using hot water heated with natural gas. The ozone laundry system(s) must transfer ozone into the water through:

- Venturi Injection
- Bubble Diffusion
- Additional applications may be considered upon program review and approval on a case by case basis
- For laundromats, the ozone laundry system(s) must be connected to both the hot and cold water inlets of the clothes washing machine(s) so that hot water is no longer provided to the clothes washer.

DEFINITION OF BASELINE EQUIPMENT

The base case equipment is a conventional washing machine system with no ozone generator installed. The washing machines are provided hot water from a gas-fired boiler.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure equipment effective useful life (EUL) is estimated at 10 years based on typical lifetime of the ozone generator's corona discharge unit.[491]

DEEMED MEASURE COST

The actual measure costs should be used if available. If not, the following deemed values should be used:

Application	Deemed Measure Cost
Laundromat	$25.53 / lbs capacity[492]
Hotel/Motel	$79.84 / lbs capacity[493]
Fitness and Recreation	
Healthcare	
Assisted Living	

LOADSHAPE

Loadshape C53 – Flat

COINCIDENCE FACTOR

Past project documentation and data collection is not sufficient to determine a coincidence factor for this measure. Value should continue to be studied and monitored through additional studies due to limited data points used for this determination.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Electric savings can be realized through reduced washer cycle length and reduced pumping load at the boiler feeding the commercial washers. There is also an increased usage associated with operating the ozone system. Data reviewed for this measure characterization indicated that while pumping savings is significant and should be accounted for, washer savings and ozone generator consumption are negligible, counter each other out and are well within the margin of error so these are not included to simplify the characterization.[494]

$$\Delta kWh_{PUMP} = HP * HP_{CONVERSION} * Hours * \%water_savings$$

Where:

ΔkWh_{PUMP} = Electric savings from reduced pumping load

[491] Aligned with other national energy efficiency programs and confirmed with national vendors

[492] Average cost per unit of capacity for laundromats was generated using data collected from previous Peoples Gas and North Shore Gas custom projects

[493] Average costs per unit of capacity were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR), as well as from the Nicor Custom Incentive Program, and the Nicor Emerging Technology Program (ETP). See referenced document Table 2 and RSMeans Mechanical Cost Data, 31st Annual Edition (2008)

[494] Washer savings were reviewed but were considered negligible and not included in the algorithm (0.00082 kWh / lbs-capacity, determined through site analysis through Nicor Emerging Technology Program (ETP) and confirmed with national vendors). Note that washer savings from Nicor's site analysis are smaller than those reported in a WI Focus on Energy case study (0.23kWh/100lbs, Hampton Inn Brookfield, November 2010). Electric impact of operating ozone generator (0.0021 kWh / lbs-capacity same source as washer savings) was also considered negligible and not included in calculations. Values should continue to be studied and monitored through additional studies due to limited data points used for this determination.

HP = Brake horsepower of boiler feed water pump;

= Actual, or use 5 HP if unknown[495]

$HP_{CONVERSION}$ = Conversion from Horsepower to Kilowatt

= 0.746

Hours = Actual associated boiler feed water pump hours

= Must be a custom calculation for laundromats, but 800 hours can be used for other applications if unknown[496]

%water_savings = water reduction factor: how much more efficient an ozone injection washing machine is compared to a typical conventional washing machine as a rate of hot and cold water reduction.

Application	%water_savings
Laundromat	10%[497]
Hotel/Motel	25%[498]
Fitness and Recreation	
Healthcare	
Assisted Living	

Using defaults above:

$\Delta kWh_{PUMP_LAUNDROMAT}$ = $5 * 0.746 * Hours * 0.10$

= $0.373\ kWh * Hours$

$\Delta kWh_{PUMP_All\ OTHER}$ = $5 * 0.746 * 800 * 0.25$

= $746\ kWh$

Default per pound: = $\Delta kWh_{PUMP} \ / \ Lbs - Capacity$

Where:

Lbs-Capacity = Total washer capacity measured in pounds of laundry

Application	Lbs-Capacity
Laundromat	Actual combined capacity of ozone connected washers
Hotel/Motel	254.38 lbs per site[499]
Fitness and Recreation	
Healthcare	
Assisted Living	

[495] Assumed average horsepower for boilers connected to applicable washer.

[496] Engineered estimate provided by CLEAResult review of Nicor custom projects. Machines spent approximately 7 minutes per hour filling with water and were in operation approximately 20 hours per day. Total pump time therefore estimated as 7/60 * 20 * 365 = 852 hours, and rounded down conservatively to 800 hours.

[497] Page 7, Laundries and Dry-Cleaning Operations, Watersmart Guidebook EBMUD_WaterSmart_Guide_Laundries_Dry-Cleaning_Operations.pdf.

[498] Average water reduction factors were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR). Table 6 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects. Nicor Savings Numbers are associated with ACEE_AWE_Ozone Laundry / From Gas Savings Calculations.

[499] Average lbs-capacity per project site was generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR), as well as from the Nicor Custom Incentive Program, and the Nicor Emerging Technology Program (ETP). See referenced document Table 2.

$\Delta kWh_{PUMPALL\ OTHERS}$ per pound = 746/254.38

= 2.93 kWh/lb

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure, but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$$\Delta kWh_{water} = \Delta Water\ (gallons) / 1{,}000{,}000 * E_{water\ total}$$

Where:

$\Delta Water\ (gallons)_{LAUNDROMAT}$ = $239 * Lbs_Capacity$[500]

$\Delta Water\ (gallons)_{ALL\ OTHERS}$ = $464{,}946$[501]

$E_{water\ total}$ = IL Total Water Energy Factor (kWh/Million Gallons)

=5,010[502]

Deemed savings using defaults:

$\Delta kWh_{water_LAUNDROMAT}$ = $(239 * Lbs - Cpacity)/1{,}000{,}000 * 5{,}010$

$\Delta kWh_{water_ALL\ OTHERS}$ = $464{,}946/1{,}000{,}000 * 5{,}010$

= $2{,}329\ kWh$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Past project documentation and data collection is not sufficient to determine summer coincident peak demand savings for this measure. Value should continue to be studied and monitored through additional studies due to limited data points used for this determination. In absence of site-specific data, the summer coincident peak demand savings should be assumed to be zero.

ΔkW = 0

FOSSIL FUEL SAVINGS

$$\Delta Therm = Therm_{Baseline} * \%hot_water_savings$$

Where:

ΔTherm = Gas savings resulting from a reduction in hot water use, in therm.

$Therm_{Baseline}$ = Annual Baseline Gas Consumption

= $WHE * WUtiliz * WUsage_hot$

Where:

WHE = water heating energy: energy required to heat the hot water used

= 0.00885 therm/gallon[503]

[500] See the "Water Impact Descriptions and Calculation" section of this measure for more information.

[501] See the "Water Impact Descriptions and Calculation" section of this measure for more information.

[502] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

[503] Assuming boiler efficiency is the regulated minimum efficiency (80%), per Title 20 Appliance Standard of the California Energy Regulations (October 2007). The incoming municipal water temperature is assumed to be 55°F with an average hot

WUtiliz = washer utilitzation factor: the annual pounds of clothes washed per year

= actual, if unknown the values below:

Application	WUtiliz
Laundromat	2,190[504] cycles per year * Lbs-Capacity
Hotel/Motel	916,150 lbs[505] (Approx. 4,745 cycles per year) per site
Fitness and Recreation	
Healthcare	
Assisted Living	

WUsage_hot = hot water usage factor: how much hot water a typical conventional washing machine utilizes, normalized per pounds of clothes washed

Application	WUsage_hot
Laundromat	0.64 gallons/lb[506]
Hotel/Motel	1.19 gallons/lb[507]
Fitness and Recreation	
Healthcare	
Assisted Living	

Using defaults above:

$Therm_{Baseline_LAUNDROMAT}$ = 0.00885 * (2,190 cycles per year * Lbs-Capacity) * 0.64

= 12.4 therms * Lbs-Capacity

$Therm_{Baseline_ALL\ OTHERS}$ = 0.00885 * 916,150 * 1.19

= 9648 therms

%hot_water_savings = hot water reduction factor: how much more efficient an ozone injection washing machine is, compared to a typical conventional washing machine, as a rate of hot water reduction

Application	%hot_water_savings
Laundromat	100%
Hotel/Motel	81%[508]
Fitness and Recreation	
Healthcare	
Assisted Living	

water supply temperature of 140°F, based on default test procedures on clothes washers set by the Department of Energy's Office of Energy Efficiency and Renewable Energy (Federal Register, Vol. 52, No. 166). Enthalpies for these temperatures (107 btu/lbs at 140°F, 23.07 btu/lbs at 55°F) were obtained from ASHRAE Fundamentals.

[504] DOE Technical Support Document Chapter 6, 2010 https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf

[505] Average utilization factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. Table 3 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects.

[506] Calculated as WUsage * Average % Hot water (estimated at 59% from Custom laundromat data); 1.09*0.59 = 0.64 gal / lbs laundry.

[507] Average hot water usage factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. Summarizes data gathered from several NRR-DR projects.

[508] Average hot water reduction factors were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR). Table 5 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects. Nicor Savings Numbers are associated with ACEE_AWE_Ozone Laundry / From Gas Savings Calculations.

Savings using defaults above:

ΔTherm $= Therm_{Baseline} * \%hot_water_savings$

$\Delta Therm_{LAUNDROMAT} = 12.4 * Lbs - Capacity * 100\%$

$= 12.4\ therms * Lbs - Capacity$

$\Delta Therm_{ALL\ OTHER} = 9648 * 81\%$

$= 7815\ therms\ per\ site$

Default per lb capacity:

$\Delta Therm_{LAUNDROMAT}$ / lb $= 12.4 * Lbs - Capacity\ /\ lb\ capacity$

$= 12.4\ therms\ /\ lb$

$\Delta Therm_{ALL\ OTHER}$ / lb $= 7815\ /\ 254.38$

$= 30.7\ therms\ /\ lb$

WATER IMPACT DESCRIPTIONS AND CALCULATION

The water savings calculations listed here account for the combination of hot and cold water used. Savings calculations for this measure were based on the reduction in total water use from implementing an ozone washing system to the base case. There are three main components in obtaining this value:

$$\Delta Water\ (gallons) = WUsage * WUtiliz * \%water_savings$$

Where:

ΔWater (gallons) = reduction in total water use from implementing an ozone washing system to the base case

WUsage = water usage factor: amount of total water used by a conventional washing machine normalized per unit of clothes washed

$WUsage_{LAUNDROMATS}$ = 1.09 gallons / lbs laundry[509]

$WUsage_{ALL\ OTHERS}$ = 2.03 gallons/lbs laundry[510]

WUtiliz = washer utilization factor: the annual pounds of clothes washed per year

= actual, if unknown use the values below:

Application	WUtiliz
Laundromat	2,190[511] cycles per year * Lbs-Capacity
Hotel/Motel	916,150 lbs[512] (Approx. 4,745 cycles per year) per site
Fitness and Recreation	
Healthcare	
Assisted Living	

[509] Based on Peoples Gas custom project data.

[510] Average water usage factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. summarizes data gathered from several NRR-DR projects.

[511] DOE Technical Support Document Chapter 6, 2010 https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf

[512] Average utilization factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program. Table 3 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects.

%water_savings = water reduction factor: how much more efficient an ozone injection washing machine is compared to a typical conventional washing machine as a rate of hot and cold water reduction.

Application	%water_savings
Laundromat	10%[513]
Hotel/Motel	25%[514]
Fitness and Recreation	
Healthcare	
Assisted Living	

Savings using defaults above:

$\Delta Water = WUsage * WUtiliz * \%water_savings$

$\Delta Water_{LAUNDROMATS} = 1.09 * WUtiliz * 0.1$

$= 1.09 * (2{,}190 * Lbs - Capacity) * 0.1$

$= 239 * Lbs - Capacity$

$\Delta Water_{ALL\ OTHERS} = 2.03 * 916{,}150 * 0.25$

$= 464{,}946\ gallons\ per\ site$

Default per pound:

$\Delta Water_{LAUNDROMATS}$ / lb capacity $= (239 * Lbs - Capacity) / lb - capacity$

$= 239\ gallons/lb$

Δ Water $_{ALL\ OTHERS}$ / lb-capacity $= 464{,}946 / 254.38$

$= 1{,}828\ gallons / lb$

DEEMED O&M COST ADJUSTMENT CALCULATION

Maintenance is required for the following components annually:[515]

- Ozone Generator: filter replacement, check valve replacement, fuse replacement, reaction chamber inspection/cleaning, reaction chamber o-ring replacement
- Air Preparation – Heat Regenerative: replacement of two medias
- Air Preparation – Oxygen Concentrators: filter replacement, pressure relief valve replacement, compressor rebuild
- Venturi Injector: check valve replacement

Maintenance is expected to cost $0.79 / lbs capacity.

Sources

[513] Page 7, Laundries and Dry-Cleaning Operations, Watersmart Guidebook EBMUD_WaterSmart_Guide_Laundries_Dry-Cleaning_Operations.pdf.

[514] Average water reduction factors were generated using data collected from existing ozone laundry projects that received incentives under the Non-Residential Retrofit Demand Reduction program (NRR-DR). Table 6 summarizes data gathered from several NRR-DR projects, Nicor Custom projects, and Nicor ETP projects. Nicor Savings Numbers are associated with ACEE_AWE_Ozone Laundry / From Gas Savings Calculations.

[515] Confirmed through communications with national vendors and available references, via an online forum (The Ozone Laundry Blog – The Importance of Maintenance).

Source ID	Reference
1	"Lodging Report", December 2008, California Travel & Tourism Commission, http://tourism.visitcalifornia.com/media/uploads/files/editor/Research/CaliforniaTourism_200812.pdf
2	"Health, United States, 2008" Table 120, U.S. Department of Health & Human Services, Centers for Disease Control & Prevention, National Center for Health Statistics, http://www.cdc.gov/nchs/data/hus/hus08.pdf#120
3	Fourth Quarter 2008 Facts and Fictures, California Department of Corrections & Rehabilitation (CDCR), http://www.cdcr.ca.gov/Divisions_Boards/Adult_Operations/docs/Fourth_Quarter_2008_Facts_and_Figures.pdf
4	Jail Profile Survey (2008), California Department of Corrections & Rehabilitation (CDCR), http://www.cdcr.ca.gov/Divisions_Boards/CSA/FSO/Docs/2008_4th_Qtr_JPS_full_report.pdf
5	DEER2011_NTGR_2012-05-16.xls from DEER Database for Energy-Efficient Resources; Version 2011 4.01 Under: DEER2011 Update Documentation linked at: DEER2011 Update Net-To-Gross table Cells: T56 and U56
6	The Benefits of Ozone in Hospitality On-Premise Laundry Operations, PG&E Emerging Technologies Program, Application Assessment Report #0802, April 2009.
7	Federal Register, Vol. 52, No. 166
8	2009 ASHRAE Handbook – Fundamentals, Thermodynamic Properties of Water at Saturation, Section 1.1 (Table 3), 2009
9	Table 2 through 6: Excel file summarizing data collected from existing ozone laundry projects that received incentives under the NRR-DR program
10	DOE Technical Support Document Chapter 6, 2010 https://www.regulations.gov/contentStreamer?documentId=EERE-2006-STD-0127-0118&attachmentNumber=8&disposition=attachment&contentType=pdf
11	GTI Residential Ozone Laundry Field Demonstration (May 2018)

MEASURE CODE: CI-HWE-OZLD-V07-230101

REVIEW DEADLINE: 1/1/2030

4.3.7 Multifamily Central Domestic Hot Water Plants

DESCRIPTION

This measure covers multifamily central domestic hot water (DHW) plants with thermal efficiencies greater than or equal to 88%. This measure is applicable to any combination of boilers and storage tanks provided the thermal efficiency of the boiler(s) is greater than 88%. Plants providing other than solely DHW are not applicable to this measure.

This measure was developed to be applicable to the following program types: TOS, NC, ER.

If applied to other program types, the measure savings should be verified.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025 while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. As code requirements and adoption can differ from municipality to municipality, the user should always verify which version of code is applicable.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify, the boiler(s) must have a Thermal Efficiency of 88% or greater and supply domestic hot water to multi-family buildings.

DEFINITION OF BASELINE EQUIPMENT

For TOS, the baseline boiler is assumed to have a Thermal Efficiency of 80%.[516]

For Early Replacement, the savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit as above and efficient unit consumption for the remainder of the measure life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the domestic hot water boilers is 15 years.[517]

DEEMED MEASURE COST

TOS: The actual install cost should be used for the efficient case, minus the baseline cost assumption provided below:

Capacity Range	Baseline Installed Cost per kBtuh[518]
< 300 kBtuh	$65 per kBtuh
300 – 2500 kBtuh	$38 per kBtuh
> 2500 kBtuh	$32 per kBtuh

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

[516] International Energy Conservation Code (IECC) 2012/2015/2018/2021/2024, Table C404.2, Minimum Performance of Water-Heating Equipment, hot water supply boiler, gas.
[517] Nicor Gas Energy Efficiency Plan 2011-2014. Revised Plan Filed Pursuant to Order Docket 10-0562, May 27, 2011.
[518] Baseline install costs are based on data from the "2010-2012 WO017 Ex Ante Measure Cost Study", Itron, California Public Utilities Commission. The data is provided in a file named "MCS Results Matrix – Volume I".

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

There are no anticipated electrical savings from this measure.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Time of Sale:

ΔTherms $= Hot\ Water\ Savings\ +\ Standby\ Loss\ Savings$

$=[(MFHH * \#Units * GPD * Days/yr * \gamma_{Water} * (T_{out} - T_{in}) * (1/Eff_{base} - 1/Eff_{ee})) / 100{,}000] + [((SL * Hours/yr * (1/Eff_{base} - 1/Eff_{ee})) / 100{,}000]$

Early Replacment:[519]

ΔTherms for remaining life of existing unit (first 5 years):

$=[(MFHH * \#Units * GPD * Days/yr * \gamma_{Water} * (T_{out} - T_{in}) * (1/Eff_{exist} - 1/Eff_{ee})) / 100{,}000] + [((SL * Hours/yr * (1/Eff_{exist} - 1/Eff_{ee})) / 100{,}000]$

ΔTherms for remaining measure life (next 10 years):

$=[(MFHH * \#Units * GPD * Days/yr * \gamma_{Water} * (T_{out} - T_{in}) * (1/Eff_{base} - 1/Eff_{ee})) / 100{,}000] + [((SL * Hours/yr * (1/Eff_{base} - 1/Eff_{ee})) / 100{,}000]$

Where:

MFHH = number of people in multifamily household

Household Unit Type	Household[520]		
	IQ Participants	Non-IQ Participants	All Participants
Multifamily - Deemed	2.3	2.09	2.18
Custom	Actual Occupancy or Number of Bedrooms[521]		

#Units = Number of units served by hot water boiler

= Actual

GPD = Gallons of hot water used per person per day

[519] The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a "number of years to adjustment" and "savings adjustment" input which would be the (new base to efficient savings)/(existing to efficient savings).

[520] Assumptions are taken from the draft unadjusted 2024 Baseline Study evaluation data provided in 07/2024 by GDS Associates.

[521] Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

= Actual. If unknown assume 17.6 gallons per person per day[522]

Days/yr = 365.25

γ_{Water} = Specific Weight of Water

= 8.33 gal/lb

T_{out} = tank temperature of hot water

= 125°F or custom

T_{in} = Incoming water temperature from well or municipal system

= 50.7°F [523]

Eff_{base} = thermal efficiency of base unit

= 80%[524]

Eff_{ee} = thermal efficiency of efficient unit complying with this measure

= Actual. If unknown assume 88%

Eff_{exist} = thermal efficiency of existing unit

= Actual. If unknown assume 73%[525]

SL = Standby Loss[526]

= (Input rating / 800) + (110 * √(Tank Volume)).

Input rating = Name plate input capacity in btuh

Tank Volume = Rated volume of the tank in gallons

Hours/yr = 8766 hours

100,000 = btu/therm

[522] Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

[523] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[524] IECC 2021, Table C404.2, Minimum Performance of Water-Heating Equipment, hot water supply boiler, gas.

[525] Based upon DCEO data provided 10/2014; average age adjusted efficiency of existing units replaced through the program. Efficiency age adjustment of 0.5% per year based upon NREL "Building America Performance Analysis Procedures for Existing Homes".

[526] Stand-by loss is provided in IECC 2012/2015/2018, Table C404.2, Minimum Performance of Water-Heating Equipment.

Time of Sale:

For example, an 88% 1000-gallon boiler with 150,000 btuh input rating installed serving 50 units with average 2.1 people per unit.

ΔTherms $= Hot\ Water\ Savings\ +\ Standby\ Loss\ Savings$

$=[(MFHH * \#Units * GPD * Days/yr * \gamma_{Water} * (T_{out} - T_{in}) * (1/Eff_{base} - 1/Eff_{ee}))\ /\ 100{,}000] + [((SL * Hours/yr * (1/Eff_{base} - 1/Eff_{ee}))\ /\ 100{,}000]$

$= [(2.1 * 50 * 17.6 * 8.33 * 365.25 * 1.0 * (125 - 50.7) * (1/0.8 - 1/0.88))\ /\ 100{,}000] + [((150{,}000/800 + (110 * \sqrt{1000}) * 8766 * (1/0.8 - 1/0.88))\ /\ 100{,}000]$

$= 475\ +\ 37$

$= 512\ therms$

Early Replacement:

For example, an 88% 1000-gallon boiler with 150,000 btuh input rating installed serving 50 units with average 2.1 people per unit replaces a working unit with unknown efficiency.

ΔTherms for remaining life of existing unit first 5 years):

$= [(2.1 * 50 * 17.6 * 8.33 * 365.25 * 1.0 * (125 - 50.7) * (1/0.73 - 1/0.88))\ /\ 100{,}000] + [((150{,}000/800 + (110 * \sqrt{1000}) * 8766 * (1/0.73 - 1/0.88))\ /\ 100{,}000]$

$= 975\ +\ 75$

$= 1050\ therms$

ΔTherms for remaining measure life (next 10 years):

= 475 + 37 (as above)

= 512 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-MDHW-V09-270101

REVIEW DEADLINE: 1/1/2029

4.3.8 Controls for Central Domestic Hot Water

DESCRIPTION

Demand control recirculation pumps seek to reduce inefficiency by combining control via temperature and demand inputs, whereby the controller will not activate the recirculation pump unless both (a) the recirculation loop return water has dropped below a prescribed temperature (e.g., 100°F) and (b) a CDHW demand is sensed as water flow through the CDHW system.

This measure was developed to be applicable to the following program types: TOS, RF, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

There are three efficient technologies to be considered:

- Timer-based: allows the user to program a schedule to perform recirculation during specific windows throughout the day.
- Aquastat-controlled: calls for recirculation when the water temperature at one point in the system falls below a certain pre-programmed setpoint (e.g., 100°F).
- On-Demand: senses the demand as water flow through the CDHW system. These types of system are most adequate on small central water heating systems.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure category is existing, uncontrolled recirculation pumps on gas-fired CDHW system.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The effective useful life is 15 years.[527]

DEEMED MEASURE COST

The average cost of the demand controller circulation kit is $1,442 with an installation cost of $768 for a total measure cost of $2,210.[528]

LOADSHAPE

Loadshape C02 - Non-Residential Electric DHW

COINCIDENCE FACTOR

N/A

[527] Benningfield Group. (2009). *PY 2009 Monitoring Report: Demand Control for Multifamily Central Domestic Hot Water.* Folsom, CA: Prepared for Southern California Gas Company, October 30, 2009.

[528] The incremental costs were averaged based on the following multi-family, dormitory and hospitality building studies-
Gas Technology Institute. (2014). *1003: Demand-based domestic hot water recirculation Public project report.* Des Plaines, IL: Prepared for Nicor Gas, January 7, 2014.
Studies performed in multiple dormitory buildings in the California region for Southern California Gas' PREPS Program, 2012.
Evaluation of New DHW System Controls in Hospitality and Commercial Buildings. Prepared for: Minnesota Department of Commerce, Division of Energy Resources, 2018.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \Delta kWh_{heater} + \Delta kWh_{pump}$$

ΔkWh_{heater} = $\%ElecDHW * Boiler\ Capacity * (t_{normal\ occ} * R_{normal\ occ} + t_{low\ occ} * R_{low\ occ}) / 3{,}412$

ΔkWh_{pump} = $(HP_{recirc} * 0.746 * (8760 - Pump_{hrs\ controlled}) / Motor_{eff}$

ΔkWh_{pump} = 1,103[529] kWh as default value if values unknown.

Where:

%ElecDHW = proportion of water heating supplied by electric resistance heating

= 1 if electric DHW; 0 if fuel DHW. If unknown, assume 32%[530]

Boiler Capacity = Input Capacity of the Domestic Hot Water boiler in BTU/hr. When paired with the installation of a new boiler, use the actual capacity of the new boiler.

= If the facility uses the same boiler for space heat and domestic hot water, estimate the boiler input capacity for only domestic hot water loads. If this cannot be estimated, use the table below:

Building Type	% of Boiler Input Capacity	Or Use the Following Formulas
Multifamily	22.75%[531]	= 12,493 BTU/hr * (#Apartments) [532]
Dormitories	16.48%[533]	= 4,938 BTU/hr * (#Rooms) [534]
Hotels/Motels	12.33%[535]	= 3,696 BTU/hr * (#Rooms) [536]
Offices	Use Actual Size	Use Actual Size

[529] This value is the average kWh saved per pump based on results from Multi-Family buildings studied in Nicor Gas Emerging Technology Program study, Southern California Gas' study in multiple dormitory buildings, and Minnesota's Evaluation of New DHW System Controls in Hospitality and Commercial Buildings. Note this value does not reflect savings from electric units but electrical savings from gas-fired units. See 'CDHW Controls Summary Calculations.xlsx' for more information.

[530] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

[531] This is an average number based on Residential Energy Consumption Survey (2009) data and Commercial Building Energy Consumption Survey (2012) data compiled by U.S. Energy Information Administration, for buildings with more than 5 apartments in Illinois and Nursing Home and Assisted Living facilties in Midwest.

[532] This is based on studies done in multiple university dormitory buildings in the California region, for Southern California Gas' PREPS Program, 2012. It closely matches the design guidelines outlined in 2007 ASHRAE Handbook, Chapter 49: Service Water Heating, Table 7, and assumes 1 to 2 students per dorm room based on typical dorm room layouts. This source provides the source for dormitory assumptions of Boiler Input Capacity, $t_{low\ occ}$, $R_{normal\ occ}$ and $R_{low\ occ}$.

[533] This is based on Commercial Building Energy Consumption Survey (2012) data compiled by U.S. Energy Information Administration, for Education facilities in East North Central.

[534] This is based on studies done at Multi-Family Buildings for the Nicor Gas Emerging Technology Program by Gas Technology Institute. It closely matches the design guidelines outlined in 2007 ASHRAE Handbook, Chapter 49: Service Water Heating, Table 9, and assumes 2.1 persons per apartment as per ComEd PY3 Multi-Family Home Energy Savings Program Evaluation Report Final, May 16, 2012, by Navigant. This source provides the source for dormitory assumptions of Boiler Input Capacity, $t_{low\ occ}$, $R_{normal\ occ}$ and $R_{low\ occ}$.

[535] This value is ratioed upon the Btu per Dwelling per Hotel/Motel vs Dormitory building type assuming the same heating capacity requirements based upon the similarity between the building types.

[536] Calculated based upon ASHRAE 2015 ASHRAE HVAC Applications Table 6 and IL TRM assumptions. See 'CDHW Controls Summary Calculations.xlsx' for more information

$t_{normal\ occ}$ = Total operating hours of domestic hot water burner when the facility has normal occupancy. If unknown, use the following table.

$t_{low\ occ}$ = Total operating hours of domestic hot water burner, when the facility has low occupancy.[537] If unknown, use the following table.

$R_{normal\ occ}$ = Reduction(%) in total operating hours of domestic hot water burner, due to installed central domestic hot water controls, during normal occupancy period. Values are set in the table below.

$R_{low\ occ}$ = Reduction(%) in total operating hours of domestic hot water burner, due to installed central domestic hot water controls, during low occupancy period. Values are set in the table below.

Building Type	$t_{normal\ occ}$ (hours)	$t_{low\ occ}$ (hours)	$R_{normal\ occ}$ (%)	$R_{low\ occ}$ (%)
Multi-Family	2,089[538]	0	24.02%	0%
Dormitories	1,688[539]	520[540]	22.44%	44.57%[541]
Hotels/Motels	2,428[542]	0	13.44%[543]	0%
Offices	2,857[544]	1,231	22.90%	41.70%

$HP_{recirculating}$ = the size of the recirculating pump in HP

0.746 = Conversion factor kW/HP

8760 = Hours of operation of uncontrolled recirculating pump

$Pump_{hrs\ controlled}$ = The table below corresponds to the control types for commercial buildings

Hours of Operation[545]	
Timer	6,570
Aquastat-Controlled	1,095
On Demand	122

$Motor_{eff}$ = The efficiency of the pump motor. Use actual or, if unknown, use the table below:

[537] Low occupancy periods for dormitory buildings can be assumed as vacation day or holiday occupancy.
[538] Based on results of the studies done at Multi-Family Buildings for the Nicor Gas Emerging Technology Program:
Gas Technology Institute. (2014). *1003: Demand-based domestic hot water recirculation Public project report.* Des Plaines, IL: Prepared for Nicor Gas, January 7, 2014.
[539] Based on results of studies performed in multiple university dormitory buildings in the California region, for Southern California Gas' PREPS Program, 2012.
[540] Low occupancy periods for dormitory buildings can be assumed as vacation day or holiday occupancy.
[541] Estimated from low occupancy hours
[542] Calculated from the Btu per dwelling unit and average annual therm consumption for DHW for all Hospitality Buildings noted in "Evaluation of New DHW System Controls in Hospitality and Commercial Buildings", MN Commerce Department Energy Resources, 06/30/2018.
[543] Average Hospitallity Savings, "Evaluation of New DHW System Controls in Hospitality and Commercial Buildings", MN Commerce Department Energy Resources, 06/30/2018.
[544] Based on the report, Energy Efficiency with Domestic Water Heating in Commercial Buildings, ACEEE Summer Study on Energy Efficiency in Buildings, 2010. Using the tables of results for Tuesday, Saturday and Sunday to estimate blended values for $t_{normal\ occ}$, $t_{low\ occ}$, $R_{normal\ occ}$ and $R_{low\ occ}$.
[545] The Hours of operation of recirculating pump for commercial buildings in general from Research and Analysis of the Benefits of Appliance Standards for Domestic Hot Water Circulator Pumps. Energy Solutions (October 2021)

Motor HP	Efficiency
0.25	66.7%
0.33	70.6%
0.5	75.3%
0.75	79.6%
1.0	81.2%
1.5	84.8%
2.0	85.8%
3.0	87.2%

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Gas savings for this measure can be calculated by using site specific boiler size and boiler usage information or deemed values are provided based on number of rooms for Dormitories and number of apartments for multifamily buildings.[547]

$$\Delta\text{Therms} = \%FossilDHW * Boiler\ Input\ Capacity * (t_{normal\ occ} * Rnormal\ occ + t_{low\ occ} * R_{low\ occ}) / 100{,}000$$

Where:

%FossilDHW = proportion of water heating supplied by fossil fuel heating.

= 0 if electric DHW; 1 if fuel DHW. If unknown, assume 68%[548]

Boiler Input Capacity = Input capacity of the Domestic Hot Water boiler in BTU/hr.

= If the facility uses the same boiler for space heat and domestic hot water, estimate the boiler input capacity for only domestic hot water loads. If this cannot be estimated, use the following table:

[546] Blended efficiencies for small motors IECC 2021, Table C405.8(2), Table C405.8(3) and Table C405.8(3)

[547] See 'CDHW Controls Summary Calculations.xlsx' for more information.

[548] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

Building Type	% of Boiler Input Capacity	Or Use the Following Formulas
Multifamily	22.75% [549]	= 12,493 BTU/hr * (#Apartments) [550]
Dormitories	16.48% [551]	= 4,938 BTU/hr * (#Rooms) [552]
Hotels/Motels	12.33% [553]	= 3,696 BTU/hr * (#Rooms) [554]
Offices	Use Actual Size	Use Actual Size

Other variables as provided above.

Based on defaults above:

ΔTherms = 30.1 * number of rooms (for dormitories)

= 62.7 * number of apartments (for multifamily buildings)

= 12.06 * number of rooms (hotels/motels)

For example, a dormitory building has a 400,000 BTU/hr boiler whose burner operates for an estimated 580 hours during vacation months and 1,300 hours during regular occupancy months. Savings from installing central domestic hot water controls in this building are:

ΔTherms = 400,000 BTU/hr * (1,300 * 0.2244 + 580 * 0.4457) / 100,000

= 2,201 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-CDHW-V08-260101

REVIEW DEADLINE: 1/1/2031

[549] This is an average number based on Residential Energy Consumption Survey (2009) data and Commercial Building Energy Consumption Survey (2012) data compiled by U.S. Energy Information Administration, for buildings with more than 5 apartments in Illinois and Nursing Home and Assisted Living facilties in Midwest.

[550] This is based on studies done in multiple university dormitory buildings in the California region, for Southern California Gas' PREPS Program, 2012. It closely matches the design guidelines outlined in 2007 ASHRAE Handbook, Chapter 49: Service Water Heating, Table 7, and assumes 1 to 2 students per dorm room based on typical dorm room layouts. This source provides the source for dormitory assumptions of Boiler Input Capacity, $t_{low\ occ}$, $R_{normal\ occ}$ and $R_{low\ occ}$.

[551] This is based on Commercial Building Energy Consumption Survey (2012) data compiled by U.S. Energy Information Administration, for Education facilities in East North Central.

[552] This is based on studies done at Multi-Family Buildings for the Nicor Gas Emerging Technology Program by Gas Technology Institute. It closely matches the design guidelines outlined in 2007 ASHRAE Handbook, Chapter 49: Service Water Heating, Table 9, and assumes 2.1 persons per apartment as per ComEd PY3 Multi-Family Home Energy Savings Program Evaluation Report Final, May 16, 2012 by Navigant. This source provides the source for dormitory assumptions of Boiler Input Capacity, $t_{low\ occ}$, $R_{normal\ occ}$ and $R_{low\ occ}$.

[553] This value is ratioed upon the Btu per Dwelling per Hotel/Motel vs Dormitory building type assuming the same heating capacity requirements based upon the similarity between the building types.

[554] Calculated based upon ASHRAE 2015 ASHRAE HVAC Applications Table 6 and IL TRM assumptions. See 'CDHW Controls Summary Calculations.xlsx' for more information

4.3.9 Heat Recovery Grease Trap Filter

DESCRIPTION

A heat recovery grease trap filter combines grease filters and a heat exchanger to recover heat leaving kitchen hoods. As a direct replacement for conventional hood mounted filters in commercial kitchens, they are plumbed to the domestic hot water system to provide preheating energy to incoming water.

This measure was developed to be applicable to the following program types: NC and RF. If applied to other program types, the measure savings should be verified. For NC projects, this measure may be applicable if code requirements are otherwise satisfied.

DEFINITION OF EFFICIENT EQUIPMENT

Grease filters with heat exchangers carrying domestic hot water in kitchen exhaust air ducts.

DEFINITION OF BASELINE EQUIPMENT

Kitchen exhaust air duct with constant air flow and no heat recovery.[555]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[556]

DEEMED MEASURE COST

Full installation costs, including plumbing materials, labor and any associated controls, should be used for screening purposes.

LOADSHAPE

Loadshape C01 - Commercial Electric Cooking

COINCIDENCE FACTOR

Summer Peak Coincidence Factor for measure is provided below for different building type:[557]

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.36
Unknown	0.40

[555] Savings methodology factors are for a constant speed fan.
[556] Professional judgement, consistent with expected lifetime of kitchen demand ventilation controls and other kitchen equipment.
[557]Minnesota 2012 Technical Reference Manual, Electric Food Service_v03.2.xls

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

For electric hot water heaters:

$$\Delta kWh = [(Meal/Day * HW/Meal * Days/Year) * lbs/gal * BTU/lb.°F * (\Delta T/filter * Qty_Filter) * 0.000293] / (\eta_{HeaterElec})$$

Where:

Meal/Day = Average number of meals served per day. If not directly available, see Table 1.

HW/Meal = Hot water required per meal

= 3 gal/meal[558]

Days/Year = Number of days kitchen operates per year. If not directly available, see Table 1.

Lbs/gal = Density of water

= 8.3 lbs/gal

BTU/lb.°F = Specific heat of water

= 1.0

ΔT/filter = Temperature difference of domestic water across each filter

= 5.8°F/filter[559]

Qty_Filter = Number of heat recovery grease trap filters installed. If not directly available, see Table 1.

Commercial Kitchen Load based on Building Type

Building Type	Meals/Day[560]	Assumed days/Year	Number of Filters[561]
Primary School	400	312	2
Secondary School	600	312	3
Quick Service Restaurant	800	312	5
Full Service Restaurant	780	312	4
Large Hotel	780	356	4
Hospital	800	356	4

$\eta_{HeaterElec}$ = Efficiency of the Electric water heater.

= Actual. If unknown, for retrofit use the table C404.2 in IECC 2012. For new construction use the active code at time the permit was issued.

[558] Average dishwashing and faucet water usage taken from Chapter 8, Table 8.3.3 Normalized Annual End Uses of Water in Select Restaurants in Western United States.

[559] Average value based on case studies. Northwinds Sailing, Inc. and North Shore Sustainable Energy, LLC. *Angry Trout Café Kitchen Exhaust Heat Recovery.* Minnesota Department of Commerce, Division of Energy Resources, 2012.

[560] Commercial Kitchen Loads for listed buildings in U.S. Department of Energy Commercial Reference Building Models of the National Building Stock, NREL

[561] Each filter is 20 X 20 inches.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = ΔkWh/Hours * CF

Where:

Hours = Hours of operation of kitchen exhaust air fan. If not directly available use:

Building Type	Kitchen Exhaust Fan Annual Operating Hours[562]
Primary School	4,056
Secondary School	4,056
Quick Service Restaurant	5,616
Full Service Restaurant	5,616
Large Hotel	5,340
Hospital	3,916

CF = Summer Peak Coincidence Factor for measure:[563]

Location	CF
Fast Food Limited Menu	0.32
Fast Food Expanded Menu	0.41
Pizza	0.46
Full Service Limited Menu	0.51
Full Service Expanded Menu	0.36
Cafeteria	0.36
Unknown	0.40

FOSSIL FUEL SAVINGS

For natural gas hot water heaters:

$$\Delta\text{Therm} = [(Meal/Day * HW/Meal * Days/Year) * lbs/gal * BTU/lb.°F * (\Delta T/filter * Qty_Filter] / (\eta_{HeaterGas} * 100{,}000)$$

Where:

$\eta_{HeaterGas}$ = Efficiency of the Gas water heater. If not directly available, use:

= Actual. If unknown, for retrofit use the table C404.2 in IECC 2012. For new construction use the active code at time the permit was issued.

Other variables as above.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

O&M savings may result from reduced filter and hood cleaning frequencies. More research should be done to understand any potential savings and the associated value.

[562] Exhaust Fan Schedules for listed buildings in U.S. Department of Energy Commercial Reference Building Models of the National Building Stock, NREL.

[563] Minnesota 2012 Technical Reference Manual, Electric Food Service_v03.2.xls.

MEASURE CODE: CI-HWE-GRTF-V04-240101

REVIEW DEADLINE: 1/1/2030

4.3.10 DHW Boiler and Water Heater Tune-up

DESCRIPTION

Domestic hot water (DHW) boilers and water heaters provide hot water for bathrooms, kitchens, tubs and other appliances. Several commercial and industrial facilities such as multi-family buildings, lodging and restaurants have a separate hot water boiler serving DHW loads. Unlike space heating boilers, DHW boilers operate year round, which means they have a greater need to be properly maintained and tuned up.

This measure calculates savings for tuning up a DHW boiler or water heater to improve its efficiency and reduce its consumption. A boiler or water heater tune-up involves cleaning/inspecting burners, burner nozzles and combustion chambers, adjusting air flow and burner gas input to reduce stack temperatures, and checking venting and safety controls. A pre- and post- tune up combustion efficiency ticket (from combustion analyzer) can be used to confirm the improvement in boiler efficiency.

Boilers that serve only a DHW load are eligible for this measure, as are all types of central gas water heaters (including gas storage and tankless water heaters) for multifamily properties.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements[564] listed below, by approved technician:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces.
- Inspect all refractory. Patch and wash coat as required.
- Inspect gaskets on front and rear doors and replace as necessary.
- Seal and close front and rear doors properly.
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.
- Clean plugs in control piping.
- Remove all hand hole and man hole plates. Flush boiler or water heater with water to remove loose scale and sediment.
- Replace all hand hole and man hole plates with new gaskets.
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.
- Make necessary adjustments to burner for proper combustion.

[564] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up.

- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and man hole plates for leaks at normal operating temperatures and pressures.
- Troubleshoot any boiler system or water heater problems as requested by on-site personnel

DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a boiler or central water heater for a multifamily property that has not had a tune-up within the past 36 months.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 3 years.[565]

DEEMED MEASURE COST

The cost of this measure is $0.83/MBtu/hr per tune-up.[566]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = ((T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma_{water} * 1 * (1/Eff_{before} - 1/Eff_{after}))/100{,}000$$

Where:

T_{OUT}	= Hot water storage tank temperature
	= 125°F
T_{IN}	= Incoming water temperature from well or municipal system
	= 50.7°F [567]
$HotWaterUse_{Gallon}$	= Estimated annual hot water consumption (gallons)
	= Actual if possible to provide reasonable custom estimate. If not, the following methods are provided to develop an estimate:[568]

[565] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up.
[566] Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012
[567] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.
[568] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL

1. Consumption per usable storage tank capacity

= Capacity * Consumption/cap

Where:

Capacity = Usable capacity of hot water storage tank in gallons

= Actual

Consumption/cap = Estimate of consumption per gallon of usable tank capacity, based on building type:

Building Type[569]	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894

2. Consumption per unit area by building type

= (Area/1000) * Consumption/1,000 sq.ft.

Where:

Area = Area in sq.ft that is served by DHW boiler or water heater

= Actual

Consumption/1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:

Building Type	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941

White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

[569] According to CBECS 2012 “Lodging” buildings include Dormitories, Hotels, Motel or Inns and other Lodging and “Nursing” buildings include Assisted Living and Nursing Homes.

Building Type	Consumption/1,000 sq.ft.
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

3. Consumption by number of people per household

= GPD * Household * 365.25

Where:

GPD = Gallons Per Day of hot water use per person

= 45.5 gallons hot water per day per household / 2.59 people per household.[570]

= 17.6

Household = Average number of people per household

Household Unit Type	Household[571]		
	IQ Participants	Non-IQ Participants	All Participants
Multifamily - Deemed	2.3	2.09	2.18
Custom	Actual Occupancy or Number of Bedrooms[572]		

Use Multifamily if: Building meets utility's definition for multifamily

365.25 = Days per year, on average

γ_{water} = Specific weight capacity of water (lb/gal)

= 8.33 lbs/gal

1 = Specific heat of water (Btu/lb.°F)

Eff_{before} = Efficiency of the boiler or water heater before tune-up

Eff_{after} = Efficiency of the boiler or water heater after tune-up

100,000 = Converts Btu to therms

Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the year and take readings at a consistent firing rate for pre and post tune-up.

[570] Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation. Reprinted With Permission.

[571] Assumptions are taken from the draft unadjusted 2024 Baseline Study evaluation data provided in 07/2024 by GDS Associates.

[572] Bedrooms are suitable proxies for household occupancy, and may be preferable to actual occupancy due to turnover rates in residency and non-adult population impacts.

For example, tune up of a DHW Boiler heating a 100 gallon storage tank in a nursing home, measuring 80% AFUE prior to tune up and 82.2% AFUE after.

ΔTherms = $((T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma_{water} * 1 * (1/Eff_{before} - 1/Eff_{after}))/100{,}000$

= ((125 – 50.7) * (100 * 672) * 8.33 * 1 * (1/0.8 – 1/0.822))/100,000

= 13.9 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-DBTU-V03-250101

REVIEW DEADLINE: 1/1/2029

4.3.11 Tunnel Washers

DESCRIPTION

Laundry equipment can be found at a variety of facilities, including hospitals, hotels, health clubs, penitentiaries, and others. Typically, these facilities use conventional batch washing machines for laundering their linens, towels, napkins and tablecloths, and uniforms. The uniformity of the feedstocks makes them good candidates for conversion to a continuous-batch tunnel washing machine system, which ultimately utilizes less water and detergent than conventional systems. The water savings are ultimately based on a comparison of the water efficiencies between the baseline and efficient equipment (measured in gallons of water per pound of laundry).

DEFINITION OF EFFICIENT EQUIPMENT

A tunnel washing machine utilizes a porous Archimedes screw to move laundry and wash water in opposite (or counterflow) directions. The laundry travels in the upslope direction, while the wash water travels downslope through the holes in the Archimedes screw. The laundry gets progressively cleaner as it travels up the screw, while the wash water gets progressively dirtier as it travels down the screw. The screw can be programmed to intermittently change direction, to provide additional agitation. The mechanical action of the screw and travel path of the wash water through holes helps significantly with the cleaning action of the tunnel washer, allowing a reduction in the amount of detergent and rinse water required.

In contrast to the baseline equipment, the tunnel washer reuses the “rinse” water from the top section of the tunnel into the lower “wash” water sections, along with the gradual introduction of detergent. The continuous counterflow of laundry and wash water ultimately results in a more water-efficient system.

Tunnel washers also utilize automated PLC computer controls to constantly monitor water temperatures in each section of the tunnel and to automate the introduction of fresh water and detergent. The speed of the Archimedes screw can adjust for the varying dirt load of the laundry input. The computer system can typically collect performance data (gallons of water, pounds of detergent, pounds of laundry) over time to continuous evaluate system efficiency.

Tunnel washers can utilize either a hydraulic press extractor to “squeeze” water out of the linen or a more conventional centrifugal extractor that spins the linen to remove the water.

Tunnel washers can also reduce manhours required to process the laundry, as a staff is not required to manually load and unload each batch. The continuous feed of laundry in a tunnel washing machine system requires less labor and reduces the potential for injury from sticking hand and arms into a conventional washing machine drum.

Tunnel washers are quite large compared to conventional washers and require a significant footprint in the facility. In addition, they require approximately 12 feet of ceiling clearance above the top of the tunnel washer for proper installation.

DEFINITION OF BASELINE EQUIPMENT

A traditional batch washing machine has discrete washing and rinsing cycles, wherein the water gets completely drained at the end of each cycle.

Typical top-loading washing machines used in homes and laundromats use approximately 40 gallons of water per load. This equates to 20 gallons for the wash cycle and 20 gallons for the rinse cycle. Some facilities will even utilize a second rinse cycle. The vertical axis design requires enough water in the drum to suspend the fabric in the soapy water.

The next step up in efficiency is a front-loading (or horizontal axis) washing machines. They typically use 20 to 30 gallons of water per load. This equates to 10-15 gallons for the wash cycle and 10-15 gallons for the rinse cycle.

Larger horizontal-axis washing machines can consume up to 45 gallons of water per load, equating to 22 gallons for the wash cycle and 22 gallons for the rinse cycle.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is assumed to be 15 years for a new tunnel washing machine.[573]

DEEMED MEASURE COST

The actual cost of the measure should be used.[574]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings from conversion from conventional washing machines to tunnel washing machines are the result of reduced water consumption and reduced natural gas consumption from heating water. There are indirect electric energy savings from reduced potable water treatment and wastewater treatment.

ELECTRIC ENERGY SAVINGS

The electric energy savings are based indirectly on the reduced electricity usage attributed to the water savings from the tunnel washing machine. By applying an "Energy Factor", the water savings (in gallons/year) can be converted to electricity savings (in kWh/year). This "Energy Factor" considers the electric energy requirements of water treatment plants and water distribution infrastructure, and wastewater treatment and distribution infrastructure.

The methodology for estimating water savings is as follows:

$$\Delta Water = [BWME - TWME] \; x \; PLD \; x \; ADPY$$

ΔWater =	Total Water Savings (gallons/year)
BWME =	Baseline Washing Machine Efficiency (gal of water / lb. of laundry)
TWME =	Tunnel Washing Machine Efficiency (gal of water / lb. of laundry)
PLD =	Pounds of Laundry Per Day (lb. laundry/day)
ADPY =	Annual Days Per Year (days/year)

The values for BWME and TWME should be taken from actual equipment specifications or actual measurements (water flow meters and mechanical scales).

Typical values for TWME can be range from 0.75-1.0 gal. of water/lb. of laundry.[575] Some equipment vendors have claimed TWME approaching 0.3-0.4 gal. of water/lb. of laundry.[576] For the purposes of this measure, a TWME value of 0.87 gal. of water/lb. of laundry will be used.

[573] Table 8-18: Average Useful Lifetime of Commercial Washing Equipment, Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances, Navigant Consulting, December 21, 2009.
[574] One study found the average cost of tunnel washers to be $1,100,000. Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances, Navigant Consulting, December 21, 2009. https://www1.eere.energy.gov/buildings/publications/pdfs/corporate/commercial_appliances_report_12-09.pdf
[575] Matt Poe. "Efficient, Flexible Tunnel Washers: Tunnel washers have made leaps forward in technology, productivity in the past 10 years", *American Laundry News,* 12/11/18. <https://americanlaundrynews.com/articles/efficient-flexible-tunnel-washers>
[576] Ibid.

Typical values for BWME can range from 1.8-3.0 gal. of water/lb. of laundry.[577] For the purposes of this measure, a BWME value of 2.03 gal. of water/lb. of laundry will be used.[578]

The PLD is specific to each individual facility. An occupied hotel room typically produces 11 pounds of laundry per day.[579] An occupied hospital bed likely produces a similar amount of laundry load. The laundry loads of restaurants, health clubs, prisons, and other facilities need to be quantified using actual facility data.

The PLD can also be estimated from the Ozone Laundry Measure in the IL TRM, section 4.3.6. This measure gives a Washer Utilization Factor (Wutil) of 916,150 pounds/year of laundry for a typical facility.[580] Assuming 365 days/year of laundry activity, this would give a PLD of 2,508 pounds of laundry per day.

The ADPY is often 365 days per year for facilities that never shut down, including hospitals, hotels, and prisons. Other facilities may have regular shutdown periods, so the ADPY value should be adjusted as necessary.

The electricity savings for this measure can be calculated by applying the energy factor to the ΔWater. This EF considers savings from both potable water treatment and wastewater treatment.

$$\Delta kWh_{water} = \Delta Water\ (gallons) \ / \ 1{,}000{,}000 \ * \ Ewater\ total$$

Where

Ewater total = IL Total Water Energy Factor (kWh/Million Gallons)
= 5,010[581]

For example, switching from conventional washing machine technology to tunnel washing machine technology, at a facility that processes the defined 916,150 pounds/year (Wutil) and is open every day of the year.

$\Delta Water = [BWME \ - \ TWME] \ x \ PLD \ x \ ADPY$
= [(2.03 – 0.87) gal. of water/lb. of laundry] x (916,150 lb. of laundry/year)
= 1,062,734 gal. of water/year

$\Delta kWh_{water} = \Delta Water \ / \ 1{,}000{,}000 \ * \ Ewater\ total$
= (1,062,734 gal. of water/year) / 1,000,000 * 5,010 kWh/million gallons
= 5,324 kWh/year

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Since the times of day from the water savings measure do not necessarily coincide with the times of day that the water treatment and distribution equipment is in use, the coincident peak demand savings cannot be determined.

FOSSIL FUEL SAVINGS

With reduced water use by the installation of a tunnel washer, the DHW boiler used to heat the incoming water will use significantly less gas. The below algorithm can be used to calculate natural gas savings for hot water heating.

[577] Theresa Boehl. "Tunnel Washers: The Answer to Rising Labor, Utility Costs?", *American Laundry News,* 5/27/14. <https://americanlaundrynews.com/articles/tunnel-washers>
[578] IL TRM Section 4.3.6 "Ozone Laundry"
[579] Joseph Ricci. "Outsourced Hotel Laundries: The Value of Certification", *Lodging*, 3/28/17. <https://lodgingmagazine.com/outsourced-hotel-laundries-the-value-of-certification/>
[580] IL TRM Section 4.3.6 footnote for W_{util}, which states "Average utilization factors were generated using data collected from existing ozone laundry projects that received incentives under the NRR-DR program."
[581] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

$$\Delta\text{Therms} = ((T_{out} - T_{in}) * HotWaterReduction_{Gallon} * \gamma_{water} * 1 * (1/Eff))/100{,}000$$

Where:

T_{OUT}	= Hot water storage tank temperature
	= 125°F
T_{IN}	= Incoming water temperature from well or municipal system
	= 50.7°F [582]
$HotWaterReduction_{Gallon}$	= Estimated annual hot water reduction (gallons)
	= Actual custom estimate
γ_{water}	= Specific weight capacity of water (lb/gal)
	= 8.33 lbs/gal
1	= Specific heat of water (Btu/lb.°F)
Eff	= Efficiency of the boiler
	= Use actual efficiency, otherwise use 80% AFUE
100,000	= Converts Btu to therms

For example, a DHW Boiler with an efficiency of 80% AFUE heats a 100 gallon storage tank in a laundry facility using a tunnel washer. Use of the tunnel washer will save the original laundry site an estimated 1,062,734 gallons of water the below example savings:

$$\Delta\text{Therms} = ((T_{out} - T_{in}) * HotWaterUse_{Gallon} * \gamma_{water} * 1 * (1/Eff))/100{,}000$$

= ((125 – 50.7) * 1,062,734 * 8.33 * 1 * (1/0.8))/100,000

= 8221.8 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

The water savings from the tunnel washing machines will help preserve water supplies, extend the life of water treatment and wastewater treatment plants. The reduction in detergent requirements will also have cost and environmental benefits.

DEEMED O&M COST ADJUSTMENT CALCULATION

Actual O&M cost adjustments should be used for this measure.[583]

MEASURE CODE: CI-HWE-TUWA-V03-250101

REVIEW DEADLINE: 1/1/2029

[582] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[583] Annual repair & maintenance costs have been estimated at $19,000 per unit. Energy Savings Potential and RD&D Opportunities for Commercial Building Appliances, Navigant Consulting, December 21, 2009. https://www1.eere.energy.gov/buildings/publications/pdfs/corporate/commercial_appliances_report_12-09.pdf

4.3.12 Tank Insulation

DESCRIPTION

This measure provides rebates for installation of 1" or 2" fiberglass, mineral fiber, or other types of insulation with similar properties to existing bare heated tanks for industrial and some commercial installations. Storage tanks can hold any heated material including, but not limited to, hot water, thermal oil, chemicals, and asphalt.

Default per square foot savings estimates are provided for both exposed indoor and outdoor storage tanks that are heated by heat transfer fluids including steam and thermal oil. Only systems heated with natural gas are eligible for this measure.

Indoor tanks require at least 1" of insulation and outdoor tanks must have at least 2 inches of insulation and include an all-weather protective jacket. New advanced insulating materials may be thinner and savings can be calculated with 3E Plus v4.1.[584]

This measure was developed to be applicable to the following program types: RF (Retrofit), DI (Direct Install). If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is installing tank insulation to an uninsulated, heated material storage tank. Indoor tanks must have at least 1 inch of insulation (R-value of 2.1) and outdoor tanks must have at least 2" of insulation (R--value of 4.2) and include an all-weather protective jacket.

DEFINITION OF BASELINE EQUIPMENT

The base case for savings estimates is a bare, steel tank. Other tank materials can be used to calculate savings with 3E Plus v4.1. Tanks are not required by mechanical codes to be insulated and are commonly found without any insulation.[585]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[586]

INCREMENTAL MEASURE COST

The incremental cost for this measure is $12/ft^2. [587]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

[584] 3E Plus v4.1 is a heat loss calculation software provided by the NAIMA (North American Insulation Manufacturer Association).
[585] ASHRAE Handbook – Fundamentals 2017 lists requirements for pipe and duct insulation but does not mention tank insulation.
[586] Based on the California Municipal Utilities Association Technical Reference Manual Third Edition measure 14.1.
[587] Based on RS Means Data Line Number 220719101162.

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = [ESF_b * A_b + ESF_e * A_e] * Hours * LF * TRF / (100{,}000 * \eta)$$

Where:

ESF_b = Energy savings factor from tank body defined as the difference in heat loss between an insulated condition and a bare condition as found in table below [Btu/hr/ft^2]

A_b = Area of tank body [ft^2]

= Actual

ESF_e = Energy savings factor from tank endcap(s) defined as the difference in heat loss between an insulated condition and a bare condition as found in table below [Btu/hr/ft^2]

A_e = Area of endcap(s) [ft^2]

= Combined area of endcaps if tank is oriented horizontally, separate areas if tank is oriented vertically or only one endcap is insulated

= Actual

Hours = Operating hours of heating system

= Actual

LF = Load factor of heating system

= Annual gas consumption / (Hours * Nameplate Heating Capacity)

TRF = Thermal Regain Factor for tank location and use, see table below. The Custom TRF option may be used on any tank location, including tank locations with deemed TRFs specifically listed in the table below, if supporting justification and calculations for the Custom TRF are provided.

May vary seasonally such as: TRF[summer] * summer hours + TRF[winter] * winter hours where TRF values reflecting summer and winter conditions are apportioned by the hours for those conditions. TRF may also be adjusted by building specific balance point temperature (BPT) and operating hours above and below that BPT.[588]

Tank Location	Assumed Regain	TRF, Thermal Regain Factor
Outdoor	0%	1.0
Indoor, conditioned, annual use (e.g. hot water or process loads), 55°F BPT	45%	0.55
Indoor, semi-conditioned, annual use, 55°F BPT	16%	0.84

[588] Zimmerman, Cliff, Franklin Energy, "Thermal Regain Factor_4-30-14.docx", 2014. Based on climate zone 2. Note 'Location not specified – Commercial' assumes pipes provide DHW year round. 'Location not specified – Commercial' assumes semi-conditioned annual usage.

Tank Location	Assumed Regain	TRF, Thermal Regain Factor
Indoor, unconditioned spaces, (no heat transfer to conditioned space)	0%	1.0
Location not specified - Commercial	45%	0.55
Location not specified – Industrial	16%	0.84
Custom	Custom	1 – assumed regain

100,000 = Conversion factor from BTUs to Therms

η = Efficiency of heating equipment used to heat tanks

= Actual, or if unknown assume 79%[589]

The following table shows conductivities and maximum temperature ratings of similar insulation materials. The average value was used with 3EPlus software to generate the Energy Savings Factors used in the savings algorithm.

Table 1: Insulation Types

Insulation Type	Conductivity (Btu.in/ hr.ft^2.°F @ 300°F)	Max Temp (°F)
Mineral Fiber Pipe and Tank Wrap	0.48	650
Mineral Fiber Board	0.44	850
Polyurethane	0.5	400
Average	0.47	

The tank surface temperature assumption depends on the system type. The following table should be used to select the appropriate Energy Savings Factor based on the fluid temperature:

Table 2: Heating Fluid Temperatures

System Type	Fluid Temperature Assumption (°F)
Low Pressure Steam (< 15 psi)	225
High Pressure Steam (> 60 psi)	315
Thermal Oil	425

The energy savings factors (ESF) were developed using the 3E Plus v4.1 software program, and are derived as the difference in heat loss per square foot of a bare tank and an insulated tank.[590] The energy savings analysis is based on adding 1" (indoor) or 2" (outdoor) thick insulation around bare tanks. Outdoor conditions are assumed to be 48.6°F with a wind speed of 5.0 mph.[591] The thermal conductivity of tank insulation varies by material and temperature rating; to obtain a typical value, a range of materials allowed for this measure was averaged. For insulation materials not in the table above, use 3E Plus v4.1 software to calculate ESF_b and ESF_e.

Energy Savings Factors [Btu/hr/ft^2]

[589] Minimum efficiency for steam boilers as set in IECC 2018 code C403.3.2.

[590] Tank insulation calc_8-4-20.xlsx including tables obtained from 3E Plus v4.1 software.

[591] DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL for the average ambient temperature and wind speed for Aurora, IL. Adjusted to align with ASHRAE 24.4 Terrain Category 1 for Large city centers with densely populated, tall buildings (2017).

		Low Pressure Steam	High Pressure Steam	Thermal Oil
Vertical Tank - Body	Indoor	290.2	559.0	991.8
	Outdoor	373.4	666.0	1132.0
Horizontal Tank - Body	Indoor	290.2	559.0	991.8
	Outdoor	373.4	666.0	1132.0
Vertical Tank End - Top	Indoor	336.8	642.8	783.9
	Outdoor	426.3	756.2	1269.6
Vertical Tank End - Bottom	Indoor	189.8	380.0	712.1
	Outdoor	288.1	515.7	897.3
Horizontal Tank End	Indoor	290.2	559.0	991.8
	Outdoor	373.4	666.0	1132.0

For example, an outdoor, vertical, cylindrical tank with a radius of 5 ft and height of 15 ft heated by a thermal oil heating system that is insulated around the body and top of the tank would save (assuming 4380 hours of operation, 70% load factor, and 78% efficient thermal oil heater):

ΔTherms $=[ESF_b * A_b + ESF_e * A_e] * Hours * LF * TRF / (100{,}000 * \eta)$

ESF_b = 1132.0 Btu/hr/ft^2

A_b = 2 * π * r * h

= 471.2 ft^2

ESF_e = 1269.6 Btu/hr/ft^2

A_e = π * r^2

= 78.5 ft^2

Hours = 4380

LF = 0.7

TRF = 1.0

η = 0.78

ΔTherms = [1132.0 * 471.2 + 1269.6 * 78.5] * 4380 * 0.7 * 1 / (100,000 * 0.78)

= 24,884 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-TKIN-V03-240101

REVIEW DEADLINE: 1/1/2029

4.3.13 Tankless Water Heater Array

DESCRIPTION

A Central Condensing Tankless Water Heater (CCTWH) array is a type of domestic hot water heating system formed by integrating multiple condensing tankless water heating units in a modular style to increase overall system capacity, turndown capability and to reduce standby energy losses. Hot water energy savings resulting from reduction in standby losses and improved system efficiency are detailed in this measure.

Traditional domestic water heaters for large commercial applications come in two basic designs: conventional tank type water heaters and boilers with external storage tanks. Both these systems produce large volumes of hot water even when there is no demand, resulting in significant standby energy losses. For facilities with peak domestic hot water loads, the water heating system will be sized and installed to meet peak hot water loads. These large systems will often have low turndown ratios and will result in lower efficiencies during lower hot water loads.

On the other hand, gas fired instantaneous or tankless water heaters are defined by code for federal regulations[592] as water heaters which produce not less than 4,000 Btu/hr per gallon of storage. Multiple individual condensing gas fired tankless water heating units are integrated together with specific system controls to form a CCTWH array.

As a replacement to conventional central domestic hot water systems, CCTWH arrays primarily yield energy savings by minimizing standby heat losses and providing high turn-down ratios and there by maximizing the "condensing" efficiency of the water heating system. The temperature difference between supply water temperature and inlet water temperature of the water heater determines the efficiency if the water heater. The inlet/return water temperatures need to be lower to achieve higher efficiencies. Without a storage tank, CCTWH arrays have lower thermal mass and lower return water temperatures to achieve high condensing level efficiencies. Typical points of application of CCTWH array are building types with high peak water heating demands and high turn down ratios like Multifamily, Hotels/ Motels, Hospitals and Universities/ Schools.

This measure involves estimation of hot water energy savings for multiple varying building specific and system specific parameter inputs to estimate hot water usage and energy savings. An external spreadsheet calculator[593] located at [link] has been developed which utilizes the following inputs to facilitate the estimation of the hot energy savings for this measure.

- Measure type (New construction NC or Time of sale TOS)
- Building type[594]
    - Application type: Multifamily, Hotels and Motels.
        - Number of units served by the water heater.
    - Application type: Hospital and Healthcare buildings
        - Number of beds in the spaces served by the water heater.
    - Application type: Offices, Schools, and Universities.
        - Daily occupancy in the spaces served by the water heater.
    - Application type: Other Commercial buildings.
        - Gross building floor area served by the water heater.
- Climate Zone: Rockford, Chicago, Springfield, Belleville, Marion
- Baseline water heater type, firing rate, storage volume and rated stand by loss for measure type Time of sale (TOS).
- CCTWH array firing rate, storage volume, peak flow rate at 70^{o}F ΔT and rated standby loss.

[592]Gas fired Instantaneous water heater as defined in code for federal regulations. eCFR :: 10 CFR Part 431 Subpart G -- Commercial Water Heaters, Hot Water Supply Boilers and Unfired Hot Water Storage Tanks

[593] Externally attached spreadsheet tool 'Energy Savings Calculator for Central Condensing Tankless Water Heater Array.xlsm'.

[594] Building type definitions are as defined in Illinois Technical Reference Manual version 11, Volume 1: Overview and User Guide, Section 3.6 Glossary. IL-TRM_Effective_010123_v11.0_Vol_1_Overview_09222022_FINAL.pdf (ilsag.info)

This measure was developed to be applicable to the following program types: NC and TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Central Condensing Tankless Water Heater array (CCTWH array) are formed by integrating individual gas fired condensing tankless water heating units into a modular system with specific system controls. Gas fired Instantaneous or Tankless water heaters shall produce not less than 4,000 Btu/hr per gallon of storage as defined by federal code for regulations[595]. CCTWH array system to be used as part of this measure should be greater than 200,000 Btu/hr and produce not less than 4,000 Btu/hr per gallon of stored water. CCTWH array system as a part of the measure shall have a rated thermal efficiency greater than 90%.

DEFINITION OF BASELINE EQUIPMENT

Time of Sale: This measure type is only applicable for existing commercial gas fired water heaters being replaced after the end of their useful life. The baseline condition is assumed to be a new standard water heater of same type as the existing unit being replaced. The efficiency of the baseline water heater in this case, would be or minimum efficiency as required by the federal standards[596]. If existing equipment type is unknown, the baseline condition is assumed to be a standard commercial gas fired storage type water heater meeting federal minimal efficiency standards listed in table below.

New Construction: The baseline condition is assumed to be a new standard commercial gas fired storage type water heater meeting federal minimum efficiency standards listed in table below.

Equipment Type[597]	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor
Commercial Gas Storage Water Heaters (Including Storage water heaters and Service hot water boilers with external storage tanks)	>75,000 Btu/hr	All	80% $E_{thermal}$, Btu/hr Standby Losses = (Q /800 + 110√Rated Storage Volume in Gallons), Btu/hr
Commercial Gas Instantaneous Water Heaters	<10 gal and >200,000 Btu/hr	All	80% $E_{thermal}$, Btu/hr Standby Losses = NA
	≥10 gal and >200,000 Btu/hr	All	80% $E_{thermal}$, Btu/hr Standby Losses = (Q /800 + 110√Rated Storage Volume in Gallons), Btu/hr

For the purpose of calculating baseline water heater standby losses in measure type NC, Capacity of the Baseline water heater (NC) is calculated as follows:

(NC)Baseline water heater capacity (Btu/hr) = Recovery demand * ΔT * 8.33/ŋ

Recovery demand (gph) = Peak flow (gpm) * 30

[595] Gas fired Instantaneous water heater as defined in code for federal regulations. eCFR :: 10 CFR Part 431 Subpart G -- Commercial Water Heaters, Hot Water Supply Boilers and Unfired Hot Water Storage Tanks

[596] Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431. eCFR :: 10 CFR Part 431 Subpart G -- Commercial Water Heaters, Hot Water Supply Boilers and Unfired Hot Water Storage Tanks

[597] Commercial Water heater equipment type definitions are per U.S Department of Energy, federal code for regulation standards.

Peak flow (gpm)	= Peak flow of the CCTWH array at 70 °F ΔT temperature rise.
30	= A peak flow of 30 minutes is assumed to estimate peak gallons per hour recovery demand.
8.33	= 8.33 lb/gal of water
ŋ	= 0.8 (Efficiency of the (NC) Baseline water heater)
(NC) Baseline water heater storage (Gal)	= (NC) Baseline water heater capacity (Btu/hr) /3,999
3,999	= Conversion factor to estimate minimum storage volume to be defined as a storage type water heater per U.S. federal code for standards.

Note that (NC) Baseline water heater capacity and (NC) Baseline water heater storage are only utilized to calculate baseline system standby loss for calculating measure energy savings.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years[598].

DEEMED MEASURE COST

Actual costs should be used where available. Total equipment cost assumptions for the measure can used from table below if actual costs are unknown. Depending on actual site demand requirements, CCTWH array is expected to have higher firing rate than a storage water heater, to meet the same hot water demand. While computing incremental costs for this measure, corresponding firing rates shall be utilized for the Baseline water heater and the CCTWH array.

Capacity	Total Equipment Cost- CCTWH Array	Total Equipment Cost Baseline[599]	
		Storage Type Water Heater	Service Hot Water Boiler with Storage Tanks
≤800 kBtu/hr	14.45 $/kBtu/hr[600]	34.67 $/kBtu/hr	27.50 $/kBtu/hr
>800 kBtu/hr	31.21 $/kBtu/hr[601]		

Incremental Cost	= (Unit Cost CCTWH Array * Eff firing rate) – (Unit Cost Baseline * Baseline firing rate)
Unit Cost	= Cost per firing rate of the water heating equipment ($/kBtu/hr).
Eff firing rate	= Firing rate(kBtu/hr) of the Central condensing tankless water heater array.
Baseline firing rate	= Firing rate(kBtu/hr) of the Baseline domestic water heater.

For baseline water heater firing rate in measure type NC, refer to Definition of baseline equipment section.

[598] California ETRM, Tankless water heater commercial measure (Version SWWH006-07) lists a useful life of 20 years. California Public Utilities Commission (CPUC), Energy Division. 2014. "DEER2014-EUL-table-update_2014-02-05.xlsx." https://www.caetrm.com/login/?next=/measure/SWWH006/07/

[599] Baseline install costs are based on data from 2010-2012_WO017_Ex_Ante_Measure_Cost_Study_-_Final_Report.pdf (calmac.org) . Only equipment and miscellaneous costs are considered excluding labor costs for a non-condensing 82% TE storage type water heater. Average of equipment and miscellaneous costs for Large storage water heater Et=80% and SHW Boilers Et=82% are used to estimate equipment cost per kBtu/hr.

[600] Install cost from Swierczyna, R., P. Glanville, M. Mensinger Jr., A. Haynor, B. Schoenbauer. 2022. Demonstration of Packaged Central Condensing Tankless Water Heating Systems in Multifamily Buildings. Minnesota Commerce Department. https://mn.gov/commerce/energy/conserving-energy/applied-research-development/

[601] Install cost for CCTWH array greater than 800 kBtu/hr are from GTI Energy field demonstration projects in Illinois.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

There are no anticipated electrical energy savings for this measure.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = \{[G \; x \; 8.33 \; x \; 1 \; x \; (Tout - Tin) \; x \; ((1/\eta base) - (1/\eta eff))] + (SLbase - SLeff)\} / 1{,}000{,}00$$

Where:

G = Annual hot water use (in gallons).

= Actual annual hot water usage (If hot water usage is metered in measure type TOS)

= Average daily hot water use x Operating days in a year. (if daily use is listed in table below.

Operating days in a year = Actual or If unknown, use values from table below.

Building Type[602] [603]	Operating Days per Year
Offices	250
Restaurant	365
Retail	365
Grocery stores/ Convenience stores	365
Warehouses	250
Schools	200
Universities	200
Health	365
Hotels, Motels	365
Multifamily	365
Other Commercial	250

[602] Sezgan, O et al. Technology data characterizing water heating in commercial buildings: Application to end use forecasting, Ernest Orlando Lawrence Berkeley National Laboratory, December 1995. lbnl-37398e.pdf (lbl.gov)

[603] 2020 State of Ohio Energy efficiency technical reference manual, Volume III: Commercial and Industrial market sector. "Technical Reference Manual (TRM) for Ohio Senate Bill 221 Energy Efficiency and Conservation Program and 09-512-GEUNC", October 15, 2009. Based on Ohio utility supply profiles. ViewImage.aspx (state.oh.us)

Average daily hot water use to be calculated from table below based on building type.

Building Type	Consumption	Unit
Multi-family	36.9	Gal/unit/day[604]
Hotels <=20 units	20	Gal/unit/day[605]
Hotels 21-99 Units	14	Gal/unit/day
Hotels 100+ units	10	Gal/unit/day
School (Jr/Sr High)	1.8	Gal/student/day
Elementary school	0.6	Gal/student/day
Universities	1.8	Gal/person/day
Hospitals	18.4	Gal/bed/day
Office	1	Gal/person/day
Retail >=30,000 SF	1,354	Gal/1000 SF/year[606]
Retail < 30,000 SF	6,111	Gal/1000 SF/year
Restaurants	44,439	Gal/1000 SF/year
Grocery store	697	Gal/1000 SF/year
Convenience	4,594	Gal/1000 SF/year
Warehouse	1,239	Gal/1000 SF/year
Other Commercial	3,941	Gal/1000 SF/year

8.33 = Density of water lb/gal.

1 = Specific heat capacity of water Btu/lb ^{o}F.

Tout = water heater set point (^{o}F) (demand temperature) is assumed to be 125 ^{o}F. If custom higher water temperatures are used, actual tank water temperature should be verified.

Tin = Average inlet water temperature (^{o}F) is based on the building location nearest to zones listed in table below.

Typical Entering Cold-Water Temperatures[607] in ^{o}F			
Zones	Min	Avg	Max
(1)Rockford	40.86	53.80	66.31
(2)Chicago O'Hare	44.10	56.17	67.85
(3)Springfield	46.05	59.38	72.30
(4)Belleville	48.24	60.08	71.55
(5)Marion	49.63	62.09	74.19

ηbase = Rated efficiency of baseline water heater in Thermal efficiency (Et) can be actual value if known or can be taken from per table in definition of baseline equipment.

[604] 2022 IL Technical reference manual, measure 4.3.7, referenced Deoreo, B., and P. Mayer. Residential End Uses of Water Study Update. Forthcoming. ©2015 Water Research Foundation.
[605] 2019 ASHRAE Applications handbook, chapter 51 service water heating for Hotels, Schools/ Universities and offices water consumption.
[606] 2022 IL Technical reference manual, version 11, volume 2, section 4.3.1., lists consumption/ cap for retail spaces, restaurants, grocery stores, convenience stores, Warehouses and other commercial spaces. Update with reference from 4.3.1
[607] Cold water temperatures are taken From US DOE, Building America Analysis Spreadsheets

ηnew = Rated efficiency of the efficient CCTWH array in Thermal efficiency (Et).

SLbase = Annual Standby energy loss of the baseline water heater in btu.

= SL rated base X H

SL rated base = Rated Standby loss rating of the baseline water heater in Btu/hr.

= Actual or if unknown, Use calculation below to estimate standby losses.

= (Q /800 + 110√Rated Storage Volume in Gallons), Btu/hr

Q = Capacity/ Firing rate of the Baseline water heater in Btu/hr

H = 8760 annual hours of operation is assumed for estimating stand by losses.

SLeff = Annual Standby energy loss of the efficient CCTWH array in btu.

= SL rated eff X H

SL rated eff = Rated Standby loss rating of the efficient CCTWH array in Btu/hr

= or Actual Standby loss rating values based on CCTWH system operation. This will need to be verified to be utilized in the measure.

=If unknown and CCTWH array rated storage volume is greater than or equal to 10 gallons, assume a standby loss of,

Qeff /800 + 110√Rated Storage Volume in Gallons), Btu/hr

Qeff = Capacity/ Firing rate of the CCTWH array in Btu/hr.

For example, savings for a CCTWH array with 796 kbtu/hr input rating, 20 gpm peak flow at 70 ^{o}F ΔT and 96% TE is installed serving 23 units in a multi-family building in Chicago, replacing a storage type water heater 199 kBtu/hr input rating, 100-gallon storage and 80% TE, is calculated as follows:

Following inputs listed below shall be utilized to estimate Therms savings in the external spreadsheet calculator.

Description	Input	Calculated Annual Therms Savings
Measure type	Time of Sale (TOS)	489 Therms
Building Type	Multi-family	
Number of units served by the water heater	23	
Building location: Climate Zone	Climate Zone2: Chicago	
Baseline water heater type	Commercial gas fired storage water heater	
Baseline water heater Firing rate input	199 kBtu/hr	
Baseline water heater storage capacity	100 Gallons	
CCTWH array system firing rate input	796 kBtu/hr	
CCTWH array system Thermal efficiency	96%	

The same example; when a CCTWH array with 796 kbtu/hr input rating, 20 gpm peak flow at 70 °F ΔT and 96% TE is installed serving 23 units in a multi-family building in Chicago is installed in New Construction, Hot water energy savings are estimated as based on input listed below.

Description	Input	Calculated Annual Therms Savings
Measure type	New Construction (NC)	518 Therms
Building Type	Multi-family	
Number of units served by the water heater	23	
Building location: Climate Zone	Climate Zone2: Chicago	
Baseline water heater type	Commercial gas fired storage water heater	
CCTWH array system firing rate input	796 kBtu/hr	
CCTWH array system Thermal efficiency	96%	
CCTWH array system Peak flow at 70 °F temperature rise	20 gpm	

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-TWHA-V01-240101

Review Deadline: 1/1/2029

4.3.14 Solar Water Heater

DESCRIPTION

A solar water heater provides water heating by collecting solar thermal energy and transferring it to the domestic water heating system to offset energy needed from electricity or fossil fuels. The solar water heater consists of one or more solar thermal collection panels which warm a heat transfer fluid, a heat exchanger tank inside the building where the heat is transferred from the heat transfer fluid to the domestic hot water supply, a pump to move the heat transfer fluid, and a controller which operates the system. In Illinois, solar water heating systems typically require a backup water heater to provide a portion of the water heating load.

This measure characterizes the installation of a solar water heating system with a new or existing backup water heater in a small commercial facility. The backup water heater may be an existing electric resistance or natural gas water heater, a new electric resistance or natural gas water heater, or an integrated electric resistance backup heater in the solar water heating system.

This measure was developed to be applicable to the following program types: TOS, NC, RF.
If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be an ENERGY STAR[608] certified solar water heating system with a Solar Uniform Energy Factor (SUEF) of 3.00 or greater for systems with electric backup or a SUEF of 1.8 or greater for systems with gas backup. The solar water heating system must meet the Solar Rating and Certification Corporation (SRCC™) OG-300 standard and be designed for a minimum 50% Solar Fraction (SF). Solar water heating systems in Illinois must have a backup water heater to meet year-round water heating needs. Backup water heaters installed with solar systems are assumed to be electric or natural gas instantaneous (tankless) water heaters, at high draw, with minimum efficiencies of 0.92 UEF or 0.81 UEF, respectively.

DEFINITION OF BASELINE EQUIPMENT

For Time of Sale (TOS) and New Construction (NC), the baseline condition is a new electric or natural gas water heater meeting federal minimum efficiency standards. For all electric solar water heating systems, assume a 50-gallon electric resistance storage water heater baseline, at medium draw, with 0.9207 UEF. For solar water heating systems with a natural gas water heater backup, assume a 50-gallon natural gas storage water heater, at medium draw, with 0.5633 UEF.

For Retrofit (RF), the baseline condition is the existing electric or natural gas water heater.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 25 years[609].

DEEMED MEASURE COST

For Time of Sale or New Construction the incremental installation cost (including labor) should be used. Defaults are provided below. Actual efficient costs can also be used although care should be taken as installation costs can vary significantly due to complexities of a particular site.

For retrofit costs, the actual full installation cost should be used (default provided below if unknown).

Baseline Installed Cost:

[608] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification and corresponding Qualified Products List should continue to be used through the effective period of this TRM.
[609] GSA Honeycomb Solar Thermal Collector, GPG-027, August 2016.

Item	Default Cost
Baseline Installed Cost	$882[610]
New Solar Water Heater System	$6,757[611]
Incremental Cost	$5,875

LOADSHAPE

For electric hot water heaters, use Loadshape C02 - Commercial Electric DHW.

COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.925.[612]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

Solar water heating systems with electric backup:

Time of Sale & New Construction:

$$\Delta kWh = \frac{\left(\left(\frac{1}{UEF_{Base}} - \frac{1}{UEF_{Solar}}\right) * HotWaterUse * \gamma Water * (T_{OUT} - T_{IN}) * 1.0\right)}{3412}$$

Retrofit:

$$\Delta kWh = \frac{\left(\frac{1}{UEF_{Exist}} * SF * HotWaterUse * \gamma Water * (T_{OUT} - T_{IN}) * 1.0\right)}{3412}$$

Solar water heating systems with natural gas backup:

Time of Sale & New Construction:

$$\Delta kWh = Electric\ penalty\ for\ solar\ circulating\ pump$$
$$= \frac{-P_pump * Hours_pump * SF}{1000}$$
$$\Delta therms = \frac{\left(\left(\frac{1}{UEF_{BaseFF}} - \frac{1}{UEF_{SolarFF}}\right) * HotWaterUse * \gamma Water * (T_{OUT} - T_{IN}) * 1.0\right)}{100{,}000}$$

Retrofit:

$$\Delta kWh = Electric\ penalty\ for\ solar\ circulating\ pump$$
$$= \frac{-P_pump * Hours_pump * SF}{1000}$$

[610] Baseline ERWH equipment costs: Energy Solutions (2024). Heat Pump Water Heaters in the Northeast and Mid-Atlantic: Costs and Market Trends. Prepared for: Northeast States for Coordinated Air Use Management (NESCAUM) and The Ozone Transport Commission (OTC).). Installation labor cost from same study suggests $308, for a total of $882. Additionally, a review of 18 baseline ERWH models (5 different manufacturers; sizes ranging from 30-50 gallons) listed with online retailers (Home Depot, Lowes, Menards, and Ferguson Supply) available in IL established an average equipment cost of $575.
[611] California eTRM, Measure ID SWWH032, in effect 1/1/2026.
[612] Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.

$$\Delta\text{therms} = \frac{\left(\frac{1}{UEF_{ExistFF}} * SF * HotWaterUse * \gamma Water * (T_{OUT} - T_{IN}) * 1.0\right)}{100{,}000}$$

Where:

UEF_{Base} = Uniform Energy Factor (efficiency) of standard electric water heater according to federal standards. Assume electric storage water heater:

= 0.9207 [613]

UEF_{Solar} = Uniform Energy Factor equivalent of all electric solar water heating system.

Note: Do not use the Solar Uniform Energy Factor.

$$= \frac{UEF_{Backup}}{(1 - SF)}$$

SF = Solar Fraction of installed solar water heater

= Actual, per design or provided on SRCC certification.

Use WI – Milwaukee value for Climate Zones 1 and 2, MO – St Louis for Climate Zones 4 and 5 and an average of the two for Climate Zone 3 or if location is unknown.

UEF_{Backup} = Uniform Energy Factor of backup water heater.

= Actual. If unknown assume 0.92 [614]

UEF_{Exist} = Uniform Energy Factor of existing electric water heater.

= Use actual UEF rating where it is possible to measure or reasonably estimate.

= If unknown assume 0.9207 [615]

UEF_{BaseFF} = Uniform Energy Factor (efficiency) of standard gas water heater according to federal standards. Assume gas storage water heater:

= 0.5633 [616]

$UEF_{SolarFF}$ = Uniform Energy Factor equivalent of solar water heating system with a gas backup.

Note: Do not use the Solar Uniform Energy Factor.

$$= \frac{UEF_{BackupFF}}{(1 - SF)}$$

SF = Solar Fraction of installed solar water heater

= Actual, per design or provided on SRCC certification.

Use WI – Milwaukee value for Climate Zones 1 and 2, MO – St Louis for Climate Zones 4 and 5 and an average of the two for Climate Zone 3 or if location is unknown.

$UEF_{BackupFF}$ = Uniform Energy Factor of backup water heater.

= Use actual UEF rating where it is possible to measure or reasonably estimate.

[613] Assuming a new 50 gallon electric storage baseline at Medium Draw.
[614] Assuming a new instantaneous electric backup at High Draw.
[615] Assuming an existing 50 gallon electric storage water heater at Medium Draw installed after 2015.
[616] Assuming a new 50 gallon gas storage baseline at Medium Draw.

= If unknown assume 0.81[617]

$UEF_{ExistFF}$ = Uniform Energy Factor of existing water heater.

= Use actual UEF rating where it is possible to measure or reasonably estimate.

= If unknown assume 0.5633[618]

HotWaterUse = Estimated annual hot water consumption (gallons)

= Actual, per design or estimate by building type. Capped at 32,000 gallons per solar water heating system.[619]

Consumption per unit area served by solar water heater by building type
= (Area/1000) * Consumption per 1,000 sq.ft.

Where:

Area = Area in sq.ft that is served by domestic water heating system

= Actual

Consumption per 1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:[620]

Building Type	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Large Office	1,818
Large Retail	1,354
Other Commercial	3,941
Small Office	1,540
Small Retail	6,111
Warehouse	1,239

γWater = Specific weight of water

= 8.33 pounds per gallon

T_{OUT} = Tank temperature

= 125°F

T_{IN} = Incoming water temperature from well or municiple system

= 50.7°F [621]

1.0 = Heat Capacity of water (1 Btu/lb*°F)

[617] Assuming a new instantaneous gas backup at High Draw.
[618] Assuming an existing 50 gallon electric storage water heater at Medium Draw installed after 2015.
[619] Equivalent to the hot water usage of a 5-bedroom home, which is the upper range of the OG-300 standard.
[620] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.
[621] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

3412	= Conversion from Btu to kWh
100,000	= Conversion from Btu to therms
P_pump	= Power of circulation pump in watts
	= Actual, per design.
Hours_pump	= Annual pump operating hours
	= Full load hours * SF

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{Hours} * CF$$

Where:

ΔkWh	= Electric savings (or increase) of measure
Hours	= Full load hours of water heater
	= 6,461 [622]
CF	= Summer Peak Coincidence Factor for measure
	= 0.925 [623]

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-CSWH-V01-270101

REVIEW DEADLINE: 1/1/2029

[622] Full load hours assumption based on Wh/Max W Ratio from Itron eShape data for Missouri, calibrated to Illinois loads.
[623] Coincidence factor based on Average W in peak period/Max W from Itron eShape data for Missouri, calibrated to Illinois loads.

4.3.15 ECM Circulation Pumps for Domestic Hot Water

DESCRIPTION

This measure is for replacing single-speed induction motor circulator pumps with electronically commutated motor (ECM) circulator pumps. Circulator pumps are used to circulate water for domestic water heating in residential and commercial buildings and are commonly used in multifamily and commercial buildings to shorten the amount of time it takes for hot water to reach the occupants on upper floors and those with long piping runs. These recirculator pumps can be operated continuously or be controlled by a timer or an aquastat, which turns on the pump only when the temperature of the return line falls below a certain set point. Circulator pumps that use ECMs are more efficient because they lack brushes that add friction to the motor and can modulate their speed to match the load.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a properly sized high-efficiency ECM pump for domestic water heating with variable speed capabilities to match demand.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a standard efficiency, constant speed PSC pump for domestic water heating without variable speed capabilities.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for ECM circulation pumps is 15 years.[624]

DEEMED MEASURE COST

The incremental cost for this measure is estimated to be $6/watt for the ECM pump.[625]

LOADSHAPE

Loadshape C02 - Non-Residential Electric DHW.

COINCIDENCE FACTOR

The coincidence factor is assumed to be 1.0.[626]

[624]ComEd Effective Useful Life Research Report (2018), Navigant, May 14, 2018, for “Commercial ECM motors”.
[625] These values are based on $29/gpm for ECM pumps and $12/gpm for PSC pumps. Costs are found in Wilo’s Price Book – Pumps and systems for Building Services and Groundwater. Accessed 6/10/2014.
[626] Wisconsin Focus on Energy 2026 Technical Reference Manual, January 30, 2026. Coincidence factor is for Variable Speed ECM Pump, Domestic Hot Water Recirculation, Heating Water Circulation, and Cooling Water Circulation, page 380.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

$$\Delta\text{kWh} = ((Watts_{Base} * HOU_{Base}) - (Watts_{EE} * HOU_{EE})) * \frac{1}{1{,}000} * LF$$

Where:

$Watts_{Base}$ = $Watts_{EE}$ / SF

SF = Savings Fraction

= 0.18[627]

$Watts_{EE}$ = Installed nameplate motor watts

= Actual

HOU_{Base} = Annual pump run hours for baseline DHW recirculating pump, see table below:

Hours of operation[628]	
Continuous operation	8,760
Timer	6,570
Aquastat-Controlled	1,095
On Demand	122

HOU_{EE} = Annual pump run hours for ECM DHW recirculating pump, use table above

LF = Load Factor

= 0.90[629]

For example, a dormitory building whose central domestic hot water system utilizes timer controls for the circulation pumps installed a 40 watt ECM circulation pump. Electric energy savings are:

ΔkWh = ((40 / 0.18) * 6570) – (40 * 6570) / 1000 * 0.90

= 1,077kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \left((Watts_{Base}) - (Watts_{EE})\right) * \frac{1}{1{,}000} * LF * CF$$

[627] Cadmus. (2012, October). Impact Evaluation of the 2011–2012 Pennsylvania ECM Circulator Pump Pilot Program. Table 2. Pump Spot Measurements.

[628] The Hours of operation of recirculating pump for commercial buildings in general from Research and Analysis of the Benefits of Appliance Standards for Domestic Hot Water Circulator Pumps. Energy Solutions (October 2021)

[629] Cascade Energy (2012, November). Proposed Standard Savings Estimation Protocol for Ultra-Premium Efficiency Motors. Appendix C: NW Industrial Motors Database Analysis Table 6: Load Factor by nameplate hp and end use load factor for air compressors and average motor efficiency. Average efficiency for NEMA premium efficiency 1800 RPM ODP motors with 75% and 100% load factors from 1HP to 200HP.

Where:

CF = Summer Peak Coincidence Factor for measure
= 1.0[630]

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HWE-ECMP-V01-270101

REVIEW DEADLINE: 1/1/2029

[630] Wisconsin Focus on Energy 2026 Technical Reference Manual, January 30, 2026. Coincidence factor is for Variable Speed ECM Pump, Domestic Hot Water Recirculation, Heating Water Circulation, and Cooling Water Circulation, page 380.

4.4. HVAC End Use

Many of the commercial HVAC measures use equivalent full load hours (EFLH) to calculate heating and cooling savings. The tables with these values are included in this section and referenced in each measure.

The OpenStudio models are initially based upon DOE Prototypes described in NREL's "U.S. Department of Energy Commercial Reference Building Models of the National Building Stock". A TAC working group reviewed and made adjustments to best reflect the IL building stock. Details of key modeling inputs are provided within the file "Energy Models Inputs & Outputs Summary_06152026" on the IL TRM Sharepoint Site: TRM Reference Documents: 2nd Volume – Commercial and Industrial Measures: Commercial Building Energy Models. See Appendix for key modeling attributes.

Note, for greenhouse boiler control measures, like Modulating Boiler Controls and/or Boiler Oxygen Trim Controls it is recommended to use methodology detailed in 4.4.21 Linkageless Boiler Controls for Space Heating and 4.4.22 Oxygen Trim Controls for Space Heating Boilers, respectively.

Note where a measure installation is within a building or application that does not fit with any of the defined building types below, the user should apply custom assumptions where it is reasonable to estimate them, else the building of best fit should be utilized.

Equivalent Full Load Hours for Heating ($EFLH_{Heating}$) for Existing Buildings:

Building Type	Heating EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Assembly	1,037	1,059	964	870	879	OpenStudio
Assisted Living	2,099	2,004	1,975	2,021	1,994	OpenStudio
Auto Dealership	1,028	1,066	953	867	831	OpenStudio
Childcare/Pre-School	1,154	1,113	1,052	906	828	OpenStudio
College	1,227	1,262	1,109	995	1,009	OpenStudio
Convenience Store	2,338	2,412	2,240	2,201	2,211	OpenStudio
Drug Store	1,136	1,171	1,044	920	866	OpenStudio
Elementary School	2,563	2,520	2,272	1,964	1,849	OpenStudio
Emergency Services	1,056	1,079	977	848	668	OpenStudio
Garage	984	953	853	667	704	eQuest
Greenhouse – w/ Curtains	4,317	3,993	3,496	2,938	2,745	Virtual Grower 3.1
Greenhouse – w/o Curtains	4,341	4,014	3,516	2,954	2,760	Virtual Grower 3.1
Grocery	2,682	2,724	2,560	2,559	2,589	OpenStudio
Healthcare Clinic	1,577	1,585	1,453	1,415	1,578	OpenStudio
High School	1,807	1,726	1,775	1,837	1,773	OpenStudio
Hospital - CAV no econ	1,239	1,233	1,102	985	934	OpenStudio
Hospital - CAV econ	1,280	1,275	1,149	1,044	1,005	OpenStudio
Hospital - VAV econ	1,477	1,487	1,353	1,203	1,229	OpenStudio
Hospital - FCU	1,862	1,901	1,758	1,691	1,720	OpenStudio
Hospital - Unknown	1,464	1,474	1,340	1,231	1,222	OpenStudio

Building Type	Heating EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Hotel/Motel	1,643	1,644	1,511	1,386	1,417	OpenStudio
Hotel/Motel - Common	1,721	1,726	1,601	1,495	1,508	OpenStudio
Hotel/Motel - Guest	1,606	1,615	1,489	1,336	1,383	OpenStudio
Manufacturing Facility_Miscellaneous	942	967	870	779	721	OpenStudio
Manufacturing Facility_Food/Chemical	1,089	1,084	963	880	858	OpenStudio
MF - High Rise	933	913	795	567	587	OpenStudio
MF - High Rise - Common	1,040	957	836	661	659	OpenStudio
MF - High Rise - Residential	977	957	840	646	683	OpenStudio
MF - Mid Rise	1,483	1,492	1,364	1,233	1,163	OpenStudio
Movie Theater	1,305	1,311	1,180	1,117	1,079	OpenStudio
Office - High Rise - CAV no econ	1,028	1,004	906	844	704	OpenStudio
Office - High Rise - CAV econ	1,020	1,028	919	869	741	OpenStudio
Office - High Rise - VAV econ	1,331	1,343	1,188	1,061	1,146	OpenStudio
Office - High Rise - FCU	1,312	1,304	1,193	1,137	1,106	OpenStudio
Office - Low Rise	1,470	1,505	1,347	1,210	1,143	OpenStudio
Office - Mid Rise	1,113	1,111	995	892	995	OpenStudio
Religious Building	1,447	1,475	1,340	1,124	1,074	OpenStudio
Restaurant	1,554	1,528	1,435	1,315	1,295	OpenStudio
Retail - Department Store	733	742	666	540	482	OpenStudio
Retail - Strip Mall	1,349	1,380	1,257	1,100	1,030	OpenStudio
Warehouse Nonrefrigerated	1,147	1,137	1,021	954	931	OpenStudio
Warehouse Refrigerated	572	546	510	406	359	OpenStudio
Medical Office	1,515	1,522	1,444	1,406	1,515	OpenStudio
Unknown	1,464	1,461	1,340	1,213	1,181	n/a

Equivalent Full Load Hours for Heating ($EFLH_{Heating}$) for New Construction:

Building Type	Heating EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Assembly	898	893	820	789	857	OpenStudio
Assisted Living	2,606	2,527	2,556	2,612	2,693	OpenStudio
Auto Dealership	650	646	595	468	423	OpenStudio
Childcare/Pre-School	582	557	513	406	425	OpenStudio
College	1,040	1,023	958	952	1,115	OpenStudio
Convenience Store	2,174	2,258	2,063	2,035	1,969	OpenStudio
Drug Store	543	502	434	319	237	OpenStudio
Elementary School	669	647	582	503	491	OpenStudio
Emergency Services	1,068	1,038	934	801	714	OpenStudio
Grocery	3,312	3,401	3,179	3,239	3,238	OpenStudio
Healthcare Clinic	643	621	546	494	482	OpenStudio
High School	1,901	1,764	1,855	2,163	1,987	OpenStudio
Hospital - CAV no econ	984	1,002	899	756	696	OpenStudio
Hospital - CAV econ	1,128	1,149	1,055	912	852	OpenStudio
Hospital - VAV econ	885	896	789	626	716	OpenStudio
Hospital - FCU	1,801	1,893	1,745	1,717	1,666	OpenStudio
Hospital - Unknown	1,199	1,235	1,122	1,003	982	n/a
Hotel/Motel	874	893	787	631	699	OpenStudio
Hotel/Motel - Common	1,349	1,408	1,301	1,194	1,175	OpenStudio
Hotel/Motel - Guest	1,004	1,033	911	746	817	OpenStudio
Manufacturing Facility_Miscellaneous	578	828	594	591	558	OpenStudio
Manufacturing Facility_Food/Chemical	767	775	684	490	478	OpenStudio
MF - High Rise	636	619	507	323	307	OpenStudio
MF - High Rise - Common	904	823	732	563	524	OpenStudio
MF - High Rise - Residential	692	695	585	435	436	OpenStudio
MF - Mid Rise	914	913	777	599	484	OpenStudio
Movie Theater	939	930	851	769	757	OpenStudio
Office - High Rise - CAV no econ	807	809	685	513	468	OpenStudio
Office - High Rise - CAV econ	865	871	752	577	554	OpenStudio
Office - High Rise - VAV econ	921	921	835	730	703	OpenStudio
Office - High Rise - FCU	780	827	711	638	624	OpenStudio
Office - Low Rise	639	628	571	493	451	OpenStudio
Office - Mid Rise	996	973	882	721	648	OpenStudio

Building Type	Heating EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Religious Building	1,137	1,143	1,029	861	802	OpenStudio
Restaurant	1,352	1,322	1,202	1,093	1,058	OpenStudio
Retail - Department Store	686	675	593	471	420	OpenStudio
Retail - Strip Mall	786	795	712	612	626	OpenStudio
Warehouse Nonrefrigerated	1,031	1,033	980	921	912	OpenStudio
Warehouse Refrigerated	536	543	491	415	379	OpenStudio
Medical Office	1,571	1,684	1,449	1,394	1,474	OpenStudio
Unknown	993	980	915	856	837	n/a

Equivalent Full Load Hours for Cooling ($EFLH_{cooling}$) for Existing Buildings:

Building Type	Cooling EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Assembly	855	788	925	1,014	1,008	OpenStudio
Assisted Living	899	858	1,052	1,079	1,110	OpenStudio
Auto Dealership	715	693	842	856	860	OpenStudio
Childcare/Pre-School	580	606	750	765	718	OpenStudio
College	1,000	931	1,163	1,221	1,374	OpenStudio
Convenience Store	381	321	474	454	459	OpenStudio
Drug Store	809	773	910	973	983	OpenStudio
Elementary School	631	632	721	731	776	OpenStudio
Emergency Services	1,654	1,687	1,915	2,150	2,190	OpenStudio
Garage	1,062	1,058	1,316	1,604	1,567	eQuest
Grocery	642	612	765	792	783	OpenStudio
Healthcare Clinic	1,681	1,662	1,860	2,035	2,023	OpenStudio
High School	725	678	782	827	819	OpenStudio
Hospital - CAV no econ	1,987	1,995	2,194	2,353	2,297	OpenStudio
Hospital - CAV econ	1,559	1,599	1,851	1,972	1,920	OpenStudio
Hospital - VAV econ	1,670	1,726	1,891	2,010	2,002	OpenStudio
Hospital - FCU	2,158	2,117	2,210	2,393	2,322	OpenStudio
Hospital - Unknown	1,844	1,859	2,037	2,182	2,135	OpenStudio
Hotel/Motel	1,380	1,349	1,625	1,745	1,826	OpenStudio
Hotel/Motel - Common	1,367	1,369	1,594	1,690	1,785	OpenStudio
Hotel/Motel - Guest	1,327	1,352	1,624	1,739	1,840	OpenStudio
Manufacturing Facility_Miscellaneous	2,121	2,098	2,133	2,172	2,197	OpenStudio

Building Type	Cooling EFLH Existing Buildings					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Manufacturing Facility_Food/Chemical	5,016	4,986	4,995	5,042	5,035	OpenStudio
MF - High Rise	1,571	1,490	1,980	2,087	1,679	OpenStudio
MF - High Rise - Common	970	970	1,230	1,252	938	OpenStudio
MF - High Rise - Residential	1,522	1,433	1,932	2,047	1,655	OpenStudio
MF - Mid Rise	1,177	1,250	1,533	1,643	1,560	OpenStudio
Movie Theater	820	695	754	818	1,049	OpenStudio
Office - High Rise - CAV no econ	1,465	1,473	1,591	1,735	1,780	OpenStudio
Office - High Rise - CAV econ	1,065	1,084	1,281	1,346	1,392	OpenStudio
Office - High Rise - VAV econ	1,307	1,268	1,408	1,547	1,578	OpenStudio
Office - High Rise - FCU	1,516	1,484	1,572	1,682	1,638	OpenStudio
Office - Low Rise	768	775	959	959	1,054	OpenStudio
Office - Mid Rise	1,135	1,096	1,247	1,352	1,425	OpenStudio
Religious Building	502	449	551	505	568	OpenStudio
Restaurant	1,107	1,133	1,338	1,447	1,489	OpenStudio
Retail - Department Store	861	835	1,019	1,052	1,089	OpenStudio
Retail - Strip Mall	778	770	982	1,026	981	OpenStudio
Warehouse Nonrefrigerated	349	345	442	457	499	OpenStudio
Warehouse Refrigerated	360	353	452	415	505	OpenStudio
Medical Office	1,240	1,203	1,299	1,397	1,494	OpenStudio
Unknown	825	805	953	1,000	1,038	n/a

Equivalent Full Load Hours for Cooling ($EFLH_{cooling}$) for New Construction:

Building Type	Cooling EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Assembly	825	780	906	987	1,065	OpenStudio
Assisted Living	1,000	1,001	1,257	1,280	1,207	OpenStudio
Auto Dealership	841	823	985	1,010	1,065	OpenStudio
Childcare/Pre-School	626	640	782	780	663	OpenStudio
College	1,000	933	1,096	1,123	1,145	OpenStudio
Convenience Store	302	247	378	349	375	OpenStudio
Drug Store	1,177	1,157	1,312	1,381	1,410	OpenStudio

Building Type	Cooling EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Elementary School	791	774	925	905	920	OpenStudio
Emergency Services	1,253	1,313	1,543	1,589	1,638	OpenStudio
Grocery	499	312	311	286	301	OpenStudio
Healthcare Clinic	1,391	1,389	1,526	1,661	1,663	OpenStudio
High School	885	839	1,015	1,049	1,076	OpenStudio
Hospital - CAV no econ	2,622	2,618	2,731	2,876	2,886	OpenStudio
Hospital - CAV econ	1,406	1,463	1,720	1,792	1,926	OpenStudio
Hospital - VAV econ	1,539	1,500	1,863	2,002	1,996	OpenStudio
Hospital - FCU	3,129	3,098	3,193	3,358	3,301	OpenStudio
Hospital - Unknown	2,174	2,170	2,377	2,507	2,527	n/a
Hotel/Motel	1,944	1,941	1,985	2,090	2,102	OpenStudio
Hotel/Motel - Common	1,293	1,329	1,543	1,619	1,643	OpenStudio
Hotel/Motel - Guest	987	1,015	1,146	1,165	1,193	OpenStudio
Manufacturing Facility_Miscellaneous	1,303	1,316	1,452	1,557	1,385	OpenStudio
Manufacturing Facility_Food/Chemical	2,094	2,134	2,307	2,597	2,532	OpenStudio
MF - High Rise	2,113	2,093	2,372	2,475	2,078	OpenStudio
MF - High Rise - Common	984	998	1,241	1,279	918	OpenStudio
MF - High Rise - Residential	2,102	2,089	2,382	2,493	2,078	OpenStudio
MF - Mid Rise	1,823	1,877	2,163	2,239	2,079	OpenStudio
Movie Theater	434	397	508	506	573	OpenStudio
Office - High Rise - CAV no econ	1,405	1,390	1,571	1,655	1,664	OpenStudio
Office - High Rise - CAV econ	1,062	1,076	1,302	1,317	1,320	OpenStudio
Office - High Rise - VAV econ	963	961	1,130	1,204	1,205	OpenStudio
Office - High Rise - FCU	1,926	1,872	1,952	2,074	2,092	OpenStudio
Office - Low Rise	611	607	744	731	721	OpenStudio
Office - Mid Rise	927	927	1,106	1,184	1,208	OpenStudio
Religious Building	464	469	556	527	588	OpenStudio
Restaurant	1,149	1,175	1,405	1,496	1,525	OpenStudio
Retail - Department Store	861	840	994	1,016	1,058	OpenStudio
Retail - Strip Mall	711	664	813	824	847	OpenStudio
Warehouse Nonrefrigerated	345	362	420	420	481	OpenStudio
Warehouse Refrigerated	175	178	233	205	267	OpenStudio
Medical Office	1,149	1,145	1,356	1,400	1,428	OpenStudio

Building Type	Cooling EFLH New Construction					Model Source
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)	
Unknown	799	784	925	950	979	n/a

4.4.1 Air Conditioner Tune-up

DESCRIPTION

An air conditioning system that is operating as designed saves energy and provides adequate cooling and comfort to the conditioned space

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a unitary or split system air conditioner at least 3 tons and preapproved by program. The measure requires that a certified technician performs the following items:

- Check refrigerant charge
- Identify and repair leaks if refrigerant charge is low
- Measure and record refrigerant pressures
- Measure and record temperature drop at indoor coil
- Clean condensate drain line
- Clean outdoor coil and straighten fins
- Clean indoor and outdoor fan blades
- Clean indoor coil with spray-on cleaner and straighten fins
- Repair damaged insulation – suction line
- Change air filter
- Measure and record blower amp draw

A copy of contractor invoices that detail the work performed to identify tune-up items, as well as additional labor and parts to improve/repair air conditioner performance must be submitted to the program.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be an AC system that that does not have a standing maintenance contract or a tune up within in the past 36 months.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 3 years.[631]

DEEMED MEASURE COST

Tune-up costs can vary considerably, particularly if refrigerant leak detection, remediation and recharge is necessary. Actual invoiced tune-up costs should be used.

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [632]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

[631] 3 years is given for "Clean Condenser Coils – Commercial" and "Clean Evaporator Coils". DEER2014 EUL Table.

[632] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

= 47.8%[633]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWH = (kBtu/hr) * [(1/EERbefore) - (1/EERafter)] * EFLH$$

Where:

kBtu/hr = capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).

=Actual

EERbefore = Energy Efficiency Ratio of the baseline equipment prior to tune-up[634]

=Actual

EERafter = Energy Efficiency Ratio of the baseline equipment after to tune-up

=Actual

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

Where it is not possible or appropriate to perform Test in and Test out of the equipment, the following deemed methdology can be used:

$$\Delta kWh = (kBtu/hr) \,/\, EERbefore * EFLH * \%Savings$$

Where:

%Savings = Deemed percent savings per Tune-Up component. These are additive if condenser cleaning, evaporator cleaning and refrigerant charge correction are performed (totals provided below)[635]

Tune-Up Component	% Savings
Condenser Cleaning	6.10%
Evaporator Cleaning	0.22%
Refrig. Charge Off. <=20%	0.68%
Refrig. Charge Off. >20%	8.44%
Combined (Refrig. Charge Off. <=20%)	7.00%

[633]Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[634] In the context of this measure Energy Efficiency Ratio (EER) refers to field-measured steady-state rate of heat energy removal (e.g., cooling capacity) by the equipment in Btuh divided by the steady-state rate of energy input to the equipment in watts. This ratio is expressed in Btuh per watt (Btuh/watt). The cooling capacity may be derived using either refrigerant or air-side measurements. The measurement is performed at the outdoor and indoor environmental conditions that are present at the time the tune-up is being performed, and should be normalized using a correction function to the AHRI 210/240 Standard test conditions. The correction function should be developed based on manufacturer's performance data. Care must be taken to ensure the unit is fully loaded and operating at or near steady-state. Generally, this requires that the outside air temperature is at least 60°F, and that the unit runs with all stages of cooling enabled for 10 to 15 minutes prior to making measurements. For more information, please see "IL TRM_Normalizing to AHRI Conditions Method".

[635] Savings estimates are determined by applying the findings from DNV-GL "Impact Evaluation of 2013-2014 HVAC3 Commercial Quality Maintenance Programs", April 2016, to simulate the inefficient condition within select eQuest models and across climate zones. The percent savings were consistent enough across building types and climate zones that it was determined appropriate to apply a single set of assumptions for all. See 'eQuest C&I Tune up Analysis.xlsx' for more information.

Tune-Up Component	% Savings
Combined (Refrig. Charge Off. >20%)	14.76%

For example, a 12 EER 5-ton rooftop air conditioner on a department store in Rockford receives a tune-up that includes both condenser and evaporator cleaning:

ΔkWh = (5*12) / 12 * 1,392 * 6.32%

= 440 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW_{SSP} = (kBtu/hr * (1/EERbefore - 1/EERafter)) * CF_{SSP}$$

$$\Delta kW_{PJM} = (kBtu/hr * (1/EERbefore - 1/EERafter)) * CF_{PJM}$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [636]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [637]

Where it is not possible or appropriate to perform Test in and Test out of the equipment, the following deemed methdology can be used:

$$\Delta kW = (kBtu/hr) / EERbefore * \%Savings * CF$$

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-ACTU-V06-250101

REVIEW DEADLINE: 1/1/2027

[636] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[637] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

4.4.2 Space Heating Boiler Tune-up

DESCRIPTION

This measure is for a non-residential boiler that provides space heating. The tune-up will improve boiler efficiency by cleaning and/or inspecting burners, combustion chamber, and burner nozzles. Adjust air flow and reduce excessive stack temperatures, adjust burner and gas input. Check venting, safety controls, and adequacy of combustion air intake. Combustion efficiency should be measured before and after tune-up using an electronic flue gas analyzer.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements listed below[638] by approved technician:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces.
- Inspect all refractory. Patch and wash coat as required.*
- Inspect gaskets on front and rear doors and replace as necessary.*
- Seal and close front and rear doors properly.*
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.*
- Clean plugs in control piping.*
- Remove all hand hole and manhole plates. Flush boiler with water to remove loose scale and sediment.*
- Replace all hand hole and manhole plates with new gaskets.*
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.*
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.*
- Make necessary adjustments to burner for proper combustion.
- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and manhole plates for leaks at normal operating temperatures and pressures.
- Troubleshoot any boiler system problems as requested by on-site personnel

Note: Tune-up activities marked with an asterisk (*) are eligible to be performed by internal maintenance staff at periods of boiler shutdown.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a boiler that has not had a tune-up within the past 36 months.

[638] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 3 years.[639]

DEEMED MEASURE COST

The assumed cost of this measure is $0.83/MBtu/hr per tune-up[640], or $224 per boiler serviced[641]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = (Capacity * EFLH * (((Eff_{before} + E_i)/ Eff_{before}) - 1)) / 100{,}000$$

Where:

Capacity = Boiler gas input size (Btu/hr)

= Custom

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

Eff_{before} = Efficiency of the boiler before the tune-up

= Actual. Default value is 81.5%[642]

Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the heating season and take readings at a consistent firing rate for pre and post tune-up.

E_i = Efficiency improvement of the boiler tune-up measure

= Actual. Default value is 2.3%[643]

100,000 = Converts Btu to therms

[639] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

[640] Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

[641] Center for Energy and Environment Expanded Scope Commercial Boiler Tune Ups, 8/31/2021, Table 12

[642] Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

[643] Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

For example, a 1050 kBtu boiler in a Chicago high rise office records an efficiency prior to tune up of 81.5% AFUE and a 2.3% improvement in efficiency after tune up:

$$\Delta therms = (1{,}050{,}000 * 2050 * ((0.815 + 0.023)/ 0.815 - 1)) /100{,}000$$

$$= 607 \text{ Therms}$$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-BLRT-V08-270101

REVIEW DEADLINE: 1/1/2030

4.4.3 Process Boiler Tune-up

DESCRIPTION

This measure is for a non-residential boiler for process loads. For space heating, see measure 4.4.2. The tune-up will improve boiler efficiency by cleaning and/or inspecting burners, combustion chamber, and burner nozzles. Adjust air flow and reduce excessive stack temperatures, adjust burner and gas input. Check venting, safety controls, and adequacy of combustion air intake. Combustion efficiency should be measured before and after tune-up using an electronic flue gas analyzer.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the facility must, as applicable, complete the tune-up requirements by approved technician[644] as specified below:

- Measure combustion efficiency using an electronic flue gas analyzer
- Adjust airflow and reduce excessive stack temperatures
- Adjust burner and gas input, manual or motorized draft control
- Check for proper venting
- Complete visual inspection of system piping and insulation
- Check safety controls
- Check adequacy of combustion air intake
- Clean fireside surfaces
- Inspect all refractory. Patch and wash coat as required.*
- Inspect gaskets on front and rear doors and replace as necessary.*
- Seal and close front and rear doors properly.*
- Clean low and auxiliary low water cut-off controls, then re-install using new gaskets.*
- Clean plugs in control piping.*
- Remove all hand hole and man hole plates. Flush boiler with water to remove loose scale and sediment.*
- Replace all hand hole and man hole plates with new gaskets.*
- Open feedwater tank manway, inspect and clean as required. Replace manway plate with new gasket.*
- Clean burner and burner pilot.
- Check pilot electrode and adjust or replace.
- Clean air damper and blower assembly.
- Clean motor starter contacts and check operation.*
- Make necessary adjustments to burner for proper combustion.
- Perform all flame safeguard and safety trip checks.
- Check all hand hole plates and man hole plates for leaks at normal operating temperatures and pressures.
- Troubleshoot any boiler system problems as requested by on-site personnel

Note: Tune-up activities marked with an asterisk (*) are eligible to be performed by internal maintenance staff at periods of boiler shutdown.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition of this measure is a boiler that has not had a tune-up within the past 24 months and that does not have a standing maintenance contract.

[644] Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 2 year.[645]

DEEMED MEASURE COST

The cost of this measure is $0.60/MBtu/hr per tune-up.[646]

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = ((Capacity * 8766 * UF) / 100) * (1 - (Eff_{pre} / Eff_{measured}))$$

Where:

Capacity = Boiler gas input size (kBtu/hr)

=Custom

UF = Utilization Factor

= 41.9%,[647] or custom

Eff_{pre} = Boiler Combustion Efficiency Before Tune-Up

= Actual. Default value is 80.3%[648]

Note: Contractors should select a firing rate that appropriately represents the average operating condition and take readings at a consistent firing rate for pre and post tune-up.

$Eff_{measured}$ = Boiler Combustion Efficiency After Tune-Up

[645] U.S. Department of Energy, "Chapter 9 O&M Ideas for Major Equipment Types" in Operations & Maintenance Best Practices Guide: Release 3.0", August 2010, 9.19 – 9.20

[646] Incremental costs are sourced from Nicor Gas program data and reflect an average of actual process boiler tune-up costs from projects implemented in 2020 and 2021. For more detail, see: "4.4.2 Process Boiler tune up IMC – Nicor Gas.xlsx".

[647] Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

[648] Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

= Actual. Default value is 82.6%[649]

100 = converstion from kBtu to therms

8766 = hours a year

For example, a 80.3% 1050 kBtu boiler is tuned-up resulting in final efficiency of 82.6%:

Δtherms =((1050 * 8766 * 0.419) / 100) * (1 - (0.80.3 / 0.826))

= 1074 therms

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-PBTU-V07-230101

REVIEW DEADLINE: 1/1/2029

[649] Guidehouse evaluation results from tune-up efficiency improvement research for Peoples Gas and North Shore Gas through their C&I and Public Sector Prescriptive Rebate Program, their Small Business Program, and their Multi-Family Programs. The evaluation included project and population data from program year's 2018 and 2019.

4.4.4 Boiler Lockout/Reset Controls

DESCRIPTION

This measure relates to improving combustion efficiency by adding controls to non-residential space heating boilers to vary the boiler entering water temperature relative to heating load as a function of the outdoor air temperature to save energy. Energy is saved by increasing the temperature difference between the water temperature entering the boiler in the boiler's heat exchanger and the boiler's burner flame temperature. The flame temperature remains the same while the water temperature leaving the boiler decreases with the decrease in heating load due to an increase in outside air temperature. A lockout temperature is also set to prevent the boiler from turning on when it is above a certain temperature outdoors.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Natural gas customer adding boiler reset controls capable of resetting the boiler supply water temperature in an inverse linear fashion with outdoor air temperature. Boiler lockout temperatures should be set to 55 °F at this time as well, to turn the boiler off when the temperature goes above a certain setpoint.

DEFINITION OF BASELINE EQUIPMENT

Existing boiler without boiler reset controls, any size with constant hot water flow.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 16 years.[650]

DEEMED MEASURE COST

The cost of this measure is $612.[651]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = Capacity_{input} * SF * EFLH / 100$$

Where:

$Capacity_{input}$ = Boiler Input Capacity (kBtu/hr)

[650] This is intentionally longer than the assumptions found in the early replacement commercial HVAC measures as the application of boiler reset controls will occur in a variety of sites that may not be targeted for early replacement HVAC systems.
[651] Nexant. Questar DSM Market Characterization Report. August 9, 2006.

= custom

SF = Savings factor

= 8%,[652] or custom

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

100 = conversion from kBtu to therms

For example, reset controls were installed on an 800 kBtu/hr boiler at a restaurant in Rockford, IL

ΔTherms = 800 * 0.08 * 1,350 / 100

= 864 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-BLRC-V05-240101

REVIEW DEADLINE: 1/1/2029

[652] Savings factor is the estimate of annual gas consumption that is saved due to adding boiler reset controls. A comparable savings factor, based on boiler tuneup savings is derived from Xcel Energy "DSM Biennial Plan-Technical Assumptions," Colorado. For further substantiation, Wisconsin Focus on Energy 2020 TRM uses 8%, citing multiple sources. And other prescriptive programs across the country consistently use between 5 and 10% savings factor (Efficiency Vermont - 2020, New York TRM, version 7.0 – 2020 (Cadmus Group, Inc. Home Energy Services Impact Evaluation, August 2012, pg. 20)).

4.4.5 Condensing Unit Heaters

DESCRIPTION

This measure applies to a gas fired condensing unit heater installed in a commercial application.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a condensing unit heater up to 300 MBH with a Thermal Efficiency > 90% and the heater must be vented, and condensate drained per manufacturer specifications. The unit must be replacing existing natural gas equipment.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be a non-condensing natural gas unit heater at end of life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[653]

DEEMED MEASURE COST

The incremental capital cost for a unit heater is equal to the input capacity in kBtu/h multiplied by $4.82[654]

Incremental cost = Capacity * $4.82

Where:

Capacity	= Nominal rating of the input capacity of the new condensing unit heater in kBtu/hr
$4.82	= Incremental cost per kBtu/h of input capacity of a new condensing unit heater

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

[653]PA Consulting Group. Focus on Energy, Business Programs: Measure Life Study Final Report. August 25, 2009.
[654]The incremental capitol cost is based on historic project data from Wisconsin Focus on Energy, spanning 2020 through September 2022. The data is aggregated based on 18 projects that comprised of 68 installed unit heaters. The average installed unit heater cost was $17.46 / kBtu/h of input unit capacity. The baseline unit heater cost was estimated to be $12.63 / kBtu/h of input unit capacity, per review of online pricing of Reznor and Modine models on Supply House's website. The incremental cost was sourced from the 2025 Wisconsin Focus on Energy TRM, Public Service Commission of Wisconsin, Cadmus – "Unit Heaters, > 90% Thermal Efficiency (pg. 245)

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = ((Capacity * EFLH * UF) / 100) * (1 / Eff_{Base} - 1 / Eff_{EE})$$

Where:

Capacity = Nominal rating of the input capacity of the new condensing unit heater in kBtu/hr

= Actual

UF = Utilization Factor

= 72.5%,[655] or custom

Eff_{Base} = Combustion Efficiency of the baseline unit heater

= Default value is 80%[656]

Eff_{EE} = Combustion Efficiency of the installed unit heater

= Actual. Default value is 90%

100 =converstion from kBtu to therms

EFLH = Equivalent Full Load Hours for in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

For example, a 150 kBtu condensing unit heater with a combustion efficiency of 90% is installed in a garage in Rockford:

Δtherms =((150 * 985 * 0.725) / 100) * (1 / 0.80 – 1 / 0.90)

= 149 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-CUHT-V04-270101

REVIEW DEADLINE: 1/1/2030

[655] The utilization factor accounts for the fact that unit heaters are typically over-sized. Value as sourced from the 2025 Wisconsin Focus on Energy Technical Reference Manual, Public Service Commission of Wisconsin, Cadmus – Unit Heaters, ≥ 90% Thermal Efficiency (pg. 245)

[656] Baseline combustion efficiency is sourced from IECC 2024 for all capacity warm-air unit heaters, gas-fired.

4.4.6 Electric Chiller

DESCRIPTION

This measure relates to the installation of a new electric chiller meeting the efficiency standards presented below. This measure could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new chiller or chillers in an existing building (i.e. time of sale) or new construction.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to exceed the efficiency requirements of the baseline defined by the program.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to meet the minimum efficiency requirements within the IECC code in effect on the date of the building permit. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Note, users should refer to the website for the Illinois Energy Conservation Code to verify the latest adopted code.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 23 years.[657]

DEEMED MEASURE COST

The incremental capital cost for this measure is provided below:

Air-Cooled Chiller Incremental Costs ($/Ton) [658]				
Capacity (Tons)	Efficient EER (Baseline Path B FL EER = 9.70)			
	9.9	10.2	10.52	10.7
50	$226	$453	$694	$830
100	$113	$226	$347	$415
150	$75	$151	$231	$277
200	$46	$92	$141	$169
400	$23	$46	$71	$85

Air-Cooled Chiller Incremental Costs ($/Ton)		
Efficient EER (Baseline Path B IPLV)[659]		
Capacity (Tons)	Efficient IPLV	$/Ton
<150	17.7	$73.35
	19.0	$127.50
≥150	18.0	$33.32
	19.3	$56.12

[657] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018. (http://deeresources.com/deer0911planning/downloads/EUL_Summary_10-1-08.xls).
[658] Based on Navigant Consulting, NEEP "Incremental Cost Study Phase Two Final Report", January 2013.
[659] Based on San Diego Gas & Electric (SDG&E) "SWHC052 2022 CostAnalysis.xlsx", January 2022

Water Cooled Chiller Incremental Costs (Baseline Path B FL)[660]							
	Scroll/Screw Chiller				Centrifugal Chiller		
Capacity (Tons)	Efficient kW/ton (Baseline 0.78 kW/Ton)				Efficient kW/ton (Baseline 0.64 kW/Ton)		
	0.72	0.68	0.64	0.6	0.60	0.58	0.54
50	$114	$164	N/a	N/a	$62	$99	$172
100	$52	$77	N/a	N/a	$42	$66	$115
150	N/a	N/a	N/a	N/a	$31	$49	$86
200	N/a	N/a	$61	$122	N/a	N/a	$55
400	N/a	N/a	N/a	$16	N/a	N/a	$22

Water Cooled Chiller Incremental Costs (Baseline Path B IPLV)[661]					
Scroll/Screw Chiller			Centrifugal Chiller		
Capacity (Tons)	Efficient kW/Ton	$/Ton	Capacity (Tons)	Efficient kW/Ton	$/Ton
< 75	0.45	$106	< 150	0.40	$185
	0.43	$193		0.37	$263
75 to 149	0.44	$21	150 to 299	0.36	$72
	0.42	$39		0.34	$275
150 to 299	0.40	$37	300 to 399	0.35	$158
	0.37	$167		0.33	$226
300 to 599	0.37	$180	400 to 599	0.34	$194
	0.35	$322		0.32	$250
>= 600	0.34	$162	>= 600	0.34	$66
	0.32	$296		0.32	$99

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [662]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [663]

[660] Based on Navigant Consulting, NEEP "Incremental Cost Study Phase Two Final Report", January 2013.
[661] Based on "Water-Cooled Chiller (WCC) (SWHC005-02) Cost Data" by Southern California Edison, November 2020 (SWHC005_Water-Cooled_Chiller_Cost_Data_2020Q3.xlsx)
[662] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[663] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Algorithm

CALCULATION OF SAVINGS

The enhanced electric energy savings calculation should be used as the primary method for more accurate energy savings, with the efficiencies calculated for the specific climate zone and building type for the chiller application. Where the calculated NPLV efficiency of the chiller at the specific conditions is unknown, the basic electric energy savings calculation can be used as a secondary method where the traditional industry-standard IPLV ratings may be more readily available.

ELECTRIC ENERGY SAVINGS

BASIC ELECTRIC ENERGY SAVINGS FOR WATER-COOLED CHILLERS:

$$\Delta kWH = TONS * ((IPLVbase) - (IPLVee)) * EFLH$$

Where:

TONS = chiller actual installed cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)

IPLVbase = efficiency of baseline equipment expressed as Integrated Part Load Value(kW/ton) obtained from current IECC Minimum Efficiency Table – Path (A). Refer to Baseline Efficiency Values by Chiller Type and Capacity in the Reference Tables & Equations section.

IPLVee[664] = efficiency of high efficiency equipment expressed as Integrated Part Load Value (kW/ton)[665]

= Actual installed

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

For example, using the default assumptions on the installation of a 150 Ton Centrifugal Water-Cooled Electric Chiller in a Mid-Rise Office in Rockford with an IPLV of .405 kW/ton:

ΔkWh = 150 * (0.550 - 0.405) * 1672

= 36,366 kWh

ENHANCED ELECTRIC ENERGY SAVINGS FOR WATER-COOLED CHILLERS:

$$\Delta kWH = TONS * ((IPLVbase * ILad) - (NPLV - ILee)) * EFLH$$

Where:

TONS = chiller actual installed cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)

ILadj = adjustment factor to align IPLVbase to Illinois climate and building type. Refer to Table 1 below.

NPLV-ILee[666] = efficiency of proposed high efficiency equipment as Non-Standard Part Load Value (kW/ton) evalutated at Illinois adjusted conditions. All other variables to remain at AHRI standard conditions.

[664] Integrated Part Load Value is a seasonal average efficiency rating calculated in accordance with ARI Standard 550/590. It may be calculated using any measure of efficiency (EER, kW/ton, COP), but for consistency with IECC code requirements, it is expressed in terms of IPLV here.

[665] Can determine IPLV from standard testing or looking at engineering specs for design conditions. Standard data is available from AHRI online Certification Directory.

[666] Calculation to be performed using manufacturer-provided efficiency ratings at custom part-load operating points specific to Illinois climate and building type. All other variables to remain at AHRI standard conditions. These custom part-load operating points are based on building load profiles generated from public domain EnergyPlus files developed by Pacific Northwest National Labs in conjunction and with oversight from ASHRAE. The different building types are reflective of certain typical

Chiller manufacturer shall evaluate their chiller's efficiencies at the four unique part-load operating points using entering condenser water temperatures (ECWT) and the adjusted weighted percentages from Table 2 below for the applicable building space type listed[7]. Refer to following NPLV equation:

$$NPLV\ (kw/ton) = 1/[a/A + b/B + c/C + d/D]$$

Where: the lower case letters are the decimal values for weighting and the upper case letters are the chiller efficiency rating at each unique operating point.

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

TABLE 1:

Water-Cooled Chillers ILadj Factors to IPLV (Path A) Baseline		
Space Type (occupancy schedule assumption)	Water-Cooled Chiller Type	
	Centrifugal	Screw/Scroll
Office (or unknown[667]) (12hr, 5 days/week)	1.143	1.178
Hospital (24hr, 7 days/week, high occupancy during day)	1.043	1.067
High-Rise Apartments (24hr, 7 days/week, lighter occupancy during day)	1.117	1.155
Primary School (12hr, 5 days/week, seasonal)	1.082	1.127
Hotel (24hr, 7days/week)	1.159	1.186

TABLE 2:

Water-Cooled Chillers NPLV Part-Load Evaluation Conditions Adjusted to Illinois by Building Type								
	% Full Load Cooling Design for Chiller							
	25%		50%		75%		94%	
Space Type	Weight	ECWT [F]	Weight	ECWT [F]	Weight	ECWT [F]	Weight	ECWT [F]
Office (or unknown)	40.1%	68.1	38.3%	74.8	17.9%	80.4	3.7%	84.8
Hospital	15.0%	62.2	44.6%	69.8	35.6%	76.7	4.8%	83.7
High-Rise Apartments	30.1%	68.7	41.6%	73.8	21.3%	78.7	7.0%	83.4
Primary School	25.3%	67.0	26.3%	71.9	31.2%	76.1	17.2%	81.5
Hotel	47.8%	67.0	39.2%	76.1	12.2%	82.2	0.80%	86.9

occupancy schedules. See Reference Tables & Equations section at the end of this measure for additional info and supporting equations.

[667] Office building type is considered a reasonable estimate of the average application.

For example, using the default assumptions on the installation of a 150 Ton Centrifugal Water-Cooled Electric Chiller in a Mid-Rise Office in Rockford with an IPLV of .405 kW/ton:

ΔkWh = 150 * ((0.55 * 1.143) - (1 / ((0.401 / 0.409) + (0.383 / 0.406) + (0.179 / 0.405) + (0.037 / 0.403)))) * 1672

= 55,613.7

BASIC ELECTRIC ENERGY SAVINGS FOR AIR-COOLED CHILLERS:

$$\Delta kWH = TONS * ((12/IPLVbase) - (12/IPLVee)) * EFLH$$

Where:

TONS = chiller actual installed cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)

IPLVbase = efficiency of baseline equipment as Integrated Part Load Value (EER) obtained from current IECC Minimum Efficiency Table – Path (A).. Refer to Baseline Efficiency Values by Chiller Type and Capacity in the Reference Tables & Equations section.

IPLVee[668] = efficiency of proposed high efficiency equipment expressed as Integrated Part Load Value (EER)

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

For example, using the default assumptions on the installation of a 150 Ton Centrifugal Air-Cooled Electric Chiller in a Mid-Rise Office in Rockford with an IPLV of 15:

ΔkWh = 150 * ((12 / 14) - (12 / 15)) * 1672

= 14,331.4 kWh

ENHANCED ELECTRIC ENERGY SAVINGS FOR AIR-COOLED CHILLERS:

$$\Delta kWH = TONS * (12/(IPLVbase * ILadj) - 12/(NPLV - ILee)) * EFLH$$

Where:

TONS = chiller actual installed cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)

ILadj = adjustment factor to align IPLVbase to Illinois climate and building type. Refer to Table 3 below.

NPLV-ILee[669] = efficiency of proposed high efficiency equipment as Non-Standard Part Load Value (EER) evalutated at Illinois adjusted conditions. All other variables to remain at AHRI standard conditions. Chiller manufacturer shall evaluate their chiller's efficiencies at the four unique part-load operating points using outdoor design dry bulb (ODDB) and the adjusted weighted percentages from Table 4 below for the applicable building space type listed. Refer to following NPLV equation:

NPLV (EER) = a*A + b*B + c*C + d*D

[668] Integrated Part Load Value is a seasonal average efficiency rating calculated in accordance with AHRI Standard 550/590. It may be calculated using any measure of efficiency (EER, kW/ton, COP), but for consistency with IECC code requirements, it is expressed in terms of IPLV here. IPLV data is available from AHRI online Certification Directory or certified chiller manufacturer's data.

[669] Calculation to be performed using manufacturer-provided efficiency ratings at custom part-load operating points specific to Illinois climate and building type. All other variables to remain at AHRI standard conditions. These custom part-load operating points are based on building load profiles generated from public domain EnergyPlus files developed by Pacific Northwest National Labs in conjunction and with oversight from ASHRAE. The different building types are reflective of certain typical occupancy schedules. See Reference Tables & Equations section at the end of this measure for additional info and supporting equations.

Where: the lower case letters are the decimal values for weighting and the upper case letters are the chiller efficiency rating at each unique operating point.

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

TABLE 3:

Air-Cooled Chillers ILadj Factors to IPLV (Path A) Baseline	
Space Type	Air-Cooled Chiller
Office (or unknown)	0.860
Hospital	0.925
High-Rise Apartments	0.866
Primary School	0.850
Hotel	0.929

TABLE 4:

Air-Cooled Chillers NPLV Part-Load Evaluation Conditions Adjusted to Illinois by Building Type								
	% Full Load Cooling Design for Chiller							
	25%		50%		75%		94%	
Space Type	Weight	ODDB [F]	Weight	ODDB [F]	Weight	ODDB [F]	Weight	ODDB [F]
Office (or unknown)	40.1%	69.1	38.3%	77.2	17.9%	83.9	3.7%	89.2
Hospital	15.0%	60.0	44.6%	70.2	35.6%	77.5	4.8%	86.6
High-Rise Apartments	30.1%	67.2	41.6%	75.9	21.3%	83.2	7.0%	89
Primary School	25.3%	68.1	26.3%	74.1	31.2%	79.6	17.2%	85.6
Hotel	47.8%	65.3	39.2%	76.9	12.2%	84.6	0.80%	85.6

For example, using the default assumptions on the installation of a 150 Ton Centrifugal Air-Cooled Electric Chiller in a Mid-Rise Office in Rockford with an IPLV of 15:

ΔkWh = 150 * (12 / (14 * .86) - (12 / ((0.401 * 15.3) + (0.383 * 15.1) + (0.179 * 15) + (0.037 * 14.9)))) * 1,672

= 51,377.5 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$\Delta kW_{SSP} = TONS * ((PEbase) - (PEee)) * CF_{SSP}$

$\Delta kW_{PJM} = TONS * ((PEbase) - (PEee)) * CF_{PJM}$

Where:

PEbase = Peak efficiency of baseline equipment expressed as Full Load (kW/ton)

PEee = Peak efficiency of high efficiency equipment expressed as Full Load (kW/ton)

= Actual installed

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%

For example, using the default assumptions on the installation of a 150 Ton Centrifugal Water-Cooled Electric Chiller in a Mid-Rise Office in Rockford with a peak efficiency of .409 kW/ton:

ΔkW_{SSP} = 150 * (.550 - .409) * .913

= 19.3

ΔkW_{PJM} = 150 * (.550 - .409) * .478

= 10.1

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

REFERENCE TABLES

***Chillers Ratings**- Chillers are rated with different units depending on equipment type as shown below

Equipment Type	Unit
Air cooled, electrically operated	Full load EER Part Load EER
Water cooled, electrically operated, positive displacement (reciprocating and rotary screw and scroll)	Full Load kW/ton Part Load kW/ton
Water cooled, electrically operated, centrifugal	Full Load kW/ton Part Load kW/ton

****IPLV Equations and Standard Rating Conditions per AHRI 550/590:**

Expression Of Chiller Efficiency	Equation				
Coefficient Of Performance–COP, W/W, or Energy Efficiency Ratio–EER, Btu/h/W	IPLV or NPLV = 0.01A + 0.42B + 0.45C + 0.12D				
Power Per Ton, kW/ton	IPLV or NPLV = $\frac{1}{\frac{0.01}{A}+\frac{0.42}{B}+\frac{0.45}{C}+\frac{0.12}{D}}$				
	Chiller Energy Efficiency, Load				
	A at 100%	**B** at 75%	**C** at 50%	**D** at 25%	— at 0%
IPLV Rating Conditions					
Condenser, water-cooled only:[a]					
Entering water temperature, F [C]	85 [29.4][b]	75 [23.9]	65 [18.3]	65 [18.3]	65 [18.3]
Flow rate, gpm/ton [Lps per kW]	3.0 [0.054][c]				
Fouling factor, h·ft²·F/Btu [m²·C/W]	0.00025 [0.000044]				
Evaporator:					
Leaving water temperature, F [C]	44 [6.7][b]	—	—	—	44 [6.7]
Flow rate, gpm/ton [Lps per kW]	2.4 [0.043][c]	—	—	—	2.4 [0.043]
Fouling factor, h·ft²·F/Btu [m²·C/W]	0.0001[0.000018]				

***Building Types** - Generalized Occupancy Schedules of Building Types for Reference:

Office –12 hour operation; 5 days a week

Hospital –24 hour operation; 7 days a week; heavier occupancy during the day

High Rise Apts – 24 hour operation; 7 days a week; lighter occupancy during the day

Primary School – 12 hour operation; 5 days a week; seasonal

Hotel –24 hour operation; 7 days a week

****Conversion Factors** – Equations to convert efficiency units where necessary:

kW/ton = 12 / EER

kW/ton = 12 / (COP x 3.412)

COP = EER / 3.412

COP = 12 / (kW/ton) / 3.412

EER = 12 / kW/ton

EER = COP x 3.412

2018 IECC Baseline Efficiency Values by Chiller Type and Capacity (effective 7/1/2019 to 12/31/2023)

TABLE C403.3.2(7)
WATER CHILLING PACKAGES — EFFICIENCY REQUIREMENTS[a, b, d]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE[b]
			Path A	Path B	Path A	Path B	
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA[c]	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15,800 IPLV	
	≥ 150 Tons		≥ 9.562 FL	NA[c]	≥ 10.100 FL	≥ 9.700 FL	
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.				
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL	
			≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV	
	≥ 75 tons and < 150 tons		≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.615 IPLV	≤ 0.586 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV	
	≥ 150 tons and < 300 tons		≥ 0.680 FL	≥ 0.718 FL	≥ 0.660 FL	≥ 0.680 FL	
			≥ 0.580 IPLV	≥ 0.540 IPLV	≥ 0.540 IPLV	≥ 0.440 IPLV	
	≥ 300 tons and < 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV	
	≥ 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
Water cooled, electrically operated centrifugal	< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV	
	≥ 150 tons and < 300 tons		≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.400 IPLV	
	≥ 300 tons and < 400 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.520 IPLV	≤ 0.390 IPLV	
	≥ 400 tons and < 600 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
	≥ 600 Tons		≤ 0.570 FL	≤ 0.590 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.539 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
Air cooled, absorption, single effect	All capacities	COP	≥ 0.600 FL	NA[c]	≥ 0.600 FL	NA[c]	AHRI 560
Water cooled absorption, single effect	All capacities	COP	≥ 0.700 FL	NA[c]	≥ 0.700 FL	NA[c]	
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA[c]	≥ 1.000 FL	NA[c]	
			≥ 1.050 IPLV		≥ 1.050 IPLV		
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA[c]	≥ 1.000 FL	NA[c]	
			≥ 1.000 IPLV		≥ 1.050 IPLV		

a. The requirements for centrifugal chiller shall be adjusted for nonstandard rating conditions in accordance with Section C403.3.2.1 and are only applicable for the range of conditions listed in Section C403.3.2.1. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.

b. Both the full-load and IPLV requirements shall be met or exceeded to comply with this standard. Where there is a Path B, compliance can be with either Path A or Path B for any application.

c. NA means the requirements are not applicable for Path B and only Path A can be used for compliance.

d. FL represents the full-load performance requirements and IPLV the part-load performance requirements.

2021 IECC Baseline Efficiency Values by Chiller Type and Capacity (effective January 1, 2024 to November 29, 2025)

TABLE C403.3.2(3)
WATER-CHILLING PACKAGES—MINIMUM EFFICIENCY REQUIREMENTS[a, b, e, f]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	PATH A	PATH B	TEST PROCEDURE[c]
Air cooled chillers	< 150 tons	EER (Btu/Wh)	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 13.700 IPLV.IP	≥ 15.800 IPLV.IP	
	≥ 150 tons		≥ 10.100 FL	≥ 9.700FL	
			≥ 14.000 IPLV.IP	≥ 16.100 IPLV.IP	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/Wh)	Air-cooled chillers without condenser must be rated with matching condensers and comply with air-cooled chiller efficiency requirements		AHRI 550/590
Water cooled, electrically operated positive displacement	< 75 tons	kW/ton	≤ 0.750 FL	≤ 0.780 FL	AHRI 550/590
			≤ 0.600 IPLV.IP	≤ 0.500 IPLV.IP	
	≥ 75 tons and < 150 tons		≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.560 IPLV.IP	≤ 0.490 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.660 FL	≤ 0.680 FL	
			≤ 0.540 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 300 tons and < 600 tons		≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.520 IPLV.IP	≤ 0.410 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Water cooled, electrically operated centrifugal	< 150 tons	kW/ton	≤ 0.610 FL	≤ 0.695 FL	AHRI 550/590
			≤ 0.550 IPLV.IP	≤ 0.440 IPLV.IP	
			≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.550 IPLV.IP	≤ 0.400 IPLV.IP	
	≥ 300 tons and < 400 tons		≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.520 IPLV.IP	≤ 0.390 IPLV.IP	
	≥ 400 tons and < 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Air cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.600 FL	NA[d]	AHRI 560
Water cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.700 FL	NA[d]	AHRI 560
Absorption double effect, indirect fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 0.150 IPLV.IP		
Absorption double effect, direct fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 1.000 IPLV		

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.
b. The requirements for centrifugal chillers shall be adjusted for nonstandard rating conditions per Section C403.3.2.1 and are applicable only for the range of conditions listed there. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.
c. Both the full-load and IPLV.IP requirements must be met or exceeded to comply with this standard. When there is a Path B, compliance can be with either Path A or Path B for any application.
d. NA means the requirements are not applicable for Path B, and only Path A can be used for compliance.
e. FL is the full-load performance requirements, and IPLV.IP is for the part-load performance requirements.
f. This table is a replica of ASHRAE 90.1 Table 6.8.1-3 Water-Chilling Packages—Minimum Efficiency Requirements.

2024 IECC Baseline Efficiency Values by Chiller Type and Capacity (CURRENT)

TABLE C403.3.2(3)—LIQUID-CHILLING PACKAGES—MINIMUM EFFICIENCY REQUIREMENTS[a, b, e]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	PATH A	PATH B	TEST PROCEDURE[c]
Air cooled	< 150 tons	EER (Btu/Wh)	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 13.700 IPLV.IP	≥ 15.800 IPLV.IP	
	≥ 150 tons		≥ 10.100 FL	≥ 9.700FL	
			≥ 14.000 IPLV.IP	≥ 16.100 IPLV.IP	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/Wh)	Air-cooled without condenser must be rated with matching condensers and comply with air-cooled chiller efficiency requirements		AHRI 550/590
Liquid-cooled, electrically operated positive displacement	< 75 tons	kW/ton	≤ 0.750 FL	≤ 0.780 FL	AHRI 550/590
			≤ 0.600 IPLV.IP	≤ 0.500 IPLV.IP	
	≥ 75 tons and < 150 tons		≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.560 IPLV.IP	≤ 0.490 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.660 FL	≤ 0.680 FL	
			≤ 0.540 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 300 tons and < 600 tons		≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.520 IPLV.IP	≤ 0.410 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Liquid-cooled, electrically operated centrifugal	< 150 tons	kW/ton	≤ 0.610 FL	≤ 0.695 FL	AHRI 550/590
			≤ 0.550 IPLV.IP	≤ 0.440 IPLV.IP	
	≥150 tons and <300 tons		≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.550 IPLV.IP	≤ 0.400 IPLV.IP	
	≥ 300 tons and < 400 tons		≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.520 IPLV.IP	≤ 0.390 IPLV.IP	
	≥ 400 tons and < 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Air cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.600 FL	NA[d]	AHRI 560
Liquid-cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.700 FL	NA[d]	AHRI 560
Absorption double effect, indirect fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 0.150 IPLV.IP		
Absorption double effect, direct fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 1.000 IPLV		

MEASURE CODE: CI-HVC-CHIL-V11-270101

REVIEW DEADLINE: 1/1/2028

4.4.7 Room Air Conditioner

DESCRIPTION

This measure relates to the purchase and installation of an efficient room air conditioning unit that exceeds a baseline unit meeting minimum Federal Standard efficiency ratings presented below:[670]

Product Type and Class (Btu/hr)		Federal Standard with louvered sides (CEER) [671]	Federal Standard without louvered sides (CEER)
Without Reverse Cycle	< 6,000	13.1	12.8
	6,000 - 7,999	13.7	
	8,000 to 10,999	16.0	14.1
	11,000 to 13,999		13.9
	14,000 to 19,999		13.7
	20,000 to 27,999	13.8	13.8
	>=28,000	13.2	
With Reverse Cycle	<14,000	14.4	13.7
	14,000 to 19,999		12.8
	>=20,000	13.7	
Casement only		13.9	
Casement-Slider		15.3	

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the new room air conditioning unit must meet be an efficient unit that exceeds the federal standards presented above.

DEFINITION OF BASELINE EQUIPMENT

The baseline assumption is a new room air conditioning unit that meets the current minimum federal efficiency standards presented above.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 12 years. [672]

DEEMED MEASURE COST

The incremental cost for this measure is assumed to be $40 for an efficient unit.[673]

LOADSHAPE

Loadshape C03 - Commercial Cooling

[670] Federal Baselines defined by Code of Federal Regulations §430.32(d), effective May 26, 2026. See DOE rulemaking docket (EERE-2014-BT-STD-0059) for more information.
Side louvers that extend from a room air conditioner model in order to position the unit in a window. A model without louvered sides is placed in a built-in wall sleeve and are commonly referred to as "through-the-wall" or "built-in" models.
Casement-only refers to a room air conditioner designed for mounting in a casement window of a specific size.
Casement-slider refers to a room air conditioner with an encased assembly designed for mounting in a sliding or casement window of a specific size. Reverse cycle refers to the heating function found in certain room air conditioner models.
[671] See DOE's Appliance and Equipment Standards for Room AC;
[672] Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.
[673] ENERGY STAR cost based on field study conducted by Efficiency Vermont. See 'room-ac-cost-analysis-10.2023.xlsx.'

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [674]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [675]

Algorithm

CALCULATION OF SAVINGS

ENERGY SAVINGS

$$\Delta kWh = (FLH_{RoomAC} * Btu/h * (1/CEER_{base} - 1/CEER_{ee}))/1000$$

Where:

FLH_{RoomAC} = Full Load Hours of room air conditioning unit

= Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

Btu/h = Input capacity of unit

= Actual. If unknown assume 8,500 Btu/hr [676]

$CEER_{base}$ = Combined Energy Efficiency Ratio of baseline unit

= As provided in tables above

$CEER_{ee}$ = Combined Energy Efficiency Ratio of efficient unit

= Actual.

For example, for an 8,500 Btu/h capacity unit (17.6 $CEER_{ee}$), with louvered sides, in an unknown location in Rockford:

$\Delta kWH_{ENERGY\ STAR}$ = (1003 * 8500 * (1/16.0 – 1/17.6)) / 1000

= 48.4 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = Btu/h * ((1/CEER_{base} - 1/CEER_{ee}))/1000) * CF$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

[674] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[675] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

[676] Based on maximum capacity average from the RLW Report: Final Report Coincidence Factor Study Residential Room Air Conditioners, June 23, 2008.

= 91.3% [677]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[678]

Other variable as defined above

For example, for an 8,500 Btu/h capacity ENERGY STAR unit (17.6 CEERee), with louvered sides, in Rockford during system peak:

$\Delta kW_{ENERGY\ STAR}$ = ((8500 * (1/16.0 – 1/17.6)) / 1000) * 0.913

= 0.0441 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-ESRA-V06-270101

REVIEW DEADLINE: 1/1/2028

[677] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[678] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

4.4.8 Guest Room Energy Management (PTAC & PTHP)

DESCRIPTION

This measure applies to the installation of a temperature setback and lighting control system for individual guest rooms. The savings are achieved based on Guest Room Energy Management's (GREM's) ability to automatically adjust the guest room's set temperatures and control the HVAC unit for various occupancy modes.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Guest room temperature set point must be controlled by automatic occupancy detectors or keycard that indicates the occupancy status of the room. During unoccupied periods the default setting for controlled units differs by at least 5 degrees from the operating set point. Theoretically, the control system may also be tied into other electric loads, such as lighting and plug loads to shut them off when occupancy is not sensed. This measure bases savings on improved HVAC controls. If the system is connected to lighting and plug loads, additional savings would be realized. The incentive is per guestroom controlled, rather than per sensor, for multi-room suites. Replacement or upgrades of existing occupancy-based controls are not eligible for an incentive.

DEFINITION OF BASELINE EQUIPMENT

Guest room energy management thermostats replace manual heating/cooling temperature set-point and fan On/Off/Auto thermostat controls. Two possible baselines exist based on whether housekeeping staff are directed to set-back (or turn off) thermostats when rooms are not rented.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for GREM is 15 years.[679]

DEEMED MEASURE COST

$260/unit.

The incremental cost documented for this measure is $260 per room HVAC controller, which is the cost difference between a non-programmable thermostat and a GREM.[680]

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

A coincidence factor is not used in the determination of coincident peak kW savings.

Algorithm

CALCULATION OF SAVINGS

Below are the annual kWh savings per installed EMS for different sizes and types of HVAC units. The savings are achieved based on GREM's ability to automatically adjust the guest room's set temperatures and control the HVAC unit to maintain set temperatures for various occupancy modes. Note that care should be taken in selecting a value consistent with actual baseline conditions (e.g., whether housekeeping staff are directed to set-back/turn-off the

[679] DEER 2008 value for energy management systems.
[680] This value was extracted from Smart Ideas projects in PY1 and PY2.

thermostats when rooms are unrented). Different values are provided for Motels and Hotels since significant differences in shell performance, number of external walls per room and typical heating and cooling efficiencies result in significantly different savings estimates. Energy savings estimates are derived using a prototypical EnergyPlus simulation of a motel and a hotel.[681] Model outputs are normalized to the installed capacity and reported here as kWh/Ton, coincident peak kW/Ton and Therms/Ton.

ELECTRIC ENERGY SAVINGS

Climate Zone (City based upon)	Heating Source	Baseline	Electric Savings (kWh/Ton)
Motel Electric Energy Savings			
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	744
		No Housekeeping Setback	1,786
	PTAC w/ Gas Heating	Housekeeping Setback	63
		No Housekeeping Setback	155
	PTHP	Housekeeping Setback	385
		No Housekeeping Setback	986
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	506
		No Housekeeping Setback	1,582
	PTAC w/ Gas Heating	Housekeeping Setback	51
		No Housekeeping Setback	163
	PTHP	Housekeeping Setback	211
		No Housekeeping Setback	798
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	462
		No Housekeeping Setback	1,382
	PTAC w/ Gas Heating	Housekeeping Setback	65
		No Housekeeping Setback	198
	PTHP	Housekeeping Setback	202
		No Housekeeping Setback	736
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	559
		No Housekeeping Setback	1,877
	PTAC w/ Gas Heating	Housekeeping Setback	85
		No Housekeeping Setback	287
	PTHP	Housekeeping Setback	260
		No Housekeeping Setback	1,023
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	388
		No Housekeeping Setback	1,339
	PTAC w/ Gas Heating	Housekeeping Setback	81
		No Housekeeping Setback	274
	PTHP	Housekeeping Setback	174
		No Housekeeping Setback	682
Hotel Electric Energy Savings			
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	204
		No Housekeeping Setback	345
	PTAC w/ Gas Heating	Housekeeping Setback	121
		No Housekeeping Setback	197

[681] For motels, see S. Keates, ADM Associates Workpaper: "Suggested Revisions to Guest Room Energy Management (PTAC & PTHP)", 11/14/2013 and spreadsheet summarizing the results: 'GREM Savings Summary_IL TRM_1_22_14.xlsx'. In 2014 the hotel models were also run to compile results, rather than by applying adjustment factors to the motel results as had been done in V3.0 of the TRM. The updated values can be found in 'GREM Savings Summary (Hotel)_IL TRM_10_16_14.xls'.

Climate Zone (City based upon)	Heating Source	Baseline	Electric Savings (kWh/Ton)
	PTHP	Housekeeping Setback	152
		No Housekeeping Setback	253
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	177
		No Housekeeping Setback	296
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	94
		No Housekeeping Setback	148
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	188
		No Housekeeping Setback	342
	PTAC w/ Gas Heating	Housekeeping Setback	119
		No Housekeeping Setback	195
	PTHP	Housekeeping Setback	145
		No Housekeeping Setback	250
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	161
		No Housekeeping Setback	294
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	92
		No Housekeeping Setback	147
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	182
		No Housekeeping Setback	291
	PTAC w/ Gas Heating	Housekeeping Setback	123
		No Housekeeping Setback	197
	PTHP	Housekeeping Setback	145
		No Housekeeping Setback	233
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	153
		No Housekeeping Setback	240
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	94
		No Housekeeping Setback	146
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	182
		No Housekeeping Setback	308
	PTAC w/ Gas Heating	Housekeeping Setback	125
		No Housekeeping Setback	199
	PTHP	Housekeeping Setback	146
		No Housekeeping Setback	240
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	152
		No Housekeeping Setback	255
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	95
		No Housekeeping Setback	147
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	171
		No Housekeeping Setback	295
	PTAC w/ Gas Heating	Housekeeping Setback	122
		No Housekeeping Setback	199
	PTHP	Housekeeping Setback	140
		No Housekeeping Setback	235
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	141
		No Housekeeping Setback	243
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	92
		No Housekeeping Setback	146

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Motel Coincident Peak Demand Savings			
Climate Zone (City based upon)	**Heating Source**	**Baseline**	**Coincident Peak Demand Savings (kW/Ton)**
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.17
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.17
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.17
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.06
		No Housekeeping Setback	0.17
	PTAC w/ Gas Heating	Housekeeping Setback	0.06
		No Housekeeping Setback	0.17
	PTHP	Housekeeping Setback	0.06
		No Housekeeping Setback	0.17
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.17
	PTAC w/ Gas Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.17
	PTHP	Housekeeping Setback	0.07
		No Housekeeping Setback	0.17
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.10
		No Housekeeping Setback	0.28
	PTAC w/ Gas Heating	Housekeeping Setback	0.10
		No Housekeeping Setback	0.28
	PTHP	Housekeeping Setback	0.10
		No Housekeeping Setback	0.28
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.21
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.21
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.21

Hotel Coincident Peak Demand Savings			
Climate Zone (City based upon)	**Heating Source**	**Baseline**	**Coincident Peak Demand Savings (kW/Ton)**
1 (Rockford)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08

Hotel Coincident Peak Demand Savings			
Climate Zone (City based upon)	**Heating Source**	**Baseline**	**Coincident Peak Demand Savings (kW/Ton)**
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
2 (Chicago)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.07
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.07
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.07
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.07
3 (Springfield)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.07
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.07
4 (Belleville)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
5 (Marion-Williamson)	PTAC w/ Electric Resistance Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTAC w/ Gas Heating	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	PTHP	Housekeeping Setback	0.08
		No Housekeeping Setback	0.11
	Central Hot Water Fan Coil w/ Electric Resistance Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	0.05
		No Housekeeping Setback	0.08

FOSSIL FUEL SAVINGS

For PTACs with gas heating:

Motel Natural Gas Energy Savings

Climate Zone (City based upon)	Baseline	Gas Savings (Therms/Ton)
1 (Rockford)	Housekeeping Setback	30
	No Housekeeping Setback	71
2 (Chicago)	Housekeeping Setback	20
	No Housekeeping Setback	62
3 (Springfield)	Housekeeping Setback	17
	No Housekeeping Setback	52
4 (Belleville)	Housekeeping Setback	21
	No Housekeeping Setback	70
5 (Marion-Williamson)	Housekeeping Setback	13
	No Housekeeping Setback	47

Hotel Natural Gas Energy Savings			
Climate Zone (City based upon)	**Heating Source**	**Baseline**	**Gas Savings (Therms/Ton)**
1 (Rockford)	PTAC w/ Gas Heating	Housekeeping Setback	3.6
		No Housekeeping Setback	6.4
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	3.6
		No Housekeeping Setback	6.4
2 (Chicago)	PTAC w/ Gas Heating	Housekeeping Setback	3.0
		No Housekeeping Setback	6.5
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	3.0
		No Housekeeping Setback	6.5
3 (Springfield)	PTAC w/ Gas Heating	Housekeeping Setback	2.6
		No Housekeeping Setback	4.1
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	2.6
		No Housekeeping Setback	4.1
4 (Belleville)	PTAC w/ Gas Heating	Housekeeping Setback	2.5
		No Housekeeping Setback	4.8
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	2.5
		No Housekeeping Setback	4.8
5 (Marion-Williamson)	PTAC w/ Gas Heating	Housekeeping Setback	2.1
		No Housekeeping Setback	4.2
	Central Hot Water Fan Coil w/ Gas Heating	Housekeeping Setback	2.1
		No Housekeeping Setback	4.2

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-GREM-V07-260101

REVIEW DEADLINE: 1/1/2028

4.4.9 Air and Water Source Heat Pump Systems (Centrally Ducted and Ductless)

DESCRIPTION

This measure applies to the installation of high-efficiency air cooled and water source heat pump systems with conditioned air delivered to the building via ductwork, ductless systems and "hybrid" systems that work in conjunction with fuel-fired heating systems. This measure could apply to replacing an existing unit at the end of its useful life, or installation of a new unit in a new or existing building.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a high-efficiency air cooled or water source, heat pump system that exceeds the baseline and meets program requirements.

DEFINITION OF BASELINE EQUIPMENT

New construction / Time of Sale: To calculate savings with an electric baseline, the baseline equipment is assumed to be a standard-efficiency air cooled or water source heat pump system that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date unknown assume current Code minimum). The rating conditions for the baseline and efficient equipment efficiencies must be equivalent.

To calculate savings with a furnace/ AC baseline, the baseline equipment is assumed to meet the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher).

Where unknown, the baseline should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition.

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. If evaluation determines the applicable version of code, given location and timing, isn't an appropriate baseline due to supply constraints, low compliance, or other issues, the previous iteration of code may be used through 2023.

IECC 2021 and 2024 leverages new DOE testing methods and associated metrics. The following conversion factors are recommended for use if the efficient equipment is not rated under the new testing procedure but the stipulated baseline is:[682]

SEER2 = X * SEER

EER2 = X * EER

HSPF2 = X * HSPF

Where:

X	SEER2	EER2	HSPF2
Ducted	0.95	0.95	0.85
Ductless	1.00	1.00	0.90
Packaged	0.95	0.95	0.84

[682] Consortium for Energy Efficiency (CEE), Testing, Testing, M1, 2, 3, Transitioning to New Federal Minimum Standards, CEE Summer Program Meeting, August, 2022.

Note: new Federal Standards affecting heat pumps and air conditioning equipment became effective January 1, 2023.

Early replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating and cooling equipment for the assumed remaining useful life of the existing unit and a new baseline heating and cooling system meeting the code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) for the remainder of the measure life.

A weighted average early replacement rate is provided for use in programs when the actual baseline early replacement rates are unknown.

Deemed Early Replacement Rates For ASHP[683]

Equipment Type	Full System Displacement	Partial System Displacement
Cooling	30%	30%
Heating	30%	100%

Note to apply these deemed early replacement rates, an assumption of the percentage of replacements that are full displacement v partial displacement is required. This should be determined through evaluation, or a deemed ratio of 100% Full Displacement for ducted ASHPs and 50% Full: 50% Partial for Ductless ASHPs can be used. Savings should be calculated following both the full and partial displacement methodology and then this ratio should be used to weight the savings accordingly.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years.[684]

Remaining life of existing equipment is assumed to be 6 years for ASHP and Central AC, 6 years for furnace, 8 years for boilers[685] and 16 years for electric resistance.[686]

DEEMED MEASURE COST

Ducted Air Source Heat Pumps:

New Construction and Time of Sale: For analysis purposes, the incremental capital cost for this measure is assumed as $100 per ton for commercially sized air-cooled units.[687] The incremental cost for all other equipment types should be determined on a site-specific basis.

[683] Consistent with Residential assumptions – should be updated with Commercial data when available. Program tracking data from ComEd and Ameren between 2018 and 2020 was used to develop these assumptions. During this period the air source heat pump programs operated downstream and projects were classified as Time of Sale or Early Replacement. Note that any fuel switch scenario at the time would have been classified as Time of Sale and therefore the rates provided likely represent a low estimate of the true early replacement rates. In the absence of alternative data, the TAC agreed to apply these rates and the deemed full v partial displacement assumptions listed, but these assumptions should be revisited through future evaluation.

[684] Consistent with Residential measure and based on 2016 DOE Rulemaking Technical Support document, as recommended in Guidehouse 'ComEd Effective Useful Life Research Report', May 2018.

[685] Assumed to be one third of effective useful life of replaced equipment.

[686] Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.

[687] Based on a review of TRM incremental cost assumptions from Vermont, Wisconsin, and California.

For residential sized ASHP, defaults provided below:[688]

Capacity Range	Incremental Cost per Ton[689]
< 2 tons	$88
≥ 2 to < 3 tons	$70
≥ 3 to < 4 tons	$59
≥ 4 tons	$57

Early Replacement: The actual full installation cost of the Heat Pump (including any necessary electrical or distribution upgrades required) should be used. The assumed deferred cost of replacing existing equipment with a new baseline unit should also be incorporated.

Ductless Minisplit Heat Pumps:

New Construction and Time of Sale: The actual installed cost of the DMSHP (including any necessary electrical or distribution upgrades required) should be used (defaults are provided below), minus the assumed installation cost of the baseline equipment, or assume $4,019 for a new baseline 80% AFUE furnace, or $8,820 for a new 84% AFUE boiler.[690]

The assumed baseline cost for electric equipment is provided below.[691]

Baseline Equipment Type	Capacity Range	Baseline Cost ($/Ton)
Centrally Ducted Air Source Heat Pumps	< 2 tons	$4,602
	≥ 2 to < 3 tons	$3,691
	≥ 3 to < 4 tons	$3,093
	≥ 4 tons	$2,992
Ductless Minisplit Heat Pumps	< 1 ton	$8,156
	≥ 1 to < 2 tons	$5,356
	≥ 2 to < 3 tons	$3,704
	≥ 3 tons	$3,670
Central Air Conditioning	< 2 tons	$2,340
	≥ 2 to < 3 tons	$1,900
	≥ 3 tons	$1,500

Default full cost of the DMSHP is provided below.:[692]

Unit Size	Full Install Cost ($/ton)[693]
< 1 ton	$8,312 + ($600* (HSPF2-7.8))

[688] In 2025, a working group was created to update costs for residential HVAC equipment. Heat Pump and Central Air Conditioning costs are based upon Ameren program data. Furnace and Boiler costs are based on Ameren, Nicor, People's Gas, and North Shore Gas program data. Baseline costs have been determined using ratios from Updated Buildings Sector Appliance and Equipment Costs and Efficiencies by Guidehouse and Leidos, prepared for the U.S. Energy Information Administration. See file "HVAC Costs – 071825_VEIC.xlsx" for more details.

[689] Ibid

[690] In 2025, a working group was created to update costs for residential HVAC equipment. Heat Pump and Central Air Conditioning costs are based upon Ameren program data. Furnace and Boiler costs are based on Ameren, Nicor, People's Gas, and North Shore Gas program data. Baseline costs have been determined using ratios from Updated Buildings Sector Appliance and Equipment Costs and Efficiencies by Guidehouse and Leidos, prepared for the U.S. Energy Information Administration. See file "HVAC Costs – 071825_VEIC.xlsx" for more details.

[691] Ibid

[692] Ibid

[693] Ibid

Unit Size	Full Install Cost ($/ton)[693]
≥ 1 to < 2 tons	$5,458 + ($600* (HSPF2-7.8))
≥ 2 to < 3 tons	$3,775 + ($600* (HSPF2-7.8))
≥ 3 tons	$3,740 + ($600* (HSPF2-7.8))

The incremental cost of the DSMHP compared to a baseline minimum efficiency DSMHP is provided in the table below:[694]

Unit Size	Incremental Cost ($/ton)
< 1 ton	$156
≥ 1 to < 2 tons	$102
≥ 2 to < 3 tons	$71
≥ 3 tons	$70

Early Replacement/retrofit (replacing existing equipment): The actual full installation cost of the DMSHP (including any necessary electrical or distribution upgrades required) should be used. The assumed deferred cost (after the appropriate number of years described above in the 'Deemed Lifetime of Efficient Equipment' section) of replacing existing equipment with a new baseline unit is provided in table below for electric equipment, or is assumed to be $4,601 for a new baseline 80% AFUE furnace or $10,563 for a new 84% AFUE boiler.[695] If replacing electric resistance heat, there is no deferred replacement cost. This future cost should be discounted to present value using the nominal societal discount rate.

Equipment Type	Capacity Range	Deferred Baseline Cost per Ton
Centrally Ducted Air Source Heat Pumps	< 2 tons	$5,268
	≥ 2 to < 3 tons	$4,226
	≥ 3 to < 4 tons	$3,541
	≥ 4 tons	$3,425
Ductless Minisplit Heat Pumps	< 1 ton	$9,337
	≥ 1 to < 2 tons	$6,132
	≥ 2 to < 3 tons	$4,240
	≥ 3 tons	$4,202
Central Air Conditioning	< 2 tons	$2,679
	≥ 2 to < 3 tons	$2,175
	≥ 3 tons	$1,717

Where the DMSHP is a supplemental HVAC system, the full installation cost of the DMSHP (including any necessary electrical or distribution upgrades required) should be used without a deferred replacement cost.

If the install cost is unknown a default is provided above. Fuel switch scenarios are likely to require additional installation work which may include adding new electrical circuits, capping existing gas lines and upgrading electrical panels. These costs are likely to range significantly and actual values should be used wherever possible. If unknown, assume an additional $300 for fuel switch installations.

LOADSHAPE

Loadshape C05 - Commercial Electric Heating and Cooling

[694] Ibid

[695] All baseline replacement costs are consistent with their respective measures and include inflation rate of 2.28%.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [696]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [697]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC AND FOSSIL FUEL ENERGY SAVINGS

Non fuel switch measures:

$$\Delta kWh_{Non\ Fuel\ Switch} = ASHPSiteCoolingImpact + ASHPSiteHeatingImpact$$

Where:

For units with cooling capacities less than 65 kBtu/hr (ASHP only):

ASHPSiteCoolingImpact = $((CoolingLoad/DuctlessSave * (1/(SEER2_base))) - (CoolingLoad * 1/(SEER2_ee\ )))/1{,}000$

ASHPSiteHeatingImpact = $((HeatLoad_Disp/DuctlessSave * (1/(HSPF2_base * HSPF2_ClimateAdj))) - (HeatLoad_Disp * 1/(HSPF2_e * HSPF2_ClimateAdj))) / 1{,}000$

For ASHP units with cooling capacities equal to or greater than 65 kBtu/hr and all WSHPs:

$$\Delta kWh_{Non\ Fuel\ Switch} = ASHPSiteCoolingImpact + ASHPSiteHeatingImpact$$

Where:

ASHPSiteCoolingImpact = $((CoolingLoad * (1/(IEER_base))) - (CoolingLoad * 1/(IEER_ee\ )))/1{,}000$

ASHPSiteHeatingImpact = $(HeatLoad_Disp\ / 3{,}412 * (1/COP_base - 1/COP_ee))$

Fuel switch measures:

Fuel switch measures must produce positive total lifecycle energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be

[696] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[697] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

SiteEnergySavings (MMBTUs) = $FuelSwitchSavings + NonFuelSwitchSavings$

FuelSwitchSavings = $GasHeatReplaced - HPSiteHeatConsumed$

NonFuelSwitchSavings = $FurnaceFanSavings + HPSiteCoolingImpact$

For units with cooling capacities less than 65 kBtu/hr (ASHP only):

ASHPSiteHeatConsumed =$((HeatLoad_Disp * (1/(HSPF2_ee * HSPF2_ClimateAdj * PD_Adj))) / 1{,}000 * 3{,}412) / 1{,}000{,}000$

ASHPSiteCoolingImpact = $(((CoolingLoa/DuctlessSave * (1/(SEER2_base)) - ((ColingLoad * 1/(SEER2_ee)))/1{,}000 * 3412) / 1{,}000{,}000$

FurnaceFanSavings =$(FurnaceFlg * HeatLoad_Disp/DuctlessSave * 1/FUE_{base} * Fe) / 1{,}000{,}000$

GasHeatReplaced = $(HeatLoad_Disp/DuctlessSave * 1/AFUE_{base}) / 1{,}000{,}000$

For ASHP units with cooling capacities greater than 65 kBtu/hr and all WSHPs:

ASHPSiteHeatConsumed =$(HeatLoad_Disp * (1/(COP_ee * PD_Adj)) / 1{,}000{,}000$

ASHPSiteCoolingImpact = $(((CoolingLoad * (1/(IEER_base)) - ((CoolingLoad * 1/(IEER_ee)))/1{,}000 * 3{,}412) / 1{,}000{,}000$

FurnaceFanSavings = $(FurnaceFlag * HeatLoad_Disp * 1/AFUE_{base} * F_e) / 1{,}000{,}000$

GasHeatReplaced = $(HeatLoad_Disp * 1/AFUE_{base}) / 1{,}000{,}000$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure supported by:	Electric Utility claims (kWh):	Gas Utility claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 6 years for furnace, 8 years for boilers, 15

years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Programs where existing system unknown

In programs where the existing fuel or system type is unknown, savings should be apportioned between the Fuel Switch and Non- Fuel Switch scenarios, as follows:

Savings from Non-Fuel Switch (kWh) $=(1 - \%FuelSwitch) * \Delta kWh_{Non\ Fuel\ Switch}$

Plus

Savings from Fuel Switch (MMBtu converted to appropriate fuel as table above)

$= \%FuelSwitch * SiteEnergySavings\ (MMBTUs)$

Where:

%FuelSwitch = The percentage of replacements resulting in fuel-switching.

= 1 when fuel switching is known, 0 if non fuel switch

= when unknown, e.g. midstream program, determine via evaluation

CoolingLoad = Annual cooling load for the building

= $EFLH_{cool}$ * $Capacity_{cool}$

$Capacity_{cool}$ = Output capacity of the cooling equipment in Btu per hour (1 ton of cooling capacity equals 12,000 Btu/hr).

= Actual installed

$SEER2_{base}$ = Seasonal Energy Efficiency Ratio of the baseline equipment

= SEER from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).

$SEER2_{ee}$ = Seasonal Energy Efficiency Ratio of the energy efficient equipment.

= Actual installed

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

DuctlessSave = Factor used to adjust ducted heating or cooling load displaced by ductless systems that are not subject to losses from existing ductwork.

= 1-0.15 = 0.85 for ducted system displaced by ductless system

= 1.00 for ducted system displaced by ducted system or ductless system displaced by ductless system

$HSPF2_{base}$ = Heating Seasonal Performance Factor of the baseline equipment

= HSPF from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume a blended baseline value of 4.0 HSPF2[698]).

$HSPF2_{ee}$ = Heating Seasonal Performance Factor of the energy efficient equipment.

= Actual installed. If rating is COP, HSPF = COP * 3.413

[698] Blended Baseline value came from percentage of accounts with heat pumps (15%) at 7.5 HSPF2 and electric furnaces (85%) at 3.412 HSPF, based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

HSPF_ClimateAdj = Adjustment factor to account for observed discrepency between seasonal heating performance relative to rated HSPF as provided by standard AHRI 210/240 rating conditions. Note, the adjustment is dependent on the test method use for the rating (i.e. HSPF or HSPF2 rating) [699]:

City (county based upon)	HSPF_ClimateAdj When using HSPF2 rating
1 (Rockford)	77%
2 (Chicago)	77%
3 (Springfield)	91%
4 (Belleville)	91%
5 (Marion)	91%
Weighted Average[700]	
ComEd	77%
Ameren	89%
Statewide	80%

$IEER_{base}$ = Integrated Energy Efficiency Ratio of the baseline equipment

= IEER (or EER2) from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code). For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER2 to EER2 for calculation of peak savings:[701]

$$EER2 = (-0.02 * SEER2^2) + (1.12 * SEER2)$$

$IEER_{ee}$ = Integrated Energy Efficiency Ratio (or EER2) of the energy efficient equipment. For air-cooled units < 65 kBtu/hr, if the actual $EER2_{ee}$ is unknown, assume the conversion from SEER2 to EER2 as provided above.

= Actual installed

HeatLoad_Disp = Annual heat load for the building displaced by the ASHP (Btus)

$= EFLH_{heat} * Capacity_{heat} * HeatLoadFactor$

$EFLH_{heat}$ = heating mode equivalent full load hours in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

$Capacity_{heat}$ = output capacity of the heat pump equipment in Btu per hour.

= Actual installed

HeatLoadFactor = Portion of HeatLoad displaced by ASHP in partial displacement applications. Varies by Switchover Temperature and Climate Region. If Switchover Temperature is unknown, use 32°F.

[699] Adjustment factors are based on findings from NEEA, July 2020 'EXP07:19 Load-based and Climate-Specific Testing and Rating Procedures for Heat Pumps and Air Conditioners'. See 'NEEA HP data' for calculation. Findings were consistent with other reviewed sources including ASHRAE, 2020 'Right-Sizing Electric Heat Pump and Auxiliary Heating for Residential Heating Systems Based on Actual Performance Associated with Climate Zone' and Cadmus, 2022 'Residential ccASHP Building Electrification Study'. The difference between HSPF and HSPF2 ratings is based on the change in testing procedure that will correct for some of this effect where ducted systems will have an approximately 9% lower HSPF2 rating as compared to HSPF, based on CEE presentation, July 2022, 'Testing Testing, M1, 2, 3: Transitioning to New Federal Minimum Standards'.

[700] Weighting for Ameren is based on electric heat accounts in each of the heating zones. Weighting for ComEd and Statewide average is based on number of occupied residential housing units in each zone. ComEd is weighted average of Zones 1-2. Alternative program-weighted assumptions can be used if appropriate.

[701] Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

= 1.0 if full displacement (e.g. cold climate heat pumps and water source heat pumps) or if switchover temperature is lower than 17°F or if Partial Displacement with simultaneous operation

Climate Zone (City based upon)	HeatLoadFactor (by Switchover Temperature)[702]										
	47°F	44°F	41°F	38°F	35°F	32°F	29°F	26°F	23°F	20°F	17°F
1 (Rockford)	4%	8%	12%	16%	26%	36%	45%	58%	66%	71%	78%
2 (Chicago)	4%	9%	15%	21%	32%	43%	52%	66%	74%	77%	84%
3 (Springfield)	4%	9%	15%	21%	37%	52%	59%	69%	76%	79%	85%
4 (Belleville)	7%	14%	22%	30%	41%	55%	66%	77%	85%	90%	93%
5 (Marion)	7%	16%	25%	34%	53%	67%	76%	86%	90%	93%	97%
Weighted Average[703]											
ComEd	4%	9%	15%	20%	31%	43%	51%	66%	73%	77%	84%
Ameren	5%	11%	17%	24%	38%	52%	60%	71%	79%	82%	88%
Statewide	4%	9%	16%	21%	33%	45%	54%	67%	75%	79%	85%

PD_Adj = Adjustment multiplier to account for increased heat pump efficiency in Partial Displacement applications when there is no electric resistance backup and switchover temperature is higher than 17F. Varies by Switchover Temperature and Climate Region. If Switchover Temperature is unknown, use 32F.

= 1.0 if full displacement (e.g. cold climate heat pumps or water source heat pumps) or if switchover temperature is lower than 17F or if Partial Displacement with simultaneous operation

Climate Zone (City based upon)	PD_Adj (by Switchover Temperature) [704]										
	47°F	44°F	41°F	38°F	35°F	32°F	29°F	26°F	23°F	20°F	17°F
1 (Rockford)	153%	149%	146%	143%	138%	134%	132%	128%	126%	124%	122%
2 (Chicago)	153%	148%	145%	142%	138%	134%	132%	128%	126%	125%	123%
3 (Springfield)	153%	148%	145%	142%	137%	133%	132%	129%	128%	127%	125%
4 (Belleville)	152%	149%	145%	143%	139%	135%	133%	131%	128%	127%	126%
5 (Marion)	153%	148%	145%	142%	138%	135%	134%	131%	130%	129%	128%
Weighted Average[705]	153%	148%	145%	142%	138%	134%	132%	128%	126%	125%	123%
ComEd	153%	148%	145%	142%	138%	134%	132%	130%	128%	127%	125%
Ameren	153%	148%	145%	142%	138%	134%	132%	129%	127%	126%	124%

[702] Values based on Morehead Energy 2024 analysis of TMYx typical hourly weather data for 2007-2021. See 'ASHP Partial Displacement Analysis 20240611_HDD55.xlsx'.

[703] Weighting for Ameren is based on electric heat accounts in each of the heating zones. Weighting for ComEd and Statewide average is based on number of occupied residential housing units in each zone. ComEd is weighted average of Zones 1-2. Alternative program-weighted assumptions can be used if appropriate.

[704] Values based on Morehead Energy 2024 analysis of TMYx typical hourly weather data for 2007-2021. See 'ASHP Partial Displacement Analysis 20240611_HDD55.xlsx'.

[705] Weighting for Ameren is based on electric heat accounts in each of the heating zones. Weighting for ComEd and Statewide average is based on number of occupied residential housing units in each zone. ComEd is weighted average of Zones 1-2. Alternative program-weighted assumptions can be used if appropriate.

Climate Zone (City based upon)	PD_Adj (by Switchover Temperature) [704]										
	47°F	44°F	41°F	38°F	35°F	32°F	29°F	26°F	23°F	20°F	17°F
Statewide											

3412 = Btu per kWh.

COP_{base} = coefficient of performance of the baseline equipment

= COP from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code). If rating is HSPF2, COP = HSPF2 / 3.413

COP_{ee} = coefficient of performance of the energy efficient equipment.

= Actual installed. If rating is HSPF2, COP = HSPF2 / 3.413

$AFUE_{base}$ = Baseline Annual Fuel Utilization Efficiency Rating. For early replacement measures, use actual AFUE rating for the remaining useful life of the existing equipment (6 years for furnace, 8 years for boilers). For new systems (time of sale, new construction or remaining years of early replacement), use appropriate code level efficiency.

FurnaceFlag = 1 if system replaced is a gas furnace, 0 if not.

F_e = Furnace Fan energy consumption as a percentage of annual fuel consumption

= 7.7%[706]

%IncentiveElectric = % of total incentive paid by electric utility

= Actual

%IncentiveGas = % of total incentive paid by gas utility

= Actual

Code of Federal Regulations (baseline effective 1/1/2019):[707]

Equipment type	Cooling capacity	Heating type	Cooling Efficiency level	Heating Efficiency level	Compliance date
Small Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥65,000 Btu/h and <135,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 12.2 IEER = 14.1	N/A	1/1/2018 1/1/2024
		All Other Types of Heating	IEER = 12.0 IEER = 13.9	COP = 3.3 COP = 3.4	1/1/2018 1/1/2024
		Electric Resistance Heating or No Heating	IEER = 11.6 IEER = 13.5	N/A	1/1/2018 1/1/2024

[706] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[707] Code of Federal Regulations: Table 3 to §431.97—Updates to the Minimum Cooling Efficiency Standards for Air Conditioning and Heating Equipment and Table 4 to §431.97—Updates to the Minimum Heating Efficiency Standards for Air-Cooled Air Conditioning and Heating Equipment [Heat Pumps]. For 1/1/2024 compliance dates, note these manufacturing and import federal standards go into effect on 1/1/2023. The measure characterization is recommending delaying adopting these standards until 1/1/2024.

Equipment type	Cooling capacity	Heating type	Cooling Efficiency level	Heating Efficiency level	Compliance date
Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥135,000 Btu/h and <240,000 Btu/h	All Other Types of Heating	IEER = 11.4 IEER = 13.3	COP = 3.2 COP = 3.3	1/1/2018 1/1/2024
Very Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥240,000 Btu/h and <760,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 10.6 IEER = 12.5	N/A	1/1/2018 1/1/2024
		All Other Types of Heating	IEER = 10.4 IEER = 12.3	COP = 3.2	1/1/2018 1/1/2024
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, Single-Phase, Split-System)	<65,000 Btu/h	All	SEER2 = 14.3 EER2 = 9.4	HSPF2 = 7.5	1/1/2023
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, Single-Phase, Single-Package)	<65,000Btu/h	All	SEER2 = 13.4 EER2 = 8.8	HSPF2 = 6.7	1/1/2023
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Split-System)	<65,000 Btu/h	All	SEER2 = 14.3 EER2 = 9.4	HSPF2 = 7.5	1/1/2025
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Single-Package)	<65,000Btu/h	All	SEER2 = 13.4 EER2 = 8.8	HSPF2 = 6.7	1/1/2025
Small Commercial Packaged Air-Conditioning and Heating Equipment (Water Source: Water-to-Air, Water-Loop)	<17,000 Btu/h	All	EER = 12.2	COP = 4.3	10/9/2015
	≥17,000 Btu/h and <65,000 Btu/h	All	EER = 13.0	COP = 4.3	10/9/2015
	≥65,000 Btu/h and <135,000Btu/h	All	EER = 13.0	COP = 4.3	10/9/2015

Minimum Efficiency Requirements: 2015 IECC (baseline effective 1/1/2016 to 6/30/2019)

TABLE C403.2.3(2)
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE[a]
				Before 1/1/2016	As of 1/1/2016	
Air cooled (cooling mode)	< 65,000 Btu/h[b]	All	Split System	13.0 SEER[c]	14.0 SEER[c]	AHRI 210/240
			Single Package	13.0 SEER[c]	14.0 SEER[c]	
Through-the-wall, air cooled	≤ 30,000 Btu/h[b]	All	Split System	12.0 SEER	12.0 SEER	
			Single Package	12.0 SEER	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.0 IEER	AHRI 340/360
		All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 11.8 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 10.7 IEER	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 10.5 IEER	10.4 EER 11.4 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	9.3 EER 9.4 IEER	
Water to Air: Water Loop (cooling mode)	< 17,000 Btu/h	All	86°F entering water	12.2 EER	12.2 EER	ISO 13256-1
	≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	13.0 EER	13.0 EER	
	≥ 65,000 Btu/h and < 135,000 Btu/h	All	86°F entering water	13.0 EER	13.0 EER	
Water to Air: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	18.0 EER	18.0 EER	ISO 13256-1
Brine to Air: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering water	14.1 EER	14.1 EER	ISO 13256-1
Water to Water: WaterLoop (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	10.6 EER	ISO 13256-2
Water to Water: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.3 EER	16.3 EER	
Brine to Water: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER	12.1 EER	

(continued)

TABLE C403.2.3(2)—continued
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE[a]
				Before 1/1/2016	As of 1/1/2016	
Air cooled (heating mode)	< 65,000 Btu/h[b]	—	Split System	7.7 HSPF[c]	8.2 HSPF[c]	AHRI 210/240
		—	Single Package	7.7 HSPF[c]	8.0 HSPF[c]	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h[b] (cooling capacity)	—	Split System	7.4 HSPF	7.4 HSPF	
		—	Single Package	7.4 HSPF	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h[b]	—	Split System	6.8 HSPF	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	3.3 COP	AHRI 340/360
			17°F db/15°F wb outdoor air	2.25 COP	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	3.2 COP	
			17°F db/15°F wb outdoor air	2.05 COP	2.05 COP	
Water to Air: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	4.3 COP	ISO 13256-1
Water to Air: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	3.7 COP	
Brine to Air: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	3.2 COP	
Water to Water: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	3.7 COP	ISO 13256-2
Water to Water: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.1 COP	3.1 COP	
Brine to Water: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.
a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.
c. Minimum efficiency as of January 1, 2015.

Minimum Efficiency Requirements: 2018 IECC (baseline effective 7/1/2019 to 12/31/2023)

TABLE C403.3.2(2)
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 65,000 Btu/h[b]	All	Split System	14.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall, air cooled	≤ 30,000 Btu/h[b]	All	Split System	12.0 SEER	
			Single Package	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.0 IEER	AHRI 340/360
		All other	Split System and Single Package	10.8 EER 11.8 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 11.4 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	
Water to Air: Water Loop (cooling mode)	< 17,000 Btu/h	All	86°F entering water	12.2 EER	ISO 13256-1
	≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	13.0 EER	
	≥ 65,000 Btu/h and < 135,000 Btu/h	All	86°F entering water	13.0 EER	
Water to Air: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	18.0 EER	ISO 13256-1
Brine to Air: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering water	14.1 EER	ISO 13256-1
Water to Water: Water Loop (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	ISO 13256-2
Water to Water: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.3 EER	
Brine to Water: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER	

IECC2018 Table C403.3.2(2) continued from previous page:

Air cooled (heating mode)	< 65,000 Btu/h[b]	—	Split System	8.2 HSPF	AHRI 210/240
		—	Single Package	8.0 HSPF	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h[b] (cooling capacity)	—	Split System	7.4 HSPF	
		—	Single Package	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h[b]	—	Split System	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	AHRI 340/360
			17°Fdb/15°F wb outdoor air	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	
			17°Fdb/15°F wb outdoor air	2.05 COP	
Water to Air: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	ISO 13256-1
Water to Air: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	
Brine to Air: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	
Water to Water: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	ISO 13256-2
Water to Water: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.1 COP	
Brine to Water: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.

b. Single-phase, air-cooled heat pumps less than 65,000 Btu/h are regulated by NAECA. SEER and HSPF values are those set by NAECA.

Minimum Efficiency Requirements: 2021 IECC (effective January 1, 2024 to November 29, 2025)

TABLE C403.3.2(2)
ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 66,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 14.3 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	
Space constrained, air cooled (cooling mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	
Single duct, high velocity, air cooled (cooling mode)	< 65,000	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 12.0 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	11.0 EER 12.2 IEER before 1/1/2023 14.1 IEER after 1/1/2023	AHRI 340/360
		All other		10.8 EER 12.0 IEER before 1/1/2023 13.9 IEER after 1/1/2023	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		10.6 EER 11.6 IEER before 1/1/2023 13.5 IEER after 1/1/2023	
		All other		10.4 EER 11.4 IEER before 1/1/2023 13.3 IEER after 1/1/2023	
	≥ 240,000 Btu/h	Electric resistance (or none)		9.5 EER 10.6 IEER before 1/1/2023 12.5 IEER after 1/1/2023	
		All other		9.3 EER 10.4 IEER before 1/1/2023 12.3 IEER after 1/1/2023	
Air cooled (heating mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	8.2 HSPF before 1/1/2023 7.5 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	8.0 HSPF before 1/1/2023 6.7 HSPF2 after 1/1/2023	

IECC2021 Table C403.3.2(2) continued from previous page

TABLE C403.3.2(2)—continued
ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Space constrained, air cooled (heating mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	7.4 HSPF before 1/1/2023 6.3 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	7.4 HSPF before 1/1/2023 6.3 HSPF2 after 1/1/2023	
Small duct, high velocity, air cooled (heating mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	7.2 HSPF before 1/1/2023 6.1 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	All	47°F db/43°F wb outdoor air	3.30 COP_H before 1/1/2023 3.40 COP_H after 1/1/2023	AHRI 340/360
			17°F db/15°F wb outdoor air	2.25 COP_H	
	≥ 135,000 Btu/h and < 240,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H before 1/1/2023 3.30 SOP_H after 1/1/2023	
			17°F db/15°F wb outdoor air	2.05 COP_H	
	≥ 240,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	

Minimum Efficiency Requirements: 2024 IECC (effective November 30, 2025)

TABLE C403.3.2(2)—ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[c]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	14.3 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	13.4 SEER2	
Space constrained, air cooled (cooling mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	11.7 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	11.7 SEER2	
Small duct, high velocity, air cooled (cooling mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER2	AHRI 210/240—2023
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	14.1 IEER	AHRI 340/360
		All other		13.9 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		13.5 IEER	
		All other		13.3 IEER	
	≥ 240,000 Btu/h	Electric resistance (or none)		12.5 IEER	
		All other		12.3 IEER	
Air cooled(heating mode)	< 65,000 Btu/h (cooling capacity)	—	Split system, three phase and applications outside US single phase[b]	7.5 HSPF2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	6.7 HSPF2	
Space constrained, air cooled (heating mode)	≤ 30,000 Btu/h(cooling capacity)	—	Split system, three phase and applications outside US single phase[b]	6.3 HSPF2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	6.3 HSPF2	
Small duct high velocity, air cooled (heating mode)	< 65,000 Btu/h	—	Split system, three phase and applications outside US single phase[b]	6.1 HSPF2	AHRI 210/240—2023
Air cooled (heating mode)	≥ 65,000 Btu/h and< 135,000 Btu/h(cooling capacity)	—	47°F db/43°F wb outdoor air	3.40 COP_H	AHRI 340/360
			17°F db/15°F wb outdoor air	2.25 COP_H	
	≥ 135,000 Btu/h and< 240,000 Btu/h(cooling capacity)		47°F db/43°F wb outdoor air	3.30 SOP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	
	≥ 240,000 Btu/h(cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	

Non Fuel Switch example, a 5-ton single phase split system 60,000 Btuh capacity heat pump, with an efficiency SEER2 of 16, and an efficient HSPF2 of 9.5, at a new restaurant in Chicago with a building permit dated after 1/1/2023 saves:

ΔkWh =$Annual\ kWh\ Savings_{cool} + Annual\ kWh\ Savings_{heat}$

Annual kWh Savings$_{cool}$ = $(Capacity_{cool} * EFLH_{cool} * (1/SEER_{base} - 1/SEER_{ee}))/1000$

Annual kWh Savings$_{heat}$ =$(HeatLoad * (1/(HSPF_{base} * HSPF_ClimateAdj) - 1/(HSPF_{ee} * HSPF_ClimateAdj)/1000$

ΔkWh = (60,000 * 761 * (1/14.3 – 1/16))/1000 + (60,000 * 797 * (1/(7.5 * 0.7) – 1/(9.5 * 0.7))/1000

= 2257 kWh

Fuel Switch Illustrative Examples

[for illustrative purposes 50:50 Incentive is used for joint programs]

New construction using gas furnace and central AC baseline:

For example, a 60,000 Btu, 16 SEER2, 9.5 HSPF2 single phase split system Air Site Heat Pump installed in a new Chicago restaurant, in place of a 120,000 Btuh natural gas furnace and 5 ton Central AC unit:

SiteEnergySavings (MMBTUs) = $GasHeatReplaced + FurnaceFanSavings - HPSiteHeatConsumed + HPSiteCoolingImpact$

GasHeatReplaced = $(HeatLoad * 1/AFUE_{base})$ / 1,000,000

= $(60{,}000 * 797 * 1/0.8)$ / 1000000

= 59.8 $MMBtu$

FurnaceFanSavings =$(FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_e)$ / 1,000,000

= $(1 * 60{,}000 * 797 * 1/0.8 * 0.077)$ / 1,000,000

= 4.6 $MMBtu$

HPSiteHeatConsumed = $((HeatLoad * (1/(HSPF_{ee} * HSPF_ClimateAdj))) /1000 * 3412)/1{,}000{,}000$

= $((60{,}000 * 797 * (1/(9.5 * 0.77))) / 1000 * 3412) / 1{,}000{,}000$

= 22.3 $MMBtu$

HPSiteCoolingImpact = $((FLHcool * Capacity_{cool} * (1/SEER_{base} - 1/SEER_{ee}))/1000 * 3412) / 1{,}000{,}000$

= $((761 * 60{,}000 * (1/14.3 - 1/16)) / 1000 * 3412)/1{,}000{,}000$

= 1.2 $MMBtu$

SiteEnergySavings (MMBTUs) = 59.8 + 4.6 – 22.3 + 1.2 = 43.3 MMBtu [Measure is eligible]

Fuel Switch Illustrative Example continued

Savings would be claimed as follows:

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	43.3 * 1,000,000/3412 = 12,691 kWh	N/A
Electric and gas utility	0.5 * 43.3 * 1,000,000/3412 = 6,345 kWh	0.5 * 43.3 * 10 = 217 Therms
Gas utility only	N/A	43.3 * 10 = 433 Therms

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = ((Capacity_{cool}/DuctlssSave * 1/EER2_base) - (Capacity_{cool} * 1/EER2_ee)) / 1000 * CF$$

Where CF value is chosen between:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [708]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [709]

For example, a 5 ton single phase split system air source heat pump, with an efficient EER2 of 12.5 with a building permit dated after 1/1/2023 saves:

ΔkW = ((60,000/1 * 1/9.4) – (60,000 * 1/12.5))/1000 *0.913

= 1.44 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from gas to electric.

For the purposes of forecasting load reductions due to fuel switch ASHP projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

[708] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[709] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure.

ΔTherms = $[Heating\ Consumption\ Replaced]$

= $[(\%FuelSwitch * HeatLoad_Disp/DuctlessSave * 1/AFUE_{base}) / 100{,}000]$

ΔkWh = $[FurnaceFanSavings] - [HP\ heating\ consumption] + [Cooling\ savings]$

For units with cooling capacities less than 65 kBtu/hr:

= $\%FuelSwitch * [FurnaceFlag * HeatLoad_Disp/DuctlessSave * 1/AFUE_{base} * F_e * 0.000293] - [(HeatLoad_Disp * (1/(HSPF2_{ee} * HSPF2_ClimateAdj * PD_Adj))/1000] + [((CoolingLoad/DuctlessSave * 1/SEER2_{base}) - (CoolingLoad * 1/SEER2_{ee}))/1000]$

For units with cooling capacities greater than 65 kBtu/hr:

= $\%FuelSwitch * [FurnaceFlag * HeatLoad_Disp * 1/AFUE_{base} * F_e * 0.000293] - [HeatLoad_Disp/3412 * 1/(COP_{ee} * PD_Adj)] + [(CoolingLoad * (1/IEER_{base} - 1/IEER_{ee}))/1000]$

MEASURE CODE: CI-HVC-HPSY-V15-270101

REVIEW DEADLINE: 1/1/2028

4.4.10 High Efficiency Boiler

DESCRIPTION

To qualify for this measure the installed equipment must be replacement of an existing boiler at the end of its service life, in a commercial or multifamily space with a high efficiency, gas-fired steam or hot water boiler. High efficiency boilers achieve gas savings through the utilization of a sealed combustion chamber and multiple heat exchangers that remove a significant portion of the waste heat from flue gasses. Because multiple heat exchangers are used to remove waste heat from the escaping flue gasses, some of the flue gasses condense and must be drained.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a boiler used 80% or more for space heating, not process, and boiler AFUE, E_T (thermal efficiency), or E_C (combustion efficiency) rating must be rated greater than or equal to 85% for hot water boilers and 83% for steam boilers.

DEFINITION OF BASELINE EQUIPMENT

Dependent on when the unit is installed and whether the unit is hot water or steam. The baseline efficiency source is the Energy Independence and Security Act of 2007 with technical amendments from Federal Register, volume 81, Number 10, January 15, 2016 for boilers <300,000 and Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr.[710]

For boilers <300,000 Btu/hr the technical amendments include the recent compliance dates for gas-fired hot water and steam boilers manufactured on or after January 15, 2021.[711]

Note, for natural draft steam boilers, as IECC 2024, the Illinois state energy code effective statewide as of November 30, 2025, exceeds the minimum federal efficiency standards, it was replaced in favor of the more aggressive thermal efficiency values in the table below. For new construction applications where the permitting date is prior to the state's adoption of IECC 2024, it is recommended to use the applicable edition of IECC corresponding to that timeline. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Each gas-fired commercial packaged boiler must meet the applicable energy conservation standard levels detailed in the table below.

Boiler baseline efficiency standards:[712]

Boiler Type	Efficiency
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 25 years.[713]

[710] Energy Conservation Standards for Commercial Boilers, Code of Federal Regulations, 10 CFR 431.87
[711] Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).
[712] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.
[713] Consistent with DOE assumption determined through a literature review in Appendix 8-F of the Department of Energy Commercial Technical Support Document.

DEEMED MEASURE COST

The measure cost for this technology is tiered based on the boiler type and combustion efficiencies. As installation costs for the base case and the measure case units are assumed to be the same, labor costs are not specified for this measure.

Incremental and Gross Measure costs for Space Heating Boilers

Boiler Type	Incremental Measure Cost ($/KBtu)[714]	Full Installed Measure Cost ($/KBtu)[715]
Hot Water Boiler ≥85% E_C and <90% E_C	$2.17	$12.94
Hot Water Boiler ≥90% E_C	$12.17	$22.95
Steam Boiler ≥83% E_C and <85% E_C	$4.35	$19.24
Modular Steam Boiler Arrays (≥85% E_C)[716]	Custom	

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = EFLH * Capacity * ((Efficiency_{EE} - Efficiency_{Base}) / Efficiency_{Base}) / 100{,}000$$

Where:

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

Capacity = Nominal Heating Input Capacity Boiler Size (Btu/hr) for efficient unit not existing unit

= custom Boiler input capacity in Btu/hr

$Efficiency_{Base}$ = Baseline Boiler Efficiency Rating, dependant on year and boiler type

Hot water boiler baseline:

Boiler Capacity and Distribution Type	Efficiency
Hot Water <300,000 Btu/hr[717]	84% AFUE

[714] Ibid.
[715] Ibid.
[716] Miura Modular Boilers, https://s29958.pcdn.co/wp-content/uploads/2019/03/LXBrochure2016.pdf
[717] Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).

Boiler Capacity and Distribution Type	Efficiency
Hot Water ≥300,000 & ≤2,500,000 Btu/hr[718]	80% E_T
Hot Water Boiler > 2,500,000[719]	82% E_C

Steam boiler baseline:

Boiler Capacity and Distribution Type	Efficiency
Steam <300,000 Btu/hr[720]	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h [721]	79% E_T
Steam - natural draft ≥300,000 & ≤2,500,000 Btu/hr	79% TE[722]
Steam Boiler >2,500,000 Btu/h	79% E_T
Steam - natural draft >2,500,000 Btu/hr	79% E_T [723]

$Efficiency_{EE}$ = Efficent Boiler Efficiency Rating

=actual value, specified to one significant digit (i.e., 95.7%)

For example, a 150,000 btu/hr water boiler meeting AFUE 90% is installed in Rockford at a high rise office building , in the year 2022

ΔTherms = 2,089* 150,000 * (0.90-0.840)/0.840) / 100,000 Btu/Therm

= 224 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-BOIL-V13-270101

REVIEW DEADLINE: 1/1/2030

[718] Thermal Efficiency. Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87).
[719] Combustion Efficiency. Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87).
[720] Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).
[721] Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87). Includes efficiency requirements for all steam boilers ≥ 300,000 Btu/hr.
[722] IECC 2024
[723] IECC 2024

4.4.11 High Efficiency Furnace

DESCRIPTION

This measure covers the installation of a residential sized (<225,000 Btu/hr) or commercial sized (>=225,000 Btu/hr) high efficiency gas furnace in lieu of a standard efficiency gas furnace in a commercial or industrial space. Note commercial sized condensing gas units (>= 225,000 Btu/hr) heating 100% outside air should use 4.4.37 Unitary HVAC Condensing Furnace if appropriate. High efficiency gas furnaces achieve savings through the utilization of a sealed, super insulated combustion chamber, more efficient burners, and multiple heat exchangers that remove a significant portion of the waste heat from the flue gasses. Because multiple heat exchangers are used to remove waste heat from the escaping flue gasses, most of the flue gasses condense and must be drained.

This measure also describes savings from a brushless permanent magnet (BPM) motor (known and referred in this measure as an electronically commutated motor (ECM)) compared to a lower efficiency motor within a residential sized unit. Time of Sale and New Construction scenarios can no longer claim these electrical savings, as federal standards make ECM blower fan motors a requirement for residential-sized furnaces.[724] Savings however are available from replacing an operational inefficient furnace with a new furnace with an ECM prior to the end of its life.

This measure was developed to be applicable to the following program types: TOS, NC and EREP. If applied to other program types, the measure savings should be verified.

Time of sale:

a. The installation of a new high efficiency, gas-fired condensing furnace in a commercial location. This could relate to the replacement of an existing unit at the end of its useful life, or the installation of a new system.

Early replacement:

Early Replacement determination will be based on meeting the following conditions:

- The existing unit is operational when replaced, or

  The existing unit requires minor repairs (defined as 20% of the cost of a new baseline replacement unit).[725]
- All other conditions will be considered Time of Sale.

The Baseline AFUE of the existing unit replaced:

- If the AFUE of the existing unit is known, the Baseline AFUE is the actual AFUE value of the unit replaced.
- If the AFUE of the existing unit is unknown, use assumptions in variable list below (AFUE(exist)).
- If the operational status or repair cost of the existing unit is unknown, use time of sale assumptions.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a furnace with input energy less than 225,000 Btu/hr rated natural gas fired furnace with an Annual Fuel Utilization Efficiency (AFUE) rating and fan electrical efficiency exceeding the program requirements:

DEFINITION OF BASELINE EQUIPMENT

Time of Sale: The current Federal Standard for gas furnaces <225,000 Btu/hr is an AFUE rating of 80%.

[724] As part of the code of federal regulations, energy conservation standards for covered residential furnace fans become effective on July 3, 2019 (10 CFR 430.32(y)). The expectation is the baseline will essentially become an ECM motor.
[725] The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost it can be considered early replacement. Note the non-inflated cost should be used as this would be a cost consideration in the program year.

For furnaces ≥225,000 Btu/hr, the baseline AFUE rating is 81%.

Early replacement: The baseline for this measure is the efficiency of the existing equipment for the assumed remaining useful life of the unit and a new baseline 80% AFUE for Residential sized or 81% AFUE for Commercial sized unit for the remainder of the measure life.

DEFINITION OF MEASURE LIFE

The expected measure life is assumed to be 23 years.[726]

Remaining life of existing equipment is assumed to be 8 years.[727]

DEEMED MEASURE COST

For residential sized units (<225,000 Btu/hr):

Time of Sale: The incremental capital cost for this measure depends on efficiency as listed below:[728]

AFUE	Installation Cost	Incremental Install Cost
Baseline	$4,019	n/a
≤ 95%	$4,327	$307
> 95% - < 97%	$4,524	$505
≥ 97%	$4,699	$679

Early Replacement: The full installation cost is provided in the table above. The assumed deferred cost (after 5.5 years) of replacing existing equipment with a new 80% baseline unit is assumed to be $4,550.[729] This cost should be discounted to present value using the nominal discount rate.

For commercial sized units (≥225,000 Btu/hr) – actual costs should be used.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Residential sized (<225,000 Btu/hr), Early Replacement Only:

For remaining useful life of the existing furnace (assumed 5.5 years):

$$\Delta kWh = Heating\ Savings\ +\ Cooling\ Savings\ +\ Shoulder\ Season\ Savings$$

[726] US EIA, "Technology Forecast Updates – Residential and Commercial Building Technologies – Reference Case", Guidehouse and Leidos, March 2023.
[727] Assumed to be one third of effective useful life.
[728] In 2025, a working group was created to update costs for residential HVAC equipment. Heat Pump and Central Air Conditioning costs are based upon Ameren program data. Furnace and Boiler costs are based on Ameren, Nicor, People's Gas, and North Shore Gas program data. Baseline costs have been determined using ratios from Updated Buildings Sector Appliance and Equipment Costs and Efficiencies by Guidehouse and Leidos, prepared for the U.S. Energy Information Administration. See file "HVAC Costs – 071825_VEIC.xlsx" for more details.
[729] Baseline cost assumption inflated using 2.28% rate.

Where:

Heating Savings = Brushless DC motor or Electronically commutated motor (ECM)
= 418 kWh[730]

Cooling Savings = Brushless DC motor or electronically commutated motor (ECM) savings during cooling season

If air conditioning = 263 kWh

If no air conditioning = 175 kWh

If unknown (weighted average)= 241 kWh[731]

Shoulder Season Savings = Brushless DC motor or electronically commutated motor (ECM) savings during shoulder seasons

= 51 kWh

For example, a blower motor in a low rise office building where air conditioning presence is unknown:

ΔkWh = Heating Savings + Cooling Savings + Shoulder Season Savings
= 418 +241 + 51
= 710 kWh

For remaining measure life of the existing furnace (next 11 years): 0 kWh

All other applications assume 0 kWh.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Residential sized (<225,000 Btu/hr) Early Replacement Only:

For remaining useful life of the existing furnace (assumed 5.5 years):

For units that have evaporator coils and condensing units and are cooling in the summer in addition to heating in the winter the summer coincident peak demand savings should be calculated. If the unit is not equipment with coils or condensing units, the summer peak demand savings will not apply.

$$\Delta kW = (CoolingSavings/HOURSyear) * CF$$

Where:

HOURSyear = Actual hours per year if known, otherwise use hours from Table below for building type[732]

CF =Summer Peak Coincidence Factor for measure is provided below for different building types[733]

[730] To estimate heating, cooling and shoulder season savings for Illinois, VEIC adapted results from a 2009 Focus on Energy study of BPM blower motor savings in Wisconsin. This study included effects of behavior change based on the efficiency of new motor greatly increasing the amount of people that run the fan continuously. The savings from the Wisconsin study were adjusted to account for different run hour assumptions (average values used) for Illinois. See: FOE to IL Blower Savings.xlsx.
[731] The weighted average value is based on assumption that 75% of buildings installing BPM furnace blower motors have Central AC.
[732] Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the cooling system is operating for each building type.
[733] Coincidence Factors are estimated using the OpenStudio models.

Building Type	Cooling Run Hours	Coincidence Factor (CF)	Model Source
Assembly	2,275	58.2%	OpenStudio
Assisted Living	5,711	53.6%	OpenStudio
Auto Dealership	1,690	72.7%	OpenStudio
Childcare/Pre-School	2,041	77.1%	OpenStudio
College	4,221	57.1%	OpenStudio
Convenience Store	1,722	80.5%	OpenStudio
Drug Store	1,843	76.2%	OpenStudio
Elementary School	3,152	48.4%	OpenStudio
Emergency Services	3,636	81.4%	OpenStudio
Garage	2,102	61.9%	eQuest
Grocery	2,016	88.4%	OpenStudio
Healthcare Clinic	4,447	80.8%	OpenStudio
High School	3,304	44.2%	OpenStudio
Hospital - CAV no econ	8,760	85.4%	OpenStudio
Hospital - CAV econ	8,744	84.8%	OpenStudio
Hospital - VAV econ	5,465	87.1%	OpenStudio
Hospital - FCU	8,760	80.9%	OpenStudio
Hospital - Unknown	7,932	84.6%	OpenStudio
Hotel/Motel	5,999	48.5%	OpenStudio
Hotel/Motel - Common	6,266	71.5%	OpenStudio
Hotel/Motel - Guest	4,132	34.4%	OpenStudio
Manufacturing Facility_Miscellaneous	7,070	91.0%	OpenStudio
Manufacturing Facility_Food/Chemical	8,760	93.5%	OpenStudio
MF - High Rise	4,332	60.3%	OpenStudio
MF - High Rise - Common	2,670	94.9%	OpenStudio
MF - High Rise - Residential	4,622	57.5%	OpenStudio
MF - Mid Rise	3,477	64.4%	OpenStudio
Movie Theater	2,347	49.9%	OpenStudio
Office - High Rise - CAV no econ	6,129	83.7%	OpenStudio
Office - High Rise - CAV econ	2,723	82.8%	OpenStudio
Office - High Rise - VAV econ	4,790	85.7%	OpenStudio
Office - High Rise - FCU	5,905	82.8%	OpenStudio
Office - Low Rise	1,990	75.5%	OpenStudio
Office - Mid Rise	3,041	75.5%	OpenStudio
Religious Building	2,129	38.1%	OpenStudio
Restaurant	3,213	74.3%	OpenStudio
Retail - Department Store	1,737	75.8%	OpenStudio
Retail - Strip Mall	1,750	76.7%	OpenStudio

Building Type	Cooling Run Hours	Coincidence Factor (CF)	Model Source
Warehouse Nonrefrigerated	1,110	66.2%	OpenStudio
Warehouse Refrigerated	882	87.9%	OpenStudio
Medical Office	4,366	76.5%	OpenStudio
Unknown	2,833	65.3%	n/a

For example, a blower motor in a low rise office building where air conditioning presence is unknown:

ΔkW = (241 / 1990) * 0.755

= 0.091 kW

For remaining measure life of the existing furnace (next 11 years): 0 kW

All other applications assume 0 kWh.

FOSSIL FUEL SAVINGS

Time of Sale:

ΔTherms = $(EFLH * Capacity * (AFUE(eff) / AFUE(base) - 1)) / 100{,}000$

Early replacement[734]:

ΔTherms for remaining life of existing unit (1st 5.5 years):

ΔTherms = $(EFLH * Capacity * (AFUE(eff) / AFUE(exist) - 1)) / 100{,}000$

ΔTherms for remaining measure life (next 11 years):

ΔTherms = $(EFLH * Capacity * (AFUE(eff) / AFUE(base) - 1)) / 100{,}000$

Where:

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

Capacity = Nominal Heating Input Capacity Furnace Size (Btu/hr) for efficient unit not existing unit

= custom Furnace input capacity in Btu/hr

AFUE(exist) = Existing Furnace Annual Fuel Utilization Efficiency Rating

= Use actual AFUE rating where it is possible to measure or reasonably estimate.

If unknown, assume 64.4 AFUE%. [735]

AFUE(base) = Baseline Furnace Annual Fuel Utilization Efficiency Rating

[734] The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a "number of years to adjustment" and "savings adjustment" input which would be the (new base to efficient savings)/(existing to efficient savings).

[735] Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

= For residential sized units (<225,000 Btu/hr): 80%[736]

= For commercial sized units (>=225,000 Btu/hr):

Program	AFUE(base)
Time of Sale	81%[737]
Early Replacement	81%[738]

AFUE(eff) = Efficent Furnace Annual Fuel Utilization Efficiency Rating.

= Actual. If Unknown, assume 97%.[739]

For example,

ΔTherms = (1428 * 150,000 * (0.92 / 0.80 – 1))/ 100,000

= 321 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-FRNC-V16-270101

REVIEW DEADLINE: 1/1/2029

[736] Residential sized units as per Code of Federal Regulations, effective November, 2015 (10 CFR 432(e)).
[737] Commercial sized units as per Code of Federal Regulations, effective January 2023 (10 CFR 431(d)).
[738] Commercial sized units as per Code of Federal Regulations, effective January 1, 2023 (10 CFR 431(d)).
[739]Minimum ENERGY STAR efficiency after 7.31.2026.

4.4.12 Infrared Heaters

DESCRIPTION

A natural gas-fired radiant infrared heater uses the combustion of natural gas to heat a metal tube or ceramic panel to a very high temperature (typically between 1200 and 5000 degrees Fahrenheit). The high surface temperature causes radiant heat transfer between the heater surface and its surroundings. The surroundings will re-radiate the heat to occupants and release heat through convection to the air, providing a comfortable environment without directly heating air.

Infrared heaters are ideal for space heating applications where there are elevated ceilings with high thermal stratification, spaces with high ventilation or air infiltration rates, or a need for spot heating within an unconditioned or industrial space. Aircraft hangers, warehouses, greenhouses, manufacturing production areas, pools, and loading docks are space types that can be efficiently served by a radiant infrared heater.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a natural gas heater with an electric ignition that uses non-conditioned air for combustion. Gross Radiant Coefficient (GRC) is provided by the manufacturer and defined as the ratio of radiant heat output to the natural gas input energy (in Btu).[740]

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a standard natural gas fired warm air heater.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[741]

DEEMED MEASURE COST

The incremental capital cost for this measure is $2.70 per kBtu/hr input capacity.[742]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

[740] "AHRI Standard 1330 - 2014 Standard for Performance Rating for Radiant Output of Gas Fired Infrared Heaters". 2014. Air Conditioning, Heating, and Refrigeration Institute. Arlington, VA.
[741] 2020 Michigan Energy Measures Database (MEMD). Please see file "mi_master_measure_database_2020-011020_681298_7.xlsx"
[742] Ibid

FOSSIL FUEL SAVINGS

Natural gas savings for this measure are based on the standard practice of HVAC designers to size a gas-fired radiant infrared heater at a lower input capacity than an equivalent warm air unit heater for an identical application.

$$\Delta\text{Therms} = Therms(base) - Therms(IR)$$

$$\text{Therms(base)} = Capacity/RSF * EFLH/100{,}000$$

$$\text{Therms(IR)} = Capacity * EFLH/100{,}000$$

Where:

Capacity = Input capacity of radiant infrared heater in btu/hr

= Actual

RSF = Radiation Sizing Factor, dependent on Gross Radiant Coefficient[743] as listed below:[744,745]
If Gross Radiant Coefficient is unavailable, assume RSF = 0.85.

Gross Radiant Coefficient (GRC)	RSF (Radiation Sizing Factor)
GRC < 0.67	0.85
0.67 ≤ GRC	0.70

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

100,000 = Btu to therm conversion factor

For example: a radiant heater with a natural gas input capacity of 125,000 Btu/hr and a Gross Radiant Coefficient of 0.45 installed in a warehouse in Chicago will save:

ΔTherms = Therms(base) – Therms(IR)

$$\text{Therms(base)} = 125{,}000/0.85 * 1286/100{,}000$$

= 1891.2 Therms

$$\text{Therms(IR)} = 125{,}000 * 1286/100{,}000$$

= 1607.5 Therms

ΔTherms = 283.7 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[743] Gross Radiant Coefficient should be provided by the manufacturer.
[744] Radiation Sizing Factor(RSF) value determined by testing as per 2016 ASHRAE® HANDBOOK: Heating, Ventilating, and Air-Conditioning SYSTEMS AND EQUIPMENT, Inch-Pound Edition, Chapter 16, pg. 16.1, "Energy Conservation," 2016, American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc. Atlanta, GA.
[745] "Put Your Infra-Red Knowledge to the Test". Contracting Canada, July - August 2002.

MEASURE CODE: CI-HVC-IRHT-V05-270101

REVIEW DEADLINE: 1/1/2030

4.4.13 Package Terminal Air Conditioner (PTAC) and Package Terminal Heat Pump (PTHP)

DESCRIPTION

A PTAC is a packaged terminal air conditioner that cools and sometimes provides heat through an electric resistance heater (heat strip). A PTHP is a packaged terminal heat pump. A PTHP uses its compressor year-round to heat or cool. In warm weather, it efficiently captures heat from inside your building and pumps it outside for cooling. In cool weather, it captures heat from outdoor air and pumps it into your home, adding heat from electric heat strips as necessary to provide heat.

This measure characterizes:

Time of Sale: the purchase and installation of a new efficient PTAC or PTHP.

Early Replacement: the early removal of existing HVAC system from service, prior to its natural end of life, and replacement with a new efficient PTAC or PTHP unit. Savings are calculated between existing unit and efficient unit consumption during the remaining life of the existing unit, and between new baseline unit and efficient unit consumption for the remainder of the measure life.

This measure was developed to be applicable to the following program types: TOS NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be PTACs or PTHPs that exceed baseline efficiencies.

DEFINITION OF BASELINE EQUIPMENT

Time of Sale: the baseline condition is equipment that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date is unknown, assume current Code minimum).

Early Replacement: the baseline is the existing HVAC equipment for the assumed remaining useful life of the unit and the new baseline as defined above for the remainder of the measure life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 8 years.[746]

Remaining life of existing equipment is assumed to be 3 years.[747]

DEEMED MEASURE COST

Time of Sale: The incremental capital cost for this equipment is estimated to be $84/ton.[748]

Early Replacement: The measure cost is the full cost of removing the existing unit and installing a new one. The actual program cost should be used. If unknown assume $1,047 per ton.[749]

The assumed deferred cost (after 5 years) of replacing existing equipment with new baseline unit is assumed to be $1,077 per ton.[750] This cost should be discounted to present value using the nominal discount rate.

LOADSHAPE

Loadshape R10 – Residential Electric Heating and Cooling

[746] Based on 2015 DOE Technical Support Document, as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[747] Standard assumption of one third of effective useful life.
[748] DEER 2008. This assumes that baseline shift from IECC 2012 to IECC 2015 carries the same incremental costs. Values should be verified during evaluation.
[749] Based on DCEO – IL PHA Efficient Living Program data.
[750] Based on subtracting TOS incremental cost from the DCEO data and incorporating inflation rate of 2.28%.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market.

CF_{SSP} = Summer System Peak Coincidence Factor for Heat Pumps in multi-family homes (during system peak hour)

= 67.0% [751]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Heat Pumps in multi-family homes (average during peak period)

= 28.5% [752]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

Non Fuel Switch Measures

Electric savings for PTACs and PTHPs should be calculated using the following algorithms

Time of Sale:

PTAC ΔkWh[753] = $Annual\ kWh\ Savings_{cool}$

PTHP ΔkWh = $Annual\ kWh\ Savings_{cool} + Annual\ kWh\ Savings_{heat}$

Annual kWh $Savings_{cool}$ = $CoolingLoad * (1/EER_{base} - 1/EER_{ee})$

Annual kWh $Savings_{heat}$ = $(HeatLoad * (1/COP_{base} - 1/COP_{ee}))/3.412$

Early Replacement:

ΔkWh for remaining life of existing unit (1st 3years) = Annual kWh $Savings_{cool}$ + Annual kWh $Savings_{heat}$

Annual kWh $Savings_{cool}$ = $CoolingLoad * (1/EER_{exist} - 1/EER_{ee})$

Annual kWh $Savings_{heat}$ = $(HeatLoad * (1/COP_{exist} - 1/COP_{ee}))/3.412$

ΔkWh for remaining measure life (next 5 years) = $Annual\ kWh\ Savings_{cool} + Annual\ kWh\ Savings_{heat}$

Annual kWh $Savings_{cool}$ = $CoolingLoad * (1/EER_{base} - 1/EER_{ee})$

Annual kWh $Savings_{heat}$ = $(HeatLoad * (1/COP_{base} - 1/COP_{ee}))/3.412$

Fuel switch measures:

Fuel switch measures must produce positive total energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows:

[751] Based on All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015.
[752] Based on All-Electric Homes PY6 Metering Results: Multi-family HVAC Systems, Cadmus, October 2015.
[753] There are no heating efficiency improvements for PTACs since although some do provide heating, it is always through electric resistance and therefore the COP_{base} and COP_{ee} would be 1.0.

SiteEnergySavings (MMBTUs) = $FuelSwitchSavings + NonFuelSwitchSavings$

FuelSwitchSavings = $(GasHeatReplaced - ElectricHeatConsumed)$

NonFuelSwitchSavings = $CoolingImpact$

Where:

GasHeatReplaced = $(HeatLoad * 1/FossilEff_{base})$ / 1,000

ElectricHeatConsumed = $(HeatLoad * 1/COP_{ee})$ / 1000

CoolingImpact = $CoolLoad * ((1/EER_{base}) - (1/EER_{ee})) * 3{,}412/1{,}000{,}000$

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure supported by:	Electric Utility claims (kWh):	Gas Utility claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

CoolingLoad = Annual cooling load for the space being served

= $kBtu/hr_{cool}$ * $EFLH_{cool}$

$kBtu/hr_{cool}$ = capacity of the cooling equipment in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).

= Actual installed

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use:

HeatLoad = Annual heat load for the space being served

= $kBtu/hr_{heat}$ * $EFLH_{heat}$

$kBtu/hr_{heat}$ = capacity of the heating equipment in kBtu per hour.

= Actual installed

$EFLH_{heat}$ = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

EER_{exist} = Energy Efficiency Ratio of the existing equipment

= Actual. If unknown assume 10.4 EER for PTAC and for PTHP.[754]

EER_{base} = Energy Efficiency Ratio of the baseline equipment; see the table below for values.

= Based on applicable Code on date of equipment purchase (if unknown assume current Code

Copy of Table C403.3.2(4): Minimum Efficiency Requirements: Electrically operated packaged terminal air conditioners, packaged terminal heat pumps

Equipment Type	IECC 2024	IECC 2015/2018	Federal Regulations
	Minimum Efficiency (baseline effective 11/30/2025)	Minimum Efficiency (baseline effective 1/1/2016)	Minimum Efficiency (baseline effective 1/1/2019)
PTAC (Cooling mode)	14.0 – (0.300 x Cap/1000) EER		14.0 – (0.300 x Cap/1000) EER
Standard Sized			Compliance date: 1/1/2017
PTAC (Cooling mode)	10.9 – (0.213 x Cap/1000) EER		10.9 – (0.213 x Cap/1000) EER
Non-Standard Size*			Compliance date: 10/7/2010
PTHP (Cooling mode)	14.0 – (0.300 x Cap/1000) EER		14.0 – (0.300 x Cap/1000) EER
Standard Sized			Compliance date: 10/8/2012
PTHP (Cooling mode)	10.8 – (0.213 x Cap/1000) EER		10.8 – (0.213 x Cap/1000) EER
Non-Standard Size*			Compliance date: 10/7/2010
PTHP (Heating mode)	3.7 – (0.052 x Cap/1000) COP	3.2 – (0.026 x Cap/1000) COP	3.7 – (0.052 x Cap/1000) COP
Standard Sized			Compliance date: 10/8/2012
PTHP (Heating mode)	2.9 – (0.026 x Cap/1000) COP		2.9 – (0.026 x Cap/1000) COP
Non-Standard Size*			Compliance date: 10/7/2010

Table notes: "Cap" = The rated cooling capacity of the project in Btu/hr. If the units capacity is less than 7000 Btu/hr, use 7,000 Btu/hr in the calculation. If the unit's capacity is greater than 15,000 Btu/hr, use 15,000 Btu/hr in the calculations.

*** Non-Standard Size apply only to units with existing sleeves less than 16 inches (406mm) in height and less than 42 inches (1067 mm) in width. Replacement unit shall be factory labeled as follows "MANUFACTURED FOR REPLACEMENT APPLICATIONS ONLY; NOT TO BE INSTALLED IN NEW CONSTRUCTION PROJECTS".**

EER_{ee} = Energy Efficiency Ratio of the energy efficient equipment. For air-cooled units < 65 kBtu/hr, if the actual EER_{ee} is unknown, assume the following conversion from SEER to EER for calculation of peak savings[755]: $EER = (-0.02 * SEER^2) + (1.12 * SEER)$

= Actual installed

3.412 = Btu per Wh.

COP_{exist} = coefficient of performance of the existing equipment

= Actual. If unknown assume 1.0 COP for PTAC units and 2.9 COP for PTHPs[756]

COP_{base} = coefficient of performance of the baseline equipment; see table above for values.

COP_{ee} = coefficient of performance of the energy efficient equipment.

= Actual installed.

[754] Efficiency of existing unit is estimated based on the 2015/2018 IECC building energy code standard sized, and assuming a 1 ton unit; PTAC: EER = 14.0 – (0.3 * 12,000/1,000) = 10.4, and PTHP: EER = 14 – (0.3 * 12,000/1,000) = 10.4.
[755] Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.
[756] Efficiency of existing unit is estimated based on the 2015/2018 IECC building energy code, and assuming a 1 ton unit; COP = 3.2 – (0.026 * 12,000/1,000) = 2.9.

$FossilEff_{base}$ = Efficiency of baseline or existing fossil fuel heating system

= Actual or select baseline from applicable measure in Section 4.

Time of Sale (assuming new construction baseline):

For example, a 1 ton PTAC with an efficient EER of 12 in a guest room of a hotel in Rockford with a building permit dated after 1/1/2016 saves:

= [(12) * [(1/10.4) – (1/12)] * 1,042

= 160 kWh

Early Replacement (assuming replacement baseline for deferred replacement in 3 years):

For example, a 1 ton PTHP with an efficient EER of 12, COP of 3.0 in a guest room of a hotel in Rockford replaces a PTAC unit (with electric resistance heat) with unknown efficiency.

ΔkWh for remaining life of existing unit (1st 3 years)

= (12 * (1/10.4 – 1/12) * 1,042) + (12/3.412 * (1/1.0 – 1/3.0) * 1,758)

= 160 + 4,122

= 4,282 kWh

ΔkWh for remaining measure life (next 5 years)

= (12 * (1/10.4 – 1/12) * 1,042) + (12/3.412 * (1/1.0 – 1/3.0) * 1,758)

= 160 + 4,122

= 4,282 kWh

For example, a 1 ton PTHP with an efficient EER of 12, COP of 3.0 in a guest room of a hotel in Rockford in place of a 80% central boiler providing heat and a baseline PTAC.

SiteEnergySavings (MMBTUs) = FuelSwitchSavings + NonFuelSwitchSavings

FuelSwitchSavings = (GasHeatReplaced – ElectricHeatConsumed)

NonFuelSwitchSavings = CoolingImpact

GasHeatReplaced = (HeatLoad * 1/$FossilEff_{base}$) / 1,000

= (12 * 1,758 * 1/0.8) / 1,000

= 26.4 MMBtu

ElectricHeatConsumed = (HeatLoad * 1/COP_{ee}) / 1,000

= (12 * 1,758 * 1/3) / 1,000

= 7.0 MMBtu

CoolingImpact = CoolLoad * (1/EER_{base} – 1/EER_{ee}) * 3,412/1,000,000

= 12 * 1,042 * (1/10.4 – 1/12) * 3,412/1,000,000

= 0.5 MMBtu

SiteEnergySavings (MMBTUs) = 26.4 – 7.0 + 0.5

= 19.9 MMBtu

If supported by an electric utility: ΔkWh = ΔSiteEnergySavings * 1,000,000 / 3,412

= 19.9 * 1,000,000/3,412

= 5,832 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Time of Sale:

$$\Delta kW = (kBtu/hr_{cool}) * [(1/EER_{base}) - (1/EER_{ee})] * CF$$

Early Replacement:

ΔkW for remaining life of existing unit (1st 3 years)=$(kBtu/hr_{cool}) * [(1/EER_{exist}) - (1/EER_{ee})] * CF$

ΔkW for remaining measure life (next 5 years) = $(kBtu/hr_{cool}) * [(1/EER_{base}) - (1/EER_{ee})] * CF$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Heat Pumps in multi-family homes (during system peak hour)

= 67.0% [757]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 28.5% [758]

[757] Based on All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmus, October 2015.
[758] Based on All-Electric Homes PY6 Metering Results: Multifamily HVAC Systems, Cadmis, October 2015.

Time of Sale:

For example, a 1 ton replacement cooling unit with no heating with an efficient EER of 12 with a building permit dated after 1/1/2016 saves:

ΔkW_{SSP} = (12 * (1/10.4 – 1/12) *0.67

= 0.1031 kW

For example, a 1 ton PTHP with an efficient EER of 12, COP of 3.0 replacing a PTAC unit with unknown efficiency saves:

ΔkW for remaining life of existing unit (1st 3 years):

ΔkW_{SSP} = 12 * (1/10.4 – 1/12) * 0.67

= 0.1031 kW

ΔkW for remaining measure life (next 5 years):

ΔkW_{SSP} = 12 * (1/10.4 – 1/12) * 0.67

= 0.1031 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = $[Gas\ Heat\ Replaced]$

= $(HeatLoad\ *\ 1/FossilEff_{base})\ /\ 100$

ΔkWh = $-\ [Electric\ Heat\ Added]\ +\ [CoolingImpact]$

= $-((HeatLoad\ *\ 1/COP_{ee})\ /\ 3.412)\ +\ (CoolLoad\ *\ (1/EER_{base}\ -\ 1/EER_{ee}))$

MEASURE CODE: CI-HVC-PTAC-V15-270101

REVIEW DEADLINE: 1/1/2030

4.4.14 Pipe Insulation

DESCRIPTION

This measure provides rebates for installation of 1" – 4" fiberglass, foam, calcium silicate or other types of insulation with similar insulating properties to existing bare pipe on straight piping as well as other pipe components such as elbows, tees, valves, and flanges for all non-residential installations.

Savings are provided in two forms; default savings estimates on a per linear foot basis and savings calculated with a multitude of varying parameters with the use of an external calculator[759]. The default savings estimates are provided in the 'Calculation of Savings' section below. They provide estimated savings for measure applications with select and default parameters. The external tool, however, allows more flexibility and provides comprehensive analysis to pipe insulation projects, accounting for all on-site variables.

Default per linear foot savings estimates are provided for both exposed indoor or above ground outdoor piping distributing fluid in the following system types (natural gas fired systems only):

- Hydronic heating systems (with or without outdoor reset controls), including:
    - boiler systems that do not circulate water around a central loop and operate upon demand from a thermostat ("non-recirculation")
    - systems that recirculate during heating season only ("Recirculation – heating season only")
    - systems recirculating year-round ("Recirculation – year-round")
- Domestic hot water
- Low and high-pressure steam systems
    - non-recirculation
    - recirculation - heating season only
    - recirculation - year round

With the use of the external tool to account for varying parameter inputs, savings are calculated using the "Pipe Insulation" calculator available on the Nicor Gas website at: https://www.nicorgas.com/emerging. Savings are approached through the following inputs:

- Pipe Material: Copper, Steel, Stainless Steel
- Pipe Location: Indoor (Heated, Semi-Heated,[760] Unheated, Unspecified) or Outdoor
- Application: Hot Water Space Heating, Steam (5, 15, 40, 65, 100, 150 psi) for various system types detailed in the subsequent system type list below
- Thermal Regain Factor (based on pipe location)
- Building Type [761]
- Nominal Pipe Size (inches)
- Insulation Thickness (inches): 1"-4", specified in ½" increments [762]
- Hot Water/Steam Boiler Efficiency (%): 75%-90%, specified in 2.5% increments
- Climate Zone: Rockford, Chicago, Springfield, Belleville, Marion
- Length of Installed Pipe (feet)
- Number of Elbows, Tees, Flanges, and/or Valves [763]

[759] Please see; 'C&I Pipe Insulation Calculator Access.docx' for directions on accessing the external calculator. The use of other comparable external calculators are allowed if the functionality mirrors the savings approach detailed in this characterization.
[760] Unconditioned space with heat transfer to conditioned space (e.g. boiler room, ceiling plenum, basement, crawlspace, wall, etc.).
[761] Comprehensive list of building types available in Section 4.4, HVAC End Use of IL TRM.
[762] For insulation thicknesses greater than 4", savings can be claimed based on 4" insulation thickness.
[763] Equivalent length of elbows and tees is based on methodology described in ANSI/ASME B36.19. Equivalent length of flanges and valves is based on methodology described in ATSM Standard C1129-12.

Process piping can also use the algorithms provided but requires custom entry of hours.

For new construction applications, minimum qualifying nominal pipe diameter is 1". Piping must have at least 1" of insulation and outdoor piping must include an all-weather protective jacket. New advanced insulating materials may be thinner, and savings can be calculated with 3E Plus v4.1.

The relevant code of compliance should be followed for direction on minimum permitted insulation thickness for a nominal pipe diameter. As per the International Energy Conservation Code (IECC) 2024, the minimum permitted insulation thickness is 1" for installations pertaining to new construction or major renovation heating HVAC applications [764]. However, there are exceptions based on Fluid Operating Temperature Range, Insulation thermal conductivity range, install locations and pipe sizes –indicating the minimum insulation thickness required for parameters described in the column headers presented in the table below.

Fluid Operating Temperature Range and Usage (°F)	Insulation Conductivity		Nominal Pipe or Tube Size (inches)				
	Conductivity Btu.in/(h.ft$^{2.°F}$)	Mean Rating Temperature, °F	<1	1 to <1.5	1.5 to <4	4 to <8	≥8
>350	0.32 - 0.34	250	4.5	5.0	5.0	5.0	5.0
251 - 350	0.29 - 0.32	200	3.0	4.0	4.5	4.5	4.5
201 - 250	0.27 - 0.30	150	2.5	2.5	2.5	3.0	3.0
141 - 200	0.25 - 0.29	125	1.5	1.5	2.0	2.0	2.0
105 - 140	0.21 - 0.28	100	1.0	1.0	1.5	1.5	1.5
40 -60	0.21 - 0.27	75	0.5	0.5	1.0	1.0	1.0
<40	0.20 - 0.26	50	0.5	1.0	1.0	1.0	1.5

Note – The above table is not representative of the applicability of the measure and does not reflect any limitations in the web-based calculator. This is merely the requirements cited by the IECC 2024 code for pipe insulation.

This measure was developed to be applicable to the following program types: RF, DI

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is installing pipe wrap insulation to a length of pipe. Indoor piping must have at least 1" of insulation (or equivalent R-value) and outdoor piping must have at least 2" of insulation (or equivalent R-value) and include an all-weather protective jacket. Minimum qualifying pipe diameter is 1." Insulation must be continuous and contiguous over fittings that directly connect to straight pipe, including elbows and tees.[765]

DEFINITION OF BASELINE EQUIPMENT

The base case for savings estimates is a bare pipe. Pipes are required by new construction code to be insulated but are still commonly found uninsulated in older commercial buildings.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[766]

[764] International Energy Conservation Code, 2024; Section C403.13.3 Piping Insulation (Mandatory), Table C403.13.3.
[765] *ASHRAE Handbook—Fundamentals*, 23.14; Hart, G., "Saving energy by insulating pipe components on steam and hot water distribution systems", *ASHRAE Journal*, October 2011.
[766] Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

DEEMED MEASURE COST

Actual costs should be used if known. Otherwise, the deemed measure costs below based on RS Means[767] pricing reference materials may be used.[768] The following table summarizes the estimated costs for this measure per foot of insulation added and include installation costs:

1" Insulation Thickness				
Nominal Pipe Size	**1**	**1.5**	**2**	**2.5**
Pipe- RS Means #	220719.10.5140	220719.10.5160	220719.10.5170	220719.10.5180
Jacket- RS Means #	220719.30.0140 & 220719.40.0200	220719.30.0150 & 220719.40.0220	220719.30.0152 & 220719.40.0240	220719.30.0154 & 220719.40.0260
Pipe Insulation Type	Calcium Silicate	Calcium Silicate	Calcium Silicate	Calcium Silicate
Jacket Type (Indoor)	PVC	PVC	PVC	PVC
Jacket Type (Outdoor)	Aluminum	Aluminum	Aluminum	Aluminum
Insulation Cost per foot [1]	$10.32	$10.65	$11.52	$11.82
Jacket Cost per foot (Indoor) [2]	$5.83	$6.09	$6.30	$6.59
Jacket Cost per foot (Outdoor) [3]	$7.40	$7.66	$8.07	$8.26
Total Cost per foot (Indoor) = [1+2]	**$16.15**	**$16.74**	**$17.82**	**$18.41**
Total Cost per foot (Outdoor) = [1+3]	**$17.72**	**$18.31**	**$19.59**	**$20.08**

1" Insulation Thickness (continued)		
Nominal Pipe Size	**3**	**4**
Pipe- RS Means #	220719.10.5190	Extrapolated
Jacket- RS Means #	220719.30.0156 & 220719.40.0280	220719.30.0160 & 220719.40.0320
Pipe Insulation Type	Calcium Silicate	Calcium Silicate
Jacket Type (Indoor)	PVC	PVC
Jacket Type (Outdoor)	Aluminum	Aluminum
Insulation Cost per foot [1]	$12.65	$14.61
Jacket Cost per foot (Indoor) [2]	$6.83	$7.74
Jacket Cost per foot (Outdoor) [3]	$8.89	$10.07
Total Cost per foot (Indoor) = [1+2]	**$19.48**	**$22.35**
Total Cost per foot (Outdoor) = [1+3]	**$21.54**	**$24.68**

[767] RS Means 2026. Mechanical Cost Data, plumbing category, piping insulation and protective jackets. Std Union labor, location selected as Springfield, IL (Q1 2026). See reference doc "RS Means.xlsx"
[768] RS Means 2010: "for fittings, add 3 linear feet for each fitting plus 4 linear feet for each flange of the fitting"

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Δtherms per foot[769] $= [((Q_{base} - Q_{eff}) * EFLH) / (100{,}000 * \eta_{Boiler})] * TRF$

$= [Modeled\ or\ provided\ by\ tables\ below] * TRF$

Δtherms $= (L_{sp} + L_{oc,i}) * \Delta therms\ per\ foot$

Where:

EFLH = Equivalent Full Load Hours for Heating in Existing Buildings or New Construction

= Actual, or defaults by building type provided in Section 4.4, HVAC end use

For year-round recirculation or domestic hot water:

= 8,766

For heating season recirculation, hours with the outside air temperature below 55°F:

Zone	Hours
Zone 1 (Rockford)	5,039
Zone 2 (Chicago)	4,963
Zone 3 (Springfield)	4,495
Zone 4 (Belleville/	4,021
Zone 5 (Marion)	4,150

Q_{base} = Heat Loss from Bare Pipe (Btu/hr/ft)

= Calculated where possible using 3E Plusv4.1 software. For defaults see table below

Q_{eff} = Heat Loss from Insulated Pipe (Btu/hr/ft)

= Calculated where possible using 3E Plusv4.1 software. For defaults see table below

100,000 = conversion factor (1 therm = 100,000 Btu)

[769]This value comes from the reference table "Savings Summary by Building Type and System Type." The formula and the input tables in this section document assumptions used in calculation spreadsheet "Pipe Insulation Savings 2013-11-12.xlsx".

η_{Boiler} = Efficiency of the boiler being used to generate the hot water or steam in the pipe

= Actual or if unknown use default values given below:

= 80% for hot water boilers [770]

= 79% for steam boilers [771]

TRF = Thermal Regain Factor for pipe location and use, see table below. The Custom TRF option may be used on any pipe location, including pipe locations with deemed TRFs specifically listed in the table below, if supporting justification and calculations for the Custom TRF are provided.

May vary seasonally such as: TRF[summer] * summer hours + TRF[winter] * winter hours where TRF values reflecting summer and winter conditions are apportioned by the hours for those conditions. TRF may also be adjusted by building specific balance point temperature (BPT) and operating hours above and below that BPT.[772]

Pipe Location	Assumed Regain	TRF, Thermal Regain Factor
Outdoor	0%	1.0
Indoor, conditioned space during the heating season, 55°F BPT	85%	0.15
Indoor, conditioned space, not during the heating season, 55°F BPT	0%	1.0
Indoor, conditioned, annual use (e.g., hot water or process loads), 55°F BPT	45%	0.55
Indoor, semi- conditioned, (unconditioned space, with heat transfer to conditioned space. E.g., boiler room, ceiling plenum, basement, crawlspace, wall), during the heating season, 55°F BPT	30%	0.70
Indoor, semi-conditioned, not during the heating season, 55°F BPT	0%	1.0
Indoor, semi-conditioned, annual use, 55°F BPT	16%	0.84
Indoor, unconditioned spaces, (no heat transfer to conditioned space)	0%	1.0
Location not specified - Commercial	23%	0.77
Location not specified – Industrial	16%	0.84
Custom	Custom	1 – assumed regain

L_{sp} = Length of straight pipe to be insulated (linear foot)

= actual installed (linear foot)

$L_{oc,I}$ = Total equivalent length of the other components (valves and tees) of pipe to be insulated

[770] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

[771] Ibid.

[772] Zimmerman, Cliff, Franklin Energy, "Thermal Regain Factor_4-30-14.docx", 2014. Based on climate zone 2. Note 'Location not specified – Commercial' assumes semi-conditioned spaces with 50% pipes providing space heating and 50% providing DHW. 'Location not specified – Commercial' assumes semi-conditioned annual usage.

= Actual installed (linear foot). See table "Equivalent Length of Other Components – Elbows and Tees" for equivalent lengths.

The heat loss estimates (Q_{base} and Q_{eff}) were developed using the 3E Plus v4.1 software program.[773] The energy savings analysis is based on adding 1-inch (indoor) or 2-inch (outdoor) thick insulation around bare pipe. The thermal conductivity of pipe insulation varies by material and temperature rating; to obtain a typical value, a range of materials allowed for this measure were averaged. For insulation materials not in the table below, use 3E Plusv4.0 software to calculate Q_{base} and $Q_{eff.}$

Insulation Type	Conductivity (Btu.in / hr.ft^2.ºF @ 75F)	Max temp (ºF)
Polyethylene foam	0.25	200
Flexible polyurethane-based foam	0.27	200
Fiberglass	0.31	250
Melamine foam	0.26	350
Flexible silicon foam	0.40	392
Calcium silicate	0.40	1200
Cellular glass	0.31	400
Average conductivity of all these materials (Btu.in / hr.ft^2.ºF @ 75ºF)	0.31	

The pipe fluid temperature assumption used depends upon both the system type and whether there are outdoor reset controls:

System Type	Fluid temperature assumption (˚F)
Hot Water space heating with outdoor reset - Non recirculation	145
Hot Water space heating without outdoor reset - Non recirculation	170
Hot Water space heating with outdoor reset – Recirculation heating season only	145
Hot Water space heating without outdoor reset – Recirculation heating season only	170
Hot Water space heating with outdoor reset – Recirculation year-round	130
Hot Water space heating without outdoor reset – Recirculation year-round	170
Domestic Hot Water	125
5 psi Steam (low pressure)	225
15 psi Steam (low pressure)	250
40 psi Steam (low pressure)	287
65 psi Steam (high pressure)	312
100 psi Steam (high pressure)	338
150 psi Steam (high pressure)	365

[773] 3E Plus is a heat loss calculation software provided by the NAIMA (North American Insulation Manufacturer Association).

For Example, a DHW water boiler in an unconditioned indoor space with 100 feet of 4" steel pipe, and 20 each of pipe elbows, tees, flanges, and valves installing 2.5" of polyethylene foam would save:

Δtherms per foot=$(((Q_{base} - Q_{eff}) * EFLH) / (100{,}000 * n_{Boiler})) * TRF$

=((((0.8 * 252.6) – (0.25 * 252.6) * 8,766) / (100,000 * 81.9%)) * 0.77

= 11.4 therms per foot

Δtherms = (L_{sp} + L_{oci}) * Δtherms per foot

= (100 + 152.6) * 11.4

= 2,892.3 therms

Example System Types	Indoor Insulation, Hot Water	Indoor Insulation, 5 psi Steam	Indoor Insulation, 65 psi Steam	Domestic Hot Water	Outdoor Insulation, Hot Water	Outdoor Insulation, 5 psi Steam	Outdoor Insulation, 65 psi Steam
Insulation thickness (inch)	1	2	2.5	1	3	3.5	4
Temperature, Fluid in Pipe (°F)	170 (w/o reset) 145 (w/ reset heat) 130 (w/reset year)	225	312	125	170 (w/o reset) 145 (w/ reset heat) 130 (w/reset year)	225	312
Climate Zone	Climate Zone 2: Chicago						
Building Type	Office – Mid Rise						
Operating Time (hrs/yr)	1,629 (non-recirc) 4,963 (recirc heating season) 8,766 (recirc year-round)						
Ambient Temperature (°F)[774]	75	75	75	75	48.6	48.6	48.6
Wind speed (mph)[775]	0	0	0	0	5.0	5.0	5.0
Boiler / Water Heater efficiency	75%	80%	85%	67%	80%	85%	90%
Pipe parameters							
Pipe Location	Indoor Heated	Indoor Semi-heated	Indoor Unheated	n/a	Outdoor		
Pipe material	Copper	Steel	Stainless Steel	Copper	Copper	Steel	Stainless Steel
Length of Pipe (ft)	100						
Pipe size for Heat Loss Calc	2”	2”	2”	2”	2”	2”	2”
Outer Diameter, Pipe, actual	2.38”	2.38”	2.38”	2.38”	2.38”	2.38”	2.38”
Heat Loss, Bare Pipe (from 3EPlus) (Btu/hr·ft)	113.5 (w/o reset) 77.8 (w/ reset heat) 58 (w/reset year)	232.2	286.3	52	460.2 (w/o reset) 363.4 (w/ reset heat) 306 (w/reset year)	709.5	942.2
Insulation parameters							
Average Heat Loss, Insulation (from 3EPlus) (Btu/hr·ft)	21.6 (w/o reset) 15.8 (w/ reset heat) 12.4 (w/reset year)	22.6	31.8	13.25	15.2 (w/o reset) 12.1 (w/ reset heat) 10.2 (w/reset year)	20.4	28.2

[774] DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL for the average ambient temperature for Aurora, IL.
[775] DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL for the average ambient temperature for Aurora, IL.

Example System Types	Indoor Insulation, Hot Water	Indoor Insulation, 5 psi Steam	Indoor Insulation, 65 psi Steam	Domestic Hot Water	Outdoor Insulation, Hot Water	Outdoor Insulation, 5 psi Steam	Outdoor Insulation, 65 psi Steam
Annual Energy Savings/ft							
Annual Gas Use, Base Case (therms/yr/ft)	2.46 (w/o reset) 5.15 (w/ reset heat) 6.78 (w/reset year)	4.73 (non recirc) 14.4 (recirc heat) 25.4 (recirc year)	5.5 (non recirc) 16.7 (recirc heat) 29.5 (recirc year)	6.76	9.37 (w/o reset) 22.5 (w/ reset heat) 33.5 (w/reset year)	13.6 (non recirc) 41.4 (recirc heat) 73.2 (recirc year)	17.1 (non recirc) 52.0 (recirc heat) 91.8 (recirc year)
Annual Gas Use, Measure case (therms/yr/ft)	0.46 (w/o reset) 1.05 (w/ reset heat) 1.48 (w/reset year)	0.43 (non recirc) 1.4 (recirc heat) 2.4 (recirc year)	0.6 (non recirc) 1.8 (recirc heat) 3.2 (recirc year)	1.73	0.3 (w/o reset) 0.7 (w/ reset heat) 1.1 (w/reset year)	0.4 (non recirc) 1.2 (recirc heat) 2.1 (recirc year)	0.6 (non recirc) 1.6 (recirc heat) 2.8 (recirc year)
Annual Gas Savings (therms/yr/ft)	2.0 (w/o reset) 4.1 (w/ reset heat) 5.3 (w/reset year)	4.3 (non recirc) 13.0 (recirc heat) 23.0 (recirc year)	4.9(non recirc) 14.9 (recirc heat) 26.3 (recirc year)	5.02	9.1 (w/o reset) 21.8 (w/ reset heat) 32.4 (w/reset year)	13.2 (non recirc) 40.2 (recirc heat) 71.1 (recirc year)	16.5 (non recirc) 50.4 (recirc heat) 89 (recirc year)
Elbows, Tees, Flanges, & Valves							
Number of Elbows	5	10	20	n/a	5	10	20
Number of Tees	5	10	20	n/a	5	10	20
Number of Flanges	5	10	20	n/a	5	10	20
Number of Valves	5	10	20	n/a	5	10	20
Annual Energy Savings							
Total Gas Savings (therms/yr)	39 (w/o reset) 80 (w/ reset heat) 104 (w/reset year)	478 (non recirc) 1,456 (recirc heat) 2,571 (recirc year)	1,072 (non recirc) 3,267 (recirc heat) 5,770 (recirc year)	502	930 (w/o reset) 2,832 (w/ reset heat) 4,211 (w/reset year)	2,112 (non recirc) 6,434 (recirc heat) 11,364 (recirc year)	3,635 (non recirc) 11,074 (recirc heat) 19,560 (recirc year)

Heat = heating season only, year = year round

Values below must be multiplied by the appropriate Thermal Regain Factor (TRF). All variables were the same except for hours of operation in the calculation of the default savings per foot for the various building types and applications as presented in the table below:

Savings Summary for Indoor pipe insulation by System Type and Building Type (Δtherms per foot) (continues for 3.5 pages)

Location	System Type	Building Type	Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
			Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Indoor	Hot Water Space Heating with outdoor reset – non-recirculation	Assembly	1.32	1.36	1.21	0.81	1.24
		Assisted Living	1.25	1.22	1.07	0.79	0.95
		College	1.13	1.06	0.95	0.53	0.63
		Convenience Store	1.10	1.01	0.90	0.65	0.72
		Elementary School	1.32	1.29	1.13	0.78	0.95
		Garage	0.73	0.72	0.63	0.50	0.56
		Grocery	1.19	1.19	1.04	0.65	0.78
		Healthcare Clinic	1.17	1.20	1.05	0.71	0.75
		High School	1.37	1.38	1.23	0.88	1.03
		Hospital - CAV no econ	1.31	1.35	1.15	0.99	1.12
		Hospital - CAV econ	1.33	1.37	1.17	1.01	1.15
		Hospital - VAV econ	0.54	0.51	0.39	0.23	0.25
		Hospital - FCU	0.98	1.12	0.91	1.07	1.44
		Hotel/Motel	1.31	1.27	1.14	0.78	0.96
		Hotel/Motel - Common	1.19	1.21	1.15	0.93	0.98
		Hotel/Motel - Guest	1.30	1.26	1.13	0.75	0.93
		Manufacturing Facility	0.78	0.75	0.70	0.42	0.47
		MF - High Rise	1.13	1.12	1.02	0.87	0.87
		MF - High Rise - Common	1.35	1.31	1.17	0.81	1.04
		MF - High Rise - Residential	1.09	1.08	0.99	0.85	0.83
		MF - Mid Rise	1.23	1.25	1.07	0.79	0.90
		Movie Theater	1.35	1.33	1.24	0.94	1.12
		Office - High Rise - CAV no econ	1.50	1.52	1.38	0.93	1.01
		Office - High Rise - CAV econ	1.55	1.58	1.45	1.00	1.10
		Office - High Rise - VAV econ	1.13	1.15	0.95	0.56	0.63
		Office - High Rise - FCU	0.83	0.82	0.71	0.37	0.39
		Office - Low Rise	1.06	1.06	0.84	0.51	0.59
		Office - Mid Rise	1.17	1.18	0.99	0.63	0.70
		Religious Building	1.19	1.11	1.07	0.78	0.89
		Restaurant	1.00	1.00	0.90	0.68	0.81
		Retail - Department Store	1.03	0.95	0.89	0.58	0.66
		Retail - Strip Mall	0.99	0.91	0.81	0.56	0.60
		Warehouse	1.08	1.01	1.04	0.65	0.80
		Unknown	1.15	1.14	1.01	0.73	0.84

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Indoor	Hot Water Space Heating without outdoor reset – non-recirculation	Assembly	1.96	2.00	1.79	1.19	1.83
		Assisted Living	1.84	1.80	1.58	1.16	1.40
		College	1.67	1.56	1.40	0.78	0.93
		Convenience Store	1.62	1.50	1.33	0.95	1.06
		Elementary School	1.95	1.90	1.68	1.16	1.40
		Garage	1.08	1.06	0.93	0.74	0.82
		Grocery	1.76	1.75	1.54	0.96	1.15
		Healthcare Clinic	1.73	1.77	1.55	1.05	1.11
		High School	2.02	2.03	1.82	1.30	1.52
		Hospital - CAV no econ	1.93	1.99	1.69	1.46	1.65
		Hospital - CAV econ	1.96	2.03	1.73	1.50	1.70
		Hospital - VAV econ	0.80	0.76	0.57	0.34	0.37
		Hospital - FCU	1.45	1.65	1.35	1.58	2.13
		Hotel/Motel	1.93	1.87	1.69	1.16	1.41
		Hotel/Motel - Common	1.75	1.78	1.69	1.38	1.45
		Hotel/Motel - Guest	1.92	1.86	1.66	1.11	1.37
		Manufacturing Facility	1.15	1.11	1.03	0.62	0.69
		MF - High Rise	1.67	1.65	1.50	1.28	1.28
		MF - High Rise - Common	1.99	1.93	1.73	1.19	1.54
		MF - High Rise - Residential	1.61	1.60	1.46	1.26	1.23
		MF - Mid Rise	1.82	1.84	1.59	1.17	1.33
		Movie Theater	1.99	1.96	1.83	1.39	1.66
		Office - High Rise - CAV no econ	2.21	2.24	2.04	1.37	1.49
		Office - High Rise - CAV econ	2.29	2.33	2.14	1.48	1.63
		Office - High Rise - VAV econ	1.67	1.70	1.40	0.83	0.93
		Office - High Rise - FCU	1.22	1.21	1.04	0.55	0.58
		Office - Low Rise	1.56	1.56	1.24	0.76	0.87
		Office - Mid Rise	1.73	1.74	1.47	0.94	1.04
		Religious Building	1.75	1.65	1.58	1.15	1.32
		Restaurant	1.48	1.48	1.33	1.01	1.19
		Retail - Department Store	1.52	1.40	1.31	0.85	0.97
		Retail - Strip Mall	1.46	1.35	1.19	0.82	0.89
		Warehouse	1.59	1.49	1.53	0.96	1.18
		Unknown	1.70	1.68	1.50	1.07	1.25
	Hot Water with outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	3.73	3.68	3.33	2.98	3.08
	Hot Water w/o outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	5.51	5.43	4.92	4.40	4.54
	Hot Water with outdoor reset	All buildings, Recirculation year round (All hours)	4.79	4.79	4.79	4.79	4.79
	Hot Water w/o outdoor reset	All buildings, Recirculation year round (All hours)	9.58	9.58	9.58	9.58	9.58
	Domestic Hot Water	DHW circulation loop	5.02	5.02	5.02	5.02	5.02

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
	LP Steam – non-recirculation	Assembly	4.25	4.36	3.89	2.59	3.97
		Assisted Living	4.01	3.92	3.44	2.53	3.04
		College	3.64	3.40	3.04	1.69	2.02
		Convenience Store	3.52	3.26	2.89	2.07	2.32
		Elementary School	4.24	4.13	3.64	2.52	3.05
		Garage	2.34	2.31	2.03	1.62	1.79
		Grocery	3.83	3.81	3.34	2.08	2.49
		Healthcare Clinic	3.76	3.85	3.36	2.29	2.42
		High School	4.39	4.42	3.96	2.82	3.30
		Hospital - CAV no econ	4.20	4.33	3.69	3.17	3.60
		Hospital - CAV econ	4.25	4.41	3.76	3.26	3.70
		Hospital - VAV econ	1.74	1.65	1.24	0.75	0.81
		Hospital - FCU	3.15	3.60	2.93	3.44	4.63
		Hotel/Motel	4.19	4.07	3.67	2.51	3.07
		Hotel/Motel - Common	3.81	3.87	3.68	3.00	3.15
		Hotel/Motel - Guest	4.18	4.05	3.62	2.42	2.98
		Manufacturing Facility	2.49	2.41	2.23	1.35	1.51
		MF - High Rise	4.52	4.46	4.07	3.46	3.47
		MF - High Rise - Common	5.38	5.22	4.68	3.23	4.17
		MF - High Rise - Residential	4.37	4.34	3.94	3.41	3.33
		MF - Mid Rise	4.94	4.99	4.30	3.16	3.60
		Movie Theater	4.33	4.26	3.98	3.03	3.61
		Office - High Rise - CAV no econ	4.81	4.88	4.45	2.98	3.24
		Office - High Rise - CAV econ	4.97	5.07	4.66	3.21	3.54
		Office - High Rise - VAV econ	3.64	3.71	3.06	1.81	2.01
		Office - High Rise - FCU	2.66	2.62	2.27	1.20	1.26
		Office - Low Rise	3.40	3.39	2.69	1.65	1.89
		Office - Mid Rise	3.77	3.78	3.19	2.03	2.26
		Religious Building	3.82	3.58	3.43	2.51	2.87
		Restaurant	3.21	3.22	2.89	2.19	2.60
		Retail - Department Store	3.31	3.04	2.86	1.86	2.12
		Retail - Strip Mall	3.17	2.94	2.59	1.79	1.93
		Warehouse	3.46	3.23	3.33	2.08	2.56
		Unknown	3.70	3.66	3.26	2.34	2.71
	LP Steam	All buildings, Recirculation heating season only (Hours below 55F)	11.99	11.81	10.70	9.57	9.88
	LP Steam	All buildings, Recirculation year round (All hours)	20.84	20.84	20.84	20.84	20.84

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
	HP Steam – non-recirculation	Assembly	8.02	8.22	7.34	4.89	7.49
		Assisted Living	7.56	7.39	6.49	4.77	5.73
		College	6.87	6.42	5.73	3.18	3.81
		Convenience Store	6.65	6.14	5.45	3.91	4.37
		Elementary School	8.00	7.79	6.87	4.75	5.76
		Garage	4.42	4.35	3.82	3.05	3.38
		Grocery	7.22	7.19	6.30	3.93	4.70
		Healthcare Clinic	7.09	7.27	6.35	4.32	4.57
		High School	8.28	8.34	7.48	5.33	6.23
		Hospital - CAV no econ	7.92	8.16	6.95	5.98	6.79
		Hospital - CAV econ	8.03	8.32	7.09	6.14	6.98
		Hospital - VAV econ	3.28	3.12	2.35	1.41	1.53
		Hospital - FCU	5.95	6.79	5.53	6.50	8.73
		Hotel/Motel	7.91	7.69	6.93	4.74	5.79
		Hotel/Motel - Common	7.18	7.30	6.95	5.65	5.94
		Hotel/Motel - Guest	7.89	7.64	6.83	4.57	5.62
		Manufacturing Facility	4.70	4.55	4.22	2.55	2.84
		MF - High Rise	6.85	6.76	6.16	5.25	5.26
		MF - High Rise - Common	8.15	7.91	7.09	4.89	6.31
		MF - High Rise - Residential	6.62	6.57	5.97	5.17	5.04
		MF - Mid Rise	7.48	7.57	6.51	4.79	5.46
		Movie Theater	8.16	8.04	7.52	5.71	6.80
		Office - High Rise - CAV no econ	9.07	9.20	8.39	5.62	6.12
		Office - High Rise - CAV econ	9.38	9.57	8.80	6.06	6.67
		Office - High Rise - VAV econ	6.86	6.99	5.76	3.41	3.80
		Office - High Rise - FCU	5.02	4.95	4.27	2.27	2.38
		Office - Low Rise	6.41	6.40	5.08	3.11	3.56
		Office - Mid Rise	7.12	7.12	6.03	3.84	4.27
		Religious Building	7.20	6.75	6.46	4.73	5.41
		Restaurant	6.06	6.08	5.46	4.13	4.90
		Retail - Department Store	6.25	5.74	5.39	3.51	4.00
		Retail - Strip Mall	5.98	5.54	4.89	3.37	3.63
		Warehouse	6.53	6.09	6.29	3.93	4.84
		Unknown	6.97	6.91	6.14	4.41	5.11
	HP Steam	All buildings, Recirculation heating season only (Hours below 55F)	22.62	22.28	20.18	18.05	18.63
	HP Steam	All buildings, Recirculation year round (All hours)	39.32	39.32	39.32	39.32	39.32

Savings Summary for Outdoor pipe insulation by System Type and Building Type (Δtherms per foot) (continues for 3.5 pages)

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Outdoor	Hot Water Space Heating with outdoor reset – non-recirculation	Assembly	5.61	5.75	5.14	3.42	5.24
		Assisted Living	5.28	5.17	4.54	3.34	4.01
		College	4.80	4.49	4.00	2.23	2.66
		Convenience Store	4.65	4.29	3.81	2.74	3.06
		Elementary School	5.59	5.45	4.81	3.32	4.03
		Garage	3.09	3.04	2.67	2.13	2.36
		Grocery	5.05	5.03	4.41	2.75	3.29
		Healthcare Clinic	4.96	5.08	4.44	3.03	3.20
		High School	5.79	5.83	5.23	3.72	4.36
		Hospital - CAV no econ	5.54	5.71	4.86	4.18	4.74
		Hospital - CAV econ	5.62	5.82	4.96	4.30	4.88
		Hospital - VAV econ	2.29	2.18	1.64	0.98	1.07
		Hospital - FCU	4.16	4.75	3.87	4.54	6.11
		Hotel/Motel	5.53	5.37	4.85	3.32	4.05
		Hotel/Motel - Common	5.02	5.11	4.86	3.95	4.15
		Hotel/Motel - Guest	5.52	5.34	4.77	3.20	3.93
		Manufacturing Facility	3.29	3.18	2.95	1.78	1.99
		MF - High Rise	4.80	4.73	4.31	3.67	3.68
		MF - High Rise - Common	5.70	5.54	4.96	3.42	4.41
		MF - High Rise - Residential	4.63	4.60	4.17	3.62	3.53
		MF - Mid Rise	5.23	5.29	4.55	3.35	3.82
		Movie Theater	5.71	5.62	5.25	4.00	4.76
		Office - High Rise - CAV no econ	6.34	6.44	5.87	3.93	4.28
		Office - High Rise - CAV econ	6.56	6.69	6.16	4.24	4.67
		Office - High Rise - VAV econ	4.80	4.89	4.03	2.38	2.66
		Office - High Rise - FCU	3.52	3.46	2.99	1.58	1.67
		Office - Low Rise	4.48	4.48	3.55	2.18	2.49
		Office - Mid Rise	4.98	4.98	4.22	2.69	2.98
		Religious Building	5.03	4.72	4.52	3.31	3.78
		Restaurant	4.24	4.26	3.82	2.89	3.43
		Retail - Department Store	4.37	4.01	3.77	2.45	2.80
		Retail - Strip Mall	4.18	3.87	3.42	2.36	2.55
		Warehouse	4.57	4.26	4.40	2.75	3.38
		Unknown	4.88	4.83	4.30	3.09	3.57
	Hot Water Space Heating without outdoor reset – non-recirculation	Assembly	7.10	7.27	6.49	4.33	6.63
		Assisted Living	6.69	6.53	5.74	4.22	5.08
		College	6.08	5.68	5.07	2.81	3.37
		Convenience Store	5.88	5.43	4.82	3.46	3.86
		Elementary School	7.07	6.90	6.08	4.20	5.10
		Garage	3.91	3.85	3.38	2.70	2.99
		Grocery	6.39	6.36	5.58	3.48	4.16
		Healthcare Clinic	6.27	6.44	5.62	3.83	4.05
		High School	7.33	7.38	6.62	4.71	5.51
		Hospital - CAV no econ	7.01	7.22	6.15	5.29	6.00

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
		Hospital - CAV econ	7.10	7.36	6.28	5.44	6.17
		Hospital - VAV econ	2.91	2.76	2.07	1.24	1.35
		Hospital - FCU	5.26	6.01	4.89	5.75	7.73
		Hotel/Motel	6.99	6.80	6.13	4.20	5.12
		Hotel/Motel - Common	6.36	6.46	6.15	5.00	5.25
		Hotel/Motel - Guest	6.99	6.76	6.04	4.05	4.97
		Manufacturing Facility	4.17	4.03	3.73	2.26	2.52
		MF - High Rise	6.06	5.98	5.45	4.64	4.65
		MF - High Rise - Common	7.21	7.00	6.28	4.33	5.58
		MF - High Rise - Residential	5.86	5.82	5.28	4.57	4.46
		MF - Mid Rise	6.62	6.70	5.76	4.24	4.83
		Movie Theater	7.22	7.11	6.65	5.05	6.02
		Office - High Rise - CAV no econ	8.02	8.15	7.42	4.97	5.42
		Office - High Rise - CAV econ	8.30	8.47	7.78	5.37	5.91
		Office - High Rise - VAV econ	6.07	6.19	5.10	3.01	3.36
		Office - High Rise - FCU	4.44	4.37	3.78	2.01	2.10
		Office - Low Rise	5.68	5.66	4.50	2.75	3.15
		Office - Mid Rise	6.30	6.30	5.34	3.40	3.77
		Religious Building	6.37	5.97	5.72	4.19	4.79
		Restaurant	5.37	5.38	4.83	3.66	4.33
		Retail - Department Store	5.53	5.08	4.77	3.10	3.54
		Retail - Strip Mall	5.29	4.90	4.33	2.98	3.22
		Warehouse	5.78	5.39	5.56	3.47	4.28
		Unknown	6.17	6.11	5.44	3.90	4.52
	Hot Water with outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	15.82	15.58	14.11	12.62	13.03
	Hot Water without outdoor reset	All buildings, Recirculation heating season only (Hours below 55F)	20.02	19.71	17.86	15.97	16.49
	Hot Water with outdoor reset	All buildings, Recirculation year round (All hours)	23.16	23.16	23.16	23.16	23.16
	Hot Water without outdoor reset	All buildings, Recirculation year round (All hours)	34.79	34.79	34.79	34.79	34.79
	LP Steam – non-recirculation	Assembly	11.11	11.38	10.16	6.77	10.37
		Assisted Living	10.46	10.23	8.99	6.61	7.94
		College	9.51	8.89	7.93	4.40	5.28
		Convenience Store	9.21	8.50	7.55	5.42	6.05
		Elementary School	11.07	10.79	9.52	6.57	7.98
		Garage	6.12	6.02	5.29	4.23	4.68
		Grocery	10.00	9.96	8.73	5.45	6.50
		Healthcare Clinic	9.81	10.07	8.79	5.99	6.33
		High School	11.47	11.54	10.35	7.38	8.63
		Hospital - CAV no econ	10.97	11.30	9.63	8.28	9.40
		Hospital - CAV econ	11.11	11.52	9.82	8.51	9.66
		Hospital - VAV econ	4.54	4.32	3.25	1.95	2.11
		Hospital - FCU	8.24	9.41	7.66	9.00	12.10
		Hotel/Motel	10.95	10.64	9.60	6.56	8.02
		Hotel/Motel - Common	9.95	10.11	9.62	7.83	8.23

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
		Hotel/Motel - Guest	10.93	10.57	9.46	6.33	7.78
		Manufacturing Facility	6.51	6.30	5.84	3.53	3.94
		MF - High Rise	11.82	11.66	10.63	9.05	9.07
		MF - High Rise - Common	14.05	13.65	12.23	8.43	10.89
		MF - High Rise - Residential	11.42	11.33	10.30	8.92	8.70
		MF - Mid Rise	12.90	13.05	11.23	8.26	9.41
		Movie Theater	11.30	11.14	10.41	7.91	9.42
		Office - High Rise - CAV no econ	12.56	12.74	11.62	7.78	8.47
		Office - High Rise - CAV econ	12.99	13.25	12.19	8.40	9.24
		Office - High Rise - VAV econ	9.49	9.69	7.98	4.71	5.26
		Office - High Rise - FCU	6.96	6.85	5.92	3.15	3.29
		Office - Low Rise	8.88	8.86	7.04	4.31	4.93
		Office - Mid Rise	9.86	9.86	8.35	5.31	5.91
		Religious Building	9.97	9.35	8.95	6.56	7.50
		Restaurant	8.39	8.42	7.56	5.72	6.78
		Retail - Department Store	8.65	7.95	7.46	4.85	5.54
		Retail - Strip Mall	8.28	7.67	6.77	4.67	5.03
		Warehouse	9.05	8.44	8.71	5.44	6.70
		Unknown	9.66	9.57	8.51	6.11	7.08
	LP Steam	All buildings, Recirculation heating season only (Hours below 55F)	31.32	30.85	27.94	25.00	25.80
	LP Steam	All buildings, Recirculation year round (All hours)	54.46	54.46	54.46	54.46	54.46
	HP Steam – non-recirculation	Assembly	17.20	17.62	15.73	10.48	16.06
		Assisted Living	16.20	15.84	13.91	10.23	12.29
		College	14.73	13.76	12.28	6.82	8.17
		Convenience Store	14.25	13.16	11.68	8.38	9.36
		Elementary School	17.14	16.70	14.73	10.18	12.35
		Garage	9.47	9.32	8.20	6.54	7.24
		Grocery	15.47	15.41	13.51	8.43	10.07
		Healthcare Clinic	15.19	15.59	13.61	9.27	9.81
		High School	17.75	17.87	16.03	11.42	13.36
		Hospital - CAV no econ	16.98	17.49	14.90	12.82	14.55
		Hospital - CAV econ	17.21	17.83	15.20	13.17	14.96
		Hospital - VAV econ	7.04	6.68	5.02	3.02	3.27
		Hospital - FCU	12.76	14.56	11.85	13.93	18.73
		Hotel/Motel	16.95	16.48	14.86	10.17	12.41
		Hotel/Motel - Common	15.40	15.65	14.90	12.12	12.74
		Hotel/Motel - Guest	16.92	16.38	14.64	9.80	12.05
		Manufacturing Facility	10.09	9.75	9.04	5.46	6.10
		MF - High Rise	14.69	14.50	13.22	11.25	11.28
		MF - High Rise - Common	17.46	16.96	15.21	10.48	13.53
		MF - High Rise - Residential	14.19	14.08	12.80	11.09	10.81
		MF - Mid Rise	16.04	16.22	13.96	10.26	11.70
		Movie Theater	17.49	17.23	16.12	12.25	14.59
		Office - High Rise - CAV no econ	19.44	19.73	17.98	12.05	13.12
		Office - High Rise - CAV econ	20.10	20.51	18.86	13.00	14.30

			Annual therm Savings per linear foot (therm /ft) (2" pipe / 1" insulation for hot water, 2" insulation for steam)				
Location	System Type	Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
		Office - High Rise - VAV econ	14.70	14.99	12.36	7.30	8.14
		Office - High Rise - FCU	10.76	10.60	9.16	4.86	5.10
		Office - Low Rise	13.75	13.71	10.89	6.66	7.63
		Office - Mid Rise	15.25	15.27	12.92	8.23	9.15
		Religious Building	15.43	14.47	13.85	10.15	11.60
		Restaurant	12.99	13.03	11.70	8.85	10.49
		Retail - Department Store	13.39	12.31	11.55	7.52	8.57
		Retail - Strip Mall	12.82	11.87	10.49	7.23	7.79
		Warehouse	14.01	13.06	13.48	8.41	10.37
		Unknown	14.95	14.81	13.17	9.45	10.96
	HP Steam	All buildings, Recirculation heating season only (Hours below 55F)	48.49	47.76	43.25	38.69	39.94
	HP Steam	All buildings, Recirculation year round (All hours)	84.30	84.30	84.30	84.30	84.30

For insulation covering elbows and tees that connect straight pipe, a calculated surface area will be assumed based on the dimensions for fittings given by ANSI/ASME B36.19. The surface area is then converted to an equivalent length of pipe, that must be added to the total length of straight pipe to calculate total savings. Equivalent pipe lengths are given in 1" increments in pipe diameter for simplicity. In the case of pipe diameters in between full inch diameters, interpolation should be used to determine the equivalent length. The larger pipe sizes mostly apply to steam header piping, which has the most heat loss per foot.

Calculated Surface Areas of Elbows and Tees

Nominal Pipe Diameter	Calculated Surface Area (ft)	
	90 Degree Elbow[776]	Straight Tee[777]
1"	0.10	0.13
2"	0.41	0.39
3"	0.93	0.77
4"	1.64	1.21
5"	2.57	1.77
6"	3.70	2.44
8"	6.58	3.95
10"	10.28	5.98
12"	14.80	8.34

Equivalent Length of Other Components – Elbows and Tees (L_{oc})

Nominal Pipe Diameter	Equivalent Length of Other Components (ft)	
	90 Degree Elbow	Straight Tee
1"	0.30	0.38
2"	0.66	0.63
3"	1.01	0.84
4"	1.40	1.03

[776] Based on the dimensions for diameter, long radius, and short radius given by ANSI/ASME 36.19.
[777] Based on the center to face and diameter dimensions given by ANSI/ASME B36.19.

Nominal Pipe Diameter	Equivalent Length of Other Components (ft)	
	90 Degree Elbow	Straight Tee
5”	1.76	1.22
6”	2.13	1.41
8”	2.91	1.75
10”	3.65	2.13
12”	4.44	2.50

For insulation around valves or flanges, a surface area from ASTM standard C1129-12 will be assumed for 2” pipes. For 1” pipes, which weren’t included in the standard, a linear-trended value will be used. The surface area is then converted to an equivalent length of either 1” or 2” straight pipe that must be added to the total length of straight pipe to calculate total savings.

Calculated Surface Areas of Flanges and Valves

Valves				
ANSI Class	150	300	600	900
NPS (in)	ft^2	ft^2	ft^2	ft^2
1	0.69	1.8	1.8	2.4
2	2.21	2.94	2.94	5.2
2.5	2.97	3.51	3.91	6.6
3	3.37	4.39	4.69	6.5
4	4.68	6.06	7.64	9.37
6	7.03	9.71	13.03	15.8
8	10.3	13.5	18.4	23.8
10	13.8	18	26.5	32.1
12	16.1	24.1	31.9	41.9

Flanges				
ANSI Class	150	300	600	900
NPS (in)	ft^2	ft^2	ft^2	ft^2
1	0.36	0.36	0.4	1.23
2	0.71	0.84	0.88	1.54
3	1.06	1.32	1.36	1.85
4	1.44	1.83	2.23	2.64
6	2.04	2.72	3.6	4.37
8	2.92	3.74	4.89	6.4
10	3.68	4.8	6.93	8.47
12	5.01	6.34	7.97	10.43

Equivalent Length of Other Components - Flanges and Valves (L_{oc})

ANSI Class	Equivalent Length of Other Components (ft)			
	1” Valve	1” Flange	2” Valve	2” Flange
150	2.00	1.04	3.56	1.14
300	5.22	1.04	4.73	1.35
600	5.22	1.16	4.73	1.42
900	6.96	3.57	8.37	2.48
ANSI Class	3" Valve	3" Flange	4" Valve	4" Flange
150	3.67	1.16	3.98	1.22
300	4.79	1.44	5.15	1.56
600	5.11	1.48	6.49	1.90
900	7.09	2.02	7.96	2.24

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-PINS-V11-270101

REVIEW DEADLINE: 1/1/2031

4.4.15 Single-Package and Split System Unitary Air Conditioners

DESCRIPTION

This measure promotes the installation of high-efficiency unitary air-, water-, and evaporatively-cooled air conditioning equipment, both single-package and split systems. Air conditioning (AC) systems are a major consumer of electricity and systems that exceed baseline efficiency requirements can significantly reduce energy consumption. This measure could apply to the replacing of an existing unit at the end of its useful life or the installation of a new unit in a new or existing building.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a high-efficiency air-, water-, or evaporatively-cooled air conditioner that exceeds the energy efficiency requirements as prescribed by the program.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a standard-efficiency air-, water, or evaporatively-cooled air conditioner that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date is unknown, assume current Code minimum).

For Early Replacement programs, use the actual efficiency of the existing unit or assume IECC code base in place at the original time of existing unit installation. To qualify under the early replacement characterization, baseline equipment must meet these additional qualifications:

- The existing unit is operational when replaced or the existing unit would be operational with minor repairs.[778]

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. If evaluation determines the applicable version of code, given location and timing, isn't an appropriate baseline due to supply constraints, low compliance, or other issues, the previous iteration of code may be used through 2023.

IECC 2021 and 2024 leverage new DOE testing methods and associated metrics. The following conversion factors are recommended for use if the efficient equipment is not rated under the new testing procedure but the stipulated baseline is:[779]

SEER2 = X * SEER

EER2 = X * EER

HSPF2 = X * HSPF

Where:

[778] Based on ComEd Small Business Trade Ally feedback. For units rated at less than 20 ton units, the cost of common repairs is under $2,000, significantly less than the cost of purchasing new equipment. Therefore, if the cost of repair is less than $2,000, it can be considered early replacement because customers would repair instead of replace a failed unit. Repair cost data was not available for units larger than 20 tons.

[779] Consortium for Energy Efficiency (CEE), Testing, Testing, M1, 2, 3, Transitioning to New Federal Minimum Standards, CEE Summer Program Meeting, August, 2022.

X	SEER2	EER2	HSPF2
Ducted	0.95	0.95	0.85
Ductless	1.00	1.00	0.90
Packaged	0.95	0.95	0.84

Note: new Federal Standards affecting heat pumps and air conditioning equipment became effective January 1, 2025.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[780]

For early replacement, the remaining life of existing equipment is assumed to be 5 years.[781]

DEEMED MEASURE COST

The incremental capital cost for this measure is based upon capacity and efficiency level (defined be CEE specifications),[782] as outlined in the following table:[783]

	Incremental cost ($/ton)	
Capacity	Up to and including CEE Tier 1 units	CEE Tier 2 and above
< 135,000 Btu/hr	$63	$127
135,000 Btu/hr to > 250,000 Btu/hr	$63	$127
250,000 Btu/hr and greater	$19	$38

For early replacement, the full cost of the installed unit should be used. If unknown use defaults below. The assumed deferred cost (after 5 years) of replacing existing equipment with a new baseline unit is also provided. This future cost should be discounted to present value using the real discount rate:

	Full Install Cost ($/ton)		
Capacity	Base Units	Up to and including CEE Tier 1 units	CEE Tier 2 and above
< 135,000 Btu/hr	$895	$958	$1,021
135,000 Btu/hr to > 250,000 Btu/hr	$762	$825	$889
250,000 Btu/hr and greater	$673	$691	$710

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

[780] Measure Life Report: Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, Inc., June 2007.
[781] Assumed to be one third of effective useful life.
[782] CEE Commercial Unitary Air-conditioning and Heat Pumps Specification, which provides high efficiency performance specifications for single-package and split system unitary air conditioners.
[783] NEEP Incremental Cost Study (ICS) Final Report – Phase 3, May 2014.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)
= 91.3% [784]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)
= 47.8% [785]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Time of Sale:

For units with cooling capacities less than 65 kBtu/hr:

$$\Delta kWH = (kBtu/hr) * [\frac{1}{SEER2base} - \frac{1}{SEER2ee}] * EFLH$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

$$\Delta kWH = (kBtu/hr) * [\frac{1}{IEERbase} - \frac{1}{IEERee}] * EFLH$$

Early replacement:[786]

For units with cooling capacities less than 65 kBtu/hr:

For remaining life of existing unit (1st 5 years):

$$\Delta kWH = (kBtu/hr) * [\frac{1}{SEER2exist} - \frac{1}{SEER2ee}] * EFLH$$

For remaining measure life (next 10 years):

$$\Delta kWH = (kBtu/hr) * [\frac{1}{SEER2base} - \frac{1}{SEER2ee}] * EFLH$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

For remaining life of existing unit (1st 5 years):

$$\Delta kWH = (kBtu/hr) * [\frac{1}{IEERexist} - \frac{1}{IEERee}] * EFLH$$

NOTE: If the existing equipment age is such that IEER ratings are not available, EER may be substitued when necessary. In such instances both existing and efficient unit efficiencies should be specified in EER.

For remaining measure life (next 10 years):

$$\Delta kWH = (kBtu/hr) * [\frac{1}{IEERbase} - \frac{1}{IEERee}] * EFLH$$

Where:

[784] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[785] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.
[786] The two equations are provided to show how savings are determined during the initial phase of the measure (existing to efficient) and the remaining phase (new baseline to efficient). In practice, the screening tools used may either require a First Year savings (using the first equation) and then a "number of years to adjustment" and "savings adjustment" input which would be the (new base to efficient savings)/(existing to efficient savings).

kBtu/hr	= capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)
$SEER2_{base}$	= Seasonal Energy Efficiency Ratio of the baseline equipment
	= SEER2 values from tables below, based on applicable Code on date of equipment purchase (if unknown assume current Code).
$SEER2_{ee}$	= Seasonal Energy Efficiency Ratio of the energy efficient equipment (actually installed)
$SEE2R_{exist}$	= Seasonal Energy Efficiency Ratio of the existing equipment
	= Actual, or assume Code base in place at the original time of existing unit installation
$IEER_{base}$	= Integrated Energy Efficiency Ratio of the baseline equipment. See table below based on applicable Code on date of equipment purchase (if unknown assume current Code).
$IEER_{ee}$	= Integrated Energy Efficiency Ratio of the energy efficient equipment (actually installed)
$IEER_{exist}$	= Integrated Energy Efficiency Ratio of the existing equipment
	= Actual, or assume Code base in place at the original time of existing unit installation
EFLH	= Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

The rating conditions for the baseline and efficient equipment efficiencies must be equivalent.

Code of Federal Redulations (baseline effective 1/1/2025):[787]

Equipment type	Cooling capacity	Heating type	Efficiency level	Compliance date
Small Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥65,000 Btu/h and <135,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 12.9 IEER = 14.8	1/1/2018 1/1/2023
		All Other Types of Heating	IEER = 12.7 IEER = 14.6	1/1/2018 1/1/2023
Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥135,000 Btu/h and <240,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 12.4 IEER = 14.2	1/1/2018 1/1/2023
		All Other Types of Heating	IEER = 12.2 IEER = 14.0	1/1/2018 1/1/2023
Very Large Commercial Packaged Air Conditioning and Heating Equipment (Air-Cooled)	≥240,000 Btu/h and <760,000 Btu/h	Electric Resistance Heating or No Heating	IEER = 11.6 IEER = 13.2	1/1/2018 1/1/2023
		All Other Types of Heating	IEER = 11.4 IEER = 13.0	1/1/2018 1/1/2023
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Split-System)	<65,000 Btu/h	All	SEER2 = 13.4	1/1/2025
Small Commercial Package Air-Conditioning and Heating Equipment (Air-Cooled, 3-Phase, Single-Package)	<65,000Btu/h	All	SEER2 = 13.4	1/1/2025

[787] Code of Federal Regulations: Table 3 to §431,97 – Updates to Minimum Cooling Efficiency Standards for Air Conditioning and Heating Equipment

2015 IECC Minimum Efficiency Requirements (baseline effective 1/1/2016 to 6/30/2019)

TABLE C403.2.3(1)
MINIMUM EFFICIENCY REQUIREMENTS:
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE[a]
				Before 1/1/2016	As of 1/1/2016	
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split System	13.0 SEER	13.0 SEER	AHRI 210/240
			Single Package	13.0 SEER	14.0 SEER[c]	
Through-the-wall (air cooled)	≤ 30,000 Btu/h[b]	All	Split system	12.0 SEER	12.0 SEER	
			Single Package	12.0 SEER	12.0 SEER	
Small-duct high-velocity (air cooled)	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	11.0 SEER	
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 11.4 IEER	11.2 EER 12.8 IEER	AHRI 340/360
		All other	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.6 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.4 IEER	
		All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 12.2 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 10.1 IEER	10.0 EER 11.6 IEER	
		All other	Split System and Single Package	9.8 EER 9.9 IEER	9.8 EER 11.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 9.8 IEER	9.7 EER 11.2 IEER	
		All other	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 11.0 IEER	
Air conditioners, water cooled	< 65,000 Btu/h[b]	All	Split System and Single Package	12.1 EER 12.3 IEER	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 12.3 IEER	12.1 EER 13.9 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 12.1 IEER	11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.5 EER 12.5 IEER	12.5 EER 13.9 IEER	
		All other	Split System and Single Package	12.3 EER 12.5 IEER	12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.4 EER 12.6 IEER	12.4 EER 13.6 IEER	
		All other	Split System and Single Package	12.2 EER 12.4 IEER	12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.2 EER 12.4 IEER	12.2 EER 13.5 IEER	
		All other	Split System and Single Package	12.0 EER 12.2 IEER	12.0 EER 13.3 IEER	

(continued)

2018 IECC Minimum Efficiency Requirements (baseline effective 7/1/2019 to 12/31/2023)

TABLE C403.3.2(1)
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split System	13.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall (air cooled)	≤ 30,000 Btu/h[b]	All	Split system	12.0 SEER	
			Single Package	12.0 SEER	
Small-duct high-velocity (air cooled)	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 12.8 IEER	AHRI 340/360
		All other	Split System and Single Package	11.0 EER 12.6 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.4 IEER	
		All other	Split System and Single Package	10.8 EER 12.2 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 11.6 IEER	
		All other	Split System and Single Package	9.8 EER 11.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 11.2 IEER	
		All other	Split System and Single Package	9.5 EER 11.0 IEER	
Air conditioners, water cooled	< 65,000 Btu/h[b]	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 13.9 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.5 EER 13.9 IEER	
		All other	Split System and Single Package	12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.4 EER 13.6 IEER	
		All other	Split System and Single Package	12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.2 EER 13.5 IEER	
		All other	Split System and Single Package	12.0 EER 13.3 IEER	

Air conditioners, evaporatively cooled	< 65,000 Btu/h[b]	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.0 EER 12.2 IEER	
		All other	Split System and Single Package	11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.9 EER 12.1 IEER	
		All other	Split System and Single Package	11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.7 EER 11.9 IEER	
		All other	Split System and Single Package	11.5 EER 11.7 IEER	
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

2021 IECC Minimum Efficiency Requirements (effective January 1, 2024 to November 29, 2025)

TABLE C403.3.2(1)
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[c, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	13.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single-package, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	
Space constrained, air cooled	≤ 30,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	
Small duct, high velocity, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 12.1 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	11.2 EER 12.9 IEER before 1/1/2023 14.8 IEER after 1/1/2023	AHRI 340/360
		All other		11.0 EER 12.7 IEER before 1/1/2023 14.6 IEER after 1/1/2023	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		11.0 EER 12.4 IEER before 1/1/2023 14.2 IEER after 1/1/2023	
		All other		10.8 EER 12.2 IEER before 1/1/2023 14.0 IEER after 1/1/2023	

TABLE C403.3.2(1)—continued
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[c, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled *(continued)*	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)	Split system and single package	10.0 EER 11.6 IEER before 1/1/2023 13.2 IEER after 1/1/2023	AHRI 340/360
		All other		9.8 EER 11.4 IEER before 1/1/2023 13.0 IEER after 1/1/2023	
	≥ 760,000 Btu/h	Electric resistance (or none)		9.7 EER 11.2 IEER before 1/1/2023 12.5 IEER after 1/1/2023	
		All other		9.5 EER 11.0 IEER before 1/1/2023 12.3 IEER after 1/1/2023	
Air conditioners, water cooled	< 65,000 Btu/h	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 13.9 IEER	AHRI 340/360
		All other		11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.5 EER 13.9 IEER	
		All other		12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		12.4 EER 13.6 IEER	
		All other		12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		12.2 EER 13.5 IEER	
		All other		12.0 EER 13.3 IEER	

TABLE C403.3.2(1)—continued
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[c, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, evaporatively cooled	< 65,000 Btu/h[b]	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 12.3 IEER	AHRI 340/360
		All other		11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.0 EER 12.2 IEER	
		All other		11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		11.9 EER 12.1 IEER	
		All other		11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		11.7 EER 11.9 IEER	
		All other		11.5 EER 11.7 IEER	
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.

b. Single-phase, US air-cooled air conditioners less than 65,000 Btu/h are regulated as consumer products by the US Department of Energy Code of Federal Regulations DOE 10 CFR 430. SEER and SEER2 values for single-phase products are set by the US Department of Energy.

c. DOE 10 CFR 430 Subpart B Appendix M1 includes the test procedure updates effective 1/1/2023 that will be incorporated in AHRI 210/240—2023.

d. This table is a replica of ASHRAE 90.1 Table 6.8.1-1 Electrically Operated Unitary Air Conditioners and Condensing Units—Minimum Efficiency Requirements.

2024 IECC Minimum Efficiency Requirements (effective November 30, 2025) – Note, for EER ratings to be used in the Summer Coincident Peak Demand Savings algorithm, use values provided in IECC 2021 above.

TABLE C403.3.2(1)—ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[c]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	13.4 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	13.4 SEER2	
Space constrained, air cooled	≤ 30,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	11.7 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	11.7 SEER2	
Small duct, high velocity, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	12. 0 SEER2	AHRI 210/240—2023
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	14.8 IEER	AHRI 340/360
		All other		14.6 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		14.2 IEER	
		All other		14.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)	Split system and single package	13.2 IEER	AHRI 340/360
		All other		13.0 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		12.5 IEER	
		All other		12.3 IEER	
Air conditioners, water cooled	< 65,000 Btu/h	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 13.9 IEER	AHRI 340/360
		All other		11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.5 EER 13.9 IEER	
		All other		12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		12.4 EER 13.6 IEER	
		All other		12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		12.2 EER 13.5 IEER	
		All other		12.0 EER 13.3 IEER	

Air conditioners, evaporatively cooled	< 65,000 Btu/h[b]	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 12.3 IEER	AHRI 340/360
		All other		11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.0 EER 12.2 IEER	
		All other		11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		11.9 EER 12.1 IEER	
		All other		11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		11.7 EER 11.9 IEER	
		All other		11.5 EER 11.7 IEER	
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.

b. Single-phase, US air-cooled air conditioners less than 65,000 Btu/h are regulated as consumer products by the US Department of Energy Code of Federal Regulations DOE 10 CFR 430. SEER and SEER2 values for single-phase products are set by the US Department of Energy.

c. DOE 10 CFR 430 Subpart B Appendix M1 includes the test procedure updates effective January 1, 2023, documented in AHRI 210/240—2023.

For example, a 5 ton air cooled split system with a SEER2 of 15 at an existing retail strip mall in Rockford would save:

ΔkWH = (60) * [(1/13.4) – (1/15)] * 697
= 333 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Time of Sale:

$$\Delta kW = (kBtu/hr) * (\frac{1}{EER2base} - \frac{1}{EER2ee}) * CF$$

Early Replacement:

For remaining life of existing unit (1st 5 years):

$$\Delta kW = (kBtu/hr) * [\frac{1}{EER2exist} - \frac{1}{EER2ee}] * CF$$

For remaining measure life (next 10 years):

$$\Delta kW = (kBtu/hr) * [\frac{1}{EER2base} - \frac{1}{EER2ee}] * CF$$

Where:

$EER2_{base}$ = Energy Efficiency Ratio of the baseline equipment

= EER values from tables above, based on applicable Code on date of equipment purchase (if unknown assume current Code). (For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER to EER for calculation of peak savings:[788] EER = (-0.02 * $SEER^2$) + (1.12 * SEER))

$EER2_{ee}$ = Energy Efficiency Ratio of the energy efficient equipment. If the actual EER_{ee} is unknown, assume the conversion from SEER to EER for calculation of peak savings as above).

= Actual installed

$EER2_{exist}$ = Energy Efficiency Ratio of the existing equipment

= Actual, or assume Code base in place at the original time of existing unit installation

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [789]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [790]

[788] Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.
[789] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[790]Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

For example, a 5 ton air cooled split system with a SEER of 15 in Rockford would save:

ΔkW_{SSP} = (60) * [(1/11.4) – (1/12.3)] * 0.913

= 0.352 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

MEASURE CODE: CI-HVC-SPUA-V13-270101

REVIEW DEADLINE: 1/1/2029

4.4.16 Steam Trap Replacement or Repair

DESCRIPTION

The measure applies to the repair or replacement of steam traps in the failed open state that allow steam to escape the steam distribution system or return to the condensate receiver leading to increased steam generation. The measure is applicable to commercial applications, commercial HVAC (low pressure steam) including multifamily buildings, low pressure industrial applications, medium pressure industrial applications, and high-pressure industrial applications.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a repaired or replaced steam trap that is no longer allowing excess steam to escape.

Customers must have steam traps in the failed open or leaking state to qualify for rebates. However, if a commercial customer opts to replace all traps without inspection, rebates and the savings are discounted to take into consideration the fact that some traps are being replaced that have not yet failed.

DEFINITION OF BASELINE EQUIPMENT

The baseline criterion is a faulty steam trap in the failed open or leaking state. No minimum leak rate is required. Any leaking or blow through trap can be repaired or replaced. If a commercial customer chooses to repair or replace all the steam traps at the facility without verification, the savings are adjusted. Savings for commercial full replacement projects are reduced by the percentage of traps found to be leaking on average from the studies listed. If an audit is performed on a commercial site, then the leaking and blowdown can be adjusted.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

For standard steam traps the life of this measure is 6 years.[791]

For Venturi steam traps the measure life is 20 years if replacing a faulty mechanical steam trap.[792] If replacing an operational mechanical steam trap, the measure life is 14 years, having been reduced by the six-year measure life established for standard steam traps. By applying this conservative approach of reducing the measure life by the full estimated useful life of the existing steam trap, there is no need to survey or produce an inventory of the age of existing steam traps.

Venturi steam traps do not contain any moving parts, and their manufacturers cite this feature for the reduced failure rate leading to longer operational life than mechanical steam traps. Venturi steam traps have been observed to operate in excess of 20 years.[793] Venturi steam traps also typically come with a 10-year warranty that can be extended up to 20 years. Therefore, savings may be claimed on a year-to-year basis for venturi steam traps undergoing annual maintenance that have exhausted their deemed 20-year measure life.

[791] Source paper is the CLEAResult "Steam Traps Revision #1" dated August 2011. Primary studies used to prepare the source paper include Enbridge Steam Trap Survey, KW Engineering Steam Trap Survey, Enbridge Steam Saver Program 2005, Armstrong Steam Trap Survey, DOE Federal Energy Management Program Steam Trap Performance Assessment, Oak Ridge National Laboratory Steam System Survey Guide, KEMA Evaluation of PG&E's Steam Trap Program, Sept. 2007. Communication with vendors suggested an inverted bucket steam trap life typically in the range of 5 - 7 years, float and thermostatic traps 4- 6 years, float and thermodynamic disc traps of 1 - 3 years.

[792] "Venturi Steam Trap – Functional Laboratory Study, GTI on behalf of Illinois utilities, Nicor Gas, Peoples Gas, and North Shore Gas, and on behalf of contributing utilities from other states, March 26, 2019. This report reflects phase 1 of an ongoing field study that will continue data collection to validate useful life and provide information on proper sizing in various end use applications. Additional data expected in 2021.

[793] Ibid. Based on reported age for venturi steam traps currently operating in the field.

DEEMED MEASURE COST

Actual measure costs, including survey and installation costs should be used where available. Default costs per trap are provided below to be used in addition to an estimate of survey and installation costs.

Steam System	Cost per trap[794] ($)
Commercial Dry Cleaners	$77
Commercial Heating (including Multifamily), low pressure steam	$77
Industrial Medium Pressure: 15 < psig < 30	$180
Steam Trap, Industrial Medium Pressure: 30 ≤ psig < 75	$223
Steam Trap, Industrial High Pressure: 75 ≤ psig < 125	$276
Steam Trap, Industrial High Pressure: 125 ≤ psig < 175	$322
Steam Trap, Industrial High Pressure: 175 ≤ psig < 250	$370
Steam Trap, Industrial High Pressure: 250 ≤ psig	$418

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings. These savings only apply to situations in which steam is lost from the steam system.

$$\Delta kWh_{water} = \Delta Water\ (gallons) \ / \ 1{,}000{,}000 \ * \ E_{water\ supply}$$

Where

$E_{water\ supply}$ = Water Supply Energy Factor (kWh/Million Gallons)

= 2,571[795]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta Therm = Sa * (Hv + Hs * (T_1 - T_{source})) * Hours * L \ / \ (100{,}000 * \eta_B)$$

Where:

Sa = Steam loss per leaking trap (lbs/hr)

[794] Ibid.

[795] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'. Note since the water loss associated with this measure is due to evaporation and does not discharge into the wastewater system, only the water supply factor is used here.

For systems used in space heating applications that operate at 5 psig or lower, use the following equation to calculate Sa[796]. The condensate return system pressure, P_2, will typically be atmospheric pressure, 14.696 psia.

$$Sa = 1519.3 * P_1 * D^2 * [(1/T_1) * (\gamma/(\gamma-1)) * ((P_2/P_1)^{(2/\gamma)} - (P_2/P_1)^{((\gamma+1)/\gamma))}]^{0.5} * A * FF$$

For all other steam systems and applications, use the following equation.

$$Sa = 24.24 * P_1 * D^2 * A * FF$$

Defaults are provided in table below if custom calculation is not performed.

Where:

1519.3 = Constant, $(s^2 * °R^{0.5})/(ft * hr)$

P_1 = Average steam trap inlet pressure (absolute, psia). If not available, use defaults provided in table below (note that defaults are provided in psig, not psia).

D = Diameter of orifice, inches. Actual value should be used wherever possible as this value has a significant impact on steam flowrate value.

T_1 = Temperature of Saturated Steam (°R)

$= 507.89 * P_1^{0.0962}$

Where:

507.89 = Constant, $°R*(in^2/lb_f)^{0.0962}$

γ = Heat Capacity Ratio (unitless)

$= 5.071 * 10^{-4} * P_1 + 1.332$

P_2 = Average steam trap outlet pressure (absolute psia). If unknown, assume atmospheric pressure, 14.696 psia.

A = Adjustment factor

= 50%,[797] all steam systems. This factor accounts for reduction in the maximum theoretical steam flow to the average steam flow (the Enbridge factor).

FF = Flow Factor. In addition to the Adjustment factor (A), an additional 50 percent flow factor adjustment is recommended for medium and high-pressure steam systems to address industrial float and thermostatic style traps where additional blockage is possible.

24.24 = Constant $lbm/(hr-psia-in^2)$

Default Steam Loss per Trap (Sa) are provided below for different system types:

[796] See "Derivation of Equation for Subsonic Compressible Flow through an Orifice and Supporting Calculations for Illinois TRM Steam Trap Measure" paper for more information.

[797] Enbridge adjustment factor used as referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012 and DOE Federal Energy Management Program Steam Trap Performance Assessment.

Steam System	Average Steam Trap Inlet Pressure (psig)[798]	Diameter of Orifice (in)	Adjustment Factor	Flow Factor	Average Actual Steam Loss per Leaking Trap (lbm/hr/trap) [799]
Commercial Dry Cleaners	82.8	0.1250	50%	100%	18.5
Multifamily LPS Space Heating – calculate Sa as provided above. If using default value, cap total savings at 20% of building consumption	-	-	50%	100%	6.9
Commercial LPS Space Heating	11.2	0.2100	50%	100%	13.8
Industrial/Process Low Pressure: psig < 15	11.2	0.2100	50%	100%	13.8
Medium Pressure: 15 ≤ psig < 30	16	0.1875	50%	50%	6.5
Medium Pressure: 30 ≤ psig < 75	47	0.2500	50%	50%	23.4
High Pressure: 75 ≤ psig < 125	101	0.2500	50%	50%	43.8
High Pressure: 125 ≤ psig < 175	146	0.2500	50%	50%	60.9
High Pressure: 175 ≤ psig < 250	202	0.2500	50%	50%	82.1
High Pressure: 250 ≤ psig < 300	263	0.2500	50%	50%	105.2
High Pressure: 300 ≤ psig	Custom	Custom	50%	50%	Calculated

Hv = Heat of vaporization of steam, (Btu/lbm)

Steam System	Average Inlet Pressure (psig)	Heat of Vaporization[800] (Btu/lbm)
Commercial Dry Cleaners	82.8	890
Multifamily LPS Space Heating	--	951
Commercial Space Heating (including Multifamily) LPS	11.2	951
Industrial/Process Low Pressure: psig < 15	11.2	951
Medium Pressure: 15 ≤ psig < 30	16	944
Medium Pressure: 30 ≤ psig < 75	47	915
High Pressure: 75 ≤ psig < 125	101	880
High Pressure: 125 ≤ psig < 175	146	859
High Pressure: 175 ≤ psig < 250	202	837
High Pressure: 250 ≤ psig < 300	263	816
High Pressure: 300 ≤ psig	--	Custom

[798]Commercial and Industrial low pressure steam trap inlet pressure based on Franklin Energy and Opinion Dynamics analysis of data collected by Armstrong for 120,833 steam traps. Data covered coil, process, and radiator steam trap applications on modulating and constant pressure systems less than 15psi.
Medium and high pressure steam trap inlet pressure based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours. Dry cleaning steam trap inlet pressure based on C5 Steam Traps – Nicor FINAL 10.27.11.

[799] For applications where inlet pressures and orifice diameters are provided in the table, default values are directly calculated using the equation above. For the multifamily LPS space heating applications where inlet pressures and orifice diameters are not provided in the table, default values are assumptions based on engineering judgement and will be revisited in future years.

[800] Heat of vaporization of steam at the inlet pressure to the steam trap. Implicit assumption that the average boiler nominal pressure where the vaporization occurs, is essentially that same pressure. Referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012.

= If exact steam pressure (psig) in known[801]:

Steam Pressure (psig)	Hv (Btu/lbm)	Steam Pressure (psig)	Hv (Btu/lbm)	Steam Pressure (psig)	Hv (Btu/lbm)
0	970	44	917	170	849
1	968	46	915	175	847
2	966	48	914	180	845
3	964	50	912	185	843
4	962	55	909	190	841
5	960	60	906	195	839
6	959	65	901	200	837
7	957	70	898	205	836
8	956	75	895	210	834
9	954	80	891	215	832
10	953	85	889	220	830
12	949	90	886	225	828
14	947	95	883	230	827
16	944	100	880	235	825
18	941	105	878	240	823
20	939	110	875	245	822
22	937	115	873	250	820
24	934	120	871	255	819
26	933	125	868	260	817
28	930	130	866	265	815
30	929	135	864	270	814
32	927	140	861	275	812
34	925	145	859	280	811
36	923	150	857	285	809
38	922	155	855	290	808
40	920	160	853	295	806
42	918	165	851	300	805

Hs = Specfic heat of water, (Btu/(lbm * °R))

= 1.001

T_{source} = Incoming water temperature

= 513.67°R[802]

η_B = Boiler efficiency

= custom, if unknown:

= 79% for steam boilers[803]

Hours = Annual hours when steam system is pressurized

= custom, if unknown:

[801] Engineering Toolbox (2003), Saturated Steam Properties – Engineering Data & Calculations, Gauge Pressure and Evaporated Enthalpy columns. https://www.engineeringtoolbox.com/saturated-steam-properties-d_273.html [Accessed May 2026]
[802] US DOE Building America Program. Building America Analysis Spreadsheet. For Chicago, IL.
[803] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

Steam System	Zone (where applicable)	Hours/Yr[804]
Commercial Dry Cleaners	All Climate Zones	2,425
Industrial/Process Low Pressure: psig < 15		8,282
Medium Pressure: 15 ≤ psig < 30		8,282
Medium Pressure: 30 ≤ psig < 75		8,282
High Pressure: 75 ≤ psig < 125		8,282
High Pressure: 125 ≤ psig < 175		8,282
High Pressure: 175 ≤ psig < 250		8,282
High Pressure: 250 ≤ psig < 300		8,282
High Pressure: 300 ≤ psig		8,282
Commercial Space Heating LPS	Rockford	4,272
	Chicago	4,029
	Springfield	3,406
	Belleville	2,515
	Marion	2,546
Multifamily Space Heating LPS	For steam traps that are part of steam systems where the boiler cycles on/off to maintain space setpoint temperature or for steam traps located downstream of a steam control valve that opens/closes to maintain setpoint temperature, use Heating EFLH values in Section 4.4 for High Rise or Mid-Rise MF buildings. For steam traps that are exposed to steam continuously throughout the heating season, use the values listed above for Commercial Space Heating LPS for your appropriate climate zone.	

L = Leaking & blow-thru

L is 1.0 when applied to the replacment of an individual leaking trap. If a number of steam traps are replaced and the system has not been audited, the leaking and blow-thru is applied to reflect the assumed percentage of steam traps that were actually leaking and need to be replaced. A custom value can be utilized if a supported by an evaluation.

Steam System	L (%)[805]
Custom	Custom
Commercial Dry Cleaners	27%
Commercial Heating (including Multifamily) LPS	27%
Industrial/Process Low Pressure: psig < 15	16%
Medium Pressure: 15 ≤ psig < 30	16%
Medium Pressure: 30 ≤ psig < 75	16%
High Pressure: 75 ≤ psig < 125	16%
High Pressure: 125 ≤ psig < 175	16%
High Pressure: 175 ≤ psig < 250	16%
High Pressure: 250 ≤ psig < 300	16%

[804] Medium and high-pressure steam trap annual operating hours based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours.
[805] Dry cleaners survey data as referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012.

For example, a commercial dry cleaning facility with the default hours of operation and boiler efficiency;

$$\Delta\text{Therms} = Sa * (Hv + Hs * (T_1 - T_{source})) * Hours * L / (100{,}000 * \eta_B)$$

T_1 = 507.89 * $P_1^{0.0962}$

= 507.89 * $(82.8 + 14.696)^{0.0962}$

= 789.1°R

ΔTherms = 18.5 lbs/hr/trap * (890 Btu/lb + 1.001 * (789.1°R - 513.7°R)) * 2,425hrs * 27%/(100,000 * 80.7%)

= 175.0 therms per trap

WATER IMPACT DESCRIPTIONS AND CALCULATION

The hourly water volume saved per each repaired or replaced leaking trap is calculated by dividing the "Average Actual Steam Loss per Leaking Trap (lbm/hr/trap)" by the density of water saved, 8.33 lbm/gal, that replaces the lost steam. The average actual steam loss is provided in the table for parameter *Sa*, the "Average actual steam loss per leaking trap" in the Fossil Fuel Savings section above. Annual water savings are calculated using *Hours* and *L*, the leaking and blow through factor, as defined above.

Water savings only apply to situations where condensate is lost from the steam system. If a condensate recovery system is in place, assume zero water savings or provide a custom calculation based on site-specific operation.

The annual water savings for a replaced or repaired trap is given by:

$$\Delta\text{Water} = GAL * Hours * L$$

Where:

GAL = average actual water volume saved per leaking trap, as listed in the following table and based on steam system type.

Other variables as defined above.

Steam System*	Average Actual Steam Loss per Leaking Trap (lbm/hr/trap)	GAL: Average Actual Water Volume Saved per Leaking Trap Atmospheric Venting (gal/hr/trap)
Commercial Dry Cleaners	18.5	2.22
Multifamily LPS Space Heating	6.9	0.83
Commercial Heating (including Multifamily) LPS	13.8	1.66
Industrial/Process Low Pressure: psig < 15	13.8	1.66
Medium Pressure: 15 ≤ psig < 30	6.5	0.78
Medium Pressure: 30 ≤ psig < 75	23.4	2.81
High Pressure: 75 ≤ psig < 125	43.8	5.26
High Pressure: 125 ≤ psig < 175	60.9	7.31
High Pressure: 175 ≤ psig < 250	82.1	9.86
High Pressure: 250 ≤ psig < 300	105.2	12.63
High Pressure: 300 ≤ psig	Calculated	Calculated Steam Loss / 8.33

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-STRE-V14-270101

REVIEW DEADLINE: 1/1/2029

4.4.17 Variable Speed Drives for HVAC Pumps and Cooling Tower Fans

DESCRIPTION

This measure is applied to variable speed drives (VSD) which are installed on the following HVAC system applications: chilled water pump, hot water pumps and cooling tower fans. There is a separate measure for HVAC supply and return fans. All other VSD applications require custom analysis by the program administrator. The VSD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

This measure is not applicable for:

- Cooling towers, chilled or hot water pumps with any process load.
- VSD installation in existing cooling towers with 2-speed motors. (current code requires 2-speed motors for cooling towers with motors greater than 7.5 HP)
- VSD installation in new cooling towers with motors greater than 7.5 HP

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The VSD is applied to a motor which does not have a VSD. This measure is not applicable for replacing failed VSDs. The application must have a variable load and installation is to include the necessary controls. Savings are based on application of VSDs to a range of baseline load conditions including no control, inlet guide vanes, outlet guide vanes and throttling valves.

DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VSD or other methods of control. Retrofit baseline is an existing motor operating as is. Retrofit baselines may or may not include guide vanes, throttling valves or other methods of control. This information shall be collected from the customer.

Installations of new equipment with VSDs which are required by IECC, state energy code as adopted by the State of Illinois are not eligible for incentives. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for HVAC application is 15 years;[806] measure life for process is 15 years.[807]

DEEMED MEASURE COST

Customer provided costs will be used when available. Default measure costs[808] are noted below for up to 75 hp motors. Custom costs must be gathered from the customer for motor sizes not listed below.

[806] ComEd Effective Useful Life Research Report (2018), Navigant, May 14, 2018
[807] California Public Utilities Commission (CPUC), Energy Division. 2014. "DEER2014-EUL-table-update_2014-02-05.xlsx"
[808] NEEP Incremental Cost Study Phase Two Final Report dated January 13, 2013 (pg. 32; Table 15). Equipment and labor costs were extrapolated or interpolated as necessary for motor sizes not covered in the incremental cost study.

HP	Cost
5 HP	$2,250
7.5 HP	$2,517
10 HP	$2,784
15 HP	$3,318
20 HP	$3,852
25 HP	$4,386
50 HP	$6,573
75 HP	$8,532

LOADSHAPE

Loadshape C42 - VFD - Boiler feedwater pumps <10 HP

Loadshape C43 - VFD - Chilled water pumps <10 HP

Loadshape C44 - VFD Boiler circulation pumps <10 HP

Loadshape C48 - VFD Boiler draft fans <10 HP

Loadshape C49 - VFD Cooling Tower Fans <10 HP

COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = BHP\ /EFFi * Hours * ESF$$

Where:

BHP = System Brake Horsepower

(Nominal motor HP * Motor load factor)

Motors are assumed to have a load factor of 65% for calculating kW if actual values cannot be determined[809]. Custom load factor may be applied if known.

EFFi = Motor efficiency, installed. Actual motor efficiency shall be used to calculate kW. If not known, default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor, as detailed in the table below.

[809] Del Balso, Ryan J. "Investigation into the Reliability of Energy Efficiency/Demand Side Management Savings Estimates for Variable Frequency Drives in Commercial Applications", University of Colorado, Department of Civil, Environmental and Architectural Engineering, 2013.

NEMA Premium Efficiency Motors Default Efficiencies[810]

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

Hours = Default hours are provided for HVAC applications which vary by HVAC application and building type[811]. When available (provided via Energy Management Software or metered), actual hours should be used.

Building Type	Heating Run Hours	Cooling Run Hours	Model Source
Assembly	6,111	2,275	OpenStudio
Assisted Living	8,541	5,711	OpenStudio
Auto Dealership	3,978	1,690	OpenStudio
Childcare/Pre-School	5,632	2,041	OpenStudio

[810] Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.

[811] Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the heating or cooling system is operating for each building type. "Heating and Cooling Run Hours" are estimated as the total number of hours fans are operating for heating, cooling and ventilation for each building type. This may overclaim certain applications (e.g. pumps) and so where possible actual hours should be used for these applications.

Building Type	Heating Run Hours	Cooling Run Hours	Model Source
College	6,205	4,221	OpenStudio
Convenience Store	8,334	1,722	OpenStudio
Drug Store	4,612	1,843	OpenStudio
Elementary School	6,987	3,152	OpenStudio
Emergency Services	3,541	3,636	OpenStudio
Garage	4,849	2,102	eQuest
Grocery	8,760	2,016	OpenStudio
Healthcare Clinic	8,711	4,447	OpenStudio
High School	8,756	3,304	OpenStudio
Hospital - CAV no econ	5,061	8,760	OpenStudio
Hospital - CAV econ	5,147	8,744	OpenStudio
Hospital - VAV econ	6,163	5,465	OpenStudio
Hospital - FCU	6,520	8,760	OpenStudio
Hospital - Unknown	5,723	7,932	OpenStudio
Hotel/Motel	6,074	5,999	OpenStudio
Hotel/Motel - Common	6,157	6,266	OpenStudio
Hotel/Motel - Guest	5,530	4,132	OpenStudio
Manufacturing Facility_Miscellaneous	4,643	7,070	OpenStudio
Manufacturing Facility_Food/Chemical	4,504	8,760	OpenStudio
MF - High Rise	4,466	4,332	OpenStudio
MF - High Rise - Common	3,047	2,670	OpenStudio
MF - High Rise - Residential	4,572	4,622	OpenStudio
MF - Mid Rise	4,784	3,477	OpenStudio
Movie Theater	6,680	2,347	OpenStudio
Office - High Rise - CAV no econ	5,491	6,129	OpenStudio
Office - High Rise - CAV econ	5,290	2,723	OpenStudio
Office - High Rise - VAV econ	5,099	4,790	OpenStudio
Office - High Rise - FCU	4,998	5,905	OpenStudio
Office - Low Rise	5,119	1,990	OpenStudio
Office - Mid Rise	6,595	3,041	OpenStudio
Religious Building	5,688	2,129	OpenStudio
Restaurant	4,723	3,213	OpenStudio
Retail - Department Store	4,070	1,737	OpenStudio
Retail - Strip Mall	4,888	1,750	OpenStudio
Warehouse Nonrefrigerated	4,930	1,110	OpenStudio
Warehouse Refrigerated	4,004	882	OpenStudio
Medical Office	8,529	4,366	OpenStudio
Unknown	5,948	2,833	n/a

The type of hours to apply depends on the VFD application, according to the table below.

Application	Hours Type
Hot Water Pump	Heating
Chilled Water Pump	Cooling
Cooling Tower Fan	Cooling

ESF = Energy savings factor varies by VFD application. Units are kW/HP.

Application	ESF[812]
Hot Water Pump	0.118
Chilled Water Pump	0.199
Cooling Tower Fan	0.302

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = BHP/EFFi * DSF$$

Where:

DSF = Demand Savings Factor varies by VFD application.[813] Units are kW/HP. Values listed below are based on typical peak load for the listed application.

Application	DSF
Hot Water Pump	0
Chilled Water Pump	0.160
Cooling Tower Fan	0.076

FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION

There are no expected fossil fuel impacts for this measure.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-VSDHP-V12-270101

REVIEW DEADLINE: 1/1/2028

[812] Based on OpenStudio Large Office model, finding difference in energy use for each VSD application. See 'VSD ESF Calculation_2026.xls'.

[813] Based on OpenStudio Large Office model, finding difference in maximum demand for each VSD application. See 'VSD ESF Calculation_2026.xls'.

4.4.18 Small Commercial Programmable Thermostats – Retired 12/31/2019. Replaced with 4.4.48 Small Commercial Thermostats

4.4.19 Demand Controlled Ventilation

DESCRIPTION

Demand control ventilation (DCV) adjusts outside ventilation air based on the number of occupants and the ventilation demands that those occupants create. DCV is part of a building's ventilation system control strategy. It may include hardware, software, and controls as an integral part of a building's ventilation design. Active control of the ventilation system provides the opportunity to reduce heating and cooling energy use.

The primary component is a control sensor to communicate either directly with the economizer or with a central computer. The component is most typically a carbon dioxide (CO_2) sensor, occupancy sensor, or turnstile counter. This measure is applicable to multiple building types, and savings are classified by the specific building types defined in the Illinois TRM. This measure is modeled to assume night-time set-backs are in operation and minimum outside air is being used when the building is unoccupied. Systems that have static louvers or that are open at night will likely have greater savings by using the custom program.

Demand controlled ventilation can also be added to the exhaust fans of enclosed parking garages. The fans modulate the ventilation airflow based on pollutant concentrations (primarily carbon monoxide) in the space.

This measure does not apply to packaged single-zone (PSZ) rooftop units with functioning economizers. For PSZ with functioning economizers, see 4.4.41 Advanced Rooftop Controls.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment condition is defined by new CO_2 sensors installed on return air systems where no other sensors were previously installed. For heating savings, this measure does not apply to any system with terminal reheat (constant volume or variable air volume). For terminal reheat systems a custom savings calculation should be used.

DEFINITION OF BASELINE EQUIPMENT

The base case for this measure is a space with no demand control capability. The current code minimum for outside air (OA) is 5 CFM per occupant (ASHRAE 62.1 - 2025) which is the value for office space assumed in this measure.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 10 years and based on CO_2 sensor estimated life. [814]

DEEMED MEASURE COST

The deemed measure cost is assumed to be the full cost of installation of a DCV retrofit including sensor cost ($278) and RTU integration cost ($900 per zone) for a total of $1,178.[815]

Adding demand controlled ventilation to parking garages is assumed to cost $500 per sensor including the cost of the controller. The installation cost is estimated at $1,000 for labor.[816]

[814] During conversations with vendors and Building Automation System (BAS) contractors, it was determined that sensors must be functional for up to 10 years. It is recommended that they are part of a normal preventive maintenance program in which calibration is an important part of extending useful life. Although they are not subject to mechanical failure, they do fall out of tolerance over time.

[815] Business Energy Advisor | Demand-Controlled Ventilation (bizenergyadvisor.com), 2017. Average sensor cost used from list of eight different vendors and CO2 sensors. RTU integration costs assume high end of estimated range ($300-$900) for implementing DCV on a newer DCV-ready RTU with existing economizer.

[816] California Utilities Statewide Codes and Standards Team. 2011. "2013 California Building Energy Efficiency Standards", Garage Exhaust, Section 4.2 Page 14.

LOADSHAPE

Commercial ventilation C23

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

For facilities heated by natural gas,

$$\Delta kWh = Condition\ Space/1000 * SF_{cooling}$$

For facilities heated by heat pumps,

$$\Delta kWh = Condition\ Space/1000 * SF_{cooling} + Condition\ Space/1000 * SF_{Heat\ HP}$$

For facilities heated by electric resistance,

$$\Delta kWh = Condition\ Space/1000 * SF_{cooling} + Condition\ Space/1000 * SF_{Heat\ ER}$$

Where:

Conditioned Space = actual square footage of conditioned space controlled by sensor

$SF_{cooling}$ = Cooling Savings Factor
= value in table below based on building type and weather zone

$SF_{Heat\ HP}$ = Heating Savings factor for facilities heated by Heat Pump (HP)
= value in table below based on building type and weather zone

$SF_{Heat\ ER}$ = Heating Savings factor for facilities heated by Electric Resistance (ER)
= value in table below based on building type and weather zone

Saving Factor Tables[817]

Building Type	$SF_{cooling}$ (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	285	289	299	298	305
Office - Mid-rise	225	228	234	233	237
Office - High-rise	267	271	279	279	284
Religious Building	763	780	886	889	910
Restaurant	498	510	573	593	615
Retail - Department Store	388	393	410	415	423
Retail - Strip Mall	269	272	285	285	290
Convenience Store	355	357	368	370	374
Elementary School	358	367	410	405	415
High School	350	359	401	396	406

[817] The electric energy savings was calculated using TMY3 weather data and methodology consistent with ASHRAE standards. Savings are calculated on an annual basis for each given temperature zone in Illinois. Energy savings for DCV were developed utilizing standards, inputs and approaches as set forth by ASHRAE 90.1 -2010 (code level up until Dec 31, 2015). Building input parameters like square footage, equipment efficiencies and occupancy match those used in the EFLH calculations. Reference calculation found in Demand Control Ventilation 12-30-13.xls.

Building Type	$SF_{cooling}$ (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
College/University	400	426	472	488	519
Healthcare Clinic	349	354	389	392	398
Lodging	407	409	423	424	428
Manufacturing	175	177	183	248	185
Special Assembly Auditorium	563	581	668	677	711
Default (non-garage)	377	385	419	426	433
Enclosed Parking Garage[818]	925	925	925	925	925

Building Type	$SF_{Heat\ HP}$ (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	234	205	181	171	147
Office - Mid-rise	157	138	121	115	99
Office - High-rise	211	185	163	154	133
Religious Building	1,508	1,333	1,180	1,125	1,008
Restaurant	1,067	962	837	816	720
Retail - Department Store	368	329	291	285	249
Retail - Strip Mall	246	215	195	186	165
Convenience Store	180	163	141	138	121
Elementary School	657	572	508	473	418
High School	641	558	495	461	406
College/University	1,267	1,114	980	945	798
Healthcare Clinic	447	396	348	334	299
Lodging	205	184	159	154	135
Manufacturing	130	114	101	172	83
Special Assembly Auditorium	1,773	1,564	1,414	1,378	1,212
Default (non-garage)	606	535	474	460	400

Building Type	$SF_{Heat\ ER}$ (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	703	615	542	512	441
Office - Mid-rise	471	413	364	345	298
Office - High-rise	633	554	489	462	398
Religious Building	4,523	3,999	3,541	3,376	3,024
Restaurant	3,201	2,886	2,511	2,449	2,159
Retail - Department Store	1,103	987	874	855	748
Retail - Strip Mall	738	646	584	559	495
Convenience Store	541	488	423	413	364
Elementary School	1,972	1,715	1,523	1,420	1,254
High School	1,924	1,673	1,484	1,383	1,219
College/University	3,801	3,341	2,940	2,834	2,394
Healthcare Clinic	1,341	1,188	1,044	1,001	896

[818] Savings are estimated based on a study done by California Utilities Statewide Codes and Standards Team, "2013 California Building Energy Efficiency Standards", 2013, Section 2.4, Table 1. The savings are primarily fan savings, and are not dependent on climate zone.

Building Type	SF Heat ER (kWh/1000 SqFt)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Lodging	616	551	477	462	406
Manufacturing	390	343	303	516	250
Special Assembly Auditorium	5,320	4,691	4,243	4,133	3,636
Default (non-garage)	1,819	1,606	1,423	1,381	1,199

For example, for a 7,500 SqFt of low-rise office space in Chicago with gas heat.

ΔkWh = 7,500 /1000 *289

= 2,168 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

NA

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = Condition\ Space/1000 * SF_{Heat\ Gas}$$

Where:

SF Heat Gas = value in table below based on building type and weather zone.[819]

Building Type	SF Heat Gas (Therm/1000 sq ft)				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low-rise	30	26	23	22	19
Office - Mid-rise	20	18	16	15	13
Office- High-rise	27	24	21	20	17
Religious Building	193	171	151	144	129
Restaurant	137	123	107	104	92
Retail - Department Store	47	42	37	36	32
Retail - Strip Mall	31	28	25	24	21
Convenience Store	23	21	18	18	16
Elementary School	84	73	65	61	53
High School	82	71	63	59	52
College/ University	162	143	125	121	102
Healthcare Clinic	57	51	45	43	38
Lodging	26	23	20	20	17
Manufacturing	17	15	13	22	11
Special Assembly Auditorium	227	200	181	176	155
De-fault	78	68	61	59	51

[819] The natural gas energy savings was calculated using TMY3 weather data and methodology consistent with ASHRAE standards. Savings are calculated on an annual basis for each given temperature zone in Illinois. Energy savings for DCV were developed utilizing standards, inputs and approaches as set forth by ASHRAE 62.1 and 90.1, respectively. Building input parameters like square footage, equipment efficiencies and occupancy match those used in the EFLH calculations. Reference calculation found in Demand Control Ventilation 12-30-13.xls.

For example, for a 7500 SqFt of low-rise office space in Chicago.

ΔTherms = 7,500/1,000 * 26

= 195 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-DCV-V08-270101

REVIEW DEADLINE: 1/1/2030

4.4.20 High Turndown Burner for Space Heating Boilers

DESCRIPTION

This measure is for a non-residential boilers equipped with linkageless controls providing space heating with burners having a turndown less than 6:1.[820] Turndown is the ratio of the high firing rate to the low firing rate. When boilers are subjected to loads below the low firing rate, the boiler must cycle on/off to meet the load requirements. A higher turndown ratio reduces burner startups, provides better load control, saves wear-and-tear on the burner, and reduces purge-air requirements, all of these benefits result in better overall efficiency.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler linkageless burner must operate with a turndown greater than or equal to 10:1 and be subjected to loads less than or equal to 30% of the full fire input MBH[821] for greater than 60% of the operating hours.[822]

DEFINITION OF BASELINE EQUIPMENT

The baseline boiler utilizes a linkageless burner with a turndown ration of 6:1 or less and is used primarily for space heating. Redundant boilers do not qualify. Code requirements must be considered.

Note: beginning with the 2015 edition, and continuing through the 2024 edition, IECC makes the following requirements for boiler turndown:

Boiler Systems with design input of greater than 1,000,000 Btu/h shall comply with the turndown ratio specified in the following table.

The system turndown requirement shall be met through the use of multiple single-input boilers, one or more *modulating boilers* or a combination of single-input and *modulating boilers*.

BOILER SYSTEM DESIGN INPUT	MINIMUM TURNDOWN RATIO
≥ 1,000,000 and less than or equal to 5,000,000	3 to 1
> 5,000,000 and less than or equal to 10,000,000	4 to 1
> 10,000,000	5 to 1

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be the lower of remaining useful life of the boiler, or 21 years.[823]

DEEMED MEASURE COST

Actual costs shall be used as available. When unknown, the deemed installed measure cost including labor is approximately $2.53/MBtu/hr.[824]

[820] The standard turndown ratio for boilers is 6:1. Understanding Fuel Savings in the Boiler Room, ASHRAE Journal, David Eoff, December, 2008 p 38.
[821] Focus on Energy Evaluation, Business Programs: Deemed Savings Manual V1.0, March 22, 2010. This factor implies that boilers are 30% oversized on average.
[822] FES Analysis of bin hours based upon a 30% oversizing factor.
[823] "American Society of Heating, Refrigeration, and Air-Conditioning Engineers, Inc. ASHRAE Handbook, HVAC Applications. Chapter 38, "Owning and Operating Costs", Table 4. 2019.
[824] FES review of PY2/PY3 costs for custom People's and North Shore high turndown burner projects. See High Turndown Costs.xlsx for details.

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = Ngi * SF * EFLH / 100$$

Where:

Ngi = Boiler gas input size (kBtu/hr) = custom

SF = Savings Factor, based on the percentage of energy loss per hour

= (∑ ((EL_base – EL_eff) * H_cycling)) / H)*100

Where:

EL_base = Base Boiler Percentage of energy loss due to cycling at % of Base Boiler Load where BL_base ≤ TDR_base

= 0.003 * (Cycles_base)^2 – 0.001 * Cycles_base [825]

Where:

Cycles_base = Number of Cycles/hour of base boiler

= TDR_base / BL

Where:

BL = % of full boiler load at bin hours being evaluated. This is assumed to be a straight line based on 0% load at the building balance point (assumed to be 55F), and full load corrected for the oversizing (OSF) at the lowest temperature bin of -10 to -5F. (See table below for summary of values at different temperature bins.)

OSF = Oversizing Factor = 1.3,[826] or custom

[825] Release 3.0 Operations & Maintenance Best Practices A Guide to Achieving Operational Efficiency, August 2010, Federal Energy Management Program, US Department of Energy. The equation was determined by plotting the values in Table 9.2.1 – Boiler Cycling Energy Loss.

[826] PA Consulting, KEMA, Focus on Energy Evaluation, Business Programs: Deemed Savings Manual V1.0, March 22, 2010, Page 4-12.

TDR_base = Turndown ratio = 0.33,[827] or custom

EL_eff = Efficient Boiler Percentage of energy loss due to cycling at % of Efficient Boiler Load

= 0.003 * (Cycles_eff)^2 – 0.001 * Cycles_eff

Where:

Cycles_eff = Number of Cycles/hour

= TDR_eff / BL

Where:

TDR_eff = Turndown ratio = 0.10,[828] or custom

H_cycling = Hours base boiler is cycling at % of base boiler load

= see table below or custom

H = Total Number of Hours in Heating Season

= 4,725[829] or custom

100 = convert to a percentage

SF = 65.7 / 4725 *100 = 1.4% or custom (see table below for summary of values)

Temperature	H_cycling	BL	EL_base	EL_eff	(EL_base-EL_eff)* Hours Cycling
50 to 55	574	6.0%	8.5%	0.7%	44.5
45 to 50	576	12.0%	2.0%	0.0%	11.5
40 to 45	435	18.0%	0.8%	0.0%	3.5
35 to 40	884	24.0%	0.4%	0.0%	3.5
30 to 35	778	30.0%	0.3%	0.0%	2.3
				Total	65.7

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

100 = convert kBtu to therms

Water Impact Descriptions and Calculation

N/A

Deemed O&M Cost Adjustment Calculation

N/A

Measure Code: CI-HVC-HTBC-V08-270101

Review Deadline: 1/1/2028

[827] Ibid.

[828] 10:1 ratio used to qualify for efficient equipment.

[829] TMYx weather data for the weighted average heating hours for the state of Illinois

4.4.21 Linkage-less Boiler Controls for Space Heating

DESCRIPTION

This measure is for a non-residential boiler providing space heating with single-point positioning combustion control. In single-point positioning control, the fuel valve is linked to the combustion air damper via a jackshaft mechanism to maintain correspondence between fuel and combustion air input. Most boilers with single-point positioning control do not maintain low excess air levels over their entire firing range. Generally, these boilers are calibrated at high fire, but due to the non-linearity required for efficient combustion, excess air levels tend to dramatically increase as the firing rate decreases. Boiler efficiency drops as the excess air levels are increased.

This measure was developed to be applicable to the following program types: TOS, NC, RF.
If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler burner must have a linkage-less control system allowing the combustion air damper position to be adjusted and set for optimal efficiency at several firing rates throughout the burner's firing range. This requires the fuel valve and combustion air damper to each be powered by a separate actuator. An alternative to the combustion air damper is a Variable Speed Drive on the combustion air fan. Note: this measure only applies to the incremental savings attributed to linkage-less positioning. If O_2 trim is installed, also see measure 4.4.22 "Oxygen Trim Controls for Space Heating Boilers".

DEFINITION OF BASELINE EQUIPMENT

The baseline boiler utilizes single-point positioning for the burner combustion control.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.[830]

DEEMED MEASURE COST

The deemed measure cost is estimated at $8,500.[831]

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

When a Variable Speed Drive is incorporated, electrical savings are calculated according to the "4.4.17 Variable Speed Drive for HVAC Pumps and Cooling Tower Fans" measure.

[830] Ontario Energy Board, "Final Report: Custom Measure Life", Michaels Energy, May 10, 2018, burner modification measure life is estimated at 20 years.

[831] Codes and Standards Enhancement Initiative (CASE) – Commercial Boilers; 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011 (pg. 19). The estimated incremental costs were provided by boiler control representatives and did not vary with boiler capacity. The $8,500 estimated incremental cost represents the mid-point of the estimated price range.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = Ngi * SF * EFLH / 100$$

Where:

Ngi = Boiler gas input size (kBtu/hr) = custom

SF = Savings factor

Note: Savings factor is the percentage increase in efficiency as a result of the added linkage-less burner controls. Across all boiler firing rates, single-point controls are assumed to have an average of 57% excess airwhile linkage-less controls are assumed to have 27% excess air.[832] The difference between controls types is 30% under this operating condition. A 15% reduction in excess air is approximately a 1% increase in efficiency.[833] Therefore the nominal combustion efficiency increase is 30 / 15 * 1% = 2.0%.

= 2.0%

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

100 = convert kBtu to therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-LBC-V07-260101

REVIEW DEADLINE: 1/1/2029

[832] ACEEE Summer Study 2008, Common Boiler Excess Air Trends and Strategies to Optimize Efficiency. Excess air value is an average of high/med/low firing rates for all three test cases provided, which ranged from a low of 24% at high-fire, to a high of 115% at low-fire. Linkage-less excess air percentage was taken from the average of firing rates from the test case provided.
[833] Department of Energy (DOE). January 2012, Steam Tip Sheet #4, Improve Your Boiler's Combustion Efficiency. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. This value was determined as an appropriate average over the stack temperatures and excess air levels indicated.

4.4.22 Oxygen Trim Controls for Space Heating Boilers

DESCRIPTION

This measure is for a non-residential boiler providing space heating without oxygen trim combustion controls. Oxygen (O_2) trim controls limit the amount of excess oxygen provided to the burner for combustion. This oxygen level is dependent upon the amount of air provided. Oxygen trim control converts parallel positioning, linkage-less controls, into a closed-loop control configuration with the addition of an exhaust gas analyzer and PID controller. Boilers with oxygen trim controls can maintain a predetermined excess air rate (generally 15% to 30% excess air) over the entire burner firing rate. Boilers without these controls typically have excess air rates around 30% over the entire firing rate. Boiler efficiency drops as the excess air levels are increased.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler burner must have an oxygen control system allowing the combustion air to be adjusted to maintain a predetermined excess oxygen level in the flue exhaust at all firing rates throughout the burner's firing range. This requires an oxygen sensor in the flue exhaust and linkage-less fuel valve and combustion air controls.

DEFINITION OF BASELINE EQUIPMENT

The baseline boiler utilizes linkage-less positioning for the burner combustion control. For boilers with single-point positioning control, see measure 4.4.21 "Linkage-less boiler controls for Space Heating". This measure is intended as an incremental upgrade to linkage-less controls.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the O_2 Trim controls is 20 years.[834]

DEEMED MEASURE COST

Custom costs should be used when available. The default measure cost is approximately $17,400.[835]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = Ngi * SF * EFLH / 100$$

[834] Ontario Energy Board, "Final Report: Custom Measure Life", Michaels Energy, May 10, 2018, burner modification measure life is estimated at 20 years.

[835] Washington State University Energy Efficiency Factsheet, "Boiler Combustion Monitoring & Oxygen Trim systems", 2003. Adjusted for inflation to 2025 dollars.

Where:

Ngi = Boiler gas input size (kBtu/hr)

= Custom

SF = Savings factor

Note: Savings factor is the percentage reduction in gas consumption as result of the additional O_2 trim controls. Linkage-less controls have an excess air rate of 27% over the entire firing range.[836] O_2 trim controls have an excess air rate of 15%.[837] The average difference is 12%. A 15% reduction in excess air is approximately a 1% increase in efficiency.[838] Therefore, the nominal combustion efficiency increase is 12 / 15 * 1% = 0.8%.

= 0.8%

EFLH = Default Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use. When available, actual hours should be used.

100 = convert kBtu to therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

The deemed annual Operations and Maintenance cost is $800.[839]

MEASURE CODE: CI-HVC-O2TC-V03-260101

REVIEW DEADLINE: 1/1/2029

[836] Department of Energy (DOE). 2009. Energy Matters newsletter. Fall 2009- Vol. 1, Iss. 1. Washington, DC: U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy, Industrial Technologies Program.
[837] Ibid.
[838] Department of Energy (DOE), January 2012, Steam Tip Sheet #4, Improving Your Boiler's Combustion Efficiency. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. This value was determined as an appropriate average over the stack temperatures and excess air levels indicated.
[839] CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

4.4.23 Shut Off Damper for Space Heating Boilers or Furnaces

DESCRIPTION

This measure is for non-residential atmospheric boilers or furnaces providing space heating without a shut off damper. When appliances are on standby mode warm room air is drawn through the stack via the draft hood or dilution air inlet at a rate proportional to the stack height, diameter and outdoor temperature. More air is drawn through the vent immediately after the appliance shuts off and the flue is still hot. Installation of a new shut off damper can prevent heat from being drawn up the warm vent and reducing the amount of air that passes through the furnace or boiler heat exchanger. This reduction in air can slightly increase overall operating efficiency by reducing the time needed to achieve steady-state operating conditions.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify the space heating boiler or furnace must have a new electrically or thermally activated shut off damper installed on either the exhaust flue or combustion air intake. Barometric dampers do not qualify. The damper actuation shall be interlocked with the firing controls.

DEFINITION OF BASELINE EQUIPMENT

The baseline boiler or furnace incorporates no shut off damper on the combustion air intake or flue exhaust.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the shut off damper is 15 years,[840] or for the remaining lifetime of the heating equipment, whichever is less.

DEEMED MEASURE COST

Given the variability in cost associated with differences in system specifications and design, as well as choice of measure technology, actual installed costs should be used as available or based on program-specific qualification requirements. When unavailable, a deemed measure cost of $1,500 shall be assumed.[841]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

[840] State of Wisconsin Public Service Commission of Wisconsin Focus on Energy Evaluation Business Programs: Measure Life Study Final Report: August 25, 2009, Table 1-2. Recommended Measure Life by WISeerts Group Description, pg. 1-4.
[841] CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = Ngi * SF * EFLH / 100$$

Where:

Ngi = Boiler gas input size (kBtu/hr)

= Custom

SF = Savings factor

= 1%[842]

Note: The savings factor assumes the boiler or furnace is located in an unconditioned space. The savings factor can be higher for those units located within conditioned space.

EFLH = Default Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use. When available, actual hours should be used.

100 = convert kBtu to therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

A deemed, one-time Operations and Maintenance cost of $150[843] shall be included in cost-effectiveness calculations and occur in year 10 of the measure life to account for controller replacement.

MEASURE CODE: CI-HVC-SODP-V03-240101

REVIEW DEADLINE: 1/1/2029

[842] Based on internet review of savings potential;
"Up to 4%": Use of Automatic Vent Dampers for New and Existing Boilers and Furnaces, Energy Innovators Initiative Technical Fact Sheet, Office of Energy Efficiency, Canada, 2002
"Up to 1%": Page 9, The Carbon Trust, "Steam and high temperature hot water boilers", March 2012,
"1 - 2%": Page 2, Sustainable Energy Authority of Ireland "Steam Systems Technical Guide".
[843] CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE) PROCESS BOILERS, 2013 California Building Energy Efficiency Standards, California Utilities Statewide Codes and Standards Team, October 2011, pg. 22.

4.4.24 Small Pipe Insulation

DESCRIPTION

This measure provides rebates for adding insulation to bare pipes with inner diameters of ½" and ¾". Insulation must be at least one inch thick. Since new construction projects are required by code to have pipe insulation, this measure is only for retrofits of existing facilities. This covers bare straight pipe as well as all fittings.

Default savings are provided on a per linear foot basis. It is assumed that the majority of pipes less than one inch in commercial facilities are used for domestic hot water. However, this measure can cover hydronic heating systems as well as low and high pressure steam systems.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is a ½"or ¾" diameter pipe with at least one inch of insulation. Insulation must be protected from damage which includes moisture, sunlight, equipment maintenance and wind. Outdoor pipes should have a weather protective jacket. Insulation must be continuous over straight pipe, elbows and tees.

DEFINITION OF BASELINE EQUIPMENT

The base case for savings estimates is a bare hot water or steam pipe with a fluid temperature of 105 degrees Fahrenheit or greater. Current new construction code requires insulation amounts similar to this measure, though this base case is commonly found in older existing buildings.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[844]

DEEMED MEASURE COST

The incremental measure cost for insulation is the full cost of adding insulation to the pipe. Actual installation costs should be used for the measure cost. For planning purposes, the following costs can be used to estimate the full cost of materials and labor.[845]

Pipe Size	Insulation thickness	Material cost ($/ft)	Labor cost ($/ft)	Total cost ($/ft)
½"	1"	4.58	4.43	9.01
	1 ½"	4.82	5.01	9.83
	2"	9.81	5.59	15.40
¾"	1"	4.58	4.43	9.01
	1 ½"	4.88	5.01	9.89
	2"	10.35	5.59	15.94

LOADSHAPE

N/A

[844] Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.
[845] RS Means Q1 2026. Costs include average material and labor (standard union) for across five Illinois climate zones. Assumes calcium silicate Insulation with 8oz canvas cover. For detailed labor rates see reference document "RS Means_smallpipeinsulation.xlsx"

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

ΔTherms per foot[846] $= [((Q_{base} - Q_{eff}) * EFLH) / (100{,}000 * \eta Boiler)] * TRF$

$= [Modeled\ or\ provided\ by\ tables\ below] * TRF$

ΔTherms $= (L_{sp} + L_{oc,i}) * \Delta therms\ per\ foot$

Where:

EFLH = Equivalent Full Load Hours for Heating

= Actual or defaults by building type in Existing Buildings provided in Section 4.4, HVAC end use

For year round recirculation or domestic hot water:

= 8,766

For heating season recirculation, hours with the outside air temperature below 55°F:

Zone	Hours
Zone 1 (Rockford)	5,039
Zone 2 (Chicago)	4,963
Zone 3 (Springfield)	4,495
Zone 4 (Belleville/	4,021
Zone 5 (Marion)	4,150

Q_{base} = Heat Loss from Bare Pipe (Btu/hr/ft)

= Calculated where possible using 3E Plusv4.0 software. For defaults see table below

Q_{eff} = Heat Loss from Insulated Pipe (Btu/hr/ft)

= Calculated where possible using 3E Plusv4.0 software. For defaults see table below

100,000 = conversion factor (1 therm = 100,000 Btu)

ηBoiler = Efficiency of the boiler being used to generate the hot water or steam in the pipe

= 80% for hot water boilers [847]

= 79% for steam boilers[848]

TRF = Thermal Regain Factor for pipe location and use, see table below. The Custom TRF option may be used on any pipe location, including pipe locations with deemed TRFs

[846]This value comes from the reference table "Savings Summary by Building Type and System Type." The formula and the input tables in this section document assumptions used in calculation spreadsheet "Pipe Insulation Savings 2013-11-12.xlsx".
[847] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr
[848] Ibid.

specifically listed in the table below, if supporting justification and calculations for the Custom TRF are provided.

May vary seasonally such as: TRF[summer] * summer hours + TRF[winter] * winter hours where TRF values reflecting summer and winter conditions are apportioned by the hours for those conditions. TRF may also be adjusted by building specific balance point temperature (BPT) and operating hours above and below that BPT.[849]

Pipe Location	Assumed Regain	TRF, Thermal Regain Factor
Outdoor	0%	1.0
Indoor, conditioned space during the heating season, 55°F BPT	85%	0.15
Indoor, conditioned space, not during the heating season, 55°F BPT	0%	1.0
Indoor, conditioned, annual use (e.g. hot water or process loads), 55°F BPT	45%	0.55
Indoor, semi- conditioned, (unconditioned space, with heat transfer to conditioned space. E.g., boiler room, ceiling plenum, basement, crawlspace, wall), during the heating season, 55°F BPT	30%	0.70
Indoor, semi-conditioned, not during the heating season, 55°F BPT	0%	1.0
Indoor, semi-conditioned, annual use, 55°F BPT	16%	0.84
Indoor, unconditioned spaces, (no heat transfer to conditioned space)	0%	1.0
Location not specified - Commercial	23%	0.77
Location not specified – Industrial	16%	0.84
Custom	Custom	1 – assumed regain

L_{sp} = Length of straight pipe to be insulated (linear foot)

$L_{oc,i}$ = Total equivalent length of (elbows and tees) of pipe to be insulated. Use table below to determine equivalent lengths.

Nominal Pipe Diameter	Equivalent Length (ft)[850]	
	90 Degree Elbow	Straight Tee
1/2"	0.04	0.03
3/4"	0.06	0.05

The table below shows the deemed therm savings by building type and region on a per linear foot basis for both ½" and ¾" copper pipe.

[849] Zimmerman, Cliff, Franklin Energy, "Thermal Regain Factor_4-30-14.docx", 2014. Based on climate zone 2. Note 'Location not specified – Commercial' assumes semi-conditioned spaces with 50% pipes providing space heating and 50% providing DHW. 'Location not specified – Commercial' assumes semi-conditioned annual usage.
[850] See reference file "Piping Insulation Tables_2014.11.20.xlsx"

The following table provides deemed values for 1/2" copper pipe, temperatures are assumed by category below, and insulation is assumed to be one inch fiberglass.

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Space Heating Non-recirculating	Assembly	0.068	0.069	0.063	0.057	0.057
	Assisted Living	0.137	0.131	0.129	0.132	0.130
	Auto Dealership	0.067	0.070	0.062	0.057	0.054
	Childcare/Pre-School	0.075	0.073	0.069	0.059	0.054
	College	0.080	0.082	0.072	0.065	0.066
	Convenience Store	0.153	0.157	0.146	0.144	0.144
	Drug Store	0.074	0.076	0.068	0.060	0.057
	Elementary School	0.167	0.164	0.148	0.128	0.121
	Emergency Services	0.069	0.070	0.064	0.055	0.044
	Garage	0.064	0.062	0.056	0.044	0.046
	Greenhouse – w/ Curtains	0.282	0.261	0.228	0.192	0.179
	Greenhouse – w/o Curtains	0.283	0.262	0.230	0.193	0.180
	Grocery	0.175	0.178	0.167	0.167	0.169
	Healthcare Clinic	0.103	0.103	0.095	0.092	0.103
	High School	0.118	0.113	0.116	0.120	0.116
	Hospital - CAV no econ	0.081	0.080	0.072	0.064	0.061
	Hospital - CAV econ	0.084	0.083	0.075	0.068	0.066
	Hospital - VAV econ	0.096	0.097	0.088	0.079	0.080
	Hospital - FCU	0.122	0.124	0.115	0.110	0.112
	Hospital - Unknown	0.096	0.096	0.087	0.080	0.080
	Hotel/Motel	0.107	0.107	0.099	0.090	0.092
	Hotel/Motel - Common	0.112	0.113	0.105	0.098	0.098
	Hotel/Motel - Guest	0.105	0.105	0.097	0.087	0.090
	Manufacturing Facility_Miscellaneous	0.061	0.063	0.057	0.051	0.047
	Manufacturing Facility_Food/Chemical	0.071	0.071	0.063	0.057	0.056
	MF - High Rise	0.061	0.060	0.052	0.037	0.038
	MF - High Rise - Common	0.068	0.062	0.055	0.043	0.043
	MF - High Rise - Residential	0.064	0.062	0.055	0.042	0.045
	MF - Mid Rise	0.097	0.097	0.089	0.080	0.076
	Movie Theater	0.085	0.086	0.077	0.073	0.070
	Office - High Rise - CAV no econ	0.067	0.066	0.059	0.055	0.046
	Office - High Rise - CAV econ	0.067	0.067	0.060	0.057	0.048
	Office - High Rise - VAV econ	0.087	0.088	0.078	0.069	0.075
	Office - High Rise - FCU	0.086	0.085	0.078	0.074	0.072
	Office - Low Rise	0.096	0.098	0.088	0.079	0.075
	Office - Mid Rise	0.073	0.073	0.065	0.058	0.065
	Religious Building	0.094	0.096	0.087	0.073	0.070
	Restaurant	0.101	0.100	0.094	0.086	0.085
	Retail - Department Store	0.048	0.048	0.043	0.035	0.031
	Retail - Strip Mall	0.088	0.090	0.082	0.072	0.067
	Warehouse Nonrefrigerated	0.075	0.074	0.067	0.062	0.061
	Warehouse Refrigerated	0.037	0.036	0.033	0.027	0.023
	Medical Office	0.099	0.099	0.094	0.092	0.099

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
	Unknown	0.096	0.095	0.087	0.079	0.077
Space Heating - recirculation heating season only	All buildings (Hours below 55°F)	0.329	0.324	0.293	0.262	0.271
Space Heating - recirculation year round	All buildings (All hours)	0.572	0.572	0.572	0.572	0.572
DHW	Recirculation loop	0.572	0.572	0.572	0.572	0.572
Process	Custom	Custom				

The following table provides deemed savings values for 3/4" copper pipe with temperatures assumed by category below, insulation is assumed to be one inch fiberglass.

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Space Heating Non-recirculating	Assembly	0.082	0.084	0.076	0.069	0.070
	Assisted Living	0.166	0.159	0.156	0.160	0.158
	Auto Dealership	0.081	0.084	0.075	0.069	0.066
	Childcare/Pre-School	0.091	0.088	0.083	0.072	0.066
	College	0.097	0.100	0.088	0.079	0.080
	Convenience Store	0.185	0.191	0.177	0.174	0.175
	Drug Store	0.090	0.093	0.083	0.073	0.069
	Elementary School	0.203	0.200	0.180	0.156	0.146
	Emergency Services	0.084	0.085	0.077	0.067	0.053
	Garage	0.078	0.075	0.068	0.053	0.056
	Greenhouse – w/ Curtains	0.342	0.316	0.277	0.233	0.217
	Greenhouse – w/o Curtains	0.344	0.318	0.279	0.234	0.219
	Grocery	0.212	0.216	0.203	0.203	0.205
	Healthcare Clinic	0.125	0.126	0.115	0.112	0.125
	High School	0.143	0.137	0.141	0.146	0.140
	Hospital - CAV no econ	0.098	0.098	0.087	0.078	0.074
	Hospital - CAV econ	0.101	0.101	0.091	0.083	0.080
	Hospital - VAV econ	0.117	0.118	0.107	0.095	0.097
	Hospital - FCU	0.147	0.151	0.139	0.134	0.136
	Hospital - Unknown	0.116	0.117	0.106	0.098	0.097
	Hotel/Motel	0.130	0.130	0.120	0.110	0.112
	Hotel/Motel - Common	0.136	0.137	0.127	0.118	0.119
	Hotel/Motel - Guest	0.127	0.128	0.118	0.106	0.110
	Manufacturing Facility_Miscellaneous	0.075	0.077	0.069	0.062	0.057
	Manufacturing Facility_Food/Chemical	0.086	0.086	0.076	0.070	0.068
	MF - High Rise	0.074	0.072	0.063	0.045	0.046
	MF - High Rise - Common	0.082	0.076	0.066	0.052	0.052

Piping Use	Building Type	Annual Therms Saved / Linear Foot				
		Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
	MF - High Rise - Residential	0.077	0.076	0.067	0.051	0.054
	MF - Mid Rise	0.117	0.118	0.108	0.098	0.092
	Movie Theater	0.103	0.104	0.093	0.088	0.085
	Office - High Rise - CAV no econ	0.081	0.080	0.072	0.067	0.056
	Office - High Rise - CAV econ	0.081	0.081	0.073	0.069	0.059
	Office - High Rise - VAV econ	0.105	0.106	0.094	0.084	0.091
	Office - High Rise - FCU	0.104	0.103	0.095	0.090	0.088
	Office - Low Rise	0.116	0.119	0.107	0.096	0.091
	Office - Mid Rise	0.088	0.088	0.079	0.071	0.079
	Religious Building	0.115	0.117	0.106	0.089	0.085
	Restaurant	0.123	0.121	0.114	0.104	0.103
	Retail - Department Store	0.058	0.059	0.053	0.043	0.038
	Retail - Strip Mall	0.107	0.109	0.100	0.087	0.082
	Warehouse Nonrefrigerated	0.091	0.090	0.081	0.076	0.074
	Warehouse Refrigerated	0.045	0.043	0.040	0.032	0.028
	Medical Office	0.120	0.121	0.114	0.111	0.120
	Unknown	0.116	0.116	0.106	0.096	0.094
Space Heating - recirculation heating season only	All buildings (Hours below 55°F)	0.399	0.393	0.356	0.319	0.329
Space Heating - recirculation year round	All buildings (All hours)	0.694	0.694	0.694	0.694	0.694
DHW	Recirculation loop	0.694	0.694	0.694	0.694	0.694
Process	Custom	Custom				

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-SPIN-V06-270101

REVIEW DEADLINE: 1/1/2031

4.4.25 Small Commercial Programmable Thermostat Adjustments – Retired 12/31/2019.

4.4.26 Variable Speed Drives for HVAC Supply and Return Fans

DESCRIPTION

This measure is applied to variable speed drives (VSD) which are installed on HVAC supply fans and return fans. The VSD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

Note this measure should be used for evaluating control system modifications. If combined with the evaluation of a more efficient over a baseline fan, measure '4.4.53 HVAC Supply, Return and Exhaust Fans – Fan Energy Index' should be utilized. The FEPnew value from measure 4.4.53 should be used to replace the $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right)$ term in this measure.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The VSD is applied to a motor which does not have a VSD. The application must have a variable load and installation is to include the necessary controls. Savings are based on application of VSDs to a range of baseline load conditions including no control, inlet guide vanes, outlet guide vanes and throttling valves.

DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VSD or other methods of control. Retrofit baseline is an existing motor operating as is. Retrofit baselines may or may not include guide vanes, throttling valves or other methods of control. This information shall be collected from the customer.

Installations of new equipment with VSDs which are required by IECC, state energy code as adopted by the State of Illinois are not eligible for incentives. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for all VSDs is 15 years.[851]

DEEMED MEASURE COST

Customer-provided costs will be used when available. Default measure costs are noted below for up to 75 hp motors.[852] Custom costs must be gathered from the customer for motor sizes not listed below.

HP	Cost
5 HP	$2,585
15 HP	$4,483
25 HP	$6,524
50 HP	$11,239
75 HP	$15,834

LOADSHAPE

Loadshape C39 - VFD - Supply fans <10 HP

Loadshape C40 - VFD - Return fans <10 HP

Loadshape C41 - VFD - Exhaust fans <10 HP

[851] Efficiency Vermont TRM 10/26/11 for HVAC VSD motors.

[852] RS Means, 2023. Equipment and labor costs for new VSD installation in Springfield, IL .

COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS[853]

kWh_{Base} = $$\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times RHRS_{Base} \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Base})$$

$kWh_{Retrofit}$ = $$\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times RHRS_{base} \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Retrofit})$$

ΔkWh_{fan} = $$\mathrm{kWh_{Base}} - \mathrm{kWh_{Retrofit}}$$

ΔkWh_{total} = $$\Delta\mathrm{kWh_{fan}} \times (1 + \mathrm{IE_{energy}})$$

Where:

kWh_{Base} = Baseline annual energy consumption (kWh/yr)

$kWh_{Retrofit}$ = Retrofit annual energy consumption (kWh/yr)

ΔkWh_{fan} = Fan-only annual energy savings

ΔkWh_{total} = Total project annual energy savings

0.746 = Conversion factor for HP to kWh

HP = Nominal horsepower of controlled motor

LF = Load Factor; Motor Load at Fan Design CFM (Default = 65%)[854]

η_{motor} = Installed nominal/nameplate motor efficiency

Default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor

[853] Methodology developed and tested in Del Balso, Ryan Joseph. "Investigation into the Reliability of Energy Efficiency/Demand Side Management Savings Estimates for Variable Frequency Drives in Commercial Applications". A project report submitted to the Faculty of the Graduate School of the University of Colorado, 2013.

[854] Lawrence Berkeley National Laboratory, and Resource Dynamics Corporation. (2008). "Improving Motor and Drive System Performance; A Sourcebook for Industry". U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy. Golden, CO: National Renewable Energy Laboratory.

NEMA Premium Efficiency Motors Default Efficiencies[855]

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

$RHRS_{Base}$ = Annual operating hours for fan motor based on building type

Default hours are provided for HVAC applications which vary by HVAC application and building type.[856] When available (provided via Energy Management Software or metered), actual hours should be used.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Assembly	2,374	OpenStudio	VAV
Assisted Living	6,375	OpenStudio	CAV
Auto Dealership	5,326	OpenStudio	CAV
Childcare/Pre-School	2,177	OpenStudio	CAV and VAV

[855] Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.

[856] Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
College	3,753	OpenStudio	CAV and VAV
Convenience Store	8,760	OpenStudio	CAV
Drug Store	6,034	OpenStudio	CAV
Elementary School	2,305	OpenStudio	VAV
Emergency Services	8,760	OpenStudio	CAV
Garage	7,357	eQuest	CAV
Grocery	7,568	OpenStudio	CAV
Healthcare Clinic	4,471	OpenStudio	VAV
High School	3,118	OpenStudio	VAV
Hospital - CAV no econ	7,166	OpenStudio	CAV
Hospital - CAV econ	7,225	OpenStudio	CAV
Hospital - VAV econ	3,757	OpenStudio	VAV
Hospital - FCU	4,727	OpenStudio	CAV
Hospital - Unknown	5,719	OpenStudio	Average of hospital models
Hotel/Motel	3,712	OpenStudio	CAV
Hotel/Motel - Common	8,678	OpenStudio	CAV
Hotel/Motel - Guest	2,112	OpenStudio	CAV
Manufacturing Facility_Miscellaneous	2,267	OpenStudio	CAV
Manufacturing Facility_Food/Chemical	4,702	OpenStudio	CAV
MF - High Rise	2,617	OpenStudio	CAV
MF - High Rise - Common	3,411	OpenStudio	CAV
MF - High Rise - Residential	2,613	OpenStudio	CAV
MF - Mid Rise	8,450	OpenStudio	CAV
Movie Theater	1,779	OpenStudio	VAV
Office - High Rise - CAV no econ	5,459	OpenStudio	CAV
Office - High Rise - CAV econ	5,430	OpenStudio	CAV
Office - High Rise - VAV econ	2,884	OpenStudio	VAV
Office - High Rise - FCU	2,130	OpenStudio	CAV
Office - Low Rise	4,721	OpenStudio	CAV
Office - Mid Rise	3,413	OpenStudio	VAV
Religious Building	3,783	OpenStudio	VAV
Restaurant	8,226	OpenStudio	CAV
Retail - Department Store	5,245	OpenStudio	CAV
Retail - Strip Mall	4,189	OpenStudio	CAV
Warehouse Nonrefrigerated	3,142	OpenStudio	CAV
Warehouse Refrigerated	3,076	OpenStudio	CAV
Medical Office	3,498	OpenStudio	VAV
Unknown	3991	n/a	n/a

$\%FF$ = Percentage of run-time spent within a given flow fraction range

Default Fan Duty Cycle Based on 2012 ASHRAE Handbook; HVAC Systems and Equipment, page 45.11, Figure 12.

Flow Fraction (% of design cfm)	Percent of Time at Flow Fraction
0% to 10%	0.0%
10% to 20%	1.0%
20% to 30%	5.5%
30% to 40%	15.5%
40% to 50%	22.0%
50% to 60%	25.0%
60% to 70%	19.0%
70% to 80%	8.5%
80% to 90%	3.0%
90% to 100%	0.5%

PLR_{Base} = Part load ratio for a given flow fraction range based on the baseline flow control type

$PLR_{Retrofit}$ = Part load ratio for a given flow fraction range based on the retrofit flow control type

Control Type	Flow Fraction									
	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%
No Control or Bypass Damper	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Discharge Dampers	0.46	0.55	0.63	0.70	0.77	0.83	0.88	0.93	0.97	1.00
Outlet Damper, BI & Airfoil Fans	0.53	0.53	0.57	0.64	0.72	0.80	0.89	0.96	1.02	1.05
Inlet Damper Box	0.56	0.60	0.62	0.64	0.66	0.69	0.74	0.81	0.92	1.07
Inlet Guide Vane, BI & Airfoil Fans	0.53	0.56	0.57	0.59	0.60	0.62	0.67	0.74	0.85	1.00
Inlet Vane Dampers	0.38	0.40	0.42	0.44	0.48	0.53	0.60	0.70	0.83	0.99
Outlet Damper, FC Fans	0.22	0.26	0.30	0.37	0.45	0.54	0.65	0.77	0.91	1.06
Eddy Current Drives	0.17	0.20	0.25	0.32	0.41	0.51	0.63	0.76	0.90	1.04
Inlet Guide Vane, FC Fans	0.21	0.22	0.23	0.26	0.31	0.39	0.49	0.63	0.81	1.04
VFD with duct static pressure controls	0.09	0.10	0.11	0.15	0.20	0.29	0.41	0.57	0.76	1.01
VFD with low/no duct static pressure	0.05	0.06	0.09	0.12	0.18	0.27	0.39	0.55	0.75	1.00

Provided below is the resultant values based upon the defaults provided above:

Control Type	$\sum_{0\%}^{100\%}(\%FF \times PLR_{Base})$
No Control or Bypass Damper	1.00
Discharge Dampers	0.80
Outlet Damper, BI & Airfoil Fans	0.78
Inlet Damper Box	0.69
Inlet Guide Vane, BI & Airfoil Fans	0.63
Inlet Vane Dampers	0.53
Outlet Damper, FC Fans	0.53
Eddy Current Drives	0.49

Control Type	$\sum_{0\%}^{100\%}(\%FF \times PLR_{Base})$
Inlet Guide Vane, FC Fans	0.39
VFD with duct static pressure controls	0.30
VFD with low/no duct static pressure	0.27

IE_{energy} = HVAC interactive effects factor for energy (default = 15.7%)

SUMMER COINCIDENT PEAK DEMAND SAVINGS

kW_{Base} = $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times PLR_{Base,FFpeak}$

$kW_{Retrofit}$ = $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times PLR_{Retrofit,FFpeak}$

ΔkW_{fan} = $\mathrm{kW_{Base}} - \mathrm{kW_{Retrofit}}$

ΔkW_{total} = $\Delta \mathrm{kW_{fan}} \times (1 + \mathrm{IE_{demand}})$

Where:

kW_{Base} = Baseline summer coincident peak demand (kW)

$kW_{Retrofit}$ = Retrofit summer coincident peak demand (kW)

ΔkW_{fan} = Fan-only summer coincident peak demand impact

ΔkW_{total} = Total project summer coincident peak demand impact

$PLR_{Base,FFpeak}$ = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the baseline flow control type (default average flow fraction during peak period = 90%)

$PLR_{Retrofit,FFpeak}$ = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the retrofit flow control type (default average flow fraction during peak period = 90%)

IE_{demand} = HVAC interactive effects factor for summer coincident peak demand (default = 15.7%)

FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION

There are no expected fossil fuel impacts for this measure.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-VSDF-V12-270101

REVIEW DEADLINE: 1/1/2029

4.4.27 Energy Recovery Ventilator

DESCRIPTION

This measure includes the addition of energy recovery equipment on existing or new unitary equipment, where energy recovery is not required by the IECC 2012/2015/2018/2021/2024. This measure analyzes the heating and cooling savings potential from recovering energy from exhaust or relief building air. This measure assumes that during unoccupied hours of the building no exhaust or relief air is available for energy recovery.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Efficient equipment is unitary equipment that incorporates energy recovery not required by the IECC 2012/2015/2018/2021/2024.

DEFINITION OF BASELINE EQUIPMENT

The baseline is unitary equipment not required by IECC 2012/2015/2018/2021/2024 to incorporate energy recovery.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the domestic energy recovery equipment is 15 years.[857]

DEEMED MEASURE COST

The incremental cost for this measure assumes cost of cabinet and controls incorporated into packaged and built up air handler units. Additionally, it assumes a 1 to 1 ratio of fresh and exhausted air.

Energy Recovery Equipment Type	Incremental Cost $/CFM[858]
Plate Heat Exchanger	$3.75
Rotary Wheel	$3.75

DEEMED O&M COST ADJUSTMENTS

There are no expected O&M savings associated with this measure.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

[857] Assumed service life limited by controls - "Demand Control Ventilation Using CO_2 Sensors", pg. 19, by US Department of Energy Efficiency and Renewable Energy.
[858] "National Cost-Effectiveness of ASHRAE Standard 90.1-2010 Compared to ASHRAE Standard 90.1-2007", PNNL, November 2007 (page 4-16).

Algorithm

CALCULATION OF ENERGY SAVINGS ELECTRIC ENERGY SAVINGS

The electric energy savings calculation here represents the net electric energy savings from reduced cooling requirements after accounting for increased fan power caused by additional pressure drop from the ERV device. These savings do not account for heating energy savings in HVAC systems using heat pumps or electric resistance heat. This calculation does not apply to sensible-only devices such as heat pipes.

ΔkWh = $(cfm) * Normalized\ Electric\ Energy\ Savings$

cfm = design supply air flow of energy recovery ventilator in cubic feet per minute

= rated energy recovery ventilator supply air flow * (1 – Exhaust Air Transfer Ratio)

Exhaust Air Transfer Ratio = percentage of supply air made up of cross-leakage from exhaust air; value provided by vendor

= 0.05 (default)

Normalized Electric Energy Savings

= kWh/cfm savings value for the expected energy savings (net of fan energy penalty) as detailed in Table 1 – Electric Energy Savings Summary (kWh/cfm)

Table 1 – Electric Energy Savings Summary (kWh/cfm)[859]

Building Type	Normalized Electricity Savings (kWh/OA cfm)				
	Zone 1 - Rockford	Zone 2 - Chicago	Zone 3 - Springfield	Zone 4 - Mt. Vernon/Belleville	Zone 5 - Marion
Enthalpy Wheel - 75% sensible and latent effectiveness					
Assembly	NA	NA	NA	0.107	0.229
Education	NA	NA	0.371	0.245	0.369
Grocery	NA	NA	0.239	0.523	0.630
Healthcare	1.551	1.594	2.508	2.999	3.077
Multifamily	2.178	2.566	3.781	4.746	5.029
Office	0.974	1.169	2.379	2.998	3.194
Retail	0.048	0.124	0.389	1.027	1.063
Enthalpy Plate - 50% sensible and latent effectiveness					
Assembly	NA	NA	NA	NA	NA
Education	NA	NA	NA	NA	0.035
Grocery	NA	NA	NA	0.002	0.102
Healthcare	0.923	0.963	1.548	1.841	1.908
Multifamily	0.627	0.908	1.450	2.341	2.509
Office	0.309	0.487	1.321	1.705	1.918
Retail	NA	NA	NA	0.398	0.435

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $(cfm) * Normalized\ Electric\ Peak\ Demand\ Savings * CF$

= design supply air flow of energy recovery ventilator in cubic feet per minute

= rated energy recovery ventilator supply air flow * (1 – Exhaust Air Transfer Ratio)

[859] Energy savings modeled using IL TRM energy models with added energy recovery wheels or enthalpy plates. Energy recovery device specifications based on product data from the AHRI Certification Directory (https://www.ahridirectory.org/Search/SearchHome?ReturnUrl=%2f). See reference "ERV Effectiveness AHRI Directory Survey."

Exhaust Air Transfer Ratio = percentage of supply air made up of cross-leakage from exhaust air; value provided by vendor

= 0.05 (default)

CF = 1.0

Normalized Electric Peak Demand Savings

= kW/cfm savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 2 – Electric Peak Demand Savings Summary (kW/cfm)

Table 2 – Electric Peak Demand Savings Summary (kW/cfm)[860]

Building Type	Normalized Electric Demand Savings (kW/OA cfm)				
	Zone 1 - Rockford	Zone 2 - Chicago	Zone 3 - Springfield	Zone 4 - Mt. Vernon/Belleville	Zone 5 - Marion
Enthalpy Wheel - 75% sensible and latent efficiency					
Assembly	0.00127	0.00092	0.00111	0.00213	0.00209
Education	0.00159	0.00164	0.00282	0.00202	0.00308
Grocery	0.00115	0.00159	0.00152	0.00153	0.00187
Healthcare	0.00465	0.00433	0.00480	0.00443	0.00443
Multifamily	0.00210	0.00325	0.00298	0.00370	0.00381
Office	0.00538	0.00518	0.00527	0.00529	0.00589
Retail	0.00156	0.00195	0.00020	0.00217	0.00223
Enthalpy Plate - 50% sensible and latent efficiency					
Assembly	NA	NA	0.00024	0.00115	0.00113
Education	0.00114	0.00118	0.00201	0.00142	0.00218
Grocery	0.00059	0.00089	0.00083	0.00079	0.00102
Healthcare	0.00287	0.00284	0.00306	0.00292	0.00275
Multifamily	NA	0.00128	0.00111	0.00172	0.00167
Office	0.00351	0.00344	0.00344	0.00345	0.00384
Retail	0.00087	0.00123	0.00001	0.00119	0.00124

FOSSIL FUEL SAVINGS

Gas savings algorithm is derived from the following:

ΔTherms $=(Design\ Heating\ Load * TE_ERV * EFLH * OccHours/24) / (100{,}000 * \eta Heat)$

Where:

Design Heating Load = (1.08 * CFM * ΔT)

1.08 = A constant for sensible heat equations (BTU/h/CFM.°F)

CFM = Cubic Feet per Minute of Energy Recovery Ventilator

ΔT = T_RA – T_DD

T_RA = Temperature of the Return Air = 70°F or custom

[860] Demand savings modeled using IL TRM energy models with added energy recovery wheels or enthalpy plates. Energy recovery device specifications based on product data from the AHRI Certification Directory (https://www.ahridirectory.org/Search/SearchHome?ReturnUrl=%2f). Coincident demand measured according to TRM guidelines, though in 1-hour increments as established by the eQUEST simulation.

T_DD = Temperature on design day of outside air[861]

= (see Table below) or custom

Zone	Weather Station	T_DD, Temperature, °F
1	Greater Rockford	-5.4
2	Chicago/O'Hare ARPT.	-1.0
3	Springfield/Capital	1.1
4	Scott AFB MidAmerica	7.2
5	Cape Girardeau Regional	10.1
Average	-	2.4

TE_ERV = Thermal Effectiveness of Energy Recovery Equipment[862]

= (see Table below) or custom

Heat Recovery Equipment Type	TE_ERV (%)
Fixed Plate	0.65
Rotary Equipment	0.68

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

OccHours = Average Hours per day facility is occupied

= custom or use Modeling Inputs in eQuest models:

Building Type	Weekday	Saturday	Sunday	Holiday	Annual Operating Hours	OccHours
Assembly/Convention Center	10am-9pm	10am-9pm	10am-9pm	closed	3905	10.7
Assisted Living	24/7	24/7	24/7	24/7	8760	24.0
College	8am-9pm	closed	closed	closed	3263	8.9
Convenience Store	7am-10pm	9am-9pm	10am-5pm	10am-5pm	4823	13.2
Elementary School	8am-4pm (20% in summer)	closed	closed	closed	1606	4.4
Garage	7am-5pm	8am-12pm	closed	closed	3342	9.1
Grocery	7am-9pm	7am-9pm	9am-8pm	closed	4814	13.2
Healthcare Clinic	7am-7pm	9am-5pm	closed	closed	3428	9.4
High School	8am-4pm (20% in summer)	closed	closed	closed	1606	4.4
Hospital	24/7	24/7	24/7	24/7	8760	24.0
Motel	24/7	24/7	24/7	24/7	8760	24.0
Manufacturing Facility (Light Industry)	Mfg: 6am-10pm, Office: 8am-5pm	Mfg: 6am-10pm, Office: closed	closed	closed	4848	13.3
Multi-Family Mid-Rise	24/7; Reduced occupancy 7am - 5pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	7038	19.3

[861]Weather Station Data, 99.6% Heating DB - 2021 Fundamentals, ASHRAE Handbook. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

[862]Energy Recovery Fact Sheet - Center Point Energy, MN

Building Type	Weekday	Saturday	Sunday	Holiday	Annual Operating Hours	OccHours
Multi-Family High-Rise	24/7; Reduced occupancy 7am - 5pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	24/7; Reduced occupancy 9am - 3pm	7038	19.3
Movie Theater	10am-Midnight	10am-Midnight	10am-Midnight	10am-Midnight	5110	14.0
Office - Low-rise	8am-5pm	closed	closed	closed	2259	6.2
Office - Mid-rise	8am-5pm	20% 8am-noon	closed	closed	2301	6.3
Office - High-rise	8am-5pm	20% 8am-noon	closed	closed	2301	6.3
Religious Building	Office: 8am-5pm, other: closed	closed	8am-1pm	closed	260	0.7
Restaurant	7am-8pm	7am-8pm	7am-8pm	closed	4615	12.6
Retail - Department Store	9am-9pm	9am-9pm	10am-5pm	10am-5pm	4070	11.1
Retail - Strip Mall	9am-9pm	9am-9pm	10am-5pm	10am-5pm	4070	11.1
Warehouse (Conditioned Storage)	7am-7pm	7am-7pm (reduced occupancy)	closed	closed	3324	9.1

ηHeat = Efficiency of heating system

= Actual

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-ERVE-V09-270101

REVIEW DEADLINE: 1/1/2029

4.4.28 Stack Economizer for Boilers Serving HVAC Loads

MEASURE DESCRIPTION

Stack economizers are designed to recover heat from hot boiler flue gasses. Recovered heat is used to preheat boiler feed water. This measure describes the retrofit of HVAC boilers with stack economizers. HVAC boilers are defined as those used for space heating applications. There is another, similar measure for boilers that serve process loads.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify the economizer must be installed on a boiler exhaust stack. Heat captured by the economizer is to be used to pre-heat boiler feed water.

DEFINITION OF BASELINE EQUIPMENT

The baseline boiler does not have an economizer installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be the lower of the remaining useful life of the boiler or 15 years.[863]

DEEMED MEASURE COST

The incremental and full measure cost for this measure is custom.

DEEMED O&M COST ADJUSTMENTS

The O&M cost for this measure is custom.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = SF * MBH_In * EFLH / 100$$

Where:

SF = Savings factor

= calculated custom as (T_existing – T_eff) / 40°F * TRE or when not possible a default value based on the table below

[863] PA Consulting, Focus on Energy Evaluation, Business Programs: Measure Life Study, August 25, 2009.

Where:

T_existing = Existing Full Fire Boiler Flue Gas Temperature as it exits the Stack[864]
= 425°F (water, 81.9% eff) or custom
= 480°F (steam, 80.7% eff) or custom

T_eff = Efficient Full Fire Boiler Flue Gas Temperature as it exits the Stack
= 338°F (conventional economizer – Water Boiler)[865] or custom
= 365°F (conventional economizer – Steam Boiler)[866] or custom
= 280°F (condensing economizer – Water Boiler)[867] or custom
= 308°F (condensing economizer – Steam Boiler)[868] or custom

TRE = % efficiency increase for 40°F of stack temperature reduction
= 1%,[869] or custom

Based on defaults provided above:

Boiler Type	SF[870]	
	Conventional Economizer	Condensing Economizer
Hot Water Boiler	2.19% average SF or custom	3.63% average SF or custom
Steam Boiler	2.88% average SF or custom	4.31% average SF or custom

MBH_In = Rated boiler input capacity, in MBH
= Actual

EFLH = Equivalent Full Load Hours for heating are provided in Section 4.4 HVAC End Use

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

[864] Cleaver Brooks. March 2012, Boiler Efficiency Guide, Pg. 7, Figure 1.
[865] The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (425°F + 250°F) / 2 = 338°F.
[866] The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (480°F + 250°F) / 2 = 365°F.
[867] The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (425°F + 135°F) / 2 = 280°F.
[868] The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (480°F + 135°F) / 2 = 308°F.
[869] United States EPA, Climate Wise: Wise Rules for Industrial Efficiency, July 1998. The Wise Rules indicate savings range of 1-2% per 40°F reduction, so utilizing 1% is a conservative approach.
[870] These average values should be utilized in absence of actual temperature data. An economizer with a zero temperature change between the existing and the efficient temperatures would not be installed, so these average values are conservative.

DEEMED O&M COST ADJUSTMENT CALCULATION

Depending on design, stack economizers may require routine maintenance for optimal performance. A custom calculation should be used as necessary.

MEASURE CODE: CI-HVC-BECO-V03-250101

REVIEW DEADLINE: 1/1/2028

4.4.29 Stack Economizer for Boilers Serving Process Loads

MEASURE DESCRIPTION

Stack economizers are designed to recover heat from hot boiler flue gasses. Recovered heat is used to preheat boiler feed water. This measure describes the retrofit of process boilers with stack economizers. Process boilers are defined as those used for industrial, manufacturing, or other non-HVAC applications. There is another, similar measure for boilers that serve HVAC loads.

This measure was developed to be applicable to the following program types: NC, TOS, RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The economizer must be installed on a boiler exhaust stack. Heat captured by the economizer is to be used to pre-heat boiler feed water.

DEFINITION OF BASELINE EQUIPMENT

The baseline boiler does not have an economizer installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be the lower of the remaining useful life of the for the boiler or 15 years.[871]

DEEMED MEASURE COST

The incremental and full measure cost for this measure is custom.

DEEMED O&M COST ADJUSTMENTS

The O&M cost for this measure is custom.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = SF * MBH_In * 8766 * UF / 100$$

Where:

SF = $(T_existing - T_eff)/40°F * TRE$

= see default Savings Factor table below

[871] PA Consulting, Focus on Energy Evaluation, Business Programs: Measure Life Study, August 25, 2009.

T_existing = Existing Full Fire Boiler Flue Gas Temperature as it exits the Stack[872]
= 425°F (water, 81.9% eff per IL TRM) or custom
= 480°F (steam, 80.7% eff per IL TRM) or custom

T_eff = Efficient Full Fire Boiler Flue Gas Temperature as it exits the Stack
= 338°F (conventional economizer – Water Boiler)[873] or custom
= 365°F (conventional economizer – Steam Boiler)[874] or custom
= 280°F (condensing economizer – Water Boiler)[875] or custom
= 308°F (condensing economizer – Steam Boiler)[876] or custom

TRE = % efficiency increase for 40°F of stack temperature reduction
= 1%,[877] or custom

Based on defaults provided above:

Boiler Type	SF[878]	
	Conventional Economizer	Condensing Economizer
Hot Water Boiler	2.19% average SF or custom	3.63% average SF or custom
Steam Boiler	2.88% average SF or custom	4.31% average SF or custom

MBH_In = Rated boiler input capacity, in MBH
= Actual

8766 = Hours a year

UF = Utilization Factor
= 41.9%,[879] or custom

[872] Cleaver Brooks. March 2012, Boiler Efficiency Guide, Pg. 7, Figure 1.
[873] The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (425°F + 250°F) / 2 = 338°F.
[874] The minimum stack temperature for a non-condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (480°F + 250°F) / 2 = 365°F.
[875] The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (425°F + 135°F) / 2 = 280°F.
[876] The minimum stack temperature for a condensing economizer is 250°F from Department of Energy (DOE). January 2012, Steam Tip Sheet #26A, Consider Installing a Condensing Economizer. Advanced Manufacturing Office. Washington, DC: U.S. Department of Energy. The average temperature drop is assumed to be ½ way between the existing and efficient temperature minimum, (480°F + 135°F) / 2 = 308°F.
[877] United States EPA, Climate Wise: Wise Rules for Industrial Efficiency, July 1998. The Wise Rules indicate savings range of 1-2% per 40°F reduction, so utilizing 1% is a conservative approach.
[878] These average values should be utilized in absence of actual temperature data. An economizer with a zero temperature change between the existing and the efficient temperatures would not be installed, so these average values are conservative.
[879] Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-PECO-V04-260101

REVIEW DEADLINE: 1/1/2029

4.4.30 Notched V Belts for HVAC Systems

MEASURE DESCRIPTION

This measure is for replacement of smooth v-belts in non-residential package and split HVAC systems with notched v-belts or for installing new equipment with synchronous belts instead of smooth v-belts. Typically there is a v-belt between the motor and the supply air fan and/or return air fan in larger package and split HVAC systems (RTU).

In general there are two styles of grooved v-belts, notched and synchronous. The DOE defines each as follows;

Notched V-Belts - A notched belt has grooves or notches that run perpendicular to the belt's length, which reduces the bending resistance of the belt. Notched belts can use the same pulleys as cross-section standard V-belts. They run cooler, last longer, and are about 2% more efficient than standard V-belts.

Synchronous Belts - Synchronous belts (also called cogged, timing, positive-drive, or high-torque drive belts) are toothed and require the installation of mating grooved sprockets. These belts operate with a consistent efficiency of 98% and maintain their efficiency over a wide load range.

- Smooth v-belts are usually referred to in five basic groups:
- "L" belts are low end belts that are for small, fractional horsepower motors and these are not used in RTUs.
- "A" and "B" belts are the two types typically used in RTUs. The "A" belt is a ½ inch width by 5/16 inch thickness and the "B" belt is larger, 21/32 inch wide and 12/32 inch thick so it can carry more power. V-belts come in a wide variety of lengths where 20 to 100 inches is typical.
- "C" and "D" belts are primarily for industrial applications with high power transmission requirements.
- V-belts are provided by various vendors. The notched version of these belts typically have an "X" added to the designation. For this measure, only the "A" and "B" v-belts are considered. A typical "A" v-belt is replaced by a notched "AX" v-belt and a "B" is replaced by a "BX." In general, smooth v-belts have an efficiency of 90% to 98% while notched v-belts have an efficiency of 95% to 98%. Because notched v-belts are more flexible they work with smaller diameter pulleys and they have less resistance to bending. Lower bending resistance increases the power transmission efficiency, lowers the waste heat, and allows the belt to last longer than a smooth belt.

Three research papers[880] [881] [882] show that the notched v-belt efficiency is 2% to 5% better than a typical smooth v-belt. A fourth paper by USDOE's Energy Efficiency and Renewable Energy[883] group reviewed most of the earlier literature and recommended using a conservative 2% efficiency improvement for energy savings for calculations.

For this measure it is assumed that upgrading a standard smooth v-belt with a new notched v-belt will result in a fan energy reduction of 2%.

DEFINITION OF EFFICIENT EQUIPMENT

For the Notched V-Belt characterization to apply, the Efficient Equipment is HVAC RTUs that have notched v-belts installed on the supply and/or return air fans. This can be done as a retrofit, TOS, or NC project.

For the Synchronous Belt characterization to apply, the Efficient Equipment is HVAC RTUs that have synchronous belts installed on the supply and/or return air fans. This can be done as a TOS or NC project. Retrofit projects can also claim savings, but costs should be verified independently (typically the cost of installing synchronous belts and drive sprockets as a retrofit is not economically viable).

[880] "Gates Corporation Announces New EPDM Molded Notch V-Belts," The Gates Rubber Co., June 2010 (Assumed 3% efficiency improvement).
[881] "Synchronous Belt Drives Offer Low Cost Energy Savings," Baldor. February 2009. (attached in Reference Documents).
[882] "Energy Savings from Synchronous Belts," The Gates Rubber Co., February 2014. (Assumed 5% efficiency improvement).
[883] "Motor System Tip Sheet #5, Replace V-Belts with Cogged or Synchronous Belt Drives," USDOE-EERE, September 2005. (Assumed 2% efficiency improvement).

DEFINITION OF BASELINE EQUIPMENT

The Baseline Equipment is HVAC RTUs that have smooth v-belts installed on the supply and/or return air fans (i.e., RTU does not already have a notched v-belt installed).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

A v-belt has a life based on fan run hours which varies by building type based primarily on occupancy schedule because the fans are required by code to operate continuously during occupied hours. The supply and return fans will also run a few hours during unoccupied hours for heating and cooling as needed. For the notched v-belt EUL calculation, the default hours in the following table are used for a variety of building types and HVAC applications.

EUL = Belt Life / Occupancy Hours per year

Where:

Belt Life = 24,000 hours[884]

Occupancy Hours per year = values from Table below

The notched v-belt measure EUL is summarized by building type in the following table.

Notched v-belt Effective Useful Life (EUL)

Building Type	Total Fan Run Hours[885]	EUL (Years)	Model Source	Fan Type in Model
Assembly	2,374	10.1	OpenStudio	VAV
Assisted Living	6,375	3.8	OpenStudio	CAV
Auto Dealership	5,326	4.5	OpenStudio	CAV
Childcare/Pre-School	2,177	11.0	OpenStudio	CAV and VAV
College	3,753	6.4	OpenStudio	CAV and VAV
Convenience Store	8,760	2.7	OpenStudio	CAV
Drug Store	6,034	4.0	OpenStudio	CAV
Elementary School	2,305	10.4	OpenStudio	VAV
Emergency Services	8,760	2.7	OpenStudio	CAV
Garage	7,357	3.3	eQuest	CAV
Grocery	7,568	3.2	OpenStudio	CAV
Healthcare Clinic	4,471	5.4	OpenStudio	VAV
High School	3,118	7.7	OpenStudio	VAV
Hospital - CAV no econ	7,166	3.3	OpenStudio	CAV
Hospital - CAV econ	7,225	3.3	OpenStudio	CAV
Hospital - VAV econ	3,757	6.4	OpenStudio	VAV
Hospital - FCU	4,727	5.1	OpenStudio	CAV
Hospital - Unknown	5,719	4.2	OpenStudio	Average of hospital models
Hotel/Motel	3,712	6.5	OpenStudio	CAV
Hotel/Motel - Common	8,678	2.8	OpenStudio	CAV

[884] "DEER2014-EUL-table-update_2014-02-05.xlsx," Database for Energy Efficiency Resources (DEER), DEER2014 EUL Table. (attached in Reference Documents).

[885] Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

Building Type	Total Fan Run Hours[885]	EUL (Years)	Model Source	Fan Type in Model
Hotel/Motel - Guest	2,112	11.4	OpenStudio	CAV
Manufacturing Facility_Miscellaneous	2,267	10.6	OpenStudio	CAV
Manufacturing Facility_Food/Chemical	4,702	5.1	OpenStudio	CAV
MF - High Rise	2,617	9.2	OpenStudio	CAV
MF - High Rise - Common	3,411	7.0	OpenStudio	CAV
MF - High Rise - Residential	2,613	9.2	OpenStudio	CAV
MF - Mid Rise	8,450	2.8	OpenStudio	CAV
Movie Theater	1,779	13.5	OpenStudio	VAV
Office - High Rise - CAV no econ	5,459	4.4	OpenStudio	CAV
Office - High Rise - CAV econ	5,430	4.4	OpenStudio	CAV
Office - High Rise - VAV econ	2,884	8.3	OpenStudio	VAV
Office - High Rise - FCU	2,130	11.3	OpenStudio	CAV
Office - Low Rise	4,721	5.1	OpenStudio	CAV
Office - Mid Rise	3,413	7.0	OpenStudio	VAV
Religious Building	3,783	6.3	OpenStudio	VAV
Restaurant	8,226	2.9	OpenStudio	CAV
Retail - Department Store	5,245	4.6	OpenStudio	CAV
Retail - Strip Mall	4,189	5.7	OpenStudio	CAV
Warehouse Nonrefrigerated	3,142	7.6	OpenStudio	CAV
Warehouse Refrigerated	3,076	7.8	OpenStudio	CAV
Medical Office	3,498	6.9	OpenStudio	VAV
Unknown	3991	6.0	n/a	n/a

The lifetime of a synchronous belt system is the same as the lifetime of the equipment it is installed on because it is a permanent upgrade, involving the installation of toothed pulleys. Typical HVAC RTU lifetime is 15 years, which applies to synchronous belts as well. This is not to suggest that the actual belt component has an equivalent lifetime because they do require replacement. However, their O&M cost savings (derived from not having to tension, etc.) are assumed to offset the replacement cost of the belt, resulting in a net cost of zero. As a result, neither a separate lifetime nor O&M savings are quantified for synchronous belts and lifetime can therefore be considered as the lifetime of the equipment they're installed on because it would not be possible to install a traditional or notched belt on the synchronous pulleys.

DEEMED MEASURE COST

Costs of belts and pulleys are known to vary substantially based on belt length and pulley diameter. Two cost estimations are provided below; a fully deemed approach for applications such as an upstream program where limited information is known, and a semi-custom approach that is useful when more accurate cost estimates are desired.

Fully Deemed:

A review of the Grainger online pricing for "A," "B," "AX," and "BX" v-belts[886] revealed the incremental costs to upgrade to notched v-belts as summarized in the table below:

[886] Grainger catalog on-line web-site for Dayton v-belt pricing.

Notched V-belt Incremental Cost Summary

Smooth V-Belt Industry Number	Outside Length (Inches)	Dayton Smooth V-Belt*	Notched V-belt Industry Number	Dayton Notched v-belt*	Price Increase	% Increase
A30 (Item # 1A095)	32	$9.11	AX30 (Item # 3GWU4)	$12.71	$3.60	40%
B29 (Item # 6L208)	32	$11.72	BX29 (Item # 5TXL4)	$16.78	$5.00	43%
* Pricing based on Dayton Belts as found on Grainger Website 4/24/2026						

Note that the incremental cost for notched V-Belts assumes that the notched belt is purchased and installed instead of a smooth v-belt. There is no difference in the cost of installation, only the material.

Synchronous Belt Incremental Cost Summary

Smooth V-Belt Industry Number	Smooth belt system Price*	Synchronous Belt Industry Number	Synchronous System Price*	Price Difference
Belt A30 (Item # 1A095)	$9.11	Belt 1DHL5 (Item # 322L050)	$28.28	$19.17
Gearbelt pulley BK47 (Item #5UHD5)	$59.49	Gearbelt sprocket 68-5P25-2012 (Item 809TZ9)	$160.86	$101.37
* Costs based on Grainger pricing, accessed 4/24/2026				

Incremental cost for a NC or TOS project is approximately $221.91. This is the price of synchronous equipment (belt, two sprockets) subtract v-belt equipment (belt, two pulleys). Labor cost is assumed to be equal in the baseline and efficient cases.

Incremental cost for a RF project is $490.89. This is the price of synchronous equipment and labor to install it[887] (not including a trip charge), less the cost of the v-belt (but not the pulleys).

Semi-Custom[888]

Use the following relationships along with NC, TOS and RF assumptions outlined above to estimate semi-custom costs.

Component	Type	Cost Function (per inch)	Inch Measurement
Standard V-Belt	A	$0.28/in + $0.96	Outside Length
Standard V-Belt	B	$0.29/in + $9.15	Outside Length
Standard Pulley	A, B, AX, BX	$11.85/in - $9.47	Outside Diameter
Notched Belt	AX	$0.36/in + $1.07	Outside Length
Notched Belt	BX	$0.49/in + $2.33	Outside Length
Synchronous Belt	1/2 inch	$0.58/in + $8.90	Pitch Length
Synchronous Belt	1 inch	$0.26/in + $5.67	Pitch Length
Synchronous Pulley	for use with 1/2 inch belt	$27.20/in - $21.19	Pitch Diameter
Synchronous Pulley	for use with 1 inch belt	$25.04/in - $27.23	Pitch Diameter

[887] Assumed to be $150 based on mechanical contractor estimate.
[888] Based on review and trend fitting cost data from Grainger online. See reference document “Notched V Belts costs.xlsx” for derivation.

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

Loadshape C05 - Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = kW_{connected} * Hours * ESF$$

Where:

$kW_{Connected}$ =kW of equipment is calculated using motor efficiency[889]

= (HP * 0.746 kW/HP* Load Factor)/Motor Efficiency

Load Factor =Motors are assumed to have a load factor of 80% for calculating KW if actual values cannot be determined.[890] Custom load factor may be applied if known.

Motor Efficiency = Actual motor efficiency shall be used to calculate KW. If not known a value from the motor efficiency refrence tables below should be used.[891] Default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor.

Motor Efficiencies (EPACT)						
Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles					
	6	4	2	6	4	2
	Speed (RPM)					
	1200	1800	3600	1200	1800	3600
1/8	-	44.00%	-	-	-	-
1/6	57.50%	62.00%	-	-	-	-
1/4	68.00%	68.00%	-	68.00%	64.00%	-
1/3	70.00%	70.00%	72.00%	70.00%	68.00%	72.00%
1/2	78.50%	80.00%	68.00%	72.00%	74.00%	68.00%
3/4	77.00%	78.50%	74.00%	77.00%	75.50%	74.00%
1	80.00%	82.50%	75.50%	80.00%	82.50%	75.50%
1.5	84.00%	84.00%	82.50%	85.50%	84.00%	82.50%
2	85.50%	84.00%	84.00%	86.50%	84.00%	84.00%
3	86.50%	86.50%	84.00%	87.50%	87.50%	85.50%
5	87.50%	87.50%	85.50%	87.50%	87.50%	87.50%
7.5	88.50%	88.50%	87.50%	89.50%	89.50%	88.50%
10	90.20%	89.50%	88.50%	89.50%	89.50%	89.50%

[889] Note that kWConnected may be determined using various methodologies. The examples provided use rated HP and assumed load factor. Other methodologies include rated voltage and full load current with assumed load factor, or actual measured voltage and current.

[890] Com Ed TRM June 1, 2010.

[891] Efficiency values for motors less than one HP taken from Baldor Electric Catalog 501, standard motor product catalog.

Motor Efficiencies (EPACT)						
15	90.20%	91.00%	89.50%	90.20%	91.00%	90.20%
20	91.00%	91.00%	90.20%	90.20%	91.00%	90.20%
25	91.70%	91.70%	91.00%	91.70%	92.40%	91.00%

Motor Efficiencies (NEMA Premium)						
Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	2	4	6	2	4	6
	Speed (RPM)			Speed (RPM)		
	1200	1800 (Default)	3600	1200	1800	3600
1/8	-	44.00%	-	-	-	-
1/6	57.50%	62.00%	-	-	-	-
1/4	68.00%	68.00%	-	68.00%	64.00%	-
1/3	70.00%	70.00%	72.00%	70.00%	68.00%	72.00%
1/2	78.50%	80.00%	68.00%	72.00%	74.00%	68.00%
3/4	77.00%	78.50%	74.00%	77.00%	75.50%	74.00%
1	82.50%	85.50%	77.00%	82.50%	85.50%	77.00%
1.5	86.50%	86.50%	84.00%	87.50%	86.50%	84.00%
2	87.50%	86.50%	85.50%	88.50%	86.50%	85.50%
3	88.50%	89.50%	85.50%	89.50%	89.50%	86.50%
5	89.50%	89.50%	86.50%	89.50%	89.50%	88.50%
7.5	90.20%	91.00%	88.50%	91.00%	91.70%	89.50%
10	91.70%	91.70%	89.50%	91.00%	91.70%	90.20%
15	91.70%	93.00%	90.20%	91.70%	92.40%	91.00%
20	92.40%	93.00%	91.00%	91.70%	93.00%	91.00%
25	93.00%	93.60%	91.70%	93.00%	93.60%	91.70%

Hours = When available, actual hours should be used. If actual hours are not available, default hours are provided in table below for HVAC fan operation[892], which varies by building type:

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Assembly	2,374	OpenStudio	VAV
Assisted Living	6,375	OpenStudio	CAV
Auto Dealership	5,326	OpenStudio	CAV
Childcare/Pre-School	2,177	OpenStudio	CAV and VAV
College	3,753	OpenStudio	CAV and VAV
Convenience Store	8,760	OpenStudio	CAV
Drug Store	6,034	OpenStudio	CAV
Elementary School	2,305	OpenStudio	VAV
Emergency Services	8,760	OpenStudio	CAV
Garage	7,357	eQuest	CAV

[892] Hours per year are estimated using the eQuest models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Grocery	7,568	OpenStudio	CAV
Healthcare Clinic	4,471	OpenStudio	VAV
High School	3,118	OpenStudio	VAV
Hospital - CAV no econ	7,166	OpenStudio	CAV
Hospital - CAV econ	7,225	OpenStudio	CAV
Hospital - VAV econ	3,757	OpenStudio	VAV
Hospital - FCU	4,727	OpenStudio	CAV
Hospital - Unknown	5,719	OpenStudio	Average of hospital models
Hotel/Motel	3,712	OpenStudio	CAV
Hotel/Motel - Common	8,678	OpenStudio	CAV
Hotel/Motel - Guest	2,112	OpenStudio	CAV
Manufacturing Facility_Miscellaneous	2,267	OpenStudio	CAV
Manufacturing Facility_Food/Chemical	4,702	OpenStudio	CAV
MF - High Rise	2,617	OpenStudio	CAV
MF - High Rise - Common	3,411	OpenStudio	CAV
MF - High Rise - Residential	2,613	OpenStudio	CAV
MF - Mid Rise	8,450	OpenStudio	CAV
Movie Theater	1,779	OpenStudio	VAV
Office - High Rise - CAV no econ	5,459	OpenStudio	CAV
Office - High Rise - CAV econ	5,430	OpenStudio	CAV
Office - High Rise - VAV econ	2,884	OpenStudio	VAV
Office - High Rise - FCU	2,130	OpenStudio	CAV
Office - Low Rise	4,721	OpenStudio	CAV
Office - Mid Rise	3,413	OpenStudio	VAV
Religious Building	3,783	OpenStudio	VAV
Restaurant	8,226	OpenStudio	CAV
Retail - Department Store	5,245	OpenStudio	CAV
Retail - Strip Mall	4,189	OpenStudio	CAV
Warehouse Nonrefrigerated	3,142	OpenStudio	CAV
Warehouse Refrigerated	3,076	OpenStudio	CAV
Medical Office	3,498	OpenStudio	VAV
Unknown	3991	n/a	n/a

ESF = Energy Savings Factor, the ESF for notched v-belt Installation is assumed to be 2%

= the ESF for notched Synchronous Belt Installation is assumed to be 3.1%[893]

[893] Based on information found in Advanced Manufacturing Office, US DOE, "Replace V-Belts with Notched or Synchronous Drives", (US Department of Energy Motor Systems Tip Sheet #5, DOE/GO-102012-3740, November 2012). V-belt drives can have a peak efficiency of 95% and synchronous belts operate at 98%, therefore ESF is (1-95%/98%) = 3.1%.

For example, a notched v-belt installation in an low rise office building RTU with a 5 HP NEMA premium efficiency motor using the default hours of operation, motor load and 89.5% motor efficiency;

ΔkWh = $kW_{connected}$* Hours * ESF
= ((HP * 0.746 kW/HP* Load Factor)/Motor Efficiency) * Hours * ESF
= ((5 HP * 0.746 kW/HP* 80%) / 89.5%) * 6345 * 2%
= 423.1 kWh Savings

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = kW_{connected} * ESF * CF$$

Where:

$kW_{Connected}$ = kW of equipment is calculated using motor efficiency.
= (HP *0 .746 kW/HP* Load Factor)/Motor Efficiency

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)
= 91.3% [894]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)
= 47.8% [895]

Variables as provided above

For example, an office building RTU with a 5 HP NEMA premium efficiency motor using the default motor load and 89.5% motor efficiency;

ΔkW_{SSP} = $kW_{connected}$* ESF * CF
= ((HP * 0.746 kW/HP* Load Factor)/Motor Efficiency) * ESF * CF
= ((5 HP * 0.746 kW/HP* 80%) / 89.5%) * 2% * 0.913
= 0.0609 kW Savings

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-NVBE-V08-270101

REVIEW DEADLINE: 1/1/2030

[894] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[895]Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

4.4.31 Small Business Furnace and Rooftop Unit Tune-Up

DESCRIPTION

This measure is for a fossil fuel Small Business furnace or Gas-Fired Rooftop Unit that provides space heating. The tune-up will improve furnace or gas-fired rooftop unit performance by inspecting, cleaning, and adjusting the furnace or rooftop unit and appurtenances for correct and efficient operation. Additional savings may be realized through a complete system tune-up.

This measure was developed to be applicable to the following program types: RF (small businesses).

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure an approved technician must complete the tune-up requirements listed below:[896]

- Measure combustion efficiency using an electronic flue gas analyzer
- Check and clean blower assembly and components per manufacturer's recommendations
- Where applicable lubricate motor and inspect and replace fan belt, if required
- Inspect for gas leaks
- Clean burner per manufacturer's recommendations and adjust as needed
- Check ignition system and safety systems and clean and adjust as needed
- Check and clean heat exchanger per manufacturer's recommendations
- Inspect exhaust/flue for proper attachment and operation
- Inspect control box, wiring and controls for proper connections and performance
- Check air filter and clean or replace per manufacturer's recommendations
- Inspect duct work connected to furnace for leaks or blockages
- Measure temperature rise and adjust flow as needed
- Check for correct line and load volts/amps
- Check thermostat operation is per manufacturer's recommendations (if adjustments made, refer to 'Small Commercial Programmable Thermostat Adjustment' measure for savings estimate)
- Perform Carbon Monoxide test and adjust heating system until results are within standard industry acceptable limits

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a furnace or a gas-fired rooftop unit assumed not to have had a tune-up in the past 3 years.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the tune up is 3 years.[897]

DEEMED MEASURE COST

The incremental cost for this measure should be the actual invoiced cost of the tune-up.

[896] American Standard Heating & Air Conditioning, Maintenance for Indoor Units

[897] Assumed consistent with other tune-up measures. For more detail, see: 4.4.1 Air Conditioner Tune-Up (3 years is given for "Clean Condenser Coils – Commercial" and "Clean Evaporator Coils". DEER2014 EUL Table.) and 4.4.2 Space Heating Boiler Tune-Up (Act on Energy Commercial Technical Reference Manual No. 2010-4, 9.2.2 Gas Boiler Tune-up.)

DEEMED O&M COST ADJUSTMENTS

There are no expected O&M savings associated with this measure.

LOADSHAPE

Loadshape C04 - Commercial Electric Heating

COINCIDENCE FACTOR

N/A

Algorithms

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

ΔkWh = $\Delta Therms * F_e * 29.3$

Where:

ΔTherms = as calculated below

F_e = Furnace or rooftop fan energy consumption as a percentage of annual fuel consumption

= 7.7%[898]

29.3 = kWh per therm

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

ΔTherms =$(Capacity * EFLH * (((Eff_{before} + E_i)/ Effbefore) - 1)) / 100{,}000$

Where:

Capacity = Furnace gas input size (Btu/hr)

= Actual

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

Eff_{before} = Efficiency of the furnace before the tune-up

= Actual

Note: Contractors should select a mid-level firing rate that appropriately represents the average building operating condition over the course of the heating season and take readings at a consistent firing rate for pre and post tune-up.

E_i = Efficiency Improvement of the furnace tune-up measure

= Actual

100,000 = Converts Btu to therms

[898] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

For example, a 200 kBtu furnace in a Rockford low rise office records an efficiency prior to tune up of 82% AFUE and a 1.8% improvement in efficiency are tune up:

Δtherms = (200,000 * 1428 * (((0.82 + 0.018)/ 0.82) – 1)) /100,000

= 62.3 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-FTUN-V05-230101

REVIEW DEADLINE: 1/1/2028

4.4.32 Combined Heat and Power

DESCRIPTION

During 2021 and 2022, a TAC CHP Working Group held multiple discussions with a view to updating this measure. While some progress was made, including moving towards a more custom approach, a difference in policy interpretation relating to the appropriate calculation of gas savings, and the appropriate data for determining emission rates over the lifetime of the measure, has prevented reaching consensus. Discussions will continue in 2023 and if required a non-consensus exhibit will be completed and filed in order that the Commission can provide a ruling on the appropriate methodology. Until then, the existing version of this measure is maintained.

The Combined Heat and Power (CHP) measure can provide energy savings within the State of Illinois through the development and operation of CHP projects. This measure is applicable for Conventional or Topping Cycle CHP systems, as well as Waste Heat-to-Power (WHP) or Bottoming Cycle CHP systems. The measure will reduce the total Btu's of energy required to meet the end use needs of the facility.

It is recognized that CHP system design and configuration may be complex, and as such the calculation of energy savings may not be reducible to the equations within this measure. In such cases a more comprehensive engineering and financial analysis may be developed that more accurately incorporates the attributes of complex CHP configurations such as variable-capacity systems, and partial combined-cycle CHP systems. Where noted, the use of values that are determined through an external engineering analysis may be substituted by agreement between the participant, the program administrator and independent evaluator. This substitution of values does not eliminate ex post evaluation risk (retroactive adjustments to savings claims) that exists when using custom inputs.

Due to the long planning horizon for CHP projects, CHP projects will use the project permit date to determine the version of the IL-TRM the implementation teams will follow. The purpose of this is to confirm the savings calculation methodologies for projects as early as possible due to the long planning horizon for the measure.

This measure was developed to be applicable to the following program types: Retrofit (RF), New Construction (NC). If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Conventional or Topping Cycle CHP is defined as an integrated system that is located at or near the building or facility (on-site, on the customer side of the meter) that utilizes a prime mover (reciprocating engine, gas turbine, micro-turbine, fuel cell, boiler/steam turbine combination) for the purpose of generating electricity and useful thermal energy (such as steam, hot water, or chilled water) where the primary function of the facility where the CHP is located is not to generate electricity for use on the grid. An eligible system must demonstrate a minimum total system efficiency of 60% (HHV),[899] with at least 20% of the system's total useful energy output in the form of useful thermal energy on an annual basis.

Measuring and Calculating Conventional CHP Total System Efficiency:

CHP efficiency is calculated using the following equation:

$$CHP_{\ Efficiency}(HHV) = \frac{\left[CHP_{thermal}\ \left(\frac{kBtu}{yr}\right) + E_{CHP}\ \left(\frac{kWh}{yr}\right) * 3.412\ \left(\frac{kBtu}{kWh}\right)\right]}{F_{totalCHP}\left(\frac{kBtu}{yr}\right)}$$

Where:

$CHP_{thermal}$ = Useful annual thermal energy output from the CHP system, defined as the annual thermal energy output of the CHP system that is actually recovered and utilized in the facility/process.

[899] Higher Heating Value (HHV): refers to the heating value of the fuel and is defined as the total thermal energy available, including the heat of condensation of water vapors, resulting from complete combustion of the fuel versus the Lower Heating Value (LHV), which assumes the heat of condensation is not available.

E_{CHP} = Useful annual electricity output produced by the CHP system, defined as the annual electric energy output of the CHP system that is actually utilized to replace purchased electricity required to meet the requirements of the facility/process.

$F_{totalCHP}$ = Total annual fuel consumed by the CHP system

For further definition of the terms, please see "Calculation of Energy Savings" Section below.

Waste Heat-to-Power or Bottoming Cycle CHP is defined as an integrated system that is located at or near the building or facility (on-site, on the customer side of the meter) that does one of the following:

- Utilizes exhaust heat from an industrial/commercial process to generate electricity (except for exhaust heat from a facility whose primary purpose is the generation of electricity for use on the grid); or
- Utilizes the pressure drop in an industrial/commercial facility to generate electricity through a backpressure steam turbine where the facility normally uses a pressure reducing valve (PRV) to reduce the pressure in their facility; or
- Utilizes the pressure reduction in natural gas pipelines (located at natural gas compressor stations) before the gas is distributed through the pipeline to generate electricity, provided that the conversion of energy to electricity is achieved without using additional fossil fuels.

Since these types of systems utilize waste heat as their fuel, they do not have to meet any specific total system efficiency level (assuming they use no additional fossil fuel in their operation) If additional fuel is used onsite, it should be accounted for using the following methodology:

- Treat the portion of Waste-Heat-to-Power that does not require any additional fuel using the Waste-Heat-to-Power methodology outlined in this document.
- Treat the portion of Waste-Heat-to-Power that requires additional fuel (if natural gas) using the Conventional CHP methodology outlined in this document. If the additional fuel is not natural gas, custom carbon equivalency calculations would be needed – refer to section "Calculation of Energy Savings" for more details.
- Add the energy savings together.

These systems may export power to the grid.

DEFINITION OF BASELINE EQUIPMENT

Electric Baseline: The baseline facility would be a facility that purchases its electric power from the grid.

Heating Baseline (for CHP applications that displace onsite heat): The baseline equipment would be the boiler/furnace operating onsite, or a boiler/furnace meeting the baseline equipment defined in the High Efficiency Boiler (Section 4.4.10)/Furnace (Section 4.4.11) measures of this TRM.

Cooling Baseline (for CHP applications that displace onsite cooling demands): The baseline equipment would be the chiller (or chillers) operating onsite, or a chiller (or chillers) meeting the definition of baseline equipment defined in the Electric Chiller (Section 4.4.6) measure of this TRM.

Facilities that use biogas or waste gas: Facilities that use (but are not purchasing) biogas or waste gas that is not otherwise used, whether they are using biogas or waste gas only or a combination of biogas or waste gas and natural gas to meet their energy demands are also eligible for this measure. If additional fuel is purchased to power the CHP system, then the additional natural gas should be taken into account using the following methodology:

- Treat the portion of CHP system that does not require any additional fuel, or that requires additional fuel that would otherwise be wasted (e.g., flared), using the Waste-Heat-to-Power methodology outlined in this document.
- Treat the portion of CHP that requires additional fuel (if natural gas) using the Conventional CHP methodology outlined in this document. If the additional fuel is not natural gas, custom carbon equivalency calculations would be needed – refer to section "Calculation of Energy Savings" for more details.
- Add the energy savings together.

Consumption of any biogas or waste gas that would not otherwise being wasted (e.g., flared) will be accounted for in the overall net BTU savings calculations the same as for purchased natural gas.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

Measure life is a custom assumption, dependent on the technology selected and the system installation.

DEEMED MEASURE COST

Custom installation and equipment cost will be used. These costs should include the cost of the equipment and the cost of installing the equipment. Equipment costs include, but are not limited to: prime mover, heat recovery system(s), exhaust gas treatment system(s), controls, and any interconnection/electrical connection costs.

The installations costs include labor and material costs such as, but not limited to: labor costs, materials such as ductwork, piping, and wiring, project and construction management, engineering costs, commissioning costs, and other fees.

Measure costs will also include the present value of expected maintenance costs over the life of the CHP system.

LOADSHAPE

Use Custom Loadshape. The loadshape should be obtained from the actual CHP operation strategy, based on the On-Peak and Off-Peak Energy definitions specified in Table 3.3 of "Section 3.5 Electrical Loadshapes" of the TRM.

COINCIDENCE FACTOR

Custom coincidence factor will be used. Actual value based on the CHP operation strategy will be used.

Algorithm

CALCULATION OF ENERGY SAVINGS

i) Conventional or Topping Cycle CHP Systems:

Step 1: (Calculating Total Annual Source Fuel Savings in Btus)

The first step is to calculate the total annual source fuel savings associated with the CHP installation, in order to ensure the CHP project produces positive total annual source fuel savings (i.e., reduction in source Btus):

$S_{FuelCHP}$ = Annual fuel savings (Btu) associated with the use of a Conventional CHP system to generate the useful electricity output (kWh, converted to Btu) and useful thermal energy output (Btu) versus the use of the equivalent electricity generated and delivered by the local grid and the equivalent thermal energy provided by the onsite boiler/furnace.

$= (F_{grid} + F_{thermalCHP}) - F_{total\ CHP}$

Where:

F_{grid} = Annual fuel in Btu that would have been used to generate the useful electricity output of the CHP system if that useful electricity output was provided by the local utility grid.

$= E_{CHP} * H_{grid}$

Where:

E_{CHP} = Useful annual electricity output produced by the CHP system, defined as the annual electric energy output of the CHP system that is actually utilized to replace purchased electricity required to meet the requirements of the facility/process. [900]

[900] For complex systems this value may be obtained from a CHP System design/financial analysis study.

$= (CHP_{capacity} * Hours) - E_{Parasitic}$

$CHP_{capacity}$ = CHP nameplate capacity

= Custom input

Hours = Annual operating hours of the system

= Custom input

$E_{parasitic}$ = The electricity required to operate the CHP system that would otherwise not be required by the facility/process

= Custom input

H_{grid} = Heat rate of the grid in Btu/kWh, based on the average fossil heat rate for the EPA eGRID subregion, adjusted to take into account T&D losses.

For systems operating less than 6,500 hrs per year:

Use the Non-baseload heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest).[901] Also include any line losses.

For systems operating more than 6,500 hrs per year:

Use the All Fossil Average heat rate provided by EPA eGRID for RFC West region for ComEd territory (including independent providers connected to RFC West), and SERC Midwest region for Ameren territory (including independent providers connected to SERC Midwest). Also include any line losses.

$F_{thermalCHP}$ = Annual fuel in Btu that would have been used on-site by a boiler/furnace to provide the useful thermal energy output of the CHP system.[902]

$= CHP_{thermal} / Boiler_{eff}$ (or $CHP_{thermal} / Furnace_{eff}$)

$CHP_{thermal}$ = Useful annual thermal energy output from the CHP system, defined as the annual thermal energy output of the CHP system that is actually recovered and utilized in the facility/process.

= Custom input

$Boiler_{eff}$ /$Furnace_{eff}$= Efficiency of the on-site Boiler/Furnace that is displaced by the CHP system or if unknown, the baseline equipment value stated in the High Efficiency Boiler (Section 4.4.10) measure or High Efficiency Furnace (Section 4.4.11) measure in this TRM.

= Custom input

$F_{total\ CHP}$ = Total fuel in Btus consumed by the CHP system

= Custom input

[901] These values are subject to regular updates so should be reviewed regularly to ensure the current assumptions are correct. Refer to the latest EPA eGRID data. Current values, based on eGrid 2018 are:
Non-Baseload RFC West: 10,024 Btu/kWh * (1 + Line Losses)
Non-Baseload SERC Midwest: 9,871 Btu/kWh * (1 + Line Losses)
All Fossil Average RFC West: 9,575 Btu/kWh * (1 + Line Losses)
All Fossil Average SERC Midwest: 10,369 Btu/kWh * (1 + Line Losses)

[902] For complex systems this value may be obtained from a CHP System design/financial analysis study.

Step 2: (Savings Allocation to Program Administrators for Purposes of Assessing Compliance with Energy Savings Goals (Not for Use in Load Reduction Forecasting))

Savings claims are a function of the electric output of the CHP system (E_{CHP}), the used thermal output of the CHP system ($F_{thermalCHP}$), and the CHP system efficiency (CHP_{Eff}(HHV)). The percentages of electric output and used thermal output that can be claimed also differ slightly depending on whether the project was included in both electric[903] and gas[904] Energy Efficiency Portfolio Standard (EEPS)[905] efficiency programs, only an electric EEPS program or only a gas EEPS program. The tables below provide the specific percentages of electric and/or thermal output that can be claimed under each of those three scenarios. These percentages apply only to cases in which natural gas is the fuel used by the CHP system. Saving estimates for systems using other fuels should be calculated on a custom basis. If the waste heat recovered from the CHP system is offsetting electric equipment, such as an absorption chiller offsetting an electric chiller, then the net change in electricity consumption associated with the electric equipment should be added to the allocated electric savings.

1) For systems participating in both electric EEPS and gas EEPS programs:

CHP Annual System Efficiency (HHV)	Allocated Electric Savings	Allocated Gas Savings
60%	65% of E_{CHP} (kWh)	No gas savings
>60% to 65%	65% of E_{CHP} (kWh) + one percentage point increase for every one percentage point increase in CHP system efficiency (max 70% of E_{CHP} in kWh)	No gas Savings
>65%	70% of E_{chp} (kWh)	2.5% of $F_{thermal}$ (Boiler Natural Gas offset by CHP thermal) for every one percentage point increase in CHP system efficiency above 65%.

Example: System with measured annual system efficiency (HHV) of 70%: Electric savings (kWh) = 70% of E_{CHP} measured over 12 months, and Gas savings (therms) = 12.5% of $F_{thermal}$ measured over 12 months (70% - 65% = 5 X 2.5% = 12.5%).

2) For systems participating in only an electric EEPS program:

CHP Annual System Efficiency (HHV)	Allocated Electric Savings	Allocated Gas Savings
60%	65% of E_{CHP} (useful electric output of CHP system in kWh)	No gas Savings
Greater than 60%	65% + one percentage point increase for every one percentage point increase in CHP system efficiency (no max)	No gas Savings

Example: System with measured annual fuel use efficiency of 75%: Electric savings (kWh) = 65% + 15% = 80% of E_{CHP} measured over 12 months (15% = 1% for every 1% increase in system efficiency). No gas savings (therms).

3) For systems participating in only a gas EEPS program:

CHP Annual System Efficiency (HHV)	Allocated Electric Savings	Allocated Gas Savings
60% or greater	No electric savings	2.5% of Fthermal (Boiler Natural Gas offset by CHP thermal) for every one percentage point increase in CHP system efficiency above 60%.

Example: System with measured annual system efficiency (HHV) of 70%: No Electric savings (kWh). Gas savings (therms) = 25% of $F_{thermal}$ measured over 12 months (70% - 60% = 10 X 2.5% = 25%).

Conventional or topping cycle CHP systems virtually always require an increase in the use of fuel on-site in order to produce electricity. Different jurisdictions and experts across the country have employed and/or put forward a variety of approaches to address how increased on-site fuel consumption should be reflected in the attribution of electric savings to CHP systems.[906] The approach reflected in the tables above is generally consistent – for CHP systems consuming natural gas – with approaches recently put forward by the Southwest Energy Efficiency Project (SWEEP) and Institute for Industrial Productivity (IIP) that determine reduced electric savings based on the equivalent amount of carbon dioxide generated from the increased fuel used.[907]

There are a variety of ways one could treat the potential for gas utilities to claim savings from CHP projects in their EEPS portfolios. For projects in which a natural gas EEPS program is involved, the tables above treat savings from CHP installations in two steps: (1) a fuel-switch from electricity to natural gas (i.e., using more natural gas to eliminate the need to generate as much electricity on the grid); and (2) possible increases in CHP efficiency above a "benchmark" level. When both electric EEPS and natural gas EEPS programs are involved in a project, the program administrator claims all the electricity savings associated with a fuel-switch up to a "benchmark" 65% efficient CHP system. All the savings associated with increasing CHP efficiencies above that benchmark level are allocated to natural gas (e.g., if the CHP efficiency is 75%, the natural gas savings associated with an increase in CHP efficiency from 65% to 75% are allocated to natural gas). That is consistent with the notion that CHP efficiency typically increases primarily by increasing the use of the thermal output of the system (increasing the displacement of baseline gas use). For projects that involve only a natural gas EEPS program, the "benchmark" above which the gas utility can claim savings is lowered to 60%.

ii) **Waste-Heat-to-Power CHP Systems :**

ELECTRIC ENERGY SAVINGS:

$$\Delta kWh = E_{CHP}$$

Where:

E_{CHP} = Useful annual electricity output produced by the CHP system, defined as the annual electric energy output of the CHP system that is actually utilized to replace purchased electricity required to meet the requirements of the facility/process.

= Custom input

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = CF * CHP_{capacity}$$

Where:

CF = Summer Coincidence factor. This factor should also consider any displaced chiller capacity.[908]

[908] If some or all of the existing electric chiller peak demand is no longer needed due to new waste heat powered chillers (e.g., absorption), the coincidence factor should be adjusted appropriately.

= Custom input

$CHP_{Capacity}$ = CHP nameplate capacity

= Custom input

FOSSIL FUEL ENERGY SAVINGS:

$$\Delta Therms = F_{thermalCHP} \div 100{,}000$$

Where:

$F_{thermalCHP}$ = Net savings in annual purchased fuel in Btu, if any, that would have been used on-site by a boiler/furnace to provide some or all of the useful thermal energy output of the CHP system.[909]

100,000 = Conversion factor for Btu to therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Custom estimates of maintenance costs that will be incurred for the life of the measure will be used**.** Maintenance costs vary with type and size of the prime mover. These costs include, but are not limited to:

- Maintenance labor
- Engine parts and materials such as oil filters, air filters, spark plugs, gaskets, valves, piston rings, electronic components, etc. and consumables such as oil
- Minor and major overhauls

For screening purposes, the US EPA has published resource guides that provide average maintenance costs based on CHP technology and system size.[910]

COST-EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING

For the purposes of forecasting load reductions due to CHP projects, changes in site energy use at the customer's meter – reduced consumption of utility provided electricity – adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

For the purposes of screening a CHP measure application for cost-effectiveness, changes in site energy use – reduced consumption of utility provided electricity and the net change in consumption of fuel – should be used. In general, the benefit and cost components used in evaluating the cost-effectiveness of a CHP project would include at least the following terms:

MEASURE CODE: CI-HVC-CHAP-V07-230101

REVIEW DEADLINE: 1/1/2025

[909] In most cases, it is expected that waste-heat-to-power systems will not provide any new net useful thermal energy output, since the CHP system will be driven by thermal energy that was otherwise being wasted. If additional natural gas or other purchased energy is used onsite, it should be properly accounted for.

[910] "EPA Combined Heat and Power Partnership Resources" Oct 07, 2014, in the document "Catalog of CHP Technologies", US EPA, September 2017, pages 2-16,, 3-14, 4-14, 5-14, and 6-16.

4.4.33 Commercial & Industrial Air Curtain

DESCRIPTION

This measure applies to buildings with exterior entryways that utilize overhead doors. All other air curtain applications, such as through sliding door entryways or conventional foot-traffic entryways, require custom analysis as air curtain designs must often accommodate other factors that may change their effectiveness.

The use of overhead doors within exterior entryways during the heating season leads to the exfiltration of warm air from the upper portion of the door opening and the infiltration of colder air from the lower portion of the door opening. This results in increased heating energy use to compensate for heat losses every time a door is opened. By reducing heat losses, air curtains can also enhance the physical comfort of employees or customers near the entryway as there will be reduced temperature fluctuations when the door is opened and closed. In addition, in some cases excess heating capacity may be installed in buildings to meet this larger heating load. The addition of air curtains to exterior entryways that currently utilize overhead doors will result in energy savings and enhanced personal comfort, and also possibly in reduced equipment sizing and costs.

The primary markets for this measure are commercial and industrial facilities with overhead doors in exterior entryways, including but not limited to the following building types: retail, manufacturing, and warehouse (non-refrigerated).

Limitations

- For use in conditioned spaces with an overhead door in an exterior entryway.
- This measure should only be applied to spaces in which the overhead door separates a conditioned space and an unconditioned space.
- Installation must follow manufacturer recommendations to attain proper air velocity, discharge angle down to the floor level, and unit position.
- Certain heating systems may not be a good fit for air curtains, such as locations with undersized heating capacity. In these cases, the installation of an air curtain may not effectively reduce heating system cycling given the inappropriately sized heating capacity.
- Limited to buildings with slightly positive to slightly negative pressurization (~5 Pa to -10 Pa). For all other scenarios, custom analysis is recommended.
- Measure assumes wind speeds at near ground level are less than or equal to 12 mph for 90% of the heating or cooling season. For areas with more extreme weather, custom analysis is necessary.
- Note: for cost effectiveness, it is recommended that minimum door open times should be approximately 15 hours per week.[911]

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

The following methodology is highly complex and requires significant data collection. It is hoped that simplifying steps can be made in future iterations based on continued metering and evaluation of installations. Also the data collected through implementing the measure in the way currently drafted will aid in simplifying efforts at a future date.

DEFINITION OF EFFICIENT EQUIPMENT

Overhead air curtains designed for commercial and industrial applications that have been tested and certified in accordance with ANSI/AMCA 220 and installed following manufacturer guidelines. Measure is for standard models without added heating.

[911] Spentzas, Steve, et. al, "1009: Commercial and Industrial Air Curtains – Public Project Report," Nicor Gas Emerging Technology Program (Oct 2014): 9.

DEFINITION OF BASELINE EQUIPMENT

No air curtain or other currently installed means to effectively reduce heat loss and air mixing during door openings, such as a vestibule or strip curtain.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[912]

DEEMED MEASURE COST

The incremental capital cost for overhead air curtains for exterior entryways are as follows, with an added average installation cost approximately equal to the capital cost.[913]

Door Size	Capital Cost
3.5'w x 7'h	$1,500
6'w x 7'h	$2,500
8'w x 8'h	$3,600
10'w x 10'h	$4,500
10'w x 12'h	$5,400
12'w x 14'h	$8,000
16'w x 16'h	$13,300

LOADSHAPE

Heating Season: If electric heating, use Commercial Electric Heating Loadshape: C04. Otherwise, N/A

Cooling Season: Commercial Cooling Loadshape C03. Or, if applicable, use Commercial Electric Heating and Cooling Loadshape C05.

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[914]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[915]

Algorithm

CALCULATION OF ENERGY SAVINGS

The following formulas provide a methodology for estimating cooling load (kWh) and heating load (therm) savings associated with the installation of air curtains on exterior entryways such as a single door or loading bay. This algorithm is based on the assumption that therm savings are directly related to the difference in cooling or heating losses due to infiltration or exfiltration through an entryway before and after the installation of an AMCA certified air curtain. Energy savings are assumed to be the result of a reduction of natural infiltration effects due to wind and

[912] Navigant Consulting Inc, Measures and Assumptions for Demand Side Management (DSM) Planning: Appendix C: Substantiation Sheets, "Air Curtains – Single Door," Ontario Energy Board, (April 2009): C-137.
2014 Database for Energy-Efficient Resources, EUL/RUL (Effective/Remaining Useful Life) Values, February 4, 2014.

[913] Based on manufacturer interviews and air curtain specification sheets. Smaller doors are estimated based on interpolation of larger door costs.

[914] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[915] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

thermal forces and follow the calculation methodology outlined by the ASHRAE Handbook.[916] The calculation assumes that the air curtain is appropriately sized and commissioned to be effective in mitigating infiltration of winds of up to 12 mph for at a least 90% of the year (based on manufacturer literature and TMY3 wind speed ranges at near ground level for Illinois).[917] Additionally, this measure assumes the HVAC systems are appropriately balanced such that the maximum pressure differential between indoor air and outdoor air is within the range of 5 Pa < ΔP < -10 Pa.[918] Custom analysis is necessary if building pressurization exceeds this range. However, while effectiveness decreases, some studies suggest that air curtains outperform vestibules and single door construction for negatively pressurized buildings with a ΔP of above -30 Pa.[919]

This algorithm allows either actual inputs or provides estimates if actual data is not available. All weather dependent values are derived from TMY3 data for the closest weather station to those locations defined elsewhere in the Illinois TRM (which are based on 30 year climate normals). If TMY3 weather station data was not available for the data used in the Illinois TRM, the next closest weather station was used. It is assumed that weather variations are negligible between the weather stations located within the same region. This approach was followed as the air curtain algorithm has a number of weather-dependent variables, which are all calculated in relation to the heating season or cooling season as defined by the balance point temperature deemed appropriate for the facility. All weather-dependent data is based on TMY3 data and is listed in tables by both climate zone and balance point temperature, which is then normalized to the Illinois TRM climate zoned HDD/CDD definitions unless otherwise noted.

ELECTRIC ENERGY SAVINGS

$$\Delta kWhcooling = [(Q_{tbc} - Q_{tac}) / \eta Cool - (HP * 0.7457)] * t_{open} * CD$$

$$\Delta kWhHPheating = [(Q_{tbc} - Q_{tac}) / \eta Heat_Electric - (HP * 0.7457)] * t_{open} * HD$$

$$\Delta kWhGasheating = -(HP * 0.7457) * t_{open} * HD$$

Where:

Q_{tbc} = rate of total heat transfer through the open entryway, before air curtain (kBtu/hr)

Q_{tac} = rate of total heat transfer through the open entryway, after air curtain (kBtu/hr)

(see calculation in 'Heat Transfer Through Open Entryway with/without Air Curtain' sections below)

ηCool = energy efficiency ratio (EER) of the cooling equipment (kBtu/kWh) * distribution efficiency.

= Actual. If unknown, use the table assumption from IECC 2012 (or IECC 2024 if through new construction) and assume 95% distribution efficiency for central cooling with ducts. If unknown assume:[920]

Space Cooling Source	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling Source	10.2	11.1

[916] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): Ch 16.1 - 16.37.
[917] National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL.
[918] Spentzas, Steve, et. al, "1009: Commercial and Industrial Air Curtains – Public Project Report," Nicor Gas Emerging Technology Program (Oct 2014): 10.
Wang, Liangzhu, "Investigation of the Impact of Building Entrance Air Curtain on Whole Building Energy Use," Air Movement and Control International, Inc. (2013). 4.
[919] Wang, Liangzhu, "Investigation of the Impact of Building Entrance Air Curtain on Whole Building Energy Use," Air Movement and Control International, Inc. (2013). 4.
[920] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95, and multiplied by 0.95 distribution efficiency.

HP = Input power for air curtain (hp)

= Actual value. If actual value not available, use the following estimates based on manufacturer specs

Door Size	Fan HP
3.5'w x 7'h	0.5
6'w x 7'h	0.75
8'w x 8'h	1
10'w x 10'h	1.5
10'w x 12'h	4
12'w x 14'h	6
16'w x 16'h	12

0.7457 = unit conversion factor, brake horsepower to electric power (kW/HP)

t_{open} = average hours per day the door is open (hr/day)

= Actual or user defined estimated value.

CD = cooling days per year, total days in year above balance point temperature (day)

= use table below to select the best value for location:[921]

.	CD (Balance Point Temperature)				
Climate Zone -Weather Station/City	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	194	168	148	124	97
2 - Chicago O'Hare AP / Chicago	194	173	153	127	95
3 - Springfield #2 / Springfield	214	194	174	148	114
4 - Belleville SIU RSCH / Belleville	258	229	208	174	138
5 - Carbondale Southern IL AP / Marion	222	201	181	158	130

ηHeat_Electric = Efficiency of heating system, including distribution efficiency.

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2024 if through new construction) and assuming 0.95 distribution efficiency.

Alternatively, as deemed from table below:

System Type	HSPF2 Estimate	ηHeat (HSPF2 * 0.95)
Heat Pump	7.37[922]	7.0
Resistance	N/A	1

[921] National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL.
Note that cooling days (CD) are calculated by first determining its value from the TMY3 data associated with the appropriate weather station as defined by and used elsewhere in the Illinois TRM. Using the TMY3 outdoor air dry bulb hourly data, the annual hours are totaled for every hour that the outdoor air dry bulb temperature is above a designated zero heat loss balance point temperature or base temperature for cooling. For commercial and industrial (C&I) buildings, a base temperature for heating of 55 °F is designated in the Illinois TRM, but building specific base temperatures are recommended for large C&I projects. Additionally, the TRM uses a 30-year normal data for degree-days while the CD calculation was based on TMY3 data; in order to account for this, calculations of CD were also normalized by the ratio of CDD to align the calculated values more closely with the TRM.

[922] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.

HD = heating days per year, total days in year above balance point temperature (day)

= use table below to select an appropriate value:[923]

	HD				
Climate Zone Weather Station/City	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

Heat Transfer Through Open Entryway without Air Curtain (Cooling Season)

Q_{tbc} = $4.5 * CFM_{tot} * (h_{oc} - h_{ic}) / (1{,}000\ Btu/kBtu)$

Where:

4.5 = unit conversion factor with density of air: $60\ min/hr * 0.075\ lbm/ft3$

CFM_{tot} = Total air flow through entryway (cfm), see calculation below

h_{oc} = average enthalpy of outside air during the cooling season (Btu/lb)

= use the below table to determine the approximate outdoor air enthalpy associated with an indoor temperature setpoint and climate zone.[924]

	h_{oc}		
Climate Zone -Weather Station/City	67 °F	72 °F	77 °F
1 - Rockford AP / Rockford	31.6	33.0	35.3
2 - Chicago O'Hare AP / Chicago	32.0	33.6	35.4
3 - Springfield #2 / Springfield	32.9	34.6	36.6
4 - Belleville SIU RSCH / Belleville	33.5	35.0	36.4
5 - Carbondale Southern IL AP / Marion	34.6	36.2	37.7

h_{ic} = average enthalpy of indoor air, cooling season (Btu/lb)

= use the below table to determine the approximate indoor air enthalpy associated with an indoor temperature setpoint in indoor relative humidity.

	h_{ic}		
Relative Humidity (%)	67 °F	72 °F	77 °F
60	25.5	28.5	31.8
50	23.9	26.6	29.5
40	22.3	24.7	27.3

= an estimate 26.6 Btu/lb associated with the 72 °F and 50% indoor relative humidity case can be used as an approximation if no other data is available. For other indoor temperature setpoints and RH, enthalpies may be interpolated or a psychrometric chart may be referenced.

[923] Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

[924] Average enthalpies were estimated following ASHRAE guidelines for perfect gas relationships for dry air associated with hourly TMY3 data. Enthalpies were then averaged for all values associated with a dry-bulb outdoor air temperature that exceeded the indoor air temperature setpoint. Other enthalpy values may be interpolated for indoor air temperature setpoints not represented in the table. Note that while outdoor air enthalpies increase with higher temperature setpoints, the change in enthalpy from indoor to outdoor will decrease.

The total airflow through the entryway, CFM_{tot}, includes both infiltration due to wind as well as thermal forces, as follows:

$$CFM_{tot} = \sqrt{[\ (CFM_w)^2 + (CFM_t^2)\ ]}$$

Where:

CFM_w = Infiltration due to the wind (cfm)

CFM_t = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

$$CFM_w = (V_{WC} * C_{WC}) * C_V * A_d * (88 \frac{fpm}{mph})$$

Where:

v_{wc} = average wind speed during the cooling season based on entryway orientation (mph)

= use the below table to for the wind speed effects based on climate zone and entryway orientation:[925]

	Entryway Orientation			
Climate Zone -Weather Station /City	N	E	S	W
1 - Rockford AP / Rockford	4.2	4.1	4.7	4.8
2 - Chicago O'Hare AP / Chicago	4.7	4.5	5.4	4.6
3 - Springfield #2 / Springfield	4.1	3.7	6.0	5.0
4 - Belleville SIU RSCH / Belleville	3.3	2.7	3.8	4.2
5 - Carbondale Southern IL AP / Marion	3.1	2.9	4.4	3.8

C_{wc} = wind speed correction factor due to wind direction in cooling season (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the cooling season prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for cooling applications.

	Entryway Orientation			
Climate Zone -Weather Station/City	N	E	S	W
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31
2 - Chicago O'Hare AP / Chicago	0.18	0.17	0.36	0.26
3 - Springfield #2 / Springfield	0.17	0.12	0.46	0.21
4 - Belleville SIU RSCH / Belleville	0.21	0.15	0.35	0.16
5 - Carbondale Southern IL AP / Marion	0.18	0.15	0.37	0.11

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

C_v = effectiveness of openings,

= 0.3, assumes diagonal wind[926]

A_d = area of the doorway (ft^2)

= user defined

[925] Average wind speeds are calculated based on the TMY3 wind speed data. Because this data is collected at an altitude of 33 ft, wind speed is approximated for a 5 ft level based on ASHRAE Handbook guidelines using the urban/suburban parameters for adjusting wind speed based on altitude (Layer thickness (ft) δ = 1200, Exponent a = 0.22).
ASHRAE, "Airflow Around Buildings," in 2013 ASHRAE Handbook – Fundamentals (2013): p 24.3.

[926] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

The infiltration due to thermal forces is calculated as follows:

$CFM_t = A_d * C_{dc} * (60\ sec/min) * \sqrt{[2 * g * H/2 * (T_o - T_{ic}) / (459.7 + T_{oc})]}$

Where:

C_{dc} = the discharge coefficient during the cooling season[927]

= 0.4 + 0.0025 * $|T_{ic} - T_{oc}|$

= 0.42, Illinois average at indoor air temp of 72°F

Note, values for C_{dc} show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value may be used as a simplification.

g = acceleration due to gravity

= 32.2 ft/sec^2

H = the height of the entryway (ft)

= user input

T_{ic} = Average indoor air temperature during cooling season

= User input, can assume indoor cooling temperature set-point

T_{oc} = Average outdoor temp during cooling season (°F)

= the average outdoor temperature is dependent on the CD period and zone. As such, the following table may be used for average outdoor temperature during the cooling period:[928]

	T_{oc}				
Climate Zone Weather Station/City	**62 °F**	**67 °F**	**72 °F**	**77 °F**	**82 °F**
1 - Rockford AP / Rockford	72.9	76.0	79.2	82.5	85.5
2 - Chicago O'Hare AP / Chicago	72.9	76.0	79.4	82.8	85.5
3 - Springfield #2 / Springfield	73.7	76.7	79.9	83.4	86.4
4 - Belleville SIU RSCH / Belleville	74.9	77.7	81.0	84.3	86.9
5 - Carbondale Southern IL AP / Marion	75.1	77.7	80.9	84.7	87.4

459.7 = conversion factor from °F to °R

= calculation requires absolute temperature for values not calculated as a difference of temperatures.

Heat Transfer Through Open Entryway with Air Curtain (Cooling Season)

$Q_{tac} = Q_{tbc} * (1 - E)$

Where:

E = the effectiveness of the air curtain (%)

= 0.60[929]

[927] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13.

[928] Based on binned data from TMY3 & adjusted bracketed thermostat setpoint temperatures. Interpolate other values as needed.

[929] Assumed conservative estimate based on referenced study results and ASHRAE 2004 effectiveness range of 60-80% for air curtains. Jaramillo, Julian, et. Al. "Application of Air Curtains in Refrigerated Chambers," International Refrigeration and Air-Conditioning Conference, Purdue University e-Pubs (July 14-17, 2008).
ASHRAE, "Room Air Distribution Equipment," in 2004 ASHRAE Handbook – HVAC Systems and Equipment (2004): p 17.8.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh_{cooling} / (CD * 24)) * CF$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[930]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[931]

FOSSIL FUEL SAVINGS

Natural gas savings, ∆therms, associated with reduced infiltration through an entryway during the heating season are calculated by determining the difference between heat loss through the entryway before and after the installation of the air curtain.

$$\Delta therms = (Q_{bc} - Q_{ac}) * t_{open} * HD / \eta Heat_Fossil$$

Where:

Q_{bc} = rate of sensible heat transfer through the open entryway, before air curtain (therm/hr)

Q_{ac} = rate of sensible heat transfer through the open entryway, after air curtain (therm/hr)

t_{open} = average hours per day the door is open (hr/day)

= Actual or estimated user input value

HD = heating days per year, total days in year above balance point temperature (day)

= use table below to select an appropriate value:[932]

	HD				
Climate Zone - Weather Station/City	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

ηHeat_Fossil = efficiency of heating equipment * Distribution Efficiency

= Actual, if unknown assume code baseline and assume 95% distribution efficiency. Is unknown assume 0.821.[933]

Heat Transfer Through Open Entryway without Air Curtain (Heating Season)

[930] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[931] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

[932] Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

[933] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

Q_{bc} $= (1.08\ Btu/(hr * °F * cfm)) * CFM_{tot} * (T_{ih} - T_{oh}) / (100{,}000\ Btu/therm)$

Where:

1.08 = sensible heat transfer coefficient (specific heat of air and unit conversions)

CFM_{tot} = Total air flow through entryway (cfm)

T_{ih} = Average indoor air temperature during heating season

= User input, can assume indoor heating temperature set-point

T_{oh} = Average outdoor temp during heating season (°F)

= use table below, based on binned data from TMY3 & balance point temperature:

	Avg Outdoor Air Temp - Heating Season				
Climate Zone -Weather Station/City	**45 °F**	**50 °F**	**55 °F**	**60 °F**	**65 °F**
1 - Rockford AP / Rockford	26.3	28.8	31.6	34.2	37.3
2 - Chicago O'Hare AP / Chicago	29.4	31.2	34.0	36.8	40.3
3 - Springfield #2 / Springfield	29.4	31.5	34.6	37.7	41.6
4 - Belleville SIU RSCH / Belleville	31.7	33.6	36.2	39.2	42.3
5 - Carbondale Southern IL AP / Marion	32.5	34.9	37.8	40.7	44.0

The total airflow through the entryway, CFM_{tot}, includes both infiltration due to wind as well as thermal forces, as follows:

CFM_{tot} $= \sqrt{[(CFM_w)2 + (CFM_{t2})]}$

Where:

CFM_w = Infiltration due to the wind (cfm)

CFM_t = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

CFM_w $= (v_{wh} * C_{wh}) * C_v * A_d * (88 \frac{fpm}{mph})$

Where:

v_{wh} = average wind speed during the heating season (mph)

= similar to cooling season wind speed assumptions, use the following table to determine average wind speed based on entryway orientation:

	Entryway Orientation			
Climate Zone -Weather Station/ City	**N**	**E**	**S**	**W**
1 - Rockford AP / Rockford	5.0	4.6	4.9	5.6
2 - Chicago O'Hare AP / Chicago	5.5	5.2	4.9	5.1
3 - Springfield #2 / Springfield	5.0	4.9	5.3	5.1
4 - Belleville SIU RSCH / Belleville	4.3	3.4	3.5	5.3
5 - Carbondale Southern IL AP / Marion	4.6	3.2	4.2	4.4

C_{wh} = wind speed correction factor due to wind direction in heating season, (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for time during the heating season that prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for heating applications.

	Entryway Orientation			
Climate Zone -Weather Station/ City	N	E	S	W
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31
2 - Chicago O'Hare AP / Chicago	0.21	0.10	0.26	0.39
3 - Springfield #2 / Springfield	0.21	0.14	0.27	0.34
4 - Belleville SIU RSCH / Belleville	0.31	0.15	0.22	0.29
5 - Carbondale Southern IL AP / Marion	0.31	0.11	0.27	0.18

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

C_v = effectiveness of openings,

= 0.3, assumes diagonal wind[934]

A_d = area of the doorway (ft^2)

= user input

The infiltration due to thermal forces is calculated as follows:

$$CFM_t = A_d * C_{dh} * (60 \frac{sec}{min}) * \sqrt{[2 * g * H/2 * (T_{ih} - T_{oh}) / (459.7 + T_{ih})]}$$

Where:

C_{dh} = the discharge coefficient during the heating season

= $0.4 + 0.0025 * |T_{ih} - T_{oh}|$

= 0.49, Illinois average at indoor air temp of 72°F

Note, values for C_{dh} show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value may be used as a simplification.

g = acceleration due to gravity

= 32.2 ft/sec^2

H = the height of the entryway (ft)

= user defined

Heat Transfer Through Open Entryway without Air Curtain (Heating Season)

$$Q_{ac} = Q_{bc} * (1 - E)$$

Where:

E = the effectiveness of the air curtain (%)

= 0.60[935]

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

[934] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

[935] Assumed conservative estimate based on referenced study results and ASHRAE 2004 effectiveness range of 60-80% for air curtains. Jaramillo, Julian, et. Al. "Application of Air Curtains in Refrigerated Chambers," International Refrigeration and Air-Conditioning Conference, Purdue University e-Pubs (July 14-17, 2008).
ASHRAE, "Room Air Distribution Equipment," in 2004 ASHRAE Handbook – HVAC Systems and Equipment (2004): p 17.8.

DEEMED O&M COST ADJUSTMENT CALCULATION

The air curtain would need to be regularly serviced and commissioned to ensure that it is appropriately operating. This is estimated at a cost of $150.[936]

MEASURE CODE: CI-HVC-AIRC-V09-270101

REVIEW DEADLINE: 1/1/2030

[936] Assumes approximately 1 hour of maintenance (include cleaning out filters, greasing, and checking that the designed angle of attack on the blower nozzle is at the designed position) based on manufacturer input and product spec sheets.

4.4.34 Destratification Fan

DESCRIPTION

This measure applies to buildings with high bay ceiling construction without fans currently installed for the purpose of destratifying air. There is also a separate measure for destratification fans as applied to agricultural settings ("High Volume Low Speed Fans"). All other destratification fan applications require custom analysis.

Air stratification leads to higher temperatures at the ceiling and lower temperatures at the ground. During the heating season, destratification fans improve air temperature distribution in a space by circulating warmer air from the ceiling back down to the floor level, thereby enhancing comfort and saving energy. Energy savings are realized by a reduction of heat loss through the roof-deck and walls as a result of a smaller temperature differential between indoor temperature and outdoor air.

Note that further, but limited, empirical evidence suggests that improved air mixing due to destratification would also result in shorter heating system runtimes due to warmer air reaching the thermostat level sooner, and possibly even allow a facility to lower the thermostat set point while maintaining a similar level of occupant comfort. This is supported by measured data in which an increase in temperatures was observed at the thermostat (5 foot level) level when air is destratified, resulting in an approximate temperature increase at the 5 foot level in the range of 1 – 3°F.[937] This measure does not currently attempt to quantify the potential impacts of air mixing from destratification; however, it should be noted that additional therms savings may be possible.

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

Limitations

- For use in conditioned, high bay structures. Recommended minimum ceiling height of 20 ft.
- This measure should only be applied to spaces in which the ceiling is subject to heat loss to outdoor air (i.e., single story or top floor spaces) and where there is sufficient space to allow for appropriate spacing of the fans. Other applications require custom analysis.
- Installation must follow manufacturer recommendations sufficient to effectively destratify the entire space. Please see calculation of effective area, Aeff, in the therms savings algorithm as a check if this criteria is met. Otherwise, custom calculation is necessary.
- Measure does not currently support facilities with night setbacks on heating equipment. Custom analysis is needed in this case.
- Certain heating systems may not be a good fit for destratification fans, such as locations with: high velocity vertical throw unit heaters, radiant heaters, and centralized forced air systems. In these cases, measured evidence of stratification should be confirmed, and custom analysis may be necessary.

DEFINITION OF EFFICIENT EQUIPMENT

High Volume, Low Speed (HVLS) fans with a minimum diameter of 14 ft with Variable Speed Drive (VSD) installed.[938]

Note that bell-shaped fans are currently excluded from this measure due to limited validation of the technology available. Further verification of effectiveness compared to HVLS is needed. A manufacturer of bell-shaped fans indicates that four bell-shaped fans provide an equivalent effective area as a typical HVLS fan. However, there is a need for further review of bell-shaped fan field test data supporting manufacturer claims regarding comparable effectiveness to HVLS technologies.

DEFINITION OF BASELINE EQUIPMENT

No destratification fans or other means to effectively mix indoor air.

[937] Kosar, Doug, "1026: Destratification Fans – Public Project Report," Nicor Gas, Emerging Technology Program (Oct 2014): 16.
[938] Kosar, Doug, "1026: Destratification Fans – Public Project Report," Nicor Gas, Emerging Technology Program (Oct 2014): 16.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[939]

DEEMED MEASURE COST

The incremental measure cost = [equipment cost of HVLS fans] + [installation costs (including materials and labor)]

Since installation cost is dependent on a variety of factors, actual costs should be used if known. The default incremental measure cost for HVLS fans are as follows:[940]

Fan Diameter (ft)	Incremental Cost
14	$6,600
16	$6,650
18	$6,700
20	$6,750
22	$6,800
24	$6,850

LOADSHAPE

Loadshape C04: Commercial Electric Heating.

COINCIDENCE FACTOR

There are no summer coincident peak demand savings for this measure due to no savings attributable to cooling during the summer peak period.

Algorithm

CALCULATION OF SAVINGS

The following formulas provide a methodology for estimating heating load savings associated with destratification fan use. This algorithm is based on the assumption that savings are directly related to the difference in heat loss through the envelope before and after destratification.

ELECTRIC ENERGY SAVINGS

The algorithm for this measure was developed for natural gas heating applications, however, for electric heating applications, the same methodology presented in the Fossil Fuel Savings Section may be used with the standard conversion factor from therms to kWh of 29.31 kWh/therm and an equipment efficiency as follows:

System Type	Cooling Capacity of Equipment	Age of Equipment	HSPF Estimate	η (Effective COP Estimate) (HSPF/3.413) * 0.95 (Distribution efficiency)
Heat Pump[941]	All	Before 2009	6.8	1.9

[939] Consistent with both 2008 Database for Energy-Efficient Resources, EUL/RUL (Effective/Remaining Useful Life) Values, October 10, 2008 and GDS Associates, Inc, "Measure Life Report: Residential and Commercial/Industrial Lighting and HVAC Measures," New England Stat Program Working Group (June 2007), p30.

[940] Costs were obtained from manufacturer interviews and are based off of average or typical prices for base model HVLS fans. Costs include materials and labor to install the fans and tie fans into an existing electrical supply located near the fan.

[941] Minimum heating efficiency standards for heat pumps are sourced from the Code of Federal Standards for Small and Large Commercial Package Air Conditioning and Heating Equipment (Air Cooled), 10 CFR 431.97 with compliance dates of June 16, 2008; January 1, 2010; January 1, 2017; January 1, 2018; and January 1, 2023. As the first federal appliance standards for heating efficiency for commercial heat pumps went into effect in June 2008, assuming efficiency standards equivalent to residential heat pumps prior to that date. Note, new Federal Standards affecting heat pumps became effective January 1, 2023. In order to allow for existing inventory meeting the previous federal standards to clear shelves, this measure characterization

System Type	Cooling Capacity of Equipment	Age of Equipment	HSPF Estimate	η (Effective COP Estimate) (HSPF/3.413) * 0.95 (Distribution efficiency)
	< 65,000 Btu/h	2009 - 2017	7.7	2.2
		2017 on	8.2	2.3
	≥ 65,000 Btu/h and < 135,000 Btu/h	2010 -2023	11.3	3.1
		2023 on	11.6	3.2
	≥ 135,000 Btu/h and < 240,000 Btu/h	2010-2023	10.9	3.0
		2023 on	11.3	3.1
	≥ 240,000 Btu/h and < 760,000 Btu/h	2010 on	10.9	3.0
Resistance	N/A	N/A	N/A	1

Regardless of how the building is heated, the energy consumption of the fans must be accounted for. If the building is electrically heated, fan energy shall be subtracted from the savings as calculated above. If the building is heated with natural gas, this shall represent an electric penalty, i.e., an increase in consumption. This is calculated as follows:

$\Delta kWh = -(W_{fan} * N_{fan}) * t_{eff}$

W_{fan} = fan input power (kW)

N_{fan} = number of fans

t_{eff} = effective annual operation time, based on balance point temperature (hr)

= see table below in Fossil Fuel Savings section for further detail

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$\Delta Therms = [(\Delta Q_r + \Delta Q_w) * t_{eff}] / (100{,}000 * \eta)$

Where:

ΔQ_r = the heat loss reduction through the roof due to the destratification fan (Btu/hr)

= See calculation section below

ΔQ_w = the heat loss reduction through the exterior walls due to destratification fan (Btu/hr)

= See calculation section below

t_{eff} = effective annual operation time, based on balance point temperature (hr)

= use table below to select an appropriate value:[942]

will incorporate these federal appliance standards as an equipment efficiency option on January 1, 2024. If the application of this measure is in a new construction building, the HVAC equipment efficiency should be sourced from the applicable code edition of IECC. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints. Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code.

[942] These were calculated at various base temperatures using TMY3 data and adjusted to make consistent with the 30 year normal data used elsewhere. For more information see 'Destratification Fan Workpaper'; Robert Irmiger, Gas Technology Institute, 9/6/2015.

Climate Zone -Weather Station/City	t_{eff}				
	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	3810	4226	4880	5571	6436
2 - Chicago O'Hare AP / Chicago	3593	3986	4603	5254	6070
3 - Springfield #2 / Springfield	3038	3370	3891	4442	5131
4 - Belleville SIU RSCH / Belleville	2243	2488	2873	3280	3789
5 - Carbondale Southern IL AP / Marion	2271	2519	2909	3320	3836

100,000 = conversion factor (1 therm = 100,000 Btu)

η = thermal efficiency of heating equipment * distribution efficiency

= Actual, if unknown assume code baseline and assume 95% distribution efficiency. If unknown, assume 0.821.[943]

For example, for a warehouse facility located in Rockford, IL, installing destratification fans could reduce heat loss through the roof of 95,000 Btu/hr and a reduced heat loss through the wall of 51,228 Btu/hr. Assuming a balance point of 55°F the therms savings for the facility would be estimated as:

ΔTherms = $[(\Delta Q_r + \Delta Q_w) * t_{eff}] / (100{,}000 * \eta)$

= [(95,000 Btu/hr + 51,282 Btu/hr) * 4,880 hr] / [(100,000 Btu/therm) * 0.8)]

= 8,923 therms

Heat loss reduction through the roof

ΔQ_r = $Q_{r,s} - Q_{r,d}$

= $(1/R_r) * A_r * [(T_{r,s} - T_{oa}) - (T_{r,d} - T_{oa})]$

= $(1/R_r) * A_r * (T_{r,s} - T_{r,d})$

Where:

$Q_{r,s}$ = roof heat loss for stratified space

$Q_{r,d}$ = roof heat loss for destratified space

R_r = overall thermal resistance through the roof (hr · ft^2 · °F / Btu)

= Actual or estimated based on construction type. If unknown, assume the following:

Thermal Resistance Factor (R-Factor) for Roof	Retrofit[944]	New Construction[945]
R_r	15.0 (hr · ft^2 · °F / Btu)	30.0 (hr · ft^2 · °F / Btu)

A_r = roof area (ft^2)

= user input

[943] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[944] Professional judgement was used to address older vintage structures and an estimate of 50% of current code standard was used.

[945] Consistent with IECC 2015/2018/2021/2024 code requirements.

= can be approximated with floor area

T_{oa} = outside air temperature, note: therm savings calculations are actually independent of outside air because this term drops out of the heat loss reduction equation

$T_{r,s}$ = indoor temperature at roof deck, stratified case (°F)

= Actual. If unknown, use the following equation

= $m_s * h_r + T_{f,s}$

h_r = ceiling height/roof deck (ft)

m_s = estimated heat gain per foot elevation, stratified case (°F/ft)

= 0.8 °F/ft

= Professional judgement used to define value based on result from a Nicor Gas ETP Pilot field testing results and the Ansley article below.[946,947] Estimates from these sources fall on the conservative side of the industry rule of thumb range of 1-2 °F/ft heat gain.

$T_{f,s}$ = estimated floor temperature, stratified case (°F)

= $T_{tstat} – m_s * h_{tstat}$

= $T_{tstat} – 4$ °F

T_{tstat} = temperature set point at the thermostat

h_{tstat} = vertical distance between the floor and the thermostat, assumed 5ft

$T_{r,d}$ = indoor temp at roof, destratified case

= actual value, or may be estimated using the following:[948,949]

= T_{tstat} + 1 °F

For example, for a 50,000 ft^2 warehouse built in 1997 with 30 ft ceilings and a thermostat set point of 65°F. No further measured values available.

$\Delta Q_r = (1/R_r) * A_r * (T_{r,s} – T_{r,d}) = (1/R_r) * A_r * [(m_s * h_r + T_{tstat} – 4\ °F) – (T_{tstat} + 1\ °F)]$

$= (1/R_r) * A_r * [(0.8°F/ft * h_r) – 5\ °F]$

$= 1/(10\ hr \cdot ft^2 \cdot °F / Btu) * (50{,}000\ ft^2) * [(0.8°F/ft * 30\ ft) – 5\ °F]$

= 95,000 Btu/hr

Heat loss reduction through exterior walls

Note: a conservative estimate for therms savings would neglect the impact of heat loss through the walls. However, Ansley suggests that estimates based on the roof deck losses alone underestimate actual savings by up to 46%.[950]

$\Delta Q_w = Q_{w,s} - Q_{w,d}$

$= (1/R_w) * A_w * (T_{w,s} - T_{w,d})$

[946] Kosar, Doug, "1026: Destratification Fans – Public Project Report," Nicor Gas, Emerging Technology Program (Oct 2014): 10-11. Field testing results indicated approximately 0.6 °F/ft for a garden center.
[947] Aynsley, Richard, "Saving Heating Costs in Warehouses," ASHRAE Journal (Dec 2005): 48. Identifies a 0.8 °F/ft gain.
[948] Kosar, Doug, "1026: Destratification Fans – Public Project Report," Nicor Gas, Emerging Technology Program (Oct 2014): 10-11. Field testing results indicated approximately 0.6 °F/ft for a garden center.
[949] Aynsley, Richard, "Saving Heating Costs in Warehouses," ASHRAE Journal (Dec 2005): 48.
[950] Aynsley, Richard, "Saving Heating Costs in Warehouses," ASHRAE Journal (Dec 2005): 51.

Where:

R_w = overall thermal resistance through the exterior walls (hr · ft^2 · °F / Btu)

= Actual or estimated based on construction type.[951] If unknown, assume the following:

Thermal Resistance Factor (R-Factor) for Wall	Retrofit[952]	New Construction[953] (2010 or newer)
R_w	6.5 (hr · ft^2 · °F / Btu)	13.0 (hr · ft^2 · °F / Btu)

A_w = area of exterior walls (ft^2)

= user input

$T_{w,s}$ = average indoor air temperature for wall heat loss, stratified case

= If actual $T_{r,s}$ measurement is available[954]

= $[(T_{r,s} * h_a) + (T_{tstat} * h_b)] / h_r$

h_a = vertical distance between the heat source and the ceiling

h_b = vertical distance between the floor and the heat source

= Otherwise, use the linear stratification equation at average space height, see definition above.

= $m_s * (h_r / 2) + T_{f,s}$

= $m_s * (h_r / 2) + (T_{tstat} – 4)$

$T_{w,d}$ = average indoor air temperature for wall heat loss, destratified case

= $T_{tstat} + 0.5$

= conservative estimate using engineering judgment based on the same assumption used for $T_{r,f}$ estimate.

For example, for a 50,000 ft^2 warehouse built in 1997 with 1200 ft length of perimeter wall and 30 ft ceilings and a thermostat set point of 65°F and a measured temperature at the ceiling of 85°F and unit heaters located 10 feet from the roof:

ΔQ_w = $(1/R_w) * A_w * (T_{w,s} – T_{w,d})$

= $(1/R_w) * A_w * [([(T_{r,s} * h_a) + (T_{tstat} * h_b)] / h_r) – (T_{tstat} + 0.5\ °F)]$

= 1/(6.5 hr·ft^2·°F/Btu) * (1,200 * 30) * [([(85°F * 10ft) + (65°F * 20ft)] / 30ft) – (65 + 0.5 °F)]

= 1/(6.5 hr·ft^2·°F/Btu) * (36,000ft^2) * (71.7 °F – 65.5 °F)

= 34,338 Btu/hr

Measure eligibility check

[951] Because heat loss through the walls is estimated using the average space temperature pre- and post- destratification. There are a number of factors that can impact the average space temperature causing deviations from estimates of many degrees in some cases. As such, it is recommended that a conservative value for the thermal resistance through the walls, R_w, be used. A recommended method for determining R_w would be to use the highest R-value for the wall space, neglecting lower R-values associated with windows, thermal bridges, etc.

[952] ANSI/ASHRAE/IESNA 100-1995, "Energy Conservation in Existing Buildings," ASHRAE Standard (1995). Additionally, professional judgement was used to address older vintage structure prior to adoption of the 1995 standard and an estimate of 50% of current code standard was used.

[953] ANSI/ASHRAE/IESNA Standard 90.1-2007, "Energy Standard for Buildings Except Low-Rise Residential Buildings," ASHRAE Standard (2007): Table 5.5-4 and Table 5.5-5.

[954] Aynsley, Richard, "Saving Heating Costs in Warehouses," ASHRAE Journal (Dec 2005): 48.

Use the following algorithm to verify a fan system is sufficiently sized to destratify air across the entire area.

Effective area, A_{eff}, is the area over which a fan or a group of fans can be expected to effectively destratify a space. If A_{eff} is less than the roof area, A_r, a custom analysis approach should be followed to account for the change in the effectiveness of the system. In lieu of more detailed studies, effective area is defined based on the measured results from an Enbridge Gas field study in which the area a fan was expected to effectively destratify was equal to 5 times the fan diameter.[955] Effective area, is calculated as follows:

$$A_{eff} = [\pi * (5 * D_{fan})2) / 4] * N_{fan}$$

$$= 6.25 * \pi * D_{fan^2} * N_{fan}$$

Where:

A_{eff} = the effective area fan area on the floor (ft^2)

D_{fan} = fan diameter

N_{fan} = the number of fans

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-DSFN-V10-270101

REVIEW DEADLINE: 1/1/2030

[955] Enbridge Gas Distribution, Inc., "Big Fans Deliver Big Bonus," (Aug 2007). Additionally, multiple utilities have adopted this definition in their programs in including Enbridge Gas and Consumers Energy.

4.4.35 Economizer Repair and Optimization

DESCRIPTION

Economizers are designed to use unconditioned outside air (OA) instead of mechanical cooling to provide cooling when exterior conditions permit. When the OA temperature is less than the changeover temperature (determined by a static setpoint or a reference return air sensor) up to 100% OA is supplied to help meet the facility's cooling needs, thus reducing mechanical cooling energy and saving energy. An economizer that is not working or is not properly adjusted can waste energy and cause comfort issues. This HVAC measure involves the repair and optimization of common economizer problems such as adjusting changeover setpoint, repairing damper motors and linkages, and replacing non-working sensors and/or controllers. These repairs and adjustments result in proper operation which maximizes both occupant comfort and energy savings.

This measure is only appropriate for single zone packaged rooftop units. Custom calculations are required for savings for multi-zone systems.

In general, the HVAC Economizer Optimization measure may involve both repair and/or optimization, as below.

Economizer Repair – The economizer repair work is preformed to ensure that the existing economizer is working properly. This allows the system to take advantage of free cooling and ensure that the system is not supplying an excess amount of OA during non-economizing periods.

- **Replace Damper Motor** – If the existing damper motor is not operational, the unit will be replaced with a functioning motor to allow proper damper modulation.
- **Repair Damper Linkage** – If the existing linkage is broken or not adjusted properly, the unit will be replaced or adjusted to allow proper damper modulation.
- **Repair Economizer Wiring** – If the existing economizer is not operational due to a wiring issue, the issue will be repaired to allow proper economizer operation.
- **Reduce Over Ventilation** – If the unit is supplying excess OSA, the OSA damper position will be adjusted to meet minimum ventilation requirements.
- **Replace Economizer Sensor**– If the unit is equipped with a nonadjustable dry bulb (i.e., snapdisk) or malfunctioning analog sensor, the sensor is replaced with a new selectable sensor.
- **Replace Economizer Control**– If the existing economizer controller is not operational, the unit will be replaced or upgraded to allow for proper economizer operation.

Economizer Optimization – The economizer optimization work is performed to ensure that the existing economizer system is set up properly to maximize use of free cooling for units located in a particular climate zone.

- **Economizer Changeover Setpoint Adjustment** – If the unit is equipped with a fully operational economizer, the controller is adjusted to the appropriate changeover setpoint based on ASHRAE 90.1 (Figure 1 - *Table 6.5.1.1.3 High-Limit Shutoff Control Settings for Air Economizers)* for the corresponding climate zone.
- **Enable Integrated Operation** – If the unit is equipped with a fully operational economizer and is not set up to allow a minimum of two stages of cooling (1st stage – Economizer Only & 2nd Stage – Economizer & Mechanical cooling), the unit will be wired to allow two stage cooling

This measure was developed to be applicable to the following program types: RF, DI.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment condition is defined by fully functional economizer that is programmed to meet ASHRAE 90.1 economizer changeover setpoint requirements for the facility's climate zone and changeover control type (Figure 1 - Table 6.5.1.1.3 High-Limit Shutoff Control Settings for Air Economizers).[956]

Figure 1 – Baseline ASHRAE High-Limit Shutoff Control Settings

TABLE 6.5.1.1.3 High-Limit Shutoff Control Settings for Air Economizers[b]

Control Type	Allowed Only in Climate Zone at Listed Setpoint	Required High-Limit Setpoints (Economizer Off When):	
		Equation	Description
Fixed dry-bulb temperature	1b, 2b, 3b, 3c, 4b, 4c, 5b, 5c, 6b, 7, 8	$T_{OA} > 75°F$	Outdoor air temperature exceeds 75°F
	5a, 6a	$T_{OA} > 70°F$	Outdoor air temperature exceeds 70°F
	1a, 2a, 3a, 4a,	$T_{OA} > 65°F$	Outdoor air temperature exceeds 65°F
Differential dry-bulb temperature	1b, 2b, 3b, 3c, 4b, 4c, 5a, 5b, 5c, 6a, 6b, 7, 8	$T_{OA} > T_{RA}$	Outdoor air temperature exceeds return air temperature
Fixed enthalpy with fixed dry-bulb temperature	All	$h_{OA} > 28$ Btu/lb[a] or $T_{OA} > 75°F$	Outdoor air enthalpy exceeds 28 Btu/lb[a] of dry air[a] or outdoor air temperature exceeds 75°F
Differential enthalpy with fixed dry-bulb temperature	All	$h_{OA} > h_{RA}$ or $T_{OA} > 75°F$	Outdoor air enthalpy exceeds return air enthalpy or outdoor air temperature exceeds 75°F

a. At altitudes substantially different than sea level, the fixed enthalpy limit shall be set to the enthalpy value at 75°F and 50% RH. As an example, at approximately 6000 ft elevation, the fixed enthalpy limit is approximately 30.7 Btu/lb.
b. Devices with selectable rather than adjustable setpoints shall be capable of being set to within 2°F and 2 Btu/lb of the setpoint listed.

Figure 2 – ASHRAE Climate Zone Map

NORMATIVE APPENDIX B
CLIMATE ZONES FOR U.S. STATES AND COUNTIES

This normative appendix provides the climate zones for U.S. states and counties. Figure B-1 contains the county-level climate zone map for the United States. Table B-1 lists each state and major counties within the state and shows the climate number and letter for each county listed.

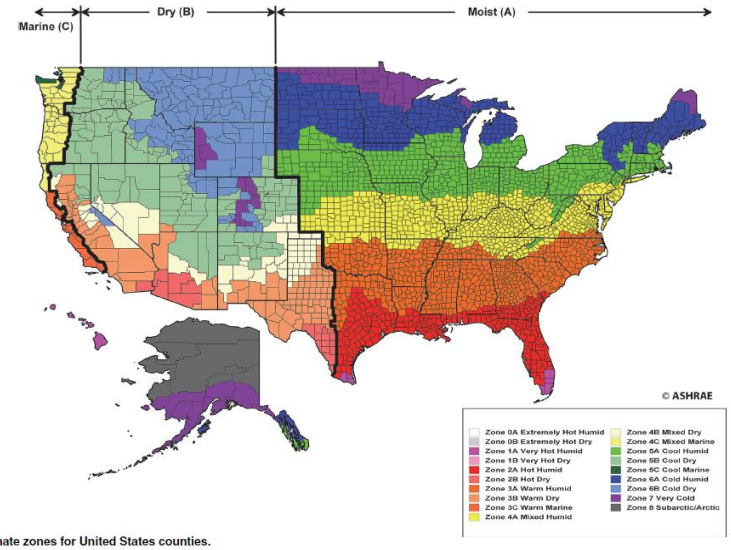

FIGURE B-1 Climate zones for United States counties.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is an existing economizer installed on a packaged single zone rooftop HVAC unit. The existing economizer system is currently not operating as designed due to mechanical and/or control problems, and/or is not optimally adjusted.

[956] ASHRAE, Standard 90.1-2013

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 5 years.[957]

DEEMED MEASURE COST

The cost for this measure can vary considerably depending upon the existing condition of the economizer and the work required to achieve the required efficiency levels. Measure cost should be determined on a site-specific basis.

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

The savings calculation methodology uses a regression equation to calculate the energy savings for a variety of common situations.[958] The equation variables are limited to the ranges listed; if the actual conditions fall outside of these ranges, custom calculations are required.

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = [Baseline\ Energy\ Use\ (kWh/ton) - Proposed\ Energy\ Use\ (kWh/ton)] * Cooling\ Capacity\ (Tons)$$

The following equations are used to calculate baseline and proposed electric energy use.[959]

Changeover types: Fixed Dry-Bulb (DB), Dual Temperature Dry-Bulb (DTDB), Dual Temperature Enthalpy (DTEnth), Fixed Enthalpy (Enth), and Analog ABCD Economizers (ABCD).

Electric Energy Use Equations (kWh/ton):

Building Type	Changeover Type	Equation
Assembly	DB	CZ + CSP*(-2.021) + EL*(-16.362 + OAn*1.665 + OAx*(-3.13)
	DTDB	CZ + EL*(-11.5) + OAn*1.635 + OAx*(-2.817)
	DTEnth	CZ + EL*(-17.772) + OAn*1.853 + OAx*(-3.044)
	Enth	CZ + CSP*(-5.228) + EL*(-17.475) + OAn*1.765 + OAx*(-3.003)
	ABCD	CZ + CSP*(-2.234) + EL*(-16.394) + OAn*1.744 + OAx*(-3.01)
Convenience Store	DB	CZ + CSP*(-3.982) + EL*(-27.508) + OAn*2.486 + OAx*(-4.684)
	DTDB	CZ + EL*(-20.798) + OAn*2.365 + OAx*(-3.773)
	DTEnth	CZ + EL*(-30.655) + OAn*2.938 + OAx*(-4.461)
	Enth	CZ + CSP*(-8.648) + EL*(-25.678) + OAn*2.092 + OAx*(-3.754)
	ABCD	CZ + CSP*(-3.64) + EL*(-24.927) + OAn*2.09 + OAx*(-3.788)
	DB	CZ + CSP*(-0.967) + EL*(-6.327) + OAn*2.87 + OAx*(-1.047)

[957] DEER 2014 (DEER2014 EUT Table D08 v2.05).

[958] For more information on methodology, please refer to workpaper submitted by CLEAResult titled "CLEAResult_Economizer Repair_151020_Finalv2.doc". Note that the original ComEd eQuest models were used in the analysis, rather than the VEIC developed models used elsewhere. VEIC do not consider this a significant issue as adjustments from the ComEd models were focused on calibrating EFLH values, not to overall energy use metrics. We also believe using the ComEd models is likely more conservative. It may be appropriate to update the analysis with the updated models at a later time.

[959] This approach allows the savings estimate to account for the operational attributes of the baseline as well as the proposed case, yielding a better estimate than an approach that assumes a particular baseline or proposed energy use to determine savings.

Building Type	Changeover Type	Equation
Office - Low Rise	DTDB	CZ + OAn*2.968 + OAx*(-0.943)
	DTEnth	CZ + EL*(-9.799) + OAn*3.106 + OAx*(-1.085)
	Enth	CZ + CSP*(-2.773) + EL*(-7.392) + OAn*2.941 + OAx*(-0.974)
	ABCD	CZ + CSP*(-1.234) + EL*(-7.229) + OAn*2.936 + OAx*(-0.995)
Religious Facility	DB	CZ + CSP*(-1.131) + OAn*3.542 + OAx*(-1.01)
	DTDB	CZ + EL*(-10.198) + OAn*4.056 + OAx*(-1.279)
	DTEnth	CZ + OAn*3.775 + OAx*(-1.031)
	Enth	CZ + CSP*(-2.13) + OAn*3.317 + OAx*(-0.629)
	ABCD	CZ + CSP*(-0.95) + OAn*3.313 + OAx*(-0.647)
Restaurant	DB	CZ + CSP*(-2.243) + EL*(-21.523) + OAx*(-1.909)
	DTDB	CZ + EL*(-14.427) + OAn*0.295 + OAx*(-1.451)
	DTEnth	CZ + EL*(-25.99) + OAn*0.852 + OAx*(-1.951)
	Enth	CZ + CSP*(-4.962) + EL*(-16.868) + OAn*(-0.12) + OAx*(-1.418)
	ABCD	CZ + CSP*(-2.115) + EL*(-16.15) + OAn*(-0.125) + OAx*(-1.432)
Retail - Department Store	DB	CZ + CSP*(-1.003) + OAn*3.765 + OAx*(-0.938)
	DTDB	CZ + OAn*3.688 + OAx*(-0.676)
	DTEnth	CZ + OAn*4.081 + OAx*(-1.072)
	Enth	CZ + CSP*(-2.545) + OAn*3.725 + OAx*(-0.788)
	ABCD	CZ + CSP*(-1.175) + OAn*3.708 + OAx*(-0.809)
Retail - Strip Mall	DB	CZ + CSP*(-1.192) + EL*(-5.62) + OAn*3.353 + OAx*(-1.142)
	DTDB	CZ + OAn*3.355 + OAx*(-0.915)
	DTEnth	CZ + EL*(-9.202) + OAn*3.642 + OAx*(-1.215)
	Enth	CZ + CSP*(-2.997) + EL*(-5.938) + OAn*3.312 + OAx*(-0.964)
	ABCD	CZ + CSP*(-1.36) + EL*(-5.884) + OAn*3.3 + OAx*(-0.987)

Where:

CZ = Climate Zone Coefficient

= Depends on Building Type and Changover Type (see table below)

		Electric Climate Zone Coefficients				
Building Type	Changeover Type	CZ1 (Rockford)	CZ2 (Chicago)	CZ3 (Springfield)	CZ4 (Belleville)	CZ5 (Marion)
Assembly	DB	874.07	886.73	1043.38	1071.48	1072.20
	DTDB	698.45	711.89	870.13	899.51	903.10
	DTEnth	702.06	715.42	873.43	902.76	906.50
	Enth	851.95	865.43	1020.65	1047.10	1053.32
	ABCD	884.19	897.63	1053.12	1080.58	1086.35
Convenience Store	DB	1739.12	1787.09	2128.78	2206.65	2245.93
	DTDB	1389.28	1436.30	1780.99	1863.45	1904.89
	DTEnth	1398.42	1446.82	1789.71	1869.89	1912.59
	Enth	1643.51	1691.34	2032.83	2112.21	2157.63
	ABCD	1692.80	1740.62	2082.35	2162.73	2207.68
Office - Low Rise	DB	674.06	687.17	899.17	993.84	989.16
	DTDB	583.62	597.02	811.39	907.61	903.58

Building Type	Changeover Type	Electric Climate Zone Coefficients				
		CZ1 (Rockford)	CZ2 (Chicago)	CZ3 (Springfield)	CZ4 (Belleville)	CZ5 (Marion)
	DTEnth	588.94	602.11	816.02	912.49	908.26
	Enth	668.83	682.23	893.61	987.52	986.59
	ABCD	690.27	703.52	915.27	1009.94	1008.59
Religious Facility	DB	613.26	630.50	853.53	923.99	931.74
	DTDB	518.40	535.45	760.76	832.57	840.72
	DTEnth	513.59	531.20	756.26	829.13	837.26
	Enth	576.94	594.17	817.64	888.37	897.18
	ABCD	593.78	611.04	834.69	905.83	914.27
Restaurant	DB	1397.27	1430.45	1763.21	1837.63	1872.18
	DTDB	1191.82	1225.12	1558.32	1633.95	1669.13
	DTEnth	1192.84	1226.77	1559.41	1635.13	1671.11
	Enth	1343.56	1377.52	1710.11	1783.66	1821.67
	ABCD	1373.72	1407.70	1740.43	1814.74	1852.55
Retail - Department Store	DB	717.89	730.07	968.85	1034.78	1035.06
	DTDB	628.83	641.70	883.37	951.09	951.33
	DTEnth	629.35	641.90	882.84	951.33	951.44
	Enth	705.06	717.99	956.42	1020.57	1024.45
	ABCD	728.60	741.47	980.19	1045.30	1048.57
Retail - Strip Mall	DB	800.69	818.68	1070.39	1129.87	1133.84
	DTDB	692.97	711.31	965.63	1026.68	1030.41
	DTEnth	698.12	716.34	970.06	1031.78	1035.72
	Enth	784.54	803.35	1054.37	1112.72	1120.74
	ABCD	810.10	828.86	1080.11	1139.39	1146.95

CSP = Economizer Changeover Setpoint (°F or Btu/lb) (actual in ranges below)

Economizer Control Type		Economizer Changeover Setpoint
Dry-Bulb		60°F – 80°F
Dual Temperature Dry-Bulb		0°F – 5°F delta
Dual Temperature Enthalpy		0 Btu/lb – 5 Btu/lb delta
Enthalpy		18 Btu/lb – 28 Btu/lb
Analog ABCD Economizers	A	73°F
	B	70°F
	C	67°F
	D	63°F
	E	55°F

EL = Integrated Economizer Operation (Economizer Lockout)

= 1 for Economizer w/ Integrated Operation (Two Stage Cooling)

= 0 for Economizer w/ out Integrated Operation (One Stage Cooling)

OAn = Minimum Outside Air (%OA * 100)[960]

= Actual. %OA must be between 15% and 70%. If unknown, assume:

- Functional Economizer – 30%
- Nonfunctional Economizer (Damper failed closed) – 15%
- Nonfunctional Economizer (Damper failed open) – 30% (assume Minimum Ventilation (Three Fingers))[961]

Note: the actual integer Oan value (e.g., 30) should be used in the regression algorithm, not the percentage (e.g., 0.3).

OAx = Maximum Outside Air (%)

= Actual. Must be between 15% and 70%. If unknown, assume:

- Functional Economizer – 70%
- Nonfunctional Economizer (Damper failed closed) – 15%
- Nonfunctional Economizer (Damper failed open) – 30% (assume Minimum Ventilation (Three Fingers))

For example, a low-rise office building in Rockford (Climate Zone 1) is heated and cooled with a packaged Gas (92 kBtu output) / DX (5 ton) RTU. The RTU is equipped with a fixed dry bulb outside air economizer and is programed for integrated operation. When the technician inspects the RTU they find that the changeover setpoint is programmed to 62°F, which does not meet ASHRAE economizer high limit shut off air economizer recommendations. After further investigation it is found that the OA damper motor is not operational and is providing 30% outside air.

The technician replaces the damper motor and allow for proper OA damper modulation (30% Min OA & 70% Max OA). They also adjust the fixed dry-bulb changeover setpoint to meet the ASHRAE economizer high limit shut off air economizer recommendation of 70°F.

ΔkWh = [Baseline Energy Use (kWh/ton) - Proposed Energy Use (kWh/ton)] * Cooling Capacity (tons)

Baseline Energy Use (kWh/ton) = Equation for Office Low Rise

= CZ + CSP*(-0.967) + EL*(-6.327) + OAn*2.87 + OAx*(-1.047)

= 674.06 + 62*(-0.967) + 0*(-6.327) + 30*2.87 + 30*(-1.047)

= 668.8 kWh/ton

Proposed Energy Use (kWh/ton) = Equation for Office Low Rise

= CZ + CSP*(-0.967) + EL*(-6.327) + OAn*2.87 + OAx*(-1.047)

= 674.06 + 70*(-0.967) + 0*(-6.327) + 30*2.87 + 70*(-1.047)

= 619.2 kWh/ton

ΔkWh = [668.8 (kWh/ton) - 619.2 (kWh/ton)] * 5 tons

= 49.6 kWh/ton * 5 tons

= 248.08 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A - It is assumed that repair or optimization of the economizer will not typically have a significant impact on summer peak demand.

[960] DNV GL, "HVAC Impact Evaluation Final Report WO32 HVAC – Volume 1: Report," California Public Utilities Commission, Energy Division, HVAC Commercial Quality Maintenance (CQM) (1/28/14).

[961] Technician rule of thumb taken from CPUC 'HVAC Impact Evaluation Final Report', WO32, 28Jan 2015, p18.

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = [Baseline\ Energy\ Use\ (Therms/kBtuh) - Proposed\ Energy\ Use\ (Therms/kBtuh)] * Output\ Heating\ Capacity\ (kBtuh)$$

The following equations are used to calculate baseline and proposed electric energy use.

Natural Gas Energy Use Equations (therms / kbtu output)

Building Type	Changeover Type	Equation
Assembly	DB	CZ + OAn*0.0853
	DTDB	CZ + OAn*0.0866
	DTEnth	CZ + OAn*0.0866
	Enth	CZ + OAn*0.0855
	ABCD	CZ + OAn*0.0855
Convenience Store	DB	CZ + OAn*0.26
	DTDB	CZ + OAn*0.263
	DTEnth	CZ + OAn*0.263
	Enth	CZ + OAn*0.261
	ABCD	CZ + OAn*0.261
Office - Low Rise	DB	CZ + OAn*0.3
	DTDB	CZ + OAn*0.301
	DTEnth	CZ + OAn*0.301
	Enth	CZ + OAn*0.3
	ABCD	CZ + OAn*0.3
Religious Facility	DB	CZ + OAn*0.35
	DTDB	CZ + OAn*0.348
	DTEnth	CZ + OAn*0.348
	Enth	CZ + OAn*0.349
	ABCD	CZ + OAn*0.349
Restaurant	DB	CZ + OAn*0.0867
	DTDB	CZ + OAx*(-0.038) + OAn*OAx*0.00149
	DTEnth	CZ + OAx*(-0.038) + OAn*OAx*0.00149
	Enth	CZ + OAn*0.0878
	ABCD	CZ + OAn*0.0878
Retail - Department Store	DB	CZ + OAn*0.319
	DTDB	CZ + OAn*0.318
	DTEnth	CZ + OAn*0.318
	Enth	CZ + OAn*0.318
	ABCD	CZ + OAn*0.318
Retail - Strip Mall	DB	CZ + OAn*0.215
	DTDB	CZ + OAn*0.216
	DTEnth	CZ + OAn*0.216
	Enth	CZ + OAn*0.215
	ABCD	CZ + OAn*0.215

Where:

CZ = Climate Zone Coefficient

= Depends on Building Type and Changover Type (see table below)

		Natural Gas Climate Zone Coefficients				
Building Type	**Changeover Type**	**CZ1 (Rockford)**	**CZ2 (Chicago)**	**CZ3 (Springfield)**	**CZ4 (Belleville)**	**CZ5 (Marion)**
Assembly	DB	-0.03	-0.55	-1.06	-1.28	-1.71
	DTDB	-0.02	-0.57	-1.11	-1.34	-1.79
	DTEnth	-0.02	-0.57	-1.11	-1.34	-1.79
	Enth	-0.03	-0.55	-1.06	-1.29	-1.72
	ABCD	-0.03	-0.55	-1.06	-1.29	-1.72
Convenience Store	DB	2.95	0.50	-1.48	-2.96	-5.56
	DTDB	3.06	0.52	-1.56	-3.11	-5.81
	DTEnth	3.06	0.52	-1.56	-3.11	-5.81
	Enth	2.96	0.50	-1.49	-2.98	-5.59
	ABCD	2.96	0.50	-1.49	-2.98	-5.59
Office - Low Rise	DB	5.83	3.02	0.46	-0.92	-4.13
	DTDB	5.98	3.08	0.41	-1.03	-4.36
	DTEnth	5.98	3.08	0.41	-1.03	-4.36
	Enth	5.85	3.03	0.46	-0.93	-4.16
	ABCD	5.85	3.03	0.46	-0.93	-4.16
Religious Facility	DB	9.23	6.71	3.75	2.40	-0.80
	DTDB	9.41	6.83	3.77	2.39	-0.86
	DTEnth	9.41	6.83	3.77	2.39	-0.86
	Enth	9.25	6.73	3.75	2.40	-0.80
	ABCD	9.25	6.73	3.75	2.40	-0.80
Restaurant	DB	8.30	6.54	4.94	4.00	1.95
	DTDB	10.51	8.71	7.07	6.10	4.00
	DTEnth	10.51	8.71	7.07	6.10	4.00
	Enth	8.28	6.51	4.91	3.96	1.90
	ABCD	8.28	6.51	4.91	3.96	1.90
Retail - Department Store	DB	8.20	5.86	3.19	1.25	-2.59
	DTDB	8.35	5.94	3.18	1.18	-2.75
	DTEnth	8.35	5.94	3.18	1.18	-2.75
	Enth	8.21	5.87	3.18	1.24	-2.61
	ABCD	8.21	5.87	3.18	1.24	-2.61
Retail - Strip Mall	DB	6.40	4.35	2.07	0.49	-2.18
	DTDB	6.51	4.38	2.03	0.39	-2.34
	DTEnth	6.51	4.38	2.03	0.39	-2.34
	Enth	6.41	4.35	2.06	0.48	-2.20
	ABCD	6.41	4.35	2.06	0.48	-2.20

For example, a low-rise office building in Rockford (Climate Zone 1) is heated and cooled with a packaged Gas (92 kBtu output) / DX (5 ton) RTU. The RTU is equipped with a fixed dry bulb outside air economizer and is programed for integrated operation. When the technician inspects the RTU they find that the changeover setpoint is programmed to 62°F, which does not meet ASHRAE economizer high limit shut off air economizer recommendations. After further investigation it is found the OA damper motor is not operational and is providing 30% outside air.

The technician replaces the damper motor and allow for proper OA damper modulation (30% Min OA & 70% Max OA). They also adjust the fixed dry-bulb changeover setpoint to meet the ASHRAE economizer high limit shut off air economizer recommendation of 70°F.

ΔTherms = [Baseline Energy Use (Therms/kBtuh) - Proposed Energy Use (Therms/kBtuh)] * Output Heating Capacity (kBtuh)

Baseline Energy Use (Therms/kBtuh) = Equation for Office Low Rise

= CZ + OAn*0.3
= 5.83 + 30*0.3
=14.8 Therms/kBtuh output

Proposed Energy Use (Therms/kBtuh) = Equation for Office Low Rise

= CZ + OAn*0.3
= 5.83+30*0.3
=14.8 Therms/kBtuh output

ΔTherms = [14.8(Therms/kBtuh output) - 14.8 (Therms/kBtuh output)] * 92kBtuh output

= 0.0 (Therms/kBtuh output) * 92kBtuh output

= 0 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-ECRP-V06-260101

REVIEW DEADLINE: 1/1/2029

4.4.36 Multi-Family Space Heating Steam Boiler Averaging Controls

DESCRIPTION

This measure covers multi-family space heating boiler averaging controls. Temperature sensors are placed in interior spaces to monitor the average temperature of the building. At a minimum, a sensor must be placed at each corner and at one central location. Additionally, a temperature sensor must monitor the outside air temperature. These sensors shall provide data to the averaging controls. The averaging controls will adjust the boiler operation based upon an average of the indoor sensors and the outside air temperature. These controls shall also incorporate a night-time setback capability. Buildings utilizing thermostatic radiator valves, or other modulating control valves or sequences to control the temperature in individual spaces, are not eligible.

This measure was developed to be applicable to the following program types: RF.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify the boiler(s) must incorporate an averaging control system utilizing at least 4 indoor sensors and 1 outdoor sensor. The controls shall have the capability to incorporate a nighttime setback throughout the building.

DEFINITION OF BASELINE EQUIPMENT

The baseline is a boiler system without averaging controls or other steam supply modulating controls. Current boiler control system can utilize a single thermostat or aquastat and timer.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for the domestic hot water boiler(s) is 20 years.[962]

DEEMED MEASURE COST

As a retrofit measure, the actual installed cost should be used for screening purposes. A deemed retrofit measure cost of $5,060 can be used if the actual installed cost is unknown.[963]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS[964]

$$\Delta\text{Therms} = Capacity * EFLH * SF / 100{,}000$$

[962] The Brooklyn Union Gas Company, High Efficiency Heating and Water and Controls, Gas Energy Efficiency Program Implementation Plan.

[963] NREL, "Steam Balancing and Tuning for Multifamily Residential Buildings in Chicagoland-Second Year of Data Collection", August 2013.

[964] The preferred algorithm for determining fossil fuel savings relies on capacity of the boiler, this algorithm is more closely aligned with how similar measures in the TRM calculate fossil fuel savings. The algorithm that uses Living Units to estimate savings exists as an option for when the capacity of the existing boiler is unknown.

Or

ΔTherms = $Living\ Units * Gas_Boiler_Load * HF * SF$

Where:

Capacity = Boiler gas input size (Btu/h)

= Actual

Living Units = Number of living units (apartment or condos) served by the boiler

= Actual

HF = Household factor

= 65% for multifamily[965]

Gas_Boiler_Load = Estimate of annual household load for gas boiler heated single-family homes. If location is unknown, assume the average below[966]

Climate Zone (City based upon)	Gas_Boiler_Load (therms)
1 (Rockford)	1275
2 (Chicago)	1218
3 (Springfield)	1043
4 (Belleville)	805
5 (Marion)	819
Average	1158

EFLH = Effective Full Load Hours for heating in Existing Buildings are provided in section 4.4. HVAC End Use

SF = Savings Factor

= 10.2%,[967] or custom if savings can be substantiated

100,000 = converts Btu/h to therm

For example, a 1,000,000 btu/h steam boiler in a Mid-Rise Multi-Family building in Chicago has averaging controls installed.

ΔTherms = 1,000,000 * 1,685 * 0.102 / 100,000

= 1,719 therms

[965] Multifamily household heating consumption relative to single-family households is affected by overall household square footage and exposure to the exterior. This 65% reduction factor is applied to MF homes, based on professional judgment that average household size, and heat loads of MF households are smaller than single-family homes

[966] Values are based on household heating consumption values and inferred average AFUE results from Table 3-4, Program Sample Analysis, *Nicor R29 Res Rebate Evaluation Report 092611_REV FINAL to Nicor*). Adjusting to a statewide average using relative HDD values to adjust for the evaluation results focus on northern region. Values for individual cities are then calculated by comparing average HDD to the individual city's HDD.

[967] "Steam Balancing and Tuning for Multifamily Residential Buildings in Chicagoland-Second Year of Data Collection", NREL, August 2013, states that test buildings with steam balancing measures saved an average of 10.2%. The energy savings estimate assumes additional system balancing through the installation of large capacity air vents on steam main lines and the replacement of radiator vents. This work is assumed to be done in concert with any system being retrofitted with averaging controls.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-SBAC-V04-260101

REVIEW DEADLINE: 1/1/2028

4.4.37 Unitary HVAC Condensing Furnace

DESCRIPTION

Condensing furnaces recover energy in combustion exhaust flue gasses that would otherwise simply be vented to the atmosphere, making them more efficient than non-condensing furnaces. This measure applies to a constant volume (CV), dedicated outside air system (DOAS), make-up air system (MUAS), or any unitary HVAC system that is utilizing an indirect gas fired process to heat 100% OA to provide ventilation or make-up air to commercial and industrial (C&I) building spaces. The unitary package must contain an indirect gas-fired, warm air furnace section, but the unitary package can be with or without an electric air conditioning section. The unitary package can be either a single package or split system that is applied indoors (non-weatherized) or outdoors (weatherized).

This measure excludes demand control ventilation, condensing unit heaters, and high efficiency (condensing) furnaces with annual fuel utilization efficiency (AFUE) ratings (for furnaces with less than 225,000 Btu/hr input capacity), which are covered by other measures for the C&I sector in the Technical Reference Manual (TRM).[968]

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the efficient unitary equipment must contain a condensing, warm air furnace with a natural gas thermal efficiency (TE) rating of 90% or higher, or alternatively, the unitary package must have equipment nameplate information for natural gas that identifies a heating output and heating input rating that has an output over input ratio of 0.90 or higher. These ratings must be certified by a recognized testing laboratory in accordance with American National Standards Institute (ANSI) Standard Z21.47 for Gas-Fired Central Furnaces.[969] The furnace must be vented and condensate disposed of in accordance with the equipment manufacturer installation instructions and applicable codes.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is expected to be unitary equipment that contains a non-condensing, warm air furnace with a natural gas thermal efficiency (TE) rating of 81%, or alternatively, the unitary package will have equipment nameplate information for natural gas that identifies a heating output and heating input rating that has an output over input ratio of 0.81. These ratings must be certified by a recognized testing laboratory in accordance with American National Standards Institute (ANSI) Standard Z21.47 for Gas-Fired Central Furnaces. Note, effective January 1, 2023, the Department of Energy (DOE) federal minimum efficiency standard is 81% for ≥225,000 Btu/hr input capacity furnaces per the Energy Conservation Standard for Commercial Warm Air Furnaces.[970] In the American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE) Standard 90.1 Energy Standard for Buildings Except Low-Rise Residential Buildings[971] that minimum TE requirement is extended below 225,000 Btu/hr input capacity to require all commercial warm air furnaces and combination warm air furnace/air conditioning units to meet the minimum 81% TE.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years[972], which is consistent with the established TRM measure life for single-package and split system unitary air conditioners, since in colder climates these unitary packages typically contain a gas-fired, warm air furnace section, with an electric air conditioning section.

[968] Illinois Statewide Technical Reference Manual (TRM), Version 14.0 (effective January 1, 2026), 2026.
[969] American National Standards Institute (ANSI), ANSI Z21.47 Standard for Central Gas-Fired Central Furnaces, 2012.
[970] Department of Energy (DOE), Commercial Warm Air Furnace Standard DOE 10 CFR, Part 431, Subpart D – Commercial Warm Air Furnaces, (10 CFR 431.77).
[971] American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE), ASHRAE Standard 90.1 Energy Standard for Buildings Except Low-Rise Residential Buildings, 2013.
[972] Minnesota Department of Commerce, Division of Energy Resources, Field Study of Condensing Hating in Makeup-Air and Mixed-Air Rooftop Units (RTUs), GTI, October 2017

DEEMED MEASURE COST

The actual incremental equipment and installation costs should be used, if available. If not, the incremental cost of $5.42 per 1000 Btu/hr of output capacity should be used for the condensing furnace equipment (as part of a unitary package) and its installation (including the combustion condensate drainage and disposal system). This incremental cost is from the DOE Technical Support Document for the Notice of Proposed Rulemaking (NOPR) for the Commercial Warm Air Furnace Standard.[973] Per the DOE documentation, it is based on their representative 250,000 Btu/hr input capacity furnace at a 92% TE.

LOADSHAPE

Loadshape C23 - Commercial Ventilation

COINCIDENCE FACTOR

The coincidence factor is assumed to be 1.0 – that is, building ventilation will always be provided during peak periods.

Algorithm

CALCULATION OF SAVINGS

The following methodology provides formulas for estimating gas heating savings associated with condensing furnaces in unitary HVAC packages when applied as a CV, DOAS, MUAS, or any RTU that is indirectly heating 100% outside air (OA). These types of HVAC systems typically run continuously during the HVAC operating schedule to provide building ventilation and maintain indoor air quality or to compensate for exhaust and maintain neutral or slightly positive building pressurization. The algorithm estimates the gas use reduction resulting from utilizing condensing heating of 90% or higher thermal efficiency (TE) in place of the federal minimum TE of 80% (or other user defined baseline TE) for commercial warm air furnaces.

The methodology provides a representative group of operating schedules for the market sector applications highlighted earlier based on DOE commercial reference building models.[974] Heating loads during the operating schedule are determined based on hourly differences between a range of supply air (SA) heated to temperatures and the OA temperature using Typical Meteorological Year (TMYx) weather data.[975] These hourly heating loads are generated for all hours when the OA temperature is below the base temperature of 55 °F for heating in C&I settings per the TRM. To accommodate the variability in heating base temperatures in C&I settings, these hourly heating loads are also generated for base temperatures of 45 °F and 65 °F for heating. The hourly heating loads are then summed for the entire year. The annual heating loads are calculated in this manner for the climate zone 2 weather station (Chicago O'Hare Airport), which is then normalized to its National Centers for Environmental Information (NCEI)[976] 15-year (2006-2020) weather average by multiplying by the heating degree day (HDD) ratio of the NCEI/TRM HDD55 over the TMYx HDD55 (HDD at base temperature of 55 °F), and likewise for the annual heating loads for HDD45 (HDD at base temperature of 45 °F) and HDD65 (HDD at base temperature of 65 °F), using the values in Table 1 and Table 2. Since detailed hourly weather data is not available for all 5 of the TRM climate zone weather stations, the annual heating loads for the other climate zones are determined by multiplying the climate zone 2 annual heating loads by the ratio of the other climate zone NCEI HDD over the climate zone 2 NCEI HDD, using the values in Table 1.

These annual heating loads on a per unit airflow basis are then used in conjunction with the actual airflow of the 100% OA system and its condensing efficiency to calculate the gas heating savings versus the baseline (non-condensing) heating efficiency. This measure results in additional electric use by the unitary HVAC package due to the additional pressure drop of the condensing heat exchanger of the warm air furnace section.

[973] Department of Energy (DOE), Rulemaking for Commercial Warm Air Furnace Standard, Technical Support Document 2015.
[974] Department of Energy (DOE) National Renewable Energy Laboratory, Commercial Reference Building Models of the National Building Stock, 2011.
[975] TMYx climate normal data from year 2007 till 2021; climate.onebuilding.org.
[976] National Centers for Environmental Information, U.S Climate Normal 15-year data set from 2006-2020.

Table 1. NCEI/TRM HDD Values for All Climate Zones[977]

Climate Zone - Weather Station/City	NCEI 15 Year Average HDD45	NCEI 15 Year Average HDD55	NCEI 15 Year Average HDD65
1 - Rockford AP / Rockford	2419	4171	6414
2 - Chicago O'Hare AP / Chicago	2059	3760	5963
3 - Springfield #2 / Springfield	1743	3296	5368
4 - Belleville SIU RSCH / Belleville	1089	2351	4162
5 - Carbondale Southern IL AP / Marion	1148	2499	4413

Table 2. TMYx HDD Values for Climate Zone 2[978]

Climate Zone - Weather Station/City	TMYx HDD45	TMYx HDD55	TMYx HDD65
2 - Chicago O'Hare AP / Chicago	2093	3855	6086

ELECTRIC ENERGY SAVINGS

As noted previously, this measure results in additional SA fan electric use by the unitary HVAC system due to the additional pressure drop of the condensing heat exchanger of the warm air furnace section.

$$\Delta kWh = -(t_{FAN} * cfm * \Delta P) / (\eta_{FAN/MOTOR} * 8520)$$

Where:

t_{FAN} = annual fan runtime (hr), refer to Tables 3 through 14

cfm = airflow (cfm), use actual or rated system airflow

ΔP = incremental pressure drop (inch W.G.), assume 0.15 if actual value not known

$\eta_{FAN/MOTOR}$ = combined fan and motor efficiency, assume 0.60 if actual value not known

8520 = conversion factor (fan horsepower – HP – calculation constant of 6356 for standard air conditions adjusted by 1 HP = 0.746 kW, or 6356/ 0.746 = 8520 for this kW calculation)

SUMMER COINCIDENT PEAK DEMAND SAVINGS

The additional SA fan electric use by the unitary HVAC system will typically result in a modest electric demand increase.

$$\Delta kW = (\Delta kWh / t_{FAN}) * CF$$

Where:

[977] National Centers for Environmental Information, U.S Climate Normal 15-year data set from 2006-2020.
[978] TMYx climate normal data from year 2007 till 2021; climate.onebuilding.org.

CF = 1.0

For example, for a "big box" retail store operating 24 hours a day and 7 days a week (8760 hours per year) with a 5000 cfm DOAS that has an incremental pressure drop of 0.15 inch W.G. and a combined fan and motor efficiency of 0.6 has annual kWh savings of:

ΔkWh = - (t_{FAN} * cfm * ΔP) / ($\eta_{FAN/MOTOR}$ * 8520)
= - (8760 * 5000 * 0.15) / (0.6 * 8520)
= - 1285 kWh

ΔkW = (ΔkWh / t_{FAN}) * CF
= (- 1285 / 8760) * 1.0
= - 0.15 kW

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = [Q_{OA} * cfm * (1/TE_{NC} - 1/TE_C)]/ 100{,}000$$

Where:

Q_{OA} = annual outside air (OA) heating load per cfm of OA (Btu/cfm)

First, select the most representative operating schedule for the application from among the four (4) scenarios listed below and its set of three (3) applicable tables. Second, select the table in that set with the most representative HDD base temperature – the base temperature for OA below which heating is required. If that base temperature is not readily determined, select the TRM default base temperature of 55 °F (HDD55) for heating in C&I settings. Third, select the climate zone within that table. Fourth, select an appropriate heated to supply air (SA) temperature within that table. Use the resulting Q_{OA} value, with linear interpolation allowed between SA temperatures.

The four (4) scenarios available are indicative of the following building applications and operating schedules:

1. 24 hour a day and 7 day a week (24/7) operation, with HVAC operating schedule of 8760 hours per year, typical of large retail stores with DOAS, hotel/multifamily buildings with corridor MUAS, and healthcare facilities with DOAS. Use Table 3 through Table 5.

2. 6:00 AM to 1:00 AM everyday operation, with HVAC operating schedule of 7300 hours per year, typical of full service and quick service restaurants with kitchen MUAS. Use Table 6 through Table 8.

3. 7:00 AM to 9:00 PM Monday-Friday, 7:00 AM to 10:00 PM Saturday, and 9:00 AM to 7:00 PM Sunday operations, with HVAC operating schedule of 5266 hours per year, typical of non-24/7 retail stores with DOAS. Use Table 9 through Table 11.

4. 7:00 AM to 9:00 PM Monday-Friday operation, with HVAC operating schedule of 3911 hours per year, typical of school buildings with DOAS. Use Table 12 through Table 14.

TE_{NC} = non-condensing thermal efficiency (TE), use federal minimum TE of 81% (0.81) or actual TE if known

TE_C = condensing thermal efficiency (TE), use actual TE or if unknown assume 90% (0.90)

100,000 = conversion factor (1 therm = 100,000 Btu)

Continuing the previous example: for a climate zone 2 (Chicago O'Hare AP / Chicago) application using a 90% TE condensing DOAS with a supply air temperature from the DOAS of 95 °F:

$\Delta Therms = [Q_{OA} * cfm * (1/TE_{NC} - 1/TE_C)]/ 100,000$

$= 307,374 * 5,000 * (1/0.81 – 1/0.90)/100,000$

$= 1,897$ therms

8760 Hour Annual Operation Scenario

Table 3. 8760 Hour Annual Operation Scenario for HDD45

Supply Air Fan Runtime = 8760 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone - Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	200,876	246,935	292,995	339,054
2 - Chicago O'Hare AP / Chicago	171,021	210,235	249,449	288,663
3 - Springfield #2 / Springfield	144,713	177,895	211,076	244,258
4 - Belleville SIU RSCH / Belleville	90,394	111,120	131,847	152,574
5 - Carbondale Southern IL AP / Marion	95,368	117,235	139,102	160,970

Table 4. 8760 Hour Annual Operation Scenario for HDD55

Supply Air Fan Runtime = 8760 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone - Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	229,235	285,134	341,034	396,933
2 - Chicago O'Hare AP / Chicago	206,610	256,992	307,374	357,756
3 - Springfield #2 / Springfield	181,126	225,294	269,462	313,630
4 - Belleville SIU RSCH / Belleville	129,220	160,730	192,240	223,751
5 - Carbondale Southern IL AP / Marion	137,337	170,826	204,316	237,806

Table 5. 8760 Hour Annual Operation Scenario for HDD65

Supply Air Fan Runtime = 8760 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone - Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	249,288	321,098	392,909	464,719
2 - Chicago O'Hare AP / Chicago	231,766	298,529	365,292	432,055
3 - Springfield #2 / Springfield	208,624	268,721	328,818	388,914
4 - Belleville SIU RSCH / Belleville	161,761	208,358	254,955	301,553
5 - Carbondale Southern IL AP / Marion	171,517	220,924	270,332	319,739

7300 Hour Annual Operation Scenario

Table 6. 7300 Hour Annual Operation Scenario for HDD45

Supply Air Fan Runtime = 7300 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	170,393	207,917	245,441	282,965
2 - Chicago O'Hare AP / Chicago	145,069	177,016	208,963	240,910
3 - Springfield #2 / Springfield	122,753	149,785	176,818	203,851
4 - Belleville SIU RSCH / Belleville	76,677	93,562	110,448	127,333
5 - Carbondale Southern IL AP / Marion	80,896	98,711	116,526	134,341

Table 7. 7300 Hour Annual Operation Scenario for HDD55

Supply Air Fan Runtime = 7300 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	184,019	229,029	274,038	319,047
2 - Chicago O'Hare AP / Chicago	165,857	206,423	246,990	287,557
3 - Springfield #2 / Springfield	145,400	180,963	216,526	252,090
4 - Belleville SIU RSCH / Belleville	103,732	129,103	154,475	179,847
5 - Carbondale Southern IL AP / Marion	110,248	137,213	164,178	191,144

Table 8. 7300 Hour Annual Operation Scenario for HDD65

Supply Air Fan Runtime = 7300 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	199,927	257,510	315,093	372,675
2 - Chicago O'Hare AP / Chicago	185,875	239,410	292,946	346,481
3 - Springfield #2 / Springfield	167,315	215,505	263,695	311,885
4 - Belleville SIU RSCH / Belleville	129,731	167,096	204,461	241,826
5 - Carbondale Southern IL AP / Marion	137,555	177,174	216,792	256,411

5266 Hour Annual Operation Scenario

Table 9. 5266 Hour Annual Operation Scenario for HDD45

Supply Air Fan Runtime = 5266 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	116,847	142,840	168,834	194,827
2 - Chicago O'Hare AP / Chicago	99,481	121,611	143,742	165,872
3 - Springfield #2 / Springfield	84,178	102,904	121,630	140,355
4 - Belleville SIU RSCH / Belleville	52,581	64,278	75,975	87,672
5 - Carbondale Southern IL AP / Marion	55,474	67,815	80,156	92,496

Table 10. 5266 Hour Annual Operation Scenario for HDD55

Supply Air Fan Runtime = 5266 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	125,486	156,333	187,181	218,028

Supply Air Fan Runtime = 5266 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
2 - Chicago O'Hare AP / Chicago	113,100	140,903	168,706	196,509
3 - Springfield #2 / Springfield	99,150	123,524	147,897	172,271
4 - Belleville SIU RSCH / Belleville	70,736	88,125	105,513	122,902
5 - Carbondale Southern IL AP / Marion	75,180	93,660	112,141	130,622

Table 11. 5266 Hour Annual Operation Scenario for HDD65

Supply Air Fan Runtime = 5266 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	136,447	175,864	215,281	254,697
2 - Chicago O'Hare AP / Chicago	126,857	163,503	200,149	236,795
3 - Springfield #2 / Springfield	114,190	147,177	180,164	213,151
4 - Belleville SIU RSCH / Belleville	88,540	114,117	139,694	165,271
5 - Carbondale Southern IL AP / Marion	93,880	120,999	148,119	175,239

3911 Hour Annual Operation Scenario

Table 12. 3911 Hour Annual Operation Scenario for HDD45

Supply Air Fan Runtime = 3911 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	84,156	102,887	121,617	140,348
2 - Chicago O'Hare AP / Chicago	71,649	87,596	103,542	119,489
3 - Springfield #2 / Springfield	60,627	74,121	87,614	101,108
4 - Belleville SIU RSCH / Belleville	37,870	46,299	54,728	63,156
5 - Carbondale Southern IL AP / Marion	39,954	48,847	57,739	66,632

Table 13. 3911 Hour Annual Operation Scenario for HDD55

Supply Air Fan Runtime = 3911 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	90,860	113,295	135,729	158,164
2 - Chicago O'Hare AP / Chicago	81,892	102,113	122,333	142,553
3 - Springfield #2 / Springfield	71,792	89,518	107,244	124,970
4 - Belleville SIU RSCH / Belleville	51,218	63,864	76,510	89,157
5 - Carbondale Southern IL AP / Marion	54,435	67,876	81,317	94,757

Table 14. 3911 Hour Annual Operation Scenario for HDD65

Supply Air Fan Runtime = 3911 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
1 - Rockford AP / Rockford	99,503	128,516	157,530	186,543
2 - Chicago O'Hare AP / Chicago	92,509	119,483	146,457	173,431
3 - Springfield #2 / Springfield	83,272	107,553	131,834	156,114
4 - Belleville SIU RSCH / Belleville	64,567	83,393	102,220	121,046

Supply Air Fan Runtime = 3911 Hours	Q_{oa} (Annual Btu/cfm) At Supply Air Temperature Of			
Climate Zone -Weather Station/City	75°F	85°F	95°F	105°F
5 - Carbondale Southern IL AP / Marion	68,461	88,423	108,385	128,347

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

The actual incremental annual maintenance costs should be used, if available. If not, the incremental cost of $0.05 per 1000 Btu/hr of output capacity should be used for maintaining the combustion condensate disposal system yearly. This incremental cost is from the DOE Technical Support Document for the Notice of Proposed Rulemaking (NOPR) for the Commercial Warm Air Furnace Standard. Per the DOE documentation, it is based on their representative 250,000 Btu/hr input capacity furnace at a 92% TE.

MEASURE CODE: CI-HVC-UNCF-V06-270101

REVIEW DEADLINE: 1/1/2030

4.4.38 Covers and Gap Sealers for Room Air Conditioners

DESCRIPTION

Room air conditioners (window ACs, through-the-wall or sleeve ACs, PTACs or PTHPs) constitute a permanent or semi-permanent penetration through the building's envelope. These units are often poorly installed, resulting in gaps that act like air leakage pathways through the building's envelope. The uncontrolled movement of air across the gaps in the envelope (infiltration) increases the building's winter heating requirements and reduces its overall energy performance.

The heat loss and infiltration can be reduced by installing a rigid or flexible insulated cover on the inside of a room AC. These covers should be maintained by building staff and should remain installed through the heating season. Simple uninsulated cloth covers with no sealing at edges do not qualify for this measure.

There are several types of AC covers available that may be eligible for this measure:

- If the room AC is left in the window or sleeve, a rigid cover that covers the indoor side of the AC unit with foam gaskets to seal the edges may be installed.
- If the room AC is absent or is removed during the heating months, a rigid cover that fits inside the sleeve with foam gaskets along the edges for proper air sealing may be installed.
- Flexible covers that are well insulated and perfectly cover the indoor side of the AC unit may also be eligible for this measure.

This measure should be used for commercial and multi family common area units. Residential and multi family in-unit should use prescriptive assumptions in 5.6.1 Air Sealing.

This measure was developed to be applicable to the following program types: RF, DI. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The installed equipment is a rigid cover that fits inside the empty sleeve or completely covers the indoor side of a window AC unit, with foam gaskets sealing the edges. A flexible insulated cover that perfectly covers the indoor side of the unit and seals gaps may also be installed. Covers should remain installed throughout the winter heating season.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a room AC (window AC, through-the-wall or sleeve AC, PTAC or PTHP) that is poorly installed with gaps around the edges and does not use AC covers or gap sealers during the winter heating months.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life of typical AC covers is 5 years.[979]

DEEMED MEASURE COST

The measure cost is the full cost of installing AC covers. Actual installation costs (material and labor) should be used if available. In actual costs are unknown, assume material cost of $24 (flexible covers) up to $119, depending on size of the AC unit.[980] The install time per unit is 15 to 30 minutes at assumed labor rate of $20/hour.

LOADSHAPE

Loadshape C04 – Commercial Electric Heating

COINCIDENCE FACTOR

N/A

[979] New York Standard Approach for Estimating Energy Savings from Energy Efficiency Programs V4, April 2016 (New York TRM).
[980] Cost estimates from customer invoices and vendors. Material costs can be lower for bulk orders.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

If the building is electrically heated, electric energy savings are calculated as follows:

$$\Delta kWh = (Q_{infiltration} * 1.08 * (T_{SA} - T_{OA}) * EFLH_{heat}) / (3{,}412 * COP)$$

Where:

$Q_{infiltration}$ = Air infiltration (CFM) due to poor installation of window or through-the-wall AC[981]

$$= ELA * 0.000645 * (f_s{}^2 fs2 * (T_{SA} TSA - T_{OA} TOA) + f_w{}^2 fw2 * U^2 U2)^{1/2} * 2118.88$$

Where:

ELA = Effective Leakage Area (sq. in.)

= Can be collected on site; if unknown, assume 6 sq. in.[982]

0.000645= Converts square inches to square meters

f_s = Stack Coefficient

$$= 1/3 * (9.81 * Height * 0.3048 / TOA)^{0.5}$$

f_w = Wind Coefficient

$$= A * B * (Height * 0.3048 / 10)^C$$

Where:

9.81 = Acceleration due to gravity (m/s^2)

Height = Height of the location of the leakage area in feet

= Assume 8 ft per floor

0.3048 = Converts feet to meters

T_{OA} = Average Outside Air Temperature during heating period.[983] Use values from table below, based on facility location.[984] This figure must be in Kelvin to determine Stack Coefficient (f_s) and infiltration ($Q_{infiltration}$), but in Fahrenheit to determine energy savings (ΔkWh, ΔTherms).

Zone	T_{OA} (°F)	T_{OA} (K)
Zone 1 (Rockford)	31.63	272.94
Zone 2 (Chicago)	33.99	274.26
Zone 3 (Springfield)	34.58	274.58
Zone 4 (Belleville)	36.24	275.51
Zone 5 (Marion)	39.07	277.08

[981] Infiltration equation and values for stack and wind coefficient equations from "The Use of Blower Door Data." Max Sherman, 1998. The equation is adjusted for wall leakage area (i.e. no ceiling or floor leakage).

[982] Average effective leakage area for multi-family building AC units from "There are Holes in Our Walls." Prepared for Urban Green Council by Steven Winter Associates, April 2011.

[983] "Heating Period" is defined as hours when the TMY3 dry bulb temperature is less than 55°F (balance point).

[984] Based on NREL's Typical Meteorological Year 3 (TMY3) data for different weather stations.

A, B and C = Constants based on the facility site's shielding and terrain parameters. Use values from the tables below:[985]

Shielding Class	Shielding Type	Shielding Description	A
1	None	No obstructions or local shielding whatsoever (i.e. isolated building)	0.324
2	Light	Light local shielding with few obstructions (e.g. A few trees or a shed in the vicinity)	0.285
3	Moderate	Moderate local shielding; some obstructions within two house heights (e.g. Thick hedge fence on fence and nearby building)	0.24
4	Heavy	Heavy shielding; obstructions around most of perimeter buildings or trees within five building heights in most directions (e.g. Well developed/dense tract house)	0.185
5	Very Heavy	Very heavy shielding, large obstruction surrounding perimeter within two house heights (e.g. Typical downtown area)	0.102

Terrain Class	Terrain Type	Terrain Description	B	C
1	None	Ocean or other body of eater with at least 5 km of unrestricted space	1.3	0.1
2	Light	Flat terrain with some isolated obstacles (e.g. Buildings or trees well separated from each other)	1	0.15
3	Moderate	Rural areas with low buildings, trees etc.	0.85	0.2
4	Heavy	Urban, industrial or forest areas	0.67	0.25
5	Very Heavy	Center of large city (e.g. Manhattan)	0.47	0.35

0.3048 = Converts feet to meters

T_{SA} = Average Indoor Air Temperature during heating period. This figure will need to be in Kelvin to calculate infiltration ($Q_{infiltration}$) and Fahrenheit to calculate energy savings (ΔkWh, ΔTherms).

= Collected on site. If unknown, assume 72°F (295 K). If known, convert °F to K by using the following equation: K = (°F + 459.67) * (5/9).

U = Average Wind Speed (m/s) during heating period. Use table below, based on facility location.[986]

Zone	U (m/s)
Zone 1 (Rockford)	4.50
Zone 2 (Chicago)	4.67
Zone 3 (Springfield)	4.60
Zone 4 (Belleville)	3.92
Zone 5 (Marion)	3.07

2118.88 = Converts m^3/s to CFM

[985] Shielding and terrain class descriptions and constants from "The Use of Blower Door Data." Max Sherman, 1998" and "Wind and Infiltration Interaction for Small Buildings." MH Sherman and DT Grimsrud, Lawrence Berkley Laboratory, 1982.
[986] Based on TMY3 data, see "Covers for Room AC_11092016.xls" for more information.

1.08 = Sensible heat transfer constant (Btu/hr.CFM.°F)

$EFLH_{heat}$ = Equivalent Full Load Hours for heating in Existing Buildings from section 4.4 HVAC End Use[987]

3,412 = Converts Btus to kWh

COP = Coefficient of Performance of the heating unit

= Collected on site. If unknown assume 2.6 for PTHP[988]

If the floor of the building where the AC cover was installed is known, deemed per-unit savings for the Multifamily Building type for Shielding Class 3 and Terrain Class 3 are as follows:

Multifamily - Electric Savings per Unit (kWh/unit) Floor # Where Installed is Known						
Floor # Where Installed	Height	Rockford	Chicago	Springfield	Belleville	Marion
1	8	55.18	53.16	45.70	31.09	25.67
2	16	68.19	65.31	56.17	38.72	32.66
3	24	77.92	74.34	63.96	44.45	37.97
4	32	86.04	81.85	70.44	49.25	42.44
5	40	93.15	88.42	76.11	53.46	46.37
6	48	99.56	94.34	81.22	57.26	49.93
7	56	105.44	99.76	85.90	60.75	53.20
8	64	110.91	104.80	90.25	63.99	56.24
9	72	116.04	109.53	94.33	67.04	59.11
10	80	120.89	114.00	98.19	69.92	61.81
12	96	129.92	122.31	105.36	75.29	66.85
14	112	138.21	129.94	111.95	80.22	71.49
16	128	145.93	137.04	118.08	84.81	75.82
18	144	153.19	143.72	123.84	89.13	79.88
20	160	160.05	150.03	129.29	93.21	83.72
22	176	166.59	156.03	134.47	97.10	87.38
24	192	172.83	161.77	139.42	100.82	90.88
26	208	178.82	167.28	144.18	104.38	94.23
28	224	184.58	172.57	148.75	107.81	97.46
30	240	190.15	177.69	153.17	111.12	100.58

If the floor of the building where the AC cover was installed is unknown, but the total number of floors in the building is known, assume the AC overs were installed evenly across all floors of the building. Therefore, savings is the average of the savings for each floor less than or equal to the total number of floors in the building. The deemed per-unit savings for the Multifamily Building type for Shielding Class 3 and Terrain Class 3 is:

[987] Although in theory the hours should be all hours that infiltration is expected (i.e. all hours <55F), the IL TAC has agreed to use the Equivalent Full Load Hours to keep the savings at a more conservative level.

[988] From IECC 2012 Minimum Efficiency Requirements. For a 1 ton PTHP, COP = 2.9 – (0.026 * 12,000/1,000).

Multifamily - Electric Savings per Unit (kWh/unit) Floor # Where Installed is not Known, But Total Building Height is Known						
# of Floors in Building	Building Height	Rockford	Chicago	Springfield	Belleville	Marion
1	8	55.18	53.16	45.70	31.09	25.67
2	16	61.69	59.24	50.94	34.91	29.17
3	24	67.10	64.27	55.28	38.09	32.10
4	32	71.83	68.67	59.07	40.88	34.69
5	40	76.10	72.62	62.48	43.39	37.02
6	48	80.01	76.24	65.60	45.71	39.17
7	56	83.64	79.60	68.50	47.85	41.18
8	64	87.05	82.75	71.22	49.87	43.06
9	72	90.27	85.72	73.79	51.78	44.84
10	80	93.33	88.55	76.23	53.59	46.54
12	96	96.66	91.62	78.88	55.57	48.39
14	112	100.12	94.81	81.63	57.62	50.31
16	128	103.64	98.06	84.44	59.71	52.27
18	144	107.18	101.32	87.25	61.81	54.25
20	160	110.71	104.57	90.05	63.91	56.21
22	176	114.20	107.79	92.83	65.98	58.16
24	192	117.65	110.96	95.57	68.03	60.08
26	208	121.05	114.09	98.27	70.05	61.98
28	224	124.39	117.17	100.93	72.04	63.85
30	240	127.68	120.19	103.54	73.99	65.68

For example, a mid-rise multi-family building located in the moderate terrain class and shielding class of Chicago, has 16 rooms on the 10th floor (80 feet high) with PTHPs that get covered with a cover and foam gasket during the heating months. The indoor temperature during the heating months is maintained at 74°F. The air infiltration and the related energy savings from the AC covers and seals are calculated as follows -

For Shielding Class 3 and Terrain Class 3,

A = 0.24, B = 0.85 and C = 0.2

Therefore,

$f_s = 1/3 * (9.81\ m/s^2 * 80\ ft * 0.3048\ m/ft / 274.26\ K)^{0.5} = 0.3\ m/K^{½}.s$

$f_w = 0.24 * 0.85 * (80\ ft * 0.3048\ m/ft / 10\ m)^{0.2} = 0.24$

Total effective leakage area (ELA) = 16 units * 6 sq. in. = 96 sq. in.

$Q_{infiltration} = ELA * 0.000645 * (f_s^2 * (T_{SA} – T_{OA}) + f_w^2 * U^2)^{1/2} * 2118.88$

$= 96 * 0.000645 * (0.3^2 * (296.48\ K – 274.26\ K) + 0.24^2 * 4.67^2)^{1/2} * 2118.88$

$= 237\ CFM$

ΔkWh = (237 * 1.08 Btu/hr.CFM.°F * (74°F – 33.99°F) * 1,782) / (3,412 Btu/kWh* 2.6)

= 2,057 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

As the savings occur during the winter season (non-peak), there are no demand savings associated with this measure.

FOSSIL FUEL SAVINGS

If the building is heated with gas, the natural gas savings are calculated as follows:

$$\Delta Therms = (Q_{infiltration} * 1.08\ Btu/hr.CFM.°F * (T_{SA} - T_{OA}) * EFLH_{heat}) / (100{,}000\ Btu/therm * \eta)$$

Where:

η = Efficiency of heating equipment.

= Collected on site. If unknown, assume 80%[989].

100,000 = Converts Btus to therms

Other factors as defined above

If the floor of the building where the AC cover was installed is known, deemed per-unit savings per unit for the Multifamily Building type for Shielding Class 3 and Terrain Class 3 are as follows:

Multifamily - Gas Savings per Unit (Therms/Unit) Floor # Where Installed is Known						
Floor # Where Installed	Height	Rockford	Chicago	Springfield	Belleville	Marion
1	8	6.12	5.90	5.07	3.45	2.85
2	16	7.56	7.24	6.23	4.29	3.62
3	24	8.64	8.24	7.09	4.93	4.21
4	32	9.54	9.08	7.81	5.46	4.71
5	40	10.33	9.81	8.44	5.93	5.14
6	48	11.04	10.46	9.01	6.35	5.54
7	56	11.69	11.06	9.53	6.74	5.90
8	64	12.30	11.62	10.01	7.10	6.24
9	72	12.87	12.15	10.46	7.43	6.55
10	80	13.41	12.64	10.89	7.75	6.85
12	96	14.41	13.56	11.68	8.35	7.41
14	112	15.33	14.41	12.41	8.90	7.93
16	128	16.18	15.20	13.09	9.40	8.41
18	144	16.99	15.94	13.73	9.88	8.86
20	160	17.75	16.64	14.34	10.34	9.28
22	176	18.47	17.30	14.91	10.77	9.69
24	192	19.16	17.94	15.46	11.18	10.08
26	208	19.83	18.55	15.99	11.57	10.45
28	224	20.47	19.14	16.50	11.96	10.81
30	240	21.09	19.70	16.98	12.32	11.15

If the floor of the building where the AC cover was installed is unknown, but the total number of floors in the building is known, assume the AC overs were installed evenly across all floors of the building. Therefore, savings is the average of the savings for each floor less than or equal to the total number of floors in the building. The deemed per-unit savings for the Multifamily Building type for Shielding Class 3 and Terrain Class 3 is:

Multifamily - Gas Savings per Unit (Therms/Unit) Floor # Where Installed is not Known, But Total Building Height is Known						
# of Floors in Building	Building Height	Rockford	Chicago	Springfield	Belleville	Marion
1	8	6.12	5.90	5.07	3.45	2.85

[989] Energy Independence and Security Act of 2007 – averaged for hot water and steam boilers.

Multifamily - Gas Savings per Unit (Therms/Unit) Floor # Where Installed is not Known, But Total Building Height is Known						
# of Floors in Building	Building Height	Rockford	Chicago	Springfield	Belleville	Marion
2	16	6.84	6.57	5.65	3.87	3.24
3	24	7.44	7.13	6.13	4.22	3.56
4	32	7.97	7.62	6.55	4.53	3.85
5	40	8.44	8.05	6.93	4.81	4.11
6	48	8.87	8.46	7.28	5.07	4.35
7	56	9.27	8.83	7.60	5.31	4.57
8	64	9.65	9.18	7.90	5.53	4.78
9	72	10.01	9.51	8.18	5.74	4.97
10	80	10.35	9.82	8.45	5.94	5.16
12	96	10.72	10.16	8.75	6.16	5.37
14	112	11.10	10.51	9.05	6.39	5.58
16	128	11.49	10.87	9.36	6.62	5.80
18	144	11.89	11.24	9.68	6.85	6.02
20	160	12.28	11.60	9.99	7.09	6.23
22	176	12.66	11.95	10.29	7.32	6.45
24	192	13.05	12.31	10.60	7.54	6.66
26	208	13.42	12.65	10.90	7.77	6.87
28	224	13.79	12.99	11.19	7.99	7.08
30	240	14.16	13.33	11.48	8.21	7.28

For example, a gas-heated mid-rise multi-family building located in the moderate terrain class and shielding class of Chicago, has 16 rooms on the 10th floor (80 feet high) with room air conditioners that get covered with an AC cover and foam gasket during the heating months. The indoor temperature during the heating months is maintained at 74°F. The air infiltration and the related therm savings from the AC covers and seals are calculated as follows:

For Shielding Class 3 and Terrain Class 3,

A = 0.24, B = 0.85 and C = 0.2

Therefore,

$f_s = 1/3 * (9.81\ m/s^2 * 80\ ft * 0.3048\ m/ft / 274.26\ K)^{0.5} = 0.3\ m/K^{½}.s$

$f_w = 0.24 * 0.85 * (80\ ft * 0.3048\ m/ft / 10\ m)^{0.2} = 0.24$

Total effective leakage area (ELA) = 16 units * 6 sq.in = 96 sq. in

$Q_{infiltration} = ELA * 0.000645 * (f_s^2 * (T_{SA} – T_{OA}) + f_w^2 * U^2)^{1/2} * 2118.88$

$= 96 * 0.000645 * (0.3^2 * (296.48\ K – 274.26\ K) + 0.24^2 * 4.67^2)^{1/2} * 2118.88$

= 237 CFM

ΔTherms = (237 * 1.08 Btu/hr.CFM.°F * (74°F – 33.99°F) * 1,782) / (100,000 Btu/therm * 80%)

= 228 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-CRAC-V05-260101

REVIEW DEADLINE: 1/1/2028

4.4.39 High Temperature Heating and Ventilation (HTHV) Direct Fired Heater

DESCRIPTION

This measure applies to 100% outside air, high temperature heating and ventilation (HTHV) direct fired gas heaters. These units replace unit heaters (indirect gas fired or steam coil) or rooftop units in warehouses which suffer from extreme temperature stratification, minimal controls, and reduced heating efficiencies.

Warehouses have high ceilings (~30 ft high) and suffer from stratification of air. The warm air rises and remains near the roof which keeps the thermostat from reaching its desired setpoint. This increases the run hours of the heating unit and causes discomfort among the occupants. The HTHV units have high pressure fans that direct high temperature and high velocity air towards the floor to help minimize temperature stratification. On average, a 30 ft high warehouse could reduce its linear stratification from 0.53°F/ft to 0.13°F/ft, thus maintaining a more uniform temperature in the room and reducing the operating hours of the heating unit.

Since the HTHV units are direct fired, they also have improved efficiencies of 92% compared to 80% for a typical indirect fired unit heater or rooftop unit. They transfer the latent heat of the flue gases into the space instead of venting it out.

This measure only applies to high ceiling warehouses that do not have any other destratification technologies installed (e.g., destratification fans, air rotation units). New HTHV units must be the warehouse's primary heat source.

This measure was developed to be applicable to the following program types: RF, TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment must be a 100% outside air, HTHV direct fired gas heater with a discharge temperature greater than or equal to 150°F, a temperature rise that is greater than or equal to 140°F, and an efficiency exceeding 92%.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment must be an indirect fired gas, steam unit heater, or a rooftop unit used as the primary space heating source. Warehouses with existing destratification technologies (high volume, low speed fans or air turnover units) do not qualify for this measure.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[990]

DEEMED MEASURE COST

The measure cost should be based on a contractor's evaluation of the project scope and may vary significantly on a project-to-project basis. If unknown, for early replacement or retrofit projects, assume $14.50/MBtuh (material cost for an HTHV unit) or $26/MBtuh (sum of material and installation cost).[991]

The incremental measure cost, assuming a baseline of standard efficiency unit heaters, is $7.43/MBtuh (material cost).[992]

LOADSHAPE

Loadshape C04: Commercial Electric Heating

[990] Based on "Field Demonstration of High Efficiency Gas Heaters", prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014.
[991] Average costs from CLEAResult's evaluation of 9 different projects in the Chicagoland area.
[992] Based on data collected in "Field Demonstration of High Efficiency Gas Heaters", prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014.

COINCIDENCE FACTOR

Assumed to be 0.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

HTHV units may increase the facility's electric energy consumption due to high pressure motors that supply air at higher velocity.

$$\Delta kWh = -(kWh/HDD) * HDD$$

Where:

kWh/HDD = increase in electric energy consumption due to HTHV fan motor

= 1.04[993]

HDD = heating degree days

Zone	City	HDD55[994]	ΔkWh
1	Rockford	4,272	(4,443)
2	Chicago	4,029	(4,190)
3	Springfield	3,406	(3,542)
4	Belleville	2,515	(2,616)
5	Marion	2,546	(2,648)

Although HTHV fan motors have a higher power draw, they also result in decreased heating equipment operating time, potentially offsetting some of the increase in electrical energy consumption. Therefore, if replacing heating equipment other than unit heaters, a custom evaluation may be necessary to determine if there is an increase in electrical energy consumption.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Since HTHV units operate during the winter (non-peak) season, there are no demand savings associated with this measure.

FOSSIL FUEL SAVINGS

Custom calculation below. Otherwise, use a deemed savings factor from the table that follows.

$$\Delta Therms = (FLH_{base} * Cap_{base} / (\eta_{base} * 100)) - (FLH_{eff} * Cap_{eff} / (\eta_{eff} * 100))$$

Where:

$FLH_{base} = LF_{base} * Hours$

$FLH_{eff} = LF_{eff} * Hours$

Hours = Annual operating hours of the unit, calculated as total number of hours when outside air temperature is less than 55°F. This can be adjusted based on the facility's occupancy schedule.

LF_{base} = load factor of baseline unit heater

[993] Based on data collected in "Field Demonstration of High Efficiency Gas Heaters", prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014. This study replaced four standard unit heaters with HTHV units, and the electrical energy increased from 0.40 kWh/HDD to 1.44 kWh/HDD. Therefore, savings are assumed to be 1.04 kWh /HDD.

[994] 30-year normals from the National Climactic Data Center (NCDC), assuming base temperature 55.

$= (Q_{inf,base} + Q_{w,base} + Q_{r,base})/(Cap_{base} * 100)$

LF_{eff} = load factor of HTHV heater

$= (Q_{inf,eff} + Q_{w,eff} + Q_{r,eff})/(Cap_{eff} * 100)$

Cap_{base} = existing heating unit input capacity (MBtuh)

= can be collected on site, or assumed to be the same as HTHV unit capacity, Cap_{eff}

Cap_{eff} = HTHV unit input capacity (MBtuh)

= can be collected on site or from specification sheets

η_{base} = efficiency of existing heating unit

= collected from equipment nameplate or assumed as70% for steam unit heaters, 80% for gas fired unit heaters, and 84% for rooftop units[995]

η_{eff} = efficiency of HTHV unit

= collected from equipment nameplate or assumed as 92%

100 = converts MBtu to therms

See following table for savings inputs.

[995] Efficiency of existing systems assumed from ASHRAE 90.1 – 2010 and manufacturer's specification sheets for various equipment. Steam unit heaters have a lower efficiency due to steam distribution losses.

Parameter	Existing Unit	Proposed (Efficient) Unit
Temperatures		
Setpoint Temperature (°F):	$T_{setpoint}$ = collected on site, or assumed as 65°F	
Ceiling Temperature[996] (°F):	Either collected on site when the existing unit is in operation with an infrared gun or assumed as: $T_{c,base}$= $T_{setpoint}$ + 0.53°F/ft * Height	Either collected on site when the proposed unit is in operation with an infrared gun or assumed as: $T_{c,eff}$ = $T_{setpoint}$ + 2 to 4°F
Average Room Temperature (°F):	$T_{r,base}$= ($T_{setpoint}$ + $T_{c,base}$) / 2	$T_{r,eff}$= ($T_{setpoint}$ + $T_{c,eff}$) / 2
Outside Air Temperature (°F):	T_{OA} from local weather data[997]	
Heat Loads		
Infiltration Load[998]:	$Q_{inf,base}$= 0.04CFM/ft^2 * (Wall Surface Area + Roof Surface Area) * 1.08 * ($T_{r,base}$ - T_{OA})	$Q_{inf,eff}$= 0.04CFM/ft^2 * (Wall Surface Area + Roof Surface Area) * 1.08 * ($T_{r,eff}$ - T_{OA})
Wall Conduction Load[999]:	$Q_{w,base}$ = 1/R-value$_{wall}$ * (Wall Surface Area * 1.08 * ($T_{r,base}$ - T_{OA}) Where: R-value$_{wall}$ = the insulation value of the wall. It can be collected on site or assumed as R-15.	$Q_{w,eff}$ = 1/R-value$_{wall}$ * (Wall Surface Area * 1.08 * ($T_{r,eff}$ - T_{OA}) Where: R-value$_{wall}$ = the insulation value of the wall. It can be collected on site or assumed as R-15.
Roof Conduction Load:	$Q_{r,base}$ = 1/R-value$_{roof}$ * (Roof Surface Area * 1.08 * ($T_{r,base}$ - T_{OA}) Where: R-value$_{roof}$ = the insulation value of the roof. It can be collected on site or assumed as R-20.	$Q_{r,eff}$ = 1/R-value$_{roof}$ * (Roof Surface Area * 1.08 * ($T_{r,eff}$ - T_{OA}) Where: R-value$_{roof}$ = the insulation value of the roof. It can be collected on site or assumed as R-20.
Surface Areas		
Roof Surface Area:	Collected on site or assumed as: = facility area in ft^2 If facility area is unknown, assume facility area[1000]: = 41.4 ft^2/MBtuh * Cap$_{eff}$	
Wall Surface Area:	Collected on site or assumed as: = (Height * Length + Height * Width) * 2 Where: Length, height, and width (feet) of the facility can be collected on site. If unknown, assume: Length = Width = (Facility Area)$^{1/2}$ and Height = 25 ft If facility area is unknown, assume facility area: = 41.4 ft^2/MBtuh * Cap$_{eff}$	

The default values from the table above were used to calculate the deemed savings values in the following table. Savings are provided for various rated input capacity ranges and weather stations.

[996] Baseline stratification rate is based on data collected in "Field Demonstration of High Efficiency Gas Heaters", prepared for Better Buildings Alliance, US. DOE, Jim Young, Navigant Consulting, 2014. The study also verifies that the proposed ceiling temperature can be maintained within 2-4°F of the setpoint.

[997] Use Typical Meteorological Year (TMY3) data from NREL.

[998] Typical infiltration rate assumed from Infiltration Modeling Guidelines for Commercial Building Energy Analysis, prepared for US. DOE by Pacific Northwestern National Laboratory, 2009.

[999] Roof and Wall Insulation R-values are based on ASHRAE 90.1- 2010. (Jim Young 2014) (K. Gowri 2009).

[1000] Based on DOE's Commercial Prototype Modeled Warehouse building (in Chicago), via the Building Energy Codes Program.

Cap_{eff} (MBtu/hr)	Average Cap_{eff} (MBtu/hr)	Nearest Weather Station	ΔTherms (Baseline: Steam Fired Unit Heaters)	ΔTherms (Baseline: Gas Fired Unit Heaters)	ΔTherms (Baseline: Rooftop Units)
$300 < Cap_{eff} \leq 500$	400	Rockford	3,120	1,996	1,620
$500 < Cap_{eff} \leq 900$	757	Rockford	5,208	3,346	2,725
$900 < Cap_{eff} \leq 1{,}000$	950	Rockford	6,280	4,047	3,297
$1{,}000 < Cap_{eff} \leq 1{,}400$	1,200	Rockford	7,656	4,932	4,020
$1{,}400 < Cap_{eff} \leq 1{,}600$	1,499	Rockford	9,249	5,966	4,872
$1{,}600 < Cap_{eff} \leq 2{,}100$	1,850	Rockford	11,100	7,160	5,865
$2{,}100 < Cap_{eff} \leq 2{,}400$	2,200	Rockford	12,914	8,338	6,820
$2{,}400 \leq Cap_{eff}$	2,718	Rockford	15,547	10,084	8,236
$300 < Cap_{eff} \leq 500$	400	Chicago	2,820	1,824	1,488
$500 < Cap_{eff} \leq 900$	757	Chicago	4,709	3,058	2,506
$900 < Cap_{eff} \leq 1{,}000$	950	Chicago	5,681	3,696	3,031
$1{,}000 < Cap_{eff} \leq 1{,}400$	1,200	Chicago	6,924	4,512	3,696
$1{,}400 < Cap_{eff} \leq 1{,}600$	1,499	Chicago	8,364	5,456	4,482
$1{,}600 < Cap_{eff} \leq 2{,}100$	1,850	Chicago	10,046	6,549	5,384
$2{,}100 < Cap_{eff} \leq 2{,}400$	2,200	Chicago	11,682	7,634	6,292
$2{,}400 \leq Cap_{eff}$	2,718	Chicago	14,079	9,214	7,583
$300 < Cap_{eff} \leq 500$	400	Springfield	2,452	1,588	1,300
$500 < Cap_{eff} \leq 900$	757	Springfield	4,095	2,665	2,188
$900 < Cap_{eff} \leq 1{,}000$	950	Springfield	4,950	3,221	2,651
$1{,}000 < Cap_{eff} \leq 1{,}400$	1,200	Springfield	6,024	3,936	3,240
$1{,}400 < Cap_{eff} \leq 1{,}600$	1,499	Springfield	7,285	4,767	3,912
$1{,}600 < Cap_{eff} \leq 2{,}100$	1,850	Springfield	8,732	5,717	4,718
$2{,}100 < Cap_{eff} \leq 2{,}400$	2,200	Springfield	10,164	6,666	5,500
$2{,}400 \leq Cap_{eff}$	2,718	Springfield	12,258	8,045	6,632
$300 < Cap_{eff} \leq 500$	400	Belleville	2,456	1,604	1,320
$500 < Cap_{eff} \leq 900$	757	Belleville	4,103	2,687	2,218
$900 < Cap_{eff} \leq 1{,}000$	950	Belleville	4,950	3,249	2,689
$1{,}000 < Cap_{eff} \leq 1{,}400$	1,200	Belleville	6,036	3,972	3,276
$1{,}400 < Cap_{eff} \leq 1{,}600$	1,499	Belleville	7,300	4,812	3,972
$1{,}600 < Cap_{eff} \leq 2{,}100$	1,850	Belleville	8,751	5,772	4,773
$2{,}100 < Cap_{eff} \leq 2{,}400$	2,200	Belleville	10,186	6,732	5,566
$2{,}400 \leq Cap_{eff}$	2,718	Belleville	12,285	8,127	6,713
$300 < Cap_{eff} \leq 500$	400	Marion	2,180	1,444	1,200
$500 < Cap_{eff} \leq 900$	757	Marion	3,649	2,430	2,021
$900 < Cap_{eff} \leq 1{,}000$	950	Marion	4,408	2,936	2,442
$1{,}000 < Cap_{eff} \leq 1{,}400$	1,200	Marion	5,364	3,576	2,988
$1{,}400 < Cap_{eff} \leq 1{,}600$	1,499	Marion	6,491	4,332	3,613
$1{,}600 < Cap_{eff} \leq 2{,}100$	1,850	Marion	7,789	5,217	4,348
$2{,}100 < Cap_{eff} \leq 2{,}400$	2,200	Marion	9,064	6,072	5,082
$2{,}400 \leq Cap_{eff}$	2,718	Marion	10,926	7,339	6,116

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-HTHV-V02-230101

REVIEW DEADLINE: 1/1/2028

4.4.40 Gas High Efficiency Single Package Vertical Air Conditioner

DESCRIPTION

This measure covers the installation of a single package vertical air conditioner (SPVAC) with a high efficiency gas furnace, referred to here as a through-the-wall (TTW) condensing gas furnace instead of a standard efficiency gas furnace. The primary market served by TTWs are multifamily housing and hospitality in a new construction application. High efficiency gas furnaces achieve savings through the utilization of a sealed, super insulated combustion chamber, more efficient burners, and multiple heat exchangers that remove a significant portion of the waste heat from the flue gases. Because multiple heat exchangers are used to remove waste heat from the escaping flue gases, most of the flue gases condense and must be drained. Management of the acidic condensate is currently a major limiting factor for retrofit application, making the new construction the best initial market point until the industry develops better strategies for condensate management for retrofit applications. Also, TTWs are normally installed at the exterior wall to access outside air to reject heat in the cooling cycle. Placement of TTWs near the exterior might be prohibitive in retrofit applications. Furnaces equipped with ECM fan motors and with above code EER ratings provide an opportunity for additional electric energy savings.

This measure assumes a unit size less than or equal to 65,000 Btu/hr.

This measure was developed to be applicable to the following program types: NC, TOS. If applied to other program types such as RF, the measure savings should be verified via a custom measure.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a TTW condensing system with a code minimum 11.0 EER cooling system and a high-efficiency gas furnace with an annual fuel utilization efficiency (AFUE) of 90% or greater.[1001] Fan electrical efficiency must exceed the program requirements.

DEFINITION OF BASELINE EQUIPMENT

Baseline equipment for this measure are units with a cooling system that meets the current code minimum 11.0 EER efficiency rating and a heating unit with an AFUE rating of 80% or less.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16.5 years.[1002]

DEEMED MEASURE COST

The incremental capital cost for this measure depends on efficiency as listed below:[1003]

AFUE	Incremental Cost Premium
80%	$400
90%	$400
95%	$500

LOADSHAPE

Loadshape R08 – Residential Cooling

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits. The second represents the average savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market.

CF_{SSP} = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)

[1001] Electronic Code of Federal Regulations: 10 CFR 431.97, last modified on September 23, 2019.
[1002] Average of 15-18 year lifetime estimate made by the Consortium for Energy Efficiency in 2010.
[1003] Based on discussion with TTW Manufacturers at AHR 2018 Show in Chicago, IL.

= 68%[1004]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)

= 46.6%[1005]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Electric savings come from a high efficiency cooling unit.[1006] In some instances, the TTW unit provided by the manufacturer may not have higher efficiency cooling and fan blower motor systems integrated into the TTW design; in these cases, electric energy savings will be zero for those components.

$$\Delta kWh_{EER} = FLH_{cool} * Capacity * (1/EER_{base} - 1/EER_{eff}) / 1000$$

Where:

FLH_{cool} = Full load hours for cooling:[1007]

Climate Zone (City based upon)	FLH_{cool} (multifamily)
1 (Rockford)	499
2 (Chicago)	629
3 (Springfield)	707
4 (Belleville)	982
5 (Marion)	868
Weighted Average	655

Capacity = Cooling capacity of the efficient unit in Btu/hr

= Actual installed

EER_{eff} = Energy efficiency ratio of the efficient equipment

= Actual installed rating

EER_{base} = Energy efficiency ratio of the baseline equipment[1008]

= 11.0

For example, for a Rockford non-weatherized multifamily unit conditioned by a SPVAC with a 2-ton (24,000 Btu/hr) cooling capacity, a rated EER of 13.0, and an ECM fan blower motor installed.

ΔkWh = [499 * 24,000 * (1/11.0 – 1/13.0) / 1,000] = 167 kWh

[1004] Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.
[1005] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.
[1006] If an ECM motor in the packaged system is present, savings should be claimed for this measure by referring to the Residential Furnace Blower Motor measure in the IL TRM.
[1007] Consistent with multifamily assumptions from Residential Volume. Full load hours for Chicago, Moline, and Rockford are provided in "Final Evaluation Report: Central Air Conditioning Efficiency Services (CACES), 2010, Navigant Consulting", p.33. An average FLH/Cooling Degree Day (from NCDC) ratio was calculated for these locations and applied to the CDD of the other locations to estimate FLH. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.
[1008] Electronic Code of Federal Regulations: 10 CFR 431.97, last modified on September 23, 2019.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = CF * Capacity * (1/EER_{base} - 1/EER_{eff}) / 1{,}000$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Central A/C (during utility peak hour)

= 68%[1009]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Central A/C (average during PJM peak period)

= 46.6%[1010]

FOSSIL FUEL SAVINGS

$$\Delta Therms = EFLH_{heat} * Capacity * (AFUE_{eff} - AFUE_{base}) / AFUE_{base} / 100{,}000$$

Where:

$EFLH_{heat}$ = Equivalent Full Load Hours for heating:

Climate Zone (City based upon)	$EFLH_{heat}$ (general multifamily)
1 (Rockford)	1,924
2 (Chicago)	1,726
3 (Springfield)	1,708
4 (Belleville)	1,195
5 (Marion)	1,270

Capacity = Nominal heating input capacity furnace size (Btu/hr) for efficient unit

= Actual

$AFUE_{eff}$ = Efficient furnace annual fuel utilization efficiency rating

= Actual installed rating

$AFUE_{base}$ = Baseline furnace annual fuel utilization efficiency rating

= 80%

100,000 = Btu/Therm

For example, for a Chicago non-weatherized multifamily unit heated by an SPVAC with a 40 kBtu/hr capacity and a rated AFUE of 93%.

ΔTherms = 1,726 * 40,000 * [(0.93 – 0.8) / 0.8] / 100,000

= 112 therms

[1009] Based on metering of 24 homes with central AC during PY4 and PY5 in Ameren Illinois service territory.

[1010] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1011] Consistent with multifamily assumptions from Residential Volume. Full load heating hours for heat pumps are provided for Rockford, Chicago and Springfield in the ENERGY STAR Calculator. Estimates for the other locations were calculated based on the FLH to Heating Degree Day (from NCDC) ratio. VEIC consider ENERGY STAR estimates to be high due to oversizing not being adequately addressed. Using average Illinois billing data (from ICC commerce Commission) VEIC estimated the average gas heating load and used this to estimate the average home heating output (using 83% average gas heat efficiency). Dividing this by a typical 36,000 Btu/hr ASHP gives an estimate of average ASHP FLH_heat of 1821 hours. We used the ratio of this value to the average of the locations using the ENERGY STAR data (1994 hours) to scale down the ENERGY STAR estimates. There is a county mapping table in Volume 1, Section 3.7 providing the appropriate city to use for each county of Illinois.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC -SPVA-V04-270101

REVIEW DEADLINE: 1/1/2030

4.4.41 Advanced Rooftop Controls (ARC)

DESCRIPTION

The Advanced Rooftop Controls (ARC) measure installs demand-controlled ventilation with optional supply-fan speed control via a variable-frequency drive or multi-speed motor to a single-zone, packaged HVAC unit with a functioning integrated economizer already installed. The demand-controlled ventilation modulates the outside air damper based on CO_2 concentration in the conditioned space. The supply-fan speed control options consist of setting the fan speed to 40% in ventilation mode and to 90% in heating and cooling modes, or of setting the fan speed to 40% in ventilation mode, to 75% in 1st stage heating and 1st stage cooling modes, and to 90% in 2nd stage heating and 2nd stage cooling modes. The measure results in fan, cooling, and heating savings compared to a baseline scenario of constant-volume, constant-ventilation operation typical of single-zone, packaged HVAC units. There are several off-the-shelf products available for the packaged HVAC unit market that support these control sequences, and the energy savings potential of these strategies has been studied and reported on.[1012]

Demand-controlled ventilation modulates the percentage of outside air that is delivered to a space and its occupants by controlling the position of the outside air damper. The outside air damper is set to the minimum position required for the space, and is opened further when CO_2 concentration in the conditioned space increases, which indicates an increase in occupancy. The damper also opens to provide 100% outside air cooling (i.e., the unit economizes) when conditions permit. This portion of the measure saves energy by reducing unnecessary heating and cooling of outside air. Demand-controlled ventilation can also be combined with the installation of a variable-frequency drive or a multi-speed motor on the supply fan. This drive is used to reduce the speed of the supply fan when the full design airflow is not required. When the unit is only providing ventilation air (i.e., not heating or cooling), the airflow is reduced substantially but not below the ASHRAE-required minimum ventilation rate. The flow for heating and cooling can also be reduced a small amount in most cases. Per the fan affinity laws, the reduction in flow correlates to a near cubic reduction in fan power. In these ways, this measure is able to achieve energy savings via reduced cooling, heating, and ventilation..

This measure is intended for commercial buildings served by single-zone, packaged HVAC units. For buildings not meeting this criteria, refer to measure 4.4.19 “Demand Controlled Ventilation”.

This measure was developed to be applicable to the following program types: RF, DI.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a single-zone, packaged HVAC unit (with an existing functional integrated economizer) that has been retrofitted with demand-controlled ventilation controls with optional supply-fan speed control via a variable-frequency drive.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a single-zone, packaged HVAC unit (with an existing functional integrated economizer) that lacks demand-controlled ventilation, and lacks supply fan speed control via a variable-frequency drive.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 10 years and based on the estimated life of a CO_2 sensor.[1013]

[1012] Katipamula, S., et al, “Advanced Rooftop Control (ARC) Retrofit: Field-Test Results”, Pacific Northwest National Laboratory, July 2013.

[1013] During conversations with vendors and Building Automation System (BAS) contractors, it was determined that sensors must be functional for up to 10 years. It is recommended that they are part of a normal preventive maintenance program in which calibration is an important part of extending useful life. Although they are not subject to mechanical failure, they do fall out of tolerance over time.

DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost below can be used.

Table 1 – Deemed Measure Cost Details

Measure	Material Cost	Labor Cost	Total Cost
CO2 sensor and RTU integration only[1014]	$278	$900	$1,178
CO2 sensor, RTU integration, and VFD or multi-speed motor [1015]	$2,079.10	$1,367.26	$3,446.36

LOADSHAPE

Commercial ventilation C23

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1016]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1017]

Algorithm

CALCULATION OF ENERGY SAVINGS

To determine the savings associated with the Advanced Rooftop Controls (ARC) measure we utilized the available IL TRM prototype eQuest models which were initially created by the Energy Center of Wisconsin[1018] but modified by VEIC in 2014 as part of the IL TRM v4.0 Equivalent Full Load Hours (EFLH) update. For each building type we used the most recent versions of the models for our baseline models (Assembly was not part of EFLH update). These models which were used are the most up-to-date versions and are readily available on the VEIC SharePoint site, under the TRM Reference Documents Section.

Upon examination of the ComEd building prototype models we found several of the baseline models did not have packaged single zone (PSZ) units. This measure is targeting packaged single zone HVAC systems. Therefore, as a basis for savings calculations, we chose only models that: 1) utilized PSZ HVAC systems, and 2) aligned with the small commercial building type applicable to this measure. Once the ComEd baseline models were selected, we determined several modifications were necessary to the prototype models in order to represent the baseline scenario for this measure:

1. Multistage PSZ HVAC System with Constant Volume Supply Fan
2. Optimized Economizer Controls by Climate Zone
    a. Economizer Changeover Type – Set to fixed Dry Bulb

[1014] CO2 Sensor costs - Business Energy Advisor | Demand-Controlled Ventilation (bizenergyadvisor.com), 2017. Average sensor cost used from list of eight different vendors and CO2 sensors. RTU integration costs assume high end of estimated range ($300-$900) for implementing DCV on a newer DCV-ready RTU with existing economizer.

[1015] VFD/multi-speed motor costs – RS Means, Q1 2026. Springfield, IL, material and labor cost to install 3hp 460V 3-phase VFD. 3hp is the assumed supply fan motor size on a 10-ton single-zone packaged rooftop unit.

[1016] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1017]Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1018] Energy Center of Wisconsin, ComEd Portfolio Modeling Report, July 30, 2010.

b. Economizer High-Limit Control Setpoints – Setpoints based on ASHRAE Climate Zones Fixed Dry Bulb Temperature recommendations.

c. Enable Integrated Operation – Allows economizer to operate simultaneously with mechanical cooling

Additionally, several the building prototype models were found to have supply fan total static pressure modeled inputs that seem excessive and atypical for packaged single zone rooftop units – these included convenience stores (5 in. wc), manufacturing facilities (5 in. wc), office low rises (5 in. wc), religious buildings (5 in. wc), and restaurants (5 in. wc). The remaining models had supply fan total static pressure inputs more in line with what we would expect to find for packaged single zone rooftop units, ranging from 1.3 to 2 in. wc. For each model having a supply fan total static pressure above 2 in. wc, model inputs were adjusted to set these to 2 in. wc. To implement the modifications shown above, changes were made to eQUEST keywords in the ComEd prototype models as shown in the following table. Hard-coded system capacities and supply airflows can be found in the attached "Advanced Rooftop Controls_End Use Analysis_IL TRM.xlsx" spreadsheet.

Table 2 – Prototype Modifications to eQuest Keywords

Component Adjusted	eQuest Keyword	IL TR Value	Modified Prototype Value
System - System Type	SYSTEM:TYPE	PSZ	PVVT
System - Airflow and Temperature Control	SYSTEM:AIR/TEMP-CONTROL	N/A	STAGED-VOLUME
System – Supply Fan Total Static Pressure	SYSTEM:SUPPLY-STATIC	Varies	If >2: 2 Else: IL TR Value
System - Cooling and Heating Capacities	SYSTEM:COOLING-CAPACITY SYSTEM:HEATING-CAPACITY	Auto-sized	Hard-coded (after retrieving auto-sized outputs)
System - Supply Fan Control	SYSTEM:FAN-CONTROL	Varies	CONSTANT-VOLUME
System - Supply Fan Ratios	SYSTEM:MIN-FLOW-RATIO SYSTEM:CMIN-FLOW-RATIO SYSTEM:HMIN-FLOW-RATIO SYSTEM:-MAX-FAN-RATIO	N/A	1
System - Supply Airflow	SYSTEM:SUPPLY-FLOW	Auto-sized	Hard-coded (after retrieving auto-sized outputs)
Economizer - Changeover Type	SYSTEM:OA-CONTROL	Fixed	Single Dry-Bulb
Economizer - Changeover Setpoint	SYSTEM-ECONO-LIMIT-T	Varies	ASHRAE 90.1-2013 – High-Limit Shutoff Control Settings: ASHRAE CLIMATE ZONE – 4A = 65°F ASHRAE CLIMATE ZONE – 5A = 70°F
Economizer - Integrated Operation	SYSTEM:ECONO-LOCKOUT	Yes	No

Further modifications were then made to these baseline models to simulate the following measure scenarios:

1. Demand-controlled ventilation (DCV) controls
2. DCV and supply fan variable frequency drive (VFD) with two fan speed modes

a. 40% fan speed for ventilating

b. 90% fan speed for heating and cooling

3. DCV and supply fan VFD with three fan speed modes

a. 40% fan speed for ventilating

b. 75% fan speed for 1st stage heating and cooling

c. 90% fan speed for 2nd and higher stage heating and cooling

The eQuest modifications from the baseline models to represent these measure scenarios are shown in the following table. Full modeled energy end use and savings summaries can be found in the attached "Advanced Rooftop Controls_End Use Analysis_IL TRM.xlsx" spreadsheet.

Table 3 – Baseline and Measure Scenario eQuest Keywords

Component Adjusted	eQuest Keyword	Baseline Value	Measure Scenario Values		
			1	2	3
System - Minimum Outside Air Control	SYSTEM:MIN-OA-METHOD	Fraction of Design Flow	DCV Return Sensor	DCV Return Sensor	DCV Return Sensor
System - Supply Airflow	SYSTEM:SUPPLY-FLOW	Hard-coded	1.0 × Hard-coded value	0.9 × Hard-coded value	0.9 × Hard-coded value
System - Supply Fan Control	SYSTEM:FAN-CONTROL	CONSTANT-VOLUME	CONSTANT-VOLUME	FAN-EIR-FPLR	FAN-EIR-FPLR
System - Supply Fan Ratios	SYSTEM:MIN-FLOW-RATIO	1	1	0.44*	0.44*
	SYSTEM:CMIN-FLOW-RATIO	1	1	1	0.83**
	SYSTEM:HMIN-FLOW-RATIO	1	1	1	0.83**
	SYSTEM:-MAX-FAN-RATIO	1	1	1	1

*Since the total supply flow is limited by 0.9 of the baseline, a value of 0.44 for the minimum flow ratio results in a 40% fan speed: 0.4/0.9=0.44

** Since the total supply flow is limited by 0.9 of the baseline, a value of 0.83 for the minimum heating/cooling flow ratios results in a 75% fan speed: 0.75/0.9=0.83

With these modifications in place each scenario was simulated in eQuest for each chosen IL TRM prototype building type across the five TRM climate zones. Whole building electric and gas savings were determined from the simulation output and are presented in the following sections. Electric savings have been normalized by cooling tons and heating savings by furnace kBtuh output.

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (Capacity_{Cool} \times Normalized\ Electric\ Cooling\ Energy\ Savings) + (Capacity_{Heat} \times Normalized\ Electric\ Heating\ Energy\ Savings)$$

Where:

$Capacity_{Cool}$ = capacity of the cooling equipment in tons (nominal tonnage may be used).

= Actual

Normalized Electric Cooling Energy Savings

= kWh/ton savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 4 – Electric Cooling Energy Savings Summary (kWh/ton)

Table 4 – Electric Cooling Energy Savings Summary (kWh/ton)

Building Type - IL TRM Prototype Model Name	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario: 1 - DCV 2 - DCV and VFD w/ 2-speed fan control 3 - DCV and VFD w/ 3-speed fan control														
	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	52.0	145.8	168.7	51.4	154.6	175.5	85.2	189.0	205.8	95.7	199.7	213.7	89.7	200.8	210.4
Assisted Living	8.0	574.4	604.7	8.8	580.5	605.5	14.7	578.2	598.7	15.6	589.1	609.4	16.5	600.9	615.5
College	49.7	410.8	448.4	54.1	410.4	442.0	106.5	464.1	490.9	139.1	514.3	537.0	158.7	511.9	526.3
Conditioned Storage	1.9	339.8	393.6	3.5	355.1	404.5	5.9	346.3	388.6	9.5	349.5	384.5	10.3	349.5	371.7
Convenience Store	46.4	918.9	984.1	49.9	921.0	977.0	82.3	955.1	1,000.2	86.9	996.3	1,035.0	103.7	998.3	1,022.7
Garage	14.8	479.7	578.9	19.2	482.9	573.6	25.9	510.4	586.3	48.4	570.1	640.3	53.0	589.0	648.7
Grocery	41.8	480.1	505.1	43.9	486.5	507.6	68.1	502.8	520.4	83.2	536.1	550.6	89.7	539.8	547.9
Manufacturing Facility	7.7	773.4	824.8	9.0	761.4	807.1	19.6	771.8	809.3	30.8	801.2	832.8	34.2	784.9	802.5
Office Low Rise	15.2	1,071.2	1,147.3	17.2	1,065.8	1,131.8	23.1	1,062.2	1,115.7	30.5	1,091.4	1,137.7	31.2	1,042.2	1,071.7
Religious Building	6.5	869.4	1,016.9	6.3	894.6	1,029.6	11.1	931.0	1,047.1	15.5	1,005.4	1,108.3	15.0	1,051.1	1,134.0
Restaurant	13.8	554.0	598.2	14.9	574.2	610.8	26.4	564.5	596.6	27.7	606.3	637.2	25.8	603.5	628.3
Retail Department Store	34.0	692.6	751.0	34.4	697.7	749.0	55.4	715.0	757.7	60.8	725.4	761.1	64.3	723.2	743.8
Retail Strip Mall	30.9	739.7	782.5	32.9	734.1	770.5	50.8	748.5	776.8	55.3	761.3	784.8	60.1	755.2	768.4

$Capacity_{Heat}$ = capacity of the heating equipment in tons (nominal tonnage may be used).

= Actual

Normalized Electric Heating Energy Savings

= kWh/ton savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 5 – Electric Energy Heating Savings Summary (kWh/ton)[1019]

[1019] Values for electric heat are based on converting the gas therm/kBtuh factors to electric kWh/ton factors factoring in the gas heating efficiencies used in the models and assuming a 2.3 COP heat pump. See 'ARC_ElectricHeatCalculation.xls' for calculation.

Table 5 – Electric Heating Energy Savings Summary (kWh/ton)

	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario: 1 - DCV 2 - DCV and VFD w/ 2-speed fan control 3 - DCV and VFD w/ 3-speed fan control														
Building Type	**1**	**2**	**3**	**1**	**2**	**3**	**1**	**2**	**3**	**1**	**2**	**3**	**1**	**2**	**3**
Assembly	868.6	893.1	893.1	868.6	893.1	893.1	746.3	795.2	783.0	734.0	783.0	770.7	734.0	807.4	795.2
Assisted Living	119.3	59.6	23.9	95.4	47.7	11.9	83.5	35.8	11.9	83.5	59.6	23.9	71.6	59.6	23.9
College	880.8	831.9	807.4	770.7	734.0	709.6	648.4	611.7	599.5	526.1	513.8	489.3	342.5	330.3	318.1
Conditioned Storage	305.8	171.3	146.8	269.1	134.6	110.1	244.7	110.1	85.6	232.4	97.9	73.4	183.5	48.9	36.7
Convenience Store	587.2	464.9	440.4	526.1	403.7	379.2	452.6	342.5	330.3	428.2	330.3	305.8	354.8	269.1	244.7
Garage	59.6	47.7	35.8	47.7	35.8	35.8	47.7	35.8	23.9	47.7	35.8	23.9	47.7	35.8	35.8
Grocery	894.6	835.0	811.1	799.2	739.5	727.6	703.7	656.0	632.2	632.2	596.4	584.5	489.0	453.3	441.3
Manufacturing Facility	59.6	47.7	35.8	47.7	35.8	35.8	47.7	35.8	23.9	35.8	23.9	23.9	23.9	23.9	23.9
Office - Low Rise	334.0	143.1	119.3	298.2	107.4	83.5	238.6	95.4	71.6	214.7	71.6	59.6	155.1	23.9	23.9
Religious Building	107.4	131.2	155.1	95.4	107.4	131.2	83.5	95.4	107.4	71.6	95.4	107.4	71.6	71.6	83.5
Restaurant	345.9	262.4	226.6	298.2	214.7	190.8	262.4	190.8	167.0	238.6	190.8	155.1	202.8	155.1	131.2
Retail - Department Store	298.2	178.9	167.0	274.3	155.1	131.2	238.6	131.2	119.3	214.7	131.2	107.4	178.9	107.4	95.4
Retail - Strip Mall	286.3	226.6	202.8	250.5	190.8	178.9	214.7	167.0	155.1	202.8	167.0	155.1	178.9	143.1	131.2

For example, a 10-ton rooftop heat pump on an office low rise building in Chicago installs DCV with 2-speed supply fan control (operating at 40% in ventilating mode and 90% in heating and cooling modes):

ΔkWh = ($Capacity_{Cool}$ × Normalized Electric Cooling Energy Savings) + ($Capacity_{Heat}$ × Normalized Electric Heating Energy Savings)

= (10 tons × 1,065.8 kWh/ton) + (10 tons × 107.4 kWh/ton)

= 11,732 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW_{SSP} = (tons) \times Normalized\ Electric\ Cooling\ Peak\ Demand\ Savings \times CF_{SSP}$$

$$\Delta kW_{PJM} = (tons) \times Normalized\ Electric\ Cooling\ Peak\ Demand\ Savings \times CF_{PJM}$$

Where:

tons = capacity of the cooling equipment in tons (nominal tonnage may be used).

= Actual

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1020]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1021]

Normalized Electric Peak Demand Savings

= kW/ton savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 6 – Electric Peak Demand Savings Summary (kW/ton)

Table 6 – Electric Peak Demand Savings Summary (kW/ton)

Building Type - IL TRM Prototype Model Name	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario: 1 - DCV 2 - DCV and VFD w/ 2-speed fan control 3 - DCV and VFD w/ 3-speed fan control														
	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	0.024	0.107	0.107	0.086	0.126	0.126	0.015	0.042	0.042	0.069	0.095	0.095	0.048	0.064	0.064
Assisted Living	0.021	0.116	0.116	0.021	0.075	0.075	0.018	0.086	0.086	0.021	0.092	0.092	0.024	0.081	0.081
College	0.007	0.207	0.207	0.007	0.090	0.090	0.006	0.179	0.179	0.005	0.132	0.132	0.009	0.074	0.074
Conditioned Storage	0.007	0.065	0.065	0.006	0.083	0.083	0.010	0.096	0.096	0.005	0.060	0.060	0.007	0.071	0.071
Convenience Store	0.047	0.369	0.369	0.053	0.394	0.394	0.042	0.395	0.395	0.017	0.356	0.356	0.067	0.390	0.390
Garage	0.012	0.054	0.054	0.011	0.053	0.053	0.011	0.053	0.053	0.011	0.068	0.068	0.007	0.061	0.061
Grocery	0.065	0.122	0.122	0.034	0.080	0.080	0.033	0.088	0.088	0.072	0.119	0.119	0.033	0.082	0.082
Manufacturing Facility	0.008	0.335	0.335	0.006	0.296	0.296	-0.003	0.283	0.283	0.000	0.333	0.333	0.049	0.376	0.376
Office Low Rise	0.011	0.395	0.395	0.009	0.346	0.346	0.007	0.366	0.366	0.011	0.384	0.384	0.029	0.385	0.385
Religious Building	0.000	0.462	0.465	0.000	0.406	0.409	0.000	0.461	0.461	0.000	0.456	0.457	0.000	0.464	0.467
Restaurant	0.030	0.231	0.231	0.034	0.162	0.162	0.023	0.113	0.113	0.033	0.134	0.134	0.006	0.069	0.069
Retail Department Store	0.057	0.152	0.152	0.042	0.120	0.120	0.029	0.099	0.099	0.029	0.113	0.113	0.066	0.149	0.149
Retail Strip Mall	0.046	0.171	0.171	0.046	0.191	0.191	0.042	0.189	0.189	0.020	0.158	0.158	0.066	0.178	0.178

For example, a 10-ton rooftop air conditioner on an office low rise building in Chicago installs DCV with 2-speed supply fan control (operating at 40% in ventilating mode and 90% in heating and cooling modes) using the Summer System Peak Coincidence Factor:

$$\Delta kW = (10\ tons) \times (0.346\ kW/ton) \times 91.3\%$$

$$= 3.159\ kW$$

[1020] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1021] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = (kBtuh\ output) \times Normalized\ Gas\ Energy\ Savings$$

Where:

kBtuh = heating output of the gas furnace in kBtuh

= Actual

Normalized Gas Energy Savings

= therms/kBtuh output savings value for the appropriate combination of building type, climate zone, and measure scenario per Table 7 – Gas Energy Savings Summary (therms/kBtuh output)

Table 7 – Gas Energy Savings Summary (therms/kBtuh output)

Building Type - IL TRM Prototype Model Name	Rockford - Zone 1			Chicago - Zone 2			Springfield - Zone 3			Mt Vernon/Belleville - Zone 4			Marion - Zone 5		
	Measure Scenario: 1 - DCV 2 - DCV and VFD w/ 2-speed fan control 3 - DCV and VFD w/ 3-speed fan control														
	1	2	3	1	2	3	1	2	3	1	2	3	1	2	3
Assembly	7.1	7.3	7.3	7.1	7.3	7.3	6.1	6.5	6.4	6.0	6.4	6.3	6.0	6.6	6.5
Assisted Living	1.0	0.5	0.2	0.8	0.4	0.1	0.7	0.3	0.1	0.7	0.5	0.2	0.6	0.5	0.2
College	7.2	6.8	6.6	6.3	6.0	5.8	5.3	5.0	4.9	4.3	4.2	4.0	2.8	2.7	2.6
Conditioned Storage	2.5	1.4	1.2	2.2	1.1	0.9	2.0	0.9	0.7	1.9	0.8	0.6	1.5	0.4	0.3
Convenience Store	4.8	3.8	3.6	4.3	3.3	3.1	3.7	2.8	2.7	3.5	2.7	2.5	2.9	2.2	2.0
Garage	0.5	0.4	0.3	0.4	0.3	0.3	0.4	0.3	0.2	0.4	0.3	0.2	0.4	0.3	0.3
Grocery	7.5	7.0	6.8	6.7	6.2	6.1	5.9	5.5	5.3	5.3	5.0	4.9	4.1	3.8	3.7
Manufacturing Facility	0.5	0.4	0.3	0.4	0.3	0.3	0.4	0.3	0.2	0.3	0.2	0.2	0.2	0.2	0.2
Office Low Rise	2.8	1.2	1.0	2.5	0.9	0.7	2.0	0.8	0.6	1.8	0.6	0.5	1.3	0.2	0.2
Religious Building	0.9	1.1	1.3	0.8	0.9	1.1	0.7	0.8	0.9	0.6	0.8	0.9	0.6	0.6	0.7
Restaurant	2.9	2.2	1.9	2.5	1.8	1.6	2.2	1.6	1.4	2.0	1.6	1.3	1.7	1.3	1.1
Retail Department Store	2.5	1.5	1.4	2.3	1.3	1.1	2.0	1.1	1.0	1.8	1.1	0.9	1.5	0.9	0.8
Retail Strip Mall	2.4	1.9	1.7	2.1	1.6	1.5	1.8	1.4	1.3	1.7	1.4	1.3	1.5	1.2	1.1

For example, a rooftop unit with a 148 kBtuh output gas furnace on an office low-rise building in Chicago installs DCV with 2-speed supply fan control (operating at 40% in ventilating mode and 90% in heating and cooling modes):

$\Delta\text{Therms} = (148\ kBtuh) \times (0.9\ therms/kBtuh\ output)$

$= 133.2\ therms$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-ARTC-V05-270101

REVIEW DEADLINE: 1/1/2030

4.4.42 Advanced Thermostats for Small Commercial – Retired 12/31/2019. Replaced with 4.4.48 Small Commercial Thermostats

4.4.43 Packaged RTU Sealing

DESCRIPTION

The HVAC Packaged RTU Sealing Measure targets areas of the RTU that are readily accessible and can be easily sealed. By sealing the following areas, the amount of uncontrolled infiltration will be reduced leading to increased occupant comfort and an overall reduction in energy use.

The measure seeks to target the following three areas for sealing.

1. Economizer Hood – Seal the interior and exterior seams that connect the economizer to the RTU using UL listed metal tape and/or silicone caulking.
2. RTU Curb – Seal supply and return duct seams inside of RTU with mastic along with any leaks that are found around the perimeter of the roof to RTU connection using UL listed metal tape and/or silicone caulking.
3. Non-Removable Cabinet Panels – Seal all cabinet seams that are not typically removed during basic service (i.e., control panel) using UL listed metal tape and/or silicone caulking.

Uncontrolled infiltration of non-conditioned outside air (OSA) is a known issue for packaged rooftop units (RTU). This leakage can occur through the curb, economizer assembly connection and cabinet panels. This leakage not only influences occupant comfort but also increases energy usage by increasing the heating and cooling loads while also reducing the unit's operating energy efficiency.

Prior to a laboratory and field study developed by Robert Mowris & Associates, Inc.,[1022] the energy effects of uncontrolled infiltration through cabinet leakage were difficult to quantify. However, this study determined that uncontrolled OSA infiltration not only increases the amount of energy to condition the excess air but also reduces the unit's operating efficiency (sensible EER) by 5.4%. By reducing the amount of uncontrolled OSA infiltration through RTU sealing the unit's operating efficiency (EER) can be increased reducing the amount of cooling energy. (Note: The referenced study quantifies improvements only from sealing the economizer hood – sealing the curb and non-access panels are recommended practice here but savings have not been quantified for these actions and may be in a future revision.)

This measure is only appropriate for packaged single zone rooftop units. Custom calculations are required for savings for built up air handling units or packaged multizone systems.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment condition is assumed to be a packaged HVAC system that has had the economizer hood, curb and non-access cabinet panels sealed.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment condition is assumed to be an operational packaged HVAC system that has not been previously sealed. The packaged HVAC systems must be single zone and must have a functioning economizer.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

Because the measure targets existing packaged RTU units, the deemed lifetime of the measure is assumed to be 5 years.[1023]

[1022] Robert Mowris & Associates, Inc., "Laboratory Test Results of Commercial Packaged HVAC Maintenance Faults," California Public Utilities Commission, Feb 15, 2016 page 203.
[1023] Assumed to be one third of effective useful life of an RTU (15 years).

DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost listed below can be used. The deemed measure costs are detailed for each individual RTU[1024].

Measure	Material Unit	Material Cost / Unit	Labor Unit (Hours)	Labor Rate / Unit	Total Cost
HVAC Packaged RTU Sealing	1	$49.69	1.5	$51.00	$126.19

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1025]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1026]

Algorithm

CALCULATION OF ENERGY SAVINGS

To determine the savings associated with the Packaged RTU Sealing measure available IL TRM prototype eQuest models, which were initially created by the Energy Center of Wisconsin[1027] but modified by VEIC in 2014 as part of the IL TRM v4.0 Equivalent Full Load Hours (EFLH) update, were utilized. For each building type we used the most recent versions of the models for our baseline models (Assembly was not part of EFLH update).

This measure is targeting packaged single zone HVAC systems. Therefore, as a basis for savings calculations, only models that had the following characteristics were chosen: 1) Packaged-Single Zone (PSZ) HVAC systems; and 2) aligned with the small commercial building type applicable to this measure. Several modifications to the models were necessary in order to simulate a functioning airside economizer, which is assumed to be present in the baseline scenario for this measure:

3) Optimized Economizer Controls by Climate Zone
a. Economizer Changeover Type – Set to fixed Dry Bulb
b. Economizer High-Limit Control Setpoints – Setpoints based on ASHRAE Climate Zones Fixed Dry Bulb Temperature recommendations.
c. Enable Integrated Operation – Allows economizer to operate simultaneously with mechanical cooling

To determine the energy use associated with an unsealed RTU, the prototype models were modified using the associated reduction in efficiency reported in a Robert Mowris and Associates, Inc. study that was performed for the California Public Utilities Commission in 2016.[1028] For further detail on the full modeled energy end use and savings summaries, see: "Packaged RTU Sealing_End Use Analysis_IL TRM 09042018.xlsx" spreadsheet.

After analyzing the modeled cooling annual energy usage for both the baseline (unsealed) and measure (sealed) model scenarios it was determined that the building type and climate zone variables had a minimal impact on the

[1024] Web retailer costs for sealing materials and RS Means open-shop labor cost for Chicago, IL for the year 2025. See reference document "Packaged RTU Sealing_End Use Analysis_IL TRM 05152025.xlsx"
[1025] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1026] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.
[1027] Energy Center of Wisconsin, ComEd Portfolio Modeling Report, July 30, 2010.
[1028] Robert Mowris & Associates, Inc., "Laboratory Test Results of Commercial Packaged HVAC Maintenance Faults," California Public Utilities Commission, Feb 15, 2016 Section 5.4.

overall energy savings associated with the measure. As a result, the overall average savings factor of 4.67% was deemed applicable for any small commercial building type across all climate zones. This single savings value used in conjunction with the energy and demand savings calculations listed in the following sections will allow the savings to be calculated based on the unit size and equivalent full load hours listed in the Illinois Technical Resource Manual (TRM).

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (kBtu/hr) \ / \ EER_{before} * EFLH_{cooling} * \%Savings$$

Where:

kBtu/hr = rated capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).

= Actual

EER_{before} = Energy Efficiency Ratio (EER) of the baseline equipment * distribution efficiency

=Actual (assume 95% distribution efficiency)

%Savings = Deemed savings percentage

= 4.67%[1029]

$EFLH_{cooling}$ = Equivalent Full Load Hours for cooling in Existing Buildings from section 4.4 HVAC End Use

For example, a 12 EER 5-ton rooftop air conditioner on a department store in Rockford receives packaged RTU sealing:

$$\Delta kWh = (5 * 12) \ / \ 12 * 639 * 4.67\%$$
$$= 149.2 \ kWh$$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kWssp = (kBtu/hr) \ / \ EER_{before} * \%Savings * CF_{SSP}$$

$$\Delta kWpjm = (kBtu/hr) \ / \ EER_{before} * \%Savings * CF_{PJM}$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1030]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1031]

[1029] The average cooling energy savings for all building types and climate zones, as determined by modeling 13 small commercial building types across 5 weather zones utilizing the prototype TRM eQuest models. For additional reference on the methodology and approach to the calculation of the deemed savings factor, see "Packaged RTU Sealing_End Use Analysis_IL TRM 2022.xlsx".

[1030] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1031] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Other variables as provided above

For example, a 12 EER 5-ton rooftop air conditioner using the Summer System Peak Coincidence Factor receives RTU sealing:

ΔkW = $(5 * 12) / 12 * 4.67\% * 91.3\%$

= $0.213\ kW$

FOSSIL FUEL SAVINGS

ΔTherm = $(kBtu/hr) / 100 / Efficiency_{before} * EFLH_{heating} * \%Savings$

Where:

kBtu/hr = rated capacity of the heating equipment actually installed in kBtu per hour

= Actual

100 = Converts kBtu/hr to Therms/hr

$Efficiency_{before}$ = Efficiency of the baseline equipment (rated) * distribution efficiency

= Actual (assuming 95% distribution efficiency)

%Savings = Deemed savings percentages by building type and climate zone are provided in the following table

Building Type	Savings Percentage				
	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Assembly	2.84%	2.86%	2.86%	2.98%	2.94%
Assisted Living	4.01%	4.15%	4.35%	4.64%	5.44%
College	3.86%	3.88%	3.97%	4.09%	5.10%
Conditioned Storage (Warehouse)	0.92%	0.90%	0.87%	1.00%	1.23%
Convenience Store	3.07%	3.20%	3.43%	3.70%	4.63%
Garage	0.20%	0.21%	0.22%	0.23%	0.29%
Grocery	3.38%	3.49%	3.60%	3.79%	4.57%
Manufacturing Facility	0.18%	0.16%	0.16%	0.16%	0.16%
Office - Low Rise	2.19%	2.23%	2.37%	2.46%	2.96%
Religious Building	0.28%	0.28%	0.30%	0.31%	0.37%
Restaurant	2.76%	2.83%	2.96%	3.11%	3.58%
Retail - Department Store	1.87%	1.91%	2.00%	2.14%	2.88%
Retail - Strip Mall	2.06%	2.12%	2.29%	2.46%	3.17%

$EFLH_{heating}$ = Equivalent Full Load Hours for heating in Existing Buildings from section 4.4 HVAC End Use

For example, a packaged RTU with an 80% efficient 150-kBtu/hr gas furnace on a department store in Rockford receives packaged RTU sealing:

ΔTherm = $(150 / 100) / 80\% * 1{,}365 * 1.87\%$

= $47.9\ Therms$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-PRTU-V03-260101

REVIEW DEADLINE: 1/1/2029

4.4.44 Commercial Ground Source and Ground Water Source Heat Pump

DESCRIPTION

This measure characterizes the installation of a Ground Source Heat Pump under the following scenarios:

A. New Construction:
   i. The installation of a new Ground Source Heat Pump system meeting ENERGY STAR[1032] efficiency standards presented below in a new C&I building.
   ii. Note the baseline in this case should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition.

B. Time of Sale:
   i. The planned installation of a new Ground Source Heat Pump system meeting ENERGY STAR efficiency standards presented below to replace an existing system(s) that does not meet the criteria for early replacement described in section C below.
   ii. Note the baseline in this case is an equivalent replacement system to that which exists currently in the building. Where unknown, the baseline should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, only an electric utility or only a gas utility.
   iii. DHW savings are calculated based upon the fuel type and efficiency of the existing unit.

C. Early Replacement/Retrofit:
   i. The early removal of functioning electric or gas space heating and/or cooling systems from service, prior to the natural end of life, and replacement with a new high efficiency Ground Source Heat Pump system.
   ii. Note the baseline in this case is the existing equipment being replaced. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, only an electric utility or only a gas utility. DHW savings are calculated based upon the fuel and efficiency of the existing unit.
   iii. Early Replacement determination will be based on meeting the following conditions:
      - The existing unit is operational when replaced, or
      - The existin unit requires minor repairs to be operational, defined as costing less than 20% of the new baseline replacement cost (as defined in the Measured Cost section of the relevant equipment).[1033]
      - All other conditions will be considered Time of Sale.

   The Baseline efficiency of the existing unit replaced:
      - Use actual existing efficiency whenever possible.
      - If the efficiency of the existing unit is unknown, use assumptions based on the federal minimum standards provided in tables below.
      - If the operational status or repair cost of the existing unit is unknown use time of sale assumptions.

The installation of the GSHP should meet the following design parameters to ensure a properly sized circulation pump. If the GSHP design does not meet the following parameters, a custom calculation should be performed to account for the motor energy consumed by the circulation pump. Optimal design parameters are:

- Circulation pump is included in the manufacturer assembly of the GSHP system
  Or;

[1032] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[1033] The Technical Advisory Committee agreed that if the cost of repair is less than 20% of the new baseline replacement cost (defined in the Measure Costs section), it can be considered early replacement.

- Circulation pump flow rate less than or equal to 3.0 GPM per system ton
- Variable flow controls on pumps serving systems greater than 10 tons. Variable flow controls include one of the following:
    - A variable speed system pump controlled from differential pressure and 2-way water flow control valves on each heat pump.
    - Individual on/off pumps on each heat pump controlled by heat pump demand. The heat pumps may be decoupled from the ground heat exchanger using a separate variable speed pump controlled by differential temperature across the ground loop.
- On/off or variable flow controls on pumps for systems less than 10 tons. On/off pump controls shall operate only when heat pump(s) are running.
- System pumping head less than 80 feet. For systems 10 tons or smaller system pumping head should not exceed 40 feet.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

For these products, the baseline equipment includes Air Conditioning, Space Heating and Domestic Hot Water Heating.

New Construction:

To calculate savings with an electric baseline, the baseline equipment is assumed to be an Air Source Heat Pump meeting the Federal Standard efficiency level as outlined in Table 2 (effective 1/1/2016 to 6/30/2019) or Table 7 (effective 7/1/2019 to 9/30/2022) or Table 12 (effective 10/1/2022) ; and a Federal Standard electric hot water heater efficiency level as outlined in Table 6 (effective 1/1/2016 to 6/30/2019) or Table 11 (effective 7/1/2019 to 9/30/2022) or Table 16 (effective 10/1/2022).

To calculate savings with a chiller/unitary cooling systems and boiler/furnace baseline, the baseline equipment is assumed to meet the minimum standard efficiencies as outlined in the Table 3 (effective 1/1/2016 to 6/30/2019) or Table 8 (effective 7/1/2019 to 9/30/2022) or Table 13 (effective 10/12022)

Tablefor chillers/unitary cooling systems, and Table 4 (effective 1/1/2016 to 6/30/2019) or Table 9 (effective 7/1/2019 to 9/30/2022) or Table 14 (effective 10/1/2022) for boilers or Table 5 (effective 1/1/2016 to 6/30/2019) or Table 10 (effective 7/1/2019 to 9/30/2022) or Table 15 (effective 10/1/2022) for furnaces. If a desuperheater is installed, the domestic hot water heater minimum standard efficiency is calculated as per Table 6 (effective 1/1/2016 to 6/30/2019) or Table 11 (effective 7/1/2019 to 9/30/2022) or Table 16 (effective 10/1/2022) below.

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. If evaluation determines the applicable version of code, given location and timing, isn't an appropriate baseline due to supply constraints, low compliance, or other issues, the previous iteration of code may be used through 2023.

IECC 202 and 2024 leverage new DOE testing methods and associated metrics. The following conversion factors are recommended for use if the efficient equipment is not rated under the new testing procedure but the stipulated baseline is:[1034]

SEER2 = X * SEER

EER2 = X * EER

HSPF2 = X * HSPF

Where:

X	SEER2	EER2	HSPF2
Ducted	0.95	0.95	0.85
Ductless	1.00	1.00	0.90
Packaged	0.95	0.95	0.84

[1034] Consortium for Energy Efficiency (CEE), Testing, Testing, M1, 2, 3, Transitioning to New Federal Minimum Standards, CEE Summer Program Meeting, June 10, 2022.

Table 2: IECC 2015 ASHP Minimum Efficiency Requirements (effective 1/1/2016 to 6/30/2019)**:**

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY		TEST PROCEDURE[a]
				Before 1/1/2016	As of 1/1/2016	
Air cooled (cooling mode)	< 65,000 Btu/h[b]	All	Split System	13.0 SEER[c]	14.0 SEER[c]	AHRI 210/240
			Single Package	13.0 SEER[c]	14.0 SEER[c]	
Through-the-wall, air cooled	≤ 30,000 Btu/h[b]	All	Split System	12.0 SEER	12.0 SEER	
			Single Package	12.0 SEER	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 11.2 IEER	11.0 EER 12.0 IEER	AHRI 340/360
		All other	Split System and Single Package	10.8 EER 11.0 IEER	10.8 EER 11.8 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 10.7 IEER	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 10.5 IEER	10.4 EER 11.4 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 9.6 IEER	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	9.3 EER 9.4 IEER	
Air cooled (heating mode)	< 65,000 Btu/h[b]	—	Split System	7.7 HSPF[c]	8.2 HSPF[c]	AHRI 210/240
		—	Single Package	7.7 HSPF[c]	8.0 HSPF[c]	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h[b] (cooling capacity)	—	Split System	7.4 HSPF	7.4 HSPF	
		—	Single Package	7.4 HSPF	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h[b]	—	Split System	6.8 HSPF	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	3.3 COP	AHRI 340/360
			17°Fdb/15°F wb outdoor air	2.25 COP	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	3.2 COP	
			17°Fdb/15°F wb outdoor air	2.05 COP	2.05 COP	

Table 3: IECC 2015 Electric Chillers, Air-Cooled and Water-Cooled minimum efficiencies (effective 1/1/2016 to 6/30/2019)

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE[c]
			Path A	Path B	Path A	Path B	
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA[c]	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15,800 IPLV	
	≥ 150 Tons		≥ 9.562 FL	NA[c]	≥ 10.100 FL	≥ 9.700 FL	
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.				
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL	
			≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV	
	≥ 75 tons and < 150 tons		≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.615 IPLV	≤ 0.586 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV	
	≥ 150 tons and < 300 tons		≥ 0.680 FL	≥ 0.718 FL	≥ 0.660 FL	≥ 0.680 FL	
			≥ 0.580 IPLV	≥ 0.540 IPLV	≥ 0.540 IPLV	≥ 0.440 IPLV	
	≥ 300 tons and < 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV	
	≥ 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
Water cooled, electrically operated centrifugal	< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV	
	≥ 150 tons and < 300 tons		≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.400 IPLV	
	≥ 300 tons and < 400 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.520 IPLV	≤ 0.390 IPLV	
	≥ 400 tons and < 600 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
	≥ 600 Tons		≤ 0.570 FL	≤ 0.590 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.539 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
Air cooled, absorption, single effect	All capacities	COP	≥ 0.600 FL	NA[c]	≥ 0.600 FL	NA[c]	AHRI 560
Water cooled absorption, single effect	All capacities	COP	≥ 0.700 FL	NA[c]	≥ 0.700 FL	NA[c]	
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA[c]	≥ 1.000 FL	NA[c]	
			≥ 1.050 IPLV		≥ 1.050 IPLV		
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA[c]	≥ 1.000 FL	NA[c]	
			≥ 1.000 IPLV		≥ 1.050 IPLV		

Table 4: IECC 2015 Boiler minimum efficiency requirements (effective 1/1/2016 to 6/30/2019)

EQUIPMENT TYPE[a]	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY[d, e]	TEST PROCEDURE
Boilers, hot water	Gas-fired	< 300,000 Btu/h	80% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	80% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	82% E_c	
	Oil-fired[c]	< 300,000 Btu/h	80% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	82% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	84% E_c	
Boilers, steam	Gas-fired	< 300,000 Btu/h	75% AFUE	10 CFR Part 430
	Gas-fired- all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	79% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	79% E_t	
	Gas-fired-natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	77% E_t	
		> 2,500,000 Btu/h[a]	77% E_t	
	Oil-fired[c]	< 300,000 Btu/h	80% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	81% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	81% E_t	

Table 5: IECC 2015 Warm-air Furnace minimum efficiency standards (effective 1/1/2016 to 6/30/2019)

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY[d, e]	TEST PROCEDURE[a]
Warm-air furnaces, gas fired	< 225,000 Btu/h	—	78% AFUE or 80%E_t[c]	DOE 10 CFR Part 430 or ANSI Z21.47
	≥ 225,000 Btu/h	Maximum capacity[c]	80%E_t[f]	ANSI Z21.47
Warm-air furnaces, oil fired	< 225,000 Btu/h	—	78% AFUE or 80%E_t[c]	DOE 10 CFR Part 430 or UL 727
	≥ 225,000 Btu/h	Maximum capacity[b]	81%E_t[g]	UL 727
Warm-air duct furnaces, gas fired	All capacities	Maximum capacity[b]	80%E_c	ANSI Z83.8
Warm-air unit heaters, gas fired	All capacities	Maximum capacity[b]	80%E_c	ANSI Z83.8
Warm-air unit heaters, oil fired	All capacities	Maximum capacity[b]	80%E_c	UL 731

Table 6: IECC 2015 Water Heaters minimum performance (effective 1/1/2016 to 6/30/2019)

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED[a, b]	TEST PROCEDURE
Water heaters, electric	≤ 12 kW[d]	Resistance	0.97 - 0.00 132V, EF	DOE 10 CFR Part 430
	> 12 kW	Resistance	$(0.3 + 27/V_m)$, %/h	ANSI Z21.10.3
	≤ 24 amps and ≤ 250 volts	Heat pump	0.93 - 0.00 132*V*, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gal	0.67 - 0.0019*V*, EF	DOE 10 CFR Part 430
	> 75,000 Btu/h and ≤ 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t $(Q/800 + 110\sqrt{V})$SL, Btu/h	ANSI Z21.10.3
	> 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t $(Q/800 + 110\sqrt{V})$SL, Btu/h	
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h[c]	≥ 4,000 (Btu/h)/gal and < 2 gal	0.62 - 0.00 19V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E_t $(Q/800 + 110\sqrt{V})$SL, Btu/h	

Table 7: IECC 2018 ASHP Minimum Efficiency Requirements (effective 7/1/2019 to 9/30/2022)

TABLE C403.3.2(2)
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AND APPLIED HEAT PUMPS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 65,000 Btu/h[b]	All	Split System	14.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall, air cooled	≤ 30,000 Btu/h[b]	All	Split System	12.0 SEER	
			Single Package	12.0 SEER	
Single-duct high-velocity air cooled	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.0 IEER	AHRI 340/360
		All other	Split System and Single Package	10.8 EER 11.8 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.6 EER 11.6 IEER	
		All other	Split System and Single Package	10.4 EER 11.4 IEER	
	≥ 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.5 EER 10.6 IEER	
		All other	Split System and Single Package	9.3 EER 9.4 IEER	
Water to Air: Water Loop (cooling mode)	< 17,000 Btu/h	All	86°F entering water	12.2 EER	ISO 13256-1
	≥ 17,000 Btu/h and < 65,000 Btu/h	All	86°F entering water	13.0 EER	
	≥ 65,000 Btu/h and < 135,000 Btu/h	All	86°F entering water	13.0 EER	
Water to Air: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	18.0 EER	ISO 13256-1
Brine to Air: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering water	14.1 EER	ISO 13256-1
Water to Water: Water Loop (cooling mode)	< 135,000 Btu/h	All	86°F entering water	10.6 EER	ISO 13256-2
Water to Water: Ground Water (cooling mode)	< 135,000 Btu/h	All	59°F entering water	16.3 EER	
Brine to Water: Ground Loop (cooling mode)	< 135,000 Btu/h	All	77°F entering fluid	12.1 EER	

Table 7 continued:

Air cooled (heating mode)	< 65,000 Btu/h[b]	—	Split System	8.2 HSPF	AHRI 210/240
		—	Single Package	8.0 HSPF	
Through-the-wall, (air cooled, heating mode)	≤ 30,000 Btu/h[b] (cooling capacity)	—	Split System	7.4 HSPF	
		—	Single Package	7.4 HSPF	
Small-duct high velocity (air cooled, heating mode)	< 65,000 Btu/h[b]	—	Split System	6.8 HSPF	
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.3 COP	AHRI 340/360
			17°Fdb/15°F wb outdoor air	2.25 COP	
	≥ 135,000 Btu/h (cooling capacity)	—	47°F db/43°F wb outdoor air	3.2 COP	
			17°Fdb/15°F wb outdoor air	2.05 COP	
Water to Air: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	4.3 COP	ISO 13256-1
Water to Air: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.7 COP	
Brine to Air: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	3.2 COP	
Water to Water: Water Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	68°F entering water	3.7 COP	ISO 13256-2
Water to Water: Ground Water (heating mode)	< 135,000 Btu/h (cooling capacity)	—	50°F entering water	3.1 COP	
Brine to Water: Ground Loop (heating mode)	< 135,000 Btu/h (cooling capacity)	—	32°F entering fluid	2.5 COP	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = [(°F) - 32]/1.8.

a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.
b. Single-phase, air-cooled heat pumps less than 65,000 Btu/h are regulated by NAECA. SEER and HSPF values are those set by NAECA.

Table 8: IECC 2018 Electric Chillers, Air-Cooled and Water-Cooled minimum efficiencies (effective 7/1/2019 to 9/30/2022)

TABLE C403.3.2(7)
WATER CHILLING PACKAGES — EFFICIENCY REQUIREMENTS[a, b, d]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	BEFORE 1/1/2015		AS OF 1/1/2015		TEST PROCEDURE[c]
			Path A	Path B	Path A	Path B	
Air-cooled chillers	< 150 Tons	EER (Btu/W)	≥ 9.562 FL	NA[c]	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 12.500 IPLV		≥ 13.700 IPLV	≥ 15,800 IPLV	
	≥ 150 Tons		≥ 9.562 FL	NA[c]	≥ 10.100 FL	≥ 9.700 FL	
			≥ 12.500 IPLV		≥ 14.000 IPLV	≥ 16.100 IPLV	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/W)	Air-cooled chillers without condenser shall be rated with matching condensers and complying with air-cooled chiller efficiency requirements.				
Water cooled, electrically operated positive displacement	< 75 Tons	kW/ton	≤ 0.780 FL	≤ 0.800 FL	≤ 0.750 FL	≤ 0.780 FL	
			≤ 0.630 IPLV	≤ 0.600 IPLV	≤ 0.600 IPLV	≤ 0.500 IPLV	
	≥ 75 tons and < 150 tons		≤ 0.775 FL	≤ 0.790 FL	≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.615 IPLV	≤ 0.586 IPLV	≤ 0.560 IPLV	≤ 0.490 IPLV	
	≥ 150 tons and < 300 tons		≥ 0.680 FL	≥ 0.718 FL	≥ 0.660 FL	≥ 0.680 FL	
			≥ 0.580 IPLV	≥ 0.540 IPLV	≥ 0.540 IPLV	≥ 0.440 IPLV	
	≥ 300 tons and < 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.520 IPLV	≤ 0.410 IPLV	
	≥ 600 tons		≤ 0.620 FL	≤ 0.639 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.540 IPLV	≤ 0.490 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
Water cooled, electrically operated centrifugal	< 150 Tons	kW/ton	≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.695 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.440 IPLV	
	≥ 150 tons and < 300 tons		≤ 0.634 FL	≤ 0.639 FL	≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.596 IPLV	≤ 0.450 IPLV	≤ 0.550 IPLV	≤ 0.400 IPLV	
	≥ 300 tons and < 400 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.520 IPLV	≤ 0.390 IPLV	
	≥ 400 tons and < 600 tons		≤ 0.576 FL	≤ 0.600 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.549 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
	≥ 600 Tons		≤ 0.570 FL	≤ 0.590 FL	≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.539 IPLV	≤ 0.400 IPLV	≤ 0.500 IPLV	≤ 0.380 IPLV	
Air cooled, absorption, single effect	All capacities	COP	≥ 0.600 FL	NA[c]	≥ 0.600 FL	NA[c]	AHRI 560
Water cooled absorption, single effect	All capacities	COP	≥ 0.700 FL	NA[c]	≥ 0.700 FL	NA[c]	
Absorption, double effect, indirect fired	All capacities	COP	≥ 1.000 FL	NA[c]	≥ 1.000 FL	NA[c]	
			≥ 1.050 IPLV		≥ 1.050 IPLV		
Absorption double effect direct fired	All capacities	COP	≥ 1.000 FL	NA[c]	≥ 1.000 FL	NA[c]	
			≥ 1.000 IPLV		≥ 1.050 IPLV		

Table 9: IECC 2018 Boiler minimum efficiency requirements (effective 7/1/2019 to 9/30/2022)

Note Code of Federal Regulations for gas -fired hot water boilers manufactured after January 15, 2021 require <300,000Btuh hot water boilers to be 84% AFUE and <300,000 Btuh steam boilers to be 82% AFUE (10 CFR 432(e)(3)). This should be assumed baseline from 1/1/2022.

TABLE C403.3.2(5)
MINIMUM EFFICIENCY REQUIREMENTS: GAS- AND OIL-FIRED BOILERS

EQUIPMENT TYPE[a]	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY[d, e]	TEST PROCEDURE
Boilers, hot water	Gas-fired	< 300,000 Btu/h[f, g]	82% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	80% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	82% E_c	
	Oil-fired[c]	< 300,000 Btu/h[g]	84% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	82% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	84% E_c	
Boilers, steam	Gas-fired	< 300,000 Btu/h[f]	80% AFUE	10 CFR Part 430
	Gas-fired- all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	79% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	79% E_t	
	Gas-fired-natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	77% E_t	
		> 2,500,000 Btu/h[a]	77% E_t	
	Oil-fired[c]	< 300,000 Btu/h	82% AFUE	10 CFR Part 430
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[b]	81% E_t	10 CFR Part 431
		> 2,500,000 Btu/h[a]	81% E_t	

Table 10: IECC 2018 Warm-air Furnace minimum efficiency standards (effective 7/1/2019 to 9/30/2022)

TABLE C403.3.2(4)
WARM-AIR FURNACES AND COMBINATION WARM-AIR FURNACES/AIR-CONDITIONING UNITS, WARM-AIR DUCT FURNACES AND UNIT HEATERS, MINIMUM EFFICIENCY REQUIREMENTS

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY[d, e]	TEST PROCEDURE[a]
Warm-air furnaces, gas fired	< 225,000 Btu/h	—	80% AFUE or 80%E_t^c	DOE 10 CFR Part 430 or ANSI Z21.47
	≥ 225,000 Btu/h	Maximum capacity[c]	80%E_t^f	ANSI Z21.47
Warm-air furnaces, oil fired	< 225,000 Btu/h	—	83% AFUE or 80%E_t^c	DOE 10 CFR Part 430 or UL 727
	≥ 225,000 Btu/h	Maximum capacity[b]	81%E_t^g	UL 727
Warm-air duct furnaces, gas fired	All capacities	Maximum capacity[b]	80%E_c	ANSI Z83.8
Warm-air unit heaters, gas fired	All capacities	Maximum capacity[b]	80%E_c	ANSI Z83.8
Warm-air unit heaters, oil fired	All capacities	Maximum capacity[b]	80%E_c	UL 731

Table 11: IECC 2018 Water Heaters minimum performance (effective 7/1/2019 to 9/30/2022)

TABLE C404.2
MINIMUM PERFORMANCE OF WATER-HEATING EQUIPMENT

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED[a, b]	TEST PROCEDURE
Water heaters, electric	≤ 12 kW[d]	Tabletop[e], ≥ 20 gallons and ≤ 120 gallons	0.93 - 0.00132*V*, EF	DOE 10 CFR Part 430
		Resistance ≥ 20 gallons and ≤ 55 gallons	0.960 - 0.0003*V*, EF	
		Grid-enabled[f] > 75 gallons and ≤ 120 gallons	1.061 - 0.00168V, EF	
	> 12 kW	Resistance	(0.3 + 27/V_m), %/h	ANSI Z21.10.3
	≤ 24 amps and ≤ 250 volts	Heat pump > 55 gallons and ≤ 120 gallons	2.057 - 0.00113V, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gallons and > 55 gallons	0.675 - 0.0015V, EF	DOE 10 CFR Part 430
		> 55 gallons and ≤ 100 gallons	0.8012 - 0.00078V, EF	
	> 75,000 Btu/h and ≤ 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	ANSI Z21.10.3
	> 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h[c]	≥ 4,000 (Btu/h)/gal and < 2 gal	0.82 - 0.00 19V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E_t	

Table 12: IECC 2021 ASHP Minimum Efficiency Requirements (expected to become effective statewide in 2023)

TABLE C403.3.2(2)
ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 66,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 14.3 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	
Space constrained, air cooled (cooling mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	
Single duct, high velocity, air cooled (cooling mode)	< 65,000	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 12.0 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	11.0 EER 12.2 IEER before 1/1/2023 14.1 IEER after 1/1/2023	AHRI 340/360
		All other		10.8 EER 12.0 IEER before 1/1/2023 13.9 IEER after 1/1/2023	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		10.6 EER 11.6 IEER before 1/1/2023 13.5 IEER after 1/1/2023	
		All other		10.4 EER 11.4 IEER before 1/1/2023 13.3 IEER after 1/1/2023	
	≥ 240,000 Btu/h	Electric resistance (or none)		9.5 EER 10.6 IEER before 1/1/2023 12.5 IEER after 1/1/2023	
		All other		9.3 EER 10.4 IEER before 1/1/2023 12.3 IEER after 1/1/2023	
Air cooled (heating mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	8.2 HSPF before 1/1/2023 7.5 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	8.0 HSPF before 1/1/2023 6.7 HSPF2 after 1/1/2023	

Table 12 continued:

TABLE C403.3.2(2)—continued
ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Space constrained, air cooled (heating mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	7.4 HSPF before 1/1/2023 6.3 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	7.4 HSPF before 1/1/2023 6.3 HSPF2 after 1/1/2023	
Small duct, high velocity, air cooled (heating mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	7.2 HSPF before 1/1/2023 6.1 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	All	47°F db/43°F wb outdoor air	3.30 COP_H before 1/1/2023 3.40 COP_H after 1/1/2023	AHRI 340/360
			17°F db/15°F wb outdoor air	2.25 COP_H	
	≥ 135,000 Btu/h and < 240,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H before 1/1/2023 3.30 SOP_H after 1/1/2023	
			17°F db/15°F wb outdoor air	2.05 COP_H	
	≥ 240,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	

Table 13: IECC 2021 Electric Chillers, Air-Cooled and Water-Cooled minimum efficiencies (expected to become effective statewide in 2023)

TABLE C403.3.2(3)
WATER-CHILLING PACKAGES—MINIMUM EFFICIENCY REQUIREMENTS[a, b, e, f]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	PATH A	PATH B	TEST PROCEDURE[c]
Air cooled chillers	< 150 tons	EER (Btu/Wh)	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 13.700 IPLV.IP	≥ 15.800 IPLV.IP	
	≥ 150 tons		≥ 10.100 FL	≥ 9.700FL	
			≥ 14.000 IPLV.IP	≥ 16.100 IPLV.IP	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/Wh)	Air-cooled chillers without condenser must be rated with matching condensers and comply with air-cooled chiller efficiency requirements		AHRI 550/590
Water cooled, electrically operated positive displacement	< 75 tons	kW/ton	≤ 0.750 FL	≤ 0.780 FL	AHRI 550/590
			≤ 0.600 IPLV.IP	≤ 0.500 IPLV.IP	
	≥ 75 tons and < 150 tons		≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.560 IPLV.IP	≤ 0.490 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.660 FL	≤ 0.680 FL	
			≤ 0.540 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 300 tons and < 600 tons		≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.520 IPLV.IP	≤ 0.410 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Water cooled, electrically operated centrifugal	< 150 tons	kW/ton	≤ 0.610 FL	≤ 0.695 FL	AHRI 550/590
			≤ 0.550 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.550 IPLV.IP	≤ 0.400 IPLV.IP	
	≥ 300 tons and < 400 tons		≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.520 IPLV.IP	≤ 0.390 IPLV.IP	
	≥ 400 tons and < 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Air cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.600 FL	NA[d]	AHRI 560
Water cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.700 FL	NA[d]	AHRI 560
Absorption double effect, indirect fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 0.150 IPLV.IP		
Absorption double effect, direct fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 1.000 IPLV		

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.
b. The requirements for centrifugal chillers shall be adjusted for nonstandard rating conditions per Section C403.3.2.1 and are applicable only for the range of conditions listed there. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.
c. Both the full-load and IPLV.IP requirements must be met or exceeded to comply with this standard. When there is a Path B, compliance can be with either Path A or Path B for any application.
d. NA means the requirements are not applicable for Path B, and only Path A can be used for compliance.
e. FL is the full-load performance requirements, and IPLV.IP is for the part-load performance requirements.
f. This table is a replica of ASHRAE 90.1 Table 6.8.1-3 Water-Chilling Packages—Minimum Efficiency Requirements.

Table 14: IECC 2021 Boiler minimum efficiency requirements (expected to become effective statewide in 2023)

Note Code of Federal Regulations for gas -fired hot water boilers manufactured after January 15, 2021 require <300,000 Btuh hot water boilers to be 84% AFUE and <300,000 Btuh steam boilers to be 82% AFUE (10 CFR 432(e)(3)). This should be assumed baseline from 1/1/2022.

TABLE C403.3.2(6)
GAS- AND OIL-FIRED BOILERS—MINIMUM EFFICIENCY REQUIREMENTS[i]

EQUIPMENT TYPE[b]	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY	EFFICIENCY AS OF 3/2/2022	TEST PROCEDURE[a]
Boilers, hot water	Gas fired	< 300,000 Btu/h[g, h] for applications outside US	82% AFUE	82% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	80% E_t[d]	80% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	82% E_c[c]	82% E_c[c]	
	Oil fired[f]	< 300,000 Btu/h[g, h] for applications outside US	84% AFUE	84% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	82% E_t[d]	82% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	84% E_c[c]	84% E_c[c]	
Boilers, steam	Gas fired	< 300,000 Btu/h[g] for applications outside US	80% AFUE	80% AFUE	DOE 10 CFR 430 Appendix N
	Gas fired—all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	79% E_t[d]	79% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	79% E_t[d]	79% E_t[d]	
	Gas fired—natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	77% E_t[d]	79% E_t[d]	
		> 2,500,000 Btu/h[b]	77% E_t[d]	79% E_t[d]	
	Oil fired[f]	< 300,000 Btu/h[g] for applications outside US	82% AFUE	82% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	81% E_t[d]	81% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	81% E_t[d]	81% E_t[d]	

Table 15: IECC 2021 Warm-air Furnace minimum efficiency standards (expected to become effective statewide in 2023)

TABLE C403.3.2(5)
WARM-AIR FURNACES AND COMBINATION WARM-AIR FURNACES/AIR-CONDITIONING UNITS, WARM-AIR DUCT FURNACES AND UNIT HEATERS—MINIMUM EFFICIENCY REQUIREMENTS[a]

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Warm-air furnace, gas fired for application outside the US	< 225,000 Btu/h	Maximum capacity[c]	80% AFUE (nonweatherized) or 81% AFUE (weatherized) or 80% E_t[b, d]	DOE 10 CFR 430 Appendix N or Section 2.39, Thermal Efficiency, ANSI Z21.47
Warm-air furnace, gas fired	< 225,000 Btu/h	Maximum capacity[c]	80% E_t[b, d] before 1/1/2023 81% E_t[d] after 1/1/2023	Section 2.39, Thermal Efficiency, ANSI Z21.47
Warm-air furnace, oil fired for application outside the US	< 225,000 Btu/h	Maximum capacity[c]	83% AFUE (nonweatherized) or 78% AFUE (weatherized) or 80% E_t[b, d]	DOE 10 CFR 430 Appendix N or Section 42, Combustion, UL 727
Warm-air furnace, oil fired	< 225,000 Btu/h	Maximum capacity[c]	80% E_t before 1/1/2023 82% E_t[d] after 1/1/2023	Section 42, Combustion, UL 727
Electric furnaces for applications outside the US	< 225,000 Btu/h	All	96% AFUE	DOE 10 CFR 430 Appendix N
Warm-air duct furnaces, gas fired	All capacities	Maximum capacity[c]	80% E_c[e]	Section 2.10, Efficiency, ANSI Z83.8
Warm-air unit heaters, gas fired	All capacities	Maximum capacity[c]	80% E_c[e, f]	Section 2.10, Efficiency, ANSI Z83.8
Warm-air unit heaters, oil fired	All capacities	Maximum capacity[c]	80% E_c[e, f]	Section 40, Combustion, UL 731

Table 16: IECC 2021 Water Heaters minimum performance (expected to become effective statewide in 2023)

TABLE C404.2
MINIMUM PERFORMANCE OF WATER-HEATING EQUIPMENT

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED[a, b]	TEST PROCEDURE
Water heaters, electric	≤ 12 kW[d]	Tabletop[e], ≥ 20 gallons and ≤ 120 gallons	0.93 – 0.00132*V*, EF	DOE 10 CFR Part 430
		Resistance ≥ 20 gallons and ≤ 55 gallons	0.960 – 0.0003*V*, EF	
		Grid-enabled[f] > 75 gallons and ≤ 120 gallons	1.061 – 0.00168V, EF	
	> 12 kW	Resistance	$(0.3 + 27/V_m)$, %/h	ANSI Z21.10.3
	≤ 24 amps and ≤ 250 volts	Heat pump > 55 gallons and ≤ 120 gallons	2.057 – 0.00113V, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gallons and > 55 gallons	0.675 – 0.0015V, EF	DOE 10 CFR Part 430
		> 55 gallons and ≤ 100 gallons	0.8012 – 0.00078V, EF	
	> 75,000 Btu/h and ≤ 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	ANSI Z21.10.3
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	
	> 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h[c]	≥ 4,000 Btu/h/gal and < 2 gal	0.82 – 0.00 19V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E_t	
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	
Storage water heaters, oil	≤ 105,000 Btu/h	≥ 20 gal and ≤ 50 gallons	0.68 – 0.0019V, EF	DOE 10 CFR Part 430
	≥ 105,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	ANSI Z21.10.3
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	
Instantaneous water heaters, oil	≤ 210,000 Btu/h	≥ 4,000 Btu/h/gal and < 2 gal	0.59 – 0.0019V, EF	DOE 10 CFR Part 430
	> 210,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
	> 210,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	78% E_t	
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	
Hot water supply boilers, gas and oil	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
Hot water supply boilers, gas	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E_t	
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	
Hot water supply boilers, oil	> 300,000 Btu/h and < 12,500,000 Btu/h	> 4,000 Btu/h/gal and > 10 gal	78% E_t	
			$(Q/800 + 110\sqrt{V})$SL, Btu/h	

Time of Sale: The baseline for this measure is a new replacement unit of the same system type as the existing unit, meeting the minimum standard efficiencies provided above.

Early replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating, cooling and hot water equipment for the assumed remaining useful life of the existing unit, and a new baseline heating and cooling system for the remainder of the measure life (as provided in table above).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of the ground source heat pump is assumed to be 25 years.[1035]

The expected measure life of the ground loop field is assumed to be 50 years.[1036]

For early replacement, the remaining life of existing equipment is assumed to be 6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers, chillers and GSHP,[1037] and 25 years for electric resistance.[1038]

DEEMED MEASURE COST

New Construction and Time of Sale: Incremental costs of the Ground Source Heat Pump should be used. This would be the actual installed cost of the Ground Source Heat Pump, well drilling, building retrofit, and system commissioning costs (default of $10,923/ton),[1039] minus the assumed installation cost of the baseline equipment (See table below for ASHP,[1040] or $12.43/kBtu capacity for a new baseline efficient furnace or $19.33/kBtu capacity for a new efficient steam boiler or $21.27/kBtu capacity for a new efficient hot water boiler,[1041] and $1,539/ton for new baseline chiller replacement[1042]).

Equipment Type	Capacity Range	Incremental Cost per Ton
Centrally Ducted Air Source Heat Pumps	< 2 tons	$88
	≥ 2 to < 3 tons	$70
	≥ 3 to < 4 tons	$59
	≥ 4 tons	$57

Early Replacement: The actual installed cost of the Ground Source Heat Pump should be used (default cost for total system retrofit provided above). The assumed deferred cost (after the appropriate number of years described above in the 'Deemed Lifetime of Efficient Equipment' section) of replacing existing equipment with a new baseline unit is presented in the table below for a new baseline Air Source Heat Pump, or is assumed to be $14.55/kBtu capacity for a new baseline efficient furnace or $23.15/kBtu capacity for a new efficient steam boiler or $25.47/kBtu capacity for a new efficient hot water boiler and $1,843/ton for new baseline chiller replacement[1043]. This future cost should be discounted to present value using the nominal societal discount rate.

[1035] System life of indoor components as per US DOE estimates from the Office of Energy Efficiency & Renewable Energy. The ground loop has a much longer life, but the compressor and other mechanical components are the same as an ASHP.
[1036] U.S. DOE Office of Energy Efficiency & Renewable Energy, Energy Saver details and descriptions for Geothermal Heat Pumps
[1037] Assumed to be one third of effective useful life of replaced equipment.
[1038] Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.
[1039] Average calculated based on reviewing cost information received from Chicagoland GSHP installers.
[1040] In 2025, a working group was created to update costs for residential HVAC equipment. Heat Pump and Central Air Conditioning costs are based upon Ameren program data. Furnace and Boiler costs are based on Ameren, Nicor, People's Gas, and North Shore Gas program data. Baseline costs have been determined using ratios from Updated Buildings Sector Appliance and Equipment Costs and Efficiencies by Guidehouse and Leidos, prepared for the U.S. Energy Information Administration. See file "HVAC Costs – 071825_VEIC.xlsx" for more details.
[1041] Average calculated based on RSMeans Mechanical Cost Data 2015.
[1042] Average calculated based on RSMeans Mechanical Cost Data 2015 for Scroll, air cooled condenser chillers.
[1043] All baseline replacement costs are consistent with their respective measures and include inflation rate of 2.28%.

Equipment Type	Capacity Range	Deferred Baseline Cost per Ton[1044]
Centrally Ducted Air Source Heat Pumps	< 2 tons	$5,268
	≥ 2 to < 3 tons	$4,226
	≥ 3 to < 4 tons	$3,541
	≥ 4 tons	$3,425

LOADSHAPE

Loadshape C04 – Commercial Electric Heating (if replacing building with no existing cooling)

Loadshape C05 - Commercial Electric Heating and Cooling

Note for the purpose of cost effectiveness screening for a fuel switch scenario, the heating kWh increase and cooling kWh decrease should be calculated separately such that the appropriate loadshape (i.e., Loadshape C04 - Commercial Electric Heating and Loadshape C03 – Commercial Cooling respectively) can be applied.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1045]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1046]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS AND FOSSIL FUEL SAVINGS

Non-fuel switch measures:

$$\Delta kWh = [Cooling\ savings] + [Heating\ savings] + [DHW\ savings]$$

$$\text{Cooling Savings} = (Capacity_{cool} * EFLH_{Cool} * (1/EER2_{base} - 1/EER2_{GSHP}))/1000$$

$$\text{Heating Savings} = (Capacity_{Heat} * EFLH_{Heat} * (1/HSPF2_{base} - 1/(COP_{GSHP} * 3.412)))/1000$$

$$\text{DHW Savings} = Elec_{DHW} * (\%DHW * ((1/EF_{elecbase}) * HotWaterUse_{Gallon} * \gamma Water * (Tout - Tin) * 1/3412))$$

[1044] In 2025, a working group was created to update costs for residential HVAC equipment. Heat Pump and Central Air Conditioning costs are based upon Ameren program data. Furnace and Boiler costs are based on Ameren, Nicor, People's Gas, and North Shore Gas program data. Baseline costs have been determined using ratios from Updated Buildings Sector Appliance and Equipment Costs and Efficiencies by Guidehouse and Leidos, prepared for the U.S. Energy Information Administration. See file "HVAC Costs – 071825_VEIC.xlsx" for more details.

[1045] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1046] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Fuel switch measures:

Fuel switch measures must produce positive total lifecycle energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

SiteEnergySavings (MMBTUs) = $FuelSwitchSavings + NonFuelSwitchSavings$

FuelSwitchSavings = $GasHeatReplaced - GSHPSiteHeatConsumed$

NonFuelSwitchSavings = $FurnaceFanSavings + GSHPSiteCoolingImpact + GSHPSiteWaterImpact$

GasHeatReplaced = $(HeatLoad * 1/AFUE_{base})$ / 1,000,000

FurnaceFanSavings =$(FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_e)$ / 1,000,000

GSHPSiteHeatConsumed = $(HeatLoad * 1/COP_{GSHP})$/ 1,000,000

GSHPSiteCoolingImpact = $(EFLH_{cool} * Capacity_{Cool} * (1/EER2_{base} - 1/EER2_{GSHP})/1000 * 3412)$/ 1,000,000

GSHPSiteWaterImpact$_{Gas}$ = $(\%DHWDisplaced * ((1/EF_{Gas} * GPD * Household * 365.25 * \gamma Water * (T_{OUT} - T_{in}) * 1.0)$ / 1,000,000

GSHPSiteWaterImpact$_{Electric}$ = $(\%DHWDisplaced * ((1/EF_{Elec} * GPD * Household * 365.25 * \gamma Water * (T_{OUT} - T_{in}) * 1.0)$/ 1,000,000

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure supported by:	Electric Utility claims (kWh):	Gas Utility claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Note for Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 6 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

Capacity$_{cool}$ = Cooling Output Capacity of Ground Source Heat Pump (Btu/hr)
= Actual installed

EFLH$_{cool}$ = Cooling Equivalent Full Load Hours
Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use

$EER2_{Base}$ = Energy Efficiency Ratio (EER2) of existing cooling unit (kBtu/hr / kW).
For early replacement, use actual EER2 rating for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 8 years for GSHP). If EER2 unknown but SEER2 available, convert using the equation:[1047] $EER2_{exist} = (-0.02 * SEER2_{exist}^2) + (1.12 * SEER2_{exist})$.

For TOS, NC, and the remaining measure life of early replacement, use minimum standard efficiencies as specified in tables in 'Definition of Baseline Equipment' section.

$EER2_{GSHP}$ = Part Load Energy Efficiency Ratio efficiency of efficient GSHP unit[1048]
= Actual installed

HeatLoad = Calculated heat load for the building

$= EFLH_{Heat} * Capacity_{Heat}$

$Capacity_{Heat}$ = Heating Output Capacity of Ground Source Heat Pump (Btu/hr)
= Actual installed

$EFLH_{Heat}$ = Heating Equivalent Full Load Hours of heat pump
Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use

$HSPF2_{Base}$ = Heating System Performance Factor of baseline electric heating system (kBtu/kWh)
For early replacement, use actual HSPF2 rating for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 8 years for GSHP or 15 years for electric resistance). For electric resistance, assume 3.41.[1049].

For TOS, NC, and the remaining measure life of early replacement, use minimum standard efficiencies as specified in tables in 'Definition of Baseline Equipment' section.

COP_{GSHP} = Part Load Coefficient of Performance of efficient GSHP[1050]

= Actual installed

3.412 = Constant to convert the COP of the unit to the Heating Season Performance Factor (HSPF2)

$Elec_{DHW}$ = 1 if building has electric DHW
= 0 if building has non electric DHW
= 0 if one to one replacement of existing Ground Source Heat Pump

%DHW = Percentage of total DHW load that the GSHP will provide
= Actual if known
= If unknown and if desuperheater installed, assume 44%[1051]
= 0% if no desuperheater installed

$EF_{elecbase}$ = Energy Factor of baseline electric DHW
= Actual. If unknown or for new construction, assume federal standard as defined in applicable table in 'Definition of Baseline Equipment' section.

[1047] From Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder.
[1048] From Res GSHP measure of the IL-TRM: As per conversations with David Buss territory manager for Connor Co, the EER rating of an ASHP equate most appropriately with the full load EER of a GSHP.
[1049] Electric resistance has a COP of 1.0 which equals 1/0.293 = 3.41 HSPF.
[1050] As per Res GSHP measure.
[1051] Assumes that the desuperheater can provide two thirds of hot water needs for eight months of the year (2/3 * 2/3 = 44%). Based on input from Doug Dougherty, Geothermal Exchange Organization.

$HotWaterUse_{Gallon}$ = Estimated annual hot water consumption (gallons)

= Actual if possible to provide reasonable custom estimate. If not, two methodologies are provided to develop an estimate:

1. Consumption per usable storage tank capacity

= Capacity * Consumption/cap

Where:

Capacity = Usable capacity of hot water storage tank in gallons

= Actual

Consumption/cap = Estimate of consumption per gallon of usable tank capacity, based on building type:[1052]

Building Type[1053]	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894

2. Consumption per unit area by building type

= (Area/1000) * Consumption/1,000 sq.ft.

Where:

Area = Area in sq.ft that is served by DHW boiler

= Actual

Consumption/1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:[1054]

[1052] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

[1053] According to CBECS 2012 "Lodging" buildings include Dormitories, Hotels, Motel or Inns and other Lodging and "Nursing" buildings include Assisted Living and Nursing Homes.

[1054] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

Building Type[1055]	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

γWater = Density of water

= 8.33 pounds per gallon

T_{out} = Tank temperature

= 125°F

T_{in} = Incoming water temperature from well or municiplal system

= 50.7°F [1056]

1 = Heat Capacity of water (1 Btu/lb·°F)

3.412 = Conversion from Btu to kWh

$AFUE_{base}$ = Baseline Annual Fuel Utilization Efficiency Rating.
For early replacement measures, use actual AFUE rating for the remaining useful life of the existing equipment (6 years for furnace, 8 years for boilers).

For TOS, NC, and the remaining measure life of early replacement, use minimum standard efficiencies as specified in tables in 'Definition of Baseline Equipment' section.

FurnaceFlag = 1 if system replaced is a gas furnace, 0 if not.

F_e = Furnace Fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1057]

$EF_{GasBase}$ = Energy factor of Baseline natural gas DHW heater

= Actual. If unknown or New Construction, assume federal standard as defined in applicable table in 'Definition of Baseline Equipment' section.

3412 = Btu per kWh

[1055] According to CBECS 2012 "Lodging" buildings include Dormitories, Hotels, Motel or Inns and other Lodging and "Nursing" buildings include Assisted Living and Nursing Homes.

[1056] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[1057] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

%IncentiveElectric = % of total incentive paid by electric utility

= Actual

%IncentiveGas = % of total incentive paid by gas utility

= Actual

Non-Fuel Switch Illustrative Examples

New Construction using ASHP baseline:

For example, a 10 ton closed loop unit with Part Load EER rating of 20 and Part Load COP of 4.4, with desuperheater installed, and with a 100 gallon electric water heater in an new High School building in Chicago:

ΔkWh = [120,000 * 1,642 * (1/11 – 1/20) / 1000] + [1,549 * 120,000 * (1/11 – 1/(4.4*3.412)) / 1000] + [1 * 0.44 * ((1/0.9568 * (100*672) * 8.33 * (125-50.7) * 1)/3412)]

=8,061 + 4,516 +5,606 = 18,183 kWh

Early Replacement:

For example, a 10 ton closed loop unit with Part Load EER rating of 20 and Part Load COP of 4.4 and with desuperheater installed in in an Assisted living building in Chicago with a 100 gallon electric water heater, replacing an existing working Air Source Heat Pump with efficiency ratings of 8.2 EER and 7.7 HSPF:

ΔkWH for remaining life of existing unit (1st 8 years):

= [120,000 * 1,457 * (1/8.2 – 1/20) / 1000] + [1,646 * 120,000 * (1/7.7 – 1/(4.4*3.412)) / 1000] + [1 * 0.44 * ((1/0.9568 * (100*672) * 8.33 * (125-50.7) * 1)/3412)]

= 12,580 + 12,495 +5606 = 30,681 kWh

ΔkWH for remaining measure life (next 17 years):

= [120,000 * 1,457 * (1/11 – 1/20) / 1000] + [1,646 * 120,000 * (1/11 – 1/(4.4*3.412)) / 1000] + [1 * 0.44 * ((1/0.9568 * (100*672) * 8.33 * (125-50.7) * 1)/3412)]

= 7,153 + 4,800 +5,606 = 17,559 kWh

Fuel Switch Illustrative Example

[for illustrative purposes a 50:50 Incentive is used for joint programs]

Early Replacement fuel switch:

A 10 ton closed loop unit with Part Load EER rating of 20 and Part Load COP of 4.4 in an Assisted Living building in Chicago with a 100 gallon gas water heater replaces an existing working natural gas boiler with 75% efficiency and central AC of 9.5 EER, and desuperheater installed with natural gas existing DHW heater:

LifetimeSiteEnergySavings (MMBTUs) = $LifetimeGasHeatReplaced + LifetimeFurnaceFanSavings - LifetimeGSHPSiteHeatConsumed + LifetimeGSHPSiteCoolingImpact + LifetimeGSHPSiteWaterImpact$

LifetimeGasHeatReplaced =$((HeatLoad * 1/AFUE_{exist}) / 1{,}000{,}000 * 8\ years) + ((HeatLoad * 1/AFUE_{base}) / 1{,}000{,}000 * 17\ years)$

=$((120{,}000 * 1{,}646 * 1/0.75) / 1{,}000{,}000 * 8) + ((120{,}000 * 1{,}646 * 1/0.8) / 1{,}000{,}000 * 17)$

= $6304.2\ MMBtu$

LifetimeFurnaceFanSavings=$((FurnaceFlag * HeatLoad * 1/AFUE_{exist} * F_e) / 1{,}000{,}000 * 8\ years) + ((FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_{e}_New) / 1{,}000{,}000 * 17\ years)$

= 0 MMBtu

LifetimeGSHPSiteHeatConsumed = $(HeatLoad * 1/COP_{GSHP}) / 1{,}000{,}000 * 25\ years$

= $(120{,}000 * 1{,}646 * 1/4.4)/1{,}000{,}000 * 25$

= $1122.3\ MMBtu$

Fuel Switch Illustrative Example continued

LifetimeGSHPSiteCoolingImpact =$(((EFLH_{cool} * Capacity_{Cool} * (1/EER_{exist} - 1/EER_{GSHP}))/1000 * 3412) / 1{,}000{,}000 * 6\ years) + (((EFLH_{cool} * Capacity_{Cool} * (1/EERbase - 1/EER_{GSHP}))/1000 * 3412) / 1{,}000{,}000 * 19\ years)$

= $(((120000 * 1{,}457 * (1/9.5 - 1/20)) / 1000 * 3412)/1{,}000{,}000 * 6) + (((120000 * 1{,}457 * (1/11 - 1/20)) / 1000) * 3412)/1{,}000{,}000 * 19)$

= $661.5\ MMBtu$

LifetimeGSHPSiteWaterImpact$_{Gas}$ = $((\%DHWDisplaced * ((1/EF_{Gas} * GPD * Household * 365.25 * \gamma Water * (T_{OUT} - T_{in}) * 1.0) / 1{,}000{,}000) * 25\ years$

= $(0.44 * (1/0.8 * (100 * 672) * 8.33 * (125 - 50.7) * 1) / 1{,}000{,}000) * 25$

= $571.9\ MMBtu$

LifetimeSiteEnergySavings (MMBTUs) = 6304.2 + 0 – 1122.3 + 661.5 + 571.9 = 6,415 MMBtu [Measure is eligible]

First 6 years:

SiteEnergySavings_FirstYear (MMBTUs) = $GasHeatReplaced + FurnaceFanSavings - GSHPSiteHeatConsumed + GSHPSiteCoolingImpact + GSHPSiteWaterImpact$

GasHeatReplaced= $(HeatLoad * 1/AFUE_{exist}) / 1{,}000{,}000$

= $(120{,}000 * 1{,}646 * 1/0.75) / 1{,}000{,}000$

= $263.4\ MMBtu$

FurnaceFanSavings=$(FurnaceFlag * HeatLoad * 1/AFUE_{exist} * F_e) / 1{,}000{,}000$

= $0\ MMBtu$

GSHPSiteHeatConsumed = $(HeatLoad * 1/COP_{GSHP}) / 1{,}000{,}000$

= $(120{,}000 * 1{,}646 * 1/4.4)/ 1{,}000{,}000$

= $44.9\ MMBtu$

GSHPSiteCoolingImpact =$((EFLH_{cool} * Capacity_{Cool} * (1/EER_{exist} - 1/EER_{GSHP}))/1000 * 3412)/1{,}000{,}000$

= $((120000 * 1{,}457 * (1/9.5 - 1/20)) / 1000 * 3412)/1{,}000{,}000$

= $33.0\ MMBtu$

GSHPSiteWaterImpact$_{Gas}$ = $(\%DHWDisplaced * ((1/EF_{Gas} * GPD * Household * 365.25 * \gamma Water * (T_{OUT} - T_{in}) * 1.0) / 1{,}000{,}000$

= $(0.44 * (1/0.8 * (100 * 672) * 8.33 * (125 - 50.7) * 1) / 1{,}000{,}000$

= $22.9\ MMBtu$

SiteEnergySavings_FirstYear (MMBTUs) = 263.4 + 0 – 44.9 + 33 + 22.9 = 274.4 MMBtu

Fuel Switch Illustrative Example continued

Remaining 10 years:

SourceEnergySavings_PostAdj (MMBTUs) = $GasHeatReplaced + FurnaceFanSavings - GSHPSourceHeatConsumed + GSHPSourceCoolingImpact + GSHPSourceWaterImpact$

GasHeatReplaced = $(HeatLoad * 1/AFUE_{exist})$ / 1,000,000

= $(120{,}000 * 1{,}646 * 1/0.8)$ / 1,000,000

= 246.9 $MMBtu$

FurnaceFanSavings =$(FurnaceFlag * HeatLoad * 1/AFUE_{exist} * F_e)$ / 1,000,000

= 0 MMBtu

GSHPSiteHeatConsumed = $(HeatLoad * 1/COP_{GSHP})$ / 1,000,000

= $(120{,}000 * 1{,}646 * 1/4.4)$/ 1,000,000

= 44.9 $MMBtu$

GSHPSiteCoolingImpact = ($(EFLH_{cool} * Capacity_{Cool} * (1/EER_{exist} - 1/EER_{GSHP}))/1000 * 3412)/1{,}000{,}000$

= $((120000 * 1{,}457 * (1/11 - 1/20))$ / $1000 * 3412)/1{,}000{,}000$

= 24.4 $MMBtu$

$GSHPSiteWaterImpact_{Gas}$ = $(\%DHWDisplaced * ((1/EF_{Gas} * GPD * Household * 365.25 * \gamma Water * (T_{OUT} - T_{in}) * 1.0)$ / 1,000,000

= $(0.44 * (1/0.8 * (100 * 672) * 8.33 * (125 - 50.7) * 1)$ / 1,000,000

= 22.9 $MMBtu$

SourceEnergySavings_PostAdj (MMBTUs) = 246.9 + 0 – 44.9 + 24.4 + 22.9 = 249.3 MMBtu

Savings would be claimed as follows:

Measure supported by:	Electric Utility claims:	Gas Utility claims:
Electric utility only	First 6 years: 274.4 * 1,000,000 / 3412 = 80,422 kWh Remaining 10 years: 249.3 * 1,000,000 / 3412 = 73,066 kWh	N/A
Electric and gas utility	First 6 years: 0.5 * 274.4 * 1,000,000 / 3412 = 40,211 kWh Remaining 10 years: 0.5 * 249.3 * 1,000,000 / 3412 = 36,533 kWh	First 6 years: 0.5 * 274.4 * 10 = 1372 Therms Remaining 10 years: 0.5 * 249.3 * 10 = 1247 Therms
Gas utility only	N/A	First 6 years: 274.4 * 10 = 2744 Therms Remaining 10 years: 249.3 * 10 = 2493 Therms

$$\Delta kW = (Capacity_{Cool} * (1/EER2_{base} - 1/EER2_{GSHP}))/1000 * CF$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)
= 91.3%[1058]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)
= 47.8%[1059]

New Construction or Time of Sale:

For example, a 10 ton closed loop unit with Full Load EER rating of 20:

$\Delta kW_{SSP} = (120{,}000 * (1/11 - 1/20))/1000 * 0.913$
$= 4.482kW$

$\Delta kW_{PJM} = (36{,}000 * (1/11 - 1/20))/1000 * 0.478$
$= 2.347kW$

Early Replacement:

For example, a 10 ton closed loop unit with Full Load 20 EER replaces an existing working Air Source Heat Pump with 8.2 EER:

ΔkW_{SSP} for remaining life of existing unit (1st 8 years):
$= (120{,}000 * (1/8.2 - 1/20))/1000 * 0.913$
$= 7.883\ kW$

ΔkW_{SSP} for remaining measure life (next 17 years):
$= (120{,}000 * (1/11 - 1/20))/1000 * 0.913$
$= 4.482kW$

ΔkW_{PJM} for remaining life of existing unit (1st 8 years):
$= (120{,}000 * (1/8.2 - 1/20))/1000 * 0.478$
$= 4.127\ kW$

ΔkW_{PJM} for remaining measure life (next 17 years):
$= (120{,}000 * (1/11 - 1/20))/1000 * 0.478$
$= 2.347kW$

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

[1058] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1059] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from gas to electric.

For the purposes of forecasting load reductions due to fuel switch GSHP projects; changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 7 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure.

ΔTherms = $[Heating\ Consumption\ Replaced] + [DHW\ Savings\ if\ existing\ natural\ gas\ DHW]$

= $[(HeatLoad * 1\ AFUE_{base})/ 100{,}000] + [(1 - ElecDHW) * \%DHW * (1/ EF_{GasBase} * HotWaterUse_{Gallon} * \gamma Water * (T_{OUT} - T_{in}) * 1.0) / 100{,}000)]$

ΔkWh = $[FurnaceFanSavings] - [GSHP\ heating\ consumption] + [Cooling\ savings] + [DHW\ savings\ if\ existing\ electric\ DHW]$

=$[FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_e * 0.000293] - [(HeatLoad * (1/ COP_{GSHP} * 3.412))/1000] + [(EFLH_{cool} * Capacity_{Cool} * (1/EER2_{\ base} - 1/EER2_{GSHP}))/1000] + [ElecDHW * \%DHW * ((1/EF_{ELEC} * HotWaterUse_{Gallon} * \gamma Water * (T_{OUT} - T_{in}) * 1.0) / 3412)]$

Illustrative Example of Cost Effectiveness Inputs for Fuel Switching:

For example, a 10 ton unit with Part Load EER rating of 20 and Part Load COP of 4.4 in an Assisted living building in Chicago with a 100 gallon gas water heater replaces an existing working natural gas boiler with 75% efficiency and air-cooled chiller of 9.5 EER. [Note the calculation provides the annual savings for the first 8 years of the measure life, an additional calculation (not shown) would be required to calculate the annual savings for the remaining life (years 9-25)]:

ΔTherms $=[HeatLoad * 1\ AFUE_{base})/\ 100{,}000] + [(1 - ElecDHW) * \%DHW * (1/ EF_{GasBase} * HotWaterUse_{Gallon} * \gamma Water * (T_{OUT} - T_{in}) * 1.0) / 100{,}000)]$

$=[(120{,}000 * 1{,}646 * 1/0.75)/100{,}000] + [((1 - 0) * 0.44 * (1/0.8 * (100 * 672) * 8.33 * (125 - 50.7) * 1\ )/100{,}000)]$

$= 2{,}634 + 229$

$= 2{,}863\ therms$

ΔkWh $=[FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_e * 0.000293] - [(HeatLoad * (1/ COP_{GSHP} * 3.412))/1000] + [(EFLH_{cool} * Capacity_{Cool} * (1/EER_{base} - 1/ EER_{GSHP}))/1000] + [ElecDHW * \%DHW * ((1/EF_{ELEC} * HotWaterUse_{Gallon} * \gamma Water * (T_{OUT} - T_{in}) * 1.0) / 3412)]$

$= 0 - [(1646 * 120{,}000 * (1/\ 4.4\ * 3.412))/1000] + [(1457 * 120000 * (1/11 - 1/20))/1000] + [0 * (0.44 * ((1/0.9568) * (100 * 672) * 8.33 * (125 - 50.7) * 1\ /3412))]$

$= 0 - 153{,}168 + 7153 + 0$

$= -146{,}015\ kWh$

MEASURE CODE: CI-HVC-GSHP-V11-270101

REVIEW DEADLINE: 1/1/2028

4.4.45 Adsorbent Air Cleaning

DESCRIPTION

The Adsorbent Air Cleaning (AAC) measure installs modular adsorbent air cleaning devices ("AAC modules") into commercial forced air HVAC systems. These devices pass return air through adsorbent media which remove the gas-phase contaminants carbon dioxide and species of volatile organic compounds (VOCs) from the return air, allowing it to be recirculated rather than removed from the building as exhaust and replaced with ventilation air. This allows HVAC system operators to substantially reduce the amount of outside air brought in for ventilation while still maintaining acceptable indoor air quality, resulting in heating and cooling energy savings. An energy penalty is incurred due to the operation of fans integrated within the AAC modules, as well as from integrated electric heaters used in a regeneration cycle which purges the adsorbent media of contaminants to allow them to be used again. Net energy savings are calculated and are equal to the cooling and heating energy savings due to reduced outdoor air minus the energy required to operate the AAC modules.

This measure serves the market for medium to large commercial and institutional buildings.

This measure is currently applicable to the following program types: NC, RF, DI. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Efficient equipment is defined as a commercial HVAC system which has AAC modules installed in the return airstream, with the number of modules determined by appropriate sizing calculations. The modules allow for a substantial reduction in the volume of outside air introduced to the building compared to systems without AAC modules.

DEFINITION OF BASELINE EQUIPMENT

Baseline equipment is a variable air volume HVAC system equipped with an integrated economizer and which does not have AAC modules installed. Heating is provided by either electricity, natural gas, or heat pump.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for HVAC applications is 20 years.[1060]

DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost below can be used, which is based on a cost per cfm of supply air flow rate.[1061]

Unit	Material Cost / Unit ($/cfm)	Labor Cost / Unit ($/cfm)	Total Cost / Unit ($/cfm)
Supply Air CFM	$0.90	$0.48	$1.38

For example, the default deemed measure cost of installing the AAC measure in an HVAC system with a design supply air flow rate of 75,000 cfm is:

Deemed Measure Cost ($) = 75,000 cfm * $1.38/cfm = $103,500

LOADSHAPE

For buildings with gas heat:

Loadshape C03 – Commercial Cooling

For buildings with electric heat:

[1060] Expected lifetime based on median years of axial fans and dampers from the ASHRAE Equipment Life Expectancy Chart.
[1061] Default measure cost is based on sales information and labor cost estimates provided by a major Original Equipment Manufacturer (OEM) of AAC units. The OEM's estimates are based on prior installation experiences and case studies.

Loadshape C05 – Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

The concidence factor is assumed to be the PJM Summer Peak Coincidence Factor for Commercial Cooling:

CF_{PJM} = 47.8%[1062]

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings associated with the Adsorbent Air Cleaning measure were derived from the results of a pilot study conducted in a commercial office building in Chicago during the 2019-2020 cooling and heating seasons. The building had a VAV system with economizer and electric heat. During the study, outdoor air rates were reduced according to the AAC module manufacturer's recommendations. Building cooling and heating loads associated with preconditioning outdoor air were continuously measured both with baseline and reduced outdoor air flow rates over a range of outdoor air temperatures and humidities. Statistical models were developed to predict energy and peak electric load savings as a function of outdoor air flow rate and outdoor air conditions. The models were then used to simulate energy use and peak load savings in other Illinois climate zones using TMY data.

In addition to monitoring cooling and heating energy, the pilot study also measured the electricity used to operate the AAC modules for the duration of the cooling and heating seasons. This energy penalty was subtracted from the cooling and heating load savings to calculate net savings.

ELECTRIC ENERGY SAVINGS

Identify the building's heating fuel. Electric energy savings will differ for buildings with natural gas, electric resistance, or electric heat pumps as a heating fuel.

For buildings with **natural gas** as a heating fuel, electric energy savings are:

$$\Delta kWh = \Delta VOA * (NCLS / Cooling_{COP} - Annual\ Electric_{AAC})$$

For buildings with **electric resistance** as a heating fuel, electric energy savings are:

$$\Delta kWh = \Delta VOA * (NCLS / Cooling_{COP} + NHLS - Annual\ Electric_{AAC})$$

For buildings with **electric heat pumps** as a heating fuel, electric energy savings are:

$$\Delta kWh = \Delta VOA * (NCLS / Cooling_{COP} + NHLS / Heating_{COP} - Annual\ Electric_{AAC})$$

Where:

ΔV_{OA} = reduction in minimum outside air flow (scfm) due to incorporating an AAC module

= if the rate is unknown, calculate using the following equation:

$\Delta V_{OA} = V_{supply} * F_{OA} * F_R$, where:

V_{supply} = design or operational peak supply air flow rate of air handler in scfm

F_{OA} = operational minimum fraction of outside air in supply airflow before installing AAC modules

[1062] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

F_R = percentage reduction of outside air due to AAC modules

= custom; if unknown, use 0.7 as a default[1063]

NCLS (Normalized Cooling Load Savings)

= ΔkWh/Δscfm savings value for the appropriate climate zone in the table below:

Normalized Cooling Load Savings (kWh/cfm)				
Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
17.9	18.6	24.2	26.5	23.6

NHLS (Normalized Heating Load Savings)

= ΔkWh/Δscfm savings value for the appropriate climate zone and F_{OA} in the table below:

F_{OA}	Normalized Heating Load Savings (kWh/cfm)				
	Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
0.10	2.24	1.13	1.09	0.76	0.95
0.15	3.32	1.94	2.14	1.72	1.81
0.20	3.90	2.44	2.76	2.28	2.37
0.25	4.31	2.80	3.09	2.53	2.68
0.30	4.54	3.05	3.25	2.68	2.85

$Cooling_{COP}$ = seasonal average COP of building cooling plant. If unknown, use 4.0 as a default[1064]

$Heating_{COP}$ = seasonal average COP of heat pump. If unknown, use 2.5 as a default[1065]

Annual $Electric_{AAC}$ = annual electricity consumed by AAC modules for the appropriate climate zone

AAC Electricity Consumption (kWh/cfm)				
Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
1.07	0.91	1.06	0.98	0.89

[1063] The default value of 0.7 for FR is based on a survey of previous case studies which documented the field installation of AAC modules in existing HVAC systems.

[1064] The default cooling COP value of 4.0 is an approximation consistent with cooling analysis in the LEED rating system, and approximates a modern, moderate efficiency water-cooled chiller (COP = 6.0) with cooling tower and pump energy usage.

[1065] The default heating COP value of 2.5 is an approximation representing an air-source heat pump of moderate efficiency.

For example, An office building in Climate Zone 3 is equipped with a VAV system with electric heat and has a cooling plant COP of 4.0, a design supply air flow rate of 50,000 scfm and an outdoor air ventilation rate of 10,000 scfm. Installing AAC modules will allow reduction of the outdoor air ventilation rate by 70%. In this case:

V_{supply} = 50,000 scfm

F_{OA} = 10,000 scfm / 50,000 scfm = 0.2

F_R = 0.7

$\Delta V_{OA} = V_{supply} * F_{OA} * F_R$ = 50,000 scfm * 0.2 * 0.7 = 7,000 scfm

Normalized Cooling Load Savings = 24.2 kWh/scfm (Climate zone 3, F_{OA} = 0.2)

$Cooling_{COP}$ = 4.0

Normalized Heating Load Savings = 2.76 kWh/scfm (Climate zone 3, F_{OA} = 0.2)

Annual $Electric_{AAC}$ = 1.06 kWh/scfm (Climate zone 3)

$\Delta kWh = \Delta V_{OA} * (NCLS / Cooling_{COP} + NHLS – Annual\ Electric_{AAC})$

= 7,000 scfm * (24.2 kWh/scfm / 4.0 + 2.76 kWh/scfm – 1.06 kWh/scfm)

= 54,250 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta V_{OA} * (Normalized\ Peak\ Cooling\ Load\ Savings / Cooling_{COP}) * CF_{PJM}$$

Where:

CF_{PJM} = 0.478

Normalized Peak Cooling Load Savings

= ΔkW/Δscfm savings value for the appropriate combination of building type, climate zone, and measure scenario, as detailed in the table below

Normalized Peak Cooling Load Savings (kW/cfm)				
Rockford – Zone 1	Chicago – Zone 2	Springfield – Zone 3	Mt. Vernon/Belleville – Zone 4	Marion – Zone 5
0.0259	0.0256	0.0296	0.0293	0.0283

FOSSIL FUEL SAVINGS

Natural gas savings do not apply to buildings where electricity is the heating fuel. For buildings where natural gas is the heating fuel:

$$\Delta therms = \Delta V_{OA} * (NHLS / \eta) * 0.03412$$

Where:

η	= efficiency of gas heating equipment. If unknown, use 0.821 as default.[1066]
0.03412	= therms per kWh. Conversion factor to convert kWh to therms

MEASURE CODE: CI-HVC-ADAC-V05-270101

REVIEW DEADLINE: 1/1/2030

[1066] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

4.4.46 Server Room Temperature Set back

DESCRIPTION

This measure involves adjusting existing thermostats or building automation systems for reduced cooling energy consumption and fan energy consumption in server room and/or data center spaces. Existing set points should be documented through an audit or retro-commissioning study. A maximum temperature setpoint of 95°F will limit significant increase in server fan power consumption.

This measure was developed to be applicable to the following program types: RF, DI

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The criteria for this measure is established by optimizing the cooling temperature setpoint with a commercial thermostat or building automation system, up to a maximum of 95°F, which is adjusted to meet or approach ASHRAE recommended standards for data center cooling.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is a commercial thermostat or building automation system that is currently controlling cooling temperature setpoints that do not align with ASHRAE TC 9.9.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of a programmable thermostat is assumed to be 8 years.[1067] For the purposes of claiming savings for an adjustment of an existing thermostat, this is reduced to a 50% persistence factor to give a final measure life of 4 years. It is recommended that this assumption be evaluated by future energy measurement and verification activities.

DEEMED MEASURE COST

Actual labor costs should be used if the implementation method allows. If unknown the labor cost for this measure is assumed to be $35.24 per thermostat,[1068] as summarized in the following table.

Measure	Units	Materials	Labor	Total Cost (including O&P)	City Cost Index (Install Only)*	Total	Source
Adjust Temperature Set Points	4	$0.00	$5.95	$6.55	134.5%	$35.24	RS Means 2010 (pg 255, Section 23-09-8100)
* Chicago, IL – Division 23							

LOADSHAPE

Loadshape C03 – Commercial Cooling

COINCIDENCE FACTOR

Since the server room is cooled 8760 hours, the summer peak coincidence factor is assumed to be 100%.

[1067] 8 years is based upon ASHRAE Applications (2003), Section 36, Table 3 estimate of 16 years for the equipment life, reduced by 50% to account for persistence issues.

[1068] RSMeans, "Instrumentation and Control for HVAC", Mechanical Cost Data , Kingston, MA: Reed Construction Data, 2010, pg. 255 & 632.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = Capacity * (1/EER) * EFLH * LF * \%Savings * (T_{after} - T_{before})$$

Where:

Capacity = Capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)
= Actual

EER = Energy efficiency ratio of the equipment
= Actual

EFLH = Equivalent full load hours for cooling
= 8,760

LF = Load Factor,
= 65%[1069]

%Savings = Deemed percent savings
= 4% per degree increase[1070]

T_{after} = Space temperature setpoint after adjustment, maximum of 95°F
= Actual

T_{before} = Space temperature setpoint before adjustment
= Actual

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = Capacity * (1/EER) * LF * \%Savings * (T_{after} - T_{before}) * CF$$

Where:

CF = Summer Peak Coincidence Factor for measure
= 1.0

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[1069]ASHRAE Technical Support Document, 4.2.3.2 "Estimate the Average Computer Server Heat Load", page 4-15.
[1070]J. Brandon. "Going Green In The Data Center: Practical Steps For Your SME To Become More Environmentally Friendly. Processor", 29, Sept. 2007.

MEASURE CODE: CI-HVC-SRSB-V02-260101

REVIEW DEADLINE: 1/1/2029

4.4.47 Air Deflectors for Unit Ventilators – Provisional Measure – Removed V12.

4.4.48 Small Commercial Thermostats

DESCRIPTION

This measure characterizes the energy savings from the installation of either a Programmable or an advanced Thermostat to reduce heating and cooling consumption in a small commercial building.

The thermostat must be installed to control a single-zone HVAC system. This measure is limited to packaged HVAC units 10 tons or less. This measure should not be used when HVAC systems are being replaced, in new construction and whenever code compliance is required.

The savings associated with small commercial installations of thermostats had not been well evaluated at the time this measure was created for TRM Version 8.0. In the absence of assumptions specific to small commercial customers, the percent savings derived from Illinois Residential evaluations were used. In version 9.0 the cooling savings percentage was updated based on research conducted on small commercial programmable thermostat applications.[1071] In CY2020, additional research was performed to support a potential update to the heating savings percentage. The results did not provide a sufficient statistically significant basis for changing the current assumption.

Note that while these devices and service could potentially be used as part of a demand response program, the costs, delivery, impacts, and other aspects of DR-specific program delivery are not included in this characterization at this time, though they could be added in the future.

This measure was developed to be applicable to the following program types: TOS, RF, DI.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The criteria for this measure are established by replacement of a manual-only thermostat, with one that has the capability to establish a schedule of time and/or temperature setpoints, or replacement of a programmable thermostat with an Advanced Thermostat.

DEFINITION OF BASELINE EQUIPMENT

The baseline is assumed to be a manual or programmable thermostat.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 11 years.[1072]

DEEMED MEASURE COST

For DI and other programs for which installation services are provided, the actual material, labor, and other costs should be used. If unknown then the average incremental cost for the new installation measure is assumed to be $175.

LOADSHAPE

Loadshape C05 – Commercial Electric Heating and Cooling, or

Loadshape C03 – Commercial Cooling

COINCIDENCE FACTOR

In the absence of conclusive results from empirical studies on peak savings, the TAC agreed to a temporary assumption of 50% of the cooling coincidence factor, acknowledging that while the savings from the Thermostat will

[1071] See "Small Commercial Thermostats Research," memorandum from Guidehouse to ComEd dated May 15, 2020.
[1072] Based on 2017 Residential Smart Thermostat Workpaper, prepared by SCE and Nest for SCE (Work Paper SCE17HC054, Revision #0). Estimate ability of smart systems to continue providing savings after disconnection and conduct statistical survival analysis which yields 9.2-13.8 year range.

track with the cooling load, the impact during peak periods may be lower. This is an assumption that could use future evaluation to improve these estimates.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 45.7 [1073]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 23.9% [1074]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Heating savings are provided based upon the percentage savings from the Residential version of this measure. Cooling savings are based on research on small commercial programmable thermostat installations. Future research on heating savings percentages for small commercial applications, and heating and cooling savings percentages for Advanced Thermostat applications, should be used to improve this assumption.

$$\Delta kWh^{1075} = \Delta kWh_{heating} + \Delta kWh_{cooling}$$

$$\Delta kWh_{heating} = (\%ElecHeat * kBtu/hr_{heat} * 1/\eta Heat_Electric * EFLH_{heat} * Heating_Reduction * BAF) + (\Delta Therms * F_e * 29.3)$$

$$\Delta kWh_{cool} = kBtu/hr_{cool} * 1/\eta Cool * EFLH_{cool} * Cooling_Reduction * BAF$$

Where:

%ElecHeat = Percentage of heating savings assumed to be electric

= 1 if electric heat, 0 if gas heat. If unknown assume 0.08[1076].

$kBtu/hr_{heat}$ = capacity of the heating equipment in kBtu per hour.

= Actual. If unknown assume 114.5[1077]

ηHeat_Electric = Heating Seasonal Performance Factor of the equipment * Distribution efficiency

= Actual (assuming distribution efficiency of 0.95), if unknown a blended baseline value of 4.6 HSPF2[1078].

$EFLH_{heat}$ = Heating mode equivalent full load hours in Existing Buildings are provided in section 4.4 HVAC End Use.

Heating_Reduction = Assumed percentage reduction in total building heating energy consumption due to thermostat

[1073] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year. Multiplied by 50%.

[1074] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year. Multiplied by 50%.

[1075] Electrical savings are a function of both heating and cooling energy usage reductions. For heating this is a function of the percent of electric heat (heat pumps) and fan savings in the case of a natural gas furnace.

[1076] Based on percentage of customers in ComEd Small Business Thermostat program with electric heat.

[1077] Average capacity of 705 installs of thermostats in Ameren Illinois territory installed from 2015-2020.

[1078] Blended Baseline value came from percentage of accounts with heat pumps (15%) at 7.4 HSPF2 and electric furnaces (85%) at 3.412 HSPF, based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85, and then to estimate duct losses multiplied by 0.95.

= 8.8%[1079]

ΔTherms = Therm savings if Natural Gas heating system

= See calculation in Fossil Fuel section below

F_e = Furnace Fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1080]

29.3 = kWh per therm

$kBtu/hr_{cool}$ = capacity of the cooling equipment actually installed in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)

= Actual. If unknown assume 61.0[1081]

ηCool = Seasonal Energy Efficiency Ratio of the cooling equipment * Distribution Efficiency

= Actual, is unknown assume Code base, and assume 95% distribution efficiency for central cooling with ducts. For midstream programs, assume a value of 11.1 SEER2.[1082]

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use.

Cooling_Reduction = Average percentage reduction in total building cooling energy consumption due to installation of thermostat:

= 17.7%[1083]

BAF = Baseline adjustment factor.

= 1.0, if the baseline thermostat was manual type

[1079] Assumed equal to assumption for Residential Advanced Thermostats with manual thermostat baseline, before adding savings from Thermostat Optimization (which is not applicable to small commercial customers). Note that a Guidehouse billing study in CY2020 did not find a statistically significant basis for adjusting this assumption for commercial applications, see "Small Commercial Thermostats TRM Research" memo. April 21, 2021.
Estimates of heating and cooling reduction factors are based on consumption data analyses with matching to non-participants and are therefore net with respect to participant spillover and between net and gross with respect to free ridership. Like all consumption data analyses, they are gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to these factors will be determined as part of the annual SAG net-to-gross process.

[1080] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[1081] Average capacity of 639 installs of thermostats on units <=10tons in Ameren Illinois territory installed from 2015-2020 and 706 installs on units <=10tons in ComEd territory in 2021.

[1082] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER value converted to SEER2 by multiplying by 0.95, and multiplied by 0.95 distribution efficiency.

[1083] Based on research conducted by Guidehouse on a sample of IL Small Commercial programmable thermostat installations, which found a range of savings values depending on the modeling assumptions used. Guidehouse recommended selecting the midpoint of this range, which it deemed preferable to continuing to rely on Residential assumptions, while also accounting for the relative uncertainties involved. See "Small Commercial Thermostats Research" memo completed in 2020.
Estimates of heating and cooling reduction factors are based on consumption data analyses with matching to non-participants and are therefore net with respect to participant spillover and between net and gross with respect to free ridership. Like all consumption data analyses, they are gross with respect to non-participant spillover. For more detail, see Table 5-3 in Volume 4 of the IL-TRM. Consistent with Section 7.2 of the Illinois EE Policy Manual, applicable net-to-gross adjustments to these factors will be determined as part of the annual SAG net-to-gross process.

= 0.6, if the baseline thermostat was programmable type[1084]

= 0.8, if the baseline is unknown[1085]

For example, a thermostat installed in a Drug Store in Rockford with an electric heating system, replacing a manual type thermostat would have the following savings:

ΔkWh Heating = 1 * 114.5 * 1/4.6 * 2,848 * 8.8% * 1

= 6,238

ΔkWh Cooling = 61 * 1/11.1 * 858 * 17.7% * 1

= 835

ΔkWh = 6,238 + 835

= 7,073 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = kBtu/hr_{cool} * 1/EER2 * Cooling_Reduction * BAF * CF$$

Where:

EER2 = Energy Efficiency Ratio of the equipment

= Actual, if unknown assume current Code. For midstream programs, assume a value of 10.2 EER2.[1086] For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER to EER for calculation of peak savings:[1087]

$$EER = (-0.02 * SEER^2) + (1.12 * SEER)$$

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 45.7% [1088]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 23.9% [1089]

Other variables as provided above.

[1084] This factor represents the ratio of thermostat adjustment savings to thermostat replacement savings. It is based on actual thermostat algorithm data (i.e., degrees of setback, hours values, fan modes) from two years of ComEd AirCare Plus Program data (PY9+ and CY2018), including 382 thermostat adjustment installations and 3,847 thermostat replacement installations. An analysis of the data showed that on average, thermostat adjustments saved 61% and 59% of the thermostat replacement cooling savings and heating savings, respectively. For simplicity, a value of 0.6 was selected for both cooling and heating savings adjustment. See IL TRM Workpaper "4.4.48 Small Commercial Thermostats", Guidehouse, 6/23/2021 for details.

[1085] Review of ComEd's 2020 Baseline Study and 2019-2020 Program Data indicates that approximately half of installs are in buildings with existing manual thermostats, and half with existing programmable thermostats.

[1086] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note EER value converted to EER2 by multiplying by 0.95, and multiplied by 0.95 distribution efficiency.

[1087] Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

[1088] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year. Multiplied by 50%.

[1089] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year. Multiplied by 50%.

For example, a thermostat installed through a midstream program in a Drug Store in Rockford with an electric heating system, replacing a manual type thermostat would have the following savings during system peak hours:

ΔkW = 61 * 1/10.2* 17.7% *1 * 45.7%

= 0.48 kW

FOSSIL FUEL SAVINGS

$$\Delta Therms = ((1 - \%ElectricHeat) * EFLH_{heat} * Capacity * 1/\eta Heat_Fossil * Heating_Reduction * BAF)/ 100{,}000 Btu/Therm$$

Where:

Capacity = Nominal Heating Input Capacity (Btu/hr) of heating system

= Actual

ηHeat_Fossil = Annual Fuel Utilization Efficiency Rating * Distribution Efficiency

= Actual, if unknown assume code baseline and assume 95% distribution efficiency. For midstream prorams, assume a value of 0.821.[1090]

Other variables as provided above.

For Example, a thermostat installed through a midstream program in a Drug Store in Rockford with a gas heating system with a rated capacity of 60,000 Btu/hr, replacing a manual type thermostat would have the following savings:

ΔTherms = ((1 - 0) * 2,848 * 60,000 * 1 / 0.821 * 8.8% * 1) / 100,000

= 183 Therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-THST-V08-260101

REVIEW DEADLINE: 1/1/2029

[1090] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

4.4.49 Boiler Chemical Descaling

DESCRIPTION

The measure is for a non-residential hot water or steam boiler serving process loads or one that provides space heating. Even with careful and precise water treatment in a boiler system, mineral scales are formed over time due to the high pressure and heat. Boiler scale is typically calcium, carbon, iron and silica particle deposits that form on the boiler tubes. Scale creates a problem because it typically possesses a thermal conductivity far less than the corresponding value for bare steel. Even thin layers of scale serve as an effective insulator and inhibit heat transfer. The result is overheating of boiler tube metal, tube failures, and loss of energy efficiency.

De-scaling a boiler system will improve boiler efficiency by removing mineral scale build up on boiler tubes. De-scaling is done either through mechanical or chemical cleaning techniques. There are several limitations to mechanical cleaning, namely firetube boilers cannot be mechanically cleaned. Depending on the size of the boiler, it can take up to a week to mechanically clean the tubes. This measure applies to chemical de-scaling, which is an efficient alternative, since it is not plagued by these limitations. The procedure typically involves the boiler being emptied and taken off-line, following which, the correct chemical solution ratio is pumped through the boiler system for four to eight hours.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, the facility must, as applicable, complete the chemical de-scaling by an approved technician and be NSF/ANSI/CAN 60 compliant.[1091]

The efficient equipment is a boiler system which has been de-scaled using a chemical solution. After the cleaning is complete, the personnel have to ensure that all safety checks are completed including checks for leaks. Lastly, any remains of the descaling chemical solution have to be eliminated from the tubes by flushing the system with water and a blowdown.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a boiler system that is compromised by scale build up.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The lifetime of this measure varies based on the location of the site in Illinois. It has been established that the rate of scale buildup in hydronic systems is directly dependent on the hardness of the supply water (the amount of dissolved Calcium, Magnesium and Iron).[1092] Based on an analysis of water supply composition in Illinois,[1093] the estimated life of measure(in years) before requiring de-scaling is listed below:

Climate Zone	Measure Life of De-scaling
Rockford	2
Chicago	6
Springfield	2
Belleville	3

[1091] NSF/ANSI/CAN 60 Standard: "If you manufacture, sell or distribute water treatment chemicals in North America, your products are required to comply with NSF/ANSI/CAN 60: Drinking Water Treatment Chemicals – Health Effects by most governmental agencies that regulate drinking water supplies."

[1092] 'Study on Benefits of Removal of Water Hardness (Calcium and Magnesium Ions) from a Water Supply', Battelle Memorial Institute, accessed April 2020.

[1093] The Water Quality Reports from 'Illinois American Water' were analyzed for all five TRM zones in Illinois. Based on the water hardness level and Iron content, a correlation was made to the estimated usage of hydronic equipment before de-scaling is required. See page v of 'Study on Benefits of Removal of Water Hardness (Calcium and Magnesium Ions) from a Water Supply', Battelle Memorial Institute and "Water Quality Summary.xlsx" for reference.

Climate Zone	Measure Life of De-scaling
Marion	3

DEEMED MEASURE COST

The cost of this measure is estimated to be $378/MMBtu/hr per boiler.[1094]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms} = (Capacity * EFLH * \%Ei) / 100{,}000$$

Where:

Capacity = Nominal Heating Input Capacity Boiler Size (Btu/hr) for boiler unit

= Actual

EFLH = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use. For process loads, use custom hours.

%Ei = Percent efficiency improvement from chemical descaling

= Dependent on system pressure and estimate of scale thickness. If unknown assume normal.[1095]

	Efficiency Improvement (%Ei)	
Scale Thickness (inches)	Low Pressure (15psig and below) Applications	High Pressure (above 15psig) Applications
Low (≤1/64)	1%	1.6%
Normal (≥1/32 & ≤ 3/64)	2.5%	3.9%
High (≥1/16)	3.9%	6.2%

[1094] Averaged from quotes from two chemical de-scaling solution manufacturers. Quote based on one day service with two personnel, including circulating pumps, tank assembly and other necessary fittings. Quotes based on pilot project study done by Nicor Gas Emerging Technology Program and Gas Technology Institute (GTI), "Descaling of Steam Boiler Systems", 2019-2020. A 20% RYDLYME solution is assumed for cost, based on the pilot.

[1095] Estimates based on pilot project study done by Nicor Gas Emerging Technology Program and Gas Technology Institute (GTI), "Descaling of Steam Boiler Systems", 2019-2020, and review of the following studies:
'Clean Firetube Boiler Waterside Heat Transfer Surfaces', U.S. Department of Energy, April 2012.
'Energy Conservation Program Guide for Industry and Commerce', NBS Handbook 115 Supplement 1, U.S. Department of Energy, December 1975, accessed April 2020.

100,000 = Converts Btu to Therms

For example, a 10,000 MBH firetube steam boiler in a Manufacturing facility in Rockford. The scaling on the tubes was estimated to be of 'normal' thickness and the steam supply was 'low pressure' at 15 psig.

ΔTherms = (Capacity * EFLH * %Ei) / 100,000

= (10,000,000 * 1,048 * 0.025) / 100,000

= 2,620 Therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-BCHD-V02-240101

REVIEW DEADLINE: 1/1/2029

4.4.50 Electric Chillers with Integrated Variable Speed Drives – Removed V12

4.4.51 Advanced Rooftop Controls with High Rotor Pole Switch Reluctance Motors

DESCRIPTION

A High Rotor Pole Switch Reluctance Motor (HRSRM) is a type of brushless DC electric motor that runs by reluctance torque. Unlike other DC motor types, power is delivered to windings in the stator rather than the rotor. This simplifies the mechanical design; power does not need to be delivered to a moving part, but requires a switching system through software control to deliver power to the different windings. Electronic devices can precisely time switch, facilitating HRSRM configurations.

In applications on rooftop units (RTUs), the HRSRM motor is comparable or more efficient than an RTU equipped with a variable speed drive supply fan. It results in fan-energy savings and can also include cooling savings if coupled with compressor or ventilation control, compared to a baseline scenario of constant-volume, constant-ventilation operation that is typical of single-zone, packaged HVAC units.

Fan energy savings come from the new integrated motor controls that allow for higher efficiency at varying loads and is achieved in all applications. Cooling savings can also be added from the effective use of variable speed or multi-stage cooling.

The markets that can be served by HRSRM motors are those which utilize RTUs, including but not limited to:

1 Fast-Service Restaurant
2 Full-Service Restaurant
3 Small Office
4 Stand-Alone Retail
5 Strip Mall
6 Warehouse

This measure was developed to be applicable to the following program types: NC, RF, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a single-zone, packaged HVAC unit with an existing functional integrated economizer that has been fitted with a HRSRM supply-fan and integrated speed control. This applies to both retrofit and new construction, and early replacement applications.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a single-zone, packaged HVAC unit (with an existing functional integrated economizer) that lacks demand-controlled ventilation controls and lacks supply-fan speed control via a variable-frequency drive.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 12 years based on the HRSRM life.[1096]

DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the deemed measure cost below can be used. Material cost is based on the horsepower (hp) of the supply fan used in the RTU. Retrofit represents the full cost of the installation. New construction and early replacement represent the incremental cost of the motor itself on a new unit.[1097]

[1096] Based on life cycle of a switch reluctance motor from P. Andrada, B. Blanque, E. Martınez, J.I. Perat, J.A. Sanchez, and M. Torrent, "Environmental and life cycle cost analysis of one switched reluctance motor drive and two inverter-fed induction motor drives," IET Electric Power Applications (2010): page 8.
[1097] Based on cost data from Turntide on HRSRM motors, https://turntide.com

Deemed Measure Cost Details

Type	HP	Material Cost	Labor Hours	Labor Rate	Deemed Cost
Retrofit	1	$1,554.75	3	$96.67	$1,844.76
Retrofit	1.5	$1,580.75	3	$96.67	$1,870.76
Retrofit	2	$1,644.75	3	$96.67	$1,934.76
Retrofit	5	$1,758.75	3	$96.67	$2,048.76
Retrofit	7.5	$2,417.75	3	$96.67	$2,707.76
Retrofit	10	$2,587.75	3	$96.67	$2,877.76
New Construction/Early Replacement	1	$932.85	-	-	$932.85
New Construction/Early Replacement	1.5	$948.45	-	-	$948.45
New Construction/Early Replacement	2	$986.85	-	-	$986.85
New Construction/Early Replacement	5	$1,055.25	-	-	$1,055.25
New Construction/Early Replacement	7.5	$1,450.65	-	-	$1,450.65
New Construction/Early Replacement	10	$1,552.65	-	-	$1,552.65

LOADSHAPE

Commercial ventilation C23

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1098]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1099]

[1098] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1099] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

Algorithm

CALCULATION OF ENERGY SAVINGS

Six different building types were selected for study. OpenStudio measures were used to generate ASHRAE 90.1-2013 code-compliant DOE prototype baseline models for each building type. The total conditioned area, the number of conditioned zones, and the peak cooling demand for each building are summarized in the following table.[1100]

Selected DOE Prototype Buildings

Building Type	Small Office	Stand-Alone Retail	Warehouse	Strip Mall	Fast-Service Restaurant	Full-Service Restaurant
Conditioned Area (ft2)	5,502	24,692	52,045	22,500	2,501	5,502
Number of Conditioned Zones	5	4	3	10	2	2
Total Fan Break Horsepower (BHP)	3.5	25	5	23	7	11
Design Cooling Load (Ton)	8.5	65	13	69	20	33

In order to achieve savings, the RTU control options consist of following modes:

1. Ventilation Mode:
a. Outdoor air is at a minimum for building type
b. Fan speed set to 40%
c. Heating and cooling coils are off
2. Economizer Mode
a. Outdoor air rate was set from 40% and increased as needed to satisfy indoor air temperature
b. When outdoor air could no longer satisfy cooling, cooling mode was staged on
3. Mechanical Cooling Mode
a. Outdoor air is at a minimum for building type
b. Compressors (if multiple or variable) were staged/modulated to meet setpoint temperature of the space
c. Supply fan set to 100%
4. Heating mode
a. Outdoor air is at a minimum for building type
b. Heating coil staged as necessary
c. Supply fan set to 100%

The models produced a percentage energy savings based on using a HRSRM fan and varying compressor types. Retrofit savings include fan only. For new construction and early replacement, savings are based on compressor type and energy efficiency of the unit. These RTU control options are reflected in the table below. As a correction to these entries, a second set of single two-stage compressor RTU fan options are also reflected in the *Energy Savings Type: ESF_Fan* entry in the table below[1101] and are characterized by the following speed settings:

1. Ventilation Mode:
a. Outdoor air is at a minimum for building type
b. Supply fan set to 40%
c. Heating and cooling coils are off
2. Economizer Mode:

[1100] Korbaga Woldekidan, Daniel Studer, and Ramin Faramarzi, "Performance Evaluation of Three RTU Energy Efficiency Technologies," 2019.
[1101] Lick, A., A. Cardiel, J. Zhou, S. Hackel, S. Pigg, and K. Gries. "Switched-Reluctance Motor Field Evaluation Final Report." Slipstream project report for the ComEd Energy Efficiency Program. March 25, 2022. https://comedemergingtech.com/project/srm-field-evaluation

a. No change compared to existing RTU settings
3. Mechanical Cooling Mode (Stage 1):
a. Outdoor air is at a minimum for building type
b. Compressor stage 1 ON
c. Supply fan set to 75%
4. Mechanical Cooling Mode (Stage 2):
a. Outdoor air is at a minimum for building type
b. Compressor stage 1 & 2 ON
c. Supply fan set to 90%
5. Heating Mode:
a. Outdoor air is at a minimum for building type
b. Heating coil staged as necessary
c. Supply fan set to 90%

ELECTRIC ENERGY SAVINGS

For units with cooling capacities less than 65 kBtu/hr:

$$\Delta kWH = (kBtu/hr) * (1/SEER2_{exist}) * EFLH * ESF_Cooling + 0.746 * FanHP * (LF/\eta_{motor}) * RunHours * ESF_Fan$$

For units with cooling capacities equal to or greater than 65 kBtu/hr:

$$\Delta kWH = (kBtu/hr) * (1/IEER_{exist}) * EFLH * ESF_Cooling + 0.746 * FanHP * (LF/\eta_{motor}) * RunHours * ESF_Fan$$

Where:

kBtu/hr = capacity of the cooling equipment in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr)

$SEER2_{exist}$ = Seasonal Energy Efficiency Ratio of the existing equipment * Distribution Efficiency

= Actual. Or assume Code base in place at the original time of existing unit installation. IECC 2018 (effective July 1, 2019 to December 31, 2023), IECC 2021 (effective January 1, 2024 to November 29, 2025), and IECC 2024 (effective statewide November 30, 2025) provided below for referenced, and assume distribution efficiency of 0.95. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints. If unknown, assume a value of 11.1 SEER2.[1102]

$IEER_{exist}$ = Integrated Energy Efficiency Ratio of the existing equipment * Distribution Efficiency

= Actual. Or assume Code base in place at the original time of existing unit installation. IECC 2018 (effective July 1, 2019 to December 31, 2023), IECC 2021 (effective January 1, 2024 to November 29, 2025), and IECC 2024 (effective statewide November 30, 2025) provided below for reference, and assume distribution efficiency of 0.95. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in Illinois TRM version 8.0 section 4.4 HVAC End Use

ESF_Cooling = Energy savings factor for cooling as found in **Error! Reference source not found.**[1103]

[1102] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER value converted to SEER2 by multiplying by 0.95, and multiply by 0.95 distribution efficiency.
[1103] Average cooling savings for all building types from paper entitled "Performance Evaluation of Three RTU Energy Efficiency Technologies", NREL and ComEd, December 2020. Savings averaged by RTU compressor type.

ESF_Fan = Energy savings factor for cooling as found in table below[1104]

Energy Savings Factors

Energy Savings Type	Retrofit Type	HRSRM on Single Stage Compressor	HRSRM on Single Two Stage Compressor	HRSRM on Variable Speed Compressor
ESF_Cooling[1105]	New Construction/Early Replacement	0%	0%	0%
ESF_Cooling[1106]	Supply Fan Retrofit Only	0.0%	0.0%	0.0%
ESF_Fan[1106]	New Construction/Early Replacement	46.6%	61.0%	64.8%
ESF_Fan[1106]	Supply Fan Retrofit Only	46.6%	61.0%	64.8%

FanHP = Horsepower of fan in RTU

= Actual

LF = Load Factor; Motor Load at Fan Design CFM (Default = 65%)[1107]

η_{motor} = Installed nominal/nameplate motor efficiency

Default motor is a NEMA Premium efficiency, ODP, 4-pole/1800 RPM fan motor

NEMA Premium Efficiency Motors Default Efficiencies[1108]

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924

[1104] Based on forthcoming ComEd Field Study (final results TBD)

[1105] Energy savings in this row only are due to control of the RTU that goes beyond solely fan motor replacement and utilizes additional control like ventilation or compressor control. Measures should incorporate additional control to claim savings here. See related footnotes for details.

[1106] The numbers in the "HRSRM on Single Two Stage Compressor" column are based on the field study "Switched-Reluctance Motor Field Evaluation Final Report", Prepared for ComEd by Slipstream, March 25, 2022. The numbers in the other two columns are based on the field study and the simulation study "Performance Evaluation of Three RTU Energy Efficiency Technologies", NREL and ComEd, December 2020.

[1107] Lawrence Berkeley National Laboratory, and Resource Dynamics Corporation. (2008). "Improving Motor and Drive System Performance; A Sourcebook for Industry". U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy. Golden, CO: National Renewable Energy Laboratory.

[1108] Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

RunHours = Annual operating hours for fan motor based on building type

= Default hours are provided for HVAC applications which vary by HVAC application and building type in the following table.[1109] When available, actual hours should be used.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Assembly	2,374	OpenStudio	VAV
Assisted Living	6,375	OpenStudio	CAV
Auto Dealership	5,326	OpenStudio	CAV
Childcare/Pre-School	2,177	OpenStudio	CAV and VAV
College	3,753	OpenStudio	CAV and VAV
Convenience Store	8,760	OpenStudio	CAV
Drug Store	6,034	OpenStudio	CAV
Elementary School	2,305	OpenStudio	VAV
Emergency Services	8,760	OpenStudio	CAV
Garage	7,357	eQuest	CAV
Grocery	7,568	OpenStudio	CAV
Healthcare Clinic	4,471	OpenStudio	VAV
High School	3,118	OpenStudio	VAV
Hospital - CAV no econ	7,166	OpenStudio	CAV
Hospital - CAV econ	7,225	OpenStudio	CAV
Hospital - VAV econ	3,757	OpenStudio	VAV
Hospital - FCU	4,727	OpenStudio	CAV

[1109] Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the fans are operating for heating, cooling, and ventilation for each building type.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Hospital - Unknown	5,719	OpenStudio	Average of hospital models
Hotel/Motel	3,712	OpenStudio	CAV
Hotel/Motel - Common	8,678	OpenStudio	CAV
Hotel/Motel - Guest	2,112	OpenStudio	CAV
Manufacturing Facility_Miscellaneous	2,267	OpenStudio	CAV
Manufacturing Facility_Food/Chemical	4,702	OpenStudio	CAV
MF - High Rise	2,617	OpenStudio	CAV
MF - High Rise - Common	3,411	OpenStudio	CAV
MF - High Rise - Residential	2,613	OpenStudio	CAV
MF - Mid Rise	8,450	OpenStudio	CAV
Movie Theater	1,779	OpenStudio	VAV
Office - High Rise - CAV no econ	5,459	OpenStudio	CAV
Office - High Rise - CAV econ	5,430	OpenStudio	CAV
Office - High Rise - VAV econ	2,884	OpenStudio	VAV
Office - High Rise - FCU	2,130	OpenStudio	CAV
Office - Low Rise	4,721	OpenStudio	CAV
Office - Mid Rise	3,413	OpenStudio	VAV
Religious Building	3,783	OpenStudio	VAV
Restaurant	8,226	OpenStudio	CAV
Retail - Department Store	5,245	OpenStudio	CAV
Retail - Strip Mall	4,189	OpenStudio	CAV
Warehouse Nonrefrigerated	3,142	OpenStudio	CAV
Warehouse Refrigerated	3,076	OpenStudio	CAV
Medical Office	3,498	OpenStudio	VAV
Unknown	3991	n/a	n/a

2018 IECC Minimum Efficiency Requirements (baseline effective 7/1/2019 to 12/31/2023)

TABLE C403.3.2(1)
MINIMUM EFFICIENCY REQUIREMENTS: ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS

EQUIPMENT TYPE	SIZE CATEGORY	HEATING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split System	13.0 SEER	AHRI 210/240
			Single Package	14.0 SEER	
Through-the-wall (air cooled)	≤ 30,000 Btu/h[b]	All	Split system	12.0 SEER	
			Single Package	12.0 SEER	
Small-duct high-velocity (air cooled)	< 65,000 Btu/h[b]	All	Split System	11.0 SEER	
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.2 EER 12.8 IEER	AHRI 340/360
		All other	Split System and Single Package	11.0 EER 12.6 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.0 EER 12.4 IEER	
		All other	Split System and Single Package	10.8 EER 12.2 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	10.0 EER 11.6 IEER	
		All other	Split System and Single Package	9.8 EER 11.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	9.7 EER 11.2 IEER	
		All other	Split System and Single Package	9.5 EER 11.0 IEER	
Air conditioners, water cooled	< 65,000 Btu/h[b]	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 13.9 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.5 EER 13.9 IEER	
		All other	Split System and Single Package	12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.4 EER 13.6 IEER	
		All other	Split System and Single Package	12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.2 EER 13.5 IEER	
		All other	Split System and Single Package	12.0 EER 13.3 IEER	

Air conditioners, evaporatively cooled	< 65,000 Btu/h[b]	All	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.1 EER 12.3 IEER	AHRI 340/360
		All other	Split System and Single Package	11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	12.0 EER 12.2 IEER	
		All other	Split System and Single Package	11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.9 EER 12.1 IEER	
		All other	Split System and Single Package	11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric Resistance (or None)	Split System and Single Package	11.7 EER 11.9 IEER	
		All other	Split System and Single Package	11.5 EER 11.7 IEER	
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced test procedure, including the reference year version of the test procedure.

b. Single-phase, air-cooled air conditioners less than 65,000 Btu/h are regulated by NAECA. SEER values are those set by NAECA.

2021 IECC Minimum Efficiency Requirements (effective January 1, 2024 to November 29, 2025)

TABLE C403.3.2(1)
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	13.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single-package, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	
Space constrained, air cooled	≤ 30,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	
Small duct, high velocity, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 12.1 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	11.2 EER 12.9 IEER before 1/1/2023 14.8 IEER after 1/1/2023	AHRI 340/360
		All other		11.0 EER 12.7 IEER before 1/1/2023 14.6 IEER after 1/1/2023	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		11.0 EER 12.4 IEER before 1/1/2023 14.2 IEER after 1/1/2023	
		All other		10.8 EER 12.2 IEER before 1/1/2023 14.0 IEER after 1/1/2023	

TABLE C403.3.2(1)—continued
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[b, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled *(continued)*	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)	Split system and single package	10.0 EER 11.6 IEER before 1/1/2023 13.2 IEER after 1/1/2023	AHRI 340/360
		All other		9.8 EER 11.4 IEER before 1/1/2023 13.0 IEER after 1/1/2023	
	≥ 760,000 Btu/h	Electric resistance (or none)		9.7 EER 11.2 IEER before 1/1/2023 12.5 IEER after 1/1/2023	
		All other		9.5 EER 11.0 IEER before 1/1/2023 12.3 IEER after 1/1/2023	
Air conditioners, water cooled	< 65,000 Btu/h	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 13.9 IEER	AHRI 340/360
		All other		11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.5 EER 13.9 IEER	
		All other		12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		12.4 EER 13.6 IEER	
		All other		12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		12.2 EER 13.5 IEER	
		All other		12.0 EER 13.3 IEER	

TABLE C403.3.2(1)—continued
ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS—MINIMUM EFFICIENCY REQUIREMENTS[c, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, evaporatively cooled	< 65,000 Btu/h[b]	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 12.3 IEER	AHRI 340/360
		All other		11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.0 EER 12.2 IEER	
		All other		11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		11.9 EER 12.1 IEER	
		All other		11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		11.7 EER 11.9 IEER	
		All other		11.5 EER 11.7 IEER	
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365

2024 IECC Minimum Efficiency Requirements

TABLE C403.3.2(1)—ELECTRICALLY OPERATED UNITARY AIR CONDITIONERS AND CONDENSING UNITS MINIMUM EFFICIENCY REQUIREMENTS[c]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air conditioners, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	13.4 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	13.4 SEER2	
Space constrained, air cooled	≤ 30,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	11.7 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	11.7 SEER2	
Small duct, high velocity, air cooled	< 65,000 Btu/h[b]	All	Split system, three phase and applications outside US single phase[b]	12. 0 SEER2	AHRI 210/240—2023
Air conditioners, air cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	14.8 IEER	AHRI 340/360
		All other		14.6 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		14.2 IEER	
		All other		14.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)	Split system and single package	13.2 IEER	AHRI 340/360
		All other		13.0 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		12.5 IEER	
		All other		12.3 IEER	

IECC 2024 Table c403.3.2(1) continued.

Air conditioners, water cooled	< 65,000 Btu/h	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 13.9 IEER	AHRI 340/360
		All other		11.9 EER 13.7 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.5 EER 13.9 IEER	
		All other		12.3 EER 13.7 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		12.4 EER 13.6 IEER	
		All other		12.2 EER 13.4 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		12.2 EER 13.5 IEER	
		All other		12.0 EER 13.3 IEER	
Air conditioners, evaporatively cooled	< 65,000 Btu/h[b]	All	Split system and single package	12.1 EER 12.3 IEER	AHRI 210/240
	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)		12.1 EER 12.3 IEER	AHRI 340/360
		All other		11.9 EER 12.1 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		12.0 EER 12.2 IEER	
		All other		11.8 EER 12.0 IEER	
	≥ 240,000 Btu/h and < 760,000 Btu/h	Electric resistance (or none)		11.9 EER 12.1 IEER	
		All other		11.7 EER 11.9 IEER	
	≥ 760,000 Btu/h	Electric resistance (or none)		11.7 EER 11.9 IEER	
		All other		11.5 EER 11.7 IEER	
Condensing units, air cooled	≥ 135,000 Btu/h	—	—	10.5 EER 11.8 IEER	AHRI 365
Condensing units, water cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365
Condensing units, evaporatively cooled	≥ 135,000 Btu/h	—	—	13.5 EER 14.0 IEER	AHRI 365

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.

b. Single-phase, US air-cooled air conditioners less than 65,000 Btu/h are regulated as consumer products by the US Department of Energy Code of Federal Regulations DOE 10 CFR 430. SEER and SEER2 values for single-phase products are set by the US Department of Energy.

c. DOE 10 CFR 430 Subpart B Appendix M1 includes the test procedure updates effective January 1, 2023, documented in AHRI 210/240—2023.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = [(kBtu/hr) * (1/EER_{exist}) * ESF_Cooling + 0.746 * FanHP * (LF/\eta_{motor}) * ESF_Fan] * CF$$

Where:

EER_{exist} = Energy Efficiency Ratio of the existing equipment * Distribution Efficiency (assume the following conversion from SEER to EER for calculation of peak savings: EER = (-0.02 * SEER2) + (1.12 * SEER))

= Actual, or assume Code base in place at the original time of existing unit installation, and assume 95% distribution efficiency. If unknown assume 10.2EER2[1110]

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-HSRM-V08-270101

REVIEW DEADLINE: 1/1/2028

[1110] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95.

4.4.52 Hydronic Heating Radiator Replacement

DESCRIPTION

A hydronic heating radiator's capacity to evenly and consistently distribute heat throughout a space, utilizing piped hot-water or steam is often stymied by the buildup of mineral deposits and contaminates. Past research has shown that eliminating these deposits regularizes flow rate and boiler behavior, in effect restoring a radiator to a like-new condition.[1111] A space is heated more effectively in this improved state and this condition furthermore reduces the need for continual (additionally wasteful) thermostat readjustment. A straightforward process to achieve this is to simply replace the fouled hydronic radiator pipe system with a new system equivalent to the replaced system's pre-fouled performance levels. This avoids any possible inconsistencies associated with a radiator-flushing procedure (e.g., less-than-expected savings, failure to return the pipe system to like-new condition, inability to treat a system due to its interlinking with separate domestic hot water systems, etc.) and furthermore ensures that expected savings are realized. This measure offers benefits during heating seasons for natural gas, is applicable to both residential and commercial applications, and considers hot water or steam as the source of thermal energy (seeing as both heat transfer mediums can theoretically act as the intermediary from which contaminates precipitate).

The calculations of savings presented in this section are furthermore normalized to apply to both commercial and multi-family residential applications and additionally consider the differences between the physical characteristics of hot water or steam (e.g., thermal resistance, temperature, convective heat transfer) when computing the savings tabulated in the 'Annual Normalized Gas Savings per Surface Area' table shown below.

This measure was developed to be applicable to the following program types: RF

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a new replacement hydronic radiator free of mineral deposit scaling and/or sludge which must reflect the capacity of the replaced system's pre-fouled performance levels (i.e., a "like-for-like" replacement).

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is the hydronic radiator being replaced, which has shown decreased performance due to a high degree of mineral deposit scaling and sludge buildup. The built-up scale inside the radiators is predominantly assumed to be Iron Oxide (Fe_3O_4) and to have a thermal conductivity of 3.01 Btu/hr·ft·°F.[1112]

A "standard scaled" radiator is assumed to be 10% clogged and a "heavily scaled" radiator is assumed to be 30% clogged. An implementation contractor will need to verify the baseline condition of the radiator, to classify it as either standard or heavily scaled. Measuring the surface temperature spread using an infrared temperature thermometer can be used to determine this; surface temperature spot readings below 180°F for a steam system and below 100°F for a hot water system can be labeled as 'standard scaling'. A "heavily scaled" radiator is assumed to one with surface temperature spots below 150°F for a steam system and below 90°F for a hot water system.[1113] This should be verified by the implementation contractor by measuring the radiator surface temperature at multiple points when operating the boiler system at full load and when outdoor air temperatures are below 20°F. Implementer should strive to perform spot readings on at least 10% of total radiators. Based on the collected spot temperature readings, qualify the facility as either standard scaled or heavily scaled.

[1111] Day, Paul and Balmer, Paul. "Independent Study Shows Sludge Build-up Significantly Affects Hydronic Heating System Performance," May, 2011. Accessed 03/25/20.

[1112] The thermal properties of Iron Oxide are referenced from the following: Takeda, Mikako and Onishi, Takashi and Nakakubo, Shouhei and Fujimoto, Shinji. "Physical Properties of Iron-Oxide Scales on Si-Containing Steels at High Temperature," Materials Transactions Vol 50, No. 9 (2009): pp. 2242-2246. dio:10.2320/matertrans.M2009097.

[1113] Assumptions based on typical operating hot water/steam supply temperatures for cast-iron radiators of 170°F and 220°F. 'Clogged' surface temperature assumptions based on temperatures below which performance of radiators starts dropping considerably.

The baseline for this measure is aging scaled radiators. Most facilities tend not to replace their old radiators and often tend to add a means of secondary heating. This measure is aimed at these facilities to incentivize the replacement of these old radiators.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

Hydronic radiator systems are extremely diverse, in size, scope or application, and in the materials utilized for the heat transfer surface. Cast iron, steel, and copper piping are common in radiators, as are polymer materials such as polyethylene (often seen in newer radiator systems). As such, an estimated useful life will naturally vary based on these circumstances and the quality of previous radiator maintenance. The estimated useful life of a typical hydronic radiator has been approximated to be 25 years.[1114]

DEEMED MEASURE COST

The measure cost is the full cost of removing the existing unit and installing a new one. The actual program cost should be used. If unknown, assume $61.35 per vertical column.[1115] For more details on the definition of section of a radiator, the cited reference can be used.[1116]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

The annual natural gas savings per area for radiator replacement is calculated by determining the difference between the heat transfer from the replacement radiator and the radiator being replaced.

$$\Delta Therms = \frac{\left[[Q_{New} - Q_{Base}] * EFLH\right]}{(100{,}000 * \eta)}$$

$$Q_{Base} = \frac{(A * \Delta T)}{R_{Base}}$$

[1114] Examples from the following source use "system design lives" of 20 and 25 years, and cite the service lifetimes of a cast iron hydronic radiator's boiler to often be "30 years or more".
Siegenthaler, John, Modern Hydronic Heating: For Residential and Light Commercial Buildings 3rd Edition, Delmar Cengage Learning, Clifton Park, New York, 2012.
There is limited information available on system lifetimes of hydronic radiators, as well-built and well-maintained systems tend to last for decades. We assume that a midpoint of the "design-lifes" cited above (25) can correspond to the time a hydronic radiator system begins to underperform, with one known reason for underperformance (which also happens to be the focus of this measure) being the corrosion of piping materials and/or the presence of precipitated mineral contaminates restricting flow rate and thus hindering heat transfer.

[1115] Average calculated from RSMeans Cost Data 2020 for Hydronic Heating Radiators, Cast Iron.

[1116] Express Radiant, "Calculating Radiator Output", 2014. This reference shows a representation of how a section of a typical radiator is defined.

$$R_{Base} = R_{conv1} + R_{cond} + \left(\frac{R_{rad} * R_{conv2}}{R_{rad} + R_{conv2}}\right)$$

$$Q_{New} = \frac{(A * \Delta T)}{R_{New}}$$

The thermal resistance components remain the same as the above (R_{Base}), with the exception of the contaminate oxide layer which is no longer present in the post-case:

$$R_{New} = R_{conv1} + \left(\frac{R_{rad} * R_{conv2}}{R_{rad} + R_{conv2}}\right)$$

Where:

Q_{New} (Btu/hr) = The heat emission from the replacement hydronic heating system

Q_{Base} (Btu/hr) = The heat emission from the hydronic heating system being replaced

$EFLH$ = Effective full load hours based on the climate zone

Heating Season Recirculation Hours

Climate Zone	Hours
1 – Rockford	5,039
2 – Chicago	4,963
3 – Springfield	4,495
4 – Belleville	4,021
5 – Marion	4,150

η = Actual Thermal Efficiency of the Heating Equipment (if unknown, use 81.9% for water boilers[1117] and 80.7% for steam boilers[1118])

$100{,}000$ = conversion factor (1 Therm = 100,000 Btu)

A (ft^2) = the effective area of heat transfer of the radiator[1119]

ΔT (°F) = the temperature difference between the supply fluid temperature and the conditioned room design temperature

R_{Base} (ft2 °F hr/ BTU) = the overall thermal resistance of the system before replacement

R_{New} (ft2 °F hr/ BTU) = the overall thermal resistance of the system after replacement

R_{conv1}(ft2 °F hr/ BTU) = the thermal resistance of convection between the hot water/steam and the radiator[1120]

R_{cond}(ft2 °F hr/ BTU) = the thermal resistance of conduction in the oxide layer buildup[1121]

[1117] Average efficiencies of units from the California Energy Commission (CEC).

[1118] Ibid.

[1119] The pipe diameter is assumed to be 2 inches and the thickness of mineral deposits in a fouled radiator (which, recall, are assumed to be composed of iron oxide), is a function of the percent of the pipe diameter which is clogged and the assumed pipe diameter.

[1120] For a steam system, the supply temperature is assumed to be 220°F. For a hot water system, the supply temperature is assumed to be 170°F. This implies convective heat transfer coefficients of 1,100 Btu/hr·ft^2·°F and 700 Btu/hr·ft^2·°F for steam and hot water, respectively, the inverses of which equate to steam's or hot water's thermal resistances.

[1121] Recall that iron oxide has a thermal conductivity of 3.01 Btu/hr·ft^2·°F.

$R_{rad}(\text{ft2 °F hr/ BTU})$ = the thermal resistance of radiation between the radiator and the conditioned space[1122]

$R_{conv2}(\text{ft2 °F hr/ BTU})$ = the thermal resistance of convection between radiator and the conditioned space[1123]

Annual Normalized Gas Savings per Surface Area (therms/ft^2)

HVAC System Type		1 – Rockford	2 – Chicago	3 – Springfield	4 – Belleville	5 – Marion
Hot Water Radiator	Standard Scaling	0.115	0.113	0.102	0.091	0.094
	Heavy Scaling	0.337	0.332	0.301	0.269	0.278
Steam Radiator	Standard Scaling	0.170	0.168	0.152	0.136	0.140
	Heavy Scaling	0.501	0.493	0.447	0.400	0.413

$$\Delta Therms = HS_{cz} * Area_{radiator}$$

Where:

HS_{cz} = Annual heating savings per area of radiator by climate zone, values from 'Annual Normalized Gas Savings per Surface Area' table above.

$Area_{radiator}$ = Total surface area of radiator (ft^2)

Example:

For example, a building in Climate Zone 1 is equipped with a heavily scaled steam radiator system. The surface area of the replacement and radiator being replaced was calculated to be 85 ft^2.

$\Delta Therms$ = Annual Normalized Gas Savings (therms/ft^2) * Surface Area (ft^2)

= 0.501 * 85

= 42.59 therms annually

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-HHRR-V02-240101

REVIEW DEADLINE: 1/1/2028

[1122] Stefan-Boltzmann constant is assumed to be 1.714×10^{-9} BTU·hr^{-1}·ft^{-2}·°R^{-4}.

[1123] The convective heat transfer coefficient of Air is assumed to be 1.844 Btu/hr·ft^2·°F. Emissivity of radiator surface is assumed to be 0.6.

4.4.53 HVAC Supply, Return and Exhaust Fans – Fan Energy Index

DESCRIPTION

The Fan Energy Index (FEI) is a new fan efficiency metric that allows for the comparison of different fans at application specific operating conditions. This is a significant improvement over the current Fan Efficiency Grade metric, which is defined at a rated condition. FEI is incorporated in ASHRAE 90.1-2019 and IECC-2024. These codes set the baseline FEI as 1.0 for constant speed fan operation and 0.95 for variable speed fan operation. More efficient fans will have FEI greater than these values. It is only applicable to stand-alone fans, and not for fans embedded in packaged equipment. This measure results in fan energy savings compared to a baseline scenario of an existing fan's FEI or code minimum FEI for a new fan.

Note this measure should be used for evaluating more efficient over baseline fans with the same control system. Measure 4.4.26 should be utilized to evaluate control system modifications. When combining the two measures, the FEP_{New} value should be used to replace the $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right)$ term in Measure 4.4.26 Variable Speed Drive for HVAC Supply and Return Fans.

This measure serves the market for commercial and industrial buildings.

This measure was developed to be applicable to the following program types: TOS, NC, and EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to exceed the efficiency requirements defined by the program.

DEFINITION OF BASELINE EQUIPMENT

For Time of Sale (TOS): The baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit or sale (if unknown assume IECC 2024).

For New Construction (NC): The baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit (if unknown assume IECC 2024). As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

For Early Replacement (EREP): The baseline equipment is assumed to be the existing fan.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

For variable speed fans, the expected measure life is 15 years.[1124]

For constant speed fans, the expected measure life is 18 years for centrifugal housed and unhoused fans. The expected measure life is 25 years for all other fan types.[1125]

DEEMED MEASURE COST

Actual measure costs should be used if available. Default measure costs are noted below for fans with FEI greater than 1.0[1126]. These costs are established at an FEI of 1.2. To calculate the cost for a fan with different FEI, prorate the default cost with the actual FEI (see example).

[1124] "NEEP Incremental Cost Study – Phase II Final Report, Navigant, 2013."

[1125] U.S. Department of Energy Fans and Blowers Working Group, Energy Conservation Program: Final Determination of Fans and Blowers as Covered Equipment

[1126] Costs are based on the U.S. Department of Energy Fans and Blowers Working Group spreadsheet: EERE-2013-BT-STD-0006-0189_attachment_1.xlsx.

TOS and NC

Fan Type	Cost ($/hp)	
	Small (< 10 hp)	Large (>= 10 hp)
Axial Cylindrical Housed	$264	$87
Panel	$29	$10
Centrifugal Housed	$199	$55
Centrifugal Unhoused	$76	$18
Inline and Mixed Flow	$297	$97
Radial	$119	$33
Power Roof Ventilator	$140	$42

EREP

Fan Type	Cost ($/hp)	
	Small (< 10 hp)	Large (>= 10 hp)
Axial Cylindrical Housed	$3,218	$1,068
Panel	$319	$104
Centrifugal Housed	$1,381	$382
Centrifugal Unhoused	$827	$195
Inline and Mixed Flow	$2,301	$751
Radial	$1,570	$434
Power Roof Ventilator	$1,536	$460

For example, the default deemed measure cost of installing a new construction, centrifugal housed, 5 hp fan with FEI = 1.3 is:

Deemed Measure Costs ($) = $199 per hp *5 hp * (1.3 / 1.2) = $1,078

LOADSHAPE

Loadshape C39 – VFD – Supply fans <10 HP

Loadshape C40 – VFD – Return fans <10 HP

Loadshape C41 – VFD – Exhaust fans <10 HP

COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Note this measure should be used for evaluating more efficient over baseline fans with the same control system. Measure 4.4.26 Variable Speed Drives for HVAC Supply and Return Fans should be utilized to evaluate control system modifications. When combining the two measures, the FEP_{New} value should be used to replace the $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right)$ term in Measure 4.4.26.

$$\Delta kWh_{fan} = FEP_{New} * (\frac{FEI_{New}}{FEI_{Base}} - 1) * RHRS * \sum_{0\%}^{100\%} (\%FF * PLR)$$

$$\Delta kWh_{total} = \Delta kWh_{fan} * (1 + IE_{energy})$$

Where:

ΔkWh_{fan} = Fan-only annual energy savings (kWh)

FEP_{New} = Fan Electrical Power of new fan at 100% flow fraction (kW)

FEI_{New} = Fan Energy Index of new fan at 100% flow fraction (-)

FEI_{Base} = Fan Energy Index of baseline fan at 100% flow fraction (-)

TOS and NC: FEI_{base} is defined per IECC.

= 0.95 for Variable Speed Fan

= 1.0 for Constant Speed Fan

EREP: FEI_{base} is defined as existing fan efficiency. If unknown, use:[1127]

Fan Type	Drive Type		
	Variable Speed – Belt	Constant Speed – Belt	Constant Speed – Direct
Axial Cylindrical Housed	0.88	0.88	0.97
Panel	0.95	0.95	0.88
Centrifugal Housed	0.92	0.92	0.92
Centrifugal Unhoused	0.94	0.94	1.03
Inline and Mixed Flow	0.79	0.79	0.77
Radial	0.81	0.81	0.94
Power Roof Ventilator	0.82	0.82	0.76

RHRS = Annual operating hours for fan based on building type

Default hours are provided for HVAC applications which vary by HVAC application and building type.[1128] When available (provided via Energy Management Software or metered), actual hours should be used.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Assembly	2,374	OpenStudio	VAV
Assisted Living	6,375	OpenStudio	CAV
Auto Dealership	5,326	OpenStudio	CAV
Childcare/Pre-School	2,177	OpenStudio	CAV and VAV
College	3,753	OpenStudio	CAV and VAV

[1127] "Fan Energy Index Market Research: Final Report", prepared for ComEd by Slipstream, May 2021.

[1128] Hours per year are estimated using the eQuest or OpenStudio models as the total number of hours the fans are operating for heating, cooling and ventilation for each building type.

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Convenience Store	8,760	OpenStudio	CAV
Drug Store	6,034	OpenStudio	CAV
Elementary School	2,305	OpenStudio	VAV
Emergency Services	8,760	OpenStudio	CAV
Garage	7,357	eQuest	CAV
Grocery	7,568	OpenStudio	CAV
Healthcare Clinic	4,471	OpenStudio	VAV
High School	3,118	OpenStudio	VAV
Hospital - CAV no econ	7,166	OpenStudio	CAV
Hospital - CAV econ	7,225	OpenStudio	CAV
Hospital - VAV econ	3,757	OpenStudio	VAV
Hospital - FCU	4,727	OpenStudio	CAV
Hospital - Unknown	5,719	OpenStudio	Average of hospital models
Hotel/Motel	3,712	OpenStudio	CAV
Hotel/Motel - Common	8,678	OpenStudio	CAV
Hotel/Motel - Guest	2,112	OpenStudio	CAV
Manufacturing Facility_Miscellaneous	2,267	OpenStudio	CAV
Manufacturing Facility_Food/Chemical	4,702	OpenStudio	CAV
MF - High Rise	2,617	OpenStudio	CAV
MF - High Rise - Common	3,411	OpenStudio	CAV
MF - High Rise - Residential	2,613	OpenStudio	CAV
MF - Mid Rise	8,450	OpenStudio	CAV
Movie Theater	1,779	OpenStudio	VAV
Office - High Rise - CAV no econ	5,459	OpenStudio	CAV
Office - High Rise - CAV econ	5,430	OpenStudio	CAV
Office - High Rise - VAV econ	2,884	OpenStudio	VAV
Office - High Rise - FCU	2,130	OpenStudio	CAV
Office - Low Rise	4,721	OpenStudio	CAV
Office - Mid Rise	3,413	OpenStudio	VAV
Religious Building	3,783	OpenStudio	VAV
Restaurant	8,226	OpenStudio	CAV
Retail - Department Store	5,245	OpenStudio	CAV
Retail - Strip Mall	4,189	OpenStudio	CAV
Warehouse Nonrefrigerated	3,142	OpenStudio	CAV
Warehouse Refrigerated	3,076	OpenStudio	CAV
Medical Office	3,498	OpenStudio	VAV
Unknown	3991	n/a	n/a

%FF = Percentage of run-time spent within a given flow fraction range[1129]

Flow Fraction (% of design cfm)	Percent of Time at Flow Fraction
0% to 10%	0.0%
10% to 20%	1.0%
20% to 30%	5.5%
30% to 40%	15.5%
40% to 50%	22.0%
50% to 60%	25.0%
60% to 70%	19.0%
70% to 80%	8.5%
80% to 90%	3.0%
90% to 100%	0.5%

PLR = Part load ratio for a given flow fraction range[1130]

Control Type	Flow Fraction									
	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%
No Control or Bypass Damper	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Discharge Dampers	0.46	0.55	0.63	0.70	0.77	0.83	0.88	0.93	0.97	1.00
Outlet Damper, BI & Airfoil Fans	0.53	0.53	0.57	0.64	0.72	0.80	0.89	0.96	1.02	1.05
Inlet Damper Box	0.56	0.60	0.62	0.64	0.66	0.69	0.74	0.81	0.92	1.07
Inlet Guide Vane, BI & Airfoil Fans	0.53	0.56	0.57	0.59	0.60	0.62	0.67	0.74	0.85	1.00
Inlet Vane Dampers	0.38	0.40	0.42	0.44	0.48	0.53	0.60	0.70	0.83	0.99
Outlet Damper, FC Fans	0.22	0.26	0.30	0.37	0.45	0.54	0.65	0.77	0.91	1.06
Eddy Current Drives	0.17	0.20	0.25	0.32	0.41	0.51	0.63	0.76	0.90	1.04
Inlet Guide Vane, FC Fans	0.21	0.22	0.23	0.26	0.31	0.39	0.49	0.63	0.81	1.04
VFD with duct static pressure controls	0.09	0.10	0.11	0.15	0.20	0.29	0.41	0.57	0.76	1.01
VFD with low/no duct static pressure	0.05	0.06	0.09	0.12	0.18	0.27	0.39	0.55	0.75	1.00

Provided below are the resultant values based upon the defaults provided above:

Control Type	$\sum_{0\%}^{100\%}(\%FF \times PLR)$
No Control or Bypass Damper	1.00
Discharge Dampers	0.80
Outlet Damper, BI & Airfoil Fans	0.78
Inlet Damper Box	0.69
Inlet Guide Vane, BI & Airfoil Fans	0.63
Inlet Vane Dampers	0.53

[1129] Default Fan Duty Cycle Based on 2012 ASHRAE Handbook; HVAC Systems and Equipment (pg. 45.11, Figure 12)
[1130] Methodology developed and tested in Del Balso, Ryan Joseph. "Investigation into the Reliability of Energy Efficiency/Demand Side Management Savings Estimates for Variable Frequency Drives in Commercial Applications". A project report submitted to the Faculty of the Graduate School of the University of Colorado, 2013.

Control Type	$\sum_{0\%}^{100\%}(\%\boldsymbol{FF} \times \boldsymbol{PLR})$
Outlet Damper, FC Fans	0.53
Eddy Current Drives	0.49
Inlet Guide Vane, FC Fans	0.39
VFD with duct static pressure controls	0.30
VFD with low/no duct static pressure	0.27

ΔkWh_{total} = Total project annual energy savings (kWh)

IE_{energy} = HVAC interactive effects factor for energy (default = 15.7%)

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW_{fan} = $$FEP_{New} * \left(\frac{FEI_{New}}{FEI_{Base}} - 1\right) * PLR_{FFpeak}$$

ΔkW_{total} = $$\Delta \mathrm{kW}_{\mathrm{fan}} * (1 + \mathrm{IE}_{demand})$$

Where:

ΔkW_{fan} = Fan-only summer coincident peak demand impact (kW)

PLR_{Ffpeak} = The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the baseline flow control type (default average flow fraction during peak period = 90%)

ΔkW_{total} = Total project summer coincident peak demand impact (kW)

IE_{demand} = HVAC interactive effects factor summer coincident peak demand (default = 15.7%)

FOSSIL FUEL SAVINGS

There are no expected fossil fuel impacts for this measure.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-FFEI-V05-270101

REVIEW DEADLINE: 1/1/2028

4.4.54 Process Heating Boiler

DESCRIPTION

A process boiler is a pressure vessel that transfers heat to water for industrial process applications. Process boilers can be configured as an integrated packaged boiler or as modular instantaneous boiler arrays. This measure is applicable to boilers which serve process loads in a facility.

Modular instantaneous boilers are a recent addition to the industrial/commercial market aimed at addressing some of the drawbacks of conventional large boiler systems. They achieve high efficiencies by using multiple smaller sized modules to meet the minimum demand. They allow each boiler to operate at or close to full rated load most of the time, with reduced standby losses. The boiler design is a low water mass pressure vessel that produces steam at operating pressure rapidly then shuts off the combustion system once the demand requirement is met, thereby saving fuel.

Traditional packaged boiler systems are designed to provide the entire steam load of the facility using one or two boilers. Typically, the boiler horsepower is sized for the maximum steam load required at any facility. However, the average steam load of any facility is only 30 to 40 percent of this, and the average load on the boiler system is low. Therefore, they are not able to achieve these high efficiencies.[1131]

This measure was developed to be applicable to the following program types: NC, EREP, TOS.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is the replacement of a non-residential standard efficiency process boiler for process loads with a high-efficiency process boiler exceeding the energy conservation standards outlined below. The efficient unit may either be a conventional packaged boiler or a modular boiler array system. Non-residential commercial boilers are defined as having an input rating greater than 300,000 Btu/h.

DEFINITION OF BASELINE EQUIPMENT

For Time of Sale and New Construction:
Gas-fired boilers, termed as commercial packaged boilers, manufactured after March 12, 2012 must comply with the standards defined in the Code of Federal Regulations, 10 CFR 431.87.[1132]

Note, for natural draft steam boilers, as IECC 2024, the Illinois state energy code effective statewide as of November 30, 2025, exceeds the minimum federal efficiency standards, it was replaced in favor of the more aggressive thermal efficiency values in the table below. For new construction applications where the permitting date is prior to the state's adoption of IECC 2024 it is recommended to use the applicable edition of IECC corresponding to that timeline. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Boiler baseline efficiency standards

Boiler Type	Efficiency[1133]
Hot Water Boiler $\geq$ 300,000 Btu/h and $\leq$ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h and $\leq$10,000,000 Btu/h	82% E_C
Hot Water Boiler >10,000,000 Btu/h	82% E_C
Steam Boiler $\geq$ 300,000 Btu/h and $\leq$ 2,500,000 Btu/h	79% E_T

[1131] Modular boiler arrays have greater combustion efficiencies as compared to traditional steam boilers. This has been verified via a field study done by Nicor Gas ETP. The study covered an industrial manufacturing facility with (10) modular process steam boiler systems; the effective efficiency was found to be in line with the rated manufacturer efficiency of 87%.
[1132] Boilers $\geq$ 300,000 Btu/hr, Code of Federal Regulations, 10 CFR 431.87, Table 1 – Commercial Packaged Boiler Energy Conservation Standards.
[1133] Ibid.

Boiler Type	Efficiency[1133]
Steam Boiler ≥ 2,500,000 Btu/h and ≤10,000,000 Btu/h	79% E_T
Steam Boiler > 10,000,000 Btu/h	79% E_T

where E_T means "thermal efficiency" and E_C means "combustion efficiency" as defined in 10 CFR 431.82.

For early replacement: The efficiency of the existing equipment should be used for the assumed remaining useful life of the equipment and a new baseline equipment as described above for the remainder of the measure life.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 25 years.[1134]

For EREP, the remaining useful life of the existing equipment is assumed to be 1/3rd of EUL (25/3) or 8 years.

DEEMED MEASURE COST

The measure cost for this technology is tiered based on the boiler type and combustion efficiencies. As installation costs for the base case and the measure case units are assumed to be the same, labor costs are not specified for this measure.

Incremental and Gross Measure costs for Process Boilers

Boiler Type	Incremental Measure Cost ($/Kbtu)[1135]	Full Measure Cost ($/Kbtu)[1136]
Hot Water Boiler ≥85% E_C and <90% E_C	$2.17	$12.94
Hot Water Boiler ≥90% E_C	$12.17	$22.95
Steam Boiler ≥83% E_C and <85% E_C	$4.35	$19.24
Modular Steam Boiler Arrays (≥85% E_C)[1137]	Custom	

A deferred baseline replacement cost, consistent with the delta between the full measure cost and incremental cost above should be assumed after the remaining useful life of the existing equipment.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

[1134] Federal Register 85 FR 1592 – Energy Conservation Program: Energy Conservation Standards for Commercial Packaged Boilers

[1135] California ETRM measure "Process Boiler", https://www.caetrm.com/measure/SWWH008/01/ , accessed April 16, 2021..

[1136] Ibid.

[1137] Miura Modular Boilers, https://s29958.pcdn.co/wp-content/uploads/2019/03/LXBrochure2016.pdf

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

For first 8 years:

$$\Delta Therms = 8{,}766 * Capacity * UF * \left(\frac{Efficiency_{EE}}{Efficiency_{Exist}} - 1\right) * \frac{1}{100{,}000}$$

For remaining 17 years:

$$\Delta Therms = 8{,}766 * Capacity * UF * \left(\frac{Efficiency_{EE}}{Efficiency_{Base}} - 1\right) * \frac{1}{100{,}000}$$

Where:

8,766	= Annual Operating hours for Process Boilers The assumed hours of operation are based on continual plant operation. Variation in plant operating hours is accounted for in the utilization factor. While the boiler may operate during the entire year, it may not be operating at its full rated load.
Capacity	= Nominal heating input capacity boiler size for high-efficiency unit (Btu/hr)
UF	= Utilization Factor = Custom or if unknown 41.9%[1138]
$Efficiency_{Exist}$	= Existing boiler efficiency rating, = Actual
$Efficiency_{Base}$	= Baseline boiler efficiency rating, dependent on year and boiler type or use actual operating efficiencies for early replacements. See table in "Definition of Baseline Equipment."
$Efficiency_{EE}$	= Efficient boiler efficiency rating for packaged or modular boiler system = Actual value, specified to one significant digit (i.e., 95.7%)
100,000	= Constant to convert from Btu to therm

For example, an 800,000 Btu/hr gas-fired process steam boiler with a thermal efficiency rating of 87% is installed replacing a similar sized natural draft steam boiler with baseline efficiency of 79%.

ΔTherms	= 8,766 * 800,000 * 0.419 * (0.870 – 0.790)/0.790 / 100,000 = 2,976 therms

[1138] Illinois TRM v9.0,measure 4.4.3 Process Boiler Tune-up, "Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012".

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-PHBO-V05-270101

REVIEW DEADLINE: 1/1/2030

4.4.55 Commercial Gas Heat Pump

DESCRIPTION

Heat pumps are a class of HVAC equipment that moves heat from cold source to warm sink, moving heat "uphill". Often heat pumps can operate in reverse, using a reversing valve or other means to provide air conditioning (A/C) and space heating with the same product. If heat recovery is employed, the heat pump can also provide service hot water (SHW). Heat pumps generally involve the use of a refrigerant and utilize refrigeration cycles. Gas-fired heat pumps are a subset of heat pumps whose primary input drive energy is a gaseous fuel, instead of an electrically driven compressor. Gas-fired heat pumps can be separated into two categories, *work-activated* technologies where a delivered fuel drives a prime mover (e.g., internal combustion engine) which supplies work to a refrigerant compressor, and *heat-activated* where the primary energy input to the heat pump cycle is thermal energy, often from fuel combustion, driving a sorption-type or other thermally driven heat pump cycle.

This measure characterizes the installation of a commercial gas-fired heat pump for the following scenarios: NC, TS, EREP, and RF.

A. New Construction:
    i. The installation of a new commercial heat-activated (e.g., sorption-type) or work-activated (e.g., engine-driven) gas heat pump, certified to ANSI Z21.40.1 or ANSI Z21.40.2 respectively, that meets the criteria laid out in ANSI Z21.40.4 Performance Testing and Rating of Gas-Fired, Air Conditioning and Heat Pump Appliances.
    ii. Note the baseline in this case should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition defined in the Efficient Equipment section.
B. Time of Sale:
    i. The planned installation of a new gas heat pump meeting the efficiency standards laid out below that does not meet the criteria for early replacement as described in section C below.
    ii. Note the baseline in this case is the purchase of new equipment that is similar technology to existing equipment. Where unknown, the baseline should be determined via EM&V and the algorithms are provided to allow savings to be calculated from any baseline condition. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, only an electric utility, or only a gas utility. SHW savings are calculated based on the fuel and efficiency of the existing unit.
C. Early Replacement/Retrofit:
    i. The early removal of functioning electric or gas space heating and/or cooling systems from service, prior to the natural end of life, and replacement with a new high efficiency commercial gas heat pump system.
    ii. Note the baseline in this case is the existing equipment being replaced. The calculation of savings is dependent on whether an incentive for the installation has been provided by both a gas and electric utility, only an electric utility, or only a gas utility. SHW savings are calculated based on the fuel and efficiency of the existing unit.
    iii. Early Replacement determination will be based on meeting the following conditions:
        a. The existing unit is operational when replaced, or
        b. The existing unit requires minor repairs to be operational, defined as costing less than 20% of the new baseline replacement cost (as defined in the Measured Cost section of the relevant equipment).
        c. All other conditions will be considered Time of Sale.

    For the Baseline efficiency of the existing unit being replaced:
        a. Use actual existing efficiency whenever possible.
        b. If the efficiency of the existing unit is unknown, use assumptions based on the Federal minimum standards provided in tables below.

c. If the operational status or repair cost of the existing unit is unknown use time of sale assumptions.

DEFINITION OF EFFICIENT EQUIPMENT

Gaseous fuel heat pumps for space heating/cooling and domestic/service hot water heating. The table below shows the current gas heat pump products in two broad commercial categories – water heating and space heating/cooling. The table additionally lists applicable industry test methods and the primary efficiency metric.

Table 1: Current Gas Heat Pump Products

Equipment			Test Method	Efficiency Metric	
Category	Sector	Type	Industry	Primary Metric	Tested Performance
Water Heating	Commercial	Gas HPWH with or without storage tank	ANSI/ASHRAE 118.1	Coefficient of Performance (COP)	> 1.2 COP
Space Heating & Cooling	Commercial	Gas-fired air-conditioner or heat pump	ANSI Z21.40.4	Coefficient of Performance (COP) for heating / cooling	> 1.2 $COP_{heating}$ or > 1.0 $COP_{cooling}$

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment includes Service Hot Water, Space Heating, and Air-Conditioning.

New Construction:

IECC 2021(effective January 1, 2024 to November 29, 2025) and IECC 2024 (effective statewide as of 11/30/2025) for commercial facilities is applicable here.

To calculate savings with an electric baseline, the baseline equipment is assumed to be an Air Source Heat Pump meeting the state energy code efficiency level as outlined in **Error! Reference source not found.** (IECC 2021) and Table 7 (IECC 2024) below.

To calculate savings with a chiller/unitary cooling system (**Error! Reference source not found.**, IECC 2021 and Table 8, IECC 2024) and boiler/furnace baseline (**Error! Reference source not found.** and Table 9 for boilers and **Error! Reference source not found.** and Table 10 for warm air furnaces), the baseline equipment is assumed to meet the minimum standard efficiencies as outlined in their respective tables.

To calculate savings with water heater applications, the baseline equipment is assumed to meet the minimum standard efficiencies outlined in **Error! Reference source not found.** (IECC 2021) or Table 11 (IECC 2024).

As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints. Given location and timing, if evaluation determines the applicable version of code isn't an appropriate baseline due to supply constraints, low compliance, or other issues, then the previous iteration of code may be used through 2027.

Table 2: IECC 2021 Air-Source Heat Pumps Minimum Efficiency Requirements

TABLE C403.3.2(2)
ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 66,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 14.3 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	14.0 SEER before 1/1/2023 13.4 SEER2 after 1/1/2023	
Space constrained, air cooled (cooling mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 11.7 SEER2 after 1/1/2023	
Single duct, high velocity, air cooled (cooling mode)	< 65,000	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER before 1/1/2023 12.0 SEER2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	11.0 EER 12.2 IEER before 1/1/2023 14.1 IEER after 1/1/2023	AHRI 340/360
		All other		10.8 EER 12.0 IEER before 1/1/2023 13.9 IEER after 1/1/2023	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		10.6 EER 11.6 IEER before 1/1/2023 13.5 IEER after 1/1/2023	
		All other		10.4 EER 11.4 IEER before 1/1/2023 13.3 IEER after 1/1/2023	
	≥ 240,000 Btu/h	Electric resistance (or none)		9.5 EER 10.6 IEER before 1/1/2023 12.5 IEER after 1/1/2023	
		All other		9.3 EER 10.4 IEER before 1/1/2023 12.3 IEER after 1/1/2023	
Air cooled (heating mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	8.2 HSPF before 1/1/2023 7.5 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	8.0 HSPF before 1/1/2023 6.7 HSPF2 after 1/1/2023	

(Table 2 Continued)

TABLE C403.3.2(2)—continued
ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[a, d]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Space constrained, air cooled (heating mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	7.4 HSPF before 1/1/2023 6.3 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
			Single package, three phase and applications outside US single phase[b]	7.4 HSPF before 1/1/2023 6.3 HSPF2 after 1/1/2023	
Small duct, high velocity, air cooled (heating mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	7.2 HSPF before 1/1/2023 6.1 HSPF2 after 1/1/2023	AHRI 210/240—2017 before 1/1/2023 AHRI 210/240—2023 after 1/1/2023
Air cooled (heating mode)	≥ 65,000 Btu/h and < 135,000 Btu/h (cooling capacity)	All	47°F db/43°F wb outdoor air	3.30 COP_H before 1/1/2023 3.40 COP_H after 1/1/2023	AHRI 340/360
			17°F db/15°F wb outdoor air	2.25 COP_H	
	≥ 135,000 Btu/h and < 240,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H before 1/1/2023 3.30 SOP_H after 1/1/2023	
			17°F db/15°F wb outdoor air	2.05 COP_H	
	≥ 240,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	

Table 3: IECC 2021 Electric Chillers, Air-Cooled and Water-Cooled Minimum Efficiency Requirements

TABLE C403.3.2(3)
WATER-CHILLING PACKAGES—MINIMUM EFFICIENCY REQUIREMENTS[a, b, e, f]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	PATH A	PATH B	TEST PROCEDURE[c]
Air cooled chillers	< 150 tons	EER (Btu/Wh)	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 13.700 IPLV.IP	≥ 15.800 IPLV.IP	
	≥ 150 tons		≥ 10.100 FL	≥ 9.700FL	
			≥ 14.000 IPLV.IP	≥ 16.100 IPLV.IP	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/Wh)	Air-cooled chillers without condenser must be rated with matching condensers and comply with air-cooled chiller efficiency requirements		AHRI 550/590
Water cooled, electrically operated positive displacement	< 75 tons	kW/ton	≤ 0.750 FL	≤ 0.780 FL	AHRI 550/590
			≤ 0.600 IPLV.IP	≤ 0.500 IPLV.IP	
	≥ 75 tons and < 150 tons		≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.560 IPLV.IP	≤ 0.490 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.660 FL	≤ 0.680 FL	
			≤ 0.540 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 300 tons and < 600 tons		≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.520 IPLV.IP	≤ 0.410 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Water cooled, electrically operated centrifugal	< 150 tons	kW/ton	≤ 0.610 FL	≤ 0.695 FL	AHRI 550/590
			≤ 0.550 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.550 IPLV.IP	≤ 0.400 IPLV.IP	
	≥ 300 tons and < 400 tons		≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.520 IPLV.IP	≤ 0.390 IPLV.IP	
	≥ 400 tons and < 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Air cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.600 FL	NA[d]	AHRI 560
Water cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.700 FL	NA[d]	AHRI 560
Absorption double effect, indirect fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 0.150 IPLV.IP		
Absorption double effect, direct fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 1.000 IPLV		

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.
b. The requirements for centrifugal chillers shall be adjusted for nonstandard rating conditions per Section C403.3.2.1 and are applicable only for the range of conditions listed there. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.
c. Both the full-load and IPLV.IP requirements must be met or exceeded to comply with this standard. When there is a Path B, compliance can be with either Path A or Path B for any application.
d. NA means the requirements are not applicable for Path B, and only Path A can be used for compliance.
e. FL is the full-load performance requirements, and IPLV.IP is for the part-load performance requirements.
f. This table is a replica of ASHRAE 90.1 Table 6.8.1-3 Water-Chilling Packages—Minimum Efficiency Requirements.

Note: Code of Federal Regulations for gas-fired hot water boilers (10 CFR 432I(3)):require:

<300,000 Btu/hr hot water boilers to be 84% AFUE, and
<300,000 Btu/hr steam boilers to be 82% AFUE
See **Table 4** below for all other minimum efficiencies.

Table 4: IECC 2021 Boiler Minimum Efficiency Requirements

TABLE C403.3.2(6)
GAS- AND OIL-FIRED BOILERS—MINIMUM EFFICIENCY REQUIREMENTS[i]

EQUIPMENT TYPE[b]	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY	EFFICIENCY AS OF 3/2/2022	TEST PROCEDURE[a]
Boilers, hot water	Gas fired	< 300,000 Btu/h[g, h] for applications outside US	82% AFUE	82% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	80% E_t[d]	80% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	82% E_c[c]	82% E_c[c]	
	Oil fired[f]	< 300,000 Btu/h[g,h] for applications outside US	84% AFUE	84% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	82% E_t[d]	82% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	84% E_c[c]	84% E_c[c]	
Boilers, steam	Gas fired	< 300,000 Btu/h[g] for applications outside US	80% AFUE	80% AFUE	DOE 10 CFR 430 Appendix N
	Gas fired—all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	79% E_t[d]	79% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	79% E_t[d]	79% E_t[d]	
	Gas fired—natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	77% E_t[d]	79% E_t[d]	
		> 2,500,000 Btu/h[b]	77% E_t[d]	79% E_t[d]	
	Oil fired[f]	< 300,000 Btu/h[g] for applications outside US	82% AFUE	82% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	81% E_t[d]	81% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b]	81% E_t[d]	81% E_t[d]	

Table 5: IECC 2021 Warm-Air Furnace Minimum Efficiency Requirements

TABLE C403.3.2(5)
WARM-AIR FURNACES AND COMBINATION WARM-AIR FURNACES/AIR-CONDITIONING UNITS, WARM-AIR DUCT FURNACES AND UNIT HEATERS—MINIMUM EFFICIENCY REQUIREMENTS[a]

EQUIPMENT TYPE	SIZE CATEGORY (INPUT)	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Warm-air furnace, gas fired for application outside the US	< 225,000 Btu/h	Maximum capacity[c]	80% AFUE (nonweatherized) or 81% AFUE (weatherized) or 80% E_t[b, d]	DOE 10 CFR 430 Appendix N or Section 2.39, Thermal Efficiency, ANSI Z21.47
Warm-air furnace, gas fired	< 225,000 Btu/h	Maximum capacity[c]	80% E_t[b, d] before 1/1/2023 81% E_t[d] after 1/1/2023	Section 2.39, Thermal Efficiency, ANSI Z21.47
Warm-air furnace, oil fired for application outside the US	< 225,000 Btu/h	Maximum capacity[c]	83% AFUE (nonweatherized) or 78% AFUE (weatherized) or 80% E_t[b, d]	DOE 10 CFR 430 Appendix N or Section 42, Combustion, UL 727
Warm-air furnace, oil fired	< 225,000 Btu/h	Maximum capacity[c]	80% E_t before 1/1/2023 82% E_t[d] after 1/1/2023	Section 42, Combustion, UL 727
Electric furnaces for applications outside the US	< 225,000 Btu/h	All	96% AFUE	DOE 10 CFR 430 Appendix N
Warm-air duct furnaces, gas fired	All capacities	Maximum capacity[c]	80% E_c[e]	Section 2.10, Efficiency, ANSI Z83.8
Warm-air unit heaters, gas fired	All capacities	Maximum capacity[c]	80% E_c[e, f]	Section 2.10, Efficiency, ANSI Z83.8
Warm-air unit heaters, oil fired	All capacities	Maximum capacity[c]	80% E_c[e, f]	Section 40, Combustion, UL 731

Table 6: IECC 2021 Water Heater Minimum Efficiency Requirements

TABLE C404.2
MINIMUM PERFORMANCE OF WATER-HEATING EQUIPMENT

EQUIPMENT TYPE	SIZE CATEGORY (input)	SUBCATEGORY OR RATING CONDITION	PERFORMANCE REQUIRED[a, b]	TEST PROCEDURE
Water heaters, electric	≤ 12 kW[d]	Tabletop[e], ≥ 20 gallons and ≤ 120 gallons	0.93 – 0.00132V, EF	DOE 10 CFR Part 430
		Resistance ≥ 20 gallons and ≤ 55 gallons	0.960 – 0.0003V, EF	
		Grid-enabled[f] > 75 gallons and ≤ 120 gallons	1.061 – 0.00168V, EF	
	> 12 kW	Resistance	(0.3 + 27/V_m), %/h	ANSI Z21.10.3
	≤ 24 amps and ≤ 250 volts	Heat pump > 55 gallons and ≤ 120 gallons	2.057 – 0.00113V, EF	DOE 10 CFR Part 430
Storage water heaters, gas	≤ 75,000 Btu/h	≥ 20 gallons and > 55 gallons	0.675 – 0.0015V, EF	DOE 10 CFR Part 430
		> 55 gallons and ≤ 100 gallons	0.8012 – 0.00078V, EF	
	> 75,000 Btu/h and ≤ 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	ANSI Z21.10.3
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	
	> 155,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	
Instantaneous water heaters, gas	> 50,000 Btu/h and < 200,000 Btu/h[c]	≥ 4,000 Btu/h/gal and < 2 gal	0.82 – 0.00 19V, EF	DOE 10 CFR Part 430
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
	≥ 200,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E_t	
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	
Storage water heaters, oil	≤ 105,000 Btu/h	≥ 20 gal and ≤ 50 gallons	0.68 – 0.0019V, EF	DOE 10 CFR Part 430
	≥ 105,000 Btu/h	< 4,000 Btu/h/gal	80% E_t	ANSI Z21.10.3
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	
Instantaneous water heaters, oil	≤ 210,000 Btu/h	≥ 4,000 Btu/h/gal and < 2 gal	0.59 – 0.0019V, EF	DOE 10 CFR Part 430
	> 210,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
	> 210,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	78% E_t	
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	
Hot water supply boilers, gas and oil	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 4,000 Btu/h/gal and < 10 gal	80% E_t	ANSI Z21.10.3
Hot water supply boilers, gas	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 4,000 Btu/h/gal and ≥ 10 gal	80% E_t	
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	
Hot water supply boilers, oil	> 300,000 Btu/h and < 12,500,000 Btu/h	> 4,000 Btu/h/gal and > 10 gal	78% E_t	
			(Q/800 + 110$\sqrt{V}$)SL, Btu/h	

Table 7: IECC 2024 Air-Source Heat Pumps Minimum Efficiency Requirements

TABLE C403.3.2(2)—ELECTRICALLY OPERATED AIR-COOLED UNITARY HEAT PUMPS—MINIMUM EFFICIENCY REQUIREMENTS[c]

EQUIPMENT TYPE	SIZE CATEGORY	HEADING SECTION TYPE	SUBCATEGORY OR RATING CONDITION	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Air cooled (cooling mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	14.3 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	13.4 SEER2	
Space constrained, air cooled (cooling mode)	≤ 30,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	11.7 SEER2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	11.7 SEER2	
Small duct, high velocity, air cooled (cooling mode)	< 65,000 Btu/h	All	Split system, three phase and applications outside US single phase[b]	12.0 SEER2	AHRI 210/240—2023
Air cooled (cooling mode)	≥ 65,000 Btu/h and < 135,000 Btu/h	Electric resistance (or none)	Split system and single package	14.1 IEER	AHRI 340/360
		All other		13.9 IEER	
	≥ 135,000 Btu/h and < 240,000 Btu/h	Electric resistance (or none)		13.5 IEER	
		All other		13.3 IEER	
	≥ 240,000 Btu/h	Electric resistance (or none)		12.5 IEER	
		All other		12.3 IEER	
Air cooled(heating mode)	< 65,000 Btu/h (cooling capacity)	—	Split system, three phase and applications outside US single phase[b]	7.5 HSPF2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	6.7 HSPF2	
Space constrained, air cooled (heating mode)	≤ 30,000 Btu/h(cooling capacity)	—	Split system, three phase and applications outside US single phase[b]	6.3 HSPF2	AHRI 210/240—2023
			Single package, three phase and applications outside US single phase[b]	6.3 HSPF2	
Small duct high velocity, air cooled (heating mode)	< 65,000 Btu/h	—	Split system, three phase and applications outside US single phase[b]	6.1 HSPF2	AHRI 210/240—2023
Air cooled (heating mode)	≥ 65,000 Btu/h and< 135,000 Btu/h(cooling capacity)	—	47°F db/43°F wb outdoor air	3.40 COP_H	AHRI 340/360
			17°F db/15°F wb outdoor air	2.25 COP_H	
	≥ 135,000 Btu/h and< 240,000 Btu/h(cooling capacity)		47°F db/43°F wb outdoor air	3.30 SOP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	
	≥ 240,000 Btu/h(cooling capacity)		47°F db/43°F wb outdoor air	3.20 COP_H	
			17°F db/15°F wb outdoor air	2.05 COP_H	

For SI: 1 British thermal unit per hour = 0.2931 W, °C = (°F − 32)/1.8, wb = wet bulb, db = dry bulb.

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.

b. Single-phase, US air-cooled heat pumps less than 65,000 Btu/h are regulated as consumer products by the US Department of Energy Code of Federal Regulations DOE 10 CFR 430. SEER, SEER2 and HSPF values for single-phase products are set by the US Department of Energy.

c. DOE 10 CFR 430 Subpart B Appendix M1 includes the test procedure updates effective January 1, 2023, documented in AHRI 210/240—2023.

Table 8: IECC 2024 Electric Chillers, Air-Cooled and Water-Cooled Minimum Efficiency Requirements

TABLE C403.3.2(3)—LIQUID-CHILLING PACKAGES—MINIMUM EFFICIENCY REQUIREMENTS[a, b, e]

EQUIPMENT TYPE	SIZE CATEGORY	UNITS	PATH A	PATH B	TEST PROCEDURE[c]
Air cooled	< 150 tons	EER (Btu/Wh)	≥ 10.100 FL	≥ 9.700 FL	AHRI 550/590
			≥ 13.700 IPLV.IP	≥ 15.800 IPLV.IP	
	≥ 150 tons		≥ 10.100 FL	≥ 9.700FL	
			≥ 14.000 IPLV.IP	≥ 16.100 IPLV.IP	
Air cooled without condenser, electrically operated	All capacities	EER (Btu/Wh)	Air-cooled without condenser must be rated with matching condensers and comply with air-cooled chiller efficiency requirements		AHRI 550/590
Liquid-cooled, electrically operated positive displacement	< 75 tons	kW/ton	≤ 0.750 FL	≤ 0.780 FL	AHRI 550/590
			≤ 0.600 IPLV.IP	≤ 0.500 IPLV.IP	
	≥ 75 tons and < 150 tons		≤ 0.720 FL	≤ 0.750 FL	
			≤ 0.560 IPLV.IP	≤ 0.490 IPLV.IP	
	≥ 150 tons and < 300 tons		≤ 0.660 FL	≤ 0.680 FL	
			≤ 0.540 IPLV.IP	≤ 0.440 IPLV.IP	
	≥ 300 tons and < 600 tons		≤ 0.610 FL	≤ 0.625 FL	
			≤ 0.520 IPLV.IP	≤ 0.410 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Liquid-cooled, electrically operated centrifugal	< 150 tons	kW/ton	≤ 0.610 FL	≤ 0.695 FL	AHRI 550/590
			≤ 0.550 IPLV.IP	≤ 0.440 IPLV.IP	
	≥150 tons and <300 tons		≤ 0.610 FL	≤ 0.635 FL	
			≤ 0.550 IPLV.IP	≤ 0.400 IPLV.IP	
	≥ 300 tons and < 400 tons		≤ 0.560 FL	≤ 0.595 FL	
			≤ 0.520 IPLV.IP	≤ 0.390 IPLV.IP	
	≥ 400 tons and < 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
	≥ 600 tons		≤ 0.560 FL	≤ 0.585 FL	
			≤ 0.500 IPLV.IP	≤ 0.380 IPLV.IP	
Air cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.600 FL	NA[d]	AHRI 560
Liquid-cooled absorption, single effect	All capacities	COP (W/W)	≥ 0.700 FL	NA[d]	AHRI 560
Absorption double effect, indirect fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 0.150 IPLV.IP		
Absorption double effect, direct fired	All capacities	COP (W/W)	≥ 1.000 FL	NA[d]	AHRI 560
			≥ 1.000 IPLV		

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.
b. The requirements for centrifugal chillers shall be adjusted for nonstandard rating conditions per Section C403.3.2.1 and are applicable only for the range of conditions listed there. The requirements for air-cooled, water-cooled positive displacement and absorption chillers are at standard rating conditions defined in the reference test procedure.
c. Both the full-load and IPLV.IP requirements must be met or exceeded to comply with this standard. When there is a Path B, compliance can be with either Path A or Path B for any application.
d. NA means the requirements are not applicable for Path B, and only Path A can be used for compliance.
e. FL is the full-load performance requirements, and IPLV.IP is for the part-load performance requirements.

Note: Code of Federal Regulations for gas-fired hot water boilers (10 CFR 432I(3)) requires:

<300,000 Btu/hr hot water boilers to be 84% AFUE, and
<300,000 Btu/hr steam boilers to be 82% AFUE
See Table 9 below for all other minimum efficiencies.

Table 9: IECC 2024 Boiler Minimum Efficiency Requirements

TABLE C403.3.2(6)—GAS- AND OIL-FIRED BOILERS—MINIMUM EFFICIENCY REQUIREMENTS

EQUIPMENT TYPE[b]	SUBCATEGORY OR RATING CONDITION	SIZE CATEGORY (INPUT)	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Boilers, hot water	Gas fired	< 300,000 Btu/h[g, h] for applications outside US	84% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	80% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b] and ≤ 10,000,000 Btu/h[b]	82% E_c[c]	
		> 10,000,000 Btu/h[b]	82% E_c[c]	
	Oil fired[f]	< 300,000 Btu/h[g, h] for applications outside US	86% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	82% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b] and ≤ 10,000,000 Btu/h[b]	84% E_c[c]	
		> 10,000,000 Btu/h[b]	84% E_c[c]	
Boilers, steam	Gas fired	< 300,000 Btu/h[g] for applications outside US	82% AFUE	DOE 10 CFR 430 Appendix N
	Gas fired—all, except natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	79% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b] and ≤ 10,000,000 Btu/h[b]	79% E_t[d]	
		> 10,000,000 Btu/h[b]	79% E_t[d]	
	Gas fired—natural draft	≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	79% E_t[d]	
		> 2,500,000 Btu/h[b]	79% E_t[d]	
	Oil fired[f]	< 300,000 Btu/h[g] for applications outside US	82% AFUE	DOE 10 CFR 430 Appendix N
		≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h[e]	81% E_t[d]	DOE 10 CFR 431.86
		> 2,500,000 Btu/h[b] and ≤ 10,000,000 Btu/h[b]	81% E_t[d]	
		> 10,000,000 Btu/h[b]	81% E_t[d]	

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure.
b. These requirements apply to boilers with rated input of 8,000,000 Btu/h or less that are not packaged boilers and to all packaged boilers. Minimum efficiency requirements for boilers cover all capacities of packaged boilers.
c. E_c = Combustion efficiency (100 percent less flue losses).
d. E_t = Thermal efficiency.
e. Maximum capacity—minimum and maximum ratings as provided for and allowed by the unit's controls.
f. Includes oil-fired (residual).
g. Boilers shall not be equipped with a constant burning pilot light.
h. A boiler not equipped with a tankless domestic water-heating coil shall be equipped with an automatic means for adjusting the temperature of the water such that an incremental change in inferred heat load produces a corresponding incremental change in the temperature of the water supplied.

Table 10: IECC 2024 Warm-Air Furnace Minimum Efficiency Requirements

TABLE C403.3.2(5)—WARM-AIR FURNACES AND COMBINATION WARM-AIR FURNACES/ AIR-CONDITIONING UNITS, WARM-AIR DUCT FURNACES AND UNIT HEATERS—MINIMUM EFFICIENCY REQUIREMENTS[g]

DESCRIPTION	FUEL	ELECTRIC POWER PHASE	APPLICATION LOCATION	HEATING CAPACITY (INPUT), Btu/h[b]	COMBO-UNIT COOLING CAPACITY, Btu/h	SUBTYPE	MINIMUM EFFICIENCY	TEST PROCEDURE[a]
Warm-air furnace	Gas	1	Inside US	< 225,000	< 65,000	See Informative Appendix F, Table F-4[f]		
Warm-air furnace	Gas	1	Inside US	< 225,000	≥ 65,000	Nonweatherized	80% AFUE	Appendix N[g]
						Weatherized	81% AFUE or 80% E_t[c]	Appendix N[g]
								ANSI Z21.47
Warm-air furnace	Gas	1	Outside US	< 225,000	All	Nonweatherized	80% AFUE	Appendix N[g]
						Weatherized	81% AFUE or 80% E_t[c]	Appendix N[g]
								ANSI Z21.47
Warm-air furnace	Gas	3	All	< 225,000	All	Nonweatherized	80% AFUE	Appendix N[g]
						Weatherized	81% AFUE or 80% E_t[c]	Appendix N[g]
								ANSI Z21.47
Warm-air furnace	Gas	All	All	≥ 225,000 and ≤ 400,000	All	All	81% E_t[c]	ANSI Z21.47
Warm-air furnace	Gas	All	Inside US	> 400,000	All	All	80% E_t[c] before 1/1/2023 81% E_t[c] after 1/1/2023	ANSI Z21.47
Warm-air furnace	Gas	All	Outside US	> 400,000	All	All	80% E_t[c] before 1/1/2023 81% E_t[c] after 1/1/2023	ANSI Z21.47 or ANSI Z83.8
Warm-air furnace	Oil	1	Inside US	< 225,000	< 65,000	See Informative Appendix F, Table F-4[f]		
Warm-air furnace	Oil	1	Inside US	< 225,000	≥ 65,000	Nonweatherized	83% AFUE	Appendix N[g]
						Weatherized	78% AFUE or 80% E_t[d]	Appendix N[g]
								Section 42 UL 727
Warm-air furnace	Oil	1	Outside US	< 225,000	All	Nonweatherized	83% AFUE	Appendix N[g]
						Weatherized	78% AFUE or 80% E_t[d]	Appendix N[g]
								Section 42 UL 727
Warm-air furnace	Oil	3	All	<225,000	All	Nonweatherized	83% AFUE	Appendix N[g]
						Weatherized	78% AFUE or 80% E_t[d]	Appendix N[g]
								Section 42 UL 727
Warm-air furnace	Oil	All	All	≥ 225,000	All	All	82% E_t[d]	Section 42 UL 727
Warm-air furnace	Electric	1	Inside US	< 225,000	< 65,000	See Informative Appendix F, Table F-4[f]		
Warm-air furnace	Electric	1	Inside US	< 225,000	≥ 65,000	All	96% AFUE	Appendix N[g]

Table 10 Continued...

Warm-air furnace	Electric	1	Outside US	< 225,000	All	All	96% AFUE	Appendix N[g]
Warm-air furnace	Electric	3	All	< 225,000	All	All	96% AFUE	Appendix N[g]
Warm-air duct furnaces	Gas	All	All	All	All	All	80% E_c[d]	ANSI Z83.8
Warm-air unit heaters	Gas	All	All	All	All	All	80% E_c[d, e]	ANSI Z83.8
Warm-air unit heaters	Oil	All	All	All	All	All	80% E_c[d, e]	Section 40 UL 731

For SI: 1 British thermal unit per hour = 0.2931 W.

a. Chapter 6 contains a complete specification of the referenced standards, which include test procedures, including the reference year version of the test procedure. For this table, the following applies:
   - Appendix N = 10 CFR 430 Appendix N
   - ANSI Z21.47 = Section 2.39, Thermal Efficiency, ANSI Z21.47
   - ANSI Z83.3 = Section 2.10, Efficiency, ANSI Z83.3
   - UL 727 = Section 42, Combustion, UL 727
   - UL 731 = Section 40, Combustion, UL 731

b. Compliance of multiple firing rate units shall be at the maximum firing rate.

c. E_t = thermal efficiency. Units must also include an interrupted or intermittent ignition device (IID), have jacket losses not exceeding 0.75 percent of the input rating, and have either power venting or a flue damper. A vent damper is an acceptable alternative to a flue damper for those furnaces where combustion air is drawn from the conditioned space.

d. E_c = combustion efficiency (100 percent less flue losses). See test procedure for detailed discussion.

e. Units must also include an interrupted or intermittent ignition device (IID) and have either power venting or an automatic flue damper.

f. Includes combination units with cooling capacity < 65,000 Btu/h. For US applications of federally covered < 225,000 Btu/h products, see Informative Appendix F, Table F-4.

g. 10 CFR 430 is limited to-single phase equipment that is not contained within the same cabinet with a central air conditioner whose rated cooling capacity is above 65,000 Btu/h but for the test and rating procedures are not impacted for three-phase and can be used for AFUE ratings for ASHRAE/IES Standard 90.1 three-phase products and single-phase products with a cooling capacity greater than 65,000 Btu/h.

Table 11: IECC 202 Water Heater Minimum Efficiency Requirements

TABLE C404.2—MINIMUM PERFORMANCE OF WATER-HEATING EQUIPMENT

EQUIPMENT TYPE	SIZE CATEGORY	SUBCATEGORY OR RATING CONDITION	DRAW PATTERN	PERFORMANCE REQUIRED[a]	TEST PROCEDURE[b]
Electric table-top water heaters[c]	≤ 12 kW	≥ 20 gal ≤ 120 gal[d]	Very small Low Medium High	UEF ≥ 0.6323 – (0.0058 × V_r) UEF ≥ 0.9188 – (0.0031 × V_r) UEF ≥ 0.9577 – (0.0023 × V_r) UEF ≥ 0.9884 – (0.0016 × V_r)	DOE 10 CFR Part 430 App. E
Electric storage water heaters[e, f]: resistance and heat pump	≤ 12 kW	≥ 20 gal ≤ 55 gal[f]	Very small Low Medium High	UEF ≥ 0.8808 – (0.0008 × V_r) UEF ≥ 0.9254 – (0.0003 × V_r) UEF ≥ 0.9307 – (0.0002 × V_r) UEF ≥ 0.9349 – (0.0001 × V_r)	DOE 10 CFR Part 430 App. E
	≤ 12 kW	> 55 gal ≤120 gal[f]	Very small Low Medium High	UEF ≥ 1.9236 – (0.0011 × V_r) UEF ≥ 2.0440 – (0.0011 × V_r) UEF ≥ 2.1171 – (0.0011 × V_r) UEF ≥ 2.2418 – (0.0011 × V_r)	DOE 10 CFR Part 430 App. E
Electric storage water heaters[e, f, m]	> 12 kW	—	—	$(0.3 + 27/V_m)$, %/h	DOE 10 CFR Part 431.106 App. B
Grid-enabled water heaters[g]	—	> 75 gal[d]	Very small Low Medium High	UEF ≥ 1.0136 – (0.0028 × V_r) UEF ≥ 0.9984 – (0.0014 × V_r) UEF ≥ 0.9853 – (0.0010 × V_r) UEF ≥ 0.9720 – (0.0007 × V_r)	DOE 10 CFR Part 430 App. E
Electric instantaneous water heaters[h]	≤ 12 kW	< 2 gal[d]	Very small Low Medium High	UEF ≥ 0.91 UEF ≥ 0.91 UEF ≥ 0.91 UEF ≥ 0.92	DOE 10 CFR Part 430
	> 12 kW & ≤ 58.6 kW[i]	≤ 2 gal & ≤180°F	All	UEF ≥ 0.80	DOE 10 CFR Part 430
Gas storage water heaters[e, m]	≤ 75,000 Btu/h	≥20 gal & ≤ 55 gal[d]	Very small Low Medium High	UEF ≥ 0.3456 – (0.0020 × V_r) UEF ≥ 0.5982 – (0.0019 × V_r) UEF ≥ 0.6483 – (0.0017 × V_r) UEF ≥ 0.6920 – (0.0013 × V_r)	DOE 10 CFR Part 430 App. E
	≤ 75,000 Btu/h	> 55 gal & ≤ 100 gal[d]	Very small Low Medium High	UEF ≥ 0.6470 – (0.0006 × V_r) UEF ≥ 0.7689 – (0.0005 × V_r) UEF ≥ 0.7897 – (0.0004 × V_r) UEF ≥ 0.8072 – (0.0003 × V_r)	DOE 10 CFR Part 430 App. E
	> 75,000 Btu/h and ≤ 105,000 Btu/h[j, k]	≤ 120 gal & ≤180°F	Very small Low Medium High	UEF ≥ 0.2674 – (0.0009 × V_r) UEF ≥ 0.5362 – (0.0012 × V_r) UEF ≥ 0.6002 – (0.0011 × V_r) UEF ≥ 0.6597 – (0.0009 × V_r)	DOE 10 CFR Part 430 App. E
	> 105,000 Btu/h[k]	—	—	80% E_t $\$4 \leq Q/(800 + 110\sqrt{V})$, Btu/h	DOE 10 CFR Part 431.106

Table 11 Continued…

Gas instantaneous water heaters[j]	> 50,000 Btu/h and < 200,000 Btu/h[k]	< 2 gal[d]	Very small Low Medium High	UEF ≥ 0.80 UEF ≥ 0.81 UEF ≥ 0.81 UEF ≥ 0.81	DOE 10 CFR Part 430 App. E
	≥ 200,000 Btu/h[k]	< 10 gal	—	80% E_t	DOE 10 CFR Part 431.106
	≥ 200,000 Btu/h[k]	≥10 gal	—	80% E_t $SL \leq Q/(800 + 110\sqrt{V})$, Btu/h	
Oil storage water heaters[g, m]	≤ 105,000 Btu/h	≤ 50 gal[d]	Very small Low Medium High	UEF = 0.2509 – (0.0012 × V_r) UEF = 0.5330 – (0.0016 × V_r) UEF = 0.6078 – (0.0016 × V_r) UEF = 0.6815 – (0.0014 × V_r)	DOE 10 CFR Part 430
	> 105,000 Btu/h and ≤ 140,000 Btu/hl	≤ 120 gal & ≤180°F	Very small Low Medium High	UEF ≥ 0.2932 – (0.0015 × V_r) UEF ≥ 0.5596 – (0.0018 × V_r) UEF ≥ 0.6194 – (0.0016 × V_r) UEF ≥ 0.6740 – (0.0013 × V_r)	DOE 10 CFR Part 430 App. E
	> 140,000 Btu/h	All	—	80% E_t $SL \leq Q/(800 + 110\sqrt{V})$, Btu/h	DOE 10 CFR Part 431.106
Oil instantaneous water heaters[h, m]	≤ 210,000 Btu/h	< 2 gal	—	80% E_t $EF \geq 0.59 - (0.0005 \times V)$	DOE 10 CFR Part 430 App. E
	> 210,000 Btu/h	< 10 gal	—	80% E_t	DOE 10 CFR Part 431.106
	> 210,000 Btu/h	≥ 10 gal	—	78% E_t $SL \leq Q/(800 + 110\sqrt{V})$, Btu/h	DOE 10 CFR Part 431.106
Hot water supply boilers, gas and oil[h]	≥ 300,000 Btu/h and < 12,500,000 Btu/h	< 10 gal	—	80% E_t	DOE 10 CFR Part 431.106
Hot water supply boilers, gas[i, m]	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 10 gal	—	80% E_t $SL \leq Q/(800 + 110\sqrt{V})$, Btu/h	DOE 10 CFR Part 431.106
Hot water supply boilers, oil[h, m]	≥ 300,000 Btu/h and < 12,500,000 Btu/h	≥ 10 gal	—	78% E_t $SL \leq Q/(800 + 110\sqrt{V})$, Btu/h	DOE 10 CFR Part 431.106
Pool heaters, gas[d]	All	—[f]	—	82% E_t	DOE 10 CFR Part 430 App. P
Heat pump pool heaters	All	50°F db and 44.2°F wb outdoor air 80.0°F entering water	—	4.0 COP	DOE 10 CFR Part 430 App. P
Unfired storage tanks	All	—	—	Minimum insulation requirement R-12.5 (h × ft^2 × °F)/Btu	(none)

Table 11 Continued…

For SI: 1 foot = 304.8 mm, 1 square foot = 0.0929 m^2, °C = (°F − 32)/1.8, 1 British thermal unit per hour = 0.2931 W, 1 gallon = 3.785 L, 1 British thermal unit per hour per gallon = 0.078 W/L.

a. Thermal efficiency (E_t) is a minimum requirement, while standby loss is a maximum requirement. In the standby loss equation, V is the rated volume in gallons and Q is the nameplate input rate in Btu/h. V_m is the measured volume in the tank in gallons. Standby loss for electric water heaters is in terms of %/h and denoted by the term "S," and standby loss for gas and oil water heaters is in terms of Btu/h and denoted by the term "SL." Draw pattern (DP) refers to the water draw profile in the Uniform Energy Factor (UEF) test. UEF and Energy Factor (EF) are minimum requirements. In the UEF standard equations, V_r refers to the rated volume in gallons.

b. Chapter 6 contains a complete specification, including the year version, of the referenced test procedure.

c. A tabletop water heater is a storage water heater that is enclosed in a rectangular cabinet with a flat top surface not more than 3 feet in height and has a ratio of input capacity (Btu/h) to tank volume (gal) < 4,000.

d. Water heaters or gas pool heaters in this category are regulated as consumer products by the US DOE, as defined in 10 CFR 430.

e. Storage water heaters have a ratio of input capacity (Btu/h) to tank volume (gal) < 4,000.

f. Efficiency requirements for electric storage water heaters ≤ 12 kW apply to both electric-resistance and heat pump water heaters. There are no minimum efficiency requirements for electric heat pump water heaters greater than 12 kW or for gas heat pump water heaters.

g. A grid-enabled water heater is an electric-resistance water heater that meets all of the following:

1. Has a rated storage tank volume of more than 75 gallons.
2. Is manufactured on or after April 16, 2015.
3. Is equipped at the point of manufacture with an activation lock.
4. Bears a permanent label applied by the manufacturer that complies with all of the following:
   4.1. Is made of material not adversely affected by water.
   4.2. Is attached by means of nonwater soluble adhesive.
   4.3. Advises purchasers and end users of the intended and appropriate use of the product with the following notice printed in 16.5 point Arial Narrow Bold font: "IMPORTANT INFORMATION: This water heater is intended only for use as a part of an electric thermal storage or demand response program. It will not provide adequate hot water unless enrolled in such a program and activated by your utility company or another program operator. Confirm the availability of a program in your local area before purchasing or installing this product."

h. Instantaneous water heaters and hot water supply boilers have an input capacity (Btu/h) divided by storage volume (gal) ≥ 4,000 (Btu/h)/gal.

i. Electric instantaneous water heaters with input capacity >12 kW and ≤ 58.6 kW that (1) have a storage volume > 2 gallons, (2) are designed to provide outlet hot water at temperatures greater than 180°F, or (3) use three-phase power have no efficiency standard.

j. Gas storage water heaters with input capacity > 75,000 Btu/h and ≤ 105,000 Btu/h must comply with the requirements for the > 105,000 Btu/h if the water heater (1) has a storage volume > 120 gallons, (2) is designed to provide outlet hot water at temperatures greater than 180°F, or (3) uses three-phase power.

k. Refer to Section C404.2.1 for additional requirements for gas storage and instantaneous water heaters and gas hot water supply boilers.

l. Oil storage water heaters with input capacity > 105,000 Btu/h and ≤ 140,000 Btu/h must comply with the requirements for the > 140,000 Btu/h if the water heater either (1) has a storage volume > 120 gallons, (2) is designed to provide outlet hot water at temperatures greater than 180°F, or (3) uses three-phase power.

m. Water heaters and hot water supply boilers with more than 140 gallons of storage capacity need not meet the standby loss requirement where: (1) the tank surface area is thermally insulated to R-12.5 or more, (2) there is no standing pilot light, and (3) for gas- or oil-fired storage water heaters, the heater is equipped with a fire damper or fan-assisted combustion.

Time of Sale: The baseline for this measure is a new replacement unit of the same system type as the existing unit, meeting the minimum efficiencies provided above.

Early Replacement / Retrofit: The baseline for this measure is the efficiency of the *existing* heating, cooling, and hot water equipment for the assumed remaining useful life of the existing unit, and a new baseline heating and cooling system for the remainder of the measure life (as provided in tables above).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life of the gas heat pump is assumed to be 15 years for a natural gas heat pump[1139].

For early replacement, the remaining life of existing equipment is assumed to be 6 years for an air-source heat pump and Central A/C, 6 years for a furnace, and 8 years for boilers and ground source heat pumps.[1140]

DEEMED MEASURE COST

New Construction and Time of Sale: Incremental costs of the gas heat pump should be used. This would be the actual installed cost of the heat pump equipment as well as system commissioning costs, minus the assumed installation cost of the baseline equipment.

Early Replacement: The actual installed cost of the gas heat pump should be used. The assumed deferred cost of replacing existing equipment with a new baseline is 1/3 of the incremental cost. This future cost should be discounted to present value using the nominal societal discount rate.

The incremental cost of gas heat pump over various replacement equipment is shown in **Table 7**[1141].

Table 7: Incremental Cost of Commercial Gas Heat Pump

Incremental Cost ($/ton)		
Replaced Technologies	**Installed Cost ($/ton)**	**Incremental GHP Cost ($/ton)**
Rooftop Air Source Heat Pump	$1,813	$1,987
Ground Source Heat Pump	$5,781	-$1,981
Electric Boiler	$250	$3,550
Natural Gas Furnace	$92	$3,709
Natural Gas Boiler	$594	$3,206
Air-cooled Electric Chiller	$988	$2,813
Water-cooled Electric Chiller	$550	$3,250
Gas-fired Water Heater	$384	$3,416
Electric-resistance Water Heater	$772	$3,028
Gas Heat Pump	$3,800	

Guide to read incremental cost:

Example 1: for a gas boiler and air-cooled electric chiller being replaced with a gas heat pump, the incremental cost will be (Cost of GHP) – (Cost of Natural Gas Boiler + Air-Cooled Electric Chiller) = $3,800 – ($594 + $988) = $2,218.

Example 2: for a gas boiler and gas-fired water heater being replaced with a gas heat pump, the incremental cost will be Cost of GHP – (Cost of Natural Gas Boiler + Gas Fired Water Heater) = $3,800 – ($594+$384) = $2,822.

[1139] U.S. Energy Information Administration | Assumptions to the Annual Energy Outlook 2021: Commercial Demand Module: https://www.eia.gov/outlooks/aeo/assumptions/pdf/commercial.pdf

[1140] Assumed to be one third of effective useful life of replaced equipment.

[1141] U.S. Energy Information Administration (EIA), Updated Buildings Sector Appliance and Equipment Costs and Efficiencies, March 2023: https://www.eia.gov/analysis/studies/buildings/equipcosts/pdf/full.pdf

LOADSHAPE

Depending on the baseline conditions, the appropriate loadshapes will be a combination of some, but not all, of the loadshapes below. Note for the purpose of cost-effectiveness screening for a fuel switching scenario, the cooling therm increase, and heating therm decrease should be calculated separately such as the appropriate loadshape (i.e., Loadshape C04 – Commercial Electric Heating and Loadshape C03 – Commercial Cooling, (respectively) can be applied.

Loadshape C02 – Commercial Electric SHW

Loadshape C03 – Commercial Cooling

Loadshape C04 – Commercial Electric Heating (if replacing building with no existing cooling)

Loadshape C05 – Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits. The second represents the average savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial Cooling (during system peak hour)

= 91.3%[1142]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial Cooling (average during peak period)

= 47.8%[1143]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS AND FOSSIL FUEL SAVINGS

Non-Fuel Switch Measures:

$$\Delta\text{therms} = \Delta therms_{SACE} + \Delta therms_{SHW}$$

Space Heating Savings

$$\Delta\text{therms}_{SPACE} = \frac{EFLH * Capacity * (Efficiency_{EE} - Efficiency_{Base})}{100{,}000 * Efficiency_{Base}}$$

Where:

EFLH = Equivalent Full Load Hours for heating in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use

Capacity = Nominal Heating Input Capacity Size (Btu/hr) for efficient unit not existing unit

= custom gas-fired heat pump input capacity (Btu/hr)

[1142] Values taken from established TRM references in section 4.4.44 and based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1143] Values taken from established TRM references in section 4.4.44 and based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm M-F, June through August) is divided by the maximum AC load during the year.

$Efficiency_{Base}$ = Baseline Efficiency Rating, dependant on year and boiler type. See Table 4 above

$Efficiency_{EE}$ = Rated Commerical Gas Heat Pump space heating efficiency, expressed as a fuel-input only COP_{Gas}, for the nominal capacity rating condition

Hot water boiler baseline:

Hot Water Boiler Capacity (Btu/hr)	Efficiency
Hot Water < 300,000 [1144]	84% AFUE
300,000 ≤ Hot Water ≤ 2,500,000 [1145]	80% E_T
2,500,000 < Hot Water [1146]	82% E_C

For example, a 150,000 BTU/hr water boiler meeting COP_{Gas} 1.4 is installed in Rockford at a high-rise office building in the year 2022:

ΔTherms = 2,089 * 150,000 * (1.4 - 0.840) / 0.840) / 100,000 Btu/Therm

= 2,089.0 therms

Service Hot Water Savings:

$$\Delta Therms_{SHW} = \frac{(T_{out} - T_{in}) \ * \ HotWaterUse_{Gallon} * \gamma Water * 1.0 * \left(\frac{1}{TE_{gasbase}} - \frac{1}{COP_{Eff}}\right)}{100{,}000}$$

Where:

T_{OUT} = Tank temperature
= 140°F

T_{IN} = Incoming water temperature from well or municipal system
= 50.7°F [1147]

$HotWaterUse_{Gallon}$
= Estimated annual hot water consumption (gallons)
= Actual, if possible to provide reasonable custom estimate. If not, two methodologies are provided to develop an estimate:

1. Consumption per usable storage tank capacity = Capacity * (Consumption/Cap)

Where:

Capacity = Usable capacity of hot water storage tank in gallons
= Actual

Consumption/Cap = Estimate of consumption per gallon of usable tank capacity, based on building type:[1148]

[1144] Code of Federal Regulations, effective January 15, 2021 (10 CFR 432(e)(3)).
[1145] Thermal Efficiency. Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87).
[1146] Combustion Efficiency. Code of Federal Regulations, effective March 2, 2012 (10 CFR 431.87).
[1147] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.
[1148] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

Building Type[1149]	Consumption/Cap
Convenience	528
Education	568
Grocery	528
Health	788
Large Office	511
Large Retail	528
Lodging	715
Other Commercial	341
Restaurant	622
Small Office	511
Small Retail	528
Warehouse	341
Nursing	672
Multi-Family	894

2. Consumption per unit area by building type = (Area / 1000) * Consumption/1,000ft^2

Where:

Area = Area in ft^2 that is served by SHW boiler
= Actual

Consumption/1,000ft^2 = Estimate of SHW consumption per 1,000ft^2 based on building type:[1150]

Building Type[1151]	Consumption/1,000ft^2
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

γWater = Specific weight capacity of water (lb/gal) = 8.33 lbs/gal

[1149] According to CBECS 2012 "Lodging" buildings include Dormitories, Hotels, Motel or Inns and other Lodging and "Nursing" buildings include Assisted Living and Nursing Homes.

[1150] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

[1151] According to CBECS 2012 "Lodging" buildings include Dormitories, Hotels, Motel or Inns and other Lodging and "Nursing" buildings include Assisted Living and Nursing Homes.

1 = Specific heat of water (Btu/lb·°F)[1152]

100,000 = Converts Btu to Therms

$TE_{gasbase}$ = Rated efficiency of baseline water heater (expressed as Uniform Energy Factor (UEF) or Thermal Efficiency as provided below).

COP_{Eff} = Rated efficiency of the commercial gas heat pump as certified expressed as Uniform Energy Factor (UEF) or Coefficient of Performance as provided below.

Note the same draw pattern (very small, low, medium, and high draw) should be used for both baseline and efficient units.

Equipment Type	Sub-Category	Draw Pattern	Federal Standard – Uniform Energy Factor or Thermal Efficiency[1153]
Residential-duty Commercial High-Capacity Storage Gas-Fired Storage Water Heaters >75,000 Btu/h	≤120 gallon tanks	Very small	UEF = 0.2674 – (0.0009 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5362 – (0.0012 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6002 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 0.6597 – (0.0009 * Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >75,000 Btu/h	>120 gallon tanks	All	80% $E_{thermal}$, Standby Losses = (Q /800 + 110√Rated Storage Volume in Gallons)
Commercial Gas Storage Water Heaters >155,000 Btu/h		All	
Commercial Gas Instantaneous Water Heaters >200,000 Btu/h	<10 gallon	All	80% $E_{thermal}$
	≥10 gallon	All	78% $E_{thermal}$

Draw patterns are based on first hour rating (gallons) for storage tanks and maximum flow (GPM) for instantaneous as shown below:[1154]

Storage Water Heater Draw Pattern	
Draw Pattern	**First Hour Rating (gallons)**
Very Small	≥ 0 and < 18
Low	≥ 18 and < 51
Medium	≥ 51 and < 75
High	≥ 75

Instantaneous Water Heater Draw Pattern	
Draw Pattern	**Max GPM**
Very Small	≥ 0 and < 1.7
Low	≥ 1.7 and < 2.8
Medium	≥ 2.8 and < 4

[1152] Specific heat is the amount of heat required to change the temperature of a mass by one degree.
[1153] All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.
[1154] Definitions provided in 10 CFR 430, Subpart B, Appendix E, Section 5.4.1.

For example, for a 200,000 Btu/h, 150 gallon, GHP with a COP = 1.4 installed in a 1500 ft^2 restaurant:

ΔTherms = ((140 – 50.7) * ((1,500/1,000) * 44,439) * 8.33 * 0.975 * (1/0.8 - 1/1.4))/100,000

= 259.0 Therms

Fuel Switch Measures:

Fuel switching measures must produce positive total annual fuel savings (i.e., reduction in Btus) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

SiteEnergySavings (MMBTUs) $= (ElectricHeatReplaced - GHPEnergyConsumed_{Heat}) + (ElectricCoolingReplaced - GHPEnergyConsumed_{Cool}) + (ElectricWaterHeatReplaced - GHPEnergyConsumed_{SHW})$

If Energy Savings calculated above is positive, the measure is eligible.

Electric Space Heating Replaced with Natural Gas Heat Pump

ElectricHeatReplaced [MMBTU] $= (kBtu/hr_{heat} * EFLH_{heat} * (1/COP_{base})) / 1{,}000$

GHPEnergyConsumed$_{Heat}$ [MMBTU] $= ((kBtu/hr_{heat} * EFLH_{heat} * (1/COPP_{GH})) / 1{,}000$

Where:

kBtu/hr$_{heat}$ = capacity of the heating equipment in kBtu per hour (1 ton of heating capacity equals 12 kBtu/hr).

COP$_{base}$ = Coefficient of performance of the baseline equipment, or thermal efficiency if applicable, at nominal condition

= based on the applicable Code on the date of equipment purchase (if unknown assume current Code). If rating is HSPF, COP = HSPF / 3.413

EFLH$_{Heat}$ = Heating Equivalent Full Load Hours
= Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use

COP$_{GHP}$ = Coefficient of performance of the GHP equipment at nominal condition
= Actual installed

Electric Cooling Replaced with Natural Gas Heat Pump

ElectricCoolingReplaced [MMBTU] $= (kBtu/hr_{cool} * EFLH_{cool} * (1 * 3.412/EER_{base})) / 1{,}000$

GHPEnergy Consumed$_{cool}$ [MMBTU] $= ((kBtu/hr_{cool} * EFLH_{cool} * (1/COP_{GHP})) / 1{,}000)$

kBtu/hr$_{cool}$ = capacity of the cooling equipment in kBtu per hour (1 ton of cooling capacity equals 12 kBtu/hr).

EER$_{base}$ = Energy Efficiency Ratio of the baseline equipment at nominal condition

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

COP_{GHP} = Coefficient of performance of the GHP equipment at nominal condition
= Actual installed

Electric Water Heating Replaced with Natural Gas Heat Pump

ElectricWaterHeatReplaced [MMBTU] $=((T_{out} - T_{in}) * HotWaterUse_{gallon} * \gamma Water * 1.0 * (1/TE_{elecbase}))/ 1{,}000{,}000$

$GHPEnergyConsumed_{SHW}$ [MMBTU] $=(Tt_{ou} - T_{in}) * HotWaterUse_{gallon} * \gamma Water * 1.0 * (1/COP_{GHP}) / 1{,}000{,}000$

**See previous nonfuel switch section for most descriptions

$TE_{elecbase}$ = Rated efficiency of baseline water heater expressed as Uniform Energy Factor (UEF) or Thermal Efficiency (TE) or Coefficient of Performance (COP), if not provided for resistance-type electric water heating assume $TE_{elec,base}$ = 0.98

COP_{GHP} = Coefficient of performance of the GHP equipment
= Actual installed

Total Therm Savings = SiteEnergySavings * 10

Example:

A 3,000-squarefoot building with a 120 kBtu/hr output gas heat pump system replacing existing baseline equipment with COP of 1.3 in heating, cooling, and water heating in a Chicagoland public elementary school. The baseline equipment being replaced are all electric heating, cooling, and service hot water heater. Measure Type is EREP/RF

Baseline equipment efficiency: electric baseboard heating – 1.0 COP; electric air source cooling – 10.8 EER. Electric service hot water heater – 0.98 TE.

Heating Site MMBTU Savings = ElectricHeatReplaced - $GHPEnergyConsumed_{Heat}$

ElectricHeatReplaced [MMBTU] = $(kBtu/hr_{heat} * EFLH_{heat} * (1/COP_{base}))$ / 1,000

= $(120 * 1603 * (1/2.25))$ /1,000

= $192.4\ MMBtu$

$GHPEnergyConsumed_{Heat}$ [MMBTU] = $((kBtu/hr_{heat} * EFLH_{heat} * (1/COP_{GHP}))$ / 1000)

= $(120 * 1603 * 1/1.3)/1000$

= $148.0\ MMBtu$

Cooling Site MMBTU Savings = $ElectricCoolingReplaced - GHPEnergy\ Consumed_{cool}$

ElectricCoolingReplaced [MMBTU] = $(kBtu/hr_{cool} * EFLH_{cool} * (1 * 3.412/EER_{base}))$ / 1,000

= $(120 * 837 * (1 * 3.412/10.8))$ /1,000

= $31.7\ MMBtu$

$GHPEnergy\ Consumed_{cool}$ [MMBTU] = $((kBtu/hr_{cool} * EFLH_{cool} * (1/COP_{GHP}))$ / 1000)

= $(120 * 837 * 1/1.3)$ /1000

= $77.3\ MMBtu$

Service Hot Water Heater Site MMBTU Savings = $ElectricWaterHeatReplaced - GHPEnergyConsumed_{SHW}$

ElectricWaterHeatReplaced [MMBTU] = $((T_{out} - T_{in}) * HotWaterUse_{gallon} * \gamma Water * 1.0 * (1/TE_{elecbase}))$ / 1,000,000

= $((140 - 50.7) * (7285 * 3) * 8.33 * 1 * (1/0.98))$ / 1,000,000

= $16.6 MMBtu$

$GHPEnergyConsumed_{SHW}$ [$MMBTU_{source}$] = $((T_{out}-T_{in}) * HotWaterUse_{gallon} * \gamma Water * 1.0 * (1/COP_{GHP})$ / 1,000,000)

= (((140 - 50.7) * (7285*3) * 8.33 * 1.0 * (1/1.3))/1,000,000)

= 12.5 MMBtu

Example continued:

GHPEnergyConsumed$_{SHW}$ [MMBTU$_{source}$] = $((T_{out} - T_{in}) * HotWaterUse_{gallon} * \gamma Water * 1.0 * (1/COP_{GHP}) / 1{,}000{,}000)$

= $(((140 - 50.7) * (7285 * 3) * 8.33 * 1.0 * (1/1.3))/1{,}000{,}000)$

= 12.5 $MMBtu$

Total Site MMBTU Savings = $(194.2 - 148.0) + (31.7 - 77.3) + (16.6 - 12.5)$

= 4.7 $MMBtu$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

New Construction / Time of Sale:

$$\Delta kW = (kBtu/hr * (1/EER_{base})) * CF$$

Early Replacement / Retrofit:

$$\Delta kW = (kBtu/hr * (1/EER_{exist})) * CF$$

Where:

EER_{base} = Energy Efficiency Ratio of the baseline equipment

EER_{exist} = Energy Efficiency Ratio of the existing equipment

= Actual, or assume Code base in place at the original time of existing unit installation

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1155]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1156]

For example, a 120 kBtu/hr electric air source cooling with a 10.8 EER replaced with a gas heat pump in Chicago would save:

ΔkW_{SSP} = (120 * (1 / 10.8)) * 0.913

= 10.14 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A. The installed cost of gas heat pump includes O&M agreement.

[1155] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1156] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from electric to gas.

For the purposes of forecasting load reductions due to fuel switch HP projects; changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure. For Early Replacement measures, the efficiency terms of the existing unit should be used for the remaining useful life of the existing equipment (6 years for ASHP and Central AC, 6 years for furnace, 8 years for boilers or GSHP, 15 years for electric resistance), and the efficiency terms for a new baseline unit should be used for the remaining years of the measure.

ΔTherms = $[Increased\ Consumption]$

ΔTherms = $-\ (Therms_{SPACE}\ +\ Therms_{SHW}\ +\ Therms_{Cool})$

Therms$_{SPACE}$ = $((kBtu/hr_{heat})\ *\ 1/COP_{GHP}\ *\ EFLH_{heat})*\ 1000/\ 100{,}000$

Therms$_{SHW}$ =$((T_{out}-T_{in})\ *\ HotWaterUse_{gallon}*\ \gamma Water\ *1\ *\ (1/COP_{GHP}))/\ 100{,}000$

Therms$_{Cool}$ =$((kBtu/hr_{cool})\ *\ 1/COP_{GHP}\ *\ EFLH_{cool})\ *\ 1{,}000/100{,}000$

ΔkWh = $[Replaced\ Consumption]$

ΔkWh = $(kWh_{SPACE}\ +\ kWh_{SHW}\ +\ kWh_{Cool})$

kWh$_{SPACE}$ =$(kBtu/hr_{heat})/3.412\ *\ 1/COP_{base}\ *\ EFLH_{heat}$

kWh$_{SHW}$ =$((T_{out}-T_{in})\ *\ HotWaterUse_{gallon}*\ \gamma Water\ *0.975\ *\ (1/TE_{elecbase}))/3413$

kWh$_{Cool}$ = $(kBtu/hr_{cool})\ *\ (1/EER_{base})\ *\ EFLH_{cool}$

MEASURE CODE: CI-HVC-GFHP-V06-270101

REVIEW DEADLINE: 1/1/2030

4.4.56 Commercial Duct Sealing

DESCRIPTION

This measure was developed to reduce the heating and cooling losses from ducts running through un-conditioned spaces, including, but not limited to: unheated/uncooled attics, basements or crawlspaces; or the outdoors. To the extent that the duct runs through a conditioned space, such as occupied rooms, between conditioned building floors, or semi-heated or semi-cooled spaces, this measure is not applicable as it is assumed that all heating or cooling losses from the duct perform beneficial heating or cooling to the conditioned space. This assumption ignores the potential overheating and overcooling of the conditioned space, which energy waste is hereby deemed to be negligible.[1157]

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is installing duct wrap or other insulation to a length of HVAC ductwork. If applied to ductwork that currently, or in the future may transmit cooling air, the insulation must be wrapped with an impermeable vapor barrier.

The efficient duct air sealing case is installing elastomeric sealant externally to cracks and holes in ductwork that completely and permanently seals the ductwork from air leakage. The elastomeric material must remain flexible and adhere to the ductwork during the measure lifetime and to withstand significant swings in ductwork temperature without losing its sealing capability.

DEFINITION OF BASELINE EQUIPMENT

Baseline equipment is an uninsulated and/or un-sealed duct located within an un-conditioned space. If a duct has previously been insulated but a significant portion of the insulation has deteriorated or fallen off, the program shall verify the duct insulation condition and determine whether the duct can be considered “un-insulated” for purposes of applying for an incentive.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 20 years.[1158]

DEEMED MEASURE COST

The actual installation cost should be used if known. If unknown, the measure cost for duct insulation, including material and installation, is assumed to be $8.00 per square foot[1159] and for duct crack sealing, including materials and installation, is assumed to be $15.00 per linear foot.[1160]

LOADSHAPE

Loadshape C01 – Commercial Electric Cooling

Loadshape C03 – Commercial Cooling

Loadshape C04 – Commercial Electric Heating

Loadshape C05 – Commercial Electric Heating and Cooling

[1157] It is recommended that additional analyses be considered using custom analysis to determine the extent of overheating or overcooling from uninsulated or unsealed ductwork running through conditioned spaces.
[1158] Measure Life Report, Residential and Commercial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.
[1159] Engineering estimate provided by John Johnson.
[1160] Engineering estimate provided by John Johnson.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1161]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1162]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Where available, savings from duct Insulaton measures should be determined through a custom analysis. When that is not feasible for the program, the following engineering algorithms can be used.

$$\Delta kWh = \Delta kWh_cooling + \Delta kWh_heatingElectric + \Delta kWh_heatingGas$$

Where:

ΔkWh_cooling = If building is cooled, reduction in annual cooling requirement due to duct insulation

$$= ((1 / R_DuctExist - 1 / R_DuctEfficient) * A_Duct + 1.08 * CFM_Saved * EFLHCool * (Avg_Clg_OAT - Avg_Duct_Clg_SAT)) / 1000 / \eta Cool * \%Cool$$

Where:

$R_Duct_{Efficient}$ = Average R-value of proposed duct assembly after installation of additional insulation

= Actual

R_Duct_{Exist} = Average R-value value of existing duct assembly, including any existing insulation

= if duct is uninsulated, the average R-value deemed to be 0.8 hr-sf-F/BTU[1163]

A_Duct = Net area of duct proposed to be insulated (ft^2)

= Actual

1.08 = Specific heat of air x density of inlet air @ 70F x 60 min/hr in BTU

CFM_Saved = Quantity of duct leakage saved by application of crack sealant to previously unsealed ductwork

[1161] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1162] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1163] ASHRAE. Inside duct air film assumed to be <0.1 hr-sf-F/BTU; Outside of duct assumed to be in still air with air film R-value of 0.79 hr-sf-F/BTU,

= CFM/Ft for average crack width from table below[1164], adjusted for actual duct internal pressure[1165] * Length of Crack (Ft.)

Average Crack Width (Inches)	CFM Air Leakage per Foot of Crack @ 0.3" w.c. duct
0.00	0 CFM
0.05	7 CFM
0.10	13 CFM
0.15 (Default if Unknown)	20 CFM
0.20	26 CFM
0.25	33 CFM
0.30	39 CFM
0.35	46 CFM
0.40	52 CFM
0.45	59 CFM
0.50	65 CFM
Unknown	20 CFM

$EFLH_{Cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

Avg_Clg_OAT = Deemed average ambient air temperature over the cooling season in the building space through which the HVAC duct runs, based on climate zone:[1166]

Climate Zone	Cooling Season Avg OA DBT
1 - Rockford	71.3 degF
2 - Chicago	73.7 degF
3 - Springfield	70.7 degF
4 - Belleville	76.3 degF
5 - Marion	69.0 degF

Avg_Duct_Clg_SAT = 60 degF.[1167]

[1164] ASHRAE Fundamentals (2017), Page 16.28, Fig 14. Elevator door CFM assumed to apply to low-rise commercial buildings. Straight line regression analysis was used by ASHRAE: CFM values from 0.0" to 0.2" crack width for personnel doors; and CFM values from 0.0" to 0.3" crack width for elevator doors. The same straight line regression formula is assumed to apply to larger crack widths up to 0.5.

[1165] ASHRAE Fundamentals (2017), Page 16.28, Fig. 14: "For other dP, Multiply Leakage Rate by (dP/0.3)^0.55" .

[1166] BinMaker Pro weather data, based on average outdoor air temperatures over the hottest 5 calendar months. Outdoor average temperatures is assumed to be equivalent to the average temperatures of typical duct locations in: attics, basements, crawl spaces and outdoors. Additional research is recommended to verify actual average ambient temperatures in these areas; additional inputs may be recommended to identify the actual space type of the duct and create a lookup table based on space type and climate zone.

[1167] Engineering estimate by John Johnson – Leidos, based on estimate of average supply air temperature, both for continuous fan operation scenarios and automatic on/off fan operation scenarios. Additional research is recommended to verify actual average duct cooling supply temperatures; additional inputs may be recommended to identify HVAC fan control modes and create a lookup table based on fan control mode type and climate zone.

24 = Converts days to hours

1000 = Converts Btu to kBtu

ηCool = Efficiency of cooling system * Distribution efficiency. Actual, if known and assume 95% distribution efficiency. Alternatively, use IECC 2012 as a default source if equipment type is known, or as deemed from table below[1168]

Space Cooling	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling Source	10.2	11.1

%Cool = Percent of building ***where duct insulation is to be installed*** that is cooled

= Actual %, if known, or, If actual % unknown, use following deemed values:

Is Space Being Insulated Cooled?	Deemed %Cool, if actual % is unknown
Yes	100%
No	0%

For example, insulating an uninsulated 300 ft^2 duct and sealing 473 cfm leakage for an Assembly Building Type in Rockford with unknown cooling system: R_Duct_{Exist} = 0.8; $R_Duct_{Efficient}$ = 12.8; A_Duct = 300; CFM_Saved = 473; $EFLH_{Cool}$ = 725; Avg_Clg_OAT = 71.3; Avg_Duct_Clg_SAT = 60; ηCool = 13.0; %Cool = 100%

ΔkWh_cooling = ((1 / 0.8 - 1 / 12.8) * 300 + 1.08 * 473) * 725 * (71.3 - 60) / 1000 / 13.0 * 100%

= 543 kWh

ΔkWh_heatingElectric = If electric heat (resistance or heat pump), reduction in annual electric heating due to wall and/or foundation insulation

$$= [(1 / R_DuctExist - 1 / R_DuctEfficient) * A_Duct + 1.08 * CFM_Saved] * EFLHHeat * (Avg_Duct_Htg_SAT - Avg_Htg_OAT) / \eta Heat / 3412 * \%ElectricHeat$$

Where:

$EFLH_{Heat}$ = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

Avg_Htg_OAT = Deemed average ambient air temperature over the cooling season in the building space through which the HVAC duct runs, based on climate zone:[1169]

[1168] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95.

[1169] BinMaker Pro weather data, based on average outdoor air temperatures over the hottest 5 calendar months. Outdoor average temperatures is assumed to be equivalent to the average temperatures of typical duct locations in: attics, basements,

Climate Zone	Heating Season Avg OA DBT
1 - Rockford	29.4 degF
2 - Chicago	34.2 degF
3 - Springfield	27.4 degF
4 - Belleville	38.4 degF
5 - Marion	31.4 degF

Avg_Duct_ Htg _SAT = 85 degF.[1170]

ηHeat = Efficiency of heating system * distribution efficiency, as deemed from table below

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95 (distribution efficiency)
Heat Pump	7.37[1171]	2.05
Resistance	N/A	1

3412 = Converts Btu to kWh

%ElectricHeat = Percent of building ***where duct insulation is to be installed*** that is electrically heated

= Actual %, if known, or, If actual % unknown, use following deemed values:

Is Space Being Insulated Electrically Heated?	Deemed %ElectricHeat, if actual % is unknown
Yes	100%
No	0%

For example, insulating an uninsulated 300 ft^2 duct and sealing 473 cfm leakage for an Assembly Building Type in Rockford with electric resistance heating system: R_Duct_{Exist} = 0.8; $R_Duct_{Efficient}$ = 12.8; A_Duct = 300; CFM_Saved = 473; $EFLH_{Heat}$ = 1787; Avg_Htg_OAT = 29.4; Avg_Duct_Htg_SAT = 85; ηHeat = 1.0; %Electric Heat = 100%

ΔkWh_heatingElectric = ((1 / 0.8 – 1 / 12.8) * 300 + 1.08 * 473) * 1787 * (85 - 29.4) / 3412 / 1.0 * 100%

= 25,113 kWh

crawl spaces and outdoors. Additional research is recommended to verify actual average ambient temperatures in these areas; additional inputs may be recommended to identify the actual space type of the duct and create a lookup table based on space type and climate zone.

[1170] Engineering estimate by John Johnson – Leidos, based on estimate of average supply air temperature, both for continuous fan operation scenarios and automatic on/off fan operation scenarios. Additional research is recommended to verify actual average duct heating supply temperatures; additional inputs may be recommended to identify HVAC fan control modes and create a lookup table based on fan control mode type and climate zone.

[1171] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.

ΔkWh_heatingGas = If gas furnace or boiler heat, kWh savings for reduction in combustion fan run time

$= \Delta Therms * Fe * 29.3$

Where:

ΔTherms = Annual therms of gas space heating saved, as determined below

F_e = Furnace or boiler combustion fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1172]

29.3 = conversion of therms to kWh (= 100000 / 3412)

Other variables as defined above

For example, if: ΔTherms = 1072; F_e = 7.7%, then:

ΔkWh_heatingGas = 1072 * 7.7% * 29.3

= 2419 kWh

For example, based on the above calculations with electric resistance heat, total annual kWh savings =

Total Annual kWh Savings = 543 + 25,113 + 0

= 25,657 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh_cooling}{EFLH_Cooling} * CF$$

Where:

ΔkWh_cooling = Annual kWh saving in cooling energy use, as determined above

EFLH_cooling = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1173]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1174]

[1172] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[1173] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1174] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

For example based on example above: ΔkWh_cooling = 543; EFLH_Cooling = 725; CF = 0.478; then:

Summer Coincidcent Peak savings = 543 / 725 * 0.478
= 0.36 kW

FOSSIL FUEL SAVINGS

If Natural Gas heating:

ΔTherms

$$= [(1 / R_DuctExist - 1 / R_DuctEfficient) * A_Duct + 1.08 * CFM_Saved] * EFLHHeat * (Avg_Duct_Htg_SAT - Avg_Htg_OAT) / \eta Heat / 100{,}000 * \%GasHeat$$

Where:

ηHeat = Efficiency of heating system, including distribution losses

= Actual, if unknown assume 0.821.[1175]

%GasHeat = Percent of space being retrofitted with insulation that is heated using gas

= Actual %, if known, or, If actual % unknown, use following deemed values:

Is Space Being Insulated Heated with Gas?	Deemed %GasHeat, if actual % is unknown
Yes	100%
No	0%

Other variables as defined above

For example, insulating an uninsulated 300 ft^2 duct and sealing 473 cfm leakage for an Assembly Building Type in Rockford with unknown gas heating system: R_ExistWall = 0.8; R_NewWall = 12.8; A_Duct = 300; CFM_Saved = 473; $EFLH_{Heat}$ = 1787; Avg_ Htg _OAT = 29.4; Avg_Duct_ Htg _SAT = 85; ηHeat = 0.8; %GasHeat = 100%; then

Annual Therm Savings = ((1 / 0.8 - 1 / 12.8) * 300 + 1.08 * 473) * 1787 * (85 - 31.4) / 0.8 / 100,000 * 100%
= 1033 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-DSEAL-V04-270101

REVIEW DEADLINE: 1/1/2029

[1175] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

4.4.57 Condensate Recovery System

DESCRIPTION

This measure is applied to steam fossil-fuel fired boilers where partial or no condensate is returned. As more condensate is returned into the boiler system, less make-up water is required, saving fossil-fuel, make-up water chemical, and treatment cost[1176]. Less condensate discharged into the sewer also means reduced disposal costs and reduction in energy losses due to energy blowdown[1177]. The measure is applicable to commercial applications, commercial HVAC including multifamily buildings, low pressure applications, medium pressure industrial applications, and high-pressure industrial applications.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as functional steam system that increase the return of condensate in comparison to the baseline case. New systems are not eligible for this measure.

DEFINITION OF BASELINE EQUIPMENT

Baseline is an existing steam boiler system where minimal or no condensate is returned.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years[1178].

DEEMED MEASURE COST

If known, the actual material and labor cost of installation should be used. If unknown, the average measure cost per GPM of condensate returned is $4,861[1179]. This cost includes material and labor for installing condensate recovery systems (storage tanks, pipes and pumps).

LOADSHAPE

Loadshape C35 – Industrial Process
Loadshape C36 – HVAC Pump motor (heating)

COINCIDENCE FACTOR

For process boiler systems, the summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

0 for space heating boiler systems.

[1176] Vineeth C, M G Prince. Impact of Condensate Recovery on Boiler Fuel Consumption in Textile Sector. Vol. 3. Issue 5
[1177] U.S. DOE. Return Condensate to the Boiler. Energy.gov/sites/prod/files/2014/05/f16/steam8_boiler.pdf
[1178] Table 4 Chapter 36, Comparison of Service Life Estimates, 2007 ASHRAE Handbook, HVAC Applications
[1179] Results from Condensate Recovery efficiency improvement research through the C&I and Public Sector Custom Rebate Program, and Small Business Program. The evaluation included project and population data from years 2016 – 2022.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

This measure results in additional electric use due to the addition of the condensate pump.

$$\Delta\text{kWh} = -\left(\text{HP}_{\text{motor}} \times 0.746 \times \frac{\text{LF}}{\eta_{\text{motor}}}\right) \times \text{hours}$$

Where:

HP_{motor} = Installed nameplate motor horsepower

= Actual. If unknown:

E.D.R (sq. ft) Boiler HP BTUH (1000's) $\text{lbm}_{\text{steam}}$/hr	Pump[1180] USGPM	Pump Discharge Pressure PSI	Motor[1181] HP 3500 RPM
1,000	1.50	10	1/2
7		20	1/2
240		30	1/2
250		40	3/4
2,000	3.00	10	1/2
14		20	1/2
480		30	1/2
500		40	3/4
		50	1 1/2
4,000	6.00	10	1/2
29		20	1/2
960		30	1/2
1,000		40	3/4
		50	1 1/2
6,000	9.00	10	1/2
43		20	1/2
1,440		30	1/2
1,500		40	3/4
		50	1 1/2
10,000	15.00	10	1/2
71		20	1/2
2,400		30	1/2

[1180] Condensate pumps are rated in square feet EDR. To convert boiler rating to square feet EDR use the following conversion factors:
Multiply boiler horsepower (BHP) by 140 to get square feet EDR
Divide Btu/h by 240 to get square feet EDR
Multiply lbs of steam per hour by 4 to get square feet EDR
A boiler can put out half a gallon per 1000 sq ft EDR per minute. Size the pump capacity for twice to three times the return rate. Then assign a motor HP based on the system's pressure requirement.

[1181] Steve Almgreen. "How to size a condensate return unit" Xylem Inc, 2015. Steam Team Products

E.D.R (sq. ft) Boiler HP BTUH (1000's) lbm_{steam}/hr	Pump[1180] USGPM	Pump Discharge Pressure PSI	Motor[1181] HP 3500 RPM
2,500		40	1
		50	2
20,000		10	1/2
143		20	1/4
4,800	30.00	30	1
5,000		40	1 1/2
		50	2
25,000		10	3/4
179		20	1
6,000	37.50	30	1 1/2
6,250		40	1 1/2
		50	2 1/2
30,000		10	3/4
214		20	1
7,200	45.00	30	1 1/2
7,500		40	2 1/2
		50	5
40,000		10	1 1/2
286		20	1 1/2
9,600	60.00	30	2
10,000		40	5
		50	5
50,000		10	2
357		20	2
12,000	75.00	30	3
12,500		40	5
		50	7 1/2
65,000		10	2
464		20	2 1/2
15,600	97.50	30	2 1/2
16,250		40	5
		50	7 1/2
		60	7 1/2
80,000		10	2 1/2
571		20	2 1/2
19,200	120.00	30	2 1/2
20,000		40	5
		50	7 1/2
		60	7 1/2

E.D.R (sq. ft) Boiler HP BTUH (1000's) lbm_{steam}/hr	Pump[1180] USGPM	Pump Discharge Pressure PSI	Motor[1181] HP 3500 RPM
100,000	150.00	10	3
714		20	3
24,000		30	3
25,000		40	5
		50	7 1/2
		60	10

0.746 = Conversion factor from horsepower to kW (kW/hp)

$\frac{LF}{\eta_{motor}}$ = Combined as a single factor since efficiency is a function of load

Where:

LF = Load Factor; Ratio of the peak running load to the nameplate rating of the motor

= Actual, or if unknown 0.65[1182]

η_{motor} = Motor efficiency at pump operating conditions

= Actual

HOURS = Annual operating hours of the pump

For space heating

= Operating hours of heating system

For other processes

= Actual. If unknown:

Shift	Hours
Single shift (8/5)	1,976 hours 7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952 hours 7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928 hours 24 hours per day, weekdays,
4-shift (24/7)	8,320 hours 24 hours/day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average[1183]	5,702 hours

[1182] "Measured Loading of Energy Efficient Motors - the Missing Link in Engineering Estimates of Savings," ACEEE 1994 Summer Study Conference, Asilomar, CA.

[1183] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = -\left(HP_{motor} \times 0.746 \times \frac{LF}{\eta_{motor}}\right) \times CF$$

Where:

CF = Summer Coincident Peak Factor for measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average[1184]	0.89

FOSSIL FUEL SAVINGS (WATER SAVINGS MUST BE CALCULATED FIRST)

Fossil-fuel savings are calculated by estimating the amount of water that is discharged into the sewer. Savings are calculated on the enthalpy difference between make-up water and condensate temperature.

$$\Delta Therms = \frac{\Delta Water \times 8.33 \times (H_r - H_w) \times (1 - S_{loss})}{n_{boiler} x\ 100{,}000}$$

The calculated water savings (in gallons/year) is in turn, used to calculate fossil-fuel savings. The condition of condensate recovery systems varies widely between facilities. Flow meter readings or make-up water records are required for accurate calculations. For condensate systems where partial condensate is returned, a custom calculation is suggested.

$$\Delta Water = \left[\frac{EFLH \times Capacity}{[(H_s - H_r)(\%_{Existing}) + (H_s - H_w)(1 - \%_{Existing})] \times 8.33}\right]\left[\frac{\%_{Proposed} - \%_{Existing}}{1 - \%_{Existing}}\right]$$

ΔWater = Condensate water (gal) discharged into sewer that is saved after recovery systems are in place.

8.33 = specific mass in pounds of one gallon of water (lbm/gal)

= Actual if known.

EFLH = Equivalent Full Load hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

Capacity = Nominal Heating Input Capacity Boiler Size (Btu/hr) for existing unit

= Custom Boiler input capacity in btu/hr

H_s = Enthalpy of supplied steam[1185] (Btu/lbm)

[1184] Ibid.

[1185] Taken from IL TRM Measure 4.4.14 Pipe Insulation

System Type	Supply Fluid temperature [1186,1187] (°F)	Enthalpy of steam or hot water (Btu/lbm)
5 psi Steam (low pressure)	225	1,155
15 psi Steam (low pressure)	250	1,163
40 psi Steam (low pressure)	287	1,176
65 psi Steam (high pressure)	312	1,183
100 psi Steam (high pressure)	338	1,190

H_r = Enthalpy of return steam (Btu/lbm)

The condensate fluid temperature assumption used depends upon both the system type and whether there are outdoor reset controls[1188]:

System Type	Return Fluid Temperature[1189] (°F)	Enthalpy of condensate (Btu/lbm)
5 psi Steam (low pressure)	225	193
15 psi Steam (low pressure)	250	219
40 psi Steam (low pressure)	287	256
65 psi Steam (high pressure)	312	282
100 psi Steam (high pressure)	338	309
150 psi Steam (high pressure)	365	338

H_w = Enthalpy of incoming water from well or municipal system (Btu/lbm)

= 18.8 Btu/lbm for an incoming water temperature of 50.7°F [1190]

S_{loss} = Percentage of flash steam loss

= 12%[1191] or actual if known.

%existing = Percentage of existing condensate recovery

= 0% if no condensate is recovered or Actual If known

%proposed = Percentage of proposed condensate recovery

= 80%[1192] or actual if known

n_{boiler} = Efficiency of the steam boiler

= Actual or if unknown use default values given below:

[1186] A typical design uses a Δ20°F from hot water supply temperature to return temperature. ASHRAE. Boiler System Efficiency. 2006. http://goesheatingsystems.com/wp-content/uploads/2015/04/BoilerEfficiencyArticle.pdf

[1187] Typical hot water boiler operating temperature is 180°F. ASHARE. Boiler system Efficiency. 2006. http://goesheatingsystems.com/wp-content/uploads/2015/04/BoilerEfficiencyArticle.pdf

[1188] Taken from IL TRM Measure 4.4.14 Pipe Insulation

[1189] A typical design uses a Δ20°F from hot water supply temperature to return temperature. ASHRAE. Boiler System Efficiency. 2006. http://goesheatingsystems.com/wp-content/uploads/2015/04/BoilerEfficiencyArticle.pdf

[1190] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[1191] U.S. Department of Energy. Return Condensate to the Boiler. https://www.energy.gov/sites/prod/files/2014/05/f16/steam8_boiler.pdf

[1192] Okbaendrias, Biniam. Energy Management in Industries: Analysis of energy savings potential by steam condensate return. Page 10. About 75-85% of the total condensate return in reasonable.

= 79% for steam boilers[1193]

100,000 = Btu to therms for natural gas conversion factor. For other fossil-fuel, find appropriate conversion.

For example, for a Chicago 1,500 kbtu/hr steam boiler in an elementary school operating at 5 psi with a failed condensate return system.

ΔWater = (1,603 * 1,500,000)/((((1155-193)*0) + ((1155-18.8)*(1-0))) * 8.33)*((0.8-0)/(1-0))

= 203,243 gallons

ΔTherms = (203,243 * 8.33 * (193 - 18.8) * (1 – 0.12)) /(0.807 * 100,000)

= 3,216 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

The methodology for calculating water savings involves obtaining the gallons of water that is dumped into the drain. Refer to fossil-fuel savings for calculation.

DEEMED O&M COST ADJUSTMENT CALCULATION

Maintenance personnel should complete annual or semi-annual maintenance inspections of the condensate return system for its optimal performance. The O&M cost shall be included in cost-effectiveness calculations. It is recommended to service the following components to maintain the system's proper operation: pumps, ensure periodic lubrication for motors, in accordance with the motor manufacturer's guidelines. Strainers, traps should also be included as an O&M consideration. A custom calculation should be used as necessary.

MEASURE CODE: CI-HVC-CNDR-V03-260101

REVIEW DEADLINE: 1/1/2029

[1193] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

4.4.58 Steam Trap Monitoring System

DESCRIPTION

The measure applies to the installation of a steam trap monitoring system. The measure is applicable to commercial applications, commercial HVAC including multifamily buildings, and industrial applications. An existing measure, 4.4.16 Steam Trap Replacement or Repair, covers the replacement of a faulty steam trap in the failed open or leaking state. In addition to the steam trap replacement savings, the proposed measure allows to account for savings due to faster repair of the steam traps. Once a failed steam trap is detected, it can be immediately repaired/replaced. Continuous steam trap monitoring leaves behind manual inspections (audits) by using sensors to transmit real-time conditions of the steam system.

Energy savings for each steam trap occurs only when failed open, and steam trap failure rates vary based on trap size, type, and pressure. Energy savings are calculated on a per trap basis with the assumed annual failure rate for each application. Separate savings methodologies are recommended for space heating and process heating applications.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Customers must install a steam trap monitoring system on properly functioning steam traps serving either space heating or process heating load. The monitoring system must be capable of tracking the following, but not limited to, number of steam traps, trap type, operating pressure, operating temperature, ambient temperature, trap condition, date/time, application, and trap location. Applicants must provide characteristics for the steam system such as heating efficiency, steam trap orifice size(s), and system pressure(s). Customer must commit to repairing/replacing steam traps identified as failed by the steam trap monitoring system.

DEFINITION OF BASELINE EQUIPMENT

The baseline criterion are functioning steam traps serving either space heating or process heating load with no pre-existing monitoring system. No minimum leak rate is required.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years based on vendor estimates.[1194]

DEEMED MEASURE COST

The costs are subject to the subscription period chosen by the customer as shown in table below. The approximate installed cost is per trap per year and includes sensors, gateway, cellular service, cloud hosting, User license, data, and reports.

Number of Traps	Term[1195]				
	1 Year	2 Years	3 Years	4 Years	5 Years
100 – 250	$300	$282	$265	$249	$234
250 – 499	$291	$274	$257	$242	$227
500 – 999	$282	$265	$249	$234	$220
1000 – 1999	$274	$257	$242	$227	$214
2000 – 2999	$266	$250	$235	$221	$207
3000 – 4999	$262	$246	$232	$218	$204
5000 – 5999	$258	$242	$228	$214	$201
6000 – 6999	$254	$238	$224	$210	$198
7000+	$251	$235	$221	$207	$196

[1194] Measure life as referenced in Michigan CI Technologies & Franklin Energy "Work paper FES-H8a – Steam Trap Monitoring System" dated September 2016.

[1195] The Everactive Steam Trap Monitoring Service Price

Additional costs exist for the repair or replacement of steam traps once identifying a fault.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Secondary kWh Savings for Water Supply and Wastewater Treatment

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings. These savings only apply to situations in which steam is lost from the steam system.

$$\Delta kWh_{water} = \Delta Water\ (gallons)/1{,}000{,}000\ \times E_{water\ supply}$$

Where:

$E_{water\ supply}$ = Water Supply Energy Factor (kWh/Million Gallons)

= 2571[1196]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta Therm = N\ \times P_{malfunctioning} \times F_o \times S_a \times \left(\frac{\left(Hv + Hs \times (T_1 - T_{source})\right) \times Hours}{(100{,}000 \times \eta_B)}\right)$$

Where:

N = Total number of steam traps monitored through the steam trap monitoring system

$P_{malfunctioning}$ = Annual Percentage of malfunctioning traps

$P_{malfunctioning} = L \times T_{audit} \times T_u$

Where:

L = Leaking & Blow-thru

= custom, if unknown:

Steam System	L (%)[1197]
Commercial Dry Cleaners	27%
Commercial Heating (including Multifamily) LPS	27%
Industrial and Process Low Pressure ≤ 15 psig	16%
Medium Pressure > 15 psig < 30 psig	16%

[1196] This factor includes 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'. Note since the water loss associated with this measure is due to evaporation and does not discharge into the wastewater system, only the water supply factor is used here.

[1197] Dry cleaners survey data as referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012.

Steam System	L (%)[1197]
Medium Pressure ≥ 30 < 75 psig	16%
High Pressure ≥ 75 < 125 psig	16%
High Pressure ≥ 125 < 175 psig	16%
High Pressure ≥ 175 < 250 psig	16%
High Pressure ≥ 250 < 300 psig	16%
High Pressure ≥ 300 psig	16%

T_{audit} = Average time between audits

Custom, if unknown use 1 year

Tu = Average percentage of year trap malfunctions are undetected for steam systems without a steam trap monitoring system

Custom, if unknown use 50%[1198]

F_o = Failed open to total failed ratio

= Custom, if unknown: [1199]

96%, Space heating applications

98%, Dry cleaners

94%, All other steam systems and applications

S_a = Steam loss per leaking trap, (lbs/hr)

Hv = Heat of vaporization of steam, (Btu/lbm)

Steam System	Average Inlet Pressure psig	Heat of Vaporization (Btu/lbm)[1200]
Commercial Dry Cleaners	82.8[1201]	890
Commercial Space Heating (including Multifamily) LPS	11.2[1202]	951
Industrial/Process Low Pressure: psig < 15	11.2[1171]	951
Medium Pressure: 15 ≤ psig < 30	16	944
Medium Pressure: 30 ≤ psig < 75	47	915
High Pressure: 75 ≤ psig < 125	101	880
High Pressure: 125 ≤ psig < 175	146	859

[1198] The energy savings estimates of this measure assume that without an automatic steam trap monitoring system, manual audits would be performed once per year, so a leaking steam trap would, on average, leak for 6 months before being detected and repaired/replaced when the trap fails

[1199] Results from Steam Trap Audit/Replacement efficiency improvement research through the C&I and public Sector Prescriptive Rebate Program, Small Business Program and the Multi-family program. The evaluation included project and population data from years 2019 through 2022

[1200] Heat of vaporization of steam at the inlet pressure to the steam trap. Implicit assumption that the average boiler nominal pressure where the vaporization occurs, is essentially that same pressure. Referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012.

[1201] Medium and high-pressure steam trap inlet pressure based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours. Dry cleaning steam trap inlet pressure based on C5 Steam Traps – Nicor FINAL 10.27.11.

[1202] Results from Armstrong International research through the steam trap management platform SAGE. The research population data included Commercial Heating LPS as well as Industrial or Process Low Pressure, < 15 psi applications. The search of the database yield 120,853 steam traps meeting these parameters: Average orifice size 0.21" and average pressure 11.2 psi.

Steam System	Average Inlet Pressure psig	Heat of Vaporization (Btu/lbm)[1200]
High Pressure: 175 ≤ psig < 250	202	837
High Pressure: 250 ≤ psig < 300	263	816
High Pressure: 300 ≤ psig	--	Custom

Hs = Specific heat of water, $(Btu/(lbm * °R))$

= 1.001

T_1 = Temperature of Saturated Steam, $(°R)$

= $507.89 \times {P_1}^{0.0962}$

Where:

= $507.89 = Constant, °R \times \left(in^2/lb_f\right)^{0.0962}$

T_{source} = $513.67\ °R$[1203]

Hours = Annual hours when steam system is pressurized

= custom, if unknown:

Steam System	Zone (Where applicable)	Hours/Yr[1204]
Commercial Dry Cleaners	All Climate Zones	2,425
Industrial/Process Low Pressure: psig < 15		8,282
Medium Pressure: 15 ≤ psig < 30		8,282
Medium Pressure: 30 ≤ psig < 75		8,282
High Pressure: 75 ≤ psig < 125		8,282
High Pressure: 125 ≤ psig < 175		8,282
High Pressure: 175 ≤ psig < 250		8,282
High Pressure: 250 ≤ psig < 300		8,282
High Pressure: 300 ≤ psig		8,282
Commercial Space Heating LPS	Rockford	4,272
	Chicago	4,029
	Springfield	3,406
	Belleville	2,515
	Marion	2,546
Multifamily Space Heating LPS	For steam traps that are part of steam systems where the boiler cycles on/off to maintain space setpoint temperature or for steam traps located downstream of a steam control valve that opens/closes to maintain setpoint temperature, use Heating EFLH values in Section 4.4 for High Rise or Mid-Rise MF buildings. For steam traps that are exposed to steam continuously throughout the heating season, use	

[1203] US DOE Building America Program. Building America Analysis Spreadsheet. For Chicago, IL.

[1204] Medium and high-pressure steam trap annual operating hours based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours.

Steam System	Zone (Where applicable)	Hours/Yr[1204]
	the values listed above for Commercial Space Heating LPS for your appropriate climate zone.	

100,000 = Conversion factor $(Btu/Therms)$

η_B = Boiler efficiency

= custom, if unknown:

79% for steam boilers[1205]

Low-Pressure System (≤ 5psig) Space Heating Savings Estimates

For systems used in space heating applications that operate at 5 psig or lower, use the following equation to calculate S_a[1206]. The condensate return system pressure, P_2, will typically be atmospheric pressure, 14.696 psia.

$$S_a = 1{,}519.3 \times P_1 \times D^2 \times \left[\left({}^{1}/_{T_1}\right) \times \left({}^{\gamma}/_{(\gamma-1)}\right) \times \left(\left({}^{P_2}/_{P_1}\right)^{({}^{2}/_{\gamma})} - \left({}^{P_2}/_{P_1}\right)^{({}^{(\gamma+1)}/_{\gamma})}\right)\right]^{0.5} \times A \times FF$$

Where:

1,519.3 = Constant, $(s^2 \times °R^{0.5})/(ft \times hr)$

P_1 = Average steam trap inlet pressure $(absolute, psia)$. If not available, apply a assumed default pressure of 5 psig (note that the default is provided in psig, not psia; to calculate the default psia add atmospheric pressure, 14.696, to the assumed gauge pressure, psig)

D = Diameter of orifice, inches. Actual value should be used wherever possible as this value has a significant impact on steam flowrate value.

γ = Heat Capacity Ratio $(unitless)$

= $5.071 \times 10^{-4} \times P_1 + 1.332$

P_2 = Average steam trap outlet pressure $(absolute, psia)$. If unknown, assume atmospheric pressure, $14.696\ psia$

A = Adjustment factor

= 50%,[1207] all steam systems. This factor accounts for reduction in the maximum theoretical steam flow to the average steam flow (the Enbridge factor).

FF = Flow factor. In addition to the Adjustment factor (A), and additional 50% flow factor adjustment is recommended for medium and high-pressure steam systems to address industrial float and thermostatic style traps where additional blockage is possible.

Defaults are provided in table below if custom calculation is not performed. The savings are averages for common orifice diameters $\left({}^{1}/_{8}, {}^{3}/_{16}, {}^{1}/_{4}, {}^{5}/_{16}\ inches\right)$ at an assumed 5 psig.

[1205] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

[1206] See "Derivation of Equation for Subsonic Compressible Flow through an Orifice and Supporting Calculations for Illinois TRM Steam Trap Measure" paper for more information

[1207] Enbridge adjustment factor used as referenced in CLEAResult "Work paper Steam Traps Revision #2" Revision 3 dated March 2, 2012 and DOE Federal Energy Management Program Steam Trap Replacement Assessment.

Savings per Steam Trap Orifice Size[1208]		1/8	3/16	1/4	5/16
S_a	(lbs/hr)	3.84	8.64	15.35	23.99
ΔTherms	(Therms/trap/yr)	14.23	32.02	56.92	88.94

Process Heating and Low, Medium and High-Pressure Systems (>5 psig) Savings Estimates

Use the following equation, for all other steam systems and applications

$$S_a = 24.24 \times P_1 \times D^2 \times A \times FF$$

Where:

24.24 = Constant, $lbm/(hr \times psia \times in^2)$

P_1 = Average steam trap inlet pressure $(absolute, psia)$. If not available, use defaults provided in table below (note that default are provided in psig, not psia; to calculate the default psia add atmospheric pressure, 14.696, to the assumed gauge pressure, psig) Defaults are provided in table below if custom calculation is not performed. Multifamily Space Heating LPS and High Pressure systems over 300 psig require custom calculations.

Steam System	Climate Zone (if applicable)	Average Steam Trap Inlet Pressure (psig) [1210]	Diameter of Orifice (in)	Adjustment Factor	Flow Factor	Sa[1209] (lbs/trap/hr)	ΔTherm
Space Heating Applications							
Commercial LPS Space Heating (including Multifamily)	Rockford	11.2[1211]	0.21	50%	100%	13.8	108
	Chicago						101
	Springfield						86
	Belleville						63
	Marion						64
Process Heating Applications							
Commercial Dry Cleaners		82.8	0.125	50%	100%	18.5	86
Industrial/Process Low Pressure: psig < 15		11.2[1212]	0.2100[19]	50%	100%	13.8	121
Medium Pressure: 15 ≤ psig < 30		16	0.1875	50%	50%	6.5	57

[1208] Default values are directly calculated using the equations above.
[1209] Default values are directly calculated using the equations above.
[1210] Medium and high-pressure steam trap inlet pressure based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours. Dry cleaning steam trap inlet pressure based on C5 Steam Traps – Nicor FINAL 10.27.11.
[1211] Results from Armstrong International research through the steam trap management platform SAGE. The research population data included Commercial Heating LPS as well as Industrial or Process Low Pressure, < 15 psi applications. The search of the database yields 120,853 steam traps meeting these parameters: Average orifice size 0.21" and average pressure 11.2 psi.
[1212] Ibid.

Steam System	Climate Zone (if applicable)	Average Steam Trap Inlet Pressure (psig) [1210]	Diameter of Orifice (in)	Adjustment Factor	Flow Factor	Sa[1209] (lbs/trap/hr)	ΔTherm
Medium Pressure: 30 ≤ psig < 75		47	0.25	50%	50%	23.4	209
High Pressure: 75 ≤ psig < 125		101	0.25	50%	50%	43.8	395
High Pressure: 125 ≤ psig < 175		146	0.25	50%	50%	60.9	551
High Pressure: 175 ≤ psig < 250		202	0.25	50%	50%	82.1	745
High Pressure: 250 ≤ psig < 300		263	0.25	50%	50%	105.2	954

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

The hourly water volume saved per each repaired or replaced leaking trap is calculated by dividing the "Steam Loss per Leaking Trap (lbm/hr/trap)" by the density of water saved, 8.33 lbm/gal, that replaces the lost steam. The steam loss is provided in the table for parameter S_a, the "Steam loss per leaking trap" in the Fossil Fuel savings section above. Annual water savings are calculated using Hours and $P_{malfunctioning}$, the annual percentage of malfunctioning traps, as defined above.

Water savings only apply to situations where condensate is lost from the steam system. If a condensate recovery system is in place, assume zero water savings or provide a custom calculation based on site-specific operation.

The annual water savings for a replaced or repaired trap is given by:

$$\Delta Water = GAL \times Hours \times N \times P_{malfunctioning} \times F_o$$

Where:

GAL = average actual water volume saved per leaking trap, as listed in the following table and based on steam system type.

Other variables as defined above

Steam System	S_a	GAL (gal/hr/trap)
Commercial Dry Cleaners	18.5	2.22
Commercial LPS Space Heating (Including Multifamily)	13.8	0.83
Industrial/Process Low Pressure: psig < 15	13.8	1.66
Medium Pressure: 15 ≤ psig < 30	6.5	0.79
Medium Pressure: 30 ≤ psig < 75	23.4	2.81
High Pressure: 75 ≤ psig < 125	43.8	5.26
High Pressure: 125 ≤ psig < 175	60.9	7.31
High Pressure: 175 ≤ psig < 250	82.1	9.85
High Pressure: 250 ≤ psig < 300	105.2	12.63
High Pressure: 300 ≤ psig	Calculated	Calculated Steam Loss / 8.33

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-STMS-V3-260101

REVIEW DEADLINE: 1/1/2028

4.4.59 Ductless Heat Pumps - Removed in v.13

Measure now combined with 4.4.9 Air and Water Source Heat Pump System (Centrally Ducted and Ductless)

4.4.60 Variable Refrigerant Flow HVAC System

DESCRIPTION

This measure applies to the installation of air source Variable Refrigerant Flow (VRF) HVAC systems. VRF systems are heat pumps that have one outdoor condensing unit with refrigerant piped to multiple indoor evaporator units to deliver cooling and/or heating to individual interior zones as needed. This measure could apply to replacing an existing unit at the end of its useful life or the installation of a new unit in a new or existing building.

This measure was developed to be applicable to the following program times: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to both retrofit and new construction installations of VRF systems. Savings are based in the inherent efficiency of VRF systems as compared to traditional HVAC systems. VRF systems should meet or exceed ASHRAE 90.1 minimum efficiency requirements for air source VRF systems.

DEFINITION OF BASELINE EQUIPMENT

Time of Sale / New Construction

Non-fuel switch measures:

To calculate savings with an electric baseline, the baseline equipment is assumed to be a ducted split-system heat pump for non-residential buildings 25,000 square feet or fewer and is 3 floors or fewer. For non-residential buildings over 25,000 square feet or 4 floors or higher, the baseline equipment is assumed to be a standard-efficiency air cooled heat pump roof top unit (RTU) system. For residential buildings types which utilize individual in-unit HVAC systems, such as multifamily, lodging, dormitories, etc., the baseline equipment is assumed to be a residential style standard-efficiency packaged terminal heat pump split system.

Fuel switch measures:

To calculate savings with a gas or fuel heating baseline, the baseline equipment is assumed to be single zone furnace and air-conditioning units for non-residential buildings 25,000 square feet or fewer and is 3 floors or fewer. For non-residential buildings over 25,000 square feet or taller than 3 floors, the baseline equipment is assumed to be a packaged variable-air-volume (VAV) system with DX cooling and hot water reheat. For residential buildings types which utilize individual in-unit HVAC systems, such as multifamily, lodging, dormitories, etc., the baseline equipment is assumed to be a packaged terminal air conditioner (PTAC) with hot-water radiator heating. If the residential building is 4 stories or more, the baseline system will be a water source heat pump (WSHP) system with a boiler and cooling tower.

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the IECC code in effect on the date of the building permit. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

Standard efficiency implies equipment that complies with Code energy efficiency requirements (IECC or Code of Federal Regulations, whichever is higher) in effect on the date of equipment purchase (if date unknown, assume current Code minimum). The rating conditions for the baseline and efficient equipment efficiencies must be equivalent

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. If evaluation determines the applicable version of code, given location and timing, isn't an appropriate baseline due to supply constraints, low compliance, or other issues, the previous iteration of code may be used through 2023.

IECC 2021 leverages new DOE testing methods and associated metrics. The following conversion factors are recommended for use if the efficient equipment is not rated under the new testing procedure but the stipulated baseline is:[1213]

SEER2 = X * SEER

EER2 = X * EER

HSPF2 = X * HSPF

Where:

X	SEER2	EER2	HSPF2
Ducted	0.95	0.95	0.85
Ductless	1.00	1.00	0.90
Packaged	0.95	0.95	0.84

Baseline selection:

The following table can be used to determine the appropriate baseline HVAC system type.

	Non-Fuel Switch	Fuel Switch
Multifamily or Lodging, 3 floors or fewer	Packaged Terminal Heat Pump	PTAC w/ Hot Water Radiator
Multifamily or Lodging, 4 floors or more	Packaged Terminal Heat Pump	Water Source Heat Pump with Cooling Tower and Natural Gas Boiler
Non-residential <25,000 SF and 3 floors or fewer	Ducted-Split System Heat Pump	Packaged Single Zone (Furnace) + Air Conditioner
Non-Residential >25,000 SF OR more than 3 floors	Heat Pump RTU	Packaged VAV RTU with Hot Water Reheat

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for VRF is 16 years[1214].

DEEMED MEASURE COST

Time of Sale: For analysis, the incremental capital costs are summarized in the following table. Site specific cost data should be used where available.

Baseline System	Incremental Cost ($/ton) [1215]
Packaged Terminal Heat Pump	$610
Ducted Split System Heat Pump	$860

[1213] Consortium for Energy Efficiency (CEE), Testing, Testing, M1, 2, 3, Transitioning to New Federal Minimum Standards, CEE Summer Program Meeting, August, 2022.

[1214] Consistent with Residential air source heat pump measure and based on a 2016 DOE Rulemaking Technical Support document, as recommended in Guidehouse 'ComEd Effective Useful Life Research Report', May 2018.

[1215] Estimated measure incremental costs for PTHP, HP RTU and PTAC based other incremental costs and differences in installed cost from U.S. Energy Information Administration (EIA), Updated Buildings Sector Appliance and Equipment Costs and Efficiencies: https://www.eia.gov/analysis/studies/buildings/equipcosts/pdf/full.pdf. For Ducted Split HP, Packaged Single Zone Furnace + AC and Packaged VAV RTU is based on Mid-Atlantic Technical Reference Manual version 9, Variable Refrigerant Flow (VRF) Heat Pump Systems measure. Published October, 2019. Water-source HP systems estimated from data collected from manufacturers. Water-source heat pump systems were not very different compared to VRF systems.

Baseline System	Incremental Cost ($/ton) [1215]
Heat Pump RTU	$130
PTAC w/ Hot Water Radiator	$160
Water Source Heat Pump	$0
Packaged Single Zone (Furnace) + Air Conditioner	$835
Packaged VAV RTU with Hot Water Reheat	$540

LOADSHAPE

Loadshape C05 – Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits. The second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)
= 91.3%[1216]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)
= 47.8%[1217]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Savings are calculated as a sum of system switching savings and efficiency savings, analogous to the following equation:

$$\text{Annual Savings} = [System\ Switch\ Savings] + [Savings\ from\ improved\ VRF\ efficiency]$$

For fuel-switching calculations, the above equation is used for calculating the cooling savings, while the heating savings are calculated by as the following:

$$\text{Annual Savings} = [Gas\ Heat\ Replaced\ x\ System\ Switch\ Adjustment\ Factor] + [Fan\ Savings] - [Heat\ Pump\ heat\ consumed\ x\ System\ Switch\ Adjustment\ Factor] + [Heat\ Pump\ Cooling * System\ Switch\ Savings + Heat\ Pump\ Cooling\ Savings\ from\ improved\ VRF\ efficiency]$$

The system switching savings are calculated by multiplying the cooling or heating load (EFLH times heat or cool capacity) and multiplying it by system heating ($Heat_{adj}$) and cooling ($Cool_{adj}$) factors. These adjustment factors were calculated with energy model data of different building types. The VRF performance curves were calibrated based on independent field monitored data.

- The difference in building code baseline efficiency between VRF and the baseline system.

[1216] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1217] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

- The improved part load performance of the VRF inverter driven compressor compared to single-stage or two-stage compressors.
- Heat recovery mode savings from the VRF units.
- Decrease in energy from cooling towers (WSHP baseline) and water pumps (baseline systems with hot water and WSHP).
- WSHP electric heating and boiler fuel consumption (WSHP baseline).
- Differences in treating ventilation between mixed recirculating systems and VRF systems with dedicated outdoor air systems (Heat Pump RTU and VAV baseline systems only).

Savings from improved VRF efficiency is similar to other efficiency savings from other TRM measures, where savings are calculated as the load multiplied by the change in efficiency.

Non-fuel switch measures:

For units with cooling capacities less than 65 kBtu/hr:

ΔkWh = $Annual\ kWh\ Savings_{cool} + Annual\ kWh\ Savings_{heat} + FanSavings$

Annual kWh Savings$_{cool}$ = $[System\ Switch\ Savings] + [Savings\ from\ improved\ VRF\ efficiency]$

= $(Cool_{adj} * Capacity_{cool} * EFLH_{cool}/3{,}412) + (Capacity_{cool} * EFLH_{cool} * (1/SEER2base - 1/SEER2ee))/1000$

Annual kWh Savings$_{heat}$ = $[System\ Switch\ Savings] + [Savings\ from\ improved\ VRF\ efficiency]$

FanSavings = $(Heat_{adj} * HeatLoad/3{,}412) + (HeatLoad * (1/HSPF2base - 1/HSPF2ee))/1000$

= $(Flag * HeatLoad * 1/AFUE_{base} * F_e)$ / 3,412

For units with cooling capacities equal to or greater than 65 kBtu/hr:

ΔkWh = $Annual\ kWh\ Savings_{cool} + Annual\ kWh\ Savings_{heat} + FanSavings$

Annual kWh Savings$_{cool}$ = $[System\ Switch\ Savings] + [Savings\ from\ improved\ VRF\ efficiency]$

= $(Cool_{adj} * Capacity_{cool} * EFLH_{cool}/3{,}412) + (Capacity_{cool} * EFLH_{cool} * (1/IEERbase - 1/IEERee))/1000$

Annual kWh Savings$_{heat}$ = $[System\ Switch\ Savings] + [Savings\ from\ improved\ VRF\ efficiency]$

FanSavings = $(Heat_{adj} * HeatLoad)/3{,}412 + (HeatLoad * (1/COPbase - 1/COPee))$ /3,412

= $(Flag * HeatLoad * 1/AFUE_{base} * F_e)$ / 3,412

Fuel switch measures:

Fuel switch measures must produce positive total lifecycle site energy savings in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

SiteEnergySavings (MMBTU) = $GasHeatReplaced + FanSavings - HPSiteHeatConsumed + HPSiteCoolingImpact$

GasHeatReplaced (MMBTU) = $(GasHeat_{adj} * HeatLoad * 1/AFUE_{base})$ / 1,000,000

FanSavings (MMBTU) = $(Flag * HeatLoad * 1/AFUE_{base} * Fe)$ / 1,000,000

For units with cooling capacities less than 65 kBtu/hr:

HPSiteHeatConsumed (MMBTU) = $(Heat_{adj} * HeatLoad * (1/HSPFee)) * 3{,}412$ / 1,000 / 1,000,000

HPSiteCoolingImpact (MMBTU) =$[System\ Switch\ Savings] +$
$[Savings\ from\ improved\ VRF\ efficiency]$

= $((Cool_{adj} * Capacity_{cool} * EFLHcool)$ / 1,000,000) + $((EFLHcool * Capacity_{cool} * (1/SEER2base - 1/SEER2ee)) * 3{,}412$ / 1,000 / 1,000,000)

For units with cooling capacities greater than 65 kBtu/hr:

HPSiteHeatConsumed (MMBTU) = $(Heat_{adj} * HeatLoad * (1/COPee))$ / 1,000,000

HPSiteCoolingImpact (MMBTU) =$[System\ Switch\ Savings] +$
$[Savings\ from\ improved\ VRF\ efficiency]$

= $((Cool_{adj} * Capacity_{cool} * EFLHcool)$ / 1,000,000) + $((EFLHcool * Capacity_{cool} * (1/IEER_base - 1/IEER_ee)) * 3{,}412$ /1,000 / 1,000,000)

Savings are adjusted by heating ($Heat_{adj}$) and cooling ($Cool_{adj}$) factors presented in the following table. These values bring the expected savings in line with energy model estimated savings.

Baseline System	$GasHeat_{adj}$	$Cool_{adj}$	$Heat_{adj}$
Packaged Terminal Heat Pump	N/A	0.1	0.0
Ducted Split System Heat Pump	N/A	0.0	0.0
Heat Pump RTU	N/A	-0.2	0.5
PTAC w/ Hot Water Radiator	0.7	0.0	1.3
Water Source Heat Pump	0.4	0.1	0.5
Packaged Single Zone (Furnace) + Air Conditioner	1.4	0	1.6
Packaged VAV RTU with Hot Water Reheat	0.9	-0.2	1.8

If SiteEnergySavings calculated above is positive, the measure is eligible. The appropriate savings claim is dependent on which utilities are supporting the measure as provided in a table below:

Measure supported by:	Electric Utility claims (kWh):	Gas Utility claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note: utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Where:

$Cool_{adj}$ = This cooling adjustment factor is derived from energy modeling results to calibrate TRM calculation savings to energy modeling savings estimates.[1218] Adjustment factor values are presented in a table above.

$Heat_{adj}$ = This heating adjustment factor is derived from energy modeling results to calibrate TRM calculation savings to energy modeling savings estimates.[1219] Adjustment factor values are presented in a table above.

$GasHeat_{adj}$ = This gas heating adjustment factor is derived from energy modeling results to calibrate TRM calculation savings to energy modeling savings estimates.[1220] Adjustment factor values are presented in a table above.

$Capacity_{cool}$ = input capacity of the cooling equipment in Btu per hour (1 ton of cooling capacity equals 12,000 Btu/hr).

= Actual installed

SEER2base =Seasonal Energy Efficiency Ratio of the baseline equipment

= SEER from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).

SEER2ee = Seasonal Energy Efficiency Ratio of the energy efficient equipment.
= Actual installed

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

HSPF2base = Heating Seasonal Performance Factor of the baseline equipment

= HSPF from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).

HSPF2ee = Heating Seasonal Performance Factor of the energy efficient equipment.
= Actual installed. If rating is COP, HSPF = COP * 3.413

IEERbase = Integrated Energy Efficiency Ratio of the baseline equipment

= IEER from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).

IEERee = Integrated Energy Efficiency Ratio of the energy efficient equipment.

= Actual installed

HeatLoad = Calculated heat load for the building

= $EFLH_{heat}$ * $Capacity_{heat}$

Where:

$EFLH_{heat}$ = heating mode equivalent full load hours in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

[1218] Based on Variable Refrigerant Flow Study. See 'Variable Refrigerant Flow Study 2023'.
[1219] Based on Variable Refrigerant Flow Study. See 'Variable Refrigerant Flow Study 2023'.
[1220] Based on Variable Refrigerant Flow Study. See 'Variable Refrigerant Flow Study 2023'.

$Capacity_{heat}$ = Actual installed input capacity of the heat pump equipment in Btu per hour.

3412 = Btu per kWh.

COPbase = coefficient of performance of the baseline equipment

= COP from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code).

If rating is HSPF, COP = HSPF / 3.413

COPee = coefficient of performance of the energy efficient equipment.

= Actual installed. If rating is HSPF, COP = HSPF / 3.413

AFUEbase = Baseline Annual Fuel Utilization Efficiency Rating. Use appropriate code level efficiency.

Flag = 1 if system replaced is an RTU or ducted system with furnace fan, 0 if not.

F_e = Fan energy consumption as a percentage of annual fuel consumption

= 7.7% for RTU replacement, 3% for multifamily (residential style) furnace replacement[1221]

%IncentiveElectric = % of total incentive paid by electric utility

= Actual

%IncentiveGas = % of total incentive paid by gas utility

= Actual

[1221] Fe is estimated using TRM models for the three building types: low-rise office, sit-down restaurant and retail-strip mall. 7.7% represents the average Fe of the three building types. See "Fan Energy Factory Example Calculation 2021-06-23.xlsx" for reference. Mutlifamily is 3%, lower than commercial, due to typically lower fan static pressure in residential style applications.

Equipment Type	Size Category	Heating Section Type	Subcategory or Rating Condition	Minimum *Efficiency*	Test Procedure
VRF air cooled (cooling mode)	<65,000 Btu/h	All	*VRF* multisplit *system*	13.0 *SEER*	AHRI 1230
	≥65,000 Btu/h and <135,000 Btu/h	*Electric resistance* (or none)		11.0 *EER* 12.9 *IEER*14.6 *IEER*	
			VRF multisplit *system* with heat recovery	10.8 *EER* 12.7 *IEER* 14.4 *IEER*	
	≥135,000 Btu/h and <240,000 Btu/h		*VRF* multisplit *system*	10.6 *EER* 12.3 *IEER* 13.9 *IEER*	
			VRF multisplit *system* with heat recovery	10.4 *EER* 12.1 *IEER* 13.7 *IEER*	
	≥240,000 Btu/h		*VRF* multisplit *system*	9.5 *EER* 11.0 *IEER* 12.7 *IEER*	
			VRF multisplit *system* with heat recovery	9.3 *EER* 10.8 *IEER* 12.5 *IEER*	
VRF air cooled (heating mode)	<65,000 Btu/h (cooling capacity)		*VRF* multisplit *system*	7.7 *HSPF*	AHRI 1230
	≥65,000 Btu/h and <135,000 Btu/h (cooling capacity)		*VRF* multisplit *system* 47°F db/43°F wb *outdoor air*	3.3 COP_H	
			17°F db/15°F wb *outdoor air*	2.25 COP_H	
	≥135,000 Btu/h (cooling capacity)		*VRF* multisplit *system* 47°F db/43°F wb *outdoor air*	3.2 COP_H	
			17°F db/15°F wb *outdoor air*	2.05 COP_H	

Non Fuel Switch example, a heat recovery VRF system with 8 ton cooling capacity and 96 kbtu heating capacity, an efficient IEER of 18.5 and COP of 3.75, at a new construction low-rise office in Chicago in 2024 saves:

ΔkWh = $Annual\ kWh\ Savings_{cool} + Annual\ kWh\ Savings_{heat} + FanSavings$

Annual kWh Savingscool = $(Cooladj * Capacitycool * EFLHcool / 3412) + (Capacitycool * EFLHcool * (1/IEERbase - 1/IEERee))/1000$

Annual kWh Savingsheat = $(Heatadj * Heat\ Load / 3412) + (HeatLoad * (1/COPbase - 1/(COPee))/3412$

FanSavings = $(Flag * HeatLoad * 1/AFUEbase * Fe) / 3412$

ΔkWh = $(0.0 * 96000 * 989/3{,}412) + (96000 * 989 * (1/14.4 - 1/18.5)/1000 + (0.0 * 916 * 60000/3412) + (916 * 60000 * (1/3.3 - 1/3.75) / 3412) + (1 * 916 * 60000 * 1/0.8 * 0.077) / 3412$

ΔkWh = $3597\ kWh$

Fuel Switch example, a heat recovery VRF system with 8-ton cooling capacity and 96 kbtu heating capacity, an efficient EER of 12.5 and COP of 3.75, at a new construction low-rise office in Chicago, assuming a packaged single zone (furnace) and air conditioner baseline. Assuming 50%-50% Incentive agreement is used for joint programs, savings:

SiteEnergySavings (MMBTUs) = $GasHeatReplaced + FanSavings - HPSiteHeatConsumed + HPSiteCoolingImpact$

GasHeatReplaced = $(GasHeat_{adj} * HeatLoad * 1/AFUE_{base})$ / 1,000,000

= $1.4 * (96000 * 916 * 1/0.8)$ / 1000000

= 153.9 $MMBtu$

FanSavings = $(Flag * HeatLoad * 1/AFUE_{base} * F_e)$ / 1,000,000

= $(1 * 96000 * 916 * 1/0.8 * 0.030)$ / 1000000

= 3.30 $MMBtu$

For units with cooling capacities greater than 65 kBtu/hr:

HPSiteHeatConsumed = $(Heat_{adj} * HeatLoad * (1/COPee))$ / 1,000,000

= $(1.6 * 96000 * 916 * (1/3.75))$ / 1,000,000

= 37.9 $MMBtu$

HPSiteCoolingImpact = $(Cool_{adj} * Capacity_{cool} * EFLH_{cool}$ / 1,000,000) $* (FLHcool * Capacity_{cool} * (1/IEERbase - 1/IEERee)) * 3{,}412$ / 1,000 / 1,000,000

= $((0.0 * 989 * 96000)/1{,}000{,}000) + (989 * 96000 * (1/14.4 - 1/18.5)) * 3{,}412$ / 1,000 / 1,000,000

= 5.0 $MMBtu$

SiteEnergySavings (MMBTUs) = $153.9 + 3.30 - 37.9 + 5.0 = 124.3$ [$Measure\ is\ eligible$]

Savings would be claimed as follows, assuming a 50%-50% incentive agreement:

Measure supported by:	Electric Utility claims (kWh):	Gas Utility claims (therms):
Electric utility only	124.3 * 1,000,000/3,412 = 36,430 kWh	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	0.5 * 124.3 * 1,000,000/3,412 = 18,215 kWh	0.5 * 124.3 * 10 = 622therms
Gas utility only	N/A	143.3 * 10 = 1,243 therms

SUMMER COINCIDENT PEAK DEMAND SAVINGS

For units with cooling capacities less than 65 kBtu/hr:

$$\Delta kW = \left(\frac{Capacity_{cool}}{1{,}000} * \left(\frac{1}{EER2base} - \frac{1}{EER2ee}\right)\right) * CF$$

For units with cooling capacities greater than 65 kBtu/hr:

$$\Delta kW = \left(\frac{Capacity_{cool}}{1{,}000} * \left(\frac{1}{EERbase} - \frac{1}{EERee}\right)\right) * CF$$

Where:

EERbase = Energy Efficiency Ratio of the baseline equipment

= EER from tables below, based on the applicable Code on the date of equipment purchase (if unknown assume current Code). For air-cooled units < 65 kBtu/hr, assume the following conversion from SEER to EER for calculation of peak savings[1222]:

EER = (-0.02 * $SEER_2$) + (1.12 * SEER)

EERee = Energy Efficiency Ratio of the energy efficient equipment. For air-cooled units < 65 kBtu/hr, if the actual EERee is unknown, assume the conversion from SEER to EER as provided above.

= Actual installed

CF value is chosen between:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%

For example, a heat recovery VRF system with 8-ton cooling capacity and 96 kbtu heating capacity, an efficient EER of 12.5, saves:

ΔkW = (96,000/1,000 * (1/10.8 – 1/12.5)) *0.913

= 1.1 kW

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from gas to electric.

[1222] Based on Wassmer, M. (2003). A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations. Masters Thesis, University of Colorado at Boulder. Note this is appropriate for single speed units only.

For the purposes of forecasting load reductions due to fuel switch ASHP projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, should therefore reflect the decrease in one fuel and increase in another, as opposed to the single savings value calculated in the "Electric and Fossil Fuel Energy Savings" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = $[Heating\ Consumption\ Replaced]$
= $[GasHeat_{Adj} * HeatLoad * 1/AFUE_{base}) / 100{,}000]$

ΔkWh = $[FurnaceFanSavings] - [HP\ heating\ consumption] + [Cooling\ savings]$

For units with cooling capacities less than 65 kBtu/hr:

ΔkWh = $[FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_e * 0.000293] - [Heat_{Adj} * HeatLoad/3412 * (1/(COP_{ee}))/1000] + [Cool_{adj} * (Capaciy_{cool} * EFLH_{cool} * (1/EER2base - 1/EER2_ee))/1000]$

For units with cooling capacities greater than 65 kBtu/hr:

ΔkWh = $[FurnaceFlag * HeatLoad * 1/AFUE_{base} * F_e * 0.000293] - [Heat_{adj} * HeatLoad/3412 * (1/COP_{ee})]$
$+ [Cool_{adj} * (Capacity_{cool} * EFLH_{cool} * (1/IEERbase - 1/IEER_ee))/1000]$

MEASURE CODE: CI-HVC-VFFY-V7-270101

REVIEW DEADLINE: 1/1/2030

4.4.61 Chiller Condenser Water Temperature Reset

DESCRIPTION

Condenser water temperature reset – reset the constant condensing loop supply temperature from constant 80°F to a dynamic range of 70°F to 80°F based on the outdoor-air wet-bulb temperature (WBT). When the outdoor-air wet-bulb temperature is below 60°F, reset the condensing loop set point to 70°F. When the outdoor-air wet-bulb temperature is above 70°F, reset to 80°F; when the outdoor-air wet-bulb temperature is in between, reset the condensing supply temperature to 10°F higher than the outdoor-air wet-bulb temperature. The chiller COP (coefficient of performance) increases after the measure is applied. However, the condenser loop balances out the energy saving because the cooling tower fan works harder and longer to cool condensing water to a lower temperature. The resulting savings (primarily cooling) from this measure are roughly proportional to the amount of part-load cooling that is required in the baseline and range between 0.1% and 1.3%.

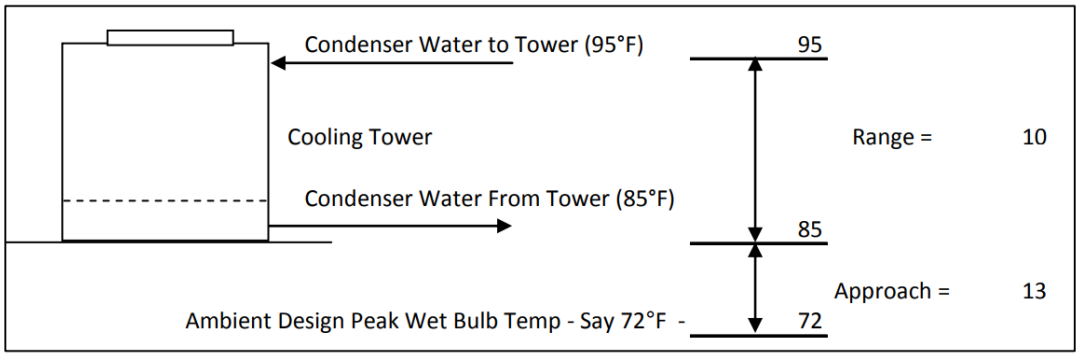

DEFINITION OF EFFICIENT EQUIPMENT

This measure is applicable when the condenser water temperature (CWT) setpoint is either not resetting properly, or a reset strategy is not implemented. The minimum setpoint is set to 70°F.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is fixed condenser water temperature of 85°F. Only applicable to water-cooled chillers.

Baseline Data Collection:

- Trend Current outdoor air dry bulb and wet bulb temperatures
- Trend Current entering condenser water supply temperature
- Trend Current leaving chilled water temperature

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected lifetime of the measure is 10 years[1223]

DEEMED MEASURE COST

Use actual chiller manufacturer provided cost.

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

[1223] 2008 Database for Energy-Efficiency Resources (DEER), Version 2008.2.05, "Effective/Remaining Useful Life Values", California Public Utilities Commission, December 16, 2008

= 91.3%[1224]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1225]

Algorithm

CALCULATION OF ENERGY SAVINGS

Efficient Data Collection:

1 Trend outdoor air dry bulb and wet bulb temperatures
2 Trend entering condenser water supply temperature
3 Trend leaving chilled water temperature
4 Trend energy usage (kWh)
5 Model weather bin data
6 Trend condenser water supply temperature and temperature setpoint, and whatever parameter the reset is based on (e.g., outside air dry bulb and wet bulb temperatures).
7 Perform functional testing if independent variables at the time of trending do not cover the range covered by the reset.

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = TONS * ((IPLVbase) - (CPLVee)) * EFLH$$

Where:

TONS = Chiller nominal cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)

= Actual installed

$IPLV_{base}$ = Efficiency of baseline equipment expressed as Integrated Part Load Value (kW/ton). Chiller units are dependent on chiller type. See Chiller Units, Conversion Values and Baseline Efficiency Values by Chiller Type and Capacity in the 4.4.6 Electric Chiller measure Reference Tables section.

$CPLV_{ee}$ = Calculated Part Load Value based on trend data post measure install (kW/ton)

= Actual installed

EFLH = Equivalent Full Load Hours for cooling in Existing Buildings or New Construction are provided in section 4.4 HVAC End Use.

[1224] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1225] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kWSSP = TONS * ((PEbase) - (PEee)) * CFSSP$$

$$\Delta kWPJM = TONS * ((PEbase) - (PEee)) * CFPJM$$

Where:

PE_{base} = Peak efficiency of baseline equipment expressed as Full Load (kW/ton)

PE_{ee} = Peak efficiency of high efficiency equipment expressed as Full Load (kW/ton)

= Actual installed

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

There are no expected O&M costs or savings associated with this measure.

MEASURE CODE: CI-HVC-CWTR-V1-230101

REVIEW DEADLINE: 1/1/2028

4.4.62 Cooling Tower Water Side Economizer

DESCRIPTION

A waterside economizer works by running the cooling tower loop in the winter and parts of the shoulder seasons as a source of cooling and transferring cooling energy to the building (secondary) cooling loop. This requires a dedicated plate-and-frame heat exchanger that is used only during waterside economizer operations, during which time the chillers are locked out.

A waterside economizer may contribute to reduced energy use in the following ways:

- Reducing the mechanical cooling load on chillers by pre-cooling return water
- Reducing energy use of the plant by allowing chillers to turn off at times of free cooling

Energy consumption (kWh) may decrease with the use of a waterside economizer because the leaving chilled water temperature can be reduced based on the wet bulb temperature. With this control strategy, the effect will be a reduction in motor speed (rpms) of the compressor as well as the pre-cooling of the chilled water return through the waterside economizer. Water side economizers must be sized to provide 100% of the cooling demand at 50 degrees (F) dry-bulb and 45 degrees (F) wet-bulb and below.[1226]

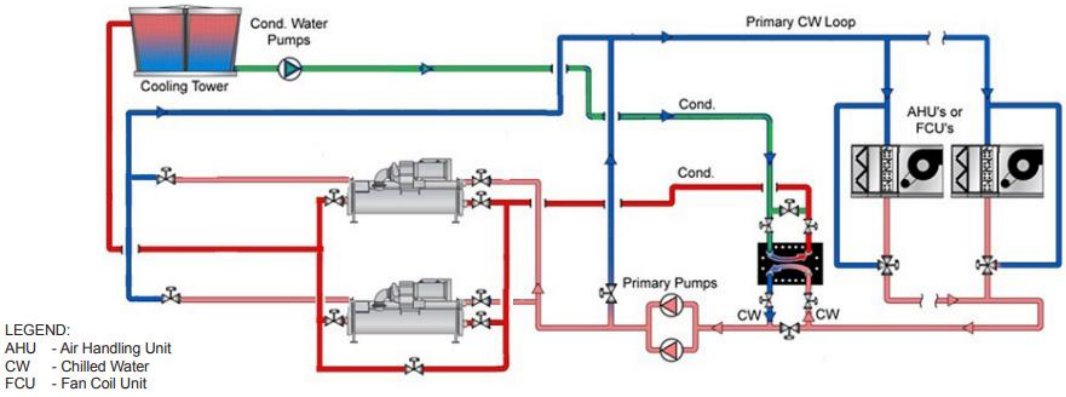

DEFINITION OF EFFICIENT EQUIPMENT

Installation of integrated waterside economizer heat exchanger to existing chilled-water system with cooling tower. Heat exchanger approach may range from 1° to 6°. Weather data is used to identify the annual hours in which outdoor air conditions are sufficient to provide water at a desirable temperature. Typically, demand savings may not be present with this measure because the process systems require water temperatures around 55-65°F and a cooling tower cannot meet these temperatures during the peak period.

DEFINITION OF BASELINE EQUIPMENT

No waterside heat exchanger installed or functional.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected lifetime of the measure is 10 years[1227]

DEEMED MEASURE COST

Use actual chiller manufacturer provided cost.

[1226] ASHRAE 2010 6.5.1.2.1 Design Capacity. Water economizer systems shall be capable of cooling supply air by indirect evaporation and providing up to 100% of the expected system cooling load at outdoor air temperatures of 50° F dry bulb/45° F wet bulb and below.

[1227] (2008 Database for Energy-Efficiency Resources (DEER), Version 2008.2.05, "Effective/Remaining Useful Life Values", California Public Utilities Commission, December 16, 2008)

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1228]

CFPJM = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1229]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (TONS * LF_{winter}) * IPLV_{base} * (Hr)_{Free}$$

Where:

TONS = chiller nominal cooling capacity in tons (note: 1 ton = 12,000 Btu/hr)

= Actual installed

LF_{winter} = Average winter cooling load, expressed as percentage of peak system capacity (tons)

= If unknown, assume 25%[1230]

$IPLV_{base}$ = efficiency of baseline equipment expressed as Integrated Part Load Value (kW/ton). Chiller units are dependent on chiller type. See Chiller Units, Conversion Values and Baseline Efficiency Values by Chiller Type and Capacity in the Reference Tables section.

= Actual installed

$(Hr)_{Free}$ = Annual hours in which outdoor air conditions are sufficient to provide condenser water at a desirable temperature that the chiller does not need to operate.

= If unknown, use default values from table below:[1231]

Climate Zone	Hours
Zone 1 (Rockford)	4334
Zone 2 (Chicago)	4253
Zone3 (Springfield)	3760
Zone 4 (Belleville)	3536
Zone 5 (Marion)	3432

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

[1228] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1229] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1230] Waterside Economizers: Tower Side Temperatures (online), Norm Hall, June 2023

[1231] NCEI NCDC 15 year climate normals (2006 – 2020) total hours per year less than 50° F

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

There are no expected O&M costs or savings associated with this measure.

MEASURE CODE: CI-HVC-CTWE-V03-260101

REVIEW DEADLINE: 1/1/2030

4.4.63 Boiler Blowdown Heat Recovery

DESCRIPTION

This measure is for a non-residential steam boiler serving process load or space heating. The measure applies to steam natural gas fired boilers where the continuous blowdown exceeds 5% of the steam rate[1232]. Blowdown heat recovery systems should also be considered when about 500lbs/hr of steam is blown down and for continuous blowdown systems of at least 1 gpm[1233]. All steam boilers must blow down to reduce the amount of dissolved solids in the boiler water. However, along with the solids, boiler chemicals and thermal energy is lost. Although blowdown heat recovery systems cannot recover the chemicals, they do recover up to 90% of the heat energy that would otherwise be lost down the drain[1234]. Blowdown waste heat can be recovered with a heat exchanger, a flash tank, or a flash tank in a combination with a heat exchanger. The recovered heat is used to pre-heat boiler make-up water before it enters the deaerator, and for low pressure steam to heat water inside the deaerator, which improves overall boiler efficiency. Heat can be recovered from boiler blowdown by using a heat exchanger to preheat boiler makeup water. Additionally, changing from manual blowdown control to automatic control can reduce a boiler's energy use by 2 – 5 percent and reduce blowdown water losses by up to 20 percent.[1235]

The measure is applicable to commercial applications, commercial HVAC including multifamily buildings, low pressure applications, medium pressure industrial applications and high pressure applications. It was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as a functional steam boiler with a blowdown heat recovery system that increases the heat recovery and boiler efficiencies in comparison to the baseline case. New systems are not eligible for this measure.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an existing steam boiler system with a deaerator where no blowdown heat is recovered

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years; capped at the measure life of a steam boiler.[1236]

DEEMED MEASURE COST

If known, the actual material and labor cost of installation should be used. If unknown, the cost of this measure is estimated to be $1.4/kBtu/hr[1237] per boiler. This cost includes material and labor for installing boiler blowndown heat recovery systems (i.e - storage tanks, pipes and pumps).

[1232] "Boiler Blowdown – Fact Sheet" N.C Division of Pollution Prevention and Environmental Assistance, August 2004. https://p2infohouse.org/ref/34/33027.pdf,

[1232] "ASHRAE: HVAC Service Life Database" ASHRAE, last modified May 12, 2023,

[1233] "Blowdown Heat Recovery" Clean Boiler, 2005 http://cleanboiler.org/learn-about/boiler-efficiency-improvement/efficiency-index/index-boiler-operations/blowdown-heat recovery/#:~:text=A%20blowdown%20heat%20recovery%20system%20should%20be%20considered,Continuous%20blowdown%20systems%20of%20at%20least%201%20gpm

[1234] "Recover Heat from Boiler Blowdown" Department of Energy, January 2012. https://www.energy.gov/sites/prod/files/2014/05/f16/steam10_boiler_blowdown.pdf

[1235] "Boiler Blowdown – Fact Sheet" N.C Division of Pollution Prevention and Environmental Assistance, last modified August 2004. https://p2infohouse.org/ref/34/33027.pdf,

[1236] "ASHRAE: HVAC Service Life Database" ASHRAE, last modified May 12, 2023, http://weblegacy.ashrae.org/publicdatabase/service_life.asp

[1237] Results from Blowdown Heat Recovery efficiency improvement research through the C&I and Public Sector Custom Rebate Program, and Small Business Program. The evaluation included project and population data from years 2018 – 2023.

LOADSHAPE

N/A

COINCIDENCE FACTOR

For process boiler systems, the summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

N/A for space heating boiler systems.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Natural gas savings are calculated by estimating the amount of blowdown net heat flow. Savings are calculated from the enthalpy difference between the make-up water and the blowndown temperature.

$$\Delta\text{Therms} = \frac{\text{BFR} \times (\text{H}_\text{B} - \text{H}_\text{w})}{\text{n}_\text{boiler} \times 100{,}000} \times \text{SF}$$

Where:

BFR = Boiler Blowdown flow rate in lb/year. The calculated blowndown flow rate is in turn used to calculate natural gas savings. Boiler heat recovery systems vary widely between manufacturers and facilities.

$$\text{BFR} = \text{Annual}_\text{usage} \times \%\text{BD}$$

$\text{Annual}_{\text{usage}}$ = The annual steam usage in lbm/year.

= Actual or if unknown:

$$\text{Annual}_\text{usage} = \left[\frac{\text{Hours} \times \text{Capacity}}{[(\text{H}_\text{S} - \text{H}_\text{B})(1 - \%_\text{make-up}) + (\text{H}_\text{S} - \text{H}_\text{w})(\%_\text{make-up})]}\right]$$

Capacity = Boiler input capacity in btu/hr.

$\%_{\text{make-up}}$ = Percentage of make-up water

= 20%[1238] or actual if known.

If space heating:

Hours = Equivalent Full Load Hours of heating in Existing Buildings; provided in section 4.4 HVAC End Use.

If process:

Hours = $\text{Annual Hours} \times \text{UF}$

[1238] Okbaendrias, Biniam. Energy Management in Industries: Analysis of energy savings potential by steam condensate return. Page 10. About 75-85% of the total condensate return in reasonable

Annual Hours = Annual operating hours of the facility

= Use actual or if unknown 8766[1239]

UF = Utilization Factor

= Use actual or if unknown 41.9%[1240]

%BD = Blowdown Percentage

= 5% for automatic or 7% for manual[1241] or:

$$\%\mathrm{BD} = \frac{1}{\mathrm{c_{cycle}}}$$

C_{cycle} = Concentration cycles

$$\mathrm{c_{cycle}} = \frac{\mathrm{F_c} \times \mathrm{cond_{target}}}{\mathrm{cond_{feedwater}}}$$

= Actual if known

F_c = Conductivity Factor

= 1 if automatic blowdown; 1.2[1242] if manual blowdown

H_B = Enthalpy of the blowdown (Btu/lbm)

System Type	Supply Fluid Temperature[1243] (˚F)	Enthalpy of Blowdown (Btu/lbm)
5 psi Steam (low pressure)	225	195.4
15 psi Steam (low pressure)	250	218.3
40 psi Steam (low pressure)	287	256.1
65 psi Steam (high pressure)	312	281.9
100 psi Steam (high pressure)	338	309.1
150 psi Steam (high pressure)	365	338.6

H_s = Enthalpy of supplied steam[1244], (Btu/lbm)

System Type	Supply Fluid Temperature[1245] (˚F)	Enthalpy of Supplied Steam (Btu/lbm)
5 psi Steam (low pressure)	225	1155
15 psi Steam (low pressure)	250	1166
40 psi Steam (low pressure)	287	1176
65 psi Steam (high pressure)	312	1186

[1239] From IL TRM

[1240] From IL TRM Measure 4.4.54 Process Heating Boiker

[1241] "Boiler Blowdown – Fact Sheet" N.C Division of Pollution Prevention and Environmental Assistance, August 2004. https://p2infohouse.org/ref/34/33027.pdf

[1242] "Boiler Blowdown – Fact Sheet" N.C Division of Pollution Prevention and Environmental Assistance, last modified August 2004.
https://p2infohouse.org/ref/34/33027.pdf

[1243] A typical design uses a Δ20°F from hot water supply temperature to return temperature. ASHRAE. Boiler System Efficiency. 2006. http://goesheatingsystems.com/wp-content/uploads/2015/04/BoilerEfficiencyArticle.pdf

[1244] Taken from IL TRM Measure 4.4.14 Pipe Insulation

[1245] A typical design uses a Δ20°F from hot water supply temperature to return temperature. ASHRAE. Boiler System Efficiency. 2006. http://goesheatingsystems.com/wp-content/uploads/2015/04/BoilerEfficiencyArticle.pdf

System Type	Supply Fluid Temperature[1245] (°F)	Enthalpy of Supplied Steam (Btu/lbm)
100 psi Steam (high pressure)	338	1190
150 psi Steam (high pressure)	365	1196

H_w = Enthalphy of incoming water from well or municipal system (Btu/lbm)

= 18.8 Btu/lbm for incoming water temperature of 50.7°F[1246]

SF = 90% heat recovery[1247].

n_{boiler} = Efficiency of the steam boiler

= Actual or if unknown use default values given below:

= 79% for steam boilers[1248]

$\%_{boiler\ load}$ = The load percentage of the blowdown boiler In the total load. (i.e if only one boiler available in

the facility, use 1)

$Cond_{feed\ water}$ = The conductivity of the feed water in µmho.

= Actual, If known.

$$= (\%_{make-up}) \times cond_{make\ up} + (1 - \%_{make-up}) \times cond_{return}$$

$Cond_{make\ up}$ = 317[1249] µmho or actual if known.

$Cond_{return}$ = 20 µmho[1250] or actual if known.

$Cond_{target}$ = The target conductivity following blowdown in µmho[1251]. Consult boilermaker for recommended TDS and max conductivity if available.

Boiler Type	Max TDS (ppm)	Max µmho
2 Pass Fire-Tube	4,500	6,716
3 Pass Fire-Tube	3,000 to 3,500	4,851
Low Pressure Water-Tube	2,000 to 3,000	3,731
Medium Pressure Water-Tube	1,500	2,239
High Pressure Water-Tube	1,000	1,493

[1246] Taken from IL TRM Measure 4.4.14 Pipe Insulation

[1247] "Recover Heat from Boiler Blowdown" Department of Energy, last modified May 12, 2023. https://www.energy.gov/sites/prod/files/2014/05/f16/steam10_boiler_blowdown.pdf

[1248] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

[1249] "Comprehense Chemical Analysis " City of Chicago – Department of Water Management – Bureau of Water Supply; Water Quality Division-Water Purification Laboratories, last modified May 12,2023. https://www.chicago.gov/content/dam/city/depts/water/WaterQltyResultsNRpts/ccReports/CCA-2019-1-3.pdf

[1250] "Boiler Blowdown Automation Basics", last modified January 23, 2017. https://www.yamathosupply.com/blogs/news/boiler-blowdown-automation-basics#:~:text=Involves%20manually%20opening%20a%20blowdown%20valve%20at%20various,target%20maximum%20lead%20to%20the%20formation%20of%20scale.

[1251] "Maximum permissible TDS", last modified May 12,2023. http://www2.spiraxsarco.com/resources/steam-engineering-tutorials/the-boiler-house/controlling-tds-in-the-boiler-water.asp

For example, for a Chicago High School with a 10,000 kbtu/hr steam boiler in an 15 psi system with no blowdown heat recovery and existing manual blowdown.

$$\text{BDR} = \left[\frac{10{,}000{,}000 \times 1855}{((1{,}166 - 218.3)(1 - 0.2) + (1{,}166 - 18.8)(0.2)]}\right] \times 0.07\% \text{ (manual blowdown)} = 1{,}314 \text{ klb/year}$$

$$\Delta\text{Therms} = \frac{1{,}314{,}803 \text{ lb/year } \times (218.3 - 18.8)}{80.7\% \times 100{,}000} \times 0.9 = 2{,}925 \text{ therms}$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Maintenance personnel should complete annual or semi-annual maintenance inspections of the condensate return system for its optimal performance. The O&M cost shall be included in cost-effectiveness calculations. It is recommended to service the following components to maintain the system's proper operation: pumps, ensure periodic lubrication for motors, in accordance with the motor manufacturer's guidelines. Strainers, traps should also be included as an O&M consideration. A custom calculation should be used as necessary.

MEASURE CODE: CI-HVC-BBHR-V02-260101

REVIEW DEADLINE: 1/1/2028

4.4.64 Steam Vent Condensers

DESCRIPTION

According to the Department of Energy[6], vent condensers can be used with condensate systems to reduce the amount of energy needed to maintain steam temperatures. When flash steam is being vented to atmosphere, it carries with it the energy required to heat water to steam temperature, eventually wasted. Another condenser in the form of a heat exchanger attached to the condensate recovery system will allow this energy to remain within the system and thus reduce the energy needed to heat the condensate back up to the steam pressure necessary for operation. The recovered flash steam will also be distilled after eventually condensing and require less outside water to be introduced to the system. This improves longterm performance by reducing the need for undistilled feed water that has a higher concentration of heavy particulates that scale inside boilers and absorbe heat, making the boilers less efficient.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure requires that a heat exchanger be installed with capability to condense flash steam and return distilled water to the condensate tank.

DEFINITION OF BASELINE EQUIPMENT

This measure requires that a building must be equipped with steam boilers and a condensate recovery tank with flash steam venting in use. This also requires the building to be equipped with multiple pressure loads beyond heating applications and work within the parameters of fully efficient steam sytems already. Steam equipment must meet baseline efficiency standards for boilers and condensate recovery, as well as working order steam traps.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure of life is assumed to be 20 years.[1252]

DEEMED MEASURE COST

The measure cost of a vent condenser must be custom to the type installed and associated equipment necessary.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

[1252] The efficiency for Heat Exchangers is stated at 27 years by ASHARE Table 4 Chapter 36, Comparison of Service Life Estimates, 2007 ASHRAE Handbook, HVAC Applications http://weblegacy.ashrae.org/publicdatabase/system_service_life.asp?selected_system_type=3. However, this is capped at 20 years due to the TRM specified.[7]
lifetime of steam boilers.

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Natural gas energy savings are calculated for steam vent condensers per the equations given below.

$$\Delta Therms = \frac{Vent_{rate} \times (H_s - H_w) \times hours}{n_{boiler} \times 100{,}000} \; X\; SF$$

Where:

$$Vent_{rate} = Condensate_{load} \times \%_{flash\ Steam}$$

$Vent_{rate}$ = The rate at which steam passes through the vent (lb/hr)

$Condensate_{load}$ = Estimated condensate load based on pipe size[1253] (lb/hr)

$$Condensate_{load} = 114[Pipe_{size}]^{2.38}$$

$Pipe_{size}$ = Diameter of vent pipe (inches)

%FlashSteam = Percentage of flash steam (%)

System Type	Flash Steam percentage[1254] (°F)
5 psi Steam (low pressure)	1.6%
15 psi Steam (low pressure)	3.9%
40 psi Steam (low pressure)	7.8%
65 psi Steam (high pressure)	10.5%
100 psi Steam (high pressure)	13.3%
150 psi Steam (high pressure)	16.3%

If space heating:

Hours = = Equivalent Full Load Hours of heating in Existing Buildings; provided in section 4.4 HVAC End Use.

If process:

Hours = $= \text{Annual Hours} \times \text{UF}$

Annual Hours = Annual operating hours of the facility

= Use actual or if unknown 8766

UF = Utilization Factor

[1253] Design of Fluid Systems Hook-ups by Spirax Sarco (1992) Page 37. Table 11 Minimum Dimensions of Flash Vessels. Max condensate quantity and Inlet and Flash Steam Outlet size were plotted against each other. Constants for a power trendline equation were obtained as a result. An oversize factor of 0.5 was applied to the maximum condensate load to account for times when exact pipe sizes cannot be obtained, and the next available pipe size needs to be selected.

[1254] Obtained from the Steam System Modeler Tool (SSM) Flash Tank Calculator by the Department of Energy (DOE). Saturated quality 0 and Tank Pressure 0 psig.
https://www4.eere.energy.gov/manufacturing/tech_deployment/amo_steam_tool/equipFlashtank

= Use actual or if unknown 41.9%[1255]

H_s = Enthalpy of steam at venting pressure (Btu/lbm)

= 1,150 Btu/lb for steam at atmospheric pressure.

H_w = Enthalpy of incoming water from well or municipal system (Btu/lbm)

= 18.8 Btu/lbm for incoming water temperature of 50.7°F[1256].

nboiler = Efficiency of the steam boiler

= Actual or if unknown use default values given below:

= 79% for steam boilers[1257]

SF = Savings Factor

= Percent of thermal steam energy recovered from vent

= 90% of heat recovered. [1258]

For example, a vent with a pipe diameter of 2 inches in a steam boiler operating year round at 15 psi

$$Condensate_{load} = 114(2)^{2.38} = 594\ lb/hr$$

$$Vent_{rate} = 594 \times 3.9\% = 23.14\ lb/hr$$

$$\Delta Therms = \frac{(23.14) \times (1150 - 18.8) \times 8760}{80.7\% \times 100{,}000}\ X\ 0.9 = 2{,}557\ therms$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

The methodology for calculating water savings involves obtaining the vent rate referenced above. Distilled condensate is ready for productive use to be reintroduced into the system.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-STVC-V02-260101

REVIEW DEADLINE: 1/1/2028

[1255] From IL TRM Measure 4.4.54 Process Heating Boiler

[1256] Taken from IL TRM Measure 4.4.14 Pipe Insulation

[7] "ASHRAE: HVAC Service Life Database" ASHRAE, last modified May 12, 2023, http://weblegacy.ashrae.org/publicdatabase/service_life.asp

[1257] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

[1258] "Recover Heat from Boiler Blowdown" Department of Energy, last modified May 12, 2023. https://www.energy.gov/sites/prod/files/2014/05/f16/steam10_boiler_blowdown.pdf

4.4.65 Computer Room Air Conditioner (CRAC)

DESCRIPTION

Computer Room Air Conditioning (CRAC) Units are installed to meet cooling requirements for computers, servers, and other electronic components. This measure promotes the installation of CRAC units by exploring the space cooling savings potential for the replacement or new commissioning of a computer room air conditioner.[1259]

This measure could apply to the replacing of an existing functional unit, an existing unit at the end of its useful life or the installation of a new unit in a new or existing building.

This measure was developed to be applicable to the following program types: TOS, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a CRAC Unit in the equipment categories expressed in Tables 1 and 2 that exceeds the energy efficiency requirements as prescribed by the program. The equipment must be categorized as either floor or ceiling mounted.

The equipment must possess a net sensible cooling capacity less than 760,000 Btu/h for equipment classified as upflow non-ducted or horizontal flow. Equipment that is classified as Downflow or upflow ducted shall not exceed the net sensible cooling capacity of 930,000 Btu/h.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a standard-efficiency air- cooled, air- cooled with a fluid economizer, water-cooled, water-cooled with a fluid economizer, glycol-cooled, or glycol-cooled with a fluid economizer air conditioner that meets the Code energy efficiency requirements (IECC or Code of Federal Regulations whichever is higher) in effect on the date of equipment purchase (if date is unknown, assume current Code minimum).

In order for this characterization to apply, the baseline equipment is assumed to meet the efficiency requirements within the code in effect on the date of the building permit. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[1260]

DEEMED MEASURE COST

$750 per ton incremental costs may be assumed. Actual CRAC costs vary widely in practice.[1261]

[1259] "State of Minnesota Technical Reference Manual for Energy Conservation Improvement Programs" January 31st, 2024 https://mn.gov/commerce-stat/trm/releases/4.1.pdf#page=319&zoom=100,93,96

[1260] ASHRAE Standard 90.1-2010 Equipment Final Rule Technical Support Document Chapter 6, Life-Cycle Cost and Payback Period Analysis

[1261] "State of Minnesota Technical Reference Manual for Energy Conservation Improvement Programs" January 31st, 2024

LOADSHAPE

Loadshape is determined by the constant power draw by the equipment;

Loadshape C53 – Flat

COINCIDENCE FACTOR

The coincidence factor is determined by the constant power draw by the server room; the summer peak coincidence factor for the equipment is assumed to be 1.0

CFPJM = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (Size * LF * EFLH * (1/nsenCOPBASE - 1/nsenCOPEE)) / 0.2843$$

Where:

Size = the nominal cooling capacity rating of the energy efficient chiller (tons). 1 ton = 12,000 Btu/h

= Actual

LF = Cooling load factor

= 0.65[1262]

0.2843 = conversion factor (0.2843 tons/ kWh)

NSenCOPBASE = minimum rated Net Sensible Coefficient of Performance (NSenCOP)[1263]. See Tables 1 and 2.

NSenCOPEE = rated Net Sensible Coefficient of Performance (NSenCOP) for the energy efficient CRAC

= Actual

EFLH = Equivalent full load hour of cooling

= 8,760 hours

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (Size * LF * CF * (1/nsenCOPBASE - 1/nsenCOPEE)) / 0.2843$$

Where:

CF = Coincidence factor

[1262] ASHRAE Technical Support Document, 4.2.3.2 "Estimate the Average Computer Server Heat Load", page 4-15.
[1263] CRAC efficiencies are not represented by any other efficiency measurements such as IEER, EER, SEER, IPLV, or COP. Under AHRI Standard 1360-2017 (1361-2017), Net Sensible Cooling Capacity (not Total Cooling Capacity) is used to calculate a Net Sensible Coefficient of Performance.

= 1.0

Other factors as defined above

For example, an air-cooled upflow non-ducted CRAC is installed with a rated NsenCOP of 3.00, and net sensible cooling capacity of 60,000 Btu/h (5 tons). From Table 1, the baseline NsenCOP efficiency equals 2.16.

$$\Delta kWh = (Size * LF * EFLH * (1/nsenCOPBASE - 1/nsenCOPEE)) / 0.2843$$
$$= (5\ tons * 0.65 * 8760hrs * (1/2.16 - 1/3.0)) / 0.2843\ tons/kWh$$
$$= \mathbf{12,982\ kwh}$$
$$\Delta kW = (Size * LF * CF * (1/nsenCOPBASE - 1/nsenCOPEE)) / 0.284\ ton/kW$$
$$= (5\ tons * 0.65 * 1 * (1/2.16 - 1/3.0) / 0.2843\ kW/ton$$
$$= \mathbf{1.48\ Kw}$$

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

REFERENCE TABLES

Table 1—Amended Energy Conservation Standards for Floor-Mounted CRACs[1264]

Equipment type	Net sensible cooling capacity [1]	Minimum NSenCOP efficiency		Net sensible cooling capacity	Minimum NSenCOP efficiency	
		Downflow	Upflow ducted		Upflow non-ducted	Horizontal flow
Air-Cooled	<80,000 Btu/h [2]	2.70	2.67	<65,000 Btu/h	2.16	2.65
	≥80,000 Btu/h and <295,000 Btu/h	2.58	[3] 2.55	≥65,000 Btu/h and <240,000 Btu/h	2.04	2.55
	≥295,000 Btu/h and <930,000 Btu/h	2.36	2.33	≥240,000 Btu/h and <760,000 Btu/h	1.89	2.47
Air-Cooled with Fluid Economizer	<80,000 Btu/h ≥80,000 Btu/h and <295,000 Btu/h	2.70 2.58	2.67 [3] 2.55	<65,000 Btu/h ≥65,000 Btu/h and <240,000 Btu/h	[3] 2.09 [3] 1.99	2.65 2.55
	≥295,000 Btu/h and <930,000 Btu/h	2.36	2.33	≥240,000 Btu/h and <760,000 Btu/h	1.81	2.47
Water-Cooled	<80,000 Btu/h	2.82	2.79	<65,000 Btu/h	2.43	2.79
	≥80,000 Btu/h and <295,000 Btu/h	2.73	[3] 2.70	≥65,000 Btu/h and <240,000 Btu/h	2.32	2.68
	≥295,000 Btu/h and <930,000 Btu/h	2.67	2.64	≥240,000 Btu/h and <760,000 Btu/h	2.20	2.60
Water-Cooled with Fluid Economizer	<80,000 Btu/h ≥80,000 Btu/h and <295,000 Btu/h	2.77 2.68	2.74 [3] 2.65	<65,000 Btu/h ≥65,000 Btu/h and <240,000 Btu/h	2.35 2.24	2.71 2.60
	≥295,000 Btu/h and <930,000 Btu/h	2.61	2.58	≥240,000 Btu/h and <760,000 Btu/h	2.12	2.54
Glycol-Cooled	<80,000 Btu/h	2.56	2.53	<65,000 Btu/h	2.08	2.48
	≥80,000 Btu/h and <295,000 Btu/h	2.24	2.21	≥65,000 Btu/h and <240,000 Btu/h	1.90	2.18
	≥295,000 Btu/h and <930,000 Btu/h	2.21	2.18	≥240,000 Btu/h and <760,000 Btu/h	1.81	2.18
Glycol-Cooled with Fluid Economizer	<80,000 Btu/h ≥80,000 Btu/h and <295,000 Btu/h	2.51 2.19	2.48 2.16	<65,000 Btu/h ≥65,000 Btu/h and <240,000 Btu/h	2.00 1.82	2.44 2.10
	≥295,000 Btu/h and <930,000 Btu/h	2.15	2.12	≥240,000 Btu/h and <760,000 Btu/h	1.73	2.10

[1] For downflow and upflow-ducted CRACs, the NSCC measured per AHRI 1360–2017 and the latest update to the standard, AHRI 1360–2022, is higher than the NSCC measured per the current Federal test procedure (which references ANSI/ASHRAE 127–2007). Therefore, to ensure equipment currently covered by Federal standards is not removed from coverage, DOE translated the currently applicable upper capacity limit for these classes (760,000 Btu/h) to NSCC as measured per AHRI 1360–2017 and AHRI 1360–2022, resulting in a crosswalked upper capacity boundary of 930,000 Btu/h. Consequently, DOE has used 930,000 Btu/h as the translated upper capacity limit for downflow and upflow-ducted CRACs in the analysis presented in this notice. For up-flow non-ducted CRACs, because there is no change in return air temperature conditions between ANSI/ASHRAE 127–2007 and AHRI 1360–2022, the capacity boundaries in ASHRAE Standard 90.1–2019 remain the same as those specified in the current Federal standards, and DOE correspondingly retains the current capacity boundaries. For horizontal-flow CRACs, DOE does not currently prescribe standards; therefore, a crosswalk of current capacity boundaries is not applicable. See section III.C.5 of this final rule for further discussion of DOE's crosswalk analysis of capacity boundaries for CRACs.

[2] Btu/h refers to "British thermal units per hour."

[3] The amended standard for this equipment class is of equivalent stringency to the currently applicable Federal standard—the adopted level is a translation from the current metric (SCOP) to the adopted metric (NSenCOP) and aligns with the corresponding level in ASHRAE Standard 90.1.

[1264] Office of Energy Efficiency and Renewable Energy, Department of Energy., "Energy Conservation Program: Energy Conservation Standards for Computer Room Air Conditioners" June 2nd, 2023

Table 2—Amended Energy Conservation Standards for Ceiling-Mounted CRACs[1265]

Equipment type	Net sensible cooling capacity	Minimum NSenCOP efficiency	
		Ducted	Non-ducted
Air-Cooled with Free Air Discharge Condenser	<29,000 Btu/h ≥29,000 Btu/h and <65,000 Btu/h	2.05 2.02	2.08 2.05
	≥65,000 Btu/h and <760,000 Btu/h	1.92	1.94
Air-Cooled with Free Air Discharge Condenser and Fluid Economizer	<29,000 Btu/h ≥29,000 Btu/h and <65,000 Btu/h	2.01 1.97	2.04 2.00
	≥65,000 Btu/h and <760,000 Btu/h	1.87	1.89
Air-Cooled with Ducted Condenser	<29,000 Btu/h	1.86	1.89
	≥29,000 Btu/h and <65,000 Btu/h	1.83	1.86
	≥65,000 Btu/h and <760,000 Btu/h	1.73	1.75
Air-Cooled with Ducted Condenser and Fluid Economizer	<29,000 Btu/h ≥29,000 Btu/h and <65,000 Btu/h	1.82 1.78	1.85 1.81
	≥65,000 Btu/h and <760,000 Btu/h	1.68	1.70
Water-Cooled	<29,000 Btu/h	2.38	2.41
	≥29,000 Btu/h and <65,000 Btu/h	2.28	2.31
	≥65,000 Btu/h and <760,000 Btu/h	2.18	2.20
Water-Cooled with Fluid Economizer	<29,000 Btu/h ≥29,000 Btu/h and <65,000 Btu/h	2.33 2.23	2.36 2.26
	≥65,000 Btu/h and <760,000 Btu/h	2.13	2.16
Glycol-Cooled	<29,000 Btu/h	1.97	2.00
	≥29,000 Btu/h and <65,000 Btu/h	1.93	1.98
	≥65,000 Btu/h and <760,000 Btu/h	1.78	1.81
Glycol-Cooled with Fluid Economizer	<29,000 Btu/h ≥29,000 Btu/h and <65,000 Btu/h	1.92 1.88	1.95 1.93
	≥65,000 Btu/h and <760,000 Btu/h	1.73	1.76

MEASURE CODE: CI-HVC-CRAC-V01-250101

REVIEW DEADLINE: 1/1/2028

[1265] Office of Energy Efficiency and Renewable Energy, Department of Energy., "Energy Conservation Program: Energy Conservation Standards for Computer Room Air Conditioners" June 2nd, 2023

4.4.66 Steam Leak Repair

DESCRIPTION

The measure applies to the repair of steam leaks that allow steam to escape the steam distribution system. Steam leaks result in the loss of both latent heat and kinetic energy. The Steam Leak Repair measure is applicable to commercial applications, commercial HVAC (low pressure steam) including multifamily buildings, low-pressure, medium-pressure and high-pressure industrial applications. The measure is to be used when metered data is not available. Additional methods for estimating steam leak such as the plume length method may take precedence over this approach, especially for system operating pressures of 115 psig and higher.

Steam leaks that are found in steam traps must be addressed through measure 4.4.16 Steam Trap Replacement or Repair.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Customer must repair steam leak by valve packing replacement, gasket replacement, long-term epoxy wrapping, or by welding when appropriate.

DEFINITION OF BASELINE EQUIPMENT

The baseline criterion is an individual steam leak in a low, medium or high-pressure steam system. No minimum leak rate is required. Any leak can be repaired or replaced.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

6 years for steam traps or other mechanical components.[1266] Welded repairs should use a default assumption of 18 years.[1267]

DEEMED MEASURE COST

The cost for this measure can vary considerably depending on where the steam leak occurs and the work / parts required to repair it. Use custom costs where costs are not provided; otherwise use $337[1268] /(lb/hr) of steam leak.

LOADSHAPE

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

[1266] CLEAResult "Steam Traps Revision #1", August 2011. Primary studies used to prepare the source paper include Enbridge Steam Trap Survey, KW Engineering Steam Trap Survey, Enbridge Steam Saver Program 2005, Armstrong Steam Trap Survey, DOE Federal Energy Management Program Steam Trap Performance Assessment, Oak Ridge National Laboratory Steam System Survey Guide, KEMA Evaluation of PG&E's Steam Trap Program, Sept. 2007. Communication with vendors suggested an inverted bucket steam trap life typically in the range of 5 - 7 years, float and thermostatic traps 4- 6 years, float and thermodynamic disc traps of 1 - 3 years. Cost does not include installation.

[1267] Mazel, R E, and Anokhov, A E. Increasing the reliability of steam pipe welded joints. United States: Sov. Power Eng. (Engl. Transl.); (United States), Vol. 11:8; August 1982. Operating experience with thermal power plants shows that butt welds of steam pipes made of Cr-Mo-V steels have a satisfactory reliability over the course of 150,000 hours of operation.

[1268] Measure costs are based on data from seven steam leak projects provided by Franklin Energy Services.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS[1269]

$$\Delta Therm = \frac{S_a \times \left(H_v + H_s * (T_1 - T_{source})\right) * Hours}{100000 * \eta_B}$$

Where:

For Low Pressure Steam used in space heating applications (5psig or lower):

$$S_a = \text{Steam loss per leak lb/hr} = \frac{1519.3 * P_1 * D_1 * [\left(\frac{1}{T_1} * \frac{\gamma}{\gamma - 1}\right) * (\left(\frac{P_2}{P_1} * \frac{2}{\gamma}\right) - \left(\frac{P_2}{P_1} * \frac{\gamma + 1}{\gamma}\right)]}{2}$$

For all other steam systems and applications, use the following equation:

Sa = $24.24 * P_1 * D_1^2 * A * FF$

Where:

γ = heat capacity ratio

= $5.071 * 10^{-4} * P_1 + 1.332$

P_1 = Average Steam Inlet Pressure (psia)

P_2 = Average Steam Outlet Pressure. If unknown assume 14.696 psia.

D_1 = Effective diameter of the leak. If unknown use D1 = 0.08 in[1270]

A = 50%[1271], all steam systems. This factor accounts for reduction in the maximum theoretical steam flow to the average steam flow (the Enbridge factor).

H_v = Enthalpy of Vaporization in Btu/lb if unknown see Table below.

H_s = Specific Heat of Water, (Btu/(lbm * ^oR))

= 1.001

T_1 = Temperature of Saturated Steam (°R) = $507.89 * P_1^{0.0962}$, if unknown see Table below.

T_{source} = Temperature at the source, if unknown see Table below:

[1269] See "Derivation of Equation for Subsonic Compressible Flow through an Orifice and Supporting Calculations for Illinois TRM Steam Trap Measure" paper for more information.

[1270] Diameter based on "Rule of Thumb for Estimating Energy Cost Savings from the Department of Energy Lean & Energy Toolkit: Appendix C | US EPA". High-pressure steam leaks (125 pounds per square inch gauge (psig) repairs are expected to save from $150 to $500 per leak per shift per year. The Department of Energy uses a natural Gas cost of $0.35 per one hundred cubic feet (ccf). With an 80% boiler efficiency; the leak size is estimated at 342 CCF or 331 therms per leak per shift per year using the lower end of the cost savings. There are about 2,760 working hours per shift per year, which results in 0.17 therms per leak per hour. Utilizing the equation of steam loss per leaking trap from measures 4.4.16 steam trap replacement, the equivalent of 0.17 therm per leak per hour is a 0.08 orifice size. The analysis was also made for low-pressure steam leaks defined as 15 psig, costing $30 to $100 per leak per shift year. The same orifice size was obtained.

[1271] Enbridge adjustment factor used as referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012 and DOE Federal Energy Management Program Steam Trap Performance Assessment.

Steam System	Hv (btu/lb)[1272]	T1 (°R)	Ts (°R)[1273]	Average Inlet Pressure (psig)[1274]
Commercial Dry Cleaners	890	789.060	513.67	82.8
Multifamily LPS	951	672.103	513.67	3.7
Multifamily LPS ≥ 5 psig and < 15 psig	951	694.581	513.67	11.2
Commercial LPS Space Heat < 15 psig	951	694.581	513.67	11.2
Industrial or Process Low Pressure, < 15 psig	951	694.581	513.67	11.2
Medium Pressure > 15 psig < 30 psig	944	706.036	513.67	16
Medium Pressure ≥ 30 < 75 psig	915	755.079	513.67	47
High Pressure ≥ 75 < 125 psig	880	802.160	513.67	101
High Pressure ≥ 125 < 175 psig	859	827.918	513.67	146
High Pressure ≥ 175 < 250 psig	837	852.076	513.67	202
High Pressure ≥ 250 < 300 psig	816	872.652	513.67	263

Hours = Hours of plant operation

= Actual, if unknown, use default hours provided below:

Steam System	Zone (where applicable)	Hours/Yr[1275]
Commercial Dry Cleaners	All Climate Zones	2,425
Industrial/Process Low Pressure: psig < 15		8,282
Medium Pressure: 15 ≤ psig < 30		8,282
Medium Pressure: 30 ≤ psig < 75		8,282
High Pressure: 75 ≤ psig < 125		8,282
High Pressure: 125 ≤ psig < 175		8,282
High Pressure: 175 ≤ psig < 250		8,282
High Pressure: 250 ≤ psig < 300		8,282
High Pressure: 300 ≤ psig		8,282
Commercial Space Heating LPS	Rockford	4,272
	Chicago	4,029
	Springfield	3,406
	Belleville	2,515
	Marion	2,546

[1272] Latent heat of vaporization of steam at the inlet pressure to the steam trap. Implicit assumption that the average boiler nominalpressure where the vaporization occurs, is essentially that same pressure. Referenced in CLEAResult "Work Paper Steam Traps Revision #2" Revision 3 dated March 2, 2012.

[1273] US DOE Building America Program. Building America Analysis Spreadsheet. For Chicago, IL

[1274] Commercial and Industrial low pressure steam trap inlet pressure based on Franklin Energy and Opinion Dynamics analysis of data collected by Armstrong for 120,833 steam traps. Data covered coil, process, and radiator steam trap applications on modulating and constant pressure systems less than 15psi. Medium and high pressure steam trap inlet pressure based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours. Dry cleaning steam trap inlet pressure based on C5 Steam Traps – Nicor FINAL 10.27.11.

[1275] Medium and high-pressure steam trap annual operating hours based on Navigant analysis of source collected during program implementation by Nicor Gas for GPY1 through GPY4. For each steam trap project, the data provided measure savings description, operating pressure, installation Zip code, business building type, program year, and annual operating hours.

Steam System	Zone (where applicable)	Hours/Yr[1275]
Multifamily Space Heating LPS	For steam traps that are part of steam systems where the boiler cycles on/off to maintain space setpoint temperature or for steam traps located downstream of a steam control valve that opens/closes to maintain setpoint temperature, use Heating EFLH values in Section 4.4 for High Rise or Mid-Rise MF buildings. For steam traps that are exposed to steam continuously throughout the heating season, use the values listed above for Commercial Space Heating LPS for your appropriate climate zone.	

η_B = Boiler Efficiency %

= Actual, if unknown: 79%[1276] for steam boilers

For example, a steam leak in a 45 psig system in a commercial application operating 1 shift

ΔTherm = Sa * (Hv + Hs (T1-Tsource)) * Hours / (100000 * η_B)

Sa = 24.24 * P_1 * D_1^2 * A * FF

Sa = 24.24 * (45 + 14.696) * 0.08^2 * 50% * 100%

Sa = 4.630 lb/hr

ΔTherm = 4.63 * (-915 + 1.001 * (755.079 – 513.67)) * 2760 / (100000 * 80.7%)

= 183.155 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

ΔWater = GAL * Hours

Where:

GAL = average actual water volume saved per leak per system

= S_a / 8.33 (lb/gal)

Other variables as defined above.

Deemed O&M Cost Adjustment Calculation

N/A

MEASURE CODE: CI-HVC-SLKR-V02-260101

4.4.67 Review Deadline: 1/1/2028

[1276] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

CRAC/CRAH Electronically Commutated Plug Fans

DESCRIPTION

This measure requires the installation of Electronically Commutated (EC) plug fans in Computer Room Air Conditioner (CRAC) and/or Computer Room Air Handler (CRAH) units. The EC plug fans will be replacing conventional, belt-driven fans. Installing any mechanism that could potentially modify the airflow of the supply fan on a DX system has potential to freeze the coil. Installation of any ECM on a CRAC unit should be verified with the manufacturer.

This measure was developed to be applicable to the following program types: TOS and ER. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The ECM application involves the replacement of existing CRAC or CRAH fans with an EC plug nDefinition of Baseline Equipment

The baseline criteria is a CRAC/CRAH unit with centrifugal, belt-driven fans powered by three-phase AC motors.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

15 years[1277]

DEEMED MEASURE COST

If known, actual equipment and labor costs should be used.

If unknown, assume an incremental cost of $1,700 per fan[1278].

LOADSHAPE

Loadshape C53 – Flat

COINCIDENCE FACTOR

CF = 1.0

[1277] ASHRAE Standard 90.1-2010 Equipment Final Rule Technical Support Document Chapter 6, Life-Cycle Cost and Payback Period Analysis. Lifetime is assumed to be the same as that of the CRAC/CRAH system that the fan is attached to, see 4.4.65 Computer Room Air Conditioner (CRAC)

[1278] Estimated average cost of selecting an EC fan option over a baseline fan option when purchasing a new CRAC unit. This comes from a Colorado custom rebate project, please see 'CO-Rates-and-Reg-DSM-Sata-Center-Efficiency-Deemed-Savings-2016.pdf

Algorithm

CALCULATION OF ENERGY SAVINGS

Default savings for this measure are shown in the table below:

Location of Plug Fan	Annual Energy Savings (kWh/HP)	Peak Demand Reduction (kWh/HP)
In Unit	1,390	0.1587
Underfloor	2,306	0.2633
If Unknown	1,848	0.2110

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \Delta Fan\ Power * \left[HOU_{Fan} + \left(\frac{3{,}413}{12{,}000} * \eta_{cooling}\right) * HOU_{Fan} \right]$$

$$\Delta Fan\ Power = HP * (1 - CLF) * 0.746 * UF$$

$$CLF = \left(\frac{\eta_{base\ fan} * \eta_{base\ belt} * \eta_{base\ motor}}{\eta_{EC\ fan} * \eta_{EC\ drive} * \eta_{EC\ motor}}\right) - UDSF$$

Where:

$\Delta Fan\ Power$ = Fan power reduction (kW)[1235]

HOU_{Fan} = Annual hours of fan operation

= 8,760 Hours/year

3,413 = Btu to kWh conversion factor (Btu/kWh)

12,000 = Btu to ton (cooling) conversion factor (Btu/kWh)

$\eta_{cooling}$ = Efficiency of cooling system

= 0.95 KW/ton[1279]

HP = Fan power replaced (HP)

CLF = Comparison Load Factor. This term compares the baseline and EC system efficiencies and accounts for underfloor location (if applicable) to provide an estimate of the load on the EC system.[1235]

0.746 = kilowatt to hp conversion factor (KW/HP)

UF = % of CRAC/CRAH units in use

= 83%[1280]

$\eta_{base\ fan}$ = Efficiency of baseline centrifugal, forward-curved fans

= 53.81%[1281]

$\eta_{base\ belt}$ = Efficiency of baseline belt

= 95%[1234]

$\eta_{base\ motor}$ = Efficiency of baseline AC motor

[1279] U.S. Department of Energy, "Replace V'Belts with Notched or Synchronous Belt Drives", November 2012.
[1280] Pennsylvania Public Utility Commission (PUC) "Technical Reference Manual Volume 3: Commercial and Industrial Measures, 3.2.11 Computer Room Air Conditioner/Handler Electronically Commutated Plug Fans" State of Pennsylvania, August 2019.
[1281] Pennsylvania Public Utility Commission (PUC) "Technical Reference Manual Volume 3: Commercial and Industrial Measures, 3.2.11 Computer Room Air Conditioner/Handler Electronically Commutated Plug Fans" State of Pennsylvania, August 2019.

$= 91.18\%$[1282]

$\eta_{EC\ fan}$ = Efficiency of EC plug fan

$= 65.97\%$[1235]

$\eta_{EC\ drive}$ = Efficiency of EC motor drive

$= 99.5\%$[1235]

$\eta_{EC\ motor}$ = Efficiency of EC motor

$= 88.96\%$[1235]

$UDSF$ = Underfloor distribution savings factor. If fans are located:[1234]

= 0% for in-unit

= 12.7% for underfloor

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW_{peak} = \Delta Fan\ Power * \left[1 + \left(\frac{3{,}413}{12{,}000} * \eta_{cooling} \right) * CF \right]$$

Where:

$\Delta Fan\ Power$ = Fan power reduction (kW)[1283]

3,413 = Btu to kWh conversion factor (Btu/kWh)

12,000 = Btu to ton (cooling) conversion factor (Btu/kWh)

$\eta_{cooling}$ = Efficiency of cooling system

$= 0.95$ KW/ton[1237]

CF = Coincidence factor

$= 1.0$

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-CRPF-V01-260101

REVIEW DEADLINE: 1/1/2028

[1282] Xcel Energy Data Center Efficiency Program, "Deemed Savings Technical Assumptions".
[1283] Xcel Energy Data Center Efficiency Program, "Deemed Savings Technical Assumptions".

4.4.68 Turbulators

DESCRIPTION

This measure relates to improving combustion efficiency by adding turbulators. Turbulators improve the boiler efficiency by reducing the stack temperature of single-pass horizontal return tubular (HRT) brick-set boilers and older two- and three-pass oil and natural-gas fuel firetube boilers.

In firetube boilers hot combustion gases pass through long, small-diameter tubes, where heat is transferred to water through the tube walls. Hot combustion gases enter the tubes in a turbulent flow regime, but within a few feet, laminar flow begins and a boundary level of cooler gas forms along the tuber walls. This layer serves as a barrier reducing heat transfer efficiency.

According to the Department of Energy[1284], turbulators consist of small baffles, angular metal strips, spiral blades or coil wire and typically installed on the last pass of the boiler tubes to break up the laminar boundary layer. Turbulators are added to increase the turbulence of the hot combustion gases and the convective heat transfer to the heat surface, increase boiler efficiency and reduce fuel costs. Turbulators are held in place with a spring lock and can be easily removed for tube brushing.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Efficient equipment is existing boiler with added turbulators. New boilers are not eligible for this measure.

DEFINITION OF BASELINE EQUIPMENT

Baseline is an existing vertical or horizontal firetube boiler providing steam or hot water for space heating loads.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

Adding turbulators does not extend the useful life of the boiler itself, the expected measure life is assumed to be the lower of remaining useful life of the boiler 8 years or 1/3rd of the boiler EUL (25yrs)[1285] .

DEEMED MEASURE COST

The cost of installing turbulators is $41 per tube or $0.40 per boiler input MBH[1286].

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

[1284] U.S. Department of Energy. *Consider Installing Turbulators on Two- and Three- Pass Firetube Boilers.* Steam Tip Sheet #25. Advanced Manufacturing Office, Energy Efficiency & Renewable Energy, May 2014. https://www.energy.gov/sites/prod/files/2014/05/f16/steam25_firetube_boilers.pdf

[1285] IL TRM Measure 4.4.10 High Efficiency Boiler: Consistent with DOE assumption determined through a literature review in Appendix 8-F of the Department of Energy Commercial Technical Support Document.

[1286] Based on project data from 9 custom projects completed in 2025 within the Peoples Gas territory, where turbulators were installed in the final flue gas pass of both low-rise and high-rise multifamily buildings.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta Therms = Capacity * Hours * UF * \left(\frac{nboiler + Savings\ Factor}{nboiler} - 1\right) * \frac{1}{100}$$

Where:

Capacity	= Nominal Heating Input Capacity Boiler Size (kBtu/hr) for existing unit
	= Custom Boiler input capacity in kBtu/hr
Hours	= If space heating, use EFLH, Equivalent Full Load hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use
	= If process, = 8766 hours
UF	= Utilization Factor
	= 1 if space heating, since utilization factor already included in EFLH
	= If process, = 41.9%[1287]
nboiler[1288]	= Efficiency of the steam or hot water boiler
	= Actual, or if unknown:
	80% for hot water boilers
	79% for steam boilers
Savings Factor	= 3.25%[1289]
100	= constant to convert kbtu to therms

For example, turbulators installed in a Chicago 1,500 kBtu/hr steam boiler in an elementary school:

$$\Delta Therms = \frac{1{,}500\ * 1{,}603\ * 3.25\%}{100 * (80.7\% + 3.25\%)} = 930\ therms$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

[1287] Work Paper – Tune up for Boilers serving Space Heating and Process Load by Resource Solutions Group, January 2012

[1288] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

[1289] A reduction of 130°F was observed in the stack gas temperature in a manufacturing facility installing 150 turbulators into its firetube boiler. Because each 40°F reduction in the boiler flue gas temperature results in 1% boiler-efficiency improvement, the overall efficiency improved by 3.25%. Additionally, United States EPA, Climate Wise: Wise Rules for Industrial Efficiency, July 1998. The Wise Rules indicate savings range of 1-2% per 40°F reduction, so utilizing 1% is a conservative approach.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-TRBLR-V01-260101

REVIEW DEADLINE: 1/1/2028

4.4.69 Waterless HVAC Condensate Trap

DESCRIPTION

Traditional, waterfilled P-traps are commonly installed on commercial HVAC condensate drainpipes to prevent air from leaking into or out of the HVAC system, but they rely on water remaining present in the curve of the trap at all times to prevent air infiltration. When traditional P-traps dry out in the winter or shoulder seasons due to the lack of condensate production, they allow air to enter or leave the HVAC system, resulting in energy loss as the replacement air must be conditioned. In commercial HVAC systems, this energy loss can become significant and lead to increased energy bills for building operators. A cost-effective means of reducing this energy loss is by replacing traditional P-traps with waterless HVAC condensate traps that seal using the HVAC system's air pressure instead of water, eliminating the concern of dried out P-traps.

Waterless HVAC condensate traps installed on commercial HVAC systems minimize air leakage from condensate drainpipes, while also minimizing the space needed for installation when compared to traditional P-traps. Laboratory testing[1290] of waterless HVAC condensate traps demonstrated that, across all tested models, pressure levels, and pipe diameters, air leakage rates consistently remained below 1 SCFM. Notably, 90% of the tests recorded leakage rates under 0.5 SCFM. These findings support that waterless HVAC condensate traps provide a highly effective alternative to traditional P-traps, significantly reducing air leakage in dry condensate drainpipes[1291]. These waterless condensate traps can function in both positive and negative pressure environments, and are adaptable to different system configurations, pressure ranges, and drainpipe connection types[1292]. When condensate forms, buoyancy lifts the float valve from the valve seat, allowing the condensate to drain properly

A variety of commercial packaged rooftop units (RTUs) HVAC units may qualify for this measure, including packaged rooftop units (RTUs), makeup air units (MAUs), and outdoor air handling units (AHUs).. The measure applies to commercial HVAC applications for retrofitting P-trap condensate traps with a properly sized waterless condensate trap with the exception of HVAC systems with a condensing gas-fired heating systems owing to condensate management in the heating season. It is assumed that the same HVAC system serves the building cooling and heating loads.

This measure was developed to be applicable to the following program types: TOS, RF, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a waterless HVAC condensate trap designed for installation on a commercial HVAC system's condensate drainpipe.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment consists of a traditional, waterfilled P-trap, which is used as a condensate trap in commercial HVAC condensate drainpipes to prevent air leakage. This measure does not apply to existing P-traps that are sufficiently tall to hold condensate for several months.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

Specific data on the lifespan of HVAC condensate traps is limited, as their durability can be influenced by factors such as maintenance practices, water quality, and environmental conditions. The estimated useful life is assumed to be 5 years.

[1290] Rachael Collins, Theresa Pistochini, and Robert McMurry, "Laboratory Testing and Energy Saving Potential of Des Champs HVAC Air-Trap," UC Davis Western Cooling Efficiency Center, September 9, 2021

[1291] Ibid

[1292] Nicholas H. Des Champs, "It's Time to Reconsider the Use of P-Traps for HVAC Condensate Removal," (Whitepaper, February 2023).

DEEMED MEASURE COST

Actual measure costs should be used if available. If actual costs are not available, the deemed measure costs listed below may be used.[1293]

Waterless Condensate Trap Type	Cost per Trap (Material Only)	Per-Unit Labor Cost (Trap Replacement)
Negative Pressure Trap	$81.6	$25
Positive Pressure Trap	$96.5	$25

LOADSHAPE

Loadshape C04 – Commercial Electric Heating

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

Any conditioned air leaked to the environment through a condensate drainpipe will need to be replaced by outdoor air that is conditioned, and the magnitude of the energy loss is driven by the temperature difference between the leaked air temperature and the outdoor air temperature. The leaked air temperature depends on the orientation of the cooling coil (with condensate drain) relative to the gas furnace heat exchanger and the HVAC supply fan. For systems where the cooling coil is upstream of the fan and the gas furnace, the leaked air temperature is estimated to be the same as the indoor air temperature at 75°F for all times the fan is running (heat and fan modes). For systems where the cooling coil and gas furnace are downstream of the fan, the leaked air temperature is estimated to be 120°F during heating mode and 75°F during fan only mode.

A leak would occur during the heating season if the depth of the standing water in the p-trap is not sufficient to withstand the pressure difference between the air handler and outdoors, which is more likely to occur during heating season due to evaporation of water in the trap and the lack of production of condensate during winter. The impact of a condensate drain leak during cooling season is unlikely during the summer when condensate is bring produced.

ELECTRIC ENERGY SAVINGS

Electric Energy Savings are only applicable if the heating system is electric. For gas-fired heating systems, please refer to the FOSSIL FUEL SAVINGS section for energy savings.

$$\Delta kWh = (kWh_{heating} + kWh_{fan})$$

Where:

$\Delta kWh_{heating}$ = heating energy saved in kWh during heating operation

ΔkWh_{fan} = heating energy saved in kWh during ventilation operation during heating season

$$kWh_{heating} = \frac{\dot{v} * 60 * EFLHheat * \rho * c_p * \Delta Theat * tons}{3{,}412 * \eta\text{Heat}}$$

[1293]The average material costs are based on an evaluation of commercial waterless HVAC condensate traps designed for positive/negative pressure systems with standard drainpipe diameters of 1.25", 1.5", and 2.0". Labor cost estimates are derived from 2025 RS Means data for PVC P-trap replacement in Springfield, IL.

$$kWh_{fan} = \frac{\dot{v} * 60 * EFLHfanheat * \rho * c_p * \Delta Tfan * tons}{3{,}412 * \eta\text{Heat}}$$

$\dot{v}$ = estimated leak rate for the HVAC system in CFM/ton[1294]. Use actual if known.

System Tonnage	External Static Pressure (in WC)	Leak Rate (cfm/ton)
Under20 tons	1"	0.6
	2"	0.9
	3"	1.0
20 - 50 tons	1"	0.6
	2"	0.8
	3"	1.0

60 = conversion from minutes to hour

$EFLH_{heat}$ = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

ηHeat = Efficiency of electric heating system, as deemed from table below

System Type	Cooling Capacity of Equipment	Age of Equipment	HSPF Estimate	η (Effective COP Estimate) (HSPF/3.413)
Heat Pump[1295]	All	Before 2009	6.8	2.0
	< 65,000 Btu/h	2009 - 2017	7.7	2.3
		2017 on	8.2	2.40
	≥ 65,000 Btu/h and < 135,000 Btu/h	2010 on	11.3	3.3
	≥ 135,000 Btu/h and < 240,000 Btu/h	2010 on	10.9	3.2
	≥ 240,000 Btu/h and < 760,000 Btu/h	2010 on	10.9	3.2
Resistance	N/A	N/A	N/A	1

$EFLH_{fanheat}$ = Total Fan Run hours during heating season in fan mode when burner is off

= 0.5 * Total Fan Run Hours[1296]- $EFLH_{heat}$

= Assuming the heating season is from October to March

[1294] Rachael Collins, Theresa Pistochini, and Robert McMurry, "Laboratory Testing and Energy Saving Potential of Des Champs HVAC Air-Trap," UC Davis Western Cooling Efficiency Center, September 9, 2021

[1295] Minimum heating efficiency standards for heat pumps are sourced from the Code of Federal Standards for Small and Large Commercial Package Air Conditioning and Heating Equipment (Air Cooled), 10 CFR 431.97 with compliance dates of June 16, 2008; January 1, 2010; January 1, 2017; and January 1, 2018. As the first federal appliance standards for heating efficiency for commercial heat pumps went into effect in June 2008, assuming efficiency standards equivalent to residential heat pumps prior to that date.

[1296] Hours per year are estimated using the eQuest or OpenStudio models developed by VEIC, as the total number of hours the fans are operating for heating, cooling and ventilation for each building type. Assumes total fan run hours are divided equally between the heating and cooling seasons and that a traditional P-trap is fully dry during the heating season.

Total Fan Run Hours = Default hours are provided for HVAC applications which vary by HVAC application and building type in the following table[1297]. When available, actual hours should be used

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Assembly	2,374	OpenStudio	VAV
Assisted Living	6,375	OpenStudio	CAV
Auto Dealership	5,326	OpenStudio	CAV
Childcare/Pre-School	2,177	OpenStudio	CAV and VAV
College	3,753	OpenStudio	CAV and VAV
Convenience Store	8,760	OpenStudio	CAV
Drug Store	6,034	OpenStudio	CAV
Elementary School	2,305	OpenStudio	VAV
Emergency Services	8,760	OpenStudio	CAV
Garage	7,357	eQuest	CAV
Grocery	7,568	OpenStudio	CAV
Healthcare Clinic	4,471	OpenStudio	VAV
High School	3,118	OpenStudio	VAV
Hospital - CAV no econ	7,166	OpenStudio	CAV
Hospital - CAV econ	7,225	OpenStudio	CAV
Hospital - VAV econ	3,757	OpenStudio	VAV
Hospital - FCU	4,727	OpenStudio	CAV
Hospital - Unknown	5,719	OpenStudio	Average of hospital models
Hotel/Motel	3,712	OpenStudio	CAV
Hotel/Motel - Common	8,678	OpenStudio	CAV
Hotel/Motel - Guest	2,112	OpenStudio	CAV
Manufacturing Facility_Miscellaneous	2,267	OpenStudio	CAV
Manufacturing Facility_Food/Chemical	4,702	OpenStudio	CAV
MF - High Rise	2,617	OpenStudio	CAV
MF - High Rise - Common	3,411	OpenStudio	CAV
MF - High Rise - Residential	2,613	OpenStudio	CAV
MF - Mid Rise	8,450	OpenStudio	CAV
Movie Theater	1,779	OpenStudio	VAV
Office - High Rise - CAV no econ	5,459	OpenStudio	CAV
Office - High Rise - CAV econ	5,430	OpenStudio	CAV
Office - High Rise - VAV econ	2,884	OpenStudio	VAV
Office - High Rise - FCU	2,130	OpenStudio	CAV
Office - Low Rise	4,721	OpenStudio	CAV
Office - Mid Rise	3,413	OpenStudio	VAV

[1297] Ibid

Building Type	Total Fan Run Hours	Model Source	Fan Type in Model
Religious Building	3,783	OpenStudio	VAV
Restaurant	8,226	OpenStudio	CAV
Retail - Department Store	5,245	OpenStudio	CAV
Retail - Strip Mall	4,189	OpenStudio	CAV
Warehouse Nonrefrigerated	3,142	OpenStudio	CAV
Warehouse Refrigerated	3,076	OpenStudio	CAV
Medical Office	3,498	OpenStudio	VAV
Unknown	3991	n/a	n/a

ρ = density of the leaked air in lb/ft^3

= 0.08 (lb/ft3) at 1 atmosphere pressure and approximately 30-40°F[1298]

c_p = specific heat in BTU/(lb °F)

= 0.24 (BTU/lb) at 1 atmosphere pressure and 32°F[1299]

$\Delta Theat$ = T_{heat} - $T_{Avg_Htg_OAT}$

= average difference between the leaked air temperature and the outside air temperature in °F for the hours in which fan and heating operates during the heating season

T_{heat} = Supply Air Temperature of the gas heating system.

= Use 120°F when cooling coil and furnace are downstream of fan. Use 75°F when cooling coil is upstream of fan and furnace. Use actual if known.

$T_{Avg_Htg_OAT}$ = Deemed average ambient air temperature over the heating season based on climate zone[1300]

Climate Zone	Heating Season Avg OA DBT
1 - Rockford	29.4 degF
2 - Chicago	34.2 degF
3 - Springfield	27.4 degF
4 - Belleville	38.4 degF
5 - Marion	31.4 degF

$\Delta Tfan$ = T_{fan} - $T_{Avg_Htg_OAT}$

[1298] Engineering ToolBox, (2003). Air - Density, Specific Weight and Thermal Expansion Coefficient at Varying Temperature and Constant Pressures. [online] Available at: https://www.engineeringtoolbox.com/air-density-specific-weight-d_600.html [Accessed April 2025].

[1299] Engineering ToolBox, (2004). Air - Specific Heat at Constant Pressure and Varying Temperature. [online] Available at: https://www.engineeringtoolbox.com/air-specific-heat-capacity-d_705.html [Accessed April 2025]

[1300] BinMaker Pro weather data, based on average outdoor air temperatures over the hottest 5 calendar months. Outdoor average temperatures are assumed to be equivalent to the average temperatures of typical duct locations in: attics, basements, crawl spaces and outdoors. Additional research is recommended to verify actual average ambient temperatures in these areas; additional inputs may be recommended to identify the actual space type of the duct and create a lookup table based on space type and climate zone.

T_{fan} = Return Air Temperature in the Air Handler. Use the indoor air temperature setpoint.

= 75°F or actual if known.

tons = Nominal rated tonnage of HVAC system. Use actual.

3,412 = conversion from Btu to kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

The annual gas heating energy saved per year is:

$$\Delta\text{Therms} = (\Delta\text{Therms}_{heating} + \Delta\text{Therms}_{fan})$$

$$\Delta Thermsheating = \frac{\dot{v} * 60 * EFLHheat * \rho * c_p * \Delta Theat * tons}{100{,}000 * \eta\text{Heat}}$$

$$\Delta Thermsfan = \frac{\dot{v} * 60 * EFLHfan * \rho * c_p * \Delta Tfan * tons}{100{,}000 * \eta\text{Heat}}$$

Where:

$\Delta\text{Therms}_{heating}$ = heating energy saved in therms during heating operation

$\Delta\text{Therms}_{fan}$ = heating energy saved in therms during ventilation operation in heating season

100,000 = conversion from Btu to therms

ηHeat = heating system efficiency

= custom, if unknown:

80% for hot water boilers[1301]

79% for steam boilers[1302]

83.2% for furnaces (including roof-top units)[1303]

Please see the previous section for a definition of parameters and guidance on default values to be used.

For example, a 30-ton RTU with the cooling coil and gas furnace downstream of the fan, rated for 3" WC external static pressure and with gas-fired heating in an elementary school in Chicago has a waterless condensate trap retrofitted in place of a p-trap:

Δtherms = ((1.1*60*1,603*0.08*0.24*(120-34.2)*30) + (1.1*60*279.5*0.08*0.24*(75-34.2)*30))/100,000*0.8

= (5,228,621.8 + 433,519.3)/(100,000 * 0.8)

= 70.8 therms

[1301] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/hr

[1302] Ibid

[1303] GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-WCNDT-V02-270101

REVIEW DEADLINE: 1/1/2028

4.4.70 Indoor Air Purification

DESCRIPTION

The Indoor Air Purification measure addresses energy savings gained shifting a building's ventilation strategy from the prescriptive Ventilation Rate Procedure (VRP) to the performance-based Indoor Air Quality Procedure (IAQP). The VRP is the prescriptive industry standard that calculates minimum outdoor air (OA) requirements based on a combination of area based OA rate (R_a) and occupancy based OA rate (R_p). R_a and R_p values for most building types are defined in Table 6-1 of ASHRAE 62.1[1304]. Application of the VRP results in a constant dilution strategy where large volumes of outdoor air are brought in regardless of actual indoor pollutant levels. In a VRP baseline, air cleaning is limited to mechanical particulate filtration with filters placed into supply air ducts.

The IAQP is implemented by installing high-efficiency gas-phase air cleaning technology within the HVAC loop to remove contaminants from recirculated indoor air. Approaches include active contaminant removal or high efficiency filtration, or a combination of methods. Compliance requires mass balance analysis of contaminants of concern and continuous monitoring to ensure contaminant levels remain within limits specified by ASHRAE 62.1 Table 6-5, Design Compounds and Concentration Limits. ASHRAE 62.1 Appendix F includes a standard IAQP calculator and several manufacturers offer specialized IAQP calculators. In many commercial buildings, implementation of the IAQP enables a substantial reduction of OA intake and associated conditioning loads, achieving energy savings. Depending on building occupancy and ventilation needs, outdoor air reductions between 25 and 60% are commonly achieved.[1305] In new building construction, use of the IAQP may enable downsizing of HVAC equipment or elimination of dedicated outdoor air systems, resulting in energy savings and lower capital investment.

Technologies that reduce indoor air contaminant levels to comply with the IAQP rely on filtration or active removal. Filtration methods range from high efficiency particulate filters (MERV 13 or HEPA) to molecular filtration, including adsorption filters using activated charcoal or specialized chemical media to neutralize contaminants. Active removal technologies include photocatalytic oxidation, bipolar ionization, UV-C irradiation, and electrostatic precipitation. These systems may be located in supply or return ducts, or inside air handling units, depending on the technology employed. This allows the continuous removal of contaminants from internal air, maintaining pollutant concentrations below the limits defined in ASHRAE 62.1 Table 6-5.[1306] Continuous monitoring of contaminant levels verifies compliance. The technology employed is dependent on facility type and occupancy, as well as building internal and external contaminant loads. Most installed systems will rely on a combination of filtration and supplemental active removal technologies depending on building needs.

This measure was developed to be applicable to the following program types: RF, NC. If applied to other program types, the measure savings should be verified.

This measure may not be used in conjunction with measure 4.4.45, Adsorbent Air Cleaning.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a building that uses the ASHRAE 62.1 Indoor Air Quality Procedure (IAQP) to calculate the minimum outdoor air (OA) intake based on actual contaminant limits.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a building that is in compliance with the ASHRAE 62.1 Ventilation Rate Procedure (VRP).

[1304] ANSI/ASHRAE. 2025. ANSI/ASHRAE Standard 62.1-2025, Ventilation and Acceptable Indoor Air Quality. Atlanta: ASHRAE, Table 6-1

[1305] GPS Air, How SmartIAQ Achieves IAQP Compliance, Technical White Paper GPS-043-18-R21-WP, 2025: GPS AIr

[1306] ANSI/ASHRAE. 2025. *ANSI/ASHRAE Standard 62.1-2025, Ventilation and Acceptable Indoor Air Quality*. Atlanta: ASHRAE, Table 6-5

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for HVAC applications is 20 years.[1307]

DEEMED MEASURE COST

The cost for this measure is dependent on the methods and technologies employed to implement the IAQP. Due to this variability, actual installation costs should be used if available. If unknown, assume $2.20/sqft for measure installation.[1308]

LOADSHAPE

Loadshape C01 – Commercial Electric Cooling
Loadshape C03 – Commercial Cooling
Loadshape C04 – Commercial Electric Heating
Loadshape C05 – Commercial Electric Heating and Cooling
Loadshape C23 – Commercial Ventilation

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the average savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)
= 91.3%[1309]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)
= 47.8%[1310]

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings for this measure are calculated using standard engineering algorithms for conditioning of outside air. The basis for the energy savings calculation is the calculated reduction in outdoor air flow rate due to implementation of the IAQP. Energy use of indoor air purification systems is subtracted from heating and cooling savings to calculate net energy savings.

ELECTRIC ENERGY SAVINGS

ΔkWh $= \Delta kWh_cool + \Delta kWh_heatElectric + \Delta kWh_fan - kWh_IAP$

[1307] Expected lifetime based on median equipment age of air distribution equipment for the Midwest Region. ASHRAE Equipment Life Expectancy Chart, https://weblegacy.ashrae.org/publicdatabase/system_service_life.asp?c_region=4&state=NA&building_function=NA&c_size=0&c_age=0&c_height=0&c_class=0&c_location=0&selected_system_type=1&c_equipment_type=NA

[1308] Estimated costs represent an average of tiered IAQ approaches. B2 Air Systems, https://b2airsystems.com/what-are-the-most-effective-indoor-air-quality-solutions-for-large-facilities/

[1309] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1310] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Where

ΔkWh_cool = Reduction in annual cooling requirement due to outside air reduction

$= 1.08 * V_{OA} * EFLH_{cool} * \Delta T_{FL,cool} / 1000 / \eta Cool * \%Cool$

ΔkWh_heatElectric = Reduction in annual heating requirement due to outside air reduction

$= 1.08 * V_{OA} * EFLH_{heat} * \Delta T_{FL,heating} / \eta Heat / 3{,}412 * \%ElectricHeat$

ΔkWh_fan = If gas heat, kWh savings for reduction in furnace fan run time

$= \Delta Therms * Fe * 29.3$

Where:

1.08 = Specific heat of air x density of inlet air @ 70F x 60 min/hr in BTU/hr-F-CFM

V_{OA} = reduced outdoor air flow in CFM, calculated as differential between existing and efficient outdoor ventilation rates:

$= OA_{VRP} - OA_{IAQP}$

Where:

OA_{VRP} = calculated ventilation rate based on the VRP

OA_{IAQP} = calculated ventilation rate based on the IAQP

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in existing buildings or new construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,cool}$ = Temperature difference [°F] during cooling season between design day outdoor air temperature (TDD) and assumed 55°F base temperature[1311]

Climate Zone (City based upon)	$T_{DD,cool}$ [°F]	$\Delta T_{FL,cool}$ [°F]
1 (Rockford)	90.9	35.9
2 (Chicago)	91.3	36.3
3 (Springfield)	92.6	37.6
4 (Belleville)	95.2	40.2
5 (Marion)	94.4	39.4

1000 = Conversion of watts to kW

ηCool = Efficiency of cooling equipment * distribution efficiency. Actual, if possible and assume 95% distribution efficiency for central cooling with ducts. If unknown, assume:

System Type	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling	10.2	11.1

%Cool = Percentage of the building that is cooled

$EFLH_{heat}$ = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

[1311] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

$\Delta T_{FL,heat}$ = Temperature difference [°F] during heating season between design day outdoor air temperature and assumed 55°F heating base temperature[1312]

Climate Zone (City based upon)	$T_{DD,heat}$ [°F]	$\Delta T_{FL,heat}$ [°F]
1 (Rockford)	-5.4	60.4
2 (Chicago)	-1.0	56.0
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

ηHeat = Efficiency of heating equipment * distribution efficiency. Actual, if possible and assume 95% distribution efficiency. If unknown, assume: [1313]

System Type	HSPF2 Estimate	ηHeat (HSPF2/3.413)*0.95
Heat Pump	7.37	2.05
Electric Resistance	N/A	1

3,412 = Number of BTUs per kWh

%ElectricHeat = % of building heated by electricity

Fe = Furnace Fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1314]

29.3 = kWh per therm (= 100,000 BTU/Therm / 3,412 BTU/kWh)

kWh_IAP = Annual electric energy use of the installed indoor air purification system. Use actual, if available. If unknown, the table below provides deemed usage for common air purification technologies:

Purification Technology	Annual Energy Use kWh per device
UV-C / Photocatalytic Oxidation	1,050[1315]
Bipolar ionization	175[1316]
Electrostatic precipation	2,600[1317]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = ((\Delta kWh_cool / EFLH_{cool}) - (kWh_IAP / 8{,}760)) * CF$$

Where:

[1312] Weather Station Data, 96.6% Heating DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

[1313] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95 and multiplied by 0.95 distribution efficiency to estimate duct losses.

[1314] Fe is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[1315] Based on a 120W power draw of a typical UV-C lamp and a runtime of 8760 hours/year

[1316] Based on a 15W power draw for a typical ion bar and a runtime of 8760 hours/year

[1317] Based on a 300W power draw for a typcal commercial ESP system and a runtime of 8760 hours/year

ΔkWh_cool = Cooling kWh savings as calculated above

$EFLH_{cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

kWh_IAP = Annual electric energy use of the installed indoor air purification system

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%

FOSSIL FUEL SAVINGS

ΔTherms = $1.08 * V_{OA} * EFLH_{heat} * \Delta T_{FL,heating}$ / ηHeat / 100,000 * %FossilHeat

Where:

ηHeat = Actual, if unknown assume 0.821[1318]

100,000 = BTUs per therm

%FossilHeat = % of building heated by fossil fuel

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Indoor air purification systems require continuing maintenance to operate, including filter or adsorption cartridge changeouts, replacement of UV-C lamps or cleaning of electrostatic plates. Maintenance cost varies by technology and actual costs should be used. If unknown, assume annual cost of $350 per air handling unit.[1319]

MEASURE CODE: CI-HVC-INAP-V01-270101

REVIEW DEADLINE: 1/1/2030

[1318] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1319] This figure represents the midpoint of the 2024-25 national average for basic air handler maintenance. https://oxmaint.com/industries/hvac/hvac-maintenance-plan-pricing-calculator

4.4.71 Electric Chiller Tune-up

DESCRIPTION

This measure is the tune-up of an existing electric water-based chiller system to return the system to its optimal performance. Chillers and their accompanying systems (pumps, towers, etc.) can decrease in performance over time as components deteriorate or fall out of optimal conditions. A tune-up should bring a chiller system back to as close to optimal performance as possible, as well as extend the life of the equipment, saving energy. This measure applies to water-cooled and air-cooled chillers. This measure is only applicable to chillers that provide cooling only; heat pump or reversible chillers that provide heating in addition to cooling are not eligible. The tune-up should include all of the following requirements[1320]:

- Clean condenser coil/tubes
- Check cooling tower for scale or buildup and address if found (only for water-cooled chillers)
- Check contactors condition
- Check evaporator condition
- Check low-pressure controls
- Check high-pressure controls
- Check filter, replace as needed
- Check belt, replace as needed
- Check crankcase heater operation
- Check economizer operation

This measure was developed to be applicable to the following program types: RF

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be an existing chiller system after receiving a tune-up to return the system as close to optimal performance as possible and extend the equipment lifetime.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an existing chiller system that has not received a tune-up in at least 36 months and has no ongoing maintenance contract.

If the implementing program is prescriptive and dependent upon baseline assumptions for efficient processing, then the baseline should assume that the chiller was installed no less than 3 years (36 months) prior to tune-up and therefore meets the IECC 2021 chiller efficiency standards. Therefore, the baseline efficiency is the 2021 IECC minimum efficiencies (Table 1).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 3 years[1321].

[1320] NEW ORLEANS TECHNICAL REFERENCE MANUAL VERSION 9.0, 2.3.4 CHILLER TUNE-UP, November 10th, 2025
[1321] Three years is given for “Clean Condenser Coils – Commercial” and “Clean Evaporator Coils”. DEER2014 EUL Table.

DEEMED MEASURE COST

Actual tune-up costs should be used when possible. The cost of this procedure varies depending on service required and implementor. If not available, the incremental cost of $50/ton[1322] can be used.

LOADSHAPE

Loadshape C03 – Commercial Cooling

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CFssp = Summer Peak Coincidence Factor for Commercial cooling (during system peak hour)
= 91.3%[1323]

CFpjm = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)
= 47.8%[1324]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = tons * IPLV_{BASE} * EFLH_{COOLING} * ESF$$

Where:

tons = Existing chiller capacity, tons

= Actual

IPLVbase = Integrated part load value of baseline chiller in kW/ton

= Actual, if actual is not possible, then:

= IECC 2021 baseline (Table 1) using Path B*

[1322] Act on Energy Commercial Technical Reference Manual No. 2010-4. Original cost specified was $35 in 2010, which has been converted to 2023 dollars using the US Bureau of Labor Statistics CPI Inflation Calculator https://www.bls.gov/data/inflation_calculator.htm. Inflation conversion could not be re-calculated for 2025 according to BLS website.

[1323] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1324] Lbid, The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

EFLHcooling = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

ESF = Energy Savings Factor

= 0.05[1325]

* Path B used to calculate more conservative savings and assume that the chiller being serviced was efficient enough using the less rigorous Path for IPLV.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = tons * FLVbase * CF * DSF$$

Where:

FLVbase = Full load value of baseline chiller in kW/ton

= Actual, if actual is not possible, then:

= IECC 2021 baseline (Table 1) using Path A*

CFssp = Summer Peak Coincidence Factor for Commercial cooling (during system peak hour)
= 91.3%[1326]

CFpjm = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)
= 47.8%[1327]

DSF = Demand Savings Factor

= 0.025[1328]

** Path A used to calculate more conservative savings and assume that the chiller being serviced was efficient enough using the less rigorous Path for FLV.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

[1325] United States Department of Energy, Building Technologies Program: Hospitals Benefit by Improving Inefficient Chiller systems white paper, August 2011. The paper found that coil cleaning, the primary savings measure associated with this cooling tune-up measure, reduces annual cooling energy consumption by 5-7%. Demand savings are conservatively assumed to be on half this, or 2.5%.
[1326] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1327] Lbid, The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year
[1328] Lbid

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-ECTU-V01-270101

REVIEW DEADLINE: 1/1/2030

4.4.72 ENERGY STAR Ceiling Fan

DESCRIPTION

A ceiling fan unit meeting the efficiency specifications of ENERGY STAR[1329] version 4.1 is installed in place of a model meeting the federal standard. ENERGY STAR qualified ceiling fan units are over 60% more efficient than conventional fan units and use improved motors and blade designs.

Due to the EISA backstop, no lighting savings should be claimed for this measure as there is no non-LED baseline to contrast for savings. However, usage patterns may differ for fans with and without a light kit. Therefore, loadshapes and coincidence factors for lighting by building type are included in this measure.

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as an ENERGY STAR certified ceiling fan, with or without a light kit.[1330] Concurrently, ENERGY STAR criteria require ceiling fans with light kits to provide the consumer with LEDs. In the cases where light kits require screw-base sockets, the efficient lamps have to be included in the packaging of the ceiling fan.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a standard fan. The presence of a light kit on the baseline fan should align with that of the efficient equipment.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The fan savings measure life is assumed to be 10 years.[1331]

DEEMED MEASURE COST

Incremental cost of a ceiling fan with light kit is $46.

Incremental cost of only a ceiling fan is $30.71. [1332]

LOADSHAPE

Loadshape C06 – Commercial Indoor Lighting
Loadshape C07 – Grocery/Conv. Store Indoor Lighting
Loadshape C06 – Office Indoor Lighting
Loadshape C06 – Restaurant Indoor Lighting
Loadshape C06 – Retail Indoor Lighting
Loadshape C06 – Warehouse Indoor Lighting
Loadshape C06 – K-12 School Indoor Lighting
Loadshape C23 – Commercial Ventilation

[1329] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[1330] ENERGY STAR version 4.1, Product Specification for Residential Ceiling Fans and Ceiling Fan Light Kits, effective August 1, 2023.
[1331] Lifetime estimate is sourced from the ENERGY STAR Ceiling Fan Savings Calculator.
[1332] The incremental cost of $46 is sourced from the ENERGY STAR Ceiling Fan Savings Calculator, which is based on a ceiling fan and a light kit. In order to determine the incremental cost of only a ceiling fan, the incremental cost of the lights were factored in and removed accordingly. Through review of the ENERGY STAR Qualified Products List, accessed on October 11, 2018, the average ceiling fan LED light kit had 1.2 lamps, with an average wattage of 11.8W. The comparable baseline wattage, baseline cost, and efficient lamp cost is based on a scaled equivalence from the 5.5.9 LED Fixtures measure.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1333]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1334]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = FanHours * [((\%Low_{base} * WattsLow_{base}) + (\%Med_{base} * WattsMed_{base}) + (\%High_{base} * WattsHigh_{base}))/1000 - ((\%Low_{ES} * WattsLow_{ES}) + (\%Med_{ES} * WattsMed_{ES}) + (\%High_{ES} * WattsHigh_{ES}))/1000]$$

Where:[1335]

FanHours = Annual Fan "On Hours"

= Actual. If unknown, use Lighting Hours by building type in the Lighting End Use Reference Table in Section 4.5.

$\%Low_{base}$ = Percent of time spent at Low speed of baseline

= 40%

$WattsLow_{base}$ = Fan wattage at Low speed of baseline

= Actual. If unknown use 15 watts

$\%Med_{base}$ = Percent of time spent at Medium speed of baseline

= 40%

$WattsMed_{base}$ = Fan wattage at Medium speed of baseline

= Actual. If unknown use 34 watts

$\%High_{base}$ = Percent of time spent at High speed of baseline

[1333] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1334] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

[1335] All fan operating conditions and baseline default assumptions are based upon assumptions provided in the ENERGY STAR Ceiling Fan Savings Calculator. The efficient wattages at the low and high speed settings are sourced from the average of available products on the ENERGY STAR Qualified Products List (QPL), as pulled on 5/9/2025. The efficient wattage at the medium speed is interpolated based on the varying speed wattages from the ENERGY STAR version 4.0 specifications. For more information on the QPL data set, please see "Illinois Residential Ceiling Fan Analysis_2025.xlsx".

= 20%

$WattsHigh_{base}$ = Fan wattage at High speed of baseline

= Actual. If unknown use 67 watts

%LowES = Percent of time spent at Low speed of ENERGY STAR

= 40%

$WattsLow_{ES}$ = Fan wattage at Low speed of ENERGY STAR

= Actual. If unknown use 5 watts

$\%Med_{ES}$ = Percent of time spent at Medium speed of ENERGY STAR

= 40%

$WattsMed_{ES}$ = Fan wattage at Medium speed of ENERGY STAR

= Actual. If unknown use 16 watts

$\%High_{ES}$ = Percent of time spent at High speed of ENERGY STAR

= 20%

$WattsHigh_{ES}$ = Fan wattage at High speed of ENERGY STAR

= Actual. If unknown use 36 watts

For ease of reference, the fan assumptions are provided below in table form:

	Low Speed	Medium Speed	High Speed
Percent of Time at Given Speed	40%	40%	20%
Conventional Unit Wattage	15	34	67
ENERGY STAR Unit Wattage	5	16	36
ΔW	10	18	31

For example, an ENERGY STAR ceiling fan with a light kit was purchased and installed in a department store. The savings are:

ΔkWh = 4099 * [((0.4*15)+(0.4*34)+(0.2*67)) – ((0.4*5)+(0.4*16)+(0.2*36))] / 1000

= 71.32 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$\Delta kW = ((WattsHigh_{base} - WattsHigh_{ES})/1000) * CF$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1336]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

[1336] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

= 47.8%[1337]

For example, an ENERGY STAR ceiling fan with a light kit was purchased and installed in a department store. The savings are:

ΔkW = ((67-36)/1000) * 0.913
= 0.0283 kW

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION
N/A

MEASURE CODE: CI-HVC-ESCF-V01-270101

REVIEW DEADLINE: 1/1/2030

[1337] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

4.4.73 Pressure Independent VAV Controller for Fume Hood Fan Systems

DESCRIPTION

The measure focuses on retrofitting pressure-independent control valves and a variable-air-volume control system for laboratory fume hoods.

Exhaust fume hoods protect operators from inhaling harmful fumes by capturing, containing, and exhausting hazardous air contaminants, including gases and vapors, generated in laboratory experiments or processes. Fume hoods, often mounted at tabletop level, offer users protection with a movable, window-like front "face" called a sash. Laboratory fume hoods require a recommended face velocity of 100 fpm to effectively remove contaminants from the space.

However, most fume hood exhaust systems operate at high airflow 24 hours a day, regardless of actual fume hood usage. Fume hoods exhaust large volumes of air at great energy expense. The energy to filter, transport, cool, heat or reheat, and in some cases scrub (clean) this air is one of the largest energy loads in most laboratory facilities. Since many laboratories have multiple hoods, they often dictate a lab's required airflow and, in turn, the capacity of the supply and exhaust systems. The result is larger fans, chillers, boilers, and ducts than in systems with less exhaust. Consequently, fume hoods are a major factor in making a typical laboratory four to five times more energy-intensive than a typical commercial building space. In addition to increased energy usage, constant airflow rates at the minimum open sash position during reduced usage can induce errant eddy currents and airflow vortices, reducing exhaust effectiveness.

This measure focuses on optimization of a laboratory fume hood airflow control, and it involves a VAV control system with variable speed fan systems and pressure independent fast responsive airflow control valves which modulates fume hood exhaust airflow rates to maintain a desired face velocity across the face of the fume hood, along with general exhaust and supply airflow rates to maintain space comfort and pressurization needs. When the sash is closed and the fume hood is not used, the control system minimizes or fully shuts off the fume hood exhaust valve based on space requirements

This measure was developed to be applicable to the following program types: Retrofit (RF)

The measure involves retrofitting of pressure-independent airflow control valves and VAV controls to existing laboratory fume hood supply and exhaust fan systems. The measure saves energy through the following pathways:

- Fan energy savings due to reduced airflow exhausted through the fume hood
- Heating and cooling energy savings due to a reduction in the amount of conditioned makeup air needed.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment includes 100% outdoor-air variable air volume HVAC supply and exhaust fan systems serving the laboratory space(s), with airflow control valves that modulate airflow rates based on fume hood usage to maintain the desired face velocity across the hoods. All fume hoods that are part of the exhaust fan system shall be retrofitted with VAV controls to be eligible for this measure. All laboratory airflow control devices shall be pressure-independent and shall meet the safety performance and response time requirements of the ANSI/ASSP Z9.5[1338] standard and/or applicable local codes to be eligible for this measure.

VAV fan control system retrofit shall include

- Exhaust air control valve(s) for the fume hood and
- General exhaust air control valve(s) if applicable
- Supply air control valve(s)
- Variable speed control for the supply fan
- Variable speed control for the exhaust fan and
- Controls and accessories to modulate fan speeds based on space level airflow reductions.

[1338] https://blog.ansi.org/ansi/ansi-assp-z9-5-2022-laboratory-ventilation/, accessed April 17, 2026

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment includes 100% outdoor-air, constant-volume HVAC supply and exhaust fan systems serving the laboratory space(s), with no airflow control valves to maintain fume hood face velocities based on usage.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected life of the measure is assumed to be 15 years[1339].

DEEMED MEASURE COST

The measure costs shall include the cost of VAV control devices for lab spaces and variable-speed controls for the supply and exhaust fans. Actual implementation costs shall be used if actual costs are unknown use $8,750 per 1,000 CFM of fan-rated airflow[1340]

LOADSHAPE

Loadshape C03 - Commercial Cooling

COINCIDENCE FACTOR

The summer peak coincidence factors for cooling are provided below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, while the second represents the average savings over the defined summer peak period and is presented to allow savings to be bid into PJM's capacity market.

CFSSP = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1341]

CFPJM = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1342]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \Delta kWh_{Fan} + \Delta kWh_{Cooling} + \Delta kWh_{Heating}$$

Where:

ΔkWH = The total electrical energy savings

ΔkWh_{Fan} = Total fan energy savings from the exhaust fan

$= HP_{Fan} * (LF/ \eta_{motor}) * 0.746 * (1- (AR_{Fan})^{2.7}) * Hours$

LF /ηmotor = Ratio of load factor of the fan motor to motor efficiency[1343]

[1339] ASHRAE equipment life expectancy chart lists a 20-year life of VAV control boxes. Microsoft Word - ASHRAE chart for website 1.doc.
Illinois TRM measure 4.4.26 lists a 15-year life of variable speed drives. Since this measure focuses on retrofit of both VAV controls and variable speed drives, a 15-year life is assumed for program usage.

[1340] EIA 2022 total installed costs for on VAV fan controls, VAV air terminal units, with associated accessories ($7,668 in 2022 dollars ~ adjusted for inflation for 2026). Updated Buildings Sector Appliance and Equipment Costs and Efficiencies

[1341] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1342] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1343] "Measured Loading of Energy Efficient Motors - the Missing Link in Engineering Estimates of Savings," ACEEE 1994 Summer Study Conference, Asilomar, CA.

= 0.65[1344]

HP_{Fan} = Actual Rated Nameplate horsepower (hp) of the exhaust fan serving the laboratories with fume hoods retrofitted with VAV controls

0.746 = conversion factor from hp to kWh.

AR_{Fan} = Exhaust fan airflow reduction ratio (New average airflow rate/ Baseline average airflow rate), %

= 0.69[1345]

Hours = Actual annual operating exhaust fan operating hours

= If unknown, use values from table below.

Building Type	Total Fan Run Hours[1346]
Drug Store	6,034
College	3,753
Emergency Services	8,760
Healthcare Clinic	4,471
Hospital	5,719
Manufacturing Facility_Miscellaneous	2,267
Manufacturing Facility_Food/Chemical	4,702
Warehouse Nonrefrigerated	3,142
Unknown	4,856

For example, a college in Chicago has 5 HP fans that use 100% outdoor air to serve laboratory fume hoods. They are retrofitted with variable speed controls and a pressure independent air flow control device. The cooling and gas heating efficiencies are 14.0 EER and 80% respectively:

$\Delta kWh_{Fan} = HP_{Fan} * (LF/ \eta_{motor}) * 0.746 * (1- (AR_{Fan})^3) * Hours$

= 5 * (0.65) * 0.746 * (1-(0.69)^3) * 3765

= 6,129.5 kWh

$\Delta kWh_{Cooling}$ = Total cooling energy savings due to reduced make-up air during summer. Cooling s avings shall apply only to 100% outside-air HVAC units serving laboratory spaces r etrofitted with pressure-independent VAV controls.

= ρ * Cp * CFM * (1-Fan AR) * 60 * 24 * CDD * (1/EER) * (1/1000)

ρ = Density of ai

= 0.075 lb/ft^3

Cp = Specific heat of air

=0.24 Btu/lb °F

[1344] Illinois Statewide Technical Reference Manual — 4.9.1 Pump Optimization

[1345] Nicor Gas ETP pilot project. Average airflow rate reduction recorded based on installation of pressure independent VAV controls in a laboratory space. Airflow reduction was established based on normalized chemical fume hood usage patterns.

[1346] Total HVAC fan hours for building types where fume hoods are typically used are referenced in this measure. Unknown is straight average of the building types above.

CFM = Actual Rated CFM of the supply fan serving the lab spaces, cfm.

= HP_{Fan}/ 0.0011 cfm[1347], if unknown

60 = Conversion factor from minutes to hour

Hours = Actual annual fan operating hours

CDD55 = Cooling degree days based on assumed 55 F base temperature, use values below:

Weather Station/ Climate Zone	CDD55
CZ1 Rockford	2,284
CZ2 Chicago	2,494
CZ3 Springfield	2,761
CZ4 Belleville	3,480
CZ5 Marion	3,186

EER = Efficiency of the cooling system in Btu/Wh. If unknown, use values from table below. Existing efficiencies in EER, IEER or SEER2 shall be used based on equipment type and capacity range as specified in the IECC.

Electric Equipment Type - Older Equipment	Size Category	Efficiency[1348]
Air Conditioners – Air Cooled, Split System	< 65,000 Btu/h	13.0 SEER
Air Conditioners – Air Cooled, Single Packaged	< 65,000 Btu/h	14.0 SEER
Air Conditioners – Air Cooled	≥ 65,000 Btu/h and < 135,000 Btu/h	11.0 EER
	≥ 135,000 Btu/h and < 240,000 Btu/h	10.8 EER
	≥ 240,000 Btu/h and < 760,000 Btu/h	9.8 EER
	≥ 760,000 Btu/h	9.5 EER
Air Conditioners – Water Cooled	< 65,000 Btu/h	12.1 EER
	≥ 65,000 Btu/h and < 135,000 Btu/h	11.9 EER
	≥ 135,000 Btu/h and < 240,000 Btu/h	12.3 EER
	≥ 240,000 Btu/h and < 760,000 Btu/h	12.2 EER
	≥ 760,000 Btu/h	12.0 EER
Air Cooled Heat Pumps, Cooling Mode	< 66,000 Btu/h	14.0 SEER
	≥ 65,000 Btu/h and < 135,000 Btu/h	10.8 EER
	≥ 135,000 Btu/h and < 240,000 Btu/h	10.4 EER

[1347] 2021 Internation Energy Conservation Code IECC, table C403.8.1(1) mandates constant volume fans nameplate HPs to be less than or equal to CFM x 0.0011 CHAPTER 4 CE COMMERCIAL ENERGY EFFICIENCY - 2021 INTERNATIONAL ENERGY CONSERVATION CODE (IECC)

[1348] Cooling equipment efficiencies were based on minimum required efficiencies for systems before 1/1/2023 per 2021 International Energy Conservation Code, section C403.3 heating and cooling equipment efficiencies.
Heating equipment efficiencies were based on minimum HSPFs or minimum COPs times 3.412, for electric heating systems before 1/1/2023 per 2021 International Energy Conservation Code, section C403.3 heating and cooling equipment efficiencies.

Electric Equipment Type - Older Equipment	Size Category	Efficiency[1348]
	≥ 240,000 Btu/h	9.3 EER
Air Cooled Heat Pumps, Heating Mode – Split System	< 65,000 Btu/h	8.2 HSPF
Air Cooled Heat Pumps, Heating Mode – Single Packaged Units	< 65,000 Btu/h	8.0 HSPF
Air Cooled Heat Pumps, Heating Mode	≥ 65,000 Btu/h and < 135,000 Btu/h	11.3 HSPF
	≥ 135,000 Btu/h and < 240,000 Btu/h	10.9 HSPF
	≥ 240,000 Btu/h	10.9 HSPF

For example, a college in Chicago has 5 HP fans that use 100% outdoor air to serve laboratory fume hoods. They are retrofitted with variable speed controls and a pressure independent air flow control device. The cooling and gas heating efficiencies are 14.0 EER and 80% respectively:

$\Delta kWh_{Cooling}$ = ρ * Cp * CFM * (1-Fan AR) * 60 x 24 * CDD * (1/EER) * (1/1000)

= 0.075 * 0.24 * (5/0.0011) * (1-0.69) * 60 * 24 * 2494 * (1/14) * (1/1000)

= 6,506.4 kWh

$\Delta kWh_{Heating}$ = Total heating energy savings due to reduced make-up air during winter, applicable only for electric heating, Heating electric savings shall be applicable only for 100% outside air HVAC units serving the laboratory spaces retrofitted with pressure independent VAV-controls.

= ρ * Cp * CFM * (1 - AR_{Fan}) * 60 * 24 * HDD * (1/HSPF) * (1/1000)

HDD55 = Heating degree days based on assumed 55 F base temperature, use values below.

Weather Station/ Climate Zone	HDD55
CZ1 Rockford	4,171
CZ2 Chicago	3,760
CZ3 Springfield	3,296
CZ4 Belleville	2,351
CZ5 Marion	2,499

HSPF = Heating Seasonal Performance Factor in Btu/Wh

= If unknown, please refer to the electric equipment efficiency table based on applicable baseline equipment.

For example, a college in Chicago has 5 HP fans that use 100% outdoor air to serve laboratory fume hoods. They are retrofitted with variable speed controls and a pressure independent air flow control device. The cooling and gas heating efficiencies are 14.0 EER and 80% respectively:

$\Delta kWh_{Heating}$ ρ * Cp * CFM * (1 - AR_{Fan}) * 60 * 24 * HDD * (1/HSPF) * (1/1000)

= 0.075 * 0.24 * (5/0.0011) * (1-0.69) * 60 * 24 * 3760 * (1/0.8) * (1/1000)

= kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = ((\Delta kWh_{Cooling} + \Delta kWh_{Fan}) / EFLH_{Cooling}) * CF$$

Where:

$EFLH_{Cooling}$ = Equivalent Full Load Hours. For cooling values in Existing Buildings, see Section 4.4 HVAC End Use.

For example, a college in Chicago has 5 HP fans that use 100% outdoor air to serve laboratory fume hoods. They are retrofitted with variable speed controls and a pressure independent air flow control device. The cooling and gas heating efficiencies are 14.0 EER and 80% respectively:

$\Delta kW = ((\Delta kWh_{Fan} + \Delta kWh_{Cooling}) / EFLH_{Cooling}) * CF$

= ((6,129.5 + 6,506.4) / 564) * 0.913

= 20.5 kW

FOSSIL FUEL SAVINGS

$$\Delta Therms_{Heating} = \rho * Cp * CFM * (1\text{-Fan AR}) * 60 * 24 * HDD * (1/ \eta_{heat}) * (1/100{,}000)$$

Where:

η_{heat} = Actual rated efficiency of the baseline equipment

= If unknown,[1349] use 0.80 (for units dated from January 1, 1994 but before January 1, 2023) or 0.81 (for units dated after January 1, 2023)

Other values as previously outlined above.

For example, a college in Chicago has 5 HP fans that use 100% outdoor air to serve laboratory fume hoods. They are retrofitted with variable speed controls and a pressure independent air flow control device. The cooling and gas heating efficiencies are 14.0 EER and 80% respectively:

$\Delta Therms_{Heating} = \rho * Cp * CFM * (1\text{-Fan AR}) * 60 * 24 * HDD * (1/ \eta_{heat}) * (1/100{,}000)$

= 0.075 * 0.24 * (5/0.0011) * (1-0.69) * 60 * 24 * 3760 * (1/0.8) * (1/100000

= 1,716.6 Therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-PIVC-V01-270101

REVIEW DEADLINE: 1/1/2030

[1349] Code for federal regulations, title 10, chapter II, subchapter D, part 431 stipulates 80% minimum efficiency for commercial warm air furnaces manufactured on or after January 1, 1994 till January 1, 2023 and 81% minimum efficiency for heating equipment dated from January 1st 2023. eCFR :: 10 CFR Part 431 -- Energy Efficiency Program for Certain Commercial and Industrial Equipment

4.4.74 Building Automation System for Public Schools

DESCRIPTION

This measure applies to public school facilities where unit ventilators, air handling units (AHUs), and boilers are either manually controlled by building engineers or where existing pneumatic controls have deteriorated to the point of requiring manual operation. Under this measure, these HVAC components are integrated into a Building Automation System (BAS), which provides centralized monitoring and control of heating equipment. A BAS enables facility staff to remotely adjust temperature setpoints, program occupancy-based schedules to reduce energy consumption during unoccupied periods, and log system performance data in real time.

This measure is applicable only to public school facilities and is limited to HVAC equipment serving classrooms and other conditions spaces such as hallways and common areas. Eligible equipment and system configurations include unit ventilators located in classrooms, air handling units without variable speed drives in a tunnel system, hot/deck cold deck or standard configuration, and boilers. This measure is not applicable to other HVAC configurations such as rooftop units or radiators, which must be taken custom.

Energy savings are provided in two forms depending on the equipment integrated into the BAS:

1. Boiler Integration with Heating Lockout. When a boiler is connected to the BAS, a heating lockout control strategy is implemented. Heating lockout prevents the boiler from operating when outdoor air temperatures rise above a defined threshold. A table is provided for reference. Eliminates unnecessary heating during mild weather conditions when heating is not required to maintain comfort. This is slightly different than measure 4.4.4 Boiler Lockout/Reset Controls because it amplifies the eligibility to steam boilers but does not require hot water boilers to reset boiler supply water temperature with outdoor air temperature.

2. AHU and Unit Ventilator Integration. When air handling units or unit ventilators are connected to the BAS, savings are achieved through three ways:

    a. Overheating reduction. The BAS automatically modulates heating valves, dampers, and other terminal controls to maintain space temperatures at the design setpoint. This eliminates the overheating that commonly occurs under manual operation.

    b. Equipment scheduling. The BAS implemented programmed schedules that automatically start and stop HVAC equipment based on occupancy. Ensure equipment operates only when needed and eliminates the energy waste during unoccupied periods.

This measure characterizes natural gas savings only; electric savings associated with BAS integration are not quantified under this measure

This measure was developed to be applicable to the following program types: TOS, RF. I applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition for this measure is a public-school facility equipped with a Building Automation System (BAS) that provides centralized monitoring and control of HVAC equipment throughout the building. The BAS enables facility staff and energy managers to remotely monitor and adjust temperature set points, program occupancy-based schedules to reduce heating and cooling during unoccupied periods, and log system performance data in real time. Under this measure, the BAS may be connected and capable of controlling the boiler and HVAC units serving classrooms and hallways.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is a public-school facility that does not have a Building Automation System (BAS) in place. In the absence of such a system, heating and cooling operations are managed by building engineers, who adjust valve position, dampers, and other mechanical controls based on observed conditions rather than automated feedback. Room temperatures may be regulated locally by thermostats, but setpoints cannot be monitored or overridden centrally, and no scheduling capability exists to reduce heating or cooling during unoccupied periods.

This baseline condition also encompasses facilities where pneumatic controls are present but have deteriorated to the point of unreliable operation, effectively resulting in manual control to the system. The HVAC configurations analyzed under this baseline and included in this measure characterization are tunnel systems, unit ventilators, hot deck/cold deck systems, and conventional air handling units (AHUs). Under this measure, only HVAC units serving classrooms and hallways are included.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 16 years. [1350]

DEEMED MEASURE COST

The measure cost represents the incremental cost of implementing the BAS Programming associated with this measure. This includes labor and programming costs required to configure the heating lockout sequences, occupancy schedules, outdoor air control strategies and setpoint management for the integrated HVAC equipment. The cost of the BAS hardware infrastructure, if not already in place, is excluded from this measure as the programming is what's associated with the energy savings. The cost of programming a heating lockout is $1,457. The cost of programming the schedules into the BAS is $4,264 per school.

LOADSHAPE

Loadshape C06 – K-12 School Indoor Lighting

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

FOSSIL FUEL SAVINGS

Boiler Control

The savings are implementing a heating lockout.

$$\Delta \text{ Therms} = \text{kBtu} * \text{SF} * \text{Hours} / 100$$

Where:

KBtu = Boiler gas input size (KBtu/hr)

SF = 4%[1351]

Hours =

[1350] This is intentionally longer than the assumptions found in the early replacement commercial HVAC measures as the application of boiler reset controls will occur in a variety of sites that may not be targeted for early replacement HVAC systems. Mirrors the measure life estimate from 4.4.4 Boiler Lockout/Reset Controls

[1351] The default valve for boiler jacket loss in the ASHRAE 103 Standards is 1%. Typically, boilers range from 1% to as high as 5% with older, poorly insulated boilers. In addition, pre- and post- purge losses at 3% are considered: Minimize Boiler Short Cycling Losses, Energy Tips: STEAM, Steam Tip Sheet #16 (Fact Sheet), Advanced Manufacturing Office (AMO), Energy Efficiency and Renewable Energy (EERE). Open stack draft losses are an additional continuous loss.

Temperature	Hours[1352]
70	157
65	298
60	533
55	750
50	1009

Example: A 1,500 kBtu/hr boiler in a public school with manual control gets integrated into a Building Automation System and a Heating Lockout of 60F is implemented:

$$\Delta \text{ Therms} = \text{kBtu} * \text{SF} * \frac{\text{Hours}}{100} = 1500 * 0.04 * \frac{533}{100} = 319 \text{ therms}$$

HVAC Controls

$$\Delta \text{ Therms} = \frac{\text{Qaverage} * \text{CFM} * \left[\text{Hours}_{\text{existing}} - \text{Hours}_{\text{proposed}} + \text{Hours}_{\text{existing}} * \text{Overheating\%}\right]}{1000 * \text{Boiler Efficiency}}$$

Where:

Qaverage[1353] = 0.277CFM/therm/hr for Air Handling Units

= 0.22 for Unit ventilators

CFM = Supply Fan CFM of air handler unit or unit ventilator = If known, If unknown

= 0.001 * Supply Fan HP[1354],

= 1000 CFM if unit ventilator

Overheating% = 7.47% for Air Handling Units with manual control

= 11.31% for Unit Ventilators[1355]

$\text{Hours}_{\text{existing}}$ = 2303 for Air Handling Units

[1352] Off Hours were estimated by evaluating five boilers across five different public schools. Each boiler was manually switched on and off by engineering staff. Hours were correlated with outside air (OA) conditions and contrasted with TMYx weather data.

[1353] Derived using Chicago TMYx hourly dry-bulb data (Chicago O'hare) with 5°F intervals. Supply air temperature for each bin was calculated using the ASHRAE Guideline 36 outdoor air reset schedule (95°F at OAT < 20°F, linear reset to 55°F at OAT > 55°F). Mixed air temperature was calculated as MAT = OAT% * OAT + (1- OA%) * RAT, using observed average OA% of 30% for air handling units and 20% for unit ventilators, derived as well from five public schools monitored during the 2024-2025 heating season.

[1354] ASHRAE Handbook – Fundamentals, Chapter 21 (Duct Design). Typical fan power density relationships, and is the basis for 1 HP/1,000 CFM.

[1355] Derived from a monitoring study of five public schools during the 2024 – 2025 heating season. None of the schools had heating equipment integrated into a Building Automation System (BAS) at the time of the study, everything operated manually. Overheating was quantified using a multivariate regression of measured heat delivery (Q, btu/hr) against outdoor air temperature (OAT) and average room temperature. By controlling for OAT, the regression isolated the portion of Q attributable to rooms running above setpoint independent of weather-driven heating demand. A 2°F thermostat deadband as applied, meaning only overheating exceeding 2°F above the72°F design setpoint was counted. Average overheating was used including the schools were no overheating was present, meaning manual operation of the air handling unit was enough to reach temperature setpoint.

= 3296 for Unit Ventilators[1356]

$\text{Hours}_{\text{proposed}}$ = 1606 for Unit Ventilators and Air Handling Units[1357]

ηBoiler = Efficiency of the boiler being used to generate the hot water or steam in the pipe

= Actual or if unknown use default values given below:

= 80% for hot water boilers[1358]

= 79% for steam boilers[1359]

Example: A unit ventilator with manual controls is integrated into a building automation system. The building utilizes a steam boiler for space heating.

$$\Delta \text{ Therms} = \frac{0.22 * 1{,}000 * [3296 - 1606 + 0.1131 * 3296]}{1000 * 79\%} = 574 \text{ therms}$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-SBAS-V01-270101

REVIEW DEADLINE: 1/1/2030

[1356] Existing heating season operating hours were derived from the same five schools monitored in the study through the 2024-2025 heating season. Fan motor runtime was logged at 5-minute intervals using data loggers on supply fans for both AHU and UV systems. None of the monitored schools had equipment controlled by a BAS, systems were manually started and stopped by building operators.

[1357] Based on measure 4.4.27 Energy Recovery Ventilator: Elementary school hours are 8 am – 4 pm (20% in the summer).

[1358] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/h

[1359] Federal Register, volume 74, Number 139, July 22, 2009 for boilers >300,000 Btu/h

4.4.75 Dedicated Outdoor Air System (DOAS)

DESCRIPTION

The measure requires the installation of a new Dedicated Outdoor Air System (DOAS) in an existing facility or new construction application; this measure does not apply to retrofit nor early retirement of existing, functional HVAC systems. A DOAS saves energy by decoupling the ventilation component of an HVAC system with the conditioning component. This measure saves further energy by requiring the efficiency rating of the system, the ISMRE2, to surpass IECC 2024 baseline efficiency. The DOAS can be air cooled, water cooled, or a heat pump system, and can either have or not have integrated energy recovery.

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as a high-efficiency DOAS unit that is air-cooled, water-cooled, or a heat pump unit. This unit must exceed baseline efficiency requirements as defined in IECC 2024 Tables C403.3.2(12) and C403.3.2(13).

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is defined as a DOAS unit that meets the efficiency requirements of IECC 2024 Tables C403.3.2(12) and C403.3.2(13).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 20 years[1360].

DEEMED MEASURE COST

For analysis purposes, the incremental cost for a DOAS unit above the baseline efficiency requirement is assumed to be $2.00 per CFM for a unit without energy recovery, and $4.60 per CFM for a unit with energy recovery[1361].

LOADSHAPE

Loadshape C03 - Commercial Cooling

Loadshape C23 – Commercial Ventilation

COINCIDENCE FACTOR

CFssp = Summer Peak Coincidence Factor for Commercial cooling (during system peak hour) = 91.3%[1362]

CFpjm = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period) = 47.8%[1363]

[1360] REDCAR Analytics, "Economic Analysis of Heat Recovery Equipment in Commercial Dedicated Outside Air Systems", (2019), https://betterbricks.com/uploads/resources/NEEA-DOAS-Analysis-Report_Red-Car_Final.pdf (Pg. 32)
[1361] Lbid, Pg. 19, "first cost & operational costs" (2019)
[1362] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1363] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \Delta kWh_{cooling}$$

$$\Delta kWh_{cooling} = MRC_A * EFLH_C * (1/ISMRE2_{Base} - 1/ISMRE2_{Eff})$$ [1364]

Where:

MRC_A = Moisture removal capacity at point A [lbs/hr], Actual installed (from AHRI database or manufacturer)

$EFLH_C$ = Cooling Equivalent Full Load Hours, Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

$ISMRE2_{Base}$ = Integrated Seasonal Moisture Removal Efficiency (ISMRE2) (ASHRAE 920-2020) of baseline cooling system, use minimum standard efficiencies as specified in reference table – IECC 2024 Minimum Efficiency Requirements for Cooling Systems

$ISMRE2_{Eff}$ = Integrated Seasonal Moisture Removal Efficiency (ISMRE2) (ASHRAE 920-2020) of efficient DOAS unit, Actual installed

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = MRC_A * (1/ISMRE2_{Base} - 1/ISMRE2_{Eff}) * CF$$

Where:

CFssp = Summer Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1365]

CFpjm = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1366]

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

Reference Tables

[1364] The calculation approach for this measure was adopted from the TX TRM V12.0 Program Year 2026, Volume 4: Measurement and Verification Protocols 2.1.5 "Dedicated Outdoor Air Systems" Measure Overview for both Electric Savings and Demand Savings

[1365] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1366] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

Table 1 – IECC 2024 Minimum Efficiency Requirements for Cooling Systems

System Type	Subcategory	Efficiency Requirements	Test Procedure
DOAS air-cooled	Without ventilation energy recovery	3.8 ISMRE2	AHRI 920-2020
	With ventilation energy recovery	5.0 ISMRE2	
DOAS air-source heat pump	Without ventilation energy recovery (cooling)	3.8 ISMRE2	AHRI 920-2020
	With ventilation energy recovery (cooling)	5.0 ISMRE2	
	Without ventilation energy recovery (heating)	2.05 ISCOP2	
	With ventilation energy recovery (heating)	3.2 ISCOP2	
DOAS water-cooled	Without ventilation energy recovery	4.7 ISMRE2	AHRI 920-2020
	With ventilation energy recovery	5.1 ISMRE2	
DOAS water-source heat pump	Water source – Without ventilation energy recovery (cooling)	3.8 ISMRE2	AHRI 920-2020
	Ground source, closed and open loop - Without ventilation energy recovery (cooling)	4.6 ISMRE2	
	Water source – With ventilation energy recovery (cooling)	4.6 ISMRE2	
	Ground source, closed and open loop - With ventilation energy recovery (cooling)	5.0 ISMRE2	
	Water source – Without ventilation energy recovery (heating)	2.13 ISCOP2	
	Ground source, closed and open loop - Without ventilation energy recovery (heating)	2.13 ISCOP2	
	Water source – With ventilation energy recovery (heating)	4.04 ISCOP2	
	Ground source, closed and open loop - With ventilation energy recovery (heating)	3.5 ISCOP2	

MEASURE CODE: CI-HVC-DOAS-V01-270101

REVIEW DEADLINE: 1/1/2030

4.4.76 Air to Water Heat Pump

DESCRIPTION

An Air to Water Heat Pump (AWHP) provides space heating, space cooling, and/or water heating by moving heat between a hydronic heat transfer system and outdoor air. For space heating, an AWHP functions similarly to a boiler system, although the energy source is the heat gathered from the outdoor air. For space cooling, an AWHP moves heat from inside to outside via a specialized air handler. For water heating, an AWHP "pre-heats" water in the DHW system before it enters a standard water heater.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Installation of a new "residential scale" Air to Water Heat Pump with a nominal space cooling capacity up to 65 kBTU/hr that is rated to generate 110°F supply water at an outdoor temperature of 5°F with a COP of 1.7 or greater (COP @ A5W110), which is a published rating in all qualifying product literature. The AWHP must be sized to cover most of the heating load with the available hydronic distribution system. The seasonal heating and cooling efficiency factors (SHEF and SCEF) are defined by the AHRI 1700 standard, which is expected to be published in 2026. These are unitless ratings based on the average COP of the heating throughout the heating or cooling season.

DEFINITION OF BASELINE EQUIPMENT

For these products, baseline equipment includes Air Conditioning, Space Heating and Water Heating.

New Construction:

The baseline fuel type is assumed to align with the efficient equipment, unless the program can provide information to assume otherwise, and the algorithms are provided to allow savings to be calculated from any baseline condition. The electric baseline heating equipment is assumed to be a resistance boiler with a COP of 1.0 (3.41 HSPF2). For a gas boiler baseline, assume an AFUE of 84%. If the new AWHP includes cooling, the baseline cooling equipment is assumed to be a central AC meeting the Federal Standard efficiency level: 13.4 SEER2 and 10.6 EER2.[1367] If the new AWHP includes a DHW tank, the baseline is assumed to be a 50-gallon electric resistance water heater with a default efficiency of 0.9207 UEF.[1368]

Time of Sale:

The baseline is a new replacement unit of the same system type as the existing unit, meeting the baselines provided in the tables below. Only use the cooling and/or DHW baselines if the new AWHP includes cooling and/or DHW equipment.

Unit Type	Efficiency Standard
ASHP	14.3 SEER2 9.4 EER2, 7.5 HSPF2
Natural Gas or LP Furnace	80% AFUE
Natural Gas or LP Boiler	84% AFUE
Oil Furnace	83% AFUE
Oil Boiler	86% AFUE
Central AC	13.4 SEER2, 10.6 EER2

The baseline condition is a new water heater meeting Federal Standard efficiency levels, dependent on the equipment type and storage volume (in gallons) of the water heater.

[1367] The Federal Standard does not include an EER requirement. The value provided is based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2_28_2018'.
[1368] A 50 gallon volume tank for the baseline is assumed to capture market practice of using larger heat pump water heaters to achieve greater efficiency of the heat pump cycle and preventing the unit from going in electric resistance mode.

Equipment Type	Sub Category	Draw Pattern	Federal Standard – Uniform Energy Factor[1369]
Residential Electric Storage Water Heaters ≤ 75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.8808 – (0.0008 * Rated Storage Volume in Gallons)
		Low	UEF = 0.9254 – (0.0003 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.9307 – (0.0002 * Rated Storage Volume in Gallons)
		High	UEF = 0.9349 – (0.0001 * Rated Storage Volume in Gallons)
	>55 gallon and ≤120 gallon tanks[1370]	Very small	UEF = 1.9236 – (0.0011 * Rated Storage Volume in Gallons)
		Low	UEF = 2.0440 – (0.0011 * Rated Storage Volume in Gallons)
		Medium	UEF = 2.1171 – (0.0011 * Rated Storage Volume in Gallons)
		High	UEF = 2.2418 – (0.0011 * Rated Storage Volume in Gallons)
Residential Electric Instantaneous Water Heaters	≤12kW and ≤2 gal	All other	UEF = 0.91
		High	UEF = 0.92
Residential Gas Storage Water Heaters ≤75,000 Btu/h	≤55 gallon tanks	Very small	UEF = 0.3456 – (0.0020 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5982 – (0.0019 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6483 – (0.0017 * Rated Storage Volume in Gallons)
		High	UEF = 0.6920 – (0.0013 * Rated Storage Volume in Gallons)
	>55 gallon and ≤100 gallon tanks	Very small	UEF = 0.6470 – (0.0006 * Rated Storage Volume in Gallons)
		Low	UEF = 0.7689 – (0.0005 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.7897 – (0.0004 * Rated Storage Volume in Gallons)
		High	UEF = 0.8072 – (0.0003 * Rated Storage Volume in Gallons)
Residential Gas Fired Instantaneous Water Heaters	< 2 gal and >50,000 Btu/h	Very small	UEF = 0.80
		All other	UEF = 0.81
Residential Oil Storage Water Heater	≤50 gallon tanks	Very small	UEF = 0.2509 – (0.0012 * Rated Storage Volume in Gallons)
		Low	UEF = 0.5330 – (0.0016 * Rated Storage Volume in Gallons)
		Medium	UEF = 0.6087 – (0.0016 * Rated Storage Volume in Gallons)
		High	UEF = 0.6815 – (0.0014 * Rated Storage Volume in Gallons)

The same draw pattern (very small, low, medium and high draw) should be used for both baseline and efficient units. If using a deemed approach, for units ≤55 gallons – baseline is assumed to be a resistance storage unit with efficiency: 0.9307 – (0.0002 * rated volume in gallons) assuming medium draw.

For units >55 gallons – assume a 50-gallon resistance tank baseline[1371] i.e., 0.9299 UEF assuming high draw.

If unknown, assume a 50-gallon resistance tank baseline, at medium draw, therefore 0.9207 UEF.[1372]

Early Replacement:

The baseline is the efficiency of the *existing* heating, cooling and hot water equipment for the assumed remaining useful life of the existing unit and a new baseline heating and cooling system for the remainder of the measure life (as provided in tables above).

[1369] All Residential sized Federal Standards are from DOE Standard 10 CFR 430, Residential-Duty and Commercial Federal Standard are from DOE Standard 10 CFR 431.

[1370] It is assumed that tanks <75,000Btu/h and >55 gallons will not be eligible measures due to the high baseline.

[1371] A 50 gallon volume tank for the baseline is assumed to capture market practice of using larger heat pump water heaters to achieve greater efficiency of the heat pump cycle and preventing the unit from going in electric resistance mode.

[1372] About 90% of all water heaters are installed in a replace-on-burnout situation and installers strongly prefer like-for-like equipment replacements in these situations, meaning that fuel switching is unlikely in TOS situations. As stated in Opinion Dynamics Ameren Illinois' Market Effects Pilot – Heat Pump Hot Water Market Characterization Report, March 4, 2021.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years (same as for air source heat pumps).[1373]

For early replacement, the remaining life of existing equipment is assumed to be 6 years for Central AC, 8 years for boilers and 16 years for electric resistance.[1374]

DEEMED MEASURE COST

Baseline	Baseline Cost	Deferred Baseline Replacement Cost[1375]
New electric resistance boiler[1376]	$5,000	N/A
New gas boiler[1377]	$8,820	$8,982
New central AC[1378]	$5,250	$5,322
New 50-gallon electric storage water heater[1379]	$882	$892
New 50-gallon gas storage water heater, medium draw[1380]	$1,738	$1,758

AWHP Heating Capacity (kBTU/hr)	Cost
24 up to 30	$6,404
30 up to 36	$7,326
36 up to 42	$8,248
42 up to 48	$9,224
48 up to 54	$10,199
54 up to 60	$11,116
60 up to 66	$12,033
66 up to 72	$12,971

LOADSHAPE

Loadshape C04 – Commercial Electric Heating (if installed in building with no existing cooling)

[1373] Based on 2016 DOE Rulemaking Technical Support document, as recommended in Guidehouse 'ComEd Effective Useful Life Research Report', May 2018.

[1374] Assume full measure life (16 years) for replacing electric resistance as we would not expect that resistance heat would fail during the lifetime of the efficient measure.

[1375] All baseline replacement costs are consistent with their respective measures and include inflation rate of 2.28%.

[1376] "How Much Does Electric Boiler Installation Cost? [2026 Data]", Updated March 6, 2026, https://www.angi.com/articles/electric-boiler-installation-cost.htm

[1377] In 2025, a working group was created to update costs for residential HVAC equipment. Heat Pump and Central Air Conditioning costs are based upon Ameren program data. Furnace and Boiler costs are based on Ameren, Nicor, People's Gas, and North Shore Gas program data. Baseline costs have been determined using ratios from Updated Buildings Sector Appliance and Equipment Costs and Efficiencies by Guidehouse and Leidos, prepared for the U.S. Energy Information Administration, March 2023. See file "HVAC Costs – 071825_VEIC.xlsx" for more details.

[1378] Ibid., assuming 3.5-ton baseline

[1379] Baseline ERWH equipment costs: Energy Solutions (2024). Heat Pump Water Heaters in the Northeast and Mid-Atlantic: Costs and Market Trends. Prepared for: Northeast States for Coordinated Air Use Management (NESCAUM) and The Ozone Transport Commission (OTC). Installation labor cost from same study suggests $308, for a total of $882. Additionally, a review of 18 baseline ERWH models (5 different manufacturers; sizes ranging from 30-50 gallons) listed with online retailers (Home Depot, Lowes, Menards, and Ferguson Supply) available in IL established an average equipment cost of $575.

[1380] Supporting document for Energy Conservation Program: Energy Conservation Standards for Consumer Water Heaters. 2023-07-21 Consumer Water Heater Life-Cycle Cost (LCC) and Payback Period Results Analysis (NOPR), EERE-2017-BT-STD-0019-0061.

Loadshape C05 - Commercial Electric Heating and Cooling

Note for the purpose of cost effectiveness screening for a fuel switch scenario, the heating kWh increase and cooling kWh decrease should be calculated separately such that the appropriate loadshape (i.e., Loadshape C04 - Commercial Electric Heating and Loadshape C03 – Commercial Cooling respectively) can be applied.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1381]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1382]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Non-fuel switch measures:

ΔkWh = AWHPSiteCoolingImpact + AWHPSiteHeatingImpact + AWHPSiteDHWImpact

AWHPSiteCoolingImpact = [EFLHcool * Capacity_cooling * (1/$SEER2_{base}$ – 1/($SCEF_{HP}$ * 3.412))/1000]

AWHPSiteHeatingImpact = [HeatLoad* (1/$HSPF2_{base}$ – 1/($SHEF_{HP}$ * 3.412))/1000]

AWHPSiteDHWImpact = [ElecDHW * %DHWDisplaced * (((1/EF_{ELEC} – 1/EF_{HP}) * GPD * Household * 365.25 * γWater * (T_{OUT} – T_{IN}) * 1.0) / 3412)]

Fuel switch measures:

Fuel switch measures must produce positive total lifecycle energy savings (i.e., reduction in Btus at the premises) to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

SiteEnergySavings (MMBTUs) = FuelSwitchSavings + NonFuelSwitchSavings

FuelSwitchSavings = GasHeatReplaced – AWHPSiteHeatConsumed

NonFuelSwitchSavings = AWHPSiteCoolingImpact + AWHPSiteWaterImpact

GasHeatReplaced = [(HeatLoad * 1/$AFUE_{base}$) / 1,000,000]

[1381] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1382] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

AWHPSiteHeatConsumed = [(HeatLoad * 1/($SHEF_{HP}$ * 3.412)) / 1,000,000]

AWHPSiteCoolingImpact = [EFLHcool * Capacity_cooling * (1/$SEER2_{base}$ – 1/($SCEF_{HP}$ * 3.412)] / 1,000,000

$AWHPSiteWaterImpact_{Gas}$ = (%DHWDisplaced * ((1/EF_{Gas} - 1/EF_{HP}) * HotWaterUse * γWater * (T_{OUT} – T_{IN}) * 1.0)) / 1,000,000)

$AWHPSiteWaterImpact_{Elec}$ = (%DHWDisplaced * ((1/EF_{Elec} - 1/EF_{HP}) * HotWaterUse * γWater * (T_{OUT} – T_{IN}) * 1.0)) / 1,000,000

If SiteEnergySavings calculated above is positive, the measure is eligible.

The appropriate savings claim is dependent on which utilities are supporting the measure as provided in the table below:

Measure supported by:	Electric Utility claims (kWh):	Gas Utility claims (therms):
Electric utility only	SiteEnergySavings * 1,000,000/3,412	N/A
Electric and gas utility (Note utilities may make alternative agreements to how savings are allocated as long as total MMBtu savings remains the same).	%IncentiveElectric * SiteEnergySavings * 1,000,000/3,412	%IncentiveGas * SiteEnergySavings * 10
Gas utility only	N/A	SiteEnergySavings * 10

Note for Early Replacement measures, the efficiency of the existing unit should be used for the remaining useful life of the existing equipment, and the efficiency for a new baseline unit should be used for the remaining years of the measure. See assumptions below.

Where:

EFLHcool = Cooling Equivalent Full Load Hours
Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use

Capacity_cooling = Cooling Output Capacity of Air to Water Heat Pump (Btu/hr)

= Actual (1 ton = 12,000 Btu/hr)

SEER2base = Seasonal Energy Efficiency Rating of baseline or existing cooling system. For early replacement measures, use actual SEER/SEER2 rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment. If using rated efficiencies, derate efficiency value by 1% per year (maximum of 30 years) to account for degradation over time.[1383] If unknown, assume no central cooling.

[1383] Justification for degradation factors can be found on page 14 of 'AIC HVAC Metering Study Memo FINAL 2_28_2018'. Estimate efficiency as (Rated Efficiency * (1-0.01)^Equipment Age).

Baseline/Existing Cooling System	SEER2base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Central AC	9.2 SEER2[1384]	13.4 SEER2[1385]	
No central cooling	13.4 SEER2[1386]	13.4 SEER2	

$SCEF_{HP}$ = Seasonal Cooling Efficiency Factor of efficient AWHP unit. Equivalent to average COP over the heating season, including the use of electric resistance backup heat.

= Actual installed

HeatLoad = Calculated heat load for the building

= EFLH_heat * Capacity_heat

EFLH_heat = Full load hours of heat pump heating

Dependent on building type and Existing Buildings or New Construction, provided in section 4.4 HVAC End Use

Capacity_heat = Heating Output Capacity of Air to Water Heat Pump (Btu/hr)

= Actual installed

$HSPF2_{base}$ = Heating Seasonal Performance Factor of baseline or existing heating system (kBtu/kWh). For early replacement measures, use actual HSPF/HSPF2 rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment. If using rated efficiencies, derate efficiency value by 1% per year (maximum of 30 years) to account for degradation over time.[1387]

= If unknown, assume electric resistance.

Baseline/ Existing Heating System	HSPF2_base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	4.91 HSPF2[1388]	7.5 HSPF2[1389]	
Electric Resistance (Baseboard or Electric Furnace)	3.41 HSPF2[1390]		

$SHEF_{HP}$ = Seasonal Heating Efficiency Factor of efficient AWHP unit

[1384] Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2_28_2018' Converted to SEER2.

[1385] Minimum Federal Standard; Federal Register, Vol. 66, No. 14, Monday, January 22, 2001/Rules and Regulations, p. 7170-7200.

[1386] Assumes that the decision to replace existing systems includes desire to add cooling.

[1387] Justification for degradation factors can be found on page 14 of 'AIC HVAC Metering Study Memo FINAL 2_28_2018'. Estimate efficiency as (Rated Efficiency * (1-0.01)^Equipment Age).

[1388] Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2_28_2018' Converted to HSPF2.

[1389] Based on Minimum Federal Standard effective 1/1/2023.

[1390] Electric resistance has a COP of 1.0 which equals 1/0.293 = 3.41 HSPF.

= Actual installed

ElecDHW = 1 if existing DHW is electrically heated

= 0 if existing DHW is not electrically heated

%DHWDisplaced = Percentage of total DHW load that the AWHP will provide

= Actual, per design

= 0% if no DHW tank is installed

EF_{ELEC} = Energy Factor (efficiency) of electric water heater

= Actual. If unknown or for new construction, assume 0.9207[1391]

EF_{HP} = COP @ A5W110 (Ambient air at 5 degrees, supply water at 110 degrees)

= If unknown, use 1.7

HotWaterUse = Estimated annual hot water consumption (gallons)

= Actual, per design or estimate by building type.

Consumption per unit area by building type
= (Area/1000) * Consumption per 1,000 sq.ft.

Where:

Area = Area in sq.ft that is served by domestic water heating system

= Actual

Consumption per 1,000 sq.ft. = Estimate of DHW consumption per 1,000 sq.ft. based on building type:[1392]

Building Type	Consumption/1,000 sq.ft.
Convenience	4,594
Education	7,285
Grocery	697
Health	24,540
Large Office	1,818
Large Retail	1,354
Lodging	29,548
Other Commercial	3,941
Restaurant	44,439
Small Office	1,540
Small Retail	6,111
Warehouse	1,239
Nursing	30,503
Multi-Family	15,434

γWater = Specific weight of water

[1391] Assuming a 50-gallon tank baseline at Medium Draw.

[1392] Methodology based on Cadmus analysis. Annual hot water usage in gallons based on CBECS (2012) and RECS (2009) consumption data of East North Central (removed outliers of 1,000 kBtuh or less) to calculate hot water usage. Annual hot water gallons per tank size gallons based on the tank sizing methodology found in ASHRAE 2011 HVAC Applications. Chapter 50 Service Water Heating. Demand assumptions (gallons per day) for each building type based on ASHRAE Chapter 50 and to LBNL White Paper. LBL-37398 Technology Data Characterizing Water Heating in Commercial Buildings: Application to End Use Forecasting. Assumes hot water heater efficiency of 80%.

= 8.33 pounds per gallon

T_{OUT} = Tank temperature

= 125°F

T_{IN} = Incoming water temperature from well or municiplal system

= 50.7°F [1393]

1.0 = Heat Capacity of water (1 Btu/lb*°F)

3412 = Conversion from Btu to kWh

AFUEbase = Baseline Annual Fuel Utilization Efficiency Rating. For early replacement measures, use actual AFUE rating where it is possible to measure or reasonably estimate for the remaining useful life of the existing equipment. If using rated efficiencies, derate efficiency value by 1% per year (maximum of 30 years) to account for degradation over time,[1394] or if unknown assume default. If unknown value is used, it should not be derated by age.

Baseline/ Existing Heating System	AFUEbase		
	Early Replacement (Remaining useful life of existing equipment)[1395]	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Boiler	61.6%	84%	84%

EF_{GAS} = Energy Factor (efficiency) of gas water heater

= Actual. If unknown, assume federal standard:[1396]

For <=55 gallons: 0.6483 – (0.0017 * storage capacity in gallons)

For > 55 gallons 0.7897 − (0.0004 * storage capacity in gallons)

= If tank size unknown, assume 40 gallons and EF_Baseline of 0.58

3412 = Btu per kWh

%IncentiveElectric = % of total incentive paid by electric utility

= Actual

%IncentiveGas = % of total incentive paid by gas utility

= Actual

[1393] Table 4 in Chen, et. al., "Calculating Average Hot Water Mixes of Residential Plumbing Fixtures", June 2020, reports a value of 50.7°F for inlet water temperature for U.S. Census Division 3.

[1394] Justification for degradation factors can be found on page 14 of 'AIC HVAC Metering Study Memo FINAL 2_28_2018'. Estimate efficiency as (Rated Efficiency * (1-0.01)^Equipment Age).

[1395] Average nameplate efficiencies of all Early Replacement qualifying equipment in Ameren PY3-PY4.

[1396] Minimum Federal Standard as of 4/1/2015.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (Capacity_cooling * (1/EER2_{base} - 1/EER_{HP}))/1000 * CF$$

Where:

$EER2_{base}$ = Energy Efficiency Ratio 2 of baseline unit (kBtu/kWh). For early replacment measures, the actual EER2 rating where it is possible to measure or reasonably estimate should be used for the remaining useful life of the existing equipment. If using rated efficiencies, derate efficiency value by 1% per year (maximum of 30 years) to account for degradation over time.[1397] If unknown, assume default provided below. If unknown value is used, it should not be derated by age.

Baseline/Existing Cooling System	EER2_base		
	Early Replacement (Remaining useful life of existing equipment)	Early Replacement (Remaining measure life)	Time of Sale or New Construction
Air Source Heat Pump	7.4 EER2[1398]	9.4 EER2[1399]	
Ground Source Heat Pump	11.2 EER2	11.2 EER2	
Central AC	7.4 EER2	10.6 EER2	
No central cooling	10.6 EER2[1400]	10.6 EER2	

EER_{HP} = EER Efficiency of new AWHP unit; ambient air at 95 degrees, water supply at 45 degrees (A95W45)

CF_{SSP} = Summer System Peak Coincidence Factor for Central A/C (during system peak hour)

= 91.3%[1401]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Central A/C (average during peak period)

= 47.8%[1402]

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-HVC-AWHP-V01-270101

REVIEW DEADLINE: 1/1/2029

[1397] Justification for degradation factors can be found on page 14 of 'AIC HVAC Metering Study Memo FINAL 2_28_2018'. Estimate efficiency as (Rated Efficiency * (1-0.01)^Equipment Age).

[1398] Based on Opinion Dynamics and Cadmus metering study of Ameren HVAC program participants; See 'AIC HVAC Metering Study Memo FINAL 2_28_2018' Converted to EER2.

[1399] Assumed consistent with the EER2 requirements in the Federal Standard for Southwest standards (in the absence of standards for Northen states).

[1400] Assumes that the decision to replace existing systems includes desire to add cooling.

[1401] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1402] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

4.5. Lighting End Use

The commercial lighting measures use a standard set of variables for hours of use, waste heat factors, coincident factors and HVAC interaction effects. This table has been developed based on information provided by the various stakeholders. For ease of review, the table is included here and referenced in each measure.

The OpenStudio models are initially based upon DOE Prototypes described in NREL's "U.S. Department of Energy Commercial Reference Building Models of the National Building Stock". A TAC working group reviewed and made adjustments to best reflect the IL building stock. Details of key modeling inputs are provided within the file "Energy Models Inputs & Outputs Summary_06152026" on the IL TRM Sharepoint Site: TRM Reference Documents: 2nd Volume – Commercial and Industrial Measures: Commercial Building Energy Models. See Appendix for key modeling attributes.

Note where a measure installation is within a building or application that does not fit with any of the defined building types below, the user should apply custom assumptions where it is reasonable to estimate them, else the building of best fit should be utilized.

In addition, deemed baseline fixture wattages (extracted from the 2026 Pennsylvania Technical Reference Manual, Appendix C, 'Lighting Audit & Design Tool for Commercial and Industrial Projects', accessed 07/2025) is provided in "Lighting Deemed Fixture Wattage.xls" within the 4.5 Lighting folder in the Reference Documents section of the Illinois TRM Sharepoint site.

Building/Space Type	Fixture Annual Operating Hours	Screw based bulb Annual Operating hours	Waste Heat Cooling Energy WHFe	Waste Heat Cooling Demand WHFd	Coincidence Factor	Waste Heat Gas Heating	Waste Heat Electric Resistance Heating IFkWh	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Agriculture – Chicken Broilers[1403]	3,251	3,251	1.00	1.00	0.76	0.000	0.000	0.000	n/a
Agriculture – Chicken Breeders	4,606	4,606	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Chicken Layers	4,914	4,914	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Turkey Hens	2,231	2,231	1.00	1.00	0.76	0.000	0.000	0.000	n/a
Agriculture – Turkey Toms	5,351	5,351	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Turkey Breeder Hens	4,396	4,396	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Agriculture – Turkey Breeder Toms	5,446	5,446	1.00	1.00	0.95	0.000	0.000	0.000	n/a

[1403] Agriculture lighting loadshapes, operational hours, and HVAC interactive factors were developed based on field experience and research material for the general agriculture, indoor agriculture, poultry and dairy commodities. Please see the excel files, 'General Agriculture Loadshape' and 'Indoor Agriculture Lighting Loadshape' on the 8760-calculation approach and for more detail. Due to livestock housing having little to no mechanical cooling systems, waste heat cooling and associated demand factors were assumed to be 1.00.

Building/Space Type	Fixture Annual Operating Hours	Screw based bulb Annual Operating hours	Waste Heat Cooling Energy WHFe	Waste Heat Cooling Demand WHFd	Coincidence Factor	Waste Heat Gas Heating	Waste Heat Electric Resistance Heating IFkWh	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Agriculture – Dairy Long Day Lighting	6,205	6,205	1.00	1.00	0.95	0.000	0.000	0.000	n/a
Assembly	3,925	2,652	1.10	1.17	0.61	0.0180	0.4218	0.1834	OpenStudio
Assisted Living	3,446	5,950	1.18	1.23	0.54	0.0286	0.6715	0.2920	OpenStudio
Auto Dealership	3,474	2,935	1.31	1.80	0.67	0.0152	0.3572	0.1553	OpenStudio
Childcare/Pre-School	3,423	2,860	1.08	1.00	0.59	0.0117	0.2750	0.1196	OpenStudio
College	3,395	2,588	1.12	1.01	0.61	0.0057	0.1337	0.0581	OpenStudio
Convenience Store	3,750	3,650	1.02	1.22	0.66	0.0177	0.4156	0.1807	OpenStudio
Drug Store	3,336	2,935	1.27	1.70	0.68	0.0177	0.4138	0.1799	OpenStudio
Elementary School	3,038	2,118	1.18	1.99	0.61	0.0018	0.0424	0.0184	OpenStudio
Emergency Services	5,274	3,088	1.07	1.19	0.47	0.0040	0.0936	0.0407	OpenStudio
Garage	3,401	3,540	1.11	1.18	0.87	0.0000	0.0000	0.0000	eQuest
Garage, 24/7 lighting	8,766	8,766	1.11	1.18	1.00	0.0000	0.0000	0.0000	eQuest
Grocery	5,468	3,650	1.02	1.22	0.65	0.0192	0.4490	0.1952	OpenStudio
Healthcare Clinic	3,878	4,207	1.28	1.81	0.63	0.0116	0.2729	0.1186	OpenStudio
High School	3,038	2,327	1.06	1.81	0.66	0.0208	0.4864	0.2115	OpenStudio
Hospital - CAV no econ	4,431	4,207	1.36	1.60	0.55	0.0133	0.3118	0.1356	OpenStudio
Hospital - CAV econ	4,431	4,207	1.30	1.60	0.55	0.0126	0.2963	0.1288	OpenStudio
Hospital - VAV econ	4,431	4,207	1.26	1.46	0.55	0.0070	0.1636	0.0711	OpenStudio
Hospital - FCU	4,431	4,207	1.39	1.39	0.55	0.0044	0.1022	0.0444	OpenStudio
Hospital - Unknown/Average	4,431	4,207	1.33	1.52	0.55	0.0093	0.2185	0.0950	OpenStudio
Hotel/Motel	4,483	2,165	1.22	1.44	0.48	0.0218	0.5106	0.2220	OpenStudio
Hotel/Motel - Common	6,013	4,542	1.19	1.47	0.47	0.0194	0.4540	0.1974	OpenStudio
Hotel/Motel - Guest	3,590	777	1.22	1.35	0.49	0.0228	0.5347	0.2325	OpenStudio
Manufacturing Facility_Miscellaneous	4,618	2,629	1.10	1.49	0.67	0.0047	0.1100	0.0478	OpenStudio

Building/Space Type	Fixture Annual Operating Hours	Screw based bulb Annual Operating hours	Waste Heat Cooling Energy WHFe	Waste Heat Cooling Demand WHFd	Coincidence Factor	Waste Heat Gas Heating	Waste Heat Electric Resistance Heating IFkWh	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Manufacturing Facility_Food/Chemical	4,618	2,629	1.12	1.21	0.59	0.0041	0.0969	0.0421	OpenStudio
MF - High Rise	1,000	5,950	1.14	0.91	0.50	0.0175	0.4107	0.1786	OpenStudio
MF - High Rise - Common	4,824	5,950	1.01	1.00	0.43	0.0012	0.0275	0.0120	OpenStudio
MF - High Rise - Residential	525	5,950	1.15	0.94	0.53	0.0182	0.4263	0.1853	OpenStudio
MF - Mid Rise	4,263	5,950	1.11	0.97	0.50	0.0189	0.4428	0.1925	OpenStudio
Movie Theater	2,592	5,475	1.16	1.66	0.62	0.0004	0.0086	0.0037	OpenStudio
Office - High Rise - CAV no econ	3,216	3,088	1.51	1.63	0.73	0.0106	0.2485	0.1081	OpenStudio
Office - High Rise - CAV econ	3,216	3,088	1.40	1.63	0.73	0.0103	0.2406	0.1046	OpenStudio
Office - High Rise - VAV econ	3,216	3,088	1.31	1.48	0.72	0.0109	0.2564	0.1115	OpenStudio
Office - High Rise - FCU	3,216	3,088	1.38	1.37	0.72	0.0050	0.1164	0.0506	OpenStudio
Office - Low Rise	2,698	3,088	1.10	1.13	0.73	0.0142	0.3333	0.1449	OpenStudio
Office - Mid Rise	3,266	3,088	1.19	2.08	0.73	0.0251	0.5873	0.2553	OpenStudio
Religious Building	2,547	1,664	1.05	1.23	0.60	0.0129	0.3030	0.1318	OpenStudio
Restaurant	5,070	4,784	1.24	1.56	0.60	0.0165	0.3870	0.1683	OpenStudio
Retail - Department Store	4,099	2,935	1.32	1.63	0.66	0.0150	0.3519	0.1530	OpenStudio
Retail - Strip Mall	3,502	2,935	1.12	1.38	0.66	0.0141	0.3295	0.1433	OpenStudio
Warehouse Nonrefrigerated	3,135	4,293	1.02	1.18	0.68	0.0123	0.2892	0.1257	OpenStudio
Warehouse Refrigerated	3,135	4,293	1.01	1.03	0.68	0.0015	0.0351	0.0152	OpenStudio
Medical Office	2,161	3,088	1.20	1.34	0.79	0.0066	0.1558	0.0677	OpenStudio
Unknown	3,381	3,140	1.13	1.43	0.65	0.0130	0.3040	0.1322	n/a
Exterior – dusk to dawn[1404]	4,303	4,303	1.00	1.00	0.00	0.000	0.000	0.000	n/a
Exterior – dusk to business close	See calculation below		1.00	1.00	0.00	0.000	0.000	0.000	n/a

[1404] Based on Navigant verified value using 2014 Astronomical Applications Department, U.S. Naval Observatory data for ComEd's service territory. See Navigant Memorandum 'RE: LED Street Lighting Program Hours of Use for the ComEd and DCEO Programs. June 21, 2017'.

Building/Space Type	Fixture Annual Operating Hours	Screw based bulb Annual Operating hours	Waste Heat Cooling Energy WHFe	Waste Heat Cooling Demand WHFd	Coincidence Factor	Waste Heat Gas Heating	Waste Heat Electric Resistance Heating IFkWh	Waste Heat Electric Heat Pump Heating IFkWh	Model Source
Low-Use Small Business	2,954	2,954	1.31	1.53	0.66	0.023	0.524	0.262	n/a
Uncooled Building	Varies	Varies	1.00	1.00	0.66	0.014	0.320	0.160	n/a
Refrigerated Cases	5,802	n/a	1.29[1405]	1.29	1.00	0.000	0.000	0.000	n/a
Freezer Cases	5,802	n/a	1.50[1406]	1.5	1.00	0.000	0.000	0.000	n/a

Annual Operating Hours – Spaces with Lighting Controls

For spaces where occupancy or daylight sensors are known to be already installed, the user should adjust the Annual Operating Hours using the formula below. For v9.0, the TAC agreed that if current state is unknown by the implementer, then subsequent evaluation should assume the space does not have lighting controls. Over 2021 program year, this should be evaluated and the TAC will determine if a different unknown assumption should be used from V10 on.

Sensor Controlled Hours = Annual Operating Hours * (1- ESF)

Where:

Annual Operating Hours = Average hours of use per year for specific space type, provided in the Reference Table above.

ESF = Energy Savings factor (represents the percentage reduction to the operating Hours from the non-controlled baseline lighting system),

Table from Measure 4.5.10 Lighting Controls:

Lighting Control Type	Energy Savings Factor[1407]
Fixture Measurement of Control savings through Networked Trending	Custom

[1405] For closed refrigerated case lighting (open cases should use building type WHF), the value is 1.29 (calculated as (1 + (1.0 / 3.5))). Based on the assumption that all lighting in refrigerated cases is mechanically cooled, with a typical 3.5 COP refrigeration system efficiency, and assuming 100% of lighting heat needs to be mechanically cooled at time of summer peak. Assumes 3.5 COP for medium temp cases based on the average of standard reciprocating and discus compressor efficiencies with Saturated Suction Temperatures of 20°F and a condensing temperature of 90°F.

[1406] For closed freezer case lighting (open cases should use building type WHF), the value is 1.50 (calculated as (1 + (1.0 / 2.0))). Based on the assumption that all lighting in freezer cases is mechanically cooled, with a typical 2.0 COP freezer system efficiency, and assuming 100% of lighting needs to be mechanically cooled at time of summer peak. Assumes 2.0 COP for low temp cases based on the average of standard reciprocating and discus compressor efficiencies with Saturated Suction Temperatures of -20°F and a condensing temperature of 90°F.

[1407] Interior controls % savings based except where noted on LBNL, Williams et al, "Lighting Controls in Commercial Buildings", 2012, p172. ESF for Vacancy Sensors is based on Papamichael, Konstantions, Bi-Level Switching in Office Spaces, California Lighting Technology Center, February 1,2010. See Figure 8 on page 10 for relevant study results. The study shows a 30% extra savings above a typical occupancy sensor; 24% * 1.3 = 31%.
ESF for Luminaire Level Lighting Controls, and 10% High End Trim adder are based upon review of:

Lighting Control Type	Energy Savings Factor[1407]
Interior Occupancy Sensor (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	24% 37% with High End Trim
Interior Occupancy Sensor configured as "Vacancy Sensor" (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	31% 44% with High End Trim
Interior Daylight Sensor (Wall, Fixture or Remote Mounted)	28% 41% with High End Trim
Interior Dual Occupancy & Daylight Sensor (Integrated of Fixture Mounted)	38% 51% with High End Trim
Interior Networked Luminaire-Level Lighting Controls	61%
Interior Networked Lighting Controls Only with No LLLCs	35%
Interior Networked Lighting Controls (Unknown or mixed LLLCs)	49%
Refrigerated Case Occupancy Sensor – Freezer and Cooler	27%
Exterior Occupancy Sensor	41%
No Lighting Control	0%

Note, if a program is installing lighting fixtures *and* controls, the interactive effect should be accounted for by assuming fixture watt savings for full annual operating hours, control savings on efficient fixture.

Exterior Lighting Hours – dusk to business close

Hours = (6.19 * Days) + (%Adj * Days)

Where:

6.19 = Average hours per day between dusk and midnight[1408]

Days = Days of business operation

= Actual

%Adj = Percent adjustment dependent on hour closing[1409]

Business closes at	4pm	5pm	6pm	7pm	8pm	9pm	10pm	11pm	12pm	1am	2am	3am
%Adj	-619%	-604%	-564%	-500%	-400%	-300%	-200%	-100%	0%	100%	200%	300%

For example a business open until 8pm, 260 days per year, would assume:

Hours = (6.19 * 260) + (-400% * 260) = 569.4 hours

Pacific Northwest National Laboratory, "Evaluation of Advanced Lighting Control Systems in a Working Office Environment", November 2018.

Schuetter et al., "Cree SmartCast Lighting Retrofit Demonstration: LED Fixtures and Controls for Advanced Holistic Lighting Solutions", September 2020 (expected).

DesignLights Consortium and NEEA, "Energy Savings from Networked Lighting Control and Luminaire-level Lighting Control Systems: 2020 Update", 2020 (expected).

Refrigerated Case occupancy sensors ESF is based on percentage of operating hours spent in low-power operation during vacant periods, found in SDG&E workpaper: WPSDGENRLG0027.

Exterior sensors are based upon data from "Application Assessment of Bi-Level LED Parking Lot Lighting" p6.

[1408] Calculated using the eQuest model by finding the total number of hours of exterior lighting consumption between dusk and midnight and dividing by 365 (2261 / 365 = 6.19 hours per day).

[1409] See "IL TRM Ext Lighting.xlsx" for calculation.

4.5.1 Commercial ENERGY STAR Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8

4.5.2 Linear Delamping

DESCRIPTION

This measure addresses the permanent removal of existing linear lamps from fixtures where spaces are overlit. Unused lamps, lamp holders, and ballasts must be permanently removed from the fixture disposed of in accordance with local regulations.

Customers are responsible for determining whether or not to use reflectors in combination with lamp removal in order to maintain adequate lighting levels. Lighting levels are expected to meet the Illuminating Engineering Society of North America (IESNA) recommended light levels. A pre-approval application is required for lamp removal projects.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Savings are defined on a per removed lamp basis. The retrofit wattage (efficient conditioned) is therefore assumed to be zero. The savings numbers provided below are for the straight lamp removal measures, as well as the lamp removal and install reflector measures. The lamp installed/retrofit is captured in another measure.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is the linear lamp being removed (default wattages provided below). Note, if the program does not allow for the lamp type to be known, then a T12:T8:T5:LED weighting of 7%:49%:5%:38% can be applied.[1410]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 11 years per DEER 2005.

DEEMED MEASURE COST

The actual capital cost for removal of lamps should be used if possible. Defaults are provided in the table below:

Measure Category	Value	Source
8-Foot Lamp Removal	$16.00	ComEd/KEMA regression[1411]
4-Foot Lamp Removal	$12.00	ICF Portfolio Plan
8-Foot Lamp Removal with reflector	$30.00	KEMA Assumption
4-Foot Lamp Removal with reflector	$25.00	KEMA Assumption
2-Foot or 3-Foot Removal	$12.35	KEMA Assumption
2-Foot or 3-Foot Removal with reflector	$25.70	KEMA Assumption

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting

Loadshape C07 - Grocery/Conv. Store Indoor Lighting

Loadshape C08 - Hospital Indoor Lighting

Loadshape C09 - Office Indoor Lighting

Loadshape C10 - Restaurant Indoor Lighting

Loadshape C11 - Retail Indoor Lighting

Loadshape C12 - Warehouse Indoor Lighting

[1410] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024.
[1411] Based on the assessment of active projects in the 2008-09 ComEd Smart Ideas Program. See files "ltg costs 12-10-10.xl." and "Lighting Unit Costs 102605.doc".

Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * WHFe$$

Where:

WattsBase = Assume wattage reduction of lamp removed

= Actual. If unknown assume:

	Wattage of lamp removed[1412]				Weighted average
	T12	T8	T5	LED	7% T12, 49% T8, 5% T5, 38% LED
8-ft	60.3	38.6	33.8	27.0	35.1
4-ft	33.7	19.4	17.0	13.6	17.9
3-ft	40	14.6	12.8	10.2	14.5
2-ft	28	9.8	8.6	6.9	9.8

WattsEE = 0

ISR = In Service Rate or the percentage of units rebated that get installed.

=100% if application form completed with sign off that equipment permanently removed and disposed of.

Hours = Average hours of use per year are provided in Reference Table in Section 4.5. If unknown use the Miscellaneous value.

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

[1412] Default wattage reduction is based on averaging the savings from moving from a 2 to 1, 3 to 2 and 4 to 3 lamp fixture, as provided in the Standard Performance Contract Procedures Manual: Appendix B: Table of Standard Fixture Wattages, Version 3.0, SCE, March 2004. An adjustment is made to the T8 delamped fixture to account for the significant increase in ballast factor. See 'Delamping calculation.xls' for details. Defaults for T5 and linear LED lamps estimated by applying typical relative efficacy of 70 lu/watt for T8s, 80 lu/watt for T5s and 100 lu/watt for LED lamps.

For example, delamping a 4 ft T8 fixture in a mid rise office building:

ΔkWh =((19.4 - 0)/1,000) * 1.0 * 4439 * 1.17

= 100.8 kWh

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}{}^{1413} = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, delamping a 4 ft T8 fixture in a heat pump heated mid rise office building:

$\Delta kWh_{heatpenalty}$ =((19.4 - 0)/1,000) * 1.0 * 4439 * -0.104

=-9.0 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * WHFd * CF$$

Where:

WHFd = Waste heat factor for demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value..

CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value..

Other factors as defined above

For example, delamping a 4 ft T8 fixture in a mid rise office building:

ΔkW =((19.4 - 0)/1,000) * 1.0 * 1.62 * 0.6

= 0.019 kW

FOSSIL FUEL SAVINGS

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta Therms^{1414} = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Interation Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

[1413]Negative value because this is an increase in heating consumption due to the efficient lighting.

[1414] Negative value because this is an increase in heating consumption due to the efficient lighting.

Other factors as defined above

For example, delamping a 4 ft T8 fixture in an office building:

ΔTherms =((19.4 - 0)/1,000) * 1.0 * 4439 * -0.016

=-1.4 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-DLMP-V04-260101

REVIEW DEADLINE: 1/1/2030

4.5.3 High Performance and Reduced Wattage T8 Fixtures and Lamps – Retired 12/31/2025, Removed in v14

4.5.4 LED Bulbs and Fixtures

DESCRIPTION

This characterization provides savings assumptions for a variety of LED lamps including Omnidirectional (e.g., A-Type lamps), Decorative (e.g., Globes and Torpedoes), Directional (PAR Lamps, Reflectors, MR16), Mogul (E39, EX39), TLEDs and fixtures including refrigerated case, recessed and outdoor/garage fixtures.

If the implementation strategy does not allow for the installation location to be known, 100% Commercial targeted programs and 0% Residential targeted programs for LED Fixtures, Mogul LEDs and TLEDs should be used.[1415]

This measure was developed to be applicable to the following program types: TOS, NC, EREP, DI, KITS.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

For this characterization to apply, new lamps should meet performance specifications equivalent to EnergyStar Lamps V2.1 Specification, as amended (effective June 2, 2020). EnergyStar no longer lists new lamps as of December 31, 2024. Fixtures must meet current ENERGY STAR[1416] specifications where appropriate (Downlights v1.0 Final Specification and Luminaires v2.2 Final Specification) or be listed on the Design Lights Consortium Qualifying Product List.

DEFINITION OF BASELINE EQUIPMENT

The Standard Rx Program will assume a Time of Sale baseline for all one to one replacements, and early replacement for lighting redesign and early retirement for delamping.

For early replacement, the baseline is the existing fixture being replaced.

If the existing fixture is a T12: In July 14, 2012, Federal Standards were enacted that were expected to eliminate T-12s as an option for linear fluorescent fixtures. Through v3.0 of the TRM, it was assumed that the T-12 would no longer be baseline for retrofits from 1/1/2016. However, due to significant loopholes in the legislation, T-12 compliant product is still freely available and in Illinois T-12s continue to hold a significant share of the existing and replacement lamp market. From v8.0 on, a midlife adjustment is applied after the remaining useful life of the T12 fixture (calculated as 1/3 of the 40,000 hour ballast life/ hours). This assumes that T12 replacement lamps will continue to be available until then. See 'Early Replacement Measures with T12 baseline' section.

For Time of Sale, refer to the baseline tables at the end of this measure.

General Service Screw Based Lamps and ENERGY STAR fixtures: In 2012, Federal legislation stemming from the Energy Independence and Security Act of 2007 (EIAS) required all general-purpose light bulbs (defined as omni-directional or standard A-lamps) between 40 watts and 100 watts to have ~30% increased efficiency, essentially phasing out standard incandescent technology. In 2012, the 100 w lamp standards went in to effect followed by the 75 w lamp standards in 2013 and 60 w and 40 w lamps in 2014.

Additionally, an EISA backstop provision was included that would require replacement baseline lamps to meet an efficacy requirement of 45 lumens/watt or higher beginning on 1/1/2020.

However, in December 2019, DOE issued a final determination for General Service Incandescent Lamps (GSILs), finding that this more stringent standard was not economically justified. However, in May 2022 DOE reversed this decision by issuing a Final rule for both the broadened General Service Lamp definition as well as the implementation

[1415] Based on ComEd's Instant Discounts program CY2018, CY2019 and CY2020 (Rounds 1 and 2) Purchaser Survey analysis. See ComEd Instant Discounts Enduser Survey TRM Updates.xlsx. For Residential installations, hours of use assumptions from '5.5.6 LED Downlights' should be used for LED fixtures and '5.5.8 LED Screw Based Omnidirectional Bulbs' should be used for LED bulbs.

[1416] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.

of the 45 lumen per watt backstop. DOE stated that it will use its enforcement discretion to minimize impacts on the supply chain and effectively allow companies to continue the manufacture and import of noncompliant bulbs through the remainder of 2022, and allow retailers to continue selling them with limited enforcement until July 2023.

As of 1/1/2026, no savings are claimed for screw based LED lamps or ENERGY STAR fixtures due to the EISA backstop unless installed via direct install programs. Direct Install programs where it can be shown that the LED is replacing working inefficient lighting should continue to use the existing inefficient lighting as baseline and assume a measure life of 2 years.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

For interior fixtures, and Mogul LEDs, the lifetime is the life of the product, at the reported operating hours (lamp life in hours divided by operating hours per year – see reference table "LED component Costs and Lifetime"), capped at 15 years (GDS Measure Life Report, June 2007).

For exterior fixtures, the lifetime is the life of the product, at the reported operating hours (lamp life in hours divided by operating hours per year), capped at 25 years. Default lifetimes are assumed to be 16 years for Dusk-to-Dawn (4303 hours) applications, or 25 years for Dusk-to-Business-Close Year Round (1609 hours) and Dusk-to-Business-Close Seasonal (<1000 hours).[1417]

For lamps and LED Downlight Fixtures with a baseline impacted by the EISA backstop as indicated in tables below the measure life is assumed to be two years for direct install programs.

For lamps not impacted by the EISA backstop, the lifetime is calculated as the rated lifetime of the product (actual if available, otherwise assume 20,000 hours for Omnidirectional, 17,000 hours for decorative and 25,000 for directional lamps based on average rated life of lamps on the ENERGY STAR Qualified Products list (accessed 6/16/2020)) divided by the reported operating hours, capped at 10 years.[1418]

DEEMED MEASURE COST

Wherever possible, actual incremental costs should be used. Refer to reference table “LED component Cost & Lifetime” for defaults.

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting

[1417] Exterior fixture measure lives are based upon review of the typical rated life of the fixtures, divided by the hours of use assumption and applying a derating factor of 15% to account for potential impacts from external installation (as proposed in a Guidehouse EUL methodology recommendation for Street Lights).
[1418] Based on recommendation in the Dunsky Energy Consulting, Livingston Energy Innovations and Opinion Dynamics Corporation; NEEP Emerging Technology Research Report, p 6-18.

Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting
Loadshape C60 – Non-Residential Agriculture Lighting – 6 Hours
Loadshape C61 – Non-Residential Agriculture Lighting – 8 Hours
Loadshape C62 – Non-Residential Agriculture Lighting – 12 Hours
Loadshape C63 – Non-Residential Dairy Long Day Lighting – 17 Hours
Loadshape C64 – Non-Residential Agriculture Lighting – 24 Hours

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ((Watts_{base} - Watts_{EE})/1{,}000) * Hours * WHF_e * ISR * (1 - Leakage)$$

Where:

$Watts_{base}$ = Input wattage of the existing (for early replacement) or baseline system. Reference the "LED New and Baseline Assumptions" table for default values.

$Watts_{EE}$ = Actual wattage of LED purchased / installed. If unknown, use default provided below:

For ENERGY STAR rated lamps the following lumen equivalence tables should be used:[1419]

Omnidirectional Lamps - ENERGY STAR Minimum Luminous Efficacy = 80Lm/W for <90 CRI lamps and 70Lm/W for >=90 CRI lamps.

Minimum Lumens	Maximum Lumens	LED Wattage (WattsEE)	Baseline (WattsBase)	Delta Watts (WattsEE)	Impacted by EISA Backstop
120	309	4.0	25	21.0	No
310	399	4.0	25	21.0	Yes
400	749	6.6	29	22.4	Yes
750	899	9.6	43	33.4	Yes
900	1,399	13.1	53	39.9	Yes
1,400	1,999	16.0	72	56.0	Yes
2,000	2,999	21.8	150	128.2	Yes
3,000	3,299	28.9	200	171.1	Yes
3,300	3,999	28.9	200	171.1	No
4,000	5,000	35.7	300	264.3	No

[1419] See file "LED Lamp Updates 2021-06-09" for details on Guidehouse lamp wattage calculations based on equivalent baseline wattage and LED wattage of available ENERGY STAR product

Decorative Lamps - ENERGY STAR Minimum Luminous Efficacy = 65Lm/W for all lamps

Bulb Type	Minimum Lumens	Maximum Lumens	LED Wattage ($Watts_{EE}$)	Baseline ($Watts_{Base}$)	Delta Watts (WattsEE)	Impacted by EISA Backstop
Omni-Directional 3-Way	1,100	1,999	14.7	100	85.3	Yes
	2,000	2,700	22.6	150	127.4	Yes
Globe (medium and intermediate bases less than 750 lumens)	150	309	3.0	25	22	No
	310	349	3.0	25	22	Yes
	350	499	4.7	40	35.3	Yes
	500	574	5.7	60	54.3	Yes
	575	649	6.5	75	68.5	Yes
	650	1,000	8.2	100	91.8	Yes
Globe (candelabra bases less than 1050 lumens)	150	309	3.5	25	21.5	No
	310	349	3.5	25	21.5	Yes
	350	499	4.4	40	35.6	Yes
	500	574	5.5	60	54.5	Yes
Decorative (Shapes B, BA, C, CA, DC, F, G, medium and intermediate bases less than 750 lumens)	160	299	2.6	25	22.4	No
	300	309	4.3	40	35.7	No
	310	499	4.3	40	35.7	Yes
	500	800	5.8	60	54.2	Yes
Decorative (Shapes B, BA, C, CA, DC, F, G, T candelabra bases less than 1050 lumens)	120	159	1.5	15	13.5	No
	160	299	2.7	25	22.3	No
	300	309	4.2	40	35.8	No
	310	499	4.2	40	35.8	Yes
	500	650	5.5	60	54.5	Yes
Decorative (Shape ST)	250	309	6.5	40	33.5	No
	310	499	6.5	40	33.5	Yes
	500	999	8.8	60	51.2	Yes
	1000	1500	10.0	100	90.0	Yes
Decorative (Shape S)	50	75	1.0	11	10.0	No
	100	120	1.2	15	13.8	No
	120	309	2.25	25	22.8	No
	310	340	2.25	25	22.8	Yes

Directional Lamps - ENERGY STAR Minimum Luminous Efficacy = 70Lm/W for <90 CRI lamps and 61 Lm/W for >=90CRI lamps.

For Directional R, BR, ER, PAR, MR and MRX lamp types. Note the Center Beam Candle Power (CBCP) methodology described below the default table is the preferred methodology for PAR, MR and MRX lamps and should be used where data allows. Defaults for use when this information is not available are provided below:

Bulb Type	Minimum Lumens	Maximum Lumens	LED Wattage ($Watts_{EE}$)	Baseline ($Watts_{Base}$)	Delta Watts (WattsEE)	Impacted by EISA Backstop
Reflector lamp types with medium screw bases (PAR20, PAR30(S,L), PAR38, R40, etc.) w/ diameter >2.25" (*see exceptions below)	400	649	7.0	50	43	Yes
	650	899	10.7	75	64.3	Yes
	900	1,049	13.9	90	76.1	Yes
	1,050	1,199	13.8	100	86.2	Yes
	1,200	1,499	15.9	120	104.1	Yes
	1,500	1,999	18.9	150	131.1	Yes
	2,000	3,299	27.3	250	222.7	Yes
	3,300	4,200	27.3	250	222.7	No
Reflector lamp types with medium screw bases (PAR16, R14, R16, etc.) w/ diameter <2.25" (*see exceptions below)	280	309	4.6	35	30.4	No
	310	374	4.6	35	30.4	Yes
	375	600	6.4	50	43.6	Yes
*BR30, BR40, or ER40	650	949	9.3	65	55.7	Yes
	950	1,099	12.7	75	62.3	Yes
	1,100	1,399	14.4	85	70.6	Yes
	1,400	1,600	16.6	100	83.4	Yes
	1,601	1,800	22.2	120	97.8	Yes
*R20	450	524	6.0	40	34.0	Yes
	525	750	7.1	45	37.9	Yes
*MR16	250	309	3.8	20.0	16.2	No
	310	324	3.8	20.0	16.2	Yes
	325	369	4.8	25.0	20.2	Yes
	370	400	4.9	25.0	20.1	Yes

For PAR, MR, and MRX Lamps Types:

For these highly focused directional lamp types, it is necessary to have Center Beam Candle Power (CBCP) and beam angle measurements to accurately estimate the equivalent baseline wattage. The formula below is based on the Energy Star Center Beam Candle Power tool.[1420] If CBCP and beam angle information are not available or if the equation below returns a negative value (or undefined), use the manufacturer's recommended baseline wattage equivalent.[1421]

$$\text{Wattsbase} = 375.1 - 4.355(D) - \sqrt{227{,}800 - 937.9(D) - 0.9903(D^2) - 1479(BA) - 12.02(D * BA) + 14.69(BA^2) - 16{,}720 * \ln(CBCP)}$$

Where:

D = Bulb diameter (e.g. for PAR20 D = 20)

BA = Beam angle

[1420] ENERGY STAR Lamps Center Beam Intensity Benchmark Tool and Calculator

[1421] The Energy Star Center Beam Candle Power tool does not accurately model baseline wattages for lamps with certain bulb characteristic combinations – specifically for lamps with very high CBCP.

CBCP = Center beam candle power

The result of the equation above should be rounded DOWN to the nearest wattage established by Energy Star:

Diameter	Permitted Wattages
16	20, 35, 40, 45, 50, 60, 75
20	50
30S	40, 45, 50, 60, 75
30L	50, 75
38	40, 45, 50, 55, 60, 65, 75, 85, 90, 100, 120, 150, 250

Additional bulb types:

Bulb Type	Minimum Lumens	Maximum Lumens	LED Wattage ($Watts_{EE}$)	Baseline ($Watts_{Base}$)	Delta Watts (WattsEE)	Impacted by EISA Backstop
Dimmable Twist, Globe (less than 5" in diameter and > 749 lumens), candle (shapes B, BA, CA > 749 lumens), Candelabra Base Lamps (>1049 lumens), Intermediate Base Lamps (>749 lumens)	120	309	4.0	25	21.0	No
	310	399	4.0	25	21.0	Yes
	400	749	6.6	29	22.4	Yes
	750	899	9.6	43	33.4	Yes
	900	1,399	13.1	53	39.9	Yes
	1,400	1,999	16.0	72	56.0	Yes

Hours = Average hours of use per year are provided in the Reference Table in Section 4.5 for each building type. For Mogul LEDs, use fixture annual operating hours. If unknown, use the Miscellaneous value.

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in the Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

ISR = In Service Rate -the percentage of units rebated that actually get installed.

=100% if application form completed with sign off that equipment is not placed into storage.[1422] If sign off form not completed, assume the following ISR assumptions, if program survey data is not available:

[1422] Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an “In-Service Rate” when commercial customers complete an application form.

Type	Lifetime In Service Rate (ISR)[1423]
LED Bulbs	97.6%[1424]
Mogul LEDs	97.9%[1425]
LED Fixtures (Energy Star Fixtures)	97.9%[1426]
Efficiency Kits	92.4%[1427]

Type	Weighted Average 1st year In Service Rate (ISR)	2nd year Installations	3rd year Installations	Final Lifetime In Service Rate
TLEDs	83.1%[1428]	8.1%	6.8%	98.0%

Leakage = Adjustment to account for the percentage of program bulbs that move out (and in if deemed appropriate)[1429] of the Utility Jurisdiction.

Midstream (TOS) Lighting programs = Use deemed assumptions below:[1430]

ComEd: 0.31%

Ameren: 0%[1431]

All other programs = 0%

[1423] In Service Rates now represent the lifetime In Service Rates with the second and third year installations discounted by the Real Discount Rate of 0.46%. Lifetime ISR assumptions for efficiency kits are based upon Residenital direct mailed kits. For all other programs Tthe 98% Lifetime ISR assumption is based upon the standard CFL measure in the absence of any better reference. This value is based upon review of two evaluations:
'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3.

[1424] Based on ComEd's Instant Discounts program CY2019 and CY2020 (Rounds 1 and 2) Purchaser Survey analysis. See ComEd Instant Discounts Enduser Survey TRM Updates.xlsx

[1425] Based on survey data from participants in AIC's 2022 Midstream Lighting channel. See AIC Midstream Lighting – Mogul ISR Calculations.xlsx

[1426] Based on ComEd's Instant Discounts program CY2019 and CY2020 (Rounds 1 and 2) Purchaser Survey analysis. See ComEd Instant Discounts Enduser Survey TRM Updates.xlsx

[1427] First year ISR is average ISR from CY2018, CY2019 and CY2020 ComEd Small Business Kit participant installation surveys. Please see file "SB Kits Survey Analysis TRMv10 Support.xlsx"

[1428] Based on ComEd's Instant Discounts program CY2019 and CY2020 (Rounds 1 and 2) Purchaser Survey analysis. See ComEd Instant Discounts Enduser Survey TRM Updates.xlsx

[1429] Leakage in is only appropriate to credit to IL utility program savings if it is reasonably expected that the IL utility program marketing efforts played an important role in influencing customer to purchase the light bulbs. Furthermore, consideration that such customers might be free riders should be addressed. If leakage in is assessed, efforts should be made to ensure no double counting of savings occurs if the evaluation is estimating both leakage in and spillover savings of light bulbs.

[1430] Leakage rate is based upon review of PY9-CY2021 evaluations from ComEd.

[1431] Per Ameren staff, all incentivized non-residential LED bulbs and fixtures are required to show proof of being an Ameren customer and thus the leakage is 0%.

Mid Life Baseline Adjustment

Early Replacement Measures with T12 Baseline

For early replacement measures replacing existing T12 fixtures the full savings (as calculated above in the Algorithm section) will be claimed for the remaining useful life of the T12 fixture. This should be calculated as follows:

RUL of existing T12 fixture = $(1/3 * 40{,}000)/Hours$

A savings adjustment should then be applied to the annual savings for the remainder of the measure life. The adjustment factor to be applied for each T12 installation is 57%.[1432]

For example, for an existing 68W T12 fixture in a college is replaced by a 3000 lumen LED 2x2 Recessed Light Fixture (25.4W), a mid life adjustment of 57% should be applied after (1/3 * 40000)/3395 = 3.9 years.

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}{}^{1433} = (((WattsBase - WattsEE)/1000) * ISR * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, a 9W LED omnidirectional lamp, 450 lumens, is installed in a heat pump heated mid rise office and sign off form provided:

$\Delta kWh_{heatpenalty}$ = ((29-6.7)/1,000)*1.0*3088* -0.164

= - 11.3 kWh

DEFERRED INSTALLS

As presented above, if a sign off form is not completed the characterization assumes that a percentage of T-LED bulbs purchased are not installed until Year 2 and Year 3 (see ISR assumption above). The Illinois Technical Advisory Committee has determined the following methodology for calculating the savings of these future installs.

Year 1 (Purchase Year) installs: Characterized using assumptions provided above or evaluated assumptions if available.

Year 2 and 3 installs: Characterized using delta watts assumption and hours of use from the Install Year, i.e., the actual deemed (or evaluated if available) assumptions active in Year 2 and 3 should be applied.

The NTG factor for the Purchase Year should be applied.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = ((Watts_{base} - Watts_{EE})/1{,}000) * ISR * WHF_d * CF$$

[1432] The appropriate T12 midlife adjustment factor was developed by the TAC Lighting Working Group. The results of a 2019 ComEd study provided survey response data on the planned replacement upon the burnout of a T12 ballast. This was adjusted by first year NTG to remove first year freeriders and therefore estimate what the non-freerider population would do at the end of T12 life. See "Linear Forecast Workbook_2020.xls" for information on calculation.

[1433] Negative value because this is an increase in heating consumption due to the efficient lighting.

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, a 9W LED omnidirectional lamp, 450 lumens, is installed in a mid rise office and sign off form provided:

ΔkW = ((29-6.7)/1,000)* 1.0*1.3*0.6
= 0.017 kW

FOSSIL FUEL SAVINGS

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta\text{Therms} = ((Watts_{Base} - Watts_{EE})/1000) * ISR * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, a 9W LED omnidirectional lamp, 450 lumens, is installed in a mid rise office and sign off form provided:

ΔTherms = ((29-6.7)/1,000)*1.0*3088* -0.016
= - 1.10 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

For fixture measures, the individual component lifetimes and costs are provided in the reference table section below.[1434]

For lamps no O&M costs should be applied.

Reference Tables

LED Bulb Assumptions

Wherever possible, actual incremental costs should be used. If unavailable assume the following incremental costs:[1435]

Bulb Type	Year	LED	Incandescent	Incremental Cost
Omnidirectional	2017	$3.21	$1.25	$1.96
	2018	$3.21		$1.96

[1434] See IL LED Lighting Systems TRM Reference Tables_2018.xlsx for breakdown of component cost assumptions.
[1435] Baseline and LED lamp costs are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis. Given LED prices are expected to continue declining assumed costs should be reassessed on an annual basis and replaced with IL specific LED program information when available.

Bulb Type	Year	LED	Incandescent	Incremental Cost
	2019	$3.11		$1.86
	2020	$2.70		$1.45
Directional	2017	$6.24	$3.53	$2.71
	2018+	$5.18		$1.65
Decorative and Globe	2017	$3.50	$1.60	$1.90
	2018+	$3.40	$1.74	$1.66

LED Fixture Wattage, TOS Baseline and Incremental Cost Assumptions[1436]

LED Category	EE Measure Description	$Watts_{EE}$	Baseline Description	$Watts_{BASE}$	Incremental Cost
LED Downlight Fixtures* Impacted by EISA Backstop – apply 2 year measure life (or 8 years if IQ)	LED Recessed, Surface, Pendant Downlights	17.6	Baseline Recessed, Surface, Pendant Downlights	54.3	$27
LED Interior Directional	LED Track Lighting	12.2	Baseline Track Lighting	60.4	$59
	LED Wall-Wash Fixtures	8.3	Baseline Wall-Wash Fixtures	17.7	$59
LED Display Case[1437]	LED Display Case Light Fixture	4 per ft	Baseline Display Case Light Fixture	36.2 per ft	$11/ft
	LED Undercabinet Shelf-Mounted Task Light Fixtures	4 per ft	Baseline Undercabinet Shelf-Mounted Task Light Fixtures	36.2 per ft	$11/ft
	LED Refrigerated Case Light, Horizontal or Vertical	4 per ft	Baseline Refrigerated Case Light, Horizontal or Vertical (per foot)	15.2 per ft	$11/ft
	LED Freezer Case Light, Horizontal or Vertical	4 per ft	Baseline Freezer Case Light, Horizontal or Vertical (per foot)	18.7 per ft	$11/ft

[1436] Watt assumptions for efficient measures are based upon the average wattage of each fixture type/lumen range from the Design Light Consortium (DLC) Qualifying Product Lists alongside past Efficiency Vermont projects and PGE refrigerated case study. Watt, lumen, lamp life, and ballast factor assumptions for baseline fixtures are based upon manufacturer specification sheets. Baseline cost data comes from lighting suppliers, past Efficiency Vermont projects, and professional judgment. Efficient cost data comes from 2012 DOE "Energy Savings Potential of Solid-State Lighting in General Illumination Applications", Table A.1. See "LED Lighting Systems TRM Reference Tables_2018.xlsx" for more information and specific product links. For v15 a temporary 14% efficacy improvement is applied to all DLC categories to account for the new DLC rating v6.0. During the 2026 update cycle there was not sufficient numbers of fixtures rated at this standard to allow category specific updates, therefore a standard efficacy improvement was applied consistent with the 14% average described on the DLC website. A more comprehensive review will be performed in 2027.

[1437] LED Case Lighting is based on an average of DLC Horizontal and Vertical Lighting less than 80 W. This filter was intended to exclude vaportight fixtures from the average. The horizontal and vertical averages, provided by Guidehouse in 5/2020, were 4.1 W/ft and 3.7 W/ft, respectively.

LED Category	EE Measure Description	$Watts_{EE}$	Baseline Description	$Watts_{BASE}$	Incremental Cost
LED Linear Replacement Lamps	T8 LED Replacement Lamp (TLED), < 1200 lumens	7.5	F17T8 Standard Lamp - 2 foot	15.0	$13
	T8 LED Replacement Lamp (TLED), 1200-2400 lumens	12.0	F32T8 Standard Lamp - 4 foot	28.2	$15
	T8 LED Replacement Lamp (TLED), > 2400 lumens	21.7	F32T8/HO Standard Lamp - 4 foot	41.8	$13
LED Troffers	LED 2x2 Recessed Light Fixture, 2000-3500 lumens	19.6	2-Lamp 32w T8 (BF < 0.89)	57.0	$53
	LED 2x2 Recessed Light Fixture, 3501-5000 lumens	30.0	3-Lamp 32w T8 (BF < 0.88)	84.5	$69
	LED 2x4 Recessed Light Fixture, 3000-4500 lumens	26.2	2-Lamp 32w T8 (BF < 0.89)	57.0	$55
	LED 2x4 Recessed Light Fixture, 4501-6000 lumens	36.9	3-Lamp 32w T8 (BF < 0.88)	84.5	$76
	LED 2x4 Recessed Light Fixture, 6001-7500 lumens	45.2	4-Lamp 32w T8 (BF < 0.88)	112.6	$104
	LED 1x4 Recessed Light Fixture, 1500-3000 lumens	16.8	1-Lamp 32w T8 (BF <0.91)	29.1	$22
	LED 1x4 Recessed Light Fixture, 3001-4500 lumens	27.0	2-Lamp 32w T8 (BF < 0.89)	57.0	$75
	LED 1x4 Recessed Light Fixture, 4501-6000 lumens	35.3	3-Lamp 32w T8 (BF < 0.88)	84.5	$83
LED Linear Ambient Fixtures	LED Surface & Suspended Linear Fixture, <= 3000 lumens	15.4	1-Lamp 32w T8 (BF <0.91)	29.1	$10
	LED Surface & Suspended Linear Fixture, 3001-4500 lumens	24.6	2-Lamp 32w T8 (BF < 0.89)	57.0	$52
	LED Surface & Suspended Linear Fixture, 4501-6000 lumens	34.4	3-Lamp 32w T8 (BF < 0.88)	84.5	$78
	LED Surface & Suspended Linear Fixture, 6001-7500 lumens	43.8	T5HO 2L-F54T5HO - 4'	120.0	$131

LED Category	EE Measure Description	$Watts_{EE}$	Baseline Description	$Watts_{BASE}$	Incremental Cost
	LED Surface & Suspended Linear Fixture, > 7500 lumens	79.5	T5HO 3L-F54T5HO - 4'	180.0	$173
LED High & Low Bay Fixtures	LED Low-Bay Fixtures, <= 10,000 lumens	45.4	3-Lamp T8HO Low-Bay	157.0	$42.88
	LED High-Bay Fixtures, 10,001-15,000 lumens	78.2	4-Lamp T8HO High-Bay	196.0	$31.94
	LED High-Bay Fixtures, 15,001-20,000 lumens	103.9	6-Lamp T8HO High-Bay	294.0	$61.17
	LED High-Bay Fixtures, 20,001-30,000 lumens	150.4	8-Lamp T8HO High-Bay	392.0	$51.11
	LED High-Bay Fixtures, 30,001-40,000 lumens	202.2	750 Watts Metal Halide	850	$113.60
	LED High-Bay Fixtures 40,001-50,000 lumens	268.6	1000 Watts Metal Halide	1080	$166.55
	LED High-Bay Fixtures >50,000 lumens	389.2	1500 Watts Metal Halide	1610	$283.67
LED Agricultural Interior Fixtures	LED Ag Interior Fixtures, <= 2,000 lumens	11.3	1-Lamp 32w T8 (BF <0.91)	29.1	$18
	LED Ag Interior Fixtures, 2,001-4,000 lumens	26.1	2-Lamp 32w T8 (BF < 0.89)	57	$48
	LED Ag Interior Fixtures, 4,001-6,000 lumens	39.6	25% 217 Watt EISA Inc, 75% 3L T8	121.0	$57
	LED Ag Interior Fixtures, 6,001-8,000 lumens	52.4	25% 292 Watt EISA Inc, 75% 4L T8	159.0	$88
	LED Ag Interior Fixtures, 8,001-12,000 lumens	74.5	200W Pulse Start Metal Halide	227.3	$168
	LED Ag Interior Fixtures, 12,001-16,000 lumens	99.9	320W Pulse Start Metal Halide	363.6	$151
	LED Ag Interior Fixtures, 16,001-20,000 lumens	126.1	350W Pulse Start Metal Halide	397.7	$205
	LED Ag Interior Fixtures, > 20,000 lumens	170.0	(2) 320W Pulse Start Metal Halide	727.3	$356

LED Category	EE Measure Description	$Watts_{EE}$	Baseline Description	$Watts_{BASE}$	Incremental Cost
LED Exterior Fixtures	LED Exterior Fixtures, <= 5,000 lumens	24.1	100W Metal Halide	113.6	$97
	LED Exterior Fixtures, 5,001-10,000 lumens	50.5	175W Pulse Start Metal Halide	198.9	$123.81
	LED Exterior Fixtures, 10,001-15,000 lumens	83.2	250W Pulse Start Metal Halide	284.1	$134.35
	LED Exterior Fixtures, 15,001-30,000 lumens	141.5	400W Pulse Start Metal Halide	454.5	$196.16
	LED Exterior Fixtures, 30,001-40,000 lumens	222.7	750 W Metal Halide	850	$238.18
	LED Exterior Fixtures, 40,001-50,000 lumens	280.4	1000 W Metal Halide	1080	$319.31
	LED Exterior Fixtures, > 50,000 lumens	513.9	1500 W Metal Halide	1610	$1094.74
LED Mogul Base HID Replacement Lamps (if unknown, assume Type B)	LED Mogul Base HID Replacement Lamp, <= 5,000 lumens	27.2	100W Metal Halide	100 (Type A) 113.6 (Type B)	$68
	LED Mogul Base HID Replacement Lamp, 5,001-10,000 lumens	56.1	175W Pulse Start Metal Halide	175 (Type A) 198.9 (Type B)	$60
	LED Mogul Base HID Replacement Lamp, 10,001-15,000 lumens	88.6	250W Pulse Start Metal Halide	250 (Type A) 284.1 (Type B)	$129
	LED Mogul Base HID Replacement Lamp, 15,001-30,000 lumens	123.7	400W Pulse Start Metal Halide	400 (Type A) 454.5 (Type B)	$156
	LED Mogul Base HID Replacement Lamp, 30,001-40,000 lumens	207.0	750 W Metal Halide	750 (Type A) 850 (Type B)	$446
	LED Mogul Base HID Replacement Lamp, > 40,000 lumens	258.8	1000 W Metal Halide	1000 (Type A) 1080 (Type B)	$629

LED Fixture Component Costs & Lifetime[1438]

		EE Measure				Baseline			
LED Category	EE Measure Description	Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
LED Downlight Fixtures	LED Recessed, Surface, Pendant Downlights	50,000	$30.75	70,000	$47.50	2,500	$8.86	40,000	$14.40
LED Interior Directional	LED Track Lighting	50,000	$39.00	70,000	$47.50	2,500	$12.71	40,000	$11.00
	LED Wall-Wash Fixtures	50,000	$39.00	70,000	$47.50	2,500	$9.17	40,000	$27.00
LED Display Case	LED Display Case Light Fixture	50,000	$9.75/ft	70,000	$11.88/ft	2,500	$6.70	40,000	$5.63
	LED Undercabinet Shelf-Mounted Task Light Fixtures	50,000	$9.75/ft	70,000	$11.88/ft	2,500	$6.70	40,000	$5.63
	LED Refrigerated Case Light, Horizontal or Vertical	50,000	$8.63/ft	70,000	$9.50/ft	15,000	$1.13	40,000	$8.00
	LED Freezer Case Light, Horizontal or Vertical	50,000	$7.88/ft	70,000	$7.92/ft	12,000	$0.94	40,000	$6.67
LED Linear Replacement Lamps	T8 LED Replacement Lamp (TLED), < 1200 lumens	50,000	$5.76	70,000	$13.67	30,000	$6.17	40,000	$11.96
	T8 LED Replacement Lamp (TLED), 1200-2400 lumens	50,000	$8.57	70,000	$13.67	24,000	$6.17	40,000	$11.96
	T8 LED Replacement Lamp (TLED), > 2400 lumens	50,000	$8.57	70,000	$13.67	18,000	$6.17	40,000	$11.96
LED Troffers	LED 2x2 Recessed Light Fixture, 2000-3500 lumens	50,000	$78.07	70,000	$40.00	24,000	$26.33	40,000	$35.00

[1438] Note that some measures have blended baselines (T12:T8 18:82). All values are provided to enable calculation of appropriate O&M impacts. Total costs include lamp, labor and disposal cost assumptions where applicable, see IL LED Lighting Systems TRM Reference Tables_2018.xlsx for more information.

		EE Measure				Baseline			
LED Category	EE Measure Description	Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
	LED 2x2 Recessed Light Fixture, 3501-5000 lumens	50,000	$89.23	70,000	$40.00	24,000	$39.50	40,000	$35.00
	LED 2x4 Recessed Light Fixture, 3000-4500 lumens	50,000	$96.10	70,000	$40.00	24,000	$12.33	40,000	$35.00
	LED 2x4 Recessed Light Fixture, 4501-6000 lumens	50,000	$114.37	70,000	$40.00	24,000	$18.50	40,000	$35.00
	LED 2x4 Recessed Light Fixture, 6001-7500 lumens	50,000	$137.43	70,000	$40.00	24,000	$24.67	40,000	$35.00
	LED 1x4 Recessed Light Fixture, 1500-3000 lumens	50,000	$65.43	70,000	$40.00	24,000	$6.17	40,000	$35.00
	LED 1x4 Recessed Light Fixture, 3001-4500 lumens	50,000	$100.44	70,000	$40.00	24,000	$12.33	40,000	$35.00
	LED 1x4 Recessed Light Fixture, 4501-6000 lumens	50,000	$108.28	70,000	$40.00	24,000	$18.50	40,000	$35.00
LED Linear Ambient Fixtures	LED Surface & Suspended Linear Fixture, <= 3000 lumens	50,000	$62.21	70,000	$40.00	24,000	$6.17	40,000	$35.00
	LED Surface & Suspended Linear Fixture, 3001-4500 lumens	50,000	$93.22	70,000	$40.00	24,000	$12.33	40,000	$35.00
	LED Surface & Suspended Linear Fixture, 4501-6000 lumens	50,000	$114.06	70,000	$40.00	24,000	$18.50	40,000	$35.00
	LED Surface & Suspended Linear Fixture, 6001-7500 lumens	50,000	$152.32	70,000	$40.00	30,000	$26.33	40,000	$60.00
	LED Surface & Suspended Linear Fixture, > 7500 lumens	50,000	$183.78	70,000	$40.00	30,000	$39.50	40,000	$60.00

		EE Measure				Baseline			
LED Category	EE Measure Description	Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
LED High & Low Bay Fixtures	LED Low-Bay Fixtures, <= 10,000 lumens	50,000	$90.03	70,000	$62.50	18,000	$64.50	40,000	$92.50
	LED High-Bay Fixtures, 10,001-15,000 lumens	50,000	$122.59	70,000	$62.50	18,000	$86.00	40,000	$92.50
	LED High-Bay Fixtures, 15,001-20,000 lumens	50,000	$157.22	70,000	$62.50	18,000	$129.00	40,000	$117.50
	LED High-Bay Fixtures, 20,001 – 30,000 lumens	50,000	$228.52	70,000	$62.50	18,000	$172.00	40,000	$142.50
	LED High-Bay Fixtures, 30,001-40,000 lumens	50,000	$294.00	70,000	$62.50	15,000	$82.00	40,000	$143.00
	LED High-Bay Fixtures, 40,001-50,000 lumens	50,000	$324.00	70,000	$62.50	15,000	$88.00	40,000	$149.00
	LED High-Bay Fixtures, > 50,000 lumens	50,000	$382.00	70,000	$62.50	15,000	$96.00	40,000	$200.00
LED Agricultural Interior Fixtures	LED Ag Interior Fixtures, <= 2,000 lumens	50,000	$41.20	70,000	$40.00	1,000	$1.23	40,000	$26.25
	LED Ag Interior Fixtures, 2,001-4,000 lumens	50,000	$65.97	70,000	$40.00	1,000	$1.43	40,000	$26.25
	LED Ag Interior Fixtures, 4,001-6,000 lumens	50,000	$80.08	70,000	$40.00	1,000	$1.62	40,000	$26.25
	LED Ag Interior Fixtures, 6,001-8,000 lumens	50,000	$105.54	70,000	$40.00	1,000	$1.81	40,000	$26.25
	LED Ag Interior Fixtures, 8,001-12,000 lumens	50,000	$179.81	70,000	$62.50	15,000	$63.00	40,000	$112.50

		EE Measure				Baseline			
LED Category	EE Measure Description	Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
	LED Ag Interior Fixtures, 12,001-16,000 lumens	50,000	$190.86	70,000	$62.50	15,000	$68.00	40,000	$122.50
	LED Ag Interior Fixtures, 16,001-20,000 lumens	50,000	$237.71	70,000	$62.50	15,000	$73.00	40,000	$132.50
	LED Ag Interior Fixtures, > 20,000 lumens	50,000	$331.73	70,000	$62.50	15,000	$136.00	40,000	$202.50
LED Exterior Fixtures	LED Exterior Fixtures, <= 5,000 lumens	70,000	$73.80	70,000	$62.50	15,000	$58.00	40,000	$102.50
	LED Exterior Fixtures, 5,001-10,000 lumens	70,000	$124.89	70,000	$62.50	15,000	$63.00	40,000	$112.50
	LED Exterior Fixtures, 10,001-15,000 lumens	70,000	$214.95	70,000	$62.50	15,000	$68.00	40,000	$122.50
	LED Exterior Fixtures, 15,000-30,000 lumens	70,000	$321.06	70,000	$62.50	15,000	$73.00	40,000	$132.50
	LED Exterior Fixtures, 30,001-40,000 lumens	70,000	$546.00	70,000	$62.50	15,000	$82.00	40,000	$143.00
	LED Exterior Fixtures, 40,001-50,000 lumens	70,000	$722.00	70,000	$62.50	15,000	$88.00	40,000	$149.00
	LED Exterior Fixtures, > 50,000 lumens	70,000	$870.00	70,000	$62.50	15,000	$96.00	40,000	$200.00
LED Mogul Base HID Replacement Lamps	LED Mogul Base HID Replacement Lamp, <= 5,000 lumens	50,000	$108.00	70,000	$62.50	15,000	$40.00	40,000	$92.50
	LED Mogul Base HID Replacement Lamp, 5,001-10,000 lumens	50,000	$99.00	70,000	$62.50	15,000	$39.00	40,000	$92.50

		EE Measure				Baseline			
LED Category	EE Measure Description	Lamp Life (hrs)	Total Lamp Replacement Cost	LED Driver Life (hrs)	Total LED Driver Replacement Cost	Lamp Life (hrs)	Total Lamp Replacement Cost	Ballast Life (hrs)	Total Ballast Replacement Cost
	LED Mogul Base HID Replacement Lamp, 10,001-15,000 lumens	50,000	$179.00	70,000	$62.50	15,000	$50.00	40,000	$117.50
	LED Mogul Base HID Replacement Lamp, 15,001-30,000 lumens	50,000	$210.00	70,000	$62.50	15,000	$54.00	40,000	$142.50
	LED Mogul Base HID Replacement Lamp, 30,001-40,000 lumens	50,000	$514.00	70,000	$62.50	15,000	$68.00	40,000	$143.00
	LED Mogul Base HID Replacement Lamp, > 40,000 lumens	50,000	$707.00	70,000	$62.50	15,000	$78.00	40,000	$149.00

MEASURE CODE: CI-LTG-LEDB-V20-270101

REVIEW DEADLINE: 1/1/2028

4.5.5 Commercial LED Exit Signs

DESCRIPTION

This measure characterizes the savings associated with installing a Light Emitting Diode (LED) exit sign in place of a fluorescent or incandescent exit sign in a Commercial building. Light Emitting Diode exit signs have a string of very small, typically red or green, glowing LEDs arranged in a circle or oval. The LEDs may also be arranged in a line on the side, top or bottom of the exit sign. LED exit signs provide the best balance of safety, low maintenance, and very low energy usage compared to other exit sign technologies.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be an exit sign illuminated by LEDs.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an existing fluorescent or incandescent model.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 5 years.[1439]

DEEMED MEASURE COST

The actual material and labor costs should be used if available. If actual costs are unavailable, assume a total installed cost of at $32.50.[1440]

LOADSHAPE

Loadshape C53 - Flat

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 100%.[1441]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ((WattsBase - WattsEE) / 1{,}000) * HOURS * WHF_e$$

Where:

WattsBase = Actual wattage if known, if unknown assume the following:

Baseline Type	$Watts_{Base}$
Incandescent	35W[1442]
CFL (dual sided)	14W[1443]
CFL (single sided)	7W
Unknown	7W

[1439] Estimate of remaining life of existing unit being replaced.
[1440] Price includes new exit sign/fixture and installation. LED exit sign cost/unit is $22.50 based on the NYSERDA Deemed Savings Database and review of LED exit signs available as of April 2023, and assuming IL labor cost of 15 minutes @ $40/hr.
[1441] Assuming continuous operation of an LED exit sign, the Summer Peak Coincidence Factor is assumed to equal 1.0.
[1442] Based on review of available product.
[1443] Average CFL single sided (5W, 7W, 9W) from Appendix B 2013-14 Table of Standard Fixture Wattages.

WattsEE = Actual wattage if known, if unknown assume 2W for single sided or unknown type and 4W for dual sided[1444]

HOURS = Annual operating hours

= 8,766

WHF_e = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided for each building type in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, replacing incandescent fixture in a mid rise office:

ΔkWH = ((35 – 2)/1,000) * 8766 * 1.17

= 338 kWh

Replacing single sided fluorescent fixture in a hospital with CAV economizer:

ΔkWH = ((7– 2)/1,000) * 8766 * 1.30

= 57.0 kWh

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}[1445] = (((WattsBase - WattsEE)/1{,}000) * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, replacing incandescent fixture in a heat pump heated mid rise office:

$\Delta kWh_{heatpenalty}$ = ((35 – 2)/1,000) * 8,766 * -0.104

= -30.1 kWh

Replacing single sided fluorescent fixture in a heat pump heated hospital with CAV economizer:

$\Delta kWh_{heatpenalty}$ = ((7 – 2)/1,000) * 8,766 * -0.099

= -4.3 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = ((WattsBase - WattsEE) / 1{,}000) * WHF_d * CF$$

Where:

WHF_d = Waste heat factor for demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

CF = Summer Peak Coincidence Factor for measure

= 1.0

[1444] Average LED single sided (2W) from Appendix B 2013-14 Table of Standard Fixture Wattages.

[1445] Negative value because this is an increase in heating consumption due to the efficient lighting.

For example, replacing incandescent fixture in a mid rise office:

ΔkW = ((35 – 2)/1,000) * 1.36 * 1.0

= 0.045 kW

Replacing single sided fluorescent fixture in a hospital with CAV economizer:

ΔkW = ((7 – 2)/1,000) * 1.27 * 1.0

= 0.0064 kW

FOSSIL FUEL SAVINGS

Heating Penalty if natural gas heated building (or if heating fuel is unknown):

$$\Delta\text{therms} = ((WattsBase - WattsEE)/1000) * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, replacing incandescent fixture in a mid rise office:

ΔTherms = ((35 – 2)/1,000) * 8,766 * -0.016

= -4.63 Therms

Replacing single sided fluorescent fixture in a hospital with CAV economizer:

ΔTherms = ((7 – 2)/1,000) * 8,766 * -0.009

= - 0.39 Therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

The annual O&M Cost Adjustment savings should be calculated using the following component costs and lifetimes.

	Baseline Measures	
Component	Cost	Life (yrs)
Lamp	$12.45[1446]	1.37 years[1447]

MEASURE CODE: CI-LTG-LEDE-V05-250101

REVIEW DEADLINE: 1/1/2028

[1446] Consistent with assumption for a Standard CFL bulb ($2.45) with an estimated labor cost of $10 (assuming $40/hour and a task time of 15 minutes).

[1447] Assumes a lamp life of 12,000 hours and 8766 run hours 12000/8766 = 1.37 years.

4.5.6 LED Traffic and Pedestrian Signals – Retired 12/31/2026, Removed in v15

4.5.7 Lighting Power Density

DESCRIPTION

This measure relates to installation of efficient lighting systems in new construction or substantial renovation of commercial buildings excluding low rise (three stories or less) residential buildings. Substantial renovation is when two or more building systems are renovated, such as shell and heating, heating and lighting, etc. State Energy Code specifies a lighting power density level by building type for both the interior and the exterior. Either the Building Area Method or Space by Space method as defined in 2015, 2018, 2021 or 2024, depending on the IECC in effect on the date of the building permit (if unknown assume IECC 2024), can be used for calculating the Interior Lighting Power Density.[1448] The measure consists of a design that is more efficient (has a lower lighting power density in watts/square foot) than code requires. The IECC applies to both new construction and renovation.

This measure was developed to be applicable to the following program types: NC.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the lighting system must be more efficient than the baseline Energy Code lighting power density in watts/square foot for either the interior space or exterior space.

DEFINITION OF BASELINE EQUIPMENT

The baseline is assumed to be a lighting power density that meets the IECC in effect on the date of the building permit (if unknown assume IECC 2024).

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

DEEMED CALCULATION FOR THIS MEASURE

Annual kWh Savings

$$\Delta kWh = (WSFbase - WSFeffic)/1000 * SF * Hours * WHF_e$$

Summer Coincident Peak kW Savings

$$\Delta kW = (WSFbase - WSFeffic)/1000 * SF * CF * WHF_d$$

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[1449]

DEEMED MEASURE COST

The actual incremental cost over a baseline system will be collected from the customer if possible or developed on a fixture by fixture basis.

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting

Loadshape C07 - Grocery/Conv. Store Indoor Lighting

Loadshape C08 - Hospital Indoor Lighting

[1448] Refer to the referenced code documents for specifics on calculating lighting power density using either the whole building method or the Space by Space method.

[1449] Measure Life Report, Residential and Commercial/Industrial/Industrial Lighting and HVAC Measures, GDS Associates, June 2007.

Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the building type.

Algorithm

CALCULATION OF SAVINGS

ENERGY SAVINGS

$$\Delta kWh = (WSF_{base} - WSF_{effic})/1000 * SF * Hours * WHF_e$$

Where:

WSF_{base} = Baseline lighting watts per square foot or linear foot as determined by building or space type. Whole building analysis values are presented in the Reference Tables below.[1450]

WSF_{effic} = The actual installed lighting watts per square foot or linear foot.

SF = Provided by customer based on square footage of the building area applicable to the lighting design for new building.

Hours = Annual site-specific hours of operation of the lighting equipment collected from the customer. If not available, use building area type as provided in the Reference Table in Section 4.5, Fixture annual operating hours.

WHF_e = Waste Heat Factor for Energy to account for cooling savings from efficient lighting is as provided in the Reference Table in Section 4.5 by buidling type. If building is not cooled WHF_e is 1.

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}[1451] = (WSF_{base} - WSF_{effic})/1000 * SF * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

[1450] See Reference Code documentation for additional information.
[1451] Negative value because this is an increase in heating consumption due to the efficient lighting.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (WSF_{base} - WSF_{effic})/1000 * SF * CF * WHF_d$$

Where:

WHF_d = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is as provided in the Reference Table in Section 4.5 by buidling type. If building is not cooled WHFd is 1.

CF = Summer Peak Coincidence Factor for measure is as provided in the Reference Table in Section 4.5 by buidling type. If the building type is unknown, use the Miscellaneous value of 0.66.

Other factors as defined above

FOSSIL FUEL SAVINGS

$$\Delta Therms = (WSF_{base} - WSF_{effic})/1000 * SF * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. This value is provided in the Reference Table in Section 4.5 by buidling type.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

Reference Tables

Lighting Power Density Values from 2015, 2018, 2021, and 2024 for Interior Commercial New Construction and Substantial Renovation Building Area Method:

Building Area Type [1452]	IECC 2015 Lighting Power Density (w/ft^2)	IECC 2018 Lighting Power Density (w/ft^2)	IECC 2021 Lighting Power Density (w/ft^2)	IECC 2024 Lighting Power Density (w/ft^2)
Automotive Facility	0.80	0.71	0.75	0.73
Convention Center	1.01	0.76	0.64	0.64
Court House	1.01	0.9	0.79	0.75
Dining: Bar Lounge/Leisure	1.01	0.9	0.80	0.74
Dining: Cafeteria/Fast Food	0.9	0.79	0.76	0.70
Dining: Family	0.95	0.78	0.71	0.65
Dormitory	0.57	0.61	0.53	0.52
Exercise Center	0.84	0.65	0.72	0.72
Fire station	0.67	0.53	0.56	0.56
Gymnasium	0.94	0.68	0.76	0.75
Healthcare – clinic	0.90	0.82	0.81	0.77
Hospital	1.05	1.05	0.96	0.92
Hotel	0.87	0.75	0.56	0.53
Library	1.19	0.78	0.83	0.83

[1452] In cases where both a general building area type and a more specific building area type are listed, the more specific building area type shall apply.

Building Area Type [1452]	IECC 2015 Lighting Power Density (w/ft^2)	IECC 2018 Lighting Power Density (w/ft^2)	IECC 2021 Lighting Power Density (w/ft^2)	IECC 2024 Lighting Power Density (w/ft^2)
Manufacturing Facility	1.17	0.90	0.82	0.82
Motel	0.87	0.75	0.56	0.53
Motion Picture Theater	0.76	0.83	0.44	0.43
Multifamily	0.51	0.68	0.45	0.46
Museum	1.02	1.06	0.55	0.56
Office	0.82	0.79	0.64	0.62
Parking Garage	0.21	0.15	0.18	0.17
Penitentiary	0.81	0.75	0.69	0.65
Performing Arts Theater	1.39	1.18	0.84	0.82
Police Station	0.87	0.80	0.66	0.62
Post Office	0.87	0.67	0.65	0.64
Religious Building	1.0	0.94	0.67	0.66
Retail[1453]	1.26	1.06	0.84	0.78
School/University	0.87	0.81	0.72	0.70
Sports Arena	0.91	0.87	0.76	0.73
Town Hall	0.89	0.80	0.69	0.67
Transportation	0.70	0.61	0.50	0.56
Warehouse	0.66	0.48	0.45	0.45
Workshop	1.19	0.90	0.91	0.86

[1453] Where lighting equipment is specified to be installed to highlight specific merchandise in addition to lighting equipment specified for general lighting and is switched or dimmed on circuits different from the circuits for general lighting, the small of the actual wattage of the lighting equipment installed specifically for merchandise, or additional lighting power as determined below shall be added to the interior lighting power determined in accordance with this line item.

Lighting Power Density Values from IECC 2015 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

TABLE C405.4.2(2)
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/sq.ft)
Atrium	
Less than 40 feet in height	0.03 per foot in total height
Greater than 40 feet in height	0.40 + 0.02 per foot in total height
Audience seating area	
In an auditorium	0.63
In a convention center	0.82
In a gymnasium	0.65
In a motion picture theater	1.14
In a penitentiary	0.28
In a performing arts theater	2.43
In a religious building	1.53
In a sports arena	0.43
Otherwise	0.43
Banking activity area	1.01
Breakroom (See Lounge/Breakroom)	
Classroom/lecture hall/training room	
In a penitentiary	1.34
Otherwise	1.24
Conference/meeting/multipurpose room	1.23
Copy/print room	0.72
Corridor	
In a facility for the visually impaired (and not used primarily by the staff)[b]	0.92
In a hospital	0.79
In a manufacturing facility	0.41
Otherwise	0.66
Courtroom	1.72
Computer room	1.71
Dining area	
In a penitentiary	0.96
In a facility for the visually impaired (and not used primarily by the staff)[b]	1.9
In bar/lounge or leisure dining	1.07
In cafeteria or fast food dining	0.65
In family dining	0.89
Otherwise	0.65
Electrical/mechanical room	0.95
Emergency vehicle garage	0.56

(continued)

TABLE C405.4.2(2)—continued
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/sq.ft)
Food preparation area	1.21
Guest room	0.47
Laboratory	
In or as a classroom	1.43
Otherwise	1.81
Laundry/washing area	0.6
Loading dock, interior	0.47
Lobby	
In a facility for the visually impaired (and not used primarily by the staff)[b]	1.8
For an elevator	0.64
In a hotel	1.06
In a motion picture theater	0.59
In a performing arts theater	2.0
Otherwise	0.9
Locker room	0.75
Lounge/breakroom	
In a healthcare facility	0.92
Otherwise	0.73
Office	
Enclosed	1.11
Open plan	0.98
Parking area, interior	0.19
Pharmacy area	1.68
Restroom	
In a facility for the visually impaired (and not used primarily by the staff[b]	1.21
Otherwise	0.98
Sales area	1.59
Seating area, general	0.54
Stairway (See space containing stairway)	
Stairwell	0.69
Storage room	0.63
Vehicular maintenance area	0.67
Workshop	1.59
BUILDING TYPE SPECIFIC SPACE TYPES[a]	**LPD (watts/sq.ft)**
Facility for the visually impaired[b]	
In a chapel (and not used primarily by the staff)	2.21
In a recreation room (and not used primarily by the staff)	2.41
Automotive (See Vehicular Maintenance Area above)	
Convention Center—exhibit space	1.45
Dormitory—living quarters	0.38
Fire Station—sleeping quarters	0.22
Gymnasium/fitness center	
In an exercise area	0.72
In a playing area	1.2

(continued)

TABLE C405.4.2(2)—continued
INTERIOR LIGHTING POWER ALLOWANCES:
SPACE-BY-SPACE METHOD

BUILDING TYPE SPECIFIC SPACE TYPES[a]	LPD (watts/sq.ft)
healthcare facility	
In an exam/treatment room	1.66
In an imaging room	1.51
In a medical supply room	0.74
In a nursery	0.88
In a nurse's station	0.71
In an operating room	2.48
In a patient room	0.62
In a physical therapy room	0.91
In a recovery room	1.15
Library	
In a reading area	1.06
In the stacks	1.71
Manufacturing facility	
In a detailed manufacturing area	1.29
In an equipment room	0.74
In an extra high bay area (greater than 50' floor-to-ceiling height)	1.05
In a high bay area (25-50' floor-to-ceiling height)	1.23
In a low bay area (less than 25' floor-to-ceiling height)	1.19
Museum	
In a general exhibition area	1.05
In a restoration room	1.02
Performing arts theater—dressing room	0.61
Post Office—Sorting Area	0.94
Religious buildings	
In a fellowship hall	0.64
In a worship/pulpit/choir area	1.53
Retail facilities	
In a dressing/fitting room	0.71
In a mall concourse	1.1
Sports arena—playing area	
For a Class I facility	3.68
For a Class II facility	2.4
For a Class III facility	1.8
For a Class IV facility	1.2
Transportation facility	
In a baggage/carousel area	0.53
In an airport concourse	0.36
At a terminal ticket counter	0.8
Warehouse—storage area	
For medium to bulky, palletized items	0.58
For smaller, hand-carried items	0.95

a. In cases where both a common space type and a building area specific space type are listed, the building area specific space type shall apply
b. A 'Facility for the Visually Impaired' is a facility that is licensed or will be licensed by local or state authorities for senior long-term care, adult daycare, senior support or people with special visual needs.

Lighting Power Density Values from IECC 2018 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

TABLE C405.3.2(2)
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/sq.ft)
Atrium	
Less than 40 feet in height	0.03 per foot in total height
Greater than 40 feet in height	0.40 + 0.02 per foot in total height
Audience seating area	
In an auditorium	0.63
In a convention center	0.82
In a gymnasium	0.65
In a motion picture theater	1.14
In a penitentiary	0.28
In a performing arts theater	2.03
In a religious building	1.53
In a sports arena	0.43
Otherwise	0.43
Banking activity area	0.86
Breakroom (See Lounge/breakroom)	
Classroom/lecture hall/training room	
In a penitentiary	1.34
Otherwise	0.96
Computer room	1.33
Conference/meeting/multipurpose room	1.07
Copy/print room	0.56
Corridor	
In a facility for the visually impaired (and not used primarily by the staff)[b]	0.92
In a hospital	0.92
In a manufacturing facility	0.29
Otherwise	0.66
Courtroom	1.39
Dining area	
In bar/lounge or leisure dining	0.93
In cafeteria or fast food dining	0.63
In a facility for the visually impaired (and not used primarily by the staff)[b]	2.00
In family dining	0.71
In a penitentiary	0.96
Otherwise	0.63
Electrical/mechanical room	0.43
Emergency vehicle garage	0.41
Food preparation area	1.06
Guestroom[c, d]	0.77
Laboratory	
In or as a classroom	1.20
Otherwise	1.45

Laundry/washing area	0.43
Loading dock, interior	0.58
Lobby	
For an elevator	0.68
In a facility for the visually impaired (and not used primarily by the staff)[b]	2.03
In a hotel	1.06
In a motion picture theater	0.45
In a performing arts theater	1.70
Otherwise	1.0
Locker room	0.48
Lounge/breakroom	
In a healthcare facility	0.78
Otherwise	0.62
Office	
Enclosed	0.93
Open plan	0.81
Parking area, interior	0.14
Pharmacy area	1.34
Restroom	
In a facility for the visually impaired (and not used primarily by the staff[b]	0.96
Otherwise	0.85
Sales area	1.22
Seating area, general	0.42
Stairway (see Space containing stairway)	
Stairwell	0.58
Storage room	0.46
Vehicular maintenance area	0.56
Workshop	1.14

BUILDING TYPE SPECIFIC SPACE TYPES[a]	LPD (watts/sq.ft)
Automotive (see Vehicular maintenance area)	
Convention Center—exhibit space	0.88
Dormitory—living quarters[c, d]	0.54
Facility for the visually impaired[b]	
In a chapel (and not used primarily by the staff)	1.06
In a recreation room (and not used primarily by the staff)	1.80
Fire Station—sleeping quarters[c]	0.20
Gymnasium/fitness center	
In an exercise area	0.50
In a playing area	0.82
Healthcare facility	
In an exam/treatment room	1.68
In an imaging room	1.06
In a medical supply room	0.54
In a nursery	1.00
In a nurse's station	0.81
In an operating room	2.17
In a patient room[c]	0.62
In a physical therapy room	0.84
In a recovery room	1.03
Library	
In a reading area	0.82
In the stacks	1.20
Manufacturing facility	
In a detailed manufacturing area	0.93
In an equipment room	0.65
In an extra-high-bay area (greater than 50' floor-to-ceiling height)	1.05
In a high-bay area (25-50' floor-to-ceiling height)	0.75
In a low-bay area (less than 25' floor-to-ceiling height)	0.96
Museum	
In a general exhibition area	1.05
In a restoration room	0.85
Performing arts theater—dressing room	0.36
Post office—sorting area	0.68
Religious buildings	
In a fellowship hall	0.55
In a worship/pulpit/choir area	1.53

Retail facilities	
In a dressing/fitting room	0.50
In a mall concourse	0.90
Sports arena—playing area	
For a Class I facility[e]	2.47
For a Class II facility[f]	1.96
For a Class III facility[g]	1.70
For a Class IV facility[h]	1.13
Transportation facility	
In a baggage/carousel area	0.45
In an airport concourse	0.31
At a terminal ticket counter	0.62
Warehouse—storage area	
For medium to bulky, palletized items	0.35
For smaller, hand-carried items	0.69

a. In cases where both a common space type and a building area specific space type are listed, the building area specific space type shall apply

b. A 'Facility for the Visually Impaired' is a facility that is licensed or will be licensed by local or state authorities for senior long-term care, adult daycare, senior support or people with special visual needs.

c. Where sleeping units are excluded from lighting power calculations by application of Section R405.1, neither the area of the sleeping units nor the wattage of lighting in the sleeping units is counted.

d. Where dwelling units are excluded from lighting power calculations by application of Section R405.1, neither the area of the dwelling units nor the wattage of lighting in the dwelling units is counted.

e. Class I facilities consist of professional facilities; and semiprofessional, collegiate, or club facilities with seating for 5,000 or more spectators.

f. Class II facilities consist of collegiate and semiprofessional facilities with seating for fewer than 5,000 spectators; club facilities with seating for between 2,000 and 5,000 spectators; and amateur league and high-school facilities with seating for more than 2,000 spectators.

g. Class III facilities consist of club, amateur league and high-school facilities with seating for 2,000 or fewer spectators.

h. Class IV facilities consist of elementary school and recreational facilities; and amateur league and high-school facilities without provision for spectators.

Lighting Power Density Values from IECC 2021 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

TABLE C405.3.2(2)
INTERIOR LIGHTING POWER ALLOWANCES:
SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/ft²)
Atrium	
Less than 40 feet in height	0.48
Greater than 40 feet in height	0.60
Audience seating area	
In an auditorium	0.61
In a gymnasium	0.23
In a motion picture theater	0.27
In a penitentiary	0.67
In a performing arts theater	1.16
In a religious building	0.72
In a sports arena	0.33
Otherwise	0.33
Banking activity area	0.61
Breakroom (See Lounge/breakroom)	
Classroom/lecture hall/training room	
In a penitentiary	0.89
Otherwise	0.71
Computer room, data center	0.94
Conference/meeting/multipurpose room	0.97
Copy/print room	0.31

TABLE C405.3.2(2)—continued
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/ft²)
Corridor	
In a facility for the visually impaired (and not used primarily by the staff)[b]	0.71
In a hospital	0.71
Otherwise	0.41
Courtroom	1.20
Dining area	
In bar/lounge or leisure dining	0.86
In cafeteria or fast food dining	0.40
In a facility for the visually impaired (and not used primarily by the staff)[b]	1.27
In family dining	0.60
In a penitentiary	0.42
Otherwise	0.43
Electrical/mechanical room	0.43
Emergency vehicle garage	0.52
Food preparation area	1.09
Guestroom[c, d]	0.41
Laboratory	
In or as a classroom	1.11
Otherwise	1.33
Laundry/washing area	0.53
Loading dock, interior	0.88
Lobby	
For an elevator	0.65
In a facility for the visually impaired (and not used primarily by the staff)[b]	1.69
In a hotel	0.51
In a motion picture theater	0.23
In a performing arts theater	1.25
Otherwise	0.84
Locker room	0.52
Lounge/breakroom	
In a healthcare facility	0.42
Otherwise	0.59
Office	
Enclosed	0.74
Open plan	0.61
Parking area, interior	0.15
Pharmacy area	1.66
Restroom	
In a facility for the visually impaired (and not used primarily by the staff[b]	1.26
Otherwise	0.63
Sales area	1.05

TABLE C405.3.2(2)—continued
INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/ft²)
Seating area, general	0.23
Stairwell	0.49
Storage room	0.38
Vehicular maintenance area	0.60
Workshop	1.26
BUILDING TYPE SPECIFIC SPACE TYPES[a]	**LPD (watts/ ft²)**
Automotive (see Vehicular maintenance area)	
Convention Center—exhibit space	0.61
Dormitory—living quarters[c, d]	0.50
Facility for the visually impaired[b]	
In a chapel (and not used primarily by the staff)	0.70
In a recreation room (and not used primarily by the staff)	1.77
Fire Station—sleeping quarters[c]	0.23
Gymnasium/fitness center	
In an exercise area	0.90
In a playing area	0.85
Healthcare facility	
In an exam/treatment room	1.40
In an imaging room	0.94
In a medical supply room	0.62
In a nursery	0.92
In a nurse's station	1.17
In an operating room	2.26
In a patient room[c]	0.68
In a physical therapy room	0.91
In a recovery room	1.25
Library	
In a reading area	0.96
In the stacks	1.18
Manufacturing facility	
In a detailed manufacturing area	0.80
In an equipment room	0.76
In an extra-high-bay area (greater than 50 feet floor-to-ceiling height)	1.42
In a high-bay area (25–50 feet floor-to-ceiling height)	1.24
In a low-bay area (less than 25 feet floor-to-ceiling height)	0.86
Museum	
In a general exhibition area	0.31
In a restoration room	1.10
Performing arts theater—dressing room	0.41
Post office—sorting area	0.76

TABLE C405.3.2(2)—continued
INTERIOR LIGHTING POWER ALLOWANCES:
SPACE-BY-SPACE METHOD

COMMON SPACE TYPES*	LPD (watts/ft²)
Religious buildings	
In a fellowship hall	0.54
In a worship/pulpit/choir area	0.85
Retail facilities	
In a dressing/fitting room	0.51
In a mall concourse	0.82
Sports arena—playing area	
For a Class I facility[e]	2.94
For a Class II facility[f]	2.01
For a Class III facility[g]	1.30
For a Class IV facility[h]	0.86
Transportation facility	
At a terminal ticket counter	0.51
In a baggage/carousel area	0.39
In an airport concourse	0.25
Warehouse—storage area	
For medium to bulky, palletized items	0.33
For smaller, hand-carried items	0.69

Lighting Power Density Values from IECC 2024 for Interior Commercial New Construction and Substantial Renovation Space by Space Method:

TABLE C405.3.2(2)—INTERIOR LIGHTING POWER ALLOWANCES: SPACE-BY-SPACE METHOD

COMMON SPACE TYPES[a]	LPD (watts/ft^2)
Atrium	
Less than or equal to 40 feet in height	0.41
Greater than 40 feet in height	0.51
Audience seating area	
In an auditorium	0.57
In a gymnasium	0.23
In a motion picture theater	0.27
In a penitentiary	0.56
In a performing arts theater	1.09
In a religious building	0.72
In a sports arena	0.27
Otherwise	0.33
Banking activity area	0.56
Breakroom (See Lounge/breakroom)	
Classroom/lecture hall/training room	
In a penitentiary	0.74
Otherwise	0.72
Computer room, data center	0.75
Conference/meeting/multipurpose room	0.88
Copy/print room	0.56
Corridor	
In a facility for the visually impaired (and not used primarily by the staff)[b]	0.71
In a hospital	0.61
Otherwise	0.44
Courtroom	1.08
Dining area	
In bar/lounge or leisure dining	0.76
In cafeteria or fast food dining	0.36
In a facility for the visually impaired (and not used primarily by the staff)[b]	1.22
In family dining	0.52
In a penitentiary	0.35
Otherwise	0.42
Electrical/mechanical room	0.71
Emergency vehicle garage	0.51
Food preparation area	1.19
Laboratory	
In or as a classroom	1.05
Otherwise	1.21
Laundry/washing area	0.51
Loading dock, interior	0.88

Lobby	
For an elevator	0.64
In a facility for the visually impaired (and not used primarily by the staff)[b]	1.44
In a motion picture theater	0.20
In a performing arts theater	1.21
Otherwise	0.80
Locker room	0.43
Lounge/breakroom	
In a health care facility	0.77
Mother's wellness room	0.68
Otherwise	0.55
Office	
Enclosed	0.73
Open plan	0.56
Parking area daylight transition zone	1.06
Parking area, interior	0.11
Pharmacy area	1.59
Restroom	
In a facility for the visually impaired (and not used primarily by the staff)[b]	0.96
Otherwise	0.74
Sales area	0.85
Seating area, general	0.21
Security screening general areas	0.64
Security screening in transportation facilities	0.93
Security screening transportation waiting area	0.56
Stairwell	0.47
Storage room	0.35
Vehicular maintenance area	0.59
Workshop	1.17
BUILDING TYPE SPECIFIC SPACE TYPES[a]	**LPD (watts/ft^2)**
Automotive (see Vehicular maintenance area)	
Convention Center—exhibit space	0.50
Dormitory—living quarters	0.48
Facility for the visually impaired[b]	
In a chapel (and not used primarily by the staff)	0.58
In a recreation room (and not used primarily by the staff)	1.20
Fire station—sleeping quarters	0.48
Gaming establishments	
High limits game	1.68
Slots	0.54
Sportsbook	0.82
Table games	1.09
Gymnasium/fitness center	
In an exercise area	0.82
In a playing area	0.82

Health care facility	
In an exam/treatment room	1.33
In an imaging room	0.94
In a medical supply room	0.56
In a nursery	0.87
In a nurse's station	1.07
In an operating room	2.26
In a patient room	0.78
In a physical therapy room	0.82
In a recovery room	1.18
In a telemedicine room	1.44
Library	
In a reading area	0.86
In the stacks	1.18
Manufacturing facility	
In a detailed manufacturing area	0.75
In an equipment room	0.73
In an extra-high-bay area (greater than 50 feet floor-to-ceiling height)	1.36
In a high-bay area (25–50 feet floor-to-ceiling height)	1.24
In a low-bay area (less than 25 feet floor-to-ceiling height)	0.86
Museum	
In a general exhibition area	0.31
In a restoration room	1.24
Performing arts theater—dressing room	0.39
Post office—sorting area	0.71
Religious buildings	
In a fellowship hall	0.50
In a worship/pulpit/choir area	0.75
Retail facilities	
In a dressing/fitting room	0.45
Hair salon	0.65
Nail salon	0.75
In a mall concourse	0.57
Massage space	0.81
Sports arena—playing area	
For a Class I facility[c]	2.86
For a Class II facility[d]	1.98
For a Class III facility[e]	1.29
For a Class IV facility[f]	0.86
Sports arena—pools	
For a Class I facility	2.20
For a Class II facility	1.47
For a Class III facility	0.99
For a Class IV facility	0.59

Transportation facility	
Airport hangar	1.36
At a terminal ticket counter	0.40
In a baggage/carousel area	0.28
In an airport concourse	0.49
Passenger loading area	0.71
Warehouse—storage area	
For medium to bulky, palletized items	0.33
For smaller, hand-carried items	0.69

For SI: 1 foot = 304.8 mm, 1 watt per square foot = 10.76 w/m^2.

a. In cases where both a common space type and a building area specific space type are listed, the building area specific space type shall apply.
b. A 'Facility for the Visually Impaired' is a facility that is licensed or will be licensed by local or state authorities for senior long-term care, adult day care, senior support or people with special visual needs.
c. Class I facilities consist of professional facilities; and semiprofessional, collegiate or club facilities with seating for 5,000 or more spectators.
d. Class II facilities consist of collegiate and semiprofessional facilities with seating for fewer than 5,000 spectators, club facilities with seating for between 2,000 and 5,000 spectators, and amateur league and high school facilities with seating for more than 2,000 spectators.
e. Class III facilities consist of club, amateur league and high school facilities with seating for 2,000 or fewer spectators.
f. Class IV facilities consist of elementary school and recreational facilities; and amateur league and high school facilities without provision for spectators.

The exterior lighting design will be based on the building location and the applicable "Lighting Zone" as defined in IECC 2021 Table C405.5.2(1) which follows. This table is identical to IECC 2018 Table C405.4.2(1), IECC 2021, and IECC 2024.

TABLE C405.5.2(1)
EXTERIOR LIGHTING ZONES

LIGHTING ZONE	DESCRIPTION
1	Developed areas of national parks, state parks, forest land, and rural areas
2	Areas predominantly consisting of residential zoning, neighborhood business districts, light industrial with limited nighttime use and residential mixed-use areas
3	All other areas not classified as lighting zone 1, 2 or 4
4	High-activity commercial districts in major metropolitan areas as designated by the local land use planning authority

The lighting power density savings will be based on reductions below the allowable design levels as specified in IECC 2015 Table C405.5.2(2) or 2018 Table C405.2.2(2) or IECC 2021 Table C405.52(2).

Allowable Design Levels from IECC 2015

TABLE C405.5.2(2)
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

		LIGHTING ZONES			
		Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance (Base allowance is usable in tradable or nontradable surfaces.)		500 W	600 W	750 W	1300 W
Tradable Surfaces (Lighting power densities for uncovered parking areas, building grounds, building entrances and exits, canopies and overhangs and outdoor sales areas are tradable.)	**Uncovered Parking Areas**				
	Parking areas and drives	0.04 W/ft²	0.06 W/ft²	0.10 W/ft²	0.13 W/ft²
	Building Grounds				
	Walkways less than 10 feet wide	0.7 W/linear foot	0.7 W/linear foot	0.8 W/linear foot	1.0 W/linear foot
	Walkways 10 feet wide or greater, plaza areas special feature areas	0.14 W/ft²	0.14 W/ft²	0.16 W/ft²	0.2 W/ft²
	Stairways	0.75 W/ft²	1.0 W/ft²	1.0 W/ft²	1.0 W/ft²
	Pedestrian tunnels	0.15 W/ft²	0.15 W/ft²	0.2 W/ft²	0.3 W/ft²
	Building Entrances and Exits				
	Main entries	20 W/linear foot of door width	20 W/linear foot of door width	30 W/linear foot of door width	30 W/linear foot of door width
	Other doors	20 W/linear foot of door width	20 W/linear foot of door width	20 W/linear foot of door width	20 W/linear foot of door width
	Entry canopies	0.25 W/ft²	0.25 W/ft²	0.4 W/ft²	0.4 W/ft²
	Sales Canopies				
	Free-standing and attached	0.6 W/ft²	0.6 W/ft²	0.8 W/ft²	1.0 W/ft²
	Outdoor Sales				
	Open areas (including vehicle sales lots)	0.25 W/ft²	0.25 W/ft²	0.5 W/ft²	0.7 W/ft²
	Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	10 W/linear foot	10 W/linear foot	30 W/linear foot
Nontradable Surfaces (Lighting power density calculations for the following applications can be used only for the specific application and cannot be traded between surfaces or with other exterior lighting. The following allowances are in addition to any allowance otherwise permitted in the "Tradable Surfaces" section of this table.)	Building facades	No allowance	0.075 W/ft² of gross above-grade wall area	0.113 W/ft² of gross above-grade wall area	0.15 W/ft² of gross above-grade wall area
	Automated teller machines (ATM) and night depositories	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location	270 W per location plus 90 W per additional ATM per location
	Entrances and gatehouse inspection stations at guarded facilities	0.75 W/ft² of covered and uncovered area	0.75 W/ft² of covered and uncovered area	0.75 W/ft² of covered and uncovered area	0.75 W/ft² of covered and uncovered area
	Loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.5 W/ft² of covered and uncovered area	0.5 W/ft² of covered and uncovered area	0.5 W/ft² of covered and uncovered area	0.5 W/ft² of covered and uncovered area
	Drive-up windows/doors	400 W per drive-through	400 W per drive-through	400 W per drive-through	400 W per drive-through
	Parking near 24-hour retail entrances	800 W per main entry	800 W per main entry	800 W per main entry	800 W per main entry

For SI: 1 foot = 304.8 mm, 1 watt per square foot = W/0.0929 m².
W = watts.

Allowable Design Levels from IECC 2018

Table C405.2.2(2)
Lighting Power Allowances for Building Exteriors

	Zone 0	Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance (Base allowance may be used in tradable or nontradable surfaces.)					
	No allowance	350 W	400 W	500 W	900 W
Tradable Surfaces (*LPD* allowances for uncovered parking areas, *building* grounds, *building entrances*, exits and loading docks, canopies and overhangs, and outdoor sales areas may be traded.)					
Uncovered Parking Areas					
Parking areas and drives	No allowance	0.03 W/ft^2	0.04 W/ft^2	0.06 W/ft^2	0.08 W/ft^2
***Building* Grounds**					
Walkways/ramps less than 10 ft wide	No allowance	0.5 W/linear foot	0.5 W/linear foot	0.6 W/linear foot	0.7 W/linear foot
Walkways/ramps 10 ft wide or greater Plaza areas Special feature areas	No allowance	0.10 W/ft^2	0.10 W/ft^2	0.11 W/ft^2	0.14 W/ft^2
Dining areas	No allowance	0.65 W/ft^2	0.65 W/ft^2	0.75 W/ft^2	0.95 W/ft^2
Stairways	No allowance	0.6 W/ft^2	0.7 W/ft^2	0.7 W/ft^2	0.7 W/ft^2
Pedestrian tunnels	No allowance	0.12 W/ft^2	0.12 W/ft^2	0.14 W/ft^2	0.21 W/ft^2
Landscaping	No allowance	0.03 W/ft^2	0.04 W/ft^2	0.04 W/ft^2	0.04 W/ft^2
***Building Entrances*, Exits, and Loading Docks**					
Pedestrian and vehicular entrances and exits	No allowance	14 W/lin ft of opening	14 W/lin ft of opening	21 W/lin ft of opening	21 W/lin ft of opening
Entry canopies	No allowance	0.20 W/ft^2	0.25 W/ft^2	0.4 W/ft^2	0.4 W/ft^2
Loading docks	No allowance	0.35 W/ft^2	0.35 W/ft^2	0.35 W/ft^2	0.35 W/ft^2
Sales Canopies					
Free standing and attached	No allowance	0.4 W/ft^2	0.4 W/ft^2	0.6 W/ft^2	0.7 W/ft^2
Outdoor Sales					
Open areas (including vehicle sales lots)	No allowance	0.2 W/ft^2	0.2 W/ft^2	0.35 W/ft^2	0.5 W/ft^2
Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	No allowance	7 W/linear foot	7 W/linear foot	21 W/linear foot

TABLE C405.4.2(3)
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

LIGHTING ZONES				
	Zone 1	**Zone 2**	**Zone 3**	**Zone 4**
Building facades	No allowance	0.075 W/ft^2 of gross above-grade wall area	0.113 W/ft^2 of gross above-grade wall area	0.15 W/ft^2 of gross above-grade wall area
Automated teller machines (ATM) and night depositories	135 W per location plus 45 W per additional ATM per location			
Uncovered entrances and gatehouse inspection stations at guarded facilities	0.5 W/ft^2 of area			
Uncovered loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.35 W/ft^2 of area			
Drive-up windows and doors	200 W per drive through			
Parking near 24-hour retail entrances.	400 W per main entry			

For SI: For SI: 1 watt per square foot = W/0.0929 m^2.

W = watts.

Allowable Design Levels from IECC 2021

TABLE C405.5.2(2)
LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

	LIGHTING ZONES			
	Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance	350 W	400 W	500 W	900 W
Uncovered Parking Areas				
Parking areas and drives	0.03 W/ft^2	0.04 W/ft^2	0.06 W/ft^2	0.08 W/ft^2
Building Grounds				
Walkways and ramps less than 10 feet wide	0.50 W/linear foot	0.50 W/linear foot	0.60 W/linear foot	0.70 W/linear foot
Walkways and ramps 10 feet wide or greater, plaza areas, special feature areas	0.10 W/ft^2	0.10 W/ft^2	0.11 W/ft^2	0.14 W/ft^2
Dining areas	0.65 W/ft^2	0.65 W/ft^2	0.75 W/ft^2	0.95 W/ft^2
Stairways	0.60 W/ft^2	0.70 W/ft^2	0.70 W/ft^2	0.70 W/ft^2
Pedestrian tunnels	0.12 W/ft^2	0.12 W/ft^2	0.14 W/ft^2	0.21 W/ft^2
Landscaping	0.03 W/ft^2	0.04 W/ft^2	0.04 W/ft^2	0.04 W/ft^2
Building Entrances and Exits				
Pedestrian and vehicular entrances and exits	14 W/linear foot of opening	14 W/linear foot of opening	21 W/linear foot of opening	21 W/linear foot of opening
Entry canopies	0.20 W/ft^2	0.25 W/ft^2	0.40 W/ft^2	0.40 W/ft^2
Loading docks	0.35 W/ft^2	0.35 W/ft^2	0.35 W/ft^2	0.35 W/ft^2
Sales Canopies				
Free-standing and attached	0.40 W/ft^2	0.40 W/ft^2	0.60 W/ft^2	0.70 W/ft^2
Outdoor Sales				
Open areas (including vehicle sales lots)	0.20 W/ft^2	0.20 W/ft^2	0.35 W/ft^2	0.50 W/ft^2
Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	7 W/linear foot	7 W/linear foot	21 W/linear foot

For SI: 1 foot = 304.8 mm, 1 watt per square foot = W/0.0929 m^2.
W = watts.

TABLE C405.5.2(3)
INDIVIDUAL LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

	LIGHTING ZONES			
	Zone 1	Zone 2	Zone 3	Zone 4
Building facades	No allowance	0.075 W/ft^2 of gross above-grade wall area	0.113 W/ft^2 of gross above-grade wall area	0.15 W/ft^2 of gross above-grade wall area
Automated teller machines (ATM) and night depositories	135 W per location plus 45 W per additional ATM per location			
Uncovered entrances and gate-house inspection stations at guarded facilities	0.50 W/ft^2 of area			
Uncovered loading areas for law enforcement, fire, ambulance and other emergency service vehicles	0.35 W/ft^2 of area			
Drive-up windows and doors	200 W per drive through			
Parking near 24-hour retail entrances.	400 W per main entry			

For SI: For SI: 1 watt per square foot = W/0.0929 m^2.
W = watts.

Allowable Design Levels from IECC 2024

TABLE C405.5.2(2)—LIGHTING POWER ALLOWANCES FOR BUILDING EXTERIORS

	LIGHTING ZONES			
	Zone 1	Zone 2	Zone 3	Zone 4
Base Site Allowance	160 W	280 W	400 W	560 W
Uncovered Parking Areas				
Parking area, exterior	0.015 W/ft^2	0.026 W/ft^2	0.037 W/ft^2	0.052 W/ft^2
Building Grounds				
Walkways and ramps less	0.50 W/linear foot	0.50 W/linear foot	0.55 W/linear foot	0.60 W/linear foot
Plaza areas	0.028 W/ft^2	0.049 W/ft^2	0.070 W/ft^2	0.098 W/ft^2
Dining areas	0.156 W/ft^2	0.273 W/ft^2	0.390 W/ft^2	0.546 W/ft^2
Stairways	Exempt	Exempt	Exempt	Exempt
Pedestrian tunnels	0.063 W/ft^2	0.110 W/ft^2	0.157 W/ft^2	0.220 W/ft^2
Landscaping	0.014 W/ft^2	0.025 W/ft^2	0.036 W/ft^2	0.050 W/ft^2
Building Entrances and Exits				
Pedestrian and vehicular entrances and exits	5.6 W/linear foot of opening	9.8 W/linear foot of opening	14 W/linear foot of opening	19.6 W/linear foot of opening
Entry canopies	0.072 W/ft^2	0.126 W/ft^2	0.180 W/ft^2	0.252 W/ft^2
Loading docks	0.104 W/ft^2	0.182 W/ft^2	0.260 W/ft^2	0.364 W/ft^2
Sales Canopies				
Free-standing and attached	0.20 W/ft^2	0.35 W/ft^2	0.50 W/ft^2	0.70 W/ft^2
Outdoor Sales				
Open areas (including vehicle sales lots)	0.072 W/ft^2	0.126 W/ft^2	0.180 W/ft^2	0.252 W/ft^2
Street frontage for vehicle sales lots in addition to "open area" allowance	No allowance	7.2 W/linear foot	10.3 W/linear foot	14.4 W/linear foot

For SI: 1 foot = 304.8 mm, 1 watt per square foot = 10.76 W/m^2.
W = Watt.

MEASURE CODE: CI-LTG-LPDE-V11-270101

REVIEW DEADLINE: 1/1/2029

4.5.8 Miscellaneous Commercial/Industrial Lighting

DESCRIPTION

This measure is designed to calculate savings from energy efficient lighting upgrades that are not captured in other measures within the TRM. If a lighting project fits the measure description in other lighting measures, then those criteria, definitions, and calculations should be used.

Unlike other lighting measures this one applies only to RF applications (because there is no defined baseline for TOS or NC applications).

DEFINITION OF EFFICIENT EQUIPMENT

A lighting fixture that replaces an existing fixture to provide the same or greater lumen output at a lower kW consumption.

DEFINITION OF BASELINE EQUIPMENT

The definition of baseline equipment is the existing lighting fixture.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The lifetime of the efficient equipment fixture is the rated fixture life divided by hours of use. If unknown the default lifetime for interior fixtures, regardless of program type is 15 years.[1454]

For exterior fixtures, the lifetime is assumed to be 16 years for Dusk-to-Dawn (4303 hours) applications, or 25 years for Dusk-to-Business-Close Year Round (1609 hours) and Dusk-to-Business-Close Seasonal (<1000 hours).[1455]

DEEMED MEASURE COST

The actual cost of the efficient light fixture should be used.

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

[1454] 15 years is used based on assumption that most product using this measure will be LED.
[1455] Exterior fixture measure lives are based upon review of the typical rated life of the fixtures, divided by the hours of use assumption and applying a derating factor of 15% to account for potential impacts from external installation (as proposed in a Guidehouse EUL methodology recommendation for Street Lights).

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in section 4.5.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * WHFe$$

Where:

$Watts_{base}$ = Input wattage of the existing system which depends on the baseline fixture configuration (number and type of lamp) and ballast factor (if applicable) and number of fixtures.

= Actual

$Watts_{EE}$ = New Input wattage of EE fixture which depends on new fixture configuration (number of lamps) and ballast factor (if applicable) (if applicable) and number of fixtures.

= Actual

Hours = Average hours of use per year as provided by the customer or selected from the Reference Table in Section 4.5, Fixture annual operating hours, by building type. If hours or building type are unknown, use the Miscellaneous value.

WHF_e = Waste heat factor for energy to account for cooling energy savings from efficient lighting is selected from the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

ISR = In Service Rate or the percentage of units rebated that get installed.

=100% if application form completed with sign off that equipment is not placed into storage.[1456] If sign off form not completed assume the following 3 year ISR assumptions:

Weighted Average 1st year In Service Rate (ISR)	2nd year Installations	3rd year Installations	Final Lifetime In Service Rate
93.4%[1457]	2.5%	2.1%	98.0%[1458]

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}[1459] = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * -IFkWh$$

Where:

[1456] Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an "In-Service Rate" when commercial customers complete an application form.

[1457] Based on assumptions from 4.5.3 High Performance and Reduced Wattage T8 fixtures.

[1458] The 98% Lifetime ISR assumption is based upon review of two evaluations:
'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3. The 2nd and 3rd year installations should be counted as part of those future program year savings.

[1459] Negative value because this is an increase in heating consumption due to the efficient lighting.

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

Deferred Installs

As presented above, if a sign off form is not completed the characterization assumes that a percentage of bulbs purchased are not installed until Year 2 and Year 3 (see ISR assumption above). The Illinois Technical Advisory Committee has determined the following methodology for calculating the savings of these future installs.

Year 1 (Purchase Year) installs: Characterized using assumptions provided above or evaluated assumptions if available.

Year 2 and 3 installs: Characterized using delta watts assumption and hours of use from the Install Year, i.e., the actual deemed (or evaluated if available) assumptions active in Year 2 and 3 should be applied.

The NTG factor for the Purchase Year should be applied.

SUMMER COINCIDENT DEMAND SAVINGS

$$\Delta kW = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * WHFd * CF$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is selected from the Reference Table in Section 4.5 for each building type. If the building is not cooled WHFd is 1.

CF = Summer Peak Coincidence Factor for measure is selected from the Reference able in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66.

Other factors as defined above.

FOSSIL FUEL SAVINGS

$$\Delta Therms^{1460} = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. This value is selected from the Reference Table in Section 6.5 for each building type.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

If there are differences between the maintenance of the efficient and baseline lighting system then they should be evaluated on a project-by-project basis.

[1460]Negative value because this is an increase in heating consumption due to the efficient lighting.

MEASURE CODE: CI-LTG-MSCI-V06-260101

REVIEW DEADLINE: 1/1/2030

4.5.9 Multi-Level Lighting Switch

DESCRIPTION

This measure relates to the installation of new multi-level lighting switches on an existing lighting system.

This measure can only relate to the adding of a new control in an existing building, since multi-level switching is required in the Commercial new construction building energy code (IECC 2012/2015/2018/2021/2024).

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient system is assumed to be a lighting system controlled by multi-level lighting controls.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an uncontrolled lighting system where all lights in a given area are on the same circuit or all circuits come on at the same time.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for all lighting controls is assumed to be 10 years.[1461]

DEEMED MEASURE COST

When available, the actual cost of the measure shall be used. When not available, the incremental capital cost for this measure is assumed to be $55.[1462]

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in Section 4.5.

[1461] Consistent with 4.5.10 Lighting Control measure.
[1462] Consistent with Interior Wall Switch Occupancy Sensor from 4.5.10 Lighting Control measure.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = KW_{Controlled} * Hours * ESF * WHFe$$

Where:

$KW_{Controlled}$ = Total lighting load connected to the control in kilowatts.

= Actual

Hours = total operating hours of the controlled lighting circuit before the lighting controls are installed. This number should be collected from the customer. Average hours of use per year are provided in the Reference Table in Section 4.5, Fixture annual operating hours, for each building type if customer specific information is not collected. If unknown buidling type, use the Miscellaneous value.

ESF = Energy Savings factor (represents the percentage reduction to the KWcontrolled due to the use of multi-level switching).

= Dependent on building type:[1463]

Building Type	Energy Savings Factor (ESF)
Private Office	21.6%
Open Office	16.0%
Retail	14.8%
Classrooms	8.3%
Unknown, average	15%

WHF_e = Waste heat factor for energy to account for cooling energy savings from efficient lighting is provided in the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}[1464] = KW_{Controlled} * Hours * ESF * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = KW_{Controlled} * ESF * WHFd * ((CFbaseline * BaseAdj) - CF_{ML})$$

Where:

[1463] Based on results from "Lighting Controls Effectiveness Assessment: Final Report on Bi-Level Lighting Study" published by the California Public Utilities Commission (CPUC), prepared by ADM Associates.

[1464] Negative value because this is an increase in heating consumption due to the efficient lighting.

WHF_d = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If the building is un-cooled WHFd is 1.

CFbaseline = Baseline Summer Peak Coincidence Factor for the lighting system without lighting controls installed selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66

BaseAdj = Assume 0.5 if existing lighting controls, 1.0 if no existing controls

CF_{ML} = Retrofit Summer Peak Coincidence Factor the lighting system with multi-level switch installed is 0.15 regardless of building type.[1465]

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = KW_{Controlled} * Hours * ESF * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting and provided in the Reference Table in Section 4.5 by building type.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-MLLC-V08-270101

REVIEW DEADLINE: 1/1/2030

[1465] Coincidence Factor Study Residential and Commercial Industrial Lighting Measures, RLW Analytics, Spring 2007. Note, the connected load used in the calculation of the CF for occupancy sensor lights includes the average ESF.

4.5.10 Lighting Controls

DESCRIPTION

This measure relates to the installation of new occupancy or daylighting sensors and controls on a new or existing lighting system. Lighting control types covered by this measure include wall, ceiling, fixture mounted or integrated controls in addition to Luminaire Level Lighting Controls (LLLCs) or Networked Lighting Controls (NLC) which have additional high-end trim and networking capabilities. Passive infrared, ultrasonic detectors and fixture-mounted sensors or sensors with a combination thereof are eligible. Lighting controls required by state energy codes are not eligible. This must be a new installation with additional control features and may not soley be a replacement of an existing lighting control with the same control features.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Lighting that is controlled by any of the control strategies characterized in this measure; occupancy, daylighting or dual (occupancy and daylighting) controls with or without high-end trim, and Luminaire-level lighting controls (LLLCs) / Networked Lighting Controls (NLC).

LLLCs or NLCs are defined according to DesignLights Consortium (DLC) Networked Lighting Controls definition, which requires systems to have fixture networking capabilities, individual addressability, occupancy sensing, daylight harvesting, high-end trim, flexible zoning, continuous dimming, scheduling and cybersecurity. The network ability allows building managers to group lights with specific zonal control and scheduling strategies, energy monitoring and high-end trim resulting in a higher savings capability. While DLC listing is not a requirement for any control type characterized in this measure, programs should consider eligibility requirements including requiring at least the capability for network controlled occupancy, daylight harvesting and high-end trim to ensure quality product is installed achieving forecasted savings consistent with the measure assumptions below.

A subset of occupancy sensors are those that are programmed as “vacancy” sensors. To qualify as a vacancy sensor, the control must be configured such that manual input is required to turn on the controlled lighting and the control automatically turns the lighting off. Additional savings are achieved compared to standard occupancy sensors because lighting does not automatically turn on and occupants may decide to not turn it on. Note that vacancy sensors are not a viable option for many applications where standard occupancy sensors should be used instead.

DEFINITION OF BASELINE EQUIPMENT

The baseline is assumed to be the existing lighting system and can include manual or no controls or an existing control strategy that is being improved. Note where an existing inefficient fixture is replaced with an efficient fixture with control, use the fixture measure to calculate savings from the wattage reduction first, then assume the efficient fixture without control as the baseline for the control measure.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for Luminaire-level lighting controls (LLLCs) / Networked Lighting Controls (NLC) is assumed to be 15 years, consistent with the average expected lifetime of the fixture. For all other lighting controls, measure life is assumed to be 10 years.[1466]

DEEMED MEASURE COST

When available, the actual cost of the measure shall be used. When not available, the following default values are provided:

[1466] Based on research conducted by Guidehouse, interviewing 46 contractors, reported in ‘ComEd Retrofit Add-On EUL Results Memo. January 27, 2020.

Lighting Control Type	Incremental Cost[1467]
Interior Wall Switch Occupancy Sensor	$55.00
Interior Fixture-Mounted Occupancy Sensor	$67.00
Interior Remote or Wall-Mounted Occupancy Sensor	$125.00
Interior Fixture-Mounted Daylight Sensor	$50.00
Interior Remote or Wall-Mounted Daylight Sensor	$65.00
Interior Integrated Occupancy for LED Interior Fixtures < 10,000 Lumens	$40.00
Interior Integrated Occupancy for LED Interior Fixtures >= 10,000 Lumens	$40.00
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	$50.00
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	$50.00
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	$ 100.00
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	$ 100.00
Luminaire-Level Lighting Controls	$56.00
Interior Networked Lighting Controls <10,000 sqft building	$0.86 per ft^2
Interior Networked Lighting Controls 10,000-100,000 sqft building	$0.59 per ft^2
Interior Networked Lighting Controls >100,000 sqft building	$0.40 per ft^2
High End Trim or Institutional Tuning	$0.06 per ft^2
Exterior Occupancy Sensor	$82.00
Exterior NLC	Use actual

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting

[1467] Based on indicative product cost review as performed for Efficiency Vermont TRM. Cost assumption for Luminaire Level Lighting Controls is based on the average of 'clever' and 'clever-hybrid' LLLC incremental costs, including a per fixture contribution to the necessary gateway, servers and installation labor from Kisch et al, "2020 Luminaire Level Lighting Controls Incremental Cost Study", Energy Solutions on behalf of NEEA, January 2021. Cost assumptions for Interior Networked Lighting Controls is based on the average of "office", "warehouse", and "retail" by building size from Schwartz et al., "The Value Proposition for Cost-Effective, Demand Responsive-Enabling Nonresidential Lighting System Retrofits in California Buildings", Lawrence Berkeley National Laboratory and Energy Solutions prepared for California Energy Commission, April 2019.This includes both material and labor cost estimates.
Cost for High End Trim / Institutional Tuning is based on estimate provided by SlipStream based on field implementation.

Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on building type and can be found in the Reference Table in Section 4.5.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = KW_{Controlled} * Hours * (ESF_{EE} - ESF_{Base}) * WHFe$$

Where:

$KW_{Controlled}$ = Total lighting load connected to the control in kilowatts. The total connected load per control should be collected from the customer or the default values presented below used. Note where an existing inefficient fixture is replaced with an efficient fixture with control, use the fixture measure to calculate savings from the wattage reduction first, then assume the efficient fixture without control as the baseline for the control measure.

Lighting Control Type[1468]	Wattage Unit	Default kW Controlled
Interior Wall Switch Occupancy Sensor	per control	0.084
Interior Fixture-Mounted Occupancy Sensor	per fixture	0.081
Interior Remote or Wall-Mounted Occupancy Sensor	per control	0.338
Interior Fixture-Mounted Daylight Sensor	per fixture	0.095
Interior Wall-Mounted Daylight Sensor	per control	0.239
Interior Integrated Occupancy for LED Interior Fixtures < 10,000 Lumens	per fixture	0.031
Interior Integrated Occupancy for LED Interior Fixtures >= 10,000 Lumens	per fixture	0.118
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	per control	0.031
Interior Integrated Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	per control	0.118
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures < 10,000 Lumens	per control	0.031
Interior Fixture-Mounted Dual Occupancy & Daylight Sensor for LED Interior Fixtures >= 10,000 Lumens	per control	0.118
Interior Luminaire-Level Lighting Controls < 10,000 Lumens	per control	0.031
Interior Luminaire-Level Lighting Controls >= 10,000 Lumens	per control	0.118

[1468] Estimates of watts controlled are based on Efficiency Vermont data as provided in the 2018 TRM. Future evaluation should determine appropriate assumptions based on Illinois program data. Estimated kilowatts per sqft for interior networked lighting controls is based on the lighting power density (LPD) assumption in the Wisconsin Focus on Energy 2019 Technical Reference Manual and divided by 1000. To determine the total $KW_{Controlled}$ multiply by the controlled sqft. Either the total $KW_{Controlled}$ or the total sqft must be reported to estimate savings from interior networked lighting controls.

Lighting Control Type[1468]	Wattage Unit	Default kW Controlled
Interior Networked Lighting Controls	kilowatts controlled per sqft	0.00061
Refrigerated Case Occupancy Sensor – Freezer and Cooler	per control	0.090
Exterior Occupancy Sensor	per fixture	0.086
Exterior NLC	kilowatts controlled per sqft	Use actual

Hours = total operating hours of the controlled lighting circuit before the lighting controls are installed. This number should be collected from the customer if possible. If not possible, assume hours as prescribed below:

Control Type	General Building Type[1469]	Reference Table in Section 4.5 Mapped Building/Space Types	Hours
Networked Lighting Controls and Luminaire-Level Lighting Controls	Education	Childcare/Pre-School, College, Elementary School, High School	4,231
	Manufacturing	Manufacturing Facility	5,365
	Office	Office - High Rise - CAV no econ, Office - High Rise- CAV econ, Office- High Rise- VAV econ, Office- High Rise - FCU, Office- Low Rise, Office - Mid Rise	4,453
	Retail	Convenience Store, Drug Store, Grocery, Retail - Department Store, Retail - Strip Mall	6,936
	Warehouse	Warehouse	5,116
	All Other	All other building/space types in the Reference Table in Section 4.5	Use Fixture Annual Operating Hours in the Reference Table in Section 4.5
All other	All	All	Use Fixture Annual Operating Hours in the Reference Table in Section 4.5

ESF = Energy Savings Factor (represents the percentage reduction to the operating Hours from the non-controlled lighting system) from the new lighting controls installed. Where available and with building owner consent, custom savings from controls may be used via networked trending software. If unavailable or consent not provided, defaults are provided below which assume installation is appropriate to provide the savings described. For dual controls and fixtures with high-end trim this should be reviewed and verified via representative spot checks to ensure daylighting capabilities will provide savings and fixture tuning is being performed.[1470]

[1469] These are the general building types and the inferred baseline operating hours reported in DesignLights Consortium and NEEA, "Energy Savings from Networked Lighting Control (NLC) Systems with and without LLLC" Energy Solutions, September 2020. The inferred operating hours for "Assembly", "Healthcare", and "Restaurant" were excluded due to the reported small sample size (n=3, n-2, n=3 respectively). The mapping of the general building types to the building/space types listed in Section 4.5 Reference Table was completed by Guidehouse Inc.

[1470] It is recommended that evaluation is performed to assess the extent to which daylighting and high-end trim benefits are appropriately utilized in the field.

Lighting Control Type	Energy Savings Factor[1471]
Fixture Measurement of Control savings through Networked Trending (Interior or Exterior)	Custom
Interior Occupancy Sensor (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	24% 37% with High End Trim
Interior Occupancy Sensor configured as "Vacancy Sensor" (Switch, Wall, Fixture or Remote Mounted or Integrated in Fixture)	31% 44% with High End Trim
Interior Daylight Sensor (Wall, Fixture or Remote Mounted)	28% 41% with High End Trim
Interior Dual Occupancy & Daylight Sensor (Integrated of Fixture Mounted)	38% 51% with High End Trim[1472]
Interior Networked Luminaire-Level Lighting Controls	61%[1473]
Interior Networked Lighting Controls Only with No LLLCs	35%
Interior Networked Lighting Controls (unknown or mixed LLLCs)	49%
Refrigerated Case Occupancy Sensor – Freezer and Cooler	27%
Exterior Occupancy Sensor	41%
Exterior Networked Luminaire-Level Lighting Controls	61%[1474]
Exterior Networked Lighting Controls Only with No LLLCs	35%

[1471] Interior controls % savings based except where noted on LBNL, Williams et al, "Lighting Controls in Commercial Buildings", 2012, p172. ESF for Vacancy Sensors is based on Papamichael, Konstantions, Bi-Level Switching in Office Spaces, California Lighting Technology Center, February 1,2010. See Figure 8 on page 10 for relevant study results. The study shows a 30% extra savings above a typical occupancy sensor; 24% * 1.3 = 31%.

ESF for Luminaire Level Lighting Controls, Networked Lighting Controls and the 13% High End Trim adder are based upon the weighted average of results from:

Pacific Northwest National Laboratory, "Evaluation of Advanced Lighting Control Systems in a Working Office Environment", November 2018.

Schuetter et al., "Cree SmartCast Lighting Retrofit Demonstration: LED Fixtures and Controls for Advanced Holistic Lighting Solutions", September 2020 (expected).

DesignLights Consortium and NEEA, "Energy Savings from Networked Lighting Control (NLC) Systems with and without LLLC" Energy Solutions, September 2020.. LLLC ESF used in weighted average is the average of all 98 sites with NLCs w/LLLC. NLC ESF is the average of all 194 buildings. High-end trim adder used for other lighting control types is based on the results for the 96 sites w NLCs w/o LLLC and using the "Other Control Strategies" savings where the baseline had influences from high-end trim removed.

Refrigerated Case occupancy sensors ESF is based on percentage of operating hours spent in low-power operation during vacant periods, found in SDG&E workpaper: WPSDGENRLG0027.

Exterior sensors are based upon data from "Application Assessment of Bi-Level LED Parking Lot Lighting" p6.

[1472] The ESF_{EE} for interior dual occupancy & daylight sensor with high-end trim is estimated to be higher than the interior networked lighting control ESF_{EE} since this measure requires that the sensors be integrated or fixture mounted which has been documented to lead to higher savings than zone or wall sensors. The NLC measure is not specific to fixture, zone, or wall sensors.

[1473] The ESF_{EE} for LLLC is not separated out based on the inclusion of high-end trim since the DesignLights Consortium Technical Requirements Version NLC5 (1/25/21) requires that high-end trim is included for all interior networked lighting controls including LLLC.

[1474] In the absence of evaluation results specifically for exterior networked lighting controls with or without LLLCs, the same ESFs are assumed as the equivalent interior lighting controls. This is consistent with the value provided in 'Energy Savings Forecast of SolidState Lighting in General Illumination Application, Table F.4 - Building Exterior, DOE, 2019' which indicates a savings of 48% for Exterior NLCs (unknown LLC).

Lighting Control Type	Energy Savings Factor[1471]
Exterior Networked Lighting Controls (unknown or mixed LLLCs)	49%
No Lighting Control	0%

ESF_{Base} = Energy Savings Factor of the lighting controls that existed before the new lighting controls were installed. If prior existence of lighting controls is unknown, assume 0.

WHF_e = Waste heat factor for energy to account for cooling energy savings from efficient lighting is provided in the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

For example, a 1,000 sqft. low-rise office building, with cooling, installing 10 networked, interior fixture-mounted occupancy sensors would save:

$\Delta kWh = KW_{controlled} * HOURS * (ESF_{EE} - ESF_{Base}) * WHF_e$

$= 0.81 * 4,453 * (24\% - 0\%) * 1.10$

$= 952.2$ kWh

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}[1475] = KW_{Controlled} * Hours * (ESF_{EE} - ESF_{Base}) * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

For example, a 1,000 sqft. low-rise office building, with electrical reistance heating, installing 10 networked, interior fixture-mounted occupancy sensors would have the following heating penalty:

$\Delta kWh_{heatpenalty} = KW_{controlled} * HOURS * (ESF_{ee} - ESF_{Base}) * -IfkWh$

$= 0.81 * 4,453 * (24\% - 0\%) * -0.231$

$= -200$ kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = KW_{Controlled} * WHFd * ((CF_{baseline} * BaseAdj) - CF_{LC})$$

Where:

WHF_d = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If the building is un-cooled WHFd is 1.

[1475] Negative value because this is an increase in heating consumption due to the efficient lighting.

CFbaseline = Baseline Summer Peak Coincidence Factor for the lighting system without lighting controls installed selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66

BaseAdj = Assume 0.5 if existing lighting controls, 1.0 if no existing controls

CF_{LC} = Retrofit Summer Peak Coincidence Factor the lighting system with lighting controls installed is 0.15 regardless of building type.[1476]

For controls on exterior fixtures ΔkW = 0

For example, a 1,000 sqft. low-rise office building, with no existing lighting controls, installing 10 networked, interior fixture-mounted occupancy sensors would save:

ΔkW = $KW_{controlled}$ * WHF_d * ((Cfbaseline * BaseAdj) – CF_{LC})

= 0.81 * 1.26 * ((0.52 * 1) – 0.15)

= 0.38 kW

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = KW_{Controlled} * Hours * (ESF_{EE} - ESF_{Base}) * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting and provided in the Reference Table in Section 4.5 by buidling type.

For example, a 1,000 sqft. low-rise office building installing 10 networked, interior fixture-mounted occupancy sensors would save:

ΔTherms = $KW_{Controlled}$ * HOURS * (ESF_{EE} – ESF_{Base}) * - IFTherms

= 0.81 * 4,453 * (24% - 0%) * -0.01

= -8.7 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-OSLC-V10-260101

REVIEW DEADLINE: 1/1/2029

[1476] Coincidence Factor Study Residential and Commercial Industrial Lighting Measures, RLW Analytics, Spring 2007. Note, the connected load used in the calculation of the CF for occupancy sensor lights includes the average ESF.

4.5.11 Solar Light Tubes

DESCRIPTION

A tubular skylight which is 10" to 21" in diameter with a prismatic or translucent lens is installed on the roof of a commercial facility. The lens reflects light captured from the roof opening through a highly specular reflective tube down to the mounted fixture height. When in use, a light tube fixture resembles a metal halide fixture. Uses include grocery, school, retail and other single story commercial buildings.

In order that the savings characterized below apply, the electric illumination in the space must be automatically controlled to turn off or down when the tube is providing enough light.

This measure was developed to be applicable to the following program types: TOS, NC, RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a tubular skylight that concentrates and directs light from the roof to an area inside the facility.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment for this measure is a fixture with comparable luminosity. The specifications for the baseline lamp depend on the size of the Light Tube being installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life for a light tube commercial skylight is 10 years.[1477]

DEEMED MEASURE COST

If available, the actual incremental cost should be used. For analysis purposes, assume an incremental cost for a light tube commercial skylight is $750.[1478]

LOADSHAPE

Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)[1479]

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on location.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = kW_f * HOURS * WHFe$$

Where:

kW_f = Connected load of the fixture the solar tube replaces

[1477] Equal to the manufacturers standard warranty.
[1478] Based on review of solar lighting installers websites (e.g., elitesolarsystems.com).
[1479] The savings from solar light tubes are only realized during the sunlight hours. It is therefore appropriate to apply the single shift (8/5) loadshape to this measure.

Size of Tube	Average Lumen output for Chicago Illinois (minimum)[1480]	Equivalent fixture	kW
21"	9,775 (4,179)	50% 3 x 2 32W lamp CFL (207W, 9915 lumens) 50% 4 lamp F32 w/Elec 4' T8 (114W, 8895 lumens)	0.161
14"	4,392 (1,887)	50% 2 42W lamp CFL (94W, 4406 lumens) 50% 2 lamp F32 w/Elec 4' T8 (59W, 4448 lumens)	0.077
10"	2,157 (911)	50% 1 42W lamp CFL (46W, 2203 lumens) 50% 1 lamp F32 w/Elec 4' T8 (32W, 2224 lumens)	0.039
		AVERAGE	0.092

HOURS = Equivalent full load hours

= 2400 [1481]

WHF_e = Waste heat factor for energy to account for cooling energy savings from efficient lighting is selected from the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}{}^{1482} = kW_f * HOURS * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = kW_f * WHFd * ((CFbaseline * BaseAdj) - CFSL)$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is selected from the Reference Table in Section 4.5 for each building type. If the building is not cooled WHFd is 1.

CF = Summer Peak Coincidence Factor for measure is selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66.

CFbaseline = Baseline Summer Peak Coincidence Factor for the lighting system selected from the Reference Table in Section 4.5 for each building type. If the building type is unknown, use the Miscellaneous value of 0.66

BaseAdj = Assume 0.5 if existing lighting controls, 1.0 if no existing controls

[1480] Solatube Test Report (2005). http://www.mainegreenbuilding.com/files/file/solatube/stb_lumens_datasheet.pdf.
[1481] Ibid. The lumen values presented in the kW table represent the average of the lightest 2400 hours.
[1482] Negative value because this is an increase in heating consumption due to the efficient lighting.

CF_{SL} = Retrofit Summer Peak Coincidence Factor the lighting system with solar light tube installed is 0.15 regardless of building type.[1483]

FOSSIL FUEL SAVINGS

$$\Delta\text{Therms}^{1484} = kW_f * HOURS * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Please select from the Reference Table in Section 4.5 for each building type.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-STUB-V04-260101

REVIEW DEADLINE: 1/1/2030

[1483] Coincidence Factor Study Residential and Commercial Industrial Lighting Measures, RLW Analytics, Spring 2007. Note, the connected load used in the calculation of the CF for occupancy sensor lights includes the average ESF.
[1484]Negative value because this is an increase in heating consumption due to the efficient lighting.

4.5.12 T5 Fixtures and Lamps – Retired 12/31/2025, Removed in v14

4.5.13 Occupancy Controlled Bi-Level Lighting Fixtures

DESCRIPTION

This measure relates to replacing existing uncontrolled continuous lighting fixtures with new bi-level lighting fixtures. This measure can only relate to replacement in an existing building, since multi-level switching is required in the Commercial new construction building energy code (IECC 2012/2015/2018/2021/2024). This measure is limited to 24/7 operation.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient system is assumed to be an occupancy controlled lighting fixture operating 24/7, that reduces light level during unoccupied periods.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be an uncontrolled lighting system on continuously, e.g. in stairwells and corridors for health and safety reasons.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for all lighting controls is assumed to be 10 years.[1485]

DEEMED MEASURE COST

When available, the actual cost of the measure shall be used. When not available, the assumed measure cost is $274.[1486]

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

[1485] Consistent with Lighting Controls measure.
[1486] Consistent with the Multi-level Fixture measure with reference to Goldberg et al, State of Wisconsin Public Service Commission of Wisconsin, Focus on Energy Evaluation, Business Programs: Incremental Cost Study, KEMA, October 28, 2009. Also consistent with field experience of about $250 per fixture and $25 install labor.

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (KW_{Baseline} - (KW_{Controlled} * (1 - ESF))) * Hours * WHF_e$$

Where:

$KW_{Baseline}$ = Total baseline lighting load of the existing/baseline fixture

= Actual

Note that if the existing fixture is only being retrofit with bi-level occupancy controls and not being replaced $KW_{Baseline}$ will equal $KW_{Controlled}$.

$KW_{Controlled}$ = Total contolled lighting load at full light output of the new bi-level fixture

= Actual

Hours = Number of hours lighting is on. This measure is limited to 24/7 operation.

= 8,766

ESF = Energy Savings factor (represents the percentage reduction to the $KW_{Controlled}$ due to the occupancy control).

= % Standby Mode * (1 - % Full Light at Standby Mode)

% Standby Mode = Represents the percentage of the time the fixture is operating in standby (i.e. low-wattage) mode.

% Full Light at Standby Mode = Represents the assumed wattage consumption during standby mode relative to the full wattage consumption. Can be achieved either through dimming or a stepped control strategy.

= Dependent on application. If participant provided or metered data is available for both or either of these inputs a custom savings factor should be calculated. If not defaults are provided below:

Application	% Standby Mode	% Full Light at Standby Mode	Energy Savings Factor (ESF)
Stairwells	78.5%[1487]	50%	39.3%
		33%	52.6%
		10%	70.7%
		5%	74.6%
Corridors	50.0%[1488]	50%	25.0%
		33%	33.5%
		10%	45.0%

[1487] Average found from the four buildings in the State of California Energy Commission Lighting Research Program Bi-Level Stairwell Fixture Performance Final Report, October 2005.

[1488] Value determined from the Pacific Gas and Electric Company: Bi-Level Lighting Control Credits study for Interior Corridors of Hotels, Motels and High Rise Residential, June 2002.

Application	% Standby Mode	% Full Light at Standby Mode	Energy Savings Factor (ESF)
		5%	47.5%
Other 24/7 Space Type	50.0%[1489]	50%	25.0%
		33%	33.5%
		10%	45.0%
		5%	47.5%

WHF_e = Waste heat factor for energy to account for cooling energy savings from efficient lighting is provided in the Reference Table in Section 4.5 for each building type. If building is un-cooled, the value is 1.0.

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}{}^{1490} = (KW_{Baseline} - (KW_{Controlled} * (1 - ESF))) * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (KW_{Baseline} - (KW_{Controlled} * (1 - ESF))) * WHF_d * (CF_{baseline} - CF_{os})$$

Where:

WHF_d = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in the Reference Table in Section 4.5. If the building is un-cooled WHFd is 1.

$CF_{baseline}$ = Baseline Summer Peak Coincidence Factor for the lighting system without Occupancy Sensors installed.

= 1.0 (due to 24/7 operation)

CF_{os} = Retrofit Summer Peak Coincidence Factor the lighting system with Occupancy Sensors installed.

= 0.15 regardless of building type.[1491]

NATURAL GAS HEATING PENALTY

If natural gas heating:

$$\Delta therms = (KW_{Baseline} - (KW_{Controlled} * (1 - ESF))) * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting and provided in the Reference Table in Section 4.5 by buidling type.

[1489] Conservative estimate.

[1490] Negative value because this is an increase in heating consumption due to the efficient lighting.

[1491] Coincidence Factor Study Residential and Commercial Industrial Lighting Measures, RLW Analytics, Spring 2007. Note, the connected load used in the calculation of the CF for occupancy sensor lights includes the average ESF.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-OCBL-V07-270101

REVIEW DEADLINE: 1/1/2030

4.5.14 Commercial ENERGY STAR Specialty Compact Fluorescent Lamp (CFL) – Retired 12/31/2018, Removed in v8

4.5.15 LED Open Sign

DESCRIPTION

LED open signs must replace an existing neon open sign. LED drivers can be either electronic switching or linear magnetic, with the electronic switching supplies being the most efficient. The on/off power switch may be found on either the power line or load side of the driver, with the line side location providing significantly lower standby losses when the sign is turned off and is not operating. All new open signs must meet UL-84 (UL-844) requirements.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient product is an LED type illuminated open sign.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a neon type illuminated open sign.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life is 15 years.[1492]

DEEMED MEASURE COST

The actual measure installation cost should be used (including material and labor).

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section in Section 4.5.

[1492] 15 years from GDS Measure Life Report, June 2007.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

The following equation was used to determine the energy savings from installing LED open signs:

$$\Delta kWh = \frac{(WattsBase - WattsEE)}{1{,}000} * Hours * WHFe$$

Where:

$Watts_{base}$ = Wattage of neon sign with magnetic high voltage transformer

= Actual; if unknown use 46.0W[1493]

$Watts_{ee}$ = Wattage of LED sign with low voltage transformer

= Actual; if unknown use 14.9W[1494]

Hours = Annual hours of operation, assumed to be consistent with operating hours. Values are provided in the Reference Table in Section 4.5.

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}{}^{1495} = \frac{(WattsBase - WattsEE)}{1{,}000} * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

DEMAND SAVINGS

$$\Delta kW = \frac{(WattsBase - WattsEE)}{1{,}000} * WHFd * CF$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

Other variables as provided above.

[1493] Measured average demand data. Southern California Edison, "Replace Neon Open Sign with LED Open Sign", Workpaper SCE13LG070, Revision 2, October 2015. Pg. 10.

[1494] Ibid.

[1495] Negative value because this is an increase in heating consumption due to the efficient lighting.

Based on defaults provided above, the deemed energy savings are provided below:

Electric Energy and Coincident Peak Demand Savings

Building Types[1496]	Energy Savings (kWh)	$\Delta kWh_{heatpenalty}$ (if electric resistance heat)	$\Delta kWh_{heatpenalty}$ (if electric heat pump heat)	Coincident Demand Savings (kW)
Convenience Store	158	-120	-52	0.0298
Grocery	179	-39	-17	0.0311
Healthcare Clinic	138	-56	-24	0.0217
Hotel/Motel - Common	208	-78	-34	0.0333
Movie Theater	121	-73	-32	0.0227
Restaurant	187	-36	-16	0.0342
Retail - Department Store	135	-44	-19	0.0310
Miscellaneous	113	-37	-16	0.0271

FOSSIL FUEL SAVINGS

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta\text{Therms}^{1497} = \frac{(WattsBase - WattsEE)}{1{,}000} * Hours * -IFTherms$$

Where:

IFTherms = Lighting-HVAC Interation Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

Other factors as defined above

Based on defaults provided above, the deemed penalty is provided below:

Building Type	$\Delta Therms_{heatpenalty}$ (if gas heat)
Convenience Store	-5.1
Grocery	-1.7
Healthcare Clinic	-2.4
Hotel/Motel - Common	-3.2
Movie Theater	-3.2
Restaurant	-1.6
Retail - Department Store	-1.9
Miscellaneous	-1.6

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[1496] Savings can be calculated for additional building types using the default values provided in the Reference Table in Section 4.5.

[1497] Negative value because this is an increase in heating consumption due to the efficient lighting.

MEASURE CODE: CI-LTG-OPEN-V03-260101

REVIEW DEADLINE: 1/1/2029

4.5.16 LED Streetlighting

DESCRIPTION

Existing streetlights are retrofitted to be illuminated with light emitting diodes (LED) instead of less efficient lamps. Incentive applies for the replacement or retrofit of existing streetlights with new LED lamps.

This measure was developed to be applicable to the following program types: EREP, TOS*.
If applied to other program types, the measure savings should be verified.

* It is recommended to consider likely high freeridership for time of sale applications of this measure.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is the installed LED streetlight.

DEFINITION OF BASELINE EQUIPMENT

For TOS, baseline is assumed to be High Pressure Sodium lamp.

For early replacement, the baseline equipment is the existing streetlight for its' remaining useful life, and a new baseline High Pressure Sodium lamp for the remainder of the measure life. Where the existing fixture is Mercury Vapor (MV), the following table provides the deemed alignment of Mercury Vapor (MV) fixtures to High Pressure Sodium (HPS) for calculation of the midlife baseline adjustment.[1498]

MV Lamp Watts	MV System Watts	HPS Lamp Watts	HPS System Watts
100	125	50	66
175	205	100	138
250	290	100	138
400	455/469	250	295
1000	1075	400	465

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed effective useful life (EUL) of a new LED streetlight is 20 years for standard operation or 10 years for 8766 hour lighting.[1499]

For early replacement, it is assumed the existing unit has a remaining useful life (RUL) of 3 years for standard operation and 1.5 year for 8760 operation.[1500]

DEEMED MEASURE COST

The actual measure installation cost should be used (including material and labor). The assumed deferred cost (after 3 years for standard operation and 1.5 year for 8760 operation) of replacing the existing lamp with a new High

[1498] Midlife adjustment data is based on analysis by Guidehouse and is based on two years of AIC and ComEd program data, including 13,270 MV lamps and 96,780 HPS lamps. Both types of retrofits are mapped to the installed LED wattage, the resulting LED correlations are then used as a common frame of reference to align MV fixtures to the closest HPS equivalent. Results are further validated through the lumen equivalence method which confirms the alignments match the next closest lamp wattage, even if some HPS fixtures equate to higher lumen output whereas others provide lower output.

[1499] Based on research conducted by Guidehouse and reported in "ComEd LED St Lighting EUL Results Memo," January 27, 2020, Guidehouse reviewed a cross-section of products covered in 2019 energy conservation programs; these fixtures include the most commonly selected manufacturers and output spanning from 4,000 to 25,000 lumens. This review found that manufactures for the majority of LED streetlights installed through programs in IL have recently doubled the expected rated life to 100,000 hours.

[1500] Assuming an existing mercury vapor ballast with a typical rated life of 40,000. Assuming 1/3 remaining useful life and standard operation this equates to 40,000/3/4303 = 3 year remaining life, and 40,000/3/8760 = 1.5 year remaining life for 8760 operation.

Pressure Sodium lamp is assumed to be $44.[1501] This cost should be discounted to present value using the nominal discount rate.

LOADSHAPE

Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0 for standard usage or 1.0 for 8766 hour lighting.[1502]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

For remaining useful life (1st 3 years for standard operation and 1.5 year for 8760 operation) of existing equipment:

(1) $\Delta kWh = (W_{exist} - W_{eff}) * HOURS / 1000$

For remaining life of measure (next 17 years for standard operation and 8.5 years for 8760 operation) or time of sale:

(2) $\Delta kWh = (W_{base} - W_{eff}) * HOURS / 1000$

Where:

W_{exist} =the connected load of the existing equipment

= actual existing equipment wattage

W_{base} =the connected load of the baseline equipment

= assume appropriate High Pressure Sodium lamp wattage for application, see mapping table in 'Definition of Baseline Equipment section above'

W_{eff} =the connected load of the efficient equipment

= actual efficient equipment wattage

EFLH = annual operating hours of the lamp

= 4,303 hours for standard operation[1503]

= 8,766 hours for always on lighting

1000 = conversion factor (W/kW)

Mid Life Baseline Adjustment

[1501] High Pressure Sodium replacement cost (lamp and labor) was provided by ComEd based on their composite maintenance rate.

[1502] Assuming standard operation of streetlight occurs outside the summer peak period of 1-5 PM. Coincidence Factor is assumed to equal 0.

[1503] Based on Navigant verified value using 2014 Astronomical Applications Department, U.S. Naval Observatory data for ComEd's service territory. See Navigant Memorandum 'RE: LED Street Lighting Program Hours of Use for the ComEd and DCEO Programs. June 21, 2017'.

To calculate the mid life adjustment, divide the savings for remaining life of measure (1), by the first year savings (2) as provided above.

For example, an existing streetlight that uses a single 175 watt mercury vapor lamp is replaced by a 42W LED fixture. Accounting for ballast factor, the system load for the existing fixture is 205 watts. The HPS equivalent for the midlife adjustment is a 100 W lamp with total system load of 138 W. For a fixture with standard operating profile, the first year and lifetime savings for this installation are found as follows:

ΔkWh (first three years) = ((205 - 42) * 4,303) / 1000

= 701.4 kWh / year

ΔkWh (remaining seventeen years) = ((138 - 42) * 4,303) / 1000

= 413.2 kWh / year

Therefore, a midlife adjustment of 58.9% (413.2/701.4) would be applied after 3 years.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (W_{base} - W_{eff} Wbase \;\; Wbase - Weff \;) / 1000 * CF$$

Where:

CF = Summer Peak Coincidence Factor for measure

= 0 for Standard operation

= 1 for 8766 lighting

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

For EREP: to calculate an O&M adjustment, in addition to the deferred HPS replacement after 3 years, assume one additional HPS replacement lamp costing $44 in year nine and year fifteen for standard operation or every 2.7 years for 8,766 hour lighting.[1504]

For TOS: Assume one additional HPS replacement costing $44 every 6 years for standard operation or every 2.7 years for 8,766 hour lighting.

MEASURE CODE: CI-LTG-STRT-V04-250101

REVIEW DEADLINE: 1/1/2030

[1504] Assumes a rated life of the High Pressure Sodium lamp of 24,000 hours. High Pressure Sodium replacement cost (lamp and labor) was provided by ComEd based on their composite maintenance rate.

4.5.17 Exterior Photocell Repair

DESCRIPTION

This measure characterizes the repair of a photocell on an existing exterior light. A photocell is designed to switch exterior lights off during daylight hours, but if broken the fixtures may remain on 8760 hours.

This measure was developed to be applicable to the following program types: RF.
If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is an exterior light with a repaired or replaced photocell. The specifications and location of exterior lighting fixtures must be verified.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an exterior light with a broken photocell.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed measure life is 2 years.[1505]

DEEMED MEASURE COST

The deemed measure cost is $65.52 per lighting sensor.[1506]

LOADSHAPE

Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 1.0. The savings for this measure will be throughout the daytime hours.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{Watts_{fixture}}{1000} * (HOU_{PRE} - HOU_{POST})$$

Where:

$Watts_{fixture}$ = Input wattage of exterior lighting fixture(s) controlled by photocell

HOU_{PRE} = Fixture Annual Operating Hours before Photocell repair/replacement

= 8,766 hours[1507]

HOU_{POST} = Fixture Annual Operating Hours with Photocell repaired / replaced

[1505] Estimated remaining life of an exterior lamp running 8760 hours.
[1506] Wisconsin Focus on Energy TRM 2017 based on historical project data cost of 643 units over 31 projects from 2014 to 2018.
[1507] Exterior lighting with broken photocells are typically identified by visual inspection during the daytime and it is assumed that exterior lighting that is found to be on during daylight hours is on during *all* day and night hours.

= 4,303 hours[1508]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh}{(HOU_{PRE} - HOU_{POST})} * CF$$

Where:

CF = Summer Peak Coincidence Factor for measure

= 1 [1509]

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-PHRP-V02-260101

REVIEW DEADLINE: 1/1/2030

[1508] Assumption for Dusk to Dawn as provided in Section 4.5.

[1509] The savings for this measure will be throughout the daytime hours when the repaired photocell turns lighting off.

4.5.18 Ultra-Efficient LED Lighting

DESCRIPTION

This characterization provides savings assumptions for variety of ultra-efficient LED screw-based lamps including Omnidirectional (e.g., A-Type lamps), Decorative (e.g., Globes and Torpedoes) and Directional (PAR Lamps, Reflectors, MR16).

If the implementation strategy does not allow for the installation location to be known, for Residential targeted programs (e.g., an upstream retail program), a deemed split of 97% Residential and 3% Commercial assumptions should be used,[1510] and for Commercial targeted programs a deemed split of 97% Commercial and 3% Residential for non-linear LED Bulbs and 100% Commercial and 0% Residential for LED Fixtures and TLEDs should be used.[1511]

This measure was developed to be applicable to the following program types: TOS, NC, EREP, DI. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, new lamps must exceed efficiency specifications defined in the Baseline Efficacy tables below. Consult the tables to find the *minimum efficacy* that can be considered ultra-efficient for each bulb type.

Actual lamp wattages of the efficient equipment should be used to determine savings.

DEFINITION OF BASELINE EQUIPMENT

For TOS, NC or Kit programs, the baseline equipment is a standard LED bulb. See Baseline Efficacy tables below for specific baseline efficacies by lamp type and lumen output.

For Direct Install programs where it can be shown that the LED bulb is replacing working inefficient lighting, the existing inefficient lighting is baseline for the assumed remaining life of the existing lamp, and a standard LED bulb for the remainder of the measure life. A mid-life adjustment is therefore applied after 2 years, see Mid-Life Adjustment section below.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The lifetime for screw-based lamps is calculated as the rated lifetime of the product (actual if available, otherwise assume 20,000 hours for Omnidirectional, 17,000 hours for decorative and 25,000 for directional lamps based on average rated life of lamps on the ENERGY STAR Qualified Products list (accessed 6/16/2020)) divided by the reported operating hours, capped at 10 years.[1512]
For direct install programs, a mid-life adjustment is applied after 2 years.

DEEMED MEASURE COST

The actual ultra-efficient LED lamp cost should be used. For incremental cost, assume a baseline cost according to the following table[1513]:

[1510] RES v C&I split is based on a weighted (by sales volume) average of ComEd PY8, PY9 and CY2018 and Ameren PY8 in store intercept survey results. See 'RESvCI Split_2019.xlsx.

[1511] Based on ComEd's Instant Discounts program CY2018, CY2019 and CY2020 (Rounds 1 and 2) Purchaser Survey analysis. See ComEd Instant Discounts Enduser Survey TRM Updates.xlsx. For Residential installations, hours of use assumptions from '5.5.6 LED Downlights' should be used for LED fixtures and '5.5.8 LED Screw Based Omnidirectional Bulbs' should be used for LED bulbs.

[1513] Baseline and LED lamp costs are based on field data collected by CLEAResult and provided by ComEd. See ComEd Pricing Projections 06302016.xlsx for analysis. Given LED prices are expected to continue declining assumed costs should be reassessed on an annual basis and replaced with IL specific LED program information when available.

Bulb Type	Standard LED Baseline Cost
Omnidirectional	$2.70
Directional	$5.18
Decorative and Globe	$3.40

For Direct Install, assume the full ultra-efficient LED install cost, and a deferred baseline replacement cost (after 2 years) as provided above. This cost should be discounted to present value using the nominal societal discount rate.

LOADSHAPE

Loadshape C06 - Commercial Indoor Lighting
Loadshape C07 - Grocery/Conv. Store Indoor Lighting
Loadshape C08 - Hospital Indoor Lighting
Loadshape C09 - Office Indoor Lighting
Loadshape C10 - Restaurant Indoor Lighting
Loadshape C11 - Retail Indoor Lighting
Loadshape C12 - Warehouse Indoor Lighting
Loadshape C13 - K-12 School Indoor Lighting
Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)
Loadshape C18 - Industrial Indoor Lighting
Loadshape C19 - Industrial Outdoor Lighting
Loadshape C20 - Commercial Outdoor Lighting
Loadshape C60 – Non-Residential Agriculture Lighting – 6 Hours
Loadshape C61 – Non-Residential Agriculture Lighting – 8 Hours
Loadshape C62 – Non-Residential Agriculture Lighting – 12 Hours
Loadshape C63 – Non-Residential Dairy Long Day Lighting – 17 Hours
Loadshape C64 – Non-Residential Agriculture Lighting – 24 Hours

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the location type. Values are provided for each building type in the reference section below.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * WHFe$$

Where:

$Watts_{EE}$ = Actual wattage of LED purchased / installed must be used.

$Watts_{base}$ = LumensEE / $Efficacy_{Base}$

LumensEE = Lumens of ultra-efficient lamp

= Actual

$Efficacy_{Base}$ = Efficacy (Lumens/Watt) or standard efficiency LED baseline bulb.

= See table below[1514]:

Lamp Type	Minimum Lumens	Maximum Lumens	$Efficacy_{Base}$ (Lumens/Watt)
Omnidirectional	120	3299	93.6
Decorative	310	2700	100.6
Directional	310	3299	81.6
Additional EISA Non-Exempt Bulb Types	310	1999	91.1

Hours = Average hours of use per year are provided in the Reference Table in Section 4.5 for each building type. If unknown, use the Miscellaneous value.

WHFe = Waste heat factor for energy to account for cooling energy savings from efficient lighting are provided below for each building type in the Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

ISR = In Service Rate -the percentage of units rebated that actually get installed.

=100% if application form completed with sign off that equipment is not placed into storage.[1515] If sign off form not completed, assume the following ISR assumptions, if program survey data is not available:

Type	Lifetime In Service Rate (ISR)[1516]
LED Bulbs	97.6%[1517]
Efficiency Kits	92.4%[1518]

[1514] Average lumens per watt for each lamp type as provided in standard LED measures, based on Guidehouse file "LED Lamp Updates 2021-06-09".

[1515] Illinois evaluation of PY1 through PY3 has not found that fixtures or lamps placed into storage to be a significant enough issue to warrant including an "In-Service Rate" when commercial customers complete an application form.

[1516] In Service Rates now represent the lifetime In Service Rates with the second and third year installations discounted by the Real Discount Rate of 0.46%. Lifetime ISR assumptions for efficiency kits are based upon Residenital direct mailed kits. For all other programs Tthe 98% Lifetime ISR assumption is based upon the standard CFL measure in the absence of any better reference. This value is based upon review of two evaluations:
'Nexus Market Research, RLW Analytics and GDS Associates study; "New England Residential Lighting Markdown Impact Evaluation, January 20, 2009' and 'KEMA Inc, Feb 2010, Final Evaluation Report:, Upstream Lighting Program, Volume 1.' This implies that only 2% of bulbs purchased are never installed. The second and third year installations are based upon Ameren analysis of the Californian KEMA study showing that 54% of future installs occur in year 2 and 46% in year 3.

[1517] Based on ComEd's Instant Discounts program CY2019 and CY2020 (Rounds 1 and 2) Purchaser Survey analysis. See ComEd Instant Discounts Enduser Survey TRM Updates.xlsx

[1518] First year ISR is average ISR from CY2018, CY2019 and CY2020 ComEd Small Business Kit participant installation surveys. Please see file "SB Kits Survey Analysis TRMv10 Support.xlsx"

HEATING PENALTY

If electrically heated building:

$$\Delta kWh_{heatpenalty}{}^{1519} = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * -IFkWh$$

Where:

IFkWh = Lighting-HVAC Interation Factor for electric heating impacts; this factor represents the increased electric space heating requirements due to the reduction of waste heat rejected by the efficent lighting. Values are provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * WHFd * CF$$

Where:

WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting in cooled buildings is provided in Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

CF = Summer Peak Coincidence Factor for measure is provided in the Reference Table in Section 4.5. If unknown, use the Miscellaneous value.

FOSSIL FUEL SAVINGS

Heating Penalty if fossil fuel heated building (or if heating fuel is unknown):

$$\Delta Therms = \frac{(WattsBase - WattsEE)}{1{,}000} * ISR * Hours * - IFTherms$$

Where:

IFTherms = Lighting-HVAC Integration Factor for gas heating impacts; this factor represents the increased gas space heating requirements due to the reduction of waste heat rejected by the efficient lighting. Values are provided in the Referecne Table in Section 4.5. If unknown, use the Miscellaneous value.

Mid-Life Adjustment

For Direct Install programs a mid-life adjustment should be applied after two years. To calculate the adjustment perform the following calculation:

$$\text{Mid-life adjustment} = \frac{(Standard\ LED\ Lamp\ wattage - Ultra\ Efficient\ Lamp\ Wattage)}{(Existing\ Replaced\ Lamp\ Wattage - Ultra\ Efficient\ Lamp\ Wattage)}$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-LTG-ULED-V02-260101

REVIEW DEADLINE: 1/1/2030

[1519]Negative value because this is an increase in heating consumption due to the efficient lighting.

4.6.Refrigeration End Use

4.6.1 Automatic Door Closer for Walk-In Coolers and Freezers

DESCRIPTION

This measure is for installing an auto-closer to the main insulated opaque door(s) of a walk-in cooler or freezer. The auto-closer must firmly close the door when it is within 1 inch of full closure.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure consists of the installation of an automatic, hydraulic-type door closer on main walk-in cooler or freezer doors. These closers save energy by reducing the infiltration of warm outside air into the refrigeration itself.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be a walk in cooler or freezer without an automatic closure.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is 8 years.[1520]

DEEMED MEASURE COST

The deemed incremental measure cost, which includes labor costs, is $502 for a walk-in cooler or freezer.[1521]

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The measure has deemed kW savings therefore a coincidence factor does not apply.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Savings calculations are based on values from through SCE Workpaper SWCR005-03 – Auto-Closers for Refrigerated Storage Door. Savings are averaged across all California climate zones and vintages.[1522]

Annual Savings	kWh
Walk in Cooler	1,566
Walk in Freezer	3,031

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Annual Savings	kW
Walk in Cooler	0.312
Walk in Freezer	0.371

[1520] Measure life estimate is sourced from California DEER Ex-Ante Support Table – 2020, Auto-Closer for Walk-In Cooler/Freezer Doors (GrocWlkIn-DrClsr). For more detail, please see: "SupportTable_EUL2020.xlsx".
[1521] Commercial Refrigeration: Auto-Closer for Refrigerated Storage Door (SWCR005-03), California eTRM, November 21, 2023
[1522] Commercial Refrigeration: Auto-Closer for Refrigerated Storage Door (SWCR005-03), California eTRM, November 21, 2023. Energy savings are per cooler/freezer and represent an average of the modeled savings across all California climate zones.

FOSSIL FUEL SAVINGS

Natural gas savings are attributable to automatic door closers for refrigerated storage spaces. If the site is heated with natural gas as the primary fuel type, the following deemed fossil fuel savings can be claimed:[1523]

Annual Savings	Therms
Walk in Cooler	0.183
Walk in Freezer	0.516

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-ATDC-V04-270101

REVIEW DEADLINE: 1/1/2031

[1523] Commercial Refrigeration: Auto-Closer for Refrigerated Storage Door (SWCR005-03), California eTRM, November 21, 2023

4.6.2 Beverage and Snack Machine Controls

DESCRIPTION

This measure relates to the installation of new controls on refrigerated beverage vending machines, non-refrigerated snack vending machines, and glass front refrigerated coolers. Controls can significantly reduce the energy consumption of vending machine and refrigeration systems. Qualifying controls must power down these systems during periods of inactivity but, in the case of refrigerated machines, must always maintain a cool product that meets customer expectations. This measure relates to the installation of a new control on a new or existing unit. This measure should **not** be applied to ENERGY STAR[1524] qualified vending machines, as they already have built-in controls.

Vending machine categories are as defined[1525] below:

- Refrigerated Beverage Vending Machine: A commercial refrigerator that cools bottled and/or canned beverages and dispenses the bottled and/or canned beverages on payment. Bottled or canned beverages means a beverage in a sealed container.
    - Class A Machine: A refrigerated bottled and/or canned beverage vending machine that is not a combination vending machine and in which 25 percent or more of the surface area on the front side of the beverage vending machine is transparent.
    - Class B Machine: Any refrigerated bottled and/or canned beverage vending machine not considered to be Class A, and is not a combination vending machine.
- Combination Vending Machine: A bottled and/or canned beverage vending machine containing two or more compartments separated by a solid partition, that may or may not share a product delivery chute, in which at least one compartment is designed to be refrigerated, as demonstrated by the presence of temperature controls, and at least one compartment is not.
    - Combination A: Combination vending machine where 25 percent or more of the surface area on the front side of the beverage vending machine is transparent.
    - Combination B: Combination vending machine that is not considered to be Combination A.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a standard efficiency refrigerated beverage vending machine, non-refrigerated snack vending machine, or glass front refrigerated cooler with a control system capable of powering down lighting and refrigeration systems during periods of inactivity.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a standard efficiency refrigerated beverage vending machine, non-refrigerated snack vending machine, or glass front refrigerated cooler without a control system capable of powering down lighting and refrigeration systems during periods of inactivity

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 5 years.[1526]

[1524] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[1525] Code of Federal Regulations at 10 CFR 431. Subpart Q §431.296.
[1526] Measure Life Study, prepared for the Massachusetts Joint Utilities, Energy & Resource Solutions, November 2005.

DEEMED MEASURE COST

The actual measure installation cost should be used (including material and labor), but the following control costs[1527] can be assumed for analysis purposes:

Refrigerated Vending Machine and Glass Front Cooler: $245

Non-Refrigerated Vending Machine: $233

LOADSHAPE

Loadshape C52 - Beverage and Snack Machine Controls

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0.[1528]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \Delta\text{kWhLighting} + \Delta\text{kWhRef BMC}$$

$$\Delta\text{kWhLighting} = \frac{\left((8760 - \text{OccHours}) * \text{WBulb}\right)}{1000}$$

$$\Delta\text{kWhRef BMC} = \text{MDEC} * (\text{SleepHours} / 24) * \text{Days}$$

Where:

OccHours = Average Annual Hours facility is occupied [1529]

= Actual, if unknown[1530] assume 3,379 hrs

W_{Bulb} = Wattage of bulb in Refrigerated Beverage Vending Machine.

= Actual. If unknown use 56.4 W[1531] for fluorescent T8 bulbs[1532] and 31.6 W[1533] for TLEDs.

MDEC = Maximum Daily Energy Consumption per Federal regulations[1534]. Refrigerated Volume of 21 (ft^3) used in the calculations[1535]. If unknown, assume Class B, post-2019[1536]:

[1527] Measure Data and Specifications for the "Vending and Beverage Merchandise Controller", from the California eTRM, last updated 12/27/2018. Measure cost + Labor cost. The refrigerated machine was an average of several types (Double, single and triple doors). *Please see file: SWAP011-01 MeasureDataSpec - Vending and Beverage Merchandise Controller r0.6.xlsm*

[1528] Assumed that the peak period is coincident with periods of high traffic diminishing the demand reduction potential of occupancy based controls.

[1529] Occupied hours of Use per IL TRM Section 4.5 Lighting, Fixture Annual Operating Hours.

[1530] If location is known, but hours are unknown, see IL TRM Section 4.5 Lighting, for list of various locations and Annual Hours.

[1531] See 3.4.5 LED Fixtures for the F32T8 Standard Lamp - 4 foot x 2 bulbs.

[1532] Per Houghton, D. 1996. "Refrigerated Vending Machines - Overlooked Devices Hold Opportunities for Efficiency, New Services." E Source Tech Update, TU-96-7, the typical backlit display for a refrigerated beverage vending machine consists of two five-foot linear fluorescent lamps." (PGE, SWAP011-01 Vending and Beverage Merchandise Controller measure, MeasureDataSpec file)

[1533] See 3.4.5 LED Fixtures for the TLED Lamp x 2 bulbs.

[1534] 10 CFR 431. Subpart Q §431.296 (a) & (b). https://www.ecfr.gov/current/title-10/section-431.296

[1535] U.S. Department of Energy (DOE), Office of Energy Efficiency and Renewable Energy, Federal Energy Management Program. (n.d.) "Purchasing Energy-Efficient Refrigerated Beverage Vending Machines." Updated January 2020.

[1536] Those standards are the most stringent and therefore savings would be conservative.

Class	Vintage	EQN	MDEC (kWh/d)
A	post-2019	0.052 * V + 2.43	3.52
B		0.052 * V + 2.20	3.29
Combination A		0.086 * V + 2.66	4.47
Combination B		0.111 * V + 2.04	4.37
A	pre-2019	0.055 * V + 2.56	3.72
B		0.073 * V + 3.16	4.69

SleepHours = Maximum hours of sleep mode per day.

= 4 hrs[1537]

Days = Operating Days/yr.

= 365

For example, adding controls to a Class B post-2019 Vintage refrigerated beverage vending machine in an unknown location:

$\Delta kWh = \Delta kWh_{ligthing} + \Delta kWh_{Ref\ BMC}$

$\Delta kWh_{ligthing}$ = (8760 – OccHours) * W_{Bulb}

= ((8760 – 3,379) * 72 W) / 1,000

= 387 kWh/yr

$\Delta kWh_{Ref\ BMC}$ = MDEC * SleepHours/24 * Days

= 3.29 * 4/24 * 365

= 200 kWh/yr

ΔkWh = 587 kWh/yr

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-BEVM-V05-260101

REVIEW DEADLINE: 1/1/2029

[1537] Itron, Inc. 2005. 2004-2005 Database for Energy Efficiency Resources (DEER) Update Study - Final Report. Prepared for the California Public Utilities Commission. Pg 3-22.

4.6.3 Door Heater Controls for Cooler or Freezer

DESCRIPTION

By installing a control device to turn off door heaters when there is little or no risk of condensation, one can realize significant energy savings. There are two commercially available control strategies that achieve "on-off" control of door heaters based on either (1) the relative humidity of the air in the store, or (2) the "conductivity" of the door (which drops when condensation appears). In the first strategy, the system activates your door heaters when the relative humidity in your store rises above a specific setpoint, and turns them off when the relative humidity falls below that setpoint. In the second strategy, the sensor activates the door heaters when the door conductivity falls below a certain setpoint, and turns them off when the conductivity rises above that setpoint.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a door heater control on a commercial glass door cooler or refrigerator utilizing humidity or conductivity control.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline condition is assumed to be a commercial glass door cooler or refrigerator with a standard heated door with no controls installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.[1538]

DEEMED MEASURE COST

The incremental capital cost, including labor costs, for a refrigeration door heater control, regardless of the control strategy, on a per door basis is $79.50 per cooler door and $90.77 per freezer door.[1539]

LOADSHAPE

Loadshape C51 - Door Heater Control

COINCIDENCE FACTOR[1540]

The summer peak coincidence factor for this measure is assumed to be 44%.[1541]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWH = kWbase * NUMdoors * ESF * BF * 8766$$

Where:

[1538] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[1539] Door heater control unit costs are based on historical cost data, specific to the state of Illinois, collected by Ameren. See reference "Door Heater Costs AIC.xlsx" for more detail.
[1540] Source partial list from DEER 2008.
[1541] The summer peak coincidence factor is sourced from; Cadmus, "Commercial Refrigeration Loadshape Project Final Report", Northeast Energy Efficiency Partnership, Regional Evaluation, Measurement, and Verification Forum, Lexington, MA, 2015 (table 39). The coincidence factor is based on the run-time profile of anti-sweat door heater controls, for all control types, for summer peak hours, and represents an average of the monitored reduced run time between heaters with and without controls.

kWbase = connected load kW for typical reach-in refrigerator or freezer door and frame with a heater.

= If actual kWbase is unknown, assume 0.230 kW for freezers and 0.066 kW for coolers.[1542]

NUMdoors = number of reach-in refrigerator or freezer doors controlled by sensor

= Actual installed

ESF = Energy Savings Factor; represents the percentage of hours annually that the door heater is powered off due to the controls.

= 45% for all control types [1543]

BF = Bonus Factor; represents the increased savings due to reduction in cooling load inside the cases, and the increase in cooling load in the building space to cool the additional heat generated by the door heaters. [1544]

Definition	Representative Evaporator Temperature Range, °F[1545]	Typical Uses	BF
Low	-35 to 0	Freezers for times such as frozen pizza, ice cream, etc.	1.50
Medium	0 – 20	Coolers for items such as meat, milk, dairy, etc	1.30
High	20 – 45	Coolers for items such as floral, produce and meat preparation rooms	1.30

8766 = annual hours of operation

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWH \,/\, 8766) * CF$$

Where:

CF = Summer Coincident Factor for the measure

= 0.44[1546]

FOSSIL FUEL SAVINGS

N/A

[1542] Wattages per door derived from NEEP Refrigeration Loadshape Report. The Cadmus Group, Commercial Refrigeration Loadshape Project Final Report, Northeast Energy Efficiency Partnerships, Regional Evaluation, Measurement, and Verification Forum, Lexington, MA 2015 (pg. 57). For more detail, see reference file: IL TRM_Door Heater Control_Analysis_Jun 2021.xlsx

[1543] Difference in effective runtime of an uncontrolled heater and all control style heater controls. Anti-sweat door heater control reduced run time. The Cadmus Group, Commercial Refrigeration Loadshape Project Final Report, Northeast Energy Efficiency Partnerships, Regional Evaluation, Measurement, and Verification Forum, Lexington, MA 2015. Page 69, Section 4.1.4, Table 37.

[1544] Cooler and freezer bonus factors are from NEEP Refrigeration Loadshape Report. The Cadmus Group, Commercial Refrigeration Loadshape Project Final Report, Northeast Energy Efficiency Partnerships, Regional Evaluation, Measurement, and Verification Forum, Lexington, MA 2015 (pg. 78)

[1545] Energy Efficiency Supermarket Refrigeration, Wisconsin Electric Power Company, July 23, 1993.

[1546] The summer peak coincidence factor is sourced from; Cadmus, "Commercial Refrigeration Loadshape Project Final Report", Northeast Energy Efficiency Partnership, Regional Evaluation, Measurement, and Verification Forum, Lexington, MA, 2015 (table 39). The coincidence factor is based on the run-time profile of anti-sweat door heater controls, for all control types, for summer peak hours, and represents an average of the monitored reduced run time between heaters with and without controls.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-DHCT-V04-220101

REVIEW DEADLINE: 1/1/2030

4.6.4 Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers

DESCRIPTION

This measure is applicable to the replacement of an existing, uncontrolled, and continuously operating standard-efficiency shaded-pole evaporator fan motor in refrigerated display cases or fan coil in walk-ins.

This measure achieves savings by installing a more efficient motor, the result of which produces less waste heat that the cooling system must reject.

If applicable, savings from this measure may be claimed in combination with measure 4.6.6 Evaporator Fan Control for Electrically Commutated Motors.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to the replacement of an existing standard-efficiency shaded-pole evaporator fan motor in refrigerated display cases or fan coil in walk-ins. The replacement unit must be an electronically commutated motor (ECM) with a minimum efficiency of 66%. If controls are added as part of the motor upgrade to reduce annual run time, additional savings may potentially be claimed using measure 4.6.6 Evaporator Fan Control.

DEFINITION OF BASELINE EQUIPMENT

The baseline is the existing shaded-pole motor(s) with no fan control operating 8760 hours continuously in a refrigerated display case or fan coil unit of a walk-in cooling unit.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years.[1547]

DEEMED MEASURE COST

The measure cost is assumed to be as follows, per motor, for a walk in cooler or walk in freezer:[1548]

Walk-In Type	Equipment Cost ($)	Labor $/ECM Motor	Total $ per motor
Cooler	$358.50	$63.80	$422.30
Freezer	$208.52	$63.80	$272.32
Unknown (average)	$283.51	$63.80	$347.31

LOADSHAPE

Loadshape C53 - Flat

COINCIDENCE FACTOR

The peak kW coincidence factor is 100%.

[1547] DEER, Work Paper PGE3PREF126 ECM for Walk-In Evaporator with Fan Controller Revision # 2

[1548] CA eTRM "ECM Retrofit for a Walk-in Cooler or Freezer" measure, supporting Cost Data (file = swcr004-02_cost_analysis.xlsx).

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = Savings\ per\ motor\ *\ motors$$

Where:

Savings per motor = based on the motor rating of the ECM motor:

Evaporator Fan Motor Rating (of ECM)	Annual kWh Savings/motor
16W	652
1/15 - 1/20HP	1,586
1/5HP	2,320
1/3HP	3,380
1/2HP	4,481
3/4HP	5,293

= If unknown, assume 1/15 HP, therefore 1,586 kWh saved / motor[1549]

motors = number of fan motors replaced

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / Hours\ *\ CF\ *\ motors$$

Where:

ΔkWh = Gross customer annual kWh savings for the measure, as listed above

= If unknown, assume 1,586 kWh[1550]

Hours = Full Load hours per year

= 8760

CF = Summer Peak Coincident Factor

= 1.0

Other variables as defined above.

The following table provides the resulting kW savings (per motor), if unknown assume 0.181 kW saved / motor:[1551]

Evaporator Fan Motor Rating (of ECM)	Peak kW Savings/motor
16W	0.074
1/15 - 1/20HP	0.181
1/5HP	0.265
1/3HP	0.386
1/2HP	0.512
3/4HP	0.604

[1549] Default motor size for EC Evaporator was found to be ≤ 1/15 HP per the ComEd Standard Program data. See ECM Motor Size Supplement.xlsx.

[1550] Ibid.

[1551] Ibid.

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-ECMF-V05-250101

REVIEW DEADLINE: 1/1/2030

4.6.5 ENERGY STAR Refrigerated Beverage Vending Machine

DESCRIPTION

ENERGY STAR[1552] qualified new and rebuilt vending machines incorporate more efficient compressors, fan motors, and lighting systems as well as low power mode option that allows the machine to be placed in low-energy lighting and/or low-energy refrigeration states during times of inactivity.

This measure was developed to be applicable to the following program types: TOS, NC .

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The refrigerated vending machine can be new or rebuilt but must meet the ENERGY STAR specifications, as outlined below.[1553]

A. Refrigerated Beverage Vending Machine: A commercial refrigerator that cools bottled and/or canned beverages and dispenses the bottled and/or canned beverages on payment. Bottled or canned beverages means a beverage in a sealed container.

a. Class A Machine: A refrigerated bottled and/or canned beverage vending machine that is not a combination vending machine and in which 25 percent or more of the surface area on the front side of the beverage vending machine is transparent.

b. Class B Machine: Any refrigerated bottled and/or canned beverage vending machine not considered to be Class A, and is not a combination vending machine

B. Combination Vending Machine: A bottled and/or canned beverage vending machine containing two or more compartments separated by a solid partition, that may or may not share a product delivery chute, in which at least one compartment is designed to be refrigerated, as demonstrated by the presence of temperature controls, and at least one compartment is not.

a. Combination A Machine: A combination vending machine where 25 percent or more of the surface area on the front side of the beverage vending machine is transparent.

b. Combination B Machine: A combination vending machine that is not considered to be Combination A.

DEFINITION OF BASELINE EQUIPMENT

The baseline vending machine is a standard unit.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed lifetime of this measure is 14 years.[1554]

DEEMED MEASURE COST

The incremental cost of this measure is $500.[1555].

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

It is assumed that controls are only effective during off-peak hours and so have no peak-kW savings.

[1552] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[1553] ENERGY STAR Program Requirements Specification for Refrigerated Beverage Vending Machines, Version 4.0
[1554] ENERGY STAR
[1555] ENERGY STAR

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Using the ENERGY STAR MDEC Equations, as specified in the above paragraph and the Baseline Equipment DOE Standards,[1556] the theoretical energy savings are calculated as:

$$\Delta\text{kWh} = (MDEC_{Baseline} - MDEC_{Efficient}) * Days$$

Where:

MDEC*Baseline* = Maximum Daily Energy Consumption calculated using the equation from the table below, specific for the baseline equipment class and the volume range

MDEC*Efficient* = Maximum Daily Energy Consumption calculated using the equation from the table below, specific for the ENERGY STAR Specification 4.0 equipment class and the volume range

Days = Days per year

= Actual. If unknown, assume 365.

Maximum Daily Energy Consumption (MDEC) equations for Baseline Equipment and ENERGY STAR equipment compliant with ENERGY STAR Specification V4.0 are outline in the table below:

Product Class	Refrigerated Volume Range (ft^3)	MDEC Equation (kWh/day) Federal Standard: Baseline	MDEC Equation (kWh/day) ENERGY STAR V4.0
Class A	11.5 - 38.5	0.052 * V + 2.43	0.04836 * V + 2.2599
Class B	21.8 - 30.5	0.052 * V + 2.20	0.04576 * V + 1.936
Combination A	9.7 - 16	0.086 * V + 2.66	0.07998 * V + 2.4738
Combination B	N/A	0.111 * V + 2.04	0.09768 * V + 1.7952

Where:

V = the refrigerated volume (ft^3) of the refrigerated bottled or canned beverage vending machine, as specified in Appendix C.[1557]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

[1556] CFR Title 10: Energy. PART 431—ENERGY EFFICIENCY PROGRAM FOR CERTAIN COMMERCIAL AND INDUSTRIAL EQUIPMENT. 10 CFR 431.296 (b), effective January 8, 2019. https://www.ecfr.gov/current/title-10/section-431.296

[1557] Appendix C of the American National Standards Institute (ANSI)/ American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE) Standard 32.1 - 2010, ‘‘Methods of Testing for Rating Vending Machines for Bottled, Canned or Other Sealed Beverages.” For combination vending machines, the refrigerated volume does not include any non-refrigerated compartments.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-ESVE- V06-260101

REVIEW DEADLINE: 1/1/2029

4.6.6 Evaporator Fan Control for Electrically Commutated Motors

DESCRIPTION

This measure is for the installation of controls for Electronically Commutated Motors in existing medium temperature walk-in coolers. The controller reduces airflow of the evaporator fans when there is no refrigerant flow.

This measure achieves savings by controlling the motor(s) to run at lower speeds (or shut off entirely) when there is no refrigerant flow, the result of which produces less waste heat that the cooling system must reject.

If eligible, this measure may be claimed in combination with 4.6.4 Electronically Commutated Motors (ECM) for Walk-in and Reach-in Coolers / Freezers.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure must control a minimum of 1/20 HP where fans operate continuously at full speed. The measure also must reduce fan motor power by at least 75% during the off cycle. This measure is not applicable if any of the following conditions apply:

- The compressor runs more than 4380 hours annually
- The evaporator fan does not run at full speed all the time
- The evaporator fan motor runs on poly-phase power
- Evaporator does not use off-cycle or time-off defrost.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the existing condition must be a reach-in or walk-in freezer or cooler with continuously running evaporator fans driven by Electrically Commutated Motors

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 13 years.[1558]

DEEMED MEASURE COST

The measure cost is assumed to be $69.69 (controller equipment) plus $92.06 (controller labor) = $161.75 per motor controlled.[1559]

LOADSHAPE

Loadshape C46 - Evaporator Fan Control

COINCIDENCE FACTOR

The measure has deemed kW savings therefore a coincidence factor does not apply.

Algorithm

CALCULATION OF SAVINGS

Savings are based on a measure created by Energy & Resource Solutions for the California Municipal Utilities Association[1560] and supported by a PGE workpaper. Note that climate differences across all California climate zones result in negligible savings differences, which indicates that the average savings for the California study should apply equally as well to Illinois. Savings found in the aforementioned source are presented in combination with savings

[1558] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[1559] Source: DEER, Work Paper PGE3PREF126 ECM for Walk-In Evaporator with Fan Controller Revision # 2
[1560] See reference Excel files in TRM Reference Documents folder for derivation of TRM values.

from an ECM upgrade, however for the purposes of this measure only those associated with the controller are considered.

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = Savings\ per\ motor\ *\ motors$$

Where:

Savings per motor = based on the motor rating of the ECM motor:

Evaporator Fan Motor Rating (of ECM)	Annual kWh Savings/motor
16W	198
1/15 - 1/20HP	293
1/5HP	856
1/3HP	1,419
1/2HP	2,126
3/4HP	3,209

motors = number of fan motors controlled

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = Peak kW savings per motor (as listed in the table below) * motors (as defined above)

Evaporator Fan Motor Rating (of ECM)	Peak kW Savings/motor
16W	0.023
1/15 - 1/20HP	0.033
1/5HP	0.098
1/3HP	0.162
1/2HP	0.243
3/4HP	0.366

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-EVPF-V05-250101

REVIEW DEADLINE: 1/1/2029

4.6.7 Strip Curtain for Walk-in Coolers and Freezers

DESCRIPTION

This commercial measure pertains to the installation of infiltration barriers (strip curtains) on walk-in coolers or freezers. Strip curtains impede heat transfer from adjacent warm and humid spaces into walk-ins when the main door is opened, thereby reducing the cooling load. As a result, compressor run time and energy consumption are reduced. The engineering assumption is that the walk-in door is open for varying durations per day based on facility type, and the strip curtain covers the entire door frame. All algorithms and assumptions are based on prescriptive methodologies detailed by the Regional Technical Forum[1561], whose source calculations are outlined in ASHRAE's Refrigeration Handbook for calculating refrigeration load from infiltration by air exchange.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a strip curtain at least 0.06 inches thick added to a walk-in cooler or freezer.[1562] The new strip curtain must cover the entire area of the doorway when the door is opened.

DEFINITION OF BASELINE EQUIPMENT

The baseline assumption is a walk-in cooler or freezer that previously had either no strip curtain installed or an old, ineffective strip curtain installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 4 years.[1563]

DEEMED MEASURE COST

The incremental capital cost for this measure is $10.22/sq ft of door opening.[1564]

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is 100%.[1565]

1561 Database for UES Measures, Regional Technical Forum, Strip Curtains, version 2.1, September 2019

[1562]Pennsylvania Public Utility Commission Technical Reference Manual, Volume 3: Commercial and Industrial Measures, State of Pennsylvania Act 129 Energy Efficiency and Conservation Program & Act 213 Alternative Energy Portfolio Standards, Revised February 2021 -- Chapter 3.5.8 Strip Curtains for Walk-in Freezers and Coolers.

[1563]DEER 2014 Effective Useful Life.

[1564] The reference for incremental cost is $10.22 per square foot of door opening (includes material and labor). 2008 Database for Energy-Efficiency Resources (DEER), Version 2008.2.05, "Cost Values and Summary Documentation", California Public Utilities Commission, December 16, 2008.

[1565] The summer coincident peak demand reduction is assumed as the total annual savings divided by the total number of hours per year, effectively assuming the average demand reduction is realized during the peak period. This is a reasonable assumption for refrigeration savings.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS[1566]

$$\Delta kWh = \Delta kWh/sq\ ft * A$$

Where:

ΔkWh/sq ft = Average annual kWh savings per square foot of infiltration barrier. Deemed values can be found in the table below

A = Doorway area in square feet.

= Actual. If the actual doorway area in square feet is unknown, then use the values found in the table below

Default Energy Savings and Door Area for Strip Curtains[1567]

Type	Pre-Existing Curtains	Energy Savings ΔkWh/sq ft	Doorway Area (sqft)
Supermarket - Cooler	Yes	40.9	21
Supermarket - Cooler	No	119.9	
Supermarket - Freezer	Yes	168.5	21
Supermarket - Freezer	No	494.3	
Convenience Store - Cooler	Yes	6.3	21
Convenience Store - Cooler	No	23.6	
Convenience Store - Freezer	Yes	10.0	21
Convenience Store - Freezer	No	33.2	
Restaurant - Cooler	Yes	6.2	21
Restaurant - Cooler	No	22.5	
Restaurant - Freezer	Yes	32.4	21
Restaurant - Freezer	No	114	
Refrigerated Warehouse	Yes	53.4	120
Refrigerated Warehouse	No	153.4	

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh\ /\ 8766 * CF$$

Where:

8766 = hours per year

[1566] The source algorithm from which the savings per square foot values are determined is based on Tamm's equation (an application of Bernoulli's equation) [Kalterveluste durch kuhlraumoffnungen. Tamm W,.Kaltetechnik-Klimatisierung 1966;18;142-144;] and the ASHRAE handbook [American Society of Heating, Refrigeration, and Air-Conditioning Engineers (ASHRAE). 2010. ASHRAE Handbook, Refrigeration: 13.4, 13.6].

[1567] Database for UES Measures, Regional Technical Forum, Strip Curtains, version 2.1, September 2019. Custom edits were made to the workbook in order for savings approach to align with this measure workpaper. The In-Service-Rate (described as the Removal Rate by the RTF workbook) was changed from 25% to 0%. Additionally, a 58% efficacy value was inputted for sites that had existing, but inefficient strip curtains prior to retrofit. This value is sourced from tracer gas measurements on over 100 walk-in refrigeration units during the California Public Utility Commission's (CPUC) evaluation of the 2006-2008 CA investor owned utility energy efficiency programs. The baseline curtain efficacy rates are taken from short-term monitoring of over 100 walk-in units. "Commercial Facilities Contract Group 2006-2008 Direct Impact Evaluation", CPUC, February 2010.

CF = Summer Peak Coincidence Factor for the measure

= 1.0

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-CRTN-V05-220101

REVIEW DEADLINE: 1/1/2030

4.6.8 Refrigeration Economizers

DESCRIPTION

This measure applies to commercial walk in refrigeration systems and includes two components, outside air economizers and evaporator fan controllers. Economizers save energy by bringing in outside air when weather conditions allow, rather than operating the compressor. Walk-in refrigeration systems evaporator fans run almost all the time; 24 hrs/day, 365 days/yr. This is because they must run constantly to provide cooling when the compressor is running, and to provide air circulation when the compressor is not running. However, evaporator fans are a very inefficient method of providing air circulation. Installing an evaporator fan control system will turn off evaporator fans while the compressor is not running, and instead turn on an energy-efficient 35 watt fan to provide air circulation, resulting in significant energy savings. This measure allows for economizer systems with evaporator fan controls plus a circulation fan and without a circulation fan.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified. IECC code requires economizers in certain instances and therefore projects relying on code baseline definitions must verify eligibility.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure an economizer is installed on a walk in refrigeration system.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a walk-in refrigeration system without an economizer.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated life of this measure is 15 years.[1568]

DEEMED MEASURE COST

Installation costs can vary considerably depending on system size (larger systems may require multiple economizer units), physical site layouts (locating economizer intakes and ductwork), and controls elected. Therefore, actual site-specific costs should be used.

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0%.[1569]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Electric energy savings is calculated dependent on whether evaporator fans controls are installed.

With Fan Control Installed

$$\Delta kWh = [HP * kWhCond] + [((kWEvap * nFans) - kWCirc) * Hours * DCComp * BF] - [kWEcon * DCEcon * Hours]$$

Without Fan Control Installed

[1568] Estimated life from DEER Work Paper PGE3PREF126.

[1569] The economizer is only assumed to run when the outside temperature is below 33F (a 38°F cooler setpoint and 5 degree economizer deadband). Therefore savings will not coincide with the summer peak period.

$$\Delta kWh = [HP * kWhCond] - [kWEcon * DCEcon * Hours]$$

Where:

HP = Horsepower of Compressor

= actual installed

kWhCond = Condensing unit savings, kWh/HP[1570]

Climate Zone (City based upon)	Hermetic / Semi-Hermetic	Scroll	Discus
1 (Rockford)	494	434	410
2 (Chicago/O'Hare)	423	372	352
3 (Springfield)	321	282	267
4 (Belleview)	230	202	191
5 (Marion)	136	119	113

Hours = Number of annual hours that economizer operates [1571]

Region (city)	Hours
1 (Rockford)	2,033
2 (Chicago/O'Hare)	1,806
3 (Springfield)	1,350
4 (Belleview)	1,112
5 (Marion)	752

DCComp = Duty cycle of the compressor

= 50% [1572]

kWEvap = Connected load kW of each evaporator fan

= If known, actual installed. Otherwise assume 0.126 kW[1573]

kWCirc = Connected load kW of the circulating fan

= If known, actual installed. Otherwise assume 0.035 kW[1574]

nFans = Number of evaporator fans

= actual number of evaporator fans

DCEcon = Duty cycle of the economizer fan on days that are cool enough for the economizer to be working

[1570] Savings table uses Economizer Calc_Revised052024.xls. Assume 5HP compressor size used to develop kWh/Hp value. No floating head pressure controls and compressor is located outdoors. Bin Data for IL zones uses TMYx data.

[1571] In the source TRM (VT) this value was 2,996 hrs based on 38° F cooler setpoint, Burlington VT weather data, and 5 degree economizer deadband. The IL numbers were calculated by using weather bin data for each location (number of hours < 38F at each location is the Hours value) from TMYx data.

[1572] A 50% duty cycle is assumed based on examination of duty cycle assumptions from refrigeration suppliers (35%-65%), Cooltrol (35%-65%), Natural Cool (70%), Pacific Gas & Electric (58%). Also, manufacturers typically size equipment with a built-in 67% duty factor and contractors typically add another 25% safety factor, which results in a 50% overall duty factor.

[1573] Based on a weighted average of 80% shaded pole motors at 175 watts and 20% PSC motors at 84 watts. Motor wattage and efficiency values referenced from Oak Ridge National Laboratory, "Permanent Magnet Synchronous Motors for Commercial Refrigeration: Final Report", 2019. Table 1, page xiv; Table 24, page 57.

[1574] Wattage of fan used by Freeaire and Cooltrol. This fan is used to circulate air in the cooler when the evaporator fan is turned off. As such, it is not used when fan control is not present.

= If known, actual installed. Otherwise assume 63%[1575]

BF = Bonus factor for reduced cooling load from reduction of waste heat generation as a result of running the evaporator fan less

= 1.3[1576]

kWEcon = Connected load kW of the economizer fan

= If known, actual installed. Otherwise assume 0.227 kW.[1577]

For example, adding an outdoor air economizer and fan controls in Rockford to a 5 hp hermetic compressor walk in refrigeration unit with 3 evaporator fans would save:

ΔkWh = [hp * kWhCond] + [((kWEvap * nFans) – kWCirc) * Hours * DCComp * BF] – [kWEcon * DCEcon * Hours]

= [5 * 494] + [((0.126 * 3) – 0.035) * 2033 *0.5 * 1.3] – [0.227 * 0.63 * 2033]

= 2633 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \Delta kWh \; / \; Hours \; * \; CF$$

Where:

CF = Summer Peak Coincidence Factor for the measure

= 0 [1578]

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-ECON-V08-240101

REVIEW DEADLINE: 1/1/2028

[1575] Average of two manufacturer estimates of 50% and 75%.

[1576] Bonus factor (1+ 1/3.5) assumes COP of 3.5, based on the average of standard reciprocating and discus compressor efficiencies with a Saturated Suction Temperature of 20°F and a condensing temperature of 90°F.

[1577] The 227 watts for an economizer is calculated from the average of three manufacturers: Freeaire (186 Watts), Cooltrol (285 Watts), and Natural Cool (218 Watts).

[1578] The economizer is only assumed to run when the outside temperature is below 33F (a 38°F cooler setpoint and 5 degree economizer deadband). Therefore savings will not coincide with the summer peak period.

4.6.9 Night Covers for Open Refrigerated Display Cases

DESCRIPTION

This measure is the installation of fitted covers on existing open-type refrigerated and freezer display cases that are deployed during the facility unoccupied hours. Night covers are designed to reduce refrigeration energy consumption by reducing the work done by the compressor. Night covers reduce the heat and moisture entry into the refrigerated space through various heat transfer mechanisms. By fully or partially covering the case opening, night covers reduce the convective heat transfer into the case through reduced air infiltration. Additionally, they provide a measure of insulation, reducing conduction into the case, and also decrease radiation into the case by blocking radiated heat from entering the refrigerated space.

DEFINITION OF EFFICIENT EQUIPMENT

Curtains or covers on top of open refrigerated or freezer display cases that are applied at least six hours (during off-hours) in a 24-hour period.

DEFINITION OF BASELINE EQUIPMENT

Refrigerated and freezer, open-type display case in vertical, semi-vertical, and horizontal displays, with no night cover.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 5 years, based on DEER 2014.[1579]

DEEMED MEASURE COST

The incremental capital cost for this measure is $42 per linear foot of cover installed including material and labor.[1580]

LOADSHAPE

Loadshape 22: Commercial Refrigeration

COINCIDENCE FACTOR

N/A – savings occur at night only.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ES * L$$

Where:

ES = the energy savings (ΔkWh/ft) found in table below:

[1579] 2014 Database for Energy-Efficiency Resources (DEER), Version 2014, "Cost Values and Summary Documentation", California Public Utilities Commission, January, 2014. Referenced in PG&E workpaper PGECOREF101 Night Covers for Display Cases, July 2014.

[1580] 2014 Database for Energy-Efficiency Resources (DEER), Version 2014, "Cost Values and Summary Documentation", California Public Utilities Commission, January, 2014. Referenced in PG&E workpaper PGECOREF101 Night Covers for Display Cases, July 2014.

Display Case Description	Case Temperature Range (°F)	Annual Electricity Use kWh/ft[1581]	ES ΔkWh/ft reduction (= 9% reduction of electricity use[1582,1583,1584,1585])
Vertical Open, Remote Condensing, Medium Temperature	35°F to 55°F	1453	131
Vertical Open, Remote Condensing, Low Temperature	0°F to 30°F	3292	296
Vertical Open, Self-Contained Medium Temperature	35°F to 55°F	2800	252
Horizontal Open, Remote Condensing, Medium Temperature	35°F to 55°F	439	40
Horizontal Open, Remote Condensing, Low Temperature	0°F to 30°F	1007	91
Horizontal Open, Self-Contained, Medium Temperature	35°F to 55°F	1350	121
Horizontal Open, Self-Contained, Low Temperature	0°F to 30°F	2749	247

L = the length of the refrigerated case in linear feet

= Actual

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Peak savings are null because savings occur at night only.

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[1581] Energy Conservation Standards for Commercial Refrigeration Equipment: Technical Support Document, U.S. Department of Energy, September 2013. The information required to estimate annual energy savings for refrigerated display cases is taken from the 2013-2014 U.S. Department of Energy (DOE) energy conservation standard rulemaking for Commercial Refrigerated Equipment. During the rulemaking process, DOE estimates the energy savings specific to night covers through extensive simulation and energy models that are validated by both manufacturers of night covers and refrigerated cases. The information is also referenced from a study done by Southern California Edison and testing by Technischer Uberwachungs-Verein Rheinland, which are used by DOE for the rulemaking process.

[1582] Southern California Edison Refrigeration Technology and Test Center. Effects of the Low Emissivity Shields on Performance and Power Use of a Refrigerated Display Case. 1997. Southern California Edison, Rancho Cucamonga, CA.

[1583] ASHRAE, Effects of Low-E Shields on the Performance and Power Use of a Refrigerated Display Case. 1999

[1584] Connecticut Power & Light, Thermal Night Covers for Refrigerated Supermarket Display Cases. 2014

[1585] Technischer Uberwachungs-Verein Rheinland E.V. Laboratory test results for energy savings on refrigerated dairy case, conducted for Econofrost.

MEASURE CODE: CI-RFG-NCOV-V02-240101

REVIEW DEADLINE: 1/1/2029

4.6.10 High Speed Rollup Doors

DESCRIPTION

This measure entails the installation of High Speed Doors in refrigerated warehouses. High speed doors can save energy by lowering infiltration through a reduction in time that cooled spaces are exposed to ambient outdoor conditions. This in turn can lower the demand on refrigeration systems.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a High Speed Door installed on the loading dock doorway of a refrigerated space. The high speed door is assumed to act as a primary door. It should be noted that for high-traffic applications (about 45 door passages per hour, using the defaults for this measure) a custom analysis is necessary to ensure that high-speed rollup doors will provide savings, because strip curtains may outperform the high speed door, if no other open-door protection device is installed.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is existing strip curtains on doorways to a loading dock. During times of traffic, primary doors are left open, leaving just the strip curtains as open-doorway protection.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years.[1586]

DEEMED MEASURE COST

The incremental measure cost is $150/sqft.[1587]

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The coincidence factor is assumed to be 1.00.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Electric savings consider the change in loading on the refrigeration system as well as the consumption of the drive on the high speed door. The following algorithms are based heavily on those derived and described in chapter 24 Refrigerated-Facility Loads of the ASHRAE Refrigeration Handbook.

$$\Delta kWh = \left(0.00008333 * q * D_f * \eta * [D_{tB}(1 - E_B) - {}_{tE}(1 - E_E)] - D_{tM}\mathrm{M}\right) * t$$

Where:

0.00008333 = conversion from Btu/h to tons

q = sensible and latent refrigeration load for fully established flow, Btu/h

$$= 3790 * W * H^{1.5} * \left(\frac{Q_s}{A}\right) * \left(\frac{1}{R_s}\right)$$

[1586] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[1587] Rite Hite – Industrial High Speed Doors

W = width of doorway, in feet. Custom input.

H = height of doorway, in feet. Custom input.

$\frac{Q_S}{A}$ = Sensible heat load of infiltration air per square foot of door way opening, as read from the following figure and dependent on infiltration air temperature and cooled space temperature. If unknown, infiltration temperature can be assumed to be 50° F,[1588] cooler temperature 35°F, and freezer temperature -10°F,[1589] resulting in values of 0.06 for a cooler and 0.5 for a freezer.

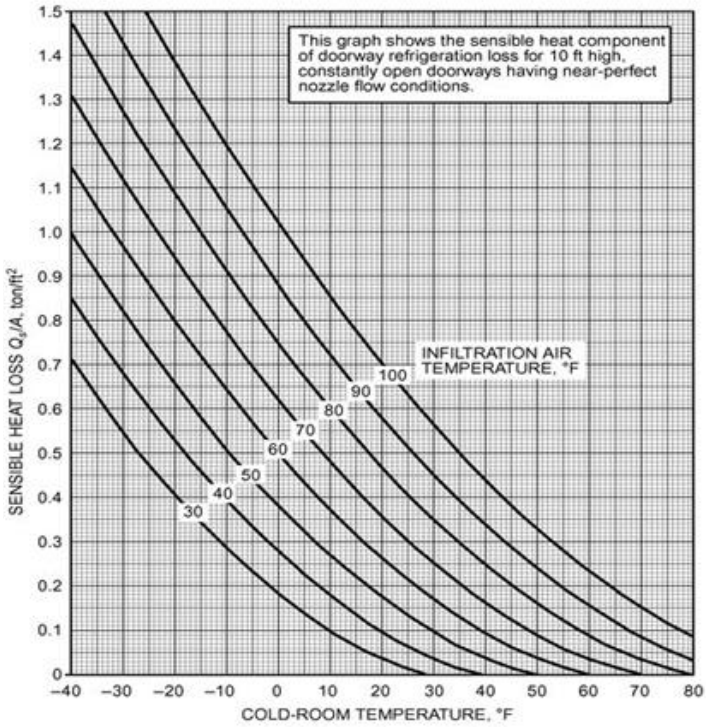

R_s = Sensible heat ratio of the infiltration air heat gain, as read or interpolated from the chart below or from a psychometric chart, dependent on temperature and relative humidity of infiltration air and cooled space temperature. If unknown, use the same assumptions as previously, with a warm space relative humidity value of 70%,[1590] resulting in values of 0.685 (interpolated) for coolers and 0.73 (interpolated) for freezers.

[1588] Taken to represent the overall annual average temperature in Illinois. TMY3 data for the five weather regions defined by the TRM indicate averages that fall within the range of 47.6 (Rockford) to 55.9 (Marion).
[1589] Refrigerated Warehouse, 2013 California Building Energy Standards, CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE), March 2011,
[1590] Taken to represent the overall annual average in Illinois. TMY3 data for the five weather regions defined by the TRM indicate averages that fall within the range of 69.1 (Springfield) to 72.1 (Rockford).

Warm Space Temp. °F	rh, %	Cold Space at 90% rh Dry-Bulb Temperature, °F –40	–30	–20	–10	0	10	20	30	40	50
70	100	0.60	0.58	0.56	0.53	0.50	0.47	0.44	0.41	0.37	0.34
	80	0.66	0.64	0.61	0.59	0.56	0.53	0.50	0.48	0.46	0.44
	60	0.72	0.70	0.68	0.66	0.63	0.61	0.59	0.58	0.59	0.64
	40	0.79	0.78	0.76	0.75	0.73	0.72	0.71	0.73	0.80	—
60	100	0.66	0.64	0.62	0.59	0.56	0.52	0.49	0.45	0.41	0.35
	80	0.71	0.69	0.67	0.64	0.62	0.59	0.56	0.53	0.52	0.53
	60	0.77	0.75	0.73	0.71	0.69	0.67	0.65	0.65	0.70	—
	40	0.83	0.82	0.81	0.79	0.78	0.77	0.78	0.83	—	—
50	100	0.72	0.70	0.67	0.64	0.61	0.57	0.53	0.49	0.43	—
	80	0.76	0.74	0.72	0.70	0.67	0.64	0.61	0.59	0.62	—
	60	0.81	0.80	0.78	0.76	0.74	0.72	0.71	0.75	—	—
	40	0.87	0.86	0.84	0.83	0.82	0.82	0.85	—	—	—
40	100	0.77	0.75	0.72	0.69	0.66	0.62	0.57	0.51	—	—
	80	0.81	0.79	0.77	0.74	0.72	0.69	0.66	0.67	—	—
	60	0.85	0.84	0.82	0.80	0.78	0.77	0.79	0.99	—	—
	40	0.90	0.89	0.88	0.87	0.86	0.88	0.97	—	—	—
30	100	0.82	0.80	0.77	0.74	0.70	0.66	0.59	—	—	—
	80	0.85	0.83	0.81	0.79	0.76	0.73	0.73	—	—	—
	60	0.88	0.87	0.86	0.84	0.83	0.83	0.94	—	—	—
	40	0.92	0.91	0.90	0.90	0.91	0.96	—	—	—	—
20	100	0.86	0.84	0.82	0.79	0.75	0.69	—	—	—	—
	80	0.89	0.87	0.85	0.83	0.81	0.80	—	—	—	—
	60	0.91	0.90	0.89	0.88	0.88	0.95	—	—	—	—
	40	0.94	0.94	0.93	0.94	0.97	—	—	—	—	—
10	100	0.90	0.88	0.86	0.83	0.78	—	—	—	—	—
	80	0.92	0.90	0.89	0.87	0.86	—	—	—	—	—
	60	0.94	0.93	0.92	0.92	0.96	—	—	—	—	—
	40	0.96	0.96	0.96	0.98	—	—	—	—	—	—
0	100	0.92	0.91	0.89	0.85	—	—	—	—	—	—
	80	0.94	0.93	0.92	0.91	—	—	—	—	—	—
	60	0.96	0.95	0.95	0.97	—	—	—	—	—	—
	40	0.97	0.97	0.98	—	—	—	—	—	—	—

D_f = doorway flow factor. Equal to 0.8 for a doorway between a freezer and a dock and 1.1 for a doorway between a cooler and a dock.[1591]

η = Efficiency of refrigeration system (kW/ton). Custom input, if unknown assume 1.6 kW/ton for coolers and 2.4 kW/ton for freezers.[1592]

D_{tB} = decimal portion of time doorway is open in the baseline condition. If during facility operating hours, the primary doors are left open, leaving only open-doorway protective devices (e.g., strip curtains) as a barrier, this is considered 1.0. If primary doors are actively operated and do not remain open for the entire time the facility is in operation, refer to the following calculation.

$$D_{tB} = \frac{(P\ \theta_{pB}\ +\ 60\ \theta_{oB})}{3600\ \theta_d}$$

P = Number of passages through doorway per hour.

Θ_{pB} = Door open to close time in seconds.

Θ_{oB} = Time door remains open in minutes.

Θ_d = Period of time considered in hours, 1 hr.

D_{tE} = decimal portion of time doorway is open in the efficient condition.

$$D_{tE} = \frac{(P\ \theta_{pE}\ +\ 60\ \theta_{oE})}{3600\ \theta_d}$$

[1591] ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.7.

[1592] Professional judgement, in alignment with typical freezer and cooler performance found in the Michigan Energy Measures Database (MEMD).

P = Number of passages through doorway per hour. Custom input; assume 5.9 if unknown.[1593]

Θ_{pE} = Door open to close time in seconds. Custom input; assume 7.5 seconds if unknown.[1594]

Θ_{oE} = Time door remains open in minutes. Custom input; assume 3 minutes if unknown.[1595]

Θ_d = Period of time considered in hours, 1 hr.

D_{tM} = decimal portion of time high speed door motor is operational.

$$D_{tM} = \frac{P\ \theta_{pE}}{3600\ \theta_d}$$

Variables defined above.

E_B = effectiveness of baseline open-doorway protective device (strip curtains). Equal to 0.85.[1596]

E_E = effectiveness of efficient open-doorway protective device. Equal to 0, unless an additional protective device exists to limit infiltration during times when the high-speed door is open.

M = operating input power of the high speed door motor, in kW.

= Custom input; assume 1.49kW if unknown.[1597]

t = hours per year when primary doors to the cooled space are open.

= Custom input; assume 2,959 hrs/yr if unknown.[1598]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = (ΔkWh / t) * CF

Where

CF = Summer peak coincidence factor for this measure

= 1.0

All other variables as defined above.

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Manufacturers suggest annual inspection and maintenance (such as patching tears) of high speed doors. At a minimum, greasing of fittings and oil top-off should be carried out annually. This is estimated at a cost of $150 per year.[1599]

[1593] ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.11
[1594] ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.6
[1595] Professional judgement.
[1596] ASHRAE, "Refrigerated –Facility Loads", in Refrigeration Handbook 2014: ASHRAE, 2014, 24.7
[1597] Rite Hite – Industrial High Speed Doors, product line commonly uses 2HP drives.
[1598] Based on a ComEd survey that obtained the number of hours per week certain building types operate. Warehouses had an average response of 55.6 and industrials had 58.2. Calculated by taking the simple average of the two and multiplying by 52 weeks/yr.
[1599] Assumes approximately 1 hour of maintenance, based on manufacturer product spec sheets.

MEASURE CODE: CI-RFG-HSRD-V03-220101

REVIEW DEADLINE: 1/1/2028

4.6.11 Q-Sync Motors for Walk-in and Reach-in Coolers/Freezers

DESCRIPTION

This measure is applicable to the replacement of an existing, uncontrolled, and continuously operating standard-efficiency shaded-pole, permanent split capacitor (PSC), and electronically commutated (EC) evaporator fan motors in reach-in refrigerated display cases as well as walk-in coolers and freezers.

This measure achieves energy savings by installing a more efficient Q-Sync motor in these scenarios (accompanied with replacement fan assembly as necessary). In addition to motor energy savings, the measure also results in less waste heat for the refrigeration equipment to reject and improves the power factor of the equipment.

This measure is limited to a typical reach-in refrigerated display case with the evaporator fan power of 9-12 Watts and walk-in coolers and freezers with the evaporator fan power of 38-50 Watts. In addition to the motor, replacement of the evaporator fan is necessary to ensure matching airflow is provided (because the fan's speed has been modified). Care must be taken by the installer to ensure airflows remain within the specified range, otherwise fan performance could suffer, causing reliability issues. Q-Sync motors are commonly purchased as a kit, which includes replacement fan blades and shrouds when replacement is necessary.

This measure was developed to be applicable to the following program types: RF, NC.[1600]

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The replacement unit must be a 9-12 Watt Q-Sync motor with a minimum of 73% motor efficiency or a 38-50 Watt Q-Sync motor with a minimum of 81% motor efficiency (as listed by manufacturer).

DEFINITION OF BASELINE EQUIPMENT

Depending on existing conditions, one of three baselines is chosen:

Baseline 1: existing shaded-pole motor(s) with no fan control operating 8760 hours continuously in a refrigerated reach-in display case, walk-in cooler, or walk-in freezer.

Baseline 2: EC motor with no fan control operating 8760 hours continuously in a refrigerated reach-in display case.

Baseline 3: existing PSC motor(s) with no fan control operating 8760 hours continuously in a walk-in cooler or freezer.

Baseline 4: blended baseline, consisting of a mix of shaded-pole motors and EC motors that are assumed to be present in retrofit project where accurate counts are unknown or difficult to determine. It is assumed that existing motors have no fan control and operate 8760 hours continuously in refrigerated reach-in display cases.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life is ten years.[1601]

DEEMED MEASURE COST

Actual measure costs should be used if available. If costs are not available, the following deemed measure cost can be used.[1602]

Measure	Material Unit (Each)	Material Cost / Unit	Labor Unit (Hours)	Labor Rate / Unit	Total Cost / Unit
9-12-watt Q-Sync motor (including replacement fan kit)	1	$52	0.25	$120	$82
38-50-watt Q-Sync motor (including replacement fan kit)	1	$50	0.50	$120	$110

[1600] Customers should be encouraged to check with the manufacturer to determine any impact on warranty of new equipment due to installing Q-sync fan/motor assemblies.
[1601] Based on communication with QM Power representative, April 16, 2018. See reference document "4.16.2018 Email.msg".
[1602] Based on communication with QM Power representative, April 24, 2018. See reference document "4.24.2018 Email.msg".

Note: the material unit cost is based on a large-scale retrofit project.

LOADSHAPE

Loadshape C53 - Flat

COINCIDENCE FACTOR

The peak kW coincidence factor is 100%

Algorithm

CALCULATION OF ENERGY SAVINGS

To determine the savings associated with the Q-Sync motor measure we utilized the field study results provided by Oak Ridge National Laboratory (ORNL)[1603] and Alternative Energy Systems Consulting (AESC)[1604] for refrigerated display cases, and the field study results provided by Slipstream[1605] and ORNL[1606] for walk-in coolers and freezers.

For refrigerated display cases, in 2015, ORNL conducted a side-by-side comparison of Q-Sync motors with EC motors in a 16 ft medium-temperature vertical multi-deck refrigerated display case at an Hy-Vee Supermarket in the Kansas City metropolitan area. A retrofit was done on the display case that contained four 12 W EC evaporator fan motors, two in each 8 ft section. Two existing EC motors in one of the 8 ft sections were replaced with two 12 W Q-Sync motors. The initial results show that Q-Sync motors consumed approximately 16.4 watts per motor, and EC motors consumed approximately 22.6 watts per motor.[1607]

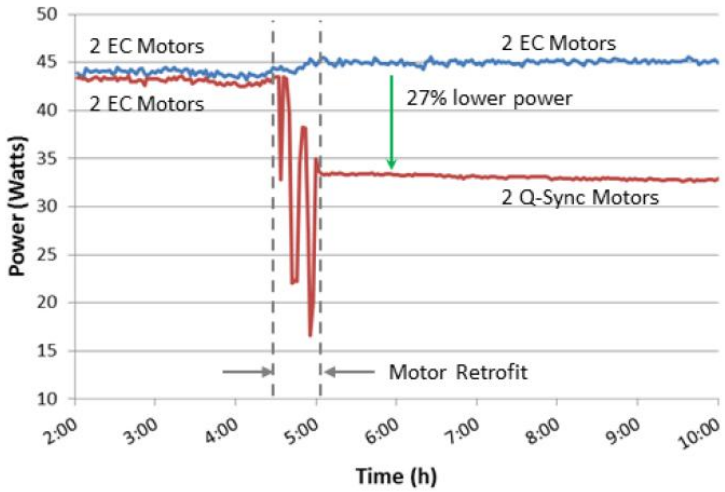

In comparison, the 2011 study by Navigant and PNNL determined that a 12 w shade-pole motor ‘s actual power is 60.0 watts for use in commercial refrigration equipment at design condition,[1608] even though some manufacturers

[1603] Brian A. Fricke and Bryan R. Becker, “Q-Sync Motors in Commercial Refrigeration: Preliminary Test Results and Projected Benefits,” Oak Ridge National Laboratory, September 2015.
[1604] M. Valmiki and Antonio Corradini, “Energy Savings of Permanent Magnet Synchronous Fan Motor Assembly Refrigerated Case Evaporators,” Alternative Energy Systems Consulting, August 2016.
[1605] Xiaohui Zhou, et al, “Q-Sync Motor Performance in Walk-in Coolers and Freezers: Field Test for ComEd Emerging Technologies,” Slipstream, March 2019.
[1606] Brian A. Fricke and Bryan R. Becker, “Permanent Magnet Synchronous Motors for Commercial Refrigeration: Final Report,” Oak Ridge National Laboratory, July 2018.
[1607] Brian A. Fricke and Bryan R. Becker, “Q-Sync Motors in Commercial Refrigeration: Preliminary Test Results and Projected Benefits,” Oak Ridge National Laboratory, September 2015.
[1608] NCI (Navigant Consulting Inc.) and PNNL (Pacific Northwest National Laboratory), “Preliminary Technical Support Document (TSD): Energy Conservation Program for Certain Commercial and Industrial Equipment: Commercial Refrigeration Equipment,” Appliances and Commercial Equipment Standards, Building Technologies Program, Office of Energy Efficiency and Renewable Energy, US Department of Energy, Washington, D.C., 2011.

also pointed out that "there could be significant variations in efficiency between motors of the same type but different models." In the AESC study, the field test showed that the average input power for each of the 13 shaded pole motors retrofitted is 41.6 watts. As a compromise between the two studies, we use 50.0 watts as a representative number for shaded pole motors in our calculation. The average evaporator fan motor powers in refrigerated cases are summarized in the following table.

	Shaded-pole motor	PSC motor	Q-Sync motor
Average evaporator fan motor power in refrigerated display cases (watt)	50.0	22.6	16.4

For walk-in coolers and freezers, in 2019, Slipstream conducted a field study in three small businesses in Illinois retrofitting a total of 18 evaporator fan motors in 7 walk-in coolers or freezers. The average input power for each of the existing 16 shaded-pole motors was 131.6 watts, and 58.4 watts for each of the existing two PSC motors. The average input power for each of the 18 Q-Sync motors post-retrofit was 40.1 watts. In the ORNL 2018 field study on walk-in cooler/freezers in two supermarkets, the average input power for each of the existing 20 shaded-pole fan motors was 111.5 watts, and 61.4 watts for each of the existing 73 PSC motors. The average input power for each of the 93 Q-Sync motors post-retrofit was 36.6 watts. Combining both studies' results, the average powers for evaporator fan motors pre- and post-retrofit are listed in the following table:

	Shaded-pole motor	PSC motor	Q-Sync motor
Average evaporator fan motor power in walk-in coolers/freezers (watt)	120.4	61.3	37.2

For refrigerated display cases:

The electrical energy savings for replacing a shaded-pole motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours. For med-temperature cases, T is 8,760 hours. For low-temp freezer cases, T is 8,578 hours considering daily 30-minute defrost cycles during which fans are not powered.[1609]

Motor energy savings (Baseline 1, med-temp, per motor)

= (50 W – 16.4 W) x 8760 hours / 1000 = 294.336 kWh

Motor energy savings (Baseline 1, low-temp, per motor)

= (50 W – 16.4 W) x 8578 hours /1000 = 288.221 kWh

The electrical energy savings for replacing an EC motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours (8760 hours):

Motor energy savings (Baseline 2, med-temp, per motor)

= (22.6 W – 16.4 W) x 8760 hours / 1000 = 54.312 kWh

Motor energy savings (Baseline 2, low-temp, per motor)

= (22.6 W – 16.4 W) x 8578 hours / 1000 = 53.184 kWh

The reduced motor power will also reduce refrigeration load. Assuming the power to drive the evaporator fan is converted to heat inside the display cases at 100% rate, the reduction in refrigeration system compressor power can be calculated using the following equation:

[1609] M M. Valmiki and Antonio Corradini, "Energy Savings of Permanent Magnet Synchronous Fan Motor Assembly Refrigerated Case Evaporators," Alternative Energy Systems Consulting, August 2016.

$$\Delta kWh_{refrigeration} = \frac{\Delta kWh_{motor}}{COP},$$

where COP is the Coefficient of Performance of refrigeration systems in the supermarket display cases. For med-temperature cases, the average COP is 2.5[1610]. For low-temp freezer cases, the average COP is 1.3.[1611]

The refrigeration energy savings can be calculated based on the above numbers:

Refrigeration energy savings (Baseline 1, med-temp, per motor) = 117.734 kWh

Refrigeration energy savings (Baseline 1, low-temp, per motor) = 221.708 kWh

Refrigeration energy savings (Baseline 2, med-temp, per motor) = 21.724 kWh

Refrigeration energy savings (Baseline 2, low-temp, per motor) = 40.910 kWh

The overall energy savings are the sums of the motor energy savings and the refrigeration energy savings:

Overall energy savings (Baseline 1, med-temp, per motor) = 412.070 kWh

Overall energy savings (Baseline 1, low-temp, per motor) = 509.929 kWh

Overall energy savings (Baseline 2, med-temp, per motor) = 76.036 kWh

Overall energy savings (Baseline 2, low-temp, per motor) = 94.094 kWh

For walk-in coolers and freezers:

The electrical energy savings for replacing a shaded-pole motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours. For coolers, T is 8,760 hours. For freezers, T is 8,578 hours considering daily 30-minute defrost cycles during which fans are not powered.

Motor energy savings (Baseline 1, med-temp, per motor)

= (120.4 W – 37.2 W) x 8760 hours / 1000 = 728.832 kWh

Motor energy savings (Baseline 1, low-temp, per motor)

= (120.4 W – 37.2 W) x 8578 hours /1000 = 713.690 kWh

The electrical energy savings for replacing a PSC motor with a Q-Sync motor in a retrofit project is calculated by the difference of the two motors demonstrated power draw multiplied by the annual operating hours (8760 hours):

Motor energy savings (Baseline 3, med-temp, per motor)

= (61.3 W – 37.2 W) x 8760 hours / 1000 = 211.116 kWh

Motor energy savings (Baseline 3, low-temp, per motor)

= (61.3 W – 37.2 W) x 8578 hours / 1000 = 206.730 kWh

The reduced motor power will also reduce refrigeration load. Assuming the power to drive the evaporator fan is converted to heat inside the display cases at 100% rate, the reduction in refrigeration system compressor power can be calculated using the following equation:

$$\Delta kWh_{refrigeration} = \frac{\Delta kWh_{motor}}{COP},$$

where COP is the Coefficient of Performance of refrigeration systems in the supermarket display cases. For med-temperature cases, the average COP is 2.5. For low-temp freezer cases, the average COP is 1.3.

[1610] Michael Deru, et al, "U.S. Department of Energy Commercial Reference Building Models of National Building Stock," NREL Report TP-5500-46861, February 2011.

[1611] Michael Deru, et al, "U.S. Department of Energy Commercial Reference Building Models of National Building Stock," NREL Report TP-5500-46861, February 2011.

The refrigeration energy savings can be calculated based on above numbers:

Refrigeration energy savings (Baseline 1, med-temp, per motor) = 291.532 kWh

Refrigeration energy savings (Baseline 1, low-temp, per motor) = 548.992 kWh

Refrigeration energy savings (Baseline 3, med-temp, per motor) = 84.446 kWh

Refrigeration energy savings (Baseline 3, low-temp, per motor) = 159.023 kWh

The overall energy savings are the sums of the motor energy savings and the refrigeration energy savings:

Overall energy savings (Baseline 1, med-temp, per motor) = 1020.364 kWh

Overall energy savings (Baseline 1, low-temp, per motor) = 1262.682 kWh

Overall energy savings (Baseline 3, med-temp, per motor) = 295.562 kWh

Overall energy savings (Baseline 3, low-temp, per motor) = 365.753 kWh

ELECTRIC ENERGY SAVINGS

If the numbers of existing shaded-pole motors, EC motors to be retrofitted are known (Baseline 1,2, & 3):

ΔkWh = Overall annual savings per motor * Motors

Where overall energy savings per motor can is as speficied in the following table:

Evaporator Fan Motor Rating (of Q-Sync motor)	Baseline	Annual kWh Savings/motor
9-12W	shaded-pole motor, med-temp	412.070
9-12W	shaded-pole motor, low-temp	509.929
9-12W	EC motor, med-temp	76.036
9-12W	EC motor, low-temp	94.094
38-50W	shaded-pole motor, med-temp	1,020.364
38-50W	shaded-pole motor, low-temp	1,262.682
38-50W	PSC motor, med-temp	295.562
38-50W	PSC motor, low-temp	365.753

Motors = number of fan motors replaced

For refrigerated display cases, if the numbers of existing shaded-pole motors and EC motors are unknown in a retrofit project (Baseline 3):

$$\Delta kWh = [W_{med} - temp\ (W_{SPM}\ x\ S_{SPM} - med\ +\ W_{ECM}\ x\ S_{ECM} - med)\ +\ W_{low} - temp\ (W_{\ SPM} x\ S_{SPM} - low\ +\ W_{ECM}\ x\ S_{ECM} - low)]\ *\ Motors$$

Motors = number of fan motors replaced

S = annual energy savings per motor, by type. Savings for each different type ($S_{SPM\text{-}med}$, $S_{SPM\text{-}low}$, $S_{ECM\text{-}med}$, $S_{ECM\text{-}low}$) can be looked up from the table above.

W = weighting factors. The weights for the medium-temperature and low-temperature applications ($W_{med\text{-}temp}$ and $W_{low\text{-}temp}$) should be calculated based on the actural numbers of motors in a retrofit project, and the sum of the two weights should equal to 1. If these weights cannot be accurately obtained, the estimated weights ($W_{med\text{-}temp}$* and $W_{low\text{-}temp}$*)[1612] from the table below can be used (the W_{SPM} and W_{ECM} numbers are slightly adjusted by +/-5% based on national averages in the 2015 ORNL study, reflecting some

[1612] ASHRAE, "ASHRAE Handbook – Refrigeration," ASHRAE, 2018.

shaded pole motors may have been replaced with EC motors in the past few years).[1613]

Application	WSPM	WECM	Wmed-temp*	Wlow-temp*
Supermarkets	0.6	0.4	0.68	0.32
Other Food Retail Formats	0.8	0.2	0.68	0.32
Other Retail Categories	0.7	0.3	0.68	0.32
Restaurants and Bars	0.85	0.15	0.68	0.32
Beverage Vending Machines	0.85	0.15	0.68	0.32

For walk-in coolers and freezers, if the existing motor types are unknown in a retrofit project, it can be assumed they are PSC motors, as from industry survey in the 2018 ORNL study,[1614] 95% of the 38-50 watt evaporator fan motors are PSC motors.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh \ / \ Hours \ * \ CF$

Where:

ΔkWh = Gross customer annual kWh savings for the measure, as listed above

Hours = Full Load hours per year

= 8,766 (med-temp); 8,578 (low-temp)

CF = Summer Peak Coincident Factor

= 1.0

Other variables as defined above.

The following table provides the resulting kW savings (per motor):

Evaporator Fan Motor Rating (of Q-Sync motor)	Baseline	kW Savings/motor
9-12W	shaded-pole motor, med-temp	0.047
9-12W	shaded-pole motor, low-temp	0.059
9-12W	EC motor, med-temp	0.009
9-12W	EC motor, low-temp	0.011
38-50W	shaded-pole motor, med-temp	0.116
38-50W	shaded-pole motor, low-temp	0.147
38-50W	PSC motor, med-temp	0.034
38-50W	PSC motor, low-temp	0.043

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

[1613] NCI (Navigant Consulting Inc.) and PNNL (Pacific Northwest National Laboratory), "Preliminary Technical Support Document (TSD): Energy Conservation Program for Certain Commercial and Industrial Equipment: Commercial Refrigeration Equipment," Appliances and Commercial Equipment Standards, Building Technologies Program, Office of Energy Efficiency and Renewable Energy, US Department of Energy, Washington, D.C., 2011.

[1614] Brian A. Fricke and Bryan R. Becker, "Permanent Magnet Synchronous Motors for Commercial Refrigeration: Final Report," Oak Ridge National Laboratory, July 2018.

DEEMED O&M COST ADJUSTMENT CALCULATION

There is no O&M cost adjustment for replacing shaded pole or EC motors with Q-Sync motors in reach-in refrigerated display case applications. From the 2015 ORNL study,[1615] the 2016 AESC study,[1616] and the manufacturer,[1617] there is no expected degradation in equipment performance after the retrofits, and therefore no O&M cost differences are expected between baseline and efficient measures.

MEASURE CODE: CI-RFG-QMF-V03-220101

REVIEW DEADLINE: 1/1/2028

[1615] Brian A. Fricke and Bryan R. Becker, "Q-Sync Motors in Commercial Refrigeration: Preliminary Test Results and Projected Benefits," Oak Ridge National Laboratory, September 2015.
[1616] M M. Valmiki and Antonio Corradini, "Energy Savings of Permanent Magnet Synchronous Fan Motor Assembly Refrigerated Case Evaporators," Alternative Energy Systems Consulting, August 2016.
[1617] Based on communication with QM Power representative, August 22, 2018. See reference document "8.22.2018 Email.msg".

4.6.12 Variable Speed Drive for Condenser Fans

DESCRIPTION

This measure is applicable to VFDs installed on condenser fan motors operating in supermarket refrigeration systems.

Where a baseline condenser motor load operates at a fixed-speed, VFDs generate energy and cost savings by modulating frequency and voltage to match the load on the condensers.[1618] Savings result from the resulting fan speed variation.

This measure is applicable to motors between 0.5 horsepower and 1.5 horsepower.

This measure was developed to be applicable to the following program types: RF, TOS.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

This measure applies to retrofitted installation of condenser fan motors in supermarkets where no ability to modulate frequency and voltage for fan-speed variation exits. Savings are based on the application of VFDs to baseline load conditions defined as pre-installation load compared to post-installation load.

DEFINITION OF BASELINE EQUIPMENT

The time-of-sale baseline is a new motor installed without a VFD or other methods of control. Retrofit baseline is an existing motor operating as is.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life for VFD condenser fan applications is 15 years.[1619]

DEEMED MEASURE COST

Customer costs will be used when available. For motor sizes 0.5 to 1.5 HP the default measure cost is $1,170/HP. Custom costs must be gathered for other motor sizes.

LOADSHAPE

C22-commercial refrigeration.

COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings is based on a pre- and post-treatment test. The pre-treatment period being nearly three months in duration with post-treatment of a similar period. Both periods include significant average outdoor temperature (OAT) changes. Measurement of energy savings relies on regression of condenser fan energy use against ambient temperature. These estimates were made on each condenser using both pre- and post-VFD installation; comparison of the two yields savings.[1620]

[1618] Romberger, Jeff. Wed. “Chapter 18: Variable Frequency Drive Evaluation Protocol. The Uniform Methods Project: Methods for Determining Energy Efficiency Savings for Specific Measures”. United States. doi:10.2172/1365710.

[1619] Efficiency Vermont TRM 3/16/2015 pp 19 for motor end use-variable frequency drives.

[1620] Pre- and post-VFD retrofit kWh consumption were derived from measurement of 14 condensers at 4 supermarkets in Rockford, Il. Annual savings in each Zone is the product of the number of hours in each 5-degree F Typical Meteorological Year temperature bin multiplied by the mean savings across the 14 condensers measured in the study. These estimates represent

ELECTRIC ENERGY SAVINGS

Annual $\Delta kWh_{condenser} = No.fans * HP/fan * kWh\ savings/HP/Zone$

Zone	kWh savings/HP
1 (Rockford)	1,480
2 (Chicago)	1,500
3 (Springfield)	1,430
4 (Belleville)	1,430
5 (Marion)	1,480

For example, for a condenser with 5 fans, each rated at 1.5 HP in Chicago (Zone 2):

Annual $\Delta kWh_{condenser}$ = 5 * 1.5 * 1,500

= 11,250 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Variable frequency drives, anecdotally, increase motor life because they allow for soft-start and soft shutdown. This would lead to O&M savings from replacing motors. Unfortunately, there is currently insufficient evidence to quantify this savings, so no deemed O&M savings can be claimed at this time.

MEASURE CODE: CI-RFG-VSC-V03-250101

REVIEW DEADLINE: 1/1/2029

means from 10,000 simulations that include confidence intervals at the 90 percent level of +/-330, +/-330, +/-300, +/-320, and +/-310 for zones 1, 2, 3, 4, and 5, respectively. Detailed methods, assumptions, and calculations are found in "Variable Frequency Drive Energy Savings in Refrigeration Condensers Report. Slipstream, October, 9 2019"

4.6.13 Add Doors to Open Refrigerated Display Cases

DESCRIPTION

Open display cases are typically found in grocery and convenience stores and have been a preference of store owners because they allow customers a clear view and easy access to refrigerated products. This measure is retrofitting existing, open, refrigerated display cases by adding and installing doors. The baseline equipment is an open vertical or horizontal display case with no doors or covering. The efficient equipment is the installation of solid doors on the existing display case. Replacement of open display cases with new display cases with doors is not covered under this measure characterization.

Energy savings are based on air infiltration reduction from the addition of doors to the open display cases. The air infiltration reductions assume a reduced heat gain and subsequent reduced load on the refrigeration compressors. Both radiant and conduction heat losses were factored into the analysis as well. Energy savings are based on a per linear foot of display case.

Interactive HVAC energy savings were also included in the measure savings analysis. The HVAC interactive effects calculation assesses the measure's impact on the heating and cooling equipment. With adding a door to an open refrigerated display case, excess cold air leaking into the conditioned space no longer must be treated by the heating system, resulting in additive savings. Similarly, the reduction in cold air from the open refrigerated display case no longer supplements the efforts of the space cooling equipment, which results in an overall increase in its consumption.

High, medium, and low temperature cases are eligible for this measure; however, the measure assumptions detailed in this characterization are based on medium temperature display cases, with the installation of zero energy doors, as it was deemed the most likely candidate for participation in this measure. Open low temperature or freezer display cases are not common. If the retrofitted door has LED fixtures, it is recommended to leverage ‘4.5.4 LED Bulbs and Fixtures for quantifying savings and measure benefits.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is retrofitting an existing open, refrigerated, display case by adding doors.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an open, refrigerated, display case without any covering.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 15 years.[1621]

DEEMED MEASURE COST

The incremental cost, which includes both material and labor, differs depending on whether or not the installed door is equipped with LED lighting. The estimated incremental cost for doors without LED lighting is $390 per linear foot. The incremental cost for doors with LED lighting is $419 per linear foot.[1622]

[1621] The measure life is sourced from the PG&E Workpaper, “Add Doors to Open Medium Temperature Cases – PGE3PREF116 R3”, June 2019.

[1622] The incremental cost is sourced from the PG&E Workpaper, “Add Doors to Open Medium Temperature Cases – PGE3PREF116 R3”, June 2019. The incremental cost for retrofitting new doors on existing refrigerated display cases is the material cost of the door and the labor cost required for installation. The material cost of the doors is $331 per linear foot with LED lighting and $301 per linear foot without LED lighting. And the installation cost is $88 per linear foot.

LOADSHAPE

Loadshape C03 - Commercial Cooling

Loadshape 22: Commercial Refrigeration

COINCIDENCE FACTOR

There are two components to the demand savings of this measure, one that impacts the refrigeration equipment itself, and another that has an interactive impact on the space cooling equipment. As a result, the measure details two summer coincidence peak demand factors.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = ((\Delta\text{HG} * \text{CL})/\ (\text{EER} * \text{W/kW})\ * 8760) + (\text{MMBtu}_{\text{HVAC Cool}}\ *\ \text{kBtu/MMBtu} * \text{CL} * (1\ /\ \text{SEER2})) -\ ((\text{kWh}_{\text{Night Covers}}\ -\ \text{kWh}_{\text{Added Lights}})\ *\ \text{CL})$$

Where:

ΔkWh	= gross customer annual kWh savings
ΔHG	= Heat Gain, the decreased load or the reduced heat gain on the open refrigerated display case with the installation of a door (Btu/hr-linear foot)
	= 1,172 Btu/h-ft[1623] for vertical cases or 202.3 Btu/h-ft for horizontal cases[1624].
CL	= Case Length, refrigerated case length in feet
	= Actual
EER	= Energy Efficiency Ratio; display case compressor efficiency (Btu/hr-watt)
	= 11.36[1625]
W/kW	= Conversion from watts to kilowatts (W / kW)
	= 1,000
8760	= Annual operating hours of the refrigerated display case[1626]

[1623] The change in heat gain is sourced as the typical value for a medium temperature vertical display case adding doors from the PG&E Workpaper, "Add Doors to Open Medium Temperature Cases - PGE3PREF116 R3", June 2019. The workpaper assumes a net reduction in heat gain with the installation of doors on open refrigerated display cases. The primary benefits account for the decrease in excess heat entering the display case from air infiltration. Radiation and conduction heat gains were also included in the derivation of this value. Additionally, the net heat gain has built in assumptions on how often the refrigerated case doors will be used and the display case accessed by customers and site associates, reducing some of the air infiltration benefits of the new door.

[1624] Average load difference between Hussmann open horizontal cases and lid horizontal cases across various configurations.

[1625] Average EER values were calculated as the average of standard reciprocating and discus compressor efficiencies, using a typical condensing temperature of 90°F and saturated suction temperatures (SST) of 20°F for medium temperature applications. The efficiency analysis and product review are sourced from the Efficiency Vermont TRM, which utilizes data from Emerson Climate Technology software. Medium temperature cases have an EER value of 11.36.

[1626] The measure assumes the baseline equipment is not employing night covers or any other covering but is in fact left open for the duration of its operation.

$MMBtu_{HVAC\ Cool}$ = Total cooling load increase on the HVAC equipment per linear foot of display case. Varies by location:[1627]

Zone	$MMBtu_{HVAC\ Cool\ Vertical}$	$MMBtu_{HVAC\ Cool\ Horizontal}$
1 (Rockford)	-2.632	-0.454
2 (Chicago)	-2.763	-0.477
3 (Springfield)	-3.284	-0.567
4 (Belleville)	-3.254	-0.562
5 (Marion)	-3.335	-0.576

kBtu/MMBtu = Conversion from MMBtu to kBtu (kBtu/MMBtu)

= 1,000

SEER2 = Seasonal Energy Efficiency Ratio; HVAC equipment operating efficiency (kBtu/kWh) * Distribution Efficiency

= Actual, if unknown assume 11.1 SEER2.[1628]

$kWh_{Night\ Covers}$ = Reduction in energy savings if existing display case utilizes night covers (kWh/linear-ft)

= 0 if no night covers are deployed. See table below if display case uses night covers.

Display Case Description	Case Temperature Range (°F)	ΔkWh/ft reduction (= 9% reduction of electricity use[1629,1630])
Vertical Open, Remote Condensing, Medium Temperature	35°F to 55°F	131
Vertical Open, Remote Condensing, Low Temperature	0°F to 30°F	296
Vertical Open, Self-Contained Medium Temperature	35°F to 55°F	252

$kWh_{Added\ Lights}$ = Reduction in energy savings if new lighting is added to the case (kWh/linear-ft)

= 0 if no lighting is added, or if lighting is added but existing lighting is removed. If lighting is retrofit, determine case lighting savings using '4.5.4 LED Bulbs and Fixtures'.

[1627] The MMBtu increase on the HVAC cooling equipment is based on an outdoor air temperature bin analysis, the total hours of operation of the cooling system, and the building's overall loss of additional cooling because of the installation of the doors on the open refrigerated display case. The analysis assumes a certain amount of conditioned air has to be treated to replace the air previously cooled by the display case. Furthermore, the analysis assumes an increased load on the cooling system, at outdoor temperatures above 60°F. A 25% disabling factor was also applied to account for some of the cold air pouring out of the display case and subcooling the site's conditioned space, which will not trigger a thermostatic response from the HVAC equipment. For more information on the analysis used to derive the load increase on the HVAC cooling equipment per linear foot of display case, please see the 'HVAC IE' tab in the "IL TRM_Add Doors_Analysis_Mar 2021.xlsx".

[1628] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER value converted to SEER2 by multiplying by 0.95, and multiplied by 0.95 distribution efficiency.

[1629] Southern California Edison Refrigeration Technology and Test Center. Effects of the Low Emissivity Shields on Performance and Power Use of a Refrigerated Display Case. 1997. Southern California Edison, Rancho Cucamonga, CA. See '4.6.9 Night Covers' for more detail.

[1630] Technischer Uberwachungs-Verein Rheinland E.V. Laboratory test results for energy savings on refrigerated dairy case, conducted for Econofrost. See '4.6.9 Night Covers' for more detail.

= Actual installed equipment specifications or use case lighting values from '4.5.4 LED Bulbs and Fixtures'.

For example, a grocery store in Chicago installed zero energy doors on four open refrigerated cases that do not use night covers, which amounted to 12 linear feet of retrofitted display cases, savings the site:

ΔkWh = ((1172 * 12) / (11.36 * 1000) * 8760) + (-2.763 * 1000 * 12 * (1 / 11.1))

= 7858 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (((\Delta HG * CL) / (EER * W/kW) - (kW_{Added\ Lights} * CL) * CF_{Refrigeration}) + ((MMBtu_{HVAC\ Cool} * kBtu/MMBtu) / Hours_{Cool} * CL * (1 / SEER2) * CF_{Cool})$$

Where:

$Hours_{Cool}$ = Total combined hours the site is providing cooling. Varies by location:[1631]

Zone	Hours $_{Cool}$
1 (Rockford)	2,994
2 (Chicago)	3,143
3 (Springfield)	3,736
4 (Belleville)	3,702
5 (Marion)	3,794

$kW_{Added\ Lights}$ = Reduction in demand savings if new lighting is added to the case (kW/linear-ft)

= 0 if no lighting is added, or if lighting is added but existing lighting is removed. If lighting is retrofit, determine case lighting savings using '4.5.4 LED Bulbs and Fixtures'.

= Actual installed equipment specifications or use case lighting values from '4.5.4 LED Bulbs and Fixtures'.

$CF_{Refrigeration}$ = Summer peak coincidence factor for the refrigerated display case

= 0.964

CF_{Cool} = Summer peak coincidence factor for the HVAC cooling system. This is the summer system peak coincidence factor for commercial dooling (during system peak hours)

= 0.913[1632]

FOSSIL FUEL SAVINGS

$$\Delta Therms = (MMBtu_{HVAC\ Heat} * CL * (1 / AFUE) * 10$$

Where:

[1631] The total combined hours in which the site is providing cooling is based on an outdoor air temperature bin analysis, where the site is conditioning cold air at outdoor temperatures of 60°F and above. Weather data was sourced from TMY3 data for the specific locations. For more information on the derivation of these hours, please see 'HVAC IE' tab in the "IL TRM_Add Doors_Analysis_Mar 2021.xlsx" Night covers are not included in the peak demand savings algorithm because night covers are deployed at night, outside of the peak demand period.

[1632] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

$\Delta Therms$ = gross customer annual therms savings

$MMBtu_{HVAC\ Heat}$ = Total heating load decrease on the HVAC equipment per linear foot of display case. Varies by locations: [1633]

Zone	$MMBtu_{HVAC\ Heat\ Vertical}$	$MMBtu_{HVAC\ Heat\ Horizontal}$
1 (Rockford)	5.068	0.875
2 (Chicago)	4.937	0.852
3 (Springfield)	4.416	0.762
4 (Belleville)	4.446	0.767
5 (Marion)	4.365	0.753

CL = Case Length, refrigerated case length in feet

= Actual

AFUE = Efficiency of heating system, including distribution losses.

Actual, if unknown assume 0.821.[1634]

10 = Conversion from MMBtu to therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-DOOR-V04-260101

REVIEW DEADLINE: 1/1/2028

[1633] The MMBtu decrease on the HVAC heating equipment is based on an outdoor air temperature bin analysis, the total hours of operation in which the site is providing heat, and the building's overall reduced heating load as a result of the installation of the doors on the open refrigerated display case. The analysis assumes a certain reduction of conditioned air that had to be treated to make up for the air previously cooled by the display case. The reduced heat gain on the refrigerated display case equals the reduced heat loss by the site and a heating load that no longer has to be provided by the HVAC system. Furthermore, the analysis assumes a decrease load on the heating system, at outdoor temperatures below 60°F. A 25% disabling factor was also applied to account for some of the cold air pouring out of the display case and subcooling the site's conditioned space, which will not trigger a thermostatic response from the HVAC equipment. For more information on the analysis used to derive the load decrease on the HVAC heating equipment per linear foot of display case, please see the 'HVAC IE' tab in the "IL TRM_Add Doors_Analysis_Mar 2021.xlsx".

[1634] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

4.6.14 Floating Head Pressure Control

DESCRIPTION

Installers conventionally design a refrigeration system to condense at a set pressure-temperature setpoint, typically 90 degrees. By installing a "floating head pressure control" condenser system, the refrigeration system can change condensing temperatures in response to different outdoor temperatures. This means that as the outdoor temperature drops, the compressor will not have to work as hard to reject heat from the cooler or freezer. This measure is for the application of floating head pressure controls for compressors ≤ 10HP and a condensing temperature set to 70ºF. This measure is strictly limited to single compressor systems.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified. IECC code requires economizers in certain instances and therefore projects relying on code baseline definitions must verify eligibility.

DEFINITION OF EFFICIENT EQUIPMENT

High efficiency is a refrigeration system with floating head pressure control.

DEFINITION OF BASELINE EQUIPMENT

The baseline is a refrigeration system without floating head pressure control.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 15 years[1635].

DEEMED MEASURE COST

Floating Head Pressure Control Costs, per Horsepower (condenser rating) are as follows ($/HP)[1636]:

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature[1637]
Self- Contained Unit	$489	$534	$512
Remote Condensing Unit	$489	$534	$512
Unknown[1638]	$489	$534	$512

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 0%, based on the fact that savings for this measure will occur during periods of coldest outdoor temperatures.

[1635] California DEER 2014 Effective Useful Life (EUL) table.

[1636] Costs are based on number of additional valves per condenser motor for different HP ratings and includes installation labor costs. Costs are averaged and shown on a per HP basis. See reference document ComGroceryFHPCSingleCompressor_v2_1.xlsm, worksheet 'CostData&Analysis,' blue highlighted cells. A comparison of prevailing wages in the Pacific Northwest showed high similarity to Illinois and therefore a simple inflation technique (using the US BLS's CPI Inflation Calculator, comparing the purchasing power of $1.00 in January 2012 to May 2021) was used to convert 2012$ to 2021$ (a multiplier of 1.19). Costs were updated for 2025 by comparing the costs from the above table (May 2021) to current inflation rates (March 2025).

[1637] Unknown values based on weighted average; 2010 ASHRAE Refrigeration Handbook, page 15.1 "Medium- and low-temperature display refrigerator line-ups account for roughly 68% and 32%, respectively, of a typical supermarket's total display refrigerators.

[1638] For unit type unknown, it is assumed 50/50 split of self-contained and remote condensing units.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = HP * kWh_{HP}$$

Where:

HP = Horsepower of Compressor

= actual installed

kWh_{HP} = Savings factor, kWh per horsepower of compressor rating. Per the tables below based on weather zone, condensing unit type, and temperature range[1639]:

Note: Self-contained condensing units assume heat is rejected to conditioned or semi-conditioned space. Therefore, outdoor air temperature is not considered a critical system variable resulting in identical savings across weather zones that are much lower compared to those realized by remove condensing units that reject heat to the outdoor environment.

Zone 1 (Rockford)

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature
Self- Contained Unit	252	131	170
Remote Condensing Unit	482	451	461
Unknown	367	291	315

Zone 2 (Chicago)

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature
Self- Contained Unit	252	131	170
Remote Condensing Unit	465	435	445
Unknown	358	283	307

Zone 3 (Springfield)

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature
Self- Contained Unit	252	131	170
Remote Condensing Unit	403	377	385

[1639] Derived from RTF saving estimates for the NW climate zone and extrapolated to Illinois climate zones by using heating degree-days for a 65 degree F setpoint as established in Measure 4.4.37 Unitary HVAC Condensing Furnace measure. See reference file "fhp-savings-extrapolation-xlsx-Adjusted for Illinois.xlsx," 2021.

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature
Unknown	327	254	278

Zone 4 (Belleville)

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature
Self- Contained Unit	252	131	170
Remote Condensing Unit	321	301	307
Unknown	287	216	239

Zone 5 (Marion)

Unit Type	Low Temperature (Freezer)	Medium Temperature (Refrigerator)	Unknown Temperature
Self- Contained Unit	252	131	170
Remote Condensing Unit	328	307	314
Unknown	290	219	242

For example, a low temperature remote condensing unit in Chicago (Zone 2) with a 3-horsepower condenser would annually save:

$$\Delta kWh = 3 * 465$$
$$= 1,395 \text{ kWh}$$

SUMMER COINCIDENT PEAK DEMAND SAVINGS

There are no expected summer coincident peak demand savings for this measure.

FOSSIL FUEL SAVINGS

There are no expected fossil fuel gas savings for this measure.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-FHP-V02-260101

REVIEW DEADLINE: 1/1/2030

4.6.15 Zero Energy Doors for Refrigerated Cases

DESCRIPTION

This measure was developed to reduce the use of electric resistance heaters that prevent the formation of condensation on refrigerated case doors. Standard refrigerated case doors include anti-condensation heaters in the frames, doors, or within the glass to prevent condensation from forming and obstructing view of refrigerated products. High efficiency, zero-energy doors are designed to prevent condensation using multiple layers of glass, low-conductivity filler gas, low-emissivity glass coatings, non-metallic spacers to separate glass panes, and/or non-metallic frames to prevent condensation. Energy savings from zero energy case doors are associated with the elimination of the anti-sweat heaters, as well as the resulting reduction of the load on the refrigeration and building cooling systems. This measure covers the replacement of standard doors with anti-sweat heaters with new zero energy doors on existing refrigerated cases.

This measure is not applicable to retrofitting existing open cases with new doors, a scenario that is covered by the existing measure 4.6.13, Adding Doors to Open Refrigerated Display Cases. It should be noted that the assumptions for measure 4.6.13 are based on installing zero energy doors on existing open medium temperature display cases.

This measure cannot be used in conjunction with measure 4.6.3, Door Heater Controls for Cooler or Freezer.

This measure may be used in conjunction with measure 4.5.4, LED Bulbs and Fixtures, if the installed door has integrated LED lighting, or new LED lighting is installed as part of a door retrofit.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a refrigerated display case door designed to prevent condensation without the use of anti-sweat glass or frame heaters. Qualifying doors will have heat-reflective treated glass and have multiple glass panes with a with a low-conductivity gas fill.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a standard refrigerated display case door that uses anti-sweat glass and/or frame heaters to prevent condensation. Standard doors may have anti-sweat heater controls installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The effective useful life for this measure is 12 years.[1640]

DEEMED MEASURE COST

The measure cost is assumed to be $601.80 (material cost per door) plus $132.78 (labor cost per door) = $734.58 per door.[1641]

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The peak kW coincidence factor is 56%[1642].

[1640] Effective measure life is per Southern California Edison Company, Work Paper SWCR002-02, "Low-Temperature Display Case Doors with no Anti-Sweat Heaters" Revision 2, April 2022

[1641] Measure cost per Southern California Edison Company, Work Paper SWCR002-02, "Low-Temperature Display Case Doors with no Anti-Sweat Heaters" Revision 2, April 2022

[1642] The coincidence factor reflects the elimination of anti-sweat heaters and is derived from the average load reduction from controlled heaters vs. non-controlled heater, see section 4.6.3.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWH = kWbase * NUMdoors * Hours * \%ASH * BF$$

Where

kWbase = connected load kW for standard freezer or cooler display case door with anti-sweat heaters. If actual kWbase is unknown, assume 0.230 kW for freezer and 0.066 kW for cooler cases.[1643]

NUMdoors = number of display case doors replaced or installed on new case

Hours = Hours per year, 8766

%ASH = percentage of annual hours anti-sweat heaters are operating. Assume 90.7% if no anti-sweat heater controls exist and 45.6% if existing case doors have functional anti-sweat heater controls installed.[1644] For installation of doors on new cases, assume that the baseline case uses anti-sweat heater controls[1645].

BF = Bonus Factor; represents the increased savings due to reduction in refrigeration load load and the reduction in building cooling load. Assume 1.5 for freezer cases and 1.3 for cooler cases.[1646]

For example, a bank of 10 reach-in cooler doors without anti-sweat heater controls are replaced with zero energy doors and would annually save:

ΔkWh = 0.066 * 10 * 8766 * 0.907 * 1.3

= 6,822 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWH \,/\, 8766) * CF$$

Where

CF = Summer peak coincident factor for measure, 56%

FOSSIL FUEL SAVINGS

There are no expected fossil fuel gas savings for this measure.

[1643] kWbase/door are per Section 4.6.3 of the Illinois Statewide Technical Reference Manual, Version 14.

[1644] NEEP Refrigeration Loadshape Report. The Cadmus Group, Commercial Refrigeration Loadshape Project Final Report, Northeast Energy Efficiency Partnerships, Refional Evaluation, Measurement, and Verification Forum, Lexington, MA 2015 (p. 7)

[1645] This assumption is based on the efficiency requirements for display doors in the 2021/2024 International Energy Conservation Code (IECC), C403.11.2.1 Performance Standards, which in new installations would make door heater controls necessary when using the kWbase assumptions above.

[1646] NEEP Refrigeration Loadshape Report. The Cadmus Group, Commercial Refrigeration Loadshape Project Final Report, Northeast Energy Efficiency Partnerships, Regional Evaluation, Measurement, and Verification Forum, Lexington, MA 2015, p. 8

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-ZED-V02-270101

REVIEW DEADLINE: 1/1/2030

4.6.16 Door Gaskets for Walk-in and Reach-in Coolers and Freezers

DESCRIPTION

This measure characterizes the savings associated with installing new door gaskets on existing refrigerated cases and walk-in units where the existing gasket has been worn to the point where it no longer provides an effective seal. Tight fitting gaskets inhibit infiltration of warm, moist air into the cold refrigerated space, thereby reducing the cooling load. The reduction of moisture in the case also helps prevent frost on the evaporator coil. Frost buildup on the coil reduces the heat transfer effectiveness, reduces air passage, and increases energy use during the defrost cycle. Therefore, replacing defective door gaskets reduces compressor run time and improves the overall effectiveness of heat removal from a refrigerated cabinet or walk-in unit.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is assumed to be a standard replacement gasket with the same profile and material composition as the original. The fit must be tight and seal properly upon installation with no visible gaps or tears.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be a worn refrigeration gasket with visible damage that is allowing air to enter the unit with the door closed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 3 years[1647]

DEEMED MEASURE COST

Measure costs are based on values from a door gasket measure maintained by the RTF (Regional Technical Forum)[1648]. Original measure costs were adjusted for inflation from 2012 to 2026[1649].

Annual Savings	Cost/Door
Reach-In Cooler	$130
Reach-In Freezer	$160
Walk-In Cooler	$122
Walk -In Freezer	$181

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

This measure has deemed kW savings therefore a coincidence factor does not apply.

[1647] California Public Utilities Commission Database for Energy Efficient Resources (DEER) CPUC Support Table (2020) – Effective Useful Life and Remaining Useful Life. https://www.caetrm.com/cpuc/table/effusefullife/

[1648] Database for UES measures, Regional Technical Forum. Door Gasket Replacement, Version 2.0. June 2019 https://rtf.nwcouncil.org/measure/door-gasket-replacement/

[1649] U.S. Bureau of Labor Statistics - CPI Inflation Calculator https://data.bls.gov/cgi-bin/cpicalc.pl

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings calculations are based on values from a door gasket replacement measure maintained by the RTF (Regional Technical Forum).[1650]

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = \Delta\text{kWhDoor} * \text{Doors}$$

Where:

ΔkWhDoor = Annual kWh savings per door from the table below

Annual Savings	ΔkWhDoor
Reach-In Cooler	118
Reach-In Freezer	211
Walk-In Cooler	394
Walk -In Freezer	711

Doors = Number of doors receiving new door gaskets

For example, a bank of 10 reach-in cooler doors have their old gaskets replaced with tight fitting and properly sealed new gaskets and would annually save:

ΔkWh = 118 * 10
= 1,180 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \Delta\text{kWDoor} * \text{Doors}$$

Where:

ΔkWDoor = Annual kW savings per door from the table below

Annual Savings	ΔkWDoor
Reach-In Cooler	0.015
Reach-In Freezer	0.027
Walk-In Cooler	0.049
Walk -In Freezer	0.089

FOSSIL FUEL SAVINGS

There are no expected fossil fuel gas savings for this measure.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

[1650] Database for UES measures, Regional Technical Forum. Door Gasket Replacement, Version 2.0. June 2019 https://rtf.nwcouncil.org/measure/door-gasket-replacement/

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-DGS-V02-270101

REVIEW DEADLINE: 1/1/2030

4.6.17 Refrigeration Tune Up

DESCRIPTION

The refrigeration tune-up includes the professional maintenance of an existing refrigeration system that has not been regularly maintained. A refrigeration system that is cleaned, inspected, and maintained uses less energy than a system that has not been cleaned and maintained. A checklist of tune-up tasks is provided in the efficient equipment definition section below.

This measure was developed to be applicable to the following program types: RF.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a refrigeration system associated with a commercial enterprise that has been inspected and tuned up by a U.S. EPA 608 Certified Service Provider. The certified technician must abide by all rules and regulations related to refrigerant testing and safety protocol and must conduct, at a minimum, the following tasks:

- Clean and inspect condenser and evaporator coils;
- Clean drain pan;
- Inspect/clean/replace fans, screens, grills, filters, and drier cores;
- Check operation and optimize sub-cooling and superheat temperatures, heat reclaimers, and defrost heaters;
- Tighten all voltage connections;
- Inspect/replace relays and capacitors as needed;
- Add/remove refrigerant charge as needed.

Manufacturers' specifications should be referenced where possible to align the equipment's operating conditions to that of its original design. The entire system must be serviced to qualify for this measure.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a commercial refrigeration system that has not been tuned up in more than 36 months. The baseline refrigeration system may be a self-contained or single compressor system, or a rack refrigeration system. This measure does not apply to refrigeration systems in warehouses or industrial process settings.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 3 years.[1651]

DEEMED MEASURE COST

Tune-up costs can vary, particularly if refrigerant leak detection, remediation, and recharge are necessary. Actual invoice tune-up costs should be used.

LOADSHAPE

Loadshape C22 - Commercial Refrigeration

COINCIDENCE FACTOR

The coincidence factor equals 0.964[1652]

[1651] The expected measure life is sourced from DEER2014 EUL Table for measures: "Clean Condenser Coils – Commercial" and "Clean Evaporator Coils".

[1652] Summer peak coincidence factor is assumed to match the coincidence factor for 4.6.13 Add Doors to Open Refrigerated Display Cases

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings calculations are based on values from a door gasket replacement measure maintained by the RTF (Regional Technical Forum).[1653]

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = capacity * \frac{12}{EER} * SF * DC * 8{,}760$$

Where:

Capacity = Refrigeration system capacity in Tons

= Actual if known

= If unknown, for self-contained or single compressor walk-in units (not associated with a rack system), you may assume 124 btu/sq.ft. of walk-in area[1654]. The equation below provides this value in Tons for use in the electric energy savings formula.

$$capacity = \frac{124 * Sq.Ft.}{12000}$$

= For rack systems, use capacity at operating suction and discharge pressures

Sq. Ft. = Floor area of walk-in cooler or freezer

12 = Conversion factor based on definition of EER, converts EER to kW/ton

EER = Energy efficiency ratio of the compressor

= Actual if known

= If unknown, use values from the table below

Refrigeration Operating Temperature	Rack System[1655]	Single Compressor / Self Contained Unit[1656]
Medium Temperature (Cooler)	8.5	11.7
Low Temperature (Freezer)	4.4	3.4

[1653] Database for UES measures, Regional Technical Forum. Door Gasket Replacement, Version 2.0. June 2019 https://rtf.nwcouncil.org/measure/door-gasket-replacement/

[1654] US Department of Energy Building Technologies Office, "Energy Savings Potential and Research & Development Opportunities for Commercial Refrigeration",2009. Average of btu per unit square foot as described in table 3-14 "Characteristics of the Baseline Cooler and Freezer".

[1655] Arthur D Little, Inc. Energy Savings Potential for Commercial Refrigeration Equipment – Final report, 1996. The report uses COP values of 2.5 for coolers and 1.3 for freezers. These have been converted for use in this measure to EER values by multiplying the COP values by 3.412.

[1656] US Department of Energy Building Technologies Office, "Energy Savings Potential and Research & Development Opportunities for Commercial Refrigeration",2009. EER values sourced from table 3-14 "Characteristics of the Baseline Cooler and Freezer".

SF = Refrigeration savings factor from tune-up[1657]

= 7%

DC = Duty cycle, the average fraction of time that the compressor operates

Refrigeration Operating Temperature	Duty Cycle[1658]
Medium Temperature (Cooler)	0.66
Low Temperature (Freezer)	0.70

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW} = \frac{\Delta kWh}{(DC * 8{,}760)} * CF$$

Where:

Where:

kW = Gross customer connected load kW savings for the measure (kW)

DC = Duty Cycle as defined in the Electric Energy Savings section

CF = System peak Coincidence Factor

= 0.964

Fossil Fuel Savings

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-RFG-RTU-V01-270101

REVIEW DEADLINE: 1/1/2031

[1657] 7% savings is indicated from Wisconsin's FOE program. PSC of Wisconsin, Focus on Energy Evaluation, Business Programs: Deemed Savings Manual V1.0

[1658] US Department of Energy Building Technologies Office, "Energy Savings Potential and Research & Development Opportunities for Commercial Refrigeration",2009. Compressor duty cycles as described in tables 3-17 "Merchandising Walk-in Cooler - Energy Consumption Breakdown" & 3-18 "Storage-only Walk-in Freezer - Energy Consumption Breakdown".

4.7.Compressed Air End Use

4.7.1 VSD Air Compressor

DESCRIPTION

This measure relates to the installation of an air compressor with a variable frequency drive, load/no-load controls or variable displacement control. Baseline compressors choke off the inlet air to modulate the compressor output, which is not efficient. Efficient compressors use a variable speed drive on the motor to match output to the load. Savings are calculated using representative baseline and efficient demand numbers for compressor capacities according to the facility's load shape, and the number of hours the compressor runs at that capacity. Demand curves are as per DOE data for a Variable Speed compressor versus a Modulating compressor. This measure applies only to an individual compressor ≤ 200 hp. Only one compressor per compressed air distribution system is eligible.

This measure was developed to be applicable to the following program types: TOS.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is a compressor ≤ 200 hp with variable speed control.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is either an oil-flooded compressor ≤ 200 hp with inlet modulating with blowdown or load/no-load controls.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

13 years[1659]

DEEMED MEASURE COST

$$\text{IncrementalCost (\$)} = ((127 * hp_{compressor}) + 1{,}446) * 1.54$$[1660]

Where:

127 and 1,446[1661] = compressor motor nominal hp to incremental cost conversion factor and offset

$hp_{compressor}$ = compressor motor nominal

DEEMED O&M COST ADJUSTMENTS

N/A

LOADSHAPE

Loadshape C35 - Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

[1659] Department of Energy Technical Support Document.
[1660] Adjustment for inflation since incremental cost study is in $2008. The U.S. Bureau of Labor Statistic CPI Inflation Calculator was used to adjust $2008 (January) to $2026 (January). The resulting factor was 1.54. This adjustment was evaluated against current pricing of compressors (2026) and found to be a reasonable and appropriate.
[1661] Conversion factor and offset based on a linear regression analysis of the relationship between air compressor motor nominal horsepower and incremental cost, as sourced from the Efficiency Vermont Technical Reference Manual (TRM). Several Vermont vendors were surveyed to determine the cost of equipment.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = 0.9 * hp_{compressor} * HOURS * (CF_b - CF_e)$$

Where:

ΔkWh = gross customer annual kWh savings for the measure

$hp_{compressor}$ = compressor motor nominal hp

0.9[1662] = compressor motor nominal hp to full load kW conversion factor

HOURS = compressor total hours of operation below depending on shift

Shift	Hours	Description
Single shift (8/5)	1,976	7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952	7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928	24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8,320	24 hours per day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average[1663]	5,702	

CF_b = baseline compressor factor[1664]

Baseline Compressor	Compressor Factor (≤ 40 hp)[1665]	Compressor Factor (50 – 200 hp)[1666]
Modulating w/ Blowdown	0.890	0.863
Load/No-Load w/ 1 Gallon/CFM	0.909	0.887
Load/No-Load w/ 3 Gallon/CFM	0.831	0.811
Load/No-Load w/ 5 Gallon/CFM	0.806	0.786

[1662] Conversion factor based on Survey of CAGI data sheets from 200 compressors. See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.

[1663] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

[1664] Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM.(The "variable speed drive" compressor factor has been adjusted up from the 0.675 presented in the analysis to 0.705 to account for the additional power draw of the VSD).

[1665] Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM. (The "variable speed drive" compressor factor has been adjusted up from the 0.675 presented in the analysis to 0.705 to account for the additional power draw of the VSD). See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.

[1666] Compressor factors for this size range were developed using DOE part-load data for different compressor control types as well as load profiles from 45 compressors and 20 facilities. This data comes from ComEd Custom and Insustrial Systems programs. The compressors were filtered to reflect only rotary screw compressors, between 50 and 200 hp, and operating a minimum of 4 hour per day, Additionally, compressors with clear and consistent baseload profiles were excluded from this analysis. See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.

CF_e = efficient compressor

=0.705 for units ≤ 40 hp[1667]

= 0.658 for units 50 – 200 hp

For example, a VSD compressor with 10 hp operating in a 1-shift facility would save

ΔkWh = 0.9 * 10 * 1,976 *(0.890 – 0.705)

= 3,290 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh \ / \ HOURS \ * \ CF$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average[1669]	0.89

For example, a VSD compressor with 10 HP operating in a 1 shift facility would save

ΔkW = 3,290/1,976*0.59

= 0.98 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-VSDA-V05-270101

REVIEW DEADLINE: 1/1/2030

[1667] Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM.(The "variable speed drive" compressor factor has been adjusted up from the 0.675 presented in the analysis to 0.705 to account for the additional power draw of the VSD). See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.
[1668] Compressor factors for this size range were developed using DOE part-load data for different compressor control types as well as load profiles from 45 compressors and 20 facilities. This data comes from ComEd Custom and Insustrial Systems programs. The compressors were filtered to reflect only rotary screw compressors, between 50 and 200 hp, and operating a minimum of 4 hour per day, Additionally, compressors with clear and consistent baseload profiles were excluded from this analysis. See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.
[1669] Ibid.

4.7.2 Compressed Air Low Pressure Drop Filters

DESCRIPTION

Low pressure drop filters remove solids and aerosols from compressed air systems with a longer life and lower pressure drop than standard coalescing filters, resulting in the ability to lower a compressed air systems pressure setpoints. This reduces the compressor work required resulting in energy savings.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a low pressure drop filter with pressure drop not exceeding 1 psid when new and 3 psid at element change.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a standard coalescing filter with a pressure drop of 3 psid when new and 5 psid or more at element change

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years [1670]

DEEMED MEASURE COST

The incremental cost for this measure is estimated to be $1,000 Incremental cost per filter.[1671]

LOADSHAPE

Loadshape C35 - Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (kW_{typical} \times \Delta P \times SF \times Hours / hp_{typical}) \times hp_{real}$$

Where:

$kW_{typical}$ = Adjusted compressor power (kW) based on typical compressor loading and operating profile. Use actual compressor control type if known:

[1670] Based on survey of manufacturer claims (Zeks, Van Air, Quincy), as recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

[1671] Incremental cost research found in LPDF Costs. xlsx.

Compressor $kW_{typical}$

Control Type	$kW_{typical}$ [1672]
Reciprocating - On/off Control	70.2
Reciprocating - Load/Unload	74.8
Screw - Load/Unload	82.3
Screw - Inlet Modulation	82.5
Screw - Inlet Modulation w/ Unloading	82.5
Screw - Variable Displacement	73.2
Screw - VFD	70.8

= If the actual compressor control type is not known, use a weighted average based on the following market assumptions:

Control Type	Share %	$kW_{typical}$ [1673]
Market share estimation for load/unload control compressors	40%	74.8
Market share estimation for modulation w/unloading control compressors	40%	82.5
Market share estimation for variable displacement control compressors	20%	73.2
Weight average	-	77.6

ΔP = Reduction in pressure differential across the filter (psi)

=2 psi[1674]

SF =1% reduction in power per 2 psi reduction in system pressure is equal to 0.5% reduction per 1 psi, or a Savings Factor of 0.005[1675]

Hours = Compressor hours of operation below depending on shift

Shift	Hours	Description
Single shift (8/5)	1,976	7 AM – 3 PM, weekdays, minus three-weekday holidays and 10 days of scheduled down time
2-shift (16/5)	3,952	7AM – 11 PM, weekdays, minus three-weekday holidays and 10 days of scheduled down time
3-shift (24/5)	5,928	24 hours per day, weekdays, minus three-weekday holidays and 10 days of scheduled down time
4-shift (24/7)	8,320	24 hours per day, 7 days a week minus three-week day holidays and 10 days of scheduled down time
Unknown / Weighted average[1676]	5,702	

$hp_{typical}$ = Nominal hp for typical compressor = 100 hp[1677]

[1672] See "Industrial System Standard Deemed Saving Analysis.xls".
[1673] See "Industrial System Standard Deemed Saving Analysis.xls".
[1674] Assumed pressure will be reduced from a roughly 3 psi pressure drop through a filter to less than 1 psi, for a 2 psi savings
[1675] "Optimizing Pneumatic Systems for Extra Savings," Compressed Air Best Practices, DOE Compressed Air Challenge, 2010.
[1676] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.
[1677] Industrial System Standard Deemed Saving Analysis.xls

hp_{real} = Total hp of real compressors distibuting air through filter. This should include the total horsepower of the compressors that normally run through the filter, but not backup compressors.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh \ / \ Hours \ * \ CF$$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average[1678]	0.89

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-LPDF-V04-220101

REVIEW DEADLINE: 1/1/2030

[1678] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

4.7.3 Compressed Air No-Loss Condensate Drains

DESCRIPTION

No-loss condensate drains remove condensate as needed without venting compressed air, resulting in less air demand and consequently better efficiency. Replacement or upgrades of existing no-loss drains are not eligible for the incentive.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is installation of no-loss condensate drains.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is installation of standard condensate drains (open valve, timer, or both)

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 13 years.[1679]

DEEMED MEASURE COST

The average equipment cost per drain is $194 with an installation labor cost of $50 for a total incremental cost $244 per drain.[1680]

LOADSHAPE

Loadshape C35 - Industrial Process

COINCIDENCE FACTOR

The coincidence factor equals 0.80[1681]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = CFM_{reduced} \; x \; kW_{CFM} \; x \; Hours$$

Where:

$CFM_{reduced}$ = Reduced air consumption (CFM) per drain

= 3 CFM[1682]

kW_{CFM} = System power reduction per reduced air demand (kW/CFM) depending on the type of compressor control:

System Power Reduction per Reduced Air Demand[1683]

[1679] Measure Life Study prepared for The Massachusetts Joint Utilities, Energy & Resource Solutions, 2005

[1680] Based on empirical project data from ComEd Comprehensive Compressed Air Study program and VEIC review of pricing data found in CAS Cost Data.xlsx.

[1681] DMI (2006). Impact Evaluation of 2004 Compressed Air Prescriptive Rebates. Prepared for National Grid; results analyzed in RLW Analytics (2006). Sample Design and Impact Evaluation Analysis for Prescriptive Compressed Air Measures in the Energy Initiative and Design 2000 Programs. Prepared for National Grid.

[1682] Reduced CFM consumption is based on a timer drain opening for 10 seconds every 300 seconds as the baseline. See "Industrial System Standard Deemed Saving Analysis.xls".

[1683] Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See "Industrial System Standard Deemed Saving Analysis.xls".

Control Type	kW / CFM
Reciprocating - On/off Control	0.184
Reciprocating - Load/Unload	0.136
Screw - Load/Unload	0.152
Screw - Inlet Modulation	0.055
Screw - Inlet Modulation w/ Unloading	0.055
Screw - Variable Displacement	0.153
Screw - VFD	0.178

Or if compressor control type is unknown, then a weighted average based on market share can be used: [1684]

Control Type	Share %	kW / CFM
Market share estimation for load/unload control compressors	40%	0.136
Market share estimation for modulation w/unloading control compressors	40%	0.055
Market share estimation for variable displacement control compressors	20%	0.153
Weighted Average		0.107

Hours = Compressed air system pressurized hours

=6136 hours[1685]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh / HOURS * CF$

Where:

CF = Summer peak coincidence factor for this measure

= 0.80[1686]

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-NCLD-V04-250101

REVIEW DEADLINE: 1/1/2028

[1684] Table 8.2.3, Technical Support Document. US Department of Energy

[1685] US DOE, Evaluation of the Compressed Air Challenge® Training Program, Page 19.

[1686] DMI (2006). Impact Evaluation of 2004 Compressed Air Prescriptive Rebates. Prepared for National Grid; results analyzed in RLW Analytics (2006). Sample Design and Impact Evaluation Analysis for Prescriptive Compressed Air Measures in the Energy Initiative and Design 2000 Programs. Prepared for National Grid.

4.7.4 Efficient Compressed Air Nozzles

DESCRIPTION

This measure is for the replacement of a standard air nozzle with a high-efficiency air nozzle used in a compressed air system. High-efficiency air nozzles reduce the amount of air required to blow off parts or for drying. These nozzles utilize the Coandă effect to pull in free air to accomplish tasks with significantly less compressed air. High-efficiency nozzles often replace simple copper tubes. These nozzles have the added benefits of noise reduction and improved safety in systems with greater than 30 psig.

DEFINITION OF EFFICIENT EQUIPMENT

The high-efficiency air nozzle must meet the following specifications:

1. High-efficiency air nozzle must replace continuous open blow-offs.
2. High-efficiency air nozzle must meet SCFM rating at 80psig less than or equal to:

Nozzle Diameter:	1/8”	1/4"	5/16”	1/2"
Max SCFM Rating @ 80psig:	11	29	56	140

3. Manufacturer’s specification sheet of the high-efficiency air nozzle must be provided along with the make and model.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is a standard air nozzle.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 15 years.[1687]

DEEMED MEASURE COST

The estimated incremental measure costs are presented in the following table:[1688]

Nozzle Diameter:	1/8”	1/4"	5/16”	1/2"
Average Incremental Cost:	$42	$57	$87	$121

LOADSHAPE

Loadshape C35 - Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (SCFM * SCFM\%Reduced) * kW/CFM * \%USE * Hours$$

Where:

[1687] PA Consulting Group (2009). Business Programs: Measure Life Study. Prepared for State of Wisconsin Public Service Commission.

[1688] Costs are from EXAIR’s website and are an average of nozzles that meet the flow requirements. Models include Atto Super, Pico Super, Nano Super, Micro Super, Mini Super, Super and Large Super nozzles. Accessed March 20, 2014.

SCFM = Air flow through standard nozzle. Use actual rated flow at 80 psi if known. If unknown, the table below includes the CFM by orifice diameter.[1689, 1690]

Orifice Diameter	SCFM
1/8”	21
1/4”	58
5/16”	113
1/2"	280

SCFM%Reduced = Percent in reduction of air loss per nozzle. Estimated at 50%.[1691]

kW/CFM = System power reduction per air demand (kW/CFM) depending on the type of air compressor found in table below:[1692]

Air Compressor Type	kW/CFM
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Inlet Modulation	0.06
Screw – Inlet Modulation w/ Unloading	0.06
Screw – Variable Displacement	0.15
Screw - VFD	0.18

%USE = Percent of the compressor’s total operating hours that the nozzle is in use.

= Custom. If unknown assume 5%.[1693]

Hours = Compressed air system pressurized hours.

= Use actual hours if known. Otherwise assume values in table below:

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average[1694]	5,702

[1689] Review of manufacturer’s information.

[1690] Technical Reference Manual (TRM) for Ohio Senate Bill 221 “Energy Efficiency and Conservation Program” and 09-512-GE-UNC, October 15, 2009. Pages 170-171.

[1691] Conservative estimate based on average values provided by the Compressed Air Challenge Training Program, Machinery’s Handbook 25th Edition, and manufacturers’ catalog.

[1692] Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See “Industrial System Standard Deemed Saving Analysis.xls”.

[1693] Assumes 50% handheld air guns and 50% stationary air nozzles. Manual air guns tend to be used less than stationary air nozzles, and a conservative estimate of 1 second of blow-off per minute of compressor run time is assumed. Stationary air nozzles are commonly more wasteful as they are often mounted on machine tools and can be manually operated resulting in the possibility of a long term open blow situation. An assumption of 5 seconds of blow-off per minute of compressor run time is used.

[1694] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

For example, a ¼" diameter efficient air nozzle on a screw – VFD system, running on a three-shift schedule would save the following:

ΔkWh = (SCFM * SCFM%Reduced) * kW/CFM * %USE * Hours

= (58 * 50%) * 0.18 * 5% *5,928

= 1,547.2 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh \ / \ Hours \ * \ CF$$

Where:

ΔkWh = As calculated above.

CF = Summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average[1695]	0.89

For examble, a ¼" diameter efficient air nozzle on a screw – VFD system, running on a three-shift schedule would save the following:

ΔkW = ΔkWh / Hours * CF

= 1,547.2 / 5,928 * 0.95

= 0.25 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE CI-CPA-CNOZ-V04-250101

REVIEW DEADLINE: 1/1/2030

[1695] Ibid.

4.7.5 Efficient Refrigerated Compressed Air Dryer

DESCRIPTION

An air dryer is an essential component in a compressed air system that prevents condensate from being deposited in the compressed air supply lines of a facility. If warm saturated compressed air is supplied directly to the plant, excess condensate will form in the compressed air supply lines. Uncontrolled condensate can damage demand-side tools and process equipment. Secondly, in an oil-flooded rotary screw compressor, the residual oil from compression can be carried along the supply lines potentially damaging process equipment. Industries that use compressed air for processes make use of various types of dryers including refrigerated dryers (both cycling and non-cycling). For this measure, three types of refrigerated air dryers will be considered: thermal mass, variable speed, and digital scroll. All these technologies offer better part load performance compared to non-cycling refrigerated dryers, thereby offering energy savings during periods when the dryer is not operating at peak capacity.

This measure was developed to be applicable to the following program types: TOS.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

A new, high efficiency thermal mass dryer, variable speed dryer, or digital scroll dryer.

DEFINITION OF BASELINE EQUIPMENT

A standard non-cycling refrigerated compressed air dryer of comparable capacity.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 13 years.[1696]

DEEMED MEASURE COST

The incremental capital cost for this measure is $6 per CFM.[1697]

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = P_s * (EC50_{baseline} - EC50_{efficient}) * HOURS * CFM$$

Where:

P_s = Full flow specific power of the dryer

= 0.007 kW/CFM[1698] (for both baseline and efficient equipment)

[1696] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[1697] Analysis of material cost between cycling and non-cycling dryers according to online prices from Grainger. Cost provided is the average incremental cost when comparing non-cycling and cycling dryers of the same CFM capacity.
[1698] Compressed Air Challenge: Compressed Air Best Practice; "Cycling Air Dryers – Are Savings Significant?" Fox, Timothy J. and Marshall, Ron.

$EC50_{baseline}$ = Energy consumption ratio of baseline dryer at 50%[1699] inlet load capacity as compared to fully loaded operating conditions.[1700]

= 0.843

$ECF50_{efficient}$ = Energy consumption ratio of efficient dryer at 50% inlet load capacity as compared to fully loaded operating conditions.

= Dependent on efficient dryer type, refer to the following table:[1701]

Dryer Type	$EC50_{efficient}$
Thermal-Mass	0.729
VSD	0.501
Digital Scroll	0.551

HOURS = Compressed air system pressurized hours, depending on shift. If unknown, use weighted average. This value is the weighted average of facility owner responses from the DOE evaluation of the Compressed Air Challenge. Facility owners with compressed air systems were surveyed detailing the number of shifts their facilities operated.

Shift	Shift	Hours	Distribution of Facilities by Hours of Operation[1702]	Weighted Hours
Single Shift	7 AM – 3 PM, weekdays, minus some holidays and scheduled down time	1,976	16%	316
Two Shift	7AM – 11 PM, weekdays, minus some holidays and scheduled down time	3,952	23%	909
Three Shift	24 hours per day, weekdays, minus some holidays and scheduled down time	5,928	25%	1,482
Four Shifts or Continual Operation	24 hours per day, 7 days a week minus some holidays and scheduled down time	8,320	36%	2,995
			Total Weighted Average:	5,702

CFM = Cubic feet per minute, rated capacity of refrigerated dryer

= Assume 100% of actual rated capacity.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh \ / \ HOURS \ * \ CF$

Where:

CF = Summer peak coincidence factor, depending on shift. If unknown, use weighted average.

Shift	Coincidence Factor
Single Shift	0.59

[1699] Engineering judgement, based on the assumption that on average, compressed air systems will operate at 50% capacity.
[1700] Compressed Air Challenge: Compressed Air Best Practice; "Cycling Air Dryers – Are Savings Significant?" Fox, Timothy J. and Marshall, Ron.
[1701] Compressed Air Challenge: Compressed Air Best Practice; "Cycling Air Dryers – Are Savings Significant?" Fox, Timothy J. and Marshall, Ron.
[1702] DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

Shift	Coincidence Factor
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average[1703]	0.89

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-CADR-V03-240101

REVIEW DEADLINE: 1/1/2028

[1703] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

4.7.6 Vortex Tube Thermostat - Provisional Measure – Retired 12/31/2023, Removed in v12

4.7.7 Efficient Desiccant Compressed Air Dryer

DESCRIPTION

Compressed air is dried to reduce or eliminate condensation that can harm the compressed air system or end use equipment. For applications that require air to be dried below a dew point of 35°F,[1704] regenerative desiccant air dryers are typically used. Typically, regenerative desiccant dryers achieve pressure dew points as low as -40°F.

Regenerative desiccant dryers generally consist of two towers (or vertical tanks) filled with porous desiccant media. "Wet" compressed air flows through one tower, exiting as dried compressed air, while the other tower is dried out (or regenerated). This dryer alternates this process between towers to prevent compressed air flowing through saturated towers and damaging downstream equipment. The means of regeneration distinguishes the different types of regenerative dryer.

Heatless Desiccant Dryer: Uses compressed air ("purge air") to dry out the regenerating tower. The amount of purge air is typically between 15-20% of the dryer's rate flow (CFM), regardless of the flow rate that the compressor is supplying.[1705] This type of dryer alternates tower regeneration approximately every 5 minutes.[1706]

Heated Desiccant Dryer: Uses a combination of compressed purge air and heat for regeneration. The amount of purge air is typically 5-10% of the dryer's rate flow (CFM), regardless of the flow rate that the compressor is supplying.[1707] This type of dryer alternates tower regeneration approximately every 8 hours.[1708]

Externally Heated Blower Purge Dryer: Uses an external blower and heat source for regeneration. This type of dryer requires a small amount (2%) of purge air or ambient air to cool the tower after heating. This type of dryer alternates tower regeneration approximately every 8 hours.[1709] There is also a type of blower purge dryer called a zero-purge dryer that eliminates all compressed purge air.

The energy use of these dryers is primarily due to regeneration of the desiccant. Standard dryers come equipped with a fixed, timer regeneration control. However, the actual load on the dryer is variable. Optional dew point demand controls (DPDC) adjust the amount of regeneration to the moisture load on the dryer, reducing unnecessary purge energy.

This measure was developed to be applicable to the following program types: TOS, NC, ER.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is heated or externally heated by a blower purge desiccant dryer without dew point demand controls. Dryers installed on inlet modulation compressors do not qualify for this measure.

[1704] The dew point limitation of the most common refrigerant-type air dryer. Improving Compressed Air System Performance: A Sourcebook for Industry, US Department of Energy. Page 48. https://www.energy.gov/sites/prod/files/2016/03/f30/Improving%20Compressed%20Air%20Sourcebook%20version%203.pdf

[1705] Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron. https://airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0

[1706] Regenerative Desiccant Compressed Air Dryers. White, Donald. https://airbestpractices.com/technology/air-treatmentn2/regenerative-desiccant-compressed-air-dryers

[1707] Types of Compressed Air Dryers 2: Refrigerant and Regenerative Desiccant, Compressed Air and Gas Institute (CAGI). https://airbestpractices.com/technology/air-treatment/n2/types-compressed-air-dryers-refrigerant-and-regenerative-desiccant

[1708] Regenerative Desiccant Compressed Air Dryers. White, Donald. https://airbestpractices.com/technology/air-treatmentn2/regenerative-desiccant-compressed-air-dryers

[1709] Regenerative Desiccant Compressed Air Dryers. White, Donald. https://airbestpractices.com/technology/air-treatmentn2/regenerative-desiccant-compressed-air-dryers

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a heatless regenerative desiccant dryer without dew point demand controls.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The lifetime of this measure is 15 years.[1710]

DEEMED MEASURE COST

The incremental equipment cost for heated and blower purge regenerative desiccant dryers is $3/CFM and $12/CFM, respectively.[1711]

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = CFM_{Dryer} * (P_{Base} -- P_{EE} * PRF) * HOU$$

Where:

CFM_{Dryer} = rated capacity of the dryer in cubic feet per minute (CFM)

P_{Base} = power requirement of the baseline heatless regenerative dryer (kW/CFM)

= $PF_{Heatless} * kW_{comp}$

$PF_{Heatless}$ = purge flow of heatless model (%)

= 15%[1712]

kW_{comp} = system power reduction per reduced air demand (kW/CFM) depending on the type of compressor control.[1713] If unknown, assume Screw – Load/Unload.

Air Compressor Type	ΔkW/CFM
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Variable Displacement	0.15
Screw - VFD	0.18

[1710] Focus on Energy Evaluation Business Programs: Measure Life Study, p. 91-92. PA Consulting Group. August 25, 2009. https://focusonenergy.com/sites/default/files/bpmeasurelifestudyfinal_evaluationreport.pdf

[1711] Analysis of equipment cost between heatless, heated, blower purge dryers according to available online pricing. The capacity range considered was 250 – 1,500 CFM. Cost provided is the average incremental cost when comparing heated and blower purge dryers to baseline heatless dryers of the same CFM capacity. See "IL TRM Deissciant Dryers – Supporting Information.xls" file for more detail.

[1712] Typical estimates of purge flow for heatless dryers range from 15-20% of dryer rated capacity. 15% was selected as a conservative value.

[1713] Consistent with Air Nozzle measure, this assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See "Industrial System Standard Deemed Saving Analysis.xls".

Note: Dryers installed on inlet modulation compressors do not qualify for this measure.

P_{EE}	= power requirement of the energy efficient (heated or blower purge) regenerative dryer (kW/CFM)
	= $(PF_{EE} * kW_{comp} + kW_{Heater} + kW_{Blower})$
PF_{EE}	= purge flow of energy efficient model (%)[1714]
	= 7.5% for heated models
	= 2% for blower purge models (with compressed air cooling)
	= 0% for "zero-purge" blower purge models
kW_{Heater}	= average power of heater per CFM of dryer (kW/CFM)[1715,1716]
	= 0.007 kW/CFM for heated models
	= 0.013 kW/CFM for blower purge models
kW_{Blower}	= average power of blower per CFM of dryer (kW/CFM)[1717]
	= 0 kW/CFM for heated models
	= 0.003 kW/CFM for blower purge models
PRF	= purge reduction factor
	= Assume 50% for heatless desiccant dryers%[1718]
	= Assume 60% for externally heated or heated blower purge desiccant dryers[1719]
HOU	= compressor total hours of operation below depending on shift

[1714] Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron. https://airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0

[1715] Based on a review of data sheets from six manufacturers. These values reflect average heater kW and not nominal heater kW. The heater operation will vary based on moisture load to the dryer. See "IL TRM Deisscant Dryers – Supporting Information.xls" file for more detail.

[1716] The heater operation will be controlled by temperature to avoid overheating the desiccant media. Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron. https://airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0

[1717] Based on a review of data sheets from six manufacturers. These values reflect average blower kW and not nominal blower kW. The blower operation will in many cases vary based on moisture load to the dryer. See "IL TRM Deisscant Dryers – Supporting Information.xls" file for more detail.

[1718] "For heatless desiccant dryers, the reduction in purge tends to be proportional only to the reduction of flow, not the reduction in moisture load due to the lower inlet temperatures." The 50% value is based on the TRM's assumption of a 50% dryer load factor used Illinois TRM Measure 4.7.5. Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers. https://www.airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0

[1719] "But for heated style units, the dryer reacts to both reductions. This means some energy is saved due to flow reduction, and additional energy is saved due to the lower moisture load in the cooler inlet air, resulting in more energy savings when compared with heatless styles." Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers. https://www.airbestpractices.com/system-assessments/air-treatmentn2/lessons-learned-saving-energy-costs-heated-blower-desiccant-dry-0

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average[1720]	5,702

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$\Delta kW_{peak} = \Delta kWh \ / \ HOU \ * \ CF$

Where:

CF = summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average[1721]	0.89

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE CI-CPA-DDRY-V03-240101

REVIEW DEADLINE: 1/1/2028

[1720] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

[1721] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

4.7.8 Desiccant Dryer Dew Point Demand Controls

DESCRIPTION

Compressed air is dried to reduce or eliminate condensation that can harm the compressed air system or end use equipment. For applications that require air to be dried below a dew point of 35°F,[1722] regenerative desiccant air dryers are typically used. Typically, regenerative desiccant dryers achieve pressure dew points as low as -40°F.

Regenerative desiccant dryers generally consist of two towers (or vertical tanks) filled with porous desiccant media. "Wet" compressed air flows through one tower, exiting as dried compressed air, while the other tower is dried out (or regenerated). This dryer alternates this process between towers to prevent compressed air flowing through saturated towers and damaging downstream equipment. The means of regeneration distinguishes the different types of regenerative dryer.

The energy use of these dryers is primarily due to regeneration of the desiccant. Standard dryers come equipped with a fixed, timer regeneration control. However, the actual load on the dryer is variable. Dew point demand controls (DPDC) adjust the amount of regeneration to the load on the dryer, reducing unnecessary purge energy. DPDC can be retrofit on existing desiccant dryers or integrated in new desiccant dryers.

Heatless Desiccant Dryer: Uses compressed air ("purge air") to dry out the regenerating tower. The amount of purge air is typically between 15-20% of the dryer's rate flow (CFM), regardless of the flow rate that the compressor is supplying.[1723] This type of dryer alternates tower regeneration approximately every 5 minutes.[1724]

Heated Desiccant Dryer: Uses a combination of compressed purge air and heat for regeneration. The amount of purge air is typically 5-10% of the dryer's rate flow (CFM), regardless of the flow rate that the compressor is supplying.[1725] This type of dryer alternates tower regeneration approximately every 8 hours.[1726]

Externally Heated Blower Purge Dryer: Uses an external blower and heat source for regeneration. This type of dryer requires a small amount (2%) of purge air or ambient air to cool the tower after heating. This type of dryer alternates tower regeneration approximately every 8 hours.[1727] There is also a type of blower purge dryer called a zero purge dryer that eliminates all compressed purge air.

This measure was developed to be applicable to the following program types: RF

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a heatless, externally-heated, or blower purge regenerative desiccant dryer with dew point demand controls. The controls should be able to respond to changes in flow and moisture loading. Dryers installed on inlet modulation compressors do not qualify for this measure.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a heatless, externally-heated, or blower purge regenerative desiccant dryer without dew point demand controls.

[1722] The dew point limitation of the most common refrigerant-type air dryer. Improving Compressed Air System Performance: A Sourcebook for Industry, US Department of Energy. Page 48.
[1723] Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.
[1724] Regenerative Desiccant Compressed Air Dryers. White, Donald.
[1725] Types of Compressed Air Dryers 2: Refrigerant and Regenerative Desiccant, Compressed Air and Gas Institute (CAGI).
[1726] Regenerative Desiccant Compressed Air Dryers. White, Donald.
[1727] Regenerative Desiccant Compressed Air Dryers. White, Donald.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The lifetime of this measure is 5 years.[1728]

DEEMED MEASURE COST

The estimated cost of the controls retrofit is $4,000.[1729]

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = CFM_{Dryer} * (PF * kW_{Comp} + kW_{Heater} + kW_{Blower}) * HOU * PRF$$

Where:

CFM_{Dryer} = rated capacity of the dryer in cubic feet per minute (CFM)

PF = purge flow of desiccant dryer (%)[1730]

Air Compressor Type	Purge Flow
Heatless	15%
Externally-Heated	7.5%
Blower Purge	2.0%

kW_{Comp} = system power reduction per reduced air demand (kW/CFM) depending on the type of compressor control.[1731] If unknown, assume Screw – Load/Unload.

Air Compressor Type	ΔkW/CFM
Reciprocating – On/off Control	0.18
Reciprocating – Load/Unload	0.14
Screw – Load/Unload	0.15
Screw – Variable Displacement	0.15
Screw - VFD	0.18

Note: Dryers installed on inlet modulation compressors do not qualify for this measure.

kW_{Heater} = average power of heater per CFM of dryer (kW/CFM)[1732,1733]

[1728] Since this is a retrofit, the EUL is one-third of the dryer life which is 15 years (TRM 4.7.7). Focus on Energy Evaluation Business Programs: Measure Life Study, p. 91-92. PA Consulting Group. August 25, 2009.
[1729] Desiccant Air Dryer Control: Seeing Isn't Always Believing. Marshall, Ron.
[1730] Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.
[1731] Consistent with Air Nozzle measure, this assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See "Industrial System Standard Deemed Saving Analysis.xls".
[1732] Based on a review of data sheets from six manufacturers. These values reflect average heater kW and not nominal heater kW. The heater operation will vary based on moisture load to the dryer. See "IL TRM Desiccant Dryers – Supporting Information.xls" file for more detail.
[1733] The heater operation will be controlled by temperature to avoid overheating the desiccant media. Lessons Learned: Saving Energy Costs with Heated Blower Purge Desiccant Dryers, Marshall, Ron.

= 0.007 kW/CFM for heated models

= 0.013 kW/CFM for blower purge models

kW_{Blower} = average power of blower per CFM of dryer (kW/CFM)[1734]

= 0.000 kW/CFM for heated models

= 0.003 kW/CFM for blower purge models

HOU = compressor total hours of operation below depending on shift

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average[1735]	5,702

PRF = purge reduction factor

= Assume 50% for heatless desiccant dryers[1736]

= Assume 60% for externally-heated or heated blower purge desiccant dryers[1737]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$\Delta kW_{peak} = \Delta kWh \ / \ HOU \ * \ CF$

Where:

CF = summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average[1738]	0.89

FOSSIL FUEL SAVINGS

N/A

[1734] Based on a review of data sheets from six manufacturers. These values reflect average blower kW and not nominal blower kW. The blower operation will in many cases vary based on moisture load to the dryer. See "IL TRM Desiccant Dryers – Supporting Information.xls" file for more detail.

[1735] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

[1736] "For heatless desiccant dryers, the reduction in purge tends to be proportional only to the reduction of flow, not the reduction in moisture load due to the lower inlet temperatures." The 50% value is based on the TRM's assumption of a 50% dryer load factor used Illinois TRM Measure 4.7.5. Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers.

[1737] "But for heated style units, the dryer reacts to both reductions. This means some energy is saved due to flow reduction, and additional energy is saved due to the lower moisture load in the cooler inlet air, resulting in more energy savings when compared with heatless styles." Marshall, Ron. Lessons Learned: Saving Energy Costs with Heated Blower Desiccant Dryers.

[1738] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE CI-CPA-DPDC-V02-230101

REVIEW DEADLINE: 1/1/2030

4.7.9 Compressed Air Heat Recovery

DESCRIPTION

Air compressors are inherently inefficient, converting 80 to 93% of the electrical input energy into heat.[1739] Recovering this wasted heat for useful purposes is one method for reducing facility-level energy use. Typical air compressor heat recovery involves ducting air-cooled air compressor exhaust for space heat. Recovered heat can also be used for process heating, water heating, and boiler makeup water heating, but this workpaper only addresses the most common scenario.

This measure was developed to be applicable to the following program types: RF, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is an air-cooled air compressor that is ducted for heat recovery during the heating season. The ducting must include a thermostat that controls the heat recovery based on whether heating is needed.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an air-cooled air compressor whose exhaust is ducted to the outdoors or to a space where heat is not needed (e.g., compressor room, unoccupied space).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

15 years[1740]

DEEMED MEASURE COST

$80/hp[1741]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

$$\Delta\text{therms} = \eta_{HR} * 2{,}545 * hp * PP * Hours * CHF \,/\, 100{,}000 \,/\, \eta_{heat}$$

Where:

η_{HR} = Efficiency of heat recovery

[1739] Ron Marshall, William Scales, Gary Shafer, Paul Shaw, Paul Sheaffer, Rick Stasyshan, H.P. Improving Compressed Air System Performance: A Sourcebook for Industry v3. United States: N. p., 2016.

[1740] The 15-year measure life is based on the value for HVAC controls within the ComEd EUL research. The ductwork has an estimated 20-year measure life but is limited by the mechanical and thermostatic controls.

[1741] This estimate is based on three representative projects received through the Nicor Custom Program. The costs in these three projects were $73/hp, $76/hp, and $84/hp.

= 80%[1742]

2,545 = Conversion factor, Btu/hp-hr

hp = Nominal horsepower of the compressor

PP = Percent power at average load (% flow or capacity) conditions. See table below.
If average flow is unknown, assume 65%.[1743]
If compressor type is unknown, assume Load/No-load (1 gal/CFM).

= 93.5%

Avg. % Capacity	On/Off Control	Load/No-Load (1 gal/cfm)	Load/No-Load (10 gal/cfm)	Inlet Valve Modulation (w/o Blowdown)	Inlet Valve Modulation (w/ Blowdown)	Variable Displacement	VSD w/ Unloading	VSD w/ Stopping
0%	0%	27%	27%	71%	26%	25%	12%	0%
10%	10%	32%	35%	74%	40%	34%	20%	12%
20%	20%	63%	42%	76%	54%	44%	28%	24%
30%	30%	74%	52%	79%	62%	52%	36%	33%
40%	40%	81%	60%	82%	82%	61%	45%	41%
50%	50%	87%	68%	86%	86%	63%	53%	53%
60%	60%	92%	76%	88%	88%	69%	60%	60%
65%	**65%**	**94%**	**80%**	**90%**	**90%**	**73%**	**66%**	**66%**
70%	70%	95%	83%	92%	92%	77%	71%	71%
80%	80%	98%	89%	94%	94%	85%	80%	80%
90%	90%	100%	96%	97%	97%	91%	89%	89%
100%	100%	100%	100%	100%	100%	100%	100%	100%

Hours = Compressor hours of operation below depending on shift.
= Use actual hours if known, otherwise assume values in table below:

Shift	Hours
Single Shift	1,976
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average[1744]	5,702

CHF = Climate heating factor. This value represents the amount of time that the facility has a use for space heating. See table below for values.[1745]

[1742] Ron Marshall, William Scales, Gary Shafer, Paul Shaw, Paul Sheaffer, Rick Stasyshan, H.P. Improving Compressed Air System Performance: A Sourcebook for Industry v3. United States: N. p., 2016 (page 14).
[1743] The analysis of compressor load factors for the Illinois TRM's 4.7.1 VSD Air Compressor measure show an average load factor range of 63 – 65%. For more information, please see: "IL TRM VSD Air Compressor – Supporting Information.xls".
[1744] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.
[1745] These values reflect a ratio of the hours below a heating balance point over 8,760. The heating balance point is assumed to be 55°F. The data source is TMY3 data. See "Compressed Air Heat Recovery – Supporting Info" file for derivation.

Zone	Climate Heating Factor
1 - Rockford	58%
2 - Chicago	55%
3 - Springfield	48%
4 - Belleville	49%
5 - Marion	46%

100,000 = Conversion factor, Btu/therm

η_{heat} = Heating system efficiency

= If actual heating system efficiency is unknown, assume 80%[1746]

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE CI-CPA-CHR-V02-230101

REVIEW DEADLINE:1/1/2030

[1746] 80% is the federal minimum efficiency of gas-fired unit heaters. Unit heaters are a common heat source in industrial and manufacturing settings, where compressed air is likely to be in place.

4.7.10 Compressed Air Storage Receiver Tank

DESCRIPTION

Using an air receiver or storage tank will buffer the air demands of the system on the compressor, thus eliminating short cycling. Although a load/no-load compressor unloads in response to lowered demand, it does so over a period of time to prevent lubrication oil from foaming. Therefore, reducing the number of cycles reduces the number of transition times from load to no-load and saves energy.

To qualify for this measure an existing load/no-load compressor with a 1 gal/cfm storage ratio or a modulating w/ blowdown compressor must be replaced with a load/no-load compressor with an improved storage capacity and ratio.

This measure was developed to be applicable to the following program types: RF, NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is an oil-flooded load/no-load compressor with an improved storage capacity and ratio compared to the existing system. The cfm should reflect the rated capacity (in cfm) of all active compressors. If that value cannot be determined, compressor power can be converted to capacity using the rule-of-thumb of 4.5 cfm/hp.[1747]

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an oil-flooded load/no-load compressor with a 1 gal/cfm storage ratio or a modulating w/ blowdown compressor.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years

DEEMED MEASURE COST

Incremental cost ($) = 4.67 * ($Tank_E$ – $Tank_B$)[1748]

Where:

4.67 = air receiver tank size, in gallons, to equipment cost conversion factor

$Tank_E$ = efficient tank size (gallons)

$Tank_B$ = baseline tank size (gallons)

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

[1747] The 4.5 cfm/hp rule of thumb is based on a rotary screw compressor delivering 4 to 5 cfm per 1 hp, “Relationship Between Pressure and Flow”, Compressed Air System Best Practices, Industrial Utility Efficiency.
[1748] 2018 Vermont PUC: Technical Reference User Manual (TRM) Measure Savings Algorithms and Cost Assumptions

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = 0.9 \; x \; hp_{compressor} \; x \; Hours \; x \; (CF_b \; - \; CF_e)$$

Where:

ΔkWh = gross customer annual kWh savings for the measure

$hp_{compressor}$ = compressor motor nominal hp

0.9[1749] = compressor motor nominal hp to full load kW conversion factor

Hours = compressor total hours of operation below depending on shift

Shift	Hours	Description
Single shift (8/5)	1,976	7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952	7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928	24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8,320	24 hours per day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average[1750]	5,702	

CF_b = baseline compressor factor[1751]

= See table below for baseline compressor factor. If compressor type is unknown, default to a load/no-load compressor with 1 gallon/cfm for the appropriate-sized compressor.

Baseline Compressor	Compressor Factor (≤ 40 hp)[1752]	Compressor Factor (50 – 200 hp)[1753]
Modulating w/ blowdown	0.890	0.863
Load/No-Load w/ 1 gallon/cfm	0.909	0.887
Load/No-Load w/ 3 gallon/cfm	0.831	0.811
Load/No-Load w/ 4 gallon/cfm	0.812	0.792
Load/No-Load w/ 5 gallon/cfm	0.806	0.786

[1749] Conversion factor based on Survey of CAGI data sheets from 200 compressors. See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.

[1750] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

[1751] Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM.

[1752] Compressor factors were developed using DOE part load data for different compressor control types as well as load profiles from 50 facilities employing air compressors less than or equal to 40 hp, as sourced from the Efficiency Vermont TRM. See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.

[1753] Compressor factors for this size range were developed using DOE part-load data for different compressor control types as well as load profiles from 45 compressors and 20 facilities. This data comes from ComEd Custom and Industrial Systems programs. The compressors were filtered to reflect only rotary screw compressors, between 50 and 200 hp, and operating a

CF_e = efficient compressor factor

= See table above for load/no-load compressors with the adequate storage capacity installed. If unknown, default to load/no-load compressors w/ 4 gallons/cfm.

For example, a 1-shift facility with a 100-hp modulating (with blowdown) adds a 2,000-gallon receiver to their compressed air system. This improvement brings the system storage over 4 gallons/cfm.

Capacity Check: *= 2,000 gallons / (100 hp * 4.5 cfm/hp)*
= 4.4 gallons/cfm

ΔkWh = 0.9 * 100 * 1,976 * (0.863 – 0.792)
= 12,627 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$\Delta kW = \Delta kWh / Hours * CF$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
1-shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average[1754]	0.89

For example, a 1-shift facility with a 100-hp VSD modulating (with blowdown) compressor adds a 2,000-gallon receiver to their compressed air system. This improvement brings the system storage over 4 gallons per cfm.

Capacity Check: *= 2,000 gallons / (100 hp * 4.5 cfm/hp)*
= 4.4 gallons per cfm

ΔkW = 12,627 / 1,976 * 0.59
= 3.77 kW

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

minimum of 4 hour per day, Additionally, compressors with clear and consistent baseload profiles were excluded from this analysis. See "IL TRM VSD Air Compressor – Supporting Information.xls" for more information.

[1754] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-CASRT-V02-230101

REVIEW DEADLINE: 1/1/20230

4.7.11 Reduce Compressed Air Setpoint

DESCRIPTION

This measure characterizes the energy savings associated with reducing the compressed air pressure setpoint. A lower setpoint pressure results in the reduction of work requirements on the compressor resulting in energy savings. The energy savings assumptions are based on compressors operating at 100 psi.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment must meet the following requirements:

Compressor setpoint must be decreased
Specification and location of compressor must be known and verifiable

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an air compressor with a pressure setpoint higher than necessary (line pressure more than 115% of the highest end use requirement).

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 5 years.[1755]

DEEMED MEASURE COST

The incremental cost is assumed to be $0.

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta\text{kWh} = (kW_{typical} * \Delta P * SF * Hours / hp_{typical}) * hp_{real}$$

Where:

ΔkWh = gross customer annual kWh savings for the measure

$kW_{typical}$ = adjusted compressor power (kW) based on typical compressor loading and operating profile. Use actual compressor control type if known:

[1755] Based on value from ComEd Operational Efficiency CY2018 Impact Evaluation.

Control Type	$kW_{typical}$ [1756]
Reciprocating - On/off Control	70.2
Reciprocating - Load/Unload	74.8
Screw - Load/Unload	82.3
Screw - Inlet Modulation	82.5
Screw - Inlet Modulation w/ Unloading	82.5
Screw - Variable Displacement	73.2
Screw - VFD	70.8

= if the actual compressor control type is not known, use a weighted average based on the following market assumptions:

Control Type	Share %	$kW_{typical}$ [1757]
Market share estimation for load/unload control compressors	56%	74.8
Market share estimation for modulation w/unloading control compressors	27%	82.5
Market share estimation for variable displacement control compressors	17%	73.2
Weight average	-	76.6

ΔP = reduction in pressure differential between efficient and base case (psi)

= actual

SF = 1% reduction in power per 2 psi reduction in system pressure is equal to 0.5% reduction per 1 psi, or a Savings Factor of 0.005[1758]

HOURS = compressor total hours of operation below depending on shift

Shift	Hours	Description
Single shift (8/5)	1,976	7 AM – 3 PM, weekdays, minus some holidays and scheduled down time
2-shift (16/5)	3,952	7AM – 11 PM, weekdays, minus some holidays and scheduled down time
3-shift (24/5)	5,928	24 hours per day, weekdays, minus some holidays and scheduled down time
4-shift (24/7)	8,320	24 hours per day, 7 days a week minus some holidays and scheduled down time
Unknown / Weighted average[1759]	5,702	

$hp_{typical}$ = nominal hp for typical compressor

[1756] Consistent with 4.7.2 Compressed Air Low Pressure Drop Filters. See "Industrial System Standard Deemed Saving Analysis.xls".
[1757] Based on Tables 8.2.2 and 8.2.3 from Technical Support Document: Air Compressors. US Department of Energy. May, 2016.
[1758] "Optimizing Pneumatic Systems for Extra Savings," Compressed Air Best Practices, DOE Compressed Air Challenge, 2010.
[1759] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

= 100 hp[1760]

hp_{real} = total hp of real compressors distibuting air through filter. This should include the total horsepower of the compressors that normally run through the filter, but not backup compressors.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = $\Delta kWh \ / \ Hours \ * \ CF$

Where:

CF = Summer peak coincidence factor for this measure

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average[1761]	0.89

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-RCAS-V02-230101

REVIEW DEADLINE: 1/1/2030

[1760] Consistent with 4.7.2 Compressed Air Low Pressure Drop Filters. See "Industrial System Standard Deemed Saving Analysis.xls".

[1761] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

4.7.12 AODD Pump Controls

DESCRIPTION

Diaphragm pumps are widely used for their numerous advantages, such as simplicity, serviceability, and durability. These pumps can tolerate fluids that are corrosive, viscous, or contain a significant portion of entrained solids (E.g., effluent and slurries). Diaphragm pumps can be driven by compressed air or electric motors. Air-operated double diaphragm (AODD) pumps are estimated to be present in up to 85-90% of manufacturing plants in the US.[1762] The intrinsic simplicity of AODDs allow them to have significantly lower upfront material costs than electric motor-driven diaphragm pumps since there is no electric motor.

Typically, AODDs are operated at a fixed capacity and do not have a controller attached. In this scenario, the pump consumes compressed air continuously when operating. An electronic stroke controller can reduce the amount of air that the AODD pump consumes while operating. This controller synchronizes the compressed air release with the pump so that the diaphragm experiences a burst of air rather than a continuous stream. This reduces the air consumption and noise generation of the pump. This technology increases the pressure variance experienced by the pump; however, the overall impact on fluid flow is negligible.[1763]

Typically, this technology is limited to larger AODD pump sizes (≥ 2”), higher pressures (≥ 60 psig) and applications with longer operation times. This technology might not be applicable for systems with highly viscous fluids.

This measure was developed to be applicable to the following program types: RF, TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is an AODD pump with an electronic stroke optimizing control.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is an AODD pump operating at a fixed capacity.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years[1764]

DEEMED MEASURE COST

Total cost is $1,150. The material cost for this type of control is $950.[1765] Labor is $200, based on estimated time of 2 hours and $100 per hour rate.[1766]

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

[1762] Hank Van Ormer. “Study Proves Potential Energy Savings of AODD Pump Controls,” Compressed Air Best Practices. https://www.airbestpractices.com/system-assessments/end-uses/study-proves-potential-energy-savings-aodd-pump-controls

[1763] “Diaphragm Pump Controller Performance Project Report,” Purdue School of Engineering and Technology. January 12, 2015.

[1764] This is an estimated based on lifetimes of similar electronic controls. HVAC controls generally have a 15-year EUL but are typically in less demanding environments than industrial pumping applications (e.g., manufacturing, wastewater treatment, etc.). For this reason, a more conservative value of 10 years was selected.

[1765] MizAir.com. Accessed August 4, 2020. https://www.mizair.com/lp-miz

[1766] Engineering judgement.

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = CFM_{AODD} * kW_{Comp} * Hours * SF$$

Where:

CFM_{AODD} = Rated flow of the AODD (CFM). Use actual, if known.

If unknown, see below for guidance.[1767]

Nominal Pump Size	Pressure Air Rang (psig)	Range of Air Consumption (SCFM)	Default Air Consumption (SCFM)
2”	80 – 120 psig (average = 95 psig)	90 – 120	105
3” & 4”	90 – 110 psig (average = 100 psig)	125 - 150	138

kW_{Comp} = System power reduction per air demand (kW/CFM) depending on the type of air compressor found in table below.[1768]

Air Compressor Type	kW_{Comp} (kW/CFM)
Reciprocating – On/off Control	0.184
Reciprocating – Load/Unload	0.136
Screw – Load/Unload	0.152
Screw – Inlet Modulation	0.055
Screw – Inlet Modulation w/ Unloading	0.055
Screw – Variable Displacement	0.153
Screw – VFD	0.178

Or if compressor control type is unknown, then a weighted average based on market share can be used:[1769]

Control Type	Share %	kW / CFM
Market share estimation for load/unload controls compressors	40%	0.136
Market share estimation for modulation w/ unloading control compressors	40%	0.055
Market share estimation for variable displacement control compressors	20%	0.153
Unknown / Weighted average		0.107

Hours = Compressed air system pressurized hours

= Use actual hours if known, otherwise assume values in table below:

Shift	Hours
Single Shift	1,976

[1767] “Demand-Side Savings: Energy Efficiency in Optimizing Compressed Air,” Air Power USA. Page 8-46.

[1768] Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See “Industrial System Standard Deemed Saving Analysis.xls”

[1769] Table 8.2.3, Technical Support Document. US Department of Energy

Shift	Hours
Two Shifts	3,952
Three Shifts	5,928
Four Shifts or Continual Operation	8,320
Unknown / Weighted average[1770]	5,702

SF = Savings Factor, representing the reduction of compressed air consumed by the pump
= 35%[1771]

For example, a 2-inch AODD is outfitted with a stroke-optimizing control in a Screw – Load/Unload compressor
ΔkWh = 105 * 0.152 * 5,702 * 35%
= 31,851 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / Hours * CF$$

Where:

ΔkWh = As calculated above

CF = Summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average[1772]	0.89

For example, a 2-inch AODD is outfitted with a stroke-optimizing control in a Screw – Load/Unload compressor
ΔkW = 31,851 / 5,702 * 0.89
= 4.97 kW

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[1770] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules
[1771] This is the average value of several references, the strongest of which is a lab study that reports a savings range of 20% - 50%. "Diaphragm Pump Controller Performance Project Report," Purdue School of Engineering and Technology. January 12, 2015. For a full list of savings estimates, see the "IL TRM AODD Controls – Supporting Info.xls"
[1772] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules

MEASURE CODE: CI-CPA-AODD-V02-250101

REVIEW DEADLINE: 1/1/2028

4.7.13 Compressed Air Leak Repair

DESCRIPTION

This measure shows the energy savings potential associated with reducing compressed air losses and the repair of compressed air leaks. Compressed air leaks can be responsible for 20-30% of total air compressor output in a facility. This measure is applicable to compressed air systems in manufacturing environments where blow off, pneumatic tools and manufacturing processes of many varieties are used.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is the compressed air system with air leaks identified via a leak survey and leak tags, and then leaks repaired to minimize compressed air wastage.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing compressed air system with leaks.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 6.5 years for non-filter leak repairs and 1.5 years for leak repairs to filter equipment.[1773]

DEEMED MEASURE COST

The incremental cost is assumed to be $8 per horsepower[1774]

LOADSHAPE

Loadshape C35 - Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (TotalCFM * Hours * C_{aircomp} * Control\ factor / hp_{typical}) * hp_{real}$$

Where:

TotalCFM = $\sum_{leaks=1}^{N_{leaks}} CFM_{leaks}$

N_{leaks} = Number of leaks repaired

[1773] "Joint ComEd-Ameren Illinois Compressed Air Leak Repair Effective Useful Life Research Results Memo," Guidehouse, December 19, 2025, Section 6. Appendix – Screened 30-month dataset. Filter leak repairs are calculated based on the same methodology for the 40 leaks that were completed on filter equipment in the study. See: CompressedAirLeakRepair_EULworkbook for TRM Workpaper_05116.xlsx for additional information and calculations.

[1774] Engineering estimate from previous project cost data review and engineering judgment as obtained from Minnesota Technical Reference Manual Version 1.2, Industrial Compressed Air – Compressed Air Leak Detection

CFM_{leak} = CFM loss at each leak. Estimate based on either ultrasonic leak detection digital decibel readings (preferred) or via visual inspection as provided in the tables below:

Ultrasonic Leak Detection[1775]:

Digital Reading	System Air Pressure				
	100 PSIG	75 PSIG	50 PSIG	25 PSIG	10 PSIG
	Estimated CFM_{leaks}				
10 dB	0.5	0.3	0.2	0.1	0.05
20 dB	0.8	0.9	0.5	0.3	0.15
30 dB	1.4	1.1	0.8	0.5	0.4
40 dB	1.7	1.4	1.1	0.8	0.5
50 dB	2	2.8	2.2	2	1.9
60 dB	3.6	3	2.8	2.8	2.3
70 dB	5.2	4.9	3.9	3.4	3
80 dB	7.7	6.8	5.6	5.1	3.6
90 dB	8.4	7.7	7.1	6.8	5.3
100 dB	10.6	10	9.6	7.3	6

Visual Inspection[1776]:

Pressure (psig)	Leak Orifice Diameter (inches)					
	1/64	1/32	1/16	1/8	1/4	3/8
70	0.3	1.2	4.8	19.2	76.7	173
80	0.33	1.3	5.4	21.4	85.7	193
90	0.37	1.5	5.9	23.8	94.8	213
100	0.41	1.6	6.5	26	104	234
125	0.49	2	7.9	31.6	126	284

*Values in CFM

$C_{aircomp}$ = Compressor efficiency

= Actual, if unknown compressor type, use 0.19 kW/CFM[1777]

Type	$C_{aircomp}$ kW/CFM
Single-acting Reciprocating Air Compressor	0.23
Double-acting Reciprocating Air Compressor	0.155
Lubricant-injected Rotary Screw Compressor	0.185
Lubricant-free Rotary Screw Compressor	0.2
Centrifugal Compressor	0.18
Average/unknown	**0.19**

[1775] UE Systems, Inc. ELMA Ultraprobe Manual 'Compressed Air Ultrasonic Leak Detection Guide', Guess-timator Cart for UP9000/10,000, page 7.

[1776] Leakage rates(cfm) for different supply pressures and approximately equivalent orifice sizes obtained from Energy Tips – Minimize Compressed Air Leaks Minimize Compressed Air Leaks; Industrial Technologies Program (ITP) Compressed Air Tip Sheet #3 (Fact Sheet) (energy.gov)

[1777] Compressed Air Challenge "Fundamentals of Compressed Air Systems" Pg 28-32

Hours = Compressor hours of operation below depending on shift:

Shift	Hours	Description
Single shift (8/5)	1,976	7 AM – 3 PM, weekdays, minus three-weekday holidays and 10 days of scheduled down time
2-shift (16/5)	3,952	7AM – 11 PM, weekdays, minus three-weekday holidays and 10 days of scheduled down time
3-shift (24/5)	5,928	24 hours per day, weekdays, minus three-weekday holidays and 10 days of scheduled down time
4-shift (24/7)	8,320	24 hours per day, 7 days a week minus three-week day holidays and 10 days of scheduled down time
Unknown / Weighted average	5,702	

Control factor = Efficiency Factors per control type for air compressors from table below. If unknown control type, use 0.3 (%kW/%load)[1778]

Control Type	Control factor (%kW/%load)
Inlet Valve Modulated	0.31
Variable Displacement	0.69
Variable Speed Drive	0.85

$hp_{typical}$ = nominal horsepower of a typical air compressor

= 100 hp[1779]

hp_{real} = total hp of real compressors. This should include the total horsepower of the compressors that normally run through the filter, but not backup compressors

= Actual

For example, a repair of a 500hp system running 3 shifts at 100psig. Unknown control type that fixes 10 leaks that are 1/32" in size would save the following:

ΔkWh = (TotalCFM * Hours * $C_{aircomp}$ * Control Factor / $hp_{typical}$) * hp_{real}

= ((10 * 1.6) * 5,928 * 0.19 * 0.3 / 100) * 500

= 27,032 kWh

For example, using ultrasonic leak detection on a 500 hp, 100 psi, 3 shift system with VSD controls with unknown compressor type finding 5 leaks at 30 decibels:

ΔkWh = (TotalCFM * Hours * $C_{aircomp}$ * Control Factor / $hp_{typical}$) * hp_{real}

= ((5 * 1.4) * 5,928 * 0.19 * 0.85 / 100) * 500

= 33,508 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh \; / \; Hours \;) \; * \; CF$$

[1778] Compressed Air Challenge "Fundamentals of Compressed Air Systems" Pg 90-91

[1779] Consistent with 4.7.2 Compressed Air Low Pressure Drop Filters. See "Industrial System Standard Deemed Saving Analysis.xls".

Where,

CF = Summer peak coincidence factor, see table below

Shift	Coincidence Factor
Single shift (8/5)	0.59
2-shift (16/5)	0.95
3-shift (24/5)	0.95
4-shift (24/7)	0.95
Unknown / Weighted average[1780]	**0.89**

For example, a repair of a 500hp system running 3 shifts at 100psig that fixes 10 leaks that are 1/8" in size would save the following:

ΔkW = (ΔkWh / Hours) * CF

= (27,032 / 5,928) * 0.95

= 4.332 kW

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-CPA-CALR-V04-270101

REVIEW DEADLINE: 1/1/2029

[1780] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

4.7.14 Compressed Air Tool Replacement

DESCRIPTION

The measure applies to the replacement of pneumatic tools driven by a compressed air system. Replacement tools will be direct electric (corded or cordless) equivalent tools. The replacement electric tool will perform the same function at the same output as the baseline pneumatic tool.

This measure was developed to be applicable to the following program types: TOS and NC. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is defined as a new direct-electric drive tool.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is defined as a pneumatic tool driven by compressed air generated by a central compressed air system. Examples include: impact wrenches, drills, shears, screwdrivers, grinders, sanders, nailers, ratchets, linear actuators, or pumps.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 8 years.[1781]

DEEMED MEASURE COST

The incremental cost is the actual cost of the new tool.

LOADSHAPE

Loadshape C35 – Industrial Process

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is dependent on the industrial shift and corresponding hours of operation. Values are provided for each shift type in the variable definition section.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = ((CATool_{CFM} * kW_{CFM}) - ETool_{kW}) * Hours * Usage$$

Where:

$CATool_{CFM}$ = CFM draw of the existing pneumatic tool

= Actual. Rated or measured

kW_{CFM} = System power reduction per reduced air demand (kW/CFM) depending on the type of compressor control:

System Power Reduction per Reduced Air Demand:[1782]

Control Type	kW / CFM
Reciprocating - On/off Control	0.184
Reciprocating - Load/Unload	0.136
Screw - Load/Unload	0.152

[1781] Based on online product review.

[1782] Calculated based on the type of compressor control. This assumes the compressor will be between 40% and 100% capacity before and after the changes to the system demand. See "Industrial System Standard Deemed Saving Analysis.xls".

Control Type	kW / CFM
Screw - Inlet Modulation	0.055
Screw - Inlet Modulation w/ Unloading	0.055
Screw - Variable Displacement	0.153
Screw - VFD	0.178

$ETool_{kW}$ = kW consumed by new electric-driven tool

= Actual rated

Hours = Compressed air system pressurized hours, depending on shift. If unknown, use weighted average. This value is the weighted average of facility owner responses from the DOE evaluation of the Compressed Air Challenge. Facility owners with compressed air systems were surveyed detailing the number of shifts their facilities operated.

Shift	Shift	Hours	Distribution of Facilities by Hours of Operation[1783]	Weighted Hours
Single Shift	7 AM – 3 PM, weekdays, minus some holidays and scheduled down time	1,976	16%	316
Two Shift	7AM – 11 PM, weekdays, minus some holidays and scheduled down time	3,952	23%	909
Three Shift	24 hours per day, weekdays, minus some holidays and scheduled down time	5,928	25%	1,482
Four Shifts or Continual Operation	24 hours per day, 7 days a week minus some holidays and scheduled down time	8,320	36%	2,995
			Total Weighted Average:	5,702

Usage = The percentage of time the tool is being actively used during the time the compressed air system is pressurized

= Actual. Value is a percentage

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh \; / \; Hours \; * \; CF$$

Where:

ΔkWh = As calculated above.

CF = Summer peak coincidence factor

Shift	Coincidence Factor
Single Shift	0.59
Two Shifts	0.95
Three Shifts	0.95
Four Shifts or Continual Operation	0.95
Unknown / Weighted average[1784]	0.89

[1783] DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

[1784] Weighting of 16% single shift, 23% two shift, 25% three shift and 36% continual based on DOE evaluation of the Compressed Air Challenge, section 2.1.5 Facility Operating Schedules.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION
N/A

MEASURE CODE: CI-CPA-CATR-V01-270101

REVIEW DEADLINE: 1/1/2028

4.8.Shell End Use

4.8.1 Roof Insulation for C&I Facilities

DESCRIPTION

Energy and demand savings are realized through reductions in the building cooling and heating loads by way of improvements in roof assembly thermal resistance properties. This measure was developed to be applicable to the following program types: RF and NC.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a roof assembly with thermal resistance that exceeds code requirements and should be determined by the program.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition in retrofit scenarios is the thermal resistance of the existing roof assembly.

The baseline for new construction scenarios is the thermal resistance of the roof assembly as mandated by applicable building code. Assembly R-values shall be referenced from IECC 2015 or ASHRAE – 90.1 – 2013, or IECC 2018 or ASHRAE 90.1-2016, IECC 2021, or IECC 2024 depending on the IECC in effect on the date of the building permit (if unknown assume IECC 2024).

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure expected useful life (EUL) is assumed to be 20 years per DEER 2008. This is consistent with SDG&E's 9th Year Measure Retrofit Study (1996 & 1997 Residential Weatherization Programs), CPUC's Energy Efficiency Policy Manual v.2, and GDS's Measure Life Report Residential and Commercial/Industrial Lighting and HVAC Measures (June 2007).

DEEMED MEASURE COST

Costs can be highly variable due to differences in building type and structural assemblies and therefore actual costs should be used when possible. Absent of actual cost information, estimated costs should be used. If unknown the following defaults can be used:

Insulation Material	Cost per sq ft[1785]		
	Material	Labor	Total
R30 Unfaced Fiberglass Batts	$1.59	$1.00	$2.59
R30 Blown Cellulose	$0.28	$0.41	$0.69

LOADSHAPE

Loadshape C03: Commercial Cooling

Loadshape C04 - Commercial Electric Heating

Loadshape C05 - Commercial Electric Heating and Cooling

[1785] Costs are estimated from RS Means, Release Year 2026, Quarter 2, with labor rates an average of the 5 climate zones.

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1786]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1787]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Electric energy savings is calculated as the sum of energy saved when cooling the building and energy saved when heating the building

$$\Delta kWh = \Delta kWh_cooling + \Delta kWh_heating$$

If central cooling, the electric energy saved in annual cooling due to the added insulation is

$$\Delta kWh_cooling = ((1/R_existing) - (1/R_new)) * Area * EFLH_{cooling} * \Delta T_{FL,cooling} / 1{,}000 / \eta_cooling$$

Where:

R_existing = Roof assembly heat loss coefficient with existing (or code required) insulation [(hr-^{o}F-ft^2)/Btu]

= In retrofit scenarios, actual existing conditions prior to retrofit should be used. If unavailable, default values by building type can be used, as outlined in the following table and adopted from Ohio Energy Technical Reference Manual and expanded to cover all type of commercial buildings in the state of Illinois. In new construction scenarios, the applicable code requirements, per the following tables, should be used.

For retrofits, the R-value for the entire assembly:

Building Type	Retrofit Assembly R-Value
Assembly	13.5
Assisted Living	13.5
College	13.5
Convenience Store	13.5
Elementary School	13.5
Garage	13.5
Grocery	13.5
Healthcare Clinic	13.5
High School	13.5
Hospital	13.5
Hotel/Motel	13.5
Manufacturing Facility	12.0

[1786] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1787] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Building Type	Retrofit Assembly R-Value
MF - High Rise	13.5
MF - Mid Rise	13.5
Movie Theater	13.5
Office - High Rise	13.5
Office - Low Rise	13.5
Office - Mid Rise	13.5
Religious Building	13.5
Restaurant	13.5
Retail - Department Store	13.5
Retail - Strip Mall	13.5
Warehouse	12.0
Unknown	13.5

R-Values: ASHRAE – 90.1 – 2013 and 2016

	IL TRM Zones 1, 2, & 3 [ASHRAE/IECC Climate Zone 5 (A, B, C)]			
	Nonresidential		Semiheated	
	Assembly Maximum	Insulation Min. R-Value	Assembly Maximum	Insulation Min. R-Value
Insulation Entirely Above Deck	0.032	R-30.0 c.i.	0.063	R-15 c.i.
Metal Building (Roof)	0.037	R-19 + R-11 Ls or R-25 + R-8 Ls	0.082	R-19
Attic and Other	0.021	R-49	0.034	R-30

	IL TRM Zones 4 & 5 [ASHRAE/IECC Climate Zone 4 (A, B, C)]			
	Nonresidential		Semiheated	
	Assembly Maximum	Insulation Min. R-Value	Assembly Maximum	Insulation Min. R-Value
Insulation Entirely Above Deck	0.032	R-30.0 c.i.	0.093	R-10 c.i.
Metal Building (Roof)	0.037	R-19 + R-11 Ls or R-25 + R-8 Ls	0.082	R-19
Attic and Other	0.021	R-49	0.034	R-30

Table Notes

c.i. = continuous insulation

Ls = linear system, a continuous vapor barrier liner installed below the purlins and uninterrupted by framing members

R_new = Roof assembly heat loss coefficienty with new insulation [(hr-^{o}F-ft^{2})/Btu]

Area = Area of the roof surface in square feet.

$EFLH_{cooling}$ = Equivalent Full Load Hours for Cooling [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,cooling}$ = Temperature difference [^{o}F] during cooling season between design day outdoor air temperature (T_{DD}) and assumed 55^{o}F base temperature

Climate Zone (City based upon)	$T_{DD,,cooling}$ [°F][1788]	$\Delta T_{FL,cooling}$ [°F]
1 (Rockford)	90.9	35.9
2 (Chicago)	91.3	36.3
3 (Springfield)	92.6	37.6
4 (Belleville)	95.2	40.2
5 (Marion)	94.4	39.4

1,000 = Conversion from Btu to kBtu

η_cooling = Efficiency of cooling equipment * Distribution Efficiency. Actual, if known and assume 95% distribution efficiency for central cooling with ducts. If unknown, assume 11.1 SEER2.[1789]

If the building is heated with electric heat (resistance or heat pump), the electric energy saved in annual heating due to the added insulation is

$$\Delta kWh_heating = [(1/R_existing) - (1/R_new)] * Area * EFLH_{heating} * \Delta T_{FL,heating} / 3{,}412 / \eta_heating$$

Where:

$EFLH_{heating}$ = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,heating}$ = Temperature difference [^{o}F] during heating season between design day outdoor air temperature and assumed 55^{o}F heating base temperature

Climate Zone (City based upon)	$T_{DD,heating}$ [°F][1790]	$\Delta T_{FL,heating}$ [°F]
1 (Rockford)	-5.4	60.4
2 (Chicago)	-1.0	56.0
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

3,142 = Conversion from Btu to kWh.

η_heating = Efficiency of heating system. Use actual efficiency. If not available refer to default table below.

[1788] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

[1789] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER value converted to SEER2 by multiplying by 0.95, multiplied by 0.95 distribution efficiency.

[1790] Weather Station Data, 96.6% Heating DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95 (Distribution efficiency)
Heat Pump	7.37[1791]	2.05
Resistance	N/A	1

If the building is heated with a gas furnace, there will be some electric savings in heating the building attributed to extra insulation since the furnace fans will run less.

$$\Delta kWh_heating = \Delta Therms * Fe * 29.3$$

Where:

ΔTherms = Gas savings calculated with equation below.

Fe = Percentage of heating energy consumed by fans, assume 7.7%[1792]

29.3 = Conversion from therms to kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh_cooling / EFLH_cooling) * CF$$

Where:

$EFLH_{cooling}$ = Equivalent full load hours of air conditioning in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1793]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1794]

FOSSIL FUEL SAVINGS

If building uses a gas furnace, the savings resulting from the insulation is calculated using the following formula.

$$\Delta Therms = ((1/R_existing) - (1/R_new)) * Area * EFLH_{heating} * \Delta T_{FL,heating} / 100{,}000 / \eta_heat$$

Where:

R_existing = Roof assembly heat loss coefficient with existing (or code required) insulation [(hr-^{o}F-ft^2)/Btu], per guidance outlined in Electric Energy Savings section.

R_new = Roof assembly heat loss coefficient with new insulation [(hr-^{o}F-ft^2)/Btu]

[1791] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.

[1792] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[1793] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1794] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Area = Area of the roof surface in square feet. Assume 1000 sq ft for planning.

$EFLH_{heating}$ = Equivalent Full Load Hours for Heating in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,heating}$ = Temperature difference [^oF] during heating season between design day outdoor air temperature and assumed 55^oF heating base temperature (see above)

100,000 = Conversion from BTUs to Therms

η_heat = Efficiency of heating system * 95% (distribution efficiency)

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1795]

System Type	Efficiency[1796]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-RINS-V11-270101

REVIEW DEADLINE: 1/1/2029

[1795] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1796] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

4.8.2 Spring-Loaded Garage Door Hinge

DESCRIPTION

Existing overhead doors often close loosely at the perimeter weather strips and between panels. Conditioned air escapes through these gaps, leading to energy loss. Spring-loaded hinges create tension and reduce gaps at the perimeter and between panels. The product is applicable for small-commercial and residential sectors, but the savings estimated by this measure apply only to small-commercial applications. This measure applies to sites where the inside area of the garage is conditioned during the heating season by natural gas.

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified as a custom measure.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment consists of a heavy-duty spring-loaded hinge installed in place of a standard hinge on a garage overhead door. The number of hinges per project may vary depending on the door type, size, and number of panels. The efficient condition is an air sealed garage door with no gaps around the perimeter or between panels.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a garage door with a 1/8-inch gap between the door and the weather-stripping around the perimeter of the door. The bottom of the door is assumed sealed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.[1797]

DEEMED MEASURE COST

Incremental costs equal installed cost and will vary based on the number of hinges required per door. Based on information provided by the manufacturer to Nicor Gas, average material cost is $126 per garage door and installation cost is $63 per garage door for a total installed cost of $189 per garage door. The typical garage door is assumed to have 4 panels and 9 total hinges.

LOADSHAPE

Loadshape C04 - Commercial Electric Heating

COINCIDENCE FACTOR

Savings relate to heating only so coincidence factor is assumed to be 0.

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings are calculated based on a reduction in airflow rate associated with decreased infiltration across the leakage area. The algorithm below for change in cubic feet per minute, ΔCFM, is modeled after equation 48 in Chapter 16: Ventilation and infiltration of the 2017 ASHRAE Handbook—Fundamentals.

ELECTRIC ENERGY AND FOSSIL FUEL SAVINGS

$$\Delta kWh = \Delta HeatLoad / COP_{heat} / Conv_{kWh} * EFLH_H$$

$$\Delta Therms = \Delta HeatLoad / Eff_{heat} / Conv_{BTU} * EFLH_H$$

$$\Delta HeatLoad = \Delta CFM * Conv_{min} * Density_{air} * SpecificHeat_{air} * \Delta T$$

[1797] Public Service Commission of Wisconsin, "Evaluation – Business Program: Measure Life Study," Focus on Energy (2009): page 1-4, Table 1-2 Recommended Measure Life by WISeerts Group Description for Building Shell Equip or Tech measure type, accessed March 26, 2019, https://focusonenergy.com/sites/default/files/bpmeasurelifestudyfinal_evaluationreport.pdf.

$$\Delta CFM = A_l * [(C_s * \Delta T) + (C_w * W_s^2)]^{0.5}$$

Where:

A_l = Leakage area, estimated at 51 (in^2), of air gap before retrofit.[1798]

C_s = Stack coefficient, 0.0299 ($cfm^2/in^4 * °F$), adjustment based on airflow at average building height.[1799]

C_w = Wind coefficient, 0.0086 ($cfm^2/in^4 * mph^2$), adjustment based on airflow at average building height and wind shelter classification.[1800]

ΔT = Average temperature difference between outside air temperature (OAT) during the heating season[1801] and assumed indoor heating temperature setpoint 70°F;[1802] see table below.

W_s = Average wind speed (mph) during heating season, see table below.

Climate Zone	Average OAT, Heating (°F)	Average Delta T, Heating (°F)	Average heating Season Wind Speed (mph) [1803]
1 (Rockford)	32	38	10
2 (Chicago)	34	36	10
3 (Springfield)	35	35	10
4 (Belleville)	36	34	9
5 (Marion)	39	31	7

$Conv_{min}$ = Conversion from minutes to hours, 60 minutes/hour.

$Density_{air}$ = The density of air, 0.08 (lb/ft^3) at 1 atmosphere pressure and approximately 30-40°F.[1804]

$SpecificHeat_{air}$ = Specific heat of air, 0.24 (BTU/lb) at 1 atmosphere pressure and 32°F.[1805]

COP_{heat} = COP of electric heating system

= If heat pump, assume 2.5 for New Construction and 2.05 for existing buildings[1806]

[1798] Leakage area is estimated based on average door size of installations previously completed in Wisconsin and reported in the Wisconsin Focus on Energy Technical Reference Manual. Average door size is 10 ft x 12 ft, with a side and top perimeter equal to 1 top * (10 ft * 12 in/1 ft) + 2 sides* (12 ft * 12 in/1ft) = 408 in. At 1/8 in perimeter gap, the leakage area is 408 in * 1/8 in = 51 in^2.

[1799] 2017 ASHRAE Handbook—Fundamentals, 16.24, Table 4 "Basic Model Stack Coefficient C_s", assumed average building height of 16 feet, two-story.

[1800] 2017 ASHRAE Handbook—Fundamentals, 16.24, Table 6 "Basic Model Wind Coefficient C_w", assumed average building height of 16 feet and shelter class 3: "Typical shelter caused by other buildings across street from building under study."

[1801] DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL, for the average outdoor temperature when the heating system is expected to be operating.

[1802] Energy Center of Wisconsin, "Baseline Building Energy Models – Nonresidential Heating Thermostat Setpoint," ComEd Portfolio Modeling Report (July 2010): page 6.

[1803] DOE Weather Data, TMY3 (Typical Meteorological Year), developed by NREL, for the average wind speed when the heating system is expected to be operating, defined as hours where the average temperature is lower than 55°F.

[1804] Engineering ToolBox, (2003). Air - Density, Specific Weight and Thermal Expansion Coefficient at Varying Temperature and Constant Pressures. [online] Available at: https://www.engineeringtoolbox.com/air-density-specific-weight-d_600.html [Accessed March 2019].

[1805] Engineering ToolBox, (2004). Air - Specific Heat at Constant Pressure and Varying Temperature. [online] Available at: https://www.engineeringtoolbox.com/air-specific-heat-capacity-d_705.html [Accessed March 2019].

[1806] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85. Effective COP estimated as 7.37/3.413 * 0.95 (to estimate distribution losses).

= 1.0 if electric resistance heating

Eff_{heat} = Efficiency of heating system * 95% (distribution efficiency)

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1807]

System Type	Efficiency[1808]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

$Conv_{\text{kWh}}$ = Conversion from BTUs to kWh

= 3,412 BTU/kWh

$Conv_{Therms}$ = Conversion from BTUs to therms

$=$ 100,000 BTU/therm.

$EFLH_H$ =Equivalent Full Load Heating Hours in Existing Buildings or New Construction are listed in section 4.4 HVAC End Use.

Savings for all climate zones and selected building types are presented in the following tables:

Annual kWh Savings Existing Buildings, Heat Pump					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	1,054.4	1,014.9	909.3	822.7	668.5
Garage	443.8	401.0	346.3	249.3	212.9
Grocery	1,209.5	1,146.2	1,039.2	956.6	782.8
High School	814.9	726.3	720.5	686.7	536.1
Hospital - Unknown	660.2	620.2	543.9	460.2	369.5
Manufacturing Facility_Miscellaneous	424.8	406.9	353.2	291.2	218.0
Manufacturing Facility_Food/Chemical	491.1	456.1	390.9	328.9	259.4
Office - Low Rise	662.9	633.3	546.8	452.3	345.6
Retail - Strip Mall	608.4	580.7	510.2	411.2	311.4
Warehouse Nonrefrigerated	517.3	478.4	414.4	356.6	281.5
Warehouse Refrigerated	258.0	229.7	207.0	151.8	108.5

[1807] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1808] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

Annual kWh Savings Existing Buildings, Electric Resistance					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	2,161.4	2,080.6	1,864.0	1,686.6	1,370.4
Garage	909.7	822.1	709.8	511.1	436.4
Grocery	2,479.5	2,349.7	2,130.3	1,961.0	1,604.7
High School	1,670.5	1,488.9	1,477.1	1,407.7	1,098.9
Hospital - Unknown	1,353.4	1,271.5	1,115.1	943.3	757.4
Manufacturing Facility_Miscellaneous	870.9	834.1	724.0	596.9	446.9
Manufacturing Facility_Food/Chemical	1,006.8	935.1	801.4	674.3	531.8
Office - Low Rise	1,359.0	1,298.2	1,120.9	927.2	708.5
Retail - Strip Mall	1,247.1	1,190.4	1,046.0	842.9	638.4
Warehouse Nonrefrigerated	1,060.4	980.8	849.6	731.0	577.1
Warehouse Refrigerated	528.8	471.0	424.4	311.1	222.5

Annual kWh Savings New Construction, Heat Pump					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	864.6	832.2	745.6	674.6	548.2
Garage	363.9	328.8	283.9	204.4	174.5
Grocery	991.8	939.9	852.1	784.4	641.9
High School	668.2	595.5	590.8	563.1	439.6
Hospital - Unknown	541.4	508.6	446.0	377.3	303.0
Manufacturing Facility_Miscellaneous	348.3	333.7	289.6	238.8	178.8
Manufacturing Facility_Food/Chemical	402.7	374.0	320.5	269.7	212.7
Office - Low Rise	543.6	519.3	448.4	370.9	283.4
Retail - Strip Mall	498.9	476.2	418.4	337.2	255.4
Warehouse Nonrefrigerated	424.2	392.3	339.8	292.4	230.8
Warehouse Refrigerated	211.5	188.4	169.8	124.4	89.0

Annual kWh Savings New Construction, Electric Resistance					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	2,009.8	1,947.8	1,716.7	1,559.4	1,220.4
Garage	909.7	822.1	709.8	511.1	436.4
Grocery	3,061.9	2,933.7	2,645.4	2,482.0	2,007.0
High School	1,757.4	1,521.6	1,543.6	1,657.5	1,231.6
Hospital - Unknown	1,108.5	1,065.3	933.7	768.6	608.7
Manufacturing Facility_Miscellaneous	534.4	714.2	494.3	452.9	345.9
Manufacturing Facility_Food/Chemical	709.1	668.5	569.2	375.5	296.3
Office - Low Rise	590.7	541.7	475.2	377.8	279.5
Retail - Strip Mall	726.6	685.8	592.5	469.0	388.0
Warehouse Nonrefrigerated	953.1	891.1	815.5	705.8	565.3
Warehouse Refrigerated	495.5	468.4	408.6	318.0	234.9

Annual Therm Savings Existing Buildings					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	89.9	86.6	77.6	70.2	57.0
Garage	37.9	34.2	29.5	21.3	18.2
Grocery	103.2	97.8	88.6	81.6	66.8
High School	69.5	62.0	61.5	58.6	45.7
Hospital - Unknown	56.3	52.9	46.4	39.3	31.5
Manufacturing Facility_Miscellaneous	36.2	34.7	30.1	24.8	18.6
Manufacturing Facility_Food/Chemical	41.9	38.9	33.3	28.1	22.1
Office - Low Rise	56.5	54.0	46.6	38.6	29.5
Retail - Strip Mall	51.9	49.5	43.5	35.1	26.6
Warehouse Nonrefrigerated	44.1	40.8	35.4	30.4	24.0
Warehouse Refrigerated	22.0	19.6	17.7	12.9	9.3

Annual Therm Savings New Construction					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	83.6	81.0	71.4	64.9	50.8
Garage	37.9	34.2	29.5	21.3	18.2
Grocery	127.4	122.1	110.1	103.3	83.5
High School	73.1	63.3	64.2	69.0	51.2
Hospital - Unknown	46.1	44.3	38.8	32.0	25.3
Manufacturing Facility_Miscellaneous	22.2	29.7	20.6	18.8	14.4
Manufacturing Facility_Food/Chemical	29.5	27.8	23.7	15.6	12.3
Office - Low Rise	24.6	22.5	19.8	15.7	11.6
Retail - Strip Mall	30.2	28.5	24.7	19.5	16.1
Warehouse Nonrefrigerated	39.7	37.1	33.9	29.4	23.5
Warehouse Refrigerated	20.6	19.5	17.0	13.2	9.8

Savings for all climate zones and selected building types per linear foot (dividing by 34 linear ft) are presented in the following tables:

Annual kWh Savings per Linear Foot Existing Buildings, Heat Pump					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	31.0	29.9	26.7	24.2	19.7
Garage	13.1	11.8	10.2	7.3	6.3
Grocery	35.6	33.7	30.6	28.1	23.0
High School	24.0	21.4	21.2	20.2	15.8
Hospital - Unknown	19.4	18.2	16.0	13.5	10.9
Manufacturing Facility_Miscellaneous	12.5	12.0	10.4	8.6	6.4
Manufacturing Facility_Food/Chemical	14.4	13.4	11.5	9.7	7.6

Annual kWh Savings per Linear Foot Existing Buildings, Heat Pump					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Office - Low Rise	19.5	18.6	16.1	13.3	10.2
Retail - Strip Mall	17.9	17.1	15.0	12.1	9.2
Warehouse Nonrefrigerated	15.2	14.1	12.2	10.5	8.3
Warehouse Refrigerated	7.6	6.8	6.1	4.5	3.2

Annual kWh Savings per Linear Foot Existing Buildings, Electric Resistance					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	63.6	61.2	54.8	49.6	40.3
Garage	26.8	24.2	20.9	15.0	12.8
Grocery	72.9	69.1	62.7	57.7	47.2
High School	49.1	43.8	43.4	41.4	32.3
Hospital - Unknown	39.8	37.4	32.8	27.7	22.3
Manufacturing Facility_Miscellaneous	25.6	24.5	21.3	17.6	13.1
Manufacturing Facility_Food/Chemical	29.6	27.5	23.6	19.8	15.6
Office - Low Rise	40.0	38.2	33.0	27.3	20.8
Retail - Strip Mall	36.7	35.0	30.8	24.8	18.8
Warehouse Nonrefrigerated	31.2	28.8	25.0	21.5	17.0
Warehouse Refrigerated	15.6	13.9	12.5	9.2	6.5

Annual kWh Savings per Linear Foot New Construction, Heat Pump					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	25.4	24.5	21.9	19.8	16.1
Garage	10.7	9.7	8.4	6.0	5.1
Grocery	29.2	27.6	25.1	23.1	18.9
High School	19.7	17.5	17.4	16.6	12.9
Hospital - Unknown	15.9	15.0	13.1	11.1	8.9
Manufacturing Facility_Miscellaneous	10.2	9.8	8.5	7.0	5.3
Manufacturing Facility_Food/Chemical	11.8	11.0	9.4	7.9	6.3
Office - Low Rise	16.0	15.3	13.2	10.9	8.3
Retail - Strip Mall	14.7	14.0	12.3	9.9	7.5
Warehouse Nonrefrigerated	12.5	11.5	10.0	8.6	6.8
Warehouse Refrigerated	6.2	5.5	5.0	3.7	2.6

Annual kWh Savings per Linear Foot New Construction, Electric Resistance					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	59.1	57.3	50.5	45.9	35.9
Garage	26.8	24.2	20.9	15.0	12.8
Grocery	90.1	86.3	77.8	73.0	59.0

Annual kWh Savings per Linear Foot New Construction, Electric Resistance					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
High School	51.7	44.8	45.4	48.7	36.2
Hospital - Unknown	32.6	31.3	27.5	22.6	17.9
Manufacturing Facility_Miscellaneous	15.7	21.0	14.5	13.3	10.2
Manufacturing Facility_Food/Chemical	20.9	19.7	16.7	11.0	8.7
Office - Low Rise	17.4	15.9	14.0	11.1	8.2
Retail - Strip Mall	21.4	20.2	17.4	13.8	11.4
Warehouse Nonrefrigerated	28.0	26.2	24.0	20.8	16.6
Warehouse Refrigerated	14.6	13.8	12.0	9.4	6.9

Annual Therm Savings per Linear Foot Existing Buildings					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	2.6	2.5	2.3	2.1	1.7
Garage	1.1	1.0	0.9	0.6	0.5
Grocery	3.0	2.9	2.6	2.4	2.0
High School	2.0	1.8	1.8	1.7	1.3
Hospital - Unknown	1.7	1.6	1.4	1.2	0.9
Manufacturing Facility_Miscellaneous	1.1	1.0	0.9	0.7	0.5
Manufacturing Facility_Food/Chemical	1.2	1.1	1.0	0.8	0.7
Office - Low Rise	1.7	1.6	1.4	1.1	0.9
Retail - Strip Mall	1.5	1.5	1.3	1.0	0.8
Warehouse Nonrefrigerated	1.3	1.2	1.0	0.9	0.7
Warehouse Refrigerated	0.6	0.6	0.5	0.4	0.3

Annual Therm Savings per Linear Foot New Construction					
Building Type	Zone 1 (Rockford)	Zone 2 (Chicago)	Zone 3 (Springfield)	Zone 4 (Belleville)	Zone 5 (Marion)
Convenience Store	2.5	2.4	2.1	1.9	1.5
Garage	1.1	1.0	0.9	0.6	0.5
Grocery	3.7	3.6	3.2	3.0	2.5
High School	2.2	1.9	1.9	2.0	1.5
Hospital - Unknown	1.4	1.3	1.1	0.9	0.7
Manufacturing Facility_Miscellaneous	0.7	0.9	0.6	0.6	0.4
Manufacturing Facility_Food/Chemical	0.9	0.8	0.7	0.5	0.4
Office - Low Rise	0.7	0.7	0.6	0.5	0.3
Retail - Strip Mall	0.9	0.8	0.7	0.6	0.5
Warehouse Nonrefrigerated	1.2	1.1	1.0	0.9	0.7
Warehouse Refrigerated	0.6	0.6	0.5	0.4	0.3

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A, electric savings is for space heating that only occurs during the winter.

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-SLDH-V04-270101

REVIEW DEADLINE: 1/1/2030

4.8.3 Commercial Weather Stripping

DESCRIPTION

Note- this measure provides a prescriptive approach for commercial door sweeps. A more comprehensive approach that requires a number of additional inputs for both this and a number of other commercial air sealing opportunities is provided in measure 4.8.4 C&I Air Sealing.

Entrance/exit doors installed for a commercial or industrial buildings often leave clearance gaps to allow for proper operation. The gaps around the doors allow unconditioned air to infiltrate the building due to wind force, internal building stack affect, and other temperature differentials, thus adding to the cooling and heating loads of an HVAC system. Sweeps and other weatherstripping applications are designed to close these gaps, while still allowing proper operation. They are installed along the bottom, head, and jambs of exterior doors to prevent air infiltration from adding to the HVAC load.

This measure was developed to be applicable to the following program types: RF, DI. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

There are a variety of types of materials used as door sweeps and weather stripping, including nylon bristles, felt, vinyl, open or closed-cell foam, and EPDM rubber. Their effectiveness is assumed to be the same when properly installed.

DEFINITION OF BASELINE EQUIPMENT

This measure shall apply to the exterior doors on commercial buildings that are not sealed from the outside environment (i.e., interior vestibule doors would be ineligible) with visible gaps of at least 1/8 inches and up to 3/4 inches along any outside edge of the door. The space on the interior of the door must be conditioned and/or heated, and the calculation methodology will use standard efficiencies of 1.0 kW/ton for cooling and 80% for heating. Electric resistance heating and electric heat pump systems will use coefficients of performance (COPs) of 1.0 and 3.3, respectively.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life (EUL) is 10 years.[1809]

DEEMED MEASURE COST

Costs for this measure should be determined by actual quotes obtained from manufacturers and estimated labor. If not available, it is estimated based on brush weather strips cost of $8/LF with labor and other direct costs of installation costing $4/LF with the total coming to $12.00/LF.[1810]

LOADSHAPE

Loadshape C03 - Commercial Cooling

Loadshape C04 - Commercial Electric Heating

Loadshape C05 - Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1811]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

[1809] Assumed lower than residential due to likely significantly higher door usage.

[1810] Deemed costs reflect typical online pricing, evaluated in 5/2026.

[1811] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

= 47.8% [1812]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (\Delta kWhCool_{weatherstrip} + \Delta kWhHeat_{weatherstrip}) * Length$$

Where:

$\Delta kWhCool_{weatherstrip}$ = Annual cooling kWh savings from installation of door sweep per linear foot[1813]

Climate Zone (City based upon)	$\Delta kWhCool_{weatherstrip}$ per linear ft
1 (Rockford)	0.33
2 (Chicago)	0.36
3 (Springfield)	0.63
4 (Belleville)	0.59
5 (Marion)	0.70

$\Delta kWhHeat_{weatherstrip}$ = Annual heating kWh savings from installation of door sweep per linear foot[1814]

Climate Zone (City based upon)	$\Delta kWh_{weatherstrip}$ per linear ft	
	Electric Resistance	Heat Pump
1 (Rockford)	89.4	44.7
2 (Chicago)	78.6	39.3
3 (Springfield)	69.2	34.6
4 (Belleville)	59.9	29.9
5 (Marion)	48.0	24.0

Length = Linear feet of door weatherstripping installed

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWhCool_{weatherstrip} * Length) / EFLH_{cooling} * CF$$

Where:

$EFLH_{cooling}$ = Equivalent full load hours of air conditioning in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

[1812] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1813] Savings are based on lab test results performed by CLEAResult, assuming an 1/8"gap. See 'Commercial Weather Stripping IL_TRM_Workpaper v1.2'. Following discussion with the TAC it was determined that due to concerns over engineering algorithms overclaiming savings, 50% of the savings for the 1/8"gap are deemed appropriate.

[1814] Converts the Therm value to kWh and incorporates the relative COP efficiencies (assumed 0.78 for gas heat, 1 for electric resistance and 2.0 for heat pumps).

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1815]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1816]

FOSSIL FUEL SAVINGS

ΔTherms = $\Delta Therms_{weatherstrip} * Length$

Where:

$\Delta Therms_{weatherstrip}$ = Annual therm savings from installation of door sweep per linear foot[1817]

Climate Zone (City based upon)	$\Delta Therms_{weatherstrip}$ per linear ft
1 (Rockford)	3.91
2 (Chicago)	3.44
3 (Springfield)	3.03
4 (Belleville)	2.62
5 (Marion)	2.1

Length = Linear feet of door weatherstripping installed

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

NA

DEEMED O&M COST ADJUSTMENT CALCULATION

NA

MEASURE CODE: CI-SHL-WTST-V03-270101

REVIEW DEADLINE: 1/1/2031

[1815] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1816] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1817] Savings are based on lab test results performed by CLEAResult, assuming an 1/8"gap. See 'Commercial Weather Stripping IL_TRM_Workpaper v1.2'. Following discussion with the TAC it was determined that due to concerns over engineering algorithms overclaiming savings, 50% of the savings for 1/8"gap are deemed appropriate. This provides a savings assumption that is similar to the prescriptive Residential door sweep measure in 5.6.1 Air Sealing (assuming 3 ft doorsweep).

4.8.4 C&I Air Sealing

DESCRIPTION

Note- this measure provides a comprehensive approach for various commercial air sealing opportunities. A prescriptive approach for door sweeps only is provided in measure 4.8.16 C&I Weather Stripping.

This Air Sealing Measure incorporates a wide variety of products and procedures that reduce unwanted uncontrolled outdoor air infiltration into commercial or industrial buildings. Unwanted outdoor air causes significant increases in both heating and cooling costs throughout most of the year, and causes unwanted introduction of dust and odors into the building. This outdoor air infiltration is caused by both wind blowing against one or more sides of the building, and also through thermal stack effects in tall buildings that cause infiltration on lower floors and exfiltration on upper floors.

This measure applies to all existing commercial and industrial buildings that utilize mechanical heating and/or cooling to maintain occupant comfort. Identifying the exact length and width of cracks and holes in a building is difficult to do accurately. Similarly, conducting a building pressurization test using multiple blower doors or programming the air handling equipment to pressurize a building is also impractical in most situations. Therefore, this measure's savings calculations are instead based primarily on deemed values of air leakage reduction per unit length or unit area of air sealing retrofits installed.[1818] [1818] If a blower door or air handler pressurization and measurement test can be done both before and after air sealing, the amount of air cfm reduction, adjusted to 50 pascals of pressure differential, may be directly inserted into the 'Annual Avg infiltration CFM Saved' value to determine annual energy savings.

This measure was developed to be applicable to the following program types: RF

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Air sealing materials and diagnostic testing should meet all eligibility program qualification criteria. If applicable, the initial and final tested leakage rates should be performed in such a manner that the identified reductions can be properly discerned, particularly in situations wherein multiple building envelope measures may be implemented simultaneously.

DEFINITION OF BASELINE EQUIPMENT

The baseline condition of a building upon first inspection significantly impacts the opportunity for cost-effective energy savings through air-sealing.

If applicable and feasible, the existing air leakage rate for an existing building may be determined through approved and appropriate test methods using either blower doors or air handling units programmed to pressurize the building. Outdoor air flow quantities and simultaneous measurements of building differential pressure (inside vs outside) must be measured using approved methods and adjusted to values at 50 pascals differential.

Alternatively, if actual leakage rates cannot be measured, air leakage savings may be deemed using quantities of air leakage lengths or quantities based on inspection of the building. Lengths of cracks to be filled, quantities of leaky doors or windows to be sealed, etc. are documented and prescriptive, deemed savings rates are used to estimate savings.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.[1819]

[1818] ASHRAE, 2001 AHSRAE Handbook – Fundamentals, Chapter 26, Table 1. Effective Air Leakage Areas (Low-Rise Residential Applications Only).

[1819] As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.

MEASURE COST

Use actual cost of air sealing measures installed, if available. If actual costs are unknown, use estimated costs from table below multiplied by the number of units of each application installed:

Technology	Application	Unit Definition	Unit Cost Estimate[1820]
Weather Stripping	Single Door - Weather Stripping, Sweep	Enter Number of Doors Retrofitted	$47
	Double Doors - Weather Stripping	Enter Number of Double Door Sets Retrofitted	$209
	Casement Window - Weather Stripping	Enter Lin. Ft. of Crack Retrofitted	$6
	Double Horizontal Slider, Wood - Weather Stripping	Enter Lin. Ft. of Crack Retrofitted	$6
	Double-Hung - Weather Stripping	Enter Lin. Ft. of Crack Retrofitted	$6
	Double-Hung, with Storm Window - Weather Stripping	Enter Lin. Ft. of Crack Retrofitted	$6
	Roof-Wall Intersection, Block Seal	Enter Lin. Ft. of Crack Retrofitted	$13
	Roof-Wall Intersection, Seal Paint	Enter Lin. Ft. of Crack Retrofitted	$29
	Roof-Wall Intersection, Seal	Enter Lin. Ft. of Crack Retrofitted	$8
	Piping/Plumbing/Wiring Penetrations - Sealing	Enter Number of Penetrations Retrofitted	$63
Caulking	Caulking, External Block	Enter Lin. Ft. of Crack Retrofitted	$15
	Caulking, Internal Seal	Enter Lin. Ft. of Crack Retrofitted	$8
Attic Sealing	Attic Bypass Air Sealing, Block, Seal	Each	$486
	Attic Bypass Air Sealing, Seal	Each	$314
	Retrofit Existing Attic Hatch	Each	$281
Gasket	Exterior Wall Outlet Penetrations - Gasket	Enter Number of Outlets Retrofitted	$6
Avg Caulking / Weather Stripping	Average Window/Door Caulking / Weather Stripping	Enter Lin. Ft. of Crack Retrofitted	$13

LOADSHAPE

Loadshape C01 – Commercial Electric Cooling

Loadshape C03 – Commercial Cooling

Loadshape C04 – Commercial Electric Heating

Loadshape C05 – Commercial Electric Heating and Cooling

Loadshape C23 – Commercial Ventilation

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's

[1820] Typical project costs from quotation for large commercial air sealing project in Northeast (site: Concord, NH). All unit prices taken from BE Retrofit quote, October 2021, and inflated to 2027$.

capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1821]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1822]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

ΔkWh = $\Delta kWh_cooling + \Delta kWh_heatingElectric + \Delta kWh_heatingFurnace$

ΔkWh_cooling = If building is cooled, reduction in annual cooling requirement due to air sealing

=$1.08 * Infiltration_CFM_Saved * EFLH_{cooling} * \Delta T_{FL,cooling}/(1000 * \eta Cool * \%Cool)$

ΔkWh_heatingElectric = if building is electrically heated, reduction in annual heating requirement due to air sealing

=$1.08 * Infiltration_CFM_Saved * EFLH_{heating} * \Delta T_{FL,heating}/(\eta Heat * 3{,}412 * \%ElectricHeat$

ΔkWh_heatingGas = If gas furnace or gas boiler heat, kWh savings for reduction in combustion fan run time

= $\Delta Therms * Fe * 29.3$

Where:

1.08 = Specific heat of air x density of inlet air @ 70F x 60 min/hr in BTU/hr-F-CFM

Infiltration_CFM_Saved = Annual average CFM of outdoor air infiltration reduced due to air sealing measures implemented

= Calculated EITHER by sum of applicable values from table below multiplied by the quantities of each item implemented[1823]

Technology	Application	Delta CFM50 per Unit	Unit Definition
Weather Stripping	Single Door - Weather Stripping	25.500	Enter Number of Doors Retrofitted
	Double Doors - Weather Stripping	0.730	Enter Sq. Ft. of Both Doors Retrofitted
	Casement Window - Weather Stripping	0.360	Enter Lin. Ft. of Crack Retrofitted
	Double Horizontal Slider, Wood - Weather Stripping	0.473	Enter Lin. Ft. of Crack Retrofitted
	Double-Hung - Weather Stripping	1.618	Enter Lin. Ft. of Crack Retrofitted

[1821] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1822] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.
[1823] ASHRAE, 2001 AHSRAE Handbook – Fundamentals, Chapter 26, Table 1. Effective Air Leakage Areas (Low-Rise Residential Applications Only).

Technology	Application	Delta CFM50 per Unit	Unit Definition
	Double-Hung, with Storm Window - Weather Stripping	0.164	Enter Lin. Ft. of Crack Retrofitted
	Average Caulking Weatherstripping	0.639	Enter Lin. Ft. of Crack Retrofitted
	Piping/Plumbing/Wiring Penetrations - Sealing	10.900	Enter Number of Penetrations Retrofitted
Caulking	Window Framing, Masonry - Caulking	1.364	Enter Sq. Ft. of Windows Retrofitted
	Window Framing, Wood - Caulking	0.382	Enter Sq. Ft. of Windows Retrofitted
	Door Frame, Masonry - Caulking	1.018	Enter Sq. Ft. of Doors Retrofitted
	Door Frame, Wood - Caulking	0.364	Enter Sq. Ft. of Doors Retrofitted
	Average Window/Door - Caulking	0.689	Enter Lin. Ft. of Crack Retrofitted
Avg Caulking / Weather Stripping	Average Window/Door Caulking / Weather Stripping	0.664	Enter Lin. Ft. of Crack Retrofitted
Gasket	Electrical Outlets - Gasket	6.491	Enter Number of Outlets Retrofitted

OR if blower door or total building pressurization measurements have been conducted, by determining the CFM infiltration differential between the existing and efficient building air infiltration rates:

= CFM50_existing - CFM50_efficient

Where:

CFM50_existing = CFM of Infiltration measured by blower door or by total building pressurization test before air sealing, adjusting measured CFM to equivalent CFM at 50 pascals indoor/outdoor pressure differential[1824]

CFM50_efficient = Infiltration as measured by blower door or total building pressurization text after air sealing, adjusted to equivalent CFM at 50 pascals pressure differential

$EFLH_{cooling}$ = Equivalent Full Load Hours for Cooling [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,cooling}$ = Temperature difference [^{o}F] during cooling season between design day outdoor air temperature (T_{DD}) and assumed 55^{o}F base temperature

Climate Zone (City based upon)	$T_{DD,,cooling}$ [°F][1825]	$\Delta T_{FL,cooling}$ [°F]
1 (Rockford)	90.9	35.9
2 (Chicago)	91.3	36.3
3 (Springfield)	92.6	37.6
4 (Belleville)	95.2	40.2
5 (Marion)	94.4	39.4

1000 = Conversion of watts to kW

[1824] 50 Pascals has been established in TRM XXX as the standard building pressure differential for determining average annual infiltration rates; 50 Pascals differential is equivalent to a wind pressure from approximately 10 mph.

[1825] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

ηCool = Efficiency of cooling equipment * distribution efficiency. Actual and assume 95% distribution efficiency for central cooling with ducts. If unknown assume:[1826]

Space Cooling Source	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling Source	10.2	11.1

%Cool = Percentage of the building that is cooled

$EFLH_{heating}$ = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,heating}$ = Temperature difference [^{o}F] during heating season between design day outdoor air temperature and assumed 55^{o}F heating base temperature

Climate Zone (City based upon)	$T_{DD,heating}$ [°F][1827]	$\Delta T_{FL,heating}$ [°F]
1 (Rockford)	-5.4	60.4
2 (Chicago)	-1.0	56.0
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

ηHeat = Efficiency of heating equipment * distribution efficiency. Actual, if possible and assume 95% distribution efficiency. Alternatively, as deemed from table below:

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95 (Distribution Efficiency)
Heat Pump	7.37[1828]	2.05
Resistance	N/A	1

3,412 = Number of BTUs per kWh

%ElectricHeat = % of building heated by electricity

Fe = Furnace Fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1829]

29.3 = kWh per therm

[1826] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95 and multiplied by 0.95 distribution efficiency.
[1827] Weather Station Data, 96.6% Heating DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.
[1828] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.
[1829] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

For example, assuming air conditioned and electric resistance heated mid rise office building with 10 IEER equipment in Rockford: Infiltration_CFM_Saved = 272.8; ηCool = 10.0; %Cool = 100%, ηHeat = 1.0; %ElectricHeat = 100%, then

ΔkWh_Cooling = 1.08 * 272.8 * 1128 * 35.9 / 1000 / 10 * 100%

= 1,193 kWh of cooling energy saved

ΔkWh_Heating = 1.08 * 272.8 * 1,672 * 60.4 / 1.0 / 3,412 * 100%

= 8,720 kWh of cooling energy saved

ΔkWh = ΔkWh_cooling + ΔkWh_heatingElectric + ΔkWh_heatingFurnace

= 1,193 + 8,720 + 0

= 9,913 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh_cooling \; / \; EFLH_{cooling} \; * \; CF$$

Where:

ΔkWh_cooling = Sum of kWh saved from cooling from above calculations

$EFLH_{cooling}$ = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1830]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1831]

For example, for an mid rise office in Rockford with air conditioning as defined earlier in this section; assuming: = ΔkWh_cooling = 1200; EFLH = 834; CF_{SSP} = 0.913, then

ΔkW = 1193 / 1135 * 0.913

= 0.96 kW

FOSSIL FUEL SAVINGS

If Fossil Fuel heating:

$$\Delta Therms = 1.08 * Infiltration_CFM_Saved * EFLH_{heating} * \Delta T_{FL,heating} / \eta Heat / 100{,}000 * \%FossilHeat$$

Where:

ηHeat = Efficiency of heating system * 95% (distribution efficiency)

[1830] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1831] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1832]

System Type	Efficiency[1833]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

100,000 = BTUs per therm

%FossilHeat = % of building heated by fossil fuel

For Example, assuming for a mid rise office in Rockford with unknown natural gas heat: Infiltration_CFM_Saved =272.8; HDD55/yr = 2284; ηHeat = 0.80; %GasHeat = 100%, then

$$\Delta \text{ Therms} = 1.08 * 272.8 * 1672 * 60.4 / 0.80 / 100000 * 100\%$$

$$= 372 \text{ Therms}$$

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-CAIR-V06-270101

REVIEW DEADLINE: 1/1/2031

[1832] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1833] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

4.8.5 High Speed Overhead Doors

DESCRIPTION

This measure applies to buildings with exterior entryways that utilize overhead doors between heated and/or air conditioned spaces and the outdoors that see a high amount of traffic on a daily basis. High speed doors for refrigerated spaces are covered in section 4.6.10 of the TRM. All other high speed door applications, such as conventional foot-traffic entryways, require custom analysis.

The use of overhead doors within exterior entryways during the heating season leads to the exfiltration of warm air from the upper portion of the door opening and the infiltration of colder air from the lower portion of the door opening. This results in increased heating energy use to compensate for heat losses every time a door is opened. By reducing the time it takes for the door to open and close, high speed doors can also enhance the physical comfort of employees or customers near the entryway as there will be reduced temperature fluctuations when the door is opened and closed. In addition, in some cases excess heating capacity may be installed in buildings to meet this larger heating load. The addition of high speed doors to exterior entryways that currently utilize standard overhead doors will result in energy savings and enhanced personal comfort, and also possibly in reduced equipment sizing and associated costs.

The primary markets for this measure are commercial and industrial facilities with overhead doors in exterior entryways, including but not limited to the following building types: manufacturing, warehouse (non-refrigerated), vehicle maintenance facilities, and enclosed/heated commercial or multifamily parking garages.

This measure was developed to be applicable to the following program types: NC, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure the installed equipment must be a High Speed Door installed at a loading dock or drive-in door for a heated and/or cooled warehouse, manufacturing, service garage, or similar space. Heating can be gas fired or electric heat pump. Doors which have a refrigerated space on the interior should use measure 4.6.10 for High Speed Rollup Doors. Doors separating interior spaces with different temperature setpoints on either side are not eligible.

High speed doors must have a minimum opening speed of 32 inches per second and a minimum closing speed of 24 inches per second[1834].

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a standard overhead door, which is generally estimated to have an opening and closing speed of around 8 inches per second[1835]. The doorway should not have any type of existing open-doorway protection such as strip curtains or air curtains.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 16 years.[1836]

DEEMED MEASURE COST

The incremental measure cost is $105/sqft.[1837]

[1834] DASMA Standard 403-2020, "Specification for High Speed Doors and Grilles", DASMA Standard (2020): Section 2.6.
[1835] Wendt, Jeff, "When a High-Speed Door is More Energy Efficient", Door & Access Systems Magazine – Tech Tips. September 2014.
[1836] Assumed same measure life as high speed rollup doors for refrigerated spaces (4.6.10); As recommended in Navigant 'ComEd Effective Useful Life Research Report', May 2018.
[1837] The incremental cost is derived from analysis of a set of PG NSG custom project data, and based on equipment quotes in 2021.

LOADSHAPE

Heating Season: If electric heating, use Commercial Electric Heating Loadshape: C04. Otherwise, N/A

Cooling Season: Commercial Cooling Loadshape C03. Or, if applicable, use Commercial Electric Heating and Cooling Loadshape C05.

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1838]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1839]

Algorithm

CALCULATION OF ENERGY SAVINGS

The following formulas provide a methodology for estimating cooling load (kWh) and heating load (therm) savings associated with the installation of a high speed overhead door on exterior entryways such as a single door or loading bay. This algorithm is based on the assumption that savings are directly related to the difference in cooling or heating losses due to infiltration or exfiltration through an entryway before and after the installation of the high speed door. Energy savings are assumed to be the result of a reduction of natural infiltration effects due to wind and thermal forces and follow the calculation methodology outlined by the ASHRAE Handbook.[1840]

This algorithm allows either actual inputs or provides estimates if actual data is not available. All weather dependent values are derived from TMY3 data for the closest weather station to those locations defined elsewhere in the Illinois TRM (which are based on 30 year climate normals). If TMY3 weather station data was not available for the data used in the Illinois TRM, the next closest weather station was used. It is assumed that weather variations are negligible between the weather stations located within the same region. This approach was followed as the high speed door algorithm has a number of weather dependent variables, which are all calculated in relation to the heating season or cooling season as defined by the balance point temperature deemed appropriate for the facility. All weather dependent data is based on TMY3 data and is listed in tables by both climate zone and balance point temperature, which is then normalized to the Illinois TRM climate zoned HDD/CDD definitions unless otherwise noted.

ELECTRIC ENERGY SAVINGS

ΔkWhcooling = $(Q \ / \ EER2) \ * \ (t_{standard} \ - \ t_{fast}) \ * \ CD$

ΔkWhHPheating = $(Q \ / \ HSPF2) \ * \ (t_{standard} \ - \ t_{fast}) \ * \ HD$

Where:

Q = rate of total heat transfer through the open entryway (kBtu/hr)

(see calculation in 'Heat Transfer Through Open Entryway' section below)

EER2 = energy efficiency ratio of the cooling equipment (kBtu/kWh) * Distribution Efficiency

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2024 if through new construction) to assume values based on code estimates, and assume 95% distribution efficiency.

[1838] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1839] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.
[1840] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): Ch 16.1 - 16.37.

Note: IECC 2024 became effective November 30, 2025 and is the baseline for all New Construction permits from that date.

$t_{standard}$ = average hours per day the standard speed door is open (hr/day)

(see calculation in 'Time door is open' section below)

t_{fast} = average hours per day the high speed door is open (hr/day)

(see calculation in 'Time door is open' section below)

CD = cooling days per year, total days in year above balance point temperature (day)

= use table below to select the best value for location:[1841]

	CD (Balance Point Temperature)				
Climate Zone -Weather Station/City	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	194	168	148	124	97
2 - Chicago O'Hare AP / Chicago	194	173	153	127	95
3 - Springfield #2 / Springfield	214	194	174	148	114
4 - Belleville SIU RSCH / Belleville	258	229	208	174	138
5 - Carbondale Southern IL AP / Marion	222	201	181	158	130

HSPF2 = Heating System Performance Factor of heat pump equipment * Distribution Efficiency

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2024 if through new construction) to assume values based on code estimates, and assume 95% distribution efficiency.

Note: IECC 2024 became effective November 30, 2025 and is the baseline for all New Construction permits from that date.

HD = heating days per year, total days in year above balance point temperature (day)

= use table below to select an appropriate value:[1842]

	HD				
Climate Zone Weather Station/City	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

Time Door is Open

$t_{standard}$ $= CyclesPerDay * [Hd * 12 * (1 / Speed_{open_standard} + 1 / Speed_{close_standard})] / 3600$

[1841] National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL. Note that cooling days (CD) are calculated by first determining its value from the TMY3 data associated with the appropriate weather station as defined by and used elsewhere in the Illinois TRM. Using the TMY3 outdoor air dry bulb hourly data, the annual hours are totaled for every hour that the outdoor air dry bulb temperature is above a designated zero heat loss balance point temperature or base temperature for cooling. For commercial and industrial (C&I) buildings, a base temperature for heating of 55 oF is designated in the Illinois TRM, but building specific base temperatures are recommended for large C&I projects. Additionally, the TRM uses a 30-year normal data for degree-days while the CD calculation was based on TMY3 data; in order to account for this, calculations of CD were also normalized by the ratio of CDD to align the calculated values more closely with the TRM.

[1842] Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

t_{fast} = $CyclesPerDay * [Hd * 12 * (1 / Speed_{open_fast} + 1 / Speed_{close_fast})] / 3600$

Where:

CyclesPerDay = the number of door opening and closing cycles per day

= Actual. If unknown, use 75[1843] or for parking garages calculate based on the number of parking spaces[1844].

H_d = the height of the doorway (ft)

= user input

12 = unit conversion from feet to inches

$Speed_{open}$ = the speed (inches/second) at which the door opens

= Actual. If unknown, use 32 inches/second for high speed[1845], use 8 inches/second for standard speed[1846]

$Speed_{close}$ = the speed (inches/second) at which the door closes

= Actual. If unknown, use 24 inches/second for high speed[1847], = 8 inches/second for standard speed[1848]

3600 = unit conversion from seconds to hours

Heat Transfer Through Open Entryway (Cooling Season)

Q = $4.5 * CFM_{tot} * (h_{oc} - h_{ic}) / (1{,}000\ Btu/kBtu)$

Where:

4.5 = unit conversion factor with density of air: 60 min/hr * 0.075 lbm/ft^3 (lb*min/(ft*hr))

CFM_{tot} = Total air flow through entryway (cfm), see calculation below

h_{oc} = average enthalpy of outside air during the cooling season (Btu/lb)

= use the below table to determine the approximate outdoor air enthalpy associated with an indoor temperature setpoint and climate zone.[1849]

	h_{oc}		
Climate Zone -Weather Station/City	**67 °F**	**72 °F**	**77 °F**
1 - Rockford AP / Rockford	31.6	33.0	35.3
2 - Chicago O'Hare AP / Chicago	32.0	33.6	35.4
3 - Springfield #2 / Springfield	32.9	34.6	36.6
4 - Belleville SIU RSCH / Belleville	33.5	35.0	36.4
5 - Carbondale Southern IL AP / Marion	34.6	36.2	37.7

[1843] Wendt, Jeff, "When a High-Speed Door is More Energy Efficient", Door & Access Systems Magazine – Tech Tips. Sept. 2014.
[1844] ASHRAE, "Enclosed Vehicular Facilities – Parking Garages," in 2019 ASHRAE Handbook – HVAC Applications (2019): p. 16.18 to 16.20. Number of cars operating is 3-5% (use 4% as average) per hour of the total vehicle capacity, making openings per day = 4% * number of parking spaces * 24 hours per day * 2 (car will enter and leave once per day).
[1845] DASMA Standard 403-2020, "Specification for High Speed Doors and Grilles", DASMA Standard (2020): Section 2.6.
[1846] Wendt, Jeff, "When a High-Speed Door is More Energy Efficient", Door & Access Systems Magazine – Tech Tips. Sept. 2014.
[1847] DASMA Standard 403-2020, "Specification for High Speed Doors and Grilles", DASMA Standard (2020): Section 2.6.
[1848] Wendt, Jeff, "When a High-Speed Door is More Energy Efficient", Door & Access Systems Magazine – Tech Tips. Sept. 2014.
[1849] Average enthalpies were estimated following ASHRAE guidelines for perfect gas relationships for dry air associated with hourly TMY3 data. Enthalpies were then averaged for all values associated with a dry-bulb outdoor air temperature that exceeded the indoor air temperature setpoint. Other enthalpy values may be interpolated for indoor air temperature setpoints not represented in the table. Note that while outdoor air enthalpies increase with higher temperature setpoints, the change in enthalpy from indoor to outdoor will decrease.

h_{ic} = average enthalpy of indoor air, cooling season (Btu/lb)

= use the below table to determine the approximate indoor air enthalpy associated with an indoor temperature setpoint in indoor relative humidity.

	h_{ic}		
Relative Humidity (%)	**67 °F**	**72 °F**	**77 °F**
60	25.5	28.5	31.8
50	23.9	26.6	29.5
40	22.3	24.7	27.3

= an estimate 26.6 Btu/lb associated with the 72 °F and 50% indoor relative humidity case can be used as an approximation if no other data is available. For other indoor temperature setpoints and RH, enthalpies may be interpolated.

The total airflow through the entryway, CFM_{tot}, includes both infiltration due to wind as well as thermal forces, as follows:

CFM_{tot} = $sqrt[\ (CFM_w)^2\ +\ (CFM_t{}^2)\ ]$

Where:

CFM_w = Infiltration due to the wind (cfm)

CFM_t = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

CFM_w = $(v_{wc}\ *\ C_{wc})*\ C_v\ *\ A_d\ *\ (88\ fpm/mph)$

Where:

v_{wc} = average wind speed during the cooling season based on entryway orientation (mph)

= use the below table to for the wind speed effects based on climate zone and entryway orientation:[1850]

	Entryway Orientation				
Climate Zone -Weather Station /City	**N**	**E**	**S**	**W**	**Unknown (average)**
1 - Rockford AP / Rockford	4.2	4.1	4.7	4.8	4.5
2 - Chicago O'Hare AP / Chicago	4.7	4.5	5.4	4.6	4.8
3 - Springfield #2 / Springfield	4.1	3.7	6.0	5.0	4.7
4 - Belleville SIU RSCH / Belleville	3.3	2.7	3.8	4.2	3.5
5 - Carbondale Southern IL AP / Marion	3.1	2.9	4.4	3.8	3.6

C_{wc} = wind speed correction factor due to wind direction in cooling season (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the cooling season prevailing winds can be expected to impact the

[1850] Average wind speeds are calculated based on the TMY3 wind speed data. Because this data is collected at an altitude of 33 ft, wind speed is approximated for a 5 ft level based on ASHRAE Handbook guidelines using the urban/suburban parameters for adjusting wind speed based on altitude (Layer thickness (ft) δ = 1200, Exponent a = 0.22).
ASHRAE, "Airflow Around Buildings," in 2013 ASHRAE Handbook – Fundamentals (2013): p 24.3.

entryway. Use the following table to determine the correct wind speed correction factor for cooling applications.

	Entryway Orientation				
Climate Zone -Weather Station/City	N	E	S	W	Unknown (Average)
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31	0.23
2 - Chicago O'Hare AP / Chicago	0.18	0.17	0.36	0.26	0.24
3 - Springfield #2 / Springfield	0.17	0.12	0.46	0.21	0.24
4 - Belleville SIU RSCH / Belleville	0.21	0.15	0.35	0.16	0.22
5 - Carbondale Southern IL AP / Marion	0.18	0.15	0.37	0.11	0.20

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

C_v = effectiveness of openings,

= 0.3, assumes diagonal wind[1851]

A_d = area of the doorway (ft^2)

= user defined

The infiltration due to thermal forces is calculated as follows:

$CFM_t = A_d * C_{dc} * (60\ sec/min) * sqrt[2 * g * H_d/2 * (T_{oc} - T_{ic}) / (459.7 + T_{oc})]$

Where:

C_{dc} = the discharge coefficient during the cooling season[1852]

$= 0.4 + 0.0025 * |T_{ic} - T_{oc}|$

Note, values for C_{dc} show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value of 0.42 at indoor air temp of 72°F may be used as a simplification.

g = acceleration due to gravity

= 32.2 ft/sec^2

T_{ic} = Average indoor air temperature during cooling season

= User input, can assume indoor cooling temperature set-point

T_{oc} = Average outdoor temp during cooling season (°F)

= the average outdoor temperature is dependent on the CD period and zone. As such, the following table may be used for average outdoor temperature during the cooling period:[1853]

	T_{oc}				
Climate Zone Weather Station/City	62 °F	67 °F	72 °F	77 °F	82 °F
1 - Rockford AP / Rockford	72.9	76.0	79.2	82.5	85.5
2 - Chicago O'Hare AP / Chicago	72.9	76.0	79.4	82.8	85.5
3 - Springfield #2 / Springfield	73.7	76.7	79.9	83.4	86.4
4 - Belleville SIU RSCH / Belleville	74.9	77.7	81.0	84.3	86.9
5 - Carbondale Southern IL AP / Marion	75.1	77.7	80.9	84.7	87.4

[1851] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

[1852] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13.

[1853] Based on binned data from TMY3 & adjusted bracketed thermostat setpoint temperatures. Interpolate other values as needed.

459.7 = conversion factor from °F to °R

= calculation requires absolute temperature for values not calculated as a difference of temperatures.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (\Delta kWh_{cooling} / (CD * 24)) * CF$$

Where:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1854]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1855]

FOSSIL FUEL SAVINGS

Natural gas savings, Δtherms, associated with reduced infiltration through an entryway during the heating season are calculated by determining the difference between heat loss through the entryway before and after the installation of the high speed overhead door.

$$\Delta therms = Q * (t_{standard} - t_{fast}) * HD / \eta Heat$$

Where:

Q = rate of sensible heat transfer through the open entryway, before air curtain (therm/hr)

$t_{standard}$ = average hours per day the standard speed door is open (hr/day)

(see calculation in 'Time door is open' heading of Electric Energy Savings section)

t_{fast} = average hours per day the high speed door is open (hr/day)

(see calculation in 'Time door is open' heading of Electric Energy Savings section)

HD = heating days per year, total days in year above balance point temperature (day)

= use table below to select an appropriate value:[1856]

	HD				
Climate Zone - Weather Station/City	**45 °F**	**50 °F**	**55 °F**	**60 °F**	**65 °F**
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

ηHeat = Efficiency of heating system * 95% (distribution efficiency)

[1854] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1855] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

[1856] Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1857]

System Type	Efficiency[1858]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

Heat Transfer Through Open Entryway (Heating Season)

Q $= 1.08 * CFM_{tot} * (T_{ih} - T_{oh}) / (100{,}000\ Btu/therm)$

Where:

1.08 = sensible heat transfer coefficient: specific heat of air and unit conversions, Btu/(hr*°F*cfm)

CFM_{tot} = Total air flow through entryway (cfm)

T_{ih} = Average indoor air temperature during heating season

= User input, can assume indoor heating temperature set-point

T_{oh} = Average outdoor temp during heating season (°F)

= use table below, based on binned data from TMY3 & balance point temperature:

	Avg Outdoor Air Temp - Heating Season				
Climate Zone -Weather Station/City	45 °F	50 °F	55 °F	60 °F	65 °F
1 - Rockford AP / Rockford	26.3	28.8	31.6	34.2	37.3
2 - Chicago O'Hare AP / Chicago	29.4	31.2	34.0	36.8	40.3
3 - Springfield #2 / Springfield	29.4	31.5	34.6	37.7	41.6
4 - Belleville SIU RSCH / Belleville	31.7	33.6	36.2	39.2	42.3
5 - Carbondale Southern IL AP / Marion	32.5	34.9	37.8	40.7	44.0

The total airflow through the entryway, CFM_{tot}, includes both infiltration due to wind as well as thermal forces, as follows:

CFM_{tot} = sqrt[$(CFM_w)^2 + (CFM_t^2)$]

Where:

CFM_w = Infiltration due to the wind (cfm)

CFM_t = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

$CFM_w = (v_{wh} * C_{wh}) * C_v * A_d$ * (88 fpm/mph)

Where:

[1857] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1858] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

v_{wh} = average wind speed during the heating season (mph)

= similar to cooling season wind speed assumptions, use the following table to determined average wind speed based on entryway orientation:

	Entryway Orientation			
Climate Zone -Weather Station/ City	N	E	S	W
1 - Rockford AP / Rockford	5.0	4.6	4.9	5.6
2 - Chicago O'Hare AP / Chicago	5.5	5.2	4.9	5.1
3 - Springfield #2 / Springfield	5.0	4.9	5.3	5.1
4 - Belleville SIU RSCH / Belleville	4.3	3.4	3.5	5.3
5 - Carbondale Southern IL AP / Marion	4.6	3.2	4.2	4.4

C_{wh} = wind speed correction factor due to wind direction in heating season, (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the heating season prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for the heating applications.

	Entryway Orientation			
Climate Zone -Weather Station/ City	N	E	S	W
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31
2 - Chicago O'Hare AP / Chicago	0.21	0.10	0.26	0.39
3 - Springfield #2 / Springfield	0.21	0.14	0.27	0.34
4 - Belleville SIU RSCH / Belleville	0.31	0.15	0.22	0.29
5 - Carbondale Southern IL AP / Marion	0.31	0.11	0.27	0.18

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

C_v = effectiveness of openings,

= 0.3, assumes diagonal wind[1859]

A_d = area of the doorway (ft^2)

= user input

The infiltration due to thermal forces is calculated as follows:

$CFM_t = A_d * C_{dh} * (60 \text{ sec/min}) * \text{sqrt}[2 * g * H/2 * (T_{ih} - T_{oh}) / (459.7 + T_{ih})]$

Where:

C_{dh} = the discharge coefficient during the heating season

$= 0.4 + 0.0025 * |T_{ih} - T_{oh}|$

Note, values for C_{dh} show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value of 0.49 at indoor air temp of 72°F may be used as a simplification.

g = acceleration due to gravity

= 32.2 ft/sec^2

H = the height of the entryway (ft)

= user defined

[1859] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Manufacturers suggest annual inspection and maintenance (such as patching tears) of high speed doors. At a minimum, greasing of fittings and oil top-off should be carried out annually. This is estimated at a cost of $150 per year.[1860]

MEASURE CODE: CI-SHL-HSOD-V03-270101

REVIEW DEADLINE: 1/1/2028

[1860]Assumes approximately 1 hour of maintenance, based on manufacturer product spec sheets.

4.8.6 Dock Door Seals and Shelter

DESCRIPTION

This measure applies to buildings with exterior doors that serve as loading docks.

Overhead dock doors allow for loading and unloading of trucks. When the truck backs into the dock bumpers, a gap is created between the truck and the dock door that allows the infiltration or exfiltration of air in the upper, lower, and side portions. The infiltration/exfiltration of cold and warm air during the heating and cooling seasons increases the energy load of the building. Dock door seals are foam panels that are mounted outside of the dock door. Dock shelters are structures that form an enclosure around the perimeter of the trailer and are mounted outside of the dock door. The addition of dock door seals and shelters forms a tight seal between the truck and the door that prevents air infiltration/exfiltration and results in energy savings and enhanced personal comfort. Dock door seals and shelters also prevent the passing of rain droplets, snow, dust, insects, and other airborne particles.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Dock doors with compression seals or shelters forming a tight seal around the top, bottom, and sides of the truck and installed following manufacturer guidelines to effectively reduce heat loss and air during truck loading and unloading.

DEFINITION OF BASELINE EQUIPMENT

Dock doors with no seals or shelters installed to effectively reduce heat loss and air during truck loading and unloading.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 15 years[1861].

DEEMED MEASURE COST

The capital cost for dock door seals for exterior entryways is $3,692[1862].

LOADSHAPE

Heating season: If electric heating, use Commercial Electric heating Loadscape, C04. Otherwise, N/A

Cooling seasons: Commercial Cooling Loadshape C03. Or, if applicable, use Commercial Electric Heating and Cooling Loadshape C05.

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1863]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1864]

[1861] California Statewide Codes and Standards Enhancement (CASE) Program. “Dock Seals – Final Report”. California, November 2017.

[1862] Based on average project cost for dock door shelters incentivized under PG NSG Energy Efficiency programs between 2018 and 2020. Shelter average size is 85 square feet.

[1863] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility’s peak hour is divided by the maximum AC load during the year.

[1864] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Algorithm

CALCULATION OF ENERGY SAVINGS

The formulas follow the calculation methodology outlined by the ASHARE Handbook[1865] as stated in measure 4.4.33 Industrial Air Curtains.

ELECTRIC ENERGY SAVINGS

$$\Delta kWh_{cooling} = Q_{tbs} * t_{open} * CD / EER2$$

$$\Delta kWh_{heating} = Q_{bs} * t_{open} * HD * (100\ kBtu/therm)/(HSPF2 * (3.412\ kBtu/kWh))$$

Where:

Q_{tbs} = rate of total heat transfer through the gap before dock door seal or shelter [kBtu/hr]

t_{open} = average hours per day that a truck is in the loading position and the truck dock door is open [hr/day]

= 8.39 hours[1866] or actual.

CD = cooling days per year, total days in year above balance point temperature (day)

= use table below to select the best value for location, or 55°F if unknown:[1867]

.	CD (Balance Point Temperature)				
Climate Zone -Weather Station/City	45°F	50°F	55°F	60°F	65°F
1 - Rockford AP / Rockford	194	168	148	124	97
2 - Chicago O'Hare AP / Chicago	194	173	153	127	95
3 - Springfield #2 / Springfield	214	194	174	148	114
4 - Belleville SIU RSCH / Belleville	258	229	208	174	138
5 - Carbondale Southern IL AP / Marion	222	201	181	158	130

EER2 = energy efficiency ratio of the cooling equipment (kBtu/kWh) * distribution efficiency

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2024 if through new construction) to assume values based on code estimates, and assume 95% distribution efficiency for central cooling with ducts.

HSPF2 = Heating System Performance Factor of heat pump equipment * distribution efficiency

= Actual. If unknown, use the table C403.2.3(2) in IECC 2012 (or IECC 2024 if through new construction) to assume values based on code estimates, and assume 95% distribution efficiency for central cooling with ducts.

[1865] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): Ch 16.1 - 16.37.

[1866] Assumes 23-hour per day operation 5 days per week, with an average loading time of 45 minutes (including truck arrival and departure time) taken from: https://www.novalocks.com/wp-content/uploads/Dock-Planning-Standards-Guide.pdf. Average time between trucks estimated at 90 minutes taken from customer interviews. 5 day/7 days * 23 hr/day / 90 minutes per truck event x 45 minutes door open time per truck event = 8.39 average hr/day, 7 days/week.

[1867] National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL.
Note that cooling days (CD) are calculated by first determining its value from the TMY3 data associated with the appropriate weather station as defined by and used elsewhere in the Illinois TRM. Using the TMY3 outdoor air-dry bulb hourly data, the annual hours are totaled for every hour that the outdoor air-dry bulb temperature is above a designated zero heat loss balance point temperature or base temperature for cooling. For commercial and industrial (C&I) buildings, a base temperature for heating of 55°F is designated in the Illinois TRM, but building specific base temperatures are recommended for large C&I projects. Additionally, the TRM uses a 30-year normal data for degree-days while the CD calculation was based on TMY3 data; in order to account for this, calculations of CD were also normalized by the ratio of CDD to align the calculated values more closely with the TRM.

HD = heating days per year, total days in year above balance point temperature [day]

= use table below to select an appropriate value, or 55°F if unknown:[1868]

	HD				
Climate Zone Weather Station/City	**45°F**	**50°F**	**55°F**	**60°F**	**65° F**
1 - Rockford AP / Rockford	142	160	183	204	228
2 - Chicago O'Hare AP / Chicago	150	166	192	219	253
3 - Springfield #2 / Springfield	125	142	167	194	230
4 - Belleville SIU RSCH / Belleville	101	115	134	156	180
5 - Carbondale Southern IL AP / Marion	103	123	148	174	205

Heat Transfer Through Open Dock Door Without Dock Door Seal or Shelter (during Cooling Season)

Q_{tbs} = 4.5 * CFM_{tot} *(h_{oc} – h_{ic}) / (1,000 Btu/kBtu)

4.5 = unit conversion factor with density of air: 60min/hr * 0.075 lbm/ft^3 (lbm * min / (ft^3 * hr))

CFM_{tot} = total air flow through dock door (CFM)

h_{oc} = average enthalpy of outside air during the cooling season (Btu/lb)

= use the below table to determine the approximate outdoor air enthalpy associated with an indoor temperature setpoint and climate zone, use 72°F if unknown.[1869]

	h_{oc}		
Climate Zone -Weather Station/City	**67°F**	**72°F**	**77°F**
1 - Rockford AP / Rockford	31.6	33.0	35.3
2 - Chicago O'Hare AP / Chicago	32.0	33.6	35.4
3 - Springfield #2 / Springfield	32.9	34.6	36.6
4 - Belleville SIU RSCH / Belleville	33.5	35.0	36.4
5 - Carbondale Southern IL AP / Marion	34.6	36.2	37.7

h_{ic} = average enthalpy of indoor air, cooling season (Btu/lb) point temperature

= use the below table to determine the approximate indoor air enthalpy associated with an indoor temperature setpoint in indoor relative humidity.

	h_{ic}		
Relative Humidity (%)	**67°F**	**72°F**	**77°F**
60	25.5	28.5	31.8
50	23.9	26.6	29.5
40	22.3	24.7	27.3

= an estimate 26.6 Btu/lb associated with the 72°F and 50% indoor relative humidity case can be used as an approximation if no other data is available. For other indoor temperature setpoints and RH, enthalpies may be interpolated.

[1868] Note that Heating Days (HD) are calculated following the same approach outlined in the Cooling Days section.

[1869] Average enthalpies were estimated following ASHRAE guidelines for perfect gas relationships for dry air associated with hourly TMY3 data. Enthalpies were then averaged for all values associated with a dry-bulb outdoor air temperature that exceeded the indoor air temperature setpoint. Other enthalpy values may be interpolated for indoor air temperature setpoints not represented in the table. Note that while outdoor air enthalpies increase with higher temperature setpoints, the change in enthalpy from indoor to outdoor will decrease.

The total airflow through the gaps, CFM_{tot}, includes both infiltration due to wind as well as thermal forces, as follows:

$CFM_{tot} = sqrt[(CFM_w)^2 + (CFM_t^2)]$

Where:

CFM_w = Infiltration due to the wind (cfm)

CFM_t = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

$CFM_w = (v_{wc} * C_{wc}) * C_v * L_a * (88 \text{ fpm/mph})$

Where:

v_{wc} = average wind speed during the cooling season based on entryway orientation (mph)

= use the below table to for the wind speed effects based on climate zone and entryway orientation:[1870]

	Entryway Orientation				
Climate Zone -Weather Station /City	N	E	S	W	Unknown (average)
1 - Rockford AP / Rockford	4.2	4.1	4.7	4.8	4.5
2 - Chicago O'Hare AP / Chicago	4.7	4.5	5.4	4.6	4.8
3 - Springfield #2 / Springfield	4.1	3.7	6.0	5.0	4.7
4 - Belleville SIU RSCH / Belleville	3.3	2.7	3.8	4.2	3.5
5 - Carbondale Southern IL AP / Marion	3.1	2.9	4.4	3.8	3.6

C_{wc} = wind speed correction factor due to wind direction in cooling season (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the cooling season that prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for cooling applications.

	Entryway Orientation				
Climate Zone -Weather Station/City	N	E	S	W	Unknown (Average)
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31	0.23
2 - Chicago O'Hare AP / Chicago	0.18	0.17	0.36	0.26	0.24
3 - Springfield #2 / Springfield	0.17	0.12	0.46	0.21	0.24
4 - Belleville SIU RSCH / Belleville	0.21	0.15	0.35	0.16	0.22
5 - Carbondale Southern IL AP / Marion	0.18	0.15	0.37	0.11	0.20

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

C_v = effectiveness of openings,

= 0.3, assumes diagonal wind[1871]

[1870] Average wind speeds are calculated based on the TMY3 wind speed data. Because this data is collected at an altitude of 33 ft, wind speed is approximated for a 5 ft level based on ASHRAE Handbook guidelines using the urban/suburban parameters for adjusting wind speed based on altitude (Layer thickness (ft) δ = 1200, Exponent a = 0.22).
ASHRAE, "Airflow Around Buildings," in 2013 ASHRAE Handbook – Fundamentals (2013): p 24.3.

[1871] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

L_a = Leakage Area (gap) between doorway and truck (ft^2)

= 16.8 feet[1872] or Actual.

The infiltration due to thermal forces is calculated as follows:

$CFM_t = L_a * C_{dc} * (60 \text{ sec/min}) * \text{sqrt}[2 * g * H/2 * (T_{oc} - T_{ic}) / (459.7 + T_{oc})]$

Where:

C_{dc} = the discharge coefficient during the cooling season[1873]

$= 0.4 + 0.0025 * |T_{ic} – T_{oc}|$

= 0.42, Illinois average at indoor air temp of 72°F

Note, values for C_{dc} show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value may be used as a simplification.

g = acceleration due to gravity

= 32.2 ft/sec^2

H = dock door height (ft)

= user input

T_{ic} = Average indoor air temperature during cooling season

= User input, can assume indoor cooling temperature set-point

T_{oc} = Average outdoor temp during cooling season (°F)

= the average outdoor temperature is dependent on the CD period and zone. As such, the following table may be used for average outdoor temperature during the cooling period:[1874]

	T_{oc}				
Climate Zone Weather Station/City	**62 °F**	**67 °F**	**72 °F**	**77 °F**	**82 °F**
1 - Rockford AP / Rockford	72.9	76.0	79.2	82.5	85.5
2 - Chicago O'Hare AP / Chicago	72.9	76.0	79.4	82.8	85.5
3 - Springfield #2 / Springfield	73.7	76.7	79.9	83.4	86.4
4 - Belleville SIU RSCH / Belleville	74.9	77.7	81.0	84.3	86.9
5 - Carbondale Southern IL AP / Marion	75.1	77.7	80.9	84.7	87.4

459.7 = conversion factor from °F to °R

= calculation requires absolute temperature for values not calculated as a difference of temperatures.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$\Delta kW = (\Delta kWh_{cooling} / (CD * 24)) * CF$

Where:

[1872] Estimated 16.8 square feet of gap area. The leakage area is comprised of gaps on top, bottom and on the sides of the dock door. Common dock door dimensions are 8’0” in width with 8 ft, 9 ft or 10 ft heights. The maximum trailer size limits are 8’6” wide x 13’6” high (varies by state). Most trucks require a dock height of between 46 and 52 in. For the purposes of this calculation a 48” dock height and 9’0” wide x 10’0” high door was use, to cover the full range of truck types.

[1873] ASHRAE, “Ventilation and Infiltration,” in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13.

[1874] Based on binned data from TMY3 & adjusted bracketed thermostat setpoint temperatures. Interpolate other values as needed.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1875]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1876]

FOSSIL FUEL SAVINGS

Natural Gas savings associated with reduced infiltration through the gaps between the truck and the dock door during the heating season are calculated with the following formula:

$$\Delta therms = Q_{bs} * t_{open} * HD / \eta Heat$$

Where:

Q_{bs} = rate of sensible heat transfer through the gaps before dock door seal or shelter (therm/hr)

t_{open} = average hours per day the door is open (hr/day)

= 8.25[1877] hours or actual.

HD = heating days per year, as defined above

ηHeat = Efficiency of heating system * 95% (distribution efficiency)

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1878]

System Type	Efficiency[1879]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

Heat Transfer Through Dock Door without Dock Door Seals or Shelters (Heating Season)

$$Q_{bs} = (1.08 \text{ Btu/(hr*°F*cfm)}) * CFM_{tot} * (T_{ih} - T_{oh}) / (100{,}000 \text{ Btu/therm})$$

Where:

1.08 = sensible heat transfer coefficient (specific heat of air and unit conversions)

CFM_{tot} = Total air flow through gaps (cfm)

T_{ih} = Average indoor air temperature during heating season

[1875] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1876]Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year

[1877] Average loading time estimated at 45 minutes including truck arrival and departure time from: https://www.novalocks.com/wp-content/uploads/Dock-Planning-Standards-Guide.pdf. Average time between truck departure and arrival estimated at 90 minutes taken from customer interviews.

[1878] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1879] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

= User input, can assume indoor heating temperature set-point

T_{oh} = Average outdoor temp during heating season (°F)

= use table below, based on binned data from TMY3 & balance point temperature:

	Avg Outdoor Air Temp - Heating Season				
Climate Zone -Weather Station/City	45°F	50°F	55°F	60°F	65°F
1 - Rockford AP / Rockford	26.3	28.8	31.6	34.2	37.3
2 - Chicago O'Hare AP / Chicago	29.4	31.2	34.0	36.8	40.3
3 - Springfield #2 / Springfield	29.4	31.5	34.6	37.7	41.6
4 - Belleville SIU RSCH / Belleville	31.7	33.6	36.2	39.2	42.3
5 - Carbondale Southern IL AP / Marion	32.5	34.9	37.8	40.7	44.0

The total airflow through the gaps, CFM_{tot}, includes both infiltration due to wind as well as thermal forces, as follows:

$CFM_{tot} = sqrt[(CFM_w)^2 + (CFM_t^2)]$

Where:

CFM_w = Infiltration due to the wind (cfm)

CFM_t = Infiltration due to thermal forces (cfm)

The infiltration due to the wind is calculated as follows:

$CFM_w = (v_{wh} * C_{wh}) * C_v * L_a * (88 \text{ fpm/mph})$

Where:

v_{wh} = average wind speed during the heating season (mph)

= similar to cooling season wind speed assumptions, use the following table to determine average wind speed based on entryway orientation:

	Entryway Orientation				
Climate Zone -Weather Station/ City	N	E	S	W	Average (unknown)
1 - Rockford AP / Rockford	5.0	4.6	4.9	5.6	5.0
2 - Chicago O'Hare AP / Chicago	5.5	5.2	4.9	5.1	5.2
3 - Springfield #2 / Springfield	5.0	4.9	5.3	5.1	5.1
4 - Belleville SIU RSCH / Belleville	4.3	3.4	3.5	5.3	4.1
5 - Carbondale Southern IL AP / Marion	4.6	3.2	4.2	4.4	4.1

C_{wh} = wind speed correction factor due to wind direction in heating season, (%)

= because wind direction is not constant, a wind speed correction factor is used to adjust for the amount of time during the heating season prevailing winds can be expected to impact the entryway. Use the following table to determine the correct wind speed correction factor for the heating applications.

	Entryway Orientation				
Climate Zone -Weather Station/ City	N	E	S	W	Average (unknown)
1 - Rockford AP / Rockford	0.18	0.13	0.30	0.31	0.23
2 - Chicago O'Hare AP / Chicago	0.21	0.10	0.26	0.39	0.24
3 - Springfield #2 / Springfield	0.21	0.14	0.27	0.34	0.24
4 - Belleville SIU RSCH / Belleville	0.31	0.15	0.22	0.29	0.24
5 - Carbondale Southern IL AP / Marion	0.31	0.11	0.27	0.18	0.22

Note that correction factors do not add up to 1 (100%). This is attributed to periods of calm winds.

C_v = effectiveness of openings,

= 0.3, assumes diagonal wind[1880]

L_a = Leakage Area (gap) between doorway and truck (ft^2)

= 16.8 feet[1881] or Actual.

The infiltration due to thermal forces is calculated as follows:

$CFM_t = L_a * C_{dh} * (60 \text{ sec/min}) * \text{sqrt}[2 * g * H/2 * (T_{ih} – T_{oh}) / (459.7 + T_{ih})]$

Where:

C_{dh} = the discharge coefficient during the heating season

$= 0.4 + 0.0025 * |T_{ih} – T_{oh}|$

= 0.49, Illinois average at indoor air temp of 72°F

Note, values for C_{dh} show little variation due to balance point temperature, indoor air temperature, and climate zone. As such, if estimating results, the Illinois average value may be used as a simplification.

g = acceleration due to gravity

= 32.2 ft/sec^2

H = dock door height (ft)

= user defined

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-DDSS-V03-270101

REVIEW DEADLINE: 1/1/2028

[1880] ASHRAE, "Ventilation and Infiltration," in 2013 ASHRAE Handbook – Fundamentals (2013): p 16.13

[1881] Estimated 16.8 square feet of gap area. The leakage area is comprised of gaps on top, bottom and on the sides of the dock door. Common dock door dimensions are 8'0" in width with 8 ft, 9 ft or 10 ft heights. The maximum trailer size limits are 8'6" wide x 13'6" high (varies by state). Most trucks require a dock height of between 46 and 52 in. For the purposes of this calculation a 48" dock height and 9'0" wide x 10'0" high door was use, to cover the full range of truck types.

4.8.7 Commercial Wall Insulation

DESCRIPTION

Wall insulation is added to building wall cavities or to building internal/external wall surfaces; foundation insulation is added to building internal/external foundation surfaces, both above grade and below grade. This measure requires pre- and post-implementation R-values and measurements surface areas.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient scenario is the installation of added insulation. This measure requires a member of the implementation staff or a participating contractor to evaluate the pre- and post-implementation R-values and to measure surface areas. The requirements for participation in the program will be defined by the utilities.

DEFINITION OF BASELINE EQUIPMENT

The existing condition will be evaluated by implementation staff or a participating contractor and is likely to be empty or minimally insulated wall cavities, and uninsulated above and below grade foundation walls.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 25 years.[1882]

DEEMED MEASURE COST

Costs can be highly variable due to differences in building type and structural assemblies and therefore actual costs should be used when possible. Absent of actual cost information, estimated costs can be used as follows[1883]:

	R-value	Material/ Equipment Cost per sq.ft.	Labor Cost per sq.ft.	Full Measure Cost per sq.ft.
Unfaced Fiberglass	R-13	$0.73	$0.40	$1.13
	R-19	$0.88		$1.28
	R-30	$1.59		$1.99
Extruded Polystyrene Board	R-10	$2.57	$0.60	$3.17
	R-15	$3.49		$4.09

LOADSHAPE

Loadshape C01 – Commercial Electric Cooling

Loadshape C03 – Commercial Cooling

Loadshape C04 – Commercial Electric Heating

Loadshape C05 – Commercial Electric Heating and Cooling

[1882] Navigant 'ComEd Effective Useful Life Research Report', May 2018.

[1883] Costs are estimated from RS Means, Release Year 2026, Quarter 2, with labor rates an average of the 5 climate zones.

COINCIDENCE FACTOR

The summer peak coincidence factor for cooling is provided in two different ways below. The first is used to estimate peak savings during the utility peak hour and is most indicative of actual peak benefits, and the second represents the *average* savings over the defined summer peak period, and is presented so that savings can be bid into PJM's capacity market. Both values provided are based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren.

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1884]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1885]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

Where available, savings from wall and foundation insulation measures should be determined through a custom analysis. When that is not feasible for the program the following engineering algorithms can be used.

$$\Delta kWh = \Delta kWh_cooling + \Delta kWh_heatingElectric + \Delta kWh_heatingGas$$

Where:

$\Delta kWh_cooling$ = If building is cooled, reduction in annual cooling requirement due to wall insulation

$$= ((1 / R_ExistWall - 1 / R_NewWall) * A_wall + (1 / R_ExistAG - 1 / R_ NewAG) * A_AG + (1 / R_ExistBG - 1 / R_NewBG) * A_BG) * EFLH_{cooling} * \Delta T_{FL,cooling} / 1000 / \eta Cool * \%Cool$$

Where:

R_NewWall = R-value of proposed new wall assembly (including all layers between inside air and outside air).

= Actual

R_ExistWall = R-value value of existing assembly and any existing insulation.

= Minimum of R-5 for uninsulated assemblies[1886]

A_wall = Net area of insulated wall (ft^2)

= Actual

R_NewAG = Effective R-value of proposed new Above-Ground Foundation assembly (including all layers between inside air and outside air).

= Actual

R_ExistAG = Effective R-value value of existing Above-Ground Foundation assembly and any existing insulation.

[1884] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1885] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1886] An estimate based on review of Madison Gas and Electric, Exterior Wall Insulation, R-value for no insulation in walls, and NREL's Building Energy Simulation Test for Existing Homes (BESTEST-EX).

= Minimum of R-5 for uninsulated assemblies[1887]

A_AG = Net area of Above-Ground Foundation being insulated (ft^2)

= Actual

R_NewBG = Effective R-value of proposed new Foundation Below Grade assembly (including all layers between inside air and outside ground).

= Actual

R_ExistBG = Effective R-value value of existing Foundation Below Grade assembly and any existing insulation.

NOTE: Added to the above R-values of Below Grade assemblies shall be the following deemed Average Earth R-values, which account for transmission of heat through direct contact with the earth outside the foundation. The Effective Ground Contact R-value varies as a function of the average depth below grade of the bottom of the foundation:[1888]

Depth Below Grade of Bottom of Foundation	Earth R-value	Average Earth R-value
0 feet	2.44 F-Ft^2-Hr/Btu	2.44 F-Ft^2-Hr/Btu
1 feet	4.50 F-Ft^2-Hr/Btu	3.47 F-Ft^2-Hr/Btu
2 feet	6.30 F-Ft^2-Hr/Btu	4.41 F-Ft^2-Hr/Btu
3 feet	8.40 F-Ft^2-Hr/Btu	5.41 F-Ft^2-Hr/Btu
4 feet	10.44 F-Ft^2-Hr/Btu	6.42 F-Ft^2-Hr/Btu
5 feet	12.66 F-Ft^2-Hr/Btu	7.46 F-Ft^2-Hr/Btu
6 feet	14.49 F-Ft^2-Hr/Btu	8.46 F-Ft^2-Hr/Btu
7 feet	17.00 F-Ft^2-Hr/Btu	9.53 F-Ft^2-Hr/Btu
8 feet	20.00 F-Ft^2-Hr/Btu	10.69 F-Ft^2-Hr/Btu

A_BG = Net area of Foundation Below Grade being insulated (ft^2)

= Actual

$EFLH_{cooling}$ = Equivalent Full Load Hours for Cooling [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,cooling}$ = Temperature difference [°F] during cooling season between design day outdoor air temperature (T_{DD}) and assumed 55°F base temperature

Climate Zone (City based upon)	$T_{DD,cooling}$ [°F][1889]	$\Delta T_{FL,cooling}$ [°F]
1 (Rockford)	90.9	35.9
2 (Chicago)	91.3	36.3
3 (Springfield)	92.6	37.6
4 (Belleville)	95.2	40.2

[1887] An estimate based on review of Madison Gas and Electric, Exterior Wall Insulation, R-value for no insulation in walls, and NREL's Building Energy Simulation Test for Existing Homes (BESTEST-EX).

[1888] Source: Illinois Statewide Technical Reference Manual V10.0, Volume 3 - Section 5.6.2 Basement Sidewall Insulation, Table on page 338 of 401.

[1889] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

Climate Zone (City based upon)	$T_{DD,cooling}$ [°F][1889]	$\Delta T_{FL,cooling}$ [°F]
5 (Marion)	94.4	39.4

1000 = Converts Btu to kBtu

ηCool = Efficiency of cooling equipment * distribution efficiency. Actual and assume 95% distribution efficiency for central cooling with ducts. If unknown assume:[1890]

Space Cooling Source	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling Source	10.2	11.1

%Cool = Percent of building ***where wall or foundation insulation is to be installed*** that is cooled

= Actual %, if known, or, If actual % unknown, use following deemed values:

Is Space Being Insulated Cooled?	Deemed %Cool, if actual % is unknown
Yes	100%
No	0%

For example, for a elementary school building with unknown cooling equipment in Rockford with increase in wall insulation: R_ExistWall = 5.0; R_NewWall = 16.0; A_wall = 1,500; ηCool = 13.0; %Cool = 100%

ΔkWh_cooling = (1/5.0 - 1/16.0) * 1,500 * 834 * 35.9 / 1,000 / 11.0 * 100%

= 561 kWh

ΔkWh_heatingElectric = If electric heat (resistance or heat pump), reduction in annual electric heating due to wall and/or foundation insulation

= [(1/R_ExistWall - 1/R_NewWall) * A_wall + (1/R_ExistAG - 1/R_ NewAG) * A_AG + (1/R_ExistBG - 1/R_NewBG) * A_BG] * $EFLH_{heating}$ * $\Delta T_{FL,heating}$ / ηHeat / 3412 * %ElectricHeat

Where:

$EFLH_{heating}$ = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,heating}$ = Temperature difference [°F] during heating season between design day outdoor air temperature and assumed 55°F heating base temperature

Climate Zone (City based upon)	$T_{DD,heating}$ [°F][1891]	$\Delta T_{FL,heating}$ [°F]
1 (Rockford)	-5.4	60.4

[1890] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95 and multiplied by 0.95 distribution efficiency.

[1891] Weather Station Data, 96.6% Heating DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

Climate Zone (City based upon)	$T_{DD,heating}$ [°F][1891]	$\Delta T_{FL,heating}$ [°F]
2 (Chicago)	-1.0	56.0
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

ηHeat = Efficiency of heating system. Actual, or as deemed from table below

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95
Heat Pump	7.37[1892]	2.05
Resistance	N/A	1

3412 = Converts Btu to kWh

%ElectricHeat = Percent of building ***where wall or foundation insulation is to be installed*** that is electrically heated

= Actual %, if known, or, If actual % unknown, use following deemed values:

Is Space Being Insulated Electrically Heated?	Deemed %ElectricHeat, if actual % is unknown
Yes	100%
No	0%

For example, for a elementary school building with resistance heating in Rockford: R_ExistWall = 5.0; R_NewWall = 16.0; A_wall = 1,500; ηHeat = 1.0; %ElectricHeat = 100%

ΔkWh_heatingElec = (1/5.0 - 1/16.0) * 1,500 * 1,614 * 60.4 / 3,412 / 1.0 * 100%
= 5,893 kWh

ΔkWh_heatingGas = If gas *furnace* heat, kWh savings for reduction in combustion fan run time

= ΔTherms * F_e * 29.3

Where:

ΔTherms = Annual therms of gas space heating saved, as determined below

F_e = Furnace or boiler combustion fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1893]

29.3 = conversion of therms to kWh (= 100,000 / 3412)

[1892] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.

[1893] F_e is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

For example, if: ΔTherms = 251; F_e = 7.7%, then:

ΔkWh_heatingGas = 251 * 7.7% * 29.3

= 566 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = ΔkWh_cooling / EFLH_Cooling * CF

Where:

ΔkWh_cooling = Annual kWh saving in cooling energy use, as determined above

EFLH_cooling = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [1894]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8% [1895]

For example, for a elementary school in Rockford with unknown cooling per above example: ΔkWh_cooling = 687; EFLH_Cooling = 1,020; CF = 0.478; then:

ΔkW = 561 / 834 * 0.478

= 0.32 kW

FOSSIL FUEL SAVINGS

If Natural Gas heating:

ΔTherms = ((1/R_ExistWall - 1/R_NewWall) * A_wall + (1/R_ExistAG - 1/R_ NewAG) * A_AG + (1/R_ExistBG - 1/R_NewBG) * A_BG) * $EFLH_{heating}$ * $\Delta T_{FL,heating}$ /ηHeat /100,000 * %GasHeat

Where:

ηHeat = Efficiency of heating system * 95% (distribution efficiency)

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1896]

System Type	Efficiency[1897]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C

[1894] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1895] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1896] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1897] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

System Type	Efficiency[1897]
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

%GasHeat = Percent of space being retrofitted with insulation that is heated using gas

= Actual %, if known, or, If actual % unknown, use following deemed values:

Is Space Being Insulated Heated with Gas?	Deemed %GasHeat, if actual % is unknown
Yes	100%
No	0%

Other variables as defined above.

For example, for a elementary school building in Rockford with unknown gas heat: R_ExistWall = 5.0; R_NewWall = 16.0; A_wall = 1,500; ηHeat = 0.8; %GasHeat = 100%; then

ΔTherms = (1/5.0 - 1/16.0) * 1500 * 1,614 * 60.4/ 0.8 /100,000 * 100%

= 251 therms

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-WINS-V06-270101

REVIEW DEADLINE: 1/1/2031

4.8.8 Commercial Secondary Windows

DESCRIPTION

Commercial Secondary Windows (CSW) are window units with one or more transparent panes in a frame that attach to the interior or exterior of existing windows without replacing the original glass or frame. Secondary windows are retrofitted to existing commercial windows to improve their overall thermal performance by adding a layer of glazing. CSWs are an alternative to full window replacement and can improve energy performance of commercial buildings at a fraction of the cost of replacement

A CSW retrofit of existing clear windows create an insulating air pocket between the existing window and the new CSW, reducing heat transfer as well as air leakage and infiltration. CSWs can incorporate a variety of high-performance options including low-e coatings, vacuum-insulated glazing (VSG), and electrochromic glazing (controllable window tint).

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is a CSW unit installed permanently according to manufacturers' specifications over an existing low-performance window.

DEFINITION OF BASELINE EQUIPMENT

The baseline for this measure is an existing, non-operable single or double pane window in a commercial building. For reference in determining existing window type, use the Attachments Rating Council (AERC) Baseline Window D for single-pane and Baseline Window E for double-pane windows.[1898]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 30 years[1899].

DEEMED MEASURE COST

Actual costs for purchase and installation of the CSW units should be used if available. If cost is unknown, assume a total cost of 32$ per square foot[1900] of CSW systems installed.

LOADSHAPE

Loadshape C03- Commercial Cooling

Loadshape C04 - Commercial Electric Heating

Loadshape C05 - Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1901]

[1898] Attachments Energy Rating Council, AERC 1: Procedures for Determining Energy Performance Properties of Fenestration Attachments, Appendix A – Baseline Windows.

[1899] Effective useful life based on commercial secondary glazing systems measure in regional technical forum, technical advisory committee to Northwest Power and Conservation Council.
Commercial Secondary Glazing Systems (nwcouncil.org)

[1900] Average total installed cost for CSW systems from "Secondary Glazing Systems: Market and Deployment Development" by Slipstream prepared for the Nicor Gas Energy Efficiency Program.

[1901] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period

= 47.8%[1902]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

ΔkWh = (ΔkWh_cooling + ΔkWh_heatingElec + ΔkWh_heatingGas)

ΔkWh_cooling = $((U_{base} - U_{eff}) * A * EFLH_{Cool} * \Delta T_{FLcool}) / (1{,}000 * \eta Cool)$

Where:

U_{base} = U-factor of existing window (Btu/ft²°Fh)

= Actual; or if window type is known, use the associated value from the table below. If window type is unknown, use the "unknown" value from the table below.[1903]

Window Type	Climate Zone 5A	Climate Zone 4A
Fixed Fenestration – Metal Framing, Double Pane	0.488	0.510
Fixed Fenestration – Non-Metal Framing, Double Pane	0.421	0.460
Operable Fenestration – Metal Framing, Double Pane	0.511	0.533
Operable Fenestration – Non-Metal Framing, Double Pane	0.444	0.483
Single Pane	0.94	
Unknown	0.466	0.497

U_{eff} = U-factor of the efficient CSW assembly installed over the baseline window (Btu/ft²°Fh)

= Actual

A = Area of CSW system installed, ft²

$EFLH_{Cool}$ = Equivalent Full Load Hours for cooling in Existing Buildings are provided in section 4.4 HVAC End Use

ΔT_{FLcool} = Temperature difference during cooling season between design day outdoor air temperature (TDD) and assumed 55°F base temperature[1904]

[1902] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1903] Double Pane values in table result from a simple average of U-value requirements from the International Energy Conservation Code (IECC) 2000 – 2015 (6 versions). For the 2000 & 2003 codes, climate zones 12b,13b and 14b were used for zone 5, and 10b and 11b for zone 4 as these were updated in subsequent IECC versions. Also assumed 10-25% building glass surface for the 2000 & 2003 code. Does not include values for curtain walls, skylights, or entrance doors. Single Pane value is an average of pre-1980s (U-1.2) and 1980-1999 (U-0.68) code levels.

[1904] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

Climate Zone (City based upon)	TDD_{cool} [°F]	$\Delta T_{FL,cool}$ [°F]
1 (Rockford)	90.9	35.9
2 (Chicago)	91.3	36.3
3 (Springfield)	92.6	37.6
4 (Belleville)	95.2	40.2
5 (Marion)	94.4	39.4

1,000 = Conversion from Btu to kBtu

ηCool = Efficiency of cooling equipment (kBtu/kWh) * distribution efficiency.

= Actual if known, if unknown assume:[1905]

Space Cooling Source	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling Source	10.2	11.1

$\Delta kWh_heatingElec = ((U_{base} - U_{eff}) * A * EFLH_{Heat} * \Delta T_{FL,heat}) / (3{,}412 * \eta Heat)$

Where:

$EFLH_{Heat}$ = Equivalent Full Load Hours for heating in Existing Buildings are provided in section 4.4 HVAC End Use

ΔT_{FLheat} = Temperature difference during heating season between design day outdoor air temperature (TDD) and assumed 55°F base temperature[1906]

Climate Zone (City based upon)	TDD_{heat} [°F]	$\Delta T_{FL,heat}$ [°F]
1 (Rockford)	-5.4	60.4
2 (Chicago)	-1	56
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

3,412 = Conversion from Btu to kWh

ηHeat = Efficiency of heating system * 95% (distribution efficiency)

= Actual, or in unknown, use default values from the table below[1907]

[1905] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95 and multiplied by 0.95 distribution efficiency.
[1906] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.
[1907] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85 and multiplied by 0.95 distribution efficiency.

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95 (Distribution Efficiency)
Heat Pump	7.37	2.05
Resistance	N/A	1.0

ΔkWh_heatingGas = If gas furnace heat, kWh savings for reduction in fan run time

= ΔTherms * Fe * 29.3

Where:

Fe = Furnace Fan energy consumption as a percentage of annual fuel consumption

= 7.7%[1908]

29.3 = kWh per therm

SUMMER COINCIDENT PEAK DEMAND SAVINGS

ΔkW = (ΔkWh_cooling / $EFLH_{cool}$) * CF

Where:

$EFLH_{cool}$ = Equivalent full load hours of air conditioning in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1909]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1910]

FOSSIL FUEL SAVINGS

ΔTherms = ((U_{base} – U_{eff}) * A * $EFLH_{Heat}$ * $\Delta T_{FL,heat}$) / (100,000 * ηHeat)

Where:

100,000 = Conversion from BTUs to Therms

ηHeat = Efficiency of heating system * 95% (distribution efficiency)

[1908] Fe is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail–strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[1909] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1910] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1911]

System Type	Efficiency[1912]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-CSW-V04-270101

REVIEW DEADLINE: 1/1/2029

[1911] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

[1912] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

4.8.9 Efficient Windows

DESCRIPTION

This measure describes savings realized by the installation of new windows that have better thermal insulating properties compared to either baseline or code requirements. For a comprehensive estimate of impacts, including the effects of solar gains, computer modeling is recommended.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient solution is a window assembly with a U-factor that is better than code and a Solar Heat Gain Coefficient (SHGC) that is at least equal to but not greater than code requirements. Windows are independently tested and certified according to the standards established by the National Fenestration Rating Council (NFRC). In addition to the NFRC, any NFRC-licensed independent certification and inspection agency can provide a certification. Though not a requirement for this measure, it is strongly recommended that the efficient window assembly is NFRC certified. The window must be installed in a commercial or industrial facility that is conditioned year-round (heating and cooling).

DEFINITION OF BASELINE EQUIPMENT

For new construction applications, the baseline equipment is a window with a U-factor and a Solar Heat Gain Coefficient (SHGC) that are equal to code requirements (IECC 2024). For retrofit applications, the baseline equipment is the U-factor of the existing window.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 20 years.[1913]

DEEMED MEASURE COST

Actual installed costs should be used.

LOADSHAPE

Loadshape C03 – Commercial Cooling

Loadshape C04 – Commercial Electric Heating

Loadshape C05 – Commercial Electric Heating and Cooling

COINCIDENCE FACTOR

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1914]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1915]

[1913] Consistent with window measure lives specified in the MidAmerican Energy Company Joint Assessment, February 2013.
[1914] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[1915] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

Algorithm

CALCULATION OF ENERGY SAVINGS

The following calculations apply to a single window assembly. Note that the effects of a lower SHGC are not considered in this characterization. A lower SHGC does not necessarily equate to net savings due to the possible opposite effects it can have on heating and cooling loads. For optimum design and estimation of impacts from solar gain, a custom analysis should be performed that considers building site and orientation considerations.

ELECTRIC ENERGY SAVINGS

Electric Energy savings is calculated as the sum of energy savings when cooling the building and energy savings when heating the building.

$$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{heating}$$

If the facility is mechanically cooled, the electric energy savings in annual cooling due to the added insulation is as follows:

$$\Delta kWh_{cooling} = \frac{\left(U_{base} - U_{eff}\right) \times A_{window} \times EFLH_{cooling} \times \Delta T_{FL,cooling}}{(1{,}000 \times \eta_{cooling})}$$

Where:

U_{base} = For Retrofit applications: U-factor of existing window (Btu/ft^2.°F.h).

= Actual; or if window type is known, use the associated value from the table below. If window type is unknown, use the "unknown" value from the table below.[1916]

Window Type	Climate Zone 5A	Climate Zone 4A
Fixed Fenestration – Metal Framing, Double Pane	0.488	0.510
Fixed Fenestration – Non-Metal Framing, Double Pane	0.421	0.460
Operable Fenestration – Metal Framing, Double Pane	0.511	0.533
Operable Fenestration – Non-Metal Framing, Double Pane	0.444	0.483
Single Pane	0.94	
Unknown	0.466	0.497

= For New Construction applications: Code required U-factor (Btu/ft^2.°F.h).

= Dependent on climate zone and window type. If unknown, assume the most conservative value. See table below for IECC 2024 requirements.

Window Type	Climate Zone 5A	Climate Zone 4A
Fixed Fenestration	0.34	0.34
Operable Fenestration	0.45	0.45

[1916] Double Pane values in table result from a simple average of U-value requirements from the International Energy Conservation Code (IECC) 2000 – 2015 (6 versions). For the 2000 & 2003 codes, climate zones 12b,13b and 14b were used for zone 5, and 10b and 11b for zone 4 as these were updated in subsequent IECC versions. Also assumed 10-25% building glass surface for the 2000 & 2003 code. Does not include values for curtain walls, skylights, or entrance doors. Single Pane value is an average of pre-1980s (U-1.2) and 1980-1999 (U-0.68) code levels.

U_{eff} = U-factor value of the efficient window assembly (Btu/ft^2.°F.h)

= Actual

A_{window} = The area of the window assembly [ft^2]

= Actual

$EFLH_{cooling}$ = Equivalent Full Load Hours for Cooling [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,cooling}$ = Temperature difference [^{o}F] during cooling season between design day outdoor air temperature (TDD) and assumed 55^{o}F base temperature

Climate Zone (City based upon)	$TDD_{cooling}$ [°F][1917]	$\Delta T_{FL,cooling}$ [°F]
1 (Rockford)	90.9	35.9
2 (Chicago)	91.3	36.3
3 (Springfield)	92.6	37.6
4 (Belleville)	95.2	40.2
5 (Marion)	94.4	39.4

1,000 = Conversion from Btu to kBtu

η_cooling = Efficiency of cooling equipment (kBtu/kWh) * distribution efficiency. Actual (for new construction, use IECC 2024) and assume 95% distribution efficiency for central cooling with ducts. If unknown assume:[1918]

Space Cooling Source	Deemed Cooling EER2	Deemed Cooling SEER2
No Cooling	N/A	N/A
Unknown Cooling Source	10.2	11.1

If the building is heated with electric heat (resistance or heat pump), the electric energy saved in annual heating due to the added insulation is

$$\Delta kWh_{heating} = \frac{(U_{base} - U_{eff}) \times A_{window} \times EFLH_{heating} \times \Delta T_{FL,heating}}{(3{,}412 \times \eta_{heating})}$$

$EFLH_{heating}$ = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,heating}$ = Temperature difference [^{o}F] during heating season between design day outdoor air temperature and assumed 55^{o}F heating base temperature

[1917] Weather Station Data, 0.4% Cooling DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

[1918] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note SEER and EER values converted to SEER2/EER2 by multiplying by 0.95 and multiplied by 0.95 distribution efficiency.

Climate Zone (City based upon)	$TDD_{heating}$ [°F][1919]	$\Delta T_{FL,heating}$ [°F]
1 (Rockford)	-5.4	60.4
2 (Chicago)	-1.0	56.0
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

3,142 = Conversion from Btu to kWh.

$\eta_{heating}$ = Efficiency of heating equipment * Distribution Efficiency. Use actual efficiency and assume 95% distribution efficiency. If not available refer to default table below.

System Type	HSPF2 Estimate	ηHeat (Effective COP Estimate) (HSPF2/3.413)*0.95 (Distribution Efficiency)
Heat Pump	7.37[1920]	2.05
Resistance	N/A	1

For example, a new construction office in Chicago with an all electric HVAC system installing 50 sqft of commercial efficient windows with a U factor if 0.25 would save:

$\Delta kWh = \Delta kWh_{cooling} + \Delta kWh_{heating}$

$\Delta kWh_{cooling} = ((U_{base} - U_{eff}) * A_{window} * EFLH_{cooling} * \Delta T_{FL,cooling})/(1{,}000 * \eta_{cooling})$

$= ((0.36 - 0.25) * 50 * 1{,}790 * 36.3) / (1{,}000 * 15.2)$

$= 23.5$ kWh

$\Delta kWh_{heating} = ((U_{base} - U_{eff}) * A_{window} * EFLH_{heating} * \Delta T_{FL,heating})/(1{,}000 * \eta_{heating})$

$= ((0.36 - 0.25) * 50 * 2{,}625 * 56.0) / (3{,}142 * 2.04)$

$= 116.2$ kWh

$\Delta kWh = 23.5 + 116.2$

$= 149.6$ kWh

If the building is heated with a gas furnace, there will be some electric savings associated with the reduction in furnace run time.

$$\Delta kWh_{gasheating} = \Delta Therms \times Fe \times 29.3$$

[1919] Weather Station Data, 96.6% Heating DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

[1920] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Note HSPF value converted to HSPF2 by multiplying by 0.85.

Where:

ΔTherms = Gas savings calculated with equation below.

Fe = Percentage of heating energy consumed by fans, assume 7.7%[1921]

29.3 = Conversion from therms to kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \frac{\Delta kWh_{cooling}}{EFLH_{cooling}} \times CF$$

Where:

$EFLH_{cooling}$ = Equivalent full load hours of air conditioning in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3%[1922]

CF_{PJM} = PJM Summer Peak Coincidence Factor for Commercial cooling (average during peak period)

= 47.8%[1923]

FOSSIL FUEL SAVINGS

If building uses a gas heating system, the savings resulting from the efficient window is calculated with the following formula

$$\Delta Therms = \frac{\left(U_{base} - U_{eff}\right) \times A_{window} \times EFLH_{heating} \times \Delta T_{FL,heating}}{(100{,}000 \times \eta_{heating})}$$

Where:

U_{base} = For Retrofit applications: U-factor of existing window (Btu/ft^2.°F.h).

= Actual; or if window type is known, use the associated value from the table below. If window type is unknown, use the "unknown" value from the table below.[1924]

Window Type	Climate Zone 5A	Climate Zone 4A
Fixed Fenestration – Metal Framing	0.488	0.510

[1921] Fe is estimated using TRM models for the three most popular building types for programmable thermostats: low-rise office (10.2%), sit-down restaurant (8.6%), and retail – strip mall (4.4%). 7.7% reflects the average Fe of the three building types. See "Fan Energy Factor Example Calculation 2021-06-23.xlsx" for reference.

[1922] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

[1923] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The average AC load over the PJM peak period (1-5pm, M-F, June through August) is divided by the maximum AC load during the year.

[1924] Double pane values in table result from a simple average of U-value requirements from the International Energy Conservation Code (IECC) 2000 – 2015 (6 versions). For the 2000 & 2003 codes, climate zones 12b,13b and 14b were used for zone 5, and 10b and 11b for zone 4 as these were updated in subsequent IECC versions. Also assumed 10-25% building glass surface for the 2000 & 2003 code. Does not include values for curtain walls, skylights, or entrance doors. Single Pane value is an average of pre-1980s (U-1.2) and 1980-1999 (U-0.68) code levels.

Window Type	Climate Zone 5A	Climate Zone 4A
Fixed Fenestration – Non-Metal Framing	0.421	0.460
Operable Fenestration – Metal Framing	0.511	0.533
Operable Fenestration – Non-Metal Framing	0.444	0.483
Single Pane	0.94	
Unknown	0.466	0.497

= For New Construction applications: Code required U-factor (Btu/ft^2.°F.h).

= Dependent on climate zone and window type. If unknown, assume the most conservative value. See table below for IECC 2024 requirements.

Window Type	Climate Zone 5A	Climate Zone 4A
Fixed Fenestration	0.34	0.34
Operable Fenestration	0.45	0.45

U_{eff} = U-factor value of the efficient window assembly (Btu/ft2.°F.h)

= Actual.

A_{window} = The area of the window assembly [ft^2]

$EFLH_{heating}$ = Equivalent Full Load Hours for Heating [hr] in Existing Buildings or New Construction are provided in Section 4.4, HVAC end use

$\Delta T_{FL,heating}$ = Temperature difference [°F] during heating season between design day outdoor air temperature and assumed 55°F heating base temperature (same as above)

Climate Zone (City based upon)	$TDD_{heating}$ [°F][1925]	$\Delta T_{FL,heating}$ [°F]
1 (Rockford)	-5.4	60.4
2 (Chicago)	-1.0	56.0
3 (Springfield)	1.1	53.9
4 (Belleville)	7.2	47.8
5 (Marion)	10.1	44.9

100,000 = Conversion from BTUs to Therms

$\eta_{heating}$ = Efficiency of heating system * 95% (distribution efficiency)

= Actual, if unknown assume efficiency in table below if system type known, if not use 0.821 for planning purposes. [1926]

[1925] Weather Station Data, 96.6% Heating DB - 2021 ASHRAE Handbook, Fundamentals. The following weather stations were referenced: Climate Zone 1: Chicago Rockford Int'l, Climate Zone 2: Chicago O'Hare Int'l, Climate Zone 3: Abraham Lincoln Capital, Climate Zone 4: Scott AFB, Climate Zone 5: Cape Girardeau Regional.

[1926] Based on GDS Associates Inc., "2023-2024 Illinois Baseline Study: Nonresidential Baseline Study Results", Oct 31 2024. Total heating capacity provided by 54% Furnace and 46% Boiler at 83.1% and 85.8% AFUE respectively, multiplied by estimate of distribution losses of 95%.

System Type	Efficiency[1927]
Hot Water Boiler < 300,000 Btu/h	84% AFUE
Hot Water Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	80% E_T
Hot Water Boiler > 2,500,000 Btu/h	82% E_C
Steam Boiler < 300,000 Btu/h	82% AFUE
Steam Boiler ≥ 300,000 Btu/h and ≤ 2,500,000 Btu/h	79% E_T
Steam Boiler ≥ 2,500,000 Btu/h	79% E_T
Gas Furnace <225,000 Btu/h	80% AFUE
Gas Furnace ≥225,000 Btu/h	81% AFUE

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-SHL-CEFW-V02-270101

REVIEW DEADLINE: 1/1/2029

[1927] IECC 2024 – Table c403.3.2(6): Gas and Oil-Fired Boilers – Minimum Efficiency Requirements.

4.9.Miscellaneous End Use

4.9.1 Pump Optimization

DESCRIPTION

Pump improvements can be done to optimize the design and control of centrifugal water pumping systems, including water solutions with freeze protection up to 15% concentration by volume. Other fluid and gas pumps cannot use this measure calculation. The measurement of energy and demand savings for commercial and industrial applications will vary with the type of pumping technology, operating hours, efficiency, and existing and proposed controls. Depending on the specific application slowing the pump, trimming or replacing the impeller may be suitable options for improving pumping efficiency. Pumps up to 40 HP are allowed to use this energy savings calculation. Larger motors should use a custom calculation (which may result in larger savings that this measure would claim).

DEFINITION OF EFFICIENT EQUIPMENT

In order for this characterization to apply, the efficient equipment is proven to be an optimized centrifugal pumping system meeting the applicable program efficiency requirements:

Pump balancing valves no more than 15% throttled

Balancing valves on at least one load 100% open.

DEFINITION OF BASELINE EQUIPMENT

In order for this characterization to apply, the baseline equipment is assumed to be the existing pumping system including existing controls and sequence of operations.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 8 years.[1928]

DEEMED MEASURE COST

The incremental capital cost for this measure can vary considerably depending upon the strategy employed to achieve the required efficiency levels and should be determined on a site-specific basis.

LOADSHAPE

Loadshape C14: Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15: Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16: Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17: Indust. 4-shift (24/7) (e.g., comp. air, lights)

COINCIDENCE FACTOR

The summer peak coincidence factor for this measure is assumed to be 38%.[1929]

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (HP_{motor} * 0.746 * LF / \eta_{motor}) * HOURS * ESF$$

[1928] SCE Pump Test Final Report (2009), Summit Blue Consulting, LLC. This value is a weighted average of estimates provided by program participants.

[1929] Summer Peak Coincidence Factor has been preserved from the "Technical Reference Manual" (TRM) for Ohio Senate Bill 221 Energy Efficiency and Conservation Program and 09-512-GE-UNC," October 15, 2009. This is likely a conservative estimate, but is recommended for further study (as stated in the OH State TRM, page 269).

Where:

HP_{motor} = Installed nameplate motor horsepower

= Actual

0.746 = Conversion factor from horse-power to kW (kW/hp)

LF / η_{motor} = Combined as a single factor since efficiency is a function of load

= 0.65 [1930]

Where:

LF = Load Factor; Ratio of the peak running load to the nameplate rating of the motor

η_{motor} = Motor efficiency at pump operating conditions

HOURS = Annual operating hours of the pump

= Actual

ESF = Energy Savings Factor; assume a value of 15%.[1931]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (HP_{motor} * 0.746 * (LF / \eta_{motor})) * (ESF) * CF$$

Where:

CF = Summer Coincident Peak Factor for measure

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-PMPO-V04-220101

REVIEW DEADLINE: 1/1/2030

[1930] "Measured Loading of Energy Efficient Motors - the Missing Link in Engineering Estimates of Savings," ACEEE 1994 Summer Study Conference, Asilomar, CA.

[1931] Published estimates of typical pumping efficiency improvements range from 5 to 40%. For analysis purposes, assume 15%. United States Industrial Electric Motor Systems Market Opportunities Assessment December 2002, Table E-7, Page 18.

4.9.2 Computer Power Management Software – Retired 12/31/2026, Removed in v15

4.9.3 Modulating Commercial Gas Clothes Dryer

DESCRIPTION

This measure relates to the installation of a two-stage modulating gas valve retrofit kit on a standard commercial non-modulating gas dryer. Commercial gas clothes dryers found in coin-operated laundromats or on-premise laundromats (hospitals, hotels, health clubs, etc.) traditionally have a single firing rate which is sized properly for highest heat required in initial drying stages but is oversized for later drying stages requiring lesser heat. This causes the burner to cycle on/off frequently, resulting in less efficient drying and wasted gas. Replacing the single stage gas valve with a two-stage gas valve allows the firing rate to adjust to the changing heat demand, thereby reducing overall gas consumption.

This measure was developed to be applicable to the following program types: RF.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

A 30 to 250 pound capacity commercial gas dryer retrofitted with a two-stage modulating gas valve kit.

DEFINITION OF BASELINE EQUIPMENT

A 30 to 250 pound capacity commercial gas dryer with no modulating capabilities.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The deemed measure life for the retrofit kit is 10 years.[1932]

DEEMED MEASURE COST

The full retrofit cost is assumed to be $1,150.[1933]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

Note: Accurately estimating dryer energy consumption is complicated and challenging due to a variety of factors that influence cycle times and characteristics and ultimately drying energy requirements. Clothing loads can vary by weight, volume, fiber composition, physical structure, and initial water content, meaning that for any given cycle drying energy requirements can differ. Additionally, dryer settings selected by the user as well as interactions with the site's HVAC systems are known to influence dryer performance. As better information becomes available, this characterization can be modified to allow for a more site-specific estimation of savings.

[1932] Since this is a retrofit measure to an existing piece of equipment the measure life is less than the full life of the drier. Assumed to be 10 years as cost would be prohibitive for older machines that are likely to be need replacing soon.
[1933] NEEA Modulating Gas Valve for Commercial Dryer Study, August 24, 2023.

$\Delta Therms = N_{Cycles} * SF$

Where:

N_{Cycles} = Number of dryer cycles per year. Refer to the table below if this value is not directly available.

Application	Cycles per Year
Coin- Operated Laundromats[1934]	1,483
Multi-family Dryers[1935]	1,074
On-Premise Laundromats[1936]	3,607

SF = Savings factor

= 0.18 therms/cycle[1937]

If using default cycles the savings are as follows:

Application	ΔTherms
Coin- Operated Laundromats[1938]	267
Multi-family Dryers[1939]	193
On-Premise Laundromats[1940]	649

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-MODD-V03-270101

REVIEW DEADLINE: 1/1/2030

[1934] From DOE's Federal Register Notices, Energy Conservation Program: Energy Conservation Standards for Commercial Clothes Dryers, Office of Energy Efficiency & Renewable Energy.
[1935] Ibid.
[1936] Average value for dryer cycles in healthcare facility, hotels, drycleaners and laundromats from tests conducted in Nicor Gas Emerging Technology Program's Commercial Dryer Modulation Retrofit Public Project Report.
[1937] Based on Illinois weather data, and average dryer performance for laundromat (30 to 45lb) and hotel (75 to 170 lb) dryers. See GTI Analysis.xlsx for complete derivation.
[1938] From DOE's Federal Register Notices, Energy Conservation Program: Energy Conservation Standards for Commercial Clothes Dryers, Office of Energy Efficiency & Renewable Energy.
[1939] Ibid.
[1940] Average value for dryer cycles in healthcare facility, hotels, drycleaners and laundromats from tests conducted in Nicor Gas Emerging Technology Program's Commercial Dryer Modulation Retrofit Public Project Report.

4.9.4 High Speed Clothes Washer

DESCRIPTION

This measure applies to the installation of clothes washers with extraction speeds of 200G or greater, which is significantly higher than traditional hard-mount washers. Standard washer extractors in laundromats operate at speeds of 70-80G[1941]. The high-speed extraction process in the wash cycle removes more water from each compared to standard washers, reducing operating time and gas consumption of clothes dryers. Heat exposure and mechanical action are also reduced, resulting in less linen wear.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient equipment is assumed to be a clothes washer with an extraction speed of 200G or greater, installed in a commercial laundromat. This measure is only applicable for sites utilizing gas dryers. Sites using electric dryers are not eligible for participation.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is assumed to be a clothes washer with an extraction speed of 100G or less, installed in a commercial laundromat.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure lifetime is assumed to be the typical lifetime of a commercial clothes washer: 7 years.[1942]

For early replacement measures it is assumed the existing unit would last another 2.3 years.[1943]

DEEMED MEASURE COST[1944]

The incremental cost for time of sale is $11.83/lb capacity.

The full cost of the high speed washer for early replacement applications is $201.10/lb capacity. The deferred replacement cost of the baseline unit is $189.27/lb capacity. This future cost should be discounted to present value using the real discount rate.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

[1941] "The Real Size of a Front Load Washer", Laundromat123

[1942] "Assessment of Water Savings for Commercial Washers: Report on the Monitoring and Assessment of Water Savings from the Coin-Operated Multi-Load Clothes Washers Voucher Initiative Program." San Diego County Water Authority October 2016.

[1943] One-third of expected measure life.

[1944] Measure costs are based on data from a 2016 quote provided by a commercial washer distributor to Franklin Energy Services, adjusted for inflation.

FOSSIL FUEL SAVINGS

$$\Delta Therms = (Ncycles * Days * Capacity * RMC * h_e / \eta_{dryer} /100{,}000) * DryerUse * LF$$

Where:

Ncycles = Average number of washer cycles per day

= Use values from table below, depending on application

Application	Ncycles
Coin-operated Laundromats	4.3[1945]
Multifamily	3.4[1946]
Hotel/Motel/Hospital	10.4[1947]

Days = Days per year of commercial laundromat operation

= Actual, or if unknown, assume 360 days[1948]

Capacity = Clothes washer rated capacity (lb/cycle)[1949]

= Actual

RMC = Retained Moisture Content (%)[1950] reduction from replacing a low extraction speed washer

Washer Upgrade	RMC
100G to 200G	0.15[1951]
100G to 400G	0.25[1952]
200G to 400G	0.10[1953]

[1945] "2014-2015 State of the Self-Service Laundry Industry Report." Carlo Calma, April 13, 2015.

[1946] "Assessment of Water Savings for Commercial Washers: Report on the Monitoring and Assessment of Water Savings from the Coin-Operated Multi-Load Clothes Washers Voucher Initiative Program." San Diego County Water Authority October 2016.

[1947] "Laundry Planning Guide." EDRO, January 2015.

[1948] Based on professional judgement, assuming closed on holidays.

[1949] Clothes washer capacity is based on weight of dry clothing.

[1950] The EDRO "Laundry Planning Guide" describes moisture retention as "the ratio of retained moisture weight to clean dry textile weight." The pounds of water retained by clothing at the end of a wash cycle is calculated by multiplying Capacity (lbs of dry clothing per cycle) by RMC.

[1951] Using chart provided (Figure 1) and assuming a 50/50 cloth blend load of cotton and polyester, the retained moisture drops from approximately 65% to 50% when a 100 g washer is replaced with a 200 g washer. Chart from "Laundry Planning Guide." EDRO, January 2015. The Department of Energy test procedures for commercial clothes washers specifies, "…the use of energy test cloth consisting of a pure finished bleach cloth, made with a momie or granite weave, which is a blended fabric of 50-percent cotton and 50-percent polyester." – Energy Conservation Program: Energy Conservation Standards for Commercial Clothes Washers; Final Rule, Notice of Proposed Rulemaking, DOE, March 2014 (10 CFR Part 431).

[1952] Using chart provided (Figure 1) and assuming a 50/50 cloth blend load of cotton and polyester, retained moisture drops from approximately 65% to 40% when a 100 g washer is replaced with a 400 g washer.

[1953] Using chart provided (Figure 1) and assuming a 50/50 cloth blend load of cotton and polyester, retained moisture drops from approximately 50% to 40% when a 200 g washer is replaced with a 400 g washer.

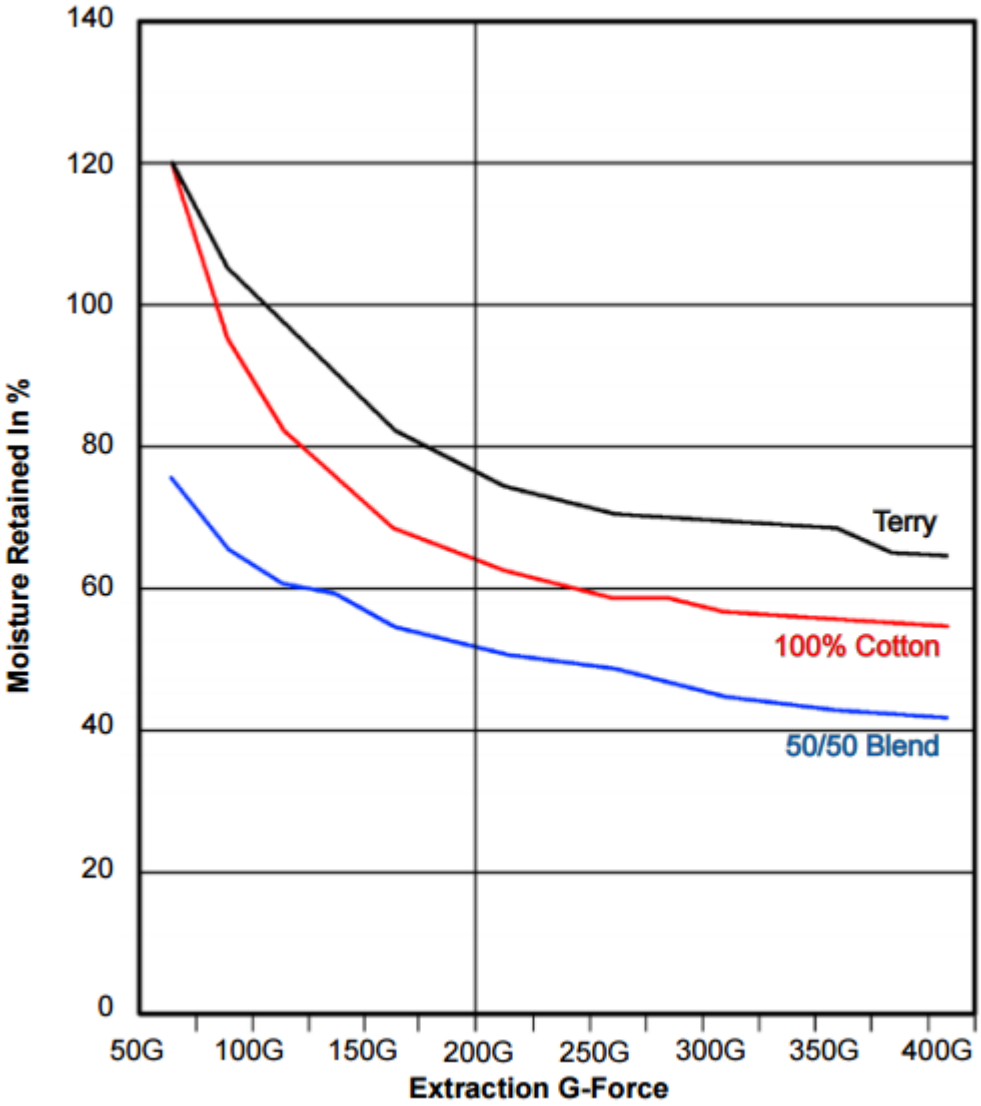

Figure 1

h_e = Heat required by a dryer to evaporate 1 lb of water

= Assume 1,200 Btu/lb[1954]

η_{dryer} = Efficiency of the clothes dryer

= Actual, or if unknown, assume 60%[1955]

100,000 = Converts Btus to therms

DryerUse = % of washer loads dried in the field

= Assume 91%[1956]

LF = Load Factor (%) to account for the pounds per washer load, as a percentage of rated capacity

[1954] "Laundry Planning Guide." EDRO, January 2015.
[1955] ACEEE (2010), "Are We Missing Energy Savings in Clothes Dryers?" Paul Bendt (Ecos), 2010
[1956] "Dryer Field Study." Northwest Energy Efficiency Alliance, November 20, 2014.

= Assume 66%[1957]

For example, a clothes washer with a 14 lb/cycle capacity and installed at a coin-operated laundromat, using default assumptions, would save:

ΔTherms = (Ncycles * Days * Capacity * RMC * h_e / η_{dryer} /100,000) * DryerUse * LF

= (4.3 * 360 * 14 * 0.25 * 1,200 / 0.60 /100,000) * 0.91 * 0.66

= 65 therms

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-HSCW-V04-250101

REVIEW DEADLINE: 1/1/2028

[1957]"Assessment of Water Savings for Commercial Washers: Report on the Monitoring and Assessment of Water Savings from the Coin-Operated Multi-Load Clothes Washers Voucher Initiative Program." San Diego County Water Authority October 2016.

4.9.5 ENERGY STAR Computers

DESCRIPTION

This measure estimates savings for a desktop computer with ENERGY STAR[1958] (ES) Version 9.0 rating, ES 9.0 with 80 PLUS Platinum PSUs, and ES 9.0 with 80 PLUS Titanium PSUs.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient product is a desktop with a rating of ENERGY STAR Version 9.0 rating, ES 9.0 with 80 PLUS Platinum PSUs, or ES 9.0 with 80 PLUS Titanium PSUs.

DEFINITION OF BASELINE EQUIPMENT

Non ENERGY STAR qualified equipment with standard efficiency power supply.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The life of this measure is 4 years.[1959]

DEEMED MEASURE COST[1960]

The incremental cost for an 80 Plus Desktop PSU is $5.
The incremental cost for an ENERGY STAR desktop PSU is $20.

LOADSHAPE

C21 Commercial Office Equipment

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS[1961]

$$\Delta kWh = 8760/1000 * (((Watts_{Base,Off} * \%Time_{Off}) + (Watts_{Base,Sleep} * \%Time_{Sleep}) + (Watts_{Base,Long} * \%Time_{Long}) + (Watts_{Base,Short} * \%Time_{Short})) - ((Watts_{Eff,Off} * \%Time_{Off}) + (Watts_{Eff,Sleep} * \%Time_{Sleep}) + (Watts_{Eff,Long} * \%Time_{Long}) + (Watts_{Eff,Short} * \%Time_{Short})))$$

Where (see assumptions in table below):

8760/1000 = Converts W to kWh

$Watts_{Base,Off}$ = baseline equipment power in off mode

[1958] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[1959] Codes and Standards Enhancement (CASE) Initiative For PY 2013: Title 20 Standards Development. Analysis of Standards Proposal for Computers, August 6, 2013. Section 2.3 Design Life, Page 15.
[1960] NEEA Research Into Action, 80 PLUS Market Progress Evaluation Report #5, November 26, 2013. Page 24. This value is further confirmed by the Federal Energy Management Program, which states "FEMP has calculated that the required ENERGY STAR-qualified desktop computer saves money if priced no more than $55 (in 2021 dollars) above the less efficient model." The incremental cost of $20 sits as a comfortable average of cost-saving computer
[1961] ENERGY STAR Program Requirements for Computers - Eligibility Criteria v9.0, Section 3.5.2.v., Equation 1: TEC Calculation (ETEC) for Desktop, Integrated Desktop, and Notebook Computers, pg 16.

$\%Time_{Off}$ = typical percent of time a desktop, integrated desktop or notebook is in off mode during the year

$Watts_{Base,Sleep}$ = baseline equipment power in sleep mode

$\%Time_{Sleep}$ = typical percent time in sleep mode

$Watts_{Base,Long}$ = baseline equipment power in long idle mode

$\%Time_{Long}$ = typical percent time in long idle mode

$Watts_{Base,Short}$ = baseline equipment power in short idle mode

$\%Time_{Short}$ = typical percent time in short idle mode

$Watts_{Eff,Off}$ = efficient equipment power in off mode

$Watts_{Eff,Sleep}$ = efficient equipment power in sleep mode

$Watts_{Eff,Long}$ = efficient equipment power in long idle mode

$Watts_{Eff,Short}$ = efficient equipment power in short idle mode

Measure Annual Mode Time (%)	Off	Sleep	Long Idle	Short Idle
Duty cycle – Commercial Desktop[1962]	15%	45%	10%	30%

Measure Watt Draw in Mode (Watts)	Off	Sleep	Long Idle	Short Idle
Baseline[1963]	0.88	2.1	26.5	27.9
ES 9.0 Desktops[1964]	0.53	1.72	9.06	14.79
ES 9.0 Desktops w/ 80 PLUS Platinum PSUs[1965]	0.50	1.50	8.5	13.8
ES 9.0 Desktops w/ 80 PLUS Titanium PSUs[1966]	0.50	1.50	8.3	13.5

Calculated energy consumption in each mode, and savings provided below:

Measure TEC by Mode - Commercial	Off	Sleep	Long Idle	Short Idle	TEC (kWh/yr)	Savings (kWh/yr)
Baseline	1.2	8.3	23.2	73.3	106.0	N/A
ES 9.0 Desktops	0.7	6.8	7.9	38.9	54.3	51.7
ES 9.0 Desktops w/ 80 PLUS Platinum PSUs	0.7	5.9	7.4	36.3	50.2	55.7

[1962] ENERGY STAR Program Requirements for Computers - Eligibility Criteria v9.0, Section 3.5.2.v., Table 4: Mode Weightings for Desktops and Integrated Desktop Computers, pg 16.

[1963] Codes and Standards Enhancement (CASE) Initiative For PY 2013: Title 20 Standards Development. Computers: Technical Report - Supplemental Analysis and Test Results, January 21, 2014.

[1964] Analysis of current DT I2 Category Desktops in the ENERGY STAR version 8.0 Qualified Products List (QPL) as accessed on 2/4/2025 (see File "ENERGY STAR_Computers_Analysis_2025.xlsx", Sheet "DT I2 Stats"). Version 8.0 QPL is used because this measure update is being made before version 9.0, and the associated QPL, becomes active on October 1st 2025.

[1965] 80 PLUS program savings calculator, additional 7% reduction in idle power levels over ENERGY STAR version 9.0 computers with 80 PLUS Silver PSU levels. The program calculator was used to establish relative and comparable savings, and as a result, absolute idle power values do not match. For more details on the derivation of the 6.7% savings factor, please see, "80 PLUS Desktop Savings_25Aug2014_Revised ESv8.xlsx", 'Analysis Summary' tab.

[1966] 80 PLUS program savings calculator, additional 9.1% reduction in idle power levels over ENERGY STAR version 9.0 computers with 80 PLUS Silver PSU levels. The program calculator was used to establish relative and comparable savings, and as a result, absolute idle power values do not match. For more details on the derivation of the 8.7% savings factor, please see, "80 PLUS Desktop Savings_25Aug2014_Revised ESv8.xlsx", 'Analysis Summary' tab.

Measure TEC by Mode - Commercial	Off	Sleep	Long Idle	Short Idle	TEC (kWh/yr)	Savings (kWh/yr)
ES 9.0 Desktops w/ 80 PLUS Titanium PSUs	0.7	5.9	7.2	35.5	49.3	56.7

Savings calculations can be referenced in "4.9.5 ENERGY STAR Computers Analysis_2025.xlsx"

SUMMER COINCIDENT PEAK DEMAND SAVINGS[1967]

$$\Delta kW = (Watts_{Base} - Watts_{Eff})/1000 * CF$$

Where:

$Watts_{Base}$ = Assumed average baseline wattage during peak period (see table below)

$Watts_{Eff}$ = Assumed average efficient wattage during peak period (see table below)

CF = Summer Peak Coincidence Factor

= 1.0

Calculated average demand during peak period, and savings provided below:

Measure Demand Reduction by Mode	TEC (Watts)	Long Idle Demand Savings (kW)	Short Idle Demand Savings (kW)	Weighted Average Demand Savings (kW)
Baseline	14.1	N/A	N/A	N/A
ES 8.0 Desktops	7.2	0.0174	0.0131	0.0142
ES 8.0 Desktops w/ 80 PLUS Platinum PSUs	6.6	0.0180	0.0141	0.0151
ES 8.0 Desktops w/ 80 PLUS Titanium PSUs	6.5	0.0182	0.0144	0.0154

Please note, the last column is a weighted average of the Long & Short Idle Modes and should be the value used in calculations. All Savings calculations can be referenced in "4.9.5 ENERGY STAR Computers Analysis_2025.xlsx"

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-COMP-V04-260101

REVIEW DEADLINE: 1/1/2027

[1967] It assumed that computers will not be off during peak period, and that the weighting of sleep, long idle and short idle during peak hours is consistent with the whole year. Wattage assumptions are weighted accordingly and coincidence factor is thus assumed to be 1.0 – see "ENERGY STAR Computers Analysis_2020_Revised.xlsx" for calculation.

4.9.6 Advanced Power Strip – Tier 1 Commercial

DESCRIPTION

This measure relates to Advanced Power Strips – Tier 1 which are multi-plug power strips with the ability to automatically disconnect specific connected loads depending upon the power draw of a control load, also plugged into the strip. Power is disconnected from the switched (controlled) outlets when the control load power draw is reduced below a certain adjustable threshold, thus turning off the appliances plugged into the switched outlets. By disconnecting, the standby load of the controlled devices, the overall load of a centralized group of equipment (e.g. a desk workstation) can be reduced. In a commercial office space, savings generally occur during off-hours, when connected equipment continues to consume electricity while in standby mode or when off. Uncontrolled outlets are also provided that are not affected by the control device and so are always providing power to any device plugged into it.

This measure was developed to be applicable to the following program types: DI, Kits.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is an advanced power strip with a load-sensing master plug and at least two controlled plugs.

DEFINITION OF BASELINE EQUIPMENT

The assumed baseline is a standard power strip with surge protection that does not control connected loads.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the advanced power strip is 7 years.[1968]

DEEMED MEASURE COST

For direct install the actual full equipment and installation cost (including labor) and for kits the actual full equipment cost should be used.

Equipment cost if unknown[1969]:

Baseline Cost	Efficient Cost	Incremental Equipment Cost
$20	$30	$10

LOADSHAPE

Loadshape C47 – Standby Losses – Commercial Office[1970]

COINCIDENCE FACTOR

N/A due to no savings attributable to standby losses between 1 and 5 PM.

[1968] This is a consistent assumption with 5.2.2 Advanced Power Strip – Tier 2.

[1969] Price survey performed by Illume Advising LLC for IL TRM workpaper, see "Current Surge Protector Costs and Comparison 7-2016" spreadsheet.

[1970] Loadshapes were calculated from empirical studies and compared to the existing loadshape in Volume 1, Table 3.5. The studies were:
Acker, Brad *et. al,* "Office Space Plug Load Profiles and Energy Saving Interventions," 2012 ACEEE Summer Study on Energy Efficiency in Buildings.
Sheppy, M. *et al*, "Reducing Plug Loads in Office Spaces" Hawaii and Guam Energy Improvement Technology Demonstration Project, NREL/NAVFAC (January 2014).

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

ΔkWh[1971] = $((kW_{wkday} * (hrs_{wkday} - hrs_{wkday\text{-}open})) + (kW_{wkend} * (hrs_{wkend} - hrs_{wkend\text{-}open}))) * weeks/year * ISR$

Where:

kW_{wkday} = Standby power consumption of connected electronics on weekday off-hours. If unknown, assume 0.0315 kW.

kW_{wkend} = Standby power consumption of connected electronics on weekend off-hours. If unknown, assume 0.00617 kW.

hrs_{wkday} = total hours during the work week (Monday 7:30 AM to Friday 5:30 PM)

= 106

hrs_{wkend} = total hours during the weekend (Friday 5:30 PM to Monday 7:30 AM)

= 62

$hrs_{wkday\text{-}open}$ = hours the office is open during the work week. If unknown, assume 48 hours[1972].

$hrs_{wkend\text{-}open}$ = hours the office is open during the weekend. If unknown, assume 0 hours.

weeks/year = number of weeks per year

= 52.2

ISR = In Service Rate

= Assume 0.969 for commercial Direct Install application[1973], or 0.71 for kit distribution and midstream programs[1974].

For example, an office open 9 hours per day (45 hours per week) on weekdays and 4 hours on Saturday:

$\Delta kWh = ((0.0315 * (106 - 45)) + (0.00617 * (62 - 4))) * 52.2 * 0.969$

= 115 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A due to no savings attributable to standby losses between 1 and 5 PM.

FOSSIL FUEL SAVINGS

N/A

[1971] Savings algorithm reconstructed from weekday and weekend savings information in Acker, Brad *et. al,* "Office Space Plug Load Profiles and Energy Saving Interventions," 2012 ACEEE Summer Study on Energy Efficiency in Buildings, and verified against savings in Acker *et. al* and savings in: BPA, "Smart Power Strip Energy Savings Evaluation: Ross Complex," (2011). Office stations are assumed to have zero or minimal standy losses during normal operating hours. Method shown in "Commercial Tier 1 APS Calculations – IL TRM.xlsx".

[1972] Unknown hours are based on a Guidehouse review of open hours for 487 participants in similar measure.

[1973] Based upon review of the PY2 and PY3 ComEd Direct Install Residential program surveys. This value could be modified based upon commercial application evaluation.

[1974] Based on survey data collected from ComEd 2018 and 2019 Small Business Kits Program. The 2018 ISR was 0.592 and the 2019 ISR was 0.835, the average being 0.71.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-APSC-V06-260101

REVIEW DEADLINE: 1/1/2028

4.9.7 High Efficiency Transformer

DESCRIPTION

Distribution transformers are used in commercial and industrial applications to step down power from distribution voltage to be used in HVAC or process loads (220V or 480V) or to serve plug loads (120V).

Distribution transformers that are more efficient than the required minimum federal standard efficiency qualify for this measure. If there is no specific standard efficiency requirement, the transformer does not qualify (because we cannot define a reasonable baseline). For example, although the federal standards increased the minimum required efficiency in 2016, most transformers with a NEMA premium or CEE Tier 2 rating will still achieve energy conservation. Standards are defined for low-voltage dry-type distribution transformers (up to 333kVA single-phase and 1000kVA 3-phase), liquid-immersed distribution transformers (up to 833kVA single-phase and 2500kVA 3-phase), and medium-voltage dry-type distribution transformers (up to 833kVA single-phase and 2500kVA 3-phase).

This measure was developed to be applicable to the following program types: TOS, NC.

If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Any transformer that is more efficient than the federal minimum standard. This includes CEE Tier II (single or three phase) and most NEMA premium efficiency rated products.

DEFINITION OF BASELINE EQUIPMENT

A transformer that meets the minimum federal efficiency requirement should be used as the baseline to calculate savings. Standards are developed by the Department of Energy and published in the Federal Register 10CFR 431.[1975]

The efficiency of a low-voltage dry-type, and liquid-immersed distribution transformer manufactured on or after January 1, 2016, shall be no less than that required for their kVA rating in the tables below. Distribution transformers with kVA ratings not appearing in the table shall have their minimum efficiency level determined by linear interpolation of the kVA and efficiency values immediately above and below that kVA rating.

(a) ***Low-Voltage Dry-Type Distribution Transformers.***

Single-phase		Three-phase	
kVA	Efficiency (%)	kVA	Efficiency (%)
15	97.70	15	97.89
25	98.00	30	98.23
37.5	98.20	45	98.40
50	98.30	75	98.60
75	98.50	112.5	98.74
100	98.60	150	98.83
167	98.70	225	98.94
250	98.80	300	99.02
333	98.90	500	99.14
		750	99.23
		1000	99.28

(b) ***Liquid-Immersed Distribution Transformers.***

[1975] US Department of Energy, "Energy Conservation Program: Energy Conservation Standards for Distribution Transformers; Final Rule", 10 CFR Part 431, Published April 18, 2013, Compliance effective as of January 1, 2016.

Single-phase		Three-phase	
kVA	Efficiency (%)	kVA	Efficiency (%)
10	98.70	15	98.65
15	98.82	30	98.83
25	98.95	45	98.92
37.5	99.05	75	99.03
50	99.11	112.5	99.11
75	99.19	150	99.16
100	99.25	225	99.23
167	99.33	300	99.27
250	99.39	500	99.35
333	99.43	750	99.40
500	99.49	1000	99.43
667	99.52	1500	99.48
833	99.55	2000	99.51
		2500	99.53

(c) ***Medium-Voltage Dry-Type Distribution Transformers.***

(2) The efficiency of a medium- voltage dry-type distribution transformer manufactured on or after January 1, 2016, shall be no less than that required for their kVA and BIL rating in the table below. Medium-voltage dry-type distribution transformers with kVA ratings not appearing in the table shall have their minimum efficiency level determined by linear interpolation of the kVA and efficiency values immediately above and below that kVA rating.

Single-phase				Three-phase			
kVA	BIL*			kVA	BIL		
	20-45 kV	46-95 kV	≥96 kV		20-45 kV	46-95 kV	≥96 kV
	Efficiency (%)	Efficiency (%)	Efficiency (%)		Efficiency (%)	Efficiency (%)	Efficiency (%)
15	98.10	97.86		15	97.50	97.18	
25	98.33	98.12		30	97.90	97.63	
37.5	98.49	98.30		45	98.10	97.86	
50	98.60	98.42		75	98.33	98.13	
75	98.73	98.57	98.53	112.5	98.52	98.36	
100	98.82	98.67	98.63	150	98.65	98.51	
167	98.96	98.83	98.80	225	98.82	98.69	98.57
250	99.07	98.95	98.91	300	98.93	98.81	98.69
333	99.14	99.03	98.99	500	99.09	98.99	98.89
500	99.22	99.12	99.09	750	99.21	99.12	99.02
667	99.27	99.18	99.15	1000	99.28	99.20	99.11
833	99.31	99.23	99.20	1500	99.37	99.30	99.21
				2000	99.43	99.36	99.28
				2500	99.47	99.41	99.33

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

30 years[1976]

[1976] US DOE lists lifetime at 32 years. For consistency with efficiency measure evaluated lifetimes, 30 years is the recommended maximum deemed lifetime. US Department of Energy, "Energy Conservation Program: Energy Conservation Standards for Distribution Transformers; Final Rule", 10 CFR Part 431, Published April 18, 2013, Effective as of January 1, 2016.

DEEMED MEASURE COST

Actual incremental costs should be used.

LOADSHAPE

Use custom loadshape based on application; default is Loadshape C67 (Ameren) or C68 (ComEd), which represent overall utility system loads.

COINCIDENCE FACTOR

Coincidence Factor for distribution transformers is 1.0 by definition. By including the load factor in the demand savings calculation, the load profile is accounted for.

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings are determined by metering equipment

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = Losses_{base} - Losses_{EE}$$

Where:

$$Losses_{base} = \text{PowerRating} * \text{LF} * \text{PF} * \left(\frac{1}{EFF_{base}} - 1\right) * 8766$$

$$Losses_{EE} = \text{PowerRating} * \text{LF} * \text{PF} * \left(\frac{1}{EFF_{EE}} - 1\right) * 8766$$

PowerRating = kVA rating of the transformer (in units of kVA)

EFF_{base} = baseline total efficiency rating of federal minimum standard transformer (refer to baseline tables above based on kVA, voltage, and type of transformer)

EFF_{EE} = actual total efficiency rating of the transformer as calculated by the appropriate DOE test method.[1977]

LF = Load Factor for the transformer. Ratio of average transformer load to peak load rating over a period of one year. Use actual load factor for the network segment served based on historical data. If unknown, assume 15.9% for commercial and industrial loads.[1978]

PF = Power Factor for the load being served by the transformer. Ratio of real power to apparent power supplied to the transformer. Use actual power factor for the network segment served. If unknown, use 1.0 (unity) by default.[1979]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \text{PowerRating} * \text{LF} * \text{PF} * \left(\frac{1}{Eff_{base}} - \frac{1}{Eff_{EE}}\right)$$

Variables as provided above.

FOSSIL FUEL SAVINGS

N/A

[1977] Energy Conservation Program: Test Procedures for Distribution Transformers; Final Rule. Effective May 30, 2006.
[1978] "Transformers Efficiency, Unwinding the Technical Potential" Cadmus Group, 1999. Based on the RMS average loading from 89 low-voltage transformers across 43 buildings of a variety of sectors.
[1979] Unity power factor for used as default value, as used in the test procedures provided by US DOE. Energy Conservation Program: Test Procedures for Distribution Transformers; Final Rule. Effective May 30, 2006.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-TRNS-V04-260101

REVIEW DEADLINE: 1/1/2029

4.9.8 High Frequency Battery Chargers

DESCRIPTION

This measure applies to industrial high frequency battery chargers, used for industrial equipment such as fork lifts, replacing existing SCR (silicon controlled rectifier) or ferroresonant charging technology. High frequency battery chargers have a greater system efficiency.

This measure was developed to be applicable to the following program types: TOS, NC, EREP. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

High frequency battery charger systems with minimum Power Conversion Efficiency of 90% and a minimum 8-hour shift operation five days per week.

DEFINITION OF BASELINE EQUIPMENT

SCR or ferroresonant battery charger systems with minimum 8-hour shift operation five days per week.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

15 years[1980]

DEEMED MEASURE COST

The deemed incremental measure cost is $813.[1981]

LOADSHAPE

Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)

COINCIDENCE FACTOR

The coincidence factor is assumed to be 0.0 for 1 and 2-shift operation and 1.0 for 3 and 4-shift operation.[1982]

Algorithm

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = (CAP * DOD) * CHG * (CR_B / PC_B - CR_{EE} / PC_{EE})$$

Where:

CAP = Capacity of Battery

= Use actual battery capacity, otherwise use a default value of 35 kWh[1983]

DOD = Depth of Discharge

[1980] Suzanne Foster Porter et al., "Analysis of Standards Options for Battery Charger Systems", (PG&E, 2010), 45.
[1981] Franklin Energy, Field Study of Industrial High Frequency Battery Chargers (2017), pg 9. Weighted average applied between FR and SCR market split.
[1982] Emerging Technologies Program Application Assessment Report #0808, Industrial Battery Charger Energy Savings Opportunities, Pacific Gas & Electric. May 29, 2009.
[1983] Jacob V. Renquist, Brian Dickman, and Thomas H. Bradley, :"Economic Comparison of fuel cell powered forklifts to battery powered forklifts", International Journal of Hydrogen Energy Volume 37, Issue 17, (2012): 2.

= Use actual depth of discharge, otherwise use a default value of 80%.[1984]

CHG = Number of Charges per year

= Use actual number of annual charges, if unknown use values below based on the type of operations[1985]

Standard Operations	Number of Charges per year
1-shift (8 hrs/day – 5 days/week)	520
2-shift (16 hrs/day – 5 days/week)	1040
3-shift (24 hrs/day – 5 days/week)	1560
4-shift (24 hrs/day – 7 days/week)	2184

CR_B = Baseline Charge Return Factor

= Actual existing (early replacement) or if unknown assume 1.1613[1986]

PC_B = Baseline Power Conversion Efficiency

= Actual existing (early replacement) or if unknown assume 0.85[1987]

CR_{EE} = Efficient Charge Return Factor

= Actual or 1.1500[1988] if unknown

PC_{EE} = Efficient Power Conversion Efficiency

= Actual or 0.92[1989] if unknown

Default savings using defaults provided above are provided below:

Standard Operations	ΔkWh
1-shift (8 hrs/day – 5 days/week)	1,692
2-shift (16 hrs/day – 5 days/week)	3,383
3-shift (24 hrs/day – 7 days/week)	5,075
4-shift (24 hrs/day – 7 days/week)	7,104

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = (PF_{EE} * PC_{EE} - PF_B * PC_B) * Volts_{DC} * Amps_{DC} / 1000 * CF$$

Where:

PF_B = Power factor of baseline charger

= Actual existing (early replacement) or if unknown assume 0.8600[1990]

PF_{EE} = Power factor of high frequency charger

[1984] Ryan Matley, "Measuring Energy Efficiency Improvements in Industrial Battery Chargers", (ESL-IE-09-05-32, Energy Technology Conference, New Orleans, LA, May 12-15, 2009), 4.

[1985] Number of charges is derived from the following reference and adjusted to the hours and days of the different types of shift operations. These values are based on an estimated 2-charge per 8-hour workday. See reference file Ryan Matley, "Measuring Energy Efficiency Improvements in Industrial Battery Chargers", (ESL-IE-09-05-32, Energy Technology Conference, New Orleans, LA, May 12-15, 2009), 4.

[1986] Ecos Consulting, "Emerging Technologies Program Application Assessment Report #0808" (2009), pg. 8

[1987] Ibid.

[1988] Ibid.

[1989] Ibid.

[1990] Ibid.

= Actual or 0.9600[1991] if unknown

$Volts_{DC}$ = Actual DC rated voltage output of charger (assumed baseline charger is replaced with same rated high frequency unit)

= Use actual battery DC voltage rating, otherwise use a default value of 48 volts.[1992]

$Amps_{DC}$ = Actual DC rated amperage output of charger (assumed baseline charger is replaced with same rated high frequency unit)

= Use actual battery DC ampere rating, otherwise use a default value of 81 amps.[1993]

1,000 = watt to kilowatt conversion factor

CF = Summer Coincident Peak Factor for this measure

= 0.0 (for 1 and 2-shift operation)[1994]

= 1.0 (for 3 and 4-shift operation)[1995]

Other variables as provided above.

Default savings using defaults provided above are provided below:

Standard Operations	ΔkW
1-shift (8 hrs/day – 5 days/week)	0
2-shift (16 hrs/day – 5 days/week)	0
3-shift (24 hrs/day – 5 days/week)	0.27209
4-shift (24 hrs/day – 7 days/week)	0.27209

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-BACH-V04-250101

REVIEW DEADLINE: 1/1/2030

[1991] Ibid.

[1992] Voltage rating based on the assumption of 35kWh battery with a normalized average amp-hour capacity of 760 Ah charged over a 7.5 hour charge cycle. Pacific Gas & Electric, "Emerging Technologies Program Application Assessment Report #0808", Industrial Battery Charger Energy Savings Opportunities. May 29, 2009. Page 8, Table 3.

[1993] Ampere rating based on the assumption of 35kWh battery with a normalized average amp-hour capacity of 760 Ah charged over a 7.5 hour charge cycle. Pacific Gas & Electric, "Emerging Technologies Program Application Assessment Report #0808", Industrial Battery Charger Energy Savings Opportunities. May 29, 2009. Page 8, Table 3.

[1994] Emerging Technologies Program Application Assessment Report #0808, Industrial Battery Charger Energy Savings Opportunities, Pacific Gas & Electric. May 29, 2009.

[1995] Ibid.

4.9.9 Commercial Clothes Dryer Moisture Sensor

DESCRIPTION

This measure applies to moisture sensing controllers installed on new or existing commercial natural gas clothes dryers controlled electronically. Moisture controllers detect when the load is dry, which will stop the cycle from consuming additional energy. Some new commercial dryers utilize moisture sensors, but the majority of older dryers, as well as many new models, still do not utilize moisture sensors. In a commercial dyer, when a load is drying, the heat will run completely on in the early stages. Then, it begins to cycle on and off more frequently as the load becomes drier. Traditional moisture sensors use a conductivity strip in the dryer drum. The wet load will contact the strip that completes the circuit. When the load is dry, the circuit is shorted that completes the drying cycle. Instead, this technology is a "plug and play" retrofit controller that uses patent-pending software to determine when the load is dry. When the load is dry, it overrides the existing controls to end the cycle, which shuts the drying cycle. This measure does not apply to mechanical timer dryers or to dryers with modulating valves installed.

Natural gas energy savings will be achieved by reduced drying times and correspondingly reduced natural gas consumption. Electric savings will also be achieved by reduced operating times.

This measure was developed to be applicable to following facility types:

- Hotel/Motel
- Miscellaneous - Fitness and Recreational Sports Centers
- Hospital
- Assisted Living Facilities
- Miscellaneous - Dry cleaning
- Multifamily

Moisture sensing controller retrofits could create significant energy savings opportunities at other larger facility types with on-premise laundry operations (such as correctional facilities, universities, and staff laundries); however, the results included in this analysis are based heavily on past project data for the applicable facility types listed above and may not apply to facilities outside of this list due to variances in number of loads and average pound (lbs.) capacity per project site. Projects at these facilities should continue to be evaluated through custom programs and the applicable facility types and the resulting analysis should be updated based on new information.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

A retrofit moisture controlling technology is added to new or existing commercial natural gas clothes dryers. Existing facilities must be able to confirm that they do not have moisture sensors (conductive strip type) or modulating gas valves installed on clothes dryers already before proceeding with the installation of this technology.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a conventional natural gas clothes dryer without a moisture sensor or a modulating gas valve installed.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The equipment effective useful life (EUL) is 10 years.[1996]

[1996] Since this is a retrofit measure to an existing piece of equipment the measure life is less than the full life of the drier. Assumed to be 10 years as cost would be prohibitive for older machines that are likely to need replacing soon.

DEEMED MEASURE COST

The full retrofit cost is assumed to be $600, including the material cost for the basic moisture control retrofit ($500) and the associated labor for installation ($100).[1997]

LOADSHAPE

Loadshape C55; Commercial Clothes Washer

COINCIDENCE FACTOR

The coincidence factor for this measure is dependent on the application:

Application	Coincidence Factor[1998]
Multi-family Dryers	0.15
On-Premise Laundromats	0.52

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

Electric energy savings are per retrofitted dryer.

$$\Delta kWh = N_{Cycles} * SF$$

Where:

N_{Cycles} = Number of dryer cycles per year. Refer to the table below if this value is not directly available from the facility.

Application	Cycles per Dryer Per Year
Multi-family Dryers[1999]	1,074
On-Premise Laundromats[2000]	3,607

SF = Savings factor

= 0.16 kWh/cycle[2001]

If using default cycles the savings are as follows:

Application	ΔkWh per Dryer
Multi-family Dryers	171.8
On-Premise Laundromats	577.1

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = \Delta kWh / Hours * CF$$

[1997] Based on Gas Technology Institute's analysis of cost data from "Nicor Gas Emerging Technology Program, 1069: Moisture Sensor Retrofit, Comprehensive Pilot Assessment Report," May 1, 2017.
[1998] In the absence of loadshape information for commercial applications, this is estimated by adjusting the residential coincidence factor proportionately by the relative number of loads (264 for residential and as described in this measure for commercial applications).
[1999] From DOE's Federal Register Notices - found here: http://energy.gov/eere/buildings/recent-federal-register-notices
[2000] Average value for dryer cycles in healthcare facility, hotels, drycleaners and laundromats from tests conducted in Nicor Gas Emerging Technology Program's Commercial Dryer Modulation Retrofit Public Project Report.
[2001] Savings factor based on engineering analysis of savings data from "Nicor Gas Emerging Technology Program, 1069: Moisture Sensor Retrofit, Comprehensive Pilot Assessment Report," May 1, 2017 and "Advanced Commercial Clothes Dryer Technologies Field Test," prepared by Gas Technology Institute for the Minnesota Department of Commerce, January 15, 2018.

Where:

Hours = Assumed Run hours of Clothes Dryer[2002]

Application	Hours
Multi-family Dryers	806
On-Premise Laundromats	2,705

CF = Summer Peak Coincidence Factor for measure.

Application	Coincidence Factor[2003]
Multi-family Dryers	0.15
On-Premise Laundromats	0.52

If using default cycles the savings are as follows:

Application	ΔkW per Dryer
Multi-family Dryers	0.0320
On-Premise Laundromats	0.1109

FOSSIL FUEL SAVINGS

Natural gas savings are per retrofitted dryer.

$\Delta Therms = N_{Cycles} * SF$

Where:

SF = Savings factor

= 0.15 therms/cycle[2004]

If using default cycles the savings are as follows:

Application	ΔTherms per Dryer
Multi-family Dryers	161
On-Premise Laundromats	541

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-CDMS-V02-230101

REVIEW DEADLINE: 1/1/2031

[2002] Estimate based on 45 minutes per cycle.

[2003] In the absence of loadshape information for commercial applications, this is estimated by adjusting the residential coincidence factor proportionately by the relative number of loads (264 for residential and as described in this measure for commercial applications).

[2004] Savings factor based on engineering analysis of savings data from "Nicor Gas Emerging Technology Program, 1069: Moisture Sensor Retrofit, Comprehensive Pilot Assessment Report," May 1, 2017 and "Advanced Commercial Clothes Dryer Technologies Field Test," prepared by Gas Technology Institute for the Minnesota Department of Commerce, January 15, 2018.

4.9.10 Efficient Thermal Oxidizers

DESCRIPTION

Thermal oxidizers are used to destroy volatile organic compounds (VOCs) from process exhausts, before emitting the treated air to the environment. VOC emissions are precursors to the formation of ground-level ozone pollution, and its control is mandated by the U.S. EPA. Some VOC constituents are individually toxic and require efficient destruction. Some waste streams have high enough concentrations to present an explosion hazard. Other waste streams merely present nuisance odors that need to be mitigated.

A facility may be required to utilize a thermal oxidizer by a state regulatory agency air quality permit. Some permits may require a VOC destruction efficiency that must be demonstrated with periodic emissions testing. Other permits merely require maintaining an oxidizer chamber temperature. A facility may also choose to utilize a thermal oxidizer for other purposes (nuisance odors) without a regulatory requirement.

The Efficient Thermal Oxidizer measure seeks to evaluate fossil fuel savings from utilizing more efficient means for VOC destruction with the use of a recuperative or regenerative thermal oxidizer. The heat recovery (either recuperative or regenerative) is used to pre-heat the inlet process air stream. This primary heat recovery is used within the thermal oxidizer process and the only heat recovery that is covered in this measure protocol. Fossil fuel savings will result from reduced burner firing. There is a "secondary" form of heat recovery that recovers heat from the combustion exhaust stack for other purposes like space heating, DHW heating, etc.

DEFINITION OF EFFICIENT EQUIPMENT

Two thermal oxidizer technologies can be considered as efficient equipment: recuperative and regenerative.

Recuperative Thermal Oxidizer

In a recuperative thermal oxidizer, the exhaust air stream is sent through a heat exchanger to indirectly pre-heat the inlet air stream coming from the process. The heat exchanger efficiency for a recuperator is typically 50-70%.[2005] The chamber temperature is typically 1,400°F to 1,500°F.

Regenerative Thermal Oxidizer

A regenerative thermal oxidizer utilizes a two-chamber ceramic bed as its heat exchanger system. The exhaust air passes through one bed, imparting its heat onto the ceramic media, while the intake air passes through the other bed, capturing the waste heat from the previous cycle. The flow reverses every few minutes so that the intake bed becomes the exhausted bed and vice versa. The heat exchanger efficiency of a regenerative system is much higher than a recuperative system. These efficiencies can reach 85% to 97%.[2006] However, the ceramic media needs to be periodically cleaned or replaced. The chamber temperatures in regenerative thermal oxidizers are typically 1,500°F to 1,600°F (depending on VOC requirements).

DEFINITION OF BASELINE EQUIPMENT

Depending on the facility process, there may be two baseline selection options: incinerator or recuperator.

The baseline thermal oxidizer with no heat recovery is referred to as an incinerator. This baseline is recommended for selection if it currently exists on site or in new construction when there is a specific process that cannot practically utilize a recuperator due to VOCs coating or clogging the heat exchanger. This system employs a burner to provide direct fire to a process exhaust air stream. Typical operative temperatures are 1,400°F to 2,200°F. The advantage of an afterburner is a quick startup and shutdown time that is ready on demand. The equipment cost is lower than the efficient equipment, but the fuel consumption is much higher.

In all other cases (existing equipment is recuperative or new construction/ expansion of manufacturing process), a recuperative thermal oxidizer is recommended as the appropriate baseline.

[2005] Presentation on the "Operating Cost Reduction Strategies for Oxidizers", presented by Rich Grzanka, during the Chem Show Technology Exposition on October 31, 2007.
[2006] Ibid.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected useful life of any thermal oxidizer system is assumed to 20 years.[2007]

DEEMED MEASURE COST

The cost of any thermal oxidizer is dependent on various variables such as air flow capacity, destruction efficiency, heat exchanger efficiency, etc.[2008] Shown below is an example of a system for 20,000 cfm.

Recuperative thermal oxidizer costs, based on their heat recovery efficiency, are detailed in the table below.

Heat Recovery Efficiency	Equipment Cost
0%	$106,042
35%	$174,193
50%	$203,801
70%	$253,801
Average	$184,317

A regenerative thermal oxidizer at 95% heat recovery has a deemed cost of $546,000.

Incinerator cost is treated as 0% heat recovery in the recuperative cost summary table above and has a deemed cost of $106,042.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings from thermally efficient equipment are entirely fossil fuel related. There are no electricity savings nor peak demand savings, as the blower fans and valve actuators are assumed to operate the same in all conditions.

ELECTRIC ENERGY SAVINGS

N/A

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

ΔTherms = ((Baseline QT Air Pollution Control Device - Proposed QT Air Pollution Control Device) x Hours) / LHV

Where:

LHV = Latent Heat of Vaporization

= If the post is regenerative thermal oxidizer, LHV = 0.953.

= If the post is recuperative thermal oxidizer, LHV = 1.

[2007] EPA Air Pollution Control Cost Manual, Chapter 2, November 2017. The system capital recovery cost is based on an estimated 20-year equipment life. This estimate of oxidizer equipment life is consistent with information available to EPA and is consistent with statements from large vendors for incinerators and oxidizers.

[2008] U.S. Environmental Protection Agency, Incinerators and Oxidizers, Chapter 2, November 2017.

Regenerative or Recuperative: A baseline or proposed regenerative or recuperative air pollution control device can each be modeled in the following heat balance equation:[2009]

Q_T (btuh) = $Q_I + Q_{CC} + Q_{RL} – Q_{VOC}$

Incinerator: A baseline incinerator air pollution control device can be modeled as the following heat balance equation:

Q_T (btuh) = $Q_I + Q_{CC} + Q_{RL}$

Where:

Q_T = Total Energy Input

Q_I = Energy (btuh) used to raise the temperature of process air (F_I)

Q_{CC} = Heat (btuh) used to raise the temperature of combustion air (F_{CC})

Q_{RL} = Radiation heat loss (btuh) from Regenerative thermal oxidizer

Q_{VOC} = Heat release (btuh) provided by VOC combustion

Hours = Annual hours per year that oxidizer is used

Where:

$Q_I = F_I * 1.08 * (T_O – T_I)$

T_O = Average stack outlet temperature (°F) (actual trended average or use efficiency equation below to solve for T_O under assumed conditions)

$T_O = \frac{(T_C - (N * (T_C - T_I))) * F_I}{(F_I + F_{CC})}$

T_C = Combustion chamber temperature (°F), trended or design value provided by the manufacturer

N = Thermal Efficiency of Heat Exchanger

Thermal Oxidizer	Efficiency
Regenerative	97%
Recuperative	70%
Incinerator	0%

T_I = Inlet air temperature (°F), this is the temperature of the air coming from the process

F_I = Process air flow (cfm), actual loading or use maximum design value

1.08 = Conversion Factor

= 60 (min/hr) * 0.07489 (lb/ft^3, density air at standard conditions) * 0.2404 btu/°F-lb, (specific heat of air), where 0.2404 is average heat capacity of intake air

Where:

$Q_{CC} = F_{CC} * 1.08 * (T_C – T_A)$

F_{CC} = Additional combustion air flow (cfm) at provided F_I value

= If unknown, assume 3% of design value[2010]

T_C = Combustion chamber temperature (°F) (same as above)

[2009] ICAC Guidance Method for Estimation of Gas Consumption in a Regenerative Thermal Oxidizer (RTO), July 2002.
[2010] Ibid.

T_A = Combustion intake air temperature (°F)

= Indoor: Actual, or assume 70 °F year-round

= Outdoor: Actual annual average found near the facility, or assume annual averages below:

Climate Zone	Average Outdoor Air Temperature (°F)[2011]
1 (Rockford)	49.7
2 (Chicago)	51.4
3 (Springfield)	54.3
4 (Belleville)	58.0
5 (Marion)	56.8

Where:

Q_{RL} = SA * HLF

SA = Thermal oxidizer exterior surface area (ft^2) (provided by the manufacturer or rough measurements taken)

HLF = Assume a heat loss factor of 240 btuh/ft^2 if installed outdoors; otherwise, 0 btuh/ft^2 for indoor installation since the waste heat provides space heating and offset gas-fired space heating equipment

Where:

Q_{VOC} = VOC * HC * (%Dest / 100)

VOC = Average lbs/hr from process to oxidizer

HC = btu/lb, weighted average for the heat of combustion of VOCS

= Site-specific, lookup table

%Dest = Destruction efficiency of VOCs provided by the manufacturer, or use:

Hours = Annual hours of operation of the air pollution control device, assume customer production schedule or hours of occupancy

LHV = Lower heating value of natural gas

= 983 btu/CF[2012]

HHV = High heating value of natural gas

= 1,031 btu/CF[2013]

0.953 = LHV / HHV conversion factor

To calculate the fossil fuel savings by upgrading from an incinerator to an efficient thermal oxidizer system, the new temperatures must be considered. The addition of heat recovery (either recuperative or regenerative) will increase the inlet temperature, T_I, above that found in the facility.

[2011] National Centers for Environmental Information (NCEI) 15 yr US Climate Normals 2006-2020. Average Annual Temperatures taken for each climate zone (ANN-TAVG-NORMAL)

[2012] Biomass Energy Data Book, 2011, Appendix A: Lower and Higher Heating Values of Gas, Liquid, and Solid Fuels.

[2013] Heat content of natural gas delivered to consumers per the Energy Information Administration, Independent Statistics & Analysis, 2018.

The calculation should consider changes in the inlet temperature. First, the key temperature required for 99.99% destruction efficiency of various VOC compounds must be determined. The U.S. EPA's Innovative Strategies and Economics Group produced some guidance on the key temperatures[2014] for the following compounds:

VOC Compound	Key Destruction Temperature (°F)
Acrylonitrile	1,344
Allyl chloride	1,276
Benzene	1,350
Chlorobenzene	1,407
1,2 – dichloromethane	1,368
Methyl chloride	1,596
Toluene	1,341
Vinyl chloride	1,369

For VOC compounds not listed above, the Key Destruction Temperature should be determined through product literature, equipment vendors, Material Data Safety Sheets (MSDS), or some other source.

When employing heat recovery, either recuperative or regenerative, the increased outlet temperature is limited to the heat exchanger efficiency. This efficiency, or in other words how much heat can be recovered, is limited to the auto-ignition temperatures of the VOCs in the air stream. Regenerative thermal oxidizers offer the advantage of recovering more heat as the combustion can occur within the heat exchanger, whereas with recuperative thermal oxidizers, the heat exchanger efficiency is much lower to prevent premature combustion in the stack of the recuperator.

While the VOCs in the waste air stream have some heating value that contributes to reaching the required chamber temperature, such contributions do not have as high of an impact in the overall energy consumption calculation when compared to the heat exchanger efficiency.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A, as VOCs are still oxidized under the baseline condition and not contributing to overall site emissions.

DEEMED O&M COST ADJUSTMENT CALCULATION

The ceramic media in the regenerative thermal oxidizer requires regular servicing and may need to be considered as a regular part of facility O&M.

MEASURE CODE: CI-MSC-ETOX-V03-260101

REVIEW DEADLINE: 1/1/2030

[2014] U.S. Environmental Protection Agency, Incinerators and Oxidizers, Chapter 2, November 2017.

4.9.11 Variable Speed Drives for Process Fans

DESCRIPTION

This measure is applied to variable speed drives (VSD) which are installed on non-HVAC fans for process loads. There are separate measures for HVAC pumps and cooling tower fans (4.4.17) and HVAC supply and return fans (4.4.26). VSD process pump applications require custom analysis by the program administrator. The VSD will modulate the speed of the motor when it does not need to run at full load. Since the power of the motor is proportional to the cube of the speed for these types of applications, significant energy savings will result.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The VSD is applied to a motor which does not have a VSD. The application must have a variable load and installation is to include the necessary controls. Savings are based on application of VSDs to a range of baseline load conditions including no control, inlet guide vanes, outlet guide vanes and throttling valves.

DEFINITION OF BASELINE EQUIPMENT

The time of sale baseline is a new motor installed without a VSD or other methods of control. Retrofit baseline is an existing motor operating without a method of variable control. This information shall be collected from the customer.

Installations of new equipment with VSDs which are required by IECC, the energy code as adopted by the State of Illinois are not eligible for incentives.

Note, IECC 2024 became effective 11/30/2025. IECC 2021 is the requisite code for any projects with permitting dates spanning January 1, 2024 to November 29, 2025, while IECC 2018 covers any projects with permitting dates spanning July 1, 2019 to 12/31/2023. Prior to July 1, 2019, IECC 2015 is the applicable code. As code requirements and adoption can differ from municipality to municipality, the user should verify which version of code is applicable given these constraints.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is 15 years.[2015]

DEEMED MEASURE COST

The costs vary based on the motor horsepower and application. Actual costs should be used. For default cost estimates, please see table below.[2016]

HP	Cost
5 HP	$2,147
10 HP	$2,494
15 HP	$3,940
20 HP	$4,389
25 HP	$4,839
30 HP	$5,289
40 HP	$6,188
50 HP	$7,088
60 HP	$8,463
75 HP	$9,552

[2015] ComEd Effective Useful Life Research Report (2018), Navigant, May 14, 2018

[2016] Default incremental costs are sourced from NEEP Incremental Cost Study (ICS) – Phase II Final Report, Navigant, 2013. The VFD costs from the NEEP ICS was further manipulated in 2017 by iTron to account for inflation, other jurisdictions, and other horsepower and application considerations. The default incremental costs assume an average between VFDs with and without bypasses and adjusted to 2023 values to account for inflation.

HP	Cost
100 HP	$11,365

LOADSHAPE

Time-based schedule considerations are required to perform energy savings calculations and should be concurrently used to establish the savings loadshape that is in alignment with relevant loadshape components and definitions.

COINCIDENCE FACTOR

The demand savings factor (DSF) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

Algorithm

CALCULATION OF SAVINGS

ELECTRIC ENERGY SAVINGS

$\text{kWh}_{\text{Base}} = \left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times RHRS \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Base})$

$\text{kWh}_{\text{Retrofit}} = \left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times RHRS \times \sum_{0\%}^{100\%} (\%FF \times PLR_{Retrofit})$

$ESF = (\text{kWh}_{\text{Base}} - \text{kWh}_{\text{Retrofit}})/\text{kWh}_{\text{Base}}$

$\Delta\text{kWh}_{\text{total}} = \text{kWh}_{\text{Base}} \times ESF$

Where:

kWh_{Base} = Baseline annual energy consumption (kWh/yr)

$kWh_{Retrofit}$ = Retrofit annual energy consumption (kWh/yr)

ESF = Energy savings factor; If ESF is greater than 67%, cap the ESF at 67% for process fan VSD improvements.[2017]

ΔkWh_{total} = Total project annual energy savings

0.746 = Conversion factor for HP to kWh

HP = Nominal horsepower of controlled motor

LF = Load Factor; Motor Load at Fan Design CFM (Default = 65%)[2018]

η_{motor} = Installed nominal/nameplate motor efficiency

= Default motor is a NEMA Premium Efficiency, ODP, 4-pole/1800 RPM fan motor

NEMA Premium Efficiency Motors Default Efficiencies[2019]

[2017] *Recommendations for Verifying Savings for non-HVAC VFDs* memorandum calculated an energy savings limit of 67% for process fans using the Toshiba Energy Savings Software for Motors and Drives (2009 version).
[2018] Lawrence Berkeley National Laboratory, and Resource Dynamics Corporation. (2008). "Improving Motor and Drive System Performance; A Sourcebook for Industry". U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy. Golden, CO: National Renewable Energy Laboratory.
[2019] Douglass, J. (2005). Induction Motor Efficiency Standards. Washington State University and the Northwest Energy Efficiency Alliance, Extension Energy Program, Olympia, WA, October 2005.

Size HP	Open Drip Proof (ODP)			Totally Enclosed Fan-Cooled (TEFC)		
	# of Poles			# of Poles		
	6	4	2	6	4	2
	Speed (RPM)			Speed (RPM)		
	1200	1800 Default	3600	1200	1800	3600
1	0.825	0.855	0.770	0.825	0.855	0.770
1.5	0.865	0.865	0.840	0.875	0.865	0.840
2	0.875	0.865	0.855	0.885	0.865	0.855
3	0.885	0.895	0.855	0.895	0.895	0.865
5	0.895	0.895	0.865	0.895	0.895	0.885
7.5	0.902	0.910	0.885	0.910	0.917	0.895
10	0.917	0.917	0.895	0.910	0.917	0.902
15	0.917	0.930	0.902	0.917	0.924	0.910
20	0.924	0.930	0.910	0.917	0.930	0.910
25	0.930	0.936	0.917	0.930	0.936	0.917
30	0.936	0.941	0.917	0.930	0.936	0.917
40	0.941	0.941	0.924	0.941	0.941	0.924
50	0.941	0.945	0.930	0.941	0.945	0.930
60	0.945	0.950	0.936	0.945	0.950	0.936
75	0.945	0.950	0.936	0.945	0.954	0.936
100	0.950	0.954	0.936	0.950	0.954	0.941
125	0.950	0.954	0.941	0.950	0.954	0.950
150	0.954	0.958	0.941	0.958	0.958	0.950
200	0.954	0.958	0.950	0.958	0.962	0.954
250	0.954	0.958	0.950	0.958	0.962	0.958
300	0.954	0.958	0.954	0.958	0.962	0.958
350	0.954	0.958	0.954	0.958	0.962	0.958
400	0.958	0.958	0.958	0.958	0.962	0.958
450	0.962	0.962	0.958	0.958	0.962	0.958
500	0.962	0.962	0.958	0.958	0.962	0.958

$RHRS$ = Annual operating hours of process fan. Actual hours should be used.

$\%FF$ = Percentage of run-time spent within a given flow fraction range.

Fans used in process applications operate under site-specific conditions. The percentage of run-time spent within each of the given ranges in the table below should be field collected.

Flow Fraction (% of design cfm)	Percent of Time at Flow Fraction
0% to 10%	Field Collected for each bin.
>10% to 20%	
>20% to 30%	
>30% to 40%	
>40% to 50%	
>50% to 60%	
>60% to 70%	
>70% to 80%	

Flow Fraction (% of design cfm)	Percent of Time at Flow Fraction
>80% to 90%	
>90% to 100%	

PLR_{Base} = Part load ratio for a given flow fraction range based on the baseline flow control type

$PLR_{Retrofit}$ = Part load ratio for a given flow fraction range based on the retrofit flow control type

Control Type	Flow Fraction									
	0-10%	>10% to 20%	>20% to 30%	>30% to 40%	>40% to 50%	>50% to 60%	>60% to 70%	>70% to 80%	>80% to 90%	>90% to 100%
No Control or Bypass Damper	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Discharge Dampers	0.46	0.55	0.63	0.70	0.77	0.83	0.88	0.93	0.97	1.00
Outlet Damper, BI & Airfoil Fans	0.53	0.53	0.57	0.64	0.72	0.80	0.89	0.96	1.02	1.05
Inlet Damper Box	0.56	0.60	0.62	0.64	0.66	0.69	0.74	0.81	0.92	1.07
Inlet Guide Vane, BI & Airfoil Fans	0.53	0.56	0.57	0.59	0.60	0.62	0.67	0.74	0.85	1.00
Inlet Vane Dampers	0.38	0.40	0.42	0.44	0.48	0.53	0.60	0.70	0.83	0.99
Outlet Damper, FC Fans	0.22	0.26	0.30	0.37	0.45	0.54	0.65	0.77	0.91	1.06
Eddy Current Drives	0.17	0.20	0.25	0.32	0.41	0.51	0.63	0.76	0.90	1.04
Inlet Guide Vane, FC Fans	0.21	0.22	0.23	0.26	0.31	0.39	0.49	0.63	0.81	1.04
VFD with duct static pressure controls	0.09	0.10	0.11	0.15	0.20	0.29	0.41	0.57	0.76	1.01
VFD with low/no duct static pressure	0.05	0.06	0.09	0.12	0.18	0.27	0.39	0.55	0.75	1.00

$\sum_{0\%}^{100\%}(\%FF \times PLR)$ = The sum of the product of the percentage of run-time spent within a given flow fraction range (%FF) and the part load ratio for a given flow fraction range based on the retrofit flow control type.

Example: A process fan with discharge damper controls operates 85% of the time at 75% flow fraction, 5% of the time at 80% flow fraction, and 10% of the time at 95% flow fraction:

$\sum_{0\%}^{100\%}(\%FF \times PLR)$ = (0.85 x 0.93) + (0.05 x 0.97) + (0.10 x 1.00)

= 0.939%

SUMMER COINCIDENT PEAK DEMAND SAVINGS

kW_{Base} = $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times PLR_{Base,FFpeak}$

$kW_{Retrofit}$ = $\left(0.746 \times HP \times \frac{LF}{\eta_{motor}}\right) \times PLR_{Retrofit,FFpeak}$

ΔkW_{fan} = $kW_{Base} - kW_{Retrofit}$

Where:

kW_{Base} = Baseline summer coincident peak demand (kW)

$kW_{Retrofit}$	= Retrofit summer coincident peak demand (kW)
ΔkW_{fan}	= Fan-only summer coincident peak demand impact
ΔkW_{total}	= Total project summer coincident peak demand impact
$PLR_{Base,FFpeak}$	= The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the baseline flow control type (default average flow fraction during peak period = 90%)
$PLR_{Retrofit,FFpeak}$	= The part load ratio for the average flow fraction between the peak daytime hours during the weekday peak time period based on the retrofit flow control type (default average flow fraction during peak period = 90%)

FOSSIL FUEL IMPACT DESCRIPTIONS AND CALCULATION

There are no expected fossil fuel impacts for this measure.

WATER IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-VSDP-V05-270101

REVIEW DEADLINE: 1/1/2028

4.9.12 Low Flow Toilets and Urinals

DESCRIPTION

Toilets and urinals are found in bathrooms located in commercial, and industrial facilities. The first federal standards dealing with water consumption for toilets and urinals was the Energy Policy Act of 1992. It specified a gallon per flush (gpf) standard for both fixtures. These standards are used to define the baseline equipment for this measure. The Subsequent U.S. EPA WaterSense program in 2009 set even tighter standards for plumbing fixtures, including toilets and urinals. These standards are used to define the efficient equipment for this measure.

DEFINITION OF EFFICIENT EQUIPMENT

The high efficiency equipment is either a U.S. EPA WaterSense certified commercial toilet fixture or commercial urinal.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is a toilet or urinal that has a maximum gallons per flush outlined by the Energy Policy Act of 1992.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The estimated useful life for this measure is assumed to be 25 years for both toilets and urinals.[2020]

DEEMED MEASURE COST

The incremental costs for both toilets and urinals are $0.[2021]

LOADSHAPE

Loadshape C02 - Commercial Electric DHW

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

The following savings should be included in the total savings for this measure but should not be included in TRC tests to avoid double counting the economic benefit of water savings.

$\Delta kWh = \Delta Water / 1{,}000{,}000 * E_{water}$ total

E_{water} = IL Total Water Energy Factor (kWh/Million Gallons)

= 5,010[2022]

[2020] ATD Home Inspection: http://www.atdhomeinspection.com/advice/average-product-life/ is 50 years. 25 years is used to be conservative.

[2021] Measure cost assumption from City of Fort Collins, "Green Building Practice Summary," March 21, 2011, page 2. The document states "Information from the EPA WaterSense web site: WaterSense® labeled toilets are not more expensive than regular toilets. MaP testing results have shown no correlation between price and performance. Prices for toilets can range from less than $100 to more than $1,000. Much of the variability in price is due to style, not functional design."

[2022] This factor includes 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information, please review Elevate Energy's Review 'IL TRM: Energy per Gallon Factor, May 2018'.

Toilet Calculation:

For example, a low flow toilet is installed in a commercial location.

ΔkWh = 491 gal/year / 1,000,000 * 5,010 kWh/million gallons

= 2.5 kWh/year

Urinal Calculation:

For example, a low flow urinal is installed in a commercial location.

ΔkWh = 2,340 gal/year / 1,000,000 * 5,010 kWh/million gallons

= 11.7 kWh/year

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER IMPACT DESCRIPTIONS AND CALCULATION

$$\Delta Water = (GPF_{Base} - GPF_{Eff}) * NFPD * ADPY$$

Where:

GPF_{Base} = Baseline equipment gallons per flush

= 1.6 for toilets[2023]

= 1.0 for urinals[2024]

GPF_{Eff} = Efficient equipment gallons per flush

= Actual, if unknown assume 1.28 for toilets[2025]

= Actual, if unknown assume 0.5 for urinals[2026]

NFPD = Number of flushes per day

= 5.9 for toilets[2027]

= 18 for urinals[2028,2029]

ADPY = Annual days per year

= 260 for commercial and industrial[2030]

[2023] U. S. EPA WaterSense. "Water Efficiency Management Guide – Bathroom Suite" (EPA 832-F-17-016d), Nov 2017.
[2024] U.S. EPA WaterSense. "WaterSenses Specification for Flushing Urinals Supporting Statement", Oct 2009.
[2025] U. S. EPA WaterSense. "Water Efficiency Management Guide – Bathroom Suite" (EPA 832-F-17-016d), Nov 2017.
[2026] U.S. EPA WaterSense. "WaterSenses Specification for Flushing Urinals Supporting Statement", Oct 2009.
[2027] CASE Initiative for PY 2013: Analysis of Standards Proposal for Toilets and Urinals Water Efficiency. July 29, 2013. Pg 18.
[2028] Ibid.
[2029] U.S. EPA WaterSense. "WaterSenses Specification for Flushing Urinals Supporting Statement", Oct 2009. Pg 1.
[2030] Assuming the work week is Monday through Friday.

Toilet Calculation:

For example, a low flow toilet is installed in a commercial location.

ΔWater = [(1.6 – 1.28) gal/flush x 5.9 flush/day x 260 days/year

= 491 gal/year

Urinal Calculation:

For example, a low flow urinal is installed in a commercial location.

ΔWater = (1.0 – 0.5) gal/flush x 18 flush/day x 260 days/year

= 2,340 gal/year

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-LFTU-V02-210101

REVIEW DEADLINE: 1/1/2030

4.9.13 Smart Irrigation Controls

DESCRIPTION

Irrigation systems are commonly found on commercial properties, educational institutions, public parks, golf courses, and other facilities with landscaped grounds. They are typically operated on timers, applying the irrigation water in the early morning or after dusk. The timing and duration of irrigation application are determined by the user, along with the location and density of sprinklers. The irrigation water gets applied according to the control schedule, regardless of whether the landscape actually needs the irrigation water at that time.

The new measure involves the installation of a control system technology that reduces or eliminates irrigation during times of precipitation or when there is already sufficient soil moisture. This measure applies to landscape irrigation systems for commercial, institutional, and public properties only. It does not apply to agricultural irrigation systems for crops or residential landscape irrigation systems.

This measure was developed to be applicable to the following program types: TOS, RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Smart Irrigation Controls utilize sensors, gauges, or local weather forecasts to regulate the application of irrigation water to lawn or landscape vegetation. There are two main technologies used for this purpose: 1) Precipitation based smart irrigation controllers, and 2) Soil-moisture based smart irrigation controllers.

Precipitation Based Smart Irrigation Controllers

This type of system utilizes either an on-site rain gauge or a local weather service to determine if there is sufficient precipitation to allow shut-off of the irrigation water.

Soil Moisture Based Smart Irrigation Controllers

This type of system utilizes soil moisture sensors, buried in the root zone, to determine if irrigation water is needed. A “suspended cycle irrigation system” uses the soil moisture sensors to determine whether a regularly scheduled irrigation application is necessary. If there is sufficient soil moisture, then the next scheduled irrigation cycle gets interrupted. A “water-on-demand irrigation system” applies irrigation water when the moisture sensor reaches its lower limit and shuts off when the moisture sensor reaches its upper limit. There is no regularly scheduled irrigation with the water on demand system.

For the purposes of this measure characterization, the assumed rolling 24-hour threshold for shutting off the irrigation is 6 mm (0.24”). The Savings Factor is based on the percentage of time that the rolling 24-hour average of precipitation meets or exceed the 6 mm threshold.

DEFINITION OF BASELINE EQUIPMENT

The baseline irrigation system applies irrigation water to the lawn or landscape on a regularly scheduled timer. The timing and duration of irrigation application are determined by the user, along with the location and density of sprinklers. The irrigation water gets applied according to the control schedule, regardless of whether the landscape actually needs the irrigation water at that time.

Sprinkler head nozzles have a variety of configurations that affect the distribution of the irrigation water. The water can come in the form of a spray, a rotating plume, a bubbler, or a drip.

Typical baseline irrigation systems provide 1 inch of irrigation to the entire lawn. This is equivalent to 0.623 gallons per square foot of lawn per week.[2031]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected useful life for Irrigation Control Measures is assumed to be 15 years.

[2031] Today’s Homeowner with Danny Lipford. “How to Calculate Lawn Irrigation Water Usage and Costs.”

DEEMED MEASURE COST

The measure cost for a multi-zone smart irrigation control system is $500.[2032]

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings from Irrigation Control Measures are the result of reduced water consumption. There are indirect electric energy savings from reduced potable water treatment.

ELECTRIC ENERGY SAVINGS

The electric energy savings are based indirectly on the reduced electricity usage used to provide the potable water and treat the wastewater. By applying an "Energy Factor", the water savings (in gallons/year) can be converted to electricity savings (in kWh/year). This "Energy Factor" considers the electric energy requirements of potable water treatment plants and potable water distribution. Since the "wasted" irrigation water in the baseline case will likely be absorbed into the soil or will runoff into surface water bodies, electricity savings from a reduction in wastewater treatment load would not apply.

The methodology for quantifying the water savings involves a direct comparison of the baseline equipment to the efficient equipment. In order to calculate the baseline water usage of an irrigation system, the number of sprinklers and their sizing need to be determined. The static pressure and sizing of the water service, along with the sprinkler head orifice sizing will ultimately determine the flow rate of water.

The electricity savings for this measure can be calculated by applying an energy factor to the calculated water savings.

$$\Delta kWh_{water} = \Delta Water / 1{,}000{,}000 * E_{water}$$

Where:

E_{water} = Illinois Total Water Energy Factor (kWh/Million Gallons)
=2,571[2033]

The total water savings for this measure can be calculated as follows:

$$\Delta Water = BSFL – ESFL$$

Where:

ΔWater = Total Water Savings (gallon/season)

The baseline volumetric flow rate for the entire system can be calculated as follows:

$$BSFL = NOS \times SFL \times DOI \times NAY$$

[2032] Material pricing taken from Google shopping search on "smart irrigation control system". The Rain Bird Smart LNK WiFi Irrigation System Indoor Controller (4 Pack) sells for $316 from online retailer Wish.com. Installation labor pricing taken from online retailer Home Advisor – Lawn and Garden, Repair a Sprinkler System**Error! Hyperlink reference not valid.** which stated $45 to $200 per hour for a plumber.

[2033] This factor include 2571 kWh/MG for water supply based on Illinois energy intensity data from a 2012 ISAWWA study and 2439 kWh/MG for wastewater treatment based on national energy intensity use estimates. For more information please review Elevate Energy's 'IL TRM: Energy per Gallon Factor, May 2018 paper'.

Where:

BSFL	= Baseline System Flow Rate (gallon/year)
NOS	= Number of Sprinklers, the total number of sprinklers at the property = Actual
SFL	= Sprinkler Flow Rate (gallon/minute) = Actual, site-specific irrigation system specifications should be consulted to determine the property's sprinkler flow rate
DOI	= Duration of Irrigation (minutes/application) = Actual, the baseline scheduling controls should be used to determine the irrigation season
NAY	= Number of Applications per Year (application/year) = Actual

The efficient volumetric flow rate can be calculated as follows:

$$ESFL = BSFL \times (1 - SF)$$

Where:

ESFL	= Efficient System Flow Rate (gallon/season)
BSFL	= Baseline System Flow Rate (gallon/season)
SF	= Savings Factor

The volumetric flow rate for the entire efficient system is based on applying a Savings Factor (SF) to the BSFL. The SF is determined by calculating the number of weeks in the irrigation season (April 25 through October 13) when there is sufficient precipitation to allow the shutoff of the irrigation system. Typical Meteorological Year (TMY-3) data gives precipitation depth in millimeters for each hour of the typical year. By consulting the TMY-3 data for the closest applicable weather station, the SF can be determined.

One source recommends a rain sensor shut-off threshold of 6 mm of precipitation for twice or thrice weekly irrigation schedule or 13 mm of precipitation for once weekly irrigation schedule.[2034] For the purposes of this workpaper, we will use a rolling 24-hour threshold of 6 mm.

The State Climatologist Office for Illinois produced a map of the Illinois Growing Season days per year for different parts of the state.[2035] Using a growing season average of 170 days, the "irrigation season" begins on April 25 and end on October 13.

By analyzing the TMY-3 precipitation data, the number of weeks during the "irrigation season" that the rolling 24-hour precipitation levels greater than 6 mm can be determined, along with the Savings Factors:

Chicago:	SF = 0.265
Midway:	SF = 0.241
Rockford:	SF = 0.268
Peoria:	SF = 0.227
Springfield:	SF = 0.186

[2034] Michael D. Dukes. "Smart Irrigation Controllers: What Makes an Irrigation Controller Smart". University of Florida, Institute for Food & Agricultural Sciences.

[2035] State Climatologist Office for Illinois, Illinois State Water Survey, 2003. Based on 1971 – 2000 data, assessing the number of days between the last spring drop below 32 degrees and the firest fall drop below 32 degrees.

For example, an irrigation system in Rockford with 50 sprinklers running at 5 gallons per minute, 20 minutes per sprinkle with 100 sprinkles per year would save:

$\Delta kWh = \Delta Water / 1{,}000{,}000 * E_{water}$

$\Delta Water = BSFL – ESFL$

$BSFL = NOS * SFL * DOI * NAY$

$= 50 * 5 * 20 * 100$

$= 500{,}000$

$ESFL = BSFL * (1 – SF)$

$= 500{,}000 * (1 – 0.268)$

$= 366{,}000$

$\Delta Water = 500{,}000 – 366{,}000$

$= 134{,}000$

$\Delta kWh = 134{,}000 / 1{,}000{,}000 * 2571$

$= 344.5$ kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

The water savings inherent in the efficient irrigation control technology will help preserve water supplies and extend the life of water treatment and wastewater treatment equipment. By reducing irrigation during periods of precipitation, unnecessary storm runoff and puddling can be avoided. For more details on calculating water savings, please see the 'Algorithm' section of this characterization.

DEEMED O&M COST ADJUSTMENT CALCULATION

Maintaining an Efficient Irrigation Control system will require periodic cleaning and calibration of the sensors. Any wiring or wireless communication devices will also need to be maintained. Costs for these activities is $196.[2036]

MEASURE CODE: CI-MSC-SIRC-V03-250101

REVIEW DEADLINE: 1/1/2029

[2036] Based on data provided on Home Advisor website, Lawn and Garden, Repair a Sprinkler System.**Error! Hyperlink reference not valid.**

4.9.14 Switch Peripheral Equipment Consolidation

DESCRIPTION

This measure will allow for projects with small scopes of equipment replacement to be cost effectively brought into the telecommunication optimization incentive program. Consolidating telecommunication line and trunk equipment eliminate underutilized equipment which reduces power draw from the rectifier. This avoided heat load also results in cooling savings.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The measure requires no new equipment and only consolidates partially loaded equipment. There are a myriad of different types of line and trunk equipment, but consolidation eliminates underutilized equipment which will result in energy savings.

DEFINITION OF BASELINE EQUIPMENT

Baseline telecommunications equipment is partially loaded line and trunk equipment that is no longer needed due to line loss on the telecommunications network. Lines are consolidated to like equipment and the underutilized equipment is removed. This applies to all line and trunk equipment and does not exclude participation from any particular type of line and trunk equipment. All line and trunk equipment are considered eligible but only up to and including 40 pieces of equipment. Above that amount, projects will require on-site amp reduction verification.

Baseline cooling equipment is assumed to be an Air-Cooled Chiller without an economizer with a capacity >240 MBtu. If cooling equipment can be verified, the chiller efficiency can be replaced with the appropriate value using Table below.

ASHRAE 90.1 2016: Table 6.8.1-11

Equipment Type	Net Sensible Cooling Capacity	Downflow units	Upflow - Ducted	Upflow - Unducted	Horizontal Flow
		COP	COP	COP	COP
Air Cooled	< 65 MBtuh	2.30	2.10	2.09	2.45
	> 65 MBtuh and < 240 MBtuh	2.20	2.05	1.99	2.35
	> 240 MBtuh	2.00	1.85	1.79	2.15
Water Cooled	< 65 MBtuh	2.50	2.30	2.25	2.70
	> 65 MBtuh and < 240 MBtuh	2.40	2.20	2.15	2.60
	> 240 MBtuh	2.25	2.10	2.05	2.45
Water Cooled with Fluid Economizer	< 65 MBtuh	2.45	2.25	2.20	2.60
	> 65 MBtuh and < 240 MBtuh	2.35	2.15	2.10	2.55
	> 240 MBtuh	2.20	2.05	2.00	2.40
Glycol Cooled	< 65 MBtuh	2.30	2.10	2.00	2.40
	> 65 MBtuh and < 240 MBtuh	2.05	1.85	1.85	2.15
	> 240 MBtuh	1.95	1.80	1.75	2.10
Glycol Cooled with Fluid Economizer	< 65 MBtuh	2.25	2.10	2.00	2.35
	> 65 MBtuh and < 240 MBtuh	1.95	1.80	1.75	2.10
	> 240 MBtuh	1.90	1.80	1.70	2.10

Converted ASHRAE 90.1 2016: Table 6.8.1-11 Cooling Efficiency Table

Equipment Type	Net Sensible Cooling Capacity	Downflow units	Upflow - Ducted	Upflow - Unducted	Horizontal Flow
		kW/Ton	kW/Ton	kW/Ton	kW/Ton
Air Cooled	< 65 MBtuh	1.53	1.67	1.68	1.44
	> 65 MBtuh and < 240 MBtuh	1.60	1.72	1.77	1.50
	> 240 MBtuh	1.76	1.90*	1.96	1.64
Water Cooled	< 65 MBtuh	1.41	1.53	1.56	1.30
	> 65 MBtuh and < 240 MBtuh	1.47	1.60	1.64	1.35
	> 240 MBtuh	1.56	1.67	1.72	1.44
Water Cooled with Fluid Economizer	< 65 MBtuh	1.44	1.56	1.60	1.35
	> 65 MBtuh and < 240 MBtuh	1.50	1.64	1.67	1.38
	> 240 MBtuh	1.60	1.72	1.76	1.47
Glycol Cooled	< 65 MBtuh	1.53	1.67	1.76	1.47
	> 65 MBtuh and < 240 MBtuh	1.72	1.90	1.90	1.64
	> 240 MBtuh	1.80	1.95	2.01	1.67
Glycol Cooled with Fluid Economizer	< 65 MBtuh	1.56	1.67	1.76	1.50
	> 65 MBtuh and < 240 MBtuh	1.80	1.95	2.01	1.67
	> 240 MBtuh	1.85	1.95	2.07	1.67

**Default value based on previous program data; in all but one project, this was the cooling efficiency value used*

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

10 years.[2037]

DEEMED MEASURE COST

There is no equipment cost to implement this measure. The only associated cost is the required internal labor to move lines from the to-be-removed piece of equipment to the chosen like piece of equipment. The default labor cost is $742/piece of equipment removed.[2038]

LOADSHAPE

Loadshape is determined by the constant power draw by the line and trunk equipment; default loadshape is: Loadshape C53 – Flat.

COINCIDENCE FACTOR

Coincidence Factor is determined by the constant power draw by the line and trunk equipment; the summer peak coincidence factor for the line and trunk equipment is assumed to be 100%. The cooling coincident factor is assumed to be consistent with the summer system peak coincidence factor as provided below:

CF_{SSP} = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [2039]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\text{kWh Savings} = \text{p} * \text{kW}_{\text{Trunk}} * (1 + \text{LCF} * \text{CE}) * \text{t}$$

Where:

p = Number of pieces of redundant equipment removed

= Actual

kW_{Trunk} = Average line and trunk equipment power draw

= 0.233 kW[2040]

LCF = Load Conversion Factor kW to Ton of cooling (tons/kW)

= 0.284 [2041]

CE = Cooling Efficiency

[2037] Assumption is based on communication from AT&T program manager indicating an expectation that consolidated equipment should be expected to remain for a minimum of 10 years.
[2038] Value based on the average of program data provided by Franklin Energy. See "Network Combing Workpaper Research_v2.xls" for details. Note projects were capped at 40 pieces of equipment in the development of this average.
[2039] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.
[2040] Value based on the average of program data provided by Franklin Energy. See "Network Combing Workpaper Research_v2.xls" for details. Note projects were capped at 40 pieces of equipment in the development of this average.
[2041] 1 ton of cooling = 12,000 BTU/h. 1kWh = 3412 BTU. Therefore 1 ton of cooling = 12000BTU/h * 1 kWh/3412 BTU = 3.51 kW per ton, = 0.284 tons/kW.

= Actual, if unknown assume 1.90 kW/ton[2042]

t = time (hours)

= 8,760 hours

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\text{kW Savings} = \text{p} * \text{kW}_{\text{Trunk}} * (\text{CF}_{\text{Trunk}} + \text{LCF} * \text{CE} * \text{CF}_{\text{SSPCool}})$$

Where:

p = Number of pieces of redundant equipment removed

kW_{Trunk} = Average line and trunk equipment power draw, 0.233 kW

LCF = Load Conversion Factor kW to Ton, 0.284

CE = Cooling Efficiency, default value = 1.90 kW/ton based on previous program data

CF_{Trunk} = Line and Trunk Equipment Coincidence Factor, 1.0

$CF_{SSPCool}$ = Summer System Peak Coincidence Factor for Commercial cooling (during system peak hour)

= 91.3% [2043]

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-SPEC-V02-230101

REVIEW DEADLINE: 1/1/2027

[2042] Cooling efficiency kW/ton default is based on air cooled units >240 Mbtuh, upflow ducted value as per the ASHRAE 90.1 2016 tables provided in the baseline section. This was the appropriate cooling efficiency value for all but one of Franklin Energy's projects.

[2043] Based on analysis of Itron eShape data for Missouri, calibrated to Illinois loads, supplied by Ameren. The AC load during the utility's peak hour is divided by the maximum AC load during the year.

4.9.15 ENERGY STAR Low Wattage Uninterruptible Power Supply

DESCRIPTION

This measure is for replacing an inefficient uninterruptable power supply (UPS) with an efficient ENERGY STAR[2044] rated UPS in telecommunications, or similar facility that operates continuously. Note for data centers and other facilities that are not operated similarly to telecommunication applications, a custom calculation based on M&V analysis and that accounts for ramp-up of loads on the UPS should be performed. UPS units provide backup power in data centers and draw power constantly to keep their batteries charged. Uninterruptible power supplies (UPS) are utilized in many organizations to protect themselves from downtime with power distribution and avoid data processing errors due to downtimes. UPS systems are connected between the public power distribution system and mission critical loads.

This measure applies to UPS's with a rated output power less than or equal to 1,875 watts.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a new ENERGY STAR UPS in a telecommunication or similar application. For single-normal mode UPSs, the installed system must meet or exceed the average loading-adjusted efficiency values required by the ENERGY STAR program. The new UPS must have a rated output power less than or equal to 1,875 watts, the limit of the scope of the federal UPS standard.[2045]

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing non-ENERGY STAR UPS in a telecommunication or similar application.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[2046]

DEEMED MEASURE COST

The incremental cost is estimated at $59 per UPS unit.[2047]

LOADSHAPE

Loadshape is determined by the constant power draw by the UPS; default loadshape is Loadshape C53 – Flat.

COINCIDENCE FACTOR

The coincidence factor for the UPS or rectifier is assumed to be 1.0 due to equipment operating during peak period.

[2044] In the event that the ENERGY STAR program is ended, the last effective ENERGY STAR specification should continue to be used through the effective period of this TRM.
[2045] Code of Federal Regulations, Energy Conservation Standards for Uninterruptible Power Supplies, effective January 10, 2022 (10 CFR 430.32(z)(3).
[2046] California Municipal Utilities Association. Savings Estimation Technical Reference Manual 2017, Third Edition. Section 8.12, p. 8–15.
[2047] As estimated in the California Municipal Utilities Association. Savings Estimation Technical Reference Manual 2017, incremental measure cost based on average UPS costs for a range of sizes, assuming a 30% premium for an ENERGY STAR UPS.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = Size * (1/Eff_{AVGbase} - 1/Eff_{AVGee}) * EFLH$$

Where:

Size = Size of UPS in rated output power, kW

$Eff_{AVGbase}$ = Efficiency of existing UPS

= Actual or use table below[2048]

UPS Product Class	Rated Output Power	Minimum Efficiency
Voltage and Frequency Dependent (VFD)	P ≤ 300 W	$-1.20\times10^{-6} \times P^2 + 7.17\times10^{-4} \times P + 0.862$
	300 W < P ≤ 700 W	$-7.85\times10^{-8} \times P^2 + 1.01\times10^{-4} \times P + 0.946$
	P > 700 W	$-7.23\times10^{-9} \times P^2 + 7.52\times10^{-6} \times P + 0.977$
Voltage Independent (VI)	P ≤ 300 W	$-1.20\times10^{-8} \times P^2 + 7.19\times10^{-4} \times P + 0.863$
	300 W < P ≤ 700 W	$-7.67\times10^{-8} \times P^2 + 1.05\times10^{-4} \times P + 0.946$
	P > 700 W	$-4.62\times10^{-9} \times P^2 + 8.54\times10^{-6} \times P + 0.979$
Voltage and Frequency Independent (VFI)	P ≤ 300 W	$-3.13\times10^{-8} \times P^2 + 1.960\times10^{-4} \times P + 0.543$
	300 W < P ≤ 700 W	$-2.60\times10^{-8} \times P^2 + 3.65\times10^{-4} \times P + 0.764$
	P > 700 W	$-1.70\times10^{-8} \times P^2 + 3.85\times10^{-6} \times P + 0.876$

Eff_{AVGee} = Efficiency of new ENERGY STAR UPS

= Actual or ENERGY STAR minimum value from table below[2049]

Rated Output Power	UPS Product Class		
	VFD	VI	VFI
P ≤ 350 W	$5.71 \times 10^{-5} \times P + 0.962$	$5.71 \times 10^{-5} \times P + 0.964$	$0.011 \times \ln(P) + 0.824$
350 W < P ≤ 1.5 kW	0.982	0.984	$0.011 \times \ln(P) + 0.824$
1.5 kW < P ≤ 1.875 kW	$0.981 - E_{MOD}$	$0.981 - E_{MOD}$	$0.0145 \times \ln(P) + 0.8 - E_{MOD}$

E_{MOD} = an allowance of 0.004 for Modular UPSs applicable in the commercial 1500 – 10,000 W range

EFLH = Equivalent Full Load Hours, per equation below and values provided in table[2050]

$= (t_{0.25} \times 0.25 + t_{0.5} \times 0.5 + t_{0.75} \times 0.75 + t_{1.0} \times 1.0) \times 8760$ hours

Rated Output Power (P) in watts	UPS Product Class	Time spent at specified proportion of reference test load (t)				EFLH
		25%	50%	75%	100%	
P ≤ 1.5 kW	VFD	0.2	0.2	0.3	0.3	5913
	VI or VFI	0	0.3	0.4	0.3	6570
1.5 kW < P ≤ 1.875 kW	VFD, VI, or VFI	0	0.3	0.4	0.3	6570

[2048] Code of Federal Regulations, Energy Conservation Standards for Uninterruptible Power Supplies, effective January 10, 2022 (10 CFR 430.32(z)(3).

[2049] ENERGY STAR Uninterruptible Power Supplies Final Version 2.0 Specification, effective January 1, 2019.

[2050] Calculation and inputs provided in ENERGY STAR Uninterruptible Power Supplies Final Version 2.0 Specification.

Default Energy Savings are provided below:[2051]

Output Power Range	Output Power (kW)[2052]	Single-Normal Mode UPS Systems			Multiple-Normal Mode UPS Systems	
		VFD	VI	VFI	$VFD_{25\%}/VI_{75\%}$	$VFD_{25\%}/VFI_{75\%}$
P ≤ 0.300 kW	0.261	185.6	207.7	1,035.4	186.0	727.7
0.300 kW < P ≤ 0.350 kW	0.335	34.7	40.9	169.5	35.3	127.4
0.350 kW < P ≤ 0.700 kW	0.513	117.3	133.5	283.2	118.0	234.4
0.700 kW < P ≤ 1.500 kW	1.041	32.0	35.5	354.6	32.0	264.2
1.500 kW < P ≤ 1.875 kW	1.766	0.0	55.3	605.0	13.9	434.1

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = Size * (1/Eff_{AVGbase} - 1/Eff_{AVGee}) * CF$$

Where:

CF_{IT} = Coincidence factor of UPS

= 1.0

Default Summer Peak Demand Savings are provided below based on defaults above:

Output Power Range	Single-Normal Mode UPS Systems			Multiple-Normal Mode UPS Systems	
	VFD	VI	VFI	$VFD_{25\%}/VI_{75\%}$	$VFD_{25\%}/VFI_{75\%}$
P ≤ 0.300 kW	0.0314	0.0316	0.1576	0.0314	0.1108
0.300 kW < P ≤ 0.350 kW	0.0059	0.0062	0.0258	0.0060	0.0194
0.350 kW < P ≤ 0.700 kW	0.0198	0.0203	0.0431	0.0200	0.0357
0.700 kW < P ≤ 1.500 kW	0.0054	0.0054	0.0540	0.0054	0.0402
1.500 kW < P ≤ 1.875 kW	0.0000	0.0084	0.0921	0.0021	0.0661

FOSSIL FUEL SAVINGS

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-UPSE-V05-260101

REVIEW DEADLINE: 1/1/2028

[2051] Default savings are provided in a calculation file provided by VEIC that utilizes the ENERGY STAR qualified products list (as accessed on June 11, 2024) for the average power rating within each range. In circumstances where the use of the efficient and baseline efficiency formulas resulted in negative default savings, the average unit efficiency from qualified products within that power range was used instead of the ENERGY STAR product class formula. See "ENERGY STAR UPS Calculations_2024.xls" for more information.

[2052] Default output power is based on the average active output power rating of ENERGY STAR rated models falling into that specified range, as sourced from the ENERGY STAR Qualified Products List for Uninterruptible Power Supplies, as accessed on June 11, 2024.

4.9.16 Energy Efficient Rectifier and High Wattage UPS

DESCRIPTION

This measure is for replacing an inefficient rectifier or high wattage uninterruptable (UPS) with an efficient unit in a data center, telecommunications, or similar facility that operates continuously. A rectifier converts alternating current (AC) to direct current (DC). UPS units provide backup power and draw constantly to keep batteries charged.

This measure applies to UPS's with a rated output power greater than 1,875 watts.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient condition is a new rectifier or UPS whose efficiency in normal mode (not in energy saver mode) is at least 94%.[2053]

DEFINITION OF BASELINE EQUIPMENT

The baseline condition is an existing rectifier or UPS whose efficiency in normal mode (not in energy saver mode) is less than 90%.[2054]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is assumed to be 15 years.[2055]

DEEMED MEASURE COST

The incremental cost is estimated at $59 per kW of IT Load.[2056]

LOADSHAPE

Loadshape is determined by the constant power draw by the Rectifier; default loadshape is Loadshape C53 – Flat.

COINCIDENCE FACTOR

The coincidence factor for the rectifier is assumed to be 1.0 due to equipment operating during peak period.

[2053] Switching mode rectifier (SMR) technologies allows for efficiencies as high as 96% according to the DOE, Office of Energy Efficiency & Renewable Energy, High-Efficiency, Wide-Band Three-Phase Rectifiers and Adaptive Rectifier Management. Accessed: 12/05/19 https://www.energy.gov/eere/amo/high-efficiency-wide-band-three-phase-rectifiers-and-adaptive-rectifier-management

[2054] Mid-range efficiency for most low peak rectifiers (88%-92%) based on information from the DOE, Office of Energy Efficiency & Renewable Energy, High-Efficiency, Wide-Band Three-Phase Rectifiers and Adaptive Rectifier Management. Accessed: 12/05/19 https://www.energy.gov/eere/amo/high-efficiency-wide-band-three-phase-rectifiers-and-adaptive-rectifier-management

[2055] California Municipal Utilities Association. Savings Estimation Technical Reference Manual 2017, Third Edition. Section 8.12, p. 8–15.

[2056] Based on market study of twenty, 1600 Volt Bridge Rectifiers, as sourced from Mouser Electronics online marketplace. Accessed: 12/05/19. https://www.mouser.com/Semiconductors/Discrete-Semiconductors/Diodes-Rectifiers/Bridge-Rectifiers/_/N-ax1mf?P=1yzxhysZ1yzxpaz

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = kWh_{base} - kWh_{EE}$$

$$kWh_{base} = ((Load * H_{IT})/Eff_{base}) + ((Load * (1/ Eff_{base} – 1) * H_{Cool} * kW/Ton_{Cool} * 3412/12000)$$

$$kWh_{EE} = ((Load * H_{IT})/Eff_{EE}) + ((Load * (1/ Eff_{EE} – 1) * H_{Cool} * kW/Ton_{Cool} * 3412/12000)$$

Where:

Load = Average IT load (output kW)

= Actual, typically at 20% of equipment rated load[2057]

H_{IT} = Annual hours of operation of rectifier or UPS

= 8760

H_{cool} = Annual cooling system hours of operation

= Actual or defaults below:

System Size	Cooling Hours (H_{cool})
Small IT (≤ 50 kW) without air-side economizer	8760 hours[2058]
Small IT (> 50 kW) with air-side economizer	4380 hours[2059]

Eff_{base} = Efficiency of existing rectifier or UPS

= Actual. If unknown assume 90%[2060]

Eff_{EE} = Efficiency of new rectifier or UPS

= Actual. If unknown assume 94%

kW/Ton_{cool} = Cooling system efficiency (kW/Ton)

Cooling Equipment Type	Efficiency Calculation (kW/Ton_{cool})
Air-Cooled Chiller	$kW/Ton_{Chiller} + kW_{chilled\ water\ pump}$ /Tons
Water-Cooled Chiller	$kW/Ton_{Compressor} + (kW_{chilled\ water\ pump} + kW_{condensor\ water\ pump} + kW_{cooling\ tower\ fans})$/Tons
Direct Expansion System	12/EER

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = kW_{base} - kW_{EE}$$

$$kW_{base} = ((Load * CF_{IT})/Eff_{base}) + ((Load * CF_{cool} * (1/ Eff_{base} – 1) * kW/Ton_{Cool} * 3412/12000)$$

$$kWh_{EE} = ((Load * CF_{IT})/Eff_{EE}) + ((Load * CF_{cool} * (1/ Eff_{EE} – 1) * kW/Ton_{Cool} * 3412/12000)$$

[2057] Based on industry knowledge of large telecom company set up.
[2058] Small IT systems are assumed to have no air-side economizer and to operate continuously throughout the year.
[2059] Larger IT systems are assumed to have an air-side economizer that allows the cooling system to be turned off for half the year. This corresponds to approximately a 45°F changeover temperature, which is a conservative assumption.
[2060] Mid-range efficiency for most low peak rectifiers (88%-92%) based on information from the DOE, Office of Energy Efficiency & Renewable Energy, High-Efficiency, Wide-Band Three-Phase Rectifiers and Adaptive Rectifier Management.

Where:

CF_{IT} = Coincidence factor of rectifier

= 1.0

CF_{cool} = Coincidence factor of cooling system

= 0.82

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-RECT-V04-250101

REVIEW DEADLINE: 1/1/2028

4.9.17 Energy Efficient Hydraulic Oils - Provisional Measure

DESCRIPTION

Industrial hydraulic systems use hydraulic oil to transfer input energy to output power. Hydraulic oils also protect critical components from premature wear. Energy efficient hydraulic oil lubricants meet these requirements and provide reduced energy consumption. Energy efficient hydraulic oils have a lower coefficient of friction which reduces the friction between two moving parts (rotating pump equipment and hydraulic oil). This lower coefficient of friction reduces the energy required to yield output power. Second, these oils have a high viscosity index which reduces the effect temperature has on the viscosity of the hydraulic oil. The high viscosity index allows constant viscosity over a range of operating temperatures which optimizes volumetric and mechanical efficiency at the pumps rated output. Additionally, energy efficient hydraulic oils reduce the operating temperature of the hydraulic system.

Manufacturers who use electric-motor-driven hydraulic systems have been found to reduce energy consumption by between 3 and 7%.

This measure was developed to be applicable to the following program types: NC, TOS and RF. If applied to other program types, the measure should be verified as a custom measure.

DEFINITION OF EFFICIENT EQUIPMENT

This is applicable for small, medium, and large manufacturers in all climate zones using electric motors to power their hydraulic system both inside and/or outside conditioned areas; or for all hydraulic systems on mobile equipment in all climate zones on Illinois.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is defined as hydraulic systems using non-energy efficient industrial hydraulic oils which provides no energy efficiency benefits. In the formula below, the baseline equipment is where, Ei = zero.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.

The ability to reduce energy consumption (energy efficiency) is an inherent characteristic in the oil which does not deplete over time. As long as the energy efficient oil is in use, it will provide energy efficiency.

DEEMED MEASURE COST

The actual incremental costs between an energy-efficient hydraulic oil and a standard hydraulic oil should be used.

LOADSHAPE

Loadshape C14: Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15: Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16: Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17: Indust. 4-shift (24/7) (e.g., comp. air, lights)

COINCIDENCE FACTOR

No coincidence factor though it is noted that reduced consumption for equipment will reduce the overall baseload power demand, especially if a construction operation or manufacturing operation demand more utility power in summer weather (e.g., construction ground work, rubber manufacturing, etc).

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings are calculated based on a reduced coefficient of friction and the shear-stable high viscosity index value associated with energy-efficient hydraulic oils in hydraulic systems. The algorithm below for Energy Savings, is modeled after the Focus on Energy Emerging Technology Program M&V study.

ELECTRIC ENERGY SAVINGS

ΔkWh = MotorHP * (0.746 kW/HP) * (%MotorLoading / µMotor) * HOURS * Ei

Where:

MotorHP = Rated horsepower of electric motor, summed when pumps are in series.

= Actual

%MotorLoading = Is dependent upon many factors including the part being manufactured, the polymer, the machine's specifications, and cycle time.

= Actual, calculated as (Average load / Full rated load)

= Estimated as 75%.[2061]

µMotor = Motor efficiency

= Actual. If unknown, estimated as 92% for motors in size range typically used.[2062]

HOURS = Hours of operation per year

= Actual

Ei = Efficiency improvement due to use of energy efficient hydraulic oils

= Actual. If not measured, assume 3.3%.[2063]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

O&M savings from the necessary standard oil replacement over the lifetime of the energy efficient hydraulic oil (including oil cost, disposal costs, labor and avoided downtime) should be calculated. If additional savings for improved pump and valve lifetime can be demonstrated, these can also be included.

An example O&M cost calculation is provided below, relating to the standard hydraulic oil requiring 1 change out per year:

O&M Component	Cost
Oil cost	$800
Oil disposal cost	$80
Labor (4 hours per change at $40/hr)	$160
Downtime Production cost (2 hours at $500 lost production cost per year)	$1000
Total annual O&M benefit (1 change per year)	$2040

[2061] Most electric motors are designed to run at 50% to 100% of rated load, from Department of Energy "Determining Electric Motor Load & Efficiency", June 23, 2020.

[2062] Based on common size and type of motor - chart on pages 13-14, "Attachment C" of reference 9, the efficiency of a 50HP motor (TEFC type) at 1200 RPM is 92%. Or 75HP at 900 RPM at 75% TEFC type is 91.8%. These are common sizes and type for manufacturers.

[2063] Estimate based on review of a number of studies provided by ExxonMobil and saved in reference folders.

MEASURE CODE: CI-MSC-EEHO-V01-210101

REVIEW DEADLINE: 1/1/2023

4.9.18 Energy Efficient Gear Lubricants - Provisional Measure

DESCRIPTION

Industrial gear reduction systems use gear oil to transfer input energy to output power. Gear oils also protect critical components from premature wear. Energy efficient gear oil lubricants meet these requirements and provide reduced energy consumption. Energy efficient gear oils have a lower coefficient of friction which reduces the friction between two moving parts (rotating pump equipment and hydraulic oil). This lower coefficient of friction reduces the energy required to yield output power. Second, these oils have a high viscosity index which reduces the effect temperature has on the viscosity of the hydraulic oil. The high viscosity index allows constant viscosity over a range of operating temperatures which optimizes volumetric and mechanical efficiency at the pumps rated output. Additionally, energy efficient gear oils reduce the operating temperature of the gear-reduction gearbox.

Manufacturers who use electric-motor-driven gear-reduction gearboxes can reduce energy consumption by up to 1% per gear-mesh (e.g., 3% efficiency for a 3-reduction gearbox).

This measure was developed to be applicable to the following program types: NC, TOS and RF. If applied to other program types, the measure should be verified as a custom measure.

DEFINITION OF EFFICIENT EQUIPMENT

This is applicable for small, medium, and large manufacturers in all climate zones using electric motors to power their gear reduction system both inside and/or outside conditioned areas; or for all gear reduction systems on mobile equipment in all climate zones on Illinois.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment is defined as a gearbox using non-energy efficient industrial gear lubricants which provides no energy efficiency benefits. In the formula below, the baseline equipment is where, Ei = zero.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 10 years.

The ability to reduce energy consumption (energy efficiency) is an inherent characteristic in the oil which does not deplete over time. As long as the energy efficient oil is in use, it will provide energy efficiency.

DEEMED MEASURE COST

The actual incremental costs between an energy-efficient and a standard gear lubricant should be used.

LOADSHAPE

Loadshape C14: Indust. 1-shift (8/5) (e.g., comp. air, lights)
Loadshape C15: Indust. 2-shift (16/5) (e.g., comp. air, lights)
Loadshape C16: Indust. 3-shift (24/5) (e.g., comp. air, lights)
Loadshape C17: Indust. 4-shift (24/7) (e.g., comp. air, lights)

COINCIDENCE FACTOR

No coincidence factor though it is noted that reduced consumption for equipment will reduce the overall baseload power demand, especially if a construction operation or manufacturing operation demand more utility power in summer weather (e.g., construction ground work, rubber manufacturing, etc).

Algorithm

CALCULATION OF ENERGY SAVINGS

Savings are calculated based on a reduced coefficient of friction and the shear-stable high viscosity index value associated with energy-efficient gear oils in gear-reduction systems. The algorithm below for Energy Savings is modeled after the Focus on Energy Emerging Technology Program M&V study.

ELECTRIC ENERGY SAVINGS

ΔkWh = MotorHP * (0.746 kW/HP) * (%MotorLoading / µMotor) * HOURS * Ei

Where:

MotorHP = Rated horsepower of electric motor, summed when pumps are in series.

= Actual

%MotorLoading = Is dependent upon many factors including the part being manufactured, the polymer, the machine's specifications, and cycle time.

= Actual, calculated as (Average load / Full rated load)

= Estimated as 75%.[2064]

µMotor = Motor efficiency

= Actual. If unknown, estimated as 92% for motors in size range typically used.[2065]

HOURS = Hours of operation per year

= Actual

Ei = Efficiency improvement due to use of energy efficient hydraulic oils

= Actual. If not measured, assume 1% per gear mesh.[2066]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

O&M savings from the necessary standard oil replacement over the lifetime of the energy efficient gear oil (including oil cost, disposal costs, labor and avoided downtime) should be calculated. If additional savings for improved gear box lifetime can be demonstrated, these can also be included.

MEASURE CODE: CI-MSC-EEGL-V01-210101

REVIEW DEADLINE: 1/1/2023

[2064] Most electric motors are designed to run at 50% to 100% of rated load, from Department of Energy "Determining Electric Motor Load & Efficiency", June 23, 2020.

[2065] Based on common size and type of motor - chart on pages 13-14, "Attachment C" of reference 9, the efficiency of a 50HP motor (TEFC type) at 1200 RPM is 92%. Or 75HP at 900 RPM at 75% TEFC type is 91.8%. These are common sizes and type for manufacturers.

[2066] Estimate based on review of a number of studies provided by ExxonMobil and saved in reference folders.

4.9.19 Smart Sockets

DESCRIPTION

Smart sockets achieve savings through the reduction of the standby load of the controlled appliance, as well as eliminating the operation of an appliance during unoccupied hours. The standby power consumption of home appliances and office equipment can be significantly reduced.

In a commercial office space, significant opportunity exists for savings from the reduction of plug loads, with power strips and timers being a key energy saving measure.[2067] Savings from smart sockets generally occurs during off-hours, when connected equipment continues to consume electricity while in standby mode or when off. Savings may also be achieved through the more precise scheduling of the appliance, so that it is not operating during unoccupied hours, though those savings have not been attempted to be quantified within this summary.

Smart sockets are ideal for all types of plugged-in devices such as small appliances (coffee maker, office heater, etc.), in-wall AC units, large office equipment, outlet lights, digital signs, decorative lighting, televisions, etc, though they provide the greatest energy savings when installed on equipment with higher wattage and standby power consumption. In a commercial office space, the shared photocopier is often the largest stand-alone user of electricity, with the highest standby power draw, so an ideal candidate for use with a smart socket. Note that a dedicated power supply is critical for your office photocopier.[2068] Also, note that the electrical amperage rating of the smart socket should be verified to suit the connected equipment. Desktop computers with peripheral equipment may be better served by an advanced power strip.

This measure was developed to be applicable to the following program types: DI, KITS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is the use of a smart plug with a standby power wattage of 2W or less. Should be UL listed. (Simply Conserve Smart Socket SS-15A1-WiFi has a standby power of less than or equal to 0.7).

DEFINITION OF BASELINE EQUIPMENT

The assumed baseline is an appliance or piece of office equipment plugged into an outlet (without a power strip) or into a standard power strip with surge protection that does not control connected loads. Note many ENERGY STAR appliances require power saving settings which will partially offset the savings potential of this measure. Where possible non-ENERGY STAR equipment should be plugged in to the socket to ensure savings are realized.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The assumed lifetime of the smart socket is 7 years.[2069]

DEEMED MEASURE COST

For direct install, the actual full equipment and installation cost (including labor) and for kits the actual full equipment cost should be used. If unknown for kits, use $9.00/each.[2070]

LOADSHAPE

Loadshape C47 – Standby Losses – Commercial Office[2071]

[2067] See Page 6 of New Buildings Institute, "Plug Load Savings Assessment: Part of the Evidence-based Design and Operations PIER Program," California Energy Commission, Evidence-based Design and Operations PIER Program, March 2013.

[2068] From Ross Wiffler, "A Dedicated Power Supply is Critical for Your Office Copier", Copiers & More, Small Business, Aug. 18th, 2015. https://commonsensebusinesssolutions.com/a-dedicated-power-supply-is-critical-for-your-office-copier/

[2069] This is an assumption consistent with 4.8.7 Advanced Power Strip – Tier 1 Commercial.

[2070] Based on cost from vendor of typical smart socket on the market, Simply Conserve Smart Socket by AM Conservation Group. 10 amp smart socket: $8.92/each; 15 amp smart socket: $9.00/each.

[2071] As referenced in 4.8.7 Advanced Power Strip – Tier 1 Commercial, Loadshapes were calculated from empirical studies and compared to the existing loadshape in Volume 1, Table 3.5. The studies were:

COINCIDENCE FACTOR

N/A due to no savings attributable to standby losses between 1 and 5 PM.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

ΔkWh[2072] = (((((W$_{Base}$ * OnAdj) – W$_{Eff}$) * (hrs$_{wkday}$ - hrs$_{wkday\text{-}open}$)) + (((W$_{Base}$ * OnAdj)– W$_{Eff}$) * (hrs$_{wkend}$ - hrs$_{wkend\text{-}open}$))) * (# of Receptacles * Receptacle Factor))/1000 * weeks/year * ISR

Where:

W$_{Base}$ = Standby power or On power consumption of connected appliance.

Use actual if known, or refer to tables below. For multi-receptacle units add up total wattage of appliances connected. If unknown, e.g. via kits, assume 9.4W[2073]

Appliances assumed to be in standby mode:

Controlled Equipment[2074]	Standby Power (W)
Air Conditioner	4.0
Air Purifier	0.7
Charger - Electronics	0.52
Coffee Maker	0.95
Computer, Desktop	2.7
Computer, Laptop	1.6
Dehumidifier	0.45
Fan	0.22
Gaming Console	1.7
Humidifier	1.2
Light – Smart Bulb	0.4
Media Player – DVD/Blu-ray	1.8
Media Player - Streaming	1.9
Printer	2.61
Television	0.95

Acker, Brad *et. al,* "Office Space Plug Load Profiles and Energy Saving Interventions," 2012 ACEEE Summer Study on Energy Efficiency in Buildings.
Sheppy, M. *et al*, "Reducing Plug Loads in Office Spaces" Hawaii and Guam Energy Improvement Technology Demonstration Project, NREL/NAVFAC (January 2014).

[2072] Savings algorithm reconstructed from weekday and weekend savings information in Acker, Brad *et. al,* "Office Space Plug Load Profiles and Energy Saving Interventions," 2012 ACEEE Summer Study on Energy Efficiency in Buildings, and verified against savings in Acker *et. al* and savings in: BPA, "Smart Power Strip Energy Savings Evaluation: Ross Complex," (2011). Office stations are assumed to have zero or minimal standy losses during normal operating hours. Method shown in "Commercial Tier 1 APS Calculations – IL TRM.xlsx".

[2073] Average connected wattage found in Guidehouse, 'ComEd Small Business Kits CY2020 Impact Evaluation Report 2021-04-01 Final.pdf'.

[2074] Standby Power Summary Table contained in "Standby Power", Lawrence Berkeley National Laboratory, Building Technology and Urban Systems Division, November 2022, https://standby.lbl.gov/standby-power-data-metering , see "List of Standby Products – StandbyTable.xlsx, Standby Median column."

Appliances assumed to be in on mode:

Controlled Equipment[2075]	On Power (W)
Air Conditioner	10.0
Air Purifier	1.51
Dehumidifier	0.45
Humidifier	3.5
Light	10.4
Fan	70.0
Space Heater	450.0
Television	23.8
Water Cooler	100

OnAdj = Adjustment for wattages of appliances that are powered on during out of hours

= 50%[2076] for appliances in on mode

=100% for appliances in standby mode and for unknown

W_{Eff} = Standby power consumption of smart socket. If unknown, assume 0.7W[2077].

hrs_{wkday} = total hours during the work week (Monday 7:30 AM to Friday 5:30 PM)

= 106

hrs_{wkend} = total hours during the weekend (Friday 5:30 PM to Monday 7:30 AM)

= 62

$hrs_{wkday\text{-}open}$ = hours the office is open during the work week. If unknown, assume 48 hours.

$hrs_{wkend\text{-}open}$ = hours the office is open during the weekend. If unknown, assume 10 hours. [2078]

# of Receptacles = Number of plug sockets on each smart socket

= Actual

Receptacle Factor = 1 if number of receptacles =1

= 0.85 if number of receptacles > 1[2079]

weeks/year = number of weeks per year

= 52.2

ISR = In Service Rate

= Assume 0.969 for commercial Direct Install application[2080]

[2075] Standby Power Summary Table contained in "Standby Power", Lawrence Berkeley National Laboratory, Building Technology and Urban Systems Division, , see "List of Standby Products – StandbyTable.xlsx, Standby Max column"

[2076] In the absence of empirical data, a 50% adjustment for appliances assumed to be on during out of hours is applied.

[2077] Average smart socket wattage found in Guidehouse, 'ComEd Small Business Kits CY2020 Impact Evaluation Report 2021-04-01 Final.pdf'.

[2078] Unknown hours are based on a Guidehouse review of open hours for 487 participants in this measure.

[2079] In smart sockets with more than one receptacle, if one piece of equipment is powered on all receptacles will be receiving power. Receptacle factor is intended to account for the uncertainty around receptacle use in multi-receptacle units

[2080] Based upon review of the PY2 and PY3 ComEd Direct Install Residential program surveys. This value could be modified based upon commercial application evaluation.

= Assume 0.28 for kits that include two smart sockets[2081]

= Assume 0.36 for kits that include one smart socket[2082]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A due to no savings attributable to standby losses between 1 and 5 PM.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-SSOC-V03-270101

REVIEW DEADLINE: 1/1/2029

[2081] This ISR is based on the results of surveys of ComEd Small Business Kit recipients conducted in the Spring of 2021. This result includes the reduction in the installation rate from the survey respondents that indicated they did not install the application which is necessary to use the smart socket as intended.

[2082] This ISR is based on the results of the surveys of ComEd Small Business Kit recipients conducted in the Spring of 2021. It is based on an estimate of what the ISR would be if the kit only included a single socket even though all the kits distributed by ComEd included two sockets. Similar to the ISR for the two socket kits, this ISR accounts for the reduction in the installation rate from the survey respondents that indicated they did not install the application which is necessary to use the smart socket as intended.

4.9.20 Lithium Ion Fork Truck Batteries

DESCRIPTION

This measure applies to electric fork trucks used in commercial, industrial, and warehouse environments. Electric fork trucks with lithium ion battery systems are more efficient than electric fork trucks with traditional lead acid battery systems because the lithium ion batteries have lower internal resistance. This allows the batteries to transfer power faster, reduces waste heat, and reduces standby losses.

Electric fork trucks can be purchased with lithium ion battery systems or an existing electric fork truck can be retrofitted to use a lithium ion battery system. An electric fork truck can be converted to a lithium ion battery system by removing the lead acid battery and installing a battery case that includes a series of lithium ion batteries and the appropriate ballast to meet weight and balance specifications for the fork truck. The lithium ion battery case is a one-for-one equivalent replacement of the lead acid battery in respect to capacity, shape, and weight. The fork truck may require a new charger to work with the new lithium ion battery system. Electric fork trucks can also replace propane or diesel powered fork truck in a one to one scenario. Where a facility normally operates a fleet of fossil-fueled fork trucks a fossil-fuel baseline should be considered for any additional fork trucks that might be purchased beyond the current quantity of trucks operating at the facility.

This measure was developed to be applicable to the following program types: TOS and RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

Class I, Class II, or Class III fork trucks that are powered by lithium ion batteries with minimum 8-hour shift operation five days per week.

DEFINITION OF BASELINE EQUIPMENT

Class I, Class II, or Class III fork trucks that are powered by lead acid batteries or fossil-fuels such as propane or diesel with minimum 8-hour shift operation five days per week.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

15 years.[2083]

DEEMED MEASURE COST

Costs will vary significantly based on the capacity and class of the fork truck. Costs for this measure should be determined by actual quotes obtained from manufacturers and estimated labor. If not available, it is estimated that a new lithium ion fork truck would cost $34,400 compared with $17,200 for a new lead-acid battery fork truck, $24,200 for a propane and $25,100 for a diesel fork truck.[2084]

Converting a lead acid battery fork truck to a lithium ion battery system would cost $17,000.[2085]

LOADSHAPE

Loadshape C14 - Indust. 1-shift (8/5) (e.g., comp. air, lights)

Loadshape C15 - Indust. 2-shift (16/5) (e.g., comp. air, lights)

[2083] Lifetime of measure assumed to be limited by the lifetime of the lithium ion charger. See reference file Suzanne Foster Porter et al., "Analysis of Standards Options for Battery Charger Systems", (PG&E, 2010), 45.
[2084] Estimates for new lithium ion, propane and diesel from Dennis, Allen and Vairamohan, Bashkar. "EPRI Forklift (Lift Truck) Comparison with Capital Costs." Electric Power Research Institute. Accessed April 19, 2022. https://et.epri.com/ForkliftCalculator.html. A new lead-acid battery is estimated to be approximately half the cost of a lithium ion, as suggested in Thomas, Pete. "Is a Lithium Ion Forklift Battery Worth the Extra Expense?" Toyota Material Handling Northern California. https://www.tmhnc.com/blog/lithium-ion-forklift-battery-cost-and-runtime.
[2085] Thomas, Pete. "Is a Lithium Ion Forklift Battery Worth the Extra Expense?" Toyota Material Handling Northern California. Accessed May 5, 2021. https://www.tmhnc.com/blog/lithium-ion-forklift-battery-cost-and-runtime.

Loadshape C16 - Indust. 3-shift (24/5) (e.g., comp. air, lights)

Loadshape C17 - Indust. 4-shift (24/7) (e.g., comp. air, lights)

COINCIDENCE FACTOR

It is assumed that lead acid battery fork trucks are charged overnight. Therefore, the coincidence factor is assumed to be 0.0 for 1-shift and 2-shift operations and 1.0 for 3-shift and 4-shift operations.[2086]

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS AND FOSSIL FUEL SAVINGS

Non-fuel switch (baseline of lead-acid fork truck):

$$\Delta kWh = (CAP * DOD * CHG * (1/ EE_{LAB} - 1/EE_{LIB})$$

Where:

CAP = Capacity of Battery

= Use actual battery capacity, otherwise use a default value of 35 kWh[2087]

DOD = Depth of Discharge

= Use actual depth of discharge, otherwise use a default value of 80%.[2088]

CHG = Number of Charges per year

= Use actual number of annual charges, if unknown use values below based on the type of operation

Standard Operations	Number of Charges per year
1-shift (8 hrs/day – 5 days/week)	520
2-shift (16 hrs/day – 5 days/week)	1,040
3-shift (24 hrs/day – 5 days/week)	1,560
4-shift (24 hrs/day – 7 days/week)	2,184

EE_{LAB} = Energy Efficiency of Lead Acid Battery

= Use actual efficiency of battery for retrofit, for new or unknown use 46%[2089]

EE_{LIB} = Energy Efficiency of Lithium Ion Battery

= Use actual efficiency of battery, if unknown use 73%[2089]

[2086] Matley, Ryan. May 29, 2009. "Industrial Battery Charger Energy Savings Opportunities." Emerging Technologies Program Application Assessment Report #0808. Pacific Gas & Electric.

[2087] Renquist, Jacob V., Brian Dickman, and Thomas H. Bradley. June 19, 2012. "Economic comparison of fuel cell powered forklifts to battery powered forklifts." International Journal of Hydrogen Energy, Volume 37, Issue 17.

[2088] Matley, Ryan. May 2009. "Measuring Energy Efficiency Improvements in Industrial Battery Chargers." Energy Systems Laboratory.

[2089] Abdulhameed, Alshaebi, Husam Dauod, and Sang Won Yoon. May 2017. "Evaluation of Different Forklift Battery Systems Using Statistical Analysis and Discrete Event Simulation." Industrial and Systems Engineering Conference. Pittsburg, PA.

Fuel switch measures (baseline of propane or diesel fork truck):

Fuel switch measures must produce positive total lifecycle energy savings (i.e., reduction in Btus at the premises) in order to qualify. This is determined as follows (note for early replacement measures the lifetime savings should be calculated by calculating savings for the remaining useful life of the existing equipment and for the remaining measure life):

$$\Delta SiteEnergySavings\ (MMBtu) = (CAP * DOD * CHG * (1/EE_{BASE} - 1/EE_{LIB})) * 3{,}412/1{,}000{,}000$$

Where:

EE_{BASE} = Energy efficiency of baseline fork truck. If unknown, assume the efficiency values below based on the type of fork truck. [2090]

= 20.4% for Propane

= 20.5% for Diesel

3,412 = Btu per kWh

1,000,000 = Btu per MMBtu

If SiteEnergySavings calculated above is positive, the measure is eligible.

Calculate savings as follows:

$$\Delta kWh = \Delta SiteEnergySavings * 1{,}000{,}000 / 3{,}412$$

Savings for each shift operation and baseline technology type using defaults provided above are provided below:

Standard Operations	Lead Acid	Diesel		Propane	
	Δ Elec (kWh)	ΔSiteEnergy Savings (MMBtu)	ΔSiteEnergy Savings (ΔkWh)	ΔSiteEnergy Savings (MMBtu)	ΔSiteEnergy Savings (ΔkWh)
1-shift (8 hrs/day – 5 days/week)	11,707	174	51,079	175	51,427
2-shift (16 hrs/day – 5 days/week)	23,414	349	102,158	351	102,855
3-shift (24 hrs/day – 5 days/week)	35,121	523	153,238	526	154,282
4-shift (24 hrs/day – 7 days/week)	49,169	732	214,533	737	215,995

SUMMER COINCIDENT PEAK DEMAND SAVINGS

It is assumed there is zero peak demand savings.

[2090] Dennis, Allen and Vairamohan, Bashkar. "EPRI Forklift (Lift Truck) Comparison with Capital Costs." Electric Power Research Institute. Accessed April 19, 2022. https://et.epri.com/ForkliftCalculator.html. Tank-to-wheel efficiency is based on dividing output electricity by input propane energy, assuming HHV of 91,333 BTU/gallon for propane and 138,500 BTU/gallon for diesel.

FOSSIL FUEL SAVINGS

Calculation provided together with Electric Energy Savings above.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

Lithium ion batteries offer several O&M advantages over lead acid batteries. These benefits include, but are not limited to:

- Lithium ion batteries charge must faster, which results in less downtime.[2091]
- There is no requirement for changing out batteries at the end of a shift or having multiple spare batteries in stock.[2091] A 3-shift operation would require a facility to have three separate lead acid batteries for each fork truck, so they could swap out batteries at the end of each shift. A lithium ion battery is charged while still in the fork truck and can use opportunity charging during employee breaktime.
- Fewer maintenance issues and no requirement for battery watering[2091]
- Longer operating life.[2092] Lithium ion batteries can last nearly four times as long as lead acid batteries.

These benefits should be considered and evaluated on a project-by-project basis. It is estimated that lithium ion fork truck adoption saves a facility 65 labor hours per truck on an annual basis.[2093]

COST EFFECTIVENESS SCREENING AND LOAD REDUCTION FORECASTING WHEN FUEL SWITCHING

This measure can involve fuel switching from fossil fuel to electric.

For the purposes of forecasting load reductions due to fuel switch projects per Section 16-111.5B, changes in site energy use at the customer's meter (using ΔkWh algorithm below) adjusted for utility line losses (at-the-busbar savings), customer switching estimates, NTG, and any other adjustment factors deemed appropriate, should be used.

The inputs to cost effectiveness screening should reflect the actual impacts on the electric and fuel consumption at the customer meter and, for fuel switching measures, this will not match the output of the calculation/allocation methodology presented in the "Fuel Switch Measures" section above. Therefore in addition to the calculation of savings claimed, the following values should be used to assess the cost effectiveness of the measure.

ΔTherms = [Fossil Fuel Consumption Saved]

= [CAP * DOD * CHG * EE_{LIB}/EE_{BASE} * 3412/100,000]

ΔkWh = [Electric Consumption Added]

= - [CAP * DOD * CHG]

MEASURE CODE: CI-MSC-LION-V03-250101

REVIEW DEADLINE: 1/1/2028

[2091] Abdulhameed, Alshaebi, Husam Dauod, and Sang Won Yoon. May 2017. "Evaluation of Different Forklift Battery Systems Using Statistical Analysis and Discrete Event Simulation." Industrial and Systems Engineering Conference. Pittsburg, PA.
[2092] Mongird, Kendall, Viswanathan, Vilayanur V., Balducci, Patrick J., Alam, Md Jan E., Fotedar, Vanshika, Koritarov, V S., and Hadjerioua, Boualem. July 2019. "Energy Storage Technology and Cost Characterization Report". U.S. Department of Energy – HydroWires. https://doi.org/10.2172/1573487.
[2093] Abdulhameed, Alshaebi, Husam Dauod, and Sang Won Yoon. May 2017. "Evaluation of Different Forklift Battery Systems Using Statistical Analysis and Discrete Event Simulation." Industrial and Systems Engineering Conference. Pittsburg, PA.

4.9.21 Building Operator Certification

DESCRIPTION

Building Operator Certification (BOC) is a training and certification program for commercial and public sector building operators. The curriculum teaches participants how to improve building comfort and efficiency by optimizing the building's systems. BOC curriculums provide participants with knowledge about system operations, proper maintenance practices, occupant communication, and occupant comfort. Participants realize energy savings by utilizing the knowledge gained to improve their building operations through O&M and capital measures.

Evaluators in Illinois used differing levels of engagement with participants to estimate savings from the BOC training. While deeming savings does not fully capture the individual and varied actions that participants made as a result of their BOC training, it is a reasonable approach to better align the expected level of impacts and program expenditures with evaluation expenditures. Deemed savings for this measure represent a weighted average of analyses' results from several Illinois BOC program evaluations. The evaluations estimated net savings and were developed per square foot of building area to account for the diversity of building sizes across Illinois. All savings estimating algorithms presented in this work paper are for net savings. Participants are required to complete a rigorous BOC course and can only claim savings for the facilities for which the individual taking the course are responsible.

The 2023 IL-TRM v11.0 will be used to verify savings for 2021 and 2022 participants, and these results will be included in the final 2022 BOC evaluations (produced by April 30, 2023). This will include 2 years' worth of participants due to the annualization of savings for 2022 participants and the transition year of 2021 to the deemed approach.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is facilities operated by participants who complete a BOC training program. Participants must complete either the BOC Level I or Level II course and obtain a certificate of completion to be eligible for savings[2094]. Eligible BOC programs must cover the following subject areas:

BOC Level I

- Efficient Operation of HVAC Systems
- Measuring and Benchmarking Energy
- Efficient Lighting Fundamentals
- HVAC Controls Fundamentals
- Indoor Environmental Quality
- Common Opportunities for Low-Cost Operational Improvement

BOC Level II

- Building Scoping and Operational Improvements
- Optimizing HVAC Controls for Energy Efficiency
- Introduction to Building Commissioning
- Water Efficiency for Building Operators
- Project Peer Exchange

The BOC course must include formal instruction (i.e., lectures), individual projects and group exercises, bringing the total course time to at least 61 hours. Participants must obtain a training certificate of completion to be eligible for savings. Individuals who participate are not eligible for savings more than twice over the measure life, once for BOC Level I and another for BOC Level II. The entire floor area for any given building can only be used once over the measure life, and evaluators will verify attendees' participation year-over-year.

[2094] Future evaluation research could explore savings differences between Level I and Level II participants.

The savings factors for this measure were developed based on an examination of savings using a weighted average approach from several similar BOC programs. The table below outlines the referenced evaluation studies, and key parameters which were inputs to this measure characterization. It is important to note that the savings information referenced is net. Therefore, this measure does not require the additional application of a net-to-gross ratio.

No previous custom study of customer participation in BOC shall inform eligibility for this measure.

Utility or Program Administrator	Year	Participants	Average Building Area	MWh/ Participant	kW/ Participant	Therm/ Participant	Incremental Measure Costs ($/Participant)[2095]
Ameren Illinois[2096]	2020	10	140,137	60.002	0.83	987	$253.94
Ameren Illinois[2097]	2019	12	408,309	64.421	12.80	3,615	$114.93
Ameren Illinois[2098]	2021	8	502,944	23.650	0.00	0	$0.00
ComEd[2099]	2020	33	319,068	132.600	14.70	N/A	$8,878.79
ComEd[2100]	2021	2	517,250	20.755	1.55	N/A	$9,310.50
Nicor Gas[2101]	2021	3	517,250	0.000	0.00	234	$0.00
Weighted Average[2102]			344,708	91.994	10.00	1,635	$4,640.29

DEFINITION OF BASELINE EQUIPMENT

The baseline is building operations as they existed before the participant completed the BOC training course.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for BOC savings is 13 years[2103]. Based on analyzed research, assume 42%[2104] of BOC savings are derived from O&M measures that have a 4-year measure life[2105]. This should be handled similar to other midlife adjustments, where after 4 years, a midlife adjustment factor of 58% is applied for the remaining nine years of the measure life.

[2095] Total incremental measure costs from the evaluation, net of O&M adjustments (if applicable), divided by the number of BOC participants.
[2096] Opinion Dynamics, 'Ameren Illinois Company 2020 Business Program Impact Evaluation Report, Final', April 28th 2021.
[2097] Opinion Dynamics, 'Ameren Illinois Company 2019 Business Program Impact Evaluation Report, Final', April 30th 2020.
[2098] Opinion Dynamics, 'Ameren Illinois Company 2019 Business Program Impact Evaluation Report, Final', April 29th 2022.
[2099] The ComEd evaluation includes both 2018 and 2019 participants. The interview sample did not stratify by program year, so the savings per participant are the same for each year. Guidehouse, 'ComEd Building Operator Certification Pilot Impact Evaluation Report', April 12th, 2021.
[2100] Guidehouse, 'ComEd Building Operator Certification Pilot Impact Evaluation Report', April 19th, 2022.
[2101] Guidehouse completed follow-up interviews with 2018 – 2020 participants from ComEd's program which also had gas service. Three interviews were completed, and all were Nicor Gas customers who completed no cost scheduling and usage tracking. The savings for these participants was calculated following the methodology used to determine the savings for ComEd's CY2022 Building Operator Certification Pilot.
[2102] The weighted average numbers are used to determine the savings parameters within this measure. The savings parameters are set so the participated weighted average savings using the TRM algorithm, including the building area cap, equals the participant weighted average savings from the referenced evaluation studies.
[2103] Average measure life of capital measures from the ComEd CY2020 evaluation.
[2104] Weighted average from referenced evaluation studies which outlined lifetime information.
[2105] EUL for operational updates when the controls type is unknown. See Attachment B:Effective Useful Life for Custom Measure. Effective Useful Life for Retro-commissioning and Behavior Programs memo by Guidehouse, September 17, 2019.

DEEMED MEASURE COST

The deemed training measure cost is $1,695.[2106] In addition, the incremental cost of capital and O&M measures should also be included. If unknown, use an incremental measure cost of $0.014/ft^2.[2107]

LOADSHAPE

C23 – Commercial Ventilation

COINCIDENCE FACTOR

The demand savings factor (C_d) is already based upon coincident savings, and thus there is no additional coincidence factor for this characterization.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = C_e * Area$$

Where

Area = Building area operated by the participant. The maximum eligible area per participant is 500,000 ft^2. In the event there are multiple participants who operate the same building (i.e. service address), or group of buildings, the program administrator can only claim savings on building square footage once (i.e., they cannot claim savings based on the same square footage for multiple participants), unless the managed square footage exceeds 500,000 ft^2; in which case, the program administrator can continue to claim savings up to the 500,000 ft^2 per participant cap until the total square footage has been accounted for.

C_e = unit area kWh savings constant per participant[2108], 0.274 kWh/ft^2/participant

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$kW = C_d * Area / 1000$$

Where

C_d = Unit demand savings constant[2109], 0.03 W/ft^2 (capped)/participant

1000 = unit conversion from W to kW

FOSSIL FUEL SAVINGS

$$Therms = C_g * Area$$

Where

[2106] The current price to take the BOC training and certification in Illinois. https://www.boccentral.org/training/illinois. Accessed May 2022.
[2107] Based on evaluated measure incremental costs, net of O&M adjustments when available, from Ameren Illinois and ComEd BOC programs in Illinois.
[2108] Average net savings per participant from the evaluations referenced. See table of evaluations in the Definition of Efficient Equipment section of this measure.
[2109] Average net demand savings per participant from the evaluations referenced. See table of evaluations in the Definition of Efficient Equipment section of this measure.

C_g = Unit gas savings constant[2110], 0.0046 therms/ft^2 (capped)/participant

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

Water and other non-energy impacts could be added in future updates.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-BOC-V02-250101

REVIEW DEADLINE: 1/1/2029

[2110] Average net natural gas savings per participant from the evaluations referenced. See table of evaluations in the Definition of Efficient Equipment section of this measure.

4.9.22 Warm-Mix Asphalt Chemical Additives

DESCRIPTION

Warm-Mix Asphalt (WMA) is the name for a variety of technologies that allow for production and placement of asphalt at temperatures lower than traditional Hot-Mix Asphalt (HMA). The production temperature of WMA is typically 25°F to 90°F below that of HMA, resulting in reduced energy consumption. The actual temperature reduction depends upon the warm mix technology used. Currently, there are three categories of WMA technologies: asphalt foaming technologies, organic additives, and chemical additives.

The asphalt foaming technologies include a variety of processes to foam asphalt, including water-injecting systems, damp aggregate, or the addition of a hydrophilic material such as a zeolite. In the asphalt plant, the water turns to steam, disperses throughout the asphalt, and expands the binder, providing a corresponding temporary increase in volume and fluids content, similar in effect to increasing the binder content. Chemical additives often include surfactants that aid in coating and lubrication of the asphalt binder in the mixture. Lastly, organic additives are typically special types of waxes that cause a decrease in binder viscosity above the melting point of the wax.

In additional to energy savings, using WMA in place of HMA reduces greenhouse gas emissions and provides multiple non-energy benefits, such as beter compaction, cool-weather paving, longer haul distances, and improved working conditions for the paving crew (reduction of fumes and odors). Warm-mix chemical additives allow for the mixing and placement of asphalt at temperatures lower than traditional HMA while maintaining similar strength, durability, and performance characteristics.

This measure is applicable to the industrial market with the end user in the transporation sector. WMA can be used in any climate, as the lower mix temperature allows WMA to be used in cooler ambient conditions than traditional HMA.

This measure was developed to be applicable to the following program types: TOS. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case is WMA. WMA is generally produced at temperatures ranging from 25°F to 90°F lower than HMA.[2111]

General WMA technologies can be categorized as chemical additives, organic additives, and water-based foaming methods. Chemical additives reduce the internal friction between aggregate particles and thin films of binders when subjected to high shear rates during mixing and high shear stress during compaction. In contrast, the other two WMA methods rely on reduction of binder viscosity.

DEFINITION OF BASELINE EQUIPMENT

The baseline case is traditional HMA. HMA is traditionally mixed between 280°F and 320°F.[2112]

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life is 1 year. Savings occur during production, and last only as long as the production runs. Since savings and costs scale to tons of asphalt production, a 1-year measure life appropriately tracks lifecycle savings.

[2111] West, R.C., M.C. Rodezno, G. Julian, B.D. Prowell, B. Frank, L.V. Osborn, & A.J. Kriech (2014). "NCHRP Report 779:Field Performance of Warm-Mix Asphalt Technologies. Transportation Research Board of the National Academies", Washington, D.C. doi:10.17226/22272.

[2112] West, R.C., M.C. Rodezno, G. Julian, B.D. Prowell, B. Frank, L.V. Osborn, & A.J. Kriech (2014). "NCHRP Report 779:Field Performance of Warm-Mix Asphalt Technologies. Transportation Research Board of the National Academies", Washington, D.C. doi:10.17226/22272.

DEEMED MEASURE COST

The costs of WMA depend primarily on the type of WMA technology that is used. Of the WMA technology options, water-injection asphalt foaming typically have the lowest cost per ton. Water injection WMA technologies have a lower incremental cost at around $0.08 per ton.[2113]

Compared to other WMA technologies, additive based WMA technologies increase the mix costs by $2.50 per ton[2114] due to the cost of chemicals and freight costs.

LOADSHAPE

N/A

COINCIDENCE FACTOR

N/A

Algorithm

CALCULATION OF ENERGY SAVINGS

Energy savings are dependent on multiple factors that primarily affect the production of WMA. The following factors have been identified as the primary contributors to energy consumption:

- Mixing drum temperature
- Additive type

ELECTRIC ENERGY SAVINGS

N/A.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

N/A.

FOSSIL FUEL SAVINGS

Average temperature reduction achieved by plants that reduce mix production temperature when using WMA must be determined to estimate reductions in energy consumption. In practice, WMA production temperatures when using water-injection foaming technologies are typically about 25°F lower than those for hot mix asphalt (HMA) using the same mix design. WMA produced with additives tends to have substantially lower mixing temperatures. For the purpose of estimating energy savings, a temperature difference of 50°F is assumed for additive-type WMA compared to HMA using the same mix design.

$$therms_{savings} = tons \times SF$$

Where:

tons = Tons of asphalt produced

SF = WMA production savings factor (therms/ton)

= See Table for SF for Water Injection Foaming and Additives

[2113] West, R.C., M.C. Rodezno, G. Julian, B.D. Prowell, B. Frank, L.V. Osborn, & A.J. Kriech (2014). "NCHRP Report 779:Field Performance of Warm-Mix Asphalt Technologies. Transportation Research Board of the National Academies", Washington, D.C. doi:10.17226/22272.

[2114] West, R.C., M.C. Rodezno, G. Julian, B.D. Prowell, B. Frank, L.V. Osborn, & A.J. Kriech (2014). "NCHRP Report 779:Field Performance of Warm-Mix Asphalt Technologies. Transportation Research Board of the National Academies", Washington, D.C. doi:10.17226/22272.

Energy Savings by mixing temperature reduction

WMA Production Technology	[A] Energy Savings [2115] (therms/Δ°F/ton)	[B] Temperature Reduction (°F)	[C] = [A]*[B] SF (therms/ton)
Water Injection Foaming	0.011	25	0.275
Additives	0.011	50	0.55
Custom Documented	0.011	Custom	Calculated

Example:

A plant producing 1,000 ton ashphalt everyday now decides to adopt additives for energy savings and non energy benefits. The savings for that plant will be computed:

Savings = 1,000 tons * 0.55 (therms/ton)

= 550 therms saved.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

In addition to reduced energy consumption, reduction in production temperatures results in reduced greenhouse gas emissions from the combustion process and any emissions from the mixed asphalt. The reduction of emissions, fumes, and odors results in a healthier work environment for production operators, truck drivers, and application workers. The lower temperature mix also allows for an extended paving season, night paving, and longer hauling distances for the WMA in comparison to HMA with faster application times.

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-WMIX-V02-240101

REVIEW DEADLINE: 1/1/2030

[2115] 1100 Btu/Δ°F/ton from: West, R.C., M.C. Rodezno, G. Julian, B.D. Prowell, B. Frank, L.V. Osborn, & A.J. Kriech (2014). "NCHRP Report 779:Field Performance of Warm-Mix Asphalt Technologies. Transportation Research Board of the National Academies", Washington, D.C. doi:10.17226/22272, converted to 0.011 Therms/Δ°F/ton by dividing by 100,000 Btu/therm.

4.9.23 Energy Efficient Hand Dryers

DESCRIPTION

This measure consists of installing efficient hand dryers that save energy by drying with air movement, using motion sensors, and reducing drying time. Energy efficient hand dryers use less energy per dry than standard hand dryers. Hand dryers are applicable in retail, commercial, and industrial settings.

This measure was developed to be applicable to the following program types: TOS, ERET. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

To qualify for this measure, a hand dryer must be motion operated with rated load of 1,500 W or less.

DEFINITION OF BASELINE EQUIPMENT

The baseline equipment for this measure is a push-button operated hand dryer with connected load in excess of 1,500 Watts.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The measure life for a new energy efficient hand dryer is 10 years[2116].

DEEMED MEASURE COST [2117]

Incremental cost is $483. Baseline cost for a hand dryer is $368. Efficient cost for an efficient hand dryer is $851.

LOADSHAPE

Loadshape C02 - Commercial Electric DHW

COINCIDENCE FACTOR

Formula of Coincidence Factor is as follows:

$$CF = \frac{Cycle\ Time\ per\ Use * Use\ per\ Day * Site\ Occupied\ Days\ per\ Year}{Site\ Occupied\ Hours\ per\ Day * 365}$$

[2116] Based on studies conducted by two separate parties; Comparative Environmental Life Cycle Assessment of Hand Drying Systems by Quantis (pg 2) and Guidelines to Reduce/Eliminate Paper Towel Use by Installing Electric Hand Dryers by Partners in Pollution Prevention P3 (pg 17).

[2117] Cost is the average retail costs for 16 baseline and 10 efficient hand dryers. See *Hand_Dryer_Analysis.xlsx* . Cost source: RestroomDirect.com

Where:

Usage	Example Building Types	Cycles per Day[2118]	Occupied Days per Year (DPY)[2119]	Occupied Hours per Day[2120]	Coincidence Factor (CF)
Low	Office, Warehouse	50	250	8	0.04
Moderate	Restaurant, Small Grocery, Small Retail	125	365	15	0.09
High – <12 hr/day	K-12 School, University, Theater, Conference Center	250	200	9	0.16
High – >=12 hr/day	Large Grocery, Retail Department Store	375	365	13	0.29
Heavy - Intermitent	Stadium, Theater, Place of Worship	250	80	6	0.10
Heavy Duty - 24/7	Transportation Center, Airport	750	365	23	0.34

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = CPD * DPY * \frac{(Watts_{Base} * CycleTime_{Base} - Watts_{EE} * CycleTime_{EE})}{(3600\ \frac{sec}{hr} * 1000\ \frac{Watts}{kW})}$$

Where:

CPD = Number of cycles per day.
= If not known, use assumption as defined in Coincidence Factor section.

DPY = Number of days the facility operates per year.
= If not known, use assumption as defined in Coincidence Factor section.

Watts = Unit wattage.
= Actual. If not known, use assumption from the table below.

Assumptions	Power (watts)
Baseline[2121]	2,036
Efficient[2122]	1,066

[2118] Guidehouse, Inc. Engineering Estimate, 2022
[2119] Illinois TRM v9.0, Days per year, from 4.3.2 Low Flow Faucet Aerators
[2120] Occupancy based on Lighting HOU from Section 4.5, combined with days per year from Section 4.3.2.
[2121] CLEAResult survey of 24 hand dryers in convenience stores in Arkansas. See *Hand_Dryer_Analysis.xlsx*.
[2122] CLEAResult cost/specification survey of 10 unique efficient hand dryers. See *Hand_Dryer_Analysis.xlsx*.

Cycle Time = Runtime seconds per use.

= Actual. If not known, use assumption from the table below.

Assumptions	Cycle Time (seconds)
Baseline[2123]	37
Efficient[2124]	12

For example, a new efficient hand dryer replacing a baseline hand dryer at a large grocery store, with unknown cycles per day and unknown days per year:

ΔkWh = (375 * 365 * (2,036*37 - 1,066*12) / (3600*1000)
= 2378 kWh

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta\text{kW_Peak} = \frac{(Watts_{Base} - Watts_{EE})}{1000} * CF$$

Where:

$Watts_{Base}$ = As defined in section above.

$Watts_{EE}$ = As defined in section above.

CF = Coincidence Factor as defined in Coincidence Factor section (shown here for convenience):

$$CF = \frac{Cycle\ Time\ per\ Use * Use\ per\ Day * Site\ Occupied\ Days\ per\ Year}{Site\ Occupied\ Hours\ per\ Day * 365}$$

Where:

[2123] CLEAResult survey of 24 hand dryers in convenience stores in Arkansas. See *Hand_Dryer_Analysis.xlsx*.
[2124] CLEAResult cost/specification survey of 10 unique efficient hand dryers. See *Hand_Dryer_Analysis.xlsx*.

Usage	Example Building Types	Cycles per Day[2125]	Occupied Days per Year (DPY)[2126]	Occupied Hours per Day[2127]	Coincidence Factor (CF)
Low	Office, Warehouse	50	250	8	0.04
Moderate	Restaurant, Small Grocery, Small Retail	125	365	15	0.09
High – <12 hr/day	K-12 School, University, Theater, Conference Center	250	200	9	0.16
High – >=12 hr/day	Large Grocery, Retail Department Store	375	365	13	0.29
Heavy - Intermitent	Stadium, Theater, Place of Worship	250	80	6	0.10
Heavy Duty - 24/7	Transportation Center, Airport	750	365	23	0.34

For example, a new efficient hand dryer replacing a baseline hand dryer at a large grocery store, with unknown cycles per day and unknown days per year:

ΔkW = ((2,036 – 1,066)/1000)*0.29
= 0.28 kW

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-EEHD-V02-230101

REVIEW DEADLINE: 1/1/2030

[2125] *Guidehouse, Inc. Engineering Estimate, 2022*
[2126] *Illinois TRM v9.0, Days per year, from 4.3.2 Low Flow Faucet Aerators*
[2127] *Occupancy based on Lighting HOU from Section 4.5, combined with days per year from Section 4.3.2.*

4.9.24 Elevator Modernization

DESCRIPTION

This measure covers the upgrade of existing elevators by replacing critical components in order for elevators to be able to handle new technology, have better performance, and to operate more efficiently. Elevator modernization typically includes motor upgrades, elevator drive system upgrades, and elevator controller replacement.

This measure is applicable to the following program types: RF.

DEFINITION OF EFFICIENT EQUIPMENT

This measure is applicable when retrofitting an existing Elevator with a Higher efficiency Motor/ Drive [Silicon Controlled Rectifier (SCR), Pulse Width Modulator (PWD) or variable Voltage variable frequency drive (VVVF)]/ Controller.

Only applicable to Office and Multifamily buildings (e.g.- small offices, large offices, low-rise multifamily, High-rise multifamily)

DEFINITION OF BASELINE EQUIPMENT

The baseline is existing elevator systems with lower efficiency Motor/ Drive [only listed drive system applicable: Motor-Generator (M-G) set system, Silicon Controlled Rectifier (SCR) and Pulse Width Modulator (PWD)]/ Controller.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected lifetime of the measure is 15 years.[2128]

DEEMED MEASURE COST

Costs are highly specific to each installation, as so the actual Equipment and Labor costs should be used.

LOADSHAPE

N/A

COINCIDENCE FACTOR

The coincidence factor for this measure is 1.0. Appling average load factor at peak is a conservative approach for estimating summer peak demand savings.[2129]

Algorithm

CALCULATION OF ENERGY SAVINGS

Only the following control upgrade configurations are applicable to this measure

Acceptable Elevator Drive Replacement Configuration

Baseline Condition	Compliance Condition
(M-G) Set	SCR, PWM, VVVF drives
SCR drive	PWM, VVVF drive
PWM drive	VVVF drive

Methods for calculating savings for M-G set baseline systems are presented below separate from SCR or PWM drive baseline systems in order to differentiate the baseline efficiency term as described in the Baseline Efficiency

[2128] New York Standard Approach for Estimating Energy Savings from Energy Efficiency Programs V11- End of Useful life, https://dps.ny.gov/system/files/documents/2023/12/nys-trm-v11_filing.pdf

[2129] New York Standard Approach for Estimating Energy Savings from Energy Efficiency Programs V11- ELEVATOR MODERNIZATION.

section below, but also to account for AC motor idling energy consumption present in an M-G set drive. There is no idling motor present in PWM or SCR drive systems, and thus no savings associated with idle energy is claimed in those cases.

ELECTRIC ENERGY SAVINGS

Motor-Generator set (M-G) as baseline system:

$$\Delta kWh = units \times [\Delta kWh_{baseline} - \Delta kWh_{ee} + (RegenSF \times \Delta kWh_{regen})]$$

$$\Delta\text{kWh}_{baseline} = \left[\frac{lb_{baseline} \times (1 - OCW_{baseline}) \times (ft/min)_{baseline}}{33{,}000 \times Eff_{hoist}} \times \frac{1}{Eff_{baseline}} \times 0.746 \times LF_{avg} \times hrs\right] + \left[\frac{hp \times 0.746 \times LF_{motor,idle}}{Eff_{baseline}} \times (8{,}760 - hrs) \times F_{idle}\right]$$

$$\Delta\text{kWh}_{ee} = \frac{lb_{ee} \times (1 - OCW_{ee}) \times (ft/min)_{ee}}{33{,}000 \times Eff_{hoist}} \times \frac{1}{Eff_{ee}} \times 0.746 \times LF_{avg} \times hrs$$

$$\Delta\text{kWh}_{regen} = \frac{lb_{ee} \times (1 - OCW_{ee}) \times (ft/min)_{ee} \times 0.746 \times Eff_{ee}}{33{,}000} \times Eff_{regen} \times F_{regen} \times hrs$$

SCR drive or PWM drive as baseline system:

$$\Delta kWh = units \times [\Delta kWh_{baseline} - \Delta kWh_{ee} + (RegenSF \times \Delta kWh_{regen})]$$

$$\Delta\text{kWh}_{baseline} = \frac{lb_{baseline} \times (1 - OCW_{baseline}) \times (ft/min)_{baseline}}{33{,}000 \times Eff_{hoist}} \times \frac{1}{Eff_{baseline}} \times 0.746 \times LF_{avg} \times hrs$$

$$\Delta\text{kWh}_{ee} = \frac{lb_{ee} \times (1 - OCW_{ee}) \times (ft/min)_{ee}}{33{,}000 \times Eff_{hoist}} \times \frac{1}{Eff_{ee}} \times 0.746 \times LF_{avg} \times hrs$$

$$\Delta\text{kWh}_{regen} = \frac{lb_{ee} \times (1 - OCW_{ee}) \times (ft/min)_{ee} \times 0.746 \times Eff_{ee}}{33{,}000} \times Eff_{regen} \times F_{regen} \times hrs$$

where:

ΔkWh = Annual electric energy savings

units = Number of units upgraded under the program

$Eff_{baseline}$ = Baseline equipment's combined Efficiency. The baseline condition is an existing M-G set, SCR drive, or PWM drive elevator system. The efficiency of the baseline elevator drive systems is derived as follows:

$$Eff_{baseline} = Eff_{motor,\ baseline} \times Eff_{gear,\ baseline} \times Eff_{drive,\ baseline}$$

$Eff_{motor,\ baseline}$ = Baseline motor efficiency (NEMA premium efficiency[2130])

$Eff_{drive,\ baseline}$ = Baseline drive efficiency, use actual if unknown use the values from Table below

Drive type	Efficiency[2131]
SCR 6	0.85
SCR12	0.90
PWM	0.94

[2130] Elevator Door Lock Monitoring & Energy Code Compliance presentation; Pg-19; https://www.nyc.gov/assets/buildings/pdf/Elevators_DLM_Energy_Code_Compliance.pdf, NY code Currently uses IE2 efficiency as code requirement.

[2131] Ibid, V11- ELEVATOR MODERNIZATION.

$Eff_{gear,\ baseline}$ = Baseline Gear efficiency, if the existing is Geared use 0.85 if not use 1.[2132]

Eff_{ee} = efficiency equipment's combined Efficiency. The compliance condition may be either Silicon-Controlled Rectifier (SCR) drive, Pulse Width Modulation (PWM) drive or Variable Voltage Variable Frequency (VVVF), Check the Calculation of energy savings section for acceptable replacement configuration.

$$Eff_{\text{ee}} = Eff_{motor,\text{ ee}} \times Eff_{gear,\text{ ee}} \times Eff_{drive,\text{ ee}}$$

$Eff_{motor,\ ee}$ = New motor efficiency, use actual

$Eff_{drive,\ ee}$ = New drive efficiency, use actual if unknown use the values from Table below

Drive type	Efficiency[2133]
SCR 6	0.85
SCR12	0.90
PWM	0.94
VVVF	0.95

$Eff_{Gear,\ ee}$ = New Gear efficiency, if the existing is Geared use 0.85 if not 1.[2134]

Eff_{regen} = regenerative efficiency, if unknown use 0.5.[2135]

Eff_{hoist} = hoist system efficiency, if unknown use 0.90.[2136]

RegenSF = Savings Factor for regenerative braking system. If Regenerative Breaking used 1 if not use 0.

$lbs_{baseline}$ = Baseline Car capacity.

lbs_{ee} = New Car capacity.

$OCW_{baseline}$ = Overweight of counterbalance as a fraction of car capacity. If unknown use 0.50.[2137]

OCW_{ee} = Overweight of counterbalance as a fraction of car capacity. If unknown use 0.50. [2138]

ft/min = Rated top velocity of car, in ft/min

LF_{avg} = Average load factor. If unknown use 0.35.[2139]

hrs = Annual hours of elevator operation. If unknown use 2,750.[2140]

hp = Horsepower of M-G set motor

$LF_{motor,\ idle}$ = M-G set motor load factor in idling mode, 0.11 [2141]

F_{idle} = Idling factor; used to account for fraction of run hours M-G set system in idling mode. Use the table below.

[2132] Ibid, V11- ELEVATOR MODERNIZATION.
[2133] Ibid, V11- ELEVATOR MODERNIZATION.
[2134] Ibid, V11- ELEVATOR MODERNIZATION.
[2135] Ibid, V11- ELEVATOR MODERNIZATION
[2136] Ibid, V11- ELEVATOR MODERNIZATION
[2137] The Vertical Transportation Handbook, 4th Edition, by George R. Strakosch and Robert S. Caporale, pg. 213.
[2138] Ibid, pg. 213.
[2139] ISO 25745-2:2015: Energy Performance of Lifts, Escalators and Moving Walks -- Part 2: Energy Calculation and Classification for Lifts (elevators).
[2140] The Vertical Transportation Handbook, 4th Edition, by George R. Strakosch and Robert S. Caporale, Table 4.2, Table 4.3, Chart 4.2
[2141] Ibid, V11- ELEVATOR MODERNIZATION.

Description	Idling factor[2142]
Timer incorporated	0.7
No Timer	1
Unknown	0.7

F_{regen} = Regenerative breaking factor; used account for fraction of run hours regenerative braking produces energy savings. If unknown use 0.5[2143] (Regenerative braking eliminates excess heat and supplies electric energy to the building 50% of run time: when lightly loaded car is raised, when fully loaded car is lowered, whenever the car decelerates).

0.746 = Conversion factor (kW/hp) 0.746 kW equals one electric horsepower

8,760 = Annual hours

33,000 = Conversion factor ((ft-lb/min)/hp), 33,000 foot-pounds per minute equals one electric horsepower.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Motor-Generator set (M-G) as baseline system-

$$\Delta\text{kW} = \text{Unit} \times \left\{ \frac{hp \times 0.746 \times LF_{motor,run}}{Eff_{baseline}} - \frac{lb_{ee} \times (1 - OCW_{ee}) \times (ft/min)_{ee} \times 0.746 \times LF_{peak}}{33{,}000 \times Eff_{hoist} \times Eff_{ee}} \right\} * \text{CF}$$

With SCR drive or PWM drive as baseline system-

$$\Delta\text{kW} = \text{Unit} \times \left\{ \left[\frac{lb_{baseline} \times (1 - OCW_{baseline}) \times (ft/min)_{baseline}}{Eff_{baseline}} - \frac{lb_{ee} \times (1 - OCW_{ee}) \times (ft/min)_{ee}}{Eff_{ee}} \right] \times \frac{0.746 \times LF_{peak}}{33{,}000 \times Eff_{hoist}} \right\} * \text{CF}$$

Where:

$LF_{motor,\ run}$ = M-G set motor load factor when loaded

= 0.9.[2144]

LF_{peak} = Peak load factor

= 0.75.[2145]

CF = Summer coincident factor

= 1.0

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

[2142] Ibid, V11- ELEVATOR MODERNIZATION.
[2143] Baldor Motors and Drives, Elevator Application Guide, pg. 3-6.
[2144] Ibid, V11- ELEVATOR MODERNIZATION.
[2145] ISO 25745-2:2015: Energy Performance of Lifts, Escalators and Moving Walks -- Part 2: Energy Calculation and Classification for Lifts (elevators). Coincidence factor is embedded within the peak load factor.

MEASURE CODE: CI-MSC-EVMD-V01-250101

REVIEW DEADLINE: 1/1/2029

4.9.25 Virtual AMI Driven Commissioning

DESCRIPTION

This measure applies to non-residential operations and maintenance (O&M) related energy savings opportunities identified via statistical analysis of customer interval meter data. To qualify for this measure, the savings opportunities must be identified via statistical identification of the appropriate target population. Individual baseline models are created for the population of non-residential customer meters and the target population is identified by screening the population for goodness-of-fit of baseline models based on hourly advanced metering infrastructure (AMI) data. The goodness-of-fit criteria are developed using accepted industry-wide methods that conform to IPMVP or other industry protocols and documents. The method is described in the Lawrence Berkeley National Laboratory's Site-Level Normalized Metered Energy Consumption Technical Guidance document[2146].

Energy advisors perform an in-depth analysis and screening of interval AMI data and associated customer account information to identify opportunities. Examples of sites flagged for intervention are those with a low overall load factor (suggesting significant variance in energy usage patterns), customers whose interval level data displays a lot of variability in energy usage profiles for the same periods of day or from one day to the next, and sites that have participated in other utility DSM programs, among other factors. Once prospective individual accounts have been screened, the Energy Advisor will contact the customer to introduce the program, review whether the identified opportunity is legitimate based on information regarding their business operations, hours of operation, equipment or building information, and discuss suggested energy conservation measures (ECM) to achieve potential savings.

Post-implementation, for all sites (both above and below 8 GWh of annual consumption) each site's pre- and post-implementation AMI data is reviewed monthly to verify that the anticipated changes were implemented with an associated reduction in energy usage apparent in the site's AMI data as well as to monitor and ensure continued implementation of the changes for the duration of the relevant program year. This is done in tandem with automated modeling processes that evaluate projects throughout the week and flag issues with expected implementation through automated alerts.

For some buildings, irregular building operations or other factors may make it impossible to verify the existence or persistence of implemented changes in the site's AMI data, and in such cases the changes will not qualify for the measure. End of year changes will qualify based on Energy Advisor and customer confirmation of the change.

This measure was developed to be applicable to the following program types: Retrofit (RF). If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient case refers to a non-residential building that has completed one or more of the following virtual AMI driven commissioning changes:

- Optimizing equipment schedules (including lighting and exhaust fans)
- Optimizing economizer operation
- Managing HVAC equipment start-up and shut-down schedules
- Identifying HVAC equipment setbacks to address unnecessary usage
- Managing HVAC equipment sequencing to address short cycling
- Optimizing occupied HVAC zone temperature setpoints to operate within building design parameters
- Optimizing chilled and hot water systems
- Lowering compressed air system pressure and/or identifying setbacks
- Resolving of major maintenance issues (e.g. compressed air system leaks)
- Optimizing other non-HVAC equipment operation (e.g. scheduling industrial equipment)

[2146] LBNL Site-Level NMEC Technical Guidance Version 2.0, section 2: Baseline model goodness of fit screening for the target population https://www.cpuc.ca.gov/-/media/cpuc-website/files/legacyfiles/l/6442463695-lbnl-nmec-techguidance-01072020.pdf

The non-residential building must have a utility meter providing hourly or more granular energy consumption.

DEFINITION OF BASELINE EQUIPMENT

The baseline case refers to a non-residential building where where an Energy Advisor reviewing the building's AMI data has observed one or more of the following energy use characteristics:

- Minimal change in energy consumption between suspected occupied and unoccupied periods.
- High energy consumption during suspected unoccupied periods.
- Other patterns in energy use that are not consistent with typical, efficient building operation (such as unexplained spikes or rapid oscillation in energy use which may suggest short cycling)

The non-residential building must have a utility meter providing hourly or more granular energy consumption.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

This measure reflects a combination of savings activities implemented via the building automation system, Strategic Energy Management (SEM), as well as remote and manual O&M related adjustments. The average EUL is assumed to be 7.3 years.[2147]

DEEMED MEASURE COST

The cost to the customer is $0, or very low. Study-based costs will be included in non-incentive costs for the utility program, so the incremental costs of the study-based survey will be included at the program level.

LOADSHAPE

Depending on the baseline conditions, the appropriate loadshapes may be a combination of some, but not all, of the loadshapes below.

Loadshape C02 – Commercial Electric DHW
Loadshape C03 – Commercial Cooling
Loadshape C04 – Commercial Electric Heating
Loadshape C05 – Commercial Electric Heating and Cooling
Loadshape C06 – Commercial Indoor Lighting
Loadshape C07 – Grocery/Conv. Store Indoor Lighting
Loadshape C08 – Health Indoor Lighting
Loadshape C09 – Office Indoor Lighting
Loadshape C11 – Retail Indoor Lighting
Loadshape C13 – Education Indoor Lighting
Loadshape C23 – Commercial Ventilation
Loadshape C54 – Religious Indoor Lighting

COINCIDENCE FACTOR

The measure has deemed coincident peak kW savings therefore a coincidence factor does not apply.

[2147] As defined in the IL-TRM through ComEd EUL Research (https://www.ilsag.info/wp-content/uploads/ComEd-EUL-Research-CY2020-Final-Outcomes-Virtual-Delphi-Panel-2020-12-18.pdf)

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh = kWhbase * PES$$

Where:

ΔkWh = Energy savings for measure (in kWh)

kWhbase = Weather normalized, baseline annual energy use (in kWh)

= Actual [2148]

PES = Percentage energy savings[2149]

Change Type	Weather Normalized, Baseline Annual Energy Use (GWh/year)	Change Type*	PES[2150]
All Types	< 8 GWh	Annual Impact	15.1
		Cooling only	11.7
		Heating only	10.4
		Cooling & Heating	12.1
		Average/Unknown	**14.8**
	> 8 GWh	Use Custom M&V approach[2151]	

*Annual Impact: Changes providing savings year around, e.g. from lighting and ventilation schedules in addition to heating and cooling changes.

Heating: Changes providing savings in heating season only.

Cooling: Changes providing savings in cooling season only.

Cooling & Heating: Changes providing savings in heating and cooling season only, without additional year round savings.

SUMMER COINCIDENT PEAK DEMAND SAVINGS

$$\Delta kW = kWaverage * PDS$$

Where:

kWaverage = Weather normalized, average summer peak demand[2152] (in kW)

[2148] Calculated using a custom modelling approach, normalized to the appropriate TMY dataset.

[2149] The PES should be verified once per plan cycle via a full evaluation of Virtual AMI Driven Commissioning projects based on consumption analysis of project site meter data. This analysis will be used to determine if any updates to the savings assumptions are warranted.

[2150] Power TakeOff & Abacus Energy Works, Prescriptive Program Design for Virtual Commissioning® Using a Deemed Savings Approach, April 2025 & Econoler, Memo – Power TakeOff Virtual VCx Prescriptive Savings Estimate, January 2025. These values represent post evaluation % savings (incorporating an average ex post adjustment of 97.3%) and are adjusted to remove anticipated program cross-participation.

[2151] Following LBNL's Site-Level NMEC Technical Guidance document as referenced above, the custom M&V approach is assumed to follow IPMVP Option C: Whole Facility analysis, using regression modeling techniques, with outdoor air temperature, and time-of-week indicators as the key independent variables.

[2152] Average kW demand is calculated as: an hourly baseline model that is weather normalized (appropriate TMY dataset) and applied to Illinois specific peak hours and averaged across those hours.

PDS = Percentage demand savings[2153]

Change Type	Weather Normalized, Baseline Annual Energy Use (GWh/year)	PDS
Heating Only	n/a	0%
All Other Types	< 8 GWh	9.5%[2154]
	> 8 GWh	Use Custom M&V approach[2155]

FOSSIL FUEL SAVINGS

N/A. While fossil fuel savings can be expected from heating related activities in fossil heated buildings, with limited access to gas AMI data and with evaluations to date focused on electric savings, no prescriptive fossil fuel savings are provided. Programs should use a custom M&V approach if claiming fossil fuel savings.

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI-MSC-VADC-V01-260101

REVIEW DEADLINE: 1/1/2030[2156]

[2153] The PDS should be verified once per plan cycle via a full evaluation of Virtual AMI-Driven Commissioning projects based on consumption analysis of project site meter data. This analysis will be used to determine if any updates to the savings assumptions are warranted.

[2154] Power TakeOff & Abacus Energy Works, Prescriptive Program Design for Virtual Commissioning® Using a Deemed Savings Approach, Addendum A: Updated Peak Demand Savings Calculations, August 2025

[2155] Following LBNL's Site-Level NMEC Technical Guidance document as referenced above, the custom M&V approach is assumed to follow IPMVP Option C: Whole Facility analysis, using regression modeling techniques, with outdoor air temperature, and time-of-week indicators as the key independent variables.

[2156] In order for this measure to continue in this prescriptive form, a full custom evaluation is required within each program plan cycle. The next custom evaluation would therefore be required to allow any adjustments to be made in the 2029 TRM cycle.

4.9.26 Engine Block Heater Controller

DESCRIPTION

The measure is a timer that is activated below a specific outdoor temperature to control an engine block heater in diesel or gasoline equipment. Engine block heaters are typically used during cold weather to pre-warm an engine prior to start, for convenience, heaters are typically plugged in considerably longer than necessary to improve startup performance. A timer allows a user to preset the heater to come on for only the amount of time necessary to pre-warm the engine block, reducing unnecessary run time even if the baseline equipment has an engine block temperature sensor.

This measure was developed to be applicable to the following program types: RF. If applied to other program types, the measure savings should be verified.

DEFINITION OF EFFICIENT EQUIPMENT

The efficient measure is an engine block heater operated by an outdoor plug-in timer (15 amp or greater) that turns on the heater only when the outdoor temperature is below the setting temperature.

DEFINITION OF BASELINE EQUIPMENT

The baseline scenario is an engine block heater that is manually plugged in by the user to facilitate equipment startup at a later time.

DEEMED LIFETIME OF EFFICIENT EQUIPMENT

The expected measure life is assumed to be 3 years.[2157]

DEEMED MEASURE COST

The incremental cost per installed plug-in timer is $150[2158] plus $50 in labor for direct install of wall – and engine-mounted devices, if applicable. No labor cost should be added for the installation of extension cord) devices.[2159]

COINCIDENCE FACTOR

Engine block timers only operate in the winter, so the summer peak demand savings is zero.

Algorithm

CALCULATION OF ENERGY SAVINGS

ELECTRIC ENERGY SAVINGS

$$\Delta kWh_{total} = \Delta\text{kWh}_{\ under\ T_base} + \Delta\text{kWh}_{\ T_base\ to\ T_{effi}} - ParaLd$$

$$\Delta\text{kWh}_{\ under\ T_base} = ISR\ *\ Heating\ Days_{Under\ T_base}\ *\ \%_{Days}\ * \frac{Hr_{base} - Hr_{effi}}{Day}\ *\ kW_{heater}$$

$$\Delta\text{kWh}_{\ T_base\ to\ T_{effi}} = ISR\ *\ (Heating\ Days_{Under\ T_efii} -\ Heating\ Days_{Under\ T_base})\ *\ \%_{Days} * \frac{Hr_{base} - Hr_{timer}}{Day}\ *\ kW_{heater}$$

Where:

[2157] Equipment life is expected to be longer, but measure life is more conservative to account for possible attrition in use over time.

[2158] Estimate based on current market research completed by ICF. Rocky Mountain Power implementers indicated that direct installs are primarily Power Badger (extension cord) installs, which range from $150 to $155.

[2159] Based on current market research completed by ICF

ISR = In Service Rate

= 78.39%[2160]

%Days = Proportion of days timer is used with the heating season

= 84.23%[2161]

T_{base} = Temperature at which controlled engine block heaters is fully operating, use 25°F if unknown

T_{effi} = Setting temperature at which engine block timers shut off the heater, use 50°F if unknown[2162]

Heating days $_{under\ T_base}$ = The number of days in the heating season in which the temperature drops below T_{base} . Use 25°F if unknown[2163]

Climate Zone (City based upon)	Heating days $_{under\ T_base}$
1 (Rockford)	79
2 (Chicago)	68
3 (Springfield)	53
4 (Belleville)	45
5 (Marion/Murphysboro)	27
State-Wide Average	54

Heating days $_{under\ T_effi}$ = The number of days in the heating season in which the temperature drops below T_{effi} . Use 50°F if unknown[2164]

Climate Zone (City based upon)	Heating days $_{under\ T_effi}$
1 (Rockford)	160
2 (Chicago)	166
3 (Springfield)	142
4 (Belleville)	115
5 (Marion/Murphysboro)	123

[2160] Efficiency Vermont (EVT) Technical Reference Manual (TRM), Measure Savings Algorithms and Cost Assumptions, March 16, 2015. Based on field study conducted by Efficiency Vermont on 352 sites in Vermont and Minnesota.

[2161] EVT TRM, March 16, 2015. Based on field study conducted by EVT on 352 sites in Vermont and Minnesota.

2162 RTF: Engine Block Heater Controls Version 1.2. See spreadsheet "Engine Block Heater Controls v3.0.xlsx" for assumptions and calculations used to estimate the typical unit energy savings and incremental costs.

2163 The number of days in the use season in which the temperature drops below 25°F in the state of Illinois. The data is sourced as an average from TMYx weather data for five different weather zones within the state, see 'Ag Op Hours_2023 – IL-Final.xlsx

[2164] National Solar Radiation Data Base – 1991 – 2005 Update: Typical Meteorological Year 3, NREL. Note that cooling days (CD) are calculated by first determining its value from the TMY3 data associated with the appropriate weather station as defined by and used elsewhere in the Illinois TRM. Using the TMY3 outdoor air dry bulb hourly data, the annual hours are totaled for every hour that the outdoor air dry bulb temperature is above a designated zero heat loss balance point temperature or base temperature for cooling. For commercial and industrial (C&I) buildings, a base temperature for heating of 55 oF is designated in the Illinois TRM, but building specific base temperatures are recommended for large C&I projects. Additionally, the TRM uses a 30-year normal data for degree-days while the CD calculation was based on TMY3 data; in order to account for this, calculations of CD were also normalized by the ratio of CDD to align the calculated values more closely with the TRM.

Climate Zone (City based upon)	Heating days under T_effi
State-Wide Average	141.2

Hr_{base} = the baseline run hours per day without the timer

= Use 10.66 hours per day if unknown[2161]

Hr_{effi} = the efficient run hours per day with the timer

= Use 2.90 hours per day if unknown[Error! Bookmark not defined.]

Hr_{timer} = the efficient run hours per day with the timer turned off the heater, 0 hour

kW_{heater} = Connected load of the engine block heater

= 1.5 kW[2165]

ParaLd = Parasitic load

= 5.46 kWh[2166]

SUMMER COINCIDENT PEAK DEMAND SAVINGS

Engine block timers only operate in the winter, so the summer peak demand savings is zero.

FOSSIL FUEL SAVINGS

N/A

WATER AND OTHER NON-ENERGY IMPACT DESCRIPTIONS AND CALCULATION

N/A

DEEMED O&M COST ADJUSTMENT CALCULATION

N/A

MEASURE CODE: CI -MSC-EBHC-V01-270101

REVIEW DEADLINE: 1/1/2029

[2165] EVT TRM, March 16, 2015. Based on field study conducted by EVT on 352 sites in Vermont and Minnesota Based on an average sized engine block heater, which typically ranges in connected load from 0.20 kW and 2 kW, as sourced from Efficiency Vermont program data.

[2166] Ibid.

Appendix 1: Key Commercial OpenStudio Building Model Assumptions

The following table provides the key inputs to the OpenStudio models that are used to develop a number of building specific assumptions within this Volume. These are provided to assist users to select an appropriate building type that best matches the building receiving the measure. More information and the OpenStudio models can be found on the IL TRM Sharepoint Site: TRM Reference Documents: 2nd Volume – Commercial and Industrial Measures: Commercial Building Energy Models.

							Hours of Operation					
					HVAC System Type		Weekdays		Sat		Sun	
Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft²)	Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
Assisted Living	Applies to residential buildings of three of more units with staff to assist the occupants. Gross Floor Area should include all fully-enclosed space within the exterior walls of the building(s) including individual rooms or units, wellness centers, exam rooms, community rooms, small shops or service areas for residents and visitors (e.g. hair salons, convenience stores), staff offices, lobbies, atriums, cafeterias, kitchens, storage areas, hallways, basements, stairways, corridors between buildings, and elevator shafts.	Mix of MidriseApartment and SecondarySchool space types.	2	104,700	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with an economizer	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Auditorium / Assembly	Applies to any performance space such as a theater, arena, or hall. Gross Floor Area should include all space within the building(s), including seating, stage and backstage areas, food service areas, retail areas, rehearsal studios, administrative/office space, mechanical rooms, storage areas, elevator shafts, and stairwells.	Mix of Retail and SecondarySchool space types.	2	127,665	PVAV with gas boiler and HW reheat, equipped with an economizer	PVAV with gas boiler and HW reheat , equipped with an economizer and ERV	11:00 AM	9:00 PM	11:00 AM	9:00 PM	11:00 AM	9:00 PM
Auto Dealership	Applies to facility space used for the retail sale of new or used cars or other vehicles. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas	RetailStandalone	1	24,692	Constant volume packaged rooftop unit with DX cooling and gas heating coil,	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped	7:00 AM	9:00 PM	7:00 AM	10:00 PM	9:00 AM	7:00 PM

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft^2)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
	(refrigerated and non-refrigerated), and administrative areas.				equipped with an economizer	with an economizer						
Childcare/ Pre-School	Applies to any building providing childcare to pre-kindergarten age children.	PrimarySchool	1	40,000	For gym, cafeteria, and kitchen: Constant volume packaged rooftop unit with DX cooling and gas coil, equipped with an economizer For all other spaces: PVAV with gas boiler and HW reheat, equipped with an economizer	PVAV with gas boiler and HW reheat, equipped with an economizer and ERV	7:00 AM	5:00 PM	closed	closed	closed	closed
College	Applies to facility space used for higher education. Relevant buildings include administrative headquarters, residence halls, athletic and recreation facilities, laboratories, etc. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.	SecondarySchool	2	210,887	VAV with water-cooled chiller and gas boiler, equipped with an economizer for all zones except the kitchen Constant volume PSZ-AC with DX cooling and HW coil for the kitchen only Backup gas unit heater for all zones	VAV with water-cooled chiller and gas boiler, equipped with an economizer and ERV Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler for cafeteria and kitchen, equipped with an economizer for both and an	AY: 8 AM Summer: 10 AM	AY: 9 PM Summer: 3 PM	closed	closed	closed	closed

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft²)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
						ERV for the Cafeteria						
Convenience Store	Applies to facility space used for the retail sale of a limited selection of food and beverage products including produce. The total gross floor area should include all supporting functions such as break rooms used by staff, storage areas (refrigerated and non-refrigerated), and administrative areas.	Supermarket	1	7,000	Constant volume PSZ-AC with DX cooling and gas coil, equipped with an economizer	Constant volume PSZ-AC with DX cooling and gas coil, equipped with an economizer	6:00 AM	10:00 PM	6:00 AM	10:00 PM	6:00 AM	10:00 PM
Drug Store	Applies to facility space used for the retail sale of a pharmaceutical products, toiletries, and a limited selection of food and beverage products. The total gross floor area should include all supporting functions such as break rooms used by staff, storage areas (refrigerated and non-refrigerated), and administrative areas. This building type has limited refrigeration loads compared to the Convenience Store.	Stripmall	1	15,000	Constant volume PSZ-AC with DX cooling and gas coil, equipped with an economizer	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with an economizer and an ERV	8:00 AM	8:00 PM	8:00 AM	6:00 PM	8:00 AM	6:00 PM
Elementary School	Applies to a school serving children in any grades from Kindergarten through sixth grade. The total gross floor area should include all supporting functions such as administrative space, conference rooms, kitchens used by staff, lobbies, cafeterias, gymnasiums, auditoria, laboratory classrooms, portable classrooms, greenhouses, stairways, atria, elevator shafts, small landscaping sheds, storage areas, etc.	PrimarySchool	1	73,959	PVAV with gas boiler and HW reheat, equipped with an economizer	PVAV with gas boiler and HW reheat, equipped with an economizer and ERV	AY: 8 AM Summer: 8 AM	AY: 3 PM Summer: 12 PM	closed	closed	closed	closed
Emergency Services	Applies to a building representing office, administrative, and functional space for Police/Fire/EMT style buildings. The building borrows many elements from the Low Rise Office definitions for size, envelope, occupant density, etc., but includes expanded	MediumOffice	1	41,430	Pkgd Rooftop AHU with DX cooling and gas heating, equipped with an economizer Hydronic	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft^2)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
	occupancy schedules and increased equipment loads.				baseboards with gas boiler	economizers and ERVs						
Grocery	Applies to facility space used for the retail sale of food and beverage products. It should not be used by restaurants. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas (refrigerated and non-refrigerated), administrative areas, stairwells, atria, lobbies, etc.	Supermarket	1	45,002	Constant volume PSZ-AC with DX cooling and gas coil , equipped with an economizer	Constant volume PSZ-AC with DX cooling and gas coil , equipped with an economizer	6:00 AM	10:00 PM	6:00 AM	10:00 PM	6:00 AM	10:00 PM
Healthcare Clinic	Applies to a facility space used to provide diagnosis and treatment for medical, dental, or psychiatric outpatient care. Gross Floor Area should include all space within the building(s) including offices, exam rooms, laboratories, lobbies, atriums, conference rooms and auditoriums, employee break rooms and kitchens, rest rooms, elevator shafts, stairways, mechanical rooms, and storage areas.	Outpatient	3	40,946	PVAV with HW heating coil and HW reheat (gas boiler), equipped with an economizer	PVAV with HW heating coil and HW reheat (gas boiler), equipped with an economizer	12:00 AM	12:00 AM	12:00 AM	12:00 AM	8:00 AM	5:00 PM
High School	Applies to facility space used as a school building for 7th through 12th grade students. This does not include college or university classroom facilities and laboratories, vocational, technical, or trade schools. The total gross floor area should include all supporting functions such as administrative space, conference rooms, kitchens used by staff, lobbies, cafeterias, gymnasiums, auditoria, laboratory classrooms, portable classrooms, greenhouses, stairways, atria, elevator shafts, small landscaping sheds, storage areas, etc.	SecondarySchool	2	210,887	VAV with air-cooled chiller and boiler , equipped with an economizer Backup gas unit heater for all zones	VAV with air-cooled chiller and boiler , equipped with an economizer Backup gas unit heater for all zones	AY: 8 AM Summer: 8 AM	AY: 3 PM Summer: 1 PM	closed	closed	closed	closed
Hospital - CAV econ	Applies to a general medical and surgical hospital (including critical access hospitals and children's hospitals) that is either a	Hospital	6	241,500	Constant volume PSZ-AC with gas coil , equipped	Constant volume PSZ-AC with gas coil,	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft²)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
	stand-alone building or a campus of buildings. Spaces more accurately characterized as a Healthcare Clinic should use that definition. The definition of Hospital accounts for all space types that are located within the Hospital building/campus, such as medical offices, administrative offices, and skilled nursing. The total floor area should include the aggregate floor area of all buildings on the campus as well as all supporting functions such as: stairways, connecting corridors between buildings, medical offices, exam rooms, laboratories, lobbies, atria, cafeterias, storage areas, elevator shafts, and any space affiliated with emergency medical care, or diagnostic care.				with an economizer	equipped with an economizer						
Hospital - CAV no econ		Hospital	6	241,500	Constant volume PSZ-AC with gas coil	Constant volume PSZ-AC with gas coil	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Hospital - FCU		Hospital	6	241,500	DOAS with constant volume fans and heating and cooling coils paired with FCU with water-cooled chiller and gas boiler	DOAS with constant volume fans and heating and cooling coils paired with FCU with water-cooled chiller and gas boiler	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Hospital - VAV econ		Hospital	6	241,500	VAV with water-cooled chiller and gas boiler	VAV with water-cooled chiller and gas boiler	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Hotel/ Motel	Applies to buildings that rent overnight accommodations on a room/suite basis, typically including a bath/shower and other facilities in guest rooms. The total gross floor area should include all interior space, including guestrooms, halls, lobbies, atria, food preparation and restaurant space, conference and banquet space, health clubs/spas, indoor pool areas, and laundry facilities, as well as all space used for supporting functions such as elevator shafts, stairways, mechanical rooms, storage areas, employee break rooms, back-of-house offices, etc. Hotel does not apply to fractional ownership properties such as condominiums or vacation timeshares. Hotel properties should be owned by a single entity and have rooms available on a nightly basis. Where distinction between Hotel and Motel	SmallHotel	4	43,202	Guest rooms: PTAC with electric heating Stairs and storage area: Electric Unit Heater Other spaces: Constant volume PSZ-AC with gas coil	All spaces except stairs and storage areas: PTAC with HW heating served by a gas boiler	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Hotel/ Motel - Common		SmallHotel	4	15,930	Stairs and storage area: Electric Unit Heater Other spaces: Constant volume PSZ-AC with gas coil	All spaces except laundry room and storage areas: PVAV with HW heating coil and HW reheat (gas boiler) Laundry room: Constant	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft²)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
	is necessary: Hotel: Room entrances and Corridors are located in the interior of the building. Corridors are conditioned spaces. Building can be significantly larger in size/height. Motel: Room entrances and Corridors are located on the exterior of the building. Corridors are not conditioned spaces. Buildings tend to be two to three stories in height.					volume PSZ-AC with DX cooling and HW coil served by the gas boiler, equipped with an economizer						
Hotel/ Motel - Guest		SmallHotel	4	27,272	PTAC with electric heating	PTAC with HW heating served by a gas boiler	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Manufacturing Facility_ Miscellaneous	Applies to buildings that are dedicated to manufacturing activities. Includes light industry buildings characterized by consumer product and component manufacturing.	Warehouse	1	52,045	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler for the office and storage area HW baseboards for production floor Economizer in the Office space type	7:00 AM	5:00 PM	8:00 AM	4:00 PM	closed	closed

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft²)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
Manufacturing Facility_Food/Chemical	Applies to buildings that are dedicated to manufacturing activities. Includes heavy industry buildings typically characterized by a plant that includes a main production area that has high-ceilings and contains heavy equipment used for assembly line production.	Warehouse	1	52,045	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler for the office and storage area HW baseboards for production floor Economizer in the Office space type	6:00 AM	10:00 PM	8:00 AM	4:00 PM	8:00 AM	4:00 PM
MF - High Rise	Applies to residential buildings with five or more floors, including all public and multiuse spaces within the building envelope. Gross Floor Area should include all fully-enclosed space within the exterior walls of the building(s) including living space in each unit (including occupied and unoccupied units), interior common areas (e.g. lobbies, offices, community rooms, common kitchens, fitness rooms, indoor pools), hallways, stairwells, elevator shafts, connecting corridors between buildings, storage areas, and mechanical space such as a boiler room. Open air stairwells, breezeways, and other similar areas that are not fully-enclosed should not be included in the Gross Floor Area.	HighriseApartment	10	84,351	PTAC with DX cooling and HW heating (gas boiler) Corridors are not conditioned spaces	PTAC with DX cooling and HW heating (gas boiler) Corridors are not conditioned spaces	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
MF - High Rise - Common		HighriseApartment	10	9,309	Constant volume PSZ-AC with DX cooling and HW coil for office space type Corridors are not conditioned spaces and don't have an HVAC system	Constant volume PSZ-AC with DX cooling and HW coil for office space type Corridors are not conditioned spaces and don't have an HVAC system	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
MF - High Rise - Residential		HighriseApartment	10	75,042	PTAC with DX cooling and HW heating (gas boiler)	PTAC with DX cooling and HW heating (gas boiler)	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft^2)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
MF - Mid Rise	Applies to residential buildings with up to four floors, including all public and multiuse spaces within the building envelope. Small Multifamily buildings best described as a house should use the residential measure characterizations.	MidriseApartment	4	33,741	Constant volume PSZ-AC with DX cooling and gas heating in all zones except corridors Electric baseboards in the Corridor space type	Constant volume PSZ-AC with DX cooling and gas heating, equipped with ERV in all zones except corridors Electric baseboards in the Corridor space type	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM	12:00 AM
Movie Theater	Applies to buildings used for public or private film screenings. Gross Floor Area should include all space within the building(s), including seating areas, lobbies, concession stands, bathrooms, administrative/office space, mechanical rooms, storage areas, elevator shafts, and stairwells.	RetailStandalone	1	45,000	PVAV with gas boiler and HW reheat , equipped with an economizer All zones have backup CV gas unit heaters	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with economizer and ERV for some spaces per code requirements	12:00 PM	11:00 PM	10:00 AM	12:00 AM	10:00 AM	10:00 PM
Office - High Rise - CAV econ	Applies to facility spaces in buildings with ten floors or more used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.	LargeOffice	13	498,588	Constant volume packaged rooftop unit with DX cooling and gas coil, equipped with an economizer	Constant volume packaged rooftop unit with DX cooling and gas coil, equipped with an economizer	6:00 AM	10:00 PM	6:00 AM	5:00 PM	closed	closed
Office - High Rise - CAV no econ		LargeOffice	13	498,588	Constant volume packaged rooftop unit with DX cooling and gas coil	Constant volume packaged rooftop unit with DX cooling and gas coil	6:00 AM	10:00 PM	6:00 AM	5:00 PM	closed	closed

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft^2)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
Office - High Rise - FCU		LargeOffice	13	498,588	DOAS with constant volume fans and heating and cooling coils paired with FCU with water-cooled chiller and gas boiler	DOAS with constant volume fans and heating and cooling coils paired with FCU with water-cooled chiller and gas boiler	6:00 AM	10:00 PM	6:00 AM	5:00 PM	closed	closed
Office - High Rise - VAV econ		LargeOffice	13	498,588	VAV with water-cooled chiller and gas boiler with HW reheat in air terminals, equipped with an economizer	VAV with water-cooled chiller and gas boiler with HW reheat in air terminals, equipped with an economizer	6:00 AM	10:00 PM	6:00 AM	5:00 PM	closed	closed
Office - Low Rise	Applies to facility spaces in buildings with four floors or fewer used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.	SmallOffice	1	5,502	Constant volume PSZ-AC with DX cooling and gas coil, equipped with an economizer Backup CV gas unit heaters	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler	6:00 AM	8:00 PM	6:00 AM	5:00 PM	closed	closed
Office - Mid Rise	Applies to facility spaces in buildings with five to nine floors used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.	MediumOffice	5	53,628	PVAV with gas boiler and HW reheat, equipped with an economizer Backup VAV gas unit heaters	PVAV with gas boiler and HW reheat, equipped with an economizer Backup VAV gas unit heaters	6:00 AM	10:00 PM	6:00 AM	5:00 PM	closed	closed

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft²)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
Religious Building	Applies to buildings that are used as places of worship. This includes churches, temples, mosques, synagogues, meetinghouses, or any other buildings that primarily function as a place of religious worship. Gross Floor Area should include all areas inside the building that includes the primary worship area, including food preparation, community rooms, classrooms, and supporting areas such as restrooms, storage areas, hallways, and elevator shafts.	Mix of MediumOffice and SecondarySchool space types	2	44,597	PVAV with gas boiler and HW reheat , equipped with an economizer All zones have backup VAV gas unit heaters	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with economizer and ERV for some spaces per code requirements	5:00 PM	8:00 PM	9:00 AM	3:00 PM	7:00 AM	2:00 PM
Restaurant	Applies to a subcategory of Retail/Service space that is used to provide commercial food services to individual customers, and includes kitchen, dining, and common areas.	FullServiceRestaurant	1	5,502	Constant volume PSZ-AC with DX cooling and HW coil (gas boiler), equipped with an economizer (in the dining space only)	Constant volume PSZ-AC with DX cooling and HW coil (gas boiler), equipped with an economizer and ERV (in the dining space only)	5:00 AM	1:00 AM	6:00 AM	1:00 AM	6:00 AM	1:00 AM
Retail - Department Store	Applies to facility space used to conduct the retail sale of consumer product goods. Stores must be at least 30,000 square feet and have an exterior entrance to the public. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, etc. Retail segments typically included under this definition are: Department Stores, Discount Stores, Supercenters, Warehouse Clubs, Dollar Stores, Home Center/Hardware Stores, and Apparel/Hard Line Specialty Stores (e.g., books, clothing, office products, toys, home goods, electronics). Retail segments excluded under this definition are:	RetailStandalone	1	70,000	Constant volume PSZ-AC with DX cooling and HW coil (gas boiler), equipped with an economizer	Constant volume PSZ-AC with DX cooling and HW coil (gas boiler), equipped with an economizer for all spaces and ERV only for the main retail space (code requirements based on the size of space)	7:00 AM	9:00 PM	7:00 AM	10:00 PM	9:00 AM	7:00 PM

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft^2)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
	Grocery, Drug Stores, Convenience Stores, Automobile Dealerships, and Restaurants.											
Retail - Strip Mall	Applies to facility space used to conduct the retail sale of consumer product goods. Stores must less than 30,000 square feet and have an exterior entrance to the public. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, etc. Retail segments excluded under this definition are: Grocery, Drug Stores, Convenience Stores, Automobile Dealerships, and Restaurants.	RetailStripmall	1	22,500	Constant volume packaged rooftop unit with DX cooling and gas coil, equipped with an economizer Backup CV gas unit heaters	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with economizer for some spaces per code requirements	7:00 AM	9:00 PM	7:00 AM	10:00 PM	9:00 AM	7:00 PM
Warehouse - Nonrefrigerated	Applies to nonrefrigerated buildings that are used to store goods, manufactured products, merchandise or raw materials. The total gross floor area of Nonrefrigerated Warehouses should include space designed to store non-perishable goods and merchandise, and all supporting functions such as offices, lobbies, stairways, restrooms, equipment storage areas, elevator shafts, etc. Nonrefrigerated warehouses also include distribution centers. Existing atriums or areas with high ceilings should only include the base floor area that they occupy. The total gross floor area of nonrefrigerated warehouse should not include outside loading bays or docks. Self-storage facilities, or facilities that rent individual storage units, are not eligible for a rating using the warehouse model.	Warehouse	1	52,045	Constant volume packaged rooftop unit with DX cooling and gas coil, equipped with an economizer for the Office and Fine Storage space types Gas unit heater in bulk Storage space type Backup CV gas unit heaters in the Office and Fine Storage space types	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler, equipped with an economizer for Fine and Bulk space types, and ERV for Bulk only	7:00 AM	5:00 PM	8:00 AM	4:00 PM	closed	closed

Building Type Name	Definition	Prototype Reference Building Model	# Floors	Floor Area (ft^2)	HVAC System Type		Hours of Operation					
							Weekdays		Sat		Sun	
					Existing Buildings	New Construction	Start time	End time	Start time	End time	Start time	End time
Warehouse - Refrigerated	Applies to refrigerated buildings that are used to store goods, manufactured products, merchandise or raw materials. The total gross floor area includes all temperature-controlled area designed to store perishable goods or merchandise under refrigeration at temperatures below 50 degrees Fahrenheit, and all supporting functions such as offices, lobbies, stairways, rest rooms, equipment storage areas, elevator shafts, etc. The total gross floor area of refrigerated warehouse should not include outside loading bays or docks. Self-storage facilities, or facilities that rent individual storage units, are not eligible for a rating using the warehouse model.	Warehouse	2	249,600	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler for the Office space type No HVAC system in Fine and Bulk Storage space types (refrigerated storage)	Constant volume PSZ-AC with DX cooling and HW coil served by a gas boiler for the Office space type No HVAC system in Fine and Bulk Storage space types (refrigerated storage)	7:00 AM	5:00 PM	8:00 AM	4:00 PM	closed	closed
Medical Office	Applies to outpatient medical office buildings such as physician offices, dental offices, and similar healthcare office facilities that primarily operate during standard business hours (7am-5pm M-F).	MediumOffice	4	95,888	PVAV with gas boiler and HW reheat, equipped with an economizer Backup VAV gas unit heaters	PVAV with gas boiler and HW reheat, equipped with an economizer Backup VAV gas unit heaters	7:00 AM	5:00 PM	closed	closed	closed	closed